# Walmart

# MAJOR PROJECTS 2022

LAKE CITY, FL
STORE NO.: 0767-247

REMODELED SQ FT: 10,000
EXISTING SQFT: 201,789
PROTO CYCLE: 09/24/21
DATE: 11/22/21
PROTO: 188 PROTO SC

## DRAWING INDEX


| | | | |
|---|---|---|---|
| GENERAL | | R2 | REFRIGERATION SCHEDULES |
| C1 | COVER SHEET | R3 | REFRIGERATION DETAILS |
| C2 | RESPONIBILITY MATRIX | | |
| N1 | GENERAL INFORMATION | ELECTRICAL | |
| SA1 | SCHEDULES AND ALLOWANCES | BAS1 | BUILDING AUTOMATION SYSTEM |
| LS1 | LIFE SAFETY PLAN | E1 | LIGHTING PLAN |
| | | E1.1 | ENLARGED LIGHTING PLANS |
| ARCHITECTURAL | | E1.2 | ENLARGED LIGHTING PLANS |
| SP1 | SITE PLAN | E1.3 | LIGHTING DETAILS AND SCHEDULES |
| D1 | DEMOLITION PLAN | E2 | POWER PLAN |
| A1 | FLOOR PLAN | E2.1 | POWER DROP PLAN |
| A1.1 | FLOOR FINISH PLAN | E2.2 | ENLARGED POWER PLANS |
| A2 | EXTERIOR ELEVATIONS | E2.3 | ENLARGED POWER PLANS |
| A2.1 | EXTERIOR DETAILS AND SIGNAGE | E3 | ELECTRICAL DETAILS |
| A3 | SECTIONS AND DETAILS | E4 | ELECTRICAL ONE-LINE DETAILS AND SCHEDULES |
| A4 | ROOF PLAN AND DETAILS | E4.1 | PANELBOARD SCHEDULES |
| A5 | ENLARGED PLANS, ELEVATIONS, AND DETAILS | RE1 | REFRIGERATION ELECTRICAL PLAN |
| A5.4 | ENLARGED PLANS AND DETAILS | T1 | TELECOM PLAN |
| A6 | REAR OFFICE PLAN | | |
| A6.1 | PARTITION TYPES AND WALL DETAILS | RACKING | |
| A8 | DOOR AND ROOM FINISH SCHEDULE | FXS1 | FXS1 FIXTURE ANCHORAGE PLAN AND NOTES |
| AC1 | AUTOCENTER PLAN AND DETAILS | FXS2 | FIXTURE ANCHORAGE DETAILS |
| GC1 | GARDEN CENTER PLAN AND DETAILS | | |
| MC1 | MONEY CENTER FLOOR PLAN, DETAILS AND SCHEDULES | SPECIAL ELEMENTS | |
| RXPFC | PAINT, FIX, CLEAN (PFC) PLAN AND DETAILS | OS1 | OWNER SUPPLIED ITEMS |
| GA1 | FRONT GROCERY PLAN | | |
| GA1.1 | FRONT GROCERY FINISH PLAN | | |
| GA2 | REAR GROCERY PLAN | | |
| GA3 | GROCERY DETAILS | | |
| GA5 | RESPONSIBILITY SCHEDULES | | |
| | | | |
| PLUMBING | | | |
| P1 | OVERALL & ENLARGED PLUMBING PLANS | | |
| P2 | PLUMBING DETAILS AND SCHEDULES | | |
| | | | |
| MECHANICAL | | | |
| M1 | OVERALL & ENLARGED MECHANICAL PLANS, DETAILS & SCHEDULES | | |
| | | | |
| REFRIGERATION | | | |
| BASR1 | REFRIGERATION BUILDING AUTOMATION SYSTEM PLAN | | |
| BASR2 | REFRIGERATION BUILDING AUTOMATION SYSTEM DETAILS | | |
| R1 | REFRIGERATION PLANS | | |


### BUILDING CODE SUMMARY

| | | |
|---|---|---|
| | NAME OF PROJECT | LAKE CITY, FL |
| WT | STREET ADDRESS | 2767 W US HIGHWAY 90 |
| | STORE MANAGER | MATTHEW STANLEY |
| | PROPOSED USE | MERCANTILE |
| CODES | BUILDING CODE | 2020 FLORIDA BUILDING CODE - BUILDING, 7TH EDITION |
| | EXISTING BUILDING CODE | 2020 FLORIDA BUILDING CODE - EXISTING BUILDING, 7TH EDITION |
| | ELECTRICAL CODE | 2017 NATIONAL ELECTRICAL CODE |
| | PLUMBING CODE | 2020 FLORIDA BUILDING CODE - PLUMBING, 7TH EDITION |
| | MECHANICAL CODE | 2020 FLORIDA BUILDING CODE - MECHANICAL, 7TH EDITION |
| | FIRE CODE | 2020 FIRE PREVENTION CODE - 7TH EDITION |
| | ACCESSIBILITY CODE | 2020 FLORIDA BUILDING CODE - ACCESSIBILTY, 7TH EDITION |
| | LIFE SAFETY | 2020 FLORIDA FIRE PREVENTION CODE, 7TH EDITION (NFPA 1 & 101) |
| OCCUPANCY | M - MERCANTILE; WHOLESALE OR RETAIL STORE (MAIN USE) | - SECT 309.1 |
| | S1 - STORAGE AREA; MOTOR VEHICLE STATION AND RECEIVING AND STOCKROOMS (MIXED USE) | - SECT 311.2 |
| | A2 - ASSEMBLY USE; BREAKROOM AND FOOD TENANT (ACCESSORY TO MAIN USE) | - SECT 303.1 |
| | B - BUSINESS; NON FOOD TENANT (ACCESSORY TO MAIN USE) | - SECT 304.1 |
| TYPE OF CONSTRUCTION | II-B UNPROTECTED (SPRINKLERED) | PER SECT 602.2 AND TABLES 601 AND 602 |
| ALLOWABLE AREA | UNLIMITED | SECTION 507.2 SECTION 507.3 |
| FIRE PROTECTION | BUILDING IS EQUIPPED THROUGHOUT WITH AN AUTOMATIC SPRINKLER SYSTEM AND IS SURROUNDED ON ALL SIDES BY 60 FEET MINIMUM OF PERMANENT OPEN SPACE. UNLIMITED AREA CRITERIA IS APPLICABLE. | |
| CLASSIFCATION OF WORK - (EXISTING BUILDING CODE) | LEVEL 2 - ALTERATIONS INCLUDE THE RECONFIGURATION OF SPACE, THE ADDITION OR ELIMINATION OF ANY DOOR OR WINDOW, THE RECONFIGURATION OR EXTENSION OF ANY SYSTEM, OR THE INSTALLATION OF ANY ADDITIONAL EQUIPMENT. | |
| EGRESS | NO CHANGES PROPOSED TO THE EIXSTING BUILDING AREA, OCCUPANCY OR EGRESS. ALL EXISTING EXITS TO REMAIN. | |

NOTE: EXISTING SQUARE FOOTAGE, EXISTING PATHS AND EGRESS WIDTH WILL NOT BEW IMPACTED BY THE REMODEL SCOPE OF WORK

NOTE: EXISTING BUILDING ALTERATION IS LEVEL 2

NOTE: BUILDING WILL BE OCCUPIDE DURING CONSTRUCTION, AREAS WILL BE SECTIONED OFF WITH DUST PARTITIONS OR SECURITY FENCING AS NEEDED.

### INTERIOR WALL AND CEILING FINISH REQUIREMENTS BY OCCUPANCY TABLE 803.11

| GROUP | INTERIOR EXIT STAIRWAY AND RAMPSOAND EXIT PASSEGEWAY | CORRIDORS AND ENCLOSURE FOR EXIT ACCESS STAIRWAYS AND RAMPS | ROOMS AND ENCLOSED SPACES |
|---|---|---|---|
| A1 & A2 | B | B | C |
| B,E,M,R-1 | B | C | C |
| S | B | C | C |
| CLASS A: FLAME SPREAD INDEX 0-25; SMOKEDEVELOPED INDEX 0-450 | | | |
| CLASS B: FLAME SPREAD INDEX 26-75; SMOKEDEVELOPED INDEX 0-450 | | | |
| CLASS C: FLAME SPREAD INDEX 76-200; SMOKEDEVELOPED INDEX 0-450 | | | |

Columbia County Building Department
Plans Reviewed for Code Compliance
State of Florida

### VICINITY MAP

### GENERAL SCOPE OF WORK

- EXTERIOR SURFACES: CLEAN, PREP AND PAINT
- INTERIOR WALLS: CLEAN, PREP AND PAINT
- PHARMACY: PAINT, FIX AND CLEAN AS NOTED
- PHOTO LAB: RELOCATE
- GARDEN CENTER: REFURBISH AS NOTED/CLEAN AND PAINT
- CUSTOMER SERVICE: REMODEL AS NOTED.
- FLOOR TILE: REPAIR/REPLACE AS NOTED.
- GROCERY: REMODEL, REPAIR/REPLACE EQUIPMENT AS NOTED
- ENTRY VESTIBULE: CLEAN AND PAINT
- SIGNAGE: INSTALL/REPLACE EXTERIOR SIGNS AS NOTED
- AUTO CENTER: REFURBISH
- VISION CENTER: PAINT, FIX AND CLEAN AS NOTED
- MONEYCENTER: CLEAN AND PAINT AS NOTED, AND REMODEL EXISTING MONEY CENTER

### GENERAL NOTES

1. BUILDING WILL BE FULLY SPRINKLERED AS REQUIRED BY CONTRACT DOCUMENTS. SUBMIT FIRE SPRINKLER SYSTEM DRAWINGS AND CALCULATIONS TO AUTHORITIES HAVING JURISDICTION (FIRE DEPARTMENT, FIRE MARSHAL, ETC). OBTAIN ALL APPROVALS PRIOR TO FABRICATION OR INSTALLATION.
2. OWNER WILL PROVIDE, OR HAS ALREADY PROVIDED, FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 10. AUTHORITY HAVING JURISDICTION WILL APPROVE FINAL FIRE EXTINGUISHER LOCATIONS.
3. WAL-MART'S ALARM CENTRALS ENGINEERING TEAM HAS CONTACTED THE AUTHORITY HAVING JURISDICTION FOR PRE-PLAN DATA ABOUT STATE AND LOCAL REQUIREMENTS THAT DIFFER FROM THE NATIONALLY PUBLISHED CODES AND STANDARDS. A COMPLETE SITE SPECIFIC SUBMITTAL IS BEING MADE DIRECTLY TO THE AUTHORITY HAVING JURISDICTION. QUESTIONS SHOULD BE DIRECTED TO 1-800-530-9924, OPTION 3.
4. THE MAXIMUM STORAGE HEIGHT IS TWELVE FEET EXCEPT IN THE GENERAL MERCHANDISE RECEIVING AREA IMMEDIATELY ADJACENT TO THE DOCK DOORS. THE STOCKROOM WILL HAVE A STACKING HEIGHT OF 15 FEET OF CLASS I-IV COMMODITIES IN FIXED, SINGLE AND DOUBLE ROW RACKS. THE STACKING HEIGHT OF THE ROLLING RACK AREA WILL NOT EXCEED 12 FEET.
5. REFER TO SPECIFICATION SECTIONS 01600 - PRODUCT REQUIREMENTS AND APPENDIX A - PRODUCTS AND WORK BY OWNER OR SEPARATE CONTRACTOR. THESE SECTIONS INCLUDE SPECIFIC INFORMATION REGARDING ITEMS AND SERVICES TO BE FURNISHED AND INSTALLED BY INDIVIDUALS OTHER THAN THE GENERAL CONTRACTOR.
6. REINSTALL ALL FIRE EXTINGUISHERS IMMEDIATELY FOLLOWING COMPLETION OF FINAL FINISH TO MOUNTING SURFACE.
7. REFER TO GENERAL CONTRACTOR PERMIT, REGISTRATION, NOTIFICATION INSPECTION & INSTALLER CERTIFICATION(GCPRN) REPORT LOCATED IN GC PERMIT INFORMATION FOLDER ON OWNER'S DOCUMENT DELIVERY WEBSITE.

| ARCHITECTURAL | STRUCTURAL | MECHANICAL/PLUMBING | REFRIGERATION | ELECTRICAL | RACKING | CIVIL | BUILDING OFFICIAL |
|---|---|---|---|---|---|---|---|
| CUHACI & PETERSON LLC<br>ANTHONY D MURPHY<br>2600 MAITLAND CENTER PRWY. STE. #200<br>ORLANDO, FLORIDA 32751<br>407-661-9100 | JOHNSTON BURKHOLDER ASSOCIATES<br>BART J. HALVERSON<br>930 CENTRAL STREET<br>KANSAS CITY, MO 64105<br>816-421-4200 | CUHACI & PETERSON LLC<br>JOSE J. DIAZ<br>2600 MAITLAND CENTER PRWY. STE. #200<br>ORLANDO, FLORIDA 32751<br>407-661-9100 | HENDERSON ENGINEERS<br>TREVOR G. JONES<br>8345 LENEXA DRIVE, SUITE 300<br>LENEXA, KANSAS 66214<br>913-742-5001 | CUHACI & PETERSON<br>JAISON P. MORAS<br>1925 PROSPECT AVENUE<br>ORLANDO, FL 32814<br>407-661-9100 | JOHNSTON BURKHOLDER ASSOCIATES<br>BART J. HALVERSON<br>930 CENTRAL STREET<br>KANSAS CITY, MO 64105<br>816-421-4200 | CPH<br>HOWARD L. RAY<br>500 WEST FULTON STREET<br>SANFORD, FLORIDA 32771<br>407-322-6841 | CITY OF LAKE CITY<br>DAVE YOUNG<br>205 N. MARION AVE.<br>LAKE CITY, FL 32055<br>386-719-5752 |


3600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.cuhaci-peterson.com
Cuhaci & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT TO BE CONSTRUCTED ON ANY OTHER PROJECT. ALL CONTEMPORANEOUSLY WITH IT'S ISSUE. DIFFERENT PROJECT SITE, OR AT A LATER TIME WITHOUT THE EXPRESS WRITTEN CONSENT OF CUHACI & PETERSON ARCHITECTS. ANY REUSE WITHOUT SUCH CONSENT SHALL BE AT THE RECIPIENT'S SOLE RISK AND WITHOUT LIABILITY TO THE ARCHITECT AND CONSULTANTS. THE RECIPIENT SHALL INDEMNIFY AND HOLD HARMLESS THE ARCHITECT AND CONSULTANTS FROM ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES INCLUDING ATTORNEY'S FEES ARISING OUT OF OR RESULTING THEREFROM. SUBMISSION OR DISTRIBUTION OF THIS PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
JOB NUMBER: 210335 PROTO: 188 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | LS |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

ANTHONY D MURPHY
STATE OF FLORIDA
REGISTERED ARCHITECT
AR100424
12/20/21

COVER SHEET

SHEET: C1

12/20/2021 4:47:19 PM
C:\Users\jaclaus.hargrove\Documents\WORKT_LakeCity_FL_188_L_ARCH_VOB_jaclaus.hargrovejaclaus.rvt

# RESPONSIBILITY MATRIX

THE PURPOSE OF THIS DOCUMENT IS TO PROVIDE EASY ACCESS TO SOME OF THE IMPORTANT INFORMATION NEEDED FOR THIS PROJECT. THIS MATRIX IS NOT AN INCLUSIVE SCOPE OF WORK AND DOES NOT REPLACE THE REQUIREMENTS IDENTIFIED IN THE REST OF THE CONTRACT DOCUMENTS.

| ITEM DESCRIPTION | FURNISHED BY | INSTALLED BY | COORDINATION TASK | CONTACT | PHONE & EMAIL | LOCATION IN DOCUMENTS |
|---|---|---|---|---|---|---|
| RESTROOM PARTITION FIELD VERIFICATION TEMPLATE - SUBMISSION TO THE PRE-SELECTED SUPPLIER | GC | GC | GC - COMPLETE THE TEMPLATE AND RETURN EARLY TO ENSURE ON-TIME DELIVERIES OF PARTITIONS. | HJC | 800-459-7099<br>WWW.HJCINC.COM/TPDEMS.PDF | SPECIFICATION 10160 |
| OWNER'S INDEPENDENT EXTERIOR COATINGS INSPECTION | OWNER | OWNER | GC TO NOTIFY OWNER'S 3RD PARTY INSPECTOR OF EXPECTED DATE OF EXTERIOR PAINT COMPLETION | FLAGSIN GROUP | (770) 515-9143;<br>KELLY@FLAGSINGROUP.COM<br>KELLY COLLINS | N/A |
| MONITOR SUPPORT KIT AND WALL MOUNTED MONITOR BRACKET FOR ALL MONITORS EXCLUDING THE PICK-UP ORDER READY BOARD (ORB) AND OVERSIZED ITEMS MONITOR (OIM) | OWNER | GC | GC PROVIDES POWER DROP; DATA CONTRACTOR TO PROVIDE DATA DROP; GC INSTALL SUPPORT TO JOIST/BLOCKING AT WALL, POLE BRACKET & MOUNT; OWNER'S INSTALLER PROVIDES & INSTALLS TV AND DRIVER | WREN SOLUTIONS | (573) 893-2249<br>ORDERS@WRENSOLUTIONS.COM | A5, 7/A9, GA1, AC1, MC1, PHM1 & PH1<br><br>APPENDIX A : OWNER... |
| MONITOR SUPPORT KIT AND WALL MOUNTED MONITOR BRACKET USED FOR THE PICK-UP ORDER READY BOARD (ORB) AND OVERSIZED ITEMS MONITOR (OIM) | GC | GC | GC PROVIDES POWER DROP; DATA CONTRACTOR TO PROVIDE DATA DROP; GC INSTALL SUPPORT TO JOIST/BLOCKING AT WALL, POLE BRACKET & MOUNT; OWNER'S INSTALLER PROVIDES & INSTALLS TV AND DRIVER | WREN SOLUTIONS | (573) 893-2249<br>ORDERS@WRENSOLUTIONS.COM | A5, GA1, BR1 & AC1 |
| SCENT SYSTEM | OWNER | OWNER (THIRD PARTY VENDOR) | COORDINATE INSTALL WITH OWNER SUPPLIED VENDOR AFTER RESTROOM ELECTRICAL WORK IS COMPLETE PER SPEC | PROLITEC, INC | MELISSA MAKER<br>CUSTOMER CARE-DISPATCHER,<br>PROLITEC, INC.<br>414.615.4602 | SPECIFICATIONS APPENDIX A |
| NEW AUTO SLIDING DOOR PACKAGES, INCLUDING NEW PICKUP OR EXPANSION DOORS. | OWNER | OWNER | GC TO CONFIRM DOOR MANUFACTURER'S ROUGH OPENING AND DRAWINGS DIMENSIONS BEFORE DOORS CAN BE BUILT AND SHIPPED. DOOR PRODUCTION DOES NOT BEGIN UNTIL ROUGH OPENINGS ARE CONFIRMED. | STANLEY ACCESS TECHNOLOGIES<br><br>RECORD-USA | STANLEY ACCESS TECHNOLOGIES,<br>FARMINGTON, CT<br>CONTACT: CARLA MESSINA, NATIONAL ACCOUNTS PROJECT MANAGER,<br>(860) 801-0267<br><br>RECORD-USA<br>MONROE, NC<br>CONTACT: DAVID PICKERS, VP OF DIRECT SALES,<br>(704) 315-7392 | REF SPECIFICATION 01600 FOR LONG LEAD TIMES |
| REPLACEMENT OF EXISTING AUTO SLIDING DOOR INCLUDING PICK-UP & OTHER LOCATIONS | OWNER | OWNER | STANLEY DISPATCHES TECHNICIAN TO CONFIRM EXISTING CONDITIONS AND ROUGH OPENINGS | STANLEY ACCESS TECHNOLOGIES<br><br>RECORD-USA | STANLEY ACCESS TECHNOLOGIES,<br>FARMINGTON, CT<br>CONTACT: CARLA MESSINA, NATIONAL ACCOUNTS PROJECT MANAGER,<br>(860) 801-0267<br><br>RECORD-USA<br>MONROE, NC<br>CONTACT: DAVID PICKERS, VP OF DIRECT SALES,<br>(704) 315-7392 | |
| AP GATE CALIBRATION - REPLACE CHECKLIST W/ SIMPLFIED START/COMPLETION DATES IN SPOCK | | OWNER | GC ADDS DATES TO SPOCK FOR:<br>1. COMPLETION<br>2. READY FOR CALIBRATION<br><br>TECHNIBUILT (WANZL) COORDINATES CALIBRATION OF EQUIPMENT | TECHNIBUILT (WANZL) | FRANCIS PYLE<br>FRANCIS.PYLE@WANZL.COM<br><br>DEAN KEATON<br>DEAN.KEATON@WANZL.COM | N/A |
| | | | | | | |
| SALVAGE PICKUP REFRIGERATION EQUIPMENT | N/A | N/A | PROPAK:<br>1. GC TO REMOVE REFRIGERATED EQUIPMENT. PROPAK TO DECOMMISSION EQUIPMENT AND REMOVE REFRIGERANT.<br>2. GC TO PALLETIZE EQUIPMENT AND CONTACT PROPAK FOR REMOVAL.<br><br>HUSSMANN:<br>1. HUSSMANN TO DECOMMISSION AND SALVAGE REFRIGERATED CASES TO BE RE-USED FOR NEW OGP ACTIVATIONS.<br>2. GC RESPONSIBLE FOR ALL OTHER SCOPE DUE TO OGP CASE REMOVAL, INCLUDING REMOVAL OF DOOR FRAMES AS NEEDED. | PROPAK<br><br>HUSSMANN | PROPAK CONTACT: DONALD PARTAIN - walmart@propak.com<br><br>HUSSMANN CONTACT: RANDY BADSKY - Randy.Badsky@Hussmann.com | SPEC SECT 02023 |
| | | | | | | |
| DIRECTION FOR EXTERIOR VERTICAL WALL JOINT MATERIAL REPLACEMENT DURING REPAINTS. | OWNER | GC | AOR - ADD NOTE TO REPLACE THE VERTICAL WALL JOINTS IF STORE'S LAST RE-PAINT WAS 5 YEARS OR MORE &/OR 3RD PARTY INSPECTION INDICATES JOINT REPLACEMENT. | WM FIELD MAINTENANCE | MARTI.JOHNSON@WALMART.COM | 07900 SEALANT |
| POWER FOR FUTURE SELF SERVICE PROPANE EXCHANGE | GC | GC | IF EXISTING 110V POWER IS NOT AVAILABLE ADD POWER AT EXISTING PROPANE STORAGE UNITS. | BLUE RHINO<br><br>AMERIGAS | BLUE RHINO:<br>DANNY THURMOND,<br>(336) 608-1585, DTHURMOND@BLUERHINO.COM<br><br>AMERIGAS:<br>SAMANTHA BURCKHARD,<br>(510) 589-4575, SAMANTHA.BURCKHARD@AMERIGAS.COM. | E2 |
| COORDINATION OF ACC TIRE EQUIPMENT (TIRE CHANGER & BALANCER ONLY) | OWNER | OWNER | GC TO CONTACT VENDORS WHEN STORE IS READY FOR INSTALLATION | HUNTER (AR & MO ONLY), HENNESEY | HUNTER (AR & MO ONLY):<br>SHARON NORTHCUTT,<br>(314) 716-0365 SNORTHCUTT@HUNTER.COM<br><br>HENNESEY:<br>DON BAXTER<br>(800) 688-6359 X 7857 | N/A |
| CLARIFY CURRENT METHODS FOR PROVIDING A TEMPORARY RESTROOM TRAILER FOR STORES WITH SINGLE RESTROOM PAIR | GC | GC | GC COORDINATES LOCATION OF TEMPORARY RR TRAILER WITH OWNER'S CONSTRUCTION MGR. REVIEW UPDATED SPECIFICATION FOR LIST OF VENDORS, UTILITY CONNECTIONS, IF ADA ACCOMODATION IS REQUIRED, ETC. | LOCAL OR NATIONWIDE TRAILER LEASING COMPANY. SEE... | SEE SPECIFICATION | SPECIFICATION SECTION 01500 |
| CHANGE THE REMOVAL AND INSTALLATION OF THE REFRIGERATED CASE KICK PLATE FROM REFRIGERATION CONTRACTOR RESPONSIBILTY TO GC RESPONSIBILITY | OWNER | GC | GC COORDINATES REMOVAL AND REINSTALLATION TIMES WITH PFC | N/A | N/A | A1.1 FLOOR FINISH RESPONSIBILITY MATRIX |
| REPLACE SCREW ANCHORED 4" X 32" SS BOLLARDS AT ENTRY SLIDING DOORS BEING UPDATED WITH NEW RUBBER FLOOR AND AT EAS PEDESTALS BEING REPLACED AT EOL. | OWNER | GC | BOLLARDS INDICATED ON THE DRAWINGS WILL BE SHIPPED TO THE STORE FOR GC INSTALL. | MCCUE CORPORATION | MCCUE CORPORATION: KAITLYN THIBAULT, (800) 800-8503,<br>KTHIBAULT@MCCUE.COM | A1, A5, GC1, AC1 |
| RESTROOM - TILE, GROUT & SETTING MATERIALS & LAV DECK SYSTEM NEED A MINIMUM 2-3 WEEKS FROM TIME OF ORDER TO DELIVERY | GC | GC | FACTORS THAT AFFECT THE MINIMUM ORDER TIME FRAME:<br>P.O. PROCESSING TIME - VARIES WITH EACH CONTRAVTOR (1-3 D)<br>NUMBER OF PROJECTS IN PIPELINE OF THE GC'S THAT GOT IN LINE 1ST (VARIES)<br>TRUCKLOAD - TRUCK LINE-UP SCHEDULE VARIES (7-10 D NOTICE MIN.)*<br>*ALT DELIVERY (ADDS COST) LTL LOADS REQUIRE 4-5 D NOTICE (IF AVAILABLE) NORMAL TRANSIT (1-4D) | HJC | 800-459-7099<br>WWW.HJCINC.COM/TPDEMS.PDF | |
| RUBBER FLOOR | PFC | PFC | RUBBER FLOORING PURCHASED THROUGH HJC AND INSTALLED BY PREFERRED FLOORING CONTRACTOR. GENERAL CONTRACTOR RECEIVES AND STORES RUBBER FLOORING ON SITE. | N/A | N/A | A5 |
| SPILL STATION ATTACHMENTS | GC | GC | GC TO COORDINATE WITH IN-STORE AP MANAGER ON LOCATION OF WHERE TO ATTACH CLEAN/SPILL STATIONS WITHIN THE STORE | N/A | N/A | SA1 BID ALLOWANCE SCHEDULE |
| PLUMBING LINE JETTING AND CAMERA SCOPING FOR RESTROOM REFRESH PROJECTS | GC | GC | GC TO JET PLUMBING LINES AND CAMERA SCOPE PLUMBING LINES AFTER WORK IN RESTROOM AREA IS COMPLETE. THE PRIMARY PURPOSE OF SCOPING IS TO ENSURE PLUMBING LINES ARE FREE OF CONSTRUCTION RELATED DEBRIS AND OBSTRUCTIONS. ANY STRUCTURAL ISSUES IDENTIFIED DURING SCOPING TO BE ADDRESSED WITH WM CONSTRUCTION MANAGER. | N/A | N/A | P1.1 |
| ACUITY BLT LIGHT FIXTURES | GC | GC | GC TO VERIFY TOTAL NUMBER OF 2X4 LIGHT FIXTURES TO BE REPLACED WITH NEW 2X2 ACUITY FIXTURES AND ORDER THROUGH SUPPLIER LOEB | LOEB ELECTRIC | LOEB ELECTRIC:<br>ANDREW KELLERMAN<br>614-421-3383<br>andrew.kellerman@loebelectric.com | E1 |
| | | | | | | |


2600 Maitland Center Parkway
Suite 250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cpaarchitects.com


Cabaret & Peterson
Architects Engineers Planners

STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT TO BE USED ON ANY OTHER PROJECT OR EXTENSION OF THIS PROJECT AT A LATER DATE OR FOR ANY OTHER PROJECT WITHOUT THE EXPRESS WRITTEN CONSENT OF THE ARCHITECT. ANY UNAUTHORIZED REUSE OF THESE PLANS WITHOUT SUCH CONSENT WILL BE CONSIDERED AN INFRINGEMENT OF THE COPYRIGHT LAWS. ALL RIGHTS RESERVED UNDER FEDERAL LAW. COPYRIGHT © 2021 CABARET & PETERSON ARCHITECTS ENGINEERS PLANNERS, INC.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210535 | PROTO | 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| CHECKED BY: | | ADM |
| DRAWN BY: | | YB |
| PROTO CYCLE: | | 09/24/21 |
| DOCUMENT DATE: | | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURRY
REGISTERED ARCHITECT
AR100424
12/20/21

RESPONIBILITY MATRIX

SHEET: C2

12/20/2021 4:12:03 PM
C:\Users\yb\Desktop\Documents\WORK_Lake City_FL_Hwy_U_ARCH_VSL.jpr\Res.responsibility.rvt

# STRIPING CONDITIONS




STRIPING AT HAZMAT

STRIPING AT BALER

STRIPING AT COMPACTOR

STRIPING REQUIREMENTS
1. 5" WIDE PAINTED STRIPES (P5) @ 12" ON CENTER, @ 45 DEGREE ANGLE TO 5" WIDE EXTERIOR BOUNDARY LINES
2. IF EXISTING HALLWAY, BALER, COMPACTOR, OR EYEWASH WARNING AREAS ARE PAINTED SOLID OR HAVE INCORRECT PATTERN, REMOVE EXISTING PAINT AND PAINT PER THE STRIPING CONDITIONS SHOWN HERE.
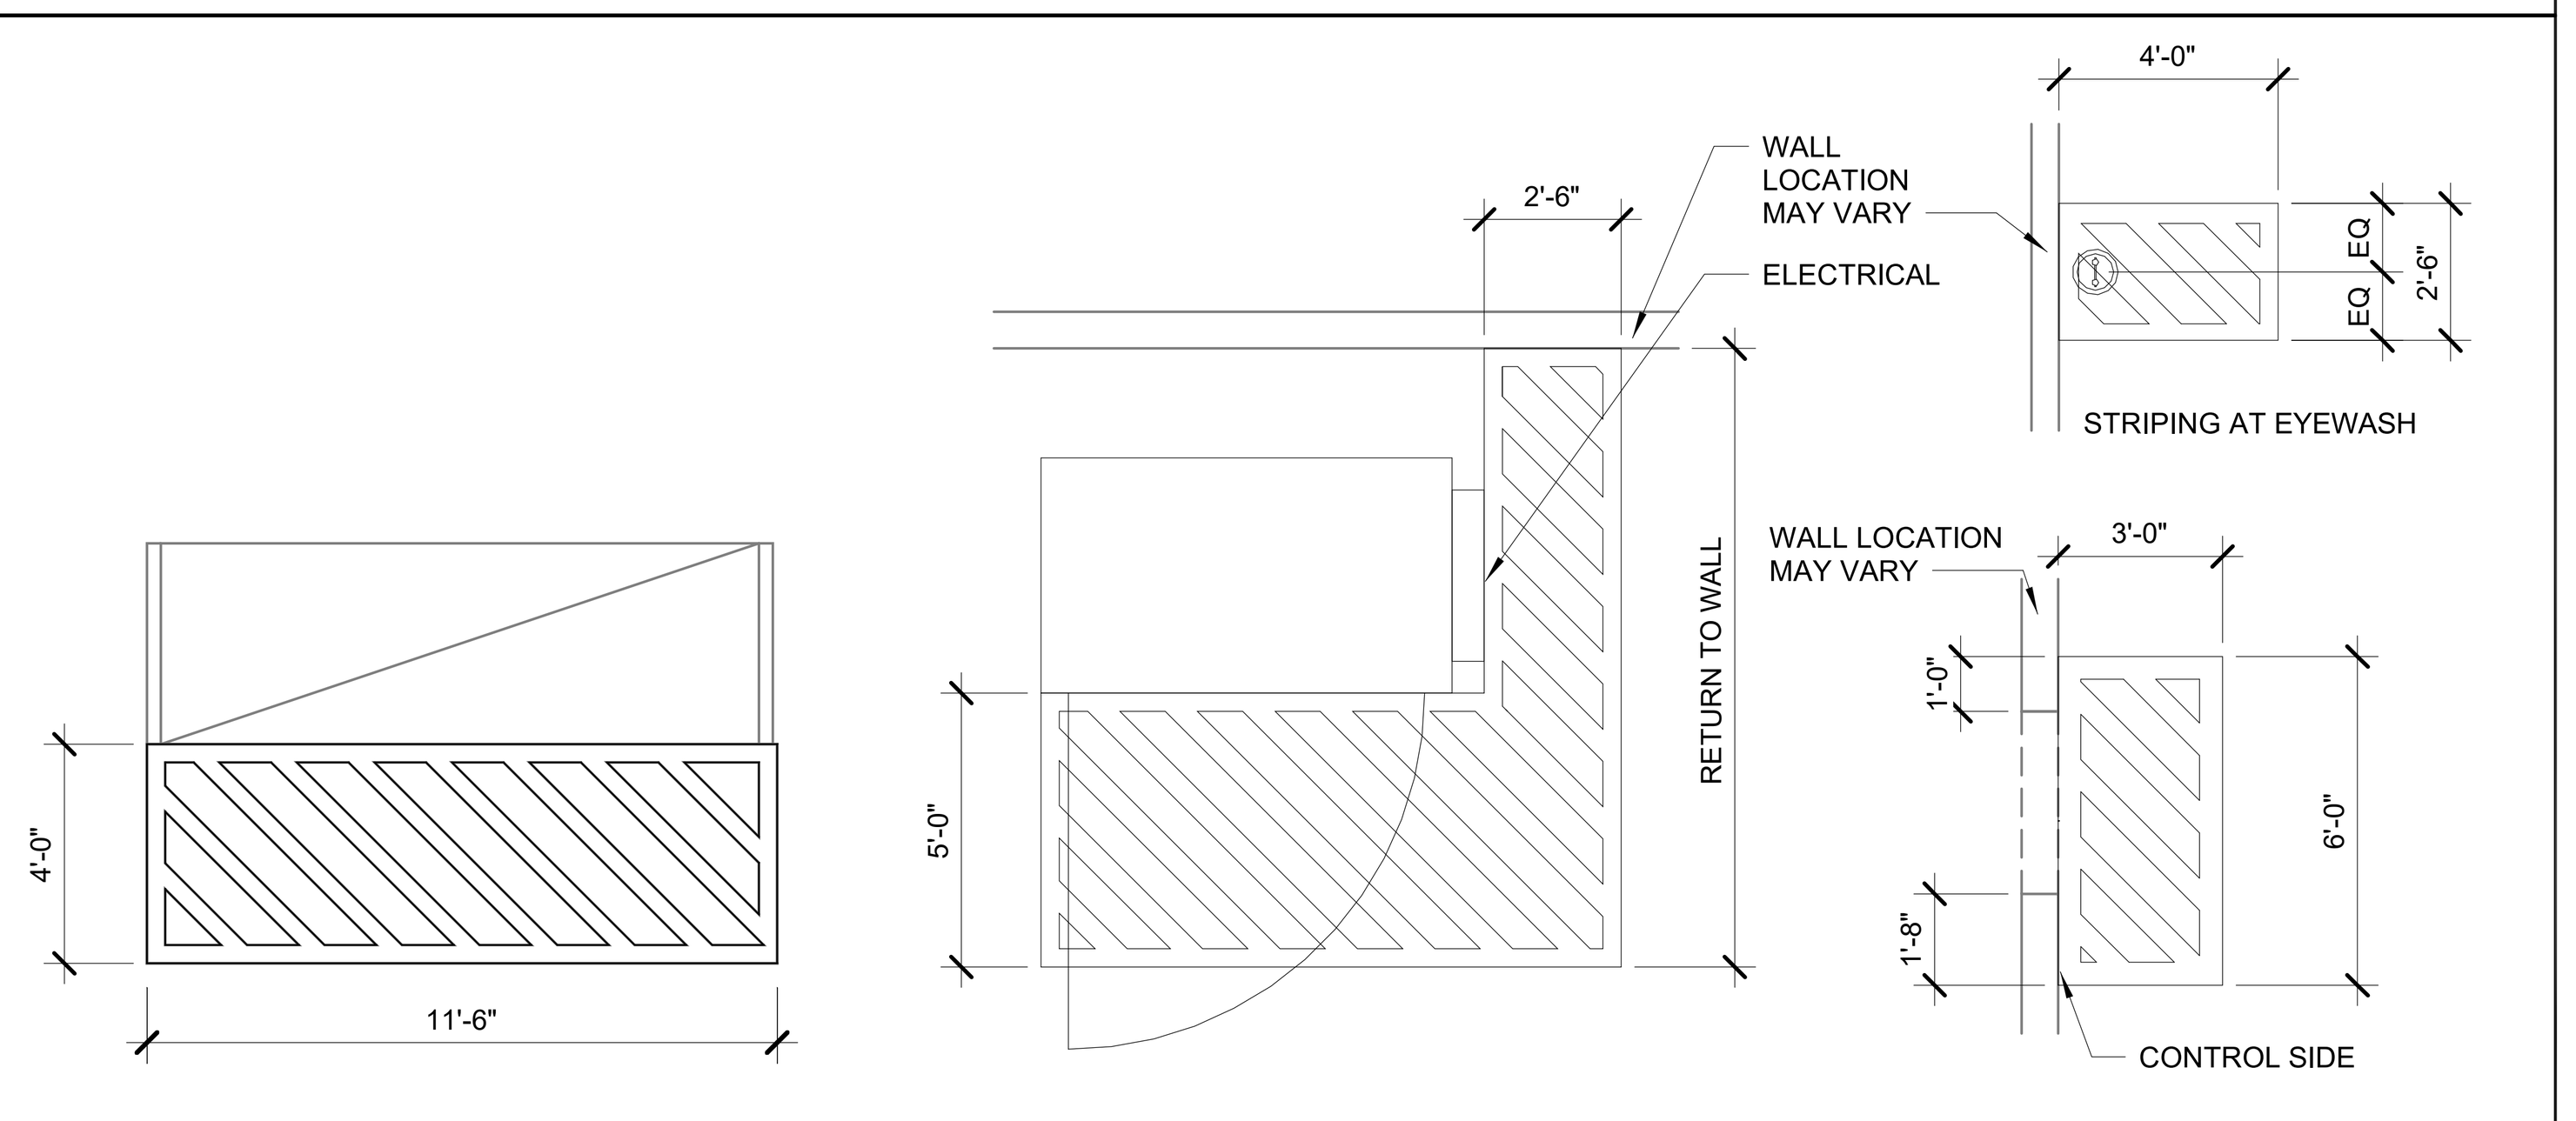
# RESTROOM DOOR SYMBOLS




## SIGNS & IDENTIFICATION

1. THE INTERNATIONAL SYMBOL OF ACCESSIBILITY SHALL BE THE STANDARD USED TO IDENTIFY FACILITIES THAT ARE ACCESSIBLE TO AND USABLE BY PHYSICALLY DISABLED PERSONS AS SET FORTH IN TITLE III AND AS SPECIFICALLY REQUIRED IN THIS SECTION.
2. THE INTERNATIONAL SYMBOL OF ACCESSIBILITY SHALL CONSIST OF A WHITE FIGURE ON A BLUE BACKGROUND. THE BLUE SHALL BE EQUAL TO COLOR NO. 15090 IN FEDERAL STANDARD 595C.
3. FOR CHARACTER PROPORTION, THE UPPERCASE LETTER "O" SHALL BE USED TO DETERMINE THE ALLOWABLE WIDTH OF ALL CHARACTERS OF A FONT. THE WIDTH OF THE UPPERCASE LETTER "O" OF THE FONT SHALL BE 55 PERCENT MINIMUM AND 110 PERCENT MAXIMUM OF THE HEIGHT OF THE UPPERCASE LETTER "I".
4. MINIMUM CHARACTER HEIGHT SHALL COMPLY WITH 2010 ADA TABLE 703.5.5. VIEWING DISTANCE SHALL BE MEASURED AS THE HORIZONTAL DISTANCE BETWEEN THE CHARACTER AND AN OBSTRUCTION PREVENTING FURTHER APPROACH TOWARDS THE SIGN. CHARACTER HEIGHT SHALL BE BASED ON THE UPPERCASE LETTER "I". CHARACTER HEIGHT MEASURED FROM THE BASELINE OF THE CHARACTER SHALL BE 5/8" (16 MM) MINIMUM AND 2 INCHES (51 MM) MAXIMUM.
5. CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THEIR BACKGROUND.
6. WHEN RAISED CHARACTERS OR SYMBOLS ARE USED, THEY SHALL CONFORM TO THE FOLLOWING:
   A. CHARACTERS SHALL BE RAISED 1/32" MINIMUM AND SHALL BE SANS-SERIF UPPERCASE CHARACTERS. RAISED LETTERS SHALL BE DUPLICATED IN BRAILLE.
   B. RAISED CHARACTERS SHALL BE A MINIMUM OF 5/8" HIGH AND 2" MAXIMUM BASED ON THE HEIGHT OF THE LETTER "I".
   C. PICTORIAL SYMBOL SIGNS (PICTOGRAMS) SHALL HAVE TEXT DESCRIPTORS LOCATED DIRECTLY BELOW THE PICTOGRAM FIELD. PICTOGRAMS SHALL HAVE A FIELD HEIGHT OF 6" MINIMUM. PICTOGRAMS AND THEIR FIELDS SHALL HAVE A NON-GLARE FINISH. PICTOGRAMS SHALL CONTRAST THEIR FIELDS, WITH EITHER A LIGHT PICTOGRAM ON A DARK FIELD OR A DARK PICTOGRAM ON A LIGHT FIELD.
7. CONTRACTED (GRADE 2) BRAILLE SHALL BE USED WHEREVER BRAILLE IS REQUIRED. DOTS SHALL BE 0.090" (2.3 MM) TO 0.100" (2.5 MM) ON CENTER IN EACH CELL WITH 0.241" (6.1 MM) TO 0.300" (7.6 MM) SPACE BETWEEN CORRESPONDING DOTS IN ADJACENT CELLS. DOTS SHALL BE RAISED A MINIMUM OF 0.025" (0.6 MM) TO 0.037" (0.9 MM) ABOVE THE BACKGROUND.
8. WHEN PERMANENT IDENTIFICATION IS PROVIDED FOR ROOMS AND SPACES, RAISED LETTERS SHALL BE ACCOMPANIED BY BRAILLE. TACTILE CHARACTERS ON SIGNS SHALL BE LOCATED 48 INCHES (1220 MM) MINIMUM ABOVE THE FINISH FLOOR OR GROUND SURFACE, MEASURED FROM THE BASE OF THE LOWEST TACTILE CHARACTER AND 60 INCHES (1525 MM) MAXIMUM ABOVE THE FINISH FLOOR OR GROUND SURFACE, MEASURED FROM THE BASELINE OF THE HIGHEST TACTILE CHARACTER. WHERE A TACTILE SIGN IS PROVIDED AT A DOOR, THE SIGN SHALL BE LOCATED ALONGSIDE THE DOOR AT THE LATCH SIDE. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH ONE ACTIVE LEAF, THE SIGN SHALL BE LOCATED ON THE INACTIVE LEAF. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH TWO ACTIVE LEAFS, THE SIGN SHALL BE LOCATED TO THE RIGHT OF THE RIGHT HAND DOOR. WHERE THERE IS NO WALL SPACE AT THE LATCH SIDE OF A SINGLE DOOR OR AT THE RIGHT SIDE OF DOUBLE DOORS, SIGNS SHALL BE LOCATED ON THE NEAREST ADJACENT WALL. SIGNS CONTAINING TACTILE CHARACTERS SHALL BE LOCATED SO THAT A CLEAR FLOOR SPACE OF 18 INCHES (455 MM) MINIMUM BY 18 INCHES (455 MM) MINIMUM, CENTERED ON THE TACTILE CHARACTERS, IS PROVIDED BEYOND THE ARC OF ANY DOOR SWING BETWEEN THE CLOSED POSITION AND 45 DEGREE OPEN POSITION. EXCEPTION: SIGNS WITH TACTILE CHARACTERS SHALL BE PERMITTED ON THE PUSH SIDE OF DOORS WITH CLOSERS AND WITHOUT HOLD-OPEN DEVICES.
9. SIGNS TO BE PROVIDED AT ALL PUBLIC MEN, WOMEN, FAMILY AND UNISEX RESTROOMS. ROOM NAME SHALL BE "RESTROOM" AT UNISEX TOILETS.

# SYMBOLS LEGEND

| Symbol | Description |
|---|---|
| X-XX | REFERENCE AT KEYNOTE INDICATOR |
| 10.1 | KEYNOTE INDICATOR |
| X.XX / X.XX / X.XX | A KEYNOTE OR BLOCK OF KEYNOTES WITH A LEADER ATTACHED APPLY SPECIFICALLY TO THE ITEM, AREA, OR SURFACE TO WHICH THE LEADER IS POINTING |
| SALES 100 X.XX X.XX | IN ADDITION TO THE ROOM FINISH SCHEDULE, A KEYNOTE OR BLOCK OF KEYNOTES ATTACHED TO THE ROOM NAME TAG APPLY TO THE ENTIRE ROOM |
| P3 | COLOR INDICATOR |
| 2-A2 | FULL AND PARTIAL SECTION INDICATOR |
| 2-A2 | EXTERIOR AND INTERIOR ELEVATION INDICATOR |
| SALES 100 | ROOM NAME AND NUMBER |
| A6 | PARTITION TYPE INDICATOR |
| 101 A | DOOR INDICATOR |
| M | WINDOW INDICATOR |
| | TV MONITOR |
| A | COLUMN LINE INDICATOR |
| 100'-0" FF EL | HEIGHT ELEVATION INDICATOR |
| 100'-0" | PLAN ELEVATION INDICATOR |
| 5 A2 | ENLARGED DETAIL INDICATOR |
| 5 A2 | DETAIL INDICATOR |
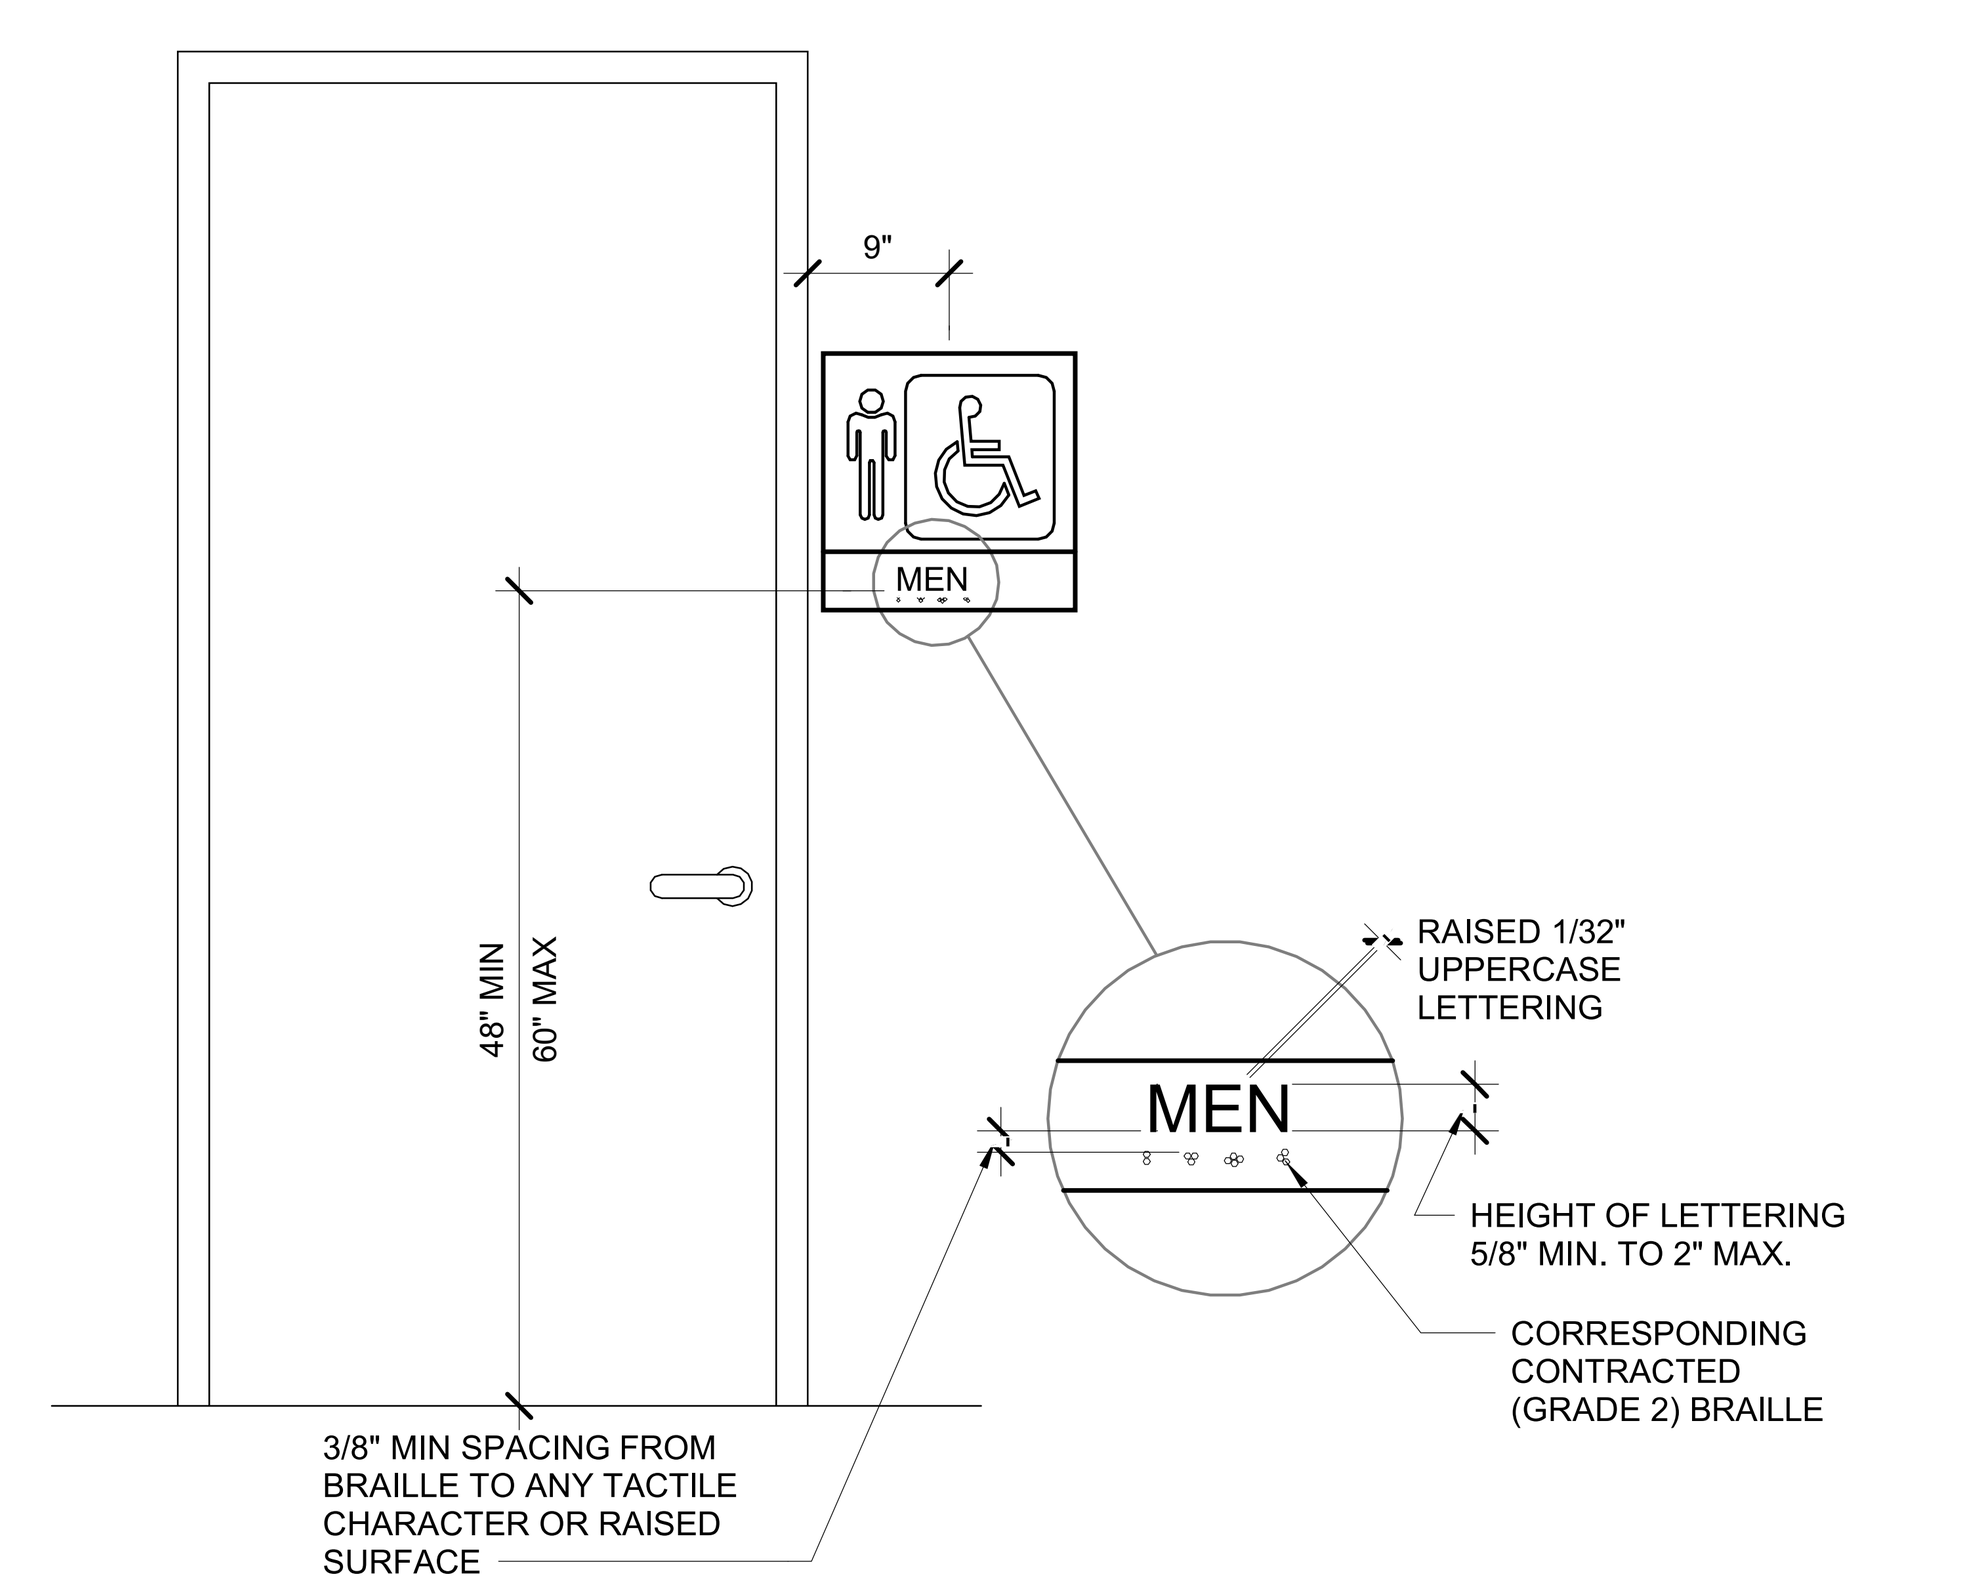
# TACTILE EXIT SIGN

TACTILE SIGN REQUIREMENTS
1. A TACTILE SIGN STATING "EXIT" AND COMPLYING WITH ANSI A117.1 SHALL BE PROVIDED ADJACENT TO EACH DOOR TO AN EXIT PASSAGEWAY AND THE EXIT DISCHARGE. REF FLOOR PLANS FOR LOCATIONS.
2. FOR CHARACTER WIDTH, THE UPPERCASE LETTER "O" SHALL BE USED TO DETERMINE THE ALLOWABLE WIDTH OF ALL CHARACTERS OF A FONT. THE WIDTH OF THE UPPERCASE LETTER "O" OF THE FONT SHALL BE 55 PERCENT MINIMUM AND 110 PERCENT MAXIMUM OF THE HEIGHT OF THE UPPERCASE "I" OF THE FONT. (ANSI A117.1-2009: 703.3.6) CHARACTER HEIGHT MEASURED FROM THE BASELINE OF THE CHARACTER SHALL BE 5/8" (16 MM) MINIMUM AND 2 INCHES (51 MM) MAXIMUM BASED ON THE HEIGHT OF THE UPPERCASE LETTER "I".
3. CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THEIR BACKGROUND.
4. CHARACTERS SHALL CONFORM TO THE FOLLOWING:
   4.a. LETTERS AND NUMBERS ON SIGNS SHALL BE RAISED 1/32" MINIMUM AND SHALL BE SANS-SERIF UPPERCASE CHARACTERS ACCOMPANIED BY GRADE 2 BRAILLE.
   4.b. RAISED CHARACTERS OR SYMBOLS SHALL BE A MINIMUM OF 5/8" HIGH AND A MAXIMUM OF 2".
5. CONTRACTED GRADE 2 BRAILLE SHALL BE USED. DOTS SHALL BE 0.090" (2.3 MM) TO 0.100" (2.5 MM) ON CENTER IN EACH CELL WITH 0.241" (6.1 MM) TO 0.300" (7.6 MM) SPACE BETWEEN CELLS. DOTS SHALL BE RAISED A MINIMUM OF 0.025" (0.6 MM) TO 0.037" (0.9 MM) ABOVE THE BACKGROUND.
6. CHARACTERS SHALL BE 48" MINIMUM ABOVE FINISH FLOOR MEASURED FROM THE BASE OF THE LOWEST TACTILE CHARACTER AND 60" MAXIMUM ABOVE FINISH FLOOR MEASURED FROM THE BASELINE OF THE HIGHEST TACTILE CHARACTER.
7. WHERE A TACTILE SIGN IS PROVIDED AT A DOOR, THE SIGN SHALL BE ALONGSIDE THE DOOR AT THE LATCH SIDE. AT DOUBLE DOORS WITH ONE ACTIVE LEAF, THE SIGN SHALL BE LOCATED ON THE INACTIVE LEAF. AT DOUBLE DOORS WITH TWO ACTIVE LEAVES, THE SIGN SHALL BE TO THE RIGHT OF THE RIGHT-HAND DOOR. TACTILE SIGNS ARE PERMITTED ON THE PUSH SIDE OF DOORS WITH CLOSERS AND WITHOUT HOLD-OPEN DEVICES. SEE ALTERNATE SOLUTIONS FOR OTHER SCENARIOS.

PREFERRED SOLUTION




SIGNS CONTAINING TACTILE CHARACTERS SHALL BE LOCATED SO THAT THERE IS AN 18"X18" CLEAR FLOOR AREA CENTERED ON THE TACTILE CHARACTERS

ALTERNATE SOLUTIONS



ALTERNATE LOCATION (NEAREST ADJACENT WALL, RIGHT HAND SIDE OF OPENING PREFERRED)

A. WHERE THERE IS NO WALL SPACE ON THE LATCH SIDE OF A SINGLE DOOR, OR TO THE RIGHT SIDE OF DOUBLE DOORS, SIGNS SHALL BE ON THE NEAREST ADJACENT WALL.

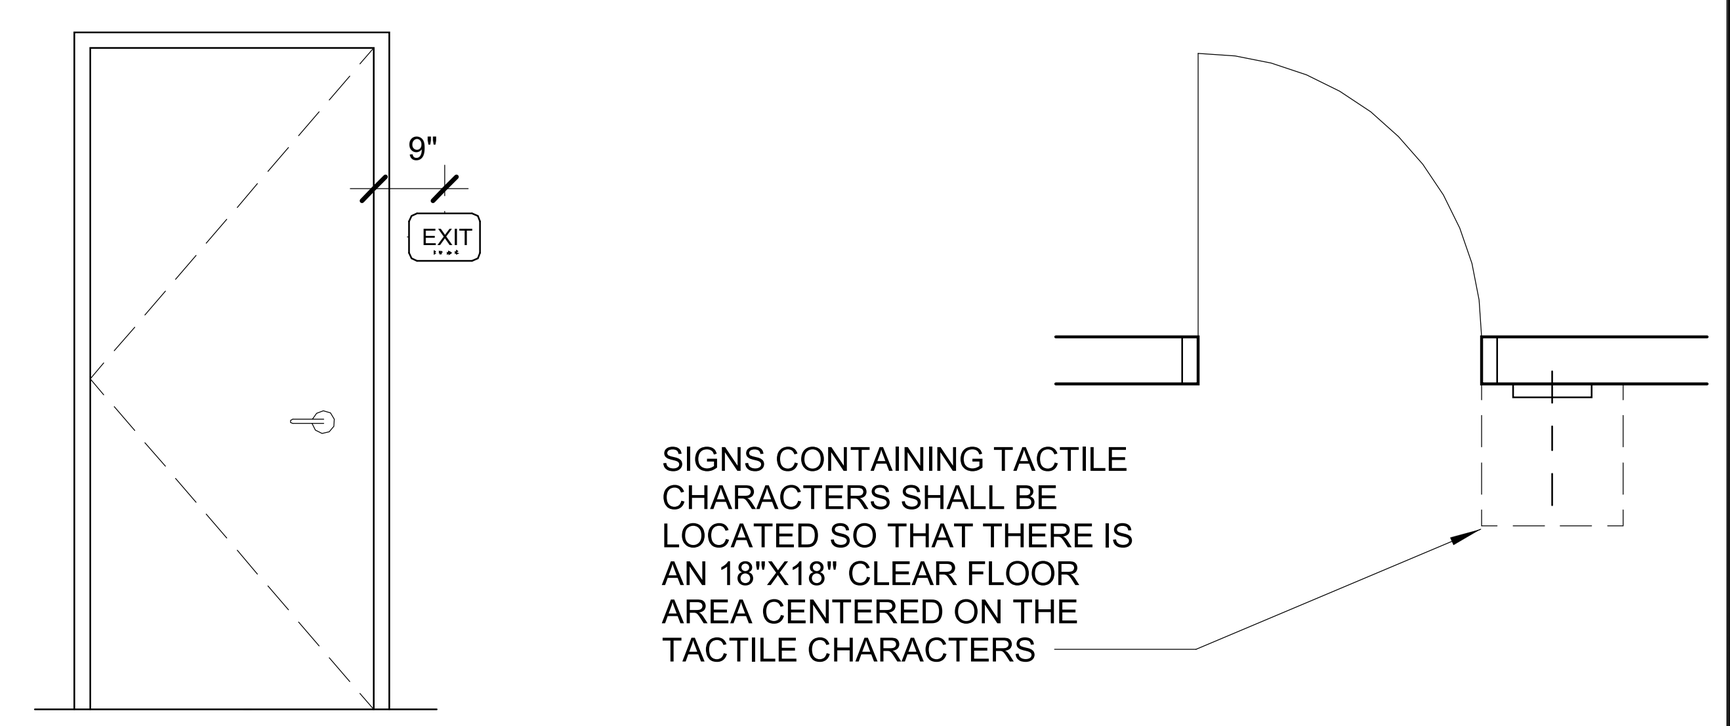B. THE REQUIRED SIGNAGE MAY BE INSTALLED SO THAT THE CLEAR FLOOR AREA IS BEYOND THE ARC OF ANY DOOR SWING BETWEEN THE CLOSED POSITION AND 45 DEGREE OPEN POSITION.



C. WHEN SIGN IS REQUIRED AT A BANK OF DOORS, PLACE (1) SIGN BETWEEN JAMBS. IF JAMB IS NOT WIDE ENOUGH FOR SIGNAGE, PLACE (1) SIGN AT RIGHT SIDE OF BANK OF DOORS.

D. WHERE REFRIGERATED CASES OR FIXTURES IMPEDE THE REQUIRED CLEAN FLOOR AREA, MOUNT SIGNAGE TO THE END PANEL OF CASE OR OWNER PROVIDED END PANEL FOR HALF GONDOLAS AND WALL STANDARD FIXTURES.

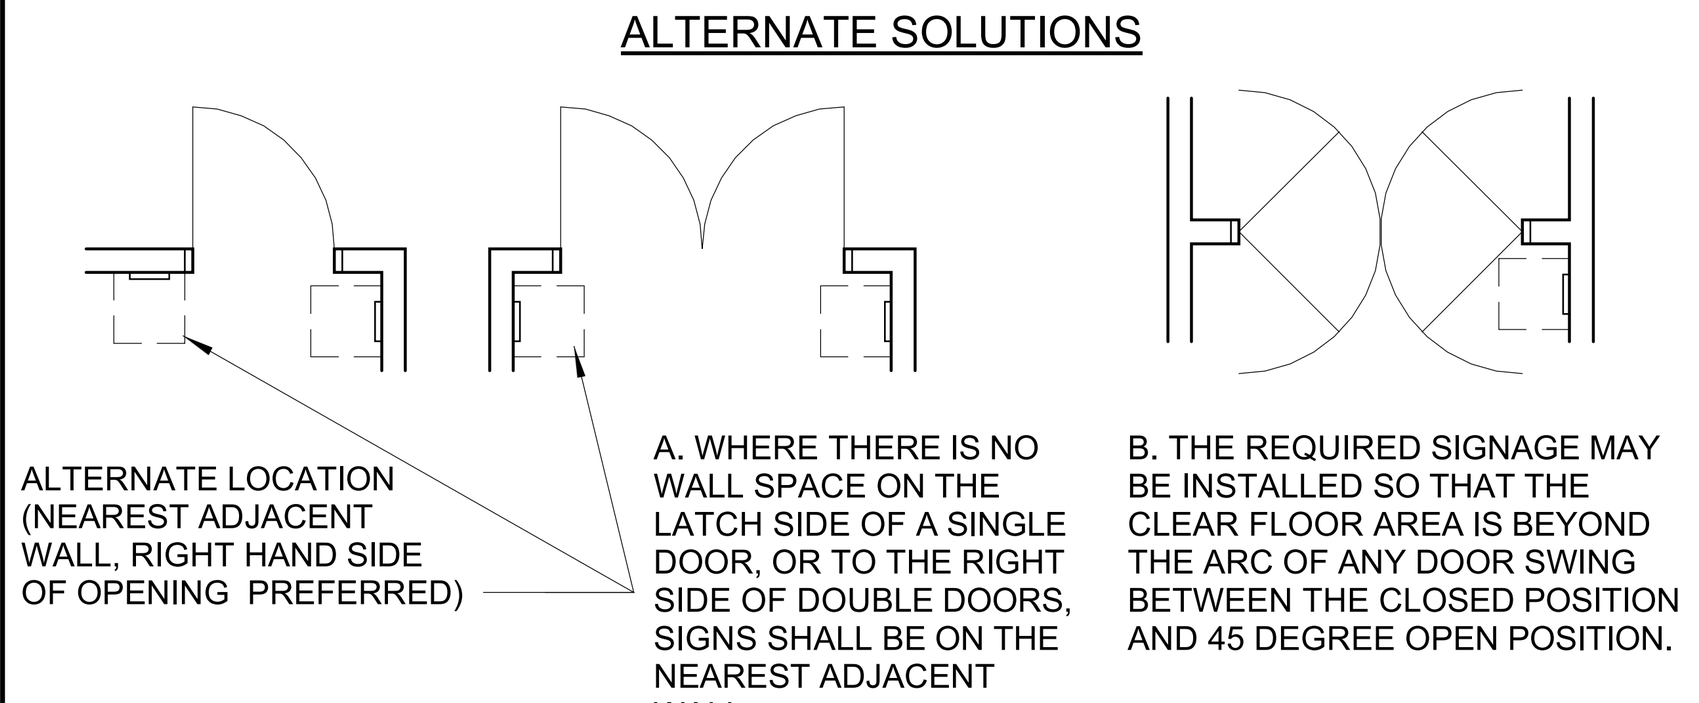E. WHERE WALL STANDARDS IMPEDE THE REQUIRED CLEAR FLOOR AREA, MOUNT SIGN DIRECTLY TO DOOR. ENSURE DOOR HAS AUTOMATIC CLOSER AND DOES NOT HAVE A HOLD-OPEN DEVICE.

F. AT EGRESS DOORS IN THE GARDEN CENTER WHERE THERE IS NOT AMPLE WALL SPACE FOR SIGNAGE, MOUNT SIGN DIRECTLY TO DOOR. ENSURE DOOR HAS AUTOMATIC CLOSER AND DOES NOT HAVE A HOLD-OPEN DEVICE.

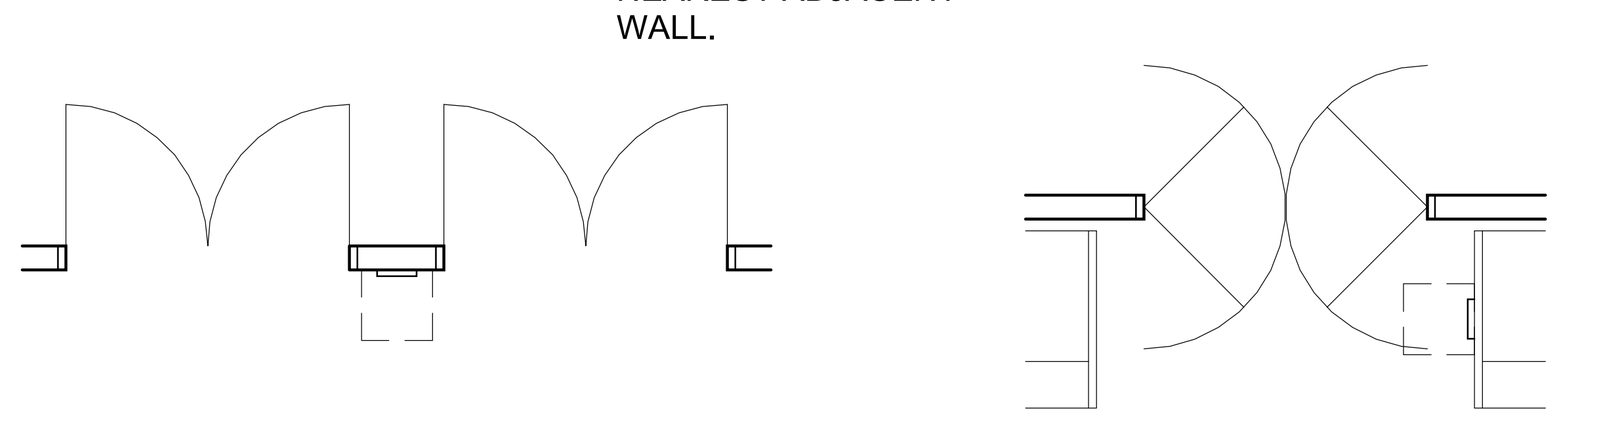


G. AUTOMATIC SLIDING DOOR LOCATIONS

TACTILE SIGNAGE CANNOT BE LOCATED ON AUTOMATIC SLIDING DOOR PANELS.




H. WHERE WAREHOUSE RACKS IMPEDE THE REQUIRED CLEAR FLOOR AREA ADJACENT TO THE DOOR, PROVIDE 3/8" A-B PLYWOOD PANEL WITH EASED EDGES AND ATTACH TO THE END OF THE WAREHOUSE RACK USING (4) GALVANIZED CARRIAGE BOLTS, WASHERS AND LOCKNUTS. CARRIAGE BOLTS ARE TO BE SIZED PROPERLY TO ENSURE THE BOLT END DOES NOT PROTRUDE BEYOND THE TOP OF LOCKNUT AND PANEL IS SECURE. IN GROCERY SERVICE AND PREPARATION AREAS, PAINT PLYWOOD P33 UNO.
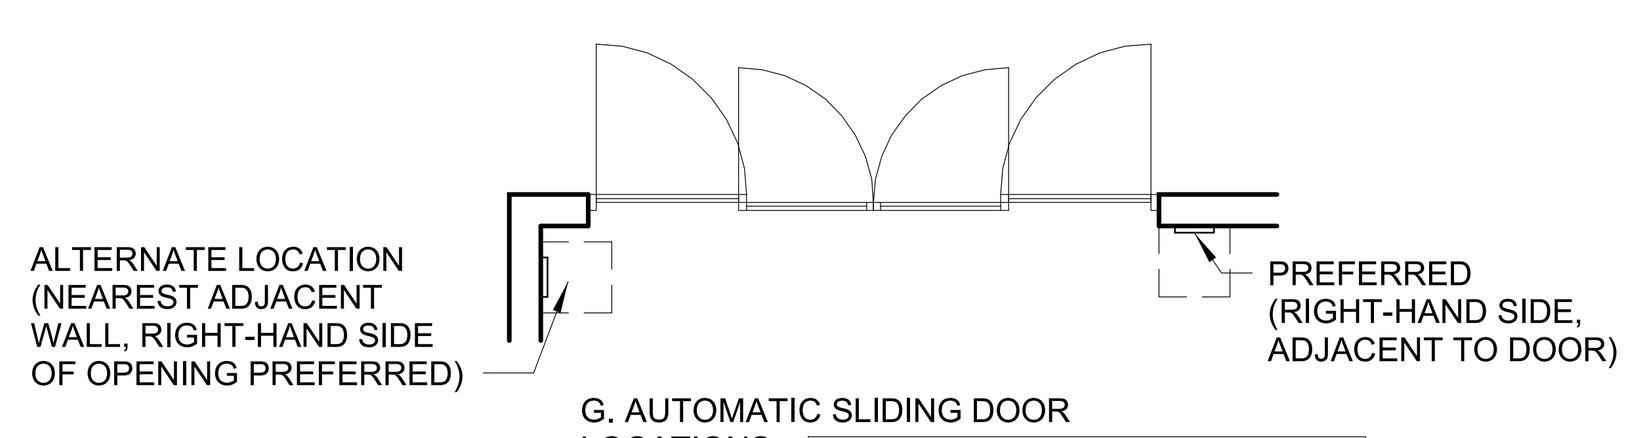
# INSECT CONTROL UNIT LEGEND

FINAL NUMBER OF UNITS RECEIVED IS DETERMINED BY THE WALMART FOOD SAFETY & HEALTH PEST MANAGEMENT AND PEST ELIMINATION SERVICES PROVIDER

| TYPE | TOTAL | |
|---|---|---|
| D | 2 | D |

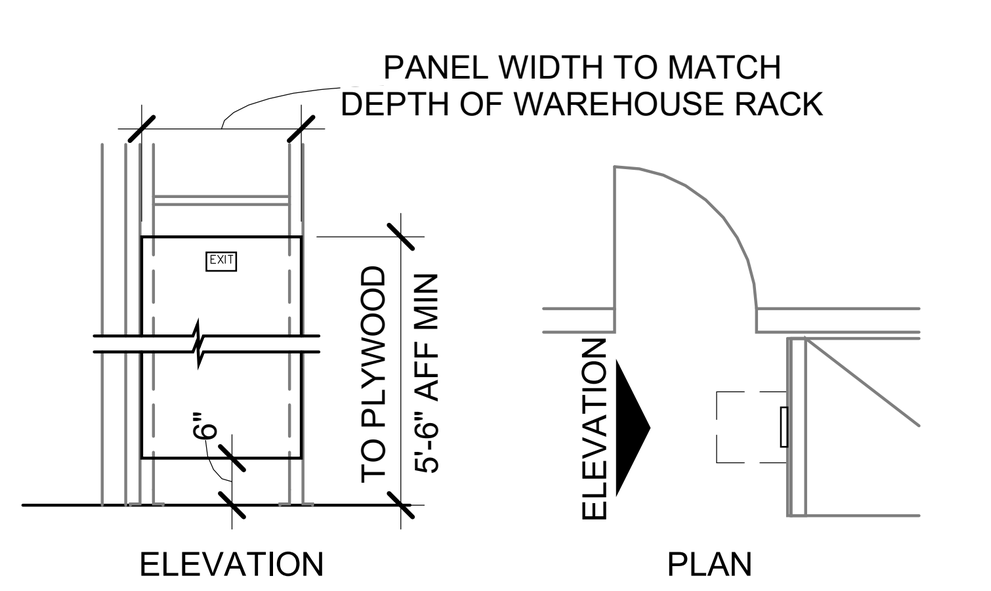NOTES:
1. ALL UNITS TO BE INSTALLED BY THE PEST ELIMINATION SERVICES PROVIDER
2. UNITS ARE NOT TO BE INSTALLED ABOVE ANY FOOD SERVICE/PREP EQUIPMENT
3. UNITS ARE TO BE INSTALLED (INDICATED WITH BROWN RECEPTACLES AND COVERS) AS INSTRUCTED WITHIN THE CONSTRUCTION DOCUMENTS. REFERENCE ARCHITECTURAL AND ELECTRICAL DRAWINGS FOR PROPER LOCATION

## SITE VERIFICATION REQUIREMENTS:

1. THE ARCHITECT HAS MADE A SCOPE VISIT WITH MEASUREMENTS AND PHOTOGRAPHS OF EXISTING CONDITIONS AND THE ARCHITECTURAL DRAWINGS INDICATE EXISTING CONDITIONS VERIFIED IN THE FIELD. IT REMAINS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL EXISTING CONDITIONS PRIOR TO THE SUBMISSION OF A BID AND TO THE COMMENCEMENT OF ANY WORK. NO ADDITIONAL COMPENSATION WILL BE PAID DUE TO THE CONTRACTOR'S FAILURE TO VERIFY EXISTING SITE CONDITIONS WHICH INCLUDE, BUT ARE NOT LIMITED TO, GRADES, EXTENT OF PAVING, OR UTILITIES.
2. ANY DISCREPANCY WITH THE EXISTING SITE CONDITIONS AND/OR THE DRAWINGS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT FOR CLARIFICATION AND INSTRUCTION. THESE CONSTRUCTION DOCUMENTS HAVE BEEN DESIGNED AND DRAWN ASSUMING EXISTING BUILDING CONDITIONS MATCH THE ORIGINAL DRAWINGS. THE GENERAL CONTRACTOR, IMMEDIATELY UPON ARRIVAL AT THE SITE, SHALL VERIFY ALL EXISTING STRUCTURAL COLUMN DIMENSIONS, STRUCTURAL BEARING HEIGHTS, EXISTING DIMENSIONS, TOP OF MASONRY ELEVATIONS, ROOFING CONDITIONS (INCLUDING PARAPETS, SCUPPERS AND ROOF DRAINS), AND JOIST BEARING ELEVATIONS PRIOR TO THE FABRICATION OF ANY STRUCTURAL ITEMS. IF DISCREPANCIES ARE FOUND BETWEEN WHAT IS SHOWN ON THE DRAWINGS AND EXISTING FIELD CONDITIONS, CONTACT THE WALMART CONSTRUCTION MANAGER AND THE ARCHITECT IMMEDIATELY TO DETERMINE WHAT ACTION SHOULD BE TAKEN TO MATCH EXISTING CONDITIONS. THE BEGINNING OF STRUCTURAL STEEL FABRICATION BY THE GENERAL CONTRACTOR, STEEL FABRICATOR, OR JOIST MANUFACTURER MEANS ACCEPTANCE OF THE EXISTING CONDITIONS.
3. ALL UTILITY LOCATIONS SHOWN ARE APPROXIMATE. THE CONTRACTOR SHALL FIELD VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES (WHETHER SHOWN OR NOT) PRIOR TO THE SUBMISSION OF A BID OR THE COMMENCEMENT OF CONSTRUCTION. THE CONTRACTOR SHALL NOTIFY THE WALMART CONSTRUCTION MANAGER OF THE DISCOVERY OF EXISTING UTILITIES NOT SHOWN OR NOTED ON DRAWINGS.
4. THE CONTRACTOR SHALL VERIFY AND MAINTAIN (REPAIR IF DAMAGED) EXISTING IRRIGATION SYSTEMS AFFECTED BY THE CONSTRUCTION OF THIS PROJECT.
5. THE CONTRACTOR SHALL FIELD LOCATE AND VERIFY ALL PROPERTY LINES, EASEMENTS, SETBACKS AND RESTRICTIONS. A REGISTERED SURVEYOR SHALL ESTABLISH ALL PROPERTY LINES AND SETBACKS PRIOR TO THE COMMENCEMENT OF CONSTRUCTION AND CLEARLY FLAG PROPERTY LINES AND SETBACKS. IT REMAINS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO DETERMINE EXACT LOCATION OF ALL SAID BOUNDARIES.
6. THE CONTRACTOR SHALL VERIFY EXACT LOCATIONS AND DEPTHS OF UNDERGROUND UTILITY SERVICES PRIOR TO ANY EXCAVATION.
7. THE CONTRACTOR SHALL VERIFY ALL GRADES AND PROPOSED FINAL GRADES. IF RAMPS, STOOPS, STAIRS, SIDEWALKS, FLATWORK OR PAVING ARE INSTALLED, VERIFY FINAL GRADES SURROUNDING THE NEW CONSTRUCTION AND ADJUST STAIR RISERS, RAMP LENGTHS, LIMITS OF PAVING, ETC., TO ACCOMMODATE THE REQUIRED RAMP SLOPE, RISER HEIGHTS OR PAVING AREAS. ALL RAMPS AND STAIRS SHALL MEET ADA-ADAAGS (OR ADOPTED HANDICAP ACCESSIBILITY REQUIREMENTS). IF THERE IS A CONFLICT IN FIELD CONDITIONS, NOTIFY WALMART CONSTRUCTION MANAGER AND THE ARCHITECT PRIOR TO THE CONSTRUCTION OR ORDERING OF MATERIALS.
8. THE CONTRACTOR SHALL VERIFY THE EXISTING FINISH FLOOR ELEVATION AT ALL NEW OPENINGS OF THE EXISTING BUILDING PRIOR TO ESTABLISHING THE FINISH FLOOR ELEVATION. TO VERIFY FLOOR ELEVATION, THE CONTRACTOR SHALL REMOVE A SMALL PORTION OF THE BLOCK WALL AT THE PROPOSED OPENING BETWEEN THE EXISTING STORE AND THE ADDITION.
9. THE CONTRACTOR SHALL VERIFY EXISTING FOOTING DEPTHS AND MATCH AT NEW ADDITION TO INSURE PROPER BLOCK COURSING. ANY DISCREPANCY SHALL BE REPORTED TO THE WALMART CONSTRUCTION MANAGER PRIOR TO CONSTRUCTION.
10. THE CONTRACTOR SHALL CORE THE ROOF INSULATION TO DETERMINE ITS THICKNESS AFTER CONTRACT AWARD. IT IS THE CONTRACTOR'S RESPONSIBILITY TO MATCH EXISTING ROOF INSULATION THICKNESS ON THE ADDITION UNLESS DIRECTED OTHERWISE TO INSTALL 3-INCH INSULATION IN SEPARATED AND ISOLATED ROOF CONDITIONS. REFER TO ROOFING SPECIFICATION SECTION.
11. REPORT ANY DISCREPANCIES FOUND IN THE FIELD IMMEDIATELY TO WALMART AND THE ARCHITECT PRIOR TO MAKING ANY STRUCTURAL MODIFICATIONS OR ORDERING OF ANY MATERIALS.

## GENERAL CONSTRUCTION REQUIREMENTS:

1. ALL WORK SHALL BE DONE IN A SAFE AND WORKMANLIKE MANNER AND IN STRICT ACCORDANCE WITH THE LOCAL AND/OR STATE (IF APPLICABLE) BUILDING CODES, NATIONAL ELECTRIC CODE, ADA-ADAAG AND OTHER ADOPTED ACCESSIBILITY STANDARDS, OSHA, AND ALL APPLICABLE CODES, REGULATIONS, ORDINANCES AND AUTHORITIES HAVING JURISDICTION (AHJ).
2. PROVISIONS REGARDING THE USE OF GAS AND DIESEL EQUIPMENT WITHIN AN ENCLOSED BUILDING, FORMERLY INCLUDED IN THIS PARAGRAPH, ARE NOW INCLUDED IN SECTION 01351 - REGULATORY COMPLIANCE
3. PROVISIONS REGARDING CORDS FOR ELECTRICAL EQUIPMENT AND ROUTING OF EQUIPMENT CORDS AND HOSES, FORMERLY INCLUDED IN THIS PARAGRAPH, ARE NOW INCLUDED IN SECTION 01351 - REGULATORY COMPLIANCE
4. EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO REVIEW THESE DOCUMENTS DOES NOT RELIEVE THE SUBCONTRACTOR OF ANY RESPONSIBILITY FOR PERFORMING WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.
5. THE EXISTING BUILDING SHALL BE PROTECTED FROM MOISTURE, DUST AND DEBRIS. INSTALL DUST PARTITIONS OR DRAPES AS REQUIRED AND/OR AS DIRECTED BY WALMART CONSTRUCTION MANAGER TO KEEP DUST AND MOISTURE FROM THE OPERATING AREAS OF THE STORE.
6. ANY DAMAGE TO WALMART'S PROPERTY, WHICH OCCURS DURING THE PROCESS OF CONSTRUCTION SHALL BE REPAIRED/REPLACED AT NO ADDITIONAL COST TO WALMART; THIS INCLUDES ALL MERCHANDISE. CONTRACTOR SHALL PAY THE COST FOR ALL DAMAGED MERCHANDISE.
7. THE CONTRACTOR SHALL MAINTAIN THE INTEGRITY OF THE EXISTING BUILDING SECURITY AT ALL TIMES. THIS INCLUDES KEEPING THE BUILDING SECURE FROM PERSONS, ENVIRONMENTAL ELEMENTS OR HAZARDS. THE CONTRACTOR SHALL BE RESPONSIBLE TO MAINTAIN THE INTEGRITY OF ALL EXISTING SECURITY SYSTEMS. THE CONTRACTOR SHALL OBTAIN PERMISSION FROM THE STORE MANAGER PRIOR TO THE MODIFICATION OF ANY EXISTING SECURITY SYSTEM FOR THE OPENING (DEMOLITION) OF ANY EXTERIOR WALL.
8. THE CONTRACTOR SHALL KEEP THE WORK AREA CLEAN AND FREE OF DEBRIS AND REMOVE ALL TRASH AND DEBRIS FROM THE CONSTRUCTION AREA DAILY. NO FLAMMABLE MATERIALS OR LIQUIDS MAY BE STORED IN THE EXISTING BUILDING OR IN ANY NEW ADDITION.
9. REMOVE ANY EXISTING EQUIPMENT, FIXTURES, FURNISHINGS, ACCESSORIES, SERVICES, SIGNAGE, FINISHES OR SURFACES AS REQUIRED SHOWN OR NOT SHOWN, FOR THE INSTALLATION OF NEW CONSTRUCTION. PROVIDE FURRING FOR CONDUITS AND PIPING, SHOWN OR NOT, AND FINISH OUT FURRING TO MATCH ADJACENT EXISTING FINISHES.
10. REPAIR, RE-ROUTE, AND EXTEND ALL SERVICES, PIPING, CONDUIT OF EXISTING ITEMS AND EQUIPMENT AS REQUIRED DURING THE CONSTRUCTION PROCESS TO MAINTAIN NORMAL STORE OPERATIONS AND AS REQUIRED FOR THE INSTALLATION OF NEW CONSTRUCTION. THIS INCLUDES ALL ITEMS SHOWN OR NOT SHOWN ON THE DRAWINGS. RESET EXISTING EQUIPMENT, FIXTURES, FURNISHINGS, ACCESSORIES OR RELATED ITEMS, INCLUDING SIGNAGE, AS REQUIRED FOR PROPER OPERATION.
11. WHEN EQUIPMENT, FIXTURES, FURNISHINGS, ACCESSORIES, SERVICES, FINISHES OR SURFACES ARE TEMPORARILY REMOVED OR RELOCATED IN ORDER TO PERFORM WORK, THE CONTRACTOR IS RESPONSIBLE FOR RETURNING THEM TO THEIR ORIGINAL POSITION, RECONNECTION OF SERVICES AND APPROPRIATE MEANS OF ATTACHMENT UNLESS SPECIFICALLY DIRECTED TO DO OTHERWISE.
12. WHERE EXISTING FINISHES ARE TO REMAIN, CLEAN, REPAIR, PATCH AND REPAINT AS NECESSARY TO BLEND IN WITH ADJACENT WORK. COORDINATE WITH WALMART CONSTRUCTION MANAGER
13. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE TIMELY ORDERING OF MATERIALS TO PROHIBIT DELAYS OF THE CONSTRUCTION SCHEDULE OF THIS PROJECT. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE DELIVERY OF MATERIALS IN A TIMELY MANNER.
14. IT IS IMPERATIVE THAT THE ROOF FRAMING, DECKING AND ROOFING SYSTEM BE COMPLETED IMMEDIATELY UPON THE DEMOLITION OF THE EXTERIOR WALL TO ELIMINATE POTENTIAL WATER DAMAGE OR MOISTURE INFILTRATION. THE CONTRACTOR SHALL KEEP THE BUILDING WATERTIGHT AT ALL TIMES.
15. THE GENERAL CONTRACTOR SHALL RESPOND TO ALL REQUIREMENTS OF THE STRUCTURAL ENGINEER/ARCHITECT FOR VERIFICATIONS, RESPONSES, AND SUBMISSIONS.
16. IF MODIFICATION TO SPRINKLER SYSTEM IS REQUIRED THE GENERAL CONTRACTOR SHALL HIRE A LICENSED SPRINKLER CONTRACTOR. CONTRACTOR TO SUBMIT SIGNED AND SEALED SPRINKLER DRAWINGS FOR APPROVAL PRIOR TO ANY ALTERATION OF THE AUTOMATIC SPRINKLER SYSTEM. WORK TO BE DONE UNDER SEPARATE PERMIT.
17. ALL ADJACENT BUILDINGS (IF APPLICABLE) SHALL REMAIN IN SERVICE DURING DEMOLITION/CONSTRUCTION.
18. MUD AND DEBRIS TRACKED ONTO OWNER PAVING OR CITY STREETS TO BE CLEANED IMMEDIATELY.
19. BUILDING COMPONENTS AFFECTED BY THE SCOPE OF WORK AND ALLOWED TO REMAIN SHALL BE SECURED TO PREVENT FALLING, LOOSENING, OR CREATING DAMAGE OF ANY KIND IN THE FUTURE.

## DEMOLITION REQUIREMENTS:

1. ALL DEMOLITION SHALL BE CARRIED OUT IN A SAFE MANNER AND IN STRICT ACCORDANCE WITH OSHA REGULATIONS.
2. THE CONTRACTOR SHALL FIELD VERIFY THE EXTENT OF DEMOLITION. THE WORK INCLUDES, BUT IS NOT LIMITED TO, THE DEMOLITION AND REMOVAL OF WALLS, DOORS, FIXTURES, PLUMBING, PAVING, MECHANICAL AND ELECTRICAL ITEMS INCLUDING CONDUITS AND DUCTWORK AS SHOWN ON DRAWING OR AS REQUIRED FOR THE INSTALLATION OF THE NEW WORK FOR A COMPLETE JOB.
3. WHEN UTILITIES ARE REMOVED, CAP AND SEAL A MINIMUM OF 8" BELOW FINISH FLOOR OR A MINIMUM OF 6" ABOVE FINISH CEILING.
4. WHEN REMOVING EXISTING STRUCTURAL ITEMS, IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROVIDE ADEQUATE SHORING, BRACING AND SUPPORT SYSTEMS TO KEEP THE EXISTING STRUCTURE INTACT AND IN A SAFE CONDITION. REFER TO SECTIONS 02023 AND 02251.
5. THE CONTRACTOR MAY NOT REMOVE THE BLOCK WALL IN A PROPOSED OPENING PRIOR TO THE ROOFING SYSTEM OVER THE NEW ADDITION BEING MADE WATERTIGHT. COORDINATE WITH THE WALMART CONSTRUCTION MANAGER AND THE STORE MANAGER TO SCHEDULE FOR DEMOLITION FOR NEW OPENINGS.
6. THE CONTRACTOR SHALL REMOVE ANY BUILDING SIGNAGE THAT INTERFERES WITH THE BUILDING ADDITION. WALMART WILL REINSTALL SIGNAGE OR ADD NEW SIGNAGE AT COMPLETION OF ADDITION.
7. NOTES INDICATING DEMOLITION WORK ARE NOT CONFINED SOLELY TO THE DEMOLITION PLANS. THE GENERAL CONTRACTOR SHALL REVIEW ALL CONSTRUCTION DOCUMENTS, INCLUSIVE OF SCHEDULES AND SPECIFICATIONS, TO DETERMINE FULL EXTENT OF DEMOLITION WORK.

# SIGNAGE LEGEND




1. REQUIRED ACCESSIBLE ELEMENTS SHALL BE IDENTIFIED BY THE INTERNATIONAL SYMBOL OF ACCESSIBILITY AT THE FOLLOWING LOCATIONS:
   A. ACCESSIBLE ENTRANCES WHERE NOT ALL ENTRANCES ARE ACCESSIBLE
   B. ACCESSIBLE ROOMS WHERE MULTIPLE SINGLE-USER TOILETS ARE CLUSTERED AT A SINGLE LOCATION
   C. ACCESSIBLE CHECK-OUT AISLES WHERE NOT ALL AISLES ARE ACCESSIBLE. THE SIGN, WHERE PROVIDED, SHALL BE ABOVE THE CHECK-OUT AISLE IN THE SAME LOCATION AS THE CHECK-OUT AISLE NUMBER OR TYPE OF CHECK-OUT IDENTIFICATION
   D. UNISEX TOILET AND BATHING ROOMS
   E. ACCESSIBLE DRESSING, FITTING AND LOCKER ROOMS WHERE NOT ALL SUCH ROOMS ARE ACCESSIBLE
2. DIRECTIONAL SIGNAGE INDICATING THE ROUTE TO THE NEAREST LIKE ACCESSIBLE ELEMENT SHALL BE PROVIDED AT THE FOLLOWING LOCATIONS. THESE DIRECTIONAL SIGNS SHALL INCLUDE THE INTERNATIONAL SYMBOL OF ACCESSIBILITY:
   A. AT EACH SEPARATE-SEX TOILET INDICATING THE LOCATION OF THE NEAREST UNISEX TOILET
3. TACTILE SIGNAGE SHALL BE LOCATED 48 INCHES (1220 MM) MINIMUM ABOVE THE FINISH FLOOR OR GROUND SURFACE, MEASURED FROM THE BASE OF THE LOWEST TACTILE CHARACTER AND 60 INCHES (1525 MM) MAXIMUM ABOVE THE FINISH FLOOR OR GROUND SURFACE, MEASURED FROM THE BASELINE OF THE HIGHEST TACTILE CHARACTER. WHERE A TACTILE SIGN IS PROVIDED AT A DOOR, THE SIGN SHALL BE LOCATED ALONGSIDE THE DOOR AT THE LATCH SIDE. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH ONE ACTIVE LEAF, THE SIGN SHALL BE LOCATED ON THE INACTIVE LEAF. WHERE A TACTILE SIGN IS PROVIDED AT DOUBLE DOORS WITH TWO ACTIVE LEAFS, THE SIGN SHALL BE LOCATED TO THE RIGHT OF THE RIGHT HAND DOOR. WHERE THERE IS NO WALL SPACE AT THE LATCH SIDE OF A SINGLE DOOR OR AT THE RIGHT SIDE OF DOUBLE DOORS, SIGNS SHALL BE LOCATED ON THE NEAREST ADJACENT WALL. SIGNS CONTAINING TACTILE CHARACTERS SHALL BE LOCATED SO THAT A CLEAR FLOOR SPACE OF 18 INCHES (455 MM) MINIMUM BY 18 INCHES (455 MM) MINIMUM, CENTERED ON THE TACTILE CHARACTERS, IS PROVIDED BEYOND THE ARC OF ANY DOOR SWING BETWEEN THE CLOSED POSITION AND 45 DEGREE OPEN POSITION. EXCEPTION: SIGNS WITH TACTILE CHARACTERS SHALL BE PERMITTED ON THE PUSH SIDE OF DOORS WITH CLOSERS AND WITHOUT HOLD-OPEN DEVICES.
4. CHARACTER AND SYMBOLS OF SIGNS SHALL BE IN CONTRAST WITH THEIR BACKGROUND AND SHALL BE EGGSHELL, MATTE, OR OTHER NON-GLARE MATERIALS OR FINISHES.
5. ACCESSIBLE SIGNAGE SHALL USE GRADE 2 BRAILLE AND MUST COMPLY WITH ICC A117.1 SECTION 703.4 OR ADA SECTION 703.3.

# ABBREVIATION LEGEND

GENERAL ABBREVIATIONS

| ABBR | DEFINITION |
|---|---|
| AB | ANCHOR BOLT |
| ACI | AMERICAN CONCRETE INSTITUTE |
| ACRYL | ACRYLIC |
| ADA | AMERICANS WITH DISABILITIES ACT |
| ADJ | ADJACENT |
| AFF | ABOVE FINISHED FLOOR |
| AFG | ABOVE FINISHED GRADE |
| AISC | AMERICAN INSTITUTE OF STEEL CONSTRUCTION |
| ARCH | ARCHITECTURAL |
| ASTM | AMERICAN SOCIETY OF TESTING AND MATERIALS |
| AWS | AMERICAN WELDING SOCIETY |
| BFF | BELOW FINISHED FLOOR |
| BL | BLOCK LINTEL |
| BO | BOTTOM OF |
| BOS | BOTTOM OF STEEL |
| BRG | BEARING |
| CJ | CONTROL JOINT |
| CL | CENTERLINE |
| CLR | CLEAR |
| CMU | CONCRETE MASONRY UNIT |
| COL | COLUMN |
| CONC | CONCRETE |
| CONST | CONSTRUCTION |
| CONT | CONTINUOUS |
| CU | CONDENSING UNIT |
| DIA | DIAMETER |
| DSD | DIRECTS SHIPPING DELIVERY |
| EAS | ELECTRONIC ARTICLE SURVEILLANCE |
| EDC | ELECTRICAL DISTRIBUTION CENTER |
| EIFS | EXTERIOR INSULATION AND FINISH SYSTEM |
| EF | EXHAUST FAN |
| EJ | EXPANSION JOINT |
| EL | ELEVATION |
| ELEC | ELECTRICAL |
| EQ | EQUAL |
| ETR | EXISTING TO REMAIN |
| EW | EACH WAY |
| EWC | ELECTRIC WATER COOLER |
| FDN | FOUNDATION |
| FF | FINISHED FLOOR |
| FRP | FIBER REINFORCED PLASTIC |
| FS | FAR SIDE |
| FTG | FOOTING |
| FV | FIELD VERIFY |
| GA | GAUGE |
| GC | GENERAL CONTRACTOR |
| GM | GENERAL MERCHANDISE |
| GR | GROCERY |
| GYP BD | GYPSUM BOARD |
| HC | HANDICAP |
| HDTV | HIGH DEFINITION TELEVISION |
| HORIZ | HORIZONTAL |
| HSA | HEADED STUD ANCHOR |
| HSS | HOLLOW STRUCTURAL SECTION |
| HT | HEIGHT |
| INFO | INFORMATION |
| ISO | ISOLATION |
| JBE | JOIST BEARING ELEVATION |
| JST | JOIST |
| JT | JOINT |
| KSI | KIPS PER SQUARE INCH |
| L | LENGTH |
| LB | POUNDS |
| LLH | LONG LEG HORIZONTAL |
| LLV | LONG LEG VERTICAL |
| LONG | LONGITUDINAL |
| MAX | MAXIMUM |
| MAU | MECHANICAL AIR UNIT |
| ME | MASONRY ELEVATION |
| MECH | MECHANICAL |
| MEP | MECHANICAL ELECTRICAL PLUMBING |
| MFR | MANUFACTURER |
| MIN | MINIMUM |
| MISC | MISCELLANEOUS |
| MO | MASONRY OPENING |
| MTL | METAL |
| NIC | NOT IN CONTRACT |
| NO | NUMBER |
| NS | NEAR SIDE |
| NTS | NOT TO SCALE |
| OC | ON CENTER |
| OD | OUTSIDE DIAMETER |
| OH | OPPOSITE HAND |
| PAF | POWDER ACTUATED FASTENER |
| PCF | POUNDS PER CUBIC FOOT |
| PFC | PAINT, FIX, CLEAN |
| PL | PLATE |
| PLAM | PLASTIC LAMINATE |
| PLAST | PLASTIC |
| PLF | POUNDS PER LINEAR FOOT |
| PMEJ | PREMOLDED EXPANSION JOINT |
| PSF | POUNDS PER SQUARE FOOT |
| PSI | POUNDS PER SQUARE INCH |
| PVC | POLYVINYL CHLORIDE |
| QTY | QUANTITY |
| RC | REFRIGERATION CONTRACTOR |
| REF | REFER TO |
| REINF | REINFORCING |
| REQD | REQUIRED |
| REV | REVERSE |
| RO | ROUGH OPENING |
| RTU | ROOF TOP UNIT |
| RXPFC | PHARMACY PAINT FIX CLEAN |
| SCB | SANITARY COVE BASE |
| SCHED | SCHEDULE |
| SDI | STEEL DECK INSTITUTE |
| SIM | SIMILAR |
| SJI | STEEL JOIST INSTITUTE |
| SPECS | SPECIFICATIONS |
| SS | STAINLESS STEEL |
| STD | STANDARD |
| STRUC | STRUCTURAL |
| T&B | TOP AND BOTTOM |
| TEMP | TEMPERED |
| THK | THICKNESS |
| TO | TOP OF |
| TOC/TC | TOP OF CONCRETE |
| TOF | TOP OF FOOTING |
| TOGB | TOP OF GRADE BEAM |
| TOM | TOP OF MASONRY |
| TOP/TP | TOP OF PAVING |
| TOS | TOP OF STEEL |
| TRANS | TRANSVERSE |
| TYP | TYPICAL |
| UNO | UNLESS NOTED OTHERWISE |
| VCPFC | VISION CENTER PAINT FIX CLEAN |
| VERT | VERTICAL |
| W | WIDTH |
| WM | WALMART |
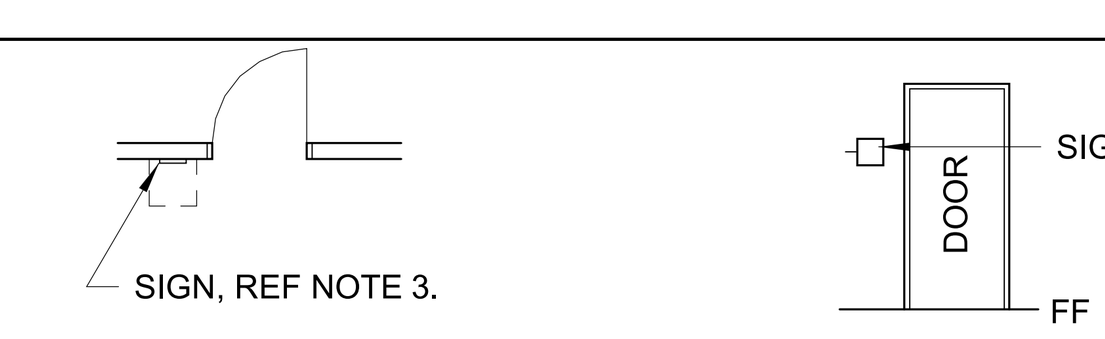
# DEFINITION LEGEND

FINAL MERCHANDISE PLAN - FINALIZED MERCHANDISE PRINT FROM WM ALSO REFERRED TO AS THE DEAL BOX COPY

2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com
Florida Corporate Certificate #AA C000526
Cuhaci & Peterson
Architects Engineers Planners

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 PROTO: 188 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | LS |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |




12/20/21

GENERAL INFORMATION

SHEET: N1

12/20/2021 4:12:10 PM
C:\Users\jeritsa.negronquiros\Documents\00767_LakeCity_FL_188_L_ARCH_V20_jeritsa.negronquiros.rvt
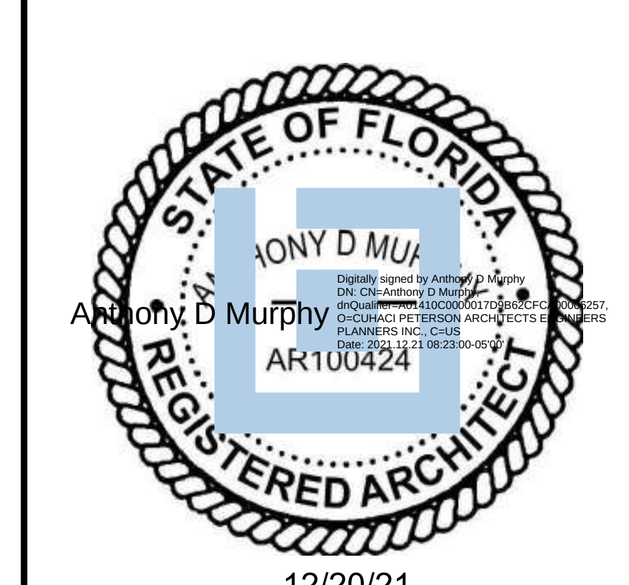
# BID ALLOWANCE SCHEDULE

THE QUANTITIES PROVIDED BELOW ARE FOR PRELIMINARY ESTIMATING/BIDDING PURPOSES ONLY.

| ITEM DESCRIPTION | QTY | ADDITIONAL NOTES | SHEET REFERENCE |
|---|---|---|---|
| CART CORRALS | 13 CORRALS | | SP1 |
| DUST WALL | 20 LF | TENANT SPACE | D1 |
| | 180 LF | REFRIGERATED CASES | |
| GONDOLA SHELVES | 40 SHELVES | | A1 |
| CASH WRAPS | 14 | | A1 |
| PIPE INSULATION | 24 LF | | A1 |
| STRAPPED EQUIPMENT | 54 | | A1 (SC) |
| CLEAN/SPILL STATION ATTACHMENTS | 5(SC) | COLUMN ATTACHMENT - MOUNTING BRACKET W/ (2) STEEL SELF DRILLING #10 x 1" TEK SCREWS. DRYWALL ATTACHMENT - MOUNTING BRACKET W/ (2) #10 x 1" WOOD SCREWS. INSTALL 2x6 WOOD BLOCKING at 4' TO CENTER AFF | C2 |
| WALL FINISH | 100 SF (SC) | GYP - SALES FLOOR (CUSTOMER VISIBLE AREAS) | A1 (SC) |
| | 100 SF (SC) | FRP - GROCERY SERVICE (CUSTOMER VISIBLE AREAS) | A1 (SC) |
| | 100 SF (SC) | TILE - GROCERY SERVICE (CUSTOMER VISIBLE AREAS) | A1 (SC) |
| | 25 LF (SC) | BASE - GROCERY SERVICE (CUSTOMER VISIBLE AREAS) | A1 (SC)<br>A1.1 (WNM) |
| FLOOR FINISH | 60 SF (SC) | TILE AND/OR EPOXY - GROCERY SERVICE (CUSTOMER VISIBLE AREAS) | A1 (SC)<br>A1.1 (WNM) |
| BOLT HOLES/ SPALLS TO REPAIR | 90 | | A1.1 |
| JOINT REPLACEMENT | 0 | SALES FLOOR AND CUSTOMER AREAS | A1.1 (SC) |
| | 122 LF | FRONT SIDEWALK AT ENTRANCES | A1.1 (SPRB |
| CEILING | --- | REF SA1 CEILING SCHEDULE | |

# CEILING SCHEDULE SC

| CEILING TILE BID ALLOWANCES | | |
|---|---|---|
| NON SALES AREA (EDIT AS REQUIRED PER PROJECT) | OFFICES (CASH, COUNT, MANAGEMENT, TRAINING, MARKET MANAGER, AP OFFICE, UPC/INVOICING, CLAIMS, OFFICE AND ALCOVES. | 26 |
| | COURTESY DESK (CUSTOMER SERVICE) (INCLUDING RETURN STORAGE) | 8 |
| | VISION CENTER (SALES, WAITING AND OFFICES / EXAM ROOMS) | 8 |
| | ACC CUSTOMER SERVICE (AND WAITING AREA) | 8 |
| | SITE TO STORE / LAYAWAY / PICKUP | 8 |
| | BREAKROOM | 24 |
| | GROCERY (PROVIDE QUANTITY OF TILES TO BE REPLACED USING EXISTING REFLECTED CEILING PLANS AND OR LIGHTING PLANS) | 14 |
| | PHARMACY | FULL TILE REPLACEMENT |
| | ALL OTHER ROOMS | ETR (UNO) |
| CEILING CLEANING | | |
| ALL CEILING TYPES | REFERENCE SPEC 01740 | |


2600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cpzarch.com
Cubar & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT A SPECIFIC TIME. CONTEMPORANEOUSLY WITH ITS ISSUE. SIMILAR BUILDINGS MAY BE PLANNED AT A DIFFERENT PROJECT SITE OR AT A LATER TIME. THIS DRAWING IS COPYRIGHTED AND PROTECTED BY THE EXCLUSIVE RIGHTS OF THE ARCHITECT AND ENGINEER. REPRODUCTION OF THIS DRAWING OR DESIGN FOR USE ON ANY OTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 221035 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

CHECKED BY: ADM
DRAWN BY: LS
PROTO CYCLE: 09/24/21
DOCUMENT DATE: 11/22/21

STATE OF FLORIDA
ANTHONY D MURRAY
REGISTERED ARCHITECT
ANTHONY D MURRAY
AR100424
12/20/21

SCHEDULES AND ALLOWANCES

SHEET:
SA1


12/20/2021 4:21:18 PM
C:\Users\lsmith.cpz\Documents\Documents\WWT_LakeCity_FL_168_L_ARCH_V28_lsmith.cpz@cubarpeterson.rvt

**TOTAL EGRESS FOR SALES FLOOR OCCUPANCY: 2,412**

1. IF ONLY MEANS OF CUSTOMER ENTRANCE IS THROUGH ONE EXTERIOR WALL OF BUILDING, ONE-HALF OF REQUIRED EGRESS WIDTH FROM THE FLOOR SHALL BE LOCATED IN SUCH WALL (37.2.5.7)

1,206 OCC x .20 = 242 REQUIRED
2,990 OCC x .20 = 558 PROVIDED

2. NOT LESS THAN ONE-HALF OF REQUIRED EXITS SHALL BE LOCATED SO AS TO BE REACHED WITHOUT PASSING THROUGH CHECKOUT (37.2.5.8)

1,206 OCC x .20 = 242 REQUIRED
3,790 OCC x .20 = 791 PROVIDED

**DISTANCE OF TRAVEL - 2020 FBC TABLE 1017.2 AND NFPA (EXISTING MERCANTILE) 37.2.6.1**

| | |
|---|---|
| FBC; SPRINKLERED | 250' |
| NFPA; SPRINKLERED | 250' |

**OCCUPANCY LOAD CALCULATIONS - 2020 FBC TABLE 1004.5 AND NFPA TABLE 7.3.1.2:**

| | | | | | |
|---|---|---|---|---|---|
| GROUND FLOOR RETAIL SALES | 144682.88 SF | / 60 | = | 2,412 | OCCUPANTS |
| OUTDOOR FENCED | 10649.70 SF | / 60 | = | 178 | OCCUPANTS |
| TRAINING | 357.99 SF | / 20 | = | 18 | OCCUPANTS |
| BREAKROOM | 1412.75 SF | / 15 | = | 94 | OCCUPANTS |
| FOOD TENANT | 264.47 SF | / 15 | = | 18 | OCCUPANTS |
| KITCHEN | 3871.25 SF | / 200 | = | 19 | OCCUPANTS |
| OFFICE | 2092.58 SF | / 150 | = | 15 | OCCUPANTS |
| STOCKROOM | 33739.10 SF | / 300 | = | 113 | OCCUPANTS |
| AUTO SERVICE CENTER | 3507.31 SF | / 50 | = | 71 | OCCUPANTS |
| LIQUOR STORE: SALES | 755.88 SF | / 60 | = | 13 | OCCUPANTS |
| TOTAL OCCUPANCY LOAD | 201333.91 SF | | | 2,951 | |

**EGRESS WIDTH REQUIRED - 2020 FBCSECTION 1005.3.2 AND NFPA TABLE 7.3.3.1**
**EXIT ACCESS TRAVEL DISTANCE: TABLE 1017.2**

FBC: EXIT ACCESS TRAVEL DISTANCE W/ SPRINKLER SYSTEM

| | |
|---|---|
| OCCUPANCY: ASSEMBLY | 250' |
| MERCANTILE | 250' |
| BUSINESS | 300' |
| STORAGE | 400' |
| NFPA; SPRINKLERED | 250' |

| | | |
|---|---|---|
| EGRESS INCHES REQUIRED | (FBC) | 0.20 INCHES PER PERSON SERVED |
| EGRESS INCHES REQUIRED | (NFPA) | 0.20 INCHES PER PERSON SERVED |

MINIMUM CLEAR WIDTH=

| | |
|---|---|
| 33" | FOR 3'-0" DOOR OPENING |
| 44" | FOR 4'-0" DOOR OPENING |
| 90" | FOR 8'-0" DOOR OPENING |
| 102" | FOR 9'-0" DOOR OPENING |
| 136" | FOR 12'-0" DOOR OPENING |
| 72" | FOR 14'-0" OPD DOOR OPENING |

EGRESS WIDTH REQUIRED (INCHES) EQUALS:
(AREA OCCUPANT LOAD) x (EGRESS WIDTH PER PERSON SERVED)

**SALES & FOOD TENANT:**

| | | | | | |
|---|---|---|---|---|---|
| 2473 | OCCUPANTS | x 0.2 | = 495 | | INCHES REQUIRED |
| 17 | 3'-0" DOORS | x 33 | = 561 | | INCHES PROVIDED |
| 4 | 12'-0" DOORS | x 136 | = 544 | | INCHES PROVIDED |
| TOTAL INCHES PROVIDED | | | 1105 | | |

**STOCKROOM/OFFICE/TRAINING/KITCHEN:**

| | | | | | |
|---|---|---|---|---|---|
| 153 | OCCUPANTS | x 0.2 | = 31 | | INCHES REQUIRED |
| 7 | 3'-0" DOORS | x 33 | = 231 | | INCHES PROVIDED |
| TOTAL INCHES PROVIDED | | | 231 | | |

**TOTAL:**

| | | | | | |
|---|---|---|---|---|---|
| 2720 | OCCUPANTS | x 0.2 | = 544 | | INCHES REQUIRED |
| 24 | 3'-0" DOORS | x 33 | = 792 | | INCHES PROVIDED |
| 6 | 12'-0" DOORS | x 136 | = 816 | | INCHES PROVIDED |
| TOTAL INCHES PROVIDED | | | 1608 | | |

**BREAKROOM EGRESS:**

| | | | | | |
|---|---|---|---|---|---|
| 94 | OCCUPANTS | x 0.2 | = 19 | | INCHES REQUIRED |
| 1 | 4'-0" DOORS | x 44 | = 44 | | INCHES PROVIDED |
| TOTAL INCHES PROVIDED | | | 44 | | |

**OUTDOOR SALES; FENCED AREA**

| | | | | | |
|---|---|---|---|---|---|
| 115 | OCCUPANTS | x 0.2 | = 23 | | INCHES REQUIRED |
| 1 | 3'-0" DOORS | x 33 | = 33 | | INCHES PROVIDED |
| TOTAL INCHES PROVIDED | | | 33 | | |

**AUTO SERVICE CENTER:**

| | | | | | |
|---|---|---|---|---|---|
| 71 | OCCUPANTS | x 0.2 | = 15 | | INCHES REQUIRED |
| 3 | 3'-0" DOORS | x 33 | = 99 | | INCHES PROVIDED |
| TOTAL INCHES PROVIDED | | | 99 | | |

**LIQUOR BOX:**

| | | | | | |
|---|---|---|---|---|---|
| 13 | OCCUPANTS | x 0.2 | = 3 | | INCHES REQUIRED |
| 1 | 11'-6" DOORS | x 130 | = 130 | | INCHES PROVIDED |
| TOTAL INCHES PROVIDED | | | 130 | | |

## SHEET NOTES

1. WHERE MERCHANDISE OR OTHER OBSTRUCTION OCCURS, NO LESS THAN ONE AISLE OF A 60" MINIMUM CLEAR WIDTH SHALL LEAD DIRECTLY TO AN EXIT FOR A CLASS A MERCANTILE OCCUPANCY (37.2.5.6).
2. ALL EXIT SIGNS AND EMERGENCY LIGHTS ARE EXISTING TO REMAIN AND WILL BE SUBJECT TO INSPECTION FROM THE FIRE MARSHAL HAVING AUTHORITY PRIOR TO FINAL APPROVALS.
3. 250' MAX. TRAVEL DISTANCE IS SHOWN AS A DASHED LINE.
4. MODIFICATION (43.2.2.1.3) THE RECONFIGURATION OF ANY SPACE; THE RECONFIGURATION OR EXTENSION OF ANY SYSTEM; OR INSTALATION OF ANY ADDITIONAL EQUIPMENT

## LEGEND

LINE REPRESENTS 250 FEET OR LESS OF TRAVEL DISTANCE TO EXIT DOORS WITH DIRECTION ARROW

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATION IN THEIR RELATED FIELD. THE FAILURE OF ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR
DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

REFERENCE SHEET A1 FOR CODE REFERENCES AND GATE NOTES.




3 ENLARGED GR ENTRY PLAN
1/8" = 1'-0"




2 ENLARGED GM ENTRY PLAN
1/8" = 1'-0"

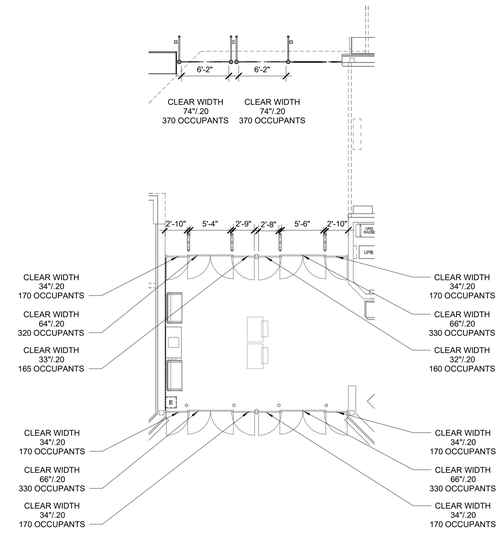


1 LIFE SAFETY PLAN
1" = 30'-0"


2600 Maitland Center Parkway
Suite 250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cpzarch.com
Cedars & Peterson
Architects Engineers Planners

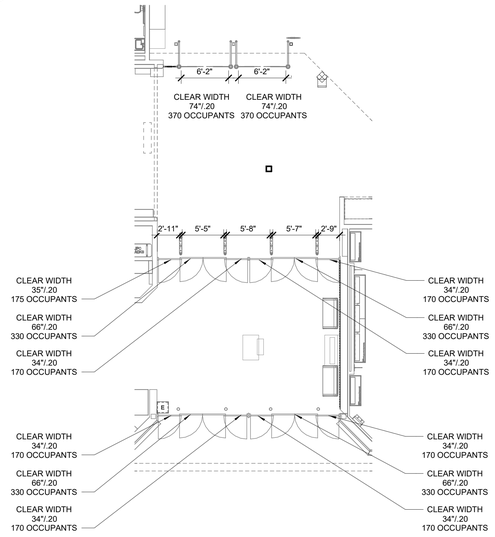
STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC PROJECT AT A SPECIFIC TIME AND IS NOT INTENDED FOR USE ON ANY CONTEMPORANEOUSLY WITH ITS ISSUE. CEDARS & PETERSON ARCHITECTS, INC. ASSUMES NO LIABILITY FOR ANY SUCH USE OF THESE DRAWINGS ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. THESE DRAWINGS ARE COPYRIGHTED AND RESTRICTED FOR USE EXCEPT FOR AND WITH RESPECT TO THE SPECIFIC PROJECT AND SITE FOR WHICH THEY WERE PREPARED AND PUBLISHED. NO PART OF THESE DRAWINGS, INCLUDING BUT NOT LIMITED TO ENGINEERS, REPRODUCTION OR THE INFORMATION CONTAINED THEREIN, SHALL BE USED ON ANY OTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

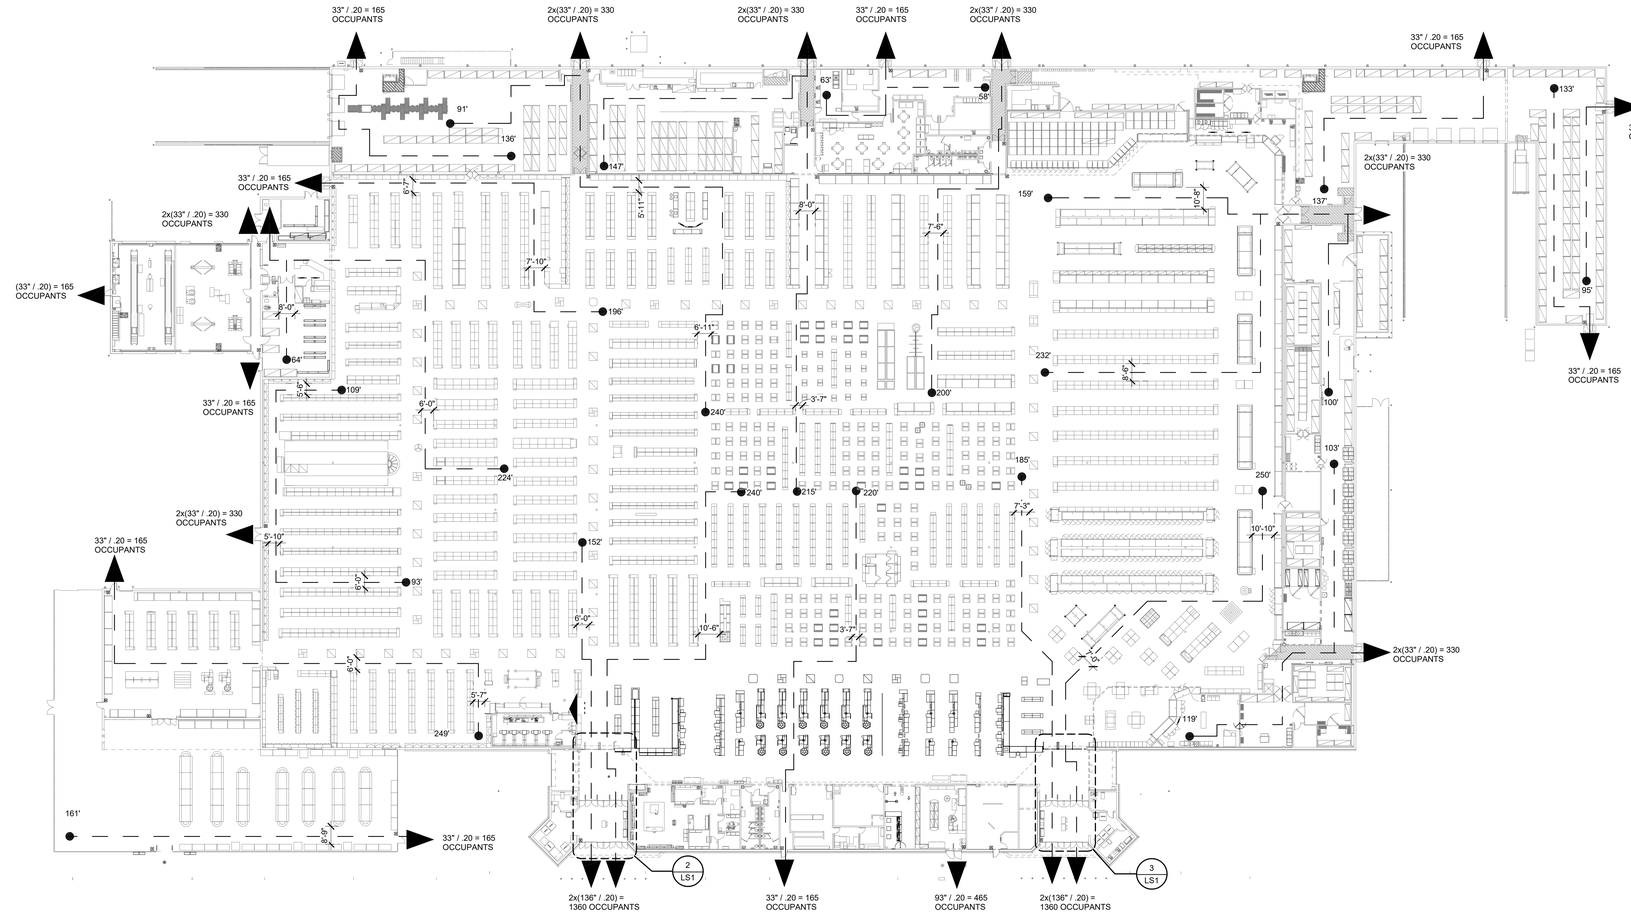CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 210335 | PROTO | 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | YB |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
AR100424
REGISTERED ARCHITECT
12/20/21

LIFE SAFETY PLAN

SHEET:
LS1

12/20/2021 4:12:43 PM
C:\Users\yerba.hargrove\Documents\WORK_LakeCity_FL_168_L_ARCH_VSI_yerba.hargrove.rvt




## 7 GC BOLLARD ENTRY PLAN
3/16" = 1'-0"




## 6 GC BOLLARD DEMO PLAN
3/16" = 1'-0"

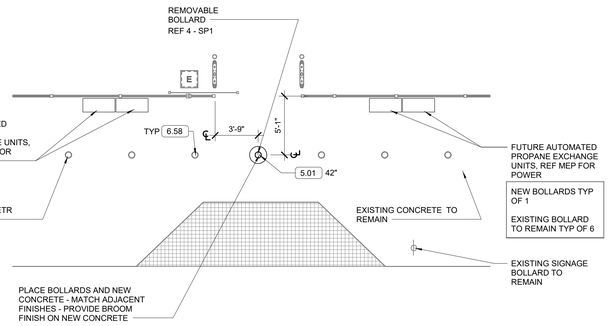


## 3 GM BOLLARD ENTRY PLAN
3/16" = 1'-0"

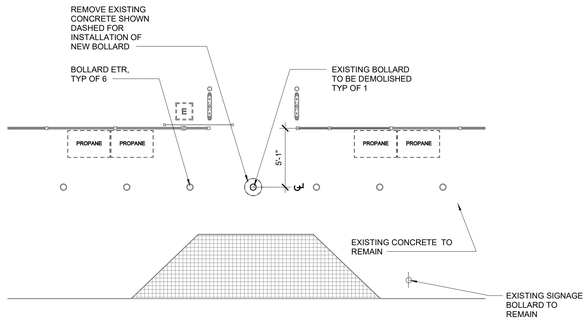


## 2 GR BOLLARD ENTRY PLAN
3/16" = 1'-0"

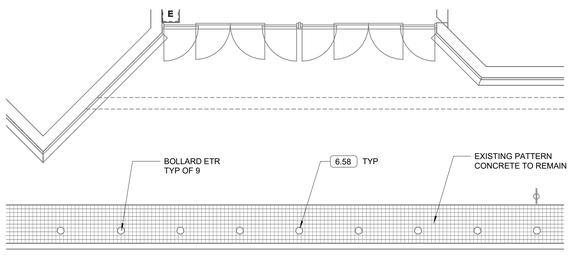


## 5 LIQUOR BOLLARD ENTRY PLAN
3/16" = 1'-0"

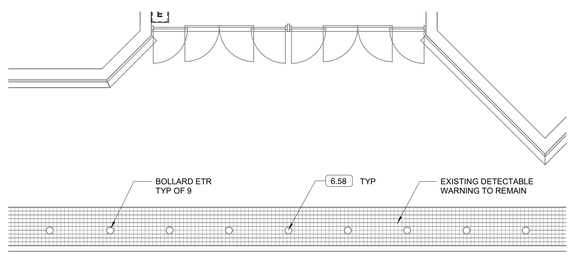


## 4 REMOVABLE BOLLARD
1/2" = 1'-0"

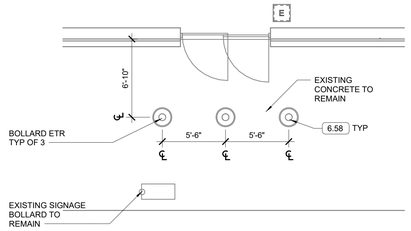


## 1 SITE PLAN
1" = 30'-0"

## SITE SHEET NOTES

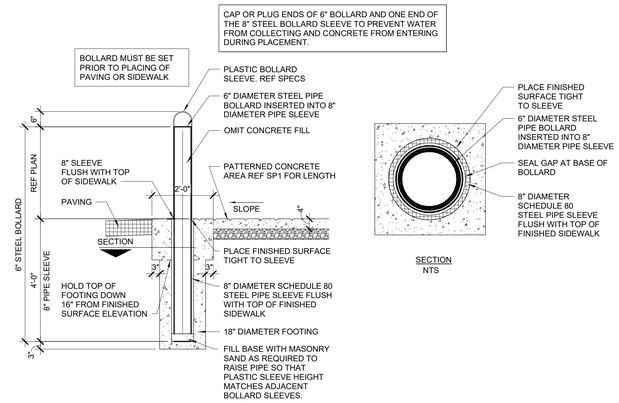1. POWER WASH SIDEWALK AROUND THE ENTIRE PERIMETER OF BUILDING.
2. PROVIDE NEW SEALANT AT ALL JOINTS BETWEEN EXTERIOR BUILDING WALLS AND ADJACENT CONCRETE SIDEWALK/PAVING, REF SPEC 07900. IF PRESENT, REMOVE EXISTING SEALANT AND BACKER PRIOR TO RE-SEALING JOINTS
3. REPAINT PERIMETER SIDEWALK AND FIRE LANE CURB
4. RAISE ALL SITE SIGNS WITHIN CLOSE PROXIMITY TO STRUCTURE TO 7'-0" ABOVE GRADE.
5. REPLACE ALL DAMAGED, MISSING, OR FADED SITE SIGNS WITHIN CLOSE PROXIMITY TO STRUCTURE.
6. NOT USED.

## KEYNOTES
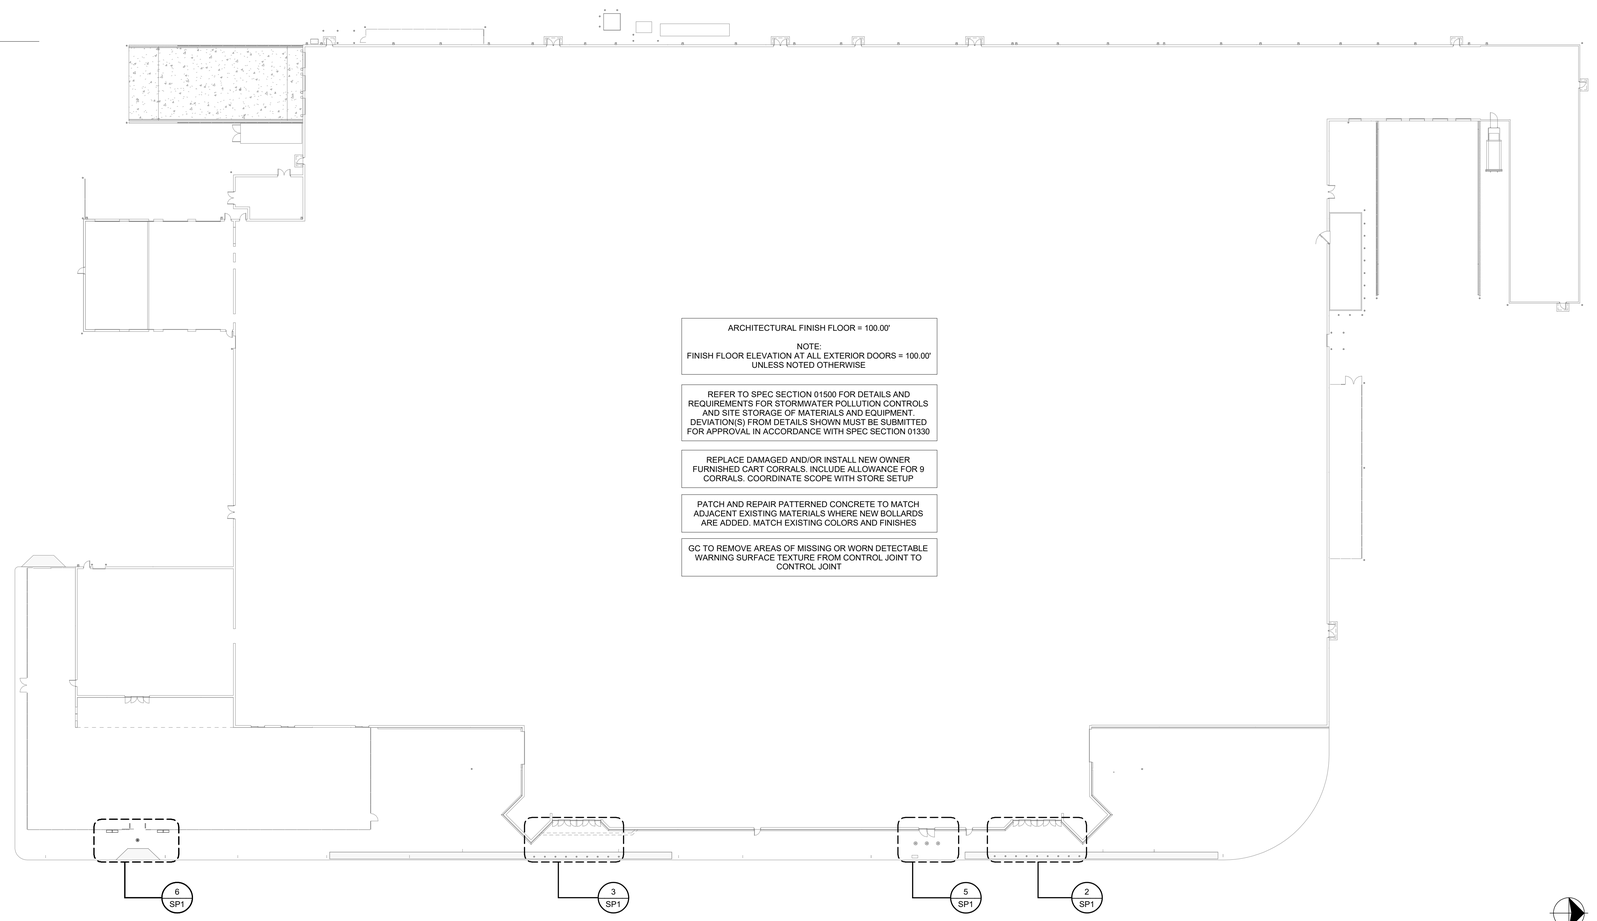
| | |
|---|---|
| **5.01** | 6" PIPE BOLLARD WITH GRAY PLASTIC SLEEVE (HEIGHT OF SLEEVE NOTED ADJACENT TO KEYNOTE) |
| **6.58** | INSTALL GRAY BOLLARD COVERS AT ALL FRONT ENTRANCE BOLLARDS. ANCHOR COVERS TO BOLLARD. REF SPEC. |


2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8091
www.cpaol.com
Cedarst & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT TO BE CONTEMPORANEOUSLY WITH ITS ISSUE, CHANGED OR USED ON ANY OTHER PROJECT AT A DIFFERENT PROJECT SITE OR AT A LATER TIME WITHOUT THE EXPRESS WRITTEN CONSENT OF CEDARST & PETERSON, INC. AND ITS PRINCIPALS. ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT, IN THIS PROJECT, REPRODUCTION OR FILING OF THIS DRAWING FOR USE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 PROTO 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

CHECKED BY: ADM
DRAWN BY: SPA
PROTO CYCLE: 09/24/21
DOCUMENT DATE: 11/22/21

STATE OF FLORIDA
ANTHONY D MURPHY
REGISTERED ARCHITECT
AR100424
12/20/21

SITE PLAN

SHEET: SP1


12/20/2021 4:12:59 PM
C:\Users\pshaw.cedarst\Documents\WWT_LakeCity_FL_168_LARCH_V25_pshaw.wspmaintrk.rvt

## DEMOLITION LEGEND

- EXISTING TO REMAIN
- DEMOLISH/REMOVE/RELOCATE
- AREA TO BE DEMOLISHED

## SHEET NOTES

1. DEMOLITION INCLUDES BUT IS NOT LIMITED TO ITEMS SHOWN DASHED. REF DEMOLITION REQUIREMENT NOTE ON N1 SHEET.
2. REMOVE ALL DOORS SHOWN DASHED. REFER TO ENLARGED PLANS AND DOOR SCHEDULE FOR DOOR AND FRAME REPLACEMENT.




## 6 TEMPORARY BARRIER/DUST DRAPE

3/4" = 1'-0"




## 5 DUST WALL SECTION

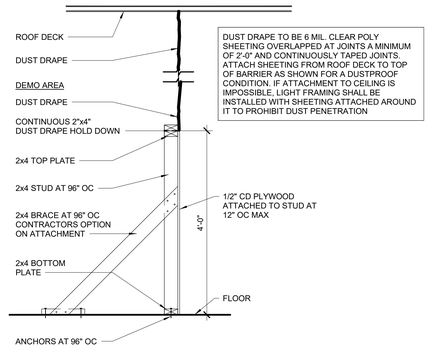3/4" = 1'-0"




CONTRACTOR NOTES:
1. SAWCUT EDGES SHALL BE STRAIGHT AND EITHER PARALLEL EXISTING CONTROL/CONSTRUCTION JOINTS. SAWCUTS AT AN ANGLE TO THE EXISTING CONTROL JOINT PATTERN WILL NOT BE ALLOWED UNDER ANY CIRCUMSTANCES.
2. PRIOR TO CUTTING, INSTALL 36" WIDE ROSIN PAPER EACH SIDE OF PROPOSED EDGE CUTS IN ORDER TO REDUCE SCARRING OF SLAB THAT IS TO REMAIN.
3. NO OVERCUTTING SHALL BE ALLOWED AT EDGES OR CORNERS OF TRENCH AREA TO BE REMOVED. PORTIONS OF SLAB WHERE OVERCUTS OCCUR SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE, WITH NO EXTENSION OF THE CONSTRUCTION SCHEDULE.
4. PERFORM CUTTING OF EXISTING CONCRETE SLABS IN ACCORDANCE WITH THE DETAILS AND SPECIFICATIONS USING SAWS AND/OR CORE DRILLS. ALL SLAB CUTTING SHALL BE PERFORMED AT NIGHT AFTER THE BUILDING HAS CLOSED FOR BUSINESS. JACK-HAMMERS OR EXPLOSIVES WILL NOT BE ALLOWED AT ANY TIME.
5. USE REMOVAL METHODS THAT WILL NOT CRACK, UNDERMINE, OR STRUCTURALLY DISTURB ADJACENT SLABS OR PARTITIONS.
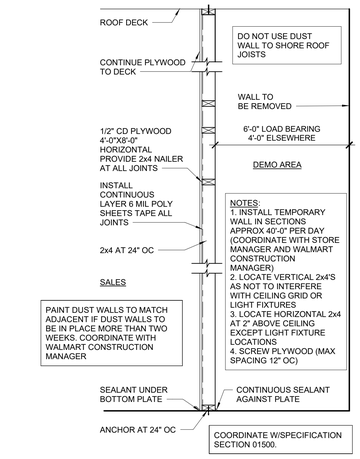
## 4 SLAB TRENCHING DETAIL

3/4" = 1'-0"

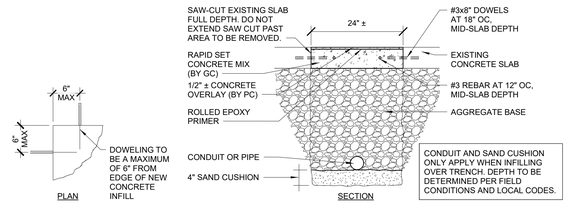


NOTE: TYPICAL WHERE UTILITY TRENCHES ARE CUT IN FLOORS OF FOOD AREAS WITHOUT CEILINGS / NOT ON AN EXTERIOR WALL

## 3 TEMPORARY FRP CLAD TRENCH BARRIER/DUST DRAPE

3/4" = 1'-0"

NOTE:
THE GENERAL CONTRACTOR SHALL REPAIR/REPLACE ANY DAMAGED FLOOR TILE DUE TO INSTALLATION OR REMOVAL OF TEMPORARY SECURITY ENCLOSURE.

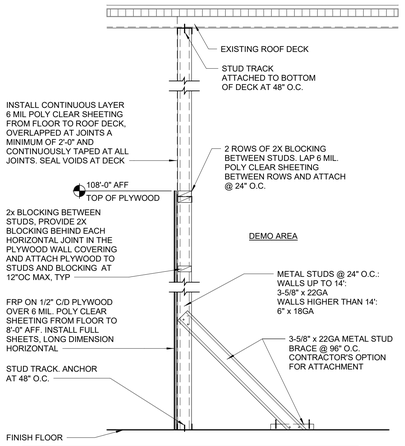


## 2 SECURITY ENCLOSURE

3/4" = 1'-0"




## 1 DEMOLITION PLAN

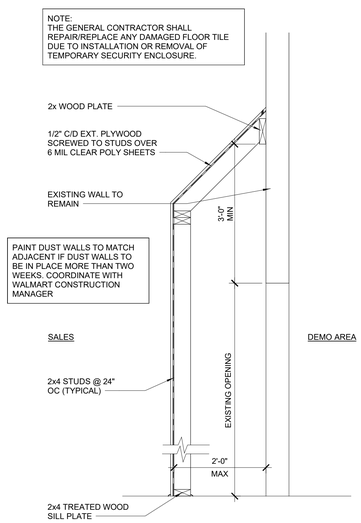1" = 30'-0"


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8791
www.cpaarchitects.com
Cabrera & Peterson Architects Engineers Planners


STIPULATION FOR REUSE

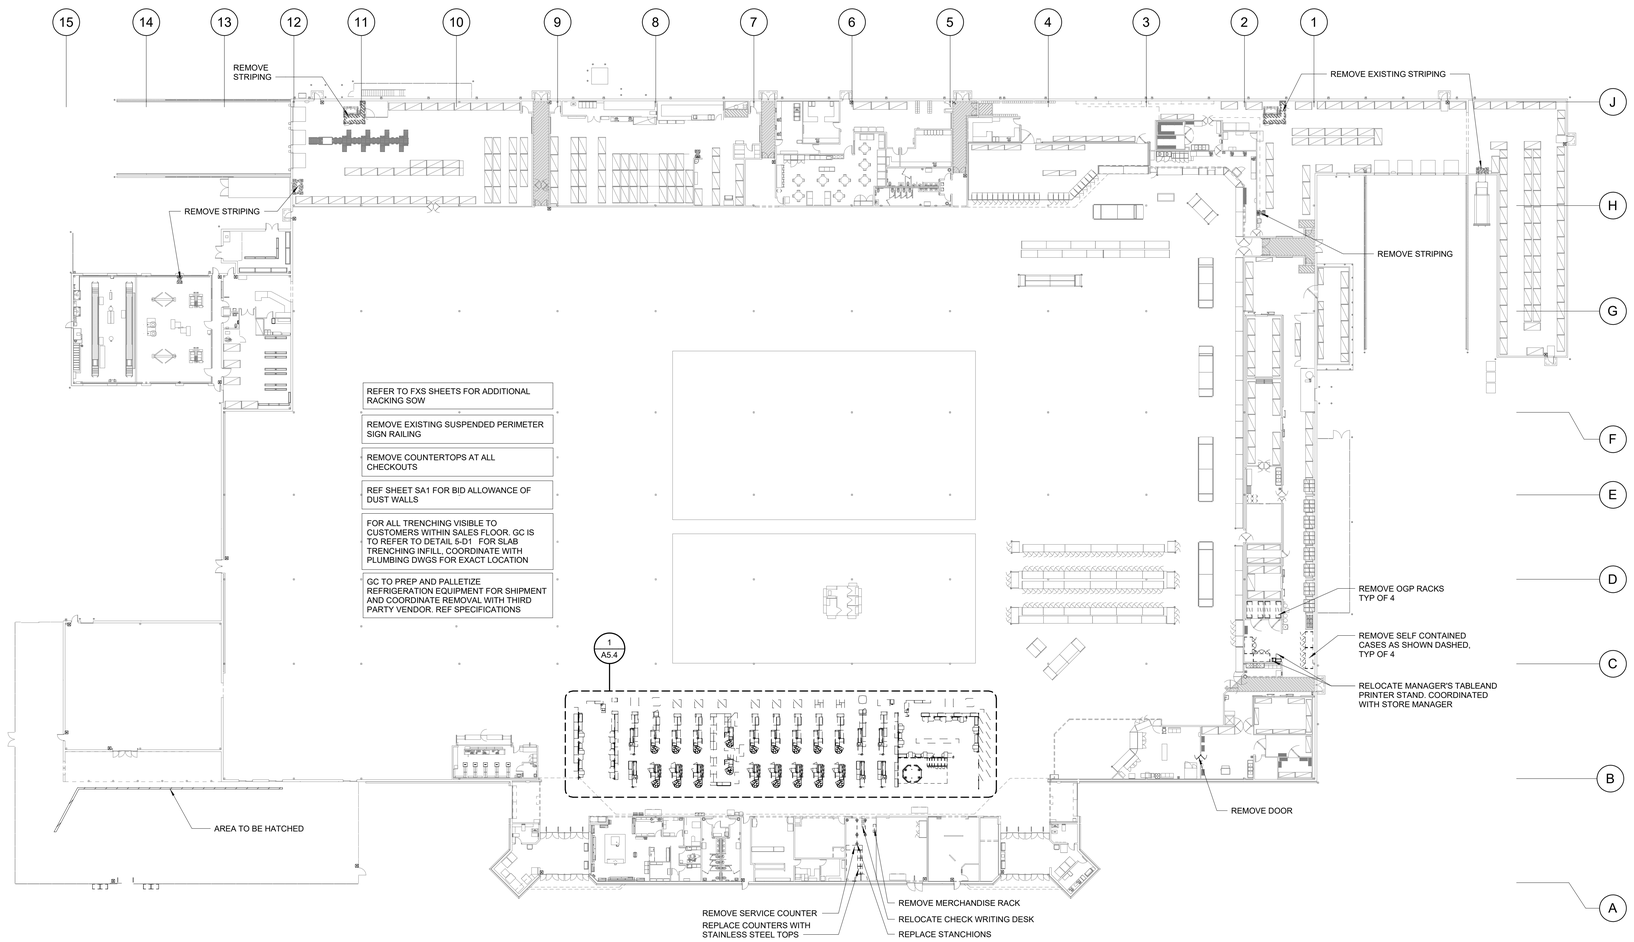
THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE DATE SUITABLE FOR REUSE ON ANOTHER OR A DIFFERENT PROJECT SITE OR A LATER REVISION OF THIS PROJECT. ANY REUSE WITHOUT THE EXPRESS AND WRITTEN VERIFICATION BY THE ENGINEER, REPRODUCTION OF THIS DRAWING IS STRICTLY PROHIBITED. ANY REUSE ON PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO FS 481.226.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210535 | PROTO | 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | JZ |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
TONY D MUI
REGISTERED ARCHITECT
AR100424
12/20/21

DEMOLITION PLAN

SHEET: D1

12/20/2021 4:13:19 PM
C:\Users\jzhao.cabrera\Documents\WORK_LocalFile_FL_168_LAKCITY_VTB_jzhao.rvt

**178 GM RECEIVING**

**WALLS**
- ETR.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**COMPACTOR**
- ETR.

**100 SALES, 900 GR SALES**

**WALLS**
- GYP BD: REF A1 FOR PAINT. INSTALL PS7 WAINSCOT AND DB5 BASE UNO, EXTEND WAINSCOT AND BASE AT EXPOSED WALL TO NEAREST MERCHANDISE RACK. REF 3-A3.
- CMU: REF A1 FOR PAINT. WHERE BASE IS EXISTING, IT IS ETR.
- GR SALES: REF GA1 AND GA2 FOR PAINT FINISHES.

**FLOOR**
- REF FLOOR FINISH PLAN.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

## SHEET NOTES

1. ENSURE ALL EXISTING WALL STANDARDS AND HALF GONDOLAS TO REMAIN ARE SECURE TO WALL.
2. RELOCATE AND/OR INSTALL PREFABRICATED CASH WRAP(S) FOR CHECKOUTS AND SERVICE COUNTERS. CAULK BASE TO FLOOR WHEN LOCATION IS FINALIZED.
3. RELOCATION AND SETUP OF GONDOLAS AND/OR RACKING AS INDICATED ON FXS SHEETS WILL BE PERFORMED BY OTHERS. ANCHORING OF UPRIGHTS TO BE PERFORMED BY GENERAL CONTRACTOR.

## KEYNOTES

| | |
|---|---|
| **9.90** | FLOOR STRIPES. REF N1 FOR STRIPING CONDITIONS. |
| **10.44** | PROVIDE TACTILE "EXIT" SIGN. REF N1. |




## 4 MONITOR SUPPORT BRACKET (OWNER FURNISHED)
3/4" = 1'-0"

**PREMANUFACTURED WALL SCHEDULE**

A 4'-0" LONG WALL PANEL ASSEMBLY
B 2'-0" LONG WALL PANEL ASSEMBLY
C CORNER GUARD
D 1'-0" LONG WALL PANEL ASSEMBLY

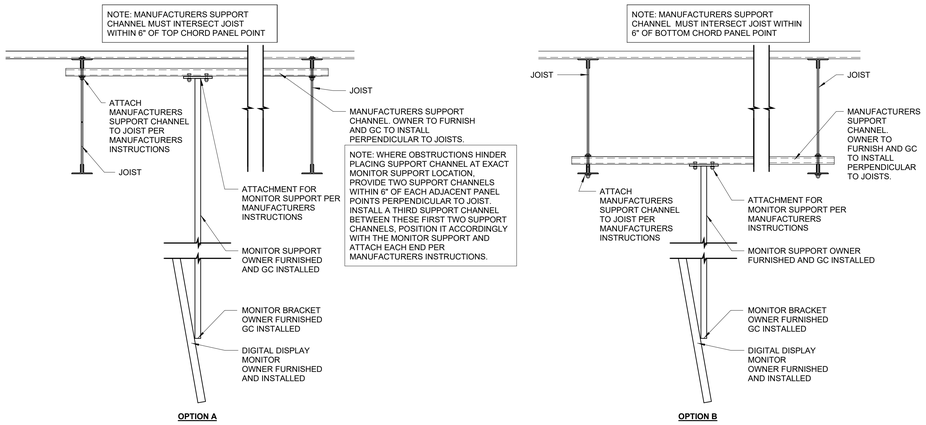


## 3 PHOTO LAB PLAN
1/4" = 1'-0"




NOTE: IF PRICE READERS, FIRE EXTINGUISHERS, PAPER TOWEL DISPENSERS, ETC ARE STRAPPED TO COLUMNS ON THE SALES FLOOR, REMOVE AND REINSTALL USING SCREWS. BID ALLOWANCE 50 ITEMS TO BE REATTACHED.

## 2 COLUMN COLORS
1/4" = 1'-0"

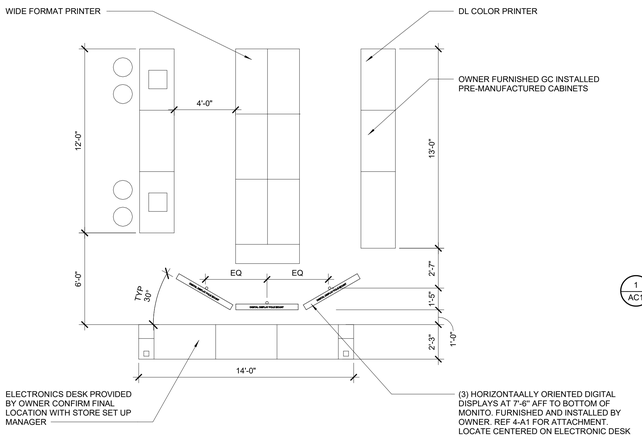


## 1 FLOOR PLAN
1" = 30'-0"

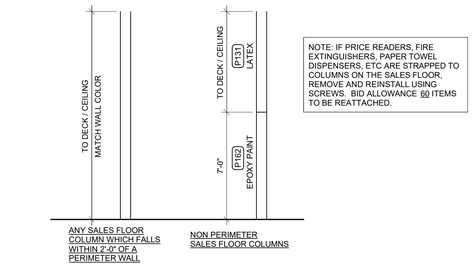
2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8791
www.cpaarchitects.com
Cubarr & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THE SPECIFIC PROJECT SHOWN AND CONTEMPORANEOUSLY WITH ITS ISSUE. CUBARR & PETERSON ARCHITECTS, P.A. IS NOT RESPONSIBLE FOR ANY MODIFICATIONS OR DIFFERENT PROJECT SITE OR A LATER DATE. THE USE OF THIS DRAWING IS RESTRICTED TO ONE EXAMPLE FOR ANOTHER PROJECT OR SITE WITHOUT THE WRITTEN PERMISSION OF CUBARR & PETERSON ARCHITECTS, P.A. REPRODUCTION OF THIS ENGINEERS, REPRODUCTION OF THIS DRAWING IS STRICTLY PROHIBITED. ANY PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

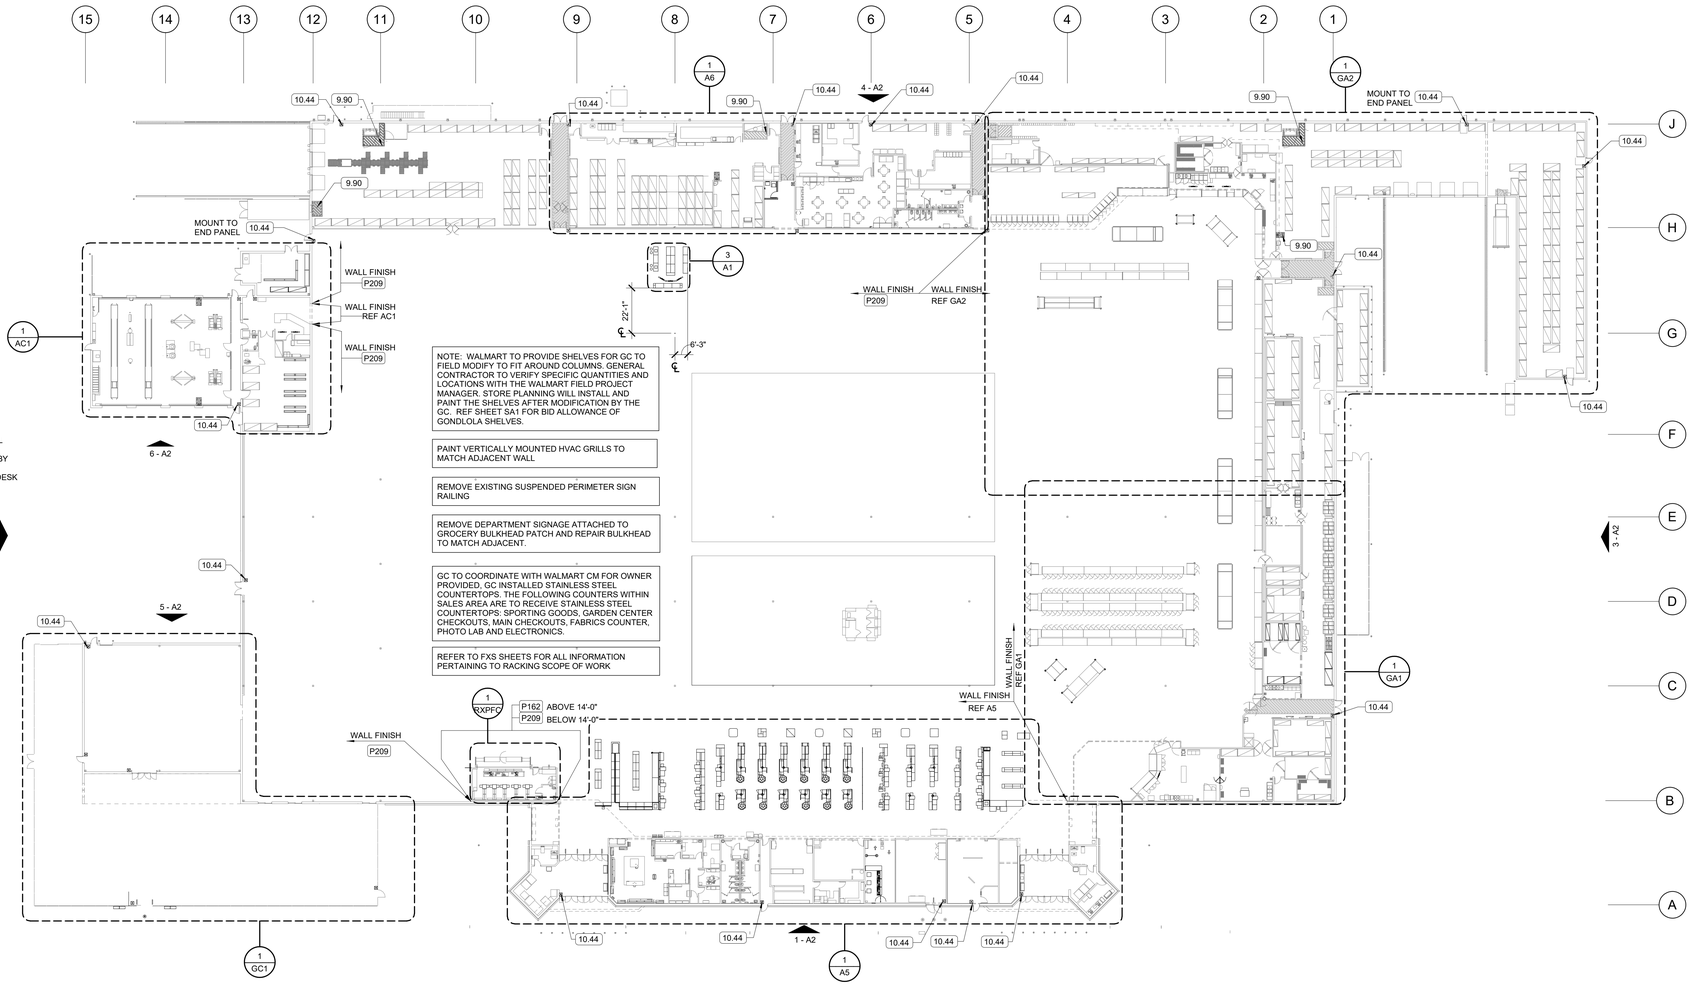
CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
JOB NUMBER: 210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | ASM |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
REGISTERED ARCHITECT
AR100424
12/20/21

FLOOR PLAN

SHEET: A1


12/20/2021 4:13:43 PM
C:\Users\jenka.hargrove\onedrive\documents\WIP\T_Lake\City_FL_168_SL_MROA_V26_jenka.hargrove.rvt

## FLOOR FINISH RESPONSIBILITY MATRIX 7

### ICC (POLISH) / PVC Conversion

**REMODEL PROJECT: 0767 LAKE CITY, FL**

**PROJECT SCOPE: ICC (LIMITED POLISH TO FIXTURE MOVE AREAS)**

**PREFERRED FLOORING CONTRACTOR: (RMI)**

| SCOPE OF WORK REMOVAL OF EXISTING AND INSTALLATION OF NEW: | CONTRACTOR RESPONSIBLE FOR WORK LISTED | | | |
|---|---|---|---|---|
| | PREFERRED FLOORING CONTRACTOR | GENERAL CONTRACTOR | REFRIGERATION CONTRACTOR | FLOORING NOTES |
| TENANT SPACES | X | | | |
| VISION CENTER | X | | | |
| APPAREL PADS - REMOVAL | X | | | |
| APPAREL PADS - STAIN BAND | X | | | |
| VESTIBULE - PORCELAIN | X | | | |
| PORCELAIN AT ENTRY TILE | X | | | |
| PHARMACY CARPET TILE | X | | | |
| RECYCLING CENTER PORCELAIN TILE | X | | | |
| FLOOR FINISHES IN GROCERY PREP AREAS (NON PUBLIC) | | X | | |
| RESTROOMS - CONCRETE OVERLAY | X | | | |
| RESTROOMS - TILE | | X | | |
| VESTIBULE - RUBBER FLOOR | X | | | 1 |
| REMOVAL AND INSTALLATION OF REFRG. CASE KICK PLATE | | X | | |
| FLOOR JOINT REPAIR (CUSTOMER AREAS) | X | | | |
| SLAB SURFACE ENHANCEMENT | X | | | |
| SEASONAL | X | | | |
| REMOVAL AND REPLACEMENT OF REFRIGERATED CASE PROTECTION | | X | | |
| REMOVAL AND/OR REPLACEMENT OF THRESHOLDS AT AUTOMATIC SLIDING DOORS BY VENDOR. GC TO SCHEDULE. | | X | | |

FLOORING NOTES

1. THRESHOLD AT AUTOMATIC ENTRANCE SLIDER DOOR TO BE REPLACED BY VENDOR.

## SHEET NOTES

1. REF STRUCTURAL DRAWINGS FOR EXPOSED AND INTEGRALLY COLORED CONCRETE FLOORS
2. REPAIR BOLT HOLES AND SPALLS RESULTING FROM MERCHANDISE FIXTURE AND OR STORAGE RACK RELOCATION OR REMOVAL. FILL ALL BOLT HOLES AND SPALLS RESULTING FROM FIXTURE AND OR STORAGE RACK RELOCATION OR REMOVAL IN NON CUSTOMER ACCESSIBLE AREAS WITH NON SHRINK GROUT. REF SHEET SA1 FOR BID ALLOWANCE OF BOLT HOLES /SPALLS TO REPAIR.
3. REMOVE AND REPLACE DAMAGED TRANSITION STRIPS TO MATCH EXISTING.

## LEGEND

- RUBBER FLOORING
- CARPET
- CONCRETE OVERLAY
- VINYL TILE
- LVT
- ICC




### 1 FINISH FLOOR PLAN
1" = 30'-0"




### 3 TRANSITION STRIP AT RUBBER FLOORING
12" = 1'-0"

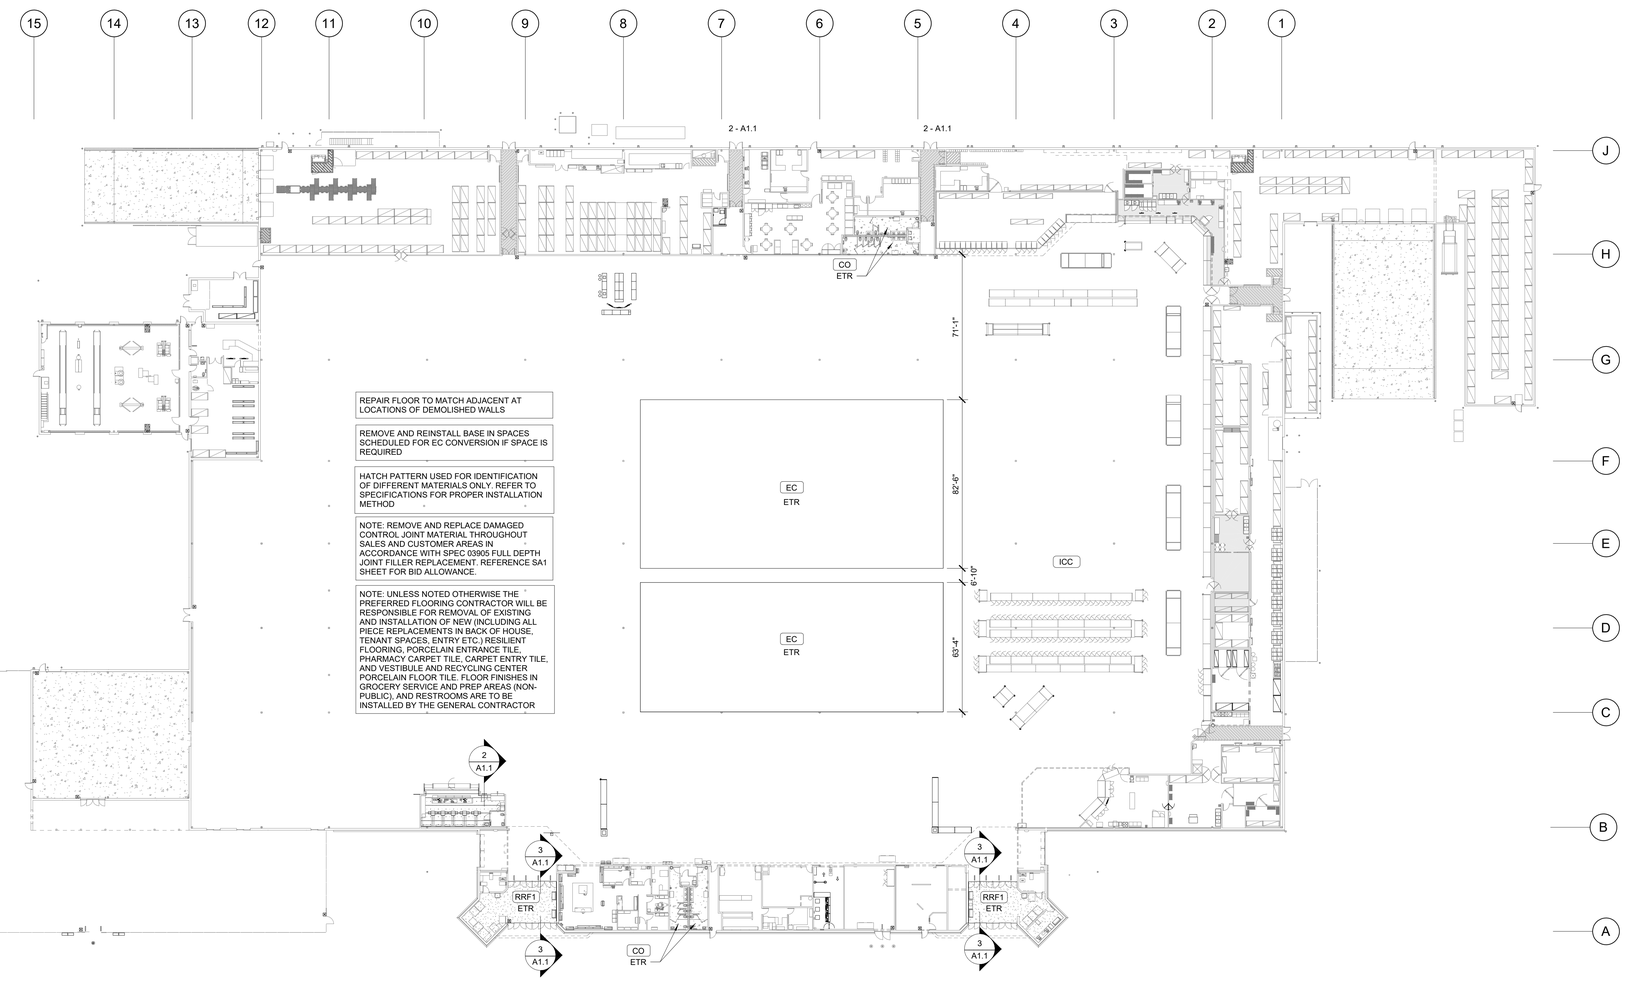


### 2 TRANSITION STRIP AT CARPET
12" = 1'-0"


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
AAC# 0007484
www.cpaarchitects.com

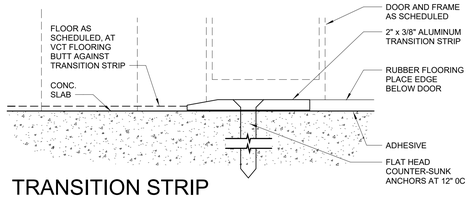Cooper & Peterson
Architects Engineers Planners

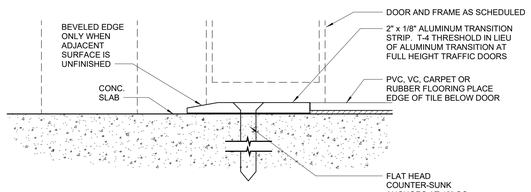

STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE, SUITABLE FOR REUSE ON ANY OTHER PROJECT OR AT A LATER TIME OR FOR ANY OTHER SITE WITHOUT THE EXPRESS WRITTEN CONSENT OF COOPER & PETERSON ARCHITECTS, INC. THE ARCHITECT, ENGINEER, REPRODUCTION OF THIS DRAWING IS STRICTLY PROHIBITED. ANY REUSE ON THIS OR ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 210335 | PROTO | 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | LS |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
REGISTERED ARCHITECT
ANTHONY D Murphy
AR100424
12/20/21

FLOOR FINISH PLAN

SHEET: A1.1

12/20/2021 4:14:01 PM
C:\Users\ptrivedi.cpa\projects\Documents\WINT_LakeCity_FL_MB_LARGA_V26_ptrivedi.cpa.rvt

## SITE PLAN

## SITE SIGNAGE: EXISTING

PYLON 1

AUTO CARE PYLON

## DISCLOSURES

- SIGN ORDINANCE: LAKE CITY, FLORIDA - CODE OR ORDINANCES CHAPTER 78 - SIGNS AND ADVERSTISING
- MAXIMUM HEIGHT ALLOWED FOR PYLON AND MONUMENT SIGNS IS 18 FT.
- SIGN SHOULD BE INCLUDED IN CALCLUATION OF SIGN AREA (1.50 TIMES LINEAR LOT FRONTAGE) FOR MAXIMUM SQ FOOTAGE ALLOWED.
- NO ADDITIONAL PYLON/MONUMENT SIGN CAN BE ADDED. 1 PER PROPERTY.
- NO RESTRICTION TO HOW MANY BUILDING WALL SIGNS ARE ALLOWED.
- SIGNAGE CALCAULATED WITH BOX METHOD.
- MAXIMUM SQ FOOTAGE FOR BUILDING SIGNS ALLOWED IS INCLUDED IN THE CALCULATION OF SIGN AREA (1.50 TIMES LINEAR LOT FRONTAGE)
- NO COLOR RESTRICTIONS FOR SIGNS.
- RESTRICTIONS TO THE ADDITION OF ONE OR MORE SIGNS TOTALING APPROX. 100 SQ FT.
- RESTRICTIONS WITH MODIFYING WALMART SIGN TO INCLUDE A BUMP OUT ABOVE THE PARAPET NO GREATER THAN TWO FT.
- NO RESTRICTIONS WITH PROPOSED COLOR SCHEMES.

## COLOR LEGEND

| | P# | COLOR NAME |
|---|---|---|
| | P49E | DARK GRAY |
| | P76U | WALMART BLUE (URETHANE-LIKE) |
| | P134E | LIGHT GRAY |
| | P135E | MEDIUM GRAY |
| | P162E | BLACK GRAY |
| | P5E | SAFETY YELLOW |
| | P81E | BLACK |

## DEMOLITION NOTES

1. REMOVE EXTERIOR TENANT SIGNS. COORDINATE REMOVAL WITH WALMART CM AND TENANT PRIOR TO BEGINNING WORK. DELIVER REMOVED TENANT SIGNS TO TENANT.
2. REMOVAL OF BUILDING MOUNTED ITEMS, SHOWN OR NOTED TO BE DEMOLISHED OR AS REQUIRED BY SCOPE OF WORK, SHALL OCCUR PRIOR TO PAINTING BUILDING. COORDINATE DEMOLITION WORK SO EXTERIOR PAINTING WILL OCCUR TO INSTALLATION OF BUILDING MOUNTED ITEMS.

## SHEET NOTES

1. PATCH AND REPAIR EXTERIOR WALL SURFACES, DAMAGED OR EXPOSED DUE TO REMOVAL OF BUILDING MOUNTED ITEMS, TO MATCH ADJACENT AS REQUIRED.
2. REFER TO DETAILS ON SHEET A2.1 FOR SUBSTRATE AND FINISH REQUIREMENTS AT LOCATIONS OF BUILDING MOUNTED SIGNS.
3. RESURFACE EXISTING EIFS WHERE SHOWN (HATCHED AREA).
4. NOT USED.
5. PRIOR TO PAINTING WALL AT LOCATION(S) OF LIT ID/LOGO SIGN(S), COORDINATE SCOPE OF WORK WITH WALMART CM.
6. IF PAINTING ADJACENT WALLS PAINT HOLLOW METAL STEEL DOORS, FRAMES, AND DOWNSPOUTS. EXPOSED METAL FLASHING, HANDRAILS, AND EXPOSED MISCELLANEOUS STEEL TO MATCH ADJACENT BUILDING COLOR UNO.
7. PAINT ANY NEW ROOFTOP GAS PIPING P5E WHERE EXTERIOR WALL IS BEING PAINTED, GAS PIPE ALONG SIDE WALL TO GRADE SHOULD MATCH ADJACENT BUILDING. DO NOT PAINT METER OR VALVES.
8. IF PAINTING ADJACENT WALLS PAINT CANOPY STRUCTURAL STEEL AND FLASHING TO MATCH ADJACENT WALL.
9. NOT USED.
10. PAINT ALL EXTERIOR ENTRY BOLLARDS TO MATCH EXISTING COLOR UNLESS NOTED TO RECEIVE PLASTIC BOLLARD SLEEVE.
11. NOT USED.
12. DO NOT PAINT LED WALL PACK HOUSINGS
13. PAINT GARDEN CENTER STEEL DOORS AND FRAMES P81E
14. NOT USED.
15. NOT USED.
16. NOT USED.




8 AUTO CARE PYLON
3/16" = 1'-0"




SHERWIN-WILLIAMS CUSTOM
DURANODIC BRONZE/ ORDER
NUMBER 7248-0044642
-DURANODIC BRONZE MATCH
-CUSTOM MANUAL MATCH

| BAC COLORANT: | OZ | 32 | 64 | 128 |
|---|---|---|---|---|
| W1 WHITE | - | 43 | - | 1 |
| B1 BLACK | 6 | 4 | 1 | 1 |
| R2 MAROON | - | 19 | - | 1 |
| Y3 DEEP GOLD | - | 48 | 1 | 1 |
| G2 NEW GREEN | - | 18 | - | - |

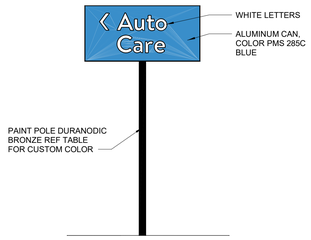ONE GALLON
#B54T00104
UI TRADECP #796999993

9 PYLON 1 SIGNAGE
3/16" = 1'-0"

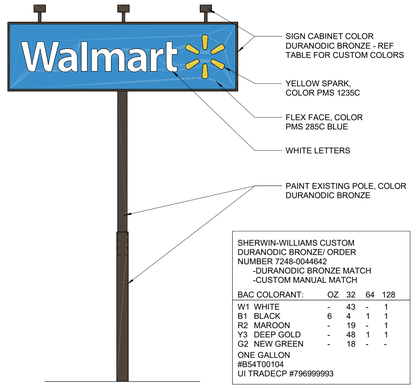


7 LEFT ELEVATION
3/64" = 1'-0"




6 AUTO CARE FRONT ELEVATION
3/64" = 1'-0"

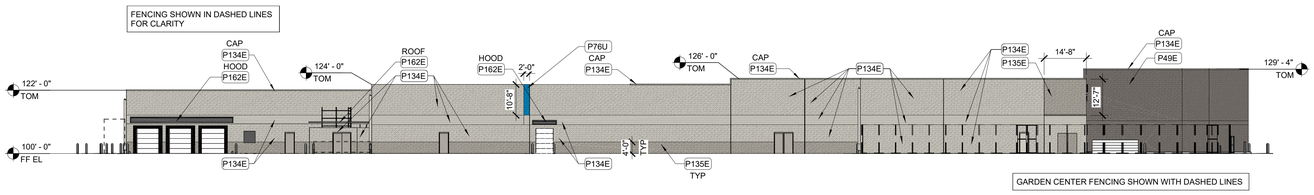


5 SEASONAL SHOP REAR ELEVATION
3/64" = 1'-0"

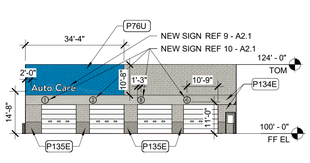


4 REAR ELEVATION
3/64" = 1'-0"

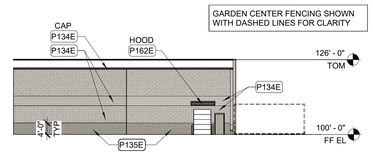


3 RIGHT ELEVATION
3/64" = 1'-0"

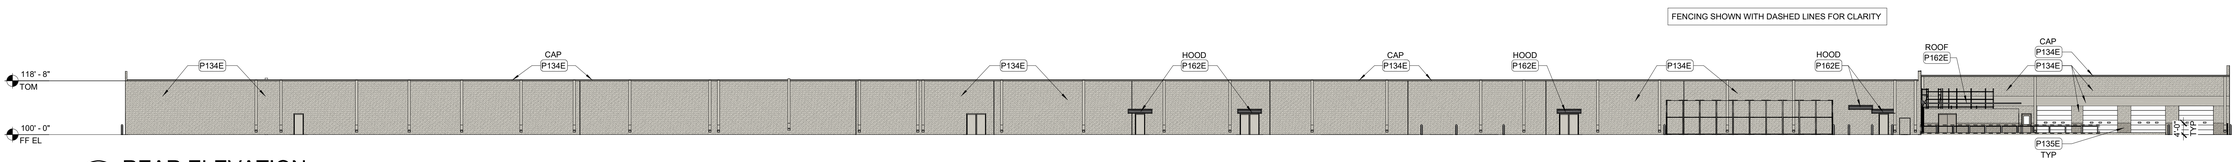


2 ENLARGED ELEVATION
3/32" = 1'-0"

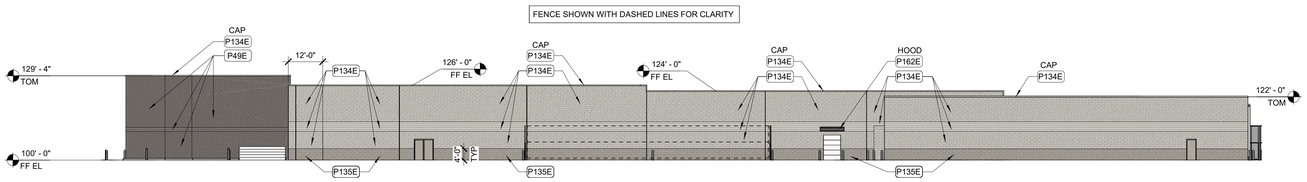


1 FRONT ELEVATION
3/64" = 1'-0"


2600 Maitland Center Parkway
Suite 200
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8084
AA#26001284
www.cpzarchitects.com

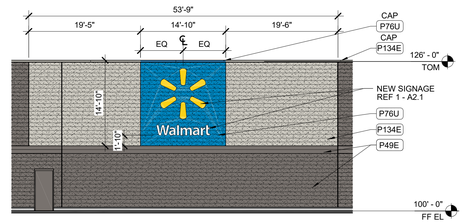Cooper & Peterson
Architects Engineers Planners

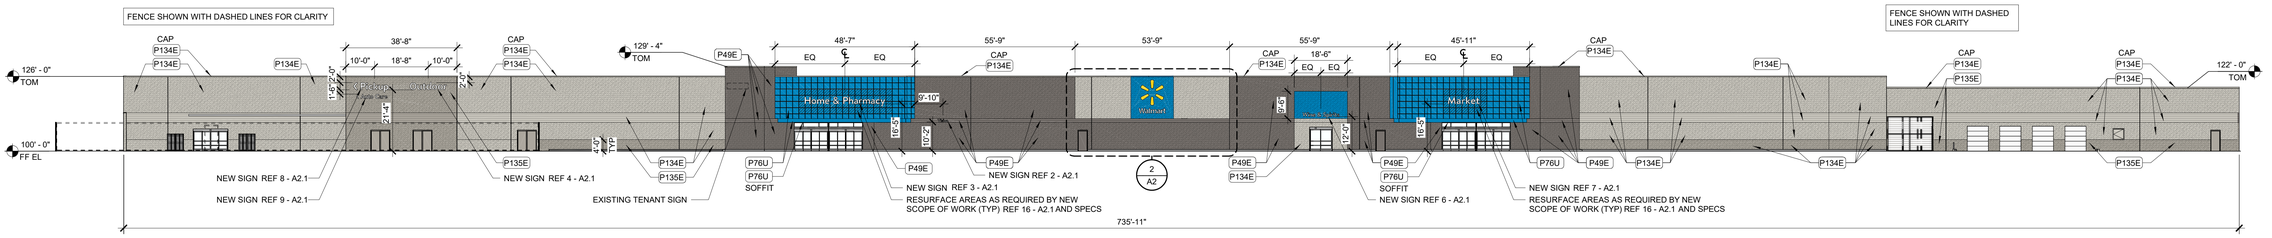

STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE DATE SUITABLE FOR REUSE ON ANOTHER A DIFFERENT PROJECT SITE OR AT A LATER TIME WITHOUT THE EXPRESS WRITTEN RESTRICTIONS OR ESCRIBE CONSENT AND OF THE ARCHITECT AND ENGINEER OF RECORD FOR THE PROJECT. REPRODUCTION OF THIS DRAWING IS LIMITED TO THE PURPOSES AND PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 210335 PROTO 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | GM/MR |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
AR100424
REGISTERED ARCHITECT
12/20/21

EXTERIOR ELEVATIONS

SHEET: A2

12/20/2021 4:08:27 PM
C:\Users\gmiller.kelgroup\Documents\BIM360\Project_Lake City, FL_168_SC_ARCH_V26_gmiller.kelgroup@cpzfirm.rvt

# SHEET FOR REFERENCE ONLY

SIGNAGE WILL BE SUBMITTED UNDER SEPARATE PERMIT

| EXISITNG SCHEDULE | | | | | | | |
|---|---|---|---|---|---|---|---|
| SIGN | QTY | TYPE | LIGHTED | COLOR | SIZE | INDIVIDUAL AREA | TOTAL AREA |
| FRONT ELEVATION | | | | | | | |
| WALMART * | 1 | EXISTING | LED | WHITE/YELLOW | 5'-6"/8'-0" | 299.04 SF | 299.04 SF |
| HOME & PHARMACY | 1 | EXISTING | NO | WHITE | 2'-6" | 94.90 SF | 94.90 SF |
| <AUTO CENTER | 1 | EXISTING | NO | WHITE | 2'-0" | 33.95 SF | 33.95 SF |
| LAWN & GARDEN | 1 | EXISTING | NO | WHITE | 2'-6" | 58.35 SF | 58.35 SF |
| SPARK BOTTLES | 1 | EXISTING | LED | YELLOW | 3'-6" | 19.67 SF | 19.67 SF |
| SPIRITS | 1 | EXISTING | LED | WHITE | 1'-6" | 11.34 SF | 11.34 SF |
| GROCERY | 1 | EXISTING | NO | WHITE | 2'-6" | 41.05 SF | 41.05 SF |
| * PICKUP | 1 | EXISTING | LED | YELLOW/WHITE | 2'-6" | 66.68 SF | 66.68 SF |
| FRONT ELEVATION | 8 | | | | | | 624.98 SF |
| AUTO CENTER | | | | | | | |
| AUTO CENTER | 1 | EXISTING | NO | WHITE | 2'-0" | 30.74 SF | 30.74 SF |
| TIRE | 2 | EXISTING | NO | WHITE | 1'-0" | 2.58 SF | 5.16 SF |
| LUBE | 2 | EXISTING | NO | WHITE | 1'-0" | 2.98 SF | 5.96 SF |
| AUTO CENTER | 5 | | | | | | 41.86 SF |
| TOTAL BUILDING SIGNAGE | 13 | | | | | | 666.84 SF |

| NEW SIGNAGE SCHEDULE | | | | | | | |
|---|---|---|---|---|---|---|---|
| SIGN | QTY | TYPE | LIGHTED | COLOR | SIZE | INDIVIDUAL AREA | TOTAL AREA |
| FRONT ELEVATION | | | | | | | |
| * WALMART | 1 | NEW | LED | YELLOW/WHITE | 8'-10"/1'-9" | 109.62 SF | 109.62 SF |
| HOME & PHARMACY | 1 | NEW | NO | WHITE | 2'-6" | 94.90 SF | 94.90 SF |
| VISION | 1 | NEW | NO | WHITE | 1'-0" | 3.63 SF | 3.63 SF |
| OUTDOOR | 1 | NEW | NO | WHITE | 2'-6" | 31.88 SF | 31.88 SF |
| < AUTO CARE | 1 | NEW | NO | WHITE | 1'-6" | 16.25 SF | 16.25 SF |
| WINE & SPIRITS | 1 | NEW | NO | WHITE | 1'-6" | 25.77 SF | 25.77 SF |
| MARKET | 1 | NEW | NO | WHITE | 2'-6" | 27.66 SF | 27.66 SF |
| PICK UP > | 1 | NEW | LED | WHITE | 2'-6" | 40.88 SF | 40.88 SF |
| FRONT ELEVATION | 8 | | | | | | 350.59 SF |
| AUTO CARE | | | | | | | |
| AUTO CARE | 1 | NEW | NO | WHITE | 2'-6" | 38.65 SF | 38.65 SF |
| NUMERIALS 1, 2, 3, 4 | 4 | NEW | NO | WHITE | 2'-6" | 4.12 SF | 16.48 SF |
| AUTO CARE | 5 | | | | | | 55.13 SF |
| TOTAL BUILDING SIGNAGE | 13 | | | | | | 405.72 SF |

## SIGNAGE GENERAL NOTES

1. SIGNAGE FURNISHED BY WAL-MART AND INSTALLED BY OTHERS.
2. ALL EXISTING WALMART EXTERIOR SIGNAGE IS TO REMAIN IN PLACE ON THE BUILDING UNTIL THE EXTERIOR SIGN COMPANY IS ONSITE. THE EXTERIOR SIGN COMPANY WILL REMOVE EXISTING SIGNAGE AND INSTALL NEW SIGNAGE. ONCE NEW SIGNAGE IS INSTALLED, GENERAL CONTRACTOR WILL PERFORM PATCH, REPAIR, AND PAINTING WORK NOTED IN PLANS AFTER NEW SIGNAGE IS INSTALLED
   A. FOR STORES THAT REQUIRE STRUCTURAL MODIFICATIONS OR REPAIRS FOR INSTALLATION OF NEW EXTERIOR SIGNAGE, A TEMPORARY BANNER WILL BE INSTALLED BY THE EXTERIOR SIGN COMPANY PRIOR TO REMOVAL OF EXISTING EXTERIOR SIGNAGE. BANNER WILL REMAIN IN PLACE UNTIL ALL MODIFICATIONS AND/OR REPAIRS HAVE BEEN COMPLETED AND NEW SIGNAGE IS INSTALLED. GC SHALL PRIORITIZE MODIFICATIONS/REPAIRS REQUIRED FOR INSTALLATION OF NEW EXTERIOR SIGNS WHILE EXTERIOR SIGN COMPANY IS ON SITE
   B. TEMPORARY BANNER WILL BE APPROXIMATELY 125 SF (5'X25').
   C. EXTERIOR SIGN WORK NEEDS TO BE SCHEDULED, COORDINATED, AND COMPLETED DURING WEEK 6 OF THE CONSTRUCTION SCHEDULE.
3. GENERAL CONTRACTOR RESPONSIBILITIES
   A. REMOVE EXISTING EXTERIOR BUILDING SIGNAGE AS NOTED ON SHEET A2. (LIGHTED ID/LOGO SIGNS WILL BE REMOVED BY OTHERS.)
   B. BY END OF FIRST WEEK OF CONSTRUCTION, REVIEW EXISTING CONSTRUCTION WHERE SIGN(S) WILL BE INSTALLED. IF EXISTING CONDITIONS DO NOT MATCH SIGN ATTACHMENT DETAILS SHOWN, REQUEST APPROVAL FROM CONSTRUCTION MANAGER TO SUBMIT RFI IN ACCORDANCE WITH SECTION 01255. NOTE DIFFERENCES IN CONSTRUCTION, INCLUDING DIMENSIONS, AND INCLUDE PHOTOGRAPHS FOR CLARIFICATION.
   C. PROVIDE SUBSTRATE SUITABLE FOR INSTALLATION OF SIGNAGE. REFER TO DETAILS ON SHEET A2.1. FOR LIGHTED ID/LOGO SIGNS COORDINATE TIMING OF WORK WITH WALMART SIGN CONTRACTOR.
   D. PROVIDE JUNCTION BOXES AND CIRCUITRY TO NEW "Walmart" and "spark" SIGNAGE. EXISTING (6) BOXES FROM "WAL+MART" SIGNAGE MAY BE REUSED.
   E. PROVIDE JUNCTION BOXES AND CIRCUITRY TO TENANT SIGNAGE LOCATION SHOWN. REFER TO ELECTRICAL.
   F. INSTALL ACCESS DOORS AND FRAMES IN GYPSUM BOARD CEILINGS IF REQUIRED BY RELOCATION OF EXISTING TENANT SIGNAGE.
   G. VERIFY VOLTAGE AT CIRCUITS FEEDING LIGHTED SIGNAGE. REFER TO ELECTRICAL
   H. MAKE FINAL TERMINATIONS ON LIGHTED SIGNAGE
4. SIGNAGE CONTRACTOR RESPONSIBILITIES
   A. REMOVE ALL LIT SIGNS UNLESS NOTED OTHERWISE.
   B. FURNISH SPECIFIED CONDUIT FOR LIGHTED SIGNAGE.
   C. MAKE REQUIRED EXTERIOR WALL PENETRATIONS, INSTALL CONDUIT, AND SEAL PENETRATIONS PER SPECIFICATION SECTION 07900.
   D. INSTALL SIGNAGE PER DETAILS ON SHEET A2.1




17 PICKUP BANNER AT EXISTING LIGHT POLE
1/4" = 1'-0"




16 SUBSTRATE AT NEW SIGNAGE
3/8" = 1'-0"

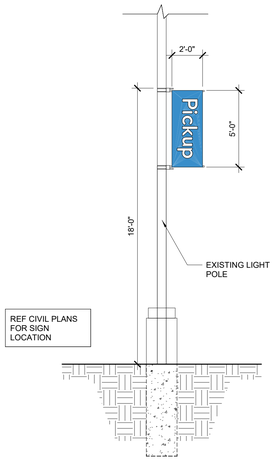


15 SIGNAGE ATTACHMENT ABOVE ROOF LINE
1 1/2" = 1'-0"

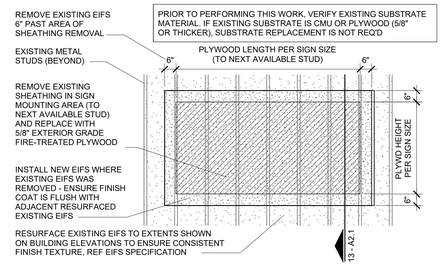


11 SIGN ATTACHMENT AT MAIN ID
1" = 1'-0"

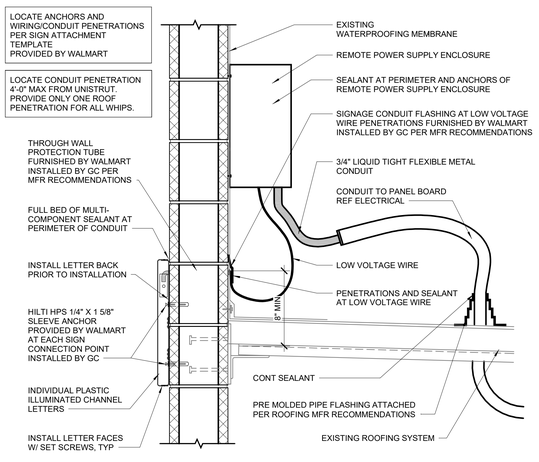


14 SIGN ATTACTHMENT BELOW ROOF LINE
1 1/2" = 1'-0"

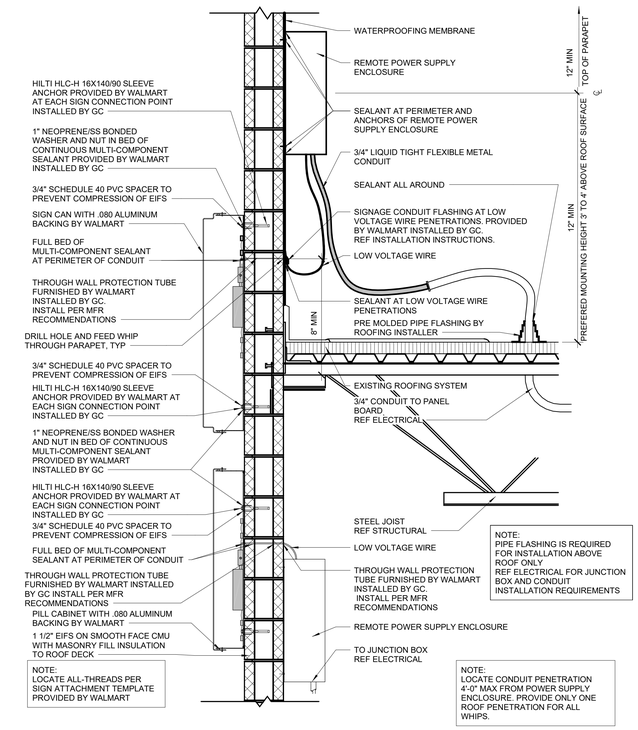


13 SIGN ATTACHMENT AT EIFS WALL
1 1/2" = 1'-0"

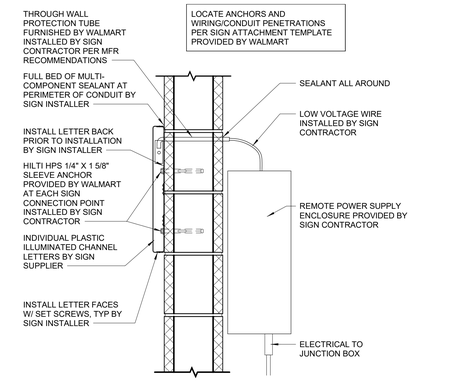


12 SIGN ATTACHMENT AT CMU WALL
1 1/2" = 1'-0"

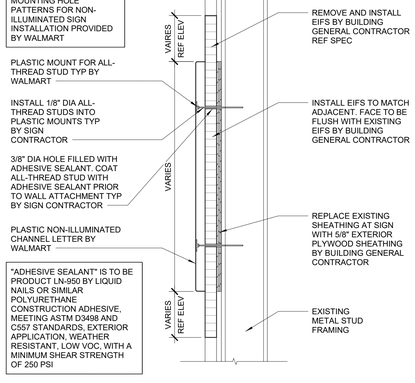


10 2'-6" AUTOMOTIVE
1/4" = 1'-0"

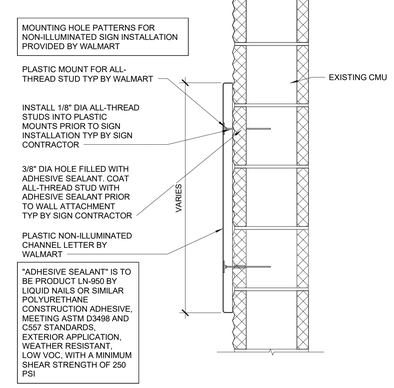


9 2'-6" AUTO CARE
1/4" = 1'-0"

NOTE TO SIGN INSTALLER:
ALL PRIMARY MOUNTING HOLES MUST BE UTILIZED. IF MOUNTING THROUGH PRIMARY HOLE IS OBSTRUCTED BY REBAR, METAL STUDS, CHANNELS, OR OTHER MISC METAL, SEAL PRIMARY HOLE IN SIGN CAN AND MOUNT THROUGH THE NEAREST ALTERNATE MOUNTING HOLE. PRIMARY HOLES ARE INDICATED WITH PREDRILLED HOLES.




NOTE:
ALL SIGN PENETRATIONS ABOVE ROOF LEVEL MUST BE A CLEAR MINIMUM OF 8" ABOVE DECK

8 2'-6" PICKUP ARROW
1/4" = 1'-0"




7 2'-6" MARKET
1/4" = 1'-0"

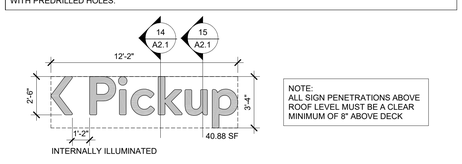


NOTE TO SIGN INSTALLER:
ALL PRIMARY MOUNTING HOLES MUST BE UTILIZED. IF MOUNTING THROUGH PRIMARY HOLE IS OBSTRUCTED BY REBAR, METAL STUDS, CHANNELS, OR OTHER MISC METAL, SEAL PRIMARY HOLE IN SIGN CAN AND MOUNT THROUGH THE NEAREST ALTERNATE MOUNTING HOLE. PRIMARY HOLES ARE INDICATED WITH PREDRILLED HOLES.

NOTE:
ALL SIGN PENETRATIONS ABOVE ROOF LEVEL MUST BE A CLEAR MINIMUM OF 8" ABOVE DECK

1 8'-10" WALMART SIGN
1/4" = 1'-0"

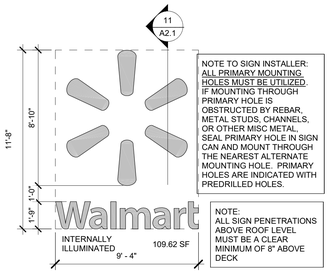


6 1'- 6" WINE SPIRITS SIGNAGE
1/4" = 1'-0"




5 1'-6" AUTO CARE
1/4" = 1'-0"

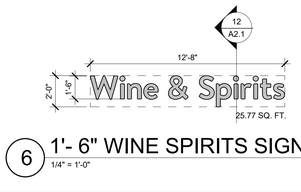


4 2'-6" OUTDOOR
1/4" = 1'-0"

3 2'-6" HOME & PHARMACY
1/4" = 1'-0"




2 1'-0" VISION
1/4" = 1'-0"


Cedarst & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5599
www.cedarstpeterson.com



STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON THE SPECIFIC PROJECT SHOWN AND CONTEMPORANEOUSLY WITH ITS ISSUE. CEDARST & PETERSON ASSUMES NO LIABILITY FOR ANY REUSE OF THESE DRAWINGS ON A DIFFERENT PROJECT SITE OR AT A LATER TIME WITHOUT THE EXPRESS WRITTEN CONSENT OF CEDARST & PETERSON. ANY SUCH REUSE WITHOUT SUCH CONSENT SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO CEDARST & PETERSON. REPRODUCTION OF THIS DRAWING IN WHOLE OR IN PART FOR ANY PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
JOB NUMBER: 2210335 | PROTO | 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | JB/NG/MR |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
REGISTERED ARCHITECT
AR100424
12/20/21

EXTERIOR DETAILS AND SIGNAGE

SHEET: A2.1


12/20/2021 4:08:42 PM
C:\Users\jbritton.hargrove\onedrive\Documents\WIP\0_Lake\City_FL_WB_LAR\QA_VIS_jbritton.hargrove.rvt




## 6 EXISTING BULKHEAD DETAIL
3/4" = 1'-0"




## 5 BULKHEAD AT CASE
1/2" = 1'-0"

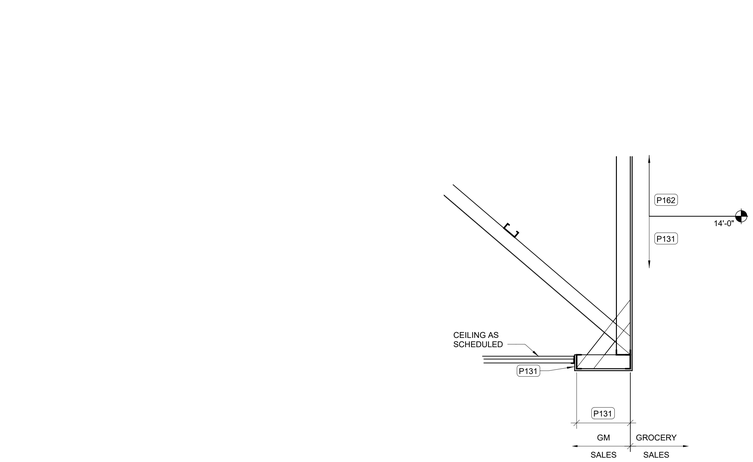


## 4 SECTION AT DELI BULKHEAD
1" = 1'-0"

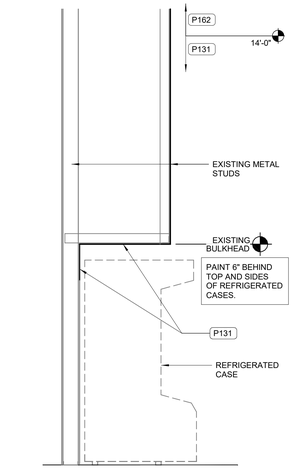


## 3 SALES WALL FINISHES @ PERIMETER HALF-GONDOLAS
1/4" = 1'-0"




## 2 EXISTING EXT CMU WALL SECTION
1/4" = 1'-0"

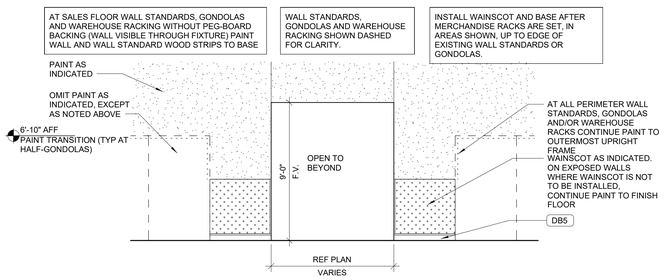


## 1 WALL STANDARD MOUNTING
12" = 1'-0"

Cedazo & Peterson
Architects Engineers Planners
3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8791
www.cedazo.com

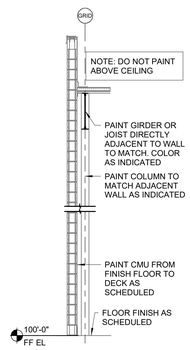STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AND PROJECT. IF USED ON A DIFFERENT PROJECT OR SITE OR AT A LATER TIME WITHOUT THE ARCHITECT'S WRITTEN PERMISSION, THE ARCHITECT SHALL BE RELIEVED OF ALL RESPONSIBILITY FOR THE PROJECT. ANY REUSE BY ANOTHER ENGINEER, REPRODUCTION OF THIS DRAWING OR PREPARATION OF ANY DERIVATIVE PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

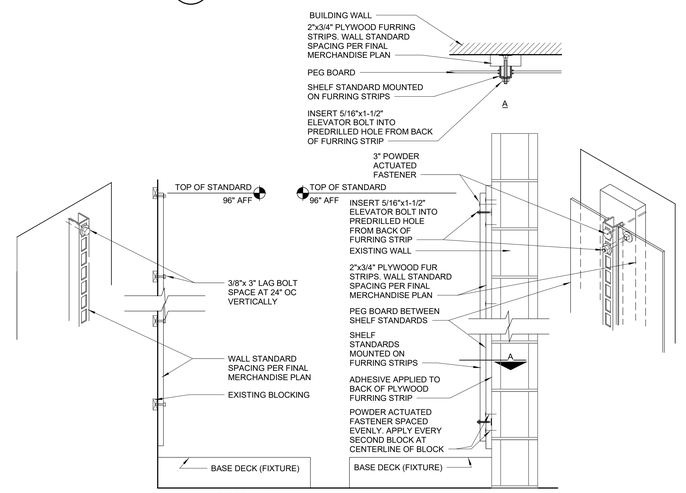CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 221035 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | YB |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |




12/20/21

SECTIONS AND DETAILS

SHEET: A3

12/20/2021 4:14:19 PM
C:\Users\ybrito.kelgroup\Documents\Revit\KEL_LakeCity_FL_168_L_ARCH_V26_ybrito.kelgroup.rvt

INSTALLATION NOTES:
1. THE ROOF PENETRATION CURB, HOOD AND CLOSURE PLATES ARE FURNISHED BY OWNER AND INSTALLED BY GENERAL CONTRACTOR
2. ALL HOOD PENETRATIONS SHALL BE THROUGH THE VERTICAL CLOSURE PLATES ONLY. PIPING AND CONDUIT SHALL BE INSTALLED BY THE TRADE CONTRACTORS WITH THE PIPE AND CONDUIT CENTERLINES 5" ABOVE THE TOP OF THE ROOF CURB WITH A MINIMUM OF 1" BETWEEN THE PIPE AND CONDUIT EXTERNAL SURFACE
3. THE GENERAL CONTRACTOR SHALL CUT AND INSTALL THE VERTICAL CLOSURE PLATES AFTER ALL PIPING AND CONDUITS ARE INSTALLED AND SEAL ALL PENETRATIONS AS NOTED IN THE DETAIL AND PROVIDE CONTINUOUS SEALANT AT THE PERIMETER JOINT BETWEEN THE CLOSURE PLATES AND HOOD AND CURB AND WHERE THE CLOSURE PLATES OVERLAP. REF SEALANT SPECIFICATION. EXPANDING FOAM SEALANT SHALL NOT BE USED WHERE SEALANT IS EXPOSED TO THE EXTERIOR.
4. EXTEND EXTERIOR REFRIGERANT AND WATER LINE EXTERNAL PVC INSULATION JACKET 1" INSIDE HOOD METAL CLOSURE PLATES.

| SHEET NOTES |
| --- |
| 1. INSTALL MOLDED PIPE FLASHING AT ALL NEW PIPE OR CONDUIT PENETRATIONS THROUGH ROOF. REF. MECHANICAL FOR LOCATIONS. REF. 4-A4 |

| ROOF LEGEND |
| --- |
| NEW RCU |
| NEW ROOF PENETRATION |




## 4 ROOF PENETRATION
1" = 1'-0"




## 5 REFRIGERATION LINE ROOF PENETRATION
NTS

NOTE: FOR ROOF PENETRATIONS LOCATED WHERE WALKWAY PADS ARE INSTALLED, TRIM WALKWAY PADS 4" FROM EDGE OF ROOF PENETRATION FLASHING BEFORE PAD INSTALLATION.

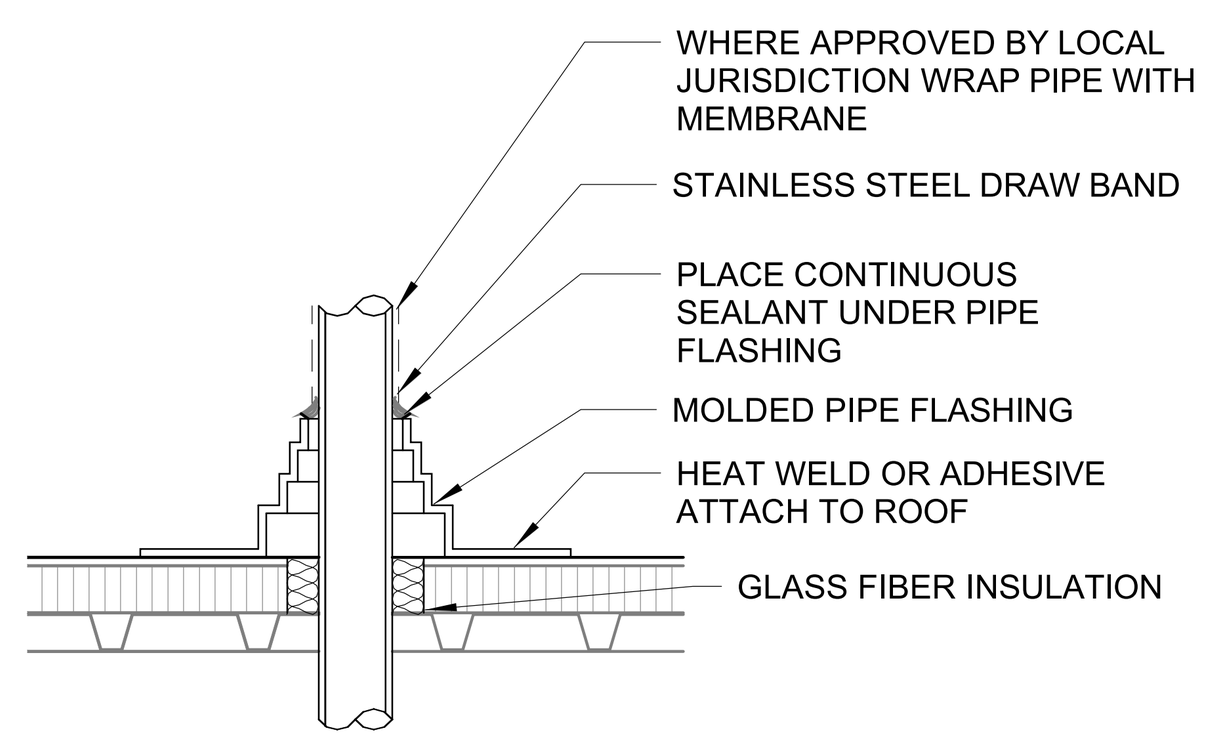NOTE: DO NOT INSTALL WALK WAY PADS UNTIL ROOF PENETRATION FLASHINGS ARE COMPLETE.

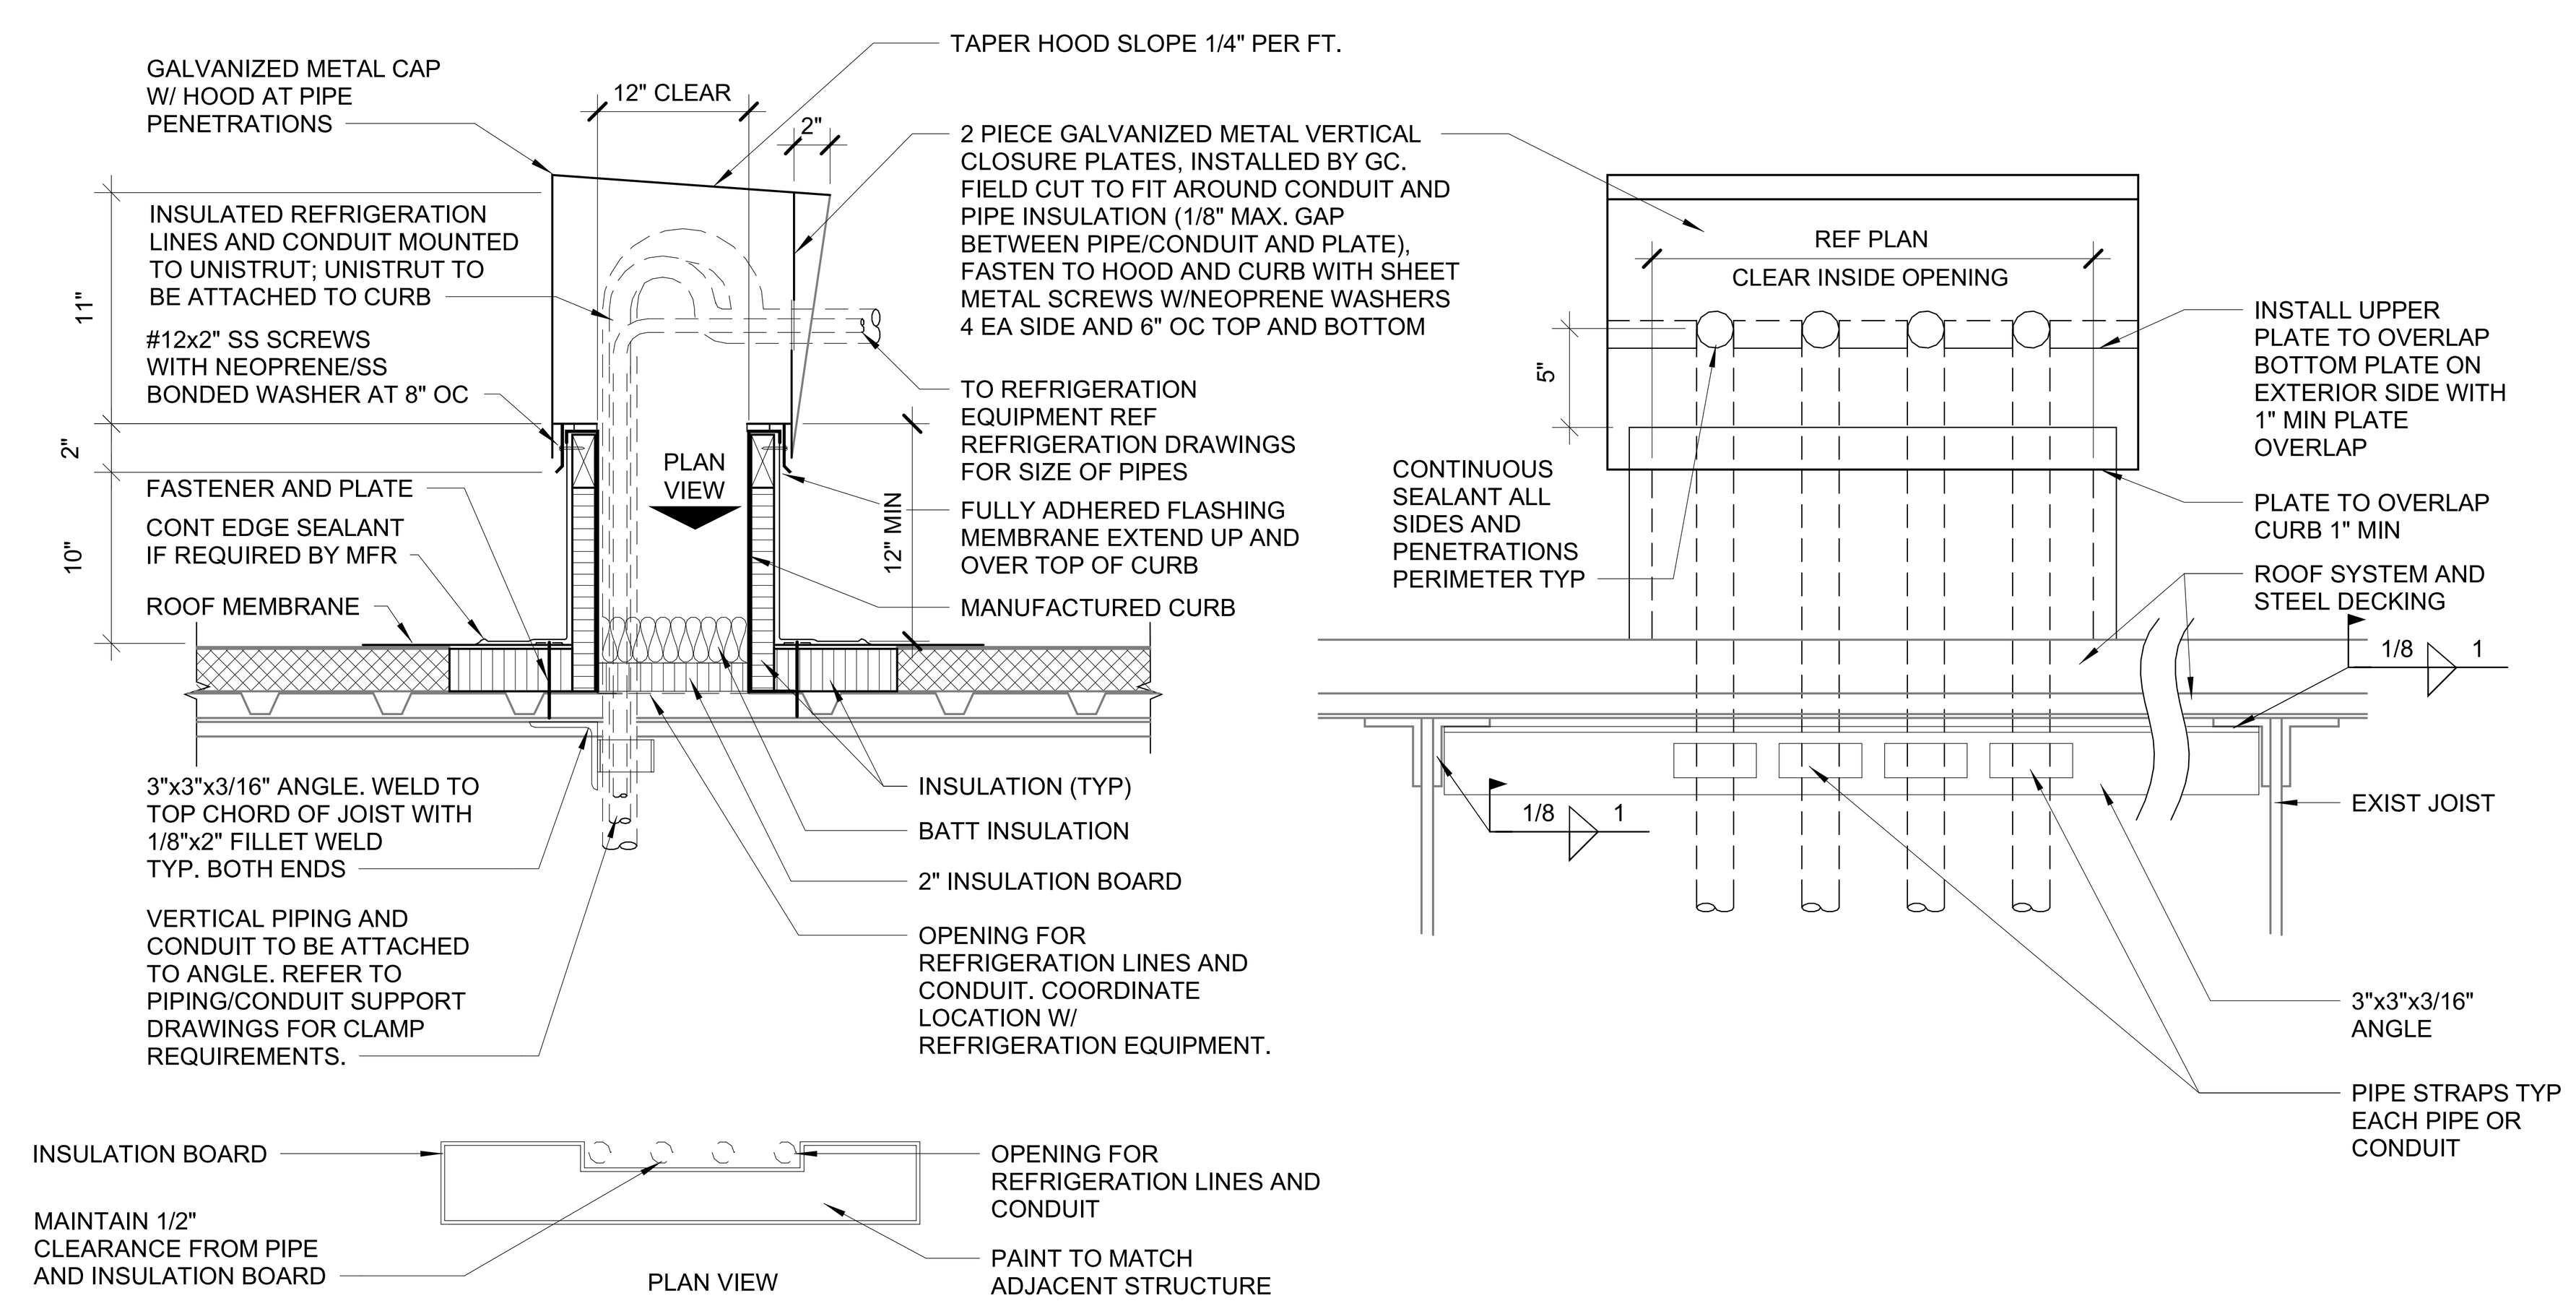


## 3 PAD LAYOUT (TYP ALL UNITS)
12" = 1'-0"

NOTE TO GC:
PROVIDED CURB IS NOT SLOPED. UNISTRUT ASSEMBLY MUST BE LEVELED IN DIRECTION OF ROOF SLOPE PRIOR TO INSTALLATION OF CONDENSING UNIT.




## 2 CONDENSER UNIT CURB
1 1/2" = 1'-0"

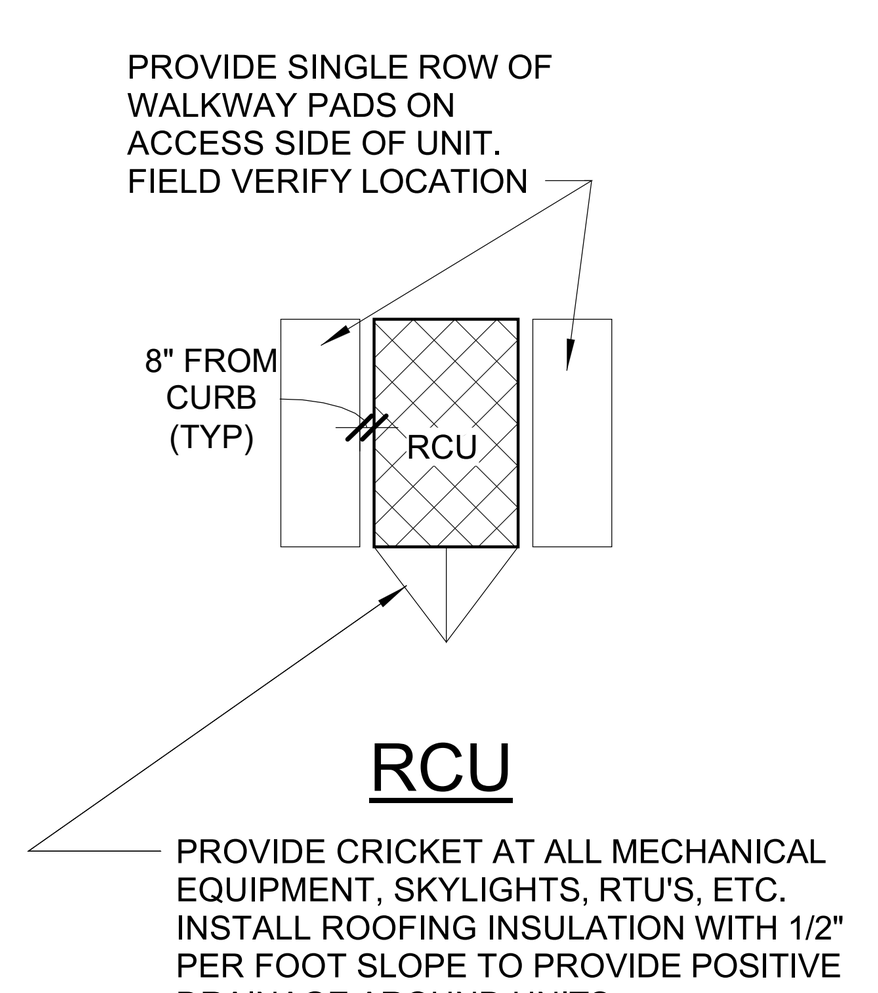


## 1 ROOF PLAN
1/32" = 1'-0"

12/20/2021 4:14:20 PM
C:\Users\jeritsa.negronquiros\Documents\00767_LakeCity_FL_188_L_ARCH_V20_jeritsa.negronquiros.rvt

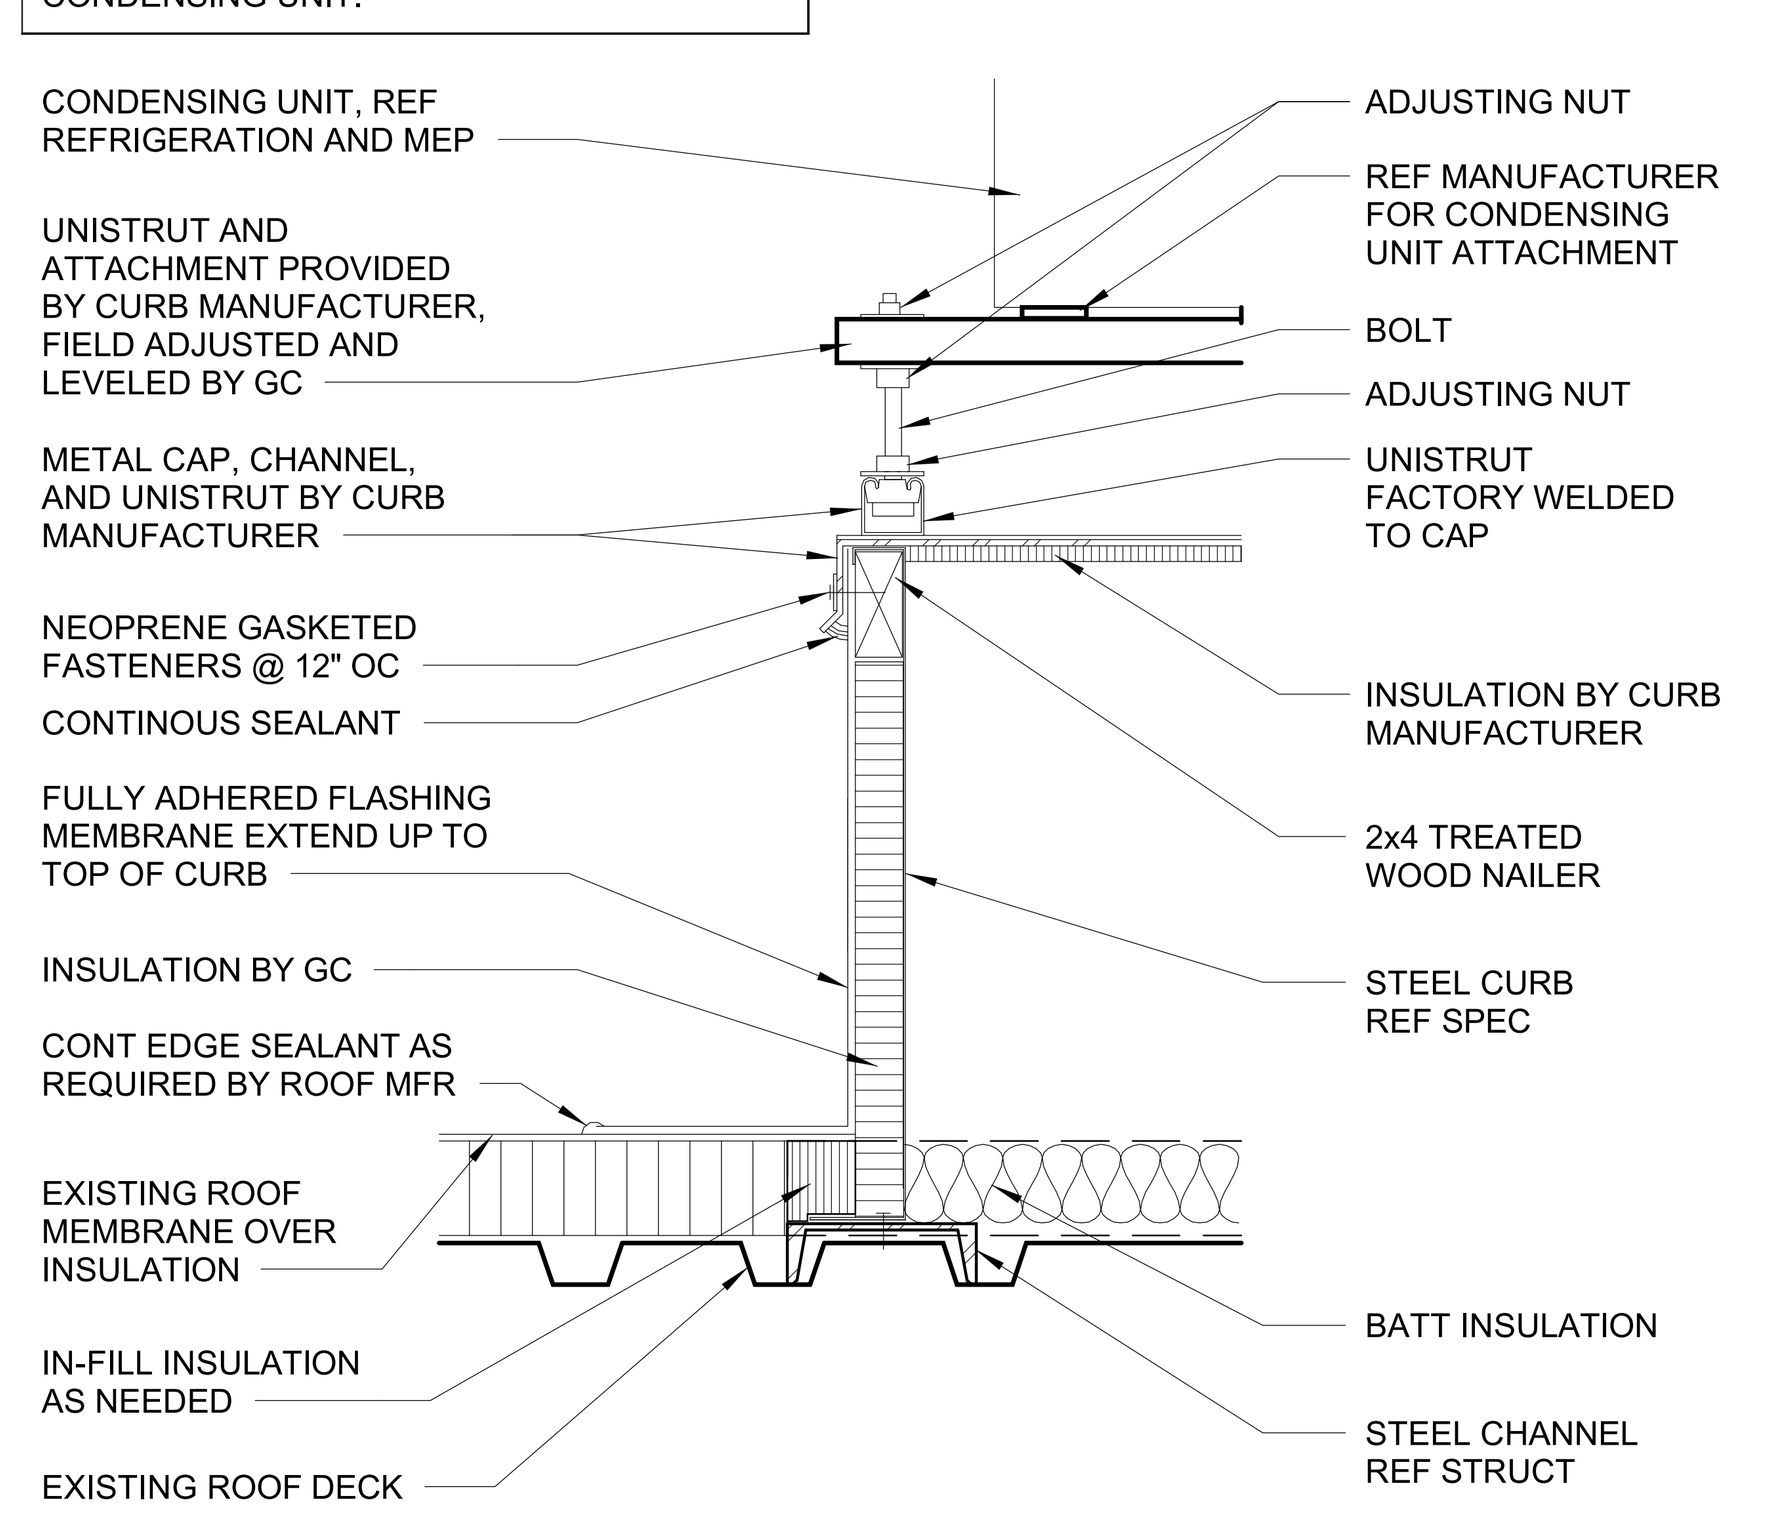
Cuhaci & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com
Florida Corporate Certificate #AA C000526

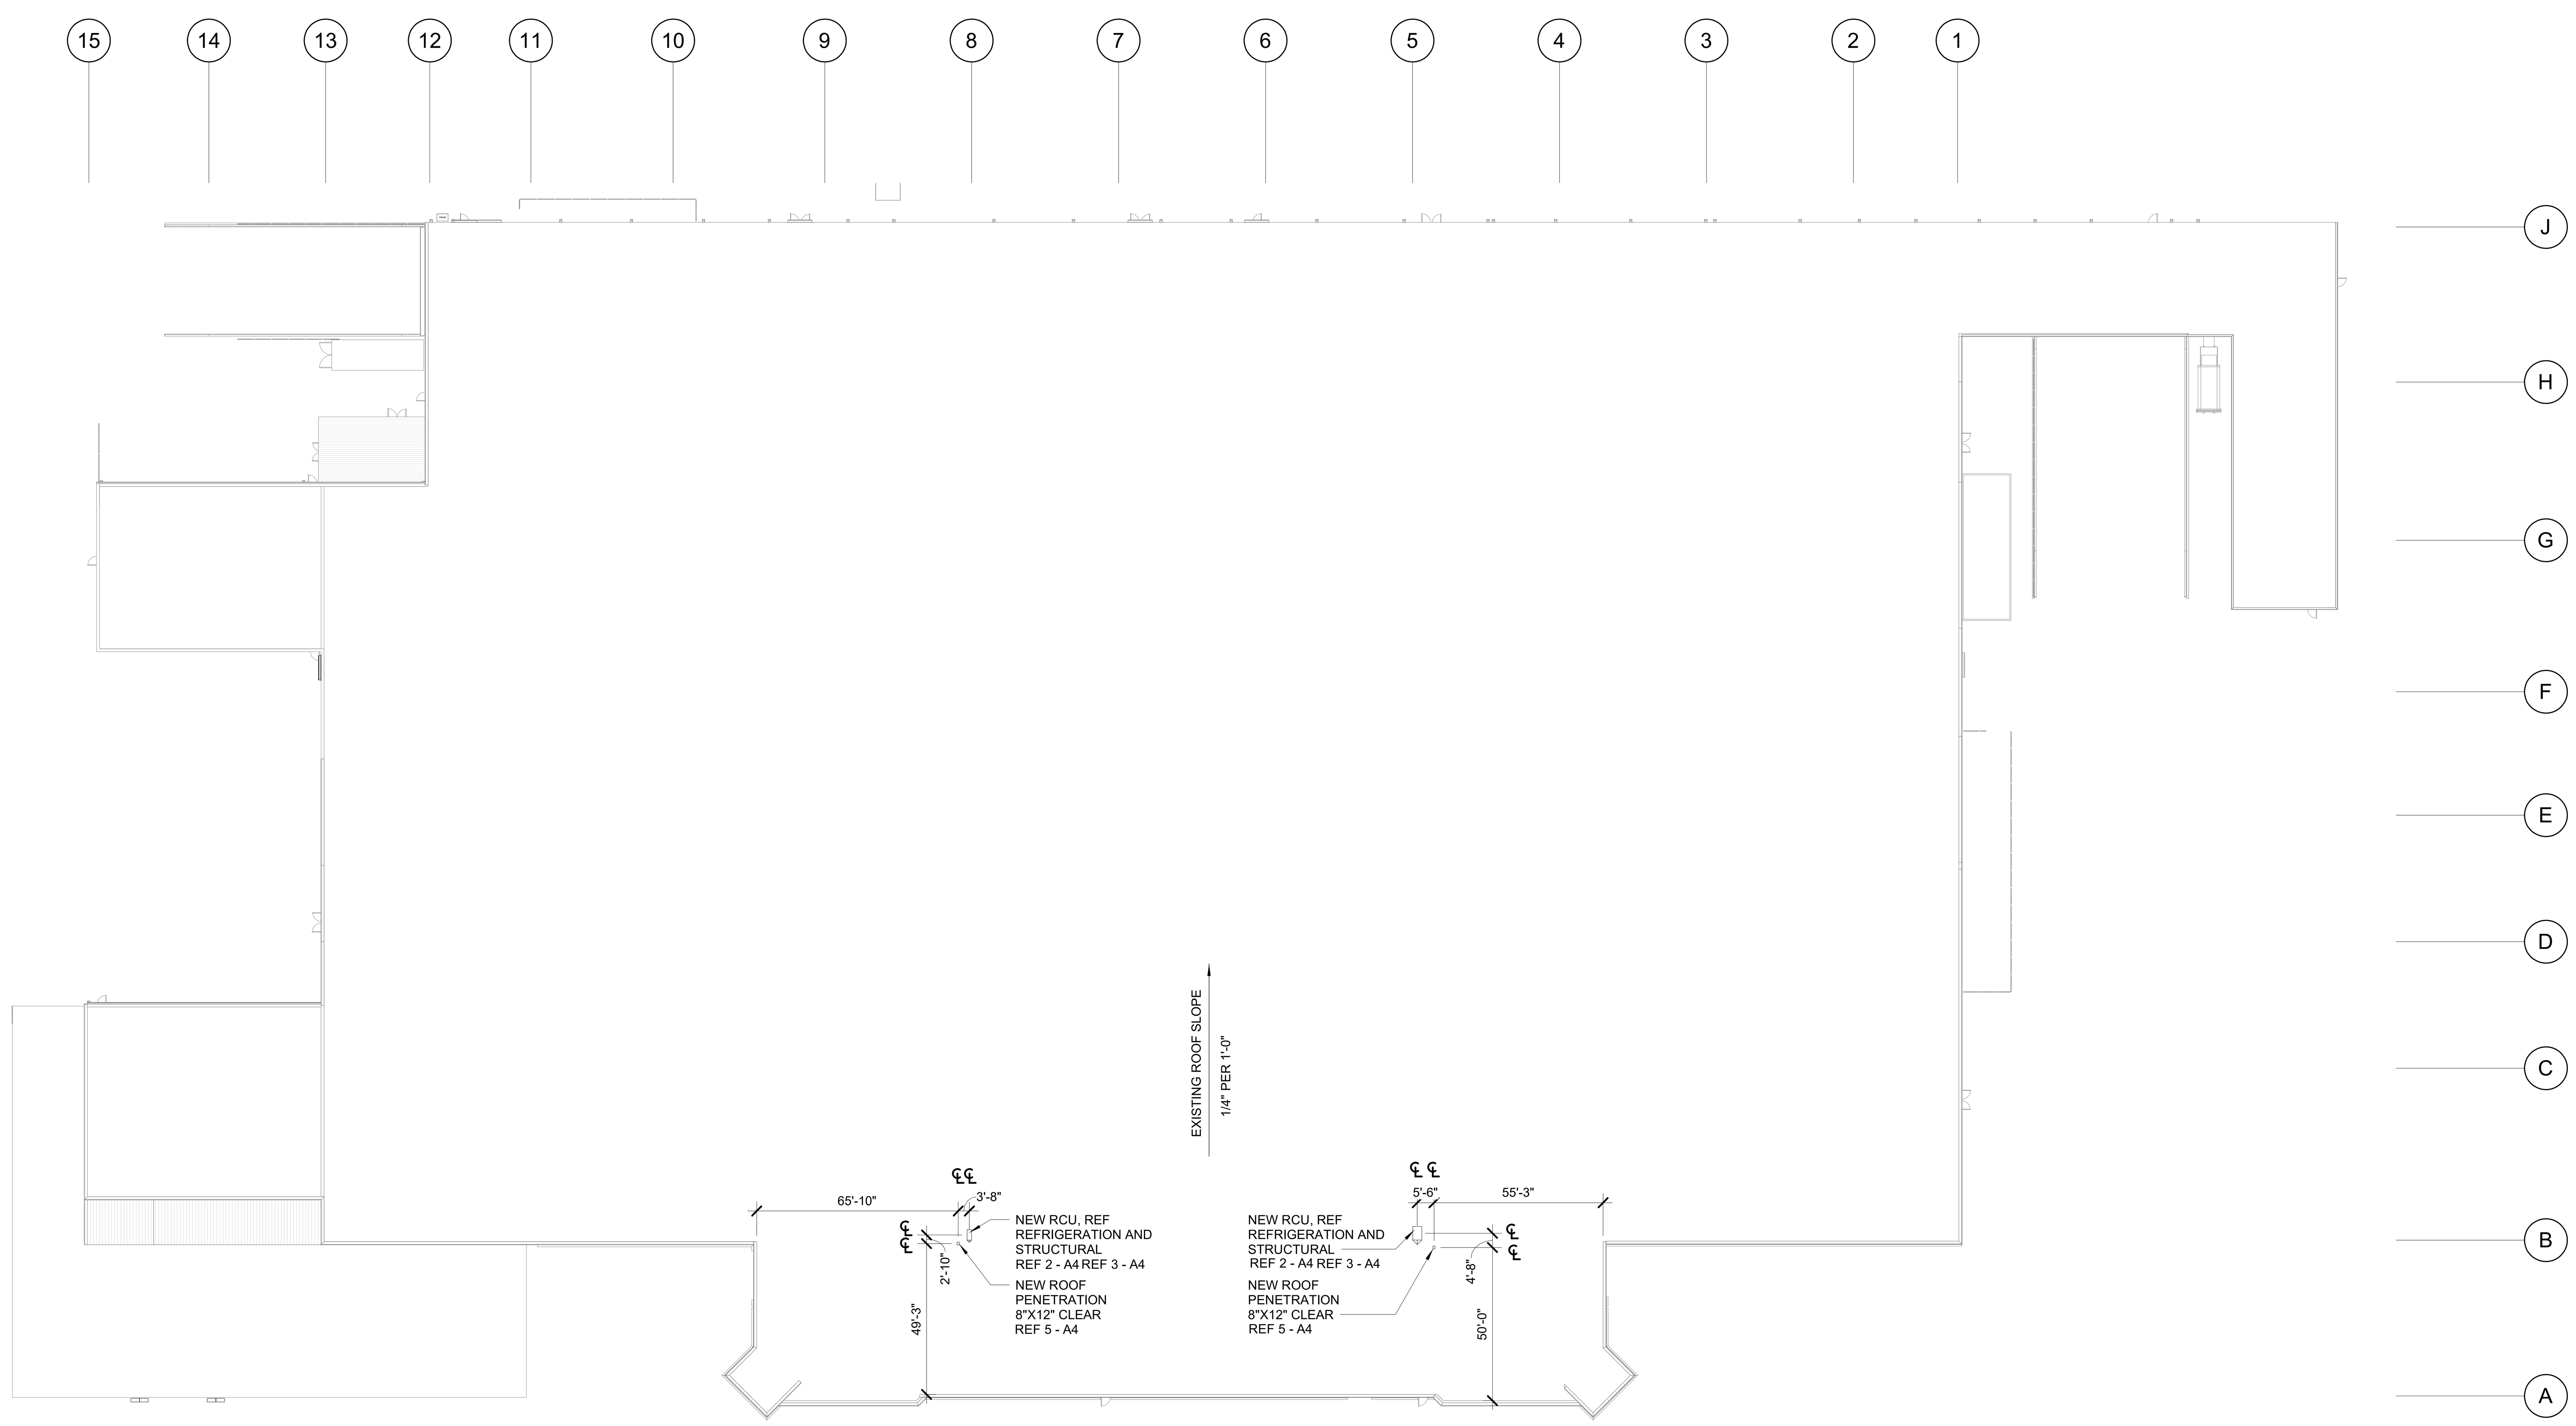

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

| JOB NUMBER: | 2210335 | PROTO: | 188 PROTO SC |
| --- | --- | --- | --- |

ISSUE BLOCK

| | |
| --- | --- |
| CHECKED BY: | ADM |
| DRAWN BY: | LS |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
Anthony D Murphy
AR100424
REGISTERED ARCHITECT
12/20/21

ROOF PLAN AND DETAILS

SHEET:
A4

**950 LIQUOR SALES**

**WALLS**
- REF 2-A5

**FLOOR**
- REF FLOOR FINISH PLAN

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE

**121 AP RETENTION**

**WALLS**
- ETR.

**FLOOR**
- REF FLOOR FINISH PLAN.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**402 AUNTIE ANNE, 810 SMART STYLE, 802 REGAL NAILS**

**WALLS**
- ETR.

**FLOOR**
- REF FLOOR FINISH PLAN

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE

**105 CUSTOMER SERVICE, 106 RETURNS STORAGE**

**WALLS**
- REF 4-A5 FOR FINISH DETAILS.

**FLOOR**
- REF FLOOR FINISH PLAN.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**MILLWORK**
- EXISTING LAMINATE COUNTERTOP (FRONT AND BACK COUNTER); REPLACE COUNTERTOP WITH NEW SS COUNTERTOP.

**110 CORRIDOR-**
**WALLS**
- ETR.

**FLOOR**
- ETR.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**107 CASH, 108 COUNTING**

**WALLS**
- ETR.

**FLOOR**
- ETR.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**101 GM VESTIBULE, 103 GM OTHER INCOME, 104 GM CART STORAGE, 115 GR VESTIBULE, 117 GR OTHER INCOME, 118 GR CART STORAGE**

**WALLS**
- GYP BD: PAINT P131 TO 10'-0" AFF AND P209 FROM 10'-0" AFF TO CEILING OR EXPOSED STRUCTURE UNO. INSTALL PS7 WAINSCOT AND DB5 BASE UNO.
- CMU: PAINT P209 WAINSCOT TO 4'-0", P131 FROM 4'-0" TO 10'-0" AFF, AND P209 FROM 10'-0" AFF TO CEILING OR EXPOSED STRUCTURE UNO.
- PAINT COLUMNS TO MATCH ADJACENT WALLS.
- CLEAN TRANSLUCENT PANELS
- CART STORAGE ONLY: ADD 3/4" PLYWOOD TO 4'-0" AFF WITH TOP EDGE EASED TO ALL GYP BD WALLS.
- CART STORAGE WALLS: P209 WAINSCOT TO 4'-0" AFF AND P131 ABOVE.

**FLOOR**
- REF FLOOR FINISH PLAN

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE

REMOVE INTERIOR TENANT SIGNAGE AS INDICATED BELOW:

ALL TENANT SPACES (EXCLUDING FULL SERVICE FOOD TENANTS)
- TENANT SIGNS TO REMAIN ETR GC TO PAINT AROUND EXISTING TENANT SIGNS UNO.
- REMOVE ALL WALLPAPER AND/OR ORNAMENTS ON THE BULKHEAD AND WALL BELOW UNO.
- PATCH, REPAIR AND PAINT BULKHEAD WALL AT REMOVED WALLPAPER AND/OR ORNAMENTATION TO MATCH ADJACENT CONSTRUCTION AND FINISHES.

ALL FOOD SERVICE TENANTS-
- EXISTING LIT SIGNS ON LOWER BULKHEADS AND AWNINGS TO REMAIN, DO NOT REMOVE, PAINT AROUND THE SIGN. TREAT TENANTS(I.E. PRETZEL COMPANIES) THAT ARE OCCUPYING FULL SERVICE FOOD TENANT SPACES MAY CONTINUE TO USE LIT SIGNAGE.

THIRD-PARTY TENANT SIGNS AND ORNAMENTS ARE TO BE RETURNED TO THE TENANT IF A THIRD-PARTY TENANT REQUESTS THEIR SIGN, WALLPAPER OR ORNAMENTATION NOT BE REMOVED, CONTACT THE WALMART CONSTRUCTION MANAGER

## SHEET NOTES

1. REF A8 FOR SCHEDULE FINISH KEY AND GENERAL FINISH NOTES.
2. PAINT STRUCTURE AS INDICATED ON 4-A1 AND PAINT GYP BOARD WALLS TO 6" BEHIND TOP AND SIDES OF REFRIGERATED CASES.
3. NOT USED.

## KEYNOTES

| | |
|---|---|
| **6.27** | 48" HIGH WAINSCOT WITH OUTSIDE CORNER TRIM |




## 8 INTERIOR ELEVATION
3/32" = 1'-0"




## 4 COURTESY DESK FLOOR PLAN
3/16" = 1'-0"

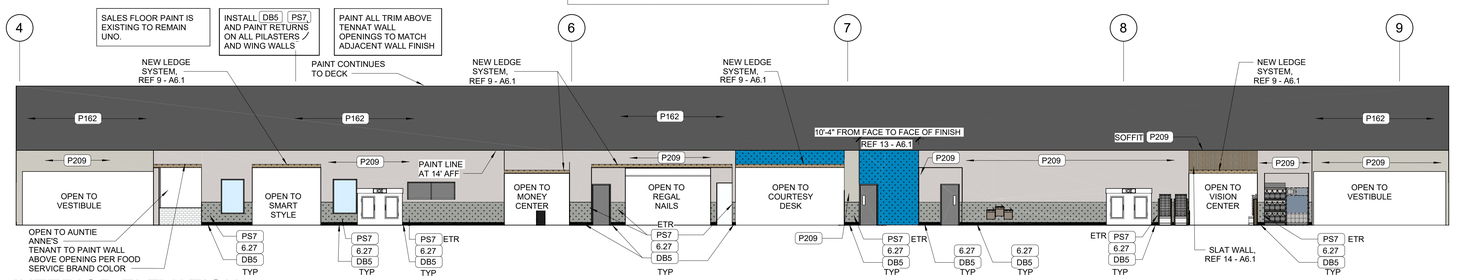


## 5 TV BRACKET BLOCKING PLAN
1 1/2" = 1'-0"

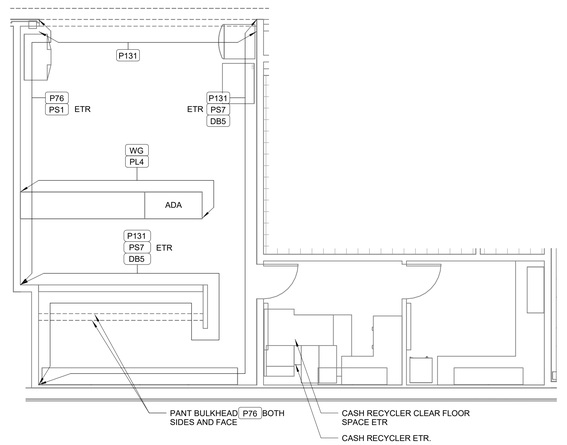


## 6 FOOD SERVICE TENANT ELEVATION
3/32" = 1'-0"

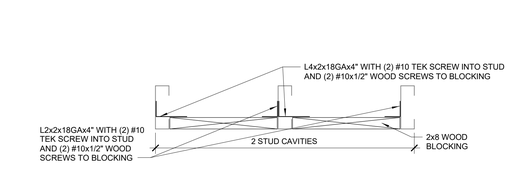


## 7 MONEY CENTER ELEVATION
3/8" = 1'-0"

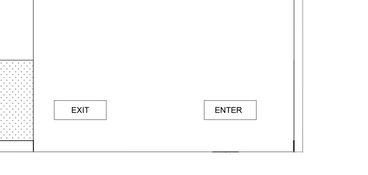


## 3 TV BRACKET BLOCKING
1/2" = 1'-0"




## 2 LIQUOR BOX FINISH PLAN
1/8" = 1'-0"

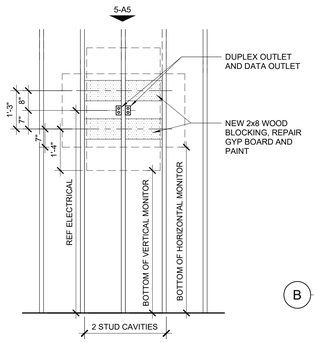


## 1 FRONT TENANT WALL FLOOR PLAN
1" = 10'-0"


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
Main@CulpepperWade.com
AA#0026116

Culpepper & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE

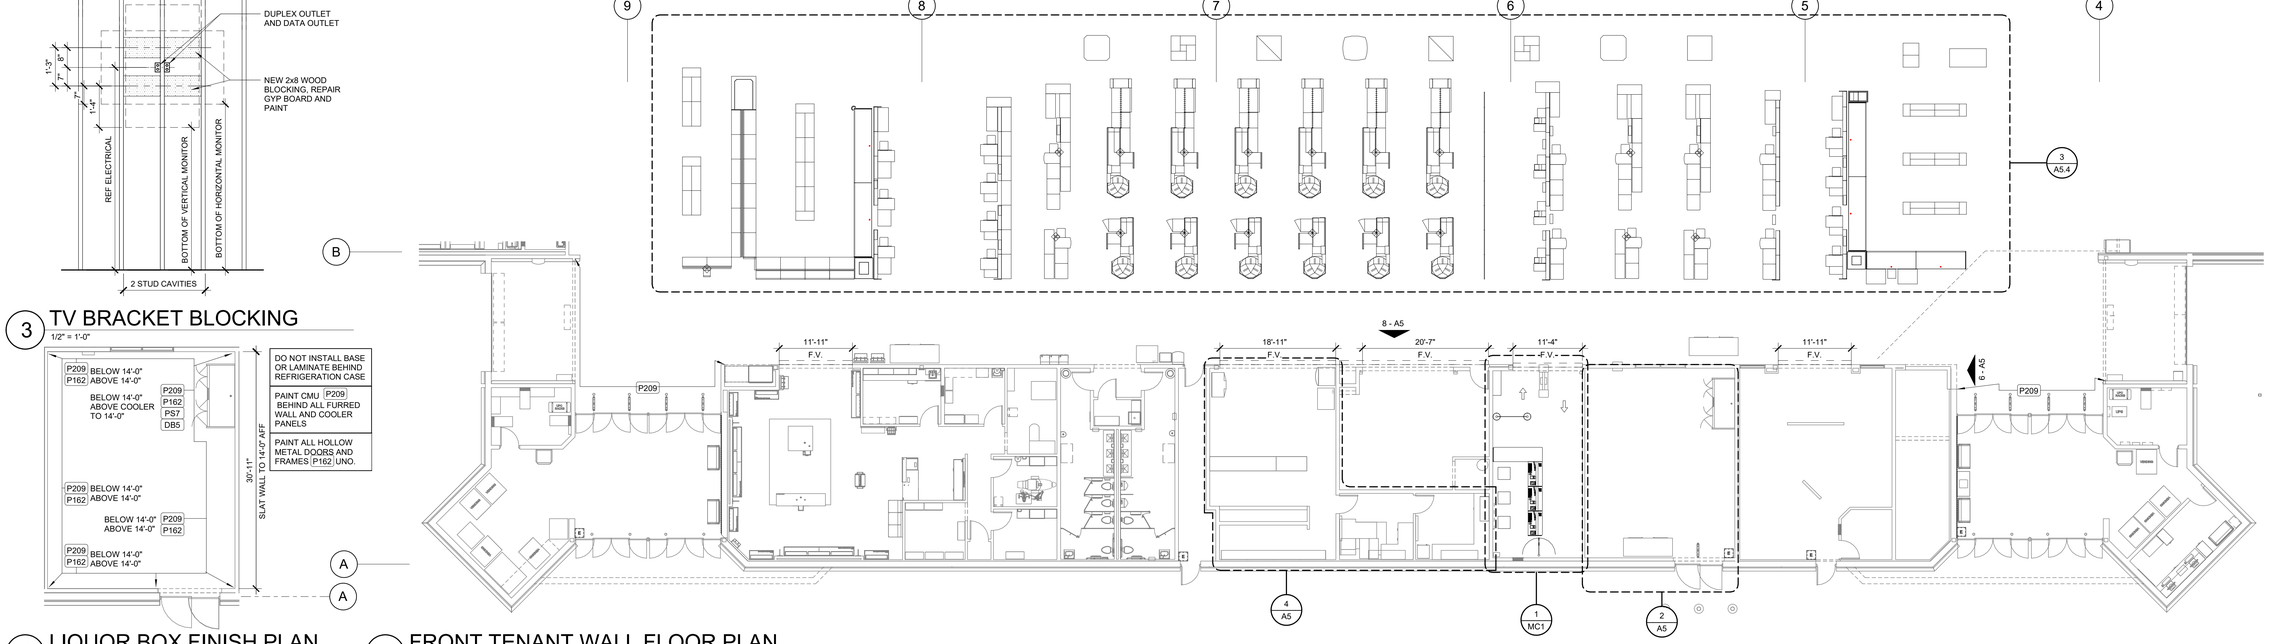
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC PROJECT AT A SPECIFIC TIME AND IS NOT INTENDED FOR USE ON ANY CONTEMPORARY PROJECT WITH ITS ISSUE DATE DIFFERENT THAN THE DATE SHOWN AS A DIFFERENT PROJECT SITE, OR AT A LATER TIME. THE USE OF THIS DRAWING IS RESTRICTED TO ONE EXISTING OR ANOTHER PERSON OR ENTITY WITHOUT THE WRITTEN PERMISSION OF CULPEPPER & PETERSON, P.A. ENGINEER'S SEAL AND SIGNATURE ON THIS DRAWING IS VALID ONLY FOR THIS PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 210335 PROTO 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | ASM/YB |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
TONY D MUJ
ANTHONY D MURPHY
AR100824
REGISTERED ARCHITECT
12/20/21

ENLARGED PLANS, ELEVATIONS, AND DETAILS

SHEET: A5


12/20/2021 4:08:33 PM
C:\Users\jbehan.ngp\Documents\Documents\WIP\21_LakeCity_FL_168_L-ARCH_YOB_jbehan.ngp.rvt

| GRID WALL LEGEND | | | | | | |
|---|---|---|---|---|---|---|
| FIXTURE #: | BLOCK: | BLOCK NAME: | 1ST SAP ARTICLE #: | SAP ARTICLE DESCRIPTION: | 2ND SAP ARTICLE #: | SAP ARTICLE DESCRIPTION: |
| 1-L | 1-L | SCO_1BAG_GRIDSHELF_L_RSR | 100625318 | D82 SCOWIRE MERCH SGL BAG | | |
| 2-L | 2-L | SCO_1BAG_GRIDSHELF_L_2LEG_RSR | 100625318 | D82 SCOWIRE MERCH SGL BAG | 100627736 | LEG KIT |
| 1-R | 1-R | SCO_1BAG_GRIDSHELF_R_RSR | 100625318 | D82 SCOWIRE MERCH SGL BAG | | |
| 2-R | 2-R | SCO_1BAG_GRIDSHELF_R_2LEG_RSR | 100625318 | D82 SCOWIRE MERCH SGL BAG | 100627736 | LEG KIT |
| 3-L | 3-L | SCO_2BAG_GRIDSHELF_L_RSR | 100625360 | D82 SCOWIRE MERCH DBL BAG | | |
| 4-L | 4-L | SCO_2BAG_GRIDSHELF_L_2LEG_RSR | 100625360 | D82 SCOWIRE MERCH DBL BAG | 100627736 | LEG KIT |
| 3-R | 3-R | SCO_2BAG_GRIDSHELF_R_RSR | 100625360 | D82 SCOWIRE MERCH DBL BAG | | |
| 4-R | 4-R | SCO_2BAG_GRIDSHELF_R_2LEG_RSR | 100625360 | D82 SCOWIRE MERCH DBL BAG | 100627736 | LEG KIT |
| 5 | 5 | SCO_GRID_30 | 100627735 | 30IN SPACER | | |
| 5-L | 5-L | SCO_GRID_30L_LEG | 100627735 | | 100627736 | LEG KIT |
| 5-R | 5-R | SCO_GRID_30R_LEG | 100627735 | | 100627736 | LEG KIT |
| 6 | 6 | SCO_GRID_51 | 100631063 | 51IN SPACER | | |
| 6-L | 6-L | SCO_GRID_51L_LEG | 100631063 | | 100627736 | LEG KIT |
| 6-R | 6-R | SCO_GRID_51R_LEG | 100631063 | | 100627736 | LEG KIT |
| 7-L | 7-L | SCO_GRIDSHELF_30L_RSR | 100627783 | 30IN BRIDGE SHELF KIT | | |
| 7-R | 7-R | SCO_GRIDSHELF_30R_RSR | 100627783 | 30IN BRIDGE SHELF KIT | | |
| 8 | 8 | SCO_GRIDSHELF_30_2_LEG_RSR | | | | |

| GRID WALL LEGEND | | | | | | |
|---|---|---|---|---|---|---|
| FIXTURE #: | BLOCK: | BLOCK NAME: | 1ST SAP ARTICLE #: | SAP ARTICLE DESCRIPTION: | 2ND SAP ARTICLE #: | SAP ARTICLE DESCRIPTION: |
| 8-L | 8-L | SCO_GRIDSHELF_30L_LEG_RSR | 100627715 | 30IN ANCHORED SHELF KIT | | |
| 8-R | 8-R | SCO_GRIDSHELF_30R_LEG_RSR | 100627715 | 30IN ANCHORED SHELF KIT | | |
| 9-L | 9-L | SCO_GRIDSHELF_48L_RSR | 100627639 | 48IN SHELF BRIDGE KIT | | |
| 10-L | 10-L | SCO_GRIDSHELF_48L_LEG_RSR | 100627782 | 48IN ANCHORED SHELF KIT | | |
| 9-R | 9-R | SCO_GRIDSHELF_48R_RSR | 100627639 | 48IN SHELF BRIDGE KIT | | |
| 10-R | 10-R | SCO_GRIDSHELF_48R_LEG_RSR | 100627782 | 48IN ANCHORED SHELF KIT | | |
| 11 | 11 | SCO_GRID_36 | 100634549 | 36IN SPACER | | |
| 12-L | 12-L | SCO_GRIDSHELF_51L_30x8_RSR | 100647056 | | | |
| 12-R | 12-R | SCO_GRIDSHELF_51R_30x8_RSR | 100647056 | | | |
| 13-L | 13-L | SCO_GRIDSHELF_51L_LEG_30x8_RSR | 100647056 | | | |
| 13-R | 13-R | SCO_GRIDSHELF_51R_LEG_30x8_RSR | 100647056 | | | |
| 15-L | 15-L | SCO_GRIDSHELF_30L_20x10_RSR | 100647055 | | | |
| 15-R | 15-R | SCO_GRIDSHELF_30R_20x10_RSR | 100647055 | | | |
| 16-L | 16-L | SCO_GRIDSHELF_30L_LEG_20x10_RSR | 100647055 | | | |
| 16-R | 16-R | SCO_GRIDSHELF_30R_LEG_20x10_RSR | 100647055 | | | |
| Corner Kit (Angle Iron for Bullpen Corners) | | | 100627800 | Corner Kit | | |




## 5 ENLARGED REFRIGERATION PLAN
1/8" = 1'-0"

## SHEET NOTES

1. ALL ELECTRICAL WORK INCLUDING DATA AND POWER DISCONNECTION BY GC.
2. REMOVAL AND REINSTALLATION OF POWER POLES BY GC. INSTALLATION OF NEW POWER POLES BY GC.
3. ALL REGISTERS TO BE REMOVED AND REINSTALLED OR INSTALLED NEW BY WALMART.
4. GENERAL CONTRACTOR RESPONSIBLE FOR ALL ELECTRICAL WORK.
5. GENERAL CONTRACTOR RESPONSIBLE FOR ANCHORS AND ALL GONDOLA ANCHORAGE.
6. GENERAL CONTRACTOR TO REPAIR FLOOR AS REQUIRED AT LOCATIONS OF REMOVED REGISTERS AND FIXTURES.
7. GENERAL CONTRACTOR TO REFER TO FIXTURE ANCHORAGE PLAN FOR ANCHORAGE REQUIREMENTS.
8. GENERAL CONTRACTOR TO ACCESS GENERAL CONTRACTOR PERMIT INFORMATION FOLDER ON WORKSPACE FOR GRID WALL INSTALLATION INSTRUCTIONS.
9. GENERAL CONTRACTOR TO INSTALL RAILING PER MANUFACTURERS RECOMMENDATIONS AND INSTRUCTIONS FOR INSTALLATION AND ANCHORING

## KEYNOTES
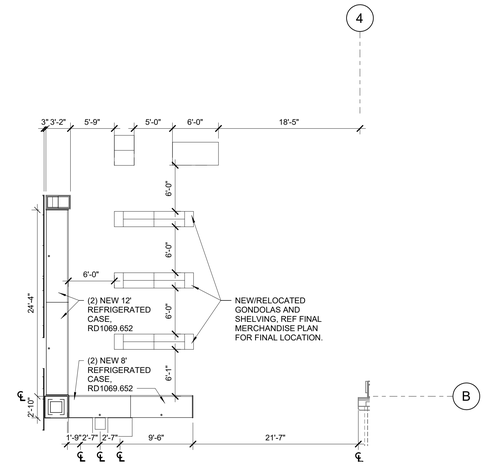
| | |
|---|---|
| **6.27** | 48" HIGH WAINSCOT WITH OUTSIDE CORNER TRIM |




## 4 REFRIGERATION CHASE
3/8" = 1'-0"




## 2 ENLARGED REFRIGERATION PLAN - GM SIDE
1/8" = 1'-0"

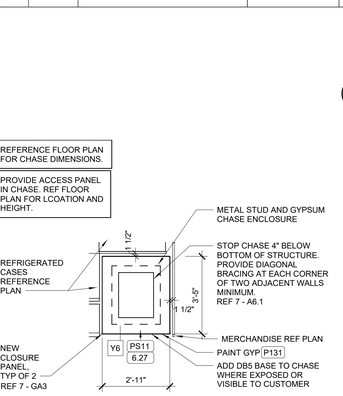


## 3 ENLARGED CHECKOUT PLAN
1/8" = 1'-0"

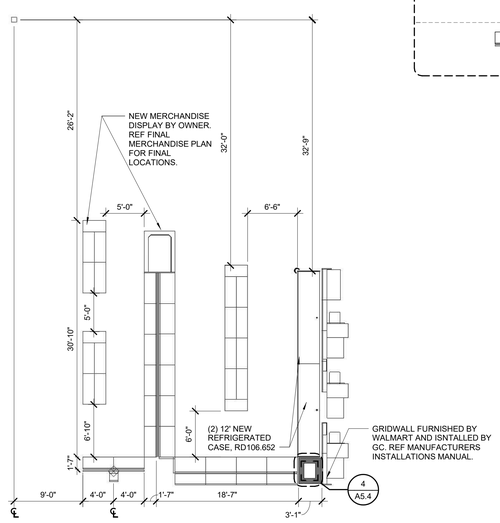


## 1 ENLARGED CHECKOUT DEMO PLAN
1/8" = 1'-0"


3600 Maguire Blvd., Suite 200
Orlando, FL 32803
P (407) 645-1500
F (407) 645-1591
AAC 0001791
Cedaroak.com
Cedar & Peterson
Architects Engineers Planners

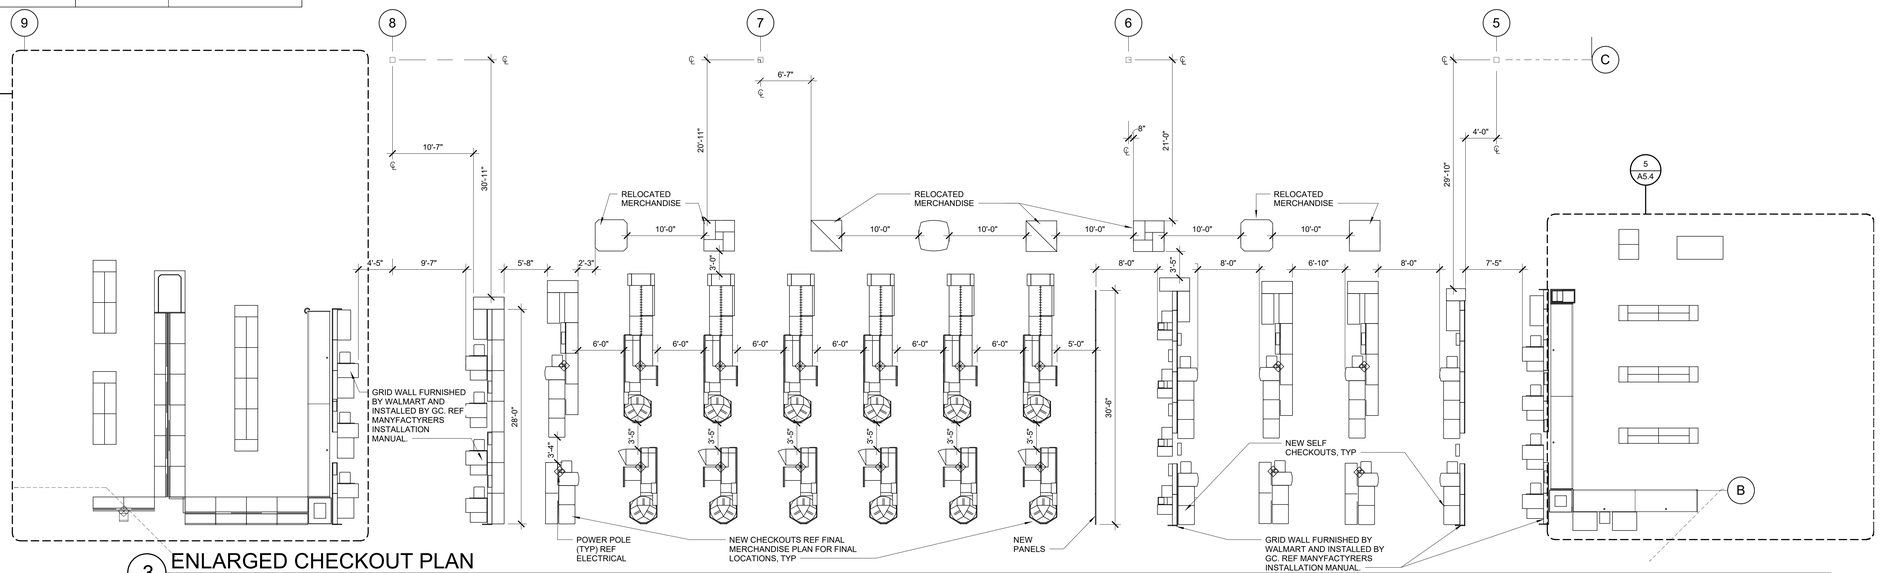
STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE SUITABLE FOR USE ON ANY OTHER PROJECT. ANY REUSE OF THESE DRAWINGS ON A DIFFERENT PROJECT SITE OR AT A LATER TIME, WITHOUT THE EXPRESS WRITTEN RELEASE OF THE ARCHITECT OR ENGINEER, IS PROHIBITED AND WILL BE AT THE USER'S SOLE RISK. REUSE OF THESE DRAWINGS ON ANY EXTENSION OF THIS PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

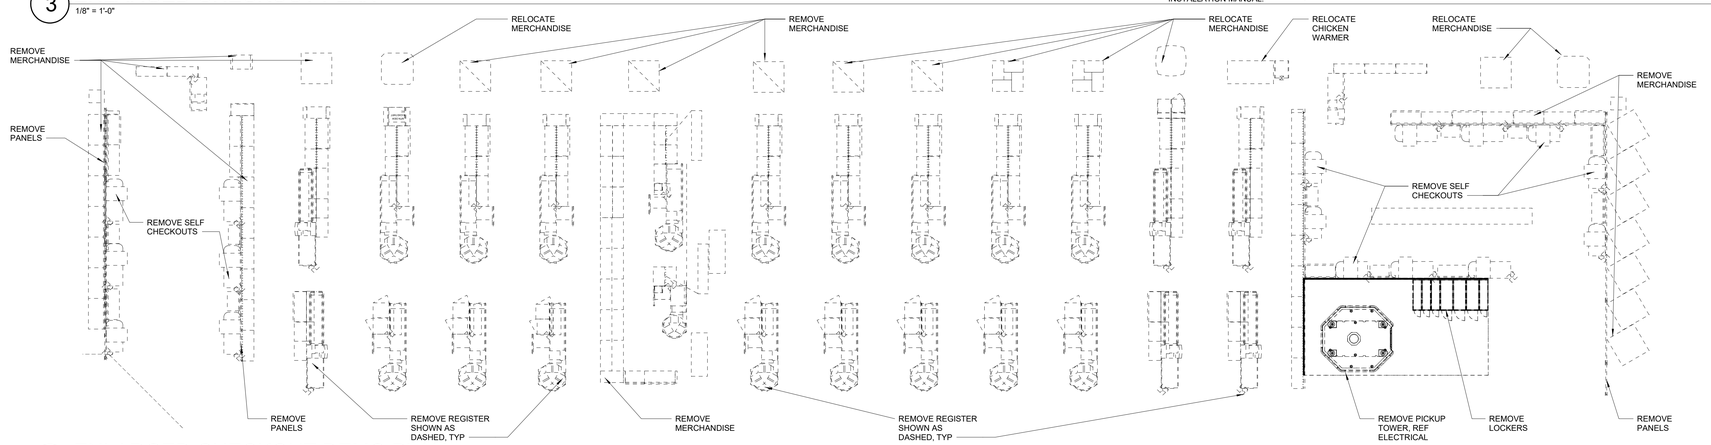
CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
JOB NUMBER: 210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | YB |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
TONY D MUI
AR100424
REGISTERED ARCHITECT
12/20/21

ENLARGED PLANS AND DETAILS

SHEET:
A5.4


12/20/2021 4:43:31 PM
C:\Users\tmui\AppData\Local\Temp\Documents\WIP\T_LakeCity_FL_168_L_ARCH_V25_tmui.rvt

**184 MOTHER'S ROOM**

**WALLS**
- PAINT ALL WALLS P204 WITH PS7 WAINSCOT AND DB5 BASE UNO.

**FLOOR**
- EXISTING EXPOSED CONCRETE FLOOR TO REMAIN.

**CEILING**
- NEW 5/8" GYP BOARD AT 9'-0" AFF P131. REF 8-A6.1

**151 BREAKROOM**

**WALLS**
- REF FINISH PLAN FOR FINISH INFORMATION. REF 7-A6.

**FLOOR**
- REF FLOOR FINISH PLAN. REF 1-A1.1

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**160 CLAIMS, 171 INVOICING, 174 CBL, 177 MARKET MANAGER'S OFFICE.**

**WALLS**
- ETR.

**FLOOR**
- ETR.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**150, 157, 162, 176 CORRIDORS AND HALLWAY**

**WALLS**
- ETR UNO.

**FLOOR**
- ETR

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

## SHEET NOTES

1. REFERENCE FINISH LEGEND AND SPECIFICATIONS FOR PAINT AND PROTECTIVE SURFACING.

## KEYNOTES

| | |
|---|---|
| **9.90** | FLOOR STRIPES. REF N1 FOR STRIPING CONDITIONS. |
| **10.11** | MIRROR |
| **10.26** | COAT HOOK (INSTALL PLYWOOD BACKING) |
| **10.44** | PROVIDE TACTILE "EXIT" SIGN. REF N1. |

**163 ALCOVE, 128 ALCOVE, 129 ALCOVE**

**WALLS**
- PAINT ALL WALLS P209 WITH PS7 WAINSCOT AND DB5 BASE UNO.
- DEMISING WALL ON SALES FLOOR: PAINT P209 WITH PS7 WAINSCOT AND DB5 BASE. REF 3-A3.

**FLOOR**
- REF FLOOR FINISH PLAN.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.




4 BREAKROOM FINISH PLAN
1/4" = 1'-0"




5 BREAKROOM ELEVATION
1/4" = 1'-0"

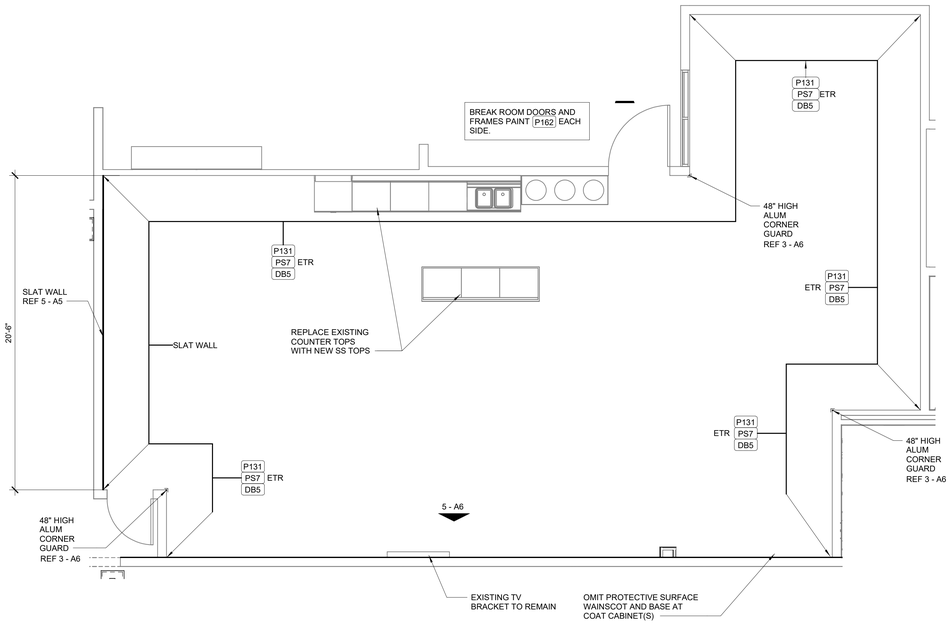


3 CORNER GUARD
3" = 1'-0"

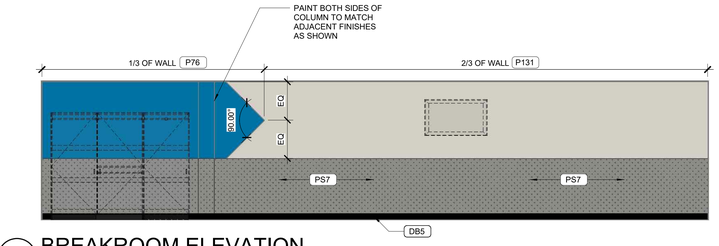


2 MOTHER'S ROOM
3/8" = 1'-0"

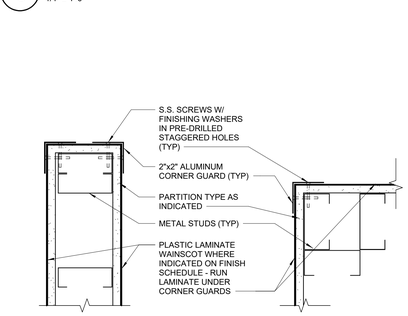


1 REAR OFFICE FLOOR PLAN
1/8" = 1'-0"


2600 Maitland Center Parkway
Suite 200
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8999
www.cpzarchitects.com
Cuozzi & Peterson
Architects Engineers Planners

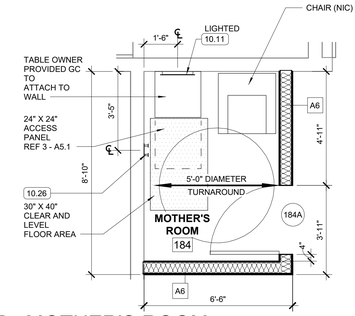

STIPULATION FOR REUSE

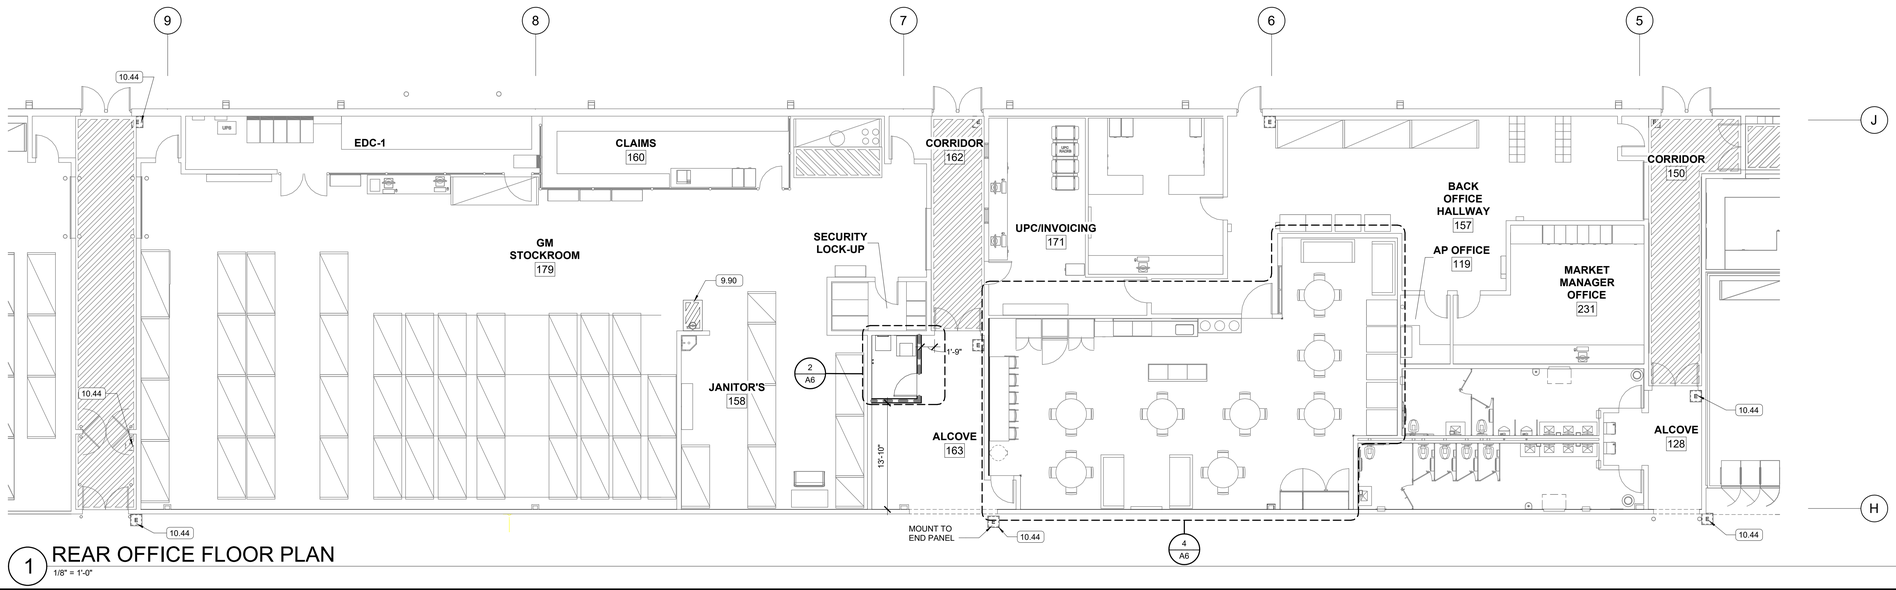THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE DATE AND SHALL NOT BE REUSED ON A DIFFERENT PROJECT SITE OR AT A LATER TIME WITHOUT THE EXPRESS WRITTEN PERMISSION OF CUOZZI & PETERSON. ANY UNAUTHORIZED REUSE OF THESE PLANS, DRAWINGS, SPECIFICATIONS OR THE DESIGNS SHOWN THEREIN, WITHOUT THE EXPRESS WRITTEN PERMISSION OF CUOZZI & PETERSON, ARCHITECTS ENGINEERS PLANNERS, FOR ANY PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 221035 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | SPA |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURRY
LICENSE NUMBER
AR100424
REGISTERED ARCHITECT
12/20/21

REAR OFFICE PLAN

SHEET: A6

12/20/2021 4:09:12 PM
C:\Users\jenna.hagmeyer\Documents\WORK_Lake City_FL_168_L_ARCH_V26_jenna.hagmeyer.rvt




## 15 SLAT WALL DETAIL
3/4" = 1'-0"




## 14 SLAT WALL ELEVATION
1/4" = 1'-0"

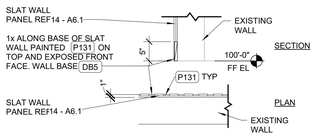


## 13 SECTION AT FURRING
1/2" = 1'-0"

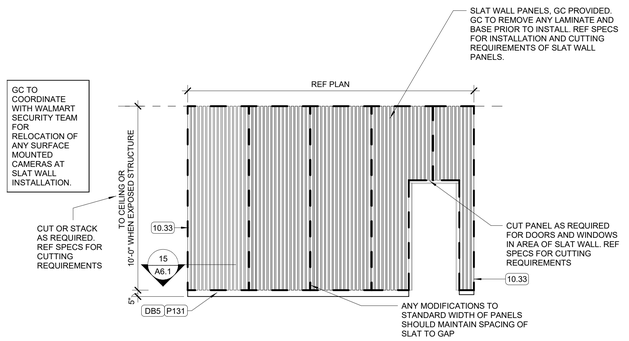


## 9 LEDGE DETAIL
1 1/2" = 1'-0"




## FIRE RATED CAPTURE TRACK
1 1/2" = 1'-0"

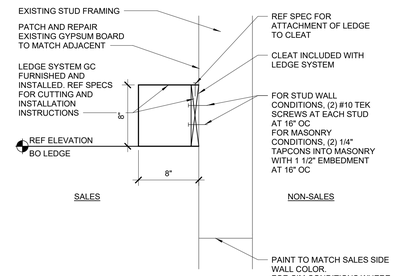


## 11 REPLACEMENT FRAMING DETAIL
1/2" = 1'-0"




## CAPTURE TRACK AT DEMISING WALL
1 1/2" = 1'-0"

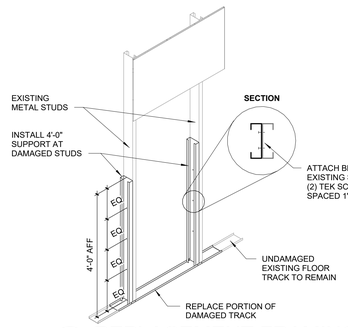


## PARTITION ATTACHMENT AT PERPENDICULAR JOIST
1 1/2" = 1'-0" RM SC: A6 RM WMN: ---

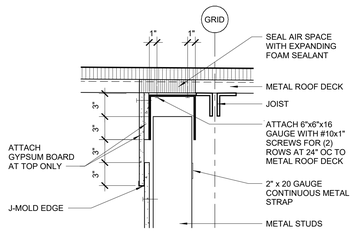


## 8 CEILING JOIST ATTACHMENT
1 1/2" = 1'-0" RM SC: A6 RM WMN: ---

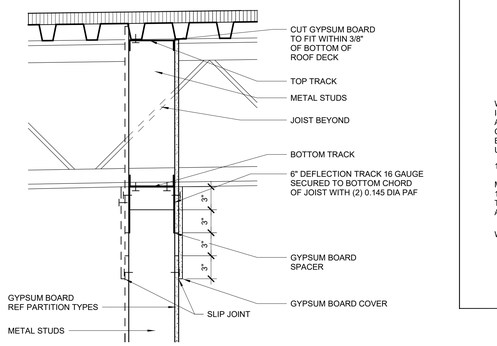


## 7 PARTITION BRACING
1 1/2" = 1'-0" RM SC: A6 RM WMN: A5.2




## 6 NON-RATED CAPTURE TRACK
1 1/2" = 1'-0" RM SC: A6 RM WMN: ---




## 4 GYPSUM BOARD CONTROL JOINT
1 1/2" = 1'-0" RM SC: A6 RM WMN: ---

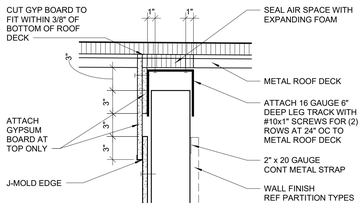


## 3 CONTROL JOINT AT DOOR JAMB
12" = 1'-0" RM SC: A6 RM WMN: ---

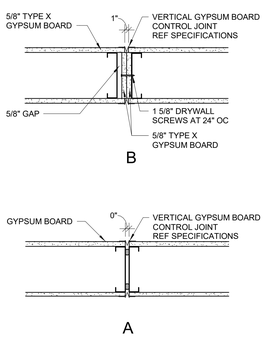


## 2 FURRING ATTACHMENT TO WALL
1 1/2" = 1'-0" RM SC: A6 RM WMN: A5.2

### INTERIOR NON-LOAD BEARING PARTITION HEADER SCHEDULE
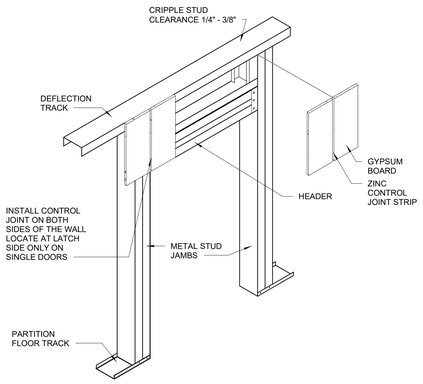
| HEADER LENGTH | HEADER MEMBERS | HEADER TRACKS | JAMB STUDS |
|---|---|---|---|
| UP TO 4'-0" | (2) C3 5/8x1 1/4"x20 GA | (2) C3 5/8x20 GA | (2) C3 5/8x1 1/4"x20 GA |
| UP TO 10'-0" | (2) C6x1 5/8"x18 GA | (2) C6x18 GA | (2) C6x1 5/8"x18 GA |
| OVER 10'-0" & UP TO 14'-0" | (2) C8x1 5/8"x18 GA | (2) C6x18 GA | (2) C6x1 5/8"x18 GA |
| OVER 14'-0" & UP TO 18'-0" | (2) C8x1 5/8"x16 GA | (2) C6x16 GA | (2) C6x1 5/8"x16 GA |
| OVER 18'-0" & UP TO 20'-0" | (2) C10x1 5/8"x16 GA | (2) C6x16 GA | (2) C6x1 5/8"x16 GA |
| OVER 20'-0" & UP TO 24'-0" | (2) C12x1 5/8"x16 GA | (2) C6x16 GA | (2) C6x1 5/8"x16 GA |

NOTES:
1. MAX WALL HEIGHT ABOVE HEADER ASSEMBLY IS 14'-0".
2. SPLICING OF HEADER AND JAMB MEMBERS IS NOT PERMITTED.
3. MAX SPAN FOR OPENINGS TO RECEIVE INFILL BELOW THE HEADER IS 19'-0".
4. JAMBS NOT TO DECK ARE TO BE BRACED IN ACCORDANCE WITH THE PARTITION BRACING DETAILS. 3 5/8" JAMBS BEYOND 13'-4" ARE TO BE BRACED ABOVE THE OPENING AND SUCH THAT THE MAXIMUM UNBRACED LENGTH IS NOT EXCEEDED.
5. FRAMING MEMBERS ARE NOT SIZED FOR VERTICAL LOAD OTHER THAN THAT OF THE PORTION OF WALL ABOVE THE OPENING.







## 1 HEADER CONNECTION DETAIL
1 1/2" = 1'-0" RM SC: A6 RM WMN: A5.2

## PARTITION TYPES

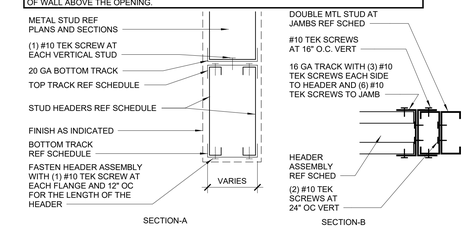


## PARTITION NOTES

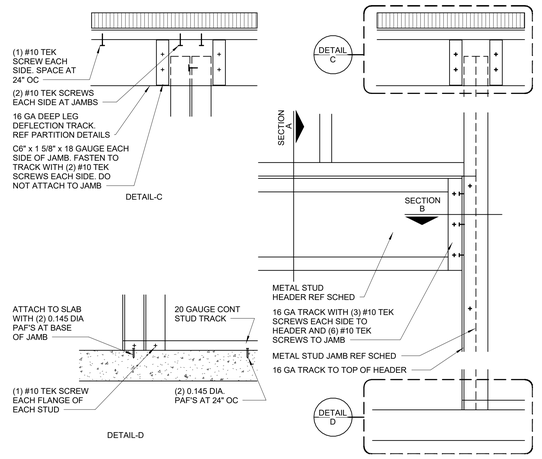1. STUDS CONTINUE TO DECK UNO. REF CAPTURE TRACK DETAILS.
2. USE 1/2" GYPSUM BOARD ON NON-RATED PARTITIONS UNO.
3. USE 5/8" TYPE X GYPSUM BOARD ON FIRE RATED PARTITIONS.
4. CONTINUE FINISH MATERIAL TO A MINIMUM OF 4" ABOVE SUSPENDED CEILING SYSTEMS UNO.
5. WHERE NO CEILING IS INDICATED CONTINUE FINISH TO DECK UNO. MAINTAIN CLEARANCE BELOW STRUCTURE PER CAPTURE TRACK DETAILS
6. STUD PARTITIONS REQUIRING A FIRE RATING OF ONE HOUR SHALL COMPLY WITH UL#U419, UL#U465 OR UL#U442. MASONRY PARTITIONS REQUIRING ONE HOUR FIRE RATING SHALL COMPLY WITH UL#U905.
7. MAXIMUM HEIGHT OF NON LOAD BEARING WALL ABOVE HEADER TO BE 14'-9"
8. REF SPECIFICATIONS FOR LATERAL BRACING OF STUD PARTITIONS.
9. PROVIDE ALTERNATING DIAGONAL METAL STUD BRACING ABOVE THE CEILING FOR INTERIOR WALL STUDS THAT DO NOT GO TO DECK. REF 7 - A6.1
10. USE GYPSUM BOARD BEHIND ALL FRP BOARD UNO.
11. WHERE NO CEILING IS SCHEDULED, STOP 1/2" PLYWOOD SUBSTRATE AT 10'-0" AFF.
12. PROVIDE FIRE BLOCKING AT FLOOR AND ROOF LEVELS, CONCEALED SPACES BETWEEN STAIRWAY STRINGERS, PENETRATIONS IN FLOOR/CEILING ASSEMBLIES AND OTHER LOCATIONS AS REQUIRED BY CODE.
13. ROOMS THAT HAVE 5/8" IMPACT RESISTANT GYP BD TO 48" AFF NEED 5/8" GYP BD ABOVE 48" AFF. REF A7 FOR LOCATIONS.
14. ON RESTROOMS WALLS RECEIVING PORCELAIN TILE, UPPER (PAINTED) PORTION IS TO BE WATER RESISTANT GYPSUM BOARD IN LIEU OF GLASS-MAT BACKER MATERIAL.
15. WHEN MODIFYING OR BUILDING ANY NEW FIRE RATED PARTITIONS, ENSURE ALL PENETRATIONS AND JOINTS ARE SEALED IN ACCORDANCE WITH THE SPECIFICATIONS.
16. PROPERLY SEAL ALL EXISTING PENETRATIONS IN EXISTING FIREWALLS TO ACHIEVE X HOUR RATING.
17. WALLS WITH AN UNSUPPORTED LENGTH GREATER THAN THE LIMITS LISTED IN THE SPECIFICATIONS ARE TO BE BRACED ABOVE THE CEILING AND AT NO GREATER THAN THE MAXIMUM UNSUPPORTED LENGTH
18. FOR PARTION WALL FRAMING DAMAGE REFERENCE 11 - A6.1

## PARTITION LEGEND

DETAIL:

PLAN:

LETTER INDICATES PARTITION TYPE REF PLANS AND SHEET A6

NUMBER INDICATES STUD HEIGHT
NO NUMBER INDICATES STUD HEIGHT TO BOTTOM OF ROOF DECK TYP

12
A3

REFERENCE SIDE
OPPOSITE SIDE

NUMBER INDICATES STUD SIZE AS FOLLOWS:

| | |
|---|---|
| 1 - 1 5/8" METAL | 6 - 6" METAL |
| 2 - 2 1/2" METAL | 8 - 8" CMU |
| 3 - 3 5/8" METAL | 12 - 12" CMU |

*REF SPECS FOR STUD GAUGE AND SPACING

- 1 HOUR RATED GYPSUM BOARD (NEW) UL#U419, UL#U442, OR UL#U465 1 HOUR RATED CMU (NEW) UL#U905
- NON-RATED GYPSUM BOARD WALL (NEW)
- ACOUSTICAL INSULATION FULL WALL THICKNESS (NEW)
- CHAIN LINK FENCE (NEW)
- COOLER/FREEZER WALL (NEW)
- (NEW) 48" HIGH PLASTIC LAMINATE OR PROTECTIVE SURFACE WAINSCOT UNO
- EXISTING 1 HOUR RATED GYPSUM BOARD TO REMAIN
- EXISTING PARTITION OR WALL TO REMAIN
- CMU WALL (NEW)
- EXISTING WALL TO BE DEMOLISHED
- EXISTING CHAIN LINK FENCE
- EXISTING 48" HIGH PLYWOOD WAINSCOT WITH 2x8 WOOD BASE
- CHAIR RAIL FURNISHED BY WALMART, INSTALLED BY G.C.
- NON-RATED GYPSUM BOARD WALL (NEW) (GROCERY PREP AREAS) WITH SILL SEALER


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8040
www.cpdesign.com
Cabaniss, Johnston, Gardner, Dumas & O'Neal LLP
Cabaniss & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THE SPECIFIC PROJECT AND AT THE CONTEMPORANEOUSLY WITH ITS ISSUE. REUSE OF THESE DRAWINGS ON ANY OTHER SITE BY DIFFERENT PROJECT SITE OR AT A LATER TIME, WITHOUT THE EXPRESS WRITTEN PERMISSION OF THE ORIGINAL ARCHITECT OR ENGINEER OF RECORD IS PROHIBITED. REPRODUCTION OF THIS DRAWING, IN WHOLE OR IN PART, FOR USE ON ANY PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 PROTO 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | LS |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
AR100424
REGISTERED ARCHITECT
12/20/21

PARTITION TYPES AND WALL DETAILS

SHEET: A6.1

12/20/2021 4:14:41 PM
C:\Users\johnston.lg\Autodesk\Documents\Revit\LG_Lake City_FL_LBL_L_ARCH_v18_johnston.lg@cpdesine.rvt

## NEW DOOR AND FRAME SCHEDULE

DETAIL REFERENCES ARE TO SHEET A8 UNO

| | | DOOR | | | | | | | FRAME | | | DETAIL | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | | | | NOMINAL SIZE | | | | | | | | | | | |
| MARK | ROOM NAME | NEW/ ETR | TYPE | MATERIAL | QTY | WIDTH | HEIGHT | GLASS | NEW/ ETR | TYPE | MATERIAL | HEAD | JAMB | THRESHOLD | FIRE RATING (MIN) | NOTES | MARK |
| 184A | MOTHER'S ROOM | NEW | F | HM-STL | 1 | 3' - 0" | 7' - 0" | --- | NEW | 1 | HM-STL | [4] | [3] | [---] | --- | [---] | 184A |
| 800A | MONEY CENTER | NEW | Y | PLASTIC | 1 | 3' - 0" | 3' - 2" | --- | --- | --- | --- | [---] | [---] | [---] | --- | [---] | 800A |
| 906A | BAKERY UTILITY | NEW | E | PLASTIC | 1 | 3' - 0" | 7' - 0" | ACRYLIC | ETR | --- | STL-BP | [21] | [20] | [---] | --- | [---] | 906A |

## MATERIAL KEY

| MARK | DESCRIPTION |
|---|---|
| A | CONCRETE |
| B | GLASS AND ALUMINUM FRAME |
| C | SMOOTH FACE CMU |
| D | SPLIT FACE CMU |
| E | CHAIN LINK |
| ETR | EXISTING TO REMAIN |
| F | EXPOSED STRUCTURE |
| G | GYPSUM BOARD |
| H | METAL SOFFIT |
| J | SHADE CLOTH |
| L | PLYWOOD |
| M | ORNAMENTAL FENCE |
| N | COOLER/FREEZER PANEL |
| P | TRANSLUCENT WALL PANEL |
| Q | FIBERGLASS ROOF PANELS |

## MATERIAL KEY

| MARK | DESCRIPTION |
|---|---|
| ACRYL | ACRYLIC |
| AL | ALUMINUM LINK |
| ALUM | ALUMINUM |
| CL | CHAIN LINK |
| HM-STL | HOLLOW METAL-STEEL |
| OM | ORNAMENTAL METAL |
| PLAST | PLASTIC |
| STL | STEEL |
| STL-P | STEEL PIPE |
| STL-BP | STEEL BENT PLATE |
| TEMP | TEMPERED |

## DOOR SCHEDULE NOTES

1. BUTTS OR HINGES. REF SPEC.
2. ALARM OR EXIT DEVICE. REF SPEC.
3. LATCH OR LOCK SET. REF SPEC.
4. PUSH AND/OR PULL. REF SPEC.
5. INSTALL AUTOMATIC CLOSER. REF SPEC.
6. REMOVE DOOR CLOSER. PATCH AS NEEDED.
7. ARMOR PLATE AND/OR KICKPLATE.
8. STOP, HOLDER, OR ELECTROMAGNETIC DOOR HOLDER. REF SPEC.
9. THRESHOLD. REF SPEC.
10. INSTALL CONTINUOUS GEARED HINGE. REF SPEC.
11. DOOR COORDINATOR. REF SPEC
12. ELECTROMAGNETIC LOCK. REF SPEC.
13. LOCK GUARD. REF SPEC.
14. ONE-WAY VIEWER. REF SPEC.
15. INSTALL 5"X20" WINDOW IN DOOR.
16. INSTALL FLEXIBLE STRIP CURTAIN
17. INSTALL SECTIONAL DOOR TRACK RETURN AT MAXIMUM HEIGHT AND AS CLOSE TO ROOF STRUCTURE AS ALLOWABLE BY MANUFACTURER.
18. FULLY GASKETED FOR NEUTRALIZATION.
19. PROVIDE 1" CLEARANCE BETWEEN EDGE OF STRIKE SIDE OF DOOR AND ADJACENT CASEWORK.
20. COORDINATE INSTALLATION OF SIGNAGE WITH DOOR MANUFACTURER. 1" HIGH LETTERS IN CONTRASTING COLORS TO BACKGROUND. TEXT TO READ "THIS DOOR TO REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED"
21. REMOVE EXISTING DOOR AND HARDWARE. EXISTING FRAME TO REMAIN. INSTALL HINGE FILLER PLATE AND STRIKE FILLER PLATE IN HOLLOW METAL FRAME.
22. FLEXIBLE TRAFFIC DOOR COLOR TO BE BLACK. PAINT DOOR FRAME P36. DO NOT PAINT STAINLESS STEEL FRAMES.
23. INSTALL HINGE FILLER PLATE PRIOR TO INSTALLATION OF CONTINUOUS HINGE.
24. PROVIDE VENDOR WITH FIELD VERIFIED DIMENSION OF CLEAR WIDTH AFTER REFRIGERATED CASES HAVE BEEN INSTALLED. DOOR COLOR TO BE BLACK.
25. SHELF ON DOOR TO BE STRIPPED, CLEANED, AND REFINISHED.
26. SIGNAGE: PROVIDE 1" HIGH LETTERS IN CONTRASTING COLORS TO BACKGROUND, TEXT TO READ "IN EMERGENCY PUSH TO OPEN"
27. NOT USED
28. NOT USED
29. NOT USED
30. NOT USED
31. NOT USED
32. NOT USED
33. NOT USED
34. CONTAINER AND DOOR MANUFACTURERS TO COORDINATE INSTALLATION OF DOORS.
35. DOOR TO BE FACTORY FINISHED BLACK COLOR - DO NOT PAINT
36. 32" MIN. CLEAR WORTH OF PASSAGEWAY AFTER INSTALLATION.
37. METAL DOOR FRAMES VISIBLE TO CUSTOMER NOT IN EXTERIOR WALLS TO RECEIVE EPOXY PAINT.
38. PREFINISHED DOOR AND HARDWARE FURNISHED AND INSTALLED BY VENDOR.
39. DOOR AND HARDWARE FURNISHED, INSTALLED, AND PAINTED BY G.C.
40. AUTOMATIC OPENER INSTALLED BY VENDOR, REF SPEC.
41. CARDREADER AND STAND ALONE ALARM INSTALLED BY VENDOR, REF SPEC. (1)
42. INSTALL STOREROOM LOCK, REF SPEC.
43. DOOR BY IPB MANUFACTURER.
44. IPB AND DOOR MANUFACTURERS TO COORDINATE INSTALLATION OF DOORS.
45. NOMINAL SIZE FOR HEIGHTS AND WIDTHS ARE DETERMINED BY THE PACKAGE HEIGHT AND WIDTH FROM DOOR VENDOR.

## GENERAL DOOR NOTES

1. ALL DOORS SCHEDULED AS NEW ARE TO RECEIVE COMPLETE NEW HARDWARE SETS AS LISTED IN SPECIFICATIONS.
2. REFERENCE ELEVATIONS ON A2 FOR EXTERIOR DOOR COLORS
3. SCHEDULED WIDTH AND HEIGHT INDICATE FINISHED OPENING SIZE AT ALL OVERHEAD AND COILING DOOR LOCATIONS
4. SCHEDULED WIDTH AND HEIGHT INDICATE ROUGH OPENING SIZE AT ALL AUTOMATIC SLIDING DOOR LOCATIONS.
5. INSTALL DRIP CAP AT ALL NEW EXTERIOR DOORS.

## FINISH KEY

REF SPECIFICATIONS FOR EXACT COLORS REQUIRED

| MARK | FINISH | COLOR | DESC. |
|---|---|---|---|
| ACT1 | ACOUSTICAL CEILING TILE | WHITE | 24"x48" |
| ACT2 | ACOUSTICAL CEILING TILE | WHITE | 24"x48" VINYL FACED NON-PERFORATED |
| ACT3 | ACOUSTICAL CEILING TILE | WHITE | 24"x48" |
| ACT4 | ACOUSTICAL CEILING TILE | WHITE | 24"x48" |
| ACTG | ACOUSTICAL CEILING GRID | WHITE | |
| B6 | PLASTIC BASE | BLACK | 6"x1/4" |
| B9 | PLASTIC BASE | BLACK | 4"x1/4" |
| B10 | PLASTIC BASE OUTSIDE CORNER | BLACK | |
| C1 | CUSHION BACK TILE CARPET | | |
| C3 | CUSHION BACK TILE CARPET | WALNUT | |
| CC | CONCRETE CURB | | |
| CT2 | ENTRY TILE | RED | 12" x 24" x 3/8" |
| CT43 | PORCELAIN WALL TILE | BEIGE | 12" x 12" x 3/8" |
| CT44 | PORCELAIN FLOOR TILE | GRAY | 12" x 12" x 3/8" |
| CT45 | WALL TILE | WHITE | 4" x 8" x 3/8" |
| CT47 | WALL TILE | BLUE | 4" x 8" x 3/8" |
| CT48 | FLOOR TILE | TAUPE GRADIENT | 12" x 24" x 3/8" |
| CT48A | COVE BASE | TAUPE GRADIENT | 6" x 12" x 3/8" |
| DB5 | DURA-TUFF BASE | BLACK | 5" |
| DB10 | DURA-TUFF BASE | BLACK | 10" |
| ETR | EXISTING TO REMAIN | | |
| FRP1 | FIBERGLASS REINFORCED PLASTIC | WHITE | FRP WALL PANEL |
| FRP2 | FIBERGLASS REINFORCED PLASTIC | BEIGE | FRP WALL PANEL |
| FRP5 | FIBERGLASS REINFORCED PLASTIC | ALMOND | FRP WALL PANEL |
| FT1 | FAUX SUBWAY TILE | WHITE | |
| G1 | GROUT | DARK GRAY | |
| G2 | GROUT | DARK GRAY | |
| G3 | GROUT | LIGHT TAN | |
| G4 | GROUT | GRAY | |
| G7 | GROUT | BROWN | |
| G15 | GROUT | BLACK | |
| G16 | GROUT | GRAY | |
| HRC1 | HEAT RESISTANT COATING | TO MATCH COPPER BROWN BY BERRIDGE | |
| HRC4 | HEAT RESISTANT COATING | MATCH DARK GRAY | |
| ICC | INTEGRAL COLORED CONCRETE | BROWN | |
| P3 | PAINT | "LOYAL BLUE" #6510 | |
| P5 | PAINT | "SAFETY YELLOW" OSHA STANDARD | |
| P5E | PAINT | SAFETY YELLOW | |
| P8 | PAINT | "PURE WHITE" # 7005 | |
| P14 | PAINT | "GOLDENROD" # 6677 | |
| P16 | PAINT | "SOFTWARE" #7074 | |
| P21E | PAINT | SAFETY RED | |
| P33E | PAINT | CREAM | |
| P36 | PAINT | "DOMINO" #6989 | |
| P36E | PAINT | BLACK | |
| P40 | PAINT | "GARDENIA" #6665 | |
| P49E | PAINT | DARK GRAY | |
| P76 | PAINT | "WALMART BLUE" #076 | |
| P76U | PAINT | WALMART BLUE (URETHANE-LIKE) | |
| P81E | PAINT | BLACK | |
| P93 | PAINT | "TAMARIND" #7538 | |
| P100 | PAINT | "NOTABLE HUE" #6521 | |
| P102 | PAINT | "BEACH HOUSE" #7518 | |
| P107 | PAINT | "STRAW HARVEST" #7698 | |
| P112 | PAINT | "BUTTERFIELD" #6676 | |
| P126 | PAINT | "KNOCKOUT ORANGE" #6885 | |
| P126U | PAINT | PICKUP ORANGE (URETHANE-LIKE) | |
| P131 | PAINT | "WHITE FLOUR" #7102 | |
| P134E | PAINT | LIGHT GRAY | |
| P135E | PAINT | MEDIUM GRAY | |
| P140E | PAINT | WHITE | |
| P159 | PAINT | "CASA BLANCA" #7571 | |
| P162 | PAINT | "PEPPERCORN" #7674 | |
| P162E | PAINT | BLACK GRAY | |
| P163 | PAINT | "TURQUISH" #6939 | |
| P164 | PAINT | "ESSENTIAL GRAY" #6002 | |
| P204 | PAINT | "FESTOON AQUA" #0019 | |
| P205 | PAINT | "DARK BLUE" | |
| P206 | PAINT | "IBIS WHITE" #7000 | |
| P207 | PAINT | "CONTEMPORARY GRAY" #1465 | |
| P208 | PAINT | "CANDID BLUE" SW #6953 | |
| P209 | PAINT | "PASSIVE GRAY" #7064 | |
| PF4 | LEAD-COTE | METALLIC | |
| PL3 | PLASTIC LAMINATE | "ORGANIC COTTON" WILSONART 4945-38 | |
| PL4 | PLASTIC LAMINATE | MAPLE | |
| PL6 | PLASTIC LAMINATE | LIGHT TAN | |
| PL11 | PLASTIC LAMINATE | NORTH SEA GRAY | |
| PL15 | PLASTIC LAMINATE | BROWN | |
| PL20 | PLASTIC LAMINATE | TAN | |
| PL28 | PLASTIC LAMINATE | ALOE | |
| PL30 | PLASTIC LAMINATE | "STEEL MESH" WILSONART 4879 | |
| PL31 | PLASTIC LAMINATE | "GREY" WILSONART 1500-60 | |
| PS1 | PROTECTIVE SURFACE | WALMART MED BLUE IMPACT SPECIALTIES | |
| PS4 | PROTECTIVE SURFACE | "GLOWING EMBER" IMPACT SPECIALTIES | |
| PS5 | PROTECTIVE SURFACE | "FRESH LINEN" IMPACT SPEICALTIES | |
| PS6 | PROTECTIVE SURFACE | YELLOW | |
| PS7 | PROTECTIVE SURFACE | "GRAY PATTERN" | |
| PS8 | PROTECTIVE SURFACE | "MAPLE" | |
| PS9 | PROTECTIVE SURFACE | "WHITE GLOSS" | |
| PS10 | PROTECTIVE SURFACE | "BLACK" | |
| PS11 | PROTECTIVE SURFACE | "MATTE LUXE CHARCOAL" | |
| PVC1 | PVC PLANK FLOORING | WOODGRAIN | |
| QT3 | QUARRY TILE | GRAY | 6"x6" ABRASIVE |
| QT31 | QUARRY TILE | RED | 6"x6" ABRASIVE |
| RRF3 | RECYCLED RUBBER FLOORING | BLACK/BLUE | |
| SCB1 | SANITARY COVE BASE | RED | 8" H ANTIMICROBIAL PLASTIC FOR QT |
| SCB2 | SANITARY COVE BASE | GRAY | 8" H ANTIMICROBIAL PLASTIC FOR QT |
| SCB4 | SANITARY COVE BASE | RED | 8" H ANTIMICROBIAL PLASTIC |
| SCB5 | SANITARY COVE BASE | GRAY | 8" H ANTIMICROBIAL PLASTIC |
| SS | STAINLESS STEEL | | |
| SST1 | SOLID SURFACE | | |
| TC | TEXTURED CONCRETE | | |
| VCT9 | VINYL COMPOSITION TILE | WHITE | 12"x12"x1/8" |
| VCT11 | VINYL COMPOSITION TILE | BEIGHE | 12"x12"x1/8" |
| VCT12 | VINYL COMPOSITION TILE | TAN | 12"x12"x1/8" |
| WB | 2x8 WOOD BASE | | |
| WB10 | 2x10 WOOD BASE | | |
| WG | PLASTIC WALL GUARD | BLACK OR GRAY | |

## GENERAL FINISH NOTES

1. PAINT ALL METAL DOOR FRAMES VISIBLE TO CUSTOMER (EXCEPT DOORS IN CMU WALLS) WITH EPOXY PAINT. PREP SURFACE TO BE PAINTED PER SPECIFICATIONS
2. PAINT ALL HM DOORS AND FRAMES LOCATED IN NEWLY PAINTED WALLS AS INDICATED:
   - DOORS AND FRAMES SHALL BE PAINTED P162 UNO
   - PAINT NEW DOORS P162 IF ADJACENT WALLS ARE UNFINISHED UNO
3. AT ROOMS SCHEDULED TO RECEIVE NEW PAINT: OMIT PAINT AT WALLS CONCEALED BY HALF-GONDOLAS, WALL STANDARDS OR WAREHOUSE RACKING WITH PEG-BOARD BACKING. AT WALL STANDARDS, GONDOLAS AND WAREHOUSE RACKING WITHOUT PEG-BOARD BACKING, PAINT WALL TO BASE.
4. AT EXPOSED PAINTED STRUCTURE OR DECK, PAINT NEW CONDUIT, DUCTWORK AND FIRE SPRINKLER PIPING (FIRE SPRINKLER HEADS TO REMAIN UNPAINTED) TO MATCH ADJACENT STRUCTURE OR DECK.
5. FOR PROTECTIVE WALL SURFACING WAINSCOT, INSTALL OUTSIDE CORNER TRIM, REFERENCE SPECIFICATIONS.
6. WHERE NEW PROTECTIVE SURFACING WAINSCOT IS TO BE INSTALLED, REMOVE EXISTING LAMINATE AND/OR FINISHES TO BASE SUBSTRATE PRIOR TO INSTALLATION OF NEW. INSTALLATION OF NEW PROTECTIVE SURFACING OVER EXISTING IS NOT ACCEPTABLE. NO EXCEPTIONS.




4 HEAD
1 1/2" = 1'-0"




3 JAMB
1 1/2" = 1'-0"

2 FRAME TYPES
3/16" = 1'-0"




1 DOOR TYPES
3/16" = 1'-0"


3600 Maitland Center Parkway
Suite 420
Maitland, Florida 32751
P (407) 645-5500
F (407) 645-5581
www.cpdesign.com
Cedrun & Peterson
Architects Engineers Planners



STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THE SPECIFIC PROJECT AND SITE CONTEMPORANEOUSLY WITH ITS ISSUE. CEDRUN & PETERSON ASSUMES NO LIABILITY FOR REUSE OF THESE DRAWINGS ON A DIFFERENT PROJECT OR SITE OR AT A LATER TIME WITHOUT THE EXPRESS WRITTEN CONSENT OF CEDRUN & PETERSON. ALL RIGHTS RESERVED. COPYRIGHT © 2020 CEDRUN & PETERSON. THESE DRAWINGS AND SPECIFICATIONS, AS INSTRUMENTS OF SERVICE, ARE AND SHALL REMAIN THE PROPERTY OF CEDRUN & PETERSON. THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANY PERSON OR ENTITY FOR ANY PROJECT EXCEPT THE PROJECT FOR WHICH THEY WERE PREPARED, REPRODUCTION OF THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE WRITTEN PERMISSION OF CEDRUN & PETERSON IS PROHIBITED. VISUAL CONTACT WITH THESE DRAWINGS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS. ANY UNAUTHORIZED USE OF THESE DRAWINGS AND SPECIFICATIONS IS AT THE SOLE RISK OF THE USER AND WILL BE SUBJECT TO LEGAL ACTION.


CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
Z210335 PROTO
JOB NUMBER:
168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| 1 | PR#1 | TBD |

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | LS |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
LICENSED
AR100824
REGISTERED ARCHITECT
12/20/21

DOOR AND ROOM FINISH SCHEDULE

SHEET:
A8


12/20/2021 4:14:32 PM
C:\Users\jmiller.cedrunpeterson\Documents\WIP\T_LakeCity_FL_168_L_ARCH_VDB_jmiller.cedrunpeterson.rvt

**604 CUSTOMER SERVICE, 606 WAITING AREA**

**WALLS**
- GYP BD: PAINT WALLS P209 TO CEILING . USE PS7 WAINSCOT AND DB5 BASE.
- CMU: PAINT P209 TO CEILING.
- PAINT ALL HOLLOW METAL DOORS AND FRAMES P162.

**FLOOR**
- ETR

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**MILLWORK**
- EXISTING SOLID SURFACE COUNTERTOP: REPLACE COUNTERTOP WITH NEW SS COUNTERTOP.

**607 OFFICE**

**WALLS**
- ETR.

**FLOOR**
- ETR.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**MILLWORK**
- ETR.

**600 LUBE & TIRE MOUNTING AREA**

**WALLS**
- PAINT LUBE AND TIRE MOUNTING AREA P16 TO 8'-0" AFF, PAINT P8 FROM 8'-0" AFF TO DECK. PAINT BOTH SIDES AND TOP HALF-HEIGHT WALL P16.
- PAINT HOLLOW METAL DOORS AND FRAMES P162.
- CLEAN AND PAINT RAILINGS FOR STAIRS AND PIT OPENINGS P5.

**FLOOR**
- ETR.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**601 TOILET**

**WALLS**
- GYP BD: PAINT P131.
- PAINT HOLLOW METAL DOORS AND FRAMES P162.

**FLOOR**
- ICC: ETR, CLEAN FLOORING.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**602 MECHANICAL, 603 SECURITY, 605 STORAGE, 608 SUPPLY, 615 TIRE STORAGE**

**WALLS**
- IF EXISTING WALLS ARE PAINTED, REPAINT WALLS P8.
- PAINT HOLLOW METAL DOORS AND FRAMES P162.

**FLOOR**
- ETR.

**609 LUBE PIT**

**WALLS**
- ETR.

**FLOOR**
- ETR.

## KEYNOTES

| | |
|---|---|
| 9.90 | FLOOR STRIPES. REF N1 FOR STRIPING CONDITIONS. |




4 AUTO CENTER ENTRY ELEVATION
1/4" = 1'-0"







6 GUTTER AND BRACKET
1 1/2" = 1'-0"

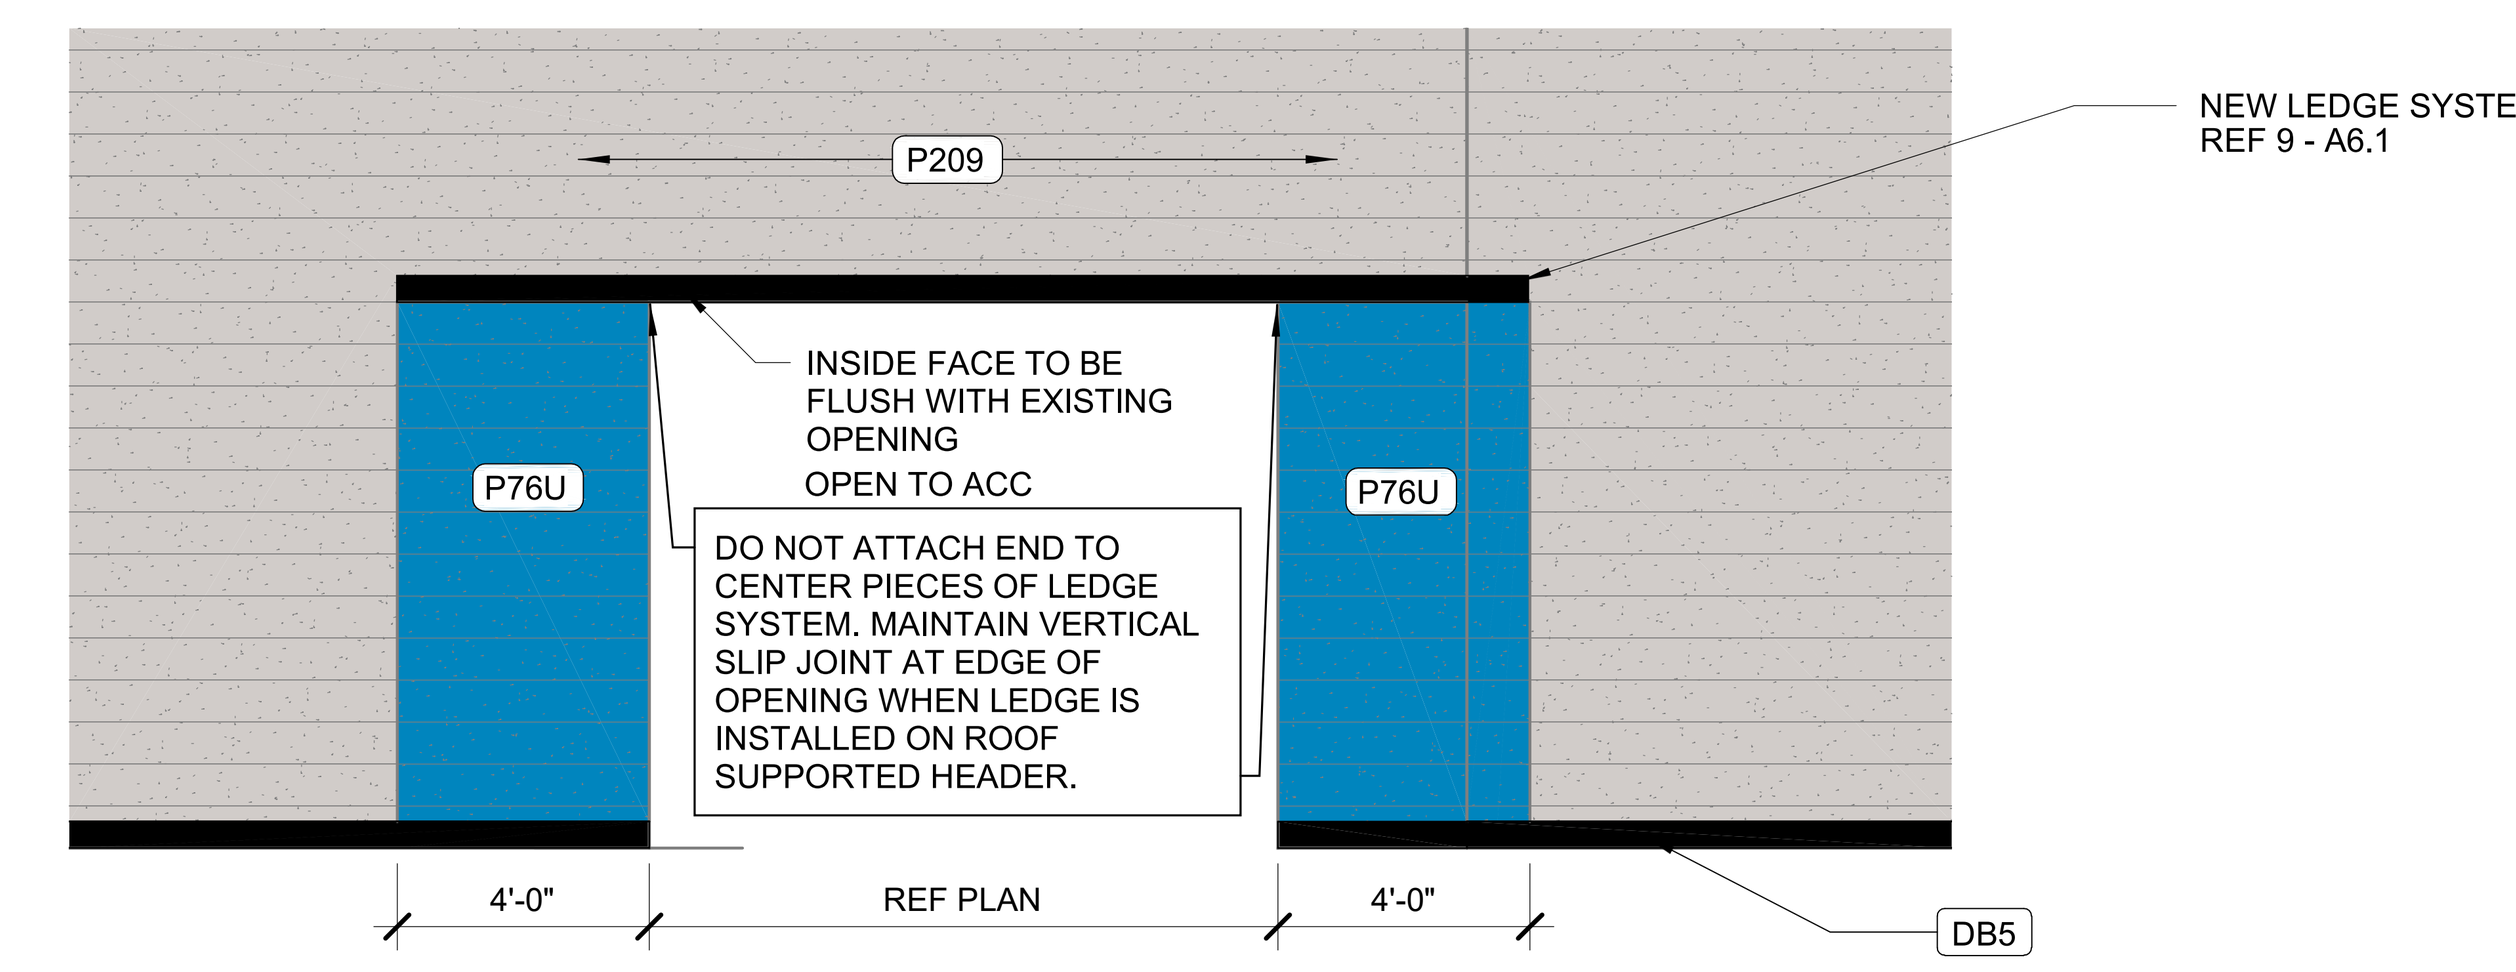


3 ACC TOILET
3/8" = 1'-0"

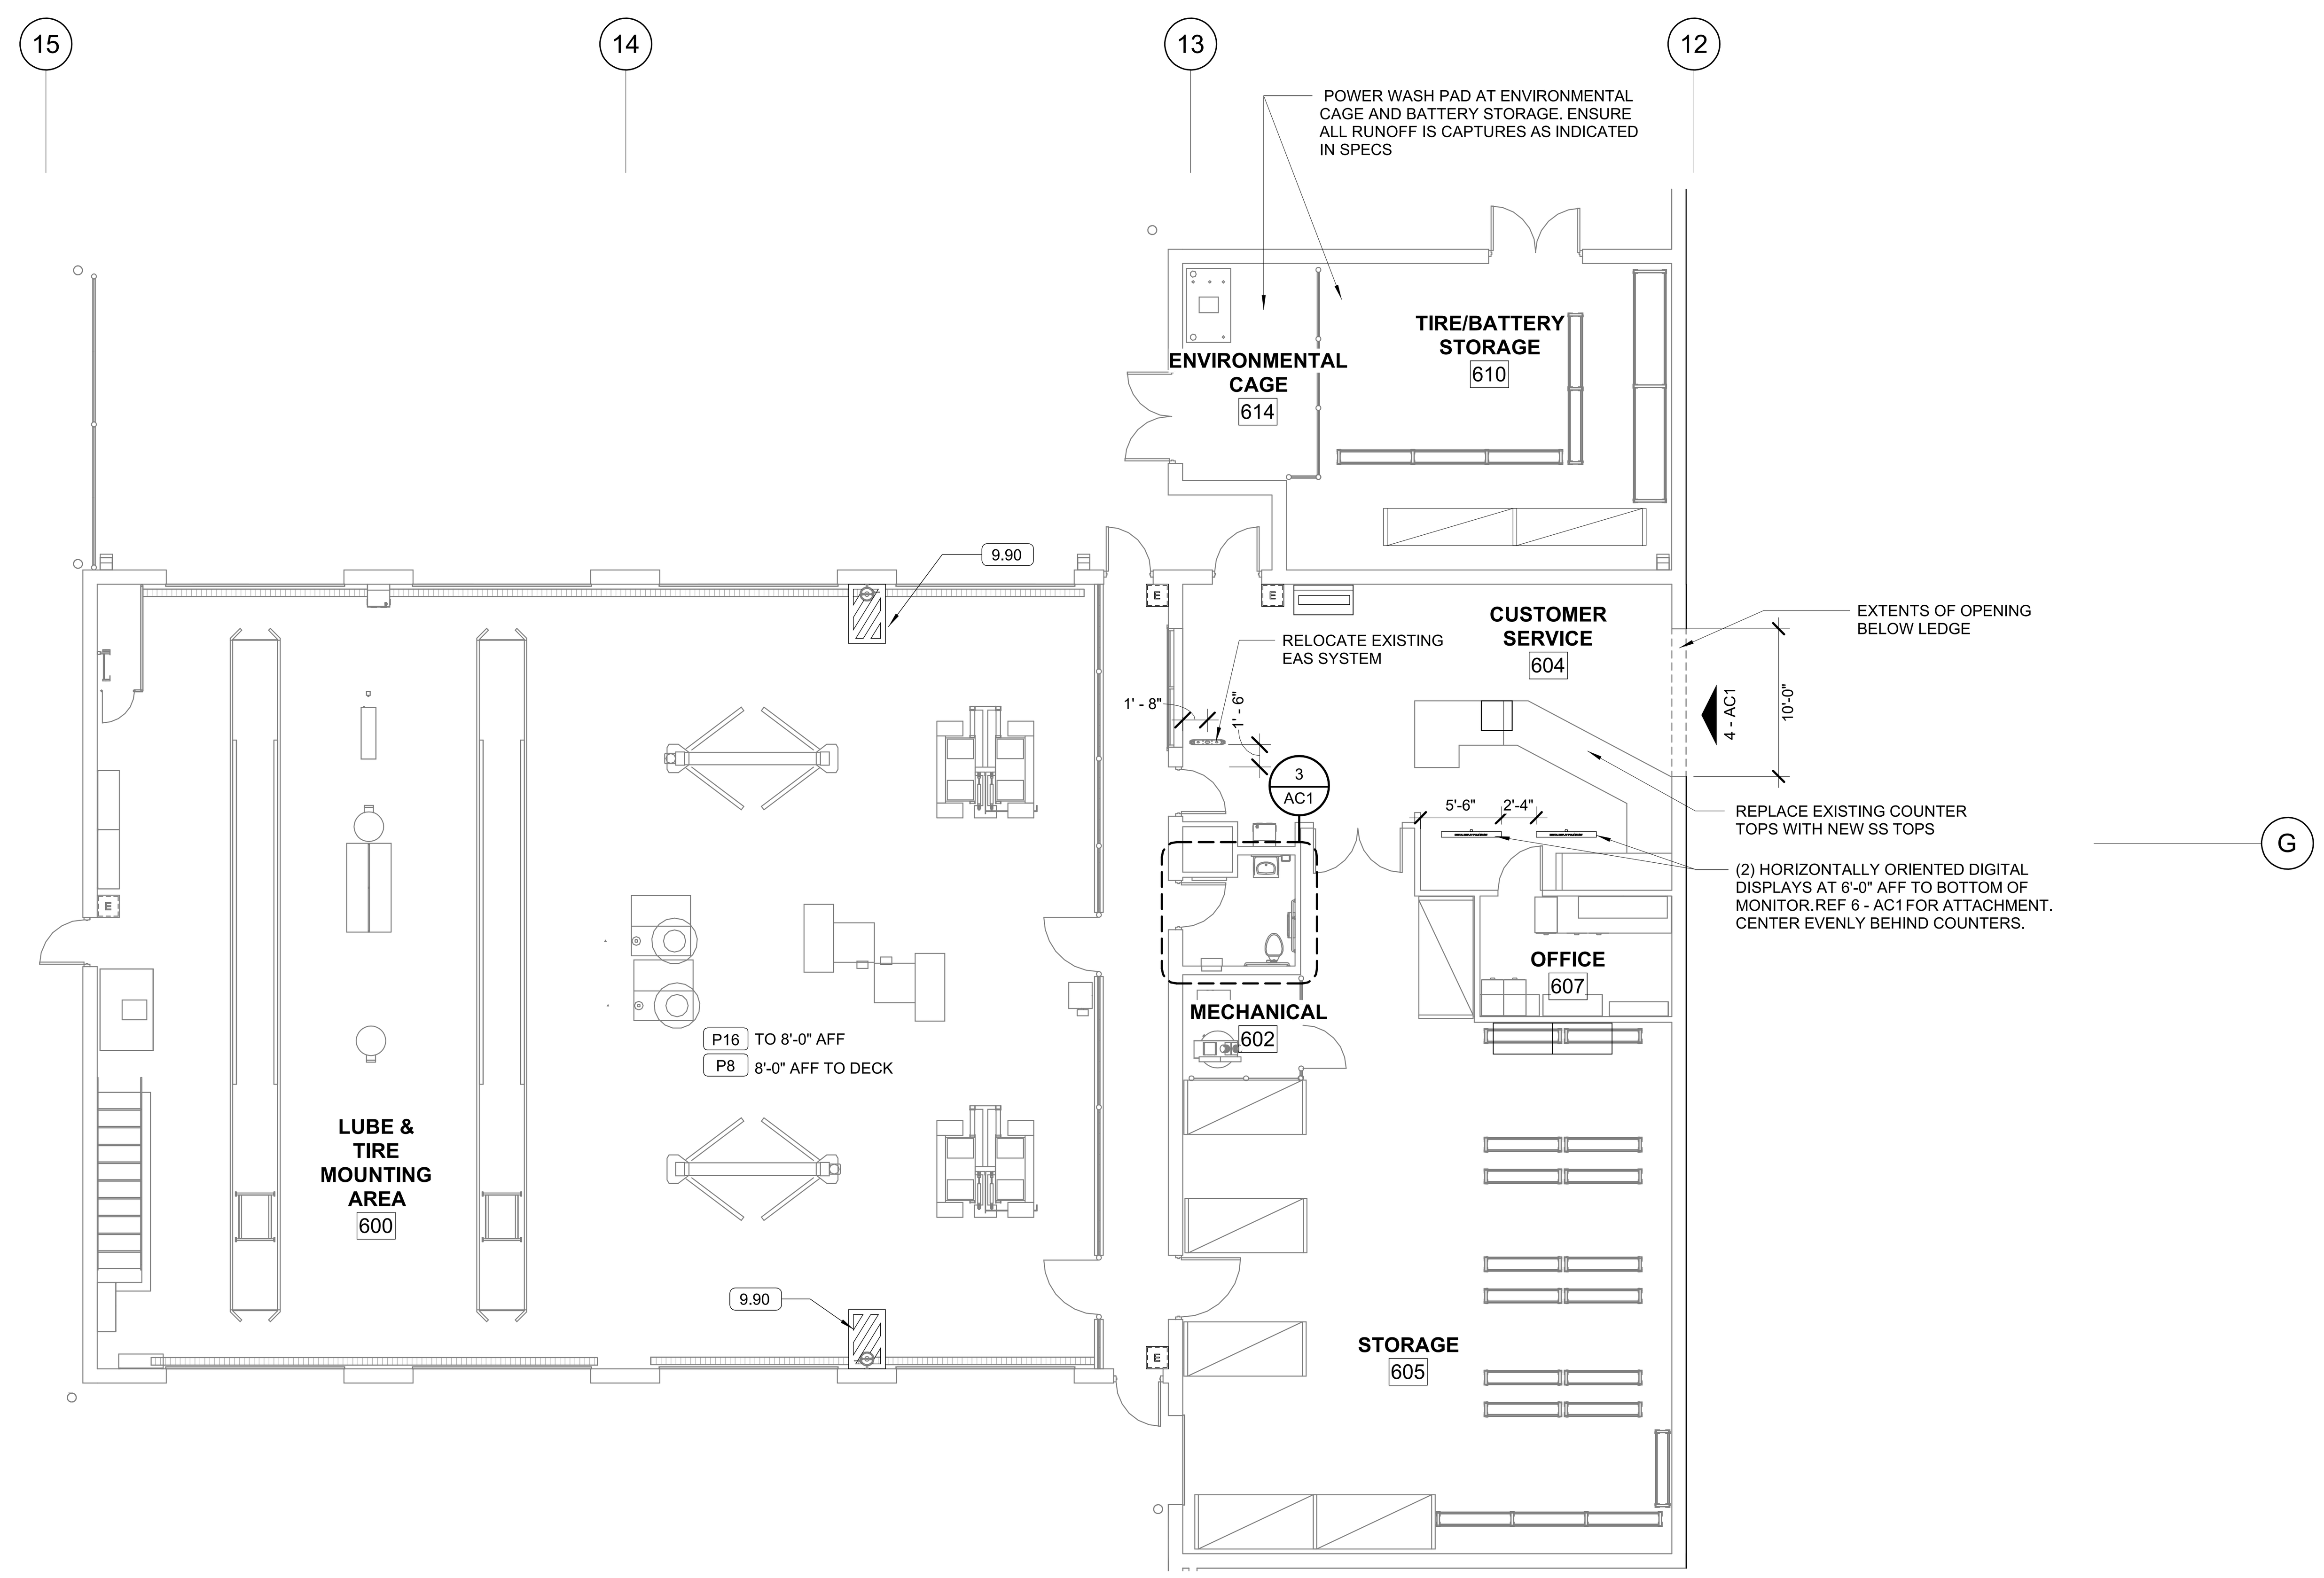


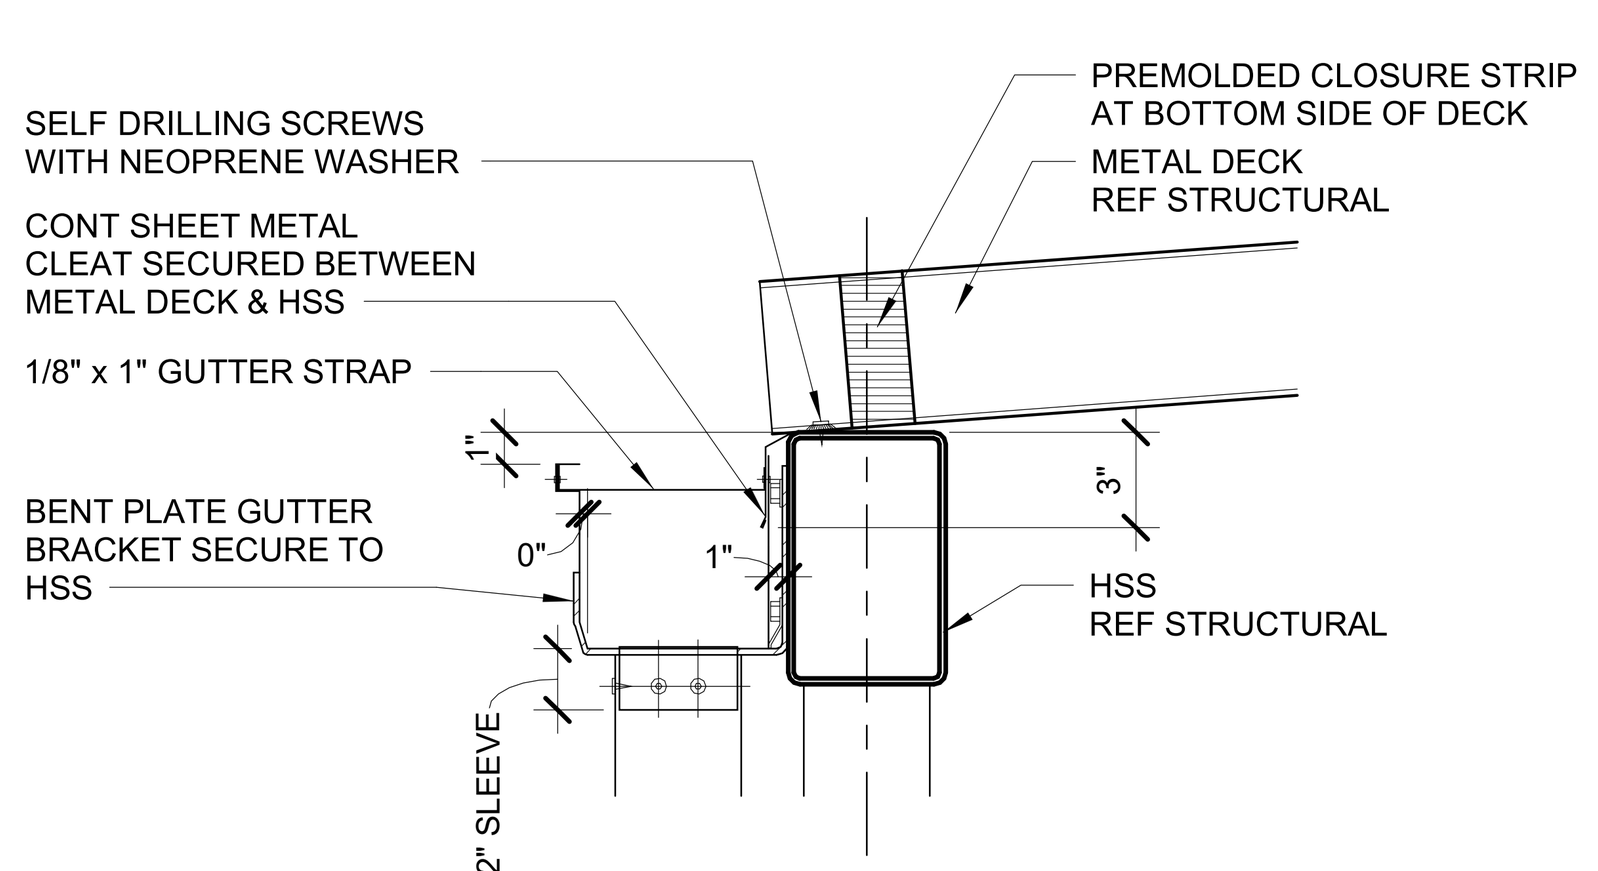5 LUBE PIT PLAN
3/16" = 1'-0"

1 ENLARGED AUTO CENTER PLAN
1/8" = 1'-0"

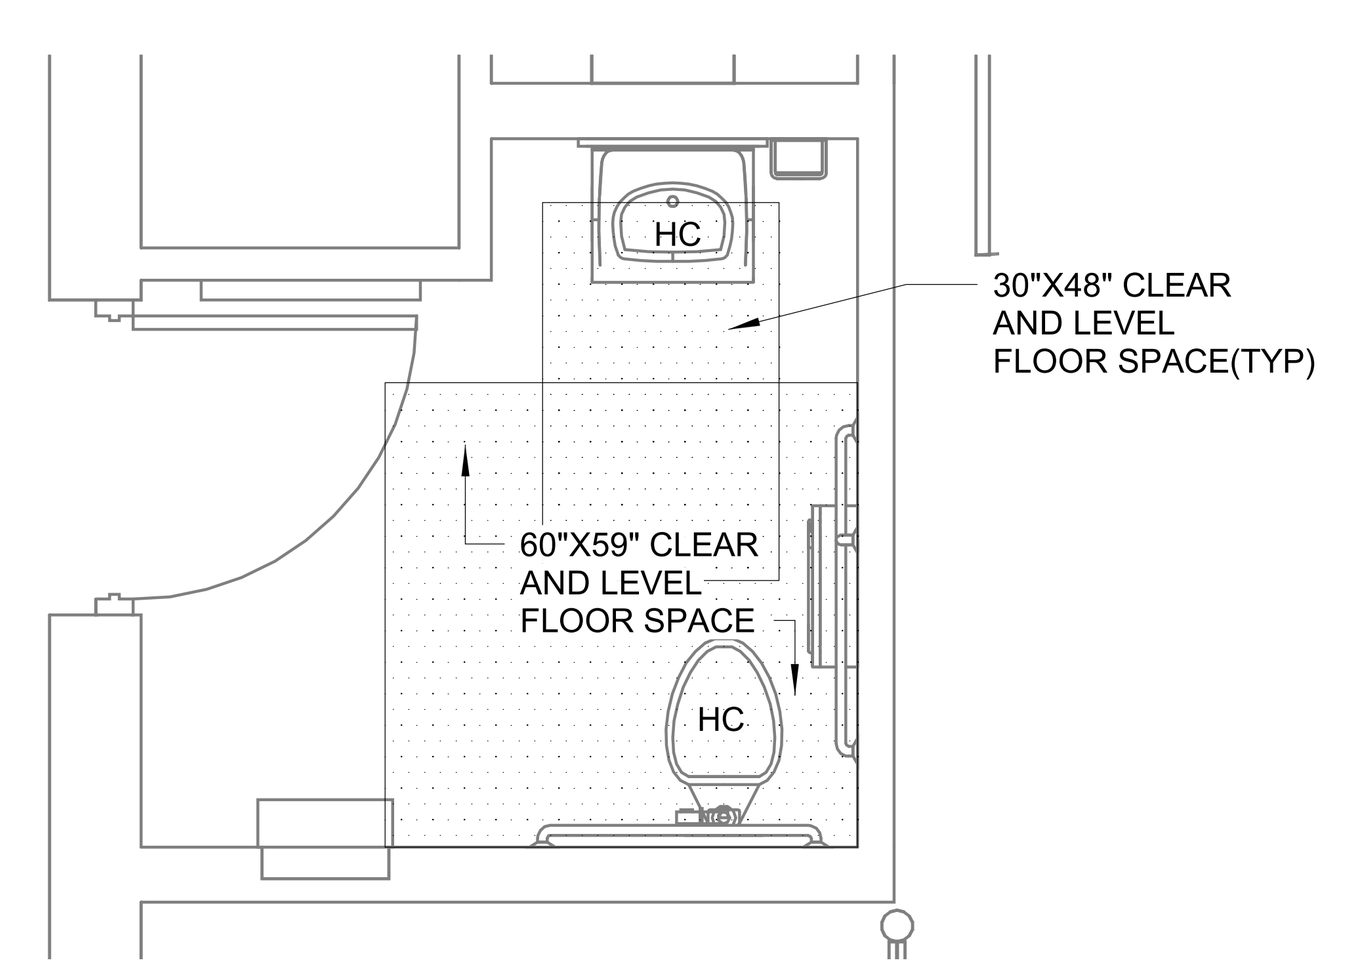12/20/2021 4:09:24 PM
C:\Users\jeritsa.negronquiros\Documents\00767_LakeCity_FL_188_L_ARCH_V20_jeritsa.negronquiros.rvt

Cuhaci & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com
Florida Corporate Certificate #AA C000526

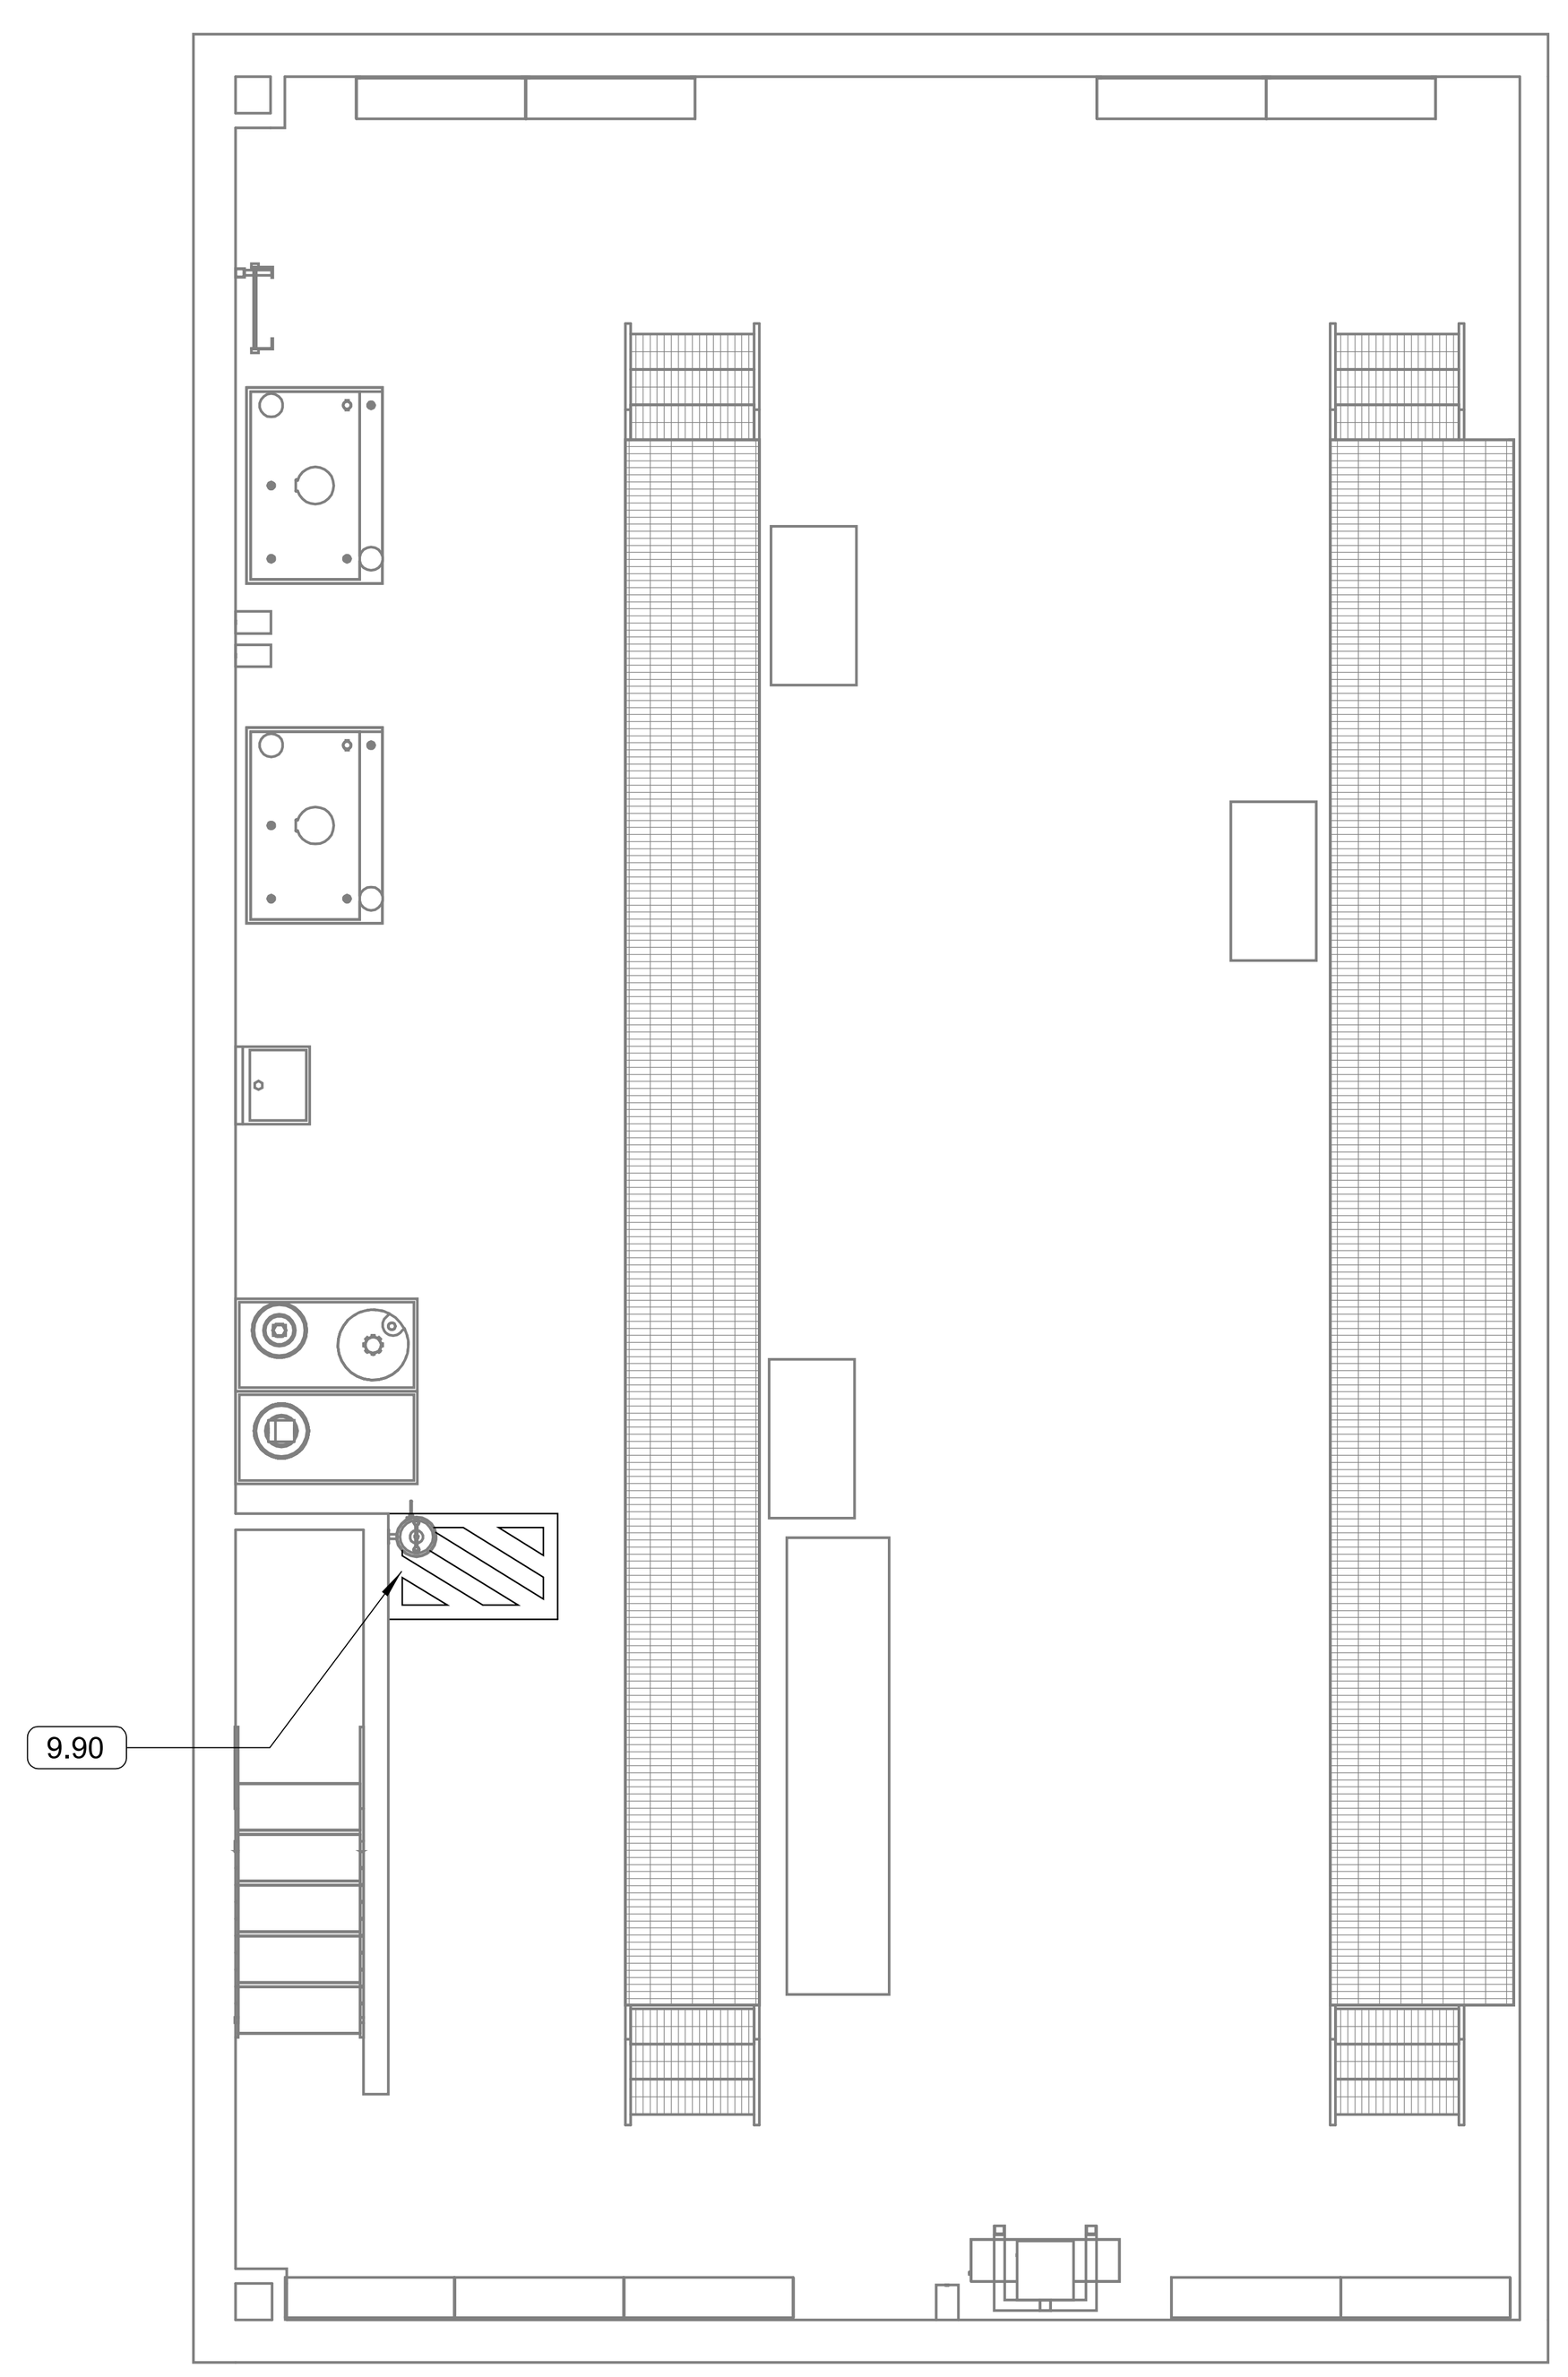STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

| JOB NUMBER: | 2210335 | PROTO: | 188 PROTO SC |
|---|---|---|---|

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | LS |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
AR100424
REGISTERED ARCHITECT
Anthony D Murphy
12/20/21

AUTOCENTER PLAN AND DETAILS

SHEET:
AC1

**126 SEASONAL SHOP**

**WALLS**
- CMU: PAINT P131 TO CEILING IF EXISTING OR FULL HEIGHT WHERE OPEN TO STRUCTURE.

**FLOOR**
- EC: ETR

**CEILING**
- OPEN TO STRUCTURE: CLEAN AND PAINT EXPOSED HVAC DUCT WORK AND PLENUMS TO MATCH PAINTED STRUCTURE UNLESS GALVANIZED OR UNPAINTED. CLEAN JOISTS, JOIST GIRDERS, DECKING, CONDUIT, SPRINKLER PIPES, AIR GRILLES/DIFFUSERS AND SECURITY GLOBES.

**500 GARDEN CENTER**

**FENCING**
- PAINT EXISTING ORNAMENTAL FENCING AND GATES P81E.
- REPLACE ALL WINDSCREENS REF SPECS.

**FLOOR/SLAB**
- EXISTING FLOORS TO REMAIN. REPAIR DAMAGED SLAB AS REQUIRED.
- GC TO PROVIDE NON-SHRINK GROUT IN ALL RECESSED COLUMN SUPPORT.

**CEILING**
- METAL CANOPY: POWERWASH. REPLACE ALL DAMAGED OR MISSING PRE-MOLDED CLOSURE STRIPS AROUND LIGHT FIXTURES.




1 GAREN CENTER PLAN
1" = 10'-0"


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-2961
www.cpaecf.com
Cubarri & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AND PROJECT AND CONTEMPORANEOUSLY WITH ITS ISSUE. CUBARRI & PETERSON ARCHITECTS, P.A. ASSUMES NO RESPONSIBILITY FOR ITS USE ON ANY DIFFERENT PROJECT SITE OR AT A LATER TIME WITHOUT ITS EXPRESS WRITTEN CONSENT. RESTRICTED USE EXHIBITS (ON AND OFF PREMISES) ARE NOT TO BE USED FOR CONSTRUCTION PURPOSES. REPRODUCTION OF THIS DRAWING, IN WHOLE OR IN PART, FOR ANY PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

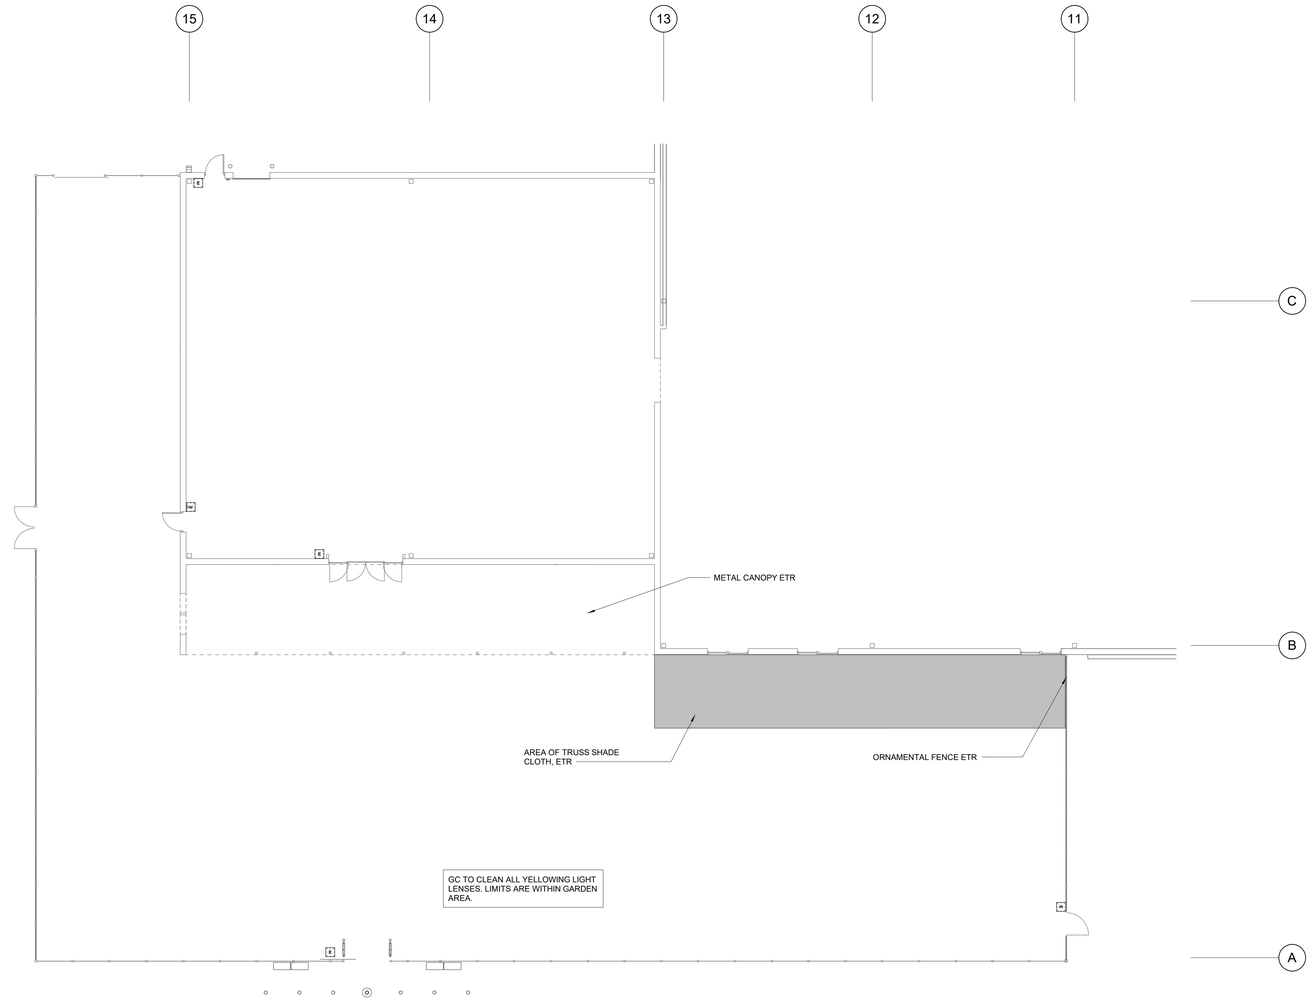
CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | LS |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
REGISTERED ARCHITECT
AR1004424
12/20/21

GARDEN CENTER PLAN AND DETAILS

SHEET: GC1


12/20/2021 4:14:09 PM
C:\Users\jmills.bg\Documents\Documents\WIP\3_Lake City_FL_168_L_ARCH_V26_jmills.bg.rvt

**800 MONEY CENTER**

**WALLS**
- REFER TO 2, 3, 4 AND 5-MC1 FOR FINISH DETAILS.
- GC TO REPLACE ALL PAINTED WAINSCOT.
- PATCH / REPAIR DAMAGED WALLS.

**FLOOR**
- REF FLOOR FINISH PLAN.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

## SHEET NOTES

1. ALL SIGNAGE DISPLAYS AND BROCHURE HOLDERS BY OTHERS. INTALLED BY THRID PARTY.
2. CONTRACTOR TO COORDINATE ANY DISRUPTION TO STORE WITH WALMART STORE MANAGER
3. CASHWRAP MILLWORK IS EQUIPPED WITH HANDICAP ACCESSIBLE WRITING SURFACE AT 34" AFF
4. NOT USED
5. COORDINATE FINAL LAYOUT WITH STORE SETUP MANAGER
6. ALL ITEMS SUPPLIED AND INSTALLED BY GENERAL CONTRACTOR (GC) UNLESS NOTED OTHERWISE




## 4 MONEY CENTER ELEVATION
3/8" = 1'-0"




## 3 MONEY CENTER ELEVATION
3/8" = 1'-0"

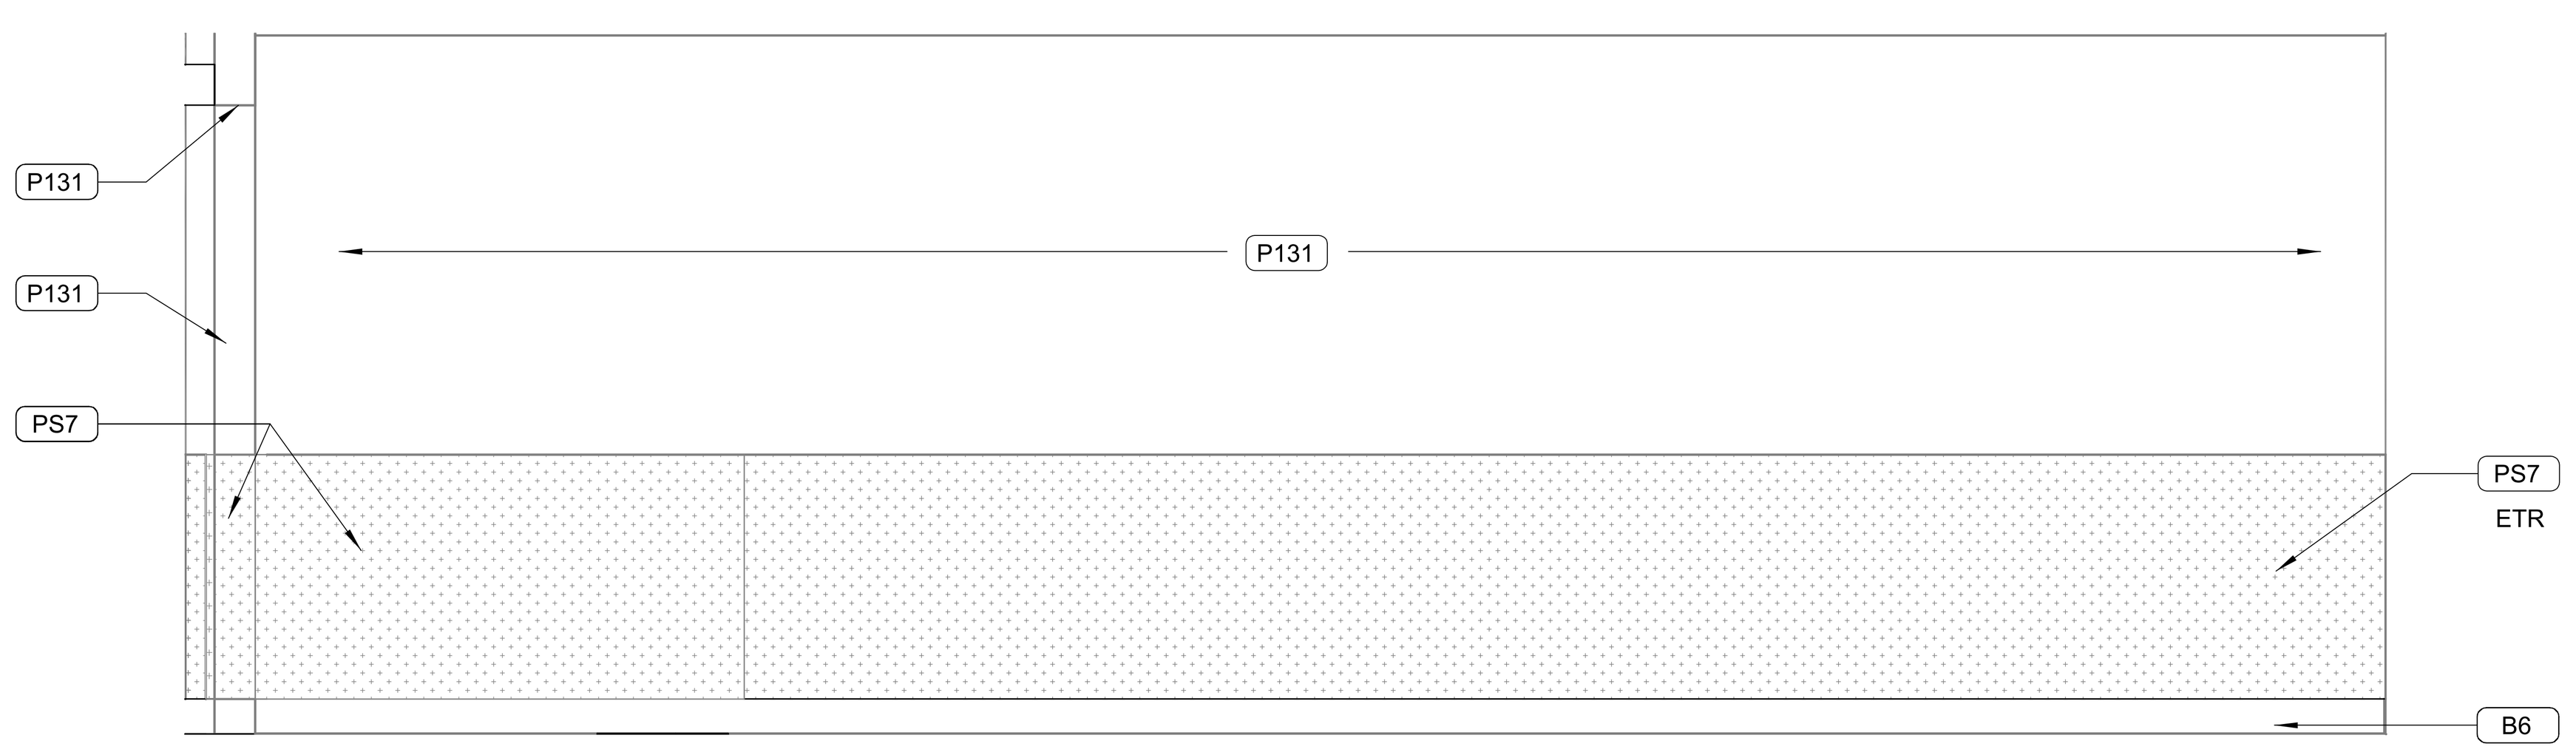


## 2 MONEY CENTER ELEVATION
3/8" = 1'-0"

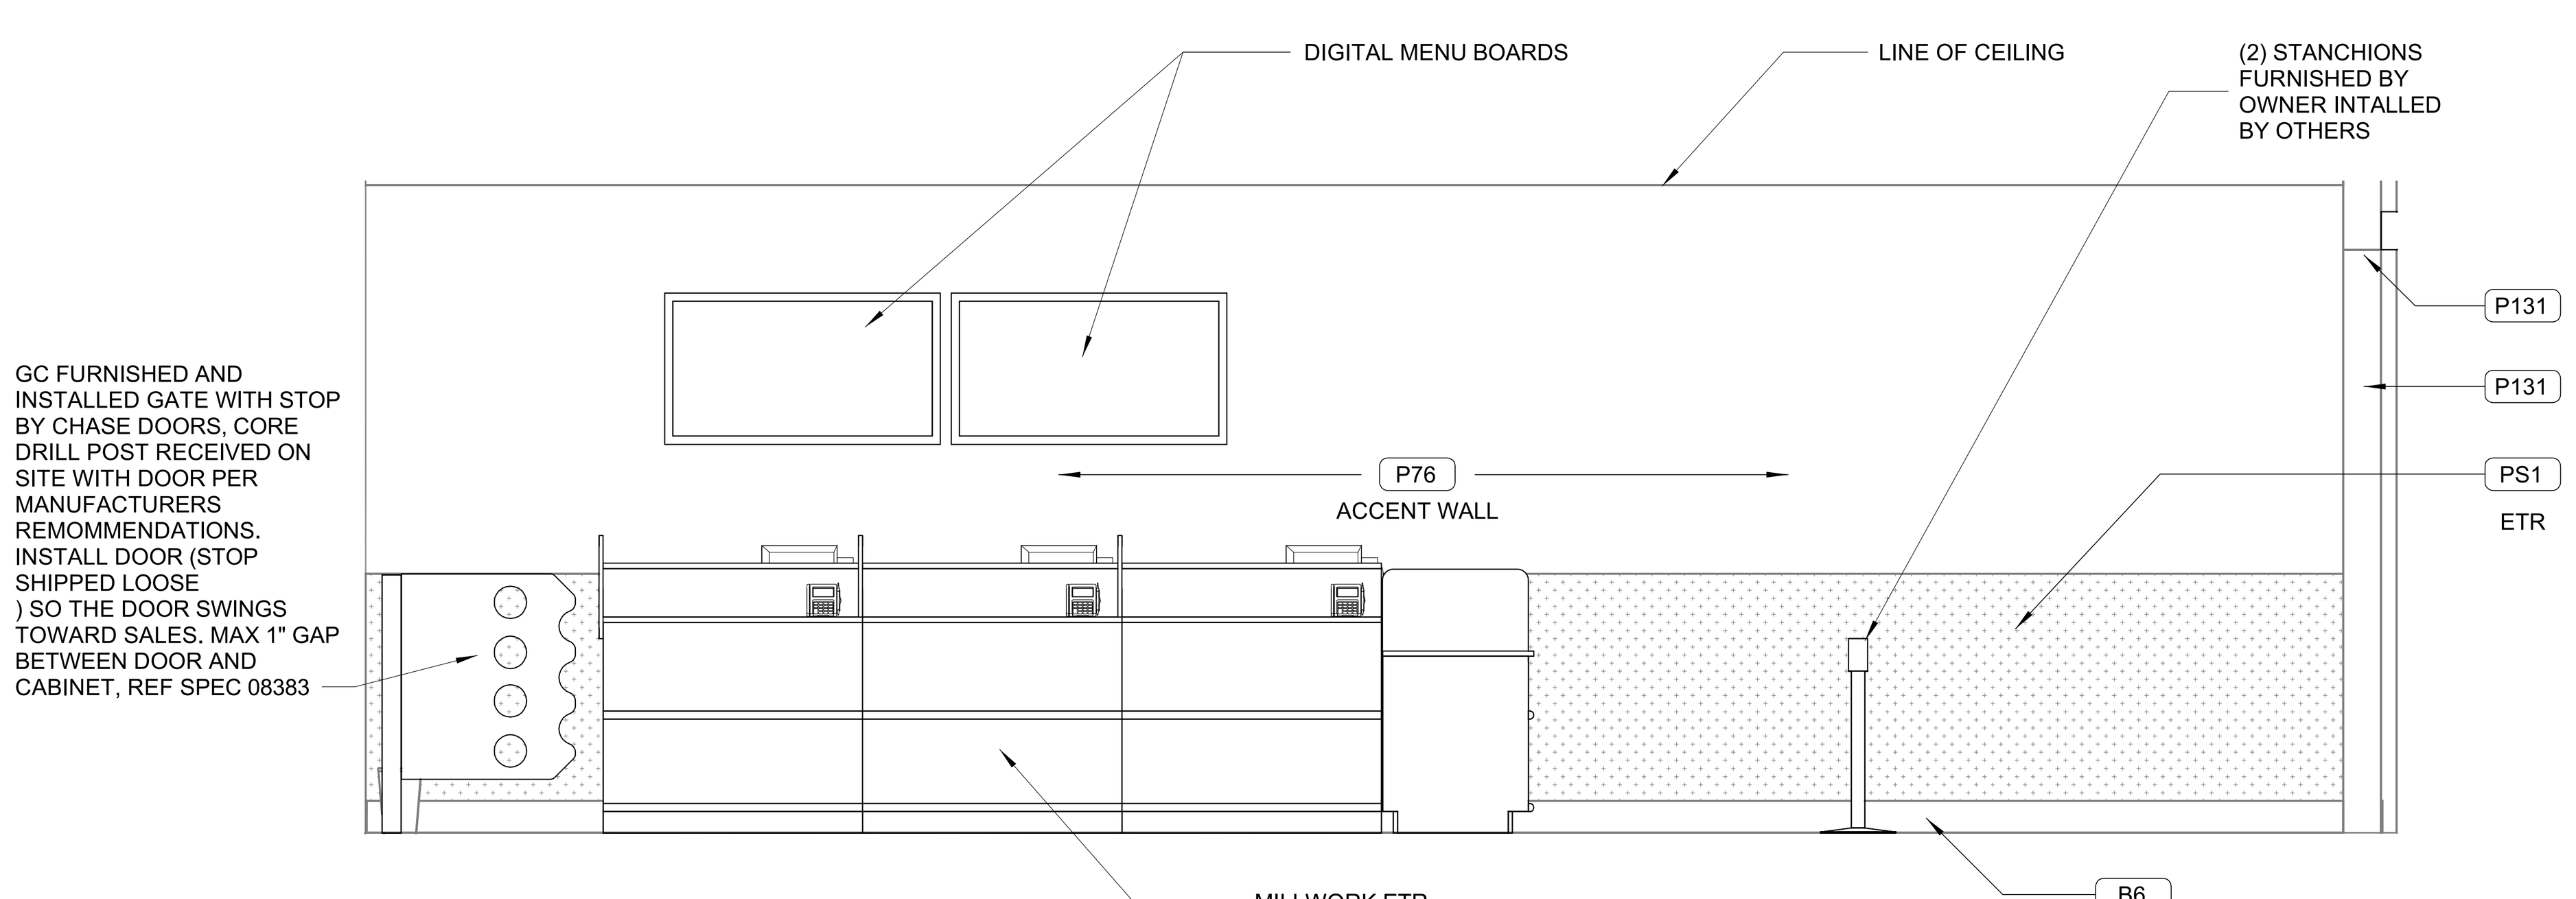


## 1 MONEY CENTER PLAN
1/2" = 1'-0"


Cuhaci & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com
Florida Corporate Certificate #AA C000526

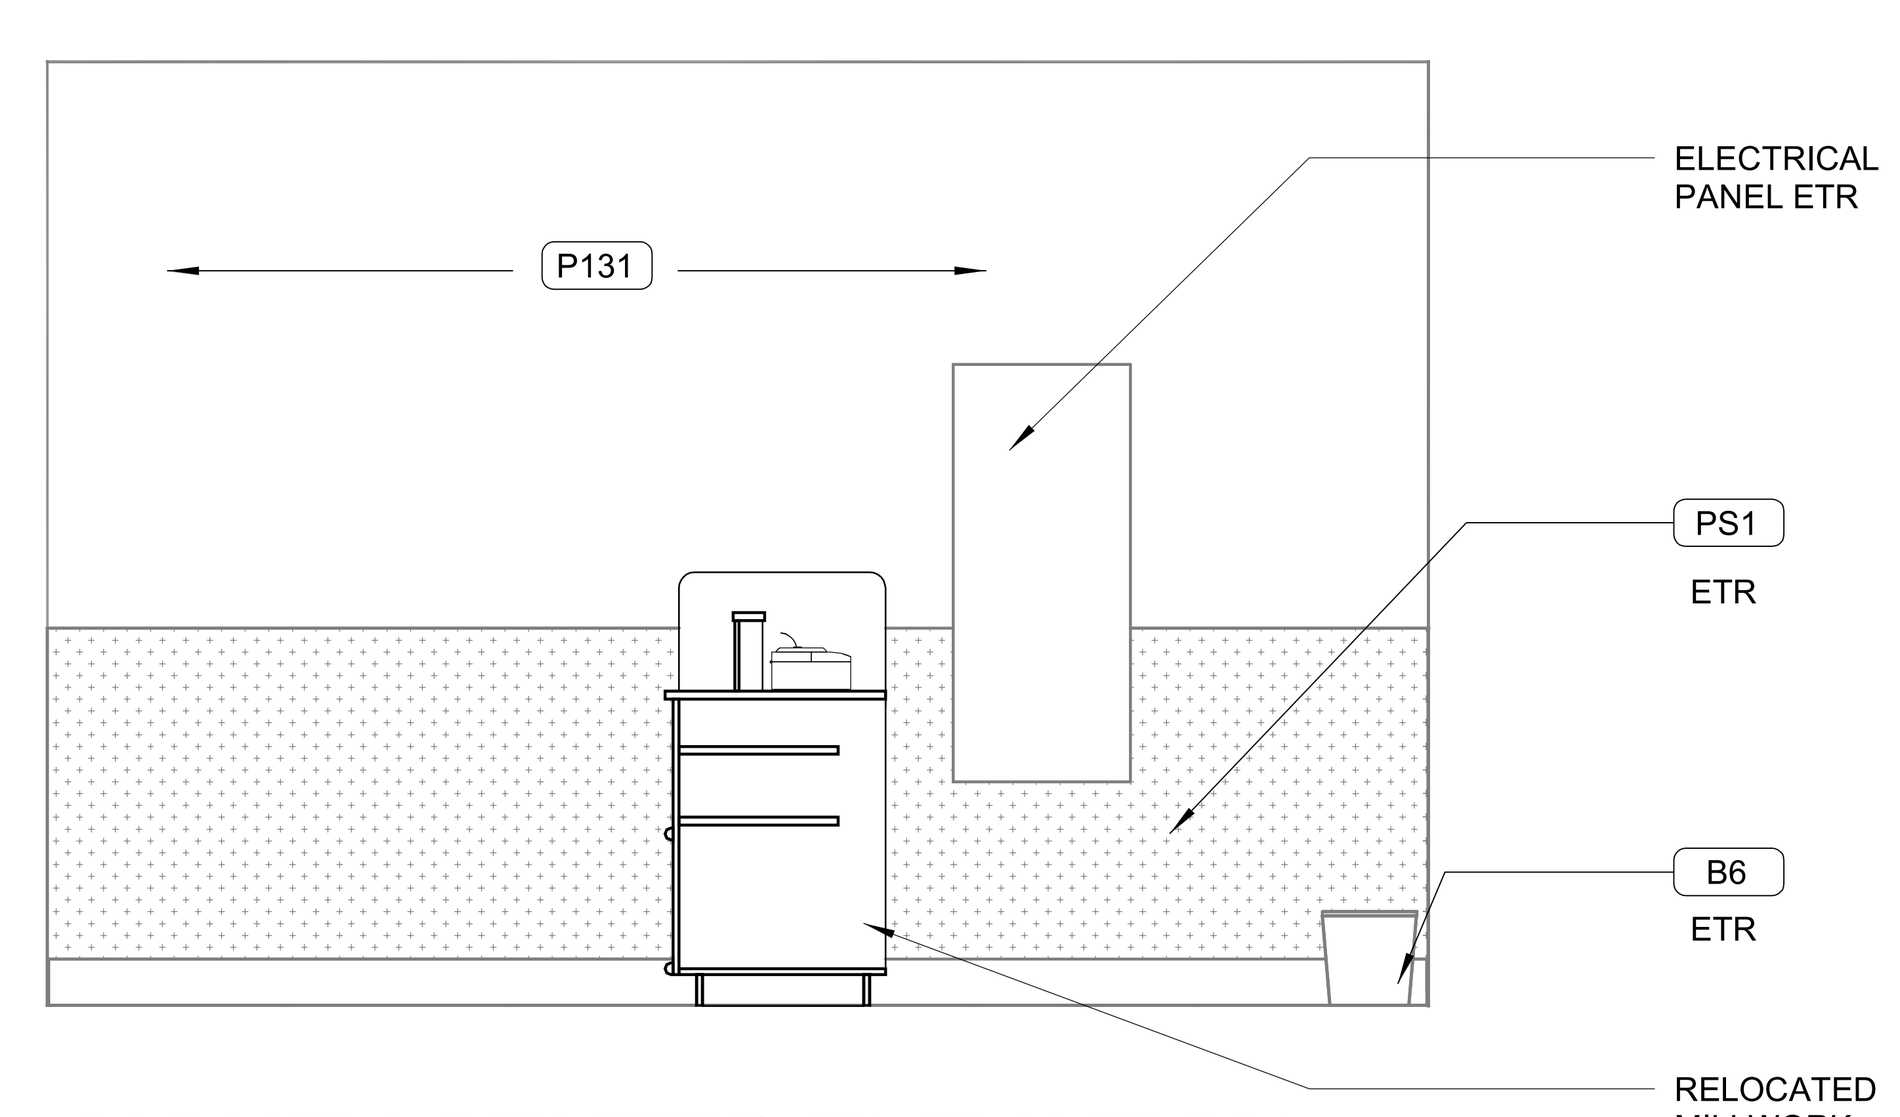

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

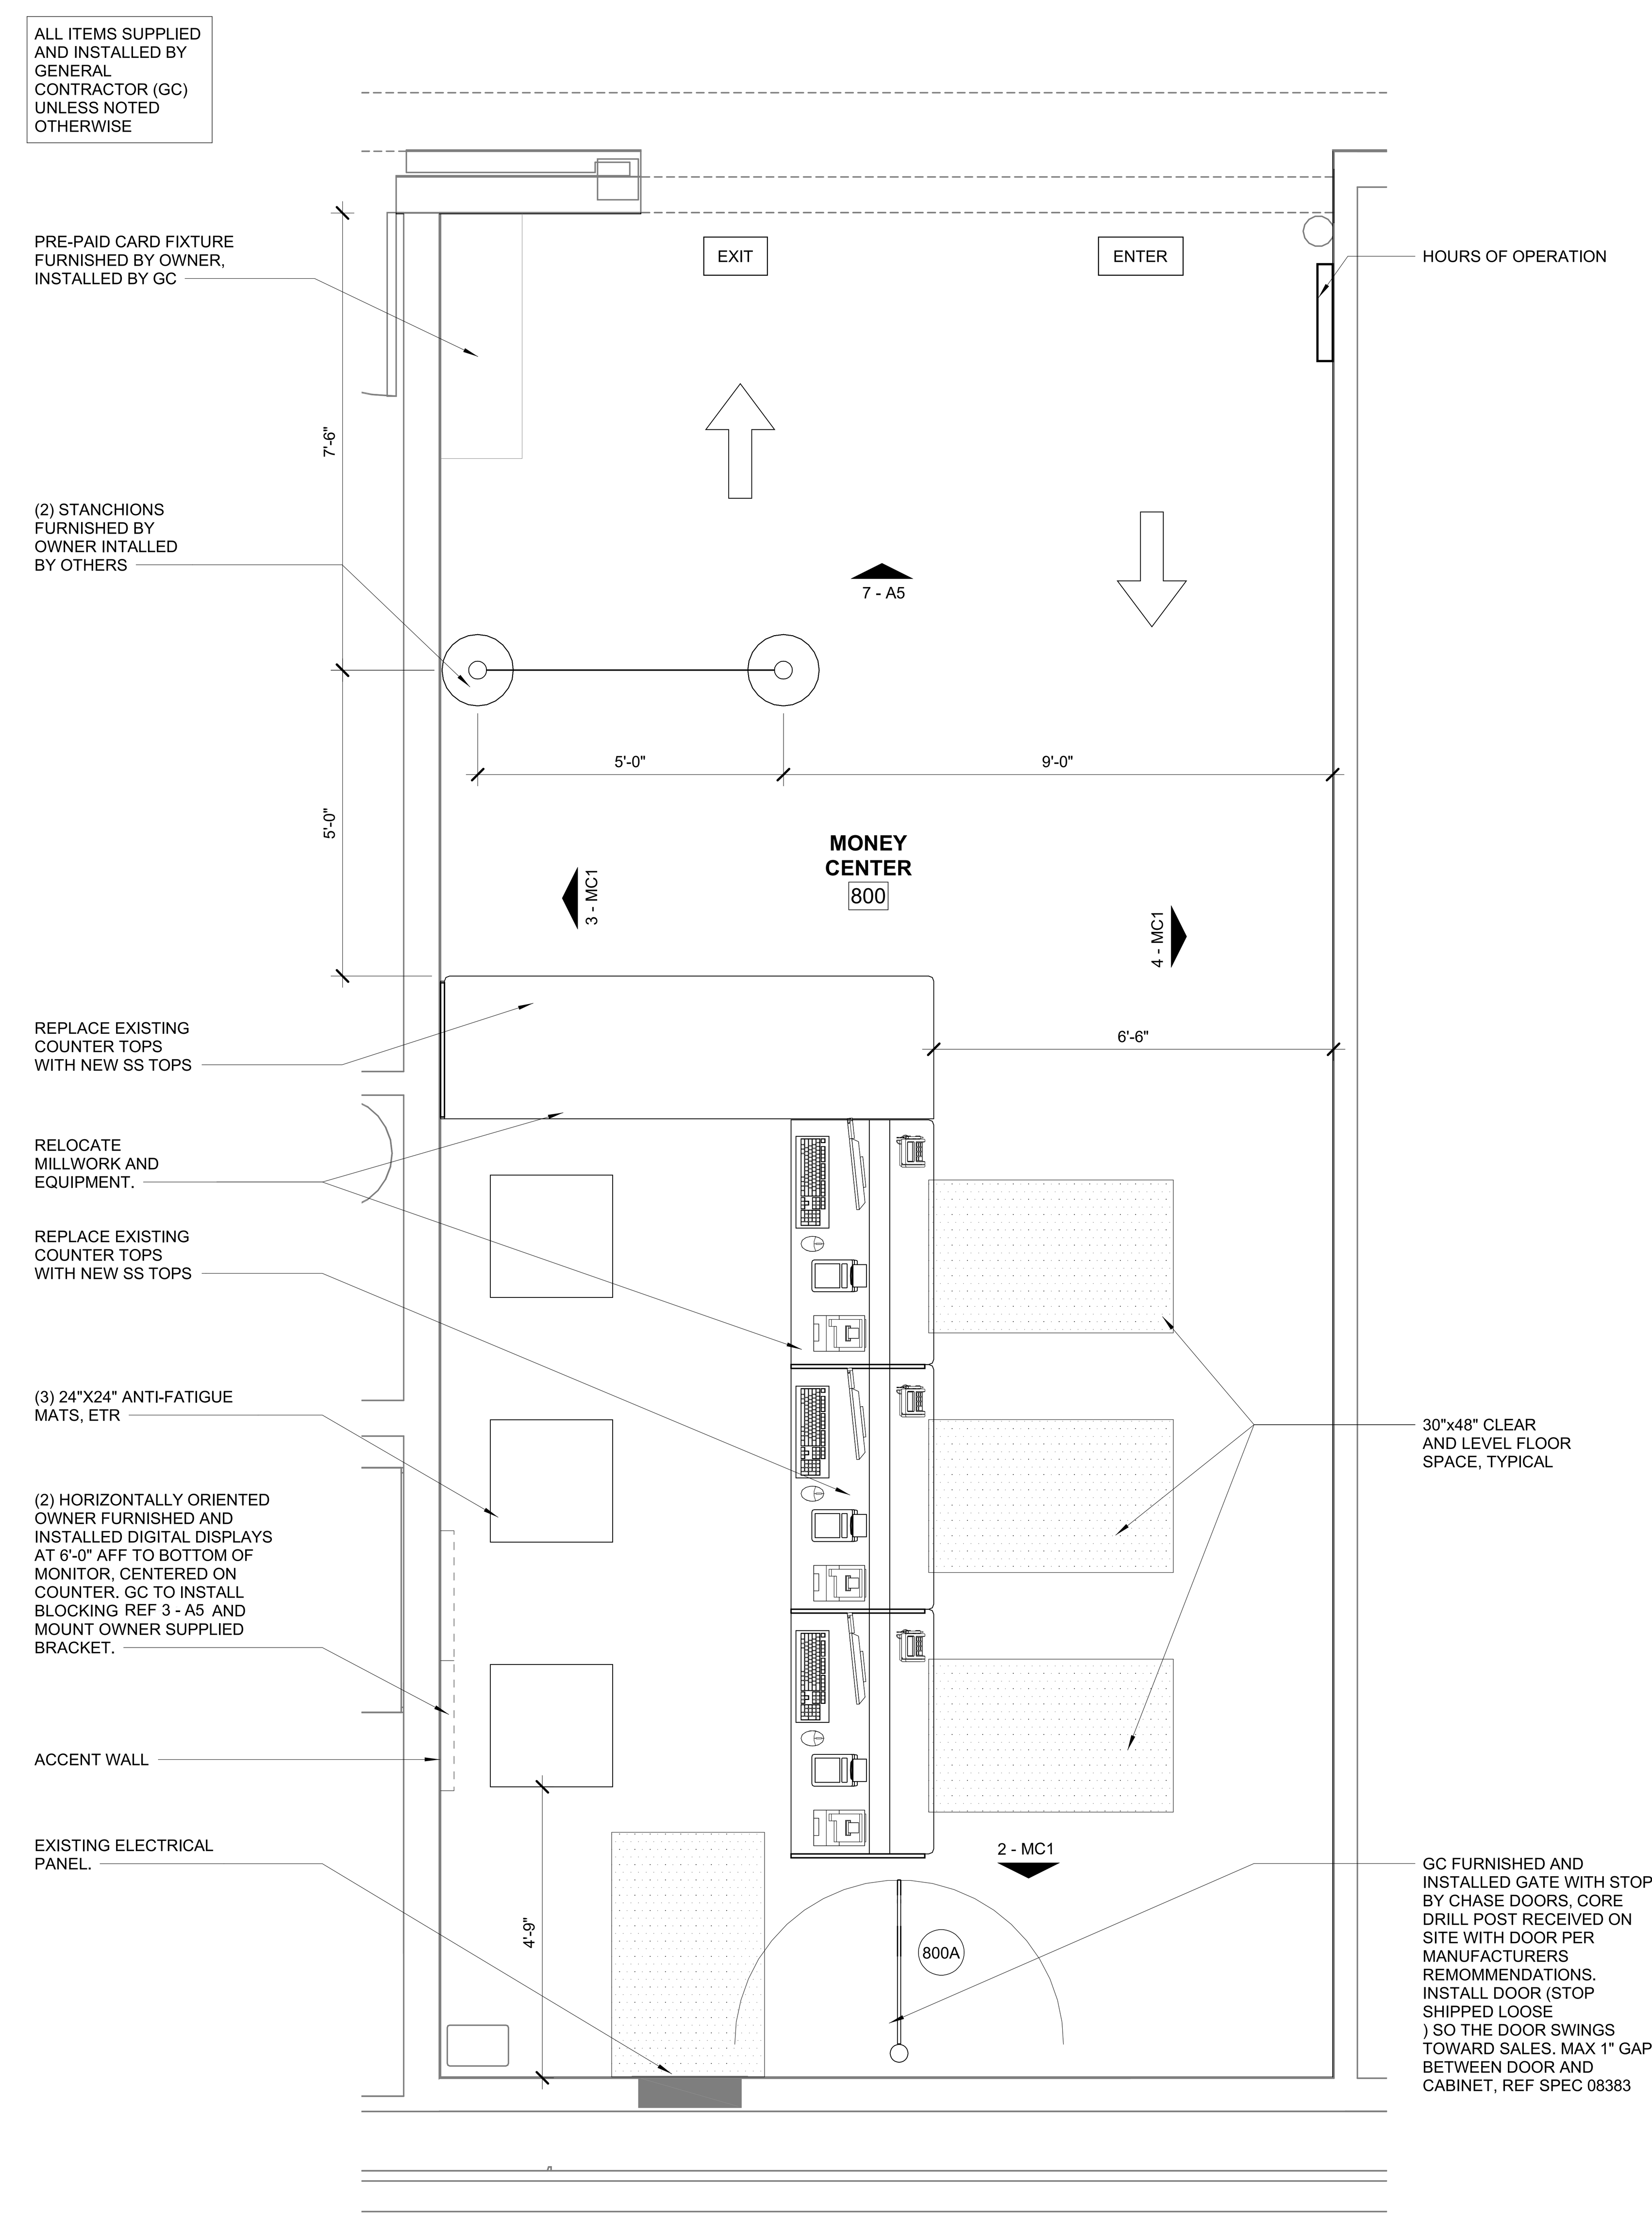
CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

| JOB NUMBER: | 2210335 | PROTO: | 188 PROTO SC |
|---|---|---|---|

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | YB |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
AR100424
REGISTERED ARCHITECT
Anthony D Murphy
12/20/21

MONEY CENTER FLOOR PLAN, DETAILS AND SCHEDULES

SHEET:
MC1


12/20/2021 4:15:08 PM
C:\Users\jeritsa.negronquiros\Documents\00767_LakeCity_FL_188_L_ARCH_V20_jeritsa.negronquiros.rvt




8 SECTION
1" = 1'-0"




7 COUNTER SECTION
1 1/2" = 1'-0"

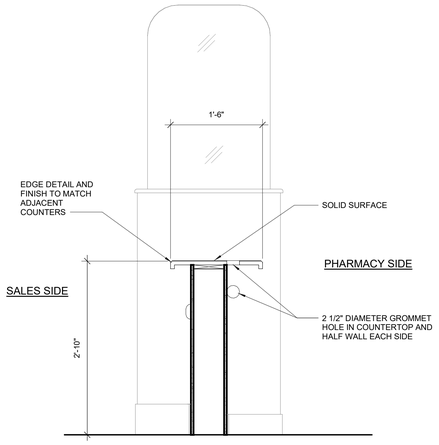


6 SINK CABINET SECTION
1 1/2" = 1'-0"

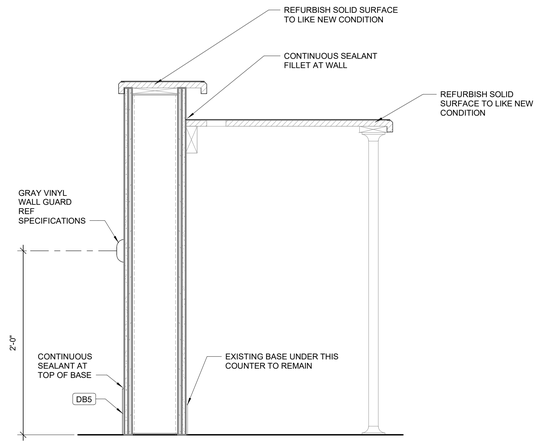


5 COUNTER SECTION
1 1/2" = 1'-0"

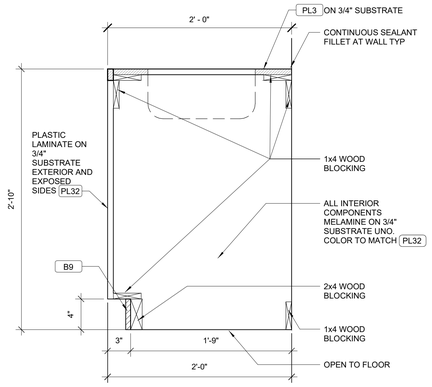


4 PHARMACY EXTERIOR ELEVATION
1/4" = 1'-0"

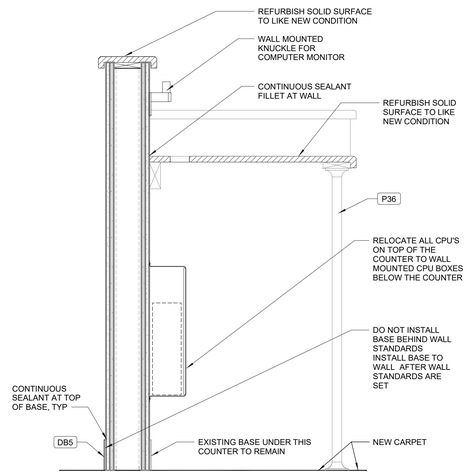


3 COUNTER SECTION
1 1/2" = 1'-0"




2 COUNTER SECTION
1 1/2" = 1'-0"




1 PHARMACY PLAN
1/4" = 1'-0"

**300 PHARMACY**

**WALLS**
- PAINT ALL WALLS P131 SEMIGLOSS
- INSTALL NEW PLASTIC BASE B6 ON ALL WALLS EXCEPT BEHIND PHARMACY RACKS.
- REPAIR DAMAGED WALLS BOTH INTERIOR AND EXTERIOR TYP.
- PAINT EXTERIOR WALLS AT PHARMACY P209 BELOW 14'-0" AND P162 ABOVE 14'-0"
- LAMINATE PS7 TO REMAIN
- INSTALL BASE DB5 ON THE CUSTOMER SIDE
- INSTALL NEW LEDGE, LAMINATED PS8 ON ALL SIDES

**FLOOR**
- REPLACE CUSHION BACK TILE CARPET C1 AND TRANSITION STRIP. REFERENCE FLOOR FINISH RESPONSIBILITY MATRIX

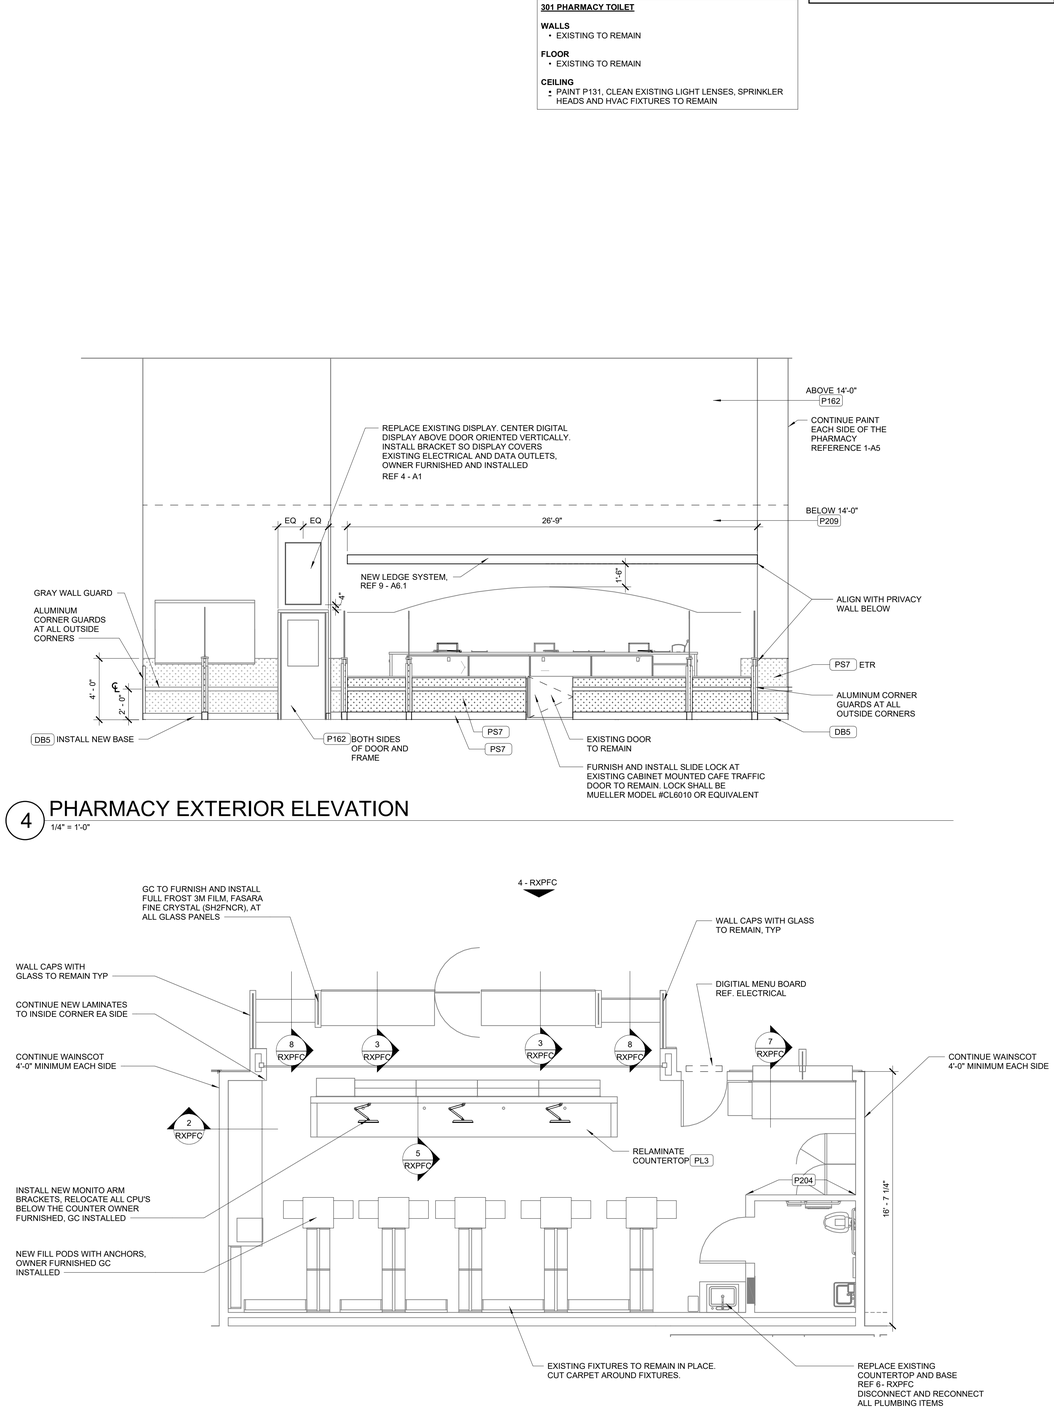**CEILING**
- REPLACE ALL CEILING TILE, CLEAN CEILING GRID TO REMAIN
- CLEAN EXISTING LIGHT LENSES, SECURITY GLOBES, SPRINKLER HEAD AND HVAC FIXTURES TO REMAIN.

**CASEWORK**
- REFURBISH ALL COUNTERTOPS TO LIKE NEW CONDITIONS, REF 1-RXPFC FOR LOCATIONS

**301 PHARMACY TOILET**

**WALLS**
- EXISTING TO REMAIN

**FLOOR**
- EXISTING TO REMAIN

**CEILING**
- PAINT P131, CLEAN EXISTING LIGHT LENSES, SPRINKLER HEADS AND HVAC FIXTURES TO REMAIN

## PFC NOTES

1. WORK SHALL BE ACCOMPLISHED IN A MANNER THAT WILL NOT AFFECT CURRENT PHARMACY OPERATIONS.
2. ALL NECESSARY PRECAUTIONS SHALL BE TAKEN TO PROTECT PHARMACY EQUIPMENT DURING REPAIR WORK.
3. GENERAL CONTRACTORS SHALL LEAVE PHARMACY IN A CLEAN AND OPERATIONAL MANNER AT THE END OF EACH WORK SESSION
4. CUT CARPET AROUND FIXTURES AND SAFE.
5. REPLACE ALL GROMMET HOLES TO MATCH EXISTING LOCATIONS AND SIZES IN COUNTERS TO RECEIVE NEW WORK.
6. NEW PAINT COLOR AND NEW LAMINATE TRANSITIONS ARE TO REMAIN WHERE EXISTING TRANSITIONS OCCUR.
7. PAINT ALL EXISTING COUNTERTOP POST P36.
8. PAINT BOTH SIDES OF EXISTING DOORS AND FRAMES P162, TYP. ALL DOORS.


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-2661
www.cpaarchitects.com
Cubarr & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC PROJECT AND IS NOT A CONTEMPORANEOUSLY WITH ITS ISSUE. DATE AND SHALL NOT BE USED BY ANY PERSON ON ANY OTHER PROJECT. SITE OR AT A LATER DATE WITHOUT THE EXPRESS WRITTEN PERMISSION OF THE ARCHITECT AND ENGINEER. REPRODUCTION OF THIS DRAWING IS STRICTLY PROHIBITED. ANY USE OF THIS PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 221033S | PROTO | 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | SPA |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
LICENSE NUMBER
AR100424
REGISTERED ARCHITECT
12/20/21

PAINT, FIX, CLEAN (PFC) PLAN AND DETAILS

SHEET:
RXPFC


12/20/2021 4:15:19 PM
C:\Users\jpinkard.cpa\Documents\Documents\WIP_LakeCity_FL_168_LARCH_V2B_jpinkard.cpa@cpaarchitects.rvt

## REFRIGERATED CASE LEGEND

| WDS NUMBER | QTY. | CASE LENGTH/ DOOR NO. | DESCRIPTION | MFR OR SUPPLIER | MODEL NO. | NOTES |
|---|---|---|---|---|---|---|
| RD1069.652 | 2 | 8FT | UNITIZED SELF-SERVICE ISLAND CENTER | HILL PHOENIX INC | QC-R-35-IC | 5 |
| RD1069.652 | 4 | 12FT | UNITIZED SELF-SERVICE ISLAND CENTER | HILL PHOENIX INC | QC-R-35-IC | 5 |

ALL WEDGES TO BE GC. PROVIDED AND INSTALLED

GENERAL WEDGE NOTES:
A. GC FURNISHED AND INSTALLED..
B. SIDE SCRIBE PIECES PROVIDED WITH WEDGE. FIELD CUT TO FIT.
C. WEDGE TOP PIECE PROVIDED WITH WEDGE. FIELD CUT TO FIT.

GROCERY DRY WEDGE KIT CONTACT:
QUALSERV
(479) 646-8386 x-310 ATTN: DION CHAMBERS

## EQUIPMENT NOTES

1. REFERENCE SHEET A1 FOR EQUIPMENT LOCATION
5. FINISHES FOR OWNER SUPPLIED EQUIPMENT ARE SPECIFIED PER BID ALIGNMENT BETWEEN OWNER AND OEM
10. EQUIPMENT INSTALLED BY EQUIPMENT SUPPLIER
11. RETROFIT DOORS/LIDS PROVIDED BY OWNER AND INSTALLED BY EQUIPMENT SUPPLIER

## GENERAL EQUIPMENT NOTES

A. ALL EQUIPMENT IS SUPPLIED BY OWNER, INSTALLED BY THE GENERAL CONTRACTOR. GENERAL CONTRACTOR TO MAKE FINAL UTILITY CONNECTIONS, UNLESS OTHERWISE NOTED
B. REFERENCE SPECIFICATIONS FOR REFRIGERATED AND HOT DISPLAY CASES FOR SUPPLIED BY, INSTALLED BY, AND FINAL CONNECT BY
C. REFERENCE SPEC APPENDIX A FOR MANUFACTURER AND MODEL NUMBERS NOT LISTED IN EQUIPMENT LEGENDS
D. OWNER TO SUPPLY SS FIXTURES BY WIN-HOLT

## KEYNOTES

| | |
|---|---|
| **1.52** | REFRIGERATED CASE CORNER PROTECTION |

**900 GR SALES**

**WALLS**
- GYP BD: REF 1-GA1 FOR PAINT. INSTALL PS7 WAINSCOT AND DB5 BASWE UNO. EXTEND WAINSCOT AND BASE AT EXPOSED WALL TO NEAREST MERCHANDISE RACK.
- CMU: REF 1-GA1 FOR PAINT. WHERE BASE IS EXISTING, IT IS ETR

**FLOOR**
- EC: ETR SPOT REPLACE DAMAGED FLOORING. REF SHEET SA1 FOR BID ALLOWANCE

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE

**912 MEAT PREP, 905 BAKERY UTILITY, 908 MEAT HOLDING**

**WALLS**
- ETR

**FLOOR**
- ETR

**FLOOR**
- REF SHEET SA1 FOR CEILING SCHEDULE

**902 DELI PREP, 909 PRODUCE PREP, 910 DRY PRODUCE PREP**

**WALLS**
- ETR

**FLOOR**
- EC,ETR.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE

**906 BAKERY**

**WALLS**
- INSTALL FAUX TILE PANELS, REF FINISH FLOOR PLAN FOR EXTENTS.
- FRP & TILE. SPOT REPLACE DAMAGED WALL FINISHES.
- REF SHEET SA1 FOR BID ALLOWANCE
- BASE:ETR. SPOT REPLACE DAMAGED WALL BASE. REF SHEET SA1 FOR BID ALLOWANCE.

**FLOOR**
- ETR

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE

## SHEET NOTES

1. STUD WALL DIMENSIONS ARE TO THE FACE OF THE STUDS.
2. ROUTE ALL UTILITY SERVICE LINES (PIPES AND CONDUIT) WITHIN STUD WALLS WHEREVER POSSIBLE. ON COOLER/FREEZER PANELS IN FOOD PREP AREAS WHERE UTILITIES MUST BE EXPOSED, CONTRACTOR TO HAVE THE OPTION OF THE FOLLOWING:
   a. SURFACE MOUNT UTILITIES WITH NON-CORROSIVE ANCHORS; SEAL BOTH SIDES OF PIPE/CONDUIT TO PANEL CONTINUOUSLY WITH SEALANT.
   b. INSTALL UTILITIES 1/2" OFF FACE OF PANEL TO ALLOW FOR CLEANING; USE ONLY NON-CORROSIVE MATERIALS FOR SPACERS AND ANCHORS.
   c. COVER UTILITIES WITH 20 GAUGE STAINLESS STEEL BENT PLATES MOUNTED TO WALL WITH NON-CORROSIVE ANCHORS; APPLY CONTINUOUS SEALANT ALONG EDGES AND JOINTS.
3. PROVIDE CONT USDA APPROVED SEALANT AT ALL JOINTS BETWEEN MATERIALS ON WALLS AND FLOORS IN FOOD PREPARATION COOLER AND FREEZER AREAS.
4. WALLS AND INFILL OF EXISTING OPENINGS ARE TO MATCH THE CONSTRUCTION AND FINISHES OF ADJACENT EXISTING WALLS.
5. PROPER INSTALLATION OF JOINT SEALANTS IS CRITICAL TO MEETING WALMART QUALITY ASSURANCE STANDARDS. PROVIDE SEALANTS IN ACCORDANCE WITH DRAWINGS AND SPECIFICATIONS. REFERENCE SECTION 07900 FOR SEALANT SCHEDULE
6. ALL JOINTS BETWEEN DISSIMILAR MATERIALS SHALL BE SEALED AS REQUIRED FOR A COMPLETE AND PROPER INSTALLATION, REGARDLESS OF WHETHER SHOWN ON THE DRAWINGS OR INDICATED IN THE SPECIFICATIONS. SUCH JOINTS NOT SHOWN OR SCHEDULED SHALL BE SEALED WITH SEALANTS AS RECOMMENDED BY THE MANUFACTURER FOR THE SPECIFIC APPLICATION.
7. INTERIOR SEALANTS USED IN FOOD PREPARATION AREAS SHALL MEET THE REQUIREMENTS FOR USE IN USDA REGULATED FACILITIES
8. PROVIDE STEEL CLOSURE PANELS AT ALL VERTICAL GAPS AND HORIZONTAL GAPS 52" OR LOWER BETWEEN REFRIGERATED CASES, WALLS AND/OR EQUIPMENT. REF 7 - GA3
9. COORDINATE REMOVAL AND DISPOSAL OF EXISTING REFRIGERATED CASES AND FIXTURES WITH MECHANICAL SERVICES CONSTRUCTION MANAGER. COORDINATE REMOVAL AND DISPOSAL OF EXISTING REFRIGERATED CASES AND FIXTURES WITH INSTALLATION OF NEW REFRIGERATED CASES AND FIXTURES EXISTING REACH-IN FROZEN CASES TO BE RELOCATED OR REMOVED SHALL BE USED ON A TEMPORARY BASIS DURING CONSTRUCTION OF NON-SERVICE SEAFOOD AREA. TEMPORARY CASES SHALL BE REMOVED ONCE THE NEW CASES ARE DELIVERED AND OPERATIONAL.
10. DIMENSIONS OF REFRIGERATED CASES ARE TO THE OUTERMOST POINTS OF THE CASES; ENDCAPS AND BUMPERS ARE CONSIDERED PART OF THE CASE, WHERE THEY OCCUR. DIMENSIONS ON THE FIXTURE PLANS ARE FOR LAYOUT AND OWNER-FURNISHED ITEMS ONLY AND ARE NOT TO BE USED FOR LOCATION OF WALLS AND OTHER CONTRACTOR-BUILT ITEMS
11. ALL FIXED (NON-MOVEABLE) EQUIPMENT INCLUDING SINKS, OVENS, AND REFRIGERATED EQUIPMENT SHALL BE SEALED TO THE WALLS. BASE OR LEGS SHALL BE SET IN A BED OF SEALANT WITH EXCESS REMOVED. MOVEABLE EQUIPMENT SHALL NOT BE SEALED.
12. NOT USED.
13. COOLER PANEL MANUFACTURERS TO FURNISH AND INSTALL LINERS, DOORS, PANELS, DOOR HARDWARE, STRIP CURTAINS, BATTEN STRIPS, MATERIALS, ETC. (WHERE INDICATED ON DRAWINGS)
14. RE-SKINNING OF EXISTING CASES TO REMAIN UNDER SEPARATE CONTRACT
15. REFER TO SHEET GA3 FOR SANITARY COVE BASE DETAILS
16. REPLACE SOAP DISPENSERS AND PAPER TOWEL DISPENSERS IN ALL GROCERY SERVICE AND PREP AREAS. REF .5 - GA3 , REF SPEC.
17. VERIFY EXACT LOCATION OF CASES WITH WALMART AND CM PRIOR TO STARTING CONSTRUCTION.




1 FRONT GROCERY PLAN
1/8" = 1'-0"


2600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-1500
F (407) 645-1501
www.cpaarchitects.com
Cabaniss & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THE SPECIFIC PROJECT SHOWN AND CONTEMPORANEOUSLY WITH ITS ISSUE. DATE. ANY REUSE OF THESE PLANS AS A DIFFERENT PROJECT SITE OR AT A LATER DATE WITHOUT THE EXPRESS WRITTEN PERMISSION OF THE ARCHITECT IS PROHIBITED. ALL COPYRIGHTS AND OTHER PROPERTY RIGHTS ARE RESERVED BY THE ARCHITECT AND ENGINEER. SUBMISSION OR DISTRIBUTION OF THIS PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

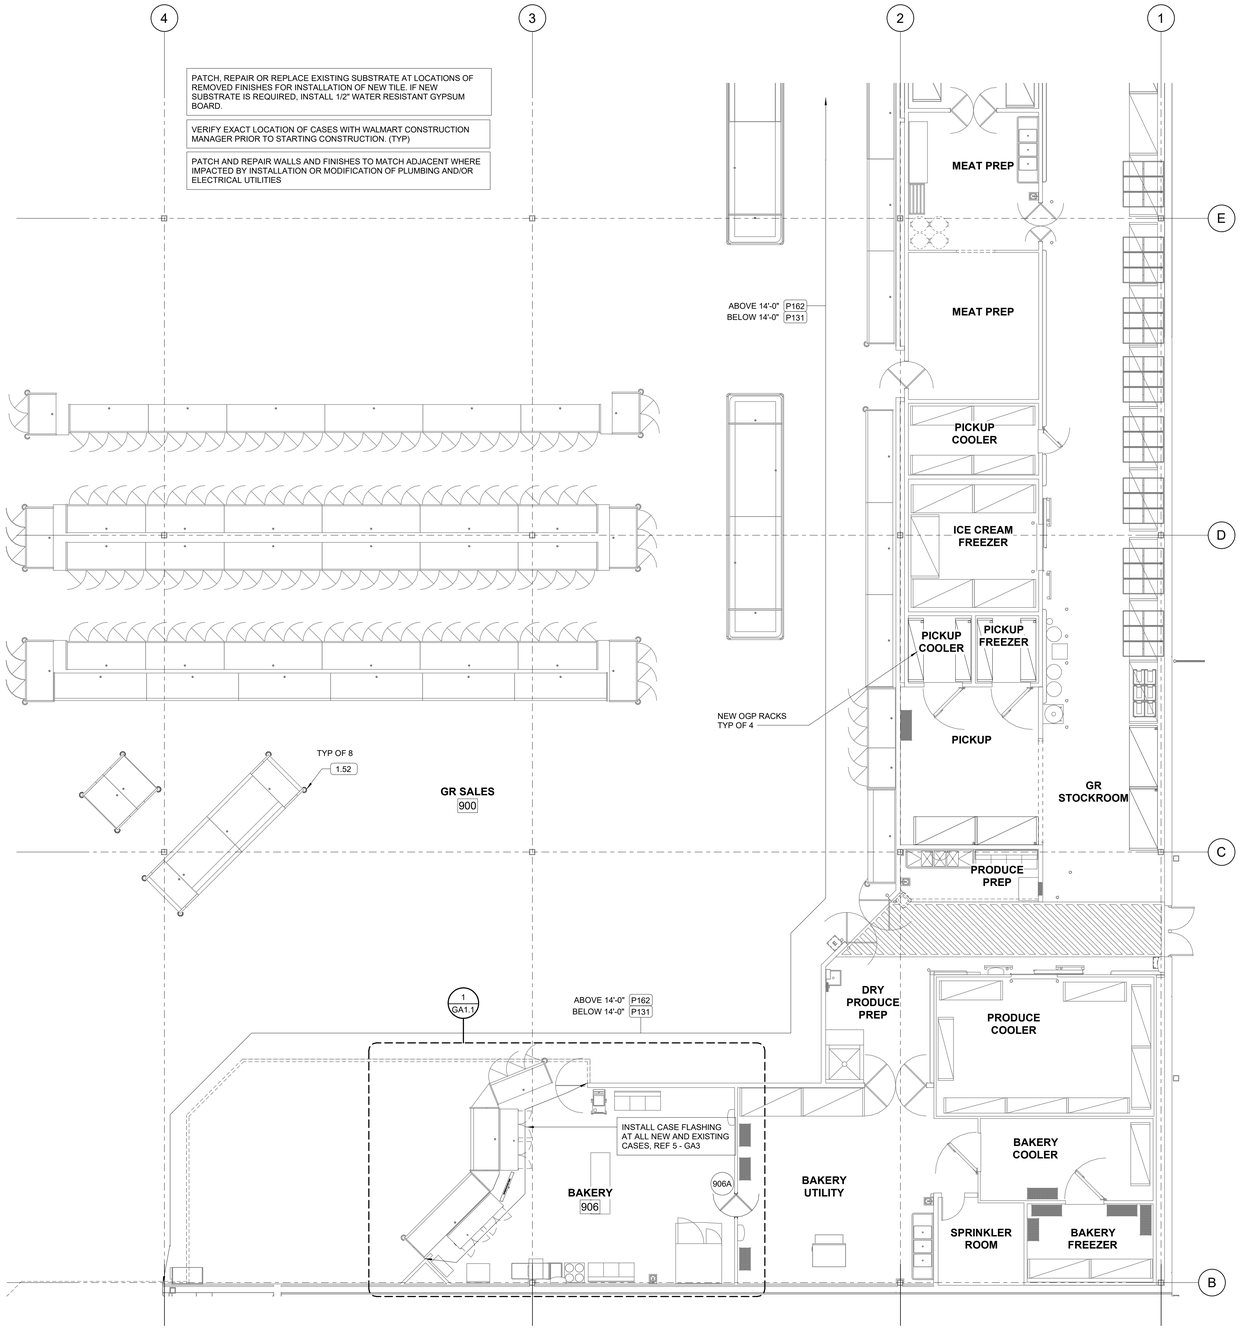
CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
JOB NUMBER: 221033S | PROTO | 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | JZ |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
REGISTERED ARCHITECT
Anthony D Murphy
AR100424
12/20/21

FRONT GROCERY PLAN

SHEET: GA1


12/20/2021 4:15:25 PM
C:\Users\jzirbel.cabaniss\Documents\0767D_LakeCity_FL_168_ILA_ARCH_V26_jzirbel.cabaniss@cpaarch.rvt

## LEGEND

- (E) STAINLESS STEEL CORNER TRIM FULL HEIGHT UNLESS NOTED OTHERWISE
- (G) STAINLESS STEEL CORNER TRIM FULL HEIGHT UNLESS NOTED OTHERWISE
- (H) STAINLESS STEEL EDGE TRIM FULL HEIGHT UNLESS NOTED OTHERWISE
- (J) STAINLESS STEEL INSIDE CORNER TRIM FULL HEIGHT UNLESS NOTED OTHERWISE

NOTES:

1. REF 6 - GA1.1 FOR CORNER GUARD AND TRIM DETAILS
2. INSTALL FAUX TILE PANELS (FT1) AT EXTENTS OF EXISTING TILE/FRP/NRP IN CUSTOMER VISIBLE ARES.




## 6 CORNER GUARD AND TRIM
6" = 1'-0"




## 5 FAUX TILE ENLARGED SECTION
3" = 1'-0"

| STAINLESS STEEL BACKSPLASH SIZE | | |
|---|---|---|
| PANEL | WIDTH | HEIGHT |
| A | 2'-6" | 2'-0" |

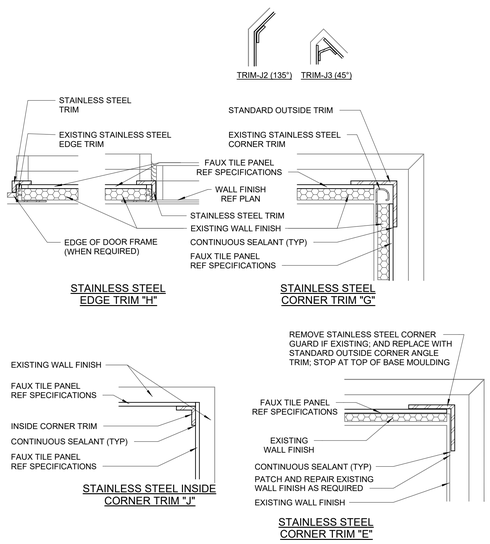NOTE:
1. FIELD MODIFY BACKSPLASH TRIM.

2. INSTALL SS PANEL(S) OVER TOP OF FAUX SUBWAY TILE WALL PANELS USING CONSTRUCTION ADHESIVE. REF SPECS.

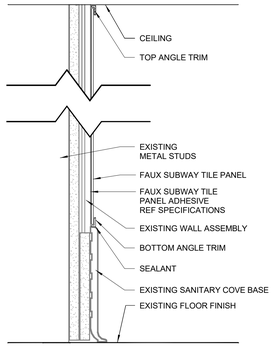2. VERIFY LOCATION OF EXISTING OUTLETS AND ENSURE SS PANELS ARE PLACED ADJACENT TO OUTLETS TO AVOID CUTTING SS PANELS IN THE FIELD

3. PROVIDE CONTINUOUS SEALANT AT ALL JOINTS AND PERIMETER OF SS PANELS.




## 4 BACKSPLASH AT DELI SLICER(S)
1/4" = 1'-0"




**ENLARGED PLAN VIEW A**




**ELEVATION**

## 3 ENLARGED FAUX TILE PANEL INSTALLATION DETAIL
3" = 1'-0"

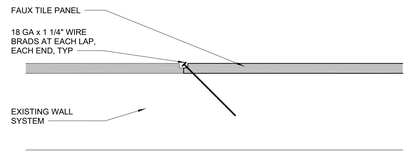


## 2 REAR GROCERY FINISH PLAN
1/4" = 1'-0"

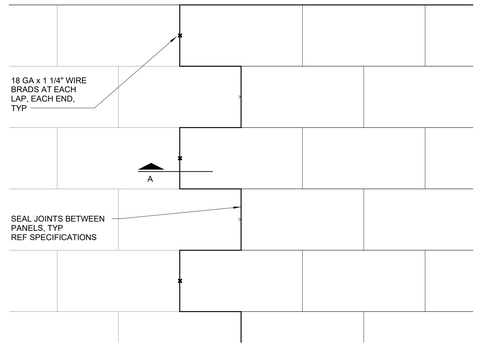


## 1 FRONT GROCERY FINISH PLAN
1/4" = 1'-0"


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cmpf.com
Cabaniss, Murphy, Fleischer & Peterson
Architects Engineers Planners

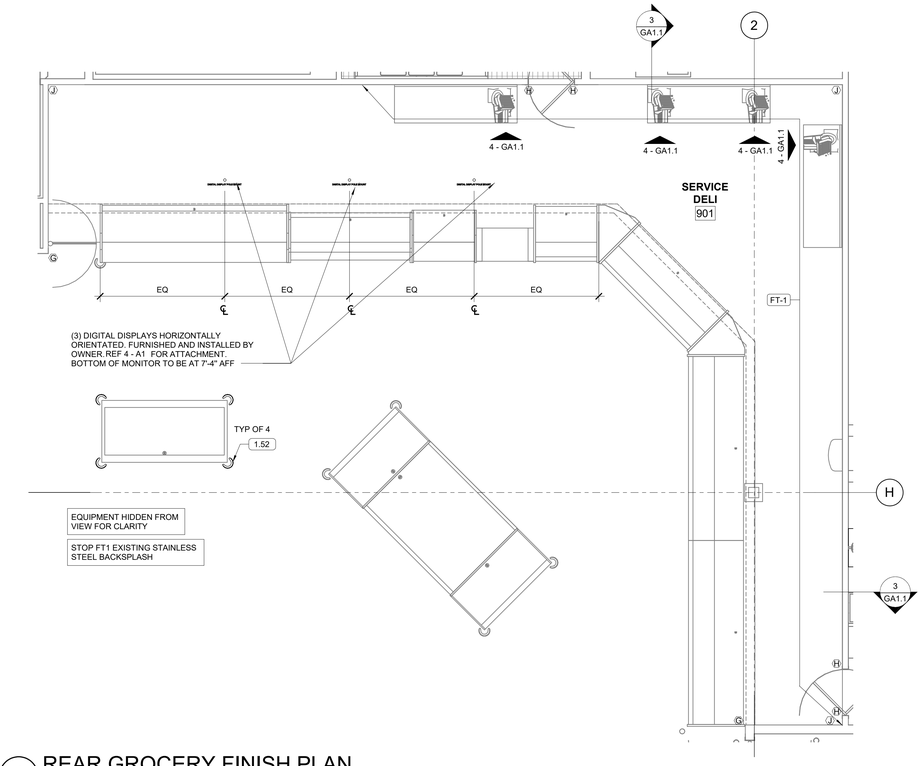
STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC PROJECT AT A SPECIFIC TIME AND IS NOT TO BE USED IN ANY CONTEMPORANEOUSLY WITH ITS ISSUE. CONTEMPORANEOUSLY WITH ITS ISSUE. CMPF ASSUMES NO RESPONSIBILITY FOR ANY SUBSEQUENT PROJECT SITE OR A PLACE DIFFERENT PROJECT SITE OR A PLACE DIFFERENT FROM THAT FOR WHICH IT WAS PREPARED. ALL RIGHTS RESERVED. COPYRIGHT © 2021 CMPF. RESTRICTED USE EXHIBITS CAN AND OTHER PROPRIETARY INFORMATION CONTAINED IN THIS DRAWING IS THE PROPERTY OF THE ENGINEER. REPRODUCTION OF THIS DRAWING IN WHOLE OR IN PART FOR ANY PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO STATE LAW.

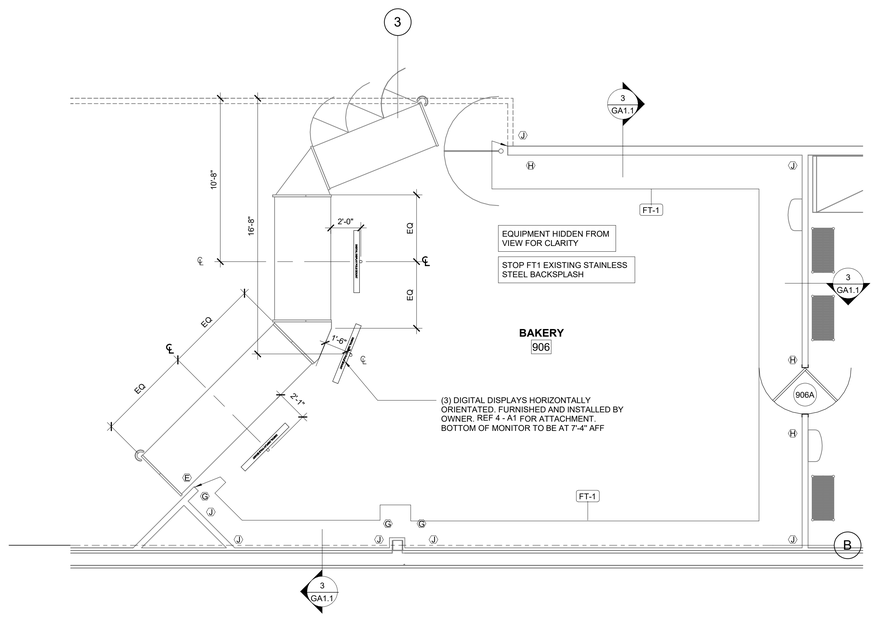
CONSULTANTS

Walmart :-)

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 221033S | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | JZ |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
REGISTERED ARCHITECT
AR100424
12/20/21

FRONT GROCERY FINISH PLAN

SHEET:
GA1.1


12/20/2021 4:15:39 PM
C:\Users\jzahler.cmpf\Documents\Documents\WIP_Lake City_FL_168_L_ARCH_V28_jzahler.rvt

**918 CORRIDOR**

**WALLS**
- ETR, UNO

**FLOOR**
- REF FLOOR FINISH PLAN

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE

**919 ALCOVE**

**WALLS**
- ETR

**FLOOR**
- EC; ETR

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**920 GR RECEIVING, 923 STOCKROOM**

**WALLS**
- ETR

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE.

**COMPACTOR**
- ETR

**901 SERVICE DELI**

**WALLS**
- INSTALL FAUX TILE PANELS, REF FINISH FLOOR PLAN FOR EXTENTS.
- FRP & TILE: SPOT REPLACE DAMAGED WALL FINISHES.
- REF SHEET SA1 FOR BID ALLOWANCE
- BASE:ETR. SPOT REPLACE DAMAGED WALL BASE. REF SHEET SA1 FOR BID ALLOWANCE.

**FLOOR**
- ETR. SPOT REPLACE DAMAGED FLOORING. REF SHEET SA1 FOR BID ALLOWANCE.

**CEILING**
- REF SHEET SA1 FOR CEILING SCHEDULE

## SHEET NOTES

1. REFER TO SHEET GA1 FOR GROCERY NOTES PERTAINING TO THIS SHEET.

## KEYNOTES

| | |
|---|---|
| **6.27** | 48" HIGH WAINSCOT WITH OUTSIDE CORNER TRIM |
| **9.90** | FLOOR STRIPES. REF N1 FOR STRIPING CONDITIONS. |
| **10.44** | PROVIDE TACTILE "EXIT" SIGN. REF N1. |

REFER SHEET GA1 FOR REFRIGERATED CASE SCHEDULE




1 REAR GROCERY PLAN
1/8" = 1'-0"


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5501
www.cpaarchitects.com

Cubaro & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE

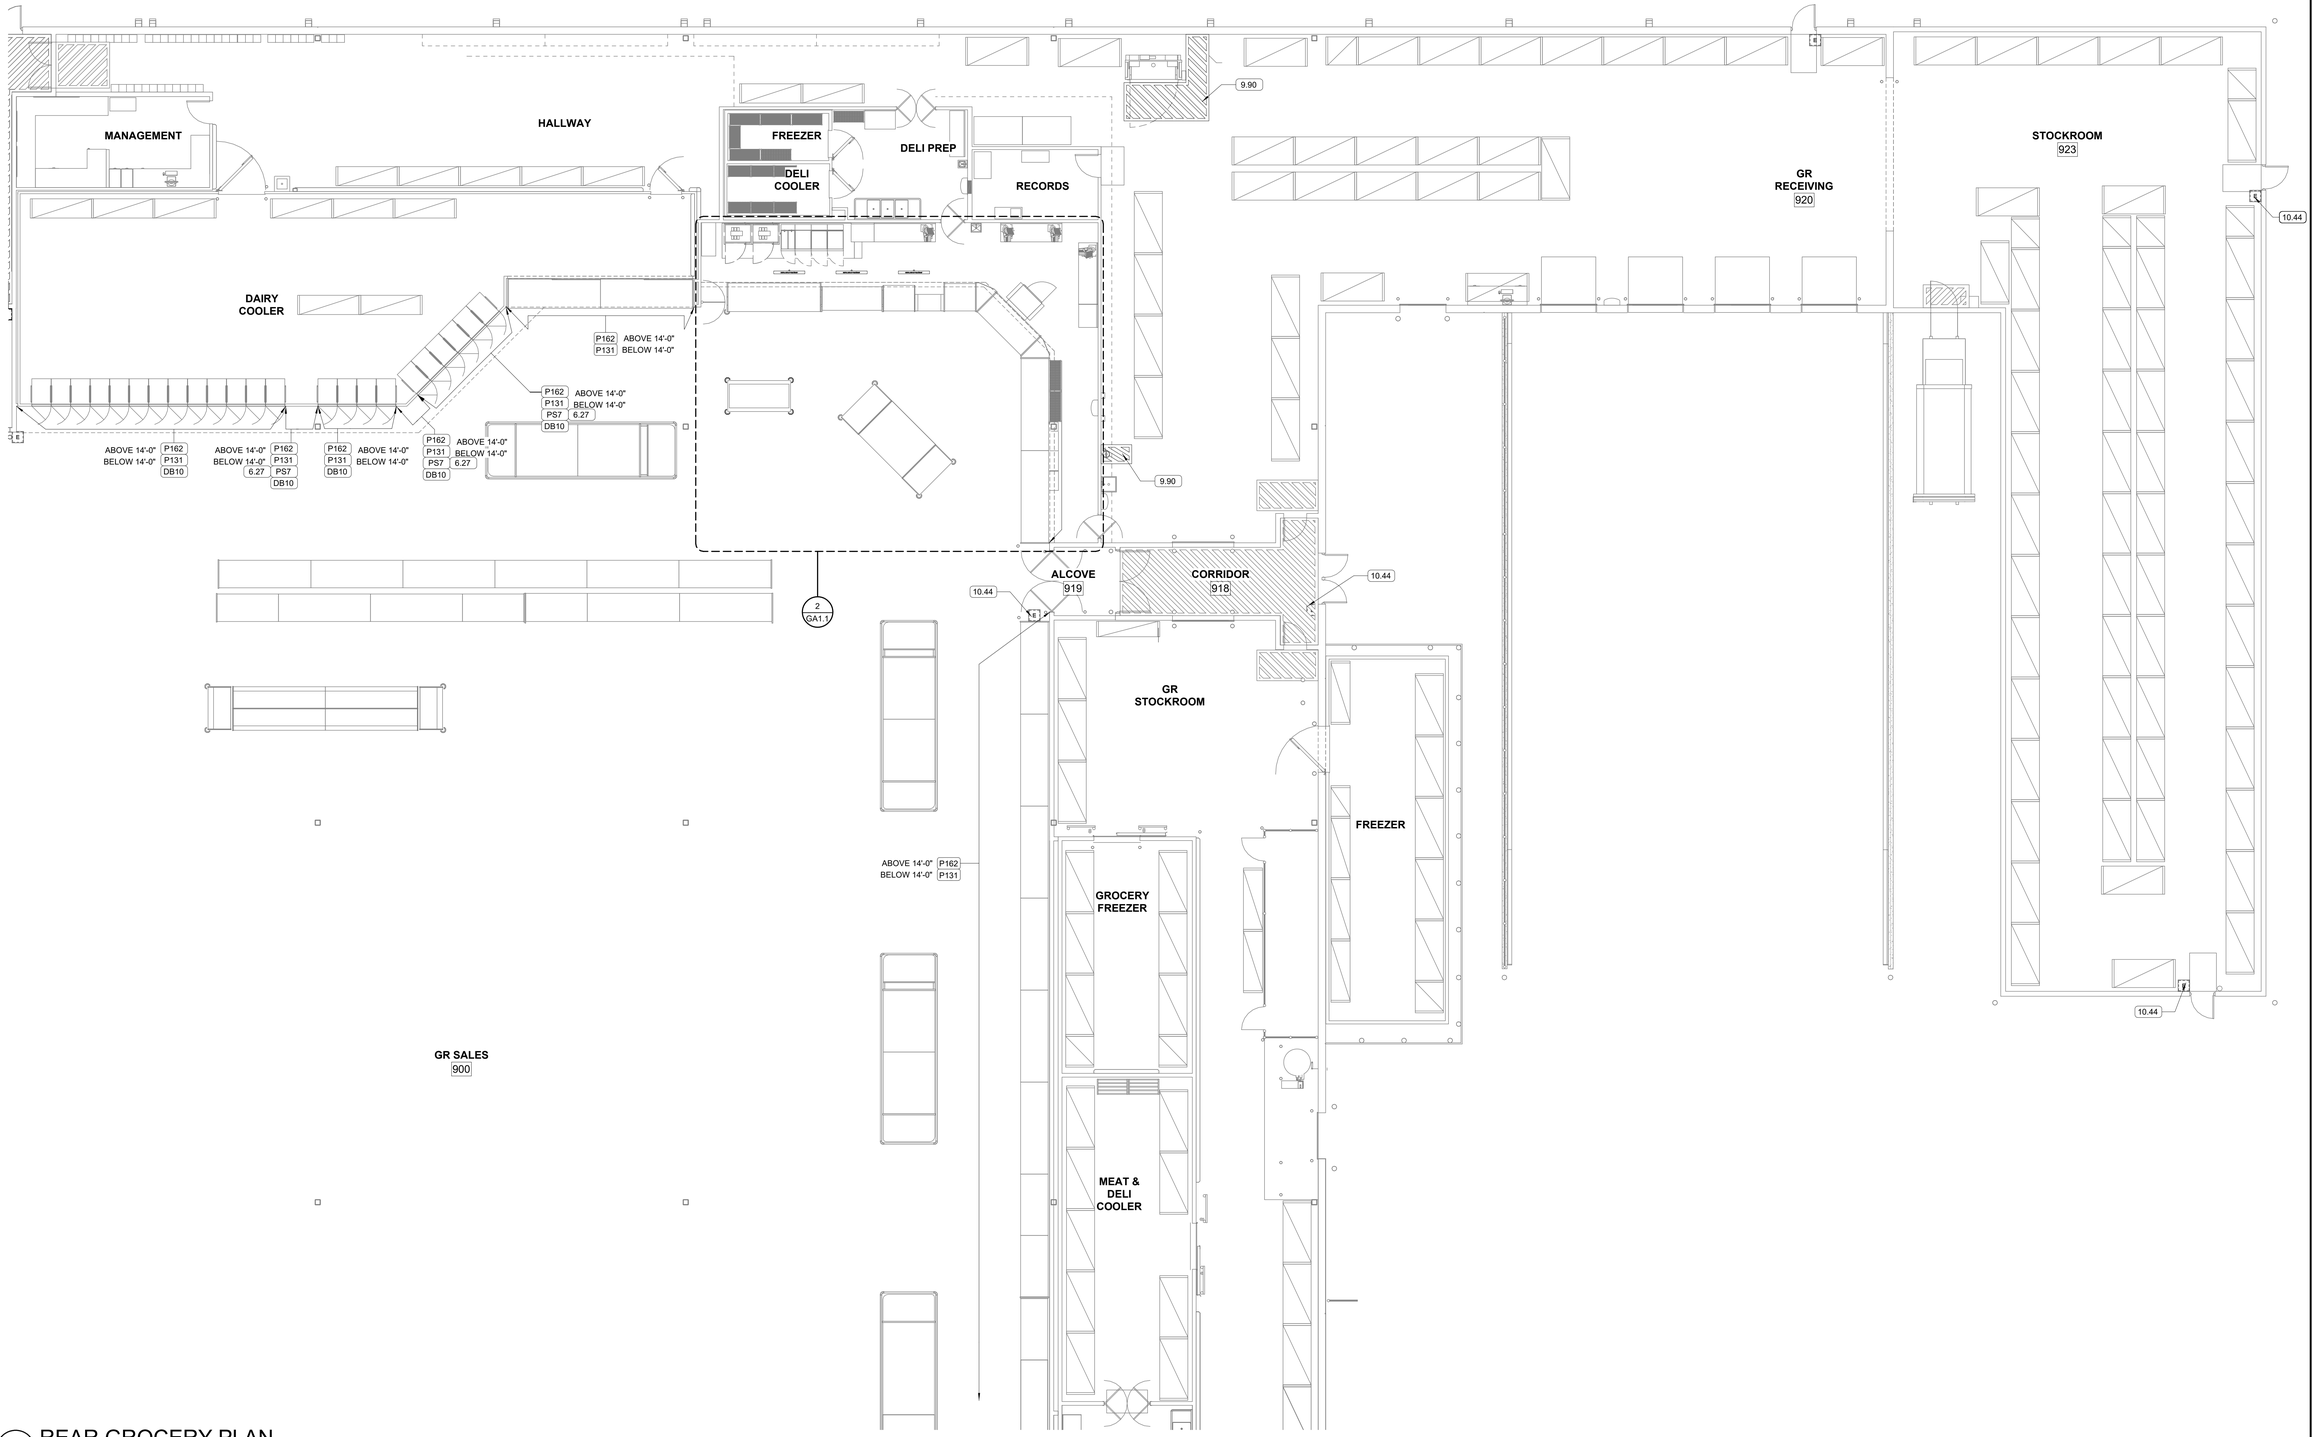
THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE DATE, SUITABLE FOR REUSE ON ANY OTHER PROJECT OR SITE OR A FUTURE DATE FOR THIS PROJECT OR SITE. ANY REUSE WITHOUT SPECIFIC VERIFICATION OR ADAPTATION BY THE ENGINEER IS PROHIBITED. REPRODUCTION OF THIS DRAWING IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF CUBARO & PETERSON, INC. ANY REUSE OF THESE PLANS ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-2247

JOB NUMBER: 210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | JZ |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

STATE OF FLORIDA
ANTHONY D MURPHY
AR100424
REGISTERED ARCHITECT
12/20/21

REAR GROCERY PLAN

SHEET: GA2


12/20/2021 4:15:51 PM
C:\Users\jzeitler\Autodesk\Documents\Revit\WM_LakeCity_FL_HB_LARCH_V26_jzeitler-segmanplan.rvt

## SANITARY COVE BASE SURFACE PREPARATION REQUIREMENTS

1. REMOVE EXISTING WALL BASE. AT EXISTING WALL CONDITIONS, REMOVE ALL GYPSUM BOARD BELOW 12" AFF AND REPLACE WITH GLASS-MAT BACKER OF SAME THICKNESS. IF FRP IS IN GOOD CONDITION REPLACE DAMAGED BASE WITH NEW BASE.
2. REMOVE AND REPLACE WALL FINISH TO NEAREST JOINT AS REQUIRED TO PERFORM GLASS-MAT BACKER INSTALLATION.
3. CUT BACK EXISTING QUARRY TILE FLOORING AS REQUIRED TO PROVIDE 1" CLEAR FROM FINISHED SURFACE TO EDGE OF TILE.
4. REMOVE ALL DEBRIS AND ANY REMAINING GROUT, CLEAN SURFACES AS REQUIRED FOR PROPER INSTALLATION OF CONSTRUCTION MATERIAL AND FINISHES.
5. INSTALL BUILDING TAPE AND FIBERGLASS MESH TAPE AS INDICATED.

NOTES:
1. REFRIGERATION CONTRACTOR TO PROVIDE GALVANIZED CLOSURE PANELS AT ALL VERTICAL GAPS AND AT ALL HORIZONTAL GAPS 52" OR LOWER AFF BETWEEN REFRIGERATED CASE, WALLS, AND/OR EQUIPMENT.
2. PROVIDE STAINLESS STEEL CLOSURE PANELS LOCATED IN PREP AREAS.
3. REF FLOOR PLANS FOR ALL PARTITION TYPES AND LOCATIONS.
4. EASE EXPOSED EDGES TO SMALL UNIFORM RADIUS.
5. SET CLOSURE PANEL IN A BED OF SEALANT EACH SIDE.
6. FASTEN CLOSURE PANELS WITH #6 PAN HEAD SCREWS AT 9" OC.
7. CLOSURE PANELS TO BE FASTENED ONLY TO THE BACK OF THE REFRIGERATED CASE OR END PANEL SKINS AS INDICATED IN THE DRAWINGS.




## 7 CLOSURE PANEL DETAIL
3/4" = 1'-0"




NOTES:
1. CONDITIONS SHOWN ARE FOR NEW CONSTRUCTION. PARTITION AND SUBSTRATE ABOVE 12" AFF MAY VARY AT EXISTING PARTITIONS
2. TRIM EXCESS BUILDING TAPE FROM PROJECTING HORIZONTAL FLAP PRIOR TO INSTALLATION OF BASE
3. REF FOR ADDITIONAL INFORMATION AT INSIDE AND OUTSIDE CORNERS
4. GC TO PROVIDE MECHANICAL FASTENERS PER MANUFACTURERS WRITTEN INSTRUCTIONS
5. USE ACCESSORIES PROVIDED AND INSTALL SANITARY COVE BASE PER MANUFACTURERS INSTRUCTIONS

## 4 SANITARY COVE BASE DETAILS (QT)
3" = 1'-0"

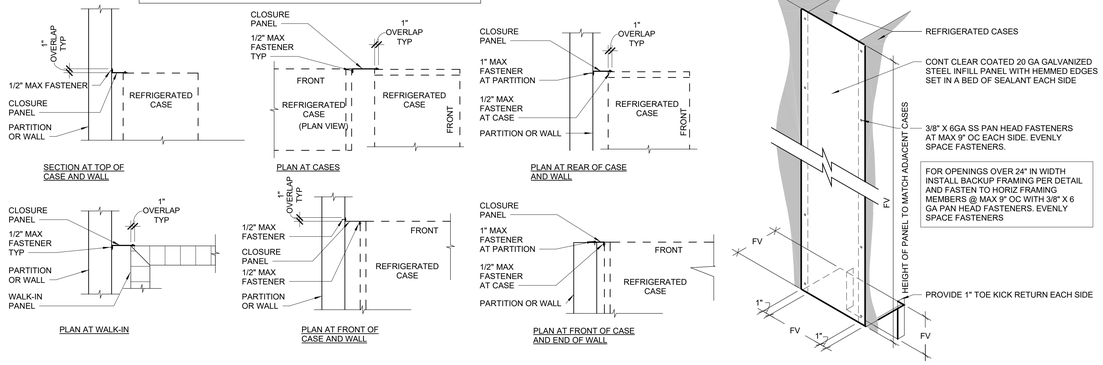


## 6 CASE TRIM DETAIL AT SERVICE CASE
3" = 1'-0"

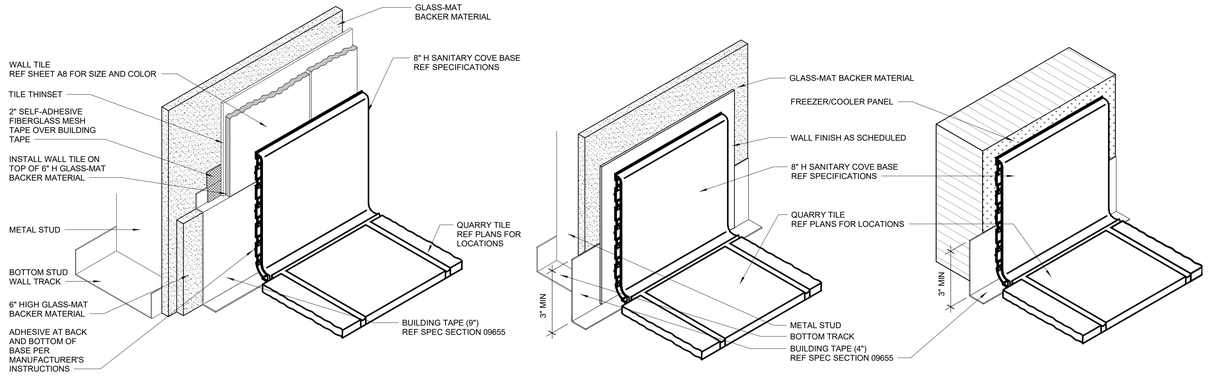


## 5 HAND SINK ELEVATION
1/2" = 1'-0"




## 3 WALL DETAIL
1 1/2" = 1'-0"

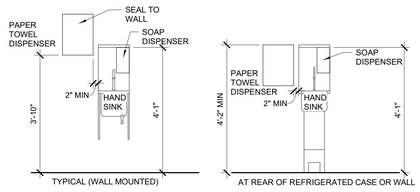


NOTES:
1. CONDITIONS SHOWN ARE FOR NEW CONSTRUCTION. PARTITION AND SUBSTRATE ABOVE 12" AFF MAY VARY AT EXISTING PARTITIONS
2. TRIM EXCESS BUILDING TAPE FROM PROJECTING HORIZONTAL FLAP PRIOR TO INSTALLATION OF BASE
3. REF FOR ADDITIONAL INFORMATION AT INSIDE AND OUTSIDE CORNERS
4. GC TO PROVIDE MECHANICAL FASTENERS PER MANUFACTURERS WRITTEN INSTRUCTIONS
5. USE ACCESSORIES PROVIDED AND INSTALL SANITARY COVE BASE PER MANUFACTURERS INSTRUCTIONS

## 2 SANITARY COVE BASE DETAILS (CONCRETE)
3" = 1'-0"




## 1 SANITARY COVE BASE ACCESSORY DETAILS
3" = 1'-0"


Cedarst & Peterson Architects Engineers Planners
2600 Maitland Center Parkway
Suite 250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cedarstpeterson.com


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THE SPECIFIC PROJECT AND SITE SHOWN HEREIN. ANY REUSE OF THESE CONTEMPORANEOUSLY WITH ITS ISSUE, OR REUSE ON A DIFFERENT SITE OR FOR A DIFFERENT PROJECT SITE OR AT A LATER TIME, WITHOUT THE EXPRESS WRITTEN PERMISSION OF CEDARST & PETERSON ARCHITECTS, INC. SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO CEDARST & PETERSON ARCHITECTS, INC. AND THE ARCHITECT'S CONSULTANTS. ALL RIGHTS RESERVED. UNPUBLISHED WORK ©2021 CEDARST & PETERSON ARCHITECTS, INC. REPRODUCTION OF THIS DRAWING IN WHOLE OR IN PART FOR ANY PURPOSE OTHER THAN THE PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 210335 | PROTO | 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | ADM |
| DRAWN BY: | JZ |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |




12/20/21

GROCERY DETAILS

SHEET: GA3

12/20/2021 5:16:05 PM
C:\Users\jordan.zeigler\projects\Documents\WIP\7_LakeCity_FL_HM_L_ARCH_V20_jordan.zeigler@cedarst.net

## CASE INSTALLATION

*****NOTE*****
**THIS DOCUMENT IS INTENDED TO DESCRIBE IMPORTANT ELEMENTS OF THIS PROJECT AND TO DEFINE THE RESPONSIBLE PARTIES FOR THIS WORK STREAM. IT IS NOT MEANT TO BE AN EXHAUSTIVE SOURCE OF INFORMATION OR A COMPLETE SCOPE OF WORK. IT SHOULD BE READ AND USED IN CONJUNCTION WITH ADDITIONAL, DETAILED INFORMATION IN THE WALMART REALTY ONE BEST WAY STANDARDS LIBRARY, AND IN PUBLICATIONS AVAILABLE FROM THE MANUFACTURER.**

| # | SCOPE OF WORK | RESPONSIBLE PARTY | | | |
|---|---|---|---|---|---|
| | | REPLACEMENTS | | NEW EQUIPMENT | |
| | | REMODEL | CAPEX | REMODEL | CAPEX |
| 1 | FURNISH THE NEW / REPLACEMENT CASES. | OEM/WMT | OEM/WMT | OEM/WMT | OEM/WMT |
| 2 | FURNISH AND INSTALL ALL (REFRIGERANT AND DRAIN) PIPING, AND ALL FIELD INSTALLED REFRIGERATION VALVES NECESSARY TO COMPLETE THE WORK. | RC | RC | RC | RC |
| 3 | FURNISH ALL CONTROLS CABLING AS NECESSARY TO COMPLETE THE WORK. (24 VOLTS OR LESS) | EMS | EMS | EMS | EMS |
| 4 | PROVIDE TYPEWRITTEN SCHEDULES FOR ALL AFFECTED ELECTRICAL PANELBOARDS. | GC | RC | GC | RC |
| 5 | INSTALL AND TERMINATE FURNISHED CONTROLS WIRING (24 VOLTS OR LESS) AS DETAILED ON THE PRINTS. | RC | RC | RC | RC |
| 6 | PROVIDE ELECTRICAL POWER CABLING FROM POWER SOURCE TO THE FIRST CASE IN THE CIRCUIT. | GC | RC | GC | RC |
| 7 | PROVIDE ALL "SLAVE" WIRING FROM FIRST CASE TO REMAINING CASES ON THE CIRCUIT. | RC | RC | RC | RC |
| 8 | PREFABRICATE AS MUCH OF THE NEW PIPE WORK AND ELECTRICAL CONDUIT AS POSSIBLE AND MOUNT ANY NEW DEVICES IN ORDER TO REDUCE THE AMOUNT OF "DOWN TIME... | RC | RC | RC | RC |
| 9 | COORDINATE THE INSTALLATION TIME WITH STORE... | GC | RC | GC | RC |
| 10 | OBTAIN HOT WORK PERMITS AS REQUIRED. | GC | RC | GC | RC |
| 11 | NOTIFY THE EMS VENDOR 24 HRS. IN ADVANCE OF THE WORK - TELL THEM WHAT CASES ARE BEING INSTALLED AND WHAT SYSTEMS WILL BE IMPACTED. | RC | RC | RC | RC |
| 12 | NOTIFY THE WMT BUILDING CONTROLS TEAM AND ADVISE THEM WHICH SYSTEMS AND WHICH CASES WILL BE IMPACTED BY THE WORK. | RC | RC | N/A | N/A |
| 13 | REMOVE ALL OF REFRIGERATED PRODUCTS FROM THE CASES THAT ARE BEING REPLACED. | WMT | WMT | N/A | N/A |
| 14 | REMOVE ALL OF THE ASSET PROTECTION (BUMP GUARDS) FROM AROUND THE CASES. | GC | RC | N/A | N/A |
| 15 | DECOMMISSION AND REMOVE THE OLD CASES. IN TEXAS, ALL DECOMMISSIONED CASES WILL BE REMOVED FROM THE STORE BY QUICK REFRIGERATION.<br>COORDINATE REMOVAL AND DISPOSAL WITH WMT CONSTRUCTION MANGER.<br>WHEN REPLACING PRODUCE CASES, REMOVE WATER SUPPLY FROM MISTING SYSTEM.<br>WHEN REPLACING DELI SERVE OVER CASES, COORDINATE THE REMOVAL OF THE DATA CABLING FOR THE DELI SCALES. | RC | RC | N/A | N/A |
| 16 | CLEAN THE FLOOR UNDER THE CASES AND JET THE DRAINS. | RC | RC | N/A | N/A |
| 17 | WHEN REPLACING MULTI-DECK AND / OR GLASS DOOR CASES, AND REUSING EXISTING PIPEWORK, RE-INSULATE THE REFRIGERATION PIPING BEHIND THE CASES. THIS APPLIES TO ALL PIPING THAT IS ACCESSIBLE WITHOUT DISTURBING EXISTING CASES, INSIDE PITS / TUNNELS OR IN A CHASE THAT IS NOT BEING OTHERWISE DISTURBED. | RC | RC | N/A | N/A |
| 18 | SET THE NEW CASES IN THE POSITION DICTATED BY THE CONSTRUCTION PRINTS. ENSURE CASES ARE STRAIGHT AND LEVEL, AND SHIMMED PER THE MANUFACTURER'S GUIDANCE. SEAL ALL CASES WITH BUTYL SEALANT. ALIGN GLASS DOORS PLUMB AND LEVEL TO PREVENT "SAW-TOOTHING" OF THE DOORS. | RC | RC | RC | RC |
| 19 | CONNECT THE NEW CASES (MECHANICAL, ELECTRICAL, PLUMBING AND CONTROLS) AS DETAILED ON THE PRINTS. | RC | RC | RC | RC |
| 20 | EVACUATE AND PRESSURE TEST THE NEW CASES AND ANY PIPING MODIFIED OR DISTURBED DURING THE WORK. | RC | RC | RC | RC |
| 21 | SWITCH ON AND COMMISSION THE NEW CASES, VALVES AND CONTROLS AS REQUIRED. CHECK AND ADJUST MECHANICAL TXV SUPERHEATS TO OEM RECOMMENDATIONS AND EPR... | RC | RC | RC | RC |
| 22 | INSTALL FURNISHED LIDS TO REFRIGERATED BUNKERS. | RC | RC | RC | RC |
| 23 | FURNISH CONTROLS SUPPORT TO THE INSTALLING CONTRACTOR. | OEM | OEM | OEM | OEM |
| 24 | WHEN REPLACING PRODUCE CASES, INSTALL NEW MISTING SYSTEM TO CASES AND CONNECT TO DEDICATED WATER SUPPLY. | RC | RC | RC | RC |
| 25 | WHEN REPLACING DELI SERVE OVER CASES, COORDINATE THE INSTALLATION OF THE DATA CABLING FOR THE DELI SCALES. | WMT | RC/WMT | WMT | RC/WMT |
| 26 | NOTIFY WMT BUILDING CONTROLS THAT THE NEW CASES ARE RUNNING AND ONLINE. | RC | RC | RC | RC |
| 27 | CARRY OUT A THOROUGH LEAK TEST ON ALL WELDED AND MECHANICAL JOINTS INSTALLED OR DISTURBED DURING THE PROJECT. | RC | RC | RC | RC |
| 28 | HANDOVER THE NEW CASES TO THE STORE.<br>(CASES MUST BE CLEAN, AT OPERATIONAL TEMPERATURE AND FULLY FUNCTIONAL WITH ALL PANS AND SHELVING IN PLACE.) | RC | RC | RC | RC |
| 29 | FILL THE NEW CASE WITH PRODUCT. | WMT | WMT | WMT | WMT |
| 30 | REPLACE MISSING OR DAMAGED FLOOR TILES OR REPAIR VISIBLE, DAMAGED CONCRETE FLOOR AROUND THE NEW CASES. (AS NEEDED) | GC (OR WMT PREFERRED FLOORNG INSTALLER) | RC | N/A | N/A |
| 31 | INSTALL NEW CIRCUIT LABELS TO THE NEW CASES AS... | RC | RC | RC | RC |
| 32 | REPLACE THE SHOP FLOOR DRAWINGS AND INSTALL REPLACEMENT LEGENDS. | RC | RC | RC | RC |
| 33 | REINSTALL ANY PREVIOUSLY REMOVED (UNDAMAGED) ASSET PROTECTION (BUMP GUARDS). INSTALL NEW OWNER FURNISHED PROTECTION EQUIPMENT AS NEEDED. | RC | RC | RC | RC |
| 34 | AFTER ALL CHANGES HAVE BEEN MADE TO A RACK, REMOVE ANY COMPRESSOR SUCTION FILTERS / SOCKS AND REPLACE THE RACK LIQUID LINE FILTERS. LEAVE THE OLD FILTERS /... | RC | RC | RC | RC |
| 35 | SUBMIT REQUIRED VERISAE AND OTHER REGULATORY FORMS AS REQUIRED BY THE END OF COMMISSIONING WEEK. COMPLETED VERISAE FORMS ARE TO BE EMAILED TO MCEQUIP@WAL-MART.COM. | RC | RC | RC | RC |
| 36 | REMOVE ALL OF THE OLD CASES AND CLEAR SITE OF ALL TOOLS, UNUSED INSTALLATION MATERIALS AND TRASH. | GC | RC | GC | RC |

## CONDENSER REPLACEMENT

*****NOTE*****
**THIS DOCUMENT IS INTENDED TO DESCRIBE IMPORTANT ELEMENTS OF THIS PROJECT AND TO DEFINE THE RESPONSIBLE PARTIES FOR THIS WORK STREAM. IT IS NOT MEANT TO BE AN EXHAUSTIVE SOURCE OF INFORMATION OR A COMPLETE SCOPE OF WORK. IT SHOULD BE READ AND USED IN CONJUNCTION WITH ADDITIONAL, DETAILED INFORMATION IN THE WALMART REALTY ONE BEST WAY STANDARDS LIBRARY, AND IN PUBLICATIONS AVAILABLE FROM THE MANUFACTURER.**

| # | SCOPE OF WORK | RESPONSIBLE PARTY | |
|---|---|---|---|
| | | REMODEL | CAPEX |
| 1 | FURNISH THE NEW REPLACEMENT CONDENSERS / VFD'S. | OEM/WMT | OEM/WMT |
| 2 | INSTALL ANY ADDITIONAL SUPPORT OR SCREENING STRUCTURES AS REQUIRED TO SUPPORT THE NEW CONDENSERS. | GC | RC |
| 3 | FURNISH AND INSTALL ALL (REFRIGERANT AND DRAIN) PIPING, AND ALL FIELD INSTALLED REFRIGERATION VALVES NECESSARY TO COMPLETE THE WORK. | RC | RC |
| 4 | FURNISH ALL CONTROLS CABLING AS NECESSARY TO COMPLETE THE WORK. (24 VOLTS OR LESS) | EMS | EMS |
| 5 | INSTALL AND TERMINATE CONTROLS WIRING (24 VOLTS OR LESS) AS DETAILED ON THE PRINTS. | RC | RC |
| 6 | TERMINATE ALL POWER CABLES. | RC | RC |
| 7 | PREFABRICATE AS MUCH OF THE NEW PIPE WORK AND ELECTRICAL CONDUIT AS POSSIBLE AND MOUNT ANY NEW DEVICES IN ORDER TO REDUCE THE AMOUNT OF "DOWN TIME" NEEDED TO COMPLETE THE INSTALLATION. | RC | RC |
| 8 | COORDINATE THE INSTALLATION TIME WITH STORE MANAGEMENT. | RC | RC |
| 9 | OBTAIN HOT WORK PERMITS AS REQUIRED. | GC | RC |
| 10 | NOTIFY THE EMS VENDOR 24 HRS. IN ADVANCE OF THE WORK - TELL THEM WHAT CONDENSERS ARE BEING INSTALLED AND WHAT SYSTEMS WILL BE IMPACTED. | RC | RC |
| 11 | NOTIFY THE WMT BUILDING CONTROLS TEAM AND ADVISE THEM WHICH SYSTEMS AND WHICH CASES WILL BE IMPACTED BY THE WORK. | RC | RC |
| 12 | TAKE WHATEVER STEPS ARE NECESSARY TO PROTECT THE PRODUCT THAT MAY BE AFFECTED BY THE WORK. | WMT | WMT |
| 13 | RECLAIM REFRIGERANT AS REQUIRED. | RC | RC |
| 14 | DECOMMISSION AND REMOVE THE OLD CONDENSERS / VFD'S. | RC | RC |
| 15 | INSTALL THE NEW FURNISHED CONDENSERS, VALVES, VFD'S ETC. AS DETAILED IN THE CONSTRUCTION PRINTS. (MECHANICAL, ELECTRICAL AND CONTROLS) | RC | RC |
| 16 | EVACUATE AND PRESSURE TEST THE NEW CONDENSERS AND ANY PIPING MODIFIED OR DISTURBED DURING THE WORK. | RC | RC |
| 17 | SWITCH ON AND COMMISSION THE NEW CONDENSERS / VFD'S AND ALL OTHER CONTROL VALVES AS REQUIRED. CHECK AND ADJUST ALL CONTROL VALVE SETTINGS PER THE LEGEND. | RC | RC |
| 18 | REPLACE THE REFRIGERANT THAT WAS RECLAIMED DURING THE SHUTDOWN / DECOMMISSIONING PROCESS. | RC | RC |
| 19 | COMMISSION THE CONDENSERS AND VFD'S, USING THE OEM'S SEQUENCE OF OPERATION AND THE EOR'S CONTROL SETTINGS. | RC | RC |
| 20 | CARRY OUT ANY CONTROLS PARAMETER CHANGES. | EMS | EMS |
| 21 | PERFORM REMOTE CHECKOUT. | RC | RC |
| 22 | FURNISH CONTROLS SUPPORT TO THE INSTALLING CONTRACTOR. | EMS | EMS |
| 23 | NOTIFY WMT BUILDING CONTROLS THAT THE NEW CONDENSERS ARE RUNNING AND ONLINE. | RC | RC |
| 24 | CARRY OUT A THOROUGH LEAK TEST ON ALL WELDED AND MECHANICAL JOINTS INSTALLED OR DISTURBED DURING THE PROJECT. | RC | RC |
| 25 | CONFIRM WITH STORE MANAGEMENT THAT THE NEW CONDENSERS ARE FULLY OPERATIONAL AND ALL CASES ARE AT THE CORRECT TEMPERATURE. | RC | RC |
| 26 | COORDINATE THE SALVAGE OF THE OLD CONDENSERS WITH AES.<br>***NOTE - IN TEXAS, WALMART'S PREFERRED SALVAGE PARTNER FOR REFRIGERATION EQUIPMENT IS QUICK REFRIGERATION. | RC | RC |
| 27 | REMOVE THE OLD LEGENDS AND INSTALL REPLACEMENT LEGENDS AS SUPPLIED BY THE EOR / OEM. | RC | RC |
| 28 | AFTER ALL CHANGES HAVE BEEN MADE TO A RACK, REMOVE ANY COMPRESSOR SUCTION FILTERS / SOCKS AND REPLACE THE RACK LIQUID LINE FILTERS. LEAVE THE OLD FILTERS / DRIERS IN THE RACK HOUSE TO BE INSPECTED BY THE MCM. | RC | RC |
| 29 | CARRY OUT ANY STRUCTURAL WORK REQUIRED AND AS INCLUDED ON THE STRUCTURAL ENGINEERING DRAWINGS. OBTAIN HOT WORK PERMITS AS REQUIRED. | GC | RC |
| 30 | PROVIDE CTL INSPECTION OF STRUCTURAL WORK | WMT | WMT |
| 31 | SUBMIT REQUIRED VERISAE AND OTHER REGULATORY FORMS AS REQUIRED BY THE END OF COMMISSIONING WEEK. COMPLETED VERISAE FORMS ARE TO BE EMAILED TO MCEQUIP@WAL-MART.COM. | RC | RC |
| 32 | CLEAR SITE OF ALL TOOLS, UNUSED INSTALLATION MATERIALS AND... | GC | RC |

## ABBREVIATION LEGEND

| ABBREVIATION | DESCRIPTION |
|---|---|
| RC | REFRIGERATION CONTRACTOR AND SUB-CONTRACTORS |
| GC | GENERAL CONTRACTOR AND SUB-CONTRACTORS |
| EMS | EMS VENDOR |
| OEM | ORIGINAL RACK EQUIPMENT MANUFACTURER, ORIGINAL CASE EQUIPMENT MANUFACTURER, AHU MANUFACTURER, RTU MANUFACTURER |
| PS | WALK-IN BOX PANEL SUPPLIER |
| WMT | WALMART |
| AES | SUPPLIER OF AHU ADAPTER CURBS, RTU ADAPTER CURBS AND WALMART'S EQUIPMENT SALVAGE PARTNER |
| WTC | WATER TREATMENT CONTRACTOR |
| MC | MECHANICAL CONTRACTOR AND SUB-CONTRACTORS |


Cuhaci & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com



STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 | PROTO: 188 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| CHECKED BY: | ADM | |
| DRAWN BY: | JZ | |
| PROTO CYCLE: | 09/24/21 | |
| DOCUMENT DATE: | 11/22/21 | |

STATE OF FLORIDA
ANTHONY D MURPHY
AR100424
REGISTERED ARCHITECT
Anthony D Murphy
12/20/21

RESPONSIBILITY SCHEDULES

SHEET:
GA5

12/20/2021 4:16:09 PM
C:\Users\jeritsa.negronquiros\Documents\00767_LakeCity_FL_188_L_ARCH_V20_jeritsa.negronquiros.rvt

THE QUANTITIES (COUNT) OF ITEMS LISTED IN THIS SCHEDULE MAY NOT ACCURATELY REPRESENT THE ACTUAL QUANTITY REQUIRED TO COMPLETE THE SCOPE OF WORK INCLUDED IN THE CONTRACT DOCUMENTS. ACTUAL QUANTITY (COUNT) OF OWNER SUPPLIED ITEMS SHALL BE DETERMINED THROUGH A THOROUGH REVIEW AND ACCOUNTING OF THE CONTRACT DRAWINGS.

## OWNER SUPPLIED ITEMS

| WDS # | VENDOR SAP # | Family | TYPE | MODEL |
|---|---|---|---|---|
| [AMERIGAS], [BLUE RHINO] | | | | |
| N/A | N/A | PUBLIC - Self Serve Propane Exchange Unit | PUBLIC - Self Serve Propane Exchange Unit | UNKNOWN |
| [LOZIER STORE FIXTURES INC][MADIX] | | | | |
| PH7008 | [1000118939][1000084552] | PHARMACY - Fill Pod V2 | 24"x24" | 24"X24" |
| [QUALSERV SOLUTIONS LLC][IDX CORPORATION] | | | | |
| VC2067 | [1000041874][1000347050] | VISION CENTER 2.0 - Vertical Slat Wall | VISION CENTER 2.0 - Vertical Slat Wall | SLAT WALL |
| ACUITY BRANDS LIGHTING INC | | | | |
| EL0016 | 1000041247 | 26_Lighting_Exit_Wall_Acuity_LQM | Type16 | RED: LQM S W 1 R 120/277 EL N SD90 M6<br>GREEN: LQM S W 1 G 120/277 EL N SD90 M6 |
| EL068R | 1000142734 | 26_Lighting_Recessed_Downlight_Acuity_LBR6 | Type68R | LBR6 07LM 40K AR LSS MWD MVOLT UGZ |
| EMERSON CLIMATE TECHNOLOGIES RETAIL | | | | |
| RB0006 | 1000214394 | 23_Refrigeration_BAS_Horn_Strobe_Emerson | Horn Strobe | 868STR |
| RB0009 | 1000214394 | 23_Refrigeration_BAS_Leak_Detection_Panel_Emerson | LDP | |
| RB0013 | 1000214394 | 23_Refrigeration_BAS_Leak_Detection_Sensor_Emerson | MRLDS | MRLDS |
| RB0016 | 1000214394 | 23_Refrigeration_BAS_Leak_Detection_Zone_Alarm_Emerson | Zone Alarm | |
| HAINES JONES & CADBURY LLC HJC | | | | |
| PH6123 | UNKNOWN | PHARMACY - Wall Guard | Wall Guard | UNKNOWN |
| PH0036 | 1000121534 | PHARMACY - Wall Mounted Equipment Arm | EQUIPMENT ARM | UNKNOWN |
| HAINES, JONES & CADBURY | | | | |
| FS0005 | 1000121534 | 21_Fire_Suppression_Sprinkler_Upright_Opflex_0-75_155_K11-2 | 3/4" BRASS UPRIGHT 155 | TY5131 |
| HEATCRAFT REFRIGERATION PRODUCTS LL | | | | |
| RC0044 | 1000108507 | 23_Refrigeration_Condensing_Unit_Kysor_Warren | Condensing Unit | |
| HONEYWELL INTERNATIONAL INC | | | | |
| | 1000211094 | 23_Refrigeration_BAS_Evap_Controller_Enclosure_KE2 | KE2 Evap 40A (20178/20844) | 20178/20844 |
| | 1000211094 | 23_Refrigeration_BAS_Evap_Controller_Enclosure_KE2 | KE2 Evap 80A (20178/20844/20219) | 20178/20844/20219 |
| RB0031 | 1000211094 | 23_Refrigeration_BAS_XIO_Enclosure_Novar | 1 XIO Enclosure | |
| KYSOR/WARREN | | | | |
| RE0568 | 1000108507 | 23_Refrigeration_Evaporator_Coil_Bohn_BEL_Kysor_Warren | BEL-0275 | BEL-0275 |
| RE0601 | 1000108507 | 23_Refrigeration_Evaporator_Coil_Bohn_BEV_Kysor_Warren | BEV-0290 | BEV-0290 |
| LOEB ELECTRIC CO | | | | |
| EL0009 | 1000133741 | 26_Lighting_Volumetric_Troffer_Loeb_BLT | Type9 | 2BLT2 40L ADSM GZ1 LP840 |
| MCCUE CORPORATION | | | | |
| FR1001 | 1000103826 | PROTECT - Floor Mounted Corner Guard | Refrigerated Case Corner Protection | UNKNOWN |
| REXEL INC | | | | |
| | 1000046047 | 26_Electrical_Outlet_WMRECDU_FET | WMRECDU-FET-END | WMRECDU-FET-END |
| EL0019 | 1000046047 | 26_Lighting_Emergency_Rexel_EVHC | Type 18 - Wall | EVHC6IDP-WM |
| EL0048 | 1000046047 | 26_Lighting_Pendant_Rexel_MLCP | Type48 | MLCP-DVD-208340CD-NN-M5L1-BK |

## SHEET NOTES

**1.** THE QUANTITIES (COUNT) OF ITEMS PURCHASED BY REALTY EXECUTION SERVICES AS SCHEDULED ON THIS "OWNER SUPPLIED ITEMS" SHEET MAY NOT ACCURATELY REPRESENT THE ACTUAL QUANTITY REQUIRED TO COMPLETE THE SCOPE OF WORK INCLUDED IN THE CONTRACT DOCUMENTS. ACTUAL QUANTITY (COUNT) OF OWNER SUPPLIED ITEMS SHALL BE DETERMINED THROUGH A THOROUGH REVIEW AND ACCOUNTING OF THE CONTRACT DRAWINGS.

**2.** REFERENCE APPENDIX A IN THE SPECIFICATIONS TO DETERMINE WHO IS RESPONSIBLE FOR THE INSTALLATION OF OWNER FURNISHED PRODUCTS.

### MATERIAL VENDOR LIST

| VENDOR | VENDOR # |
|---|---|
| HARNIX CORP | |
| THE MATWORKS COMPANY LLC | |
| VERIFY WITH SPECS (VULCRAFT, NEW MILLENIUM, CONSOLIDATED SYSTEMS INC) | |

### EQUIPMENT VENDOR LIST

| VENDOR | VENDOR SAP # |
|---|---|
| [AMERIGAS], [BLUE RHINO] | N/A |
| [LOZIER STORE FIXTURES INC][MADIX] | [1000118939] [1000084552] |
| [QUALSERV SOLUTIONS LLC][IDX CORPORATION] | [1000041874] [1000347050] |
| ACUITY BRANDS LIGHTING INC | |
| EMERSON CLIMATE TECHNOLOGIES RETAIL | 1000214394 |
| HAINES JONES & CADBURY LLC HJC | |
| HAINES, JONES & CADBURY | 1000121534 |
| HEATCRAFT REFRIGERATION PRODUCTS LL | 1000108507 |
| HONEYWELL INTERNATIONAL INC | 1000211094 |
| KYSOR/WARREN | 1000108507 |
| LOEB ELECTRIC CO | 1000133741 |
| MCCUE CORPORATION | 1000103826 |
| REXEL INC | 1000046047 |


3600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cpaarchitects.com
Cedarst & Peterson
Architects Engineers Planners



STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE DATE TO BE USED FOR ANY OTHER WORK OR A DIFFERENT PROJECT SITE OR AT A LATER TIME. ALL COPYRIGHTS AND OTHER PROPERTY RIGHTS ARE RESERVED BY CEDARST & PETERSON AND OTHER PROFESSIONAL CONSULTANTS EMPLOYED BY THE ENGINEERS. REPRODUCTION OF THIS DRAWING IN WHOLE OR IN PART FOR USE ON ANY PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
JOB NUMBER: 221033S | PROTO | 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

CHECKED BY: ADM
DRAWN BY: NG
PROTO CYCLE: 09/24/21
DOCUMENT DATE: 11/22/21

STATE OF FLORIDA
ANTHONY D MURPHY
AR100424
REGISTERED ARCHITECT
12/15/21

OWNER SUPPLIED ITEMS

SHEET:
OS1

12/14/2021 3:43:24 PM
C:\Users\pmills.bgis\Autodesk\Documents\MWS_Lake\City_FL_185_L_ARCH_V25_pmills-bgis@autodesk.rvt

# CONTROL INFORMATION

| NO. | DESCRIPTION | TYPE | PANEL/CCT | BREAKER POLES | BREAKER TYPE | ON/OFF OUTPUT | ON/OFF PROGRAMMING | ROP INPUT/ PROGRAMMING |
|---|---|---|---|---|---|---|---|---|
| C5 | EXTERIOR LIQUOR BOX SIGNAGE | CONTACTOR | LTS1 - 9 | 1 | EXISTING | IOM/R-ER3A-4 | COORDINATE WITH STORE MANAGER | N/A |
| LC1 | INTERIOR LIQUOR BOX SIGNAGE | CONTACTOR | LTS1 - 11<br>LTS1 - 14<br>LTS1 - 13<br>LTS1 - 16 | 1 | NEW | | COORDINATE WITH STORE MANAGER | N/A |

NOTE: E.C. TO FURNISH AND INSTALL CONTACTORS. REFER TO BAS SHEETS FOR CONTROL INFORMATION.




## 2 PARTIAL BAS ONE-LINE

NTS

## 1 BUILDING AUTOMATION PLAN

1/32" = 1'-0"

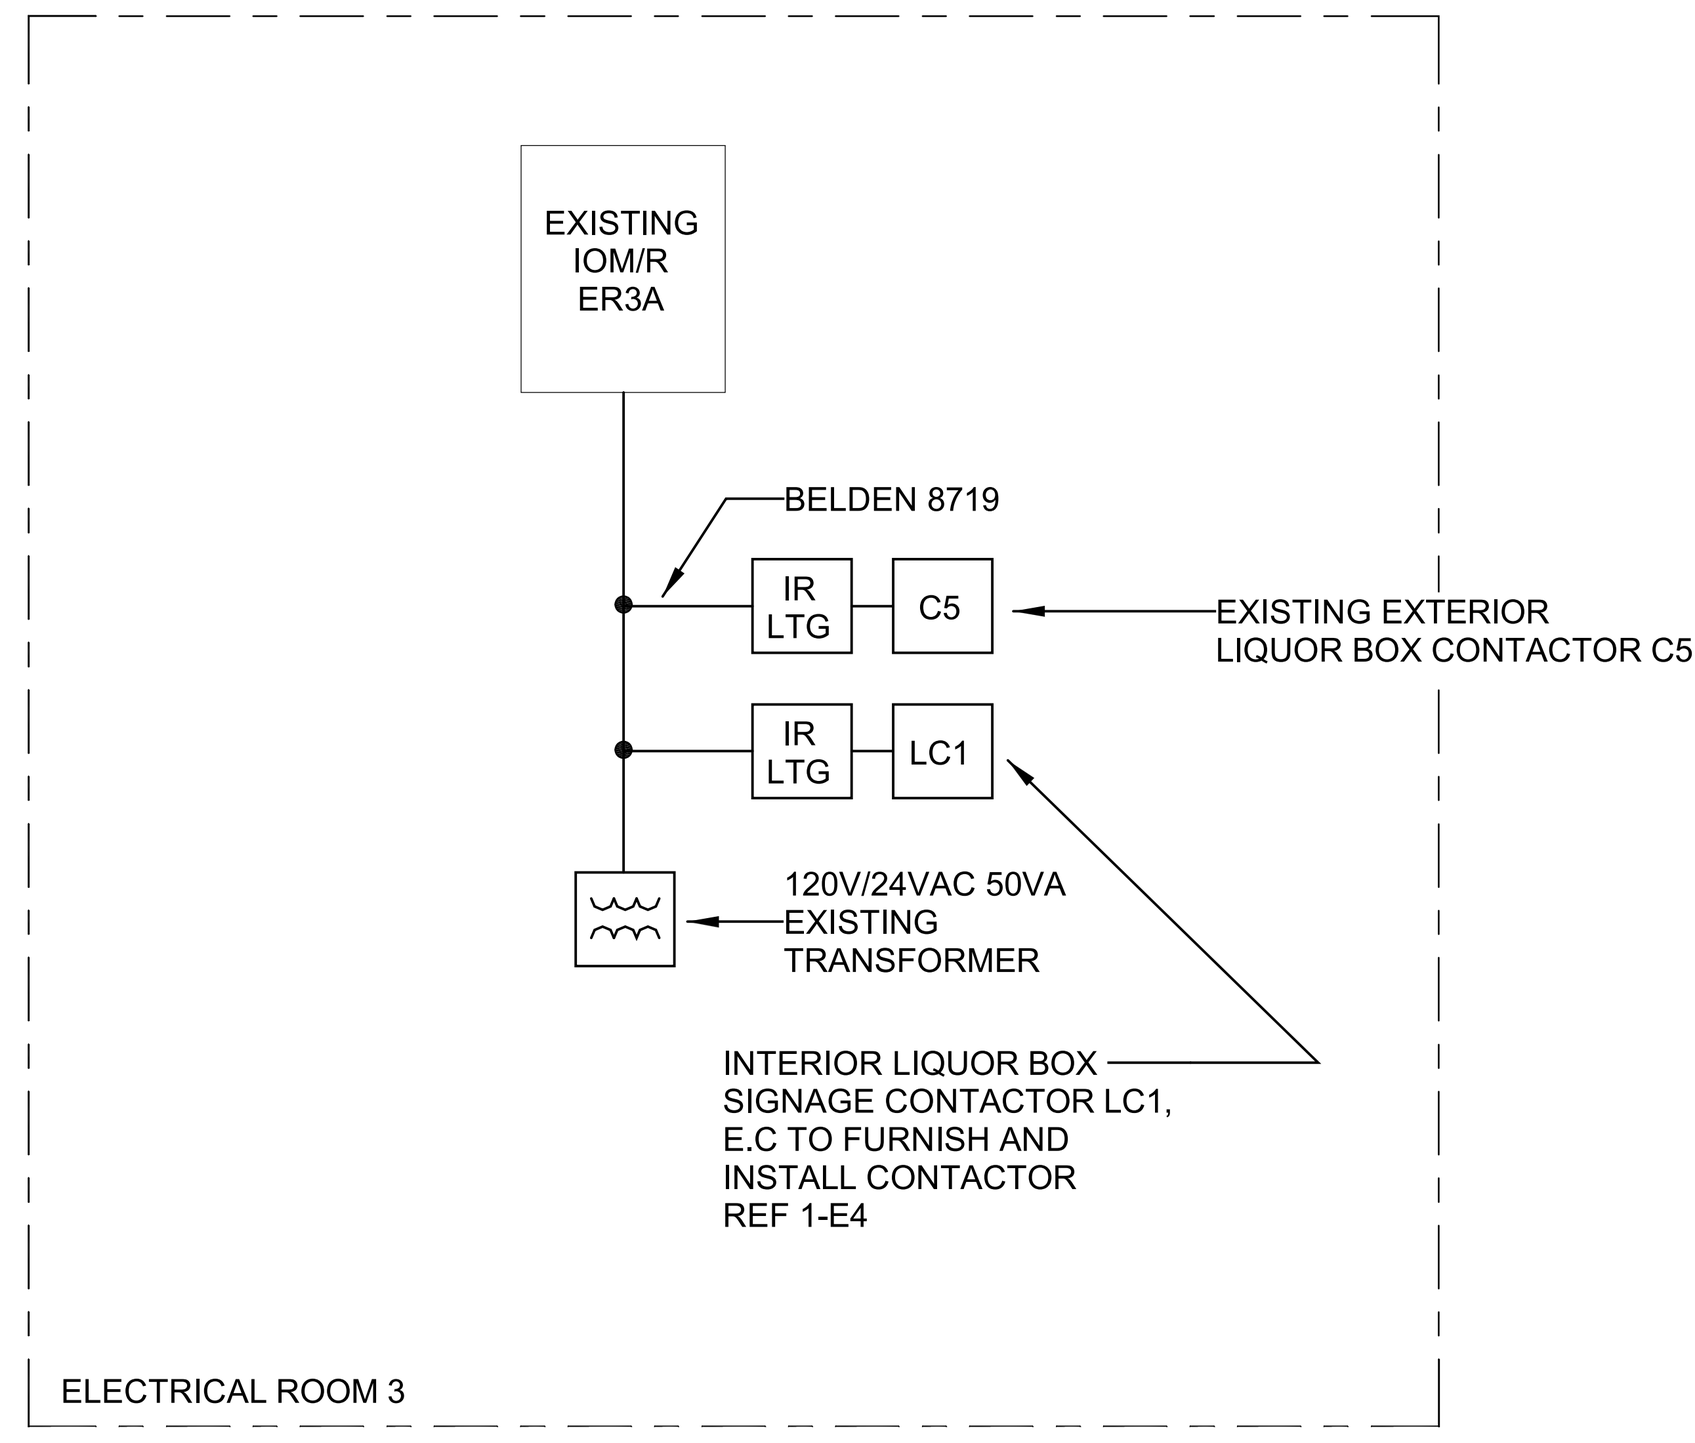PROVIDE CONDUIT, FITTINGS, WIRE-TIES, CONNECTORS, LABELS, AND ANY OTHER MISC. PARTS NEEDED TO INSTALL AND START THE SYSTEM.

OWNER WILL FURNISH ALL MAJOR E.M.S. DEVICES (INCLUDING 24 VOLT TRANSFORMERS AND RELAYS).

## WIRE LEGEND

| |
|---|
| WIR-1010 (TAN CABLE 18-2, 20-2 TWISTED PAIR) |
| WIR-2020 (BLUE CABLE 22-2 TWISTED PAIR) |
| BELDEN 8719 (16-2 TWISTED PAIR) |
| BELDEN 8761 (22-2 TWISTED PAIR) |
| BELDEN 8771 (22-3 TWISTED PAIR) |
| BELDEN 9418 (18-4 W/DRAIN GROUND) |
| BELDEN 1120A (18-3 TWISTED PAIR) |

NOTES:
1. ALL CABLE WIR-2020 UNLESS NOTED OTHERWISE.
2. ALL CABLE FURNISHED AND INSTALLED BY BAS CONTRACTOR.

## BAS EQUIPMENT SALVAGE REQUIREMENTS

ALL DEMOLISHED BAS EQUIPMENT, WITH THE EXCEPTION OF ROOFTOP EQUIPMENT BEING SALVAGED BY AES, SHALL BE RETURNED TO WALMART MECHANICAL SERVICES CONSTRUCTION MANAGER. EQUIPMENT TO BE RETURNED INCLUDES: EXECUTIVE CONTROLLER(S), IOM(S), CIM(S), CCM(S), ETC. PROVIDE DOCUMENTATION FOR ALL EQUIPMENT REMOVED IN ACCORDANCE WITH SPECIFICATIONS AND REQUIRED CLOSE-OUT DOCUMENTS.

## GENERAL BAS NOTES

1. TEMPERATURE AND CO2 SENSOR MOUNTING: PROVIDE 1/2" CONDUIT AND INSTALL BAS CABLE FROM SENSOR TO CONTROL MODULE. MOUNT SENSOR ON BOX. ALL SENSORS TO BE MOUNTED AT +84" UNLESS NOTED OTHERWISE. SENSORS ON SALES FLOOR SHALL BE INSTALLED ON THE BACK SIDE OF COLUMN. DO NOT INSTALL SENSORS IN HVAC SUPPLY AIR PATH OR IN DIRECT SUNLIGHT. REF MECHANICAL DRAWINGS FOR EXACT LOCATIONS.
   A. GYPSUM BOARD WALLS: PROVIDE A 4" SQUARE RECESSED BOX WITH A SINGLE GANG PLASTER RING FLUSH MOUNTED VERTICALLY.
   B. BLOCK WALLS AND COLUMNS: PROVIDE A 2"X4" BOX SURFACE MOUNTED VERTICALLY.
   C. INSULATE BEHIND SENSORS MOUNTED ON EXTERIOR WALLS WITH 1/2" POLYSTYRENE SPACER.
   D. MOUNT CO2 SENSORS 6" ABOVE TEMPERATURE SENSORS.
2. TERMINATIONS SHALL BE MADE IN ACCORDANCE WITH BAS SUPPLIER INSTALLATION INSTRUCTIONS. NO FOIL OR UNUSED WIRE(S) SHALL BE EXPOSED AFTER APPLICATION OF HEAT SHRINK.
3. CABLE: PROVIDE CABLE ACCORDING TO DRAWINGS. NO DEVIATION FROM DRAWINGS WILL BE ACCEPTED. CABLES SHALL HAVE EACH END LABELED INDICATING WHERE THE OPPOSITE END TERMINATES. CABLE SHALL BE INSTALLED IN CONDUIT OR CABLE TRAY IN FINISHED AREAS OF BUILDING. EXCEPT HVAC CABLE IN SALES FLOOR AREA AT BAR JOISTS.
4. MINOR CHANGES IN MATERIALS OR TERMINATION POINTS SHALL NOT INCREASE CONTRACT COST.
5. ROUTE BAS CONDUITS IN CONCEALED LOCATIONS (IN WALLS, PIPE RACKS AND/OR CHASES). PROVIDE A TRANSITION FROM THE PVC UNDERSLAB BAS CONDUIT TO EMT OR FLEX. BAS CABLES SHALL BE RUN IN CONDUIT FULL LENGTH, BENEATH REFRIGERATED CASES. BAS CABLES AT BAR JOIST LEVEL IN OPEN SALES AREA AND THE STOCKROOM CAN BE EXPOSED.
6. DEMOLITION: COORDINATE WITH ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF BAS DEMOLITION. REMOVE CONDUIT AND WIRES ALL THE WAY BACK TO ORIGINATING JUNCTION BOXES OR DEVICES. DEMOLITION SHALL NOT AFFECT ACTIVE CIRCUITS.
7. BAS CONTRACTOR SHALL PROVIDE ASSISTANCE TO THE BAS SUPPLIER ON PERFORMING EQUIPMENT TESTS ON POWER SWITCHING PANELS AS NECESSARY.
8. DIMMING CONTROL WIRING MUST TERMINATE IN HOME RUN FIXTURES ONLY, AS SHOWN ON EMS PLANS, PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. DO NOT MODIFY THE LISTED FIXTURE'S WIRING HARNESS OR TERMINATE CONTROL WIRING IN THE ADJACENT FIXTURES.
9. DO NOT INSTALL EQUIPMENT OR CONDUITS DIRECTLY UNDER SKYLIGHT WELLS UNLESS INDICATED OTHERWISE ON PLANS.
10. WHERE GROUPED CONDUITS ARE INSTALLED WITHIN THE JOIST SPACE, COORDINATE WITH SPRINKLER CONTRACTOR PRIOR TO INSTALLATION IN ORDER TO MAINTAIN REQUIRED CLEARANCES FROM SPRINKLERS.
11. 24 HOURS PRIOR TO SHUTTING DOWN HVAC SYSTEMS OR ENERGY MANAGEMENT CONTROLS SYSTEMS, SEND EMAIL TO NSRM@WALMART.COM. THE E-MAIL SHALL STATE WHAT, WHY, AND WHEN IT IS BEING SHUT DOWN AND HOW LONG IT IS ANTICIPATED TO BE SHUT DOWN. THEN SEND A FOLLOW UP EMAIL TO NSRM@WALMART.COM AFTER THE WORK IS COMPLETE AND THE SYSTEM IS BACK UP AND RUNNING.

## BAS SYMBOLS

| | |
|---|---|
| AHUC | AHU CONTROLLER |
| AHUS# | AHU TEM/RH SENSOR |
| ALS | ANALOG LIGHT SENSOR |
| ETM | ELECTRONIC THERMOSTAT MODULE |
| IDS | INDOOR DEWPOINT SENSOR |
| IHS | INDOOR HUMIDITY SENSOR |
| ITS | INDOOR TEMPERATURE SENSOR |
| ODS | OUTDOOR DEWPOINT SENSOR |
| OTS | OUTDOOR TEMPERATURE SENSOR |
| OS-X | OVERRIDE TEMPERATURE SENSOR |
| S-X | WALL TEMPERATURE SENSOR |
| _S# | UNIT HEATER TEMPERATURE SENSOR |
| HS-X | WALL HUMIDITY SENSOR |
| RTUC | ROOFTOP UNIT CONTROLLER |
| EICB | EQUIPMENT INTERFACE COMM BOARD |
| BAP | BUILDING ALARM PANEL |
| CO2 | CARBON DIOXIDE SENSOR |
| FDI | FLUORESCENT DIMMER INTERFACE |
| HIR | HUMIDITY INTERFACE RELAY |
| IAO | INTERFACE ANALOG OUTPUT |
| IFP | INTERFACE PANEL |
| IOM | INPUT/OUTPUT MODULE |
| IR | INTERFACE RELAY |
| C# | CONTACTOR |
| MINio | AHU INTERFACE AND/OR I/O MODULE |
| PLM | PHASE LOSS MONITOR |
| PSOP | POWER SWITCHING OVERRIDE PANEL |
| PSP | POWER SWITCHING PANEL |
| ROP | REMOTE OVERRIDE PANEL |
| ELDP | ECLIPSE LIGHT DIMMING PANEL |
| UCM | UNITARY CONTROL MODULE |
| ES1 | BAS CONTROLLER |
| LINGO EP/2 | BAS CONTROLLER |
| LINGO XE | BAS CONTROLLER |
| LCD | NOVAR LCD DISPLAY |
| (S) | MOMENTARY PUSH BUTTON SWITCH |
| ——— | NEW EQUIPMENT |
| ——— | EXISTING EQUIPMENT |
| — — — | FACTORY INSTALLED EQUIPMENT |
| - - - - | EQUIPMENT TO BE DEMOLISHED |

NOTE: ALL WORK ON THIS SHEET IS TO BE COMPLETED BY A WALMART APPROVED CONTRACTOR

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com
Cuhaci & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 PROTO: 188 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:19:55-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

BUILDING AUTOMATION SYSTEM

novar.

SHEET: BAS1

11/19/2021 11:29:06 AM
C:\Users\mohammed.khan\Documents\00767_LakeCity_FL_188_L_MEP_V20_mkhanVUDFE.rvt

## OCCUPANCY SENSOR NOTES

01.31.20

1. OCCUPANCY SENSORS IN RESTROOMS SHALL BE PROGRAMMED FOR AUTOMATIC ON AND MAXIMUM AVAILABLE TIME DELAY SETTINGS.
2. OCCUPANCY SENSORS IN DELI, PRODUCE, AND BAKERY PREP AREAS SHALL BE PROGRAMMED WITH MAXIMUM AVAILABLE TIME DELAY SETTINGS.
3. OCCUPANCY SENSORS IN WALK-IN COOLERS/FREEZERS SHALL BE LOW TEMPERATURE RATED, WALL MOUNTED 6" ABOVE DOOR, ADJUST AIMING FOR MAXIMUM COVERAGE, 10 MINUTE TIME DELAY.
4. ALL OTHER OCCUPANCY SENSORS SHALL BE PROGRAMMED WITH THE MINIMUM AVAILABLE TIME DELAY SETTING UNLESS NOTED OTHERWISE.
5. ALL SINGLE-POLE OCCUPANCY SENSORS SHALL BE PROGRAMMED FOR MANUAL ON LIGHTING CONTROL UNLESS NOTED OTHERWISE.
6. ALL BI-LEVEL OCCUPANCY SENSORS SHALL BE PROGRAMMED FOR AUTOMATIC ON LIGHTING CONTROL FOR 50% OF FIXTURES AND WITH MANUAL ON MODE FOR REMAINING FIXTURES.
7. WHERE TWO OCCUPANCY SENSORS ARE SHOWN IN THE SAME LOCATION WIRE FOR PARALLEL OPERATION.

## GENERAL LIGHTING NOTES

01.31.20

1. EXIT SIGN MOUNTING
   A. WALL FIXTURE: CENTER 12" ABOVE DOOR OPENING.
   B. CEILING FIXTURE: ON CEILING OR AT HEIGHT SPECIFIED ON DRAWINGS.
   C. PENDANT FIXTURE: MATCH HEIGHT OF EXISTING PENDANT MOUNTED EXIT SIGNS. IF STORE DOES NOT HAVE PENDANT MOUNTED EXIT SIGNS, THEN PENDANT MOUNT SIGN 24" BELOW BOTTOM OF BAR JOIST.
   D. VERIFY MOUNTING HEIGHT WITH AHJ.
   E. COORDINATE LOCATIONS OF EXIT SIGNS TO ENSURE STORE SIGNAGE DOES NOT OBSTRUCT THEIR VIEW.
   F. THE USE OF TRITIUM BASED RADIOACTIVE EXIT SIGNAGE IS PROHIBITED.
2. EMERGENCY LIGHT FIXTURE INSTALLATION
   A. WALL FIXTURE: 12" BELOW FINISHED CEILING OR +10'-0" IN AREAS OF EXPOSED STRUCTURE, UNLESS NOTED OTHERWISE.
   B. PENDANT FIXTURE: BOTTOM CHORD OF BAR JOIST OR AT HEIGHT SPECIFIED ON DRAWINGS.
   C. REMOTE HEAD FIXTURE: HEADS CENTERED ABOVE DOOR OPENING +9'-0", UNLESS NOTED OTHERWISE AND BATTERY PACK MOUNTED ON INTERIOR SIDE OF WALL 12" BELOW FINISHED CEILING OR AT BAR JOIST IN AREAS OF EXPOSED STRUCTURE.
   D. REFER TO MANUFACTURER'S WRITTEN INSTRUCTIONS. ALLOW BATTERY TO CHARGE CONTINUOUSLY FOR A MINIMUM OF 24 HOURS BEFORE INITIAL TESTING.
   E. AFTER EMERGENCY LIGHT HAS BEEN POWERED DO NOT TURN OFF FOR EXTENDED PERIODS OF TIME.
3. EXIT SIGNS, EMERGENCY LIGHTS AND NIGHT LIGHTS SHALL NOT BE SWITCHED.
4. IN AREAS OF OPEN STRUCTURE, MOUNT STRIP FIXTURE TO BOTTOM CHORD OF BAR JOIST, UNLESS NOTED OTHERWISE.
5. PROVIDE SEPARATE BOXES FOR GANGED SWITCHES ON SEPARATE BRANCH CIRCUITS.
6. FIXTURES DENOTED WITH "ABJ" ARE TO BE FASTENED ON UNISTRUT CHANNELS MOUNTED TO THE BOTTOM SIDE OF THE TOP CHORD OF BAR JOISTS. LOCATE THE FIXTURES RUNNING PERPENDICULAR TO BAR JOISTS WITHIN BAR JOISTS WEBBING SPACES. DO NOT FASTEN FIXTURE OR UNISTRUT CHANNELS TO ROOF DECK.

## KEYNOTES

| | |
|---|---|
| 16.125 | EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE. |
| 16.131 | CONNECT TO EXISTING CIRCUIT. |
| 16.718 | REMOVE EXISTING FLUORESCENT LAMPS, CONNECTORS AND BALLASTS FROM REFRIGERATED CASE AND SHELVES AND REPLACE WITH OWNER FURNISHED LED LIGHTING RETROFIT KIT. INSTALL LED POWER SUPPLY AND LIGHT BARS PER MANUFACTURER'S INSTRUCTIONS. |




1 LIGHTING PLAN
1" = 20'-0"

EXISTING LIGHTING FIXTURES NOT SHOWN ARE EXISTING TO REMAIN AND ARE NOT AFFECTED BY THE SCOPE OF WORK ON THIS PROJECT. THIS INCLUDES ALL GENERAL LIGHTING, EGRESS LIGHTING AND EXIT LIGHTING.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

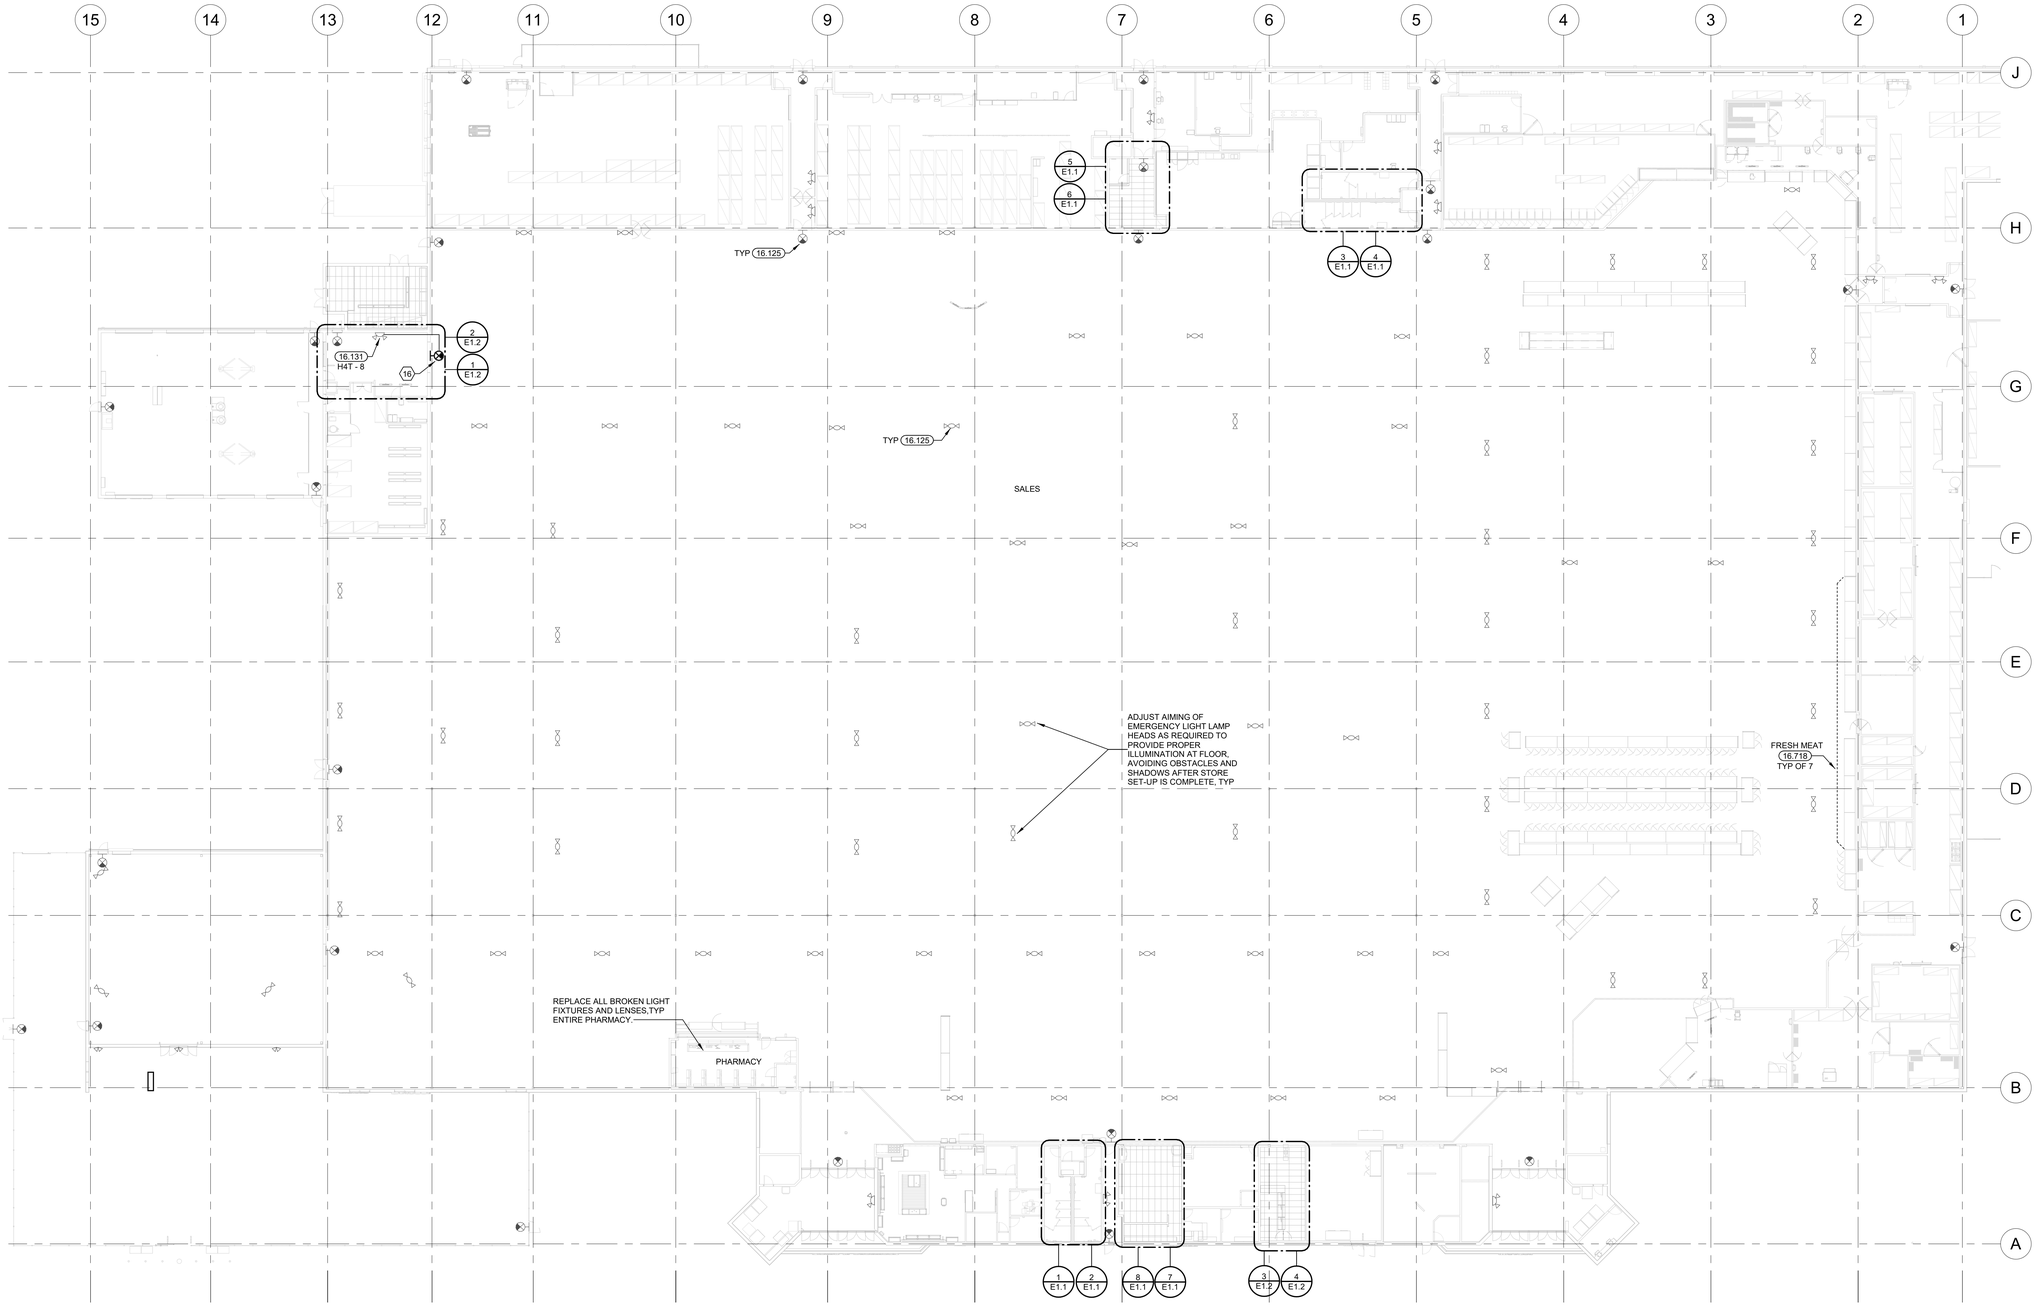
2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-2661
www.cpaarchitects.com
Cedars & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT TO BE CONTEMPORANEOUSLY WITH ITS ISSUE, MADE AVAILABLE FOR USE ON ANOTHER OR A DIFFERENT PROJECT SITE OR AT A LATER TIME WITHOUT THE EXPRESS WRITTEN PERMISSION OF CEDARS & PETERSON, INC. AND WITH PROPER COMPENSATION TO THE ARCHITECT. ANY UNAUTHORIZED USE, REUSE, ALTERATION OR EXTENSION OF THIS PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:20:09-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

LIGHTING PLAN

SHEET: E1

11/3/2021 11:35:25 AM
C:\Users\mmcdonald.kaist\Documents\WORK\1_Lake City_FL_168_L_MEP_KSL mkbaxkSDEE.rvt

## KEYNOTES

| | |
|---|---|
| 16.090 | REPLACE EXISTING LIGHT FIXTURES IN THIS AREA WITH TYPE AND QUANTITY INDICATED. INSTALL NEW LIGHT FIXTURE IN SAME LOCATION AS EXISTING LIGHT FIXTURE BEING REPLACED. RECONNECT TO EXISTING CIRCUITRY AND CONTROLS. COORDINATE EXACT LIGHT FIXTURES TO BE REPLACED WITH WALMART CONSTRUCTION MANAGER PRIOR TO PERFORMING WORK. |
| 16.125 | EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE. |
| 16.126 | EXISTING LIGHT FIXTURE TO BE DEMOLISHED. |
| 16.129 | CONNECT TO EXISTING CIRCUIT PREVIOUSLY SERVING AREA LIGHTING THAT WAS REMOVED. MAINTAIN EXISTING CIRCUIT CONTROL UNLESS NOTED OTHERWISE. PROVIDE CONSTANT HOT FOR EMERGENCY EXIT AND LOCALLY CONTROLLED LIGHT FIXTURES. |
| 16.131 | CONNECT TO EXISTING CIRCUIT. |
| 16.147 | BACKLIT MIRROR 120V/12V LED DRIVER AND RELAY (RIB2402D 277V COIL) INSTALLED ABOVE CEILING. LED DRIVER FURNISHED BY OTHERS, INSTALLED BY EC. RELAY, WIRING AND ALL FINAL CONNECTIONS FURNISHED AND INSTALLED BY EC. ROUTE 120V LED DRIVER CIRCUIT THROUGH RELAY. RELAY COIL SHALL BE CONTROLLED BY EXISTING 277V LIGHTING CONTROL. COORDINATE EXACT LOCATION OF CEILING ACCESS PANEL WITH GC AS REQUIRED. |

CONTRACTOR IS RESPONSIBLE FOR THE COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS WITH EVEN SPACING MAINTAINED.




8 CUSTOMER SERVICE LIGHTING PLAN
1/8" = 1'-0"




7 CUSTOMER SERVICE LIGHTING DEMO PLAN
1/8" = 1'-0"

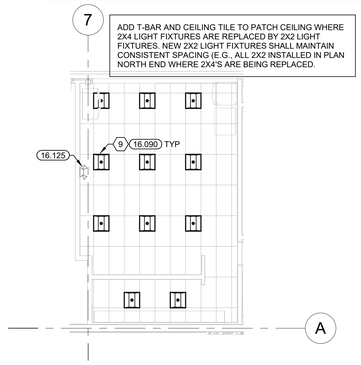


6 MOTHER'S ROOM LIGHTING PLAN
1/4" = 1'-0"

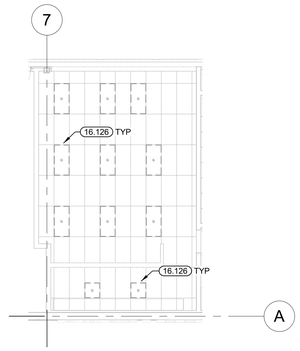


5 MOTHER'S ROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

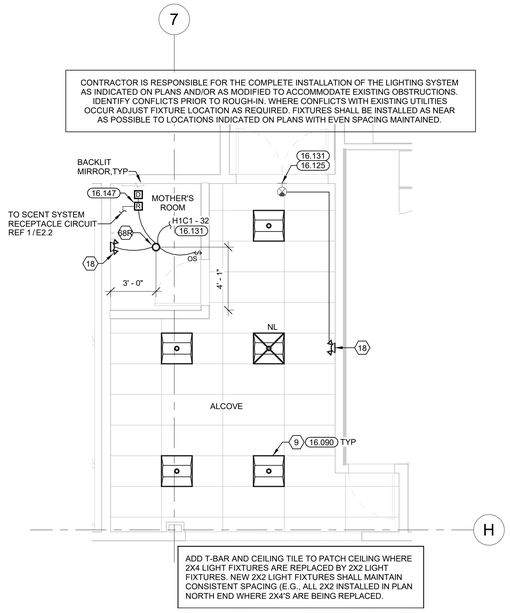


4 REAR RESTROOM LIGHTING PLAN
1/4" = 1'-0"

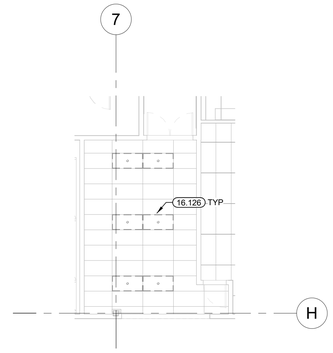


3 REAR RESTROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

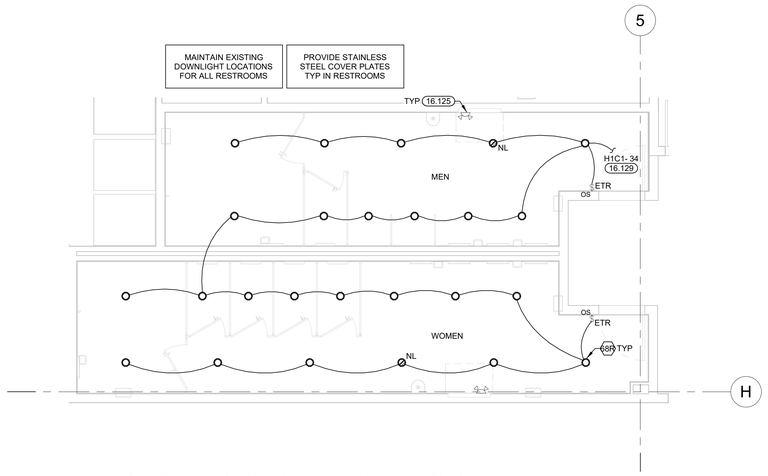


2 FRONT RESTROOM LIGHTING PLAN
1/4" = 1'-0"

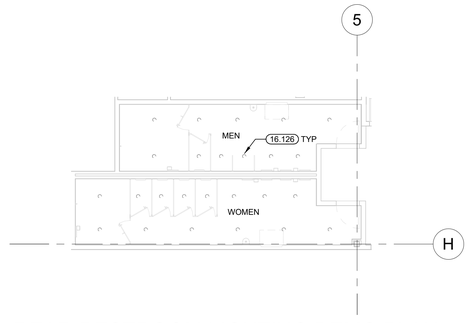


1 FRONT RESTROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

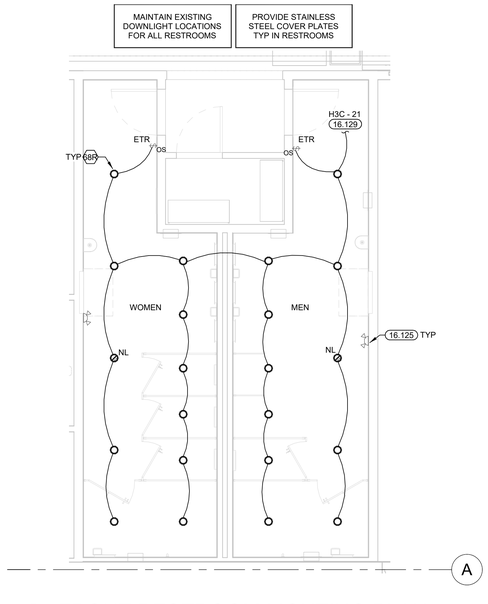EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cmpf.com
Cabaniss & Peterson
Architects Engineers Planners

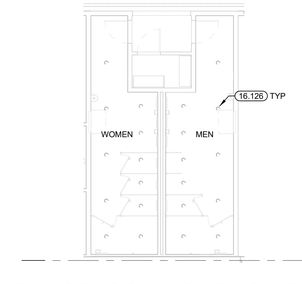
STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE, SUITABLE FOR REUSE ON EXTENSIONS OF THIS PROJECT OR ON ANY OTHER PROJECT. ANY REUSE WITHOUT WRITTEN VERIFICATION OR ADAPTATION BY THE ARCHITECT FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO THE ARCHITECT. ANY REUSE OF THIS PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO F.S. 481.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
Z210335 PROTO: 168 PROTO SC
JOB NUMBER:

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:23:56-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

ENLARGED LIGHTING PLANS

SHEET: E1.1


11/15/2021 11:35:35 AM
C:\Users\mmaki\Autodesk\Revit\Documents\0767Z_LakeCity_FL_168_L_MEP_VOL.mkmaki.rvt

## KEYNOTES

| | |
|---|---|
| 16.090 | REPLACE EXISTING LIGHT FIXTURES IN THIS AREA WITH TYPE AND QUANTITY INDICATED. INSTALL NEW LIGHT FIXTURE IN SAME LOCATION AS EXISTING LIGHT FIXTURE BEING REPLACED. RECONNECT TO EXISTING CIRCUITRY AND CONTROLS. COORDINATE EXACT LIGHT FIXTURES TO BE REPLACED WITH WALMART CONSTRUCTION MANAGER PRIOR TO PERFORMING WORK. |
| 16.125 | EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE. |
| 16.126 | EXISTING LIGHT FIXTURE TO BE DEMOLISHED. |




4 MONEY CENTER LIGHTING PLAN
1/8" = 1'-0"




3 MONEY CENTER LIGHTING DEMO PLAN
1/8" = 1'-0"

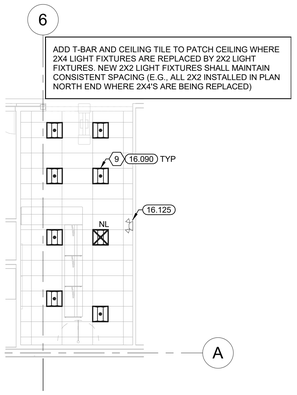


2 AUTOCARE CENTER CUSTOMER VIEWABLE LIGHTING PLAN
1/8" = 1'-0"

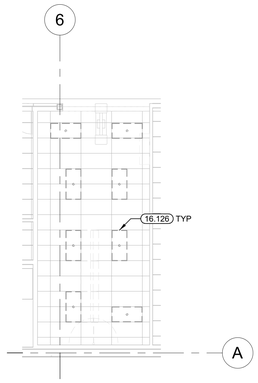


1 AUTOCARE CENTER LIGHTING DEMO PLAN
1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

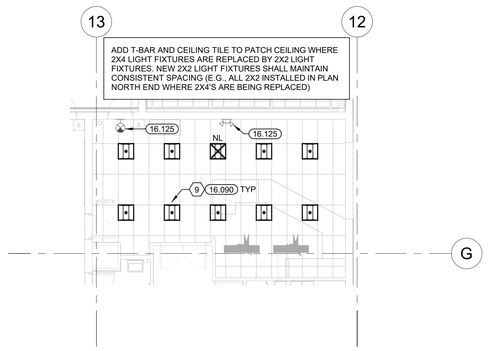EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


Cedarst & Peterson Architects Engineers Planners
3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cedarstpeterson.com

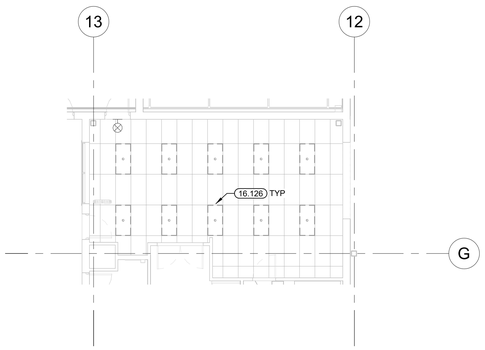
STIPULATION FOR RELISE


THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT A SPECIFIC TIME AND CONTEMPORANEOUSLY WITH ITS ISSUE. SUBSEQUENT USE OF THIS DRAWING ON A DIFFERENT PROJECT SITE OR AT A LATER TIME MAY BE HAZARDOUS. THIS DRAWING IS RESTRICTED TO ONE EXAMPLE ON ANOTHER PROJECT OR SITE WITHOUT THE EXPRESS WRITTEN CONSENT OF CEDARST & PETERSON ENGINEERS. REPRODUCTION OF THIS DRAWING IN WHOLE OR IN PART FOR USE ON PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:24:06-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER

11/22/21

ENLARGED LIGHTING PLANS

SHEET: E1.2

11/5/2021 11:29:40 AM
C:\Users\mmcdonald\Autodesk\Documents\RVT21_LakeCity_FL_168_L_MEP_V25_mbtaw1kVDE.rvt

## LIGHT FIXTURE SCHEDULE

"OW" FIXTURES AND LAMPS ARE FURNISHED BY THE OWNER FOR INSTALLATION BY THE CONTRACTOR. "GC" FIXTURES AND LAMPS ARE FURNISHED AND INSTALLED BY THE CONTRACTOR.

| TYPE | SUPPLIED BY | DESCRIPTION | VENDOR/MFR | MODEL | VOLTAGE | INPUT VA | COLOR TEMP | LIGHT SOURCE | LAMP QTY | MOUNTING | COUNT |
|---|---|---|---|---|---|---|---|---|---|---|---|
| 9 | OW | 2' x 2' VOLUMETRIC TROFFER | LOEB ELECTRIC CO | 2BLT2 40L ADSM GZ1 LP840 | 120/277 | 32 VA | 4000K | INTEGRAL LED | - | RECESSED | 34 |
| 16 | OW | EXIT SIGN (SINGLE FACE) | ACUITY BRANDS LIGHTING INC | RED: LQM S W 1 R 120/277 EL N SD90 M6<br>GREEN: LQM S W 1 G 120/277 EL N SD90 M6 | 120/277 | 4 VA | - | INTEGRAL LED | - | WALL | 1 |
| 18 | OW | EMERGENCY LIGHT | REXEL INC | EVHC6IDP-WM | 120/277 | 3 VA | - | INTEGRAL LED | - | WALL / CEILING | 2 |
| 48 | OW | PENDANT | REXEL INC | MLCP-DVD-206340CD-NN-M5L1-BK | 120/277 | 48 VA | 4000K | INTEGRAL LED | - | PENDANT | 2 |
| 68R | OW | CIRCULAR RECESSED DOWNLIGHT | ACUITY BRANDS LIGHTING INC | LBR6 07LM 40K AR LSS MWD MVOLT UGZ | 120/277 | 8 VA | 4000K | INTEGRAL LED | - | RECESSED | 48 |




3 SUSPENDED LIGHTING CONNECTIONS TO STRUCTURE
NTS 09/27/19




2 SALES FLOOR LIGHTING
NTS 07/27/18

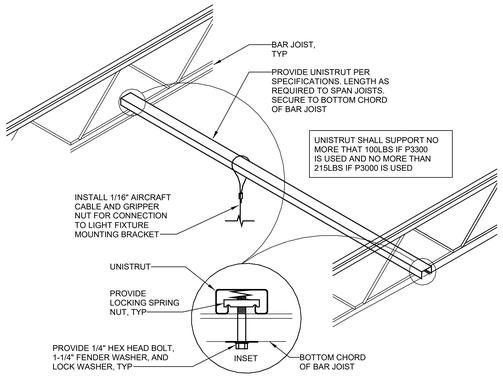


1 GENERAL ELECTRICAL CONNECTIONS TO STRUCTURE
NTS 07/27/18

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

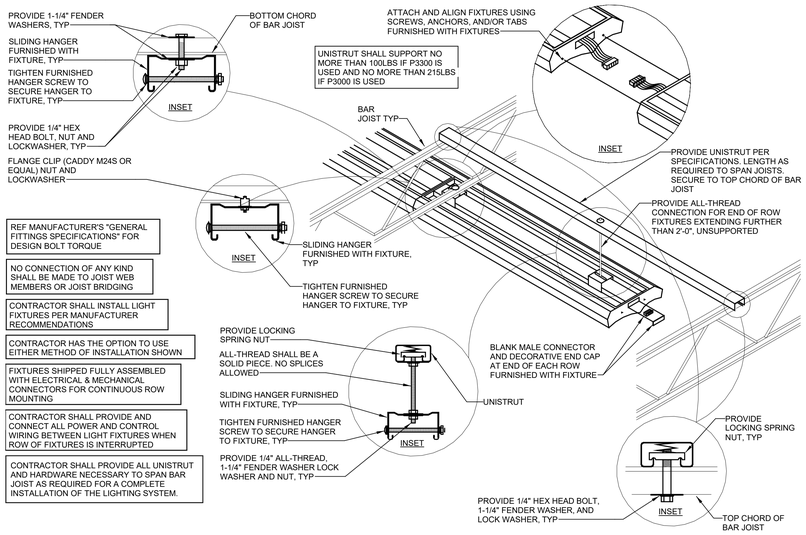EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cpaf.com
Cabaniss, Johnston, Gardner, Dumas & O'Neal, LLP
Cabaniss & Peterson
Architects Engineers Planners

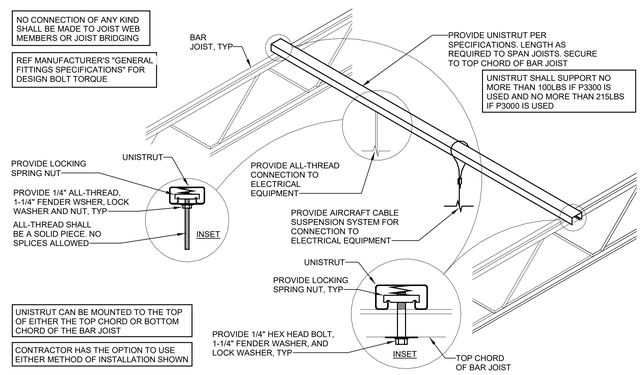
STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT CONTEMPORANEOUSLY WITH ITS ISSUE, SUITABLE FOR REUSE ON ANOTHER OR A DIFFERENT PROJECT SITE OR AT A LATER TIME. ANY REUSE WITHOUT WRITTEN VERIFICATION OR ADAPTATION BY CABANISS, JOHNSTON, GARDNER, DUMAS & O'NEAL LLP FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT OWNER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO THE ARCHITECT OR ENGINEER. REPRODUCTION OF THIS DRAWING IS EXPRESSLY PROHIBITED. ANY PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:24:21-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

LIGHTING DETAILS AND SCHEDULES

SHEET: E1.3

11/19/2021 11:29:42 AM
C:\Users\mdickens\AppData\Local\Temp\acpublish_1424\Clay_FL_WB_LMEP_V20_mdickensMJDFE.rvt




1 POWER PLAN
1" = 20'-0"

## GENERAL POWER NOTES

07.26.19

1. TELEPOWER POLE(S); MOUNT JUNCTION BOX(ES) TO TOP SIDE OF BOTTOM CHORD OF BAR JOIST. INSTALL FURNISHED POWER POLE AND TERMINATE WIRING TO JUNCTION BOX. PROVIDE UNISTRUT SUPPORTS AND HARDWARE TO SECURE TELEPOWER POLE PLUMB TO BUILDING STRUCTURE. REF POWER POLE CONNECTION DETAIL.
2. PROVIDE LIQUID-TIGHT FLEXIBLE METAL CONDUIT AND WIRING FROM DISCONNECT SWITCH OR JUNCTION BOX TO EQUIPMENT KNOCKOUT OR ELECTRICAL CONNECTION POINT.
3. WHERE EQUIPMENT NAMEPLATE PROTECTIVE DEVICE RATING DIFFERS FROM SIZE PROVIDED, NOTIFY WALMART CONSTRUCTION MANAGER IMMEDIATELY TO COORDINATE RESOLUTION.
4. ELECTRONIC FIRE PROTECTION/SECURITY ALARM BOXES AND CONDUITS SHOWN ON POWER PLANS SHALL BE PROVIDED UNDER THIS CONTRACT. IN ADDITION, UNLESS NOTED OTHERWISE, THE FOLLOWING GENERAL NOTES APPLY:
   A. ALL ALARM JUNCTION BOXES SHALL BE 4"X4"X2-1/8" MINIMUM.
   B. ALARM RACEWAYS SHALL BE 3/4" MINIMUM WITH PULL WIRE AND INSULATING BUSHINGS AT END OF VERTICAL RACEWAY RUN.
   C. VERTICAL RACEWAYS FROM ALARM BOXES SHALL BE EITHER CONCEALED INSIDE WALL OR SURFACE MOUNTED (TO MATCH JUNCTION BOX MOUNTING). ALL VERTICAL RUNS SHALL BE TURNED 90-DEGREES AT TOP SIDE OF BOTTOM CHORD OF BAR JOIST AND EXTENDED HORIZONTALLY TO A LOCATION ACCESSIBLE BY VERTICAL FLOOR TYPE LIFT.
5. UPON COMPLETION OF ELECTRICAL INSTALLATION AND PRIOR TO ENERGIZING CIRCUIT:
   A. INSPECT WIRE AND CABLE FOR PHYSICAL DAMAGE.
   B. PERFORM CONTINUITY TEST.
   C. VERIFY PROPER PHASING CONNECTION TO ALL THREE PHASE MOTOR LOADS.
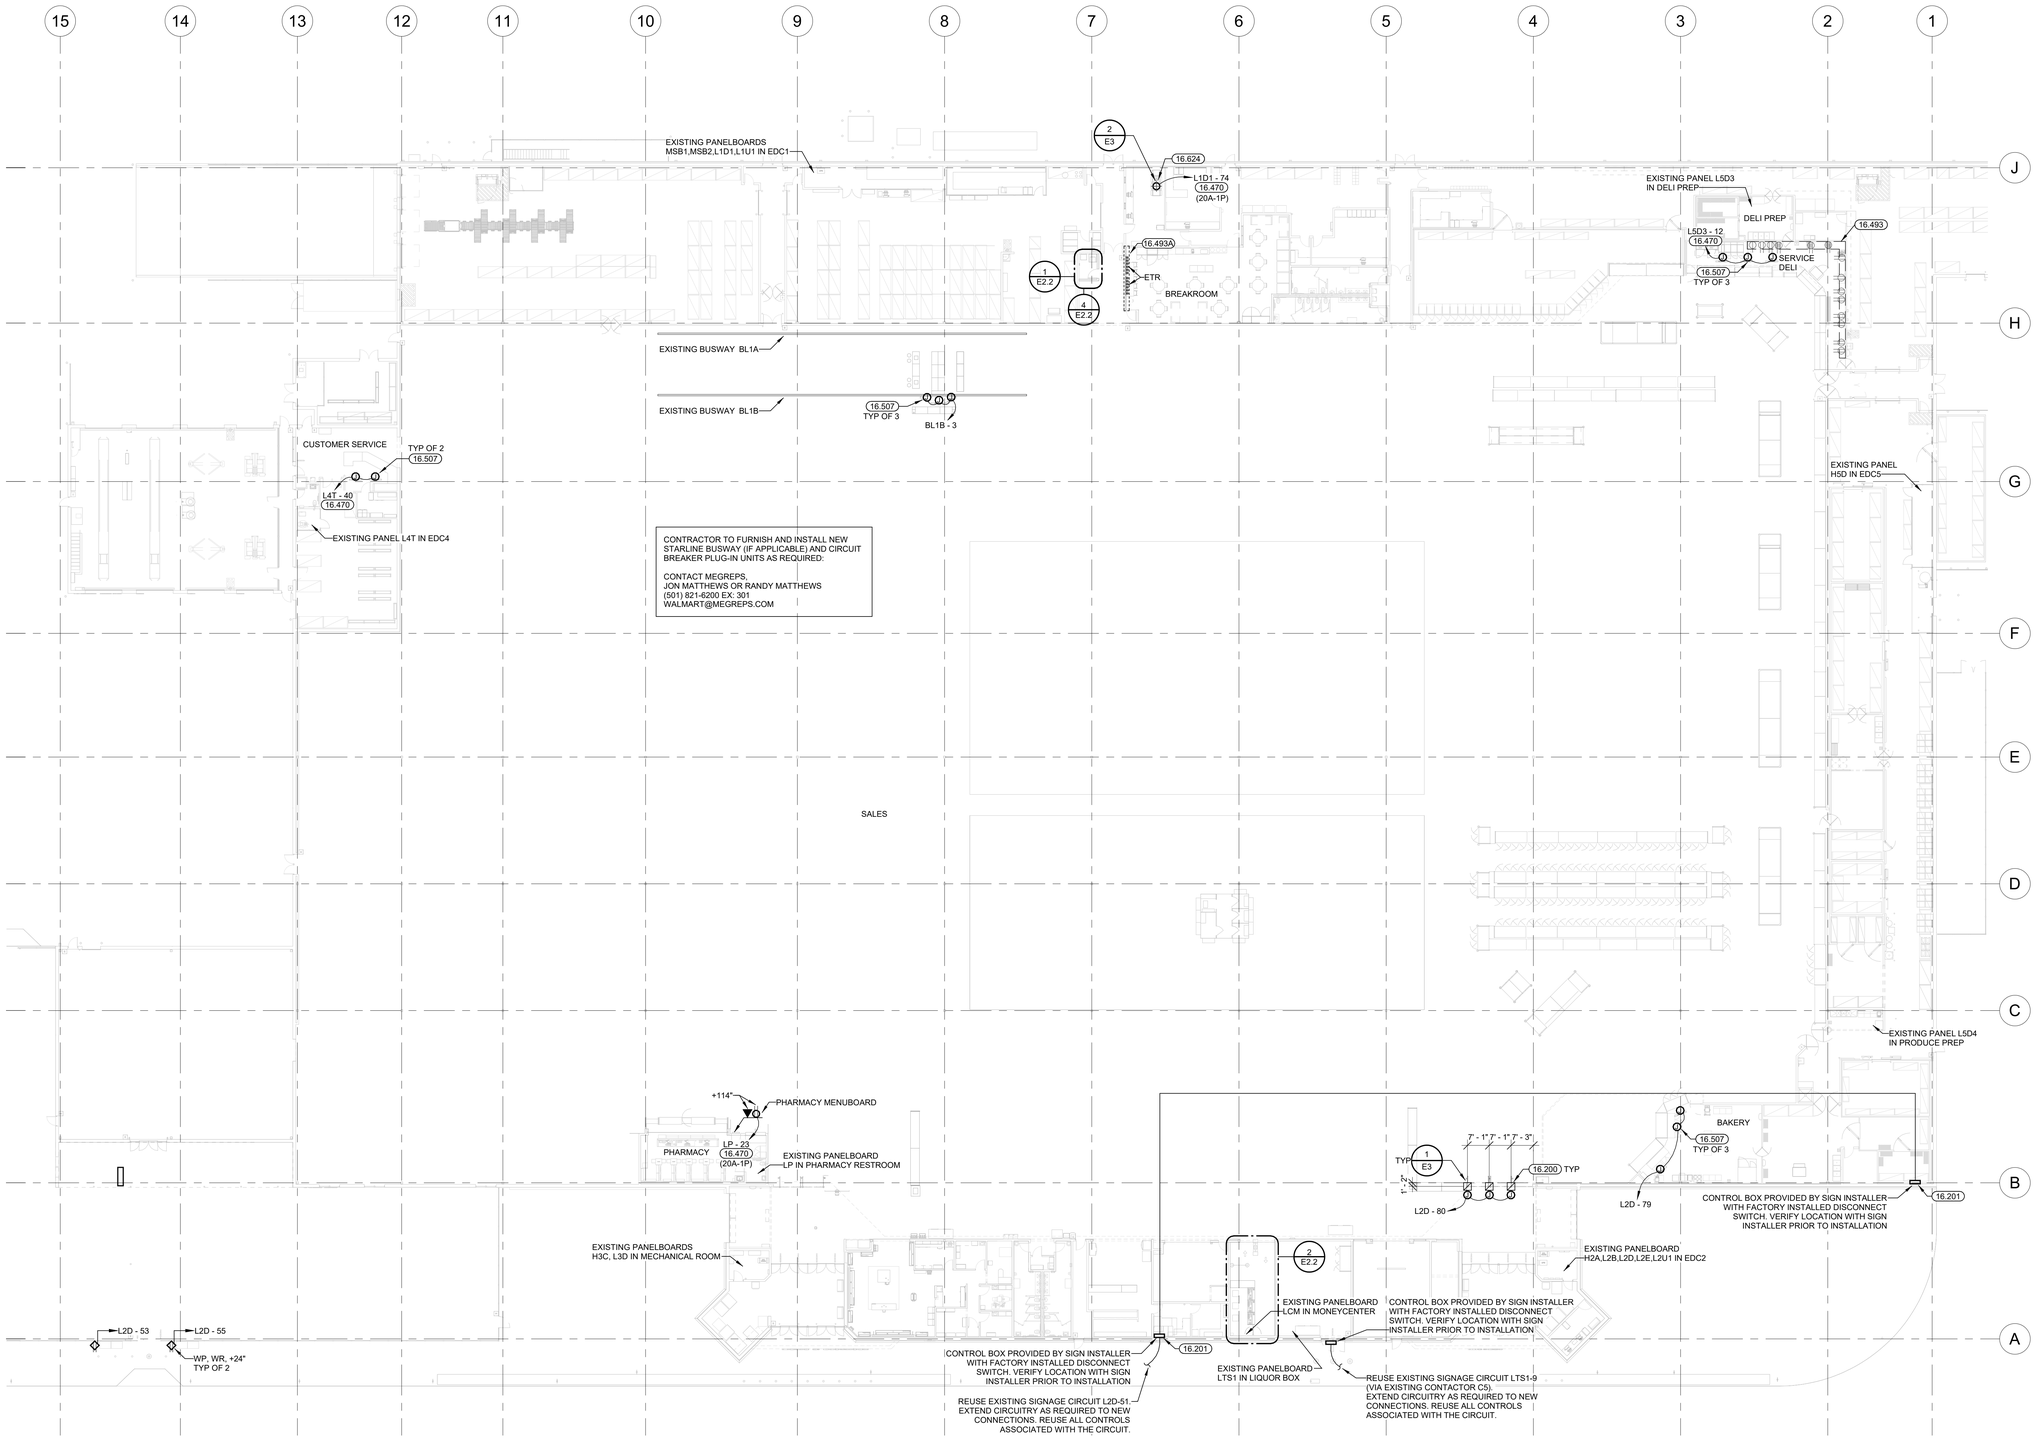
## KEYNOTES

16.200 INSTALL OWNER FURNISHED BLANK POWER POLE ON SALES FLOOR SIDE OF GATE SUCH THAT GATE OPERATION IS NOT OBSTRUCTED. ORIENT POLE SUCH THAT MOUSE HOLE IS FACING GATE POST. ROUTE FLEXIBLE METALLIC CONDUIT THROUGH POWER POLE AND PROVIDE DIRECT CONNECTION TO GATE POST(S). DO NOT ROUTE METALLIC CONDUIT ON FLOOR. INSTALL FURNISHED 2 PIN AND 6 PIN CROSSLINK CABLES FOR EACH GATE PAIR TO ENSURE SIMULTANEOUS OPERATION. UTILIZE CABLE DUCT AND POWER POLES TO ROUTE CROSSLINK CABLES.

16.201 EXTERIOR SIGN POWER: WHERE ELECTRICAL CONNECTIONS FOR SIGNAGE OCCUR BELOW ROOF LINE, ROUTE POWER TO WALL AT SIGN CONTROL BOX(ES). WHERE ELECTRICAL CONNECTIONS FOR SIGNAGE OCCUR ABOVE ROOF LINE, PROVIDE UNISTRUT TO MOUNT CONTROL BOX(ES) TO BACK SIDE OF PARAPET. LOW VOLTAGE WIRING FROM CONTROL BOX(ES) TO SIGN PROVIDED AND INSTALLED BY OTHERS. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT SIGN LOCATION(S) PRIOR TO INSTALLATION. PROVIDE ONLY ONE PENETRATION THROUGH THE ROOF. REF ARCHITECTURAL EXTERIOR WALL SECTIONS AND SIGN ATTACHMENT FOR ROOF AND PARAPET PENETRATION REQUIREMENTS.

16.470 FURNISH AND INSTALL NEW 20 AMP, 120 VOLT CIRCUIT(S). FEED FROM PANELBOARD AS INDICATED. PROVIDE 20A-1P CIRCUIT BREAKER IF NEEDED. E.C. SHALL MATCH MANUFACTURER, TYPE AND AIC RATINGS OF EXISTING CIRCUIT BREAKERS.

16.493 WALL FINISH TO BE REPLACED. REMOVE AND REINSTALL ELECTRICAL DEVICES AND VOICE/DATA OUTLETS AS REQUIRED FOR INSTALLATION OF NEW WALL FINISH. UTILIZE UL LISTED BOX EXTENDERS AS REQUIRED TO ENSURE COMPLIANT INSTALLATION. RECEPTACLES SHALL BE REPLACED WITH NEW GRAY GFCI DEVICES. PROVIDE NEW STAINLESS STEEL COVERPLATES FOR ELECTRICAL AND VOICE/DATA DEVICES. IF SURFACE MOUNTED CONDUIT/DEVICES ARE ENCOUNTERED REPLACE WITH CONCEALED CONDUIT AND RECESSED DEVICES.

16.493A WALL FINISH TO BE REPLACED. REMOVE AND REINSTALL ELECTRICAL DEVICES AND VOICE/DATA OUTLETS AS REQUIRED FOR INSTALLATION OF NEW WALL FINISH. UTILIZE UL LISTED BOX EXTENDERS AS REQUIRED TO ENSURE COMPLIANT INSTALLATION. RECEPTACLES SHALL BE REPLACED WITH NEW WHITE DEVICES. PROVIDE NEW WHITE COVERPLATES FOR ELECTRICAL AND VOICE/DATA DEVICES. IF SURFACE MOUNTED CONDUIT/DEVICES ARE ENCOUNTERED REPLACE WITH CONCEALED CONDUIT AND FLUSH MOUNTED DEVICES TO SLAT WALL BACKING BOARD.

16.507 DIGITAL DISPLAYS: MOUNT JUNCTION BOX AT STRUCTURE. AFTER INSTALLATION OF DROP POLE AND DISPLAY MOUNTING BRACKET, EXTEND CONDUCTORS IN ½" FLEXIBLE METAL CONDUIT, ROUTED INSIDE DROP POLE, TO DISPLAY MOUNTING BRACKET. PROVIDE 120V, 20A DUPLEX RECEPTACLE ON REAR OF DISPLAY MOUNTING BRACKET AND MAKE FINAL TERMINATIONS. COORDINATE DISPLAY LOCATIONS WITH STORE SETUP SUPERVISOR.

16.624 FURNISH AND INSTALL RACK MOUNTED PDU TRIPP LITE MODEL# PDU1220T OR EQUAL. COORDINATE CEILING RECEPTACLE AND PDU LOCATION WITH WALMART SECURITY MANAGER DURING PRE-CONSTRUCTION. ALL WORK SHALL BE COMPLETED AND AVAILABLE FOR SOUND SYSTEM INSTALLATION NO LATER THAN 21 DAYS FROM CONSTRUCTION START DATE. SOUND SYSTEM EQUIPMENT BY OTHERS.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8999
www.cmpae.com
Cabaniss & Peterson Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND IS NOT TO BE CONTEMPORANEOUSLY WITH ITS ISSUE, EXCEPT BY AGREEMENT OR WRITTEN PERMISSION OF CABANISS & PETERSON ARCHITECTS ENGINEERS PLANNERS. ANY UNAUTHORIZED REUSE OF THESE DRAWINGS WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT AND ENGINEER SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO CABANISS & PETERSON ARCHITECTS ENGINEERS PLANNERS. REPRODUCTION OF THIS DRAWING IN WHOLE OR IN PART FOR ANY PURPOSE OTHER THAN THE CONSTRUCTION OF THIS PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: Z210335 PROTO: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:24:32-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

POWER PLAN

SHEET: E2


11/19/2021 11:30:08 AM
C:\Users\mdawson.kiser\Documents\0767_Lake City_FL_NB_L_MEP_VSL_mkiser.rvt




CONTRACTOR TO FURNISH AND INSTALL NEW STARLINE BUSWAY (IF APPLICABLE) AND CIRCUIT BREAKER PLUG-IN UNITS AS REQUIRED:

CONTACT MEGREPS,
JON MATTHEWS OR RANDY MATTHEWS
(501) 821-6200 EX: 301
WALMART@MEGREPS.COM

EXISTING TELEPOWER POLES: ALL EXISTING TELEPOWER POLES IN OPEN STRUCTURE AREAS THROUGHOUT THE STORE SHALL BE SECURED SIMILAR TO DETAIL 1-E3 WITH OPTION OF UTILIZING 2-1 1/2 INCH RIGID PVC SPLIT DUCT TYPE SLEEVE FROM PRIME CONDUIT MWE INC, VIKIMATIC, OR INNERDUCT. COORDINATE WORK WITH WALMART STORE MANAGER AND CONSTRUCTION MANAGER TO MINIMIZE DISRUPTIONS TO STORE OPERATION AND ANY EQUIPMENT SERVED BY EACH POWER POLE.

1 POWER DROP PLAN
1" = 20'-0"
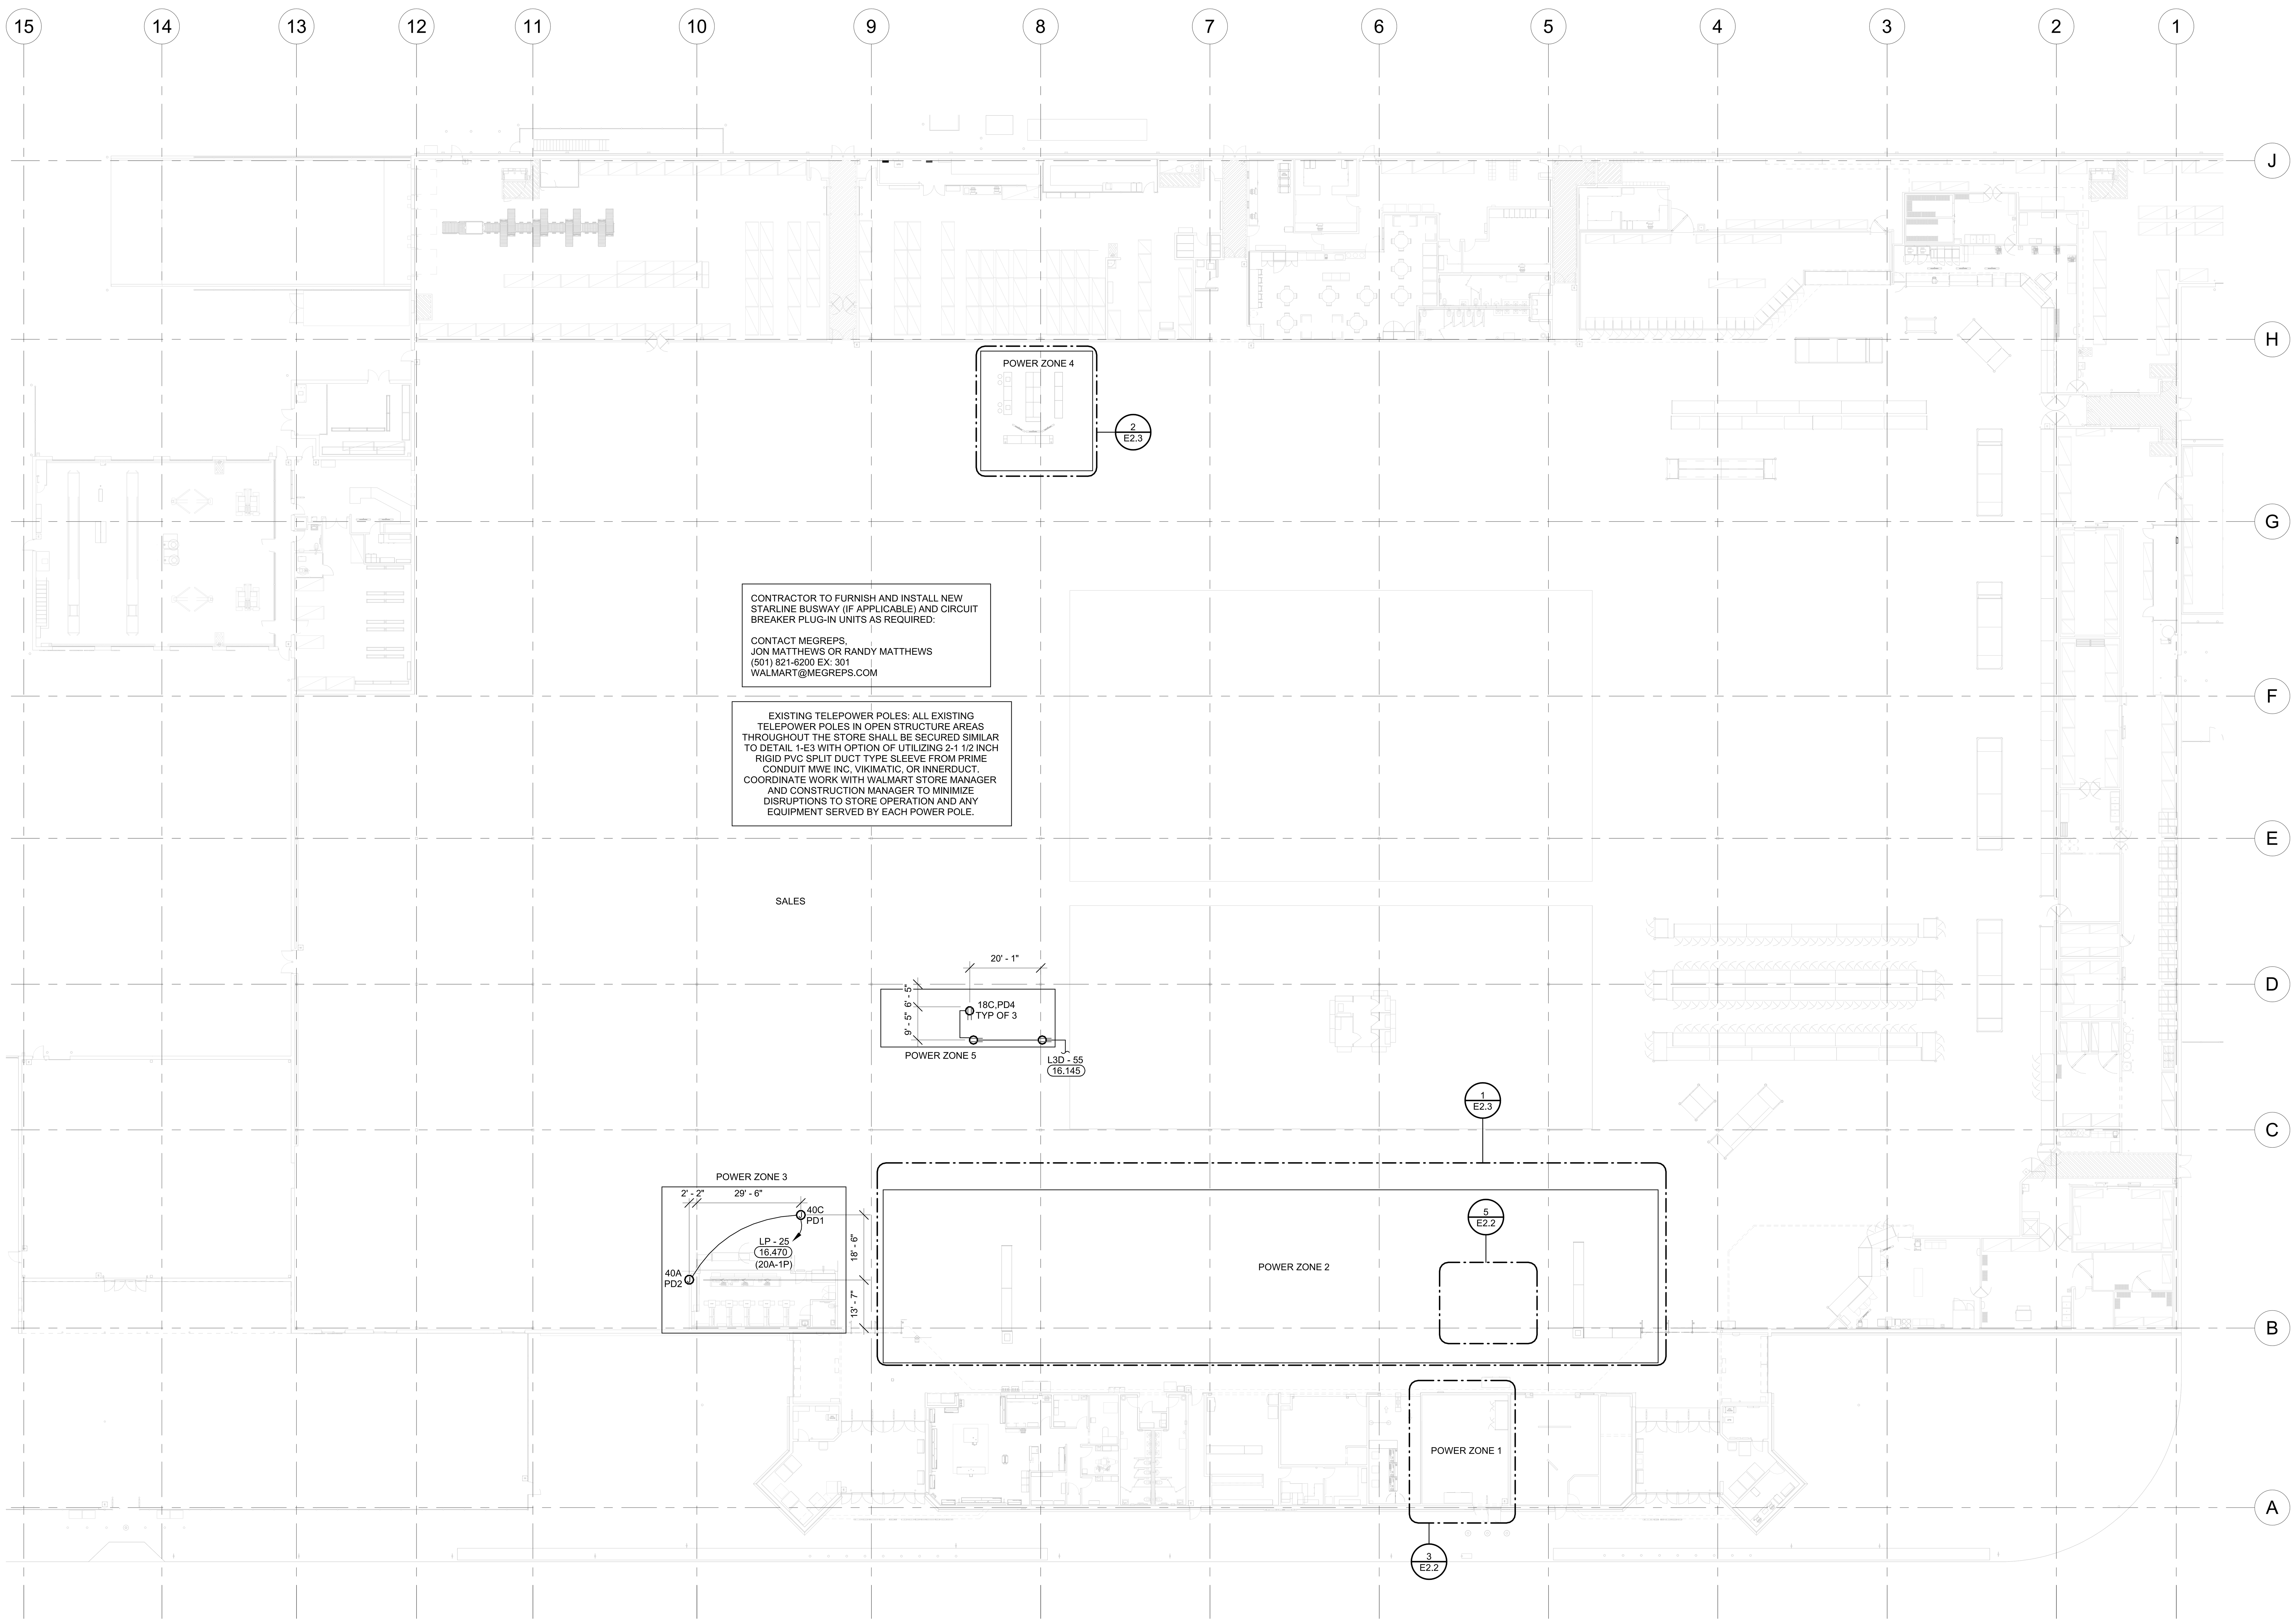
## POWER DROP SCHEDULE

07.28.17

| NO. | DESCRIPTION |
|---|---|
| PD1 | MOUNT RECEPTACLE(S) ON TOP OF DISPLAY UNIT(S) |
| PD2 | MOUNT RECEPTACLE(S) 6" ABOVE BASE OF DISPLAY ON UNIT(S) SO THAT RECEPTACLE(S) AND CONDUIT DO NOT INTERFERE WITH SHELF HEIGHT ADJUSTMENTS |
| PD3 | PROVIDE DIRECT CONNECTION TO EQUIPMENT |
| PD4 | OPEN STRUCTURE: MOUNT RECEPTACLE AT BAR JOIST AND INSTALL FURNISHED CORD REEL.<br><br>LAY-IN CEILING: PROVIDE RECESSED CEILING RECEPTACLE AND INSTALL FURNISHED CORD REEL BELOW CEILING. CORD REEL SHALL BE MOUNTED TO CEILING FAN RATED JUNCTION BOX SECURED TO LAY-IN CEILING WITH T-BAR BOX HANGER. PROVIDE 1/2" THREADED STEEL ROD FROM JUNCTION BOX TO BOTTOM OF STRUCTURAL JOIST OR CHANNEL STRUT BRIDGING ABOVE FOR SUPPORT. |

## POWER DROP NOTES

09.25.20

1. POWER DROPS WILL BE IDENTIFIED BY AN IPTV TAG OR POWER TAG, I.E. 44A, 46E, ETC. ALL CHECKOUT POWER SHALL BE CONSIDERED POWER DROPS.
2. A REVISION OF THIS PLAN BASED ON THE FINAL MERCHANDISE LAYOUT MAY BE ISSUED TO SHOW FINAL LOCATIONS FOR THE POWER DROPS. IF THE MERCHANDISE PLAN DOES NOT CHANGE, THIS PLAN WILL NOT BE REISSUED. PROVIDE CIRCUITRY TO DISPLAY RACKS AS THE RACKS ARE SET. IN ADDITION, THE FOLLOWING POWER DROP NOTES APPLY:
   A. THERE WILL BE NO ADDITIONAL CHARGE FOR DROP RELOCATION WITHIN POWER DROP ZONES DEFINED ON DRAWING.
   B. AT CLOSE OF PROJECT THE GENERAL CONTRACTOR AND CONSTRUCTION MANAGER SHALL REVIEW ADDITIONAL OR DELETED POWER DROPS WITHIN EACH ZONE TO VERIFY ANY ADDITIONAL CHARGES OR CREDITS THAT APPLY DUE TO CHANGES.
   C. ADDING OR SUBTRACTING A POWER DROP TO ANY ZONE WILL RESULT IN A CHARGE OR CREDIT ACCORDING TO SPECIAL CONDITIONS.
3. PROVIDE JUNCTION BOX AND CIRCUITRY TO NEAREST JOIST ABOVE LOCATION SHOWN ON DRAWING. EXTEND CONDUIT AND CIRCUITRY FROM JUNCTION BOX TO ENDCAP OF DISPLAY RACK.
4. WHEN EXPOSED VERTICAL CONDUIT FROM STRUCTURAL CONNECTION TO GONDOLA/EQUIPMENT EXCEEDS 10 FEET, INTERMEDIATE METALLIC CONDUIT (IMC) SHALL BE USED IN LIEU OF ELECTRICAL METALLIC CONDUIT (EMT). THE IMC CONDUIT AND COUPLINGS SHALL BE THREADED AND BE SECURELY FASTENED AT THE GONDOLA/EQUIPMENT AND AT STRUCTURE.
5. PROVIDE CONDUIT, RECEPTACLE(S) AND FINAL CONNECTIONS AT DISPLAY RACK SHELVING PER POWER DROP SCHEDULE UNLESS NOTED OTHERWISE ON DRAWING. VERIFY EXACT HEIGHT AND LOCATION OF RECEPTACLE(S) WITH STORE PLANNING SET-UP SUPERVISOR PRIOR TO INSTALLATION.
6. POWER DROPS FED FROM TRACK BUSWAY: INSTALL PLUG-IN UNIT AT A POINT ON TRACK BUSWAY NEAREST POWER DROP(S).

## KEYNOTES

| | |
|---|---|
| 16.145 | CONNECT CIRCUIT(S) TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE NOTED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO USE TO ENSURE THAT THEY MEET REQUIRED SIZE, AND ALL U.L. RATINGS AND REPLACE AS REQUIRED. |
| 16.470 | FURNISH AND INSTALL NEW 20 AMP, 120 VOLT CIRCUIT(S). FEED FROM PANELBOARD AS INDICATED. PROVIDE 20A-1P CIRCUIT BREAKER IF NEEDED. E.C. SHALL MATCH MANUFACTURER, TYPE AND AIC RATINGS OF EXISTING CIRCUIT BREAKERS. |

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

Cuhaci & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com
Florida Corporate Certificate #AA C000526

STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
JOB NUMBER: 2210335 PROTO: 188 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:25:00-05'00'

JAISON PRADEEP MORAS
LICENSE
No 76917
STATE OF FLORIDA
PROFESSIONAL ENGINEER
11/22/21

POWER DROP PLAN

SHEET:
E2.1

11/19/2021 11:30:34 AM
C:\Users\mohammed.khan\Documents\00767_LakeCity_FL_188_L_MEP_V20_mkhanVUDFE.rvt

# KEYNOTES

16.131 CONNECT TO EXISTING CIRCUIT.

16.145 CONNECT CIRCUIT(S) TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE NOTED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO USE TO ENSURE THAT THEY MEET REQUIRED SIZE, AND ALL U.L. RATINGS AND REPLACE AS REQUIRED.

16.492 E.C. SHALL COORDINATE WITH GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF ELECTRICAL DEMOLITION. REMOVE UNUSED DEVICES, BOXES, CONDUITS, AND WIRING BACK TO ORIGINATING JUNCTION BOXES OR PANELBOARDS. REFERENCE POWER PLANS FOR CIRCUITRY TO BE REUSED. DEMOLITION SHALL NOT AFFECT ACTIVE CIRCUITS. IF CIRCUIT IS DEMOLISHED ALL THE WAY TO PANELBOARD, REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER PLATE. UPDATE TYPEWRITTEN CIRCUIT DIRECTORY IDENTIFYING CIRCUIT AS "SPACE". COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS PRIOR TO BID.

16.619 PROVIDE RECESSED ALARM JUNCTION BOX IN CEILING WITH 4"x4"x1-1/2" EXTENSION RING WITH RACEWAY ROUTED TO NEAREST ACCESSIBLE CEILING SPACE.




## 5 PICKUP TOWER DEMO PLAN

1/8" = 1'-0"




## 4 MOTHER'S ROOM POWER DEMO PLAN

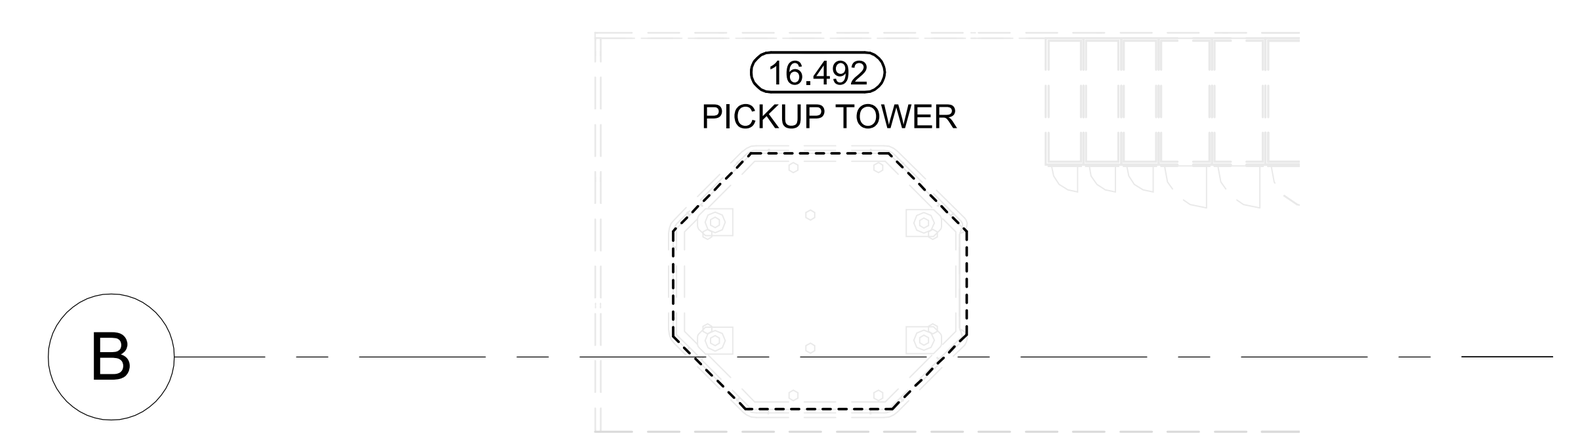1/4" = 1'-0"




## 3 LIQUOR BOX POWER PLAN

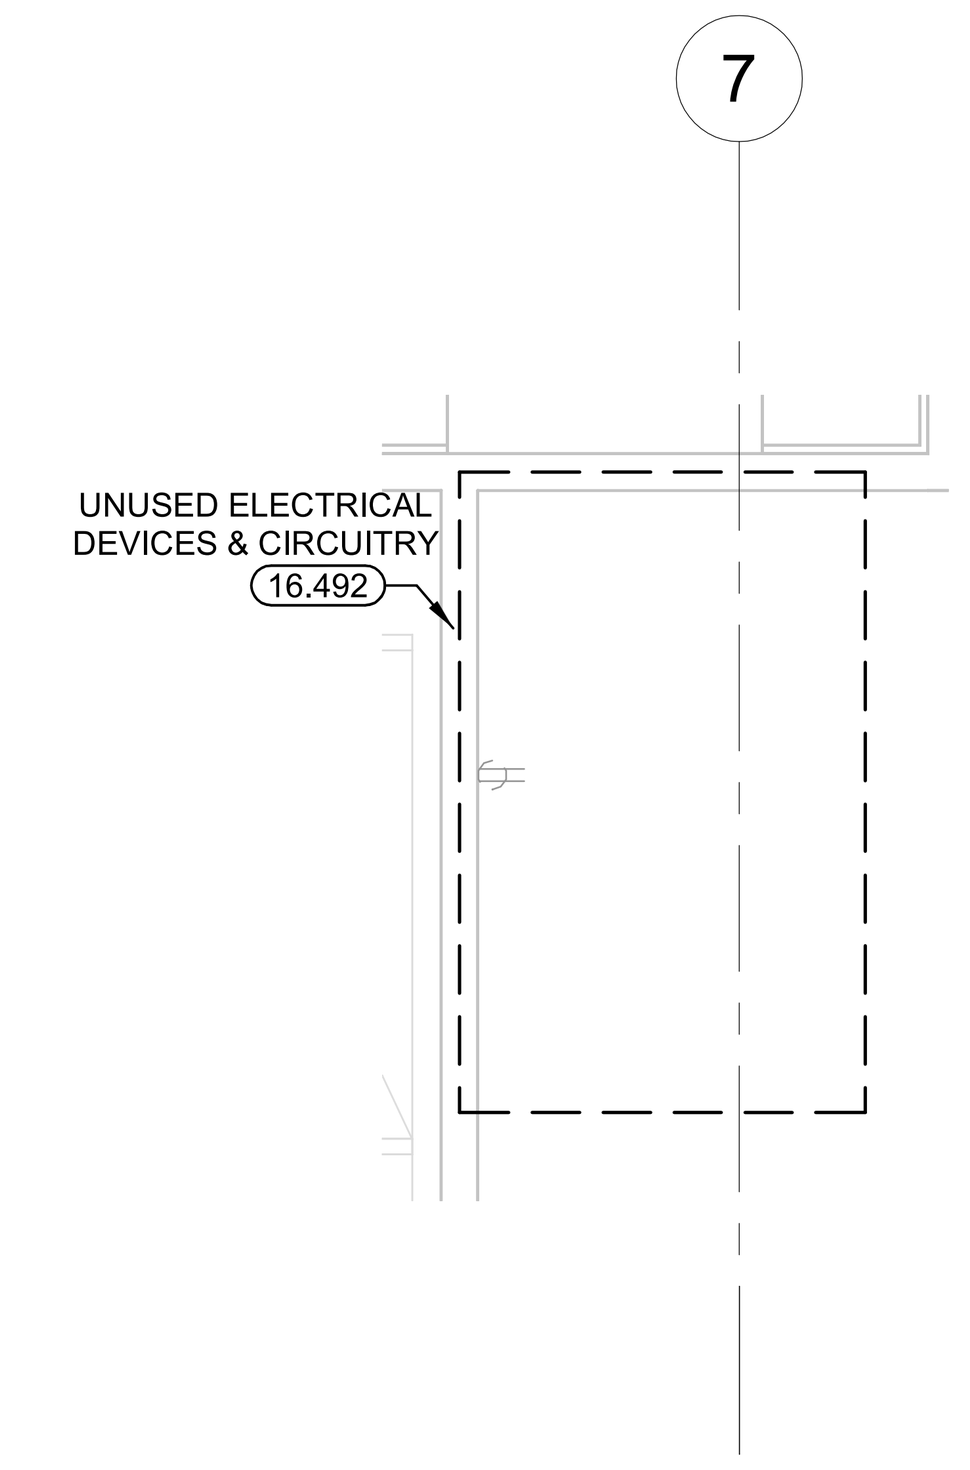1/8" = 1'-0"




## 2 MONEYCENTER POWER PLAN

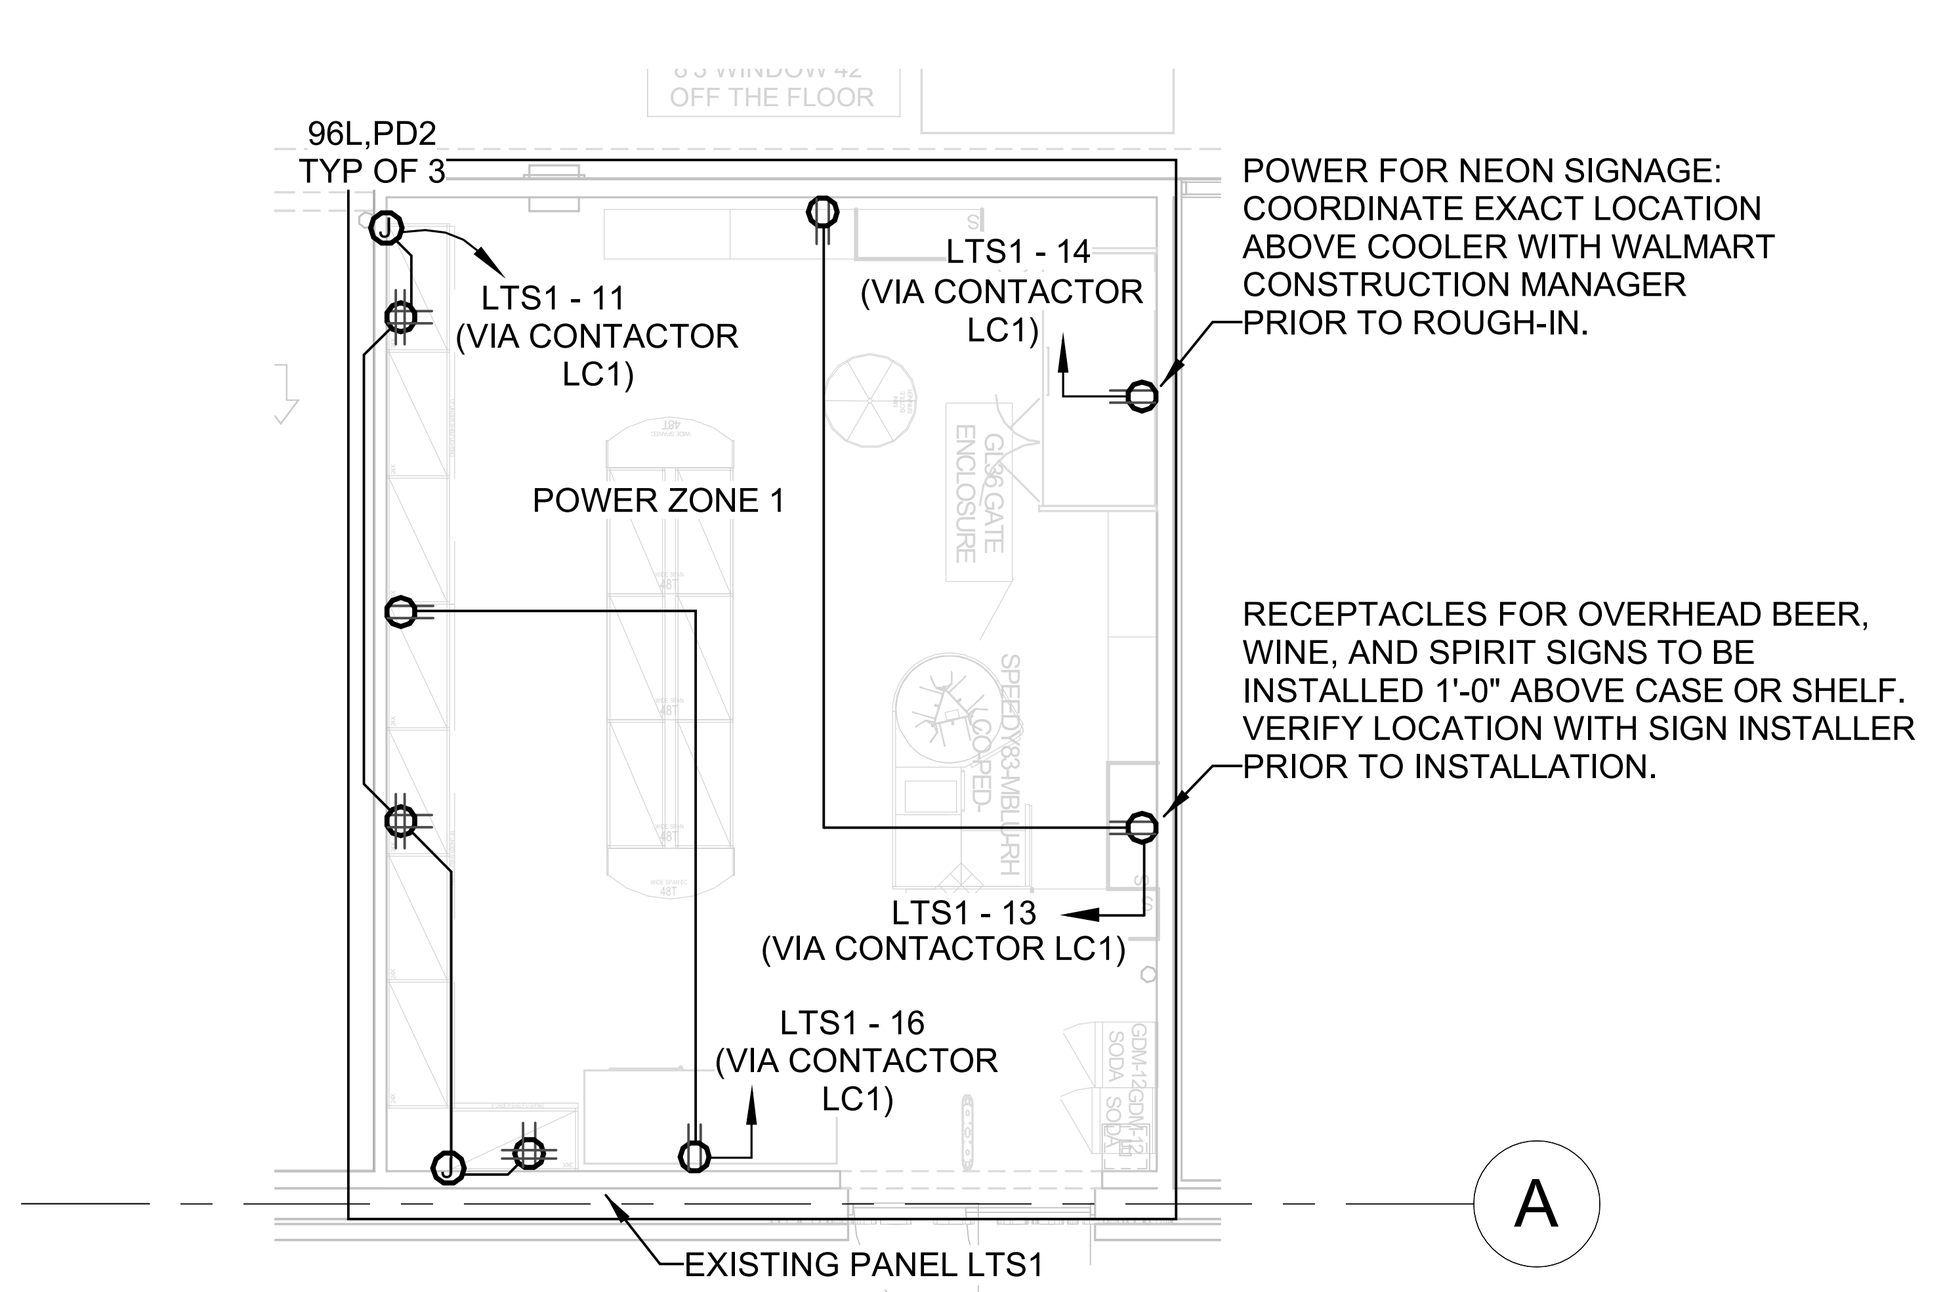1/4" = 1'-0"




## 1 MOTHER'S ROOM POWER PLAN

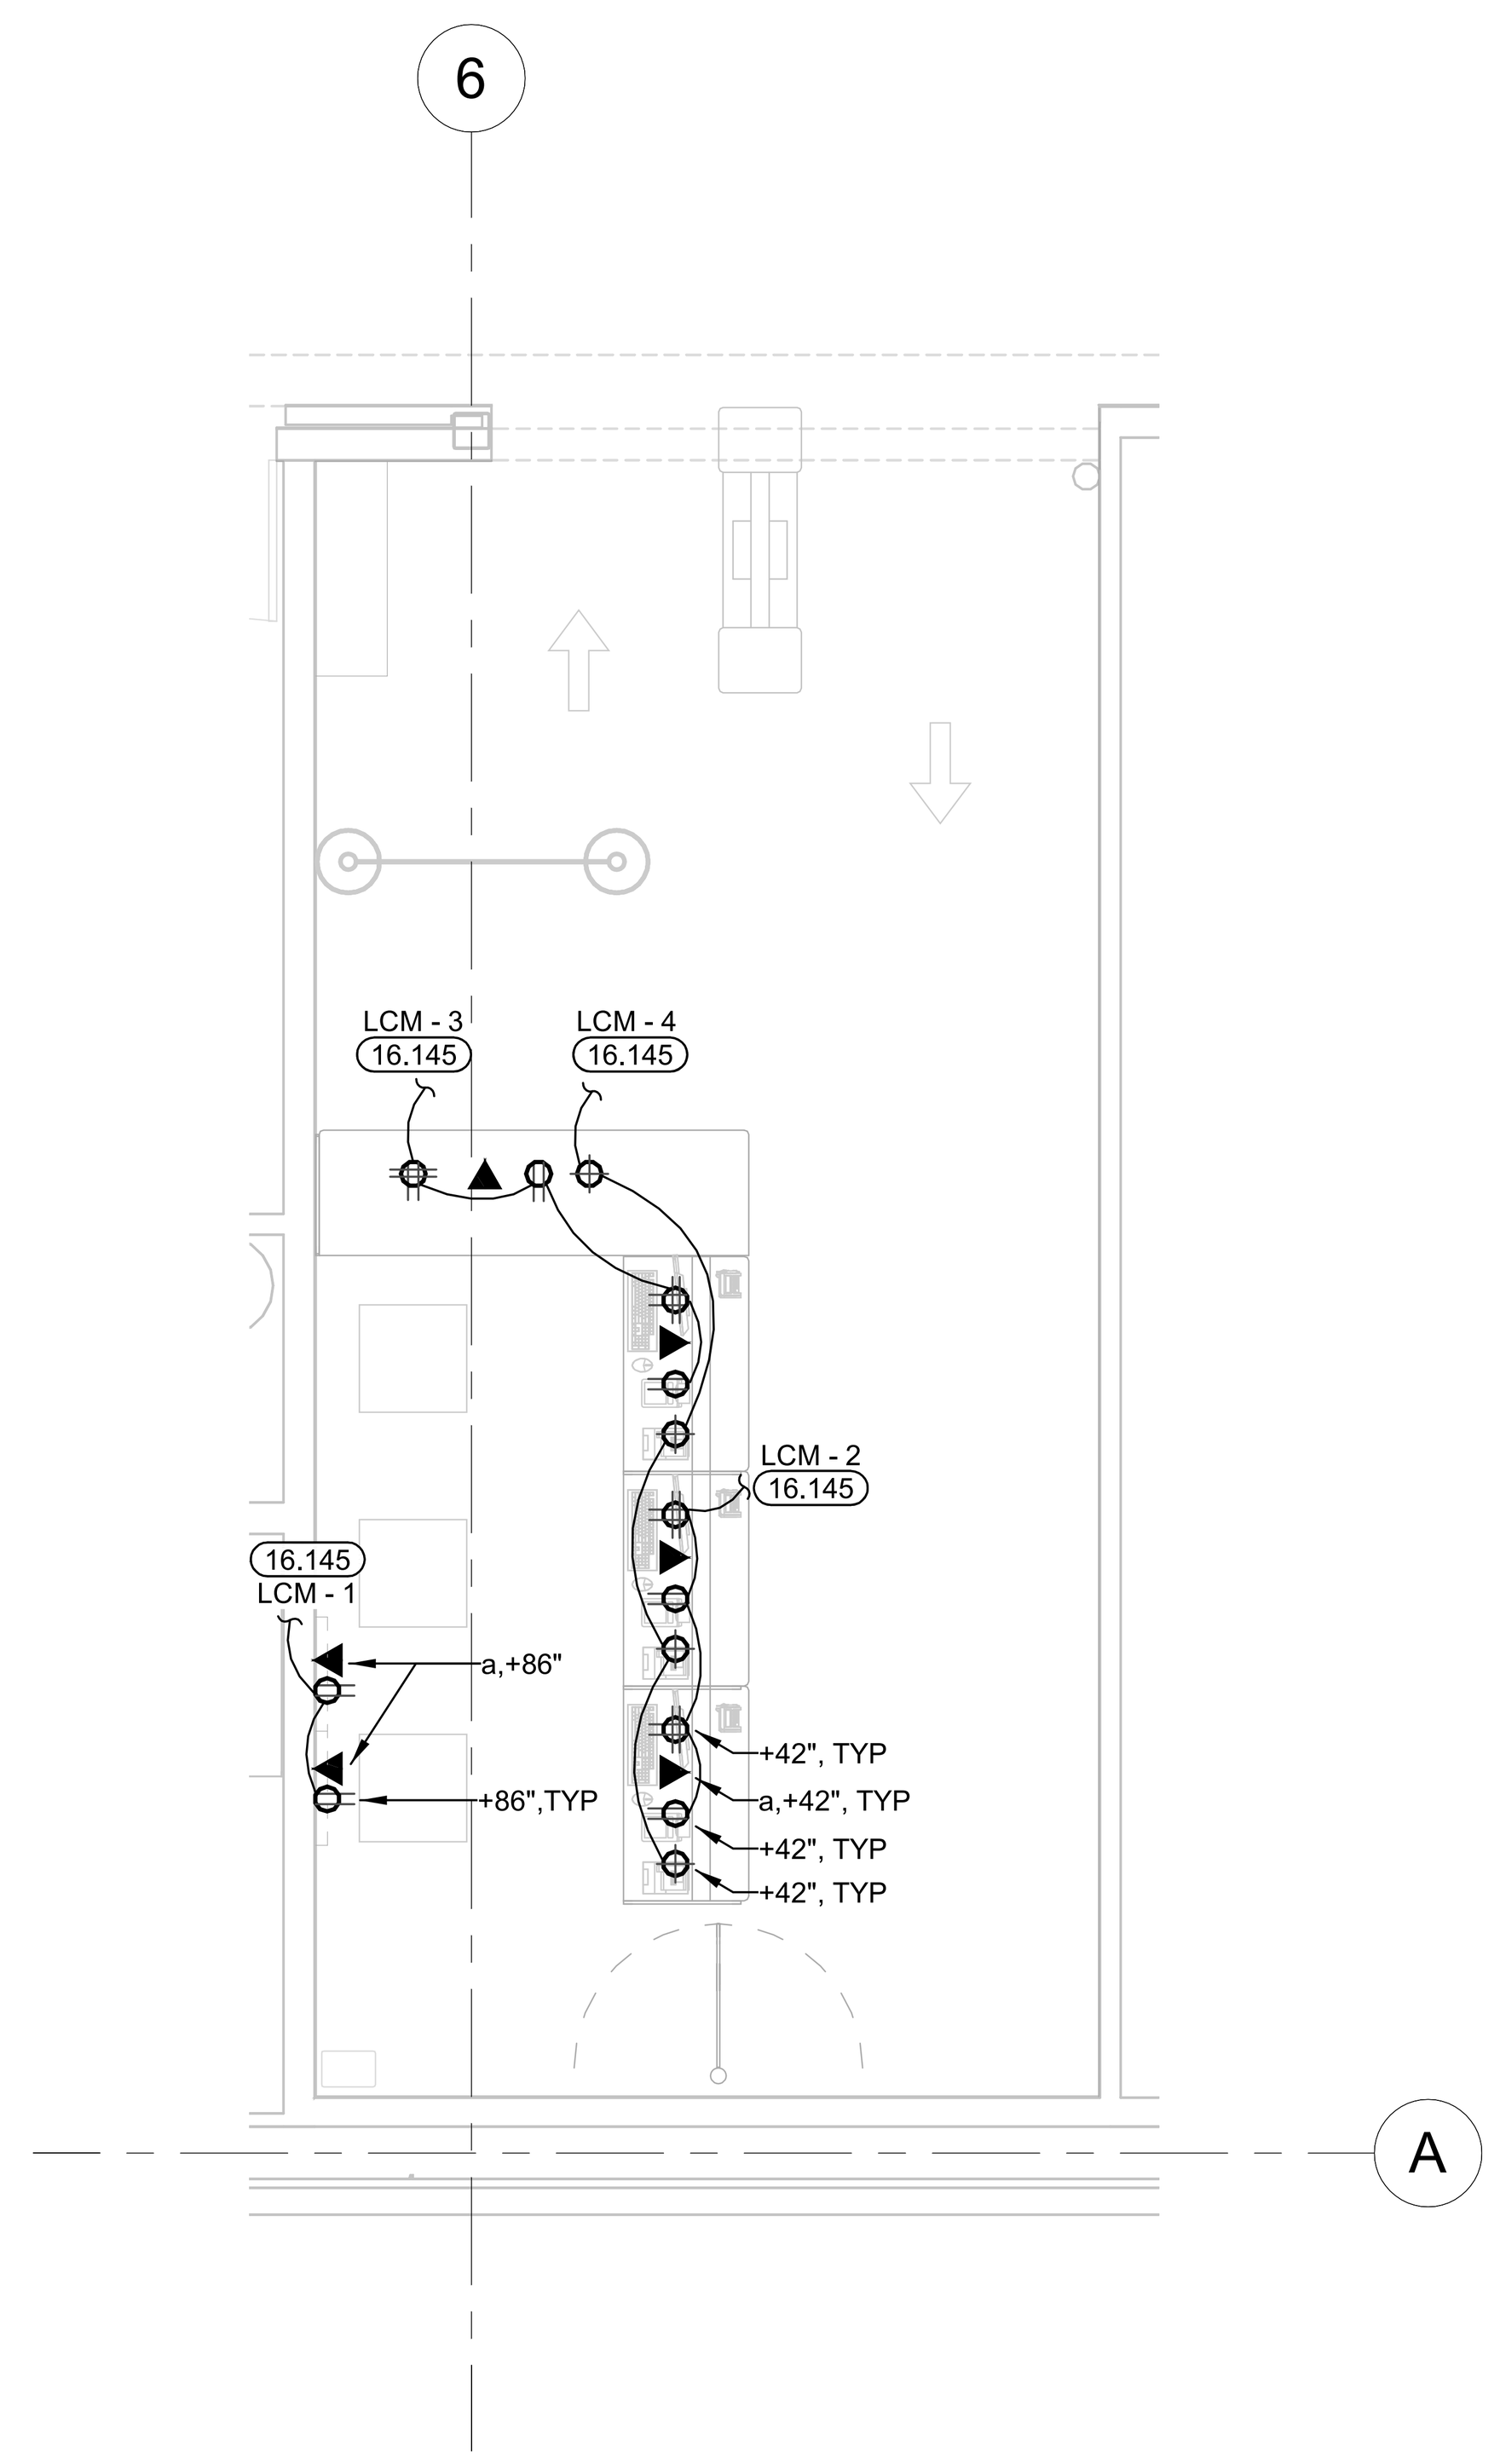1/4" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

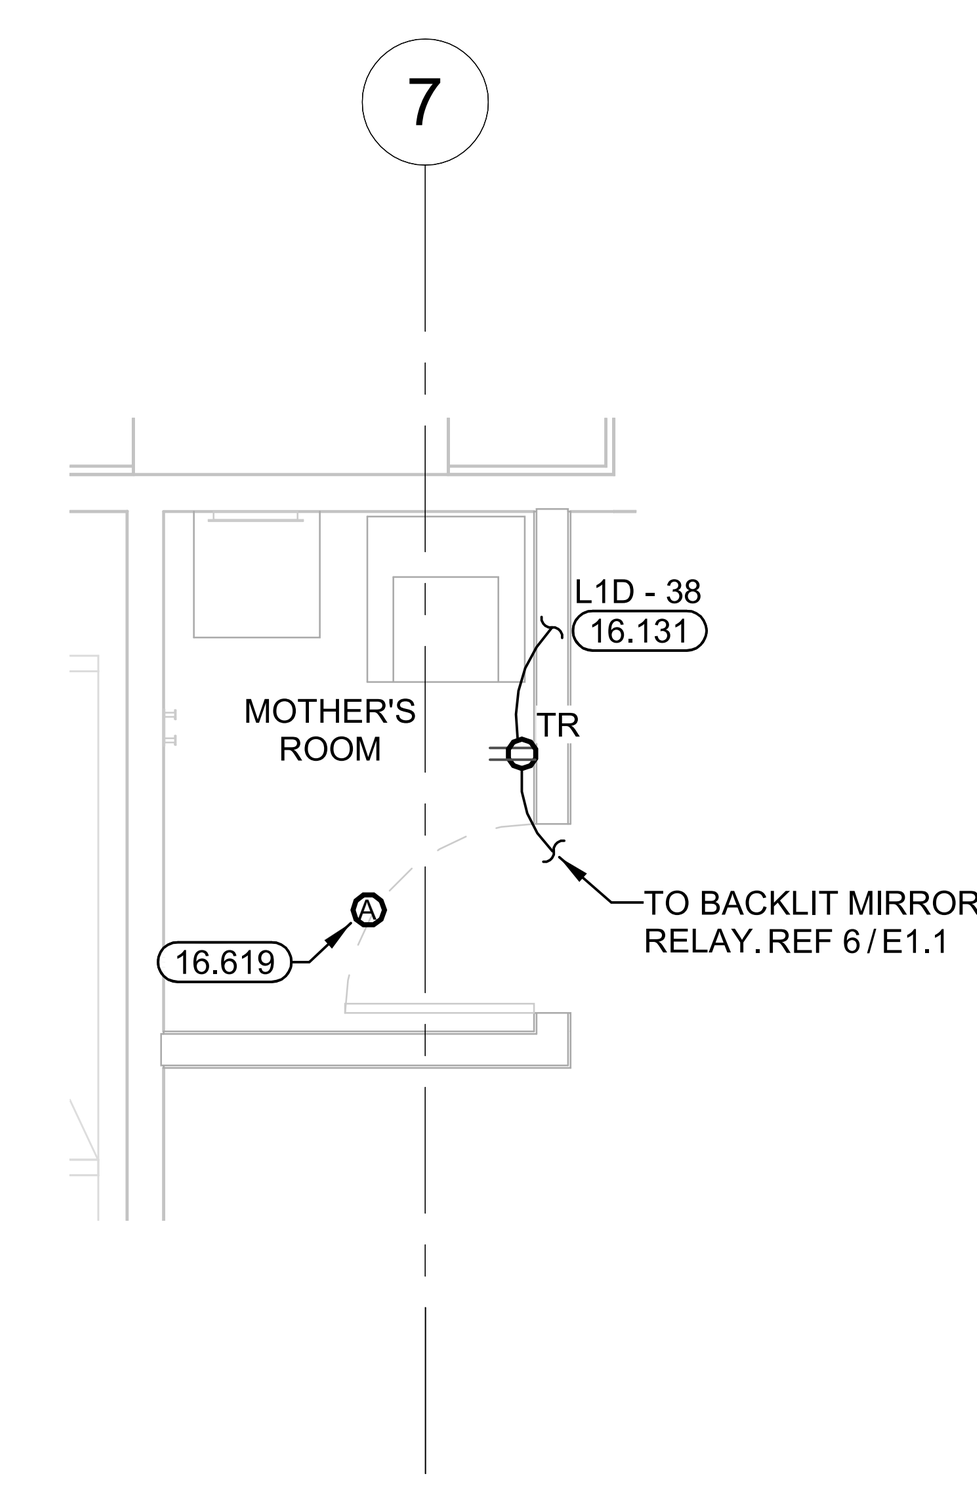
Cuhaci & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com
Florida Corporate Certificate #AA C000526


STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

| JOB NUMBER: | 2210335 | PROTO: | 188 PROTO SC |
|---|---|---|---|

ISSUE BLOCK

| | | |
|---|---|---|
| CHECKED BY: | CM | |
| DRAWN BY: | MAK | |
| PROTO CYCLE: | 08/27/21 | |
| DOCUMENT DATE: | 11/22/21 | |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:25:45-05'00'

JAISON PRADEEP MORAS
LICENSE
No 76917
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
11/22/21

ENLARGED POWER PLANS

SHEET: E2.2

11/19/2021 11:30:40 AM
C:\Users\mohammed.khan\Documents\00767_LakeCity_FL_188_L_MEP_V20_mkhanVUDFE.rvt

## KEYNOTES

16.032 CONNECT TO POWER POLE ORANGE TWIST-LOCK.

16.145 CONNECT CIRCUIT(S) TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE NOTED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO USE TO ENSURE THAT THEY MEET REQUIRED SIZE, AND ALL U.L. RATINGS AND REPLACE AS REQUIRED.

16.489 RELOCATE, EXTEND, AND RECONNECT CIRCUITRY AND ELECTRICAL DEVICES FOR RELOCATED AND/OR NEW EQUIPMENT. VERIFY CONDITION OF BRANCH CIRCUITRY, CONDUIT AND WIRE TO ENSURE THEY MEET ALL U.L. RATINGS AND REPLACE AS REQUIRED. VERIFY FINAL LOCATION OF RELOCATED/NEW EQUIPMENT WITH WALMART CONSTRUCTION MANAGER PRIOR TO ROUGH-IN.

16.492 E.C. SHALL COORDINATE WITH GENERAL CONTRACTOR AND ARCHITECTURAL DEMOLITION PLANS THE EXTENT OF ELECTRICAL DEMOLITION. REMOVE UNUSED DEVICES, BOXES, CONDUITS, AND WIRING BACK TO ORIGINATING JUNCTION BOXES OR PANELBOARDS. REFERENCE POWER PLANS FOR CIRCUITRY TO BE REUSED. DEMOLITION SHALL NOT AFFECT ACTIVE CIRCUITS. IF CIRCUIT IS DEMOLISHED ALL THE WAY TO PANELBOARD, REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER PLATE. UPDATE TYPEWRITTEN CIRCUIT DIRECTORY IDENTIFYING CIRCUIT AS "SPACE". COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS PRIOR TO BID.




## 2 ELECTRONICS POWER PLAN
1/8" = 1'-0"




## 1 FRONT CHECKOUT POWER PLAN
1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

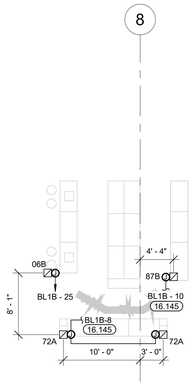EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-1500
F (407) 645-1501
www.cedpet.com
Cedarst & Peterson
Architects Engineers Planners

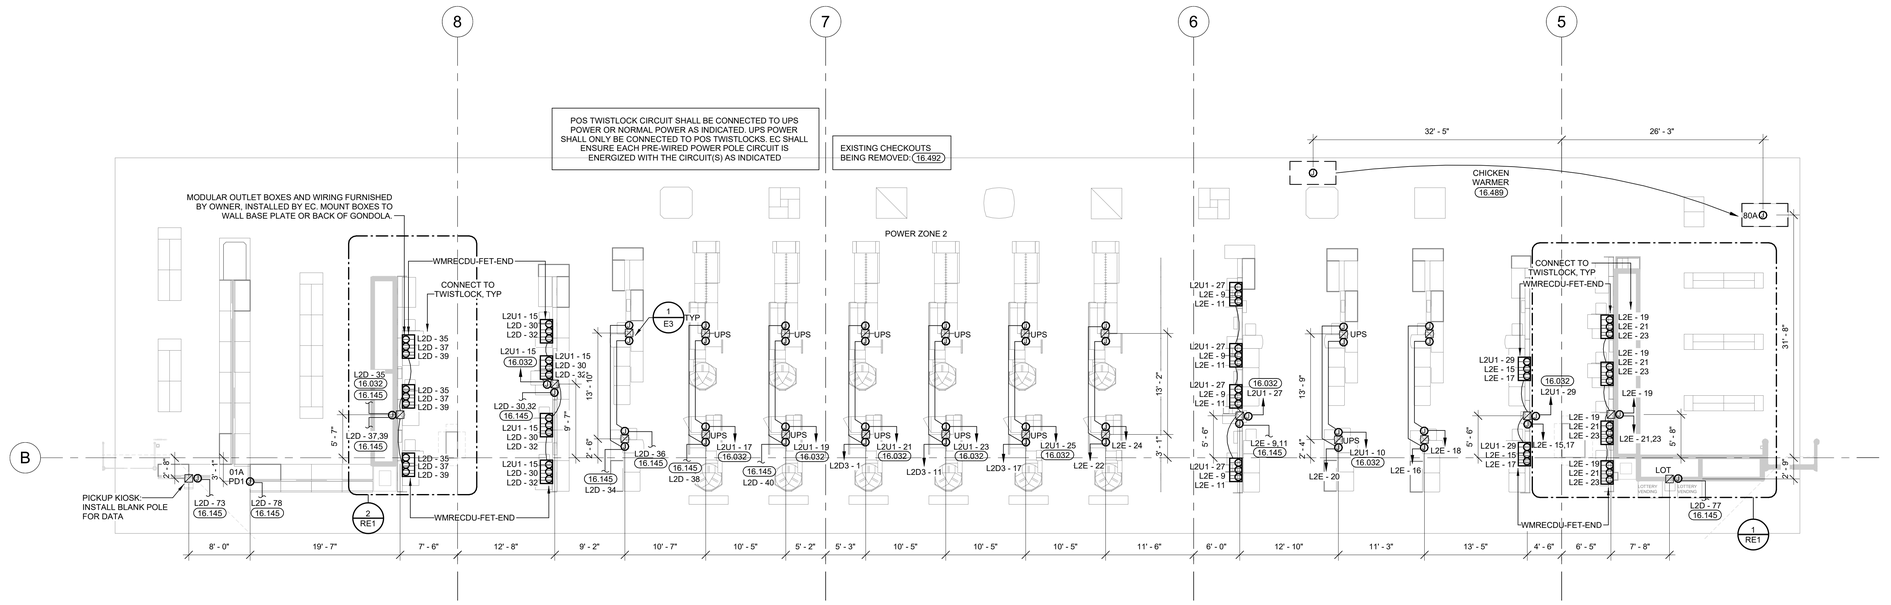
STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS NOT TO BE USED IN CONTEMPORARIOUSLY WITH ITS ISSUE, CHANGE OR ADDITION WITHOUT THE WRITTEN CONSENT OF CEDAR & PETERSON. IF THIS PROJECT IS NOT STARTED WITHIN 18 MONTHS FROM THE DATE OF THIS DRAWING, OR IF THE PROJECT IS PUT ON HOLD FOR MORE THAN 18 MONTHS AFTER THE DRAWINGS ARE PREPARED, OR IF THE PROJECT IS ABANDONED, REUSE OF THESE DRAWINGS BY THE OWNER OR ANY OTHER PARTY ON ANY OTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:25:58-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

ENLARGED POWER PLANS

SHEET: E2.3


11/3/2021 11:30:45 AM
C:\Users\mmaldonado\Desktop\Documents\06767_LakeCity_FL_VB_L_MEP_XRL_mkmcKGEE.rvt

# ELECTRICAL SYMBOLS LEGEND

04.24.20

(SYMBOLS APPLY ONLY WHEN USED ON DRAWINGS)

| SYMBOL | DESCRIPTION |
|---|---|
| | LIGHT FIXTURE (WALL MOUNTED/CEILING MOUNTED) |
| | LIGHT FIXTURE |
| | LIGHT FIXTURE, NIGHT LIGHT |
| | VOLUMETRIC LIGHT FIXTURE |
| | TRACK LIGHTING |
| | EXIT FIXTURE (WALL MOUNTED/CEILING MOUNTED) |
| | EMERGENCY LIGHT (WALL MOUNTED/CEILING MOUNTED) |
| | EMERGENCY LIGHT REMOTE HEADS (WALL MOUNTED/CEILING MOUNTED) |
| $ | SINGLE POLE SWITCH |
| $3 | 3-WAY SWITCH |
| $4 | 4-WAY SWITCH |
| $K | KEYED SWITCH |
| $D | DIMMER SWITCH |
| $VS | VARIABLE SPEED SWITCH |
| $M | MANUAL MOTOR SWITCH |
| $OS | SINGLE POLE OCCUPANCY SENSOR SWITCH |
| $OS2 | DOUBLE POLE OCCUPANCY SENSOR SWITCH |
| OS | CEILING MOUNTED OCCUPANCY SENSOR SWITCH, FOUR-DIRECTION SENSING |
| OS | WALL MOUNTED OCCUPANCY SENSOR SWITCH, ONE-DIRECTION SENSING |
| | RECEPTACLE, DUPLEX |
| | RECEPTACLE, DUPLEX, MOUNTED HORIZONTALLY |
| | RECEPTACLE, GFI |
| | RECEPTACLE, DUPLEX FLUSH FLOOR |
| | RECEPTACLE, DUPLEX ISOLATED GROUND FLUSH FLOOR |
| | RECEPTACLE, DOUBLE DUPLEX |
| | RECEPTACLE, DUPLEX ISOLATED GROUND |
| | RECEPTACLE, DOUBLE DUPLEX, ISOLATED GROUND |
| | RECEPTACLE, SIMPLEX TWIST LOCK, L5-15R, UNO |
| | RECEPTACLE, SIMPLEX TWIST LOCK, ISOLATED GROUND, L5-15R, UNO |
| | RECEPTACLE, DUPLEX TWIST LOCK, L5-15R, UNO |
| | RECEPTACLE, DUPLEX TWIST LOCK, ISOLATED GROUND, L5-15R, UNO |
| | RECEPTACLE, SPECIAL |
| | RECEPTACLE, SIMPLEX |
| | RECEPTACLE, PLUG-MOLD |
| J | JUNCTION BOX (WALL MOUNTED/CEILING MOUNTED) |
| T | THERMOSTAT (WALL MOUNTED/CEILING MOUNTED) |
| A | ALARM JUNCTION BOX, (WALL MOUNTED/CEILING MOUNTED) |
| R | ALARM JUNCTION BOX, FOR REMOTE TEST/RESET (WALL MOUNTED/CEILING MOUNTED) |
| S | SMOKE DETECTOR |
| | NON-FUSED DISCONNECT |
| | FUSED DISCONNECT |
| | EQUIPMENT CONNECTION POINT (PROVIDED WITH EQUIPMENT) |
| | CIRCUIT, CONCEALED IN WALLS OR CEILING, E INDICATES EXISTING WIRING |
| | CIRCUIT, CONCEALED IN SLAB FLOOR, E INDICATES EXISTING WIRING |
| | CIRCUIT, EXPOSED, E INDICATES EXISTING WIRING |
| | LOW VOLTAGE WIRING |
| | CONDUIT SLEEVE |
| | FLUSH MOUNTED PANELBOARD |
| | SURFACE MOUNTED PANELBOARD |
| | TELEPHONE / DATA BOX FOR ISD |
| | LOW VOLTAGE CABLE BOX FOR OTHER |
| | TELEPHONE, FLUSH FLOOR |
| | MOTOR |
| | TELEPOWER POLE |
| | PUSH BUTTON |
| B | BUZZER |
| SS | SAIL SWITCH JUNCTION BOX |
| | HORN / STROBE |
| DH | DOOR HOLD OPEN |
| TC | TIME CLOCK |

**ABBREVIATIONS**

| | |
|---|---|
| a, b, c | LOWER CASE LETTERS INDICATE SWITCHING CONFIGURATION |
| AFF | ABOVE FINISHED FLOOR |
| AFG | ABOVE FINISHED GRADE |
| C | CONDUIT |
| CCT | CIRCUIT |
| CF | CEILING FAN |
| CW | CASH WRAP |
| EC | ELECTRICAL CONTRACTOR |
| EF | EXHAUST FAN |
| ETR | EXISTING TO REMAIN |
| EWC | ELECTRIC WATER COOLER |
| G | GROUND |
| GC | GENERAL CONTRACTOR |
| GFEP | GROUND FAULT EQUIPMENT PROTECTION |
| GFI | GROUND FAULT CIRCUIT INTERRUPTER |
| HD | HAND DRYER |
| IG | ISOLATED GROUND |
| LCU | LIGHTING CONTROL UNIT |
| NL | NIGHT LIGHT |
| NTS | NOT TO SCALE |
| REC | REFRIGERATION ELECTRICAL CONTRACTOR |
| RC | REFRIGERATION CONTRACTOR |
| RH | RADIANT HEATER |
| SC | SECURITY CAMERA |
| TR | TAMPER RESISTANT |
| TYP | TYPICAL |
| UH | UNIT HEATER |
| UNO | UNLESS NOTED OTHERWISE |
| WH | WATER HEATER |
| WP | WEATHER PROOF |
| WR | WEATHER RESISTANT |

# VOICE/DATA ROUGH-IN SCHEDULE

09.27.19

| DROP | ROUGH-IN NOTES: |
|---|---|
| ▼a | FLUSH MOUNT JUNCTION BOX AT +20" (UNO) WITH (1) 3/4" CONDUIT STUBBED 12" ABOVE LAY-IN CEILING. |
| ▼b | FLUSH MOUNT JUNCTION BOX AT +20" (UNO) WITH (1) 3/4" CONDUIT ROUTED TO NEAREST ACCESSIBLE CEILING SPACE. |
| ▼c | SURFACE MOUNT JUNCTION BOX AT +66" (UNO) WITH (1) 3/4" CONDUIT STUBBED TO ACCESSIBLE CEILING SPACE. |

SCHEDULE GENERAL NOTES:

1. ALL JUNCTION BOXES SHALL BE DOUBLE GANG WITH SINGLE GANG PLASTER RING UNLESS NOTED OTHERWISE ON SCHEDULE.
2. ALL JUNCTION BOXES TO BE ROUGHED IN AT SCHEDULED HEIGHT UNLESS NOTED OTHERWISE ON DRAWINGS.
3. ALL CONDUITS SHALL BE TERMINATED WITH BUSHINGS.
4. PROVIDE PULL WIRE WITH EACH EMPTY RACEWAY (JUNCTION BOX/CONDUIT) INSTALLED.
5. CONDUIT RUNS SHALL HAVE NO MORE THAN 90 DEGREES OF TRANSITION BETWEEN PULL BOXES.
6. WHERE CONDUIT(S) TRAVERSE AREAS WITH CEILINGS OPEN TO STRUCTURE, CONDUIT(S) SHALL BE CONCEALED AS WELL AS POSSIBLE FROM VIEW FROM CUSTOMER AREA.
7. FOR CONDUIT RUNS SCHEDULED WITH 1-1/2" OR LARGER CONDUIT UTILIZE LARGE RADIUS SWEEPS AT POINTS OF TRANSITION.
8. ACCESSIBLE CEILING SPACE SHALL BE CONSIDERED 12 INCHES ABOVE A LAY-IN CEILING OR ABOVE BAR JOIST ACCESSIBLE BY A SCISSOR LIFT FOR AREAS OPEN TO STRUCTURE.

# GENERAL NOTES

08.28.20

1. FURNISH AND INSTALL ALL MATERIALS, EQUIPMENT, AND LABOR, FOR A COMPLETE INSTALLATION IN ALL RESPECTS, READY FOR INTENDED USE AND IN STRICT ACCORDANCE WITH NEC, NESC, STATE, AND LOCAL CODES, AND MANUFACTURER'S RECOMMENDATIONS. PAY ALL NECESSARY FEES AND PERMITS.
   A. NO CIRCUITRY SHALL BE ALLOWED TO BE ROUTED ACROSS THE ROOF OR THE EXTERIOR SIDE OF THE EXTERIOR WALLS.
   B. ALL EQUIPMENT SHALL BE UL LISTED WHERE APPLICABLE.
   C. ARRANGE ALL WORK TO MINIMIZE DISRUPTIONS TO STORE OPERATIONS. COORDINATE ALL DISRUPTIONS WITH WALMART CONSTRUCTION MANAGER AND STORE MANAGER.
   D. CONTRACTOR SHALL VERIFY ALL WALL FINISH THICKNESS BEFORE INSTALLING BOXES. FURNISH AND INSTALL EXTENDED BOXES OR BOX EXTENDERS WHERE REQUIRED.
   E. CONTRACTOR SHALL VERIFY THAT ALL AFFECTED PANELBOARDS HAVE CIRCUIT BREAKER KNOCKOUTS PROPERLY COVERED ANDTHAT ALL TRIM IS IN GOOD CONDITION, ALLOWING NO ACCESS TO LIVE PARTS.
2. PROVIDE SEALS AT RACEWAY PENETRATIONS AS FOLLOWS:
   A. FIRE RATED WALLS: SEAL PER SPECIFICATIONS FOR FIRE STOPPING.
   B. NEUTRALIZATION AREA: SEAL PER MECHANICAL DETAIL.
   C. FREEZER/COOLER BOXES: SEAL WITH EXPANDING FOAM SEALANT.
   D. EXTERIOR: REFER TO ARCHITECTURAL DOCUMENTS FOR SEALING REQUIREMENTS AT ALL EXTERIOR MOUNTED DEVICES, FIXTURES, ENCLOSURES, AND RACEWAY PENETRATIONS.
3. PROVIDE A SEPARATE EQUIPMENT GROUNDING CONDUCTOR (SIZE PER NEC) IN PVC TYPE CONDUIT, POWER AND LIGHTING CIRCUITS, ISOLATED GROUND CIRCUITS, OR AS SHOWN ON PLANS. CONDUIT SHALL BE SIZED PER NEC BASED ON THWN 600 VOLT COPPER SINGLE CONDUCTORS, PLUS THE EQUIPMENT GROUNDING CONDUCTOR.
4. WIRING DEVICES: DEVICE MOUNTING HEIGHTS ARE FROM FINISHED FLOOR TO CENTER OF OUTLET BOX UNLESS NOTED OTHERWISE ON PLANS. COORDINATE THE STANDARD MOUNTING HEIGHTS WITH MASONRY:
   A. SWITCHES +44"
   B. RECEPTACLES +20"
   C. VOICE/DATA +20"
5. WIRING SHALL INCLUDE FINAL CONNECTION TO ALL EQUIPMENT IN CONFORMANCE WITH EQUIPMENT SUPPLIER WIRING DIAGRAMS.
6. CONTRACTOR IS RESPONSIBLE FOR PROVIDING AN UPDATED AND COMPLETE TYPEWRITTEN CIRCUIT IDENTIFICATION SCHEDULE FOR EVERY PANELBOARD AFFECTED BY THIS PROJECT.
7. NEW OVERCURRENT PROTECTIVE DEVICES INSTALLED IN EXISTING PANELBOARDS OR DISTRIBUTION BOARDS SHALL MATCH THE TYPE AND AIC RATING OF EXISTING OVERCURRENT PROTECTIVE DEVICES.
8. BRANCH CIRCUIT CONDUCTORS SHALL BE MINIMUM #12 AWG UNLESS NOTED OTHERWISE IN SCHEDULES. WHERE 20A BRANCH CIRCUITS HAVE #8 AND LARGER WIRE SPECIFIED, #10 AWG WIRE SHALL BE USED FOR THE FINAL CONNECTION (15-FT MAXIMUM).
9. WHERE BRANCH CIRCUITS ARE GROUPED, SIZE CONDUIT AND DERATE CURRENT CARRYING CONDUCTORS PER NEC.
10. PROVIDE UL LISTED HANDLE TIES ON ALL MULTIWIRE BRANCH CIRCUITS PER NEC REQUIREMENTS.
11. SUPPORTS FROM STRUCTURE: NO ATTACHMENT OF ANY TYPE SHALL BE MADE TO BRIDGING OR JOIST WEB MEMBERS. UTILIZE ONLY THE TOP AND BOTTOM CHORDS FOR SUPPORTING THE ELECTRICAL SYSTEM INSTALLATIONS.
12. DEVICES SHOWN ON COOLER/FREEZER PANELS SHALL BE SURFACE MOUNTED UNLESS NOTED OTHERWISE. SEAL DEVICES TO COOLER/FREEZER PANELS WITH SILICONE SEALANT.
13. SURFACE MOUNTED CONDUIT ON COOLER/FREEZER PANELS OR IN FOOD PREP AREAS SHALL BE INSTALLED WITH GALVANIZED 1/2" STANDOFF CONDUIT HANGERS TO ALLOW FOR CLEANING.
14. ONLY FEEDER CIRCUITS NOTED ON THE ONE LINE DIAGRAM AND BRANCH CIRCUITS NOTED BY LEGEND SHALL BE INSTALLED UNDER SLAB. PROVIDE EXTERIOR COATED GRC BENDS ON ALL CONDUIT RUNS THAT HAVE 45 DEGREE BENDS OR GREATER. REFER TO SPECIFICATION SECTION 16.100 FOR UNDER SLAB.
15. SEISMIC ZONE REQUIREMENTS: PROVIDE EXPANSION COUPLINGS AND BRACING FOR ELECTRICAL EQUIPMENT AS REQUIRED BY LOCAL CODES.
16. EXISTING ELECTRICAL AND ALARM:
   A. WHERE DEMOLITION OR NEW CONSTRUCTION INTERRUPTS EXISTING ELECTRICAL CIRCUITS FEEDING EXISTING EQUIPMENT, DEVICES, OR LIGHTING TO REMAIN, BUT NOT SHOWN ON DRAWINGS, PROVIDE LABOR AND MATERIALS TO REWORK CIRCUITRY, AS REQUIRED, TO MAINTAIN EXISTING OPERATION.
   B. IF DEMOLITION OR NEW CONSTRUCTION WILL DISRUPT EXISTING UNDERGROUND SERVICES (ELECTRICAL, TELEPHONE, PARKING LOTLIGHTING CIRCUITRY, ETC.) PROVIDE ALL MATERIALS AND LABOR AS REQUIRED TO REROUTE, SLEEVE, OR OTHERWISE REWORK THESE SERVICES TO MAINTAIN THEIR EXISTING OPERATION.
   C. EXERCISE CAUTION AROUND ALARM AND SECURITY CABLES DURING DEMOLITION AND CONSTRUCTION. PROTECT ALARM AND SECURITY CABLES FROM ACCIDENTAL DAMAGE SO THAT SYSTEMS REMAIN OPERATIONAL AT ALL TIMES.
   D. DISPOSE OF ALL REMOVED MATERIALS, UNLESS OTHERWISE NOTED.
17. EXISTING ELECTRICAL DEMOLITION:
   A. GENERAL: REMOVE OR RELOCATE EXISTING ELECTRICAL EQUIPMENT, CONDUIT AND CONDUCTORS AS INDICATED ON THE DRAWINGS, OR ONLY AS REQUIRED BY DEMOLITION. REMOVE ALL PANELBOARDS, DISCONNECT SWITCHES, BOXES, RELAYS, TIME SWITCHES, LIGHTS, DEVICES, ETC., WHICH WILL NOT BE REUSED.
   B. SALES FLOOR: REMOVE UNUSED POWER DROP CONDUIT, CONDUCTORS AND RELATED DEVICES SERVING SALES AREA GONDOLAS BEING RELOCATED OR REMOVED. EXISTING CONDUIT AND CONDUCTORS MAY BE REUSED FOR NEW POWER DROPS WHERE SIZE, RATING, AND CONDITION MEET REQUIREMENTS INDICATED ON PLANS AND ALL U.L. RATINGS. REMOVE ALL UNUSED CONDUIT AND CONDUCTORS BACK TO POINT OF ORIGIN WHENEVER FEASIBLE. IF CIRCUIT IS NOT REUSED, REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER PLATE. EXCEPTION: DISTRIBUTION AND POWER SWITCH BREAKERS SHALL BE ETR AS "SPARE". PROVIDE HANDLE LOCK OFF DEVICE TO LOCK "SPARE" CIRCUIT BREAKER IN THE "OFF" POSITION. UPDATE TYPEWRITTEN CIRCUIT IDENTIFICATION SCHEDULE AS "SPACE" OR "SPARE"
   C. CONDUIT AND WIRING TO BE ABANDONED IN CEILING SPACES AND OTHER NON-PUBLIC AREAS (I.E., THROUGH STOCKROOM AREA): CUT WIRING LOOSE AND REMOVE FROM RACEWAY(S), LEAVING RACEWAY(S) IN PLACE. CONDUIT TO BE ABANDONED IN WALLS OR FLOORS SHALL BE REMOVED BACK TO FINISHED SURFACE AND CAPPED INSIDE. REPAIR SURFACE(S) TO MATCH ADJACENT.
   D. ALL CIRCUIT BREAKERS SERVING BRANCH CIRCUITS TO BE REMOVED SHALL ALSO BE REMOVED. REMOVE CIRCUIT BREAKER AND REPLACE WITH FILLER PLATE. EXCEPTION: DISTRIBUTION AND POWER SWITCH BREAKERS SHALL BE ETR AS "SPARE". PROVIDE HANDLE LOCK OFF DEVICE TO LOCK "SPARE" CIRCUIT BREAKER IN THE "OFF" POSITION. UPDATE TYPEWRITTEN CIRCUIT IDENTIFICATION SCHEDULE AS "SPACE " OR "SPARE".
   E. DEMOLISHED FLUORESCENT LIGHT FIXTURES: REFER TO SELECTIVE SITE DEMOLITION SPECIFICATION FOR DISPOSAL OF LIGHT FIXTURE.
   F. BUILDING COMPONENTS ABANDONED BY THE SCOPE OF WORK SHALL BE SECURED TO PREVENT FALLING, LOOSENING, OR CREATING DAMAGE OF ANY KIND IN THE FUTURE.
18. DATA AND PHONE CONDUIT INSTALLATION MILESTONE DATE: ALL RACEWAY AND CONDUIT SLEEVES FOR DATA AND PHONE CABLING TO BE INSTALLED 3 WEEKS PRIOR TO CONTRACT SUBSTANTIAL COMPLETION DATE.
19. ETHERNET CABLE:
   A. FURNISH AND INSTALL JUNCTION BOXES AS SHOWN ON PLANS. PROVIDE CONDUIT AS REQUIRED BY LOCAL CODES AND/OR ORDINANCES.
   B. ETHERNET CABLE IS FURNISHED BY OTHERS.
   C. ELECTRICAL CONTRACTOR SHALL INSTALL CABLE IN POWER POLES.
   D. ELECTRICAL CONTRACTOR SHALL INSTALL OTHER CABLE AS DIRECTED BY WALMART CONSTRUCTION MANAGER.




2 CEILING MOUNTED RECEPTACLE
NTS 07/27/18




WHEN INSTALLING ENTERTAINMENT TABLE (ENT) POWER POLE, A SEPARATE SPACER IS PROVIDED TO BE INSTALLED IN SPACE BETWEEN SIDE OF MILLWORK AND POLE. ENSURE PROPER POLE ORIENTATION TO ALLOW POLE AND BRACKET TO BE MOUNTED FLUSH WITH THE TABLE.

WHERE POWER POLE FOOT IS TO BE INSTALLED ON TILE, RUBBER FLOORING, OR CARPET, REMOVE PORTION OF THE FLOORING TO ALLOW FOOT TO BE SECURED DIRECTLY TO THE FLOOR SLAB. REFER TO SPEC SECTION 05090. DO NOT INSTALL DIRECTLY ON TOP OF TRANSITION STRIPS. SECURING THE FOOT DIRECTLY ON TOP OF VCT FLOORING IS ACCEPTABLE.

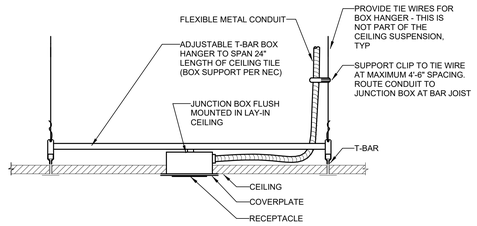1 POWER POLE CONNECTION
NTS 07/26/19

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

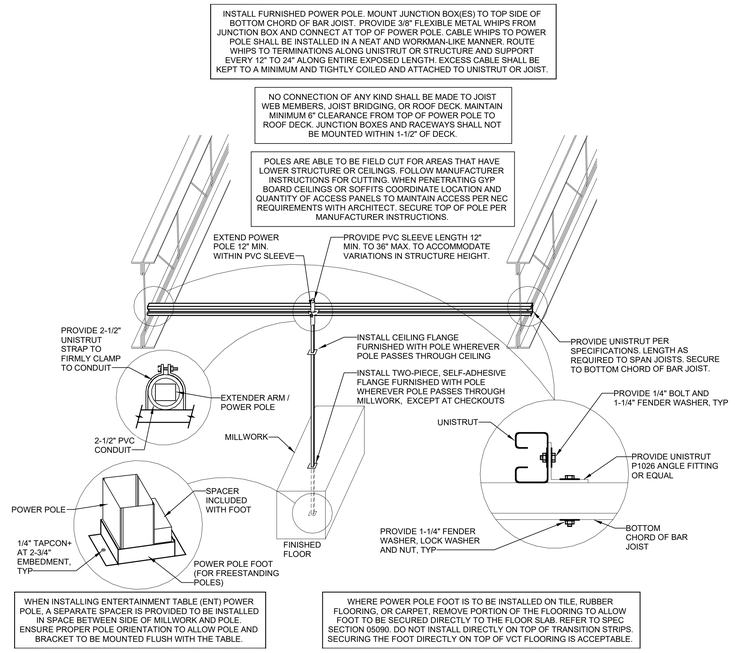EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


Cedarst & Peterson Architects Engineers Planners
2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-5581
www.cedarstpeterson.com


STIPULATION FOR RELISE

THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND IS CONTEMPORANEOUSLY WITH ITS ISSUE. STATE LAW REQUIRES THAT IT BE ERASED AT THE DISCRETION OF CEDARST & PETERSON ARCHITECTS ENGINEERS PLANNERS. REPRODUCTION OF THIS DRAWING IS STRICTLY PROHIBITED. ANY REUSE ON THIS OR ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO F.S. 481.

CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:26:09-05'00'

JAISON P. MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

ELECTRICAL DETAILS

SHEET: E3


11/16/2021 11:30:47 AM
C:\Revit Central Files\Documents\0767_LakeCity_FL_168_L_MEP_R20_mbaker@DR.rvt

# CONTACTOR SCHEDULE

| LABEL AS SHOWN: NO. | LOAD SERVED | ENCLOSURE | COIL VOLTS | CONTACTS | NOTES |
|---|---|---|---|---|---|
| C5 | LIQUOR BOX EXTERIOR SIGNAGE | NEMA-1 | 120V | 600V, 20A-4P | ELECTRICALLY HELD |
| LC1 | LIQUOR BOX INTERIOR SIGNAGE | NEMA-1 | 120V | 600V, 20A-8P | ELECTRICALLY HELD |

NOTE: E.C. TO FURNISH AND INSTALL CONTACTORS. REFER TO SHEET BAS1 FOR BAS CONTROL INFORMATION.

EXISTING SUBMETERING: IF IT IS NECESSARY TO REMOVE A METER, RTU SERVER, CT OR DISRUPT THE COMMUNICATION OF THE SUBMETERING SYSTEM IN ANY WAY, THE CONTRACTOR IS RESPONSIBLE TO RESTORE THE SUBMETERING SYSTEM TO THE SAME LEVEL OF OPERATION THAT EXISTED PRIOR TO THE WORK BEING INITIATED. THE EXISTENCE AND FUNCTIONALITY OF THE SUBMETERING SYSTEM SHALL BE VERIFIED BY CALLING WALMART BUILDING PERFORMANCE TEAM AT 479-204-0432 BETWEEN THE HOURS OF 7 AM AND 5 PM CENTRAL TIME.

EXISTING DISTRIBUTION SYSTEM IS SERIES RATED. E.C. SHALL PROVIDE CIRCUIT BREAKER(S) THAT WILL MAINTAIN EXISTING MANUFACTURER'S U.L. LISTED SERIES RATED SYSTEM.




## 1 PARTIAL ONE-LINE DIAGRAM

NTS

## ONE-LINE DIAGRAM LEGEND

11.19.10

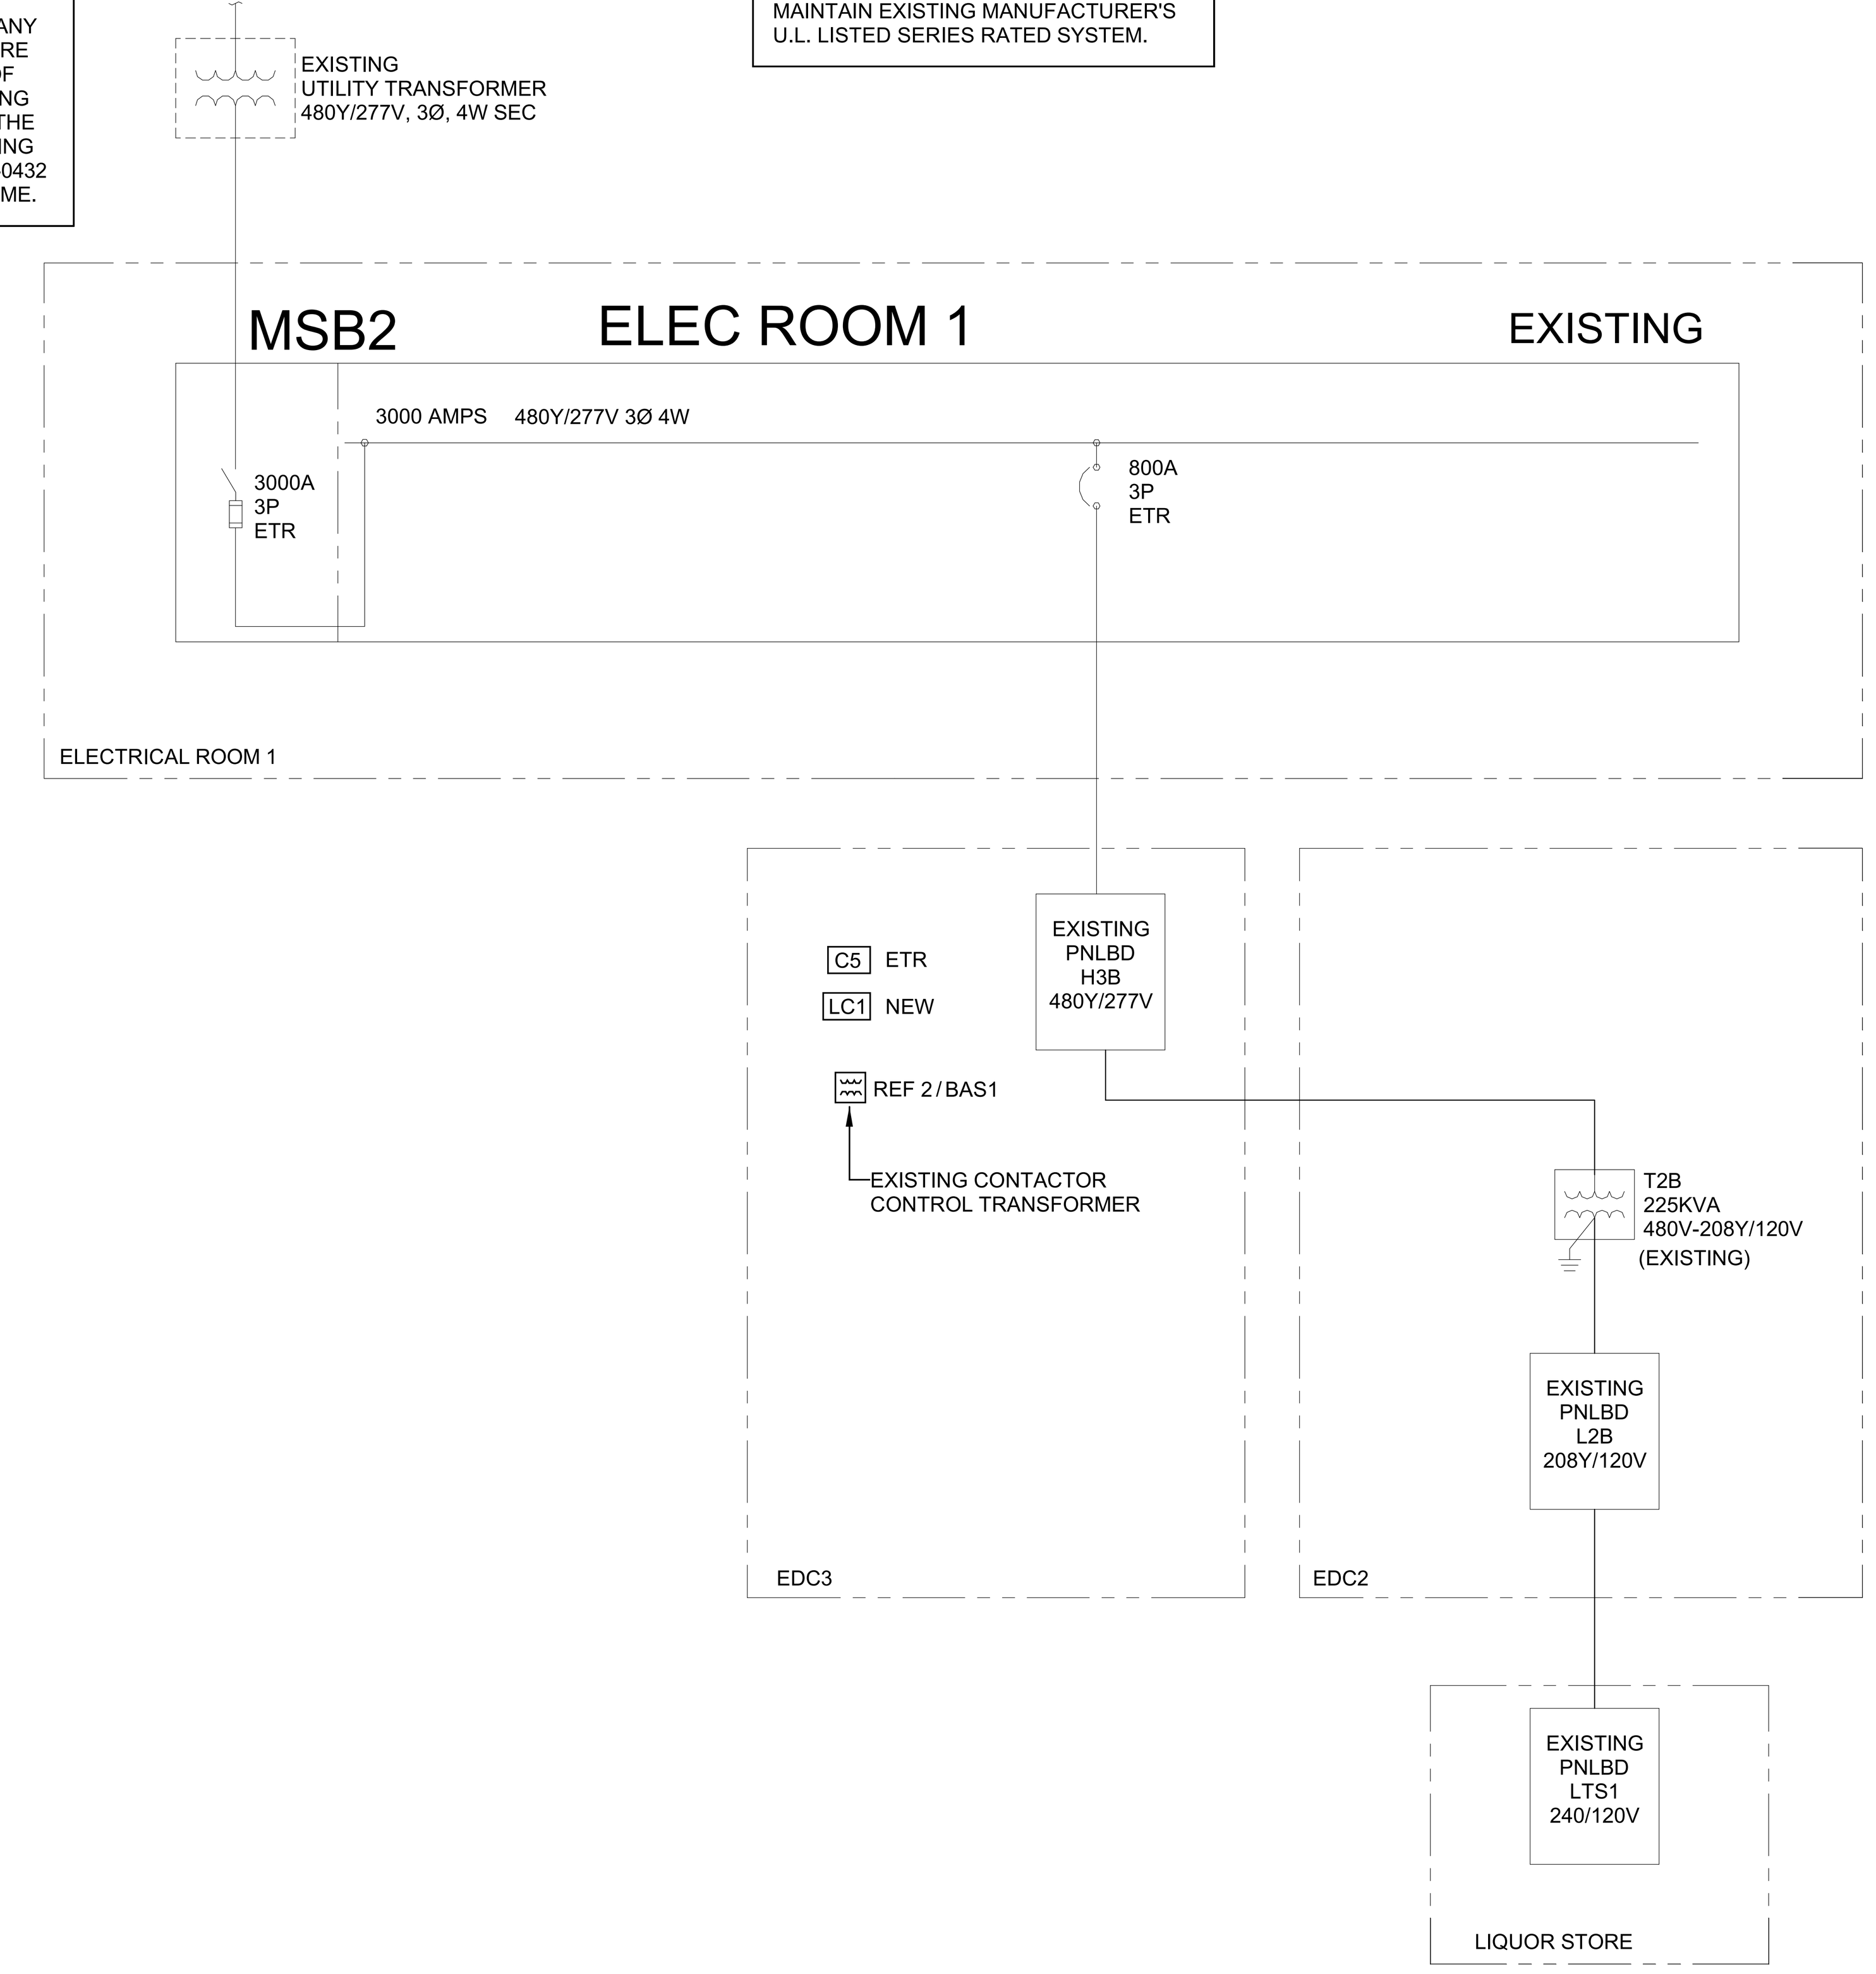- NEW EQUIPMENT
- EXISTING EQUIPMENT
- EQUIPMENT TO BE DEMOLISHED

NOTE:
ALL OF THE ELECTRICAL DEVICES SHOWN ON THE RISER DIAGRAM ARE EXISTING AND ARE BASED UPON AS-BUILT DRAWINGS. E.C. SHALL VERIFY THE EXACT EXISTING CONDITIONS, SIZES AND LOCATIONS OF EQUIPMENT PRIOR TO ROUGH-IN. THIS RISER IS SHOWN FOR INFORMATIONAL PURPOSES ONLY AND ANY NEW DEVICES ARE SHOWN IN BOLD AND ARE NOTED. DURING CONSTRUCTION, THE STORE SHALL STAY OPEN FOR BUSINESS. ANY NECESSARY POWER DOWNTIME SHALL BE SCHEDULED AND APPROVED BY WALMART CONSTRUCTION MANAGER.

## PANELBOARD NOTES ()

08.28.20

1. TERMINATE GROUND ON ISOLATED GROUND BUS.
2. INSTALL LOCKING DEVICE (LOCK-OFF FOR MAINTENANCE). LOCKING DEVICE SHALL BE UL LISTED. MANUFACTURER SHALL MATCH EXISTING PANELBOARD MANUFACTURER.
3. INSTALL LOCKING DEVICE (LOCK-ON FOR CRITICAL LOAD).
4. GFI BREAKER FOR PERSONNEL PROTECTION (5MA).
5. GFI BREAKER FOR EQUIPMENT PROTECTION (30MA).
6. CONDUCTOR SIZE HAS BEEN INCREASED FOR VOLTAGE DROP. SIZE EQUIPMENT GROUNDING CONDUCTOR PROPORTIONATELY PER NEC.
7. REFER TO ONE-LINE DIAGRAM FOR AVAILABLE FAULT CURRENT FOR INTERRUPT RATINGS.
8. REFER TO ONE-LINE DIAGRAMS FOR WIRE SIZES.
9. FACTORY WIRED TO LOAD.
10. BREAKER SHALL BE HIGH MAGNETIC TYPE.
11. BREAKER REMOVAL - FIELD VERIFY CIRCUIT BREAKER IS NOT SERVING AN EXISTING LOAD. IF NO EXISTING LOAD, REMOVE CIRCUIT BREAKER AND PROVIDE FILLER PLATE. IF BREAKER IS SERVING A LOAD, IDENTIFY LOAD SERVED. UPDATE CIRCUIT IDENTIFICATION SCHEDULE AS "SPACE" OR INDICATE LOAD SERVED.
12. DUAL TAP SOLENOID OPERATED BREAKER. CONNECT EMERGENCY/NIGHT LIGHTING TO UNSWITCHED TERMINATION.
13. EXISTING CIRCUIT AND/OR CIRCUIT BREAKER.
14. ROUTE CIRCUIT THROUGH CONTACTOR.
15. PROVIDE INTERLOCK WIRING WITH EXHAUST HOOD ANSUL SYSTEM.
16. RELOCATED CIRCUIT FROM EXISTING PANELBOARD.
17. PROVIDE BLANK CIRCUIT BREAKER FILLER PLATE FOR EXPOSED SPACE IN PANELBOARD.
18. PROVIDE U.L. LISTED OVERCURRENT DEVICE TO COORDINATE AND MAINTAIN MANUFACTURER'S SERIES RATED SYSTEM.
19. EXISTING CIRCUIT BREAKER TO REMAIN. VERIFY CONDITION OF CIRCUIT BREAKER TO ENSURE THAT IT IS OPERATIONAL AND MEETS ALL U.L. RATINGS.
20. ROUTE CIRCUIT THROUGH EXISTING LCU CABINET UTILIZING EXISTING RELAY AND CONTROLS. UPDATE LCU IDENTIFICATION SCHEDULE WITH LOAD IDENTIFICATION.
21. SOLENOID OPERATED CIRCUIT BREAKER. REFER TO ENERGY MANAGEMENT PLANS FOR CIRCUIT BREAKER CONTROL.
22. EXISTING LOAD - TRACE EXISTING CIRCUIT, IDENTIFY LOAD AND UPDATE CIRCUIT IDENTIFICATION SCHEDULE FOR LOAD SERVED. IF CIRCUIT IS NOT IN USE, REFER TO PANELBOARD NOTE (11).
23. ROUTE CIRCUIT THROUGH ENCLOSED GFI BREAKER FOR PERSONNEL PROTECTION (5MA).
24. SPARE - FIELD VERIFY CIRCUIT BREAKER IS NOT SERVING AN EXISTING LOAD. IF NO EXISTING LOAD, PROVIDE LOCK OFF DEVICE TO LOCK SPARE BREAKER IN THE OFF POSITION. IF BREAKER IS SERVING A LOAD, IDENTIFY LOAD SERVED. UPDATE CIRCUIT IDENTIFICATION SCHEDULE AS "SPARE" OR INDICATE LOAD SERVED.
25. EXISTING LOAD - TRACE EXISTING CIRCUIT, IDENTIFY LOAD AND UPDATE CIRCUIT IDENTIFICATION SCHEDULE FOR LOAD SERVED. IF CIRCUIT IS NOT IN USE, REFER TO PANELBOARD NOTE (24).

GENERAL NOTES:

1. NEW OVERCURRENT PROTECTIVE DEVICES PLACE IN EXISTING PANELBOARDS OR DISTRIBUTION BOARDS SHALL MATCH THE TYPE AND AIC RATING OF EXISTING OVERCURRENT PROTECTION DEVICES IN SAID BOARD.
2. E.C. SHALL TRACE ALL ELECTRICAL CIRCUITS FOR EVERY EXISTING PANELBOARD AFFECTED BY THIS PROJECT. IDENTIFY LOADS ON EACH CIRCUIT. PROVIDE A COMPLETE TYPEWRITTEN CIRCUIT IDENTIFICATION SCHEDULE FOR EVERY AFFECTED PANELBOARD. PROVIDE THE DATE THAT THE SCHEDULE IS CREATED.
3. ALL OVERCURRENT DEVICES ARE NEW UNLESS NOTED OTHERWISE.

## ARC FLASH

ARC FLASH HAZARD WARNING LABELING REQUIREMENTS PER NEC ARE PROVIDED BY OWNER UNDER SEPARATE CONTRACT.

## POWER INTERRUPTION NOTE

11.30.18

COORDINATE ALL WORK THAT REQUIRES POWER INTERRUPTIONS TO THE STORE WITH THE STORE MANAGER AND THE WALMART CONSTRUCTION MANAGER A MINIMUM OF 48 HOURS IN ADVANCE OF ALL STORE POWER INTERRUPTIONS. IN ADDITION, IF THE MAIN ELECTRICAL SWITCHGEAR REQUIRES WORK AND DOES NOT HAVE A MAIN SERVICE DISCONNECTING MEANS, COORDINATE WITH THE UTILITY COMPANY A MINIMUM OF TWO WEEKS IN ADVANCE OF THE STORE POWER INTERRUPTION. IF STORE IS NOT OPEN 24 HOURS PER DAY, ALL STORE POWER INTERRUPTIONS ARE TO BE ACCOMPLISHED AFTER NORMAL STORE BUSINESS HOURS. PROVIDE TEMPORARY POWER AS REQUIRED PER SPECIFICATIONS. INSTALLATION OF NEW EQUIPMENT SHALL BE COMPLETED AND THE POWER SYSTEM TESTED AND RE-ENERGIZED PRIOR TO THE TIME ESTABLISHED BY THE STORE MANAGER AND THE WALMART CONSTRUCTION MANAGER.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


Cuhaci & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com



STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart
LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 | PROTO: 188 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:26:21-05'00'

JAISON PRADEEP MORAS
LICENSE
No 76917
STATE OF FLORIDA
PROFESSIONAL ENGINEER
11/22/21

ELECTRICAL ONE-LINE DETAILS AND SCHEDULES

SHEET: E4


11/19/2021 11:30:49 AM
C:\Users\mohammed.khan\Documents\00767_LakeCity_FL_188_L_MEP_V20_mkhanVUDFE.rvt

## BUSWAY: BL1B (EXISTING)

BUS AMPS: 100A — CASE GROUND
MAINS SIZE/ TYPE: MLO — AIC RATING: 10,000A
VOLTS/PHASE: 208Y/120 V 3PH, 4W — SERVES: ELECTRONICS
SECTION: 1 — MOUNTING: CEILING
LOCATION: ELECTRONICS

| CKT NO. | DESCRIPTION | WIRE | BKR AMP | P | A | | B | | C | | P | BKR AMP | WIRE | DESCRIPTION | CKT NO. |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | MOV GONDOLA (13) | -- | 20 A | 1 | 1300 VA | 1080 VA | | | | | 1 | 20 A | -- | ENT GONDOLA (13) | 2 |
| 3 | PHOTOLAB MENUBOARDS (19) | | 20 A | 1 | | | 390 VA | 1080 VA | | | 1 | 20 A | -- | ENT GONDOLA (13) | 4 |
| 5 | ENG GONDOLA (13) | -- | 20 A | 1 | | | | | 1800 VA | 1080 VA | 1 | 20 A | -- | ENT GONDOLA (13) | 6 |
| 7 | ENG GONDOLA (13) | -- | 20 A | 1 | 1800 VA | 1080 VA | | | | | 1 | 20 A | -- | 72A ELECTRONICS C/W (19) | 8 |
| 9 | ENG GONDOLA (13) | -- | 20 A | 1 | | | 1800 VA | 600 VA | | | 1 | 20 A | -- | 87B CONNECTION CENTER (19) | 10 |
| 11 | ENG GONDOLA (13) | -- | 20 A | 1 | | | | | 1800 VA | 720 VA | 1 | 20 A | -- | WIRELESS KIOSK (13) | 12 |
| 13 | ENG GONDOLA (13) | -- | 20 A | 1 | 1080 VA | 360 VA | | | | | 1 | 20 A | -- | PHOTOLAB KIOSK RCPTS (13) | 14 |
| 15 | ENG GONDOLA (13) | -- | 20 A | 1 | | | 1440 VA | 360 VA | | | 1 | 20 A | -- | PHOTOLAB KIOSK RCPTS (13) | 16 |
| 17 | ENG GONDOLA (13) | -- | 20 A | 1 | | | | | 1800 VA | 1800 VA | 1 | 20 A | -- | ENG GONDOLA (13) | 18 |
| 19 | PHASER & SP UNIT (13) | -- | 20 A | 1 | 790 VA | 540 VA | | | | | 1 | 20 A | -- | PHOTOLAB RCPTS (13) | 20 |
| 21 | DL PRINTER (13) | -- | 20 A | 1 | | | 840 VA | 180 VA | | | 1 | 20 A | -- | 05H MEDIA AND GAMING (13) | 22 |
| 23 | WIDE FORMAT PRINTER (13) | -- | 20 A | 1 | | | | | 900 VA | 1800 VA | 1 | 20 A | -- | ENG GONDOLA (13) | 24 |
| 25 | 06B DIGITAL PICTURE CENTER | | 20 A | 1 | 840 VA | 0 VA | | | | | -- | -- | -- | SPACE | 26 |
| | | | Total Load: | | 8870 VA | | 6690 VA | | 11700 VA | | | | | | |
| | | | Total Amps: | | 77 A | | 56 A | | 100 A | | | | | | |

| TOTAL DEMAND | |
|---|---|
| Total Conn. Load: | 27260 VA |
| Total Est. Demand: | 27260 VA |
| Total Conn.: | 76 A |
| Total Est. Demand: | 76 A |

**PANELBOARD NOTES:**

FED VIA 100A-3P CIRCUIT BREAKER FROM L1D3 IN EDC1.

## PANELBOARD: L2D (EXISTING)

BUS AMPS: 225A — EQUIPMENT GROUND BUS
MAINS SIZE/ TYPE: MLO — AIC RATING: 10,000A
VOLTS/PHASE: 208Y/120 V 3PH, 4W — SERVES: GENERAL POWER
SECTION: 2 — MOUNTING: SURFACE
LOCATION: EDC2

| CKT NO. | DESCRIPTION | WIRE | BKR AMP | P | A | | B | | C | | P | BKR AMP | WIRE | DESCRIPTION | CKT NO. |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | COLUMN RECEPTS (13) | -- | 20 A | 1 | 1080 VA | 240 VA | | | | | 1 | 20 A | -- | CART CHARGER (13) | 2 |
| 3 | COLUMN RECEPTS/LBX (13) | -- | 20 A | 1 | | | 900 VA | 240 VA | | | 1 | 20 A | -- | CART CHARGER (13) | 4 |
| 5 | COLUMN RECEPTS/LBX (13) | -- | 20 A | 1 | | | | | 540 VA | 1440 VA | 1 | 20 A | -- | SERVICE KIOSK (13) | 6 |
| 7 | VENDING MACHINE (13) | -- | 20 A | 1 | 1400 VA | 1000 VA | | | | | 1 | 20 A | -- | SPARE | 8 |
| 9 | VENDING MACHINE (13) | -- | 20 A | 1 | | | 1400 VA | 540 VA | | | 1 | 20 A | -- | AP RETENTION RECEPTACLES (13) | 10 |
| 11 | VENDING MACHINE (13) | -- | 20 A | 1 | | | | | 1400 VA | 600 VA | 1 | 20 A | -- | DOOR OPERATOR (13) | 12 |
| 13 | DOOR OPERATOR (13) | -- | 20 A | 1 | 600 VA | 600 VA | | | | | 1 | 20 A | -- | DOOR OPERATOR (13) | 14 |
| 15 | DOOR OPERATOR (13) | -- | 20 A | 1 | | | 600 VA | 600 VA | | | 1 | 20 A | -- | DOOR OPERATOR (13) | 16 |
| 17 | DOOR OPERATOR (13) | -- | 20 A | 1 | | | | | 600 VA | 240 VA | 1 | 20 A | -- | CART CHANGER (13) | 18 |
| 19 | SUPPLY FAN (13) | -- | 20 A | 1 | 1180 VA | 240 VA | | | | | 1 | 20 A | -- | CART CHANGER (13) | 20 |
| 21 | SUPPLY FAN (13) | -- | 20 A | 1 | | | 1180 VA | 240 VA | | | 1 | 20 A | -- | CART CHANGER (13) | 22 |
| 23 | SUPPLY FAN (13) | -- | 20 A | 1 | | | | | 1180 VA | 180 VA | 1 | 20 A | -- | EXISTING LOAD (22) | 24 |
| 25 | O/S DRINK MACHINE (13) | -- | 20 A | 1 | 1000 VA | 180 VA | | | | | 1 | 20 A | -- | ELEC RM RCPT (13) | 26 |
| 27 | VENDING MACHINE (13) | -- | 20 A | 1 | | | 1400 VA | 540 VA | | | 1 | 20 A | -- | SC RECEPTS (13) | 28 |
| 29 | ICE BAGGER (13) | -- | 20 A | 1 | | | | | 240 VA | 600 VA | 1 | 20 A | 10 | FRONT CHECKOUT / COOLER (6,19) | 30 |
| 31 | CAR REC/SENSORMATIC (13) | -- | 20 A | 1 | 1770 VA | 768 VA | | | | | 1 | 20 A | 8 | FRONT CHECKOUT (19,6) | 32 |
| 33 | FLY VECTOR (13) | -- | 20 A | 1 | | | 180 VA | 792 VA | | | 1 | 20 A | 8 | FRONT CHECKOUT / COOLER (19,6) | 34 |
| 35 | FRONT CHECKOUT IG (19) | | 20 A | 1 | | | | | 396 VA | 264 VA | 1 | 20 A | | FRONT CHECKOUT IG (19) | 36 |
| 37 | FRONT CHECKOUT / COOLER (6,19) | 10 | 20 A | 1 | 600 VA | 1452 VA | | | | | 1 | 20 A | 6 | FRONT CHECKOUT / COOLER (19,6) | 38 |
| 39 | FRONT CHECKOUT (19,6) | 10 | 20 A | 1 | | | 576 VA | 1452 VA | | | 1 | 20 A | 6 | FRONT CHECKOUT (19,6) | 40 |
| 41 | ICE MERCHANDISER (13) | -- | 20 A | 1 | | | | | 1550 VA | 520 VA | 1 | 20 A | -- | EXHAUST FAN (13) | 42 |
| 43 | ICE MAKER (13) | -- | 20 A | 1 | 1870 VA | 2000 VA | | | | | | | | | 44 |
| 45 | SIGN (13) | -- | 20 A | 3 | | | 1000 VA | 2000 VA | | | 2 | 30 A | -- | WATER HEATER (13) | 46 |
| 47 | | | | | | | | | 1000 VA | 1240 VA | 1 | 20 A | -- | HAND DRYER (13) | 48 |
| 49 | | | | | 1000 VA | 1240 VA | | | | | 1 | 20 A | -- | HAND DRYER (13) | 50 |
| 51 | WALMART SIGNAGE(6) | 10 | 20 A | 1 | | | 662 VA | 300 VA | | | 1 | 20 A | -- | UTILITY RM/SCENT RCPTS (13) | 52 |
| 53 | PROPANE TANK(6) | 6 | 20 A | 1 | | | | | 720 VA | 720 VA | 1 | 20 A | -- | EWCS (13) | 54 |
| 55 | PROPANE TANK(6) | 6 | 20 A | 1 | 720 VA | 540 VA | | | | | 1 | 20 A | -- | SC RECEPTS (13) | 56 |
| 57 | SPACE (11) | -- | 20 A | 1 | | | 0 VA | 900 VA | | | 1 | 20 A | -- | SERVICE DESK RCPTS (13) | 58 |
| 59 | CHICKEN WARMER (13) | | 20 A | 2 | | | | | 2236 VA | 540 VA | 1 | 20 A | -- | RE MACHINE (13) | 60 |
| 61 | | | | | 2236 VA | 1080 VA | | | | | 1 | 20 A | -- | COPIER (13) | 62 |
| 63 | WAL GREET/INSECT CONTROL (13) | -- | 20 A | 2 | | | 540 VA | 900 VA | | | 1 | 20 A | -- | CASH/COUNT RCPTS (13) | 64 |
| 65 | | | | | | | | | 540 VA | 1080 VA | | | | | 66 |
| 67 | RECEPTS ON ROOF (13) | -- | 20 A | 1 | 360 VA | 1080 VA | | | | | 3 | 20 A | -- | CASH/COUNT RCPTS (13) | 68 |
| 69 | SUPPLY FAN (13) | -- | 20 A | 1 | | | 1180 VA | 1080 VA | | | | | | | 70 |
| 71 | SUPPLY FAN (13) | -- | 20 A | 1 | | | | | 1180 VA | 600 VA | 1 | 20 A | -- | SQUARE D CONTROLLER (13) | 72 |
| 73 | PU TABLET (19) | | 20 A | 1 | 180 VA | 1080 VA | | | | | 1 | 20 A | -- | COLUMN RCPTS (13) | 74 |
| 75 | ATM (13) | -- | 20 A | 1 | | | 840 VA | 900 VA | | | 1 | 20 A | -- | FITTING ROOM/MGH (19) | 76 |
| 77 | LOTTERY VENDING MACHINE (19) | | 20 A | 1 | | | | | 300 VA | 200 VA | 1 | 20 A | | | 78 |
| 79 | BAKERY MENUBOARDS | | 20 A | 1 | 390 VA | 240 VA | | | | | 1 | 20 A | | AP GATES | 80 |
| 81 | EXISTING LOAD (22) | -- | 20 A | 1 | | | 500 VA | 1240 VA | | | 1 | 20 A | -- | HAND DRYER (13) | 82 |
| 83 | GR TE CABINET (13) | -- | 20 A | 1 | | | | | 1560 VA | 1240 VA | 1 | 20 A | -- | HAND DRYER (13) | 84 |
| | | | Total Load: | | 26126 VA | | 22682 VA | | 22906 VA | | | | | | |
| | | | Total Amps: | | 218 A | | 189 A | | 191 A | | | | | | |

| TOTAL DEMAND | |
|---|---|
| Total Conn. Load: | 71714 VA |
| Total Est. Demand: | 71714 VA |
| Total Conn.: | 199 A |
| Total Est. Demand: | 199 A |

**PANELBOARD NOTES:**

FED VIA 225A-3P CIRCUIT BREAKER FROM L2B IN EDC2.

## PANELBOARD: L2E (EXISTING)

BUS AMPS: 100A — EQUIPMENT GROUND BUS
MAINS SIZE/ TYPE: 60A MCB — AIC RATING: 10,000A — ISOLATED GROUND BUS
VOLTS/PHASE: 208Y/120 V 3PH, 4W — SERVES: GENERAL IG POWER
SECTION: 1 — MOUNTING: SURFACE
LOCATION: EDC2

| CKT NO. | DESCRIPTION | WIRE | BKR AMP | P | A | | B | | C | | P | BKR AMP | WIRE | DESCRIPTION | CKT NO. |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | 16A GARDEN CENTER C/W (13) | -- | 20 A | 1 | 320 VA | 160 VA | | | | | 1 | 20 A | -- | 32G JEWELERY IG RECEPTS (13) | 2 |
| 3 | EXISTING LOAD (22) | -- | 20 A | 1 | | | 180 VA | 644 VA | | | 1 | 20 A | -- | 32A JEWELERY C/W (13) | 4 |
| 5 | EXISTING LOAD (22) | -- | 20 A | 1 | | | | | 180 VA | 1920 VA | 1 | 20 A | -- | ATM RECEPTS (13) | 6 |
| 7 | CASHROOM IG RECEPT (13) | -- | 20 A | 1 | 360 VA | 3870 VA | | | | | 2 | 50 A | -- | PANEL L2U1 (13) | 8 |
| 9 | FRONT CHECKOUT (19) | | 20 A | 1 | | | 600 VA | 4084 VA | | | | | | | 10 |
| 11 | FRONT CHECKOUT (6,19) | 10 | 20 A | 1 | | | | | 768 VA | 160 VA | 1 | 20 A | -- | 46F CASHWRAP (13) | 12 |
| 13 | EWCS (13) | -- | 20 A | 1 | 1656 VA | 0 VA | | | | | -- | -- | -- | SPACE | 14 |
| 15 | FRONT CHECKOUT / COOLER | | 20 A | 1 | | | 600 VA | 792 VA | | | 1 | 20 A | | FRONT CHECKOUT / COOLER | 16 |
| 17 | FRONT CHECKOUT | | 20 A | 1 | | | | | 384 VA | 264 VA | 1 | 20 A | | FRONT CHECKOUT (IG) | 18 |
| 19 | FRONT CHECKOUT (IG) | | 20 A | 1 | 528 VA | 792 VA | | | | | 1 | 20 A | | FRONT CHECKOUT / COOLER | 20 |
| 21 | FRONT CHECKOUT / COOLER | | 20 A | 1 | | | 759 VA | 1452 VA | | | 1 | 20 A | 8 | FRONT CHECKOUT / COOLER (6) | 22 |
| 23 | FRONT CHECKOUT | | 20 A | 1 | | | | | 768 VA | 264 VA | 1 | 20 A | | FRONT CHECKOUT | 24 |
| | | | Total Load: | | 7686 VA | | 9111 VA | | 4708 VA | | | | | | |
| | | | Total Amps: | | 68 A | | 80 A | | 39 A | | | | | | |

| TOTAL DEMAND | |
|---|---|
| Total Conn. Load: | 21505 VA |
| Total Est. Demand: | 21505 VA |
| Total Conn.: | 60 A |
| Total Est. Demand: | 60 A |

**PANELBOARD NOTES:**

## PANELBOARD: L2D4 (EXISTING)

BUS AMPS: 225A — EQUIPMENT GROUND BUS
MAINS SIZE/ TYPE: MLO — AIC RATING: 10,000A
VOLTS/PHASE: 208Y/120 V 3PH, 4W — SERVES: BAKERY EQUIPMENT
SECTION: 1 — MOUNTING: SURFACE
LOCATION: EDC2

| CKT NO. | DESCRIPTION | WIRE | BKR AMP | P | A | | B | | C | | P | BKR AMP | WIRE | DESCRIPTION | CKT NO. |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | 3559 VA | 200 VA | | | | | 2 | 20 A | -- | SPARE(25) | 2 |
| 3 | B2 PROOF BOX(13) | -- | 40 A | 3 | | | 3559 VA | 200 VA | | | | | | | 4 |
| 5 | | | | | | | | | 3559 VA | 500 VA | 1 | 20 A | -- | RECEPTACLE(13) | 6 |
| 7 | | | | | 1513 VA | 500 VA | | | | | 1 | 20 A | -- | RECEPTACLE(13) | 8 |
| 9 | B4 140 QUART MIXER(13) | -- | 35 A | 3 | | | 1513 VA | 1000 VA | | | 1 | 20 A | -- | WATER HEATER(13) | 10 |
| 11 | | | | | | | | | 1513 VA | 1000 VA | 1 | 20 A | -- | WATER HEATER(13) | 12 |
| 13 | | | | | 692 VA | 1000 VA | | | | | 1 | 20 A | -- | CAKE DECOR TABLE(13) | 14 |
| 15 | B44 DOUGH DIVIDER (13) | -- | 20 A | 3 | | | 692 VA | 200 VA | | | 1 | 20 A | -- | EXISTING LOAD(22) | 16 |
| 17 | | | | | | | | | 692 VA | 0 VA | -- | -- | -- | SPACE | 18 |
| 19 | | | | | 1513 VA | 500 VA | | | | | 1 | 20 A | -- | CART(13) | 20 |
| 21 | B84 80 QT MIXER (13) | -- | 35 A | 3 | | | 1513 VA | 500 VA | | | 1 | 20 A | -- | CART(13) | 22 |
| 23 | | | | | | | | | 1513 VA | 500 VA | 1 | 20 A | -- | CART(13) | 24 |
| 25 | SPARE(25) | -- | 20 A | 2 | 200 VA | 0 VA | | | | | 2 | 20 A | -- | SPARE(24) | 26 |
| 27 | | | | | | | 200 VA | 0 VA | | | | | | | 28 |
| 29 | EXISTING LOAD(22) | -- | 20 A | 1 | | | | | 200 VA | 500 VA | 1 | 20 A | -- | CART RECEPTACLE(13) | 30 |
| 31 | | | | | 616 VA | 500 VA | | | | | 1 | 20 A | -- | CART RECEPTACLE(13) | 32 |
| 33 | B3 RACK OVEN (13) | -- | 20 A | 3 | | | 616 VA | 180 VA | | | 1 | 20 A | | ROOF GFI RECEPT | 34 |
| 35 | | | | | | | | | 616 VA | 180 VA | 1 | 20 A | | ROOF GFI RECEPT | 36 |
| 37 | | | | | 616 VA | 672 VA | | | | | 1 | 20 A | 10 | RCU1 FAN AND LTS(6) | 38 |
| 39 | B3 RACK OVEN (13) | -- | 20 A | 3 | | | 616 VA | 1176 VA | | | 1 | 20 A | 10 | RCU2 FAN AND LTS(6) | 40 |
| 41 | | | | | | | | | 616 VA | 0 VA | -- | -- | -- | SPACE | 42 |
| | | | Total Load: | | 12081 VA | | 11965 VA | | 11389 VA | | | | | | |
| | | | Total Amps: | | 101 A | | 100 A | | 95 A | | | | | | |

| TOTAL DEMAND | |
|---|---|
| Total Conn. Load: | 35435 VA |
| Total Est. Demand: | 35435 VA |
| Total Conn.: | 98 A |
| Total Est. Demand: | 98 A |

**PANELBOARD NOTES:**

FED VIA 3P-150A CIRCUIT BREAKER FROM L2B IN EDC2

## PANELBOARD: L2U1 (EXISTING)

BUS AMPS: 100A — EQUIPMENT GROUND BUS
MAINS SIZE/ TYPE: MLO — AIC RATING: 10,000A — ISOLATED GROUND BUS
VOLTS/PHASE: 120/240 V 1PH, 3W — SERVES: CRITICAL IG EQUIPMENT
SECTION: 1 — MOUNTING: SURFACE
LOCATION: EDC2

| CKT NO. | DESCRIPTION | WIRE | BKR AMP | P | A | | B | | P | BKR AMP | WIRE | DESCRIPTION | CKT NO. |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | REG 1,3,5,7,9 (13) | -- | 20 A | 1 | 500 VA | 500 VA | | | 1 | 20 A | -- | EXISTING LOAD (22) | 2 |
| 3 | REG 11,13,15 (13) | -- | 20 A | 1 | | | 500 VA | 500 VA | 1 | 20 A | -- | REG 2 (13) | 4 |
| 5 | REG 3,17,19,21,23 (13) | -- | 20 A | 1 | 500 VA | 500 VA | | | 1 | 20 A | -- | CUSTOMER SERVICE (13) | 6 |
| 7 | REG 4,6,8,10, PAYSTATION (13) | -- | 20 A | 1 | | | 500 VA | 500 VA | 1 | 20 A | -- | GRC SWITCHES (13) | 8 |
| 9 | REG 12,14 (13) | -- | 20 A | 1 | 500 VA | 264 VA | | | 1 | 20 A | | FRONT CHECKOUT IG | 10 |
| 11 | REG 16,18,20,22 (13) | -- | 20 A | 1 | | | 500 VA | 0 VA | -- | -- | -- | SPACE | 12 |
| 13 | 6M SWITCHES (13) | -- | 20 A | 1 | 50 VA | 0 VA | | | -- | -- | -- | SPACE | 14 |
| 15 | FRONT CHECKOUT IG | 10 | 20 A | 1 | | | 528 VA | 0 VA | -- | -- | -- | SPACE | 16 |
| 17 | FRONT CHECKOUT IG | | 20 A | 1 | 264 VA | 0 VA | | | -- | -- | -- | SPACE | 18 |
| 19 | FRONT CHECKOUT IG | | 20 A | 1 | | | 264 VA | 0 VA | -- | -- | -- | SPACE | 20 |
| 21 | FRONT CHECKOUT IG | | 20 A | 1 | 264 VA | 0 VA | | | -- | -- | -- | SPACE | 22 |
| 23 | FRONT CHECKOUT IG | | 20 A | 1 | | | 264 VA | 0 VA | -- | -- | -- | SPACE | 24 |
| 25 | FRONT CHECKOUT IG | | 20 A | 1 | 264 VA | 0 VA | | | -- | -- | -- | SPACE | 26 |
| 27 | FRONT CHECKOUT IG | | 20 A | 1 | | | 528 VA | 0 VA | -- | -- | -- | SPACE | 28 |
| 29 | FRONT CHECKOUT IG | | 20 A | 1 | 264 VA | 0 VA | | | -- | -- | -- | SPACE | 30 |
| | | | Total Load: | | 3870 VA | | 4084 VA | | | | | | |
| | | | Total Amps: | | 32 A | | 34 A | | | | | | |

| TOTAL DEMAND | |
|---|---|
| Total Conn. Load: | 7954 VA |
| Total Est. Demand: | 7954 VA |
| Total Conn.: | 33 A |
| Total Est. Demand: | 33 A |

**PANELBOARD NOTES:**

FED VIA 50A-2P CIRCUIT BREAKER FROM L2E IN EDC2 VIA UPS.

## PANELBOARD: LCM (EXISTING)

BUS AMPS: 100A — EQUIPMENT GROUND BUS
MAINS SIZE/ TYPE: MLO — AIC RATING: 10,000A
VOLTS/PHASE: 208Y/120 V 3PH, 4W — SERVES: MONEYCENTER
SECTION: 1 — MOUNTING: FLUSH
LOCATION: MONEYCENTER

| CKT NO. | DESCRIPTION | WIRE | BKR AMP | P | A | | B | | C | | P | BKR AMP | WIRE | DESCRIPTION | CKT NO. |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | MONEYCENTER RECEPTS (19) | | 20 A | 1 | 360 VA | 1080 VA | | | | | 1 | 20 A | | MONEYCENTER RECEPTS (19) | 2 |
| 3 | MONEYCENTER RECEPTS (19) | | 20 A | 1 | | | 1080 VA | 720 VA | | | 1 | 20 A | | MONEYCENTER RECEPTS (19) | 4 |
| 5 | EXISTING LOAD (22) | -- | 20 A | 1 | | | | | 500 VA | 500 VA | 1 | 20 A | -- | EXISTING LOAD (22) | 6 |
| 7 | EXISTING LOAD (22) | -- | 20 A | 1 | 500 VA | 500 VA | | | | | 1 | 20 A | -- | EXISTING LOAD (22) | 8 |
| 9 | EXISTING LOAD (22) | -- | 20 A | 1 | | | 500 VA | 500 VA | | | 1 | 20 A | -- | EXISTING LOAD (22) | 10 |
| 11 | EXISTING LOAD (22) | -- | 20 A | 1 | | | | | 500 VA | 500 VA | 1 | 20 A | -- | EXISTING LOAD (22) | 12 |
| 13 | SPACE | -- | -- | -- | 0 VA | 0 VA | | | | | -- | -- | -- | SPACE | 14 |
| 15 | EXISTING LOAD (22) | -- | 20 A | 1 | | | 500 VA | 0 VA | | | -- | -- | -- | SPACE | 16 |
| 17 | SPACE | -- | -- | -- | | | | | 0 VA | 0 VA | -- | -- | -- | SPACE | 18 |
| 19 | SPACE | -- | -- | -- | 0 VA | 0 VA | | | | | -- | -- | -- | SPACE | 20 |
| 21 | SPACE | -- | -- | -- | | | 0 VA | 0 VA | | | -- | -- | -- | SPACE | 22 |
| 23 | SPACE | -- | -- | -- | | | | | 0 VA | 0 VA | -- | -- | -- | SPACE | 24 |
| | | | Total Load: | | 2440 VA | | 3300 VA | | 2000 VA | | | | | | |
| | | | Total Amps: | | 21 A | | 28 A | | 17 A | | | | | | |

| TOTAL DEMAND | |
|---|---|
| Total Conn. Load: | 7740 VA |
| Total Est. Demand: | 7740 VA |
| Total Conn.: | 22 A |
| Total Est. Demand: | 22 A |

**PANELBOARD NOTES:**

FED VIA 100A-3P CIRCUIT BREAKER FROM L2B IN EDC2.

## PANELBOARD: LTS1 (EXISTING)

BUS AMPS: 100A — EQUIPMENT GROUND BUS
MAINS SIZE/ TYPE: MLO — AIC RATING: 10,000A
VOLTS/PHASE: 120/240 V 1PH, 3W — SERVES: LIQUOR BOX
SECTION: 1 — MOUNTING: FLUSH
LOCATION: LIQUOR BOX

| CKT NO. | DESCRIPTION | WIRE | BKR AMP | P | A | | B | | P | BKR AMP | WIRE | DESCRIPTION | CKT NO. |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | RECEPTACLES (13) | -- | 20 A | 1 | 540 VA | 540 VA | | | 1 | 20 A | -- | RECEPTACLES (13) | 2 |
| 3 | RECEPTACLES (13) | -- | 20 A | 1 | | | 540 VA | 500 VA | 1 | 20 A | -- | RECEPTACLES (13) | 4 |
| 5 | RECEPTACLES (13) | -- | 20 A | 1 | 540 VA | 540 VA | | | 1 | 20 A | -- | RECEPTACLES (13) | 6 |
| 7 | PDS (13) | -- | 20 A | 1 | | | 540 VA | 540 VA | 1 | 20 A | -- | AUTO DOOR (13) | 8 |
| 9 | SIGNAGE (13) | -- | 20 A | 1 | 540 VA | 500 VA | | | | | | | 10 |
| 11 | 96L SHELF LIGHTING (14) | | 20 A | 1 | | | 200 VA | 500 VA | 2 | 20 A | -- | EXISTING LOAD (24) | 12 |
| 13 | NEON SIGNAGE (14) | | 20 A | 1 | 360 VA | 25 VA | | | 1 | 20 A | | OVERHEAD BEER SIGN (14) | 14 |
| 15 | SPACE | -- | -- | -- | | | 0 VA | 360 VA | 1 | 20 A | | OVERHEAD BEER SIGN (14) | 16 |
| 17 | SPACE | -- | -- | -- | 0 VA | 0 VA | | | -- | -- | -- | SPACE | 18 |
| | | | Total Load: | | 3585 VA | | 3180 VA | | | | | | |
| | | | Total Amps: | | 30 A | | 27 A | | | | | | |

| TOTAL DEMAND | |
|---|---|
| Total Conn. Load: | 6765 VA |
| Total Est. Demand: | 6765 VA |
| Total Conn.: | 28 A |
| Total Est. Demand: | 28 A |

**PANELBOARD NOTES:**

FED VIA 100A-2P CIRCUIT BREAKER FROM L2B IN EDC2.

## PANELBOARD: L2B (EXISTING)

BUS AMPS: 800A — EQUIPMENT GROUND BUS
MAINS SIZE/ TYPE: 800A MCB — AIC RATING: 10,000A
VOLTS/PHASE: 208Y/120 V 3PH, 4W — SERVES: 208V DISTRIBUTION
SECTION: 1 — MOUNTING: SURFACE
LOCATION: EDC2

| CKT NO. | DESCRIPTION | WIRE | BKR AMP | P | A | | B | | C | | P | BKR AMP | WIRE | DESCRIPTION | CKT NO. |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | | | | | 1940 VA | 3260 VA | | | | | | | | | 2 |
| 3 | PANELBOARD SP (13) | -- | 100 A | 3 | | | 1940 VA | 2300 VA | | | 3 | 100 A | -- | PANELBOARD LP (13) | 4 |
| 5 | | | | | | | | | 1940 VA | 2340 VA | | | | | 6 |
| 7 | | | | | 1340 VA | 2360 VA | | | | | | | | | 8 |
| 9 | PANELBOARD LVC (13) | -- | 100 A | 3 | | | 1394 VA | 2580 VA | | | 3 | 100 A | -- | PANELBOARD L1BT (13) | 10 |
| 11 | | | | | | | | | 1379 VA | 1940 VA | | | | | 12 |
| 13 | | | | | 8510 VA | 6760 VA | | | | | | | | | 14 |
| 15 | PANELBOARD LCM (13) | -- | 100 A | 3 | | | 8510 VA | 6900 VA | | | 3 | 100 A | -- | PANELBOARD LCC (13) | 16 |
| 17 | | | | | | | | | 8510 VA | 6070 VA | | | | | 18 |
| 19 | | | | | 1940 VA | 10470 VA | | | | | | | | | 20 |
| 21 | PANELBOARD L2D4 (13) | -- | 150 A | 3 | | | 2120 VA | 10660 VA | | | 3 | 150 A | -- | PANELBOARD L2D3 (13) | 22 |
| 23 | | | | | | | | | 2220 VA | 10240 VA | | | | | 24 |
| 25 | | | | | 26126 VA | 3603 VA | | | | | | | | | 26 |
| 27 | PANELBOARD L2D (13) | -- | 225 A | 3 | | | 22682 VA | 3603 VA | | | 3 | 40 A | 4 | RCU-1(6) | 28 |
| 29 | | | | | | | | | 22906 VA | 3603 VA | | | | | 30 |
| 31 | | | | | 2000 VA | 4071 VA | | | | | | | | | 32 |
| 33 | PANEL LTS1 (13) | -- | 100 A | 3 | | | 2000 VA | 4071 VA | | | 3 | 50 A | 6 | RCU-2(6) | 34 |
| 35 | | | | | | | | | 2000 VA | 4071 VA | | | | | 36 |
| 37 | SPACE | -- | 20 A | 3 | 0 VA | 0 VA | | | | | -- | -- | -- | SPACE | 38 |
| 39 | | | | | | | 0 VA | 0 VA | | | -- | -- | -- | SPACE | 40 |
| 41 | | | | | | | | | 0 VA | 0 VA | -- | -- | -- | SPACE | 42 |
| | | | Total Load: | | 72380 VA | | 68760 VA | | 67219 VA | | | | | | |
| | | | Total Amps: | | 605 A | | 575 A | | 560 A | | | | | | |

| TOTAL DEMAND | |
|---|---|
| Total Conn. Load: | 208358 VA |
| Total Est. Demand: | 208358 VA |
| Total Conn.: | 579 A |
| Total Est. Demand: | 579 A |

**PANELBOARD NOTES:**

REFER TO SHEET E4 FOR PANELBOARD NOTES

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


2600 Maitland Center Parkway
Suite 200
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8999
www.cmpassociates.com
Cedrun & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND IS NOT TO BE USED ON ANY OTHER PROJECT OR EXTENSIONS TO THIS PROJECT EXCEPT BY AGREEMENT IN WRITING AND WITH APPROPRIATE COMPENSATION TO THE ARCHITECT. ALL REUSE WITHOUT SUCH AGREEMENT SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO THE ARCHITECT AND CONSULTANTS. ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT, ARE RETAINED BY THE ARCHITECT. VISUAL CONTACT WITH THESE DRAWINGS OR WRITTEN MATERIAL CONSTITUTES PROOF OF ACCEPTANCE OF THESE RESTRICTIONS. SUBMISSION OR DISTRIBUTION OF THESE DOCUMENTS TO MEET OFFICIAL REGULATORY REQUIREMENTS OR FOR PURPOSES IN CONNECTION WITH THE PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO F.S. 481.

CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| CHECKED BY: | | CM |
| DRAWN BY: | | MAK |
| PROTO CYCLE: | | 08/27/21 |
| DOCUMENT DATE: | | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:26:36-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

PANELBOARD SCHEDULES

SHEET: E4.1


11/19/2021 11:30:32 AM
C:\Users\mmcdaniel.kaizen\Documents\WORK\2_LakeCity_FL_168_L_MEP_VOL.rvtmmcdANDEE.rvt




## 3 OVERHEAD CASE CONNECTION WIRING

NTS




## 2 GM CHECKOUT REFRIGERATION ELECTRICAL PLAN

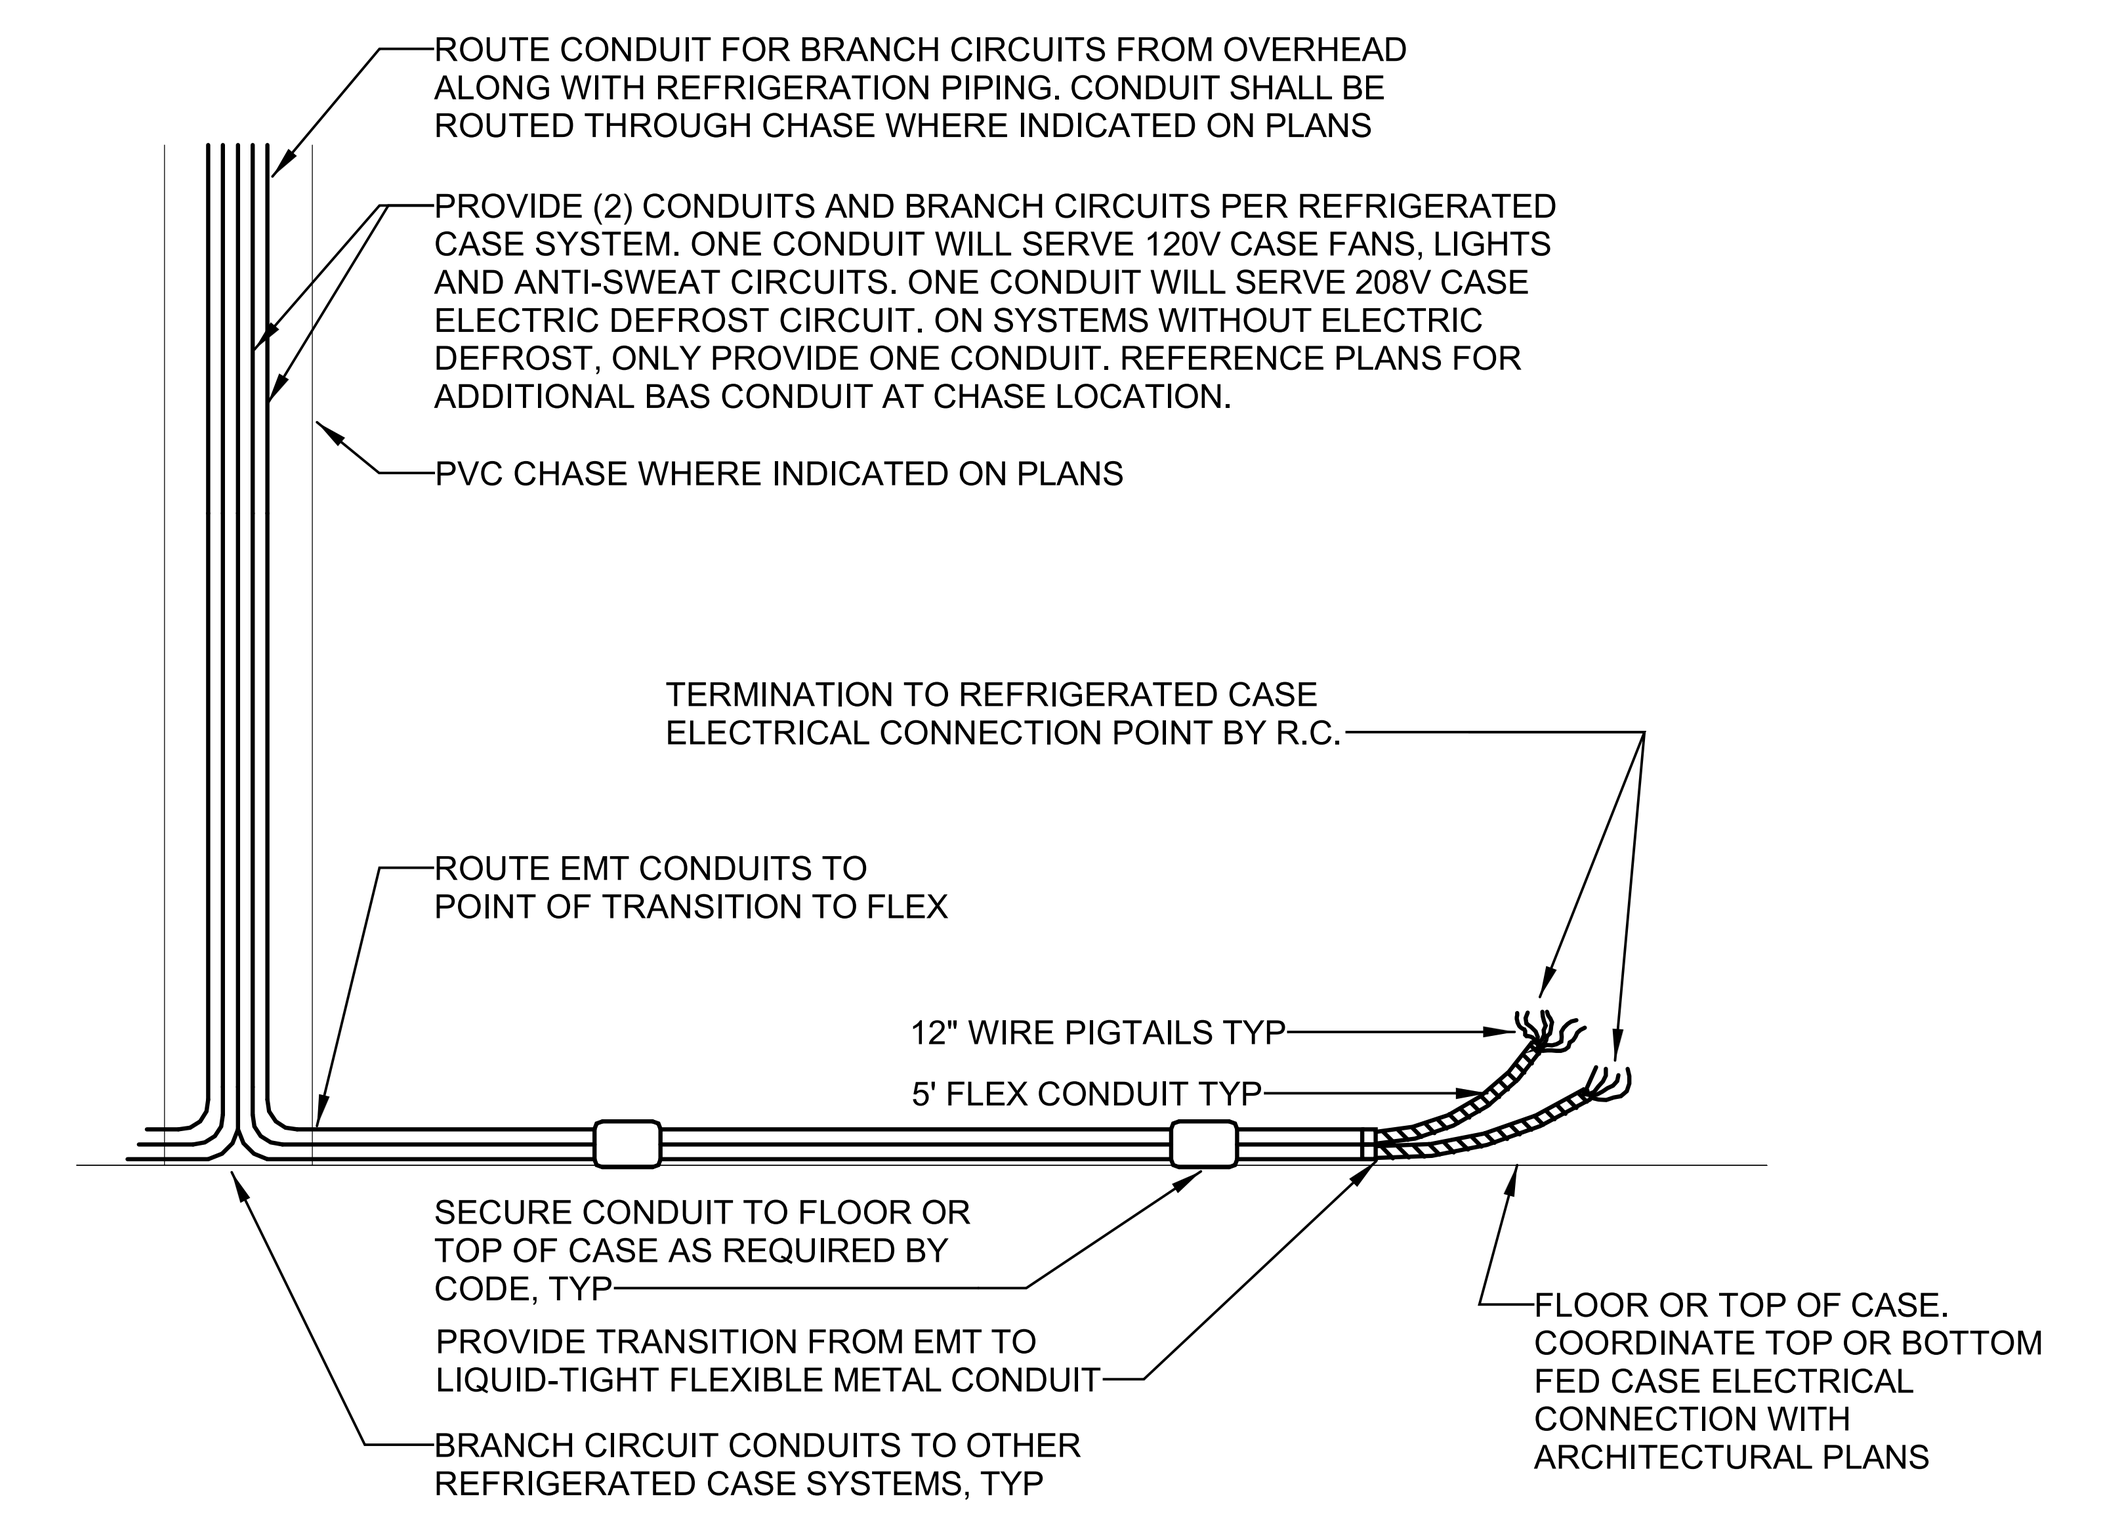1/4" = 1'-0"




## 1 GR CHECKOUT REFRIGERATION ELECTRICAL PLAN

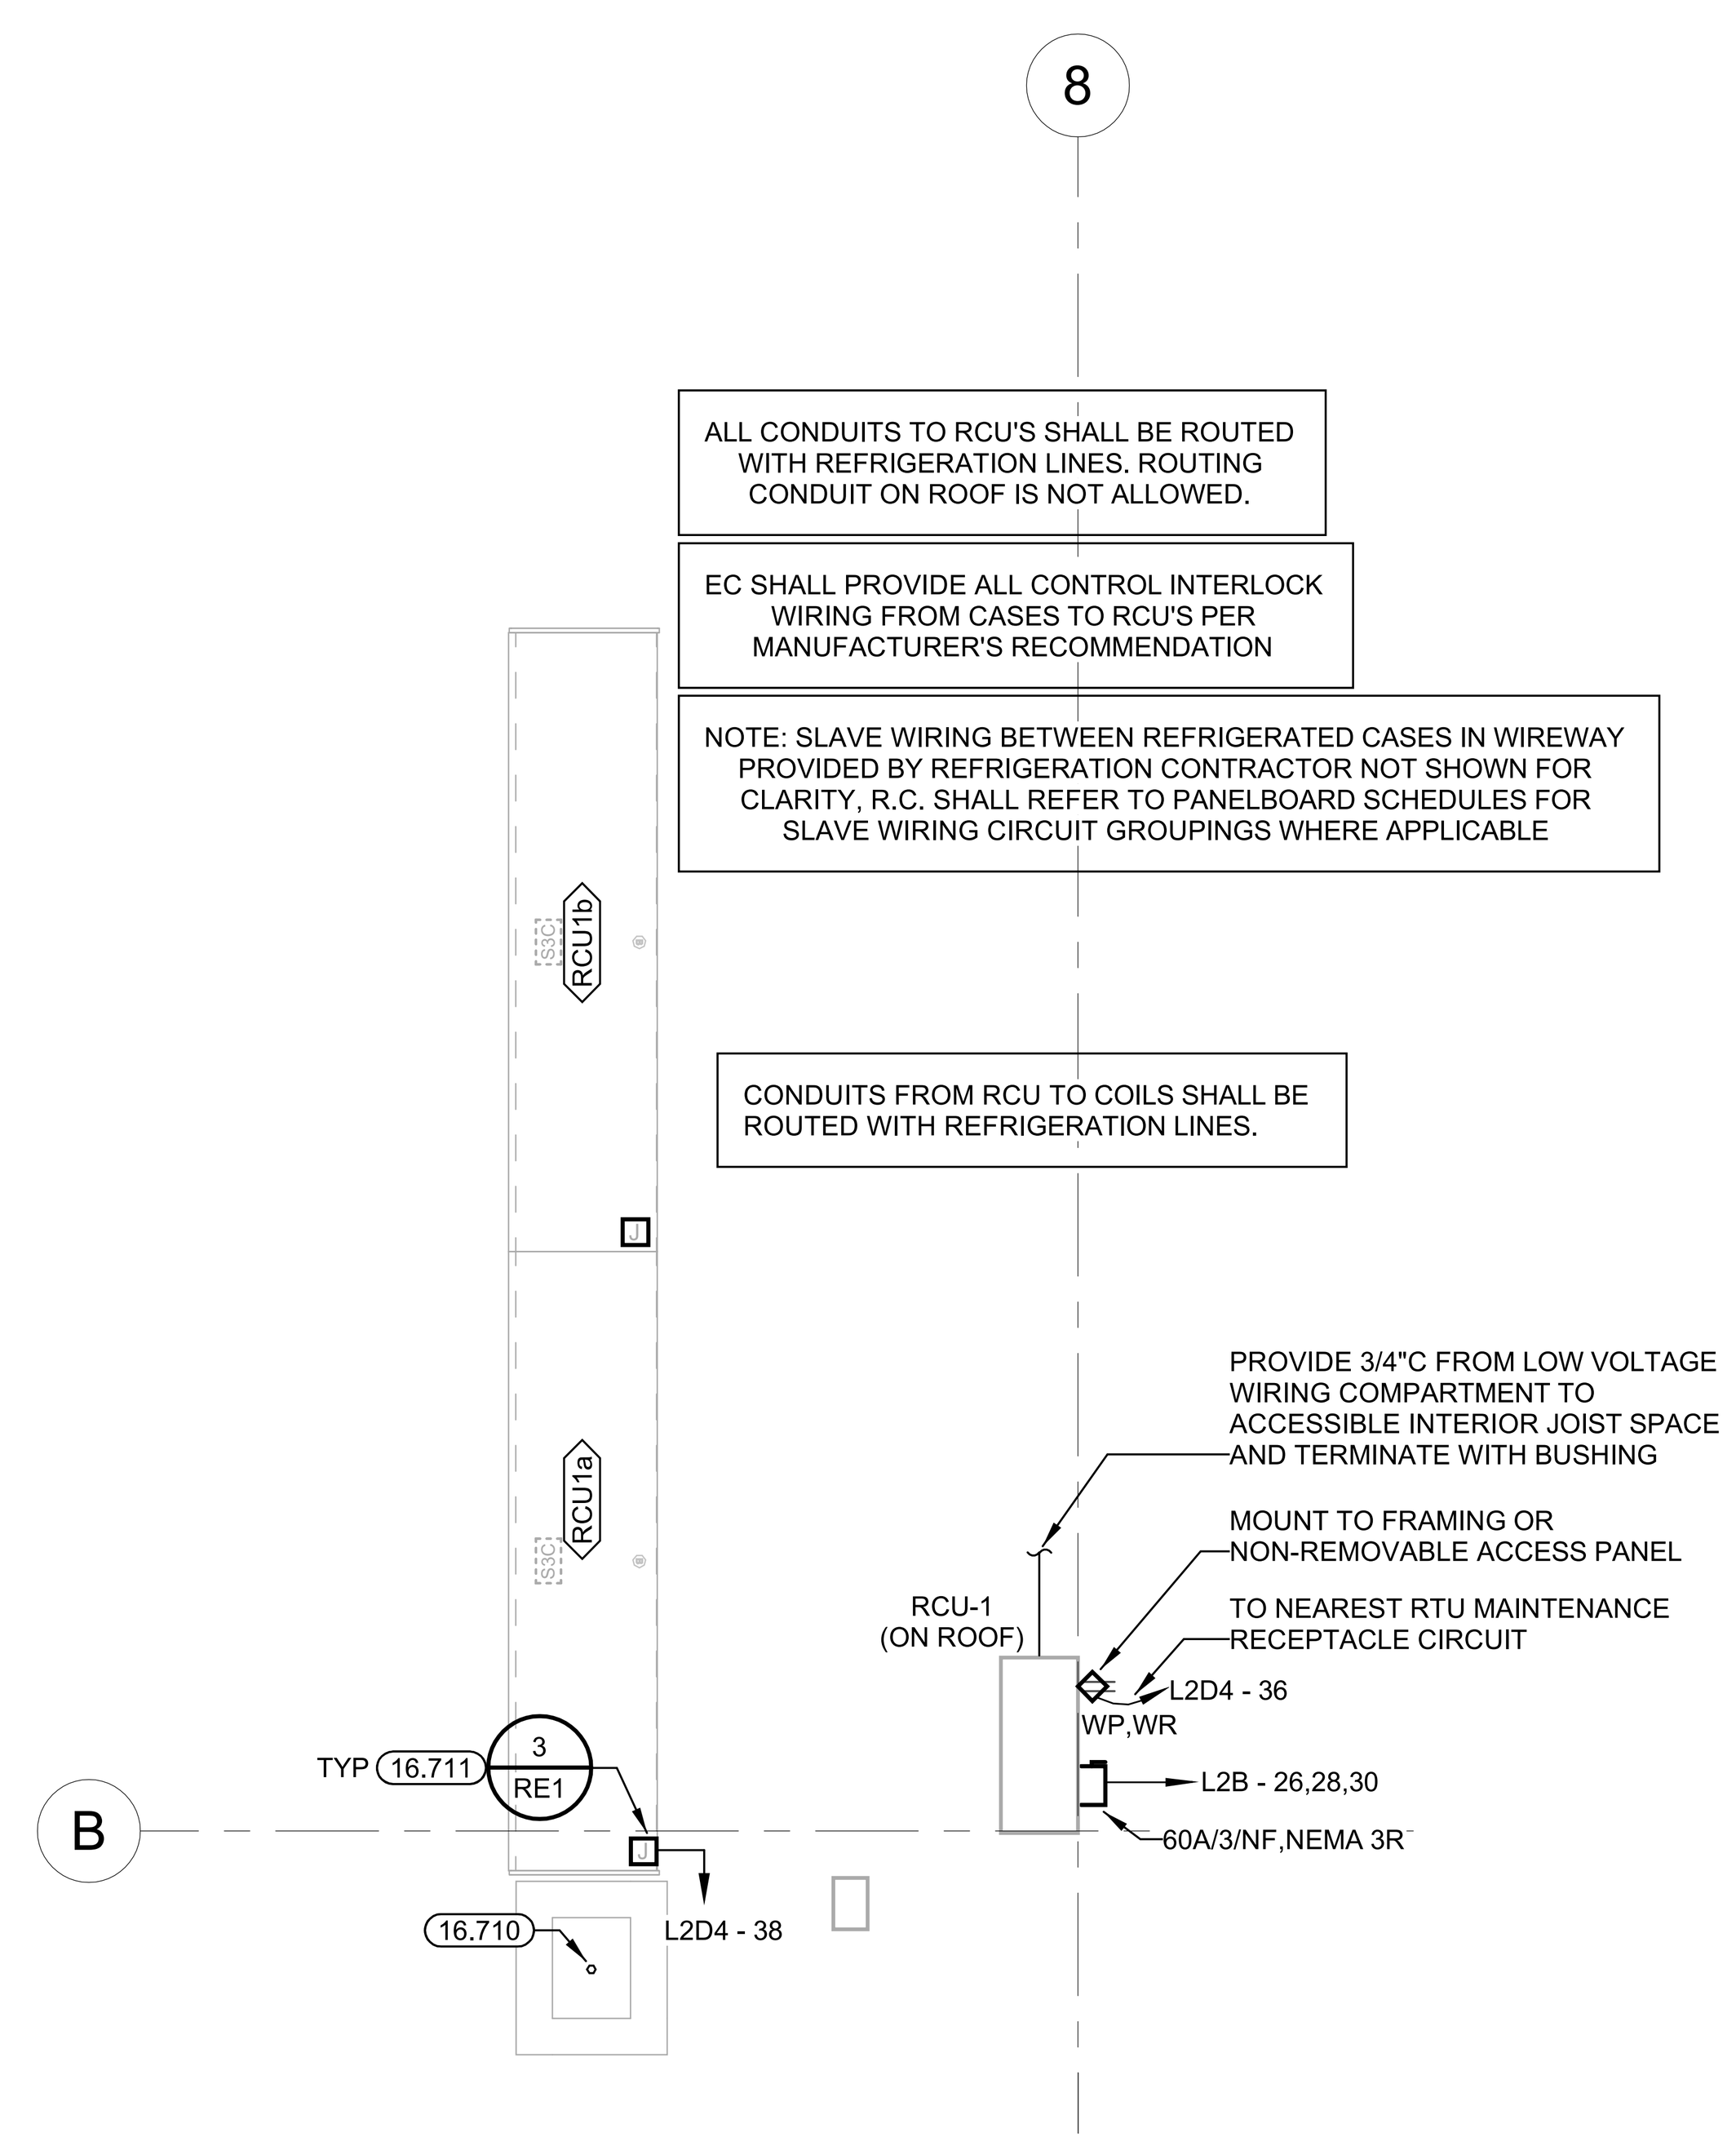1/4" = 1'-0"

## FEEDER SCHEDULE

ALL CONDUIT AND CONDUCTOR SIZES ARE BASED ON EMT WITH 40% FILL, 75ºC RATED TERMINATIONS AND TYPE THHN/THWN-2 INSULATION. FOR NON-EMT CONDUIT OR TERMINATIONS OR INSULATION TYPES RATED LESS THAN 75ºC, MODIFY SIZES ACCORDING TO NEC.
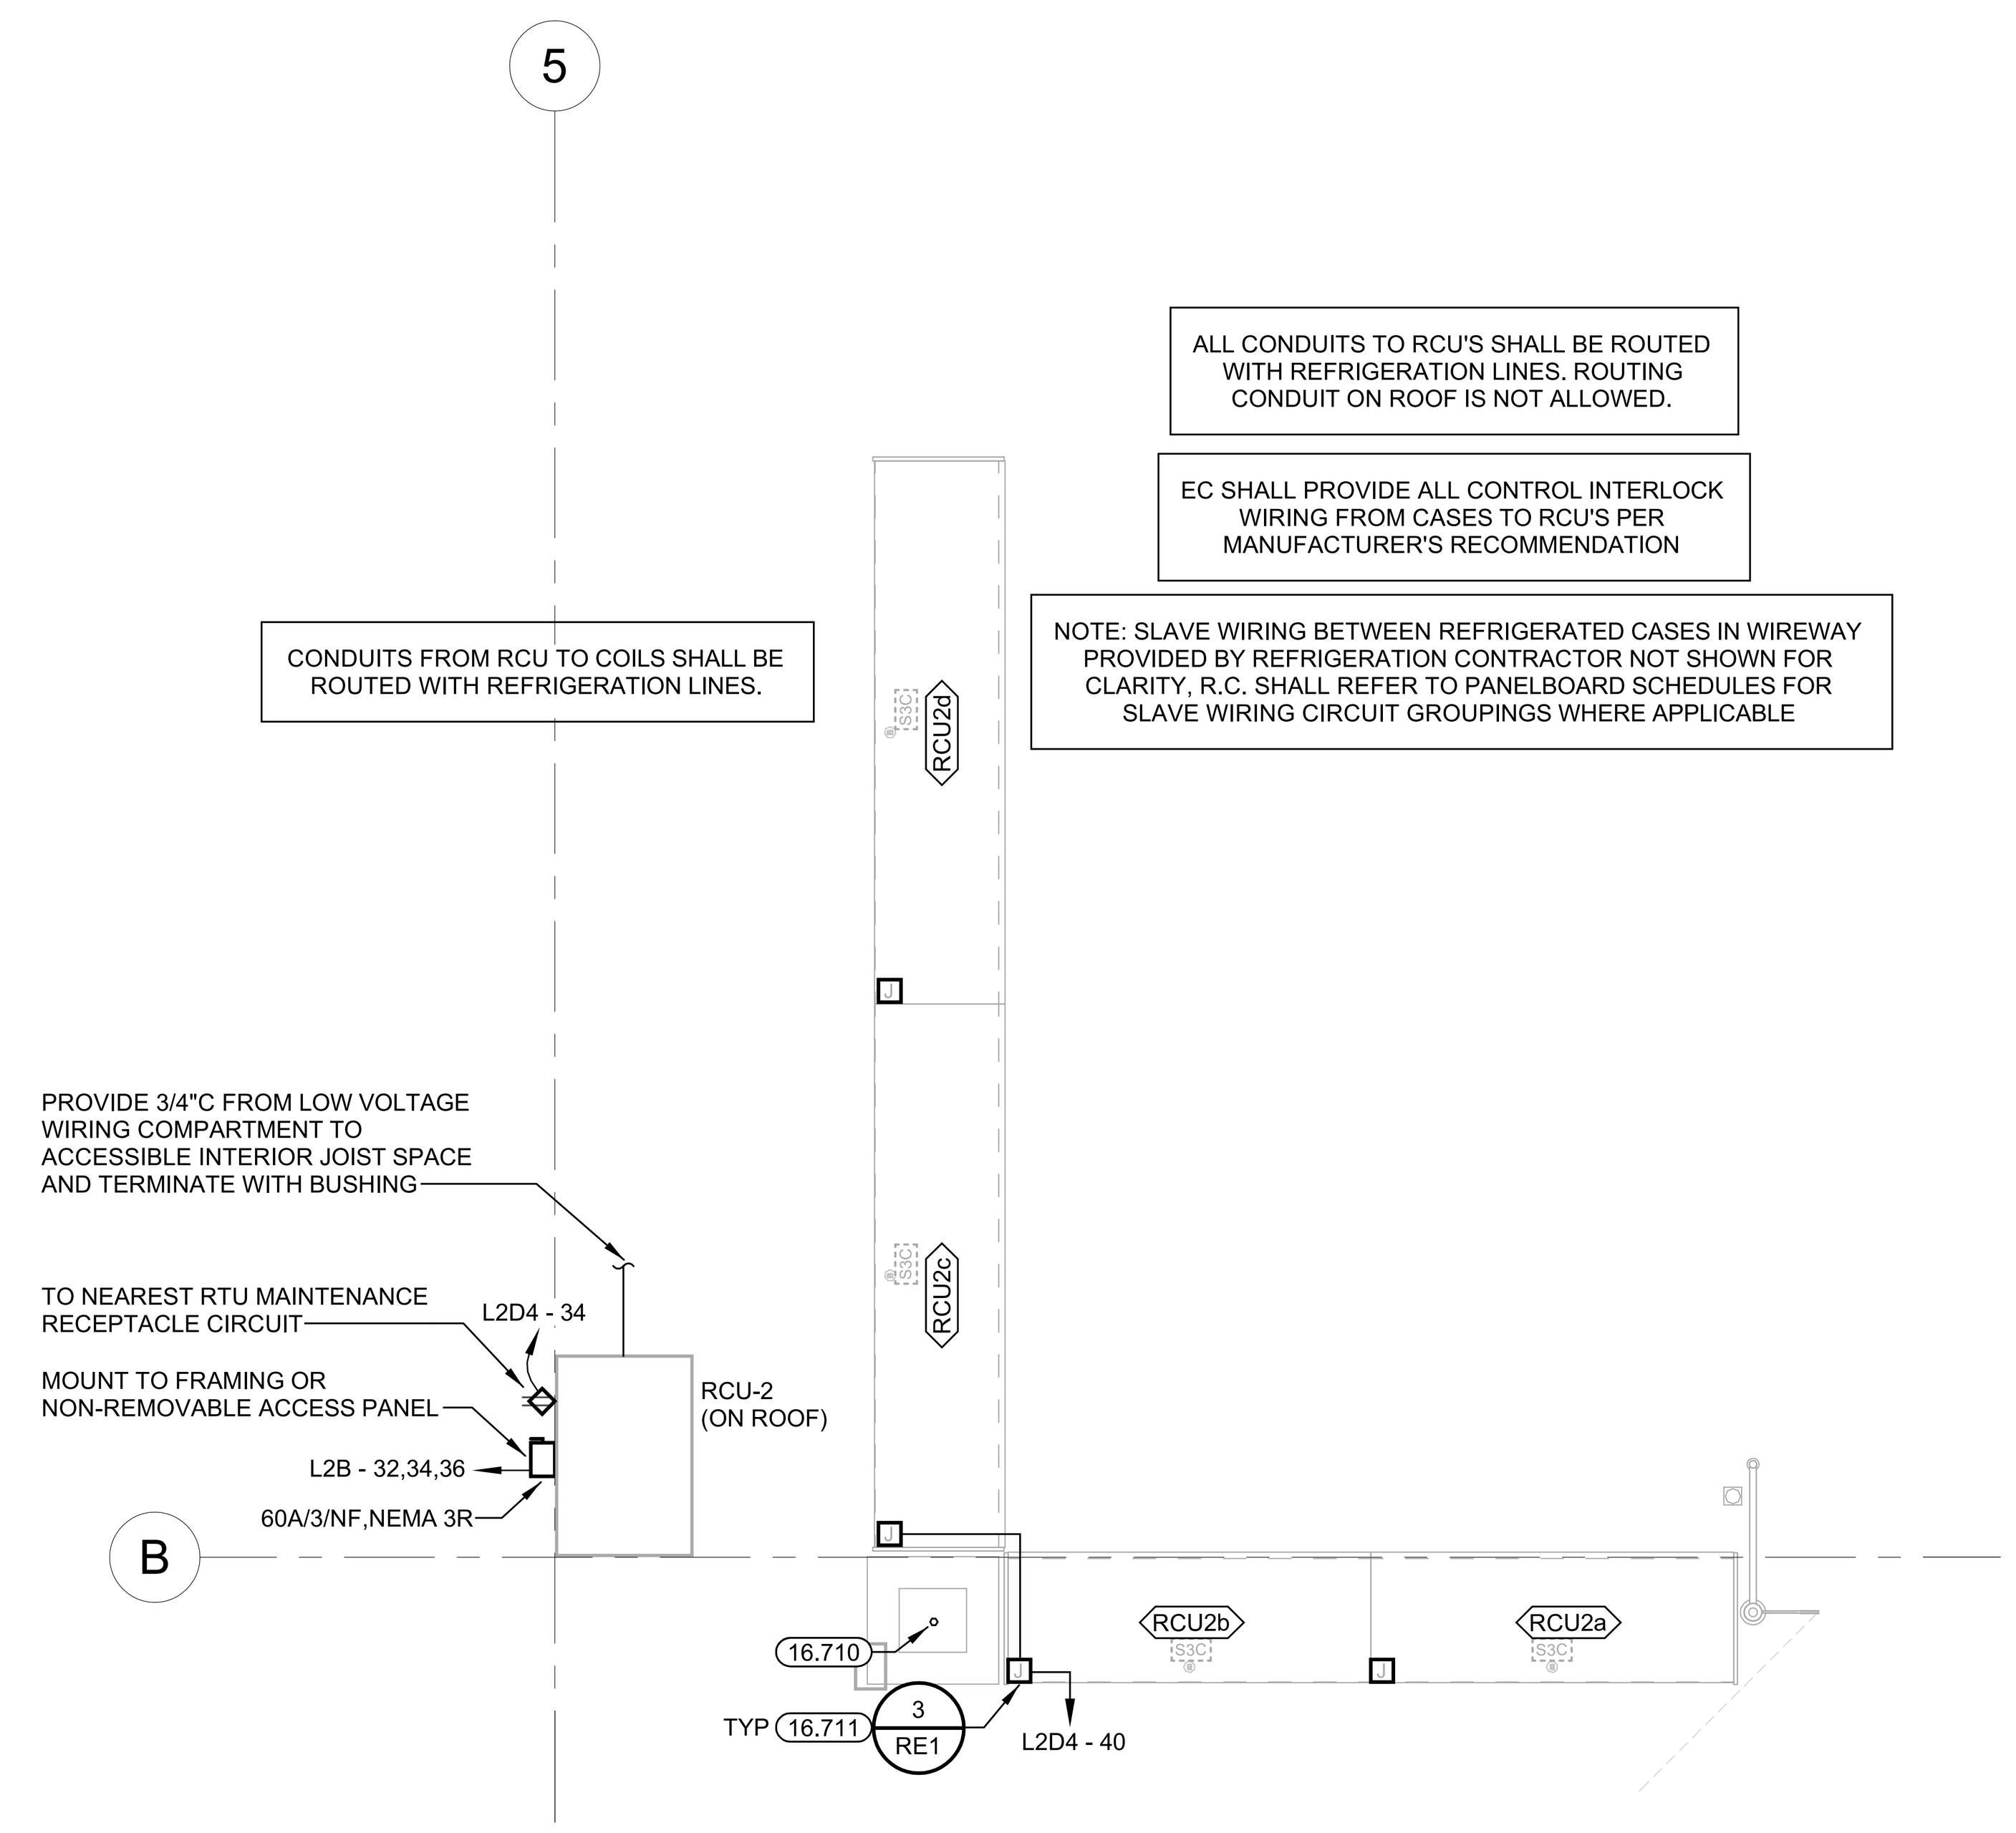
| | |
|---|---|
| XXX | **FEEDER OR GROUND SIZE** |

## GENERAL REFRIGERATION ELECTRICAL NOTES

08.28.20

1. COORDINATE ALL WORK WITH REFRIGERATION CONTRACTOR (R.C.) PRIOR TO INSTALLATION.
2. REFRIGERATED CASES: E.C. SHALL PROVIDE CONDUIT AND WIRE FOR REFRIGERATED CASE FANS, LIGHTS AND ANTI-SWEAT HEATERS, AND (IF APPLICABLE) ELECTRICAL DEFROST. PROVIDE ADEQUATE CONDUCTOR LENGTH TO ALLOW TERMINATION. NEATLY BUNDLE CIRCUITS AND CLEARLY TAG AND LABEL EACH CIRCUIT WITH BRANCH CIRCUIT DESIGNATION AND REFRIGERATION SYSTEM NUMBER FOR FINAL TERMINATION AT CASE BY R.C. REF CASE CONNECTION WIRING DETAIL.
3. IF NEW CASES ARE PROVIDED WITH A FACTORY INSTALLED TERMINAL STRIP AND JUMPERS FOR CONNECTION TO A SINGLE CIRCUIT FOR 120V CASE LOADS, RC SHALL REMOVE FACTORY INSTALLED JUMPERS AS REQUIRED TO UTILIZE EXISTING SEPARATE 120V FAN/LIGHT/ANTI-SWEAT CIRCUITS AS INDICATED ON PLANS AND/OR PANELBOARD SCHEDULES. ANY EXISTING ANTI-SWEAT CONTROL (SWEATMISER) SHALL BE BY-PASSED. CASES UTILIZING ELECTRICAL DEFROST WILL BE PROVIDED WITH SEPARATE 208V TERMINATIONS AT THE TERMINAL STRIP FOR CONNECTION TO THE 208V ELECTRIC DEFROST CIRCUIT. RC SHALL MAKE FINAL TERMINATIONS OF 120V AND 208V POWER CIRCUIT(S) AT CASE TERMINAL STRIP. REFER TO CASE CONNECTION SCHEMATIC ON REFRIGERATION SHEETS.
4. WALK-IN UNITS: PROVIDE CONDUIT AND WIRE FOR EVAPORATOR COIL FANS (CF) AND (IF APPLICABLE) ELECTRIC DEFROST (ED). PROVIDE ADEQUATE CONDUCTOR LENGTH TO ALLOW TERMINATION. NEATLY BUNDLE CIRCUITS AND CLEARLY TAG AND LABEL EACH CIRCUIT WITH BRANCH CIRCUIT DESIGNATION AND REFRIGERATION SYSTEM NUMBER FOR FINAL TERMINATION AT COIL BY R.C. REF EVAPORATOR COIL WIRING DETAIL.
5. ROUTE REFRIGERATED CASE AND WALK-IN UNIT COIL FAN, LIGHTS, ANTI-SWEAT AND DEFROST BRANCH CIRCUITS TO WIREWAYS PROVIDED AT REFRIGERATION EQUIPMENT AND/OR PANELBOARDS AS REQUIRED.
6. REFRIGERATED CASE WIRING COMPARTMENT REPRESENTED ON DRAWING BY JUNCTION BOX.
7. KEEP PENETRATIONS THROUGH WALK-IN UNITS TO A MINIMUM. ROUTE ALL CONDUITS SERVING FREEZERS AND COOLERS ON INSIDE OF BOX.
8. ALL CONDUITS INSTALLED ON TOP OF WALK-IN UNITS SHALL BE A MINIMUM OF 6" FROM ANY EDGE TO ALLOW SPACE FOR EDGE PROTECTION NETTING. DO NOT ROUTE CONDUITS ABOVE THE CEILING GRID ACCESS UNLESS CONDUITS ARE INSTALLED IN JOIST SPACE, REF ARCH.
9. UNDERSLAB CIRCUITS SHALL NOT BE ROUTED UNDER WALK-IN FREEZERS AND SHALL BE ROUTED ABOVE REFRIGERANT LINES WHERE THEY CROSS.
10. CIRCUITS FOR REFRIGERATED CASES SERVED BY UNDERSLAB REFRIGERATION PIPING ARE TO BE ROUTED UNDERSLAB AND EXTENDED TO THE FIRST CASE IN EACH SYSTEM. WIRING AND CONDUIT FOR SLAVE WIRING BETWEEN CASES SHALL BE PROVIDED BY R.C. REFER TO UNDERSLAB CASE CONNECTION WIRING DETAIL.
11. ALL UNDERSLAB CONDUITS SHALL BE 3/4" MIN.
12. CIRCUITS FOR REFRIGERATED CASES SERVED BY OVERHEAD REFRIGERATION PIPING ARE TO BE ROUTED DOWN FROM STRUCTURE AT THE SAME LOCATION AS THE REFRIGERATION PIPING AND EXTENDED TO THE FIRST CASE IN EACH SYSTEM. WIRE AND CONDUIT FOR SLAVE WIRING BETWEEN CASES SHALL BE PROVIDED BY THE R.C. REFER TO OVERHEAD CASE CONNECTION WIRING DETAIL.
13. ON GROUPS OF THREE OR MORE REFRIGERATED CASES WITH ELECTRIC DEFROST, R.C. SHALL CONNECT CASES TO CREATE A THREE-PHASE HEATER CIRCUIT. HEATER LOADS SHALL BE BALANCED BETWEEN PHASES AS EVENLY AS POSSIBLE. REF CASE DEFROST WIRING DETAIL.
14. PROVIDE A SEPARATE NEUTRAL FOR EACH NEW BRANCH CIRCUIT SERVING REFRIGERATED CASES OR WALK-IN UNITS.
15. PROVIDE CIRCUIT BREAKER LOCKING DEVICE (LOCK-OFF FOR MAINTENANCE) ON NEW AND/OR EXISTING CIRCUIT BREAKERS SERVING REFRIGERATED CASES.
16. REFERENCE ARCHITECTURAL DEMOLITION PLANS FOR FULL EXTENT OF DEMOLITION WORK REQUIRED.

## KEYNOTES

16.710 BUILDING AUTOMATION CONDUITS: PROVIDE 1" (UNLESS NOTED OTHERWISE) CONDUIT (WITH PULL WIRE) ROUTED FROM 6" ABOVE BOTTOM OF BAR JOIST IN SALES FLOOR ACCESSIBLE CEILING SPACE THROUGH PVC CHASE.

16.711 POINT OF TRANSITION FROM EMT TO FLEX. PROVIDE CONDUIT AND BRANCH CIRCUITS FOR REFRIGERATED CASE FANS, LIGHTS, ANTI-SWEAT HEATERS, AND ELECTRICAL DEFROST (IF REQUIRED). TERMINATION TO REFRIGERATED CASE ELECTRICAL CONNECTION POINT BY R.C. REFER TO CASE CONNECTION WIRING DETAIL.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


Cuhaci & Peterson
Architects Engineers Planners
2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
www.c-p.com



STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT: LAKE CITY, FL CONTEMPORANEOUSLY WITH ITS ISSUE DATE ON 11/22/21 SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: 2210335 PROTO: 188 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:26:48-05'00'

JAISON PRADEEP MORAS
LICENSE
No 76917
STATE OF FLORIDA
PROFESSIONAL ENGINEER
11/22/21

REFRIGERATION ELECTRICAL PLAN

SHEET: RE1


11/19/2021 11:30:57 AM
C:\Users\mohammed.khan\Documents\00767_LakeCity_FL_188_L_MEP_V20_mkhanVUDFE.rvt

| DATA SCHEDULE | | | | DATA SCHEDULE | | | | VOICE SCHEDULE | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| CABLE | LOCATION - DESCRIPTION | TYPE | PH | CABLE | LOCATION - DESCRIPTION | TYPE | PH | CABLE | LOCATION - DESCRIPTION | TYPE | PH | PHONE MODEL | RESTRICT Y/N/TOLL | CLOSET |
| D-BKTV-1 | BAKERY | | 2 | D-REG92 | COURTESY DESK | REG | 1 | V-105 | SALES-ELECTRONICS | DESK | 2 | 7960 | T | |
| D-BKTV-2 | BAKERY | | 2 | D-REG94 | COURTESY DESK | REG | 1 | V-150 | COURTESY DESK | DESK | 1 | 7960 | N | |
| D-BKTV-3 | BAKERY | | 2 | D-REG96 | COURTESY DESK | REG | 1 | V-151 | COURTESY DESK | DESK | 1 | 7960 | N | |
| D-REG01 | CHECKOUT | REG | 2 | D-DW01 | COURTESY DESK-DELTA WORKS | | 1 | V-359 | MONEY CENTER | | 2 | | | |
| D-REG02 | CHECKOUT | REG | 2 | D-CSD01 | COURTESY DESK-WARRANTY PC | TERM | 1 | V-984 | MONEY CENTER | | 2 | | | |
| D-REG03 | CHECKOUT | REG | 2 | D-DLTV-1 | DELI | | 2 | | | | | | | |
| D-REG04 | CHECKOUT | REG | 2 | D-DLTV-2 | DELI | | 2 | | | | | | | |
| D-REG05 | CHECKOUT | REG | 2 | D-DLTV-3 | DELI | | 2 | | | | | | | |
| D-REG06 | CHECKOUT | REG | 2 | D-ELTV-1 | ELECTRONICS | | 2 | | | | | | | |
| D-REG07 | CHECKOUT | REG | 2 | D-ELTV-2 | ELECTRONICS | | 2 | | | | | | | |
| D-REG08 | CHECKOUT | REG | 2 | D-ELTV-3 | ELECTRONICS | | 2 | | | | | | | |
| D-REG09 | CHECKOUT | REG | 2 | D-REG66 | ELECTRONICS | REG | 2 | | | | | | | |
| D-REG10 | CHECKOUT | REG | 2 | D-DT3-01 | MONEY CENTER | | 2 | | | | | | | |
| D-REG11 | CHECKOUT/SCO | REG | 2 | D-DT3-02 | MONEY CENTER | | 2 | | | | | | | |
| D-REG12 | CHECKOUT/SCO | REG | 2 | D-DT3-03 | MONEY CENTER | | 2 | | | | | | | |
| D-REG13 | CHECKOUT/SCO | REG | 2 | D-MCTV-1 | MONEY CENTER | | 2 | | | | | | | |
| D-REG14 | CHECKOUT/SCO | REG | 2 | D-MCTV-2 | MONEY CENTER | | 2 | | | | | | | |
| D-REG15 | CHECKOUT/SCO | REG | 2 | D-PBC-01 | MONEY CENTER | | 2 | | | | | | | |
| D-REG16 | CHECKOUT/SCO | REG | 2 | D-PBC-02 | MONEY CENTER | | 2 | | | | | | | |
| D-REG17 | CHECKOUT/SCO | REG | 2 | D-PBC-03 | MONEY CENTER | | 2 | | | | | | | |
| D-REG18 | CHECKOUT/SCO | REG | 2 | D-PBC-04 | MONEY CENTER | | 2 | | | | | | | |
| D-REG19 | CHECKOUT/SCO | REG | 2 | D-RXTV01 | PHARMACY | TV | 1 | | | | | | | |
| D-REG20 | CHECKOUT/SCO | REG | 2 | D-REG67 | SALES-ELECTRONICS | REG | 2 | | | | | | | |
| D-REG21 | CHECKOUT/SCO | REG | 2 | D-REG69 | SALES-JEWELRY | REG | 2 | | | | | | | |
| D-REG22 | CHECKOUT/SCO | REG | 2 | D-ACTV-1 | TLE | | 2 | | | | | | | |
| D-REG23 | CHECKOUT/SCO | REG | 2 | D-ACTV-2 | TLE | | 2 | | | | | | | |
| D-REG24 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG25 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG26 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG27 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG28 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG29 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG30 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG31 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG32 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG33 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG34 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG35 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG36 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-REG37 | CHECKOUT/SCO | REG | 2 | | | | | | | | | | | |
| D-CSDPRT | COURTESY DESK | PRT | 1 | | | | | | | | | | | |
| D-REG91 | COURTESY DESK | REG | 1 | | | | | | | | | | | |




1 TELECOM PLAN
1" = 20'-0"

## GENERAL TELECOM NOTES

08.02.19

1. VOICE/DATA OUTLET BOXES AND CONDUITS PROVIDED BY ELECTRICAL CONTRACTOR
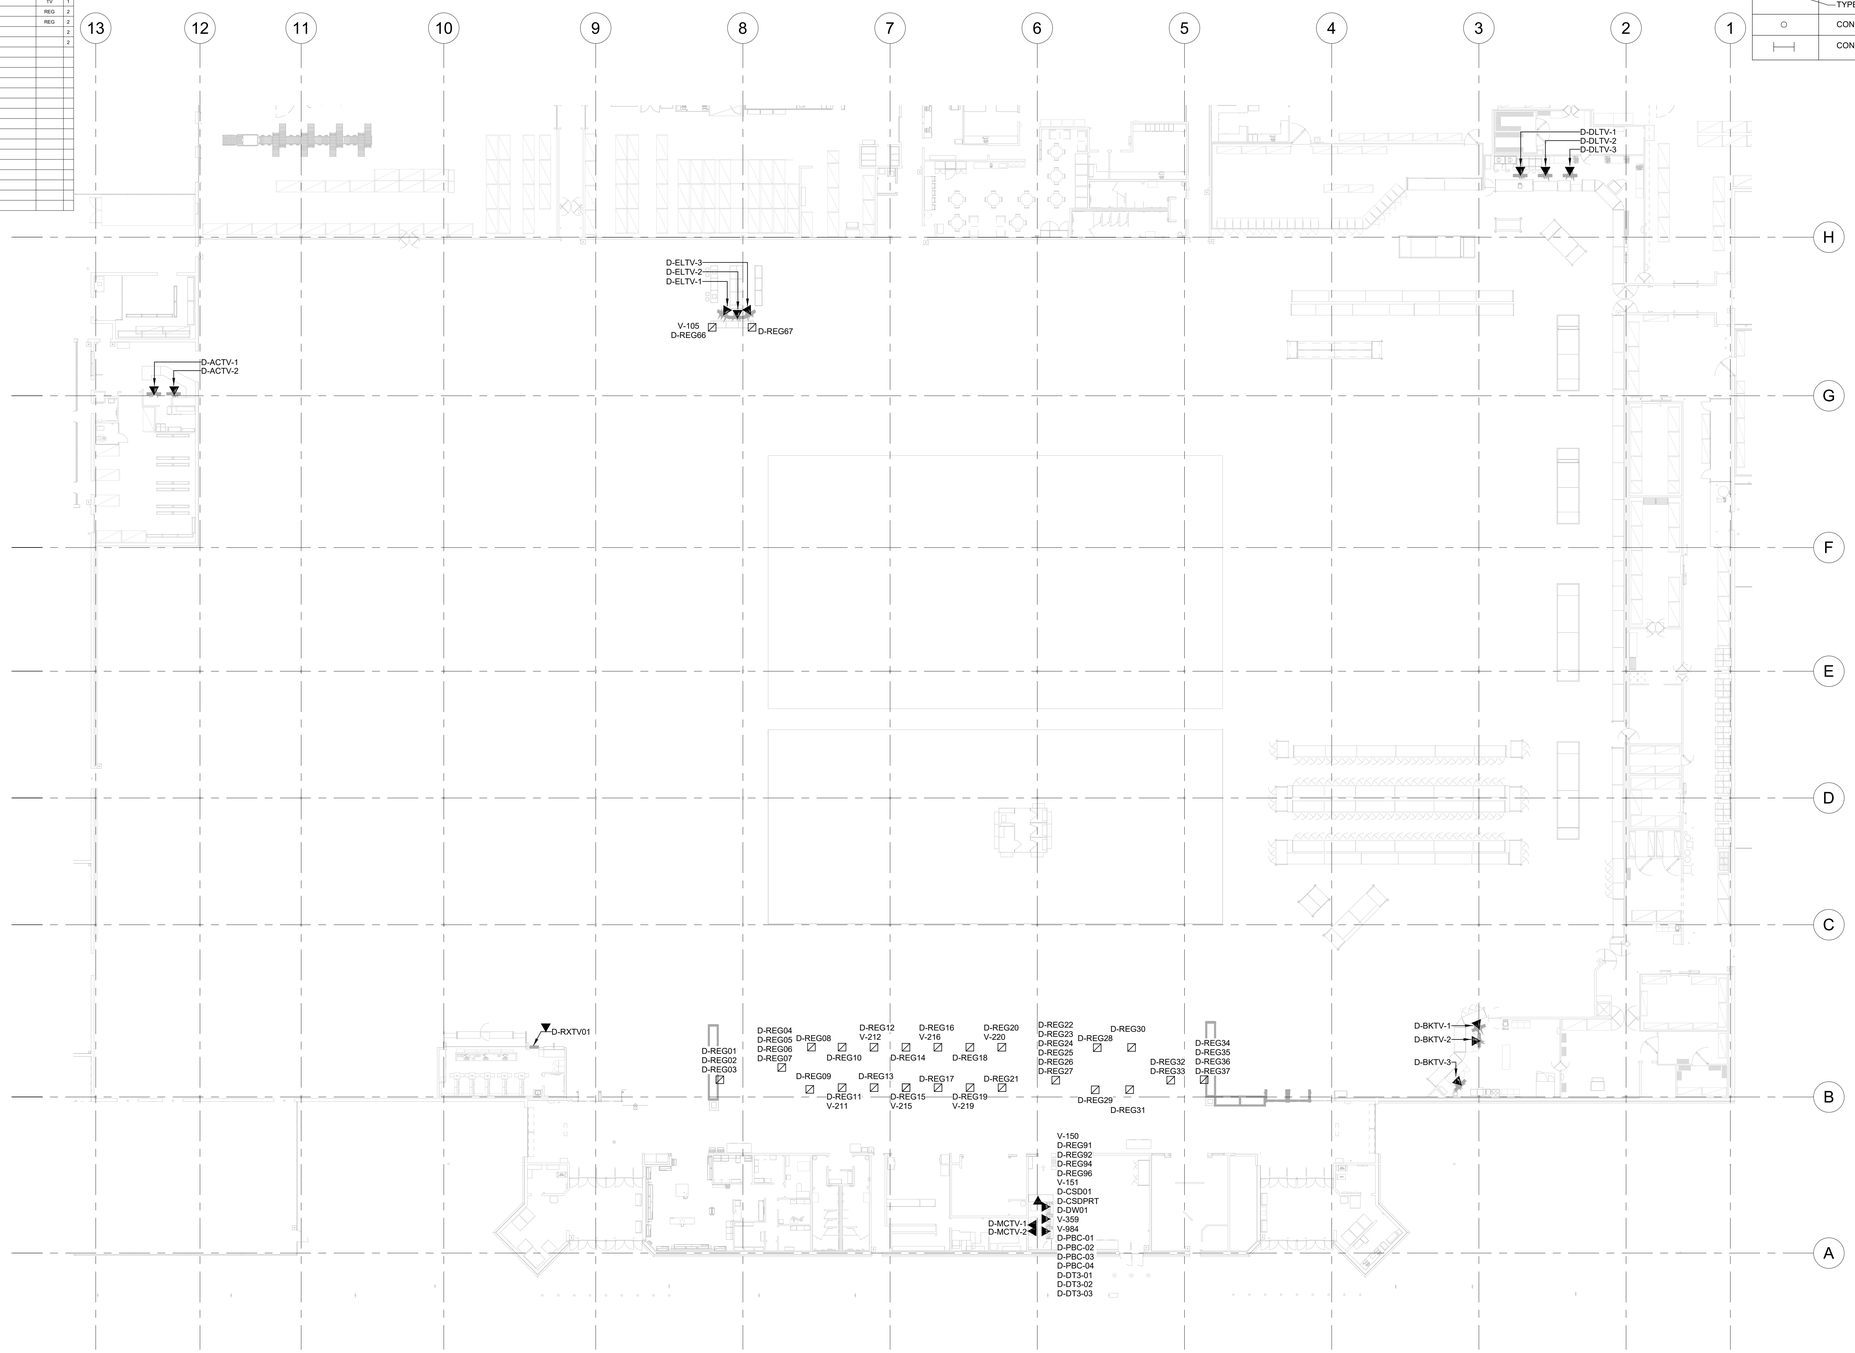
## TELECOM SYMBOLS LEGEND

08.02.19

(SYMBOLS APPLY ONLY WHEN USED ON DRAWINGS)

| SYMBOLS | DESCRIPTION |
|---|---|
| ▼ | VOICE/DATA BOX (BOX AND CONDUIT BY OTHERS) |
| ▽ | VOICE/DATA BOX |
| ⊠ | TELEPOWER POLE |
| V-951 | CABLE IDENTIFICATION NUMBER |
| | TYPE (VOICE/DATA) |
| ○ | CONDUIT DROP |
| ⊢⊣ | CONDUIT SLEEVE |

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8999
www.cpaarchitects.com
Cabral & Peterson Architects Engineers Planners


STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS SPECIFIC PROJECT AND CONTEMPORANEOUSLY WITH ITS ISSUE. ANY REUSE OF THESE DRAWINGS ON A DIFFERENT PROJECT SITE OR AT A LATER TIME, WITHOUT THE EXPRESS WRITTEN PERMISSION OF CABRAL & PETERSON ENGINEERS, REPRESENTS AN UNAUTHORIZED REUSE OF THE INSTRUMENTS OF SERVICE AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
2210335 | PROTO

JOB NUMBER: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | CM |
| DRAWN BY: | MAK |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jaison Moras
Reason: This item has been electronically signed and sealed by Jaison P. Moras, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.12.03 09:26:58-05'00'

JAISON PRADEEP MORAS LICENSE No 76917 STATE OF FLORIDA PROFESSIONAL ENGINEER
11/22/21

TELECOM PLAN

SHEET: T1

11/3/2021 11:31:17 AM
C:\Users\mmaldonado\Desktop\Documents\0767_LakeCity_FL_168_L_MOD_ADL.rvtMaldonadoMAK.rvt

## AIR DEVICE SCHEDULE

| MARK | SERVICE | MANUFACTURER | MODEL | STYLE | FRAME TYPE | FACE SIZE | NOTES |
|---|---|---|---|---|---|---|---|
| CD1 | SUPPLY AIR | TUTTLE & BAILEY<br>E.H.PRICE<br>CARNES | M<br>SMD<br>SKFA | ROUND NECK<br>CEILING DIFFUSER | SURFACE<br>MOUNT | REFER TO<br>DRAWINGS | B, E, I, L, M, N |
| TG | TRANSFER AIR | TUTTLE & BAILEY<br>E.H.PRICE<br>CARNES | CRE500<br>80F<br>RAPAF | 1/2"x1/2"x1/2"<br>EGGCRATE<br>CEILING GRILLE | LAY-IN | REFER TO<br>DRAWINGS | C, D, E, M |
| TG1 | TRANSFER AIR | TUTTLE & BAILEY<br>E.H.PRICE<br>CARNES | CRE500<br>80F<br>RAPAF | 1/2"x1/2"x1/2"<br>EGGCRATE<br>CEILING GRILLE | SURFACE<br>MOUNT | REFER TO<br>DRAWINGS | C, E |

### VOLUME / BALANCE DAMPER SCHEDULE

| TYPE | MANUFACTURER / MODEL |
|---|---|
| ROUND | AES / WMVCD<br>RUSKIN / WMRS25 |
| RECTANGULAR | AES / AMD4<br>RUSKIN / WMD25 |

GENERAL INFORMATION (ALL DEVICES):
1. INSTALL BOTTOM OF WALL MOUNTED AIR DEVICES AT ELEVATION INDICATED ON DRAWINGS UNLESS NOTED OTHERWISE.
2. BALANCE DAMPER CONTACTS:
   AES - (800) 798-0402
   RUSKIN - (816) 761-7476

NOTES:
A. 6-WAY (DB1-DB3) OR 4-WAY (DB4-DB8) THROW UNLESS SHOWN OTHERWISE WITH FLOW ARROWS ON PLAN.
B. ALL STEEL CONSTRUCTION.
C. ALL ALUMINUM CONSTRUCTION.
D. BRANCH DUCT SIZE SHALL BE SAME AS NOTED DIFFUSER NECK SIZE UNLESS NOTED OTHERWISE.
E. STANDARD WHITE FINISH.
F. PROVIDE NECK FOR DUCT CONNECTION.
G. DROP BOX DIFFUSERS FURNISHED BY OWNER INSTALLED BY CONTRACTOR. REFERENCE SPECIFICATIONS.
H. PROVIDE INTEGRAL OPPOSED BLADE DAMPERS ON ALL DRUM LOUVERS ON DROP BOXES WITH BRANCH DUCTWORK ATTACHED TO THE SUPPLY PLENUM.
I. PROVIDE MANUFACTURER'S OPPOSED BLADE DAMPER ACCESSIBLE THROUGH FACE UNLESS NOTED OTHERWISE.
J. PROVIDE WITH FASTENERS FOR COMPLETE (NON-HINGED) REMOVABILITY OF GRILLE. DO NOT PROVIDE FILTER UNLESS NOTED OTHERWISE.
K. TWO 2" SLOTS WITH MANUFACTURER'S INSULATED PLENUM (TUTTLE & BAILEY LP, PRICE JSPI, CARNES CXPC.)
L. REFER TO PLANS FOR DIRECTIONAL ARROWS INDICATING CFM THROWS FOR PROPER GRILLE SELECTION. NO DIRECTIONAL ARROWS INDICATES 4-WAY THROW.
M. PROVIDE ROUND NECK ADAPTER
N. PROVIDE CEILING TRANSITION REGISTER BOX WITH 16" OR 24" PLATE FOR ROUGH-IN.




NOTES:
1. SPIN-IN FITTINGS W/ SCOOPS ARE NOT ACCEPTABLE
2. REF PLANS FOR RUNOUT SIZES
3. 45° LEAD IN

4 HIGH EFFICIENCY BRANCH DUCT FITTING
NTS




3 DUCT SUPPORT AND GRILLE
NTS

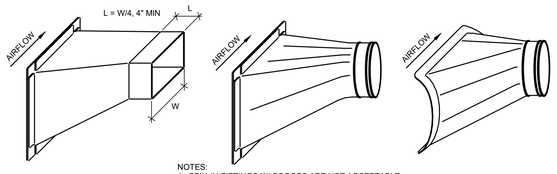


2 MOTHER'S ROOM MECHANICAL PLAN
1/4" = 1'-0"

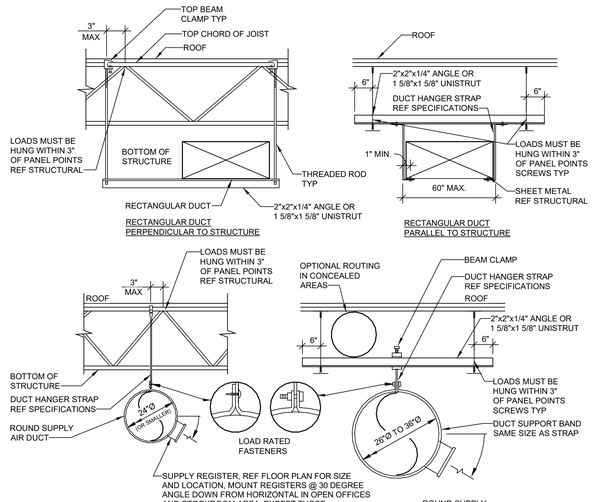


1 OVERALL MECHANICAL PLAN
1" = 30'-0"

## KEYNOTES
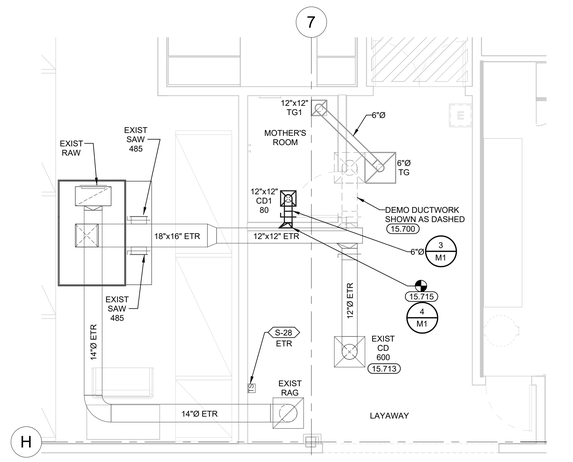
| | |
|---|---|
| 15.700 | REMOVE AIR DEVICES AND DUCTWORK SHOWN DASHED UNLESS OTHERWISE NOTED AND CAP OFF DUCTWORK TO REMAIN. PATCH AND REPAIR DUCTWORK AS NEEDED INCLUDING SEALING DUCTWORK TO REMAIN PER SPECIFICATIONS. |
| 15.713 | REBALANCE AIR DEVICE TO CFM SHOWN. REDISTRIBUTE AIR FROM EXISTING DUCTWORK TO MATCH NEW CFM REQUIREMENTS. FIELD VERIFY LOCATION OF EXISTING DUCTWORK. |
| 15.715 | CONNECT NEW DUCTWORK TO EXISTING SUPPLY DUCTWORK. REDISTRIBUTE AIR FROM EXISTING DUCTWORK TO MATCH NEW CFM REQUIREMENTS. FIELD VERIFY LOCATION OF EXISTING DUCTWORK. |

## GENERAL NOTES

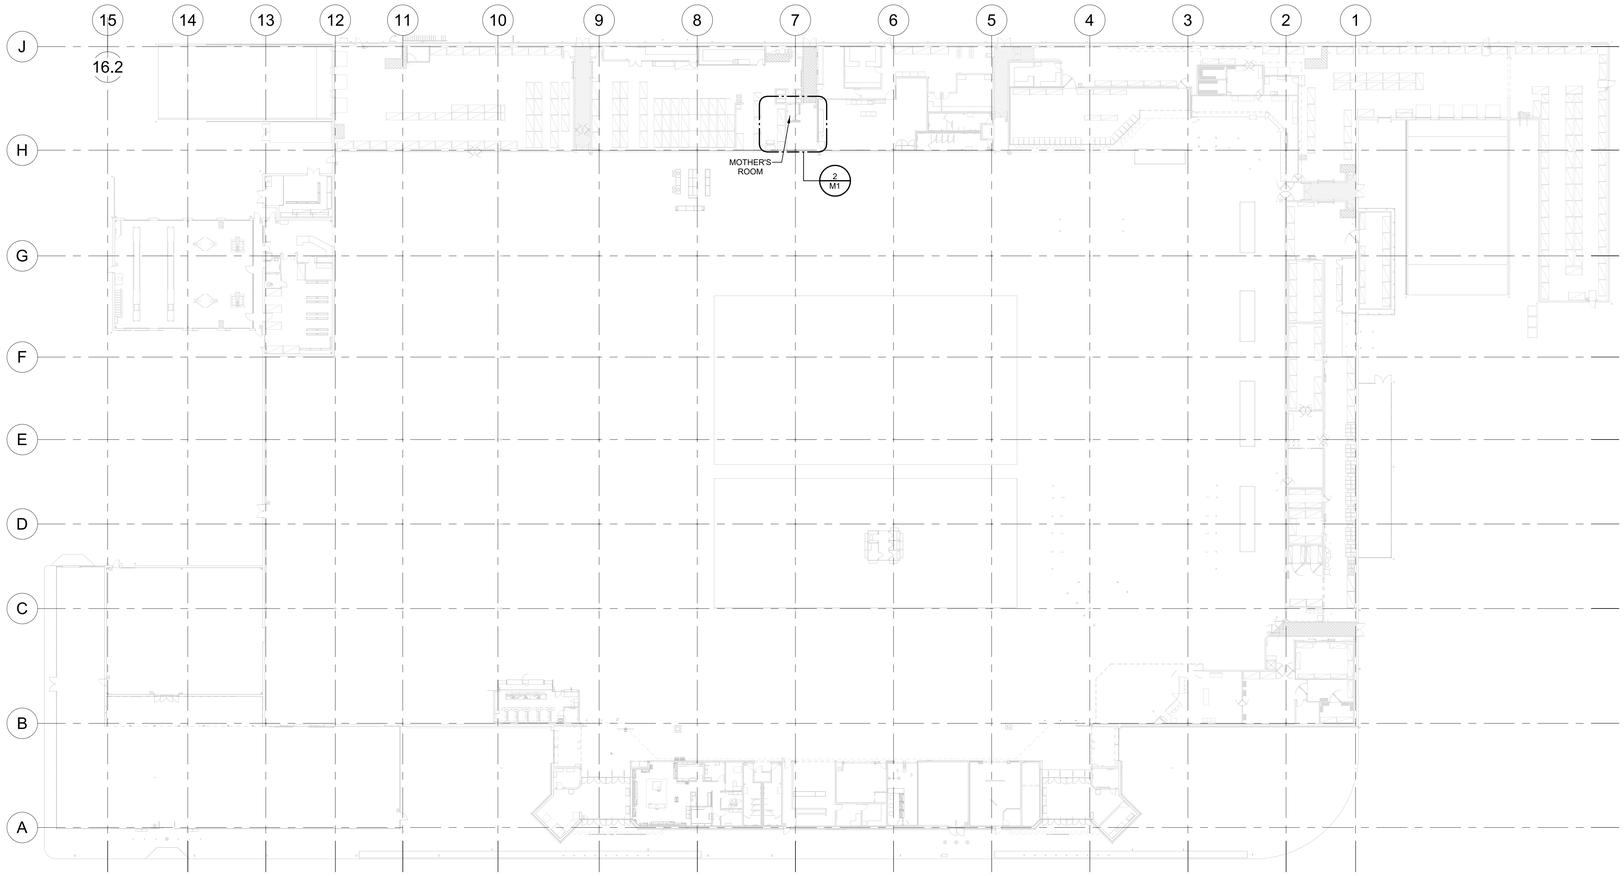1. GENERAL NOTES ARE APPLICABLE TO ALL MECHANICAL DRAWINGS.
2. PROVIDE ALL MATERIALS FOR A COMPLETE INSTALLATION IN ALL RESPECTS AND READY FOR INTENDED USE AND IN STRICT ACCORDANCE WITH STATE AND LOCAL CODES AND MANUFACTURERS RECOMMENDATIONS.
3. STORE MUST BE KEPT IN OPERATION,ARRANGE ALL WORK TO KEEP DISRUPTIONS TO STORE OPERATIONS TO A MINIMUM. COORDINATE WITH EXISTING AND NEW CONSTRUCTION. PAY ALL NECESSARY FEES AND PERMITS.
4. IF NEW CONSTRUCTION DISRUPTS EXISTING UNDERGROUND SERVICES (GAS, SEWER, DOMESTIC WATER, FIRE SPRINKLER, ETC.), PROVIDE ALL MATERIALS AND LABOR AS REQUIRED TO MAINTAIN THEIR PROPER OPERATION.
5. CONTRACTOR IS RESPONSIBLE FOR UTILIZING OWNER APPROVED ROOFING CONTRACTORS FOR CUTTING AND PATCHING ROOF.
6. CONTRACTOR SHALL FURNISH AND INSTALL EXHAUST FANS AND EXHAUST FAN CURBS. CONTRACTOR SHALL INSTALL ALL STRUCTURAL SUPPORTS FOR FANS. REFERENCE ARCHITECTURAL/STRUCTURAL SHEETS FOR DETAILS.
7. CONTRACTOR SHALL INSTALL OWNER FURNISHED RTU CURB AND TEMPORARY COVER CURB PER ARCH DETAIL (IF USED). RTU'S SHALL BE FURNISHED BY OWNER AND INSTALLED BY CONTRACTOR. CURB ADAPTOR (IF USED) SHALL BE FURNISHED BY OWNER AND INSTALLED BY CONTRACTOR. RTU SHALL BE SET ON ROOF CURB. DO NOT SET RTU DIRECTLY ON ROOF. COORDINATE RTU INSTALLATION WITH WALMART CONSTRUCTION MANAGER AND AES AS REQUIRED FOR RTU/AHU CURB ADAPTERS.
8. REPLACE FILTERS ON NEW RTU NO MORE THAN ONE DAY PRIOR TO STARTING TEST & BALANCE PROCEDURES. FILTERS SHALL BE 2" THICK EQUAL TO FARR 30/30.
9. LABEL RTU WITH 6" BLACK PERMANENT PAINT STENCIL AND LABEL SENSOR WITH 2" HIGH BLACK PERMANENT PAINT STENCIL. NUMBER THE SENSOR TO CORRESPOND WITH RTU IT CONTROLS. LOCATE LABEL FOR UNIT NEAR ITS DISCONNECT SO IT IS READABLE FROM ROOF HATCH.
10. IF RTUS ARE INSTALLED BEFORE ROOFING IS COMPLETED, THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE WHICH OCCURS DURING THE ROOFING PROCESS, INCLUDING TAR ON COILS.
11. ROOFTOP UNIT CONDENSATE SHALL BE ROUTED TO DRAIN WITH THE SLOPE OF THE ROOF.
12. MECHANICAL FAILURE OF NEW ROOFTOP UNITS PRIOR TO ACCEPTANCE BY OWNER, SHALL BE REPAIRED OR REPLACED BY CONTRACTOR THROUGH WARRANTY AGREEMENT WITH MANUFACTURER.
13. IF APPLICABLE, COORDINATE ALL NEW GAS PIPING AND ROOF EQUIPMENT WITH EXISTING GAS PIPING, SKYLIGHTS, AND ROOF EQUIPMENT. FIELD VERIFY EXISTING CONDITIONS.
14. ROOFTOP UNITS BEING ADDED TO EXISTING ROOF STRUCTURE SHALL BE INSTALLED WHEN THE UNITS ARRIVE AT THE JOB SITE. REFERENCE ARCHITECTURAL/STRUCTURAL SHEETS FOR DETAILS.
15. INSTALL VTR'S A MINIMUM OF 24" AND FLUES A MINIMUM OF 36" FROM ROOF EDGE AND/OR PARAPET WALLS. INSTALL VTR'S, FLUES AND EXHAUST FANS A MINIMUM OF 10 FT FROM OUTSIDE AIR INTAKE OF ROOF TOP UNITS. INSTALL EXHAUST FANS AND ROOF TOP UNITS A MINIMUM OF 10 FT FROM ROOF EDGE OR A MINIMUM OF 60" FROM PARAPET WALLS THAT ARE AT LEAST 42" HIGH.
16. COORDINATE LOCATION OF DUCTWORK AND DIFFUSERS WITH LIGHT FIXTURES TO PREVENT EXCESSIVE SHADOWING OF THE SALES OR STOCK FLOORS. LIGHT FIXTURE LOCATIONS TAKE PRECEDENCE. FIELD VERIFY STRUCTURAL CONDITIONS BEFORE FABRICATION OF DUCTWORK.
17. FLEXIBLE DUCT CONNECTIONS TO NEW OR RELOCATED DIFFUSERS AND GRILLES ARE PROHIBITED. INSPECT CONDITION OF EXISTING DUCT AND REPLACE DAMAGED DUCT WITH EQUIVALENT TYPE OF DUCT AS REQUIRED.
18. DUCT SIZES SHOWN ON DRAWINGS ARE NET FREE AREA. CONTRACTOR'S OPTION, ROUND DUCTWORK OF EQUIVALENT FREE AREA MAY BE USED IN LIEU OF RECTANGULAR. INCREASE RECTANGULAR SHEET METAL SIZE AS REQUIRED FOR LINER. REFER TO SPECIFICATIONS FOR THE INSULATION THICKNESS.
19. DUCT SUPPORT AND GRILLE DETAIL IS APPLICABLE THROUGHOUT THE STORE. DO NOT USE FASTENERS THAT PENETRATE ROOF DECK.
20. TYPICAL BRANCH DUCT FITTING DETAIL IS APPLICABLE THROUGHOUT THE STORE.
21. PROVIDE SEISMIC BRACING BASED ON APPROPRIATE SEISMIC ZONE REQUIREMENTS PER SMACNA PUBLISHED SEISMIC DETAILS, LOCAL AND NATIONAL CODES. CONTRACTOR'S RESPONSIBILITY INCLUDES STRUCTURAL ENGINEER'S CERTIFICATION ON DETAILS SUBMITTED FOR PERMITTING.
22. BUILDING COMPONENTS ABANDONED BY THE SCOPE OF WORK SHALL BE SECURED TO PREVENT FALLING, LOOSENING, OR CREATING DAMAGE OF ANY KIND IN THE FUTURE.
23. INSTALL ASSET TAGS ON ALL NEW RTU'S AND AHU'S AND COMPLETE THE DATA COLLECTION INFORMATION. DELETE DEMOED ASSETS FROM ASSET TAGGING APPLICATION. REFER TO SPECIFICATIONS.

REFER TO MANUFACTURER'S INSTALLATION INSTRUCTION FOR RTU AND AHU RIGGING SPECIFICATIONS AND DETAILS.

24 HOURS PRIOR TO SHUTTING DOWN ANY REFRIGERATION SYSTEMS, HVAC SYSTEMS, OR ENERGY MANAGEMENT CONTROLS SYSTEMS, SEND E-MAIL TO NSRM@WALMART.COM. THE E-MAIL SHALL STATE WHAT, WHY, AND WHEN IT IS BEING SHUT DOWN AND HOW LONG IT IS ANTICIPATED TO BE DOWN. THEN SEND A FOLLOW UP E-MAIL TO NSRM@WALMART.COM AFTER THE WORK IS COMPLETE AND THE SYSTEM IS BACK UP AND RUNNING.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


3600 Maitland Center Parkway
Suite 420
Maitland, FL 32751
P (407) 645-1500
F (407) 645-1501
www.cpaeng.com
Cabaniss & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE CONTEMPORANEOUSLY WITH ITS ISSUE, USED FOR ANY OTHER WORK EXCEPT BY AGREEMENT WITH CABANISS & PETERSON, INC. REUSE ON ANY OTHER PROJECT SITE OR AT A LATER TIME SHALL BE AT THE USER'S RISK AND WITHOUT LIABILITY TO CABANISS & PETERSON, INC. REUSE OF THESE DRAWINGS ON ANY OTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO F.S. 548.


CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: Z210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | JM |
| DRAWN BY: | HCM |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jose J Diaz-Velazquez
Reason: This item has been electronically signed and sealed by Jose J Diaz-Velazquez, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.11.23 11:10:36-05'00'

JOSE J DIAZ-VELAZQUEZ LICENSE No. 78474 STATE OF FLORIDA PROFESSIONAL ENGINEER

11/22/21

OVERALL & ENLARGED MECHANICAL PLANS, DETAILS & SCHEDULES

SHEET: M1

11/22/2021 4:26:19 PM
C:\Users\Jose.Velazquez\Documents\0767247_LakeCity_FL_US_L_MEP_V20_Jose.Velazquez.rvt




## 3 GR CHECKOUT PLUMBING PLAN
1/4" = 1'-0"




## 2 GM CHECKOUT PLUMBING PLAN
1/4" = 1'-0"

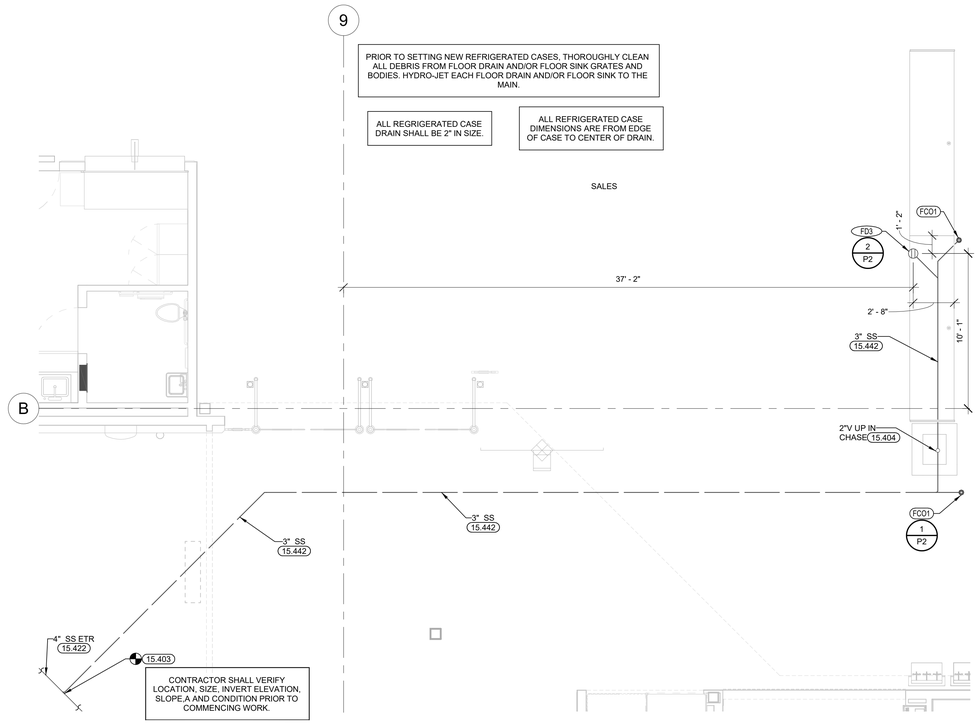


## 1 OVERALL PLUMBING PLAN
1" = 30'-0"

## KEYNOTES
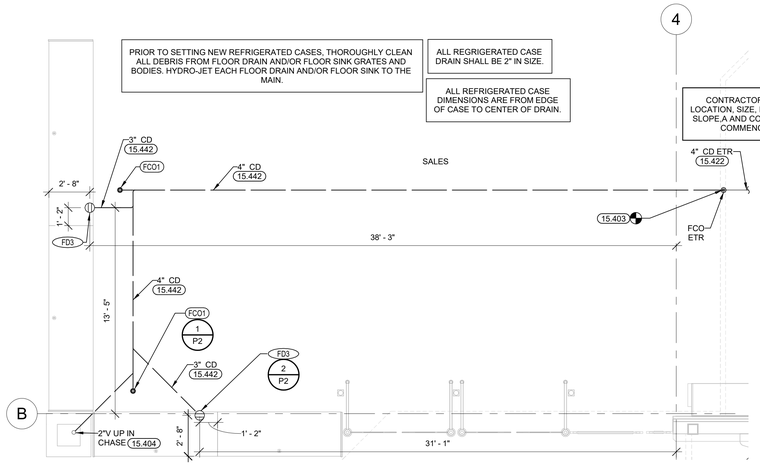
| | |
|---|---|
| 15.403 | CONNECT TO EXISTING SANITARY PIPE OF EQUAL OR LARGER SIZE. VERIFY SIZE. LOCATION, ELEVATION, AND FLOW DIRECTION AT SITE. |
| 15.404 | CONNECT TO EXISTING VENT PIPE OF EQUAL OR LARGER SIZE. VERIFY SIZE AND LOCATION AT SITE. |
| 15.422 | EXISTING PIPING TO REMAIN (VERIFY LOCATION IN FIELD). |
| 15.442 | TRENCHING AND BACKFILL BY GC, REF ARCH PLANS. COORDINATE WITH GC FOR INSTALLATION SCHEDULE. |

## GENERAL NOTES

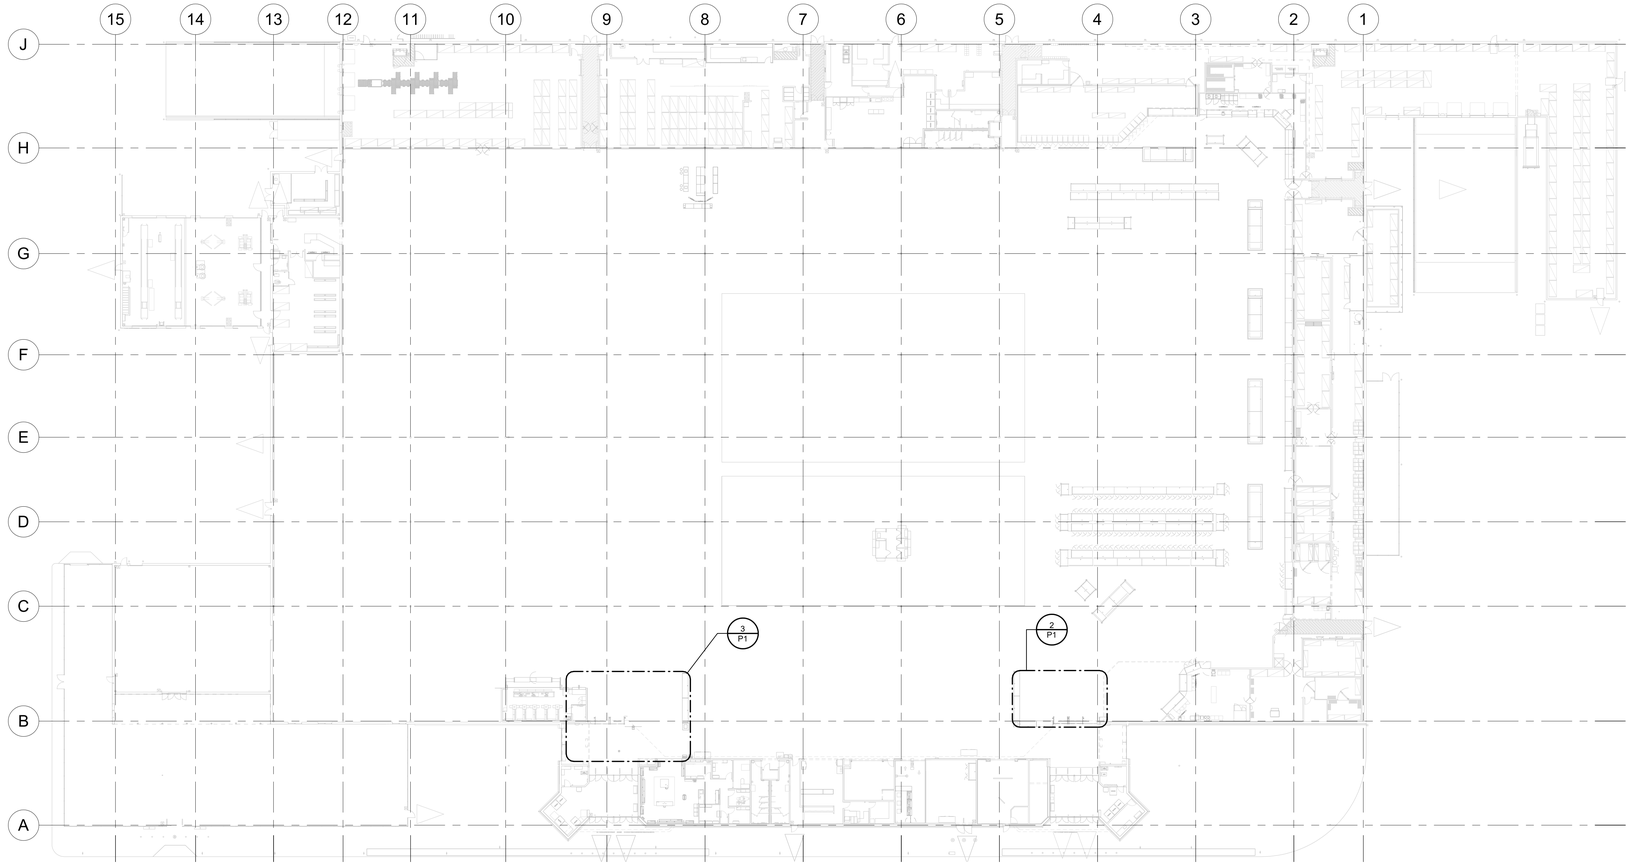12.20.13

1. GENERAL NOTES ARE APPLICABLE TO ALL PLUMBING DRAWINGS.
2. PROVIDE ALL MATERIALS FOR A COMPLETE INSTALLATION IN ALL RESPECTS AND READY FOR INTENDED USE AND IN STRICT ACCORDANCE WITH STATE AND LOCAL CODES AND MANUFACTURERS RECOMMENDATIONS.
3. STORE MUST BE KEPT IN OPERATION. ARRANGE ALL WORK TO KEEP DISRUPTIONS TO STORE OPERATIONS TO A MINIMUM. COORDINATE WITH EXISTING AND NEW CONSTRUCTION. PAY ALL NECESSARY FEES AND PERMITS.
4. IF NEW CONSTRUCTION DISRUPTS EXISTING UNDERGROUND SERVICES (GAS, SEWER, DOMESTIC WATER, FIRE SPRINKLER, ETC.), PROVIDE ALL MATERIALS AND LABOR AS REQUIRED TO MAINTAIN THEIR PROPER OPERATION.
5. CONTRACTOR IS RESPONSIBLE FOR UTILIZING OWNER APPROVED ROOFING CONTRACTORS FOR CUTTING AND PATCHING ROOF.
6. EXISTING PIPE SIZES AND LOCATIONS HAVE NOT BEEN FIELD VERIFIED. CONTRACTOR IS RESPONSIBLE TO FIELD VERIFY LOCATION AND SIZES OF ALL EXISTING PIPING THAT IS BEING CONNECTED TO OR MODIFIED, AND TO VERIFY THAT PROPER SLOPES AND ELEVATIONS ARE AVAILABLE. MAINTAIN MINIMUM SLOPE OF 1/8" PER FOOT FOR SAN SEWER PIPING 3" OR LARGER. MAINTAIN MINIMUM SLOPE OF 1/4" PER FOOT FOR SAN SEWER PIPING SMALLER THAN 3". REF ARCH. FOR TRENCHING REQUIREMENTS.
7. PLUMBING CONTRACTOR SHALL VERIFY EXISTING SEWER AND VENT PIPE SIZE AND ELEVATION AND SHALL VERIFY THAT PROPER SLOPES ARE AVAILABLE BEFORE CUTTING FLOOR SLAB FOR NEW SEWER PIPING.
8. PROVIDE ACCESS DOORS TO NEW WATER VALVES AND CLEANOUTS AS NECESSARY WHEN INSTALLED IN INACCESSIBLE AREAS.
9. PLUMBING CONTRACTOR SHALL PROVIDE ONE YEAR WARRANTY FOR PROPER SEWER SYSTEM OPERATION.
10. SANITARY DRAINAGE LINES AND FITTINGS (DRAIN, WASTE AND VENT) SHALL BE CAST IRON, COATED INSIDE AND OUTSIDE. WHERE PERMITTED BY LOCAL CODES, PVC-DWV PLASTIC SCHEDULE 40 MAY BE USED IN LIEU OF CAST IRON. ALL PHOTOLAB PLUMBING SHALL BE PVC.
11. WATER PIPING ABOVE GRADE SHALL BE TYPE "L" HARD DRAWN COPPER JOINED WITH WROUGHT COPPER FITTINGS. MAKE JOINTS USING LEAD-FREE SOLDER AND A NON-CORROSIVE, PASTE-TYPE FLUX. MAKE PIPING CONNECTIONS TO A FIXTURE WITH CHROME-PLATED SEAMLESS BRASS TUBE. INSULATE HOT & COLD WATER PIPING WITH RIGID GLASS FIBER A MINIMUM OF 1/2" THICK WITH WHITE ALL-SERVICE JACKET (VAPOR RETARDER).
12. PROVIDE AUTOMATIC TRAP PRIMERS ON FLOOR DRAINS IF REQUIRED BY LOCAL PLUMBING CODES.
13. ALL FLOOR CLEANOUTS SHALL BE INSTALLED FLUSH WITH FLOOR FINISH MATERIAL OR FLUSH WITH CONCRETE SLAB IF NO FLOOR FINISH MATERIAL IS CALLED OUT FOR ON ARCHITECTURAL DRAWINGS.
14. LOCATE ALL FLOOR CLEAN-OUTS OUT OF TRAFFIC WAYS, WHILE MAINTAINING ACCESSIBILITY. LOCATE PER DIMENSIONS IF SHOWN ON PLANS.
15. FLOOR CUTS SHALL BE STRAIGHT AND CLEAN. REPLACE REMOVED SLAB WITH CONCRETE FLUSH AND SMOOTH WITH ADJACENT FLOOR SLAB. REFERENCE ARCHITECTURAL SHEETS. COORDINATE WITH GENERAL CONTRACTOR.
16. CAP ALL PIPING OPENINGS DURING CONSTRUCTION UNTIL FINAL CONNECTIONS TO EQUIPMENT AND ACCESSORIES ARE MADE.
17. CUT AND PATCH EXISTING CONCRETE FLOOR SLAB FOR INSTALLATION OF NEW UNDERGROUND PLUMBING PIPE. MATCH EXISTING CONSTRUCTION.
18. DO NOT INSTALL PIPING WITHIN COOLER PANELS. INSTALL EXPOSED PIPING IN PREP AREAS A MINIMUM OF 1" FROM PANEL WALL AND 6" ABOVE FINISHED FLOOR TO ALLOW FOR CLEANING. USE ONLY NON-CORROSIVE MATERIALS FOR SPACERS AND ANCHORS.
19. PROVIDE ESCUTCHEON PLATES FOR PLUMBING PENETRATIONS THROUGH GROCERY CEILINGS AND WALLS.
20. PROVIDE AIR TIGHT SEAL AROUND PIPING PENETRATIONS THROUGH COOLER/FREEZER WALLS AND CEILINGS. FINISH WITH ESCUTCHEON PLATE.
21. PROVIDE HEAT TAPE AND INSULATION ON ALL WATER AND DRAIN PIPING EXPOSED TO FREEZING.
22. INSTALL CONTINUOUS SEALANT JOINT AT ALL EXTERIOR WALL PENETRATIONS.
23. AT CONTRACTOR'S OPTION (U.N.O), IN LIEU OF COPPER WATER PIPING, PEX OR AQUATHERM PIPING MAY BE USED. REFER TO EQUIVALENT NOMINAL PIPE SIZES SCHEDULE AND SPECIFICATIONS.
24. PROVIDE SEISMIC BRACING BASED ON APPROPRIATE SEISMIC ZONE REQUIREMENTS PER SMACNA PUBLISHED SEISMIC DETAILS, LOCAL AND NATIONAL CODES. CONTRACTOR'S RESPONSIBILITY INCLUDES STRUCTURAL ENGINEER'S CERTIFICATION ON DETAILS SUBMITTED FOR PERMITTING.
25. BUILDING COMPONENTS ABANDONED BY THE SCOPE OF WORK SHALL BE SECURED TO PREVENT FALLING, LOOSENING, OR CREATING DAMAGE OF ANY KIND IN THE FUTURE.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-1500
F (407) 645-1501
www.cedarandpeterson.com
Cedar & Peterson
Architects Engineers Planners


STIPULATION FOR RELISE

THIS DRAWING WAS PREPARED FOR USE BY WALMART AS PART OF A PROJECT CONTEMPORANEOUSLY WITH ITS ISSUE. CEDAR & PETERSON MAY BE RETAINED AS A STAFF REPRESENTATIVE ON ANOTHER PROJECT AT A LATER DATE. THIS DRAWING IS NOT INTENDED TO REPRESENT AS-BUILT CONDITIONS AND CEDAR & PETERSON ASSUMES NO RESPONSIBILITY FOR ENGINEERING, REPRODUCTION OR THE USE OF THIS DRAWING ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247
2210335 PROTO: 168 PROTO SC
JOB NUMBER:

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | JM |
| DRAWN BY: | HCM |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jose J Diaz-Velazquez
Reason: This item has been electronically signed and sealed by Jose J Diaz-Velazquez, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.11.23 11:15:06-05'00'

JOSE J DIAZ-VELAZQUEZ LICENSE No. 78474 STATE OF FLORIDA PROFESSIONAL ENGINEER

11/22/21

OVERALL & ENLARGED PLUMBING PLANS

SHEET: P1


11/22/2021 4:29:41 PM
C:\Users\Jose.Velazquez\Documents\WORK\2_Lake City_FL_US_L_MEP_CPD_Revit-MEP.rvt

## FLOOR DRAIN SCHEDULE

| MARK | MANUFACTURER | MODEL | DESCRIPTION |
|---|---|---|---|
| FD3 | SIOUX CHIEF<br>JOSAM | 860<br>FD-370 | LIGHT DUTY PVC WITH 9" DIAMETER LOOSE SET PVC HALF GRATE |

## CLEANOUT SCHEDULE

| MARK | MANUFACTURER | MODEL | DESCRIPTION |
|---|---|---|---|
| FCO1 | ZURN<br>SIOUX CHIEF<br>MIFAB<br>JAY R. SMITH<br>JOSAM<br>WATTS<br>OATEY | Z1400<br>852<br>C1100<br>4231<br>55000<br>CO-200-RX-4<br>74000 | CAST IRON OR PVC BODY, ROUND EXTRA HEAVY-DUTY CAST OR DUCTILE IRON TOP, POLYPROPYLENE OR ABS PLUG, ADJUSTABLE TO FINISH SURFACE. |

GENERAL INFORMATION (AS APPLICABLE):
1. REFER TO PLANS FOR DRAIN OUTLET SIZE.
2. LOAD CLASSIFICATIONS: LIGHT DUTY <2000 LBS, MEDIUM DUTY 2000 TO 4999 LBS, HEAVY DUTY 5000 TO 7499 LBS, EXTRA HEAVY DUTY 7500 TO 9999 LBS.

## SPECIALTY PLUMBING FIXTURE SCHEDULE

| MARK | FIXTURE | MANUFACTURER | MODEL | FIXTURE DESCRIPTION |
|---|---|---|---|---|
| WPG | WATER PRESSURE GAUGE | AMETEK<br>TRERICE<br>WEISS INSTRUMENTS | 656<br>D83LFSS<br>LF252 | 2.5 INCH STAINLESS STEEL CASE, ALL WETTED PARTS STAINLESS STEEL, LIQUID FILLED, 1/4 INCH NPT CONNECTOR, 1.6% ACCURACY, 30" HG VAC TO 100 PSI RANGE. |
| WHA | WATER HAMMER ARRESTOR | JOSAM<br>PRECISION PLUMBING PRODUCTS<br>WATTS<br>WILKINS<br>JAY R. SMITH<br>SIOUX CHIEF<br>MIFAB | SERIES 75000<br>STAINLESS STEEL #316 SERIES<br>SS SERIES<br>MODEL 1250XL SERIES<br>HYDROTROLS<br>HYDRA-RESTER<br>MWH | LEAD FREE CONFORM TO PDI WH-201, ANSI A112.26.1M, ASSE 1010. |
| FCV30 | FLOW CONTROL VALVE | BELL & GOSSETT<br>FLOW DESIGN | # CB LF "CIRCUIT SETTER PLUS"<br>ICSS050 | LEAD FREE NAMEPLATE AND 1/2" VALVE BODY SIZE UNLESS SHOWN OTHERWISE ON PLANS. SET AND BALANCE TO 0.25 GPM OR PROVIDE 0.25 GPM CARTRIDGE UNLESS SHOWN OTHERWISE ON PLANS AND PER MANUFACTURER'S INSTALLATION INSTRUCTIONS. |
| DCV | DOUBLE-CHECK VALVE BACKFLOW PREVENTER (STAINLESS STEEL) | WATTS | SS007QT-S | ASSE 1015, 316 STAINLESS STEEL BODY, QUARTER TURN TEST COCKS, QUARTER TURN, FULL PORT BALL VALVES AND STAINLESS STEEL STRAINER. |
| --- | CHECK VALVES | RED-WHITE<br>APOLLO<br>CRANE<br>WATTS<br>NIBCO | 232<br>SERIES 61-100<br>119J<br>9<br>T-413 | BRASS JACKET WITH PLASTIC VALVE ASSEMBLY |
| --- | DOUBLE-CHECK VALVE BACKFLOW PREVENTER | WATTS<br>BEECO<br>FEBCO<br>WILKINS | LF007QT OR LF709<br>FDC-LF<br>LF850<br>350XL OR 950XLT2 | LEAD FREE, INCLUDE TWO INDEPENDENT-ACTING CHECK VALVES, TWO SHUT-OFF VAVLES AND REQUIRED MEANS FOR TESTING FOR EACH ASSEMBLY. MINIMUM 175 PSI WORKING PRESSURE. |
| --- | LOCKABLE SHUT OFF VALVES | RED-WHITE<br>APOLLO<br>CRANE<br>WATTS | 5042<br>SERIES 70LF-100<br>LF-T-255<br>LFB-6000 OR LFB-6001 | BRASS BALL VALVES WITH PLASTIC JACKETED LEVER TYPE HANDLE. |
| --- | REDUCED PRESSURE BACKFLOW PREVENTER | WATTS<br>BEECO<br>FEBCO<br>WILKINS | LF009QT OR LF909<br>FRP-LF<br>LF860<br>375XL OR 975XL | LEAD FREE, PROVIDE STRAINER, SHUT-OFF VALVES AND TEST COCKS: INSTALL DRAIN LINE WITH AIR GAP ASSEMBLY TO RECEPTOR APPROVED BY AUTHORITY HAVING JURISDICTION. MINIMUM 175 PSI WORKING PRESSURE. |
| --- | REDUCED PRESSURE BACKFLOW PREVENTER (STAINLESS STEEL) | WATTS | SS009M3QT-S | LEAD FREE, STAINLESS STEEL REDUCED PRESSURE ZONE ASSEMBLY. FURNISHED WITH STAINLESS STEEL STRAINER, VANDAL RESISTANT TEST COCKS, AND FULL PORT QUARTER TURN BALL VALVE SHUTOFFS. INSTALL DRAIN LINE WITH AIR GAP ASSEMBLY TO RECEPTOR APPROVED BY AUTHORITY HAVING JURISDICTION. MINIMUM 175 PSI WORKING PRESSURE. |
| --- | STRAINER | WATTS<br>APOLLO | LF777SI<br>59-004-06 | CAST BRONZE Y-STRAINER WITH BALL VALVE |
| --- | TRAP PRIMER (MULTIPLE TRAPS) | PRECISION PLUMBING PRODUCTS<br>MIFAB<br>JOSAM<br>SIOUX CHIEF | PRIME RITE OR OREGON #1<br>M-500-NPB<br>88300<br>SERIES 695 | LEAD FREE, PROVIDE ALL BRONZE PRIMER VALVE WTIH REMOVABLE OPERATING PARTS, INTEGRAL VACUUM BREAKER, GASKETED ACCESS COVER, AND MULTIPLE TRAP CAPABILITY |
| --- | TRAP PRIMER (SINGLE TRAP) | PRECISION PLUMBING PRODUCTS<br>SIOUX CHIEF | PRIME-RITE OR OREGON #1<br>695 | LEAD FREE, PROVIDE ALL BRONZE PRIMER VALVE WITH REMOVABLE OPERATING PARTS, INTEGRAL VACUUM BREAKER, AND GASKETED ACCESS COVER. |
| --- | VACUUM RELIEF VALVE | WATTS | LFN36-M1 | LEAD FREE BRASS BODY. CSA/ANSI Z21.22 |
| --- | VALVES | RED-WHITE<br>APOLLO<br>CRANE<br>WATTS<br>NIBCO | 5044AB OR 5049AB<br>SERIES 70 LF<br>LF9210 SERIES<br>LFFBV-3C OR LFFBVS-3C<br>FP-600-A-LF | LEAD FREE FULL PORT BRASS BALL VALVE WITH PLASTIC JACKETED LEVER TYPE HANDLE. |

GENERAL INFORMATION:
1. THIS SCHEDULE IS COMPREHENSIVE. ALL MARKS MAY OR MAY NOT BE USED.

## PLUMBING SYMBOLS

| | |
|---|---|
| SS | SANITARY SEWER |
| GW | GREASE WASTE |
| OW | OIL WASTE |
| ST | STORM SEWER |
| RD | ROOF DRAIN LINE |
| ORD | OVERFLOW ROOF DRAIN LINE |
| – | DOMESTIC COLD WATER |
| – – – | DOMESTIC HOT WATER |
| – – – – | DOMESTIC HOT WATER RETURN |
| IW | IRRIGATION WATER |
| T | TEPID OR TEMPERED WATER |
| F | FILTERED WATER |
| G | NATURAL GAS |
| A | COMPRESSED AIR |
| CD | CONDENSATE DRAIN |
| RO | REVERSE OSMOSIS WATER |
| V | PLUMBING VENT |
| VAC | PLUMBING VACUUM |
| | UNION |
| | GAS PRESSURE REGULATOR |
| | GAS COCK |
| | ELBOW - TURNED DOWN |
| | ELBOW - TURNED UP |
| | TEE - TURNED DOWN |
| | TEE - TURNED UP |
| | BALL VALVE |
| | FLOW CONTROL VALVE |
| | PLUG VALVE |
| | CHECK VALVE |
| | SHUT-OFF VALVE IN VERTICAL LINE |
| | BACKFLOW PREVENTER |
| M | WATER METER |
| WHA | WATER HAMMER ARRESTOR |
| | THERMOMETER |
| | T & P RELIEF VALVE |
| TMV | THERMOSTATIC MIXING VALVE |
| FD | FLOOR DRAIN |
| RD | ROOF DRAIN/OVERFLOW ROOF DRAIN |
| FS | FLOOR SINK |
| FCO | FLOOR CLEANOUT |
| YCO | YARD CLEANOUT |
| FPWH | FREEZE PROOF WALL HYDRANT |
| HB | HOSE BIBB |
| WCO | WALL CLEANOUT |
| | CONNECT TO EXISTING |
| ETR | EXISTING TO REMAIN |
| | DEMO PIPE |
| | AREA OF SLAB CUT |
| VBF | VENT BELOW FLOOR |

| EQUIVALENT NOMINAL PIPE SIZES | | | |
|---|---|---|---|
| PLAN SIZE (COPPER) | POLYPROPYLENE | | PEX |
| | HOT WATER | COLD WATER | |
| 1/2" | 1/2" | 1/2" | 1/2" |
| 3/4" | 3/4" | 3/4" | 1" |
| 1" | 1" | 1" | 1 1/4" |
| 1 1/4" | 1 1/2" | 1 1/4" | 1 1/2" |
| 1 1/2" | 2" | 1 1/2" | 2" |
| 2" | 2 1/2" | 2" | N/A |
| 2 1/2" | 3" | 2 1/2" | N/A |
| 3" | 3 1/2" | 3" | N/A |
| 4" | 6" | 4" | N/A |

NOTE: REFER TO SPECIFICATIONS FOR APPROVED MANUFACTURERS.




LOCATE FLOOR DRAIN WHERE SHOWN ON DIMENSIONED PLUMBING FLOOR PLAN

2 REFRIGERATED CASE DRAIN
NTS




1 FLOOR CLEANOUT
NTS

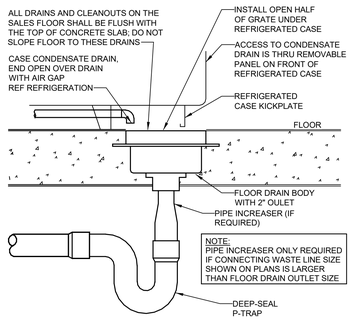EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


2600 Maitland Center Parkway
Suite #250
Maitland, FL 32751
P (407) 645-5500
F (407) 645-8791
www.cpaol.com
Cedrat & Peterson
Architects Engineers Planners


STIPULATION FOR RELISE

THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND IS NOT TO BE CONTEMPORANEOUSLY WITH ITS ISSUE, CONSTRUCTED ON ANOTHER PROJECT OR A LATER DATE WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. ALL COPYRIGHTS AND PROPERTY RIGHTS ARE RESERVED BY THE ARCHITECT. REPRODUCTION OF THIS DRAWING IN WHOLE OR IN PART FOR ANY PURPOSE OTHER THAN FOR THE PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart

LAKE CITY, FL
2767 W US HIGHWAY 90
STORE NO: 0767-247

JOB NUMBER: Z210335 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

| | |
|---|---|
| CHECKED BY: | JM |
| DRAWN BY: | HCM |
| PROTO CYCLE: | 08/27/21 |
| DOCUMENT DATE: | 11/22/21 |

Digitally signed by Jose J Diaz-Velazquez
Reason: This item has been electronically signed and sealed by Jose J Diaz-Velazquez, PE on the date and/or time stamp shown using a digital signature. Printed copies of this document are not considered signed and sealed and the signature must be verified by a 3rd Party Certificate Authority on any electronic copy.
Date: 2021.11.23 11:15:21 -05'00'

JOSE J DIAZ-VELAZQUEZ LICENSE No. 78474 STATE OF FLORIDA PROFESSIONAL ENGINEER

11/22/21

PLUMBING DETAILS AND SCHEDULES

SHEET: P2


11/23/2021 8:49:51 AM
C:\Users\Hala.Mcmurry\Documents\0767247_LakeCity_FL_US_L_MEP_V20_Hala.Mcmurry.rvt

## GENERAL NOTES

1.0 GENERAL
- 1.1 JOHNSTON BURKHOLDER ASSOCIATES HAS DESIGNED THE BASE ANCHORAGE FOR THE FIXTURES SHOWN ON THIS INSTALLATION DRAWING TO RESIST WIND/SEISMIC LATERAL FORCES. INSTALLATION OF THE FIXTURES SHALL MEET THE LAYOUT SHOWN ON THE FIXTURE LAYOUT PLAN, PROVIDED BY OWNER.

2.0 SLAB AND FOUNDATION
- 2.1 SLAB ON GRADE IS ASSUMED TO HAVE A MINIMUM OF 3,500 PSI COMPRESSIVE STRENGTH.
- 2.2 THE SLAB ON GRADE IS ASSUMED TO BE A MINIMUM OF 4 INCHES THICK, UNREINFORCED AND PLACED OVER A MINIMUM OF 4 INCHES OF DRAINAGE FILL.
- 2.3 THE SLAB ON GRADE IS DESIGNED TO BEAR ON A NET SOIL BEARING CAPACITY OF 1500 PSF MINIMUM.

3.0 MATERIAL FOR RACKS AND ANCHORAGE
- 3.1 ALL ANCHORS TO THE SLAB SHALL BE AS NOTED ON THESE PLANS.
- 3.2 OWNER IS TO PROVIDE MAINTAINENCE PER RMI/ANSI MH16.1 SECTION 1.4.1.
- 3.3 FIXTURE INSTALLER SHALL OBTAIN OUT-OF-PLUMB INSTALLATION TOLERANCE FROM FIXTURE SUPPLIER PRIOR TO INSTALLATION PER RMI/ANSI MH16.1 SECTION 1.4.11.1.
- 3.4 NO FIELD WELDING IS PERMITTED. ALL WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS, IN AN APPROVED SHOP. USE E70xx WELD RODS OR EQUAL TO TENSILE STRENGTH OF BASE METAL OF WELDMENTS. PER AWS D1.1 OR D1.3.
- 3.5 PROVIDE 6" AT 120" TALL RACKS AND 4 1/2" AT RACKS LESS THAN 120" (OR EQUAL TO 5% OF THE UPRIGHT FRAME HEIGHT) MINIMUM CLEARANCE BETWEEN OTHER RACK FIXTURES OR ADJACENT BUILDING ELEMENTS PER ASCE 7-16, SECTION 15.5.3.3.4.

4.0 ROLES AND RESPONSIBILITIES FOR DEMOLITION AND INSTALLATION OF SHELVING AND RACKING FIXTURES
- 4.1 RELOCATION AND SETUP OF GONDOLAS AND/OR RACKING AS INDICATED ON FXS SHEETS WILL BE PERFORMED BY OTHERS. ANCHORING OF UPRIGHTS TO BE PERFORMED BY GENERAL CONTRACTOR.
- 4.2 GENERAL CONTRACTOR TO ANCHOR ALL SHELVING AND RACKING FIXTURES ACCORDING TO THE REQUIREMENTS NOTED ON THE FXS SHEETS.
- 4.3 FIXTURE ANCHORING SHALL BE ACCOMPLISHED SIMULTANEOUSLY WITH FIXTURE INSTALLATION.
- 4.4 ENSURE ALL EXISTING WALL STANDARDS AND HALF GONDOLAS TO REMAIN ARE SECURE TO WALL.
- 4.5 GENERAL CONTRACTOR SHALL ENSURE THAT PROPER PROCEDURES AND WORK SEGREGATION ARE IN PLACE DURING ALL FIXTURE ANCHORING PROCEDURES.
- 4.6 GENERAL CONTRACTOR TO CLEAN ALL RESIDUE FROM SURROUNDING FIXTURES AND AREA AS ANCHORING IS COMPLETED (CLEAN AS YOU GO).
- 4.7 GENERAL CONTRACTOR IS TO PERFORM ALL REMOVAL AND INSTALLATION OF ANCHOR STRAPS AND/OR BOLTS AT FIXTURES REQUIRING PERMANENT OR TEMPORARY RELOCATION.

## RACK FIXTURE SCHEDULE

| FIXTURE MARK | FIXTURE DESCRIPTION | TOP SHELF HEIGHT | FRAME MARK | MAX SHELF LOAD (LBS) |
|---|---|---|---|---|
| B | STORAGE RACK | 120" | FRAME : 44-120 125S | 5000 |
| X | SALES FLOOR RACK | 75" | FRAME : 24-102 OGP | 250 |




TYP RACK FIXTURE SYMBOL

RACK SYMBOL LEGEND

## RACK FRAME & ANCHORAGE SCHEDULE

| FRAME MARK | ANCHOR DETAIL | FRAME COUNT |
|---|---|---|
| 24-102 OGP | 2-FXS2 & 5B-FXS2 | 10 |
| 44-120 125S | 2-FXS2 & 5A-FXS2 | 6 |
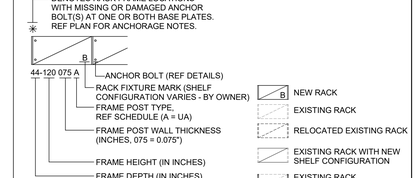
## ANCHORAGE BILL OF MATERIALS

| USAGE | MATERIAL TYPE | COUNT |
|---|---|---|
| ANCHOR | DEWALT SCREW BOLT+ - 1/2" DIAMETER x 3" (#PFM1411380) | 12 |
| ANCHOR | DEWALT SCREW BOLT+ - 3/8" DIAMETER x 2 1/2" (#PFM1411220) | 146 |
| STRAP | ANCHOR STRAPS (GONDOLA) | 122 |

NOTES:
1. ANCHOR BOLTS AND STRAPS AS NOTED ARE FURNISHED BY AND INSTALLED BY THE GENERAL CONTRACTOR (GC).
2. ANCHOR STRAP SUPPLIER CONTACT INFORMATION:
   LOZIER: JOSH GOEDKEN, joshua.goedken@lozier.biz, (402) 457-8379
   MADIX: CHERI BAGLEY, cbagley@madixinc.com, (256) 839-6354

## TEMPORARY ANCHORAGE BILL OF MATERIALS

| USAGE | MATERIAL TYPE | COUNT |
|---|---|---|
| TEMP ANCHOR | DEWALT SCREW BOLT+ - 3/8" DIAMETER x 2 1/2" (#PFM1411220) | 122 |
| TEMP STRAP | ANCHOR STRAPS (GONDOLA) | 122 |

## SHELVING FIXTURE & ANCHORAGE SCHEDULE

| FIXTURE MARK | FIXTURE DESCRIPTION | FIXTURE HEIGHT | ANCHORAGE DETAIL |
|---|---|---|---|
| 18R | HALF GONDOLA | 48" | 1A-FXS2 |
| 18S | HALF GONDOLA | 54" | 1A-FXS2 |
| 18T | HALF GONDOLA | 60" | 1A-FXS2 |
| 18V | HALF GONDOLA | 78" | 1A-FXS2 |
| 24T | HALF GONDOLA | 60" | 1A-FXS2 |
| 36V | HALF GONDOLA | 78" | 1A-FXS2 |
| 3678 EC | END CAP | 78" | 1B-FXS2 |




HALF GONDOLA FIXTURE SYMBOL




END CAP FIXTURE SYMBOL

NOTE: ANCHORS SHOWN ABOVE ARE FOR EXAMPLE ONLY, REFER TO PLAN AND DETAILS FOR ACTUAL ANCHOR CONFIGURATION.




## 1 RACK AND SHELVING FIXTURE ANCHOR PLAN
1" = 20'-0"


2900 Midland Center Parkway
Suite 200
Midland, FL 32751
P (407) 645-9500
F (407) 645-9501
www.cpi.com
Architecture Engineering Planning
Cobair & Peterson


STIPULATION FOR REUSE


THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF THE ARCHITECT. ANY REUSE WITHOUT SUCH AUTHORIZATION OR ADAPTATION BY OTHERS SUITABLE FOR USE ON A DIFFERENT PROJECT SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO THE ARCHITECT AND THE USER SHALL INDEMNIFY AND HOLD HARMLESS THE ARCHITECT AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY MODIFICATION OF THIS DRAWING FOR REFERENCE OR REPRODUCTION OF THIS DRAWING FOR USE BY GOVERNMENTAL AUTHORITIES REQUIRED BY LAW IS PERMITTED AND MAY BE CONSENT TO THE ARCHITECT.

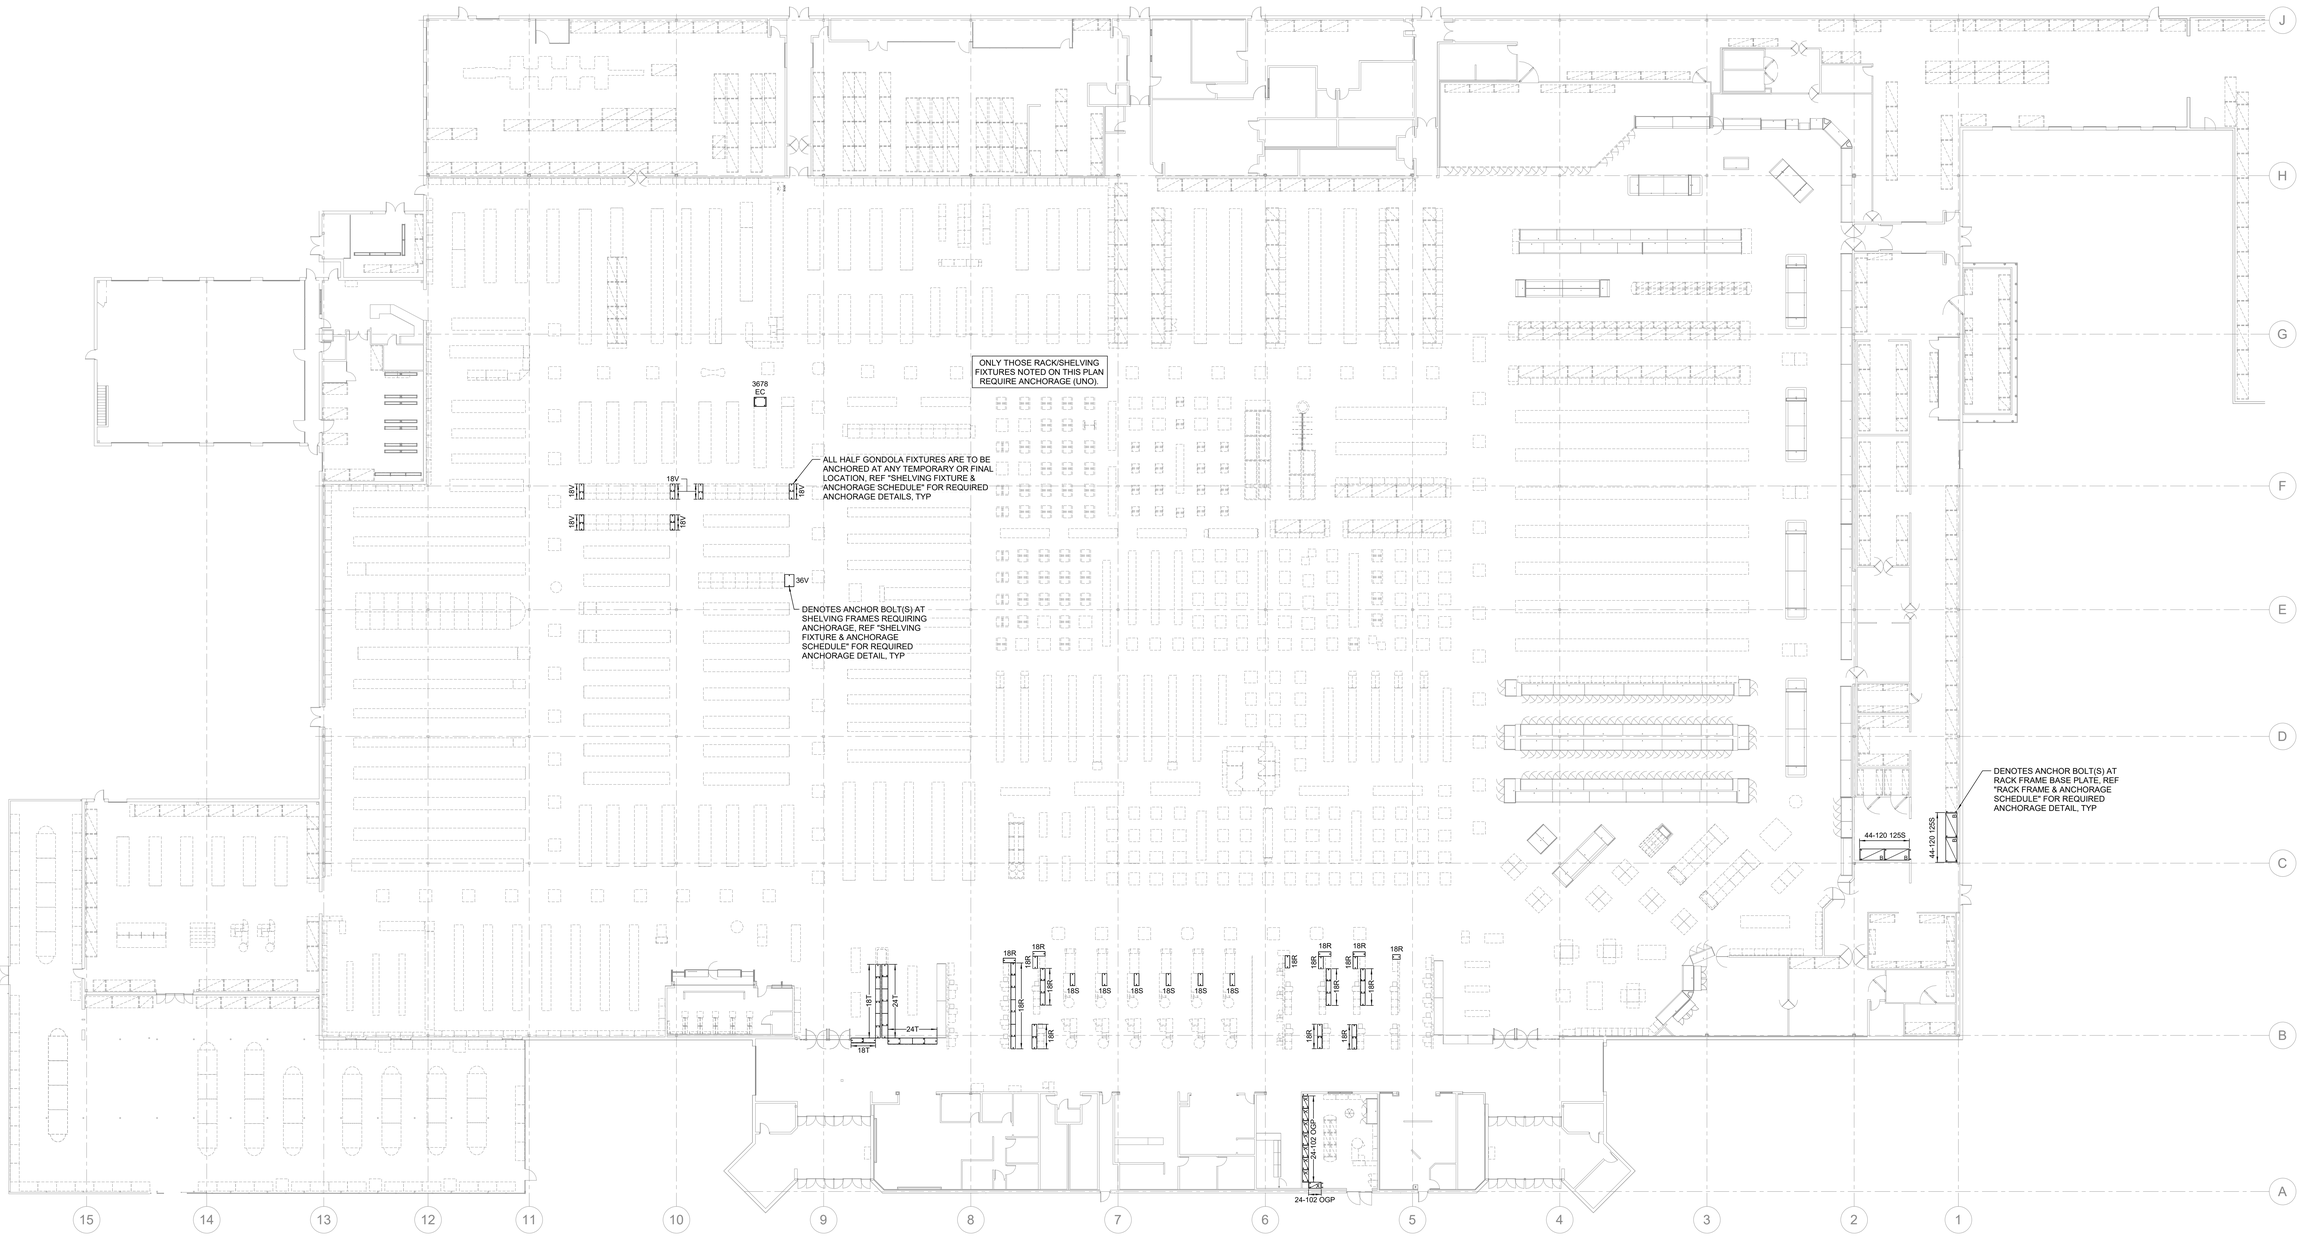
CONSULTANTS


JBA JOHNSTON BURKHOLDER ASSOCIATES
CONSULTING STRUCTURAL ENGINEERS
DESCHUTES, KANSAS CITY, MISSOURI
NICOLET, PARK, NEW HAMPSHIRE


Walmart

LAKE CITY, FL

STORE NO. 00767 | PROTO: 168 PROTO SC

JOB NUMBER: 2190403

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | DGH |
| DRAWN BY: | CRB |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |
| JBA PROJECT NO: | 2135000767 |

NOT FOR CONSTRUCTION

OWNER PROVIDED INFORMATION
**NOT FOR REGULATORY APPROVAL OR PERMITTING**

FIXTURE ANCHORAGE PLAN AND NOTES

SHEET:
FXS1


11/15/2021 11:05:37 AM
M:\Projects\000-099\099767 - Lake City, FL\2022 - 2135000767 - SRM\BACKBOX\TS_LAKE CITY, FL_WM.Rvt_V24.rvt




(1) ANCHOR BOLT(S) PER PLATE: 3/8" DIA DEWALT SCREW BOLT+, REF 3-FXS2. hnom = 2", ho = 2 1/2", (UNO).

## ANCHOR AT END CAP FRAMES

6 1 1/2" = 1'-0"




(1) ANCHOR BOLT(S) PER BASE PLATE: 1/2" DIA DEWALT SCREW BOLT+, REF 3-FXS2. hnom = 2 1/2", ho = 2 7/8", ("US" POST).

**5A - BASE PLATE "US" POST**

(1) ANCHOR BOLT(S) PER BASE PLATE: 3/8" DIA DEWALT SCREW BOLT+, REF 3-FXS2. hnom = 2", ho = 2 1/2", ("OGP" POST).

**5B - BASE PLATE "OGP" POST**

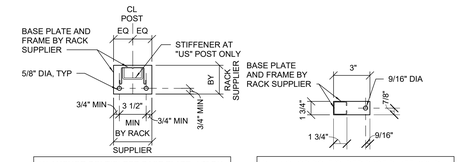**NOTES:**
1. PROVIDE SIZE AND QUANTITY OF ANCHORS AS NOTED ABOVE AT EACH UPRIGHT FRAME POST.
2. WHEN BASE PLATE CONTAINS GREATER NUMBER OF BOLT HOLES THAN ANCHORS SPECIFIED. ADDITIONAL HOLES IN BASE PLATE NEED NOT BE FILLED WITH ANCHOR BOLTS.
3. PROVIDE WASHERS AS REQUIRED TO ESTABLISH REQUIRED EMBEDMENT DEPTH "hnom".

## TYPICAL ANCHOR AT RACK FRAMES

5 1 1/2" = 1'-0"




**4A - TYPICAL SINGLE ANCHOR STRAP**




**ALTERNATIVE ANCHOR AT HALF GONDOLA END FRAME**

ALTERNATIVE ANCHOR STRAP/BOLT CONNECTION AT END FRAMES - ONLY ALLOWED FOR USE WHEN CLOSURE TUBES DO NOT HAVE A SLOTTED OPENING




(1) ANCHOR BOLT(S) PER STRAP: 3/8" DIA DEWALT SCREW BOLT+, REF 3-FXS2. hnom = 2", ho = 2 1/2", (UNO)*.

**AT GONDOLA INTERIOR & END FRAMES**

4A

* ALL TEMPORARY ANCHORS SHALL BE 3/8" DIA DEWALT SCREW BOLT +. hnom = 2", ho =2 1/2" (UNO)

## TYPICAL ANCHOR AT GONDOLA FRAMES

4 1 1/2" = 1'-0"




**TIGHTENING REQUIREMENTS:**
"SNUG TIGHT" - NO GAP BETWEEN HEAD OF ANCHOR BOLT AND BASE PLATE OR ANCHOR STRAP.

t - PLATE/STRAP THICKNESS
hnom - EMBEDMENT DEPTH
ho - MIN HOLE DEPTH
La - LENGTH OF ANCHOR

**NOTE:**
ALL ANCHOR BOLTS SHALL BE DEWALT SCREW BOLT+ THE ANCHORS MUST BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S PUBLISHED INSTALLATION INSTRUCTIONS AND PER ICC ESR-3889 REPORT. (IN CASE OF CONFLICT, THE ICC ESR-3889 GOVERNS). REF ANCHOR DETAILS FOR DIAMETER AND EMBEDMENT.

**NOTE:**
IF CENTERLINE OF ANCHOR BOLTS FALLS WITHIN 1 3/4" OF CONTROL JOINT, SHIFT FIXTURE 2" (MAX) PERPENDICULAR TO THE JOINT, OTHERWISE SUBMIT RFI TO THE ARCHITECT FOR ALTERNATE INSTALLATION BEFORE INSTALLING BOLTS.
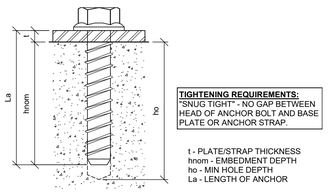
## ANCHOR BOLT DETAIL

3 NTS




## SALES FLOOR RACK ELEVATIONS

2 3/16" = 1'-0"

**DESIGN SHELF LOADS:**
9" SHELF = 15 LBS/SHELF (PHARMACY)
12" SHELF = 50 LBS/SHELF
15" SHELF = 50 LBS/SHELF (APPAREL)
18" SHELF = 125 LBS/SHELF
= 50 LBS/SHELF (APPAREL)
24"(+) SHELF = 150 LBS/SHELF
= 225 LBS/SHELF (GROCERY)
30" (HD TV) SHELF = 75 LBS/SHELF

**NO. OF SHELF LEVELS/FIXTURE HEIGHT:**
(4) LEVELS AT HT. < 48"
(5) LEVELS AT 48" < HT. < = 90"
(7) LEVELS AT HT. > 90"
(4) LEVELS AT "24V" & "24X" (FULL) = 78" & 90"
(4) LEVELS AT HD TV = 120" (YZ)
(9) LEVELS AT PHARMACY = 84" (3RX)

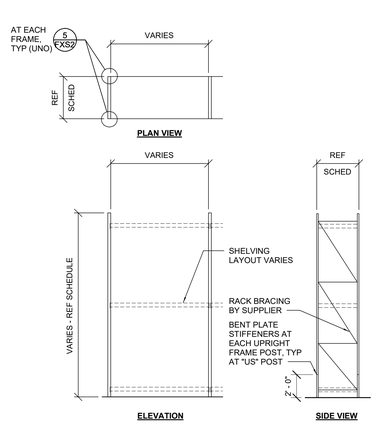(NOTE: ITEMS LISTED MAY NOT EXIST IN PROJECT)




**HALF GONDOLA PLAN VIEW**




**END CAP PLAN VIEW**

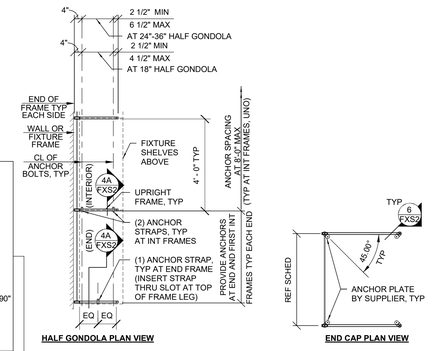


**TYPICAL SHELF FRONT VIEW**




**HALF GONDOLA SIDE VIEW AT WALL OR FIXTURE FRAME**

1A




**END CAP SIDE VIEW**

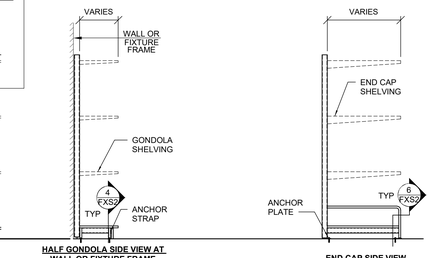1B

## TYPICAL GONDOLA AND END CAP SHELVING ELEVATIONS

1 3/8" = 1'-0"


2300 Maitland Center Parkway
Suite 222
Maitland, FL 32751
P (407) 645-5555
F (407) 645-9101
www.cpz.com
Cotleur & Peterson
Architects Engineers Planners


STIPULATION FOR REUSE

THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT. IT IS NOT SUITABLE FOR USE ON A DIFFERENT PROJECT OR AT A DIFFERENT SITE. ANY REUSE OF THIS DRAWING FOR REFERENCE OR ON ANOTHER PROJECT WITHOUT THE EXPRESS WRITTEN PERMISSION OF JBA REQUIRES THE SERVICES OF PROPER'S ADAPTATION. ANY UNAUTHORIZED REUSE, REPRODUCTION OF THIS DRAWING FOR ANY PURPOSE WHATSOEVER SHALL BE AT THE USER'S SOLE RISK AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS


JBA JOHNSTON BENJAMIN ASSOCIATES
CONSULTING STRUCTURAL ENGINEERS
TERRITORIAL KANSAS CITY, MISSOURI
NATIONAL NETWORK


Walmart

# LAKE CITY, FL

STORE NO. 00767

JOB NUMBER: 219403 | PROTO: 168 PROTO SC

ISSUE BLOCK

| | |
|---|---|
| CHECKED BY: | DGH |
| DRAWN BY: | CRB |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |
| JBA PROJECT NO: | 2135000767 |

NOT FOR CONSTRUCTION

OWNER PROVIDED INFORMATION
**NOT FOR REGULATORY APPROVAL OR PERMITTING**

FIXTURE ANCHORAGE DETAILS

SHEET:
FXS2


11/15/2021 11:05:53 AM
W:\Projects\00767.00\00767_-_Lake City, FL\1003 - 2135000767 - SPRINKLER/00767_LAKE CITY_FL_WM-Rack_V29.rvt

# SYSTEM RCU1 DISCHARGE AIR TEMPERATURE AND DEFROST PARAMETERS

Updated: 11/12/2021

| | | | | | DISCHARGE AIR TEMP SETTING FOR CASES/ RETURN AIR TEMP SETTING FOR WALK-IN BOXES | | | | DEFROST | | | | | | DEFROST SCHEDULE | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| CIRCUIT # | APPLICATION | MODEL NUMBER | MFR | EQUIP. NUMBER | MANUFACTURER'S TARGET (°F) | OWNER'S OPERATING SETPOINT (°F) | DUAL TEMP TARGET (°F) | STARTING SUPERHEAT SETPOINT (°F) | DEFROST TYPE | FREQUENCY PER DAY | PUMP OUT TIME (MIN) | MAX DURATION (MIN) | TERMINATION TEMP (°F) | DRIP TIME (MIN) | Defrost 1 | Defrost 2 | Defrost 3 | Defrost 4 | Defrost 5 | Defrost 6 |
| RCU1 | Grab-N-Go | QC-R-35-IC | HILL PHOENIX INC | RD1069.652 - 6/21/2019 | 32 | 32 | -- | 6 – 8 | OT | 4 | 0 | 30 | 42 | 0 | 0:00 | 6:00 | 12:00 | 18:00 | | |
| | | | | | | | -- | | | | | | | | | | | | | |

1.) Controlled by S3C.
2.) Temperature control via pressure controller inside the remote condensing unit.
3.) Starting superheat setpoint values are per manufacturer's published case data. Field adjustment may be required.
4.) Parameters above are to be used in programming new/replaced cases/coils only.

# SYSTEM RCU2 DISCHARGE AIR TEMPERATURE AND DEFROST PARAMETERS

Updated: 11/12/2021

| | | | | | DISCHARGE AIR TEMP SETTING FOR CASES/ RETURN AIR TEMP SETTING FOR WALK-IN BOXES | | | | DEFROST | | | | | | DEFROST SCHEDULE | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| CIRCUIT # | APPLICATION | MODEL NUMBER | MFR | EQUIP. NUMBER | MANUFACTURER'S TARGET (°F) | OWNER'S OPERATING SETPOINT (°F) | DUAL TEMP TARGET (°F) | STARTING SUPERHEAT SETPOINT (°F) | DEFROST TYPE | FREQUENCY PER DAY | PUMP OUT TIME (MIN) | MAX DURATION (MIN) | TERMINATION TEMP (°F) | DRIP TIME (MIN) | Defrost 1 | Defrost 2 | Defrost 3 | Defrost 4 | Defrost 5 | Defrost 6 |
| RCU2 | GRAB-N-GO | QC-R-35-IC | HILL PHOENIX INC | RD1069.652 - 6/21/2019 | 32 | 32 | -- | 6 – 8 | OT | 4 | 0 | 30 | 42 | 0 | 0:00 | 6:00 | 12:00 | 18:00 | | |
| | | | | | | | -- | | | | | | | | | | | | | |

1.) Controlled by S3C.
2.) Temperature control via pressure controller inside the remote condensing unit.
3.) Starting superheat setpoint values are per manufacturer's published case data. Field adjustment may be required.
4.) Parameters above are to be used in programming new/replaced cases/coils only.




2 REFRIGERATION EDC BUILDING AUTOMATION SYSTEM PLAN
1/16" = 1'-0"




1 NEW REFRIGERATION BUILDING AUTOMATION SYSTEM PLAN
1/16" = 1'-0"

## BAS EQUIPMENT SALVAGE REQUIREMENTS

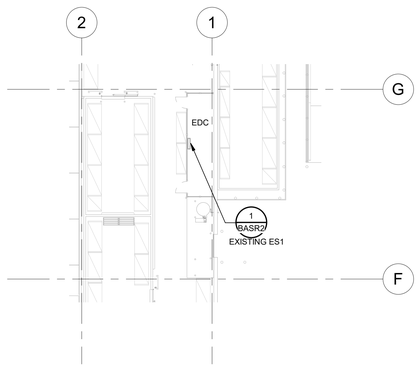RM-04.22.20

ALL DEMOLISHED NOVAR BAS EQUIPMENT SHALL BE RETURNED TO OWNER'S MECHANICAL SERVICES CONSTRUCTION MANAGER. EQUIPMENT TO BE RETURNED INCLUDES: EXECUTIVE CONTROLLER(S), IOM(S), CIM(S), CCM(S), ETC. PROVIDE DOCUMENTATION FOR ALL EQUIPMENT REMOVED IN ACCORDANCE WITH SPECIFICATIONS AND REQUIRED CLOSE-OUT DOCUMENTS.
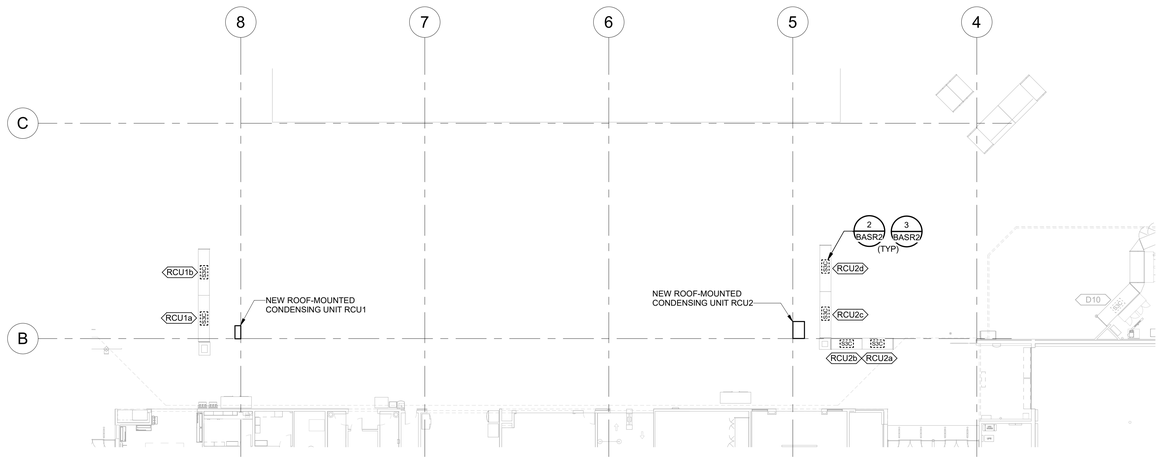
## GENERAL REFRIGERATION BAS NOTES

RM-W-04.22.20

1. BAS CONTRACTOR SHALL CONTACT THE BAS SUPPLIER(S) TO OBTAIN A CURRENT MODULE CONFIGURATION PRINTOUT BEFORE TERMINATING SENSOR LEADS AT INPUT MODULES. THE REQUEST FOR THE CONFIGURATION PRINTOUT SHALL BE MADE PRIOR TO THE INSTALLATION OF BAS CABLES. WIRING TERMINATIONS SHALL BE LANDED ACCORDING TO THE BAS SUPPLIER CONFIGURATION SHEETS.
2. BAS CONTRACTOR SHALL PROVIDE COMPLETED REFRIGERATION SENSOR INPUT VERIFICATION FORMS TO THE BAS SUPPLIER AT THE BEGINNING OF THE REFRIGERATION EQUIPMENT STARTUP. BAS INSTALLER SHALL PROVIDE ASSISTANCE TO THE BAS SUPPLIER FOR SPOT CHECKING OF SENSORS FOR ACCURACY.
3. ALL BAS CABLE ON THE SALES FLOOR SHALL BE ROUTED IN CONDUIT AND CONCEALED FROM VIEW AND ROUTED ALONGSIDE OTHER PIPING OR CONDUIT AS MUCH AS POSSIBLE.
4. BAS CONTRACTOR SHALL BE PRESENT AND AVAILABLE TO RESOLVE ISSUES AND PROVIDE REFRIGERATION STARTUP ASSISTANCE UNTIL RELEASED BY THE BAS SUPPLIER AND OWNER'S REFRIGERATION CONSTRUCTION COORDINATOR.
5. DURING THE REFRIGERATION STARTUP, BAS CONTRACTOR SHALL COMPLETE ALL UNRESOLVED REFRIGERATION WORK PRIOR TO WORKING ON OTHER BAS INSTALLATION ITEMS.
6. WHEN THE BAS SUPPLIER IS NOT SCHEDULED TO PERFORM THE ON SITE REFRIGERATION STARTUP, THE CONTRACTOR IS RESPONSIBLE FOR PERFORMING ALL CHECKS AND TEST TO ENSURE A FULLY FUNCTIONAL REFRIGERATION CONTROL SYSTEM. CONTACT THE BAS SUPPLIER FOR THE BLANK TEST VERIFICATION FORMS AND INSTRUCTIONS FOR COMPLETING. ALL COMPLETED TEST VERIFICATION FORMS SHALL BE RETURNED TO THE OWNER'S MECHANICAL SERVICES CONSTRUCTION MANAGER.
7. REFER TO ARCHITECTURAL DRAWINGS FOR PIPING INSTALLATION AND SEALING REQUIREMENTS FOR DEVICES SHOWN ON COOLER/FREEZER PANELS. DO NOT INSTALL PIPING WITHIN COOLER/FREEZER PANELS.
8. ROUTE ALL UTILITY SERVICE LINES (PIPES AND CONDUIT) WITHIN STUD WALLS WHEREVER POSSIBLE. ON COOLER/FREEZER PANELS IN FOOD PREP AREAS WHERE UTILITIES MUST BE EXPOSED, CONTRACTOR TO HAVE THE OPTION OF THE FOLLOWING:
   A. SURFACE MOUNT UTILITIES WITH NON-CORROSIVE ANCHORS; SEAL BOTH SIDES OF PIPE/CONDUIT TO PANEL CONTINUOUSLY WITH SEALANT.
   B. INSTALL UTILITIES 1/2" OFF FACE OF PANEL TO ALLOW FOR CLEANING; USE ONLY NON-CORROSIVE MATERIALS FOR SPACERS AND ANCHORS.
   C. COVER UTILITIES WITH 20 GAUGE STAINLESS STEEL BENT PLATES MOUNTED TO WALL WITH NON-CORROSIVE ANCHORS; APPLY CONTINUOUS SEALANT ALONG EDGES AND JOINTS.
9. REFERENCE ARCHITECTURAL DEMOLITION PLANS FOR FULL EXTENT OF DEMOLITION WORK REQUIRED.
10. 24 HOURS PRIOR TO SHUTTING DOWN ANY REFRIGERATION SYSTEMS, HVAC SYSTEMS OR BUILDING AUTOMATION CONTROL SYSTEMS, SEND EMAIL TO NSRM@WALMART.COM. THE E-MAIL SHALL STATE WHAT, WHY, AND WHEN IT IS BEING SHUT DOWN AND HOW LONG IT IS ANTICIPATED TO BE SHUT DOWN. THEN SEND A FOLLOW UP EMAIL TO NSRM@WALMART.COM AFTER THE WORK IS COMPLETE AND THE SYSTEM IS BACK UP AND RUNNING.
11. ALL WORK ON THIS SHEET IS TO BE COMPLETED BY AN OWNER'S APPROVED CONTRACTOR.

## BAS SYMBOLS

RM-04.22.20

| | |
|---|---|
| ES1 | NOVAR EDGE SERVER GATEWAY |
| E2E | EMERSON RX300 GATEWAY |
| RC2-XE | NOVAR SPECTRUM RACK CONTROLLER |
| XCM.20R | NOVAR OPUS RACK CONTROLLER |
| BAS | BUILDING AUTOMATION SYSTEM |
| TEMP | TEMPERATURE |
| VFD | VARIABLE FREQUENCY DRIVE |
| XFMR | TRANSFORMER |
| COMM | COMMUNICATION PORT/MODULE |
| CIM | CASE INPUT MODULE |
| LTA-X | REFRIGERATION CIRCUIT |
| S | REMOTE TEMPERATURE SENSOR |
| D | DEFROST TERMINATION SENSOR |
| DTS | DUAL TEMP SWITCH |
| RIB | RELAY IN BOX |
| RCC | NOVAR CIRCUIT CONTROLLER |
| CMS | CASE MANAGEMENT SYSTEM MODULE |
| AOM | ANALOG OUTPUT MODULE |
| 8IM | UNIVERSAL INPUT MODULE |
| RIM | RACK INPUT MODULE |
| S3C | SPORLAN WALK-IN CONTROLLER |
| S3C | SPORLAN CASE CONTROLLER |
| SGR | SPORLAN GATEWAY ROUTER |
| SNS | SPORLAN NETWORK SWITCH |
| | BAS BACKBOARD |
| SALS | SWING ARM LIMIT SWITCH |
| XIO | BACNET INPUT/OUTPUT MODULE |
| | NEW FIELD INSTALLED EQUIPMENT |
| | EXISTING EQUIPMENT |
| | NEW FACTORY INSTALLED EQUIPMENT |
| | EQUIPMENT TO BE DEMOLISHED |

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


1975 Prospect Ave.
Orlando, FL 32814
P (407) 645-5100
F (407) 645-5101
arkhart.com
Cobart & Peterson
Architects Engineers Planners



STIPULATION FOR REUSE
THIS DRAWING HAS BEEN PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE USED ON ANY OTHER WORK EXCEPT BY AGREEMENT WITH COBART & PETERSON, P.A. IT IS NOT SUITABLE FOR USE ON A DIFFERENT PROJECT OR AT A DIFFERENT SITE. ALL RIGHTS OF THIS DRAWING FOR REFERENCE OR REPRODUCTION OF THIS DRAWING IN ANY FORM WHATSOEVER WITHOUT THE EXPRESS RECORDED THE SERVICES OF PROPERLY REPRODUCTION OF THIS DRAWING OR ANY PART THEREOF AND ANY USE CONTRARY TO THE FOREGOING SHALL BE CONSIDERED AND MAY BE CONTRARY TO THE LAW.



CONSULTANTS
HENDERSON ENGINEERS
8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
2285950787


Walmart
LAKE CITY, FL
2767 W US Highway 90
STORE NO.: 00767
2190403 PROTO: 168 PROTO SC
2020 GENERAL REMODEL JOB NUMBER:

ISSUE BLOCK

| | | |
|---|---|---|
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

| | |
|---|---|
| CHECKED BY: | EAR |
| DRAWN BY: | FF |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY DUSTIN PADGET ON THE DATE LISTED BELOW USING A DIGITAL SIGNATURE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

DUSTIN PADGET LICENSED No. 90908 STATE OF FLORIDA PROFESSIONAL ENGINEER

12/07/2021

REFRIGERATION BUILDING AUTOMATION SYSTEM PLAN

SHEET:
BASR1




## 3 CASE CONTROLLER WIRING (SPORLAN)
NTS




## 2 CASE CONNECTION SCHEMATIC (SPORLAN)
NTS

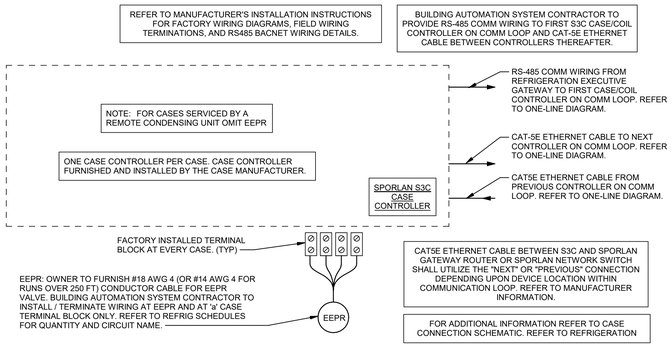


| BAS ONE-LINE AND SCHEDULE NOTES | | |
|---|---|---|
| E | —— | EXISTING BAS DEVICE, SENSOR, OR WIRE FOR REUSE. |
| RL | | EXISTING BAS DEVICE OR SENSOR TO RELOCATE AND RECONNECT. INSTALL NEW CABLE FOR RELOCATED DEVICE OR SENSOR AS NECESSARY. |
| RD | | REDESIGNATED BAS DEVICE OR SENSOR. |
| RP | | REPLACED BAS DEVICE OR SENSOR. |
| N | | NEW BAS DEVICE OR SENSOR. |
| FI | —— | NEW FIELD INSTALLED BAS DEVICE, SENSOR, OR WIRE. |
| FA | - - - - | NEW FACTORY INSTALLED BAS DEVICE, SENSOR, OR WIRE. |
| M | | BAS DEVICE OR SENSOR USED FOR MONITORING ONLY. |
| DI | | DIGITAL INPUT. |
| DO | | DIGITAL OUTPUT. |
| AI | | ANALOG INPUT. |

| ES-1 | |
|---|---|
| | COMMUNICATION PORT |
| COM1 | LCD (IF APPLICABLE) / BACNET LOOP |
| COM2 | SPECTRUM (NOVARnet) / BACNET LOOP |
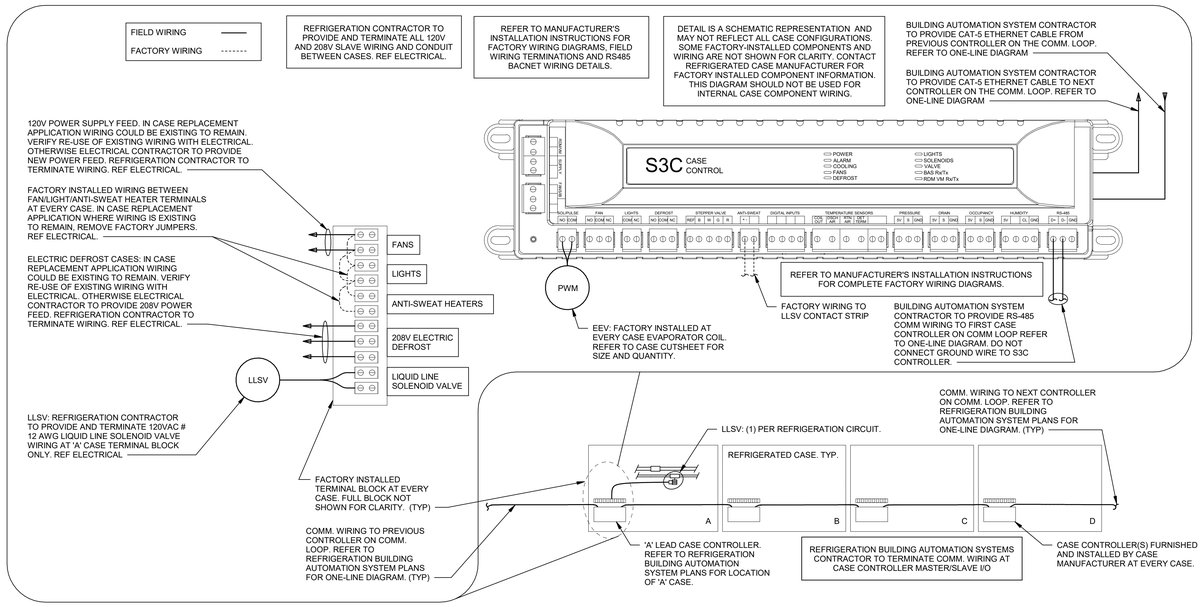
| COM MODULE 1 | |
|---|---|
| | COMMUNICATION PORT |
| COM3 | SPECTRUM (NOVARnet) / BACNET LOOP |
| COM4 | SPECTRUM (NOVARnet) / BACNET LOOP |

| COM MODULE 2 | |
|---|---|
| | COMMUNICATION PORT |
| COM5 | SPECTRUM (NOVARnet) / BACNET LOOP |
| COM6 | SPECTRUM (NOVARnet) / BACNET LOOP |
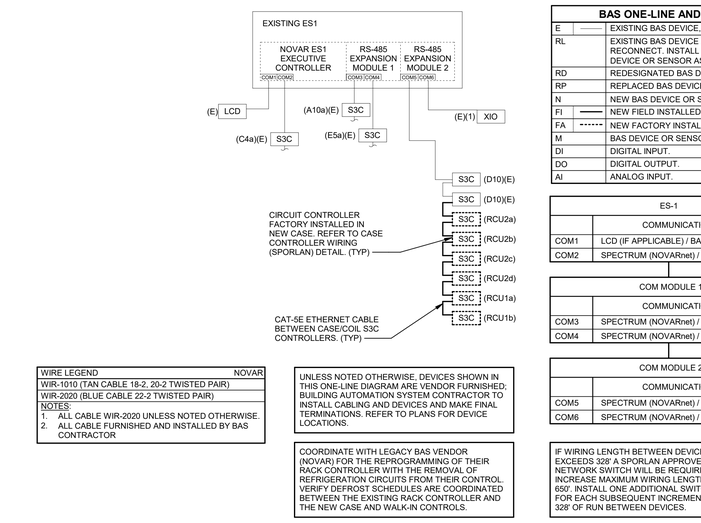
| WIRE LEGEND | NOVAR |
|---|---|
| WIR-1010 (TAN CABLE 18-2, 20-2 TWISTED PAIR) | |
| WIR-2020 (BLUE CABLE 22-2 TWISTED PAIR) | |

NOTES:
1. ALL CABLE WIR-2020 UNLESS NOTED OTHERWISE.
2. ALL CABLE FURNISHED AND INSTALLED BY BAS CONTRACTOR

UNLESS NOTED OTHERWISE, DEVICES SHOWN IN THIS ONE-LINE DIAGRAM ARE VENDOR FURNISHED; BUILDING AUTOMATION SYSTEM CONTRACTOR TO INSTALL CABLING AND DEVICES AND MAKE FINAL TERMINATIONS. REFER TO PLANS FOR DEVICE LOCATIONS.

COORDINATE WITH LEGACY BAS VENDOR (NOVAR) FOR THE REPROGRAMMING OF THEIR RACK CONTROLLER WITH THE REMOVAL OF REFRIGERATION CIRCUITS FROM THEIR CONTROL. VERIFY DEFROST SCHEDULES ARE COORDINATED BETWEEN THE EXISTING RACK CONTROLLER AND THE NEW CASE AND WALK-IN CONTROLS.

IF WIRING LENGTH BETWEEN DEVICES EXCEEDS 328' A SPORLAN APPROVED NETWORK SWITCH WILL BE REQUIRED TO INCREASE MAXIMUM WIRING LENGTH TO 650'. INSTALL ONE ADDITIONAL SWITCH FOR EACH SUBSEQUENT INCREMENT OF 328' OF RUN BETWEEN DEVICES.

## 1 REFRIGERATION BAS ONE-LINE DIAGRAM
NTS

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


Cedar & Pearson
Architects Engineers Planners
1971 Prospect Ave.
Orlando, FL 32814
P 407 | 645 5100
F 407 | 645 5101
www.cp.com



STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE USED IN WHOLE OR IN PART ON ANY OTHER PROJECT WITHOUT THE EXPRESS WRITTEN CONSENT OF CEDAR & PEARSON, INC. ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT, ARE RESERVED. ANY REUSE OF THIS DRAWING FOR REFERENCE OR FOR ANY PURPOSE OTHER THAN FOR THE SPECIFIC PROJECT FOR WHICH IT WAS PREPARED IS PROHIBITED. REPRODUCTION OF THIS DRAWING FOR REUSE REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REUSE OF THIS DRAWING FOR REFERENCE OR FOR ANY PURPOSE OTHER THAN FOR THE SPECIFIC PROJECT FOR WHICH IT WAS PREPARED IS PROHIBITED AND MAY BE CONTRARY TO THE LAW.



CONSULTANTS
HENDERSON ENGINEERS
8345 LERESA DRIVE, SUITE 320
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
228350787


Walmart
LAKE CITY, FL
2767 W US Highway 90
STORE NO: 00767

| JOB NUMBER: | 2190403 | PROTO: | 168 PROTO SC |
|---|---|---|---|

**2020 GENERAL REMODEL**

ISSUE BLOCK

| | | |
|---|---|---|
| CHECKED BY: | | EAR |
| DRAWN BY: | | FF |
| PROTO CYCLE: | | 09/24/21 |
| DOCUMENT DATE: | | 11/22/21 |

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY DUSTIN PADGET ON THE DATE LISTED BELOW USING A DIGITAL SIGNATURE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

DUSTIN PADGET LICENSE No. 80908 STATE OF FLORIDA PROFESSIONAL ENGINEER

12/07/2021

REFRIGERATION BUILDING AUTOMATION SYSTEM DETAILS

SHEET: BASR2

## PIPING SCHEDULE SYSTEM RCU1

| PIPE DESIGNATION | HORIZONTAL SUCTION | VERTICAL SUCTION RISER AS REQUIRED | LIQUID | ESTIMATED TOTAL LENGTH^^ |
|---|---|---|---|---|
| RCU1 | 1 3/8 | 7/8 | 1/2 | 60 |

* RISER SIZE IS SHOWN EVEN WHERE A RISER IS NOT EXPECTED. THIS IS FOR REFERENCE ONLY AND TO BE USED IN THE EVENT THAT A PIPING CONFLICT CAUSES THE NEED FOR A RISER. IF RISER LENGTH EXCEEDS 4 FEET, IT MUST BE APPROVED BY ENGINEER OF RECORD.

^^ESTIMATED TOTAL LENGTH INCLUDES HORIZONTAL AND VERTICAL PIPE SECTIONS. THIS IS ONLY AN ESTIMATE AND ACTUAL LENGTH WILL VARY.

Updated: 11/12/2021

NOTE: CONTENTS OF SCHEDULE CONTAINS INFORMATION DERIVED FROM OWNER'S RECORD SCHEDULES, MANUFACTURER SUBMITTALS, CUTSHEETS, AND OWNER'S DESIGN PARAMETERS AT THE TIME THE SCHEDULE WAS PREPARED. FIELD VERIFY AS IT MAY NOT REFLECT EXISTING CONDITIONS.

## PIPING SCHEDULE SYSTEM RCU2

| PIPE DESIGNATION | HORIZONTAL SUCTION | VERTICAL SUCTION RISER AS REQUIRED | LIQUID | ESTIMATED TOTAL LENGTH^^ |
|---|---|---|---|---|
| RCU2 | 1 5/8 | 1 1/8 | 5/8 | 65 |

* RISER SIZE IS SHOWN EVEN WHERE A RISER IS NOT EXPECTED. THIS IS FOR REFERENCE ONLY AND TO BE USED IN THE EVENT THAT A PIPING CONFLICT CAUSES THE NEED FOR A RISER. IF RISER LENGTH EXCEEDS 4 FEET, IT MUST BE APPROVED BY ENGINEER OF RECORD.

^^ESTIMATED TOTAL LENGTH INCLUDES HORIZONTAL AND VERTICAL PIPE SECTIONS. THIS IS ONLY AN ESTIMATE AND ACTUAL LENGTH WILL VARY.

Updated: 11/12/2021

NOTE: CONTENTS OF SCHEDULE CONTAINS INFORMATION DERIVED FROM OWNER'S RECORD SCHEDULES, MANUFACTURER SUBMITTALS, CUTSHEETS, AND OWNER'S DESIGN PARAMETERS AT THE TIME THE SCHEDULE WAS PREPARED. FIELD VERIFY AS IT MAY NOT REFLECT EXISTING CONDITIONS.




1 REFRIGERATION PLAN
1/8" = 1'-0"

## CONDENSING UNIT GENERAL NOTES

RM-10.11.20

1. INSTALL CONDENSING UNIT IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS. REFER TO ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR INSTALLATION REQUIREMENTS AND ADDITIONAL INFORMATION.
2. CONTRACTOR SHALL INSTALL CONDENSING UNIT MANUFACTURER FURNISHED LIQUID LINE SOLENOID VALVE CONTROLLED VIA FACTORY INSTALLED CASE CONTROLLER (LOCATED AT CASE).
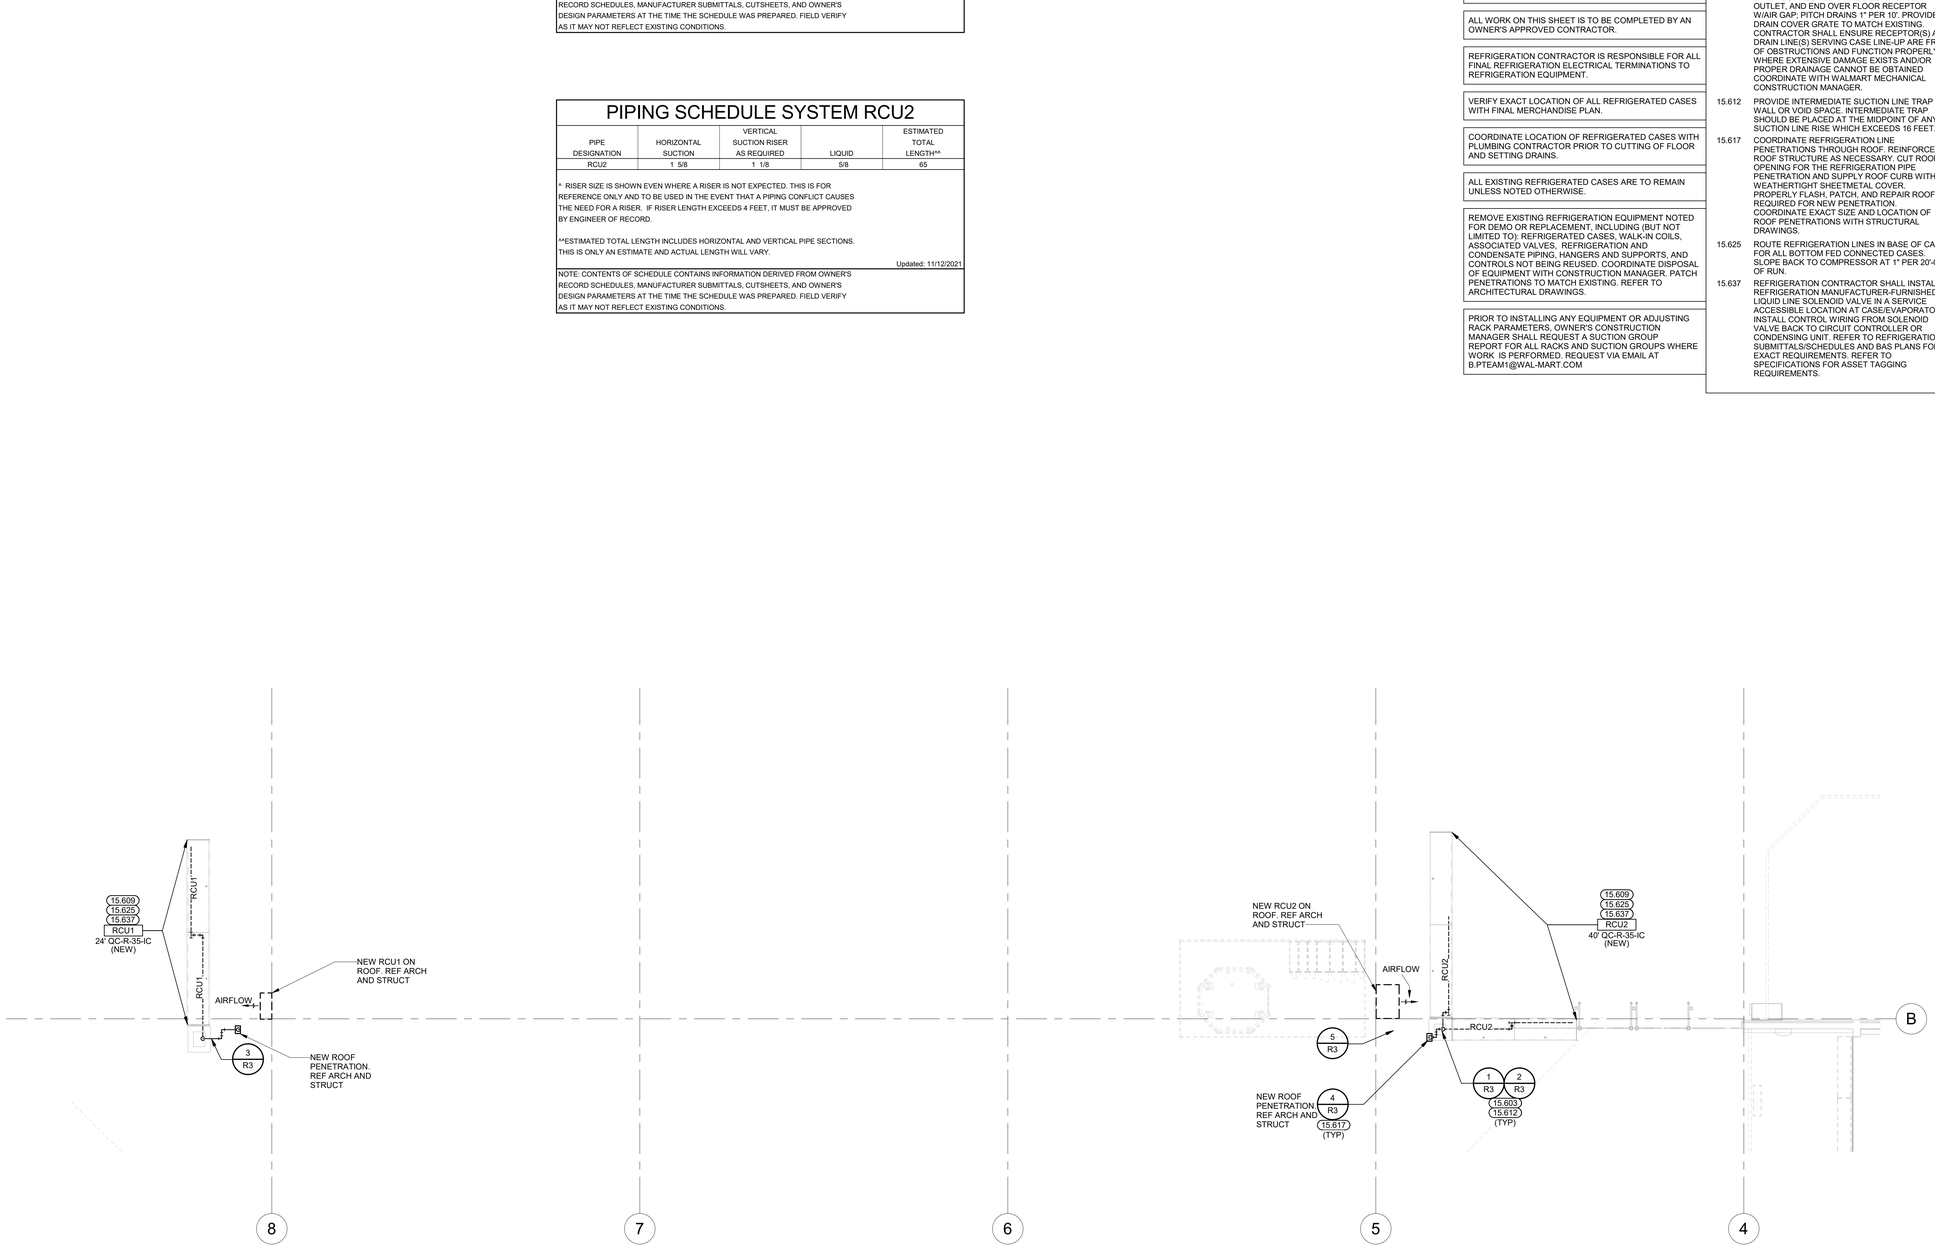
## EPA CLEAN AIR ACT

RM-11.02.15

COMPLY WITH EPA CLEAN AIR ACT, TITLE VI, SECTION 608 AND CODE OF FEDERAL REGULATION TITLE 40, PART 82 WHEN ADDING OR REMOVING REFRIGERATED EQUIPMENT. RECORD ALL EQUIPMENT IDENTIFICATION NUMBERS, MODEL AND SERIAL NUMBERS, THE AMOUNT OF REFRIGERANT RECOVERED FROM EACH UNIT, THE DATE OF DECOMMISSIONING, COMPANY NAME AND SIGNATURE OF ON-SITE SUPERVISOR.

24 HOURS PRIOR TO SHUTTING DOWN ANY REFRIGERATION SYSTEMS, HVAC SYSTEMS, OR BUILDING AUTOMATION CONTROL SYSTEMS, SEND E-MAIL TO NSRM@WALMART.COM. THE E-MAIL SHALL STATE WHAT, WHY, AND WHEN IT IS BEING SHUT DOWN AND HOW LONG IT IS ANTICIPATED TO BE DOWN. THEN SEND A FOLLOW UP E-MAIL TO NSRM@WALMART.COM AFTER THE WORK IS COMPLETE AND THE SYSTEM IS BACK UP AND RUNNING.

REFERENCE ARCHITECTURAL DRAWINGS FOR ALL NEW CASES BEING INSTALLED FOR CONNECTION LOCATION OF UTILITIES. (TOP FED VS. BOTTOM FED)

SEPARATE CONTRACTOR IS RESPONSIBLE FOR RE-SKIN OF EXISTING REFRIGERATED CASES TO REMAIN.

ALL WORK ON THIS SHEET IS TO BE COMPLETED BY AN OWNER'S APPROVED CONTRACTOR.

REFRIGERATION CONTRACTOR IS RESPONSIBLE FOR ALL FINAL REFRIGERATION ELECTRICAL TERMINATIONS TO REFRIGERATION EQUIPMENT.

VERIFY EXACT LOCATION OF ALL REFRIGERATED CASES WITH FINAL MERCHANDISE PLAN.

COORDINATE LOCATION OF REFRIGERATED CASES WITH PLUMBING CONTRACTOR PRIOR TO CUTTING OF FLOOR AND SETTING DRAINS.

ALL EXISTING REFRIGERATED CASES ARE TO REMAIN UNLESS NOTED OTHERWISE.

REMOVE EXISTING REFRIGERATION EQUIPMENT NOTED FOR DEMO OR REPLACEMENT, INCLUDING (BUT NOT LIMITED TO): REFRIGERATED CASES, WALK-IN COILS, ASSOCIATED VALVES, REFRIGERATION AND CONDENSATE PIPING, HANGERS AND SUPPORTS, AND CONTROLS NOT BEING REUSED. COORDINATE DISPOSAL OF EQUIPMENT WITH CONSTRUCTION MANAGER. PATCH PENETRATIONS TO MATCH EXISTING. REFER TO ARCHITECTURAL DRAWINGS.

PRIOR TO INSTALLING ANY EQUIPMENT OR ADJUSTING RACK PARAMETERS, OWNER'S CONSTRUCTION MANAGER SHALL REQUEST A SUCTION GROUP REPORT FOR ALL RACKS AND SUCTION GROUPS WHERE WORK IS PERFORMED. REQUEST VIA EMAIL AT B.PTEAM1@WAL-MART.COM

## PIPING AND REFRIGERATION SCHEDULE SYMBOLS

RM-10.06.20

| | |
|---|---|
| * | MODIFY CIRCUIT OR PIPE LENGTH |
| ** | NEW CASE, COIL, CIRCUIT OR VALVE |
| **** | CHANGE EXISTING PIPE SIZE AS INDICATED OR NEW PIPE |
| ^ | RISER SIZE IS SHOWN EVEN WHERE A RISER IS NOT EXPECTED. THIS IS FOR REFERENCE ONLY AND IS TO BE USED IN THE EVENT THAT A PIPING CONFLICT CAUSES THE NEED FOR A RISER. IF THE RISER LENGTH EXCEEDS 4 FEET, IT MUST BE APPROVED BY ENGINEER OF RECORD. |
| # | CONTRACTOR TO FIELD VERIFY EXISTING RISER SIZE. IF EXISTING PIPE SIZE DOES NOT MATCH SCHEDULE, REPLACE EXISTING RISER WITH NEW SIZE AS SHOWN. |

## KEYNOTES

15.603 AT ALL POINTS WHERE SUCTION LINES RISE, PROVIDE A SUCTION LINE TRAP AT THE BASE OF THE RISER.

15.609 PROVIDE PVC DRAIN LINE FROM EACH CASE DRAIN CONNECTION SAME SIZE AS CASE OUTLET, AND END OVER FLOOR RECEPTOR W/AIR GAP; PITCH DRAINS 1" PER 10'. PROVIDE DRAIN COVER GRATE TO MATCH EXISTING. CONTRACTOR SHALL ENSURE RECEPTOR(S) AND DRAIN LINE(S) SERVING CASE LINE-UP ARE FREE OF OBSTRUCTIONS AND FUNCTION PROPERLY. WHERE EXTENSIVE DAMAGE EXISTS AND/OR PROPER DRAINAGE CANNOT BE OBTAINED COORDINATE WITH WALMART MECHANICAL CONSTRUCTION MANAGER.

15.612 PROVIDE INTERMEDIATE SUCTION LINE TRAP IN WALL OR VOID SPACE. INTERMEDIATE TRAP SHOULD BE PLACED AT THE MIDPOINT OF ANY SUCTION LINE RISE WHICH EXCEEDS 16 FEET.

15.617 COORDINATE REFRIGERATION LINE PENETRATIONS THROUGH ROOF. REINFORCE ROOF STRUCTURE AS NECESSARY. CUT ROOF OPENING FOR THE REFRIGERATION PIPE PENETRATION AND SUPPLY ROOF CURB WITH WEATHERTIGHT SHEETMETAL COVER. PROPERLY FLASH, PATCH, AND REPAIR ROOF AS REQUIRED FOR NEW PENETRATION. COORDINATE EXACT SIZE AND LOCATION OF ROOF PENETRATIONS WITH STRUCTURAL DRAWINGS.

15.625 ROUTE REFRIGERATION LINES IN BASE OF CASE FOR ALL BOTTOM FED CONNECTED CASES. SLOPE BACK TO COMPRESSOR AT 1" PER 20'-0" OF RUN.

15.637 REFRIGERATION CONTRACTOR SHALL INSTALL REFRIGERATION MANUFACTURER-FURNISHED LIQUID LINE SOLENOID VALVE IN A SERVICE ACCESSIBLE LOCATION AT CASE/EVAPORATOR. INSTALL CONTROL WIRING FROM SOLENOID VALVE BACK TO CIRCUIT CONTROLLER OR CONDENSING UNIT. REFER TO REFRIGERATION SUBMITTALS/SCHEDULES AND BAS PLANS FOR EXACT REQUIREMENTS. REFER TO SPECIFICATIONS FOR ASSET TAGGING REQUIREMENTS.

## REFRIGERATION SYMBOLS

RM-09.25.18

| | |
|---|---|
| XXX / XXX | CIRCUIT NUMBER / MODEL NUMBER (CIRCUIT INFO) |
| CO | CLEANOUT (CO) |
| | CONDENSATE DRAIN LINE (CD) |
| | CONNECT TO EXISTING |
| | CONTINUATION |
| X / XX | DETAIL NUMBER / SHEET NUMBER (DETAIL REFERENCE) |
| | EVAPORATOR COIL |
| | ISOLATION VALVE |
| | ELBOW - TURNED DOWN |
| | ELBOW - TURNED UP |
| XX.XXX | REFRIGERATION KEYNOTE REFERENCE |
| | REFRIGERATION PIPING (ABOVE) |
| | REFRIGERATION PIPING (BELOW) |
| | REFRIG PIPING CASE CONNECTION |
| ETR | EXISTING TO REMAIN |
| (TYP) | TYPICAL |

## GENERAL NOTES

RM-W-09.28.20

1. PLAN INDICATES GENERAL ROUTING OF REFRIGERANT LINES, WITH A SINGLE LINE SHOWN INDICATING BOTH SUCTION AND LIQUID LINE ROUTING FOR EACH SYSTEM.
2. REFRIGERATION SYSTEM INSTALLATION SHALL BE IN COMPLETE CONFORMANCE WITH SPECIFICATIONS, AND WITH ALL REQUIREMENTS OF REFRIGERATION EQUIPMENT MANUFACTURER.
3. REFRIGERATION DRAWINGS ARE PROVIDED AS AN AID TO BIDDERS AND TO INDICATE DESIRED ROUTING OF REFRIGERATION LINES; CONTRACTOR SHALL ASSUME FULL RESPONSIBILITY FOR CORRECT INSTALLATION OF PIPING AND ACCESSORIES TO PROVIDE A COMPLETE AND FULLY OPERATING SYSTEM.
4. REFER TO SPECIFICATION 15600 FOR INSULATION THICKNESS. INSIDE DIAMETER OF INSULATION SHALL MATCH PIPE DIAMETER TO MINIMIZE AIR GAPS BETWEEN PIPING AND INSULATION. PROVIDE FACTORY PRE-MANUFACTURED FITTINGS AT ALL TRAPS AND ELBOWS. WHERE PRE-MANUFACTURED FITTINGS ARE UNAVAILABLE MITER CUT ALL FITTINGS TO ENSURE PROPER SEAL BETWEEN INSULATION SEGMENTS.
5. PIPE INSULATION SHALL BE BLACK REGARDLESS OF EXISTING INSULATION COLOR.
6. COORDINATE REFRIGERATION DEMOLITION ISSUES WITH THE ARCHITECTURAL DRAWINGS. REFER TO ARCHITECTURAL PLANS FOR REFRIGERATION EQUIPMENT DEMOLITION AND COOLER REPAIR AND REMODELING.
7. REFRIGERATION SYSTEM SHALL REMAIN OPERATIONAL DURING REMODELING. DURING THE PHASING OF OLD TO NEW SYSTEMS, BOTH NEW AND OLD REFRIGERATION SYSTEMS MAY BE REQUIRED TO OPERATE AT THE SAME TIME FOR A SHORT PERIOD.
8. WHERE NEW REFRIGERATED EQUIPMENT IS INDICATED ON THE DRAWINGS, PROVIDE DEMOLITION, REMOVAL, AND TEMPORARY STORAGE OF OLD EQUIPMENT PER OWNER'S MECHANICAL SERVICES CONSTRUCTION MANAGER'S INSTRUCTIONS, AND REFRIGERATION DEMO NOTES.
9. COORDINATE REMOVAL AND DISPOSAL OF EXISTING EVAPORATORS, REFRIGERATED CASES, AND CONDENSING UNITS, WITH OWNER'S MECHANICAL SERVICES CONSTRUCTION MANAGER.
10. REMOVE COPPER LINES, EVAPORATORS, AND CONDENSATE LINES FROM COOLERS/ FREEZERS BEING REMOVED FROM SITE. COORDINATE WITH WALK-IN PANEL VENDOR FOR TIME LINE OF REPLACEMENT. REFERENCE SPECIFICATION FOR CONTACT INFORMATION.
11. WALK-IN PANEL VENDOR SHALL PROPERLY PREPARE ALL COOLER/FREEZER PANELS, GLASS DOORS, SLIDER OR SWING DOORS, PALLETIZE, AND PREPARE THE EQUIPMENT TO SHIP OFF SITE.
12. COORDINATE WITH FIRE PROTECTION CONTRACTOR FOR THE REMOVAL OF SPRINKLERS FOR ALL REMOVED COOLER/FREEZER BOXES.
13. COORDINATE WITH ELECTRICAL CONTRACTOR FOR THE REMOVAL OF ALL REMOVED COOLER/FREEZER BOXES ELECTRICAL WIRING DEVICES.
14. COORDINATE WITH EMS CONTRACTOR FOR THE REMOVAL OF ALL REMOVED COOLER/FREEZER BOXES EMS WIRING AND DEVICES.
15. EXISTING REFRIGERATION PIPING MAY BE RE-USED UNLESS OTHERWISE NOTED ON PLANS. REFER TO SCHEDULES FOR PIPE SIZE REQUIREMENTS.
16. BUILDING COMPONENTS ABANDONED BY THE SCOPE OF WORK SHALL BE SECURED TO PREVENT FALLING, LOOSENING, OR CREATING DAMAGE OF ANY KIND IN THE FUTURE.
17. IF ANY RACK SYSTEMS WILL BE OPENED TO ADD OR REPLACE CASES, EVAPORATORS, ETC, THEN 24 TO 48 HOURS AFTER THE WORK IS COMPLETED AND ALL FINAL ADJUSTMENTS HAVE BEEN MADE, PROVIDE AND CHANGE LIQUID LINE FILTER CORES, OIL SYSTEM FILTER USING SPORLAN OF STYLE FILTER, AND REPLACE SUCTION FILTERS. FILTERS ARE TO BE RATED FOR WAX REMOVAL. CONTRACTOR TO PROPERLY DISPOSE OF OIL AND COMPONENTS REPLACED. REFER TO SPECIFICATION 15600.
18. REFER TO GROCERY ARCHITECTURAL DRAWINGS FOR ADDITIONAL WORK BY REFRIGERATION CONTRACTOR.
19. INSTALL ASSET TAGS ON ALL NEW REFRIGERATED CASES AND COMPLETE THE DATA COLLECTION INFORMATION. DELETE DEMOED ASSETS FROM ASSET TAGGING APPLICATION. REFER TO SPECIFICATIONS.
20. UPON START-UP OF ALL NEW REFRIGERATED EQUIPMENT, REFRIGERATION CONTRACTOR SHALL REQUEST THE BUILDING PERFORMANCE REPORT FOR ALL RACKS AND SUCTION GROUPS WHERE WORK IS PERFORMED. ANY DEVIATIONS NOTED ON THE REPORT MUST BE CORRECTED PRIOR TO PROJECT CLOSE OUT. REQUEST VIA EMAIL AT B.PTEAM1@WAL-MART.COM

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


1975 Prospect Ave.
Orlando, FL 32814
P 407 / 645 5100
F 407 / 645 5101
www.cpa.com
Cabrer & Peterson
Architects Engineers Planners



STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE USED IN PART OR IN WHOLE FOR CONSTRUCTION ON ANY OTHER PROJECT OR SITE. ANY REUSE WITHOUT THE EXPRESS WRITTEN PERMISSION AND APPROVAL OF THE ARCHITECT WILL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO THE ARCHITECT. ANY REUSE WITHOUT SUCH PERMISSION AND APPROVAL SHALL ENTITLE THE ARCHITECT TO FULL COMPENSATION FOR SERVICES PERFORMED ON THE PROJECT PRIOR TO SUCH UNAUTHORIZED REUSE. ALL DRAWINGS, SPECIFICATIONS AND COPIES THEREOF FURNISHED BY THE ARCHITECT ARE AND SHALL REMAIN THE ARCHITECT'S PROPERTY. THEY ARE NOT TO BE USED BY ANY OWNER OR OTHERS ON EXTENSIONS OF THE PROJECT OR ANY OTHER PROJECT EXCEPT BY AGREEMENT IN WRITING AND APPROPRIATE COMPENSATION TO THE ARCHITECT. ALL COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING COPYRIGHT, ARE RETAINED BY AND SHALL REMAIN THE PROPERTY OF THE ARCHITECT. VISUAL CONTACT WITH THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.



CONSULTANTS
HENDERSON ENGINEERS
8345 LENEXA DRIVE, SUITE 320
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
2285950787


Walmart
LAKE CITY, FL
2767 W US Highway 90
STORE NO.: 00767
2190403 PROTO: 168 PROTO SC
JOB NUMBER:
2020 GENERAL REMODEL

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | EAR |
| DRAWN BY: | FF |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY DUSTIN PADGET ON THE DATE LISTED BELOW USING A DIGITAL SIGNATURE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

DUSTIN PADGET LICENSE No. 90908 STATE OF FLORIDA PROFESSIONAL ENGINEER

12/07/2021

REFRIGERATION PLANS

SHEET:
R1

# REFRIGERATION SCHEDULE SYSTEM RCU1

| | | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Format: | Supercenter | Store #: | 767 | System Type: | Remote Condensing Unit | Refrigerant: | R448A | Refrig. OEM: | Kysor//Warren | Condenser Type | Air | Heat Reclaim Media: | N/A | SG1 Refrig. Liquid Temp (°F): | 113 | SG2 Refrig. Liquid Temp (°F): | N/A | SG3 Refrig. Liquid Temp (°F): | N/A |
| Proto Size: | -- | City/State: | Lake City, FL | Consultant: | HEI | Estimated Refrigerant Charge (lbs): | N/A | System Elec: | 208/220V 3ph 60Hz | Sat. Cond. Temp (°F): | 121 | Heat Reclaim Use: | N/A | SG1 Comp RGT (°F): | 50 | SG2 Comp RGT (°F): | N/A | SG3 Comp RGT (°F): | N/A |
| Proto Cycle Date: | 9/24/2021 | Elevation (ft): | 123 | Prepared By: | Fiona Fei | Rack & Cond. Charge (lbs): | - | Defrost Elec: | Off Time | Cond. Design TD (°F): | 15 | Heat Reclaim Water (GPM): | -- | | | | | | |
| Date Prepared: | 1/23/2022 | Design DB (°F) / WB (°F): | 106°F / 81°F | Interior Design DB (°F) / RH%: | 75°F / 55% | Fixture and Field Piping (lbs): | N/A | Sys. Pilot Elec: | 120V 1Ph | Cond. Elec | 208/220V 3 Ph 60Hz | Est. Summer THR Avail (MBH): | N/A | Evap. Superheat (°F): | 10 | | | | |

| EXTERIOR DRY BULB (DB) (°F): | 105.7 |
|---|---|
| 50 yr. Extreme DB from ASHRAE Pub. | 2017 |
| EXTERIOR WET BULB (WB) (°F): | 80.7 |
| 0.4% Monthly Max WB from ASHRAE Pub. | 2017 |
| ASHRAE Design Conditions Weather Station: | Gainesville Regional, FL |

| CIRCUIT INFORMATION | | | | | | | | | | | | | | | | | | FIXTURE ELECTRICAL INFORMATION | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | Case Fixture Length / Quantity | | | | | Walk-In Box Size | | | | | | LSHX Y or N? & Model # WI Evaps | Evaporator Coil TXV / Distributor Nozzle | Sub-Circuit Load (MBH) | Circuit Load (MBH) | Evap SST | Case/ Walk-In Air Temp | Circuit Control Valves | | Defrost | Defrost Heaters | | Fans | | Lights Amps (120v) | Anti-Sweat Amps (120v) | | | |
| CKT # | FT /# of Doors | 2 Dr/4' | 3 Dr/6' | 4 Dr/8' | 5 Dr/12' | L | W | H | Case/Coil Model | Case/Coil Manuf. | Application | | | | | | | EPR | LLSV | Type | Amps | Voltage | Amps | Voltage | | | Comments | Equip Number | CKT # |
| RCU1 | 24 FT | | | | 2 | | | | QC-R-35-IC | HILL PHOENIX INC | Grab-N-Go | | | -- | 27.1 | 24 | 32 | | E6 | OT | -- | -- | 3.0 | 120/1 | 2.6 | -- | TOTAL LIGHTS INCLUDES FOUR ROWS OF SHELF LIGHTS | RD1069.652 - 6/21/2019 | RCU1 |
| | | | | | | | | | | | | SUCTION GROUP #1 REQUIRED CAPACITY (MBH): | | | 27.1 | 22 | (°F) Suction Temperature | | | | | | | | | | |

General Notes:

1.) Owner's designated refrigeration equipment manufacturer: Kysor//Warren.
2.) Remote Condensing Unit(s) shall be equipped with oversized receiver, if applicable.
3.) OEM to ensure adequate size of compressors and condenser to meet 105% NRE at the scheduled ambient temperature conditions above.
4.) Cases are controlled by S3C.

Updated: 11/12/2021

# REFRIGERATION SCHEDULE SYSTEM RCU2

| | | | | | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Format: | Supercenter | Store #: | 767 | System Type: | Remote Condensing Unit | Refrigerant: | R448A | Refrig. OEM: | Kysor//Warren | Condenser Type | Air | Heat Reclaim Media: | N/A | SG1 Refrig. Liquid Temp (°F): | 113 | SG2 Refrig. Liquid Temp (°F): | N/A | SG3 Refrig. Liquid Temp.(°F): | N/A |
| Proto Size: | -- | City/State: | Lake City, FL | Consultant: | HEI | Estimated Refrigerant Charge (lbs): | N/A | System Elec: | 208/220V 3ph 60Hz | Sat. Cond. Temp (°F): | 121 | Heat Reclaim Use: | N/A | SG1 Comp RGT (°F): | 50 | SG2 Comp RGT (°F): | N/A | SG3 Comp RGT (°F): | N/A |
| Proto Cycle Date: | 9/24/2021 | Elevation (ft): | 123 | Prepared By: | Fiona Fei | Rack & Cond. Charge (lbs): | - | Defrost Elec: | Off Time | Cond. Design TD (°F): | 15 | Heat Reclaim Water (GPM): | -- | | | | | | |
| Date Prepared: | 1/23/2022 | Design DB (°F) / WB (°F): | 106°F / 81°F | Interior Design DB (°F) / RH%: | 75°F / 55% | Fixture and Field Piping (lbs): | N/A | Sys. Pilot Elec: | 120V 1Ph | Cond. Elec | 208/220V 3 Ph 60Hz | Est. Summer THR Avail (MBH): | N/A | Evap. Superheat (°F): | 10 | | | | |

| EXTERIOR DRY BULB (DB) (°F): | 105.7 |
|---|---|
| 50 yr. Extreme DB from ASHRAE Pub. | 2017 |
| EXTERIOR WET BULB (WB) (°F): | 80.7 |
| 0.4% Monthly Max WB from ASHRAE Pub. | 2017 |
| ASHRAE Design Conditions Weather Station: | Gainesville Regional, FL |

| CIRCUIT INFORMATION | | | | | | | | | | | | | | | | | | FIXTURE ELECTRICAL INFORMATION | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | Case Fixture Length / Quantity | | | | | Walk-In Box Size | | | | | | LSHX Y or N? & Model # WI Evaps | Evaporator Coil TXV / Distributor Nozzle | Sub-Circuit Load (MBH) | Circuit Load (MBH) | Evap SST | Case/ Walk-In Air Temp | Circuit Control Valves | | Defrost | Defrost Heaters | | Fans | | Lights Amps (120v) | Anti-Sweat Amps (120v) | | | |
| CKT # | FT /# of Doors | 2 Dr/4' | 3 Dr/6' | 4 Dr/8' | 5 Dr/12' | L | W | H | Case/Coil Model | Case/Coil Manuf. | Application | | | | | | | EPR | LLSV | Type | Amps | Voltage | Amps | Voltage | | | Comments | Equip Number | CKT # |
| RCU2 | 40 FT | | | 2 | 2 | | | | QC-R-35-IC | HILL PHOENIX INC | GRAB-N-GO | | | -- | 45.2 | 24 | 32 | | E9 | OT | -- | -- | 5.4 | 120/1 | 4.4 | -- | TOTAL LIGHTS INCLUDES FOUR ROWS OF SHELF LIGHTS | RD1069.652 - 6/21/2019 | RCU2 |
| | | | | | | | | | | | | SUCTION GROUP #1 REQUIRED CAPACITY (MBH): | | | 45.2 | 22 | (°F) Suction Temperature | | | | | | | | | | |

General Notes:

1.) Owner's designated refrigeration equipment manufacturer: Kysor//Warren.
2.) Remote Condensing Unit(s) shall be equipped with oversized receiver, if applicable.
3.) OEM to ensure adequate size of compressors and condenser to meet 105% NRE at the scheduled ambient temperature conditions above.
4.) Cases are controlled by S3C.

Updated: 11/12/2021

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


1975 Prospect Ave.
Orlando, FL 32814
P 407.841.9100
F 407.649.9161
arkhart-p.com
Cobart & Pearson
Architects Engineers Planners



STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE CONSIDERED SUITABLE FOR USE ON A DIFFERENT PROJECT. ALL RIGHTS RESERVED. USE OF THIS DRAWING FOR REFERENCE OR REPRODUCTION OF THIS DRAWING OR PORTIONS THEREOF, OR THE SERVICES OF PROFESSIONALS RECORDED THEREON FOR ANY PURPOSE OTHER THAN AS AUTHORIZED IN WRITING BY COBART & PEARSON, INC. IS PROHIBITED AND MAY BE CONTRARY TO THE LAW.



CONSULTANTS
HENDERSON ENGINEERS
8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
22R050787


Walmart
LAKE CITY, FL
2767 W US Highway 90
STORE NO: 00767
2020 GENERAL REMODEL
JOB NUMBER: 2190403 PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | EAR |
| DRAWN BY: | FF |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY DUSTIN PADGET ON THE DATE LISTED BELOW USING A DIGITAL SIGNATURE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

DUSTIN PADGET LICENSE No. 50908 STATE OF FLORIDA PROFESSIONAL ENGINEER

12/07/2021

REFRIGERATION SCHEDULES

SHEET: R2




## 5 REFRIGERATION PIPING SUPPORT (ON ROOF)
NTS




## 4 ROOF PENETRATION
NTS

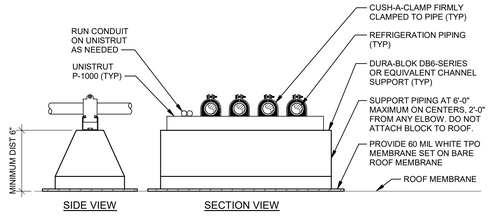


## 3 HORIZONTAL REFRIGERANT LINE SUPPORT
NTS

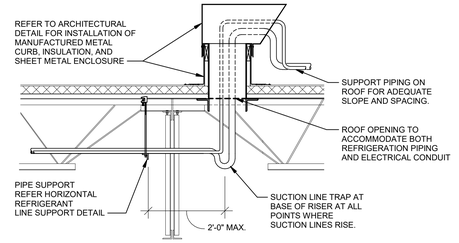


## 2 INTERMEDIATE SUCTION LINE TRAP
NTS

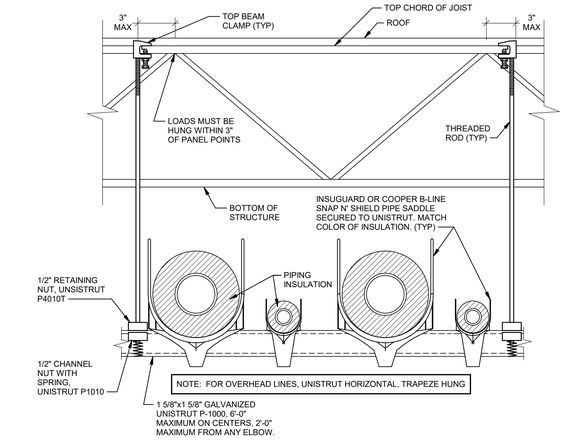


## 1 VERTICAL REFRIGERANT LINE SUPPORT
NTS

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

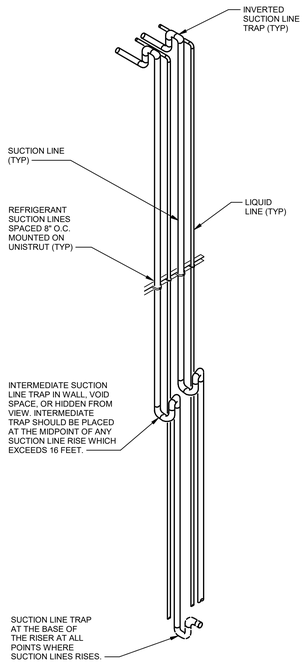EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.


1975 Prospect Ave.
Orlando, FL 32814
P 407.645.5100
F 407.645.5101
www.cpa.com
Cobart & Pearson
Architects Engineers Planners

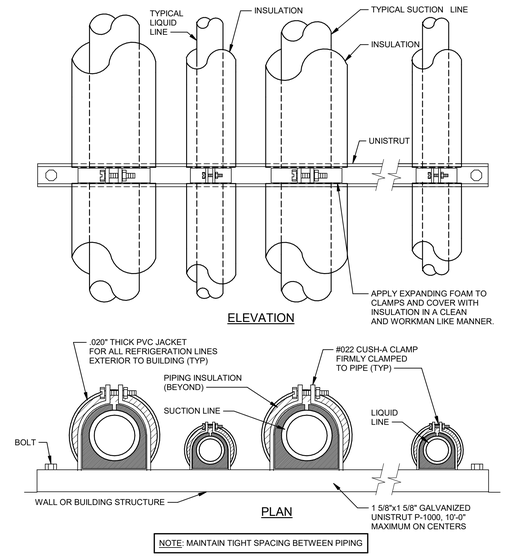

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON THIS PROJECT ONLY AND SHALL NOT BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT. CONTRACTOR(S) SHALL VERIFY AND COORDINATE ALL DIMENSIONS AND CONDITIONS OF THE JOB SITE AND SHALL NOTIFY THE ARCHITECT IMMEDIATELY OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK. THE ARCHITECT IS NOT RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK. THE ARCHITECT'S REVIEW OF THE CONTRACTOR'S SUBMITTALS IS ONLY FOR CONFORMANCE WITH THE DESIGN CONCEPT OF THE PROJECT AND COMPLIANCE WITH THE INFORMATION GIVEN IN THE CONTRACT DOCUMENTS. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING ALL QUANTITIES AND DIMENSIONS, FABRICATION PROCESSES, CONSTRUCTION TECHNIQUES, COORDINATION WITH OTHER TRADES AND SATISFACTORY PERFORMANCE OF ALL WORK. THE ARCHITECT'S REVIEW OF SHOP DRAWINGS, PRODUCT DATA, SAMPLES AND SIMILAR SUBMITTALS IS NOT INTENDED TO INCLUDE REVIEW OF THE ADEQUACY OF ANY ERECTION DRAWINGS, PERFORMANCE CHARACTERISTICS, QUANTITIES, DIMENSIONS, WEIGHTS OR GAUGES, PROCESSES, CONSTRUCTION TECHNIQUES OR COORDINATION WITH OTHER TRADES. ACCEPTANCE OF SUCH ITEMS DOES NOT RELIEVE THE CONTRACTOR FROM RESPONSIBILITY FOR DEVIATIONS FROM THE CONTRACT DOCUMENTS UNLESS THE CONTRACTOR HAS INFORMED THE ARCHITECT IN WRITING OF SUCH DEVIATIONS AT THE TIME OF SUBMISSION AND THE ARCHITECT HAS GIVEN WRITTEN ACCEPTANCE TO THE SPECIFIC DEVIATIONS. ACCEPTANCE BY THE ARCHITECT DOES NOT RELIEVE THE CONTRACTOR FROM RESPONSIBILITY FOR ERRORS OR OMISSIONS IN THE SHOP DRAWINGS OR OTHER SUBMITTALS.



CONSULTANTS
HENDERSON ENGINEERS
8345 LEREDA CIRCLE, SUITE 320
LAKELAND, FL 33811
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
2208560787


Walmart

LAKE CITY, FL
2767 W US Highway 90
STORE NO: 00767

2020 GENERAL REMODEL

JOB NUMBER: 2190403 PROTO: 168 PROTO SC

ISSUE BLOCK

| | | |
|---|---|---|
| | | |

| | |
|---|---|
| CHECKED BY: | EAR |
| DRAWN BY: | FF |
| PROTO CYCLE: | 09/24/21 |
| DOCUMENT DATE: | 11/22/21 |

THIS ITEM HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY DUSTIN PADGET ON THE DATE LISTED BELOW USING A DIGITAL SIGNATURE.

PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

DUSTIN PADGET LICENSE No. 80908 STATE OF FLORIDA PROFESSIONAL ENGINEER

12/07/2021

REFRIGERATION DETAILS

SHEET: R3