

Zone 1 +/- 19.47
Zone 2 +/- 29.96
Zone 3 +/- 41.63

WIND PRESSURE ON COMPONENTS AND CLADDING

PROFESSIONAL SERVICES BY
DRISCOLL ENGINEERING, INC.
PO BOX 357577
GAINESVILLE, FL 32635
PH (352)-331-1513
CA 8690

PLANS AND SPECIFICATIONS

The plans and specifications presented herein are applicable only for the anticipated construction at the locations shown. If construction plans change, the Design Professional should be notified so the plans and specifications can be re-evaluated. The Design Professional should be given the opportunity to review final plans and specifications to see if the intent of the plans and specifications has been followed and/or if supplemental details and recommendations are needed. The Design Professional warrants that the plans and specifications contained herein, have been prepared in accordance with generally accepted professional engineering practice. No other warranties are implied or expressed.

CORPORATE PROTECTION

It is understood and agreed that the Design Professional's Basic Services under this Agreement do not include project observation or review of the Contractor's performance or any other construction phase services, and that such services will be provided by the Client. The Client assumes all responsibility for interpretation of the contractor Documents and for construction observation and supervision and waives any claims against the Design Professional that may be in any way connected thereto.

In addition, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any loss, claim or cost, including reasonable attorney's fees and costs of defense, arising or resulting from the performance of such services by other person or entities and from any and all claims arising from modifications, clarifications, interpretations, adjustments or changes made to Contract Documents to reflect changed field or other conditions, except for claims arising from the sole negligence or willful misconduct to the Design Professional.

OWNERSHIP OF INSTRUMENTS OF SERVICE

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Design Professional as instruments of service shall remain the property of the Design Professional. The Design Professional shall retain all common law, statutory and other reserved rights, including the copyright thereto.

DEFECTS IN SERVICE

The Client shall promptly report to the Design Professional any defects or suspected defects in the Design Professional's work or services of which the Client becomes aware, so that the Design Professional may take measures to minimize the consequences of such a defect. The Client warrants that he or she will impose a similar notification requirement on all contractors in his or her Client/Contractor contract and shall require all subcontractors at any level to contain a like requirement. Failure by the Client, and the Client's contractors or subcontractors to notify the Design Professional, shall relieve the Design Professional of the costs of remedying the defects above the sum such remedy would have cost had prompt notification been given.

VERIFICATION OF EXISTING CONDITIONS

Inasmuch as the remodeling and/or rehabilitation of an existing building requires that certain assumptions be made regarding existing conditions, and because some of these assumptions may not be verifiable without expending additional sums of money or destroying otherwise adequate or serviceable portions of the building, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any claim, liability or cost (including reasonable attorney's fees and costs of defense) for injury or economic loss arising or allegedly arising out of the professional services provided under this Agreement, excepting only those damages, liabilities, or costs attributable to the sole negligence or willful misconduct of the Design Professional.

1-All construction shall comply with Florida Building Code 7th edition 2020.



- ULTIMATE WIND SPEED: 130
NOMINAL WIND SPEED: 101
WIND EXPOSURE CATEGORY: B
RISK CATEGORY 1 NON HABITABLE
INTERNAL PRESSURE COEFFICIENT Gcpi= +/- 0.0
DESIGN PRESSURE PER FBC CHAPTER 16, INCLUDING ASCE 7-16 LOAD CALCULATIONS
ROOF LIVE LOAD =12.5 PSF
ROOF DEAD LOAD = 2.5 PSF
MIN SOIL BEARING 2500 PSF
TRUSS BEARING LOAD EACH END 3600LB
TRUSS UPLIFT @ POST 2400LBS
1. Wood framing and fasteners to meet NDS-2018 requirements.
2. Fastener requirements: (1) All nails are Common galvanized; (2) all bolts are to be galvanized steel and include nuts and washers; and (3) all other hardware (Simpson, etc.) is to be installed according to manufacturer's specifications and recommendations. Nailing (size and number) shall satisfy Tables 2306.2.(1), 2306.3.(1) and 2306.3.(#) FBC unless otherwise indicated. Note: fasteners exposed to the weather are to be treated for weather resistance and compatible with the type of pressure treated wood used (connectors, nails, bolts, nuts and washers).
- Concrete Construction Notes

1. Concrete work shall conform to "Building Code Requirements for Reinforced Concrete" (ACI-318) and "Specifications for Structural Concrete" (ACI-301), Latest Edition.
2. Concrete mix shall conform to the following specifications. All concrete mixes shall conform to ASTM C-260. water-reducing admixture conforming to ASTM C-494. Air-entraining admixture shall conform to ASTM C-260.

CONCRETE MIX A

Ultimate Compressive Strength @ 28 days 3,000 PSI
Slump Range 4" +/- 1"
Maximum Aggregate Size 1"
Entrained Air None
Dry Weight per Cubic Foot 150 #




3. Shotcrete mix
4. All concrete shall be cured for a minimum of 28 days. If forms for vertical surfaces are removed prior to the end of the curing period, spray surfaces with liquid membrane curing compound.
5. Reinforcing steel shall conform to ASTM A615, Grade 40 (Fy=40 ksi). Lap continuous bars for tension lap splice per ACI-318, unless otherwise noted. Provide corner bars of same size and spacing as horizontal wall reinforcement. Cover for concrete reinforcing steel shall be in accordance with ACI-318, Paragraph 7.7.
6. Welded wire fabric (WWF) shall conform to ASTM A185. Lap sheets two mesh spaces and wire tie adjacent sheets together securely. Cut alternate reinforcement at control joints.
7. All slabs on grade shall have construction or control joints not to exceed 10'-0" spacing, unless otherwise noted.
8. Electrical conduit and other pipes to be embedded in structural concrete floor slabs or walls shall be placed in accordance with the requirements of ACI-318, Paragraph 6.3.

40' x 60' POLE STORAGE STRUCTURE


12-10-21
Michael E Driscoll PE
FL Reg # 43922

SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

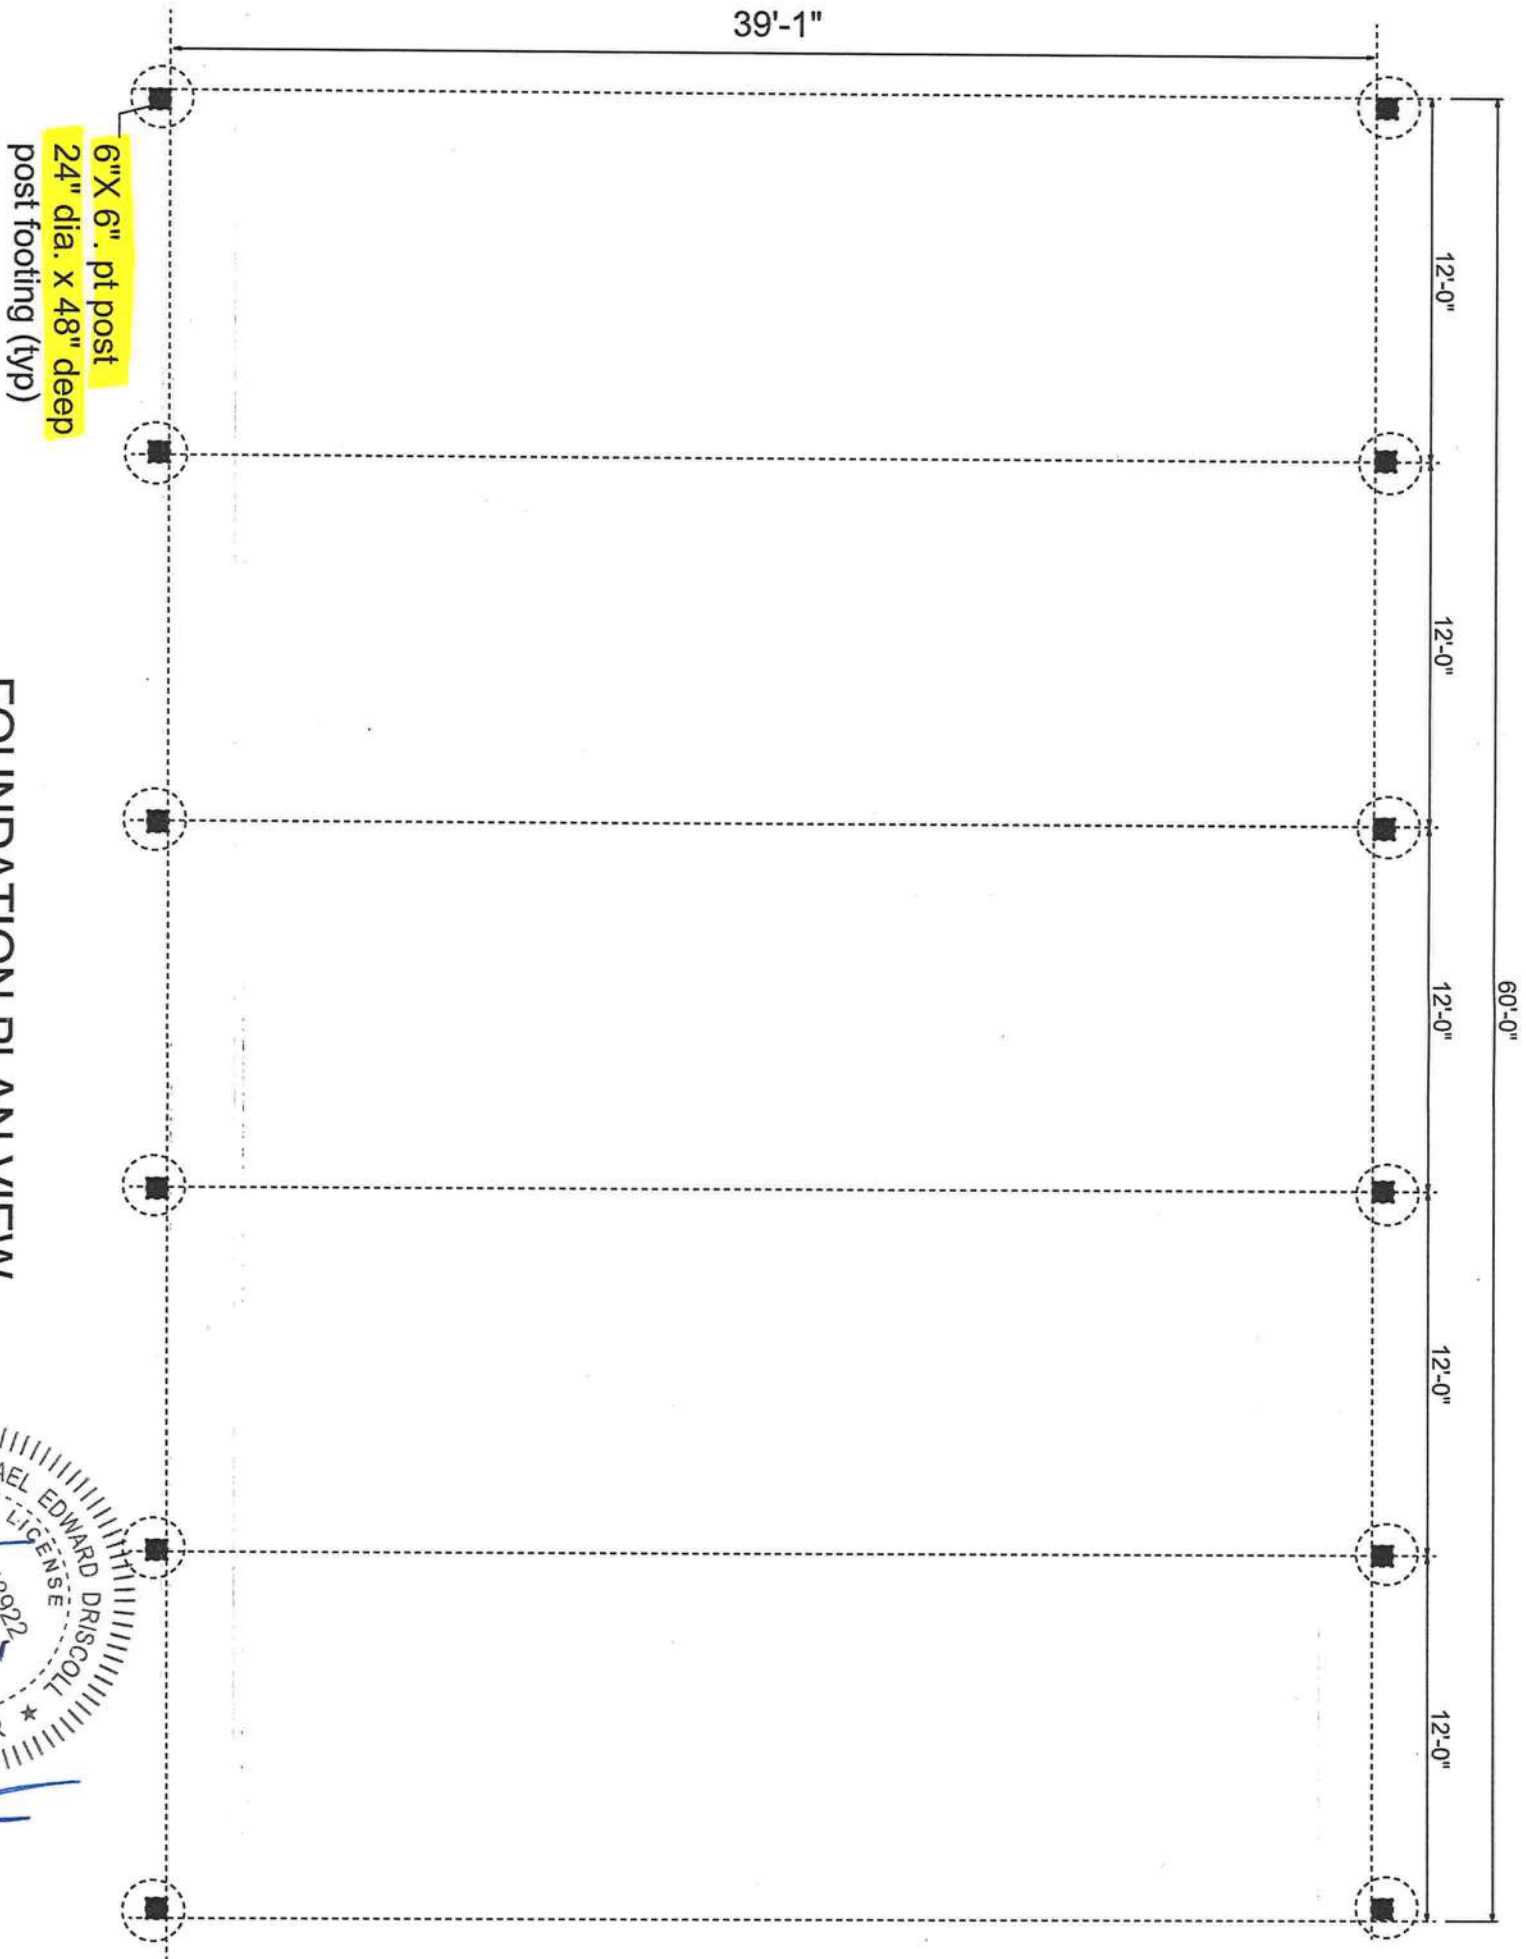

FOUNDATION PLAN VIEW

3/16" = 1'-0"

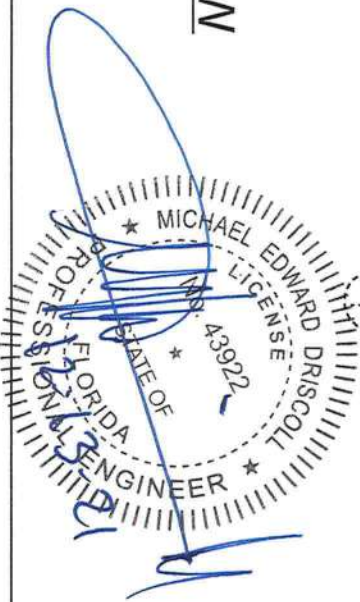

12-10-21
Michael E Driscoll PE
FL Reg # 43922




DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS
PO BOX 367577
GAINESVILLE, FL 32606
PH (352) 331-1913
FX (352) 505-3366
CA 8690

SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

SHEET:


2

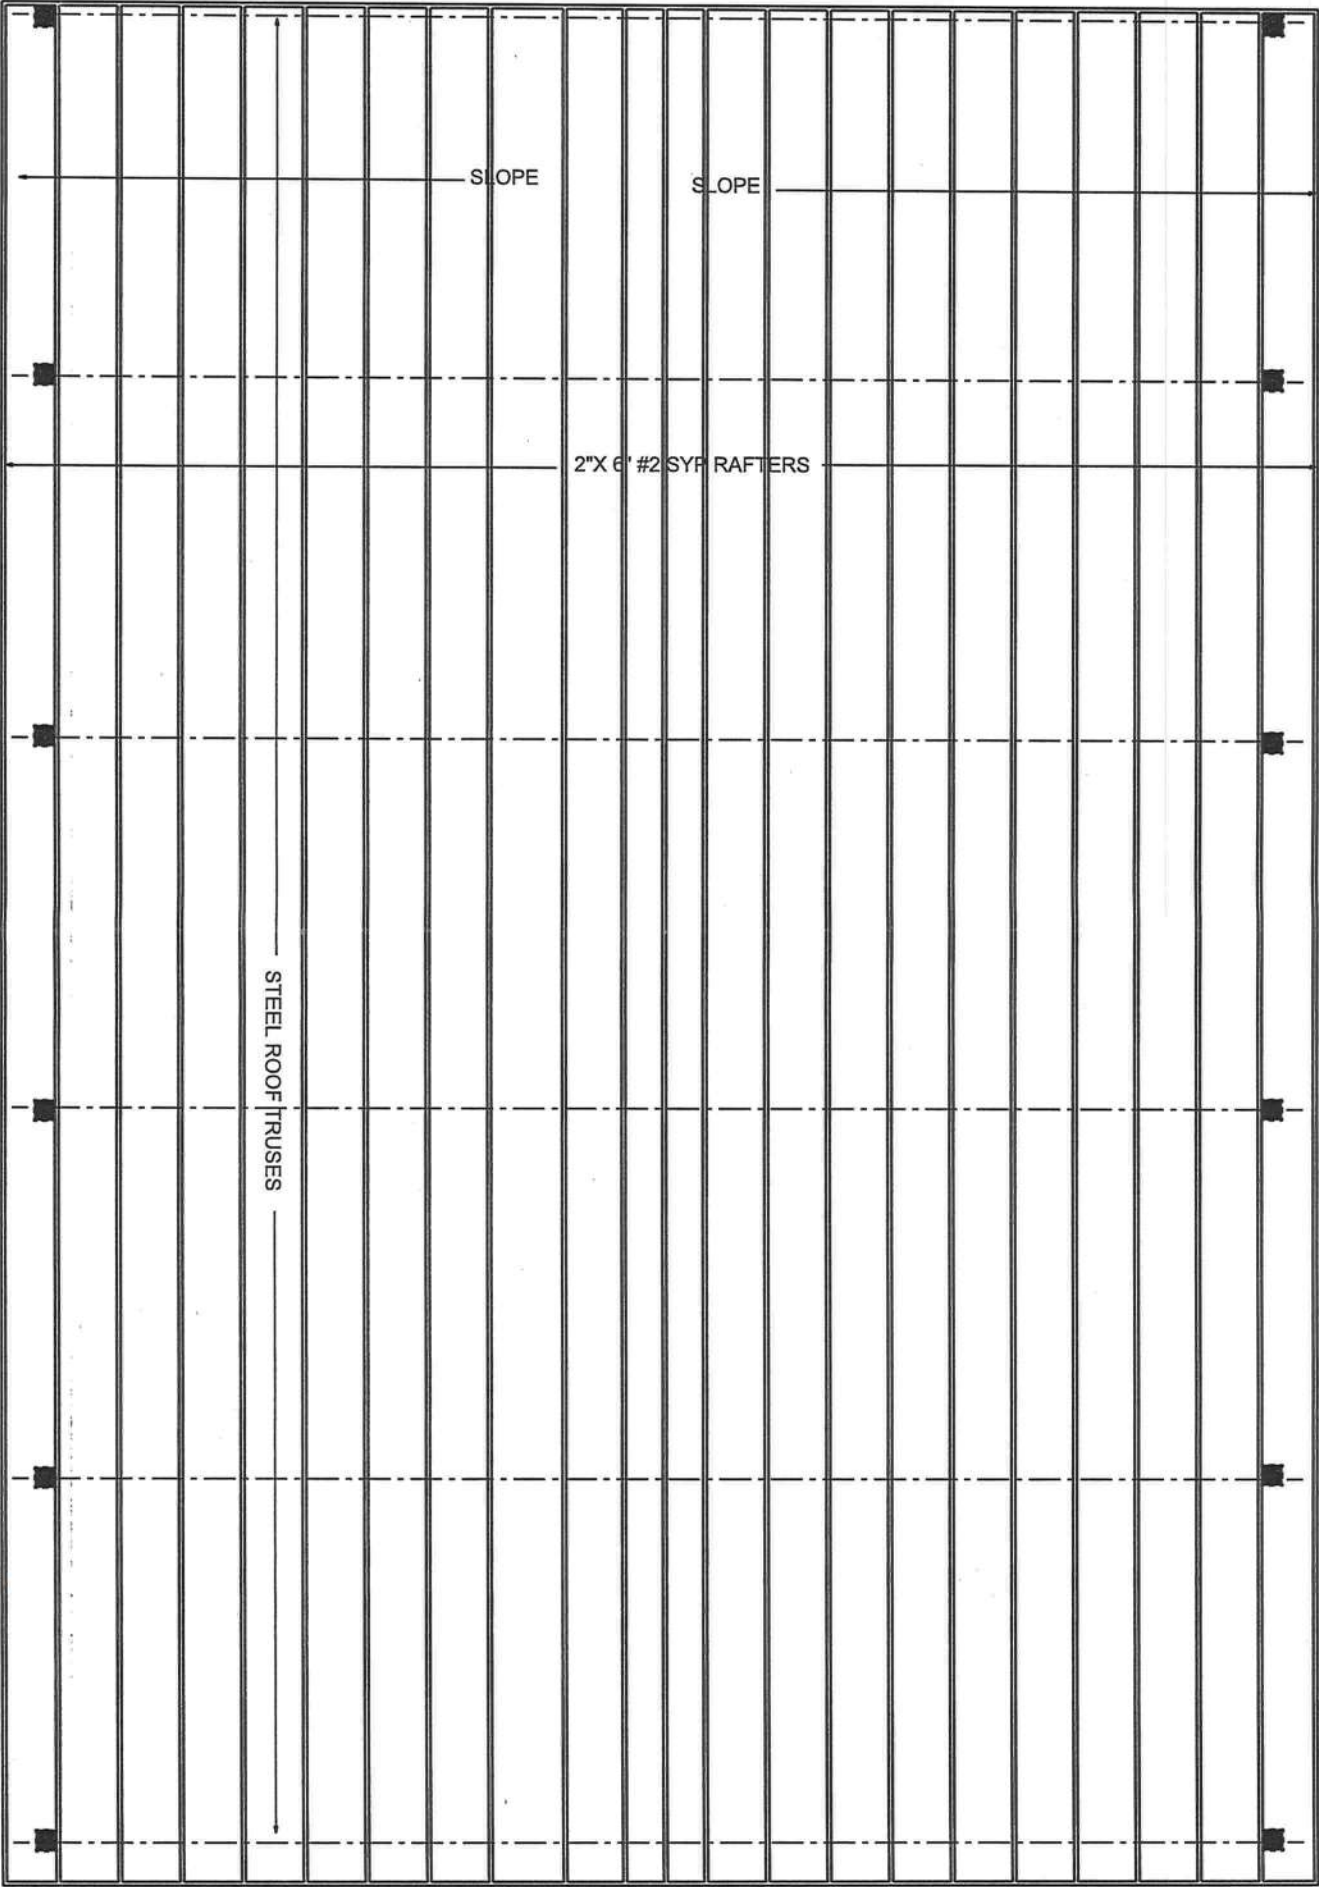

6"X 6" . pt post
24" dia. x 48" deep
post footing (typ)

ROOF PLAN VIEW


3/16" = 1'-0"

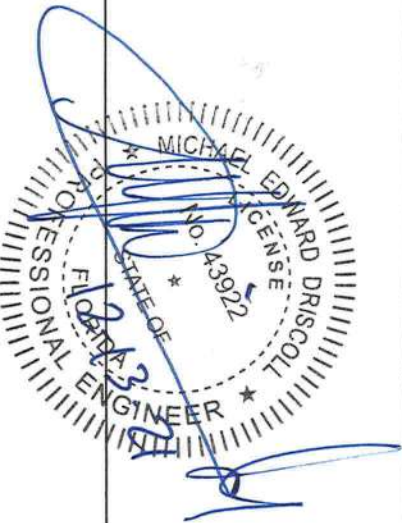


12-10-21
Michael E Driscoll PE
FL Reg # 43922




SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

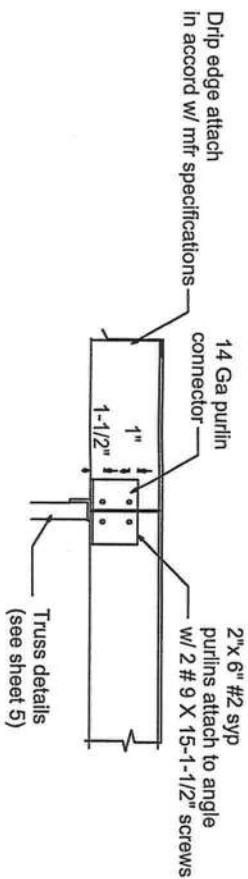


PURLIN CONNECTION DETAIL

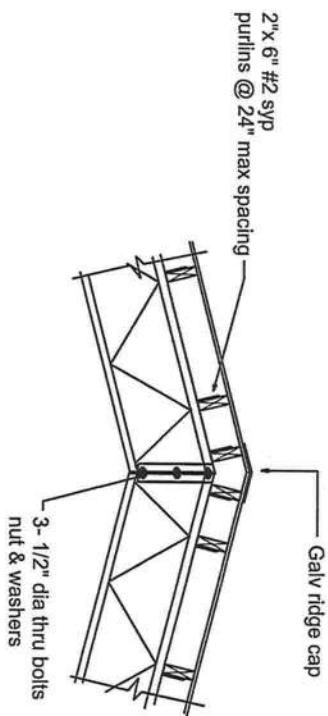


RIDGE CONNECTION DETAIL

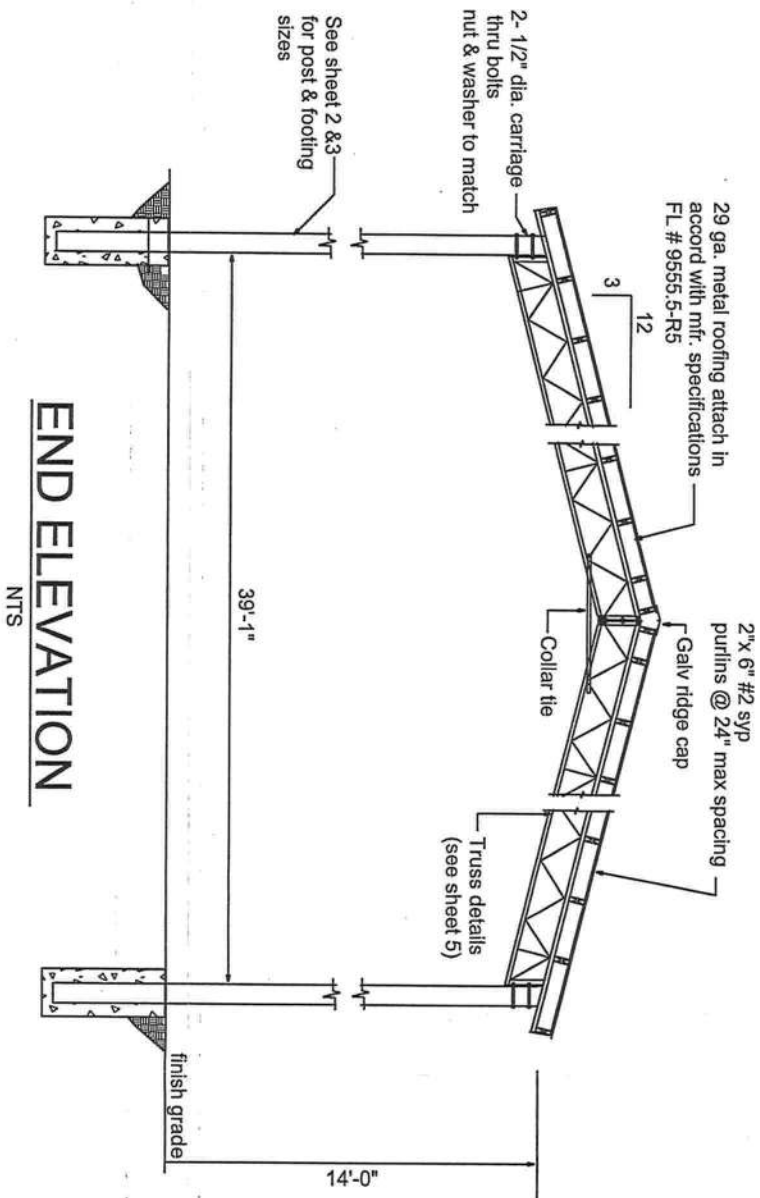


END ELEVATION

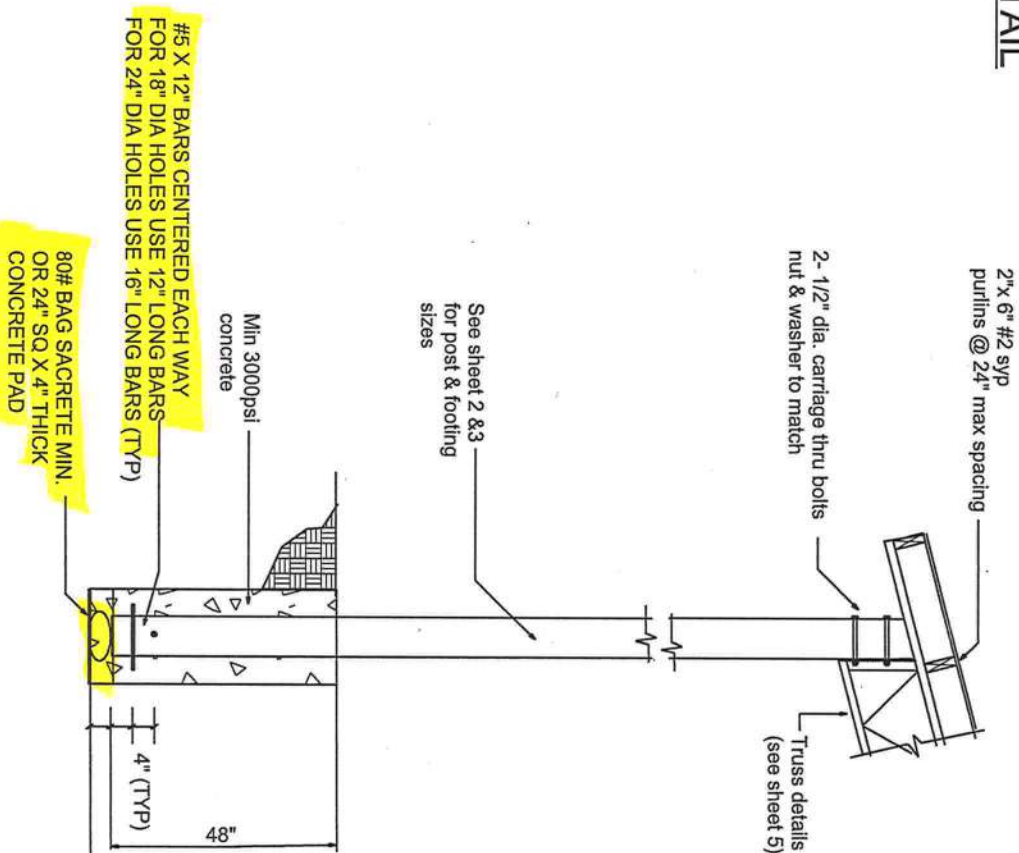

POST FOOTING TO TRUSS DETAIL

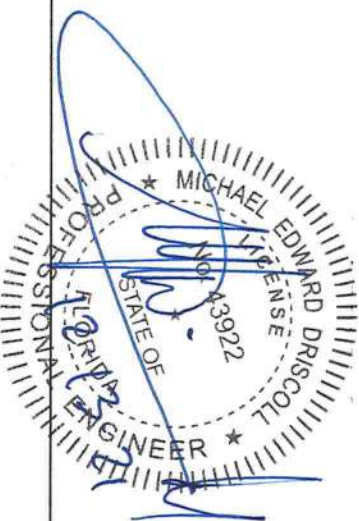

12-10-21
Michael E Driscoll PE
FL Reg # 43922

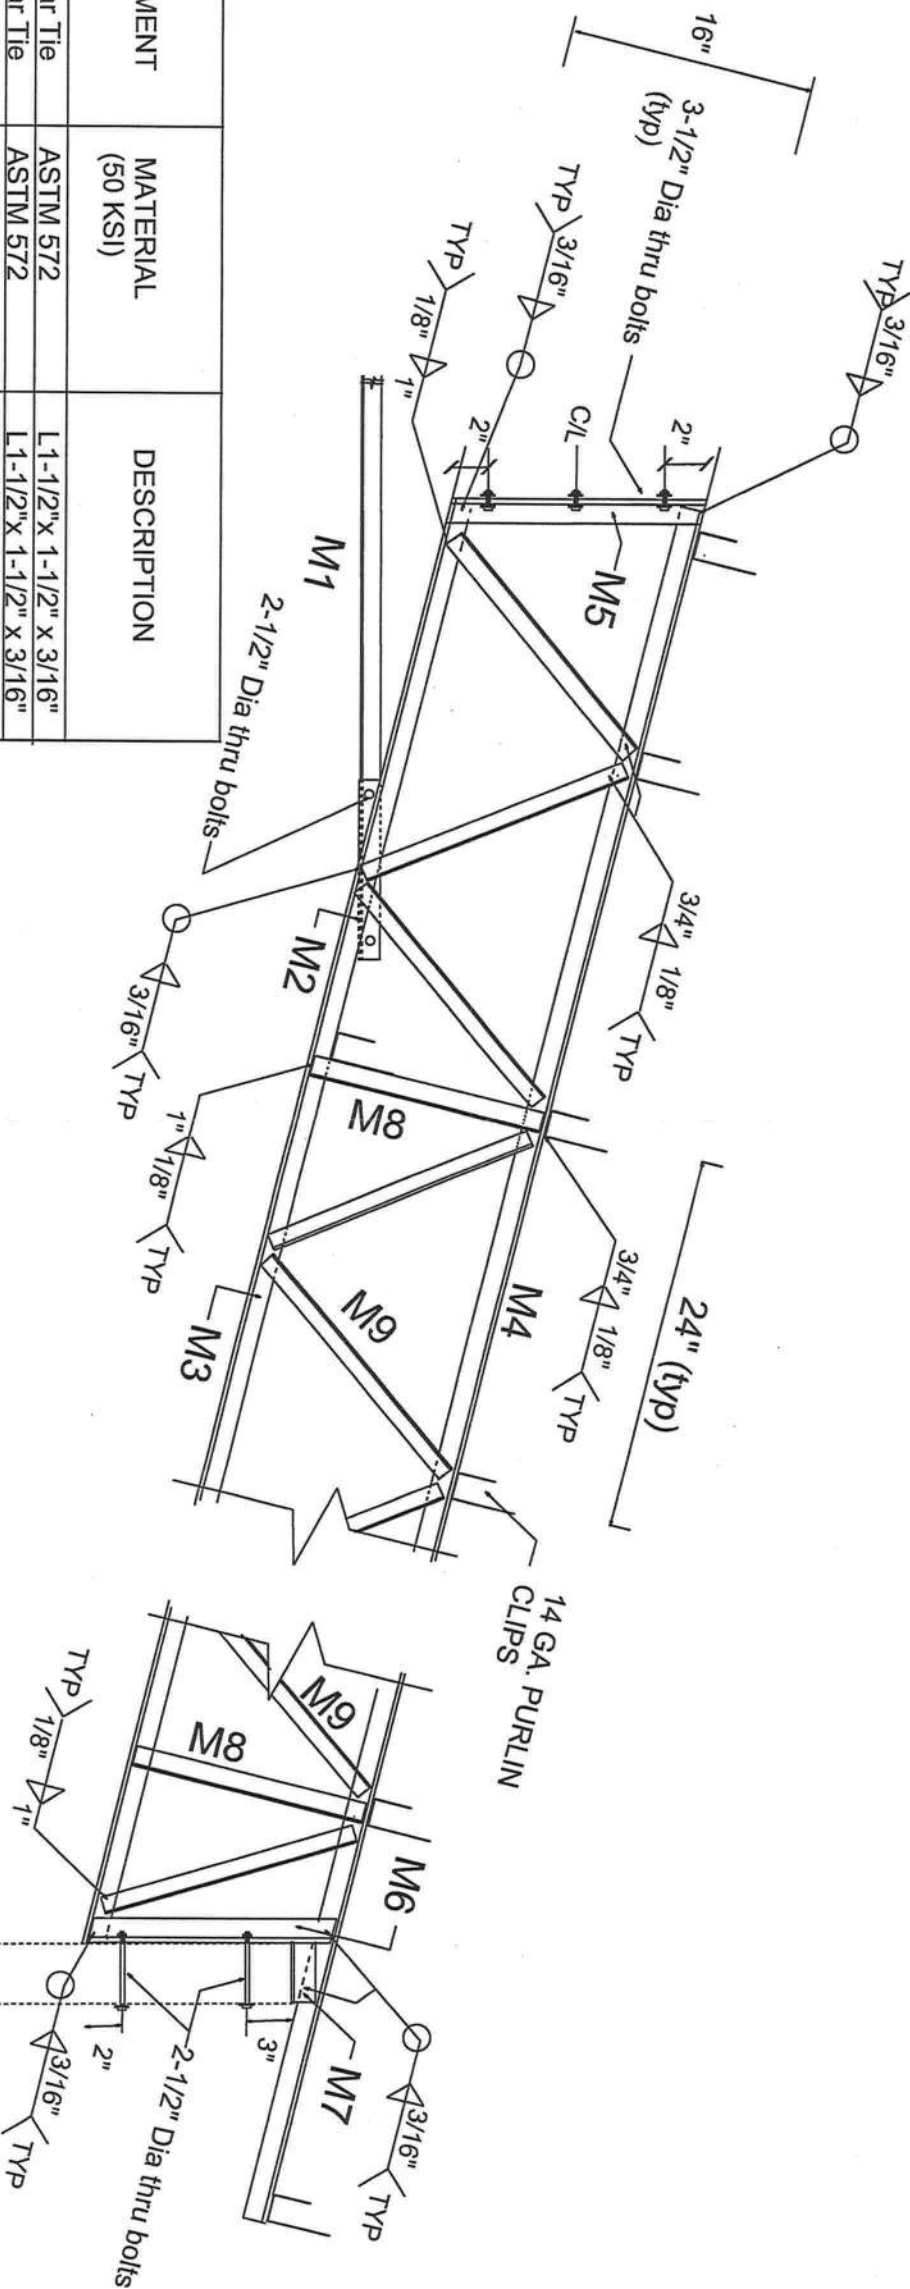


No.	ELEMENT	MATERIAL (50 KSI)	DESCRIPTION
M1	Collar Tie	ASTM 572	L1-1/2"x 1-1/2" x 3/16"
M2	Collar Tie	ASTM 572	L1-1/2"x 1-1/2" x 3/16"
M3	Top Chord	ASTM 572	L1-1/2"x 1-1/2" x 3/16"
M4	Bottom Chord	ASTM 572	L1-1/2"x 1-1/2" x 3/16"
M5	Center vertical	ASTM 572	L1-1/2" x 1-1/2" x 3/16"
M6	End Vertical	ASTM 572	L 3" x 2" x 3/8"
M7	Bearing angle	ASTM 572	L 3" x 2" x 3/8"
M8	Inside vertical	ASTM 572	L1-1/4" x 1-1/4" x 1/8"
M9	Diagonal web	ASTM 572	L1-1/4" x 1-1/4" x 1/8"

STEEL TRUSS CROSS SECTION

NOTES:

- 1-MATERIALS SHALL CONFORM TO STEEL ASTM 572.
- 2-ALL STEEL SHALL BE 50ksi IN ACCORD WITH CURRENT AISC MANUAL.
- 3- WELDING ELECTRODES TYPE E70XX
- 4- ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWS REQUIREMENTS.
- 5-ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
- 6-BOLTS SHALL BE ASTM A325, w/ NUTS & WASHERS. (TYP)
- 7- WELD STRENGTH 70 KSI MIN.
- 8- ALL POSTS SHALL BE #2 DENSE PRESSURE TREATED GROUND CONTACT.
- 9- PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
- 10- MIN EDGE DISTANCE FOR BOLT HOLES SHALL BE 3/4" MIN
- 11-MAX TRUSS SPACING SHALL NOT EXCEED 12'-0" UNO.
- 12-THE DESIGNER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBILITY OR EXERCISES NO CONTROL WITH REGARD TO FABRICATION, HANDLING, AND INSTALLATION OF TRUSSES.

2- 1/2" DIA. CARRIAGE BOLTS NUT & WASHERS (TYP)

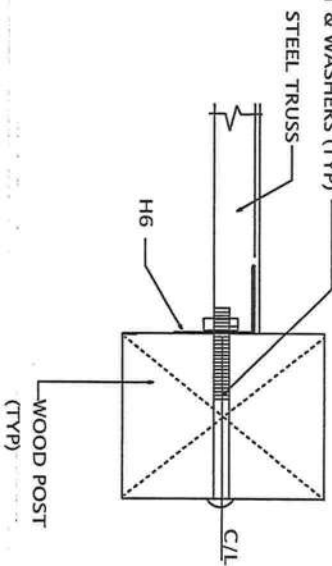


TRUSS TO POST DETAIL
PLAN VIEW

CONNECTOR SCHEDULE

2"x 6" #2 syp purlin to 6"x 6" x 14 ga. clip. 2-#9 x 1-1/2" screws
Truss to truss @ ridge 3-1/2" dia thru bolts nut & washers
Wood post to truss 2-1/2" dia thru bolts nut & washers
Post to concrete 24" dia x 48" deep w/ 2 #3 bars thru post

Wood post not shown for clarity

TRUSS DETAILS

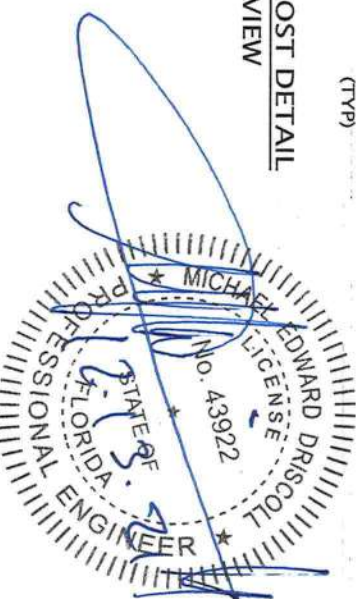


12-10-21
Michael E Driscoll PE
FL Reg # 43922



DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS
PO BOX 357577 GAINESVILLE, FL. 32606
PH (352) 331-1513
FX. (352) 505-3366
CA 8690

SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

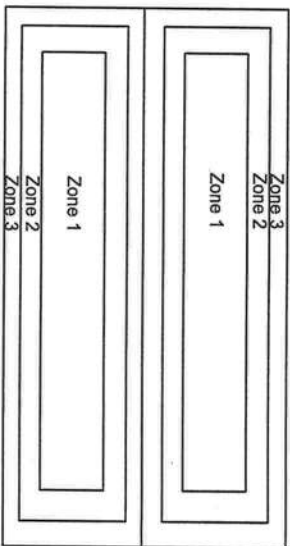

Zone 1 +/- 19.47
Zone 2 +/- 29.96
Zone 3 +/- 41.63

WIND PRESSURE ON COMPONENTS AND CLADDING

PROFESSIONAL SERVICES BY
DRISCOLL ENGINEERING, INC.
PO BOX 357577
GAINESVILLE, FL 32635
PH (352) 331-1513
CA 8890

PLANS AND SPECIFICATIONS

The plans and specifications presented herein are applicable only for the anticipated construction at the locations shown. If construction plans change, the Design Professional should be notified so the plans and specifications can be re-evaluated. The Design Professional should be given the opportunity to review final plans and specifications to see if the intent of the plans and specifications has been followed and/or if supplemental details and recommendations are needed. The Design Professional warrants that the plans and specifications contained herein, have been prepared in accordance with generally accepted professional engineering practice. No other warranties are implied or expressed.

CORPORATE PROTECTION

It is understood and agreed that the Design Professional's Basic Services under this Agreement do not include project observation or review of the Contractor's performance or any other construction phase services, and that such services will be provided by the Client. The Client assumes all responsibility for interpretation of the contractor Documents and for construction observation and supervision and waives any claims against the Design Professional that may be in any way connected thereto.

In addition, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any loss, claim or cost, including reasonable attorney's fees and costs of defense, arising or resulting from the performance of such services by other person or entities and from any and all claims arising from modifications, clarifications, interpretations, adjustments or changes made to Contract Documents to reflect changed field or other conditions, except for claims arising from the sole negligence or willful misconduct to the Design Professional.

OWNERSHIP OF INSTRUMENTS OF SERVICE

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Design Professional as instruments of service shall remain the property of the Design Professional. The Design Professional shall retain all common law, statutory and other reserved rights, including the copyright thereto.


DEFECTS IN SERVICE

The Client shall promptly report to the Design Professional any defects or suspected defects in the Design Professional's work or services of which the Client becomes aware, so that the Design Professional may take measures to minimize the consequences of such a defect. The Client warrants that he or she will impose a similar notification requirement on all contractors in his or her Client/Contractor contract and shall require all subcontractors at any level to contain a like requirement. Failure by the Client, and the Client's contractors or subcontractors to notify the Design Professional, shall relieve the Design Professional of the costs of remedying the defects above the sum such remedy would have cost had prompt notification been given.

VERIFICATION OF EXISTING CONDITIONS

Inasmuch as the remodeling and/or rehabilitation of an existing building requires that certain assumptions be made regarding existing conditions, and because some of these assumptions may not be verifiable without expending additional sums of money or destroying otherwise adequate or serviceable portions of the building, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any claim, liability or cost (including reasonable attorney's fees and costs of defense) for injury or economic loss arising or allegedly arising out of the professional services provided under this Agreement, excepting only those damages, liabilities, or costs attributable to the sole negligence or willful misconduct of the Design Professional.

1-All construction shall comply with Florida Building Code 7th edition 2020.



DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS
PO BOX 357577
GAINESVILLE, FL 32635
PH (352) 331-1513
FX (352) 505-3368

- ULTIMATE WIND SPEED: 130
NOMINAL WIND SPEED: 101
WIND EXPOSURE CATEGORY: B
RISK CATEGORY 1 NON HABITABLE
INTERNAL PRESSURE COEFFICIENT Gcpi = +/- 0.0
DESIGN PRESSURE PER FBC CHAPTER 16, INCLUDING ASCE 7-16 LOAD CALCULATIONS
ROOF LIVE LOAD =12.5 PSF
ROOF DEAD LOAD = 2.5 PSF
MIN SOIL BEARING 2500 PSF
TRUSS BEARING LOAD EACH END 3600LB
TRUSS UPLIFT @ POST 2400LBS

1. Wood framing and fasteners to meet NDS-2018 requirements.
2. Fastener requirements: (1) All nails are Common galvanized; (2) all bolts are to be galvanized steel and include nuts and washers; and (3) all other hardware (Simpson, etc.) is to be installed according to manufacturer's specifications and recommendations. Nailing (size and number) shall satisfy Tables 2306.2.(1), 2306.3.(1) and 2306.3.(#) FBC unless otherwise indicated. Note: fasteners exposed to the weather are to be treated for weather resistance and compatible with the type of pressure treated wood used (connectors, nails, bolts, nuts and washers).


Concrete Construction Notes

1. Concrete work shall conform to "Building Code Requirements for Reinforced Concrete" (ACI-318) and "Specifications for Structural Concrete" (ACI-301), Latest Edition.
2. Concrete mix shall conform to the following specifications. All concrete mixes shall contain a water-reducing admixture conforming to ASTM C-494. Air-entraining admixture shall conform to ASTM C-260.

CONCRETE MIX A

Ultimate Compressive Strength @ 28 days
Slump Range
Maximum Aggregate Size
Entrained Air
Dry Weight per Cubic Foot

3,000 PSI
4" +/- 1"
1"
None
150 #

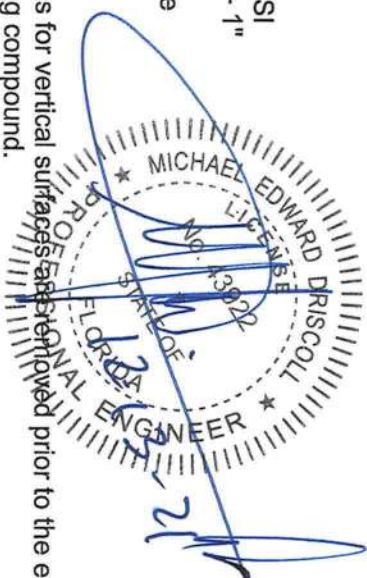


3. Shotcrete mix
4. All concrete shall be cured for a minimum of 28 days. If forms for vertical surfaces are removed prior to the end of the curing period, spray surfaces with liquid membrane curing compound.
5. Reinforcing steel shall conform to ASTM A615, Grade 40 (Fy=40 ksi). Lap continuous bars for tension lap splice per ACI-318, unless otherwise noted. Provide corner bars of same size and spacing as horizontal wall reinforcement. Cover for concrete reinforcing steel shall be in accordance with ACI-318, Paragraph 7.7.
6. Welded wire fabric (WWF) shall conform to ASTM A185. Lap sheets two mesh spaces and wire tie adjacent sheets together securely. Cut alternate reinforcement at control joints.
7. All slabs on grade shall have construction or control joints not to exceed 10'-0" spacing, unless otherwise noted.
8. Electrical conduit and other pipes to be embedded in structural concrete floor slabs or walls shall be placed in accordance with the requirements of ACI-318, Paragraph 6.3.

40' x 60' POLE STORAGE STRUCTURE

12-10-21
Michael E Driscoll PE
FL Reg # 43922


SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

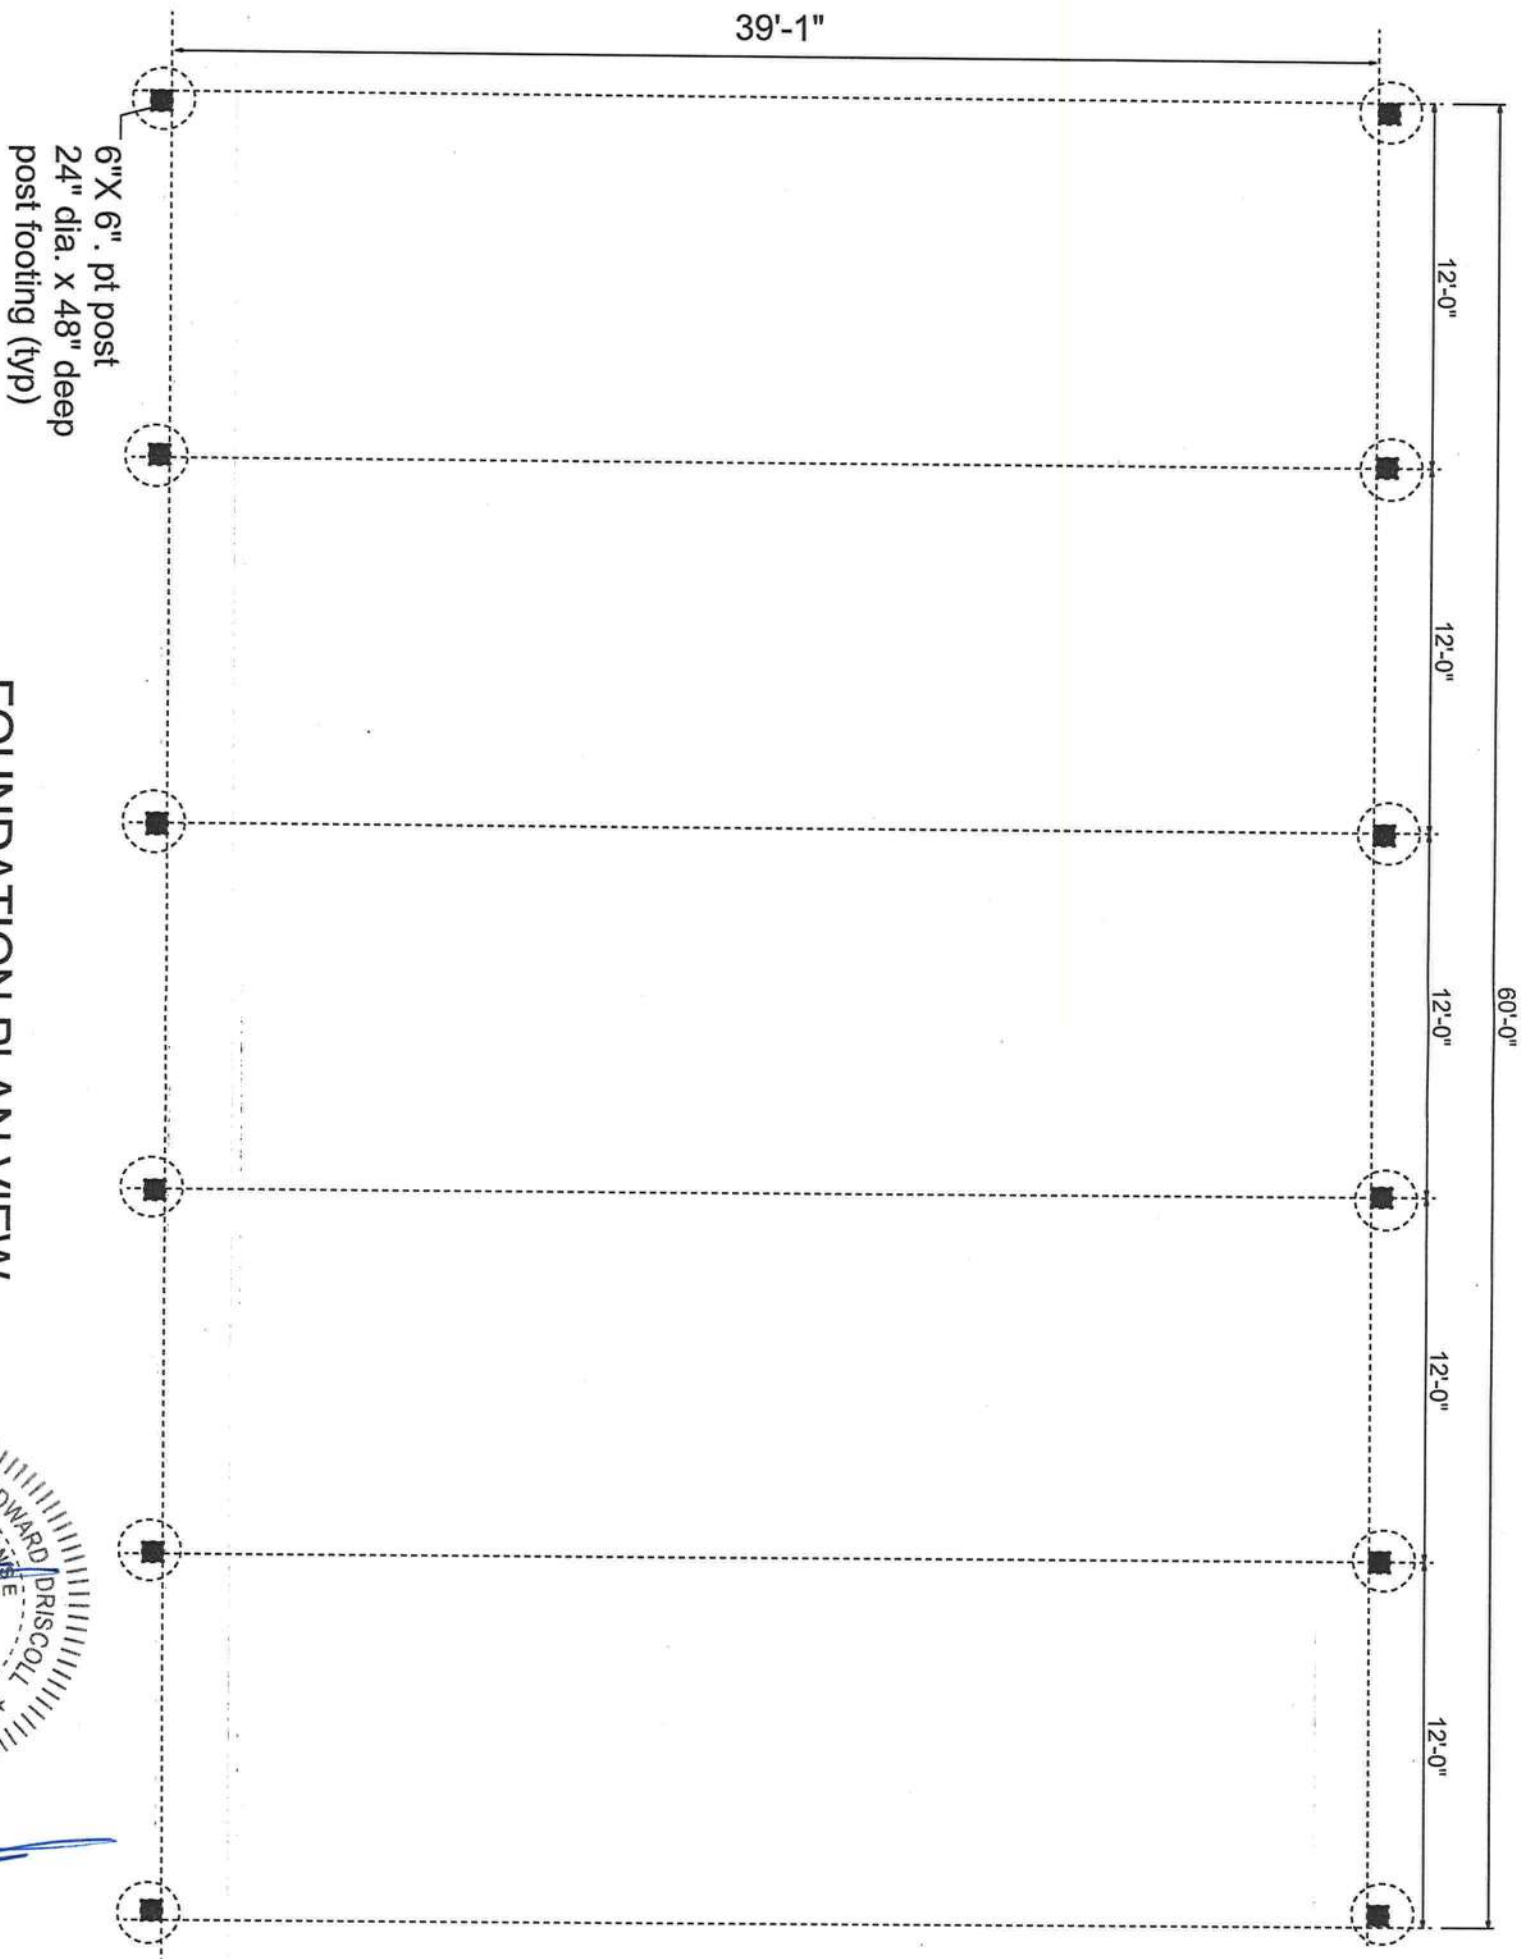

FOUNDATION PLAN VIEW

3/16" = 1'-0"

(Handwritten signature and date 12-10-21 over the professional seal)

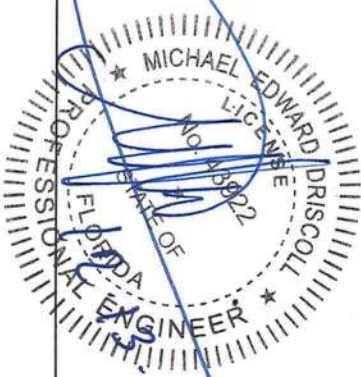

12-10-21
Michael E Driscoll PE
FL Reg # 43922





DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS
PO BOX 367577
GAINESVILLE, FL 32606

PH (352) 331-1513
FX (352) 595-3366

CA 8690

SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

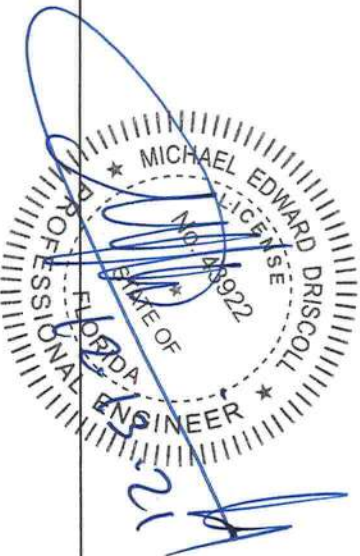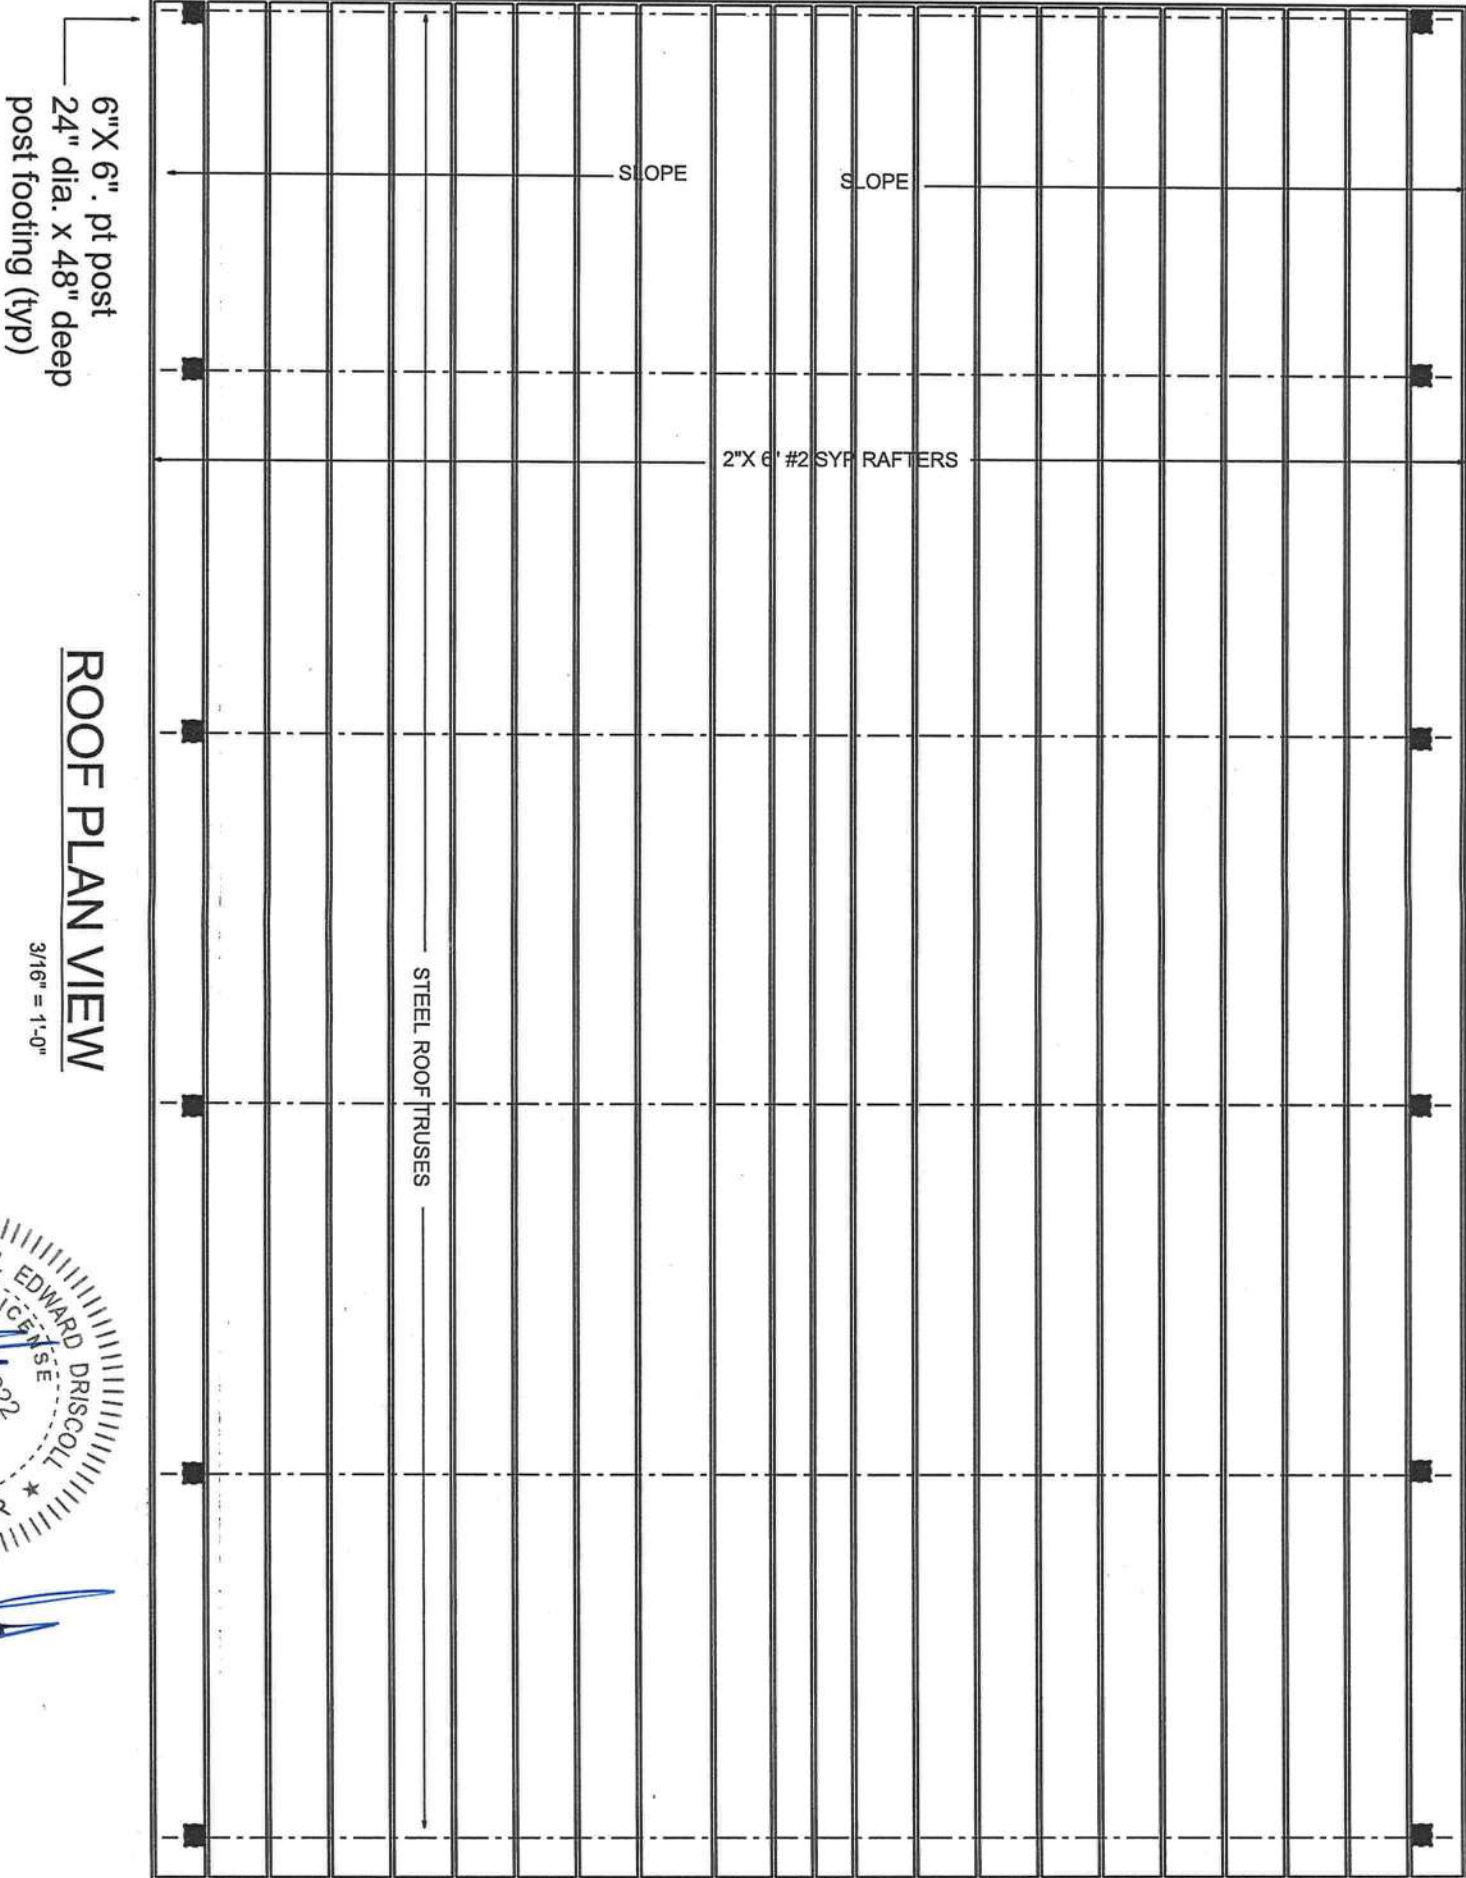

12-10-21
Michael E Driscoll PE
FL Reg # 43922




DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS

PO BOX 357577
GAINESVILLE, FL 32606


PH (352) 331-1513
FX (352) 505-3386

CA 0690


SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

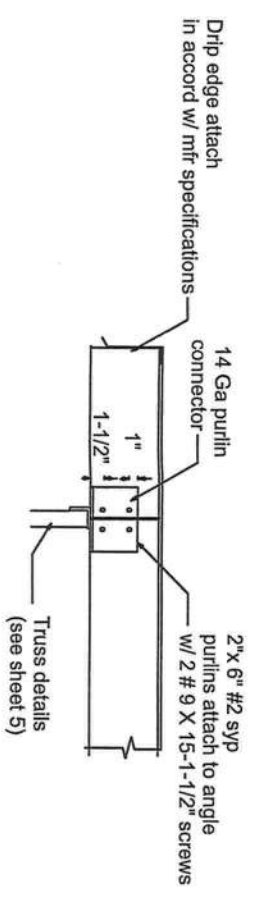


PURLIN CONNECTION DETAIL

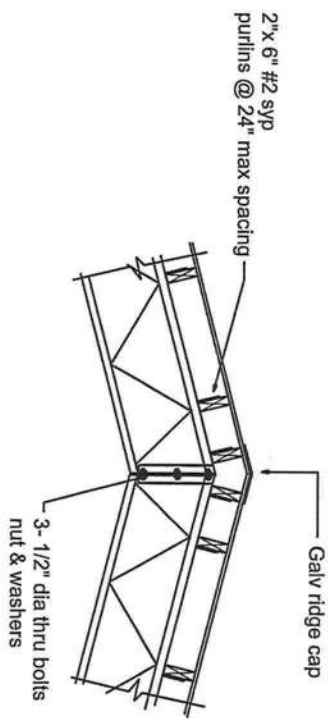

RIDGE CONNECTION DETAIL

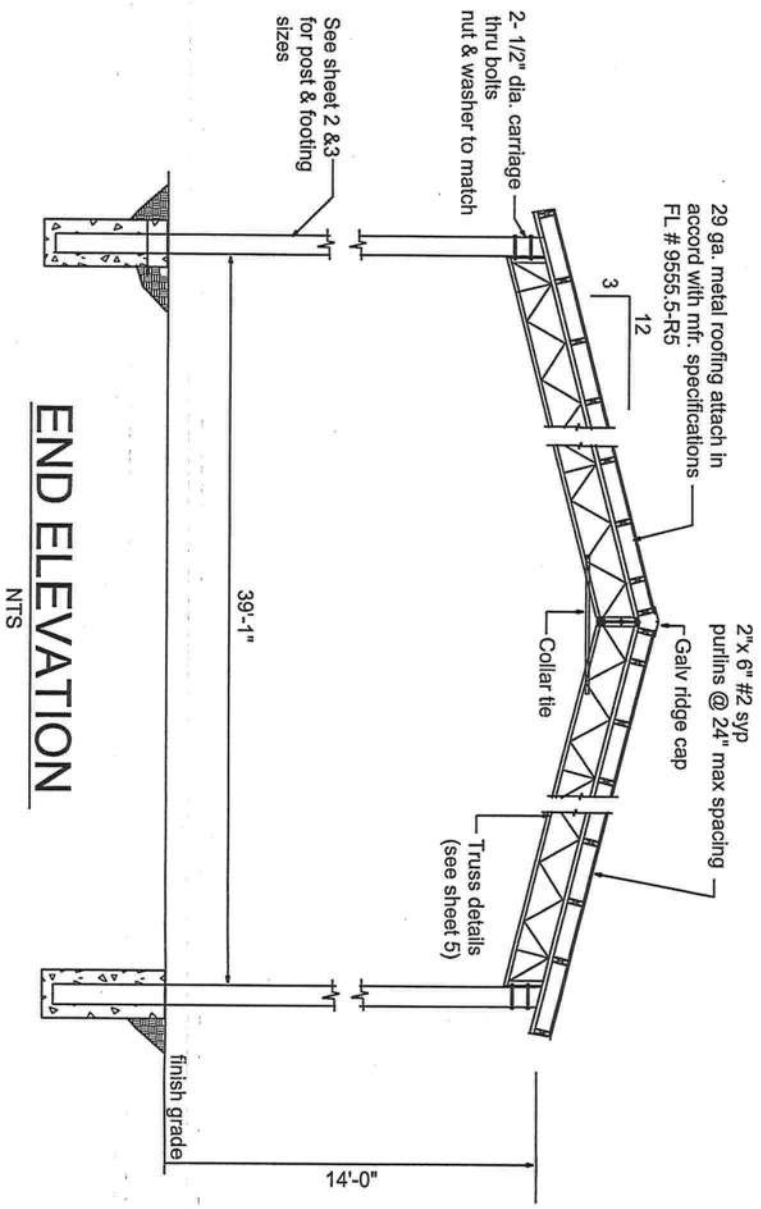


END ELEVATION
NTS

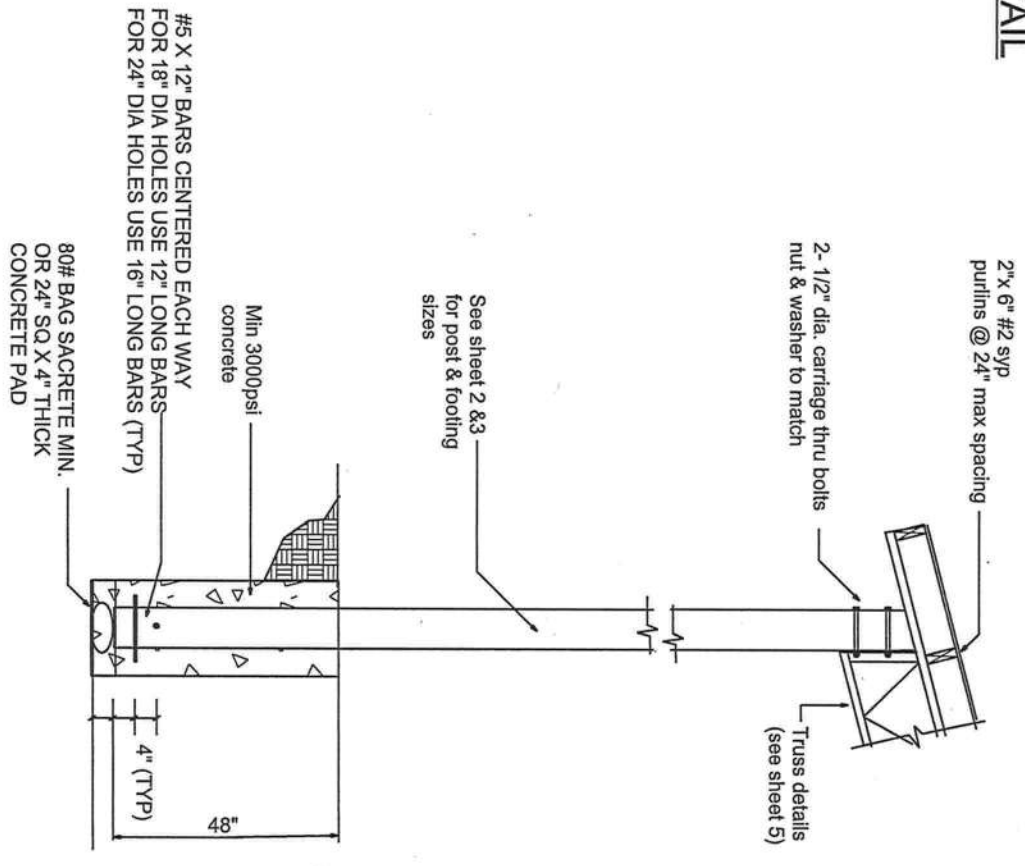

POST FOOTING TO TRUSS DETAIL



12-10-21
Michael E Driscoll PE
FL Reg # 43922

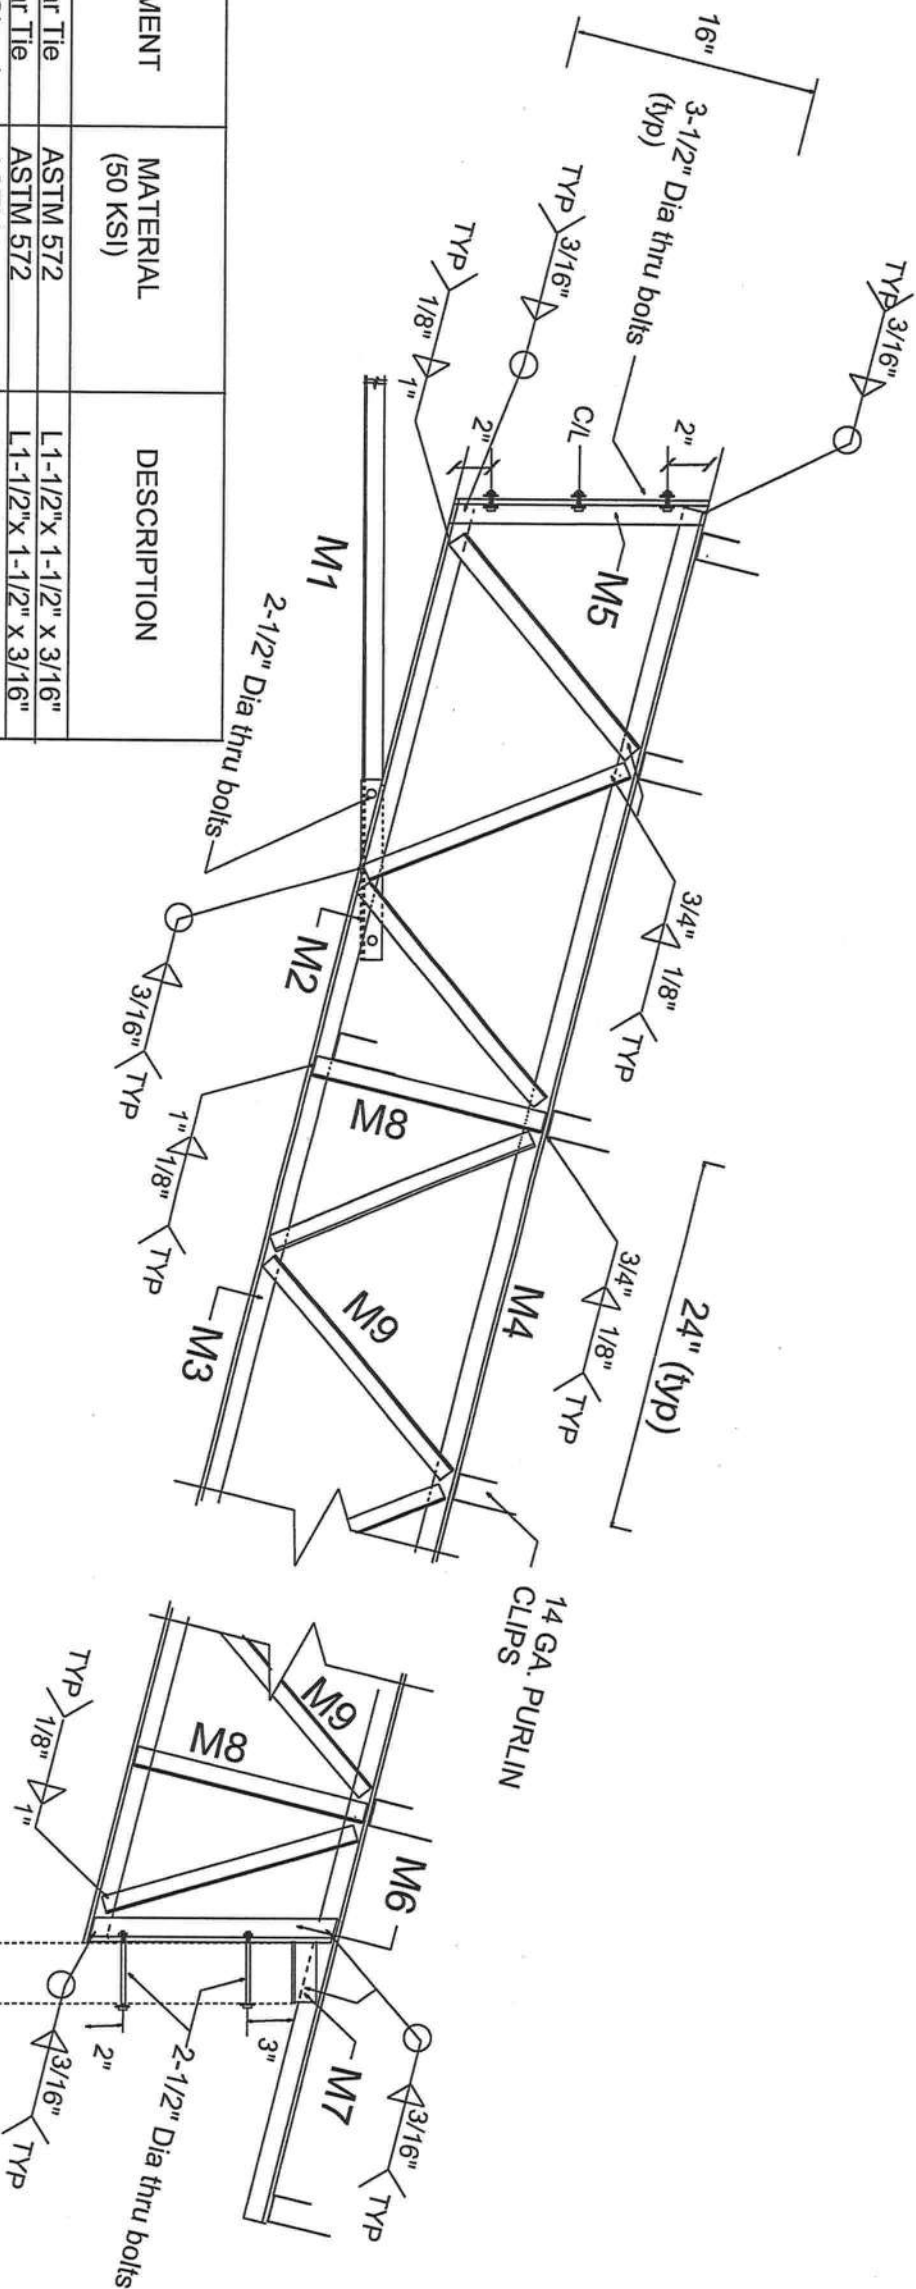


No.	ELEMENT	MATERIAL (50 KSI)	DESCRIPTION
M1	Collar Tie	ASTM 572	L 1-1/2"x 1-1/2" x 3/16"
M2	Collar Tie	ASTM 572	L 1-1/2"x 1-1/2" x 3/16"
M3	Top Chord	ASTM 572	L 1-1/2"x 1-1/2" x 3/16"
M4	Bottom Chord	ASTM 572	L 1-1/2"x 1-1/2" x 3/16"
M5	Center Vertical	ASTM 572	L 1-1/2" x 1-1/2" x 3/16"
M6	End Vertical	ASTM 572	L 3" x 2" x 3/8"
M7	Bearing angle	ASTM 572	L 3" x 2" x 3/8"
M8	Inside vertical	ASTM 572	L 1-1/4" x 1-1/4" x 1/8"
M9	Diagonal web	ASTM 572	L 1-1/4" x 1-1/4" x 1/8"

STEEL TRUSS CROSS SECTION

NOTES:

- 1-MATERIALS SHALL CONFORM TO STEEL ASTM 572.
- 2- ALL STEEL SHALL BE 50ksi IN ACCORD WITH CURRENT AISC MANUAL.
- 3- WELDING ELECTRODES TYPE E70XX
- 4- ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWS REQUIREMENTS.
- 5-ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
- 6-BOLTS SHALL BE ASTM A325. w/ NUTS & WASHERS. (TYP)
- 7- WELD STRENGTH 70 KSI MIN.
- 8- ALL POSTS SHALL BE #2 DENSE PRESSURE TREATED GROUND CONTACT.
- 9- PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
- 10- MIN EDGE DISTANCE FOR BOLT HOLES SHALL BE 3/4" MIN
- 11-MAX TRUSS SPACING SHALL NOT EXCEED 12'-0" UNO.
- 12-THE DESIGNER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBILITY OR EXERCISES NO CONTROL WITH REGARD TO FABRICATION, HANDLING, AND INSTALLATION OF TRUSSES.

2 - 1/2" DIA. CARRIAGE
BOLTS NUT & WASHERS (TYP)

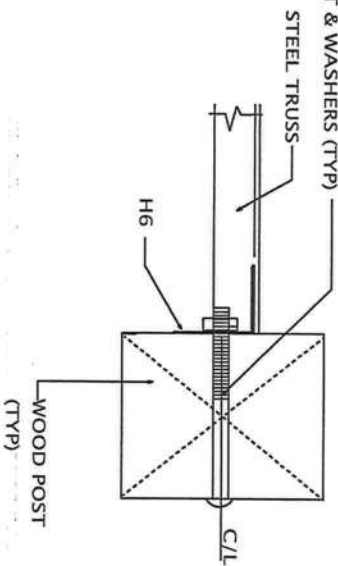


TRUSS TO POST DETAIL
PLAN VIEW

CONNECTOR SCHEDULE

2"x 6" #2 syp pultr to 6"x 6" x 14 ga. clip. 2-#9 x 1-1/2" screws
Truss to truss @ ridge 3-1/2" dia thru bolts & nut
Wood post to truss 2-1/2" dia thru bolts nut & washers
Post to concrete 24" dia x 48" deep w/ 2 #5 bars thru post

Wood post
not shown
for clarity

TRUSS DETAILS

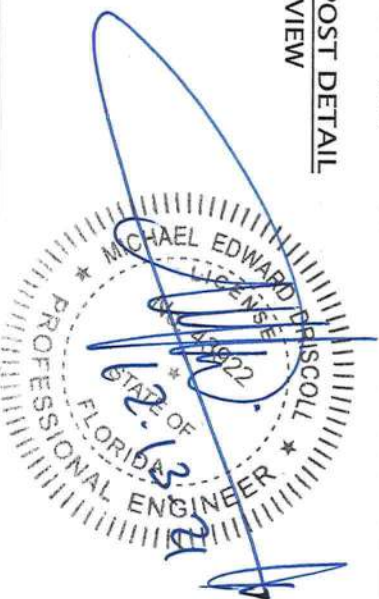


12-10-21
Michael E Driscoll PE
FL Reg # 43922



DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS
PO BOX 357577 GAINESVILLE, FL 32606
PH (352) 331-1513
FX. (352) 505-3366
CA 8690

SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

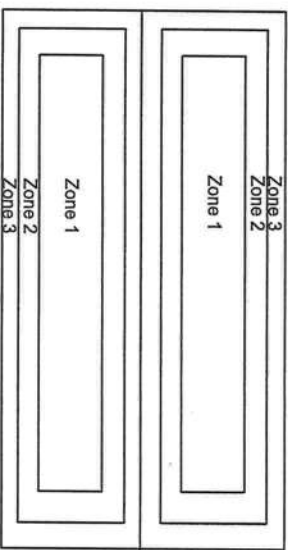

Zone 1 +/- 19.47
Zone 2 +/- 29.96
Zone 3 +/- 41.63

WIND PRESSURE ON COMPONENTS AND CLADDING

PROFESSIONAL SERVICES BY
DRISCOLL ENGINEERING, INC.
PO BOX 357577
GAINESVILLE, FL 32635
PH (352) 331-1513
CA 8890

PLANS AND SPECIFICATIONS

The plans and specifications presented herein are applicable only for the anticipated construction at the locations shown. If construction plans change, the Design Professional should be notified so the plans and specifications can be re-evaluated. The Design Professional should be given the opportunity to review final plans and specifications to see if the intent of the plans and specifications has been followed and/or if supplemental details and recommendations are needed. The Design Professional warrants that the plans and specifications contained herein, have been prepared in accordance with generally accepted professional engineering practice. No other warranties are implied or expressed.

CORPORATE PROTECTION

It is understood and agreed that the Design Professional's Basic Services under this Agreement do not include project observation or review of the Contractor's performance or any other construction phase services, and that such services will be provided by the Client. The Client assumes all responsibility for interpretation of the contractor Documents and for construction observation and supervision and waives any claims against the Design Professional that may be in any way connected thereto.

In addition, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any loss, claim or cost, including reasonable attorney's fees and costs of defense, arising or resulting from the performance of such services by other person or entities and from any and all claims arising from modifications, clarifications, interpretations, adjustments or changes made to Contract Documents to reflect changed field or other conditions, except for claims arising from the sole negligence or willful misconduct to the Design Professional.

OWNERSHIP OF INSTRUMENTS OF SERVICE

All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Design Professional as instruments of service shall remain the property of the Design Professional. The Design Professional shall retain all common law, statutory and other reserved rights, including the copyright thereto.

DEFECTS IN SERVICE

The Client shall promptly report to the Design Professional any defects or suspected defects in the Design Professional's work or services of which the Client becomes aware, so that the Design Professional may take measures to minimize the consequences of such a defect. The Client warrants that he or she will impose a similar notification requirement on all contractors in his or her Client/Contractor contract and shall require all subcontractors at any level to contain a like requirement. Failure by the Client, and the Client's contractors or subcontractors to notify the Design Professional, shall relieve the Design Professional of the costs of remedying the defects above the sum such remedy would have cost had prompt notification been given.

VERIFICATION OF EXISTING CONDITIONS

Inasmuch as the remodeling and/or rehabilitation of an existing building requires that certain assumptions be made regarding existing conditions, and because some of these assumptions may not be verifiable without expending additional sums of money or destroying otherwise adequate or serviceable portions of the building, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any claim, liability or cost (including reasonable attorney's fees and costs of defense) for injury or economic loss arising or allegedly arising out of the professional services provided under this Agreement, excepting only those damages, liabilities, or costs attributable to the sole negligence or willful misconduct of the Design Professional.

1-All construction shall comply with Florida Building Code 7th edition 2020.



ULTIMATE WIND SPEED: 130
NOMINAL WIND SPEED: 101
WIND EXPOSURE CATEGORY: B
RISK CATEGORY 1 NON HABITABLE
INTERNAL PRESSURE COEFFICIENT Gcpi= +/- 0.0
DESIGN PRESSURE PER FBC CHAPTER 16, INCLUDING ASCE 7-16 LOAD CALCULATIONS
ROOF LIVE LOAD =12.5 PSF
ROOF DEAD LOAD = 2.5 PSF
MIN SOIL BEARING 2500 PSF
TRUSS BEARING LOAD EACH END 3600LB
TRUSS UPLIFT @ POST 2400LBS

1. Wood framing and fasteners to meet NDS-2018 requirements.
2. Fastener requirements: (1) All nails are Common galvanized; (2) all bolts are to be galvanized steel and include nuts and washers; and (3) all other hardware (Simpson, etc.) is to be installed according to manufacturer's specifications and recommendations. Nailing (size and number) shall satisfy Tables 2306.2.(1), 2306.3.(1) and 2306.3.(#) FBC unless otherwise indicated. Note: fasteners exposed to the weather are to be treated for weather resistance and compatible with the type of pressure treated wood used (connectors, nails, bolts, nuts and washers).

Concrete Construction Notes

1. Concrete work shall conform to "Building Code Requirements for Reinforced Concrete" (ACI-318) and "Specifications for Structural Concrete" (ACI-301), Latest Edition.
2. Concrete mix shall conform to the following specifications. All concrete mixes shall contain a water-reducing admixture conforming to ASTM C-494. Air-entraining admixture shall conform to ASTM C-260.

CONCRETE MIX A

Ultimate Compressive Strength @ 28 days 3,000 PSI
Slump Range 4" +/- 1"
Maximum Aggregate Size 1"
Entrained Air None
Dry Weight per Cubic Foot 150 #


3. Shotcrete mix
4. All concrete shall be cured for a minimum of 28 days. If forms for vertical surfaces are removed prior to the end of the curing period, spray surfaces with liquid membrane curing compound.

5. Reinforcing steel shall conform to ASTM A615, Grade 40 (Fy=40 ksi). Lap continuous bars for tension lap splice per ACI-318, unless otherwise noted. Provide corner bars of same size and spacing as horizontal wall reinforcement. Cover for concrete reinforcing steel shall be in accordance with ACI-318, Paragraph 7.7.
6. Welded wire fabric (WWF) shall conform to ASTM A185. Lap sheets two mesh spaces and wire tie adjacent sheets together securely. Cut alternate reinforcement at control joints.
7. All slabs on grade shall have construction or control joints not to exceed 10'-0" spacing, unless otherwise noted.
8. Electrical conduit and other pipes to be embedded in structural concrete floor slabs or walls shall be placed in accordance with the requirements of ACI-318, Paragraph 6.3.

40' x 60' POLE STORAGE STRUCTURE


12-10-21
Michael E Driscoll PE
FL Reg # 43922

SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

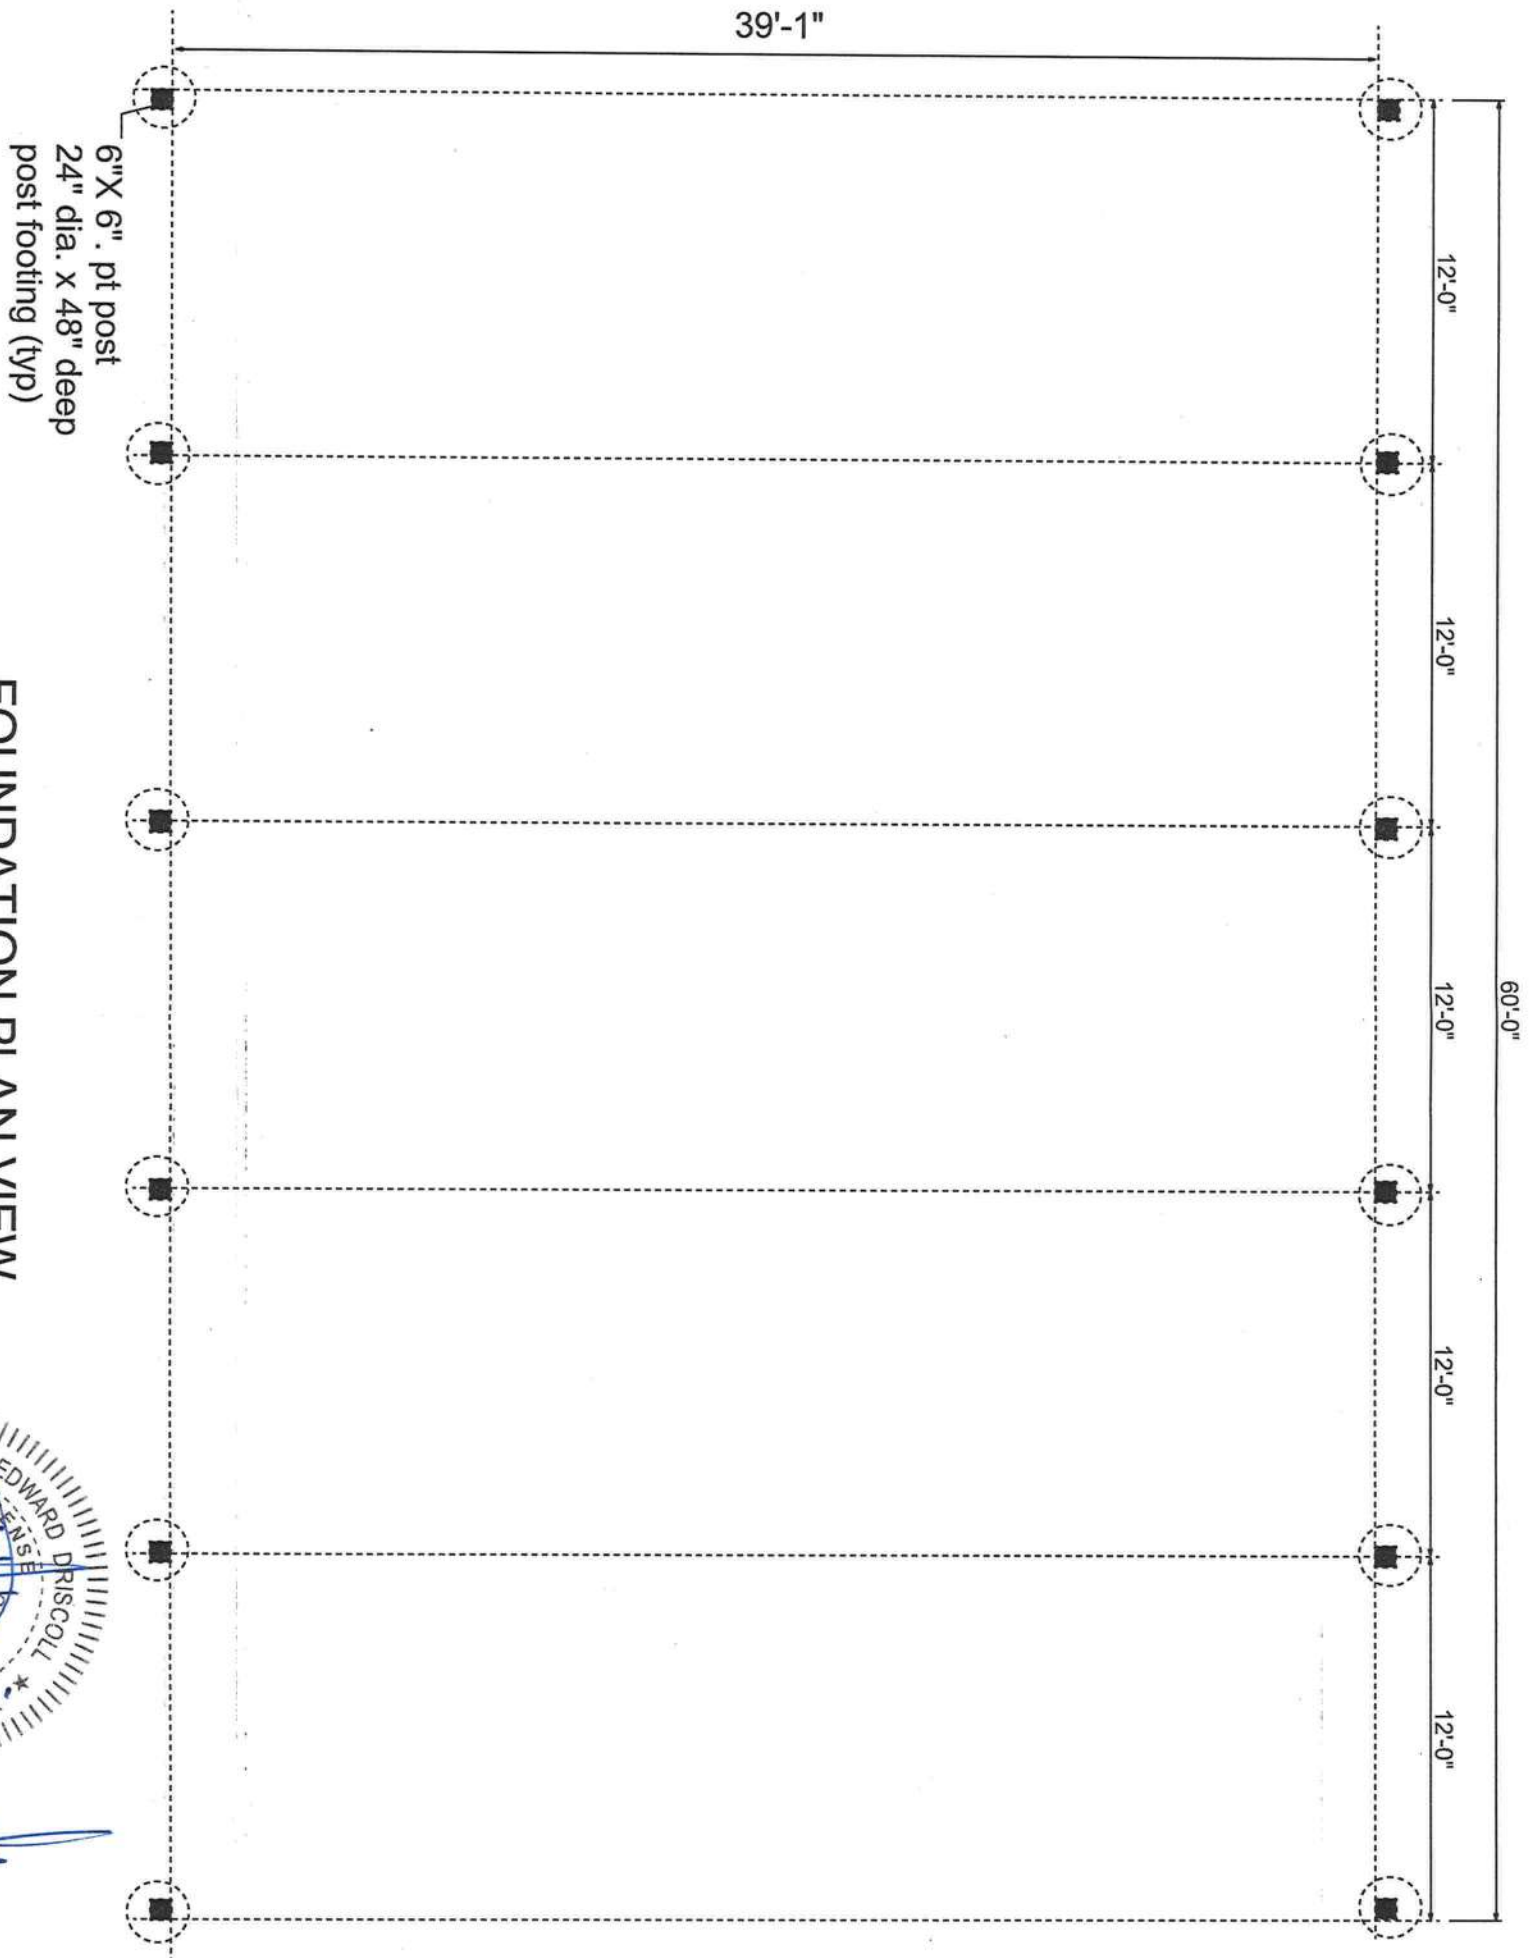

FOUNDATION PLAN VIEW

3/16" = 1'-0"

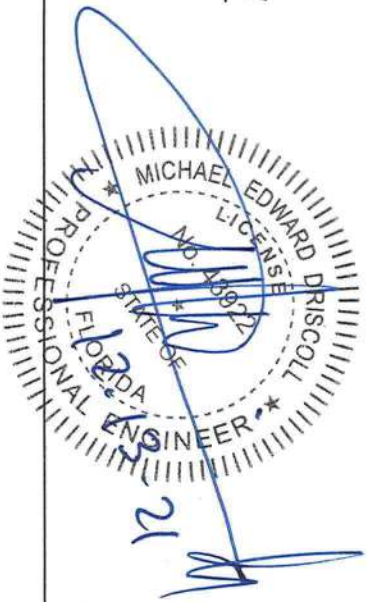

12-10-21
Michael E Driscoll PE
FL Reg # 43922




DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS
PO BOX 357577
GAINESVILLE, FL 32606
PH (352) 331-1913
FX (352) 505-3366
CA 9090

SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

SHEET:


2

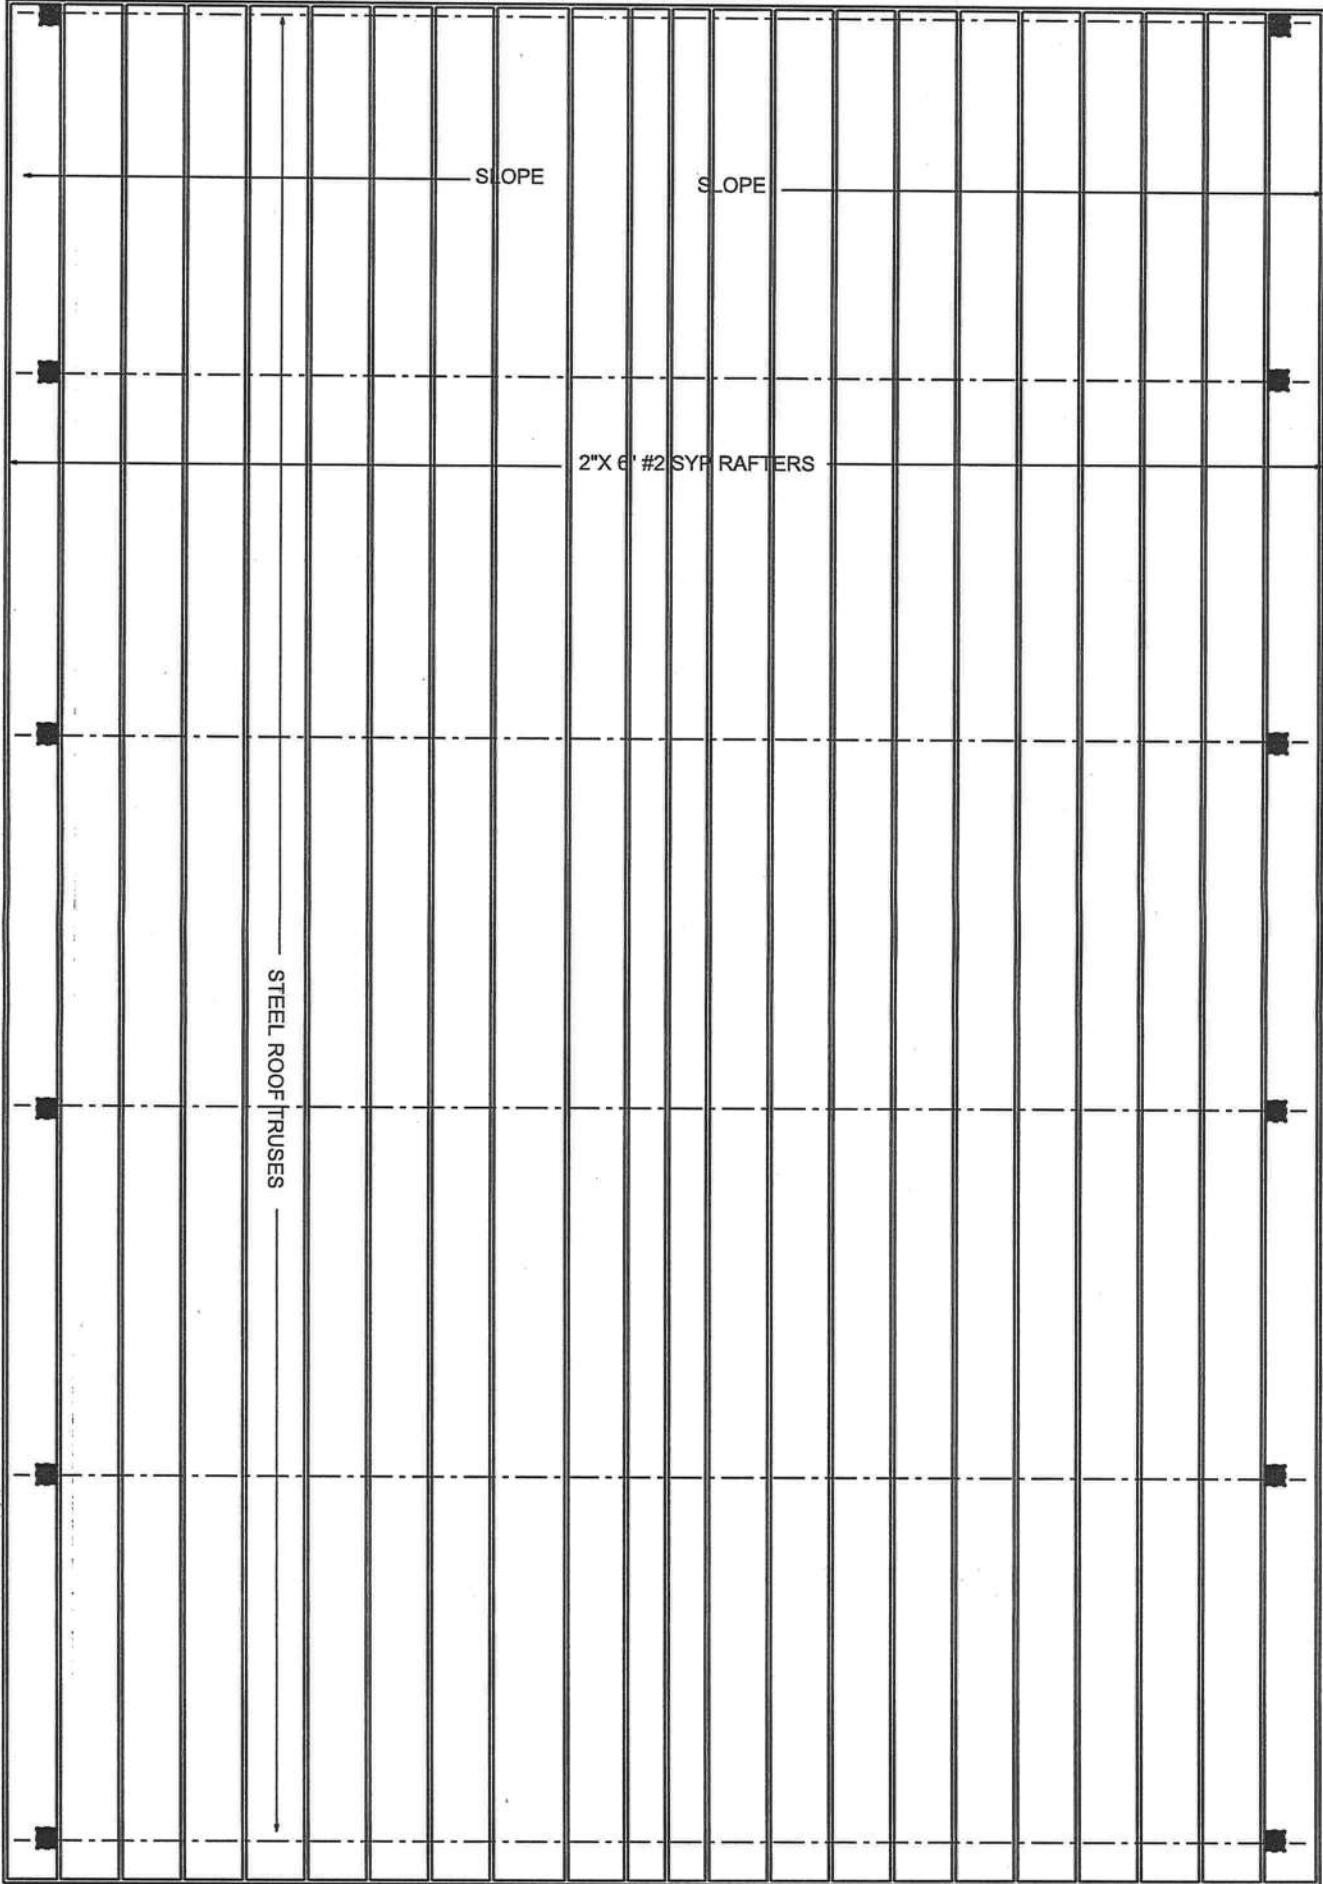

6"X 6" . pt post
24" dia. x 48" deep
post footing (typ)

ROOF PLAN VIEW

3/16" = 1'-0"

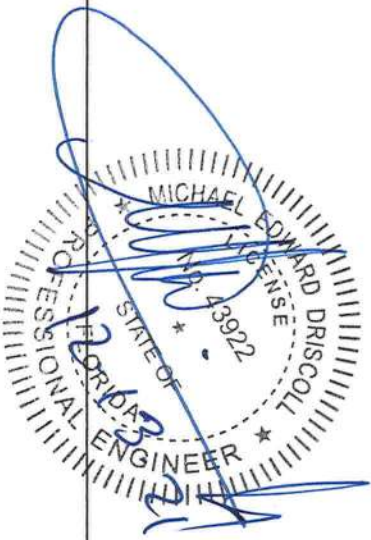

12-10-21
Michael E Driscoll PE
FL Reg # 43922




DRISCOLL ENGINEERING, INC.
CONSULTING ENGINEERS
PO BOX 357577 GAINESVILLE, FL 32606
PH (352) 331-1513
FX (352) 505-3366
CA 8690


SHINDLEBOWER
4973 TUSTENUGGEE AVE
LAKE CITY, FL. DB21-883-boa

SHEET:


3

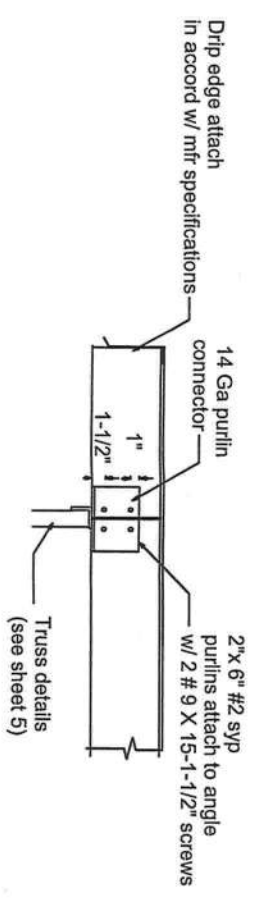


PURLIN CONNECTION DETAIL

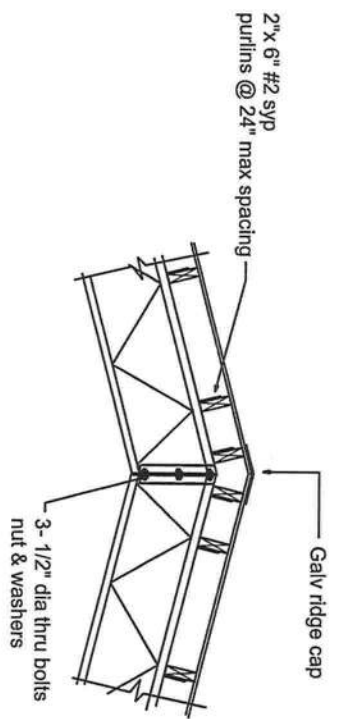


RIDGE CONNECTION DETAIL

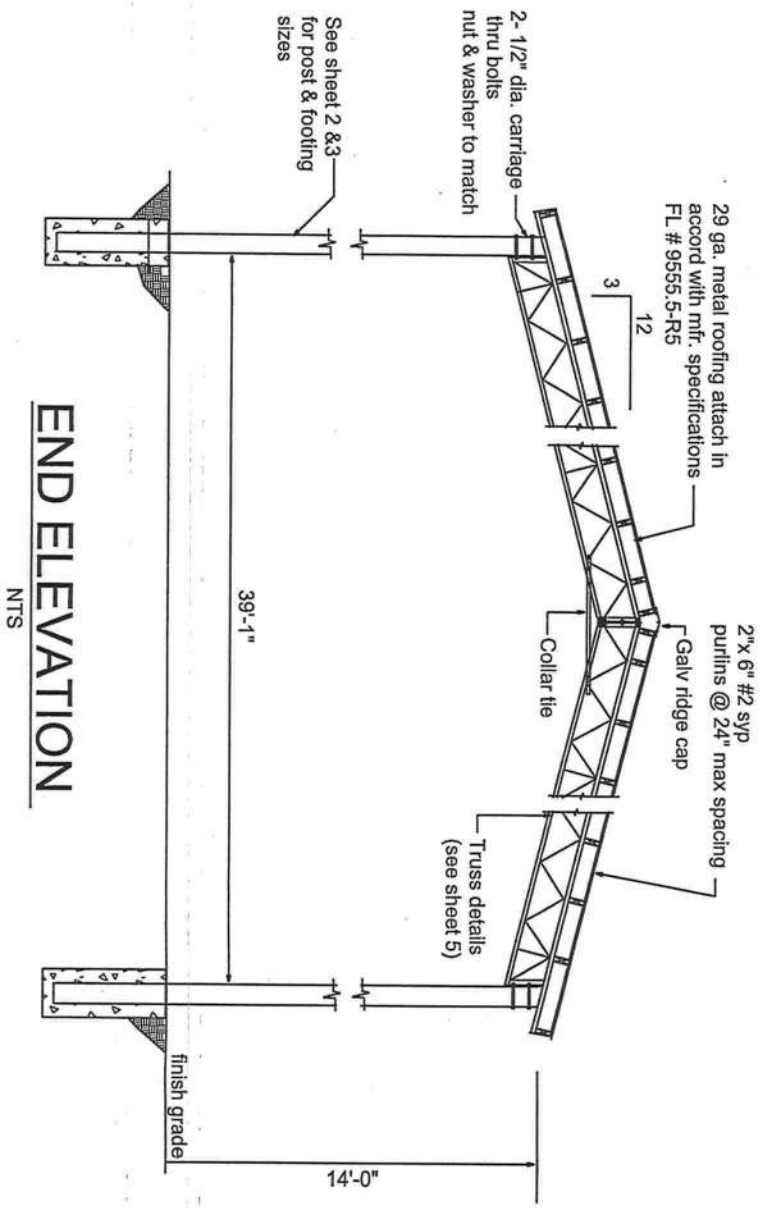


END ELEVATION
NTS

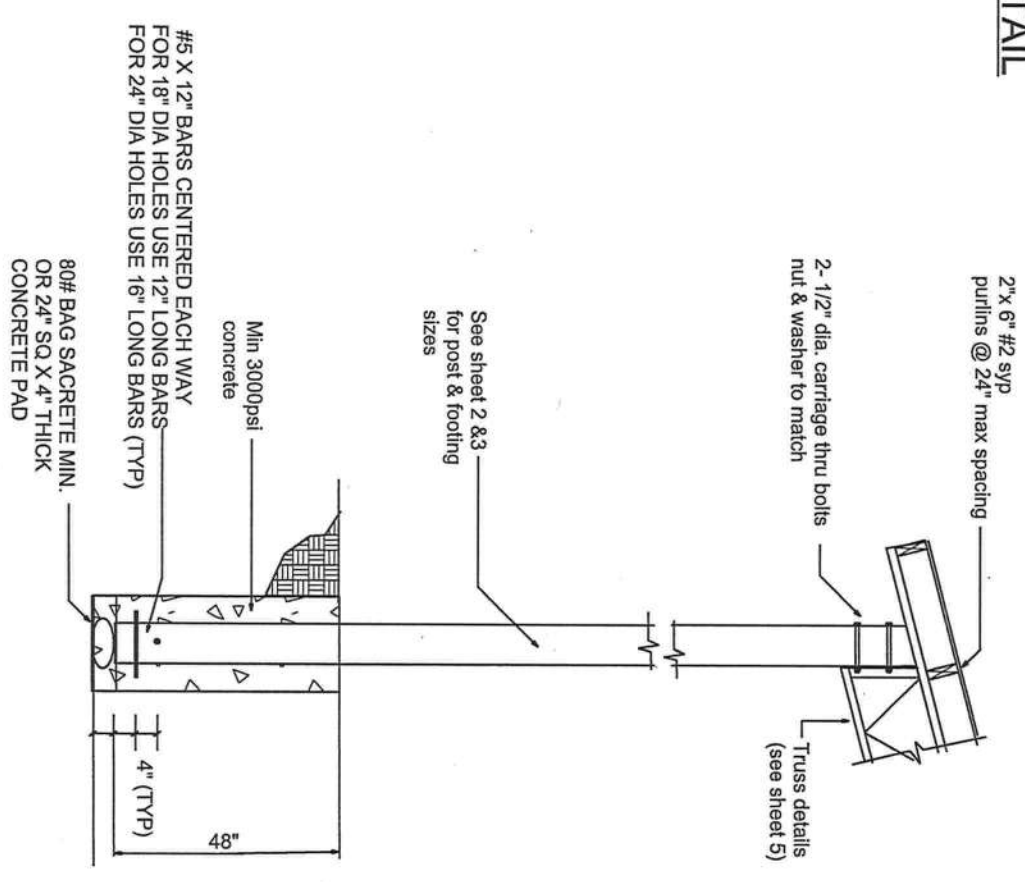

POST FOOTING TO TRUSS DETAIL

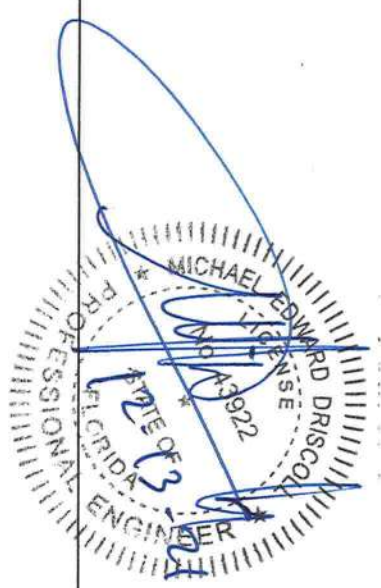


12-10-21
Michael E Driscoll PE
FL Reg # 43922

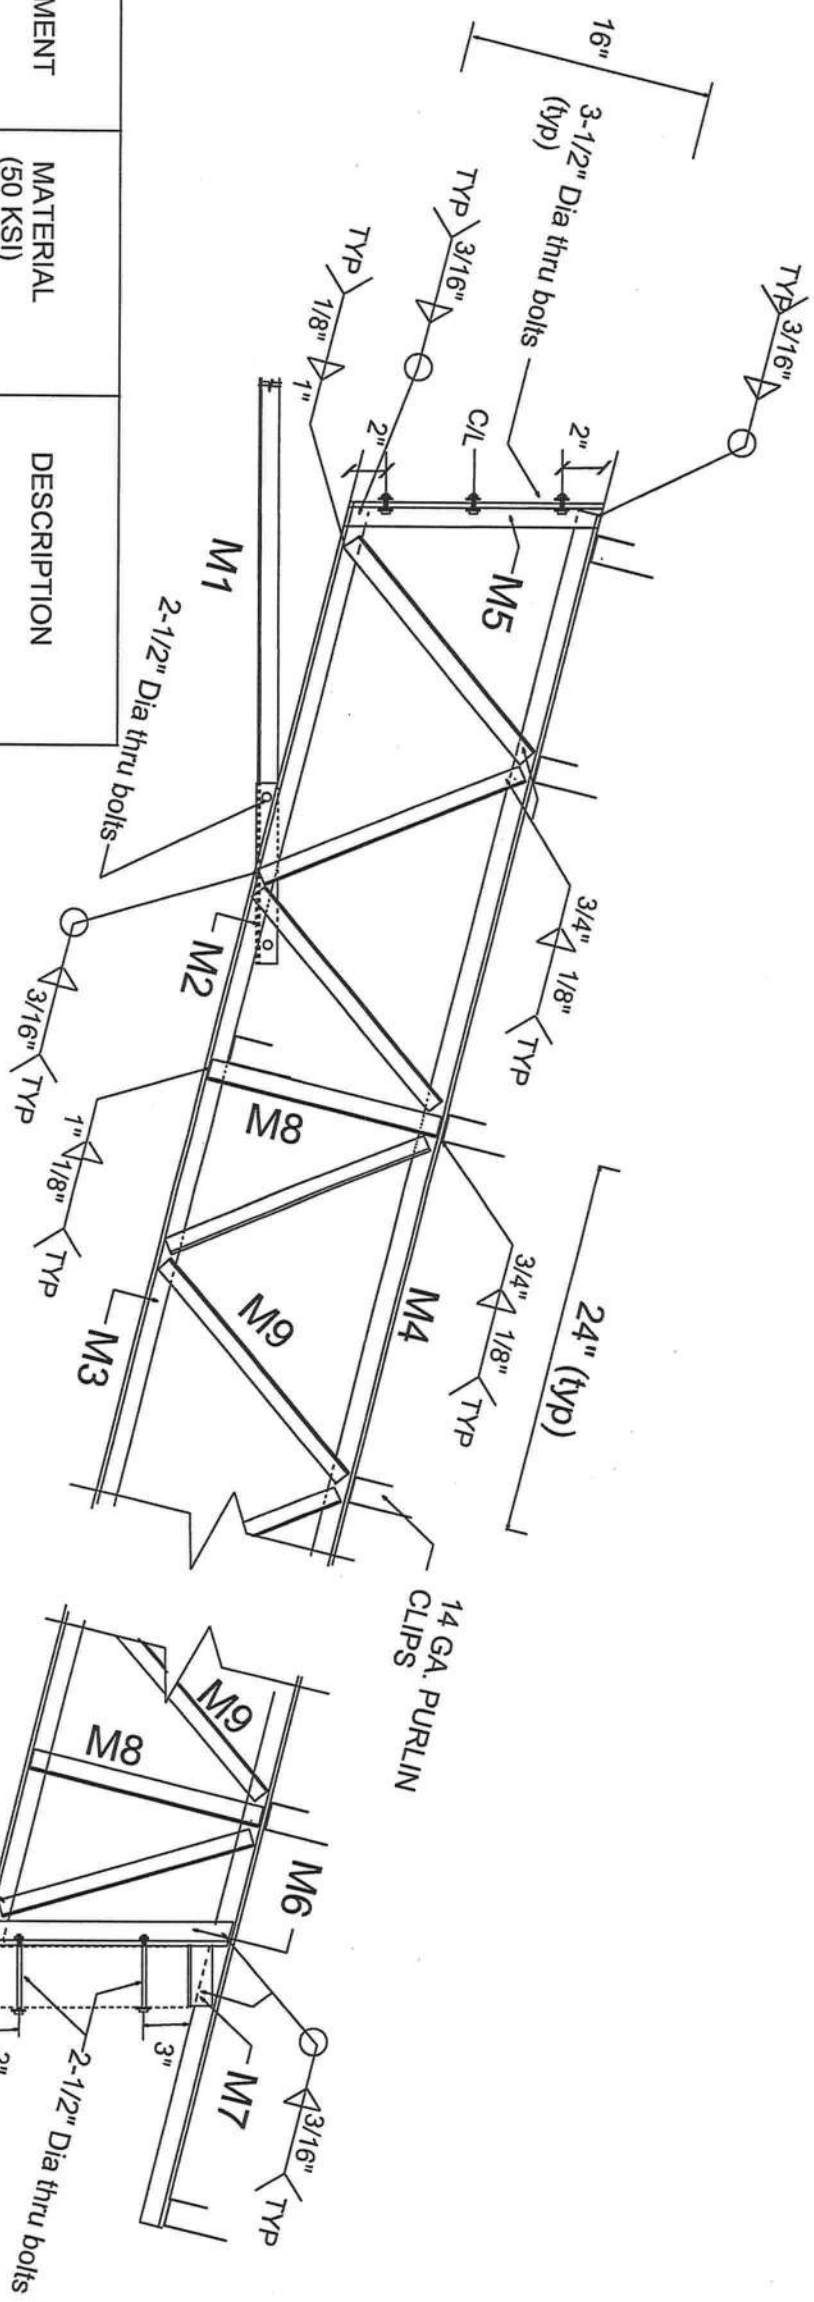

No.	ELEMENT	MATERIAL (50 KSI)	DESCRIPTION
M1	Collar Tie	ASTM 572	L1-1/2"x1-1/2" x 3/16"
M2	Collar Tie	ASTM 572	L1-1/2"x1-1/2" x 3/16"
M3	Top Chord	ASTM 572	L1-1/2"x1-1/2" x 3/16"
M4	Bottom Chord	ASTM 572	L1-1/2"x1-1/2" x 3/16"
M5	Center vertical	ASTM 572	L1-1/2" x 1-1/2" x 3/16"
M6	End Vertical	ASTM 572	L 3"x 2" x 3/8"
M7	Bearing angle	ASTM 572	L 3"x 2" x 3/8"
M8	Inside vertical	ASTM 572	L1-1/4" x 1-1/4" x 1/8"
M9	Diagonal web	ASTM 572	L1-1/4" x 1-1/4" x 1/8"

STEEL TRUSS CROSS SECTION

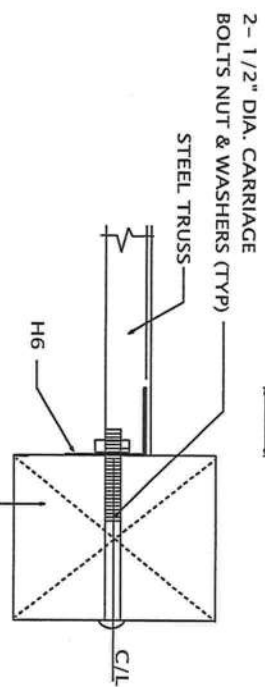


CONNECTOR SCHEDULE
2" x 6" #2 syp pultr to 6" x 6" x 14 ga. clip. 2-#9 x 1-1/2" screws
Truss to ridge 3-1/2" dia thru bolts & nut
Wood post to truss 2-1/2" dia thru bolts nut & washers
Post to concrete 24" dia x 48" deep w/ 2 #6 bars thru post

Wood post
not shown
for clarity

TRUSS DETAILS

TRUSS TO POST DETAIL
PLAN VIEW

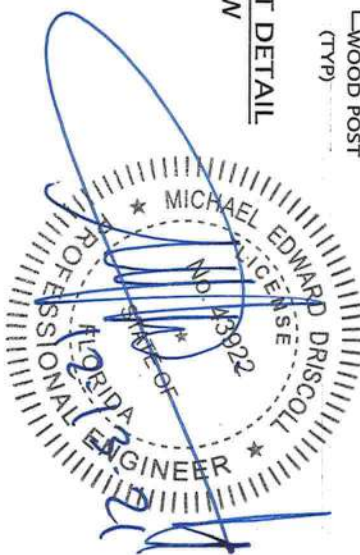

- NOTES:
- 1-MATERIALS SHALL CONFORM TO STEEL ASTM 572.
 - 2- ALL STEEL SHALL BE 50ksi IN ACCORD WITH CURRENT AISC MANUAL.
 - 3- WELDING ELECTRODES TYPE E70XX
 - 4- ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWS REQUIREMENTS.
 - 5-ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
 - 6-BOLTS SHALL BE ASTM A325. w/ NUTS & WASHERS. (TYP)
 - 7- WELD STRENGTH 70 KSI MIN.
 - 8- ALL POSTS SHALL BE #2 DENSE PRESSURE TREATED GROUND CONTACT.
 - 9- PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
 - 10- MIN EDGE DISTANCE FOR BOLT HOLES SHALL BE 3/4" MIN
 - 11-MAX TRUSS SPACING SHALL NOT EXCEED 12'-0" UNO.
 - 12-THE DESIGNER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBILITY OR EXERCISES NO CONTROL WITH REGARD TO FABRICATION, HANDLING, AND INSTALLATION OF TRUSSES.

12-10-21
Michael E Driscoll PE
FL Reg # 43922