




Sheet 1

Exhaust fans to be Panasonic Model FV-051OVS1. See attached submittal data sheet.

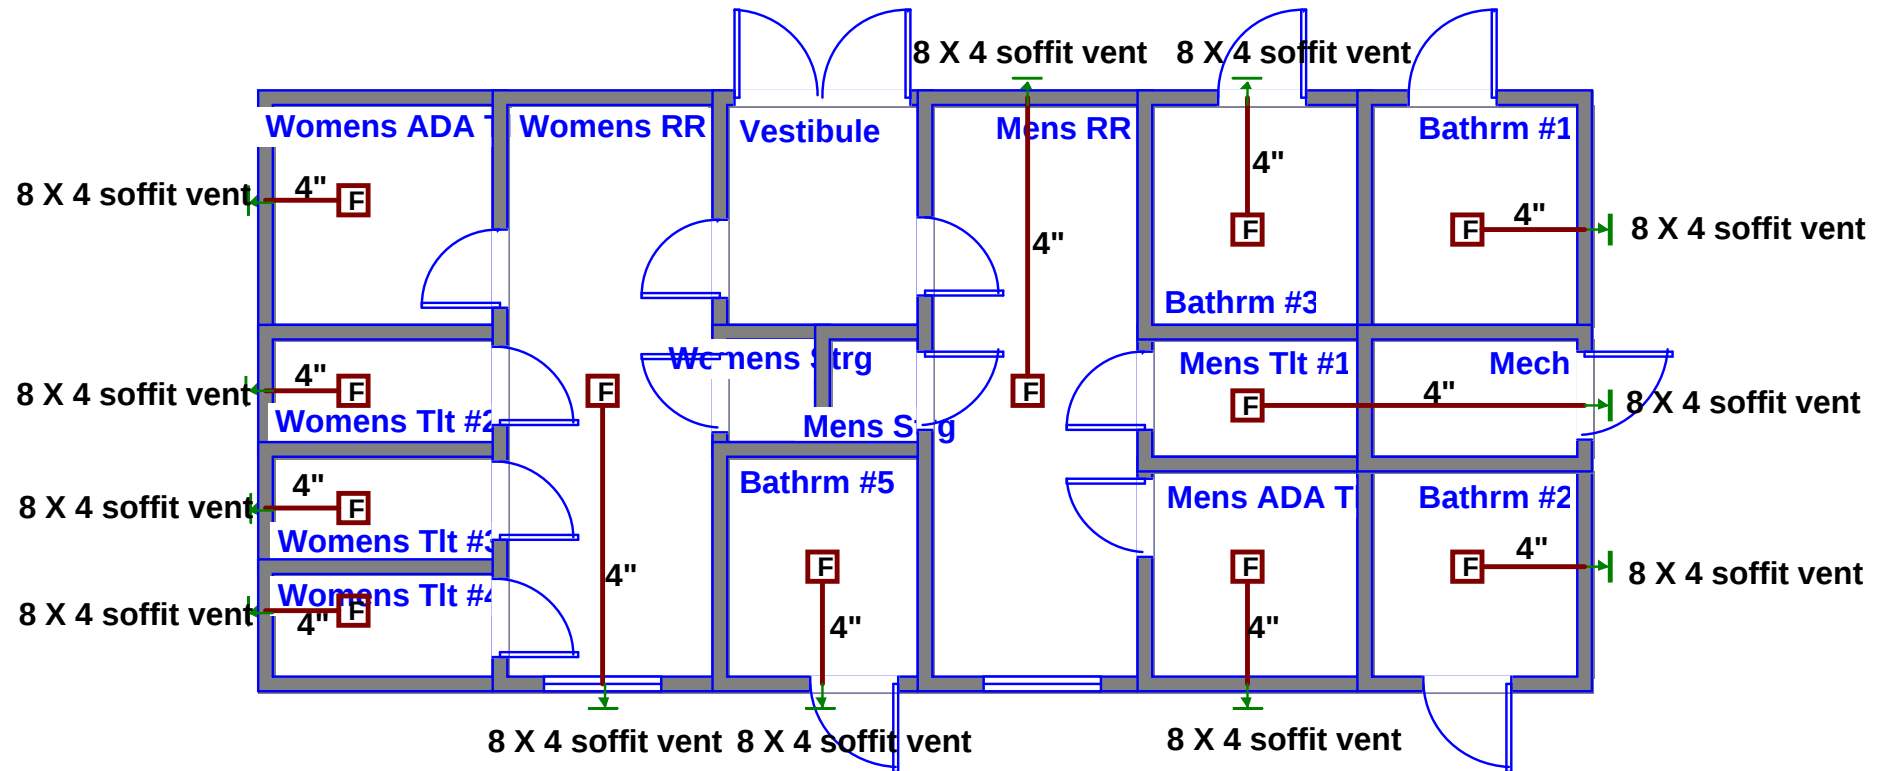

As per FBC Table 403.3.1.1 Bathroom Exhaust fans are to run continuously while occupied.
Makeup/Fresh Air is calculated as per FBC Table 403.3.1.1. Public Places Toilet rooms -
Public Occupancy Classification.

Job #: Kingdom Culture Academy Bathro
Performed by John Pirk for:

Jarvis Heat & Air, LLC
2001 N.E. 31st Avenue
Gainesville, FL 32609
Phone: (352) 316 - 4573

New Age Dimensions, L.L.C.

14080 S.E. 122nd Lane Road
Ocklawaha, FL 32179
Phone: (352) 288 - 0686 Fax: (352) 288 - 0684
www.newagedimensions.webs.com john.newage@gmail.com

Scale: 1 : 79

Page 1

Right-Suite® Universal 2024

24.0.01 RSU02050

2024-Jun-18 10:17:44

...cademy Bathrooms ventilation.rup