



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 3130985 - IC CONST. - LAVENDER & MURRY RES.

MiTek USA, Inc.

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:

Customer Info: IC CONSTRUCTION Project Name: Lavender-Murry Res. Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: TBD, TBD
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2020/TPI2014 Design Program: MiTek 20/20 8.5
Wind Code: ASCE 7-16 Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 57 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T28183209	CJ01	7/6/22	15	T28183223	PB06	7/6/22
2	T28183210	CJ03	7/6/22	16	T28183224	PB06G	7/6/22
3	T28183211	EJ01	7/6/22	17	T28183225	PB07	7/6/22
4	T28183212	EJ02	7/6/22	18	T28183226	PB07G	7/6/22
5	T28183213	EJ03	7/6/22	19	T28183227	PB08	7/6/22
6	T28183214	EJ04	7/6/22	20	T28183228	T01	7/6/22
7	T28183215	EJ05	7/6/22	21	T28183229	T01G	7/6/22
8	T28183216	HJ08	7/6/22	22	T28183230	T02	7/6/22
9	T28183217	HJ08A	7/6/22	23	T28183231	T02A	7/6/22
10	T28183218	PB01	7/6/22	24	T28183232	T02G	7/6/22
11	T28183219	PB02	7/6/22	25	T28183233	T03	7/6/22
12	T28183220	PB03	7/6/22	26	T28183234	T04	7/6/22
13	T28183221	PB04	7/6/22	27	T28183235	T05	7/6/22
14	T28183222	PB05	7/6/22	28	T28183236	T06	7/6/22

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature.


Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision based on the parameters
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: O'Regan, Philip

My license renewal date for the state of Florida is February 28, 2023.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

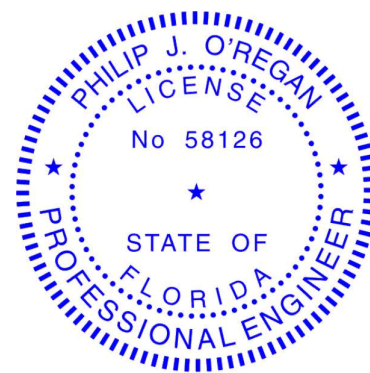

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6, 2022

O'Regan, Philip

1 of 2



RE: 3130985 - IC CONST. - LAVENDER & MURRY RES.


MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017

Site Information:

Customer Info: IC CONSTRUCTION Project Name: Lavender-Murry Res. Model: Custom
Lot/Block: N/A Subdivision: N/A
Address: TBD, TBD
City: Columbia Cty State: FL

No.	Seal#	Truss Name	Date
29	T28183237	T07	7/6/22
30	T28183238	T08	7/6/22
31	T28183239	T09	7/6/22
32	T28183240	T10	7/6/22
33	T28183241	T11	7/6/22
34	T28183242	T12	7/6/22
35	T28183243	T13	7/6/22
36	T28183244	T14	7/6/22
37	T28183245	T15	7/6/22
38	T28183246	T15G	7/6/22
39	T28183247	T16	7/6/22
40	T28183248	T16G	7/6/22
41	T28183249	T17	7/6/22
42	T28183250	T18	7/6/22
43	T28183251	T18G	7/6/22
44	T28183252	T19	7/6/22
45	T28183253	T20	7/6/22
46	T28183254	T21	7/6/22
47	T28183255	T22	7/6/22
48	T28183256	T23	7/6/22
49	T28183257	T24	7/6/22
50	T28183258	T25	7/6/22
51	T28183259	T26	7/6/22
52	T28183260	T27	7/6/22
53	T28183261	T28	7/6/22
54	T28183262	T29	7/6/22
55	T28183263	T30	7/6/22
56	T28183264	T30G	7/6/22
57	T28183265	V01	7/6/22

Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:28 2022 Page 1
ID:?NVDGqlbCtvYSOv1NEucG6zi0DO-?iAMO?8vVnkp8H9plufa91_vt0HkrQMWUMYDKz?5ZL

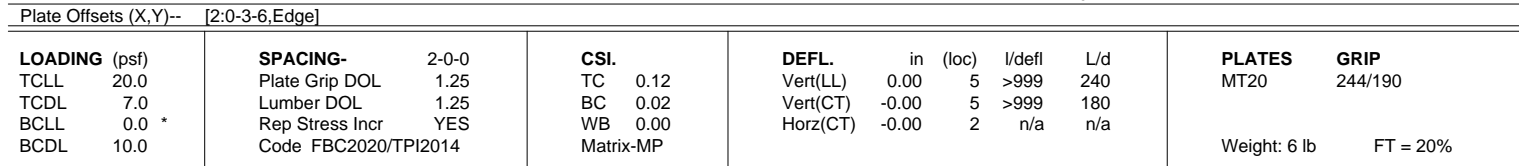

BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 1-2-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

July 6, 2022

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for the building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183210
3130985	CJ03	Jack-Open	6	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:28 2022 Page 1

ID:~NVDGqlbCtvYSOv1NEucG6zi0DO-?iAMO?8vVnkgp8H9plufa91_vT?vkrQMWUMYDKz?5ZL

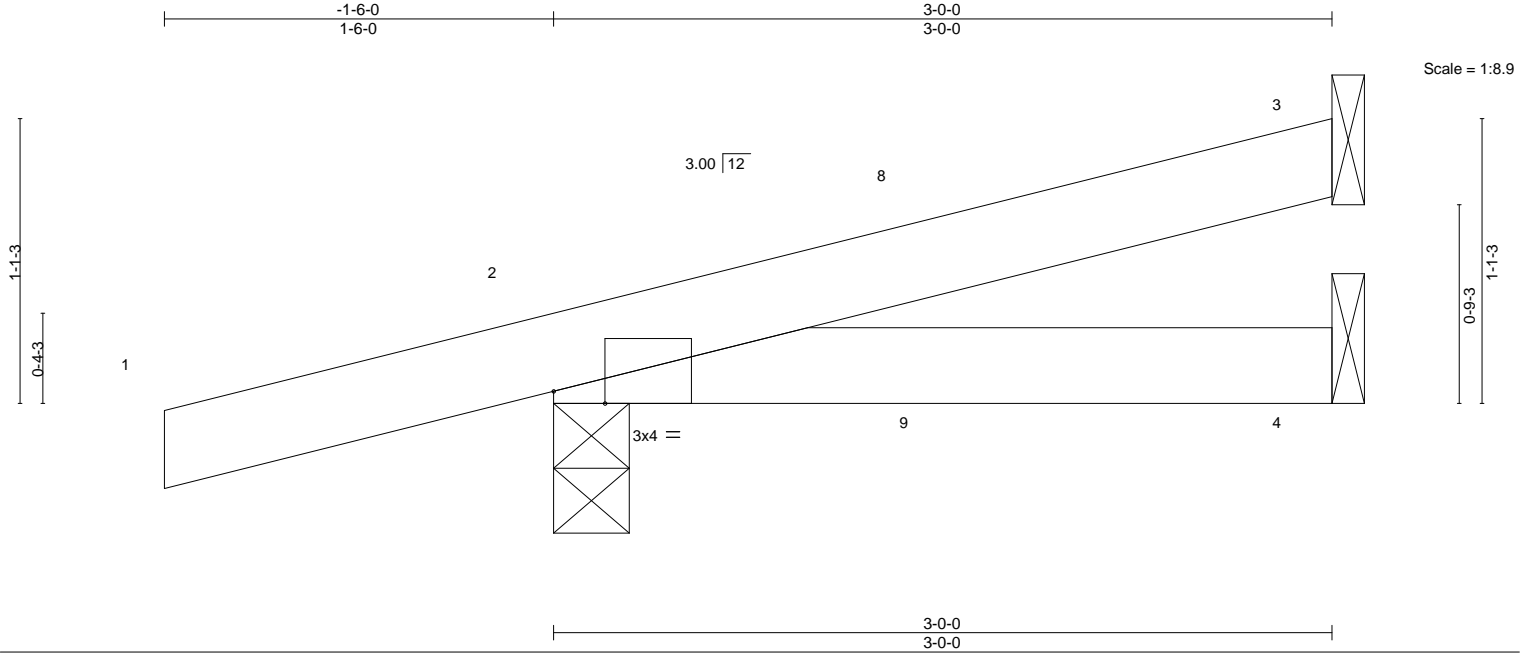


Plate Offsets (X,Y)-- [2:0-2-6,Edge]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.12	Vert(LL)	0.01	4-7	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.11	Vert(CT)	0.01	4-7	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MP							Weight: 11 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=45(LC 8)
Max Uplift 3=-30(LC 8), 2=-132(LC 8), 4=-17(LC 9)
Max Grav 3=57(LC 1), 2=210(LC 1), 4=47(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 2-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=132.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:29 2022 Page 1
ID:~NVDGqIbCtvYSOv1NEucG6zi0DO-TukIbL9XG5sgHIsLNTpu7Na5cGQTlgVl866lmz?5ZK
-1-6-0 5-0-0
1-6-0 5-0-0

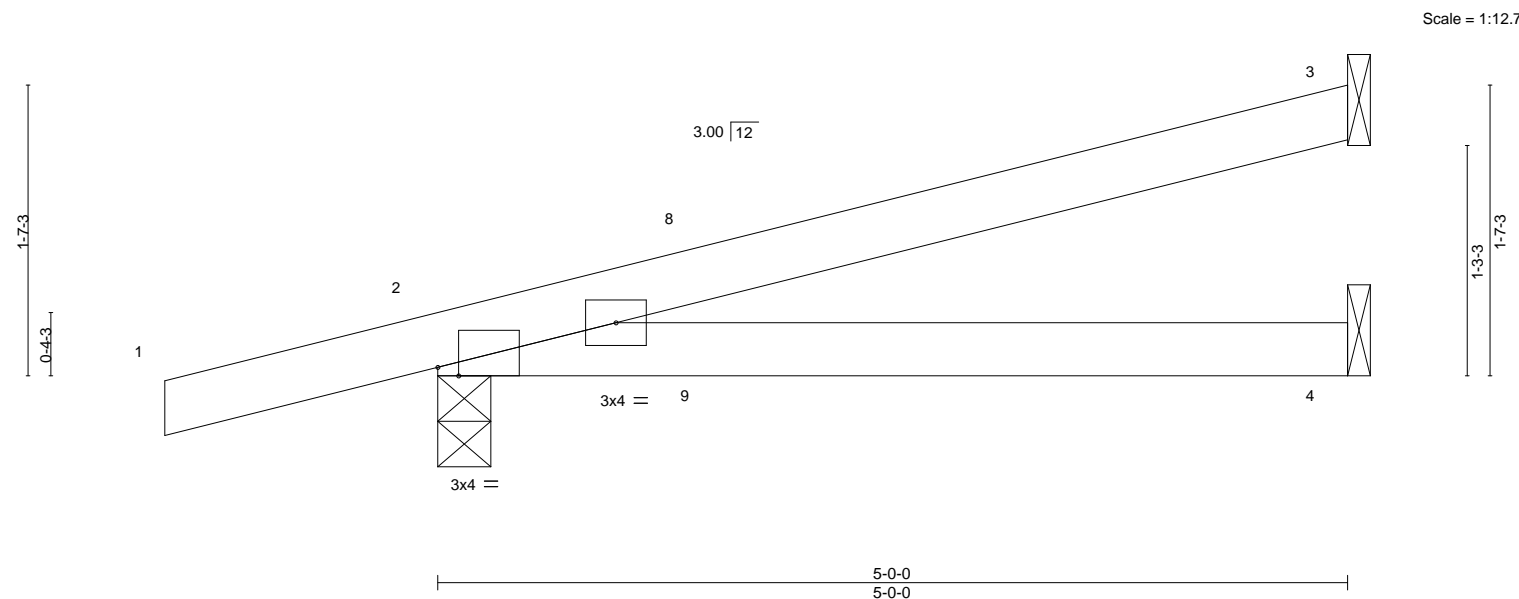

LUMBER-		BRACING-
TOP CHORD	2x4 SP No.2	TOP CHORD
BOT CHORD	2x4 SP No.2	BOT CHORD
		Structural wood sheathing directly applied or 5-0-0 oc purlins.
		Rigid ceiling directly applied or 10-0-0 oc bracing.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BC DL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 4-11-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=162

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6, 2022



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183212
3130985	EJ02	Jack-Open	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:30 2022 Page 1

ID:~NVDGqIbCtvYSOv1NEucG6zi0DO-x5H7phA91O_XvSQYxAx7fa6F4HcNCIwf_orfHDz75ZJ

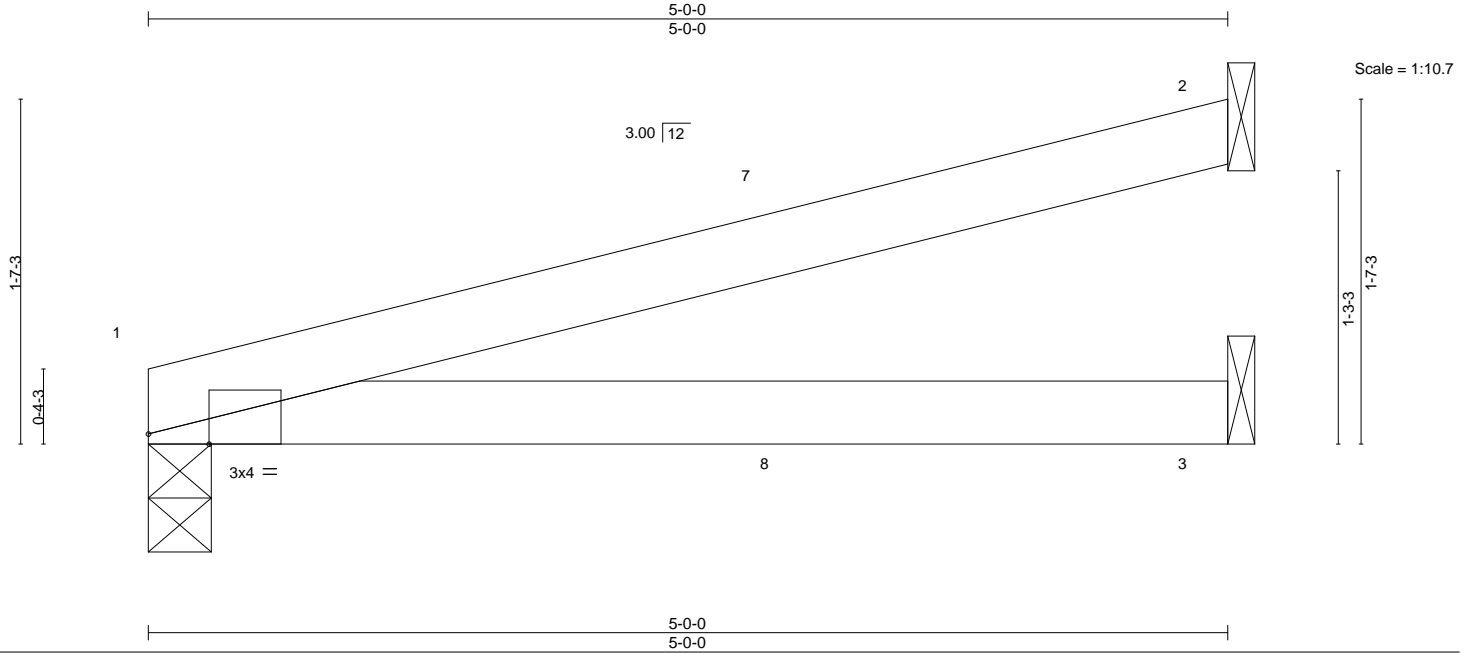


Plate Offsets (X,Y)-- [1:0-3-6,Edge]														
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d					PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.40	Vert(LL)	0.10	3-6	>598	240	MT20	244/190		
TCDL	7.0	Lumber DOL	1.25	BC	0.43	Vert(CT)	0.09	3-6	>682	180	Weight: 15 lb FT = 20%			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	1	n/a	n/a				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MP										

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

REACTIONS.

(size) 1=0-3-8, 2=Mechanical, 3=Mechanical
Max Horz 1=45(LC 12)
Max Uplift 1=-92(LC 8), 2=-66(LC 8), 3=-38(LC 8)
Max Grav 1=183(LC 1), 2=116(LC 1), 3=87(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 4-11-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 2, 3.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183213
3130985	EJ03	Flat	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:30 2022 Page 1

ID:?NVDGqlbCtvYSOv1NEucG6zi0DO-x5H7phA91O_XvSQYxAx7fa6E4HblCwf_orfHDz?5ZJ

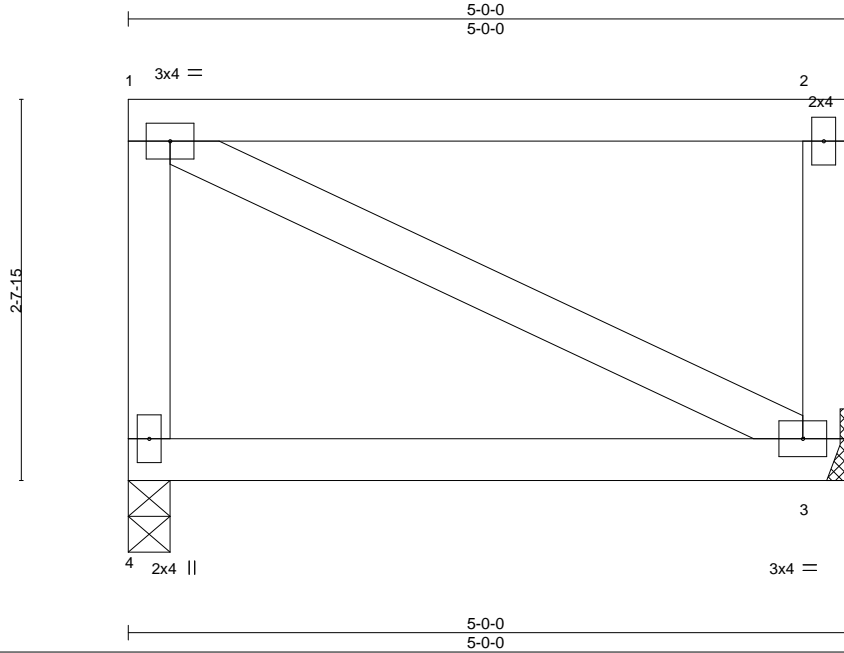

Scale: 3/4"=1'

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.46	Vert(LL)	0.10	3-4	>583	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.47	Vert(CT)	0.09	3-4	>642		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 28 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=0-3-8, 3=Mechanical
Max Uplift 4=-94(LC 8), 3=-94(LC 8)
Max Grav 4=174(LC 1), 3=174(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 3.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.
3130985	EJ04	Flat	1	1	T28183214

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:31 2022 Page 1

ID:~NVDGqIbCtvYSOv1NEucG6zi0DO-PHrV01Anoi6OXc~kvItSMCofPqgx_xCAoCSbDpfz?5ZI

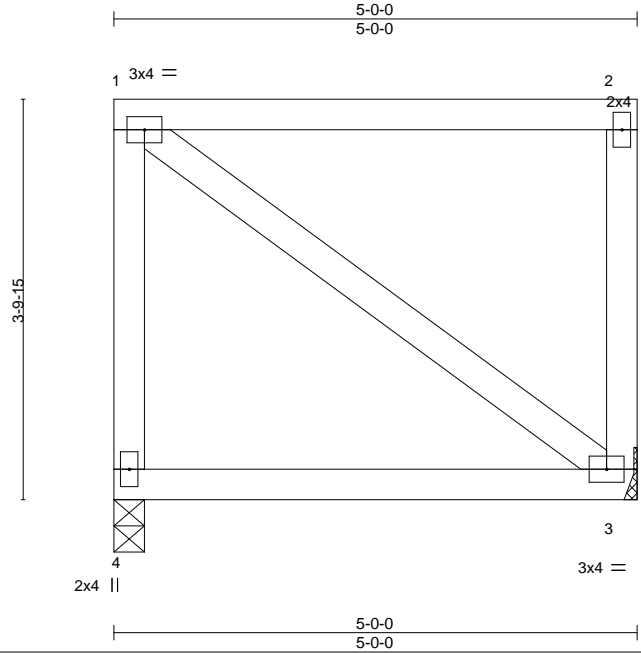

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.46	Vert(LL) 0.10	3-4	>583	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.47	Vert(CT) 0.09	3-4	>642	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 33 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5'-0" oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS.

(size) 4=0-3-8, 3=Mechanical
Max Uplift 4=-94(LC 8), 3=-94(LC 8)
Max Grav 4=174(LC 1), 3=174(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 3.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183215
3130985	EJ05	Flat	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:32 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-tTPtENBPZ0EF9law2bzb1?Caa4HDgfQxR6KmM5z?5ZH

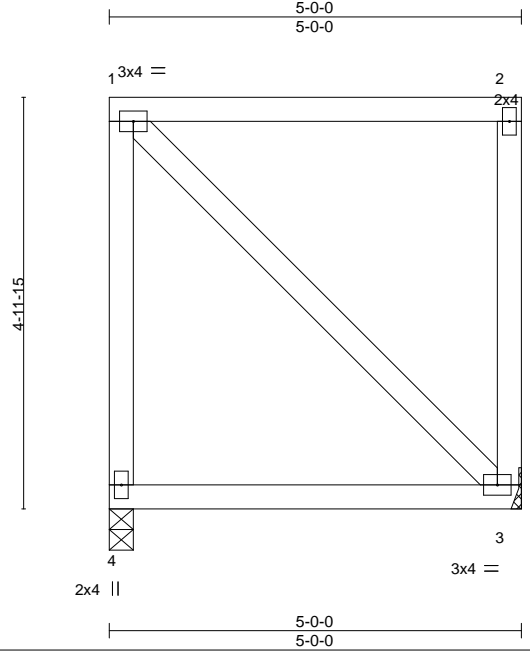

Scale = 1:28.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2'-0'-0	TC 0.46	Vert(LL) 0.10	3-4	>583	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.47	Vert(CT) 0.09	3-4	>642	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MP					Weight: 37 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5'-0'-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0'-0 oc bracing.

REACTIONS.

(size) 4=0-3-8, 3=Mechanical
Max Uplift 4=-94(LC 8), 3=-94(LC 8)
Max Grav 4=174(LC 1), 3=174(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3) zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 3.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183216
3130985	HJ08	Diagonal Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:33 2022 Page 1

ID:?NVDGqlbCtvYSOv1NEucG6zi0DO-LgzFRjC1KJM6mv97clUqHDkiXUcmP6g5gm4JuYz?5ZG



Scale = 1:17.0

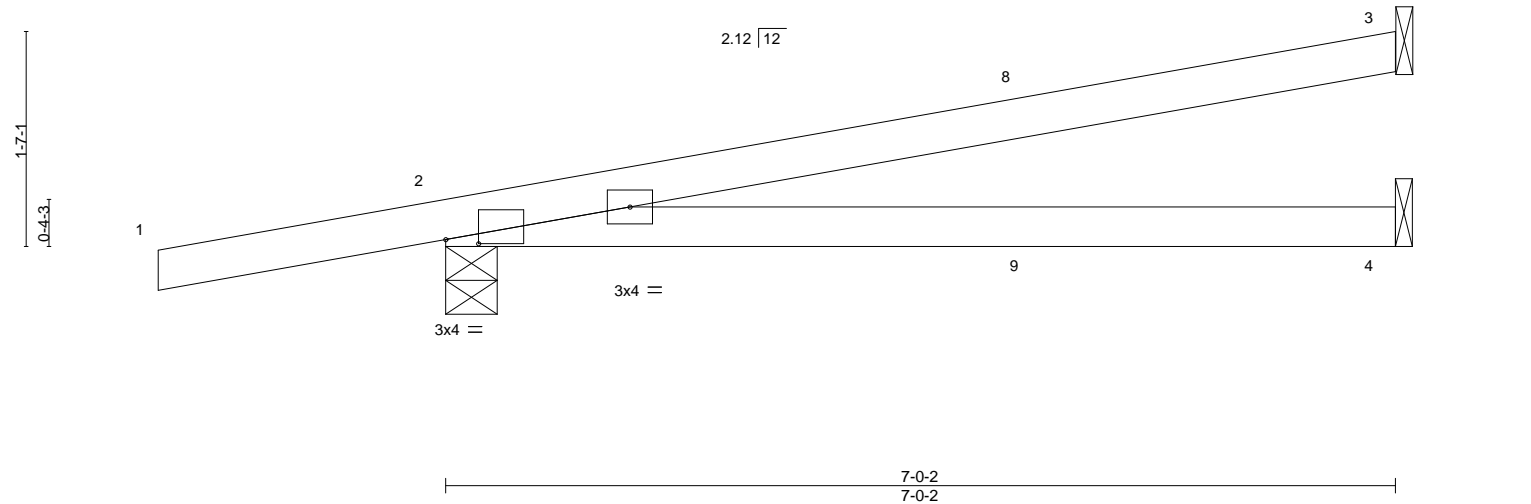


Plate Offsets (X,Y)--		[2:0-2-15,0-0-6]													
LOADING	(psf)	SPACING-		2-0-0	CSI.			DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP	
TCLL	20.0	Plate Grip DOL		1.25	TC	0.64		Vert(LL)	0.15	4-7	>559	240	MT20	244/190	
TCDL	7.0	Lumber DOL		1.25	BC	0.51		Vert(CT)	-0.21	4-7	>400	180			
BCLL	0.0 *	Rep Stress Incr		NO	WB	0.00		Horz(CT)	0.00	2	n/a	n/a			
BCDL	10.0	Code		FBC2020/TPI2014	Matrix-MS										
														Weight: 24 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-9, 4=Mechanical
Max Horz 2=63(LC 22)
Max Uplift 3=84(LC 4), 2=238(LC 4), 4=48(LC 4)
Max Grav 3=157(LC 1), 2=394(LC 1), 4=121(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=238.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 22 lb down and 36 lb up at 4-4-0, and 22 lb down and 36 lb up at 4-4-0 on top chord, and 47 lb down and 22 lb up at 1-6-1, 47 lb down and 22 lb up at 1-6-1, and 18 lb down and 25 lb up at 4-4-0, and 18 lb down and 25 lb up at 4-4-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-5=-20
Concentrated Loads (lb)
Vert: 8=-0(F=-0, B=-0) 9=-13(F=-7, B=-7)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183217
3130985	HJ08A	Diagonal Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:33 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-LgzFRjC1KJM6mv97clUqHDkiXUcmP6g5gm4JuYz?5ZG



Scale = 1:17.0

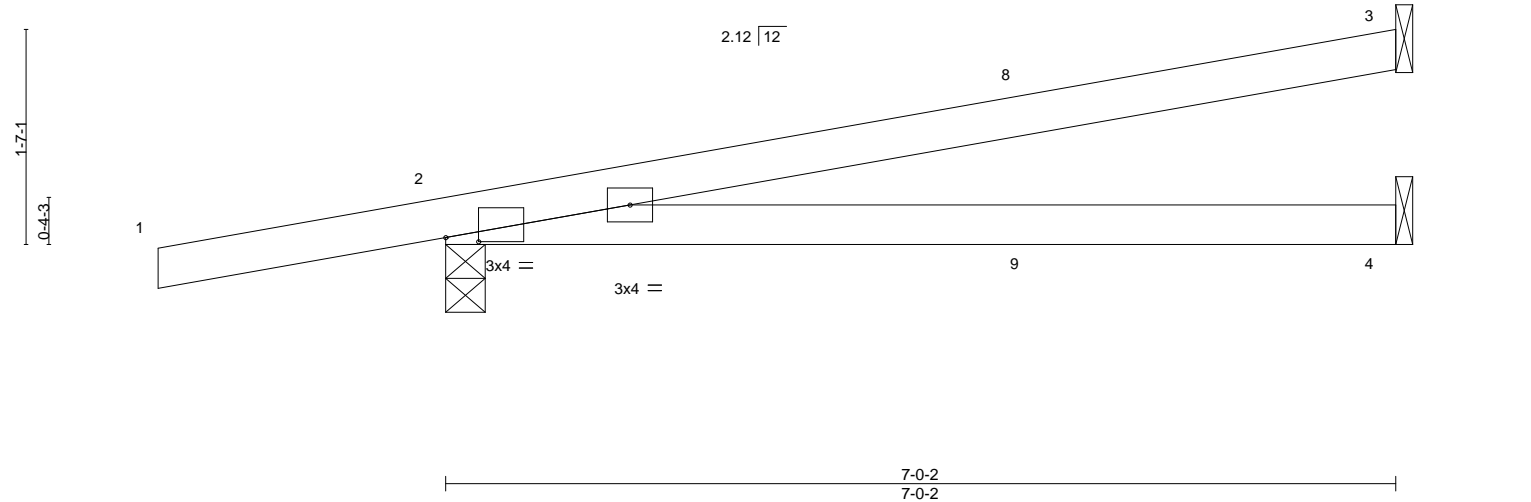


Plate Offsets (X,Y)--		[2:0-2-15,0-0-6]													
LOADING	(psf)	SPACING-		2-0-0	CSI.		DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP		
TCLL	20.0	Plate Grip DOL	1.25		TC	0.64	Vert(LL)	0.15	4-7	>559	240	MT20	244/190		
TCDL	7.0	Lumber DOL	1.25		BC	0.51	Vert(CT)	-0.21	4-7	>400	180				
BCLL	0.0 *	Rep Stress Incr	NO		WB	0.00	Horz(CT)	0.00	2	n/a	n/a				
BCDL	10.0	Code	FBC2020/TPI2014		Matrix-MS										
												Weight: 24 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=63(LC 22)
Max Uplift 3=84(LC 4), 2=238(LC 4), 4=48(LC 4)
Max Grav 3=157(LC 1), 2=394(LC 1), 4=121(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4 except (jt=lb) 2=238.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 22 lb down and 36 lb up at 4-4-0, and 22 lb down and 36 lb up at 4-4-0 on top chord, and 47 lb down and 22 lb up at 1-6-1, 47 lb down and 22 lb up at 1-6-1, and 18 lb down and 25 lb up at 4-4-0, and 18 lb down and 25 lb up at 4-4-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 4-5=-20
Concentrated Loads (lb)
Vert: 8=-0(F=-0, B=-0) 9=-13(F=-7, B=-7)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183218
3130985	PB01	Piggyback	1	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:34 2022 Page 1

ID: ?NVDGqIbCtvYSOv1NEucG6zi0DO-psXef3Dg5dUzO3kJA0?3qQH_Pu3A8ZUEuQptQ_z?5ZF

6-2-0
6-2-0

Scale = 1:12.3

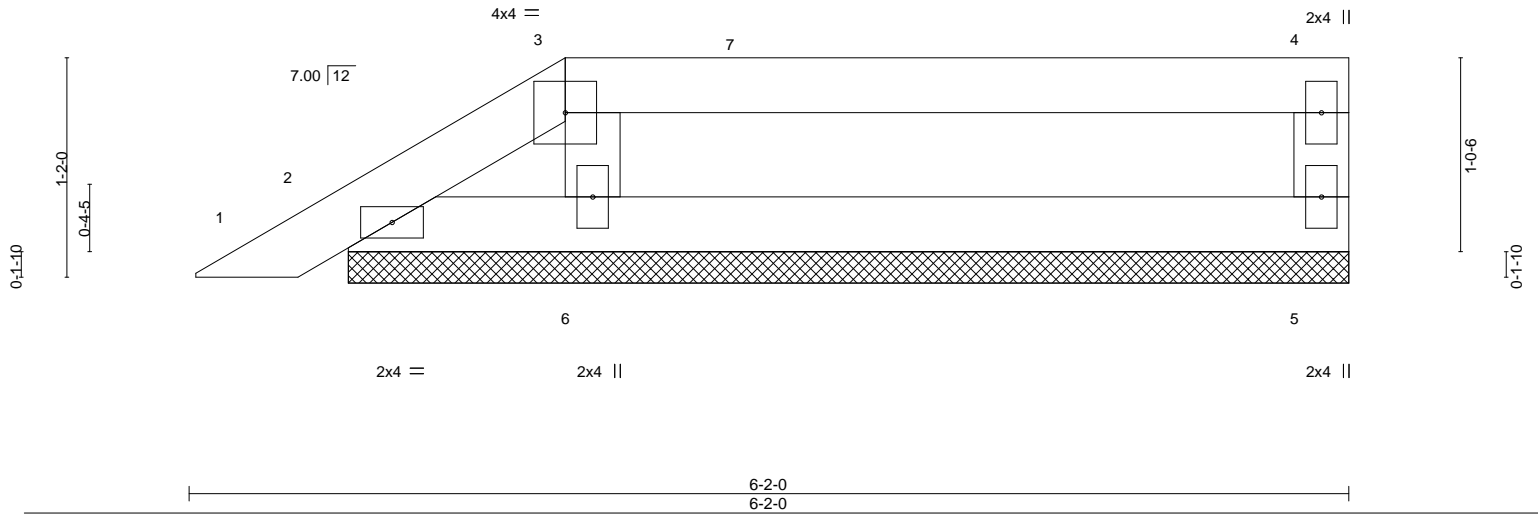

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	Vert(LL)	0.00	1	n/r	120	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.12	Vert(CT)	0.00	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-P						Weight: 19 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=5-3-13, 2=5-3-13, 6=5-3-13
Max Horz 2=35(LC 12)
Max Uplift 5=47(LC 8), 2=32(LC 12), 6=36(LC 9)
Max Grav 5=140(LC 1), 2=73(LC 1), 6=200(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
- 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183219
3130985	PB02	Piggyback	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:35 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-H250sPEIsxcq0DJVkJWIMeqAqI0xt0D74ZQzQz?5ZE

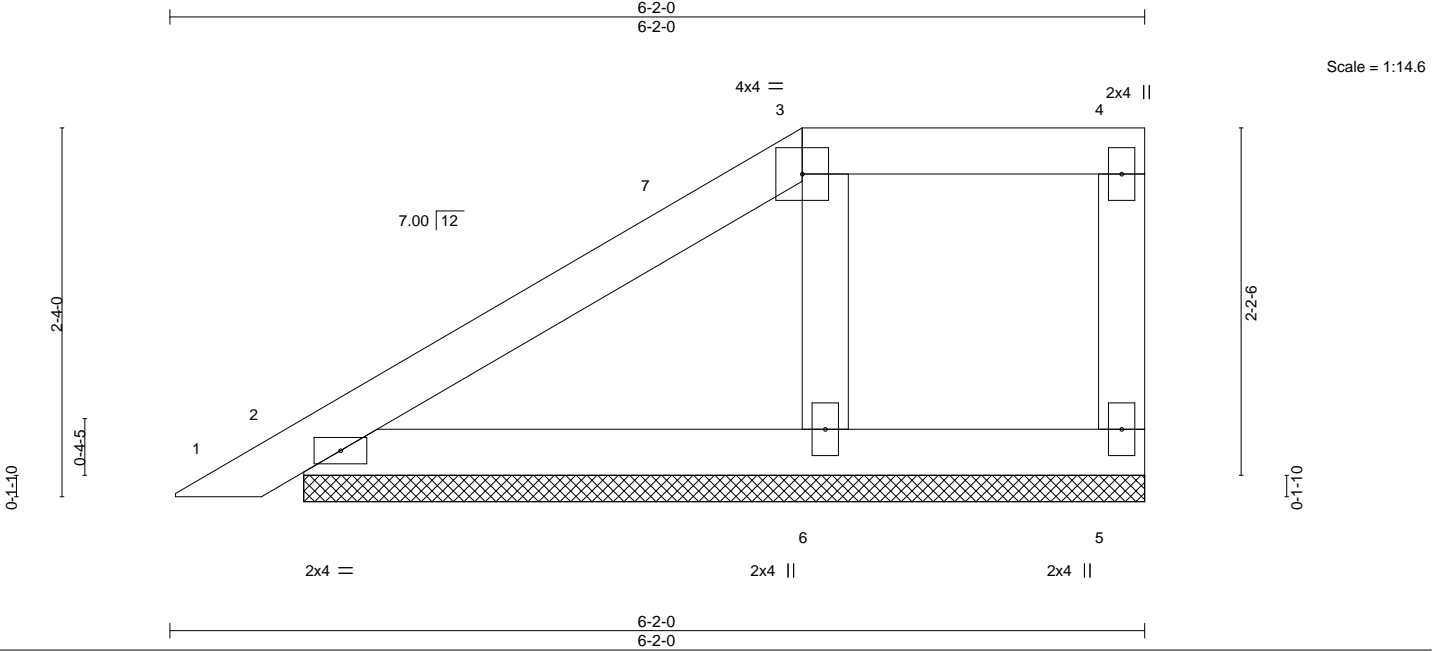

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.14	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.08	Vert(CT)	0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-P					Weight: 23 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS.

(size) 5=5-3-13, 2=5-3-13, 6=5-3-13
Max Horz 2=78(LC 12)
Max Uplift 5=-26(LC 8), 2=-33(LC 12), 6=-53(LC 12)
Max Grav 5=62(LC 1), 2=150(LC 1), 6=200(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 4-0-0, Exterior(2E) 4-0-0 to 6-0-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183220
3130985	PB03	Piggyback	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:36 2022 Page 1
ID:?NVdGqIbCtvYSOv1NEucG6zi0DO-mFfO4IEwdEkhdNuiHR1XvrMH1hgFcTPXMkl_Vsz?5ZD

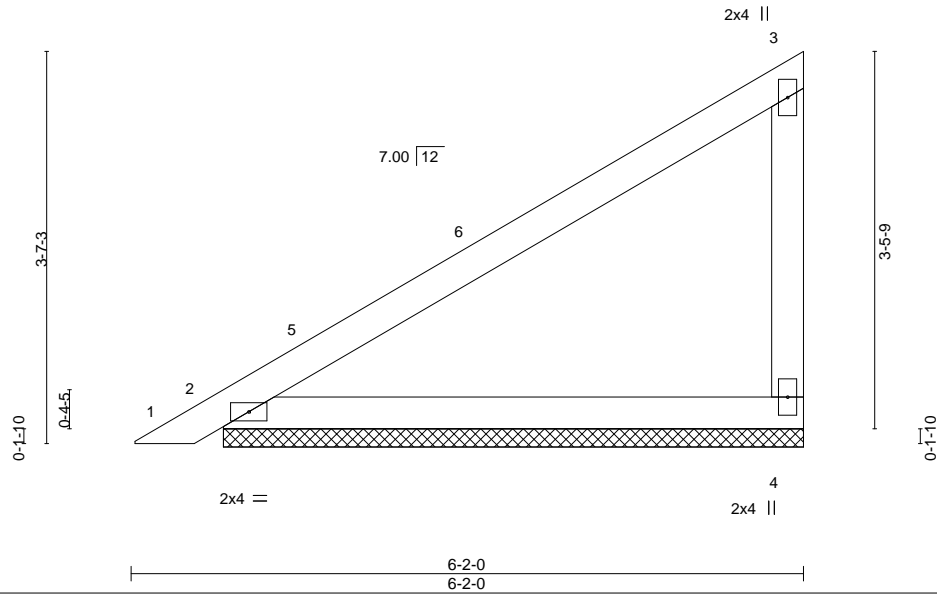

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.43	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.34	Vert(CT)	0.01	1	n/r		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.00	Horz(CT)	0.00	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 23 lb	FT = 20%
	Code FBC2020/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=5-3-13, 2=5-3-13
Max Horz 2=121(LC 12)
Max Uplift 4=-90(LC 12), 2=-38(LC 12)
Max Grav 4=199(LC 19), 2=222(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 6-0-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 7) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183221
3130985	PB04	Piggyback	1	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:36 2022 Page 1

ID:7NVDGqIbCtVYSOv1NEucG6zi0DO-mFfO4IEwdEkhdNuiHR1XvrMLjhKcTwXMkl_Vsz?5ZD



Scale = 1:12.3

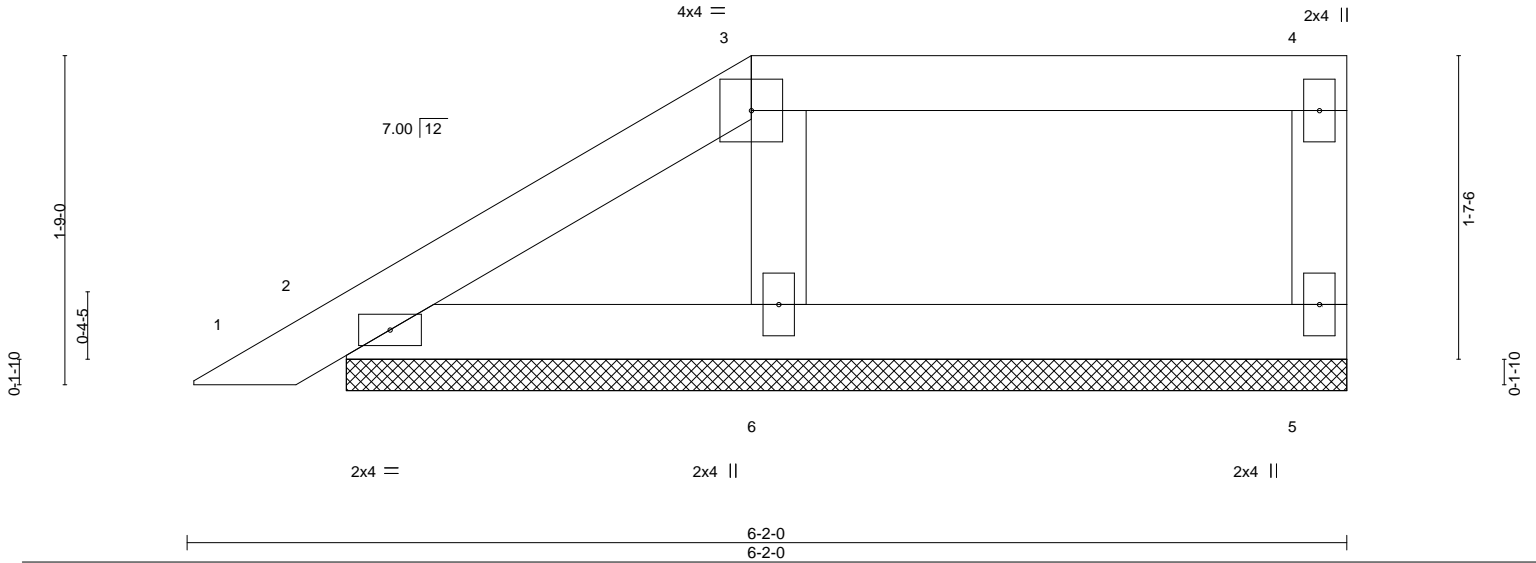

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.13	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.07	Vert(CT)	0.00	1	n/r		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.03	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code FBC2020/TPI2014						Weight: 21 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.

(size) 5=5-3-13, 2=5-3-13, 6=5-3-13
Max Horz 2=57(LC 12)
Max Uplift 5=-36(LC 8), 2=-29(LC 12), 6=-40(LC 9)
Max Grav 5=104(LC 1), 2=115(LC 1), 6=193(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
- 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183222
3130985	PB05	Piggyback	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:37 2022 Page 1

ID:7NVDGqIbCtvYSOv1NEucG6zi0DO-ERCmH4FYOYtYFXTur8ZmS3vUO53JLw4hbO2X1Jz?5ZC

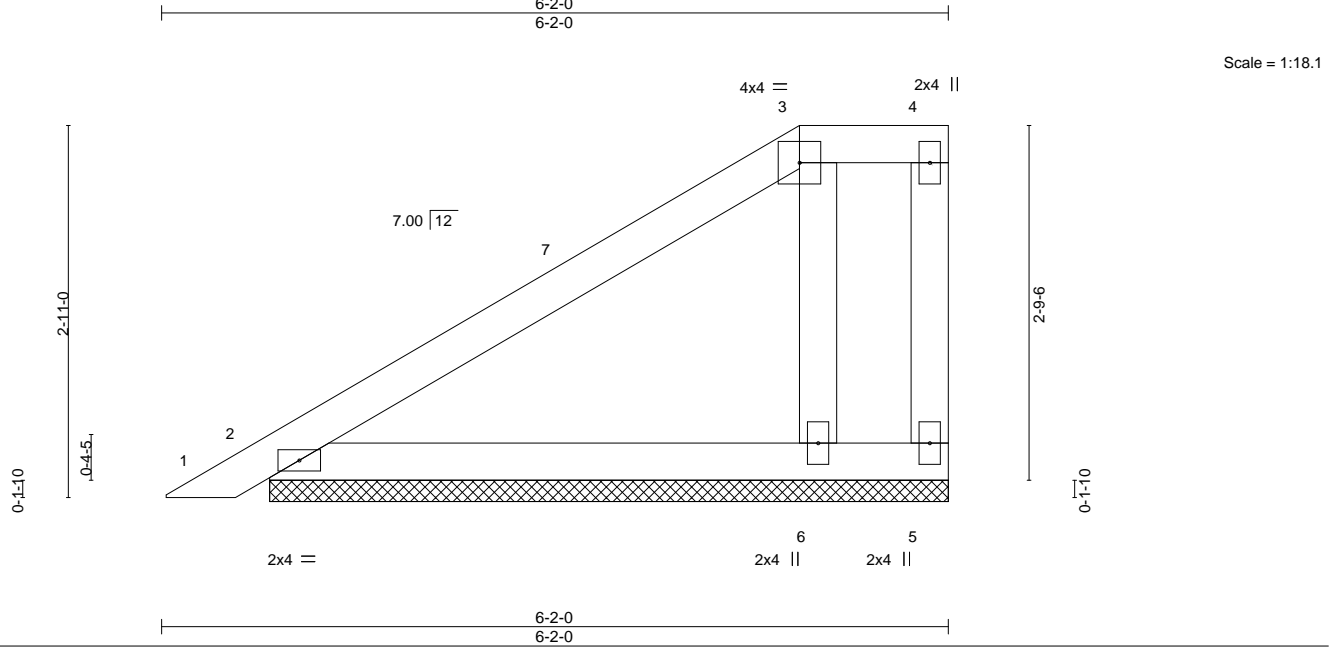

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2'-0"	TC 0.27	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.15	Vert(CT)	0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.04	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-P					Weight: 25 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS.

(size) 5=5-3-13, 2=5-3-13, 6=5-3-13
Max Horz 2=100(LC 12)
Max Uplift 5=64(LC 3), 2=38(LC 12), 6=57(LC 12)
Max Grav 2=182(LC 1), 6=245(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 5-0-0, Exterior(2E) 5-0-0 to 6-0-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183223
3130985	PB06	GABLE	7	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:38 2022 Page 1

ID:NVDGqlbCtvYSOV1NEucG6zi0DO-idm8UUGA9s?Ptg24Ps4?_GRiUVQf4NDqp2n4ZlZ?5ZB

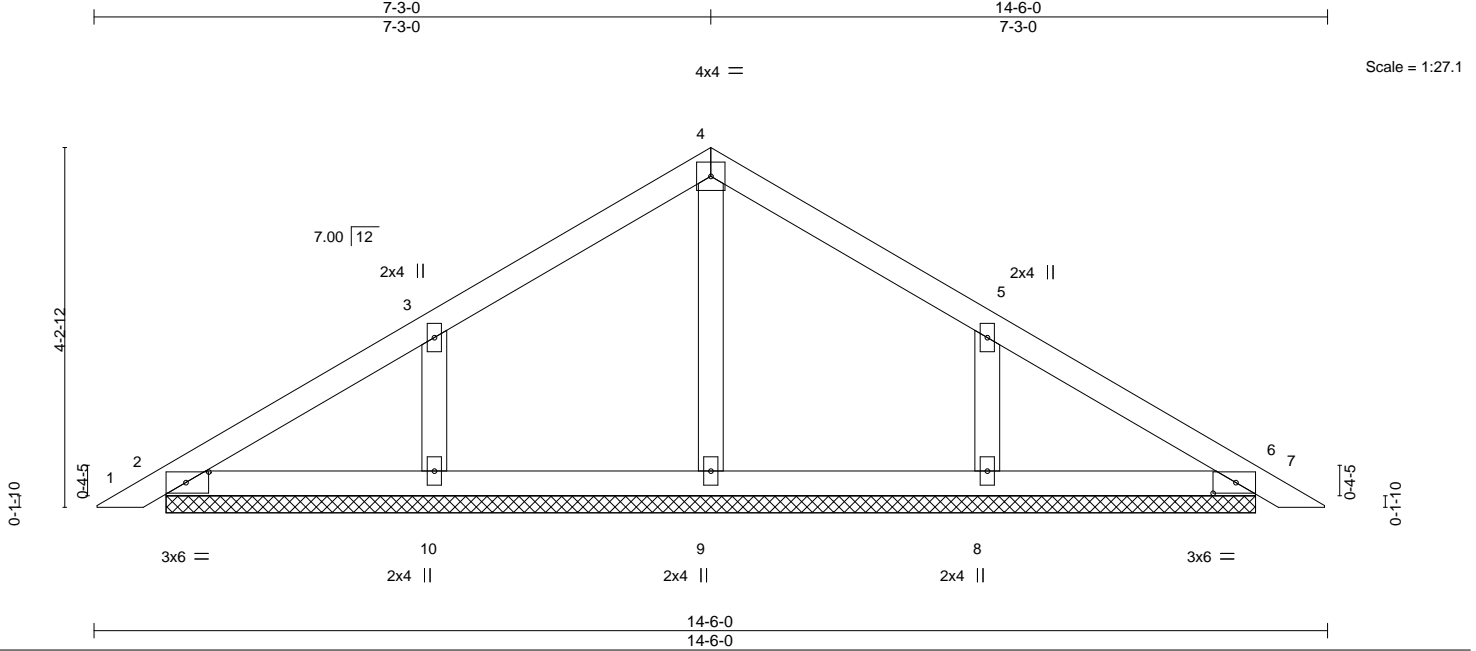

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.12	Vert(LL)	0.00	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.08	Vert(CT)	0.00				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-S							
								Weight: 54 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS.

- All bearings 12-9-11.
(lb) - Max Horz 2=95(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 6 except 8=134(LC 13), 10=134(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 2, 6, 9 except 8=289(LC 20), 10=290(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 7-3-0, Exterior(2R) 7-3-0 to 10-6-0, Interior(1) 10-6-0 to 14-2-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4'-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6 except (jt=lb) 8=134, 10=134.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183224
3130985	PB06G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:39 2022 Page 1

ID: ?NVDGqIbCtvYSOv1NEucG6zi0DO-AqKXimHow97GUqcGzZbEXU_uRvnkpqkz2iXe6Bz?5ZA

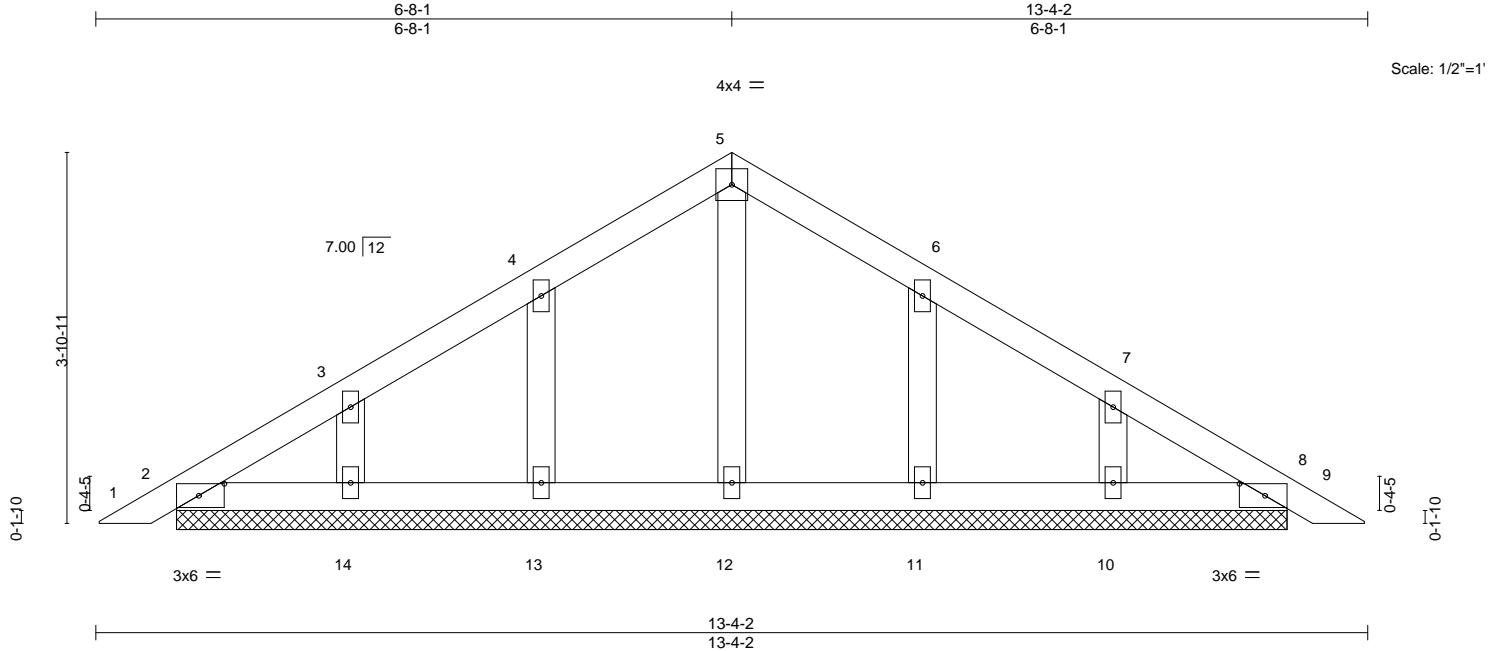


Plate Offsets (X,Y)-- [2:0-3-3,0-1-8], [8:0-3-3,0-1-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.04	Vert(LL)	0.00	8	n/r	120	MT20	244/190
TCDL 7.0	Lumber DOL 1.25		BC 0.03	Vert(CT)	0.00	8	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES		WB 0.03	Horz(CT)	0.00	8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 54 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

- All bearings 11-7-13.
(lb) - Max Horz 2=-87(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 13, 14, 11, 10
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 6-8-1, Exterior(2R) 6-8-1 to 9-8-1, Interior(1) 9-8-1 to 13-0-7 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 13, 14, 11, 10.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:40 2022 Page 1
 ID:?NVDGqIbCtvYSOv1NEucG6zi0DO-e0uvv6HQhTF66_BTWG6T3hX1aJ6lYGI7HMGBeez?5Z9i
 10-6-0 21-0-0
 10-6-0 10-6-0



LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SP No.3		

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

July 6, 2022



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building C**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183227
3130985	PB08	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:42 2022 Page 1

ID:7NVDGqIbCtVYSov1NEucG6zi0DO-aOOfKoJhC4VqLILreh8x96cOb6na0BFQkgIliWz?5Z7

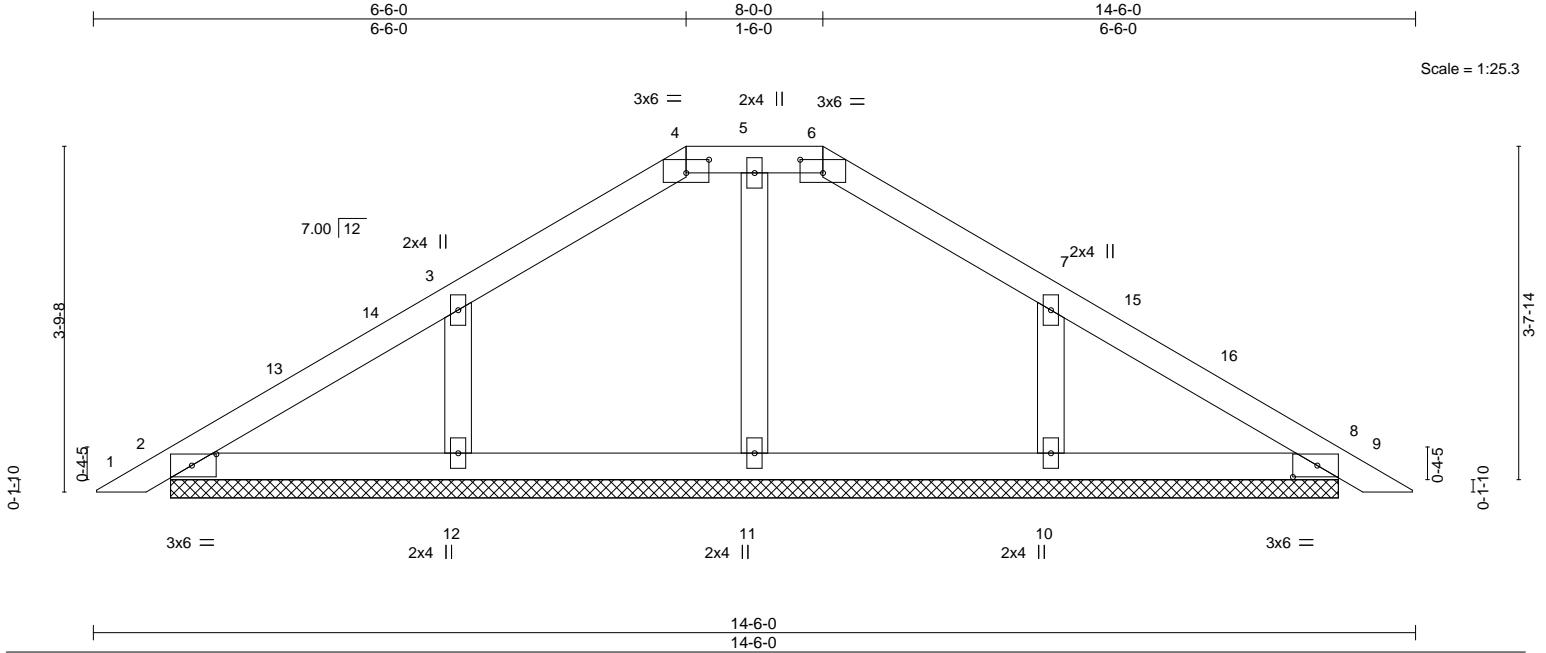

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.11	Vert(LL)	0.00 9 n/r 120	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.08	Vert(CT)	0.00 9 n/r 120				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00 8 n/a n/a				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-S							
								Weight: 53 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

- All bearings 12-9-11.
(lb) - Max Horz 2=85(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 11 except 10=124(LC 13), 12=125(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 11 except 10=277(LC 20), 12=278(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 6-6-0, Exterior(2E) 6-6-0 to 8-0-0, Exterior(2R) 8-0-0 to 12-2-15, Interior(1) 12-2-15 to 14-2-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 11 except (jt=lb) 10=124, 12=125.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183228
3130985	T01	Common	4	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:43 2022 Page 1

ID:~NVDGqIbCtVYSOv1NEucG6zi0DO-2ba1Y8KJzOdHzSw2CPgAhK9RHWxtIXAZzKvrfYz?5Z6

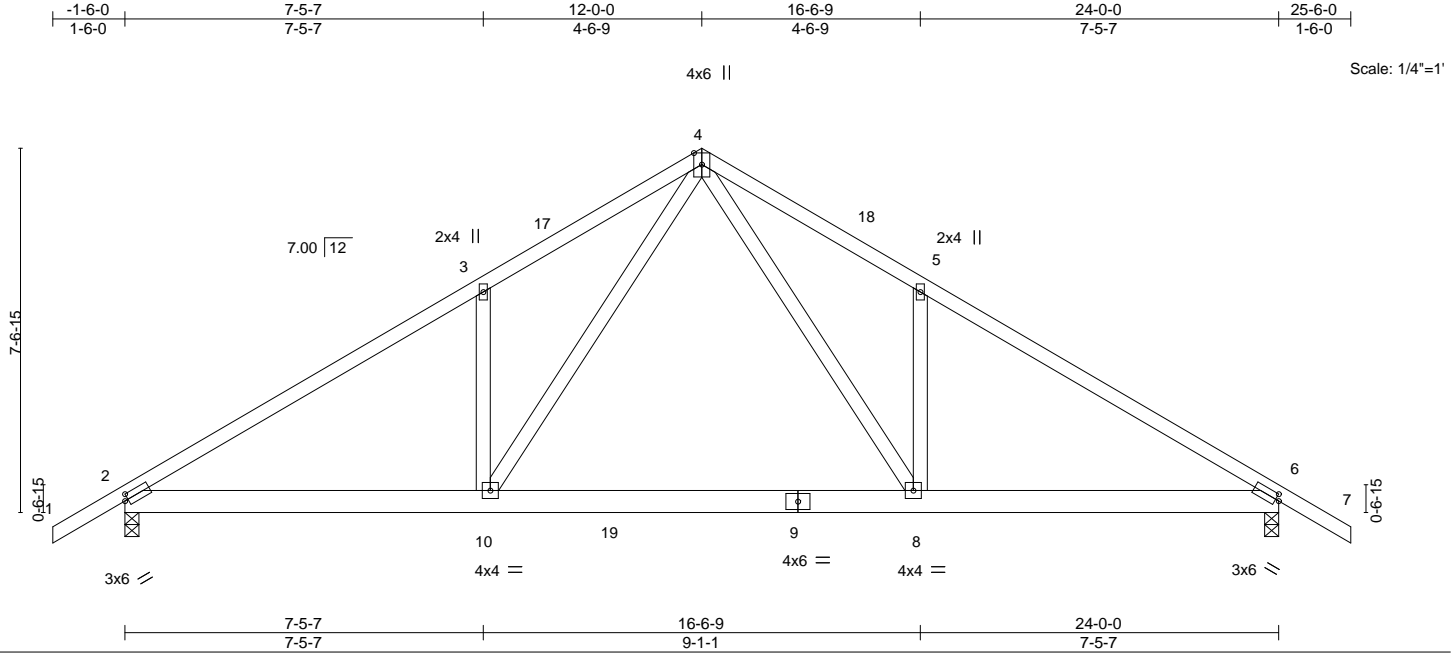

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.63	Vert(LL)	-0.19 8-10 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.85	Vert(CT)	-0.35 8-10 >824 180				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.51	Horz(CT)	0.03 6 n/a n/a				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 140 lb FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-8-5 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 6=0-3-8
Max Horz 2=185(LC 11)
Max Uplift 2=-320(LC 12), 6=-320(LC 13)
Max Grav 2=1373(LC 19), 6=1373(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2088/453, 3-4=-2104/602, 4-5=-2105/603, 5-6=-2089/454
BOT CHORD 2-10=-390/1840, 8-10=-188/1203, 6-8=-289/1727
WEBS 4-8=-378/1191, 5-8=-344/258, 4-10=-378/1190, 3-10=-344/258

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 25-6-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=320, 6=320.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-7=-54, 10-11=-20, 8-10=-80(F=-60), 8-14=-20

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183229
3130985	T01G	Common Structural Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:44 2022 Page 1

ID: ?NVDGqIbCtVYSOv1NEucG6zi0DO-Xn8QIULxkiiYbcVEI6BPExhduwNcU4ijC_EPNpZ?5Z5

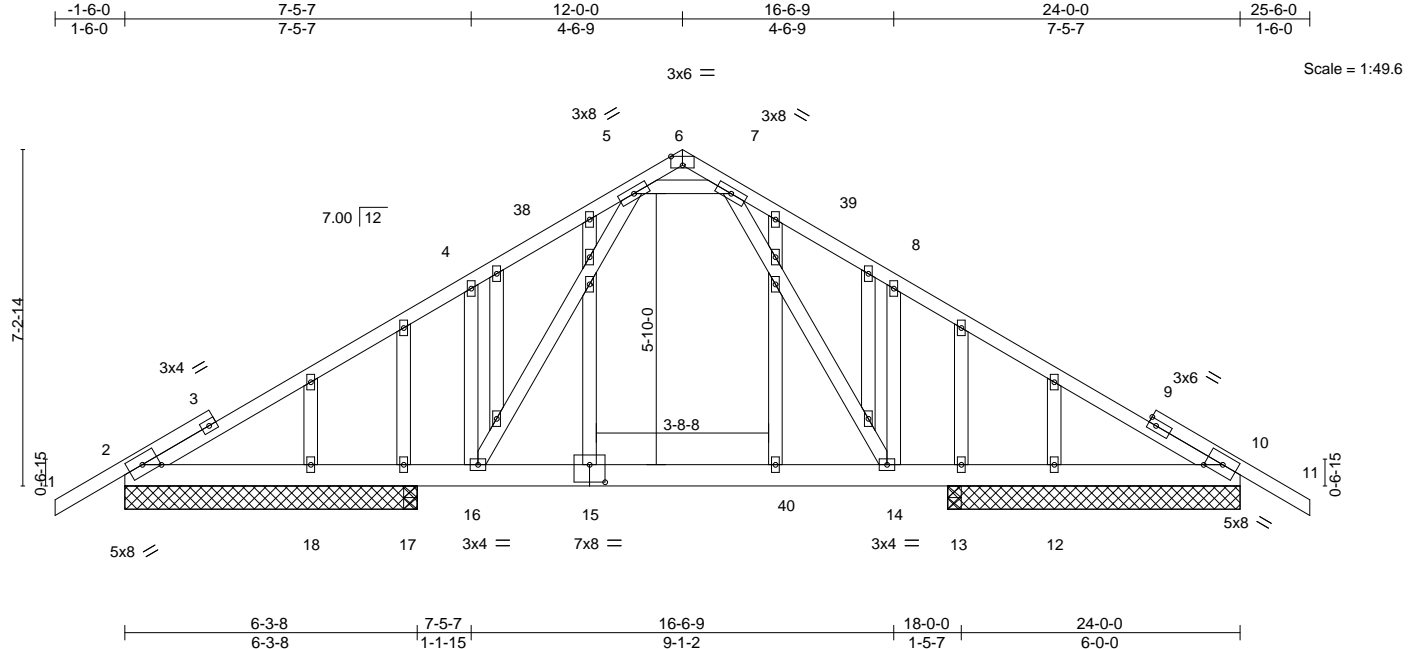

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.51	Vert(LL)	-0.12 14-16 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.50	Vert(CT)	-0.20 14-16 >717 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.11	Horz(CT)	0.01 35 n/a n/a				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 183 lb FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 6-3-8.
(lb) - Max Horz 2=-177(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 18, 12 except 17=-187(LC 12), 13=-171(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 18, 12 except 2=538(LC 19), 10=549(LC 20), 17=580(LC 19), 17=461(LC 1), 13=564(LC 20), 13=461(LC 1), 2=476(LC 1), 10=476(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-747/109, 4-5=-715/175, 7-8=-695/176, 8-10=-726/90
BOT CHORD 2-18=-5/605, 17-18=-5/605, 16-17=-5/605, 14-16=-2/482, 13-14=-6/606, 12-13=-6/606, 10-12=-6/606
WEBS 7-14=-44/274, 8-14=-325/228, 5-16=-45/273, 4-16=-325/228, 5-7=-391/141

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 25-6-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 18, 12, 2, 10 except (jt=lb) 17=187, 13=171.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183230
3130985	T02	Common	7	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:45 2022 Page 1

ID: ?NVDGqIbCtvYSOv1NEucG6zi0DO-?zhoyqLZV?tPCl4QJqiemlEmmKdODQVsQe_yJrz?5Z4

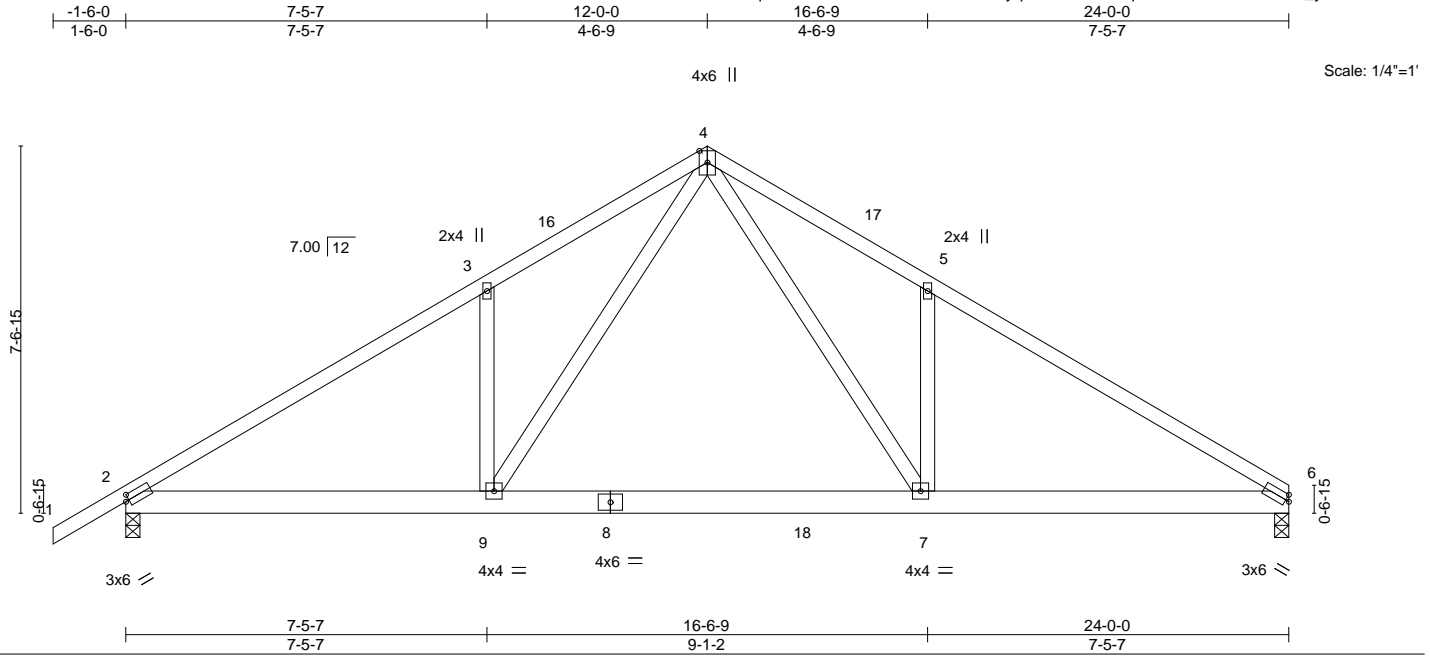

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.63	Vert(LL)	-0.18	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.85	Vert(CT)	-0.35				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.52	Horz(CT)	0.03				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 137 lb FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-7-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=0-3-8, 2=0-3-8
Max Horz 2=178(LC 11)
Max Uplift 6=285(LC 13), 2=321(LC 12)
Max Grav 6=1296(LC 20), 2=1375(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2091/454, 3-4=-2107/603, 4-5=-2119/611, 5-6=-2102/461
BOT CHORD 2-9=-404/1832, 7-9=-202/1196, 6-7=-305/1725
WEBS 4-7=-386/1205, 5-7=-346/259, 4-9=-378/1190, 3-9=-344/258

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) - 1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 24-0-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=285, 2=321.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-6=-54, 9-13=-20, 7-9=-80(F=-60), 7-10=-20

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183231
3130985	T02A	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,


8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:46 2022 Page 1

ID: ?NVDGqIbCtVYSOv1NEucG6zi0DO-TAFAA9MBGJ?GqvfdtXDtJynzAj0jyxZ?fljVrHz?5Z3



4x6 ||

Scale: 1/4"=1'

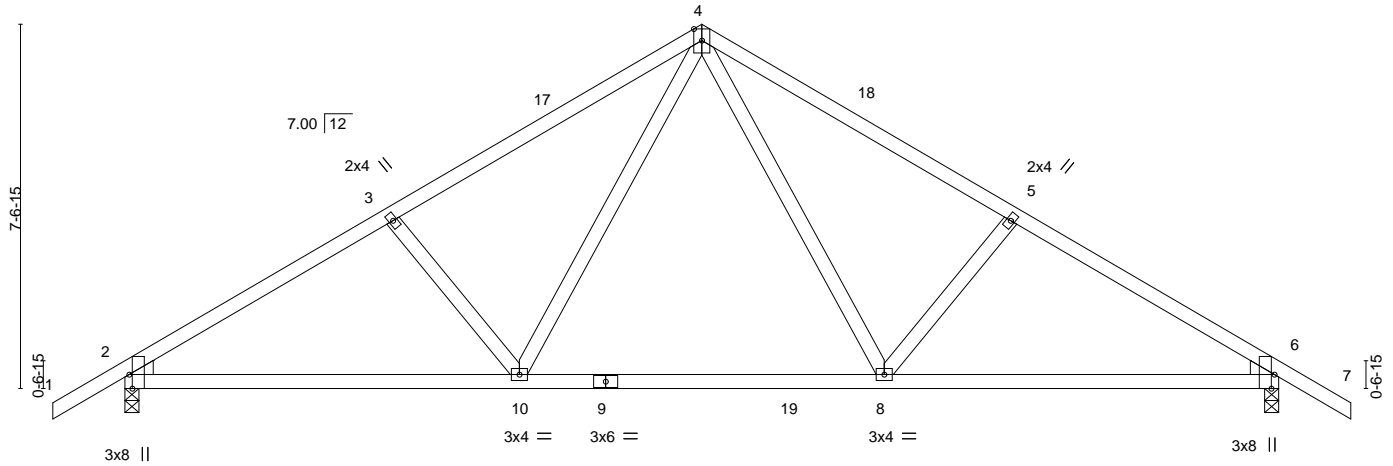

		8-2-7				15-9-9				24-0-0			
		8-2-7				7-7-1				8-2-7			
Plate Offsets (X,Y)-- [2:0-3-8,Edge], [6:0-3-8,Edge]													
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc)		l/defl		L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.46	Vert(LL)	-0.15	8-10	>999	240		MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.65	Vert(CT)	-0.23	8-10	>999	180			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.21	Horz(CT)	0.04	6	n/a	n/a			
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS								Weight: 120 lb	FT = 20%

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183232
3130985	T02G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:47 2022 Page 1

ID:?NVDGqIbCtVYSOv1NEucG6zi0DO-xMpYNVNp1d77S3EpREk6sAJ9E7ROhFR9uyT3Okz?5Z2

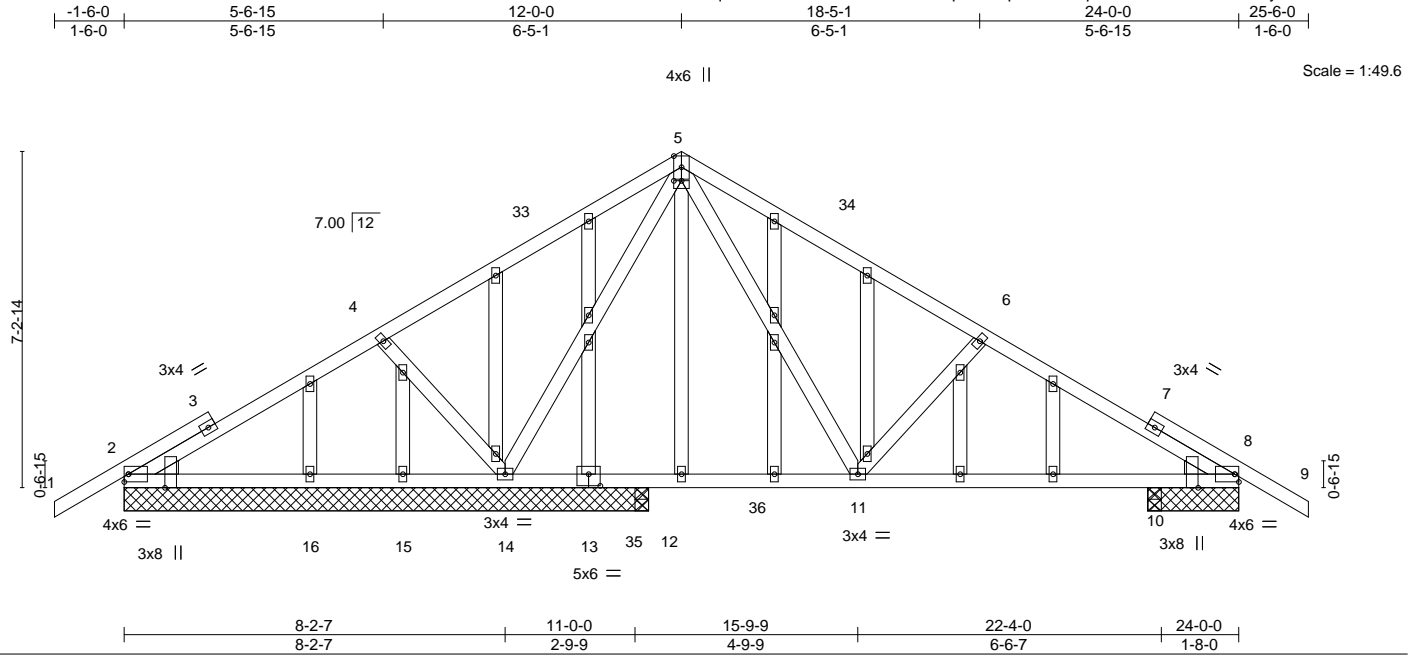


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [5:0-2-0,0-0-0], [8:0-3-8,Edge], [13:0-3-0,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.44	Vert(LL)	-0.03 10-11	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.36	Vert(CT)	-0.07 10-11	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.81	Horz(CT)	0.01 8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 175 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

All bearings 11-3-8 except (jt=length) 8=1-11-8, 12=0-3-8, 10=0-3-8.
 (lb) - Max Horz 2=177(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 2 except 8=196(LC 13), 14=291(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 15, 16, 12, 10 except 2=292(LC 23), 8=489(LC 24), 14=886(LC 19)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 4-5=-49/314, 5-6=-525/200, 6-8=-696/217
 BOT CHORD 10-11=-109/548, 8-10=-108/537
 WEBS 5-11=-157/509, 6-11=-330/238, 5-14=-669/171, 4-14=-338/236

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 25-6-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 8=196, 14=291.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183233
3130985	T03	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:48 2022 Page 1

ID:~NVDGqIbCtYsOV1NEucG6zi0DO-PYNwbrOSowF_3Dp?_yFLONsH8XfjQgyl6bCcwAz?5Z1

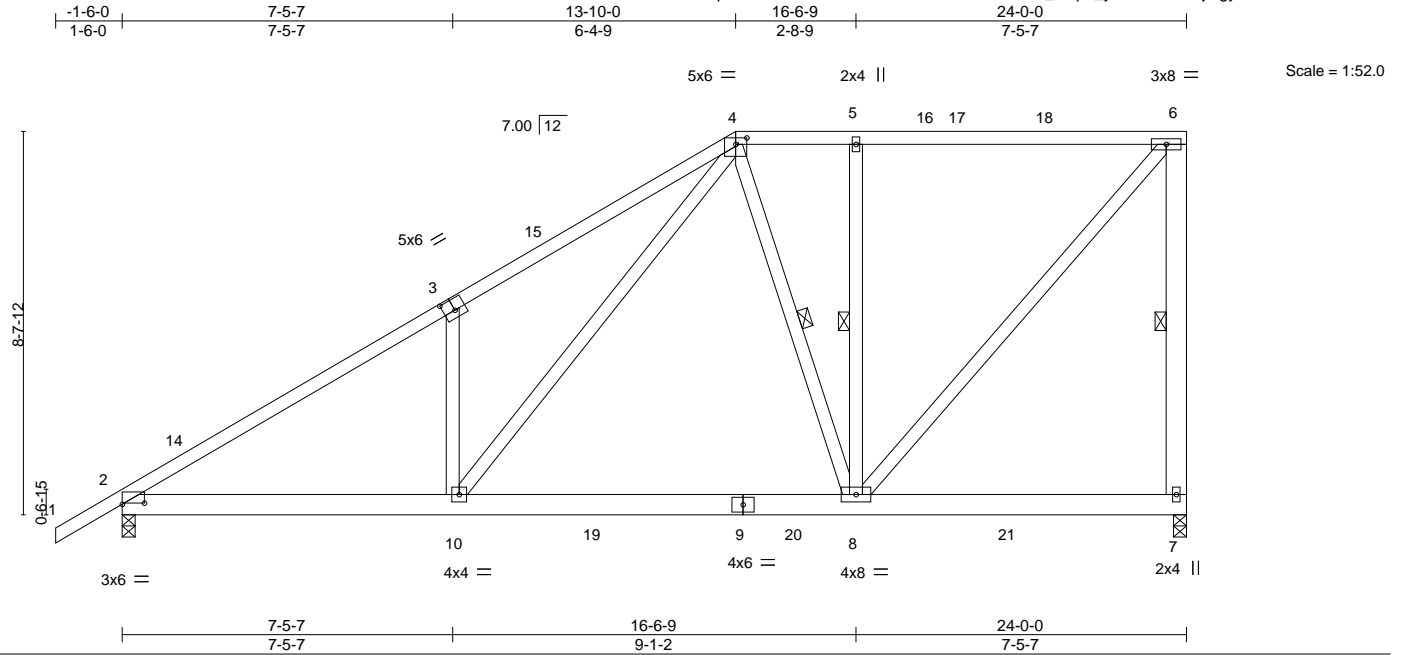


Plate Offsets (X,Y)-- [2:0-6-0,0-0-5], [3:0-3-0,0-3-0], [4:0-3-0,0-1-12]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.62	Vert(LL)	-0.17 8-10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.81	Vert(CT)	-0.32 8-10	>888	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.92	Horz(CT)	0.02 7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 177 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except*
6-7: 2x6 SP No.2

REACTIONS. (size) 7=0-3-8, 2=0-3-8
Max Horz 2=324(LC 12)
Max Uplift 7=329(LC 12), 2=321(LC 12)
Max Grav 7=1265(LC 2), 2=1364(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=2069/458, 3-4=2118/634, 4-5=905/274, 5-6=905/274, 6-7=1167/357
BOT CHORD 2-10=597/1776, 8-10=323/969
WEBS 3-10=410/298, 4-10=446/1318, 5-8=356/200, 6-8=413/1362

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 13-10-0, Exterior(2R) 13-10-0 to 18-0-15, Interior(1) 18-0-15 to 23-9-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=329, 2=321.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-6=-54, 10-11=-20, 8-10=-80(F=-60), 7-8=-20

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 9-5-5 oc bracing.
WEBS 1 Row at midpt 6-7, 4-8, 5-8

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183234
3130985	T04	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,
8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:49 2022 Page 1
ID:?NVDGqIbCtvYSOv1NEucG6zi0DO-tlxJoBO4ZENrhNNBYfmaxbPSmx?m9CgSLFyAScz?5Z0

-1-6-0
7-5-7
12-0-0
15-10-0
19-9-4
24-0-0

1-6-0
7-5-7
4-6-9
3-10-0
3-11-4
4-2-12

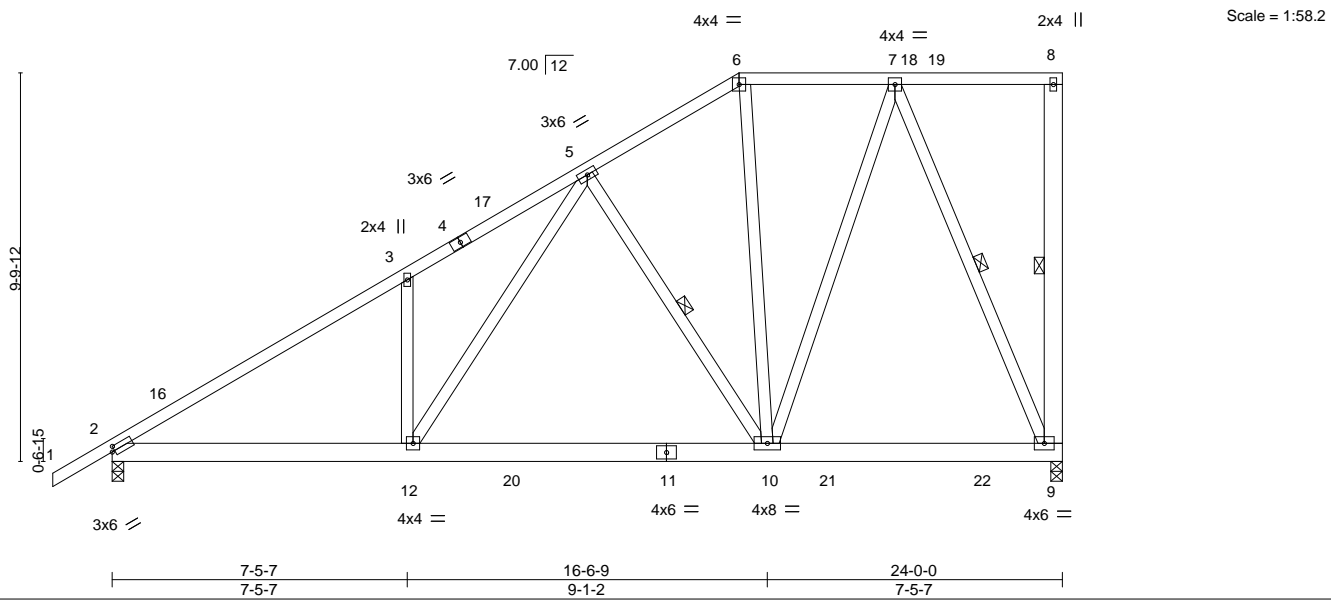


Plate Offsets (X,Y)-- [2:0-0-14,0-1-8]							
LOADING (psf)		SPACING-		CSI.		DEFL.	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.63	in (loc)	I/defl
TCDL	7.0	Lumber DOL	1.25	BC	0.82	Vert(LL)	>999
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.64	Vert(CT)	>934
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS		Horz(CT)	n/a
						PLATES	
						GRIP	
						Weight: 192 lb	
						FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-8-8 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 9-2-11 oc bracing.
WEBS	2x4 SP No.3 *Except*	WEBS	1 Row at midpt
	8-9: 2x6 SP No.2		8-9, 5-10, 7-9

REACTIONS. (size) 9=0-3-8, 2=0-3-8
Max Horz 2=367(LC 12)
Max Uplift 9=357(LC 12), 2=308(LC 12)
Max Grav 9=1255(LC 2), 2=1385(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2102/429, 3-5=-2112/573, 5-6=-958/251, 6-7=-818/249
BOT CHORD 2-12=-611/1809, 10-12=-414/1191, 9-10=-155/475
WEBS 3-12=-333/248, 5-12=-368/1156, 5-10=-741/309, 6-10=-34/325, 7-10=-294/1067, 7-9=-1207/398

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 15-10-0, Exterior(2R) 15-10-0 to 20-0-15, Interior(1) 20-0-15 to 23-9-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=357, 2=308.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-54, 6-8=-54, 12-13=-20, 10-12=-80(F=-60), 9-10=-20

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183235
3130985	T05	Half Hip	1	1	Job Reference (optional)	

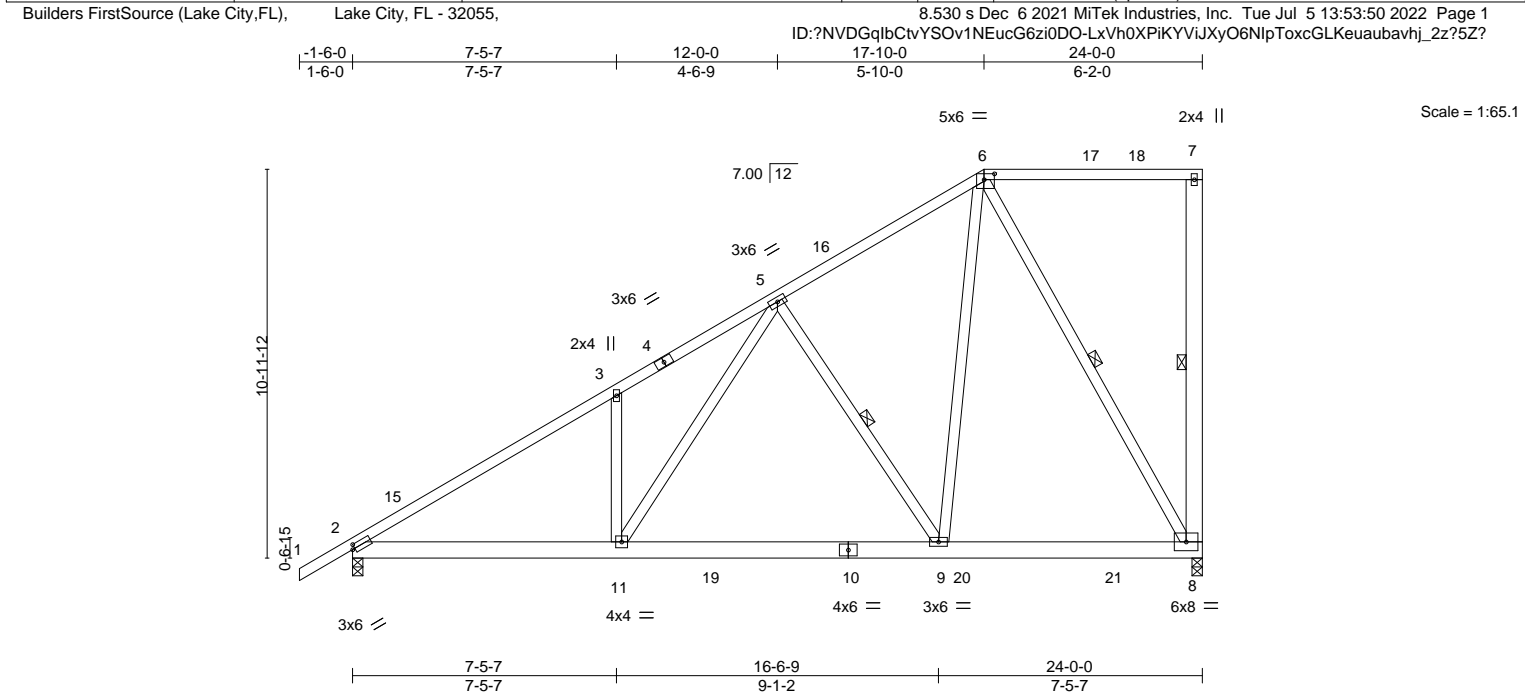


Plate Offsets (X,Y)--		[2:0-0-14,0-1-8], [6:0-3-8,0-2-0]									
LOADING	(psf)	SPACING-		CSI.		DEFL.	in	(loc)	I/defl	L/d	PLATES
TCLL	20.0	Plate Grip DOL	1.25	TC	0.64	Vert(LL)	-0.17	9-11	>999	240	MT20
TCDL	7.0	Lumber DOL	1.25	BC	0.84	Vert(CT)	-0.33	9-11	>869	180	GRIP
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.96	Horz(CT)	0.03	8	n/a	n/a	244/190
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							Weight: 186 lb
											FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-7-13 oc purlins, except end verticals.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 9-0-15 oc bracing.
WEBS	2x4 SP No.3 *Except*	WEBS	1 Row at midpt
	7-8: 2x6 SP No.2		7-8, 5-9, 6-8

REACTIONS. (size) 8=0-3-8, 2=0-3-8
Max Horz 2=410(LC 12)
Max Uplift 8=390(LC 12), 2=293(LC 12)
Max Grav 8=1287(LC 19), 2=1402(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2136/399, 3-5=-2136/536, 5-6=-982/230
BOT CHORD 2-11=-627/1849, 9-11=-438/1238, 8-9=-211/650
WEBS 3-11=-311/233, 5-11=-354/1143, 5-9=-798/349, 6-9=-331/1398, 6-8=-1321/429

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 17-10-0, Exterior(2R) 17-10-0 to 22-0-15, Interior(1) 22-0-15 to 23-9-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=390, 2=293.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-54, 6-7=-54, 11-12=-20, 9-11=-80(F=-60), 8-9=-20

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183236
3130985	T06	Piggyback Base	5	1	Job Reference (optional)	

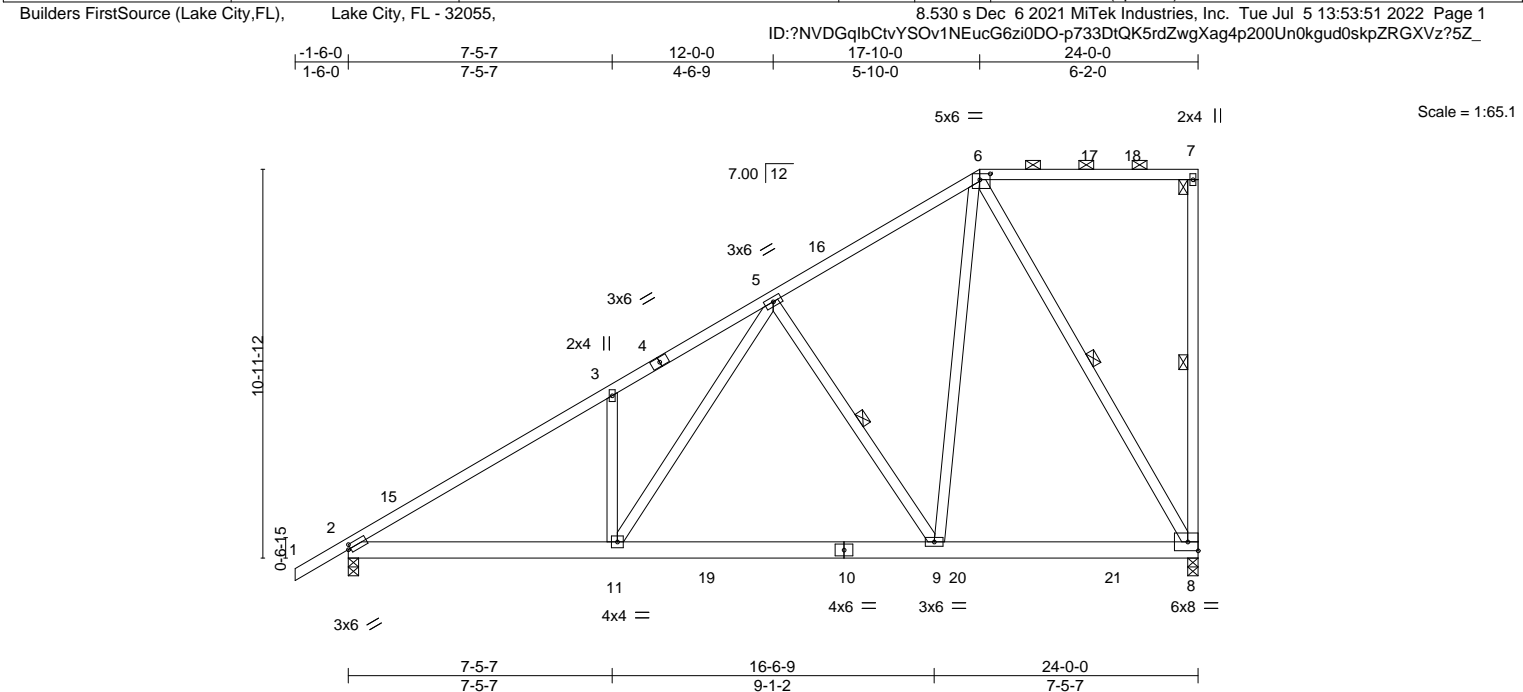


Plate Offsets (X,Y)--		[2:0-0-14,0-1-8], [6:0-3-8,0-2-0]									
LOADING	(psf)	SPACING-		CSI.		DEFL.	in	(loc)	I/defl	L/d	PLATES
TCLL	20.0	Plate Grip DOL	1.25	TC	0.64	Vert(LL)	-0.17	9-11	>999	240	MT20
TCDL	7.0	Lumber DOL	1.25	BC	0.84	Vert(CT)	-0.33	9-11	>872	180	GRIP
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.98	Horz(CT)	0.03	8	n/a	n/a	244/190
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							Weight: 177 lb
											FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-7-11 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 9-0-11 oc bracing.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 7-8, 5-9, 6-8

REACTIONS.	
(size)	8=0-3-8, 2=0-3-8
Max Horz	2=410(LC 12)
Max Uplift	8=391(LC 12), 2=295(LC 12)
Max Grav	8=1289(LC 19), 2=1407(LC 19)

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2145/402, 3-5=-2145/539, 5-6=-992/233
BOT CHORD	2-11=-630/1857, 9-11=-440/1246, 8-9=-214/658
WEBS	3-11=-311/233, 5-11=-354/1142, 5-9=-797/349, 6-9=-329/1401, 6-8=-1328/431

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 17-10-0, Exterior(2R) 17-10-0 to 22-0-15, Interior(1) 22-0-15 to 23-10-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=391, 2=295.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard	
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25	
Uniform Loads (plf)	
Vert: 1-6=-54, 6-7=-54, 11-12=-20, 9-11=-80(F=-60), 8-9=-20	

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:


July 6,2022

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183237
3130985	T07	Roof Special	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:52 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-IKcRQDRys9mQYq6mDoKHYD1xs8?gMaQu1DAq2xz?5Yz



4x4 =

Scale = 1:55.2


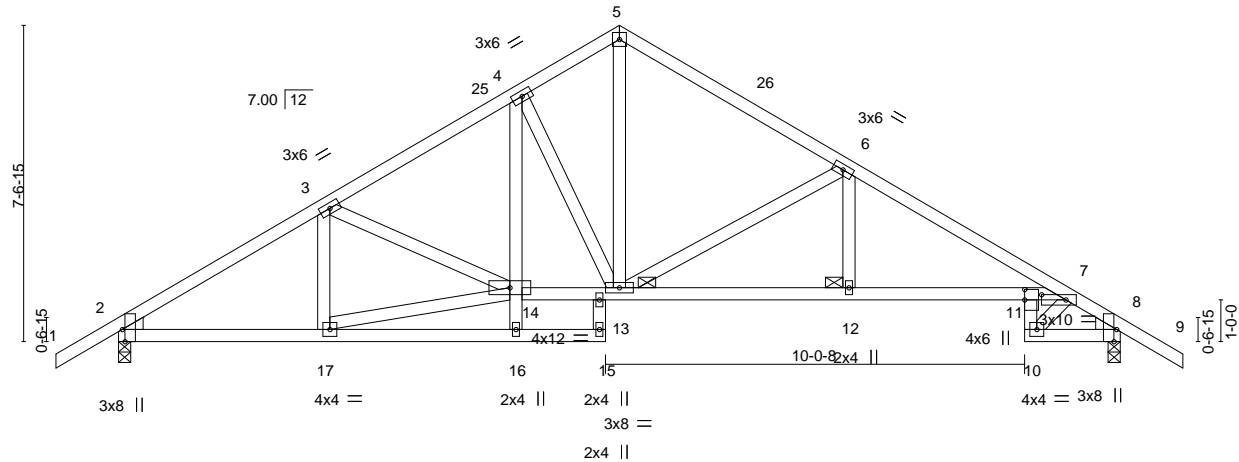


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [7:0-7-0,0-1-8], [8:0-3-8,Edge], [11:0-3-0,0-0-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.76	Vert(LL)	-0.21 11-12	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.93	Vert(CT)	-0.41 11-12	>704	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.57	Horz(CT)	0.17 8	n/a	n/a		
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-MS					Weight: 148 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2 *Except*
 4-16,10-11: 2x4 SP No.3, 7-14: 2x4 SP M 31
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-7-4 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
 2-2-0 oc bracing: 10-11.
 10-0-0 oc bracing: 14-16, 13-14, 12-13, 11-12
 JOINTS 1 Brace at Jt(s): 13, 12

REACTIONS.

(size) 2=0-3-8, 8=0-3-8
 Max Horz 2=-185(LC 10)
 Max Uplift 2=-231(LC 12), 8=-232(LC 13)
 Max Grav 2=993(LC 1), 8=988(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1391/287, 3-4=-1350/285, 4-5=-1056/275, 5-6=-1112/263, 6-7=-1804/340,
 7-8=-1212/271
 BOT CHORD 2-17=-281/1159, 4-14=-77/413, 13-14=-177/1111, 12-13=-206/1547, 11-12=-206/1547,
 7-11=-167/1326, 10-11=-126/804, 8-10=-160/892
 WEBS 14-17=-269/1105, 4-13=-526/195, 5-13=-202/849, 6-13=-762/273, 6-12=-13/407,
 7-10=-1014/175

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 25-6-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=231, 8=232.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183238
3130985	T08	Roof Special	2	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:53 2022 Page 1

ID: ?NVDGqIbCtVYSOv1NEucG6zi0DO-mWApeZRdTuGA_hznVrW5RZ5QYLc50a1GtwNaNz?5Yy



Scale = 1:54.4

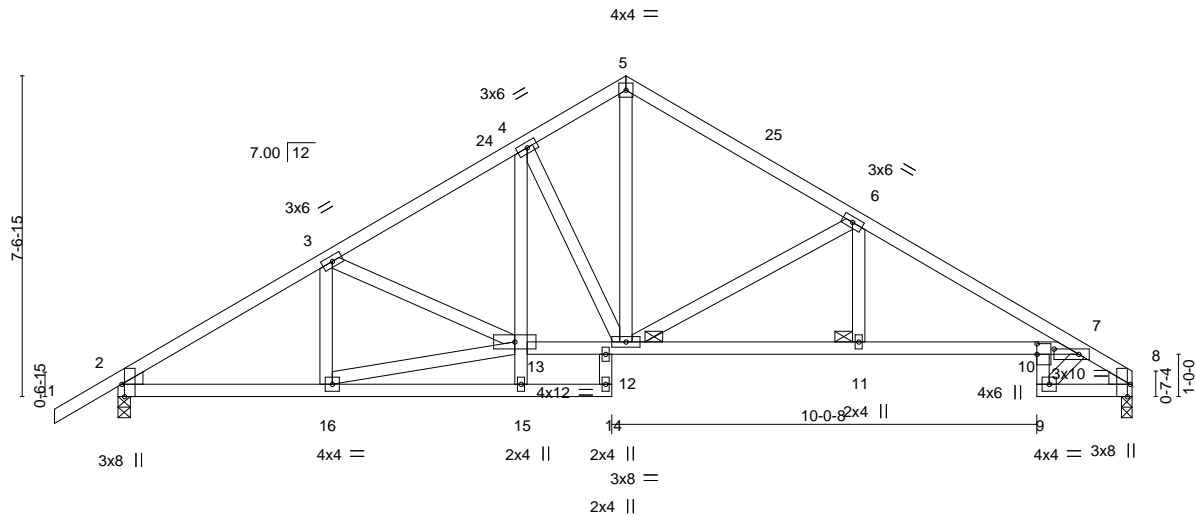


Plate Offsets (X,Y)--	[2:0-3-8,Edge], [7:0-7-0,0-1-8], [8:0-3-8,Edge], [10:0-3-0,0-0-0]
-----------------------	---

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.77	Vert(LL)	-0.21 10-11	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.95	Vert(CT)	-0.41 10-11	>701	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.58	Horz(CT)	0.17 8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 145 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2 *Except*
 4-15,9-10: 2x4 SP No.3, 7-13: 2x4 SP M 31
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

REACTIONS.

(size) 2=0-3-8, 8=0-3-0
 Max Horz 2=178(LC 9)
 Max Uplift 2=231(LC 12), 8=196(LC 13)
 Max Grav 2=994(LC 1), 8=903(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1393/287, 3-4=-1352/289, 4-5=-1058/280, 5-6=-1114/268, 6-7=-1812/361,
 7-8=-1232/289
 BOT CHORD 2-16=-295/1149, 4-13=-79/413, 12-13=-194/1113, 11-12=-247/1555, 10-11=-247/1555,
 7-10=-200/1328, 9-10=-172/827, 8-9=-207/915
 WEBS 13-16=-283/1096, 4-12=-525/197, 5-12=-205/852, 6-12=-768/288, 6-11=-24/404,
 7-9=-1040/230

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 23-11-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=231, 8=196.

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-3 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
 2-2-0 oc bracing: 9-10.
 10-0-0 oc bracing: 13-15, 12-13, 11-12, 10-11
 JOINTS 1 Brace at Jt(s): 12, 11

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183239
3130985	T09	Common	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:54 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-EikCruSDOm07n8G9LDMlee6L8ykhqZXBVXfw7qz?5Yx



4x6 ||

Scale: 1/4"=1'

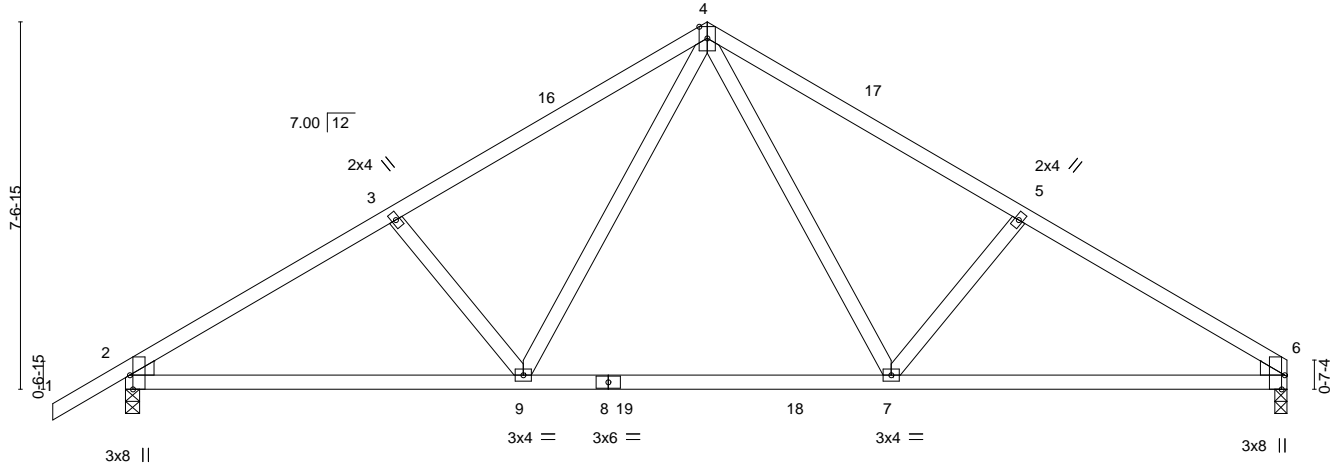


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [6:0-3-8,Edge]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.46	Vert(LL)	-0.15	7-9	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.64	Vert(CT)	-0.22	7-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.21	Horz(CT)	0.04	6	n/a	n/a		
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-MS						Weight: 117 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-4-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 6=0-3-0
Max Horz 2=178(LC 9)
Max Uplift 2=238(LC 12), 6=201(LC 13)
Max Grav 2=1097(LC 19), 6=1018(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1498/316, 3-4=-1346/313, 4-5=-1349/317, 5-6=-1502/321
BOT CHORD 2-9=-318/1363, 7-9=-109/880, 6-7=-213/1244
WEBS 4-7=-153/622, 5-7=-320/230, 4-9=-148/618, 3-9=-318/227

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-0-0, Exterior(2R) 12-0-0 to 15-0-0, Interior(1) 15-0-0 to 23-11-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=238, 6=201.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183240
3130985	T10	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:55 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-ivla3ETr948_PlrLvwT_AsfY3M7gZvxKjBPUfGz?5Yw

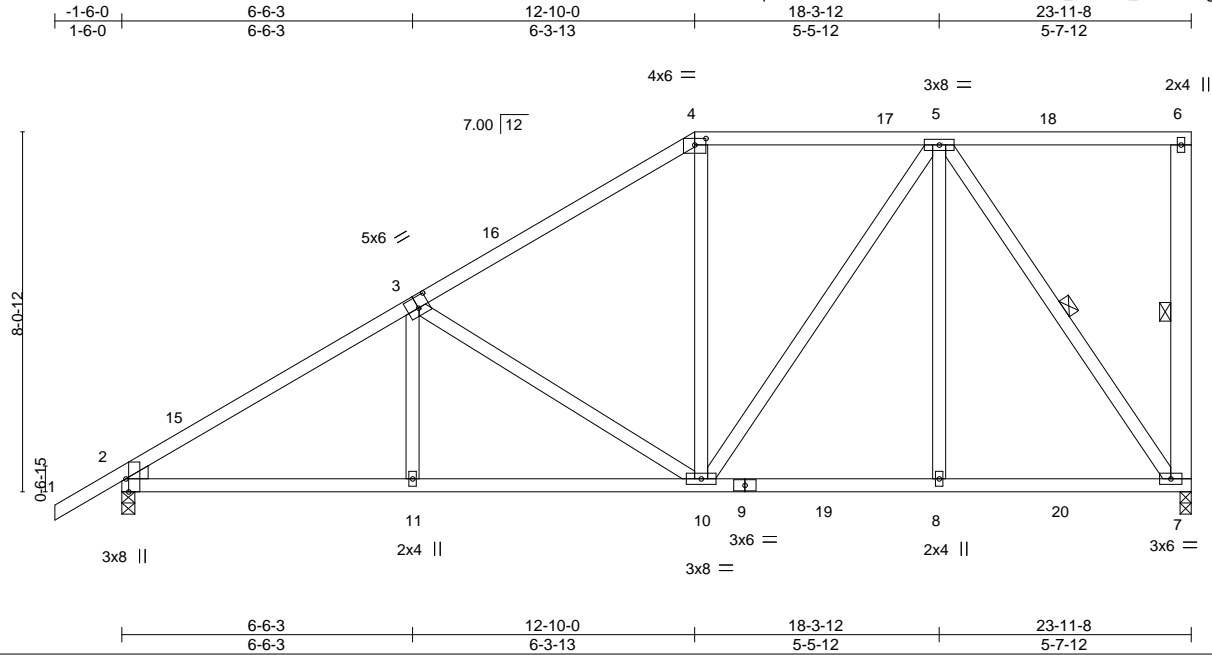


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [3:0-3-0,0-3-0], [4:0-3-0,0-1-12]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.38	Vert(LL)	-0.06 10-11	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.47	Vert(CT)	-0.12 10-11	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.65	Horz(CT)	0.03 7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 161 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
6-7: 2x6 SP No.2

WEDGE
Left: 2x4 SP No.3

REACTIONS.

(size) 7=0-3-0, 2=0-3-8
Max Horz 2=289(LC 11)
Max Uplift 7=254(LC 9), 2=267(LC 12)
Max Grav 7=997(LC 2), 2=1055(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1419/345, 3-4=-950/277, 4-5=-758/288
BOT CHORD 2-11=-352/1278, 10-11=-353/1275, 8-10=-203/569, 7-8=-203/569
WEBS 3-11=0/255, 3-10=-594/242, 5-10=-138/408, 5-8=0/312, 5-7=-974/248

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-10-0, Exterior(2R) 12-10-0 to 17-0-15, Interior(1) 17-0-15 to 23-8-12 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=254, 2=267.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183241
3130985	T11	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:56 2022 Page 1

ID: ?NVDGqIbCtVYSOv1NEucG6zi0DO-A5syGaUtVOGr1SQYsOdOj3BgplNylQoUyr81Biz75Yv

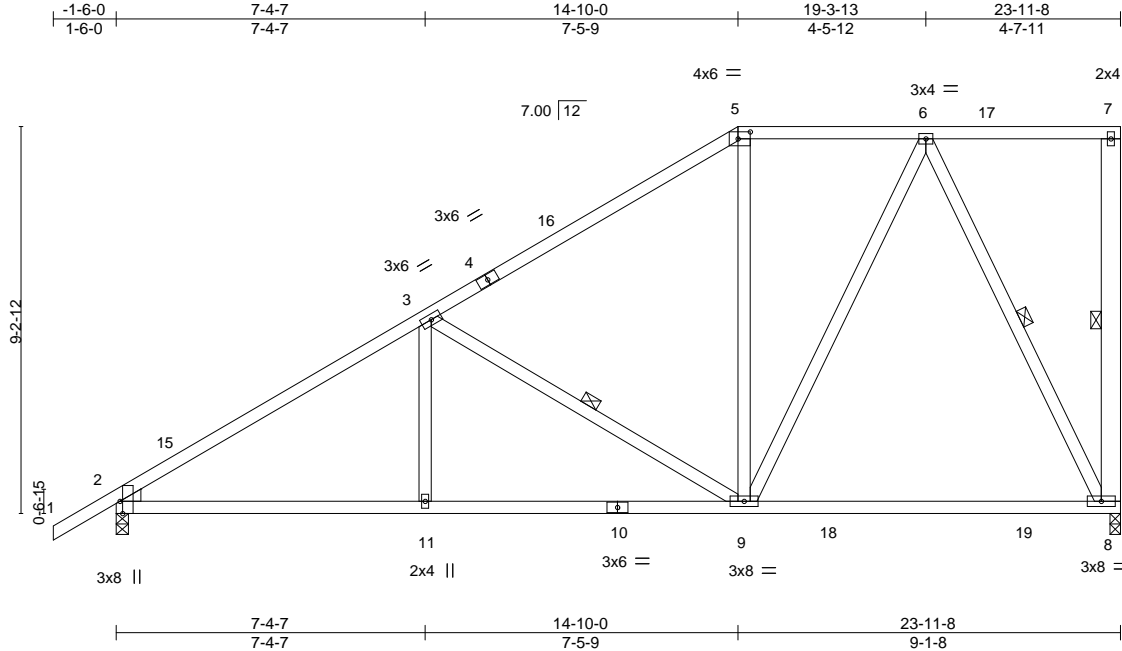


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [5:0-3-8,0-2-0]

LOADING (psf)	SPACING-	CSL.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.57	Vert(LL)	-0.29	8-9	>997	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.85	Vert(CT)	-0.44	8-9	>652	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.42	Horz(CT)	0.03	8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS						Weight: 159 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
7-8: 2x6 SP No.2

WEDGE
Left: 2x4 SP No.3

REACTIONS.

(size) 8=0-3-0, 2=0-3-8
Max Horz 2=331(LC 11)
Max Uplift 8=251(LC 9), 2=262(LC 12)
Max Grav 8=992(LC 2), 2=1068(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1406/333, 3-5=-831/241, 5-6=-639/265
BOT CHORD 2-11=-357/1284, 9-11=-357/1284, 8-9=-177/393
WEBS 3-11=0/281, 3-9=-698/293, 6-9=-168/673, 6-8=-815/252

NOTES-

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 14-10-0, Exterior(2R) 14-10-0 to 19-3-13, Interior(1) 19-3-13 to 23-8-12 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=251, 2=262.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183242
3130985	T12	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:57 2022 Page 1

ID:~NVDGqIbCtvYSOV1NEucG6zi0DO-eHQKUwV5ghOieb?k0LwSFHkrm9ID1oGdBVubj9z?5Yu

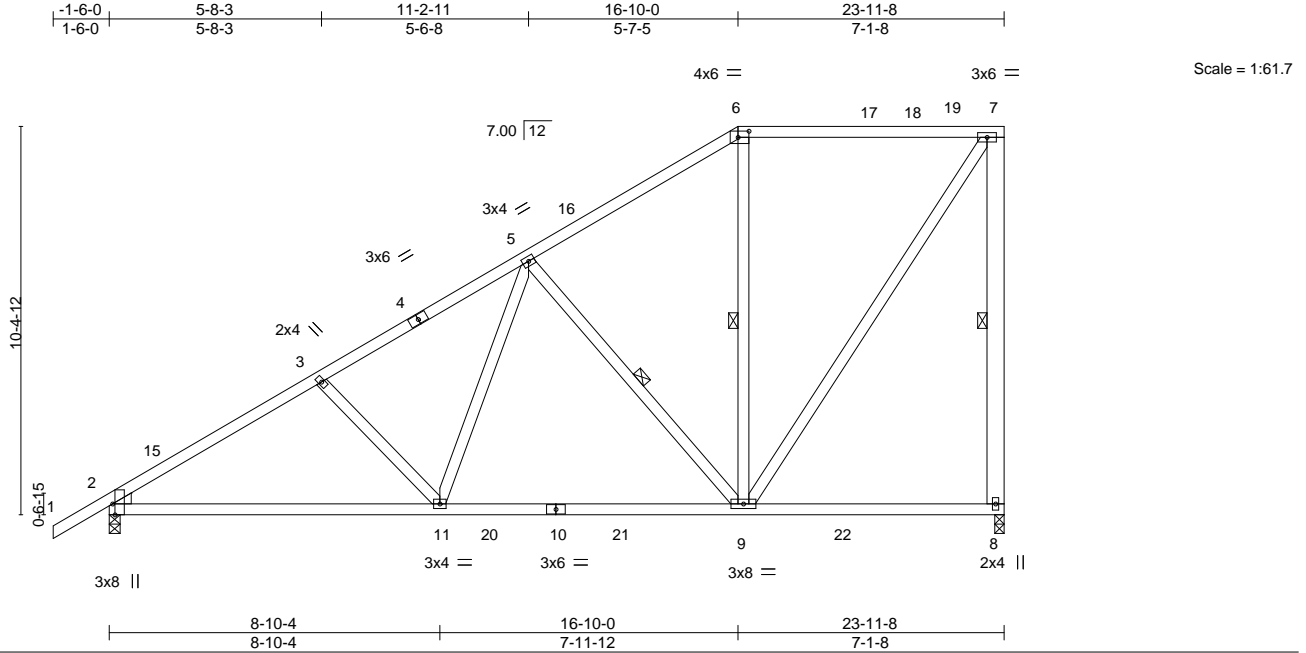


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [6:0-3-8,0-2-0]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.56	Vert(LL)	-0.13 9-11	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.72	Vert(CT)	-0.21 9-11	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.73	Horz(CT)	0.03 8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 164 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except*
7-8: 2x6 SP No.2

WEDGE

Left: 2x4 SP No.3

REACTIONS.

(size) 8=0-3-0, 2=0-3-8
Max Horz 2=373(LC 11)
Max Uplift 8=253(LC 12), 2=256(LC 12)
Max Grav 8=1019(LC 2), 2=1099(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1472/338, 3-5=-1301/320, 5-6=-664/225, 6-7=-505/238, 7-8=-880/275
BOT CHORD 2-11=-398/1377, 9-11=-306/1002
WEBS 3-11=-277/190, 5-11=-93/566, 5-9=-678/279, 7-9=-260/935

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 16-10-0, Exterior(2R) 16-10-0 to 21-0-15, Interior(1) 21-0-15 to 23-8-12 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=253, 2=256.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183243
3130985	T13	Piggyback Base	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:58 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-6T_1hGVjR?WZGIzwa2RhoUH2_Z3xmFhmQ9d8GbZ75Yt

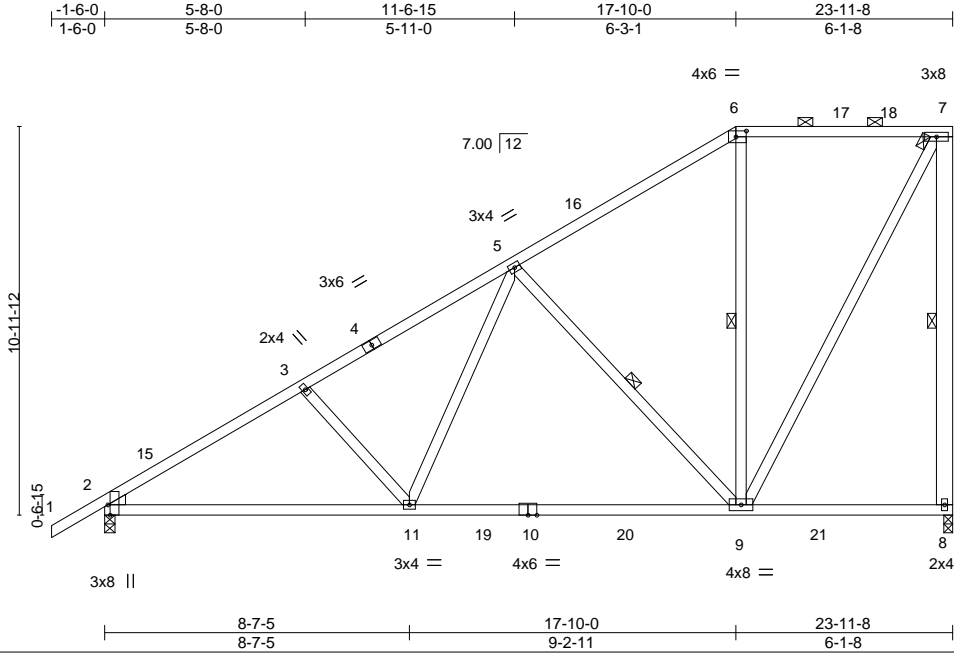


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [6:0-3-8,0-2-0]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.40	Vert(LL) -0.27	9-11	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.88	Vert(CT) -0.43	9-11	>661	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.74	Horz(CT) 0.03	8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS						
							Weight: 167 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3 *Except*
 7-8: 2x6 SP No.2

WEDGE

Left: 2x4 SP No.3

REACTIONS.

(size) 8=0-3-0, 2=0-3-8
 Max Horz 2=394(LC 11)
 Max Uplift 8=264(LC 12), 2=252(LC 12)
 Max Grav 8=1022(LC 19), 2=1103(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1498/329, 3-5=-1337/319, 5-6=-618/203, 6-7=-455/223, 7-8=-922/283
 BOT CHORD 2-11=-403/1405, 9-11=-306/989
 WEBS 3-11=-271/194, 5-11=-99/614, 5-9=-719/304, 7-9=-265/977

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 17-10-0, Exterior(2R) 17-10-0 to 22-0-15, Interior(1) 22-0-15 to 23-8-12 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=264, 2=252.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

July 6, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183244
3130985	T14	Piggyback Base	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:53:59 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-agY5ucWLCJeQuv868myxLipCqzTKViUwepNho1z?5Ys

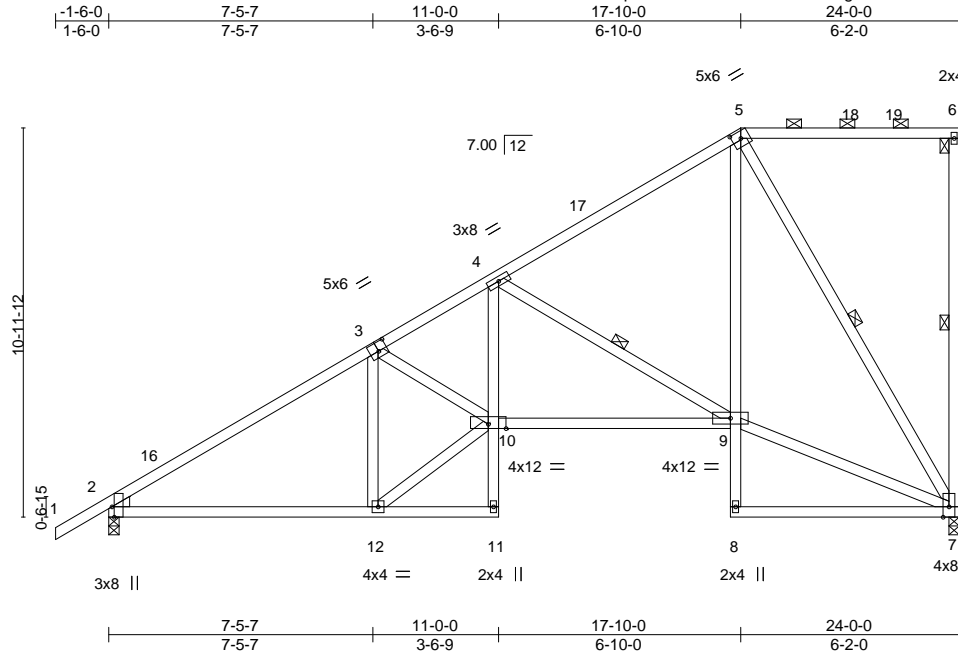

Scale = 1:65.0

Plate Offsets (X,Y)-- [2:0-3-8,Edge], [3:0-3-0,0-3-0], [5:0-3-0,0-2-5]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.46	Vert(LL)	-0.10	9-10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25		BC 0.61	Vert(CT)	-0.23	9-10	>999	180		
BCLL 0.0 *	Rep Stress Incr YES		WB 0.74	Horz(CT)	0.10	7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 176 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2 *Except*
 4-11,5-8: 2x4 SP No.3
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-3-13 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
 WEBS 1 Row at midpt 6-7, 4-9, 5-7

REACTIONS.

(size) 7=0-3-8, 2=0-3-8
 Max Horz 2=410(LC 12)
 Max Uplift 7=269(LC 12), 2=202(LC 12)
 Max Grav 7=880(LC 1), 2=966(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1279/211, 3-4=-1567/463, 4-5=-696/160
 BOT CHORD 2-12=-467/1035, 4-10=-250/703, 9-10=-593/1342, 5-9=-268/817
 WEBS 3-12=-632/351, 10-12=-574/1299, 3-10=-118/324, 4-9=-1002/463, 7-9=-196/524,
 5-7=-996/380

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 17-10-0, Exterior(2R) 17-10-0 to 22-0-15, Interior(1) 22-0-15 to 23-10-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=269, 2=202.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183245
3130985	T15	Piggyback Base	2	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:01 2022 Page 1

ID: ?NVDGqIbCtvYSOv1NEucG6zi0DO-X2frJlYckwu87DIVFB_PQ7uTjmDBzZQD67sosz?5Yq

1-6-0	6-1-15	12-0-0	18-2-0	25-9-12	32-8-0	38-10-0	44-8-1	50-10-0
1-6-0	6-1-15	5-10-1	6-2-0	7-7-12	6-10-4	6-2-0	5-10-1	6-1-15

Scale = 1:88.9

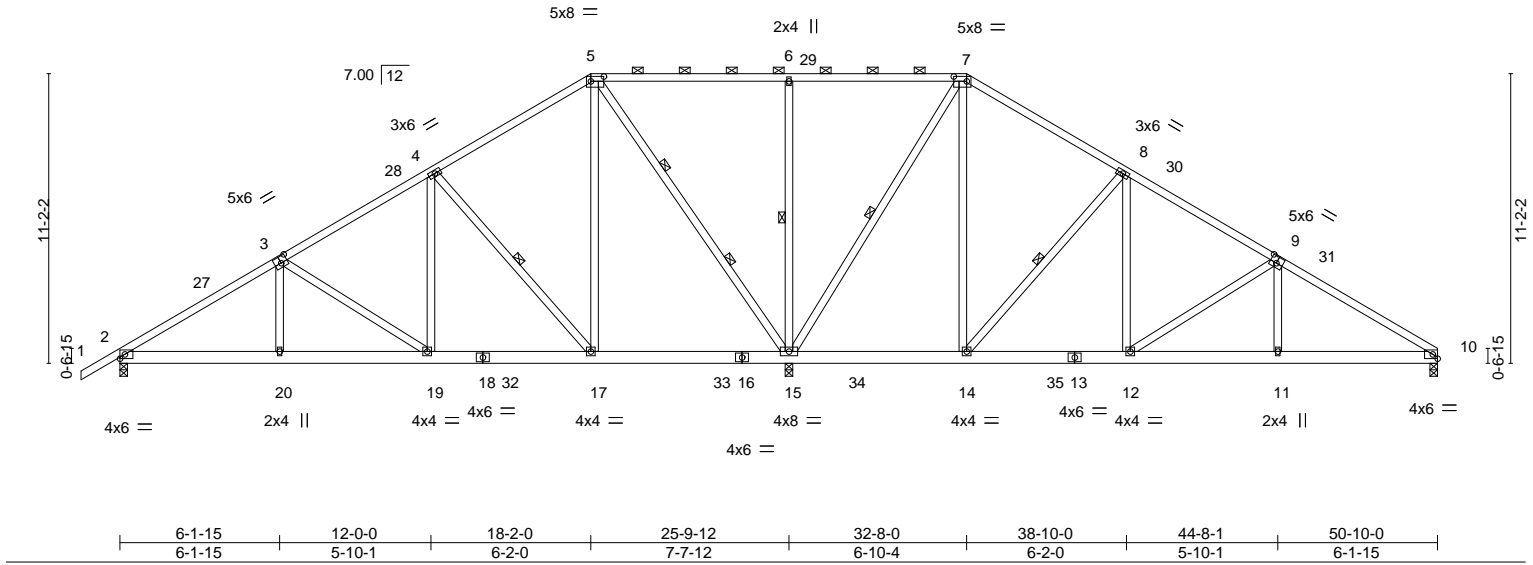


Plate Offsets (X,Y)--		[3:0-3-0,0-3-0], [5:0-6-0,0-2-4], [7:0-6-0,0-2-4], [9:0-3-0,0-3-0]
LOADING (psf)	SPACING-	2-0-0
TCLL 20.0	Plate Grip DOL	1.25
TCDL 7.0	Lumber DOL	1.25
BCLL 0.0 *	Rep Stress Incr	YES
BCDL 10.0	Code	FBC2020/TPI2014
	CSI.	
	TC	0.75
	BC	0.27
	WB	0.91
	Matrix-MS	
	DEFL.	
	in (loc)	I/defl L/d
	Vert(LL)	-0.05 17-19 >999 240
	Vert(CT)	-0.08 17-19 >999 180
	Horz(CT)	0.02 10 n/a n/a
	PLATES	GRIP
	MT20	244/190
	Weight: 367 lb FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-3-1 oc purlins, except
BOT CHORD 2x6 SP No.2	2-0-0 oc purlins (10-0-0 max.): 5-7.
WEBS 2x4 SP No.3 "Except"	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
5-15,7-15: 2x4 SP No.2	6-0-0 oc bracing: 15-17,14-15.
	WEBS 1 Row at midpt 4-17, 6-15, 7-15, 8-14
	2 Rows at 1/3 pts 5-15

REACTIONS. (size) 2=0-3-8, 15=0-3-8, 10=0-3-8
Max Horz 2=263(LC 9)
Max Uplift 2=227(LC 12), 15=519(LC 12), 10=205(LC 13)
Max Grav 2=898(LC 19), 15=2774(LC 2), 10=806(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1163/274, 3-4=-727/216, 5-6=-24/693, 6-7=-24/693, 8-9=-660/247,
9-10=-1149/311
BOT CHORD 2-20=-325/1116, 19-20=-325/1116, 17-19=-212/671, 15-17=-183/296, 12-14=-14/509,
11-12=-190/921, 10-11=-190/920
WEBS 3-19=-529/206, 4-19=-74/526, 4-17=-790/294, 5-17=-176/888, 5-15=-1337/355,
6-15=-456/243, 7-15=-1268/319, 7-14=-182/864, 8-14=-803/296, 8-12=-75/539,
9-12=-543/214

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 3-7-0, Interior(1) 3-7-0 to 18-2-0, Exterior(2R) 18-2-0 to 25-4-4, Interior(1) 25-4-4 to 32-8-0, Exterior(2R) 32-8-0 to 39-10-4, Interior(1) 39-10-4 to 50-10-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=227, 15=519, 10=205.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183246
3130985	T15G	Piggyback Base Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:03 2022 Page 1

ID: ?NVDGqIbCtVYSOV1NEucG6zi0DO-TRnbkzZsGX8sNWsuNc0tVY_z0azHRgEVZRLvxoz?5Yo

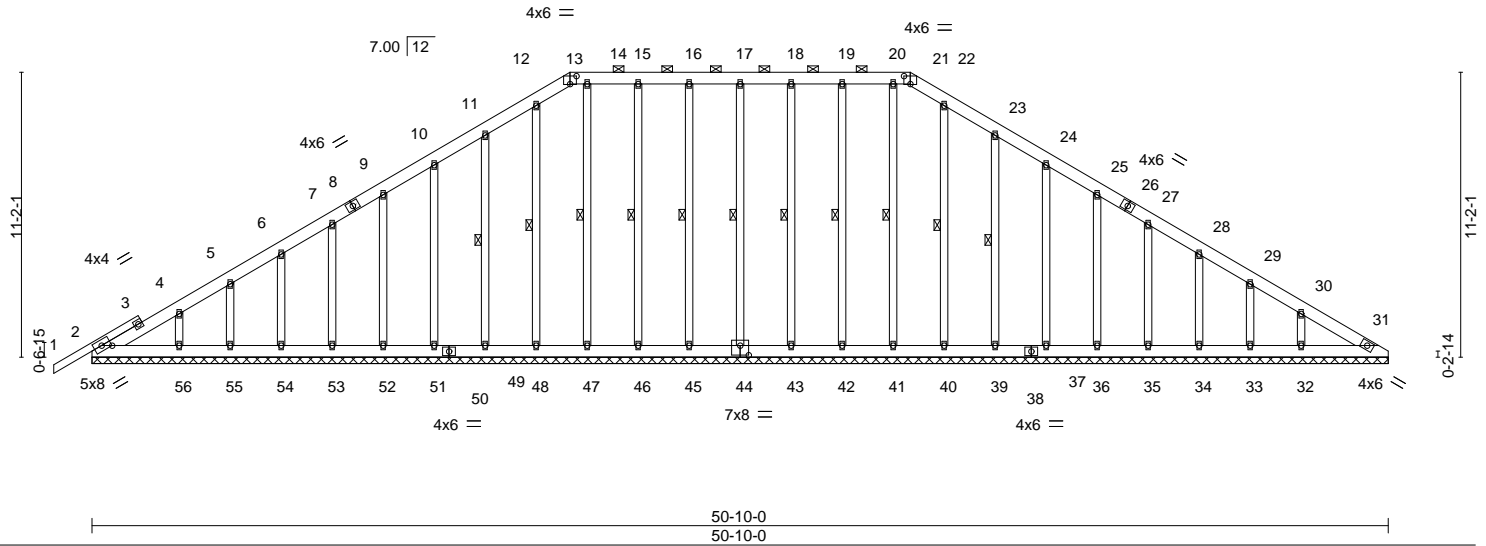

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.13	Vert(LL)	0.00	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.03	Vert(CT)	-0.00				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.01				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-S							
								Weight: 491 lb		FT = 20%	

LUMBER-

TOP CHORD 2x6 SP No.2 *Except*
1-3: 2x4 SP No.2
BOT CHORD 2x6 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 13-21.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 17-44, 16-45, 15-46, 14-47, 12-48, 11-49, 18-43, 19-42, 20-41, 22-40, 23-39

REACTIONS.

All bearings 50-10-0.
(lb) - Max Horz 2=262(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 2, 44, 45, 46, 47, 48, 49, 51, 52, 53, 54, 55, 56, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33, 31 except 32=105(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 44, 45, 46, 47, 48, 49, 51, 52, 53, 54, 55, 56, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33, 32, 31

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) -1-6-0 to 3-5-0, Exterior(2N) 3-5-0 to 18-8-15, Corner(3R) 18-8-15 to 23-9-15, Exterior(2N) 23-9-15 to 32-1-1, Corner(3R) 32-1-1 to 37-5-0, Exterior(2N) 37-5-0 to 50-4-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 44, 45, 46, 47, 48, 49, 51, 52, 53, 54, 55, 56, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33, 31 except (jt=lb) 32=105.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183247
3130985	T16	Piggyback Base	1	1	Job Reference (optional)	


Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:05 2022 Page 1

ID:NVdGqIbCtVYSOV1NEucG6zi0DO-PqvM9fb6o9OZcqcGU03Laz3F1Oa9vNxo1lq0?hz?5Ym

1-6-0	6-1-15	12-0-0	18-2-0	25-9-12	32-2-0	39-2-0	45-4-0	51-2-1	57-4-0
1-6-0	6-1-15	5-10-1	6-2-0	7-7-12	6-4-4	7-0-0	6-2-0	5-10-1	6-1-15

Scale = 1:97.4

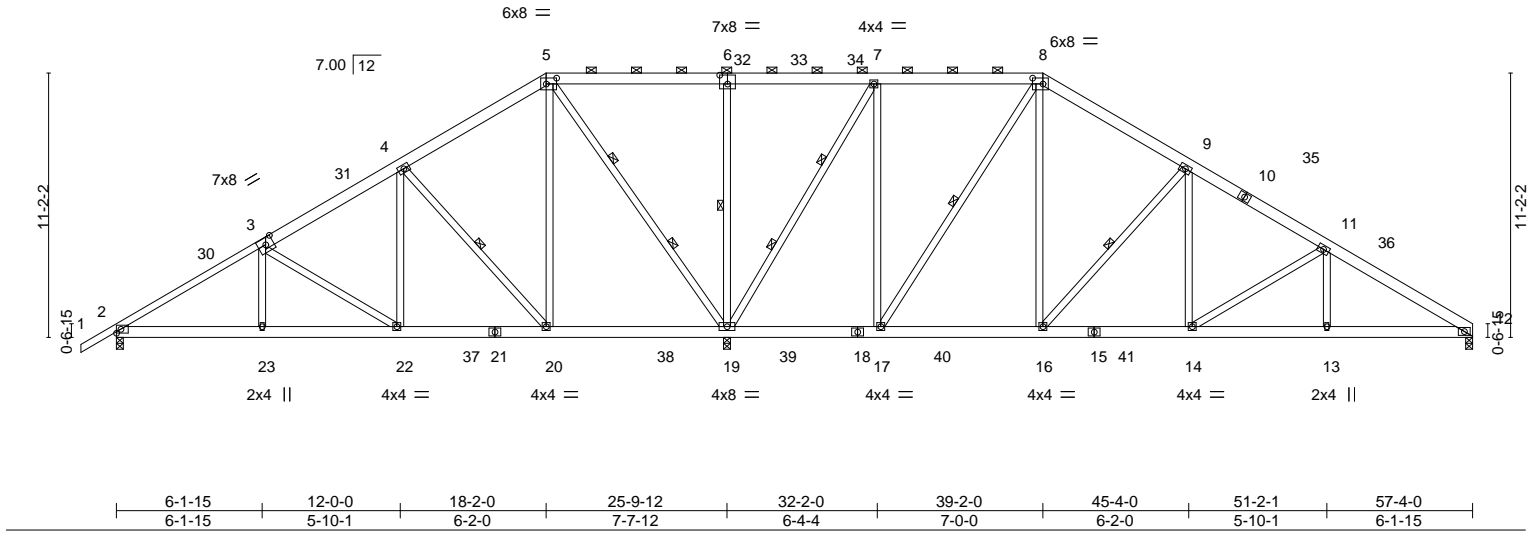

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.35	Vert(LL)	-0.07 14-16 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.33	Vert(CT)	-0.12 14-16 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.87	Horz(CT)	0.04 12 n/a n/a				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							
								Weight: 470 lb		FT = 20%	

LUMBER-

TOP CHORD 2x6 SP No.2 *Except*
1-3: 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except*
5-19,8-17: 2x4 SP No.2

REACTIONS.

(size) 2=0-3-8, 19=0-3-8 (req. 0-3-9), 12=0-3-8
Max Horz 2=262(LC 11)
Max Uplift 2=228(LC 12), 19=576(LC 12), 12=296(LC 13)
Max Grav 2=887(LC 19), 19=3024(LC 2), 12=1127(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1137/275, 3-4=-689/220, 5-6=-23/725, 6-7=-23/724, 8-9=-788/355,
9-11=-1296/424, 11-12=-1766/488
BOT CHORD 2-23=-322/1094, 22-23=-322/1085, 20-22=-188/656, 19-20=-163/287, 16-17=-30/628,
14-16=-163/1065, 13-14=-344/1474, 12-13=-344/1474
WEBS 3-22=-519/206, 4-22=-78/529, 4-20=-789/292, 5-20=-173/884, 5-19=-1353/353,
6-19=-417/217, 7-19=-1523/384, 7-17=-139/1057, 8-17=-942/216, 8-16=-182/891,
9-16=-793/295, 9-14=-74/529, 11-14=-549/213

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 4-2-13, Interior(1) 4-2-13 to 18-2-0, Exterior(2R) 18-2-0 to 26-3-5, Interior(1) 26-3-5 to 39-2-0, Exterior(2R) 39-2-0 to 47-3-5, Interior(1) 47-3-5 to 57-4-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 4x6 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- WARNING: Required bearing size at joint(s) 19 greater than input bearing size.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=228, 19=576, 12=296.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183248
3130985	T16G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,


8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:07 2022 Page 2
ID:?NVDGqIbCtVYSOv1NEucG6zi0DO-LC06aLcMKmeHr8IfcR5pfO8c6BGVNGg5U3J74Zz?5Yk

NOTES-
11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183249
3130985	T17	Piggyback Base	5	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL),		Lake City, FL - 32055,		8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:09 2022 Page 1						
ID:?NVDGqIbCtVSOv1NEucG6zi0DO-lb8s?1edsNv?5Rv1js7HlpEx1?yZrByOxNoD8Sz?5Yi										
1-6-0	6-1-15	12-0-0	18-2-0	25-9-12	32-2-0	39-2-0	45-4-0	51-2-1	54-0-7	57-4-0
1-6-0	6-1-15	5-10-1	6-2-0	7-7-12	6-4-4	7-0-0	6-2-0	5-10-1	2-10-6	3-3-9

Scale = 1:100.8

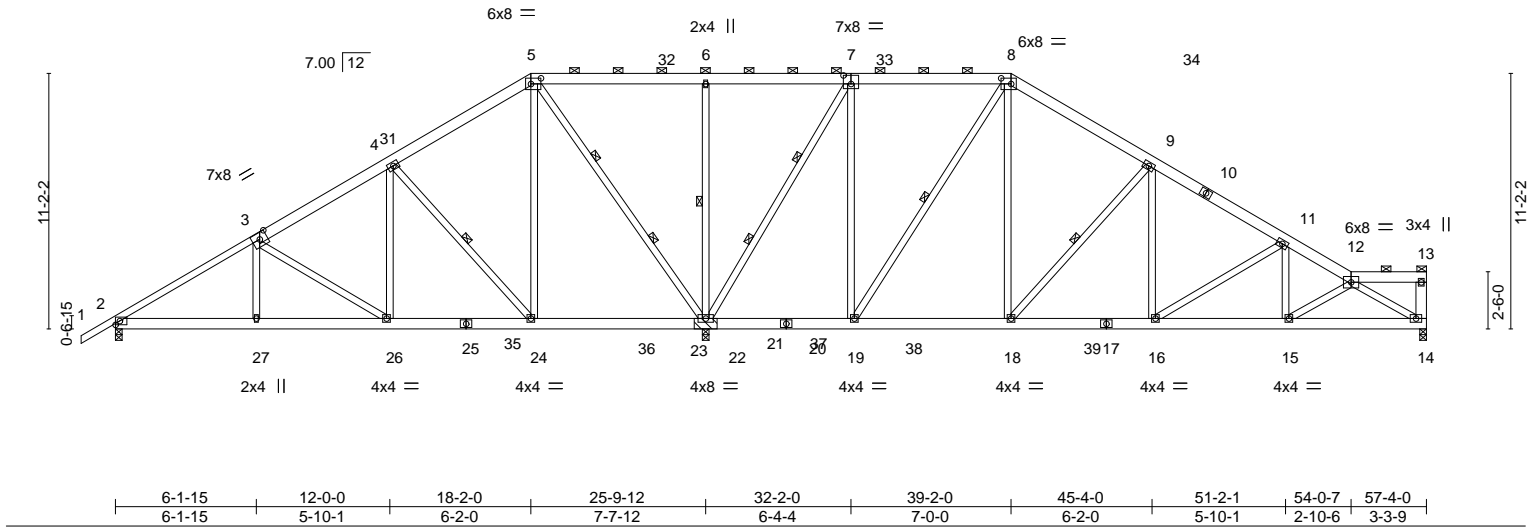

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.35	Vert(LL)	-0.07 16-18	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.30	Vert(CT)	-0.12 16-18	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.87	Horz(CT)	0.04 14	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 485 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* 1-3: 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-3-11 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-8, 12-13.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS 2x4 SP No.3 *Except* 13-14: 2x6 SP No.2, 5-22, 8-19: 2x4 SP No.2	WEBS 6-0-0 oc bracing: 22-24. 1 Row at midpt 4-24, 6-22, 8-19, 9-18 2 Rows at 1/3 pts 5-22, 7-22

REACTIONS.	(size) 14=0-3-8, 2=0-3-8, 22=(0-3-8 + bearing block) (req. 0-3-9)
	Max Horz 2=289(LC 11)
	Max Uplift 14=-245(LC 13), 2=-214(LC 12), 22=-422(LC 12)
	Max Grav 14=1071(LC 26), 2=885(LC 19), 22=3022(LC 2)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-1132/249, 3-4=-687/193, 5-6=-38/730, 6-7=-38/730, 8-9=-772/257, 9-11=-1264/307, 11-12=-1615/348
BOT CHORD	2-27=-303/1088, 26-27=-304/1080, 24-26=-200/650, 18-19=-27/613, 16-18=-163/1041, 15-16=-305/1385, 14-15=-332/1360
WEBS	3-26=-519/206, 4-26=-77/529, 4-24=-789/296, 5-24=-177/884, 5-22=-1356/304, 6-22=-417/217, 7-22=-1518/308, 7-19=-137/1043, 8-19=-924/212, 8-18=-177/872, 9-18=-770/292, 9-16=-56/489, 11-16=-463/167, 12-14=-1561/373

- NOTES-**
- 1) 2x6 SP No.2 bearing block 12" long at jt. 22 attached to front face with 3 rows of 10d (0.131"x3") nails spaced 3" o.c. 12 Total fasteners. Bearing is assumed to be SP No.2.
 - 2) Unbalanced roof live loads have been considered for this design.
 - 3) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 4-2-13, Interior(1) 4-2-13 to 18-2-0, Exterior(2R) 18-2-0 to 23-10-13, Interior(1) 23-10-13 to 39-2-0, Exterior(2R) 39-2-0 to 44-10-13, Interior(1) 44-10-13 to 57-1-4 zone; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 5) Provide adequate drainage to prevent water ponding.
 - 6) All plates are 4x6 MT20 unless otherwise indicated.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=245, 2=214, 22=422.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183250
3130985	T18	Piggyback Base	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:10 2022 Page 1

ID:~NVDGqIbCtvYSOv1NEucG6zi0DO-mniFCNfCh1sibUEHafWH0m3tPGPaewXA1Xnhuz?5Yh

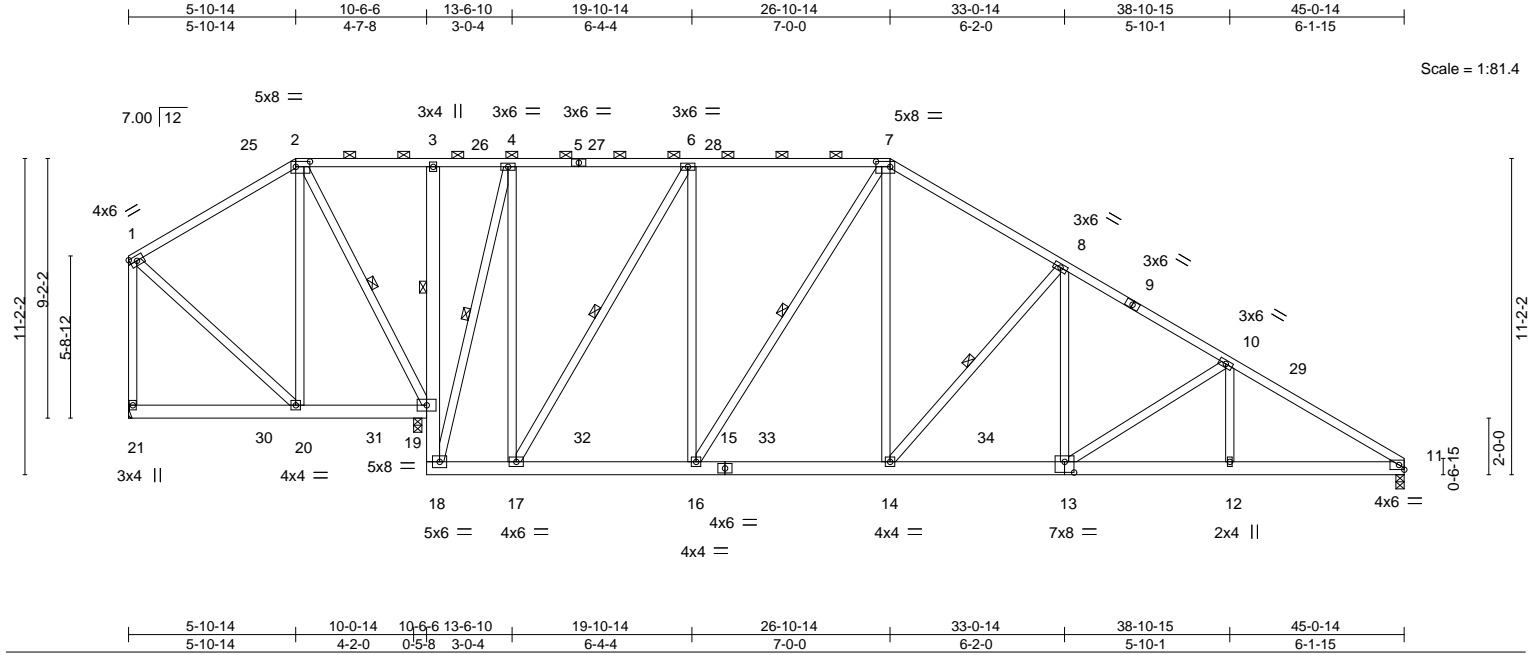


Plate Offsets (X,Y)--		[2:0-6-0,0-2-4], [7:0-6-0,0-2-4], [13:0-4-0,0-4-8]													
LOADING	(psf)	SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP				
TCLL	20.0	Plate Grip DOL	1.25	TC	0.53	Vert(LL)	-0.11 13-14	>999	240	MT20	244/190				
TCDL	7.0	Lumber DOL	1.25	BC	0.39	Vert(CT)	-0.18 13-14	>999	180						
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.89	Horz(CT)	0.02 11	n/a	n/a						
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS											
											Weight: 386 lb	FT = 20%			

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except*
6-17,7-16: 2x4 SP No.2

REACTIONS.

(size) 21=Mechanical, 19=0-3-8, 11=0-3-8
Max Horz 21=-319(LC 13)
Max Uplift 21=-204(LC 13), 19=-434(LC 9), 11=-402(LC 13)
Max Grav 21=365(LC 25), 19=2020(LC 2), 11=1459(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-68/271, 3-4=-75/281, 4-6=-311/354, 6-7=-892/491, 7-8=-1386/563,
8-10=-1921/628, 10-11=-2360/677, 1-21=-287/311
BOT CHORD 20-21=-174/314, 18-19=-255/1422, 17-18=-59/281, 16-17=-108/892, 14-16=-149/1142,
13-14=-340/1572, 12-13=-504/1963, 11-12=-504/1963
WEBS 2-19=-463/170, 4-18=-1425/293, 4-17=-226/1200, 6-17=-1205/269, 6-16=-32/766,
7-16=-531/87, 7-14=-181/876, 8-14=-786/293, 8-13=-69/515, 10-13=-485/196

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-7-13, Interior(1) 4-7-13 to 5-10-14, Exterior(2R) 5-10-14 to 12-3-6, Interior(1) 12-3-6 to 26-10-14, Exterior(2R) 26-10-14 to 33-0-14, Interior(1) 33-0-14 to 45-0-14 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 21=204, 19=434, 11=402.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183251
3130985	T18G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:12 2022 Page 1

ID: ?NVDGqIbCtvYSOv1NEucG6zi0DO-iAq?d2gV8IHayvecO?h_MRsRmC_e1YMqeK0tlnz?5Yf

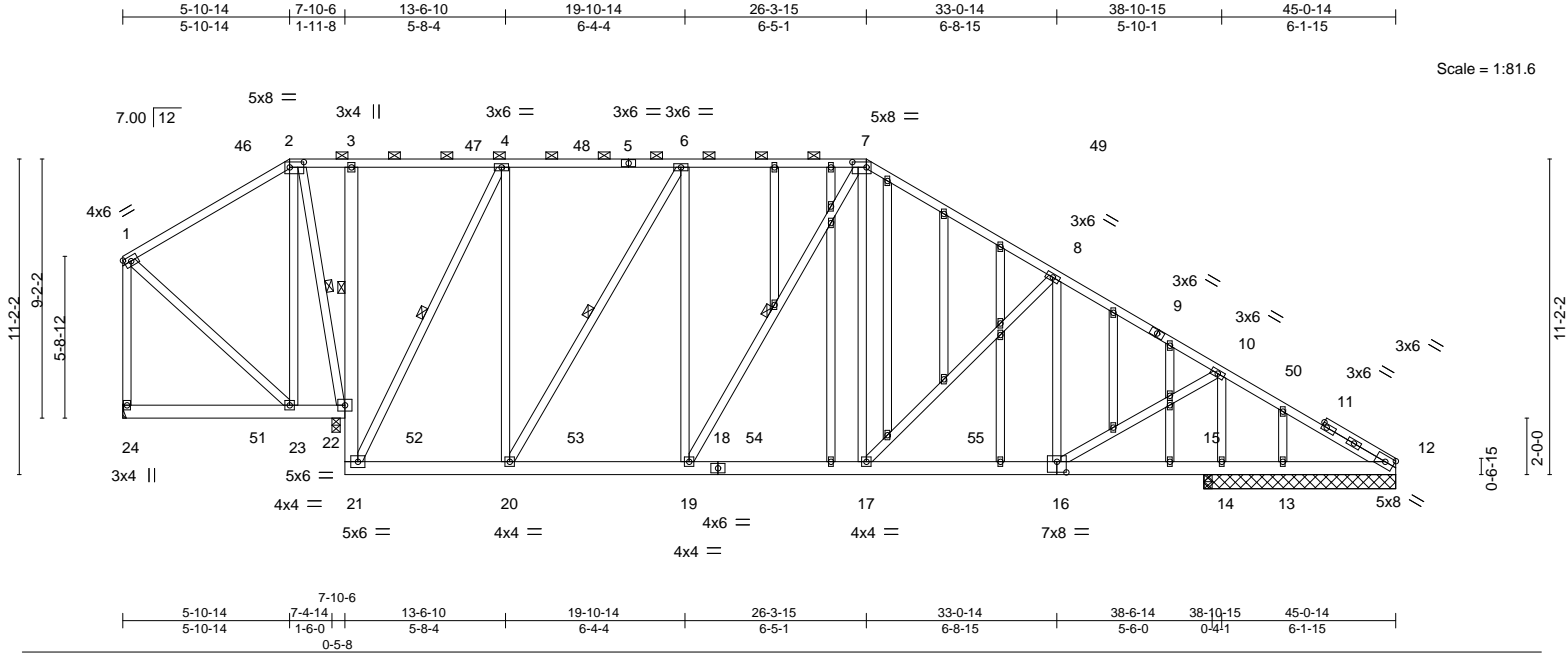

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.45	Vert(LL)	-0.05 17-19 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.27	Vert(CT)	-0.09 16-17 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.89	Horz(CT)	0.03 12 n/a n/a				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							
								Weight: 460 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-3 oc purlins, except end verticals, and 2-0-0 oc purlins (5-10-8 max.): 2-7.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing. Except:
WEBS	2x4 SP No.3 *Except*		1 Row at midpt 3-22
	6-20,7-19: 2x4 SP No.2		2-22, 4-21, 6-20, 7-19
OTHERS	2x4 SP No.3	WEBS	1 Row at midpt

REACTIONS.	
All bearings 6-9-8 except (jt=length) 24=Mechanical, 22=0-3-8, 15=0-3-8.	
(lb) - Max Horz 24=-319(LC 13)	
Max Uplift All uplift 100 lb or less at joint(s) 12, 13, 15 except 24=-247(LC 13), 22=-466(LC 9), 14=-360(LC 13)	
Max Grav All reactions 250 lb or less at joint(s) 12, 12 except 24=302(LC 20), 22=1663(LC 2), 14=1029(LC 20), 13=281(LC 20), 15=553(LC 20)	

FORCES.	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-98/267, 3-4=-104/278, 4-6=-547/373, 6-7=-882/447, 7-8=-1094/441, 8-10=-1005/341, 10-12=-85/337, 1-24=-242/261
BOT CHORD	23-24=-175/314, 21-22=-211/1200, 20-21=-103/547, 19-20=-141/882, 17-19=-80/877, 16-17=-107/816, 15-16=-256/125, 14-15=-256/125, 13-14=-256/125, 12-13=-256/125
WEBS	2-22=-415/186, 4-21=-1235/259, 4-20=-101/842, 6-20=-662/145, 6-19=0/339, 7-17=-25/310, 8-16=-422/185, 10-16=-269/1217, 10-14=-1503/489

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-7-13, Interior(1) 4-7-13 to 5-10-14, Exterior(2R) 5-10-14 to 12-3-6, Interior(1) 12-3-6 to 26-3-15, Exterior(2R) 26-3-15 to 32-8-7, Interior(1) 32-8-7 to 45-0-14 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 13, 15, 12 except (jt=lb) 24=247, 22=466, 14=360.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183252
3130985	T19	Piggyback Base	3	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:14 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-eYyi2kilgwXIBDo?WPjSSxlt0egVS275eV_qfz?5Yd



Scale = 1:82.2


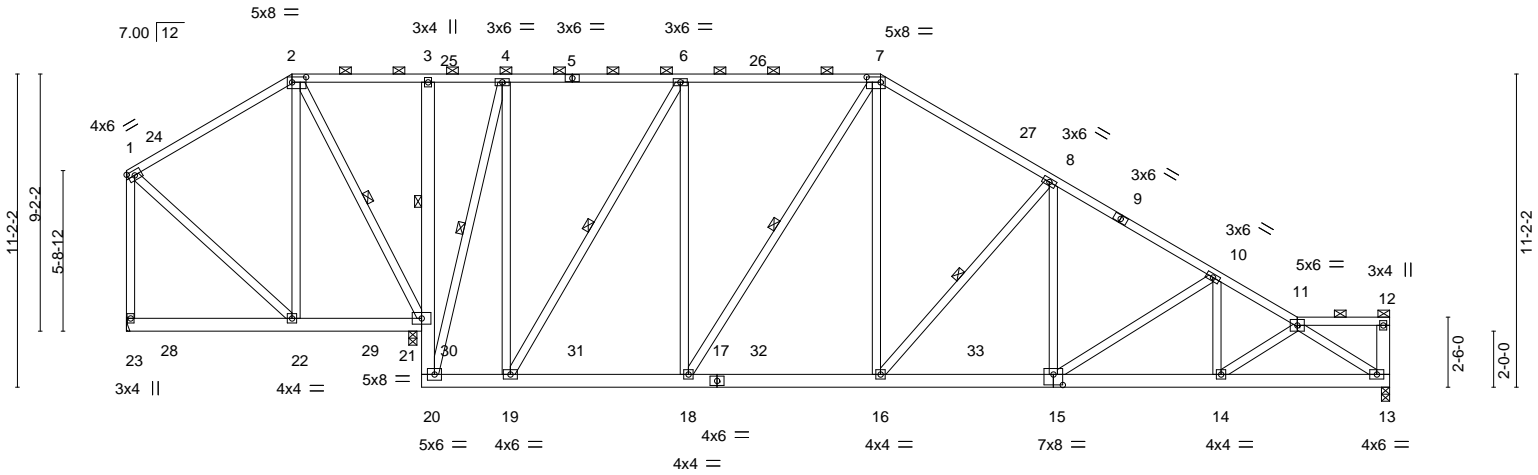


Plate Offsets (X,Y)-- [2:0-6-0,0-2-4], [7:0-6-0,0-2-4], [15:0-4-0,0-4-8]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.53	Vert(LL)	-0.10 15-16	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.37	Vert(CT)	-0.18 15-16	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.88	Horz(CT)	0.02 13	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 399 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except*
12-13: 2x6 SP No.2, 7-18,6-19: 2x4 SP No.2

REACTIONS.

(size) 13=0-3-8, 23=Mechanical, 21=0-3-8
Max Horz 23=-231(LC 8)
Max Uplift 13=-327(LC 13), 23=-172(LC 8), 21=-465(LC 9)
Max Grav 13=1387(LC 26), 23=372(LC 25), 21=2001(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-196/278, 4-6=-356/294, 6-7=-889/386, 7-8=-1375/430, 8-10=-1886/461,
10-11=-2196/490, 1-23=-292/347
BOT CHORD 20-21=-252/1411, 19-20=-67/285, 18-19=-118/889, 16-18=-148/1132, 15-16=-297/1547,
14-15=-427/1851, 13-14=-442/1777
WEBS 2-21=-405/199, 4-20=-1412/274, 4-19=-157/1186, 6-18=-53/744, 7-18=-506/112,
7-16=-175/853, 8-16=-754/287, 8-15=-51/470, 10-15=-410/155, 11-13=-2123/510,
6-19=-1192/210

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-7-13, Interior(1) 4-7-13 to 5-10-14, Exterior(2R) 5-10-14 to 10-4-15, Interior(1) 10-4-15 to 26-10-14, Exterior(2R) 26-10-14 to 31-4-15, Interior(1) 31-4-15 to 44-10-2 zone; end vertical right exposed; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 13=327, 23=172, 21=465.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183253
3130985	T20	Piggyback Base	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:16 2022 Page 1

ID:?NVDGqIbCtvYSov1NEucG6zi0DO-bx3WTQj0CXn0QWxOdqlwXH03NpI8zMZQZy_5uYz?5Yb



Scale = 1:93.4

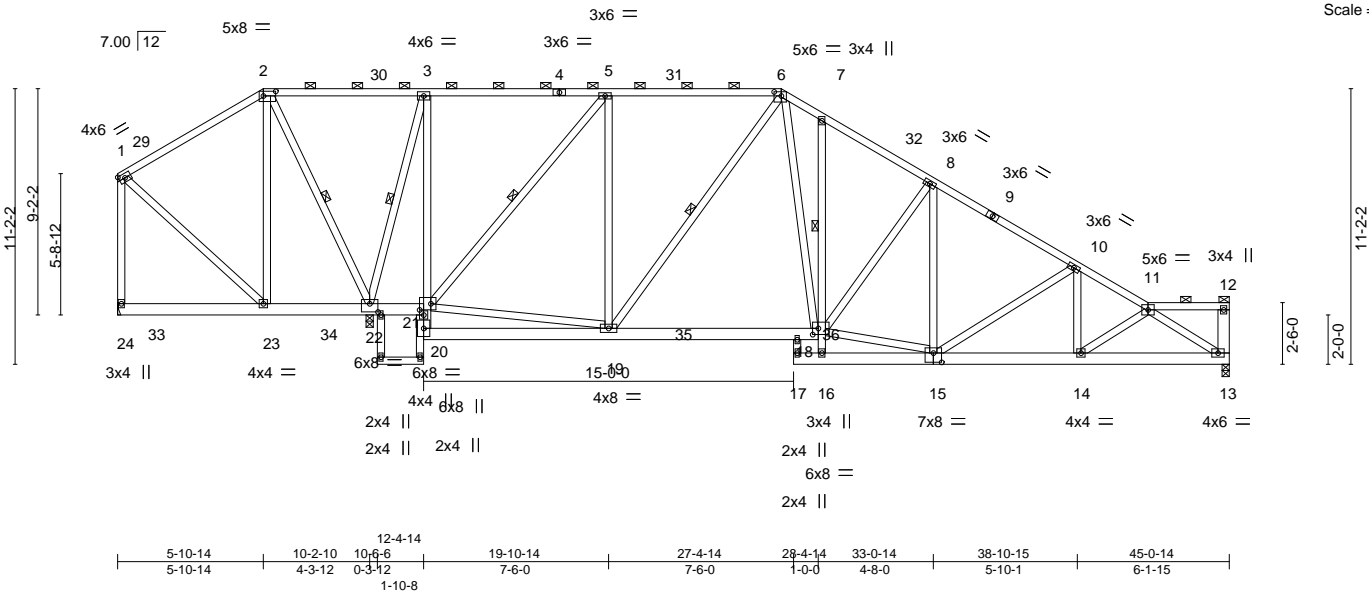


Plate Offsets (X,Y)--		[2:0-6-0,0-2-4], [6:0-3-8,0-2-0], [15:0-4-0,0-4-8], [18:0-2-12,0-3-0], [21:0-5-8,0-3-0], [22:0-4-0,0-4-0]			
LOADING (psf)		SPACING-	2-0-0	CSI.	
TCLL 20.0		Plate Grip DOL	1.25	TC 0.60	
TCDL 7.0		Lumber DOL	1.25	BC 0.49	
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.88	
BCDL 10.0		Code	FBC2020/TPI2014	Matrix-MS	
				DEFL.	in (loc) l/defl L/d
				Vert(LL)	-0.14 18-19 >999 240
				Vert(CT)	-0.23 18-19 >999 180
				Horz(CT)	0.04 13 n/a n/a
				PLATES	GRIP
				MT20	244/190
				Weight: 404 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-0-8 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-6, 11-12.
BOT CHORD	2x6 SP No.2 *Except* 3-20,7-16,25-26: 2x4 SP No.3	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 22-23,15-16. 1 Row at midpt 7-18 10-0-0 oc bracing: 20-21, 16-18 1 Row at midpt 2-22, 3-22, 5-21, 6-19
WEBS	2x4 SP No.3 *Except* 12-13: 2x6 SP No.2	WEBS	

REACTIONS. (size) 13=0-3-8, 24=Mechanical, 22=0-3-8
Max Horz 24=-231(LC 8)
Max Uplift 13=-271(LC 13), 24=-192(LC 24), 22=-503(LC 8)
Max Grav 13=1294(LC 26), 24=88(LC 23), 22=2418(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-29/267, 2-3=-39/481, 5-6=-770/266, 6-7=-1404/409, 7-8=-1466/355,
8-10=-1668/358, 10-11=-2002/391, 1-24=-27/251
BOT CHORD 22-23=-309/270, 21-22=-262/253, 3-21=-143/1073, 18-19=-98/1060, 14-15=-344/1706,
13-14=-361/1645
WEBS 2-23=-229/332, 2-22=-746/352, 3-22=-1452/372, 19-21=-131/588, 5-21=-1342/271,
5-19=-103/778, 6-19=-580/178, 6-18=-289/1059, 15-18=-185/1420, 8-18=-400/220,
10-15=-443/171, 11-13=-1941/412, 1-23=-255/72

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-7-13, Interior(1) 4-7-13 to 5-10-14, Exterior(2R) 5-10-14 to 10-4-15, Interior(1) 10-4-15 to 26-10-14, Exterior(2R) 26-10-14 to 31-4-15, Interior(1) 31-4-15 to 44-10-2 zone; end vertical right exposed; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 13=271, 24=192, 22=503.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183254
3130985	T21	Piggyback Base	4	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:18 2022 Page 1
ID: ?NVDGqIbCtvYSOV1NEucG6ziODO-XKBGu6lGk81Jgq5mlFoOci6PGdzuRFSj0GTCzRz?5YZ

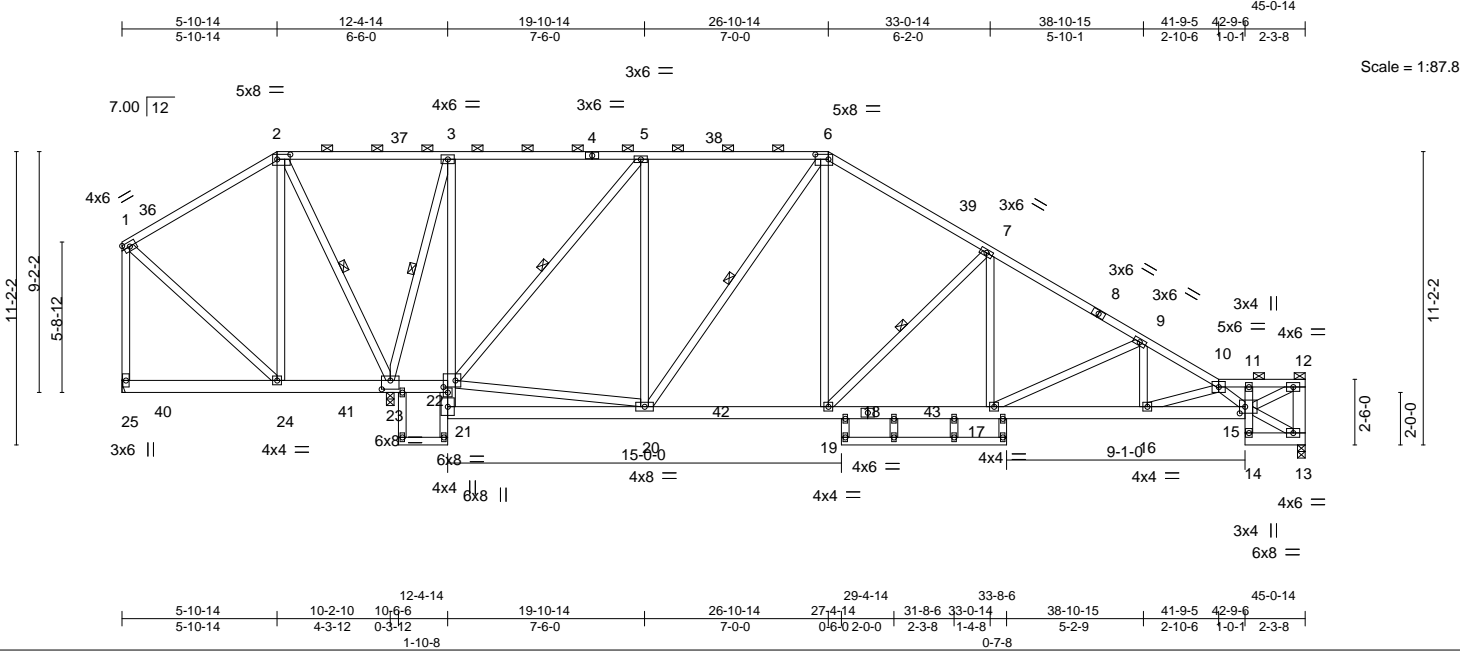


Plate Offsets (X,Y)--		[2:0-6-0,0-2-4], [6:0-6-0,0-2-4], [15:0-2-8,0-3-0], [22:0-5-8,0-3-0], [23:0-4-0,0-4-0]					
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc) l/defl L/d
TCLL 20.0		Plate Grip DOL	1.25	TC 0.64		Vert(LL)	-0.13 16-17 >999 240
TCDL 7.0		Lumber DOL	1.25	BC 0.54		Vert(CT)	-0.22 16-17 >999 180
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.92		Horz(CT)	0.09 13 n/a n/a
BCDL 10.0		Code	FBC2020/TPI2014	Matrix-MS			
						PLATES	GRIP
						MT20	244/190
						Weight: 395 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-7-4 oc purlins, except end verticals, and 2-0-0 oc purlins (4-2-11 max.): 2-6, 10-12.
BOT CHORD	2x6 SP No.2 *Except	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
WEBS	2x4 SP No.3 *Except		6-0-0 oc bracing: 23-24
	12-13: 2x6 SP No.2		9-4-1 oc bracing: 15-16.
			10-0-0 oc bracing: 21-22
		WEBS	1 Row at midpt
			2-23, 3-23, 5-22, 6-20, 7-19
REACTIONS.			
	(size) 13=0-3-8, 25=Mechanical, 23=0-3-8		
	Max Horz 25=-231(LC 8)		
	Max Uplift 13=-263(LC 13), 25=-346(LC 24), 23=-534(LC 8)		
	Max Grav 13=1240(LC 26), 25=77(LC 13), 23=2627(LC 2)		
FORCES.			
	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	1-2=-61/399, 2-3=-67/675, 3-5=-2/311, 5-6=-621/246, 6-7=-1196/318, 7-9=-1816/375, 9-10=-2538/510, 10-11=-1908/392, 11-12=-1813/377, 12-13=-1132/259, 1-25=-65/416		
BOT CHORD	23-24=-421/297, 22-23=-448/296, 3-22=-151/1099, 19-20=-88/980, 17-19=-235/1518, 16-17=-446/2182, 15-16=-630/2922		
WEBS	2-24=-249/431, 2-23=-932/390, 3-23=-1480/381, 20-22=-141/446, 5-22=-1401/292, 5-20=-128/827, 6-20=-702/195, 6-19=-179/888, 7-19=-878/310, 7-17=-71/593, 9-17=-788/247, 10-15=-1442/295, 12-15=-442/2057, 1-24=-407/110, 9-16=-39/465, 10-16=-795/198		

NOTES-			
1)	Unbalanced roof live loads have been considered for this design.		
2)	Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-7-13, Interior(1) 4-7-13 to 5-10-14, Exterior(2R) 5-10-14 to 10-4-15, Interior(1) 10-4-15 to 26-10-14, Exterior(2R) 26-10-14 to 31-4-15, Interior(1) 31-4-15 to 44-10-2 zone; end vertical right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60		
3)	Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.		
4)	Provide adequate drainage to prevent water ponding.		
5)	All plates are 2x4 MT20 unless otherwise indicated.		
6)	This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.		
7)	* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.		
8)	Refer to girder(s) for truss to truss connections.		
9)	Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 13=263, 25=346, 23=534.		
10)	Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.		

This item has been electronically signed and sealed by ORegan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183255
3130985	T22	Piggyback Base	4	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:19 2022 Page 1

ID:NVdGqIbCtvYSOv1NEucG6zi0DO-?Wle5SmuVS9aH_gyJzJd9wedK1J4Ah_sFwDIVtz?5YY

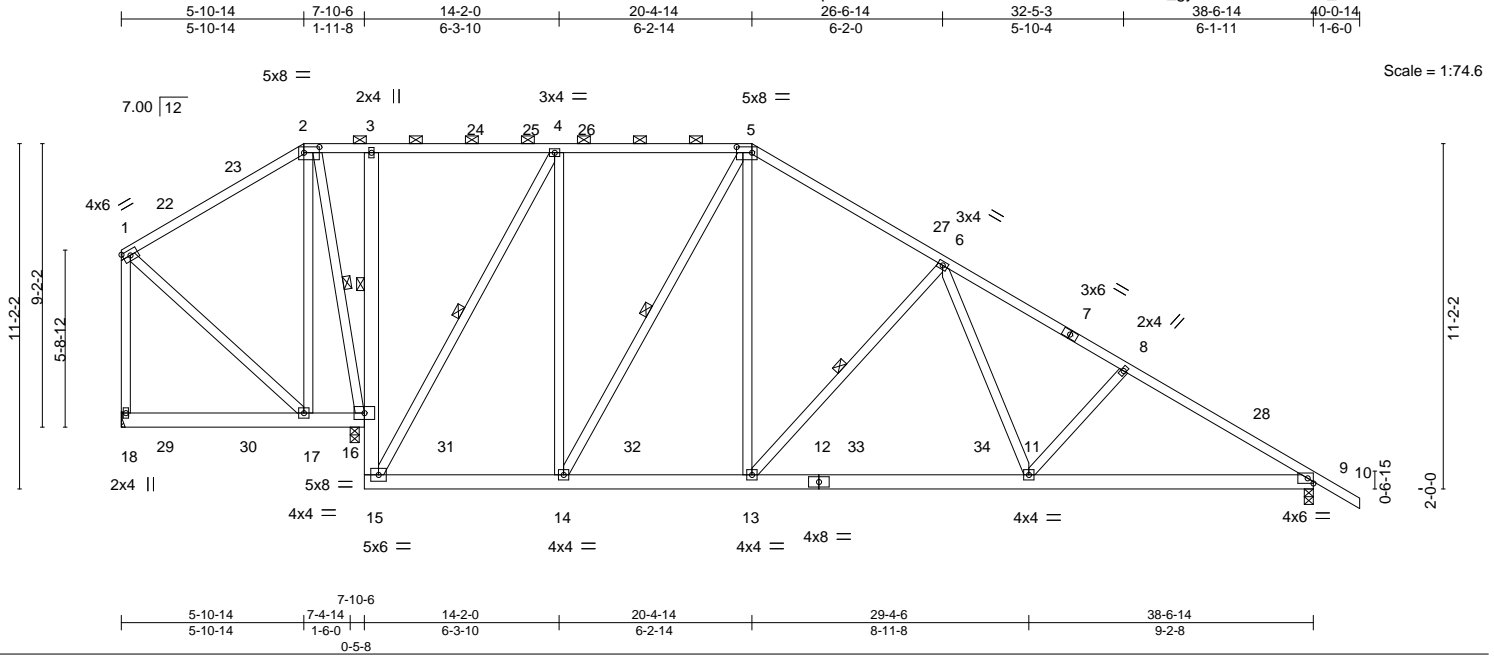


Plate Offsets (X,Y)-- [2:0-6-0,0-2-4], [5:0-6-0,0-2-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.42	Vert(LL)	-0.12 11-13	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.48	Vert(CT)	-0.21 11-13	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.96	Horz(CT)	0.03 9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 322 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 16-17.
WEBS 1 Row at midpt 3-16
1 Row at midpt 2-16, 4-15, 5-14, 6-13

REACTIONS.

(size) 18=Mechanical, 16=0-3-8, 9=0-3-8
Max Horz 18=-347(LC 13)
Max Uplift 18=-244(LC 13), 16=-320(LC 9), 9=-399(LC 13)
Max Grav 18=233(LC 25), 16=1780(LC 2), 9=1399(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-68/267, 3-4=-75/280, 4-5=-574/411, 5-6=-1108/485, 6-8=-1878/596, 8-9=-2054/606, 1-18=-157/259
BOT CHORD 17-18=-181/342, 15-16=-204/1219, 14-15=-51/553, 13-14=-53/871, 11-13=-249/1282, 9-11=-417/1697
WEBS 2-17=-121/250, 2-16=-461/171, 4-15=-1275/268, 4-14=-82/869, 5-14=-684/117, 5-13=-177/893, 6-13=-738/301, 6-11=-101/634, 8-11=-286/202

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-0-1, Interior(1) 4-0-1 to 5-10-14, Exterior(2R) 5-10-14 to 11-4-5, Interior(1) 11-4-5 to 20-4-14, Exterior(2R) 20-4-14 to 25-10-5, Interior(1) 25-10-5 to 40-0-14 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=244, 16=320, 9=399.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183256
3130985	T23	Piggyback Base	2	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:20 2022 Page 1

ID: ?NVDGqIbCtVYSOv1NEucG6zi0DO-TIJ1JnmWGmHRv8F9sgqsh7Bo4Rf9v8D0TayJ1Jz?5YX

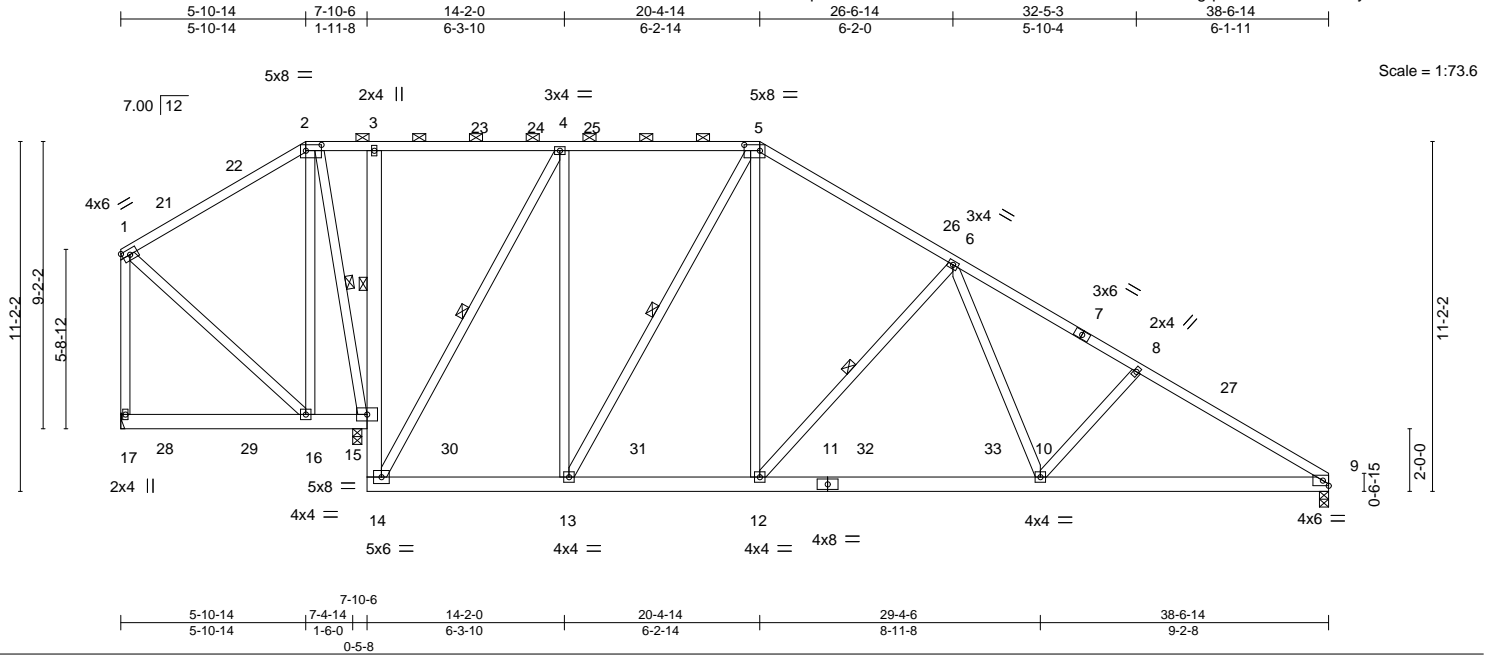


Plate Offsets (X,Y)-- [2:0-6-0,0-2-4], [5:0-6-0,0-2-4]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.42	Vert(LL)	-0.12 10-12	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.49	Vert(CT)	-0.20 10-12	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.97	Horz(CT)	0.03 9	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 320 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-1 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 15-16.
WEBS 1 Row at midpt 3-15
1 Row at midpt 2-15, 4-14, 5-13, 6-12

REACTIONS.

(size) 17=Mechanical, 15=0-3-8, 9=0-3-8
Max Horz 17=-319(LC 13)
Max Uplift 17=-224(LC 13), 15=-328(LC 9), 9=-357(LC 13)
Max Grav 17=234(LC 25), 15=1780(LC 2), 9=1321(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-70/260, 4-5=-573/396, 5-6=-1108/472, 6-8=-1887/589, 8-9=-2064/600
BOT CHORD 16-17=-175/314, 14-15=-212/1221, 13-14=-55/555, 12-13=-70/873, 10-12=-268/1291, 9-10=-440/1713
WEBS 2-15=-444/179, 4-14=-1276/277, 4-13=-90/872, 5-13=-687/127, 5-12=-179/895, 6-12=-744/304, 6-10=-108/645, 8-10=-289/204

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-0-1, Interior(1) 4-0-1 to 5-10-14, Exterior(2R) 5-10-14 to 11-4-5, Interior(1) 11-4-5 to 20-4-14, Exterior(2R) 20-4-14 to 25-10-5, Interior(1) 25-10-5 to 38-6-14 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 17=224, 15=328, 9=357.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183257
3130985	T24	Flat Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:25 2022 Page 1
ID:?NVDGqIbCtVYSOv1NEucG6zi0DO-qg6wMVqf4lwK?v86fDQ1OBugXSQoaQpIdsg3jXz?5YS

5-5-6

5-5-6

10-10-7

5-5-1

16-3-8

5-5-1

21-8-1

5-4-9


27-0-11

5-4-9

32-7-0

5-6-5

Scale = 1:55.2

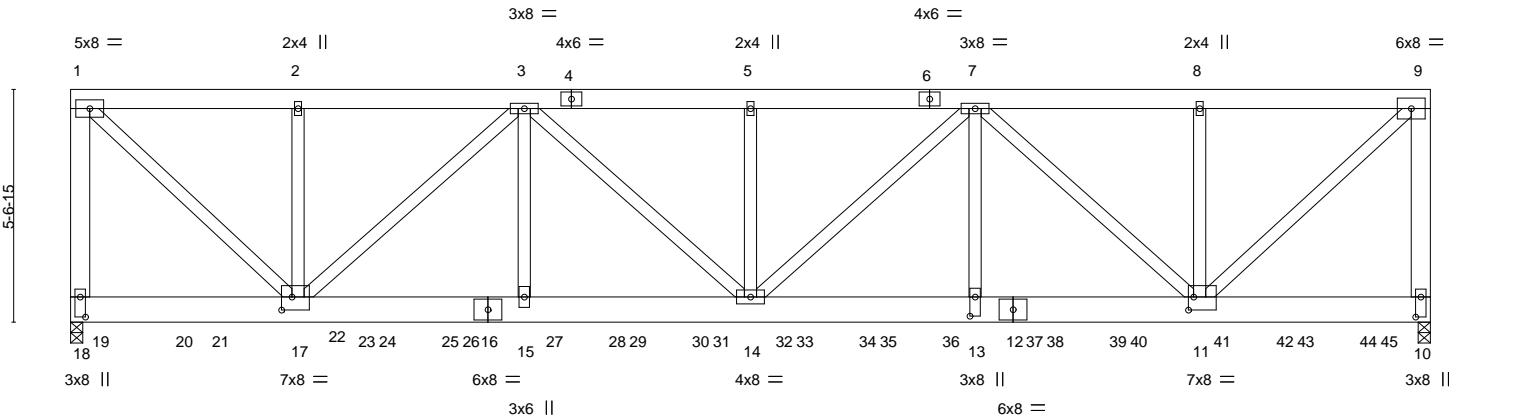

5-5-6		10-10-7		16-3-8		21-8-1		27-0-11		32-7-0	
5-5-6		5-5-1		5-5-1		5-4-9		5-4-9		5-6-5	
Plate Offsets (X,Y)-- [10:0-5-12,0-1-8], [11:0-1-8,0-3-12], [13:0-5-8,0-1-8], [17:0-3-0,0-3-12], [18:0-5-12,0-1-8]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.38	Vert(LL)	0.22 13-14	>999	240	MT20	244/190
TCDL	7.0	Lumber DOL	1.25	BC	0.27	Vert(CT)	-0.28 13-14	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.88	Horz(CT)	0.05 10	n/a	n/a		
BCDL	10.0	Code FBC2020/TP12014		Matrix-MS						Weight: 583 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-3-8 oc purlins, except end verticals.
BOT CHORD 2x8 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	
1-18,9-10: 2x6 SP No.2, 1-17,9-11: 2x4 SP No.2	

REACTIONS. (size) 18=0-3-8, 10=0-3-8
Max Uplift 18=-3226(LC 4), 10=-3542(LC 4)
Max Grav 18=5411(LC 1), 10=5718(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-18=-4748/2888, 1-2=-4820/2941, 2-3=-4820/2941, 3-5=-8629/5402, 5-7=-8629/5402, 7-8=-5125/3152, 8-9=-5125/3152, 9-10=-4966/3044
BOT CHORD 15-17=-4710/7420, 14-15=-4710/7420, 13-14=-4930/8022, 11-13=-4930/8022
WEBS 1-17=-4029/6597, 2-17=-285/180, 3-17=-3552/2420, 3-15=-850/964, 3-14=-946/1652, 5-14=-277/163, 7-14=-648/832, 7-13=-1054/1829, 7-11=-3971/2437, 8-11=-286/183, 9-11=-4282/6961

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=3226, 10=3542.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183257
3130985	T24	Flat Girder	1	2	Job Reference (optional)	

NOTES-

9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 357 lb down and 187 lb up at 0-8-4, 352 lb down and 192 lb up at 2-8-4, 352 lb down and 192 lb up at 3-6-12, 851 lb down and 487 lb up at 5-0-12, 68 lb down and 212 lb up at 5-6-12, 418 lb down and 187 lb up at 7-0-12, 68 lb down and 212 lb up at 7-6-12, 418 lb down and 187 lb up at 9-0-12, 89 lb down and 366 lb up at 9-6-12, 418 lb down and 187 lb up at 11-0-12, 89 lb down and 366 lb up at 11-6-12, 418 lb down and 187 lb up at 13-0-12, 89 lb down and 366 lb up at 13-6-12, 418 lb down and 187 lb up at 15-0-12, 89 lb down and 366 lb up at 15-6-12, 418 lb down and 187 lb up at 17-0-12, 345 lb down and 224 lb up at 17-6-12, 418 lb down and 187 lb up at 19-0-12, 266 lb down and 267 lb up at 19-6-12, 418 lb down and 187 lb up at 21-0-12, 214 lb down and 244 lb up at 21-6-12, 418 lb down and 187 lb up at 23-0-12, 214 lb down and 244 lb up at 23-6-12, 418 lb down and 187 lb up at 25-0-12, 213 lb down and 264 lb up at 25-6-12, 418 lb down and 187 lb up at 27-0-12, 213 lb down and 264 lb up at 27-6-12, 418 lb down and 187 lb up at 29-0-12, 213 lb down and 264 lb up at 29-6-12, and 418 lb down and 187 lb up at 31-0-12, and 215 lb down and 262 lb up at 31-6-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard


- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)
- Vert: 1-9=-54, 10-18=-20
- Concentrated Loads (lb)
- Vert: 17=-68(F) 15=-418(B) 13=-195(F) 11=-418(B) 19=-333(F) 20=-327(F) 21=-327(F) 22=-851(B) 23=-418(B) 24=-68(F) 25=-418(B) 26=96(F) 27=96(F) 28=-418(B) 29=96(F) 30=-418(B) 31=96(F) 32=-418(B) 33=-323(F) 34=-418(B) 35=-230(F) 36=-418(B) 37=-418(B) 38=-195(F) 39=-418(B) 40=-195(F) 41=-195(F) 42=-418(B) 43=-195(F) 44=-418(B) 45=-197(F)

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183258
3130985	T25	Roof Special Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:26 2022 Page 1

ID: ?NVDGqlbCtvYSov1NEucG6zi0DO-ls9lZrrHrc2bd3iJDxxGxORswrh4J?9usWPdFzz?5YR

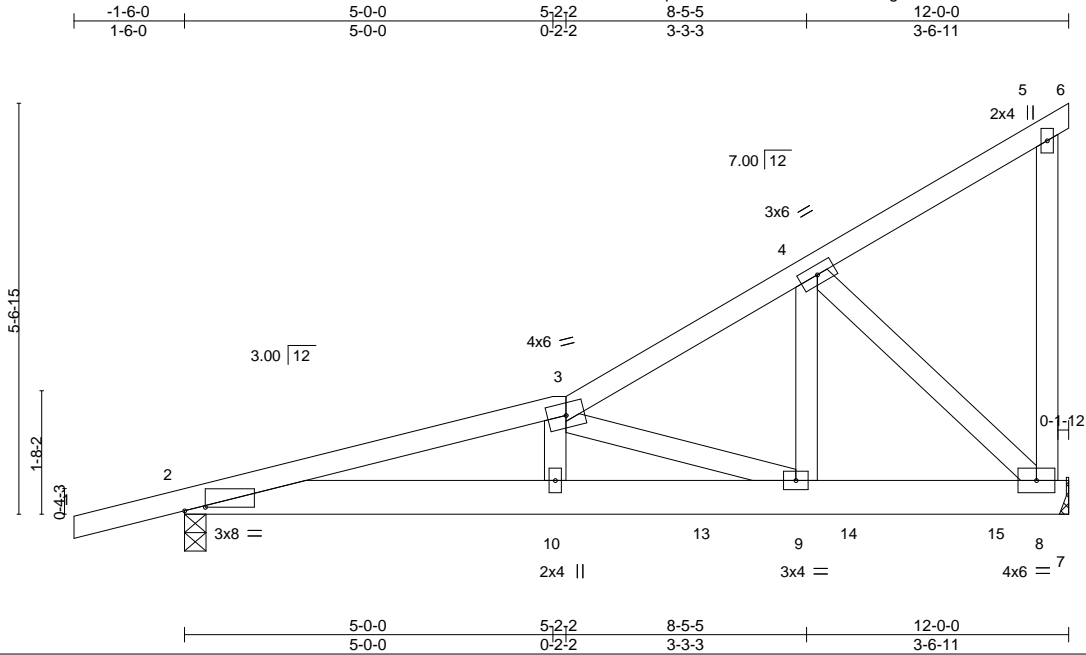

Scale = 1:31.3

Plate Offsets (X,Y)-- [2:0-3-6,0-0-9]		5-0-0		5-2-2		8-5-5		12-0-0	
		5-0-0		0-2-2		3-3-3		3-6-11	
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.27	Vert(LL)	0.06 10	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.52	Vert(CT)	-0.10 10	>999	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.36	Horz(CT)	0.02 8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 74 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-1-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-10-5 oc bracing.

REACTIONS.

(size) 8=Mechanical, 2=0-3-8
Max Horz 2=202(LC 23)
Max Uplift 8=468(LC 8), 2=348(LC 4)
Max Grav 8=871(LC 1), 2=720(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1842/753, 3-4=-810/294
BOT CHORD 2-10=-866/1773, 9-10=-854/1747, 8-9=-352/672
WEBS 3-9=-1150/537, 4-9=-399/807, 4-8=-918/480, 3-10=-136/278

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=468, 2=348.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 62 lb down and 72 lb up at 5-2-2 on top chord, and 111 lb down and 126 lb up at 5-0-0, 154 lb down and 114 lb up at 7-0-12, and 154 lb down and 114 lb up at 9-0-12, and 155 lb down and 113 lb up at 11-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-54, 3-5=-54, 5-6=-14, 2-7=-20
Concentrated Loads (lb)
Vert: 3=-62(F) 10=-108(F) 13=-154(F) 14=-154(F) 15=-155(F)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183259
3130985	T26	Jack-Closed	13	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:27 2022 Page 1

ID: ?NVDGqIbCtvYSOv1NEucG6zi0DO-m3EgnBsvcvASFCHVneSVTczymF2H2L824A9AnPz?5YQ

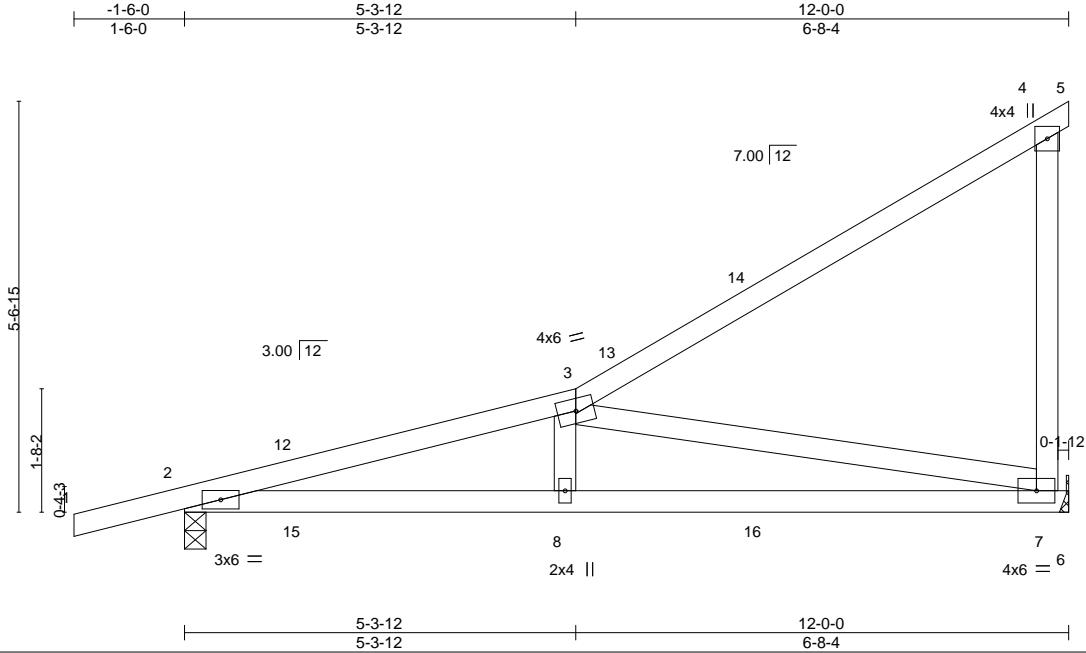

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.59	Vert(LL) 0.16	7-8	>873	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.46	Vert(CT) 0.14	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.83	Horz(CT) -0.02	7	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 58 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-13 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 4-5-8 oc bracing.

REACTIONS.

(size) 7=Mechanical, 2=0-3-8
Max Horz 2=163(LC 12)
Max Uplift 7=167(LC 9), 2=229(LC 8)
Max Grav 7=438(LC 1), 2=519(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1045/1108
BOT CHORD 2-8=-1299/996, 7-8=-1261/982
WEBS 3-8=-358/260, 3-7=-972/1235

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-0-0 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=167, 2=229.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183260
3130985	T27	Half Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:28 2022 Page 1

ID: ?NVdGqIbCtVYSOv1NEucG6zi0DO-EFo2_XtXNDIJsMshKMzk0pW7qfM2nnABJquKJsZ?5YP



Scale = 1:27.3

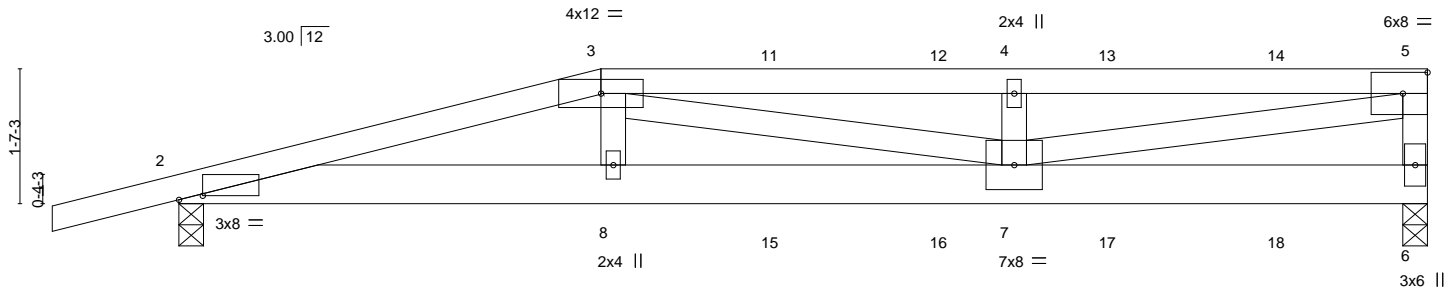


Plate Offsets (X,Y)-- [2:0-3-6,0-0-9]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.63	Vert(LL)	0.18	7-8	>991	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25		BC 0.62	Vert(CT)	-0.24	7-8	>748	180		
BCLL 0.0 *	Rep Stress Incr NO		WB 0.84	Horz(CT)	0.03	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 76 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-3-9 oc bracing.

REACTIONS.

(size) 6=0-3-8, 2=0-3-8
Max Horz 2=65(LC 4)
Max Uplift 6=478(LC 4), 2=484(LC 4)
Max Grav 6=858(LC 1), 2=851(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2437/1337, 3-4=-2305/1286, 4-5=-2305/1286, 5-6=-720/400
BOT CHORD 2-8=-1311/2350, 7-8=-1330/2385
WEBS 3-8=-160/367, 4-7=-425/236, 5-7=-1229/2203

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=478, 2=484.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 75 lb down and 67 lb up at 5-0-0, 56 lb down and 67 lb up at 7-0-12, 56 lb down and 65 lb up at 9-0-12, and 56 lb down and 67 lb up at 11-0-12, and 56 lb down and 67 lb up at 13-0-12 on top chord, and 110 lb down and 120 lb up at 5-0-0, 45 lb down and 48 lb up at 7-0-12, 45 lb down and 48 lb up at 9-0-12, and 45 lb down and 48 lb up at 11-0-12, and 45 lb down and 48 lb up at 13-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)

Vert: 1-3=-54, 3-5=-54, 2-6=-20

Concentrated Loads (lb)

Vert: 3=-56(F) 8=-102(F) 11=-56(F) 12=-56(F) 13=-56(F) 14=-56(F) 15=-40(F) 16=-40(F) 17=-40(F) 18=-40(F)

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183261
3130985	T28	Half Hip	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:28 2022 Page 1

ID: ?NVDGqlbCtvYSOv1NEucG6zi0DO-EFo2_XtXNDIJsMshKMzk0pW8DfNtnv0BJqkJsZ?5YP



Scale = 1:18.4

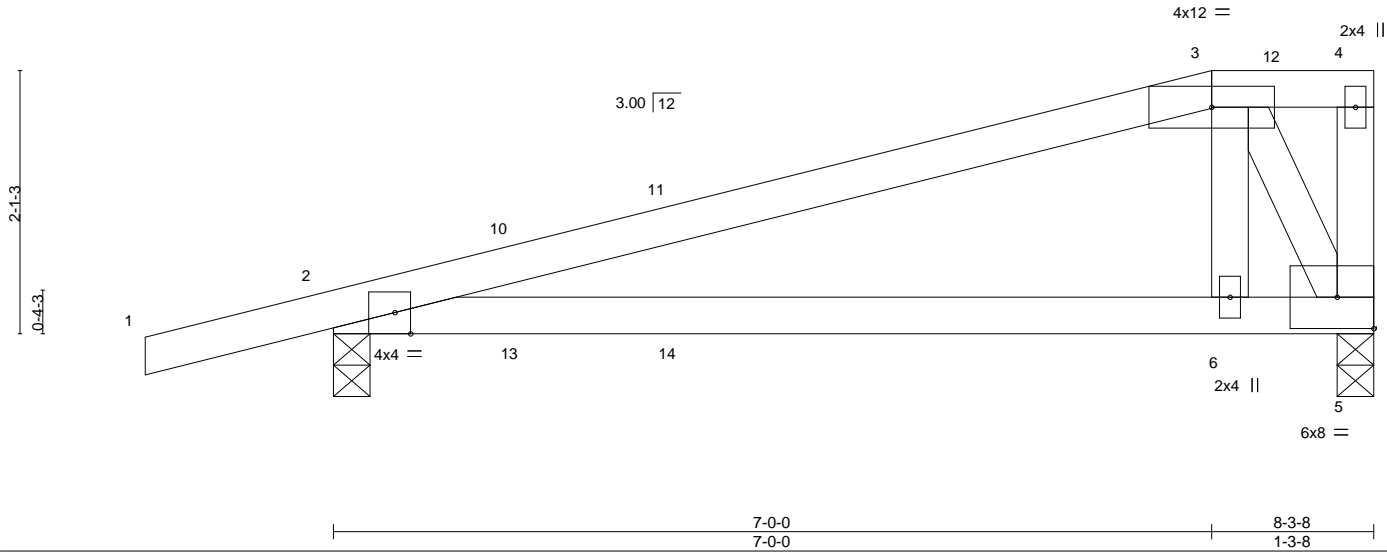


Plate Offsets (X,Y)-- [2:0-1-8,Edge]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.54	Vert(LL)	0.19	6-9	>503	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.56	Vert(CT)	0.17	6-9	>585	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.34	Horz(CT)	-0.01	5	n/a	n/a		
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-MS						Weight: 34 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-3-5 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=0-3-8
Max Horz 2=83(LC 8)
Max Uplift 2=-221(LC 8), 5=-163(LC 8)
Max Grav 2=390(LC 1), 5=294(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-339/502
BOT CHORD 2-6=-540/301, 5-6=-596/323
WEBS 3-6=-699/364, 3-5=-615/1136

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 7-0-0, Exterior(2E) 7-0-0 to 8-1-12 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=221, 5=163.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183262
3130985	T29	Monopitch	14	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:29 2022 Page 1

ID:~NVDGqIbCtvYSov1NEucG6zi0DO-iRMQBstA8XQAUWRtu3UzY13Ho3idWO2KYUeHslz?5YO



Scale = 1:18.1

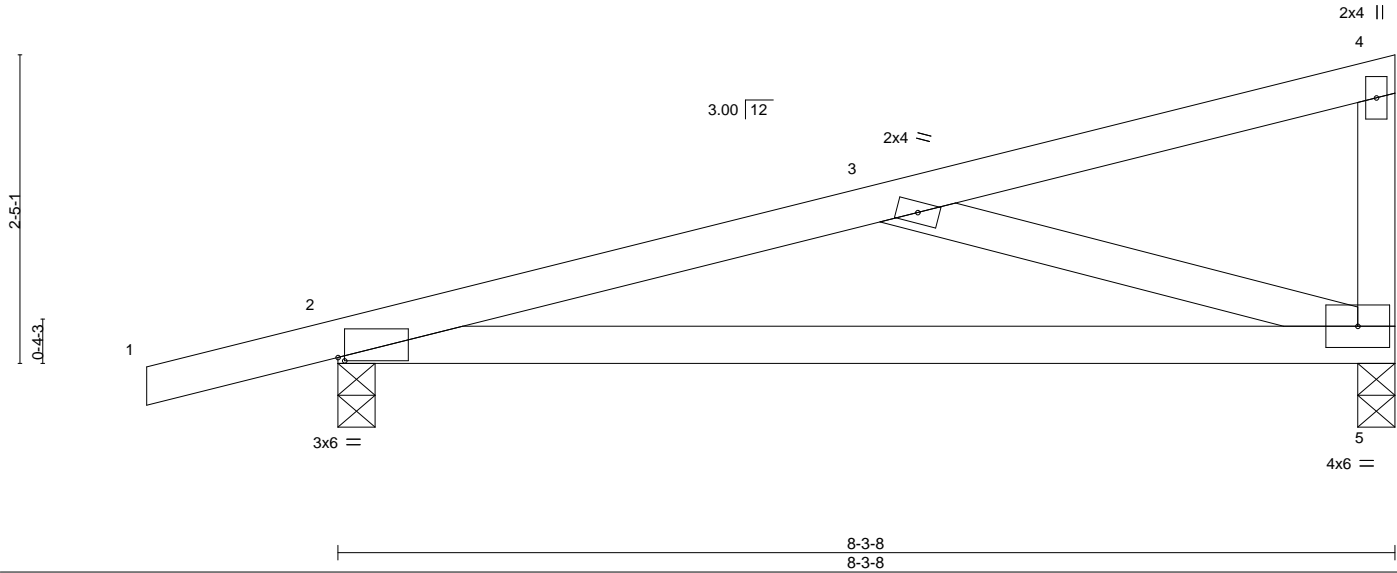

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.68	Vert(LL)	0.23	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.59	Vert(CT)	0.21				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.22	Horz(CT)	-0.01				
BCDL	10.0	Code	FBC2020/TPI2014	Matrix-MS							
								Weight: 36 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 4-11-15 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=0-3-8
Max Horz 2=93(LC 8)
Max Uplift 2=-219(LC 8), 5=-166(LC 8)
Max Grav 2=390(LC 1), 5=294(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-556/711
BOT CHORD 2-5=-805/536
WEBS 3-5=-520/752

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 8-1-12 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=219, 5=166.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183263
3130985	T30	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:30 2022 Page 1

ID: ?NVDGqIbCtvYSOv1NEucG6zi0DO-AdvpPCuovqY06g04Sm?C5EbYkT7WfItMUn8NqOkz?5YN



4x4 =

Scale = 1:26.0

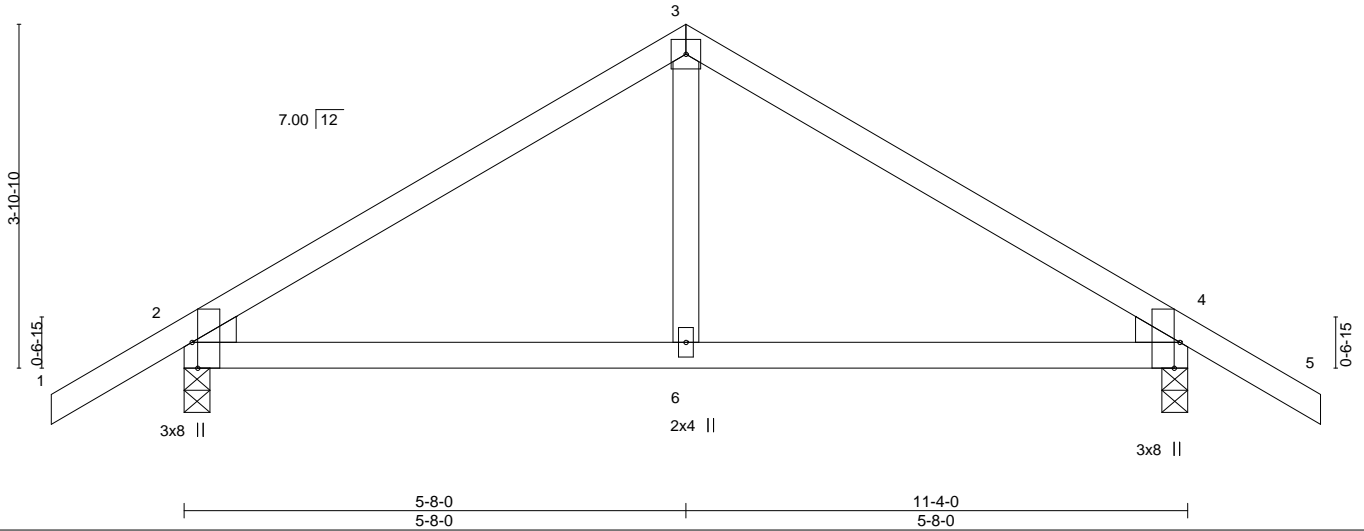


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [4:0-3-8,Edge]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.28	Vert(LL)	-0.03	6-9	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.30	Vert(CT)	-0.05	6-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.01	2	n/a	n/a		
BCDL 10.0	Code	FBC2020/TPI2014	Matrix-MS						Weight: 48 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 4=0-3-8
 Max Horz 2=-98(LC 10)
 Max Uplift 2=-131(LC 12), 4=-131(LC 13)
 Max Grav 2=500(LC 1), 4=500(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-488/168, 3-4=-488/168
 BOT CHORD 2-6=-43/362, 4-6=-43/362

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 5-8-0, Exterior(2R) 5-8-0 to 8-8-0, Interior(1) 8-8-0 to 12-10-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=131, 4=131.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183264
3130985	T30G	Common Supported Gable	1	1	Job Reference (optional)	


Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:31 2022 Page 1

ID: ?NVDGqIbCtvYSOv1NEucG6zi0DO-eqTBcYvQg8gtkqbG0UXReS8lshXu_LTd?o7OwAz?5YM



Scale = 1:24.5

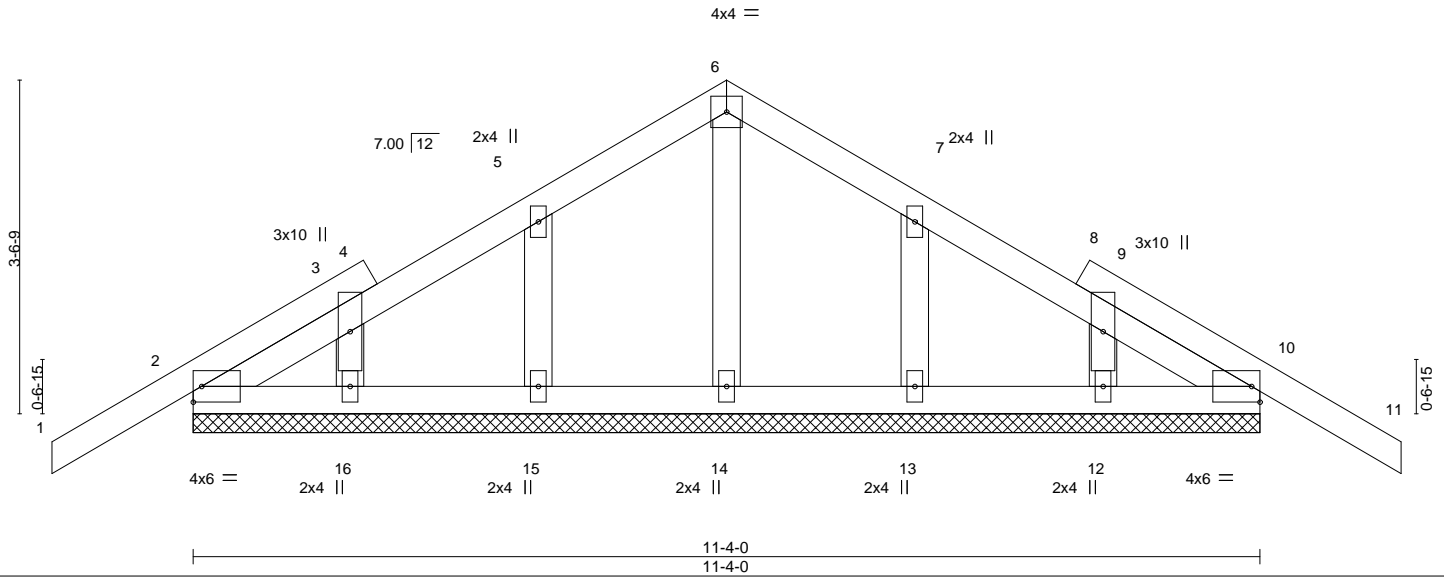

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.14	Vert(LL) -0.01	11	n/r	120		MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.03	Vert(CT) -0.01	11	n/r	120			
BCLL 0.0 *	Rep Stress Incr YES	WB 0.04	Horz(CT) 0.00	10	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S						Weight: 60 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 11-4-0.
(lb) - Max Horz 2=-90(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 15, 16, 13, 12
Max Grav All reactions 250 lb or less at joint(s) 2, 10, 14, 15, 16, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) -1-6-0 to 1-8-0, Exterior(2N) 1-8-0 to 5-8-0, Corner(3R) 5-8-0 to 8-8-0, Exterior(2N) 8-8-0 to 12-10-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 15, 16, 13, 12.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 10.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	IC CONST. - LAVENDER & MURRY RES.	T28183265
3130985	V01	GABLE	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.530 s Dec 6 2021 MiTek Industries, Inc. Tue Jul 5 13:54:32 2022 Page 1

ID:NVDGqlbCtvYSOv1NEucG6zi0DO-701Zquw2RSokL_ASZB2gAfhwMGsgjofnESxSdz75YL
10-0-1
10-0-1

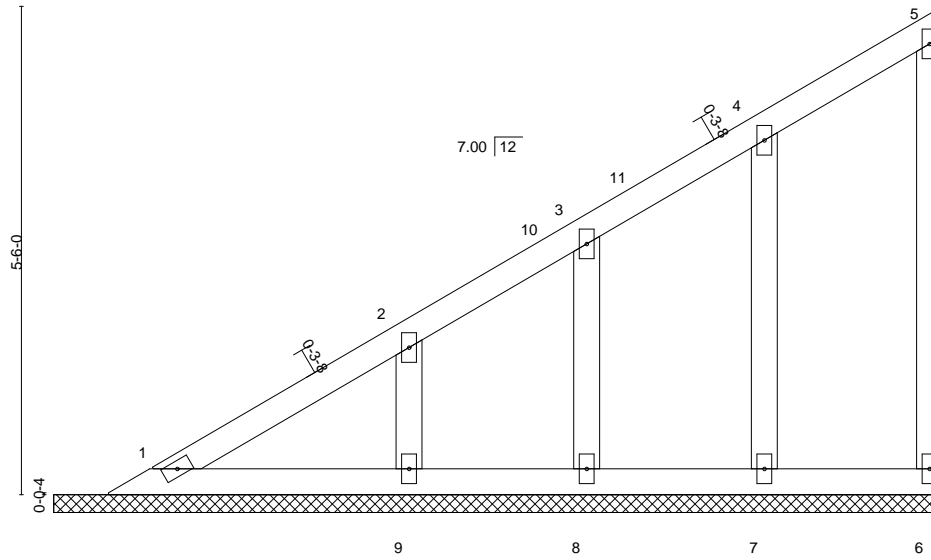

Scale = 1:25.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.08	Vert(LL)	n/a	-	n/a	999	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.06	Vert(CT)	n/a	-	n/a	999	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	6	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						
								Weight: 48 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

REACTIONS.

All bearings 10-0-1.
(lb) - Max Horz 1=166(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 6, 8, 7 except 9=104(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 1, 6, 9, 8, 7

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=25ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 1-1-7 to 4-0-0, Interior(1) 4-0-0 to 9-10-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 8, 7 except (jt=lb) 9=104.

BRACING-

TOP CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

TRUSS DESIGNED FOR WIND LOADS IN THE PLANE OF THE TRUSS ONLY. FOR STUDS EXPOSED TO WIND (NORMAL TO THE FACE), SEE STANDARD INDUSTRY GABLE END DETAILS AS APPLICABLE, OR CONSULT QUALIFIED BUILDING DESIGNER AS PER ANSI/TPI 1.

This item has been electronically signed and sealed by O'Regan, Philip, PE using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

July 6,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

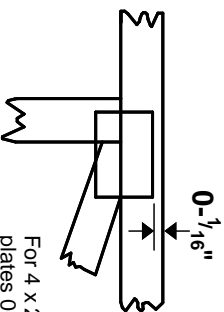

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MiTek 20/20** software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

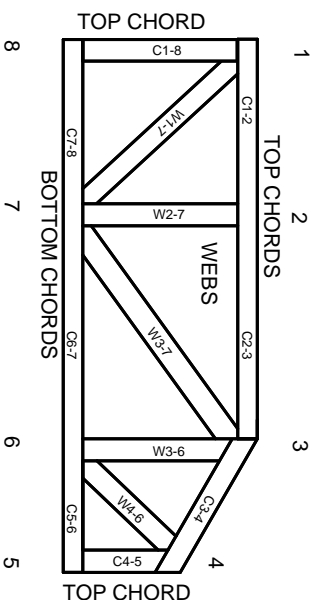

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.