


STANDARD HEADER SCHEDULE

- 6'-0" UP TO 6'-0" OPENINGS
- DOUBLE 2x8 16'-0" SOUTHERN PINE WITH 1/2" OSB SOLID CONTINUOUS SPACERS GLED AND NAILED WITH 10d 4 0.137 x 3" NAILS IN 2 ROWS 8" O.C. SPACED EACH SIDE WITH 1-HEADER STD AND 1 FULL HEIGHT STUD EACH SIDE OF OPENING
- 6'-0" UP TO 8'-0" OPENINGS
- DOUBLE 2x8 16'-0" SOUTHERN PINE WITH 1/2" OSB SOLID CONTINUOUS SPACERS GLED AND NAILED WITH 10d 4 0.137 x 3" NAILS IN 2 ROWS 8" O.C. SPACED EACH SIDE WITH 1-HEADER STD AND 1 FULL HEIGHT STUD EACH SIDE OF OPENING
- 8'-0" UP TO 16'-0" OPENINGS
- DOUBLE 2x8 16'-0" SOUTHERN PINE WITH 1/2" OSB SOLID CONTINUOUS SPACERS GLED AND NAILED WITH 10d 4 0.137 x 3" NAILS IN 2 ROWS 8" O.C. SPACED EACH SIDE WITH 1-HEADER STD AND 1 FULL HEIGHT STUD EACH SIDE OF OPENING
- 16'-0" GARAGE DOOR OPENINGS
- 2 PLY 18" X 11' 1.02 HORIZONTAL LVL HEADER GLED AND NAILED WITH 10d 4 0.137 x 3" NAILS WITH 2-HEADER STUDS AND 3 FULL HEIGHT STUDS EACH SIDE OF OPENING




MULTIPLE GANG LAM. DETAIL

NOT TO SCALE

B/U Beam DETAILS


SCALE: NONE

AREA OF JOINT	RESID. LVL	NET FREE AREA
1600 SF	12' 1/2"	1450 SQ IN.
1600 SF	12' 1/2"	1450 SQ IN.
1600 SF	12' 1/2"	1450 SQ IN.
1600 SF	12' 1/2"	1450 SQ IN.
1600 SF	12' 1/2"	1450 SQ IN.
1600 SF	12' 1/2"	1450 SQ IN.
1600 SF	12' 1/2"	1450 SQ IN.

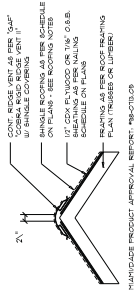

Ridge Vent Detail

SCALE: 3/4" = 1'-0"

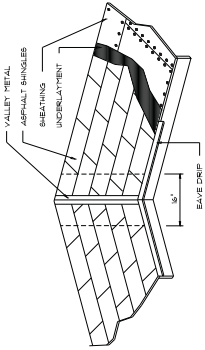

ROOFING METALS FOR FLASHING/ROOFING	MINIMUM THICKNESS	GAGE	WEIGHT PER SQ. FT.
COPPER	0.024		16
ALUMINUM	0.024		16
STAINLESS STEEL	0.078	26 ZINC COATED (A50C)	26
GALVANIZED STEEL	0.078	26 ZINC COATED (A50C)	26
ZINC ALLOY	0.027		20
PAINTED TITANE	0.027		20

Roofing/Flashing DETS.

SCALE: NONE

A

WOOD STRUCTURAL NOTES

- TEMPORARY BRACING OF THE STRUCTURE DURING ERECTION REQUIRED FOR SAFE AND STABLE CONSTRUCTION SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR SO ENGAGED. TEMPORARY & PERMANENT BRACING SHALL BE SHOWN ON THE TRUSS PLATE INSTITUTE'S LINE OF THE TRUSS PLATE INSTITUTE.
- ALL TRUSSES SHALL BE DESIGNED BY A LICENSED PROFESSIONAL ENGINEER & SHALL BE SIGNED & SEALED BY SAME. TRUSS DESIGN SHALL BE BASED ON THE TRUSS PLATE INSTITUTE'S STANDARD SPECIFICATIONS FOR INSTALLATION OF THE TRUSS PLATE INSTITUTE.
- WOOD STUDS IN EXTERIOR WALLS & INTERIOR BEARING WALLS SHALL BE NOT LESS THAN N-2 HEPIR OR BETTER.
- CONNECTORS FOR WOOD FRAMING SHALL BE GALVANIZED METAL OR BLACK METAL AS MANUFACTURED OR AS CALLED FOR IN THE PLANS. ALL CONNECTORS SHALL BE INSTALLED IN ACCORDANCE WITH THE REFER TO THE JOINT REINFORCEMENT SCHEDULE FOR PRINCIPLE CONNECTIONS.

ROOF FRAMING PLAN

SCALE: 3/4" = 1'-0"

ROOF PLAN NOTES

- SEE ELEVATIONS FOR ROOF PITCH
- ALL ELEVATIONS 1/2" OR GREATER
- UNLESS OTHERWISE NOTED
- SEE EXTERIOR ELEVATIONS AND FLOOR PLANS TO VERIFY PLATE AND HELL HEIGHTS
- NOTE ALL JENTS AND OTHER ROOF PENETRATIONS TO PLAN

REVISIONS
DEC. 2ND, 2020

CUSTOM HOME FOR:
McNUTT RESIDENCE
COLUMBIA COUNTY, FLORIDA

NICHOLAS
ARCHITECT
1500 N. BROAD RD.
LAKESIDE, FL 32055

SHEET NUMBER
S.2
OF 4 SHEETS

APR0007005
DRAWN BY: J. P. GIBBS
CHECKED BY: J. P. GIBBS
DATE: 02/01/2021

