


STATE OF FLORIDA  
 DEPARTMENT OF HEALTH  
 APPLICATION FOR CONSTRUCTION PERMIT

Permit Application Number 20-0437

1" = 100' ----- PART II - SITEPLAN ----- George Demko

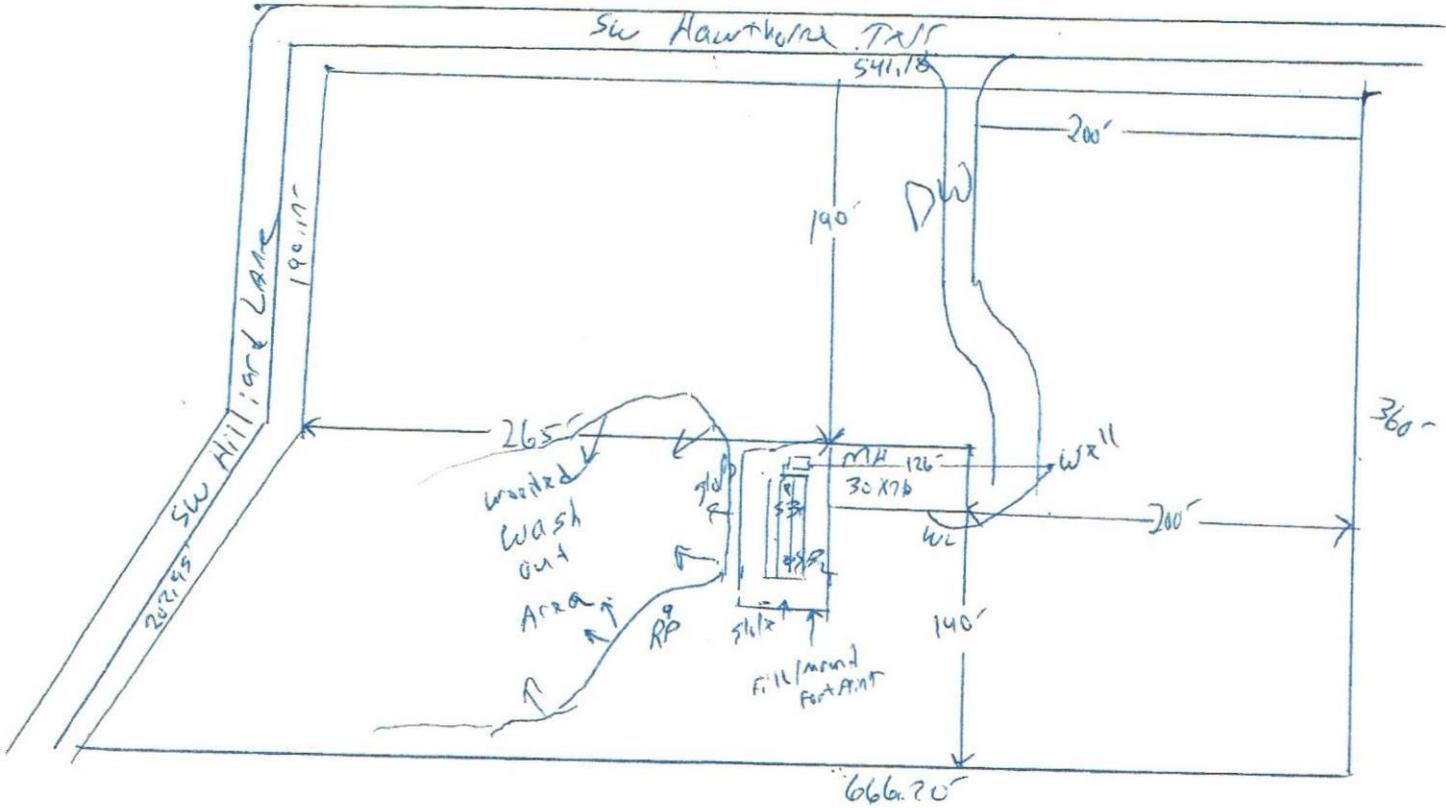

Notes: \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

Site Plan submitted by: Jeff Vander

Plan Approved \_\_\_\_\_ Not Approved \_\_\_\_\_ Date 6/8/20  
 By [Signature] Columbia County Health Department

**ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT**



STATE OF FLORIDA  
 DEPARTMENT OF HEALTH  
 ONSITE SEWAGE TREATMENT AND DISPOSAL  
 SYSTEM  
 APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO: 20-0437  
 DATE PAID: 5/8/08  
 FEE PAID: 310.00  
 RECEIPT #: 1568790

APPLICATION FOR:

New System     Existing System     Holding Tank     Innovative  
 Repair     Abandonment     Temporary   

APPLICANT: George Demko

AGENT: Jeff Hardee (Hardee Environmental and Permitting)    TELEPHONE: 352-949-0592

MAILING ADDRESS: 6450 NW 72 Lane, Chiefland, FL 32626    EMAIL: JeffHardeeHEP@aol.com

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: 1    BLOCK: -    SUBDIVISION: Little Pine Farms    PLATTED: 1989

PROPERTY ID #: 2-7-16-04111-101    ZONING: \_\_\_\_\_    I/M OR EQUIVALENT:  Y  N

PROPERTY SIZE: 4.78 ACRES    WATER SUPPLY:  PRIVATE    PUBLIC  <=2000GPD     >2000GPD

IS SEWER AVAILABLE AS PER 381.0065, FS?  Y  N    DISTANCE TO SEWER: NA FT

PROPERTY ADDRESS: SW Hawthorne Rd Ft White

DIRECTIONS TO PROPERTY: 77 South 1/2 SR 27 1/2 cr 18  
1/2 SW Hawthorne Rd to lot on left

BUILDING INFORMATION

RESIDENTIAL     COMMERCIAL

Unit No	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 64E-6, FAC
1	<u>Modular Home</u>	<u>4</u>	<u>2280</u>	
2				
3				
4				

Floor/Equipment Drains     Other (Specify) \_\_\_\_\_

SIGNATURE: Jeff Hardee

**E-MAILED**  
 DATE: 5/18/08 4/4/08



STATE OF FLORIDA  
DEPARTMENT OF HEALTH  
ONSITE SEWAGE TREATMENT AND DISPOSAL  
SYSTEM

PERMIT #: 12-SC-2089504  
APPLICATION #: AP1508790  
DATE PAID: 6/8/20  
FEE PAID: 310.20  
RECEIPT #: \_\_\_\_\_  
DOCUMENT #: PR1352320

CONSTRUCTION PERMIT FOR: OSTDS New  
APPLICANT: GEORGE\*\*20-0437 DEMKO  
PROPERTY ADDRESS: HAWTHORNE Rd Fort White, FL 32038  
LOT: 1 BLOCK: \_\_\_\_\_ SUBDIVISION: Little Pine Farms  
PROPERTY ID #: 04111-101 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]  
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [ 1,050 ] GALLONS / GPD \_\_\_\_\_ Septic Tank \_\_\_\_\_ CAPACITY  
A [ ] GALLONS / GPD \_\_\_\_\_ N/A \_\_\_\_\_ CAPACITY  
N [ ] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]  
K [ ] GALLONS DOSING TANK CAPACITY [ ] GALLONS @ [ ] DOSES PER 24 HRS #Pumps [ ]

D [ 616 ] SQUARE FEET \_\_\_\_\_ Drainfield \_\_\_\_\_ SYSTEM  
R [ ] SQUARE FEET \_\_\_\_\_ N/A \_\_\_\_\_ SYSTEM  
A TYPE SYSTEM: [ ] STANDARD [x] FILLED [ ] MOUND [ ] \_\_\_\_\_  
I CONFIGURATION: [x] TRENCH [ ] BED [ ] \_\_\_\_\_  
N

F LOCATION OF BENCHMARK: Nail in tree SE of DF

I ELEVATION OF PROPOSED SYSTEM SITE [ 33.00 ] [ INCHES / FT ] [ ABOVE / BELOW ] BENCHMARK/REFERENCE POINT  
E BOTTOM OF DRAINFIELD TO BE [ 36.00 ] [ INCHES / FT ] [ ABOVE / BELOW ] BENCHMARK/REFERENCE POINT  
L

D FILL REQUIRED: [ 15.00 ] INCHES EXCAVATION REQUIRED: [ 0.00 ] INCHES

O  
T  
H  
E  
R  
The system is sized for 4 bedrooms with a maximum occupancy of 8 persons (2 per bedroom), for a total estimated flow of 400 gpd.

SPECIFICATIONS BY: *Jeff Hurdice* TITLE: *DSE*

APPROVED BY: *Dustin W Jones* TITLE: Environmental Specialist II Columbia CHD

DATE ISSUED: 06/09/2020 EXPIRATION DATE: 12/09/2021

DH 4016, 08/09 (Obsoletes all previous editions which may not be used)  
Incorporated: 64E-6.003, FAC

