



MDG LOCATION ID: 5000025934
 VERIZON SITE NAME: LAKE CITY NORTH
 STRUCTURE TYPE: ±420' GUYED WIRED TOWER
 MARKET: JACKSONVILLE
 PROJECT TYPE: GENERATOR UPGRADE



6505 N HIMES AVE
 TAMPA, FLORIDA 33614
 (813) 353-0026
 FL CA # 31014

DISCLAIMER:
 NO COPIES, REPRODUCTIONS, TRANSMISSIONS OR ELECTRONIC MANIPULATION OF ANY PORTION OF THESE DRAWINGS IN WHOLE OR IN PART ARE TO BE MADE WITHOUT THE EXPRESS WRITTEN PERMISSION OF CBVR TELECOM DESIGN GROUP. ALL DESIGNS INDICATED IN THESE DRAWINGS ARE PROPERTY OF CBVR TELECOM DESIGN GROUP. ALL COPYRIGHTS RESERVED (C) 2025. THESE PLANS ARE FOR BUILDING DEPARTMENT REVIEW ONLY THEY ARE NOT TO BE CONSTRUED AS CONSTRUCTION DOCUMENTS UNTIL ALL BUILDING DEPARTMENT APPROVALS ARE OBTAINED.

PROFESSIONAL SEAL



01/12/2026

PREPARED FOR



7701 E. TELECOM PKWY
 TEMPLE TERRACE, FLORIDA 33637

PROJECT INFORMATION

5000025934
 LAKE CITY NORTH
 279 NW OSTEEN CT
 LAKE CITY, FL 32055
 CBVR PROJECT #: VZW.301.25

ISSUED DATES


NO.	FOR PERMIT / CONSTRUCTION	DATE
0	FOR PERMIT / CONSTRUCTION	01.12.26

SHEET NAME

TITLE SHEET

SHEET NUMBER

T-1

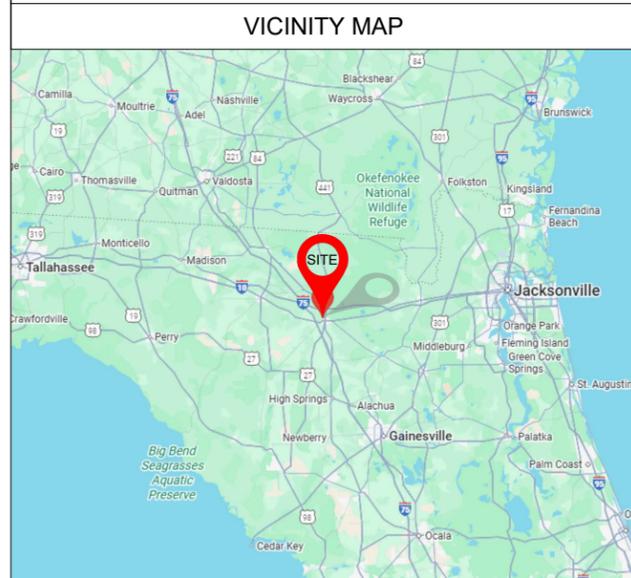

CONTACT INFORMATION

VERIZON CONTACTS:
 VERIZON WIRELESS
 7701 E TELECOM PKWY.
 TEMPLE TERRACE, FL 33637

TOWER OWNER:
 VERIZON WIRELESS
 7701 E. TELECOM PKWY
 TEMPLE TERRACE, FL 33637


TOWER MANAGER:
 VERTICAL BRIDGE
 SITE ID: US-FL-6086
 SITE NAME: LAKE CITY NORTH
 750 PARK OF COMMERCE DR.
 STE 200
 BOCA RATON, FL 33487

ARCHITECT/ ENGINEER:
 MARIA V. MARTIN, PE
 6505 N HIMES AVE
 TAMPA, FL 33614
 maria.martin@cbvrtelecom.com

PROPERTY OWNER:
 ALLTEL COMMUNICATIONS INC
 P O BOX 2549
 (#501-9-245711)
 ADDISON, TX 75001

SITE INFORMATION

PARCEL ID: 19-3S-17-05070-004 (25026)
 COUNTY: COLUMBIA
 JURISDICTION: COLUMBIA
 LATITUDE: 30° 12' 24.83" NORTH (NAD83)
 LONGITUDE: 82° 39' 8.45" WEST (NAD83)

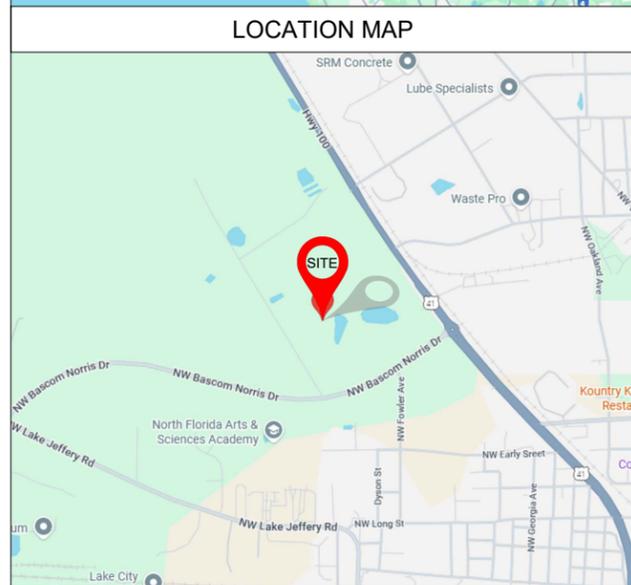

DIRECTIONS

FROM I-10 EAST TO JOB SITE:

1. Get on I-10 East.
2. Take exit 301 for US-41 toward Lake City/White City.
3. Turn right onto US-41 S (signs for Lake City).
4. At the traffic circle, take the 1st exit onto NW Bascom Norris Dr.
5. Turn right onto NE Osteen Ct.
6. The site will be on the right.



SCOPE OF WORK

THE SCOPE OF WORK CONSISTS OF MODIFYING THE EXISTING WIRELESS INSTALLATIONS:

- REMOVE EXISTING 40KW DIESEL GENERATOR
- INSTALL A NEW 50KW DIESEL GENERATOR TO THE EXISTING VERIZON GEN. PAD AND CONNECT TO EXISTING ELECTRICAL SYSTEM (UPGRADE CONDUCTORS AS NECESSARY)
- INSTALL NEW GEN. EMERGENCY SHUT-OFF BUTTON ON VERIZON SHELTER WALL

LIST OF DRAWINGS

SHT. NO.	DESCRIPTION	REV. NO.
	SITE GENERAL ARRANGEMENT PLANS	
T-1	TITLE SHEET	0
	ARCHITECTURAL / CIVIL PLANS	
C-1	OVERALL SITE PLAN WITH AERIAL VIEW	0
C-1.1	OVERALL SITE PLAN	0
C-2	ENLARGED EQUIPMENT LAYOUT PLAN	0
C-3	GENERATOR DETAIL	0
	ELECTRICAL PLANS	
E-1	GROUNDING DETAILS	0
E-2	ELECTRICAL DETAILS	0

APPLICABLE CODES

- FLORIDA BUILDING CODE 2023 (8TH EDITION)
 WIND DESIGN CRITERIA
 A. ASCE 7 - 22
 ULTIMATE WIND SPEED = 119 MPH
 RISK CATEGORY = II
 EXPOSURE = C
- B. ANSI/ TIA-222-H
 STRUCTURE CLASS = II
 TOPOGRAPHIC CATEGORY = 1
- FLORIDA FIRE PREVENTION CODE - 2023 (8TH EDITION)
- NATIONAL ELECTRIC CODE (NEC) 2020
- CITY AND OR COUNTY ORDINANCES

- NOTES:
- ALL DRAWINGS HAVE BEEN PREPARED WITHOUT THE AID OF A SURVEY OR A TITLE
 - ALL DIMENSIONS, PROPERTY LINES, AND RIGHT OF WAYS ARE APPROXIMATE BASED UPON AVAILABLE ONLINE RESOURCES AND SITE WALK PERFORMED ON 11/10/2025.
 - CONTRACTOR SHALL RESTORE AND REPAIR ANY DAMAGED AREAS CAUSED BY CONSTRUCTION TO ORIGINAL OR BETTER CONDITION
 - ALL NEW WORK TO BE PERFORMED PER LATEST VERIZON WIRELESS STANDARDS & SPECIFICATIONS
 - SETBACK DIMENSIONS ARE APPROXIMATE AND TAKEN FROM CENTER OF TOWER TO AND PERPENDICULAR TO THE PROPERTY/ R.O.W. LINES



PARCEL ID:
19-3S-17-05070-003 (25025)

PARCEL ID: 19-3S-17-05070-004 (25026)
OWNER: ALLTEL COMMUNICATIONS INC
P O BOX 2549
(#501-9-245711)
ADDISON, TX 75001

APPROXIMATE PROPERTY LINE
(PER PROPERTY APPRAISER)

EXISTING GRASSY AREA

EXISTING ±420' GUYED WIRED TOWER

±473' TO EAST PROPERTY LINE

EXISTING VERIZON SHELTER WITH VERIZON EQUIPMENT

EXISTING CHAIN-LINK FENCED COMPOUND

±493' TO EAST R.O.W. LINE

±308' TO SOUTH PROPERTY LINE

APPROXIMATE R.O.W. LINE
(PER PROPERTY APPRAISER)

NE OSTENS CT



GRAPHIC SCALE



(SCALE IN FEET)
11x17 SCALE: 1"=70'

OVERALL SITE PLAN W/ AERIAL VIEW

PREPARED BY

6505 N HIMES AVE
TAMPA, FLORIDA 33614
(813) 353-0026
FL CA # 31014

DISCLAIMER:
NO COPIES, REPRODUCTIONS, TRANSMISSIONS OR ELECTRONIC MANIPULATION OF ANY PORTION OF THESE DRAWINGS IN WHOLE OR IN PART ARE TO BE MADE WITHOUT THE EXPRESS WRITTEN PERMISSION OF CBVR TELECOM DESIGN GROUP. ALL DESIGNS INDICATED IN THESE DRAWINGS ARE PROPERTY OF CBVR TELECOM DESIGN GROUP. ALL COPYRIGHTS RESERVED (C) 2025. THESE PLANS ARE FOR BUILDING DEPARTMENT REVIEW ONLY THEY ARE NOT TO BE CONSTRUED AS CONSTRUCTION DOCUMENTS UNTIL ALL BUILDING DEPARTMENT APPROVALS ARE OBTAINED.

PROFESSIONAL SEAL

01/12/2026

PREPARED FOR

7701 E. TELECOM PKWY
TEMPLE TERRACE, FLORIDA 33637

PROJECT INFORMATION

5000025934
LAKE CITY NORTH
279 NW OSTEN CT
LAKE CITY, FL 32055

CBVR PROJECT #: VZW.301.25

ISSUED DATES

0	FOR PERMIT / CONSTRUCTION	01.12.26



SHEET NAME

OVERALL SITE PLAN

SHEET NUMBER

C-1

- NOTES:
- ALL DRAWINGS HAVE BEEN PREPARED WITHOUT THE AID OF A SURVEY OR A TITLE
 - ALL DIMENSIONS, PROPERTY LINES, AND RIGHT OF WAYS ARE APPROXIMATE BASED UPON AVAILABLE ONLINE RESOURCES AND SITE WALK PERFORMED ON 11/10/2025.
 - CONTRACTOR SHALL RESTORE AND REPAIR ANY DAMAGED AREAS CAUSED BY CONSTRUCTION TO ORIGINAL OR BETTER CONDITION
 - ALL NEW WORK TO BE PERFORMED PER LATEST VERIZON WIRELESS STANDARDS & SPECIFICATIONS

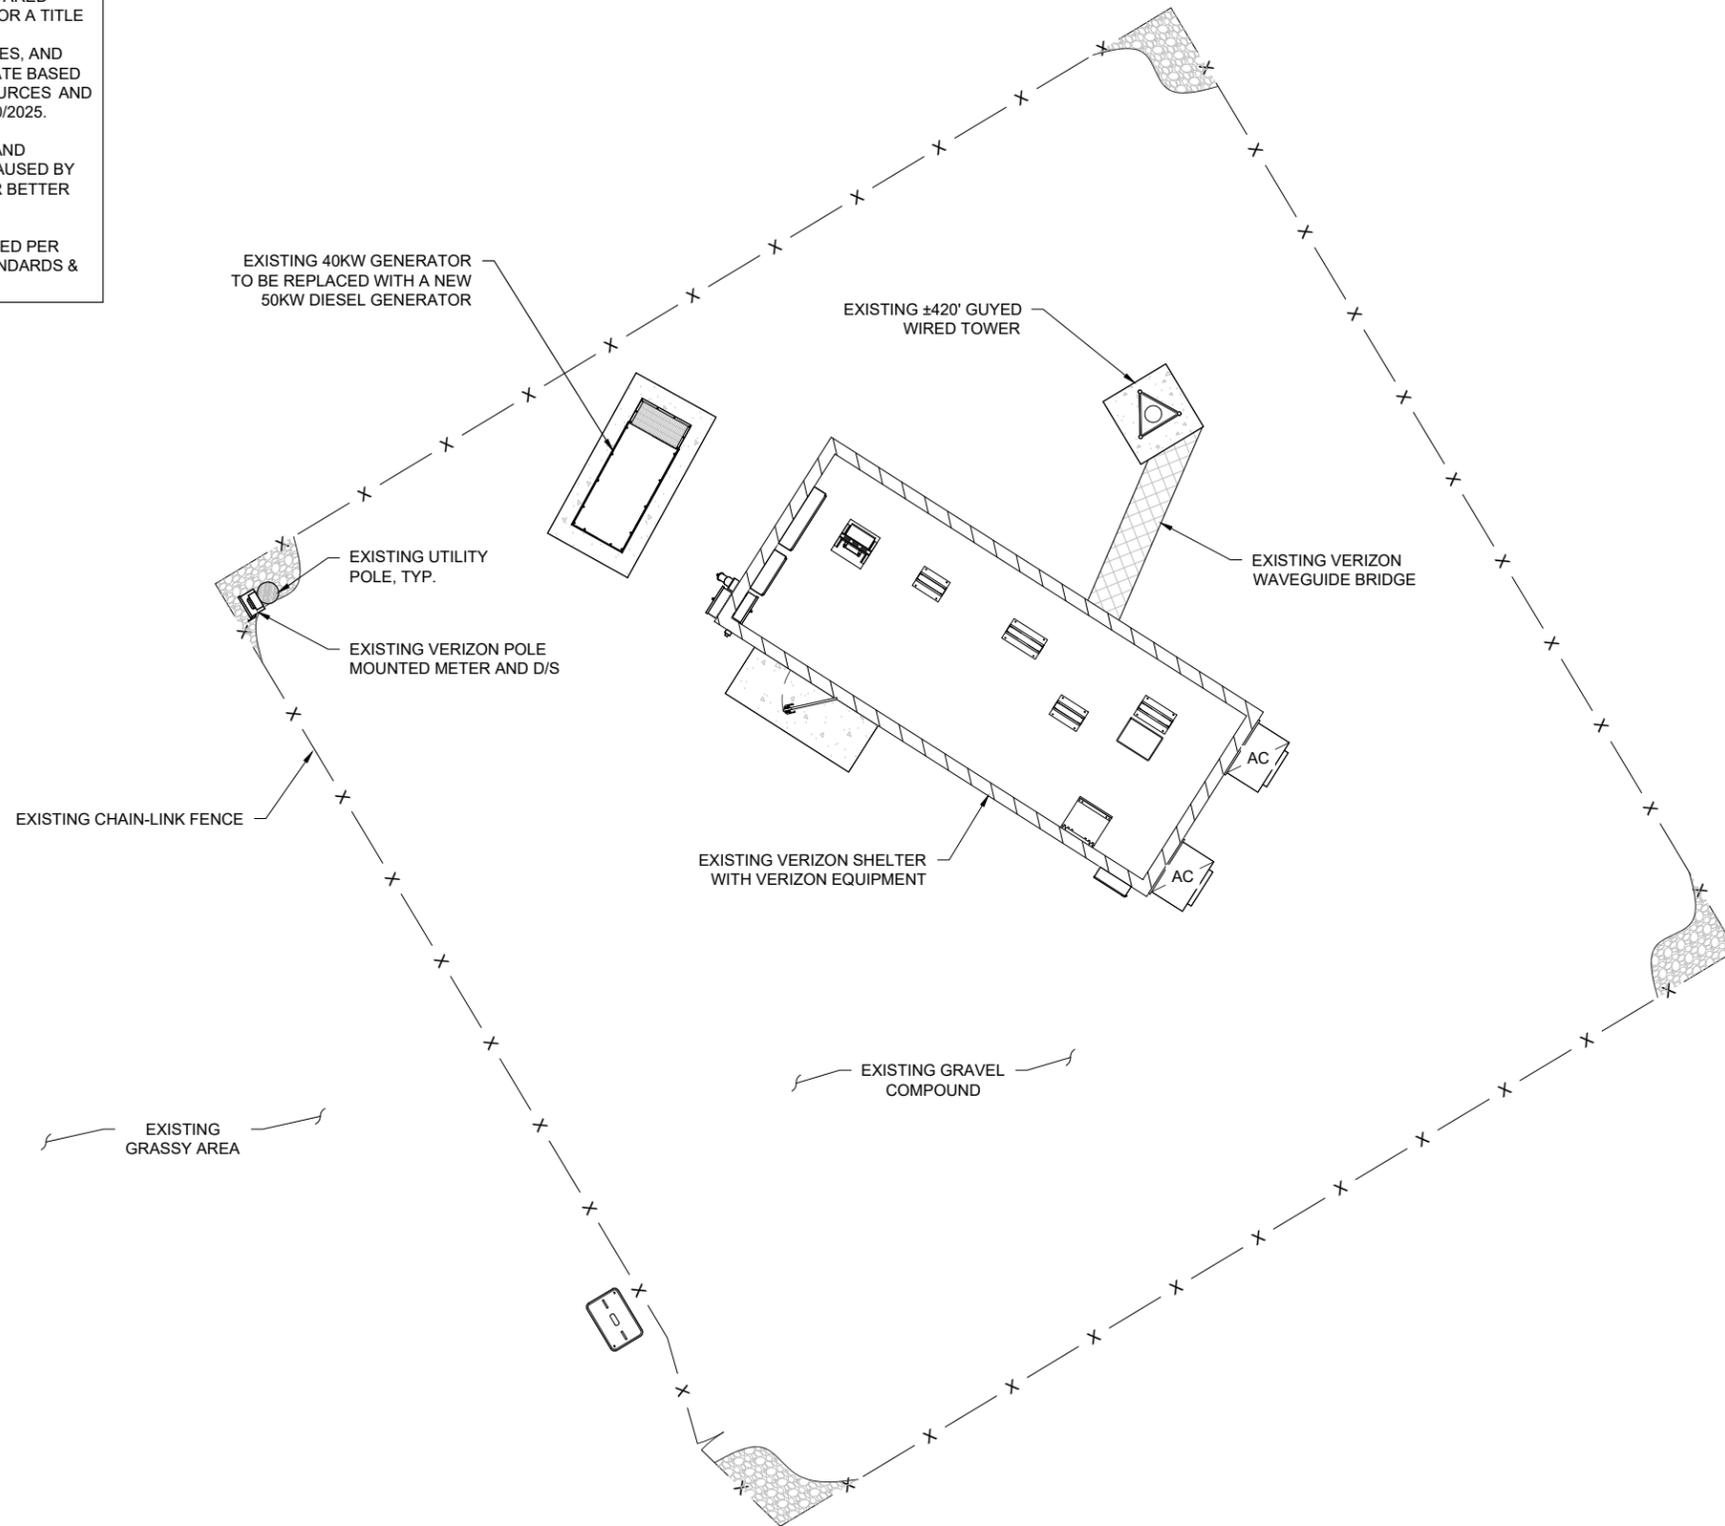

OVERALL SITE PLAN

PREPARED BY

CBVR
TELECOM DESIGN GROUP

6505 N HIMES AVE
TAMPA, FLORIDA 33614
(813) 353-0026
FL CA # 31014

DISCLAIMER:
NO COPIES, REPRODUCTIONS, TRANSMISSIONS OR ELECTRONIC MANIPULATION OF ANY PORTION OF THESE DRAWINGS IN WHOLE OR IN PART ARE TO BE MADE WITHOUT THE EXPRESS WRITTEN PERMISSION OF CBVR TELECOM DESIGN GROUP. ALL DESIGNS INDICATED IN THESE DRAWINGS ARE PROPERTY OF CBVR TELECOM DESIGN GROUP. ALL COPYRIGHTS RESERVED (C) 2025. THESE PLANS ARE FOR BUILDING DEPARTMENT REVIEW ONLY THEY ARE NOT TO BE CONSTRUED AS CONSTRUCTION DOCUMENTS UNTIL ALL BUILDING DEPARTMENT APPROVALS ARE OBTAINED.

PROFESSIONAL SEAL

01/12/2026

PREPARED FOR

7701 E. TELECOM PKWY
TEMPLE TERRACE, FLORIDA 33637

PROJECT INFORMATION

5000025934
LAKE CITY NORTH
279 NW OSTEEN CT
LAKE CITY, FL 32055

CBVR PROJECT #: VZW.301.25

ISSUED DATES

0	FOR PERMIT / CONSTRUCTION	01.12.26


SHEET NAME

OVERALL SITE PLAN

SHEET NUMBER

C-1.1

NOTES:
ALL EXISTING AND PROPOSED EQUIPMENT CONFIGURATIONS SHALL BE FIELD VERIFIED AND CONFIRMED BY GC WITH THE VERIZON WIRELESS CONSTRUCTION MANAGER.

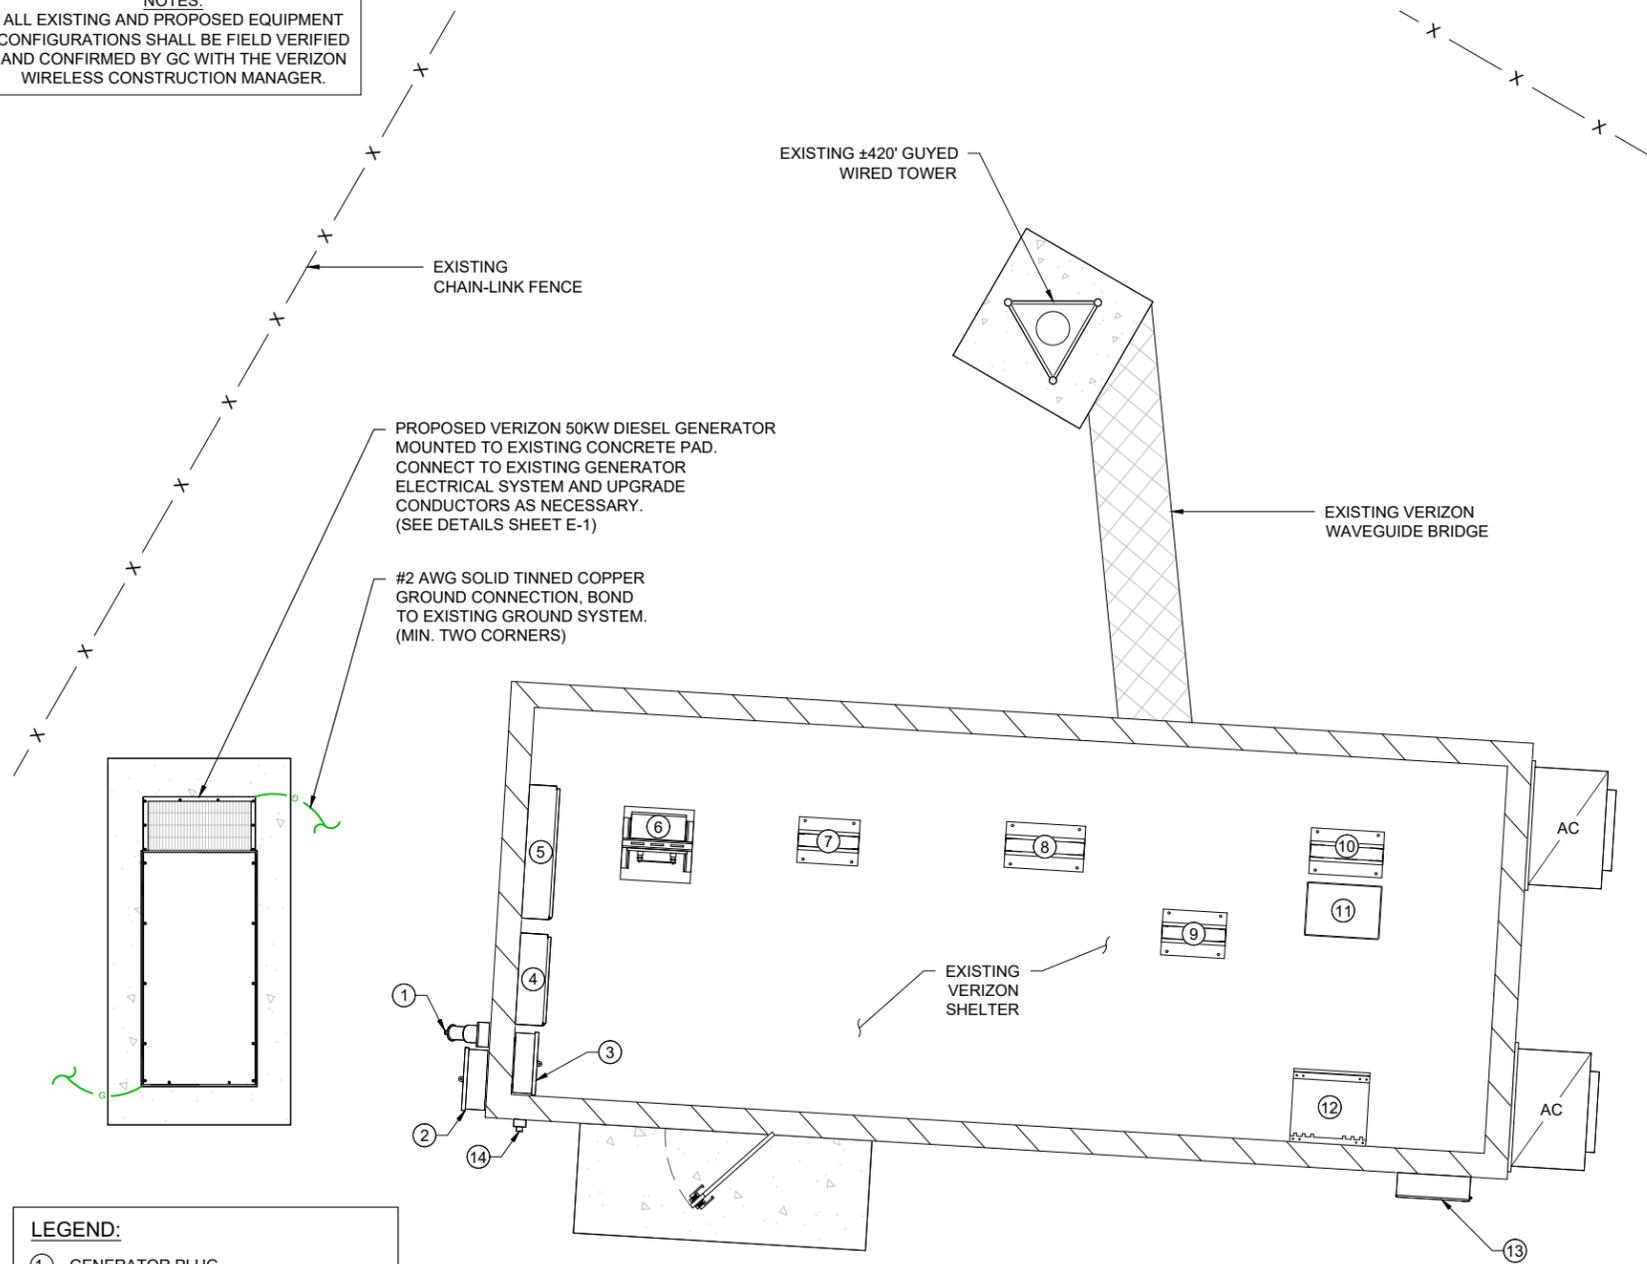


PROPOSED VERIZON 50KW DIESEL GENERATOR MOUNTED TO EXISTING CONCRETE PAD. CONNECT TO EXISTING GENERATOR ELECTRICAL SYSTEM AND UPGRADE CONDUCTORS AS NECESSARY. (SEE DETAILS SHEET E-1)

#2 AWG SOLID TINNED COPPER GROUND CONNECTION, BOND TO EXISTING GROUND SYSTEM. (MIN. TWO CORNERS)

- LEGEND:**
- ① GENERATOR PLUG
 - ② AUTOMATIC TRANSFER SWITCH
 - ③ MANUAL TRANSFER SWITCH
 - ④ MAIN ELECTRICAL PANEL
 - ⑤ TELCO CABINET
 - ⑥ POWER PLANT
 - ⑦ TRANSPORT RACK
 - ⑧ RADIO RACK
 - ⑨ OVP RACK
 - ⑩ EQUIPMENT RACK
 - ⑪ RADIO CABINET
 - ⑫ BATTERY BANK
 - ⑬ FIBER BOX
 - ⑭ PROPOSED GEN. SHUT-OFF BUTTON


GRAPHIC SCALE



ENLARGED EQUIPMENT PLAN

EMERGENCY PUSH BUTTON NOTE:

1. PROPOSED EMERGENCY STOP BUTTON MAINTAINED 50MM RED MUSHROOM PUSH BUTTON, EMERGENCY STOP ENGRAVED, BLACK BEZEL, WITH ONE N.C. CONTACT MODEL E22JLB2N88 BY EATON OR APPROVED EQUAL IN NEMA 3R HOUSING W/P600 CONTACT RATING DESIGNATION TO BREAK IGNITION POWER OF EMERGENCY GENERATOR (VERIFY CONTACT RATING AND EXACT WIRING WITH GEN. MANUF.) SUPPLY AND INSTALL ENGRAVED PLAQUE STATING "VERIZON WIRELESS EMERGENCY STOP". STOP BUTTON SHALL BE READILY VISIBLE TO APPROACHING PERSONNEL.
2. CONSTRUCTION, INSTALLATION MAINTENANCE, AND OPERATIONAL TESTING OF EPSS SHALL COMPLY WITH THE LATEST ADOPTED EDITION OF NFPA 110.
3. ALL ELECTRICAL WORK SHALL COMPLY WITH THE LATEST ADOPTED EDITION OF NFPA 70 NATIONAL ELECTRICAL CODE

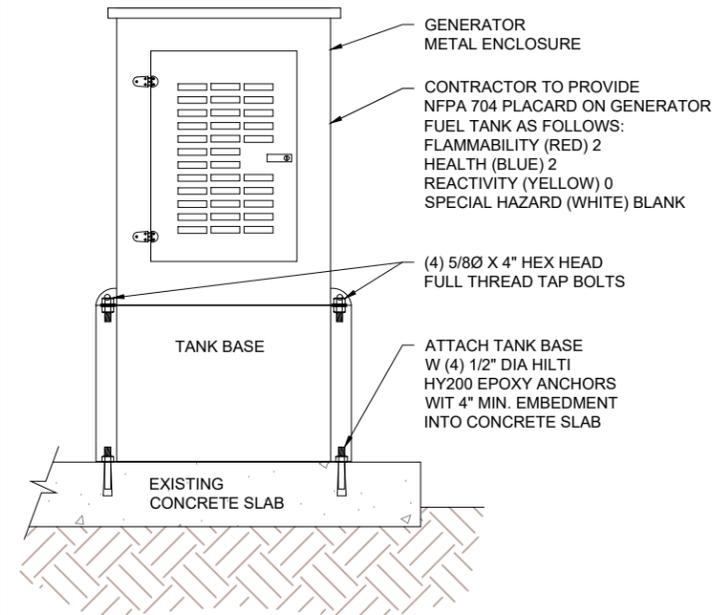

DIESEL GENERATOR ANCHOR DETAIL

NOT TO SCALE



DISCLAIMER:
NO COPIES, REPRODUCTIONS, TRANSMISSIONS OR ELECTRONIC MANIPULATION OF ANY PORTION OF THESE DRAWINGS IN WHOLE OR IN PART ARE TO BE MADE WITHOUT THE EXPRESS WRITTEN PERMISSION OF CBVR TELECOM DESIGN GROUP. ALL DESIGNS INDICATED IN THESE DRAWINGS ARE PROPERTY OF CBVR TELECOM DESIGN GROUP. ALL COPYRIGHTS RESERVED (C) 2025. THESE PLANS ARE FOR BUILDING DEPARTMENT REVIEW ONLY THEY ARE NOT TO BE CONSTRUED AS CONSTRUCTION DOCUMENTS UNTIL ALL BUILDING DEPARTMENT APPROVALS ARE OBTAINED.



01/12/2026



PROJECT INFORMATION


5000025934
LAKE CITY NORTH
279 NW OSTEEN CT
LAKE CITY, FL 32055

CBVR PROJECT #: VZW.301.25

ISSUED DATES	
0	FOR PERMIT / CONSTRUCTION 01.12.26

SHEET NAME
ENLARGED EQUIPMENT LAYOUT PLANS

SHEET NUMBER
C-2

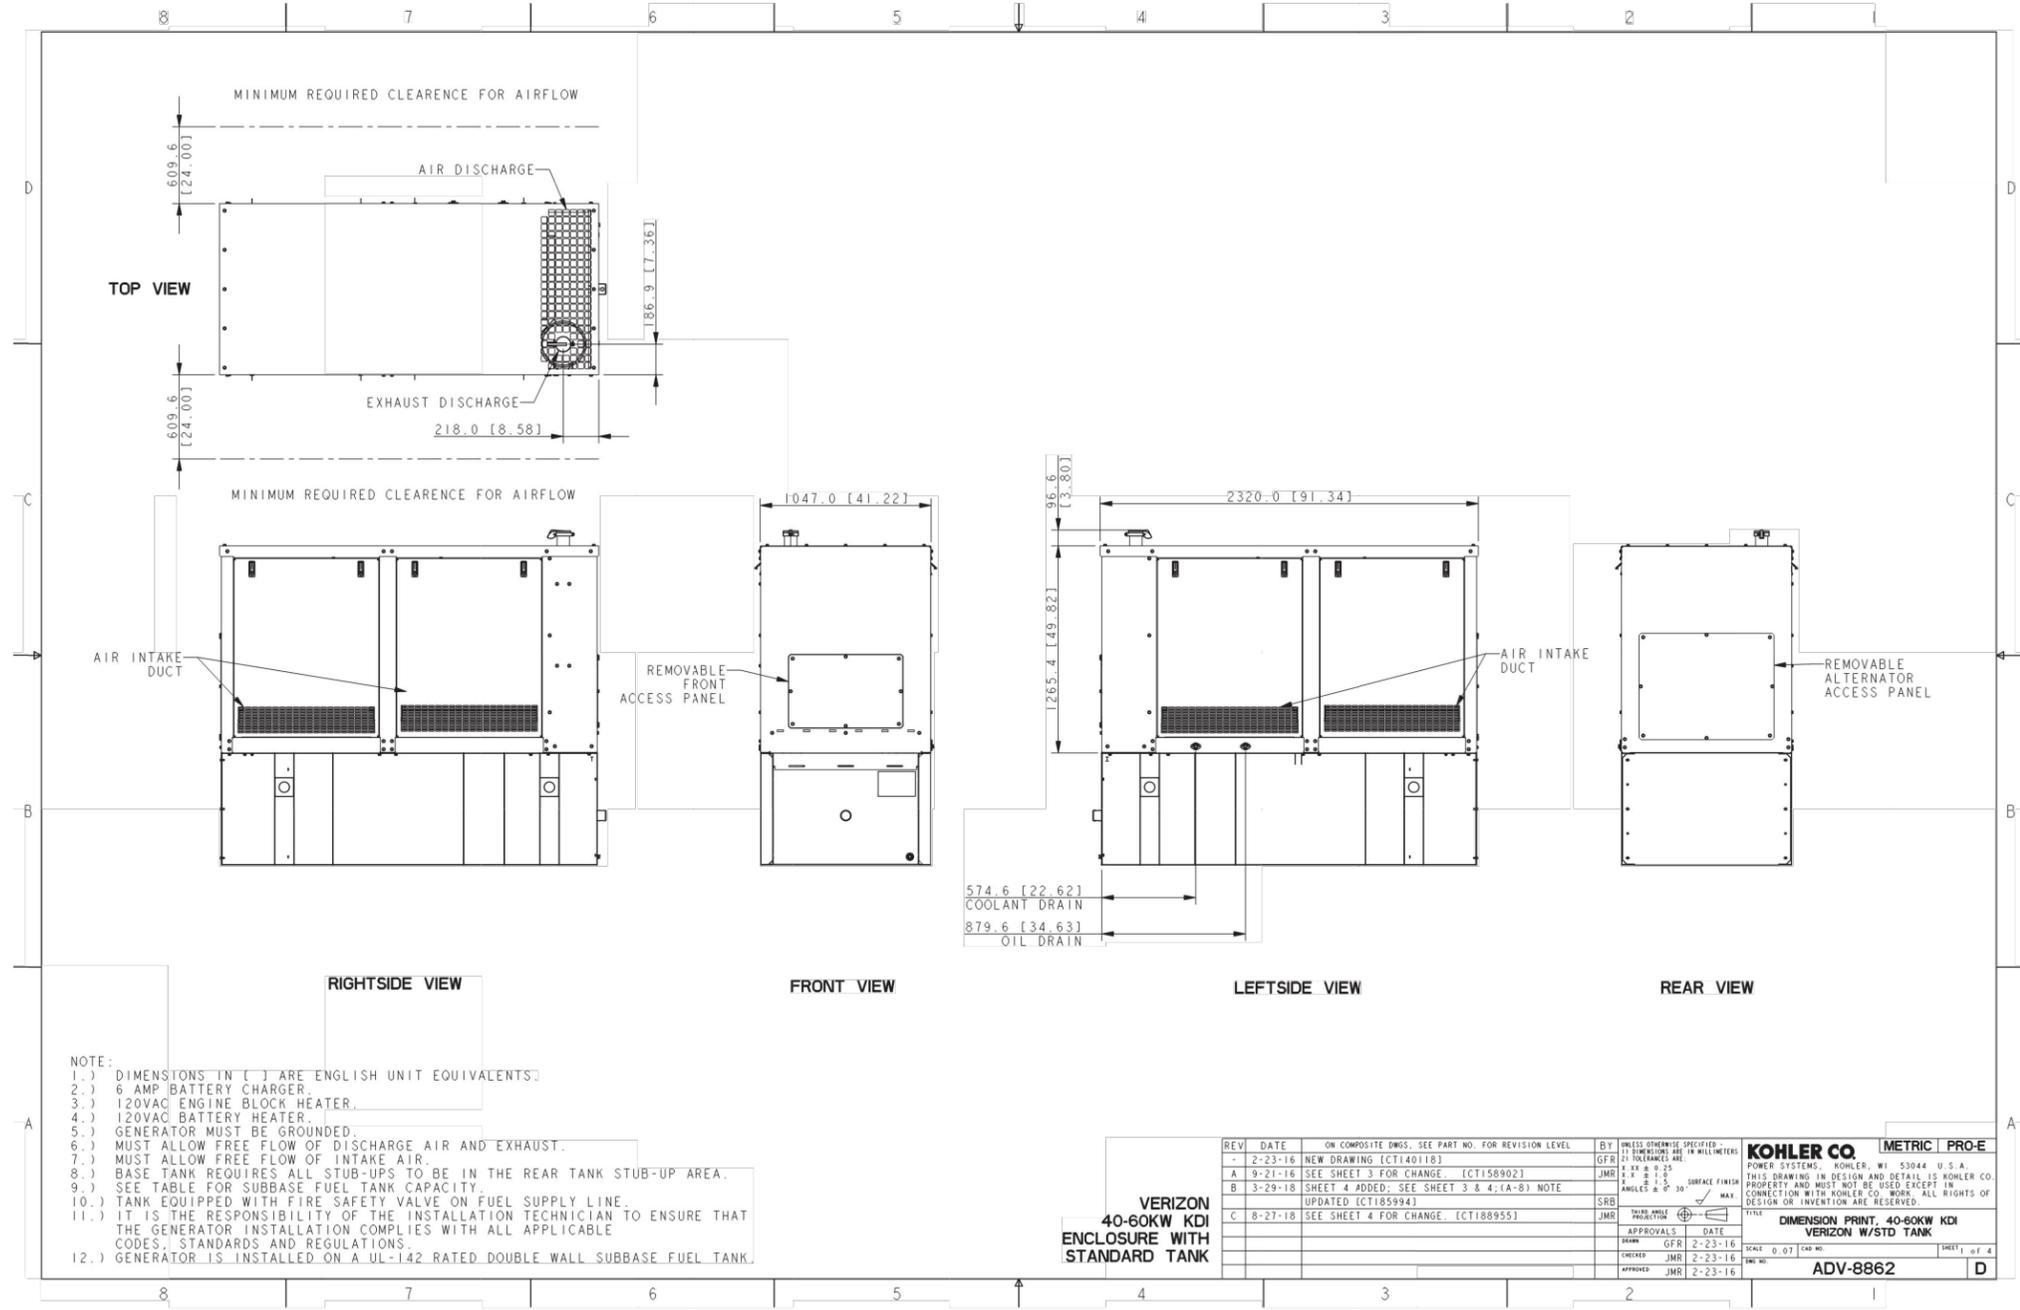

- NOTE:
- 1.) DIMENSIONS IN [] ARE ENGLISH UNIT EQUIVALENTS.
 - 2.) 6 AMP BATTERY CHARGER.
 - 3.) 120VAC ENGINE BLOCK HEATER.
 - 4.) 120VAC BATTERY HEATER.
 - 5.) GENERATOR MUST BE GROUNDED.
 - 6.) MUST ALLOW FREE FLOW OF DISCHARGE AIR AND EXHAUST.
 - 7.) MUST ALLOW FREE FLOW OF INTAKE AIR.
 - 8.) BASE TANK REQUIRES ALL STUB-UPS TO BE IN THE REAR TANK STUB-UP AREA.
 - 9.) SEE TABLE FOR SUBBASE FUEL TANK CAPACITY.
 - 10.) TANK EQUIPPED WITH FIRE SAFETY VALVE ON FUEL SUPPLY LINE.
 - 11.) IT IS THE RESPONSIBILITY OF THE INSTALLATION TECHNICIAN TO ENSURE THAT THE GENERATOR INSTALLATION COMPLIES WITH ALL APPLICABLE CODES, STANDARDS AND REGULATIONS.
 - 12.) GENERATOR IS INSTALLED ON A UL-142 RATED DOUBLE WALL SUBBASE FUEL TANK.

REV	DATE	ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL	BY	UNLESS OTHERWISE SPECIFIED: 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE	COOLER CO. METRIC PRO-E
-	2-23-16	NEW DRAWING [CT140118]	GFR	± 0.25	POWER SYSTEMS, KOHLER, WI 53044 U.S.A.
A	9-21-16	SEE SHEET 3 FOR CHANGE [CT158902]	JMR	± 0.25	THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED.
B	3-29-18	SHEET 4 ADDED; SEE SHEET 3 & 4.(A-B) NOTE	JMR	± 0.25	
		UPDATED [CT185943]	SRB	± 0.25	
C	8-27-18	SEE SHEET 4 FOR CHANGE [CT188955]	JMR	± 0.25	

VERIZON 40-60KW KDI ENCLOSURE WITH STANDARD TANK

APPROVALS DATE

SCALE 0.07 CAR NO. SHEET 1 OF 4

ADV-8862 D

DRAWINGS BY MANUFACTURER

PREPARED BY

CBVR

TELECOM DESIGN GROUP

6505 N HIMES AVE
TAMPA, FLORIDA 33614
(813) 353-0026
FL CA # 31014

DISCLAIMER:
NO COPIES, REPRODUCTIONS, TRANSMISSIONS OR ELECTRONIC MANIPULATION OF ANY PORTION OF THESE DRAWINGS IN WHOLE OR IN PART ARE TO BE MADE WITHOUT THE EXPRESS WRITTEN PERMISSION OF CBVR TELECOM DESIGN GROUP. ALL DESIGNS INDICATED IN THESE DRAWINGS ARE PROPERTY OF CBVR TELECOM DESIGN GROUP. ALL COPYRIGHTS RESERVED (C) 2025. THESE PLANS ARE FOR BUILDING DEPARTMENT REVIEW ONLY THEY ARE NOT TO BE CONSTRUED AS CONSTRUCTION DOCUMENTS UNTIL ALL BUILDING DEPARTMENT APPROVALS ARE OBTAINED.

PROFESSIONAL SEAL

01/12/2026

PREPARED FOR

verizon

7701 E. TELECOM PKWY
TEMPLE TERRACE, FLORIDA 33637

PROJECT INFORMATION

5000025934
LAKE CITY NORTH
279 NW OSTEEN CT
LAKE CITY, FL 32055

CBVR PROJECT #: VZW.301.25


ISSUED DATES	
0	FOR PERMIT / CONSTRUCTION 01.12.26

SHEET NAME


GENERATOR DETAIL

SHEET NUMBER


C-3

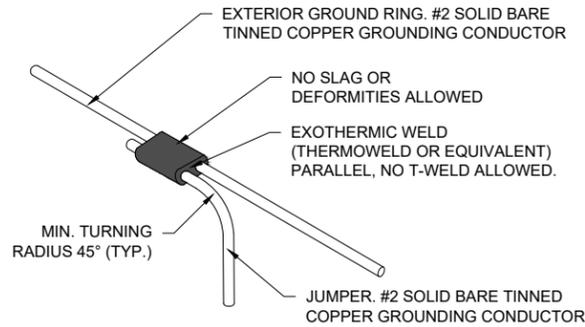

EXOTHERMIC WELD DETAIL
NOT TO SCALE

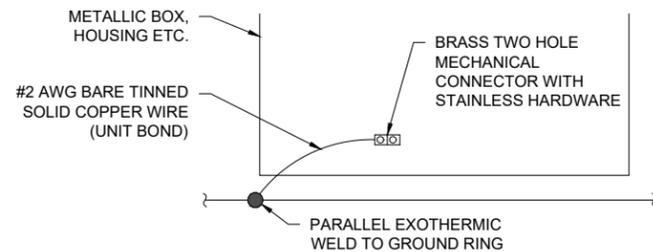

TYP. METALLIC GROUNDING DETAIL
NOT TO SCALE

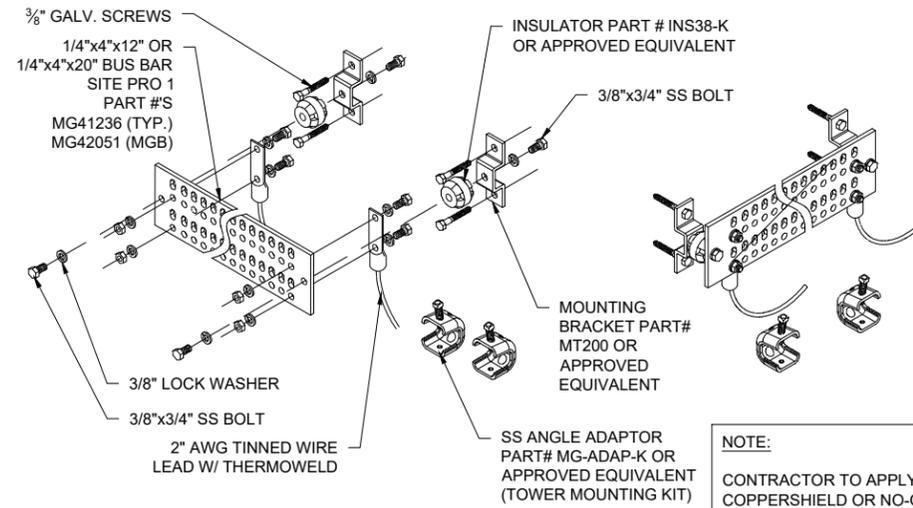

TYP. GROUND BAR DETAIL
NOT TO SCALE

ELECTRICAL NOTES:

ALL ELECTRICAL WORK SHALL CONFORM TO THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE (N.E.C.), AND APPLICABLE LOCAL CODES.

GROUNDING SHALL COMPLY WITH ARTICLE 250 OF NATIONAL ELECTRICAL CODE.

ALL ELECTRICAL ITEMS SHALL BE U.L. APPROVED OR LISTED.

ALL WIRES SHALL BE AWG MIN #12 THHN COPPER UNLESS NOTED.

CONDUCTORS SHALL BE INSTALLED IN SCHEDULE 40 PVC CONDUIT UNLESS NOTED OTHERWISE.

ROUTE GROUNDING CONDUCTORS ALONG THE SHORTEST AND STRAIGHTEST PATH POSSIBLE. BEND GROUNDING LEADS WITH A MINIMUM 8" RADIUS.

ENGAGE AN INDEPENDENT TESTING FIRM TO TEST AND VERIFY THAT RESISTANCE DOES NOT EXCEED 5 OHMS TO GROUND. TEST GROUND RING RESISTANCE PRIOR TO MAKING FINAL GROUND CONNECTIONS TO INFRASTRUCTURE AND EQUIPMENT. GROUNDING AND OTHER OPERATIONAL TESTING SHALL BE WITNESSED BY VERIZON WIRELESS REPRESENTATIVE.

PROVIDE PULL BOXES AND JUNCTION BOXES WHERE REQUIRED SO THAT CONDUIT BENDS DO NOT EXCEED 360°.

OBTAIN PERMITS AND PAY FEES RELATED TO ELECTRICAL WORK PERFORMED ON THIS PROJECT. DELIVER COPIES OF ALL PERMITS TO VERIZON WIRELESS REPRESENTATIVE.

SCHEDULE AND ATTEND INSPECTIONS RELATED TO ELECTRICAL WORK REQUIRED BY JURISDICTION HAVING AUTHORITY. CORRECT AND PAY FOR ANY WORK REQUIRED TO PASS ANY FAILED INSPECTION.

REDLINED AS-BUILTS ARE TO BE DELIVERED TO VERIZON WIRELESS REPRESENTATIVE.

ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH ALL APPLICABLE BUILDING CODES AND LOCAL ORDINANCES, INSTALLED IN A NEAT MANNER, AND SHALL BE SUBJECT TO APPROVAL BY VERIZON WIRELESS REPRESENTATIVE.

CONDUCT A PRE-CONSTRUCTION SITE VISIT AND VERIFY EXISTING SITE CONDITIONS AFFECTING THIS WORK. REPORT ANY OMISSIONS OR DISCREPANCIES FOR CLARIFICATION PRIOR TO THE START OF CONSTRUCTION.

PROTECT ADJACENT STRUCTURES AND FINISHES FROM DAMAGE. REPAIR TO ORIGINAL CONDITION ANY DAMAGED AREA.

REMOVE DEBRIS ON A DAILY BASIS. DEBRIS NOT REMOVED IN A TIMELY FASHION WILL BE REMOVED BY OTHERS AND THE RESPONSIBLE SUBCONTRACTOR SHALL BE CHARGED ACCORDINGLY. REMOVAL OF DEBRIS SHALL BE COORDINATED WITH THE OWNER'S REPRESENTATIVE. DEBRIS SHALL BE REMOVED FROM THE PROPERTY AND DISPOSED OF LEGALLY.

UPON COMPLETION OF WORK, THE SITE SHALL BE CLEAN AND FREE OF DUST AND FINGERPRINTS.

GROUNDING NOTES:

ALL DOWN GROUND WIRE AND GROUND SYSTEM WIRE SHALL BE #2 AWG, SOLID, BARE, TINNED COPPER. ALL CONNECTIONS TO GROUND SYSTEM SHALL BE EXOTHERMICALLY WELDED.

WHERE MECHANICAL GROUNDING CONNECTIONS ARE SPECIFIED, BOLTED, COMPRESSION-TYPE CLAMPS OR SPLIT-BOLT TYPE CONNECTORS SHALL BE USED.

GRIND OFF GALVANIZING IN AFFECTED AREA. EXOTHERMICALLY WELD #2 CONDUCTOR. COLD-GALV AFTER. EXOTHERMICALLY WELD OTHER END TO GROUND.

FOLLOWING COMPLETION OF WORK, CONDUCT GROUND TEST. SUBMIT WRITTEN TEST TO CONSTRUCTION MANAGER AND PROJECT MANAGER.

ALL GROUNDING WORK SHALL COMPLY WITH VERIZON WIRELESS STANDARDS.

UNLESS NOTED OTHERWISE, ALL GROUNDING SHALL BE IN ACCORDANCE WITH VERIZON WIRELESS'S REQUIREMENTS FOR "BONDING, GROUNDING AND TRANSIENT PROTECTION FOR CELL SITES", AND "SITE RESISTANCE TO EARTH TESTING". ALL GROUNDING SHALL ALSO COMPLY WITH ALL STATE AND LOCAL CODES, AND THE NATIONAL ELECTRICAL CODE (NEC).

UNLESS NOTED OTHERWISE, ALL GROUNDING CONNECTIONS SHALL BE MADE BY AN EXOTHERMIC WELD.


RESISTANCE TO EARTH TESTING IS REQUIRED PER NEC STANDARDS ON ALL NEW SITES.

NEW INSTALLED ANTENNA PIPE MOUNTS SHALL BE EXOTHERMICAL GROUND W/ #2 AWG SOLID TINNED COPPER TO EXISTING GROUND SYSTEM (EACH SECTOR).


ALL NEW COAX OR HYBRID CABLES SHALL BE GROUNDED W/ SUPPLIED GROUND KIT TO SECTOR GROUND SYSTEM.

NOTES:

- DO NOT INSTALL CABLE GROUND KIT AT A BEND AND ALWAYS DIRECT GROUND WIRE DOWN TO GROUND BAR GROUNDING KIT SHALL BE TYPE AND PART NUMBER AS SUPPLIED OR RECOMMENDED BY CABLE MANUFACTURER.
- WEATHERPROOFING SHALL BE TYPE AND PART NUMBER AS SUPPLIED OR RECOMMENDED BY CABLE MANUFACTURER.
- BUTYL TAPE WEATHERPROOFING MUST FOLLOW MANUFACTURER'S INSTALLATION INSTRUCTIONS WITH THE FOLLOWING MODIFICATION: ON THE FIRST TAPE PASS PROVIDE A COURTESY WRAP TO AVOID PERMANENTLY ADHERING TO THE COAX CONNECTOR. START TAPE APPROXIMATELY 5 INCHES FROM THE CONNECTOR AND WRAP 2 INCHES TOWARD THE CONNECTOR, THEN REVERSE THE TAPE A HALF TURN OR SO THAT THE STICKY SIDE IS UP. CONTINUE WRAPPING THE TAPE OVER THE CONNECTOR UNTIL 3 INCHES BEYOND THE CONNECTOR AND REVERSE THE TAPE A HALF TURN AGAIN OR SO THAT THE STICKY SIDE IS DOWN FOR ANOTHER 2 INCHES.
- WHEN APPLIED, THE TAPE MUST BE ABOVE 32°F (0°C) TO ENSURE ADHESION
- DO NOT STRETCH THE TAPE AND DO NOT PULL THE TAPE TO TEAR IT - ALWAYS CUT IT. PULLED TAPE EVENTUALLY UNRAVELS, DECREASING POSITION.
- TIGHTLY WRAP THE RUBBER TAPE WITH 2 LAYERS OF VINYL INSULATING TAPE.

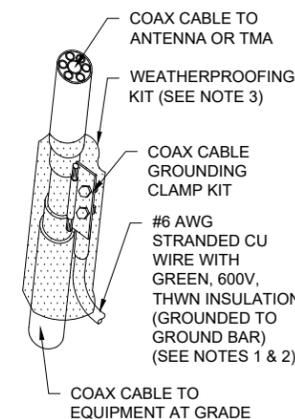

COAX CABLE GROUND
NOT TO SCALE

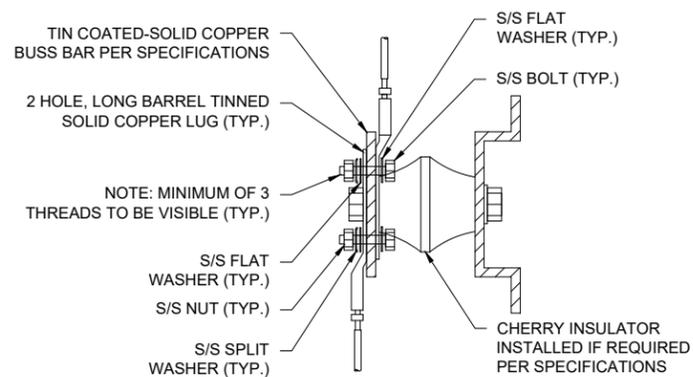

NOTES:

- ALL HARDWARE 18-8 STAINLESS STEEL INCLUDING SPLIT WASHERS.
- COAT WIRE END WITH ANTI-OXIDATION COMPOUND PRIOR TO INSERTION INTO LUG BARREL AND CRIMPING.
- APPLY ANTI-OXIDATION COMPOUND BETWEEN ALL LUGS AND BUSS BARS PRIOR TO MATING AND BOLTING.

GROUNDING BAR LUG DETAIL
NOT TO SCALE



6505 N HIMES AVE
TAMPA, FLORIDA 33614
(813) 353-0026
FL CA # 31014

DISCLAIMER:
NO COPIES, REPRODUCTIONS, TRANSMISSIONS OR ELECTRONIC MANIPULATION OF ANY PORTION OF THESE DRAWINGS IN WHOLE OR IN PART ARE TO BE MADE WITHOUT THE EXPRESS WRITTEN PERMISSION OF CBVR TELECOM DESIGN GROUP. ALL DESIGNS INDICATED IN THESE DRAWINGS ARE PROPERTY OF CBVR TELECOM DESIGN GROUP. ALL COPYRIGHTS RESERVED (C) 2025. THESE PLANS ARE FOR BUILDING DEPARTMENT REVIEW ONLY THEY ARE NOT TO BE CONSTRUED AS CONSTRUCTION DOCUMENTS UNTIL ALL BUILDING DEPARTMENT APPROVALS ARE OBTAINED.

PROFESSIONAL SEAL



01/12/2026

PREPARED FOR



7701 E. TELECOM PKWY
TEMPLE TERRACE, FLORIDA 33637

PROJECT INFORMATION

5000025934
LAKE CITY NORTH
279 NW OSTEEN CT
LAKE CITY, FL 32055

CBVR PROJECT #: VZW.301.25

ISSUED DATES


DATE	DESCRIPTION	BY
01.12.26	FOR PERMIT / CONSTRUCTION	

SHEET NAME

GROUNDING DETAILS

SHEET NUMBER

E-1

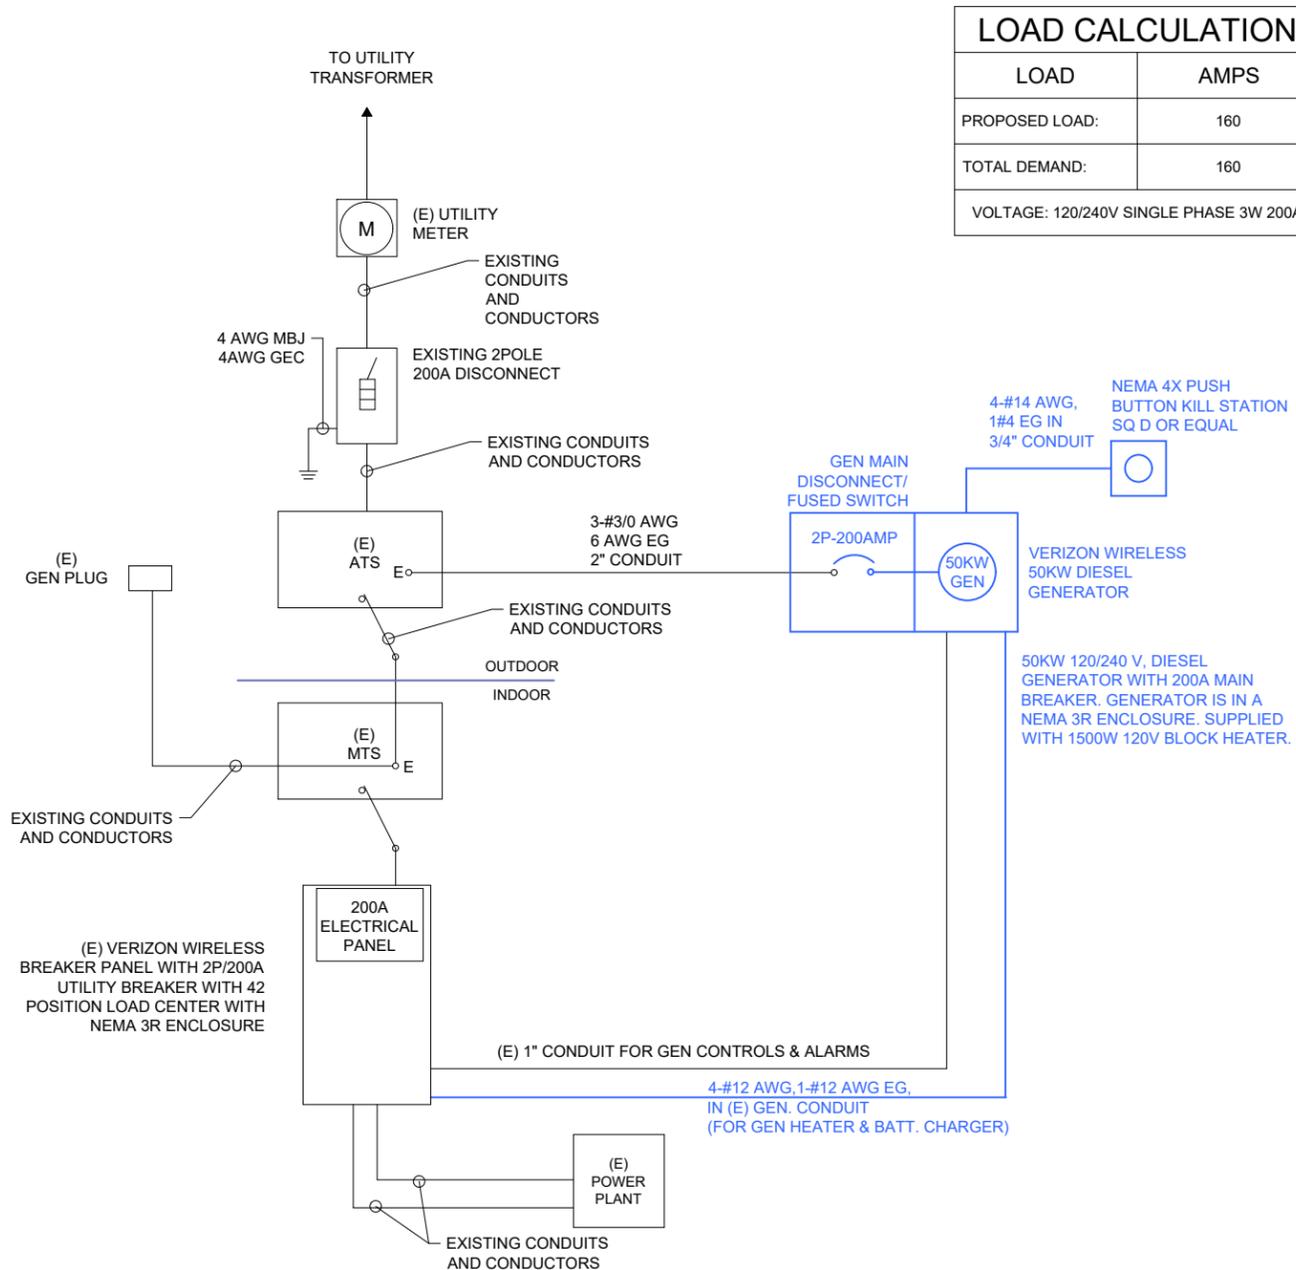

ELECTRICAL SINGLE LINE DIAGRAM

LOAD CALCULATION	
LOAD	AMPS
PROPOSED LOAD:	160
TOTAL DEMAND:	160
VOLTAGE: 120/240V SINGLE PHASE 3W 200A	

PANEL NAME:		AC PANEL BOARD			MODEL NUMBER:		UL PANELBOARD								
RATED VOLTAGE:		240	120	VOLTS	PHASE/WIRE:		1	3							
MAIN BREAKER:		200 AMPS			BUS RATING:		200								
MOUNT:		SURFACE			NEUTRAL BAR:		YES								
ENCLOSURE TYPE:		NEMA 3R			AIC:		10K								
POS	USAGE FACTOR	BUS AMPS		LOAD	POLES	AMPS	L1	L2	AMPS	POLES	LOAD	BUS AMPS		USAGE FACTOR	POS
							L1	L2							
1	1	18		AIR COND. #1	2	60A			20A	2	LTE/L3 (OFF)				2
3	1		18												4
5	1	18		AIR COND. #2	2	60A			40A	2	RECTIFIER 1.1 & 1.2	16		1	6
7	1		18										16	1	8
9	1	4		EXT INT LTS EMERGENCY LTS.	1	20A			40A	2	RECTIFIER 2.1 & 2.2	16		1	10
11	1		4	RECEPTACLES	1	20A			40A	2			16	1	12
13	1	4		RECEPTACLES	1	20A			40A	2	RECTIFIER 3.1 & 3.2	16		1	14
15	1		4	HALON PANEL	1	20A			40A	2			16	1	16
17	1	4		EQUIP. PWR OUTLET #1	1	20A			40A	2	RECTIFIER 4.1 & 4.2	16		1	18
19	1		4	EQUIP. PWR OUTLET #2	1	20A			40A	2			16	1	20
21	1	4		EQUIP. PWR OUTLET #3	1	20A			40A	2	RECTIFIER 1.3 & 1.4	16		1	22
23	1		4	EXT., INT. LTS.	1	20A			40A	2			16	1	24
25				850 CAB (OFF)	30A	2			40A	2	RECTIFIER 2.3 & 2.4	16		1	26
27													16	1	28
29				850 CAB (OFF)	30A	2			20A	1	TOWER LIGHTS	4		1	30
31									30A	2	HUAWEI (OFF)				32
33				LTE 1 (OFF)	20A	2			20A	1	GEN. BLOCK HEATER		4	1	36
35									20A	1	GEN. BATTERY CHARGER	4		1	38
37				LTE 2 (OFF)	20A	2									40
39									40A	2	SURGE PROTECTOR			1	42
41	1	4		RECEPTACLES	1	20A								1	42
		56	52	FACTORED SUB TOTAL AMPS							FACTORED SUB TOTAL AMPS	104	100		
										FACTORED TOTAL AMPS		160	152		

NOTES:
 1. ALL CONDUCTORS ARE TYPE THWN (75°C) COPPER, UNLESS NOTED OTHERWISE.
 2. MAXIMUM LENGTH OF RUN FOR RECTIFIER CIRCUITS IS 50FT.
 3. RECTIFIER LOADS ARE CONSIDERED TO BE NON-CONTINUOUS, BLOCK HEATER AND BATTERY CHARGER ARE INACTIVE WHILE GENERATOR IS IN USE.
 4. IF ADDITIONAL FUTURE LOADS ARE ADDED WHICH CAUSE TOTAL DEMAND TO EXCEED GENERATOR BREAKER SIZE, BACKUP POWER SYSTEM SHALL BE EVALUATED AND UPGRADED AS NECESSARY.

PANEL SCHEDULE

PREPARED BY

6505 N HIMES AVE
 TAMPA, FLORIDA 33614
 (813) 353-0026
 FL CA # 31014

DISCLAIMER: NO COPIES, REPRODUCTIONS, TRANSMISSIONS OR ELECTRONIC MANIPULATION OF ANY PORTION OF THESE DRAWINGS IN WHOLE OR IN PART ARE TO BE MADE WITHOUT THE EXPRESS WRITTEN PERMISSION OF CBVR TELECOM DESIGN GROUP. ALL DESIGNS INDICATED IN THESE DRAWINGS ARE PROPERTY OF CBVR TELECOM DESIGN GROUP. ALL COPYRIGHTS RESERVED (C) 2025. THESE PLANS ARE FOR BUILDING DEPARTMENT REVIEW ONLY THEY ARE NOT TO BE CONSTRUED AS CONSTRUCTION DOCUMENTS UNTIL ALL BUILDING DEPARTMENT APPROVALS ARE OBTAINED.

PROFESSIONAL SEAL

01/12/2026

PREPARED FOR

7701 E. TELECOM PKWY
 TEMPLE TERRACE, FLORIDA 33637

PROJECT INFORMATION

5000025934
 LAKE CITY NORTH
 279 NW OSTEEN CT
 LAKE CITY, FL 32055

CBVR PROJECT #: VZW.301.25

ISSUED DATES	
0	FOR PERMIT / CONSTRUCTION 01.12.26

SHEET NAME

ELECTRICAL DETAILS

SHEET NUMBER

E-2