


9' 1-1/8"

1) REFER TO HIB 91 (RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING) REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED.

- 2) ALL TRUSSES (INCLUDING TRUSSES UNDER VALLEY FRAMING) MUST BE COMPLETLY DECKED OR REFER TO DETAIL V05 FOR ALTERNATE DIAPHRAGM REQUIREMENTS.
 - 3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY DOLPHER.
 - 4) ALL TRUSSES, ARE DESIGNED FOR 7' o.c. MAXIMUM SPACING, IN.E59 OTHERWISE NOTED.
 - 5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED.
 - 6) S542 TRUSSES MUST BE INSTALLED WITH THE TOP BEING UP.
- 7) DEANEMADEBUILTE, INC TO BE FURNISHED BY BUILDER.

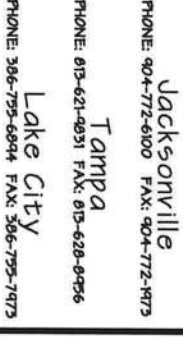

LOT 29 TURKEY CREEK

[illegible]

FL Approval Codes - Mitek Plates #'s 2197.2 - 2197.4, Versa-Lam #1644-R4 & BCI Joists #1392-R4

