



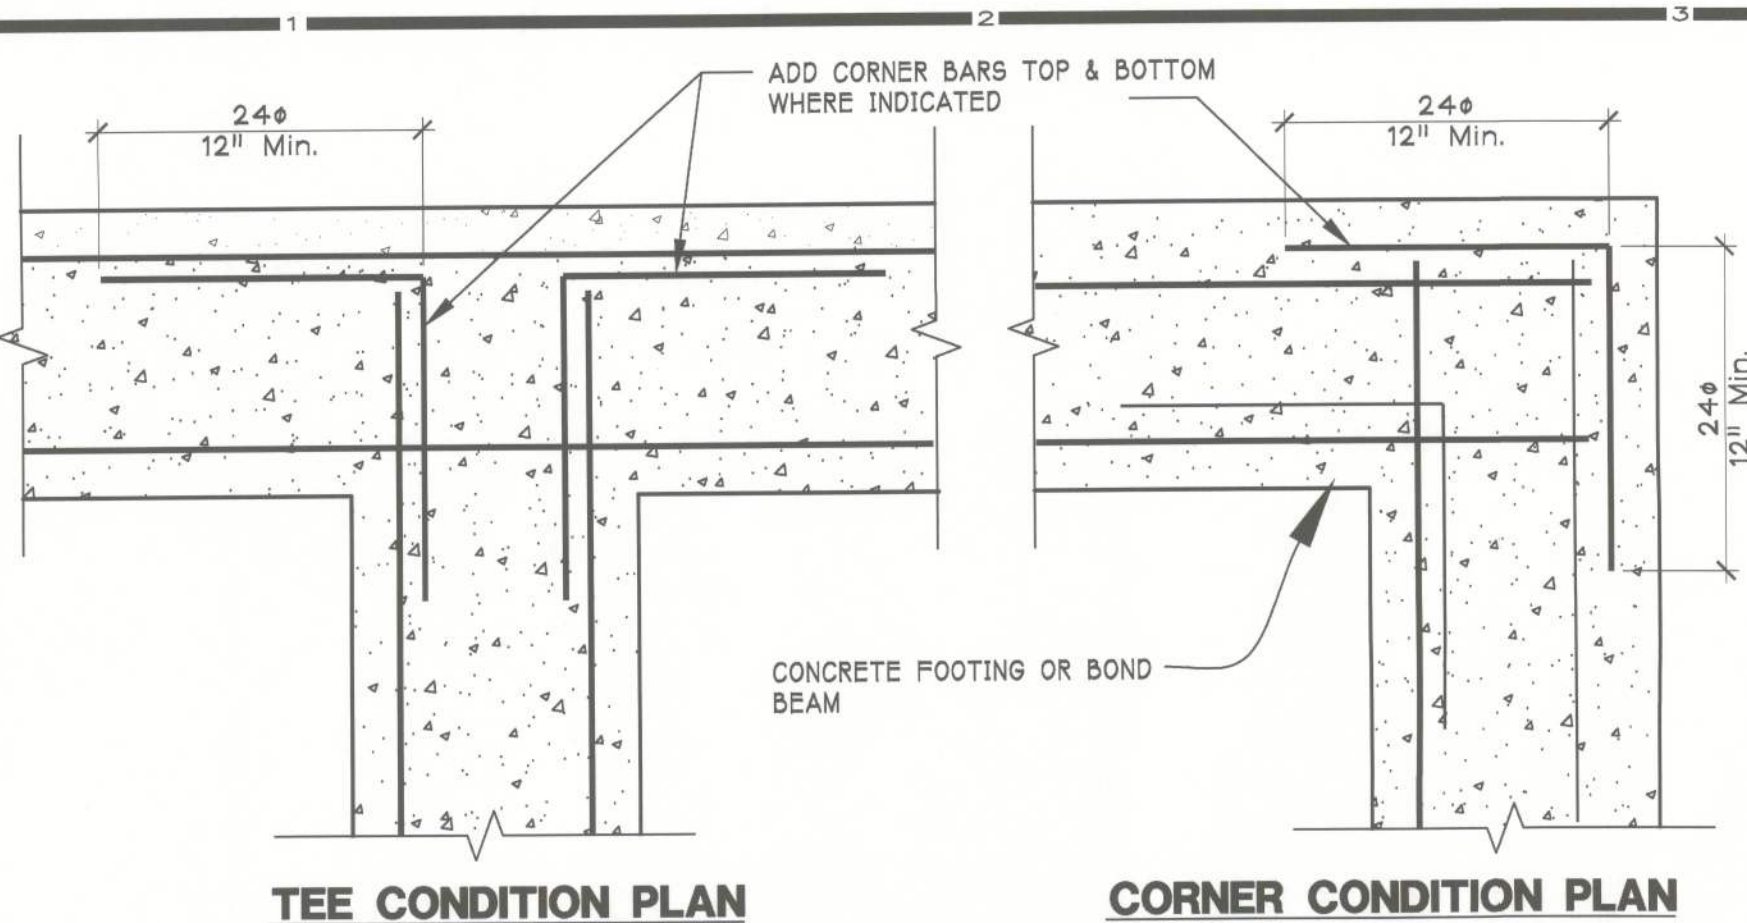


**CONTINUOUS FOOTING CORNER BARS**  
SCALE: 1 1/2"=1'-0"

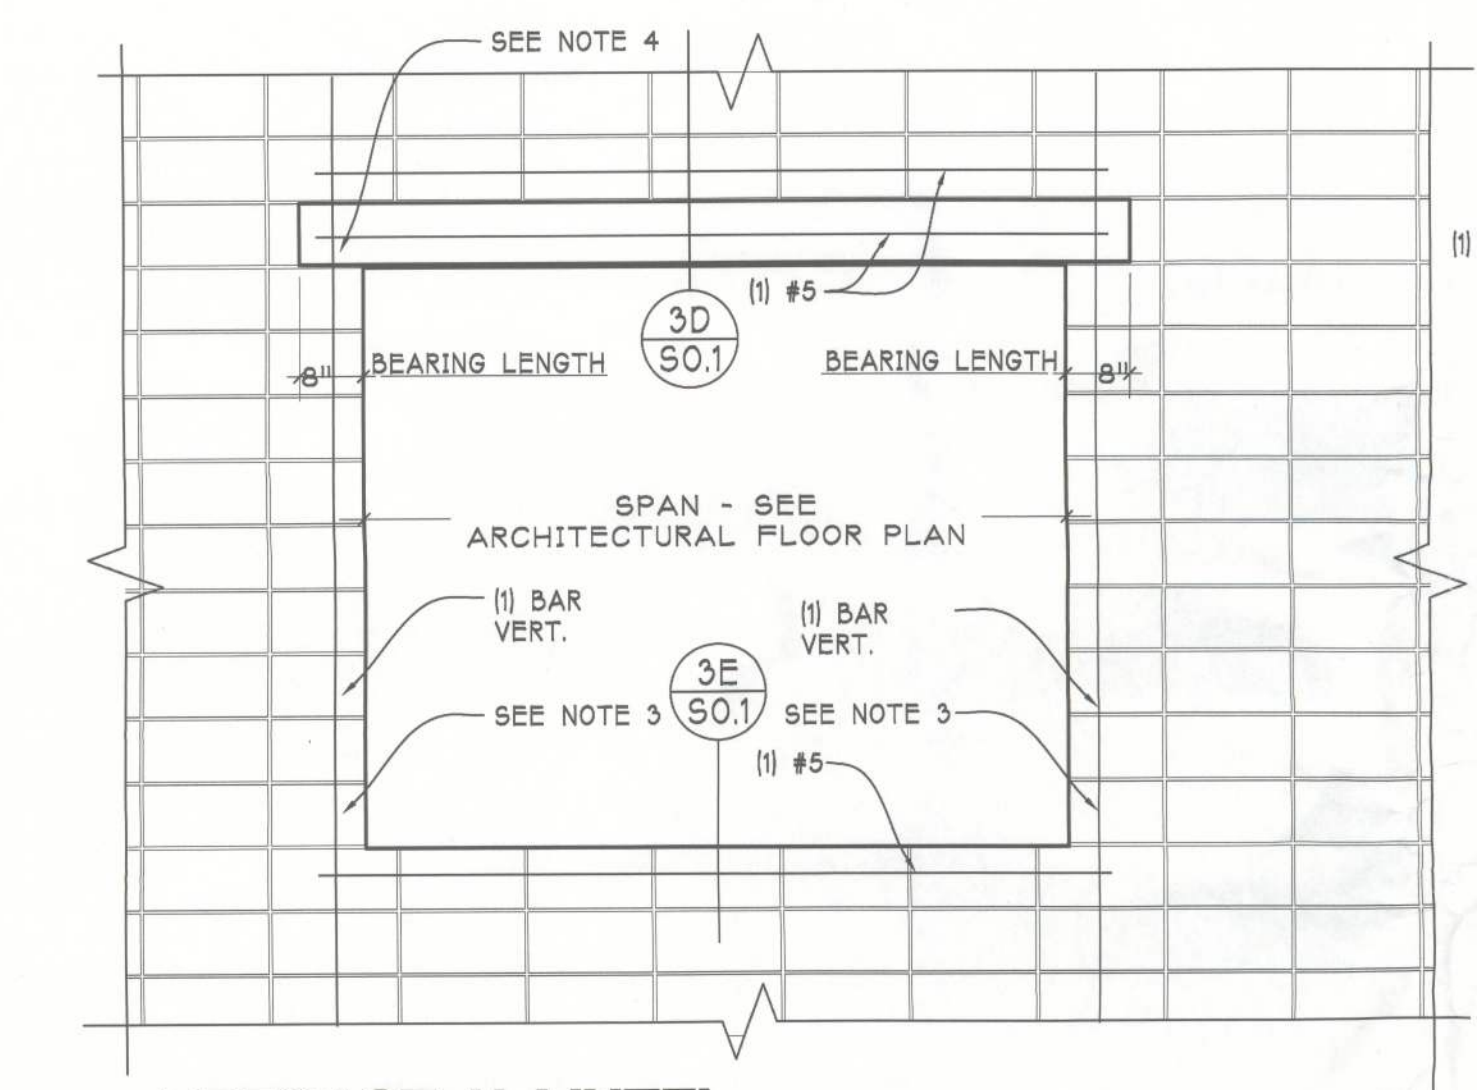


**PRECAST U-LINTEL REINFORCEMENT AT OPENINGS**  
NOT TO SCALE


**NOTES:**  
1. ALL MASONRY CELLS INDICATED TO HAVE REINFORCING SHALL BE FILLED SOLID WITH MASONRY GROUT IN ACCORDANCE WITH THE SPECIFICATIONS.  
2. PROVIDE REINFORCING AT THE JAMBS EQUIVALENT TO THE REINFORCING INTERRUPTED BY THE MASONRY OPENING. FILLED CELLS REQUIRED FOR THE SUPPORT OF THE LINTEL MAY BE COUNTED AS PART OF THIS REINFORCING.  
3. PROVIDE GROUT FILLED CELLS WITH REINFORCING AT EACH JAMB. NUMBER OF CELLS TO FILL AT EACH JAMB SHALL BE INDICATED ON THE FOUNDATION PLANS.  
4. PRECAST LINTELS SHALL HAVE OPENINGS FORMED AT EACH BEARING TO MATCH THE MASONRY CELL OPENING BELOW. REINFORCING AND MASONRY GROUT SHALL BE PLACED CONTINUOUSLY THROUGH THE OPENING.  
5. COORDINATE WITH HVAC SHEETS FOR LOCATIONS OF REINFORCED HEADERS AT DUCT PENETRATIONS THROUGH C.M.U. WALLS.

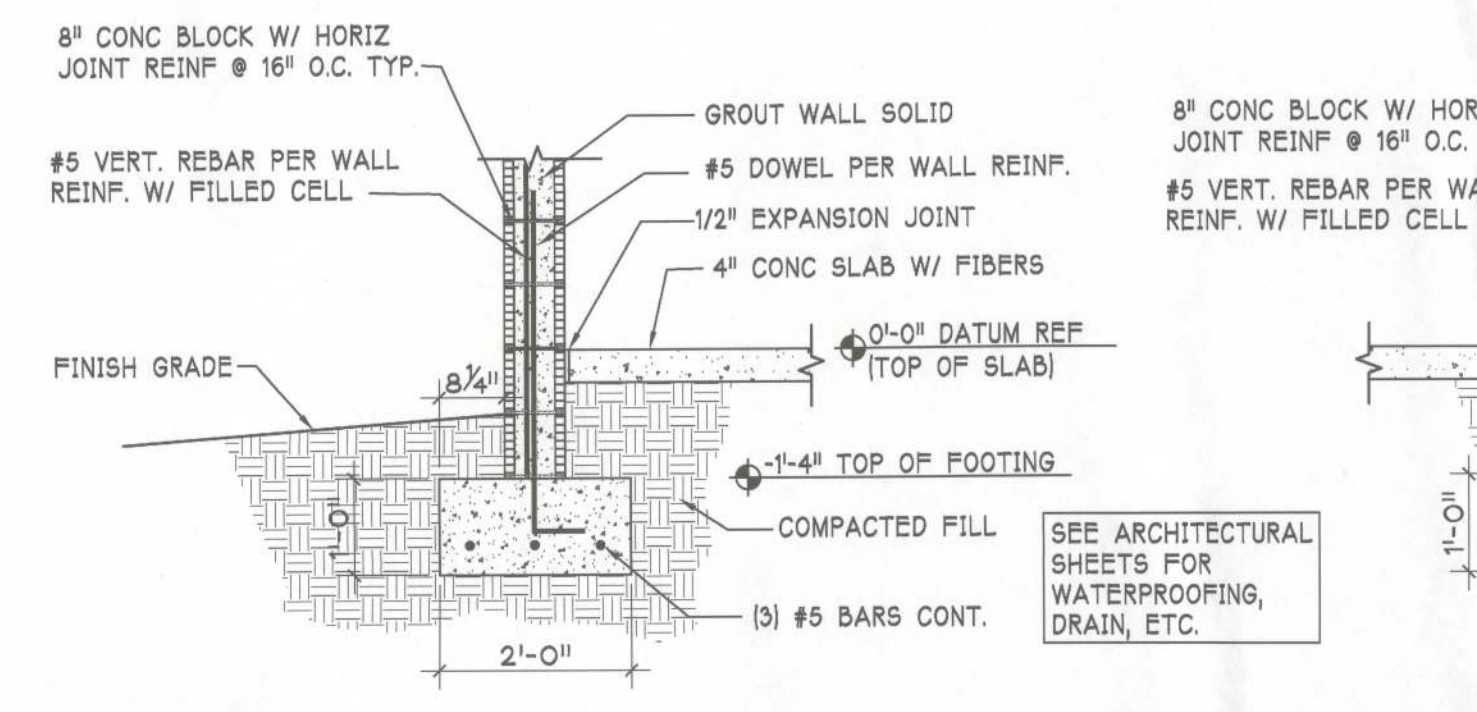

**EXT. CMU WALL FOOTING DETAIL**  
SCALE: 1/2" = 1'-0"

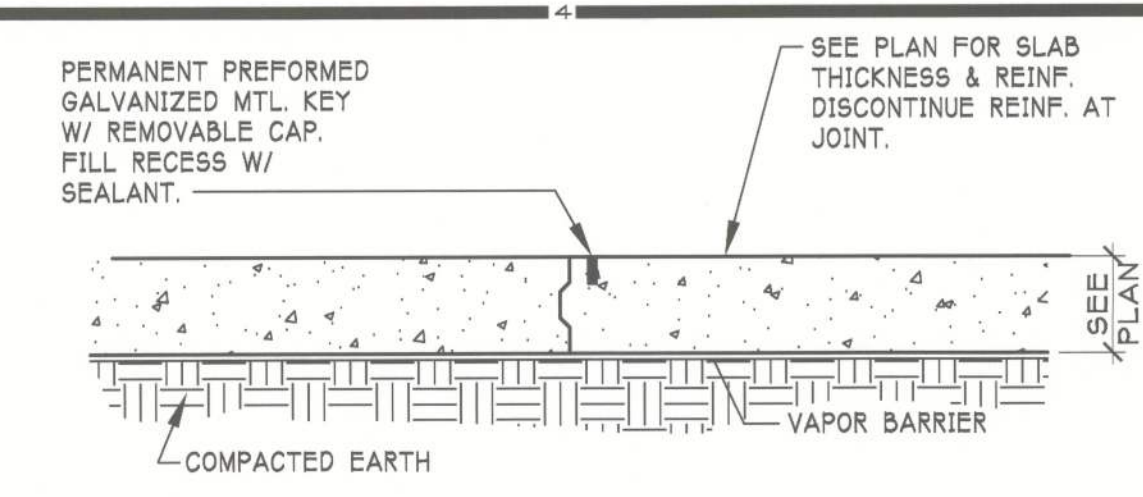

**TYPICAL CONSTRUCTION JOINT**  
SCALE: 1 1/2"=1'-0"

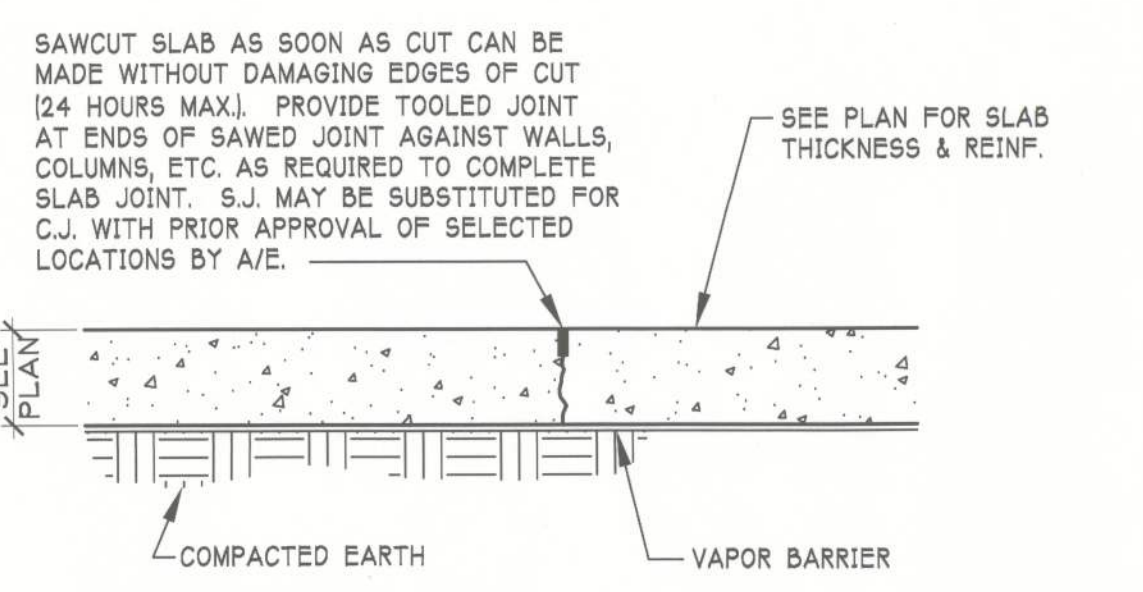


**TYPICAL SAWED CONTROL JOINT**  
SCALE: 1 1/2"=1'-0"




**PRECAST U-LINTEL REINFORCEMENT AT OPENINGS**  
SCALE: 1 1/2"=1'-0"




**REINFORCEMENT AT OPENINGS**  
SCALE: 1 1/2"=1'-0"

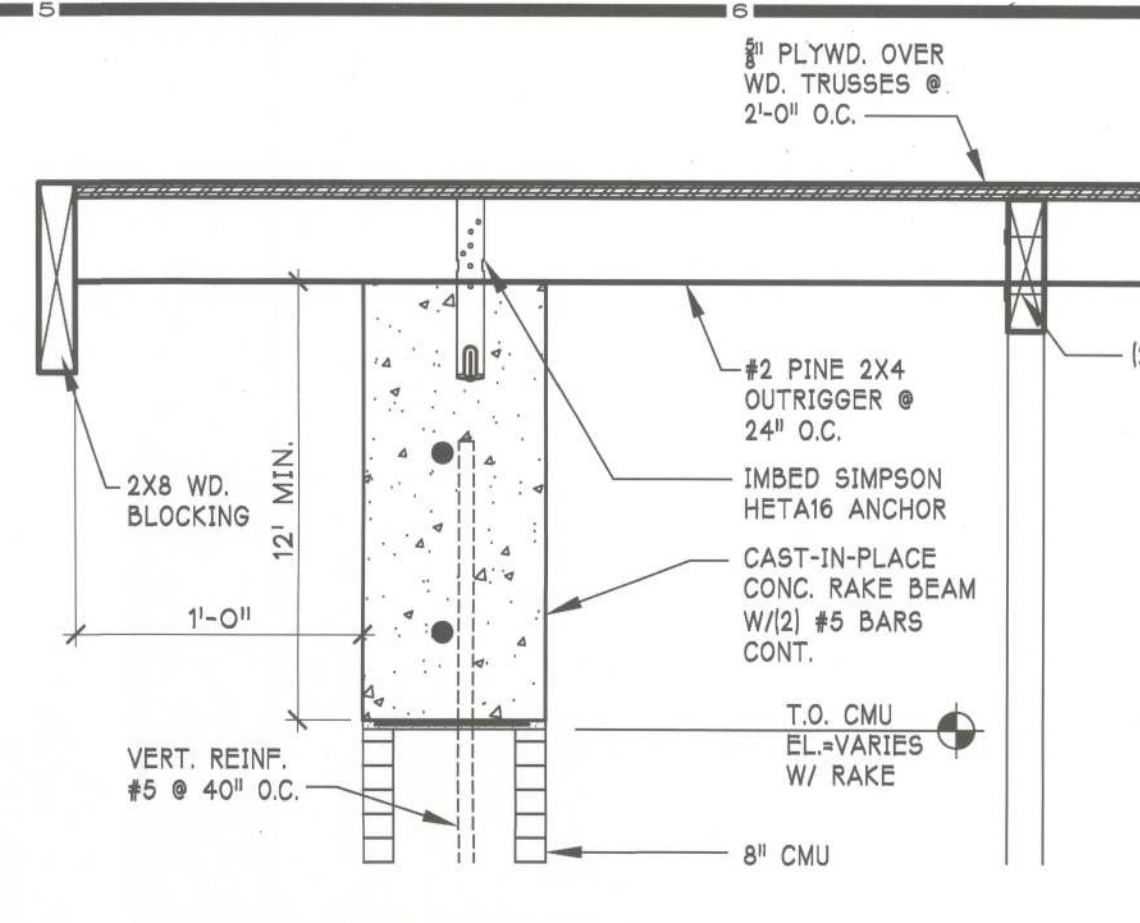

**WALL @ ROOF DETAIL**  
SCALE: 1 1/2"=1'-0"

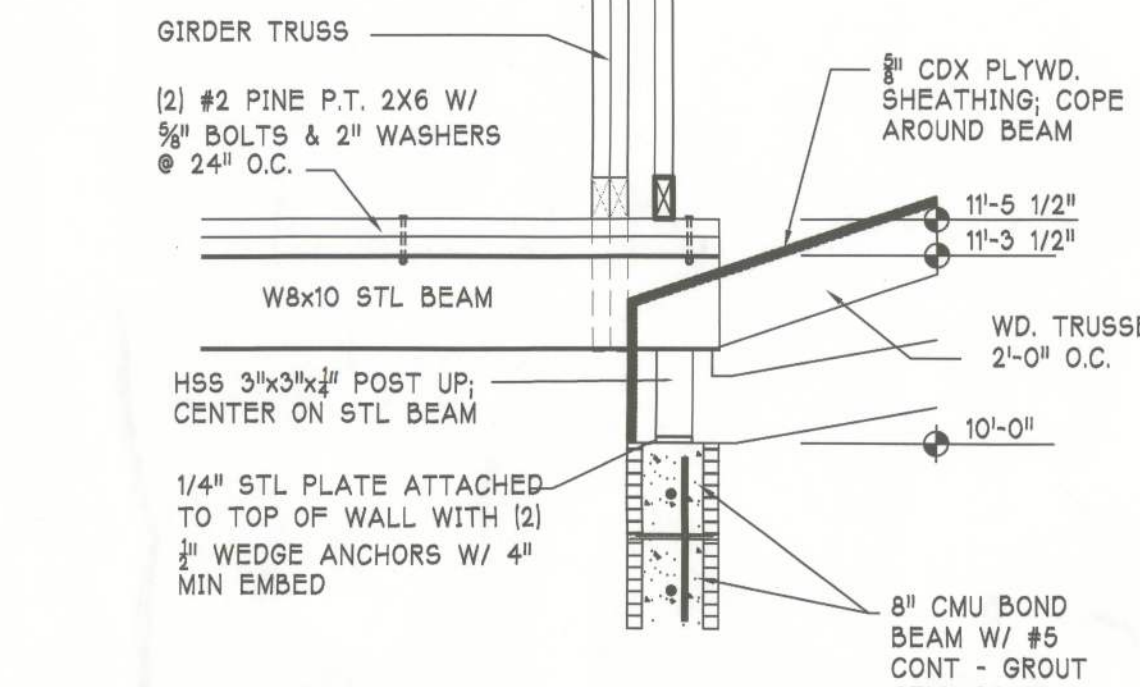


**BEAM @ WALL DETAIL**  
SCALE: 3/4"=1'-0"

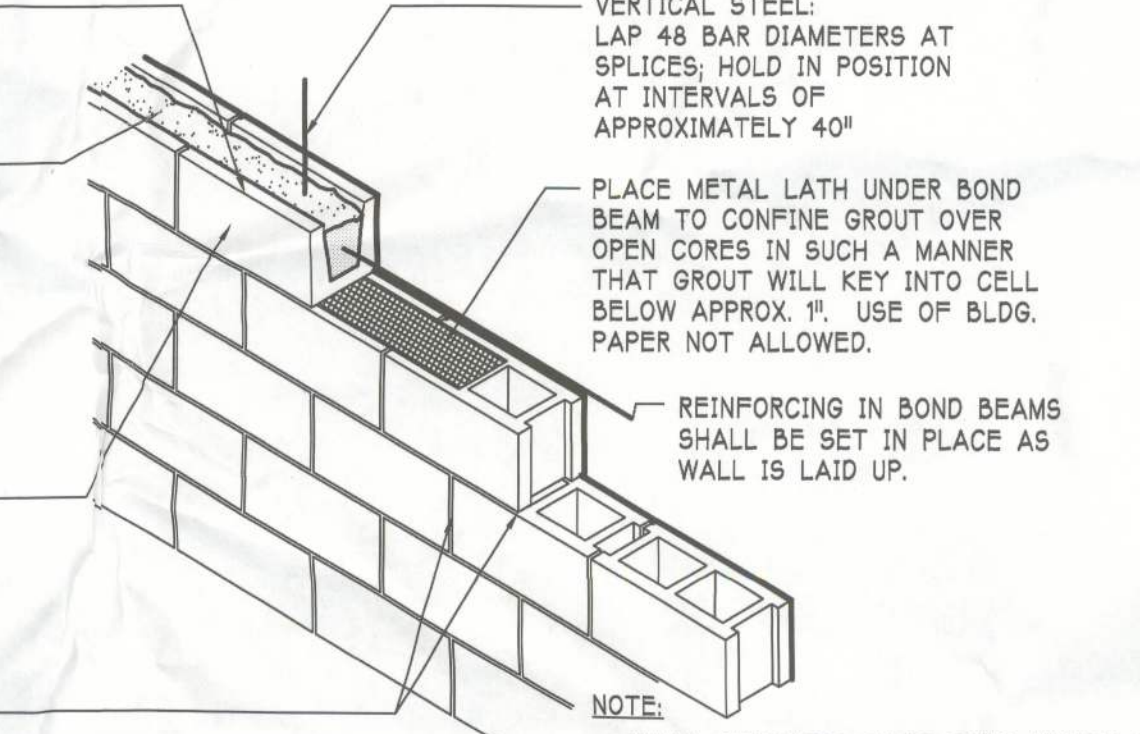


**METHOD OF LOW LIFT GROUTING**  
4'-8" MAXIMUM LIFT


**WALL PARTITION**  
SCALE: N.T.S.

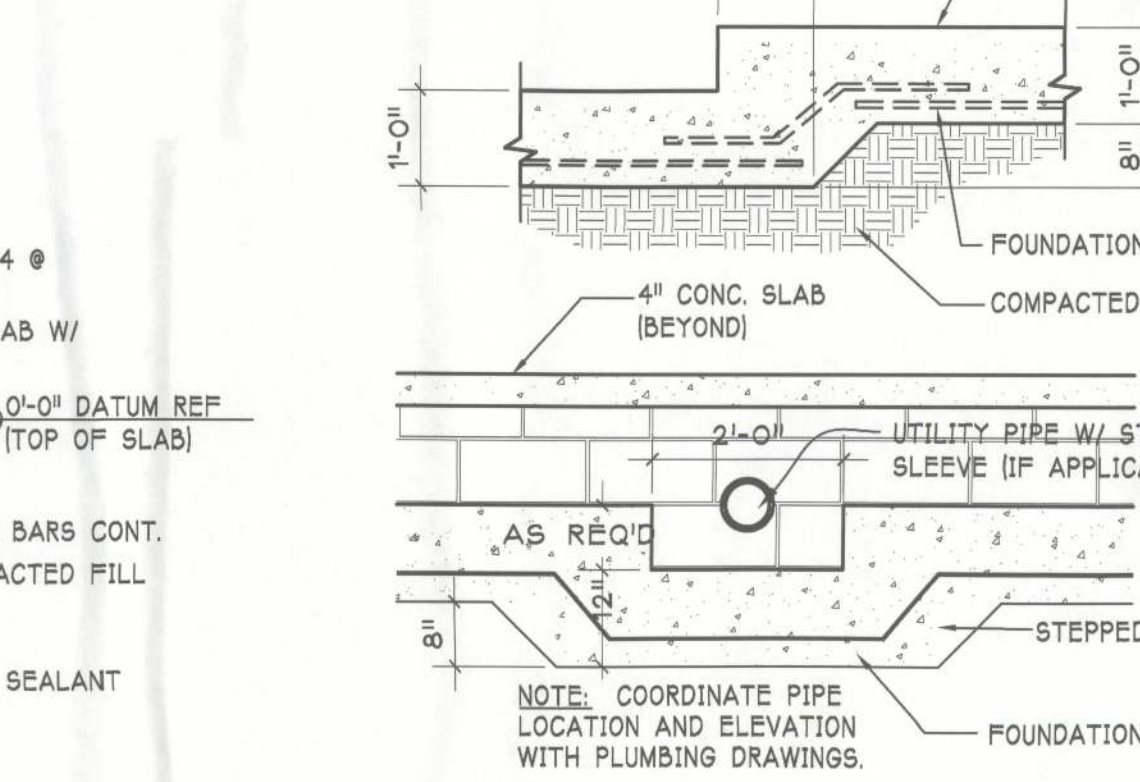

**INT. BEARING WALL THKND SLAB DETAIL**  
SCALE: 1/2" = 1'-0"

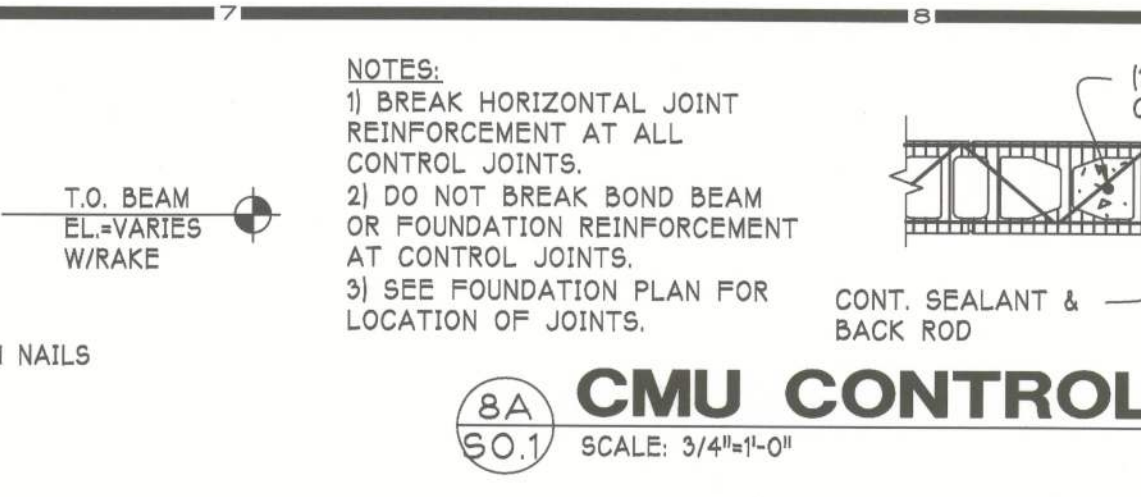

**CMU CONTROL JOINT**  
SCALE: 3/4"=1'-0"

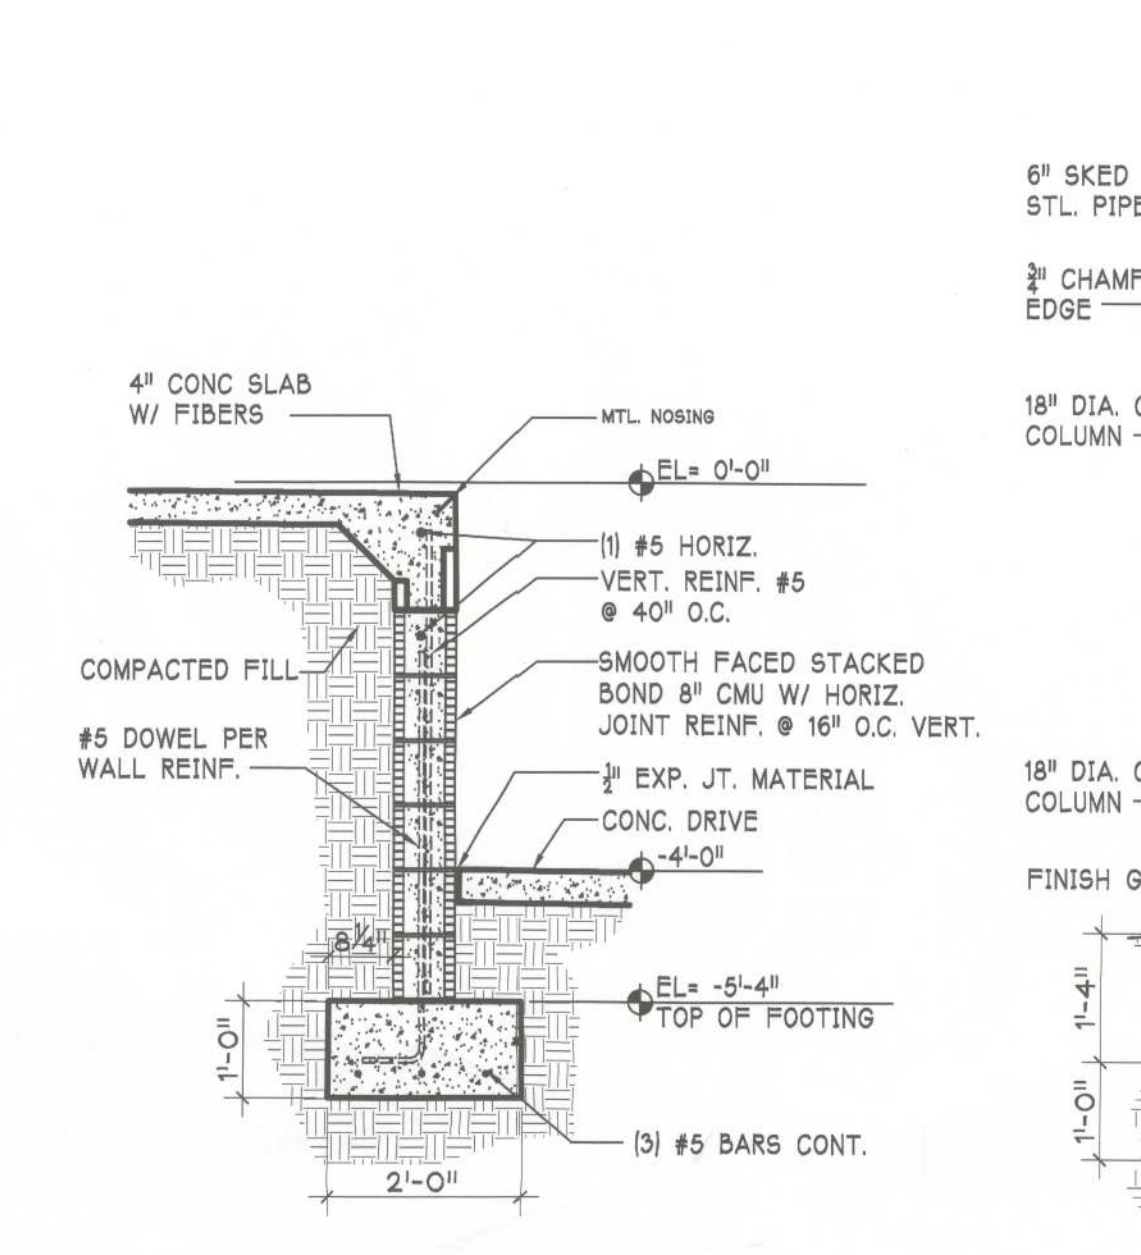


**LOADING DOCK DETAIL**  
SCALE: 1/2" = 1'-0"


| BAR | L   | 48db |
|-----|-----|------|
| #3  | 6"  | 18"  |
| #4  | 8"  | 24"  |
| #5  | 10" | 30"  |
| #6  | 12" | 36"  |
| #7  | 14" | 42"  |
| #8  | 16" | 48"  |

#3 THROUGH #8 BARS ONLY

**STANDARD HOOK & MASONRY LAP**  
SCALE: 1/2" = 1'-0"

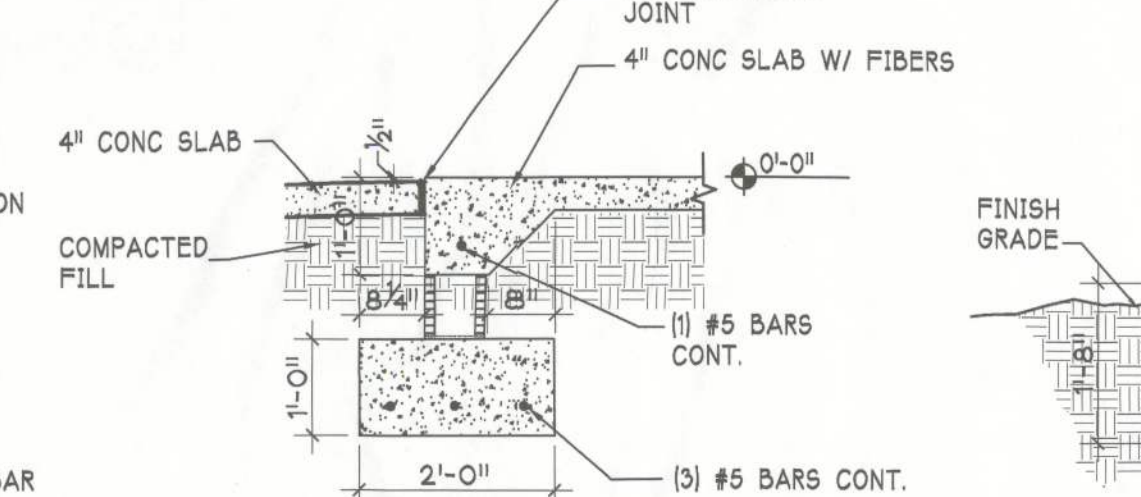


**THICKENED EDGE DETAIL**  
SCALE: 1/2" = 1'-0"

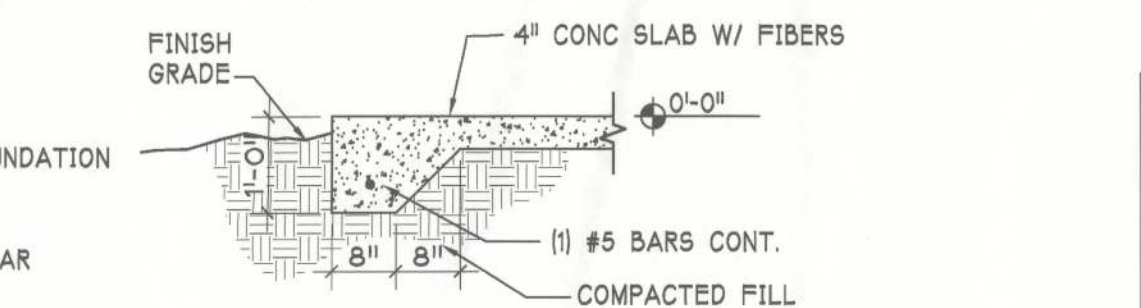


**THICKENED EDGE DETAIL**  
SCALE: 1/2" = 1'-0"



**COLUMN DETAIL**  
SCALE: 1/2" = 1'-0"

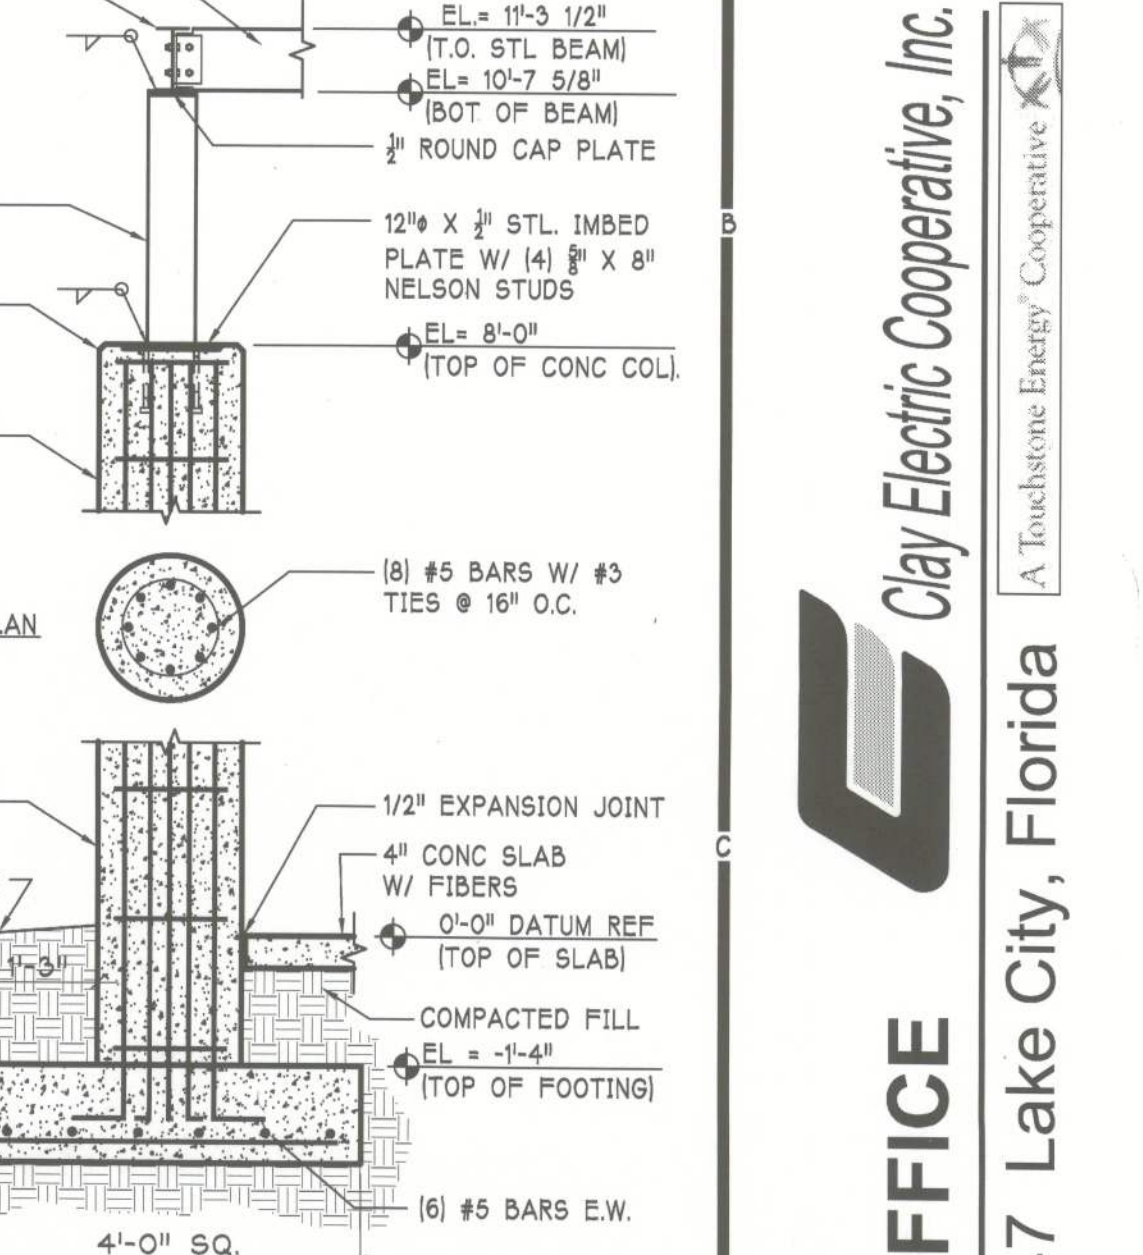

**F1 = 3'-0" THICKENED EDGE DETAIL**  
SCALE: 1/2" = 1'-0"

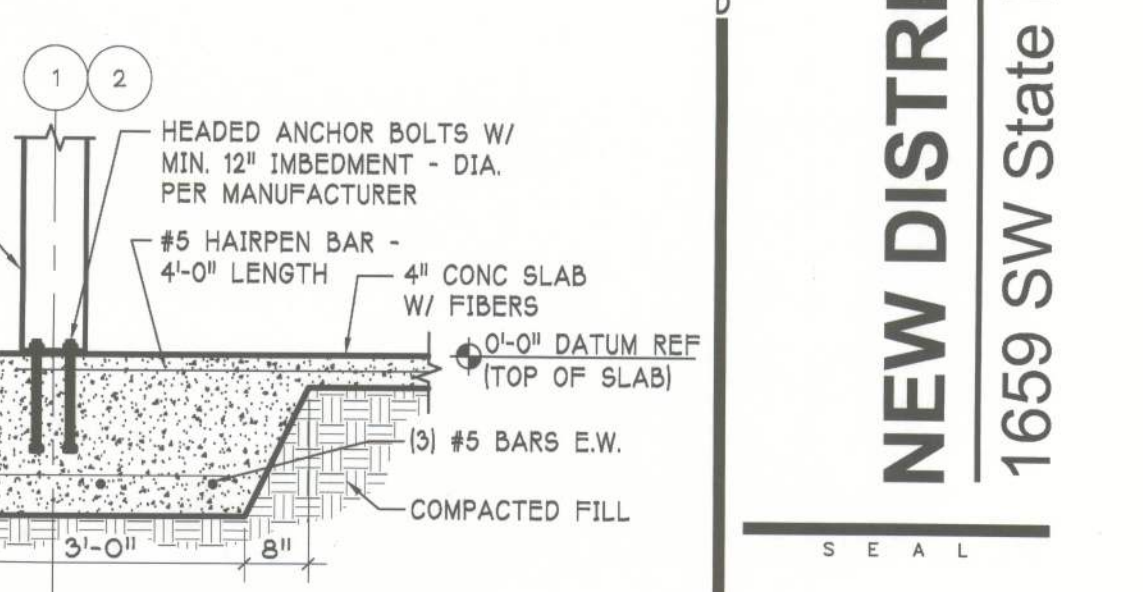

**THICKENED EDGE DETAIL**  
SCALE: 1/2" = 1'-0"

**SPUTO & LAMMERT ENGINEERING, LLC**  
STRUCTURAL ENGINEERS  
10 SW 1st AVENUE  
GAINESVILLE, FLORIDA 32601  
PHONE 352-378-0448 FAX 352-373-1331  
THOMAS SPUTO, PH.D., P.E.  
CA6855 PE 39142

**Bid Documents**

**Brame Architects**  
606 N.E. First Street  
Gainesville, Florida 32601  
352 / 372-0425  
FAX 352 / 372-0427

**Clay Electric Cooperative, Inc.**  
A Touchstone Energy Cooperative

**NEW DISTRICT OFFICE**  
1659 SW State Road 47 Lake City, Florida

WILLIAM W. BRAME  
REGISTRATION # AR-0007024  
CORP. LIC. NO. AA 000071

**STRUCTURAL FOUNDATION NOTES & DETAILS**

DRAWN GBV  
CHECKED BB  
DATE 02/07/2012  
CAD 3702060/CD

REVISIONS

FILE NO. 3702.060  
SHEET

**S0.1**