


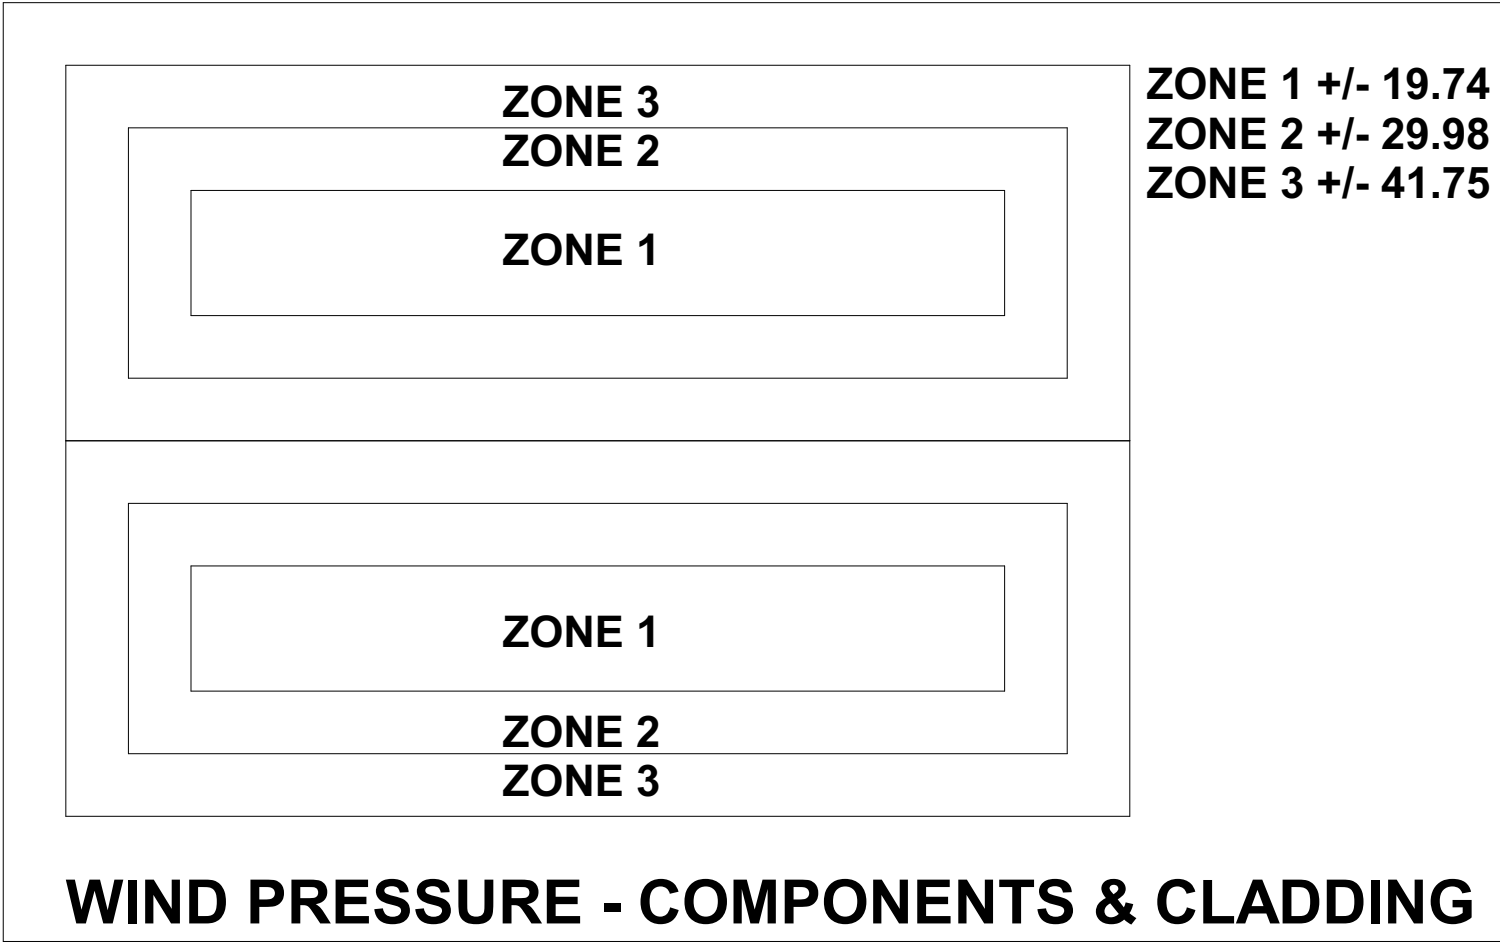

WIND EXPOSURE CATEGORY

☒ B

☐ C

☐ D

MAIN BUILDING DIMENSIONS D-1		
BARN WIDTH (FT)	6"X6" POST	8"X8" POST
32	31' - 01"	30 - 08"

MAIN POST HEIGHT (D-3) SIZE CIRCLED OR LESS					OTHER
10'	12'	14'	16'	20'	

POST SPACING (FT)

☐ 8

☐ 10

☒ 12

LEAN BUILDING DIMENSIONS D-4		
LEAN WIDTH (FT)	6"X6" POST	8"X8" POST
14	13'-6 ^{1/2} "	13'-6 ^{1/2} "

ULTIMATE & NOMINAL WIND SPEEDS	
ULTIMATE	NOMINAL
120	93
130	101
140	108
150	116
155	120
160	124

LEAN POST HEIGHT (D-6) SIZE CIRCLED OR LESS					OTHER
8'	10'	12'	14'	16'	

MAIN BLD ROOF PITCH			
3/12	4/12	5/12	6/12

LEAN BLD ROOF PITCH (a)			
1/12			

DESIGN CRITERIA:

FLORIDA BUILDING CODE 2023 8TH ED.
DESIGN LOADS PER ASCE 7-22
DESIGN SPEED - 130 MPH
ROOF LIVE LOAD - 12.5 PSF
DEAD LOAD - 2.5 PSF
WIND RISK CATEGORY - I
EXPOSURE CATEGORY - B
IMPORTANCE FACTOR - 1.0
INTERNAL WIND PRESSURE - +/- 0.18 PSI

MAIN POST FOOTING SIZE	
F-1	18" DIA. X 48" DEEP
F-2	24" DIA. X 48" DEEP

LEAN POST FOOTING SIZE	
F-1	18" DIA. X 48" DEEP
F-2	24" DIA. X 48" DEEP

POLE BARN SPECIFICATIONS

GABLE WIDTH (D-1): 32'
BUILDING LENGTH (D-2): 50'
EAVE HEIGHT (D-3): 14'
POLE SPACING: 10'
GABLE WIDTH LEAN TO (D-4): 14'
LENGTH OF LEAN TO (D-5): 20'
EAVE HEIGHT OF LEAN TO (D-6): 12'
ROOF PITCH: 3:12
ROOF RISE LEAN TO: 1:12
RIDGE HEIGHT : 18' - 00"
WALLS: OPEN
FLOOR: DIRT
ROOF METAL: 29 GA.
SIDE METAL: N/A
POST SIZE BARN: 8"x8" PT
POST SIZE LEAN TO: 8"x8" PT
FOOTING SIZE BARN: 24"X48"
FOOTING SIZE LEAN: 24"X48"
CONCRETE : 3,000 PSI



Tomas B. Whitman, PE
MADISON ENGINEERING
This has been electronically signed and sealed by TOMAS B. WHITMAN, PE using a Digital signature and date. Printed copies of this document are not considered signed and sealed and the signature must be verified on an electronic device.

TOMAS B
WHITMAN
2025.04.17
09:59:11 -04'00'

DESIGNED TBW
DRAWN DVD
CHECKED TBW
APPROVED TBW
JOB NO.: 35225147
DATE: 17 APRIL 2025

MADISON ENGINEERING, LLC
CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING
269 NE Ridge Loop
Madison, Florida 32340
Phone 850.973.7864
COA No.: 27216 www.madisonengineer.com

POLE BARN - B - 32 X 50
A&T TRUSS

CARMEN FAVORITO (32X50)

170 SW JERICHO GLEN, LAKE CITY, FL 32024


© COPYRIGHT 2025 ME

VALID ONLY WITH DATED
ORIGINAL SIGNATURE AND
SEALED OR EMPLOYED SEAL
OR DIGITAL SEAL


T. BRENT WHITMAN, P.E.
FL. P.E. #63178 / GA. P.E. #031609

SHEET NO.

1

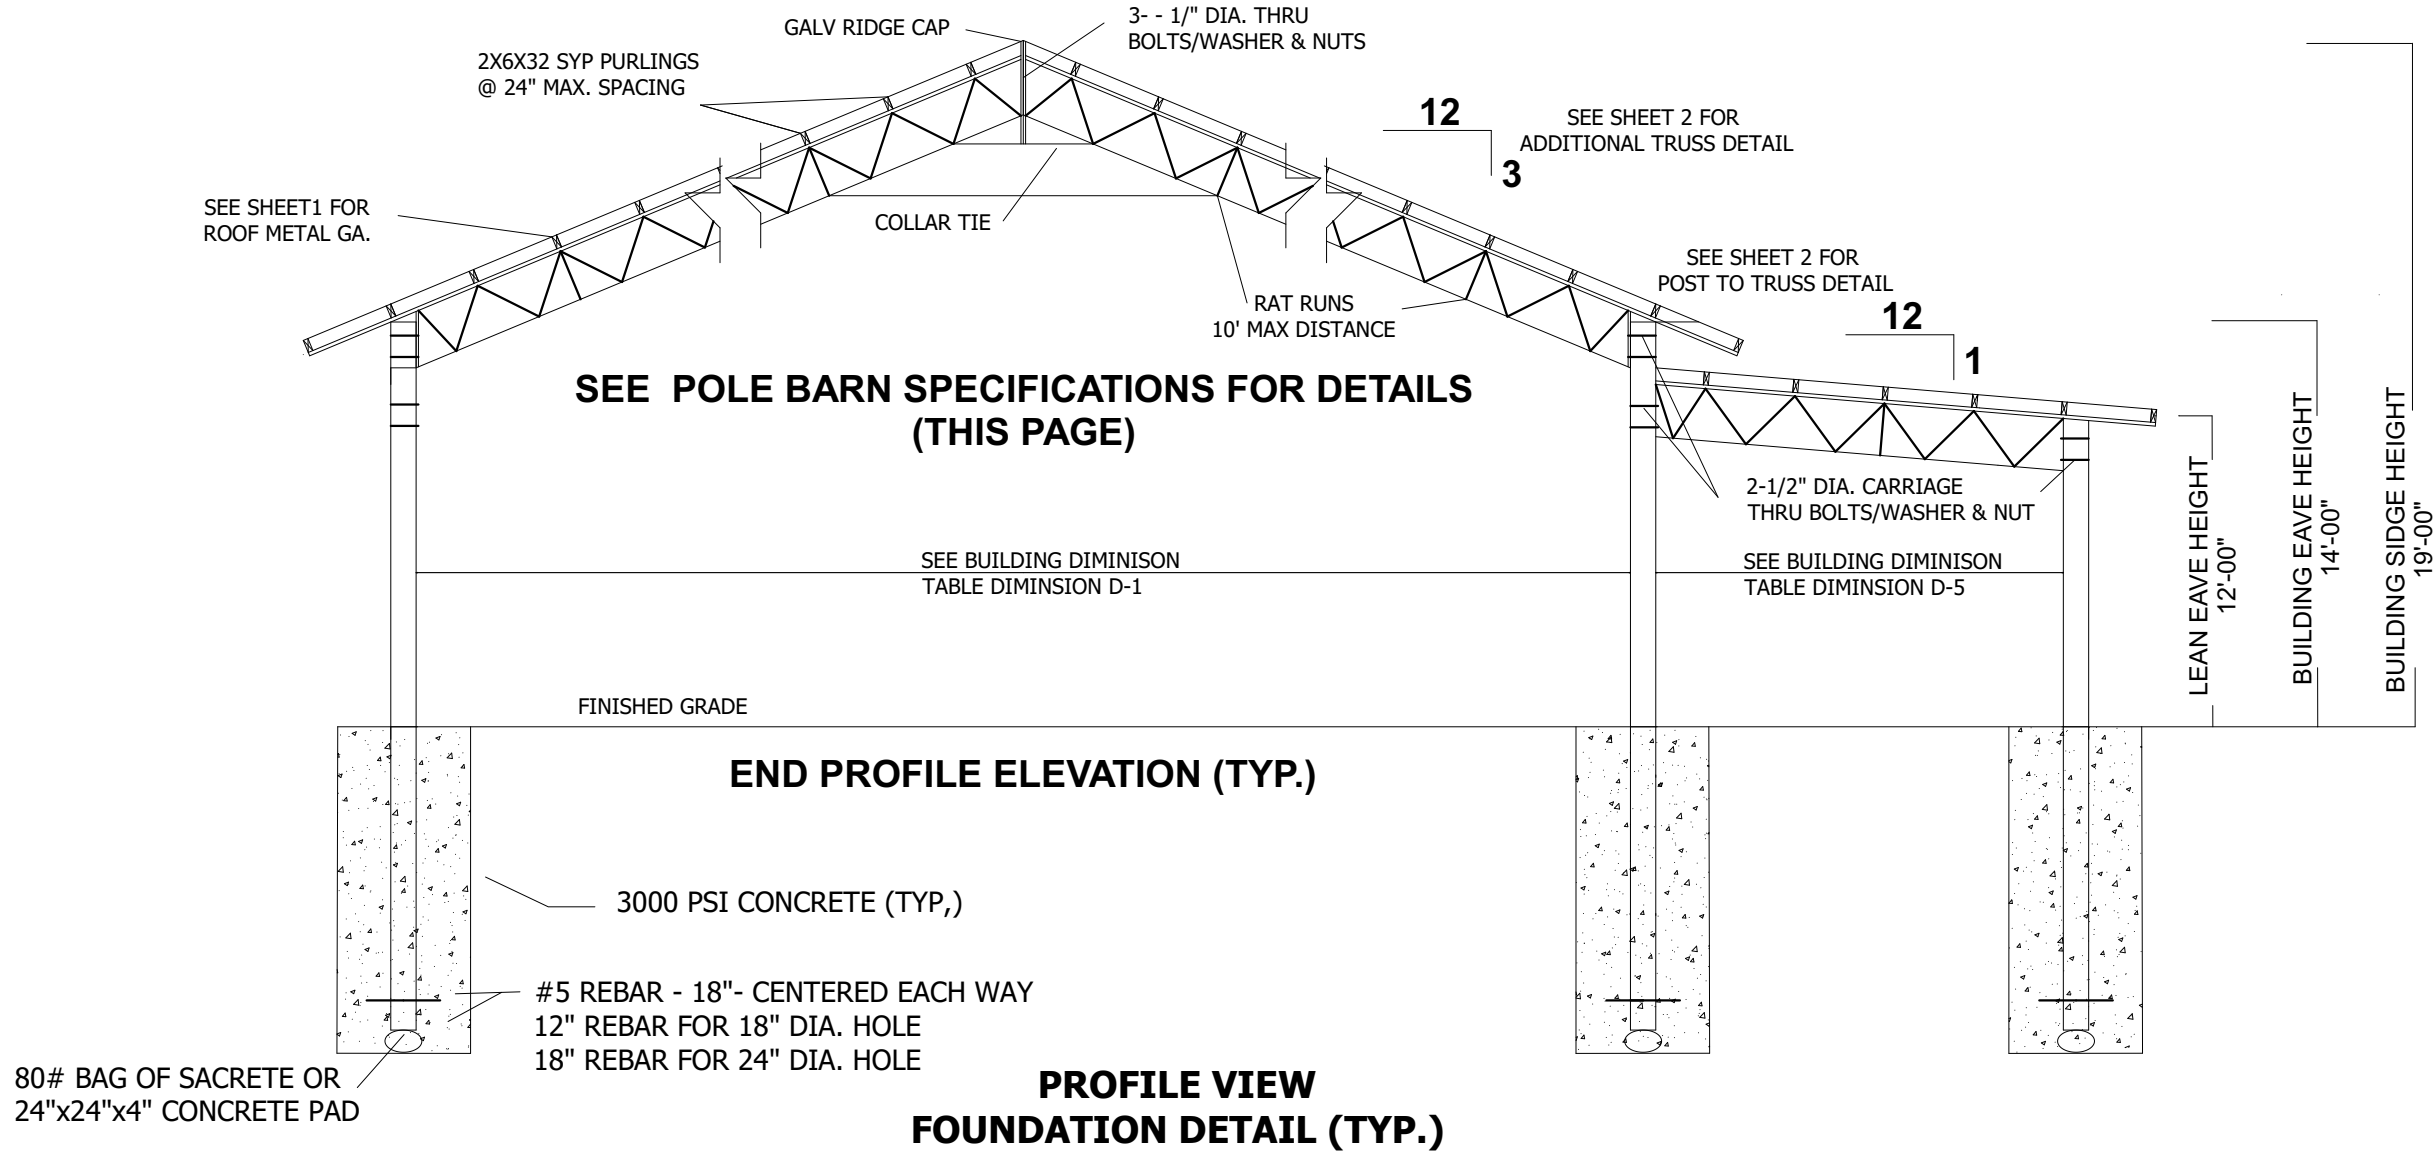


SEE POLE BARN SPECIFICATIONS FOR DETAILS
(THIS PAGE)

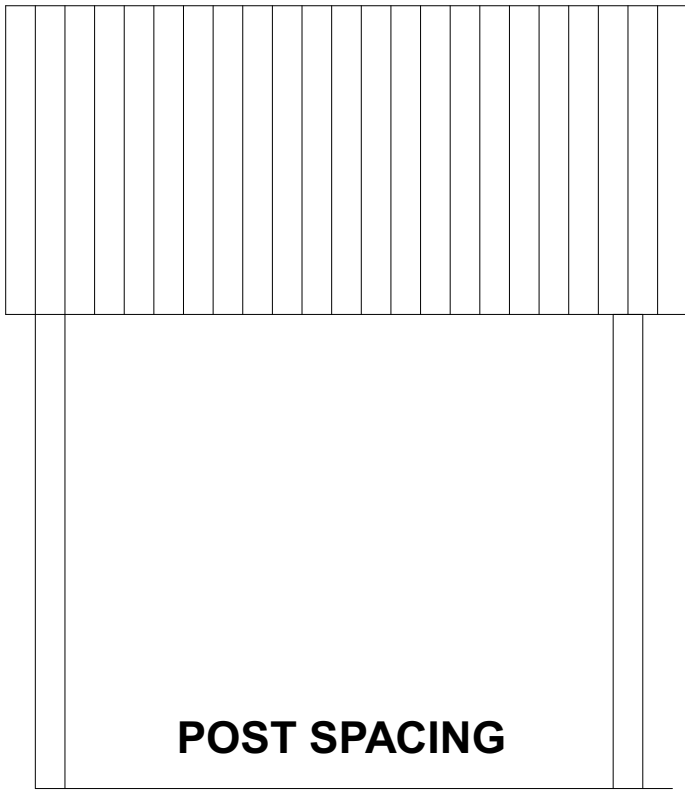

PROFILE VIEW
SIDE ELEVATION (TYP.)
SEE POLE BARN SPECIFICATIONS FOR DETAILS

NOTES:

1. PURLINS SHALL BE 2X6 #2 SYP (MAX SPACE @2'-0" O.C.)
2. CONTRACTOR IS RESPONSIBLE FOR TEMPORARY & PERMANENT CONSTRUCTION BRACING.
3. ALL DEMINSIONS SHALL BE VERIFIED PRIOR TO FABRICATION.
4. ALL WELD PER AWS STANDARDS.
5. ALL STELL AND FABRICATION PER ASCI STANDARDS.
7. ITEM DEMINSIONS ARE TO BE MODIFIED FOR SHORTER TRUSS LENGTHS.
8. ALL FASTNERS SHALL BE INSTALLED PER MANUFACTURES SPECIFICATIONS.
9. TRUSS DESIGN CAN BE USED FOR TRUSS LENGTHS SHORTER THAN 25 FEET.
10. CONCRETE WORK SHALL CONFORM TO 'BUILDING CODE REQUIRMENTS FOR REINFORCED CONCRETE' (ACI-318).
11. ALL CONCRETE SHALL BE 3000 PSI MIN. W/ WWF OR FIBER
12. FL PRODUCT APPROVAL CODE ROOF SYSTEM 36904.1

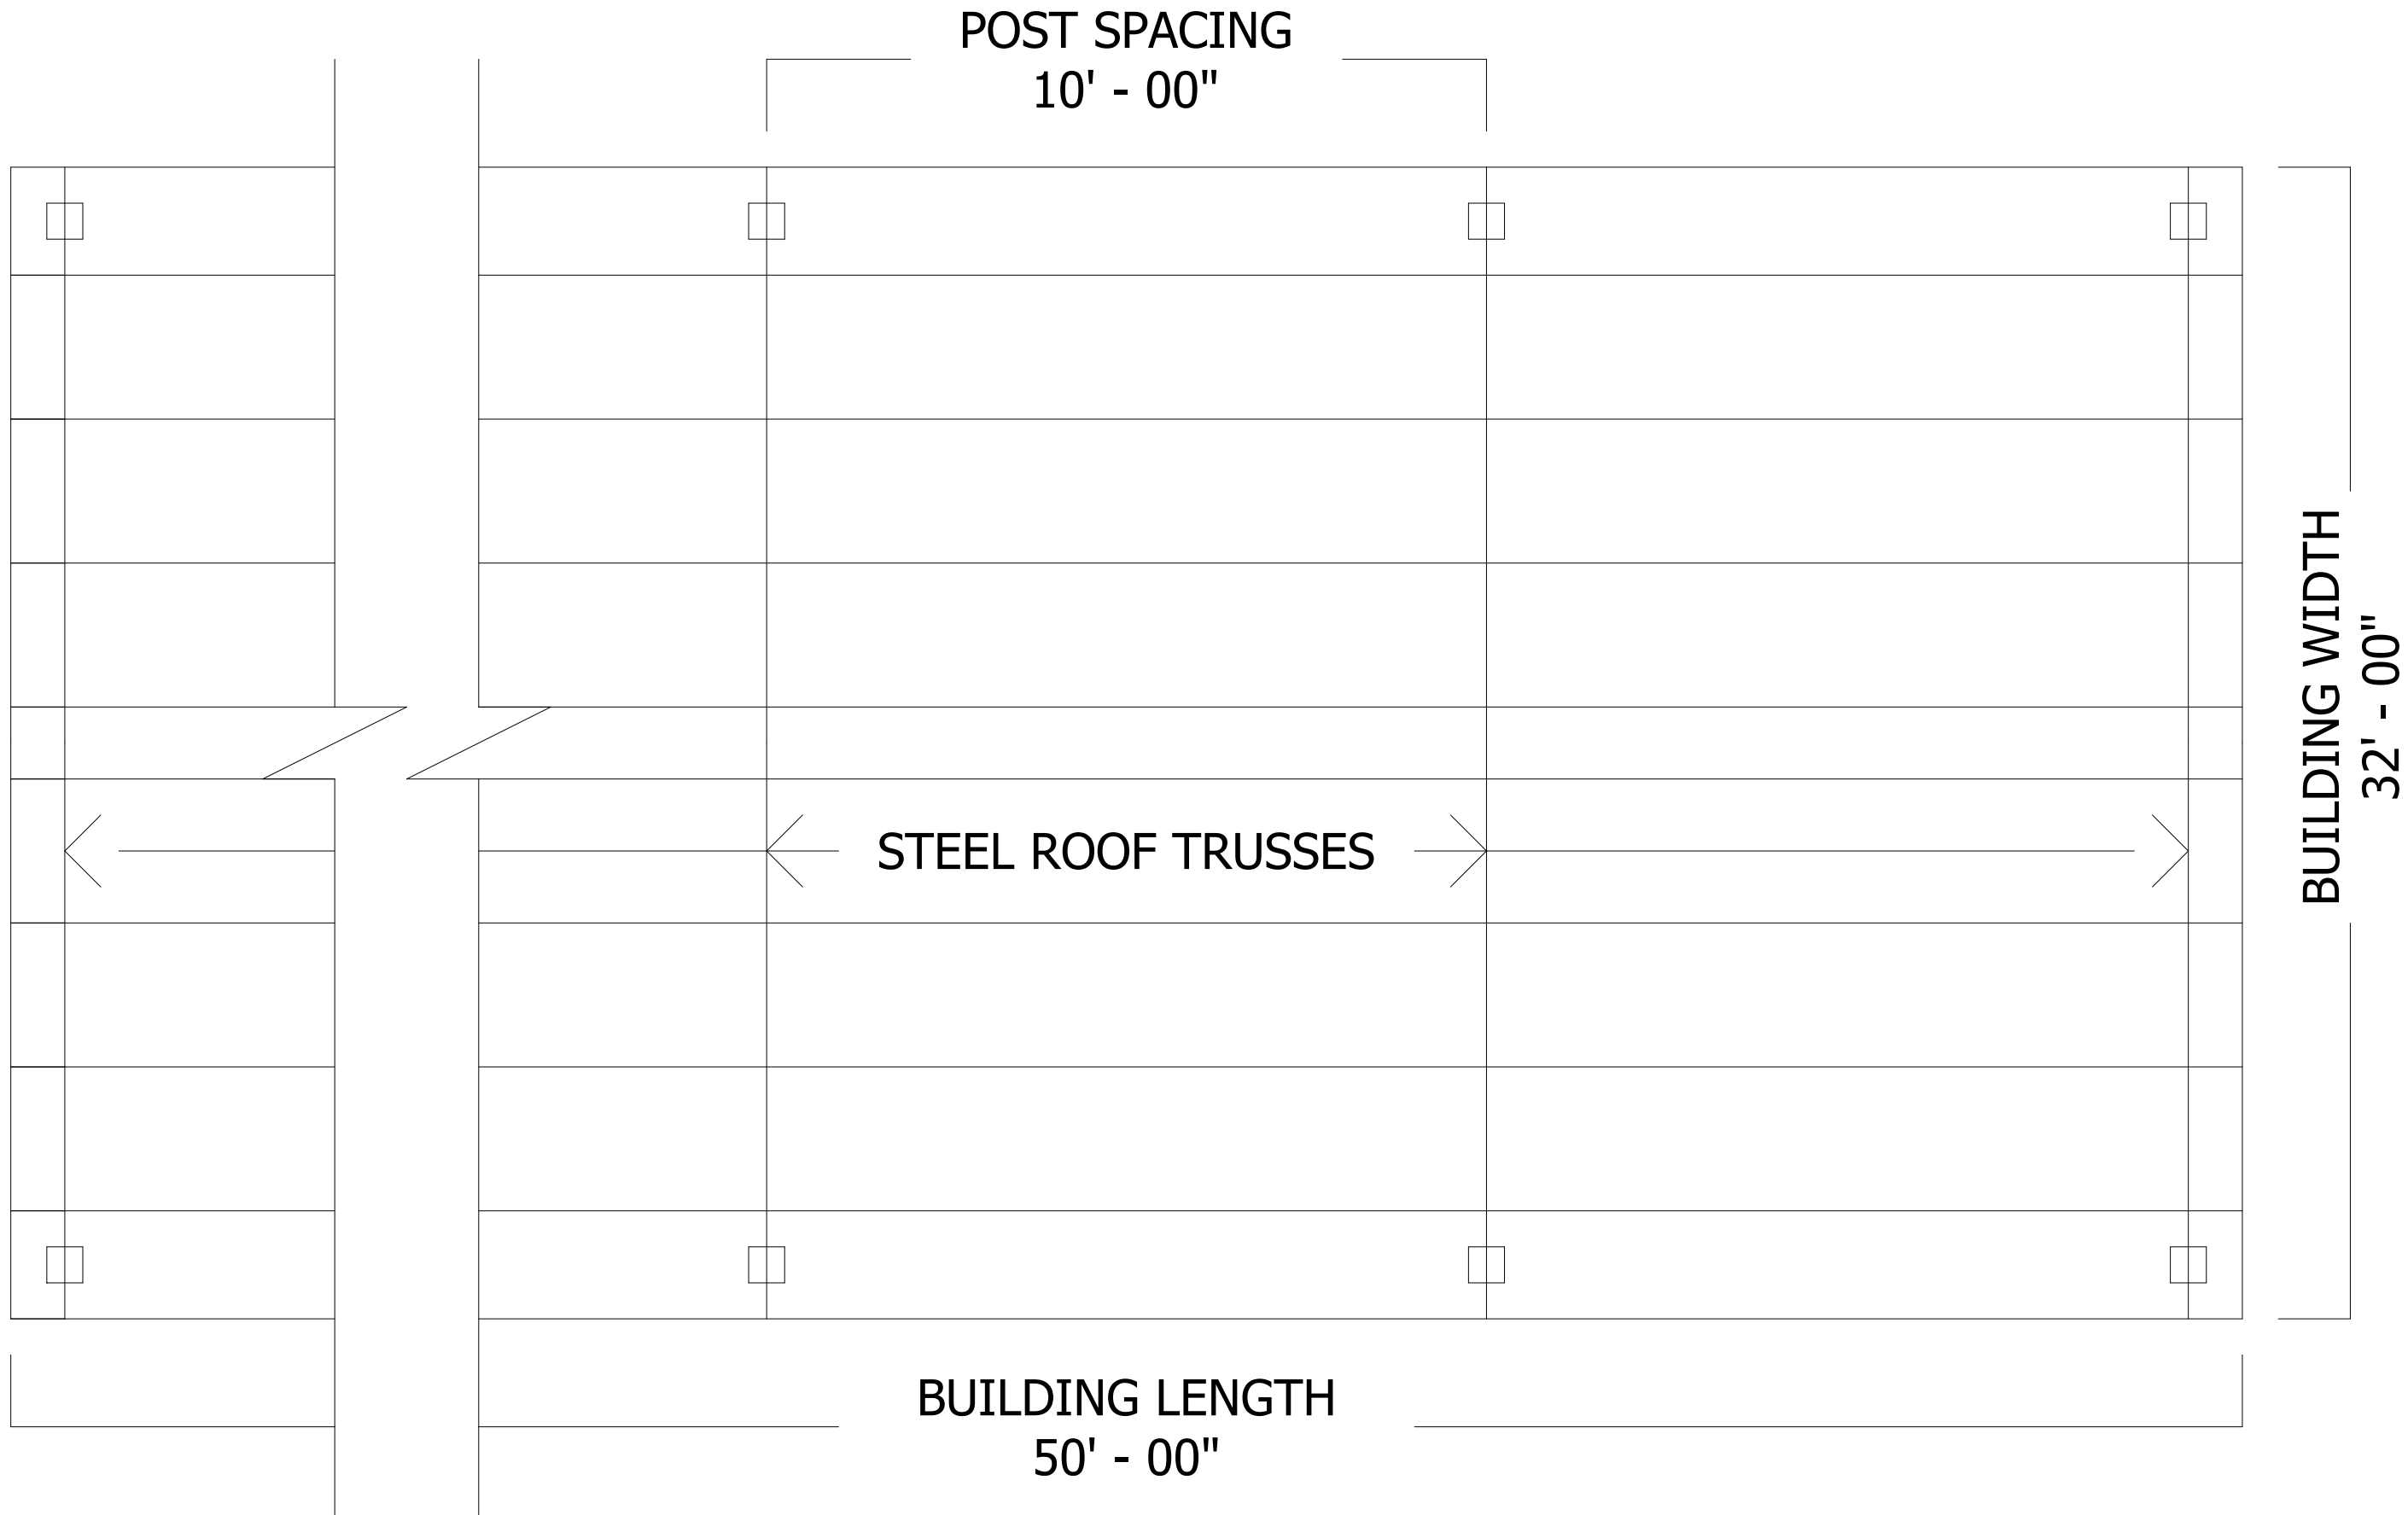

BARN PLAN VIEW (TYP.)




Tomas B. Whitman, PE
MADISON ENGINEERING
This has been electronically signed and sealed by TOMAS B. WHITMAN, PE using a Digital signature and date.
Printed copies of this document are not considered signed and sealed and the signature must be verified on an electronic device.

**TOMAS B
WHITMAN**

2025.04.17

09:58:55 -04'00'



MADISON ENGINEERING, LLC
CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING

269 NE Ridge Loop
Madison, Florida 32340
Phone 850.973.7864
COA No.: 27216 www.madisonengineer.com

POLE BARN - B - 32 X 50
ABT TRUSS

CARMEN FAVORITO (32X50)

170 SW JERICHO GLN, LAKE CITY, FL 32024

© COPYRIGHT 2025 ME



VALID ONLY WITH DATED ORIGINAL SIGNATURE AND INK OR APPROVED SEAL OR DIGITAL SEAL.

T. BRENT WHITMAN, P.E.
FL. P.E. #63178 / GA. P.E. #031609

SHEET NO.

2

DESIGNED	TBW
DRAWN	DVD
CHECKED	TBW
APPROVED	TBW
JOB NO.:	35225147
DATE:	17 APRIL 2025
COLUMBIA COUNTY	

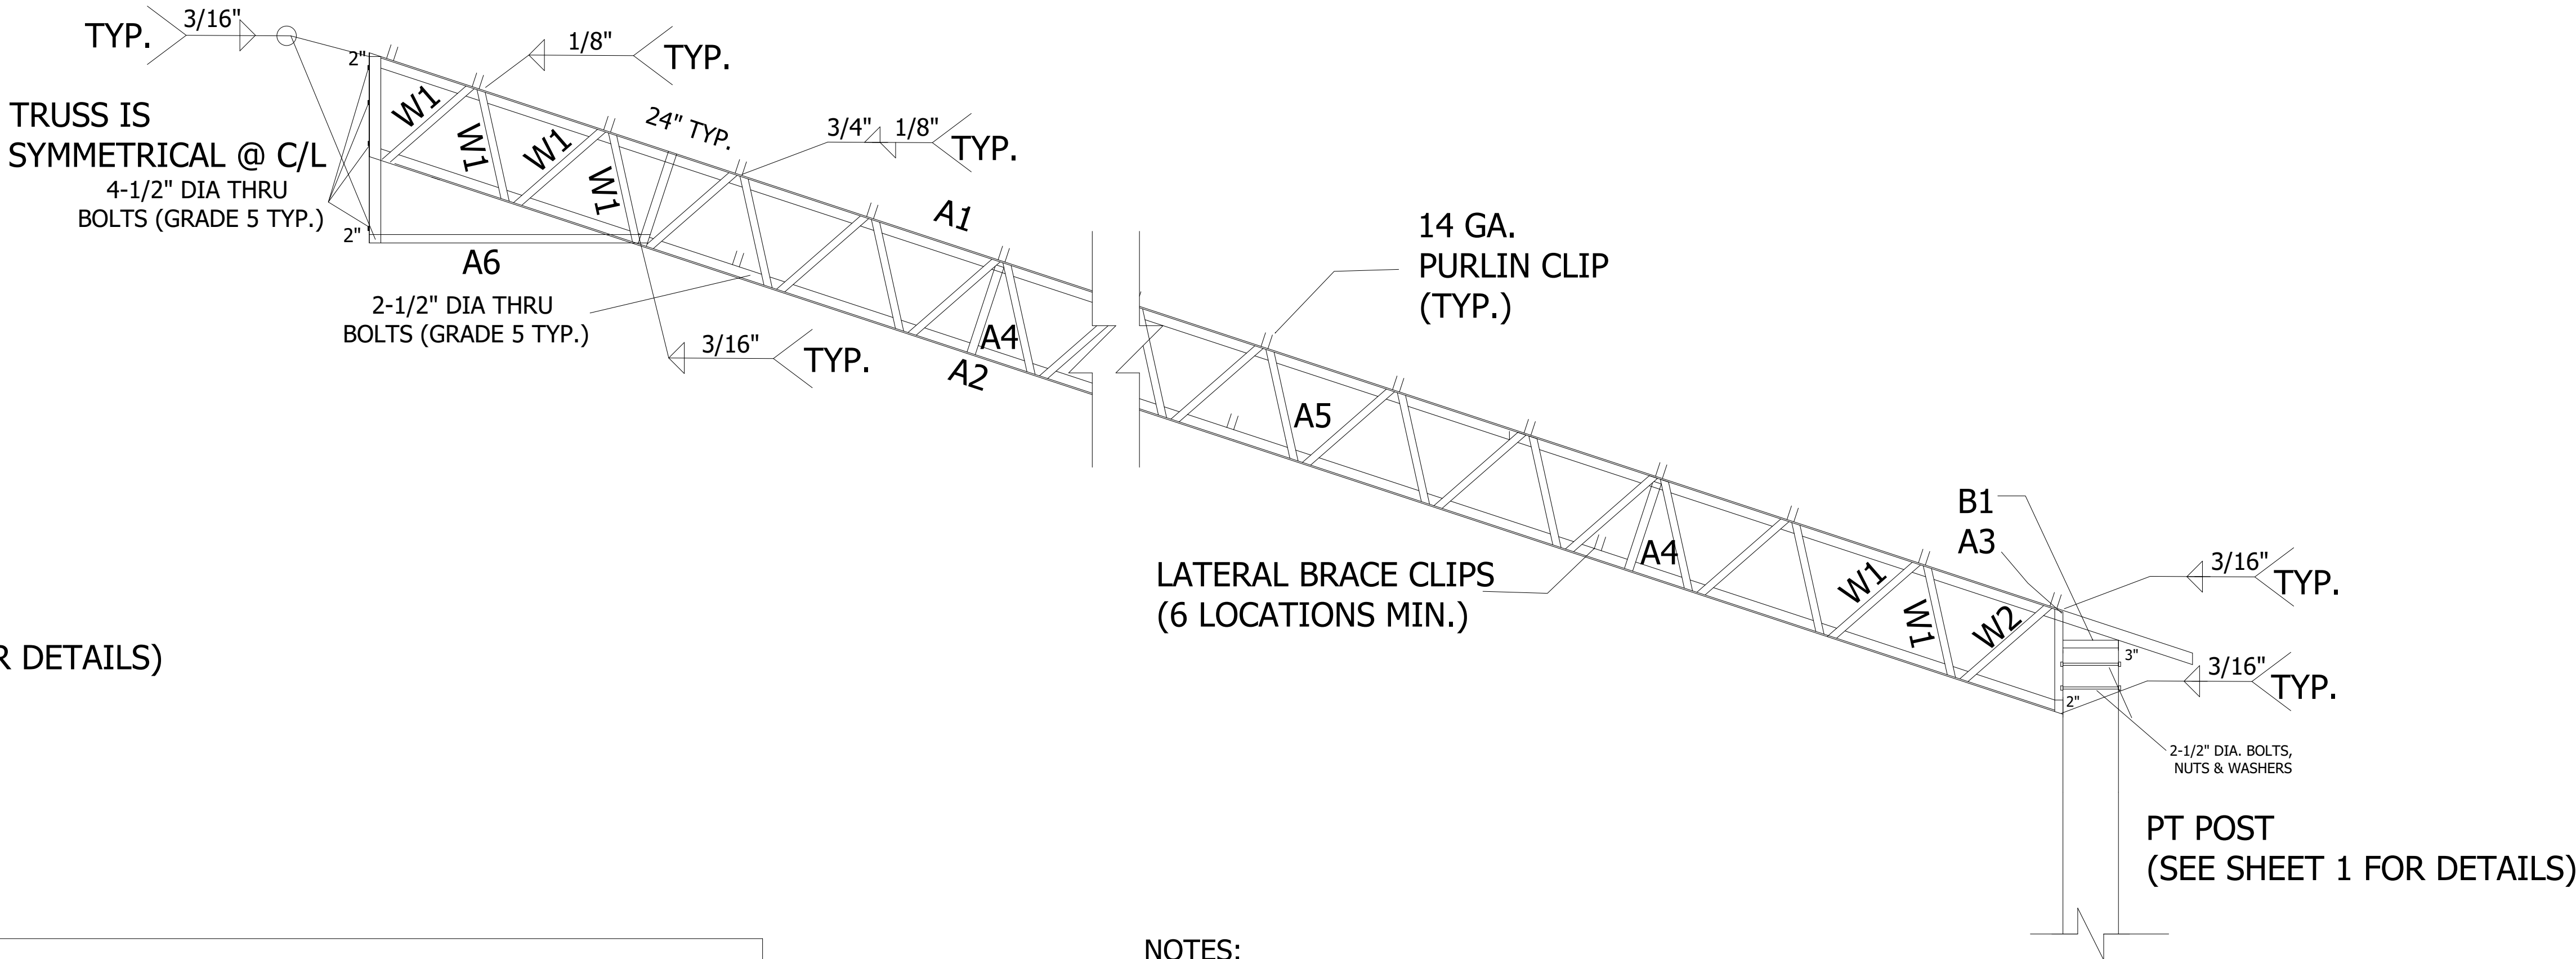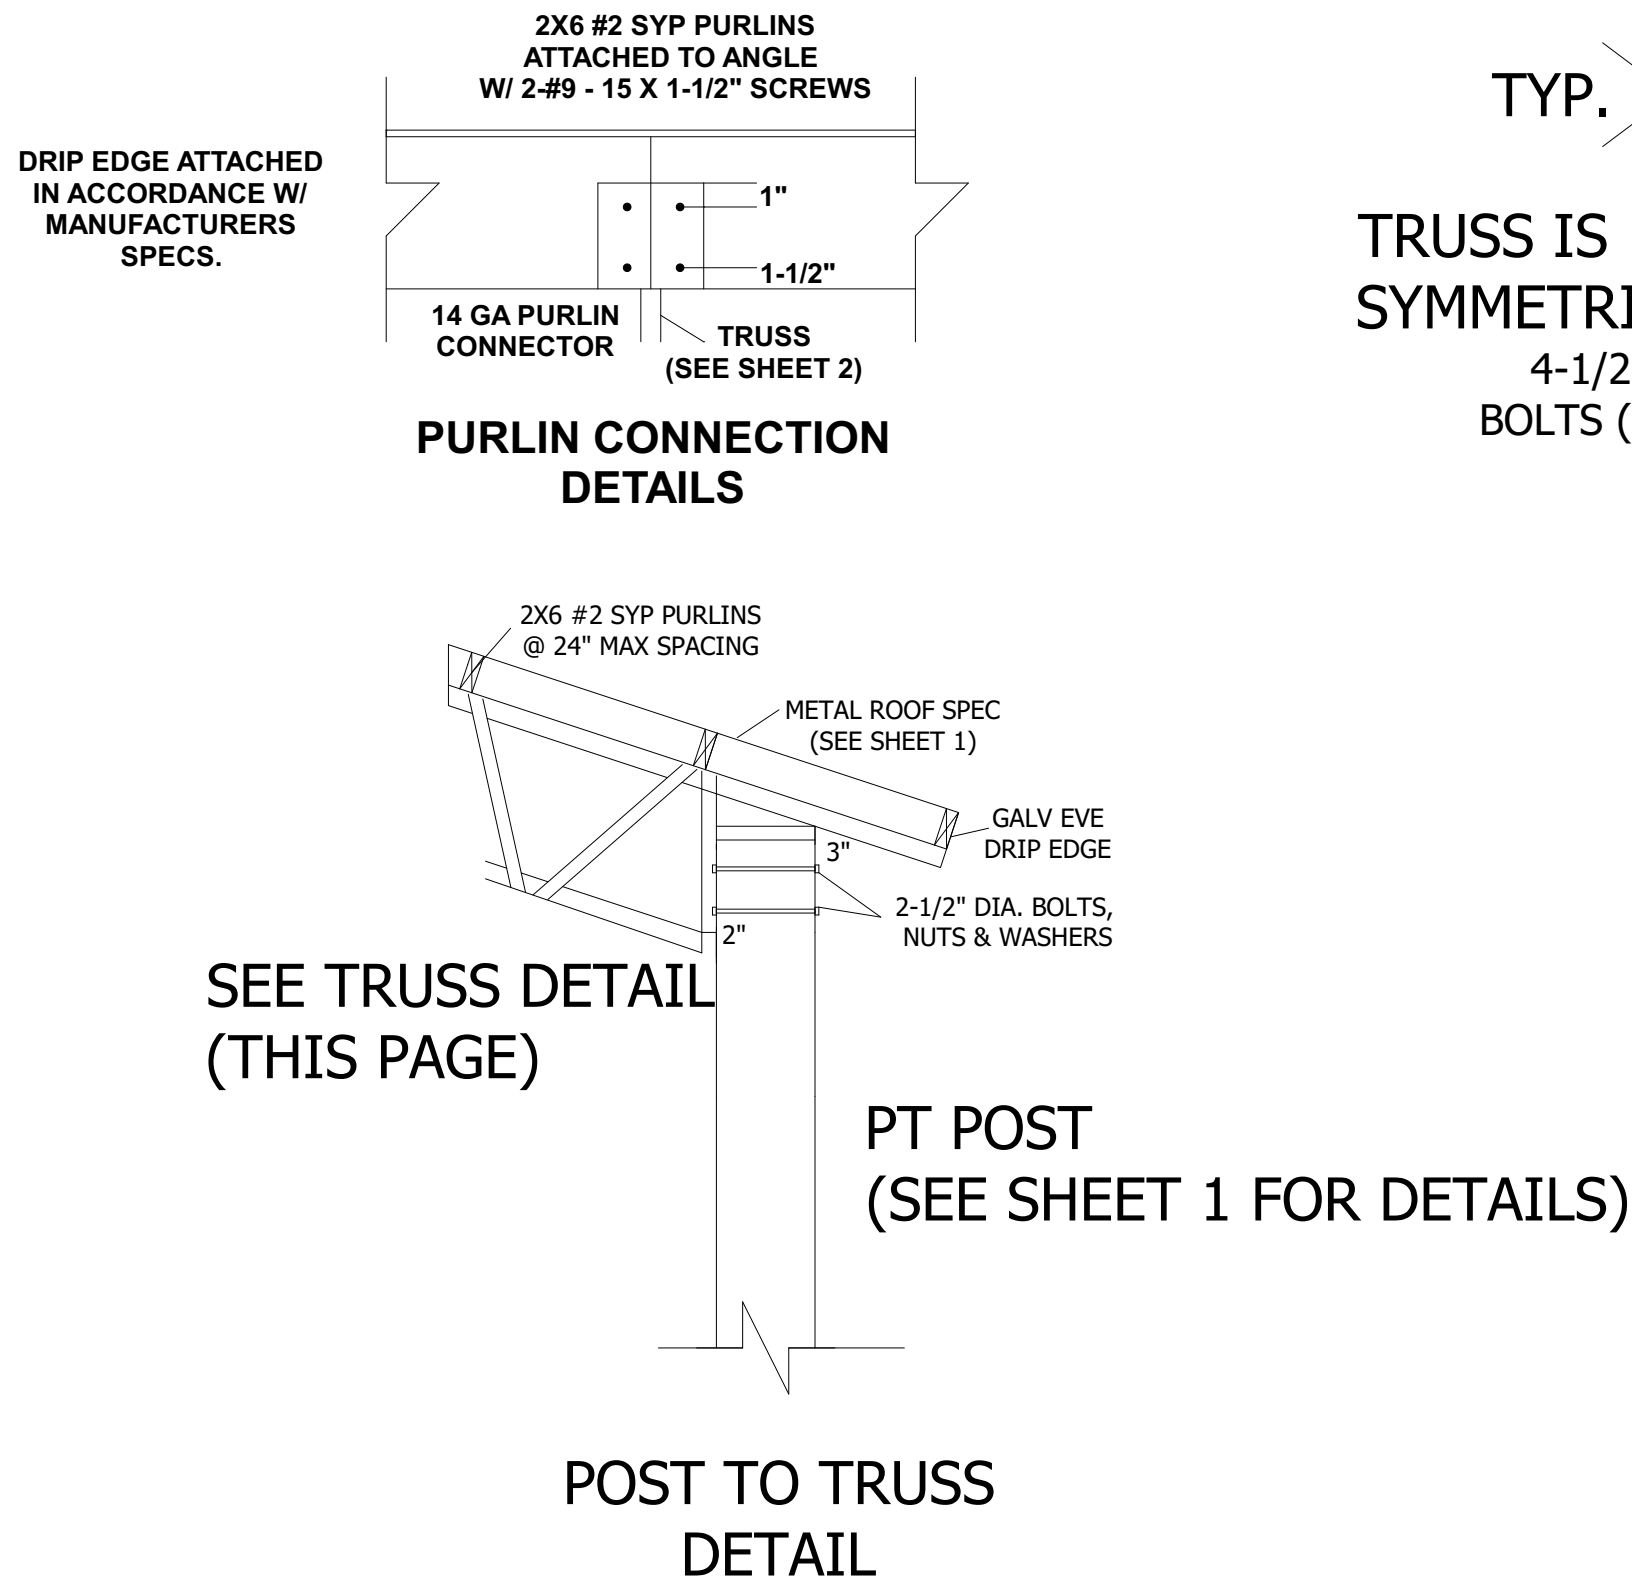

NOTES: TRUSS CROSS-SECTION

- 1- MATERIALS SHALL CONFORM TO STEEL ASTM 572.
- 2- ALL STEEL SHALL BE 50ksi IN ACCORD WITH CURRENT AISC MANUAL.
- 3- WELDING ELECTRODES SHALL BE TYPE E70XX
- 4- ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWS REQUIREMENTS
- 5- ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
- 6- BOL TS SHALL BE ASTM A325. w/ NUTS & WASHERS. TYP)
- 7- WELD STRENGTH 70 KSI MIN:
- 8- ALL POST SHALL BE #2 DENSE PRESSURE TREATED GROUND CONTACT.
- 9- PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
- 10- MIN EDGE DISTANCE FOR BOLTS HOLES SHALL BE 3/4" MIN
- 11- MAX TRUSS SPACING SHALL NOT EXCEED 12'-0" OC.
- 12-THE DESIGNER DISCLAMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBIL TY OR EXERCISES NO CONTROL WITH REGARD TO FABRICATION, HANDLING, AND INSTALLATION OF TRUSSES.

NOTES:

1. PURLINS SHALL BE 2X6 #2 SYP (MAX SPACE @2'-0" O.C.)
2. CONTRACTOR IS RESPONSIBLE FOR TEMPORARY & PERMANENT CONSTRUCTION BRACING.
3. ALL DEMINSIONS SHALL BE VERIFIED PRIOR TO FABRICATION.
4. ALL WELD PER AWS STANDARDS.
5. ALL STELL AND FABRICATION PER ASCI STANDARDS.
7. ITEM DEMINSIONS ARE TO BE MODIFIED FOR SHORTER TRUSS LENGTHS.
8. ALL FASTNERS SHALL BE INSTALLED PER MANUFACTURES SPECIFICATIONS.
9. TRUSS DESIGN CAN BE USED FOR TRUSS LENGTHS SHORTER THAN 50 FEET.
10. WELDING ELECTRODES SHALL BE E70XX
11. ALL WELDS SHALL BE IN ACCORDANCE WITH AWS REQUIRMENTS.
12. ALL POST SHALL BE #2 DENSE PRESSURE TREATED.

BILL OF MATERIALS


ITEM NO.	DESCRIPTION	MATERIAL (50 KSI)
A1	TOP CHORD	LL 2 X 2 X 3/16* ASTM 572
A2	BOTTOM CHORD	LL 2 X 2 X 3/16* ASTM 572
A3	VERTICAL CHORD	LL 2 X 2 X 3/16* ASTM 572
A4	VERTICAL CHORD	L 1 1/2 X 1 1/2 X 3/16 ASTM 572
A5	TIE	L 2 X 2 X 3/16 ASTM 572
A6	TIE	L 2 X 2 X 3/16 ASTM 572
W1	WEB	L 1-1/4 X 1-1/4 X 3/16 ASTM 572
W2	WEB	L 1-1/4 X 1-1/4 X 3/16 ASTM 572
B1	BASE	LL 2 X 2 X 3/16* ASTM 572

NOTE: LL * DENOTES DOUBLE ANGELS



Tomas B. Whitman, PE
MADISON ENGINEERING
This has been electronically signed and sealed by TOMAS B. WHITMAN, PE using a Digital signature and date.
Printed copies of this document are not considered signed and sealed and the signature must be verified on an electronic device.

TOMAS B
WHITMAN
2025.04.17
09:58:42 -04'00'

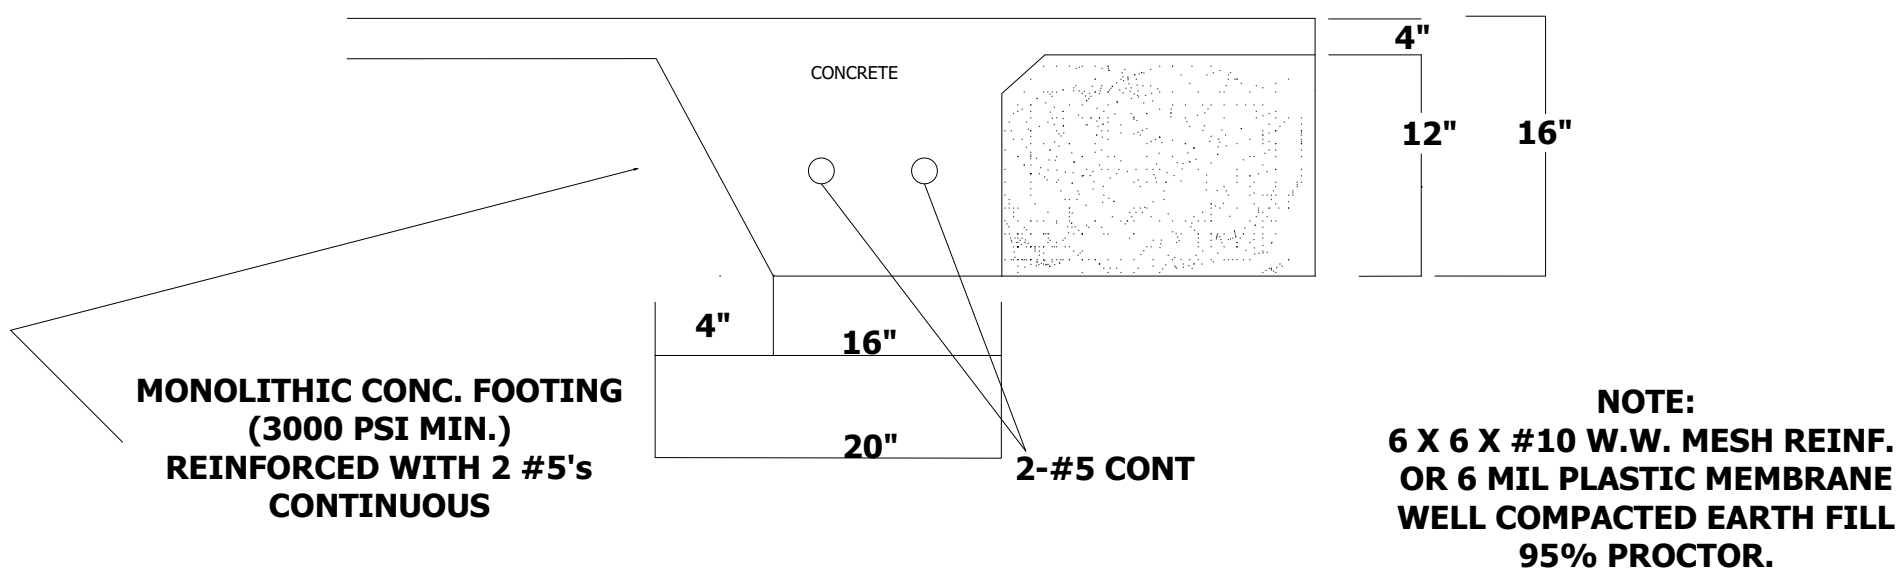

CONCRETE:
CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS. COVER OVER REINFORCING STEEL FOR FOUNDATIONS, MINIMUM CONCRETE COVER OVER REINFORCING BARS SHALL BE 3 INCHES IN FOUNDATIONS WHERE THE CONCRETE IS CAST AGAINST AND PERMANENTLY IN CONTACT WITH EARCH OR EXPOSED TO THE EARTH OR WEATHER AND 1 1/2" ELSEWHERE. REINFORCING BARS EMBEDDED IN GROUTED CELLS SHALL HAVE A MINIMUM CLEAR DISTANCE OF 1/4" FOR FINE GROUT OR 1/2" FOR COURSE GROUT BETWEEN REINFORCING BARS AND ANY FACE OF A CELL. REINFORCING BARS USED IN MASONRY WALLS SHALL HAVE A MASONRY COVER (INCLUDING GROUT) OF NOT LESS THAN 2" FOR MASONRY UNITS WITH FACE EXPOSED TO EARTH OR WEATHER 1 1/2" FOR MASONRY UNITS NOT EXPOSED TO EARCH OR WEATHER.


REINFORCING STEEL:
THE REINFORCING STEEL SHALL BE MINIMUM GRADE 40.

GALVANIZATION:
METAL ACCESSORIES FOR USE IN EXTERIOR WALL CONSTRUCTION NOT DIRECTLY EXPOSED TO THE WEATHER SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A 153, CLASS B-2. METAL PLATE CONNECTORS, SCREWS, BOLTS AND NAILS EXPOSED DIRECTLY TO THE WEATHER SHALL BE IN STAINLESS STEEL OR HOT DIPPED GALVANIZED.

REINFORCEMENT MAY BE BENT IN THE SHOP OR THE FIELD PROVIDED:

- 1. ALL REINFORCEMENT IS BENT COLD**
- 2. THE DIAMETER OF THE BEND, MEASURED ON THE INSIDE OF THE BAR, IS NOT LESS THAN 6-BAR DIAMETERS AND**
- 3. REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT.**

EXCEPTION:
WHERE BENDING IS NECESSARY TO ALIGN BARS WITH A VERTICAL CELL, BARS PARTIALLY EMBEDDED IN CONCRETE SHALL BE PERMITTED TO BE BENT AT A SLOPE NOT MORE THAN 1" OF THE HORIZONTAL DISPLACEMENT TO 6" OF VERTICAL BAR LENGTH.

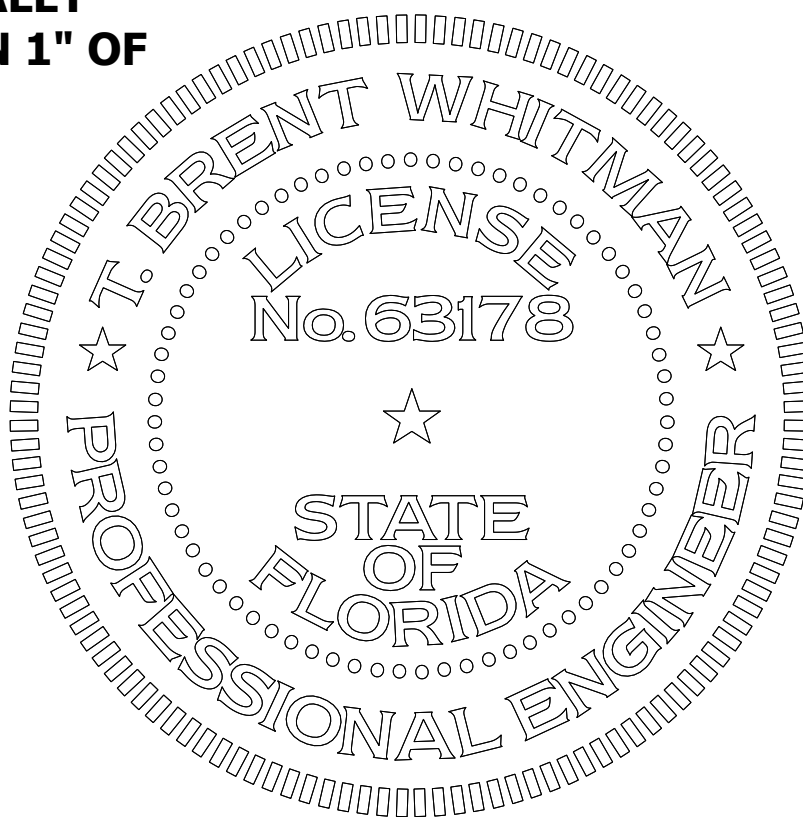

 Thomas B. Whitman, PE
MADISON ENGINEERING
This has been electronically signed and
sealed by TOMAS B. WHITMAN, PE,
using a Digital signature and date.
Printed copies of this document are not
considered signed and sealed and the
signature must be verified on an
electronic device.

**TOMAS B
WHITMAN**

**2025.04.17
09:58:23 -04'00'**

CARMEN FAVORITO (32X50)

170 SW JERICHO GLN, LAKE CITY, FL 32024

170 SW JERICHO GLN, LAKE CITY, FL 32024

POLY BARN - B - 32 X 50

ABT TRUSSES

170 SW JERICHO GLN, LAKE CITY, FL 32024

DESIGNED TBW

DRAWN DVD

CHECKED TBW

APPROVED TBW

DATE: 17 APRIL 2025

MADISON ENGINEERING, LLC

CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING

265 NE Ridge Loop

Madison, Florida 32540

Phone 850.973.7864

COA No.: 27216 www.madisonengineer.com

CARMEN FAVORITO (32X50)

170 SW JERICHO GLN, LAKE CITY, FL 32024

170 SW JERICHO GLN, LAKE CITY, FL 32024

POLY BARN - B - 32 X 50

ABT TRUSSES

170 SW JERICHO GLN, LAKE CITY, FL 32024

DESIGNED TBW

DRAWN DVD

CHECKED TBW

APPROVED TBW

DATE: 17 APRIL 2025

MADISON ENGINEERING, LLC

CONSULTING CIVIL & ENVIRONMENTAL ENGINEERING

265 NE Ridge Loop

Madison, Florida 32540

Phone 850.973.7864

COA No.: 27216 www.madisonengineer.com