#### APPLICABLE CODES AND STANDARDS

- 2023 FLORIDA BUILDING CODE (8TH EDITION)
- 2021 INTERNATIONAL BUILDING CODE
- ASCE 7-22: MINIMUM DESIGN LOADS ON BUILDINGS AND OTHER STRUCTURES
- AISC STEEL CONSTRUCTION MANUAL (15TH EDITION)
- ACI 318-14: BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE
- TMS 402-16: BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES
- AWS D1.1: STRUCTURAL WELDING

#### INSTALLATION NOTES AND SPECIFICATIONS

- ROOF PITCH SHALL NOT BE GREATER THAN 12H:4V
- 2. END WALL COLUMNS (POST) AND SIDE WALL COLUMNS ARE THE SAME U.N.O.
- 29 GA METAL PANELS SHALL BE FASTENED DIRECTLY TO 2.5" x 2.5" x 14 GA TUBE STEEL (TS) FRAMING MEMBERS FOR VERTICAL PANELS.
- 29 GA METAL PANELS SHALL BE FASTENED DIRECTLY TO 18 GA HAT CHANNELS U.N.O.
- 4. FASTENER SPACING ON-CENTERS ALONG RAFTERS OR PURLINS, AND POSTS SHALL BE:
- INTERIOR = 9" 4.2.
- 5. FASTENERS SHALL BE #12-14 x 3/4" SELF-DRILLING SCREWS (SDS), USE CONTROL SEAL WASHER WITH EXTERIOR FASTENERS. APPLICABLE ONLY FOR:
- MEAN ROOF HEIGHT OF 20'-0" OR LESS
- ROOF SLOPES OF 18° (4:12 PITCH) OR LESS
- SPACING REQUIREMENTS FOR OTHER ROOF HEIGHTS AND/OR SLOPES MAY VARY.
- 6. ANCHORS SHALL BE INSTALLED THROUGH THE BASE RAIL WITHIN 6" OF EACH RAFTER COLUMN ALONG SIDES AND ENDS
- STANDARD GROUND ANCHORS (SOIL NAILS) CONSIST OF #4 REBAR WITH WELDED NUT x 30" LONG AND MAY BE USED IN SUITABLE SOILS.
- 7.1. OPTIONAL ANCHORAGE MAY BE USED IN SUITABLE SOILS AND MUST BE USED IN UNSUITABLE SOILS AS NOTED. SOIL NAILS MAY BE USED FOR WIND SPEEDS LESS THAN OR EQUAL TO 145 MPH

#### BOW/RAFTER FRAME, END POST, GROUND ANCHOR AND PANEL FASTENER SPACING SPECIFICATIONS FASTENER SPACING O.C FOR ULT NOMINAL MAXIMUM RAFTERS/PURLINS, & POSTS (INCHES) WIND WIND RAFTER/BOW WIND SPEED SPEED EXPOSURE AND END POST CATEGORY INTERIOR (MPH) CATEGORY SPACING (FEET) BOWS/RAFTERS BOWS/RAFTERS I, II, III, or IV 115 - 150 89 - 116 151 - 180 | 117 - 139 4.0

PAGE NO.

S-1

S-2

S-3

S-4

S-5

S-6 S-7

S-8

S-9

S-10

S-11

S-12

S-13

NOTES:
1. SPECIFICATIONS APPLICABLE TO 26 OR 29 GAUGE METAL PANELS FASTENED DIRECTLY TO 12 OR 14 GAUGE STEEL TUBE BOW FRAMES.
2. FASTENTERS CONSIST OF 1/4\*-14X1\* SELF-DRILLING SCREWS WITH CONTROL SEAL WASHER.

**DRAWING INDEX** 

DESCRIPTION NOTES AND SPECIFICATIONS

BOX-BOW EAVE FRAME RAFTER ENCLOSED BUILDING

BASE RAIL AND ANCHORAGE DETAILS

CONNECTION DETAILS (1 OF 4)

CONNECTION DETAILS (2 OF 4)

CONNECTION DETAILS (3 OF 4)

**BOX EAVE RAFTER LEAN-TO OPTIONS** 

CONNECTION DETAILS (4 OF 4)

OPTIONAL CONCRETE STRIP FOOTING

OPTIONAL HELICAL ANCHORING DETAIL

BOX EAVE RAFTER VERTICAL ROOF-SIDING OPTION

FREESTANDING BOX EAVE RAFTER LEAN-TO OPTIONS

BOX EAVE RAFTER END WALL, SIDE WALL AND OPENING FRAMING


- SPECIFICATIONS APPLICABLE ONLY FOR MEAN ROOF HEIGHT OF 20 FEET OR LESS, AND ROOF SLOPES OF 14°(3:12 PITCH
- SPACING REQUIREMENTS FOR OTHER ROOF HEIGHTS AND/OR SLOPES MAY VARY.
- 4. GROUND ANCHOR REQUIREMENTS ARE 1 @ EACH CORNER AND ONE EVERY OTHER INTERIOR BOW/RAFTER POST LOCATION, AT MAXIMUM OF 10' O.C., AND BOTH SIDES OF OPENINGS WHERE BASE RAIL IS ABSENT.


  5. GROUND ANCHORS ARE NOT REQUIRED WITH CONCRETE SLAB CONSTRUCTION.

#### **DESIGN LOADS**

- DEAD LOAD = 15 PSF
- LIVE LOAD = 20 PSF
- 3. WIND LOAD (SEE TABLE 1)

# **ENCLOSED METAL BUILDING DESIGN** 22FT WIDE X 30FT LONG X 10FT EAVE HT.

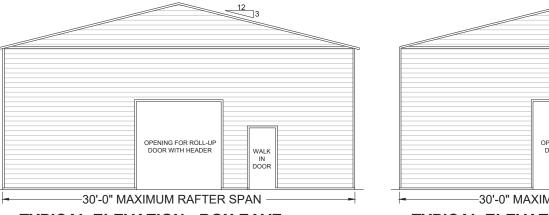

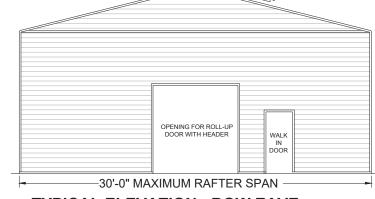


## **TYPICAL ELEVATION - BOX EAVE**

SCALE: NTS

**TYPICAL ELEVATION - BOW EAVE** 

SCALE: NTS

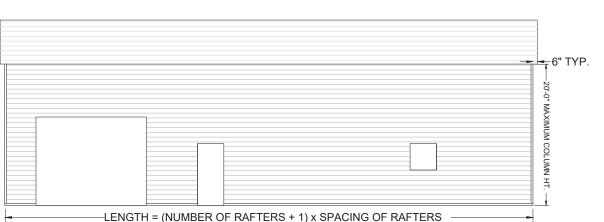

SCALE: NTS

#### TABLE 1

MEMBER	PRODUCT	MAX WIND DESIGN					
	APPROVAL NUMBER	PRESSURES					
ROOF PANELS	FL39466	+41.6 PSF / -31.2 PSF					
WALL PANELS	FL39594	+55.4 PSF / -41.6 PSF					
GARAGE DOOR	CTP	CTP					
WALK-IN DOOR	CTP	СТР					

PRODUCTS THAT MEET OR EXCEED DESIGN PRESSURES

# TYPICAL SIDE ELEVATION

JCT	MAX WIN
HIMPED	DDEC

CTP = CONTRACTOR TO PROVIDE 2023 FBC APPROVED AS TABLULATED.

# PLANS PREPARED BY:

12558 BASS ROAD, LIVE OAK, FLORIDA 32060 P:386.320.7400 F: 850.807.7309 WWW.COLLINSENG.COM **CERTIFICATE OF AUTHORIZATION: 31728** 

> SEALED BY ADAM T. COLLINS, P.E. ON 2024.05.16 PRINT COPIES OF THIS DOCUMENT ARE NOT CONSIDERED VERIFIED ON ANY ELECTRONIC COPIE
>
> NO. 75584
>
> STATE OF
>
> ONAL ENGINEER
>
> VERIFIED ON ANY ELECTRONIC COPIE
>
> NO. 75584 VERIFIED ON ANY ELECTRONIC COPIES.

8	NO.	
X		
요		
岩		
s:\ace dropbox\PR		
S:\8		


REVISIONS 2024.05. ORAWN SM DESIGNED DMC CHECKED ATC 22047 CA# 31728 ~ P: 386 320 7400 ~ WWW COLLINSENG COM

**ELITE METAL** MANUFACTURING 10121 88TH TRACE

**NOTES AND SPECIFICATIONS** 

James Smith 539 NW Ridge Glen Welborn, FL 32094

S-1 SCALE AS-SHOWN

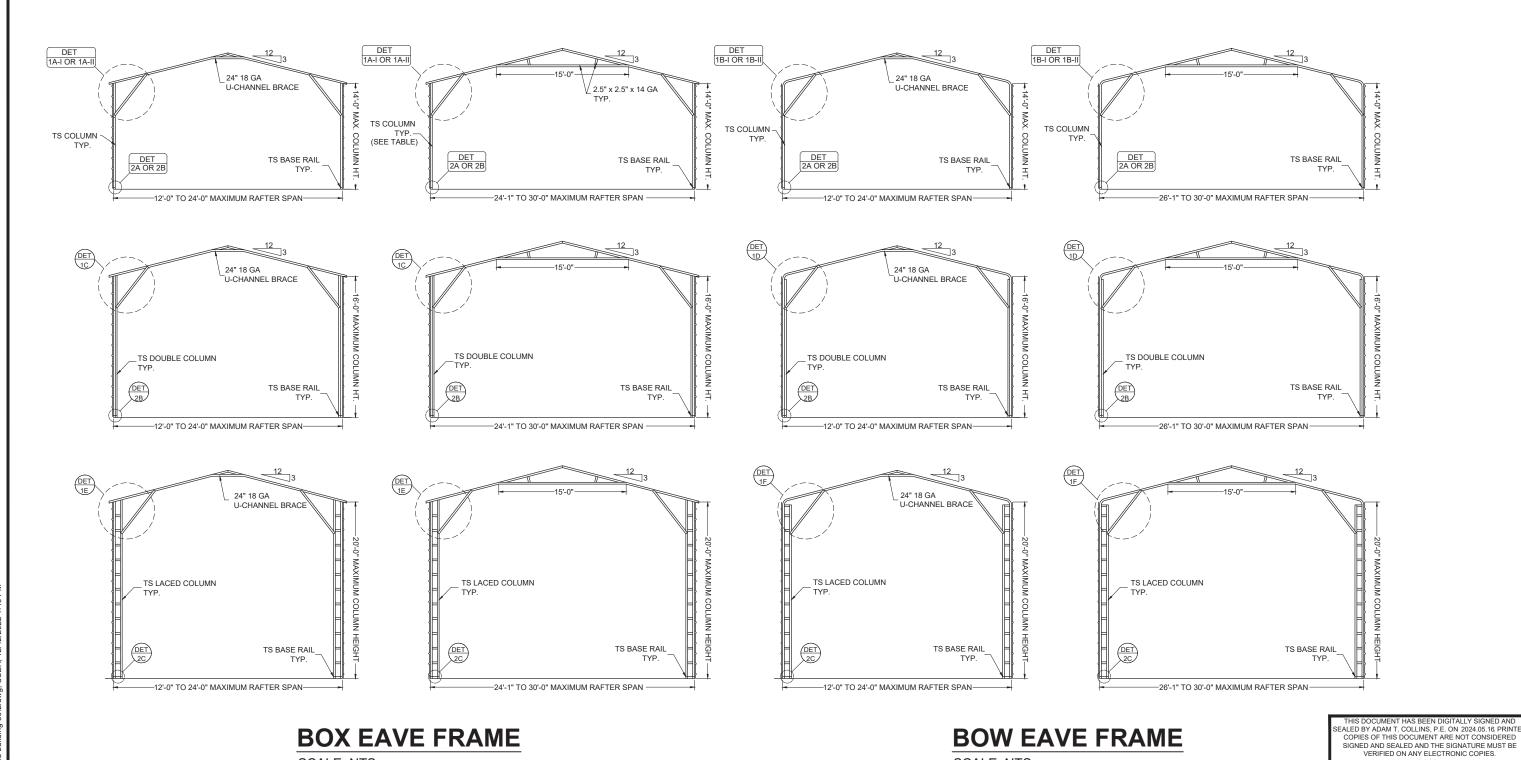

# **BOX EAVE FRAME**

SCALE: NTS

# **BOW EAVE FRAME**

SCALE: NTS

			_					
NO.	REVISIONS	DATE	DATE	2024.05.16	SUBMITTALS	DATE	PREPARED BY	CLIENT
			DRAWN	SM			ADAM COLLING	ELITE
			DESIGNED	DMC			ADAM COLLINS	MANUF
			CHECKED	ATC			ENGINEERING INC.	10121 88
			JOB No.	22047			CA# 31728 ~ P: 386.320.7400 ~ WWW.COLLINSENG.COM	

TE METAL JFACTURING 88TH TRACE

**BOX-BOW EAVE** FRAME RAFTER **ENCLOSED BUILDING** 

James Smith 539 NW Ridge Glen Welborn, FL 32094

S-2

AS-SHOWN

SCALE

NO. 75584


STATE OF

ORIDA:

ORIDA:

ORIDA:

ON AL ENGINEER OF CONTROL OF CON

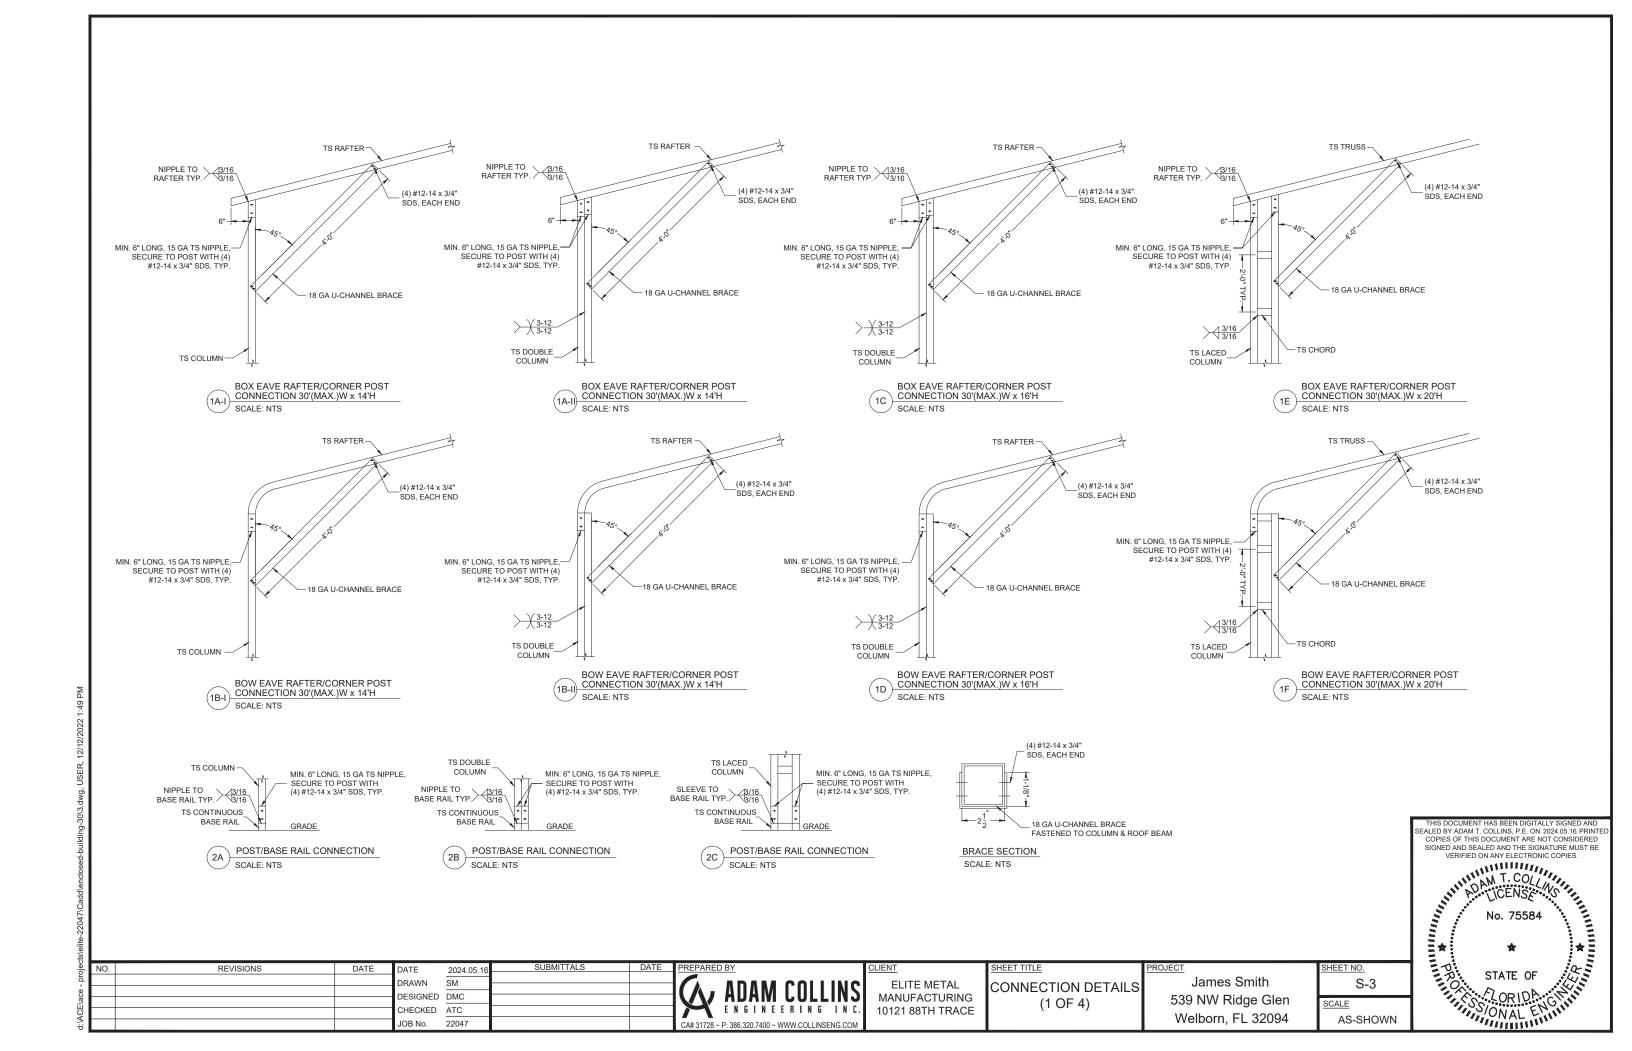

#### **GENERAL NOTES**

MINIMUM SOIL BEARING CAPACITY: 1500 PSF. CONCRETE STRENGTH: 3000 PSI @ 28 DAYS

#### MONOLITHIC FOOTER SIZE 110 C - 140 C 8" x 12" - (2) #4 12" x 16" - (2) #4 ABOVE 140 C

#### REINFORCING STEEL


- REBAR SHALL BE ASTM A615 GRADE 60
- SLAB REINFORCEMENT = WELDED WIRE FABRIC PER ASTM A185 OR FIBERGLASS FIBER REINFORCEMENT
- CONCRETE COVER SHALL BE
- 3.1. 3" WHERE EXPOSED TO SOIL OR WATER.
- 2" EVERYWHERE ELSE.
- 4. REBAR SHALL BE BENT WITHOUT HEATING.
- MINIMUM BEND = 6 X BAR DIAMETER
- REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD


#### **HELIX ANCHOR NOTES**

- 1. USE MINIMUM (2) 4" HELICES WITH 30" EMBEDMENT FOR THE FOLLOWING SOILS:
- 1.1. VERY DENSE AND/OR CEMENTED SANDS
- 1.2. COARSE GRAVEL AND COBBLES
- 1.3. CALICHE
- PRELOADED SILTS AND CLAYS 1.4.
- CORALS 1.5.
- MEDIUM DENSE COARSE SANDS 1.6.
- 1.7. SANDY GRAVEL
- VERY STIFF SILTS AND CLAYS 1.8.
- 2. USE MINIMUM (2) 6" HELICES WITH MINIMUM 48" EMBEDMENT FOR
- LOOSE TO MEDIUM DENSE SANDS
- 2.2. FIRM TO STIFF CLAYS AND SILTS
- ALLUVIAL FILL
- 3. USE MINIMUM (2) 8" HELICES WITH MINIMUM 60" EMBEDMENT.
- 3.1. FOR VERY LOOSE TO MEDIUM DENSE SANDS
- FIRM TO STIFFER CLAYS AND SILTS
- ALLUVIAL FILL.

3C


SCALE: NTS

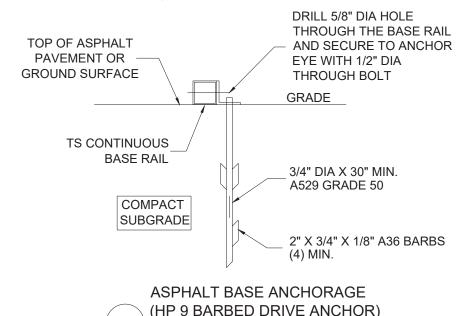

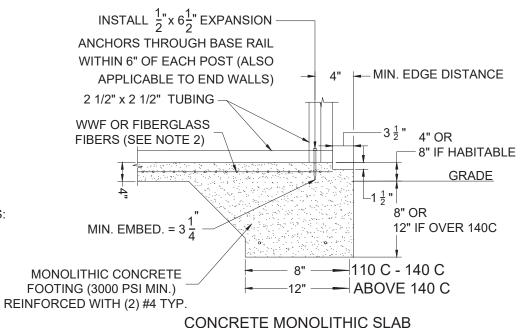


SCALE: NTS



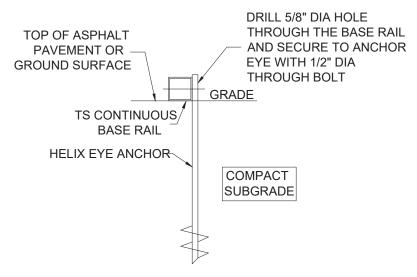

**GROUND BASE HELIX ANCHORAGE** SCALE: NTS

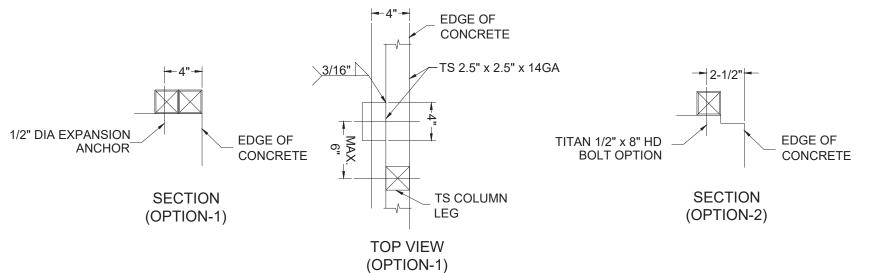

TYPICAL ANCHOR DETAIL WHEN BASE RAIL IS NEAR EDGE OF CONCRETE SCALE: NTS

HEET TITLE

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND EALED BY ADAM T. COLLINS, P.E. ON 2024.05.16 PRINT COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

VERIFIED ON ANY ELECTRONIC COPIES.

No. 75584

STATE OF

ORIDA CM.

ORIDA CM.


			_				
Ο.	REVISIONS	DATE	DATE	2024.05.16	SUBMITTALS	DATE	PREPARED BY
			DRAWN	SM			
							( A ADAM COLLINS
			DESIGNED	DMC			
			CHECKED	ATC			ENGINEERING INC.
			JOB No.	22047			CA# 31728 ~ P: 386.320.7400 ~ WWW.COLLINSENG.COM

**ELITE METAL** MANUFACTURING 10121 88TH TRACE

BASE RAIL AND ANCHORAGE DETAILS

James Smith 539 NW Ridge Glen Welborn, FL 32094


S-4 SCALE AS-SHOWN

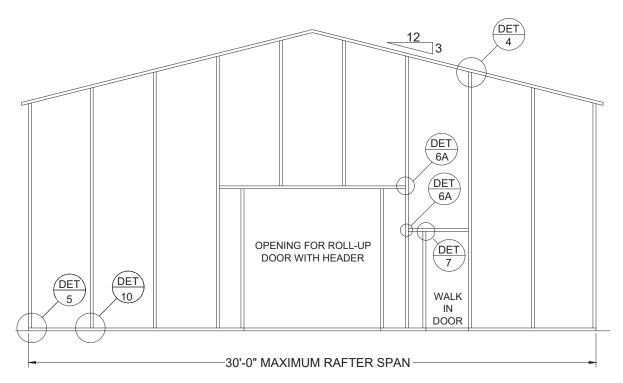

SPACING = 5'-0" FOR WIND SPEEDS BETWEEN 110 MPH AND 140 MPH SPACING = 4'-0" FOR WIND SPEEDS BETWEEN 140 MPH AND 180 MPH

## TYPICAL BOX EAVE RAFTER END WALL FRAMING SECTION

SCALE: NTS

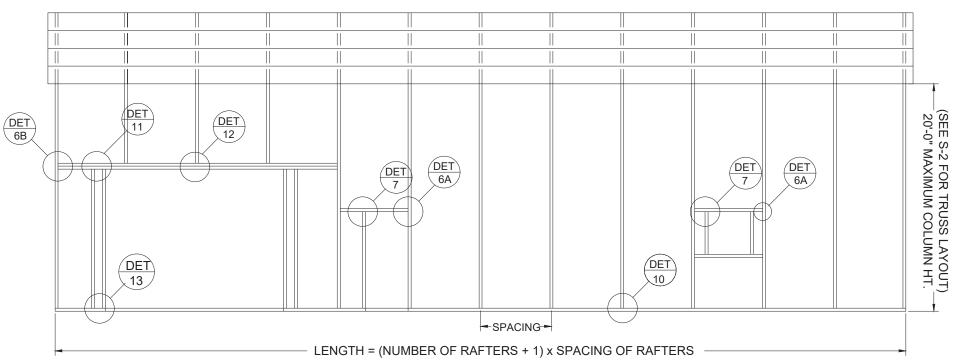

SPACING = 5'-0" FOR WIND SPEEDS BETWEEN 110 MPH AND 140 MPH SPACING = 4'-0" FOR WIND SPEEDS BETWEEN 140 MPH AND 180 MPH

# TYPICAL BOX EAVE RAFTER SIDE FRAMING SECTION

SCALE: NTS

NO.	REVISIONS	DATE	DATE	2024.05.16	SUBMITTALS	DATE	PREPARED BY
			DRAWN	SM			C ADAM COLLING
							l(🗘 ADAM COLLINSI
			CHECKED	ATC			ENGINEERING INC.
			JOB No.	22047			CA# 31728 ~ P: 386 320 7400 ~ WWW COLLINSENG COM

ELITE METAL
MANUFACTURING
10121 88TH TRACE

BOX EAVE RAFTER END WALL, SIDE WALL AND OPENING FRAMING

James Smith 539 NW Ridge Glen Welborn, FL 32094 SHEET NO.
S-5
SCALE
AS-SHOWN


THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY ADAM T. COLLINS, P.E. ON 2024 05.16 PRINTEE COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

NO. 75584

STATE OF

ONAL ENGINEERING OF THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

:047/Cadd/effclosed-building-50/5.dwg, USER, 12/12/22 1:49 FIV

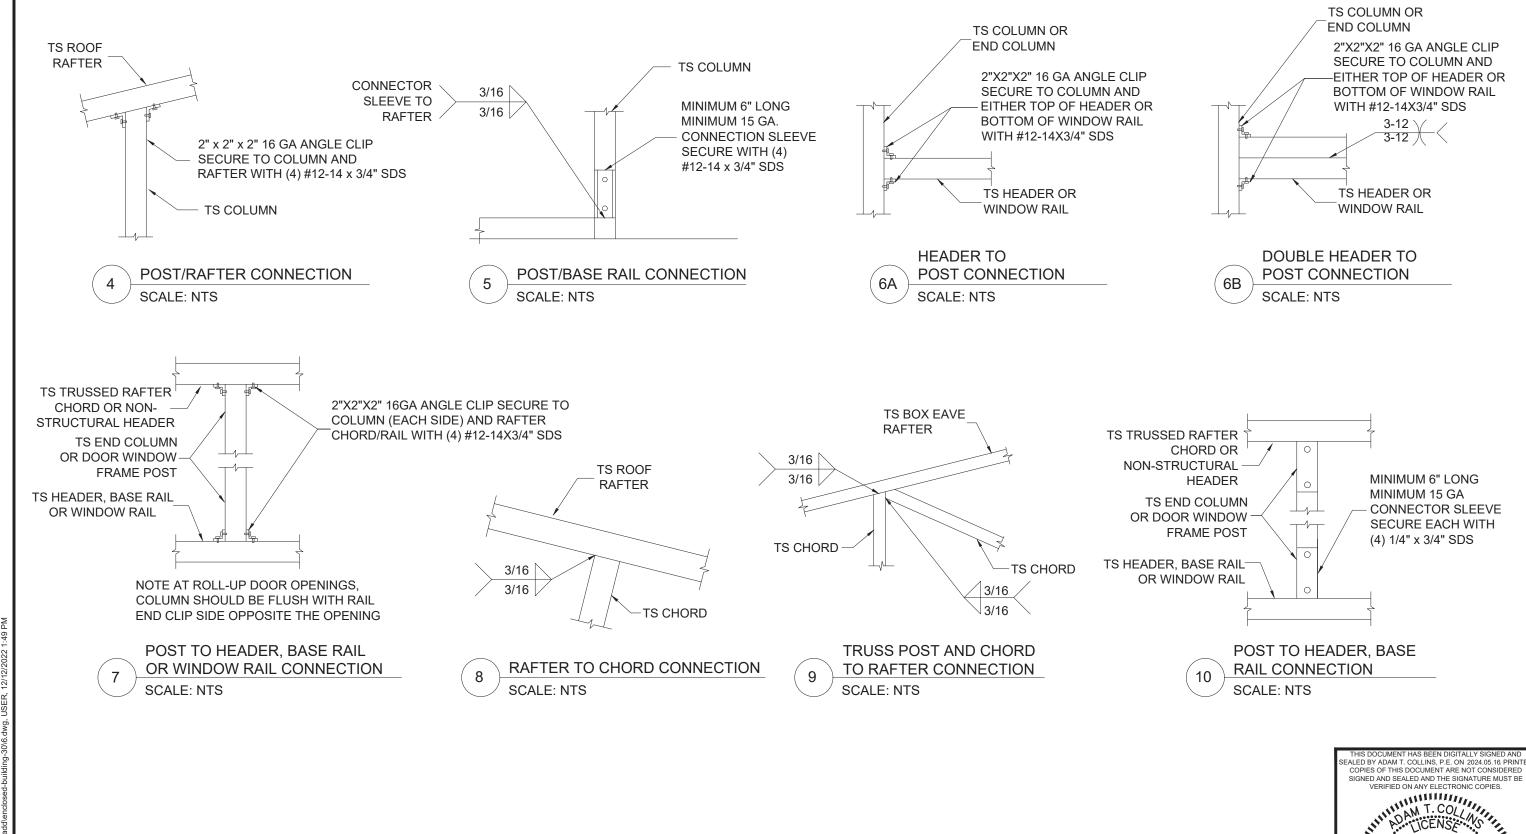

d:\ACE\ace - projects\elite-22047\Cadd\

**REVISIONS** 

2024.05.

SM

22047

ORAWN

DESIGNED DMC

CHECKED ATC

ADAM COLLINS
ENGINEERING IN C.
CA# 31728 ~ P: 386 320 7400 ~ WWW COLLINSENG COM

ELITE METAL MANUFACTURING 10121 88TH TRACE CONNECTION DETAILS (2 OF 4)

SHEET TITLE

James Smith 539 NW Ridge Glen Welborn, FL 32094 S-6
SCALE
AS-SHOWN

VERIFIED ON ANY ELECTRONIC COPIES.


No. 75584

STATE OF


ORIDA:

ONAL ENGINEERING

NO. 75584

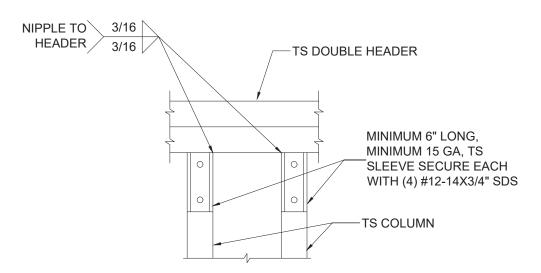


DOUBLE HEADER TO POST CONNECTION SCALE: NTS

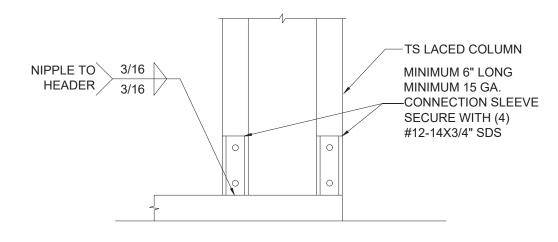

POST/BASE RAIL CONNECTION

NIPPLE TO 3/16 HEADER 3/16 TS POST MINIMUM 6" LONG. MINIMUM 15 GA, TS SLEEVE SECURE EACH WITH (4) #12-14X3/4" SDS / 3/12 TS DOUBLE HEADER 3/12

> POST/DOUBLE HEADER CONNECTION 12 SCALE: NTS

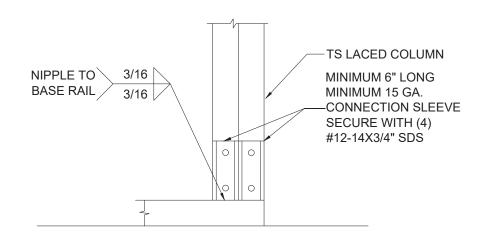

POST/BASE RAIL CONNECTION (13B SCALE: NTS

NO.	REVISIONS	DATE	DATE	2024.05.16	SUBMITTALS	DATE	PREPARED BY
			DRAWN	SM			
							(A) ADAM COLLINS
			DESIGNED	DMC			
			CHECKED	ATC			ENGINEERING INC.
			JOB No.	22047			CA# 31728 ~ P: 386.320.7400 ~ WWW.COLLINSENG.COM

SCALE: NTS

(13A

**ELITE METAL** MANUFACTURING 10121 88TH TRACE

SHEET TITLE CONNECTION DETAILS (3 OF 4)

James Smith 539 NW Ridge Glen Welborn, FL 32094


S-7 SCALE AS-SHOWN


THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY ADAM T. COLLINS, P.E. ON 2024 05.16 PRINTE COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES. No. 75584

STATE OF

STATE OF

STATE OF

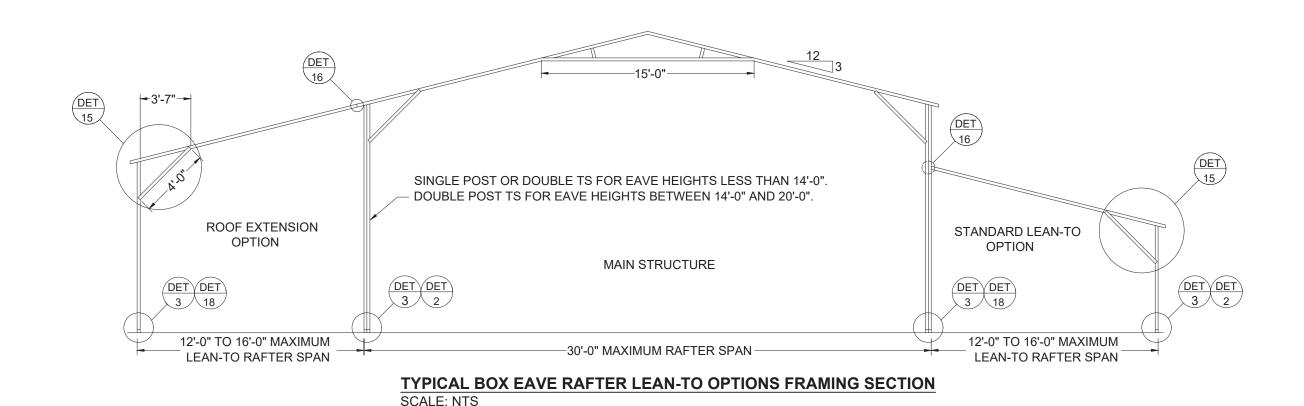

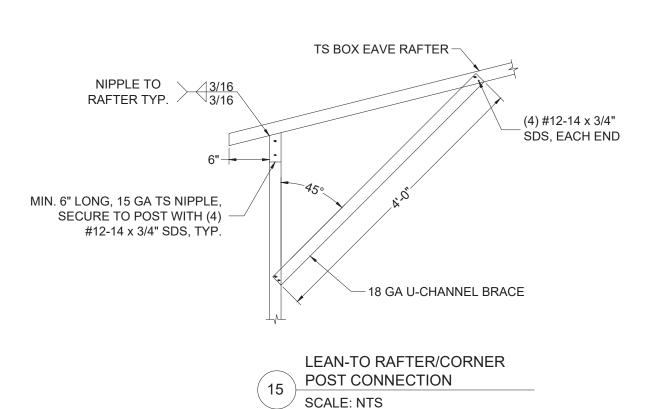

SIGNED AND SEALED AND THE SIGNAL UNE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

AN T. COLLING.

No. 75584

STATE OF

ORIDA.

SONAL ENGINEERS.

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY ADAM T. COLLINS, P.E. ON 2024.05.16 PRINTE COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

DATE DATE 2024.05.16 SUBMITTALS DATE PREPARED BY

DRAWN SM

DESIGNED DMC

CHECKED ATC

JOB No. 22047

DATE 2024.05.16 SUBMITTALS

DATE PREPARED BY

ADAM COLLINS

E N G I N E E R I N G I N C.

CA# 31728 ~ P: 386.320.7400 ~ WWW.COLLINSENG.COM

ELITE METAL
MANUFACTURING
10121 88TH TRACE

BOX EAVE RAFTER LEAN TO OPTIONS


HEET TITLE


James Smith 539 NW Ridge Glen Welborn, FL 32094

S-8

SCALE

AS-SHOWN

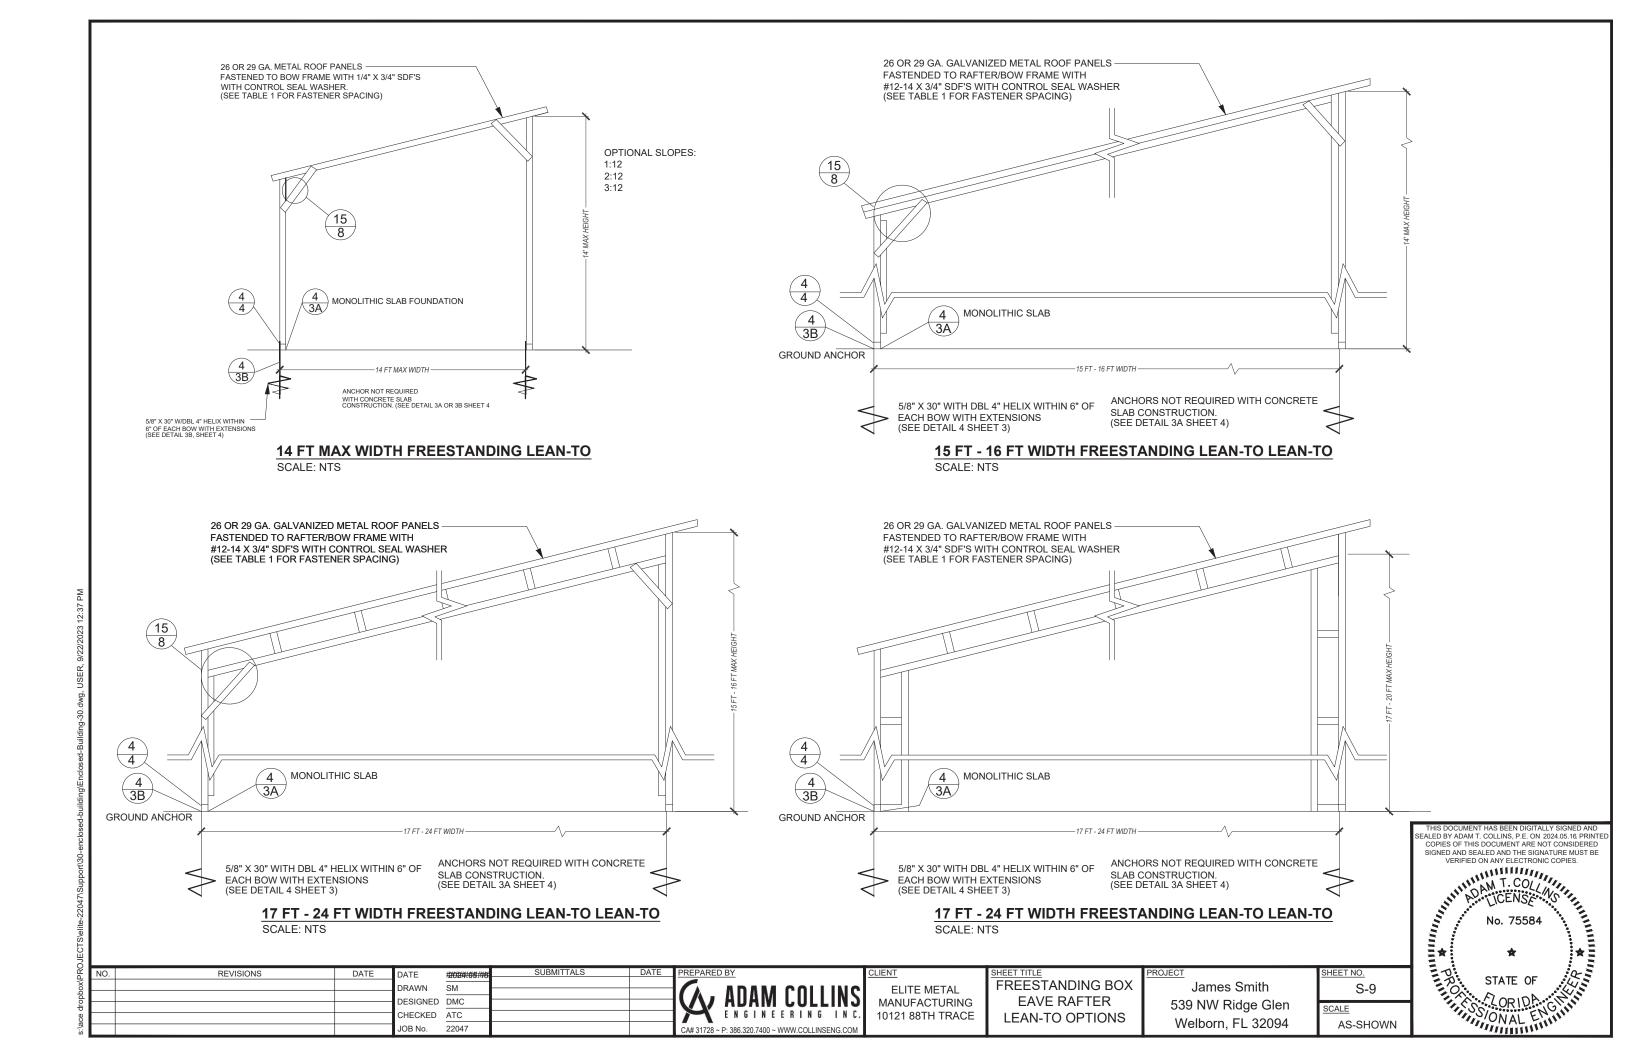

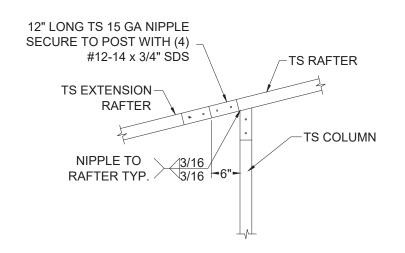


12" LONG TS 15 GA NIPPLE SECURE TO POST WITH (4) / NIPPLE TO #12-14 x 3/4" SDS RAFTER TYP. TS EXTENSION **RAFTER** 3-12 TS RAFTER TS COLUMN 2" x 2" x 2" 16 GA ANGLE CLIP <del>-</del>6"-SECURE TO COLUMN AND EITHER TOP OF HEADER OR-**BOTTOM OF WINDOW RAIL** WITH #12-14 x 3/4" SDS

SIDE EXTENSION RAFTER/POST CONNECTION RAFTER SPAN LESS THAN 12'-0"

SCALE: NTS

SCALE: NTS

SIDE EXTENSION RAFTER/POST CONNECTION
RAFTER SPAN BETWEEN 12'-0" AND 16'-0"
SCALE: NTS

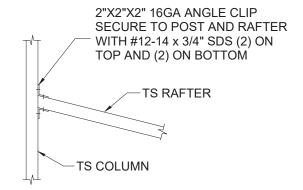

2"X2"X2" 16GA ANGLE CLIP
SECURE TO POST AND RAFTER
WITH #12-14 x 3/4" SDS (2) ON
TOP AND (2) ON BOTTOM

TS DOUBLE RAFTER

TS COLUMN

LEAN TO RAFTER/COLUMN CONNECTION
RAFTER SPANLESS THAN 12'-0"

LEAN TO RAFTER/COLUMN CONNECTION
RAFTER SPAN BETWEEN 12'-0" AND 16'-0"
SCALE: NTS

MIN. 6" LONG, 15 GA TS NIPPLE,
SECURE TO POST WITH (4)
#12-14 x 3/4" SDS, TYP.

TS CONTINUOUS
BASE RAIL

GRADE

18 LEAN-TO POST CONNECTION SCALE: NTS

DATE DATE 2024.05.16 SUBMITTALS DATE PREPARED BY

DRAWN SM

DESIGNED DMC

CHECKED ATC

JOB No. 22047

DATE 2024.05.16 SUBMITTALS

DATE PREPARED BY

ADAM COLLINS

ENGINEERINGINC.

CA#31728 - P: 386.320.7400 - WWW.COLLINSENG.COM

SHEET TITLE

CONNECTION DETAILS

(4 OF 4)

ELITE METAL

MANUFACTURING

10121 88TH TRACE


James Smith 539 NW Ridge Glen Welborn, FL 32094 SHEET NO.
S-10
SCALE
AS-SHOWN


THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND
SEALED BY ADAM T. COLLINS, P.E. ON 2024.05.16 PRINTE
COPIES OF THIS DOCUMENT ARE NOT CONSIDERED
SIGNED AND SEALED AND THE SIGNATURE MUST BE
VERIFIED ON ANY ELECTRONIC COPIES.

NO. 75584

STATE OF
ON AL

.2047\Cadd\enclosed-building-30\9.dwg, USER, 12/12/2022 1:50 Pl

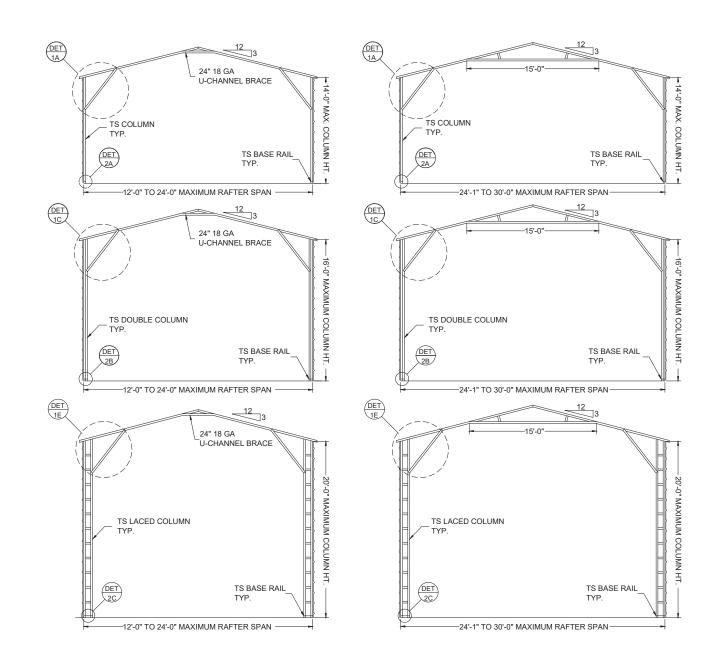


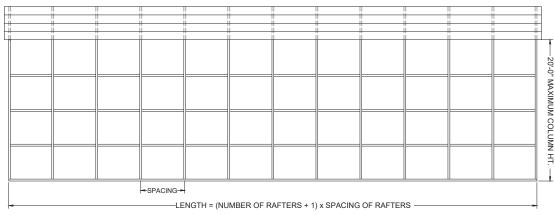


SPACING = 5'-0" FOR WIND SPEEDS BETWEEN 110 MPH AND 140 MPH SPACING = 4'-0" FOR WIND SPEEDS BETWEEN 140 MPH AND 180 MPH 1.125" 18 GA HAT CHANNELS CAN BE USED IN LIEU OF TS FOR GIRTS.

### TYPICAL SIDE FRAME SECTION

SCALE: NTS

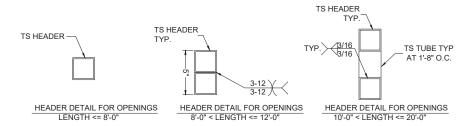

#### SIDE WALL OPTION HEADER

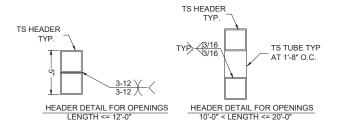

#### **END WALL OPTION HEADER**

Welborn, FL 32094

AS-SHOWN

THIS DOCUMENT HAS BEEN DIGITALLY SIGNED AND SEALED BY ADAM T. COLLINS, P.E. ON 2024.05.16. PRINTE

COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE

VERIFIED ON ANY ELECTRONIC COPIES.

SCALE: NTS

## **BOX EAVE FRAME**

2024.05.

SM

22047

ORAWN

DESIGNED DMC

CHECKED ATC

1.125" 18 GA FURRING CHANNEL FASTENED TO EACH RAFTER WITH (2) #12-14 x 3/4" SDS SPACED AT 48" O.C. MAX TS RAFTER

PANEL ATTACHMENT (ALTERNATE FOR VERTICAL ROOF PANELS) SCALE: NTS

CA# 31728 ~ P: 386.320.7400 ~ WWW.COLLINSENG.COM

No. 75584

STATE OF

STATE OF

STATE OF **BOX EAVE RAFTER** James Smith S-11 **ELITE METAL** VERTICAL MANUFACTURING 539 NW Ridge Glen SCALE 10121 88TH TRACE **ROOF-SIDING OPTION** 

REVISIONS

DATE

## **GENERAL NOTES**

MINIMUM SOIL BEARING CAPACITY: 1500 PSF. CONCRETE STRENGTH: 3000 PSI @ 28 DAYS

#### **REINFORCING STEEL**

- 1. REBAR SHALL BE ASTM A615 GRADE 60
- 2. SLAB REINFORCEMENT = WELDED WIRE FABRIC PER ASTM A185 OR FIBERGLASS FIBER REINFORCEMENT
- CONCRETE COVER SHALL BE
- 3.1. 3" WHERE EXPOSED TO SOIL OR WATER.
- 3.2. 2" EVERYWHERE ELSE.
- 4. REBAR SHALL BE BENT WITHOUT HEATING.
- MINIMUM BEND = 6 X BAR DIAMETER

REVISIONS

2024.05.1


22047

DRAWN

DESIGNED DMC

CHECKED ATC

REINFORCEMENT PARTIALLY EMBEDDED IN CONCRETE SHALL NOT BE FIELD BENT.

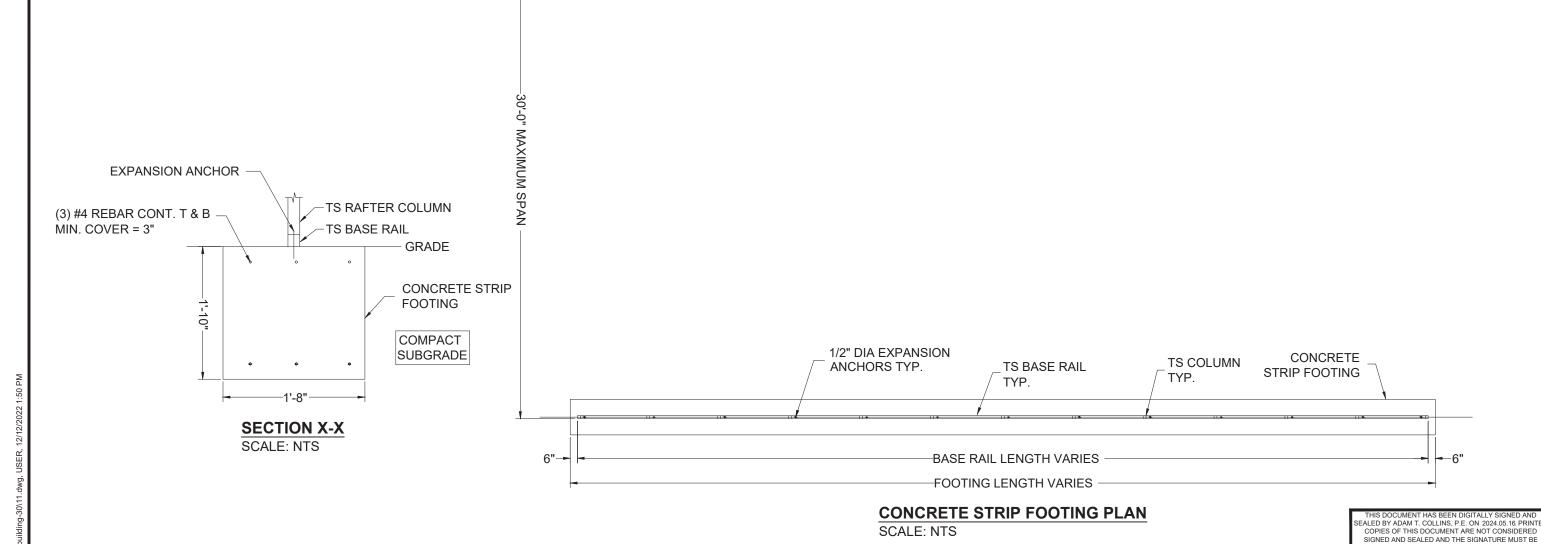

Χ-

X-

**ADAM COLLINS** CA# 31728 ~ P: 386.320.7400 ~ WWW.COLLINSENG.COM

**ELITE METAL** MANUFACTURING 10121 88TH TRACE

OPTIONAL CONCRETE STRIP FOOTING

HEET TITLE

James Smith 539 NW Ridge Glen Welborn, FL 32094

S-12 SCALE AS-SHOWN VERIFIED ON ANY ELECTRONIC COPIES.

No. 75584

STATE OF

ORIDA GIANA

STATE OF

VERIFIED ON ANY ELECTRONIC COPIES.

