

PROPOSED:
**GULF COAST
HEALTH CARE**
**113 BED SKILLED
NURSING FACILITY**

10234 NW PROSPERITY PLACE
LAKE CITY, COLUMBIA COUNTY, FLORIDA

DO NOT SCALE PRINTS
THE DOCUMENTS AND THE INFORMATION CONTAINED HEREIN
ARE THE SOLE PROPERTY OF ARCHITECTURAL CONCEPTS, INC.
UNAUTHORIZED REPRODUCTION AND/OR REUSE MAY BE
PROSECUTED IN ACCORDANCE WITH THE APPROPRIATE
COPYRIGHT AND PATENT LAWS.

PUBLICATION DATE
CONCEPT:
SCHEMATIC DESIGN:
PRELIMINARY DESIGN:
DESIGN DEVELOPMENT:
PERMIT SET:
BID SET:
FOR CONSTRUCTION:
REVISIONS:

REVISION 2 4-25-17

16HA047
HEES & ASSOCIATES, INC.
1381 Fifth Street, Sarasota, Florida 34236
Telephone: (941) 955-4555; Fax: (941) 955-9333
karl@heesassociates.com • www.heesassociates.com
C.O.A. #27043 © 2017 - Hees & Associates, Inc.
All rights reserved.

TO THE BEST OF THE ENGINEER-OF-RECORD'S
KNOWLEDGE AND ABILITY, THE COMPLETED STRUCTURE
DEPICTED ON THESE DOCUMENTS COMPLIES WITH THE
APPLICABLE MINIMUM BUILDING CODES.

NOTE:
DO NOT SCALE OFF OF THESE DRAWINGS. LAYOUT THE
BUILDING USING ALL APPLICABLE CONTRACT DRAWINGS,
BUILDING DIMENSIONS AND THE LOCATION OF ALL
STRUCTURAL ELEMENTS INCLUDING BUT NOT LIMITED TO
SLAB EDGES, WALLS, COLUMNS, OPENINGS AND
DEPRESSIONS SHALL BE COORDINATED WITH THE
ARCHITECTURAL DRAWINGS PRIOR TO LAYOUT OF THE
BUILDING. RESOLVE ANY DISCREPANCIES.


10/18/2017 2:10:35 PM
FILE LOCATION:
2:\2016 Jobs\16HA047 (Lake City Skilled Nursing)\Lake City_FPD\BAT_16HA047.dwg

SHEET DESCRIPTION:
**ENLARGED PARTIAL
FOUNDATION PLAN**

PROJECT NO. 1681 SCALE: AS NOTED

DRAWING NO.

S2.1

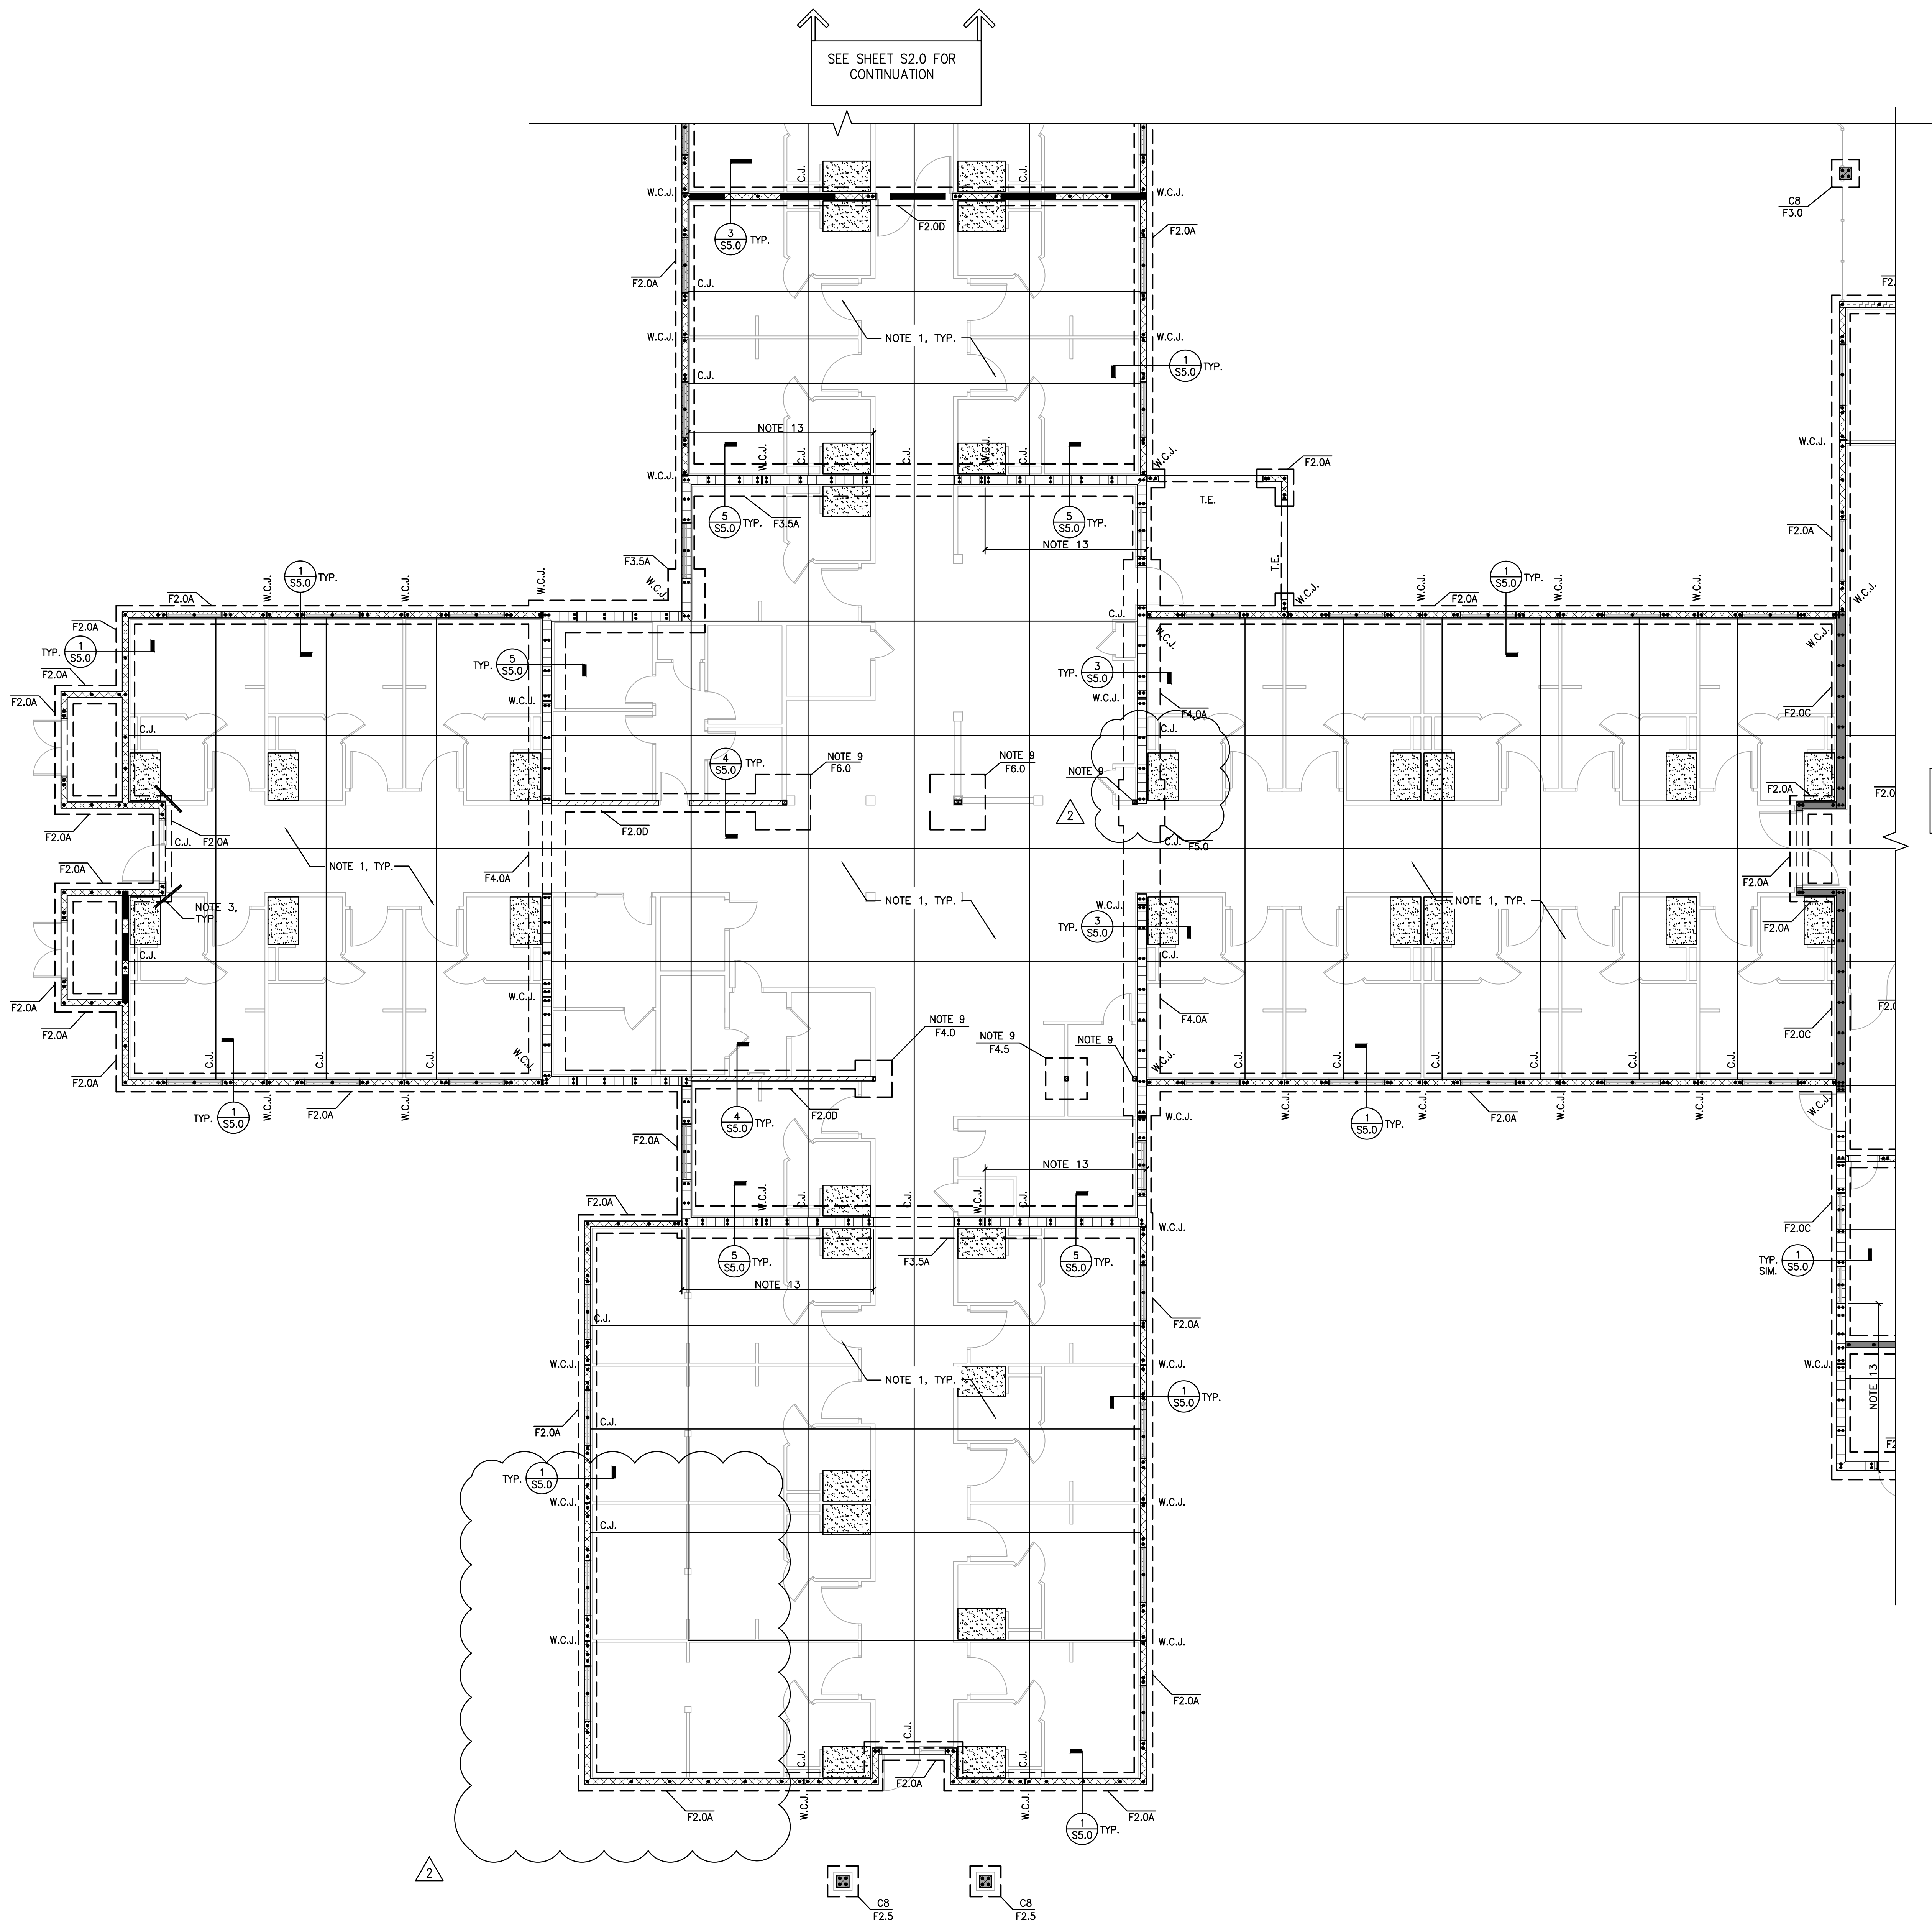

- FOUNDATION PLAN NOTES:**
- 4" CONCRETE SLAB ON GRADE W/ (1) LAYER OF 6x6 W1.4xW1.4 W.W.F. REINF. OR FIBERMESH REINF. ON 15 MIL VAPOR BARRIER ON PREPARED SUBGRADE.
 - C.J. TYPICALLY DENOTES CONTROL JOINT PER DETAIL ON S4.0.
 - TYPICALLY DENOTES (2) #4 x 4'-0" LG SLAB RE-ENTRANT BARS @ 1' O.C.
 - VERIFY DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS BEFORE COMMENCING CONSTRUCTION. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT AND THE STRUCTURAL ENGINEER. FOR ADDITIONAL INFORMATION SEE ARCHITECTURAL DRAWINGS.
 - FOR DIMENSIONS NOT SHOWN, SEE OTHER STRUCTURAL DRAWINGS AND VERIFY WITH ARCHITECTURAL DRAWINGS. DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT AND THE STRUCTURAL ENGINEER.
 - SEE ARCHITECTURAL DRAWINGS FOR SLOPES, DROPS AND DRAIN LOCATIONS IN FLOOR SLABS.
 - CENTERS OF COLUMNS, WALLS, AND BEAMS SHALL COINCIDE WITH FOUNDATION CENTERLINES, U.N.O.
 - KEY ALL INTERSECTING MASONRY WALLS TOGETHER.
 - 5 1/2"x7" PSL WOOD POST, ATTACH TO CONC. SLAB W/ SIMPSON HD14-SDS2.5 W/ PAB-18 W/ 10.5" MIN. EMBED.
 - (3) 2x6 WOOD POST, ATTACH TO CONC. SLAB W/ SIMPSON HTT4 W/ SIMPSON PAB-12 W/ 9" EMBED.
 - 5 1/2"x5 1/2" PSL WOOD COLUMN, ATTACH W/ SIMPSON HTTS TIE-DOWN (ATTACH W/ 26-16x26") W/ SIMPSON PABS ANCHOR BOLT W/ 9" MIN. EMBED.
 - (2) 2x6 WOOD STUD POST, ATTACH TO SLAB W/ SIMPSON TIE-DOWN W/ SIMPSON HTTS W/ SIMPSON PABS ANCHOR BOLT W/ 6" MIN. EMBED.
 - GROUT FILL 12" ENTIRE CMU WALL SOLID AT EXTENTS, FULL WT. HT. TO INCLUDE PARAPETS.
 - (3) 2x6 WOOD STUD POST, ATTACH TO SLAB W/ SIMPSON HD08-SDS3 W/ 7/8" THREADED ROD W/ 12" EMBED W/ MULTI BE 500V3 INDICATES AREA OF DEPRESSIONED SLAB, SEE ARCH. FOR EXTENTS.


7 5/8" OR 11 5/8" CMU FIRE WALL SEE PLAN FOR REINF.

- 8" CMU W/ (1) #5 IN EACH OF 1ST CELL [(1) #5 TOTAL]
GROUTED SOLID AT ENDS OF WALLS, CORNERS, TEES, E.E. OF WALL CONTROL JOINTS & E.S. OF OPENINGS. REINF. CELL SHALL BE FULL HEIGHT OF WALL. IN ADDITION ADD #5 IN GROUTED CELLS @ 48" O.C. MAX BETWEEN, TYP. U.N.O. GROUT ALL WALLS W/ VERTICAL REINF. SOLID.
- 12" CMU W/ (2) #6 IN EACH OF 1ST CELL [(2) #6 TOTAL]
GROUTED SOLID AT ENDS OF WALLS, CORNERS, TEES, E.E. OF WALL CONTROL JOINTS, ABOVE & BELOW ALL OPENINGS & E.S. OF OPENINGS. REINF. CELL SHALL BE FULL HEIGHT OF WALL. IN ADDITION ADD (2) #6 IN GROUTED CELLS @ 40" O.C. MAX BETWEEN, TYP. U.N.O. GROUT ALL WALLS W/ VERTICAL REINF. SOLID.
- 2x6 #2 SYP. WOOD STUD WALL W/ STUDS @ 16" O.C. MAX. EA. SIDE OF STUDS PROVIDE 3/8" DRYWALL AND ATTACH W/ 5d COOLER NAILS @ 12" O.C. ALONG PANEL EDGES & INTERMEDIATE MEMBERS, SEE ARCH. FOR GYPBOARD REQ'S.
- 8" CMU W/ (1) #7 IN EACH OF 1ST CELL [(1) #7 TOTAL]
GROUTED SOLID AT ENDS OF WALLS, CORNERS, TEES, E.E. OF WALL CONTROL JOINTS & E.S. OF OPENINGS. REINF. CELL SHALL BE FULL HEIGHT OF WALL. IN ADDITION ADD #7 IN GROUTED CELLS @ 24" O.C. MAX BETWEEN, TYP. U.N.O. GROUT ALL WALLS W/ VERTICAL REINF. SOLID.
- 12" CMU W/ (1) #7 IN EACH OF 1ST CELL [(1) #7 TOTAL]
GROUTED SOLID AT ENDS OF WALLS, CORNERS, TEES, E.E. OF WALL CONTROL JOINTS, ABOVE & BELOW ALL OPENINGS & E.S. OF OPENINGS. REINF. CELL SHALL BE FULL HEIGHT OF WALL. IN ADDITION ADD (1) #7 IN GROUTED CELLS @ 24" O.C. MAX BETWEEN, TYP. U.N.O. GROUT ALL WALLS W/ VERTICAL REINF. SOLID.
- 8" CMU W/ (1) #6 IN EACH OF 1ST CELL [(1) #6 TOTAL]
GROUTED SOLID AT ENDS OF WALLS, CORNERS, TEES, E.E. OF WALL CONTROL JOINTS & E.S. OF OPENINGS. REINF. CELL SHALL BE FULL HEIGHT OF WALL. IN ADDITION ADD #6 IN GROUTED CELLS @ 48" O.C. MAX BETWEEN, TYP. U.N.O. GROUT ALL WALLS W/ VERTICAL REINF. SOLID.

16HA047
HEES & ASSOCIATES, INC.
1381 Fifth Street, Sarasota, Florida 34236
Telephone: (941) 955-4555; Fax: (941) 955-9333
karl@heesassociates.com • www.heesassociates.com
C.O.A. #27043 © 2017 - Hees & Associates, Inc.
All rights reserved.

TO THE BEST OF THE ENGINEER-OF-RECORD'S
KNOWLEDGE AND ABILITY, THE COMPLETED STRUCTURE
DEPICTED ON THESE DOCUMENTS COMPLIES WITH THE
APPLICABLE MINIMUM BUILDING CODES.

NOTE:
DO NOT SCALE OFF OF THESE DRAWINGS. LAYOUT THE
BUILDING USING ALL APPLICABLE CONTRACT DRAWINGS,
BUILDING DIMENSIONS AND THE LOCATION OF ALL
STRUCTURAL ELEMENTS INCLUDING BUT NOT LIMITED TO
SLAB EDGES, WALLS, COLUMNS, OPENINGS AND
DEPRESSIONS SHALL BE COORDINATED WITH THE
ARCHITECTURAL DRAWINGS PRIOR TO LAYOUT OF THE
BUILDING. RESOLVE ANY DISCREPANCIES.

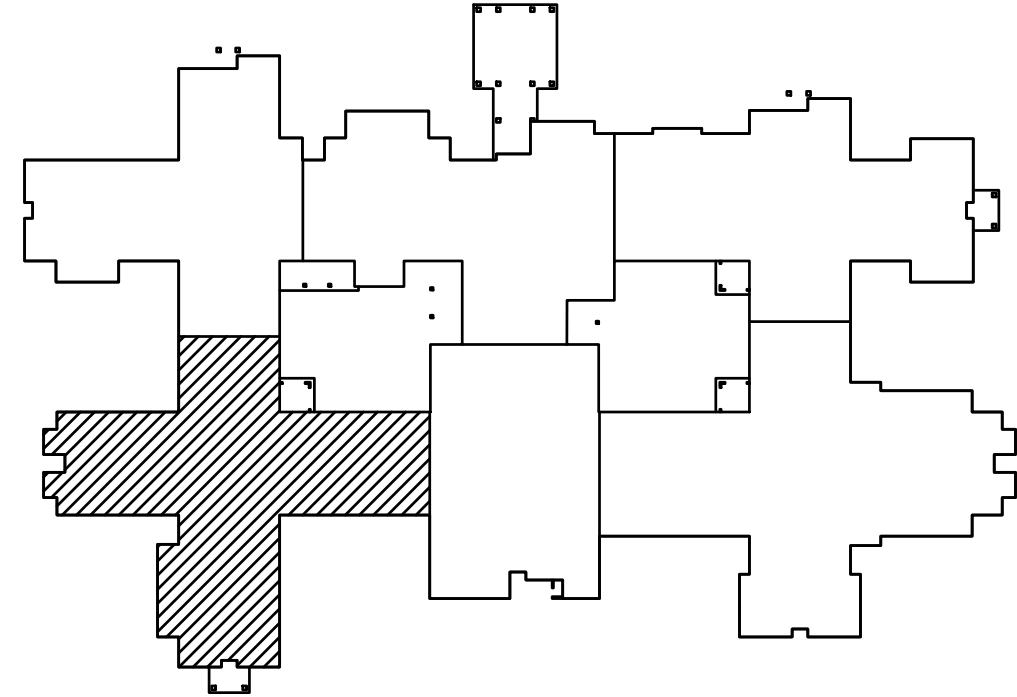

KEYPLAN