
GABLE END GYPSUM DIAPHRAGM HOLDOWN CONNECTOR


SCALE: NONE

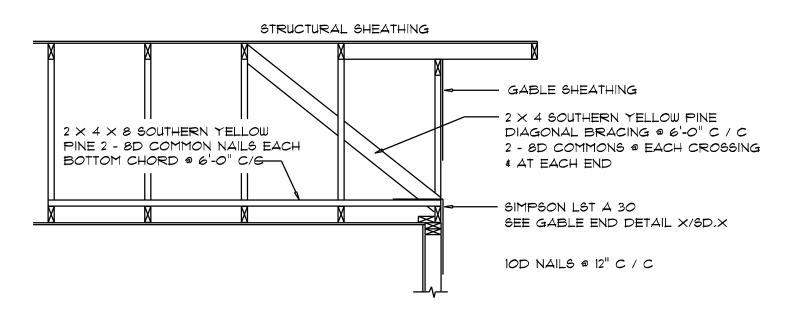


END WALL BRACING FOR CEILING DIAPHRAGM

(ALTERNATIVE TO BALLOON FRAMING)

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

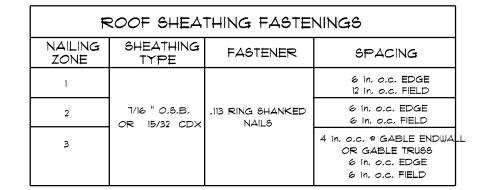

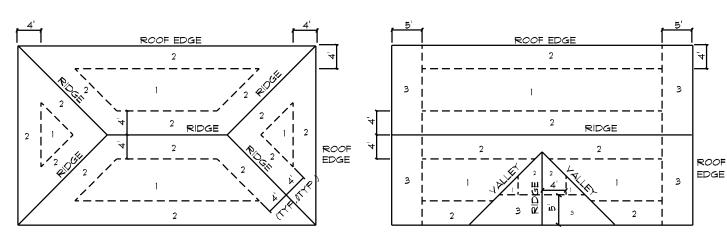


ROOF SHEATHING NAILING ZONES (HIP ROOF)


ROOF SHEATHING NAILING ZONES (GABLE ROOF)

Roof Nail Pattern DET.




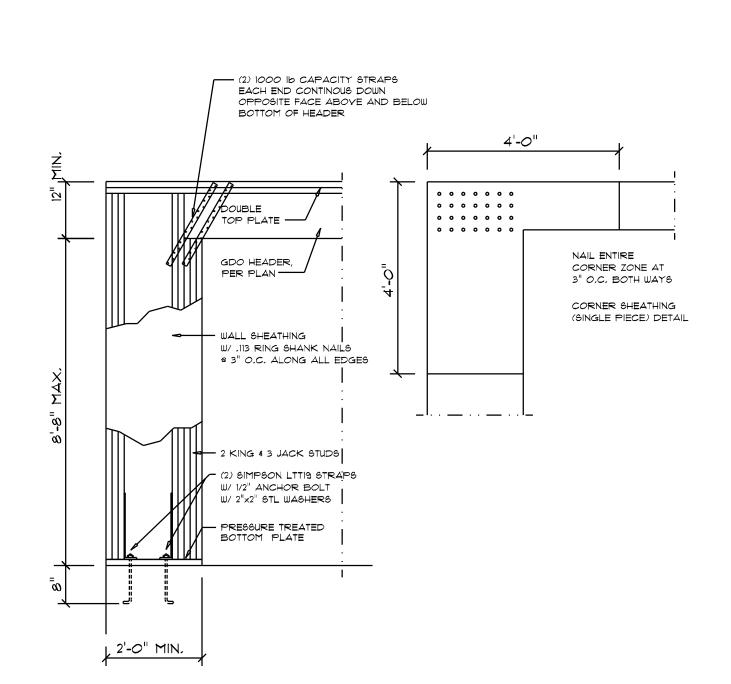




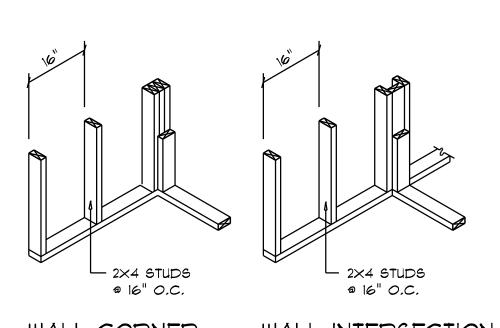




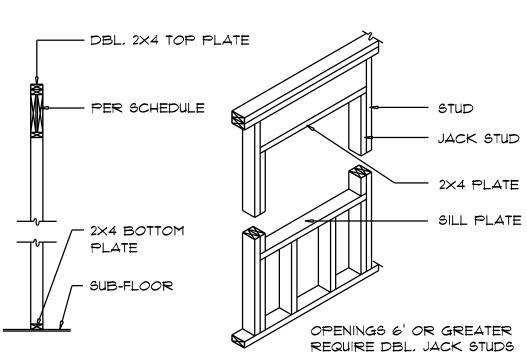

TYPICAL WINDOW HEADER

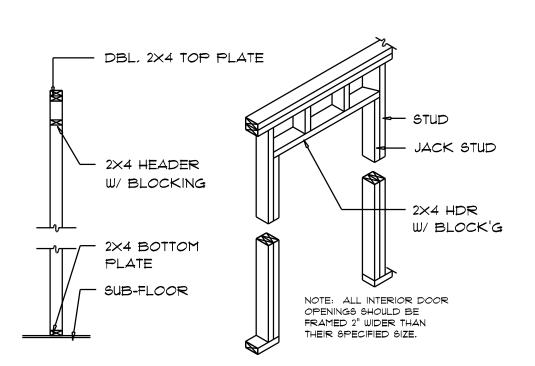


NON-BEARING WALL HEADER

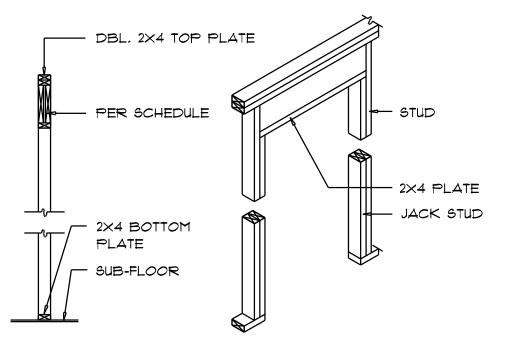


BEARING WALL HEADER



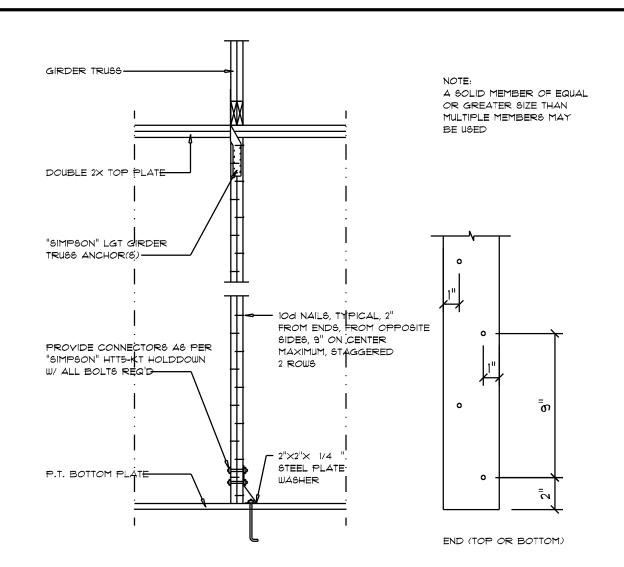

Girder Truss Column DET.


SCALE: 1/2" = 1'-0"

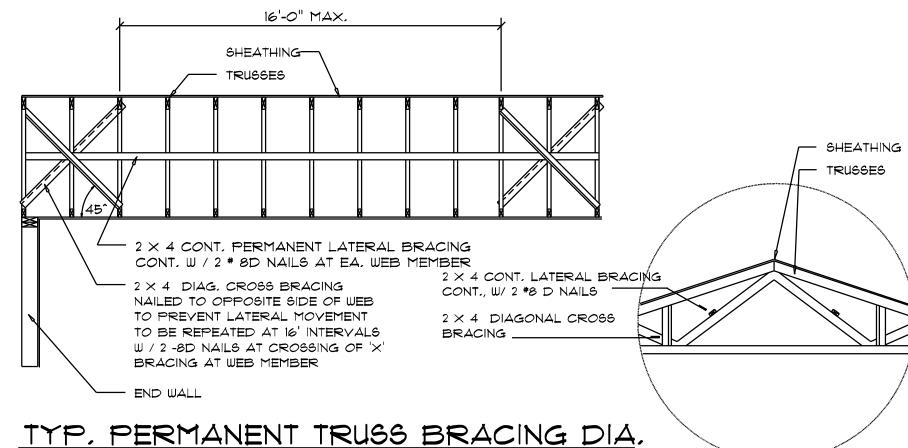

NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

Truss Bracing DETAILS

SCALE: AS NOTED

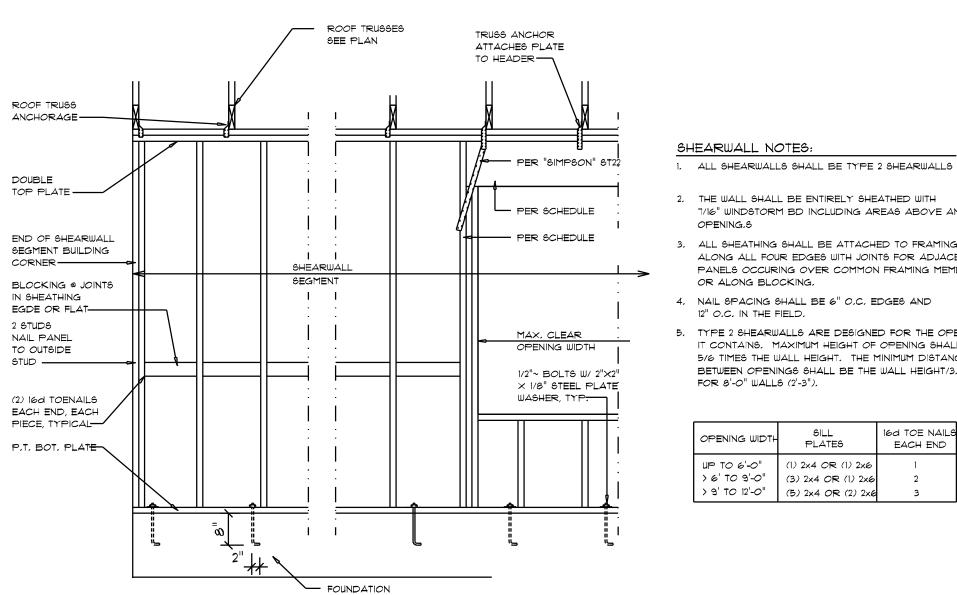


SHEARWALL NOTES:

- 2. THE WALL SHALL BE ENTIRELY SHEATHED WITH 1/16" WINDSTORM BD INCLUDING AREAS ABOVE AND BELOW
- 3. ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING.
- 4. NAIL SPACING SHALL BE 6" O.C. EDGES AND 12" O.C. IN THE FIELD.
- 5. TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS, MAXIMUM HEIGHT OF OPENING SHALL BE 5/6 TIMES THE WALL HEIGHT, THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 FOR 8'-0" WALLS (2'-3"),

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
> 6' TO 9'-0"	(3) 2x4 OR (1) 2x6	2
> 9' TO 12'-0"	(5) 2x4 OR (2) 2x6	3

Shear Wall DETAILS

SCALE: NONE

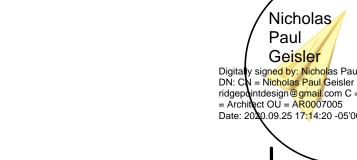

sidence

Re Jeffcoat

Fry Ave, Fort White, FL 3

SHEET NUMBER OF 4 SHEETS

Digitally signed by: Nicholas Paul Geisler DN: CN = Nicholas Paul Geisler email = ridgep dintdesign @ gmail.com C = US O = Architect OU = AR0007005 Date: 2020.09.25 17:14:20 -05'00'