



THE HOME DEPOT #6864 - 215 SW HOME DEPOT DR, LAKE CITY, FL 32025 - SITE PLAN

THIS DRAWING IS FOR CONCEPTUAL PURPOSES ONLY. DUE TO CONSTRUCTION CONSTRAINTS, SIZES AND OR LAYOUTS MAY CHANGE SLIGHTLY.

**ID. ASSOCIATES**  
BRINGING THE WORLD'S BRANDS TO LIFE  
1771 INDUSTRIAL ROAD • DOTHAN, ALABAMA • 36303  
PH (888) 303-5534 • FAX (334) 836-1401  
www.idassociatesinc.com

CLIENT: **THE HOME DEPOT**  
LOCATION: **LAKE CITY, FL** 215 SW HOME DEPOT DR  
LAKE CITY, FL 32025  
ACCOUNT REP: **R. BOUTWELL**  
DRAWING NO: **THE HOME DEPOT-LAKE CITY, FL #6864-TRC**  
DATE: **11/22/22**  
DRAWN BY: **PNS**


STORE NO. <b>6864</b>	REV. 1	REV. 2	REV. 3	REV. 4
	REV. 1	REV. 2	REV. 3	REV. 4
	REV. 1	REV. 2	REV. 3	REV. 4
	REV. 1	REV. 2	REV. 3	REV. 4



EXHIBIT APPROVED BY:

This document has been digitally signed and sealed by Christian Langley, PE on the date noted in this digital signature. Printed copies of this document are not considered signed & sealed, & the signature must be verified on any electronic copies.  
Serial: 44 49 8F 53 22 18 30 0D 22 90 96 67



Digitally signed by  
**Christian Langley**  
Date: 2023.06.16  
13:30:21 -04'00'

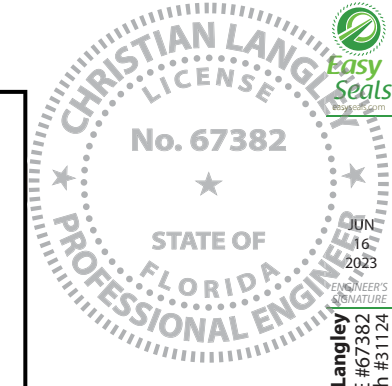



ASCE 7-16 • V=130 mph • Risk Category 2 Struct. • Sign Height = 30 ft max • Wall components & cladding:  
WIND LOADS: • Exposure 'C' • ASD Load Coeff = 0.6 • Zone 4: ± 23.8 psf • Zone 5: ± 30.3 psf

**General** • Design is in accordance with the requirements of the Fla Bldg Code 7th Ed (2020) for use within & outside the High Velocity Hurricane Zone (HVHZ). • This engineering certifies only the structural integrity of those systems, components, and/or other construction explicitly specified herein. • Electrical notes, details, & specifications are provided by and are the sole responsibility of the electrical contractor. No electrical review has been performed and no certification of such is intended. • Structural design meets requirements of ACI 318-14, AISI 360-16, ADM1-15, & NDS-18, as applicable. • Steel components shall be coated, painted, or otherwise protected against corrosion per FBC Sec 2203.2/2222.6. • Alum components in contact with steel or embedded in concrete shall be painted or protected as prescribed in ADM1-15(1a), or plastic/neoprene spacers provided. • All exposed fasteners shall be S.S. or have a protective coating for corrosion protection. • All welding shall comply with AWS requirements. • Steel welds: E70xx electrodes. • Aluminum welds: 4043 filler alloy. • Alum extrusions: 6063-T6 or stronger, U.N.C.

## NEW TRC SIGN & PLACARDS

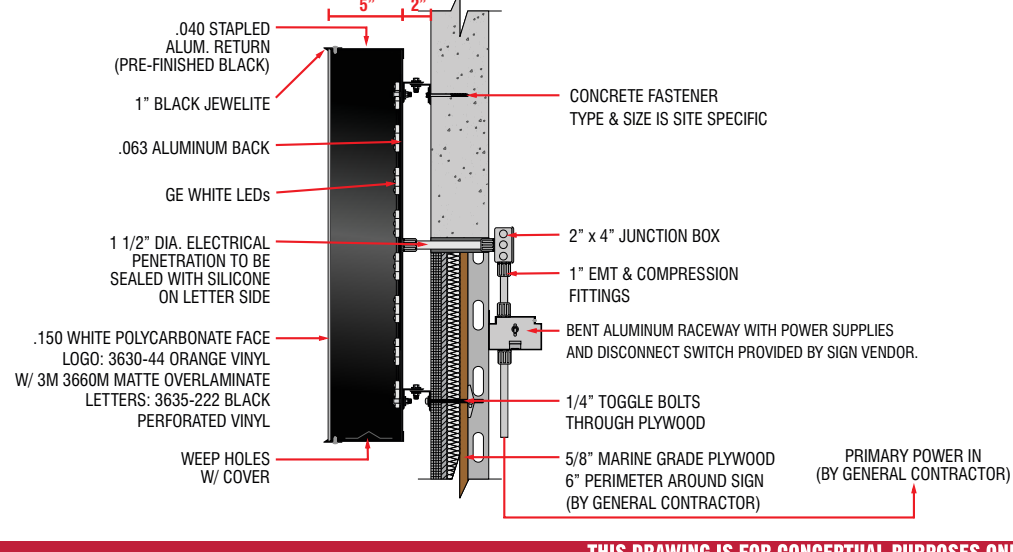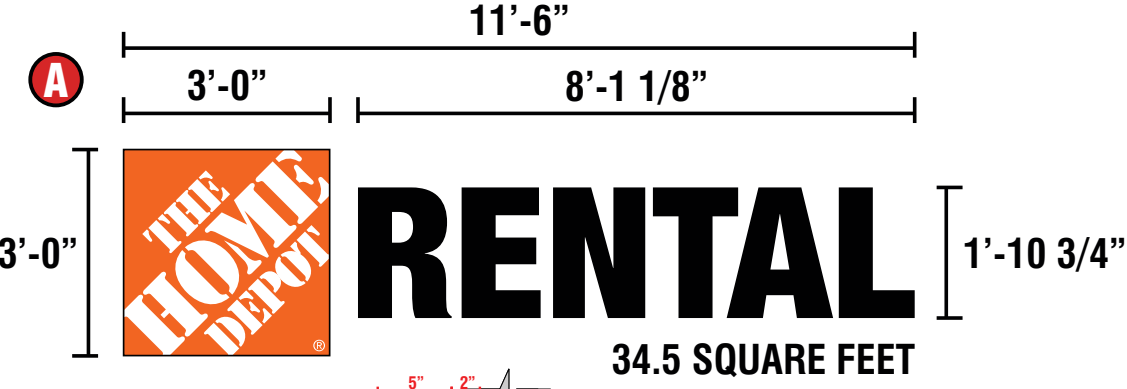

LOCATION OF DOOR TO BE DETERMINED

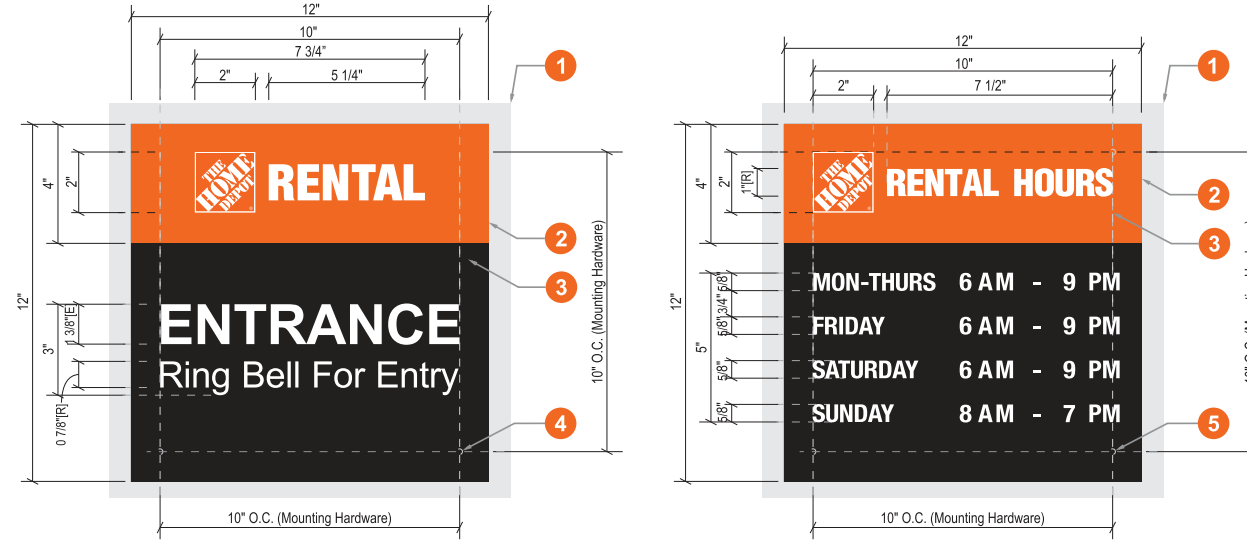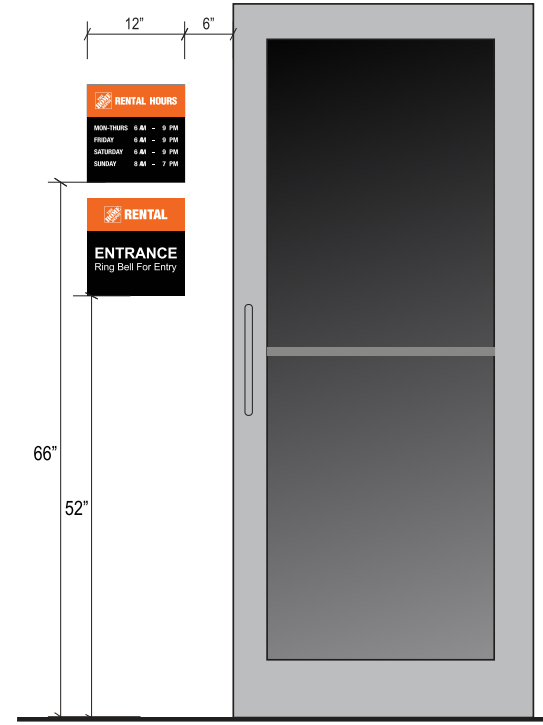

### Specifications:

1. Facade: Concrete / Metal
2. ACM Steel panel w/ applied digital print graphics including standard hours.
3. First surface applied digital printed graphics:
  - 3M-3630-44 Orange
  - 3M-7725-12 Black
 with applied 3M 3660m Matt Clear Overlay
4. Additional Hours / Numbers are magnetic.
5. Mounting Hardware: Stud mounted with 3/16" studs

THIS DRAWING IS FOR CONCEPTUAL PURPOSES ONLY. DUE TO CONSTRUCTION CONSTRAINTS, SIZES AND OR LAYOUTS MAY CHANGE SLIGHTLY.




CLIENT:	THE HOME DEPOT	STORE NO.:	6864
LOCATION:	LAKE CITY, FL	DATE:	11/22/22
ACCOUNT REP.:	R. BOUTWELL	DRAWN BY:	PNS
DRAWING NO.:	THE HOME DEPOT-LAKE CITY, FL #6864-TRC		

REV.	REV.	REV.	REV.
REV.	REV.	REV.	REV.
REV.	REV.	REV.	REV.
REV.	REV.	REV.	REV.




EXHIBIT APPROVED BY:

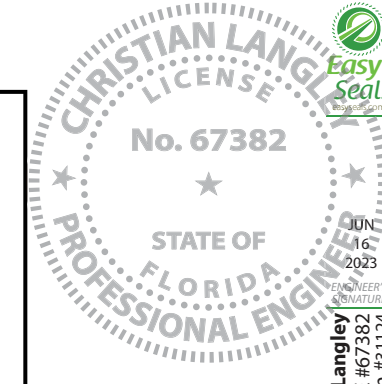

ASCE 7-16 • V=130 mph • Risk Category 2 Struct. • Sign Height = 30 ft max • Wall components & cladding: • Zone 4: ± 23.8 psf • Zone 5: ± 30.3 psf  
 WIND LOADS: • Exposure 'C' • ASD Load Coeff = 0.6 • Kzt=1.0, Kd=0.85, G=0.85


**General** • Design is in accordance with the requirements of the Fla Bldg Code 7th Ed (2020) for use within & outside the High Velocity Hurricane Zone (HVHZ). • This engineering certifies only the structural integrity of those systems, components, and/or other construction explicitly specified herein. • Electrical notes, details, & specifications are provided by and are the sole responsibility of the electrical contractor. No electrical review has been performed and no certification of such is intended. • Structural design meets requirements of ACI 318-14, AISC 360-16, ADM1-15, & NDS-18, as applicable. • Steel components shall be coated, painted, or otherwise protected against corrosion per FBC Sec 2203.2/2222.6. • Alum components in contact with steel or embedded in concrete shall be painted or protected as prescribed in ADM1-15(1a), or plastic/neoprene spacers provided. • All exposed fasteners shall be S.S. or have a protective coating for corrosion protection. • All welding shall comply with AWS requirements. • Steel welds: E70xx electrodes. • Aluminum welds: 4043 filler alloy. • Alum extrusions: 6063-T6 or stronger, U.N.C.



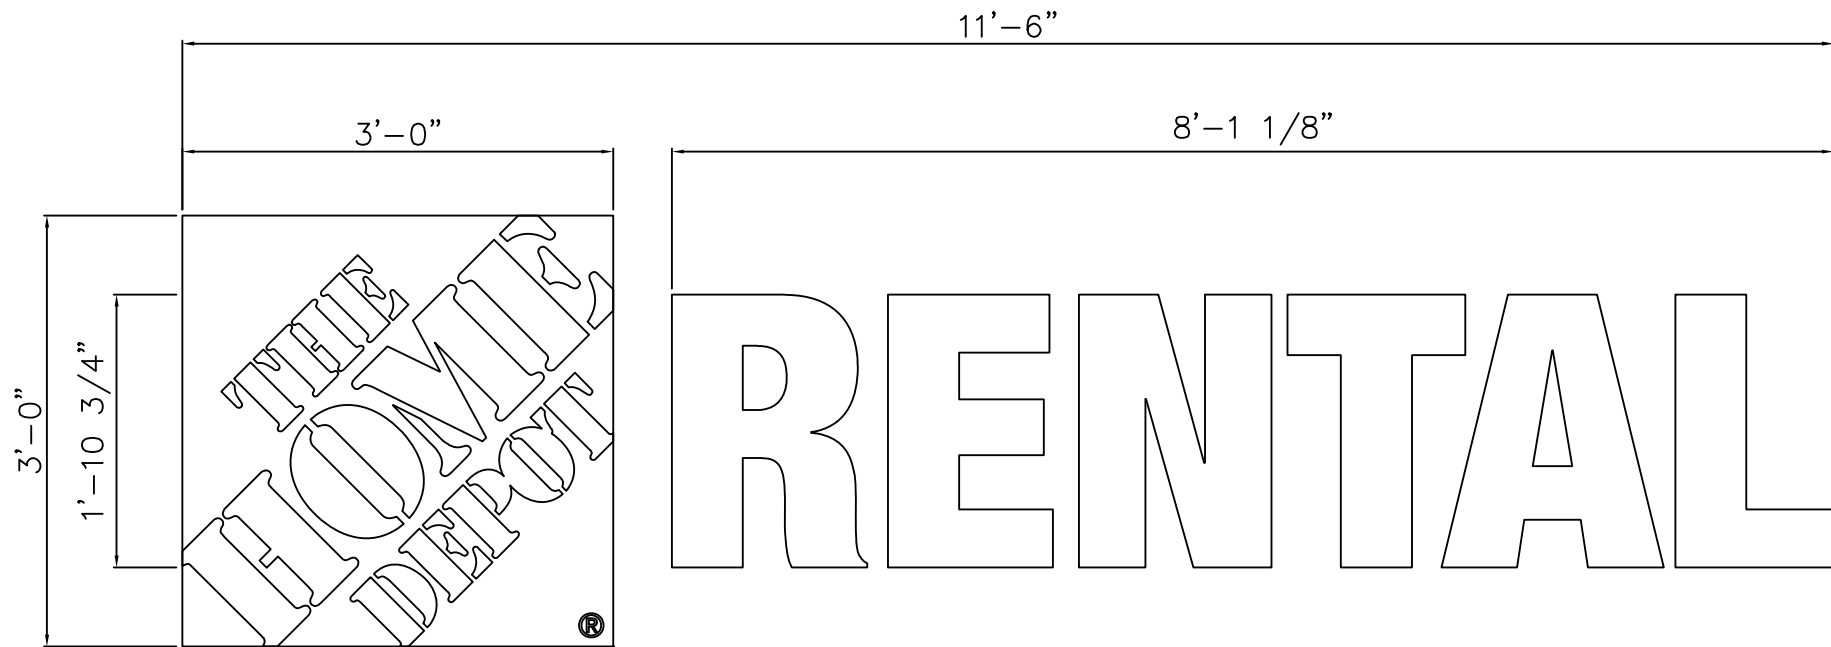


FRONT VIEW

BACK VIEW

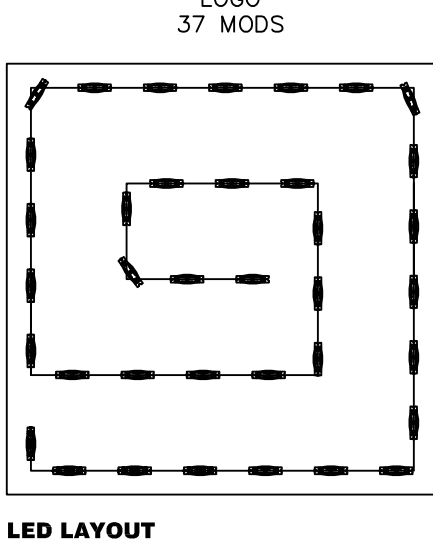


LED LAYOUT

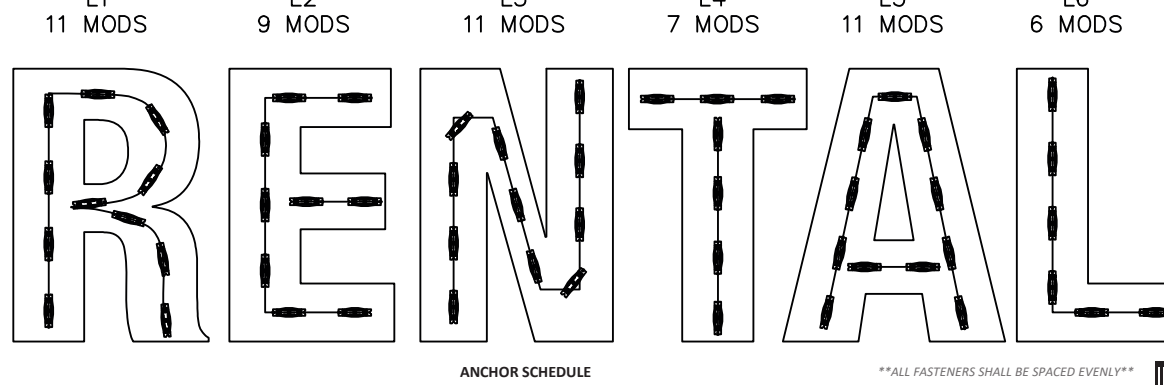

UL DISCONNECT SWITCH PER NEC 600.6- REQUIRED PER SIGN COMPONENT BEFORE LEAVING MANUFACTURER

ANCHOR SCHEDULE		**ALL FASTENERS SHALL BE SPACED EVENLY**	
WALL MATERIAL	ANCHOR TYPE	QTY or SPACING	
CONCRETE (3ksi) or HOLLOW MASONRY	1/4" THREADED RODS WITH MIN 2" EMBED IN ADHESIVE	--NOT APPLICABLE--	
	1/4" TAPCONS (OR EQUIV) WITH 1.75" EMBED	MIN (3) PER LETTER	
	1/4" EXPANSION ANCHORS WITH 2.5" EMBED	MIN (3) PER LETTER	
1/2" PLYWOOD (NO ACCESS BEHIND)	1/4" TOGGLE BOLTS	MIN (3) PER LETTER	
	1/4" WOOD SCREWS, FULL EMBED	MIN (3) PER LETTER	
METAL STUDS / PANELS	#14 METAL SCREWS TO MIN 18ga STEEL OR 0.090" ALUM	MIN (3) PER LETTER	
HOLLOW WALL + BLOCKING	1/4" THRU BOLTS OR LAGS TO SOLID BLOCKING BEHIND	MIN (3) PER LETTER	

AT LOGO, USE ANY ANCHOR OPTION SHOWN: MIN (4) TOTAL

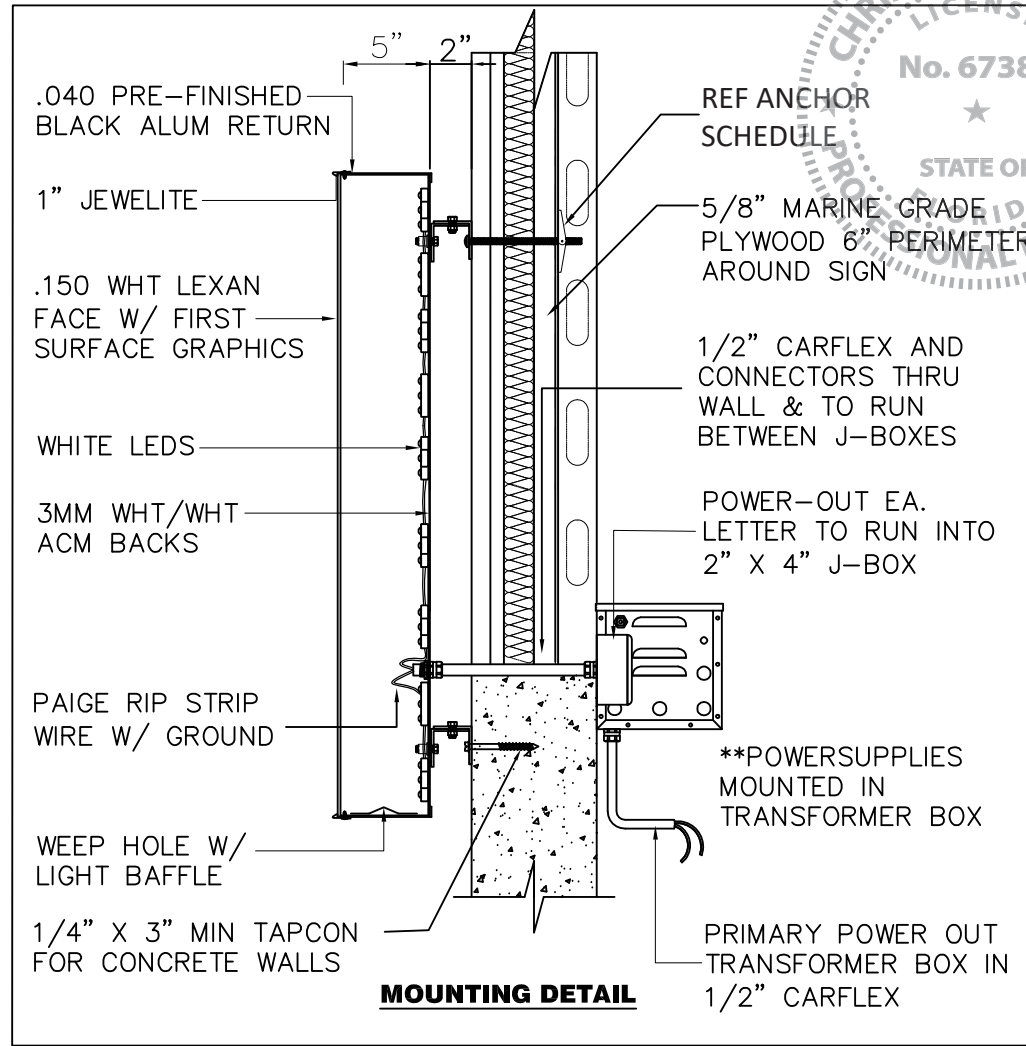

#### NOTES

3'-0" X 3'-0" X 5" DP. "THD" LOGO W/ 1'-10 3/4" X 8'-1 1/8" X 5" DP. CHANNEL LETTERS .040 ALUM RETURNS

3MM WHT/WHT ACM BACKS

FACES TO BE .150 WHITE LEXAN W/ FIRST SURFACE VINYL GRAPHICS REMOTE MOUNTED USING 2" CLIPS ON EA. LETTER & LOGO INTERNALLY ILLUMINATED USING WHITE LEDS

#### COLORS

RETURN/JEWELITE- PRE-FINISHED BLACK

LOGO FACE- 3M 3630-44 ORANGE VINYL W/ WEEDED OUT COPY LETTER FACE- 3M 3635-222 DUAL COLOR VINYL


#### ELECTRICAL

(92) TOTAL MODS OF GEMX71-W1 WHITE LEDS

(1) GEPS12-60U-NA POWER SUPPLIES

0.65 MAX AMPS

(1) 15 AMP DISCONNECT SWITCH ON TRANSFORMER BOX



CUSTOMER:

THE HOME DEPOT

LOCATION:

215 SW HOME DEPOT DR  
LAKE CITY, FL 32025

Date: 9/26/18	BY: RES	ACCOUNT MANAGER: HOLDERFIELD	ESTIMATED WEIGHT:
Revised: 3/4/21	BY: MRJ	SCALE: 3/4"=1'-0"	WIND LOAD:
POWER AT BOTTOM	BY: RES	APPROVED BY:	APPROVED DATE:
Revised: 8/20/21	BY: RES	ITEM NUMBER:	THD-36-RENTAL-CL
ADD SWITCH NOTE	BY:	Underwriters Laboratories Inc.	
Revised:	BY:		

**General** • Design is in accordance with the requirements of the **Fla Bldg Code 7th Ed (2020)** for use within & outside the High Velocity Hurricane Zone (HVHZ). • This engineering certifies only the structural integrity of those systems, components, and/or other construction explicitly specified herein. • Electrical notes, details, & specifications are provided by and are the sole responsibility of the electrical contractor. No electrical review has been performed and no certification of such is intended. • Structural design meets requirements of ACI 318-14, AISI 360-16, ADM1-15, & NDS-18, as applicable. • Steel components shall be coated, painted, or otherwise protected against corrosion per FBC Sec 2203.2/2222.6. • Alum components in contact with steel or embedded in concrete shall be painted or protected as prescribed in ADM1-15(1a), or plastic/neoprene spacers provided. • All exposed fasteners shall be S.S. or have a protective coating for corrosion protection. • All welding shall comply with AWS requirements. • Steel welds: E70xx electrodes. • Aluminum welds: 4043 filler alloy. • Alum extrusions: 6063-T6 or stronger, U.N.O.