

GENERAL NOTES:

1. TERMITE PROTECTION SHALL BE PROVIDED BY REGISTERED TERMITICIDES, INCLUDING SOIL APPLIED PESTICIDES, BAITING SYSTEMS, AND PESTICIDES APPLIED TO WOOD, OR OTHER APPROVED METHODS OF TERMITE PROTECTION LABELED FOR USE AS A PREVENTATIVE TREATMENT TO NEW CONSTRUCTION. SEE 2020 FLORIDA RESIDENTIAL CODE SECTION 202, "REGISTERED TERMITICIDE." UPON COMPLETION OF THE APPLICATION OF THE TERMITE PROTECTIVE TREATMENT, A CERTIFICATE OF COMPLIANCE SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY THAT CONTAINS THE FOLLOWING STATEMENT: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. TREATMENT IS IN ACCORDANCE WITH RULES AND LAWS ESTABLISHED BY THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES."
2. ALL WORK SHALL MEET APPLICABLE REQUIREMENTS OF THE 2020 FLORIDA BUILDING CODE, BUILDING, 7TH EDITION AND 2020 FLORIDA BUILDING CODE, RESIDENTIAL 7TH EDITION.
3. APPLIANCES SHALL BE ENERGY STAR LABELED - CLOTHES WASHERS, DISHWASHERS, REFRIGERATORS AND CLOTHES DRYERS. SUPPLY HOSES TO WATER USING FIXTURES AND APPLIANCES MUST BE ARMORED, PEX OR METAL (EXCEPT COPPER)
4. CONTRACTOR TO VERIFY ALL EXISTING CONDITIONS AND NOTIFY ARCHITECT OF ANY DISCREPANCIES WITH PLANS AND AS-BUILT CONDITIONS PRIOR TO PROCEEDING WITH THE WORK.
5. DO NOT SCALE DRAWINGS; DIMENSIONS GOVERN. LARGE SCALE DETAILS GOVERN OVER SMALL SCALE DETAILS. NOTIFY ARCHITECT WITH ANY DISCREPANCIES OVER DIMENSIONS.
6. ALL DIMENSIONS ARE TO THE FACE OF THE STUDS (ROUGH) UNLESS OTHERWISE NOTED.
7. THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL PERMITS, INSPECTION FEES, AND DEPOSITS REQUIRED FOR THE INSTALLATION OF ALL WORK. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO CALL FOR LOCAL INSPECTIONS AND OBTAIN APPROVAL FROM THE STATE FIRE MARSHAL IF REQUIRED.
8. ALL CONSTRUCTION WORK SHALL BE IN COMPLIANCE WITH ALL LOCAL CITY, COUNTY, STATE OF FLORIDA AND FEDERAL CODES. THE CONTRACTOR SHALL GIVE ALL NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES, REGULATIONS, AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY BEARING PERFORMANCE OF THE WORK.
9. VERIFY ROUGH OPENING SIZES WITH DOOR AND WINDOW MANUFACTURERS BEFORE CONSTRUCTION IS TO BEGIN.
10. SAFETY GLAZING SHALL BE PROVIDED AT HAZARDOUS LOCATIONS AS PER SECTION R308.4 OF THE FRC 2020.
11. COMBINATION SMOKE /CARBON MONOXIDE DETECTORS SHALL BE PROVIDED IN AND OUTSIDE ALL SLEEPING AREAS.
12. EACH SLEEPING ROOM MUST HAVE AT LEAST ONE OPERABLE WINDOW OR EXTERIOR DOOR APPROVED FOR EMERGENCY EGRESS OR RESCUE. UNIT MUST BE OPERABLE FROM INSIDE TO FULL CLEAR OPENING OF 5.7 SQUARE FEET, WITH SILL HEIGHT NO MORE THAN 44 INCHES ABOVE THE FLOOR, MINIMUM NET CLEAR OPENING HEIGHT OF 24 INCHES, AND MINIMUM NET CLEAR OPENING WIDTH OF 20 INCHES.
13. EXTERIOR WALLS WITH A FIRE SEPARATION DISTANCE LESS THAN 3'-0" FEET SHALL HAVE 1 HOUR PROTECTION OF 5/8" GYP BOARD AT BOTH SIDES OF THE WALL.
14. OVERHANG PROJECTIONS WITH A FIRE SEPARATION DISTANCE LESS THAN 3'-0" (FEET) SHALL BE PROVIDED WITH 5/8" GYP. BOARD UNDERSIDE FOR 1-HOUR PROTECTION.
15. ALL "GLASS OPENINGS" SHALL BE IMPACT RESISTANT GLAZING (COMPLY WITH REQUIREMENTS OF THE LARGE MISSILE TEST OF ASTM 1996 AND OF ASTM 1886 FASTENED IN ACCORDANCE WITH TABLE R301.2.1.2 OF FRC 2020.
16. THE CONTRACTOR SHALL PROVIDE ALL NECESSARY SAFETY APPARATUS REQUIRED TO ENSURE THE HEALTH AND WELFARE OF THE GENERAL PUBLIC, THE OWNERS, AND ANY WORKERS.
17. THE CONTRACTOR SHALL HAVE THE WORK SITE CLEANED ON A DAILY BASIS. THE DISPOSAL OF ANY WASTE SHALL BE OFF SITE AND IN A MANNER PRESCRIBED UNDER THE LAW.
18. CONTRACT DRAWINGS AND SPECIFICATIONS REPRESENT FINISHED STRUCTURE. THEY DO NOT INDICATE METHOD OF CONSTRUCTION. THE CONTRACTOR SHALL PROVIDE ALL MEASURES NECESSARY TO PROTECT STRUCTURE AND PERSONNEL DURING CONSTRUCTION. SUCH MEASURES SHALL INCLUDE BUT NOT BE LIMITED TO BRACING, SHORING OF LOADS DUE TO CONSTRUCTION EQUIPMENT, EXCAVATION PROTECTIONS, SCAFFOLDING, JOB SITE SAFETY, ETC. OBSERVATION VISITS TO THE SITE BY ARCHITECT, OWNER, OR ENGINEER SHALL NOT INCLUDE INSPECTIONS OF ABOVE ITEMS.
19. IT IS RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE VARIOUS TRADES ON BUILDING TO ALLOW SUFFICIENT ROOM FOR ALL EQUIPMENT.
20. CONTRACTOR TO COORDINATE ALL UTILITIES INSTALLATION AND CONNECTION WITH LOCAL UTILITY COMPANY.
21. THE CONTRACTOR SHALL PROVIDE FOR POSITIVE DRAINAGE AROUND THE BUILDING INCLUDING ANY TEMPORARY MEASURES DURING THE CONSTRUCTION SO AS TO ENSURE NO WATER DAMAGE TO THE BUILDING.
22. ALL REMOVED TOPSOIL SHALL BE STORED AND USED FOR FINISH GRADING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REMOVAL OF ALL DEBRIS MATERIAL PRIOR TO FINISH GRADING.
23. CONTRACTOR SHALL COORDINATE & INSTALL WOOD BLOCKING IN FRAMING AS NEEDED TO SUPPORT ANY ITEMS MOUNTED TO THE WALLS.
24. ALL PENETRATIONS THROUGH FIRE RATED WALLS ARE TO BE SEALED WITH CODE APPROVED FIRESTOPPING MATERIAL.
25. THE CONTRACTOR SHALL VERIFY THE MIN. F.F. ELEV. WITH THE CITY/PARISH FEMA ELEVATION AND BENCHMARK CERTIFICATE.
26. ALL DRIVEWAY AND SIDEWALKS SHALL MEET LOCAL DEPARTMENT OF PUBLIC WORKS STANDARD DETAILS IF APPLICABLE.
27. CONTRACTOR SHALL PROVIDE COLOR SCHEMES FOR ALL CABINETS, COUNTERTOPS, FLOORING AND EXTERIOR MATERIALS IN A NEUTRAL COLOR PALETTE. ALL INTERIOR WALLS, CEILINGS AND TRIM MUST BE WHITE.
28. CONTRACTOR SHALL PROVIDE ALL PLUMBING FIXTURES, ELECTRICAL FIXTURES, DOOR HARDWARE, BATHROOM HARDWARE, AND BATHROOM ACCESSORIES IN A CONSISTENT MATERIAL FINISH.
29. CONTRACTOR SHALL PROVIDE CLEAN OUT LOCATIONS, TIE-IN LOCATIONS, AND WATER AND SEWER LINE LOCATIONS ON SITE TO PERMIT DEPARTMENT FOR REVIEW.

REBUILD FLORIDA

ID-014432 COKER 3 BR SOG

636 SE BAYA DR,
LAKE CITY, FL 32025

FOR CONSTRUCTION

PROJECT INFORMATION:

OCCUPANCY: SINGLE FAMILY RESIDENTIAL
BUILDING CODE: 2020 FLORIDA BUILDING CODE, BUILDING, 7TH EDITION
PERMIT TYPE: 2020 FLORIDA BUILDING CODE, RESIDENTIAL, 7TH EDITION
TYPE OF CONSTRUCTION: NEW CONSTRUCTION
TYPE V

ZONING INFORMATION:

NOTE: THIS LOT IS LOCATED IN TWO DIFFERENT ZONING DISTRICTS.

ZONING CLASSIFICATION: RSF-2 (RESIDENTIAL SINGLE FAMILY-2)
USE: DWELLING, SINGLE-FAMILY
MINIMUM LOT AREA: SINGLE FAMILY: 10,000 SF
MINIMUM LOT WIDTH: SINGLE FAMILY: 70'
MAX. BUILDING HEIGHT: SINGLE FAMILY: TBD
FRONT YD MIN. REQ: SINGLE FAMILY: 25'
INT SIDE YD REQ: SINGLE FAMILY: 10'
CORNER SIDE YD MIN. REQ: SINGLE FAMILY: 25'
REAR YD MIN. REQ: SINGLE FAMILY: 15'

ZONING CLASSIFICATION: RO (RESIDENTIAL OFFICE)
USE: DWELLING, SINGLE-FAMILY
MINIMUM LOT AREA: SINGLE FAMILY: 6,000 SF
MINIMUM LOT WIDTH: SINGLE FAMILY: 50'
MAX. BUILDING HEIGHT: SINGLE FAMILY: TBD
FRONT YD MIN. REQ: SINGLE FAMILY: 20'
INT SIDE YD REQ: SINGLE FAMILY: 10'
CORNER SIDE YD MIN. REQ: SINGLE FAMILY: 20'
REAR YD MIN. REQ: SINGLE FAMILY: 15'

FFE INFORMATION:

FLOOD ZONE: X
FEMA BASE FLOOD ELEVATION: N/A
HIGHEST ADJACENT GRADE: 187.97' NAVD88
CROWN OF THE ROAD: 187.47' NAVD88
PROPOSED FFE.: 188.97' NAVD88

BUILDING INFORMATION:


FIRST FLOOR: 1612 SF

FRONT PORCH: 193 SF
REAR PORCH: 121 SF


BUILDING HEIGHT: 13' 4"

CONDITIONED AREA VOLUME: 12,896 CF

INDEX OF DRAWINGS	
G-1	TITLE SHEET
C-1	SITE PLAN & DETAILS
A-1	ARCHITECTURAL PLANS
A-2	ELEVATIONS
A-3	REFLECTED CEILING PLAN AND INTERIOR ELEVATIONS
A-4	SCHEDULES AND NOTES
A-5	VINYL SIDING DETAILS FOR SLAB ON GRADE
E-1	ELECTRICAL PLAN
M-1	MECHANICAL
M-2	MECHANICAL
M-3	MECHANICAL
P-1	PLUMBING PLAN
S-1	STRUCTURAL NOTES
S-2	FOUNDATION PLANS & DETAILS
S-3	CEILING FRAMING PLANS & DETAILS
S-4	ROOF FRAMING PLANS & DETAILS

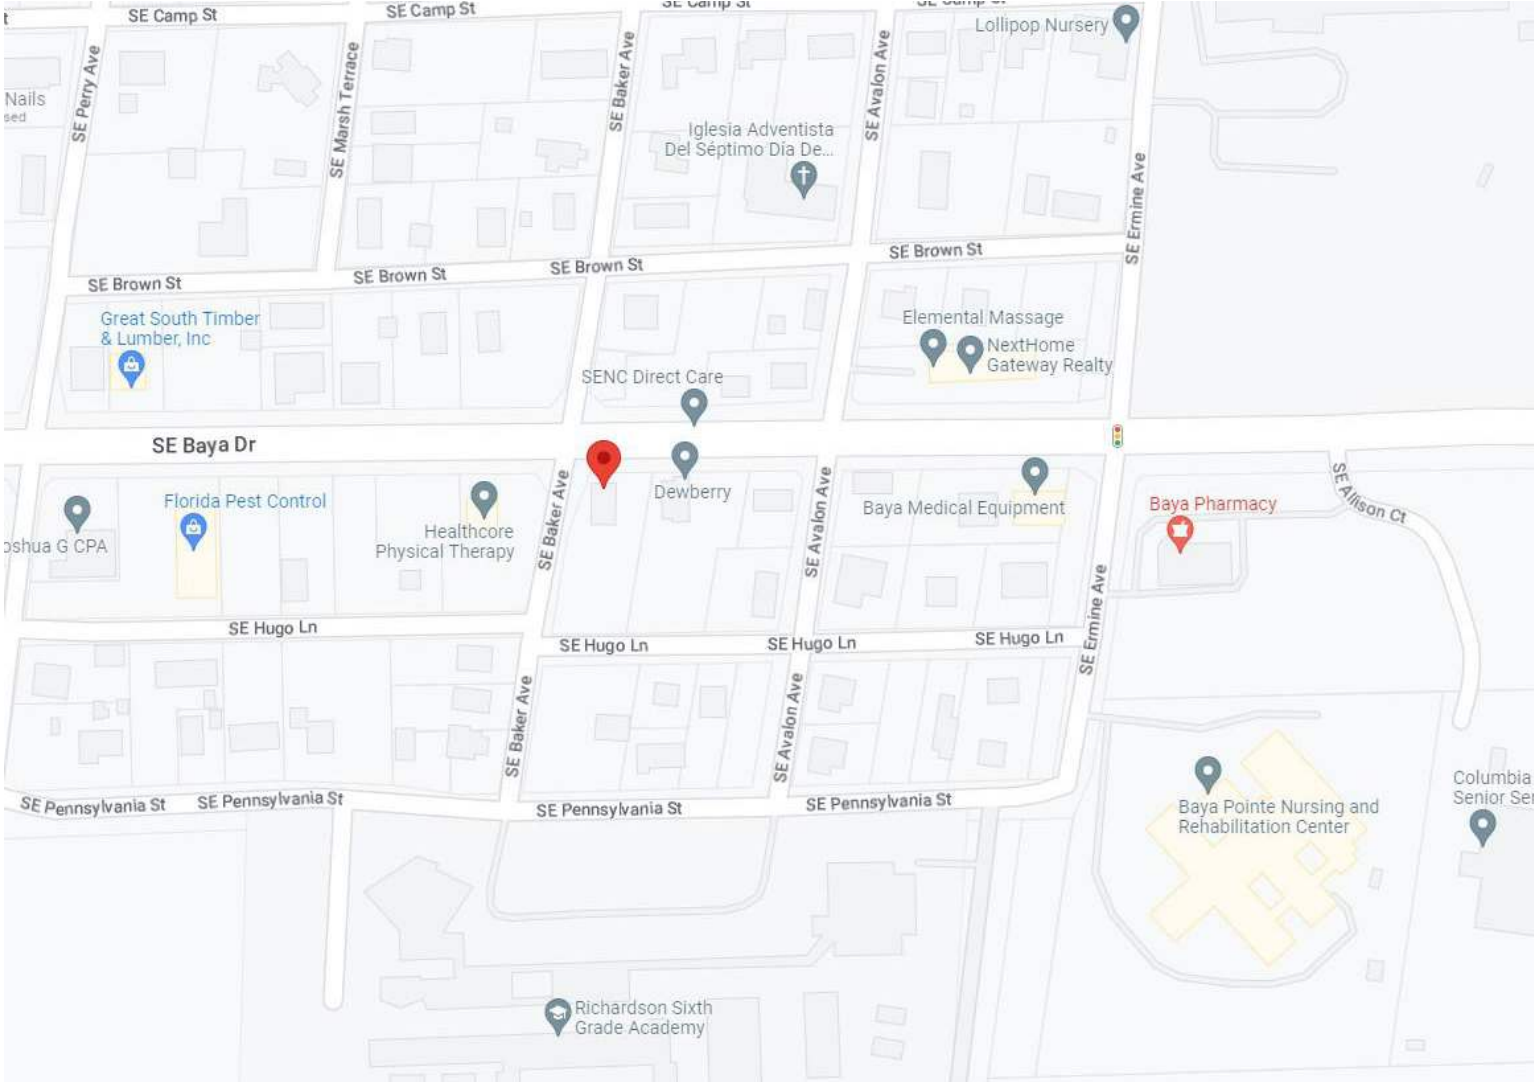

STREET MAP

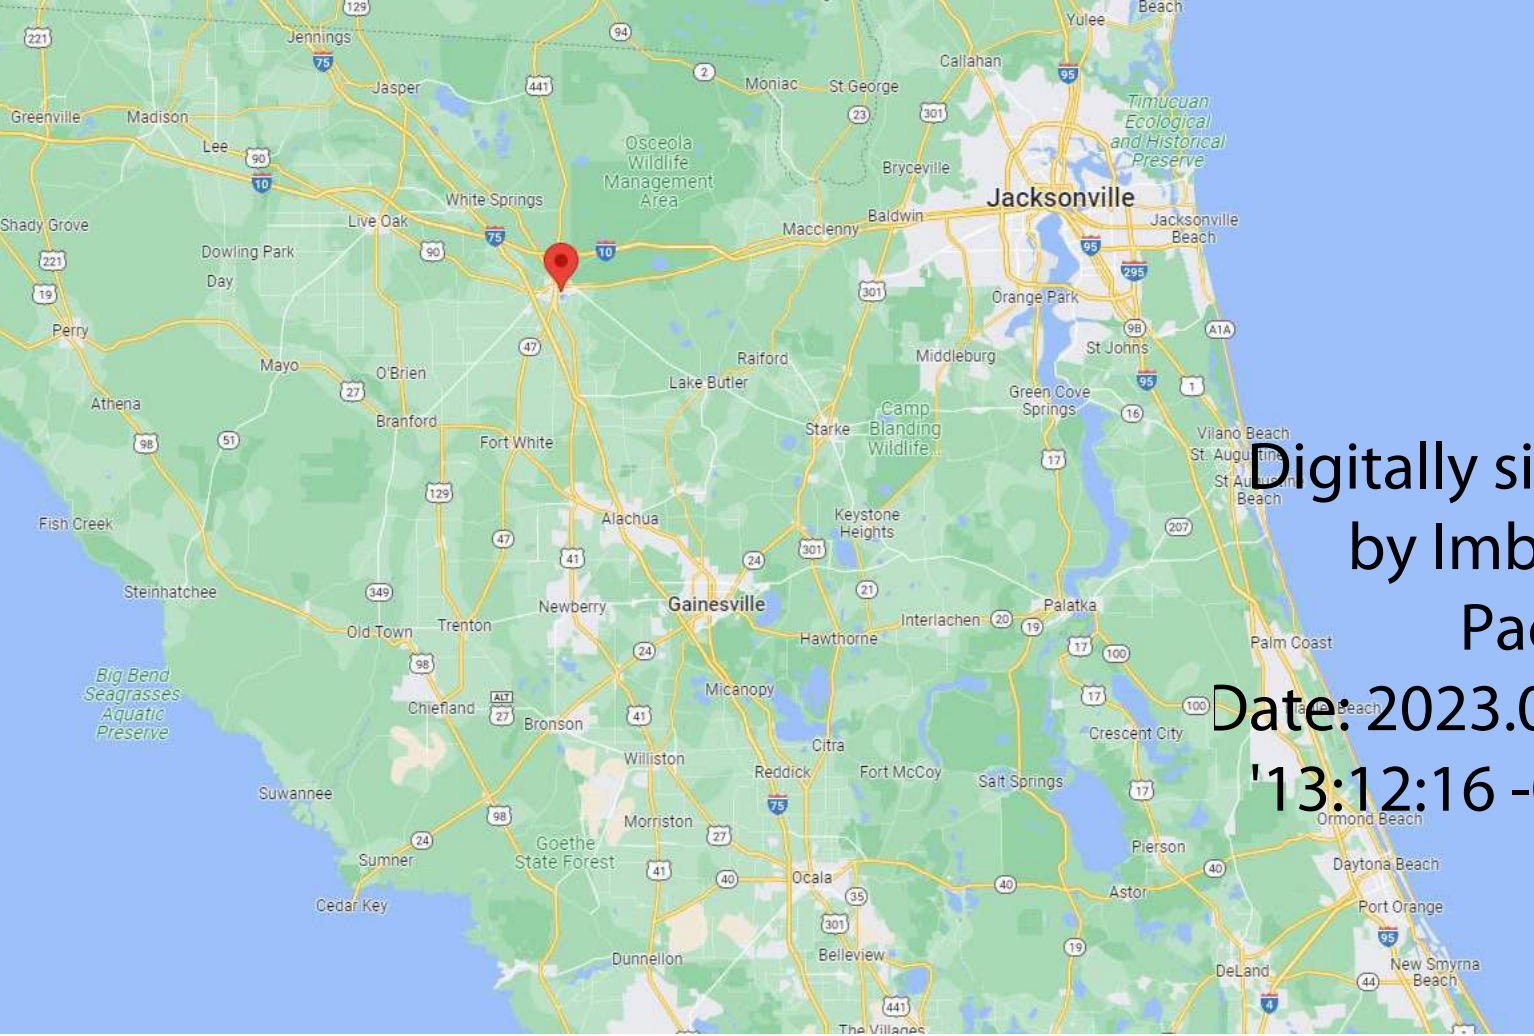

VICINITY MAP

Date	
Description	
No	

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYA DR,
LAKE CITY, FL 32025

TITLE SHEET


Project Number	2019-15
Date	04/11/2023
Drawn By	ZP
Checked By	IP

FOR CONSTRUCTION

Digitally signed
by Imbrie M
Packard
Date: 2023.04.12
'13:12:16 -05'00

This item has been
digitally signed and
sealed by Imbrie
Packard architect on
the date specified.

Printed copies of this
document are not
considered signed
and sealed and the
signature must be
verified on any
electronic copies.




G-1

SITE PLAN LEGEND

- ⊕ EL XX.XX EXISTING GRADE
- ⊕ EL XX.XX PROPOSED GRADE
- ⊕ MEX MATCH EXISTING GRADE
- FFE FINISH FLOOR ELEVATION
- LOW POINT OF SWALE
- SLOPE ARROW

FFE INFORMATION:

FLOOD ZONE: X
FEMA BASE FLOOD ELEVATION: N/A
HIGHEST ADJACENT GRADE: 187.97' NAVD88
CROWN OF THE ROAD: 187.47 NAVD88
PROPOSED FFE.: 188.97' NAVD88

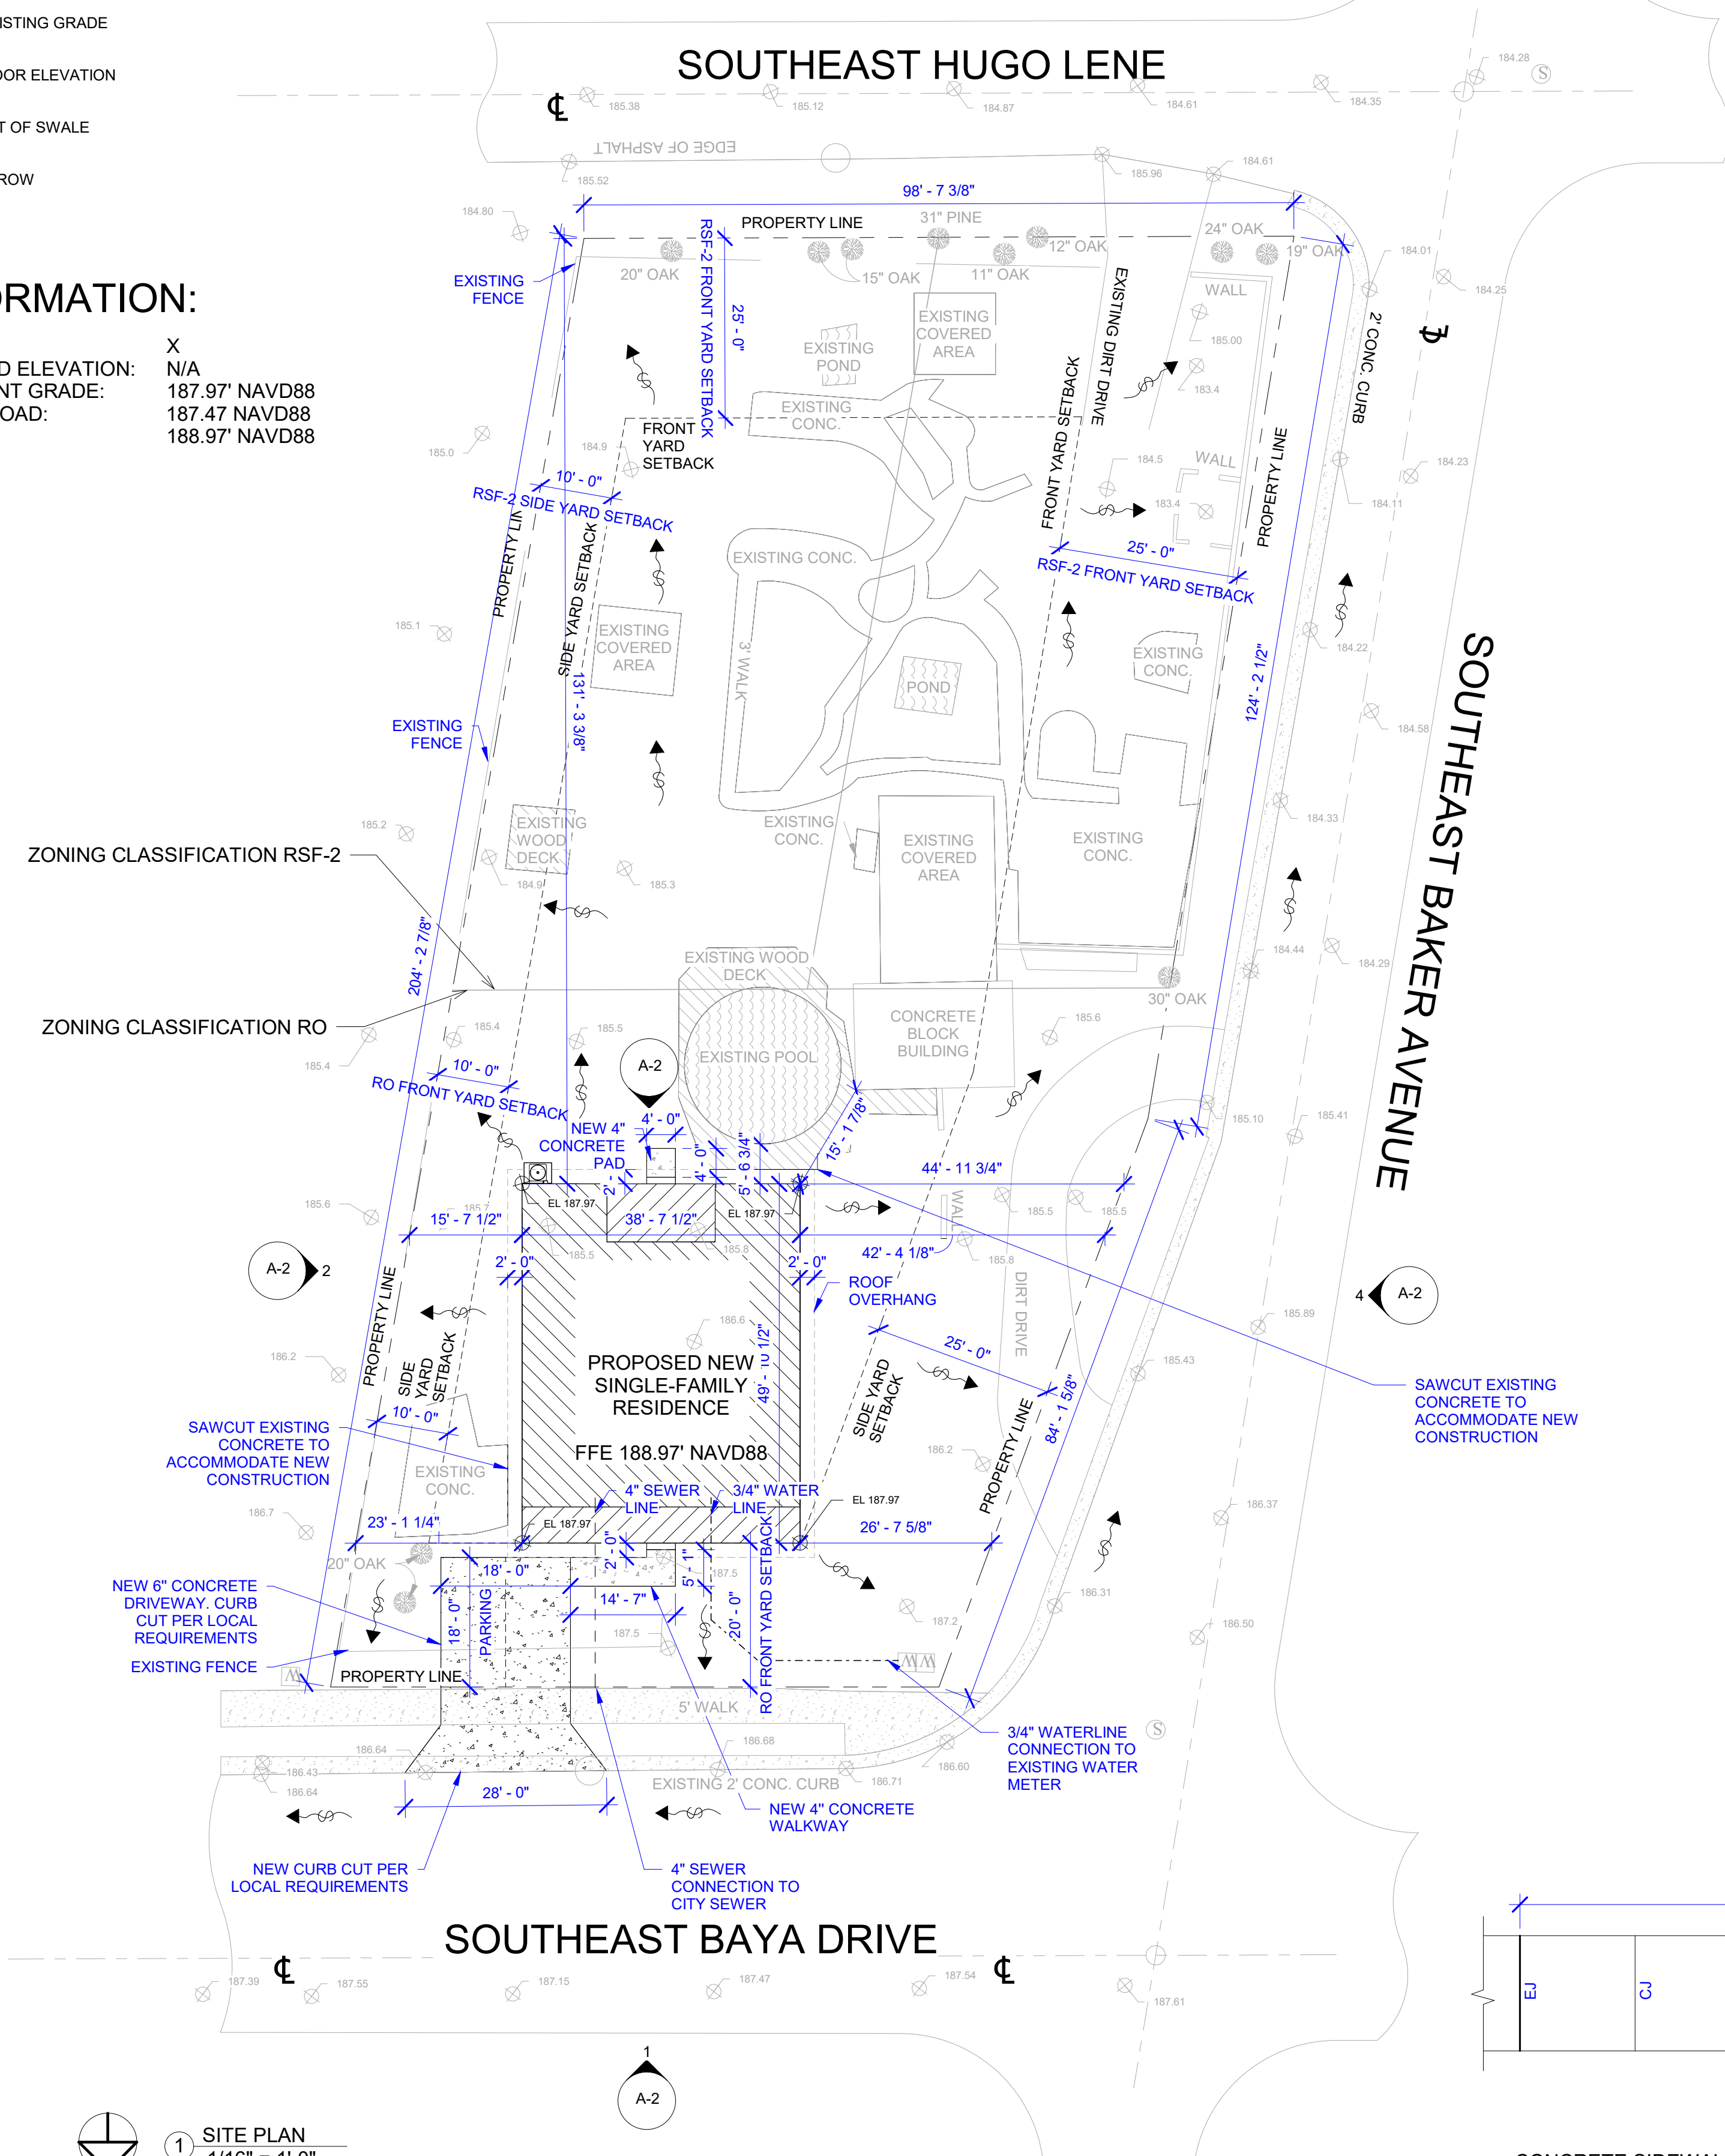



- GENERAL SITE PLAN NOTES:**
1. ALL PAVEMENT IN PUBLIC RIGHT OF WAY SHALL MEET THE DETAILS AND REQUIREMENTS OF THE LOCAL AUTHORITY HAVING JURISDICTION.
 2. ALL CURB CUTS AND DRIVEWAY APRONS SHALL MEET THE DETAILS AND REQUIREMENTS OF THE LOCAL AUTHORITY HAVING JURISDICTION.
 3. ALL SIDEWALKS WITHIN THE PROPERTY BOUNDARY TO BE 4" THICK, 4000 PSI W/ 6x6-W2.9xW2.9 WWF, AND SHALL RECEIVE BROOM FINISH 90 DEG. TO THE DIRECTION OF TRAVEL.
 4. ALL DRIVEWAYS WITHIN THE PROPERTY BOUNDARY TO BE 6" THICK, 4000 PSI W/ 6x6-W2.9xW2.9 WWF, AND SHALL RECEIVE BROOM FINISH 90 DEG. TO THE DIRECTION OF TRAVEL.
 5. SLOPE ALL FINAL GRADING AWAY FROM BUILDING TO ENSURE POSITIVE DRAINAGE. MAXIMUM SLOPE FOR LANDSCAPED AREAS IS 25%.
 6. SLOPE ALL CONCRETE PAVING AWAY FROM BUILDING AT 1% MINIMUM.
 7. SLOPE ALL CONCRETE WALKS AWAY FROM BUILDING AT 2% MINIMUM.
 8. LAY NEW SOD TO COVER ALL AREAS OF YARD DISTURBED BY CONSTRUCTION ACTIVITIES. SOD MUST BE BAHIA, ZOYSIA, OR BERMUDA, EXCEPT FOR MONROE COUNTY WHERE ALL DISTURBED AREAS SHALL BE LIMESTONE.
 9. SITE GRADING PLAN BASED ON AVAILABLE SURVEY DATA. EXISTING DRAINAGE PATTERNS TO BE CONFIRMED IN FIELD BY THE CONTRACTOR.
 10. CONTRACTOR SHALL REGRADE SITE IMMEDIATELY ADJACENT TO THE NEWLY CONSTRUCTED HOUSE TO PROVIDE POSITIVE DRAINAGE AWAY FROM THE FOUNDATION OF THE HOME.
 11. THE CONTRACTOR SHALL NOT ALTER SITE DRAINAGE PATTERNS IN A WAY THAT DIRECTS ADDITIONAL FLOWS ONTO ADJACENT PROPERTIES.
 12. UTILITY TIE-IN LOCATIONS ARE BASED ON LIMITED FIELD DATA. CONTRACTOR TO VERIFY SEWER AND WATER TIE-IN LOCATIONS IN FIELD AND NOTIFY ENGINEER OF ANY DISCREPANCY.

SITE INFORMATION:


SITE AREA: 19,407 SF

- NEW IMPERVIOUS AREA:**
- NEW HOME WITH 2' ROOF OVERHANG : 2,296 SF
 - EXISTING COVERED AREA : 676 SF
 - EXISTING CONCRETE : 1798 SF
 - EXISTING WOOD DECK : 402 SF
 - NEW CONCRETE : 414 SF
 - TOTAL: 5,586 SF


% NEW IMPERVIOUS AREA: 28.78 %
% NEW PERVIOUS AREA: 71.22 %

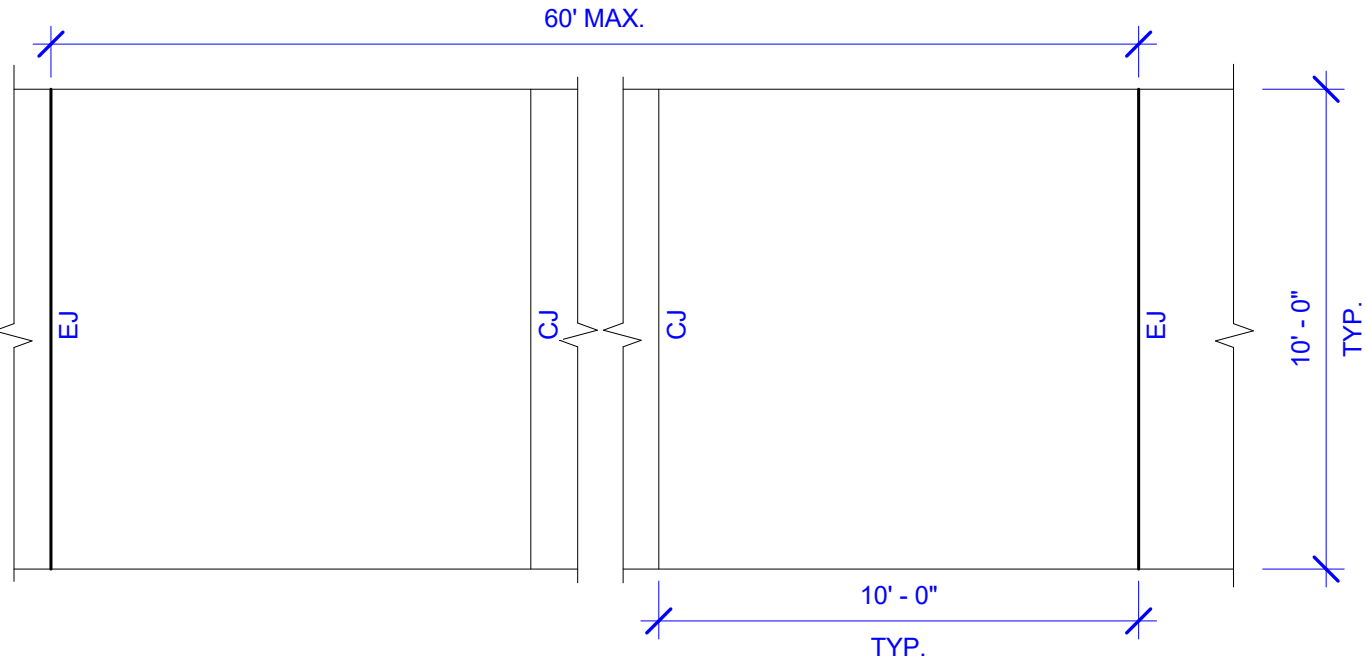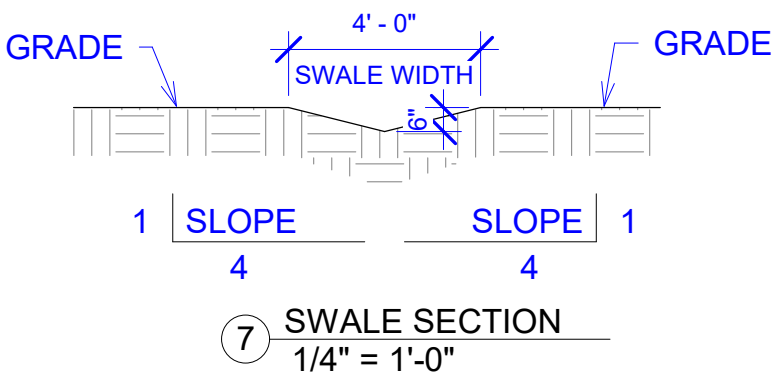


6 CONCRETE DRIVEWAY NOT TO SCALE

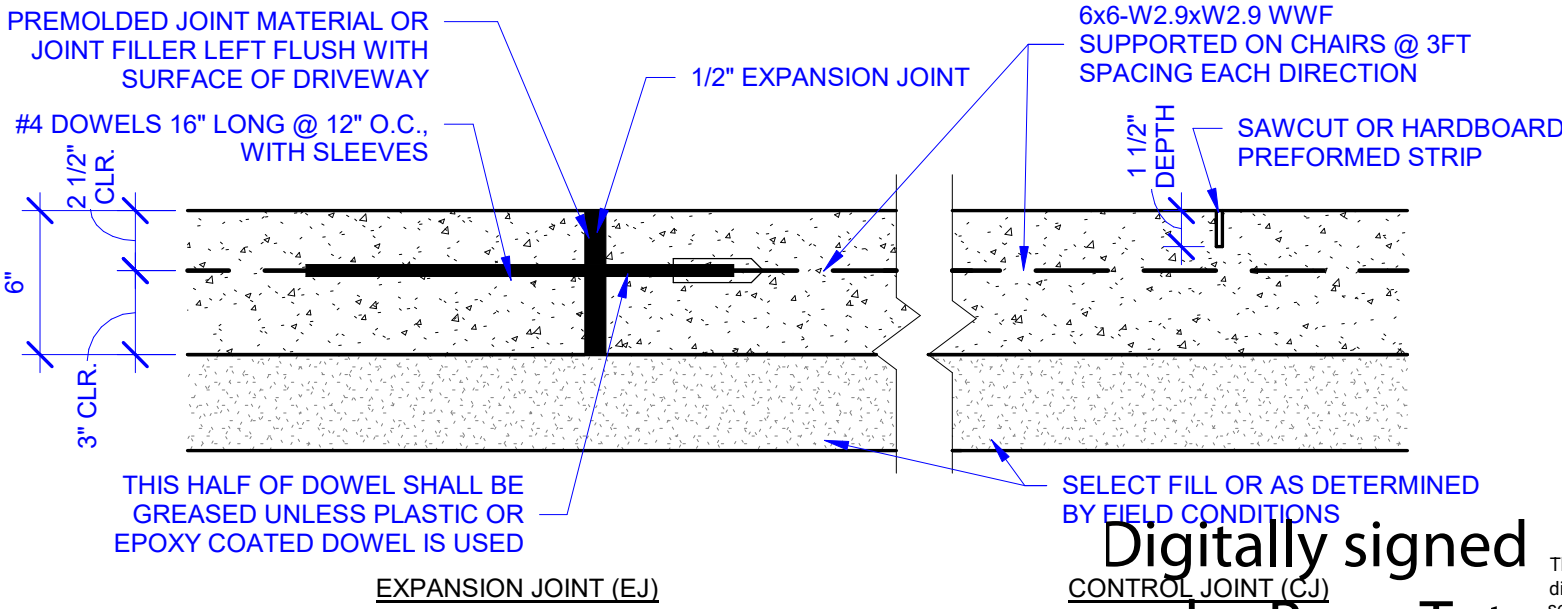

2 DRIVEWAY JOINT DETAILS NOT TO SCALE

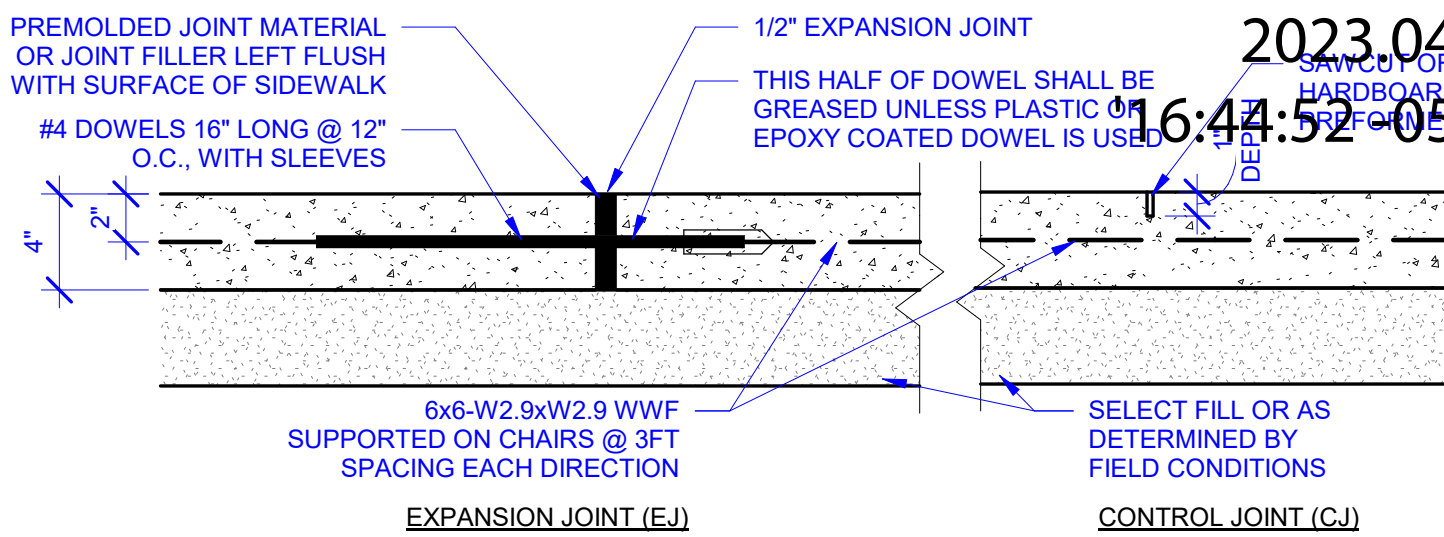

4 SIDEWALK JOINT DETAILS NOT TO SCALE

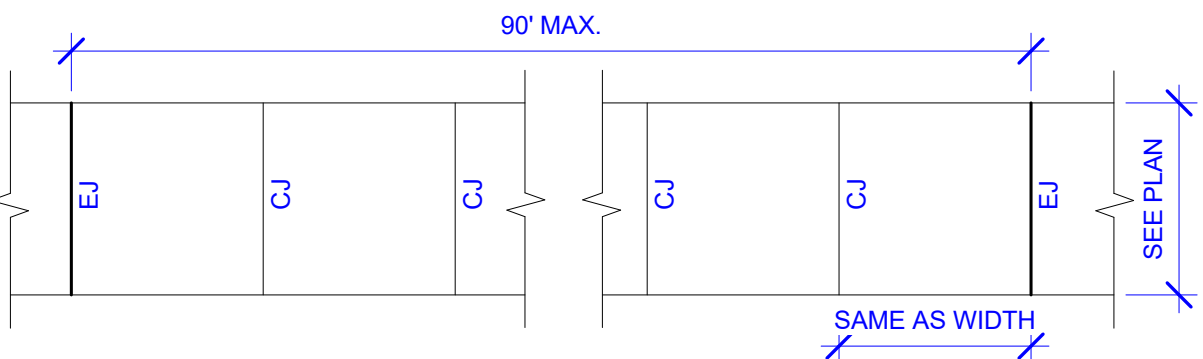

3 CONCRETE SIDEWALK NOT TO SCALE

No.	Description	Date

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG

REBUILD FLORIDA
636 SE BAYA DR.
LAKE CITY, FL 32025

SITE PLAN & DETAILS

Project Number	2019-15
Date	04/11/2023
Drawn By	ZP
Checked By	IP



FOR CONSTRUCTION

This item has been digitally signed and sealed by Beau Tate, P.E., on the date specified.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Beau Tate
No. 79080
STATE OF FLORIDA
PROFESSIONAL ENGINEER

Digitally signed
by Beau Tate
Date: 2023.04.12 16:44:52 -05'00'



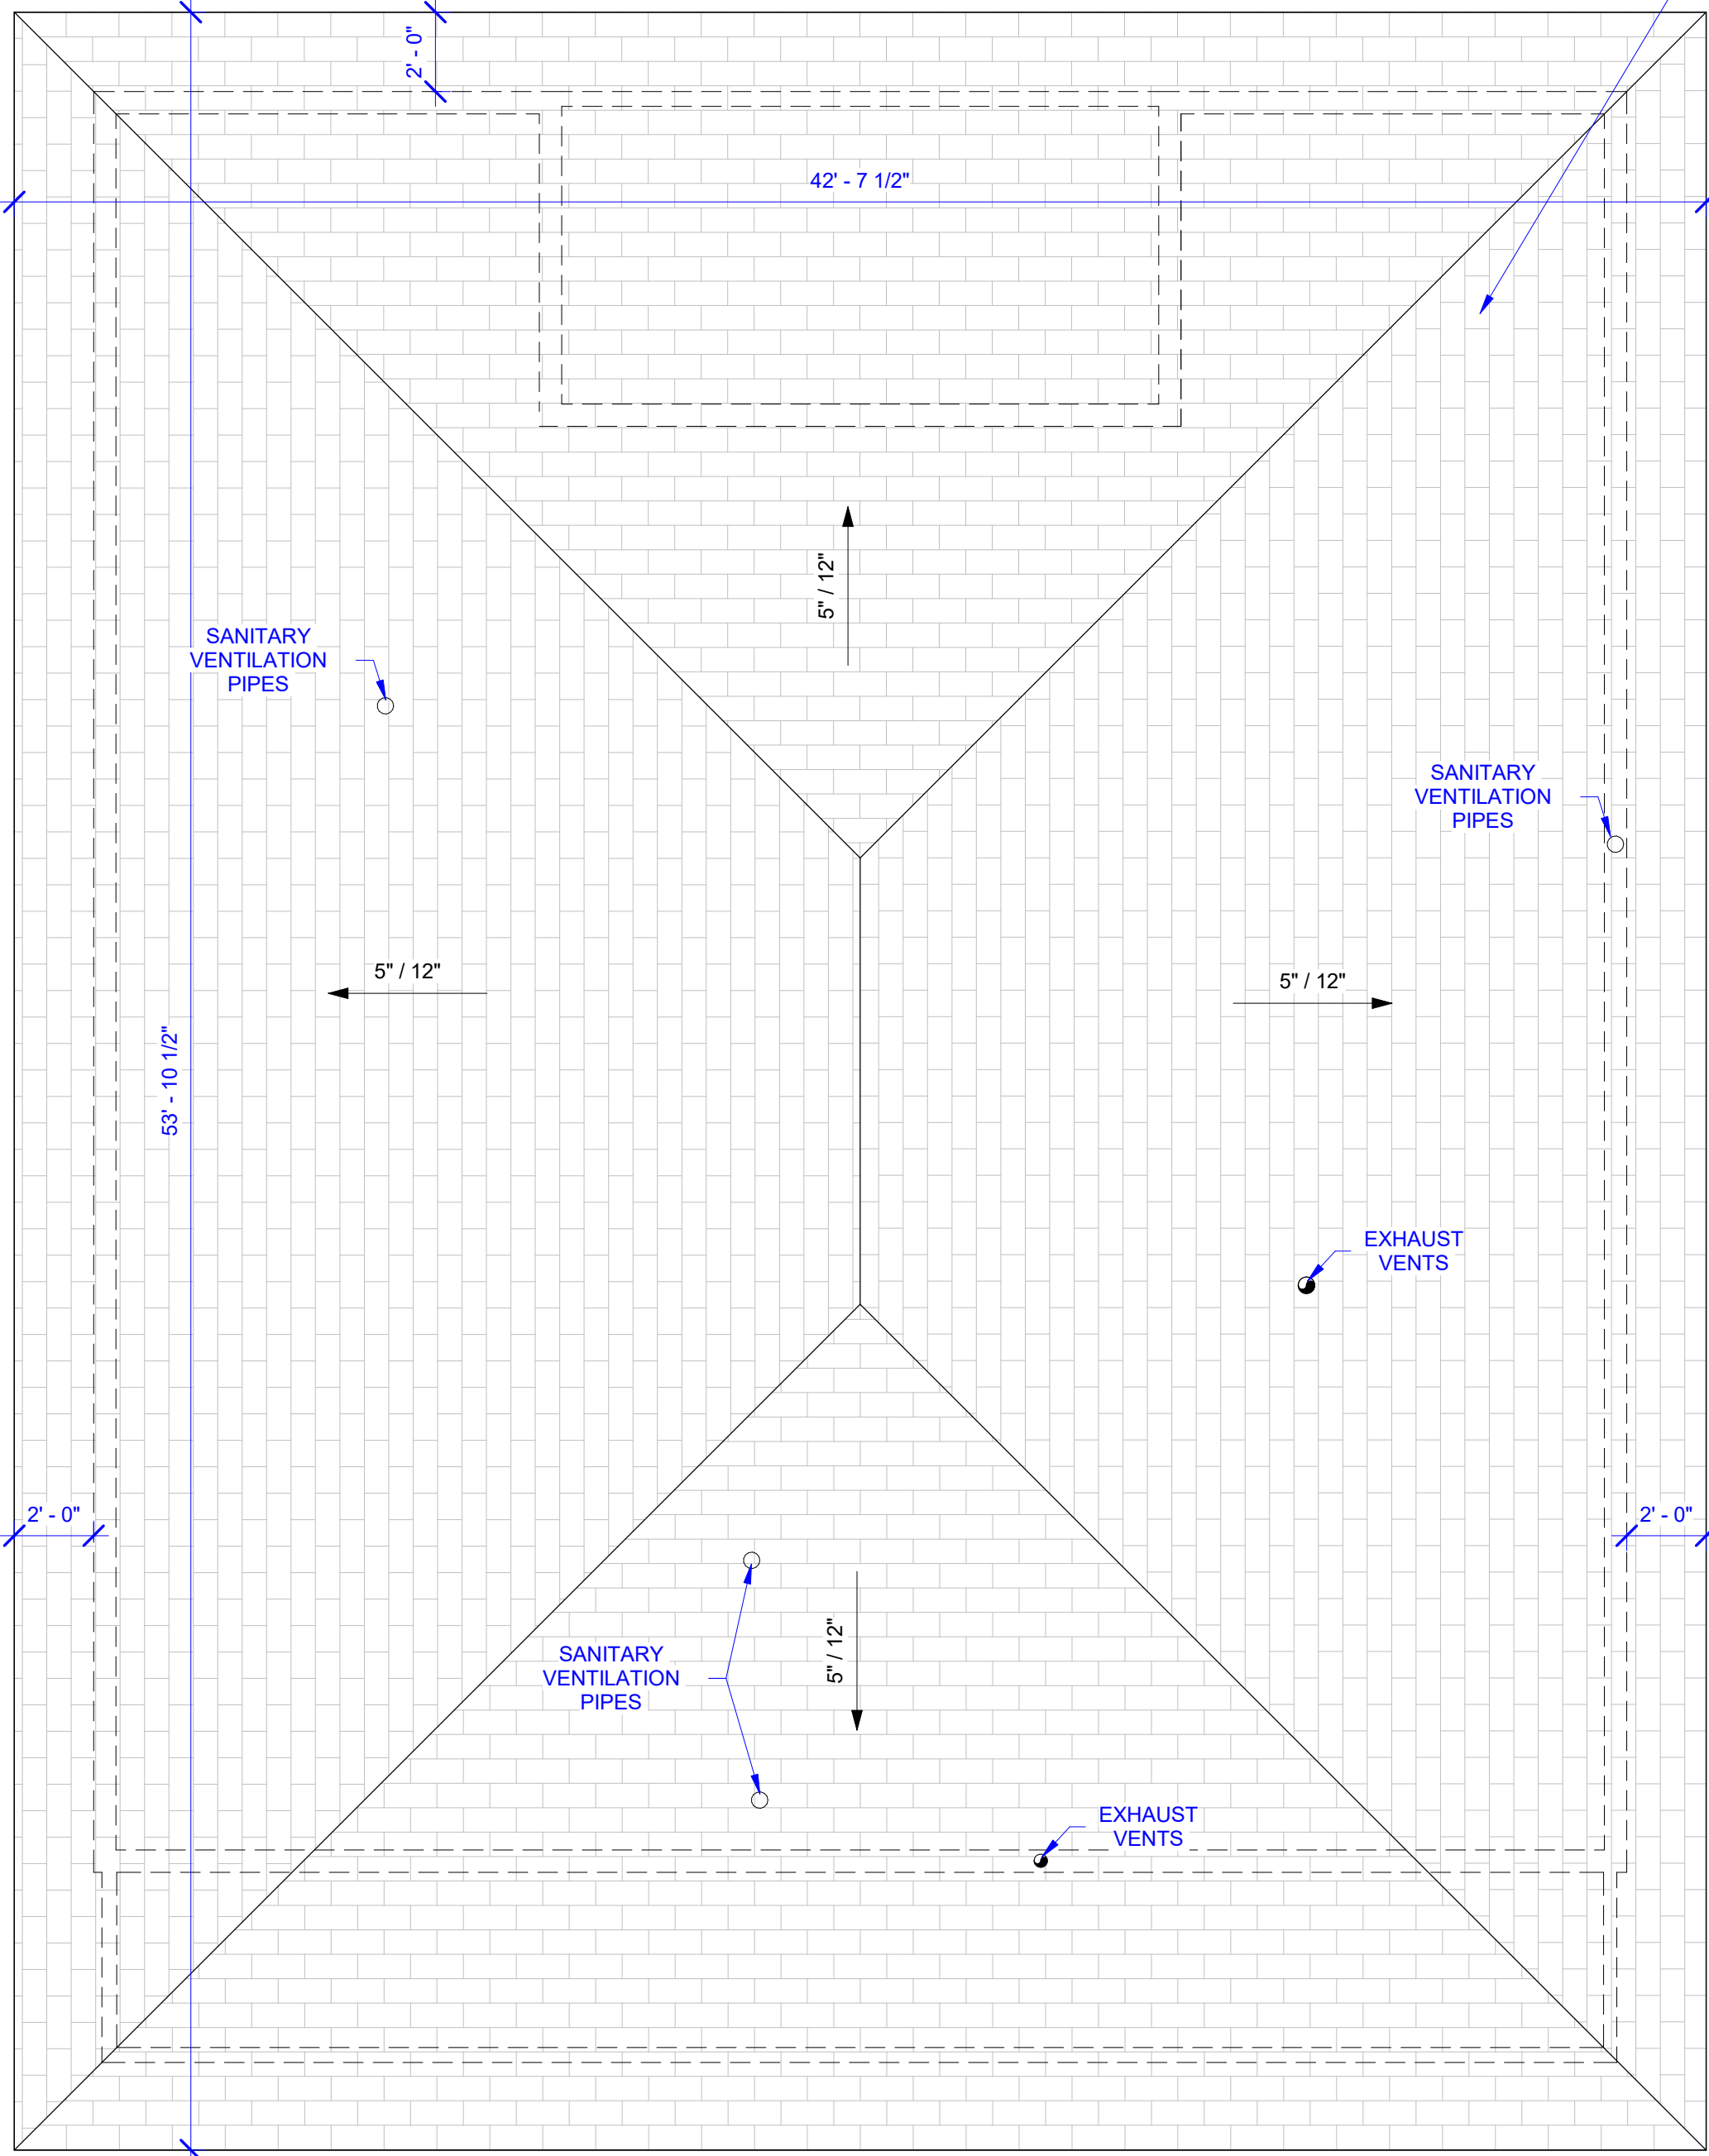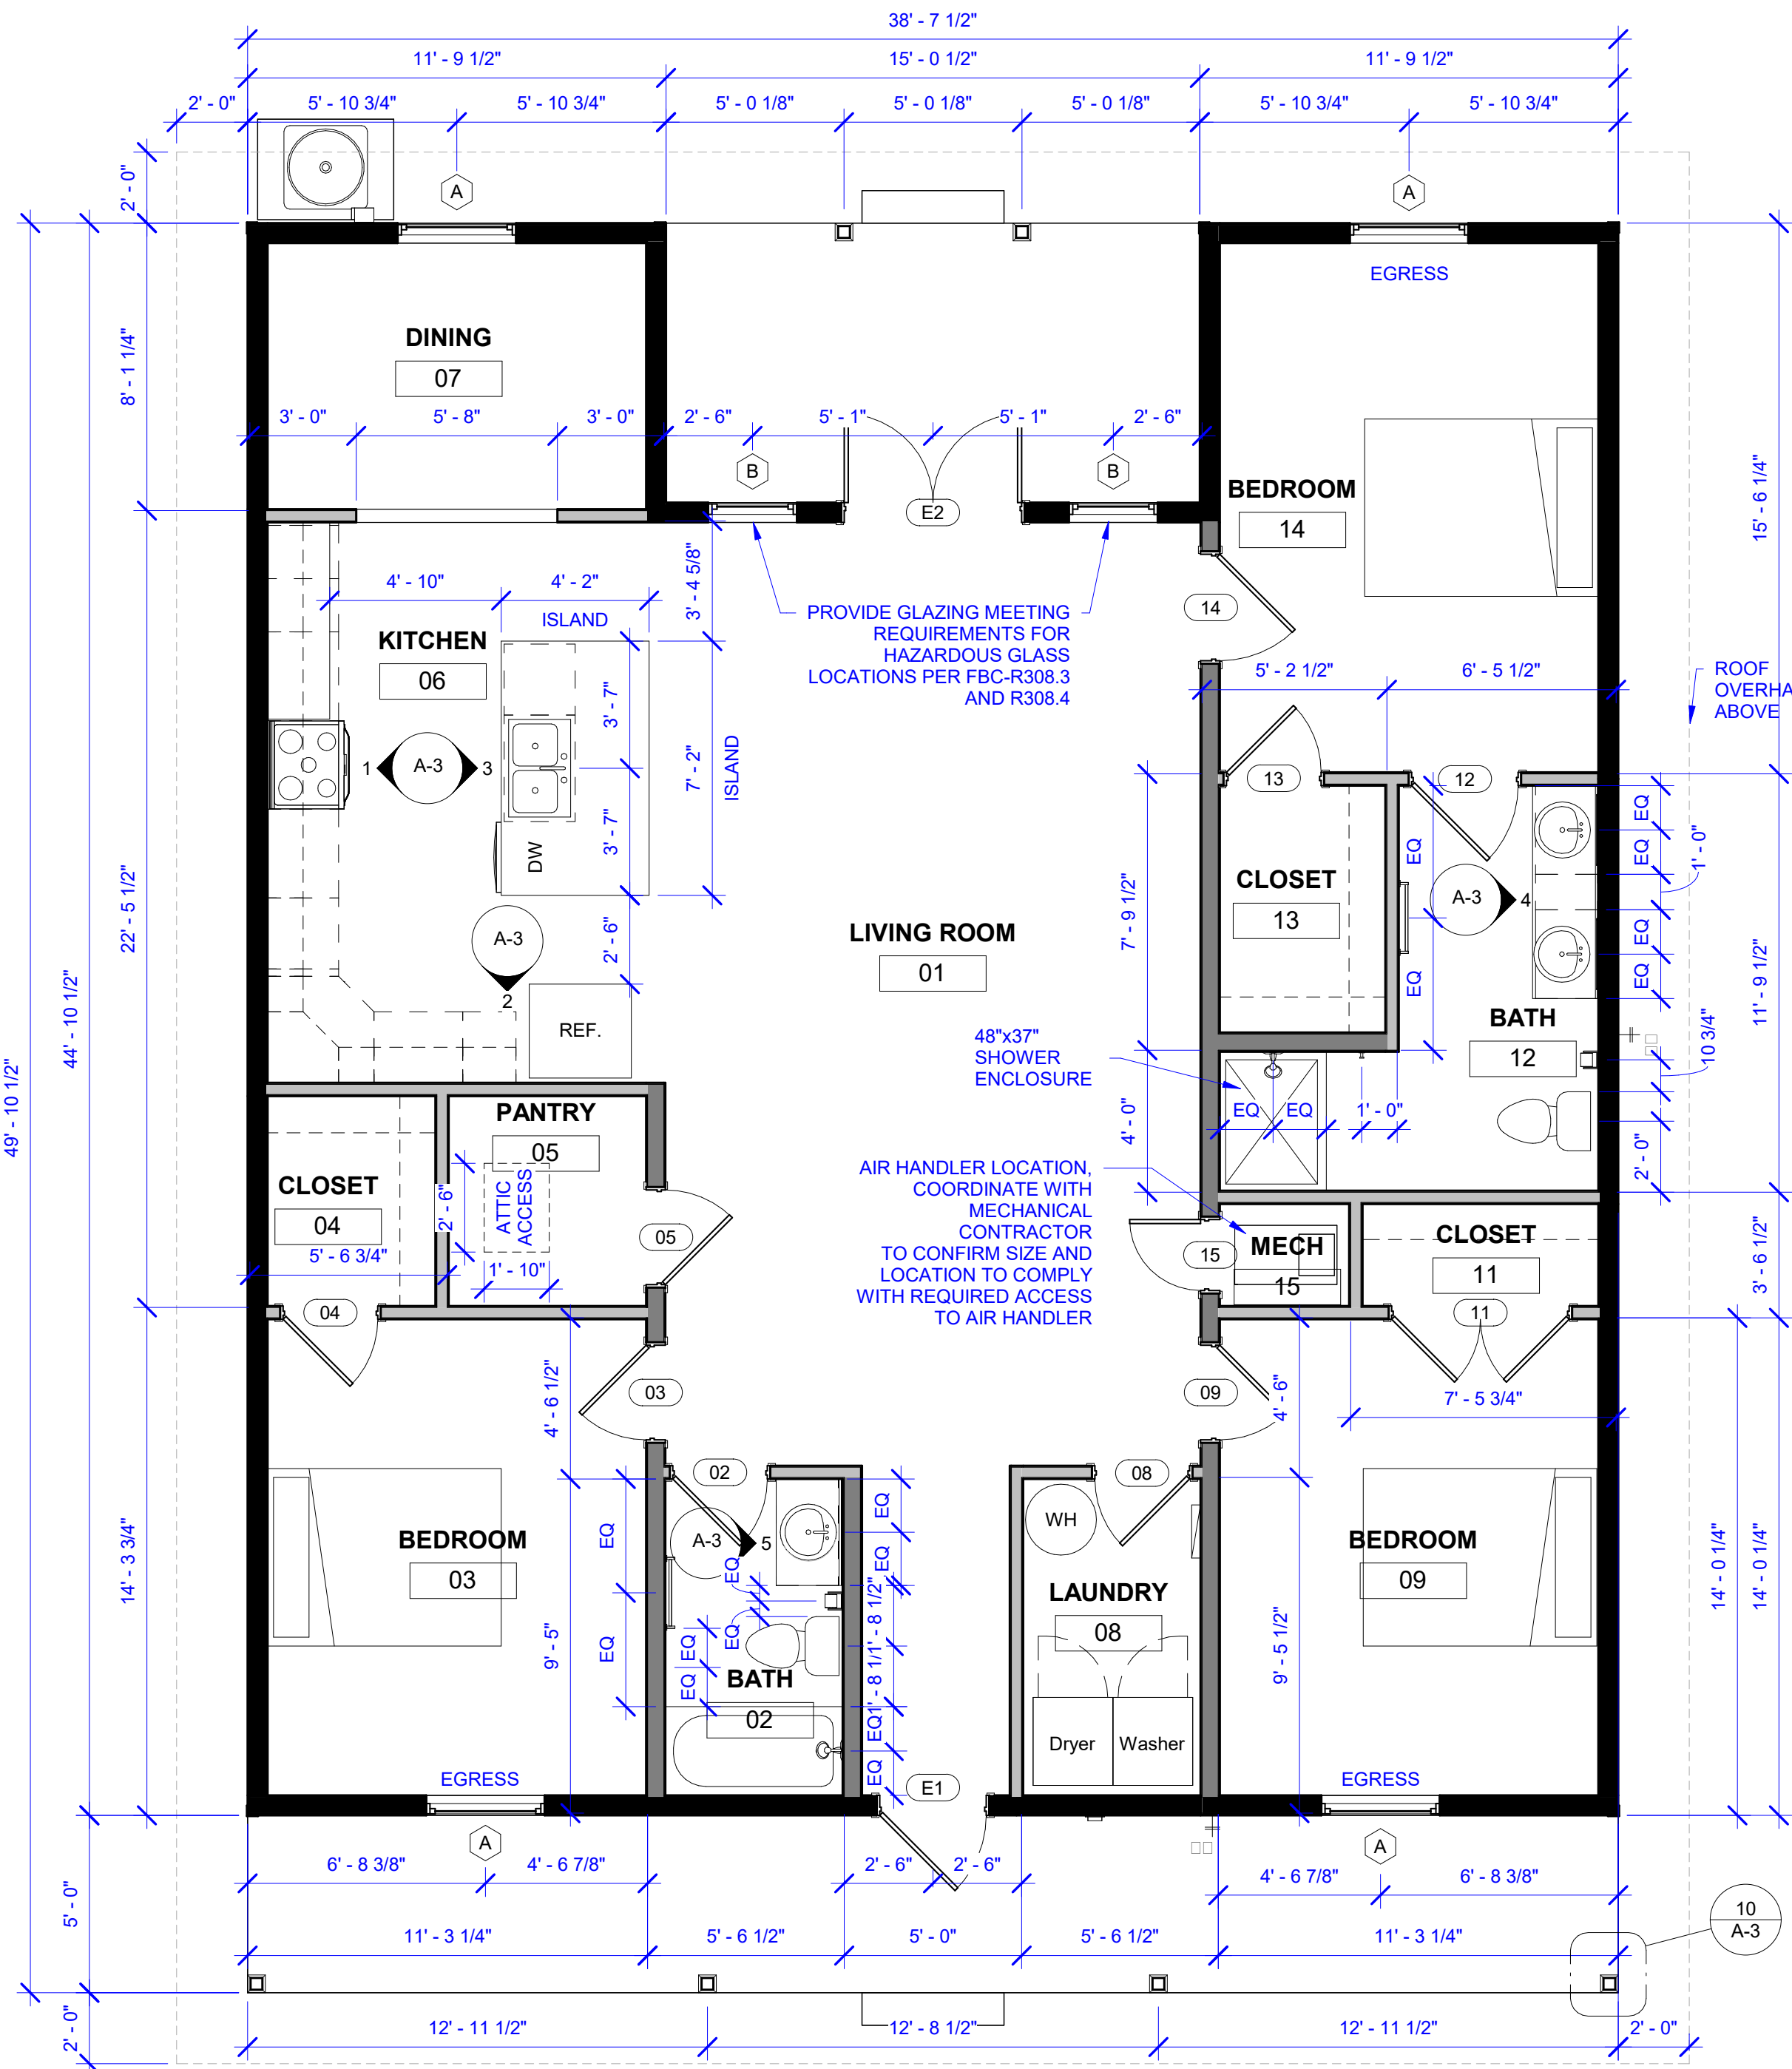

ASPHALT SHINGLE ROOF INSTALLED PER FRC 2020 905.2.
ROOF UNDERLAYMENT SHALL BE INSTALLED PER FRC 2020 905.1.1 METHOD NUMBER 2:
INCLUDE A MINIMUM 4-INCH-WIDE (102 MM) STRIP OF SELF-ADHERING POLYMER-
MODIFIED BITUMEN MEMBRANE COMPLYING WITH ASTM D1970, INSTALLED IN
ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS FOR THE DECK MATERIAL,
AND SHALL BE APPLIED OVER ALL JOINTS IN THE ROOF DECKING. AN APPROVED
UNDERLAYMENT IN ACCORDANCE WITH TABLE R805.1.1.1 FOR THE APPLICABLE ROOF
COVERING SHALL BE APPLIED OVER THE ENTIRE ROOF OVER THE 4-INCH-WIDE (102 MM)
MEMBRANE STRIPS.
ASPHALT ROOF SHINGLES SHALL BE CLASSIFIED AS ASTM D3161 CLASS F, TAS 107 OR
ASTM D7158 CLASS H.
PROVIDE PIPE BOOT AT ALL ROOF PENETRATIONS PER DETAIL.

BUILDING INFORMATION:

FIRST FLOOR: 1612 SF
FRONT PORCH: 193 SF
REAR PORCH: 121 SF
BUILDING HEIGHT: 13' 4"
CONDITIONED AREA VOLUME: 12,896 CF

ROOF VENTILATION:
ROOF AREA = 2296 SF
REQUIRED NET FREE AREA PER FBC R806.2 = $2296/150 = 15.30$ SF
SOFFIT AREA = 370 SF
SOFFIT NET FREE AREA = 14.34 SQ INCHES/SF (BY MANUFACTURER)
PROPOSED ROOF NET FREE AREA = $370 \times 14.34/144 = 36.84$ SF

1 FIRST FLOOR
1/4" = 1'-0"

2 ROOF
1/4" = 1'-0"

FIRST FLOOR LEGEND

- EXTERIOR 2X6 FRAMED WALL
- INTERIOR 2X6 FRAMED WALL
- INTERIOR 2X4 FRAMED WALL

WALL TYPE SCHEDULE

WALL TYPE	INTERIOR/EXTERIOR	DESCRIPTION (EXTERIOR TO INTERIOR)
1	EXTERIOR	VINYL SIDING, MOISTURE BARRIER, PLYWOOD WALL SHEATHING, 2x6 STUD @ 16" O.C., R-19 BATT INSULATION, 1/2" GYPSUM BOARD
2	INTERIOR	1/2" GYPSUM BOARD, 2X6 STUD @ 16" O.C., GYPSUM BOARD
3	INTERIOR	1/2" GYPSUM BOARD, 2X4 STUD @ 16" O.C., GYPSUM BOARD

WINDOW SCHEDULE

Type Mark	Width	Height	Description	Count	Head Height
A	3' - 4"	5' - 0"	DOUBLE HUNG VINYL WINDOW - EGRESS	4	6' - 8"
B	2' - 6"	5' - 0"	DOUBLE HUNG VINYL WINDOW	2	6' - 8"

WINDOW NOTES:

- WINDOW ASSEMBLY SHALL BE IMPACT RESISTANT AND INSTALLED TO MEET THE SPECIFIED WIND LOAD
- WINDOWS SHALL MEET THE REQUIREMENTS OF TABLE R402.1.2 OF THE FLORIDA ENERGY CONSERVATION CODE 2020.
- FENESTRATION U-FACTOR SHALL BE ≤ 0.40
- GLAZED FENESTRATION SHGC VALUE SHALL BE ≤ 0.25
- WINDOWS SHALL BE ENERGY STAR QUALIFIED
- PROVIDE INSECT SCREENS AT ALL WINDOWS


DOOR SCHEDULE

Mark	Width	Height	Rough Width	Rough Height	Description	Comments
02	2' - 8"	6' - 8"	2' - 10"	6' - 9"	6-PANEL INTERIOR DOOR	
03	2' - 8"	6' - 8"	2' - 10"	6' - 9"	6-PANEL INTERIOR DOOR	
04	2' - 8"	6' - 8"	2' - 10"	6' - 9"	6-PANEL INTERIOR DOOR	
05	2' - 8"	6' - 8"	2' - 10"	6' - 9"	6-PANEL INTERIOR DOOR	
08	2' - 8"	6' - 8"	2' - 10"	6' - 9"	6-PANEL INTERIOR DOOR	
09	2' - 8"	6' - 8"	2' - 10"	6' - 9"	6-PANEL INTERIOR DOOR	
11	5' - 0"	6' - 8"	5' - 2"	6' - 9"	PAIR 6-PANEL DOUBLE INTERIOR DOORS	
12	3' - 0"	6' - 8"	3' - 2"	6' - 9"	6-PANEL INTERIOR DOOR	
13	2' - 8"	6' - 8"	2' - 10"	6' - 9"	6-PANEL INTERIOR DOOR	
14	3' - 0"	6' - 8"	3' - 2"	6' - 9"	6-PANEL INTERIOR DOOR	
15	2' - 0"	5' - 0"	2' - 2"	5' - 1"	6-PANEL INTERIOR DOOR	
E1	3' - 0"	6' - 8"	3' - 2"	6' - 9"	HALF LITE ENTRY DOOR	CONFIRM WITH HVAC CONTRACTOR
E2	5' - 0"	6' - 8"	5' - 2"	6' - 9"	PAIR 3/4 LITE DOUBLE EXTERIOR DOORS	ENERGY STAR QUALIFIED, PROVIDE GLAZING MEETING REQUIREMENTS FOR HAZARDOUS GLASS LOCATIONS PER FBC-R308.3 AND R308.4

Digitally signed by
Imbrie M Packard
Date: 2023.04.12
'13:12:45 -05'00

This item has been digitally signed and sealed by Imbrie M. G. Packard architect on the date specified.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.





Project Number 2019-15
Date 04/11/2023
Drawn By ZP
Checked By IP
FOR CONSTRUCTION

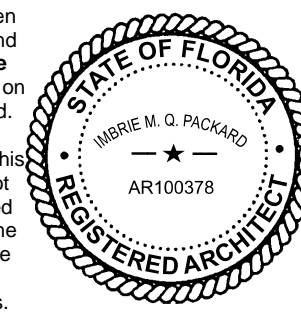

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYLA DR.
LAKE CITY, FL 32025

ARCHITECTURAL PLANS

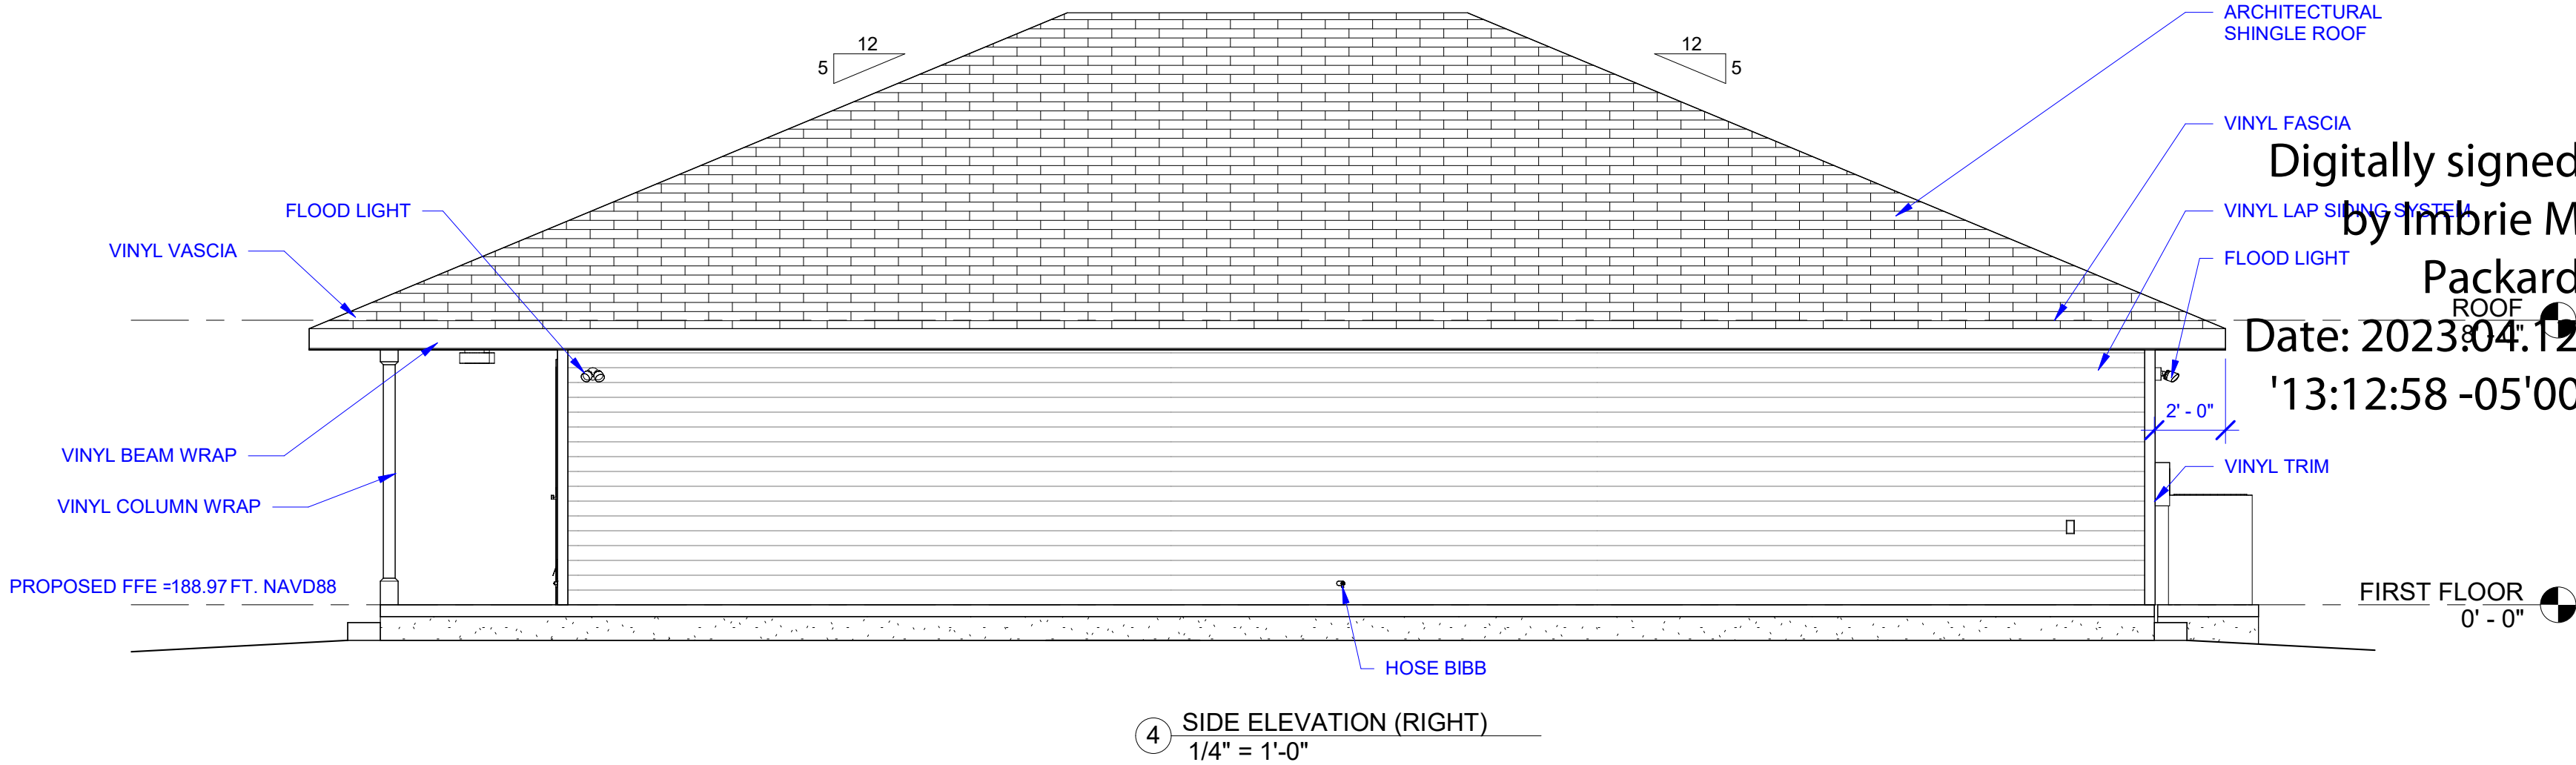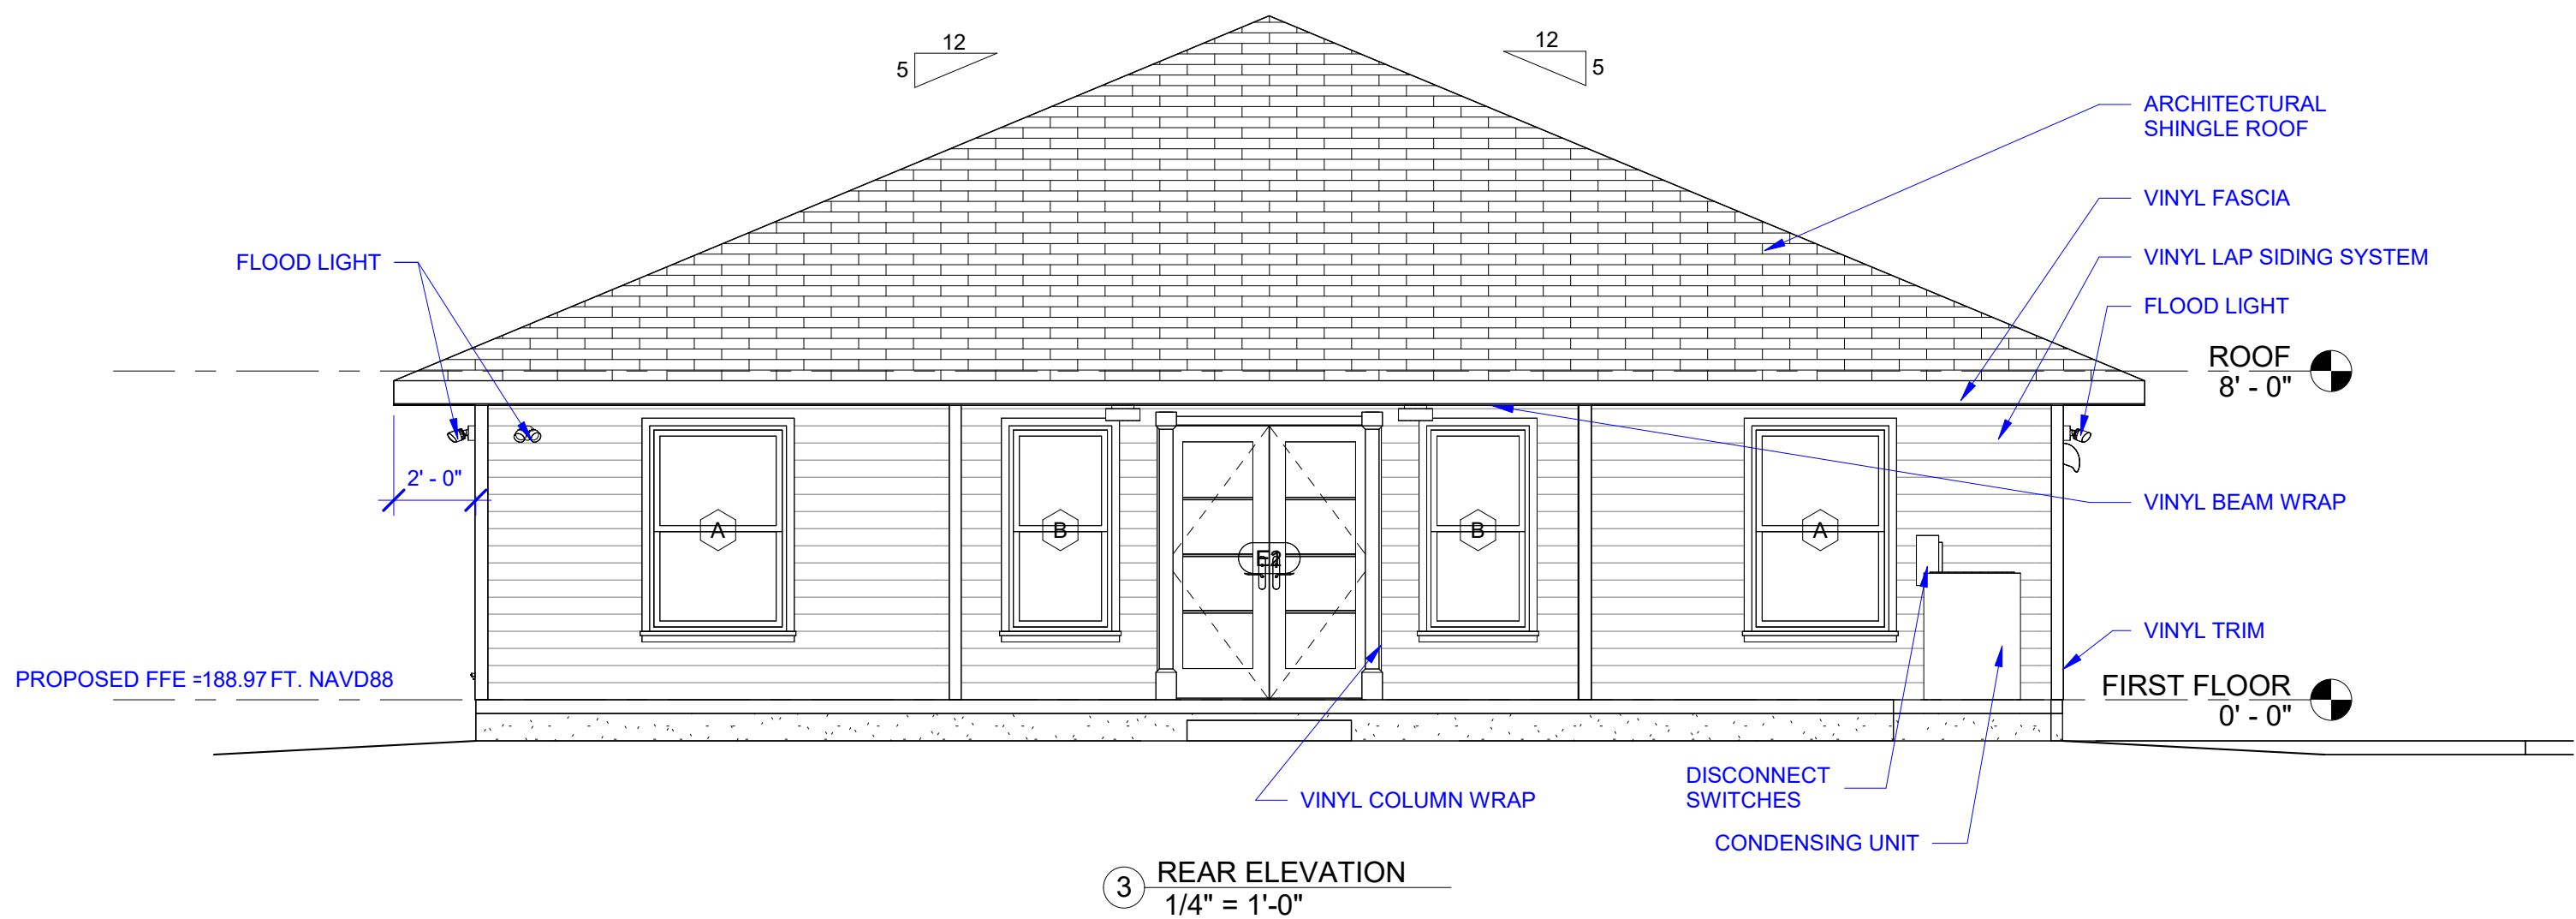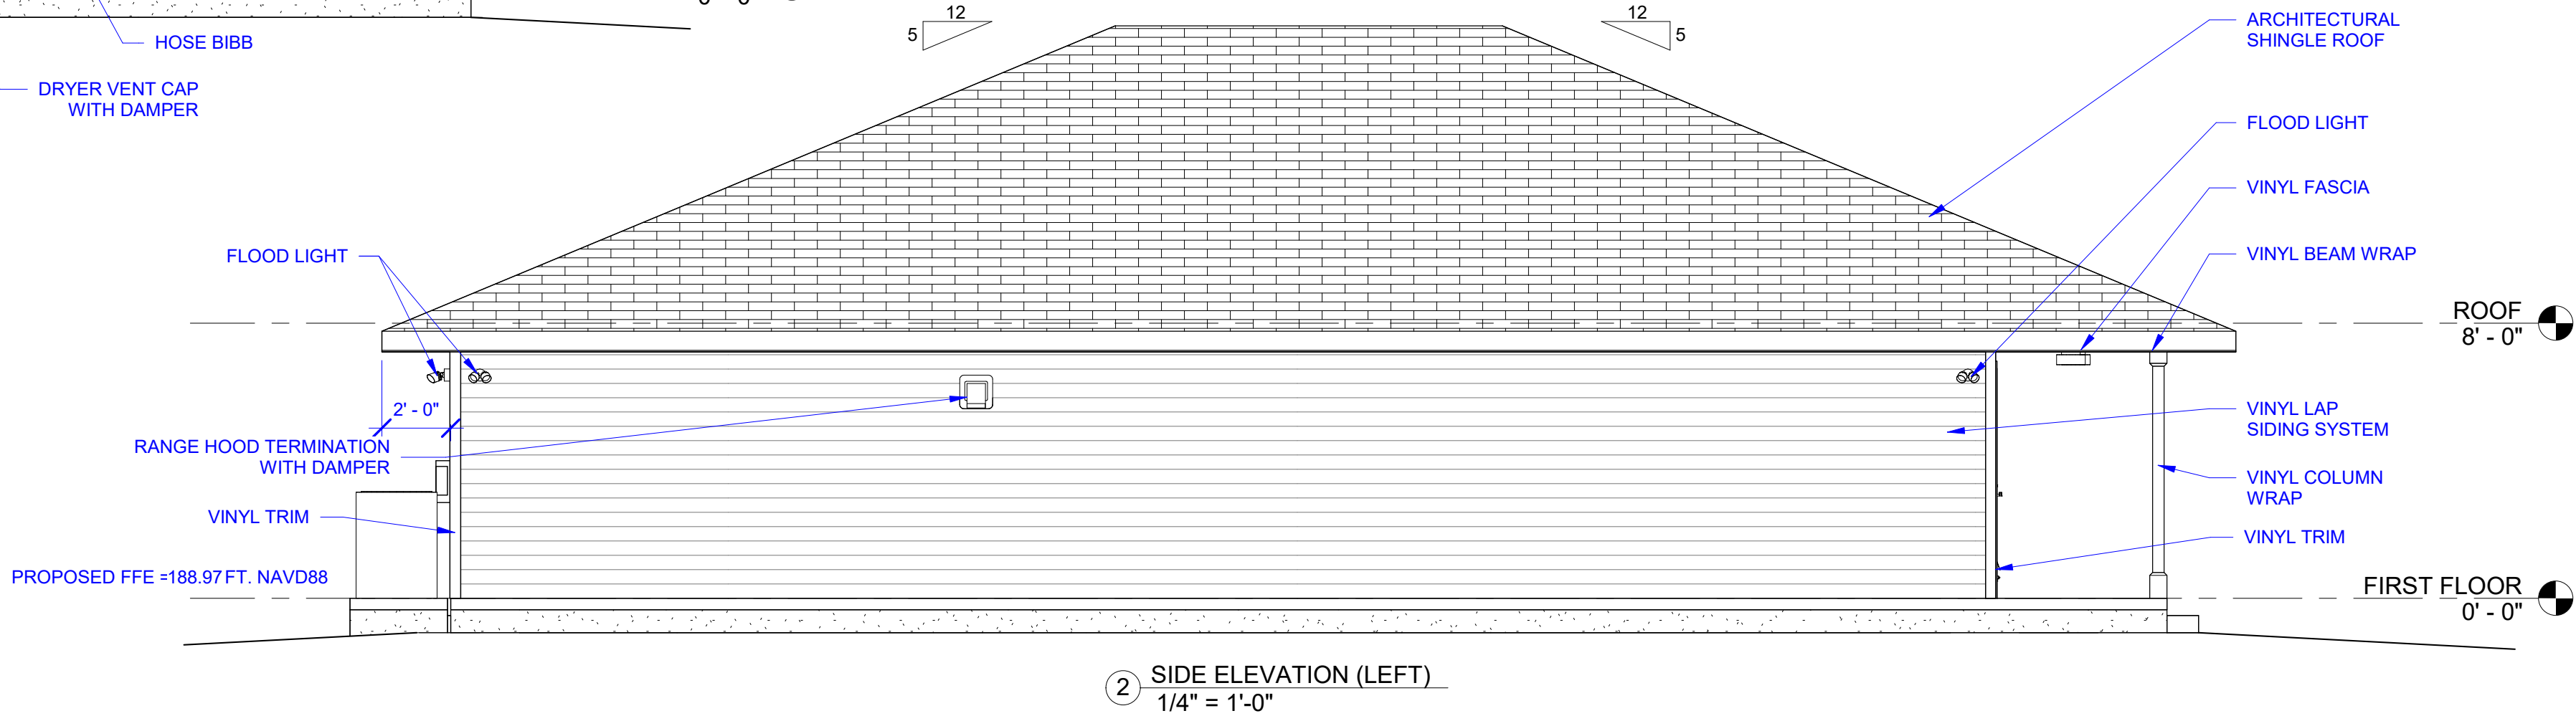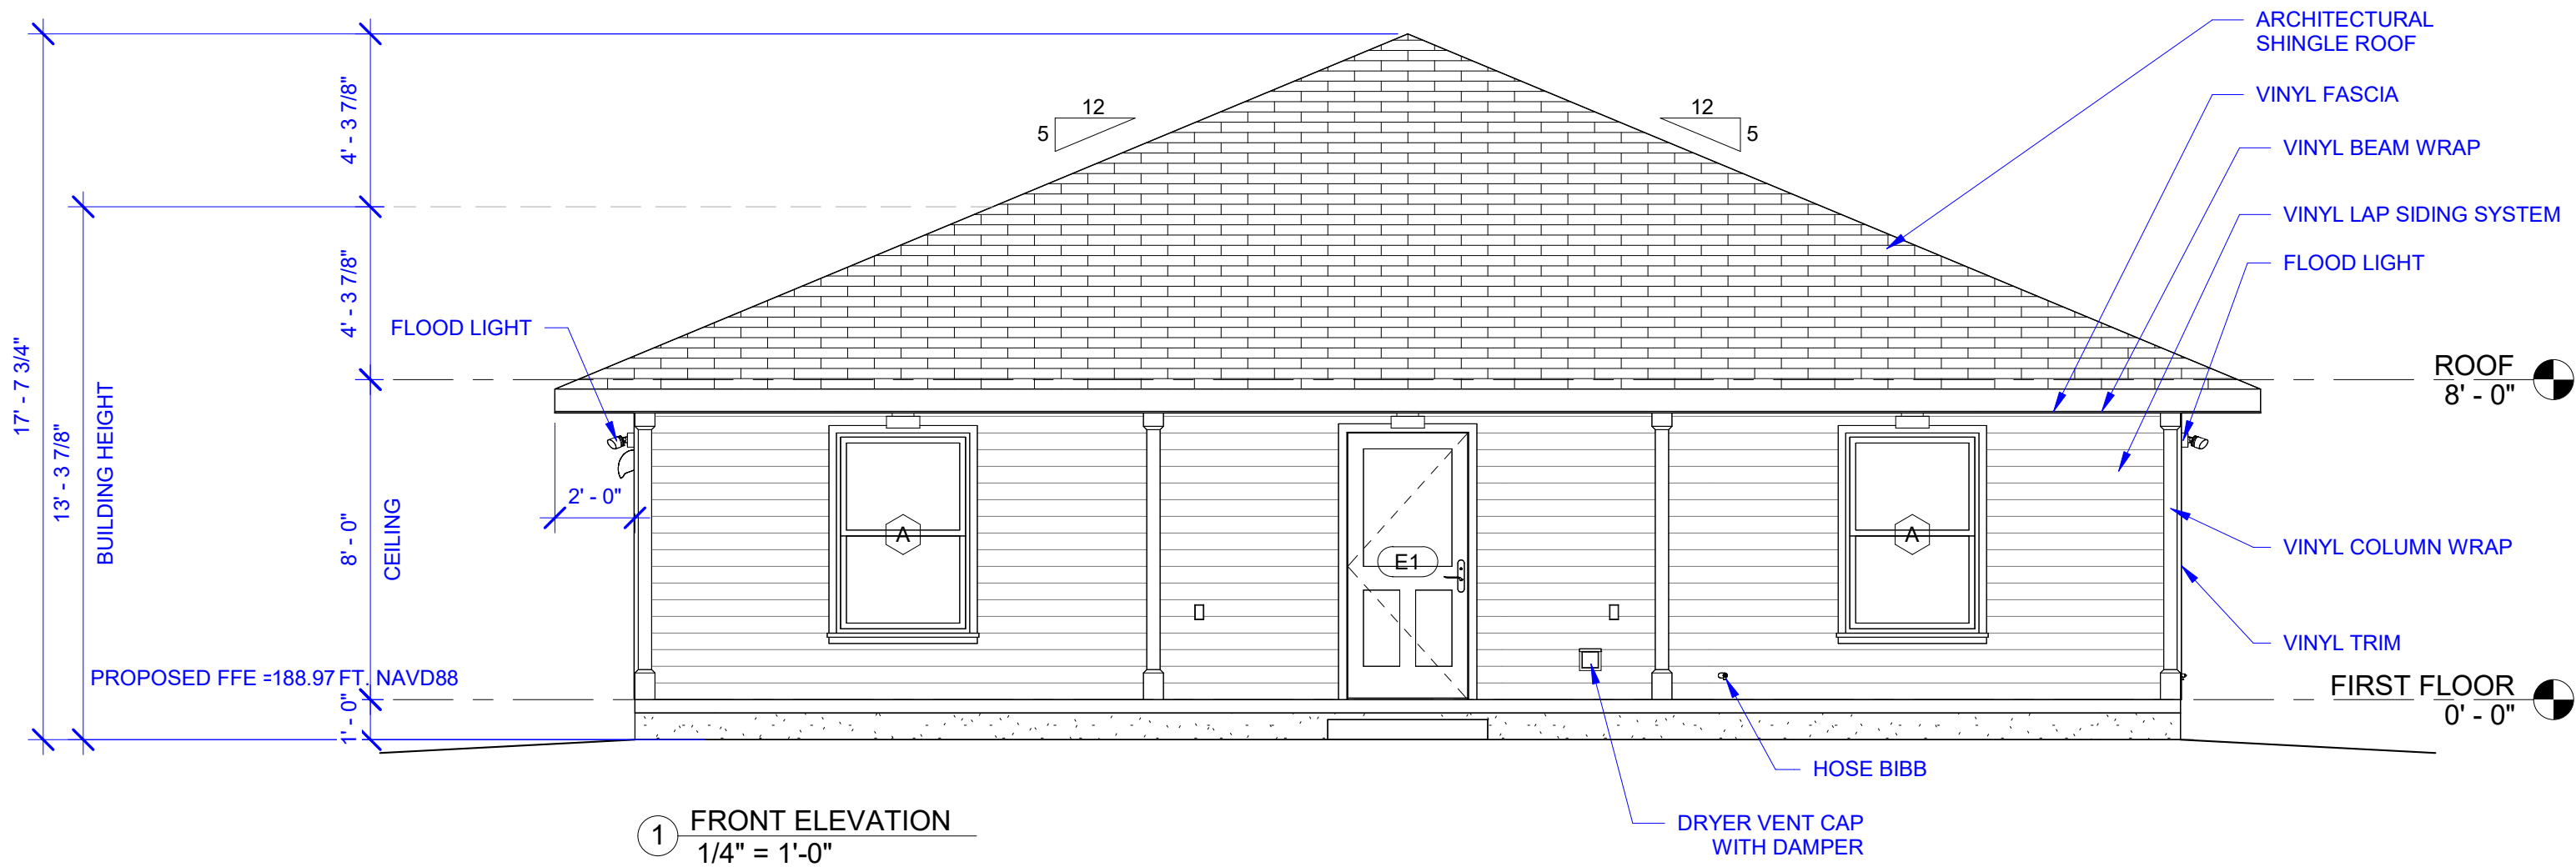

EXTERIOR DOOR INFORMATION					
Mark	Width	Height	Description	DESIGN PRESSURE (POSITIVE) PSF	DESIGN PRESSURE (NEGATIVE) PSF
E1	3' - 0"	6' - 8"	HALF LITE ENTRY DOOR	41	-45
E2	5' - 0"	6' - 8"	PAIR 3/4 LITE DOUBLE EXTERIOR DOORS	41	-45

TABLE VALUES DETERMINED PER ASCE 7-16 (MINIMUM DESIGN LOADS AND ASSOCIATED CRITERIA FOR BUILDINGS AND OTHER STRUCTURES)

EXTERIOR WINDOW INFORMATION					
Type Mark	Width	Height	Description	DESIGN PRESSURE (POSITIVE) PSF	DESIGN PRESSURE (NEGATIVE) PSF
A	3' - 4"	5' - 0"	DOUBLE HUNG VINYL WINDOW - EGRESS	43	-57
B	2' - 6"	5' - 0"	DOUBLE HUNG VINYL WINDOW	43	-46

TABLE VALUES DETERMINED PER ASCE 7-16 (MINIMUM DESIGN LOADS AND ASSOCIATED CRITERIA FOR BUILDINGS AND OTHER STRUCTURES)

No.	Description	Date

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net


ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYVIEW DR.
LAKE CITY, FL 32025


ELEVATIONS

Project Number	2019-15
Date	04/11/2023
Drawn By	ZP
Checked By	IP


FOR CONSTRUCTION

This item has been digitally signed and sealed by Imbrie M Packard architect on the date specified.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

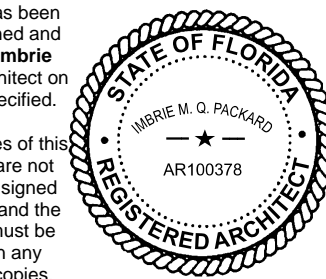


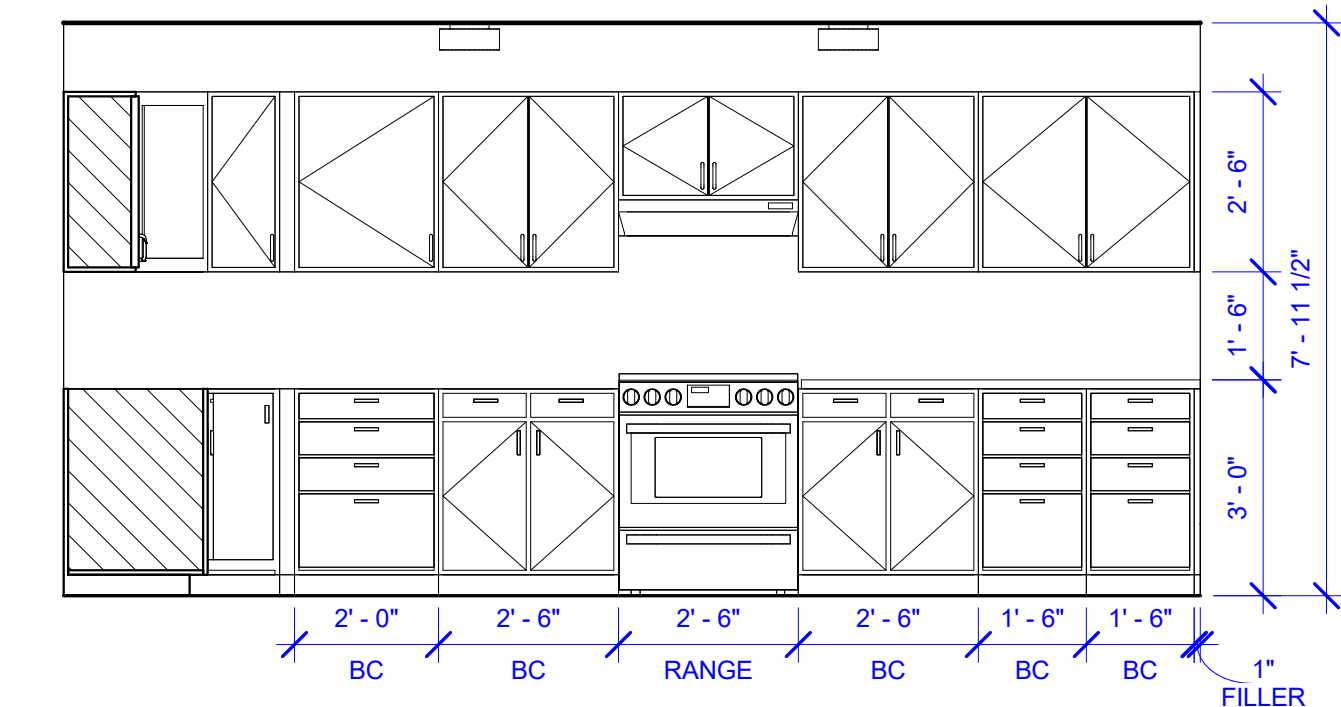


1 KITCHEN ELEVATION
3/8" = 1'-0"

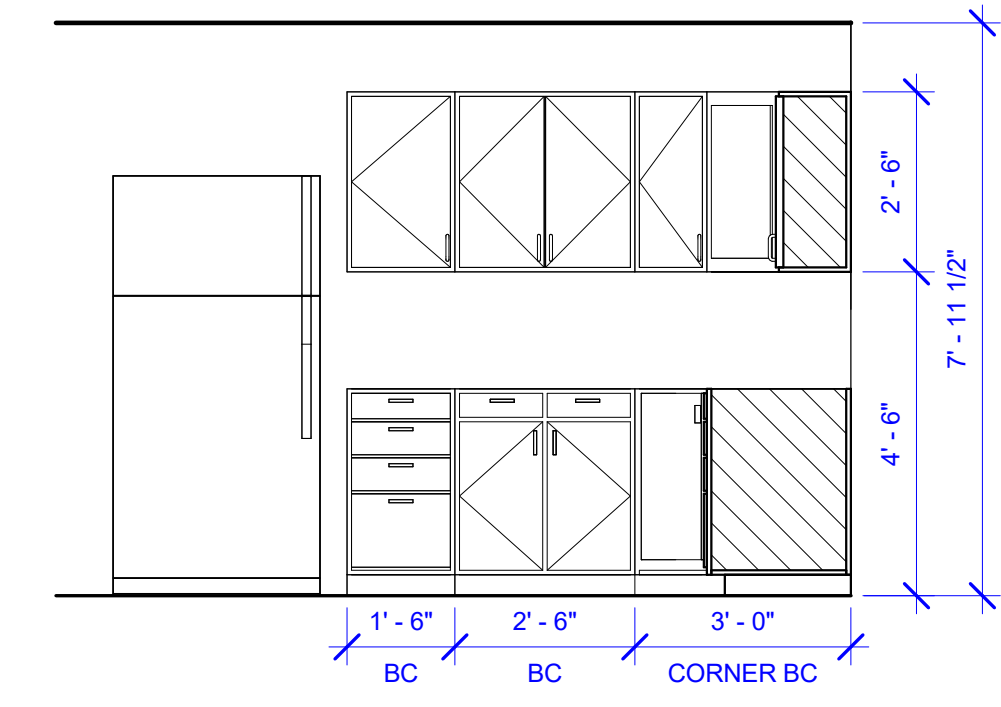


2 KITCHEN ELEVATION
3/8" = 1'-0"

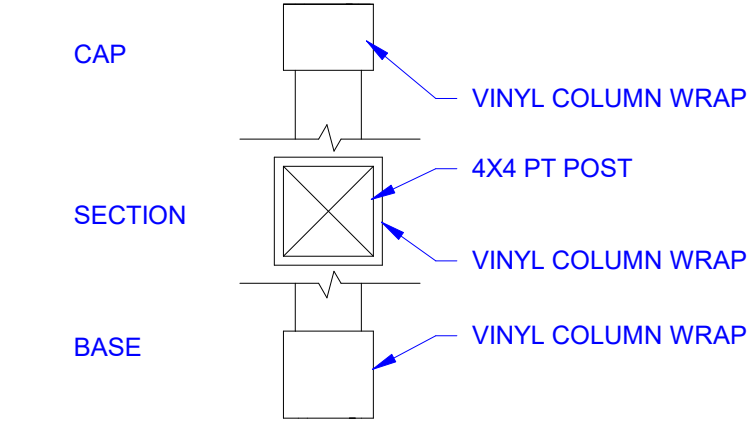


10 SECTION
3/4" = 1'-0"

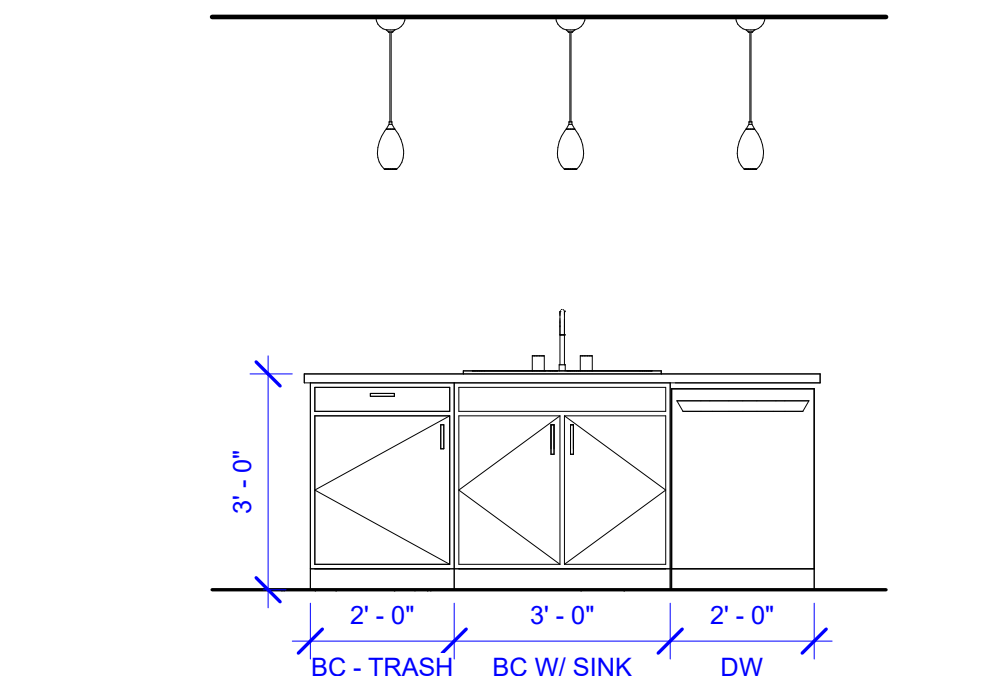


3 KITCHEN ELEVATION
3/8" = 1'-0"

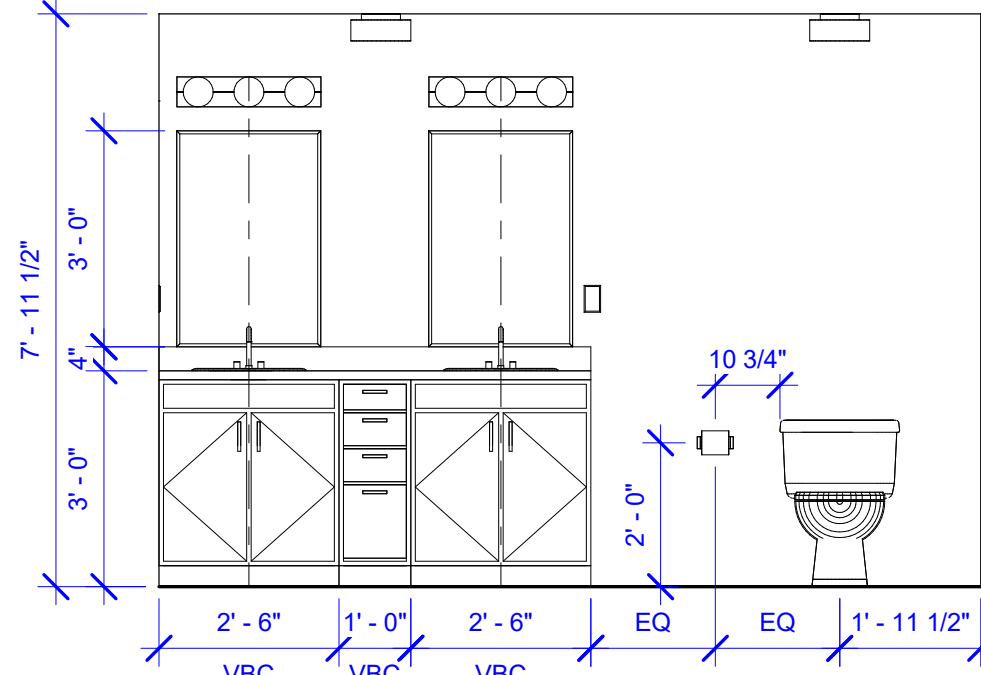


4 BATHROOM ELEVATION
3/8" = 1'-0"

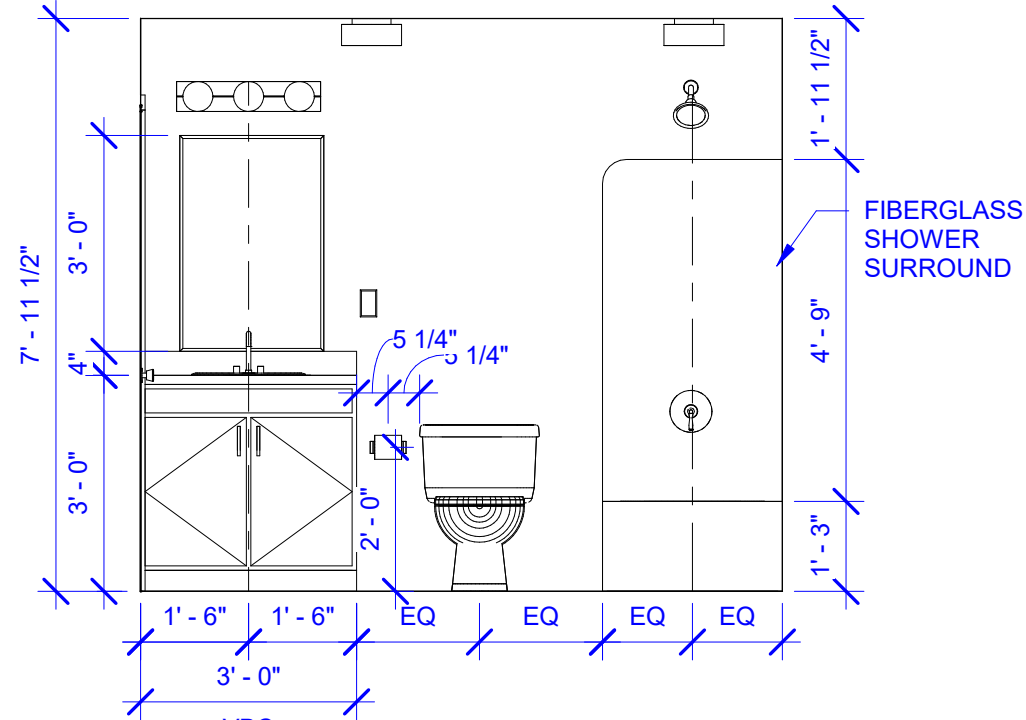


5 BATHROOM ELEVATION
3/8" = 1'-0"

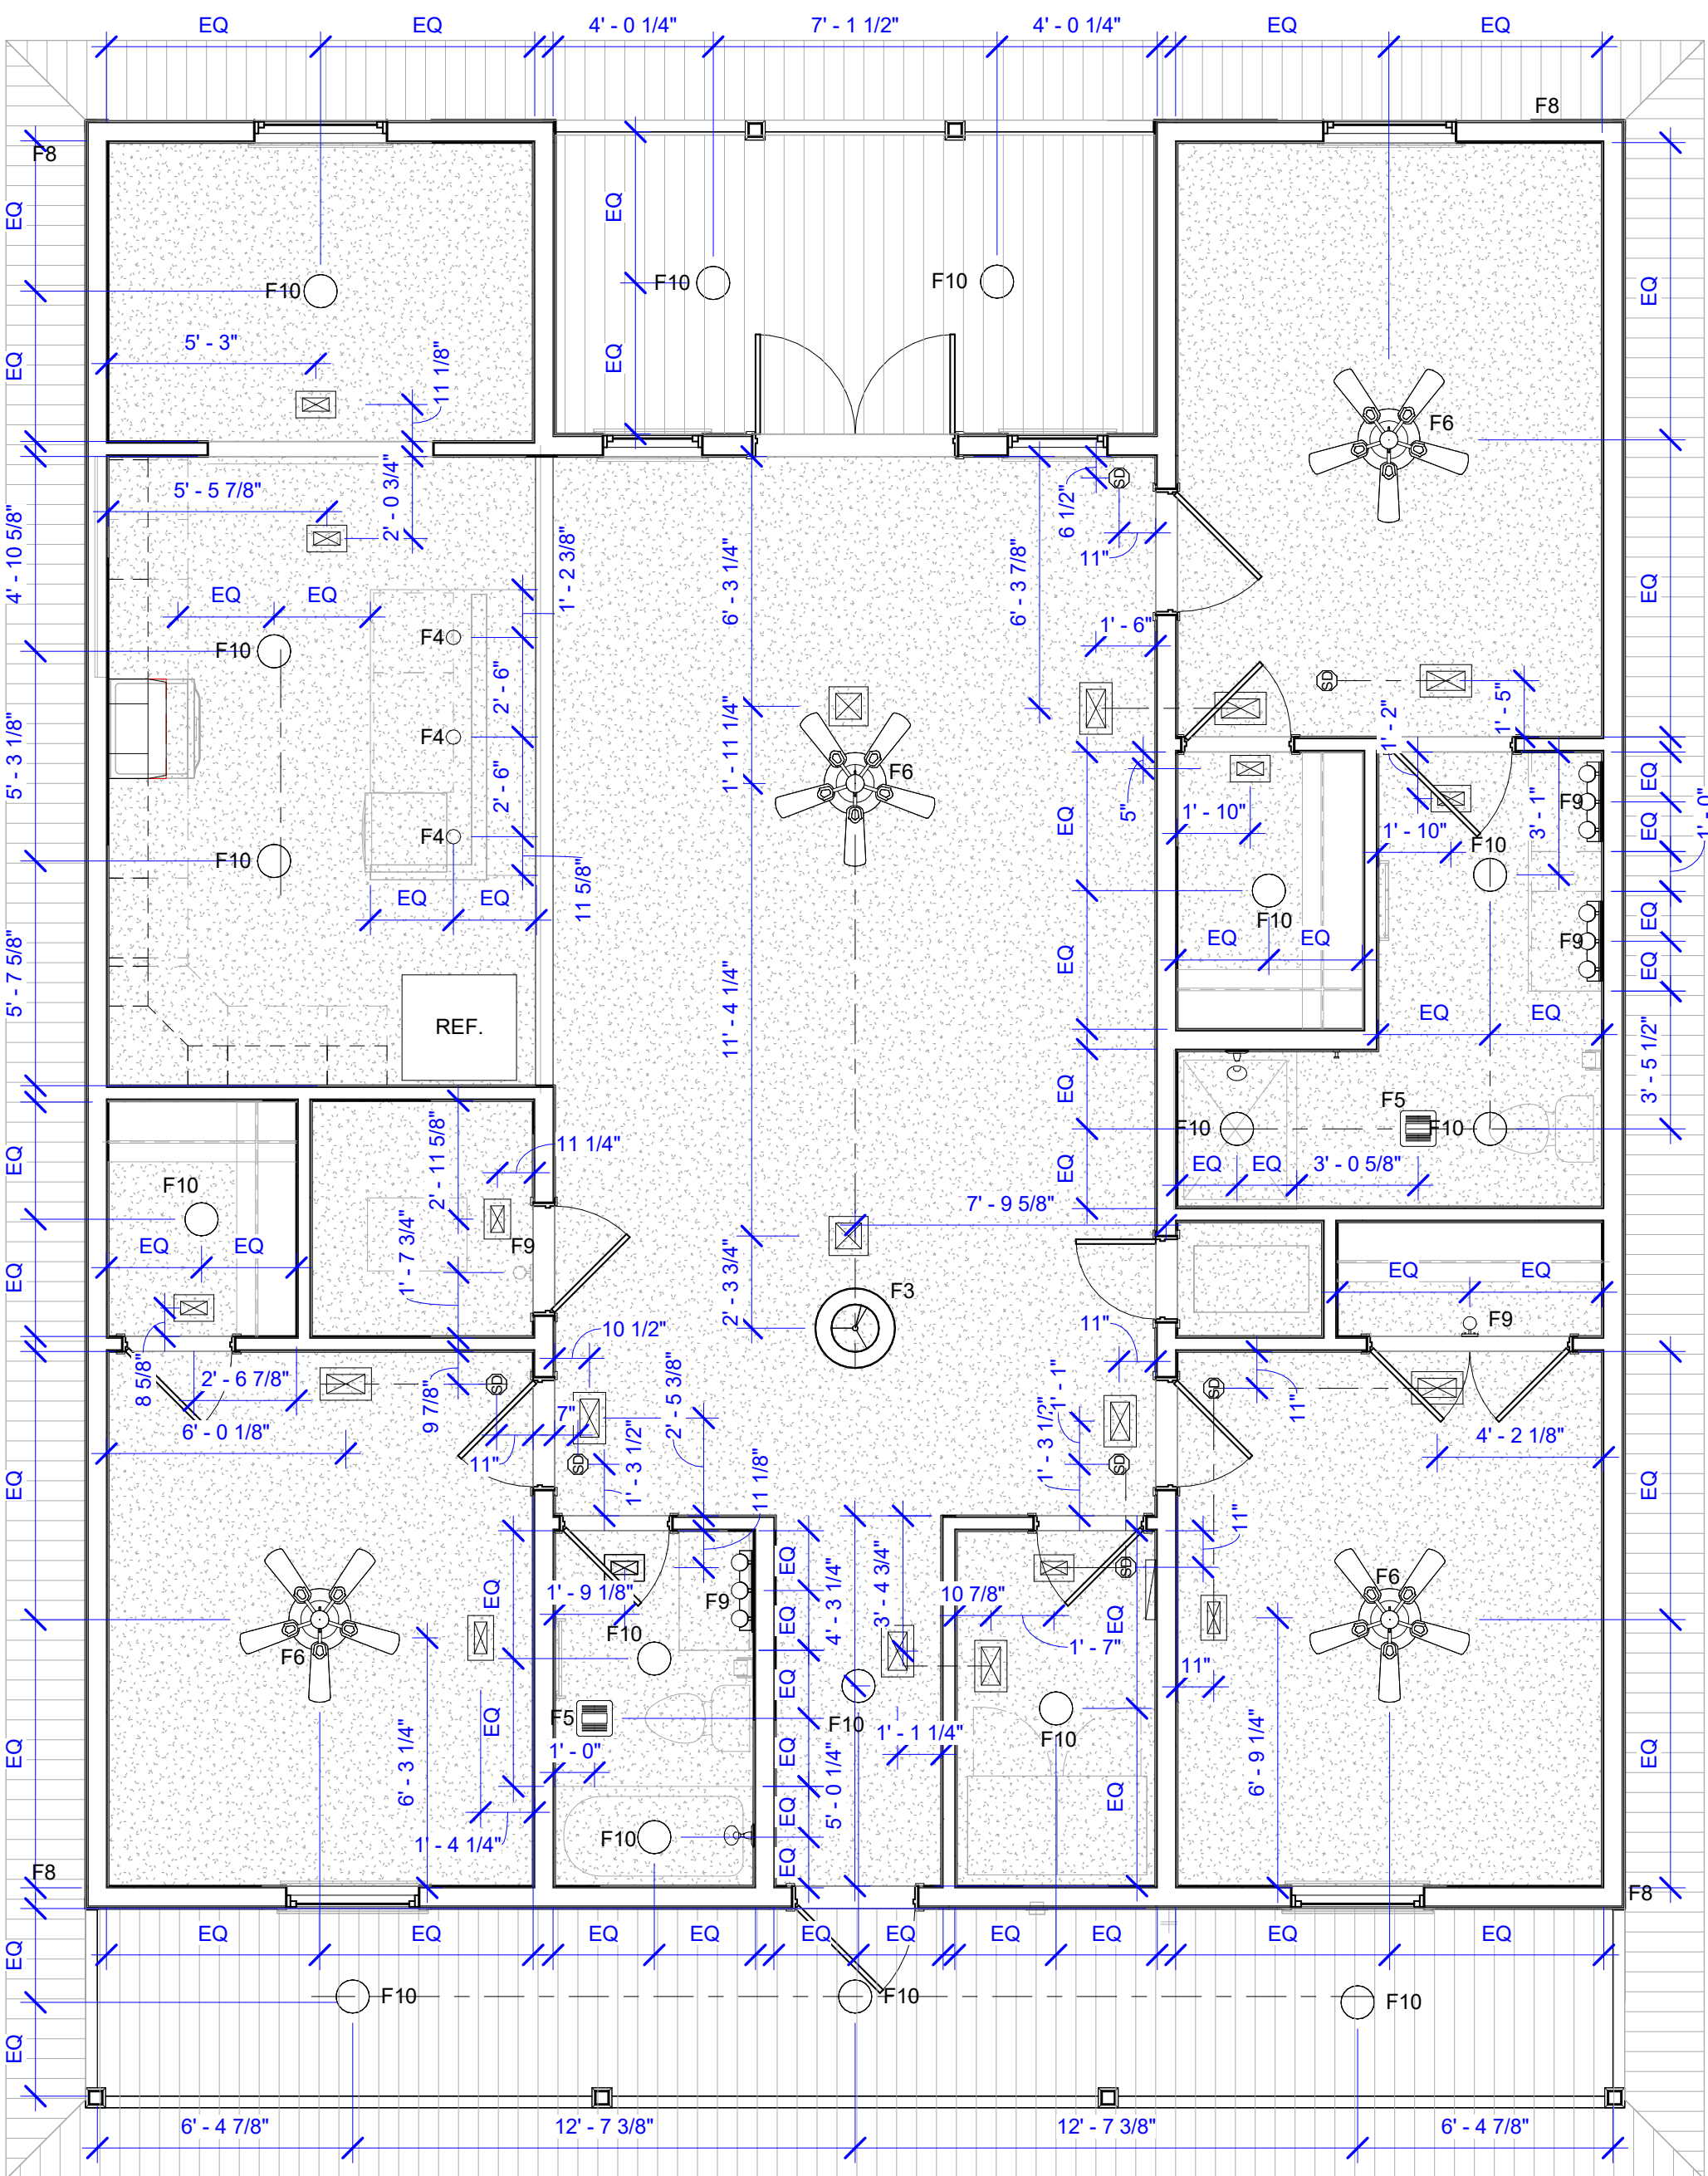

9 REFLECTED CEILING PLAN
1/4" = 1'-0"

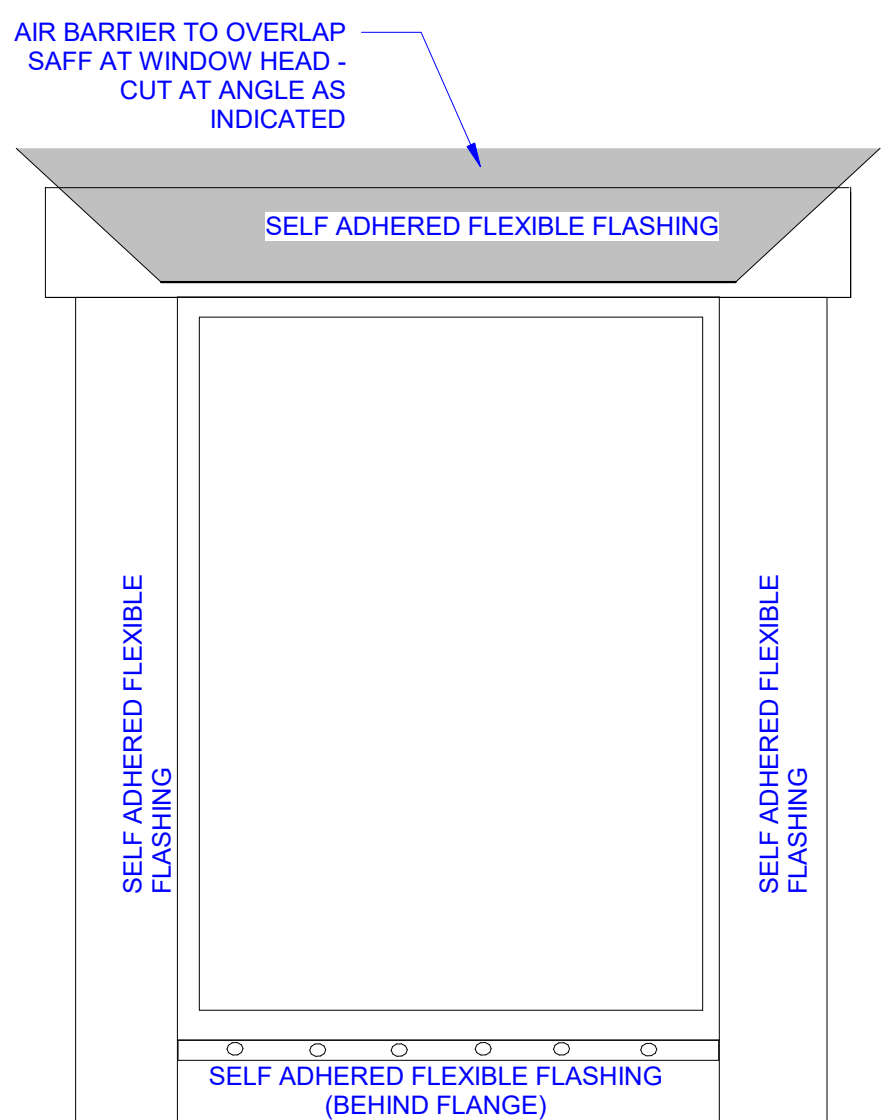


7 WINDOW AND DOOR FLASHING DIAGRAM
6" = 1'-0"

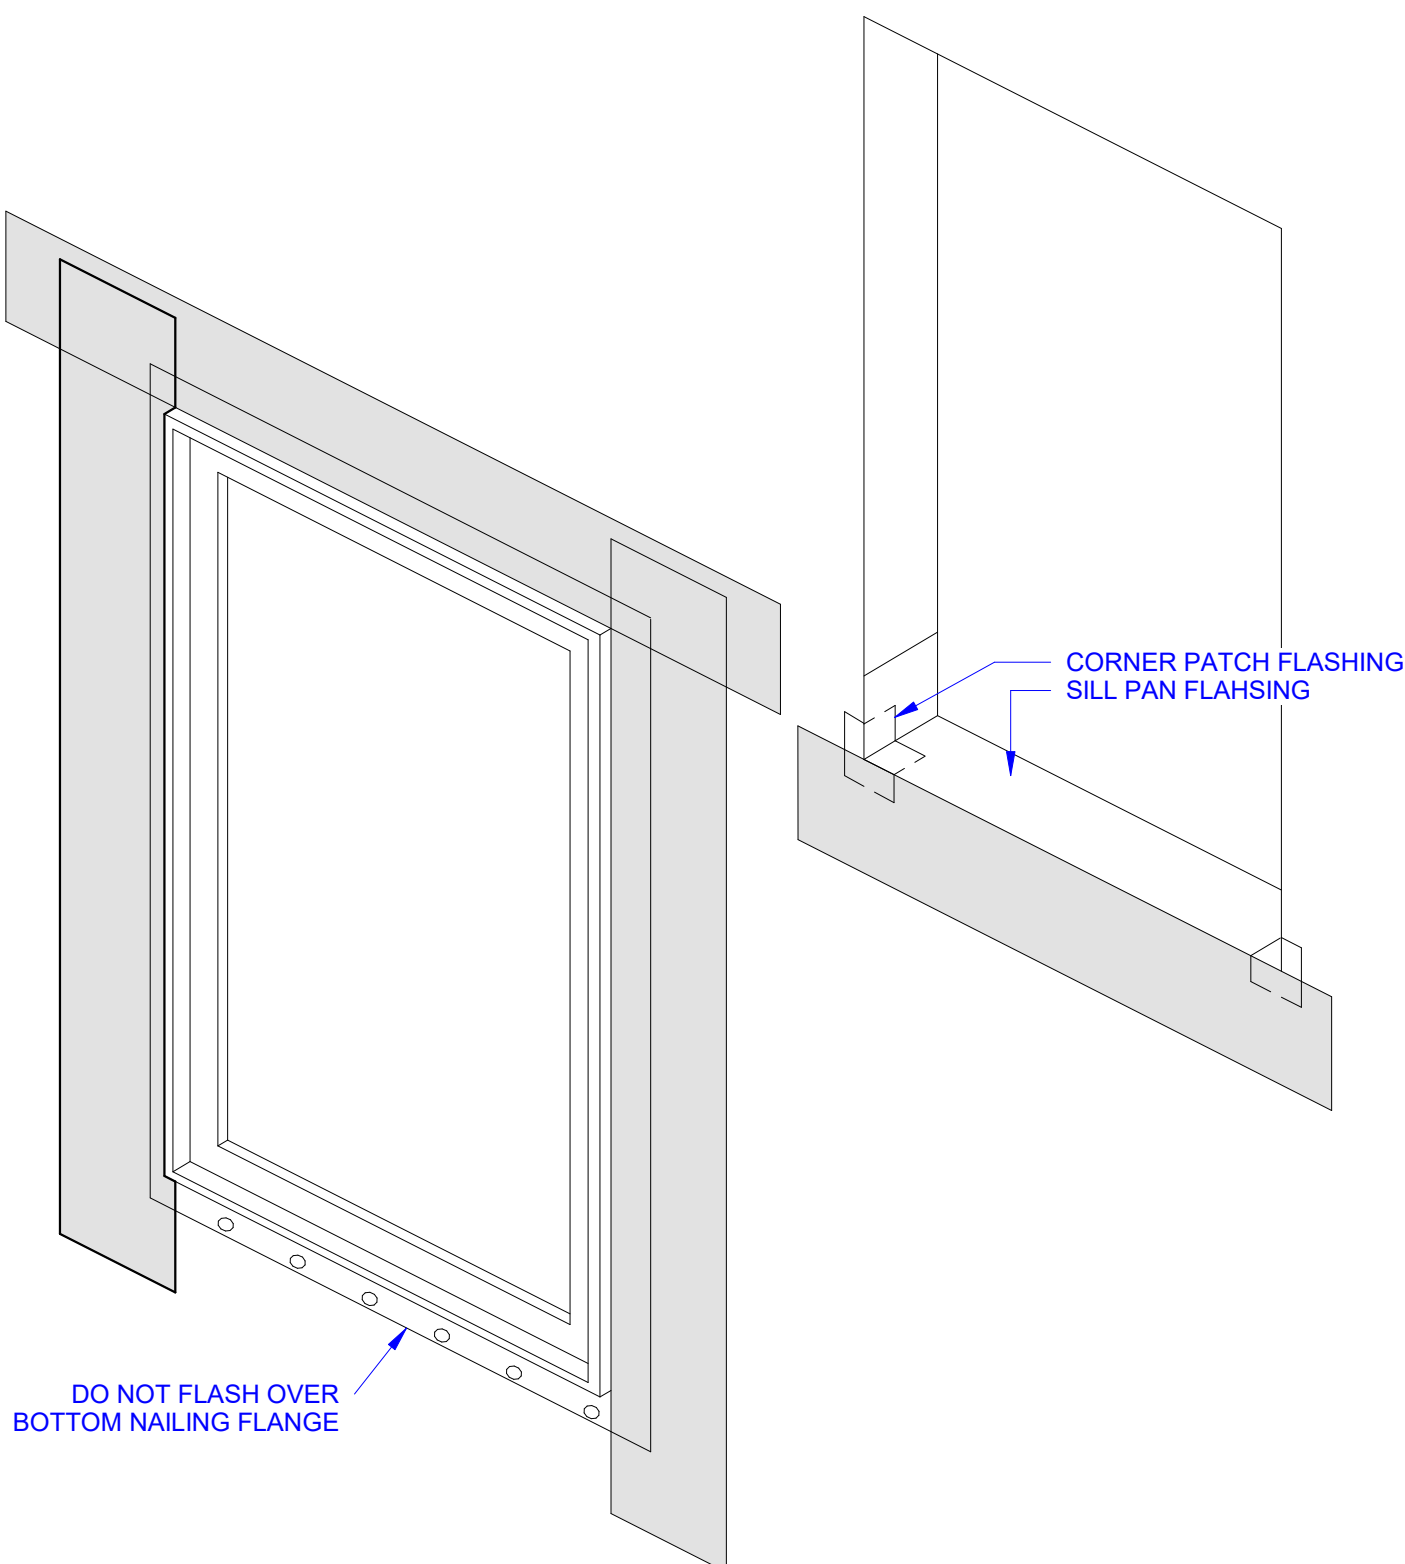


WINDOW AND DOOR FLASHING DIAGRAM
REFER TO MANUFACTURERS GUIDELINES FOR INSTALLING WINDOW,
INCLUDING THE ADDITION OF FLEXIBLE CORNER FLASHING.

REFLECTED CEILING PLAN LEGEND

- 1/2" GYPSUM BOARD
- VENTED VINYL SOFFIT
- F3 PENDANT LIGHT FIXTURE
- F9 WALL MOUNT FIXTURE
- F5 EXHAUST FAN
- F8 MOTION SENSOR FLOOD LIGHT
- CEILING FAN W/ LIGHT KIT
- COMBO SMOKE & CARBON MONOXIDE DETECTOR
- F10 CEILING MOUNTED FIXTURE
- F4 ISLAND PENDANT FIXTURE
- 10x10 DIFFUSER, SEE MECHANICAL
- 8x4 DIFFUSER, SEE MECHANICAL
- 12x6 DIFFUSER, SEE MECHANICAL
- 10x6 DIFFUSER, SEE MECHANICAL
- 14x8 DIFFUSER, SEE MECHANICAL

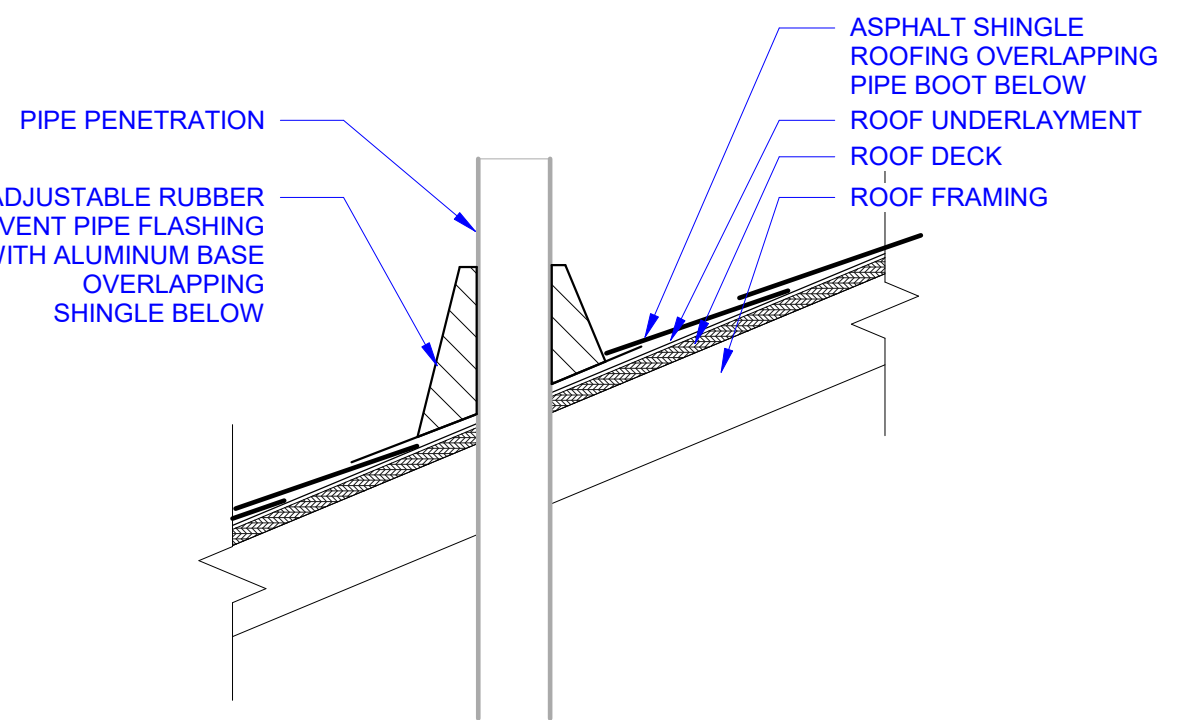

8 ROOF PENETRATION DETAIL
1 1/2" = 1'-0"

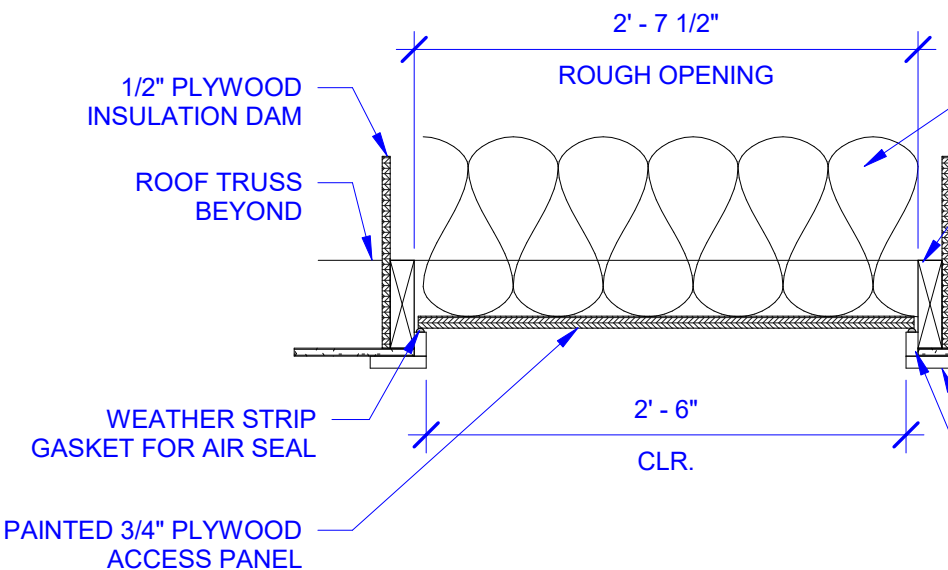

6 ATTIC ACCESS
1" = 1'-0"

Digitally signed
by Imbrie M Packard
Date: 2023.04.15 13:15 -05'00'

No.	Description	Date

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYVIEW DR.
LAKE CITY, FL 32025

REFLECTED CEILING PLAN
AND INTERIOR ELEVATIONS

Project Number 2019-15
Date 04/11/2023
Drawn By ZP
Checked By IP
FOR CONSTRUCTION

STATE OF FLORIDA
IMBRIE M. O. PACKARD
ART100378
REGISTERED ARCHITECT



FINISH TYPE SCHEDULE					
MARK	DESCRIPTION	MANUFACTURER	MODEL	FINISH	COMMENTS
VPF	VINYL PLANK FLOORING	SEE SPECS	SEE SPECS	SEE SPECS	STANDARD GRADE, CERTIFIED BY FLOORSORE OR GREENGAURD AS LOW VOC
CPT	CARPET	SEE SPECS	SEE SPECS	SEE SPECS	STANDARD GRADE, CERTIFIED BY THE CARPET AND RUG INSTITUTE (CRI) GREEN SEAL OF APPROVAL AND LOW-VOC OR NO ADHESIVES ARE USED FOR INSTALLATION
B1	WOOD BASE	SEE SPECS	SEE SPECS	SEE SPECS	BASEBOARDS WILL BE 3 1/4 INCH MDF. 3/4" SHOE MOULDING. NO EXPOSED UREA-FORMALDEHYDE WOOD PRODUCTS ALLOWED OR MUST BE SEALED
B2	WOOD BASE W/SHOE MOULDING	SEE SPECS	SEE SPECS	SEE SPECS	BASEBOARDS WILL BE 3 1/4 INCH MDF. 3/4" SHOE MOULDING. NO EXPOSED UREA-FORMALDEHYDE WOOD PRODUCTS ALLOWED OR MUST BE SEALED
GYP. PTD.	PAINTED GYPSUM BOARD	SEE SPECS	SEE SPECS	SEE SPECS	LEVEL 4 FINISH WITH LIGHT ORANGE PEEL TEXTURE, PRIMED AND 2 FINISH COATS
WP GYP. PTD.	1/2 MOISTURE RESISTANT GYPSUM BOARD	SEE SPECS	SEE SPECS	SEE SPECS	LEVEL 4 FINISH WITH LIGHT ORANGE PEEL TEXTURE, PRIMED AND 2 FINISH COATS
KIT-CAB	KITCHEN CABINETS	SEE SPECS	SEE SPECS	SEE SPECS	
KIT-COUN	KITCHEN COUNTERTOPS	SEE SPECS	SEE SPECS	SEE SPECS	POST-FORMED LAMINATE
BATH-CAB	BATHROOM CABINETS	SEE SPECS	SEE SPECS	SEE SPECS	STANDARD GRADE PREFINISHED WITH HARDWARE. NO EXPOSED UREA-FORMALDEHYDE WOOD PRODUCTS ALLOWED OR MUST BE SEALED
BATH-COUN	BATHROOM COUNTERTOPS	SEE SPECS	SEE SPECS	SEE SPECS	CULTURED MARBLE WITH MOLDED SINK
*CONFIRM ALL FINISH TYPES WITH OWNER PRIOR TO PURCHASE AND INSTALLATION					

VOC LIMITS

PAINTS APPLIED TO INTERIOR WALLS:
FLATS: 50 G/L NONFLATS: 100 G/L
GREEN SEAL STANDARD GS-11, PAINTS & COATINGS, 3RD EDITION, AUGUST 17, 2011

ANTI CORROSIVE AND ANTI RUST PAINTS:
250 G/L GREEN SEAL STANDARD GS-11, PAINTS & COATINGS, 3RD EDITION, AUGUST 17, 2011

CLEAR WOOD FINISHES:
VARNISH: 350 G/L LACQUER: 550 G/L SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1113, ARCHITECTURAL COATINGS

FLOOR COATINGS: 100 G/L

SEALERS:
WATERPROOFING: 250 G/L
SANDING: 275 G/L
ALL OTHERS: 200 G/L

SHELLACS CLEAR: 730 G/L PIGMENTED: 550 G/L

STAINS: 250 G/L

BATHROOM ACCESSORY NOTES:

- PROVIDE BLOCKING FOR ALL ACCESSORIES AS REQUIRED
- PROVIDE AND INST ALL 1 EACH OF THE FOLLOWING BATHROOM ACCESSORIES:
 - TOILET PAPER HOLDER
 - ROBE HOOK
 - TOWEL BAR

CABINETERY / COUNTERTOP NOTES:

- KITCHEN COUNTERTOPS WILL BE POST-FORMED LAMINATE WITH INTEGRAL 4" BACKSPLASH.
- KITCHEN WILL HAVE DOUBLE BASIN STAINLESS STEEL SINK WITH GARBAGE DISPOSER AND FAUCET WITH SPRAYER.
- BATHROOM CABINETS WILL BE STANDARD GRADE PREFINISHED WITH HARDWARE. NO EXPOSED UREA-FORMALDEHYDE WOOD PRODUCTS ALLOWED OR MUST BE SEALED.
- BATHROOM COUNTERTOPS WILL BE CULTURED MARBLE WITH MOLDED SINK AND 4" BACKSPLASH.
- BATHROOM WILL HAVE FAUCET AT EACH SINK.
- BATHROOMS WILL HAVE A 6 SQUARE FOOT MIRROR AT EACH SINK.

FLOORING / MOLDING NOTES:

- BEDROOM AND BEDROOM CLOSET FLOORING WILL BE STANDARD GRADE CARPET AND PAD. CARPET AND PAD MUST BE CERTIFIED BY THE CARPET AND RUG INSTITUTE (CRI) GREEN SEAL OF APPROVAL AND LOW-VOC OR NO ADHESIVES ARE USED FOR INSTALLATION.
- ALL OTHER ROOMS AND CLOSETS WILL BE STANDARD GRADE VINYL PLANK FLOORING.
- VINYL PLANK FLOORING SHALL BE CERTIFIED BY FLOORSORE OR GREENGUARD AS LOW VOC.
- BASEBOARDS WILL BE 3 ¼ INCH MDF. NO EXPOSED UREA-FORMALDEHYDE WOOD PRODUCTS ALLOWED OR MUST BE SEALED
- SHOE MOLD TO BE INSTALLED ON ALL AREAS WITH VINYL PLANK FLOORING.

APPLIANCE NOTES:

- WHITE OR BLACK FINISHES
- RANGE FREESTANDING ELECTRIC STANDARD GRADE. OVEN MUST BE SELF CLEANING.
- MICROWAVE OVEN OVER RANGE WITH BUILT-IN HOOD STANDARD GRADE.
- SUPPLY HOSES TO WATER USING FIXTURES AND APPLIANCES MUST BE ARMORED, PEX OR METAL (EXCEPT COPPER).
- REFRIGERATOR TOP FREEZER 22 CUBIC FOOT STANDARD GRADE ENERGY STAR.
- DISHWASHER STANDARD GRADE ENERGY STAR.
- GARBAGE DISPOSER ½ HP STANDARD GRADE.
- WASHING MACHINE TOP LOADING STANDARD GRADE ENERGY STAR.
- DRYER ELECTRIC STANDARD GRADE ENERGY STAR.

CLOSET NOTES:

- ALL CLOSETS WILL HAVE STANDARD GRADE VINYL-COATED WIRE MESH SHELVEING.

DRYWALL NOTES:

- ½ INCH SAG RESISTANT DRYWALL HUNG, TAPED, FLOATED, AND TEXTURED READY FOR PAINT ON WALLS AND CEILINGS.
- ALL WET AREAS AS REQUIRED PER FLORIDA BUILDING CODE WILL HAVE ½ INCH WATER ROCK (GREENBOARD) DRYWALL HUNG, TAPED, FLOATED, AND TEXTURED READY FOR PAINT ON WALLS AND CEILINGS. IN LIEU OF GREENBOARD REQUIRE CEMENT BOARD WITH TAPED SEAMS. ALL SHOWER WALLS MUST BE SEALED WITH AN ELASTOMERIC WATERPROOFING SEALER PRIOR TO TILE INSTALL. ALL FIBERGLASS INSERT MUST HAVE EDGES SEALED WITH WATERPROOFING CAULK.

DOOR NOTES:

- ALL DOORS AND TRIM WILL BE PAINTED. ALL PAINTS SHALL BE LOW VOC - MAXIMUM 50 G/L.
- ALL EXTERIOR DOOR LOCKS WILL BE KEYED ALIKE.
- ALL INTERIOR DOORS WILL CONTAIN THE APPROPRIATE DOOR KNOBS.
- ALL INTERIOR DOORS WILL HAVE 2 ¼ INCH MDF TRIM. NO EXPOSED UREA-FORMALDEHYDE WOOD PRODUCTS ALLOWED OR SEALED
- ATTIC ACCESS WILL BE PAINTED PLWOOD ACCESS PANEL PER DETAIL MEETING REQUIREMENTS OF FBC R807.

FINISH SCHEDULE							
Number	Name	Floor Finish	Base Finish	Wall Finish	Ceiling Finish	Perimeter	Area
01	LIVING ROOM	VPF	B2	GYP. PTD.	GYP. PTD.	102.63	445 SF
02	BATH	VPF	B2	GYP. PTD.	GYP. PTD.	27.83	45 SF
03	BEDROOM	CPT	B1	GYP. PTD.	GYP. PTD.	48.17	143 SF
04	CLOSET	CPT	B1	GYP. PTD.	GYP. PTD.	21.29	28 SF
05	PANTRY	VPF	B2	GYP. PTD.	GYP. PTD.	22.96	33 SF
06	KITCHEN	VPF	B2	GYP. PTD.	GYP. PTD.	53.67	170 SF
07	DINING	VPF	B2	GYP. PTD.	GYP. PTD.	37.46	83 SF
08	LAUNDRY	VPF	B2	WP GYP. PTD.	GYP. PTD.	27.83	45 SF
09	BEDROOM	CPT	B1	GYP. PTD.	GYP. PTD.	48.17	143 SF
11	CLOSET	CPT	B1	GYP. PTD.	GYP. PTD.	19.04	19 SF
12	BATH	VPF	B2	WP GYP. PTD.	GYP. PTD.	44.17	84 SF
13	CLOSET	CPT	B1	GYP. PTD.	GYP. PTD.	23.25	32 SF
14	BEDROOM	CPT	B1	GYP. PTD.	GYP. PTD.	51.17	159 SF
15	MECH	VPF	B1	GYP. PTD.	GYP. PTD.	13.04	10 SF
Grand total: 14							1440 SF

PLUMBING FIXTURE SCHEDULE					
ROOM	ITEM	MANUFACTURER	MODEL	NOTES	QUANTITY
02	VANITY SINK	SEE SPECS	SEE SPECS		1
12	VANITY SINK	SEE SPECS	SEE SPECS		2
02	VANITY FAUCET	SEE SPECS	SEE SPECS	1.5 GPM	1
12	VANITY FAUCET	SEE SPECS	SEE SPECS	1.5 GPM	2
02	SHOWER AND TUB FAUCET	SEE SPECS	SEE SPECS	2.0 GPM	1
12	SHOWER FAUCET	SEE SPECS	SEE SPECS	2.0 GPM	1
02	BATHTUB & ENCLOSURE	SEE SPECS	SEE SPECS		1
12	SHOWER BASE & ENCLOSURE	SEE SPECS	SEE SPECS		1
06	KITCHEN SINK	SEE SPECS	SEE SPECS	DOUBLE BASIN STAINLESS STEEL	1
06	KITCHEN FAUCET	SEE SPECS	SEE SPECS	2.0 GPM	1
*VERIFY FIXTURES AND LOCATIONS WITH ARCHITECTURAL PLAN AND OWNER. ALL PLUMBING FIXTURES SHALL BE WATERSENSE					

THERMAL ENVELOPE REQUIREMENTS	
TYPE	REQUIREMENT
SEALANT	SEAL ALL GAPS AND PENETRATIONS IN BUILDING ENVELOPE WITH LOW VOC SEALANT OR SPRAY FOAM. ALL INSULATION SHALL BE FORMALDEHYDE FREE.
RAISED FLOOR INSULATION	R-19 INSULATION IN CONTACT WITH THE SUBFLOOR. ALL BATT INSULATION SHALL BE UNFACED OR INSTALLED WITH PAPER BACKING TO THE OUTSIDE OF THE HOUSE.
WALL INSULATION	R-19 BATT INSULATION
ATTIC INSULATION	MIN. R-38 BLOW-IN INSULATION PER MANUFACTURER'S SPECIFICATIONS TO A MINIMUM DENSITY OF 3.5 LBS. PER CUBIC FOOT (CF).
MOISTURE BARRIER	CONTINUOUS UNBROKEN MOISTURE BARRIER (HOUSE WRAP)
RADIANT BARRIER	RADIANT BARRIER FOIL INSTALLED AT UNDERSIDE OF ROOF
ROOF	PLYWOOD ROOF SHEATHING PER STRUCTURAL. ROOF UNDERLAYMENT PER FBC - RESIDENTIAL R905.1.1, ASPHALT SHINGLE ROOF. SEE ROOF PLAN
VENTED ATTIC SPACE	1FT PER 150 FT ROOF AREA. SEE CALCULATIONS ON ROOF PLAN
WINDOWS	ENERGY STAR QUALIFIED, SEE WINDOW NOTES ON SHEET A1.1
EXTERIOR DOORS	ENERGY STAR QUALIFIED DOORS
FL ECC 2020	MEET REQUIREMENTS OF SECTION R402, AND TABLE R402.1.2
FORM R402-2020	CONTRACTOR REQUIRED TO COMPLETE FORM R402-2020 RESIDENTIAL BUILDING THERMAL ENVELOPE APPROACH FOR THE APPROPRIATE CLIMATE ZONE.

APPLIANCE SCHEDULE					
ROOM	ITEM	MANUFACTURER	MODEL	FINISH	NOTES
KITCHEN	MICROWAVE	SEE SPECS	SEE SPECS	SEE SPECS	OR APPROVED EQUAL
KITCHEN	RANGE	SEE SPECS	SEE SPECS	SEE SPECS	FREESTANDING ELECTRIC STANDARD GRADE OR APPROVED EQUAL, OVEN MUST BE SELF CLEANING
KITCHEN	DISHWASHER	SEE SPECS	SEE SPECS	SEE SPECS	OR APPROVED EQUAL, ENERGY STAR RATED
KITCHEN	REFRIDGERATOR	SEE SPECS	SEE SPECS	SEE SPECS	REFRIDGERATOR TOP FREEZER 22 CUBIC FOOT STANDARD GRADE OR APPROVED EQUAL
LAUNDRY	WASHER	SEE SPECS	SEE SPECS	SEE SPECS	OR APPROVED EQUAL, ENERGY STAR RATED
LAUNDRY	DRYER	SEE SPECS	SEE SPECS	SEE SPECS	OR APPROVED EQUAL, ENERGY STAR RATED
MECH	HOT WATER HEATER	SEE SPECS	SEE SPECS	SEE SPECS	OR APPROVED EQUAL
KITCHEN	GARBAGE DISPOSAL	SEE SPECS	SEE SPECS	SEE SPECS	1/2 HP STANDARD GRADE OR APPROVED EQUAL
*SUPPLY HOSES TO WATER USING FIXTURES AND APPLIANCES MUST BE ARMORED, PEX OR METAL (EXCEPT COPPER)					

STAIR AND RAILING REQUIREMENTS	
TYPE	REQUIREMENT
MIN. WIDTH	36"
MIN. HEAD HEIGHT	6' 8"
MAX. RISER HEIGHT	7 3/4"
MIN. TREAD DEPTH	10"
TREAD NOSING	MIN. 3/4", MAX. 11/4"
MAX. TREAD SLOPE	1/4" FROM BACK TO NOSING
HANDRAILS	REQUIRED IF 4 OR MORE RISERS
HANDRAIL HEIGHT	34"-38"
HANDRAIL PROFILE	DIAMETER 1 1/4" - 2"
GUARDRAILS	REQUIRED AT OPEN PORCHES, BALCONIES, RAMPS, OR RAISED FLOOR SURFACES THAT ARE 30" OR MORE ABOVE THE FLOOR BELOW
MIN. GUARDRAIL HEIGHT	36"
GUARDRAIL OPENING LIMITATIONS	MUST NOT ALLOW PASSAGE OF 4" SPHERE
LANDINGS	REQUIRED AT TOP & BOTTOM
MIN. LANDING SIZE	36" x 36"
DOORS	ENERGY STAR QUALIFIED DOORS
MAX. STAIR VERTICAL RISE	147" BETWEEN LEVELS OR LANDINGS

LIGHT FIXTURE SCHEDULE					
MARK	DESCRIPTION	MANUFACTURER	MODEL	COMMENTS	QUANTITY
F1	INTERIOR RECESSED CAN	SEE SPECS	SEE SPECS		0
F2	EXTERIOR RECESSED CAN	SEE SPECS	SEE SPECS		0
F3	CHANDELIER	SEE SPECS	SEE SPECS		1
F4	ISLAND PENDANT	SEE SPECS	SEE SPECS		3
F5	EXHAUST FAN	SEE SPECS	SEE SPECS		2
F6	CEILING FAN W/ LIGHT KIT	SEE SPECS	SEE SPECS		4
F7	RECESSED CAN (WET RATED)	SEE SPECS	SEE SPECS		0
F8	EXTERIOR FLOOD LIGHT	SEE SPECS	SEE SPECS		4
F9	VANITY FIXTURE	SEE SPECS	SEE SPECS		5
F10	CEILING MOUNTED FIXTURE	SEE SPECS	SEE SPECS		17
*CONFIRM ALL FIXTURES AND SWITCHING TYPES WITH OWNER PRIOR TO PURCHASE AND INSTALLATION					

BATHROOM ACCESSORY SCHEDULE					
ROOM	DESCRIPTION	MANUFACTURER	MODEL	FINISH	COMMENTS
02	TOILET PAPER HOLDER	SEE SPECS	SEE SPECS	SEE SPECS	PROVIDE AND INSTALL ONE
12	TOILET PAPER HOLDER	SEE SPECS	SEE SPECS	SEE SPECS	PROVIDE AND INSTALL ONE
02	ROBE HOOK	SEE SPECS	SEE SPECS	SEE SPECS	PROVIDE AND INSTALL ONE
12	ROBE HOOK	SEE SPECS	SEE SPECS	SEE SPECS	PROVIDE AND INSTALL ONE
02	TOWEL BAR	SEE SPECS	SEE SPECS	SEE SPECS	PROVIDE AND INSTALL ONE
12	TOWEL BAR	SEE SPECS	SEE SPECS	SEE SPECS	PROVIDE AND INSTALL ONE
*PROVIDE BLOCKING FOR ALL ACCESSORIES AS REQUIRED					

Digitally signed
by Imbrie M
Packard
Date: 2023.04.12
'13:13:30 -05'00

Date									
Description									
No.									

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG


REBUILD FLORIDA
636 SE BAYLA DR.
LAKE CITY, FL 32025

SCHEDULES AND NOTES







Project Number	2019-15
Date	04/11/2023
Drawn By	ZP
Checked By	IP
FOR CONSTRUCTION	

This item has been
digitally signed and
sealed by Imbrie
Packard architect on
the date specified.

Printed copies of this
document are not
considered signed
and sealed and the
signature must be
verified on any
electronic copies.



A-4



ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS ST.
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net


ID-014432 COKER 3 BR
SOG


VINYL SIDING DETAILS FOR
SLAB ON GRADE

FOR CONSTRUCTION


This item has been digitally signed and sealed by **Imbrie Packard** architect on the date specified.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

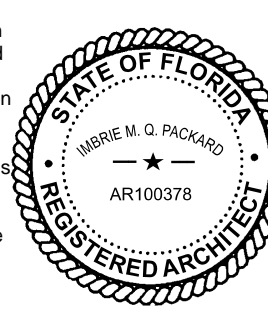


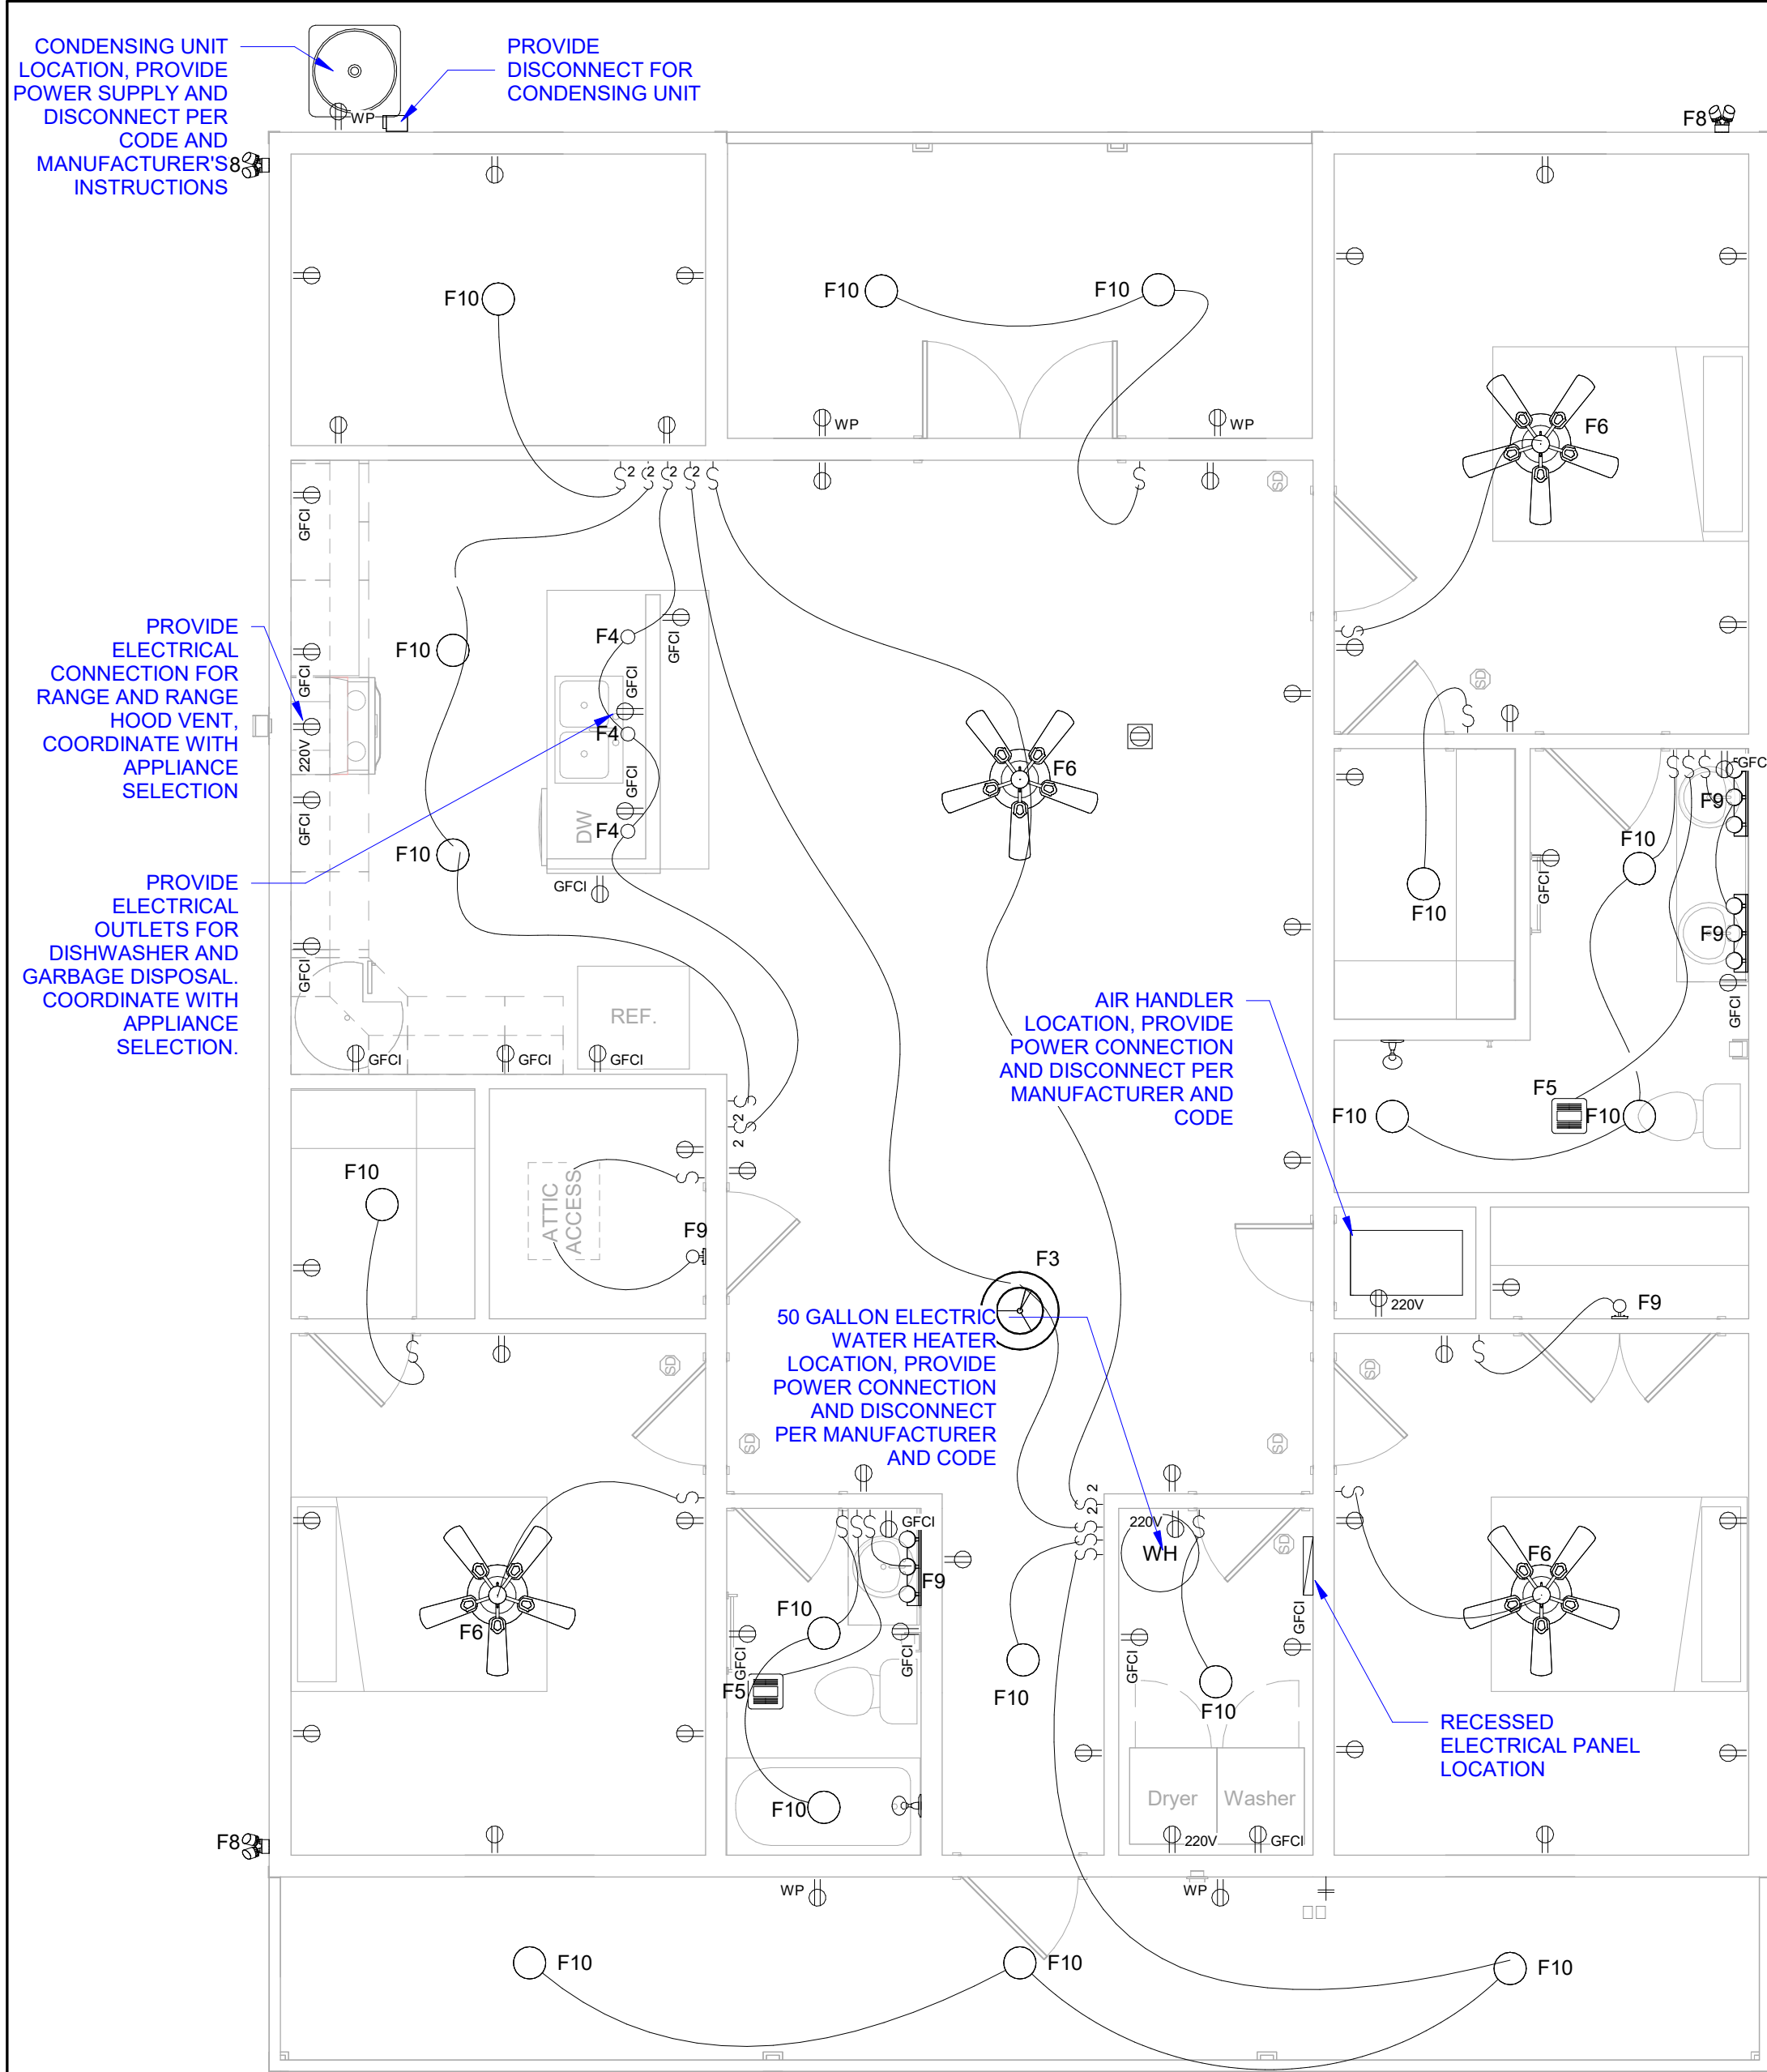

ELECTRICAL LEGEND

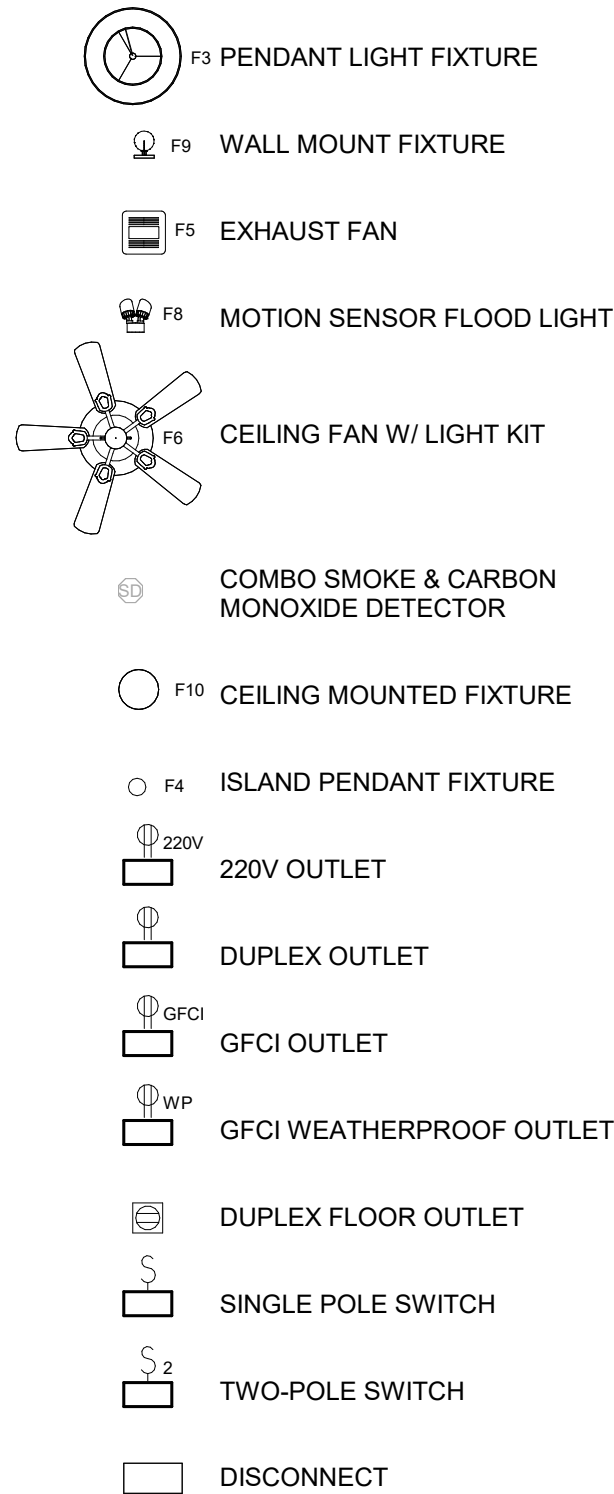

1 LIGHTING AND OUTLET LOCATION PLAN
1/4" = 1'-0"

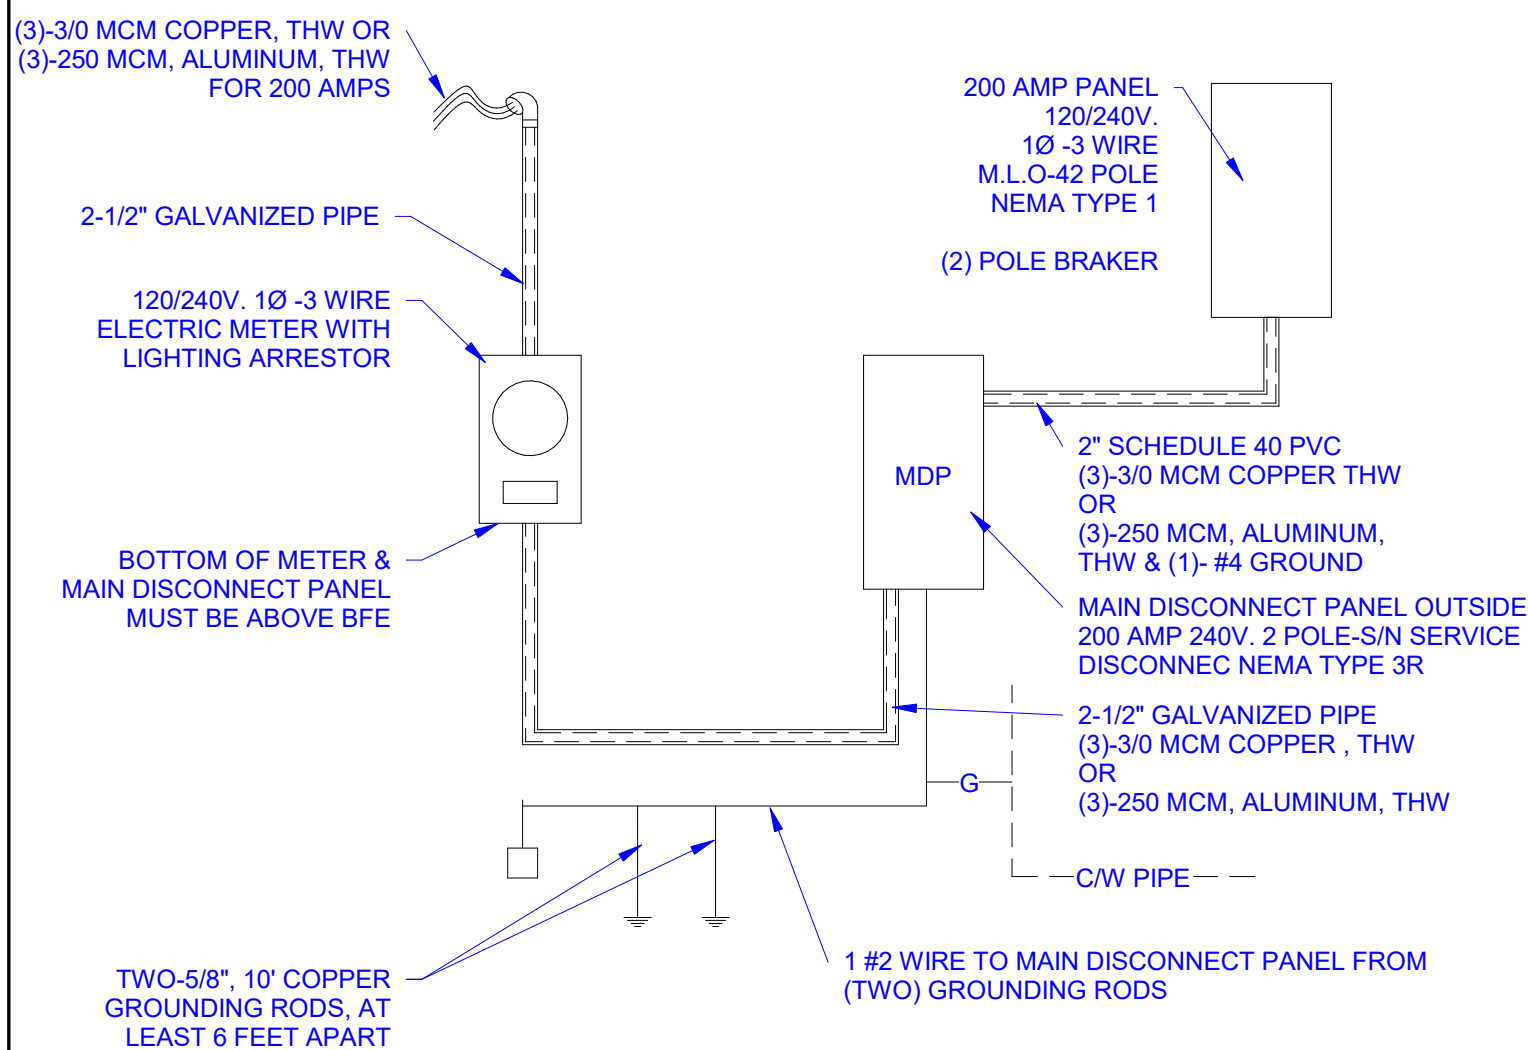


2 OVERHEAD ELECTRICAL RISER DIAGRAM
3/8" = 1'-0"

ELECTRICAL NOTES:

- ELECTRICAL WORK SHALL BE DESIGN BUILD BY ELECTRICAL SUBCONTRACTOR.
- ELECTRICAL CONTRACTOR SHALL BE LICENSED AND RESPONSIBLE TO MEET ALL APPLICABLE REQUIREMENTS BY CODE
- ELECTRICAL CONTRACTOR TO COORDINATE ELECTRICAL DRAWINGS WITH ARCHITECTURAL, STRUCTURAL, AND MECHANICAL DRAWINGS. CONTRACTOR IS RESPONSIBLE TO COORDINATE ANY DISCREPANCIES AND NOTIFY THE ARCHITECT PRIOR TO PROCEEDING WITH WORK. PROVIDE SERVICE CONNECTION AND PROPER GROUNDING. PROVIDE ALL WIRING AND EQUIPMENT FOR ALL FIXTURES AND EQUIPMENT INDICATED IN ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DRAWINGS PER CODE.
- COMBINATION SMOKE AND CARBON MONOXIDE DETECTORS SHALL BE INSTALLED OUTSIDE OF EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS AND ON EACH ADDITIONAL STORY OF THE DWELLING. ALL DETECTORS SHALL BE APPROVED AND LISTED IN ACCORDANCE UL 217 UL 2034 WITH THE MANUFACTURER'S INSTRUCTIONS. REQUIRED SMOKE DETECTORS SHALL RECEIVE THEIR PRIMARY SOURCES FROM THE BUILDING WIRING, AND WHEN PRIMARY POWER IS INTERRUPTED, SHALL RECEIVE POWER FROM A BATTERY. COMBINATION SMOKE AND CARBON MONOXIDE DETECTORS SHALL BE INSTALLED PER SECTIONS R314 AND R315 OF THE 2020 FRC
- ALL LIGHTING FIXTURES SHALL BE ENERGY STAR QUALIFIED FIXTURES
- ALL LIGHTING FIXTURES SHALL BE LED AND INCLUDE LED BULBS
- ALL OUTLETS SHALL BE INSTALLED MIN. 15" FROM FFE
- ALL LIGHT SWITCHES, THERMOSTAT, CONTROLS, SHALL BE INSTALLED AT HEIGHT MIN. 36" FROM FFE AND MAX. 48" FROM FFE.
- PROVIDE POWER TO VERTICAL PLATFORM LIFT PER MANUFACTURER'S REQUIREMENTS.
- ALL RECEPTACLES SHALL BE TAMPER RESISTANT
- ALL FIXTURES AND DEVICES SHALL BE UL LISTED
- ALL 120-VOLT, SINGLE-PHASE, 15- AND 20-AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES INSTALLED IN DWELLING UNIT KITCHENS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY AFCIs.
- CONTRACTOR SHALL PROVIDE ELECTRICAL LOAD CALCULATIONS AND ANY ADDITIONAL ELECTRICAL INFORMATION REQUESTED BY PERMIT DEPARTMENT NOT SHOWN IN DRAWINGS.

NOTES:

- CATV OR TELEPHONE CABLE SHALL NOT BE ATTACHED TO THE SERVICE MAST.
- FOR SPECIFIC HEIGHT REQUIREMENTS & CLEARANCE, REFER TO N.E.C. AND LOCAL CODES.
- SERVICE RISER SHALL BE 2" MINIMUM RIGID METAL CONDUIT
- SERVICE RISER MUST WITHSTAND 200 LBS. OF CONTINUOUS PULL.
- MAXIMUM CONDUIT HEIGHT ABOVE THE ROOF IS 48".

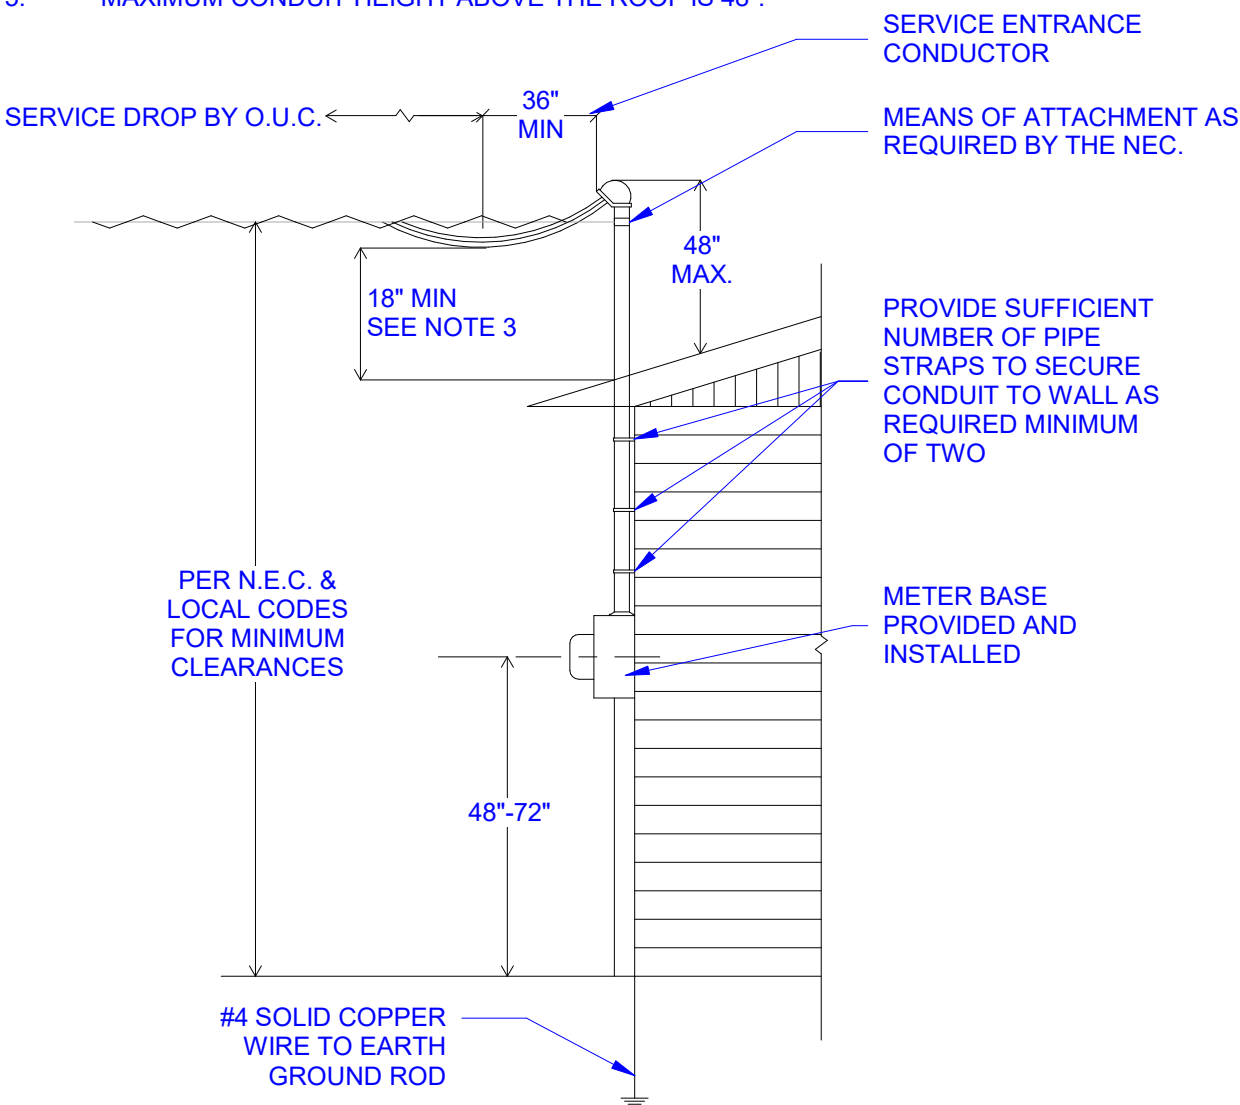

3 TYPICAL OVERHEAD RESIDENTIAL SERVICE INSTALLATION
3/8" = 1'-0"

SPECIFICATIONS:		SQUARE D QO OR EQUAL				PANEL-A				MAINS:		MLO																																													
AMPACITY:		200 AMPS								LOCATION:		LAUNDRY																																													
VOLTAGE:		120/240V, 1PH, 3 WIRE								MOUNTING:		RECESSED																																													
AMPS	POLE	TOTAL VA	WIRE SIZE	GRD SIZE	DESCRIPTION	CIRCUIT No.	CIRCUIT No.	DESCRIPTION	GRD SIZE	WIRE SIZE	TOTAL VA	POLE	AMPS																																												
30	2	5984	10	10	AHU-1	1	2	DRYER	10	10	5000	2	30																																												
30	2		10	10		3	4		10	10	2	30																																													
25	2	*	10	10	AHU-1	5	6	RANGE	10	6	8500	2	50																																												
25	2		10	10		7	8		10	6	2	50																																													
30	2	4500	10	10	WATER HEATER	9	10	SPACE																																																	
30	2		10	10		11	12	SPACE																																																	
20	1	720	12	12	RECEPT. FRONT ENTRANCE	13	14	RECEPT. LIVING ROOM	12	12	720	1	20																																												
20	1	900	12	12	RECEPT. BACK ENTRANCE	15	16	RECEPT. LIVING ROOM	12	12	720	1	20																																												
20	1	900	12	12	RECEPT. DINING ROOM	17	18	L.T.S. MASTER BED/KITCHEN/LIVING	12	12	#	1	20																																												
20	1	1260	12	12	RECEPT. MASTER BEDROOM	19	20	L.T.S. BEDROOMS/LAUNDRY/PANTRY	12	12	#	1	20																																												
20	1	920	12	12	RECEPT. /LTS MASTER BATHROOM	21	22	L.T.S. OUTDOOR FLOOD LIGHTS	12	12	#	1	20																																												
20	1	1260	12	12	RECEPT. BEDROOM #1	23	24	SMALL APPLIANCE	12	12	1500	1	20																																												
20	1	1260	12	12	RECEPT. BEDROOM #2	25	26	SMALL APPLIANCE	12	12	1500	1	20																																												
20	1	840	12	12	RECEPT. /LTS GUEST BATHROOM	27	28	SMALL APPLIANCE	12	12	1500	1	20																																												
20	1	360	12	12	RECEPT. LAUNDRY ROOM	29	30	DISPOSAL	12	12	1500	1	20																																												
20	1	300	12	12	RECIRC. PUMP	31	32	DISHWASHER	12	12	1500	1	20																																												
					SPACE	33	34	REFRIGERATOR	12	12	1200	1	20																																												
					SPACE	35	36	MICROWAVE	12	12	1200	1	20																																												
					SPACE	37	38	WASHER	12	12	1500	1	20																																												
					SPACE	39	40	SPACE																																																	
					SPACE	41	42	SPACE																																																	
<div><div><div>PANEL-A</div><div>DEMAND LOAD CALCULATIONS</div></div><div><table><tr><td>AREA (SQFT)</td><td>=</td><td>1,514</td><td></td></tr><tr><td>GENERAL LIGHTING LOAD @ 3VA PER SQ.FT.</td><td>=</td><td>4,542</td><td></td></tr><tr><td>TOTAL GENERAL LOAD</td><td>=</td><td>44,102</td><td>VA</td></tr><tr><td>RECEP. 1st 10,000 VA @ 100%</td><td>=</td><td>10,000 @ 100% =</td><td>10,000 VA</td></tr><tr><td>REST @40%</td><td>=</td><td>34,102 @ 40%=</td><td>13,641 VA</td></tr><tr><td>AIR CONDITIONERS @ 65%</td><td>=</td><td>5,984 @ 65%=</td><td>3,890 VA</td></tr><tr><td>OTHERS @ 100%</td><td>=</td><td>0 @ 100%=</td><td>0 VA</td></tr><tr><td colspan="4">TOTAL LOAD</td></tr><tr><td>TOTAL LOAD</td><td>=</td><td>27,530</td><td>VA</td></tr><tr><td>CURRENT PER PHASE</td><td>=</td><td colspan="2">TOTAL LOAD (VA) / (240V)</td></tr><tr><td></td><td>=</td><td>115</td><td>AMPS</td></tr></table></div></div> <div>NOTES: * NON SIMULTANEOUS LOAD. 100% OF COOLING IS LARGER THAN 65% OF HEAT. # INCLUDED IN GENERAL LIGHTING LOAD PER AREA.</div>														AREA (SQFT)	=	1,514		GENERAL LIGHTING LOAD @ 3VA PER SQ.FT.	=	4,542		TOTAL GENERAL LOAD	=	44,102	VA	RECEP. 1st 10,000 VA @ 100%	=	10,000 @ 100% =	10,000 VA	REST @40%	=	34,102 @ 40%=	13,641 VA	AIR CONDITIONERS @ 65%	=	5,984 @ 65%=	3,890 VA	OTHERS @ 100%	=	0 @ 100%=	0 VA	TOTAL LOAD				TOTAL LOAD	=	27,530	VA	CURRENT PER PHASE	=	TOTAL LOAD (VA) / (240V)			=	115	AMPS
AREA (SQFT)	=	1,514																																																							
GENERAL LIGHTING LOAD @ 3VA PER SQ.FT.	=	4,542																																																							
TOTAL GENERAL LOAD	=	44,102	VA																																																						
RECEP. 1st 10,000 VA @ 100%	=	10,000 @ 100% =	10,000 VA																																																						
REST @40%	=	34,102 @ 40%=	13,641 VA																																																						
AIR CONDITIONERS @ 65%	=	5,984 @ 65%=	3,890 VA																																																						
OTHERS @ 100%	=	0 @ 100%=	0 VA																																																						
TOTAL LOAD																																																									
TOTAL LOAD	=	27,530	VA																																																						
CURRENT PER PHASE	=	TOTAL LOAD (VA) / (240V)																																																							
	=	115	AMPS																																																						

VERIFY ALL EQUIPMENT LOAD, BREAKERS AND WIRE SIZES PRIOR TO INSTALLATION ORDERING OF MATERIALS

Date	
Description	
No.	

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYVIEW DR.
LAKE CITY, FL 32025

ELECTRICAL PLAN

Project Number 2019-15
Date 04/11/2023
Drawn By IP
Checked By JC
FOR CONSTRUCTION

Digitally signed
by Imbrie M
Packard
Date: 2023.04.12
'13:14:05 -05'00


This item has been digitally signed and sealed by Imbrie M. G. Packard architect on the date specified.

Printed copies of this document are not considered designed and sealed and the signature must be verified on any electronic copies.


IMBRIE M. G. PACKARD
ARCHITECT
REGISTERED ARCHITECT



MECHANICAL NOTE:
FLOOR PLANS ON MECHANICAL SHEETS MAY
DIFFER SLIGHTLY WITH ARCHITECTURAL.
MECHANICAL SHEETS ARE DIAGRAMMATIC
TO INDICATE SIZE AND APPROXIMATE
LOCATION OF MECHANICAL EQUIPMENT,
FIXTURES, AND COMPONENTS.

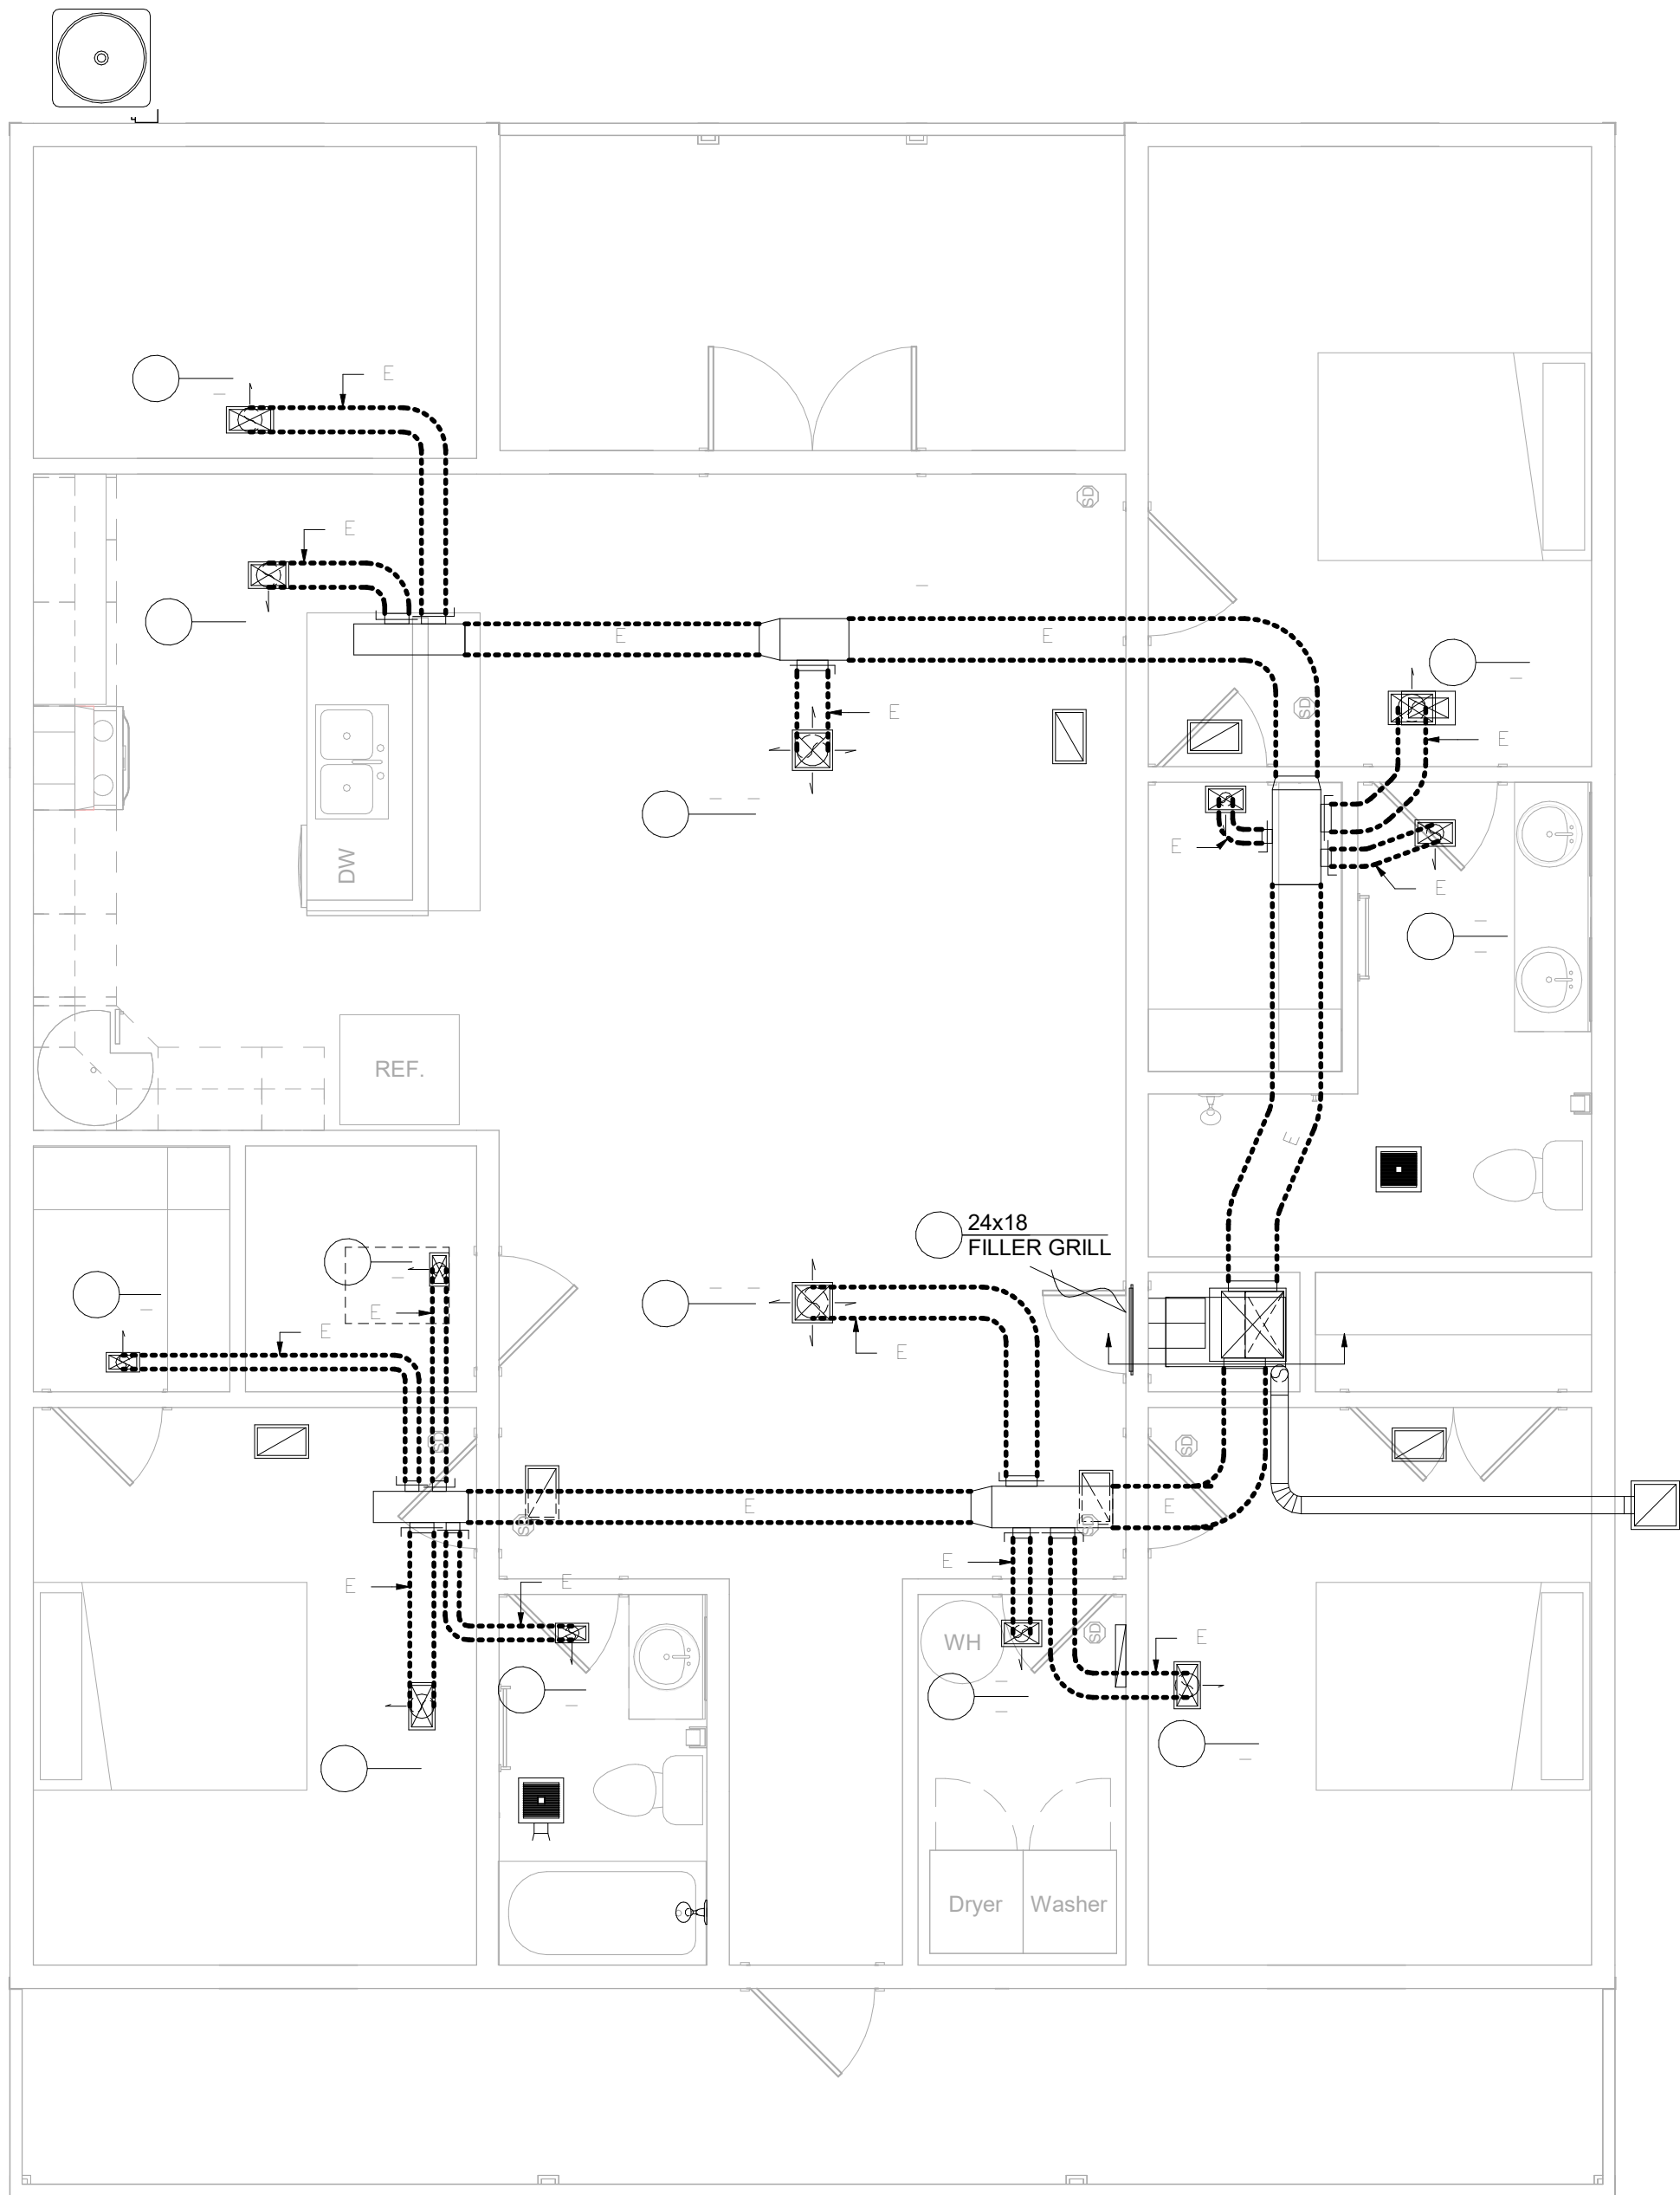


① COOLING AND HEATING DUCT SYSTEM
1/4" = 1'-0"

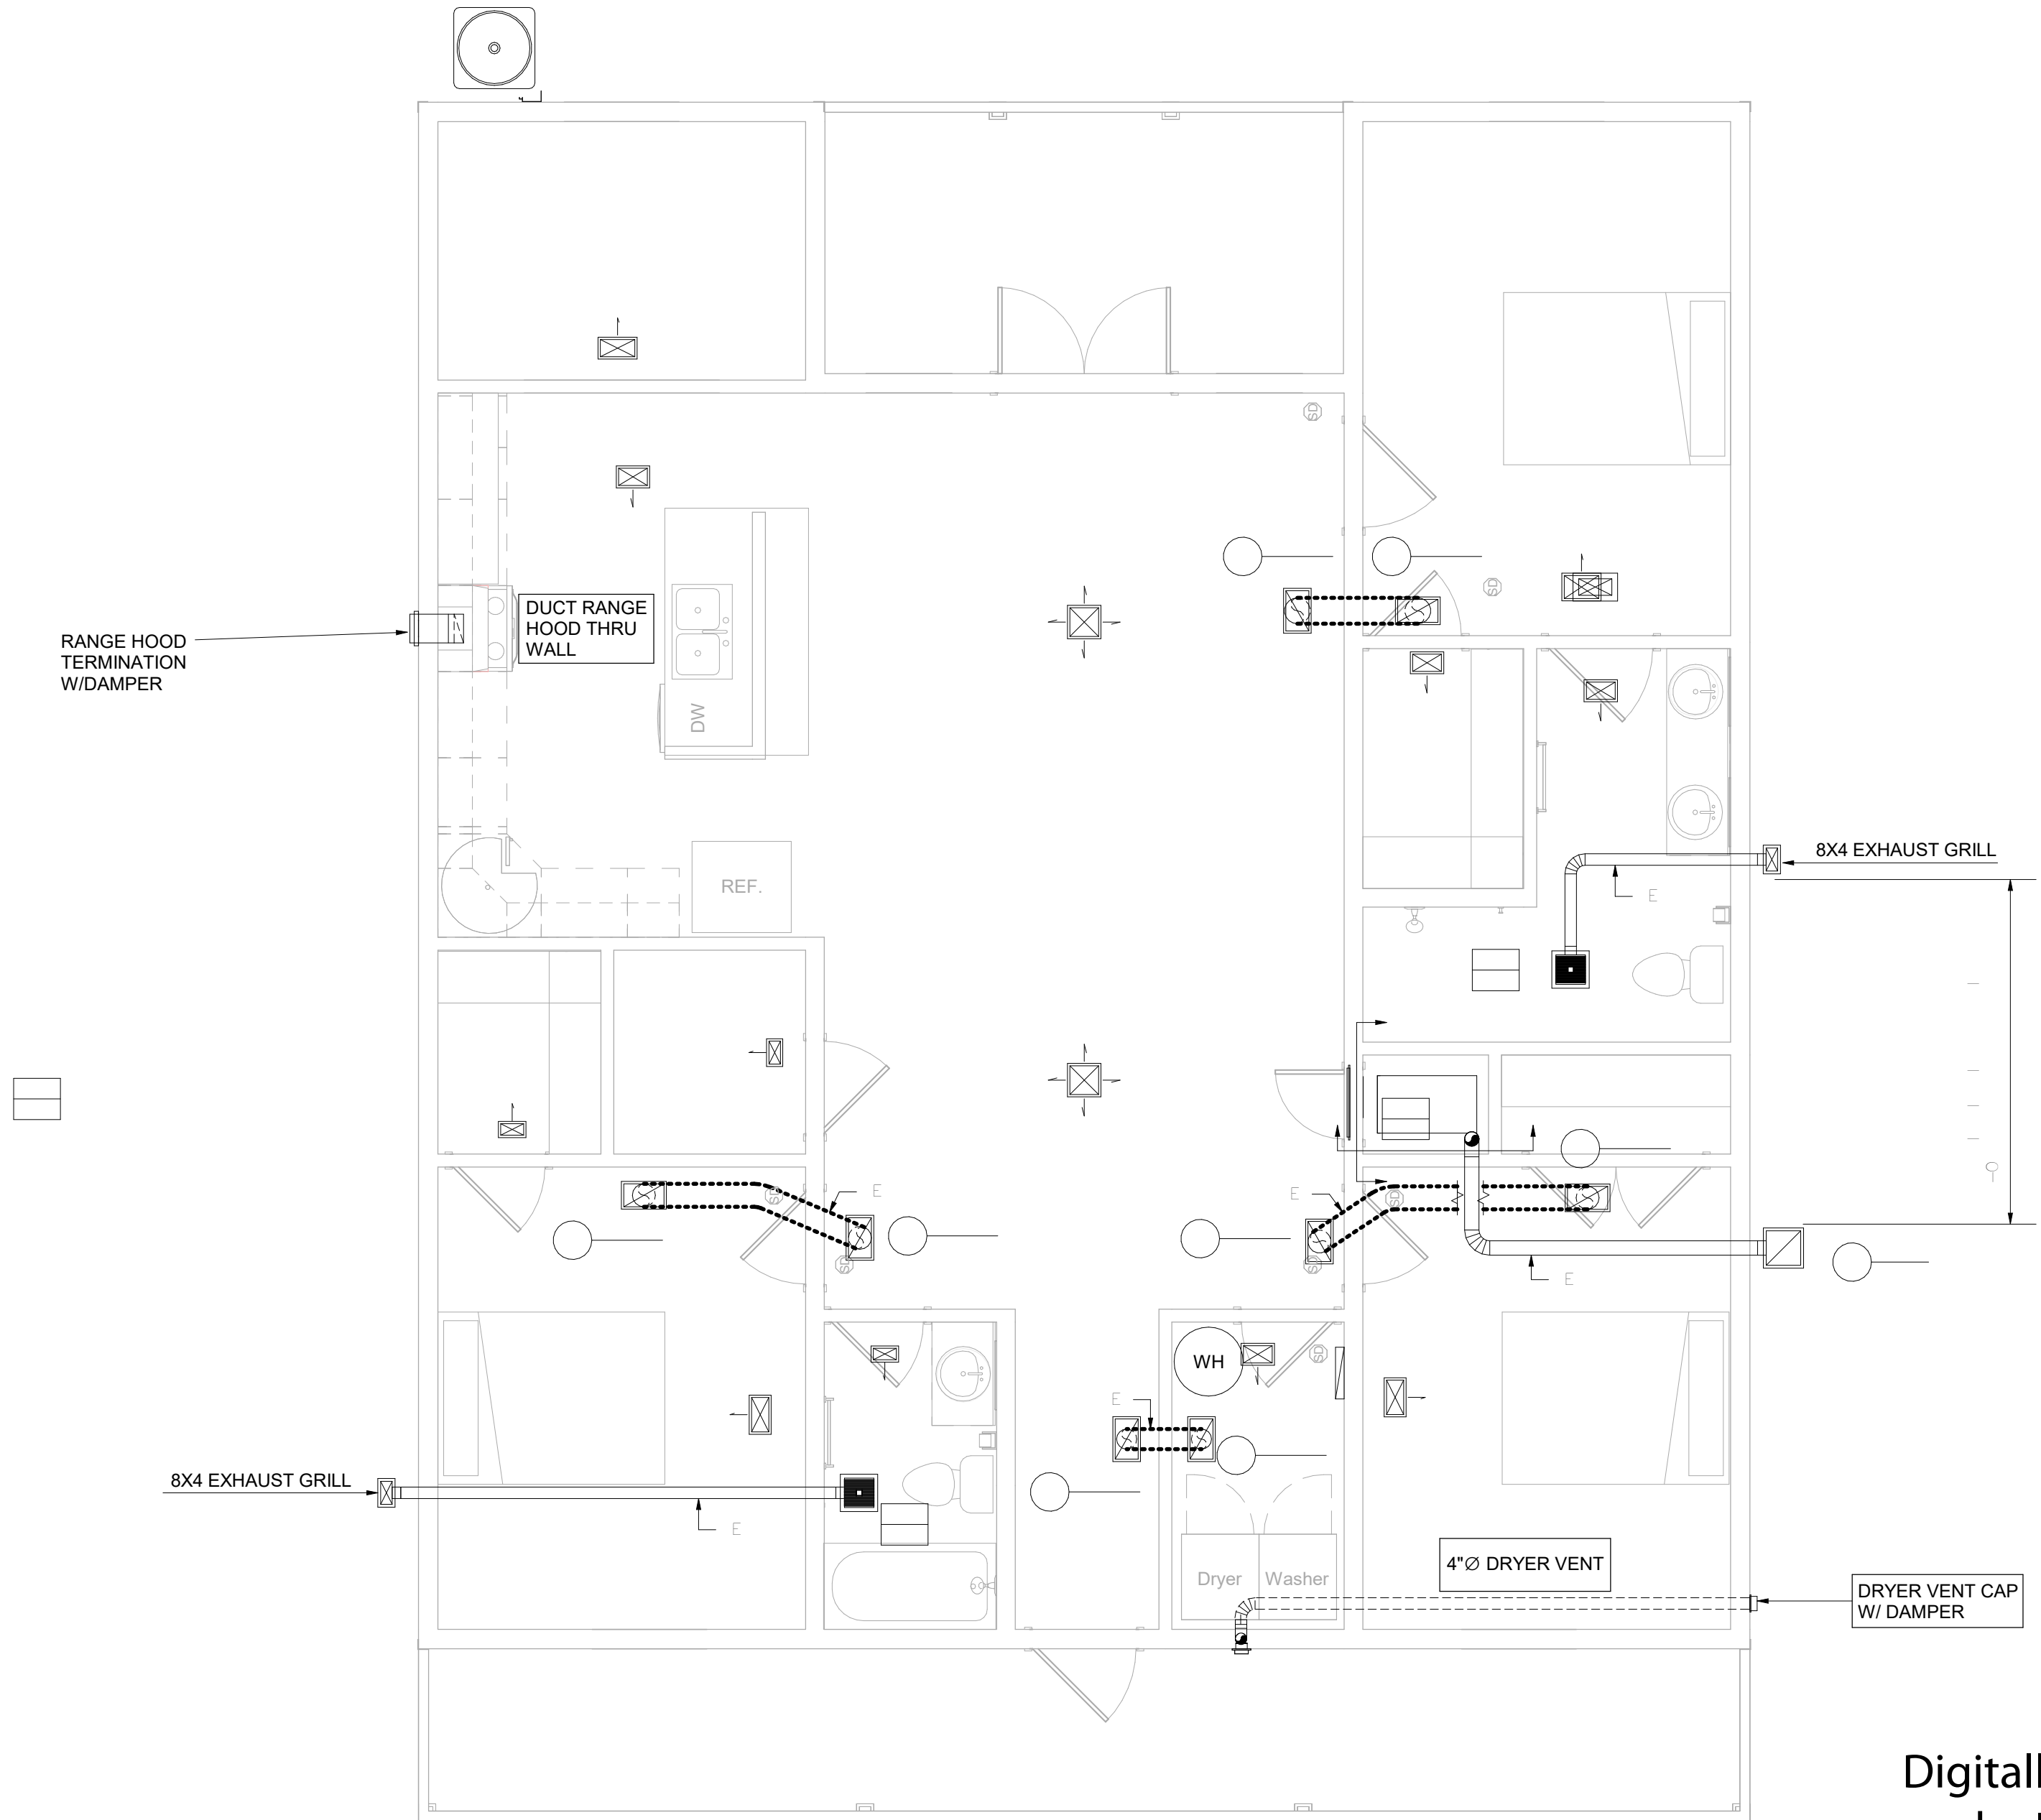

② EXHAUST, VENTILATION AND PASSIVE RETURN DUCT SYSTEMS
1/4" = 1'-0"

Digitally signed
by Imbrie M
Packard
Date: 2023.04.12
'13:14:27 -05'00

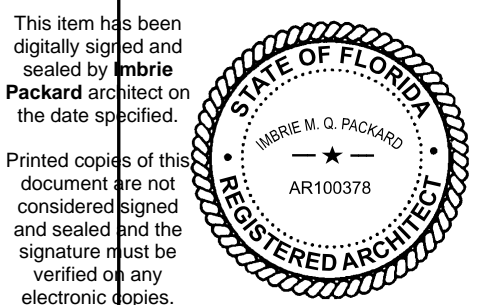

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYVIEW DR.
LAKE CITY, FL 32025

MECHANICAL

Project Number 2019-15
Date 04/11/2023
Drawn By RM
Checked By DC
FOR CONSTRUCTION

HVAC ABBREVIATION LEGEND

AHU	AIR HANDLING UNIT
CU	CONDENSING UNIT
OAI	OUTDOOR AIR INTAKE
OAD	OUTDOOR AIR DAMPER
OA	OUTDOOR AIR
EF	EXHAUST FAN
DH	DEHUMIDIFIER
CP	CONDENSATE PUMP
ZD	ZONE DAMPER
BD	BALANCE DAMPER
T	THERMOSTAT
DHC	DEHUMIDIFICATION CONTROL
AF	AIR FILTRATION
SA	SUPPLY AIR
RA	RETURN AIR

A/C DUCT WORK SPECIFICATIONS




FLEXIBLE DUCT

CLASS 1 FLEXIBLE DUCT WITH SILVER VAPOR JACKET, R-VALUE 6
MANUFACTURER: ATCO MODEL #036



METAL DUCT ROUND

GALVANIZED METAL SNAPLOCK PIPE WITH SILVER DUCT WRAP, R-VALUE = 6
MANUFACTURER: CERTAINTED SOFT TOUCH



DUCT RECTANGLE

"TOUGHGARD" DUCT BOARD BLACK MAT, R-VALUE = 6
MANUFACTURER: CERTAINTED

ALL DUCT SIZES LISTED ON PLANS ARE INSIDE DIAMETER AND ARE LISTED IN INCHES.
ADD 3" TO EACH DIMENSION FOR OUTSIDE DIAMETER

HVAC NOTES:

GENERAL NOTES

- ALL WORK TO BE DONE IN ACCORDANCE WITH THESE PLANS & THE FLORIDA BUILDING CODE 7th EDITION (2020)
- MECHANICAL DRAWINGS ARE SCHEMATIC IN NATURE & ARE NOT INTENDED TO SHOW EVERY MINOR DETAIL. THE HVAC CONTRACTOR SHALL INCLUDE THE FURNISHINGS OF ALL LABOR AND MATERIALS TO COMPLETE THE AIR CONDITIONING, HEATING, AND VENTILATION SHOWN ON THE DRAWINGS TO INCLUDE, BUT NOT BE LIMITED TO THE FOLLOWING:
 - PERMIT FEES
 - ALL AIR CONDITIONING EQUIPMENT
 - EXHAUST FANS
 - SUPPLY, RETURN, VENTILATION, & EXHAUST AIR DUCT WORK
 - SUPPLY AND RETURN DIFFUSERS AND REGISTERS, DAMPERS, WEATHERPROOF VENTILATION & EXHAUST LOUVERS
 - AIR FILTRATION; MINIMUM MERV-8
 - THERMOSTATS, CO2 SENSORS, SHUT DOWN SWITCHES & RELATED CONTROL WIRING
 - EQUIPMENT SUPPORTS, HANGERS, & RACKS
 - CONDENSATE DRAIN PANS & PIPING
 - REFRIGERANT FIELD COPPER LINE SET & PIPING
- ALL WORK SHALL BE PERFORMED BY A LICENSED HVAC CONTRACTOR CERTIFIED IN THE STATE OF FLORIDA.
- THE HVAC CONTRACTOR SHALL VISIT THE JOB SITE, MEET WITH RELATED TRADES, & FAMILIARIZE THEMSELVES WITH ANY AND ALL CONDITIONS RELATED TO THEIR WORK.
- ALL EQUIPMENT AND MATERIALS SHALL BE AS SPECIFIED OR APPROVED EQUAL. ANY CHANGES OR DEVIATIONS FROM THESE PLANS MUST BE APPROVED BY ENGINEER OF RECORD.
- AIR CONDITIONING AND HEATING EQUIPMENT SHALL NOT BE SIZED BASED ON A.R.I. CAPACITY RATINGS, BUT RATHER BASED ON SPECIFIC DESIGN CONDITIONS.
- REVISIONS OR CHANGES FROM THESE PLANS THAT MAY BE REQUIRED BECAUSE OF CONTRACTOR OPTED REVISIONS, SHALL BE COMPENSATED TO THE ENGINEER OF RECORD BY THE REQUESTING CONTRACTOR.
- FOR ANY QUESTIONS REGARDING LOAD CALCULATIONS, ENERGY CALCULATIONS, MECHANICAL DESIGN OR EQUIPMENT SELECTION, PLEASE CONTACT DENNIS STROER, CALCS-PLUS, 121 TRIPLE DIAMOND BLVD, UNIT 16, NORTH VENICE, FL 34275, 941-488-1700
- ALL ROUGHED-IN DUCTWORK AND/OR ANY MECHANICAL OPENINGS SHALL BE COVERED AND PROTECTED DURING CONSTRUCTION TO MINIMIZE DUST CONTAMINATION INSIDE THE DUCTWORK AND MECHANICAL SYSTEM. MATERIALS SUCH AS DUCK MASK, RIGID FOAM INSULATION, DUCT BOARD OR OTHER MEANS ACCEPTABLE TO SEAL THE OPENINGS.

DUCTWORK

- DUCT CONSTRUCTION AND INSTALLATION SHALL COMPLY WITH SECTION M603 OF THE 2020 FLORIDA BUILDING CODE.
- AIR CONDITIONING DUCT SYSTEM MATERIALS SHALL BE BASED ON THE FOLLOWING:
 - FLEXIBLE DUCT WORK - BRAND - ATCO #030 / UL 181, CLASS 1 AIR DUCT WITH REINFORCED METALLIZED POLYESTER JACKET WITH WIRE HELIX ENFORCED AIR TIGHT INNER LINER. INSULATION SHALL BE R- 4.
 - RECTANGLE DUCT -GALVANIZED METAL DUCT WITH R-4 LINED INSULATION.
- ALL DUCT SIZES LISTED ARE NET INSIDE DIMENSIONS.
- ALL DUCTS AND PLENUMS SHALL BE MADE AIR TIGHT. DUCT WORK SHALL BE CONSTRUCTED AND INSTALLED IN ACCORDANCE WITH THE CURRENT EDITION OF CHAPTER 13 OF THE 2020 FLORIDA BUILDING CODE.
- DUCT LEAKAGE SHALL NOT EXCEED 5% OF THE RATED AIR HANDLER FLOW.
- FLEXIBLE DUCT SHALL BE EXTENDED TO ITS FULL LENGTH. EXCESS DUCT MATERIAL IN A RUN SHALL BE LESS THAN 5%.
- FLEXIBLE DUCT SHALL BE SUPPORTED AT MANUFACTURERS RECOMMENDED INTERVALS, BUT AT NO GREATER DISTANCE THAN 4 FEET. MAXIMUM PERMISSIBLE SAG IS 1/2" PER FOOT OF SPACING BETWEEN SUPPORTS.
- FIRE DAMPERS SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 716 OF THE 2020 FLORIDA BUILDING CODE.
- DUCTS AND TRANSFER OPENINGS THAT PENETRATE FIRE RESITANT-RATED ASSEMBLIES AND ARE NOT REQUIRED BY THIS SECTION TO HAVE DAMPERS, SHALL COMPLY WITH THE REQUIREMENTS OF SECTION 712 OF THE 2020 FLORIDA BUILDING CODE.
- SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH SECTION M606 OF 2020 FLORIDA BUILDING CODE.

CONDENSATE DISPOSAL

- CONDENSATE DISPOSAL SHALL BE PROVIDED FOR EQUIPMENT AND APPLIANCES CONTAINING EVAPORATOR COILS.
- CONDENSATE DRAIN SYSTEM SHALL BE DESIGNED, CONSTRUCTED AND INSTALLED IN ACCORDANCE WITH SECTIONS 307.2.1 THROUGH 307.2.4 OF THE 2020 FLORIDA BUILDING CODE.
- ALL PRIMARY CONDENSATE PIPING LOCATED WITHIN THE INSIDE OF THE BUILDING SHALL BE INSULATED TO PREVENT CONDENSATION FROM FORMING ON THE EXTERIOR OF THE DRAIN LINE.
- MAIN AND EMERGENCY CONDENSATE DRAIN LINES SHALL BE SCHEDULE 40 PVC.
- AUXILIARY DRAIN LINE CONNECTION AT THE EVAPORATOR DRAIN PAN SHALL INCORPORATE AN SAFETY CUT-OFF SWITCH.
- AIR HANDLERS SHALL INCORPORATE AN EMERGENCY DRAIN PAN THAT IS PIPED TO A CONSPICUOUS LOCATION AT THE EXTERIOR OF THE BUILDING OR INCORPORATES A SAFETY CUT-OFF SWITCH.
- SLOPE HORIZONTAL CONDENSATE DRAINS A MINIMUM OF 1/4" PER FOOT.
- CONDENSATE SHALL BE CONVEYED FROM THE DRAIN PAN OUTLET TO AN APPROVED PLACE OF DISPOSAL. CONDENSATE SHALL NOT DISCHARGE INTO A STREET, SIDEWALK, OR ANY OTHER LOCATION AS TO CAUSE A NUISANCE. IF NO APPROVED LOCATION IS AVAILABLE, THEN A DRY WELL SHALL BE INSTALLED.
- ALL DRAIN LINES SHALL BE PROVED AND TESTED UPON EQUIPMENT START-UP.
- ALL DRAIN LINE AND DRAIN PAN SAFETY CUT OFF CONTROLS SHALL BE TESTED UPON EQUIPMENT START-UP.

SPLIT SYSTEM AIR CONDITIONING EQUIPMENT

- CONDENSING UNIT SHALL BE INSTALLED AS PER SECTION 304.1 AND 304.2 OF THE 2020 FLORIDA BUILDING CODE.
- CONDENSING UNIT SHALL BE LOCATED ON SLAB ON GRADE. TIE DOWN WITH FBC APPROVED HURRICANE STRAPS.
- CLEARANCE AROUND NON SERVICE SIDES OF THE CONDENSING UNIT SHALL COMPLY WITH MANUFACTURERS RECOMMENDATIONS AS PER MANUFACTURERS INSTALLATION INSTRUCTIONS.
- CLEARANCE ABOVE THE CONDENSING UNIT SHALL COMPLY WITH MANUFACTURERS RECOMMENDATION AS PER MANUFACTURERS INSTALLATION INSTRUCTIONS.
- AIR HANDLERS SHALL BE INSTALLED AS PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND THE 2020 FLORIDA BUILDING CODE.
- THE AIR HANDLER SHALL INCORPORATE A FILTER HOUSING WITH EASY ACCESS. THE FILTER COMPARTMENT SHALL NOT BE OBSTRUCTED IN ANY WAY BY THE REFRIGERANT PIPING, CONDENSATE PIPING, OR ANY OTHER ITEM WHICH MAY PREVENT REMOVAL AND INSTALLATION OF THE FILTER.
- FILTERS SHALL BE LOCATED AT THE AIR HANDLER DIRECTLY BEFORE THE EVAPORATOR COIL. NO FILTER BACK GRILLS SHALL BE USED UNLESS NOTED ON THE DRAWING
- CLEARANCE AROUND THE AIR HANDLER SHALL BE 4" FOR NON-SERVICE SIDES AND 36" FOR SERVICE SIDE.

OUTDOOR AIR & EXHAUST AIR SYSTEMS

- ALL EXHAUST DUCTS SHALL TERMINATE TO EXTERIOR ROOF CAP, SIDEWALL CAP, OR SOFFIT HOOD AS INDICATED ON THE HVAC PLANS.
- EXHAUST FANS SHALL HAVE BACK DRAFT DAMPER INSTALLED.
- EF #1 & EF #2 SHALL BE WIRED TO WALL SWITCH ON/OFF.
- OUTDOOR AIR DUCT SHALL BE CONNECTED TO THE RETURN SIDE OF THE AIR STREAM AT THE RETURN AIR PLENUM FOR INTAKE BALANCE.
- OUTDOOR AIR DUCT SHALL INCORPORATE A MANUAL VOLUME BALANCE DAMPER AT THE RETURN AIR PLENUM FOR INTAKE BALANCE.
- OUTDOOR AIR DUCT SHALL INCORPORATE A NORMALLY CLOSE 24 VOLT DAMPER(VAD).
- VAD SHALL BE WIRED TO OPEN VIA CORRESPONDING CO2 SENSOR.
- CO2 SENSOR SHALL OPEN VAD ON CO2 RISE AND CLOSE UPON CO2 FALL. SEE CO2 CONTROL SCHEDULE.
- OUTDOOR AIR INTAKES SHALL HAVE INSECT SCREEN AT INTAKE CAP.
- KEEP ALL VENTILATION AIR INTAKES A MINIMUM 10' FROM EXHAUST FAN TERMINATION POINTS AND SANITARY SEWER VENT OUTLETS.
- KEEP ALL OUTDOOR AIR INTAKES AND EXHAUST VENTS 3' FROM OPERABLE OPENINGS INTO BUILDING AND 3' FROM PROPERLY LINED


Digitally signed
by Imbrie M
Packard
Date: 2023.04.12
13:14:49 -0500

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYLA DR,
LAKE CITY, FL 32025

MECHANICAL

Project Number	2019-15
Date	04/11/2023
Drawn By	RM
Checked By	DC
FOR CONSTRUCTION	



SPLIT HEAT PUMP SYSTEM SCHEDULE				
SYSTEM	SEE EQUIPMENT SELECTION		2.5-Ton	
	TOTAL CAPACITY BTUH *		25,876	
	SENSIBLE CAPACITY BTUH		19,851	
	HEATING CAPACITY BTUH (47° ODT)		20,353	
	MANUFACTURER		CARRIER	
	SEER2 / EER2 / HSPF2		15.2 / 12.0 / 7.8	
AIR HANDLING UNIT	NOMINAL TONNAGE		2.5	
	AHRI NUMBER		209692247	
	DESIGNATION			
	MODEL NO.		FX4DN(B,F)037L	
	SUPPLY AIR CFM		900	
	OUTDOOR AIR (OA) CFM		--	
CONDENSING UNIT	ENTERING AIR TEMP. DBWB		75/63	
	EXTERNAL STATIC PRESS. IN. W. G.		0.6"	
	INDOOR FAN FLA		4.1	
	ELECTRIC HEAT KW		8.0	
	MCAMOCOP		45/50	
	DESIGNATION			
	MODEL NO.		25SCA530A003	
	COMPRESSOR R.L.A. / L.R.A.		14.1 / 67.9	
	OUTDOOR FAN FLA		0.6	
	OUTDOOR DESIGN TEMP. DB		95	
	MCA / MOCF		18.2 / 30	
	ELECTRIC SERVICE		208/230/1/60	

* EQUIPMENT OUTPUT IS BASED ON MANUFACTURER'S EXPANDED PERFORMANCE TABLES USING INDOOR CONDITIONS OF 75 DEGREES AND 65 DEGREE WET BULB.
** INCLUDE MERV-8 FILTER

EQUIPMENT SELECTION:

THE EQUIPMENT SCHEDULE SHOWS SEVERAL SPLIT SYSTEMS TO CHOOSE FROM.
EQUIPMENT SELECTION SHALL BE BASED ON LOCATION, ORIENTATION AND THE 2020 FLORIDA BUILDING CODE - ENERGY CONSERVATION.



HVAC LOAD CALCULATIONS WERE BASED ON SIX LOCATIONS IN FLORIDA.

HVAC LOAD CALCULATIONS WERE BASED ON SIX LOCATIONS IN FLORIDA.

Pensacola						Gainesville AP, Florida					
Front door	Supply	Sens	Lat	Net	Rec	Front door	Supply	Sens	Lat	Net	Rec
Faces	CFM	Gain	Gain	Tons	Tons	Faces	CFM	Gain	Gain	Tons	Tons
South	748	19,787	5,808	2.13	2.20	South	708	18,839	5,444	2.02	2.09
Southwest	797	20,875	*5,817	2.22	2.32	Southwest	757	19,910	5,444	2.11	2.21
West	801	20,948	5,809	2.23	2.33	West	760	19,978	5,437	2.12	2.22
Northwest	785	20,614	5,812	2.20	2.29	Northwest	748	19,696	5,437	2.09	2.19
North	747	19,765	5,811	2.13	2.20	North	707	18,822	5,446	2.02	2.09
Northeast	801	20,965	5,807	2.23	2.33	Northeast	769	20,181	*5,446	2.14	2.24
East	*832	*21,645	5,806	*2.29	*2.40	East	*801	*20,863	5,438	*2.19	*2.32
Southeast	812	21,200	5,816	2.25	2.36	Southeast	780	20,426	5,444	2.16	2.27
Jacksonville AP, Florida						Orlando AP, Florida					
Front door	Supply	Sens	Lat	Net	Rec	Front door	Supply	Sens	Lat	Net	Rec
Faces	CFM	Gain	Gain	Tons	Tons	Faces	CFM	Gain	Gain	Tons	Tons
South	722	19,329	5,339	2.06	2.15	South	723	19,297	4,969	2.02	2.14
Southwest	770	20,386	5,339	2.14	2.27	Southwest	773	20,391	4,971	2.11	2.27
West	774	20,473	5,335	2.15	2.27	West	776	20,454	4,965	2.12	2.27
Northwest	761	20,176	5,336	2.13	2.24	Northwest	762	20,148	4,966	2.09	2.24
North	721	19,307	*5,342	2.05	2.15	North	723	19,284	4,970	2.02	2.14
Northeast	783	20,663	5,340	2.17	2.30	Northeast	782	20,602	4,973	2.13	2.29
East	*813	*21,333	5,337	*2.22	*2.37	East	*815	*21,330	4,970	*2.19	*2.37
Southeast	791	20,829	5,330	2.18	2.31	Southeast	796	20,903	*4,974	2.16	2.32
Fort Myers AP, Florida						Miami AP, Florida					
Front door	Supply	Sens	Lat	Net	Rec	Front door	Supply	Sens	Lat	Net	Rec
Faces	CFM	Gain	Gain	Tons	Tons	Faces	CFM	Gain	Gain	Tons	Tons
South	722	19,320	5,341	2.06	2.15	South	712	18,801	5,625	2.04	2.09
Southwest	772	20,432	5,341	2.15	2.27	Southwest	764	19,967	*5,636	2.13	2.22
West	774	20,480	5,335	2.15	2.28	West	767	20,033	5,636	2.14	2.23
Northwest	760	20,175	5,337	2.13	2.24	Northwest	748	19,599	5,627	2.10	2.18
North	721	19,317	5,341	2.05	2.15	North	712	18,802	5,625	2.04	2.09
Northeast	777	20,523	5,331	2.15	2.28	Northeast	764	19,971	5,636	2.13	2.22
East	*814	*21,358	5,341	*2.22	*2.37	East	*801	*20,774	5,631	*2.20	*2.31
Southeast	795	20,952	*5,342	2.19	2.33	Southeast	783	20,395	5,636	2.17	2.27

EXHAUST FAN SCHEDULE				
DESIGNATION	EF #1			
FAN TYPE	CEILING			
DRIVE TYPE	DIRECT			
AIR FLOW CFM	50			
STATIC PRESS. IN. W.G.	0.25			
NOISE(SONES)	0.7			
ELECTRIC SERVICE	120/160			
MAX AMPS	.14			
MANUFACTURER	PANASONIC			
MODEL NO.	FV-05-11VKS1			
CONTROL	3			

SPEED SETTINGS AND CONTROL
1. SET TO 50 CFM.
2. STANDARD ON/OFF WALL SWITCH WITH MOTION SENSOR OPTION

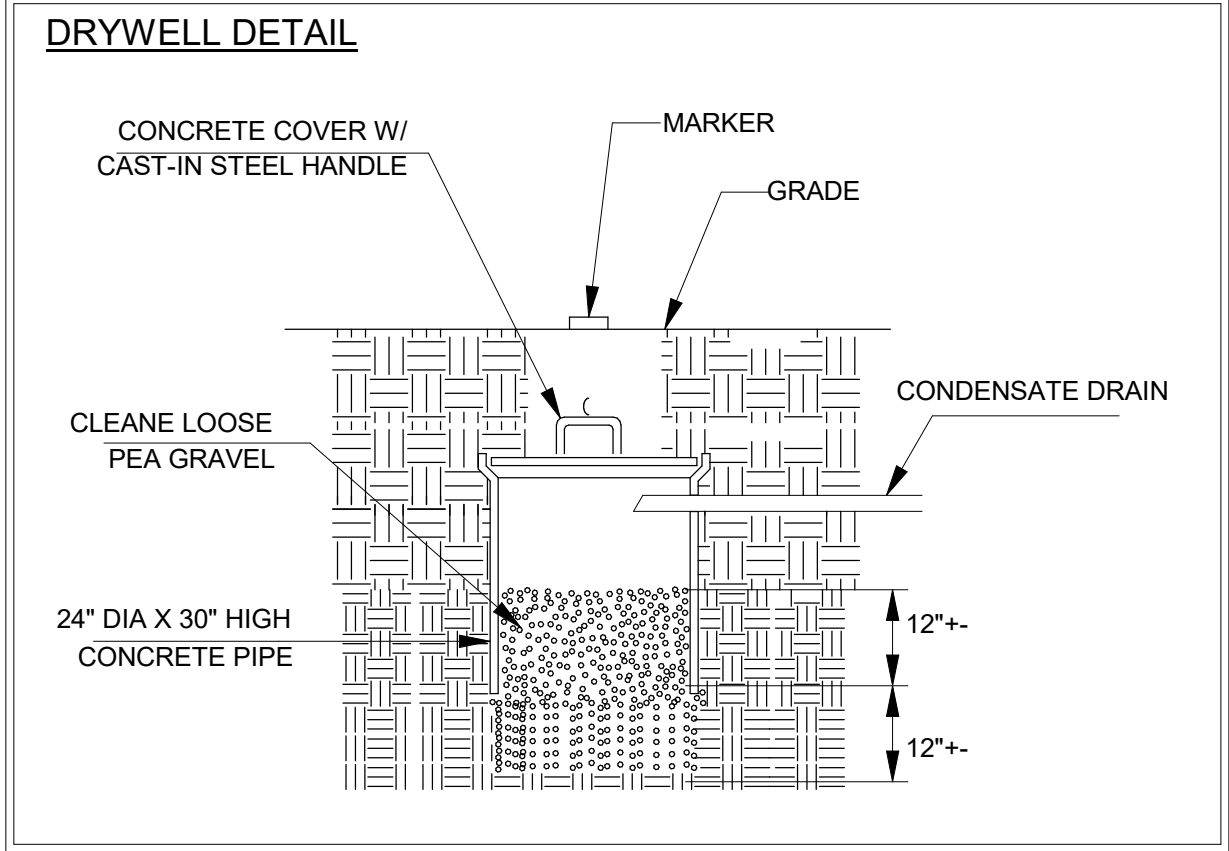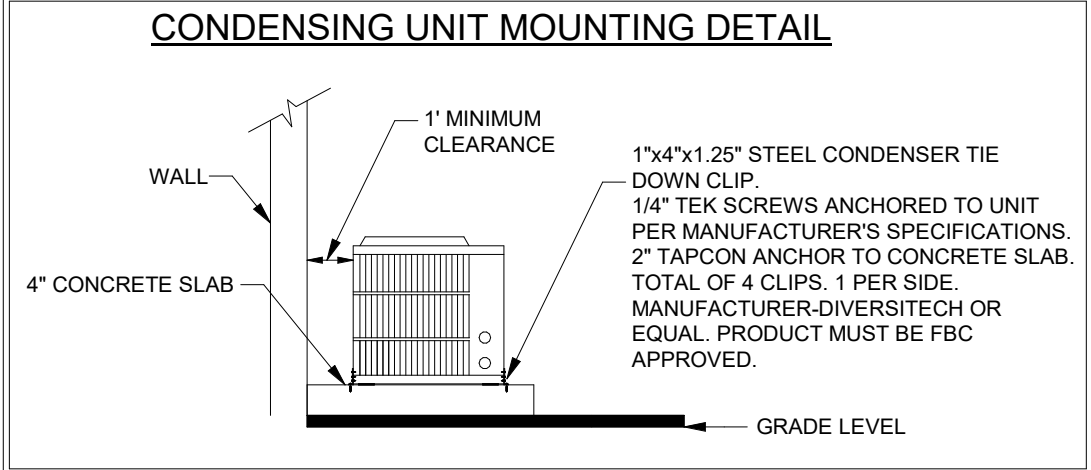

AIR DIFFUSER & DESCRIPTION



VENTILATION AIR CALCULATION

ASHRAE 62.2-2010 - CHAPTER 4
REFERENCE TABLE 4.1
OCCUPANCY CATEGORY - RESIDENTIAL

Rp 7.5 CFM/COMBINED OUTDOOR AIR FLOW RATE
Pz 4 OCCUPANTS
Ra .01 CFM/FT² - ZONE OCCUPIABLE AREA
Az 1,579 FT² - ZONE OCCUPIABLE AREA
Vbz 44.80 CFM, BREATHING ZONE OA FLOW
Ez 1.0 ZONE AIR DISTRIBUTION EFFECT
Voz 46 MINIMUM REQUIRED ZONE OUTDOOR AIR FLOW

*OUTSIDE AIR REQUIREMENTS ARE IN ACCORDANCE WITH FLORIDA MECHANICAL CODE 2014 AND ASHRAE 2014-62.2, VENTILATION FOR ACCEPTABLE INDOOR AIR QUALITY

HVAC DIFFUSER SPECIFICATIONS

SUPPLY DIFFUSER - CEILING

MANUFACTURER: AIRGUIDE
MODEL: CBHML-1.2.3.4/ME
DESCRIPTION: WHITE ALUMINUM ADJUSTABLE CURVED BLADE WITH PARALLEL BLADE DAMPER

SUPPLY DIFFUSER - SIDEWALL

MANUFACTURER: AIRGUIDE
MODEL: VML-ME
DESCRIPTION: WHITE ALUMINUM SINGLE DEFLECTION WITH PARALLEL BLADE DAMPER


RETURN DIFFUSER - CEILING/SIDEWALL

MANUFACTURER: AIRGUIDE
MODEL: RA
DESCRIPTION: WHITE ALUMINUM 38" BLADE/NON-FILTER BACK


RETURN DIFFUSER - CEILING/SIDEWALL

MANUFACTURER: AIRGUIDE
MODEL: RF-2
DESCRIPTION: WHITE ALUMINUM 38" BLADE/FILTER BACK *FOR RANGE HOOD MAKE-UP AIR DIFFUSER, PROVIDE PERMANENT WASHABLE FILTER.

STANDARD DIFFUSER TAG LEGEND

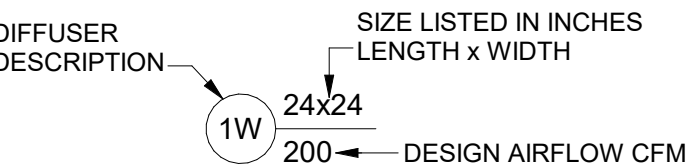


RETURN AIR GRILL PLENUM

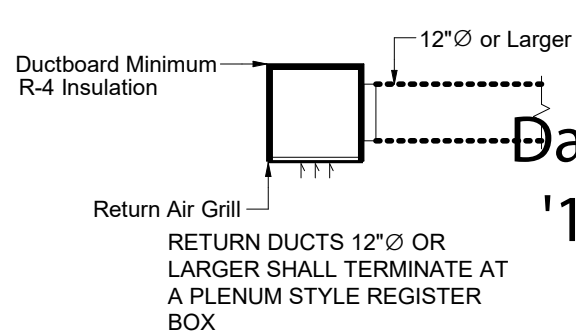

Digitally signed
by Imbrie M
Packard
Date: 2023.04.12
'13:15:22 -05'00

This item has been digitally signed and sealed by Imbrie Packard architect on the date specified.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

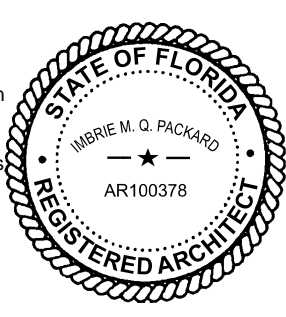


ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 263-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYLA DR.
LAKE CITY, FL 32025


MECHANICAL

Project Number 2019-15
Date 04/11/2023
Drawn By RM
Checked By DC


FOR CONSTRUCTION

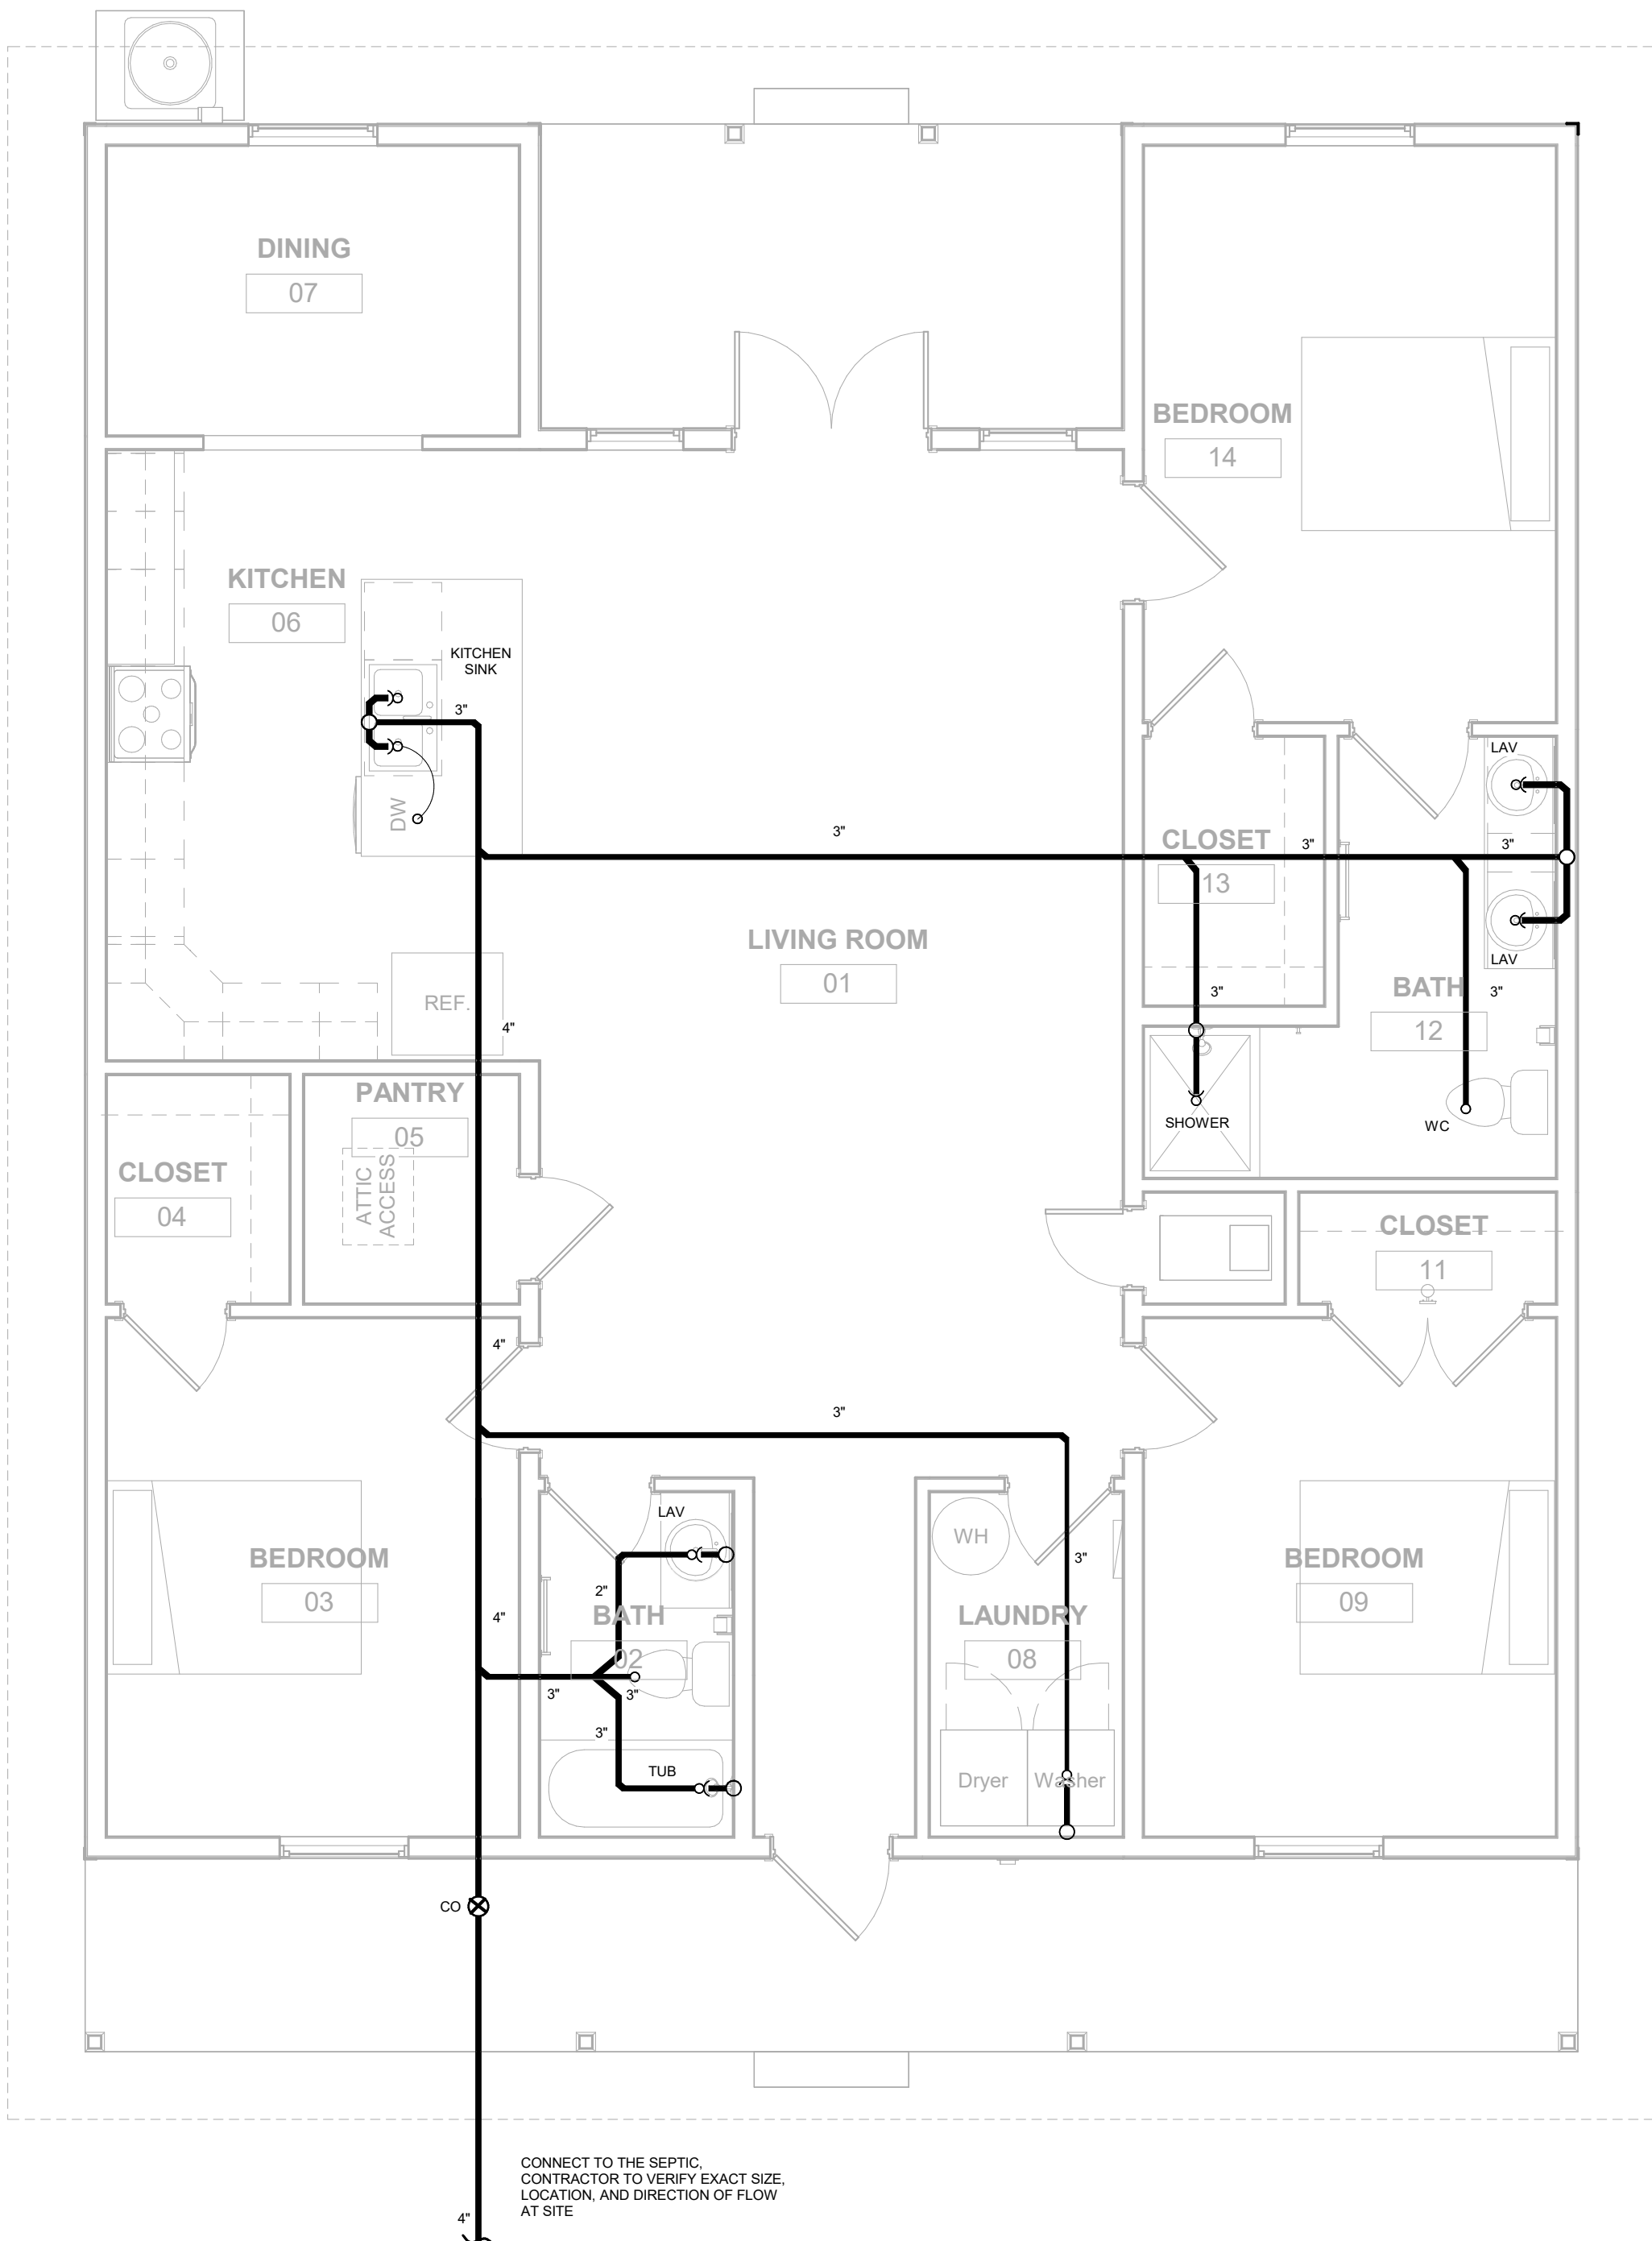

1 SANITARY PLAN
1/4" = 1'-0"

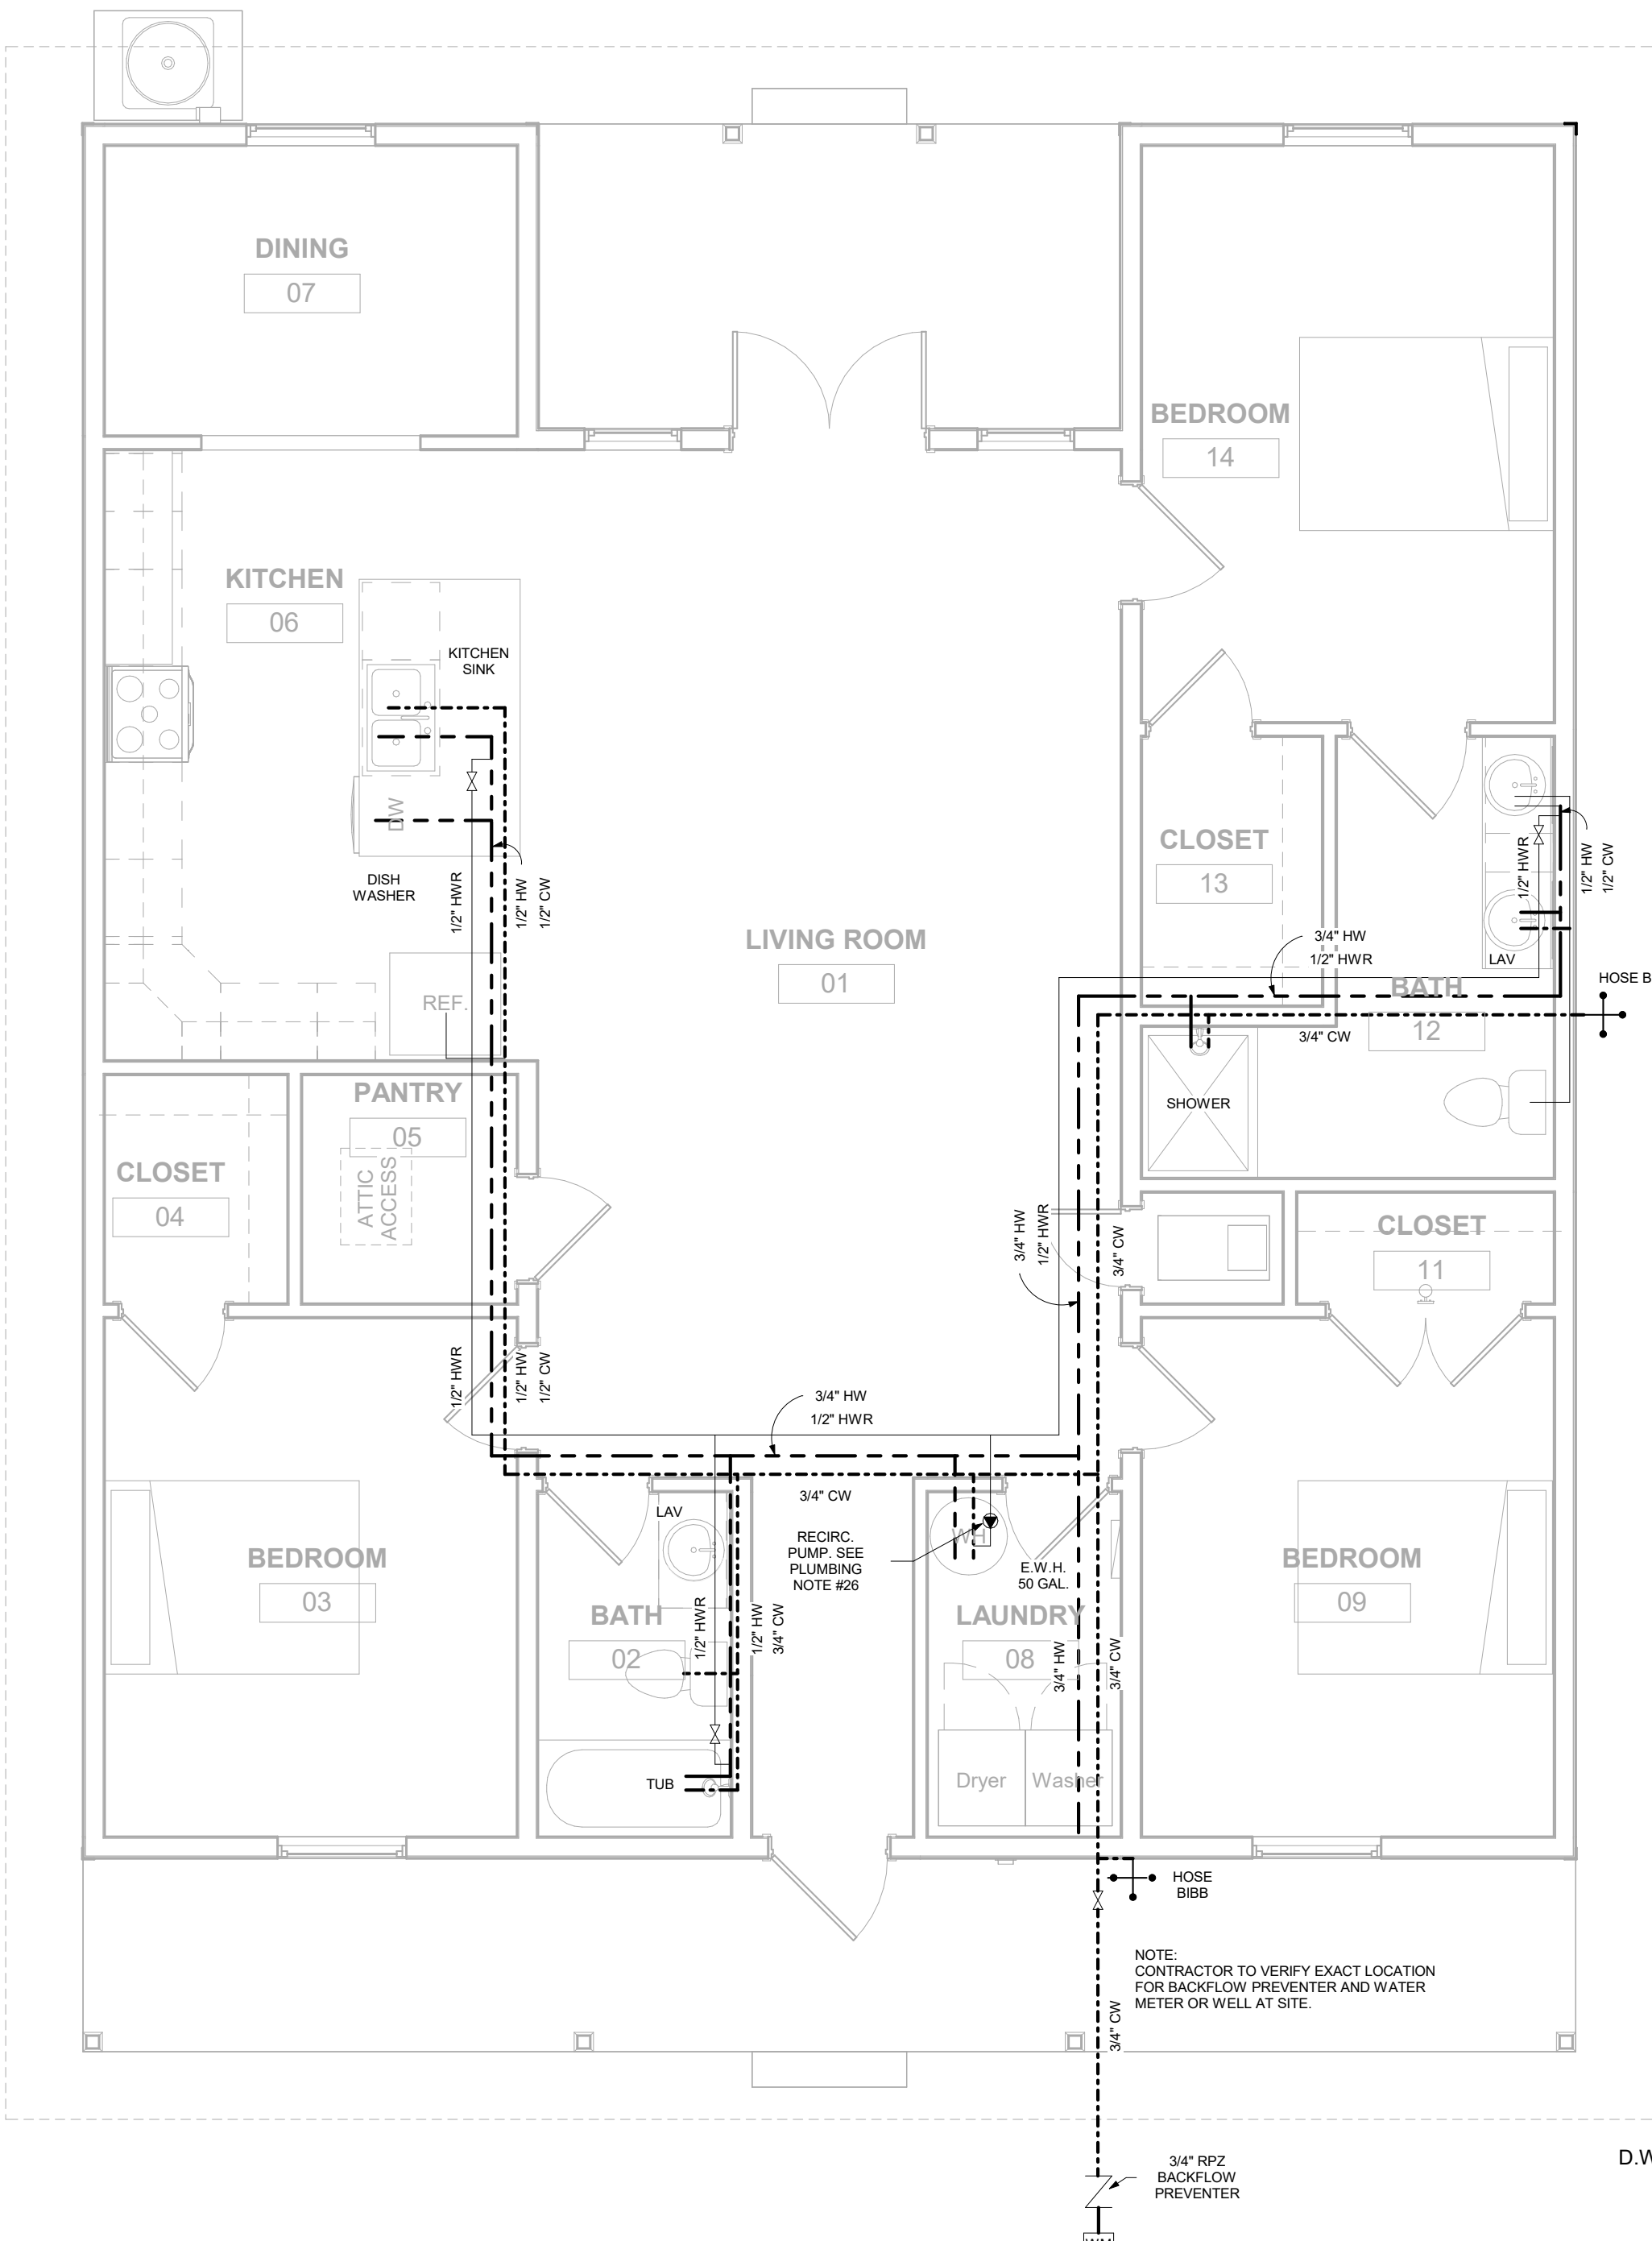

2 WATER PLAN
1/4" = 1'-0"

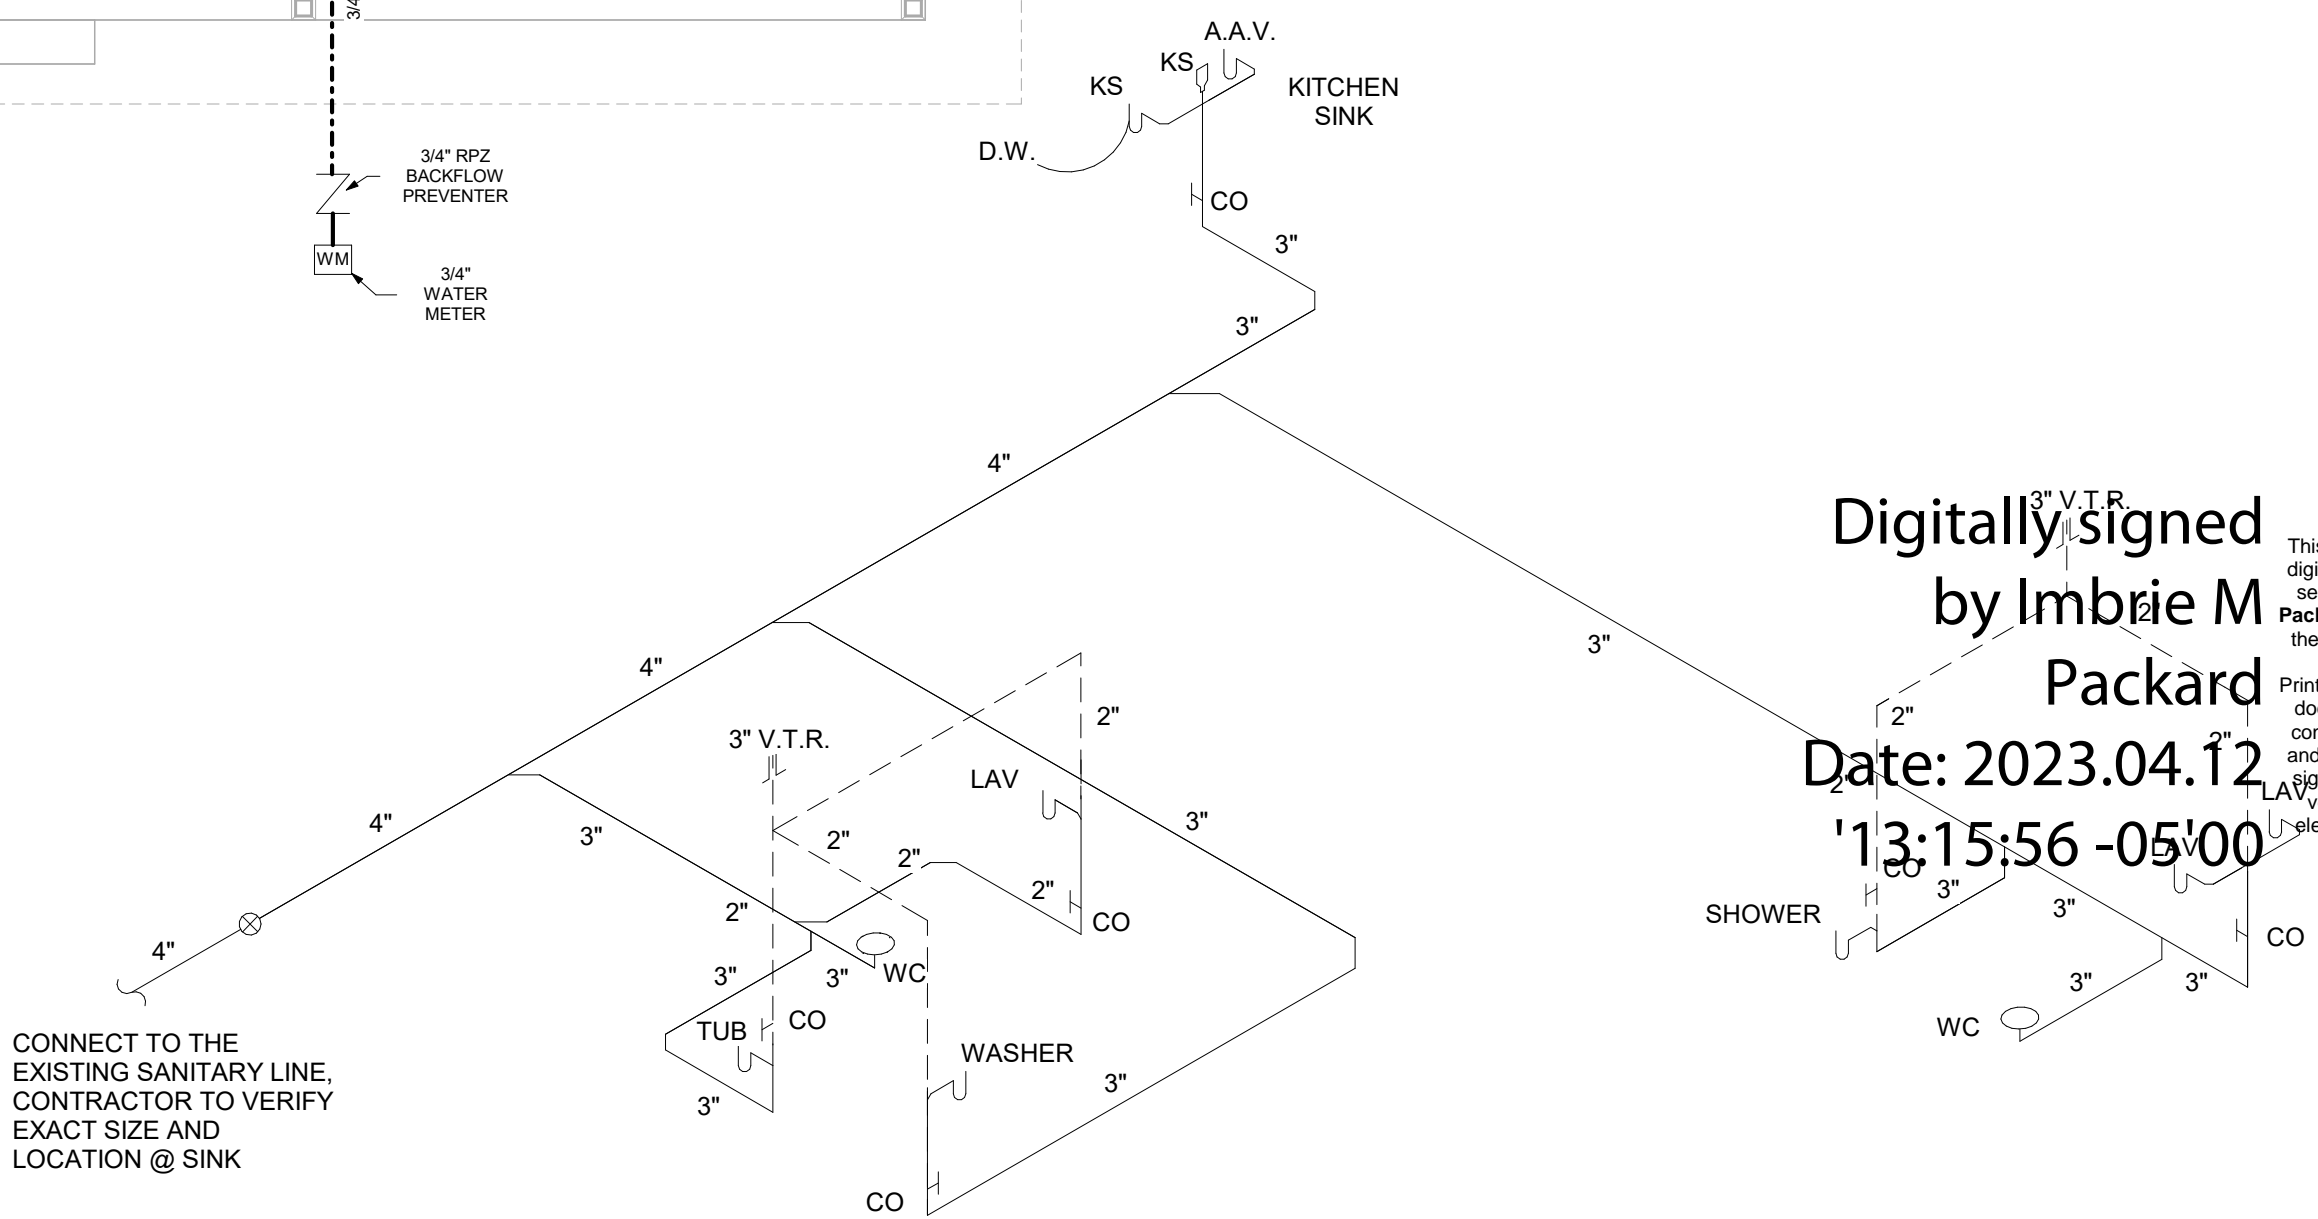

3 PLUMBING RISER DIAGRAM
1/4" = 1'-0"

PLUMBING NOTES:

- PLUMBING WORK SHALL BE DESIGN BUILD BY PLUMBING SUBCONTRACTOR AND RISER DIAGRAM SHALL BE REVIEWED AND SUBMITTED AS REQUIRED BY PERMITTING.
- PLUMBING CONTRACTOR SHALL BE LICENSED AND RESPONSIBLE TO MEET ALL APPLICABLE REQUIREMENTS BY CODE
- ALL PLUMBING FIXTURES AND PIPING SHALL CONFORM TO THE LOCAL PLUMBING CODES.
- HOT WATER HEATER TO BE ELECTRIC AND MEET REQUIREMENTS OF ENERGY STAR REFERENCE HOME WITH MIN. EF=0.93.
- INSULATE PIPES WITH MIN. R-4 PIPE INSULATION
- USE WATER-CONSERVING FIXTURES MEETING THE FOLLOWING REQUIREMENTS:
 - TOILETS 1.28 GPF
 - SHOWERHEADS 2.0 GPM
 - KITCHEN FAUCETS 2.0 GPM
 - BATHROOM FAUCETS 1.5 GPM
 - ALL PLUMBING FIXTURES SHALL BE WATERSENSE. WATER CLOSETS MUST HAVE A MINIMUM MAP RATING OF 600.
- VERIFY FIXTURES AND LOCATIONS WITH ARCHITECTURAL PLAN AND OWNER.
- VERIFY ALL APPLIANCES/EQUIPMENT (HVAC, WATER HEATERS, EXHAUST FANS, ETC.) IN BID
- PROVIDE SERVICE CONNECTIONS
- VERIFY HOT WATER HEATER LOCATIONS AND PROVIDE PLASTIC DRAIN/DRIP PAN WITH DRAIN TO EXTERIOR
- VERIFY HOSE BIB LOCATIONS (MIN. 2 EXTERIOR HOSE BIBS)
- PROVIDE "NO-D RIP" SUPPLY/ DRAIN @ WASHER
- PROVIDE ACCESS PANELS TO TUB/SHOWER UNITS
- PERFORM ALL INSULATION AND BACKFILLING
- PROVIDE ALL CLEAN OUTS, VACUUM BREAKERS AND OTHER COMPONENTS REQUIRED BY CODE WHETHER SHOWN ON DRAWING OR NOT.
- SHUTOFF VALVES SHALL BE REQUIRED ON EACH FIXTURE SUPPLY PIPE TO EACH PLUMBING APPLIANCE AND TO EACH PLUMBING FIXTURE OTHER THAN BATHTUBS AND SHOWERS. VALVES SERVING INDIVIDUAL PLUMBING FIXTURES, PLUMBING APPLIANCES, RISERS AND BRANCHES SHALL BE ACCESSIBLE.
- ALL SINKS AND LAVATORIES TO BE PROVIDED HOT AND COLD WATER
- ALL PENETRATIONS THROUGH ROOF SHALL BE FLASHED USING DEK TITE PIPE FLASHING OR EQUAL AND DEK TITE RUBBER BOOT OR EQUAL
- ALL PIPING IN UNINSULATED AREAS AND EXPOSED TO EXTERIOR SHALL BE INSULATED
- PLUMBING SUBCONTRACTOR SHALL PROVIDE AND INSTALL DRAIN LINES FOR ALL HVAC TO THE NEAREST PLUMBING LINES AND VERIFY LOCATION OF ALL EXISTING UTILITY LINES. (WATERS, SEWER, GAS, ETC.)
- ALL DRAIN LINES SHALL HAVE WATER SEAL TRAPS AND EACH FIXTURE GROUP VENTED.
- ALL SANITARY SEWER PIPING SHALL BE SCHEDULE 40 PVC DWV PIPE AND FITTING. MINIMUM SLOPE OF SANITARY SEWER LINE SHALL BE .004 PER FOOT.
- CONTRACTOR SHALL PROVIDE CLEAN OUT LOCATIONS, TIE-IN LOCATIONS, AND WATER AND SEWER LINE LOCATIONS ON SITE TO PERMIT DEPARTMENT FOR REVIEW.
- SHOWER DRAINS SHALL HAVE AN OUTLET SIZE OF NOT LESS THAN 1 1/2 INCHES (38 MM) IN DIAMETER.
- WHERE A SHOWER RECEPTOR HAS A FINISHED CURB THRESHOLD, IT SHALL BE NOT LESS THAN 1 INCH (25 MM) BELOW THE SIDES AND BACK OF THE RECEPTOR. THE CURB SHALL BE NOT LESS THAN 2 INCHES (51 MM) AND NOT MORE THAN 9 INCHES (229 MM) DEEP WHEN MEASURED FROM THE TOP OF THE CURB TO THE TOP OF THE DRAIN. THE FINISHED FLOOR SHALL SLOPE UNIFORMLY TOWARD THE DRAIN NOT LESS THAN 1/4 UNIT VERTICAL IN 12 UNITS HORIZONTAL (2-PERCENT SLOPE) NOR MORE THAN 1/2 UNIT VERTICAL PER 12 UNITS HORIZONTAL (4-PERCENT SLOPE) AND FLOOR DRAINS SHALL BE FLANGED TO PROVIDE A WATER-TIGHT JOINT IN THE FLOOR.
- PER 2020 FBC - PLUMBING, 7TH EDITION, 607.2 HOT OR TEMPERED WATER SUPPLY TO FIXTURES: THE DEVELOPED LENGTH OF HOT OR TEMPERED WATER PIPING, FROM THE SOURCE OF HOT WATER TO THE FIXTURES THAT REQUIRE HOT OR TEMPERED WATER, SHALL NOT EXCEED 50 FEET (15 240 MM). RECIRCULATING SYSTEM PIPING AND HEAT-TRACED PIPING SHALL BE CONSIDERED TO BE SOURCES OF HOT OR TEMPERED WATER. PLUMBING IS DESIGN BUILD BY PLUMBING CONTRACTOR, RECIRCULATION PUMP CAN BE OMITTED AT THE DISCRETION OF THE LICENSED PLUMBER IF THE REFERENCED CODE IS MET.

No.	Description	Date

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net


ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYVIEW DR.
LAKE CITY, FL 32025

PLUMBING PLAN

Project Number	2019-15
Date	04/11/2023
Drawn By	Author
Checked By	Checker

FOR CONSTRUCTION

Digitally signed
by Imbrie M
Packard
Date: 2023.04.12
13:15:56 -05'00'

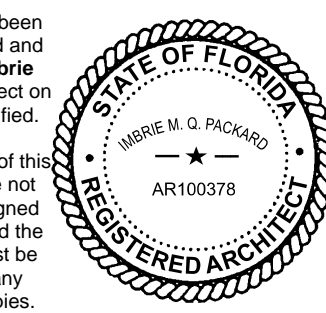

GENERAL NOTES:

1.

STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH THE ARCHITECTURAL, MECHANICAL, ELECTRICAL, SHOP DRAWINGS AND SPECIFICATIONS.
2.

CONSTRUCTION SHALL FOLLOW THE 2020 FLORIDA BUILDING CODE, 7th EDITION, THE 2020 FLORIDA RESIDENTIAL CODE, 7th EDITIONS, AND ALL LOCAL, STATE, AND FEDERAL REQUIREMENTS AND REGULATIONS. BUILDING CODE SHALL TAKE PRECEDENCE OVER DRAWINGS IF CONFLICT EXISTS.
3.

TERMITE PROTECTION SHALL BE PROVIDED BY REGISTERED TERMITICIDES, INCLUDING SOIL APPLIED PESTICIDES, BAITING SYSTEMS, AND PESTICIDES APPLIED TO WOOD, OR OTHER APPROVED METHODS OF TERMITE PROTECTION LABELED FOR USE AS A PREVENTATIVE TREATMENT TO NEW CONSTRUCTION. SEE SECTION 202, "REGISTERED TERMITICIDE." UPON COMPLETION OF THE APPLICATION OF THE TERMITE PROTECTIVE TREATMENT, A CERTIFICATE OF COMPLIANCE SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY THAT CONTAINS THE FOLLOWING STATEMENT: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. TREATMENT IS IN ACCORDANCE WITH RULES AND LAWS ESTABLISHED BY THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES."
4.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL FINAL DIMENSIONS AND FIT-UP OF THE STRUCTURE, INCLUDING VERIFYING ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE COMMENCING WORK.
5.

THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL EXISTING UTILITIES BEFORE COMMENCING ANY WORK. ANY INTERFERENCE SHALL BE BROUGHT TO THE ATTENTION OF THE STRUCTURAL ENGINEER.
6.

THE CONTRACTOR SHALL NOTIFY SUNSHINE 811 AT LEAST TWO FULL BUSINESS DAYS BEFORE ANY EXCAVATION AND FOLLOW ALL REQUIREMENTS SET FORTH BY SUNSHINE 811.
7.

THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECT'S DRAWINGS BEFORE STARTING WORK.
8.

THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN PLACEMENT, MAINTENANCE, ETC. OF ANY AND ALL SHORING, BRACING, TIE BACKS, ETC. NEEDED TO SUPPORT ANY PART OF THE NEW OR EXISTING CONSTRUCTION DURING THE ENTIRE CONSTRUCTION PROCESS TO ENSURE THE SAFETY AND INTEGRITY OF THE STRUCTURE UNTIL THE NECESSARY PERMANENT ELEMENTS ARE IN PLACE.
9.

SEE ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DRAWINGS FOR EXACT LOCATION OF ALL DEPRESSIONS, SLOPES, OPENINGS, PENETRATIONS, ETC. PENETRATION THROUGH BEAMS OR OPENINGS IN STRUCTURAL ELEMENTS NOT SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE BROUGHT TO THE ATTENTION OF THE STRUCTURAL ENGINEER.
10.

UNLESS NOTED OTHERWISE, DETAILS SHOWN ON ANY DRAWING ARE TO BE CONSIDERED TYPICAL FOR ALL SIMILAR CONDITIONS.

DESIGN CRITERIA:

- BUILDING CODE:

2020 FLORIDA BUILDING CODE, BUILDING, 7TH EDITION
ASCE 7-16 MINIMUM DESIGN LOADS AND ASSOCIATED CRITERIA FOR BUILDINGS AND OTHER STRUCTURES
2020 FLORIDA BUILDING CODE, RESIDENTIAL, 7TH EDITION

1.

DESIGN GRAVITY LOADS:

•

FIRST FLOOR

•

UNINHABITABLE ATTIC WITH LIMITED STORAGE

•

BALCONIES (EXTERIOR) AND DECK

•

GUARDS AND HANDRAILS

•

GUARD IN-FILL COMPONENTS

•

ROOMS OTHER THAN SLEEPING ROOMS

•

SLEEPING ROOMS

•

STAIRS

•

ATTIC

•

ROOF

DL = 50 PSF
LL = 40 PSF
LL = 20 PSF
LL = 40 PSF
LL = 200 PSF
LL = 50 PSF
LL = 40 PSF
LL = 30 PSF
LL = 40 PSF
DL = 10 PSF
LL = 20 PSF
LL = 20 PSF
LL = 20 PSF

2.

FOUNDATION DESIGN:

•

ALLOWABLE BEARING CAPACITY

=

1500 PSF

3.

WIND LOADS (ASCE 7-16)

•

ULTIMATE WIND SPEED =

•

NOMINAL WIND SPEED=

•

RISK CATEGORY =

•

WIND EXPOSURE CATEGORY =

180 MPH
139 MPH
II
C

FOUNDATION NOTES:

1.

PLACE FOOTINGS ON UNDISTURBED SOIL. NOTIFY THE ENGINEER IF "SOFT SPOTS", UNDERGROUND OBSTRUCTIONS, OR ANY UNUSUAL CONDITION IS ENCOUNTERED DURING STRIPPING, EXCAVATION OR FILLING.

2.

GRADE BEAMS MAY BE EARTH FORMED PROVIDED DIMENSIONAL TOLERANCES LISTED IN ACI 117-90 ARE ADHERED TO.

3.

PLACE 10 MIL. WATERPROOF MEMBRANE BENEATH ALL INTERIOR SLABS AND GRADE BEAMS. LAP 12" TO ACCOMMODATE CONCRETE POURING DIRECTION

CONCRETE NOTES:

1.

ALL CONCRETE WORK SHALL CONFORM TO ACI 301 SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS

2.

CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS WITH A 5" SLUMP

3.

CONCRETE SHALL BE NORMAL WEIGHT OF 150 LBS. PER CUBIC FOOT AND SHALL CONFORM TO THE LATEST ACI 301 SPECIFICATION.

4.

PORTLAND CEMENT SHALL CONFORM TO ASTM C150, TYPE I OR II.

5.

AGGREGATE FOR NORMAL WEIGHT CONCRETE SHALL MEET ASTM C33.

6.

REINFORCING STEEL SHALL BE IN ACCORDANCE WITH ASTM A615 GRADE 60, WELDED WIRE FABRIC (WWF) SHALL BE IN ACCORDANCE WITH ASTM 185, WIRE SHALL CONFORM TO ASTM A82.

7.

REINFORCING FABRIC ON GRADE SHALL BE CHAIRED WITH 3000 PSI CONCRETE BRICKETTES SPACED TO ADEQUATELY SUPPORT THE REINFORCING, BUT NOT GREATER THAN 3'-0" O.C. EACH WAY. LAP ALL FABRIC ONE WIRE SPACING PLUS 6 INCHES.

8.

UNLESS NOTED OTHERWISE ON THE DRAWINGS WHERE CONTINUOUS REINFORCING IS SPECIFIED, HOOK BARS AT NON-CONTINUOUS ENDS, THE MINIMUM LAP SPLICE LENGTHS OF REINFORCING BARS SHALL BE:

BAR SIZE	CLASS B SPLICE LENGTH IN 4000 PSI CONCRETE (INCHES)	TOP BAR SPLICE LENGTH IN 4000 PSI CONCRETE (INCHES)
#3	12	15
#4	15	20
#5	19	25
#6	23	29
#7	33	43

*USE THE TOP BAR SPLICE LENGTH WHERE HORIZONTAL REINFORCEMENT IS PLACED SUCH THAT 12 INCHES OR MORE OF FRESH CONCRETE IS CAST BELOW THE SPLICE

9.

PROVIDE TWO (2) #5, 4'-0" LONGER THAN OPENING DIMENSION ON ALL SIDES OF OPENING IN SLAB

10.

PROVIDE THE FOLLOWING COVER FOR REINFORCING:

A.

FOOTINGS AND GRADE BEAMS: 3"

B.

FORMED SURFACES EXPOSED TO SOIL: 3"

C.

BEAMS, COLUMNS, AND WALLS: 1 1/2"

D.

SLABS: 1 1/2"

11.

DO NOT PENETRATE OR MAKE HOLES OR OPENINGS THROUGH FOUNDATION AND/OR FOOTINGS WITHOUT ENGINEER'S APPROVAL.

12.

EXPOSED EDGES OF CONCRETE SHALL BE CHAMFERED 3/4"

WOOD FRAMING NOTES:

1.

WOOD FRAMING FABRICATION AND ERECTION SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF THE 2020 FLORIDA BUILDING CODE (FBC), THE 2020 FLORIDA RESIDENTIAL CODE (FRC) AND SHALL CONFORM TO THE WOOD FRAME CONSTRUCTION MANUAL (WFCM) FOR ONE- AND TWO-FAMILY DWELLINGS, 2001 EDITION AND THE PLYWOOD DESIGN SPECIFICATIONS BY THE APA. ALL WOOD FRAMING CONNECTIONS, STRAPS, AND TIE-DOWNS SHALL BE USED IN ADDITION TO AND CONJUNCTION WITH THE REQUIREMENTS STATED ABOVE. THE DESIGN AND NOTES BELOW ALSO COMPLY WITH THE WOOD FRAMING NOTES FOR SPECIFIC REQUIREMENTS MEETING FLORIDA BUILDING CODE (FBC) SECTIONS 2314-2330 RELATED TO WOOD CONSTRUCTION IN HIGH VELOCITY HURRICANE ZONES (HVHZ)

2.

FRAMING LUMBER OF ALL SILLS, GIRDERS, AND HEADERS OF & SUPPORTING LOAD BEARING WALLS SHALL BE SOUTHERN PINE GRADE MARKED AND KILN DRIED, NO. 1 OR BETTER. ALL OTHER FRAMING LUMBER SHALL BE SOUTHERN PINE GRADE MARKED AND KILN DRIED, NO. 2 OR BETTER. ALL MEMBER PIECES, ENDS, JOINTS, OR SPLICES SHALL BE OVER SUPPORTS UNLESS NOTED OTHERWISE.

3.

UNLESS NOTED OTHERWISE MULTIPLE PIECES OF LUMBER OR MANUFACTURED WOOD PRODUCTS USED TO FORM BEAM OR HEADER MEMBERS SHALL BE ATTACHED TOGETHER WITH 2 ROWS OF 12d NAILS SPACED AT 12" FOR PIECES UP TO 12" DEEP. ALL OTHER PIECES SHALL HAVE 3 ROWS OF 12d NAILS AT 12".

4.

OPENINGS IN EXTERIOR WOOD-FRAMED WALLS SHALL HAVE THE FOLLOWING MINIMUM NUMBER OF FULL HEIGHT STUDS AT EACH JAMB AS PER TABLE 3.23c IN THE WFCM:

A.

OPENINGS LESS THAN 4'-0":

2 STUDS

B.

OPENINGS 4'-0" TO 6'-0":

3 STUDS

C.

OPENINGS 6'-0" TO 10'-0":

4 STUDS

D.

OPENINGS LESS THAN 4'-0":

2 STUDS

*ALL MULTIPLE STUDS SHALL BE CONNECTED TOGETHER WITH TWO ROWS OF NAILS SPACED AT 8" O.C.

5.

UNLESS SHOWN OTHERWISE ALL OPENINGS IN WALLS SHALL HAVE HEADERS CONSISTING OF A MINIMUM OF TWO (2) 2x12's OR THREE (3) 2x10's.

6.

PROVIDE DOUBLE FLOOR JOISTS UNDER ALL WALLS

7.

PROVIDE FULL DEPTH BLOCKING FOR ALL FLOOR AND CEILING JOISTS @ 8'-0" O.C. MAX. AND FULL DEPTH PERIMETER BLOCKING BETWEEN ALL FLOOR AND CEILING JOISTS.

8.

PRESSURE TREATED (PT) WOOD SHALL BE TREATED WITH ACQ TO A MINIMUM RETENTION OF 0.40 LBS./CU. FT. IN ACCORDANCE WITH AWPA. PROTECTION OF WOOD AND WOOD-BASED PRODUCTS FROM DECAY SHALL BE PROVIDED IN THE FOLLOWING LOCATIONS BY THE USE OF WOOD THAT IS PRESERVATIVE-TREATED IN ACCORDANCE WITH AWPA U1 PER FRC 317 INCLUDING ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY, JOISTS WITHIN 12" FROM GRADE, AND SHEATHING, SIDING, AND FRAMING WITHIN 6" FROM GRADE, AND CONCRETE OR MASONRY EXTERIOR FOUNDATION WALLS AND ARE LESS THAN 8 INCHES FROM THE EXPOSED GROUND.

9.

WOOD MEMBERS (INCLUDING PLYWOOD SHEATHING OR BRACING) SHALL BE CONNECTED OR FASTENED WITH STEEL NAILS, SCREWS, OR BOLTS. NO STAPLES WILL BE PERMITTED. ALL WOOD CONNECTIONS SHALL BE IN ACCORDANCE WITH THE FASTENING SCHEDULE OF THE 2020 FRC AND ALL CONNECTORS SHALL MEET FBC TABLE 2324.1.

10.

JOIST AND BEAM HANGERS, HURRICANE CLIPS, AND OTHER TIES, ANCHORS, OR CONNECTORS SHALL BE AS MANUFACTURED BY SIMPSON STRONG-TIE CO., INC. OR APPROVED EQUALS AND SHALL BE ATTACHED WITH NAILS OF THE SIZE AND TYPE RECOMMENDED BY THE MANUFACTURER. ALL HANGERS, CLIPS, CONNECTORS, ANCHORS, TIES, ETC. SHALL BE GALVANIZED. ALL SUCH UNITS THAT WILL BE EXPOSED TO WEATHER, IN CONTACT WITH EARTH, WATER, OR CONCRETE, OR BELOW THE FIRST FLOOR LEVEL SHALL RECEIVE THE SIMPSON "Z-MAX" TRIPLE ZINC COATING OR APPROVED EQUAL. ALL HANGERS SHOWN ARE IN ADDITION TO THE REQUIRED FASTENERS BY FLORIDA RESIDENTIAL CODE.

11.

UNLESS SHOWN OTHERWISE ALL PLYWOOD WALL SHEATHING SHALL BE 5/8" THICK. WALL SHEATHING SHALL BE CONTINUOUS OVER THREE OR MORE SUPPORTS AND SHALL BE NAILED TO SUCH SUPPORTS WITH 8D COMMON NAILS. NAIL SPACING SHALL NOT EXCEED 6-INCHES (152 MM) ON CENTER AT PANEL EDGES AND ALL INTERMEDIATE SUPPORTS. NAIL SPACING SHALL BE 4-INCHES (102 MM) ON CENTER AT CORNER STUDS, IN ALL CASES.

12.

PLYWOOD WALL SHEATHING SHALL HAVE SOLID BLOCKING AT ALL HORIZONTAL JOINTS.

13.

UNLESS SHOWN OTHERWISE ALL PLYWOOD FLOOR SHEATHING SHALL BE APA RATED 48/24, 3/4" THICK AND FASTENED WITH GLUE AND 10d COMMON NAILS SPACED AT 6" O.C. MAX. ALONG SUPPORTING MEMBERS AT THE EDGES OF EACH SHEET AND 12" O.C. MAX. ALONG SUPPORTING MEMBERS ON THE INTERIOR OF EACH SHEET. 100% OF ALL SEALANTS USED ARE ≤ 250 G/L AND ADHESIVES ≤ 70 G/L.

14.

THE TOP PLATE OF STUD BEARING WALLS SHALL BE DOUBLED AND LAPPED AT EACH INTERSECTION OF WALLS AND PARTITIONS.

15.

CORNERS OF STUD WALLS AND PARTITIONS SHALL BE FRAMED SOLID BY NOT LESS THAN THREE STUDS.

16.

STUDS, OTHER THAN END-JOINTED LUMBER, SHALL BE SPLICED ONLY AT POINTS WHERE LATERAL SUPPORT IS PROVIDED.

17.

STUD WALLS AND PARTITIONS CONTAINING PIPES SHALL BE FRAMED TO GIVE PROPER CLEARANCE FOR THE PIPING.

18.

WHERE WALLS AND PARTITIONS CONTAINING PIPING ARE PARALLEL TO FLOOR JOISTS, THE JOISTS SHALL BE DOUBLED AND MAY BE SPACED TO ALLOW VERTICAL PASSAGE OF PIPES.

19.

WHERE VERTICAL PIPE POSITIONS NECESSITATE THE CUTTING OF PLATES, A METAL TIE NOT LESS THAN 1 INCH BY 1/8 INCH (25 MM BY 3 MM) SHALL BE PLACED ON EACH SIDE OF THE PLATE ACROSS THE OPENING AND NAILED WITH NOT LESS THAN TWO 16D OR THREE 8D NAILS AT EACH END.

20.

LVL BEAMS SHALL MEET ALL REQUIREMENTS SET BY THE MANUFACTUER.

21.

UNLESS OTHERWISE NOTED, THE LATERAL FORCE-RESISTING SYSTEM CONSISTS OF THE EXTERIOR WALLS (SHEAR WALLS) OF THE HOME.

SITE PREPARATION NOTES:

1.

AFTER DEMOLITION OF THE EXISTING STRUCTURE AND REMOVAL OF ITS ENTIRE FOUNDATIONS AND DEBRIS, THE LOCATION OF ANY EXISTING CONFLICTING UNDERGROUND UTILITY LINES WITHIN THE CONSTRUCTION AREA SHOULD BE ESTABLISHED. PROVISIONS SHOULD BE MADE TO REMOVE OR RELOCATE ANY INTERFERING UTILITY LINES WITHIN THE CONSTRUCTION AREA. ABANDONED UTILITIES SHOULD BE REMOVED OR GROUTED TO REDUCE THE POSSIBILITY OF SUBSURFACE EROSION THAT COULD RESULT IN FUTURE SETTLEMENT. EXCAVATIONS RESULTING FROM THE REMOVAL OF ANY INTERFERING UTILITIES SHOULD BE BACKFILLED IN ACCORDANCE WITH THE RECOMMENDATIONS PRESENTED BELOW.

2.

AT THE OUTSET OF CONSTRUCTION, CLEARING AND GRUBBING INCLUDING ROOT RAKING AND REMOVAL OF ANY ORGANIC-LOADED TOPSOIL OR ORGANIC SANDS THAT MAY REMAIN ON THE SITE SHOULD BE COMPLETED. AT A MINIMUM, A STRIPPING DEPTH OF ABOUT SIX INCHES IS RECOMMENDED. IT IS ALSO RECOMMENDED THAT THE CLEARING/STRIPPING OPERATIONS EXTEND AT LEAST 10 FEET BEYOND THE PROPOSED STRUCTURE PERIMETER, WHERE POSSIBLE.

3.

FOLLOWING THE CLEARING/STRIPPING OPERATIONS, THE DEVELOPMENT AREAS MAY BE BROUGHT UP TO FINISHED SUBGRADE LEVELS, IF NEEDED, USING COMPACTED STRUCTURAL FILL. THE EXISTING ON-SITE SOILS CAN BE USED FOR STRUCTURAL FILL PROVIDED IT IS FREE OF ORGANIC OR DELETERIOUS MATERIALS AND MOISTURE CONTENT IS APPROPRIATE. FILL SOILS SHOULD BE TESTED PRIOR TO IMPORT AND PLACEMENT. IMPORTED FILL SHOULD CONSIST OF SAND WITH LESS THAN 12 PERCENT PASSING THE NO. 200 SIEVE, FREE OF ROCKS/RUBBLE, ORGANICS, CLAY, DEBRIS AND OTHER UNSUITABLE MATERIAL. APPROVED SAND FILL SHOULD BE PLACED IN LOOSE LIFTS NOT EXCEEDING EIGHT INCHES IN THICKNESS AND SHOULD BE COMPACTED TO AT LEAST 95 PERCENT OF THE MATERIAL'S MAXIMUM DRY DENSITY IN ACCORDANCE WITH ASTM D-1557, MODIFIED PROCTOR METHOD. DENSITY TESTS TO CONFIRM COMPACTION SHOULD BE PERFORMED IN EACH FILL LIFT BEFORE THE NEXT LIFT IS PLACED.

4.

A MOISTURE CONTENT WITHIN THE PERCENTAGE RANGE NEEDED TO ACHIEVE COMPACTION (TYPICALLY +/- 3 PERCENT) IS RECOMMENDED PRIOR TO COMPACTION OF THE NATURAL GROUND AND FILL, BASED ON THE RESULTS OF THE MODIFIED PROCTOR COMPACTION TESTS.

5.

THE BOTTOM OF THE FOUNDATION EXCAVATIONS SHOULD BE COMPACTED TO AT LEAST 95 PERCENT OF THE MATERIAL'S MAXIMUM DRY DENSITY IN ACCORDANCE WITH ASTM D-1557, MODIFIED PROCTOR METHOD, FOR A MINIMUM DEPTH OF ONE FOOT BELOW THE BOTTOM OF THE FOUNDATIONS. SOFT OR LOOSE SOIL ZONES ENCOUNTERED AT THE BOTTOM OF THE FOOTING EXCAVATIONS SHOULD BE REMOVED AND REPLACED WITH FILL SOILS, LEAN CONCRETE, OR DENSE GRADED CRUSHED STONE (FDOT NO. 57).

NAIL CONNECTION FOR WOOD MEMBERS (FBC TABLE 2324.1)		
CONNECTION	COMMON NAILS	NUMBER OR SPACING
JOISTS TO SILL OR GIRDER, TOE NAIL	16D	2
BRIDGING TO JOIST, TOE NAIL	8D	2 EACH END
1-INCH x 6-INCH SUBFLOOR OR LESS TO EACH JOIST, FACE NAIL	8D	2
OVER 1-INCH x 6-INCH SUBFLOOR TO EACH JOIST, FACE NAIL	8D	3 + 1 FOR EACH SIZE INCREASE
2-INCHES SUBFLOOR TO JOIST OR GIRDER, BLIND AND FACE NAIL	16D	2
SOLE PLATE TO JOIST OR BLOCKING, FACE NAIL	16D	16 INCHES O.C.
TOP OR SOLE PLATE TO STUD, END NAILED	16D	2
STUD TO SOLE PLATE, TOE NAIL	3D	3 or 2 16D
DOUBLED STUDS, FACE NAIL	16D	24 INCHES O.C.
DOUBLED TOP PLATES, FACE NAIL	16D	16 INCHES O.C.
TOP PLATES, LAPS AND INTERSECTIONS, FACE NAIL	16D	2
CONTINUOUS HEADER, TWO PIECES	16	16 INCHES O.C. ALONG EACH EDGE
CEILING JOISTS TO PLATE, TOE NAIL	16D	2
CONTINUOUS HEADER TO STUD, TOE NAIL	16D	3
CEILING JOISTS, LAPS OVER PARTITIONS, FACE NAIL	16D	3
CEILING JOISTS TO PARALLEL RAFTERS, FACE NAIL	16D	3
RAFTER PLATE, TOE NAIL	16D	3
1-INCH x 6-INCH SHEATHINGS OR LESS TO EACH BEARING, FACE NAIL	8D	2
OVER 1-INCH x 6-INCH SHEATHING, TO EACH BEARING, FACE NAIL	8D	3 + 1 FOR EACH SIZE INCREASE
BUILT-UP CORNER STUDS, FACE NAIL	16D	30 INCHES O.C.
BUILT-UP GIRDERS AND BEAMS	20D	32 INCHES O.C. AT TOP AND BOTTOM AND STAGGERED, 2 AT ENDS AND AT EACH SPLICE
2-INCH PLANKS	16D	2 EACH BEARING

PRE-ENGINEERED WOOD TRUSS NOTES:

1.

TRUSSES SHALL BE DESIGNED IN ACCORDANCE WITH ANSI/TPI 1, AND THIS SPECIFICATION. WHERE ANY APPLICABLE DESIGN FEATURE IS NOT SPECIFICALLY COVERED BY ANSI/TPI 1 OR THIS SPECIFICATION, DESIGN SHALL BE IN ACCORDANCE WITH THE APPLICABLE PROVISIONS OF THE LATEST EDITION OF ANSI/AWC NDS - , AND ALL APPLICABLE LEGAL REQUIREMENTS.

2.

TRUSSES SHALL BE DESIGNED TO MEET THE REQUIREMENTS OF THE BCSI: JOINTLY PRODUCED BY THE STRUCTURAL BUILDING COMPONENTS ASSOCIATION (SBCA) AND THE TRUSS PLATE INSTITUTE (TPI) AND THE 2020 FRC AND SHALL COMPLY WITH FBC SECTION 2319.17.2 PREFABRICATED WOOD TRUSSES.

3.

TRUSS MANUFACTURER SHALL FURNISH TRUSS DESIGN DRAWINGS PREPARED IN ACCORDANCE WITH ALL APPLICABLE LEGAL REQUIREMENTS.

4.

THE TRUSS MANUFACTURER SHALL FURNISH A TRUSS PLACEMENT DIAGRAM WHICH SHALL PROVIDE AT A MINIMUM THE LOCATION ASSUMED FOR EACH TRUSS BASED ON THE TRUSS MANUFACTURER'S INTERPRETATION OF THE CONSTRUCTION DOCUMENTS

5.

THE TRUSS MANUFACTURER SHALL SUBMIT THE TRUSS SUBMITTAL PACKAGE TO THE BUILDING DESIGNER AND/OR THE LOCAL BUILDING OFFICIAL FOR REVIEW AND APPROVAL PRIOR TO THE MANUFACTURING OF THE TRUSSES.

6.

THE DESIGN, CONFIGURATION, LAYOUT, SPACING, ETC OF ALL TRUSSES SHALL BE COORDINATED BY THE CONTRACTOR AND THE TRUSS DESIGNER WITH THE MECHANICAL EQUIPMENT, DUCTWORK, AND ALL ARCHITECTURAL DRAWINGS.

7.

THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS OF THE TRUSSES FOR REVIEW BY THE ENGINEER. THE SHOP DRAWINGS SHALL BE STAMPED BY A PROFESSIONAL STRUCTURAL ENGINEER REGISTERED IN THE STATE OF FLORIDA.

8.

CONTRACTOR TO VERIFY ALL DIMENSIONS OF DRAWINGS IN FIELD PRIOR TO COORDINATION OF THE DESIGN, CONFIGURATION, LAYOUT, SPACING, ETC OF ALL TRUSSES BY THE CONTRACTOR AND THE TRUSS DESIGNER.

9.

CONTRACTOR TO CONFIRM UPLIFT ON TRUSSES DO NOT EXCEED THOSE SPECIFIED BY THE STRUCTURAL DRAWINGS.

Digitally signed
by Beau Tate
Date: 2023.04.12
'16:45:12 -05'00

This item has been digitally signed and sealed by Beau Tate, P.E., on the date specified. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

S-1

ROYAL ENGINEERS & CONSULTANTS

1501 RELIGIOUS ST.

NEW ORLEANS, LA 70130

(504) 283-9400

www.royalengineering.net


ID-014432 COKER 3 BR
SO

REBUILD FLORIDA
636 SE BAYVIEW DR.
LAKE CITY, FL 32025


STRUCTURAL NOTES

Project Number	2019-15
Date	04/11/2023
Drawn By	IP
Checked By	BT


FOR CONSTRUCTION

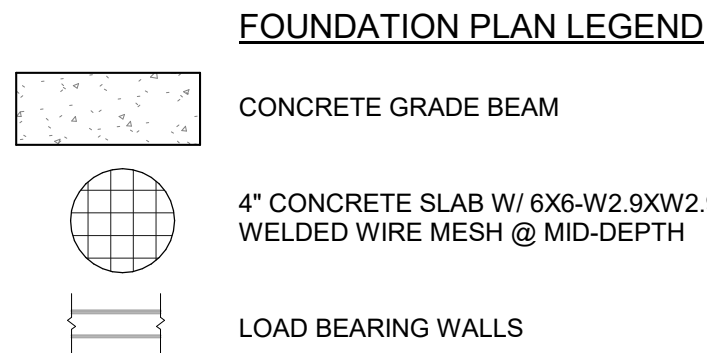


- FOUNDATION PLAN NOTES**
- SEE STRUCTURAL NOTES ON S-1
 - SIMPSON LTTT2 AT EVERY STUD TO SILL CONNECTION
 - SILLS ANCHORED TO FOUNDATION WITH 1/2" DIA. F1554 ANCHOR BOLTS EMBEDDED A MIN. OF 4" AT EVERY STUD FOR LOAD BEARING WALLS

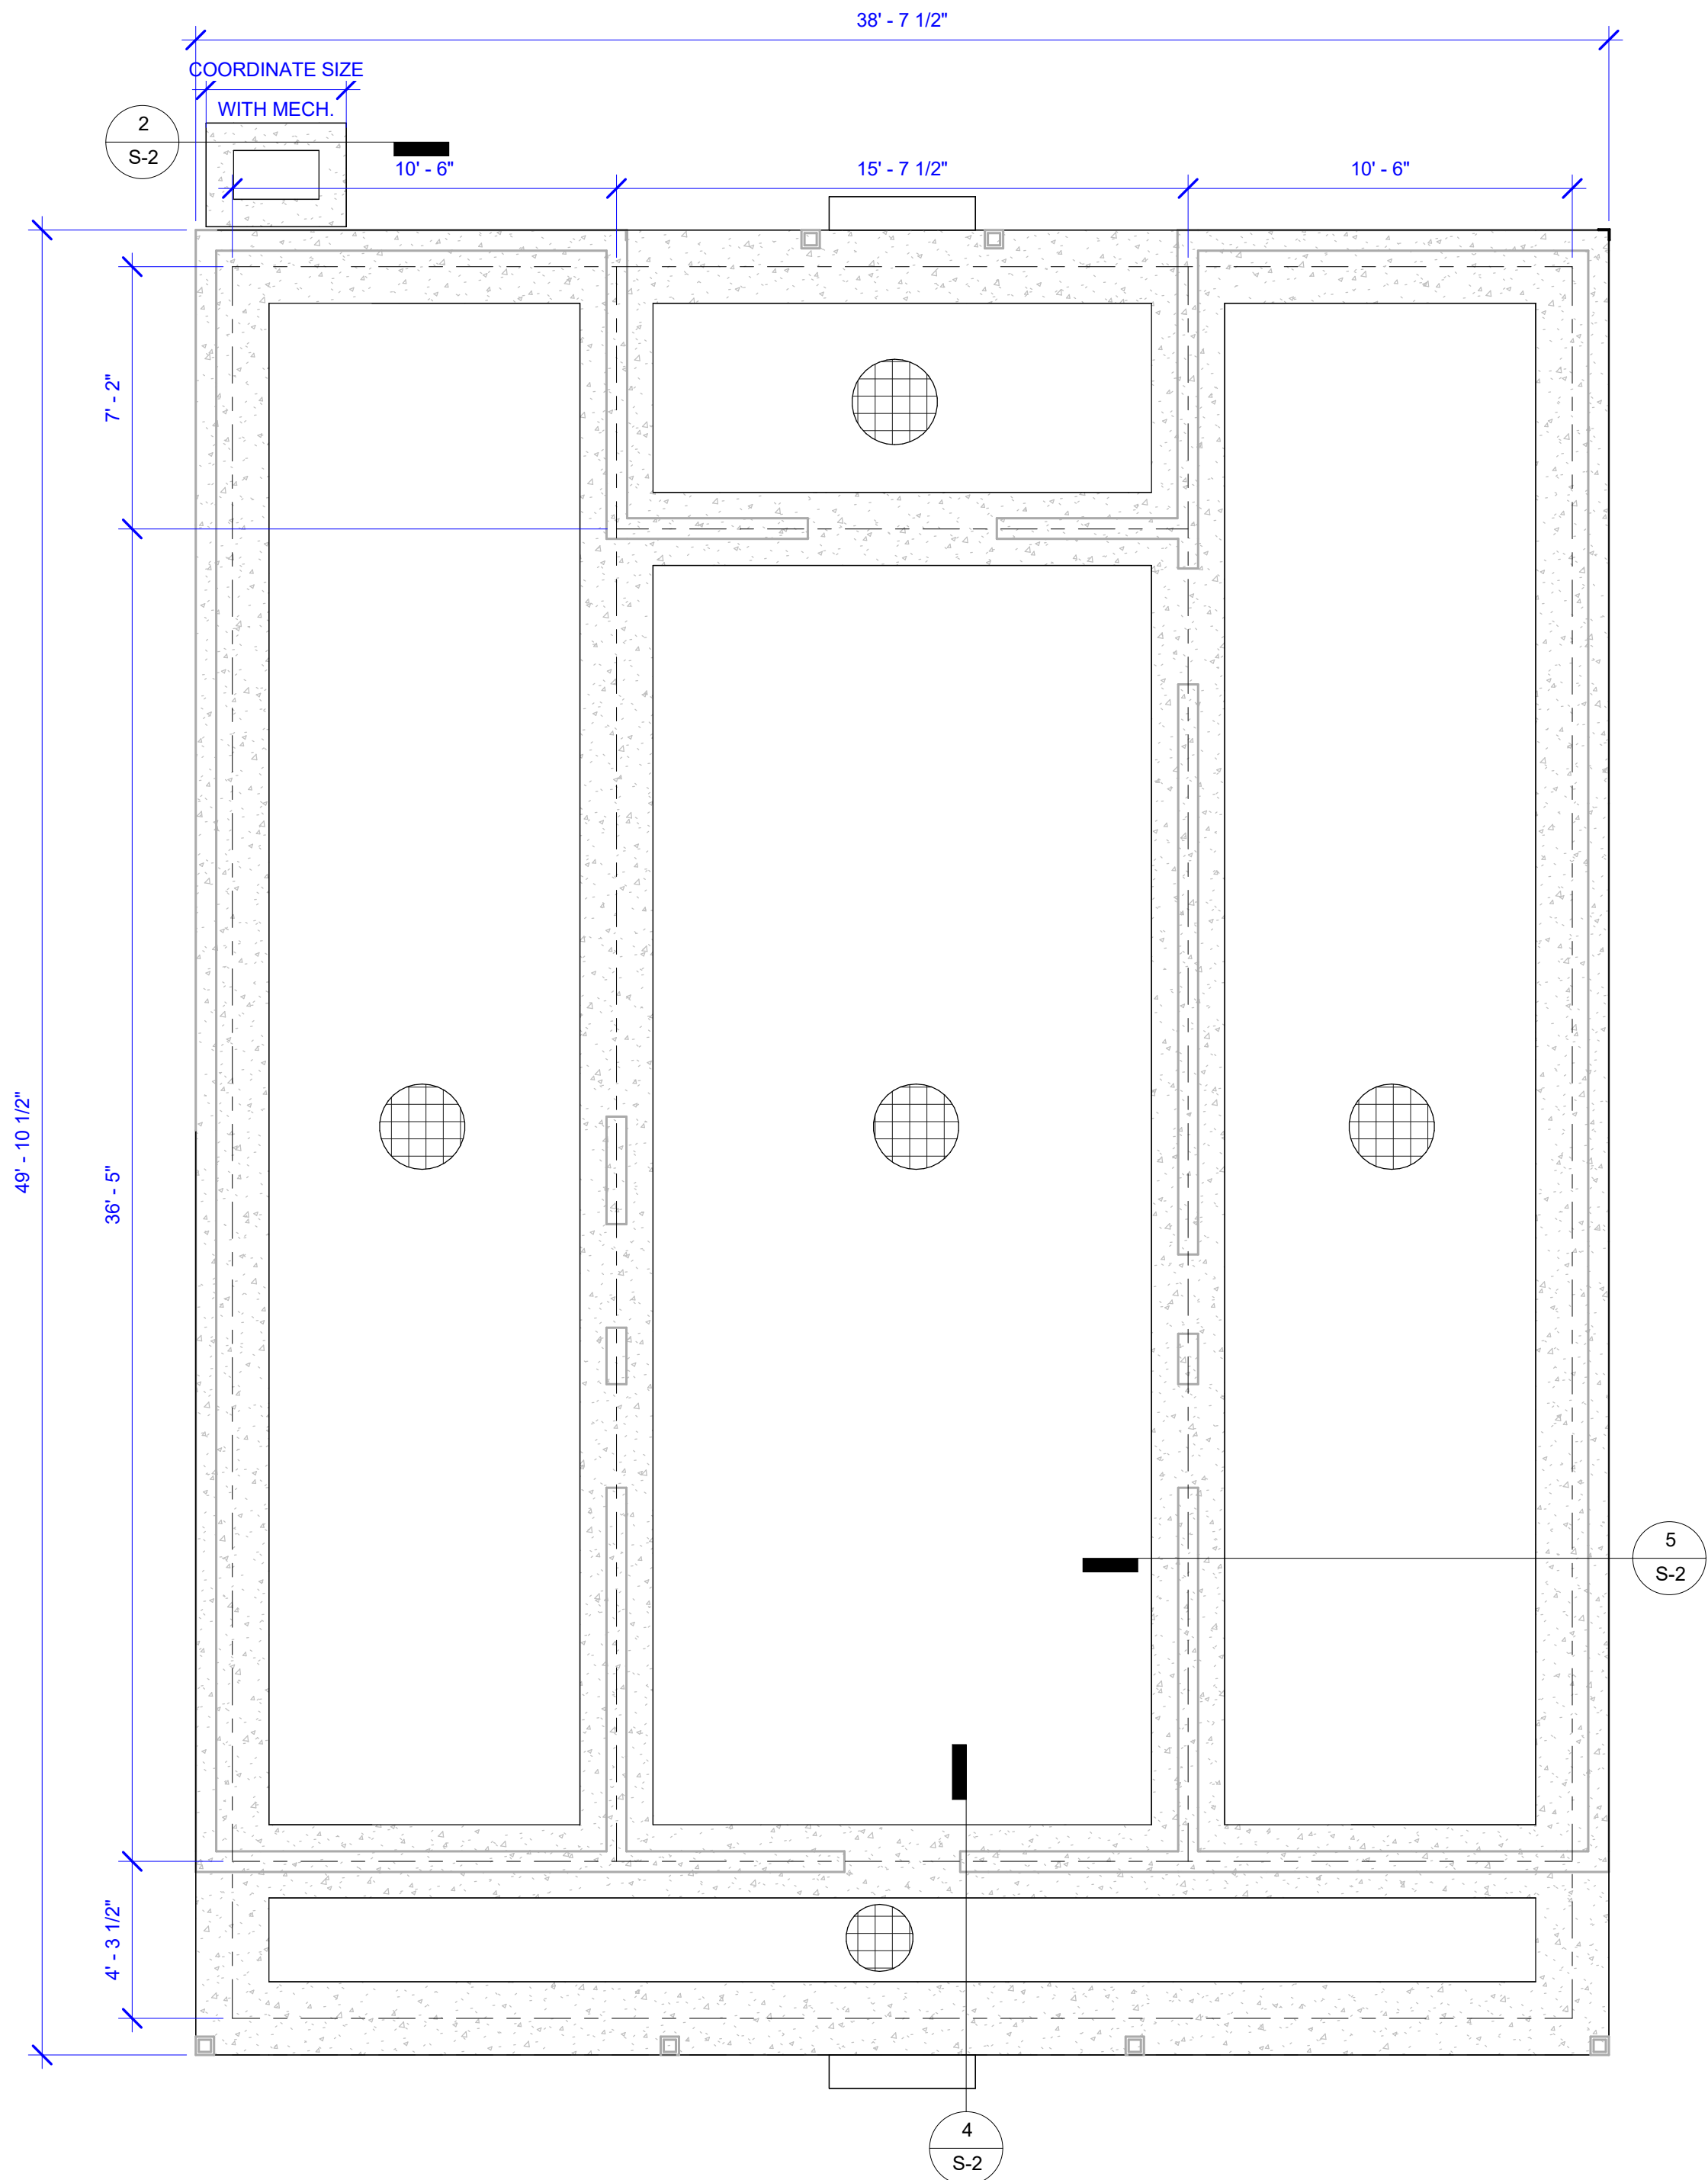


1 FOUNDATION PLAN
1/4" = 1'-0"

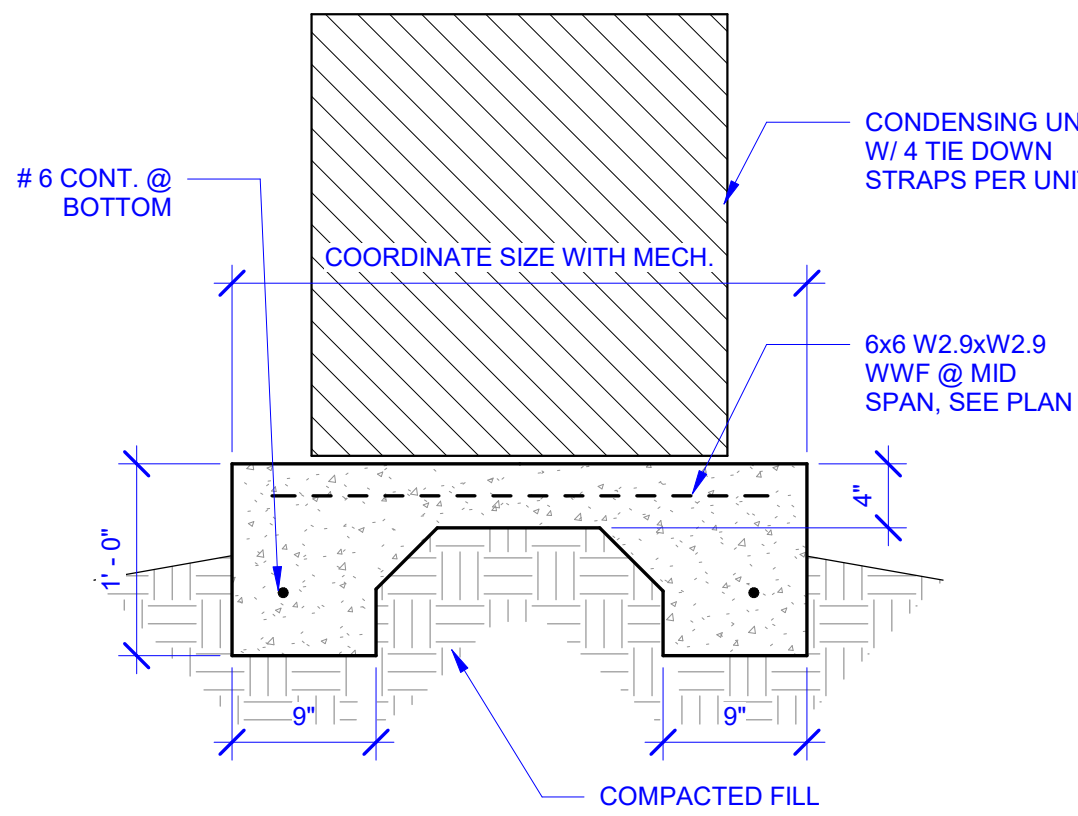


2 CONDENSER SLAB
1" = 1'-0"

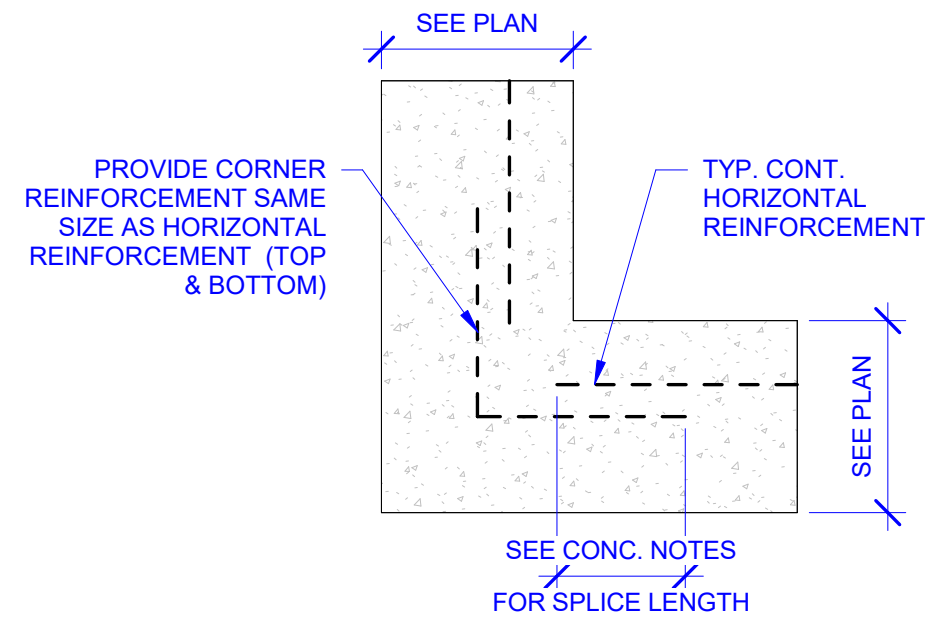

3 TYP. CORNER REINFORCEMENT LAP - PLAN VIEW
1" = 1'-0"

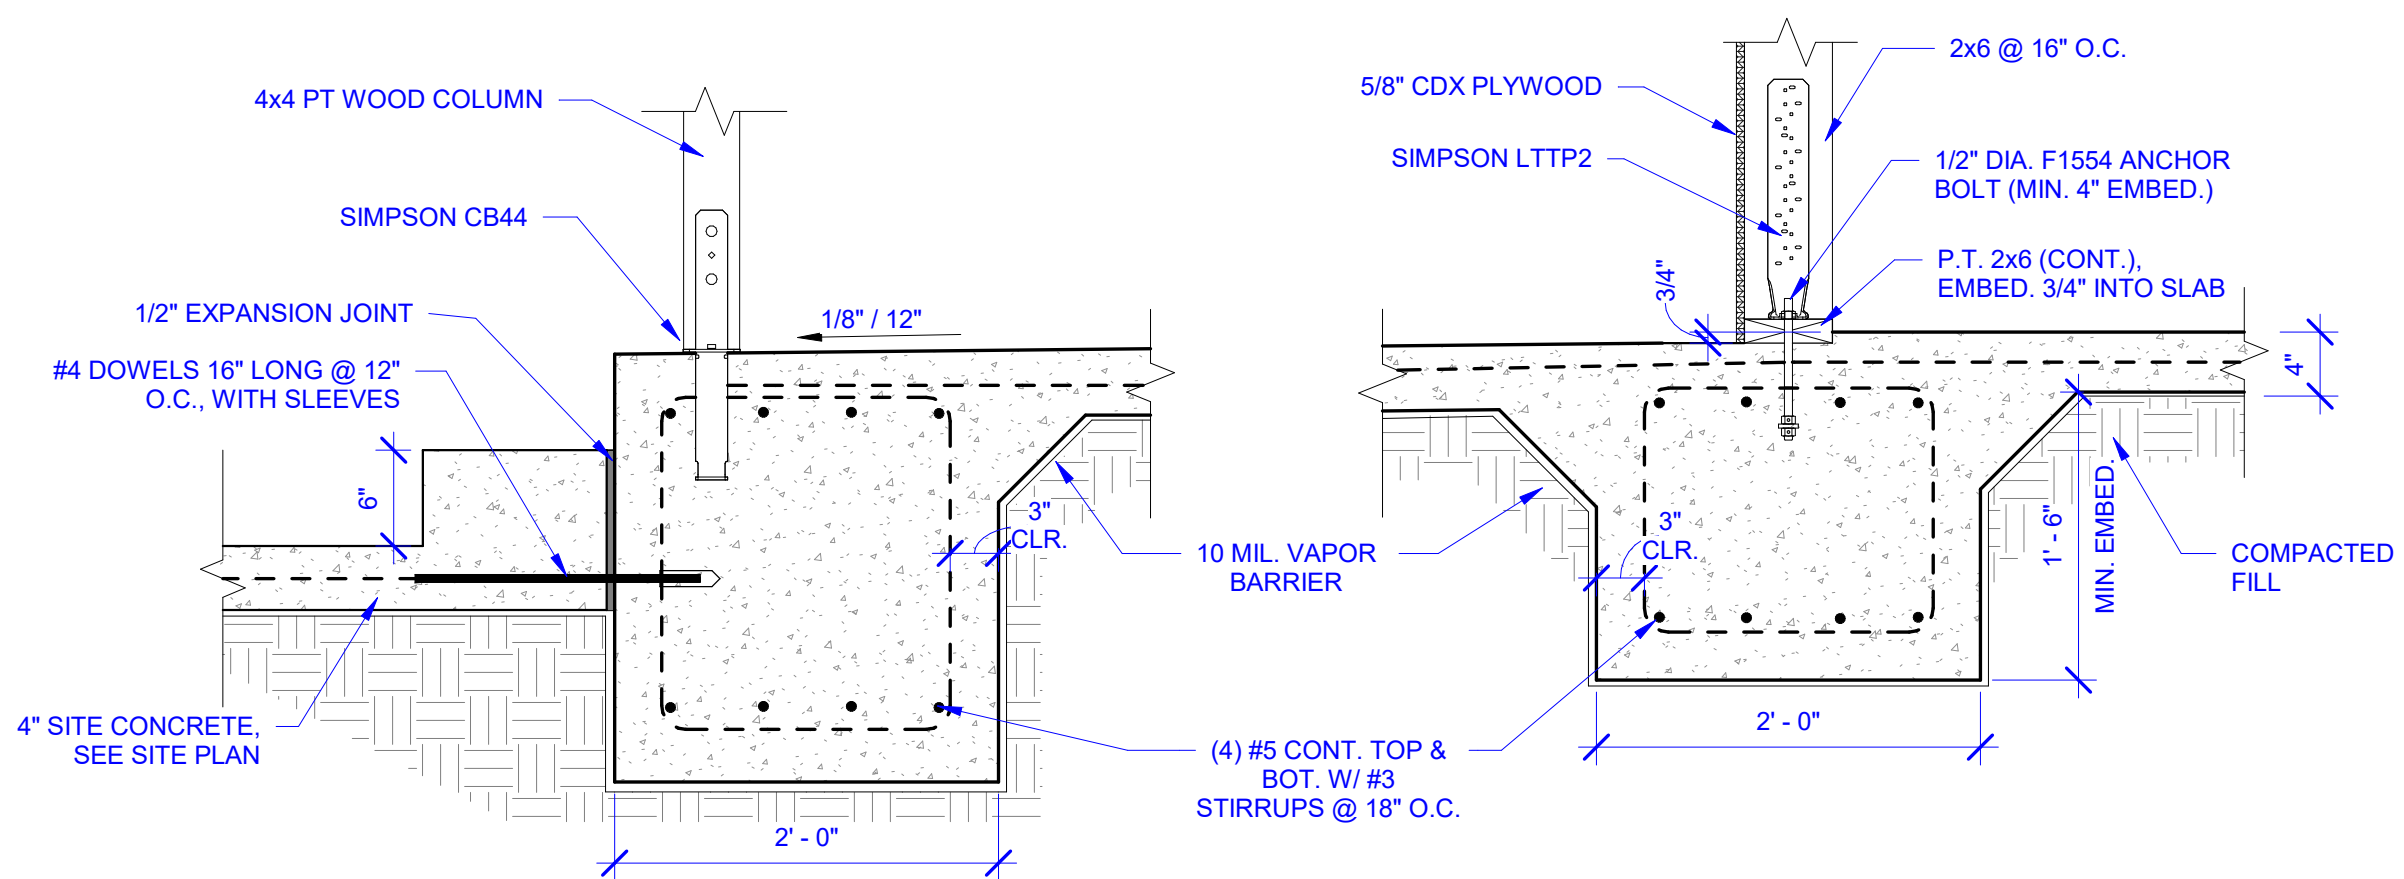

4 PORCH STEP FOUNDATION DETAIL
1" = 1'-0"

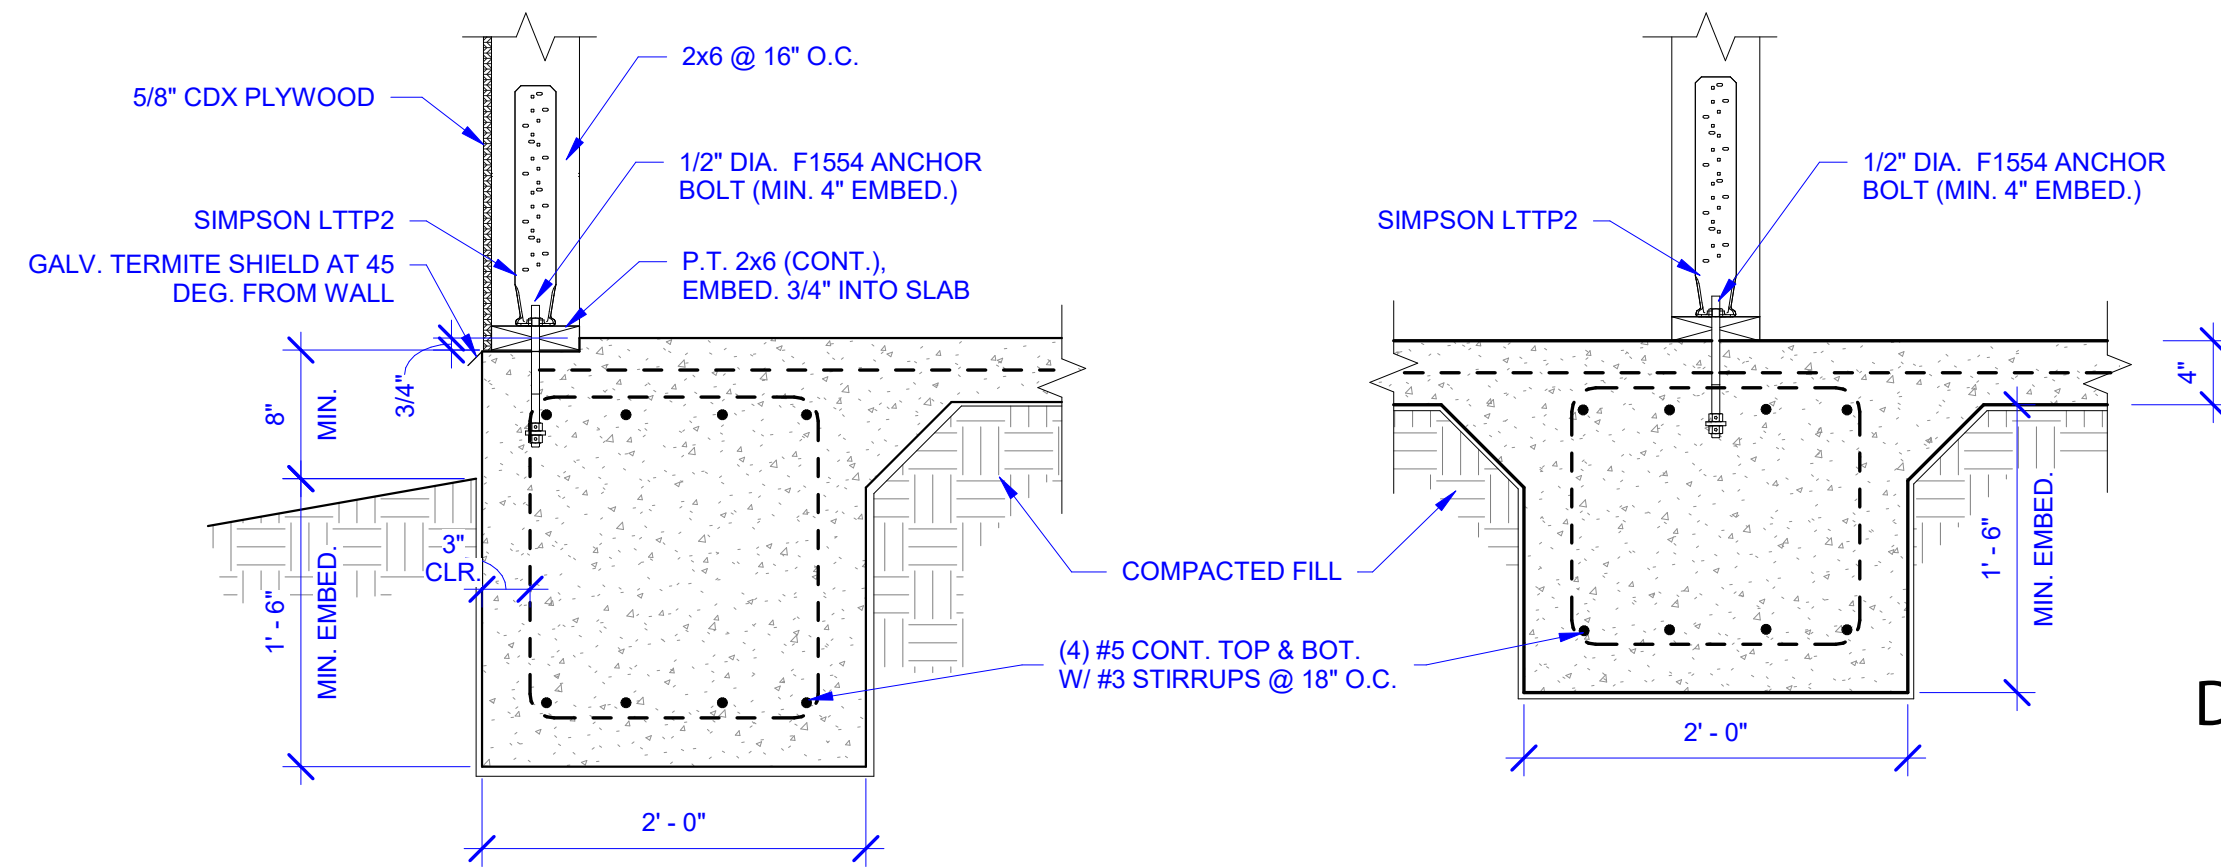

5 TYPICAL FOUNDATION
1" = 1'-0"

Digitally signed
by Beau Tate
Date: 2023.04.12
'16:45:27 -05'00

No.	Description	Date


ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net

ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYLA DR.
LAKE CITY, FL 32025



FOUNDATION PLANS & DETAILS

Project Number	2019-15
Date	04/11/2023
Drawn By	IP
Checked By	BT

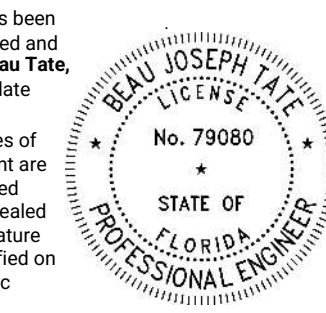FOR CONSTRUCTION




FRAMING PLAN LEGEND


-  LOAD BEARING 2X6 STUD WALL SPACED @ 16" O.C. , W/ 5/8" CDX PLYWOOD
-  (2) 2x12 BEAM

FRAMING PLAN NOTES


1. PROVIDE 3/4" PLYWOOD DECKING A MINIMUM OF 30" AROUND THE PERIMETER OF ANY EQUIPMENT IN ATTIC SPACE AND MIN. 24" PASSAGEWAY TO ANY EQUIPMENT FROM THE ATTIC ACCESS LOCATION
2. PROVIDE 2x6 BLOCKING FOR ALL LOAD BEARING STUD WALLS @ 48" O.C. MAX
3. PROVIDE 1/2" PLYWOOD BLOCKING AT RTC44 AND AC4 POST TO BEAM CONNECTIONS WHERE NECESSARY

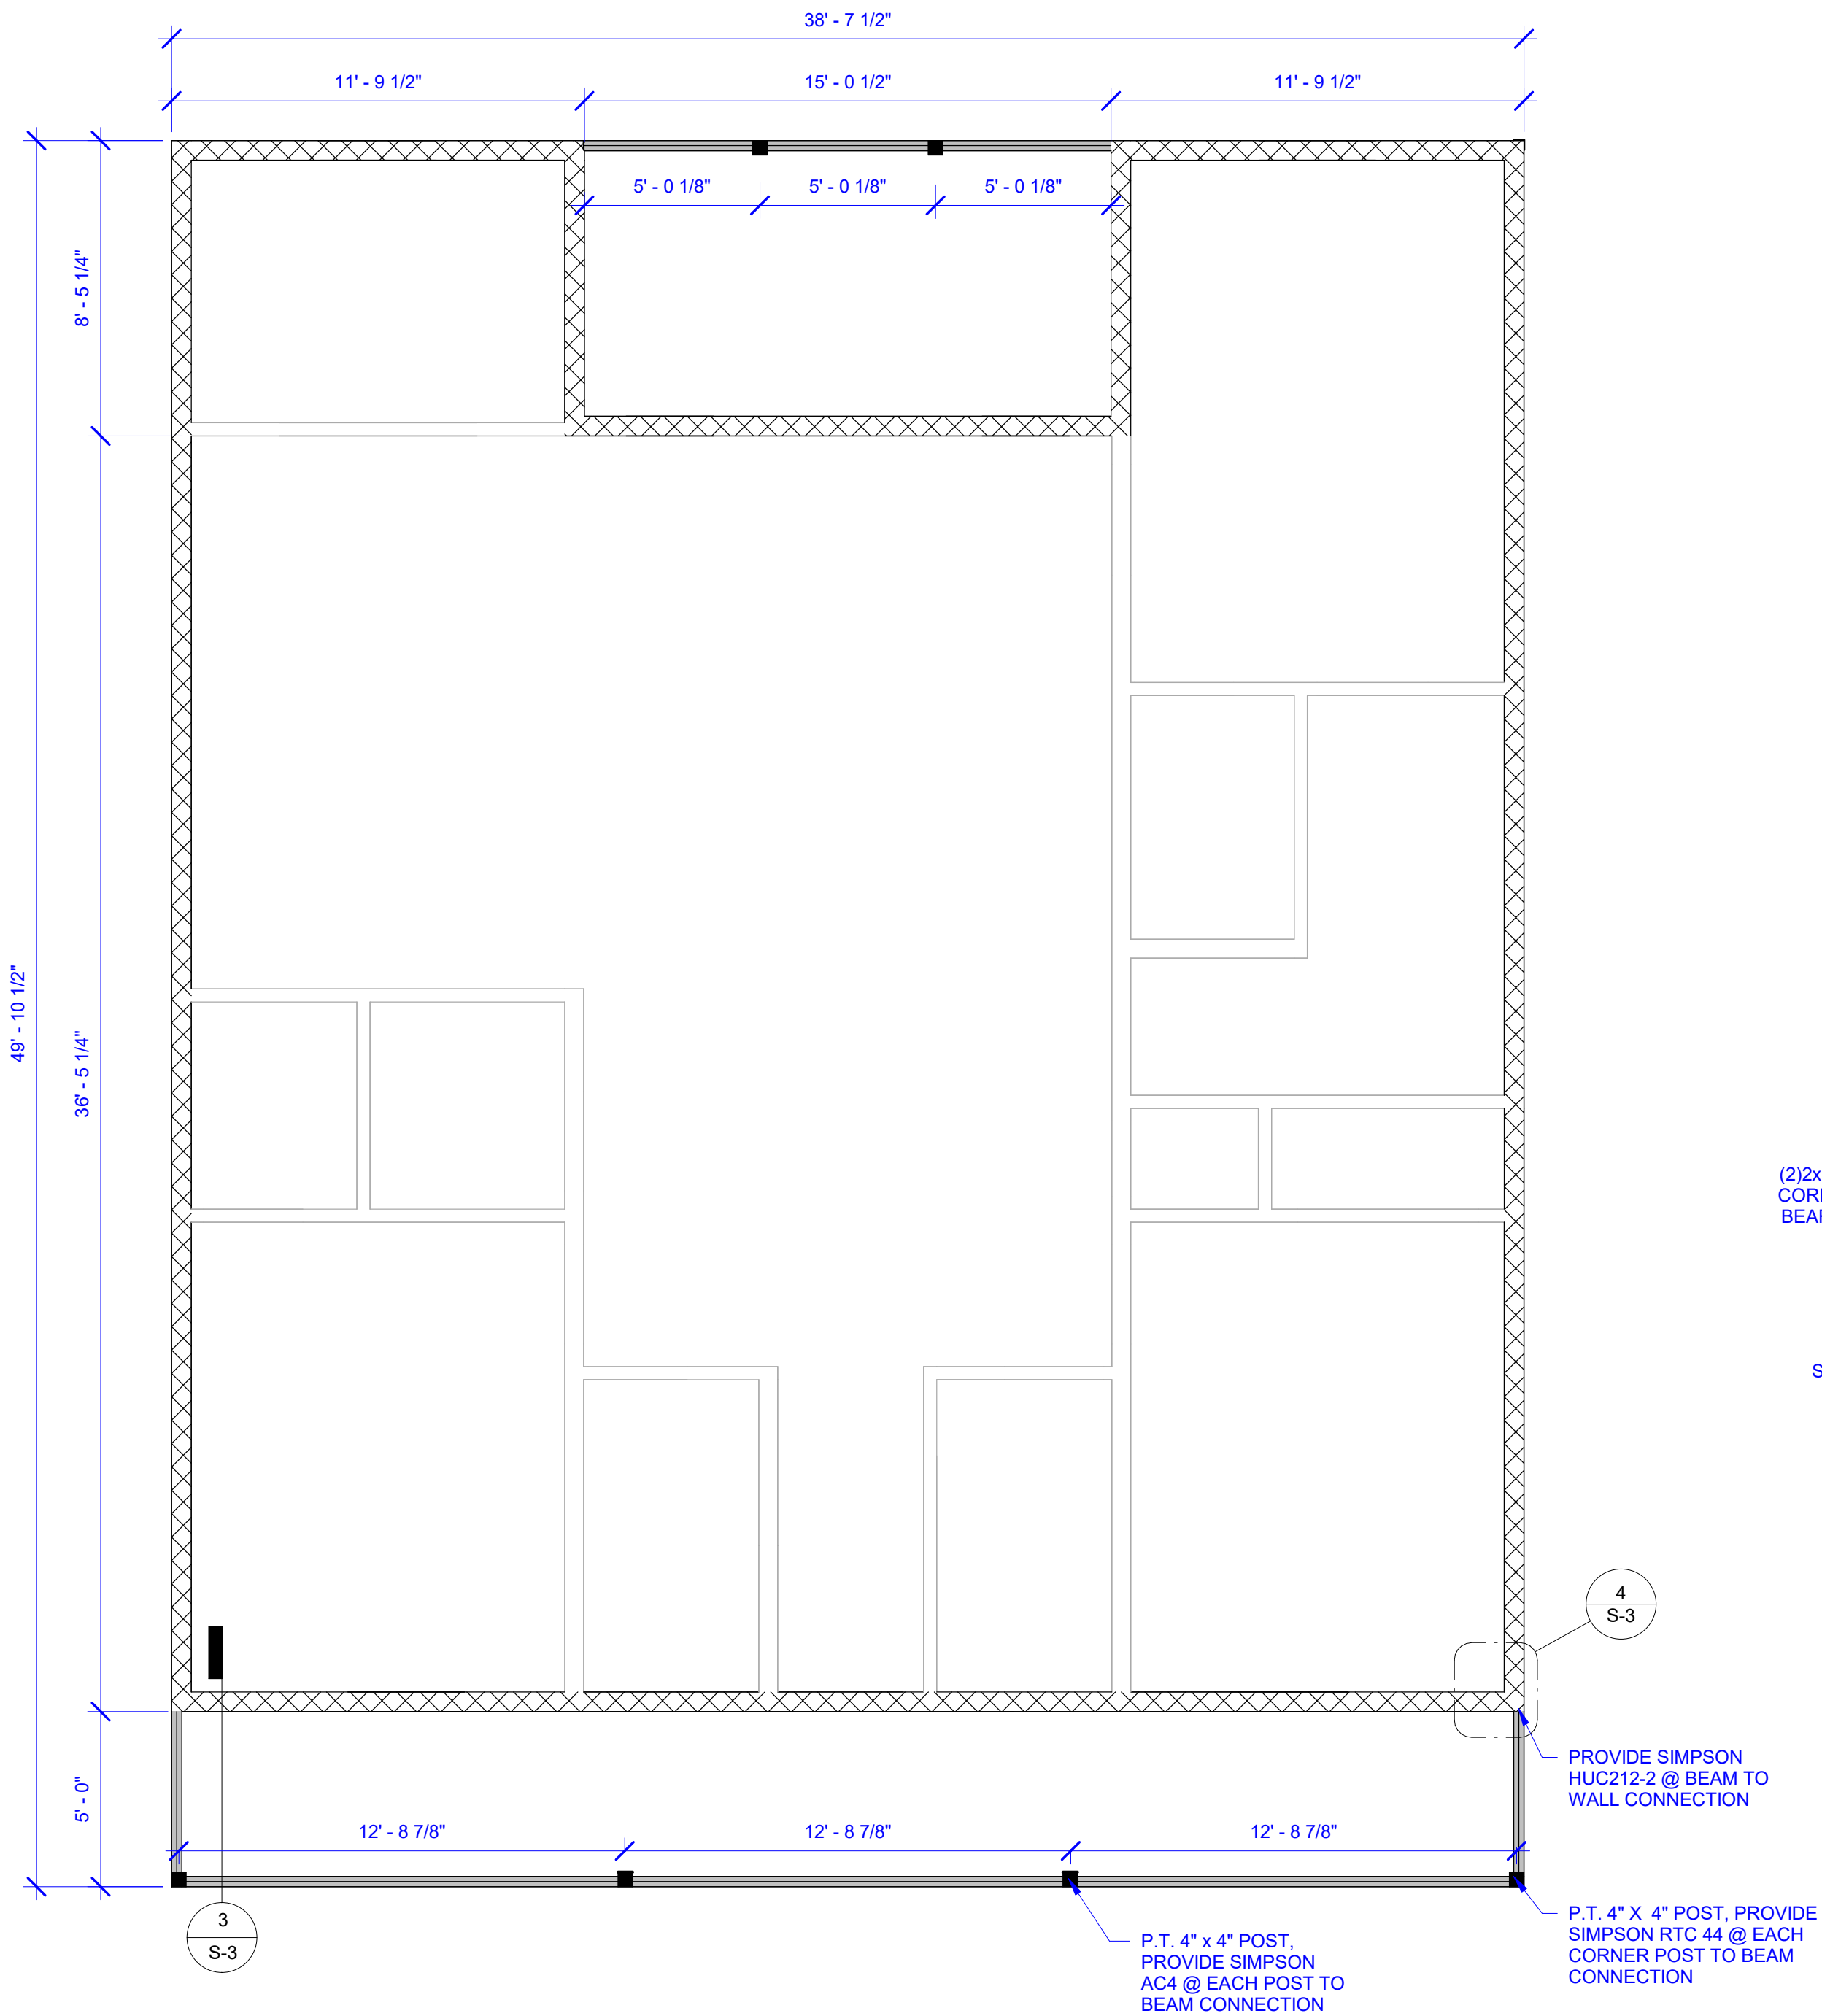


1 CEILING FRAMING PLAN
1/4" = 1'-0"

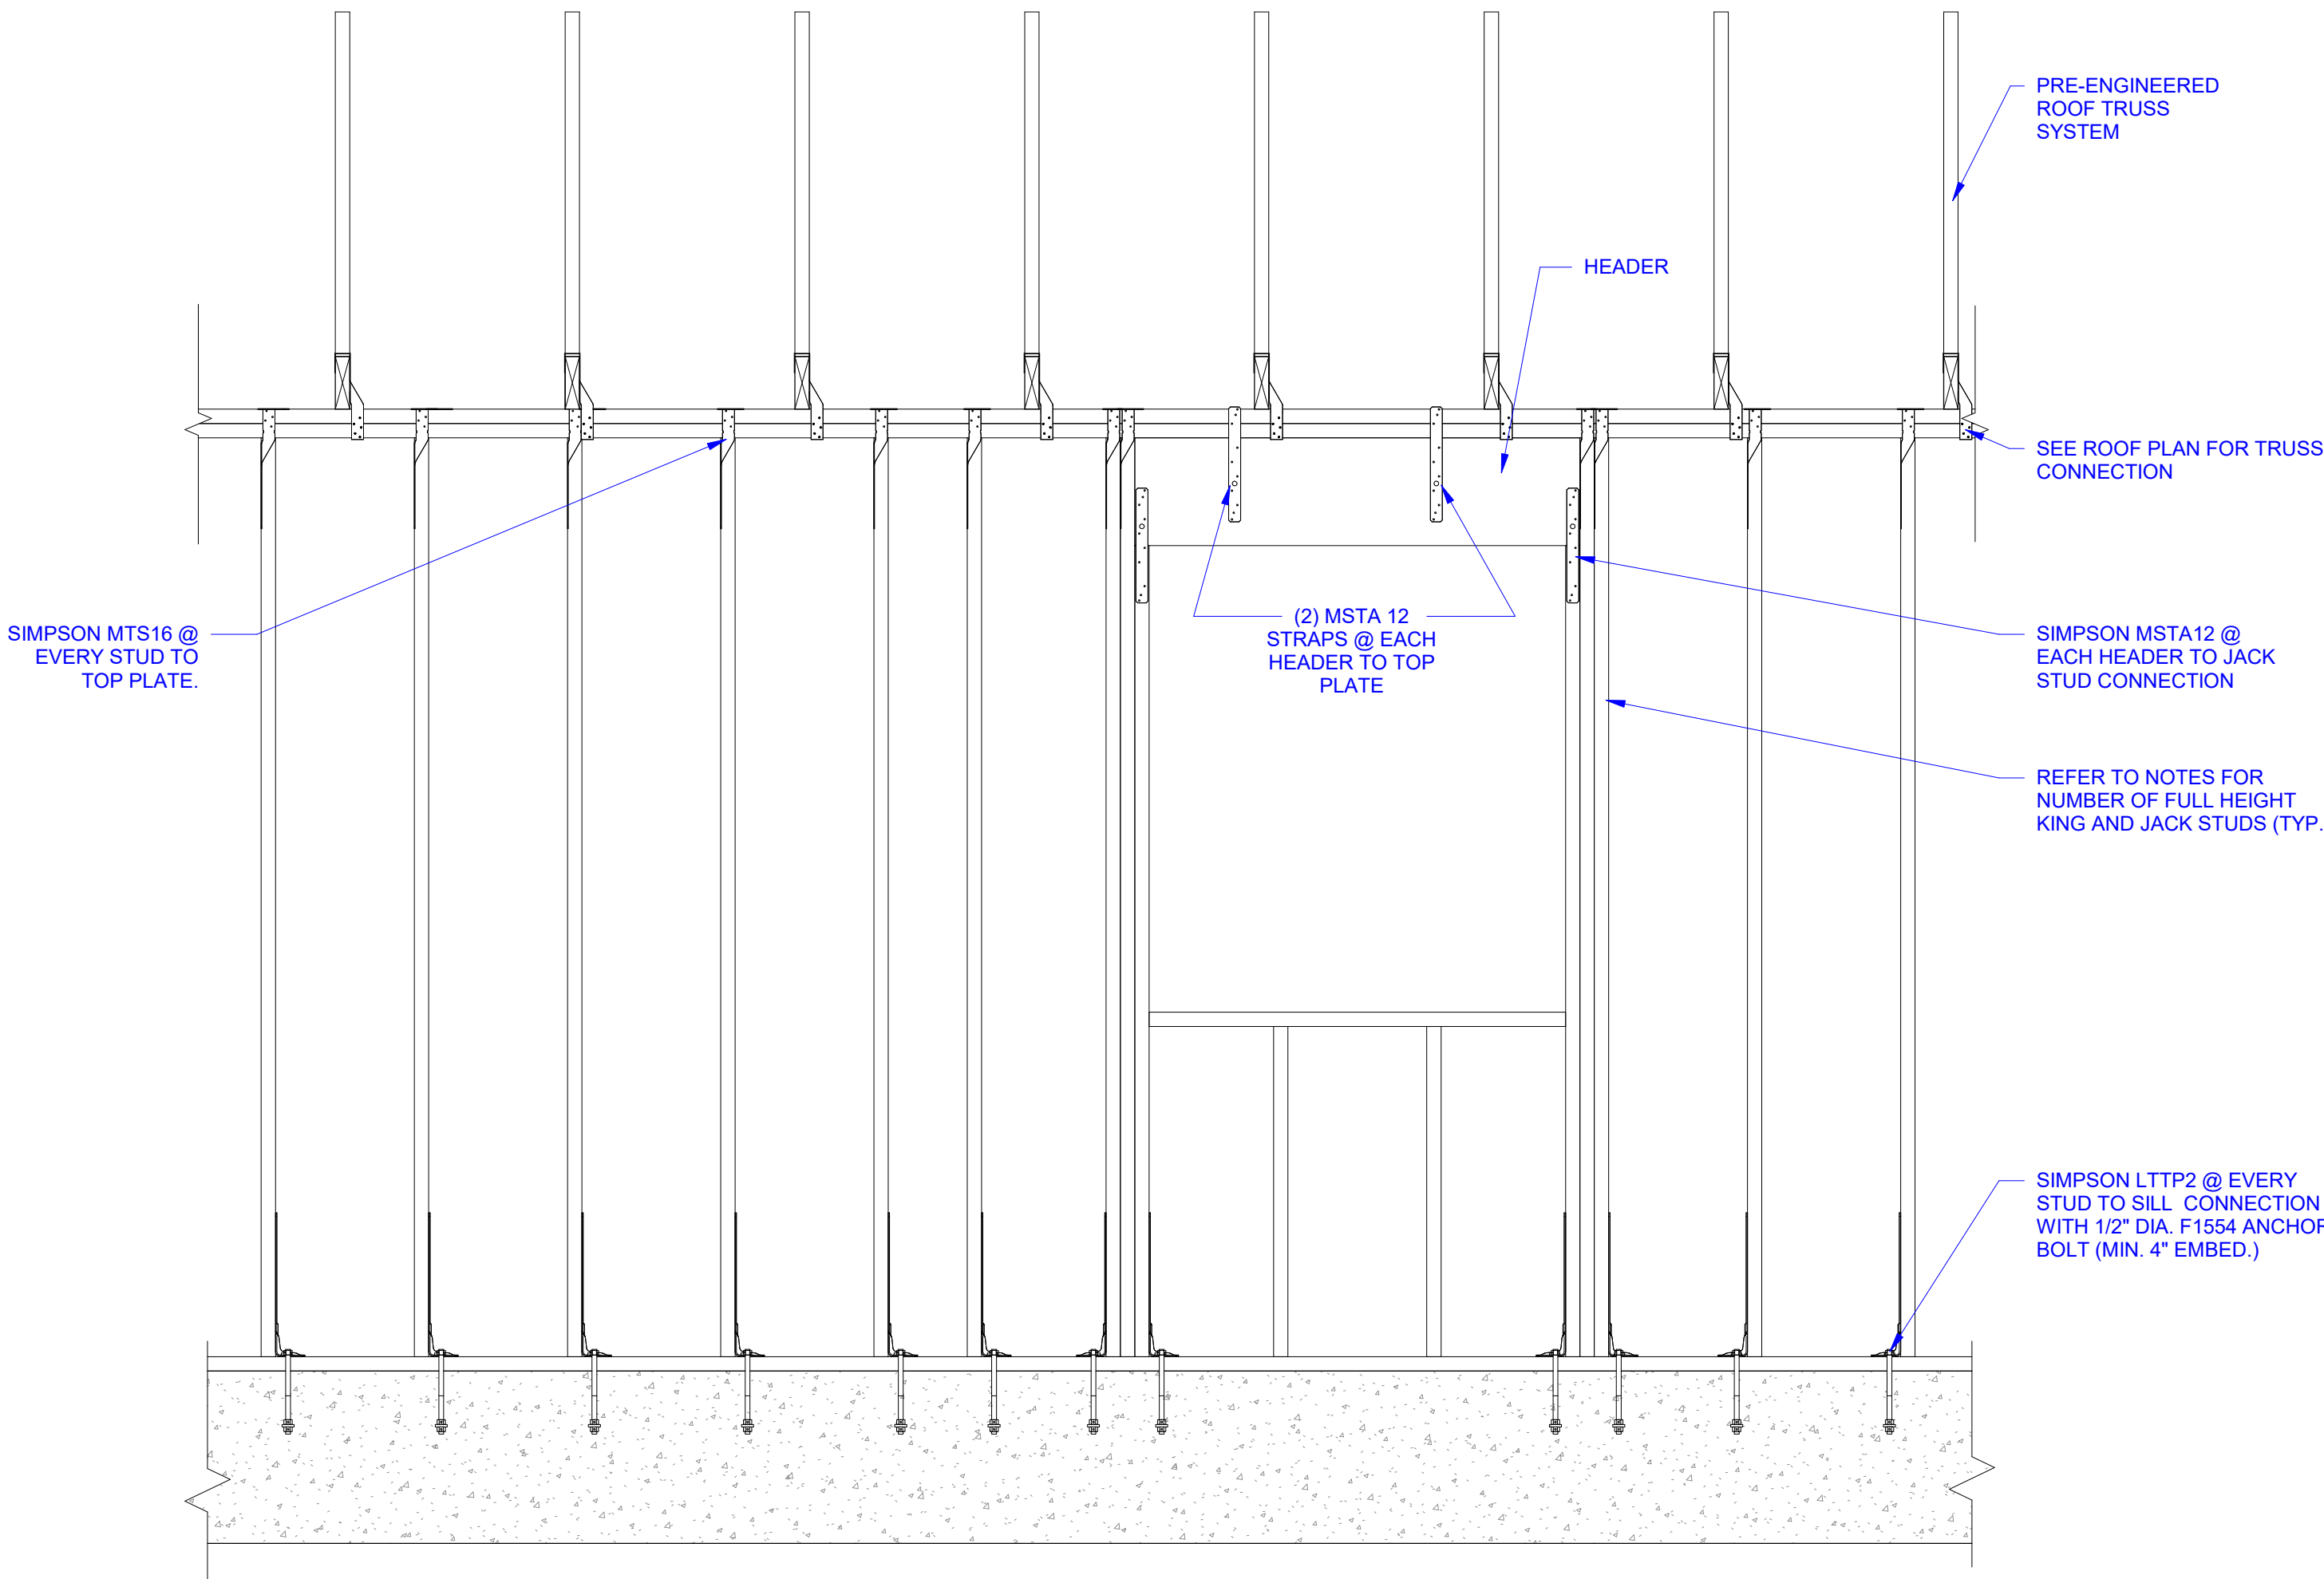

2 CONTINUOUS LOAD PATH DIAGRAM
3/4" = 1'-0"

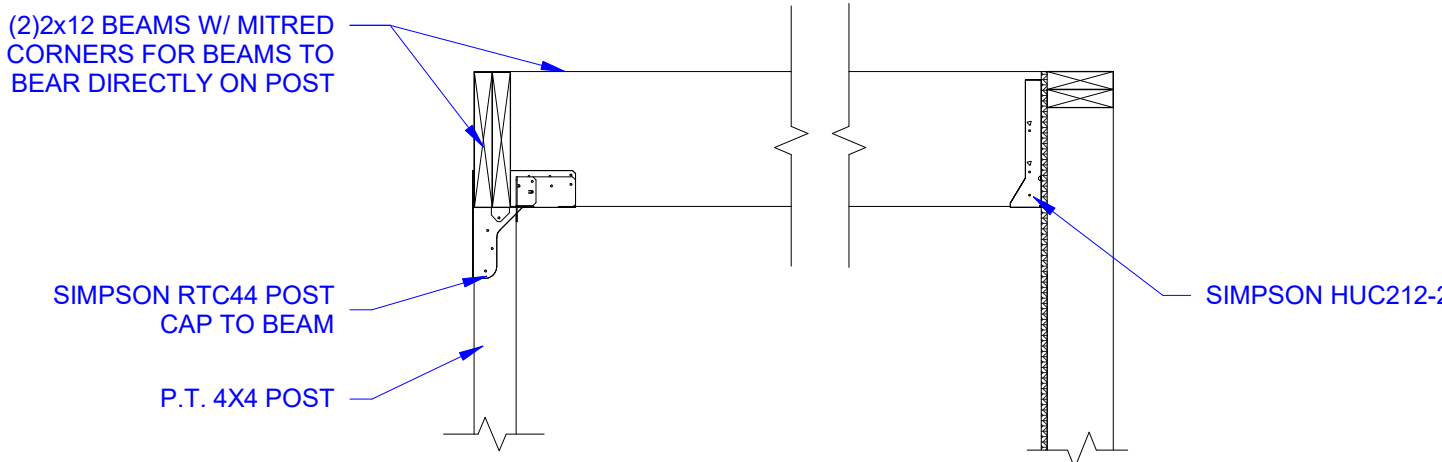

3 PORCH BEAM CONNECTION
3/4" = 1'-0"

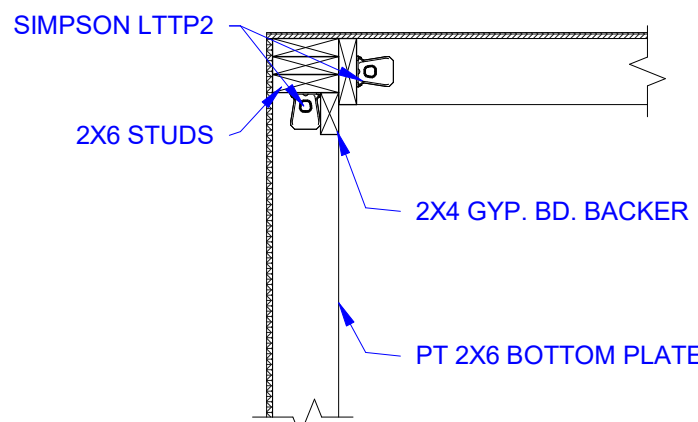

4 TYP. CORNER ANCHOR DETAIL
3/4" = 1'-0"

Digitally signed
by Beau Tate
Date:
2023.04.12
'16:45:43 -05'00

No.	Description	Date

ROYAL ENGINEERS & CONSULTANTS
1501 RELIGIOUS STREET
SUITE C
NEW ORLEANS, LA 70130
(504) 283-9400
www.royalengineering.net


ID-014432 COKER 3 BR
SOG
REBUILD FLORIDA
636 SE BAYVIEW DR.
LAKE CITY, FL 32025

CEILING FRAMING PLANS &
DETAILS

Project Number	2019-15
Date	04/11/2023
Drawn By	IP
Checked By	BT

FOR CONSTRUCTION

This item has been
digitally signed and
sealed by Beau Tate
P.E., on the date
specified.
Printed copies of
this document are
not considered
signed and sealed
and the signature
must be verified on
any electronic
copies.



1. PLYWOOD ROOF SHEATHING SHOULD BE APA RATED 23/32" (48/24)
2. PLYWOOD ROOF SHEATHING SHOULD BE RATED FOR EXPOSURE 1
3. PLYWOOD ROOF SHEATHING SHOULD BE CONTINUOUS OVER TWO OR MORE SPANS WITH FACE GRAIN PERPENDICULAR TO SUPPORTS ROOF SHEATHING PANELS SHALL BE PROVIDED WITH MIN. OF 2x4 EDGEWISE BLOCKING AT ALL HORIZONTAL PANEL JOINTS WITH EDGE SPACING AT LEAST 4 FEET FROM EACH GABLE END
4. ROOF SHEATHING FASTENED WITH WITH ASTM F1667 RRSR-03 (21/2" x 0.131") NAILS OR ASTM F1667 RRSR-04 (3" x 0.120") NAILS SPACED AT 4" O.C. MAX. ALONG SUPPORTING MEMBERS AT THE EDGES OF EACH SHEET AND 4" O.C. MAX. ALONG SUPPORTING MEMBERS ON THE INTERIOR OF EACH SHEET
5. VERTICAL JOINTS OF PLYWOOD ROOF SHEATHING SHALL BE STAGGERED EVERY FOUR FEET (4'-0") OR LESS.

CONTRACTOR SHALL PROVIDE PRE-ENGINEERED ROOF TRUSS SYSTEM.
CONTRACTOR SHALL PROVIDE ENGINEERED STAMPED TRUSS DESIGN TO THE
PERMIT DEPARTMENT AND ENGINEER OF RECORD. SEE ROOF TRUSS NOTES ON S1.0

***TRUSS STRAPS ARE PRELIMINARY AND MUST BE CHECKED
FOR ADEQUACY AGAINST THE TRUSS DESIGN.***



PRE-ENGINEERED ROOF TRUSS SYSTEM

PLYWOOD ROOF SHEATHING

E (1) SIMPSON HTS16 ROOF TRUSS TO TOP E CONNECTION, TYP.

2' - 0"

DOUBLE 2x6 (CONT.) TOP PLATE SEE PLAN

2x6 @ 16" O.C.

5/8" CDX PLYWOOD

PRE-ENGINEERED ROOF TRUSS SYSTEM

PLYWOOD ROOF SHEATHING

SIMPSON HTS16

2' - 0"

P.T. (2)2x12 BEAM

PRE-ENGINEERED ROOF TRUSS SYSTEM

PLYWOOD ROOF SHEATHING

DOUBLE 2x6 (CONT.) TOP PLATE SEE PLAN

(1) SIMPSON HDU4 & (1) SIMPSON MGT @ EACH GIRDER TRUSS TO TOP PLATE CONNECTION W/ TRIPLE STUD BELOW GIRDER TRUSS

5/8" CDX PLYWOOD

2x6 @ 16" O.C.

⑤ HTS Installation as a Truss-to-Top Plate Tie
NOT TO SCALE

This item has been digitally signed and sealed by **Beau Tate, P.E.**, on the date specified.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.



SOG
REBUILD FLORIDA
636 SE BAY DR,
LAKE CITY, FL 32025

ROOF FRAMING PLANS & DETAILS

Number	2019-15
	04/11/2023
By	IP
ed By	BT