




C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR

SAUNDER'S 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL



REVISIONS	
Date	Description

Jimison architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

COVER/TITLE

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDER'S 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO.:	
CAD FILE:	
SCALE:	AS INDICATED
These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit. Copyright © 2020	

DRAWING NUMBER

T-1

Sheet 1 of 28

INDEX OF DRAWINGS		
DRAWING	SHEET TITLE	SHEET
T-1	COVER/TITLE	1
X-1	PROJECT NOTES	2
X-2	PROJECT NOTES	3
X-3	PROJECT NOTES	4
X-4	PROJECT NOTES	5
X-5	WIND LOADS	6
C-1	SITE LAYOUT PLAN	7
A-1	FLOOR PLAN	8
A-2	DOOR & WINDOW SCHEDULES	9
A-3	DOOR DATA 1	10
A-4	DOOR DATA 2	11
A-5	DOOR DATA 3	12
A-6	DOOR DATA 4	13
A-7	DOOR DATA 5	14
A-8	DOOR DATA 6	15
A-9	DOOR DATA 7	16
A-10	WINDOW DATA 1	17
A-11	WINDOW DATA 2	18
A-11	WINDOW DATA 3	19
A-12	WINDOW DATA 4	20
A-13	FOUNDATION PLAN	21
A-14	WALL SECTIONS	22
A-14	ROOF FRAMING PLAN	23
M-1	PLUMBING PLAN	24
M-2	HVAC CALCULATIONS & PLAN	25
E-1	ELECTRICAL NOTES & LEGEND	26
E2	ELECTRIC POWER PLAN	27
E3	LIGHTING PLAN	28



1. GENERAL:

A. THESE GENERAL NOTES PRESENT AND/OR SUMMARIZE KEY PROJECT INFORMATION FOR THE PLAN READER'S CONVENIENCE. SEE PLANS, DETAILS AND PROJECT MANUAL FOR FURTHER REQUIREMENTS.

B. THESE DRAWINGS ARE COMPLIMENTARY. WHAT IS CALLED FOR ON ONE IS CALLED FOR BY ALL.

1] IN THE EVENT OF CONFLICT AMONG THE DRAWINGS:

- a. THE ARCHITECTURAL DRAWINGS SHALL GOVERN AS TO SIZES, LOCATIONS, MATERIALS AND FINISHES OF THE BUILDING.
- b. DRAWINGS OF STRUCTURAL ELEMENTS SHALL GOVERN AS TO THE SIZES, MATERIALS, SPACING AND LOCATION OF THOSE ELEMENTS.
- c. DRAWINGS RELATED TO PLUMBING FACILITIES SHALL GOVERN AS TO THE SIZES AND MATERIALS.
- d. DRAWINGS RELATED TO HEATING, VENTILATION AND AIR CONDITIONING [HVAC] SHALL GOVERN THE TYPES, CAPACITIES AND LOCATION OF FANS, DUCTWORK AND UNITS, SUBJECT TO COORDINATION WITH THE ARCHITECTURAL DRAWINGS.
- e. DRAWINGS RELATED TO THE ELECTRICAL SYSTEMS, POWER, LIGHTING, FIRE ALARM AND COMMUNICATIONS SHALL GOVERN AS TO SIZES CAPACIITES AND MATERIALS, LOCATIONS SHALL BE COORDINATED WITH THE ARCHITECTURAL DRAWINGS.

2] IN THE EVENT OF CONFLICTS AMONG THE VARIOUS PARTS OF THE DRAWINGS; THE ENLARGED DRAWINGS AND DETAILS SHALL TAKE PREDENCE OVER THE SMALLER DRAWINGS.

3] OTHER CONFLICTS WHICH MAY ARISE SHALL BE REFERRED TO THE OWNER FOR RESOLUTION.

B. ALL WORK AND MATERIALS SHALL CONFORM TO THE CURRENT ADOPTED EDITION OF THE FLORIDA BUILDING CODE AND ALL REFERENCES THEREIN.

C. ALL REFERENCES TO STANDARDS HEREIN ARE TO MOST RECENT EDITION IN EFFECT AS OF THE DATE OF THESE DOCUMENTS, UNLESS SPECIFICALLY NOTED OTHERWISE IN THE PROJECT SPECIFICATIONS.

D. UNLESS SPECIFICALLY NOTED OTHERWISE, REQUIREMENTS GIVEN FOR ONE OR MORE LOCATIONS ALSO APPLY AT OTHER LOCATIONS AT WHICH CONDITIONS ARE SIMILAR. THE REQUIREMENTS GIVEN SHALL BE ADAPTED TO SUCH OTHER LOCATIONS.

E. IT IS MANDATORY THAT THE WORK OF OTHER TRADES SHOWN ON DRAWINGS BE COORDINATED WITH ALL FRAMING.

F. IF A CONFLICT EXISTS WITH OTHER PLAN NOTES OR SPECIFICATIONS ELESWHERE, THE PROVISIONS HEREIN NOTED SHALL PREVAIL.

G. VERIFY ALL EXISTING CONDITIONS, DIMENSIONS, LOCATIONS ON SITE. SIGNIFICANT DIFFERING CONDITIONS SHALL BE REPORTED TO THE OWNER IMMEDIATELY.

H. DAMAGE TO THE PREMISES CAUSED BY THE CONTRACTOR'S, SUBCONTRACTORS OR MATERIAL SUPPLIERS OPERATIONS SHALL BE REPAIRED OR REPLACED TO THE APPROVAL OF THE OWNER AT NO ADDITIONAL COST TO THE OWNER.

I. PREPARE AND SUBMIT SHOP DRAWINGS FOR STRUCTURAL STEEL, TIMBER TRUSSES AND OTHER FABRICATED ITEMS FOR REVIEW PRIOR TO FABRICATION.

2. DESIGN LIVE LOADS:

- A. ROOF:..... 20 PSF
- B. ATTIC/MEZZANINE:..... 40 PSF
- C. INTERIOR WALL LATERAL..... 10 PSF

3. DEAD LOADS:

APPLY THE DEAD LOAD IN ADDITION TO THE LVE LOAD AT THE AREA CONCERNED, BUT SHALL NOT BE LESS THAN:

- 1] TOP OF THE ROOF:.....15 PSF
- 2] CEILING:.....20 PSF



REVISIONS		Description
Date	Symbol	

Jimison architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

PROJET NOTES 1

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO:	
CAD FILE:	
SCALE:	AS INDICATED

These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020



4. WIND VELOCITY:.....120 MPH

5. MATERIAL AND CONSTRUCTION

A. SOIL:

- 1] ALLOWABLE SOIL BEARING CAPACITY = 2,500 PSF
- 2] ALL FILLS UNDER NEW FOOTING SHALL BE COMPACTED AT OPTIMUM MOISTURE CONTENT TO 98% STANDARD PROCTOR ASTM D698.

B. CONCRETE:

- 1] ALL CONCRETE WORK SHALL CONFORM TO AMERICAN CONCRETE INSTITUTE'S (ACI) : "STANDARD BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE", LATEST EDITION.
- 2] CONCRETE SHALL HAVE A MINIMUM STRENGTH OF 3,000 PSI AT 28 DAYS

C. REINFORCING STEEL:

- 1] ALL REINFORCING STEEL SHALL BE INTERMEDIATE BILLET STEEL CONFORMING TO ASTM A615, GRADE 40.
- 2] MINIMUM SPLICE LENGTH TO BE 40 BAR DIAMETER.

D. STRUCTURAL STEEL, IF USED:

- 1] ALL STRUCTURAL STEEL WORK SHALL CONFORM TO AMERICAN INSTITUTE OF STEEL CONSTRUCTION'S (AISC) "SPECIFICATIONS OF DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS", LATEST EDITION.

E. INSULATING CONCRETE FORMING SYSTEM (ICF):

- 1] PROVIDE A INSULATING CONCRETE FORM SYSTEM AS SHOWN AND DETAILED ON THE DRAWINGS.
- 2] FORMING SYSTEM SHALL CARRY AN ACTIVE LISTING/CLASSIFICATION FOR FIRE RESISTANCE RATING OF THE COMPLETED WALL ASSEMBLY AS ENDORSED BY UNDERWRITERS LABORATORIES® UL PER TESTING TO THE ANSI/UL-263 STANDARD.
- 3] FORM SYSTEM SUPPLIED SHALL PROVIDE FULL HEIGHT WEBS FASTENING STRIPS IN CONTACT THROUGHOUT HEIGHT OF THE WALL ASSEMBLY AT 8-INCHES (203 MM) O/C PLACEMENT WITHIN SYSTEM TO ASSURE MINIMUM SETTLEMENT DURING CONCRETE PLACEMENT AND MAXIMUM SLEEVE INSERTION DIAMETER POSSIBLE BETWEEN WEBS.

3. FORM SYSTEM SHALL PROVIDE DOVETAIL FLUTES TO BOTH SIDES OF ITS INTERIOR CAVITY TO ENABLE STRUCTURAL BONDING OF CONCRETE TO FOAM ONCE CONCRETE IS CURED.

F. INSULATING CONCRETE FORMING SYSTEM (ICF)

- 1] WHERE PROJECT SCOPE PERMITS, FORM UNITS SHALL BE SUPPLIED THROUGH AN AUTHORIZED DISTRIBUTOR OF THE MANUFACTURER . THE DISTRIBUTOR SHALL BE CAPABLE OF PROVIDING PRODUCT ON SITE WITHIN 24 HOURS NOTICE.
- 2] INSULATING CONCRETE FORM SYSTEM SHALL PROVIDE A MINIMUM INSULATION PANEL THICKNESS OF 2 5/8-INCHES THROUGHOUT ALL FORMS AND PANELS FORMING THE FORM SYSTEM PRODUCT INVENTORY (WITH EXCEPTION OF VARIANCE REQUIRED FOR BRICK LEDGE AND TAPERED TOP FORMS).
- 3] STANDARDS, CORNER FORMS AND STAND ALONE PANELS OF FORM SYSTEM SHALL PROVIDE FULLY REVERSIBLE INTERLOCKS ALONG TOP AND BOTTOM EDGES TO ASSURE MINIMUM PRODUCT WASTE ON SITE. EPS FOAM PANELS SHALL BE MOLDED WITH 1-INCH WIDE BY ½-INCH HIGH/DEEP ALTERNATING MALE/FEMALE REVERSIBLE PROJECTION/SOCKET INTERLOCKS POSITIONED IN PAIRS ALONG BOTH TOP AND BOTTOM EDGES OF ALL PANELS.
- 4] WALL SYSTEM SHALL BE CAPABLE OF PROVIDING HORIZONTAL AND VERTICAL LOCK POSITIONING OF STEEL WITHIN FORM CAVITY TO CONFORM TO ALL REINFORCING REQUIREMENTS OF ACI 318.
- 5] SELECTED SYSTEM IN CONJUNCTION WITH CONCRETE AND DESIGNATED EXTERIOR AND INTERIOR FINISHES SHALL PROVIDE MINIMUM INSULATION LEVEL OF R 23.59 (HR.FT<sup>2</sup>.F/BTU) OR (RSI 4.158 (M<sup>2</sup>.K/W) -U FACTOR 0.2405 W/M2.K) ACROSS FULL LINE OF FORM UNIT CAVITY WIDTHS.
- 6] EPS FOAM PANELS FORMING PART OF WALL SYSTEM SHALL PROVIDE MAXIMUM VAPOR PERMEATION RATE OF 0.78 PERM-INCH BASED ON 2<sup>1/2</sup> INCHES SINGLES THICKNESS OF FOAM ON INTERIOR SURFACE OF CONCRETE CORE.

6. WOOD

- A. ALL WOOD FABRICATION AND CONSTRUCTION SHALL COMPLY WITH THE FLORIDA BUILDING CODE CITED ABOVE AND THE AMERICAN INSTITUTE OF TIMBER CONSTRUCTION. COMPLY WITH ALL REQUIREMENTS FOR ALL WOOD FRAMING INCLUDING, BUT NOT NECESSARILY LIMITED TO CONNECTIONS, BRACING, BRIDGING, AND NAILING.



REVISIONS		Description
Date	Symbol	

Jimison Architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

PROJECT NOTES 2

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020	ME
DRAWN: JJ	
CHECKED:	
PROJECT NO:	
CAD FILE:	
SCALE: AS INDICATED	
These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit. Copyright © 2020	

DRAWING NUMBER

X-2

Sheet 3 of 27

B. ALL FRAMING LUMBER 2x4 AND LARGER SHALL BE GRADE STAMPED SOUTHERN YELLOW PINE #2KD OR BETTER. SIZES INDICATED ARE NOMINAL MILL SIZE UNLESS NOTED OTHERWISE. PRE-DRILL BORE BOLTS, LAG SCREWS, OR NAILS AS REQUIRED TO AVOID SPLITTING.

MINIMUM ALLOWABLE STRESSES:

Fb.....	1250 PSI
Fc.....	850 PSI
E.....	1,600,000 PSI
Fv.....	90 PSI
Ft.....	700 PSI

C. ALL WOOD EXPOSED TO WEATHER, ALL SILL PLATES, ALL WOOD IN CONTACT WITH DISSIMILAR MATERIALS SHALL BE PRESSURE TREATED AND STAMPED ACCORDINGLY. ALL PERSONS SHALL EXERCISE CAUTION WHEN HANDLING OR CUTTING TREATED WOOD. FOLLOW TREATMENT APPLICATOR'S PRINTED INSTRUCTIONS.

D. LAMINATED VENEER LUMBER SHALL BE OF THE SIZES INDICATED ON THE DRAWINGS OR AS REQUIRED FOR CONSTRUCTION. INSTALL PER MANUFACTURER'S PRINTED INSTRUCTIONS INCLUDING NAILING.

MINIMUM ALLOWABLE STRESSES:

Fb.....	2800 PSI
E.....	2,000,000 PSI
Fv.....	285 PSI

E. WOOD FRAMING CONNECTIONS ARE TO BE MADE WITH METAL CONNECTORS, JOIST HANGERS, ETC., UNLESS NOTED OTHERWISE ON THE DRAWINGS. CONNECTORS (FASTENERS, ANCHORS, HANGERS, ETC.) WHETHER OR NOT SHOWN ON THE DRAWINGS SHALL BE PRODUCTS OF SIMPSON, TECO, OR AN APPROVED OTHER MANUFACTURER.

F. PLYWOOD SHALL BE APA-RATED SHEATHING FOR THE PARTICULAR APPLICATION (BUT IN NO CASE LESS THAN FOUR-PLY) OF SIZES AND GRADE VENEER TYPE INDICATED ON THE DRAWINGS OR IF NOT INDICATED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE. ALL PLYWOOD SHALL BEAR THE AMERICAN PLYWOOD ASSOCIATION TRADEMARK AND GRADING STAMP, AND SHALL BE INSTALLED

ACCORDING TO APPLICABLE APA STANDARDS, INCLUDING NAILING SCHEDULES.

G. ROOF SHEATHING:

1] ROOF SHEATHING SHALL BE 5/8" THICK, EXPOSURE 1 , SHEATHING GRADE PLYWOOD (WOOD STRUCTURAL PANELS) OR ORIENTED STRAND BOARD WITH A FACTORY APPLIED RADIANT BARRIER. THE SHEATHING SHALL BE INSTALLED WITH LONG DIMENSION PERPENDICULAR TO FRAMING AND END JOINTS SHALL STAGGERED 1/2 THE LENGTH OF THE ADJACENT PANEL.

2] ROOF SHEATHING SHALL BE FASTENED TO ROOF FRAMING WITH HOT-DIPPED GALVANIZED SCREWS AS SHOWN IN THE FASTENING SCHEDULE OF THE CITED CODE.

I. THE STRUCTURAL DESIGN IS BASED ON THE FULL INTERACTION OF ALL COMPONENTS, WITH NO PROVISION MADE FOR CONDITIONS OCCURRING DURING CONSTRUCTION. THEREFORE, THE CONTRACTOR/ERECTOR SHALL PROVIDE BRACING DURING CONSTRUCTION AND UNTIL ALL COMPONENTS ARE IN PLACE.

J. 2-2x AND 2-2X BUILT-UP BEAMS AND BOX HEADERS SHALL BE SPLICED TOGETHER WITH 12D NAILS AT 12" O.C. TOP AND BOTTOM OF BEAM. 3-2x BEAMS AND WIDER SHALL BE BOLTED TOGETHER WITH 5/8" DIAMETER BOLTS AT 2'-8" O.C., MAX. AT TOP AND BOTTOM OF BEAM.

K. UNLESS INDICATED OTHERWISE WOOD FRAMED LOAD BEARING WALLS, NEW OR EXISTING, SHALL CONSIST OF MINIMUM 2x4 @ 16" O.C. PROVIDE HORIZONTAL SOLID BLOCKING, SAME SIZE AS WALL FRAMING, AT 1/3 HEIGHT, NOT TO EXCEED 4 FEET ON CENTER EQUALLY SPACED BETWEEN THE BASE PLATE AND TOP PLATE.

7. PRE-ENGINEERED PRE-FABRICATED WOOD TRUSSES

A. DESIGN IS BASED ON TRUSSES SPACED AT 2'-0" O.C., MAX.;TYPICAL UNLESS NOTED OTHERWISE. SMALLER SPACING MAY BE USED, IF REQUIRED BY TRUSS DESIGNER/MANUFACTURER. SEE PLANS FOR TRUSS LOCATIONS.

B. TRUSS DESIGN LOADS INCLUDING GIRDER TRUSSES: SEE PARAGRAPHS 2 & 3 FOR LIVE AND DEAD LOADS.

C. WIND UPLIFT: TO BE DETERMINED BY TRUSS DESIGNER

D. MAXIMUM LIVE LOAD DEFLECTION SHALL BE SPAN/240.



REVISIONS	
Date	Description

Jimison Architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

PROJECT NOTES 3

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO:	
CAD FILE:	
SCALE:	AS INDICATED

These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER

X-3

Sheet 4 of 27

- E. ROOF TRUSSES SHALL BE DESIGNED FOR APPLICABLE WIND LOADS AT THE BUILDING LOCATION IN COMBINATION WITH DEAD LOADS SHOWN ABOVE. APPLICABLE CODE PRESSURE AND SUCTION FACTORS SHALL BE USED IN ARRIVING AT LOADS FOR THIS LOAD CASE.
- F. TRUSSES TO BE DESIGNED AND FABRICATED BY TRUSS MANUFACTURER. DESIGN SHALL BE PERFORMED BY A PROFESSIONAL ENGINEER DULY REGISTERED IN THE STATE OF FLORIDA.
- G. DIAGRAMS ARE SHOWN ON THE DRAWINGS. THE TRUSS MANUFACTURER MUST USE THESE OVERALL CONFIGURATION FOR DESIGN. CONFIGURATION AND SIZE OF TRUSS WEB MEMBERS SHALL BE DETERMINED BY TRUSS MANUFACTURER. ARCHITECTURAL DESIGN IS BASED ON 2X4 TOP CHORD.
- H. PROVIDE PERMANENT TRUSS BRIDGING AND TEMPORARY TRUSS BRACING IN ACCORDANCE WITH THE TRUSS MANUFACTURER'S INSTRUCTIONS AND CITED CODES. SPECIAL CONSIDERATION SHALL BE GIVEN TO BRACING ALONG THE BEARING WALL FOR RAISED HEEL AND SCISSORS TRUSSES. PROVIDE THE BLOCKING RECOMMENDED BY TRUSS MANUFACTUROR, BUT NO MORE THAN THE MAXIMUM OF 8 FEET ON CENTER. BLOCKING (BRIDGING) FOR RAFTER SHALL NOT EXCEED 6 FEET ON CENTER. THE REQUIRED BRACING SHALL BE DESIGNED AND SUPPLIED BY THE TRUSS MANUFACTURER.
- I. TRUSS TO TRUSS CONNECTIONS SHALL BE DESIGNED BY THE TRUSS DESIGNER/MANUFACTURER.
- J. NO REPETITIVE MEMBER OR LOAD DURATION ALLOWABLE STRESS INCREASE SHALL BE ALLOWED FOR TRUSS OR TRUSS PLATE.
- K. ROOF TRUSSES SHALL BE CONNECTED TO THE TOP PLATE WITH A SUITABLE CONNECTOR/ANCHOR DESIGNED TO RESIST THE UPLIFT REQUIREMENTS DETERMINED BY THE TRUSS MANUFACTURER.
- L. WHERE THE ROOF TRUSS CONNECTS TO ANOTHER TRUSS OR TO A BEAM, IT SHAL BE CONNECTED WITH A METAL CONNECTOR DESIGNED TO RESIST THE GRAVITY AND WIND LOADS.
- M. TRUSS DESIGN AND SHOP DRAWINGS FOR TRUSSES ARE TO BE SUBMITTED FOR REVIEW PRIOR TO FABRICATION. REVIEW IS FOR CONFIRMATION OF GENERAL CONFORMANCE WITH THE CONTRACT DOCUMENTS. THE RESPONSIBILITY FOR DESIGN, FABRICATION, DIMENSIONS, BRACING, BRIDGING, QUANTITIES, ERECTION, COORDINATION AND COMPLIANCE WITH THE CONTRACT DOCUMENTS REMAIN WITH THE TRUSS DESIGNER, TRUSS MANUFACTURE AND THE

ERECTOR.

8. INSULATION

A. ROOF/ATTIC:

INSTALL EITHER INSULATION HAVING A MINIMUM R VALUE OF 38.

9. INTERIOR FINISHES

A. WALLS:

- 1] BATHROOMS, LAUNDRY AND KITCHEN: ½" GYPSUM "GREEN BOARD"
- 2] ALL OTHER WALLS: ½" GYPSUM BOARD

B. CEILINGS: ½" CEILING RATED GYPSUM BOARD

10. OTHER MATERIALS AND ITEMS

ALL OTHER MATERIALS, NOT SPECIFICALLY DESCRIBED BUT REQUIRED FOR A COMPLETE AND PROPER INSTALLATION OF THE WORK, SHALL BE CODE APPROVED, AS SELECTED BY THE CONTRACTOR SUBJECT TO THE APPROVAL OF THE OWNER'S REPRESENTATIVE.

11. OTHER INFORMATION

A. FLOOR AREA:

- 1] GROSS TO EXTERIOR FACE OF WALL:..... 912 SF
- 2] GROSS TO INSIDE FACE OF WALL :..... 818.79 SF



REVISIONS	Description
Date	Symbol

Jimison Architect

1969 Grooverille Road  
Duluth, Georgia 31629  
Telephone: 289-2651-4148  
email: jamison.jim@windstream.net

PROJECT NOTES 4

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO:  
C&D FILE:  
SCALE: AS INDICATED


These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER


X-4

Sheet 5 of 27

SITE DATA	
Risk Category	II
Address	122 SW Albany Terrace, Fort White, FL 32038
Basic Wind Speed	120 MPH
Site Elevation	61.54 Ft
Exposure Category	C
Wind Source Direction	South
Type of Terrain	Flat
Structure	Building
Roof Profile	Hip
Building Length, L	38 Feet
Building Width, W	24 Feet
Mean Roof Height, h	14'-0"
Roof Pitch Angle	18.43 °
WIND LOAD	
Type of Building	ASCE 7-16 - Buildings - Main Wind Force Resisting System
Enclosure Classification	Enclosed

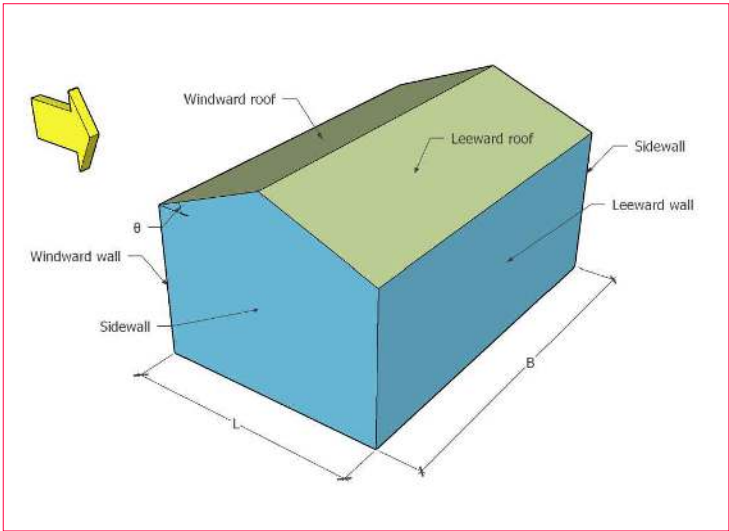

Wind Along L

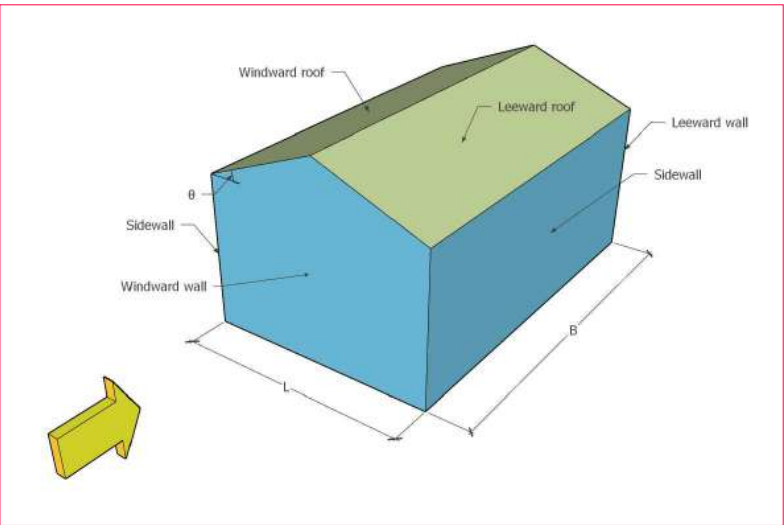

Wind Along B

WIND PRESSURE ALONG L				
			Design Pressure psf	
Surface	Level	Elevation ft	$p_{min} = qG(+C_p) - q_i(+GC\ p_i)$	$p_{max} = qG(-C_p) - q_i(-GC\ p_i)$
Windward Wall	1	15	13.290	22.850
Leeward Wall	ALL		-13.44	-3.88
Side Wall	ALL		-20.600	-11.030
Roof	Windward	Worst Case	-14.380	5.810
	Leeward	Worst Case	-17.150	-7.580
WIND PRESSURE ALONG B				
			Design Pressure psf	
Windward Wall	1	15	13.290	22.850
Leeward Wall	ALL		-16.08	-6.51
Side Wall	ALL		-20.600	-11.030
Roof	Worst Case	0 to h/2	-25.980	-16.410
		h/2 to h	-24.360	-14.790
		h to 2h	-16.830	-7.260
		> 2h	-13.070	-3.500
Minimum design wind pressure for walls = 16 psf				
Minimum design wind pressure for roof = 8 psf				



REVISIONS		Description
Date	Symbol	

Jimison architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

WIND LOADS


C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO:  
CAD FILE:  
SCALE: AS INDICATED

These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020


DRAWING NUMBER  
**X-5**  
Sheet 6 of 27



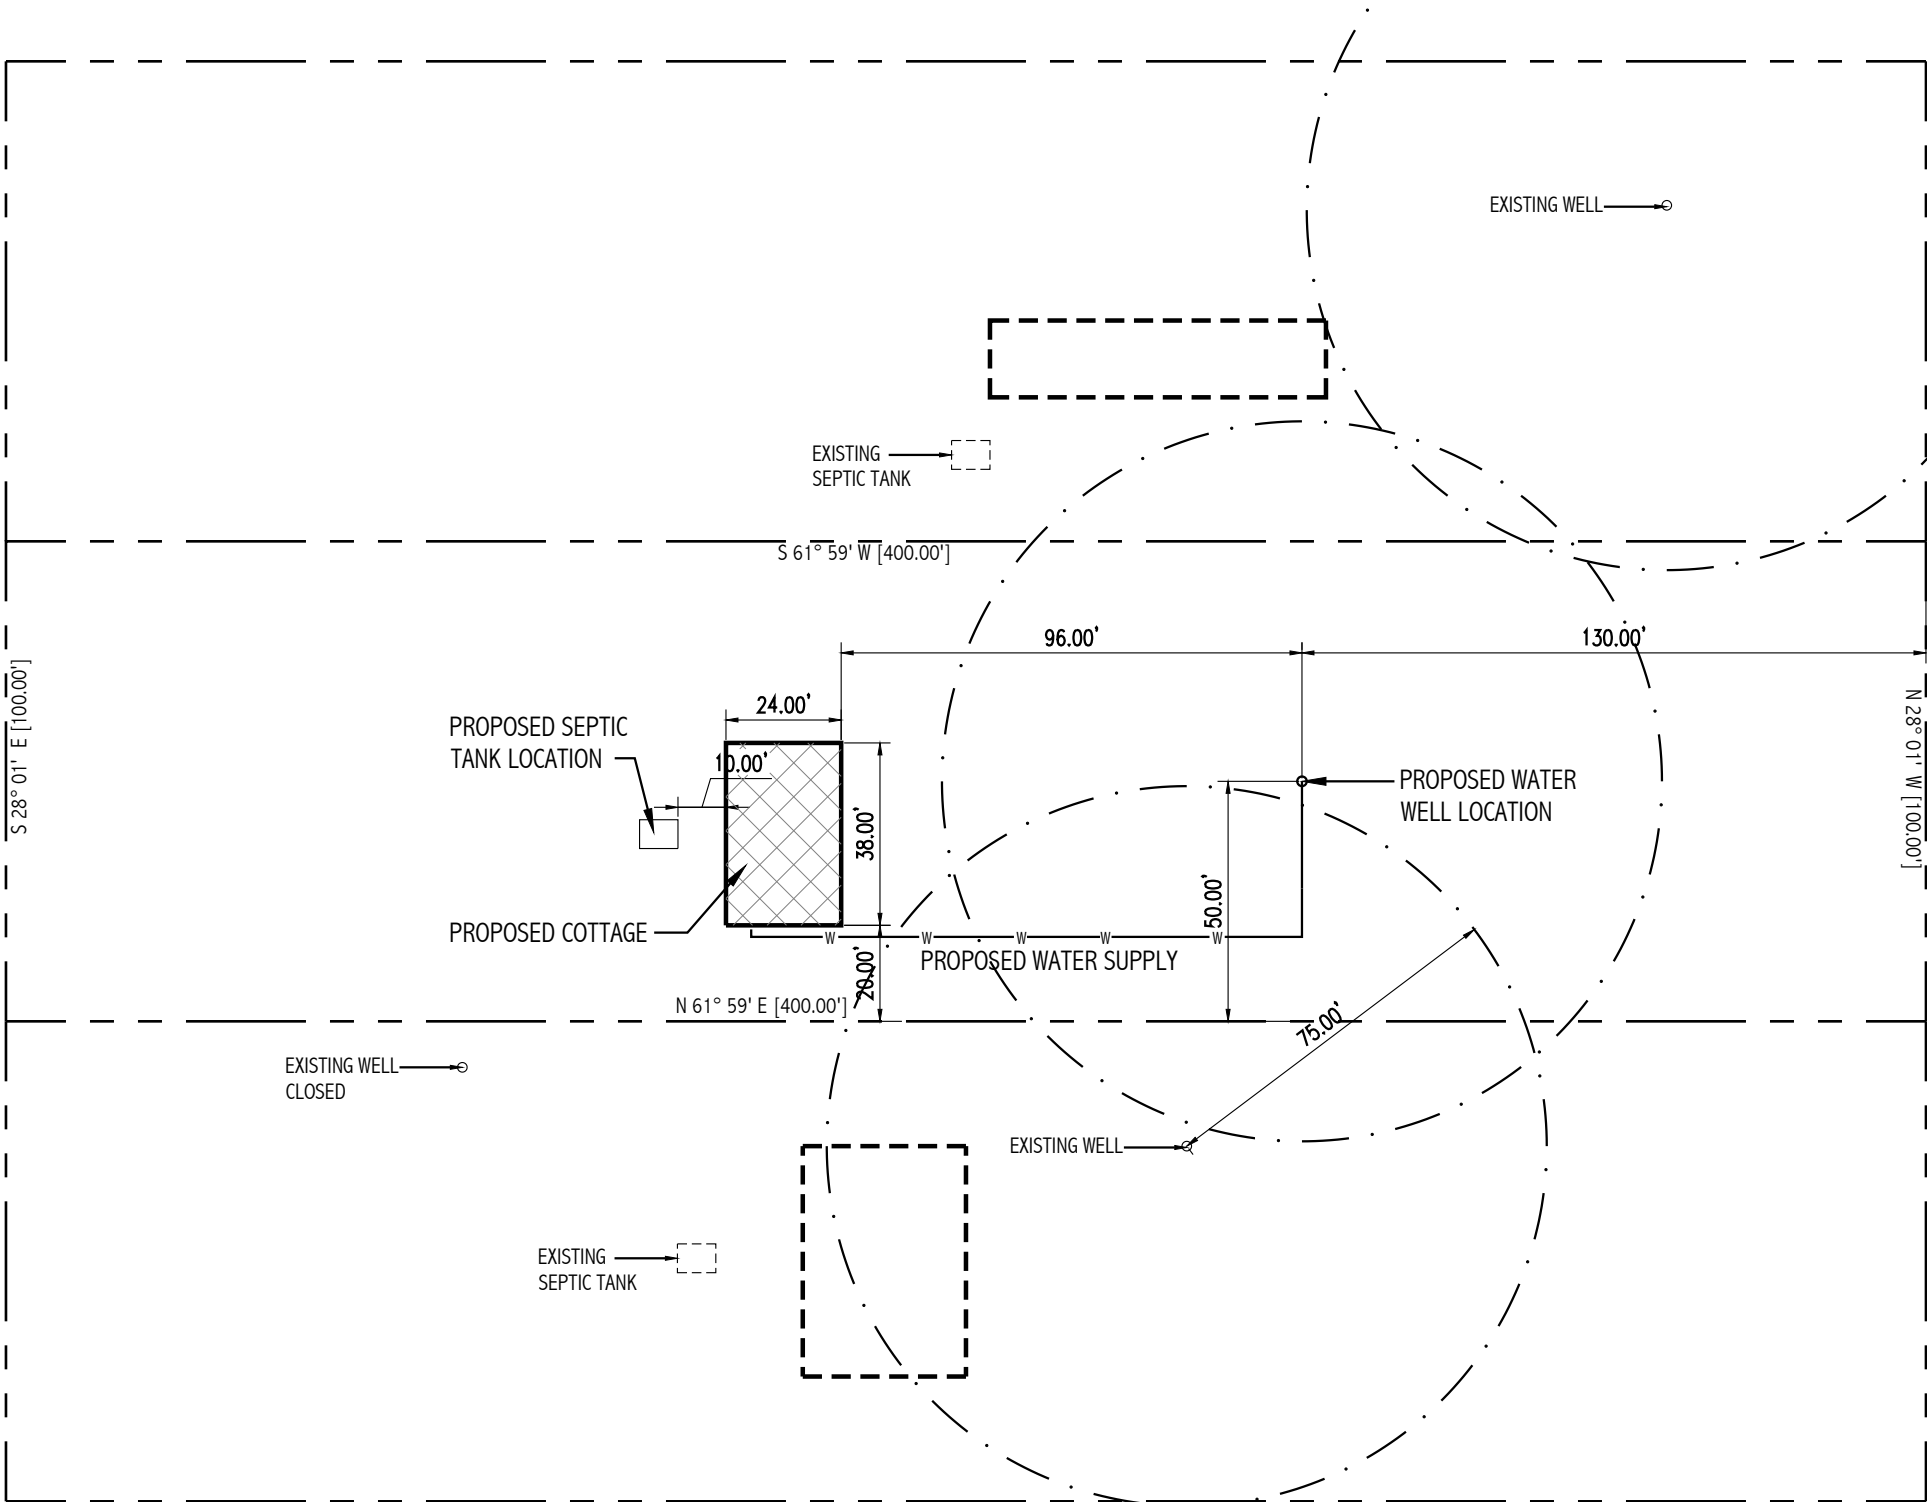

NOTES

- BOUNDARY, DISTANCES, BEARINGS SHOWN HEREON WERE TAKEN FROM A SURVEY BY BRITT MAPPING & SURVEYING, LLC, DATED 26 AUGUST 2020.
- DESCRIPTION: LOT 118, SECTION 15, MORE PARTICULARLY KNOWN AS LOT 70, UNIT 21 OF "THREE RIVERS ESTATES, INC.", BEING A PART OF THE SE ¼ SECTION 25, AND PART OF SECTION 36, TOWNSHIP 6 SOUTH RANGE 15 EAST, COLUMBIA COUNTY, FLORIDA
- VERIFY LOCATION AND MARK ALL UNDERGROUND UTILITIES PRIOR TO BEGINNING ANY CLEARING OR CONSTRUCTION OPERATIONS.
- ALL EROSION AND SEDIMENTATION CONTROLS SHALL BE INSTALLED PRIOR TO OR CONCURRENT WITH ANY CONSTRUCTION ACTIVITIES ON SITE
- MAINTAIN EROSION AND SEDIMENTATION CONTROL MEASURES UNTIL PAVEMENT IS COMPLETE AND PERMANENT VEGETATION HAS BEEN REESTABLISHED ON DISTURBED AREAS.
- ALL DIMENSIONS AND ANGLES REFERENCED FOR CONSTRUCTION LAYOUT ARE BASED ON THE BEARINGS AND DISTANCES SHOWN ON THE ABOVE REFERENCED DRAWINGS. VERIFY EXISTING RIGHTS-OF-WAY, EASEMENTS, AND PROPERTY CORNERS PRIOR TO CONSTRUCTION LAYOUT.
- ALL DIMENSIONS SHOWN FOR LOCATION OF THE BUILDING ARE TO THE FOUNDATION WALL OR FACE OF WALL.
- VERIFY ALL EXISTING CONDITIONS BEFORE BEGINNING CONSTRUCTION.



REVISIONS		Description
Date	Symbol	

**Jimison architect**  
1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

**SITE LAYOUT**  
SAUNDER'S COTTAGE  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO.:	
CAD FILE:	
SCALE:	AS INDICATED

These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER  
**C-1**  
Sheet 7 of 27

0 40 80  
GRAPHIC SCALE FEET






DOOR SCHEDULE					
DOOR NUMBER	LOCATION	SIZE			FLORIDA APPROVAL NUMBER
		WIDTH	HEIGHT	THICK.	
1	GREAT ROOM	3'-0"	6'-8"	1-5/8"	FL 15210-R6
2	M. BEDROOM	2'-6"	6'-8"	1-5/8"	FL 15210-R6
3	WIC	2'-0"	6'-8"	1-5/8"	FL 15210-R6
4	M. BATH	2'-0"	6'-8"	1-5/8"	FL 15210-R6
5	BEDROOM	2'-6"	6'-8"	1-5/8"	FL 15210-R6
6	CLOSET	PR 2'-0"	6'-8"	1-5/8"	FL 15210-R6
7	BATH	2'-4"	6'-8"	1-5/8"	FL 15210-R6
8	AIR HANDLER	2'-6"	6'-8"	1-5/8"	FL 15210-R6
9	LINEN	1'-6"	6'-8"	1-5/8"	FL 15210-R6
10	PANTRY	PR 1'-6"	6'-8"	1-5/8"	FL 15210-R6
11	KITCHEN/LAUNDRY	3'-0"	6'-8"	1-5/8"	FL 15210-R6

WINDOW SCHEDULE								
MARK	SIZE		*ROUGH OPENING		**MASONRY OPENING		MANUFACTURER	FLORIDA APPROVAL NUMBER
	WIDTH	HEIGHT	WIDTH	HEIGHT	WIDTH	HEIGHT		
W1	2'-11 1/2"	4'-11 1/2"	3'-0"	5'-0"	3'-3"	5'-3"	YKK	FL 8114-R5
W2	2'-3 1/2"	3'-1 1/2"	2'-4"	3'-2"	2'-7"	3'-5"	YKK	FL 8114-R5

\* BETWEEN WOOD BUCKS  
\*\*INCLUDES WOOD BUCKS



REVISIONS		Description	
Date	Symbol		

Jimison architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

DOOR & WINDOW SCHEDULES

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL


DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO:	
CAD FILE:	
SCALE:	AS INDICATED
These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit. Copyright © 2020	

DRAWING NUMBER

A-2

Sheet 9 of 27

R:\Clients\Plastpro, Inc PERMANENT\A - Florida Product Approvals\FL-15213 Fiberglass Door - Inswing-Outswing\C - Drawings\FL 15213 (2017)\FL-15213.1-8.dwg, FL-15213.1



plastpro

5200 W. CENTURY BLVD.  
LOS ANGELES, CA 90045


Smooth / Wood Grain / White Wood Grain  
Rustic / Mahogany  
Series Fiberglass Door  
INSWING / OUTSWING  
"IMPACT"

GENERAL NOTES

1. This product has been evaluated and is in compliance with the 6th Edition (2017) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.


TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	Typical elevation, design pressures, & general notes
2	Door panel details
3	Horizontal cross sections
4	Vertical cross sections
5	Buck and frame anchoring - 2X buck masonry construction
6	Frame anchoring - 1X buck masonry construction
7	Bill of materials & components

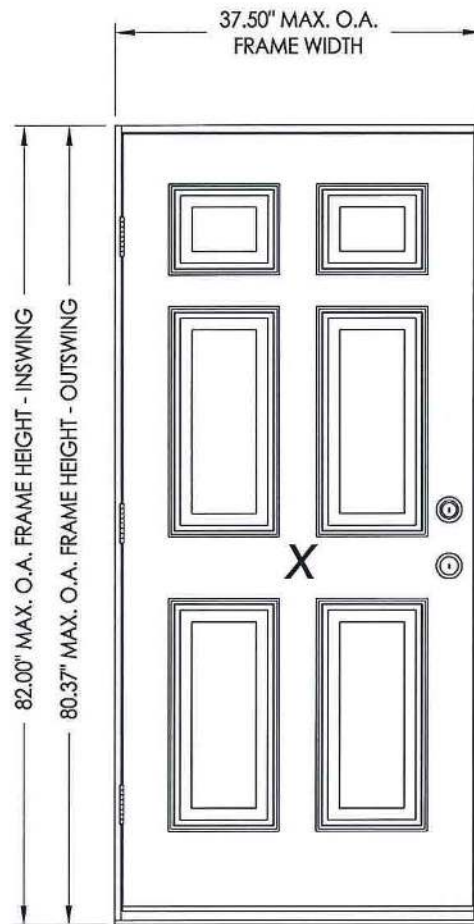

FLORIDA PRODUCT APPROVAL NUMBER FL 15210-R6

SWING	OVERALL FRAME DIMENSION	DESIGN PRESSURE (PSF)	
		POSITIVE	NEGATIVE
INSWING	37.50" x 82.00"	+65.0	-70.0
OUTSWING	37.50" x 80.37"	+65.0	-65.0

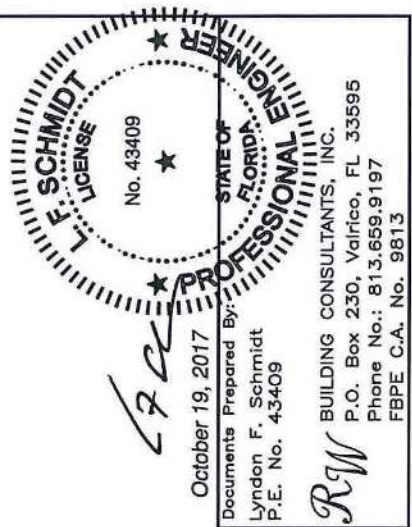

PRODUCT:  
PLASTPRO INC.  
FIBERGLASS DOOR  
PART OR ASSEMBLY:  
TYPICAL ELEVATION, DESIGN  
PRESSURES & GENERAL NOTES

NO.	DATE	REVISIONS	
		BY	DATE
2	10/19/17	LFS	UPDATE TO 6TH ED. (2017) FBC
1	04/22/15	JK	UPDATE TO 5TH ED. (2014) FBC

DATE: 02/16/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15213.1  
SHEET 1 OF 7

© 2012 R.W. BUILDING CONSULTANTS INC.

REVISIONS	
Date	Description

Jimison architect  
1969 Grooverille Road  
Duluth, Georgia 31629  
Telephone: 299-2651-4148  
email: jimison.jim@windstream.net

DOOR DATA 1  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL






DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO.:  
C&D FILE:  
SCALE: AS INDICATED  
These drawings are the property of Jim Jamison, Architect, and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER  
A-3  
Sheet 10 of 27





R:\Clients\Plastpro, Inc PERMANENTVA - Florida Product Approvals\FL-15213 Fiberglass Door - Inswing-Outswing\C - Drawings\FL 15213 (2017)\FL-15213.1-8.dwg, 3.1

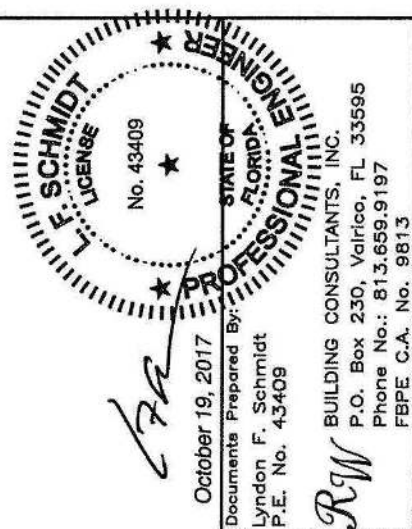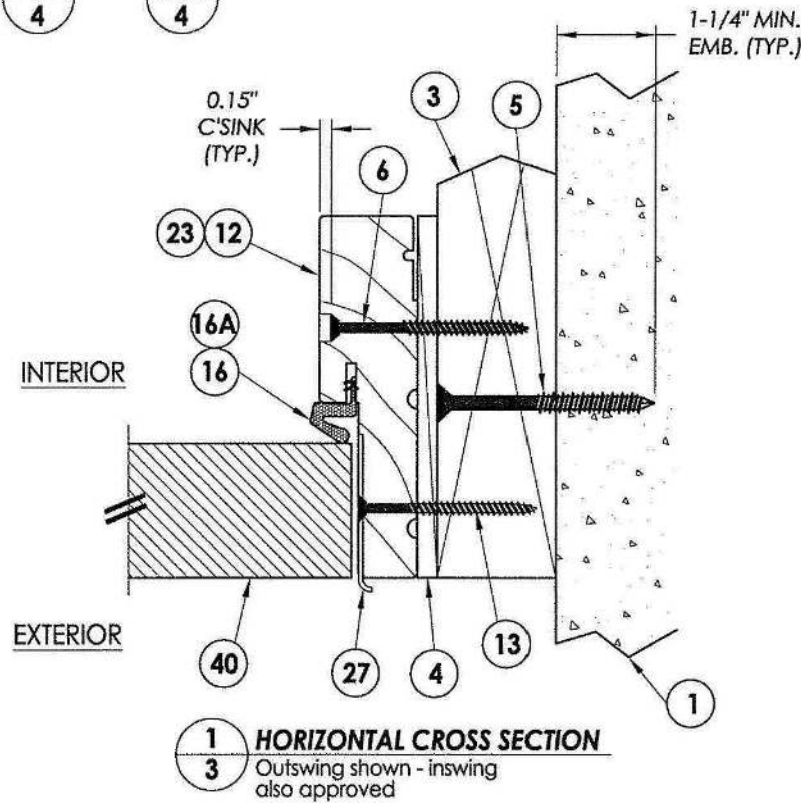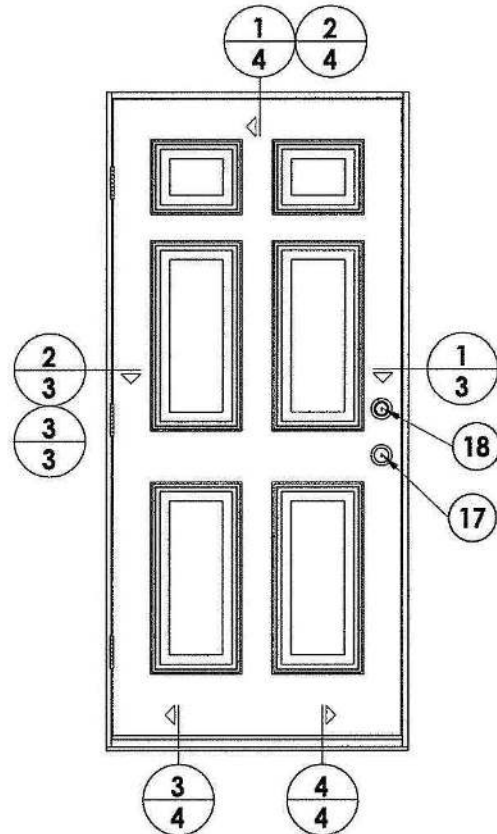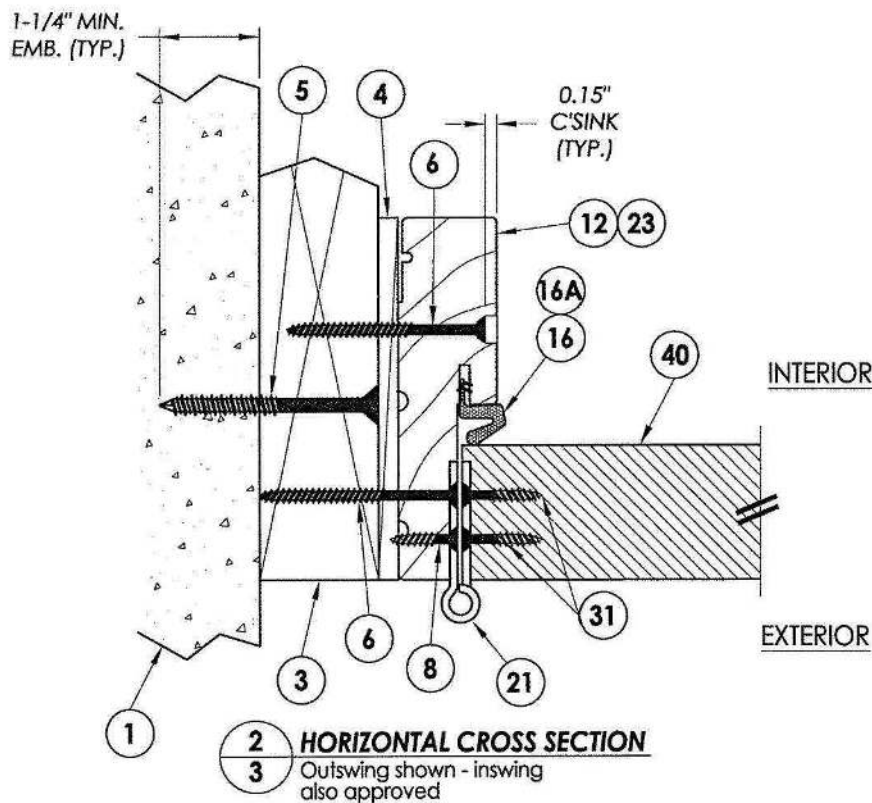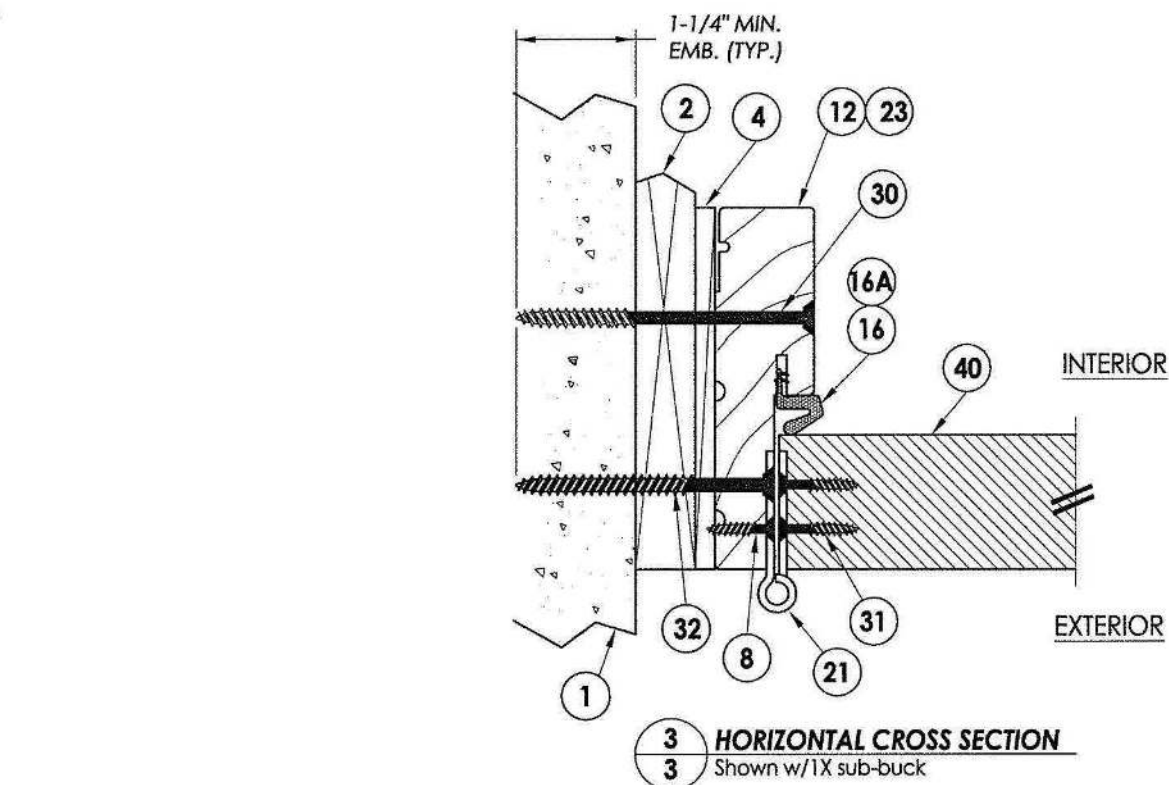

PRODUCT:  
PLASTPRO INC.  
FIBERGLASS DOOR  
PART OR ASSEMBLY:  
HORIZONTAL CROSS SECTIONS

NO.	DATE	BY
2	10/19/17	UPDATE TO 6TH ED. (2017) FBC
1	04/22/15	UPDATE TO 5TH ED. (2014) FBC

DATE: 02/16/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15213.1  
SHEET 3 OF 7

© 2012 R.W. BUILDING CONSULTANTS INC.

REVISIONS	Symbol	Description


**Jimison architect**  
1959 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jimison.jim@windstream.net

**DOOR DATA 3**  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL


DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO.:  
C&P FILE:  
SCALE: AS INDICATED  
These drawings are the property of Jim Jimison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER  
**A-5**  
Sheet 12 of 27


R:\Clients\Plastpro, Inc PERMANENTVA - Florida Product Approvals\FL-15213 Fiberglass Door - Inswing-Outswing\C - Drawings\FL 15213 (2017)\FL-15213.1-8.dwg, 4.1

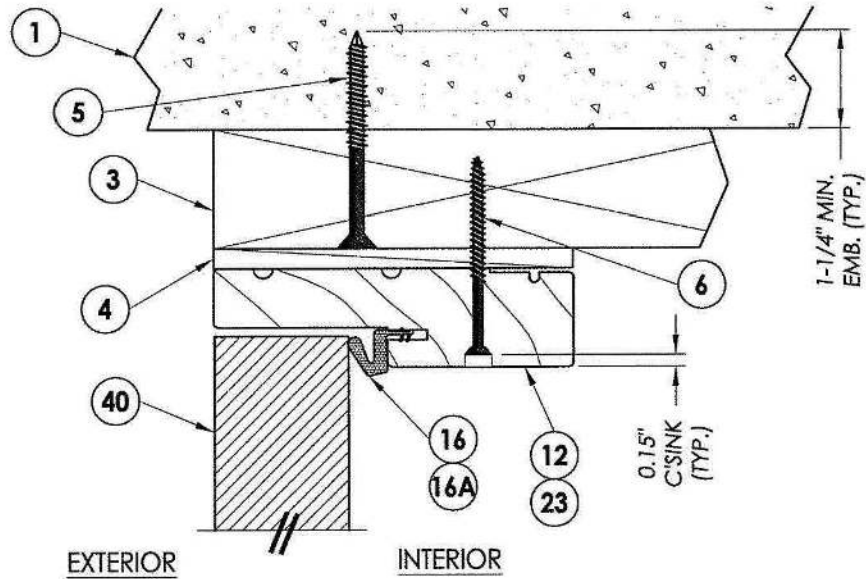


1 VERTICAL CROSS SECTION  
4 Outswing shown - inswing also approved

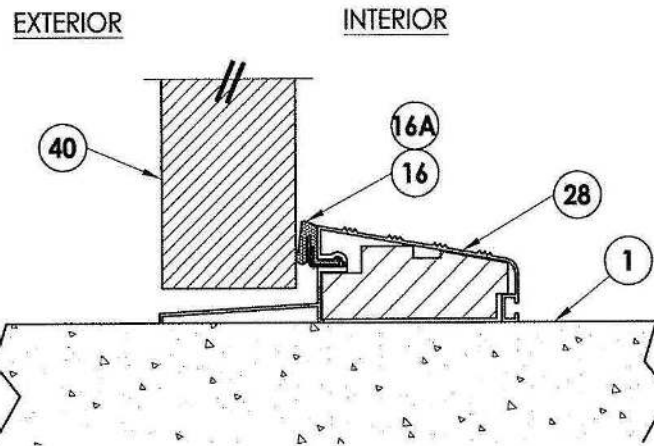


3 VERTICAL CROSS SECTION  
4 Outswing configuration

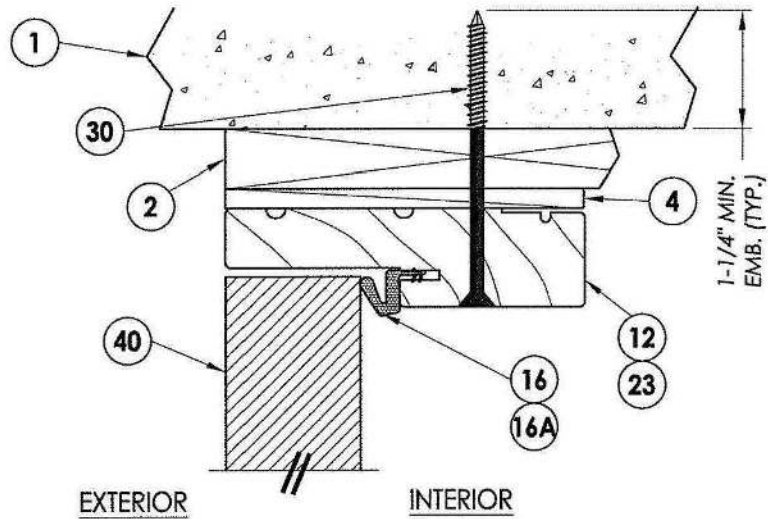

2 VERTICAL CROSS SECTION  
4 Shown w/1X sub-buck

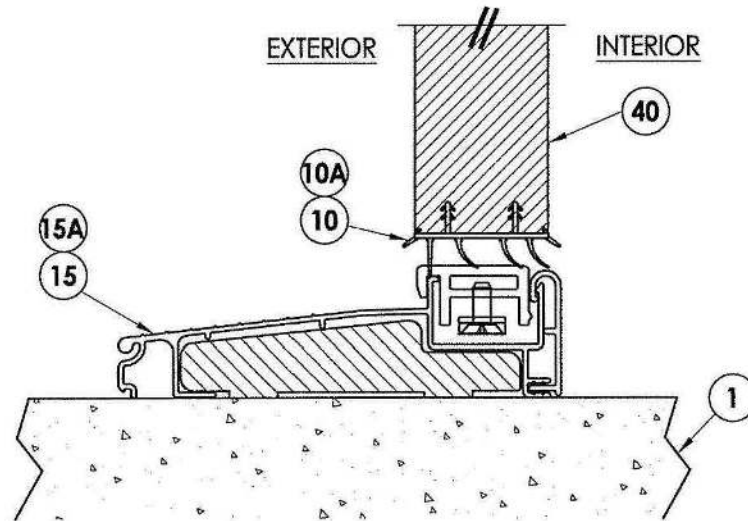

4 VERTICAL CROSS SECTION  
4 Inswing configuration

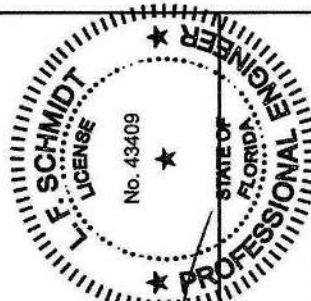

October 19, 2017  
Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409  
RW BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE C.A. No. 9813

PRODUCT:  
PLASTPRO INC.  
FIBERGLASS DOOR  
PART OR ASSEMBLY:  
VERTICAL CROSS SECTIONS

NO.	DATE	BY
2	10/19/17	LFS
1	04/22/15	JK

DATE: 02/16/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15213.1  
SHEET 4 OF 7

© 2012 R.W. BUILDING CONSULTANTS INC.

REVISIONS	Symbol	Description


Jimison architect  
1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

DOOR DATA 4  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO.:  
C&P FILE:  
SCALE: AS INDICATED  
These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER  
A-6  
Sheet 13 of 27

R:\Clients\Plastpro, Inc PERMANENT\A - Florida Product Approvals\FL-15213 Fiberglass Door - Inswing-Outswing\C - Drawings\FL-15213.1-8.dwg, 5.1

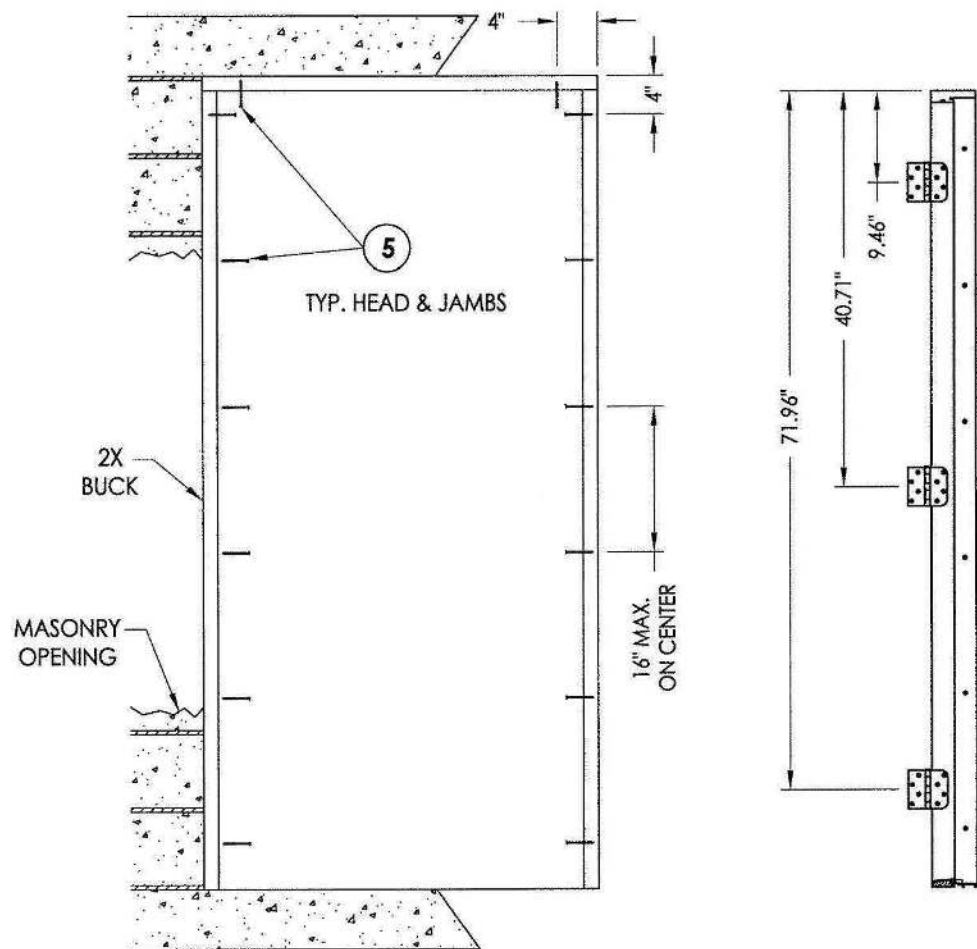

BUCK ANCHORING

HINGE JAMB


CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
ELCO ULTRA CON®	1/4"	1-1/4"	1"	4"


WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

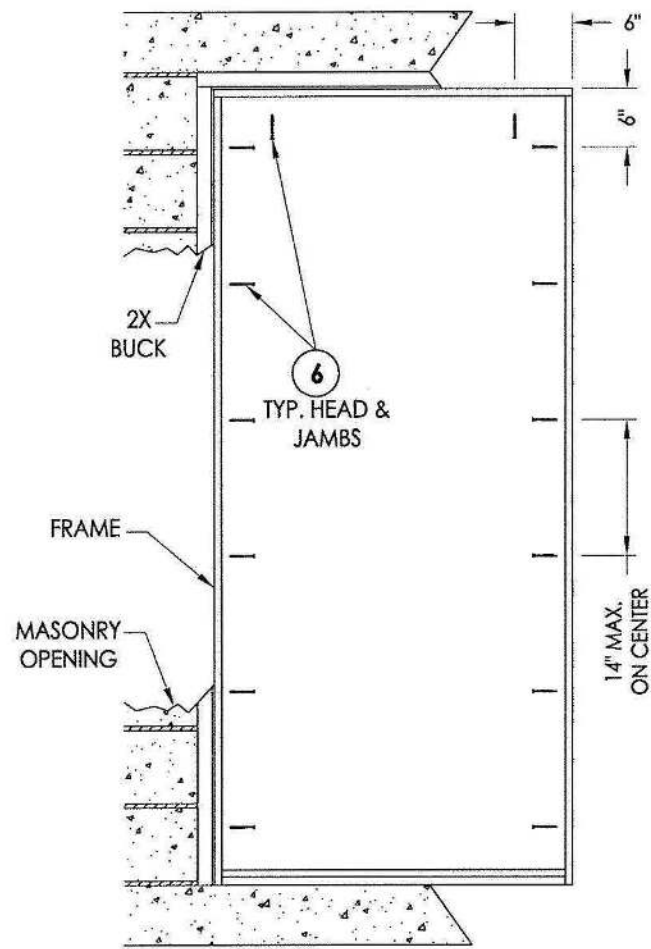


FRAME ANCHORING  
Masonry 2X buck construction


STRIKE JAMB

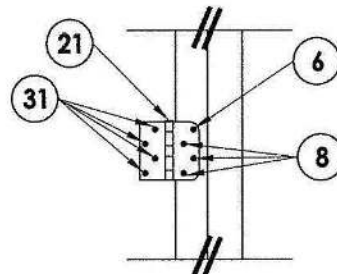

HINGE JAMB



STRIKE PLATE DETAIL

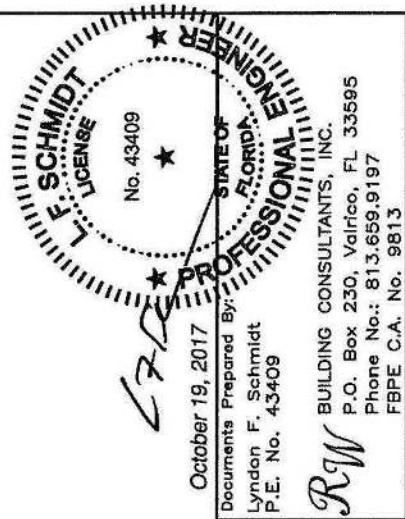

October 19, 2017  
Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE C.A. No. 9813

PRODUCT:  
PLASTPRO INC.  
FIBERGLASS DOOR  
PART OR ASSEMBLY:  
BUCK & FRAME ANCHORING  
2X BUCK MASONRY CONSTRUCTION

NO.	DATE	REVISIONS
2	10/19/17	UPDATE TO 6TH ED. (2017) FBC
1	04/22/15	UPDATE TO 5TH ED. (2014) FBC

DATE: 02/16/12  
SCALE: N.T.S.  
DWG. BY: JK  
CHK. BY: LFS  
DRAWING NO.: FL-15213.1  
SHEET 5 OF 7

© 2012 R.W. BUILDING CONSULTANTS INC.

DOOR DATA 5

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL


Jimison architect  
1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jimison.jim@windstream.net

REVISIONS	Symbol	Description

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO.:  
CADD FILE:  
SCALE: AS INDICATED  
These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020


DRAWING NUMBER  
A-7  
Sheet 14 of 27



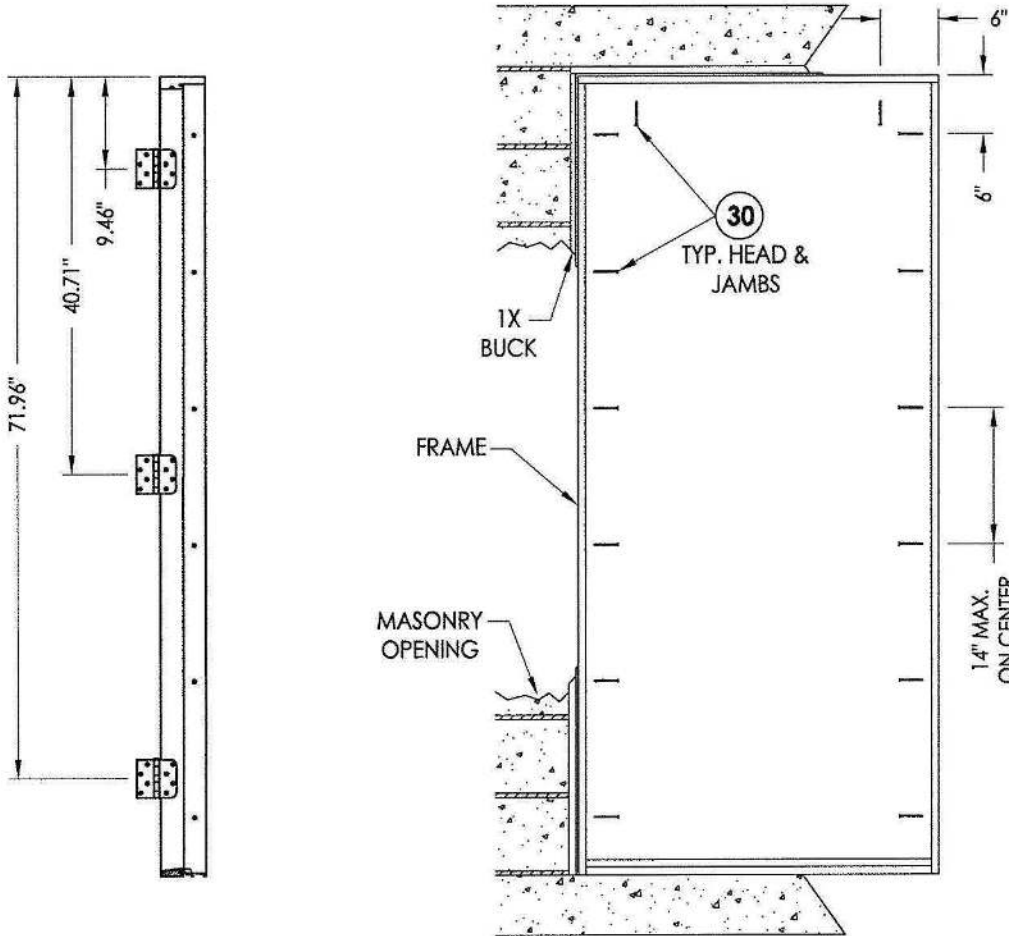


**HINGE JAMB**


**FRAME ANCHORING**  
Masonry 1X buck construction

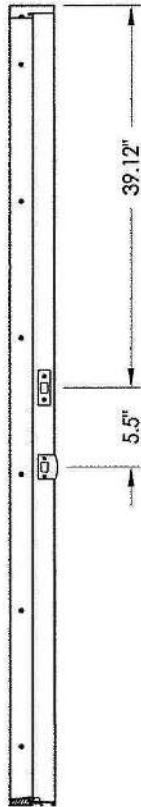

### STRIKE JAMB

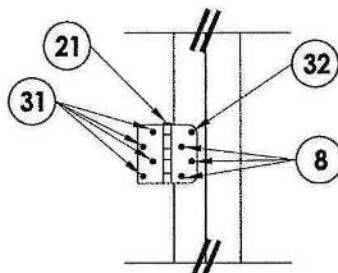

**HINGE JAMB**



### STRIKE PLATE DETAIL

CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
ELCO ULTRACON®	1/4"	1-1/4"	1"	4"
ITW TAPCON®	3/16"	1-1/4"	3"	1-1/2"


**WOOD SCREW INSTALLATION NOTES:**

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

PRODUCT:	PLASTPRO INC. FIBERGLASS DOOR
PART OR ASSEMBLY:	FRAME ANCHORING MAX BUCK MASONRY CONSTRUCTION

[illegible]

© 2012 R.W. BUILDING CONSULTANTS INC.

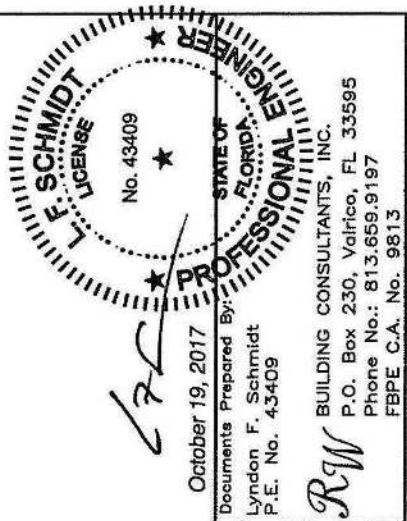[illegible]

**on architect**  
1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4348  
email: [jamiron.jim@windstream.net](mailto:jamiron.jim@windstream.net)

**DOOR DDATA 6**  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO:  
CAD FILE:  
SCALE: AS INDICATED


These drawings are the property of  
Jim Jamison, Architect and cannot be  
reused or reproduced without permission  
and credit.  
Copyright © 2020

DRAWING NUMBER


# A-8

R:\Clients\Plastpro, Inc PERMANENT\A - Florida Product Approvals\FL-15213 Fiberglass Door - Inswing-Outswing\C - Drawings\FL 15213 (2017)\FL-15213.1-8.dwg, 7.1


BILL OF MATERIALS		
ITEM	DESCRIPTION	MATERIAL
1	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
2	1X BUCK SG >= 0.55	WOOD
3	2X BUCK SG >= 0.55	WOOD
4	1/4" MAX. SHIM SPACE	-
5	1/4" X 2-3/4" PFH ELCO OR ITW CONCRETE SCREW	STEEL
6	#10 X 2-1/2" PFH WOOD SCREW (1.15" MIN. EMBEDMENT)	STEEL
8	#9 X 3/4" PFH WOOD SCREW	STEEL
9	DOOR SKIN (MIN. 0.075" THICK)	FIBERGLASS
10	INSWING VINYL DOOR BOTTOM SWEEP BY ENDURA	VINYL
10A	VINYL DOOR BOTTOM SWEEP #3628 BY HOLM IND.	VINYL
11	REINFORCEMENT WOOD FOR LOCK	WOOD
12	FINGER JOINTED PINE JAMB	WOOD
13	#9 X 2-1/4" PFH WOOD SCREW	STEEL
14	BOTTOM RAIL	CELLULAR PVC
15	INSWING ADJUSTABLE THRESHOLD BY ENDURA	ALUM. / WOOD
15A	INSWING ADJUSTABLE ALUMINUM THRESHOLD BY DLP	ALUM. / WOOD
16	FORCE 5 WEATHER STRIPPING BY ENDURA	FOAM
16A	COMPRESSION WEATHER STRIP QLON 650 BY SCHLEGEL	FOAM
17	KWIKSET KEYED ENTRY - SIGNATURE SERIES	STEEL
18	KWIKSET DEADBOLT - SIGNATURE SERIES (780)	STEEL
20	POLYURETHANE FOAM BY NANYA	POLYURETHANE
21	4" X 4" BUTT HINGE	STEEL
23	POLY FIBER JAMB	COMP. / VINYL
24	HINGE & LATCH STILE	CELLULAR PVC
25	TOP RAIL	CELLULAR PVC
26	DEADBOLT STRIKE PLATE	STEEL
27	LATCH STRIKE PLATE	STEEL
28	OUTSWING BUMP THRESHOLD	ALUM. / WOOD
29	HINGE & LATCH STILE REINFORCEMENT	LVL
30	1/4" X 3-3/4" PFH ITW CONCRETE SCREW	STEEL
31	#9 X 1" PFH WOOD SCREW	STEEL
32	1/4" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
33	3/16" X 3-1/4" PFH ITW CONCRETE SCREW	STEEL
40	DOOR PANEL - SEE DOOR PANEL DETAIL SHEET FOR CONSTRUCTION DETAILS	-

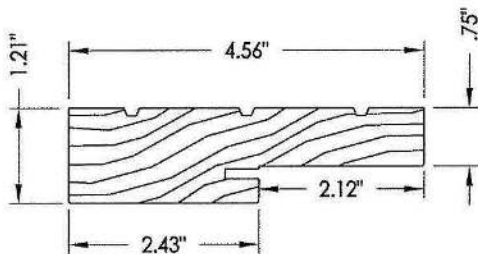


12 JAMB

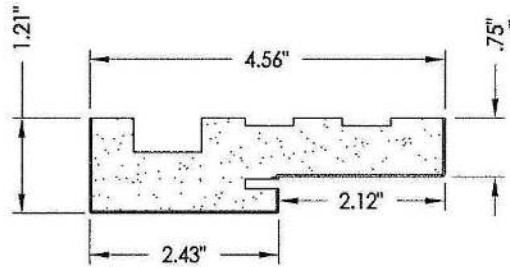


23 POLY FIBER JAMB

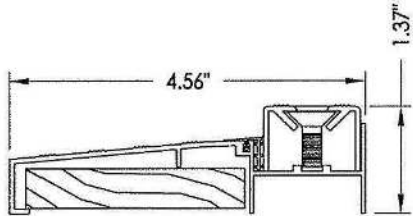


15A ADJUSTABLE INSWING SILL

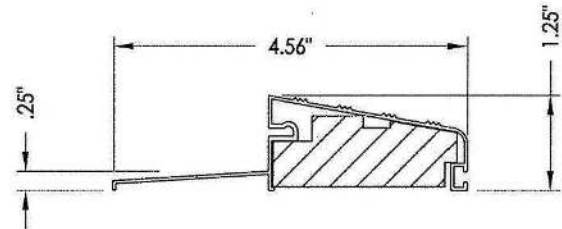

28 OUTSWING BUMP THRESHOLD

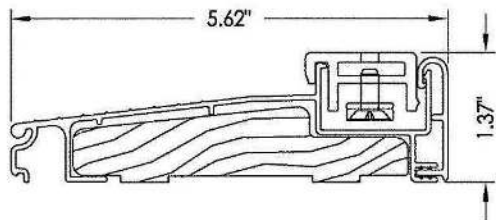

15 ADJUSTABLE INSWING SILL

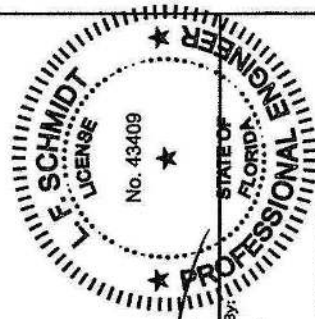

October 19, 2017  
Documents Prepared By:  
Lyndon F. Schmidt  
P.E. No. 43409  
RW BUILDING CONSULTANTS, INC.  
P.O. Box 230, Valrico, FL 33595  
Phone No.: 813.659.9197  
FBPE C.A. No. 9813

PRODUCT:		PLASTPRO INC. FIBERGLASS DOOR	
PART OR ASSEMBLY:		BILL OF MATERIALS & COMPONENTS	
DATE:		02/16/12	
SCALE:		N.T.S.	
DWG. BY:		JK	
CHK. BY:		LFS	
DRAWING NO.:		FL-15213.1	
SHEET		7 OF 7	

© 2012 R.W. BUILDING CONSULTANTS INC.

REVISIONS	
Date	Description

Jimison architect  
1969 Grooverville Road  
Duluth, Georgia 31629  
Telephone: 289-265-4148  
email: jimison.jim@windstream.net

DOOR DATA 7  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO.:  
C&D FILE:  
SCALE: AS INDICATED  
These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER  
A-9  
Sheet 16 of 27



s:\projects\ykk-ap-america, inc\cc-14-0738-residential-fbc-version-5-code-changes\revisions\fl8114-dwg-ykk123.dwg

6/16/2019 3:53 PM

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF ±1/2 INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- FOR INSTALLATION INTO WOOD FRAMING USE **#8 WOOD SCREWS** SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3/4 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION INTO METAL STUD USE **#8 PAN HEAD SCREWS** THROUGH THE FRAME OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 3 THREADS PENETRATION BEYOND METAL FRAME SUBSTRATE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
  - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
  - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM 18 GA. WALL THICKNESS.

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE CURRENT EDITION FLORIDA BUILDING CODE (FBC), EXCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
  - AAMA/WDMA/CSA 101/1.S.2/A440-05
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY, 2X FRAMING AND METAL STUD FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM **IS REQUIRED** ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- WINDOW FRAME MATERIAL: PVC
- DESIGNATIONS "X" AND "O" STAND FOR THE FOLLOWING:
  - X: OPERABLE PANEL
  - O: FIXED PANEL
- GLAZING MEETS ASTM E1300 REQUIREMENTS, SEE SHEET 3 FOR GLAZING DETAILS.

YKK AP RESIDENTIAL  
StyleView Single Hung Window

TABLE OF CONTENTS	
SHEET	SHEET DESCRIPTION
1	INSTALLATION & GENERAL NOTES
2	ELEVATION & ANCHOR SCHEDULE
3	VERTICAL SECTION & GLAZING DETAIL
4	HORIZONTAL SECTION

CONFIGURATION	DESIGN PRESSURE	MAXIMUM SIZE	MISSILE IMPACT RATING
O/X	+50 / -50 PSF	47.5" x 71.5"	NON-IMPACT



Quality  
inspires™

YKK AP AMERICA RESIDENTIAL  
7680 The Bluffs, Suite 100  
Austell, GA 30168  
PH: (678) 838-6000 x6060

TITLE: STYLE VIEW  
SINGLE HUNG  
INSTALLATION & GENERAL NOTES  
PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478 FX: (954) 744-4738

REVISIONS

NO.	DESCRIPTION	BY	DATE



DATE: 06.04.15  
DWN BY: BB  
CHK BY: HFN  
SCALE: NTS  
DWG #: YKK123  
SHEET: 1 OF 4

REVISIONS	
Date	Description

Jimison Architect  
1969 Grooverville Road  
Duluth, Georgia 31629  
Telephone: 229-263-4148  
email: jimison.jim@windstream.net

WINDOW DATA  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO.:  
C&P FILE:  
SCALE: AS INDICATED  
These drawings are the property of Jim Jamison, Architect, and cannot be reused or reproduced without permission and credit.  
Copyright © 2020


DRAWING NUMBER  
A-10  
Sheet 17 of 27

FLORIDA PRODUCT APPROVAL NUMBER FL 8114-R5



6/16/2019 3:53 PM

s:\projects\ykk ap america, inc\cc-14-0738 residential fbc version 5 code change\revisions\18114\dkgn\ykk123.dwg

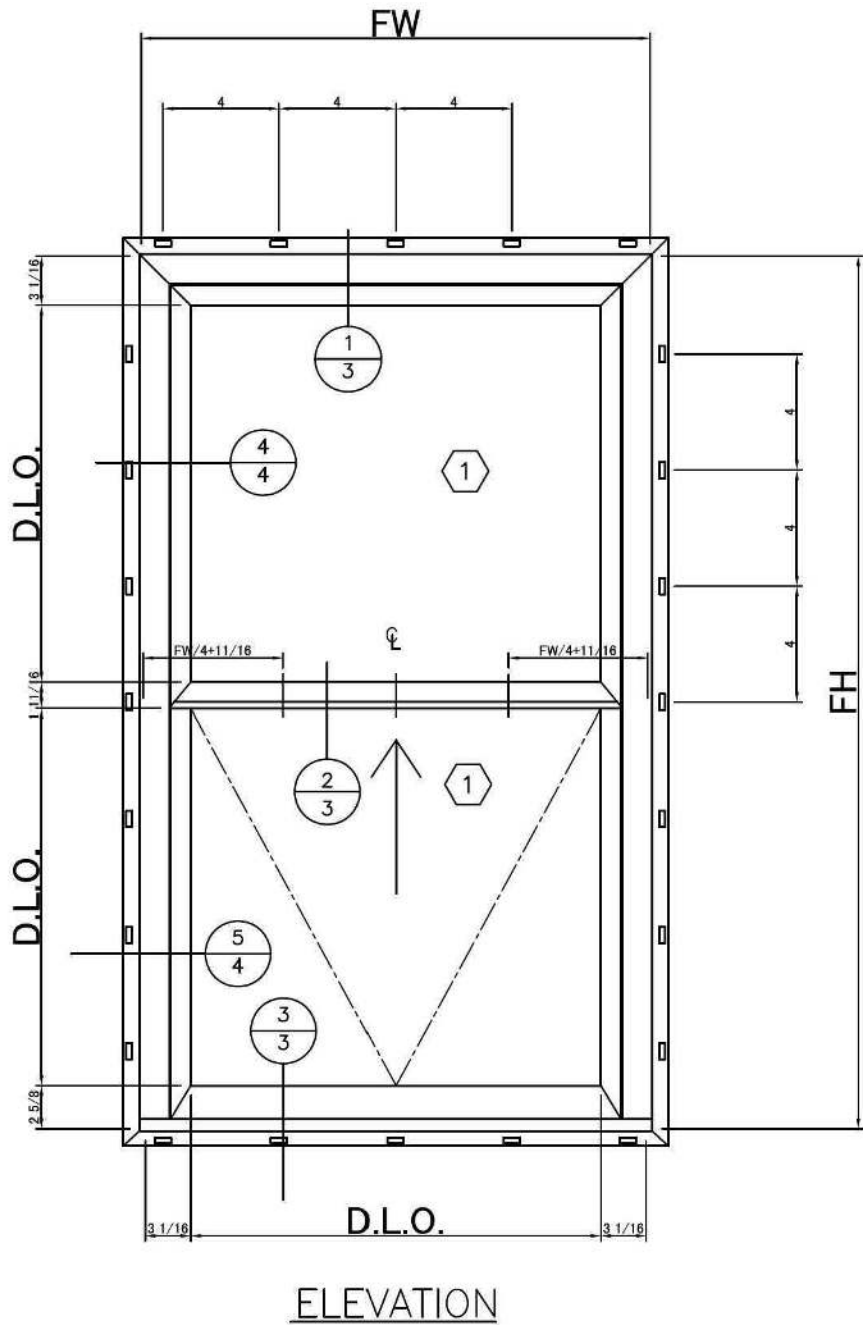

ANCHOR SCHEDULE				
METHOD	SUBSTRATE	ANCHOR	MIN. EMBEDMENT	MIN. EDGE DISTANCE
NAIL FIN	MIN. S.G. = 0.55 WOOD	#8 WOOD SCREW	1.5"	0.75"
	18 GAUGE STEEL, MIN fy = 33 ksi	#8 PAN HEAD SCREW	3 THREADS PENETRATION BEYOND METAL	0.75"

YKK

ap

Quality  
inspires™

YKK AP AMERICA RESIDENTIAL  
7680 The Bluffs, Suite 100  
Austell, GA 30168  
PH: (678) 838-6000 x6060

TITLE: STYLE VIEW  
SINGLE HUNG  
ELEVATION &  
ANCHOR SCHEDULE

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478 FX: (954) 744-4738

REVISIONS		NO.	DESCRIPTION	BY	DATE



DATE: 06.04.15  
DWN BY: BB  
CHK BY: HFN  
SCALE: NTS

DWG #: YKK123

SHEET: 2 OF 4

REVISIONS		Date	Symbol	Description

Jim Jamison architect

1969 Grooverville Road  
Dunwoody, Georgia 31129  
Telephone: 289-263-4148  
email: jamison.jim@windstream.net

WINDOW DATA 2

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO:  
CADD FILE:  
SCALE: AS INDICATED


These drawings are the property of  
Jim Jamison, Architect, and cannot be  
reused or reproduced without permission  
and credit.  
Copyright © 2020

DRAWING NUMBER

A-11

Sheet 18 of 28

s:\projects\ykk op america, inc\cc-14-0738 residential fbc version 5 code change\revisions\FB114\dwgs\ykk123.dwg

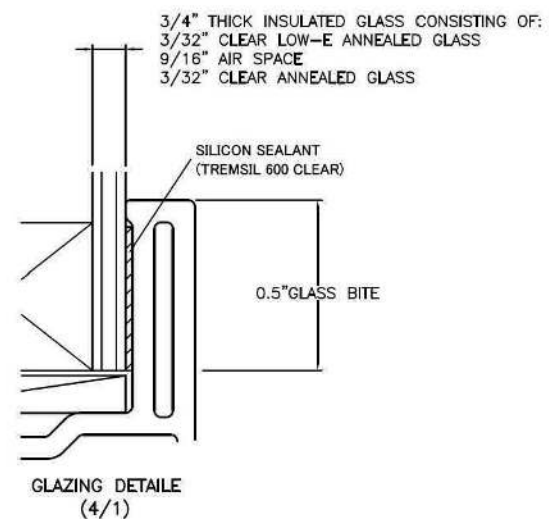

**YKK**  
**ap** ®

Quality  
inspires™

YKK AP AMERICA RESIDENTIAL  
7680 The Bluffs, Suite 100  
Austell, GA 30168  
PH: (678) 838-6000 x6060

**TITLE:** STYLE VIEW  
SINGLE HUNG  
ELEVATION, ANCHOR LAYOUT &  
GLAZING DETAIL

**PREPARED BY:**  
 **BUILDING DROPS, INC.**  
 398 E. DANIA BEACH BLVD. #338  
 DANIA BEACH, FL 33004  
 PH: (954) 399-8478 FX: (954) 744-4738

PH: (954) 399-8478  
FX: (954) 744-4738

[illegible]

DATE: 06.04.15	DWN BY: BB	CHK BY: HFN	SCALE: NTS
DWG #: <b>YKK123</b>			
SHEET: <b>3</b> OF <b>4</b>			

[illegible]

**n architect**  
1969 Grooverville Road  
Dixie, Georgia 31609  
Telephone: 229-263-4348  
email: [jami@windstream.net](mailto:jami@windstream.net)

**WINDOW DATA 3**

---

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDER'S 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO:  
CAD FILE:  
SCALE: AS INDICATED

These drawings are the property of  
Jim Jamison, Architect and cannot be  
reused or reproduced without permission  
and credit.  
Copyright © 2020


DRAWING NUMBER

A-12


Sheet 19 of 28

6/16/2018 3:53 PM

s:\projects\ykt ap america, inc\cc-14-0738 residential fbc version 5 code change\revisions\18114.dwg\ykt123.dwg

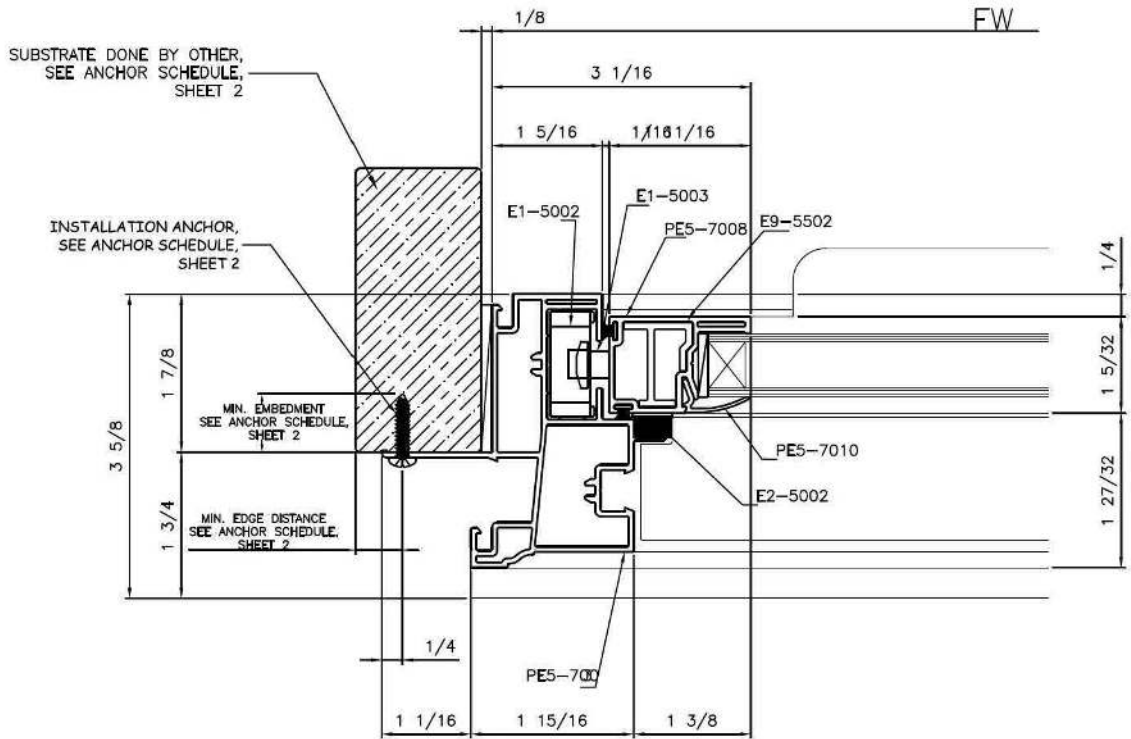

DETAIL 5

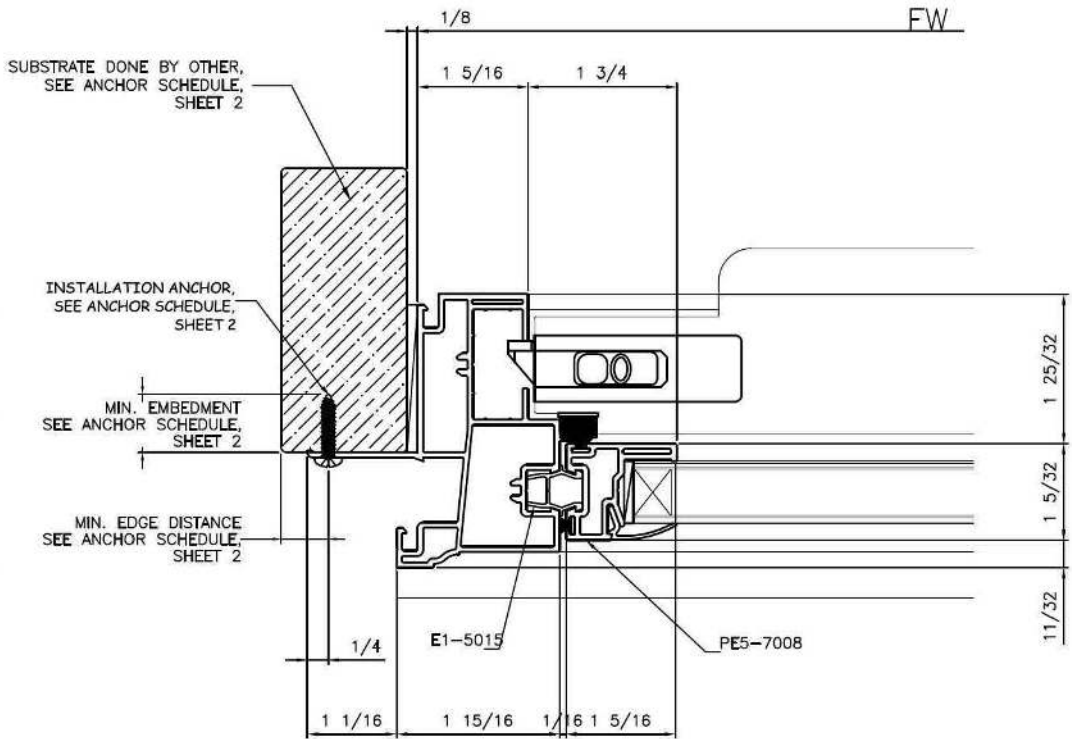

DETAIL 4



YKK AP AMERICA RESIDENTIAL  
7680 The Bluffs, Suite 100  
Austell, GA 30168  
PH: (678) 838-6000 x6060

TITLE: STYLE VIEW  
SINGLE HUNG  
HORIZONTAL SECTION

PREPARED BY:  
BUILDING DROPS, INC.  
398 E. DANIA BEACH BLVD. #338  
DANIA BEACH, FL 33004  
PH: (954) 399-8478 FX: (954) 744-4738

### REVISIONS

NO.	DESCRIPTION	BY	DATE



DATE: 06.04.15  
DWN BY: BB  
CHK BY: HFN  
SCALE: NTS

DWG #: YKK123  
SHEET: 4 OF 4

REVISIONS	
Date	Description

**Jimison Architect**  
1969 Grooverille Road  
Duluth, Georgia 31629  
Telephone: 229-263-4148  
email: jimison.jim@windstream.net

**WINDOW DATA 4**  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO.:  
CAD FILE:  
SCALE: AS INDICATED

These drawings are the property of Jim Jimison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER  
**A-13**  
Sheet 20 of 28



NOTES:

1. GENERAL:  
Unless otherwise specified, all work and materials shall conform to the requirements "Florida Residential Building Code, current adopted Edition."
2. DESIGN LOADS:

A. Live Loads:

Roof.....20 psf

Floor.....40 psf

B. Wind Load based on American National Standards Institute/American Society of Civil Engineers, ANSI/ASCE 7-88.

Wind Speed (3 sec gust).....120 mph

Exposure Class.....C

Importance Factor.....1.0
3. Materials and Construction:

A. Soil:

Assumed allowable soil bearing capacity shall be 1500 psf for all footings.

B. Concrete:

1] All concrete work shall conform to ACI 318, "Standard Building Code" requirements for reinforced concrete. Concrete shall have a minimum compressive strength at 28 days of 3000 psi.

2] Chamfer all concrete exposed edges 3/4" unless indicated otherwise.

C. Reinforcing Steel:

1] All reinforcing steel shall be intermediate grade billet steel conforming to ASTM A615, grade 40.

2] Minimum splice length = 40 bar diameters unless indicated otherwise.

3] Provide additional horizontal corner bars to match main horizontal reinforcing steel at all beam and wall intersections, corners and other directional changes, except footings.

4] Footings:

a. 2-#5 Continuous.

b. #3 Ties @ 48" o.c.

c. Use rebar chairs, not bricks or other items to support footing rebar.

d. Provide a 3" of clearance from bottom of footing to rebar.

5] Foundation Wall:

a. 1-#5 vertical bar, with standard hook into footing, as indicated; maximum spacing 6'-8" o.c.

H. VAPOR BARRIER

1] Apply a 10 mil vapor barrier over the entire surface of the prepared subgrade prior to placing concrete slab.

2] Edges shall be lapped a minimum of 6" and taped with the vapor barrier manufacturer's recommended tape.

J. Do not scale these drawings. Use dimensions only.

K. Verify all dimensions.
- 0248


SCALE: 1/4" = 1'-0"
- 
- | REVISIONS |        | Description |
|-----------|--------|-------------|
| Date      | Symbol |             |
|           |        |             |
|           |        |             |
|           |        |             |
- Jimison architect

1969 Grooverille Road  
Duluth, Georgia 31629  
Telephone: 289-2651-4148  
email: jamison.jim@windstream.net
- FOUNDATION PLAN

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL
- DATE: 23 NOV 2020  
DRAWN: ME  
CHECKED: JJ  
PROJECT NO:  
CAD FILE:  
SCALE: AS INDICATED

These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER  
A-14  
Sheet 21 of 28



REVISIONS		Description
Date	Symbol	


**Jimison architect**  
1969 Grooverille Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

**WALL SECTIONS**  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL


DATE: 5 NOV 2020  
DRAWN: ME  
CHECKED:  
PROJECT NO:  
C&D FILE:  
SCALE: AS INDICATED

These drawings are the property of  
Jim Jamison, Architect and cannot be  
reused or reproduced without permission  
and credit.  
Copyright © 2020


DRAWING NUMBER  
**A-15**  
Sheet 22 of 28

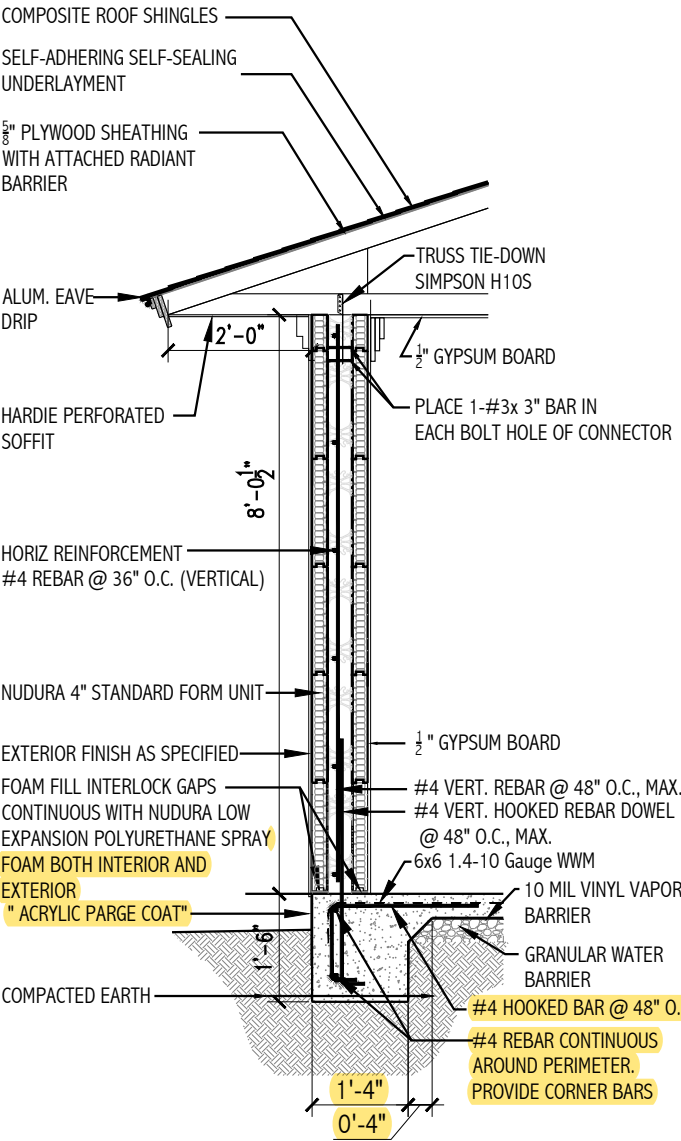




WALL SECTION **1**  
SCALE:  $\frac{3}{8}$ " = 1'-0"  
**A-15**

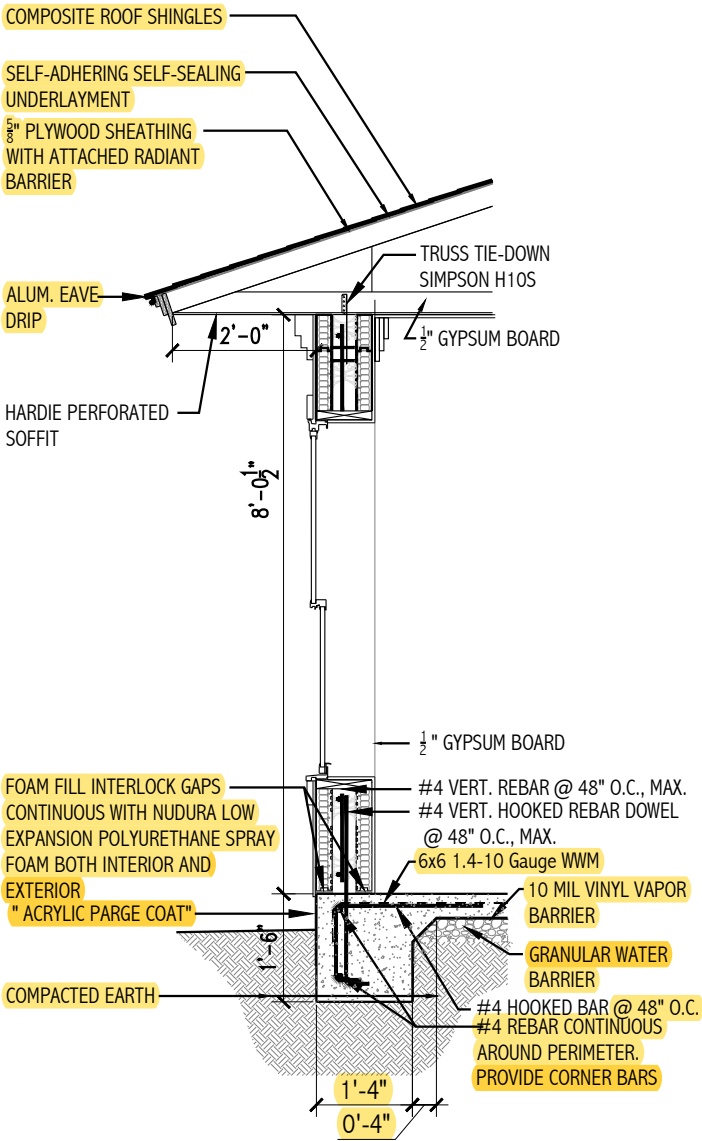

WALL SECTION **2**  
SCALE:  $\frac{3}{8}$ " = 1'-0"  
**A-15**

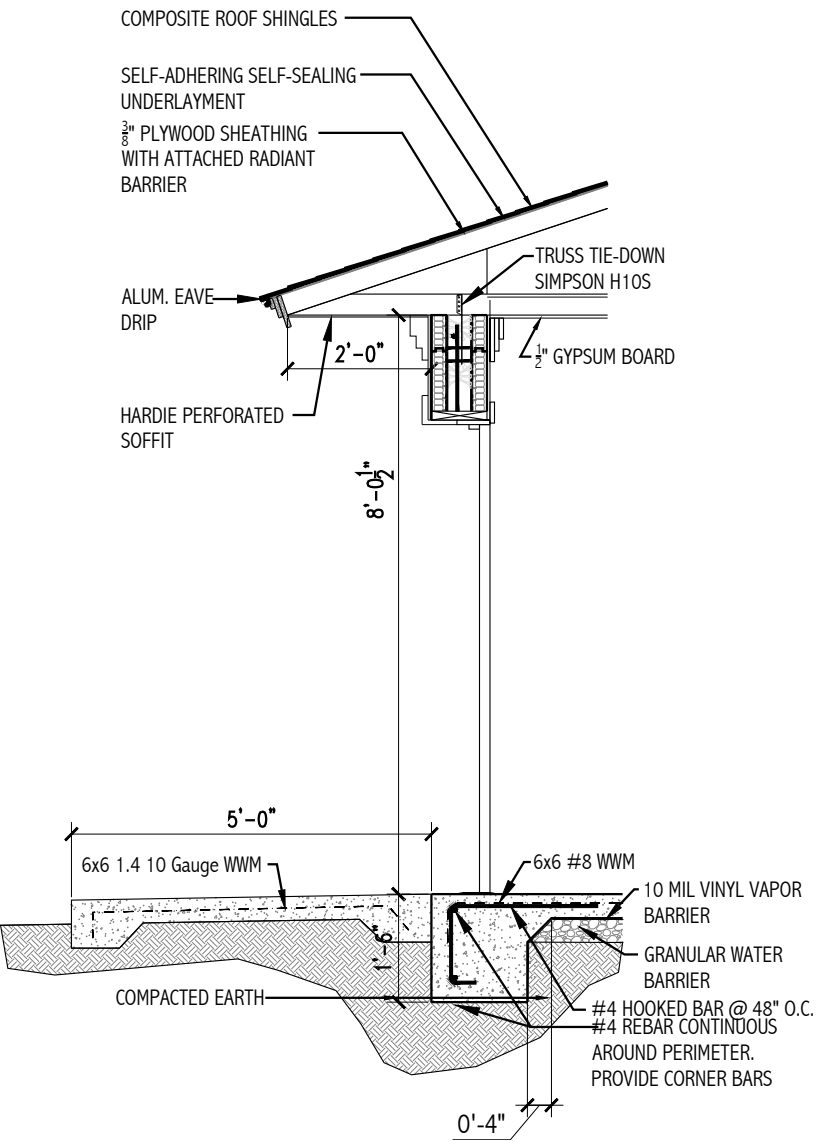


WALL SECTION **3**  
SCALE:  $\frac{3}{8}$ " = 1'-0"  
**A-15**

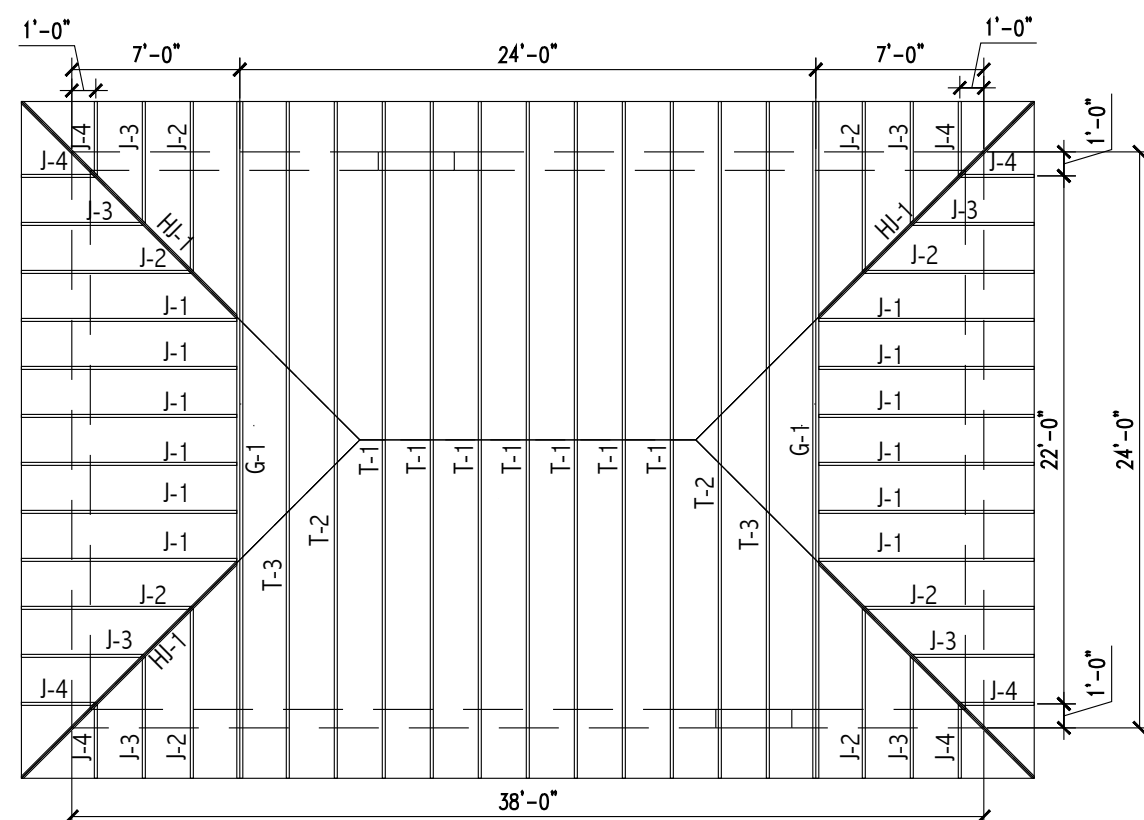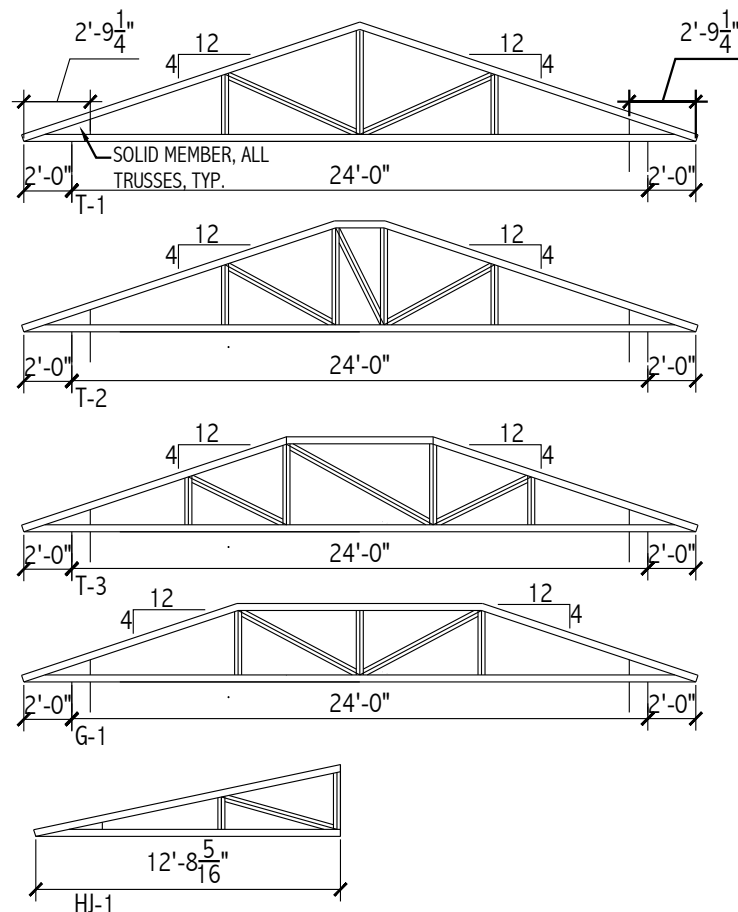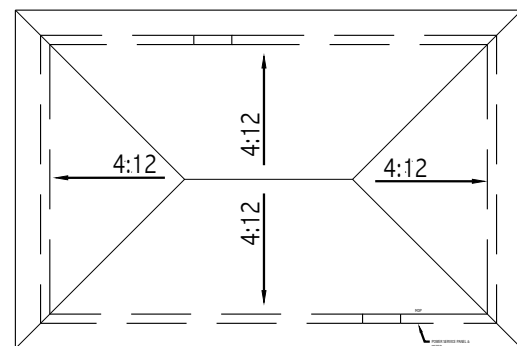

## PRE-ENGINEERED/PRE-FABRICATED WOOD TRUSSES

1. TRUSSES TO BE SPACED AT 2'-0" O.C., MAX. TYPICAL UNLESS NOTED OTHERWISE. SMALLER SPACING MAY BE USED, IF REQUIRED BY TRUSS DESIGNER/ MANUFACTURER. SEE ROOF FRAMING PLAN FOR TRUSS LOCATIONS.
2. TRUSS DESIGN LOADS INCLUDING GIRDER TRUSSES:  
TOP CHORD LIVE LOAD..... 20 PSF  
TOP CHORD DEAD LOAD..... 10 PSF (INCLUDES 3 PSF FOR TRUSS WEIGHT)  
BOTTOM CHORD DEAD LOAD..... 5 PSF  
TOTAL LOAD..... 35 PSF  
WIND UPLIFT..... TO BE DETERMINED BY TRUSS DESIGNER  
MAXIMUM LIVE LOAD DEFLECTION SHALL BE  $\text{SPAN}/240$ .
3. ROOF TRUSSES SHALL BE DESIGNED FOR APPLICABLE WIND LOADS AT THE BUILDING LOCATION IN COMBINATION WITH DEAD LOADS SHOWN ABOVE. APPLICABLE CODE PRESSURE AND SUCTION FACTORS SHALL BE USED IN ARRIVING AT LOADS FOR THIS LOAD CASE.
4. TRUSSES TO BE DESIGNED AND FABRICATED BY TRUSS MANUFACTURER. DESIGN SHALL BE PERFORMED BY A PROFESSIONAL ENGINEER DULY REGISTERED IN THE STATE OF FLORIDA.
5. CONFIGURATION AND SIZE OF TRUSS MEMBERS SHALL BE DETERMINED BY TRUSS MANUFACTURER.
6. PROFILES AND DIMENSIONS SHOWN IN THE TRUSS TYPE ELEVATIONS ON DRAWINGS ARE FOR THE PURPOSE OF CONVEYING THE DESIGN INTENT. VERIFY ALL CONDITIONS AND DIMENSIONS.
7. PROVIDE PERMANENT TRUSS BRIDGING AND TEMPORARY TRUSS BRACING IN ACCORDANCE WITH THE TRUSS MANUFACTURER'S INSTRUCTIONS.
8. TRUSS TO TRUSS CONNECTIONS SHALL BE DESIGNED BY THE TRUSS DESIGNER/MANUFACTURER.
9. NO REPETITIVE MEMBER OR LOAD DURATION ALLOWABLE STRESS INCREASE SHALL BE ALLOWED FOR TRUSS OR TRUSS PLATE.
10. ROOF TRUSSES SHALL BE CONNECTED TO THE TOP PLATE WITH A SUITABLE SIMPSON STRONG TIE H-10A CONNECTOR/ANCHOR UNLESS OTHERWISE DETERMINED BY THE TRUSS DESIGNER.
11. WHERE THE ROOF TRUSS CONNECTS TO ANOTHER TRUSS OR TO A BEAM, IT SHALL BE CONNECTED WITH A METAL CONNECTOR DESIGNED TO RESIST THE GRAVITY AND WIND LOADS.
12. TRUSS DESIGN AND SHOP DRAWINGS FOR TRUSSES ARE TO BE SUBMITTED FOR REVIEW PRIOR TO FABRICATION. REVIEW IS FOR CONFIRMATION OF GENERAL CONFORMANCE WITH THE CONTRACT DOCUMENTS.
13. THE RESPONSIBILITY FOR DESIGN, FABRICATION, DIMENSIONS, BRACING, BRIDGING, QUANTITIES, ERECTION, COORDINATION AND COMPLIANCE WITH THE CONTRACT DOCUMENTS REMAIN WITH THE CONTRACTOR.

[illegible]

**Jimison architect**  
1969 Groverville Road  
Dixie, Georgia 31609  
Telephone: 228-265-4348

**ROOF FRAMING PLAN**

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDER'S 3R  
122 SW ALBANY TERRACE


DATE: 23 NOV  
DRAWN:  
CHECKED:  
PROJECT NO:  
CAD FILE:  
SCALE: AS INDIC

These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020


DRAWING NUMBER

**A-16**

Sheet 23 of 28

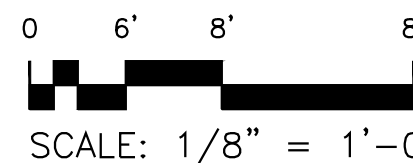



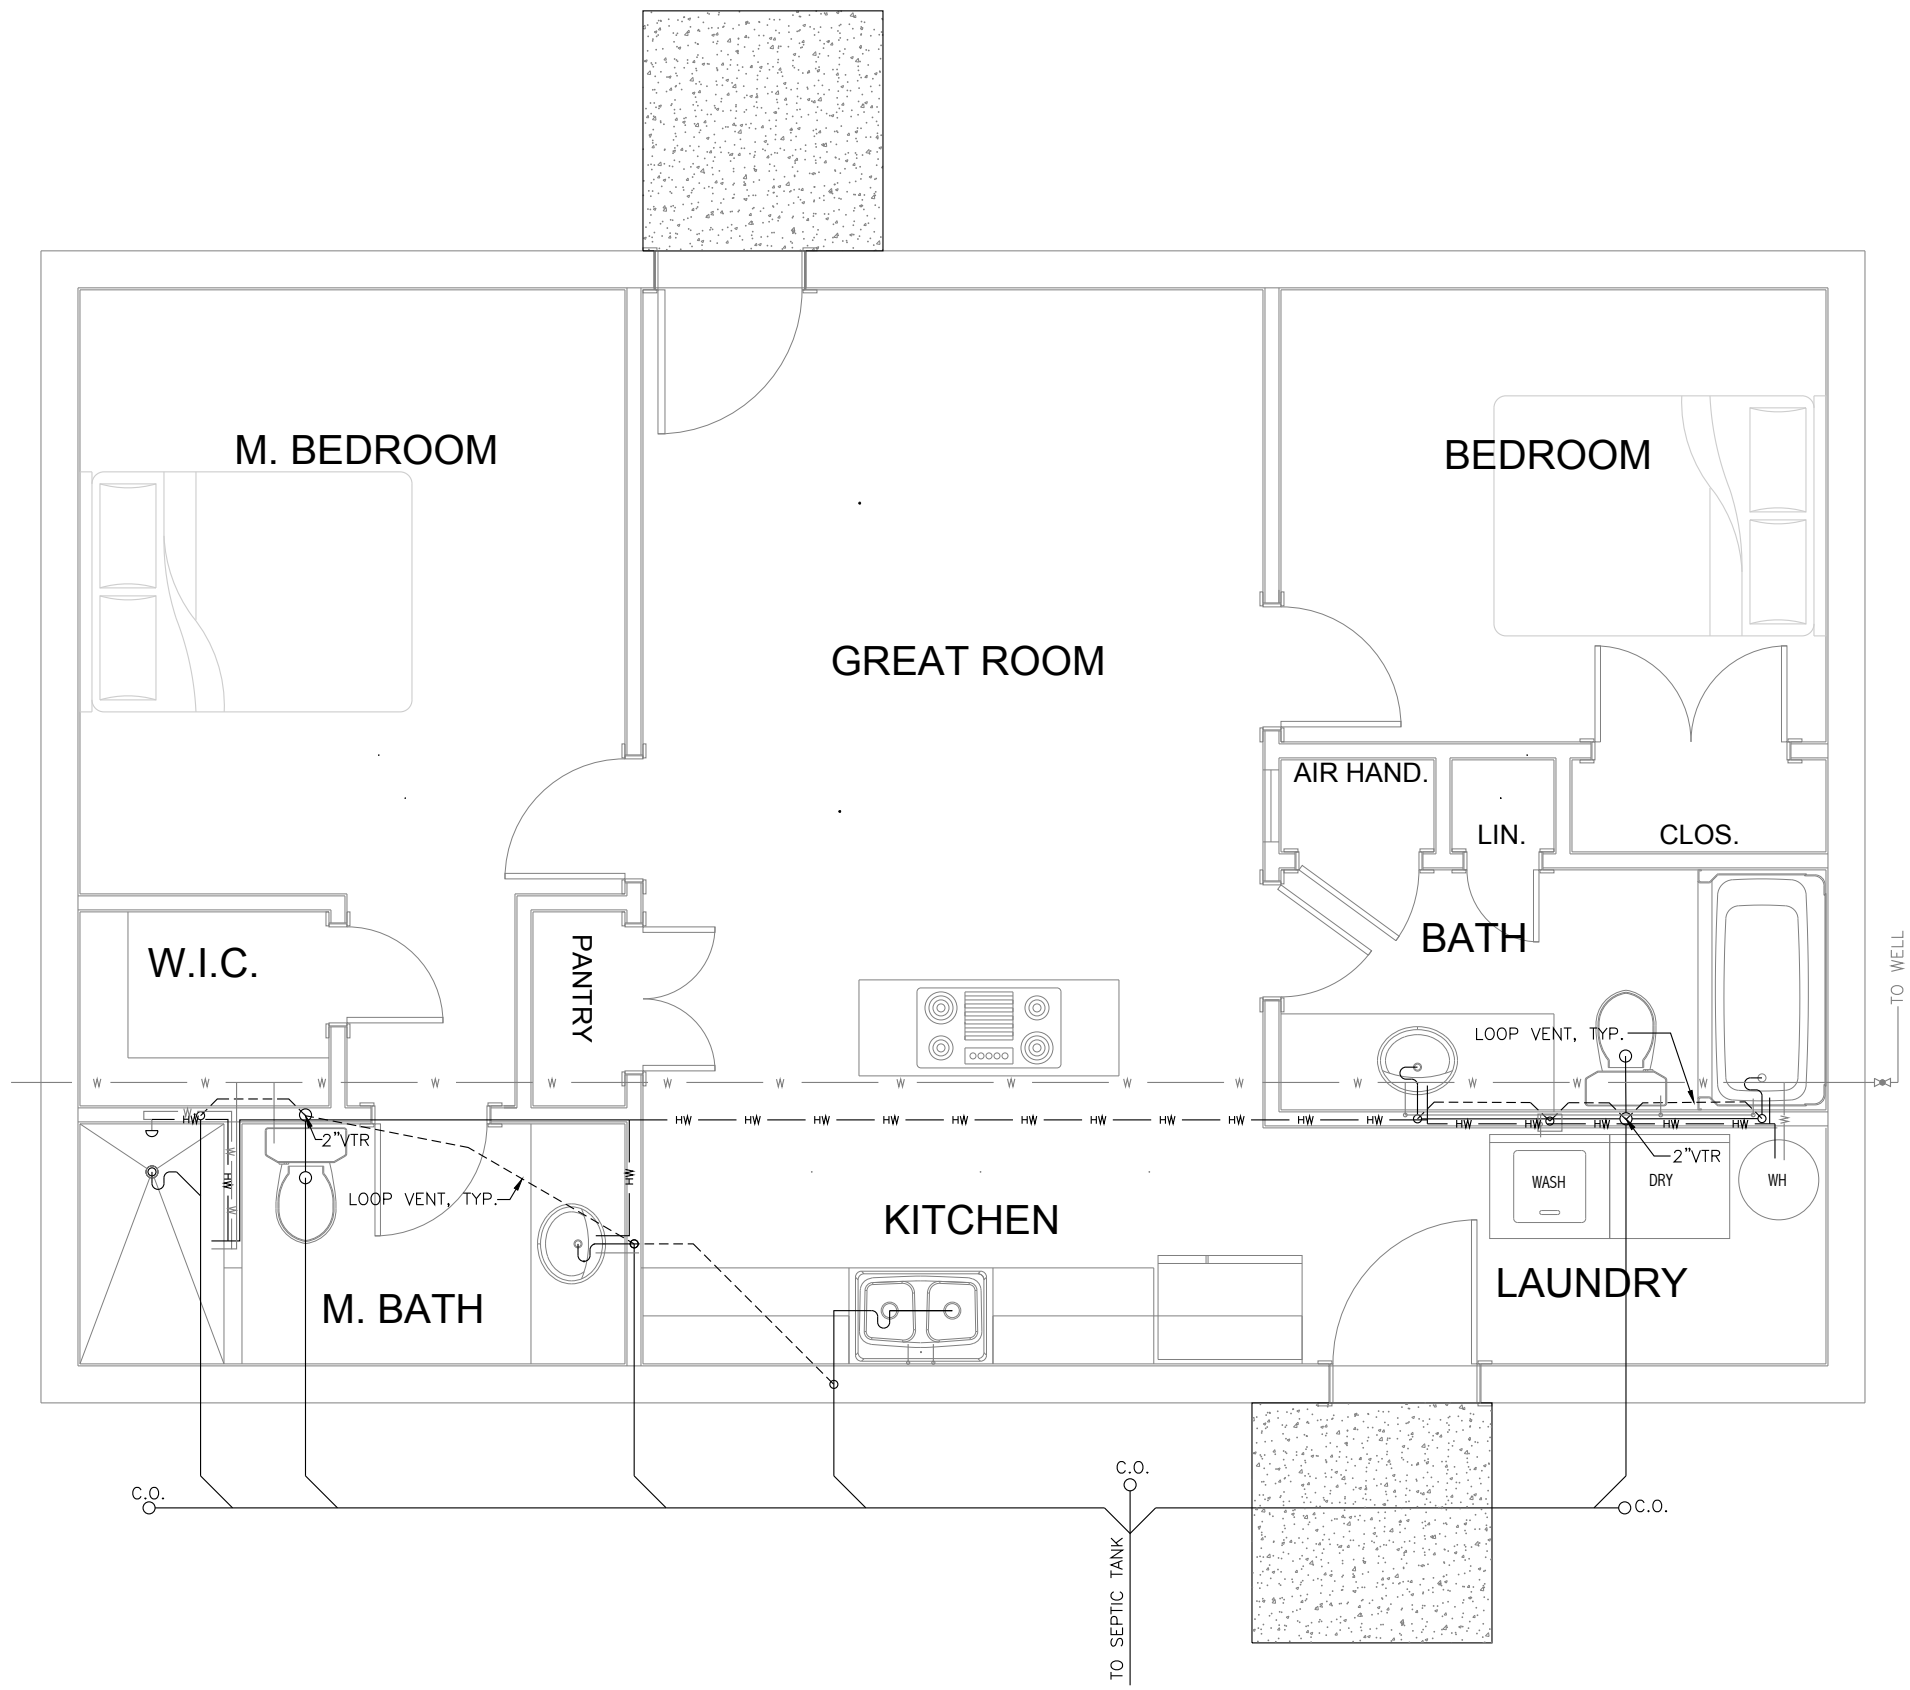

PLUMBING NOTES:

- 1. ALL WORK AND MATERIAL SHALL COMPLY WITH THE APPLICABLE FLORIDA PLUMBING CODE.
- 2. THE PLUMBING CONTRACTOR SHALL THOROUGHLY FAMILIAR HIMSELF WITH THE DRAWINGS, VERIFY LOCATIONS, PIPE ROUTING, LOCATIONS OF SHOWER CONTROLS ETC. BEFORE BEGINNING ANY INSTALLATION. ANY DISCREPANCIES OR QUESTIONS SHALL BE REPORTED TO THE OWNER.
- 3. THE PLUMBING CONTRACTOR IS AND SHALL BE RESPONSIBLE FOR ALL FINAL CONNECTIONS TO PLUMBING FIXTURES, EQUIPMENT AND APPLIANCES, INCLUDING BUT NOT NECESSARILY LIMITED TO FURNISHING AND INSTALLING ALL TRAPS, DRAINS, SUPPLIES AND STOPS.
- 4. THE PLUMBING CONTRACTOR SHALL COORDINATE ALL PIPING AND EQUIPMENT WITH OTHER TRADES TO AVOID CONFLICTS. DO NOT CUT STRUCTURAL MEMBERS WITHOUT PERMISSION. WHEN STRUCTURAL MEMBERS MUST BE CUT, CUTS, BORES AND NOTCHES MUST COMPLY WITH THE FLORIDA RESIDENTIAL BUILDING CODE.
- 5. EXACT LOCATIONS AND ROUGH-IN REQUIREMENTS FOR ALL FIXTURES AND EQUIPMENT SHALL BE DETERMINED FROM THE ARCHITECTURAL DRAWINGS, LARGE SCALE ARCHITECTURAL DETAILS, APPROVED MANUFACTURER'S SHOP DRAWINGS AND AS DIRECTED.
- 6. THIS DRAWING IS SCHEMATIC AND DOES NOT REPRESENT A COMPLETE DESIGN. ACTUAL DESIGN SHALL BE PERFORMED BY A FLORIDA LICENSED PLUMBER WITH A ACTIVE LICENSE. THIS DRAWING INDICATES GENERAL PIPING LOCATION AND GENERAL LOCATION OF VENTS AND LOOP VENTS. THE PIPING LAYOUT CAN BE REVISED, HOWEVER THE LOCATION OF THE FIXTURES, EQUIPMENT AND APPLIANCES ARE FIXED.
- 7. PIPING IS SHOWN IN ITS GENERAL LOCATION, UNLESS DIMENSIONED. EXACT LOCATION SHALL BE DETERMINED BY ACTUAL CONDITIONS.
- 8. SIZING OF ALL PIPING SHALL COMPLY WITH THE APPLICABLE FLORIDA PLUMBING CODE AND AS NOTED HEREIN.
  - A. WATER PIPING FROM WELL TO HOUSE SHALL BE 1" DIAMETER PVC BURIED WITH 18" COVER.
  - B. WATER PIPING FOR DISTRIBUTION TO FIXTURES, EQUIPMENT AND APPLIANCES SHALL BE:
    - 1] COLD WATER PIPING SHALL BE ¾" DIAMETER PVC.
    - 2] HOT WATER PIPING SHALL BE ½" DIAMETER CPVC.
- 9. ALL WATER PIPING SHALL BE INSULATED WITH ½" "ARMAFLEX."
- 10. PROVIDE SLEEVES FOR PIPES PASSING THROUGH FLOORS AND MASONRY WALLS. THE ANNULAR SPACE SHALL BE PACKED WITH A U.L. APPROVED MATERIAL. WHERE PIPING PENETRATES THE FLOOR, WALLS, CABINETS OR THE FOUNDATION WALL ESCUTCHEONS SHALL BE INSTALLED AND THE PENETRATION SHALL BE SEALED WITH A NON-FLAMMABLE SEALANT TO PREVENT THE INTRUSION OF WATER, INSECTS AND VARMINTS.
- 11. RISERS FOR FIXTURES AND VENTS SHALL BE CONCEALED IN IN WALLS.
- 12. ALL VENTS THRU THE ROOF SHALL BE INSTALLED A MINIMUM OF 15 FEET, OR GREATER IF REQUIRED BY CODE, FROM ANY FRESH AIR INTAKES.
- 13. ALL VENTS THRU THE ROOF SHALL BE FLASHED WITH A 4 LB. HIGH LEAD BOOT OR AS REQUIRED BY THE ROOFING MANUFACTURER.
- 14. ALL WATER LINES SHALL BE PROVIDED WITH WATER HAMMER ARRESTORS OR AIR CUSHIONS.
- 15. PROVIDE CLEANOUTS IN ALL WASTE WATER PIPING IN ACCORDANCE WITH THE REQUIREMENTS OF THE APPLICABLE FLORIDA BUILDING CODE.
- 16. AFTER COMPLETION AND ACCEPTANCE OF ALL OF THE PLUMBING WORK, PROVIDE THE OWNER ONE SET OF REPRODUCIBLE DRAWINGS OF THE AS BUILT AND INSTALLED PIPING, VALVES, CLEANOUTS, VENTS, FIXTURES, APPLIANCES AND EQUIPMENT, CONNECTIONS TO ALL FIXTURES, APPLIANCES AND EQUIPMENT. PROVIDE ALSO ONE COPY OF ALL MANUFACTURER'S LITERATURE FOR INSTALLED ITEMS.
- 17. THE WORK SHALL BE WARRANTED BY THE INSTALLING CONTRACTOR TO THE EXTENT OF THE FLORIDA STATUE OF LIMITATIONS APPLICABLE TO CONSTRUCTION AND MAUFACTURED EQUIPMENT.

02'4'8'

SCALE: 1/4" = 1'-0"



REVISIONS		Description
Date	Symbol	

Jimison architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

PLUMBING PLAN

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL


DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO:	
CAD FILE:	
SCALE:	AS INDICATED

DRAWING NUMBER

M-1

Sheet 24 of 28

RESIDENTIAL HEAT LOSS AND HEAT GAIN CALCULATION								
IN ACCORDANCE WITH ACCA MANUAL J								
Design Conditions: Gainesville								
Indoor:	Summer	Winter	Outdoor	Summer	Winter			
	75	72		93	31			
Relative Humidity: 55								
Summer Grains of Moisture: 116								
Daily Temperature Range: Medium								
BUILDING COMPONENT	AREA SQUARE FEET	SENSIBLE GAIN BTUH	LATENT GAIN BTUH	TOTAL HEAT GAIN BTUH	TOTAL HEAT LOSS BTUH	COOLING CFM	HEATING CFM	BOTH
GREATROOM	288	1812	1301	3113	5767	66	144	144
M. BEDROOM	189	2548	538	3106	3648	93	91	93
WIC	22	65	0	65	258	2	6	6
M. BATHROOM	61	1570	0	1570	1075	57	27	57
KITCHEN	147	2954	832	3786	2708	108	68	108
LAUNDRY	36	150	0	150	686	5	17	17
BATHROOM	61	1449	0	1449	332	53	8	53
AIR HANDLER	0	10	0	10	8	0	0	0
LIN	0	7	0	7	5	0	0	0
CLOSET	10	13	0	13	134	0	0	0
BEDROOM	121	373	0	373	1362	14	37	37
TOTALS	874.20	10950	2691	13541	15584			400

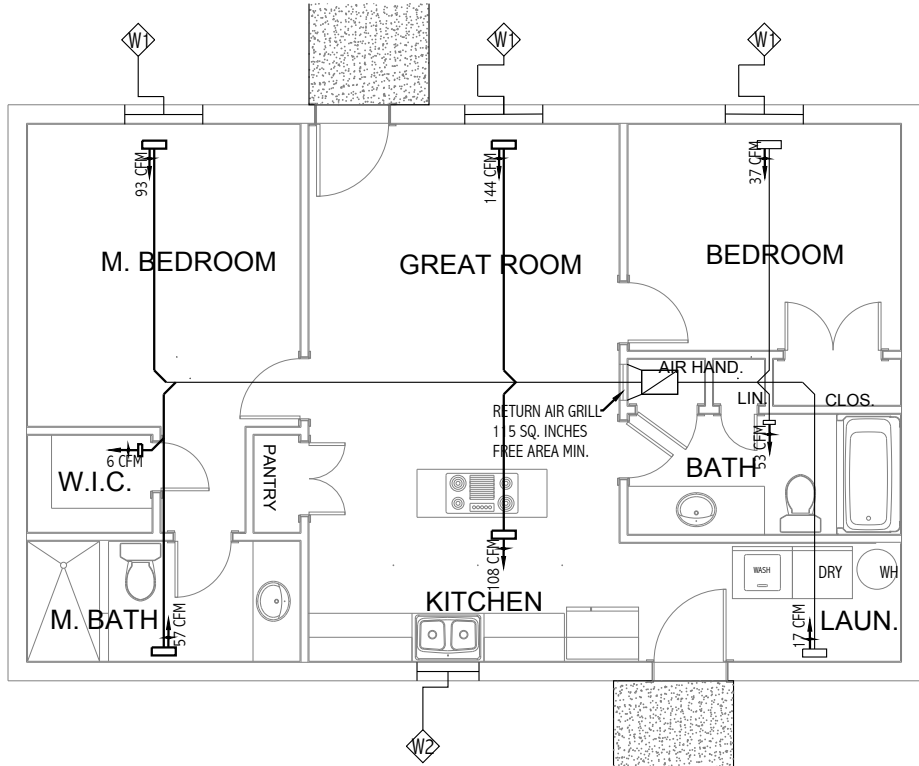

HVAC NOTES

1. THESE DRAWINGS FOR HEATING, VENTILATION AND AIR CONDITIONING ARE SCHEMATIC IN NATURE, CAREFUL COORDINATION WITH OTHER TRADES AND FRAMING IS MANDATORY.
2. ALL WORK, MATERIALS AND EQUIPMENT PROVIDED FOR AND INSTALLED SHALL MEET ALL THE REQUIRMENTS OF THE FLORIDA MECHANICAL AND ELECTRICAL CODE.
3. DUCTS FOR DRYER EXHAUST AND EXHAUST FANS: ALL JOINTS SHALL BE SEALED AIR AND LIQUID TIGHT WITH FIRE RETARDANT JOINT SEALANT. DUCT TAPE IS UNACCEPTABLE. THEY SHALL BE TERMINATED WITH A ROOF CAP OR WALL CAP AS APPROPRIATE. TERMINATION CAPS SHALL INCLUDE SCREENING OR DOORS TO PREVENT THE ENTRANCE OF BIRDS AND INSECTS.
4. DUCT FOR RANGE HOOD VENT SHALL TERMINATE ON THE ROOF WITH A WEATHER RESISTANT CAP. THE CAP SHALL ALSO INCLUDE A GUARD TO PREVENT THE ENTRY OF BIRDS AND VARMINTS.
5. ALL DUCTS SHALL RUN INDIVIDUALLY FOR EACH VENTED ITEM.
6. SUPPLY AIR VOLUMES SHOWN ARE BASED ON CALCULATIONS FROM A SOFTWARE PROGRAM BASED ON MANUAL J. CERTIFIED CALCULATIONS OF REQUIRED AIR VOLUMES PROVIDED BY FLORIDA LICENSED HVAC CONTRACTOR SHALL BE PERFORMED.
7. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING COMPLIANCE WITH THE FLORIDA ENERGY CODE. THE CONTRACTOR WILL PROVIDE AND COMPLETE ANY FORMS REQUIRED.
8. THE RETURN AIR GRILLE [R.A.G.] SHALL HAVE A FREE AREA EQUAL TO 2 TIMES THE AREA OF THE TOTAL AIR VOLUME DIVIDED BY 1000 IN SQUARE INCHES.



REVISIONS		Description
Date	Symbol	

Jimison architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

HV7AC PLAN LAYOUT & CALCULATIONS

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL


DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO.:	
CAD FILE:	
SCALE:	AS INDICATED

These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020









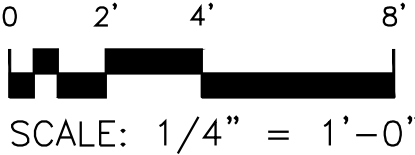








DRAWING NUMBER

M-2

Sheet 25 of 28




# ELECTRICAL LEGEND


SYMBOL	DESCRIPTION
	CEILING MOUNTED FIXTURE, LETTER DENOTES MARK IN LIGHTING FIXTURE SCHEDULE
	WALL MOUNTED FIXTURE, LETTER DENOTES MARK IN LIGHTING FIXTURE SCHEDULE
S	FLUSH MOUNTED SINGLE POLE WALL SWITCH
S <sub>3</sub>	FLUSH MOUNTED 3-WAY WALL SWITCH
	NEMA 5 -15A DUPLEX RECEPTACLE, MOUNTED 14" ABOVE FINISH FLOOR TO BOTTOM, U.N.O.
	GFCI NEMA 5-15A MOUNTED AT 44" ABOVE FINISH FLOOR
	GFCI NEMA 5-15A MOUNTED ABOVE COUNTER TOP
	220/230 RECEPTACLE UNLESS NOTED OTHERWISE
	SPECIAL PURPOSE OUTLET AS LABELED
	MOTOR CONNECTION AS INDICATED
	WATER HEATER AS NOTED
	TELEPHONE OUTLET. MOUNT AT 14" ABOVE FINISH FLOOR TO BOTTOM
	TELEPHONE OUTLET, MOUNT AT 54" ABOVE FINISH FLOOR TO TOP
	TELEVISION OUTLET, MOUNT AS DIRECTED BY OWNER
	INTERNET PROTOCOL OUTLET, MOUNT AS DIRECTED BY OWNER
	SMOKE DETECTOR
	MAIN DISTRIBUTION PANEL
WP	WEATHER PROOF
GFCI	GROUND FAULT CIRCUIT INTERRUPTER
AFF	ABOVE FINISH FLOOR
ACT	ABOVE COUNTER TOP
	2 LAMP FLOOD
	DUPLEX FLOOR OUTLET
EF	EXHAUST FAN

## ELECTRICAL NOTES

1. THESE DRAWINGS FOR ELECTRICAL LIGHTING AND POWER ARE SCHEMATIC IN NATURE, CAREFUL COORDINATION WITH OTHER TRADES AND FRAMING IS MANDATORY.
2. ALL WORK, MATERIALS AND EQUIPMENT PROVIDED FOR AND INSTALLED SHALL MEET ALL THE REQUIREMENTS OF THE FLORIDA MECHANICAL AND ELECTRICAL CODE.
3. ALL CEILING FANS SHALL BE PROVIDED WITH A WALL MOUNTED ON & OFF SWITCH.
4. LIGHTING FIXTURES SHALL BE AS SELECTED BY THE OWNER.



REVISIONS	
Date	Description

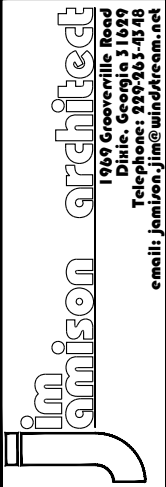

**Jimison Architect**  
1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

**ELECT. NOTES & LEGEND**

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDER'S 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL


DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO:	
CAD FILE:	
SCALE:	AS INDICATED
These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit. Copyright © 2020	

DRAWING NUMBER

**E-1**


Sheet 26 of 28



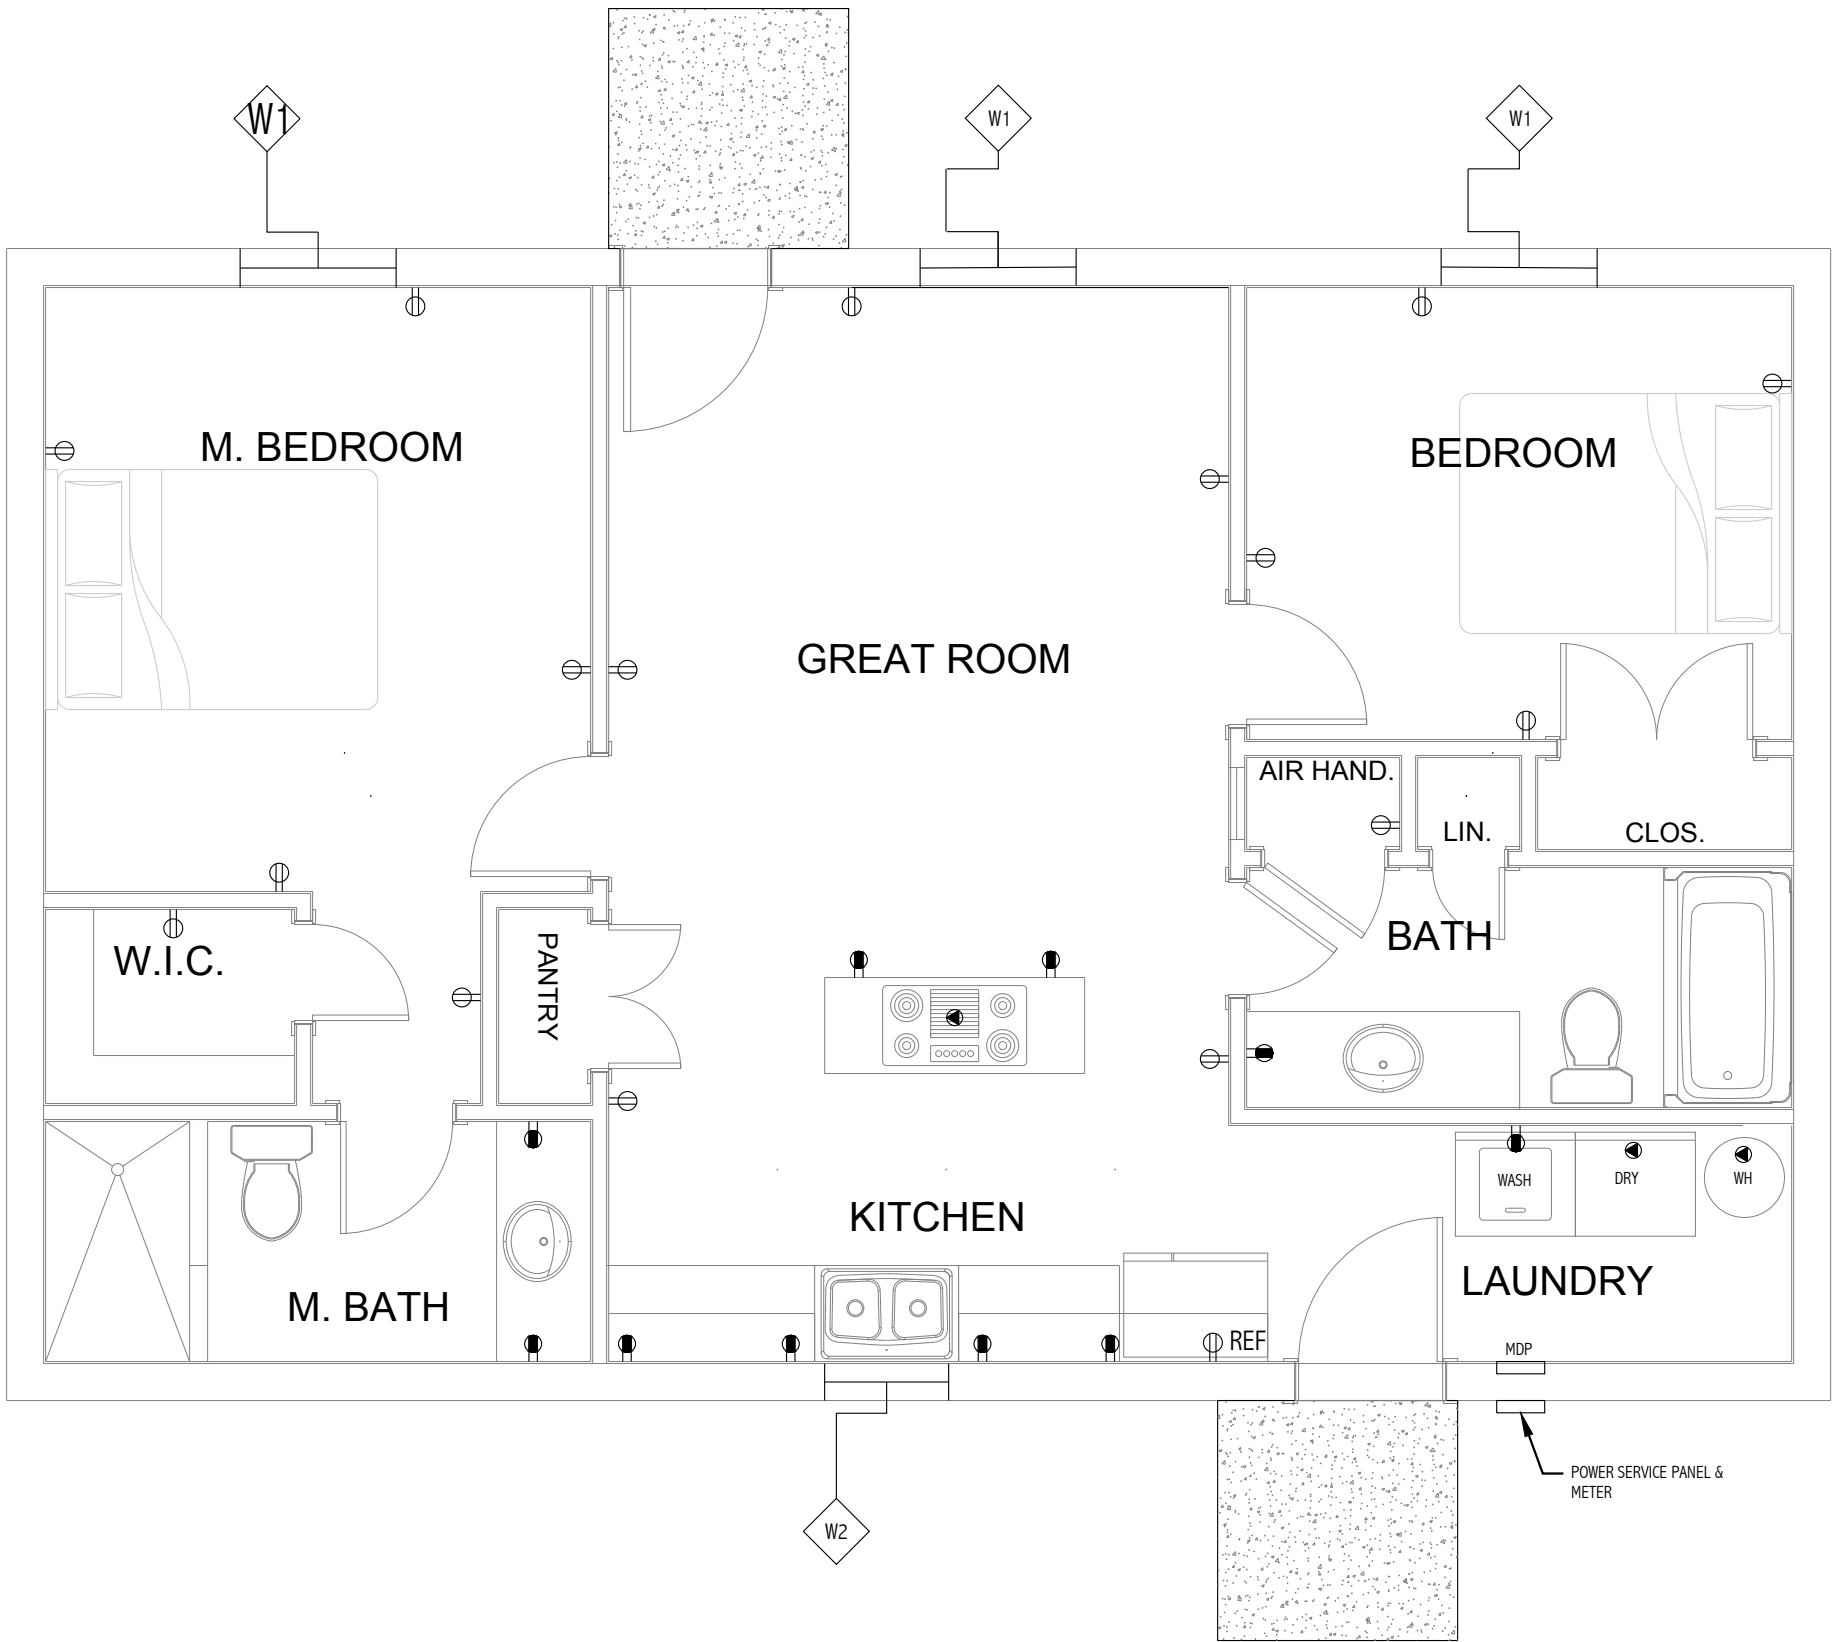

# ELECTRICAL NOTES

- 1. THESE DRAWINGS FOR ELECTRICAL LIGHTING AND POWER ARE SCHEMATIC IN NATURE, CAREFUL COORDINATION WITH OTHER TRADES AND FRAMING IS MANDATORY.
- 2. ALL WORK, MATERIALS AND EQUIPMENT PROVIDED FOR AND INSTALLED SHALL MEET ALL THE REQUIRMENTS OF THE FLORIDA MECHANICAL AND ELECTRICAL CODE.
- 3. ALL CEILING FANS SHALL BE PROVIDED WITH A WALL MOUNTED ON & OFF SWITCH EACH FOR LIGHT AND FAN.
- 4. ALL BATH EXHAUST FANS SHALL BE PROVIDED WITH A ON AND OFF SWITCH.
- 5. LIGHTING FIXTURES SHALL BE AS SELECTED BY THE OWNER.



REVISIONS		Description
Date	Symbol	

Jimison architect

1969 Grooverville Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

ELECT. POWER PLAN

C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL


DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO:	
CAD FILE:	
SCALE:	AS INDICATED


These drawings are the property of Jim Jamison, Architect and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER

E-2

Sheet 27 of 28

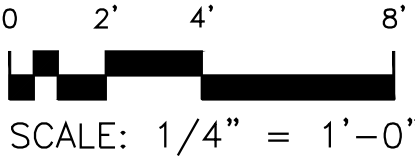

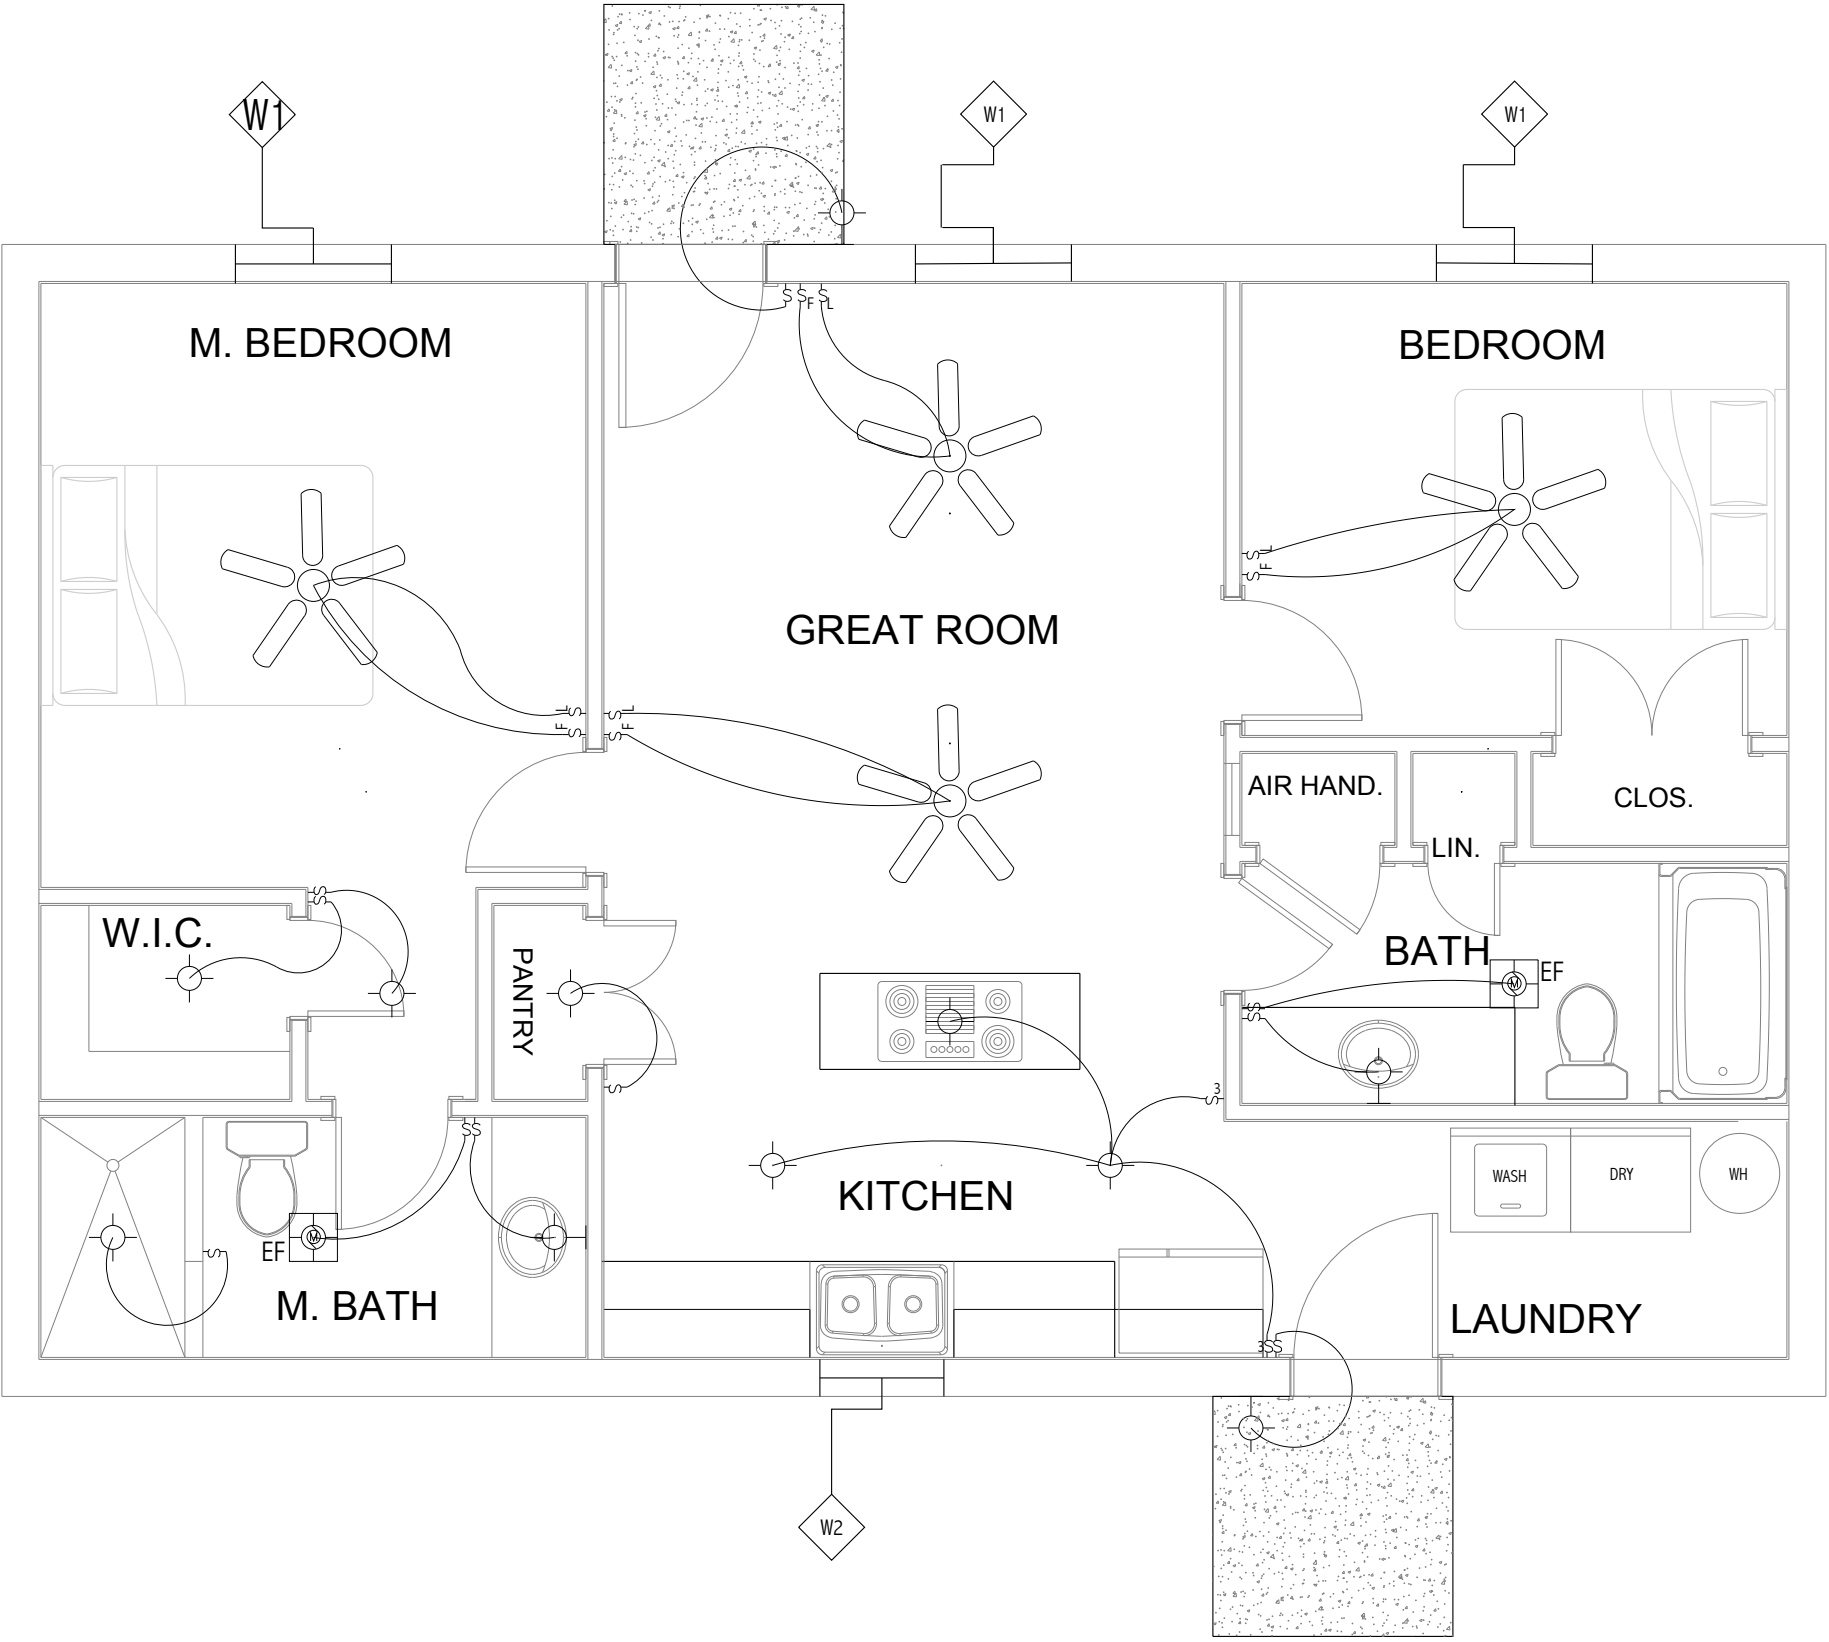

0 2' 4' 8'  
SCALE: 1/4" = 1'-0"



REVISIONS		Description
Date	Symbol	

**Jimison architect**  
1969 Grooverille Road  
Dixie, Georgia 31629  
Telephone: 229-263-4148  
email: jamison.jim@windstream.net

**LIGHTING PLAN**  
C.W. GILBERT CONSTRUCTION CO.  
GENERAL CONTRACTOR  
SAUNDERS 3R  
122 SW ALBANY TERRACE  
FORT WHITE, FL

DATE:	23 NOV 2020
DRAWN:	ME
CHECKED:	JJ
PROJECT NO:	
CAD FILE:	
SCALE:	AS INDICATED

These drawings are the property of Jim Jamison, Architect, and cannot be reused or reproduced without permission and credit.  
Copyright © 2020

DRAWING NUMBER  
**E-3**  
Sheet 28 of 28