



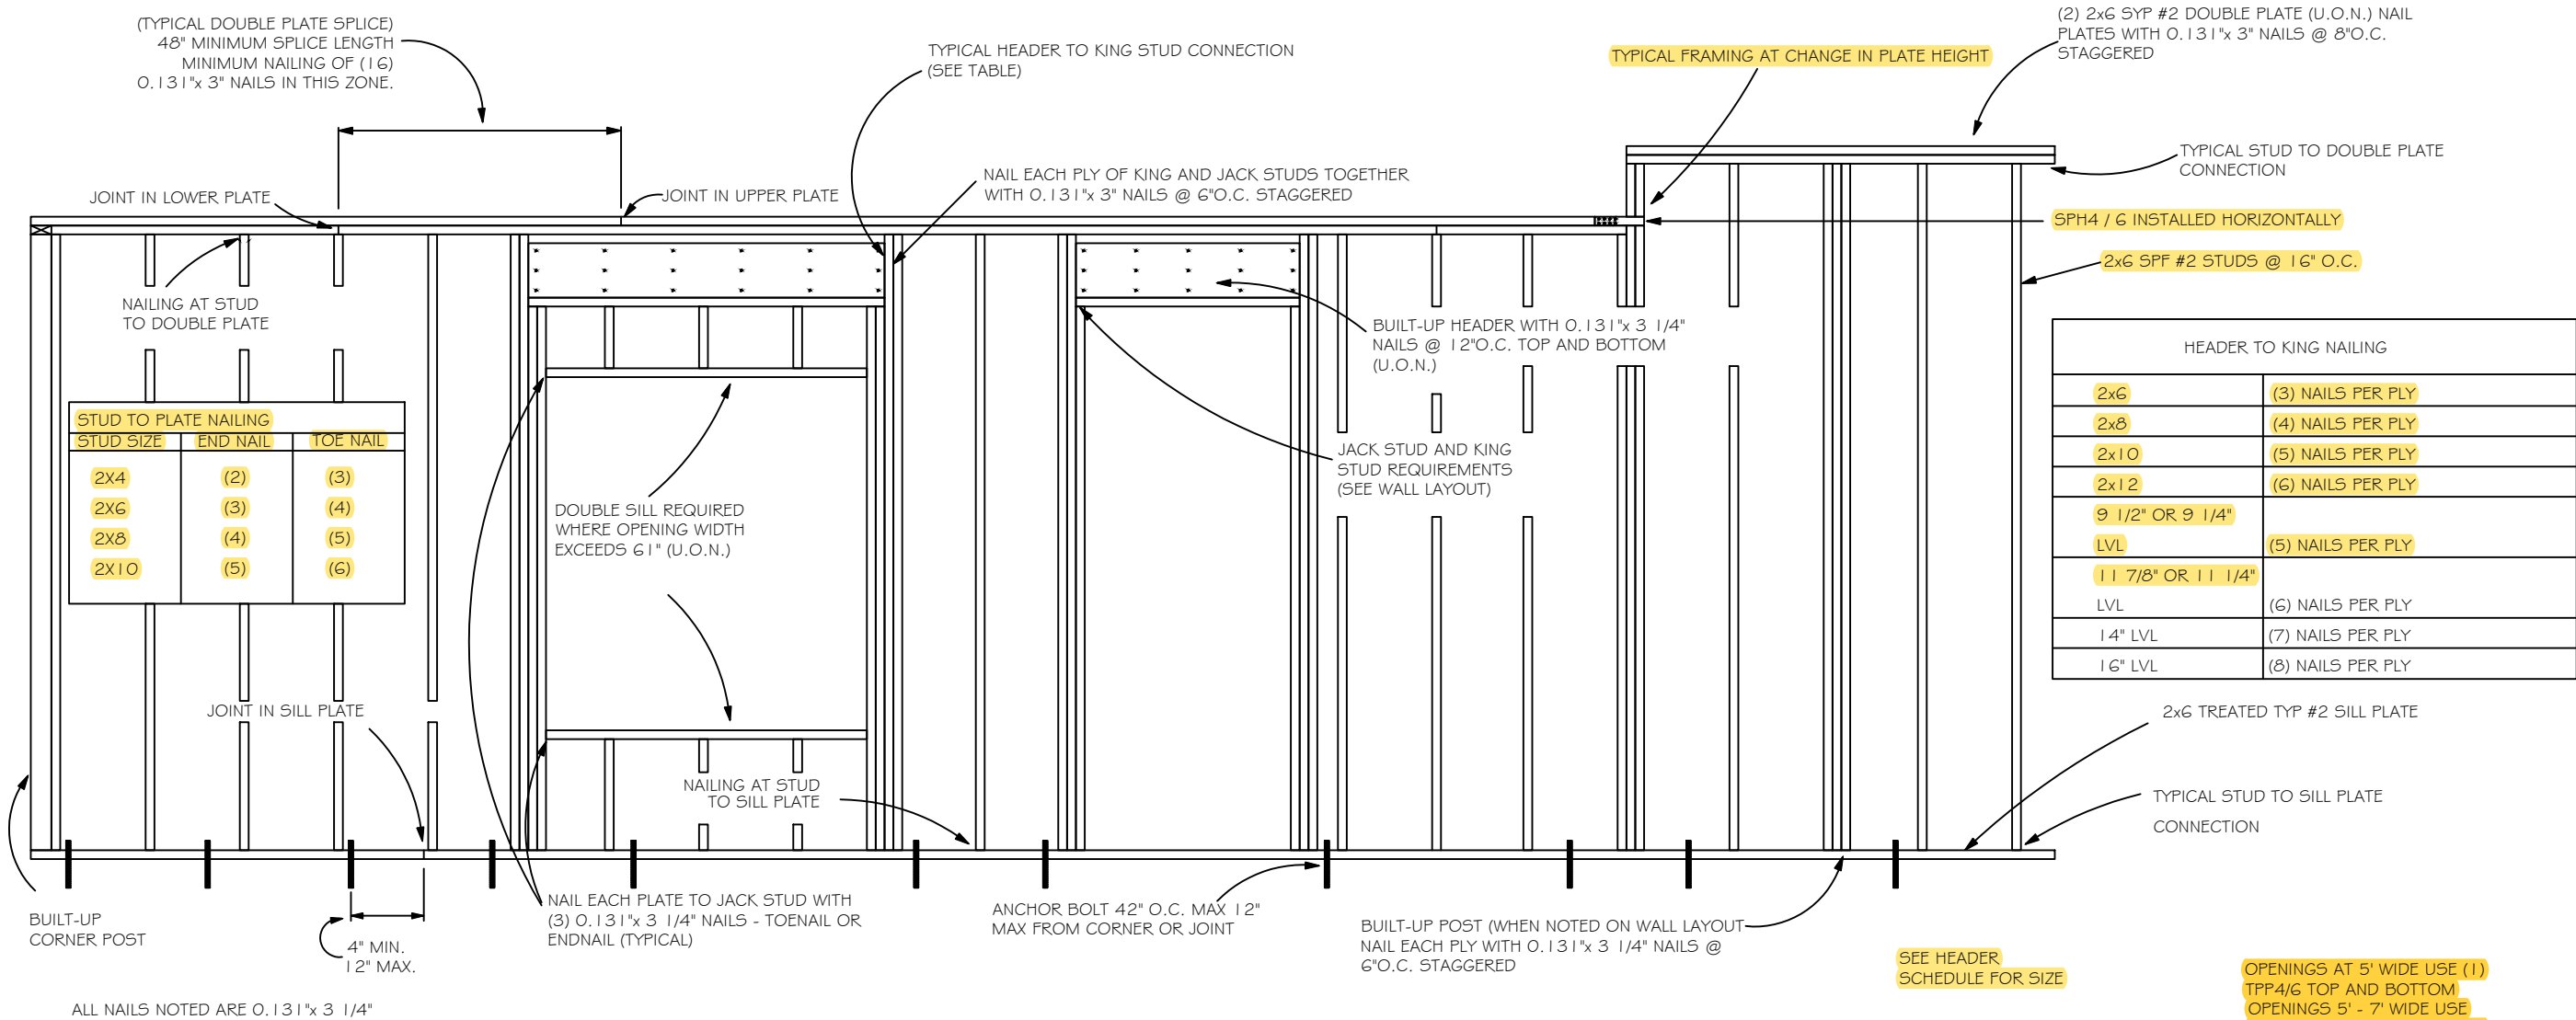

TYPICAL WALL FRAMING
NOT TO SCALE

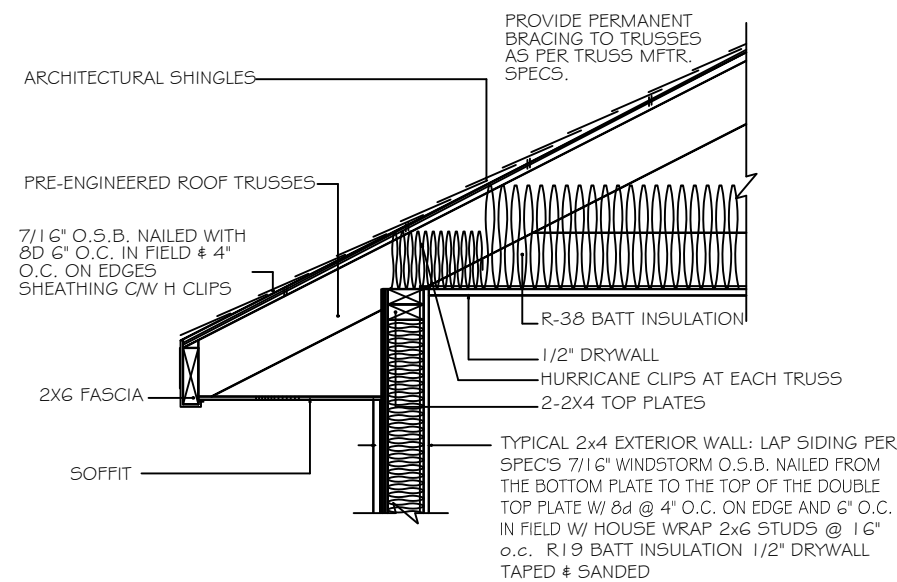

4" STUD EAVE



HEADER SCHEDULE		
2X STUD CONTINUOUS TO TOP PLATE		
HEADER - CONTINUOUS		
2 - 2X STUDS UNDER LINTELS WITH OPENINGS LARGER THEN 5'-0"		
OPENING WIDTH	BEARING OR SHEAR WALL	NON-BEARING WALLS
0'-0" TO 3'-0"	2 - 2 X 6's	2 - 2 x 4's
3'-1" TO 5'-0"	2 - 2 x 10's	2 - 2 x 6's
5'-1" TO 7'-0"	2 - 2 x 10's	2 - 2 x 8's
7'-1" TO 10'-0"	2 - 2 x 10's	2 - 2 x 10's

NOTE:
UPLIFT CONNECTION IS REQUIRED AT EACH END OF HEADER AND AT BOTTOM OF HEADER STUDS IN ADDITION TO CONNECTORS AT WALL STUDS AND AT TOP AND BOTTOM OF CRIPPLES

MAXIMUM HEADER SPAN					
3'	6'	9'	12'	15'	18'

NUMBER OF HEADER STUDS (JACKS) SUPPORTING END OF HEADER					
1	1	2	2	2	2

NUMBER OF FULL LENGTH STUDS (KINGS) AT END OF HEADER		2
--	--	---

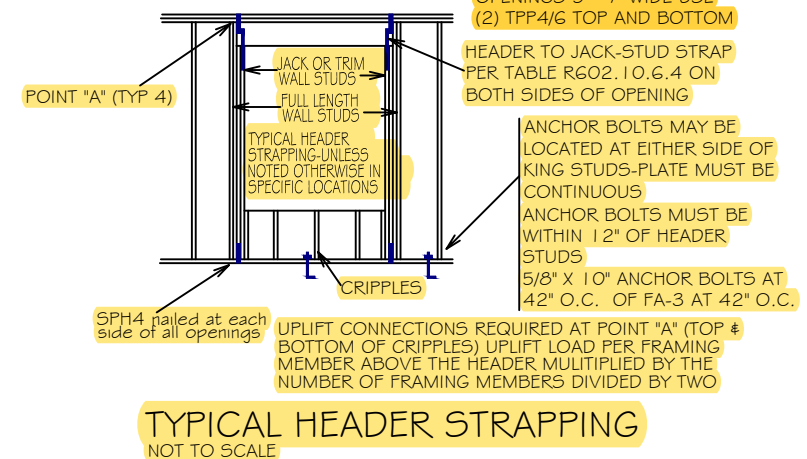

REVISION	DESCRIPTION	DATE

PREPARED FOR
HALEY & THOMAS HOLMES
haleyholmes75@yahoo.com

HOLMES RESIDENCE
FRAMING DETAILS
LAKE CITY, FL

PROJECT NO. FL19126
DATE JUNE 18, 2020
REVISION DATE
SHEET S-2

