


* ALL RECEPTACLES IN THIS LAYOUT
TO BE TAMPER-PROOF RECEPTACLES *

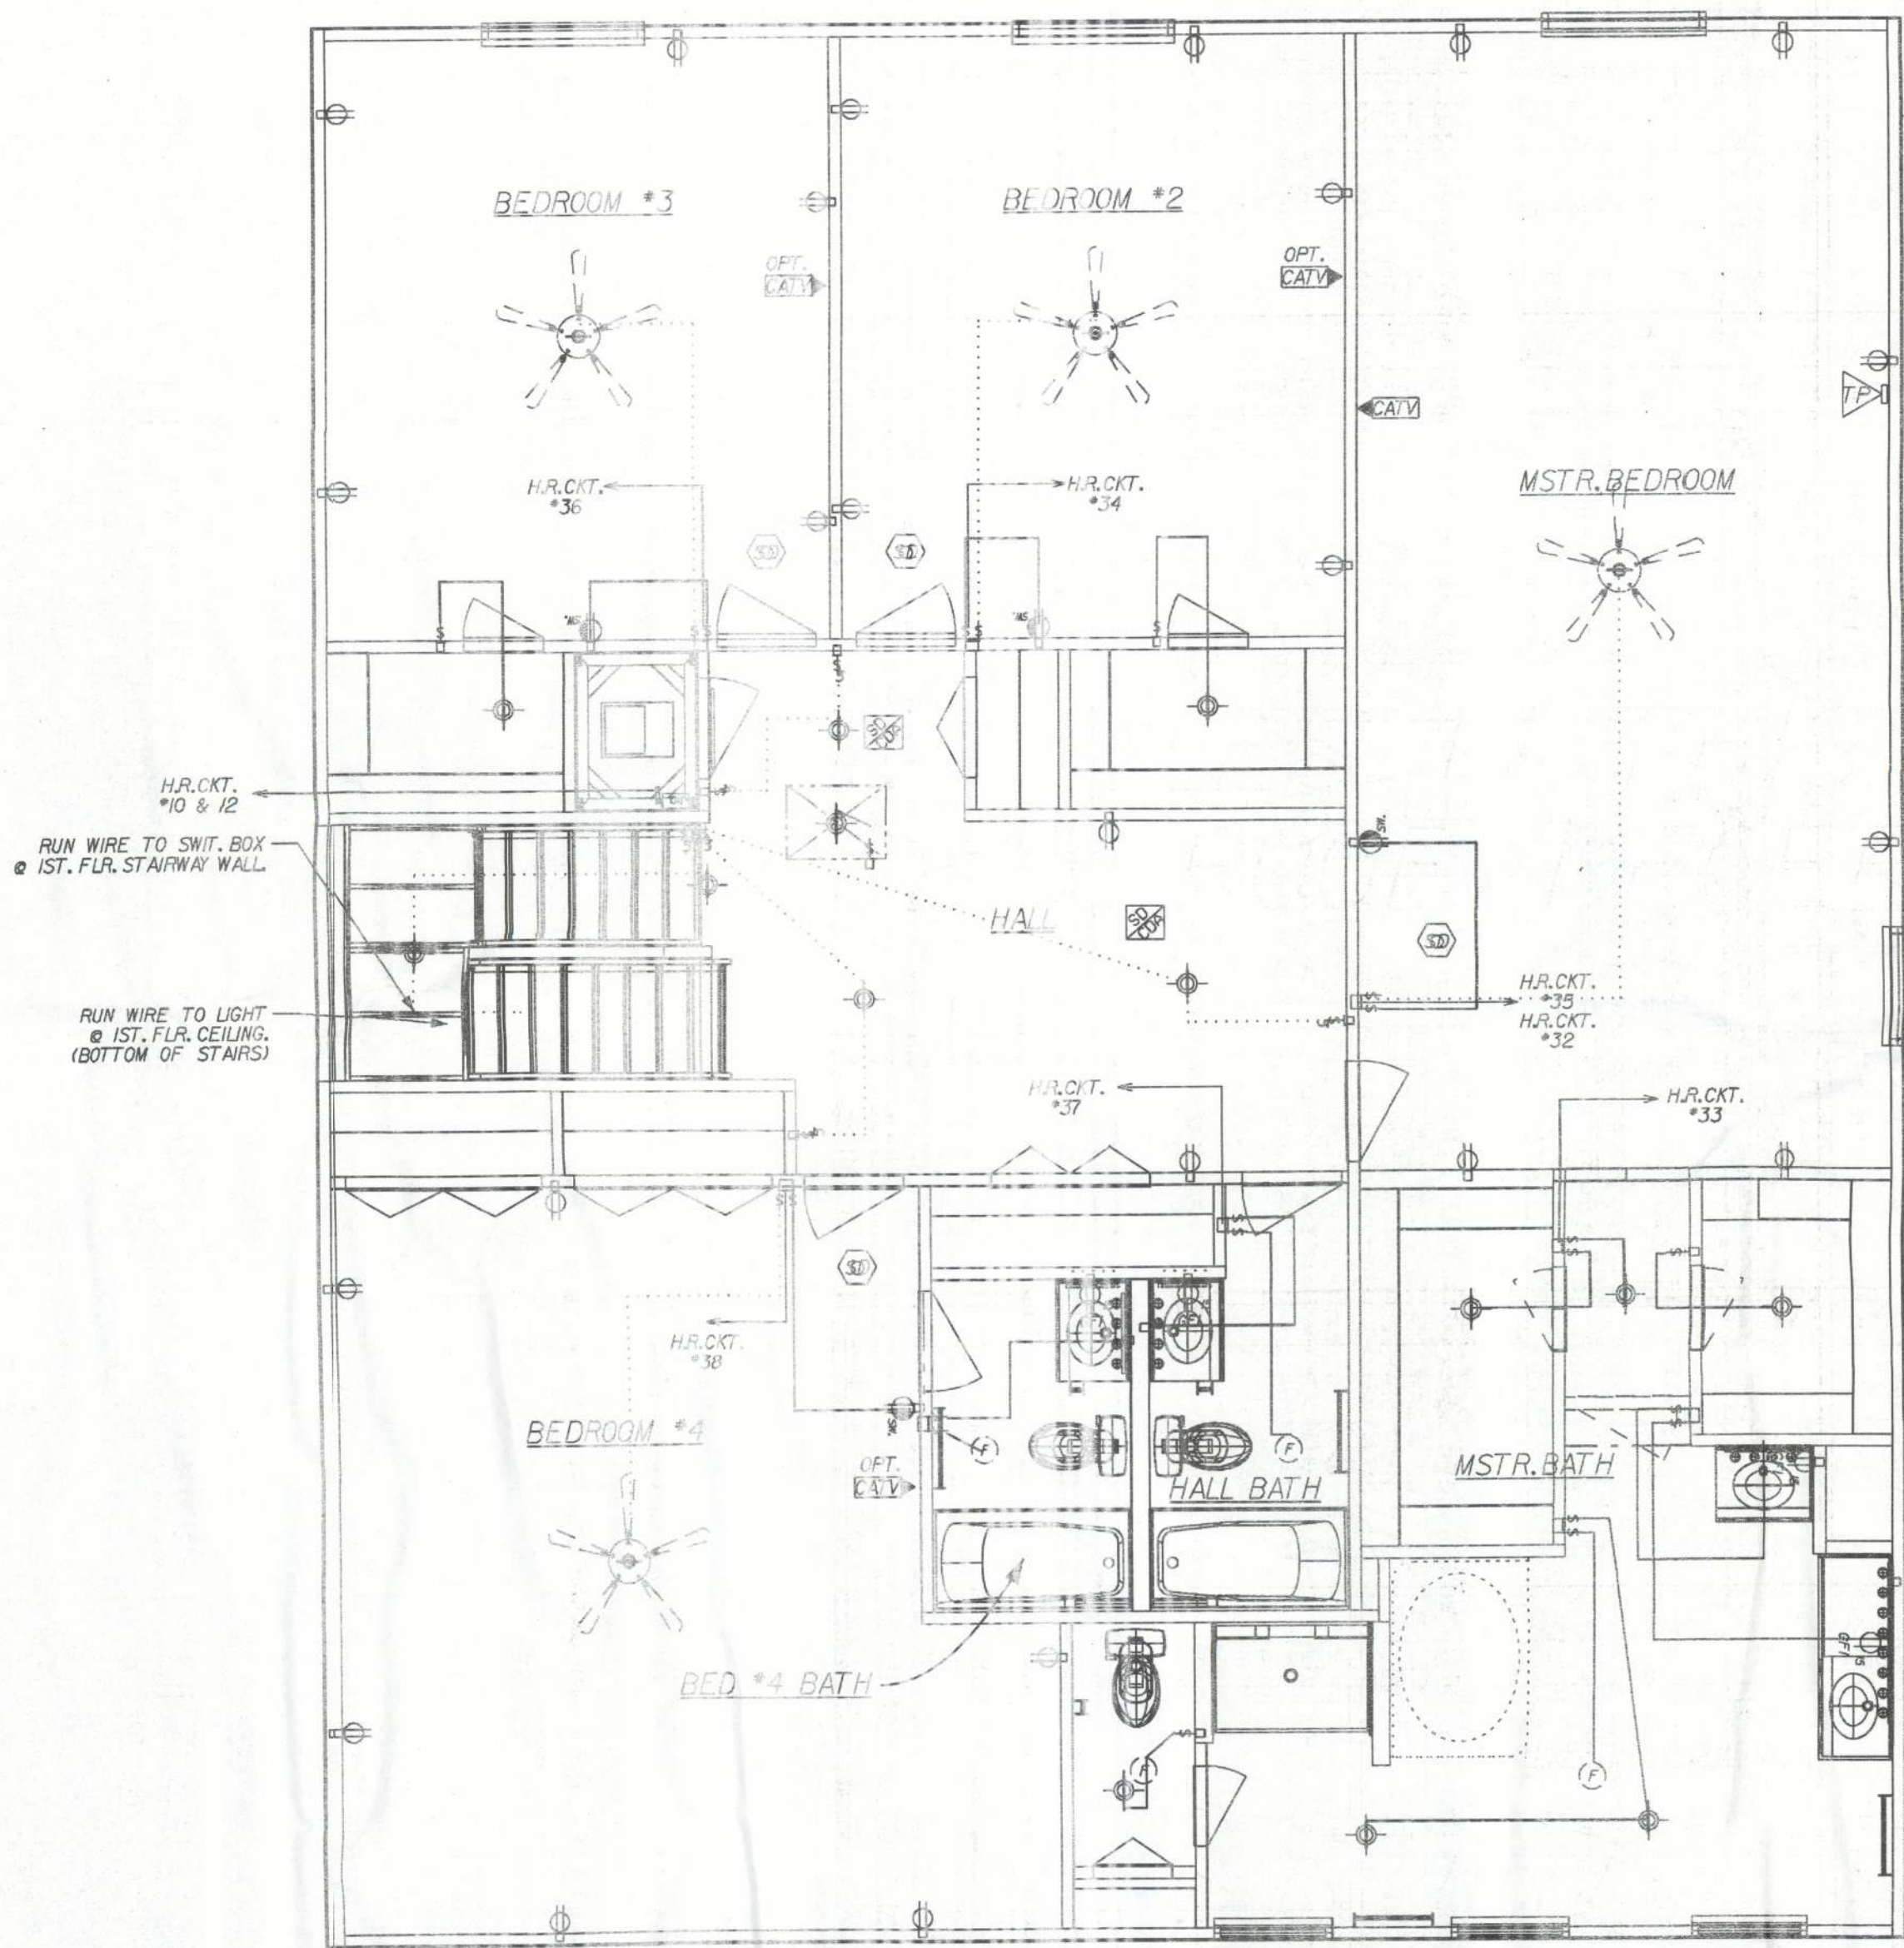

GENERAL ELECTRICAL NOTES:
CIRCUITRY IS DIAGRAMATIC ONLY. FIELD CONDITIONS MAY CHANGE. ACTUAL INSTALLATION.
PROVIDE AFC's (arc-fault circuit interrupters) IN ALL DWELLING UNIT BEDROOMS PER NEC, SECTION 210.12
SMOKE DETECTORS ARE INSTALLED PER MFG. INSTRUCTIONS AND NFPA 72. ALL DEVICES SHALL BE INTERCONNECTED WITH BATTERY BACK-UP.
FOR INSTALLATION OF GROUND ROD, SEE TYP. CONC. ENCASED ELECTRODE DETAIL SHEET * FTG

LIST OF OPTIONS:

CFA	OPTIONAL COACH LIGHTS (2) FLOOD LIGHTS AT REAR AND GARAGE OUTLET	REVISED 11-18-05
OSD	OPTIONAL DOOR LIGHT	REVISED 11-18-05

ELECTRICAL SYMBOL LEGEND:

REGULAR TEXT	REVERSE TEXT	DESCRIPTION, Graphic Symbol May Vary From Actual Fixture
[Symbol]	[Symbol]	Power Disconnect Switch
[Symbol]	[Symbol]	Door Bell Chime
[Symbol]	[Symbol]	Door Bell Buzzer
[Symbol]	[Symbol]	Ceiling Fan (By Others)
[Symbol]	[Symbol]	Smoke Detector
[Symbol]	[Symbol]	Light Fixture Bath
[Symbol]	[Symbol]	Exterior WP Lamp
[Symbol]	[Symbol]	Single Pole Switch
[Symbol]	[Symbol]	Three Way Switch
[Symbol]	[Symbol]	Single Receptacle
[Symbol]	[Symbol]	Duplex Receptacle
[Symbol]	[Symbol]	GFI Receptacle
[Symbol]	[Symbol]	Switched Receptacle
[Symbol]	[Symbol]	220 V. Special Receptacle
[Symbol]	[Symbol]	Ceiling Ltg. Fixture
[Symbol]	[Symbol]	Recessed Ltg. Fixture
[Symbol]	[Symbol]	Exhaust Fan
[Symbol]	[Symbol]	Cable TV
[Symbol]	[Symbol]	Telephone Outlet
[Symbol]	[Symbol]	Flood Lights
[Symbol]	[Symbol]	Exhaust Fan / Light Combo
[Symbol]	[Symbol]	Smoke / Carbon Monoxide Combo
[Symbol]	[Symbol]	5-Bulb Dining Chandelier
[Symbol]	[Symbol]	Breakfast Nook Opal Globe
[Symbol]	[Symbol]	Exterior Overhead Light
[Symbol]	[Symbol]	Stair Storage 18" Fluorescent or Kitchen Fluorescent Cloud

FLORIDA: THIS STRUCTURE WAS DESIGNED IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 903.0 OF THE FLORIDA BUILDING CODE, 2007. THE DESIGNER ASSUMES NO RESPONSIBILITY FOR THE RESULTS OF ANY OTHER CODES OR STANDARDS TO WHICH THIS PROJECT MAY BE SUBJECT.

DESIGNED WIND SPEED: 125 mph - 3 SEC. GUST

EXPOSURE B, ENCLOSED BUILDING, IMPORTANCE FACTOR = 1.0

REVISIONS:

DATE	DESCRIPTION
03-01-09	REV. PER 2007 FBC - RESIDENTIAL

Maronda Homes
14071 321-0664 4005 MARONDA WAY SANFORD, FLORIDA

AMERICAN 2nd. Flr. ELECTRICAL

DASHWOOD

DRAWN BY: SWE GARAGE: RIGHT

RELEASE DATE: 12-08-08

10-05-24

SHEET:

EL2

FL_GSE

PLOT DATE: 30 AUG 2011