




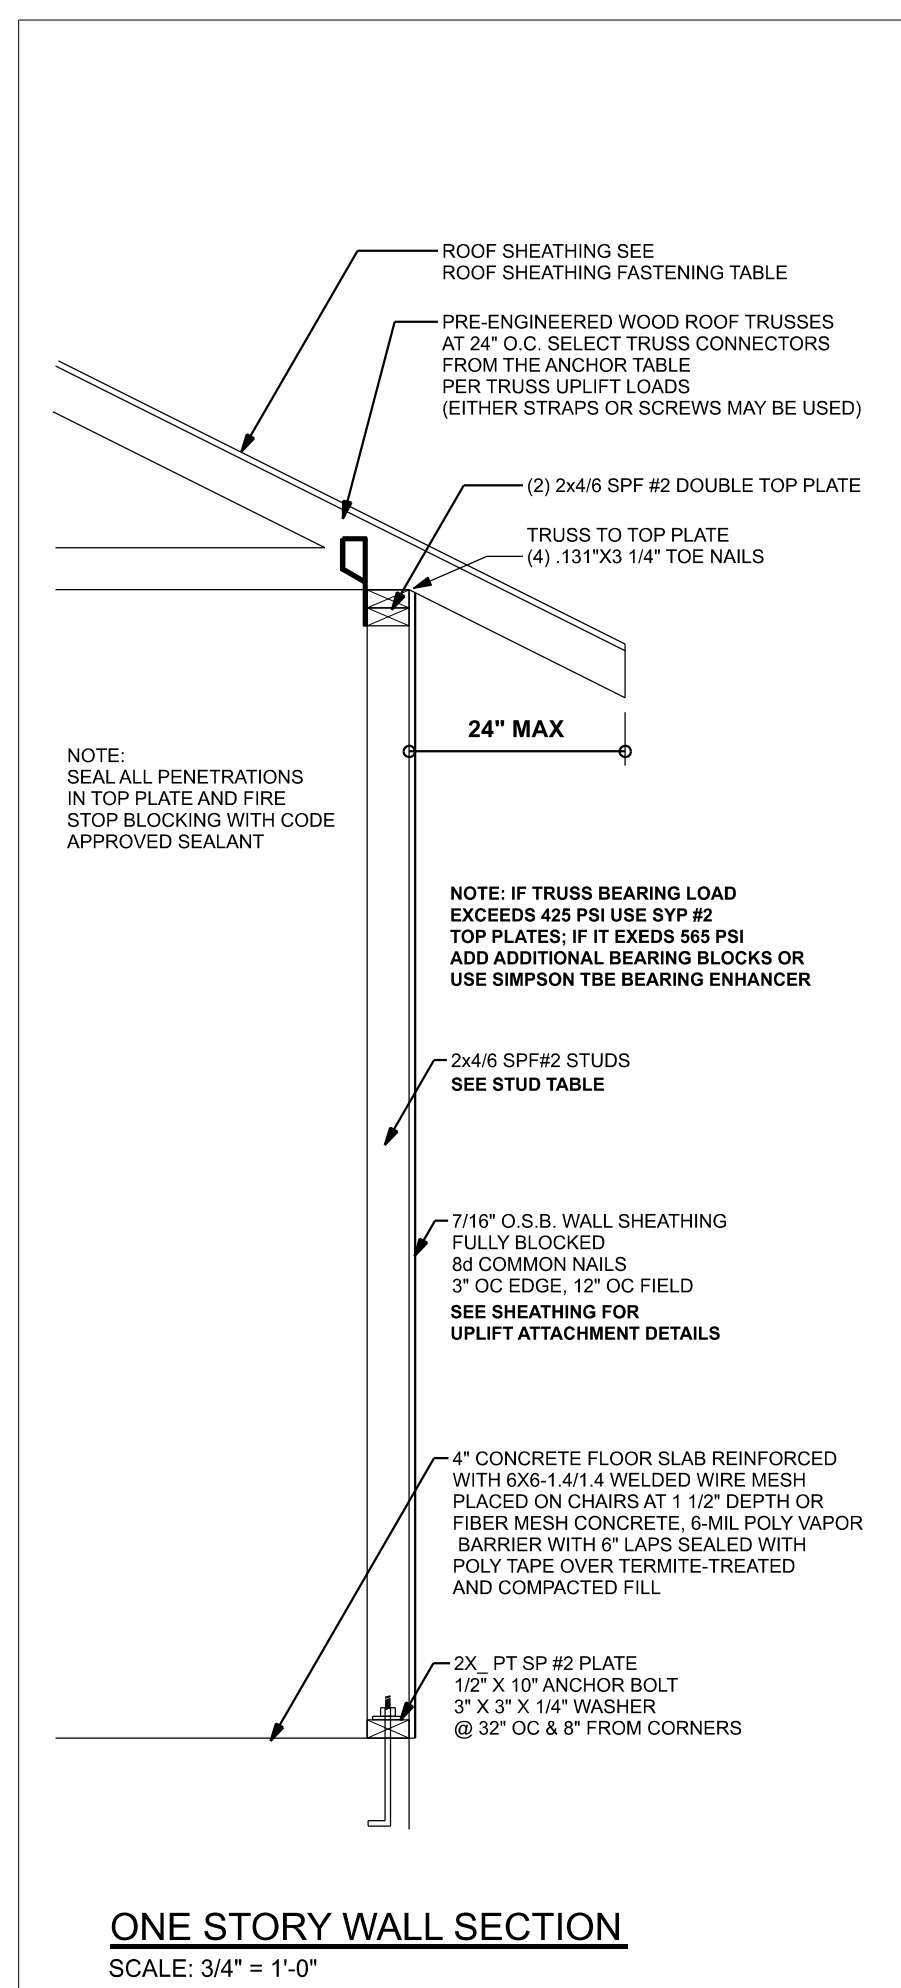

ONE STORY WALL SECTION
SCALE: 3/4" = 1'-0"

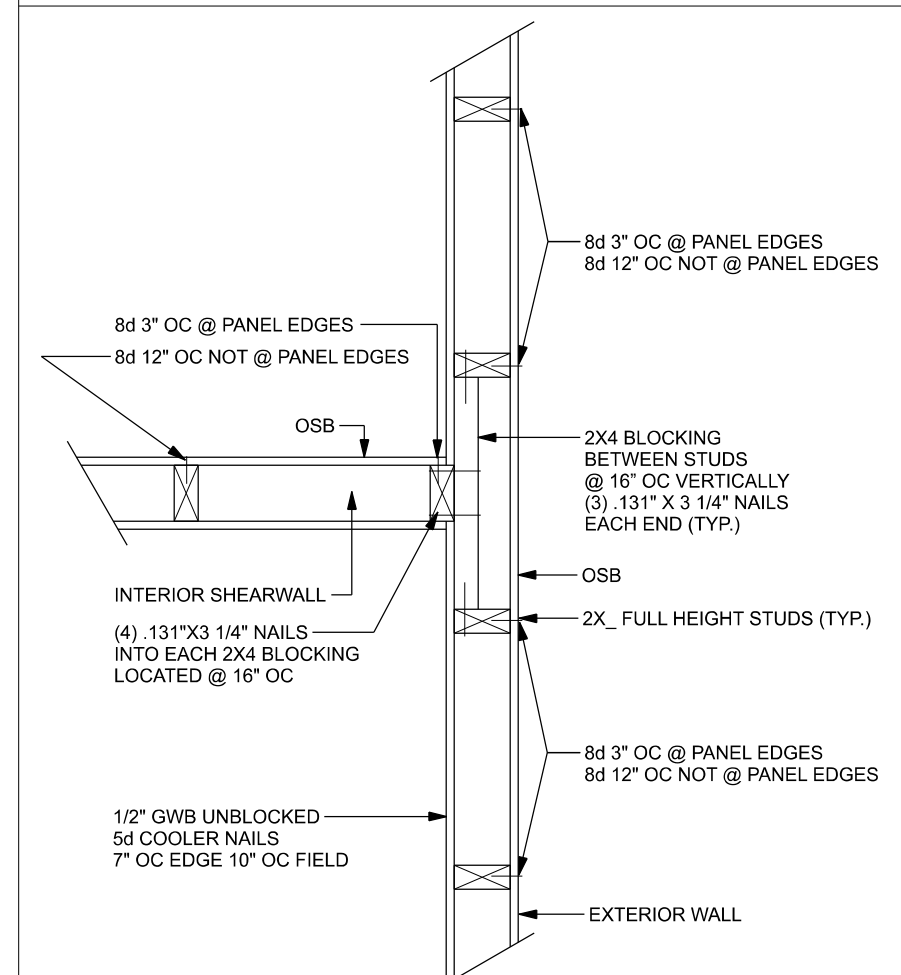

(TYP.) INTERSECTING WALL FRAMING
WOOD FRAME

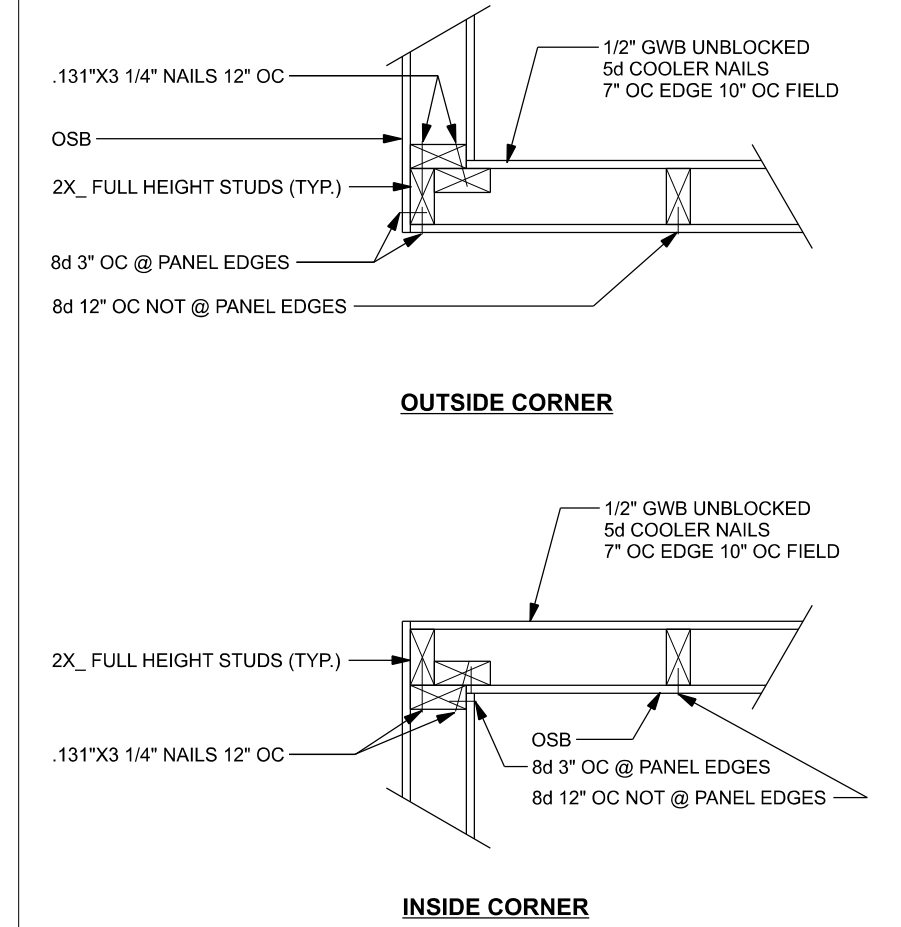


(TYP.) CORNER FRAMING
WOOD FRAME

ROOF SHEATHING FASTENING TABLE (RAFTER / TRUSS SG = 0.49)


Wind Speed	Sheathing Thickness Plywood Or OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field
120 mph Exp. B	7/16"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	12" oc
120 mph Exp. C	7/16"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	6" oc
120 mph Exp. D	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
130 mph Exp. B	7/16"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. C	15/32"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	6" oc
130 mph Exp. D	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. B	7/16"	ASTM F1667 RSR5-01 (2 3/8" x 0.131")	6" oc	6" oc
140 mph Exp. C	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
140 mph Exp. D	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. C	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	6" oc	6" oc
150 mph Exp. D	19/32"	ASTM F1667 RSR5-03 (2 1/2" x 0.131") or ASTM F1667 RSR5-04 (3" x 0.120")	4" oc	4" oc

Note: For sheathing located a minimum of 4 feet from the perimeter edge of the roof, including 4 feet on each side of ridges and hips, nail spacing is permitted to be 6 inches on center along panel edges and 6 inches on center along intermediate supports in the panel field. Note: This table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing may need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

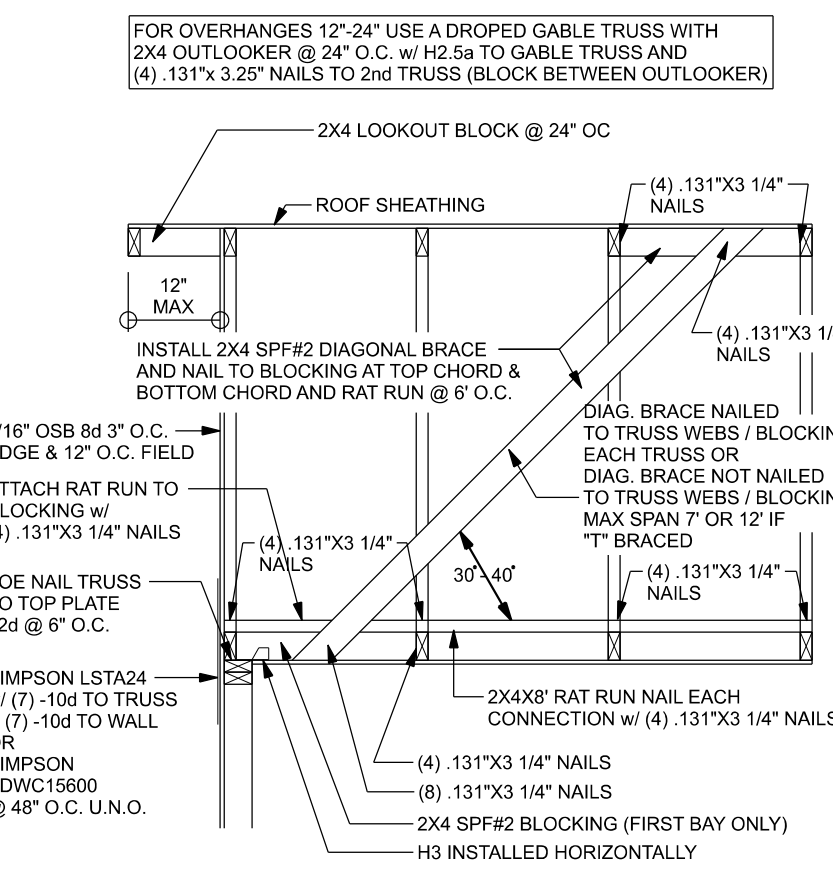


(TYP.) GABLE BRACING DETAIL
WOOD FRAME


(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

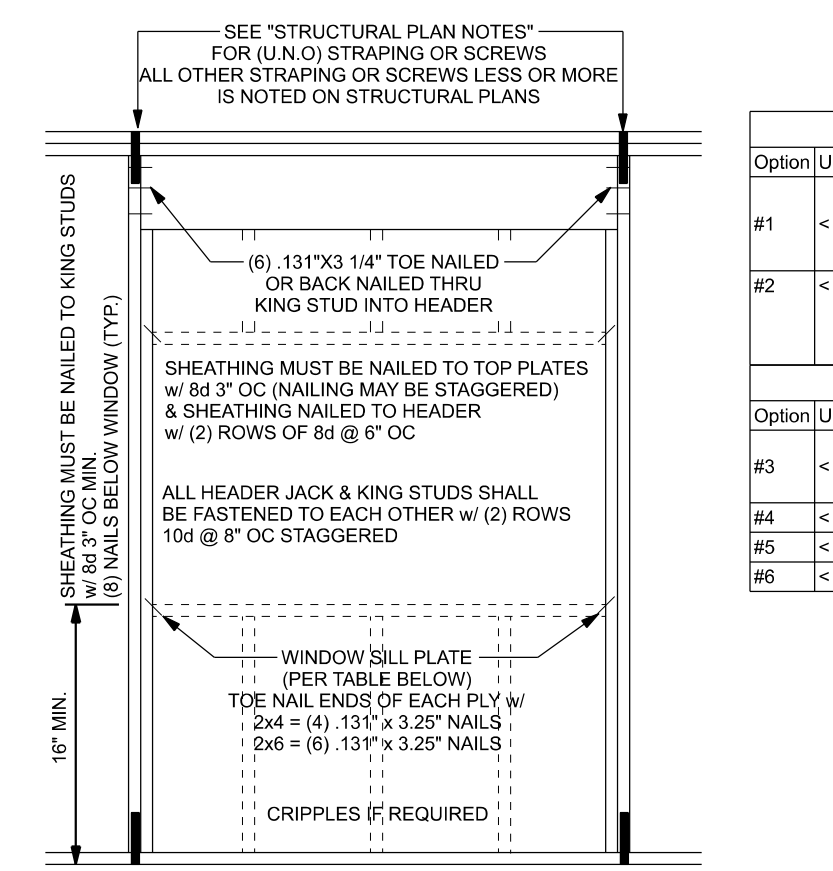


TYPICAL HEADER STRAPING OR SCREWS DETAIL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

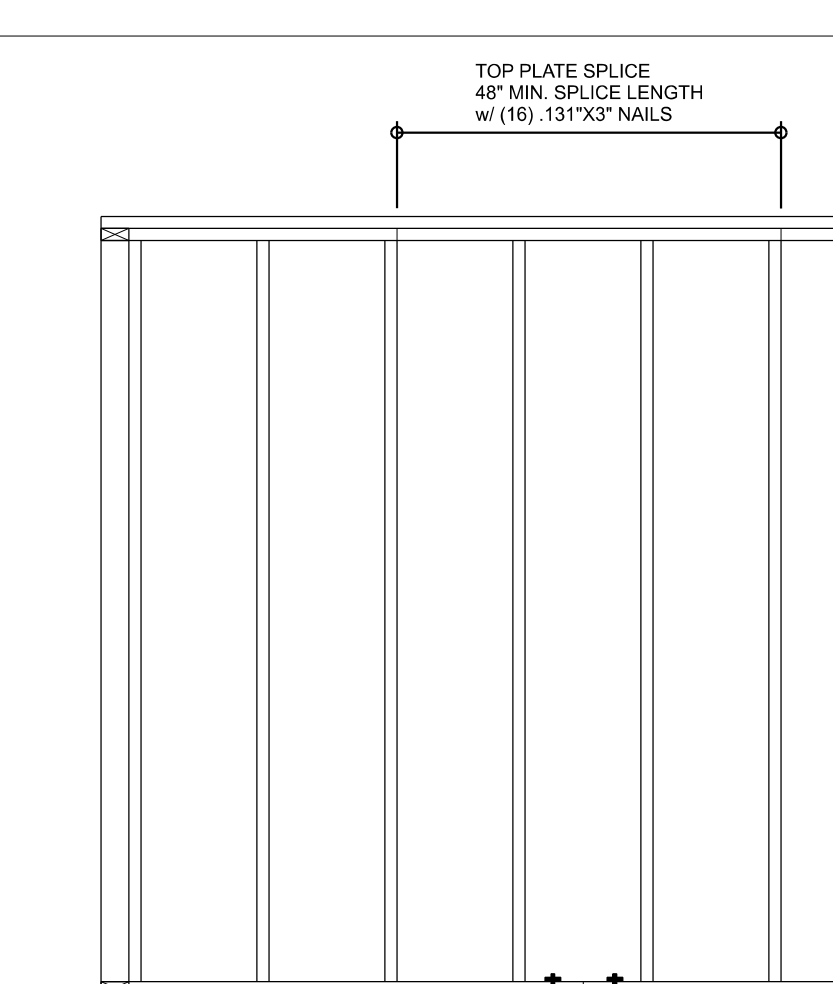

(TYP.) WALL CONNECTIONS
ONE STORY WOOD FRAME

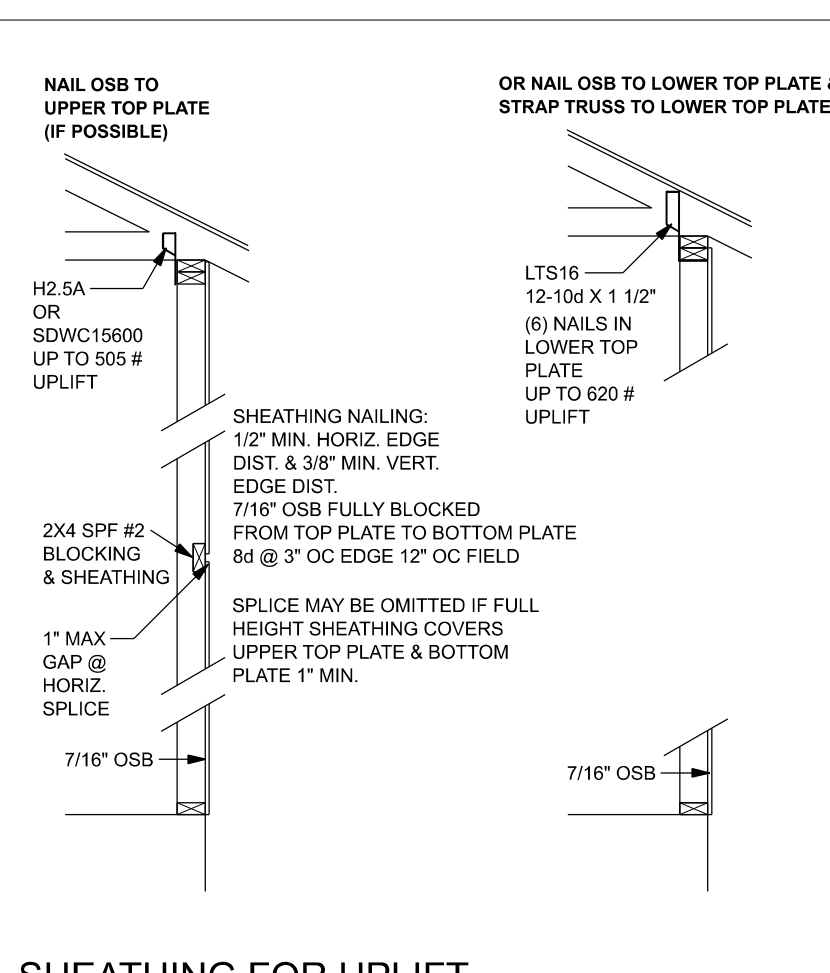

SHEATHING FOR UPLIFT ATTACHMENT DETAILS
ONE STORY WOOD FRAME

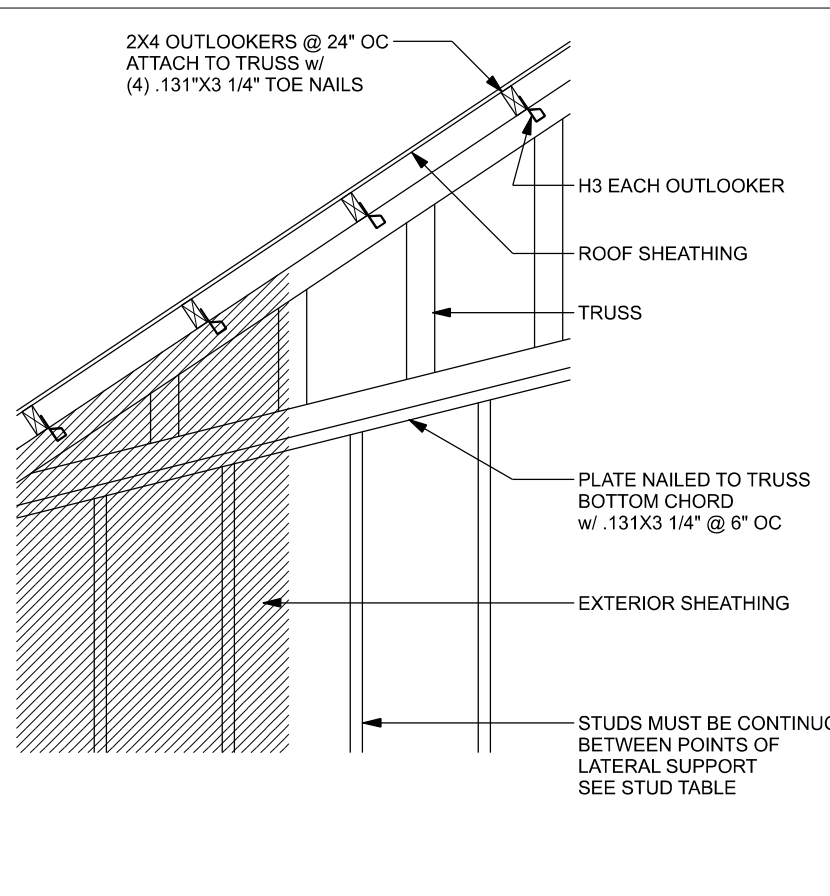

(TYP.) PORCH POST
ONE STORY WOOD

HEADER SCREWS TABLE

Option	Uplift	Top Connection	Bottom Connection
#1	< 510	Attach king stud to top plate w/ (1) Simpson SDWC15600	Attach king stud to bottom plate w/ (2) Simpson SDWC15450
#2	< 895	Attach king stud to top plate w/ (2) Simpson SDWC15600	Attach king stud to bottom plate w/ (3) Simpson SDWC15450

HEADER STRAP TABLE


Option	Uplift	Top Connection	Bottom Connection
#3	< 1235	LSTA24, 14-10d wrap over plate	LSTA24, 14-10d wrap under plate
#4	< 1455	MSTA24, 18-10d header to jacks	1/2" x 10" Anchor bolt w/ 3" x 3" x 1/4" washer must be located within 6" of king stud @ all door locations
#5	< 1800	(2) MSTA24, 18-10d header to jacks	DTT22
#6	< 2910	(2) MSTA24, 18-10d header to jacks	HTT4

SILL PLATE SPANS FOR 10'-0" WALL HEIGHT

DESIGN WIND SPEED	(1) 2x4	(2) 2x4	(1) 2x6	(2) 2x6
130 MPH EXP. C	5'-2"	7'-9"	7'-7"	11'-3"

BASED ON WFCM TABLE A3.3.288
FOR OTHER WALL HEIGHTS (H) SILL SPAN SHALL BE DIVIDED BY (H/10)

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

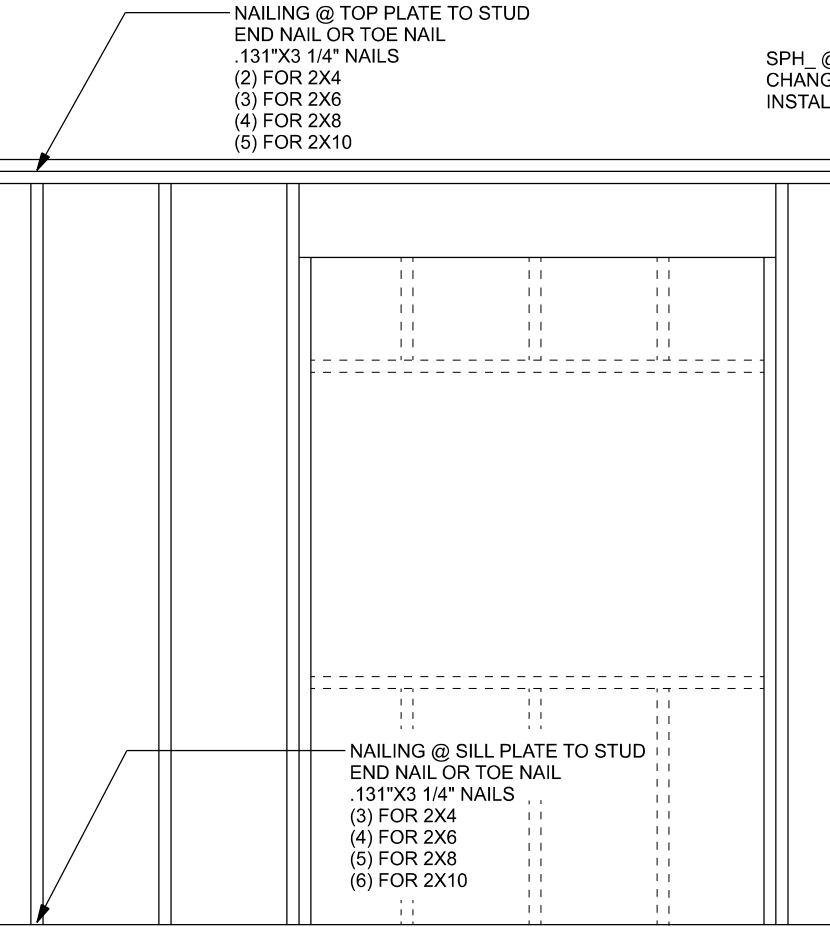


(TYP.) BEAM TO WALL
WOOD FRAME


CONNECTOR TABLE

Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter
805	505	SDWC15600	-	-
415	290	H3	4-8x1 1/2"	4-8x1 1/2"
615	540	H2.5A	5-8x1 1/2"	5-8x1 1/2"
1340	1015	H10A	9-10d1 1/2"	9-10d1 1/2"
720	620	LTS12-20	6-10d1 1/2"	6-10d1 1/2"
1000	860	MTS12-30	7-10d1 1/2"	7-10d1 1/2"
1450	1245	HTS20-30	12-10d1 1/2"	12-10d1 1/2"
Uplift SP	Uplift SPF	Strap Ties	To One Member	To Other Member
1235	1235	LSTA21	8-10d	8-10d
1640	1455	MSTA24	9-10d	9-10d
1030	1030	CS20	7-10d	7-10d
Uplift SP	Uplift SPF	Stud Plate Ties	To Stud	To Plate
585	535	SP1	6-10d	4-10d
1065	905	SP2	6-10d	6-10d
771	771	LSTA24	10-10d	wrap under or over plate
1235	1235	LSTA24	14-10d	wrap under or over plate
Uplift SP	Uplift SPF	Holdowns @ Stewall	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235	3640	HTT4	18-16x12 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Holdowns @ Mono	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x6" Titen HD
4235	3640	HTT4	18-16x12 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Post Bases @ Stewall	To Post	Anchor
1900	ABU4Z	12-16d	5/8"x12" Drill & Epoxy	
2475	ABU6Z	12-16d	5/8"x12" Drill & Epoxy	
Uplift SP	Uplift SPF	Post Bases @ Mono	To Post	Anchor
1900	ABU4Z	12-16d	5/8"x12" Drill & Epoxy	
2475	ABU6Z	12-16d	5/8"x12" Drill & Epoxy	


(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

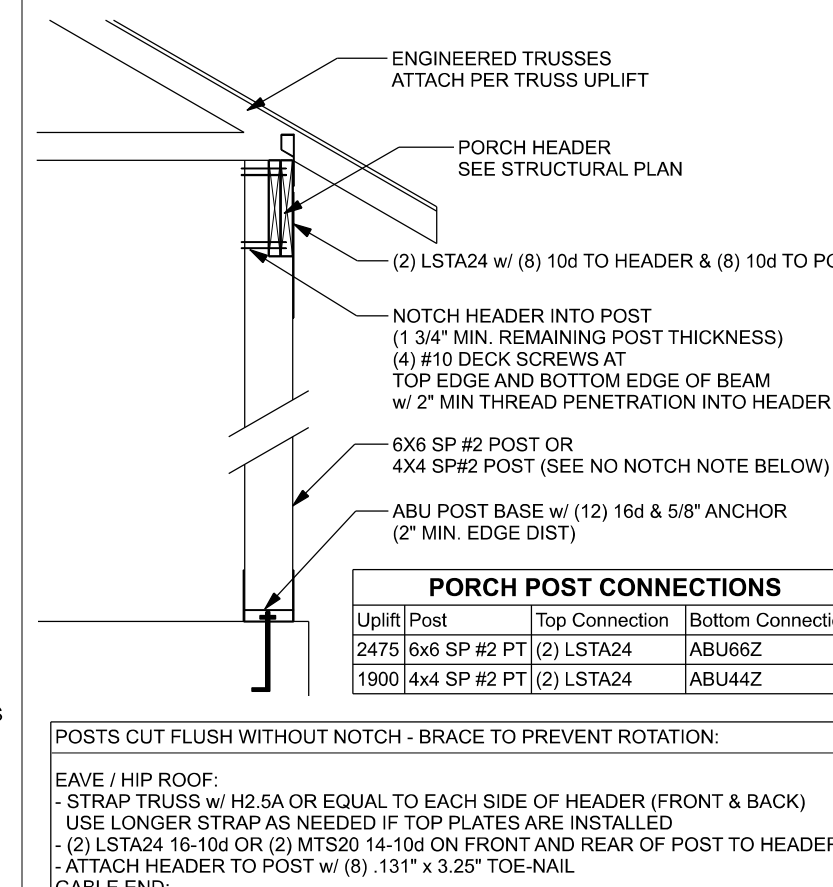

(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS

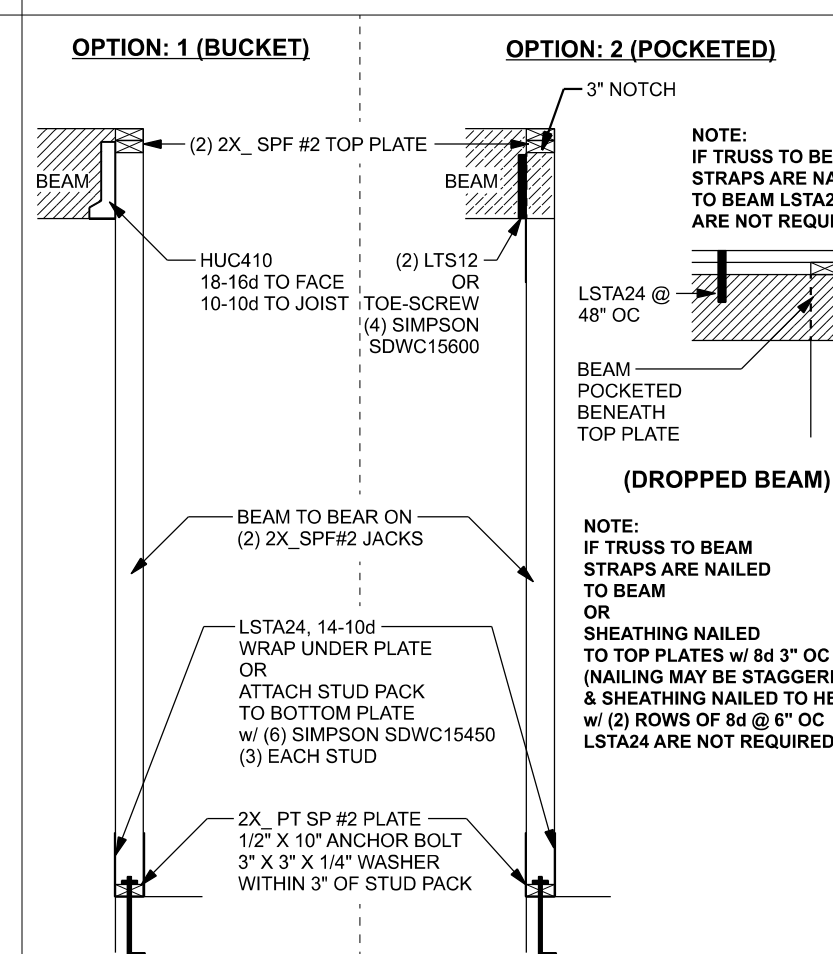

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

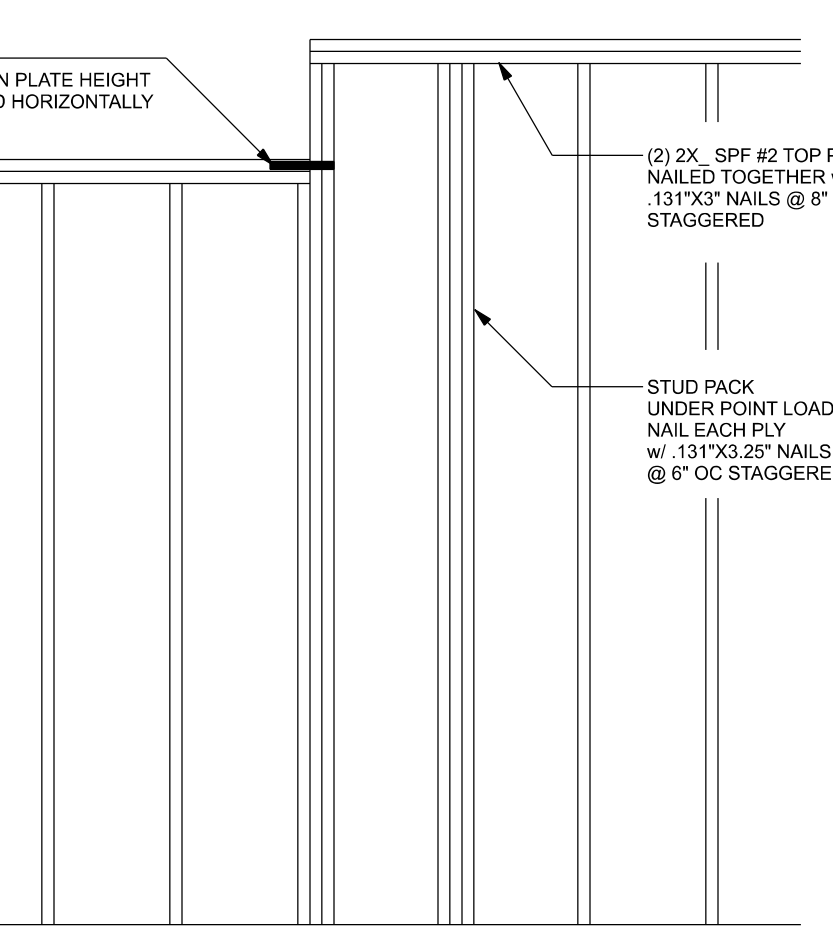


(TYP.) BEAM TO WALL
WOOD FRAME

CONNECTOR TABLE


Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter
805	505	SDWC15600	-	-
415	290	H3	4-8x1 1/2"	4-8x1 1/2"
615	540	H2.5A	5-8x1 1/2"	5-8x1 1/2"
1340	1015	H10A	9-10d1 1/2"	9-10d1 1/2"
720	620	LTS12-20	6-10d1 1/2"	6-10d1 1/2"
1000	860	MTS12-30	7-10d1 1/2"	7-10d1 1/2"
1450	1245	HTS20-30	12-10d1 1/2"	12-10d1 1/2"
Uplift SP	Uplift SPF	Strap Ties	To One Member	To Other Member
1235	1235	LSTA21	8-10d	8-10d
1640	1455	MSTA24	9-10d	9-10d
1030	1030	CS20	7-10d	7-10d
Uplift SP	Uplift SPF	Stud Plate Ties	To Stud	To Plate
585	535	SP1	6-10d	4-10d
1065	905	SP2	6-10d	6-10d
771	771	LSTA24	10-10d	wrap under or over plate
1235	1235	LSTA24	14-10d	wrap under or over plate
Uplift SP	Uplift SPF	Holdowns @ Stewall	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD
4235	3640	HTT4	18-16x12 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Holdowns @ Mono	To Stud / Post	Anchor
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x6" Titen HD
4235	3640	HTT4	18-16x12 1/2"	1/2"x12" Titen HD
Uplift SP	Uplift SPF	Post Bases @ Stewall	To Post	Anchor
1900	ABU4Z	12-16d	5/8"x12" Drill & Epoxy	
2475	ABU6Z	12-16d	5/8"x12" Drill & Epoxy	
Uplift SP	Uplift SPF	Post Bases @ Mono	To Post	Anchor
1900	ABU4Z	12-16d	5/8"x12" Drill & Epoxy	
2475	ABU6Z	12-16d	5/8"x12" Drill & Epoxy	

(TYP.) GIRDER TRUSS HOLD DOWN DETAIL
WOOD FRAME w/ STRAPS & ANCHORS



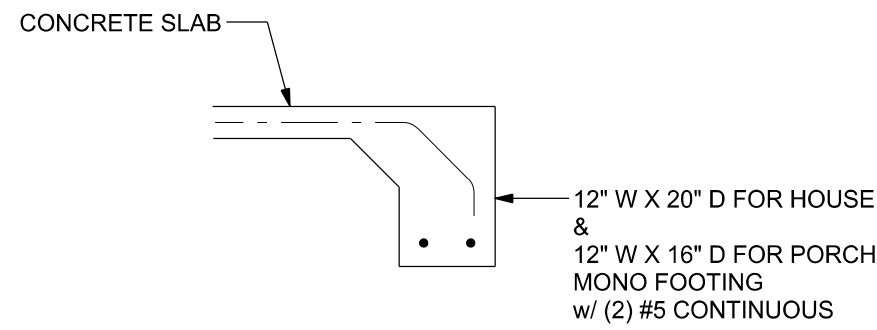

F1 S-2 MONOLITHIC FOOTING
SCALE: 1/2" = 1'-0"

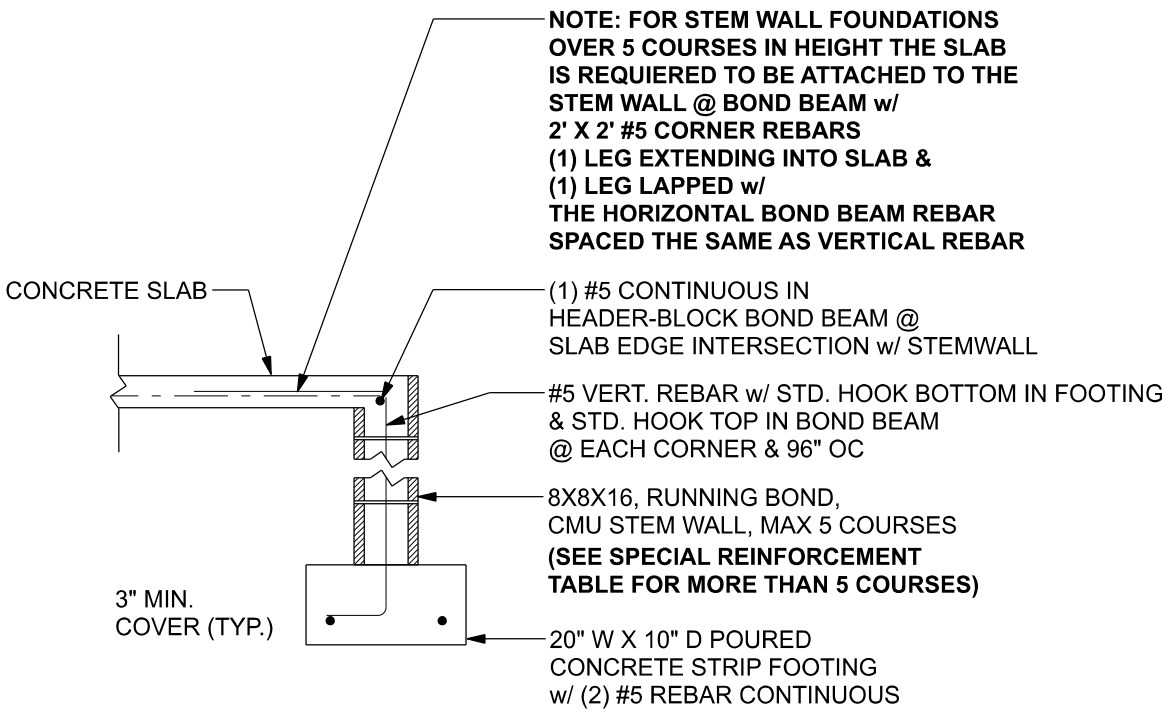


F1 S-2 STEM WALL FOOTING
SCALE: 1/2" = 1'-0"

TALL STEM WALL TABLE:							
The table assumes 40 ksi for #5 rebar and 60 ksi for #7 & #8 rebar with 6" hook in the footing and bent 24" into the reinforced slab at the top. The vertical steel is to be placed toward the tension side of the CMU wall (away from the soil pressure, within 2" of the exterior side of the wall). If the wall is over 8' high, add Durowall ladder reinforcement at 16" OC vertically or a horizontal bond beam with #5 continuous at mid height. For higher parts of the wall 12" CMU may be used with reinforcement as shown in the table below.							
STEMWALL HEIGHT (FEET)	UNBALANCED BACKFILL HEIGHT	VERTICAL REINFORCEMENT FOR 6" CMU STEMWALL (INCHES O.C.)			VERTICAL REINFORCEMENT FOR 12" CMU STEMWALL (INCHES O.C.)		
		#5	#7	#8	#5	#7	#8
3.3	3.0	96	96	96	96	96	96
4.0	3.7	96	96	96	96	96	96
4.7	4.3	88	96	96	96	96	96
5.3	5.0	56	96	96	96	96	96
6.0	5.7	40	80	96	80	96	96
6.7	6.3	32	56	80	56	96	96
7.3	7.0	24	40	56	40	80	96
8.0	7.7	16	32	48	32	64	80
8.7	8.3	8	24	32	24	48	64
9.3	9.0	8	16	24	16	40	48

MASONRY NOTE:
MASONRY CONSTRUCTION AND MATERIALS FOR THIS PROJECT SHALL CONFORM TO ALL REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES" (ACI 530.1/ASCE 6/TMS 602). THE CONTRACTOR AND MASON MUST IMMEDIATELY, BEFORE PROCEEDING, NOTIFY THE ENGINEER OF ANY CONFLICTS BETWEEN ACI 530.1-02 AND THESE DESIGN DRAWINGS. ANY EXCEPTIONS TO ACI 530.1-02 MUST BE APPROVED BY THE ENGINEER IN WRITING.

ACI 530.1-02 Section	Specific Requirements
1.4A Compressive strength	6" block bearing walls F'm = 1500 psi
2.1 Mortar	ASTM C 270, Type N, UNO
2.2 Grout	ASTM C 476, admixtures require approval
2.3 CMU standard	ASTM C 90-02, Normal weight, hollow, medium surface finish, 8"x8"x16" running bond and 12"x12" or 16"x16" column block
2.3 Clay brick standard	ASTM C 216-02, Grade SW, Type FBS, 5.5"x2.75"x11.5"
2.4 Reinforcing bars, #3 - #11	ASTM A 615, Grade 40, F_y = 40 ksi, Lap splices min 40 bar dia. (25" for #5)
2.4F Coating for corrosion protection	Anchors, sheet metal ties completely embedded in mortar or grout, ASTM A 252, Class G60, 0.60 oz/lb or 304SS
2.4F Coating for corrosion protection	Joint reinforcement in walls exposed to moisture or wire ties, anchors, sheet metal ties not completely embedded in mortar or grout, ASTM A 153, Class B2, 1.50 oz/lb or 304SS
3.3.E.2 Pipes, conduits, and accessories	Any not shown on the project drawings require engineering approval.
3.3.E.7 Movement joints	Contractor assumes responsibility for type and location of movement joints if not detailed on project drawings.

BOTTOM OF EXTERIOR FOOTINGS SHALL BE A MINIMUM OF 12" BELOW UNDISTURBED SOIL OR ENGINEERED FILL

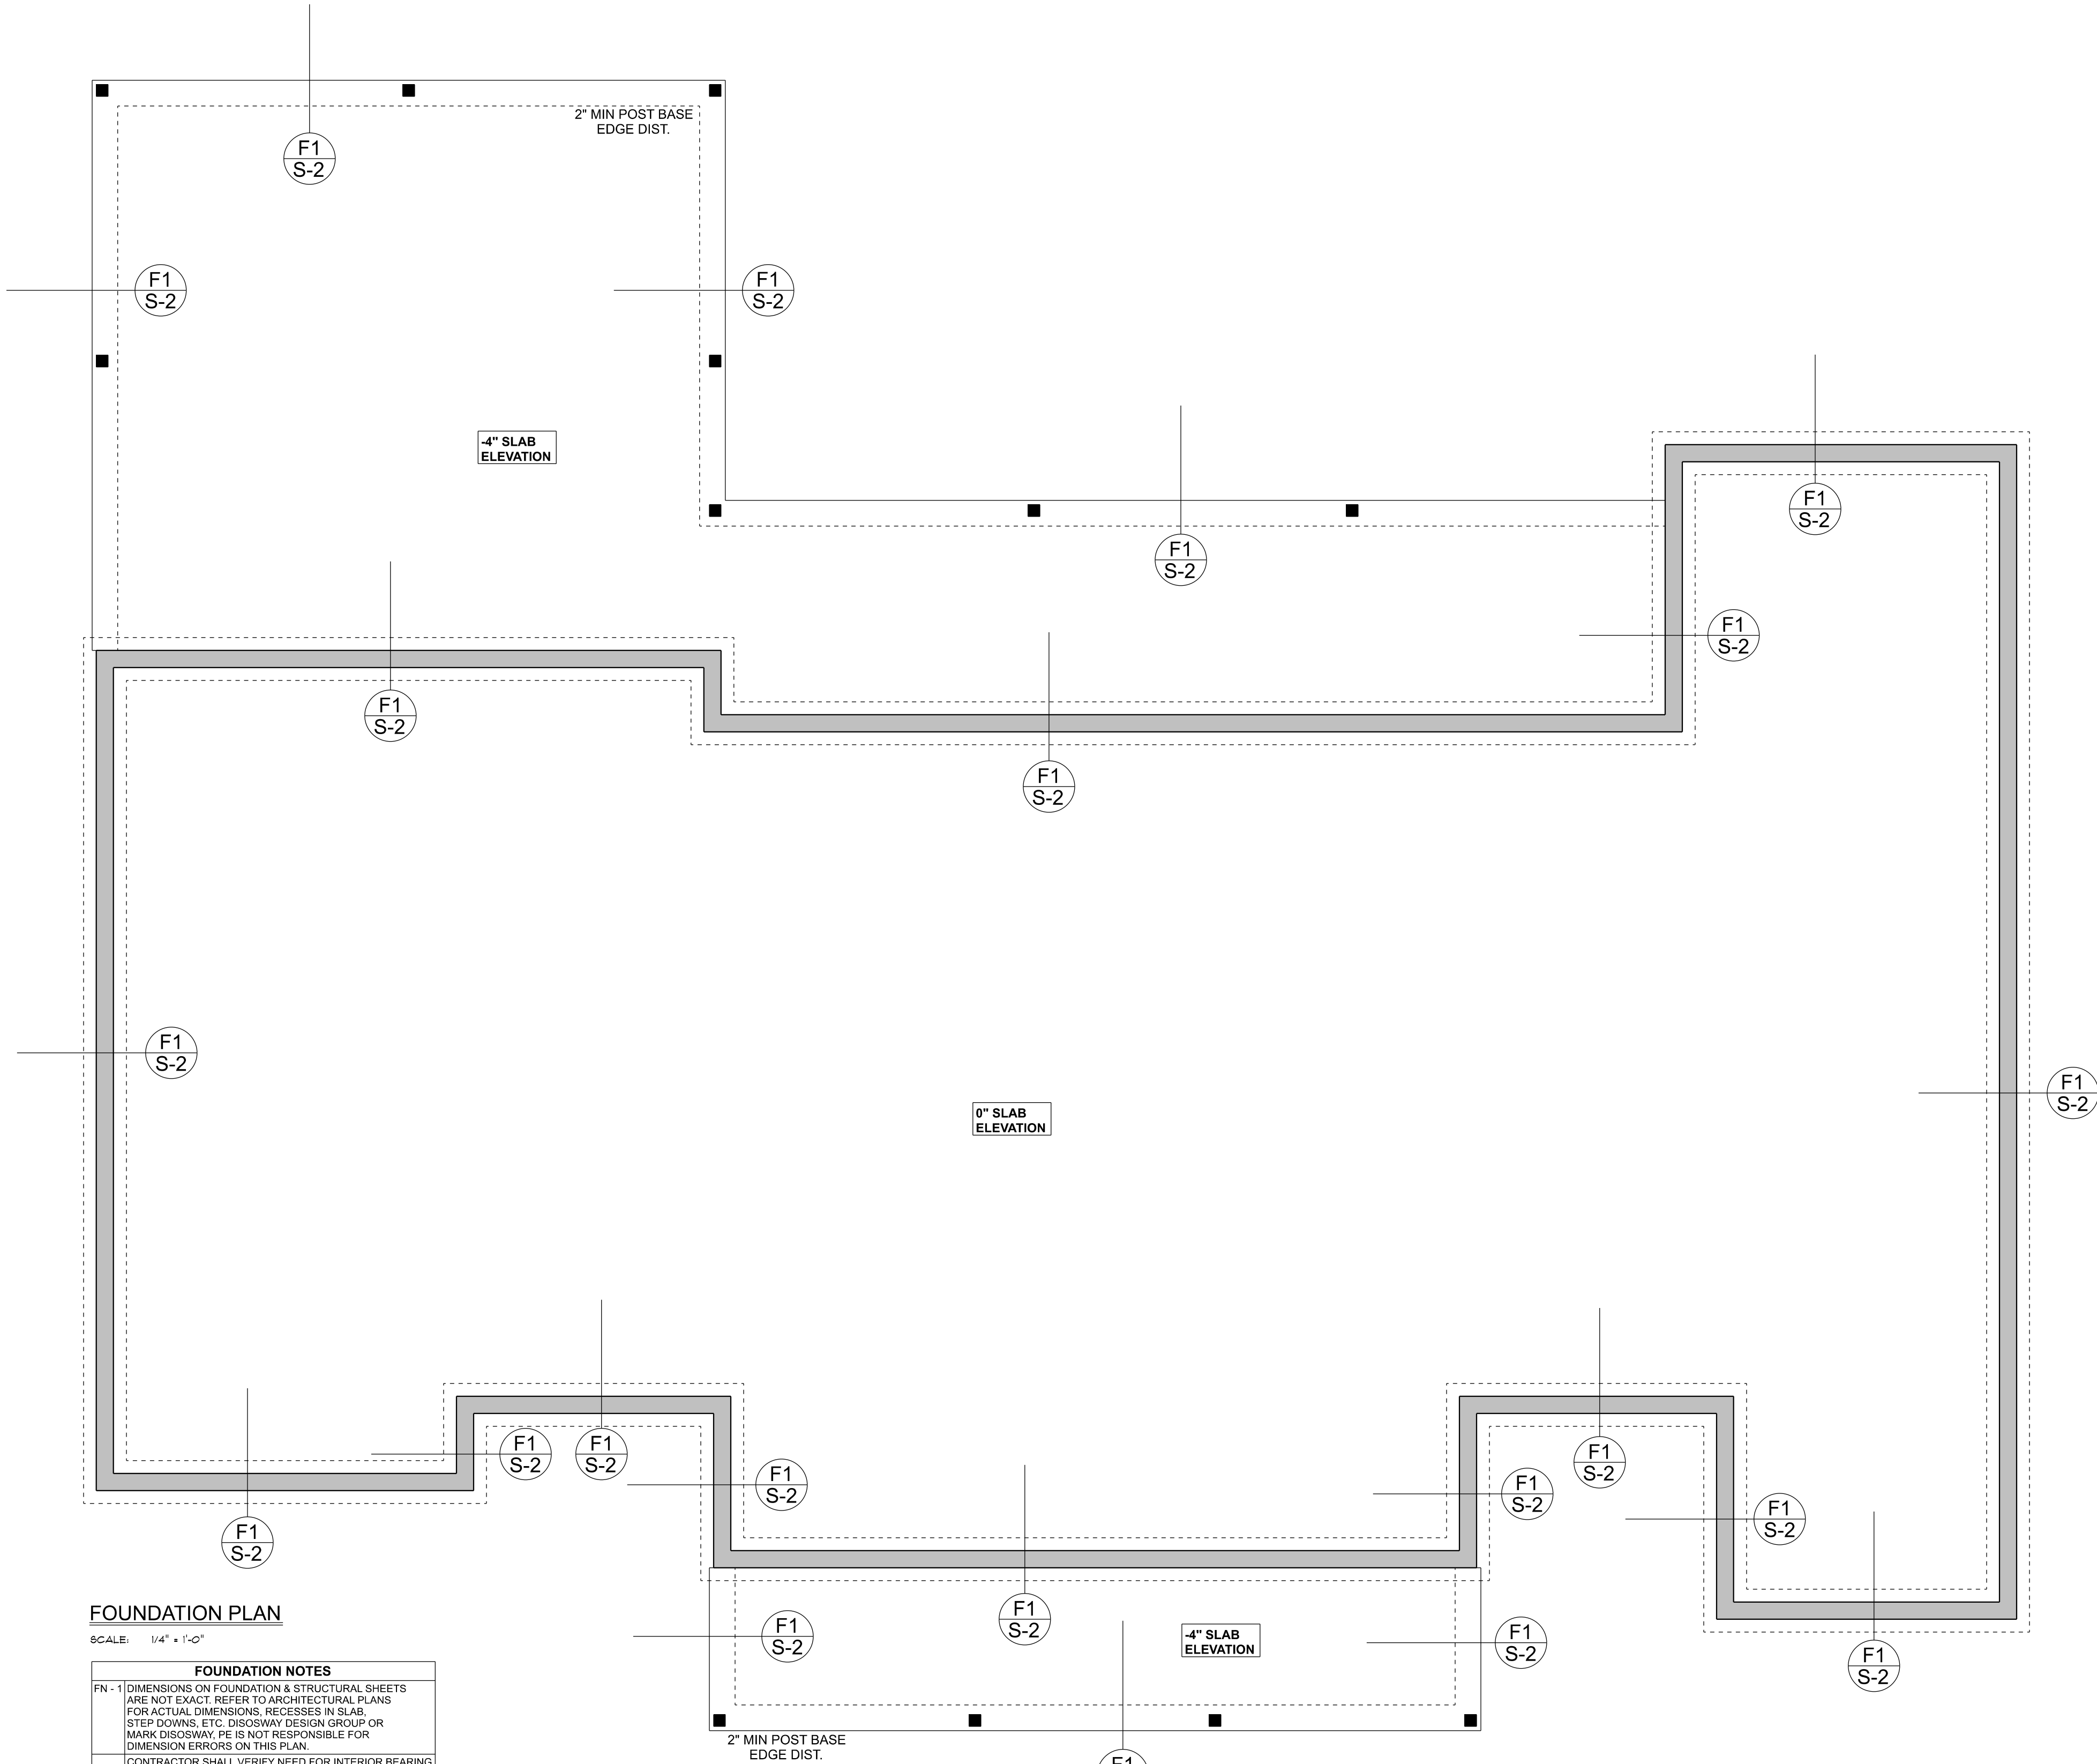

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

FOUNDATION NOTES	
FN - 1	DIMENSIONS ON FOUNDATION & STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL PLANS FOR ACTUAL DIMENSIONS. RECESSES IN SLAB STEP DOWNS, ETC. DISOSWAY DESIGN GROUP OR MARK DISOSWAY, P.E. IS NOT RESPONSIBLE FOR DIMENSION ERRORS ON THIS PLAN.
FN - 2	CONTRACTOR SHALL VERIFY NEED FOR INTERIOR BEARING WALLS BY REVIEWING THE ROOF TRUSS PLAN (BY THE SUPPLIER) BEFORE FINALIZING FOUNDATION PLAN
FN - 3	THE SLAB SHALL BE: 4" CONCRETE SLAB REINFORCED w/ 6X0.1414 WELDED WIRE MESH PLACED ON CHAIRS @ 1 1/2" DEPTH OR FIBER MESH CONCRETE, 6-MIL POLY VAPOR BARRIER w/ 6" LAPS SEALED w/ POLY TAPE OVER TERMITE-TREATED & COMPACTED FILL (ALSO, ANY OTHER CODE APPROVED TERMITE-TREATMENT METHOD CAN BE USED INSTEAD)

Bryan Zecher Construction

Philip & Katie Glover Res.

PROJECT ADDRESS:
1903 FL-47
Lake City, FL 32025

FL PE 53915
This item has been digitally signed and sealed by Mark Disosway, P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=US, O=Florida, dnQualifier=A01410C0000017E97DE07CA000746F0, CN=Mark d Disosway
2022-11-10 00:48:56

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.


CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
221306

S-2
OF 3 SHEETS

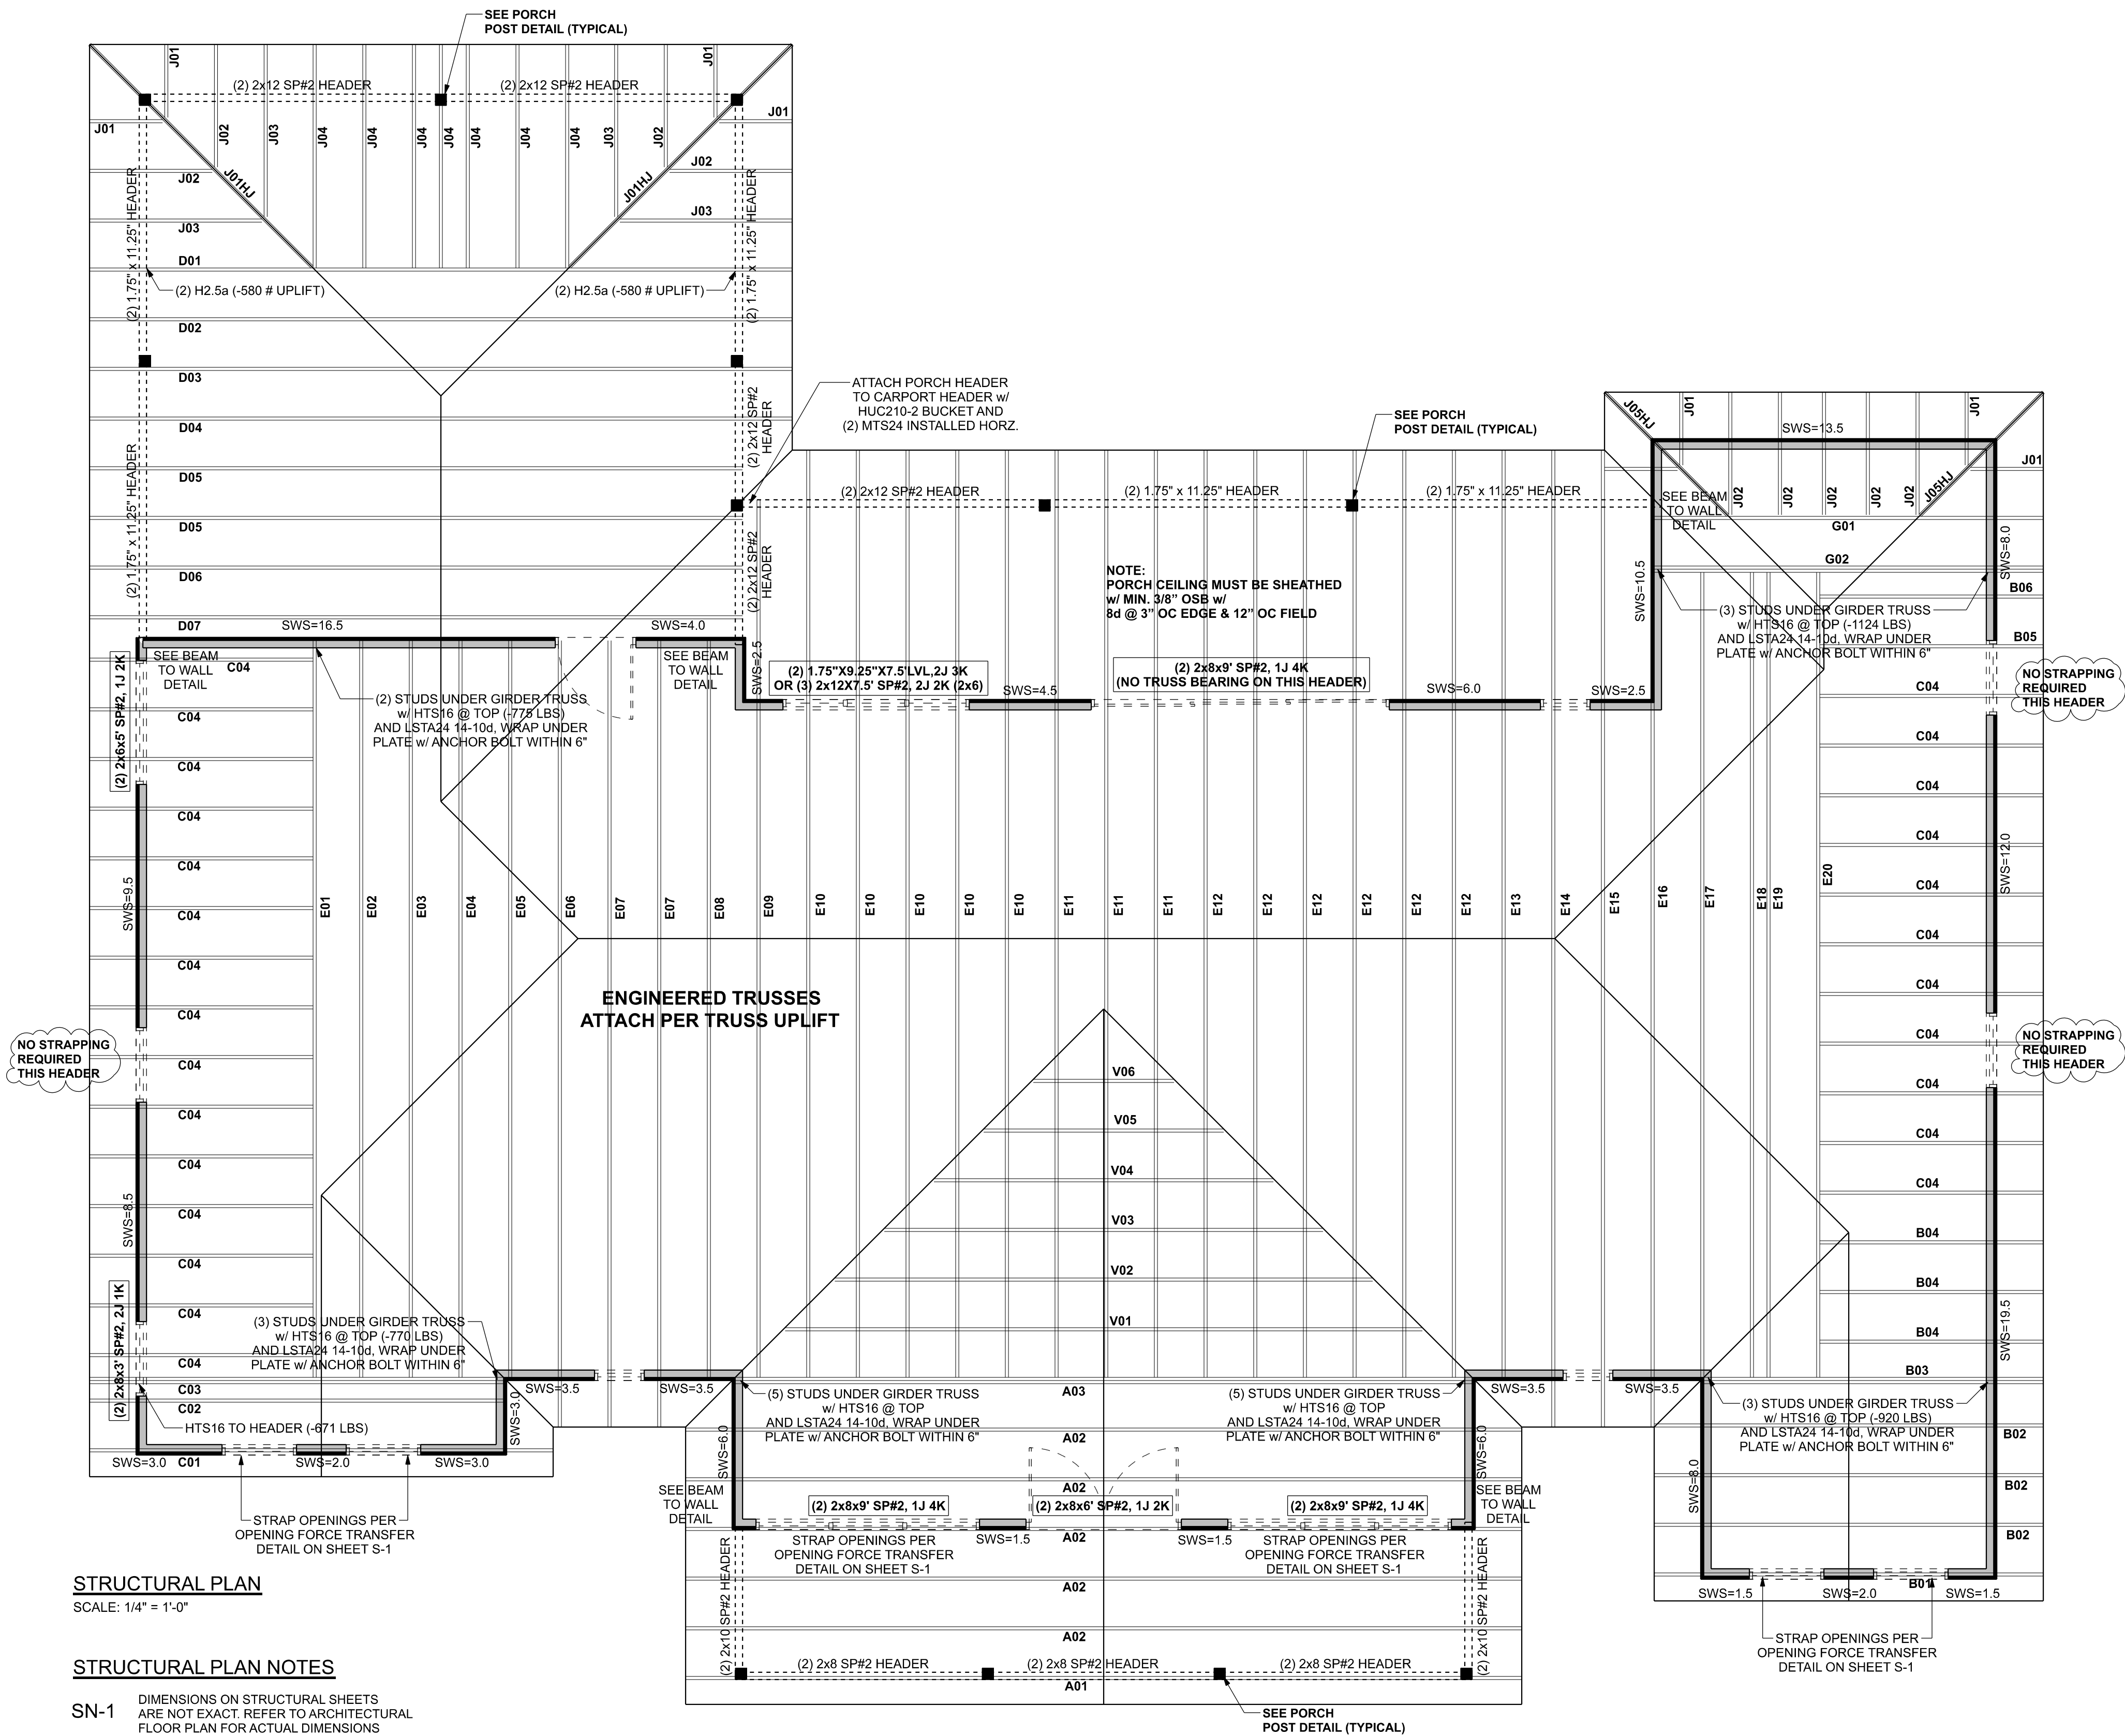

STRUCTURAL PLAN


SCALE: 1/4" = 1'-0"

STRUCTURAL PLAN NOTES

SN-1 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS

SN-2 PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI-1-03. BCSI-B1, BCSI-B2, & BCSI-B3. BCSI-B1, BCSI-B2, & BCSI-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

HEADER LEGEND

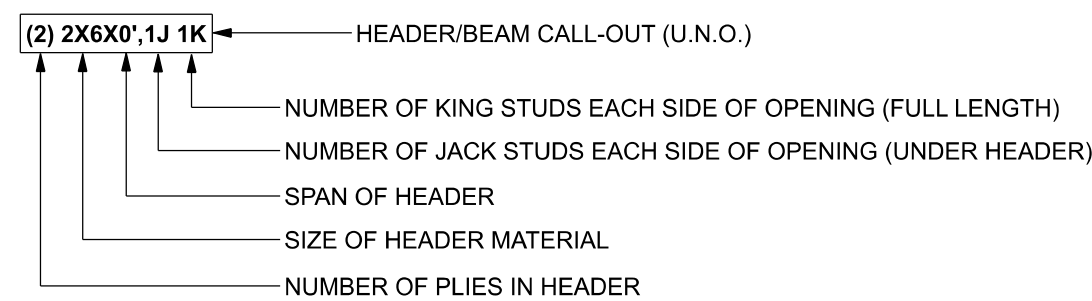

**UNLESS NOTED OTHERWISE (MINIMUM REQUIERMENTS)
SEE STRUCTURAL PLAN FOR ANY SPECIFIC CALL OUTS**

BEAM / HEADERS (SIZE)	ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X6 SP #2 (UNO)
HEADERS (JACK & KING STUDS)	ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (UNO)
HEADERS (STRAPPING)	ALL HEADERS w/ UPLIFT TO BE STRAPPED OR SCREWED DOWN w/ MIN. OPTION #1 OR OPTION #3 (SEE DETAIL ON SHEET S-1) (U.N.O.) 1/2" X 10" ANCHOR BOLT w/ 3" X 3" X 1/4" WASHER MUST BE LOCATED WITHIN 6" OF KING STUD @ ALL DOOR LOCATIONS (U.N.O.)
JACK STUDS UNDER GIRDER TRUSS	USE ONE JACK STUD GIRDER SUPPORT PER 2000 LB LOAD

ACTUAL vs REQUIRED SHEARWALL

	TRANSVERSE	LONGITUDINAL
ACTUAL	37026 LBF	30492 LBF
REQUIRED	21555 LBF	19901 LBF

CONNECTIONS, WALL, & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER. W. B. HOWLAND COMPANY JOB #22-8252

Bryan Zecher Construction

Philip & Katie Glover Res.

PROJECT ADDRESS:
1903 FL-47
Lake City, FL 32025

FL PE 53915
This item has been digitally signed and sealed by Mark Disoway, P.E. on digital signature date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

C=US, O=Florida, dnQualifier=A01410C0000017E97DE07CA000746F0, CN=Mark d Disoway
2022-11-10 00:50:19

DIMENSIONS: Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to vend engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

Mark Disoway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disowaydesign@gmail.com

JOB NUMBER:
221306

S-3
OF 3 SHEETS