


HVAC CONTROL WIRES TO UTILIZE
STANDARD 8 CONDUCTOR, 18 GA.,
COLOR CODED. SEE PHOTO THIS
SHEET.

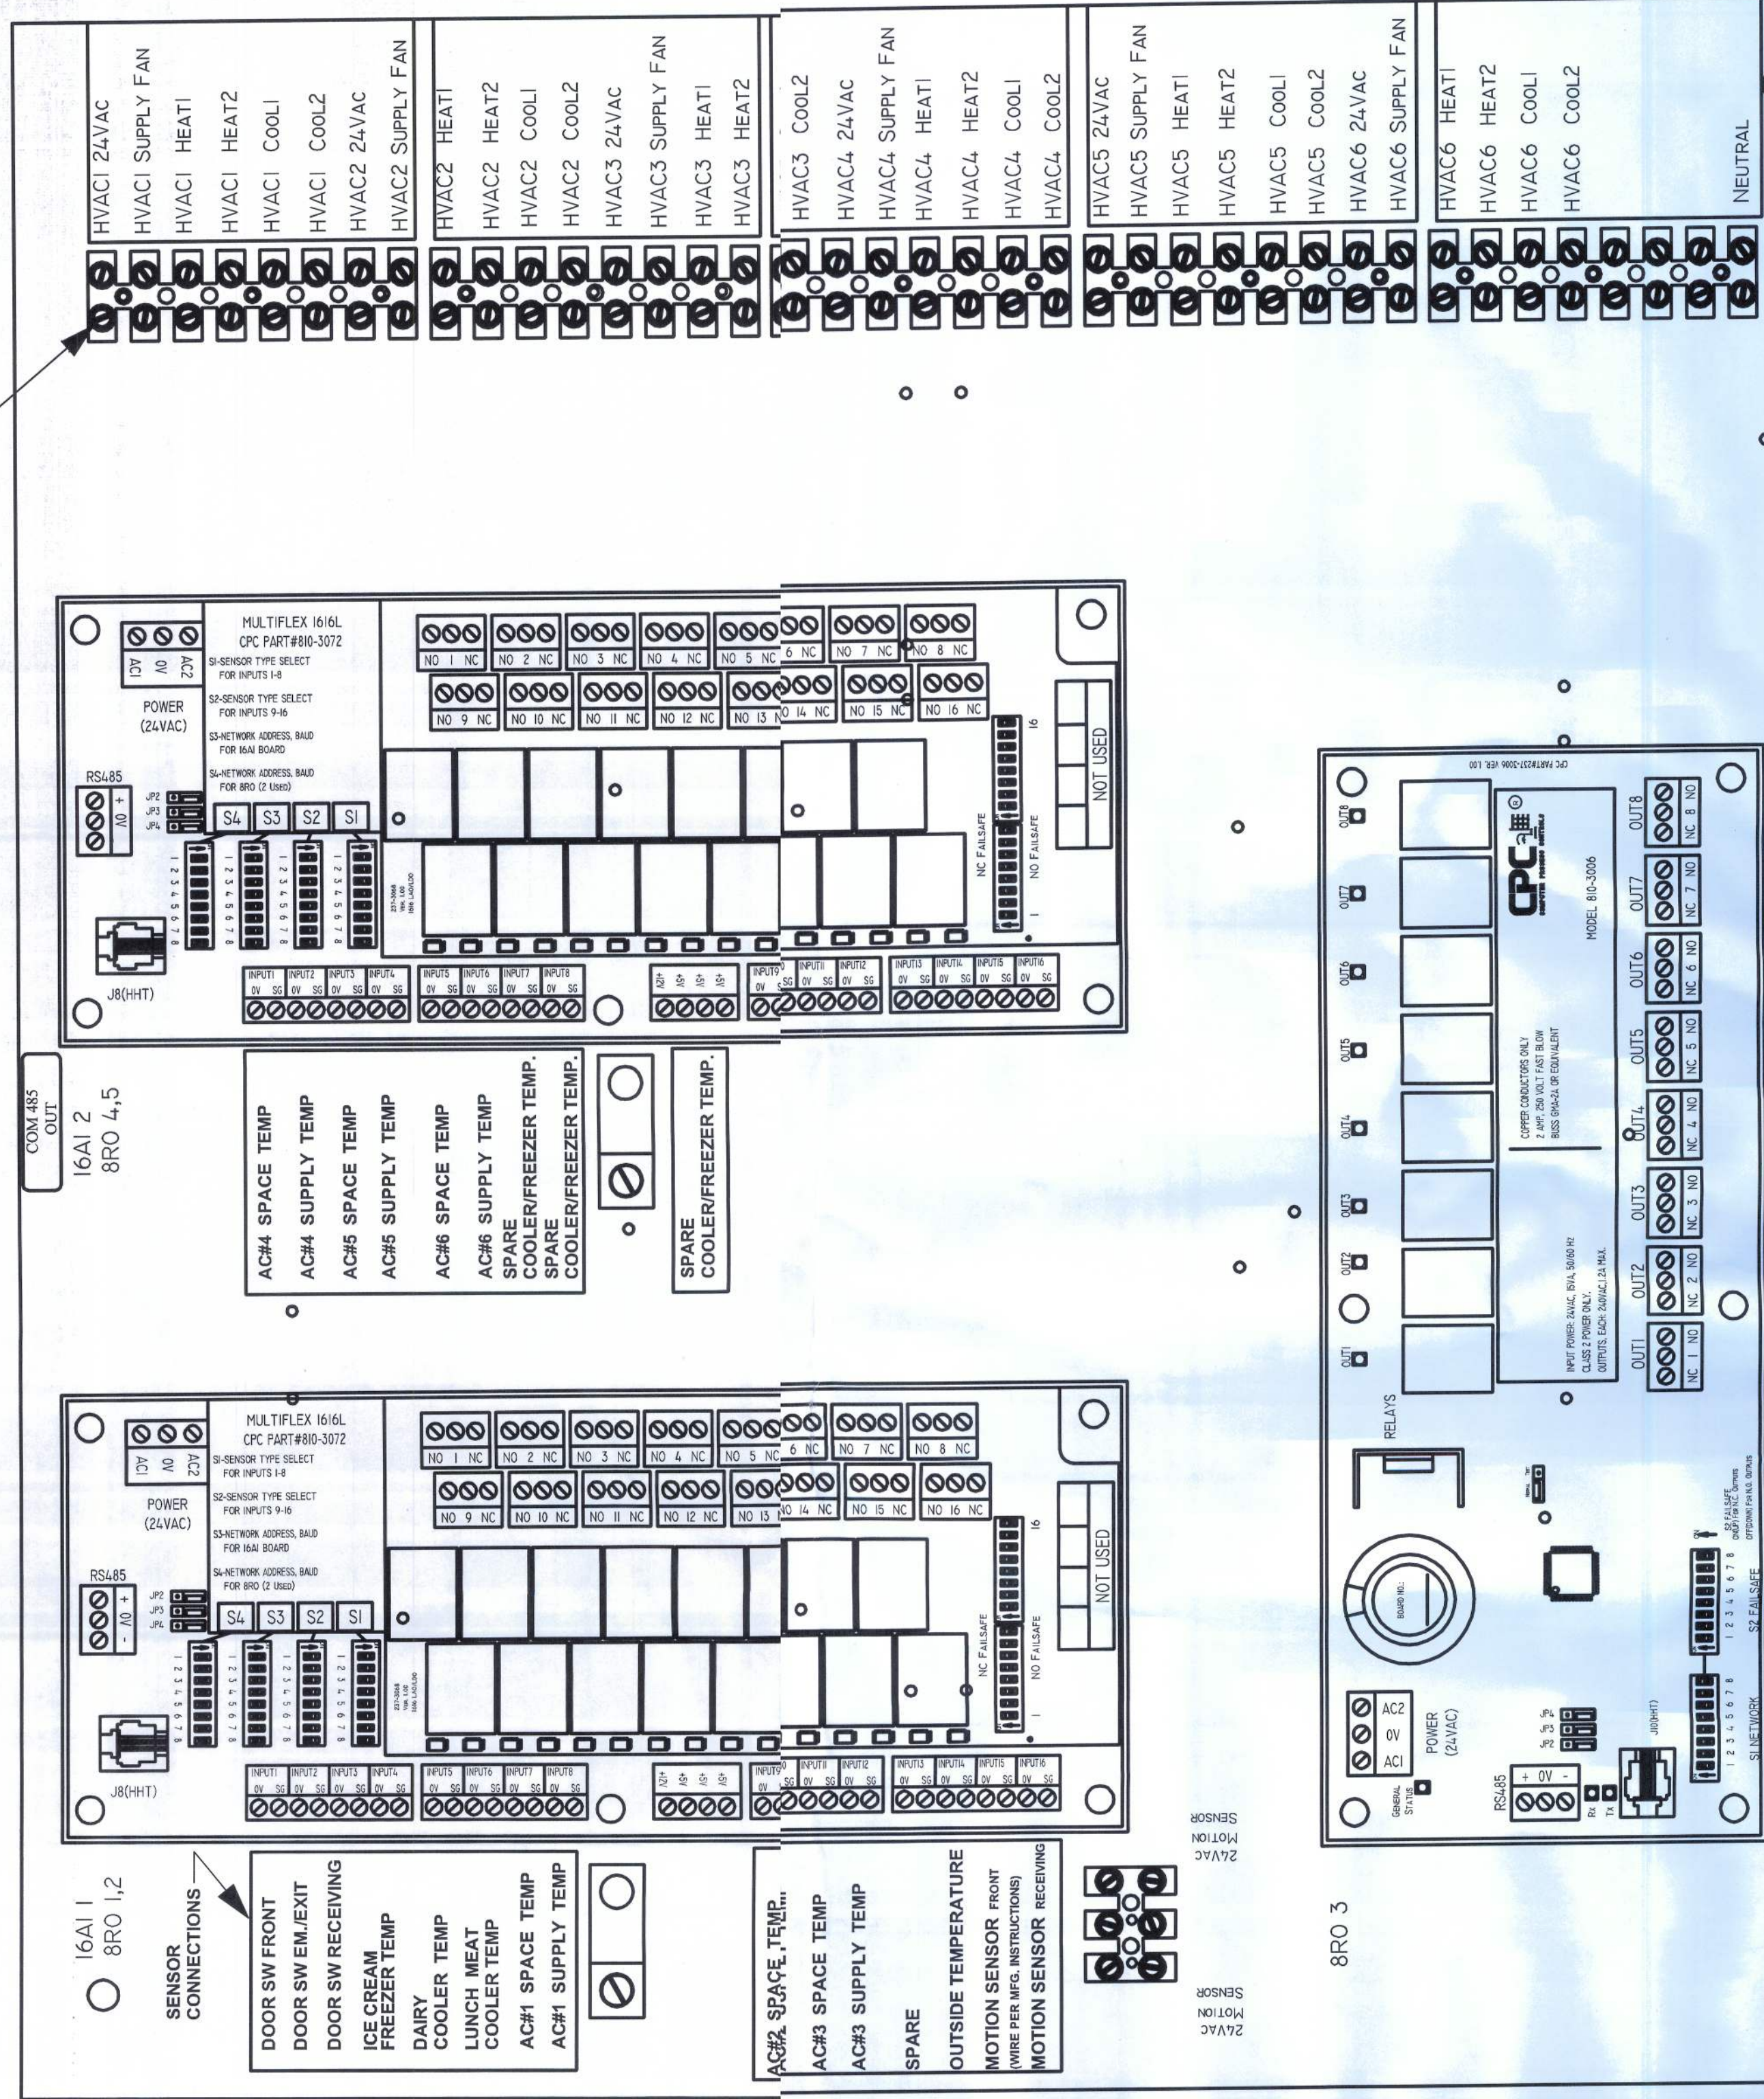


NOTES:

- EMS SUPPLIER NOTE: CUSTOMIZED DOLLAR GENERAL EMS PANEL REQUIRES STORE #, CITY, STATE, ZIP CODE & QTY. OF HVAC UNITS OF THE INSTALL SITE WHEN ORDERING. EMS SYSTEMS INSTALLATION GUIDE WITH PHOTOS IS AVAILABLE ON NATIONAL ACCOUNTS WEBSITE. ALL QUESTIONS PERTAINING TO THE EMS PANEL, SYSTEM INSTALLATION & SETUP SHOULD BE DIRECTED TO EMERSON'S DOLLAR GENERAL SUPPORT TEAM AT 770-425-2724.
- ALL SIGN & LIGHTING CIRCUITS MUST BE FED THROUGH THE DESIGNATED CONTACTORS AS NOTED ON THIS PAGE.
- ALL LOW VOLTAGE HVAC & DOOR SENSORS MUST BE COLLECTED TO THE PROPER TERMINAL. 24 GA. SHIELDED (SHIELD MUST BE GROUNDED) CABLE, BELDEN #8641, 2 CONDUCTOR WIRE OR ITS EQUIVALENT IS REQUIRED.
- COOLER & FREEZER HOME RUNS WILL BE TERMINATED AT ALL POINTS BY DOLLAR GENERAL REFRIGERATION DEPARTMENT.

1
EMS4.C

EMS HVAC CONTROL WIRING DETAIL
N.T.S.

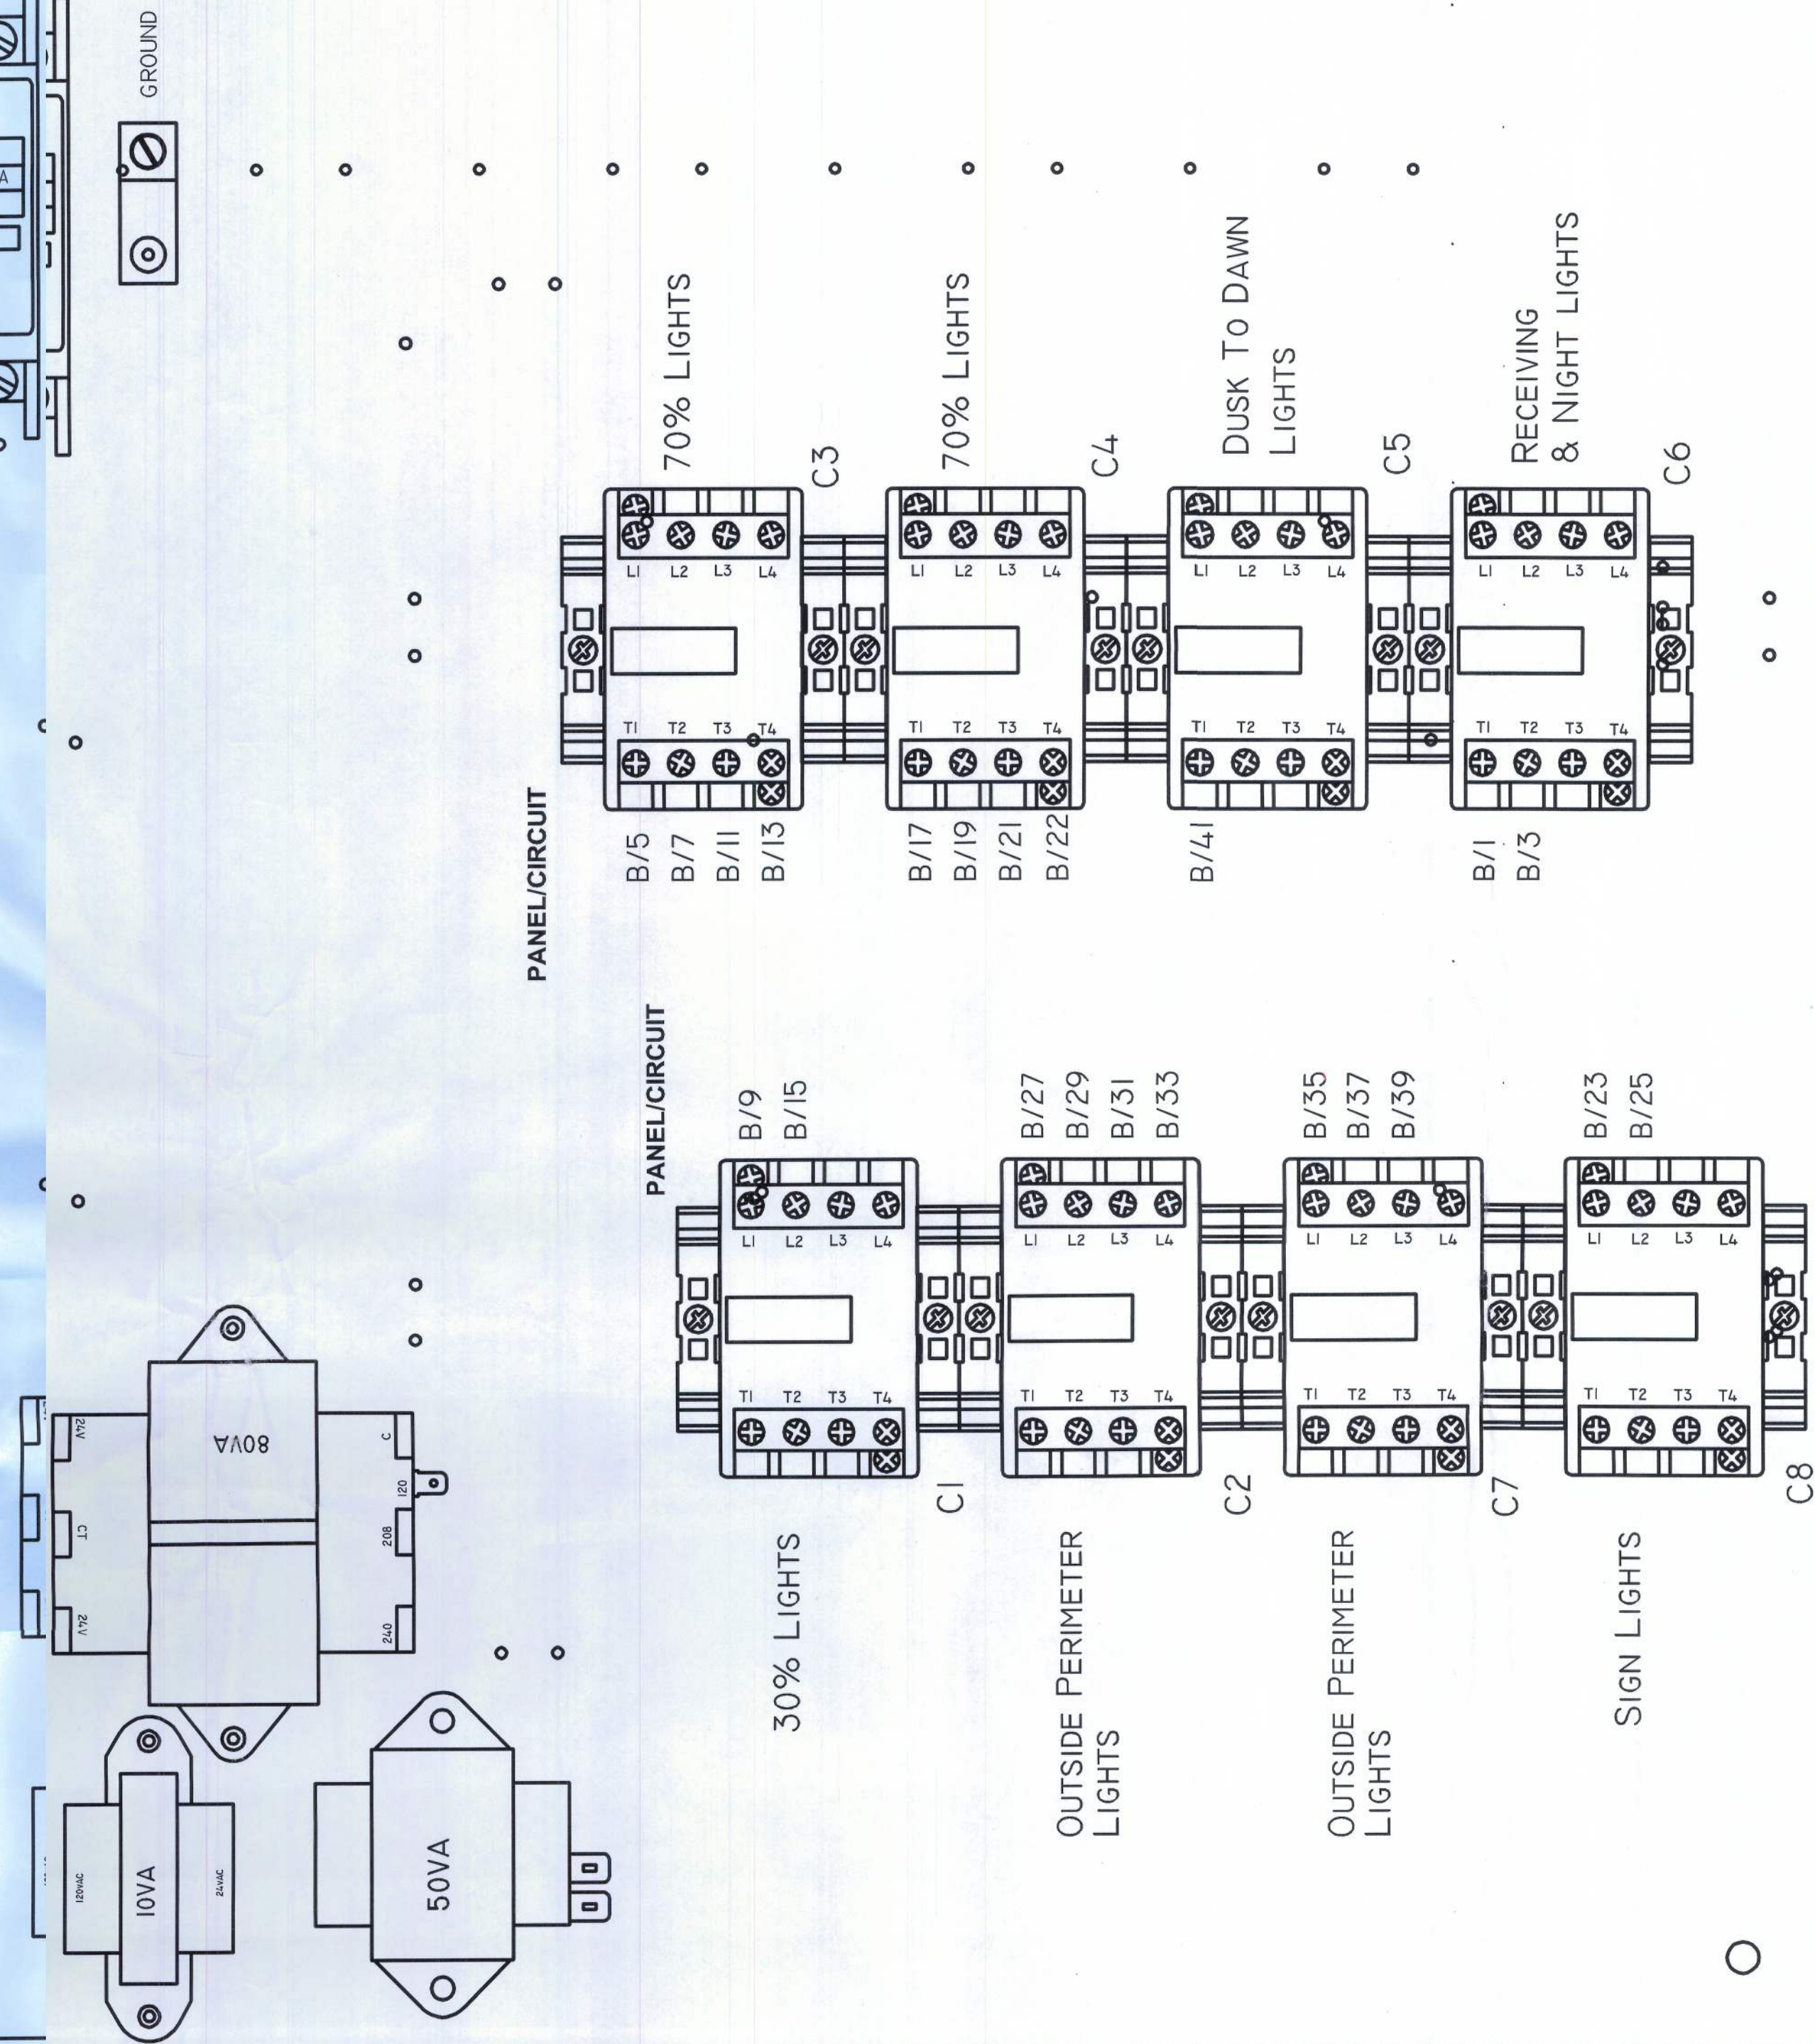

TESTING NOTE:

TESTING OF HVAC UNITS THRU EMS PANEL IS ACCOMPLISHED BY SIMPLY WARMING UP OR COOLING DOWN A SPACE TEMPERATURE SENSOR (USING A BLOW DRYER OR ELECTRONIC EQUIPMENT DUSTER AEROSOL) AND WATCH THE FAN, HEAT AND COOL STAGES CYCLE ON AND OFF. THIS REQUIRES TWO PEOPLE AT ALL TIMES...ONE TO WATCH THE SCREEN AND THE OTHER TO WATCH OPERATION OF THE AHU. WHEN COMPLETE, PRESS THE HOME BUTTON TO RETURN TO THE MAIN SCREEN.

EMS PANEL AND CONTROLS

DOLLAR GENERAL

LAKE CITY, FLORIDA
COUNTY RD 247, LAKE CITY, FL

STORE # 12851

2010 PROTOTYPE - PLAN "C" 9,100



CONCEPT
CONSTRUCTION

License#: GC1515491
ph: 386-7558887
fx: 386-7551919

295 NW Commons Loop
Suite 115-3/3
Lake City, FL 32055

www.conceptconstruction.net

NE

NICHOLAS
CELSER
PAUL
ARCHITECT
N.C.A.R.B. Certified
1758 NW Brown Road
Lake City, FL 32055
386/755-9021

CASCO

10877 WATSON ROAD
LAKE CITY, FL 32057
PHONE: 384-801-1100

DATE:

CDMM:

AR0007005