


REVISIONS
Jan. 23rd, 2026

EXISTING HOME RENOVATIONS FOR:  
**GRAND RESIDENCE**  
 1136 SW SEMINOLE TERR, LAKE CITY, FLORIDA

**NICHOLAS PAUL GEISLER ARCHITECT**  
 1186 NW Brown Rd., Lake City, FL 32025


SHEET NUMBER  
**S.5**  
 OF 5 SHEETS

AR0007005

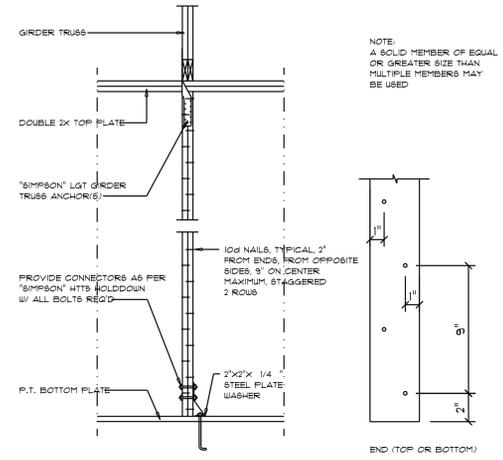


**Girder Truss Column DET.**  
 SCALE: 1/2" = 1'-0" **C**

ROOF SHEATHING FASTENINGS			
NAILING ZONE	SHEATHING TYPE	FASTENER	SPACING
1			6 in. o.c. EDGE 6 in. o.c. FIELD
2	1/2" O.S.B. OR 15/32 CDX	2 1/2"x0.131" RING SHANK NAILS @ 3"x0.100" RING SHANK NAILS	6 in. o.c. EDGE 6 in. o.c. FIELD
3			4 in. o.c. GABLE ENDWALL OR GABLE TRUSS 6 in. o.c. EDGE 6 in. o.c. FIELD

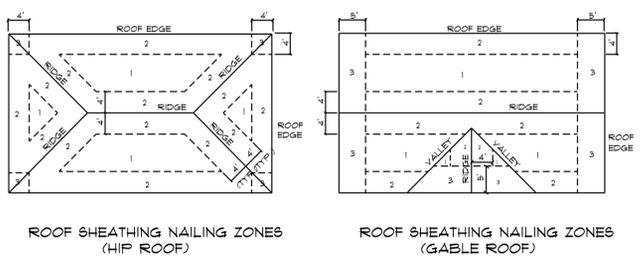


**Roof Nail Pattern DET.**  
 SCALE: NONE **B**

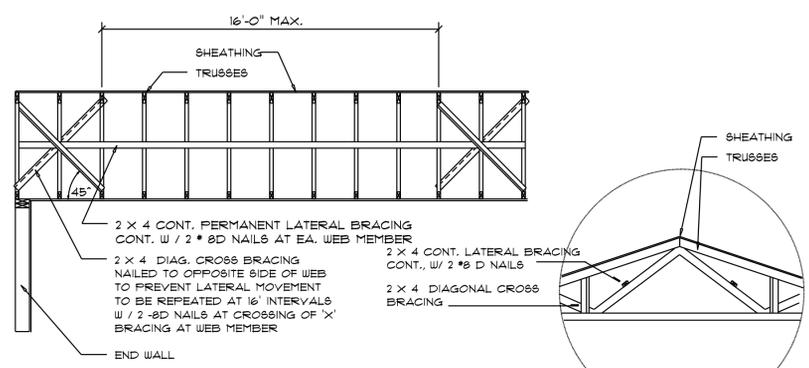


**TYP. PERMANENT TRUSS BRACING DIA.**  
 NT5  
 NOTE: ALL WOOD TO BE NUMBER 2 GRADE SOUTHERN YELLOW PINE

**Truss Bracing DETAILS**  
 SCALE: AS NOTED **D**

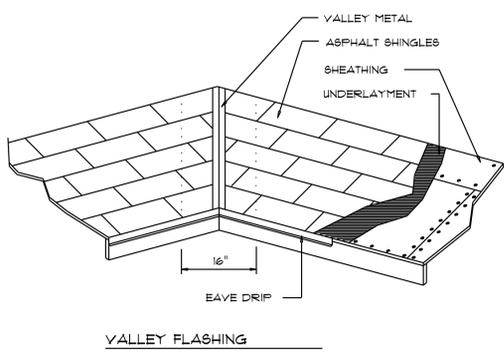


ROOFING METALS for FLASHING/ROOFING MINIMUM THICKNESS REQUIREMENTS			
MATERIAL	MINIMUM THICKNESS (in)	GAGE	WEIGHT (oz.)
COPPER			16
ALUMINUM	0.024		
STAINLESS STEEL		28	
GALVANIZED STEEL	0.0178	26 (ZINC COATED G90)	
ZINC ALLOY LEAD PAINTED TERNE	0.021		40 20

**Roofing/Flashing DETS.**  
 SCALE: NONE **A**

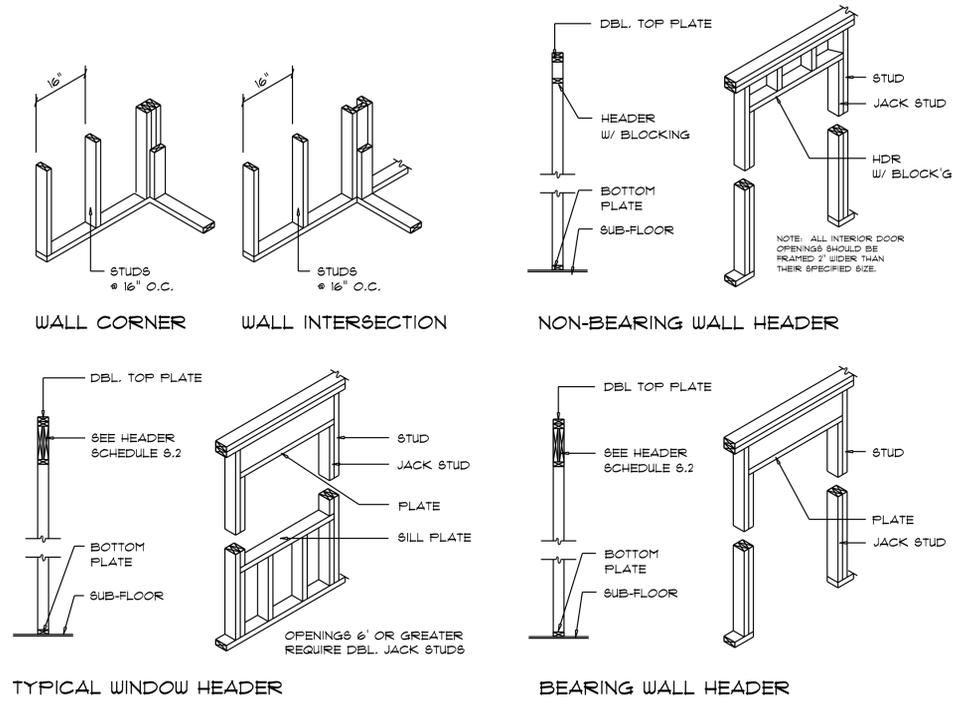

**Wall Framing/Header DETAILS**  
 SCALE: NONE **F**

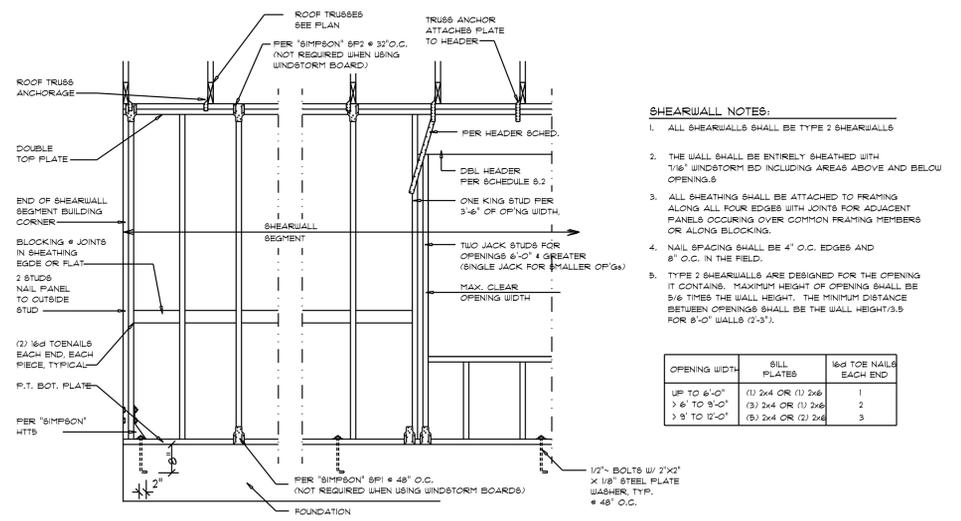

**Shear Wall DETAILS**  
 SCALE: NONE **E**