


**Application for Onsite Sewage Disposal System
Construction Permit. Part II Site Plan**
Permit Application Number: 14-2223

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH UNIT

CR# 10-5848

OCCUPIED >75' TO WELL

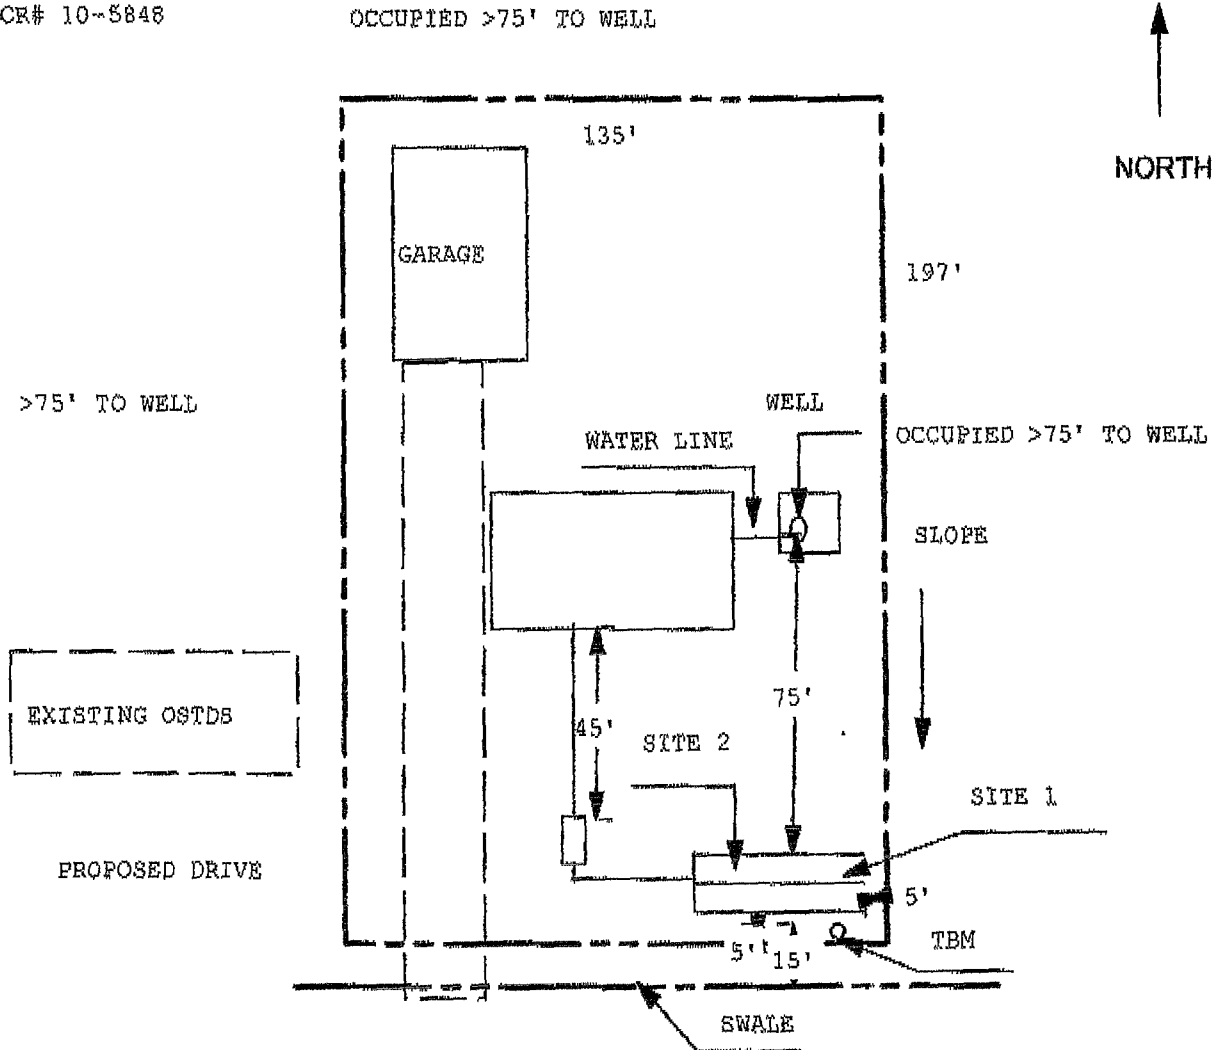

1 inch = 40 feet

Site Plan Submitted By Wendy SheppardPlan Approved Y

Not Approved

Date

Date

3/31/14

By

Notes:

Columbia

CPHU

6/



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ON-SITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION PERMIT

PERMIT #: 12-SC-1533493

APPLICATION #: AP1143669

DATE PAID: 4/16/14

FEE PAID: 30.00

RECEIPT #: 2161116

DOCUMENT #: PR937853

CONSTRUCTION PERMIT FOR: OSIDS New

APPLICANT: MARY SISTRUNK

PROPERTY ADDRESS: 344 SW STEWART Loop Lake City, FL 32026

LOT: 3 BLOCK: SUBDIVISION:

PROPERTY ID #: 03170-103

(SECTION, TOWNSHIP, RANGE, PARCEL NUMBER)

[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-5, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [900] GALLONS / GRD Septic CAPACITY
A [] GALLONS / GRD N/A CAPACITY
N [] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK: 1280 GALLONS]
K [] GALLONS DOSING TANK CAPACITY [] GALLONS [] DOSES PER 24 HRS #Pumps []

D [375] SQUARE FEET Drainfield SYSTEMR [] SQUARE FEET N/A SYSTEM

A TYPE SYSTEM: [x] STANDARD [] FILLED [] MOUND []

I CONFIGURATION: [x] TRENCH [] BED []

N

F LOCATION OF BENCHMARK: Nail in 18" Oak tree south of system site.

I ELEVATION OF PROPOSED SYSTEM SITE [24.00] [INCHES] FT [] ABOVE / [] BELOW BENCHMARK/REFERENCE POINT

E BOTTOM OF DRAINFIELD TO BE [64.00] [INCHES] FT [] ABOVE / [] BELOW BENCHMARK/REFERENCE POINT

L

D FILL REQUIRED: [0.00] INCHES EXCAVATION REQUIRED: [0.00] INCHES

The system is sized for 2 bedrooms with a maximum occupancy of 4 persons (2 per bedroom), for a total estimated flow of 300 gpd

SPECIFICATIONS BY: PAUL LLOYD

TITLE: PSE

APPROVED BY:

TITLE: Environmental Specialist I

Columbia CHD

DATE ISSUED: 04/28/2014

EXPIRATION DATE: 10/28/2015

DH 4015, 08/02 (obsoletes all previous editions which may not be used)

Incorporated: 64E-6.003, FAC

Page 1 of 3

v 1.1.4

AP1143669

SE927107