

SOIL CHEMICAL BARRIER METHOD:

-
- Technical drawing of a post hole with the following dimensions and callouts:
- Overall width: 24"
 - Overall height: 48"
 - Top section height: 8"
 - Callouts:
 - 12" x 12" x CONT. STRIP FT'G CENTERED BELOW BEARING WALL ABOVE
 - 2 - #5 BARS (THRU POST WHERE APPLICABLE) CONTINUOUS
 - 2 - #5 BARS DRILLED THRU POST EACH WAY @ 3" O.C. FROM BOT. OF POST
 - 4" GRAVEL BED FOR POST DRAINAGE
 - HOLE WITH CONCRETE

SCALE: not to scale

S.2

26ga metal roofing attached in accord with mfr. specifications
FL # 9555.5R4

2" x 6" PT #2 SYP purlins
@ 24" max spacing

1" Closed Cell Spray Ins (Entire Roof)
4.5" Open Cell Spray Ins (Conditioned Spaces)

Metal Facia & Soffits

2-2x12" LVL BEAMS
FASTEN TO POST
w/ 6" TIMBER LOCK SCREWS

1" Closed Cell
Spray Foam Ins.

2.5" Open Cell
Spray Foam Ins.

29ga metal wall panels
per FL #8246.2

2X6 SYP PURLINS
@ 24" O.C.

8X8 SYP WD POST

SIMPSON HDU11 AT POSTS
BUILD INSIDE ENCLOSED WALLS

2X6 SYP VERT. STUD WALL
w/ PT BOTTOM PLATE

Min 3000 psi
concrete

NOTCH DOUBLE LVL BEAMS INTO TOP OF POSTS

18"D x 18"W x CONT. STRIP FT'G

6"x6" W1.4xW1.4 W.W.M. PLACED AT 2" DEPTH ON CHAIRS OR FIBERMESH CONC.

3 - #5 BARS TOP & 3 - #5 BARS BOTTOM, CONTINUOUS ON WIRE/PLASTIC CHAIRS @ 48" O.C.

SCALE: not to scale

S.2

NOTE!
THE DESIGN WIND SPEED FOR THIS
PROJECT IS 130 MPH PER 2020 FBC 1609
AND LOCAL JURISDICTION REQUIREMENTS.

8x8 POST

MPSON HDU11 HOLD-DOWN

PT BOTTOM PLATE BUT TO POST

SCALE: not to scale

Digitally signed by: Nicholas P. Geisler
DN: CN = Nicholas P. Geisler email =
npgeisler47@gmail.com C = US O =
Nicholas P. Geisler
Date: 2022.03.10 17:02:55 -05'00'

CUSTOM HOME FOR:
SWINK RESIDENCE
COLUMBIA COUNTY, FLORIDA

CUSTOM HOME FOR:

SWINK RESIDENCE

SWINK RE

N
NICHOLAS
PAUL
GEISLER
ARCHITECT


■ C.A.R.B. Certified ■ Lake City, FL 32055

SHEET NUMBER

S.2

F 5 SHEETS

Geisler
ed by: Nicholas P. Geisler
cholas P. Geisler email =
@gmail.com C = US O =
Geisler
0-10-73-22-55 05/2011

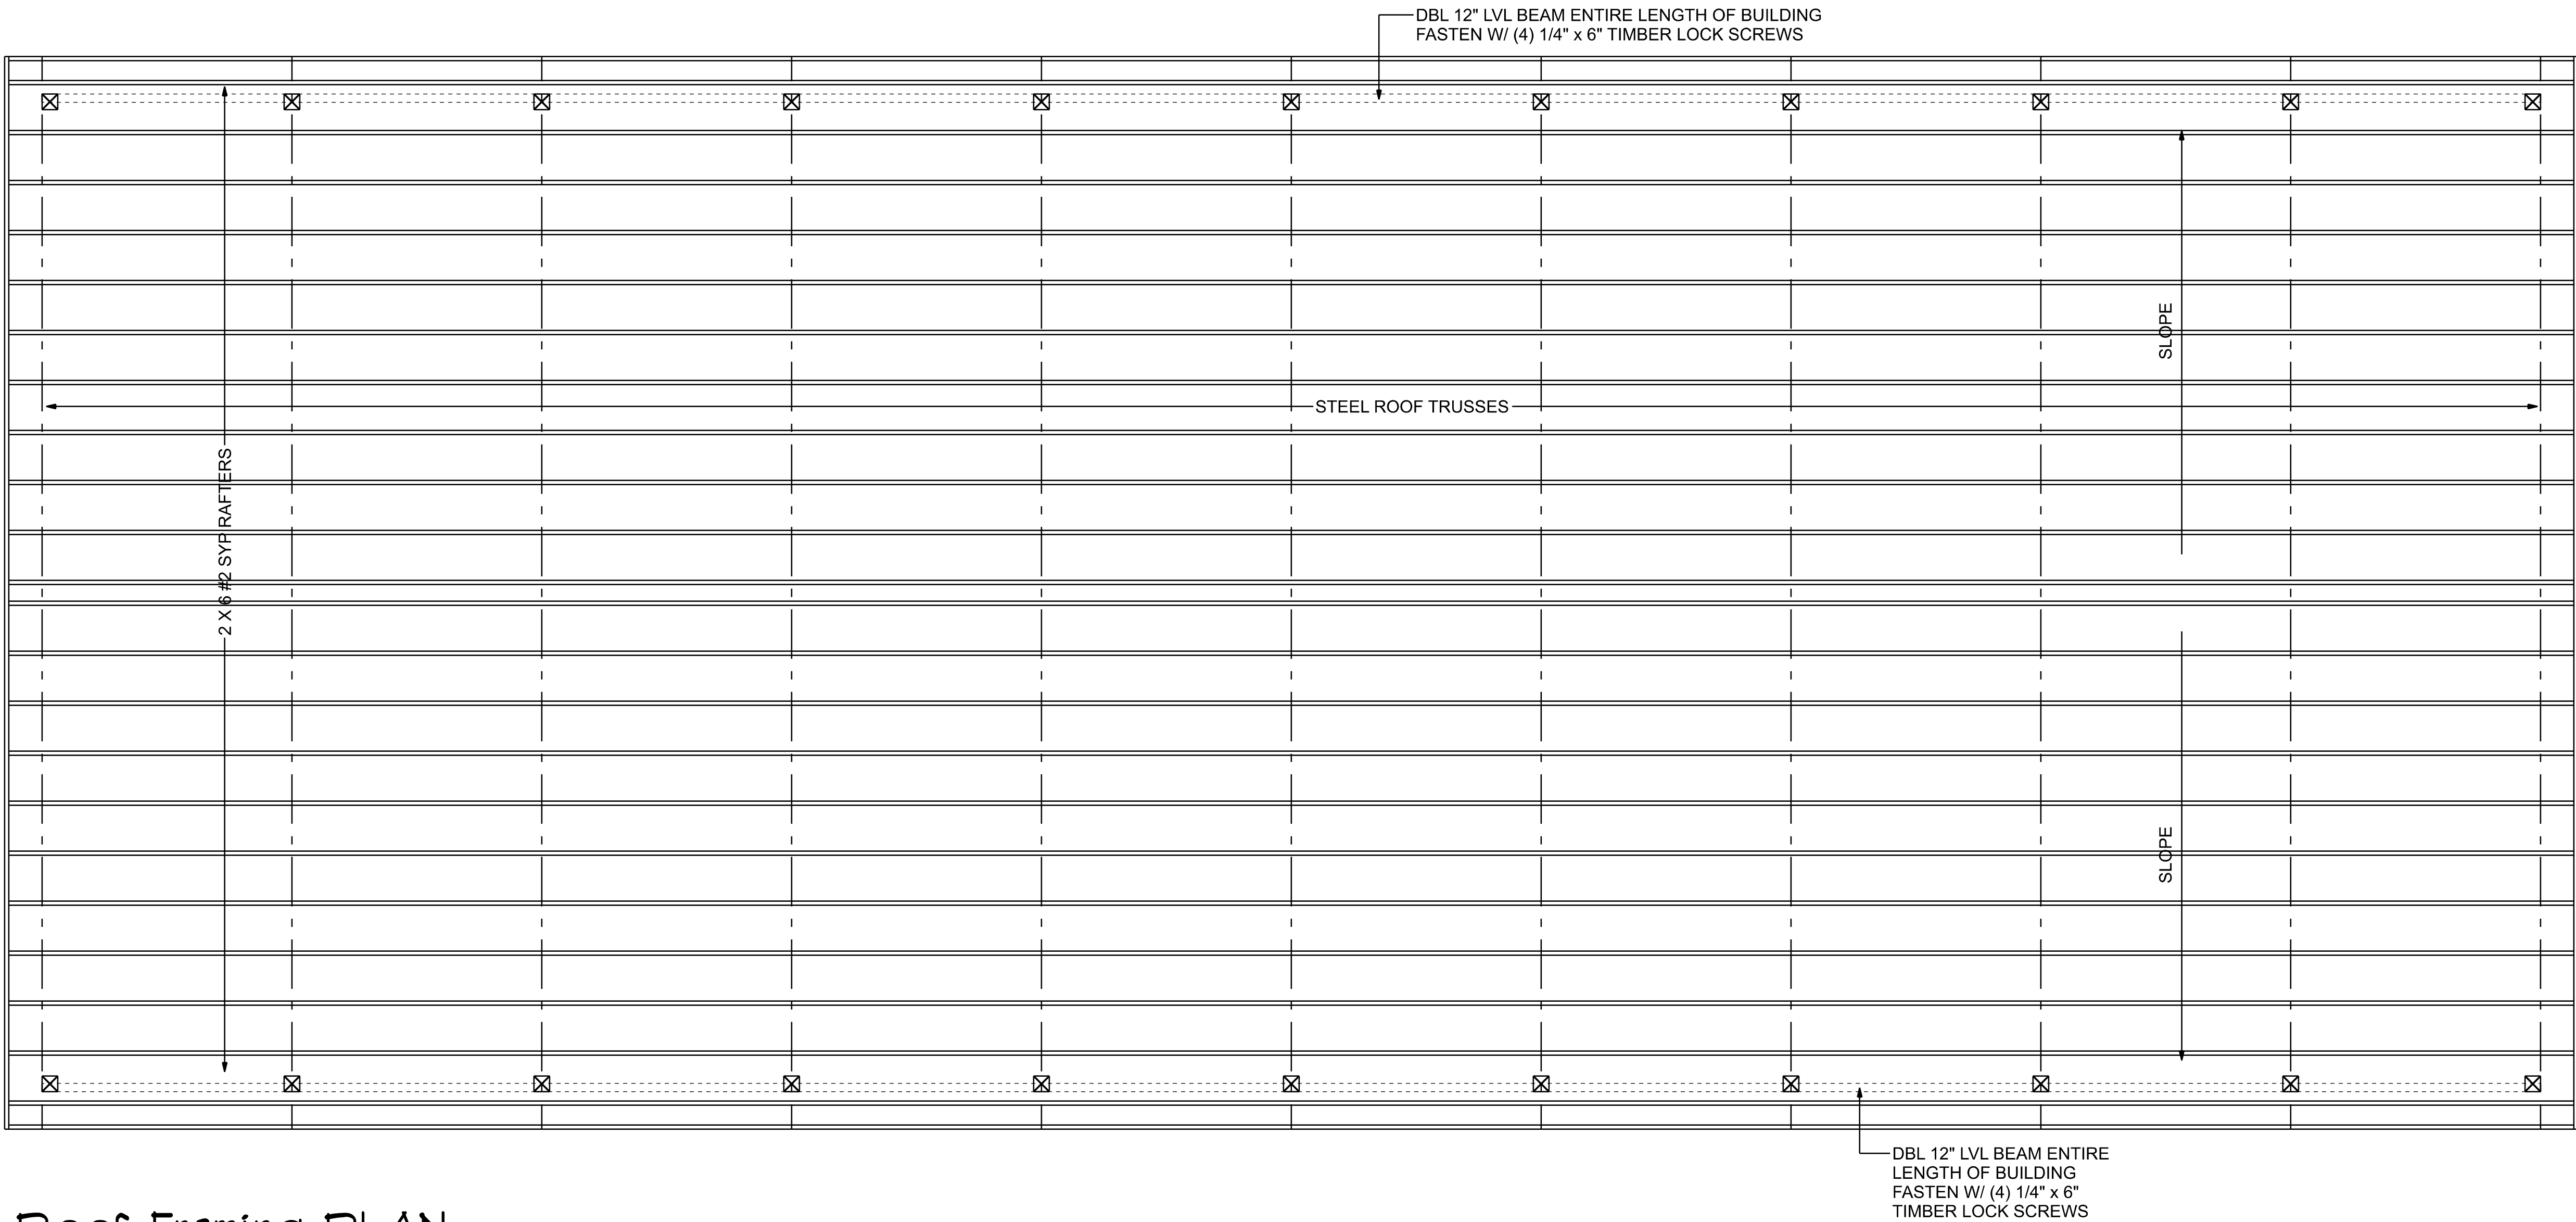


Roof Framing PLAN

SCALE: 1/4" = 1'-0"


NOTE:
THE DESIGN WIND SPEED FOR THIS
PROJECT IS 130 MPH PER FBC 1609
AND LOCAL JURISDICTION REQUIREMENTS

NOTES:


1. MATERIALS SHALL CONFORM TO STEEL ASTM 513.
2. ALL STEEL SHALL BE 50KSI IN ACCORD WITH CURRENT AISC MANUAL.
3. WELDING ELECTRODES TYPE E70XX.
4. ALL WELDING SHALL BE IN ACCORD WITH CURRENT AWWA REQUIREMENTS.
5. ALL WELDING SHALL BE DONE BY A CERTIFIED WELDER.
6. BOLTS SHALL BE ASTM A325, W/ NUTS & WASHERS (TYP).
7. WELD STRENGTH 70 KSI MIN.
8. ALL POST SHALL BE PRESSURE TREATED GROUND CONTACT.
9. PRIMING & PAINTING SHALL BE DONE BY TRUSS MANUFACTURER.
10. MIN EDGE DISTANCE FOR BOLTS HOLES SHALL BE 3/4" MIN.
11. MAX TRUSS SPACING SHALL NOT EXCEED 12'-0".
12. THE DESIGNER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF
POOR WORKMANSHIP, OR IMPROPER USE, AND ACCEPTS NO RESPONSIBILITY OR
EXERCISES NO CONTROL WITH REGARD TO FABRICATION, HANDLING, AND INSTALLATION
OF TRUSSES.

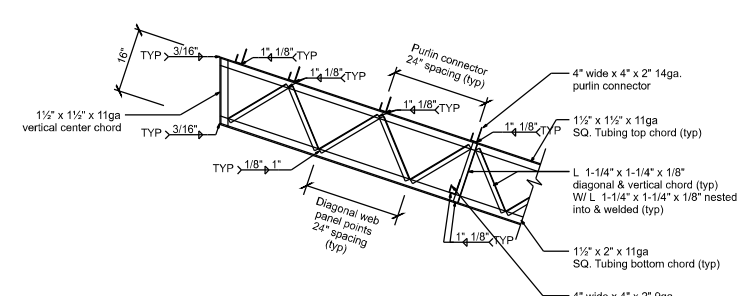


TRUSS CENTER SECTION




CENTER RIDGE SECTION

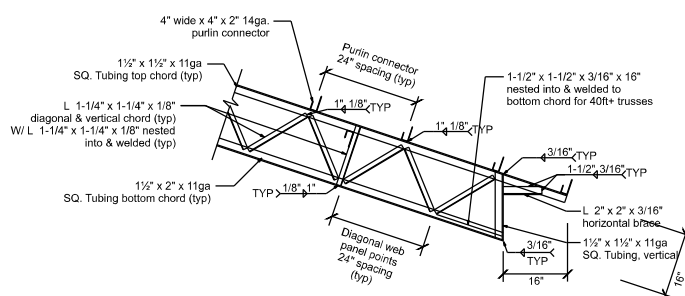


TRUSS END SECTION

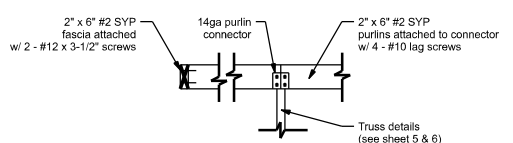


PURLIN CONNECTION SECTION




POST TO TRUSS CONNECTION

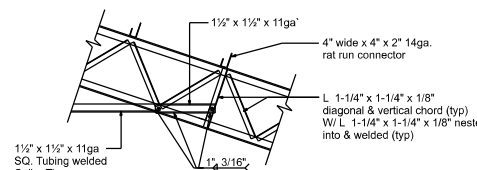

COLLAR TIE SECTION

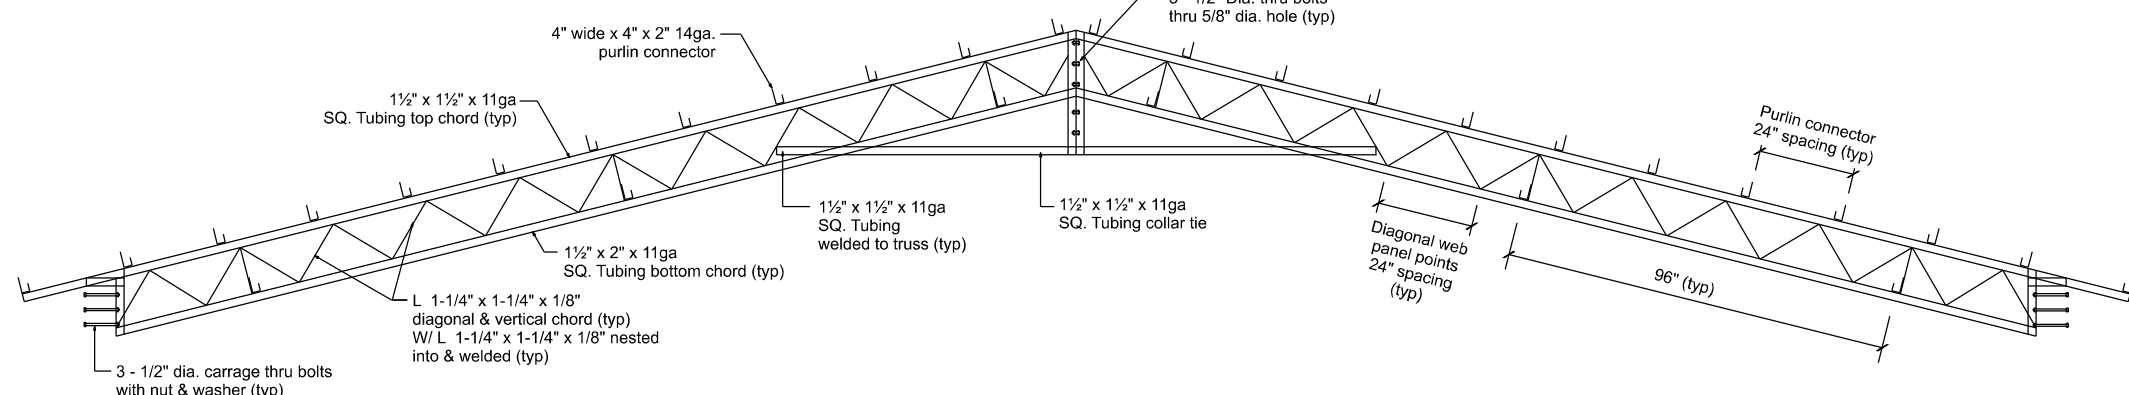


STEEL TRUSS CROSS SECTION
SCALE: 1/4" = 1'-0"

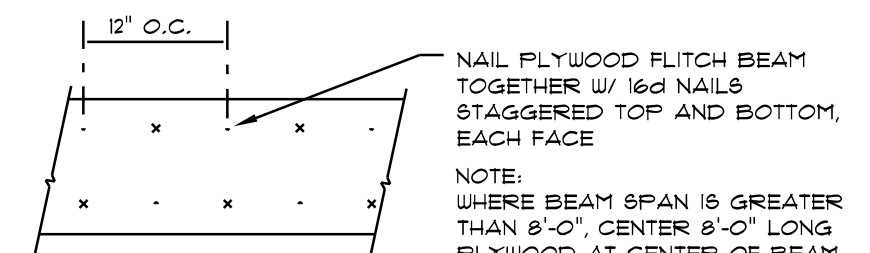

PLYWOOD FLITCH BEAM DETAIL

NOT TO SCALE

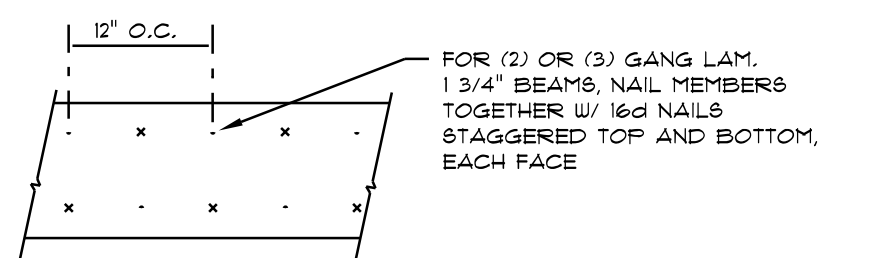


MULTIPLE GANG LAM. DETAIL

NOT TO SCALE

B/U Beam DETAILS

SCALE: NONE

ROOF SHEATHING FASTENINGS			
NAILING ZONE	PANEL TYPE	FASTENER	SPACING
1	29 ga. WALL PANELS	#9-15 OR #10-14 x 1.5" LONG w/ SEALED WASHERS	6 in. o.c. EDGE 9 in. o.c. FIELD
2			6 in. o.c. EDGE 9 in. o.c. FIELD
3			6 in. o.c. GABLE ENDWALL OR GABLE TRUSS 6 in. o.c. EDGE 9 in. o.c. FIELD

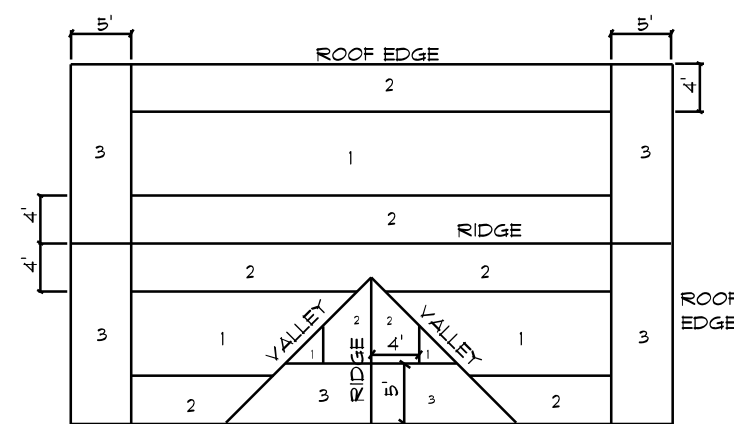

ROOF PANEL SCREW ZONES
(GABLE ROOF)

Roof Fastner Pattern DET.

SCALE: NONE

REVISIONS
Jan. 14th, 2022
MARCH 7th, 2022

CUSTOM HOME FOR:
SWINK RESIDENCE
COLUMBIA COUNTY, FLORIDA

NICHOLAS P. GEISLER
ARCHITECT
1788 NW Brown Rd.
Lakeland, FL 34055
N.C.A.R.E. Certified

SHEET NUMBER
S.4
OF 5 SHEETS

Nicholas P. Geisler
Digitally signed by Nicholas P. Geisler
DN: CN = Nicholas P. Geisler email =
npgisler47@gmail.com, C=US, O=Nicholas P. Geisler
Date: 2022.03.10 17:04:10 -05'00'

AR0007005


FRAMING ANCHOR SCHEDULE

APPLICATION	MANUF'R/MODEL
TRUSS TO POST:	3 - 1/2" dia. carriage thru bolts with nut & washer (typ)
HEADER TO KING STUD(S):	SIMPSON MSTA18
PORCH BEAM TO POST:	4 - 1/4" x 6" TIMBER LOCK SCREWS
MISC. JOINTS	SIMPSON A34

NOTE:
ALL ANCHORS SHALL BE SECURED W/ NAILS AS PRESCRIBED BY THE MANUFACTURER FOR MAXIMUM JOINT STRENGTH, UNLESS NOTED OTHERWISE.
NOTE:
REFER TO THE INCLUDED STRUCTURAL DETAILS FOR ADDITIONAL ANCHORS/ JOINT REINFORCEMENT AND FASTENERS.
NOTE:
ALL UNLISTED JOINTS IN THE LOAD PATH SHALL BE REINFORCED WITH SIMPSON A34 FRAMING ANCHORS, TYPICAL T.O.


		BUILDING COMPONENTS & CLADDING LOADS MEAN BUILDING HEIGHT = 30.0', EXPOSURE "B" ROOF ANGLE 1° TO 21°				
ZONING	AREA	Vult 110 MPH	Vult 120 MPH	Vult 130 MPH	Vult 140 MPH	
		10.0 / -19.9 11.4 / -19.4 12.8 / -18.6	14.9 / -23.1 13.6 / -23.0 11.9 / -22.2	11.5 / -21.8 16.0 / -21.0 13.9 / -20.0	20.3 / -32.3 18.5 / -31.4 16.1 / -30.2	
ROOF 1° TO 21°	1	10	12.8 / -34.1 11.4 / -31.5 10.0 / -28.2	14.9 / -41.3 13.6 / -38.0 11.9 / -33.6	11.5 / -40.4 16.0 / -44.6 13.9 / -39.4	20.3 / -56.2 18.5 / -51.1 16.1 / -45.1
	2	10	12.8 / -51.3 11.4 / -47.5 10.0 / -43.5	14.9 / -61.0 13.6 / -57.1 11.9 / -51.8	11.5 / -71.6 16.0 / -67.0 13.9 / -60.8	20.3 / -83.1 18.5 / -77.1 16.1 / -70.5
	3	10	12.8 / -73.6 11.4 / -69.8 10.0 / -65.8	14.9 / -84.1 13.6 / -79.9 11.9 / -73.4	11.5 / -93.0 16.0 / -98.0 13.9 / -90.8	20.3 / -106.2 18.5 / -100.1 16.1 / -92.5
	4	10	21.8 / -23.6 20.8 / -22.6 19.5 / -21.3	25.9 / -34.1 24.1 / -26.9 23.2 / -25.4	30.4 / -33.0 29.0 / -31.6 27.2 / -29.8	35.3 / -38.2 33.1 / -36.1 31.6 / -34.6
	5	10	21.8 / -29.1 20.8 / -27.2 19.5 / -24.6	25.9 / -34.1 24.1 / -32.4 23.2 / -29.3	30.4 / -40.1 29.0 / -38.0 27.2 / -34.3	35.3 / -41.2 33.1 / -44.0 31.6 / -39.8
	6	10	21.8 / -34.6 20.8 / -32.7 19.5 / -29.9	25.9 / -34.1 24.1 / -32.4 23.2 / -29.3	30.4 / -40.1 29.0 / -38.0 27.2 / -34.3	35.3 / -41.2 33.1 / -44.0 31.6 / -39.8

HEIGHT & EXPOSURE ADJUSTMENT COEFFICIENTS FOR BUILDING COMPONENTS & CLADDING			
BLDG HEIGHT	EXPOSURE "B"	EXPOSURE "C"	EXPOSURE "D"
15	1.00	1.21	1.41
20	1.00	1.29	1.55
25	1.00	1.35	1.61
30	1.00	1.40	1.66

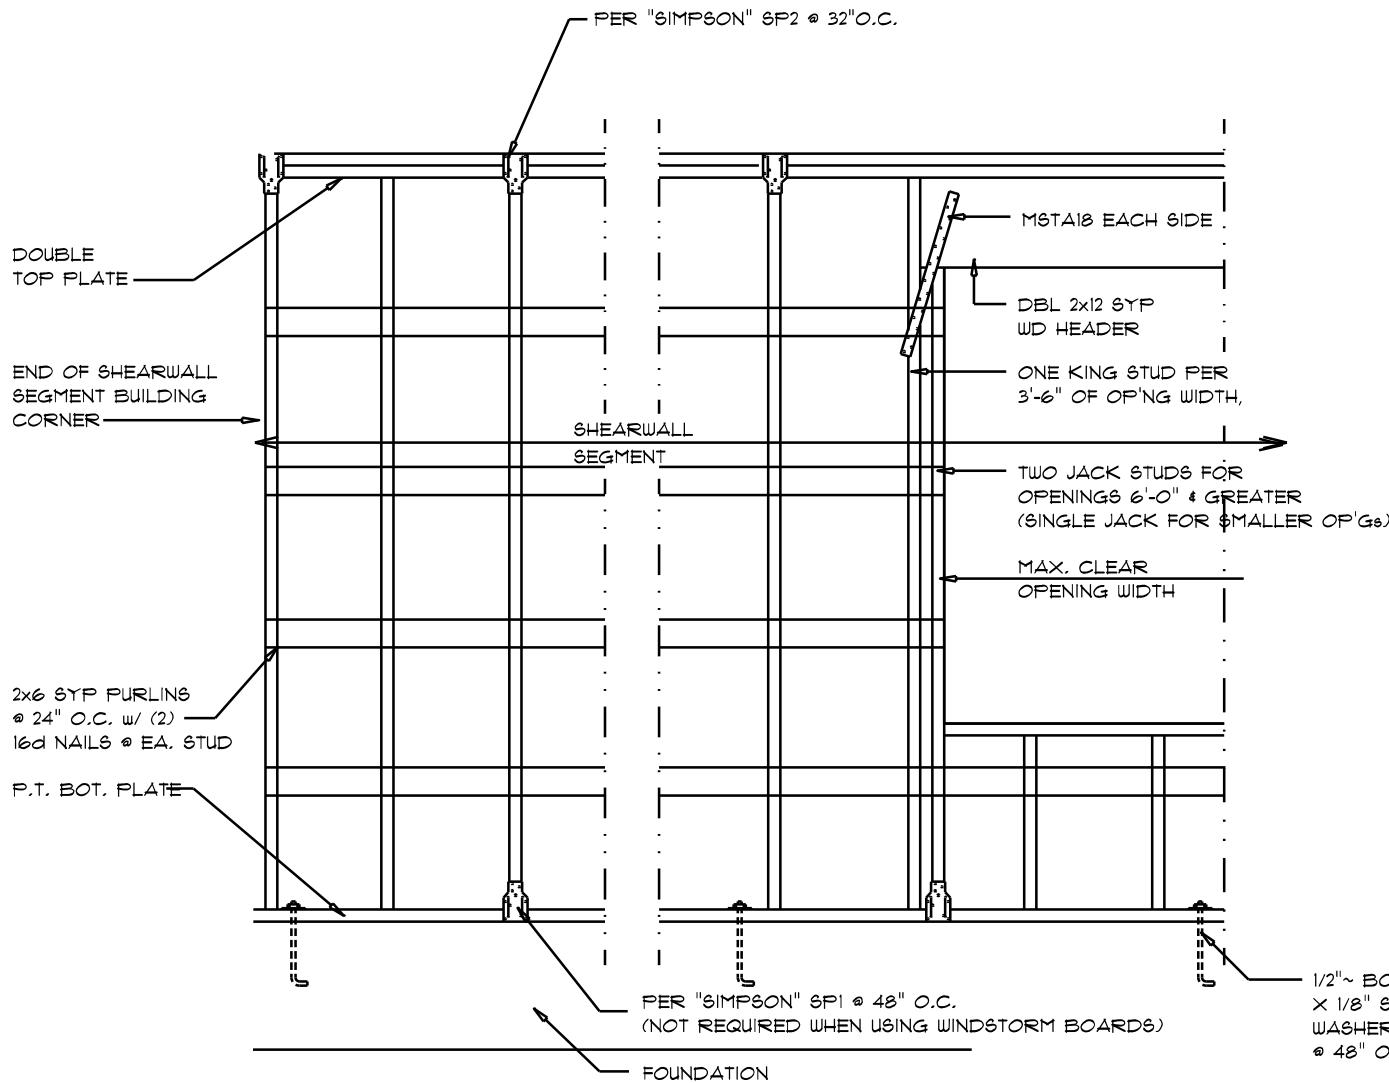

- SHEARWALL NOTES:**
- ALL SHEARWALLS SHALL BE TYPE 2 SHEARWALLS
 - THE WALL SHALL BE ENTIRELY SHEATHED WITH 7/16" WINDSTORM BD INCLUDING AREAS ABOVE AND BELOW OPENINGS
 - ALL SHEATHING SHALL BE ATTACHED TO FRAMING ALONG ALL FOUR EDGES WITH JOINTS FOR ADJACENT PANELS OCCURING OVER COMMON FRAMING MEMBERS OR ALONG BLOCKING
 - NAIL SPACING SHALL BE 6" O.C. EDGES AND 12" O.C. IN THE FIELD
 - TYPE 2 SHEARWALLS ARE DESIGNED FOR THE OPENING IT CONTAINS. MAXIMUM HEIGHT OF OPENING SHALL BE 3/4 TIMES THE WALL HEIGHT. THE MINIMUM DISTANCE BETWEEN OPENINGS SHALL BE THE WALL HEIGHT/3.5 FOR 8'-0" WALLS (2'-3")

OPENING WIDTH	SILL PLATES	16d TOE NAILS EACH END
UP TO 6'-0"	(1) 2x4 OR (1) 2x6	1
3'-6" TO 9'-0"	(3) 2x4 OR (1) 2x6	2
9'-0" TO 12'-0"	(5) 2x4 OR (2) 2x6	3

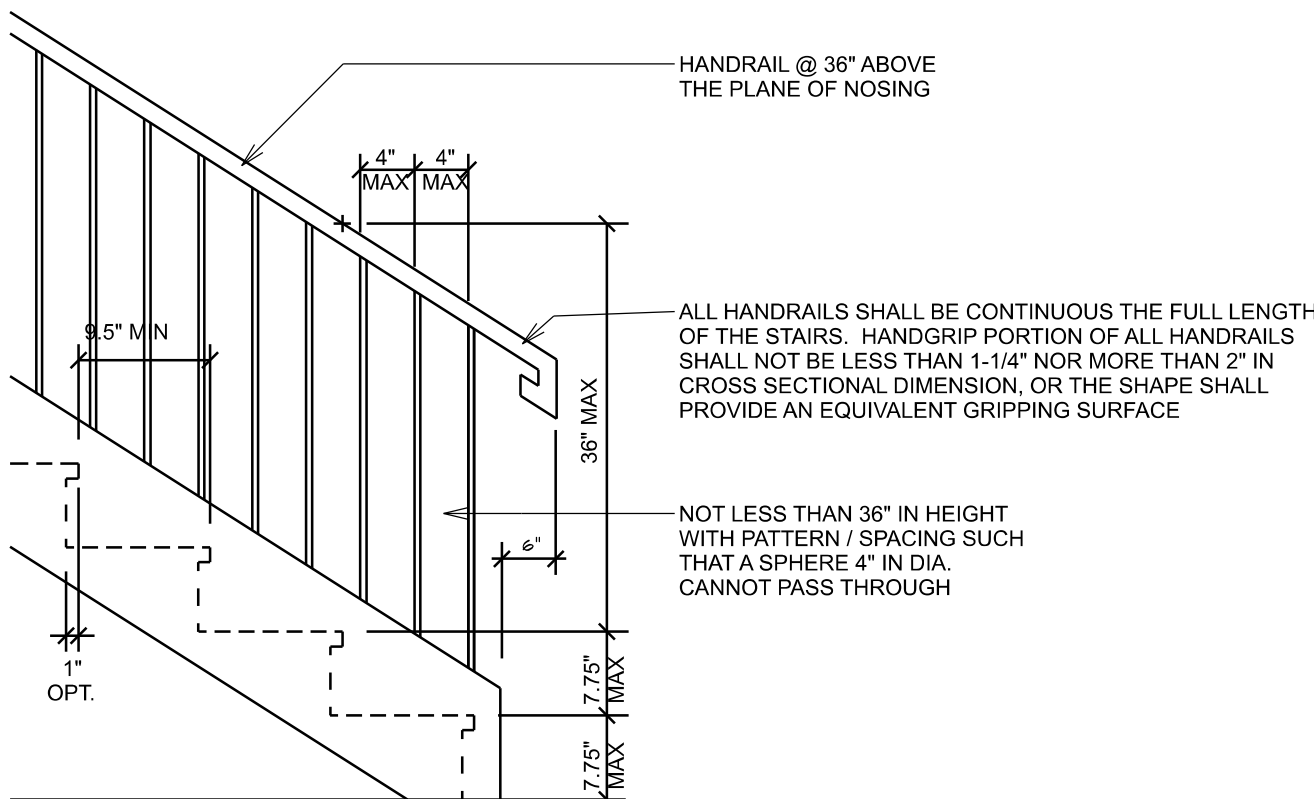

TYPICAL STAIR DETAIL
SCALE: NOT TO SCALE

STAIR / BALUSTER STYLES ARE DIAGRAMMATIC ONLY - CONTRACTOR TO COORDINATE STYLES WITH OWNER / FINISHES

FLORIDA BUILDING CODE

Compliance Summary

TYPE OF CONSTRUCTION

Roof: Gable Construction, Steel Trusses @ 12'-0" O.C.
Walls: 2x6 Wood Studs @ 16" O.C.
Floor: 4" Thk. Concrete Slab W/ Fibermesh Concrete Additive
Foundation: Continuous Footer/Steam Wall

ROOF DECKING

Material: 26 ga. Metal Sheet
Sheet Size: 36" Wide Sheets Perpendicular to Roof Framing
Fasteners: #12-14 x 1-1/4" Self-drilling Screws with washers. Corrosion resistant.

SHEARWALLS

Material: 26 ga. Metal Sheet
Sheet Size: 36" Sheets Placed Vertical
Fasteners: #12-14 x 1-1/4" Self-drilling Screws with washers. Corrosion resistant.
Furlings: 2x6 Wood Furlins @ 24" O.C.
Wall Studs: 2x6 Studs @ 16" O.C.

HURRICANE UPLIFT CONNECTORS

Truss Anchors: 3 - 1/2" dia. carriage thru bolts with nut & washer (typ)
Wall Tension: Metal Panel screwing is Adequate - #12-14 screws @ 4" O.C. Top & Bot.
Anchor Bolts: 1/2" A307 Bolts @ 48" O.C. - 1st Bolt 16" from corner

FOOTINGS AND FOUNDATIONS

Footing A: 18" dia x 18" w Cont. W/ 6 - #5 Bars Cont.
Footing B: 12" dia x 12" w Cont. W/ 2 - #5 Bars Cont.

STRUCTURAL DESIGN CRITERIA:

1. THE DESIGN COMPLIES WITH THE REQUIREMENTS OF THE 2020 FLORIDA BUILDING CODE - SECTION 1609 AND OTHER REFERENCED CODES AND SPECIFICATIONS. ALL CODES AND SPECIFICATIONS SHALL BE LATEST EDITION AT TIME OF PERMIT.

2. WIND LOAD CRITERIA: RISK CATEGORY: 2, EXPOSURE: "B"

BASED ON ANSI/ASCE 7-10, 2020 FBC 1609-4 WIND VELOCITY: V_{ULT} = 130 MPH
V_{ASCE} = 101 MPH

3. ROOF DESIGN LOADS:
SUPERIMPOSED DEAD LOADS: 20 PSF
SUPERIMPOSED LIVE LOADS: 20 PSF

4. FLOOR DESIGN LOADS:
SUPERIMPOSED DEAD LOADS: 25 PSF
SUPERIMPOSED LIVE LOADS:
RESIDENTIAL 40 PSF
BALCONIES 60 PSF

5. WIND NET UPLIFT: ARE AS INDICATED ON PLANS

TERMITE PROTECTION NOTES:

SOIL CHEMICAL BARRIER METHOD:

1. A PERMANENT SIGN WHICH IDENTIFIES THE TERMITE TREATMENT PROVIDER AND NEED FOR REINSPECTION AND TREATMENT CONTRACT RENEWAL SHALL BE PROVIDED. THE SIGN SHALL BE POSTED NEAR THE WATER HEATER OR ELECTRIC PANEL. FBC 104.2.6

2. CONDENSATE AND ROOF DOWNSPOUTS SHALL DISCHARGE AT LEAST 1'-0" AWAY FROM BUILDING SIDE WALLS. FBC 1503.4.4

3. IRRIGATION/SPRINKLER SYSTEMS INCLUDING ALL RISERS AND SPRAY HEADS SHALL NOT BE INSTALLED WITHIN 1'-0" FROM BUILDING SIDE WALLS. FBC 1503.4.4

4. TO PROVIDE FOR INSPECTION FOR TERMITE INFESTATION, BETWEEN WALL COVERINGS AND FINAL EARTH GRADE SHALL NOT BE LESS THAN 6".
EXCEPTION: PAINT AND DECORATIVE CEMENTIOUS FINISH LESS THAN 5/8" THICK ADHERED DIRECTLY TO THE FOUNDATION WALL. FBC 1403.1.6

5. INITIAL TREATMENT SHALL BE DONE AFTER ALL EXCAVATION AND BACKFILL IS COMPLETE. FBC 1016.1.1

6. SOIL DISTURBED AFTER THE INITIAL TREATMENT SHALL BE RETREATED INCLUDING SPACES BOXED OR FORMED. FBC 1016.1.2

7. BOXED AREAS IN CONCRETE FLOOR FOR SUBSEQUENT INSTALLATION OF TRAPS, ETC., SHALL BE MADE WITH PERMANENT METAL OR PLASTIC FORMS. PERMANENT FORMS MUST BE OF A SIZE AND DEPTH THAT WILL ELIMINATE THE DISTURBANCE OF SOIL AFTER THE INITIAL TREATMENT. FBC 1016.1.3

8. MINIMUM 6 MIL VAPOR RETARDER MUST BE INSTALLED TO PROTECT AGAINST RAINFALL DILUTION. IF RAINFALL OCCURS BEFORE VAPOR RETARDER PLACEMENT, RETREATMENT IS REQUIRED. FBC 1016.1.4

9. CONCRETE OVERPOUR AND MORTAR ALONG THE FOUNDATION PERIMETER MUST BE REMOVED BEFORE EXTERIOR SOIL TREATMENT. FBC 1016.1.5

10. SOIL TREATMENT MUST BE APPLIED UNDER ALL EXTERIOR CONCRETE OR GRADE WITHIN 1'-0" OF THE STRUCTURE SIDEWALLS. FBC 1016.1.6

11. AN EXTERIOR VERTICAL CHEMICAL BARRIER MUST BE INSTALLED AFTER CONSTRUCTION IS COMPLETE INCLUDING LANDSCAPING AND IRRIGATION. ANY SOIL DISTURBED AFTER THE VERTICAL BARRIER IS APPLIED, SHALL BE RETREATED. FBC 1016.1.6

12. ALL BUILDINGS ARE REQUIRED TO HAVE PRE-CONSTRUCTION TREATMENT. FBC 1016.1.1


13. A CERTIFICATE OF COMPLIANCE MUST BE ISSUED TO THE BUILDING DEPARTMENT BY: * LICENSED PEST CONTROL COMPANY BEFORE A CERTIFICATE OF OCCUPANCY WILL BE ISSUED. THE CERTIFICATE OF COMPLIANCE SHALL STATE: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. THE TREATMENT IS IN ACCORDANCE WITH THE RULES AND LAWS OF THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES". FBC 1016.1.1

14. AFTER ALL WORK IS COMPLETED, LOOSE WOOD AND FILL MUST BE REMOVED FROM BELOW AND WITHIN 1'-0" OF THE BUILDING. THIS INCLUDES ALL GRADE STAKES, TUB TRAP BOXES, FORMS, SHORING OR OTHER CELLULOSE CONTAINING MATERIAL. FBC 2303.1.3


15. NO WOOD, VEGETATION, STUMPS, CARDBOARD, TRASH, ETC., SHALL BE BURIED WITHIN 15'-0" OF ANY BUILDING OR PROPOSED BUILDING. FBC 2303.1.4

Shear Wall DETAILS


SCALE: NONE

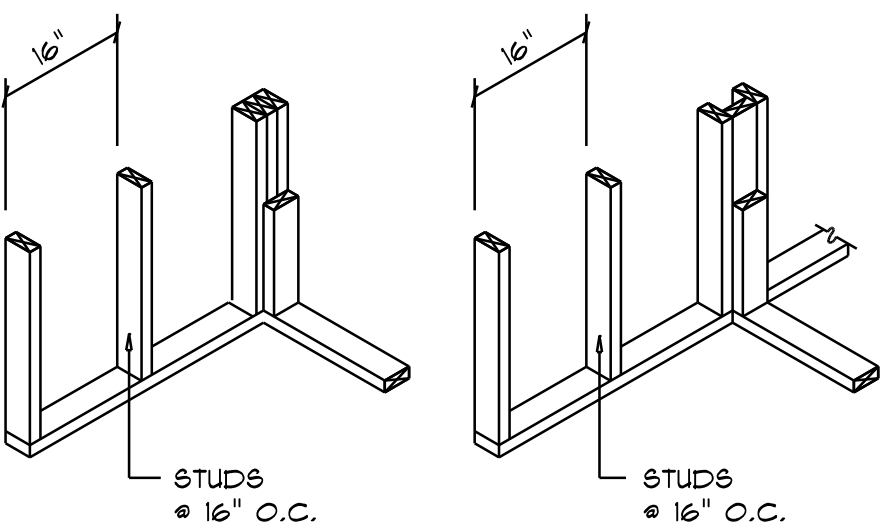


WALL CORNER WALL INTERSECTION

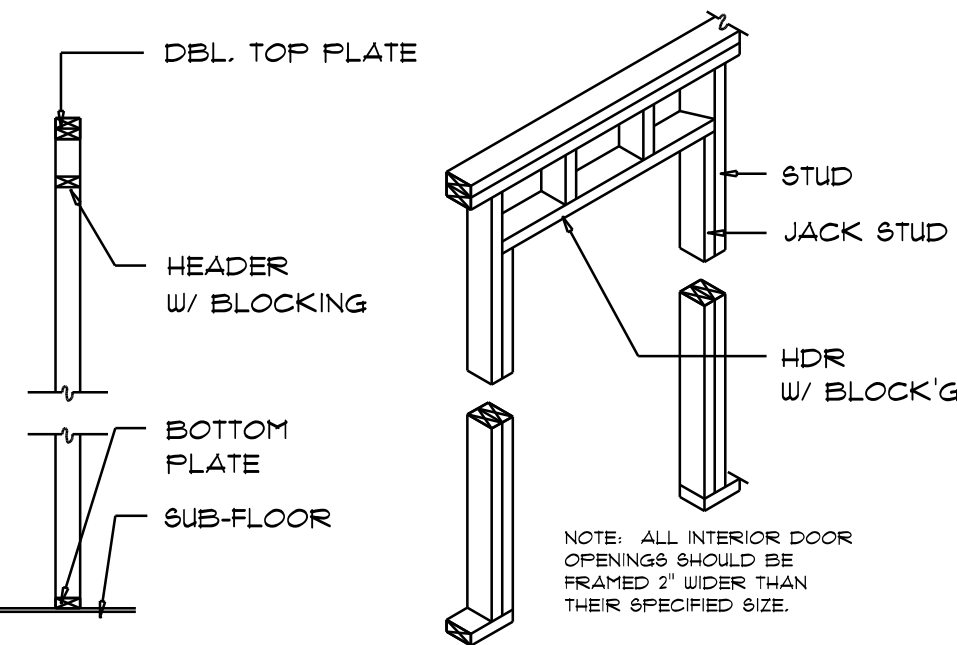

NON-BEARING WALL HEADER

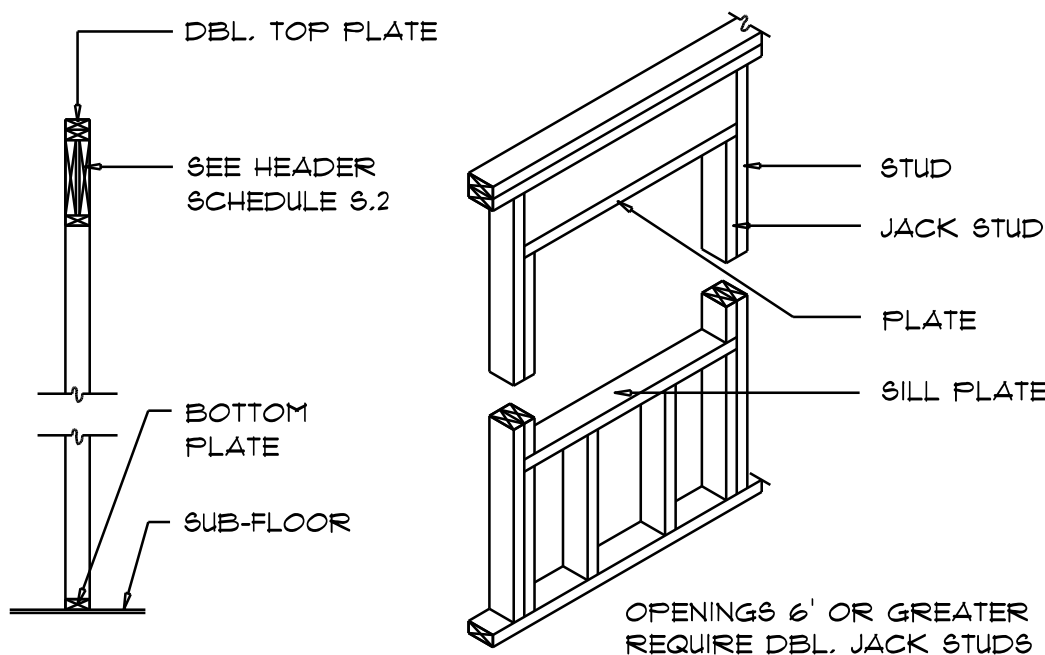

TYPICAL WINDOW HEADER

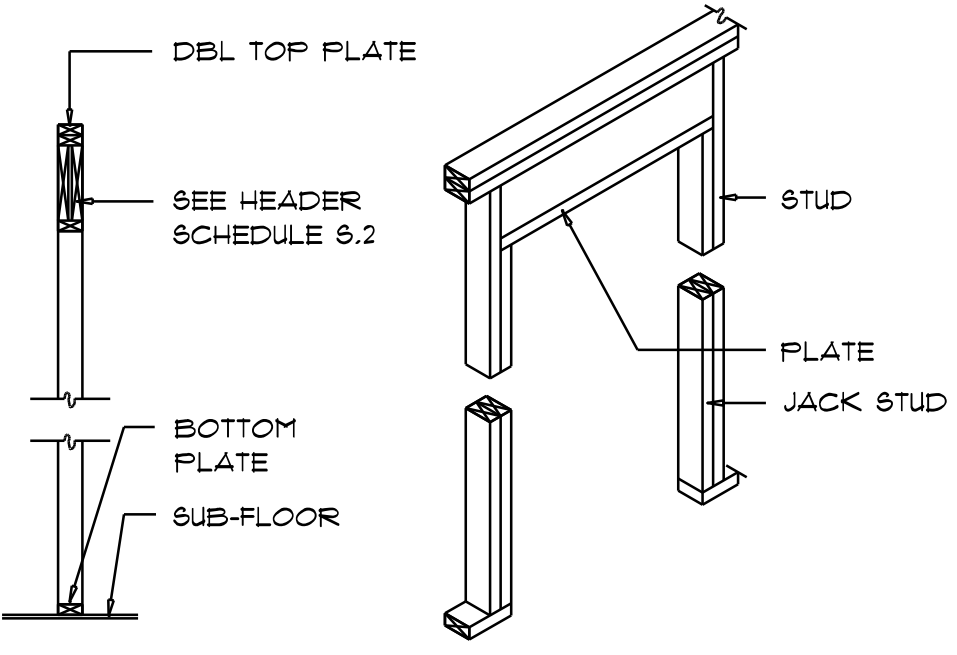


BEARING WALL HEADER

Wall Framing/Header DETAILS

SCALE: NONE

Fire Stopping DETAILS

SCALE: NONE

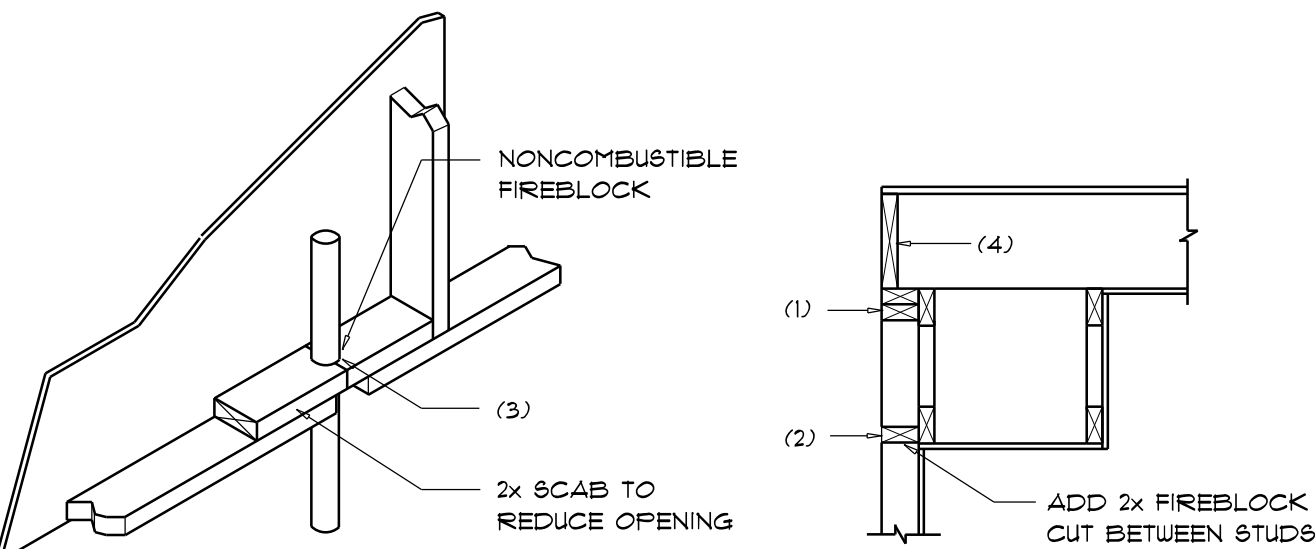

PENETRATIONS

FIREBLOCKING NOTES:

FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:

- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, COVE CEILINGS, ETC.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH "FYTROPANEL MULTIFLEX SEALANT"
- AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS, FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.