




FRONT ELEVATION
SCALE: 1/4" = 1'-0"



RIGHT ELEVATION
SCALE: 1/4" = 1'-0"

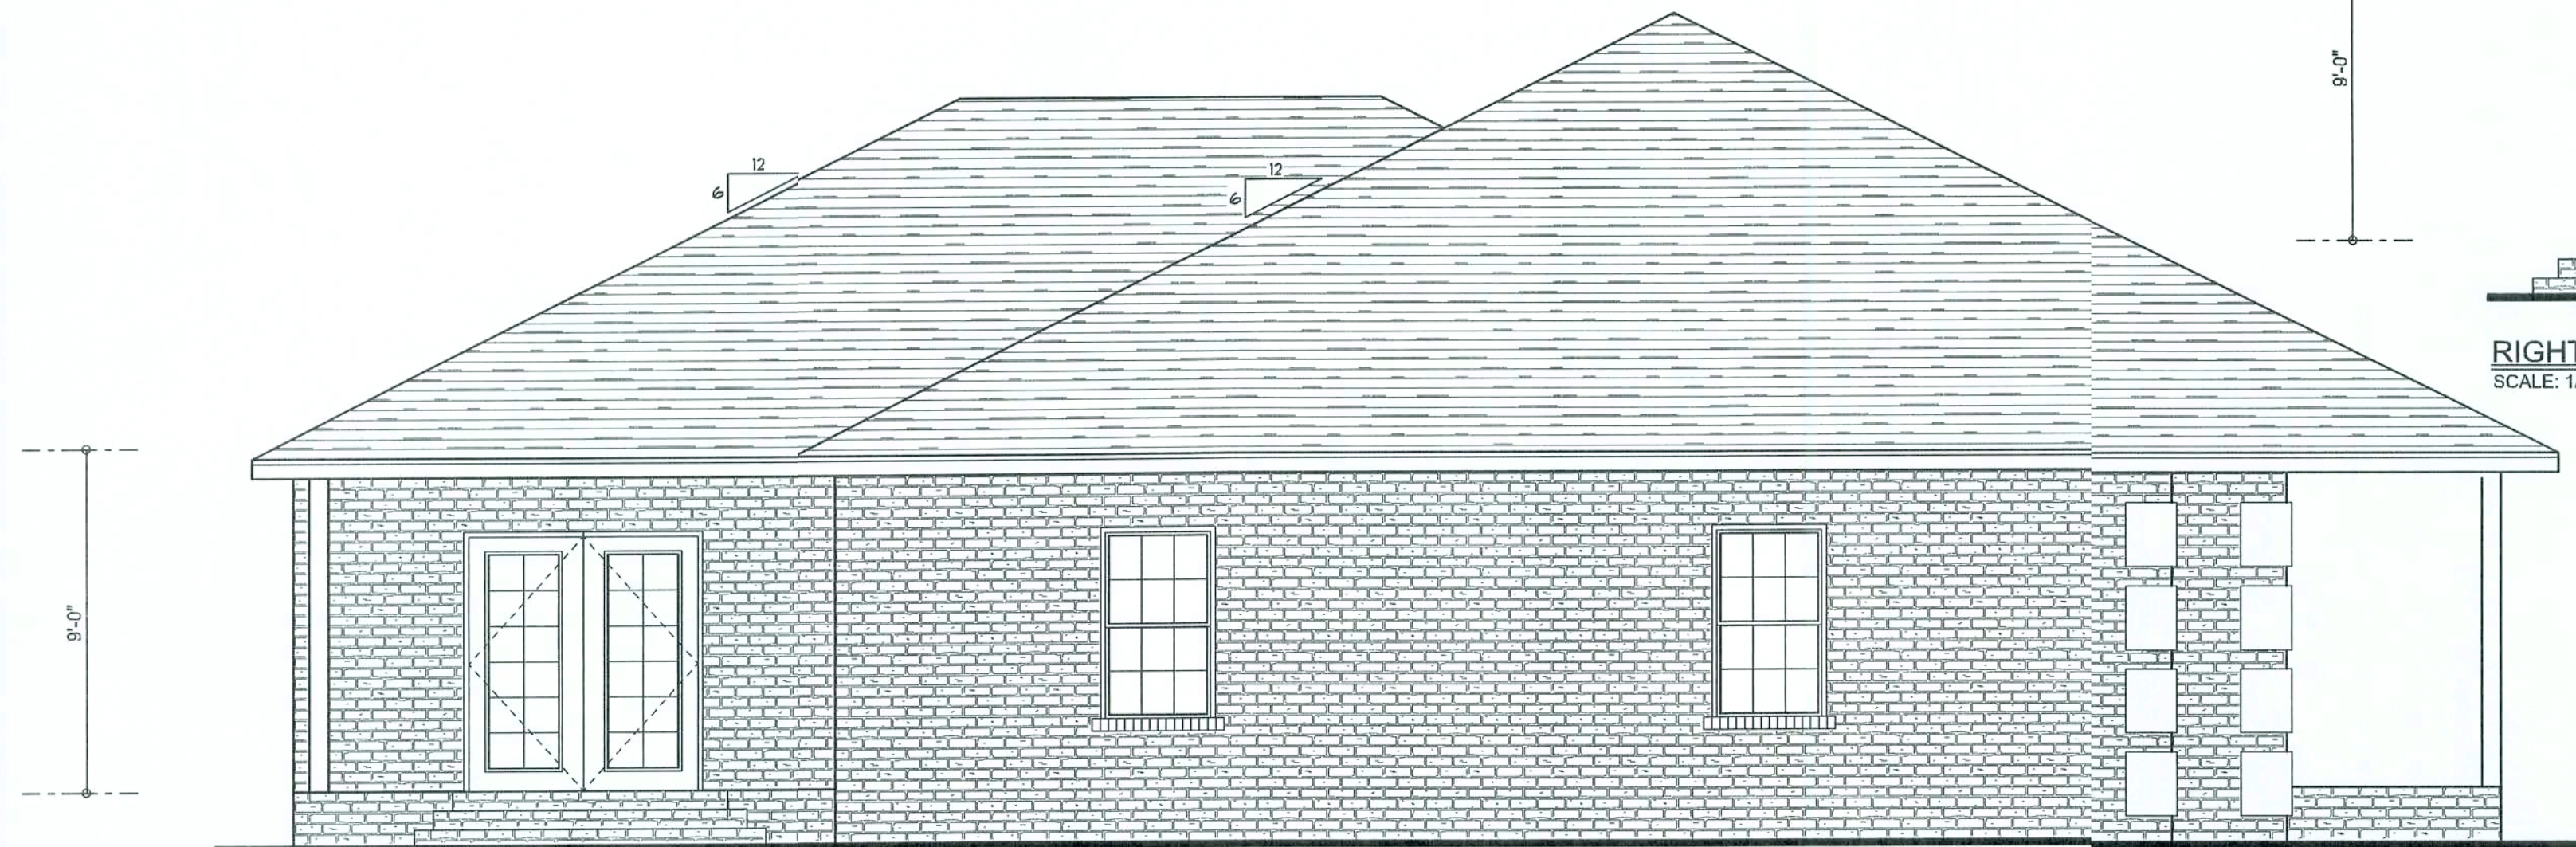

LEFT ELEVATION
SCALE: 1/4" = 1'-0"



REAR ELEVATION
SCALE: 1/4" = 1'-0"

REVISIONS	

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

REQUIRED ROOF VENTILATION:
AS PER FLORIDA BUILDING CODE 2308.7

RIDGE VENT
MIN. 50% TOTAL VENT AREA
LOCATED IN THE UPPER PORTION OF ATTIC (MIN. 3' ABOVE EAVE)
3312 S.F. / 300 x 50% = 55 S.F. RIDGE VENT AREA REQUIRED
50.1 FEET OF RIDGE VENT REQUIRED

SOFFIT VENT
3312 S.F. / 300 x 50% = 55 S.F. SOFFIT VENT AREA REQUIRED
183.3 FEET OF SOFFIT VENT REQUIRED

BUILDER MUST VERIFY THE FOLLOWING MINIMUM NET FREE VENT AREAS:

1. RIDGE VENTS = 16 IN²/FT (.11 FT²/FT)
2. OFF-RIDGE VENTS = 70 FT² PER 4' UNIT
3. SOFFIT VENTS = 4.3 IN²/FT (.03 FT²/FT)

WINDLOAD ENGINEER: Mark Disosway
P.E. No. 53915, POB 868, Lake City, FL
32065, 386-754-5419

DIMENSIONS:
Stated dimensions supercede scaled
dimensions. Refer all questions to
Mark Disosway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disosway, P.E. hereby expressly reserves
its common law copyrights and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first this express written
permission and consent of Mark Disosway.

CERTIFICATION: These plans and
"Windload Engineering", Sheet S-1, attached,
comply with Florida Building Code 2001,
Section 1606 wind loads, to the best of my
knowledge.

LIMITATION: This design is valid for one
building at specified location. In case of conflict,
structural requirements, scope of work, and
builder responsibilities on sheet S-1 control.

MARK DISOSWAY
P.E. 53915

WOODMAN PARK
BUILDERS

JOEL & SUSAN LAW
RESIDENCE

ADDRESS:
Deep Creek S/D
Columbia County, Florida

Mark Disosway P.E.
P.O. Box 868
Lake City, Florida 32025
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871
windloadengineer@bellsouth.net

PRINTED DATE:

July 25, 2005

DRAWN BY:
Ben Sparks

CHECKED BY:

DESIGNED BY:
Ben Sparks

FINALES DATE:
06 / Jul / 05

JOB NUMBER:
504252


DRAWING NUMBER

A-1


OF 5 SHEETS

REVISIONS	

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

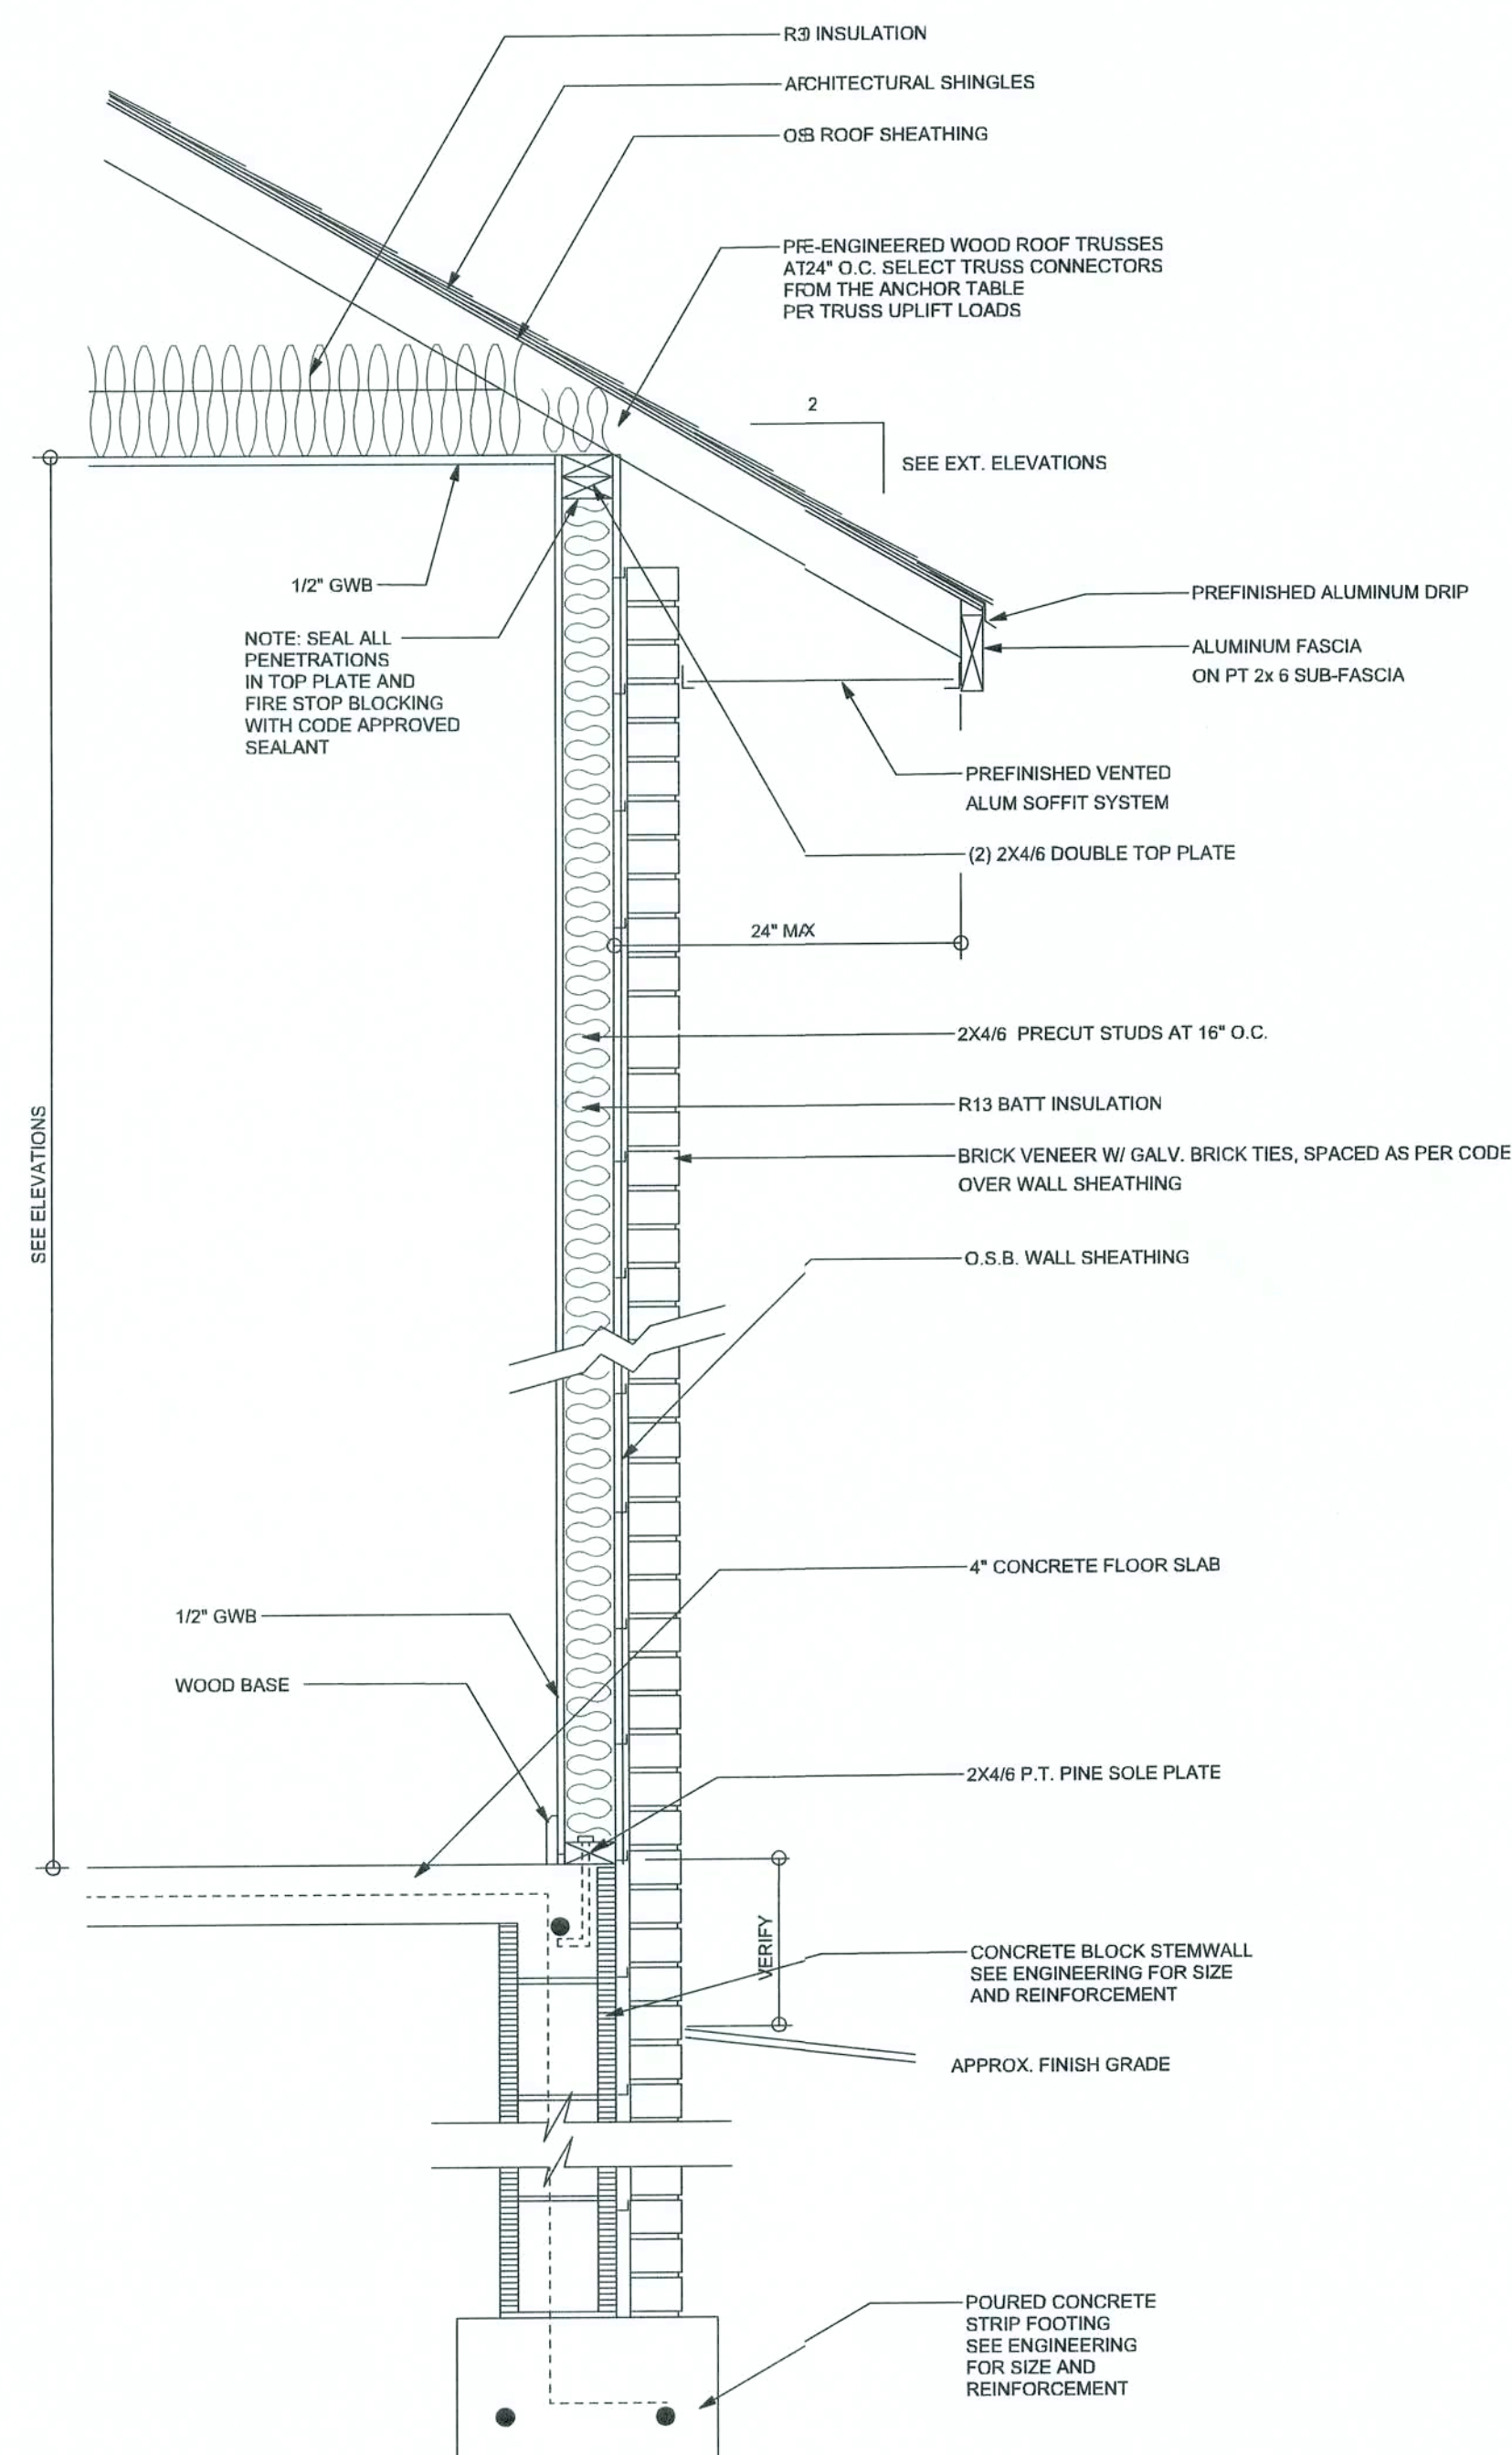

TYPICAL DESIGN WALL SECTION
NON - STRUCTURAL DATA
SCALE: 1/4\" = 1'-0"

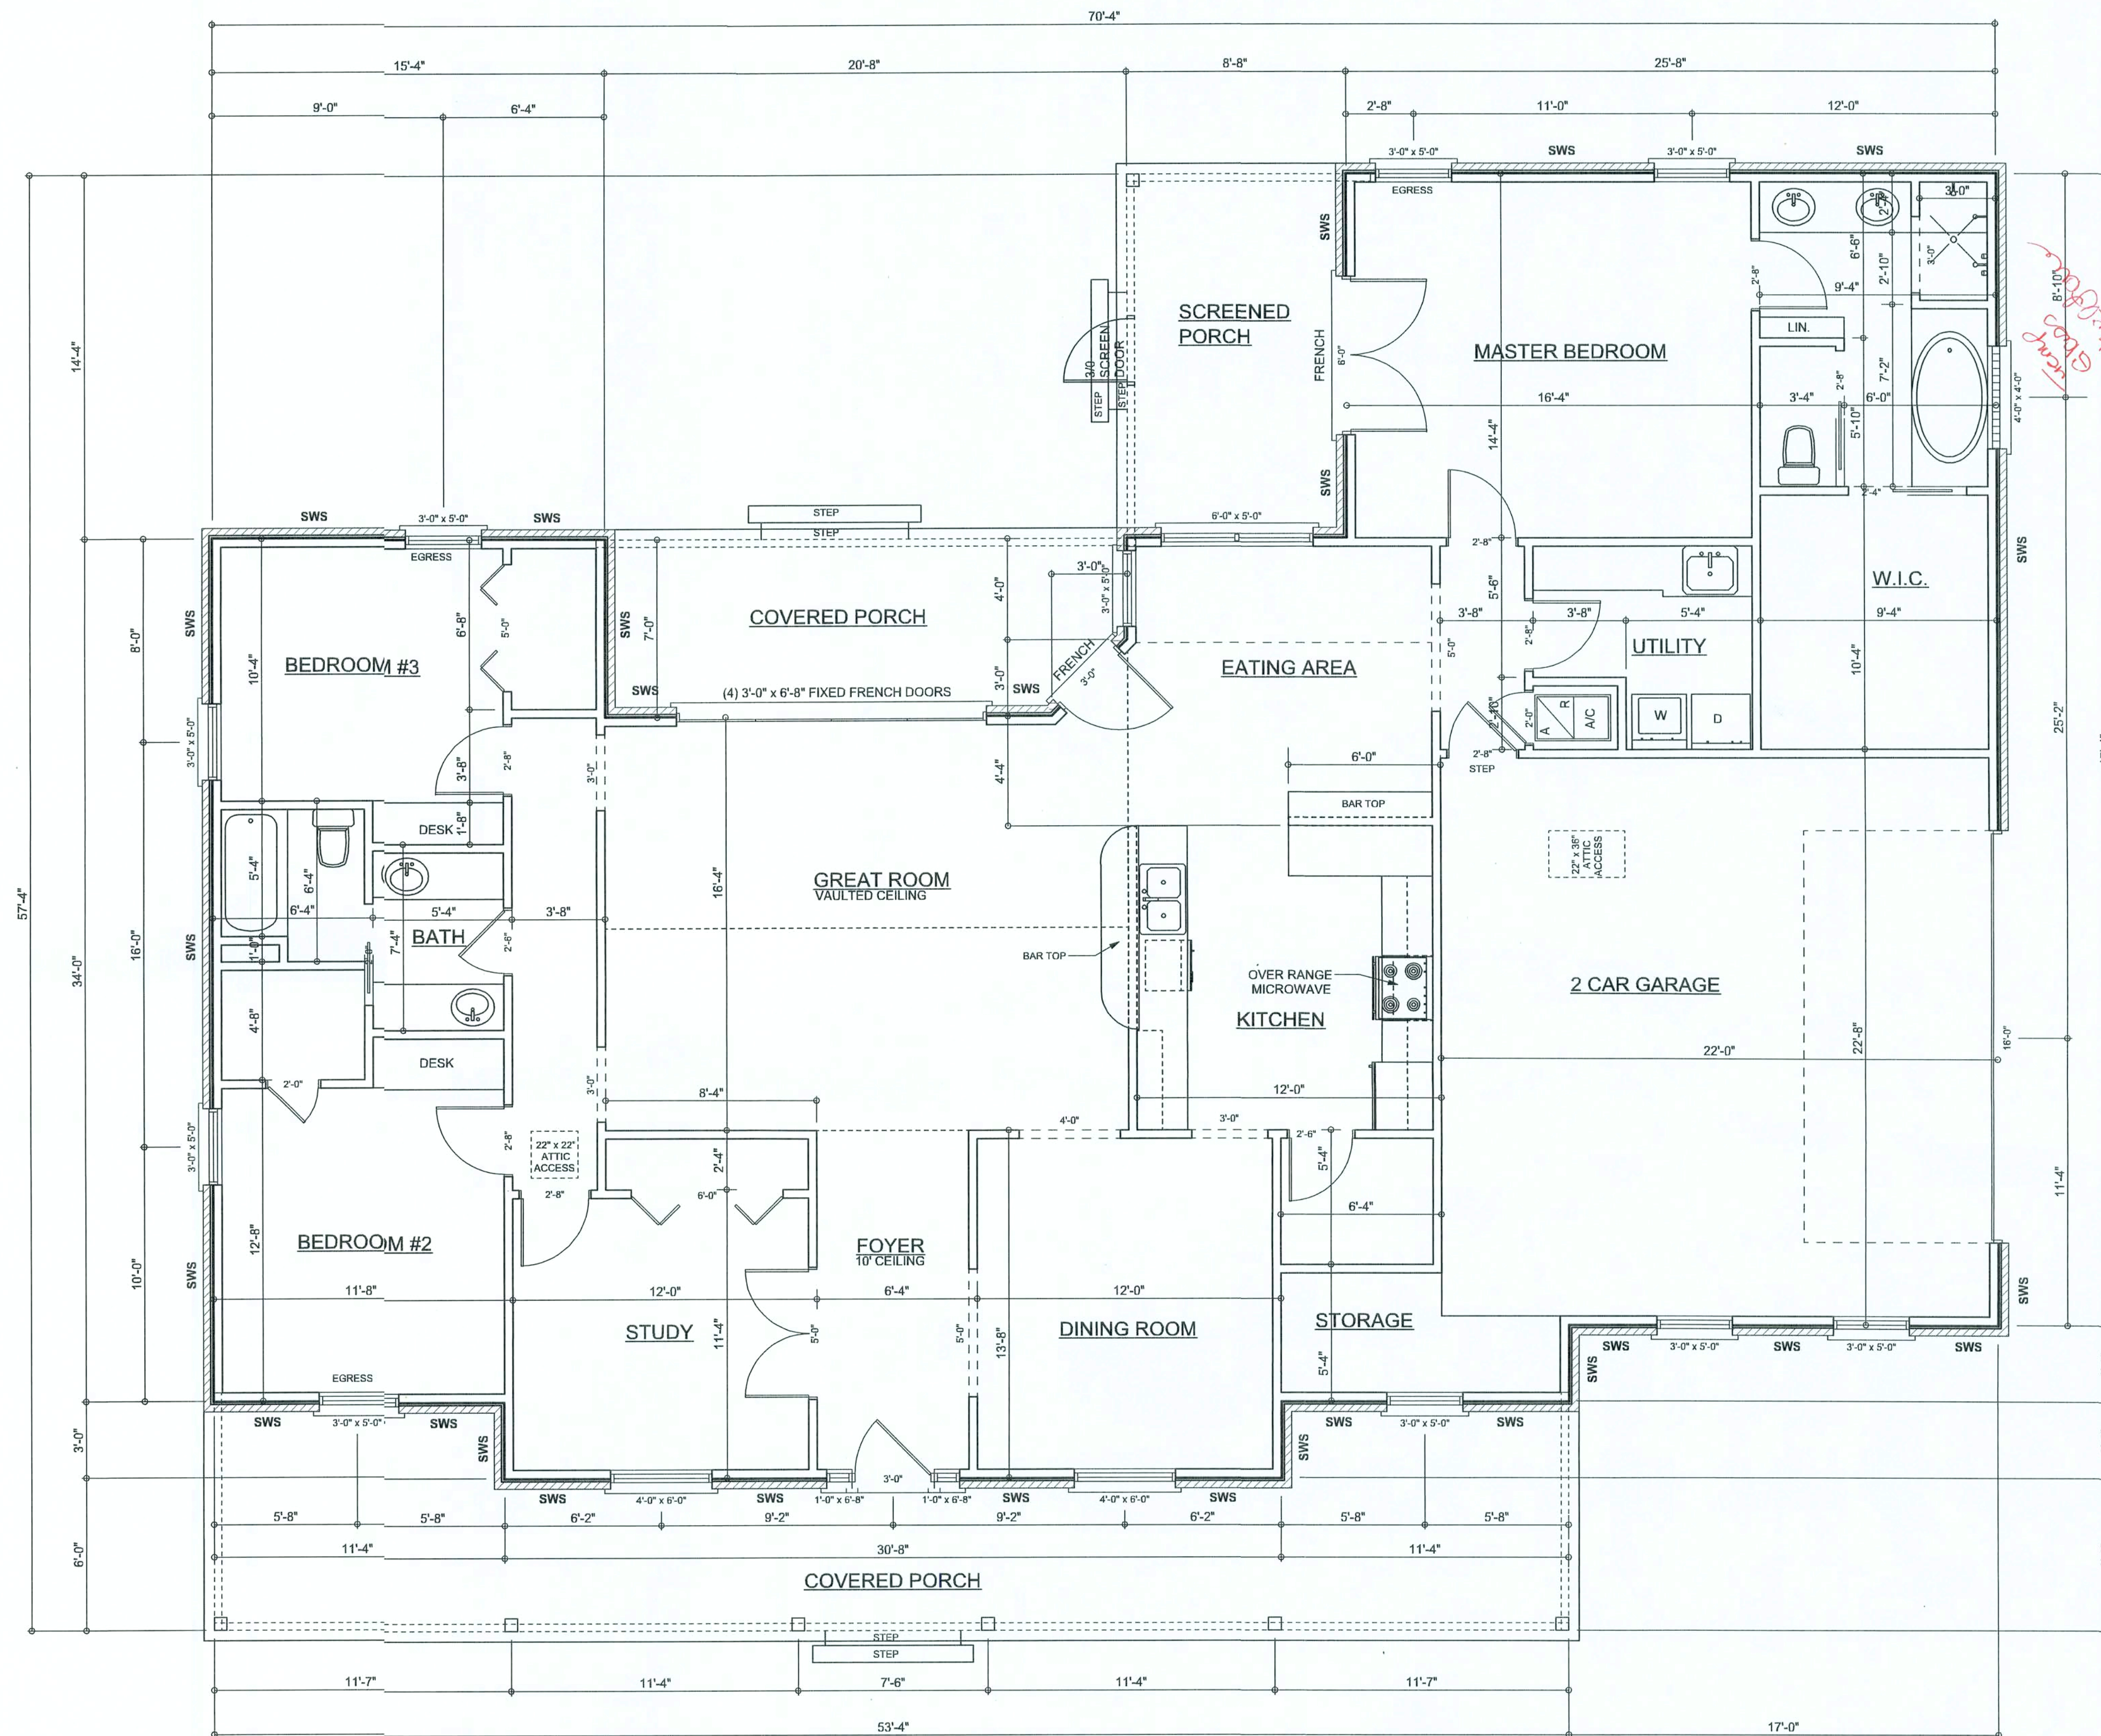

FLOOR PLAN
SCALE: 1/4\" = 1'-0"
ALL CEILING HEIGHTS TO BE 9'-0\" UNLESS NOTED OTHERWISE
SWS = SHEARWALL SEGMENTS

AREA SUMMARY

LIVING AREA	2122	S . F .
GARAGE AREA	538	S . F .
PORCH AREA	528	S . F .
SCREEN PORCH AREA	124	S . F .
TOTAL AREA	3312	S . F .

WINDLOAD ENGINEER: Mark Disoway,
PE No. 53915, P.O. Box 868, Lake City, FL
32056, 386-754-5419

DIMENSIONS:
Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: These plans and "Windload Engineering", Sheet S-1, attached, comply with Florida Building Code 2001, Section 1606 wind loads, to the best of my knowledge.

LIMITATION: This design is valid for one building at specified location. In case of conflict, structural requirements, scope of work, and builder responsibilities on sheet S-1 control.

MARK DISOWAY
P.E. 53915

Mark Disoway
25 JUL 05
SEAL

WOODMAN PARK BUILDERS

JOEL & SUSAN LAW RESIDENCE

ADDRESS:
Deep Creek S/D
Columbia County, Florida

Mark Disoway P.E.
P.O. Box 868
Lake City, Florida 32025
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871
windloadengineer@bellsouth.net

PRINTED DATE:
July 25, 2005

DRAWN BY: Ben Sparks
CHECKED BY:

DESIGNED BY:
Ben Sparks

FINALES DATE:
06 / Jul / 05

JOB NUMBER:
504252


DRAWING NUMBER

A-2

OF 5 SHEETS

REVISIONS

SOFTPLAN
ARCHITECTURAL DESIGN SOFTWARE

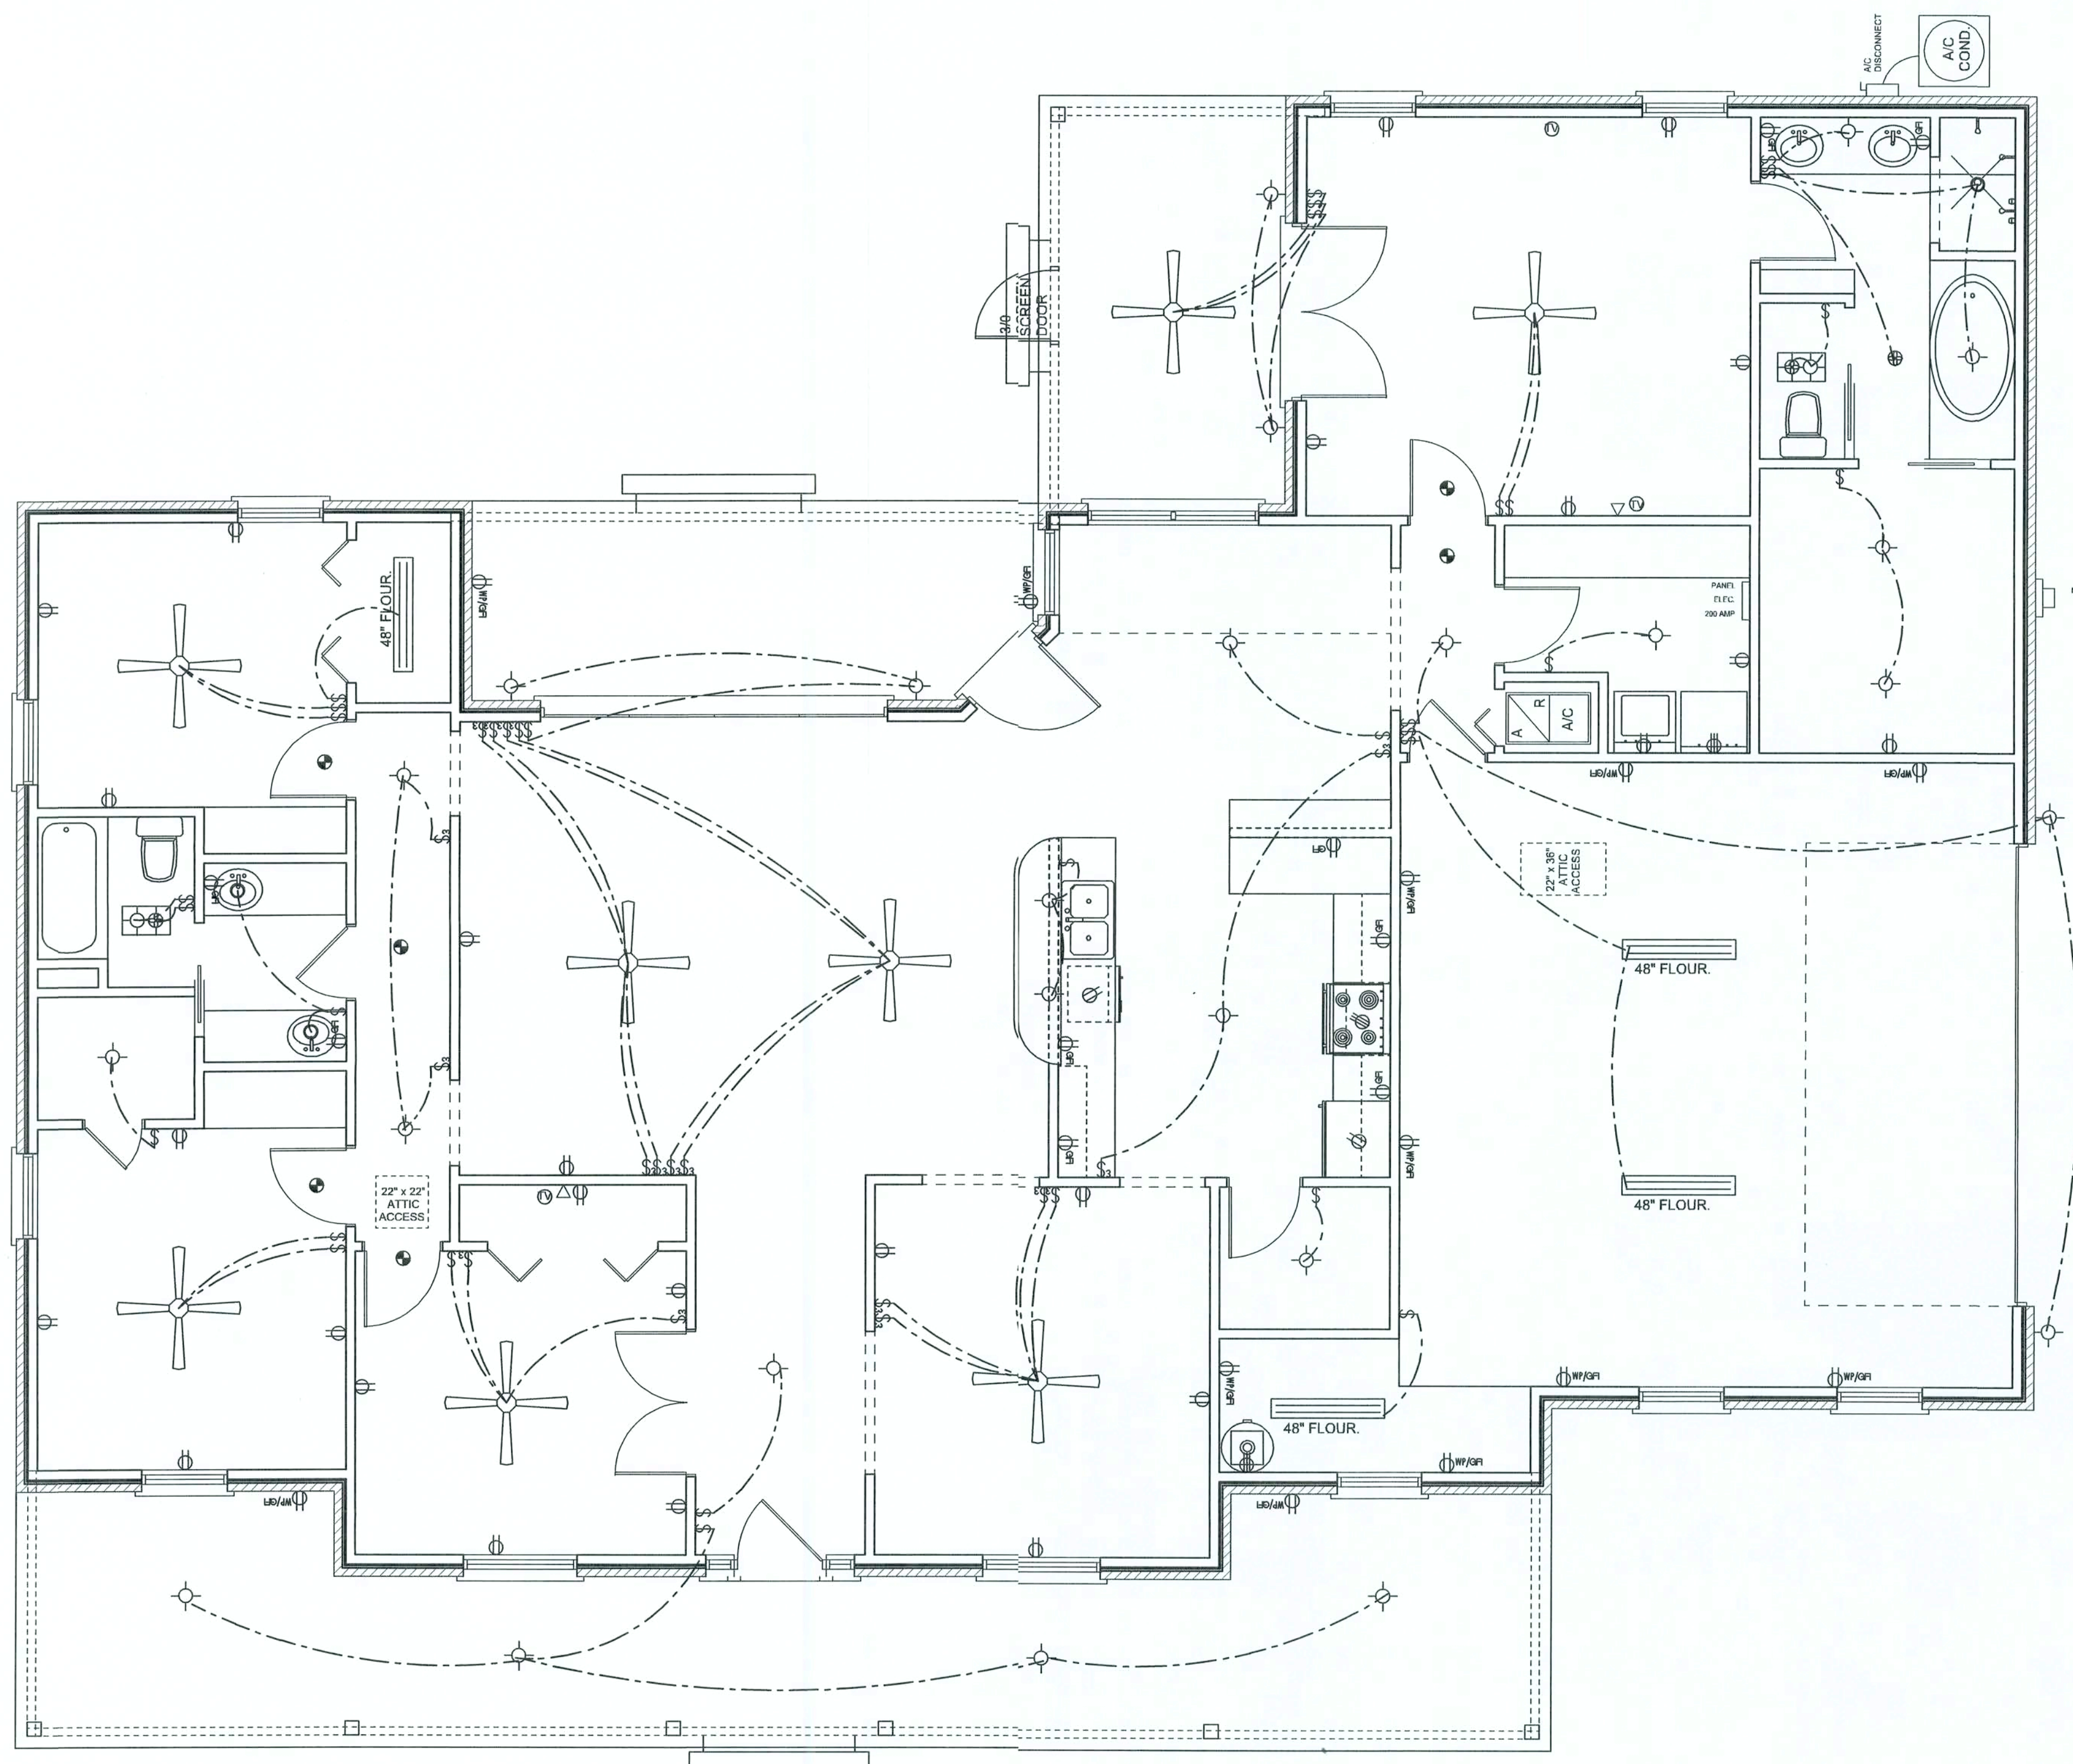

ELECTRICAL PLAN NOTES

- E-1 WIRE ALL APPLIANCES, HVAC UNITS AND OTHER EQUIPMENT PER MANUF. SPECIFICATIONS.
- E-2 CONSULT THE OWNER FOR THE NUMBER OF SEPARATE TELEPHONE LINES TO BE INSTALLED.
- E-3 ALL INSTALLATIONS SHALL BE PER NAT'L. ELECTRIC CODE.
- E-4 ALL SMOKE DETECTORS SHALL BE 120V W/ BATTERY BACKUP OF THE PHOTOELECTRIC TYPE, AND SHALL BE INTERLOCKED TOGETHER. INSTALL INSIDE AND NEAR ALL BEDROOMS.
- E-5 TELEPHONE, TELEVISION AND OTHER LOW VOLTAGE DEVICES OR OUTLETS SHALL BE AS PER THE OWNER'S DIRECTIONS, & IN ACCORDANCE W/ APPLICABLE SECTIONS OF NEC-LATEST EDITION.
- E-6 ELECTRICAL CONTR SHALL BE RESPONSIBLE FOR THE DESIGN & SIZING OF ELECTRICAL SERVICE AND CIRCUITS.
- E-7 ENTRY OF SERVICE (UNDERGROUND OR OVERHEAD) TO BE DETERMINED BY POWER COMPANY.
- E-8 ALL BEDROOM RECEPTACLES SHALL BE AFCI (ARC FAULT CIRCUIT INTERRUPT)
- E-9 ALL OUTLETS TO BE LOCATED ABOVE BASE FLOOR ELEVATION

2" PVC
3/4" RCP
36" Sweep

ELECTRICAL LEGEND	
	CEILING FAN (PRE-WIRE FOR LIGHT KIT)
	DOUBLE SECURITY LIGHT
	2X4 FLUORESCENT LIGHT FIXTURE
	RECESSED CAN LIGHT
	BATH EXHAUST FAN WITH LIGHT
	BATH EXHAUST FAN
	LIGHT FIXTURE
	DUPLEX OUTLET
	220v OUTLET
	GFI DUPLEX OUTLET
	SMOKE DETECTOR
	WALL SWITCH
	3 WAY WALL SWITCH
	4 WAY WALL SWITCH
	WATER PROOF GFI OUTLET
	PHONE JACK
	TELEVISION JACK
	GARAGE DOOR OPENER
	WALL HEATER

WINLOAD ENGINEER: Mark Disoway,
P.E. No. 53915, P.O. Box 868, Lake City, FL
32055, 386-754-5419

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION: These plans and "Winload Engineering", Sheet S-1, attached, comply with Florida Building Code 2001, Section 1605 wind loads, to the best of my knowledge.

LIMITATION: This design is valid for one building at specified location. In case of conflict, structural requirements, scope of work, and builder responsibilities on sheet S-1 control.

MARK DISOWAY
P.E. 53915

Mark Disoway
5/5/05
SEAL

WOODMAN PARK
BUILDERS

JOEL & SUSAN LAW
RESIDENCE

ADDRESS:
Deep Creek S/D
Columbia County, Florida

Mark Disoway P.E.
P.O. Box 868
Lake City, Florida 32025
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871
winloadengr@bellsouth.net

PRINTED DATE:
July 25, 2005

DRAWN BY:
Ben Sparks

CHECKED BY:

DESIGNED BY:
Ben Sparks

FINALS DATE:
06 / Jul / 05

JOB NUMBER:
504252


DRAWING NUMBER

A-3

OF 5 SHEETS

ELECTRICAL PLAN
SCALE 1/4" = 1'-0"

REVISIONS	

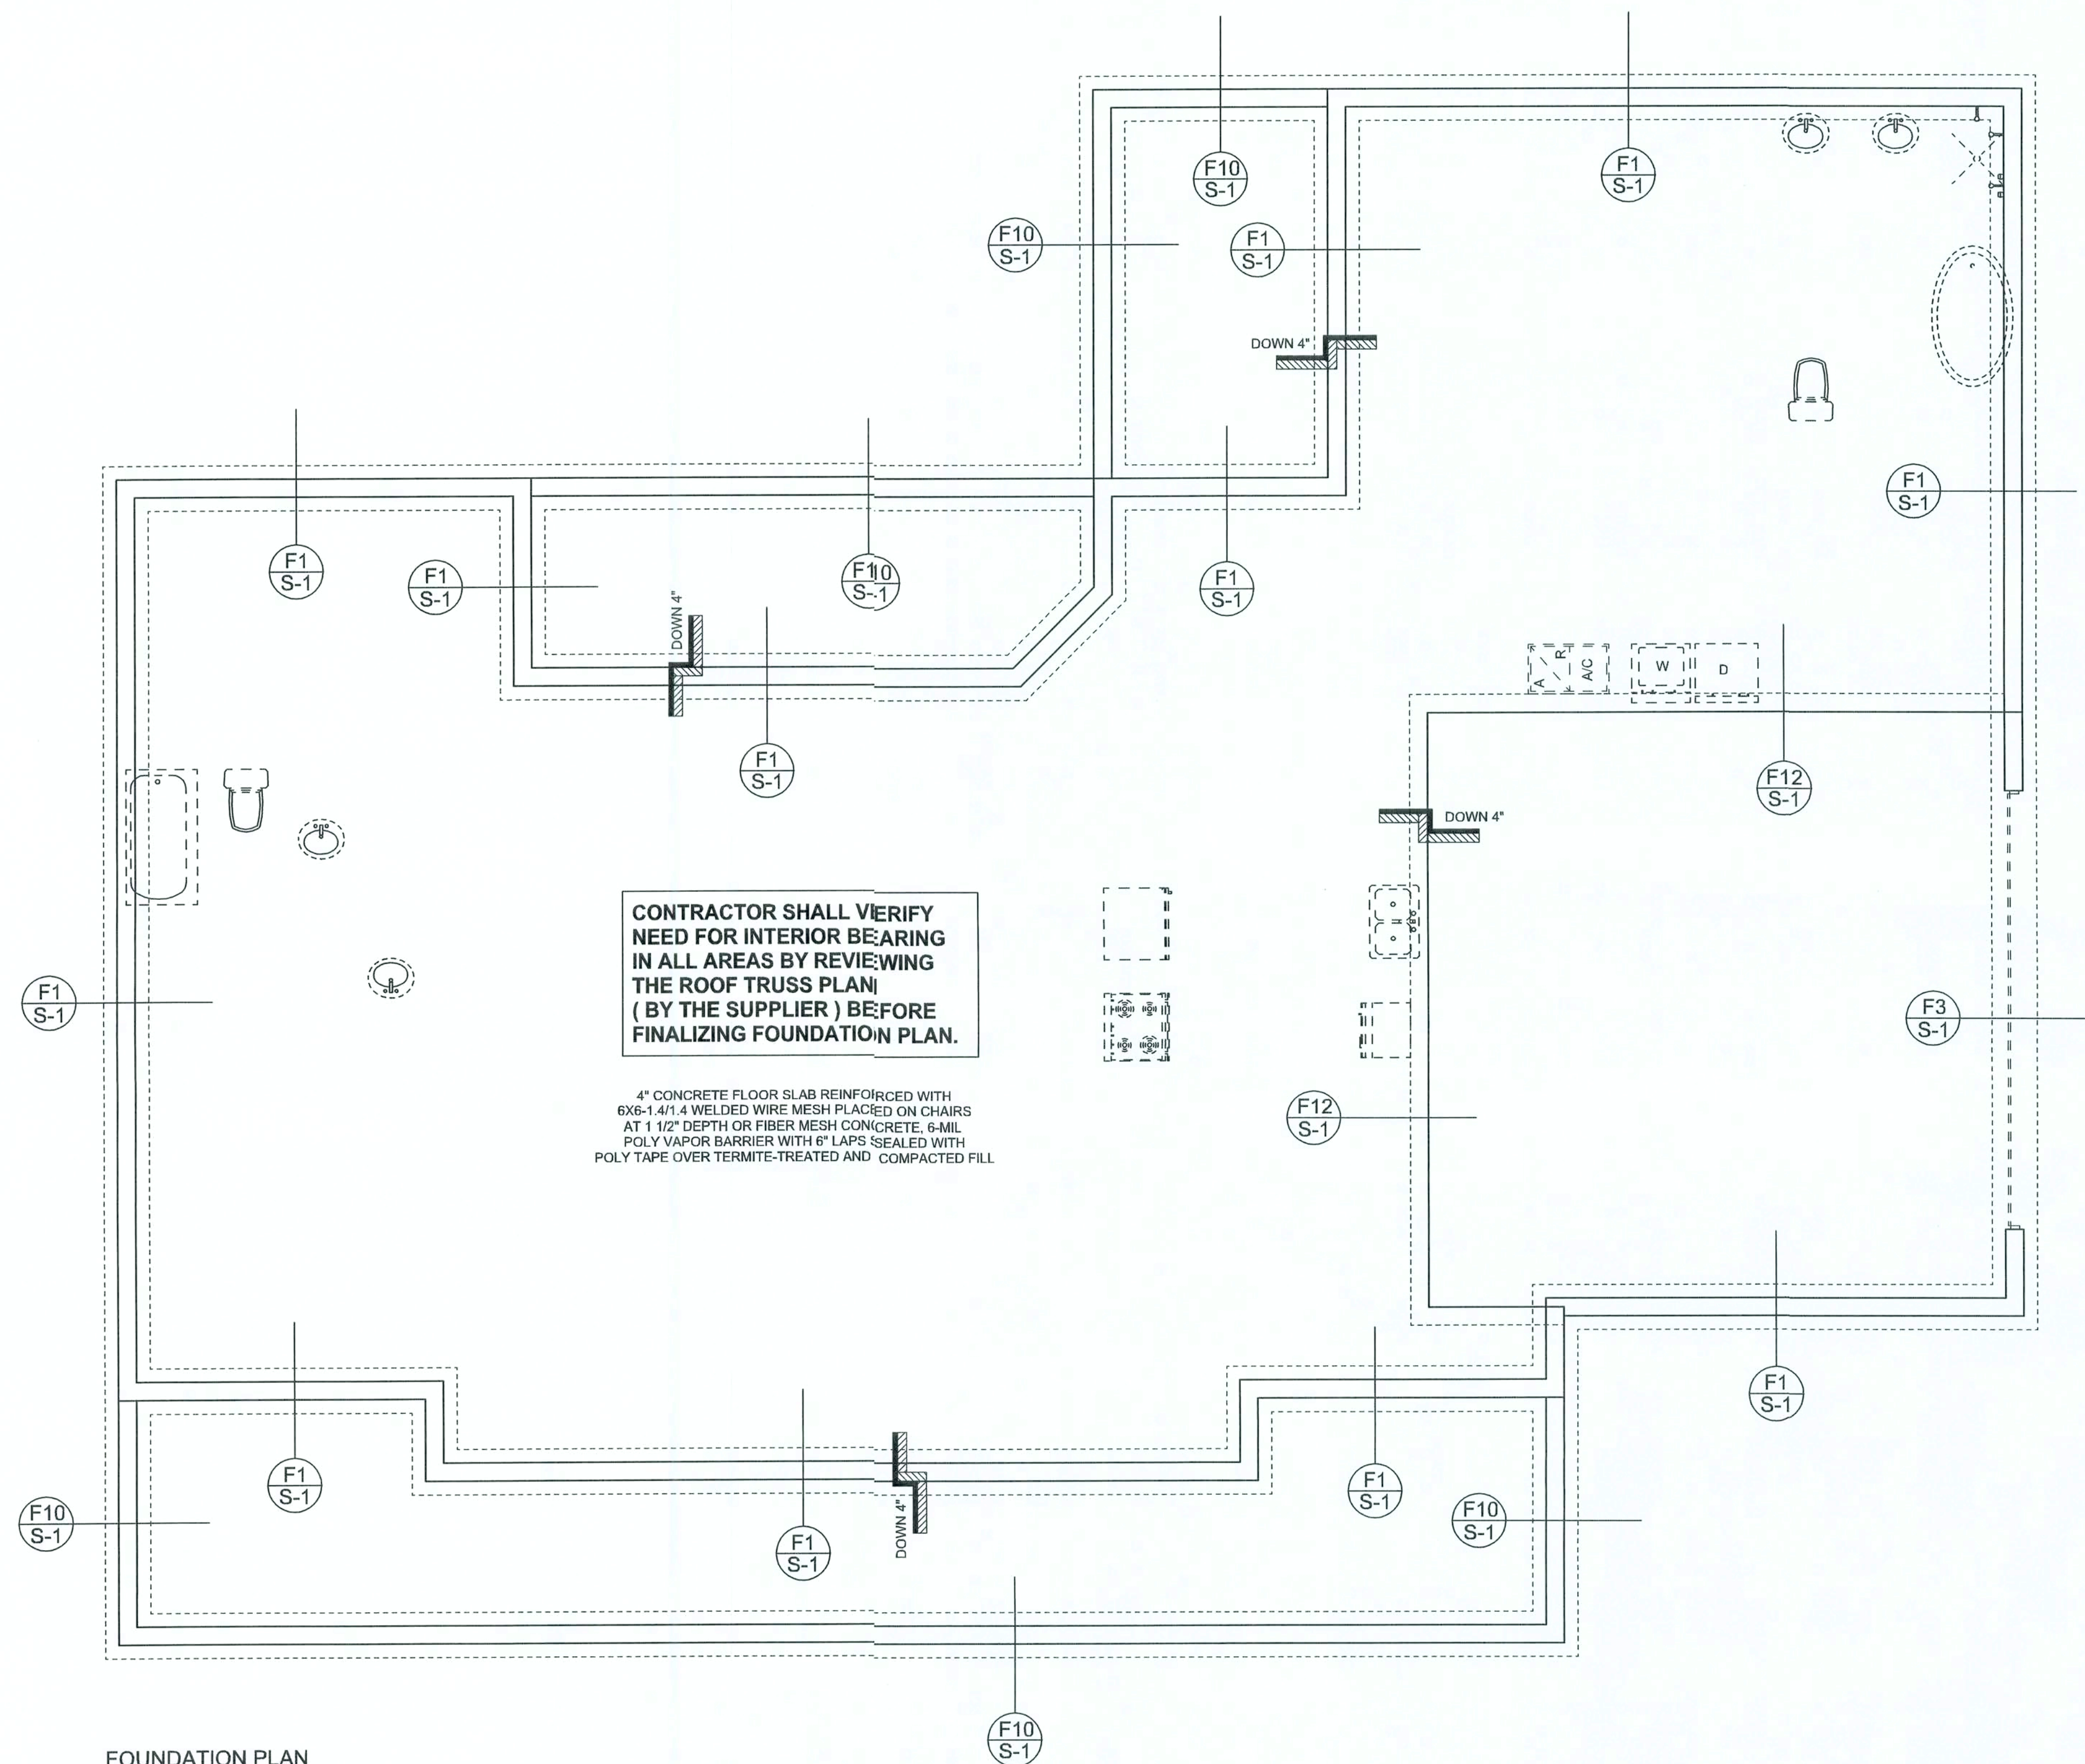


CONTRACTOR SHALL VERIFY
NEED FOR INTERIOR BEARING
IN ALL AREAS BY REVIEWING
THE ROOF TRUSS PLAN
(BY THE SUPPLIER) BEFORE
FINALIZING FOUNDATION PLAN.

4" CONCRETE FLOOR SLAB REINFORCED WITH
6X6-1/4" 4 WELDED WIRE MESH PLACED ON CHAIRS
AT 1 1/2" DEPTH OR FIBER MESH CONCRETE, 5-MIL
POLY VAPOR BARRIER WITH 6" LAPS SEALED WITH
POLY TAPE OVER TERMITE-TREATED AND COMPACTED FILL

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

DIMENSIONS ON STRUCTURAL SHEETS
ARE NOT EXACT. REFER TO ARCHITECTURAL
FLOOR PLAN FOR ACTUAL DIMENSIONS

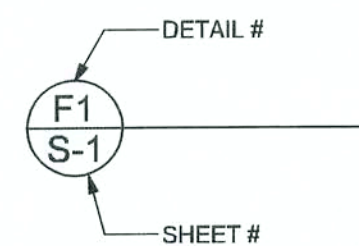

WINDLOAD ENGINEER: Mark Disoway,
P.E. No. 53815, P.O. Box 868, Lake City, FL
32056, 386-754-5419

DIMENSIONS:
Stated dimensions supercede scaled
dimensions. Refer all questions to
Mark Disoway, P.E. for resolution.
Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:
Mark Disoway, P.E. hereby expressly reserves
its common law copyrights and property right in
these instruments of service. This document is
not to be reproduced, altered or copied in any
form or manner without first the express written
permission and consent of Mark Disoway.

CERTIFICATION: These plans and
"Windload Engineering", Sheet S-1, attached,
comply with Florida Building Code 2001,
Section 1606 wind loads, to the best of my
knowledge.

LIMITATION: This design is valid for one
building at specified location. In case of conflict,
structural requirements, scope of work, and
builder responsibilities on sheet S-1 control.

MARK DISOWAY
P.E. 53815

Mark Disoway
25 JUL 05
SEAL

WOODMAN PARK BUILDERS

JOEL & SUSAN LAW RESIDENCE

ADDRESS:
Deep Creek S/D
Columbia County, Florida
Mark Disoway P.E.
P.O. Box 868
Lake City, Florida 32025
Phone: (386) 754 - 5419
Fax: (386) 269 - 4871
windloadengineer@jellsouth.net

PRINTED DATE:
July 25, 2005

DRAWN BY: Ben Sparks
CHECKED BY:


DESIGNED BY:
Ben Sparks

FINALS DATE:
06 / Jul / 05

JOB NUMBER:
504252


DRAWING NUMBER

A-4
OF 5 SHEETS

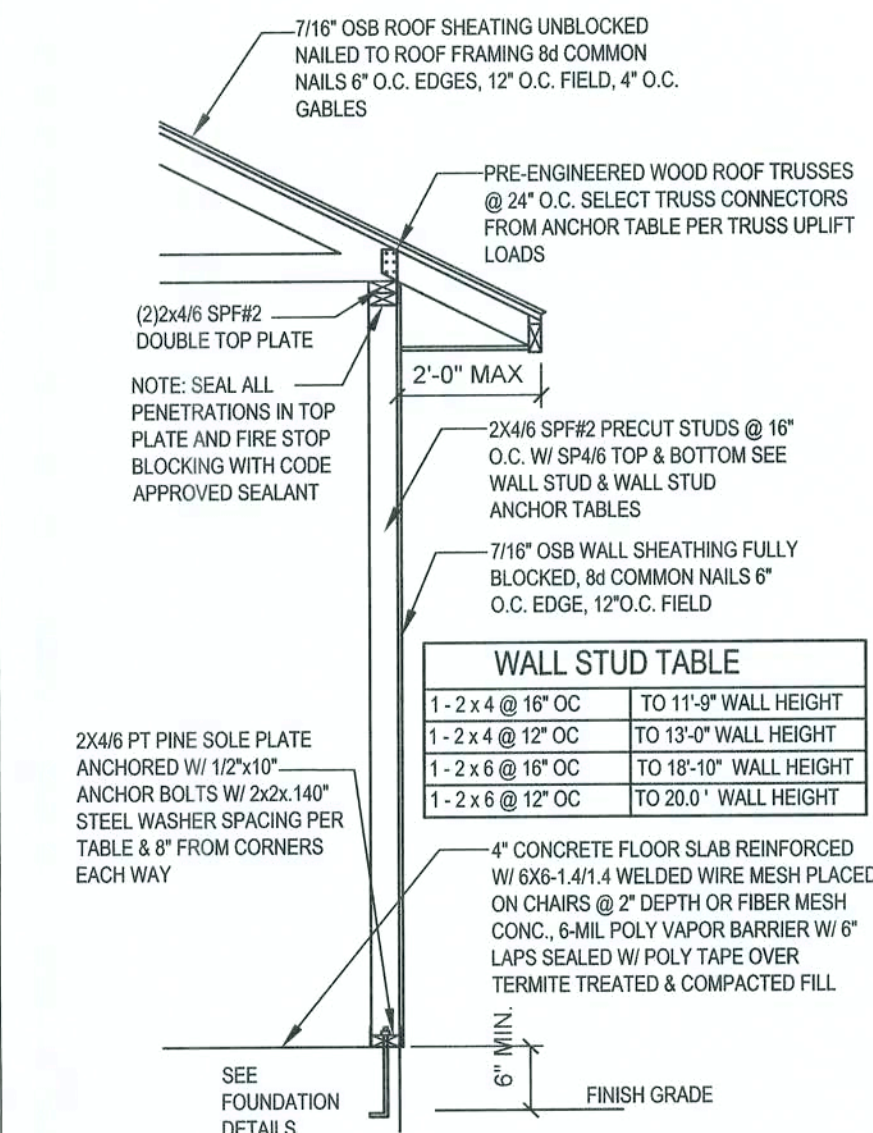


STUD ANCHOR TABLE			
TYPICAL TRUSS UPLIFT & MAX 18\"	ANCHOR BOLT SPACING	SP4 / SP6 SPACING	ALTERNATE SPACING
770 LB	48\"	48\"	NA
890 LB	48\"	32\"	NA
1270 LB	32\"	16\"	32\"
1590 LB	32\"	16\"	16\"
2200 LB	12\"	NA	(2) HTSD NAILED TO STUD PACK

W1 - SINGLE STORY EXT. WALL SECTION
SCALE: 1/2\"/>

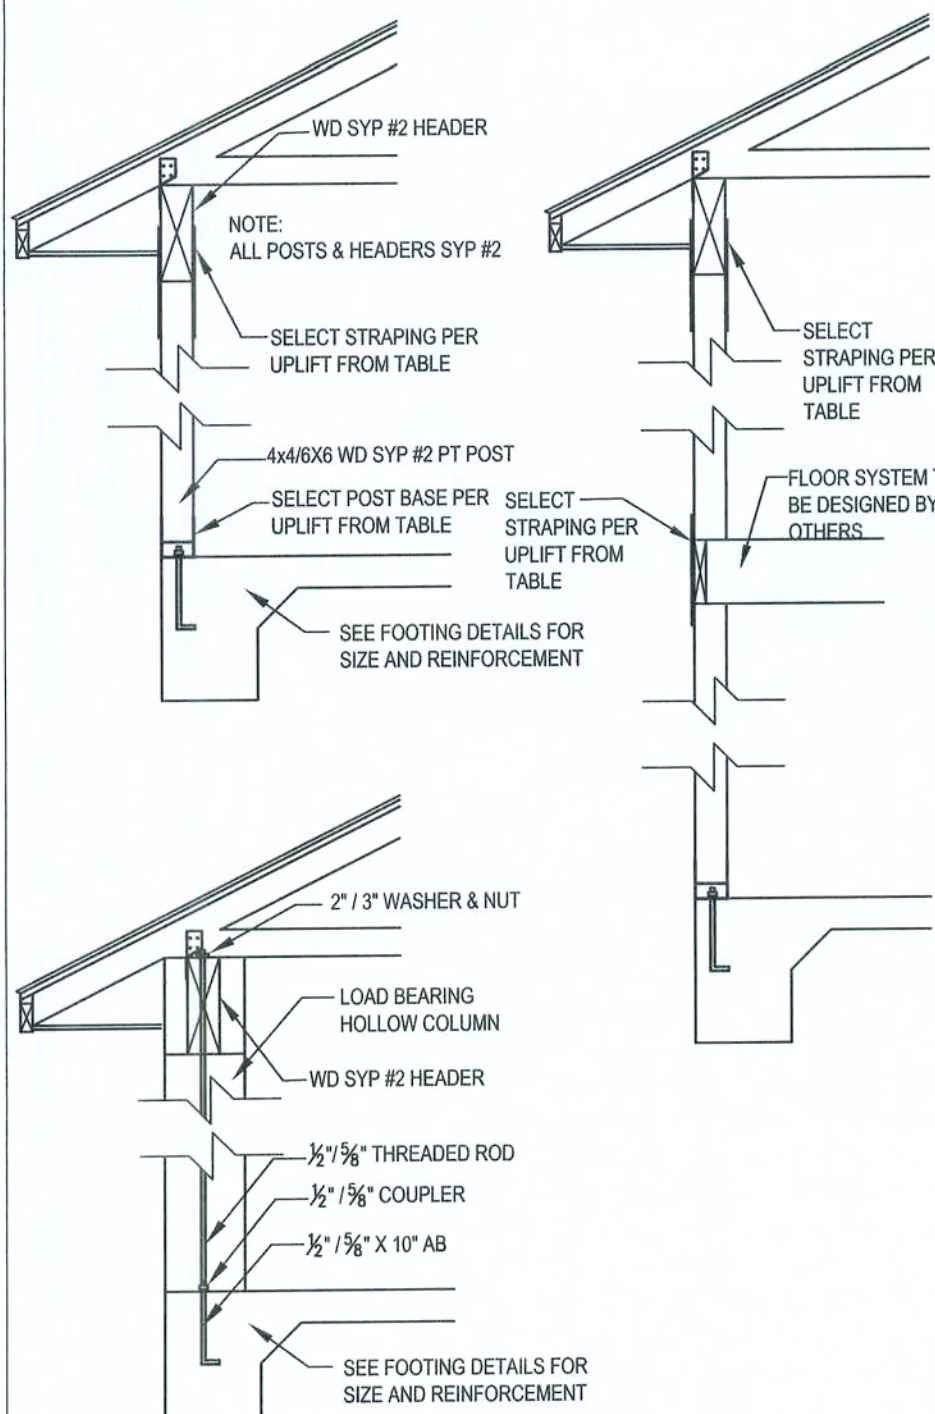


TYPICAL POST UPLIFT	POST BASE ANCHOR	BETWEEN FLOOR STRAPPING	HEADER STRAPPING
590 LB	ABA4 W/ (8) 10x1 & 2\"	(2) LSTA21 W/ (8) 10x1 SA	(2) LSTA21 W/ (8) 10x1 EA
720 LB	ABA6 W/ (8) 10x1 & 2\"	(2) LSTA21 W/ (8) 10x1 EA	(2) LSTA21 W/ (8) 10x1 EA
2200 LB	ABA4 W/ (12) 10x1 & 3\"	(2) LSTA21 W/ (16) 10x1 EA	(2) LSTA21 W/ (16) 10x1 EA
2300 LB	ABA6 W/ (12) 10x1 & 3\"	(2) LSTA21 W/ (16) 10x1 EA	(2) LSTA21 W/ (16) 10x1 EA


W12 - PORCH HEADER ANCHORS
SCALE: N.T.S. REV-18-JUL-03

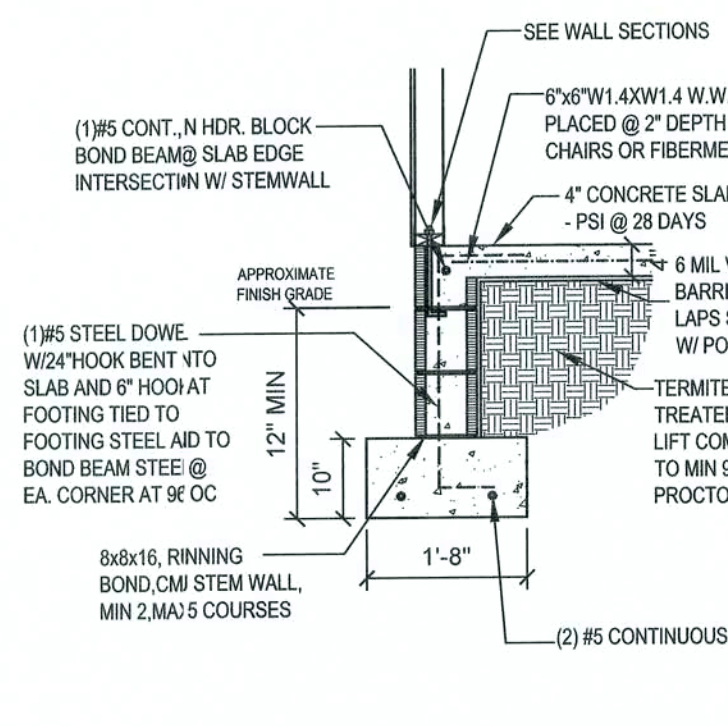


F1 - STEM WALL FOUNDATION
SCALE: 1/2\"/>

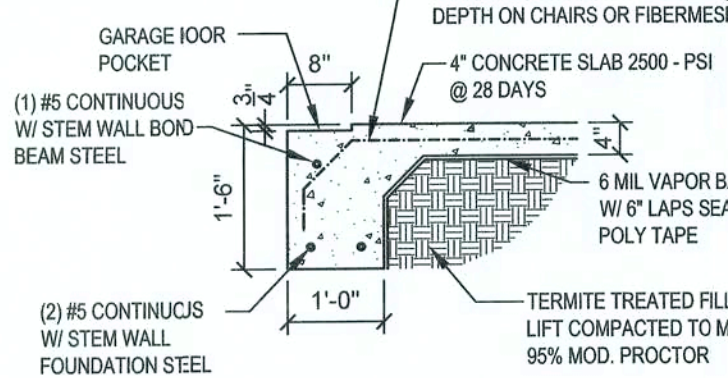


F3 - GARAGE DOOR POCKET
SCALE: 1/2\"/>

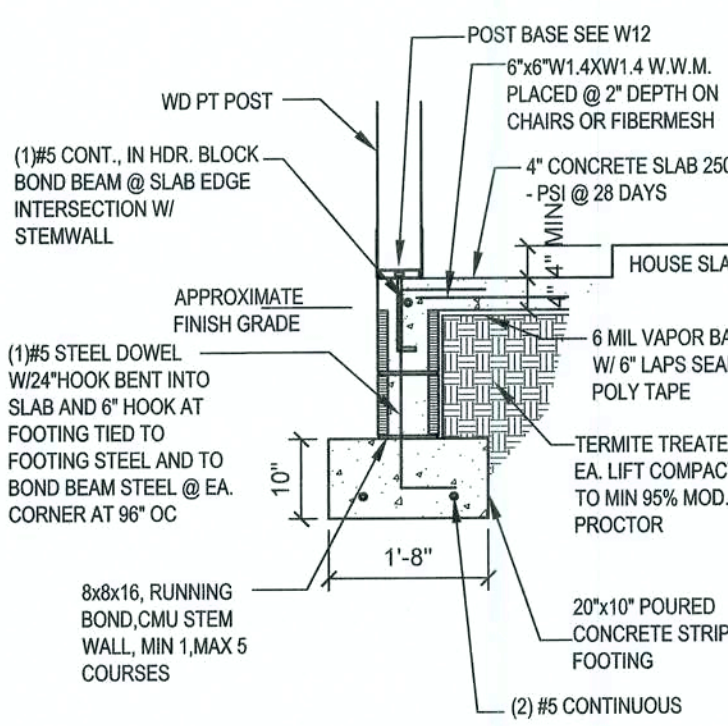


F10 - STEM WALL PORCH FOOTING
SCALE: 1/2\"/>

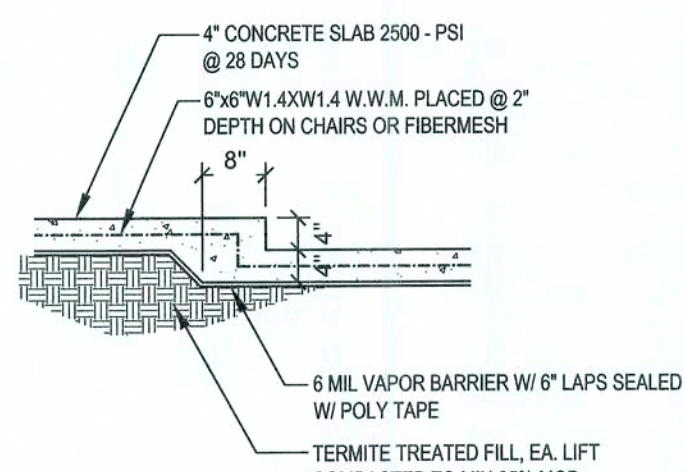


F12 - NON-BEARING STEP FOOTING
SCALE: 1/2\"/>

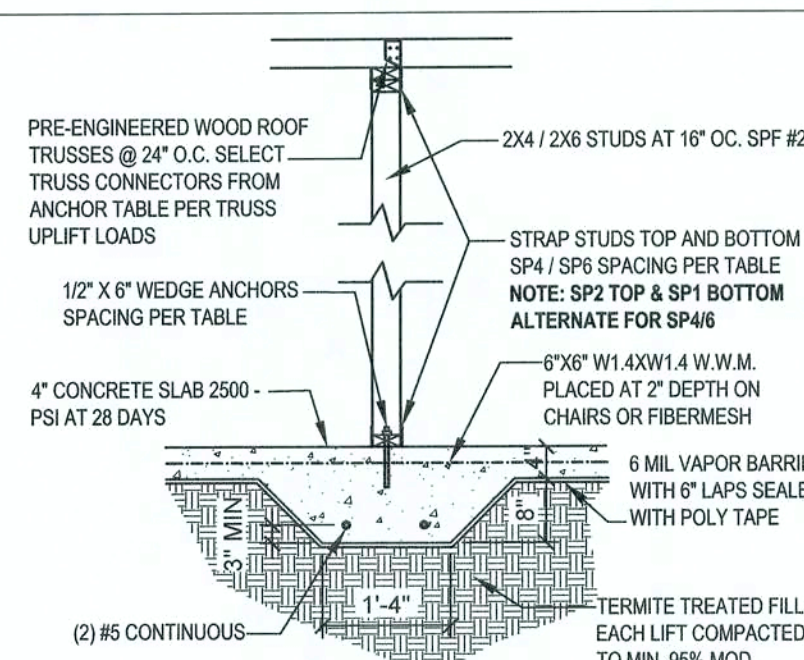


F4 - INTERIOR BEARING FOOTING
SCALE: 1/2\"/>

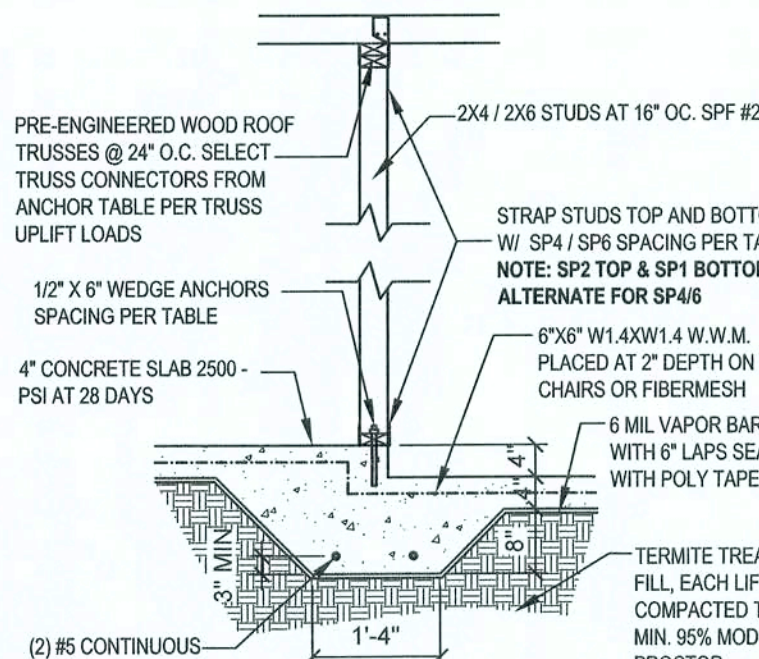

F5 - INTERIOR BEARING STEP FOOTING
SCALE: 1/2\"/>

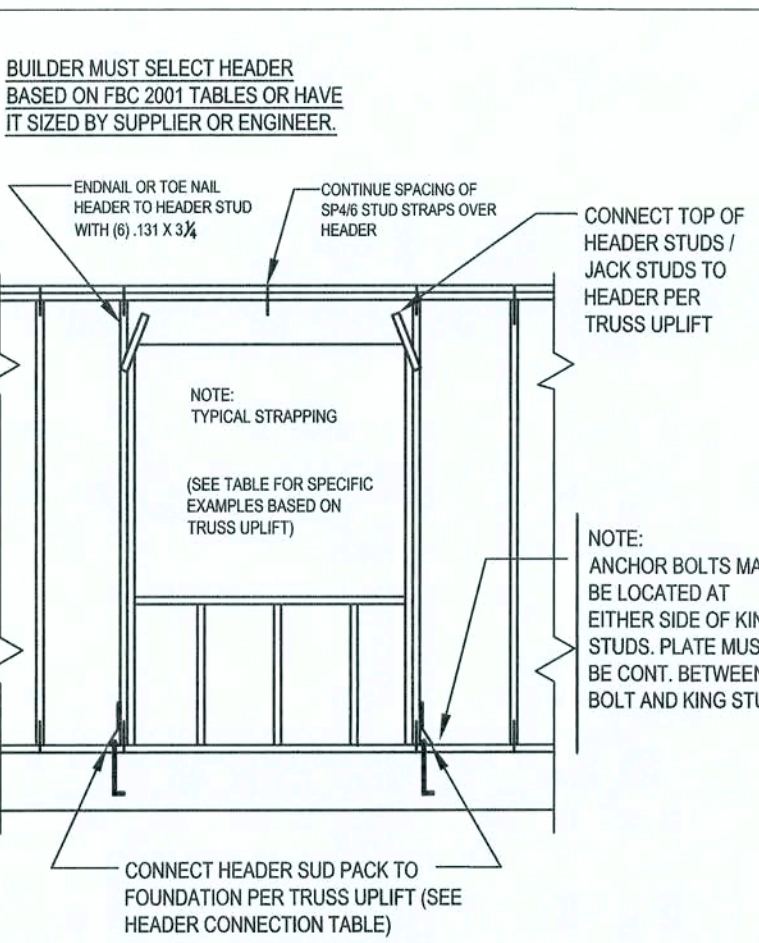

W3-TYPICAL HEADER SIZING & STRAPING DETAIL
SCALE: N.T.S. REV 22-AUG-03

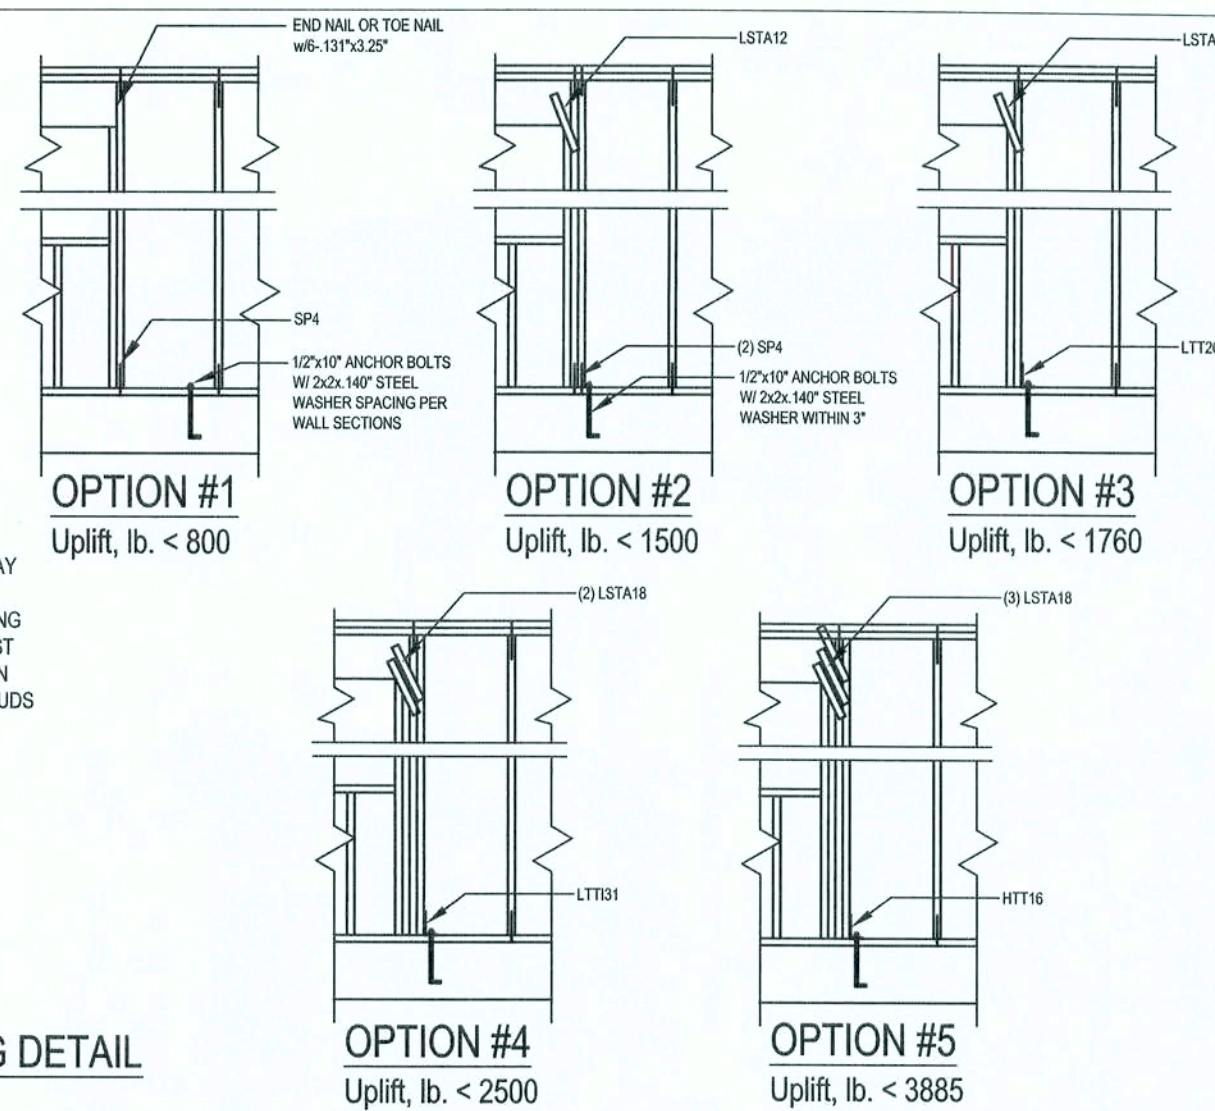

- Load Bearing Header Sizing Methods (BY BUILDER)**
- Determine header size from FBC 2001, Tables 2308.3 A, B, C, & C, or 2308.5.
 - Use supplier published data or Southern pine span tables.
 - For engineered lumber beams have suppliers engineer size beam.
 - Jack Studs and King Studs (BY BUILDER).
 - Look up jack studs from FBC 2001, Tables 2308.3 A, B, C, & C, or 2308.5.
 - Use one jack stud for every 3000 lb vertical load.
 - Total king playjack studs = studs needed to be there if no opening was there.
 - Header Uplift Connections (BY BUILDER).
 - Calculate the uplift at each end of the header by summing the moments of all truss uplifts and dividing by the length of the header.
 - Select header/connections from table below or mfg. catalog to connect header to stud (top connection) and stud to foundation (bottom connection).

Option #	Uplift, lb.	Top Connector	Bottom Connector
#1	< 800	End nail or toe nail w/ 13\"	SP4 6-10x1 1/2\"
#2	< 1500	LSTA18, 10-10x10	(2) SP4 6-10x1 1/2\"
#3	< 1760	LSTA18, 14-10x14	(2) LSTA18, 10-10x10
#4	< 2500	(2) LSTA18, 14-10x14	(2) LSTA18, 10-10x10
#5	< 3885	(2) LSTA18, 14-10x14	(2) LSTA18, 10-10x10

FBC2001, TABLE 2308.3A		Header Spans (ft)		Building Width / Truss Spans (ft)	
Header Span (ft)	Support	Header Span (ft)	Support	Header Span (ft)	Support
2-2x4	3-6	1-3-2	1-2-10	2-2x4	3-6
2-2x6	5-5	1-4-8	1-4-2	2-2x6	6-10
2-2x8	6-10	1-5-11	2-5-4	2-2x8	6-10
2-2x10	8-5	2-1-3	2-5-6	2-2x10	8-5
2-2x12	9-9	2-8-5	2-7-8	2-2x12	9-9
3-2x8	8-4	1-7-5	1-6-8	3-2x8	8-4
3-2x10	10-6	1-8-1	2-8-2	3-2x10	10-6
3-2x12	12-2	2-10-7	2-9-5	3-2x12	12-2
4-2x8	9-2	1-8-4	1-7-8	4-2x8	9-2
4-2x10	11-8	1-10-6	1-8-5	4-2x10	11-8
4-2x12	14-1	1-12-2	2-10-11	4-2x12	14-1

N2-GENERAL NOTES:

FOUNDATION: FOR POINT LOADS GRATER THAN 5000 LB OR REPETITIVE TRUSS LOADS GRATER THAN 2000 LB PER TRUSS PROVIDE A THICKENED SLAB OR PAD FOOTING 1'-0\"/>

CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS SHALL BE $F_c = 3000$ PSI. WHERE EXCESS WATER IS ADDED TO THE CONCRETE SO THAT ITS SERVICABILITY IS DEGRADED, THE ATTAINMENT OF REQUIRED STRENGTH SHALL NOT RELEASE THE CONTRACTOR FROM PROVIDING SUCH MODIFICATIONS AS MAY BE REQUIRED BY THE ENGINEER TO PROVIDE A SERVICEABLE MEMBER OR SURFACE. ALL CONCRETE SHALL BE VIBRATED. NO REPAIR OR RUBBING OF CONCRETE SURFACES SHALL BE MADE PRIOR TO INSPECTION BY AND APPROVAL OF THE ENGINEER, OWNER OR HIS REPRESENTATIVE.

WELDED WIRE REINFORCED SLAB: 6\"/>

FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT, FIBER LENGTHS SHALL BE 1/2 INCH TO 2 INCHES IN LENGTH. DOSAGE AMOUNTS SHALL BE FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD IN ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS. SYNTHETIC FIBERS SHALL COMPLY WITH ASTM C 1116. THE MANUFACTURER OR SUPPLIER SHALL PROVIDE CERTIFICATION OF COMPLIANCE WITH ASTM C 1116 WHEN REQUESTED BY THE BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE 12FT. DO NOT CUT WWW OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTORS APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.)

REBAR: ASTM A 615, GRADE 60, DEFORMED BARS, $F_y = 60$ KSI. ALL LAPS SPICES 48\"/>


STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURE CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURERS INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7\"/>

WASHERS: WASHERS USED WITH 1/2\"/>

NAILS: ALL NAILS ARE COMMON NAILS UNLESS OTHERWISE SPECIFIED OR ACCEPTED BY FBC TEST REPORTS AS HAVING EQUAL STRUCTURAL VALUES.

N5 - TRUSS UPLIFT CONNECTOR TABLE			
REV-18-NOV-04			
All connectors are Simpson Strong-Tie, uno. Select top and bottom connections from this table or SST catalog to meet truss uplift. Use fasteners as specified.			
Uplift	Uplift	Truss	To Plate
SPF	SYP	Connector	To Truss / Rafter
320	455	H3	4-d8
245	350	H5A	3-d8
535	600	H2-5A	5-d8
650	720	H10	6-10x1 1/2\"
650	590	LTS12	8-8x1 1/2\"
1245	1450	HTS20	10-10d or 12-10x1 1/2\"
1265	1470	H16, H16-2	10-10x1 1/2\"
1785	2050	LGT2	14-10d Sinker
3655	4200	MGT	3/4\"
SPF	SYP	Strip Connector	To One Member
760	885	SP4	8-10x1 1/2\"
865	1005	CS20	9-8d or 7-10d
1065	1265	LSTA18-24	7-10d
1170	1380	SPH4	12-10x1 1/2\"
420	455	SSP	4-10d
800	825	CS8	8-10d
1400	1650	CS16	14-9d or 11-10d
SPF	SYP	Column Anchor	To Foundation
1160	1350	LTT19	3/4\"
1985	2310	LTT131	3/4\"
2385	2775	HD2A	3/4\"
3590	4175	HT16	3/4\"
1975	2300	ABU6	3/4\"

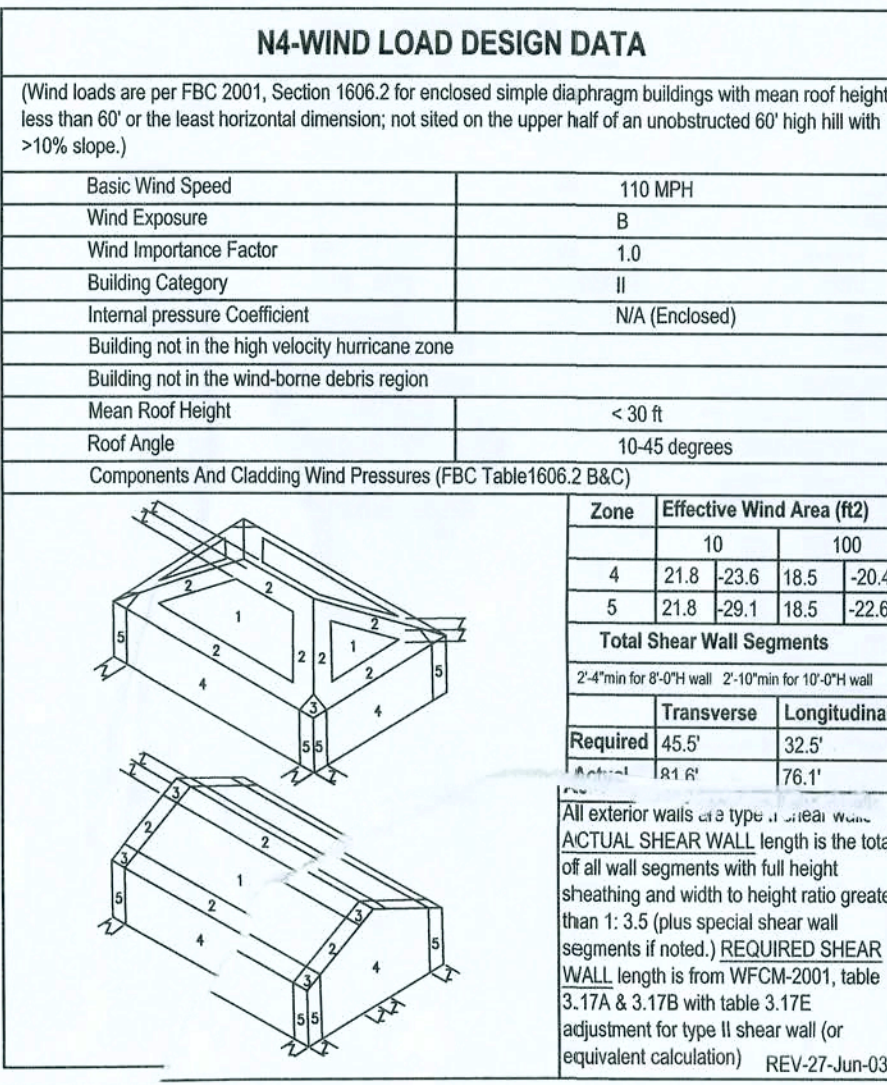

N3-WINDLOAD ENGINEER'S SCOPE OF WORK: The wind load engineer is engineer of record for compliance of the structure to wind load requirements of FBC 2001, Section 1606. If trusses are used, the wind load engineer is not engineer of record for the trusses and did not design the trusses or delegate to the truss designer.

BUILDERS RESPONSIBILITY: The builder and owner are responsible for the following, which are specifically not part of the wind load engineer's scope of work.

- Confirm that the foundation design & site conditions meet gravity load requirements (assume 1000 PSF bearing capacity unless visual observation or soils test proves otherwise).
- Provide materials and construction techniques, which comply with FBC 2001 requirements for the stated wind velocity and design pressures.
- Provide a continuous load path from roof to foundation. If you believe the plan omits a continuous load path connection, call the wind load engineer immediately.
- Verify the truss engineering includes truss design, placement plans, temporary and permanent bracing details, truss-to-truss connections, and load reactions for all bearing locations.
- Select uplift connections, walls, columns, and footings based on truss engineering bearing locations and reactions; including interior bearing walls.
- Size headers for gravity loads; headers sized by the builder for gravity loads will also satisfy wind loads.

DOCUMENT CONTROL AND PRIORITY: Structural requirements on S-1 control unless the building code or architectural sheets have more stringent requirements. Non-structural requirements on architectural sheets control. Specific requirements take precedence over general requirements. Revision control is by the latest signature date and is the responsibility of the builder.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disoway, P.E. hereby expressly reserves his common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

DIMENSIONS: Unless otherwise noted, all dimensions are in feet and inches. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

WINDLOAD ENGINEER: Mark Disoway, PE No.53915

CERTIFICATION: The attached plans and "Windload Engineering", sheet S-1, comply with FBC 2001, Section 1606 wind loads, to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location. This drawing is not valid for construction unless sealed is affixed.

REV-27-JUL-04

WINDLOAD ENGINEERING

"EVERYTHING YCU NEED FOR YOUR BUILDING PERMIT"

Mark Disoway P.E.

POB 868, Lake City, FL 32056 Phone: (386) 754-5419

Fax: (386) 754-6749 Email: windloadengineering@bellsouth.net

Location: Deep Creek SD Columbia County, Florida

Susan & Joel Law

Residence

Builder: Woodman Park Builders

Designer:

Approved: FLPER53915

Revisions:

Sheet S-1 of 5 Sheets

Windload Engineering

Job # 504252