




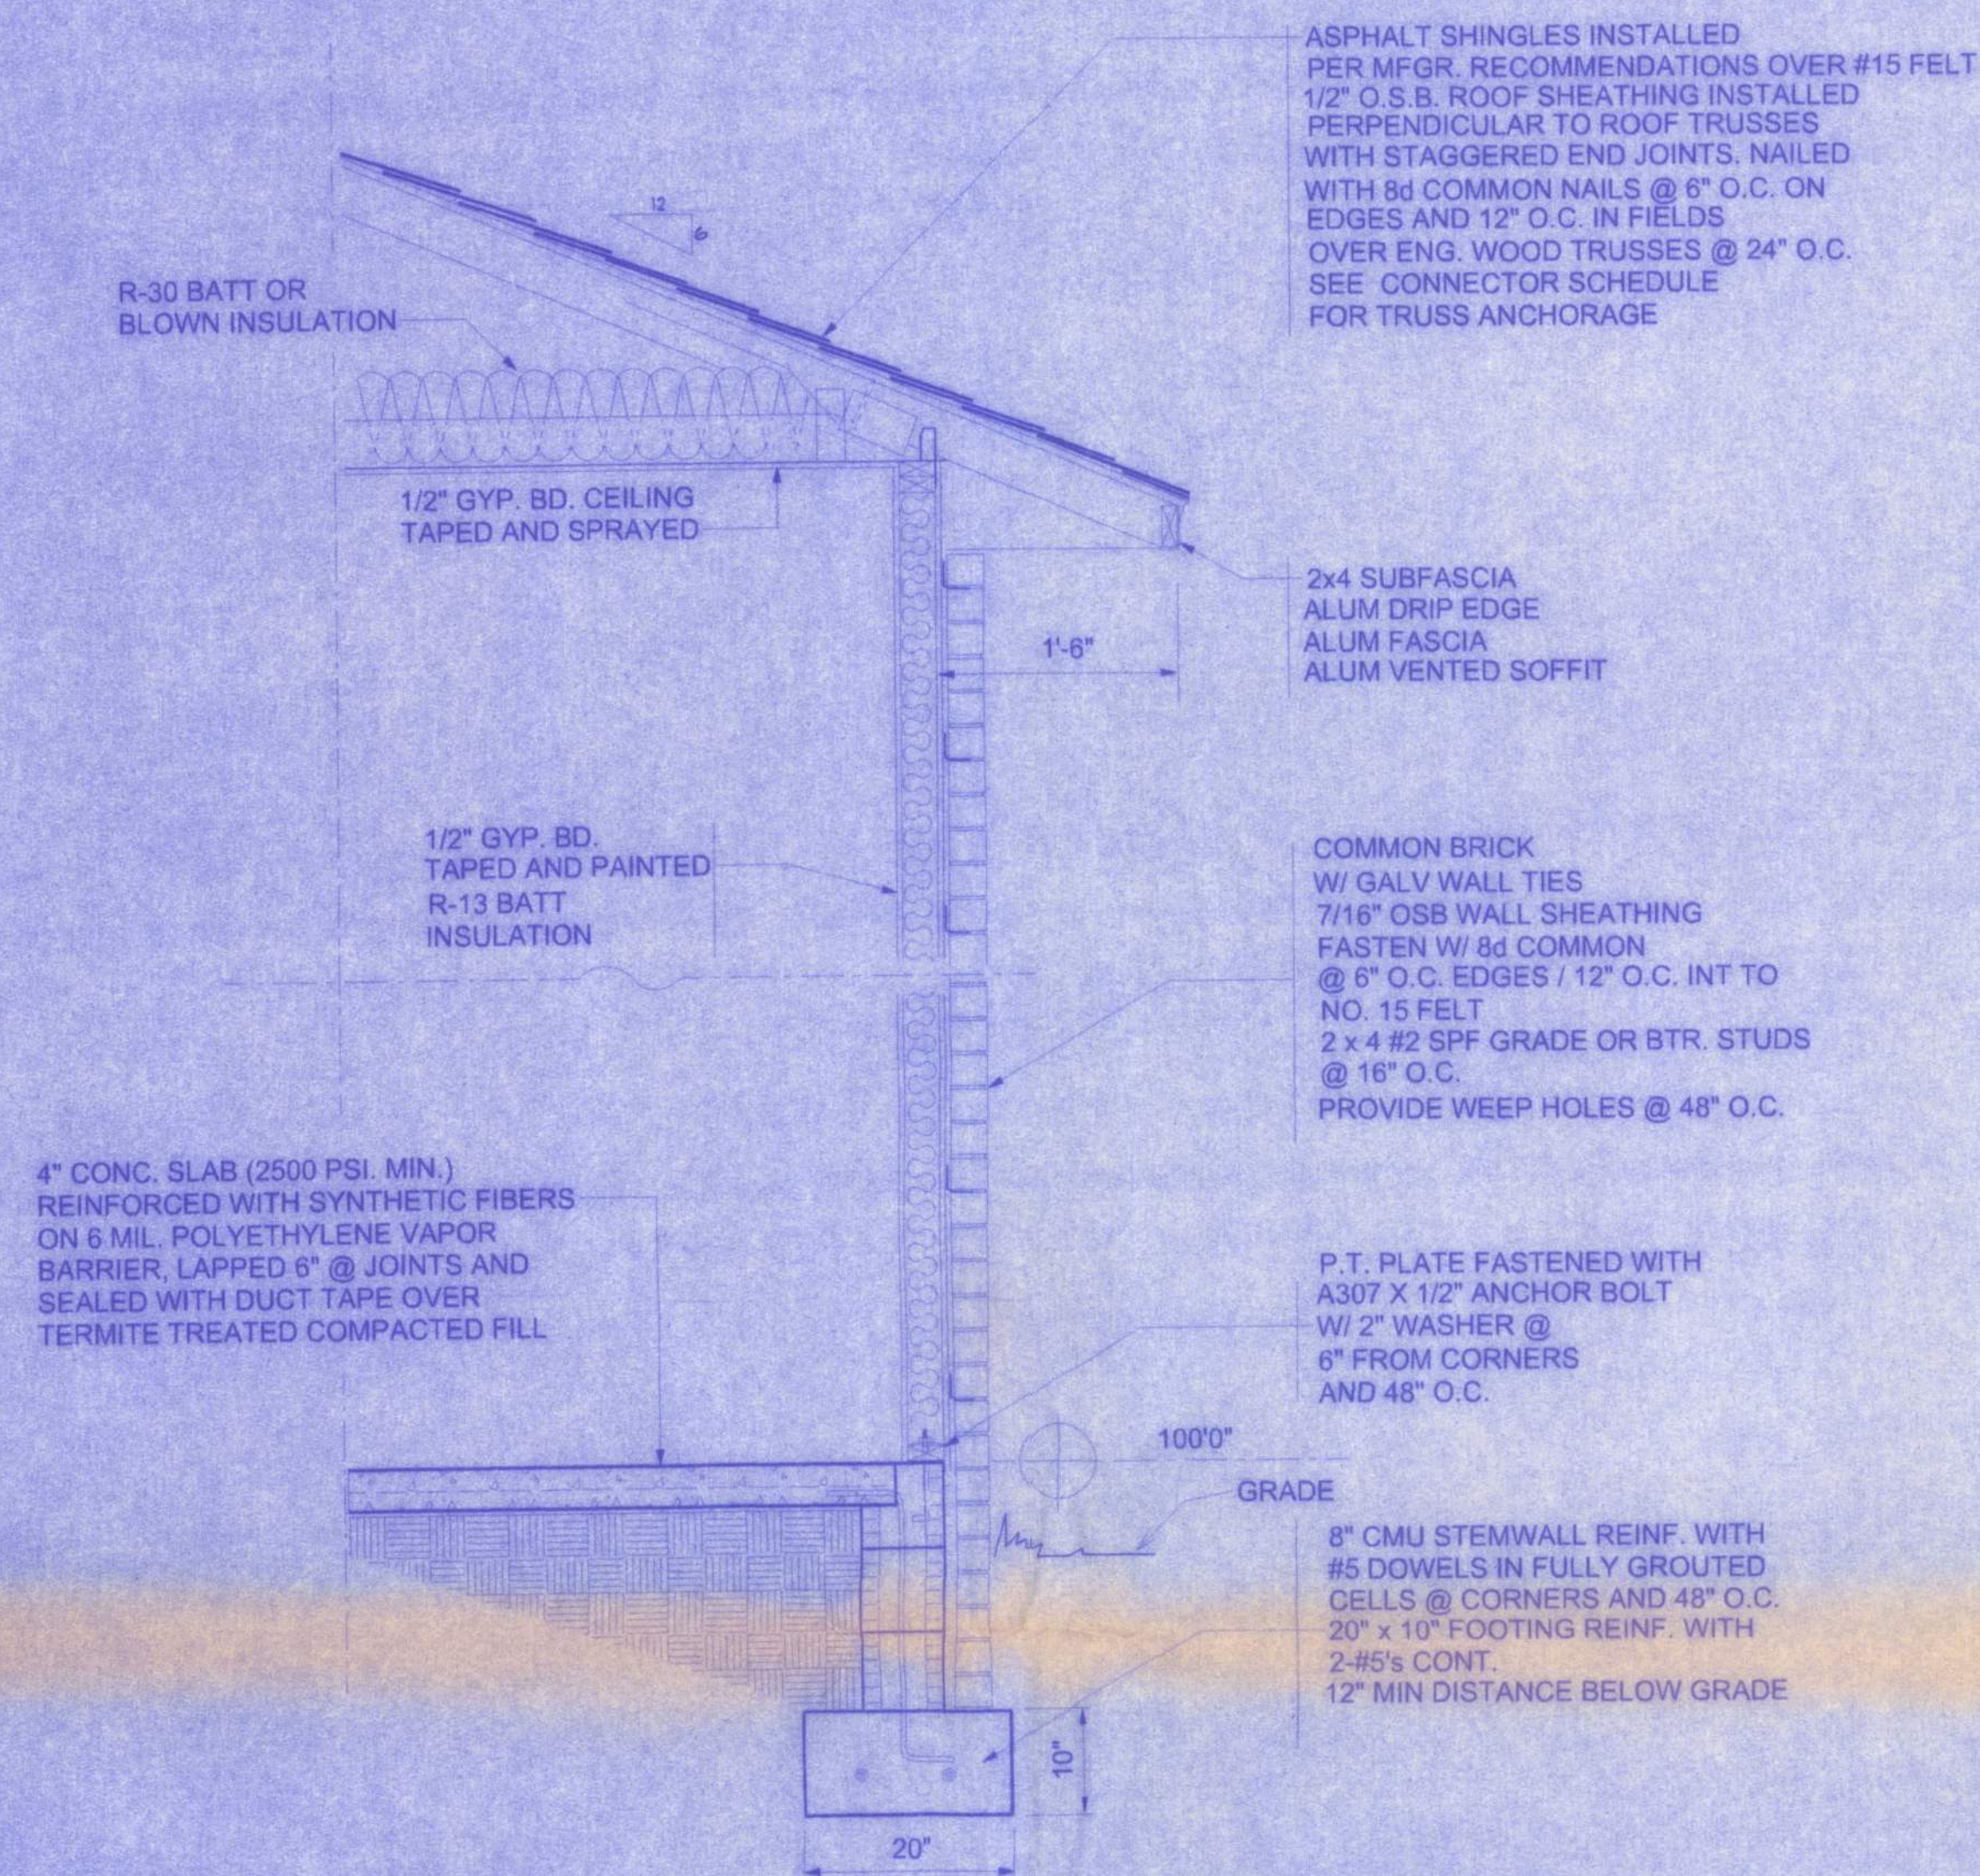


TYPICAL WALL SECTION
3/4" = 1'-0"

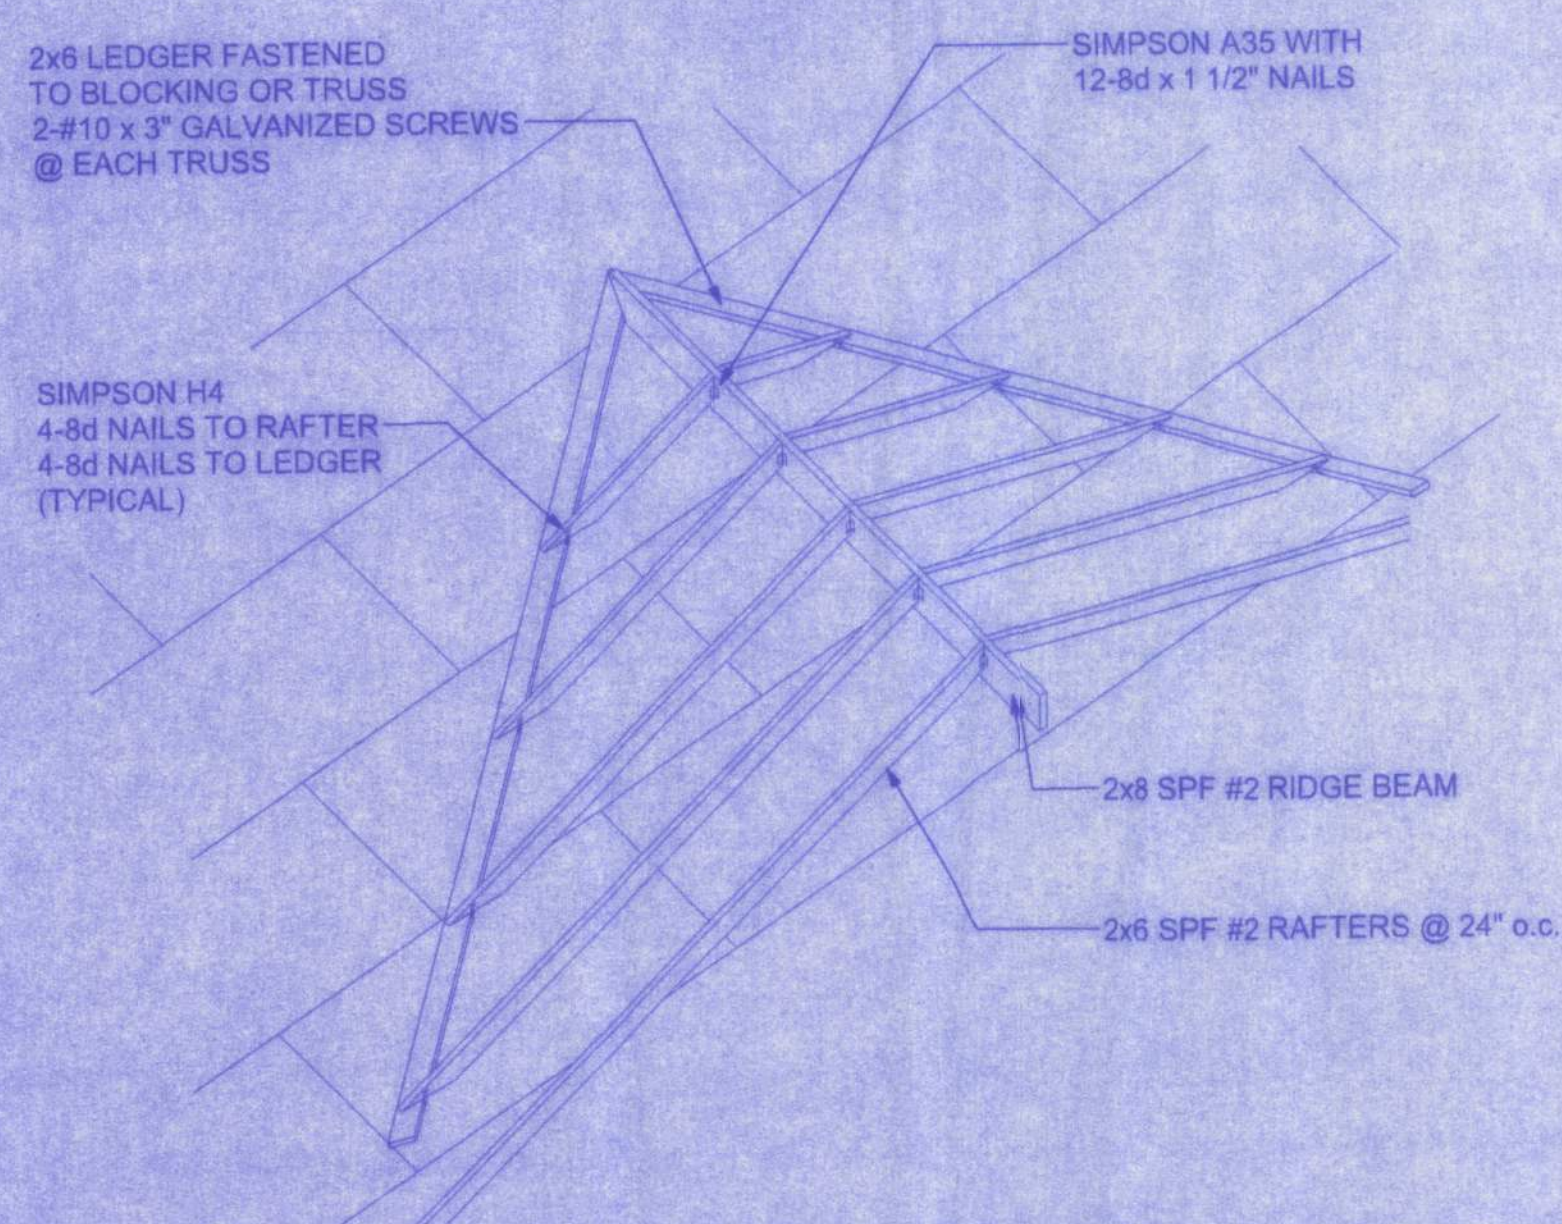


ROOF INTERSECTION CONNECTION DETAIL
NTS

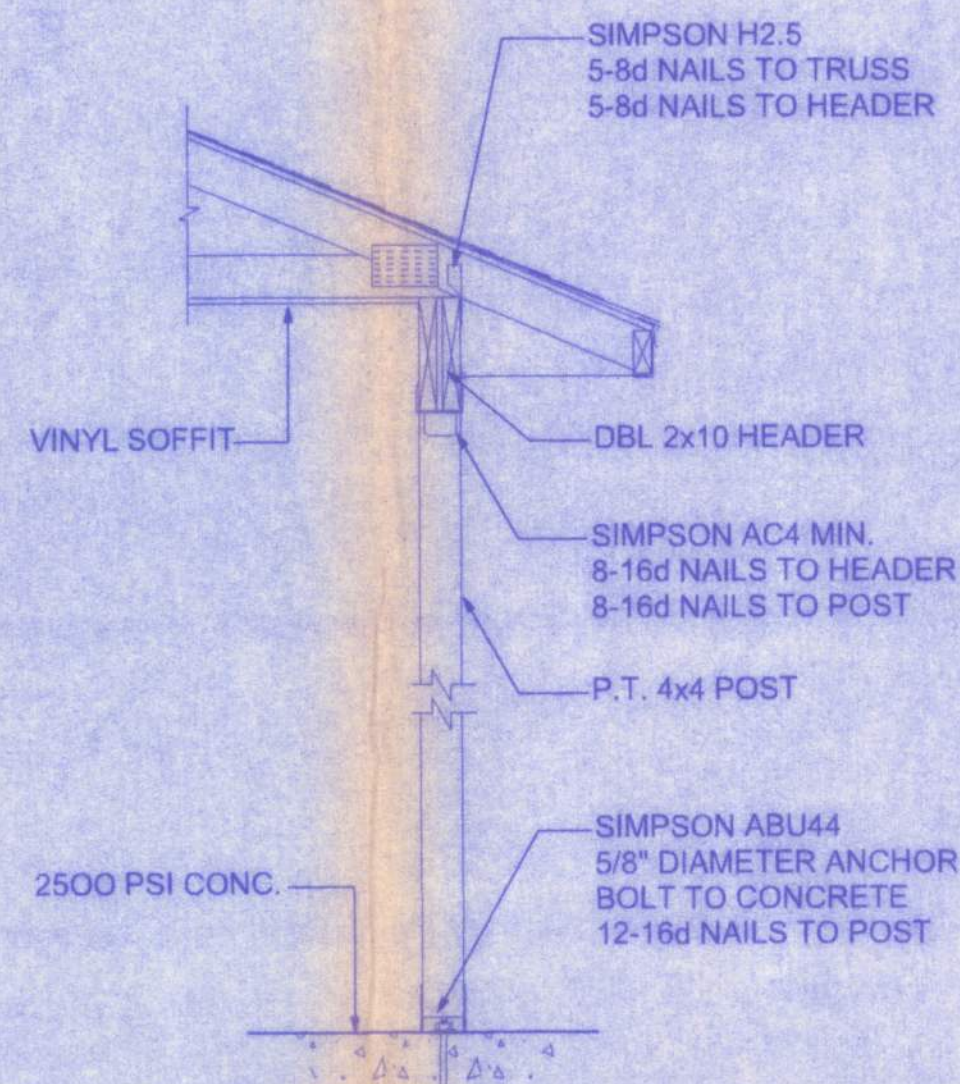

A PORCH SECTION
SCALE: 3/4" = 1'-0"

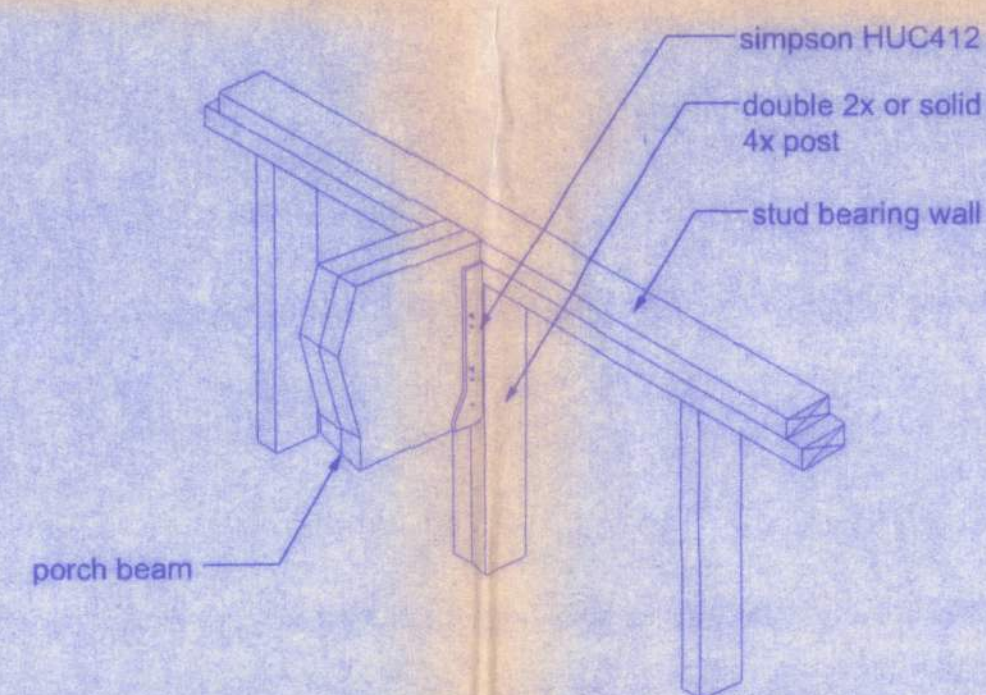


BEAM/WALL CONNECTION
NTS

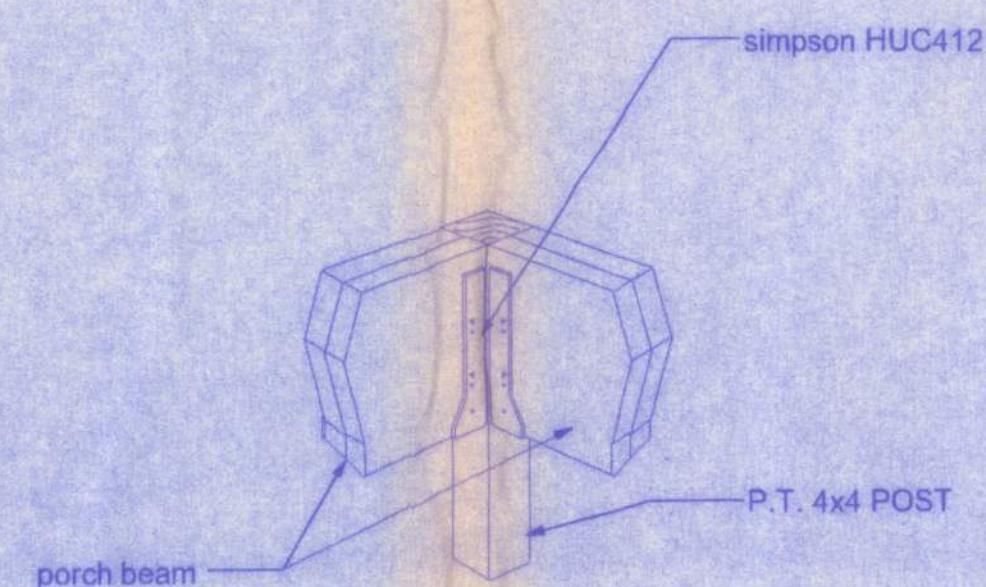


BEAM/POST CONNECTION
NTS

HEADER SPANS FOR EXTERIOR BEARING WALLS


Headers Supporting	Building Width (ft)					
	Size	Span	# jacks	Span	# jacks	Span
Roof, Ceiling	2-2x4	3'-6"	1	3'-2"	1	2'-10"
	2-2x6	5'-6"	1	4'-8"	1	4'-2"
	2-2x8	6'-10"	1	5'-11"	2	5'-4"
	2-2x10	8'-5"	2	7'-3"	2	6'-6"
	2-2x12	9'-9"	2	8'-5"	2	7'-6"
	3-2x8	8'-4"	1	7'-5"	1	6'-8"
	3-2x10	10'-6"	1	9'-1"	2	8'-2"
	3-2x12	12'-2"	2	10'-7"	2	9'-5"
	4-2x8	9'-2"	1	8'-4"	1	9'-2"
	4-2x10	11'-8"	1	10'-6"	1	9'-5"
	4-2x12	14'-1"	1	12'-2"	2	10'-11"

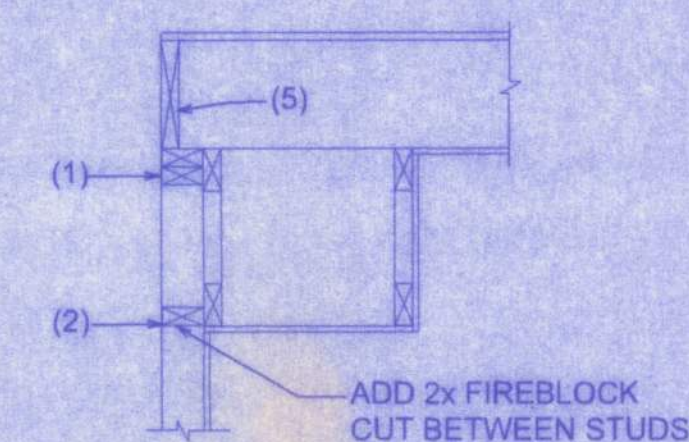

SOFFIT/DROPPED CLG.

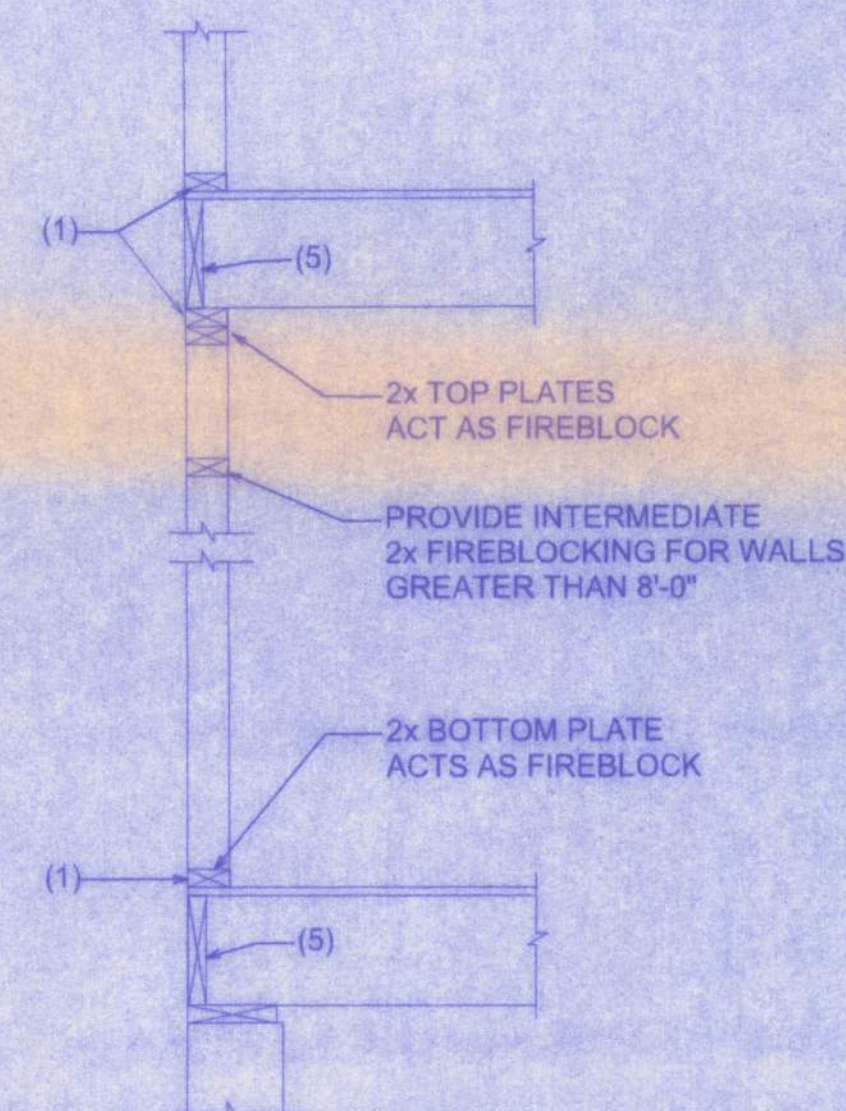

PLATFORM FRAMING

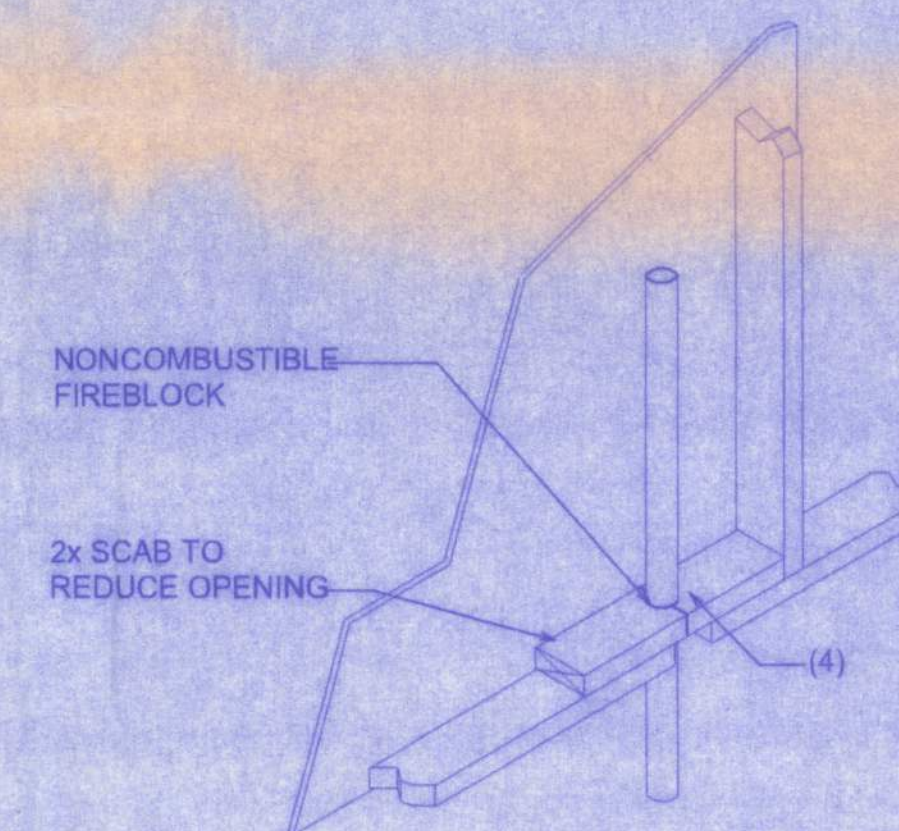

PENETRATIONS

FIREBLOCKING NOTES:

FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS:


1. IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS INCLUDING FURRED SPACES AT CEILING AND FLOOR LEVELS.
2. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS, COVE CEILINGS, ETC.
3. IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN.
4. AT OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS AND FIREPLACES AT CEILING AND FLOOR LEVELS WITH PYROPANEL MULTIFLEX SEALANT
5. AT ALL INTERCONNECTIONS BETWEEN CONCEALED VERTICAL STUD WALL OR PARTITION SPACES AND CONCEALED SPACES CREATED BY AN ASSEMBLY OF FLOOR JOISTS, FIREBLOCKING SHALL BE PROVIDED FOR THE FULL DEPTH OF THE JOISTS AT THE ENDS AND OVER THE SUPPORTS.

W.H.F.
9/26/05

ST. JOHNS MODEL
CANNON CREEK PLACE LOT#45

161 NW MADISON STREET
SUITE #102
LAKE CITY, FL 32055
(386) 768-4209

CERTIFICATE OF AUTHORIZATION # 00080101



Freeman
Design Group inc

DATE: 09/21/05
DRAWN BY: W.H.F.

REVISIONS

SHEET: A-6

OF: 6

PROJECT NO.