



Cal-Tech Testing, Inc.

#28593

- Engineering
- Geotechnical
- Environmental

P.O. Box 1625 • Lake City, FL 32056-1625 • Tel(386)755-3633 • Fax(386)752-5456
4784 Rosselle St., Jacksonville, FL 32254 • Tel(904)381-8901 • Fax(904)381-8902

Laboratories

REPORT OF LABORATORY COMPACTION TEST


Client:
Project Name:
Project Location:
Contractor:

Mike Roberts Framing 657 SW Catherine Lane, Lake City, FL 32025
Crosswind Subdivision, Lot #31
Lake City, FL
Mike Roberts Framing

File No: 10-00181-01

Date: 5/17/2010

Lab No: 13239

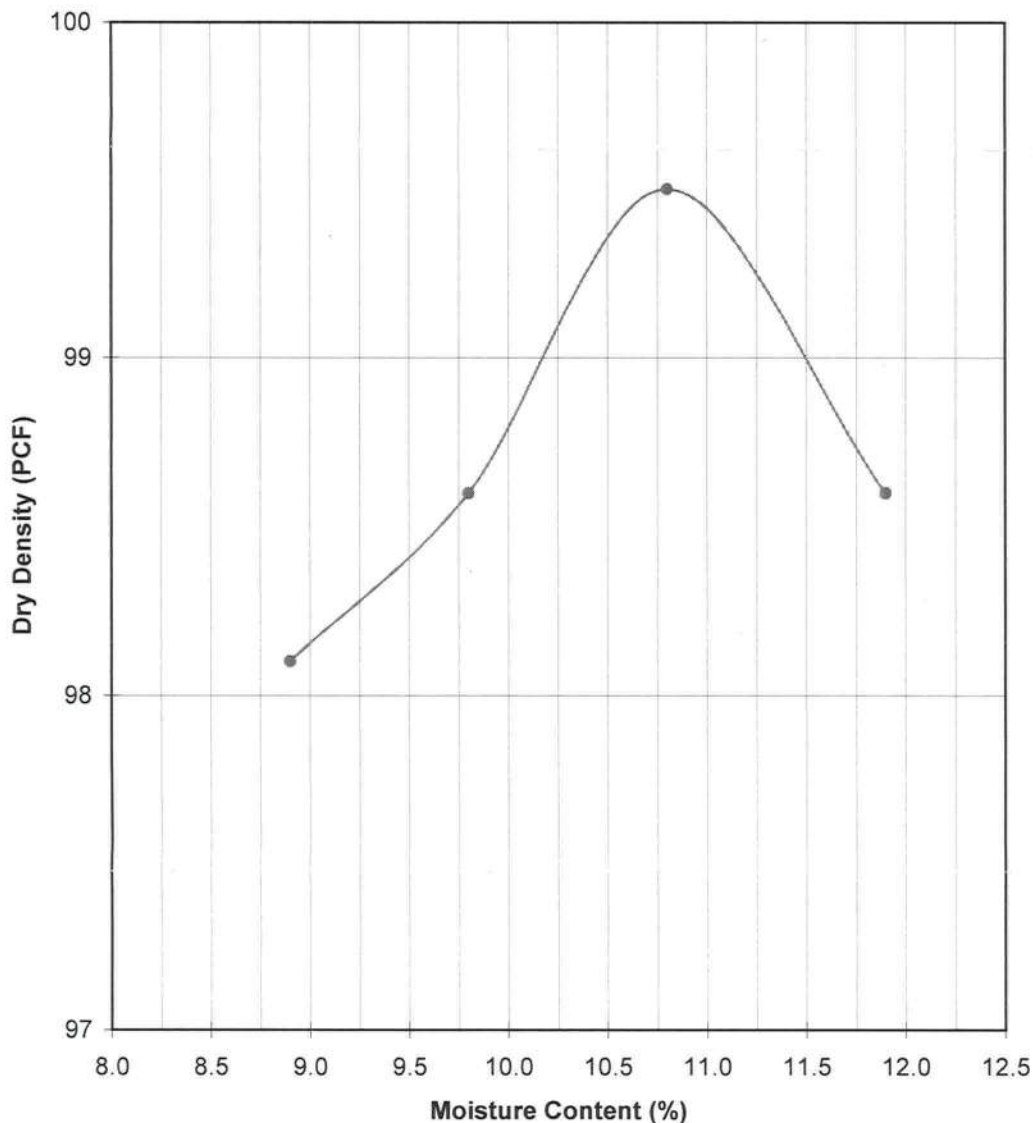

PROCTOR DATA

Proctor No.: 1

Modified Proctor ☒
(ASTM D-1557)Standard Proctor ☐
(ASTM D-698)Maximum Dry
Dens. Pcf: 100Optimum Moisture
Percent: 11

The test results presented in this report are specific only to the samples tested at the time of testing. The tests were performed in accordance with generally accepted methods and standards. Since material conditions can vary between test locations and change with time, sound judgement should be exercised with regard to the use and interpretation of the data.

Sample Description:
Sample Location:
Proposed Use:
Sampled By:
Tested By:
Remarks:

Tan Fine Sand
Existing Stockpile
Building Fill
Daryn Wimpy Date: 5/7/2010
Tim Cassidy Date: 5/14/2010
1cc: Client
1cc: File

Linda Creamer, CEO, DBE

Linda M. Creamer

President - CEO

Reviewed By: *[Signature]*

Date:

Licensed, Florida No.: 57842