

Zone 1	+/- 19.47
Zone 2	+/- 29.96
Zone 3	+/- 41.63
Zone 4	+/- 27.05
Zone 5	+/- 30.02

WIND PRESSURE ON COMPONENTS AND CLADDING

PROFESSIONAL SERVICES BY  
DRISCOLL ENGINEERING, INC.  
PO BOX 357577  
GAINESVILLE, FL 32635  
PH (352)-331-1513  
CA 6890

PLANS AND SPECIFICATIONS  
The plans and specifications presented herein are applicable only for the anticipated construction at the locations shown. If construction plans change, the Design Professional should be notified so the plans and specifications can be re-evaluated. The Design Professional should be given the opportunity to review final plans and specifications to see if the intent of the plans and specifications has been followed and/or if supplemental details and recommendations are needed. The Design Professional warrants that the plans and specifications contained herein, have been prepared in accordance with generally accepted professional engineering practice. No other warranties are implied or expressed.

CORPORATE PROTECTION  
It is understood and agreed that the Design Professional's Basic Services under this Agreement do not include project observation or review of the Contractor's performance or any other construction phase services, and that such services will be provided by the Client. The Client assumes all responsibility for interpretation of the contractor Documents and for construction observation and supervision and waives any claims against the Design Professional that may be in any way connected thereto.

In addition, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any loss, claim or cost, including reasonable attorney's fees and costs of defense, arising or resulting from the performance of such services by other person or entities and from any and all claims arising from modifications, clarifications, interpretations, adjustments or changes made to Contract Documents to reflect changed field or other conditions, except for claims arising from the sole negligence or willful misconduct to the Design Professional.

OWNERSHIP OF INSTRUMENTS OF SERVICE  
All reports, plans, specifications, computer files, field data, notes and other documents and instruments prepared by the Design Professional as instruments of service shall remain the property of the Design Professional. The Design Professional shall retain all common law, statutory and other reserved rights, including the copyright thereto.

DEFECTS IN SERVICE  
The Client shall promptly report to the Design Professional any defects or suspected defects in the Design Professional's work or services of which the Client becomes aware, so that the Design Professional may take measures to minimize the consequences of such a defect. The Client warrants that he or she will impose a similar notification requirement on all contractors in his or her Client/Contractor contract and shall require all subcontractors at any level to contain a like requirement. Failure by the Client, and the Client's contractors or subcontractors to notify the Design Professional, shall relieve the Design Professional of the costs of remedying the defects above the sum such remedy would have cost had prompt notification been given.

VERIFICATION OF EXISTING CONDITIONS  
Inasmuch as the remodeling and/or rehabilitation of an existing building requires that certain assumptions be made regarding existing conditions, and because some of these assumptions may not be verifiable without expending additional sums of money or destroying otherwise adequate or serviceable portions of the building, the Client agrees, to the fullest extent permitted by law, to indemnify and hold the Design Professional harmless from any claim, liability or cost (including reasonable attorney's fees and costs of defense) for injury or economic loss arising or allegedly arising out of the professional services provided under this Agreement, excepting only those damages, liabilities, or costs attributable to the sole negligence or willful misconduct of the Design Professional

1-All construction shall comply with Florida Building Code 7th edition 2020.

ULTIMATE WIND SPEED: 130  
NOMINAL WIND SPEED: 101  
WIND EXPOSURE CATEGORY: B  
RISK CATEGORY 2  
INTERNAL PRESSURE COEFFICIENT Gcpi= +/- 0.0  
DESIGN PRESSURE PER FBC CHAPTER 16, INCLUDING ASCE 7-16 LOAD CALCULATIONS  
ROOF LIVE LOAD =20 PSF  
ROOF DEAD LOAD = 5 PSF  
MIN SOIL BEARING 2500 PSF  
TRUSS BEARING LOAD EACH END 5200LB  
TRUSS UPLIFT @ POST 3400LBS

1. Wood framing and fasteners to meet NDS-2012 requirements.
2. Fastener requirements: (1) All nails are Common galvanized; (2) all bolts are to be galvanized steel and include nuts and washers; and (3) all other hardware (Simpson, etc.) is to be installed according to manufacturer's specifications and recommendations. Nailing (size and number) shall satisfy Tables 2306.2.(1), 2306.3.(1) and 2306.3.(#) FBC unless otherwise indicated. Note: fasteners exposed to the weather are to be treated for weather resistance and compatible with the type of pressure treated wood used (connectors, nails, bolts, nuts and washers).

Concrete Construction Notes

1. Concrete work shall conform to "Building Code Requirements for Reinforced Concrete" (ACI-318) and "Specifications for Structural Concrete" (ACI-301), Latest Edition.
2. Concrete mix shall conform to the following specifications. All concrete mixes shall contain a water-reducing admixture conforming to ASTM C-494. Air-entraining admixture shall conform to ASTM C-260

CONCRETE MIX A

Ultimate Compressive Strength @ 28 days 3,000 PSI  
Slump Range 4" +/- 1"  
Maximum Aggregate Size 1"  
Entrained Air None  
Dry Weight per Cubic Foot 150 #




3. Shotcrete mix
- 4 All concrete shall be cured for a minimum of 28 days. If forms for vertical surfaces are removed prior to the end of the curing period, spray surfaces with liquid membrane curing compound.
5. Reinforcing steel shall conform to ASTM A615, Grade 40 (Fy=40 ksi). Lap continuous bars for tension lap splice per ACI-318, unless otherwise noted. Provide corner bars of same size and spacing as horizontal wall reinforcement. Cover for concrete reinforcing steel shall be in accordance with ACI-318, Paragraph 7.7.
6. Welded wire fabric (WWF) shall conform to ASTM A185. Lap sheets two mesh spaces and wire tie adjacent sheets together securely. Cut alternate reinforcement at control joints.
7. All slabs on grade shall have construction or control joints not to exceed 10'-0" spacing, unless otherwise noted.
8. Electrical conduit and other pipes to be embedded in structural concrete floor slabs or walls shall be placed in accordance with the requirements of ACI-318, Paragraph 6.3.

24' x 70' PARTIALLY ENCLOSED POLE  
STRUCTURE

5-15-21  
Michael E Driscoll PE  
FL Reg # 43922


PRIOR  
300 SW LEGREE TERR  
FT WHITE, FL. DB21-220



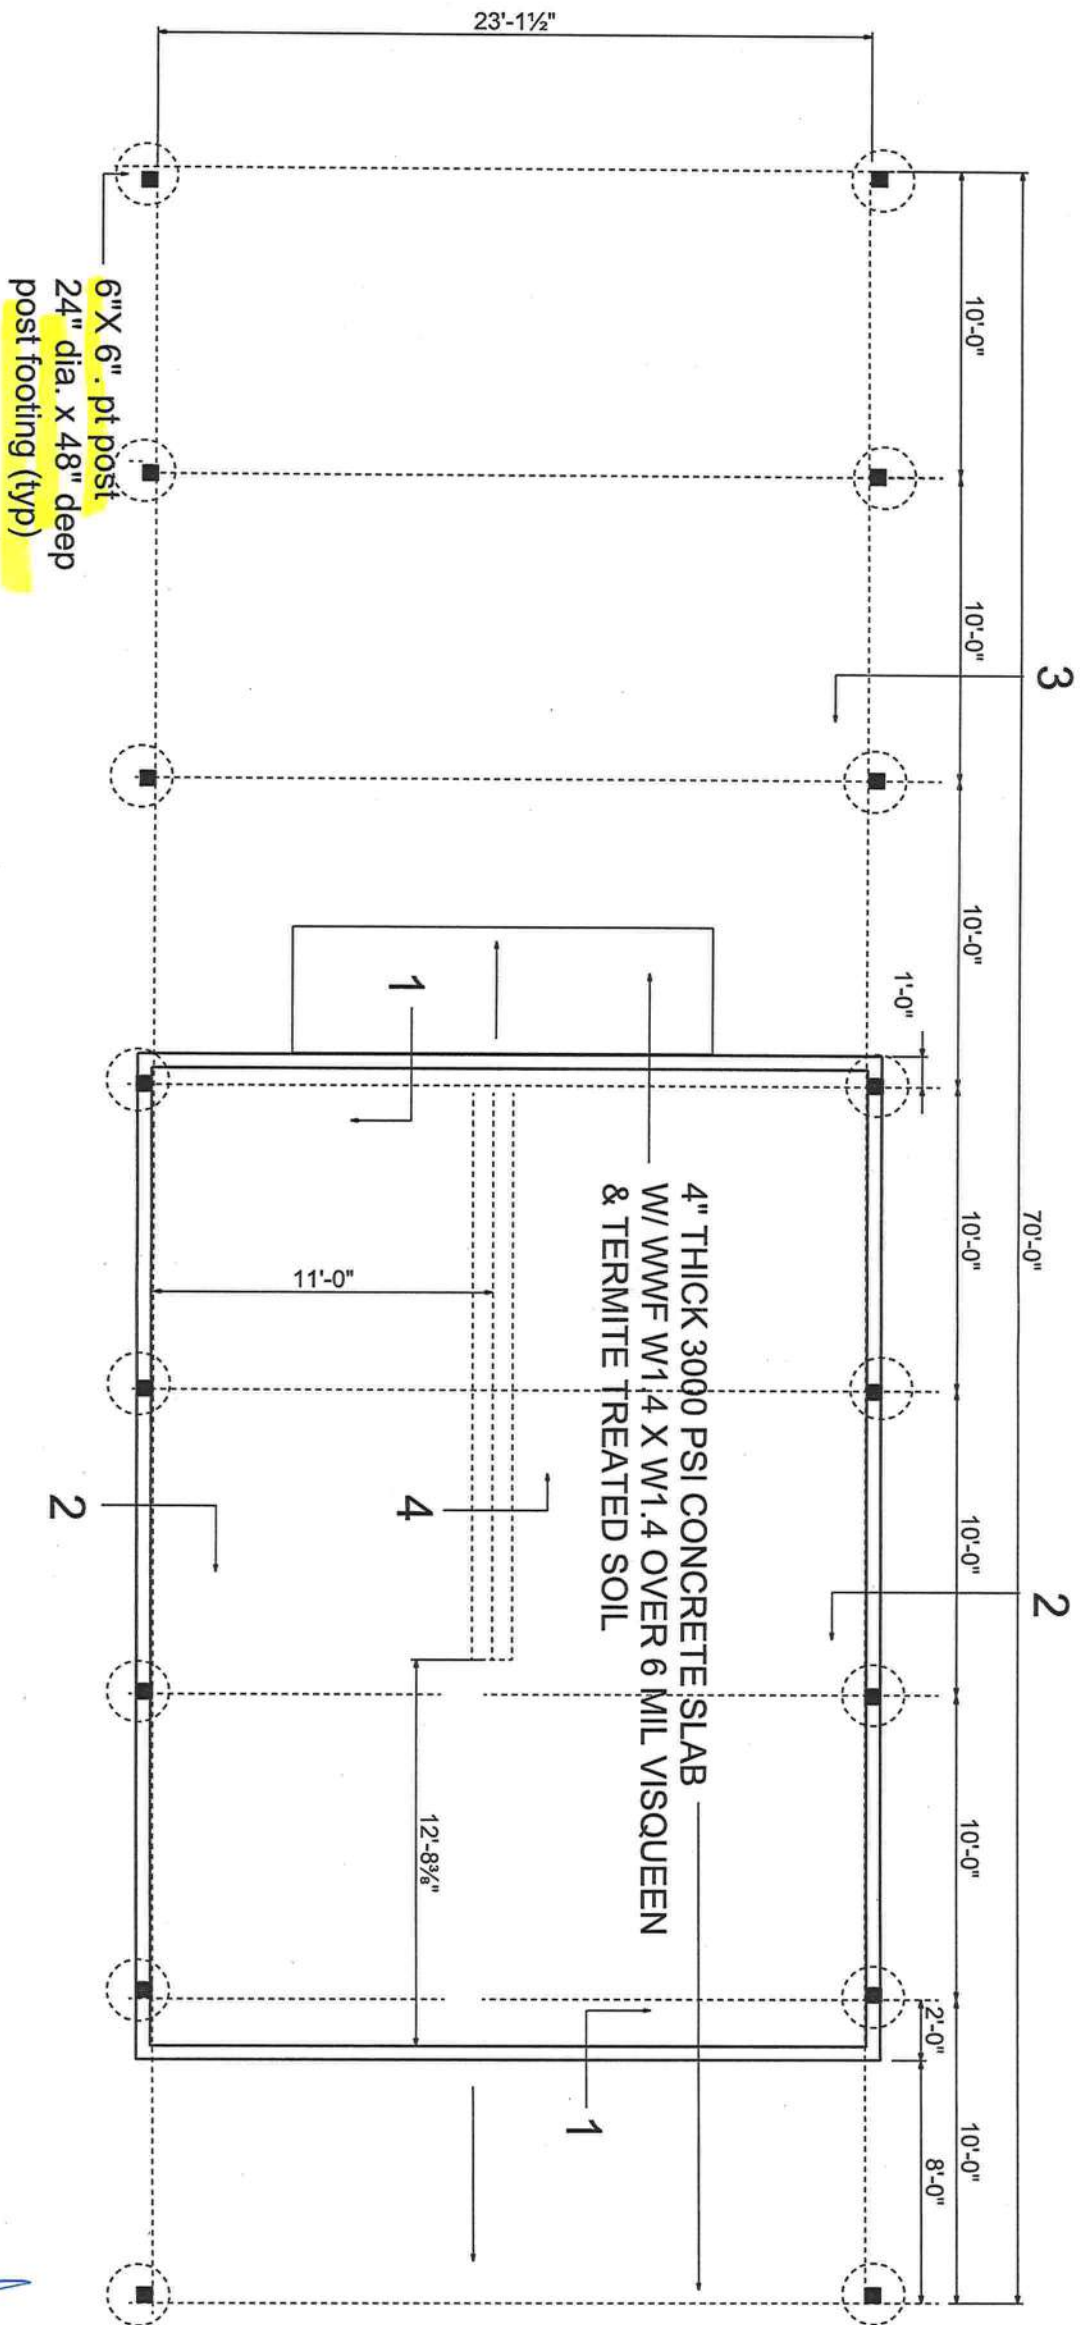

# FOUNDATION PLAN VIEW

3/16" = 1'-0"

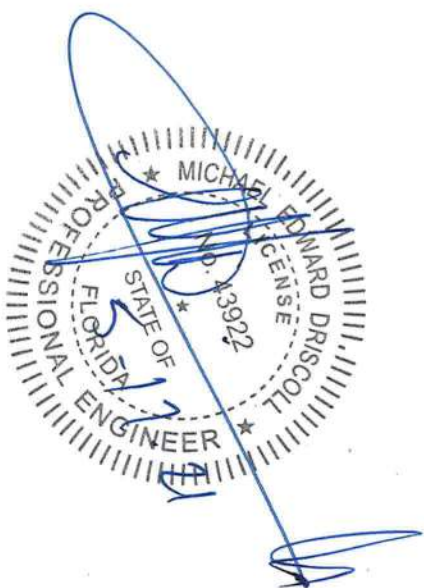


5-15-21  
Michael E Driscoll PE  
FL Reg # 43922


DRISCOLL ENGINEERING, INC.  
CONSULTING ENGINEERS  
PO BOX 357577 GAINESVILLE, FL 32606  
PH (352) 331-1513  
FX (352) 505-3366  
CA 8690

PRIOR  
300 SW LEGREE TERR  
FT WHITE, FL. DB21-220

SHEET:  
2

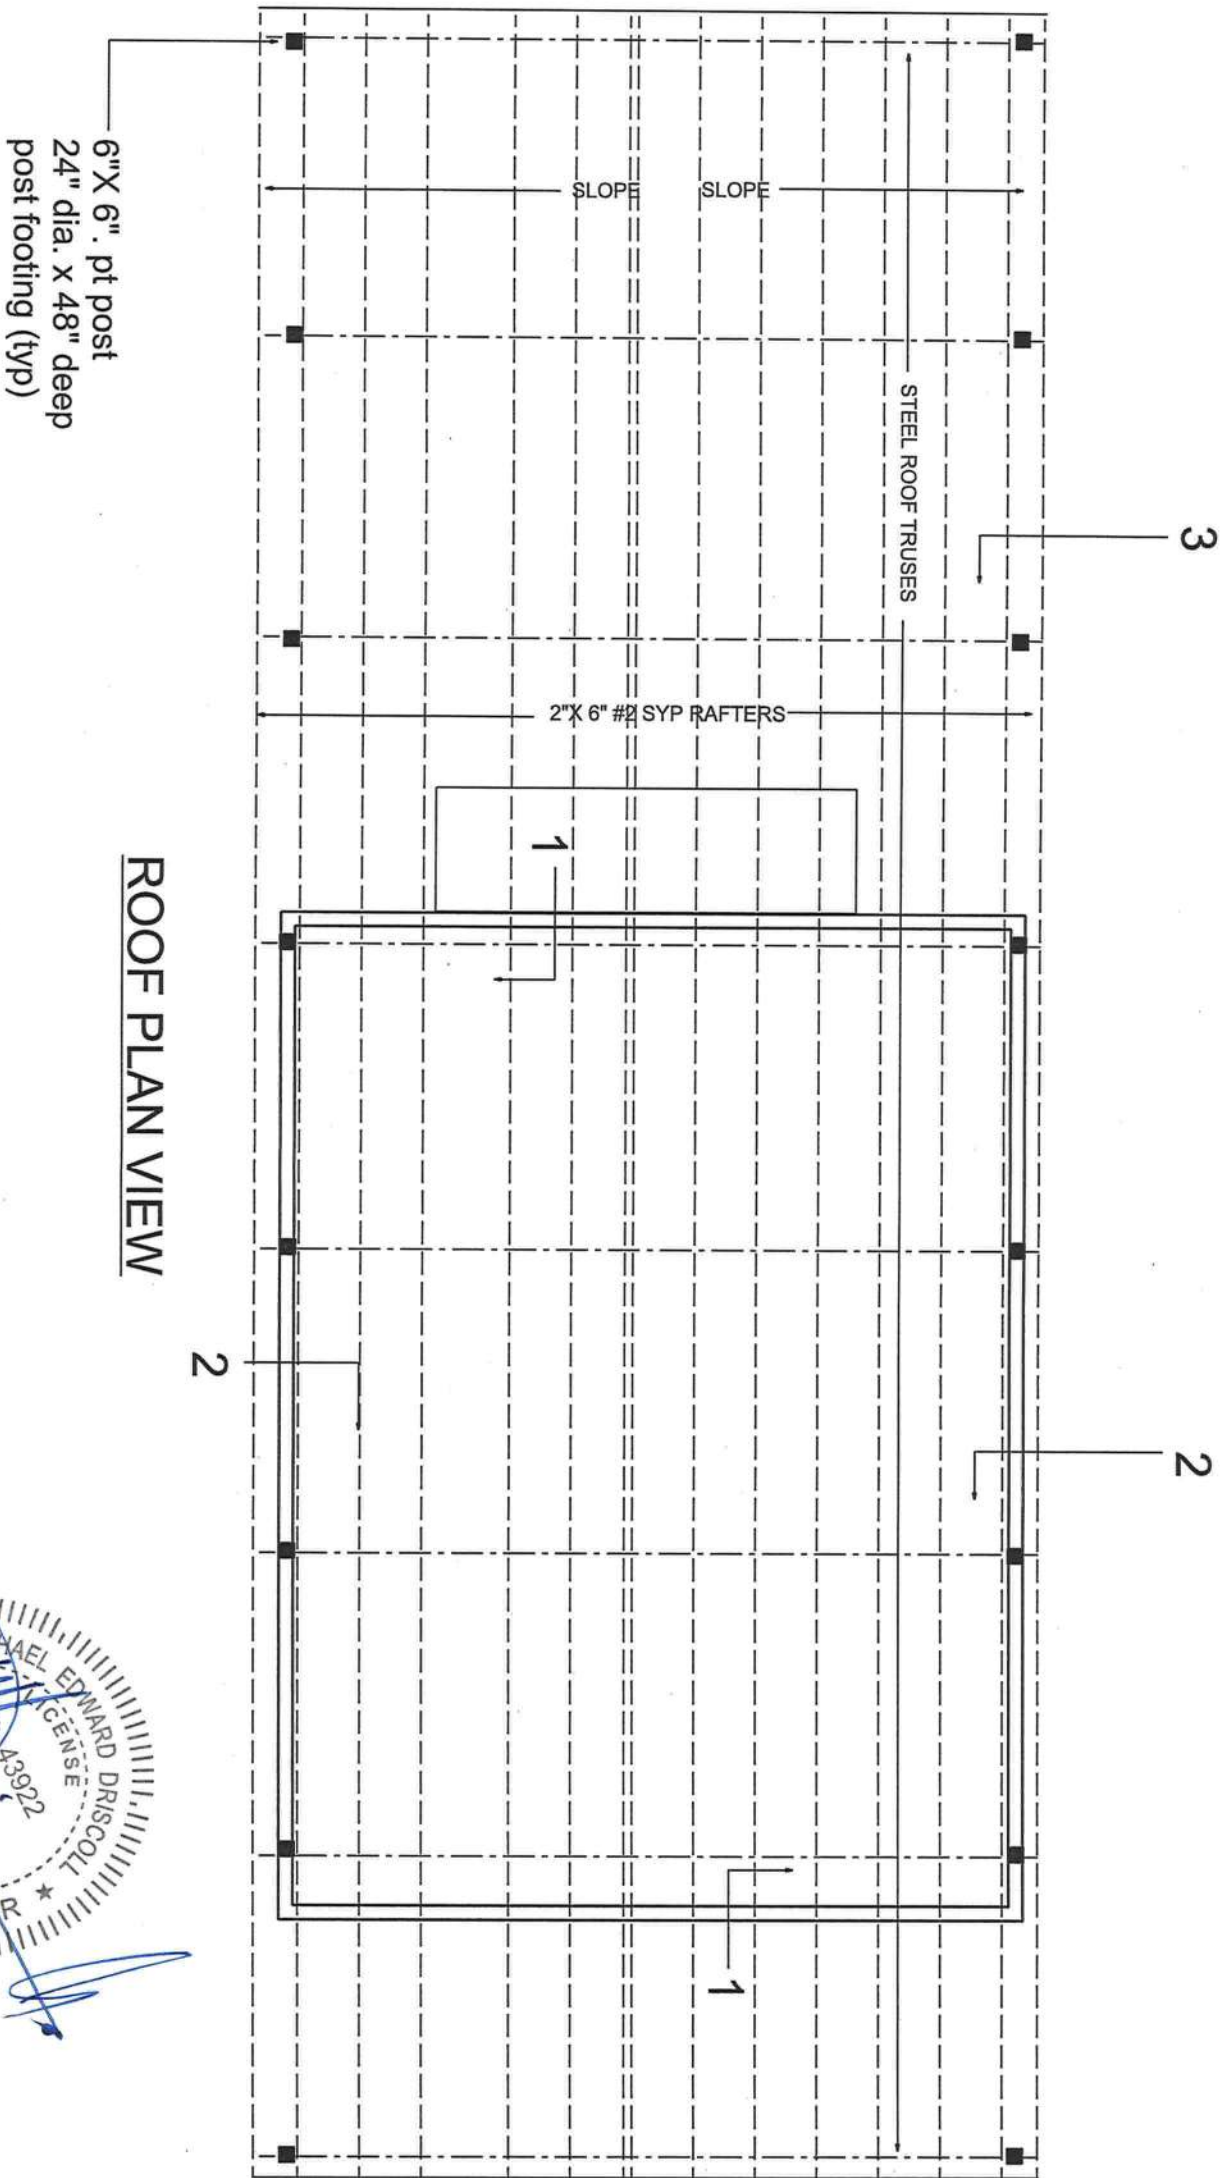

ROOF PLAN VIEW

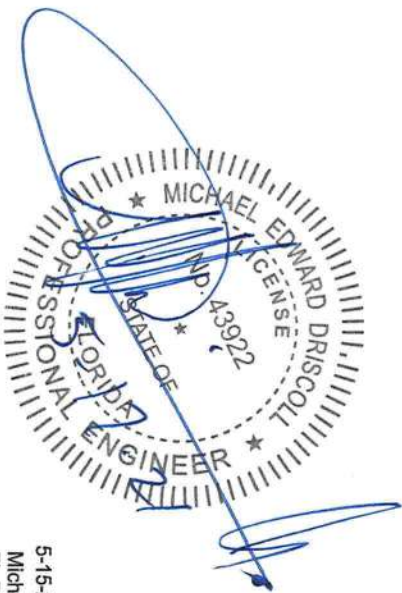

5-15-21  
Michael E Driscoll PE  
FL Reg # 43922



DRISCOLL ENGINEERING, INC.  
CONSULTING ENGINEERS  
PO BOX 357577 GAINESVILLE, FL 32606  
PH (352) 331-1513 CA 8690  
FX (352) 505-3366

PRIOR  
300 SW LEGREE TERR  
FT WHITE, FL. DB21-220



29 ga. metal roofing attach in  
accord with mfr. specifications  
FL # 9555.4R4

2"x 6" #2 syp  
purlins @ 24" max spacing

2- 1/2" dia. carriage thru bolts  
nut & washer to match

Truss details  
(see sheet 5 & 6)

2"x 6" BLOCKING CONT.  
ATTACH TO PURLINS W/ 2 12d COMMON NAILS

2"x 6" #2 syp  
purlins @ 24" max spacing

5/8" SHEETROCK OR 1/2" NON SAG  
OR EQUAL

2"x 4" #2 syp 3-1/2" VERTICAL  
ATTACH ENDS TO EACH POST  
W/ 2- #10 X 3-1/2" SCREWS (TYP)

2- 2"x 6 @ DOOR HEADER  
EACH WAY

2"x 6" BLOCKING @ 24" MAX SPACING  
ATTACH TO PURLINS W/ 2 12d COMMON NAILS

ea. end

26 ga. metal roofing attach in  
accord with mfr. specifications  
FL Product approval # 9555.4-R4

see truss details

2- 1/2" dia. carriage thru bolts  
nut & washer to match

2"x 6" TOP PLATE

2"x 4" #2 syp 3-1/2" VERTICAL  
ATTACH ENDS TO EACH POST  
W/ 2- #10 X 3-1/2" SCREWS (TYP)

2- 2"x 10" CEILING JOIST  
@ 24" MAX SPACING

2- 2"x 6 @ DOOR HEADER  
EACH WAY

5/8" SHEETROCK OR 1/2" NON SAG

26 ga metal

2"x 4" MIN #2 SYP @ 24" MAX SPACING

2"x 6" #2 SPF STUDS  
@ 16" MAX SPACING

24" (TYP)

CLOSED CELL INSULATION

See post size sheets 2 & 3

24" (TYP)

3/8" dia x 4" Simpson Titan  
or equal @ 32" max spacing

2"x 6" PT PLATE

4" THICK 3000 PSI CONCRETE SLAB  
W/ WVF W/ 4 X W/ 4 OVER 6 MIL VISQUEEN  
& TERMITTE TREATED SOIL

See sheet 2 & 3 for  
size

#5 X 12" BARS CENTERED EACH WAY  
FOR 18" DIA HOLES USE 12" LONG BARS  
FOR 24" DIA HOLES USE 18" LONG BARS (TYP)

20" DEEP X 12" WIDE FOOTING  
W/ 2 #5 BARS CONT. 3" CLR EW

80# BAG SACRETE MIN.  
OR 24" SQ X 4" THICK  
CONCRETE PAD

POST FOOTING TO TRUSS DETAIL

SECTION 2

POST FOOTING TO TRUSS DETAIL

SECTION 3

Min 3000psi  
concrete

48"

4" (TYP)

80# BAG SACRETE MIN.  
OR 24" SQ X 4" THICK  
CONCRETE PAD

See sheet 2 & 3 for  
size

#5 X 12" BARS CENTERED EACH WAY  
FOR 18" DIA HOLES USE 12" LONG BARS  
FOR 24" DIA HOLES USE 18" LONG BARS (TYP)

80# BAG SACRETE MIN.  
OR 24" SQ X 4" THICK  
CONCRETE PAD

12" WIDE X 8" DEEP THICKENED SLAB  
W/ 2 #5 BARS CONT. 3" MIN CLR

SECTION 4

POST FOOTING TO TRUSS DETAIL


SECTION 1

5-15-21  
Michael E Driscoll PE  
FL Reg # 43922



DRISCOLL ENGINEERING, INC.  
CONSULTING ENGINEERS  
PO BOX 357577  
GAINESVILLE, FL 32606  
PH (352) 331-1513  
FX (352) 505-3366  
CA 8690

PRIOR  
300 SW LEGREE TERR  
FT WHITE, FL. DB21-220

SHEET:  
4

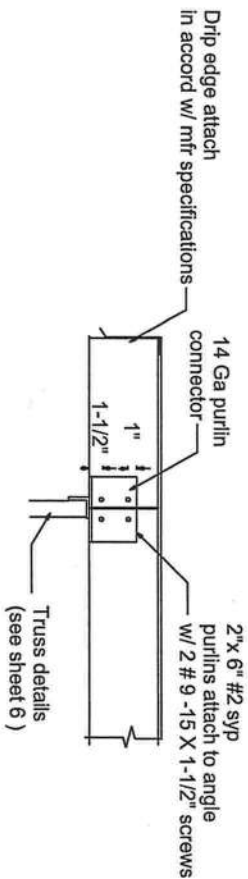

# PURLIN CONNECTION DETAIL

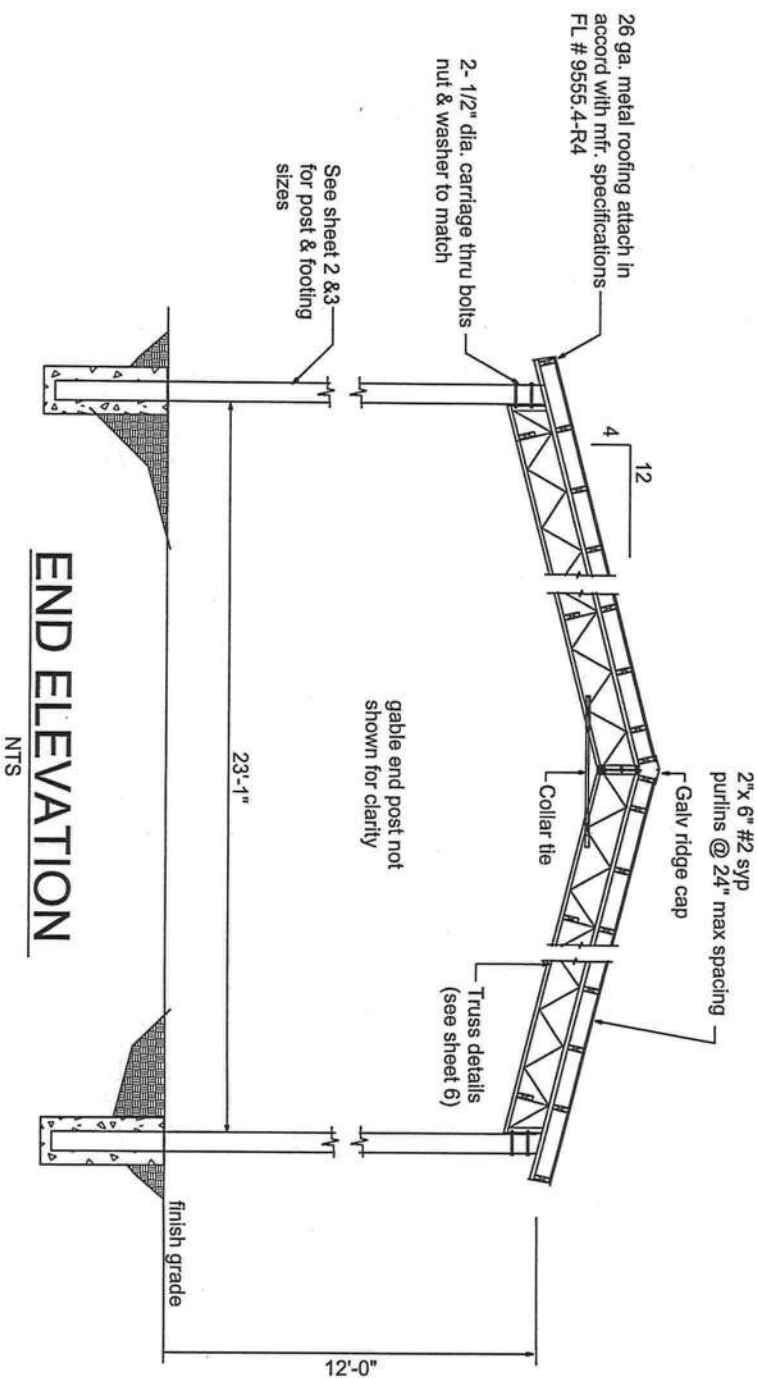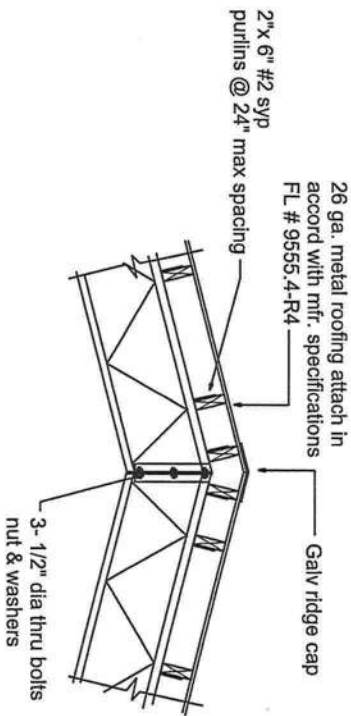

5-15-21  
Michael E Driscoll PE  
FL Reg # 43922




DRISCOLL ENGINEERING, INC.  
CONSULTING ENGINEERS  
PO BOX 357577  
GAINESVILLE, FL. 32606  
PH (352) 331-1513  
FX (352) 505-3366  
CA 8690

PRIOR  
300 SW LEGREE TERR  
FT WHITE, FL. DB21-220

SHEET:  
5




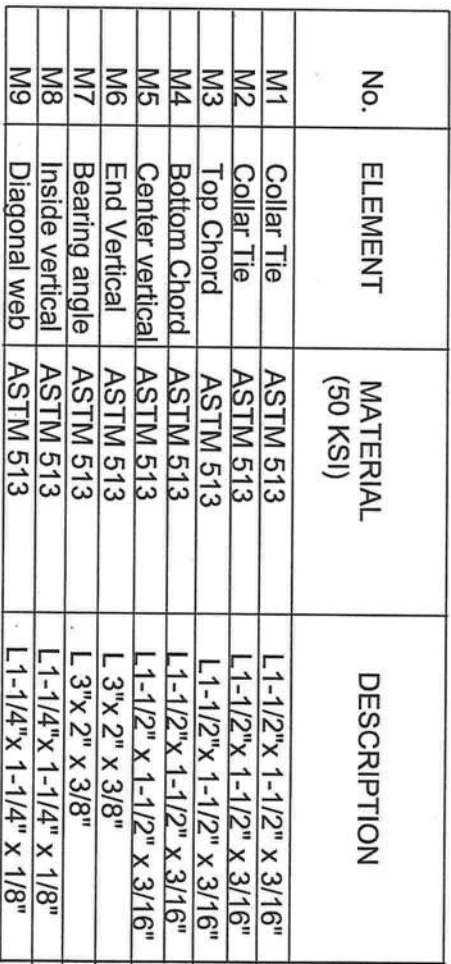

## CONNECTOR SCHEDULE

2"x 6" #2 syp purlin to 6"x 6" x 14 ga. clip 2-#9 x 1-1/4" screws  
Truss to truss @ ridge 3-1/2" dia thru bolts & nut  
Wood post to truss- 2 1/2" dia thru bolts nut & washers  
Post to concrete 24" dia x 48" deep w/ 2 #5 bars thru post

2-1/2" DIA. CARRIAGE  
BOLTS NUT & WASHERS (TYP)

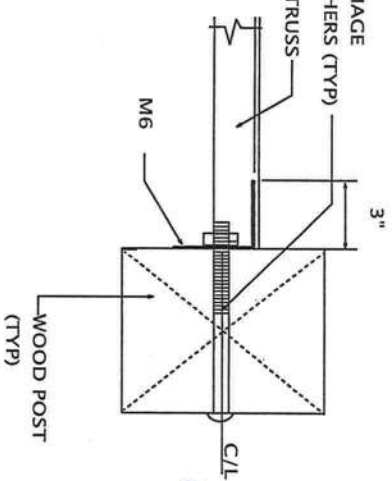


## TRUSS DETAILS

5-15-21  
Michael E Driscoll PE  
FL Reg # 43922



Electrical symbols	
Ⓢ	single pole switch
ⓈⓈ	dimmer switch
Ⓢ	3 way switch
Ⓢ	110 arc outlet
Ⓢ	220 OUTLET
Ⓢ	GFI outlet
Ⓢ	switched outlet
Ⓢ	sid overhead light
Ⓢ	recessed light
Ⓢ	light / exhaust fan 80 cfm
Ⓢ	wall mount light fixture
Ⓢ	sid overhead light
Ⓢ	double flood light
Ⓢ	track bar light
Ⓢ	vanity bar light
Ⓢ	fluorescent light
Ⓢ	ceiling fan -light
Ⓢ	smoke/carbon monoxide detector
Ⓢ	phone outlet
Ⓢ	tv outlet
Ⓢ	THERMOSTAT

OVERHEAD POWER

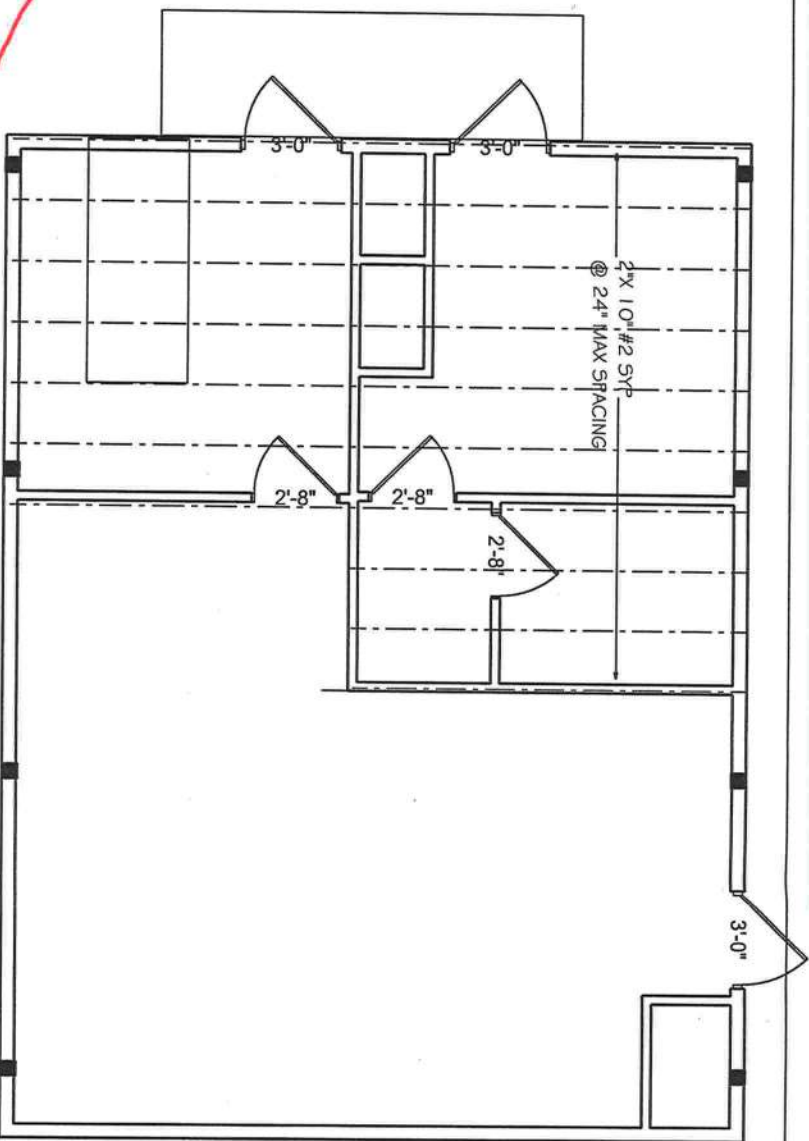


CEILING JOIST


1. THIS BUILDING SHALL BE CONSTRUCTED IN ACCORD WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE 2020 6TH EDITION
2. ALL AREAS EXCEPT WHERE GFI RECEPTALS ARE REQUIRED RECEPTALS SHALL BE ARC FAULT
3. ELECTRICAL DESIGN BY ELECTRICAL CONTRACTOR.
4. CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO BEGINNING.
5. SMOKE DETECTORS SHALL BE WIRED TO ALARM SIMULTANEOUS WITH BATTERY BACKUP.

DESIGN CRITERIA	
ULTIMATE WIND SPEED:	130
NOMINAL WIND SPEED:	101
WIND EXPOSURE CATEGORY:	B
RISK CATEGORY	11
INTERIOR PRESSURE COEFFICIENT OR $C_{pi}$	$\pm 0.18$
ASSUMED DESIGN LOAD BEARING VALUE OF SOIL	1,500 PSF
FLOOR LIVE LOAD	40 PSF
ROOF LIVE LOAD	20 PSF


LIVING AREA	792 SQ. FT
COVERED PORCH	192 SQ. FT
PARKING COVER	696 SQ. FT
TOTAL	1680 SQ. FT

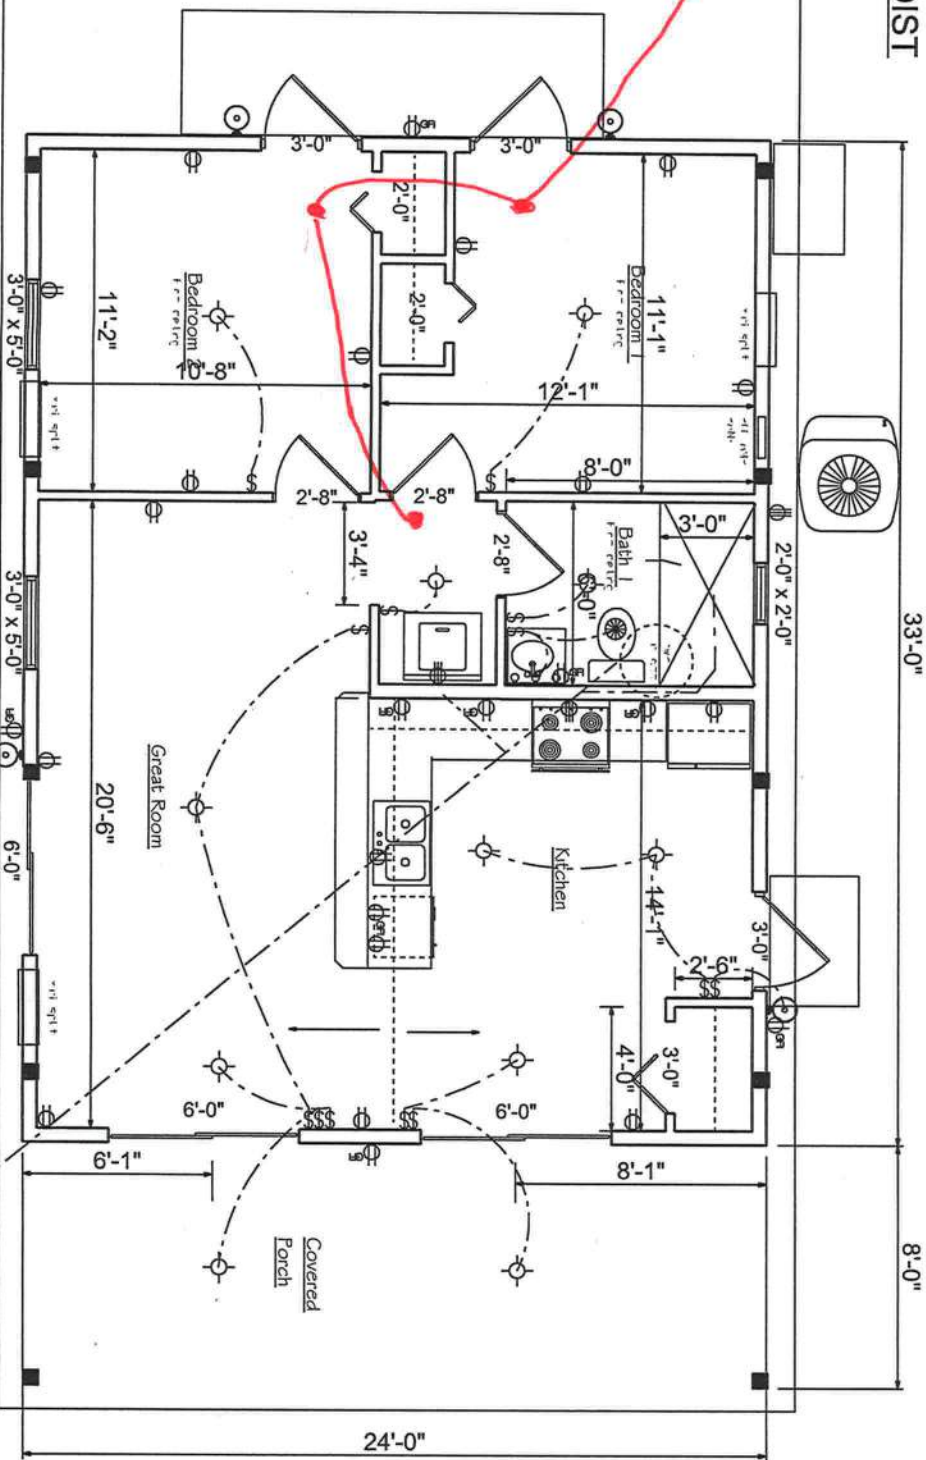


FLOOR PLAN

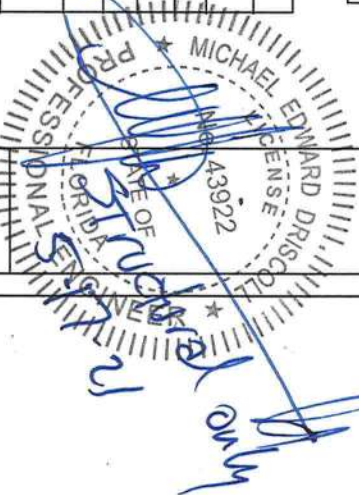




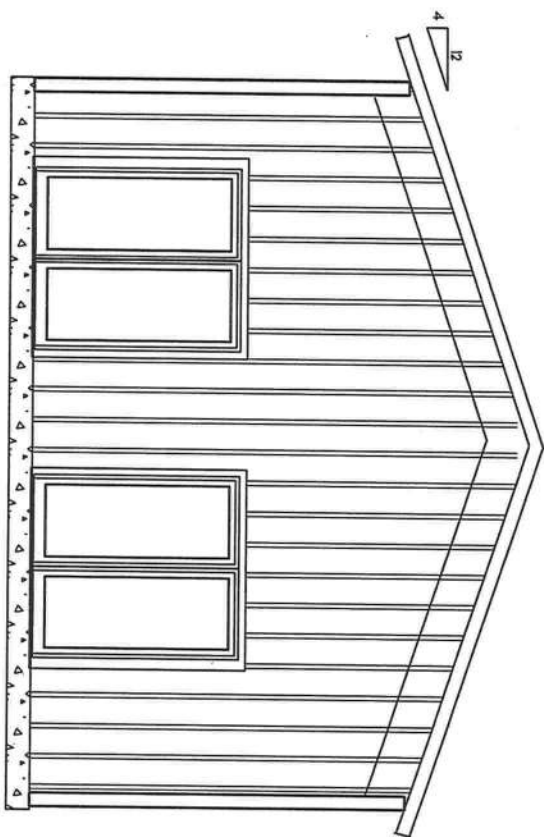


FRONT ELEVATION

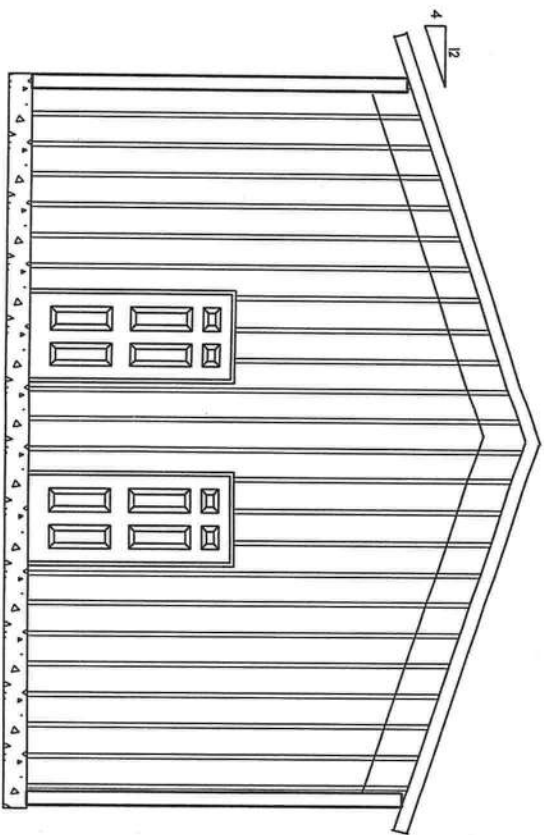

FRONT ELEVATION

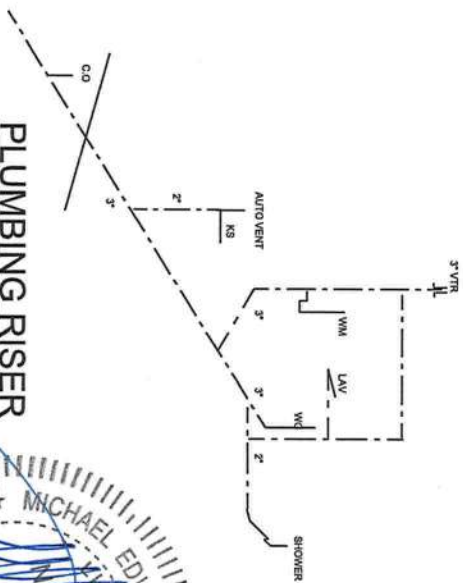


PLUMBING RISER

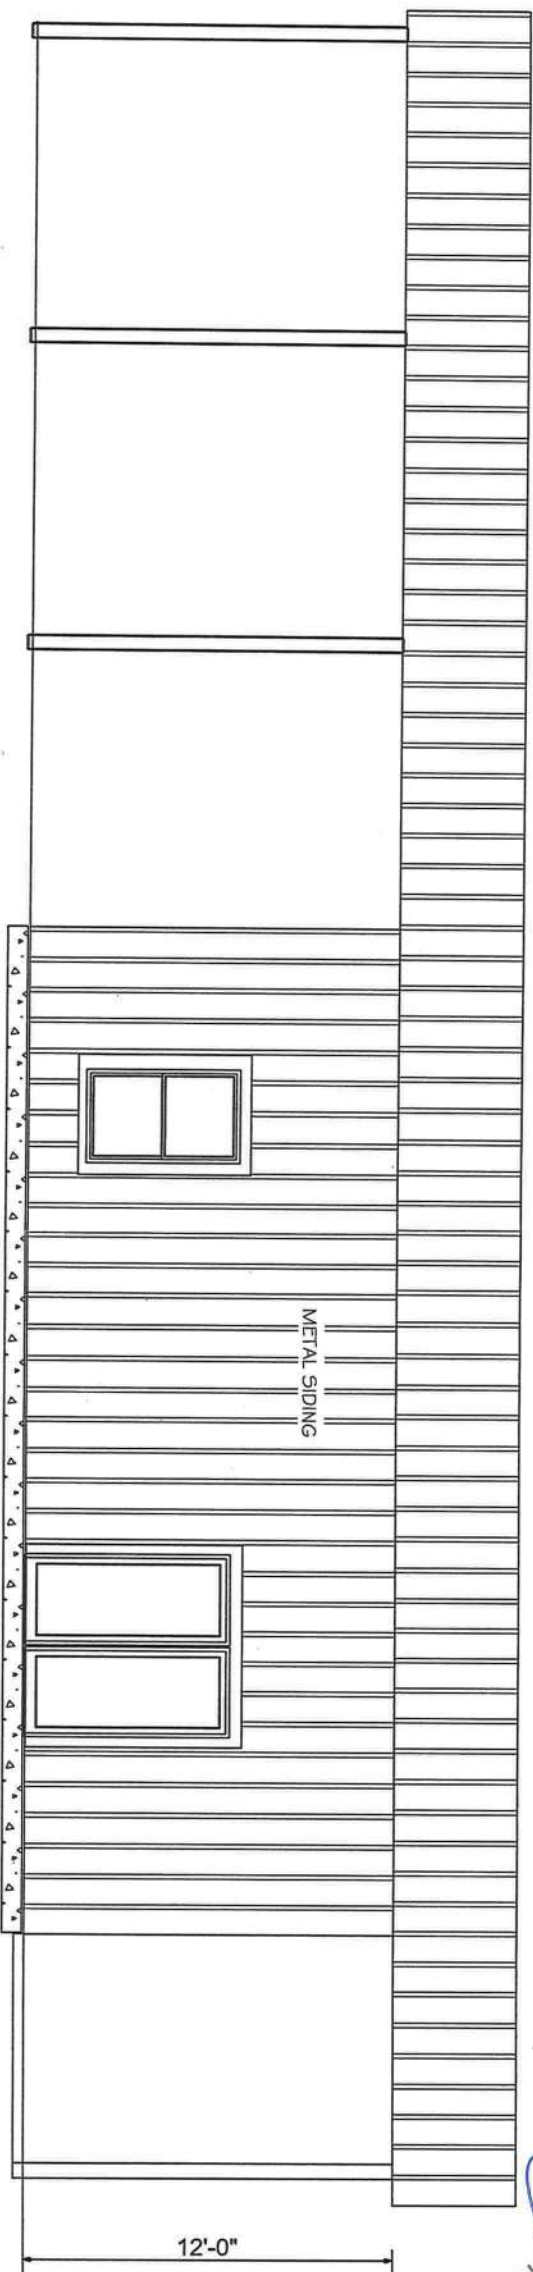

LEFT ELEVATION

12'-0"

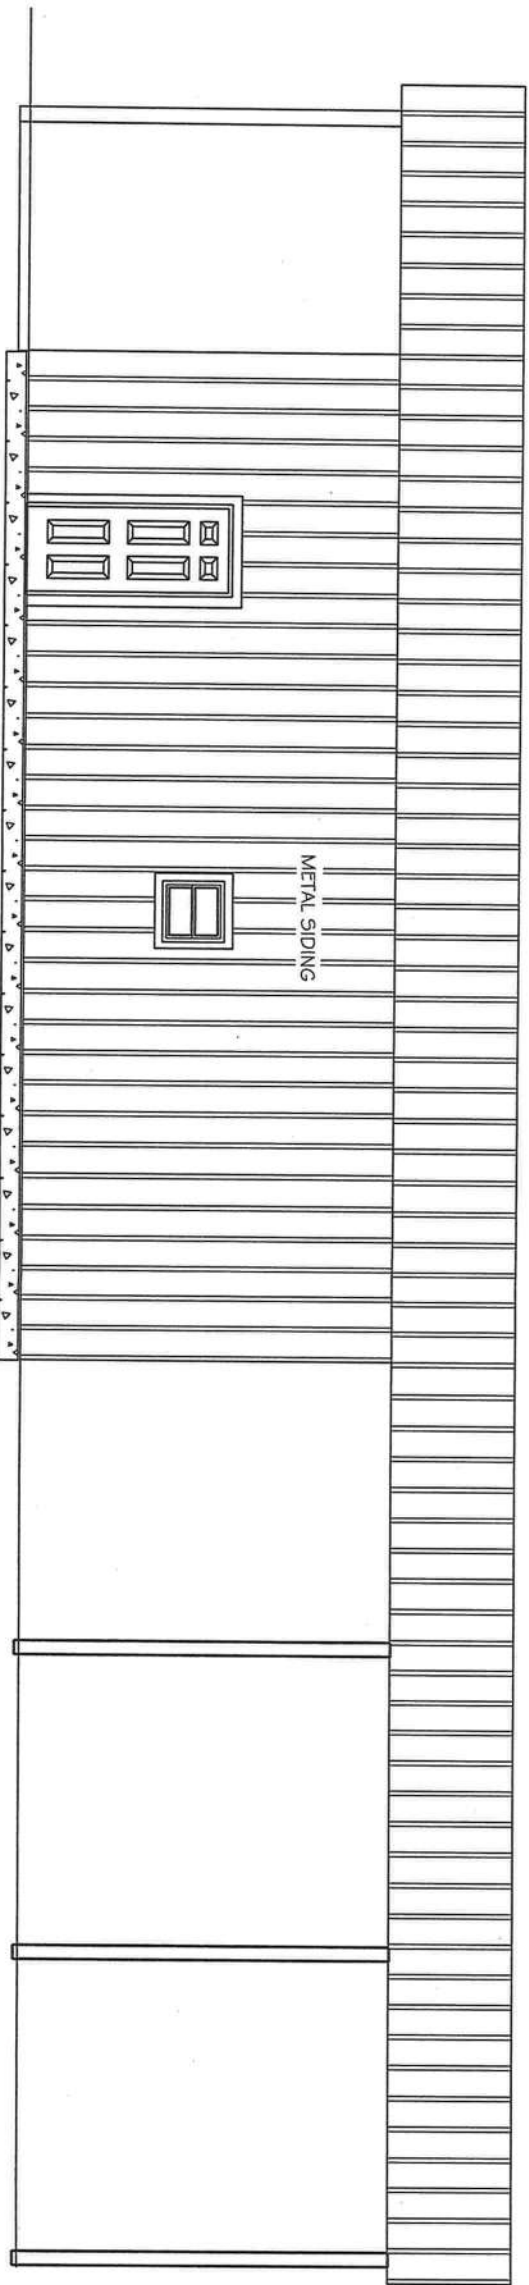

RIGHT ELEVATION



PRIOR  
300 SW LEGREE TERR  
FT WHITE, FL. DB21-220

SHEET:  
8

5-11-21  
Michael E Driscoll PE  
FL Reg # 43922  
STRUCTURAL ONLY