



Lumber design values are in accordance with ANSI/TPI 1 section 6.3  
These truss designs rely on lumber values established by others.

RE: 4460945 - JONES RES.

MiTek, Inc.  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200

**Site Information:**

Customer Info: IC CONSTRUCTION Project Name: Jones Res. Model: Custom  
Lot/Block: N/A Subdivision: N/A  
Address: TBD, TBD  
City: Columbia Cty State: FL

**Name Address and License # of Structural Engineer of Record, If there is one, for the building.**

Name: License #:  
Address:  
City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.8  
Wind Code: ASCE 7-22 Wind Speed: 130 mph  
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 81 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T37036599	CJ01	4/18/25	15	T37036613	PB03G	4/18/25
2	T37036600	CJ03	4/18/25	16	T37036614	PB04	4/18/25
3	T37036601	CJ05	4/18/25	17	T37036615	PB04G	4/18/25
4	T37036602	EJ01	4/18/25	18	T37036616	PB05	4/18/25
5	T37036603	EJ02	4/18/25	19	T37036617	PB06	4/18/25
6	T37036604	EJ03	4/18/25	20	T37036618	PB07	4/18/25
7	T37036605	EJ04	4/18/25	21	T37036619	PB08	4/18/25
8	T37036606	EJ05	4/18/25	22	T37036620	PB08G	4/18/25
9	T37036607	EJ06	4/18/25	23	T37036621	PB09	4/18/25
10	T37036608	HJ10	4/18/25	24	T37036622	T01	4/18/25
11	T37036609	PB01	4/18/25	25	T37036623	T01DD	4/18/25
12	T37036610	PB01G	4/18/25	26	T37036624	T01G	4/18/25
13	T37036611	PB02	4/18/25	27	T37036625	T02	4/18/25
14	T37036612	PB03	4/18/25	28	T37036626	T03	4/18/25

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date adjacent to the seal.


Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by  
MiTek USA, Inc. under my direct supervision based on the parameters  
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: Velez, Joaquin

My license renewal date for the state of Florida is February 28, 2027.

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

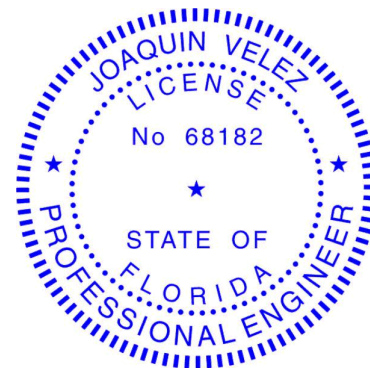

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

April 18,2025

Velez, Joaquin

1 of 2



RE: 4460945 - JONES RES.

MiTek, Inc.  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200

**Site Information:**

Customer Info: IC CONSTRUCTION   Project Name: Jones Res.   Model: Custom  
Lot/Block: N/A   Subdivision: N/A  
Address: TBD, TBD  
City: Columbia Cty   State: FL

No.	Seal#	Truss Name	Date
29	T37036627	T03G	4/18/25
30	T37036628	T03GG	4/18/25
31	T37036629	T04	4/18/25
32	T37036630	T04G	4/18/25
33	T37036631	T05	4/18/25
34	T37036632	T06	4/18/25
35	T37036633	T07	4/18/25
36	T37036634	T08	4/18/25
37	T37036635	T09	4/18/25
38	T37036636	T10	4/18/25
39	T37036637	T13	4/18/25
40	T37036638	T14	4/18/25
41	T37036639	T15	4/18/25
42	T37036640	T16	4/18/25
43	T37036641	T17	4/18/25
44	T37036642	T18	4/18/25
45	T37036643	T19	4/18/25
46	T37036644	T19G	4/18/25
47	T37036645	T20	4/18/25
48	T37036646	T21	4/18/25
49	T37036647	T22	4/18/25
50	T37036648	T23	4/18/25
51	T37036649	T23D	4/18/25
52	T37036650	T24	4/18/25
53	T37036651	T24G	4/18/25
54	T37036652	T25	4/18/25
55	T37036653	T26	4/18/25
56	T37036654	T26G	4/18/25
57	T37036655	T27	4/18/25
58	T37036656	T28	4/18/25
59	T37036657	T28G	4/18/25
60	T37036658	T29	4/18/25
61	T37036659	T30	4/18/25
62	T37036660	T31	4/18/25
63	T37036661	T31G	4/18/25
64	T37036662	T32	4/18/25
65	T37036663	T33	4/18/25
66	T37036664	T34	4/18/25
67	T37036665	T34G	4/18/25
68	T37036666	T35	4/18/25
69	T37036667	T36	4/18/25
70	T37036668	T37	4/18/25
71	T37036669	T38	4/18/25
72	T37036670	T38G	4/18/25
73	T37036671	T39	4/18/25
74	T37036672	T40	4/18/25
75	T37036673	TG01	4/18/25
76	T37036674	V01	4/18/25
77	T37036675	V02	4/18/25
78	T37036676	V03	4/18/25
79	T37036677	V04	4/18/25
80	T37036678	V05	4/18/25
81	T37036679	V06	4/18/25


Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	CJ01	Jack-Open	2	1	T37036599
					Job Reference (optional)

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:06 2025 Page 1

ID:7CvAcxg5dm4g2lcSLiTv78yDLlr-ujvH\_jjlPXiz8qG97Fxx4p8h0Z3h7Wa74Rp4uyzPu5N

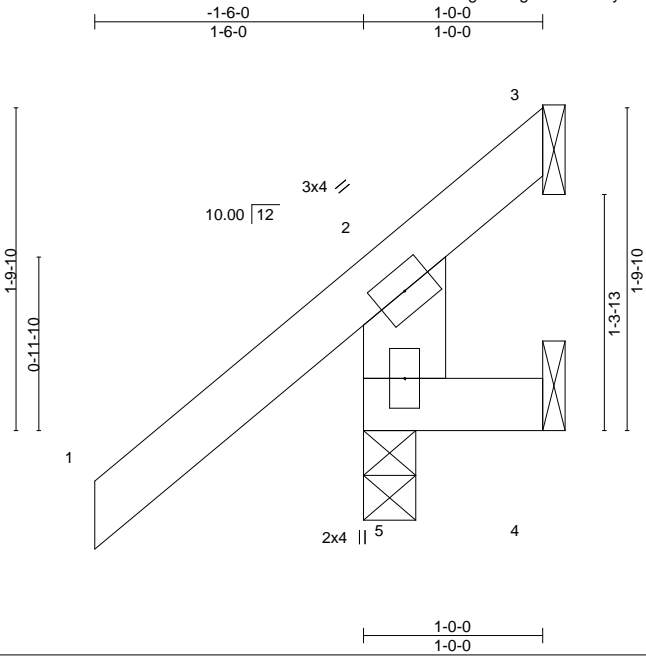

Scale = 1:12.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.35	Vert(LL)	0.00 5	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.07	Vert(CT)	0.00 5	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00 3	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MR					Weight: 8 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=61(LC 12)  
Max Uplift 5=-63(LC 12), 3=-46(LC 1), 4=-42(LC 1)  
Max Grav 5=252(LC 1), 3=11(LC 8), 4=3(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; end vertical left exposed; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 63 lb uplift at joint 5, 46 lb uplift at joint 3 and 42 lb uplift at joint 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:07 2025 Page 1  
ID:7CvAcxa5dm4a2IcSLITv78vDLlr-MvSfC3kN9raam rl-hvSAc0hrIzP6szaGI5ZeROzPu5M

Weight: 15 lb      FT = 20%

TOP CHORD	Structural wood sheathing directly applied or 3-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=124(LC 12)  
Max Uplift 5=-26(LC 12), 3=-71(LC 12), 4=-29(LC 9)  
Max Grav 5=245(LC 1), 3=70(LC 19), 4=47(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCp=-0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 2-11-4 zone; end vertical left exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 26 lb uplift at joint 5, 71 lb uplift at joint 3 and 29 lb uplift at joint 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18, 2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Components Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

MiTek®


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	CJ05	Jack-Open	2	1	T37036601
Job Reference (optional)					

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:07 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-MvSfC3kN9rqm\_rLhySAc0hp2zLZszqG15ZeROzPu5M



Scale = 1:30.2

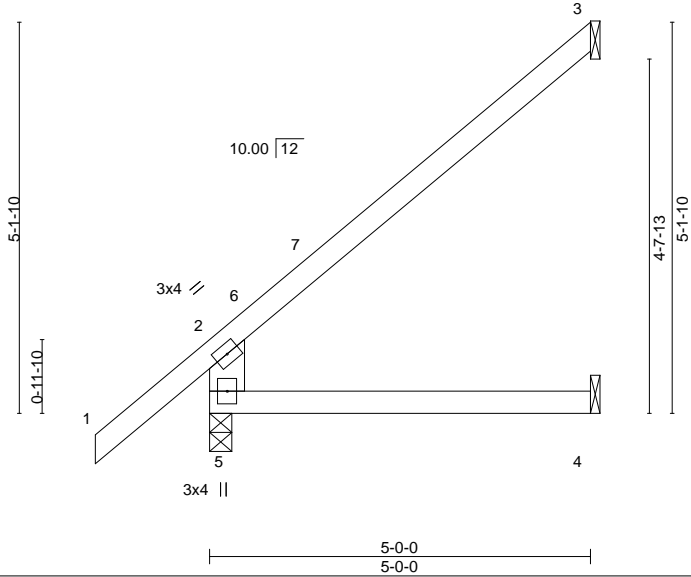

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.46	Vert(LL)	0.07	4-5	>821	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.35	Vert(CT)	0.06	4-5	>935	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.06	3	n/a	n/a		
BCDL 10.0	Code FBC2023/TP12014		Matrix-MR						Weight: 22 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x6 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=199(LC 12)  
Max Uplift 5=26(LC 9), 3=123(LC 12), 4=43(LC 9)  
Max Grav 5=311(LC 1), 3=134(LC 19), 4=87(LC 3)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-268/190

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 4-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 26 lb uplift at joint 5, 123 lb uplift at joint 3 and 43 lb uplift at joint 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	EJ01	Jack-Partial	5	1	T37036602
Builders FirstSource (Lake City,FL), Lake City, FL - 32055,					Job Reference (optional)

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:08 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-q501PPI?w9yhO8QXEgzP9ED28NgubPVQXIIBzrzPu5L

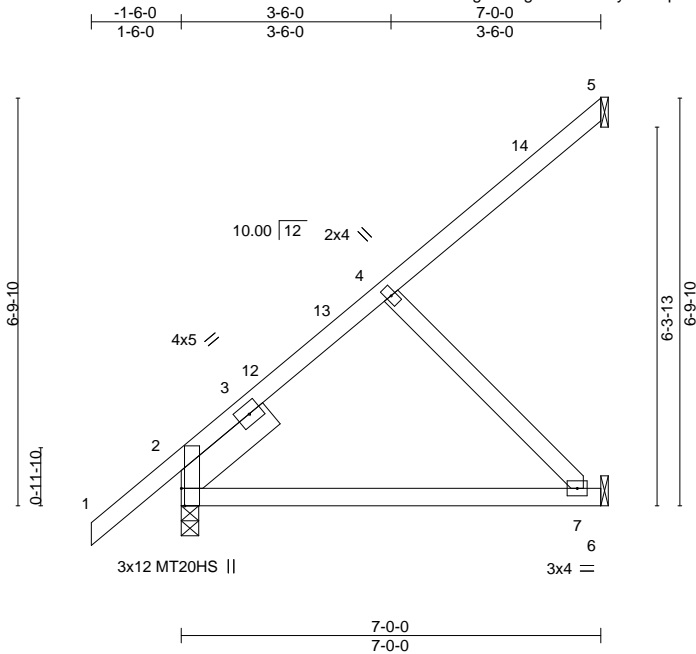


Plate Offsets (X,Y)--		[2:0-3-8,Edge]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.25
TCDL 10.0	Lumber DOL	1.25	BC 0.41
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.10
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
			<b>DEFL.</b>
			in (loc) l/defl L/d
			Vert(LL) -0.07 7-10 >999 240
			Vert(CT) -0.14 7-10 >589 180
			Horz(CT) 0.02 2 n/a n/a
			<b>PLATES</b>
			MT20 244/190
			MT20HS 187/143
			Weight: 39 lb FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x6 SP No.2 1-11-8

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 5=Mechanical, 2=0-3-8, 6=Mechanical  
Max Horz 2=255(LC 12)  
Max Uplift 5=-62(LC 12), 2=-19(LC 12), 6=-113(LC 12)  
Max Grav 5=92(LC 19), 2=377(LC 1), 6=208(LC 19)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-497/23

**NOTES-**

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 6-11-4 zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) All plates are MT20 plates unless otherwise indicated.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 62 lb uplift at joint 5, 19 lb uplift at joint 2 and 113 lb uplift at joint 6.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	EJ02	Jack-Partial	4	1	T37036603
Builders FirstSource (Lake City,FL), Lake City, FL - 32055,					Job Reference (optional)

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:08 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-q501PPI?w9yhO8QXEgzP9ED2MNkMbPiQXIIBzrzPu5L

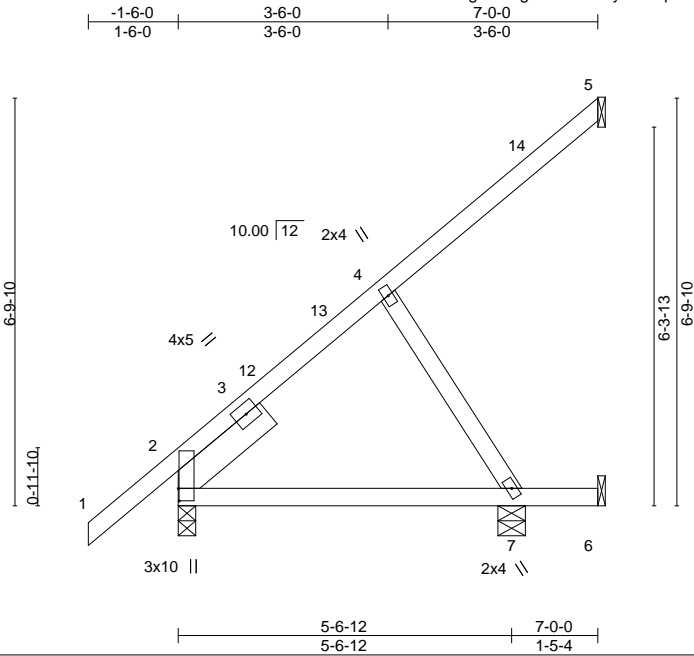


Plate Offsets (X,Y)-- [2:0-2-8,0-0-3]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP	
TCLL	20.0	Plate Grip DOL 1.25		TC	0.23	Vert(LL)	-0.02	7-10	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.19	Vert(CT)	-0.03	7-10	>999	180	
BCLL	0.0 *	Rep Stress Incr YES		WB	0.08	Horz(CT)	-0.01	5	n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS						Weight: 38 lb FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
SLIDER Left 2x6 SP No.2 1-11-8	

**REACTIONS.** All bearings Mechanical except (jt=length) 2=0-3-8, 7=0-5-8.  
(lb) - Max Horz 2=255(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 5, 2, 6 except 7=158(LC 9)  
Max Grav All reactions 250 lb or less at joint(s) 5, 6 except 2=331(LC 1), 7=278(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 4-7=-201/260

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 6-11-4 zone; end vertical left exposed; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6 except (jt=lb) 7=158.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036604
4460945	EJ03	Jack-Closed	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:09 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-lIaQdldhS4Y?I?koNUehRmBPn2IKtKZmP2kVHzPu5K

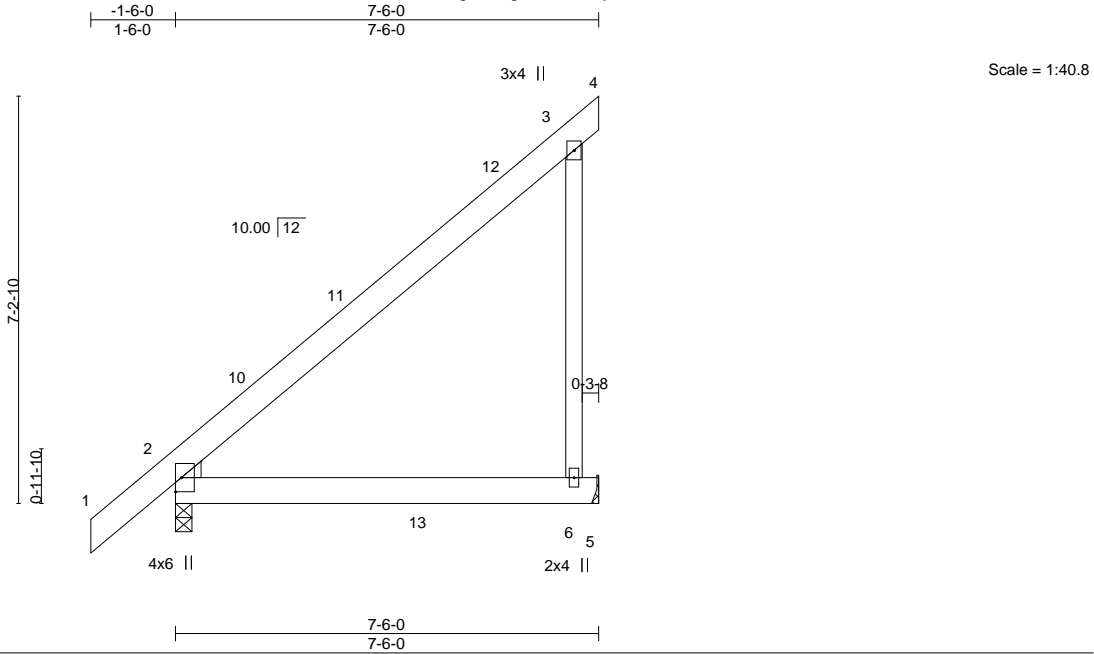

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.34	Vert(LL)	0.06 6-9	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.31	Vert(CT)	-0.10 6-9	>919	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.02 2	n/a	n/a		
BCDL 10.0	Code FBC2023/TP12014		Matrix-MS					Weight: 55 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 5=Mechanical  
Max Horz 2=266(LC 12)  
Max Uplift 2=-28(LC 12), 5=-171(LC 12)  
Max Grav 2=428(LC 19), 5=410(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 7-6-0 zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 5=171.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	EJ04	Jack-Open	8	1	T37036605
Job Reference (optional)					

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:09 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-lIaQdlldhS4Y?l?koNUehRmDun07KslZmP2kVHzPu5K

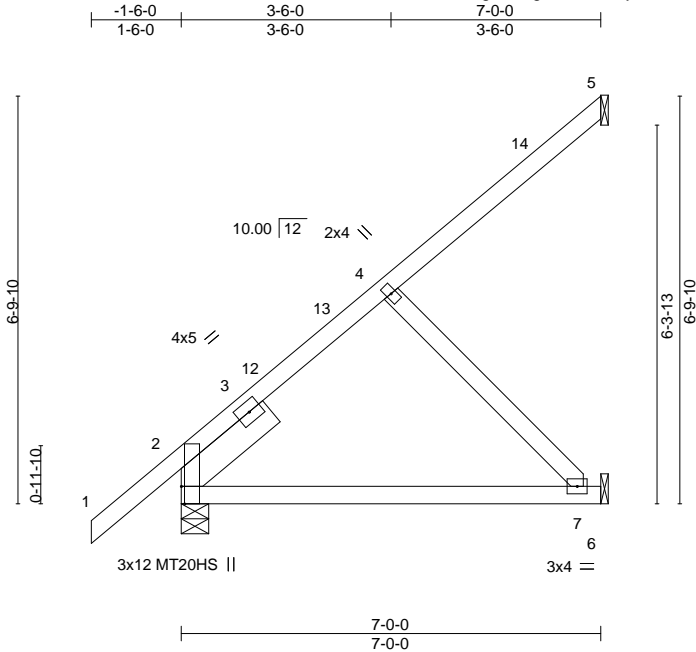


Plate Offsets (X,Y)--		[2:0-3-8,Edge]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.25
TCDL 10.0	Lumber DOL	1.25	BC 0.41
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.10
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
			<b>DEFL.</b>
			in (loc) l/defl L/d
			Vert(LL) -0.07 7-10 >999 240
			Vert(CT) -0.14 7-10 >589 180
			Horz(CT) 0.02 2 n/a n/a
			<b>PLATES</b>
			MT20 244/190
			MT20HS 187/143
			Weight: 39 lb FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x6 SP No.2 1-11-8

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 5=Mechanical, 2=0-5-8, 6=Mechanical  
Max Horz 2=255(LC 12)  
Max Uplift 5=-62(LC 12), 2=-19(LC 12), 6=-113(LC 12)  
Max Grav 5=92(LC 19), 2=377(LC 1), 6=208(LC 19)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-497/23

**NOTES-**

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 6-11-4 zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) All plates are MT20 plates unless otherwise indicated.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2 except (jt=lb) 6=113.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	EJ05	Jack-Open	14	1	T37036606
Job Reference (optional)					

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,
8.830 s Apr 11 2025 MiTek Industries, Inc.
Thu Apr 17 07:08:10 2025
Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-mU8oq4mGSmCPdSawM50tEfJL0AMH3KZj?3n11jzPu5J

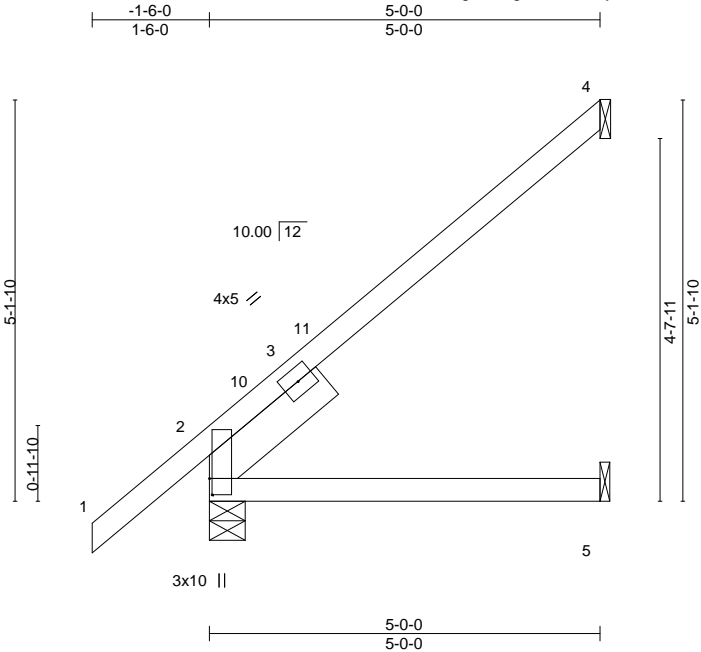


Plate Offsets (X,Y)--		[2:0-2-8,0-0-6]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.41	Vert(LL)	0.06	5-8	>985	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.42	Vert(CT)	-0.06	5-8	>934	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.04	4	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP						Weight: 25 lb FT = 20%		

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
SLIDER	Left 2x6 SP No.2 1-11-8		

**REACTIONS.** (size) 4=Mechanical, 2=0-5-8, 5=Mechanical  
Max Horz 2=200(LC 12)  
Max Uplift 4=-122(LC 12), 2=-16(LC 12), 5=-19(LC 12)  
Max Grav 4=141(LC 19), 2=301(LC 1), 5=91(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 4-11-3 zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5 except (jt=lb) 4=122.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:10 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-mU8oq4mGSmCPdSawM50tEfJKDAL53KZ?3nl1jzPu5J

Structural drawing of a roof truss system. The drawing shows four members labeled 1, 2, 3, and 4. Member 1 is a vertical support on the left, labeled "3x8 ||". Member 2 is a diagonal member connecting the top of member 1 to member 3, labeled "4x5 ||". Member 3 is a diagonal member extending from member 2 to the top right, labeled "10.00" and "12". Member 4 is a horizontal member at the bottom, labeled "5-0-0". Dimensions are indicated: a vertical dimension of "5-1-10" on the left, a horizontal dimension of "5-0-0" at the top, a horizontal dimension of "5-0-0" at the bottom, and a vertical dimension of "0-5-15" on the right. A horizontal dimension of "4-7-11" is also shown on the right. A vertical dimension of "0-11-10" is shown on the left, corresponding to the height of member 1. The drawing includes cross-section symbols (hatched rectangles) at the joints and ends of the members.

Plate Offsets (X,Y)-- [1:0-2-0,0-0-2]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.47	Vert(LL)	0.07	4-7	>825	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.49	Vert(CT)	-0.07	4-7	>878	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.04	3	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MP							Weight: 22 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
SLIDER	Left 2x6 SP No.2 1-11-8		

**REACTIONS.** (size) 1=0-5-8, 3=Mechanical, 4=Mechanical  
 Max Horiz 1=159(LC 12)  
 Max Uplift 3=125(LC 12), 4=-21(LC 12)  
 Max Grav 1=197(LC 1), 3=148(LC 19), 4=93(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCdL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCp=-0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-0-0, Zone1 3-0-0 to 4-11-3 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 3=125.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18, 2025

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Components Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-LLS.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036609
4460945	PB01	PIGGYBACK	11	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:11 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-EgiA1QnuD3KGFb96woX6msrazao8onVsDjXra9zPu5l

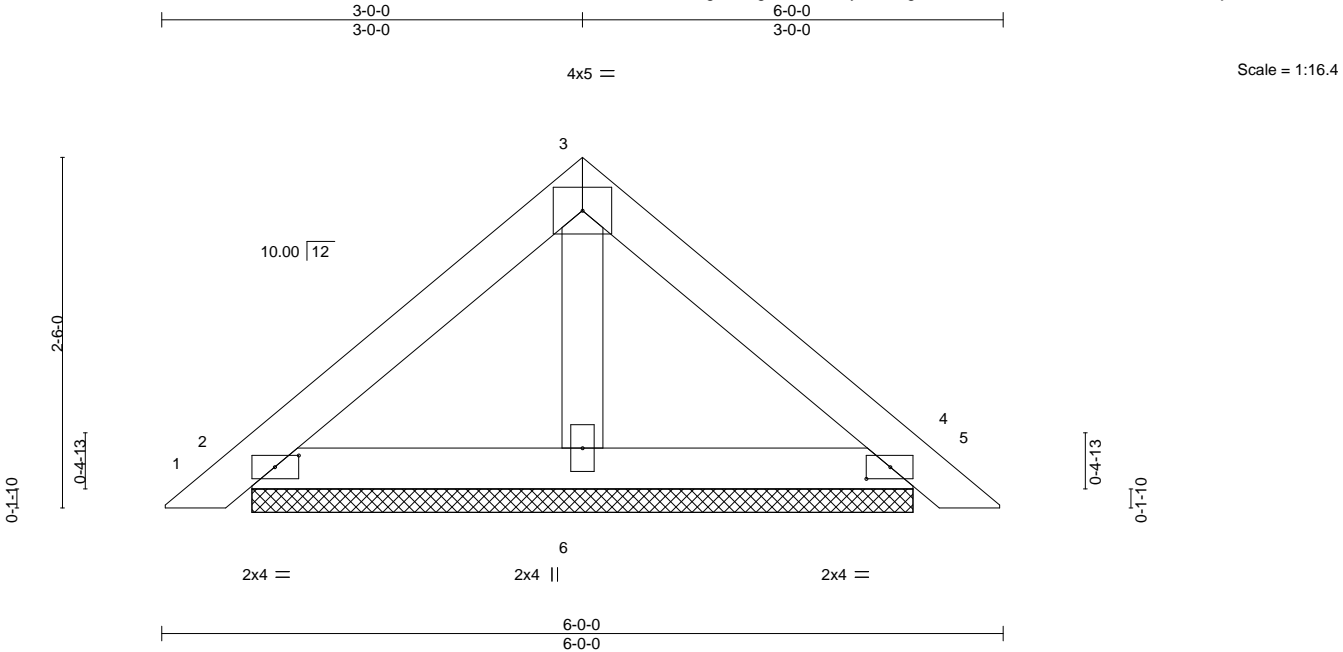


Plate Offsets (X,Y)--	[2:0-2-1,0-1-0], [4:0-2-1,0-1-0]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.15	Vert(LL)	0.00 5	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.06	Vert(CT)	0.00 5	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00 4	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P					Weight: 21 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. (size) 2=4-8-9, 4=4-8-9, 6=4-8-9  
Max Horz 2=-57(LC 10)  
Max Uplift 2=-45(LC 12), 4=-52(LC 13), 6=-11(LC 12)  
Max Grav 2=134(LC 1), 4=134(LC 1), 6=157(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4, 6.
  - 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036610
4460945	PB01G	Piggyback	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:12 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-jtGYFmoW\_NS7slkJTW2LJ4OmZ\_7gXEq?SNGO6czPu5H

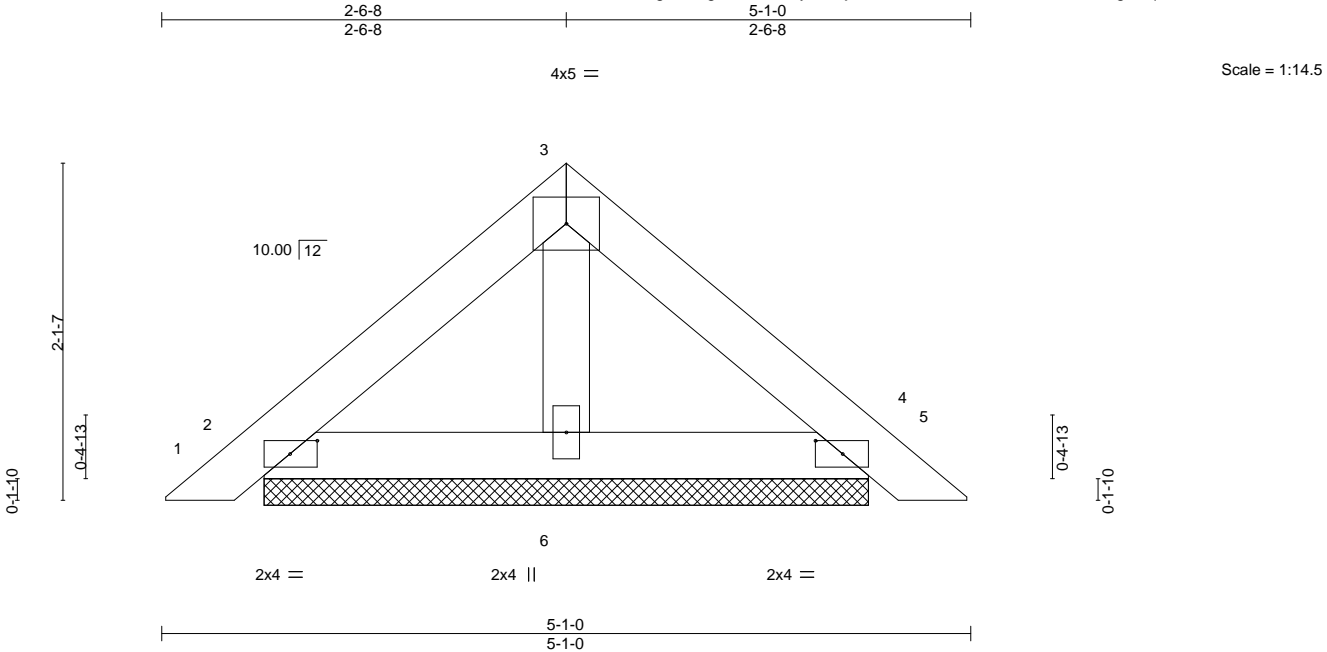


Plate Offsets (X,Y)--		[2:0-2-1,0-1-0], [4:0-2-1,0-1-0]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.09	Vert(LL)	0.00	4	n/r	120	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.04	Vert(CT)	0.00	5	n/r	120		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-P							Weight: 17 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-1-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

**REACTIONS.** (size) 2=3-9-9, 4=3-9-9, 6=3-9-9  
Max Horz 2=47(LC 10)  
Max Uplift 2=-39(LC 12), 4=-44(LC 13), 6=-8(LC 12)  
Max Grav 2=114(LC 1), 4=114(LC 1), 6=125(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) Gable studs spaced at 2-0-0 oc.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4, 6.
  - 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036611
4460945	PB02	PIGGYBACK	5	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:12 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-jtGYFmoW\_NS7slkJTW2LJ4Olj\_7HXEn?SNGO6czPu5H



Scale = 1:16.4

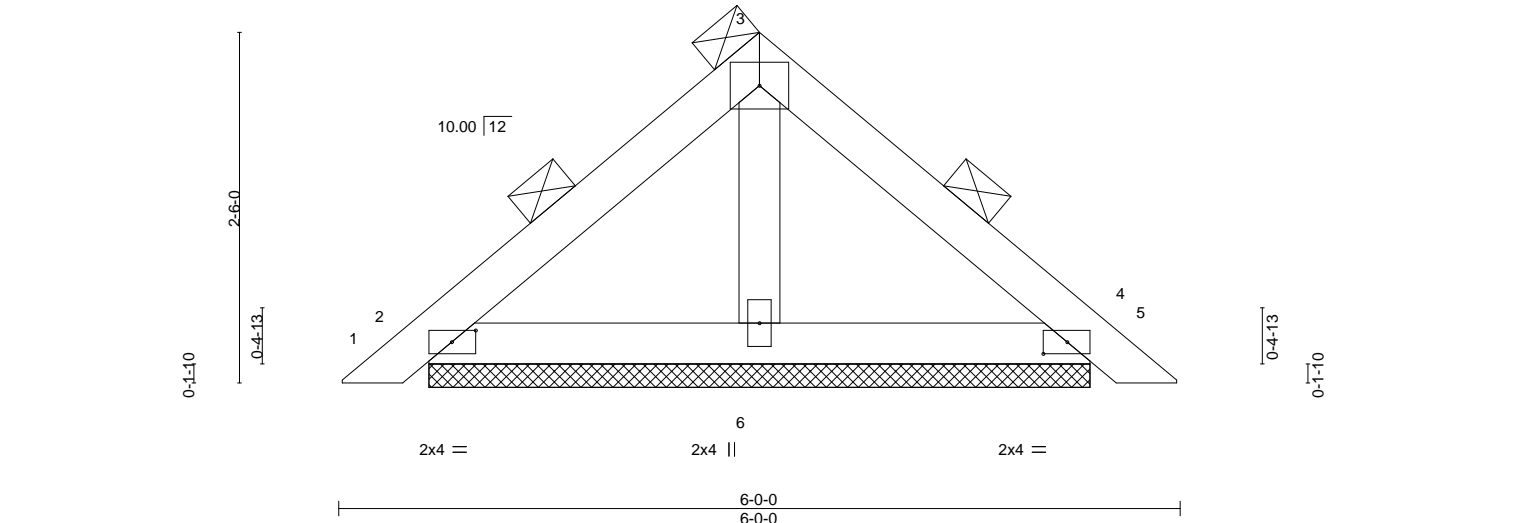


Plate Offsets (X,Y)--		[2:0-2-1,0-1-0], [4:0-2-1,0-1-0]	
LOADING (psf)	SPACING-	4-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.15
TCDL 10.0	Lumber DOL	1.25	BC 0.06
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.02
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-P
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.00 5 n/r 120
			Vert(CT) 0.00 5 n/r 120
			Horz(CT) 0.00 4 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 42 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins
BOT CHORD 2x4 SP No.2	(Switched from sheeted: Spacing > 2-8-0).
OTHERS 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=4-8-9, 4=4-8-9, 6=4-8-9

Max Horz 2=-114(LC 10)

Max Uplift 2=-90(LC 12), 4=-104(LC 13), 6=-22(LC 12)

Max Grav 2=269(LC 1), 4=269(LC 1), 6=313(LC 1)

THIS TRUSS IS DESIGNED TO SUPPORT ONLY 2'-0" OF UNIFORM LOAD AS SHOWN.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6 except (jt=lb) 4=104.
  - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036612
4460945	PB03	Piggyback	25	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:13 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-B3qwS6p8lha\_UvlV1DZasHww3OSjGgH9h10ye2zPu5G

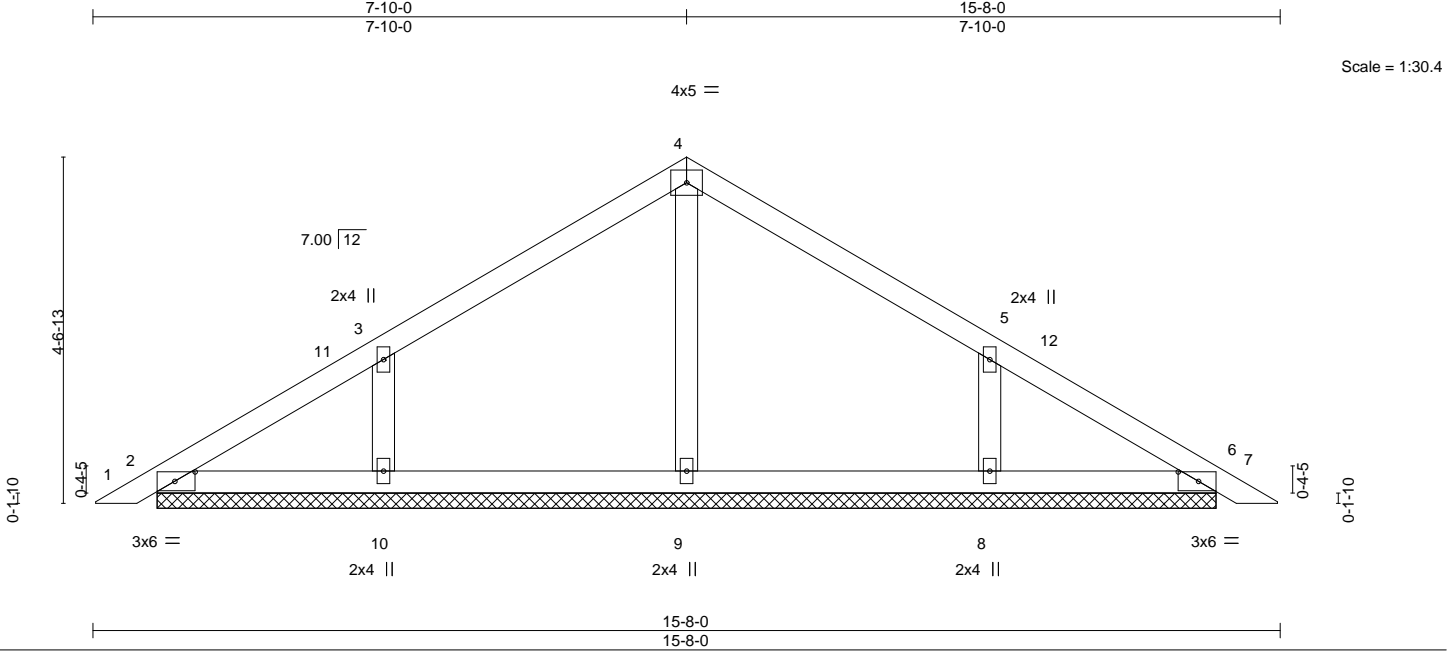


Plate Offsets (X,Y)--		[2:0-3-3,0-1-8], [6:0-3-3,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.17	Vert(LL)	0.00	6	n/r	120	MT20 244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.11	Vert(CT)	0.00	7	n/r	120	
BCLL	0.0 *	Rep Stress Incr YES		WB	0.07	Horz(CT)	0.00	6	n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S							Weight: 58 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 13-11-11.  
(lb) - Max Horz 2=108(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 6, 9 except 10=158(LC 12), 8=158(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 2, 6 except 9=269(LC 1), 10=342(LC 19), 8=341(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 3-10=262/178, 5-8=262/177

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-3-11 to 3-3-11, Zone1 3-3-11 to 7-10-0, Zone2 7-10-0 to 11-10-0, Zone1 11-10-0 to 15-4-5 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 4-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6, 9 except (jt=lb) 10=158, 8=158.
  - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036613
4460945	PB03G	Piggyback	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:14 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-fFNJgSpmW\_ir63thbw4pOVT7bop1?81lvgIVAUzPu5F

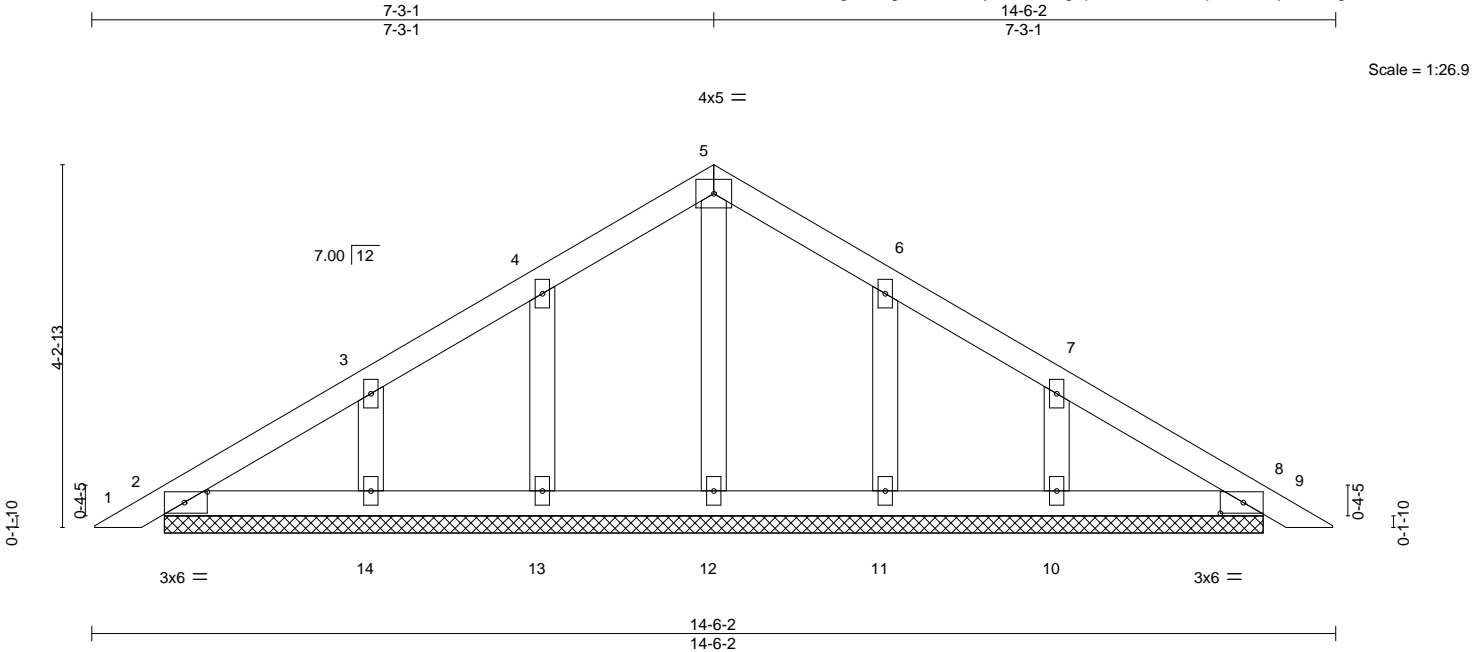


Plate Offsets (X,Y)--		[2:0-3-3,0-1-8], [8:0-3-3,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.06	Vert(LL)	0.00	8	n/r	120	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.04	Vert(CT)	0.00	9	n/r	120	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00	8	n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S							Weight: 60 lb FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

All bearings 12-9-13.  
(lb) - Max Horz 2=100(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 13, 14, 11, 10  
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-3-11 to 3-3-1, Zone1 3-3-1 to 7-3-1, Zone2 7-3-1 to 11-3-1, Zone1 11-3-1 to 14-2-7 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 13, 14, 11, 10.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036614
4460945	PB04	Piggyback	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:14 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLIr-fFNJgSpmW\_ir63thbw4pOVT5ooo5?7WlvglVAUzPu5F

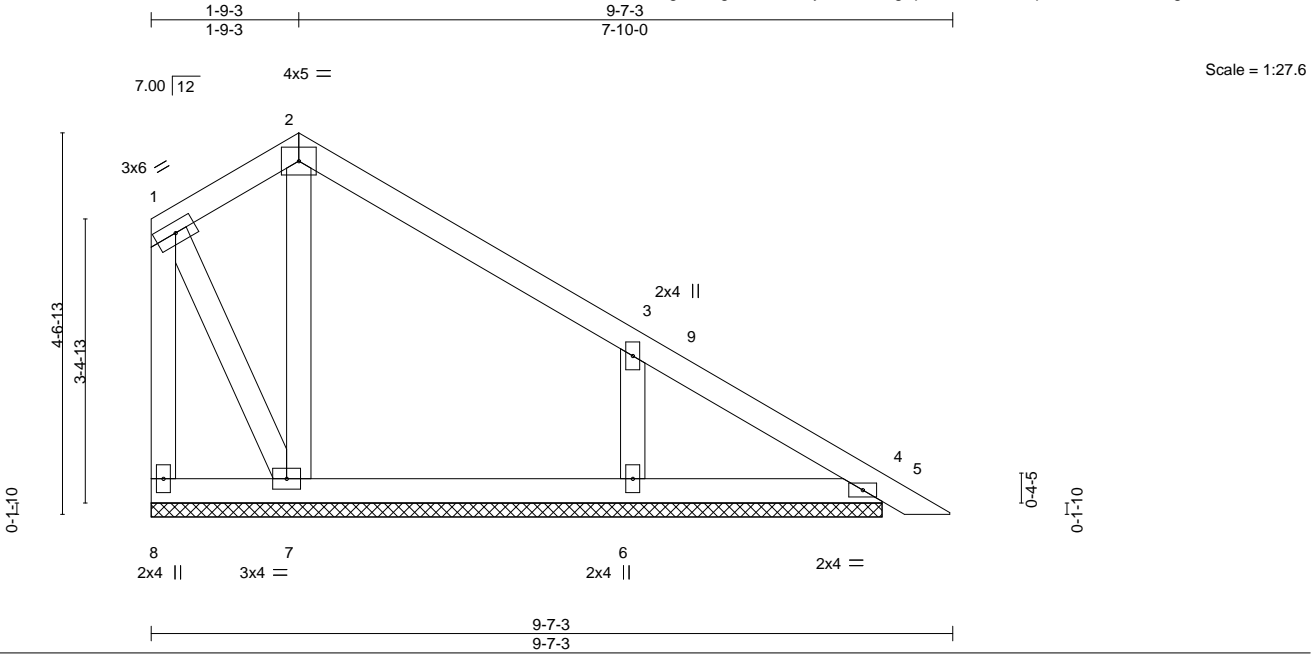

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.17	Vert(LL)	0.00	4	n/r	120	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.10	Vert(CT)	0.00	5	n/r	120	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	4	n/a	n/a	
BCDL 10.0	Code FBC2023/TP12014		Matrix-S						
								Weight: 47 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 8-9-1.  
(lb) - Max Horz 8=147(LC 13)  
Max Uplift All uplift 100 lb or less at joint(s) 8 except 6=158(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 8, 4, 7 except 6=346(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 3-6=-264/228

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-12 to 1-9-3, Zone2 1-9-3 to 5-9-3, Zone1 5-9-3 to 9-3-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) Gable studs spaced at 4-0-0 oc.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 6=158.
  - 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036615
4460945	PB04G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:15 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-7SxhtqQHlrijDSu9eb2xi05EB1KkbpS8KV3jxzPu5E

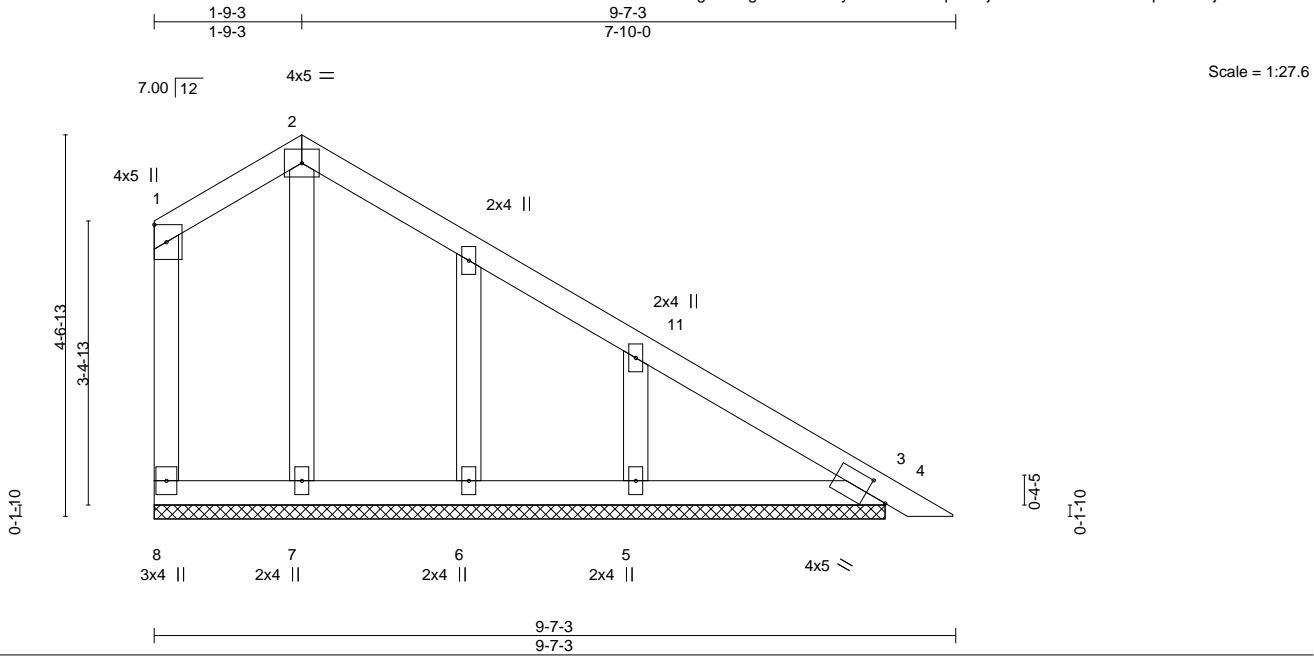


Plate Offsets (X,Y)--	[3:0-3-2,0-2-0]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.90	Vert(LL)	0.02	4	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.55	Vert(CT)	0.04	4	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-R					Weight: 46 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 8-9-1.  
(lb) - Max Horz 8=147(LC 13)  
Max Uplift All uplift 100 lb or less at joint(s) 3, 7, 6, 5 except 8=153(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 7, 6, 5 except 8=313(LC 1), 3=254(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-12 to 1-9-3, Zone2 1-9-3 to 6-0-2, Zone1 6-0-2 to 9-3-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) Gable studs spaced at 2-0-0 oc.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 7, 6, 5 except (jt=lb) 8=153.
  - 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	PB05	Piggyback	1	1	T37036616
					Job Reference (optional)

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:15 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-7SxhtoqOHLrijDSu9eb2xi0GRB8ZkbpS8KV3jxzPu5E

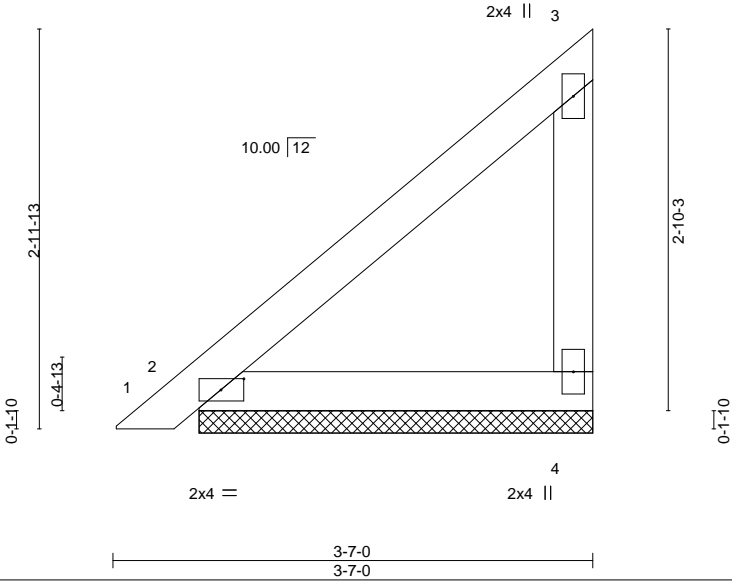

Scale = 1:17.2

Plate Offsets (X,Y)--	[2:0-2-1,0-1-0]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.18	Vert(LL)	0.00 1	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.09	Vert(CT)	0.00 1	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-P					Weight: 15 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-7-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=2-11-4, 2=2-11-4  
Max Horz 2=101(LC 12)  
Max Uplift 4=-72(LC 12), 2=-5(LC 12)  
Max Grav 4=121(LC 19), 2=138(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 8) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036617
4460945	PB06	Piggyback	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:15 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-7SxhtoqOHLrijDSu9eb2xi0laB9ckbKS8KV3jxzPu5E

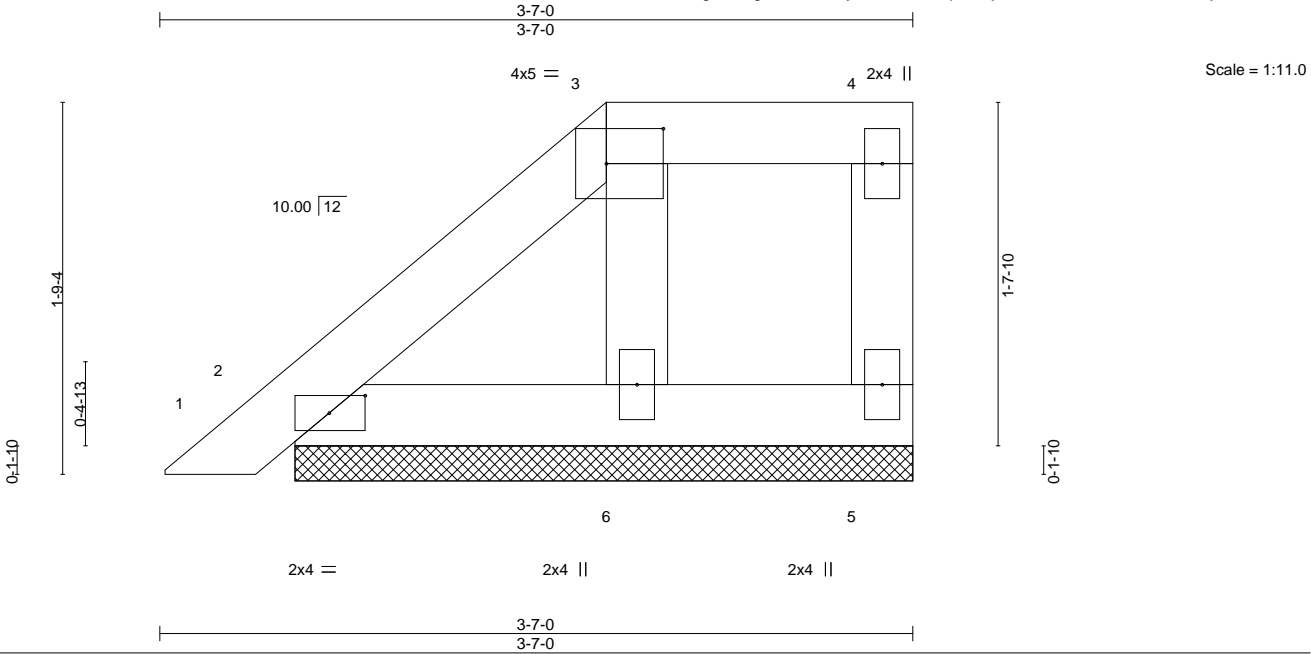


Plate Offsets (X,Y)--		[2:0-2-1,0-1-0], [3:0-3-4,0-2-0]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.04
TCDL 10.0	Lumber DOL	1.25	BC 0.02
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-P
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.00 1 n/r 120
			Vert(CT) 0.00 1 n/r 120
			Horz(CT) -0.00 5 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 14 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-7-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 5=2-11-4, 2=2-11-4, 6=2-11-4  
Max Horz 2=60(LC 12)  
Max Uplift 5=-18(LC 8), 2=-12(LC 12), 6=-37(LC 12)  
Max Grav 5=47(LC 1), 2=92(LC 1), 6=109(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
  - 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036618
4460945	PB07	Piggyback	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:16 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-beV358r02czZLN14iL6HTwYTSbVsT2abN\_EcFNzPu5D

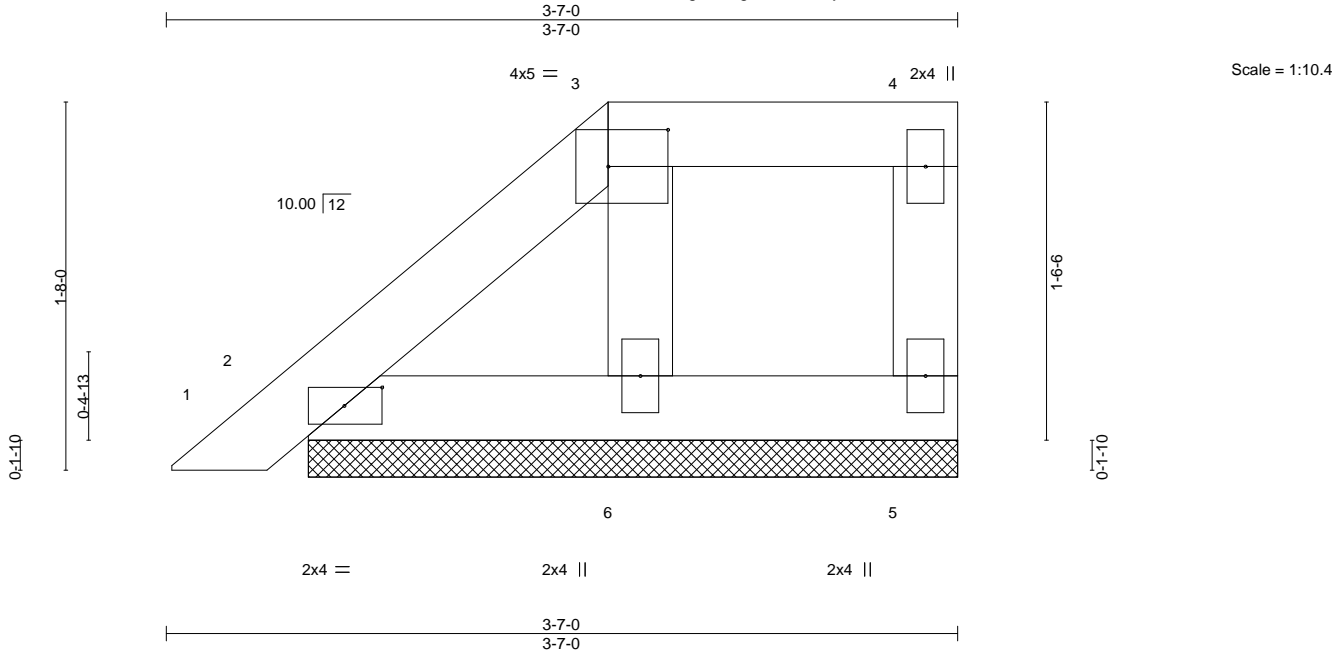


Plate Offsets (X,Y)-- [2:0-2-1,0-1-0], [3:0-3-4,0-2-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL	20.0	Plate Grip DOL	1.25	TC	0.03	Vert(LL)	0.00 1 n/r 120	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.02	Vert(CT)	0.00 1 n/r 120		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.03	Horz(CT)	-0.00 5 n/a n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-P				Weight: 13 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-7-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

**REACTIONS.** (size) 5=2-11-4, 2=2-11-4, 6=2-11-4  
Max Horz 2=56(LC 12)  
Max Uplift 5=-19(LC 8), 2=-13(LC 12), 6=-34(LC 12)  
Max Grav 5=52(LC 1), 2=88(LC 1), 6=108(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
  - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036619
4460945	PB08	Piggyback	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:16 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLIr-beV358r02czZLN14iL6HTwYTVbVzT2xbN\_EcFNzPu5D

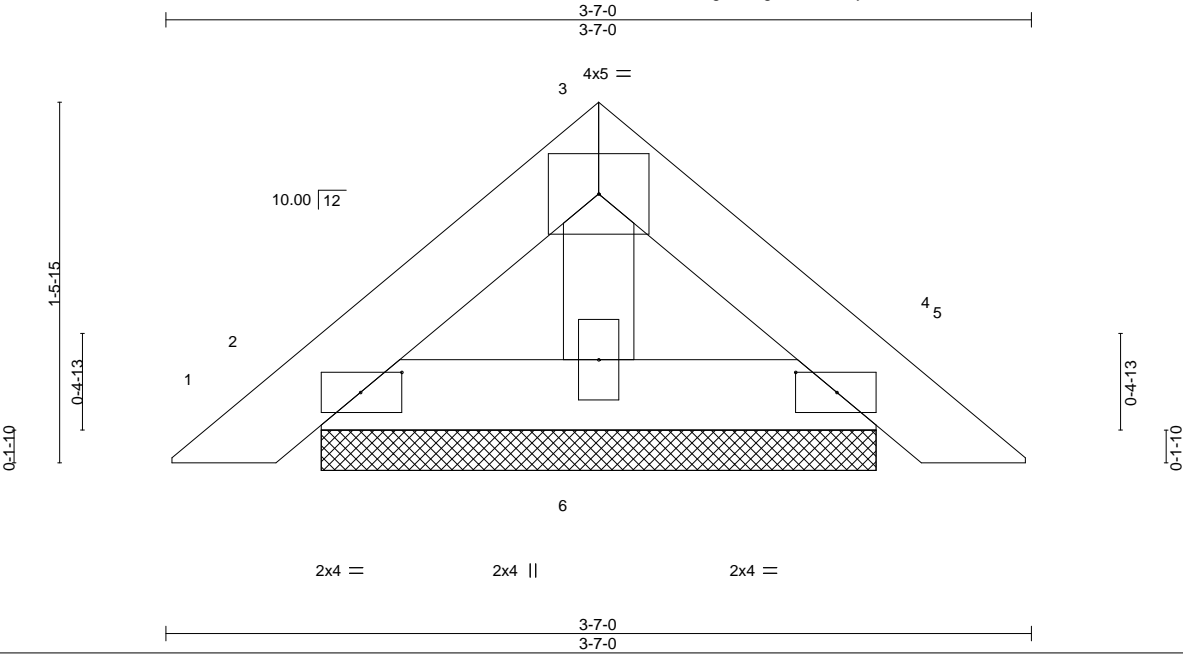


Plate Offsets (X,Y)--	[2:0-2-1,0-1-0], [4:0-2-1,0-1-0]						
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.03	Vert(LL) 0.00	4	n/r	120	MT20 244/190
TCDL 10.0	Lumber DOL 1.25	BC 0.01	Vert(CT) 0.00	4	n/r	120	
BCLL 0.0 *	Rep Stress Incr YES	WB 0.01	Horz(CT) 0.00	4	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014	Matrix-P					Weight: 11 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-7-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 2=2-3-9, 4=2-3-9, 6=2-3-9  
Max Horz 2=-32(LC 10)  
Max Uplift 2=-29(LC 12), 4=-33(LC 13), 6=-3(LC 12)  
Max Grav 2=80(LC 1), 4=80(LC 1), 6=72(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4, 6.
  - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036621
4460945	PB09	Piggyback	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:17 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-3q3RIUspfvp5PzWcGG3eW075eU?rJCVFlce\_9npzPu5C

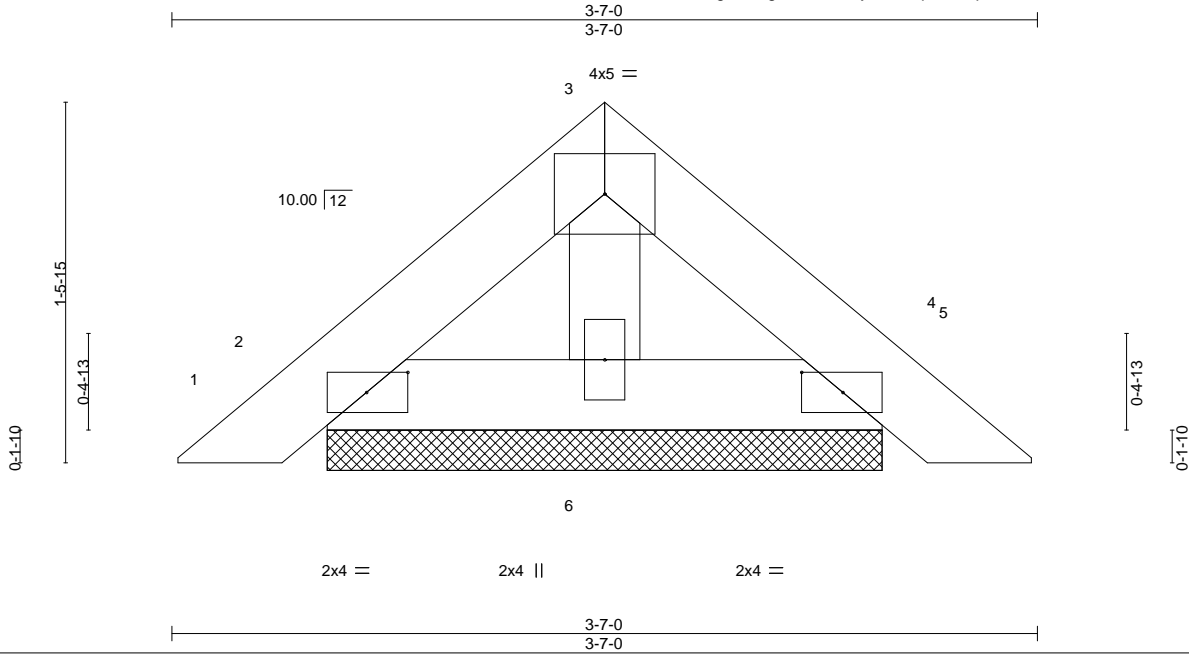


Plate Offsets (X,Y)--		[2:0-2-1,0-1-0], [4:0-2-1,0-1-0]							
LOADING (psf)		SPACING- 2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL 1.25	TC 0.02	Vert(LL) 0.00	4	n/r	120	MT20	244/190
TCDL 10.0		Lumber DOL 1.25	BC 0.01	Vert(CT) 0.00	4	n/r	120		
BCLL 0.0 *		Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00	4	n/a	n/a		
BCDL 10.0		Code FBC2023/TPI2014	Matrix-P					Weight: 23 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-7-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 2=2-3-9, 4=2-3-9, 6=2-3-9  
Max Horz 2=-32(LC 10)  
Max Uplift 2=-29(LC 12), 4=-33(LC 13), 6=-3(LC 12)  
Max Grav 2=80(LC 1), 4=80(LC 1), 6=72(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4, 6.
  - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:18 2025 Page 1

ID:7CvAcxg5dm4q2lcSLITv78yDLlr-X1dpVpsHaDDGagBSgm9lZLef9P?vxlfugljiJFzPy5B



- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 12-0-0, Zone2 12-0-0 to 16-2-15, Zone1 16-2-15 to 18-0-0, Zone2 18-0-0 to 22-1-12, Zone1 22-1-12 to 31-6-0 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are MT20 plates unless otherwise indicated.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Ceiling dead load (5.0 psf) on member(s). 4-5, 9-10, 5-19, 19-20, 9-20; Wall dead load (5.0psf) on member(s). 4-17, 10-15
- 9) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 15-17
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=110, 12=110.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 12) Attic room checked for L/360 deflection.

April 18.2025




16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036623
4460945	T01DD	ATTIC GIRDER	4	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:19 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-?DBCj9tvLXL7CqmFOUg\_5YAnUpJgCt13yTGsizPu5A

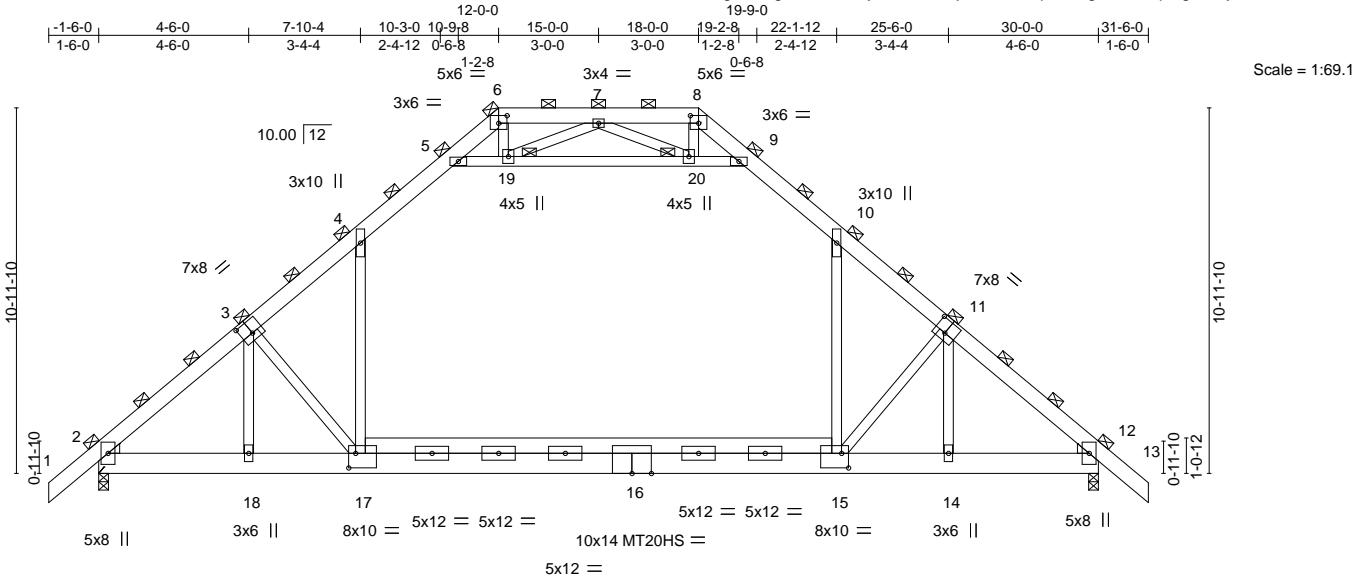

<div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div><div></div></div>									
--	--	--	--	--	--	--	--	--	--

LUMBER-

TOP CHORD 2x6 SP 2400F 2.0E or 2x6 SP M 26  
BOT CHORD 2x8 SP 2400F 2.0E \*Except\*  
15-17: 2x6 SP No.2  
WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.)  
(Switched from sheeted: Spacing > 2-8-0).  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
JOINTS 1 Brace at Jt(s): 6, 8, 19, 20  
This truss requires both edges of the bottom chord be sheathed in the room area.

REACTIONS.

(size) 2=0-3-8, 12=0-3-8  
Max Horz 2=-629(LC 6)  
Max Uplift 2=-248(LC 8), 12=-248(LC 9)  
Max Grav 2=4134(LC 2), 12=4134(LC 2)

THIS TRUSS IS DESIGNED TO SUPPORT ONLY 4'-6"  
OF UNIFORM LOAD AS SHOWN.

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-5086/209, 3-4=-5493/146, 4-5=-3403/334, 5-6=-166/1244, 6-7=0/1918, 7-8=0/1918,  
8-9=-166/1244, 9-10=-3403/334, 10-11=-5492/146, 11-12=-5086/212  
BOT CHORD 2-18=-299/4222, 17-18=-303/4216, 15-17=0/3723, 14-15=0/3841, 12-14=0/3851  
WEBS 3-18=-1377/290, 3-17=-841/764, 4-17=0/3139, 10-15=0/3138, 11-15=-847/768,  
11-14=-1381/295, 5-19=-5477/306, 19-20=-4553/0, 9-20=-5477/305, 6-19=-86/684,  
8-20=-86/685, 7-19=-1048/334, 7-20=-1048/334

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (5.0 psf) on member(s). 4-5, 9-10, 5-19, 19-20, 9-20; Wall dead load (5.0psf) on member(s). 4-17, 10-15
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 15-17
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb)

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036623
4460945	T01DD	ATTIC GIRDER	4	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:19 2025 Page 2  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-?DBCj9tvLXL7CqmFOUg\_5YAnUplJgCt13yTGsizPu5A

- NOTES-**
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 14) Attic room checked for L/360 deflection.

**⚠ WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036624
4460945	T01G	Piggyback Base Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:20 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-UPlawVuX6qT\_q\_LrxBBDemj79Cq7PojBlcCqO8zPu59  
20-5-11

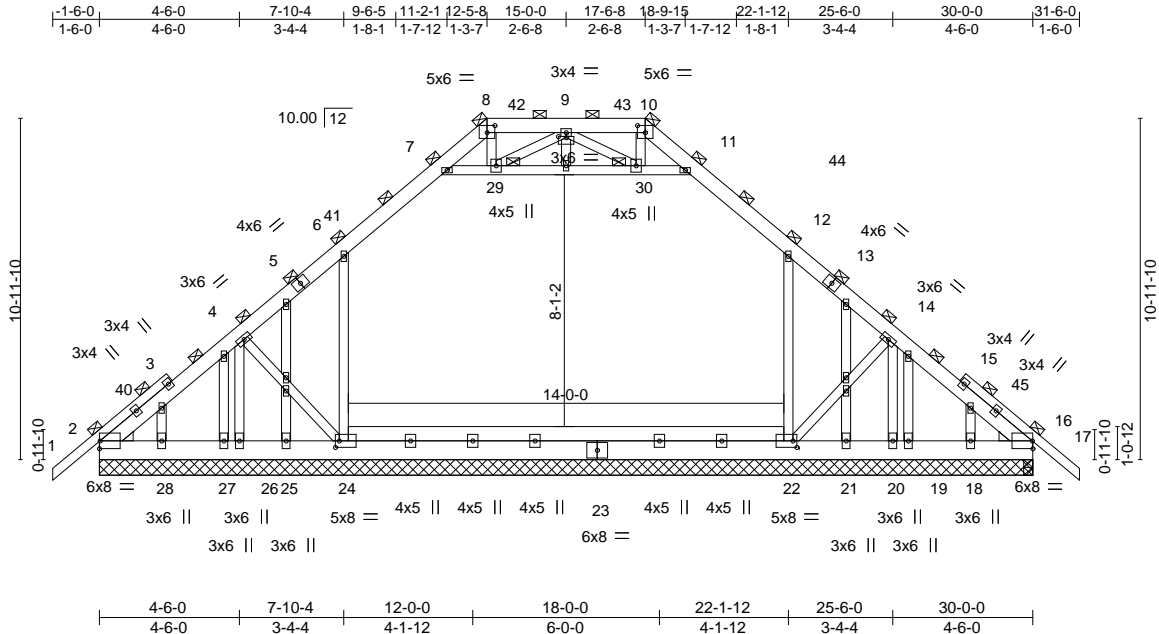


Plate Offsets (X,Y)-- [8:0-3-0,0-2-12], [9:0-3-0,0-0-7], [10:0-3-0,0-2-12], [22:0-1-8,0-2-8], [24:0-1-8,0-2-8]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.18	Vert(LL)	-0.05 22-24	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.19	Vert(CT)	-0.07 22-24	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.21	Horz(CT)	0.01 16	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S						Weight: 318 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.2 \*Except\*  
1-3,15-17: 2x4 SP No.2  
BOT CHORD 2x8 SP 2400F 2.0E \*Except\*  
22-24: 2x6 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

**BRACING-**

TOP CHORD 2-0-0 oc purlins (6-0-0 max.).  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
JOINTS 1 Brace at Jt(s): 8, 10, 29, 30

**REACTIONS.**

All bearings 30-0-0.  
(lb) - Max Horz 2=-276(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 26, 20, 16, 18, 28 except  
24=-185(LC 12), 22=-186(LC 13), 19=-171(LC 18), 21=-767(LC 18), 27=-176(LC 18), 25=-765(LC 18)  
Max Grav All reactions 250 lb or less at joint(s) 18, 19, 28, 27 except 2=502(LC 1),  
26=661(LC 20), 24=1194(LC 20), 22=1201(LC 21), 20=636(LC 2), 16=529(LC 1),  
16=529(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-536/175, 4-6=-546/196, 6-7=-560/207, 7-8=-357/146, 8-9=-282/150,  
9-10=-281/145, 10-11=-356/143, 11-12=-561/204, 12-14=-544/188, 14-16=-543/142  
BOT CHORD 2-28=-158/369, 27-28=-158/369, 26-27=-158/369, 25-26=-158/369, 24-25=-158/369,  
22-24=-140/409, 21-22=-98/341, 20-21=-98/341, 19-20=-98/341, 18-19=-98/341,  
16-18=-98/341  
WEBS 4-26=-281/89, 6-24=-287/223, 12-22=-284/219, 14-20=-265/76

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 12-5-8, Zone2 12-5-8 to 16-8-7, Zone1 16-8-7 to 17-6-8, Zone2 17-6-8 to 21-9-7, Zone1 21-9-7 to 31-6-0 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) Provide adequate drainage to prevent water ponding.
- 6) All plates are 2x4 MT20 unless otherwise indicated.
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036624
4460945	T01G	Piggyback Base Supported Gable	1	1	Job Reference (optional)	

- NOTES-**
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 26, 20, 16, 18, 28 except (jt=lb) 24=185, 22=186, 19=171, 21=767, 27=176, 25=765.
  - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 12) Attic room checked for L/360 deflection.

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))

Lake City, FL - 32055.

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:21 2025 Page 1

T37036625

Job Reference (optional)



**LUMBER-**

WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3 . Right: 2x6 SP No.2

### REACTIONS.

(size) 2=0-3-8, 14=0-3-8  
Max Horz 2=-381(LC 4)  
Max Uplift 2=-864(LC 5), 14=-908(LC 4)  
Max Grav 2=4723(LC 36), 14=5084(LC 37)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-6081/1107, 3-5=-7598/1456, 5-6=-4716/939, 6-7=-340/1021, 7-8=-499/2209,  
8-9=-439/1598, 9-10=-596/805, 10-11=-4858/785, 11-13=-7521/1292, 13-14=-6730/1212  
BOT CHORD 2-20=-917/4760, 10-20=-917/4760, 17-19=-865/5145, 16-17=-866/5104, 14-16=-866/5106  
WEBS 3-20=-2673/633, 3-19=-369/940, 5-19=-874/4328, 11-17=-938/3986, 13-17=-394/456,  
13-16=-1818/507, 6-21=-7455/1519, 21-22=-5675/1135, 10-22=-6789/1397,  
7-21=-181/1031, 9-22=-133/712, 8-21=-1853/404, 8-22=-1198/304

**NOTES-**

- 1) 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.
- 4) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BC DL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCp=-0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 5) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 6) Provide adequate drainage to prevent water ponding.
- 7) All plates are MT20 plates unless otherwise indicated.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 10) Ceiling dead load (5.0 psf) on member(s). 5-6, 10-11, 6-21, 21-22, 10-22; Wall dead load (5.0psf) on member(s). 5-19, 11-17
- 11) Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 17-19

Continued on page 2

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18.2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Components Association ([www.sbscomponents.com](http://www.sbscomponents.com))

MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-LLS.com](http://MiTek-LLS.com)

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036625
4460945	T02	Attic Girder	1	3	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:21 2025 Page 2  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-ybJy8rv9s8brR8w1VviSAzGB\_c1b85HKWgyNwazPu58

- NOTES-**
- 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=864, 14=908.
  - 13) Girder carries tie-in span(s): 7-0-0 from 12-0-0 to 21-0-0
  - 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 15) Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss) or equivalent at 22-5-4 from the left end to connect truss(es) to back face of bottom chord.
  - 16) Fill all nail holes where hanger is in contact with lumber.
  - 17) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
  - 18) Attic room checked for L/360 deflection.

- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
    - Uniform Loads (plf)
      - Vert: 1-5=-60, 5-6=-70, 6-7=-60, 7-9=-185(F=-125), 9-10=-185(F=-125), 10-31=-195(F=-125), 11-31=-70, 11-15=-60, 19-23=-20, 17-19=-200(F=-160), 17-26=-20, 6-10=-10
      - Drag: 5-19=-10, 11-17=-10
    - Concentrated Loads (lb)
      - Vert: 17=-441(B) 29=-41(B) 30=-45(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036626
4460945	T03	Common	9	1		
Builders FirstSource (Lake City,FL), Lake City, FL - 32055,						8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:22 2025 Page 1
Job Reference (optional)						ID:7CvAcxg5dm4g2lcSLiTv78yDLIr-QosKLBwndSj3lUE3cDhjBoLF0NktW_UlwHwS1zPu57



Scale = 1:62.1

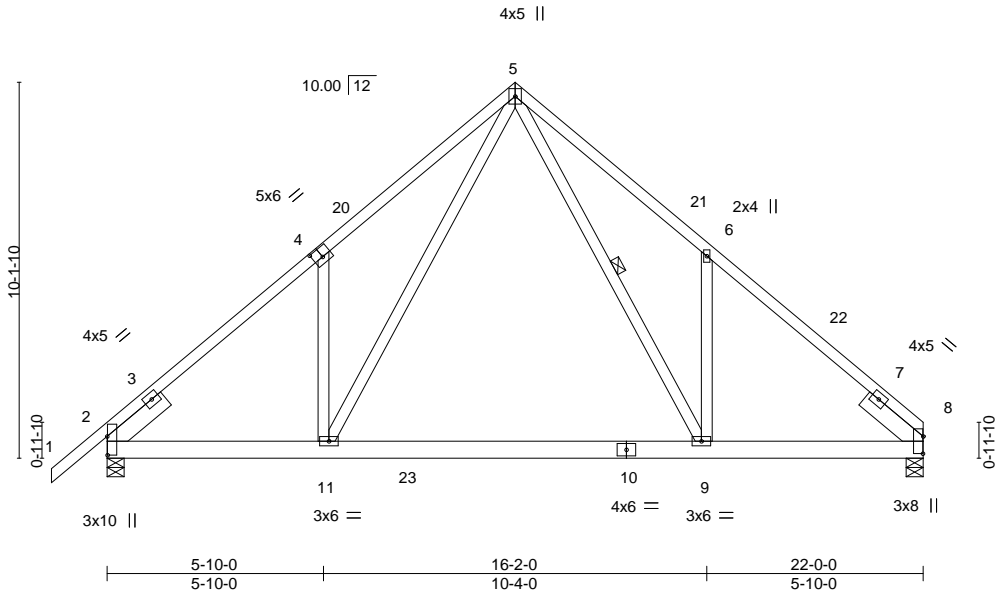


Plate Offsets (X,Y)--		[2:0-6-1,0-0-2], [4:0-3-0,0-3-0], [8:0-5-9,0-0-2]											
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.65	Vert(LL)	-0.21	9-11	>999	240	MT20	244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.76	Vert(CT)	-0.41	9-11	>650	180			
BCLL	0.0 *	Rep Stress Incr	NO	WB	1.00	Horz(CT)	0.03	8	n/a	n/a			
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS							Weight: 153 lb	FT = 20%	

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP 2400F 2.0E or 2x6 SP M 26 \*Except\*  
8-10: 2x6 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x6 SP No.2 1-11-8, Right 2x6 SP No.2 1-11-8

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-7-9 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 5-9

**REACTIONS.** (size) 8=0-5-8, 2=0-5-8  
Max Horz 2=247(LC 11)  
Max Uplift 8=278(LC 13), 2=317(LC 12)  
Max Grav 8=1314(LC 20), 2=1403(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1739/390, 4-5=-1775/598, 5-6=-1760/609, 6-8=-1714/388  
BOT CHORD 2-11=-332/1402, 9-11=-120/850, 8-9=-225/1265  
WEBS 5-9=-448/1135, 6-9=-313/314, 5-11=-436/1161, 4-11=-309/307

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 11-0-0, Zone2 11-0-0 to 15-2-15, Zone1 15-2-15 to 22-0-0 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=278, 2=317.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-5=-60, 5-8=-60, 11-16=-20, 9-11=-80(F=-60), 9-12=-20

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036627
4460945	T03G	Common Structural Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:23 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-u\_QiZXwPOLrZhR3QdJlwGOLdGQsuc1Sd\_aRU?TzPu56



Scale = 1:61.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.16	Vert(LL)	-0.02 8-10	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.19	Vert(CT)	-0.04 8-10	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.73	Horz(CT)	0.01 8	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S					Weight: 244 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.2 \*Except\*  
1-3,7-9: 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD 2-0-0 oc purlins (6-0-0 max.).  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 5-16

**REACTIONS.**

All bearings 11-5-8 except (jt=length) 8=0-5-8, 11=0-3-8.  
(lb) - Max Horz 2=-245(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 17, 18, 11 except 8=-187(LC 13), 16=-357(LC 12), 12=-438(LC 20)  
Max Grav All reactions 250 lb or less at joint(s) 12, 13, 15, 17, 18 except 2=320(LC 1), 8=759(LC 20), 16=689(LC 19), 11=628(LC 20)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-269/136, 5-6=-813/404, 6-8=-739/155  
BOT CHORD 15-16=-20/299, 13-15=-20/299, 12-13=-20/299, 11-12=-20/299, 10-11=-20/299, 8-10=-18/499  
WEBS 5-10=-351/679, 6-10=-410/346, 5-16=-327/51, 4-16=-414/349

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 11-0-0, Zone2 11-0-0 to 15-2-15, Zone1 15-2-15 to 23-6-0 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 17, 18, 11 except (jt=lb) 8=187, 16=357, 12=438.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036628
4460945	T03GG	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:23 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-u\_QiZXwPOlrZhr3QdJlwGOLdwQuMcC1d\_aRU?TzPu56



5x6 =

Scale: 3/8"=1'

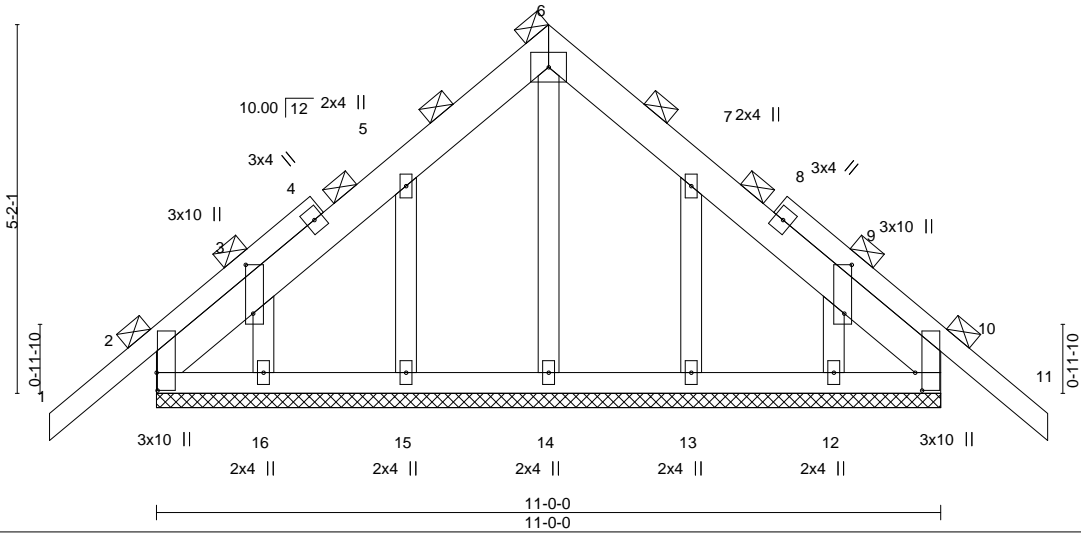

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.15	in	(loc)	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.03	Vert(LL)	-0.01 11				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.05	Vert(CT)	-0.01 11				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S		Horz(CT)	0.00 10				
								Weight: 83 lb		FT = 20%	

LUMBER-

TOP CHORD 2x6 SP No.2 \*Except\*  
1-4,8-11: 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.).  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 11-0-0.  
(lb) - Max Horz 2=132(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 15, 16, 13, 12  
Max Grav All reactions 250 lb or less at joint(s) 2, 10, 14, 15, 16, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 15, 16, 13, 12.
- 10) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 10.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036629
4460945	T04	Common	8	1		
Job Reference (optional)						

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:24 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-MA\_5mtx293zQlbecA1G9ocunyq4rLdHnDEA1XvzPu55



Scale = 1:36.5

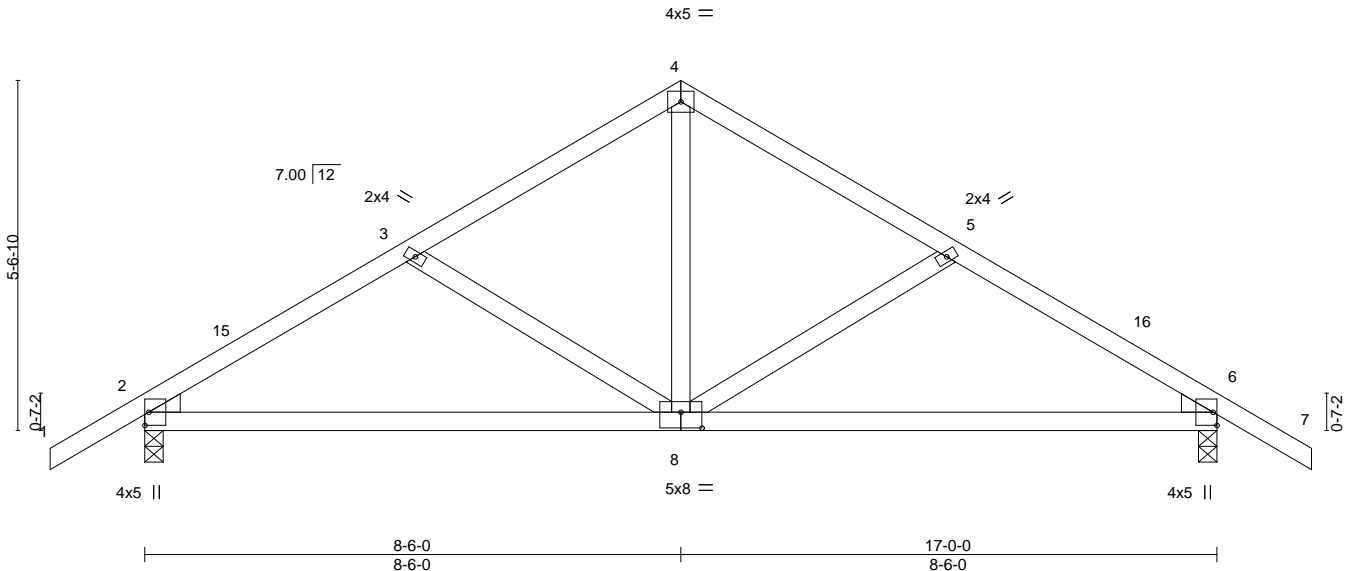


Plate Offsets (X,Y)--		[8:0-4-0,0-3-0]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.19	Vert(LL)	-0.07 8-11	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.59	Vert(CT)	-0.14 8-11	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.18	Horz(CT)	0.02 6	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS					Weight: 83 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 9-11-10 oc bracing.

REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=144(LC 11)  
Max Uplift 2=-195(LC 12), 6=-195(LC 13)  
Max Grav 2=770(LC 1), 6=770(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-948/452, 3-4=-727/405, 4-5=-727/405, 5-6=-948/452  
BOT CHORD 2-8=-320/774, 6-8=-336/774  
WEBS 4-8=-292/464, 5-8=-258/177, 3-8=-258/177

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 8-6-0, Zone2 8-6-0 to 12-10-4, Zone1 12-10-4 to 18-6-0 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=195, 6=195.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T04G	Common Supported Gable	1	1	T37036630
Job Reference (optional)					

Builders FirstSource (Lake City,FL),Lake City, FL - 32055,8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:25 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-qNYTzDygwN5HwLDpkknOLpQzQDZO44vwRuwa3LzPu54

-1-6-0  
1-6-0

11-0-0  
11-0-0

22-0-0  
11-0-0

23-6-0  
1-6-0

5x6 =

Scale = 1:60.3

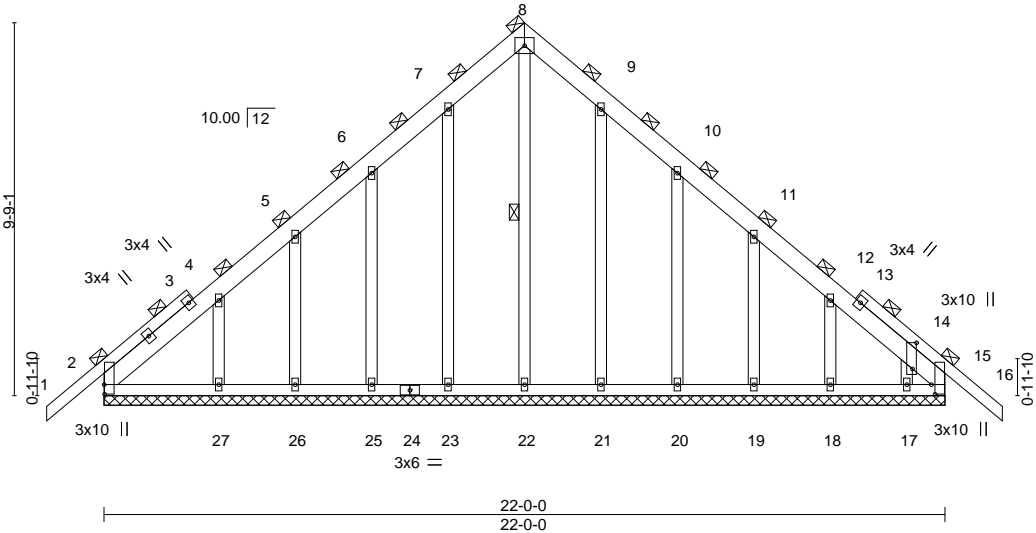


Plate Offsets (X,Y)--		[2:0-3-0,0-0-3], [14:0-8-3,0-1-4], [15:0-3-0,0-1-3]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.15
TCDL 10.0	Lumber DOL	1.25	BC 0.06
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.15
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-S
DEFL.	in (loc)	l/defl	L/d
Vert(LL)	-0.01	16	n/r
Vert(CT)	-0.01	16	n/r
Horz(CT)	0.01	15	n/a
PLATES	GRIP		
MT20	244/190		
Weight: 187 lb		FT = 20%	

LUMBER-	BRACING-
TOP CHORD	2x6 SP No.2 *Except*
	1-3,13-16: 2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3
	TOP CHORD
	2-0-0 oc purlins (6-0-0 max.).
	BOT CHORD
	Rigid ceiling directly applied or 10-0-0 oc bracing.
	WEBS
	1 Row at midpt
	8-22

**REACTIONS.** All bearings 22-0-0.  
(lb) - Max Horz 2=-245(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 15, 23, 26, 21, 18 except 25=-112(LC 12), 27=-138(LC 12), 20=-115(LC 13), 19=-102(LC 13), 17=-108(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 15, 22, 23, 25, 26, 27, 21, 20, 19, 18, 17 except 2=257(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 15, 23, 26, 21, 18 except (jt=lb) 25=112, 27=138, 20=115, 19=102, 17=108.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036631
4460945	T05	Common	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:25 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-qNYTzDygwN5HwDpkknOLpQx\_DSR44zwRuwa3LzPu54

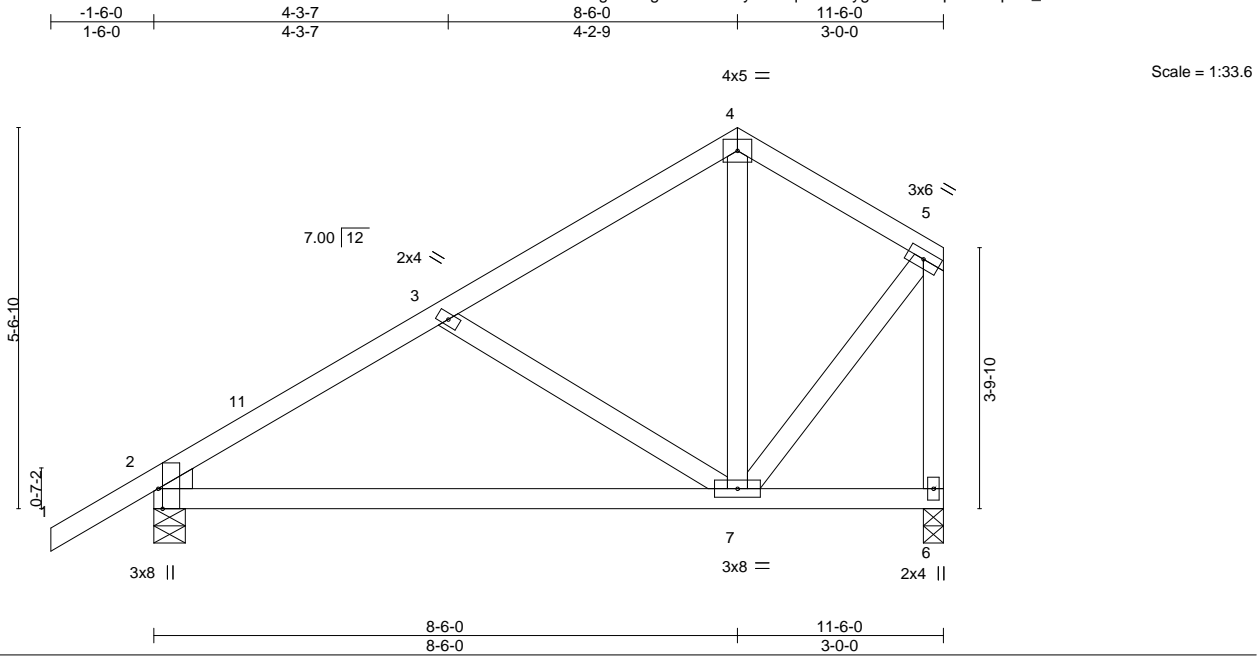


Plate Offsets (X,Y)--		[2:0-3-8,Edge]									
LOADING	(psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC 0.30	Vert(LL)	-0.09	7-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC 0.48	Vert(CT)	-0.18	7-10	>761	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB 0.15	Horz(CT)	0.01	2	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS						Weight: 66 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
WEDGE  
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 2=0-5-8, 6=0-3-8  
Max Horz 2=184(LC 12)  
Max Uplift 2=-139(LC 12), 6=-125(LC 12)  
Max Grav 2=550(LC 1), 6=448(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-540/200, 3-4=-312/127, 4-5=-277/132, 5-6=-450/200  
BOT CHORD 2-7=-235/465  
WEBS 3-7=-301/194, 5-7=-104/333

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 8-6-0, Zone3 8-6-0 to 11-4-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=139, 6=125.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Buildings FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:26 2025 Page 1  
ID:7CvAcxa5dm4a2lcSLiTv8vDLir-iZ6rBZlhaD8Yvo?SIIdr1z6GdsapP03qYf8pozPu53



<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-8-0 oc purlins, except end verticals.
BOT CHORD	2x8 SP 2400F 2.0E		
WEBS	2x4 SP No.3	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=0-5-8, 5=0-3-8  
 Max Horz 1=155(LC 8)  
 Max Uplift 1=-488(LC 8), 5=-359(LC 8)  
 Max Grav 1=2165(LC 1), 5=1484(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-2=-2396/535, 2-3=-984/231, 3-4=-956/249, 4-5=-1475/367  
 BOT CHORD 1-7=-558/2038, 6-7=-558/2038  
 WEBS 2-7=-261/1286, 2-6=-1497/4336, 3-6=-155/748, 4-6=-300/1221

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=488, 5=359.
- 7) Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 4-6-12 from the left end to 8-6-12 to connect truss(es) to front face of bottom chord.
- 8) Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 0-6-12 from the left end to 2-6-12 to connect truss(es) to back face of bottom chord.
- 9) Fill all nail holes where hanger is in contact with lumber.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

## LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-3=-60, 3-4=-60, 5-8=-20  
Concentrated Loads (lb)  
Vert: 7=-500(F) 6=-500(F) 10=-623(B) 11=-619(B) 12=-500(F)

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18, 2025




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Components Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-LLS.com](http://MiTek-LLS.com)

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:27 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78vDLIj-rlqDOuzwS L?93NBs9psQEWHC18eYwxDvCPh8EzPu52



**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-4=-1328/770, 4-5=-1242/778, 5-6=-938/654, 6-7=-804/497
BOT CHORD	2-15=-724/1016, 13-15=-595/906, 12-13=-337/533
WEBS	5-15=-338/529, 6-13=-343/314, 7-13=-508/864, 7-12=-1265/785, 9-12=-311/201, 10-12=-349/211

**LOAD CASE(S)** Standard  
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-5=-60, 5-10=-60, 11-16=-20

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18, 2025

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpiinst.org](http://www.tpiinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036633
4460945	T07	Half Hip Girder	1	1	Job Reference (optional)	

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 8=-23(F) 10=-45(F) 11=-172(F) 15=-297 6=-24(F) 20=-24(F) 21=-24(F) 22=-24(F) 23=-23(F) 24=-23(F) 25=-23(F) 26=42(F) 27=42(F) 28=42(F) 30=42(F)  
31=-164(F) 32=-164(F) 33=-164(F) 34=-164(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036634
4460945	T08	Half Hip	1	1		

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:27 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-nlgDOuzwS\_L?93NBs9psQEWlx15BYwlDvCPh8EzPu52

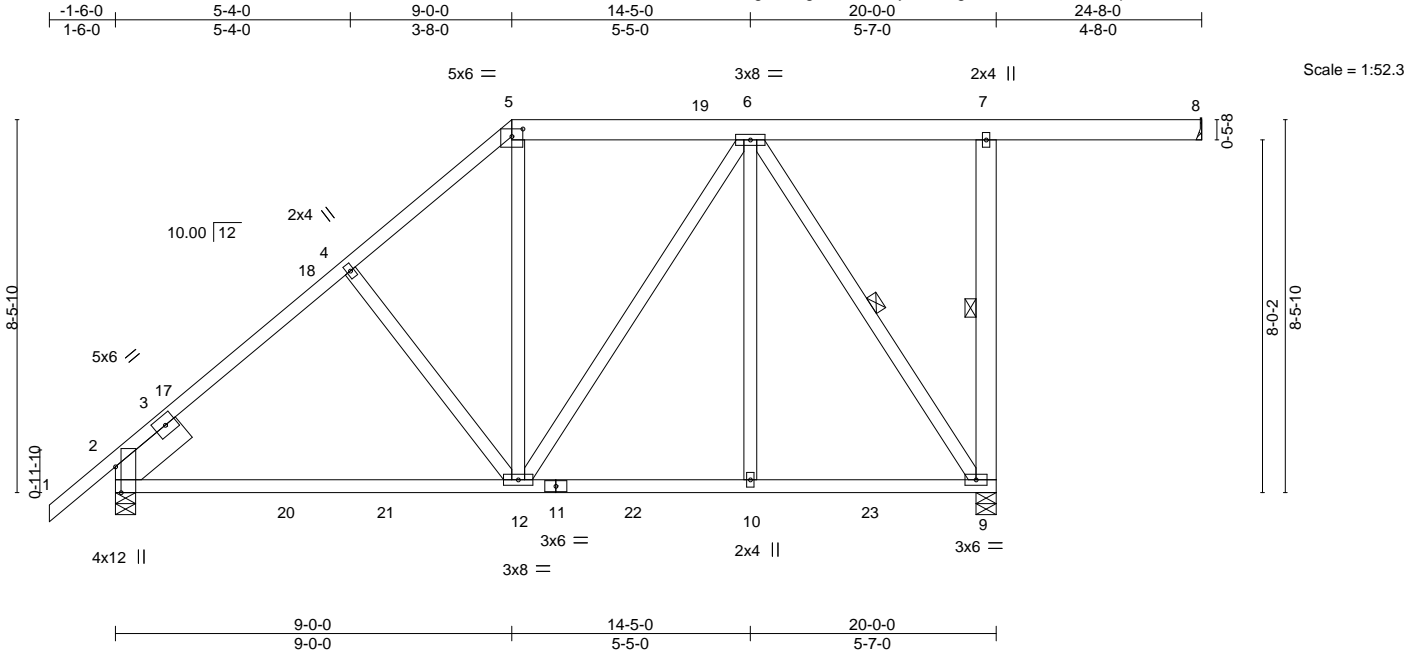


Plate Offsets (X,Y)-- [2:0-7-1,Edge], [5:0-3-0,0-2-1]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.21	Vert(LL)	-0.16 12-15	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.68	Vert(CT)	-0.27 12-15	>869	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.39	Horz(CT)	0.02 2	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS					Weight: 170 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except* 5-8: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 7-9: 2x6 SP No.2	WEBS 1 Row at midpt 7-9, 6-9
SLIDER Left 2x8 SP 2400F 2.0E 1-11-8	

REACTIONS.	(size) 8=Mechanical, 9=0-5-8, 2=0-5-8 Max Horz 2=330(LC 12) Max Uplift 8=56(LC 9), 9=334(LC 9), 2=163(LC 12) Max Grav 8=111(LC 26), 9=1062(LC 2), 2=965(LC 19)
------------	---

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown. TOP CHORD 2-4=-904/141, 4-5=-790/169, 5-6=-560/170, 7-9=-345/170 BOT CHORD 2-12=-300/697, 10-12=-117/454, 9-10=-117/454 WEBS 4-12=-254/213, 5-12=-25/287, 6-12=-131/255, 6-10=0/276, 6-9=-809/215
---------	---

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1 13-2-15 to 24-7-4 zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 7) Refer to girder(s) for truss to truss connections.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 9=334, 2=163.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036635
4460945	T09	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,
8.830 s Apr 11 2025 MiTek Industries, Inc.
Thu Apr 17 07:08:28 2025
Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLIr-FyEbcE\_YDITsnDyNPtK5zS2RDRPBHNM8s8FggzPu51

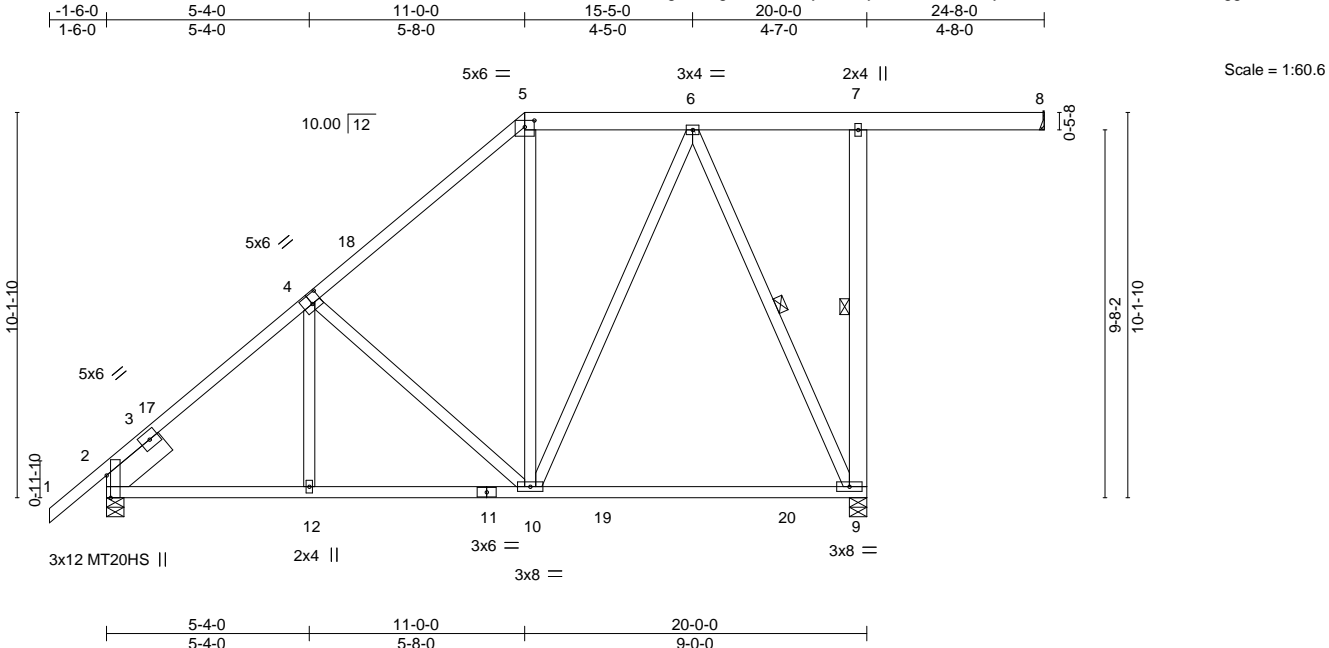


Plate Offsets (X,Y)--		[2:0-7-1,Edge], [4:0-3-0,0-3-0], [5:0-3-0,0-2-1]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.37	Vert(LL)	-0.27	9-10	>864	240	MT20 244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.82	Vert(CT)	-0.42	9-10	>562	180	MT20HS 187/143
BCLL	0.0 *	Rep Stress Incr YES		WB	0.42	Horz(CT)	0.02	9	n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS							Weight: 177 lb FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2 *Except* 5-8: 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-8-13 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 9-7-3 oc bracing.
WEBS 2x4 SP No.3 *Except* 7-9: 2x6 SP No.2	WEBS 1 Row at midpt 7-9, 6-9
SLIDER Left 2x8 SP 2400F 2.0E 1-11-8	

**REACTIONS.** (size) 8=Mechanical, 9=0-5-8, 2=0-5-8  
Max Horz 2=394(LC 12)  
Max Uplift 8=-59(LC 8), 9=-332(LC 9), 2=-150(LC 12)  
Max Grav 8=115(LC 26), 9=1048(LC 2), 2=957(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-940/127, 4-5=-690/122, 5-6=-470/163, 7-9=-329/159  
BOT CHORD 2-12=-359/747, 10-12=-359/747, 9-10=-90/283  
WEBS 4-10=-371/259, 6-10=-182/509, 6-9=-654/225

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 11-0-0, Zone2 11-0-0 to 15-5-0, Zone1 15-5-0 to 24-7-4 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 9=332, 2=150.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T10	Piggyback Base	3	1	T37036636

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:28 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-FyEbcE\_YDITsnDyNPtK5zS2S?RXyHNXM8s8FggzPu51

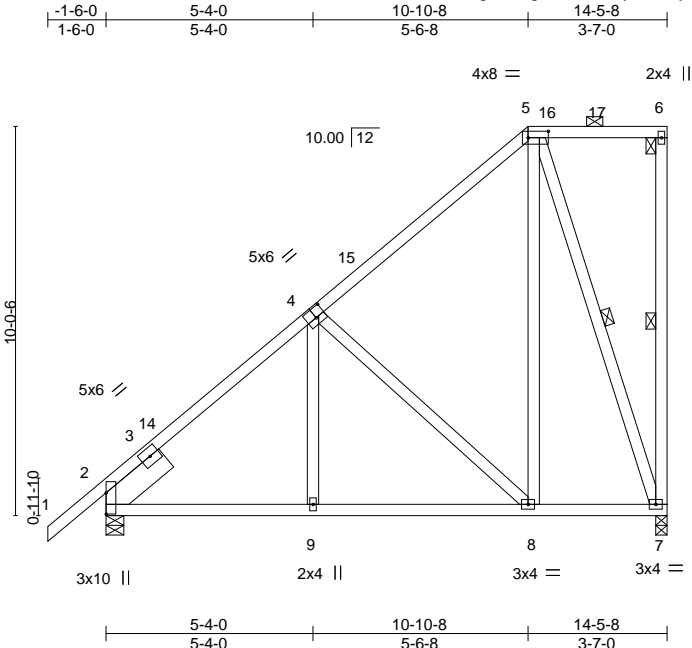


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [4:0-3-0,0-3-0], [5:0-6-4,0-2-0]													
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.32	Vert(LL)	-0.03	8-9	>999	240	MT20	244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.26	Vert(CT)	-0.06	8-9	>999	180			
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.42	Horz(CT)	-0.01	2	n/a	n/a			
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 118 lb	FT = 20%	

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x8 SP 2400F 2.0E 1-11-8

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 6-7, 5-7

**REACTIONS.**

(size) 7=0-3-8, 2=0-5-8  
Max Horz 2=393(LC 12)  
Max Uplift 7=-272(LC 12), 2=-83(LC 12)  
Max Grav 7=568(LC 1), 2=667(LC 1)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-596/33, 4-5=-324/28  
BOT CHORD 2-9=-289/441, 8-9=-288/441  
WEBS 4-8=-379/266, 5-8=-136/368, 5-7=-490/275

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 10-10-8, Zone3 10-10-8 to 14-3-12 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 7=272.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036637
4460945	T13	Half Hip	1	1		

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:29 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-j8nzpa?A\_bbjPMXazarKVfbdIrtB0qmWMWuoC7zPu50

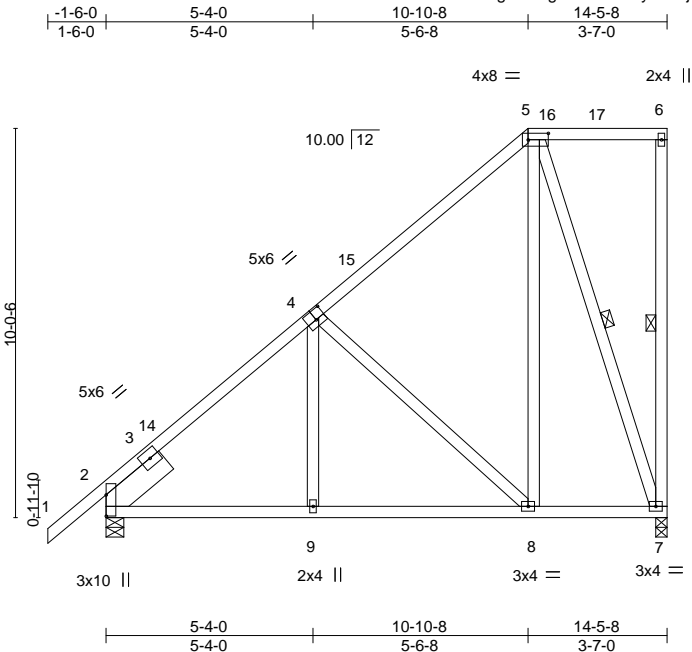


Plate Offsets (X,Y)--	[2:Edge,0-0-0], [4:0-3-0,0-3-0], [5:0-6-4,0-2-0]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	-0.03	8-9	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.26	Vert(CT)	-0.06	8-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.42	Horz(CT)	-0.01	2	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS						Weight: 118 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x8 SP 2400F 2.0E 1-11-8

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 6-7, 5-7

REACTIONS.

(size) 7=0-3-8, 2=0-5-8  
Max Horz 2=393(LC 12)  
Max Uplift 7=-272(LC 12), 2=-83(LC 12)  
Max Grav 7=568(LC 1), 2=667(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-596/33, 4-5=-324/28  
BOT CHORD 2-9=-289/441, 8-9=-288/441  
WEBS 4-8=-379/266, 5-8=-136/368, 5-7=-490/275

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 10-10-8, Zone3 10-10-8 to 14-3-12 zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 7=272.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036638
4460945	T14	Half Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:29 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-j8nzpa?A\_bbjPMXazarKVfbErn90qCWMWuoC7zPu50

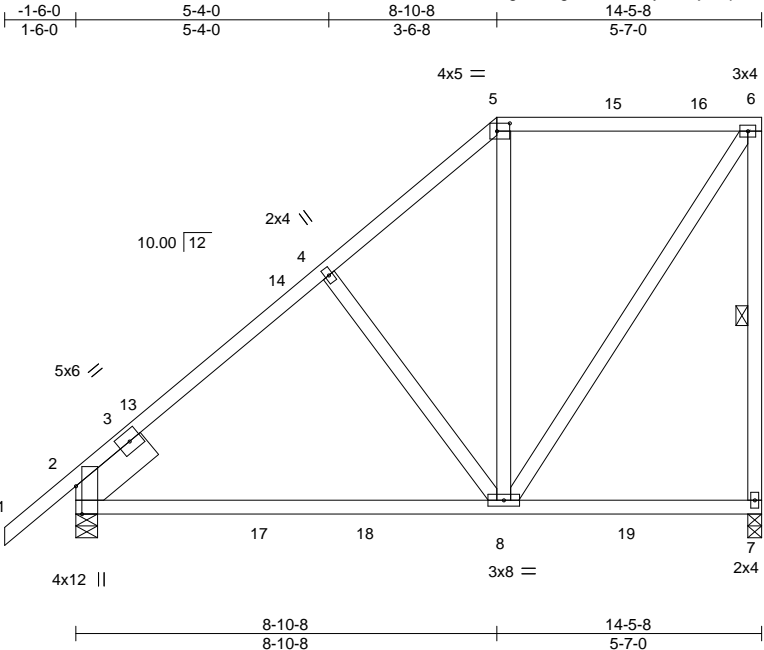


Plate Offsets (X,Y)--		[2:0-7-1,Edge], [5:0-3-4,0-2-0]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.25	TC 0.41	Vert(LL)	-0.15	8-11	>999	240	MT20	244/190	
TCDL 10.0	Lumber DOL	1.25	BC 0.64	Vert(CT)	-0.27	8-11	>645	180			
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.39	Horz(CT)	0.03	2	n/a	n/a			
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS						Weight: 102 lb	FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x8 SP 2400F 2.0E 1-11-8

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 6-7

REACTIONS.

(size) 7=0-3-8, 2=0-5-8  
Max Horz 2=329(LC 12)  
Max Uplift 7=214(LC 12), 2=120(LC 12)  
Max Grav 7=653(LC 2), 2=742(LC 19)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-701/79, 4-5=-454/110, 5-6=-303/123, 6-7=-569/227  
BOT CHORD 2-8=-253/467  
WEBS 4-8=-276/215, 6-8=-221/543

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 8-10-8, Zone2 8-10-8 to 13-1-7, Zone1 13-1-7 to 14-3-12 zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=214, 2=120.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036639
4460945	T15	Common	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:30 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-BKLM1w0plvkZ1W6mXHNZ2t8oJE35U1fbAdLIzPu5?

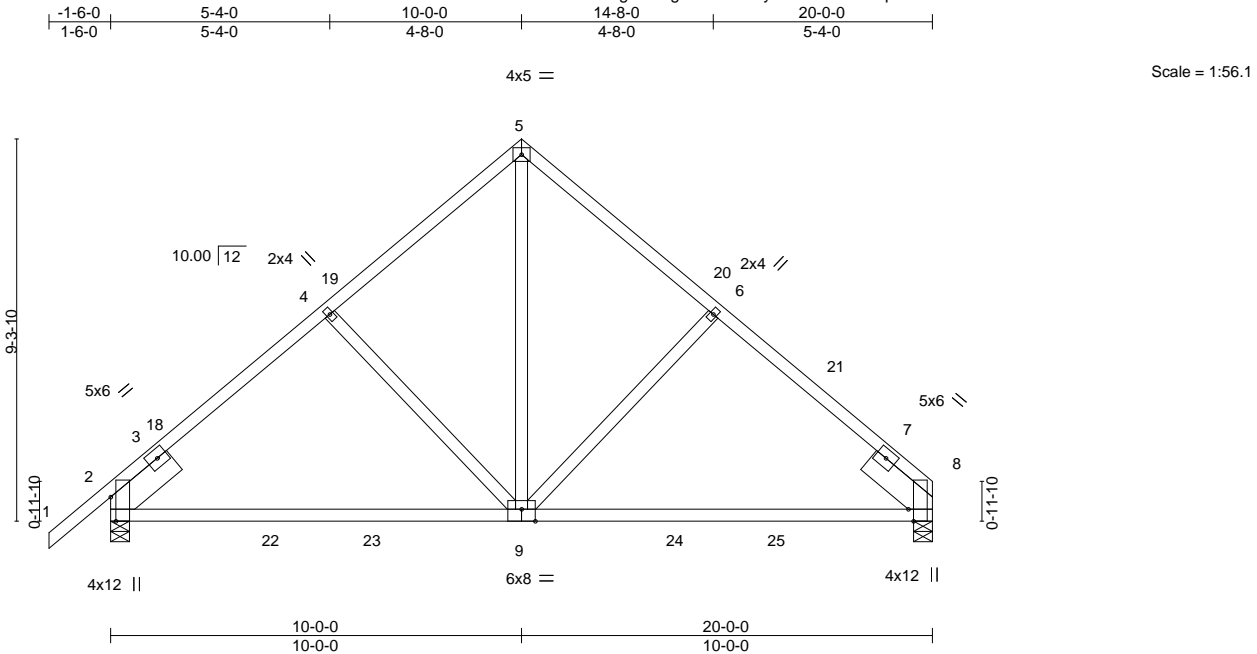


Plate Offsets (X,Y)-- [2:0-7-1,Edge], [2:0-0-0,0-0-0], [4:0-0-0,0-0-0], [8:0-3-8,Edge], [9:0-4-0,Edge]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.		in (loc) l/defl L/d		PLATES GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.26	Vert(LL)	-0.18	9-12	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.92	Vert(CT)	-0.31	9-12	>772	180	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.29	Horz(CT)	0.02	2	n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS							Weight: 116 lb FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x8 SP 2400F 2.0E 1-11-8, Right 2x8 SP 2400F 2.0E 1-11-8

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 5-11-14 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

**REACTIONS.** (size) 8=0-5-8, 2=0-5-8  
Max Horz 2=226(LC 9)  
Max Uplift 8=167(LC 13), 2=205(LC 12)  
Max Grav 8=906(LC 20), 2=995(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-951/228, 4-5=-811/247, 5-6=-810/246, 6-8=-902/227  
BOT CHORD 2-9=-199/808, 8-9=-108/711  
WEBS 5-9=-187/693, 6-9=-293/236, 4-9=-283/231

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 10-0-0, Zone2 10-0-0 to 14-2-15, Zone1 14-2-15 to 20-0-0 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=167, 2=205.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:30 2025 Page 1  
ID:7CvAcxa5dm4a2lcSLITv78vDLIr-BKLM1w0pIvKZ1W6mXHNZ2t8oJE32J?fbAdIJzPu5?



<b>BRACING-</b>	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 2-2-0 oc bracing.

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-3=-906/229, 3-4=-815/248, 4-5=-815/248, 5-7=-906/229
BOT CHORD	1-8=-204/819, 7-8=-110/714
WEBS	4-8=-189/699, 5-8=-293/236, 3-8=-293/235

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDF=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCp=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0 to 3-0-0, Zone1 3-0-0 to 10-0-0, Zone2 10-0-0 to 14-2-15, Zone1 14-2-15 to 20-0-0 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb)  
1=167. 7=167.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Components Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-LLS.com](http://MiTek-LLS.com)


Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036641
4460945	T17	Common Girder	1	3	Job Reference (optional)	

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:31 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLIr-fXvkEG1RWDsQeggy5?uaa4gy8eZxUbToqqNvH?zPu5\_



5x6 ||

Scale = 1:58.8

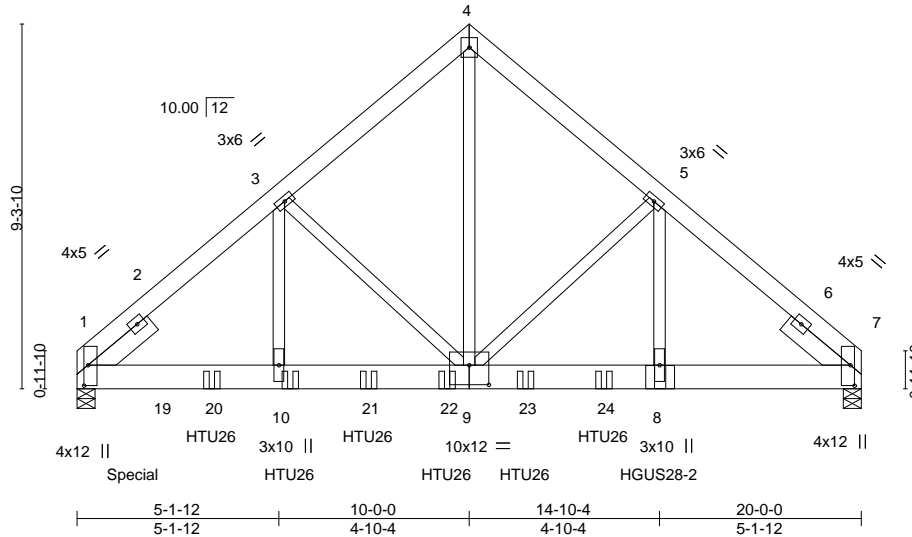


Plate Offsets (X,Y)-- [1:0-6-4,0-1-4], [3:0-0-0,0-0-0], [7:0-6-4,0-1-4], [7:0-0-0,0-0-0], [9:0-6-0,0-6-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	-0.07	8-9	>999	240	
TCDL 10.0	Lumber DOL	1.25	BC 0.24	Vert(CT)	-0.14	8-9	>999	180	
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.98	Horz(CT)	0.04	7	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS						
								Weight: 529 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x6 SP No.2  
BOT CHORD 2x8 SP 2400F 2.0E  
WEBS 2x4 SP No.3  
SLIDER Left 2x6 SP No.2 1-11-8, Right 2x6 SP No.2 1-11-8

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=0-5-8, 7=0-5-8  
Max Horz 1=-201(LC 25)  
Max Uplift 1=-2109(LC 8), 7=-2154(LC 9)  
Max Grav 1=8276(LC 2), 7=6300(LC 2)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-3=-8822/2338, 3-4=-6443/1918, 4-5=-6425/1910, 5-7=-8372/2857  
BOT CHORD 1-10=-1801/6619, 9-10=-1801/6619, 8-9=-2077/6207, 7-8=-2077/6207  
WEBS 4-9=-2259/7717, 5-9=-1915/1146, 5-8=-1368/2695, 3-9=-2320/625, 3-10=-631/3142

#### NOTES-

- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-5-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=2109, 7=2154.
- Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 3-5-4 from the left end to 13-5-4 to connect truss(es) to back face of bottom chord.
- Use Simpson Strong-Tie HGUS28-2 (36-10d Girder, 12-10d Truss) or equivalent at 14-10-7 from the left end to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1598 lb down and 370 lb up at 1-5-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

#### LOAD CASE(S) Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T17	Common Girder	1	3	T37036641

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-60, 4-7=-60, 11-15=-20

Concentrated Loads (lb)

Vert: 8=-2301(B) 10=-1398(B) 19=-1401(B) 20=-1398(B) 21=-1404(B) 22=-1404(B) 23=-1404(B) 24=-1404(B)


 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)



Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:34 2025 Page 1  
 ID:7CvCcxg5dm4g2lcSLITv78yDLlr-36bssl3Jp8E?V8Pxm7RVCjISmsY8h2oFwObZKtKzPu4x  
 6-0-15 12-0-3 17-11-6 23-10-9 29-9-13 35-10-12  
 6-0-15 5-11-3 5-11-3 5-11-3 5-11-3 6-0-15  
 Scale = 1:61.2

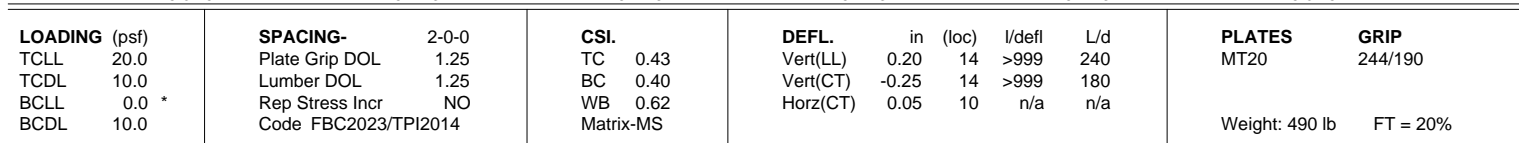

**REACTIONS.** (size) 18=Mechanical, 10=0-3-8  
 Max Uplift 18=-1435(LC 4), 10=-1422(LC 4)  
 Max Grav 18=2321(LC 1), 10=2330(LC 1)

**NOTES-**

- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.
- 4) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- 5) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Refer to girder(s) for truss to truss connections.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=1435, 10=1422.
- 11) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

Continued on page 2 Date: April 18, 2025

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18, 2025

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036642
4460945	T18	Flat Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:34 2025 Page 2  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-36bssl3Jp8E?V8PXm7RVCjISmsY8h2oFWobZtKzPu4x

**LOAD CASE(S)** Standard

Uniform Loads (plf)

Vert: 1-9=-60, 10-18=-20

Concentrated Loads (lb)

Vert: 16=-41(F) 14=-41(F) 5=-62(F) 12=-41(F) 6=-62(F) 8=-70(F) 11=-48(F) 13=-41(F) 19=-62(F) 20=-62(F) 21=-62(F) 22=-62(F) 23=-62(F) 24=-62(F) 25=-62(F) 26=-62(F) 27=-62(F) 28=-62(F) 29=-62(F) 30=-62(F) 31=-70(F) 32=-70(F) 33=-41(F) 34=-41(F) 35=-41(F) 36=-41(F) 37=-41(F) 38=-41(F) 39=-41(F) 40=-41(F) 41=-41(F) 42=-41(F) 43=-48(F) 44=-48(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036643
4460945	T19	Piggyback Base	3	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:35 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-Yl9F4e4xZRM57H\_kKryklwrXCfp8QSGOISL6PmzPu4w

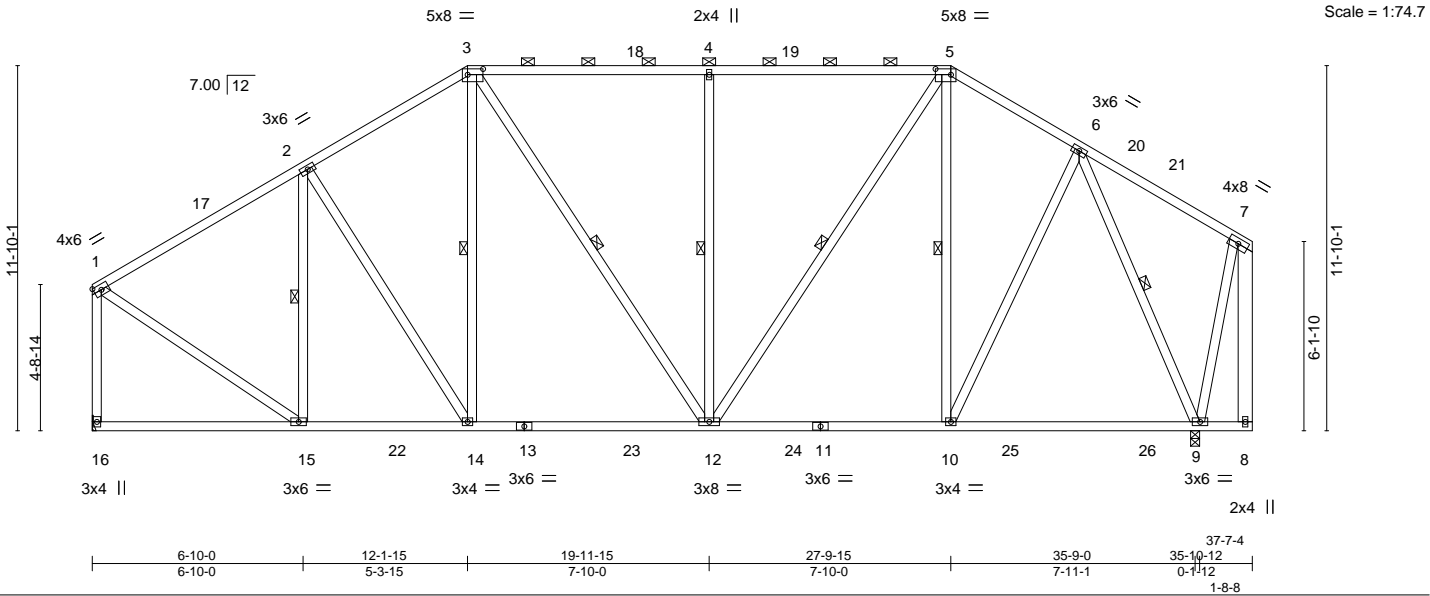


Plate Offsets (X,Y)--		[3:0-6-0,0-2-4], [5:0-6-0,0-2-4]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES		GRIP	
TCLL	20.0	Plate Grip DOL 1.25		TC	0.83	Vert(LL)	-0.14	12-14	>999	240	MT20		244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.74	Vert(CT)	-0.25	12-14	>999	180			
BCLL	0.0 *	Rep Stress Incr YES		WB	0.80	Horz(CT)	0.04	9	n/a	n/a			
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS						Weight: 303 lb FT = 20%			

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-2-3 oc purlins, except end verticals, and 2-0-0 oc purlins (4-1-9 max.): 3-5.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 2-15, 3-14, 3-12, 4-12, 5-12, 5-10, 6-9
3-12,5-12: 2x4 SP No.2, 7-8: 2x6 SP No.2	

REACTIONS. (size) 16=Mechanical, 9=0-3-8  
Max Horz 16=314(LC 11)  
Max Uplift 16=351(LC 12), 9=367(LC 13)  
Max Grav 16=1622(LC 2), 9=1806(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-1349/321, 2-3=-1427/422, 3-4=-1307/390, 4-5=-1307/390, 5-6=-1129/315, 1-16=-1514/368  
BOT CHORD 15-16=-305/268, 14-15=-375/1169, 12-14=-362/1167, 10-12=-227/921, 9-10=-178/615  
WEBS 2-15=-502/166, 3-14=-59/321, 3-12=-217/328, 4-12=-548/278, 5-12=-258/720, 5-10=-390/235, 6-10=-207/742, 6-9=-1569/353, 1-15=-223/1291

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-12 to 3-10-14, Zone1 3-10-14 to 12-1-15, Zone2 12-1-15 to 17-5-12, Zone1 17-5-12 to 27-9-15, Zone2 27-9-15 to 33-1-12, Zone1 33-1-12 to 37-4-8 zone; end vertical right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=351, 9=367.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036644
4460945	T19G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:36 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-0UjdHz4ZKIUjIRZwtYTzH8Nk\_f8h9wlYz64gx DzPu4v

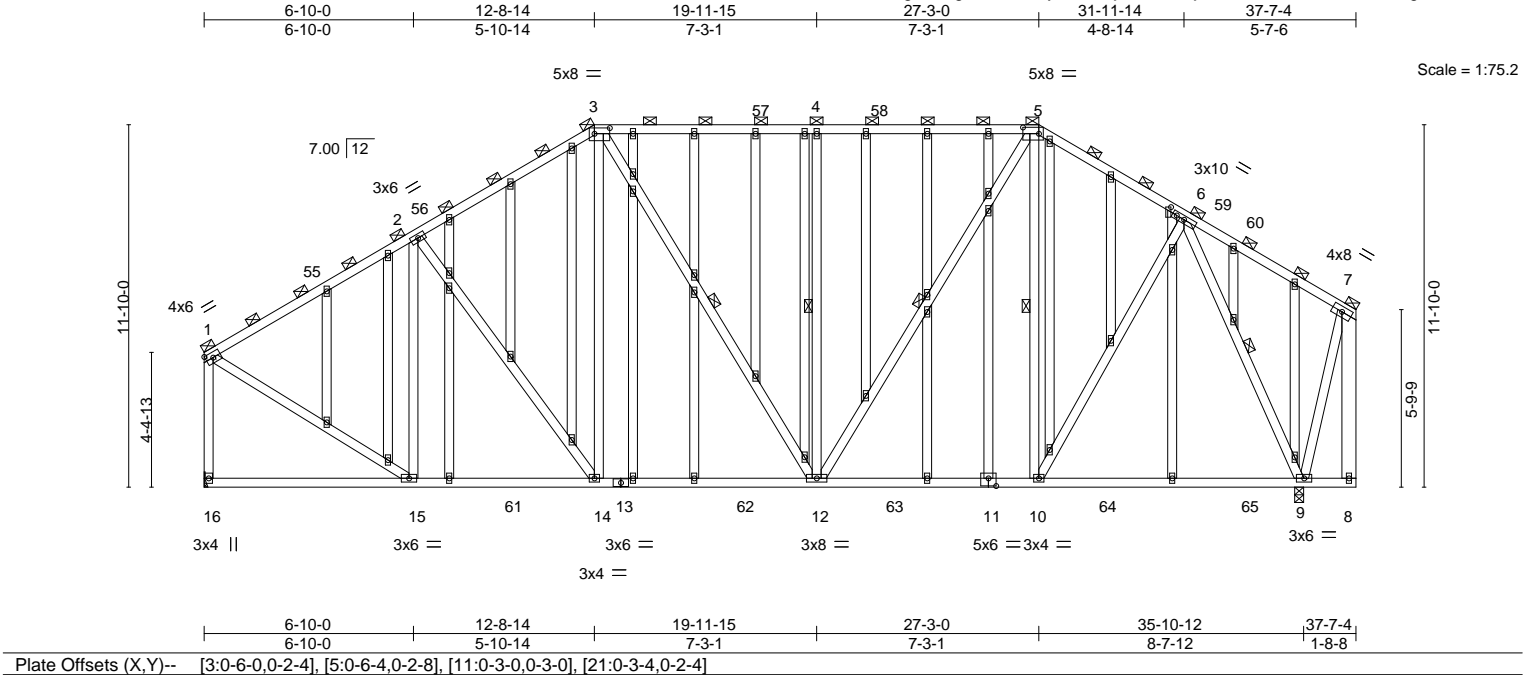

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.70	Vert(LL)	-0.18 9-10	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.78	Vert(CT)	-0.30 9-10	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.75	Horz(CT)	0.05 9	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS					Weight: 510 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (4-2-6 max.), except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 3-12, 4-12, 5-12, 5-10, 6-9
OTHERS 3-12,5-12: 2x4 SP No.2, 7-8: 2x6 SP No.2	
2x4 SP No.3	

REACTIONS.	(size) 16=Mechanical, 9=0-3-8
Max Horz	16=178(LC 9)
Max Uplift	16=342(LC 12), 9=359(LC 13)
Max Grav	16=1620(LC 2), 9=1802(LC 2)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-1404/322, 2-3=-1461/412, 3-4=-1298/376, 4-5=-1298/376, 5-6=-1186/337, 1-16=-1515/358
BOT CHORD	14-15=-354/1193, 12-14=-274/1190, 10-12=-151/964, 9-10=-110/637
WEBS	2-15=-472/159, 3-14=-70/355, 3-12=-201/296, 4-12=-506/259, 5-12=-239/664, 5-10=-336/199, 6-10=-173/695, 6-9=-1554/329, 1-15=-219/1317

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-12 to 3-10-14, Zone1 3-10-14 to 12-8-14, Zone2 12-8-14 to 18-0-11, Zone1 18-0-11 to 27-3-0, Zone2 27-3-0 to 32-6-13, Zone1 32-6-13 to 37-4-8 zone;C/C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=342, 9=359.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036646
4460945	T21	Piggyback Base	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:38 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLiTv78yDLlr-ytqNif6qsMkR\_lji?zWRNZT2VTp2dpgqRPZn05zPu4t

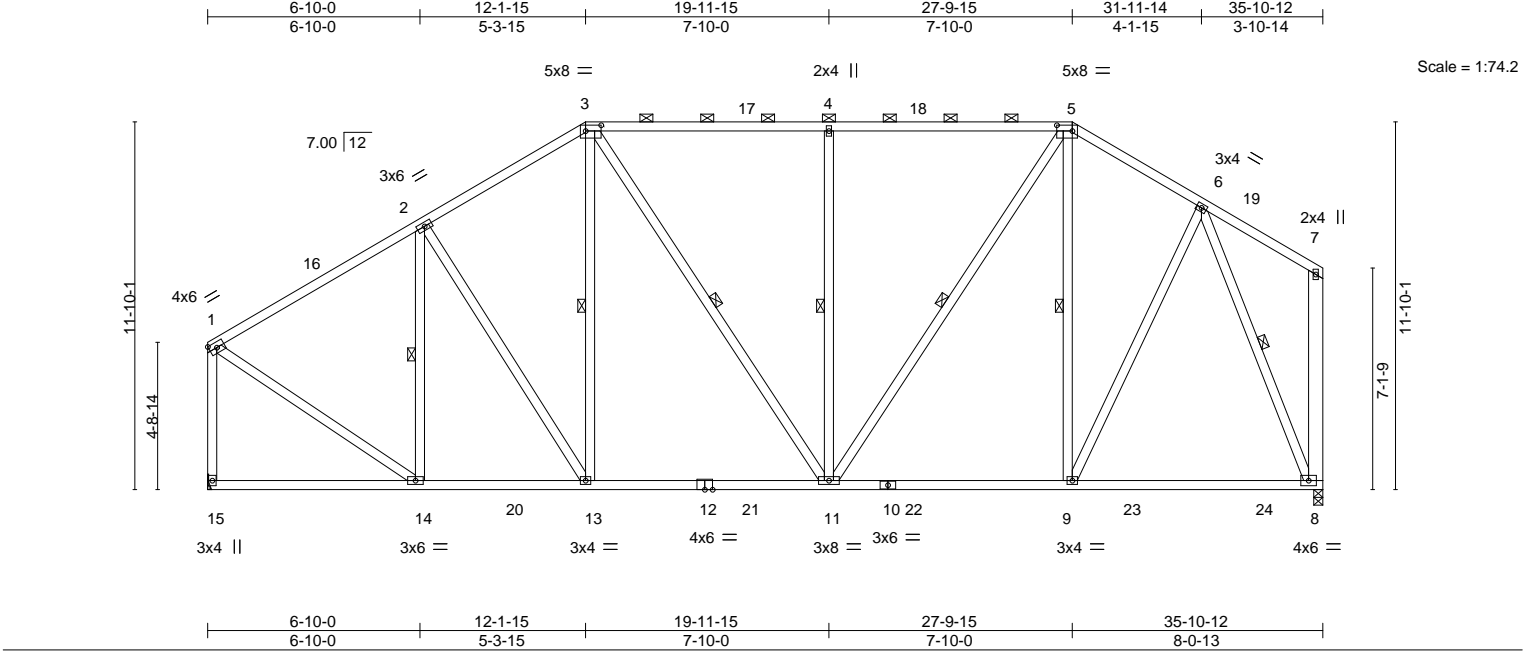


Plate Offsets (X,Y)--		[3:0-6-0,0-2-4], [5:0-6-0,0-2-4]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES		GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.83	Vert(LL)	-0.17	8-9	>999	240	MT20	244/190		
TCDL	10.0	Lumber DOL 1.25		BC	0.79	Vert(CT)	-0.28	8-9	>999	180				
BCLL	0.0 *	Rep Stress Incr YES		WB	0.76	Horz(CT)	0.04	8	n/a	n/a				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS							Weight: 291 lb		FT = 20%	

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-2-4 oc purlins, except end verticals, and 2-0-0 oc purlins (4-1-14 max.): 3-5.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 9-6-2 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 2-14, 3-13, 3-11, 4-11, 5-11, 5-9, 6-8
3-11,5-11: 2x4 SP No.2, 7-8: 2x6 SP No.2	

**REACTIONS.** (size) 15=Mechanical, 8=0-3-8  
Max Horz 15=327(LC 11)  
Max Uplift 15=-350(LC 12), 8=-335(LC 13)  
Max Grav 15=1618(LC 2), 8=1662(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-1345/320, 2-3=-1422/420, 3-4=-1300/387, 4-5=-1300/387, 5-6=-1113/312, 1-15=-1510/366  
BOT CHORD 14-15=-318/267, 13-14=-385/1165, 11-13=-371/1163, 9-11=-231/914, 8-9=-193/591  
WEBS 2-14=-500/165, 3-13=-59/323, 3-11=-216/324, 4-11=-547/278, 5-11=-264/720, 5-9=-403/242, 6-9=-211/775, 1-14=-222/1287, 6-8=-1517/342

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-12 to 3-8-13, Zone1 3-8-13 to 12-1-15, Zone2 12-1-15 to 17-2-14, Zone1 17-2-14 to 27-9-15, Zone2 27-9-15 to 32-10-14, Zone1 32-10-14 to 35-8-0 zone; end vertical right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 15=350, 8=335.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T22	PIGGYBACK BASE	7	1	
					T37036647
					Job Reference (optional)

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, ID:7CvAcxg5dm4g2lcSLITv78yDLIr-zGAJDhLA\_nvqc2CgNNJveKWwk0uHJESMm8osMizPmjH 8.830 s Feb 18 2025 MiTek Industries, Inc. Thu Apr 17 15:31:40 2025 Page 1

1-6-0 7-4-0 12-2-12 17-6-11 25-4-11 33-2-11 37-4-10 41-6-0  
1-6-0 7-4-0 4-10-12 5-3-15 7-10-0 7-10-0 4-1-15 4-1-6

Scale = 1:75.7

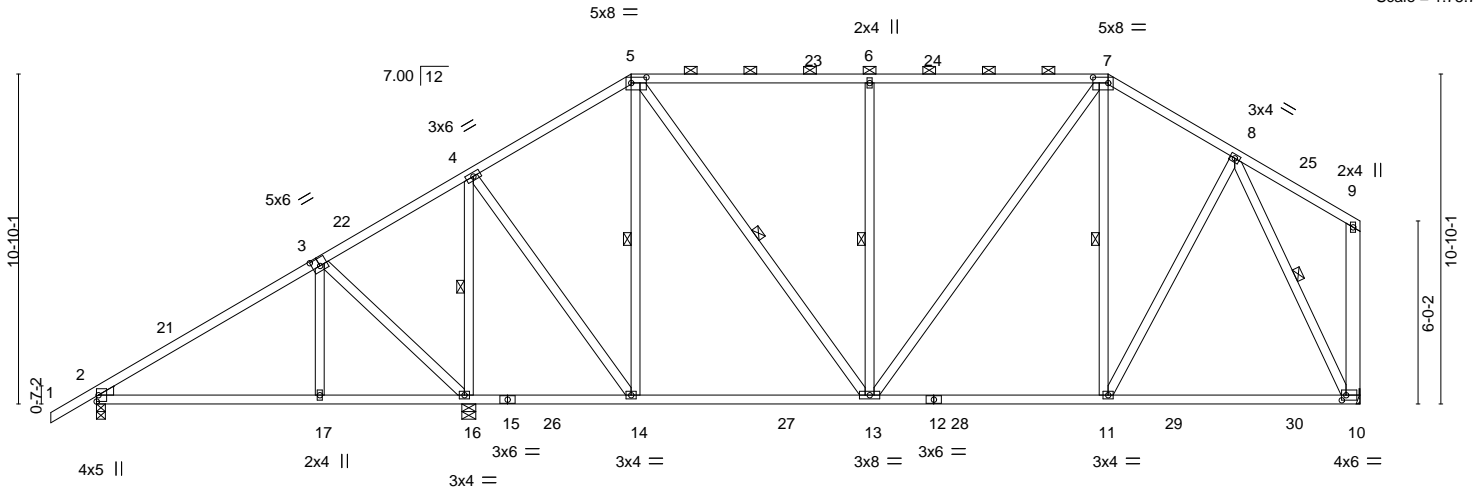


Plate Offsets (X,Y)--	[3:0-3-0,0-3-0], [5:0-6-0,0-2-4], [7:0-6-0,0-2-4], [10:0-1-12,0-2-0]
-----------------------	--

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.82	Vert(LL)	-0.18 10-11	>999	240	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.25	BC 0.78	Vert(CT)	-0.30 10-11	>999	180		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.57	Horz(CT)	0.04 10	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS						
	Code FBC2023/TPI2014						Weight: 295 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-9-15 oc purlins, except end verticals, and 2-0-0 oc purlins (4-11-1 max.): 5-7.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 4-16, 5-14, 5-13, 6-13, 7-11, 8-10
5-13,7-13: 2x4 SP No.2, 9-10: 2x6 SP No.2	
WEDGE	
Left: 2x4 SP No.3	

<b>REACTIONS.</b> (lb/size)	2=627/0-3-8 (min. 0-1-8), 16=1585/0-5-8 (min. 0-2-2), 10=1179/Mechanical
Max Horz	2=322(LC 12)
Max Uplift	2=-150(LC 12), 16=-433(LC 12), 10=-295(LC 13)
Max Grav	2=643(LC 27), 16=1815(LC 2), 10=1371(LC 2)

<b>FORCES.</b> (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-21=-630/205, 3-21=-556/225, 4-5=-802/244, 5-23=-996/306, 6-23=-996/306, 6-24=-996/306, 7-24=-996/306, 7-8=-978/296
BOT CHORD	2-17=-287/536, 16-17=-287/538, 14-27=-181/628, 13-27=-181/628, 12-13=-124/800, 12-28=-124/800, 11-28=-124/800, 11-29=-117/559, 29-30=-117/559, 10-30=-117/559
WEBS	3-17=-144/271, 3-16=-529/296, 4-16=-1290/306, 4-14=-165/914, 5-14=-479/178, 5-13=-215/647, 6-13=-546/278, 7-13=-191/375, 8-11=-145/539, 8-10=-1226/268

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 2-7-13, Zone1 2-7-13 to 17-6-11, Zone2 17-6-11 to 23-5-2, Zone1 23-5-2 to 33-2-11, Zone2 33-2-11 to 39-1-2, Zone1 39-1-2 to 41-3-4 zone; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 7) Refer to girder(s) for truss to truss connections.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 150 lb uplift at joint 2, 433 lb uplift at joint 16 and 295 lb uplift at joint 10.
  - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036648
4460945	T23	Piggyback Base	9	1		
Job Reference (optional)						

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:39 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-Q3OlV?7SdgsIcVlVZg1gvm?DtsHAMJ4\_f3JKYyZPu4s

1-6-0	7-4-0	14-5-8	17-6-11	24-8-0	28-11-6	33-2-11	34-10-8	41-6-0	43-0-0
1-6-0	7-4-0	7-1-8	3-1-3	7-1-5	4-3-6	4-3-6	1-7-13	6-7-8	1-6-0

Scale = 1:74.9

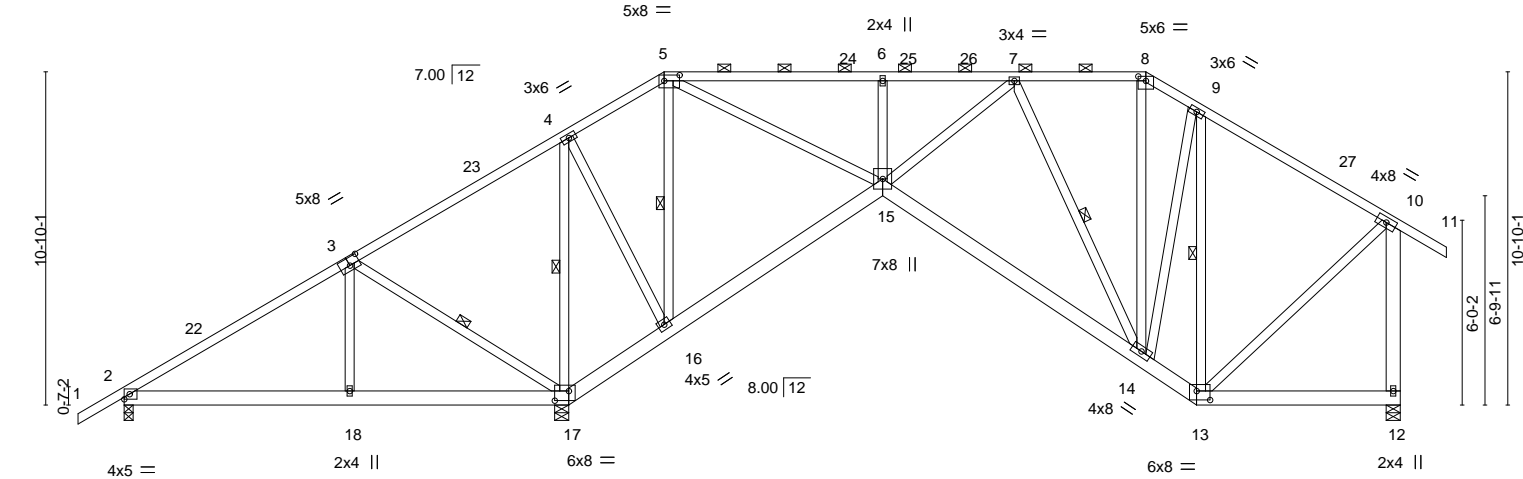


Plate Offsets (X,Y)--	[3:0-4-0,0-3-0], [5:0-6-0,0-2-4], [8:0-3-0,0-1-12], [13:0-5-4,0-3-8], [17:0-5-8,0-3-12]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.72	Vert(LL)	-0.06 14-15	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.28	Vert(CT)	-0.15 14-15	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.56	Horz(CT)	0.11 12	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS					Weight: 335 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-1-14 max.): 5-8.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 10-12: 2x6 SP No.2	WEBS 1 Row at midpt 3-17, 4-17, 5-16, 7-14, 9-13

REACTIONS.	(size) 2=0-3-8, 17=0-5-8, 12=0-5-8
Max Horz	2=354(LC 11)
Max Uplift	2=153(LC 26), 17=713(LC 9), 12=260(LC 13)
Max Grav	2=202(LC 25), 17=2421(LC 1), 12=917(LC 26)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-227/602, 3-4=-394/1045, 4-5=-170/485, 5-6=-738/214, 6-7=-738/214, 7-8=-434/245, 8-9=-565/288, 9-10=-549/242, 10-12=-853/274
BOT CHORD	2-18=-484/246, 17-18=-481/245, 16-17=-1036/318, 15-16=-525/275, 14-15=-251/753, 13-14=-130/495
WEBS	3-18=-166/358, 3-17=-656/367, 4-17=-1418/418, 4-16=-275/966, 5-16=-1050/373, 5-15=-383/1248, 6-15=-402/203, 7-14=-383/225, 9-14=-152/280, 9-13=-542/146, 10-13=-80/488

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 2-7-13, Zone1 2-7-13 to 17-6-11, Zone2 17-6-11 to 23-5-2, Zone1 23-5-2 to 33-2-11, Zone2 33-2-11 to 39-1-2, Zone1 39-1-2 to 43-0-0 zone; end vertical right exposed; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=153, 17=713, 12=260.
  - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T23D	PIGGYBACK BASE	3	1	
Builders FirstSource (Lake City,FL), Lake City, FL - 32055,					T37036649
Job Reference (optional)					

8.830 s Feb 18 2025 MiTek Industries, Inc. Thu Apr 17 15:33:41 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-wY\_Sc3o3Vz9SreywzH\_H2r0dJnJS9zhAbTcm5BzPmhO



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T24	Piggyback Base	5	1	T37036650
Job Reference (optional)					

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:40 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-uFy87L74O\_\_9D3th6OYvS\_YRTGbQ5m17uj2t4\_zPu4r

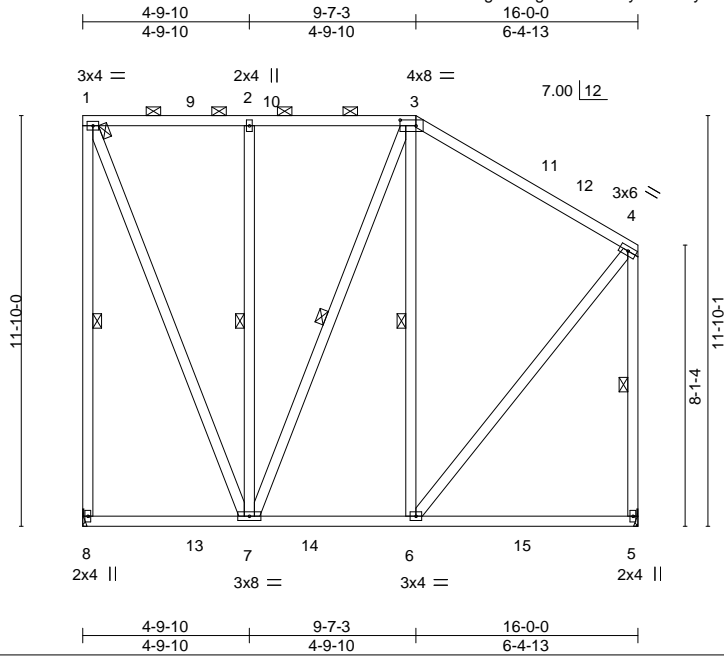


Plate Offsets (X,Y)--	[3:0-5-8,0-2-0]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.54	Vert(LL)	-0.08 5-6	>999	240	MT20 244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.41	Vert(CT)	-0.13 5-6	>999	180	
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.57	Horz(CT)	0.00 5	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS					Weight: 161 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
1-7,3-7: 2x4 SP No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-3.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 1-8, 2-7, 3-7, 3-6, 4-5

#### REACTIONS.

(size) 8=Mechanical, 5=Mechanical  
Max Horz 8=142(LC 13)  
Max Uplift 8=219(LC 8), 5=57(LC 8)  
Max Grav 8=736(LC 2), 5=738(LC 2)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-8=-635/260, 3-4=-377/84, 4-5=-605/111  
BOT CHORD 6-7=-22/259  
WEBS 1-7=-211/579, 2-7=-329/177, 4-6=-42/396

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 9-7-3, Zone2 9-7-3 to 13-10-2, Zone1 13-10-2 to 15-10-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 8=219.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T24G	GABLE	1	1	T37036651
Builders FirstSource (Lake City,FL), Lake City, FL - 32055,					Job Reference (optional)

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:41 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLiTv78yDLlr-MSWWKh8i9H60rCRtg538\_B5ZegwPqC6H7NoRcQzPu4q

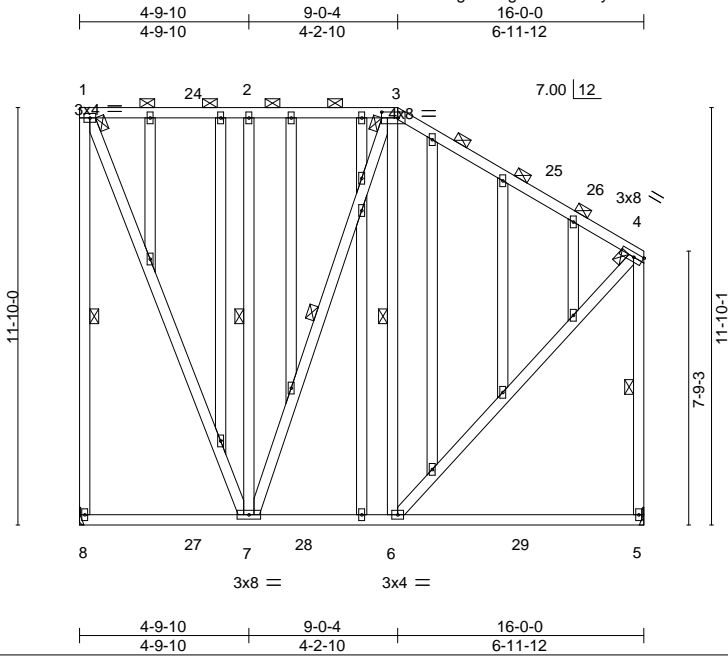


Plate Offsets (X,Y)--		[3:0-5-8,0-2-0]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.71		Vert(LL)	-0.11 5-6	>999	240	MT20	244/190
TCDL 10.0		Lumber DOL	1.25	BC 0.49		Vert(CT)	-0.19 5-6	>999	180		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.59		Horz(CT)	0.00 5	n/a	n/a		
BCDL 10.0		Code FBC2023/TPI2014		Matrix-MS						Weight: 238 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 1-8, 2-7, 3-7, 3-6, 4-5
1-7: 2x4 SP No.2	
OTHERS 2x4 SP No.3	

REACTIONS.	(size) 8=Mechanical, 5=Mechanical
	Max Horz 8=-155(LC 13)
	Max Uplift 8=-219(LC 8), 5=-54(LC 13)
	Max Grav 8=734(LC 2), 5=736(LC 2)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-8=-630/267, 3-4=-392/81, 4-5=-589/106
BOT CHORD	6-7=-19/270
WEBS	1-7=-215/569, 2-7=-306/169, 4-6=-34/379

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-1-12 to 3-1-12, Zone1 3-1-12 to 9-0-4, Zone2 9-0-4 to 13-3-3, Zone1 13-3-3 to 15-10-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 5) Provide adequate drainage to prevent water ponding.
  - 6) All plates are 2x4 MT20 unless otherwise indicated.
  - 7) Gable studs spaced at 2-0-0 oc.
  - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 10) Refer to girder(s) for truss to truss connections.
  - 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 8=219.
  - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036652
4460945	T25	Flat Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:42 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-qe4uY19KwbESTM04EpaNXPd pz49YZikQM1X\_9szPu4p

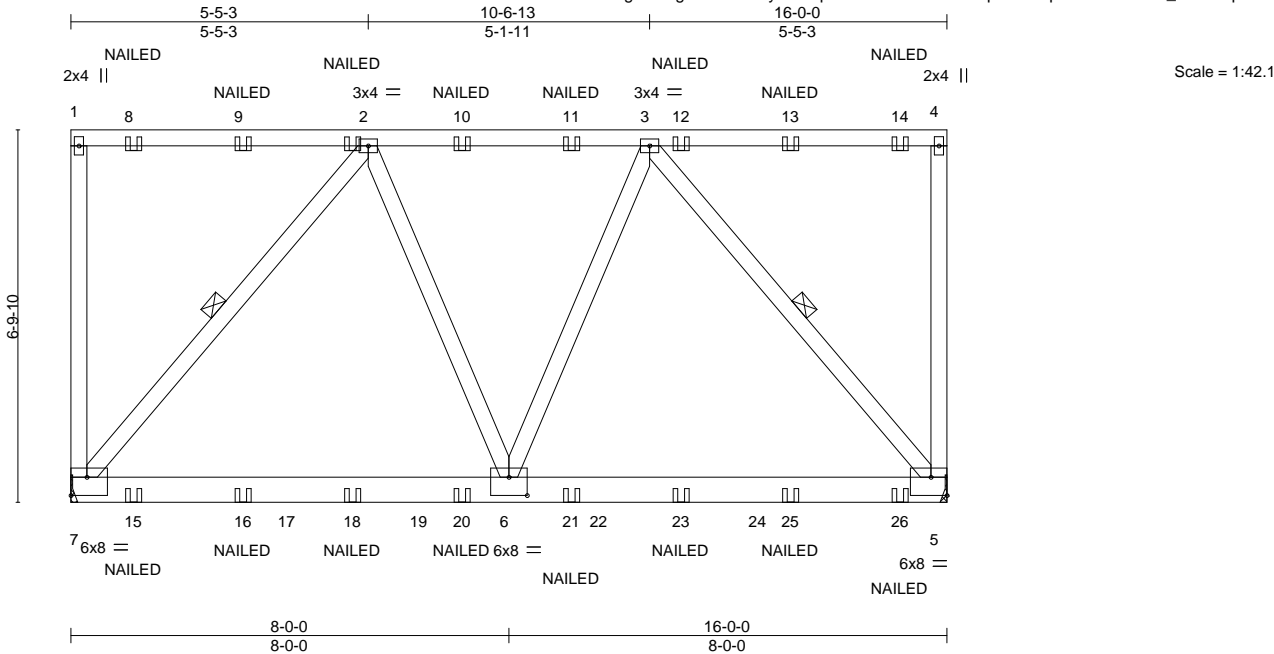


Plate Offsets (X,Y)-- [5:Edge,0-4-0], [6:0-4-0,0-4-0], [7:Edge,0-4-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL	20.0	Plate Grip DOL	1.25	TC	0.41	Vert(LL)	0.11 6-7 >999 240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.94	Vert(CT)	-0.16 6-7 >999 180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.43	Horz(CT)	0.01 5 n/a n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS				Weight: 122 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-7-14 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 9-9-4 oc bracing.  
WEBS 1 Row at midpt 2-7, 3-5

**REACTIONS.**

(size) 7=Mechanical, 5=Mechanical  
Max Uplift 7=782(LC 4), 5=809(LC 4)  
Max Grav 7=1449(LC 35), 5=1491(LC 35)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1035/534  
BOT CHORD 6-7=-432/785, 5-6=-433/786  
WEBS 2-7=-1204/663, 2-6=-275/673, 3-6=-274/671, 3-5=-1205/664

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=782, 5=809.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-60, 5-7=-20  
Concentrated Loads (lb)  
Vert: 2=-23(B) 8=-23(B) 9=-23(B) 10=-23(B) 11=-23(B) 12=-23(B) 13=-23(B) 14=-32(B) 15=-164(B) 16=-164(B) 18=-164(B) 20=-164(B) 21=-164(B) 23=-164(B) 25=-164(B) 26=-167(B)

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T26	Piggyback Base	5	1	T37036653

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,
8.830 s Apr 11 2025 MiTek Industries, Inc.
Thu Apr 17 07:08:42 2025
Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-qe4uY19KwbEsTM04EpaNXPdrT4J2ZI8QM1X\_9szPu4p

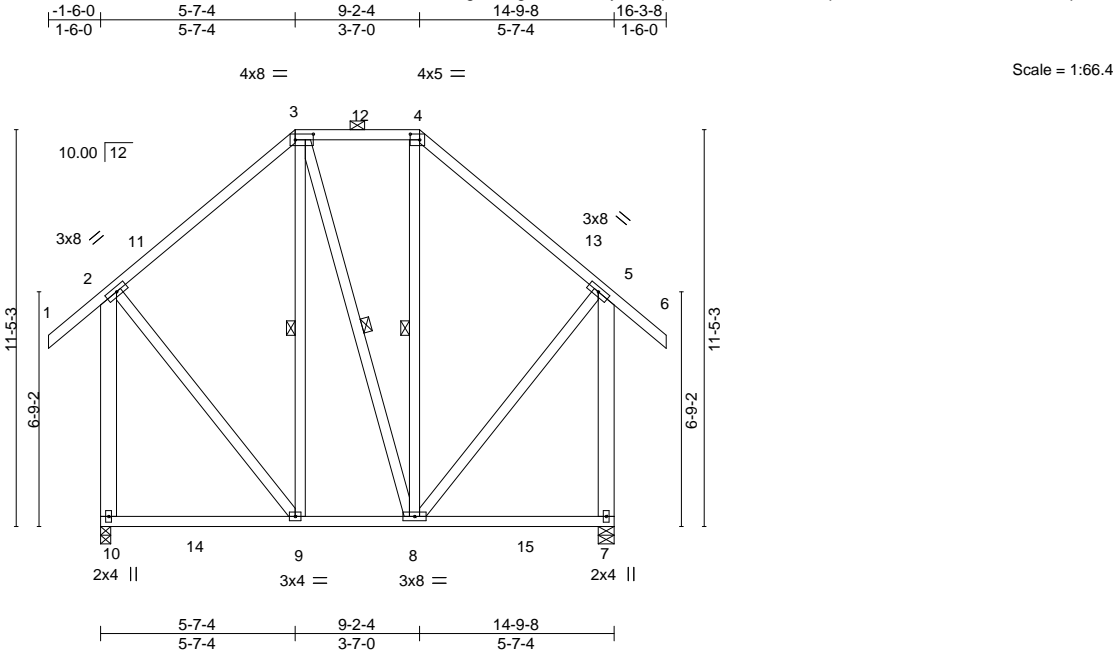


Plate Offsets (X,Y)-- [3:0-6-4,0-2-0], [4:0-3-4,0-2-0]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	20.0	Plate Grip DOL	1.25	TC	0.32	Vert(LL)	-0.04	9-10	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.27	Vert(CT)	-0.07	9-10	>999	180	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.21	Horz(CT)	-0.01	7	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS					Weight: 159 lb FT = 20%		

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 9-9-11 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 3-9, 3-8, 4-8
2-10,5-7: 2x6 SP No.2	
<b>REACTIONS.</b>	
(size) 10=0-3-8, 7=0-5-8	
Max Horz 10=-386(LC 10)	
Max Uplift 10=-180(LC 12), 7=-180(LC 13)	
Max Grav 10=751(LC 20), 7=751(LC 19)	
<b>FORCES.</b>	
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=-350/189, 4-5=-350/196, 2-10=-629/294, 5-7=-629/284	
BOT CHORD 9-10=-349/316, 8-9=-192/313	
WEBS 2-9=-151/364, 5-8=-152/364	

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 5-7-4, Zone3 5-7-4 to 9-2-4, Zone2 9-2-4 to 13-5-3, Zone1 13-5-3 to 16-3-8 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=180, 7=180.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T26G	Piggyback Base Supported Gable	1	1	T37036654
Job Reference (optional)					

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:43 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-JqeGINAyhvMj4WbGoW5c4cA1cUhbl9qaahHXhJzPu4o

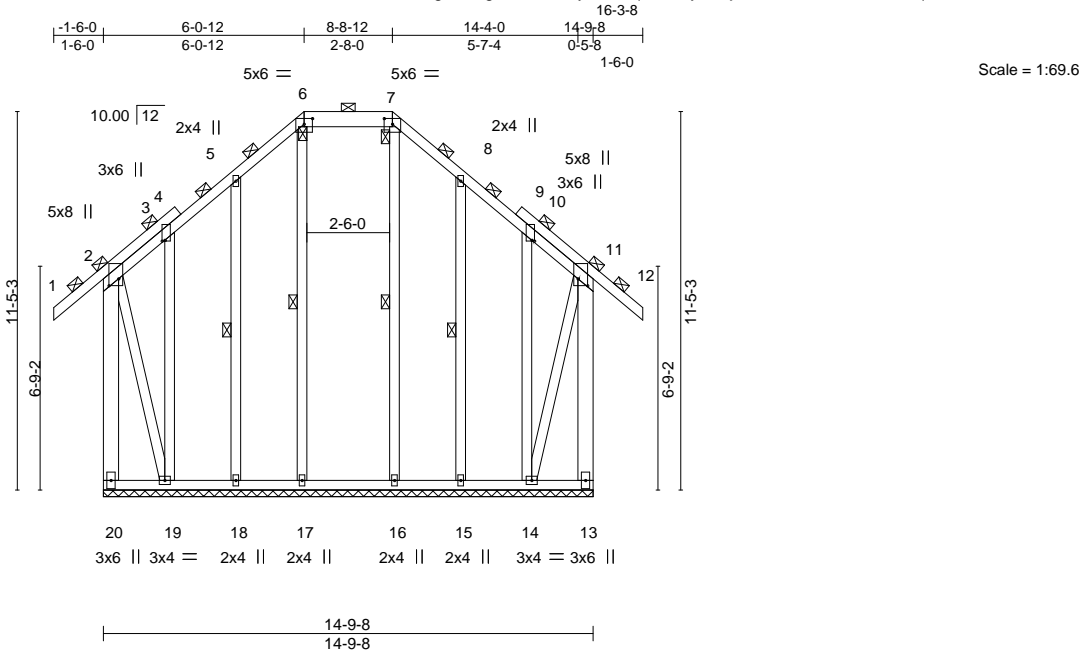


Plate Offsets (X,Y)--		[2:0-2-8,0-3-8], [3:0-0-5,0-1-0], [6:0-3-0,0-2-1], [7:0-3-0,0-2-1], [10:0-0-5,0-1-0], [11:0-2-8,0-3-8]					
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc) l/defl L/d
TCLL 20.0		Plate Grip DOL	1.25	TC 0.23		Vert(LL) -0.01	12 n/r 120
TCDL 10.0		Lumber DOL	1.25	BC 0.12		Vert(CT) -0.02	12 n/r 120
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.44		Horz(CT) -0.01	13 n/a n/a
BCDL 10.0		Code FBC2023/TPI2014		Matrix-S			
						<b>PLATES</b>	<b>GRIP</b>
						MT20	244/190
						Weight: 196 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 \*Except\*  
6-7: 2x6 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x6 SP No.2 \*Except\*  
2-19,11-14: 2x4 SP No.3  
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 8-15, 7-16, 5-18, 6-17

REACTIONS.

All bearings 14-9-8.  
(lb) - Max Horz 20=378(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 16, 17 except 20=480(LC 8),  
13=438(LC 9), 14=470(LC 8), 15=108(LC 13), 19=504(LC 9), 18=108(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 15, 18 except 20=539(LC 11),  
13=494(LC 10), 14=588(LC 11), 16=262(LC 21), 19=625(LC 10), 17=260(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-20=506/462, 5-6=121/308, 6-7=102/273, 7-8=122/309, 11-13=463/421  
BOT CHORD 19-20=345/314, 18-19=220/261, 17-18=220/261, 16-17=221/262, 15-16=221/261,  
14-15=221/261  
WEBS 2-19=539/517, 11-14=503/480

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 17 except (jt=lb) 20=480, 13=438, 14=470, 15=108, 19=504, 18=108.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T27	Piggyback Base Girder	1	2	T37036655

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:44 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-n1BeziBbSCUaigASLEdrcqjAAAtxT1YEjpL05DlzPu4n

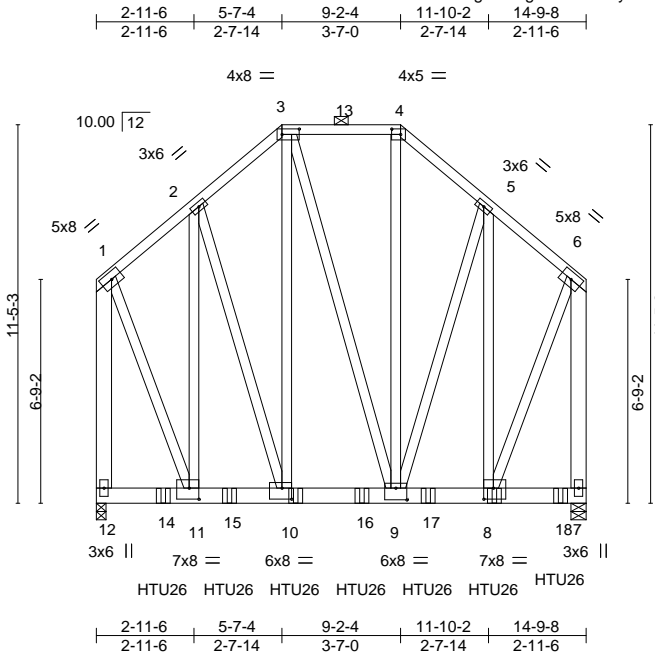


Plate Offsets (X,Y)--		[3:0-6-4,0-2-0], [4:0-3-4,0-2-0], [8:0-3-8,0-4-0], [9:0-4-0,0-4-4], [10:0-3-8,0-4-0], [11:0-3-8,0-4-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL 1.25		TC 0.37		Vert(LL) -0.04	9-10	>999	240	MT20	244/190
TCDL 10.0		Lumber DOL 1.25		BC 0.47		Vert(CT) -0.07	9-10	>999	180		
BCLL 0.0 *		Rep Stress Incr NO		WB 0.69		Horz(CT) 0.01	7	n/a	n/a		
BCDL 10.0		Code FBC2023/TPI2014		Matrix-MS						Weight: 424 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
1-12,6-7: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 12=0-3-8, 7=0-5-8  
Max Horz 12=-348(LC 4)  
Max Uplift 12=-1115(LC 8), 7=-1278(LC 9)  
Max Grav 12=4860(LC 2), 7=5605(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1871/493, 2-3=-2206/604, 3-4=-1689/494, 4-5=-2212/606, 5-6=-1868/491,  
1-12=-4510/1035, 6-7=-4491/1030  
BOT CHORD 11-12=-321/304, 10-11=-516/1388, 9-10=-533/1680, 8-9=-380/1384  
WEBS 2-11=-1208/359, 2-10=-346/932, 3-10=-390/1230, 4-9=-335/1247, 5-9=-354/972,  
5-8=-1246/366, 1-11=-834/3523, 6-8=-829/3502

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-6-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=1115, 7=1278.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-4 from the left end to 14-0-4 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

LOAD CASE(S) Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036655
4460945	T27	Piggyback Base Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:44 2025 Page 2  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-n1BeziBbSCUaigASLEdrcqjAAAtxT1YEjpL05DlzPu4n

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-3=-60, 3-4=-60, 4-6=-60, 7-12=-20

Concentrated Loads (lb)

Vert: 10=-1159(B) 8=-1159(B) 14=-1159(B) 15=-1159(B) 16=-1159(B) 17=-1159(B) 18=-1164(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036656
4460945	T28	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),Lake City, FL - 32055,


8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:44 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-n1BeziBbSCUaigASLEdrcqj7gtzx1hfjpL05DlzPu4n

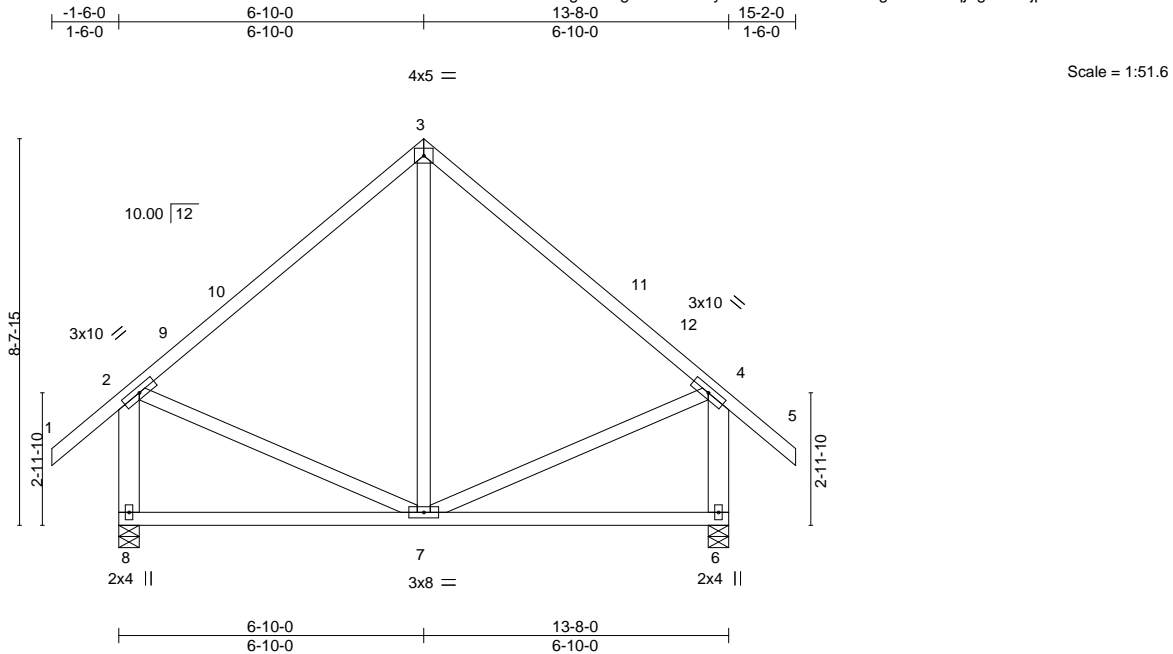

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036657
4460945	T28G	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:45 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-FDl1A2BDDWcRKqlfvx8491FNyHODm8Ms2?melBzPu4m



Scale = 1:50.8

Plate Offsets (X,Y)--		[2:0-4-12,0-1-8], [3:0-0-5,0-1-0], [7:0-3-0,Edge], [11:0-0-5,0-1-0], [12:0-4-12,0-1-8]											
LOADING (psf)		SPACING-	2-0-0		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL	20.0	Plate Grip DOL	1.25		TC	0.24	Vert(LL)	-0.01	13	n/r	120	MT20	244/190
TCDL	10.0	Lumber DOL	1.25		BC	0.05	Vert(CT)	-0.02	13	n/r	120		
BCLL	0.0 *	Rep Stress Incr	YES		WB	0.12	Horz(CT)	0.00	14	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014			Matrix-S							Weight: 129 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x6 SP No.2 \*Except\*  
2-20,12-15: 2x4 SP No.3  
OTHERS 2x4 SP No.3

#### BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

All bearings 13-8-0.  
(lb) - Max Horz 21=257(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 14, 18, 17 except 21=127(LC 8), 15=268(LC 13), 16=118(LC 13), 20=271(LC 12), 19=118(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 18, 16, 17, 19 except 21=290(LC 20), 14=257(LC 19), 15=251(LC 11), 20=281(LC 10)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-21=272/129  
BOT CHORD 19-20=138/276, 18-19=138/276, 17-18=138/276, 16-17=138/276, 15-16=138/276  
WEBS 2-20=208/390, 12-15=176/373

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 18, 17 except (jt=lb) 21=127, 15=268, 16=118, 20=271, 19=118.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T30	Roof Special	3	1	T37036659
Job Reference (optional)					

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:46 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-jPJPOOCr\_qllx\_KrTffJhFoT2hfQVZY0GfVClezPu4I

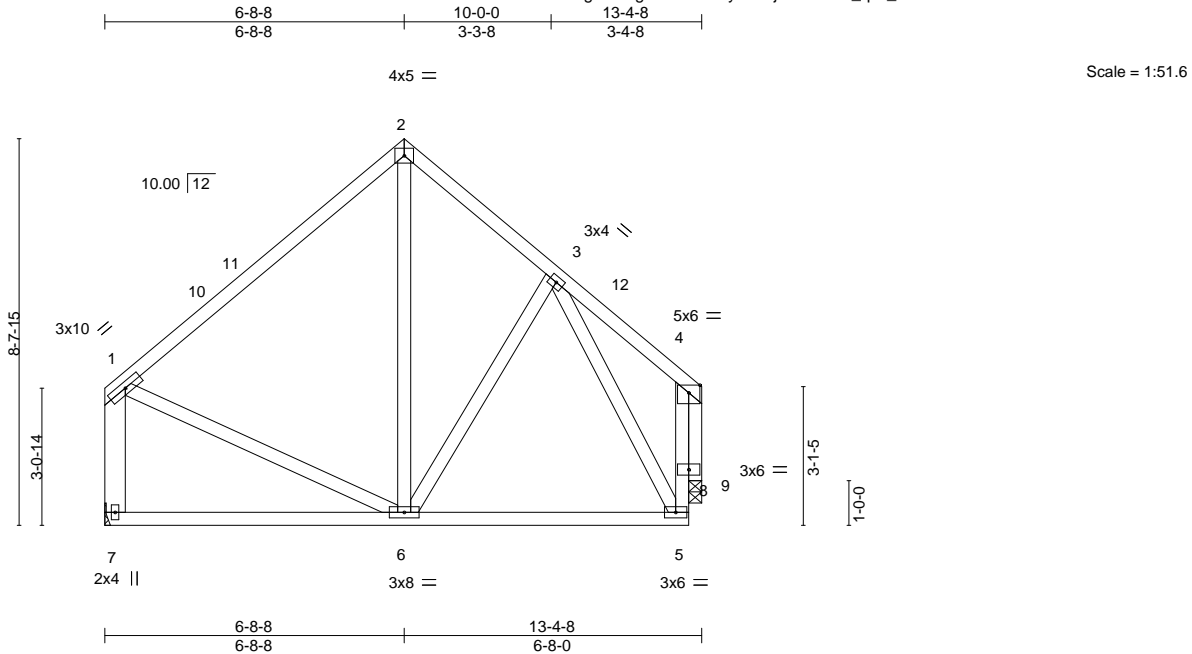

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.53	Vert(LL)	-0.04 6-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.37	Vert(CT)	-0.07 6-7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.25	Horz(CT)	0.01 9	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS					Weight: 99 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
1-7: 2x6 SP No.2  
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 7=Mechanical, 9=0-3-8  
Max Horz 7=-210(LC 10)  
Max Uplift 7=-107(LC 13), 9=-109(LC 12)  
Max Grav 7=520(LC 1), 9=497(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-421/165, 2-3=-344/207, 1-7=-461/204, 5-8=-82/363, 4-8=-82/363  
WEBS 3-5=-347/109, 4-9=-502/163

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-2-12 to 3-2-12, Zone1 3-2-12 to 6-8-8, Zone2 6-8-8 to 10-11-7, Zone1 10-11-7 to 12-11-4 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=107, 9=109.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	T31	Roof Special	1	1	T37036660
Job Reference (optional)					

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:47 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-BctnbkDTI7t9Z8v11MAYESLht5ssE?C9VJFIq4zPu4k

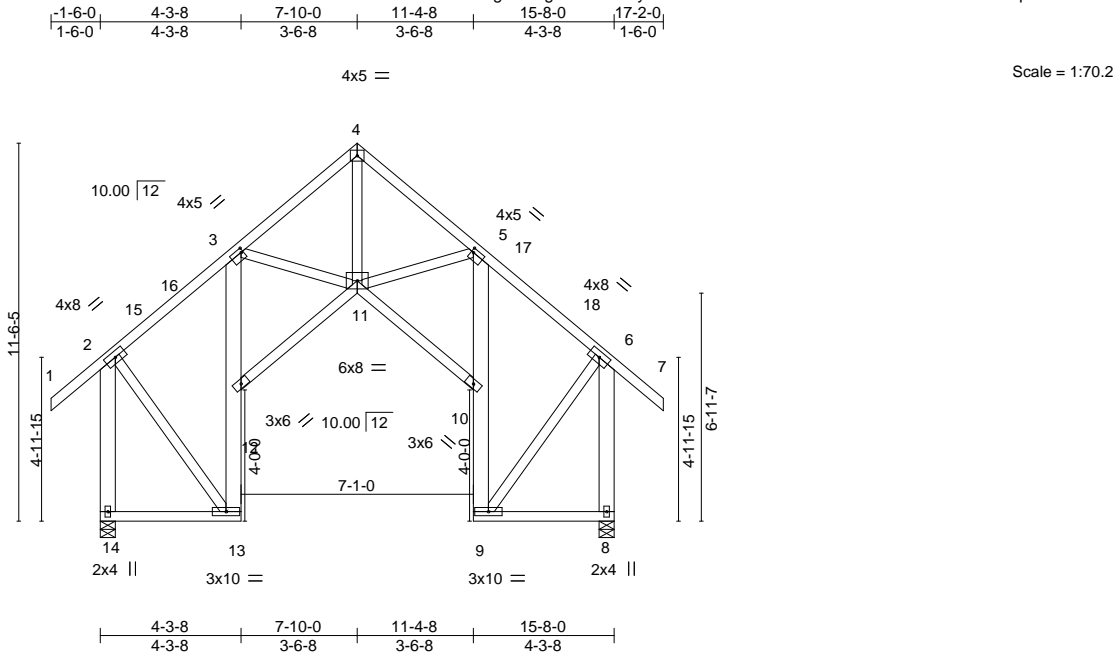


Plate Offsets (X,Y)--		[3:0-0-12,0-1-8], [5:0-0-12,0-1-8], [6:0-0-0,0-0-0]			
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc) l/defl L/d
TCLL 20.0	Plate Grip DOL	1.25	TC 0.34	Vert(LL)	0.22 11-12 >839 240
TCDL 10.0	Lumber DOL	1.25	BC 0.93	Vert(CT)	-0.29 11-12 >630 180
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.29	Horz(CT)	0.98 8 n/a n/a
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS		
				Weight: 156 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-11-9 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2 *Except*	BOT CHORD	
	3-13,5-9: 2x6 SP No.2		
WEBS	2x4 SP No.3 *Except*		
	2-14,6-8: 2x6 SP No.2		

REACTIONS. (size) 14=0-5-8, 8=0-5-8  
Max Horz 14=-368(LC 10)  
Max Uplift 14=-159(LC 12), 8=-159(LC 13)  
Max Grav 14=712(LC 1), 8=712(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-385/197, 3-4=-949/343, 4-5=-978/362, 5-6=-385/179, 2-14=-709/273, 6-8=-709/316  
BOT CHORD 13-14=-343/315, 12-13=-273/126, 3-12=-589/171, 11-12=-487/909, 10-11=-200/677, 5-10=-607/181  
WEBS 4-11=-377/977, 5-11=-239/338, 2-13=-85/390, 6-9=-61/370

- NOTES-
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 7-10-0, Zone2 7-10-0 to 12-0-14, Zone1 12-0-14 to 17-2-0 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=159, 8=159.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com





Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036661
4460945	T31G	Roof Special Structural Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:48 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlrfoR9o4E5WR?0BHUDa3hnmftuSVP6zSaJkz\_IMWzPu4j



Scale = 1:68.9

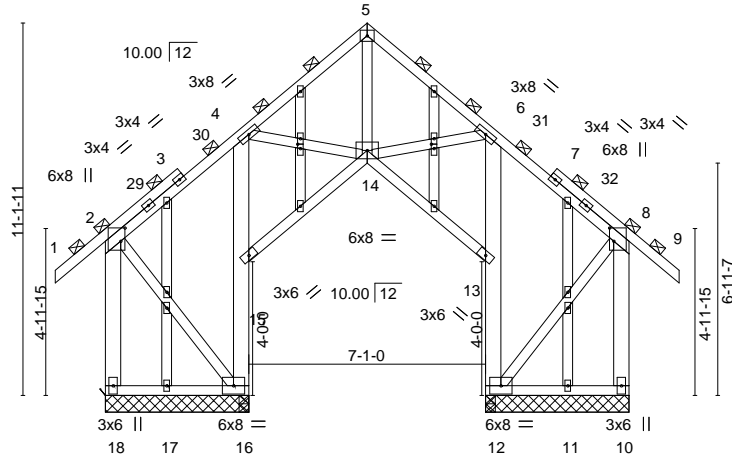

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.22	Vert(LL)	-0.01 14-15 >999 240	MT20		244/190	
TCDL	10.0	Lumber DOL	1.25	BC	0.10	Vert(CT)	-0.02 14-15 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.28	Horz(CT)	-0.03 10 n/a n/a				
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS							
								Weight: 187 lb		FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2 \*Except\*  
4-16,6-12: 2x6 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
2-18,8-10: 2x6 SP No.2  
OTHERS 2x4 SP No.3

#### BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

All bearings 4-3-8.  
(lb) - Max Horz 18=351(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 13, 12 except 18=523(LC 8),  
10=199(LC 8), 16=464(LC 9)  
Max Grav All reactions 250 lb or less at joint(s) 12, 12, 17, 11 except 18=614(LC 11), 13=418(LC 1), 10=355(LC 20), 16=760(LC 19), 16=432(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-341/350, 4-5=-261/129, 5-6=-258/111, 6-8=-233/307, 2-18=-595/592,  
8-10=-352/342  
BOT CHORD 17-18=-325/291, 16-17=-325/291, 15-16=-481/139, 4-15=-461/171, 6-13=-377/112  
WEBS 4-14=-97/262, 6-14=-122/278, 2-16=-440/485

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 7-10-0, Zone2 7-10-0 to 12-0-14, Zone1 12-0-14 to 17-2-0 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- N/A
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 13 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13, 12 except (jt=lb) 18=523, 10=199, 16=464.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036663
4460945	T33	Common Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:49 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-7\_?X0QEjGI7toR3Q8nC0JtQ3dujigqnSzdksvyyzPu4i

-1-6-0, 4-4-0, 8-6-0, 12-8-0, 16-10-0, 20-4-0

1-6-0, 4-4-0, 4-2-0, 4-2-0, 4-2-0, 3-6-0

4x5 ||

Scale = 1:76.3

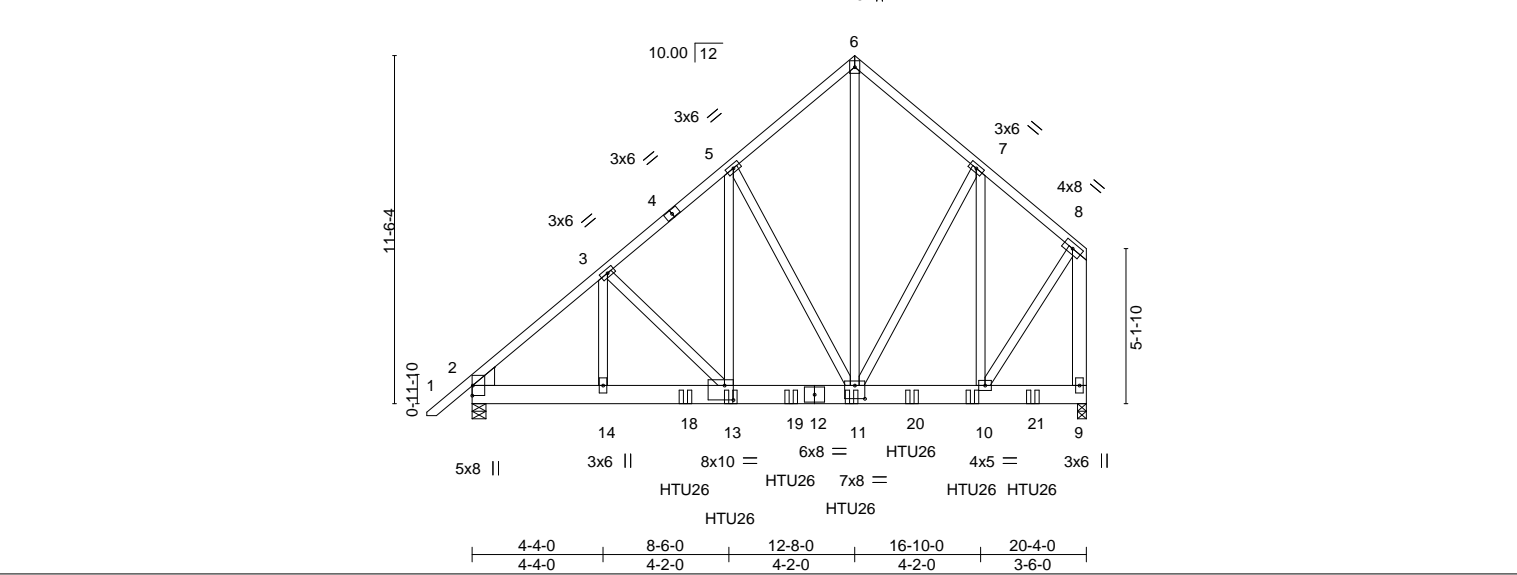


Plate Offsets (X,Y)-- [11:0-4-0,0-5-4], [13:0-3-8,0-5-12]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	20.0	Plate Grip DOL	1.25	TC	0.19	Vert(LL)	-0.05 13-14	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.21	Vert(CT)	-0.10 13-14	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.60	Horz(CT)	0.01 9	n/a	n/a		
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS						Weight: 402 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x8 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 8-9: 2x6 SP No.2	
WEDGE Left: 2x8 SP 2400F 2.0E	

REACTIONS.	(size) 2=0-5-8, 9=0-3-8
	Max Horz 2=309(LC 8)
	Max Uplift 2=-841(LC 8), 9=-745(LC 8)
	Max Grav 2=3053(LC 2), 9=4101(LC 2)
FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-3893/1097, 3-5=-3701/988, 5-6=-2477/628, 6-7=-2472/633, 7-8=-2125/432, 8-9=-3707/718
BOT CHORD	2-14=-1022/2929, 13-14=-1022/2929, 11-13=-810/2809, 10-11=-297/1590
WEBS	3-13=-268/297, 5-13=-877/2313, 5-11=-1986/889, 6-11=-693/2869, 7-11=-236/581, 8-10=-517/2772, 7-10=-884/331

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-7-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=-841, 9=745.
  - Use Simpson Strong-Tie HTU26 (10-10d Girder, 14-10dx1 1/2 Truss) or equivalent at 7-0-12 from the left end to connect truss(es) to front face of bottom chord.
  - Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 8-6-12 from the left end to 18-6-12 to connect truss(es) to front face of bottom chord.
  - Continue on page 2 where hanger is in contact with lumber.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036663
4460945	T33	Common Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:49 2025 Page 2  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-7\_?X0QEjGI7toR3Q8nC0JtQ3dujgqnSzdksvyzPu4i

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-6=-60, 6-8=-60, 9-15=-20

Concentrated Loads (lb)

Vert: 13=-608(F) 11=-608(F) 10=-608(F) 18=-1385(F) 19=-608(F) 20=-608(F) 21=-608(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036664
4460945	T34	Scissor	3	1		

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:50 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-bBZwDmFL12FkQbdcUkFs4z87I?gRJHbBHTPRPzPu4h



Scale = 1:51.4

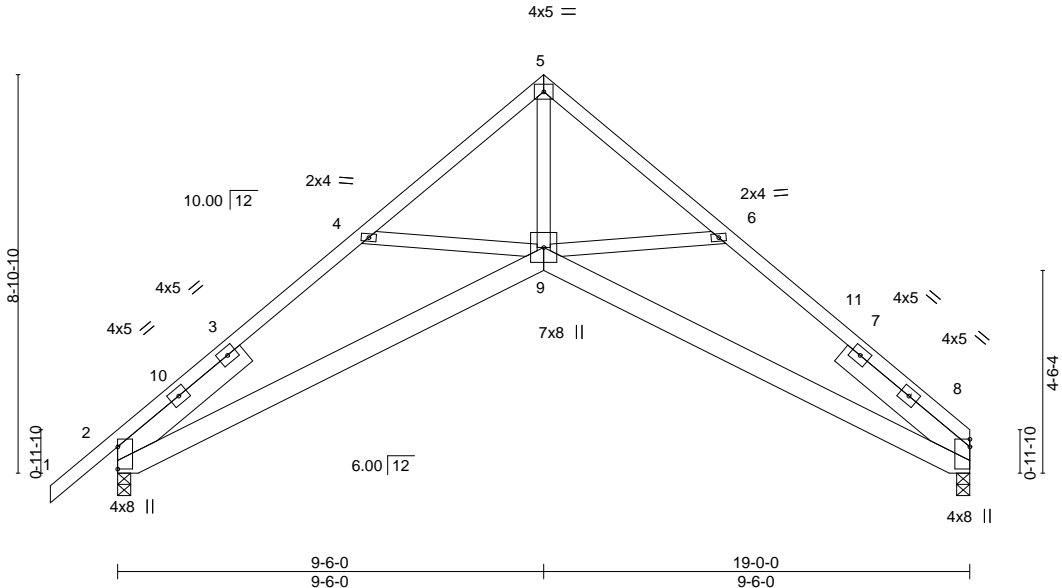


Plate Offsets (X,Y)--		[2:Edge,0-0-0], [8:Edge,0-0-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.59	Vert(LL)	0.11	2-9	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.41	Vert(CT)	-0.19	8-9	>999	180	
BCLL	0.0 *	Rep Stress Incr YES		WB	0.46	Horz(CT)	0.17	8	n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-S							Weight: 125 lb FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x6 SP No.2 3-8-13, Right 2x6 SP No.2 3-8-13

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-9-1 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
Max Horz 2=222(LC 9)  
Max Uplift 2=198(LC 12), 8=153(LC 13)  
Max Grav 2=851(LC 1), 8=739(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1529/526, 4-5=-1220/414, 5-6=-1222/433, 6-8=-1539/539  
BOT CHORD 2-9=-410/1187, 8-9=-284/1182  
WEBS 5-9=-438/1210, 6-9=-225/307, 4-9=-181/266

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 9-6-0, Zone2 9-6-0 to 13-7-5, Zone1 13-7-5 to 18-9-9 zone; end vertical left and right exposed; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 6) Bearing at joint(s) 2, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=198, 8=153.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036665
4460945	T34G	Scissor	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:51 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLIr-4N7IR6G\_oMNB2lCoGCFUOIVFsiLZ9lDIQxDzzrPu4g




Plate Offsets (X,Y)--	[2:0-3-0,0-2-0]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.85	Vert(LL)	-0.09 8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.44	Vert(CT)	-0.17 8-24	>999	180	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.54	Horz(CT)	0.20 7	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS					Weight: 145 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* 1-3: 2x4 SP No.1	TOP CHORD 2-0-0 oc purlins (3-9-12 max.).
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 7=0-5-8  
Max Horz 2=208(LC 11)  
Max Uplift 2=-198(LC 12), 7=-156(LC 13)  
Max Grav 2=844(LC 1), 7=752(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1750/704, 4-5=-1397/483, 5-6=-1406/509, 6-7=-1800/698  
BOT CHORD 2-8=-505/1502, 7-8=-456/1483  
WEBS 5-8=-534/1428, 6-8=-323/339, 4-8=-325/318

- NOTES-
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 9-6-0, Zone2 9-6-0 to 13-8-14, Zone1 13-8-14 to 18-9-4 zone; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - All plates are MT20 plates unless otherwise indicated.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Bearing at joint(s) 2, 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=198, 7=156.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036666
4460945	T35	Scissor	4	1		

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:51 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-4N7IR6G\_oMNB2iCoGCFUOIvLCiLR9mBIQxDzzrPu4g



Scale = 1:54.7

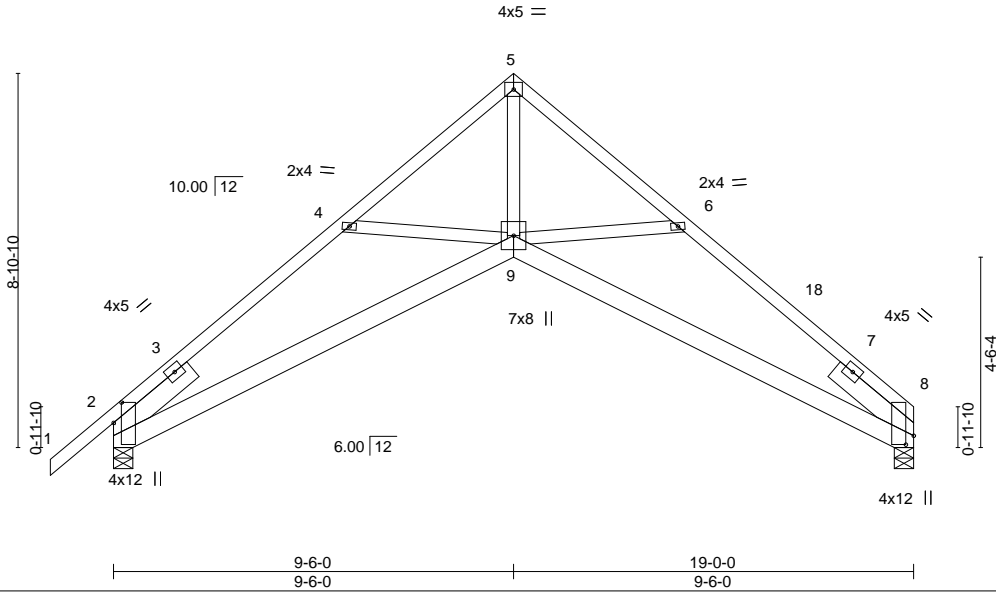


Plate Offsets (X,Y)--		[2:0-5-13,0-2-4], [8:0-2-9,0-2-4]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.51	Vert(LL)	-0.09	9	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.44	Vert(CT)	-0.17	9	>999	180	
BCLL	0.0 *	Rep Stress Incr YES		WB	0.48	Horz(CT)	0.19	8	n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS							Weight: 119 lb FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x6 SP No.2 2-5-8, Right 2x6 SP No.2 2-5-8

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-10-5 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 8=0-5-8, 2=0-5-8  
Max Horz 2=216(LC 11)  
Max Uplift 8=-157(LC 13), 2=-196(LC 12)  
Max Grav 8=756(LC 1), 2=854(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1552/430, 4-5=-1253/269, 5-6=-1271/296, 6-8=-1560/351  
BOT CHORD 2-9=-402/1377, 8-9=-227/1272  
WEBS 5-9=-264/1274, 6-9=-279/289, 4-9=-248/267

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 9-6-0, Zone2 9-6-0 to 13-7-5, Zone1 13-7-5 to 19-0-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Bearing at joint(s) 8, 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=157, 2=196.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036667
4460945	T36	Scissor	4	1		
Job Reference (optional)						

Builders FirstSource (Lake City,FL),Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:52 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-YZggeSHcZgVSfvn?pvmixV2Vw6g5uDgufbyWVHzPu4f



Scale = 1:54.7

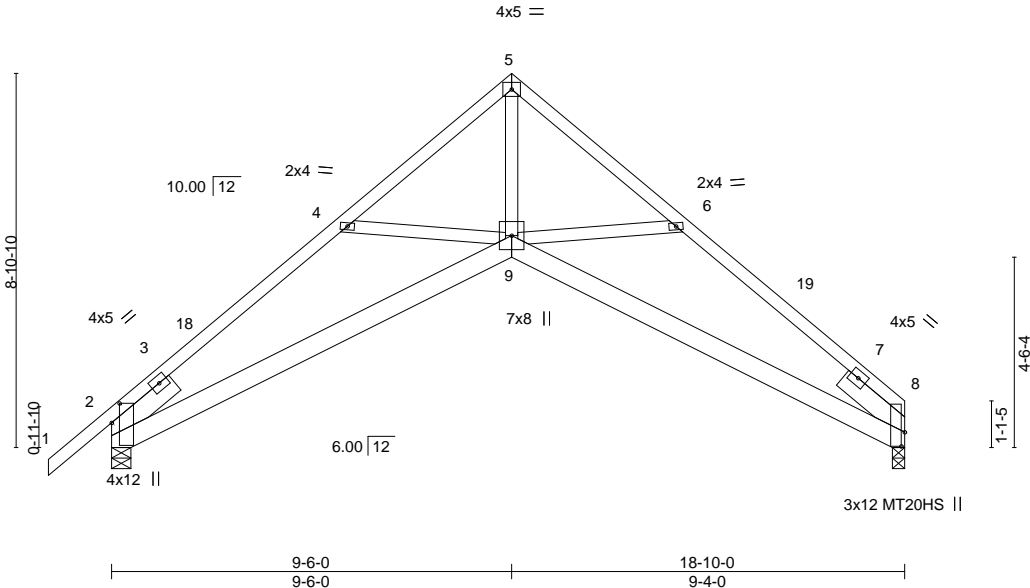


Plate Offsets (X,Y)--		[2:0-5-9,0-2-4], [8:0-4-1,0-1-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	20.0	Plate Grip DOL 1.25		TC	0.57	Vert(LL)	-0.10	9	>999	240	MT20 244/190
TCDL	10.0	Lumber DOL 1.25		BC	0.48	Vert(CT)	-0.18	9	>999	180	MT20HS 187/143
BCLL	0.0 *	Rep Stress Incr YES		WB	0.47	Horz(CT)	0.22	8	n/a	n/a	
BCDL	10.0	Code FBC2023/TPI2014		Matrix-MS							Weight: 116 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3  
SLIDER Left 2x6 SP No.2 1-11-8, Right 2x6 SP No.2 1-11-8

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-8-4 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 8=0-3-8, 2=0-5-8  
Max Horz 2=216(LC 9)  
Max Uplift 8=155(LC 13), 2=194(LC 12)  
Max Grav 8=750(LC 1), 2=847(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1547/430, 4-5=-1226/267, 5-6=-1225/294, 6-8=-1533/348  
BOT CHORD 2-9=-406/1362, 8-9=-225/1233  
WEBS 4-9=-259/270, 5-9=-261/1238, 6-9=-270/286

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 9-6-0, Zone2 9-6-0 to 13-7-5, Zone1 13-7-5 to 18-10-0 zone; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 8, 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=155, 2=194.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036668
4460945	T37	Common Girder	1	2	Job Reference (optional)	

**LOAD CASE(S)** Standard  
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-60, 4-7=-60, 11-15=-20  
Concentrated Loads (lb)  
Vert: 11=-636(B) 18=-1389(B) 19=-628(B) 20=-628(B) 21=-628(B) 22=-628(B) 23=-628(B)


 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036669
4460945	T38	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:53 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-0lE2snlEKzdJH3MBNdhYtjafW6VdnO2tFi32kzPu4e

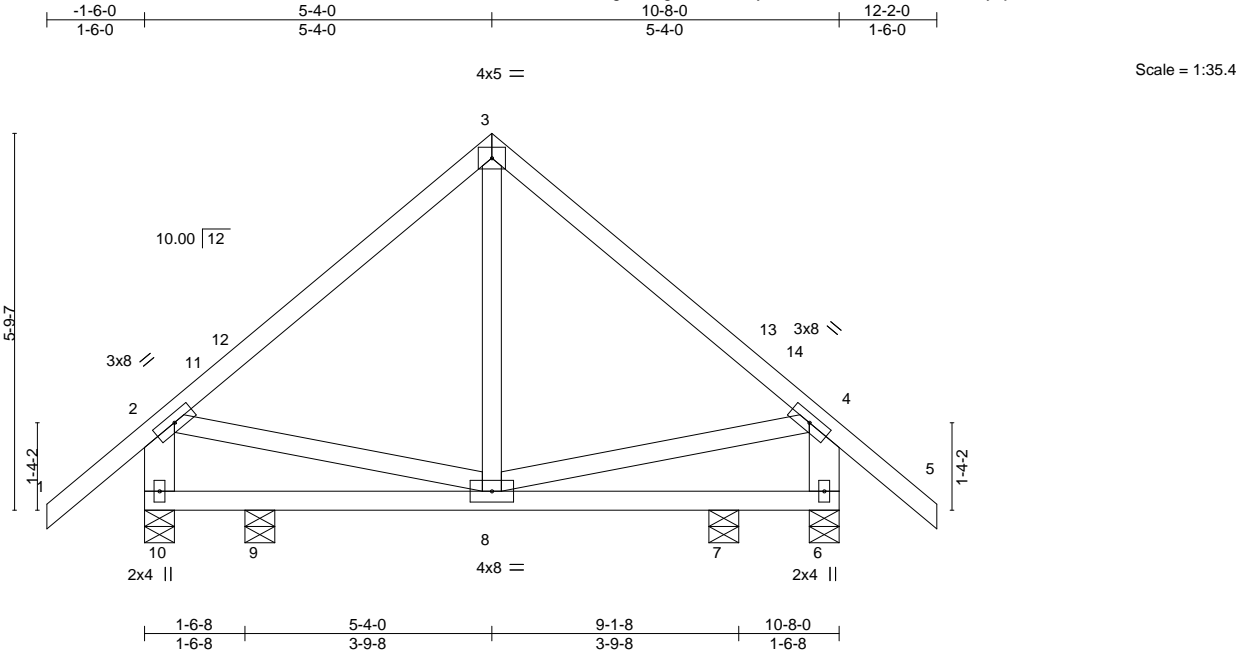

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.32	Vert(LL)	-0.00	8-9	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.09	Vert(CT)	-0.01	8-9	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	6	n/a		
BCDL 10.0	Code FBC2023/TP12014		Matrix-MS					Weight: 70 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
2-10,4-6: 2x6 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

All bearings 0-5-8.  
(lb) - Max Horz 10=-184(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 9 except 10=-139(LC 12), 6=-140(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 9, 7 except 10=445(LC 1), 6=445(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-332/166, 3-4=-332/166, 2-10=-444/300, 4-6=-444/300

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 5-4-0, Zone2 5-4-0 to 9-6-15, Zone1 9-6-15 to 12-2-0 zone; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9 except (jt=lb) 10=139, 6=140.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036670
4460945	T38G	GABLE	1	1		

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:54 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-UyoQ37Is5HI9vCxNxKoB0w7vCvQRMD6B6vRdaAzPu4d



4x5 = Scale = 1:33.9

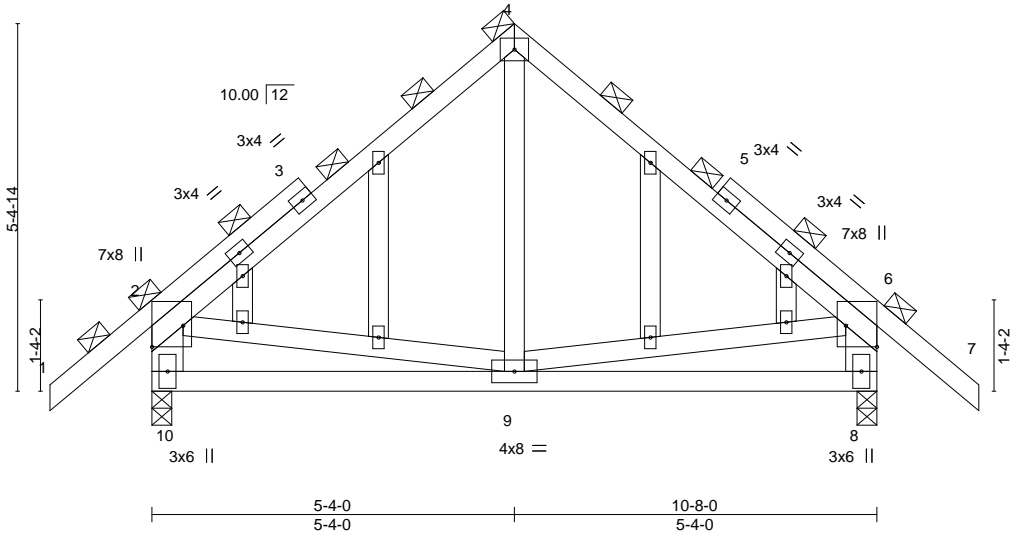


Plate Offsets (X,Y)--		[2:Edge,0-5-8], [6:Edge,0-5-8]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	20.0	Plate Grip DOL	1.25	TC	0.27	Vert(LL)	-0.01 9-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.23	Vert(CT)	-0.03 9-10	>999	180		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.00 8	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS						Weight: 87 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.), except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	
2-10,6-8: 2x6 SP No.2	
OTHERS 2x4 SP No.3	

REACTIONS. (size) 10=0-3-8, 8=0-3-8  
Max Horz 10=-131(LC 10)  
Max Uplift 10=-126(LC 12), 8=-126(LC 13)  
Max Grav 10=512(LC 1), 8=512(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-380/300, 4-6=-380/300, 2-10=-466/408, 6-8=-466/408  
BOT CHORD 9-10=-210/270

- NOTES-
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 5) All plates are 2x4 MT20 unless otherwise indicated.
  - 6) Gable studs spaced at 2-0-0 oc.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=126, 8=126.
  - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com




Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036671
4460945	T39	Common	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:54 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-UyoQ37Is5HI9vCxNxKoB0w7uDvQtMEUB6vRdaAzPu4d

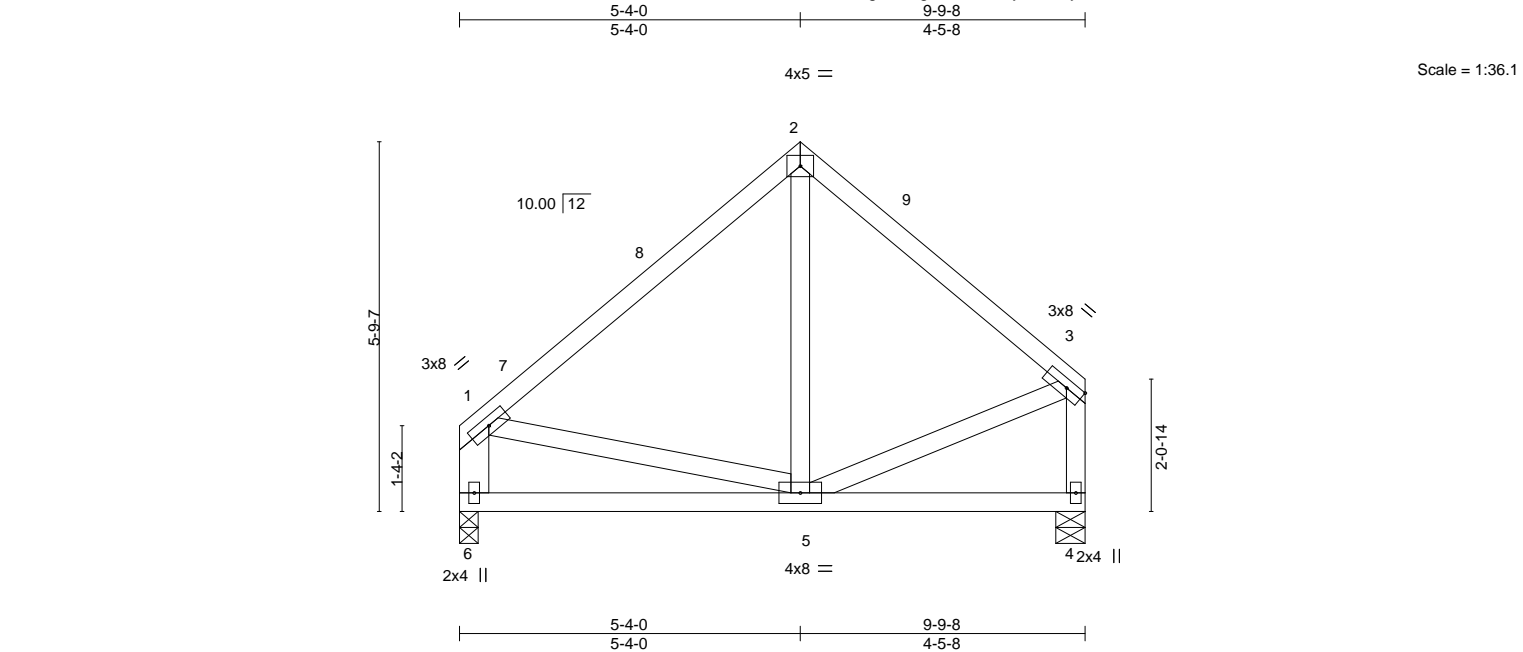

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.33	Vert(LL)	-0.02	5-6	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.20	Vert(CT)	-0.04	5-6	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	-0.00	4	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MS						
								Weight: 60 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
1-6: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=0-3-8, 4=0-5-8  
Max Horz 6=157(LC 9)  
Max Uplift 6=-75(LC 12), 4=-81(LC 12)  
Max Grav 6=377(LC 1), 4=377(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-337/259, 2-3=-316/249, 1-6=-327/269, 3-4=-343/271

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-2-12 to 3-2-12, Zone1 3-2-12 to 5-4-0, Zone3 5-4-0 to 9-7-12 zone; end vertical left and right exposed; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 4.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036672
4460945	T40	Monopitch	6	1		
Job Reference (optional)						

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:55 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLIr-y8MpGTJUSbt0WMWwV2JQZ8gz0Jfs5dYLLZBA6czPu4c



Scale = 1:21.7

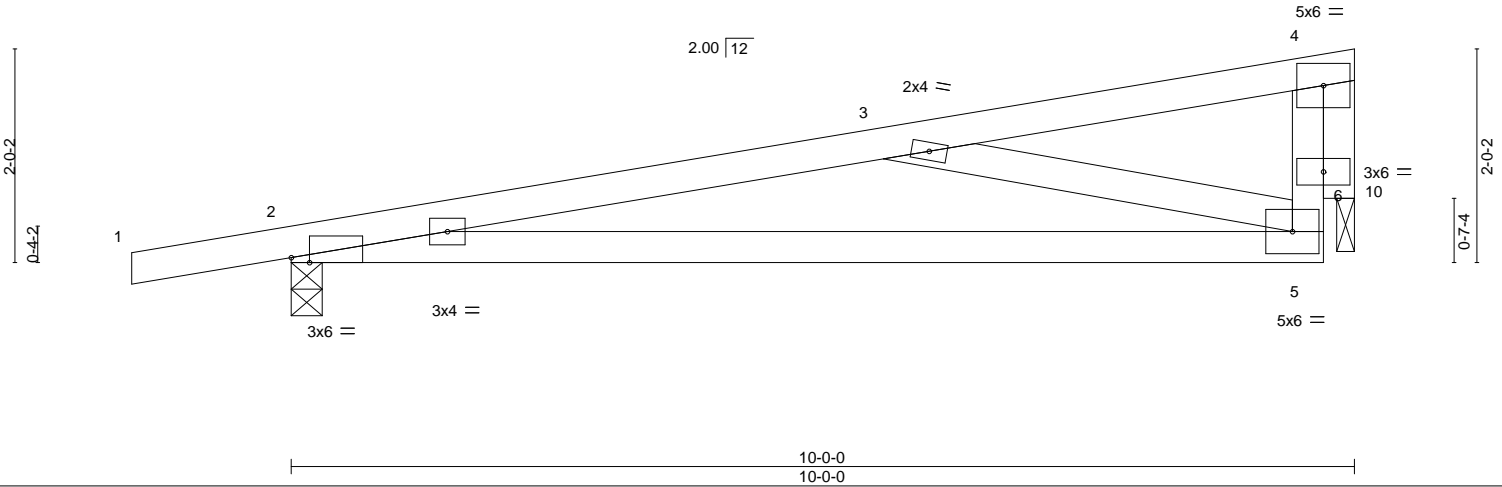


Plate Offsets (X,Y)--		[2:0-2-1,Edge]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.65		Vert(LL)	0.19 5-9	>636	240	MT20	244/190
TCDL 10.0		Lumber DOL	1.25	BC 0.67		Vert(CT)	-0.33 5-9	>363	180		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.27		Horz(CT)	0.01 10	n/a	n/a		
BCDL 10.0		Code FBC2023/TPI2014		Matrix-MS						Weight: 41 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-4 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-9-3 oc bracing.

REACTIONS.

(size) 2=0-3-8, 10=0-2-0  
Max Horz 2=74(LC 8)  
Max Uplift 2=275(LC 8), 10=197(LC 8)  
Max Grav 2=493(LC 1), 10=362(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-1002/621, 5-6=-210/295, 4-6=-210/295  
BOT CHORD 2-5=-665/984  
WEBS 3-5=-860/576, 4-10=-381/259

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-5-10, Zone1 1-5-10 to 9-6-12 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 10.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=275, 10=197.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	TG01	Flat Girder	1	1	T37036673
Builders FirstSource (Lake City,FL), Lake City, FL - 32055,					Job Reference (optional)

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:55 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-y8MpGTJUsbt0WMWav2JQZ8g0gJgR5hILLZBA6czPu4c

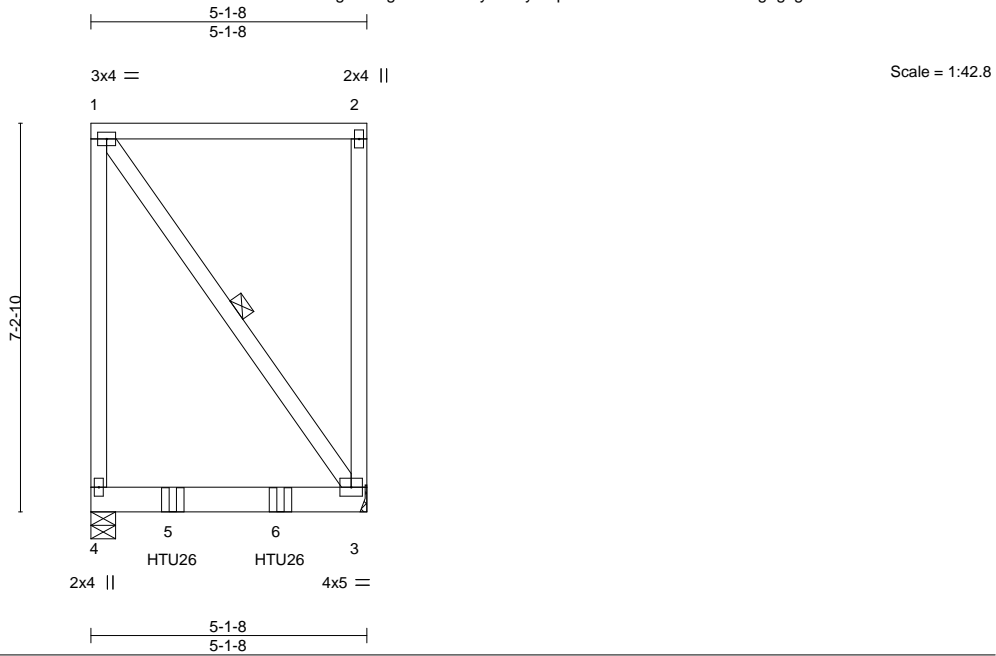

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.48	Vert(LL)	0.05	3-4	>999	240	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.63	Vert(CT)	-0.08	3-4	>737	180	244/190
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MP						
Weight: 51 lb									FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.2  
WEBS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-1-8 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 1-3

**REACTIONS.** (size) 4=0-5-8, 3=Mechanical  
Max Uplift 4=264(LC 4), 3=259(LC 4)  
Max Grav 4=498(LC 2), 3=487(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 4=264, 3=259.
- 9) Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 1-6-4 from the left end to 3-6-4 to connect truss(es) to back face of bottom chord.
- 10) Fill all nail holes where hanger is in contact with lumber.
- 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-2=-60, 3-4=-20  
Concentrated Loads (lb)  
Vert: 5=-272(B) 6=-272(B)

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036674
4460945	V01	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:56 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-QKwBUpK6du?t8W5m2lqf5LCHQj8cq7DUaDwje2zPu4b

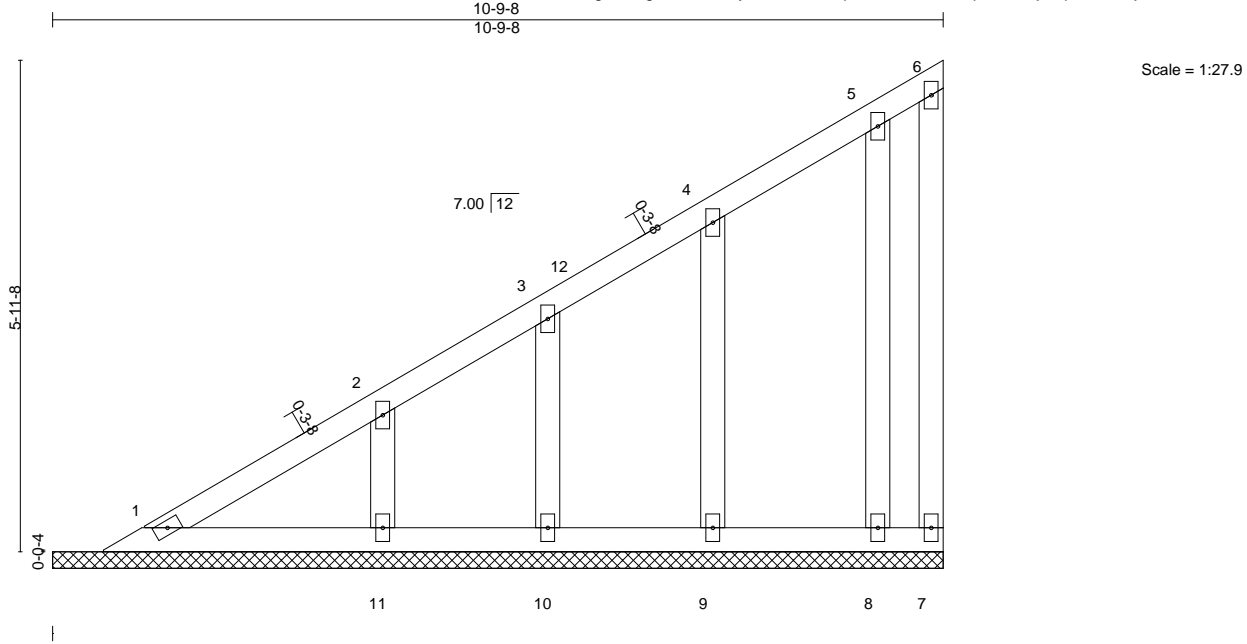

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.09	Vert(LL)	n/a	-	n/a	MT20	244/190
BCDL 10.0	Lumber DOL	1.25	BC 0.06	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	7	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S					Weight: 59 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 10-9-8.  
(lb) - Max Horz 1=186(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 7, 10, 9, 8 except 11=113(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 7, 10, 9, 8 except 11=250(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 1-1-7 to 4-0-0, Zone1 4-0-0 to 10-7-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 10, 9, 8 except (jt=lb) 11=113.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036675
4460945	V02	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:56 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-QKwBUpK6du?t8W5m2lqf5LCG9j7lq6bUaDwje2zPu4b

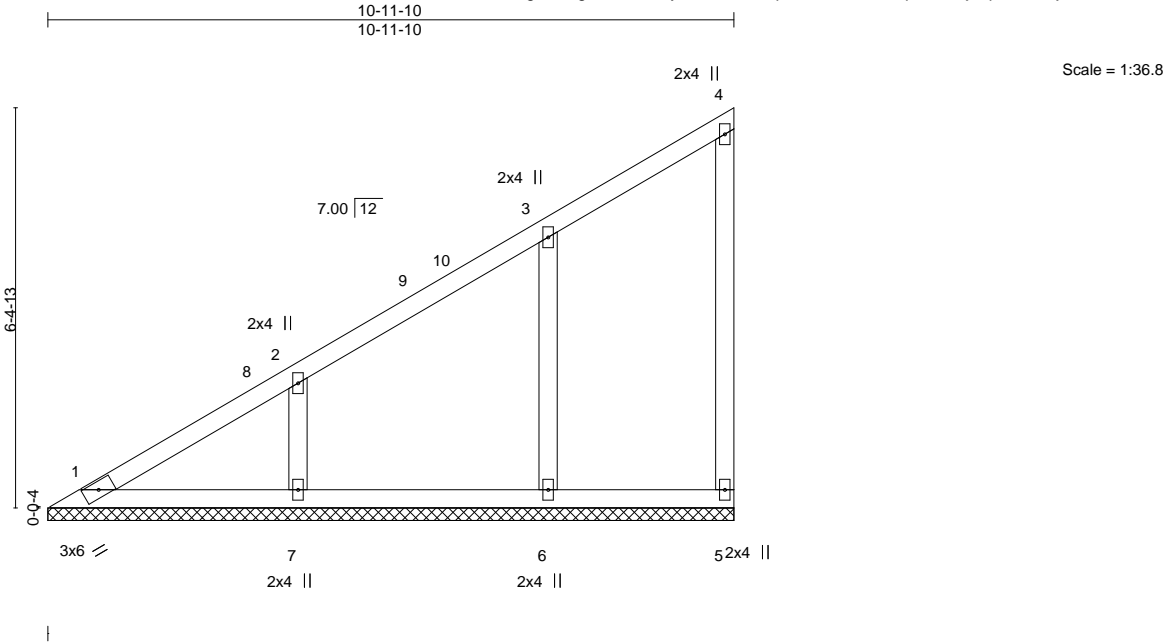

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.17	Vert(LL)	n/a	-	n/a	999	MT20 244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.11	Vert(CT)	n/a	-	n/a	999	
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	5	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S						Weight: 52 lb FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 10-11-10.  
(lb) - Max Horz 1=199(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 5, 6 except 7=153(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=417(LC 19), 6=389(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 2-7=-267/172

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-6-8, Zone1 3-6-8 to 10-9-14 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 6 except (jt=lb) 7=153.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036676
4460945	V03	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:57 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-uXUZh9LkOC7kmggycSMueZIRv7SYZYOdotgHBVzPu4a

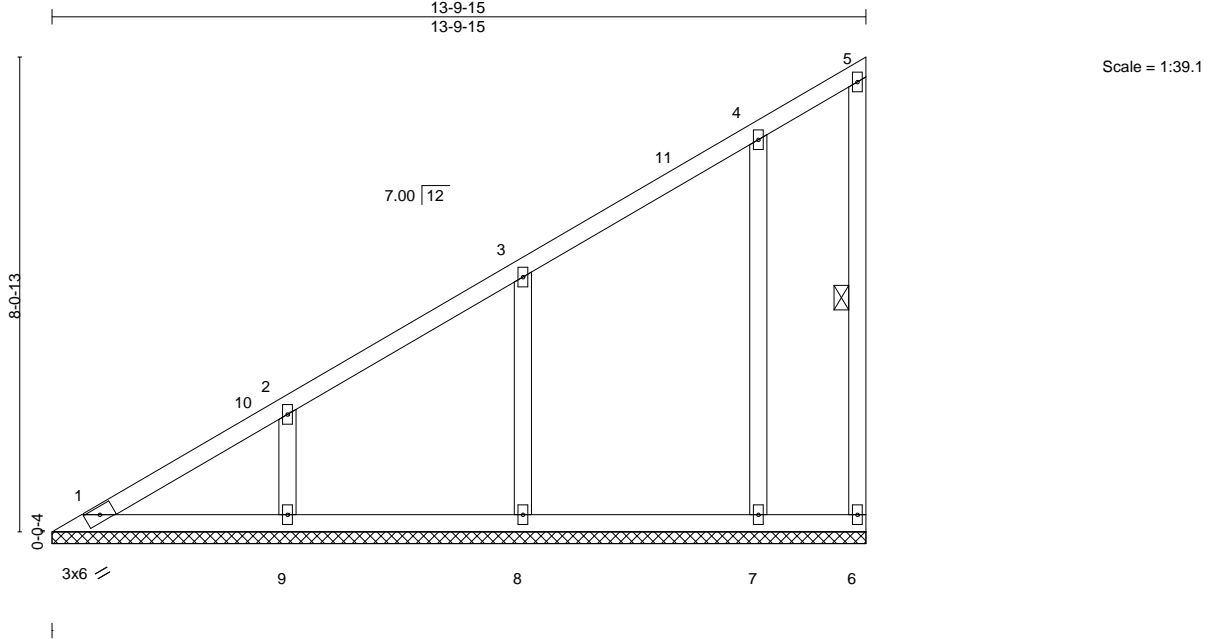

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.17	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.14	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.18	Horz(CT)	-0.00	6	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S					Weight: 73 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 5-6
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 13-9-15.  
(lb) - Max Horz 1=296(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 6 except 9=154(LC 12), 8=154(LC 12), 7=122(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 6 except 9=404(LC 19), 8=439(LC 19), 7=372(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-311/201  
WEBS 2-9=-260/173, 3-8=-264/180

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-6-8, Zone1 3-6-8 to 13-8-3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6 except (jt=lb) 9=154, 8=154, 7=122.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com




Job	Truss	Truss Type	Qty	Ply	JONES RES.	T37036677
4460945	V04	Valley	1	1		
Job Reference (optional)						

Builders FirstSource (Lake City,FL),Lake City, FL - 32055,

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:57 2025 Page 1

ID:7CvAcxg5dm4g2lcSLITv78yDLlr-uXUZh9LkOC7kmggycSMueZIRo7S4ZXcdotgHBVzPu4a

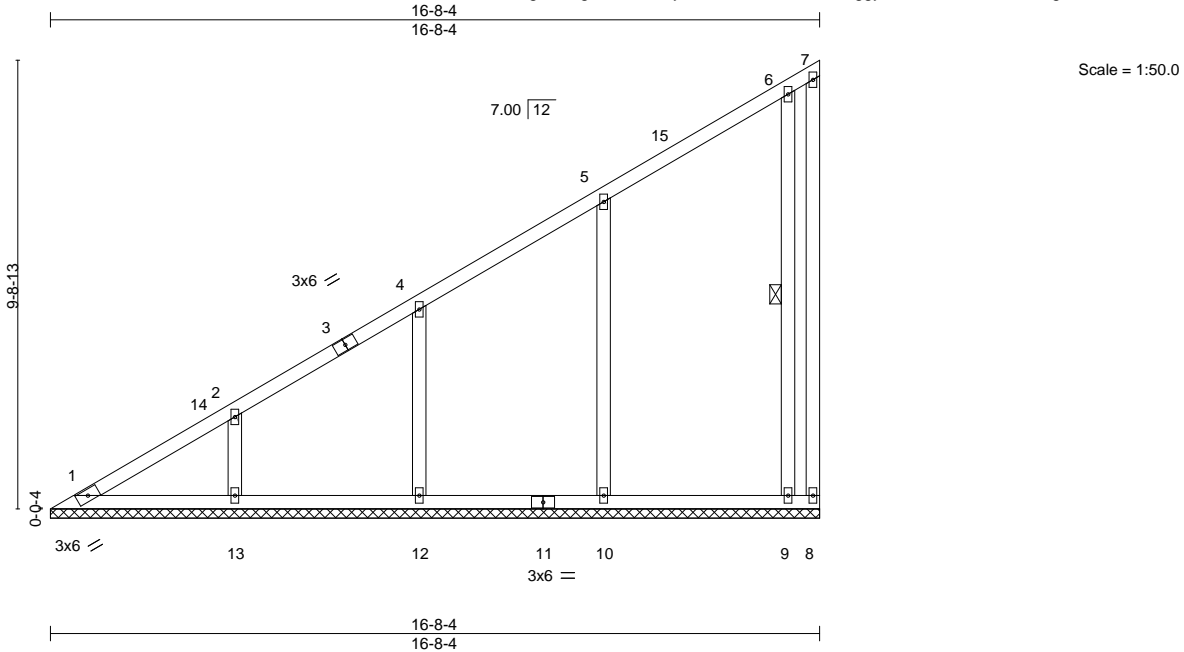

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.18	Vert(LL)	n/a	-	n/a	999	MT20
TCDL 10.0	Lumber DOL	1.25	BC 0.17	Vert(CT)	n/a	-	n/a	999	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.23	Horz(CT)	-0.00	8	n/a	n/a	
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S						
									Weight: 98 lb FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 6-9
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 16-8-4.  
(lb) - Max Horz 1=360(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) except 8=-159(LC 19), 13=-156(LC 12), 12=-146(LC 12), 10=-159(LC 12), 9=-116(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 8, 1 except 13=409(LC 19), 12=418(LC 19), 10=478(LC 19), 9=425(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-385/231, 2-4=-282/171  
WEBS 2-13=-263/175, 4-12=-251/171, 5-10=-270/183

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-6-8, Zone1 3-6-8 to 16-6-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 159 lb uplift at joint 8, 156 lb uplift at joint 13, 146 lb uplift at joint 12, 159 lb uplift at joint 10 and 116 lb uplift at joint 9.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	V05	Valley	1	1	T37036678
Job Reference (optional)					

Builders FirstSource (Lake City,FL),
Lake City, FL - 32055,

8.830 s Apr 11 2025
MiTek Industries, Inc.
Thu Apr 17 07:08:58 2025
Page 1
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-Mj2xvVLN9WFbOqF8AAAt7AmlcXoPl\_3n1XPqjxzPu4Z

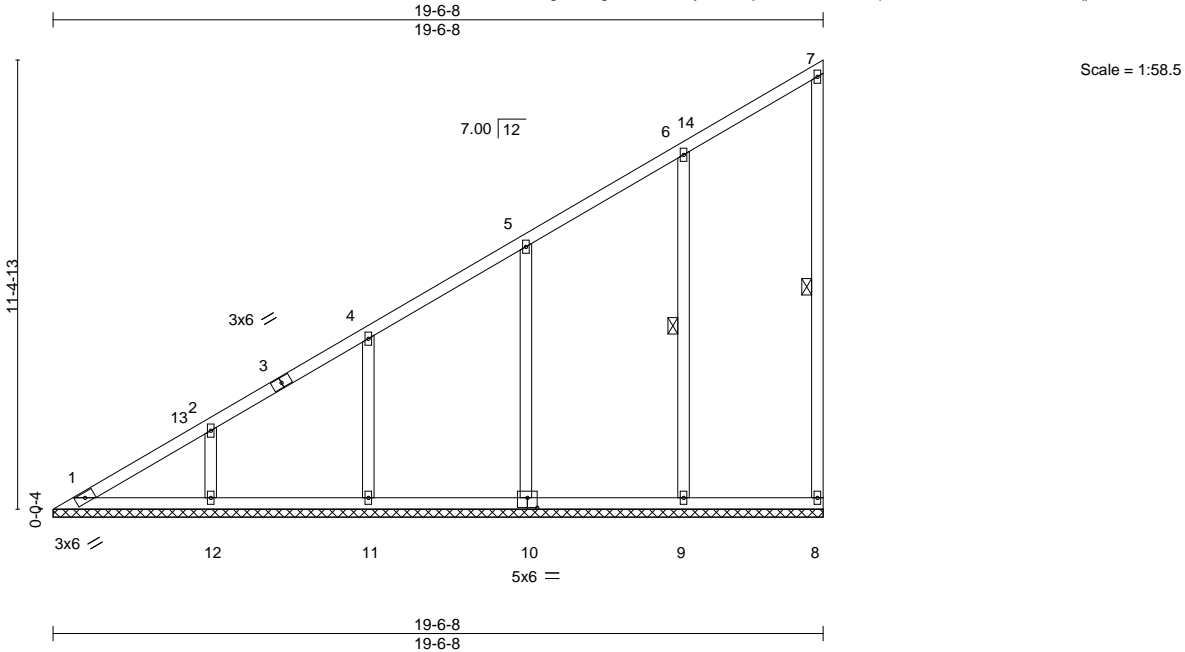


Plate Offsets (X,Y)--	[10:0-3-0,0-3-0]									
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.25	TC 0.17	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.17	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.22	Horz(CT)	0.00	8	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S						Weight: 109 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 7-8, 6-9
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 19-6-8.

(lb) - Max Horz 1=425(LC 12)

Max Uplift All uplift 100 lb or less at joint(s) 8, 1 except 12=156(LC 12), 11=148(LC 12), 10=150(LC 12), 9=150(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 8, 1 except 12=408(LC 19), 11=424(LC 19), 10=460(LC 19), 9=459(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-459/257, 2-4=-356/201, 4-5=-252/146

WEBS 2-12=-263/175, 4-11=-255/173, 5-10=-256/173, 6-9=-259/175

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-6-8, Zone1 3-6-8 to 19-4-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 1 except (jt=lb) 12=156, 11=148, 10=150, 9=150.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	JONES RES.
4460945	V06	Valley	1	1	T37036679
Builders FirstSource (Lake City,FL), Lake City, FL - 32055,					
Job Reference (optional)					

8.830 s Apr 11 2025 MiTek Industries, Inc. Thu Apr 17 07:08:58 2025 Page 1  
ID:7CvAcxg5dm4g2lcSLITv78yDLlr-Mj2xvVLN9WfbOqF8AA7AmlcfXoNI\_4n1XPqjxzPu4Z

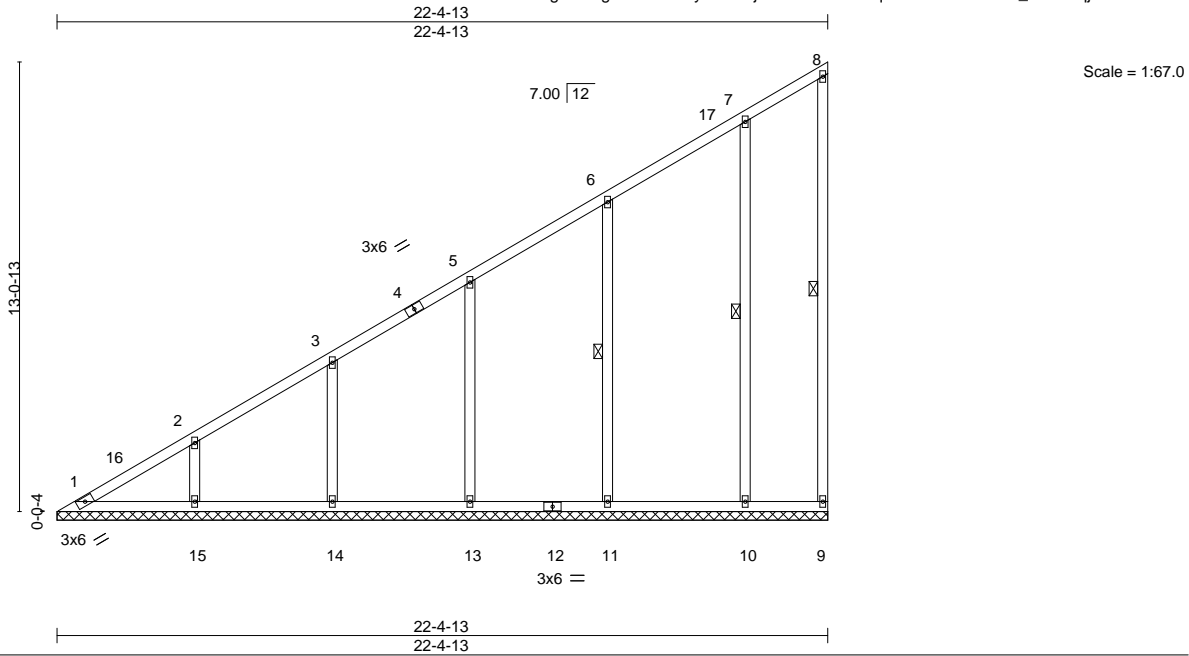

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.17	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.25	BC 0.17	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.22	Horz(CT)	-0.00	9	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-S					Weight: 137 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 8-9, 6-11, 7-10
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 22-4-13.  
(lb) - Max Horz 1=489(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 9, 1 except 15=156(LC 12), 14=149(LC 12), 13=148(LC 12), 11=154(LC 12), 10=128(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 9, 1 except 15=408(LC 19), 14=424(LC 19), 13=457(LC 19), 11=470(LC 19), 10=377(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-535/285, 2-3=-432/231, 3-5=-328/179  
WEBS 2-15=-262/175, 3-14=-255/174, 5-13=-254/172, 6-11=-264/179

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-6-8 to 3-6-8, Zone1 3-6-8 to 22-3-1 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 1 except (jt=lb) 15=156, 14=149, 13=148, 11=154, 10=128.

This item has been digitally signed and sealed by Velez, Joaquin, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Joaquin Velez PE No.68182  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
Date:

April 18,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

## Symbols


### PLATE LOCATION AND ORIENTATION



0- $\frac{1}{16}$ "

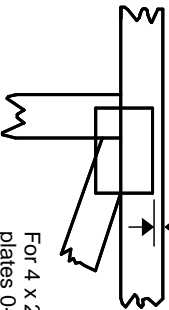

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.




\* Plate location details available in MITek software or upon request.

### PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

### LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

### BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.


### Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

## Numbering System



1 2 3 Joint ID typ.

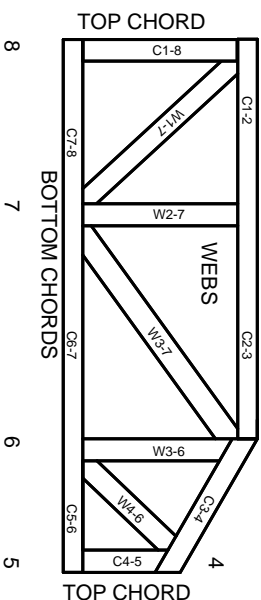

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

## Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

## Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

# MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

## General Safety Notes

**Failure to Follow Could Cause Property Damage or Personal Injury**

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.