

KENDRIA JONES RESIDENCE

842 SOUTHEAST SAINT JOHNS ST
LAKE CITY, FL 32025

PROJECT DESCRIPTION

INSTALL A ROOF MOUNTED SOLAR PHOTOVOLTAIC SYSTEM AT THE KENDRIA JONES RESIDENCE.

SYSTEM SPECIFICATIONS

AHJ:	COUNTY OF COLUMBIA
UTILITY COMPANY:	FPL
SYSTEM SIZE:	8.400kW DC 6.090kW AC
SOLAR MODULES MAKE:	Q CELLS
MODEL:	Q.PEAK DUO BLK ML-G10+ 400
QUANTITY:	21
MICROINVERTERS MAKE:	ENPHASE
MODEL:	IQ8PLUS-72-2-US
QUANTITY:	21

VICINITY MAP



ATLANTIC KEY ENERGY
12600 CHALLENGER PKWY,
STE 200
ORLANDO, FL 32826
1 (407) 988-0273



LOCATION

KENDRIA JONES
RESIDENCE
PROJECT #: P-0074596
842 SOUTHEAST SAINT JOHNS ST
LAKE CITY, FL, 32025
METER #: ACD1583

DRAWN BY:		N.R.	
DATE:		4/18/23	
REVISIONS			
DESCRIPTION		DATE	REV

GENERAL NOTES:

- THESE CONSTRUCTION DOCUMENTS HAVE BEEN BASED ON FIELD INSPECTIONS AND OTHER INFORMATION AVAILABLE AT THE TIME. ACTUAL FIELD CONDITIONS MAY REQUIRE MODIFICATIONS IN CONSTRUCTION DETAILS.
- CONTRACTOR HAS THE FULL RESPONSIBILITY TO CHECK AND VERIFY ALL DIMENSIONS AND EXISTING CONDITIONS. ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER BEFORE PROCEEDING WITH THE WORK. ANY WORK STARTED BEFORE CONSULTATION AND ACCEPTANCE BY THE ENGINEER SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND SHALL BE SUBJECT TO CORRECTION BY THEM WITHOUT ADDITIONAL COMPENSATION.
- THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR THE PROPER INSTALLATION AND COMPLETION OF THE WORK WITH APPROVED MATERIALS.
- THE EQUIPMENT AND ALL ASSOCIATED WIRING AND INTERCONNECTION SHALL BE INSTALLED ONLY BY QUALIFIED PEOPLE. A QUALIFIED PERSON IS ONE WHO HAS SKILLS AND KNOWLEDGE RELATED TO THE CONSTRUCTION AND OPERATION OF THE ELECTRICAL EQUIPMENT AND INSTALLATIONS AND HAS RECEIVED SAFETY TRAINING TO RECOGNIZE AND AVOID THE HAZARDS INVOLVED. (NEC 690.4(C), NEC 2017).
- NEW CONDUIT ROUTING SHOWN IS ESSENTIALLY SCHEMATIC. CONTRACTOR SHALL LAY OUT RUNS TO SUIT FIELD CONDITIONS AND THE COORDINATION REQUIREMENTS OF OTHER TRADES.
- ARRAY WIRING SHOULD NOT BE READILY ACCESSIBLE EXCEPT TO QUALIFIED PERSONNEL.
- THE AC DISCONNECT MUST BE ACCESSIBLE TO QUALIFIED UTILITY PERSONNEL, BE LOCKABLE, AND BE A VISIBLE-BREAK SWITCH.

SHEET INDEX

TS001	TITLE SHEET
E001	ROOF PLAN
E002	LINE DIAGRAM
E003	LABELS
S001	ATTACHMENT PLAN
MSD	DATA SHEETS
Governing Codes	
Electrical Code	2017 NEC
Fire Code	2018 NFPA / 2020 FFPC
Building Code	2020 FBC
Residential Code	2018 IRC



2023.04.19
11:55:50 -04'00'



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY OMAR TIRADO ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE NOT VCONSIDERED SIGNED AND SEAL, AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SHEET TITLE	SHEET NUMBER
TITLE SHEET	TS001

LEGEND

- LC

- LOAD CENTER
- ×

- MODULE STRING ID
- (E)

- EXISTING
- (N)

- NEW
- M

- UTILITY METER
- MSP

- MAIN SERVICE PANEL
- ACD

- AC DISCONNECT
- CB

- COMBINER BOX
- FIRE CODE SETBACKS
- SUB

- SUBPANEL
- JB

- JUNCTION BOX
- SCT

- STRING CENTER TAP
- BAT


- ENERGY STORAGE
- ICD

- INTERCONNECTION DEVICE
- BUL

- BACK UP LOADS PANEL
- APPROX. CONDUIT/ATTIC RUN



FRONT OF RESIDENCE

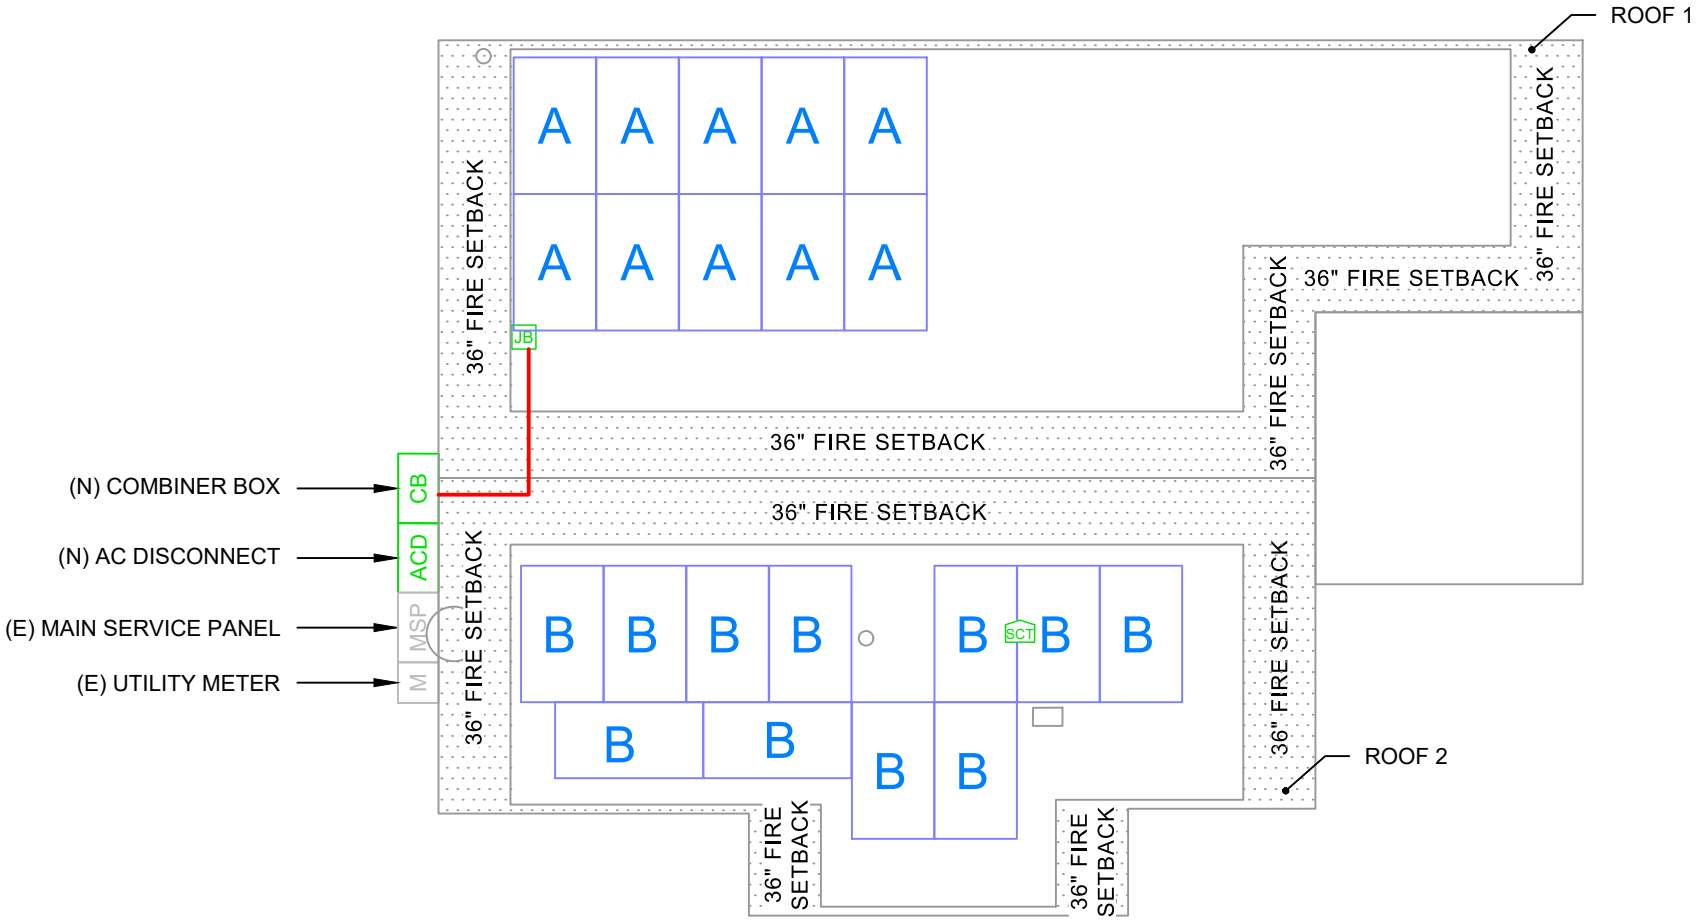

BACK OF RESIDENCE



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY OMAR TIRADO ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEAL, AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SITE PLAN
SCALE: 1/8" = 1'-0"



ATLANTIC KEY ENERGY
12600 CHALLENGER PKWY,
STE 200
ORLANDO, FL 32826
1 (407) 988-0273



LOCATION


KENDRIA JONES
RESIDENCE
PROJECT #: P-0074596
842 SOUTHEAST SAINT JOHNS ST
LAKE CITY, FL, 32025
METER #: ACD1583

DRAWN BY:		N.R.	
DATE:		4/18/23	
REVISIONS			
DESCRIPTION	DATE	REV	

SHEET TITLE	SHEET NUMBER
ROOF PLAN	E001

ID	INITIAL CONDUCTOR LOCATION	FINAL CONDUCTOR LOCATION	MIN. CONDUCTOR SIZE (AWG)		MIN. DIA CONDUIT SIZE (IN.)	# OF PARALLEL CIRCUITS	CURRENT-CARRYING CONDUCTORS IN CONDUIT	OCPD (A)	MIN. EGC SIZE (AWG)		TEMP. CORR. FACTOR		CONDUIT FILL FACTOR	CONT. CURRENT (A)	MAX. CURRENT (A)	BASE AMP. (A)	DERATED AMP. (A)	TERM. AMP. RATING (A)	LENGTH (FT)	VOLTAGE DROP (%)
1	STRING A	JUNCTION BOX	12	Q CABLE	N/A	1	2	N/A	6	BARE COPPER	0.71	56°C	N/A	12.1	15.13	30	N/A	N/A	40.00	0.80
2	STRING B	JUNCTION BOX	12	Q CABLE	N/A	1	2	N/A	6	BARE COPPER	0.71	56°C	N/A	13.31	16.64	30	N/A	N/A	70.00	0.62
3	JUNCTION BOX	COMBINER BOX	10	THWN-2 COPPER	0.75 LTNM	2	4	20	10	THWN-2 COPPER	0.71	56°C	0.8	13.31	16.64	40	22.7	35	20.00	0.28
4	COMBINER BOX	AC DISCONNECT	8	THWN-2 COPPER	0.75 LTNM	1	3	40	10	THWN-2 COPPER	0.96	35°C	1	25.41	31.76	55	52.8	50	5.00	0.08
5	AC DISCONNECT	MSP	6	THWN-2 COPPER	0.75 LTNM	1	3	N/A	-	-	0.96	35°C	1	25.41	31.76	75	72.0	65	5.00	0.05

LIST OF EQUIPMENT		
EQUIPMENT	QTY	DESCRIPTION
SOLAR PV MODULE	21	Q CELLS Q.PEAK DUO BLK ML-G10+ 400
MICROINVERTER	21	ENPHASE IQ8PLUS-72-2-US
JUNCTION BOX	1	JUNCTION BOX, NEMA 3R, UL LISTED
COMBINER BOX	1	ENPHASE IQ COMBINER 4/4C W/ IQ ENVOY (X-IQ-AM1-240-4)
AC DISCONNECT	1	60A FUSED AC DISCONNECT, 240V, NEMA 3R, UL LISTED

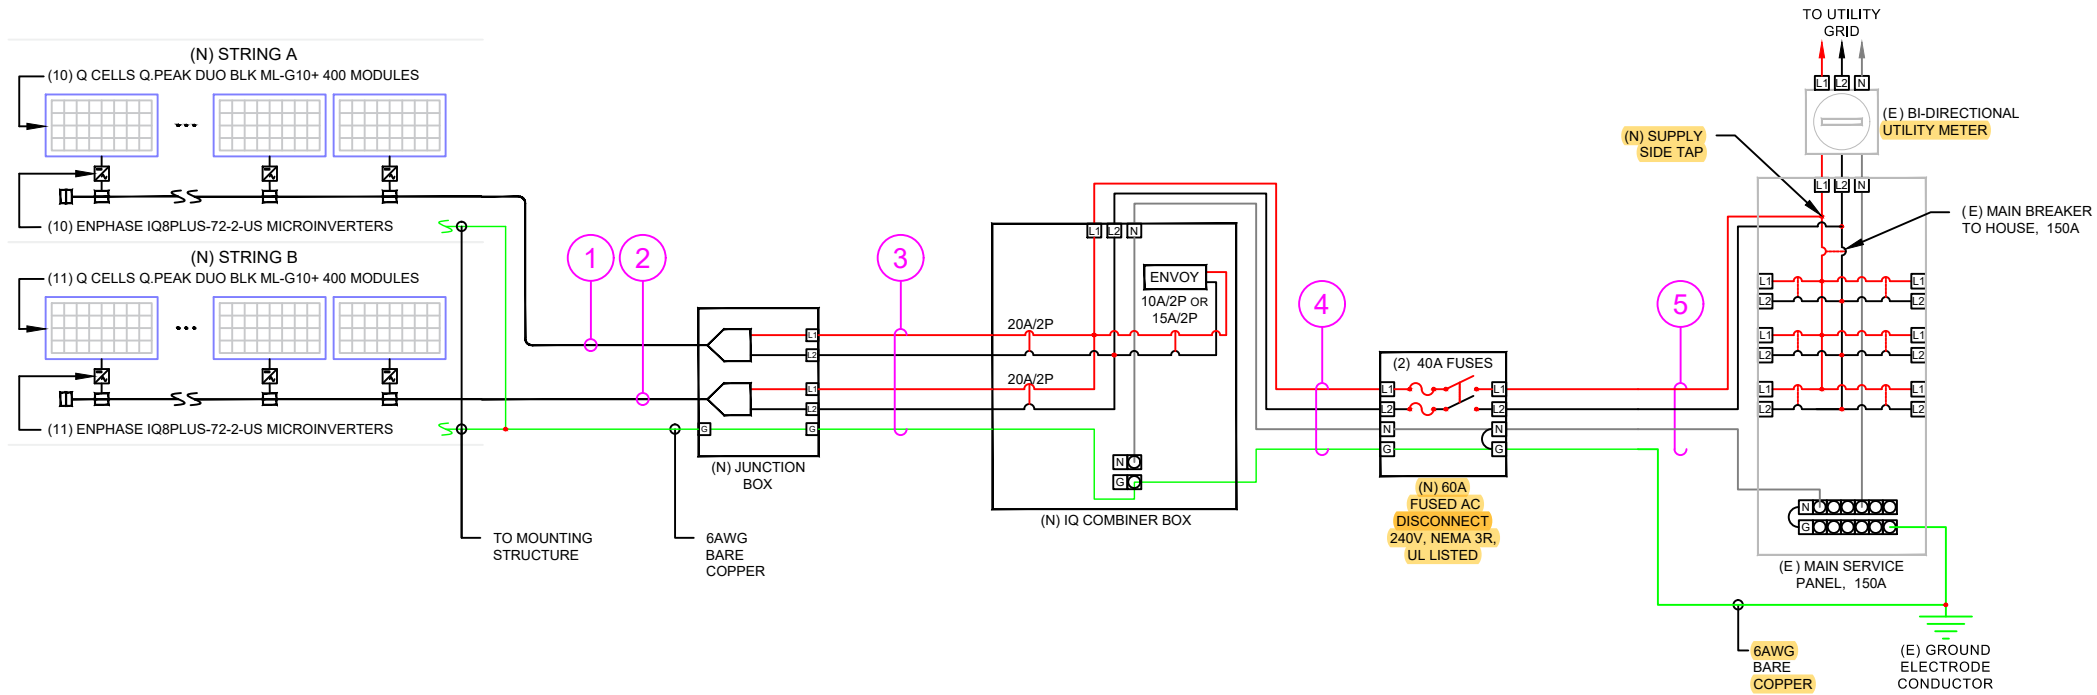

DESIGN TEMPERATURE SPECIFICATIONS

RECORD LOW TEMP	-6°C
AMBIENT TEMP. (HIGH TEMP. 2%)	35°C
CONDUIT HEIGHT	1.0"
CONDUCTOR TEMP. RATE (ROOF)	56°C



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY OMAR TIRADO ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEAL, AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES



ATLANTIC KEY ENERGY
12600 CHALLENGER PKWY,
STE 200
ORLANDO, FL 32826
1 (407) 988-0273



LOCATION

KENDRIA JONES
RESIDENCE
PROJECT #: P-0074596
842 SOUTHEAST SAINT JOHNS ST
LAKE CITY, FL, 32025
METER #: ACD1583

DRAWN BY: N.R.

DATE: 4/18/23

REVISIONS

DESCRIPTION	DATE	REV

SHEET TITLE

3-LINE
DIAGRAM

SHEET NUMBER

E002

⚡

WARNING

⚡

ELECTRIC SHOCK HAZARD

DO NOT TOUCH TERMINALS
TERMINALS ON BOTH THE LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION

LABEL LOCATION:
COMBINER BOX/ EMT
ENCLOSURES/ AC DISCONNECT/
MAIN SERVICE PANEL
PER CODE: NEC 2017, 690.13(B)

EMERGENCY RESPONDER
SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN
SWITCH TO THE "OFF"
POSITION TO SHUT
DOWN THE ENTIRE PV
SYSTEM

LABEL LOCATION:
RAPID SHUTDOWN (AC DISCONNECT)
PER CODE: NEC 690.56 (C)(1) &
NFPA1 11.12.2.1.1.1.1, 11.12.2.1.4
SHALL BE REFLECTIVE, WITH ALL
LETTERS CAPITALIZED AND HAVING A
MINIMUM HEIGHT OF 3/8 IN. (9.5 MM), IN
WHITE ON RED BACKGROUND.

WARNING: PHOTOVOLTAIC
POWER SOURCE

LABEL LOCATION:
CONDUIT/ RACEWAY/ ENCLOSURES/
COMBINER BOX/ AC DISCONNECT
PER CODE: NEC2017, 690.31(G)(3)(4)

PHOTOVOLTAIC
AC DISCONNECT

LABEL LOCATION:
AC DISCONNECT/ BREAKER/
POINTS OF CONNECTION
PER CODE: NEC2017, 690.13(B)

PHOTOVOLTAIC AC DISCONNECT

RATED AC OUTPUT CURRENT25.4A

NOMINAL OPERATING AC VOLTAGE240V

LABEL LOCATION:
AC DISCONNECT
PER CODE: NEC2017, 690.54

RAPID SHUTDOWN
SWITCH FOR
SOLAR PV SYSTEM

LABEL LOCATION:
RAPID SHUTDOWN
(AC DISCONNECT)
PER CODE: NEC 690.58 (C)(3)

⚡

WARNING

⚡

DUAL POWER SOURCE

SOURCES: UTILITY GRID AND
PV SOLAR ELECTRIC SYSTEM

LABEL LOCATION:
POINT OF INTERCONNECTION
PER CODE: NEC 2017, 705.12(B)

- NOTES
- ANSI Z535.4-2011 PRODUCT SAFETY SIGNS AND LABELS, PROVIDES GUIDELINES FOR SUITABLE FONT SIZES, WORDS, COLORS, SYMBOLS, AND LOCATION REQUIREMENTS FOR LABELS. NEC 110.21(B)(1).
 - THE LABEL SHALL BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED. NEC 110.21(B)(3).
 - ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT.
 - ALL LABELS AND MARKINGS FOR PHOTOVOLTAIC SYSTEMS WILL BE REFLECTIVE AND MEET ALL REQUIREMENTS.



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY OMAR
TIRADO ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES
OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEAL, AND
THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES



ATLANTIC KEY ENERGY
12600 CHALLENGER PKWY,
STE 200
ORLANDO, FL 32826
1 (407) 988-0273



LOCATION

KENDRIA JONES
RESIDENCE
PROJECT #: P-0074596
842 SOUTHEAST SAINT JOHNS ST
LAKE CITY, FL, 32025
METER #: ACD1583

DRAWN BY: N.R.

DATE: 4/18/23

REVISIONS

DESCRIPTION	DATE	REV

SHEET TITLE

SHEET NUMBER

LABELSE003

ARRAY DESCRIPTION						
ROOF	# OF MODULES	AZIMUTH	TILT	TRUSS SIZE	TRUSS SPACING	ROOF MATERIAL
#1	10	1	5/12 (22.62°)	2X4	24"O.C.	COMP SHINGLE
#2	11	181	5/12 (22.62°)	2X4	24"O.C.	COMP SHINGLE

DESIGN SPECIFICATION	
RISK CATEGORY	II
CONSTRUCTION	SFD
ZONING	RESIDENTIAL
SNOW LOAD (ASCE 7-16)	0 PSF
EXPOSURE CATEGORY	B
WIND SPEED (ASCE 7-16)	120 MPH



ATLANTIC KEY ENERGY
12600 CHALLENGER PKWY,
STE 200
ORLANDO, FL 32826
1 (407) 988-0273



LOCATION

KENDRIA JONES
RESIDENCE
PROJECT #: P-0074596
842 SOUTHEAST SAINT JOHNS ST
LAKE CITY, FL, 32025
METER #: ACD1583

DRAWN BY: N.R.

DATE: 4/18/23

REVISIONS

DESCRIPTION	DATE	REV



THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED BY OMAR TIRADO ON THE DATE ADJACENT TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEAL, AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES


ROOF'S GENERAL NOTES

- 1- CONTRACTOR/INSTALLER TO VERIFY ROOF CONDITIONS FOR PROPPER INSTALLATION OF THE PV SYSTEM.
- 2- CONTRACTOR/INSTALLER TO NOTIFY THE OWNER IMMEDIATELY OF ANY ROOF DEFICIENCIES AND/OR REPAIR REQUIRED TO INSTALL THE PV SYSTEM.
- 3- EOR DOES NOT ASSUME ANY RESPONSIBILITY FOR THE INSTALLATION OF ANY PV SYSTEM ON DEFICIENT ROOFS.
- 4- CONTRACTOR/INSTALLER ASSUMES ALL RESPONSIBILITY TO INSTALL AS PER MANUFACTURER STANDARS.

ROOF INSPECTION NOTES

- PV MODULES IN LAYOUTS IS CONSIDERED NON-EXPOSED AFTER COMPLYING WITH THE FOLLOWING STATEMENTS BASED ON ASCE 7-16:
- NO INDIVIDUAL PV MODULE IS MORE THAN 0.5 (MEAN ROOF HEIGHT) AWAY FROM ROOF EDGE OR ANOTHER MODULE.
 - NO INDIVIDUAL PV MODULE IS MORE THAN 4FT AWAY FROM ROOF EDGE OR ANOTHER MODULE.
 - INDIVIDUAL PV MODULE IS MORE THAN 1.5 (MODULE LENGTH) AWAY FROM CLOSEST EXPOSED EDGE.

FRONT OF RESIDENCE

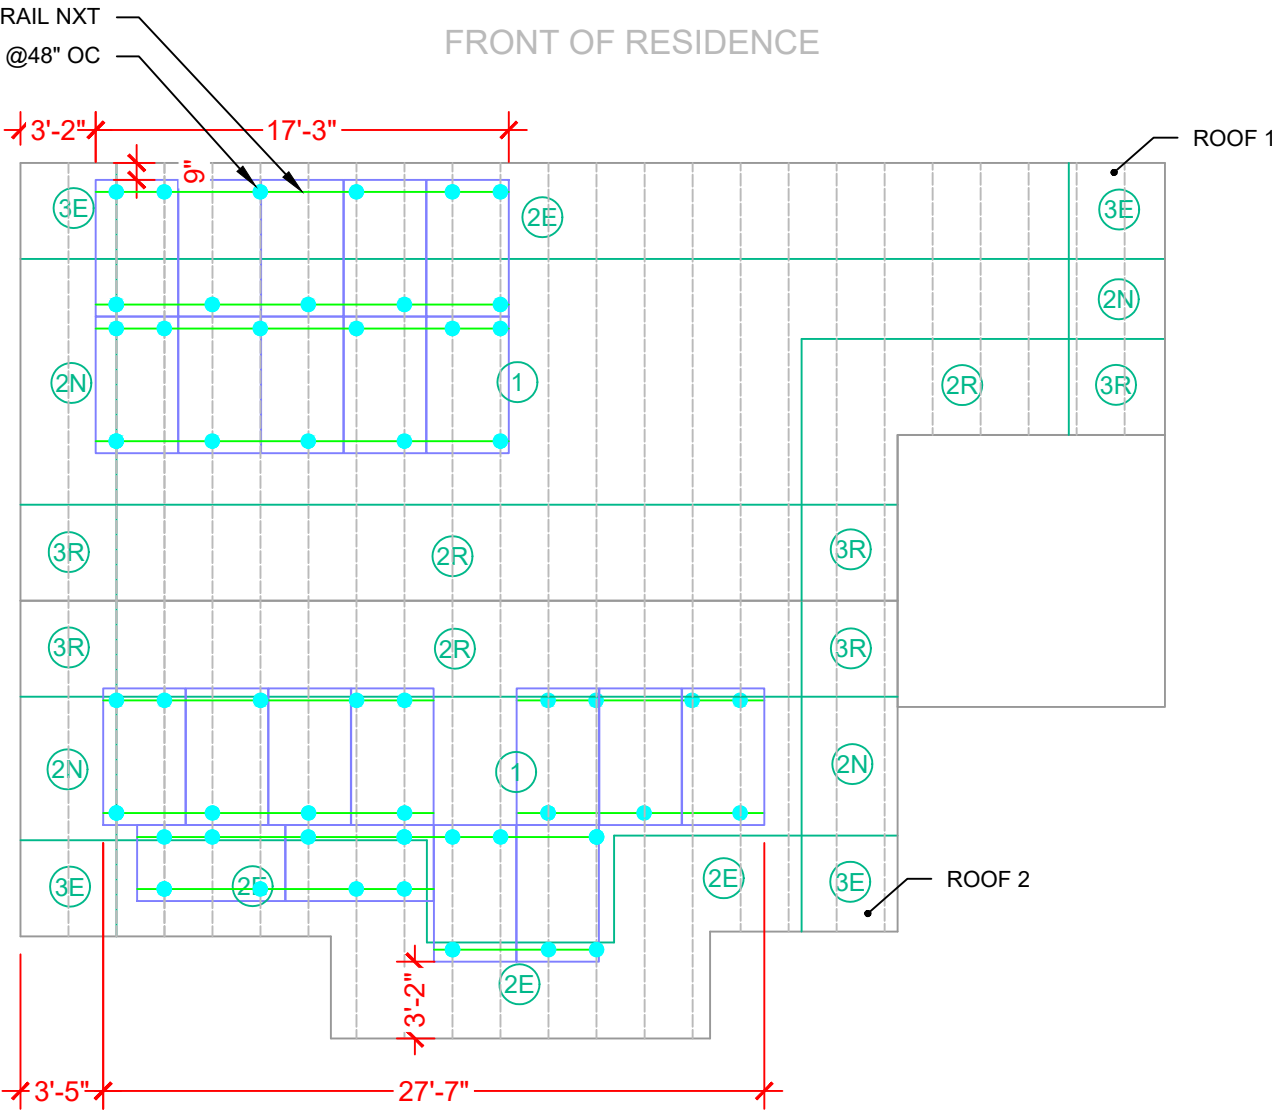

BACK OF RESIDENCE





ROOF PLAN
SCALE: 1/8" = 1'-0"

SHEET TITLE SHEET NUMBER




ATTACH.
PLAN

S001

PART # TABLE	
P/N	DESCRIPTION
SBUTYLM1	STRONGHOLD ATT W/BUTYL, MILL
SBUTYLD1	STRONGHOLD ATT W/BUTYL, DARK

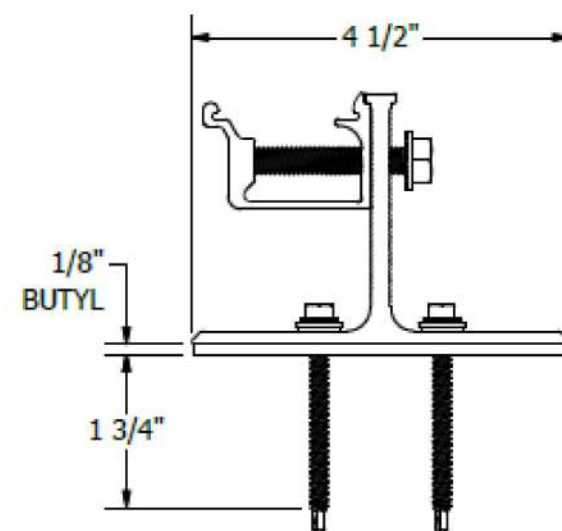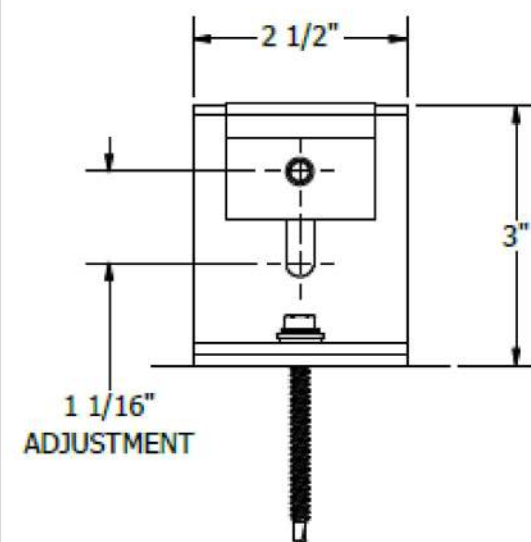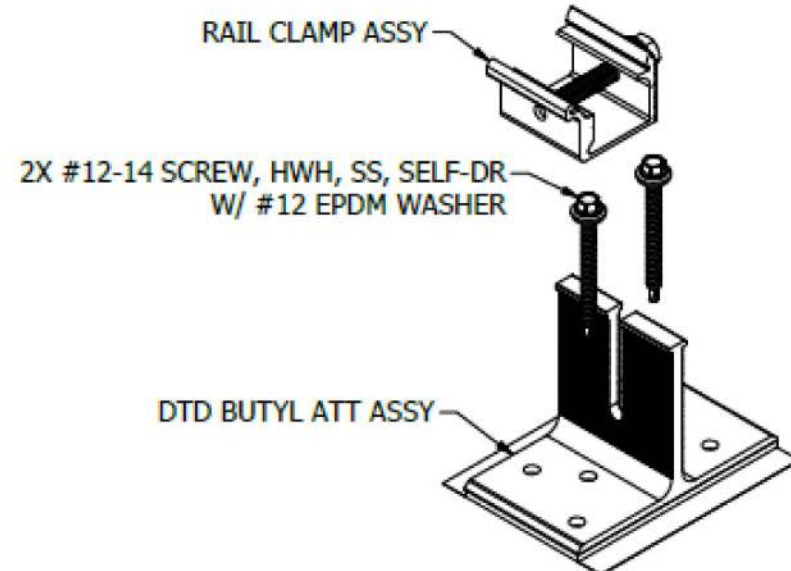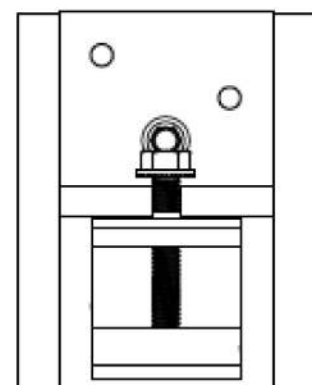

PART # TABLE		
P/N	DESCRIPTION	LENGTH
084RLM1	NXT UMount RAIL 84" MILL	84"
084RLD1	NXT UMount RAIL 84" DARK	84"
168RLM1	NXT UMount RAIL 168" MILL	168"
168RLD1	NXT UMount RAIL 168" DARK	168"
208RLM1	NXT UMount RAIL 208" MILL	208"
208RLD1	NXT UMount RAIL 208" DARK	208"
246RLM1	NXT UMount RAIL 246" MILL	246"
246RLD1	NXT UMount RAIL 246" DARK	246"
171RLM1	NXT UMount RAIL 171" MILL	171.50"
171RLD1	NXT UMount RAIL 171" DARK	171.50"

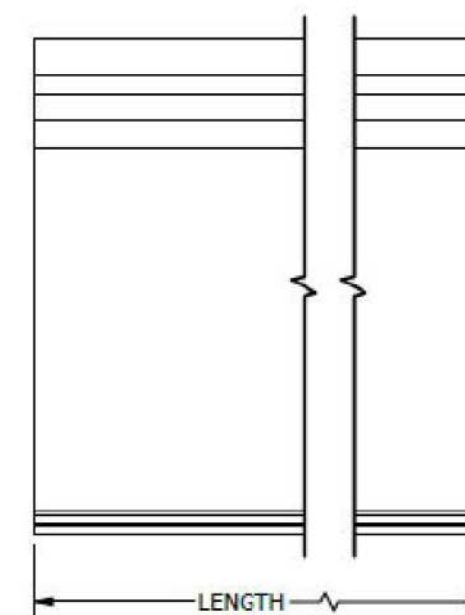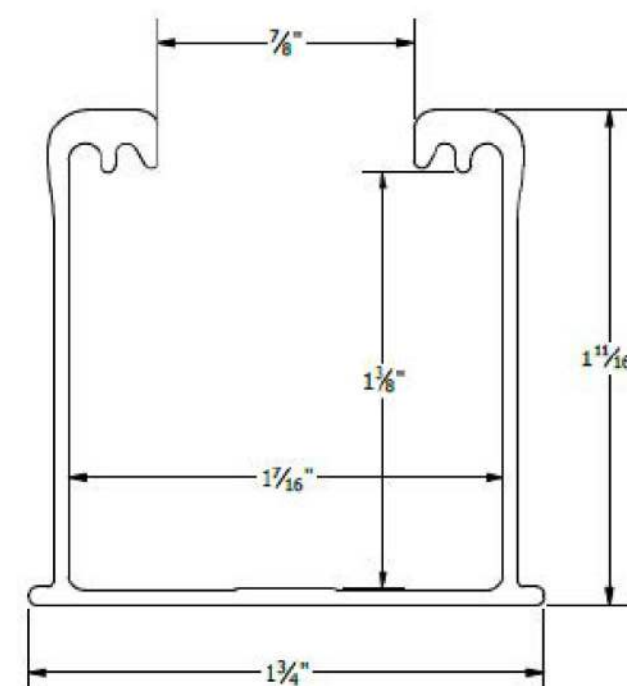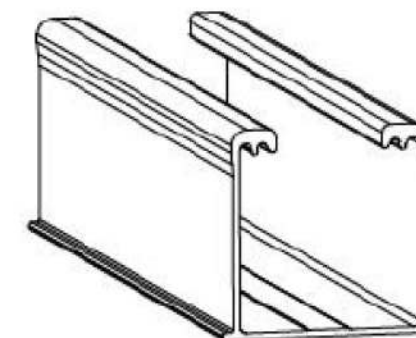

UNIRAC
1411 BROADWAY BLVD. NE
ALBUQUERQUE, NM 87102 USA
PHONE: 505.242.6411
WWW.UNIRAC.COM

PRODUCT LINE:	NXT UMount
DRAWING TYPE:	PARTS
DESCRIPTION:	SH BUTYL ATTACHMENT
REVISION DATE:	2/3/2023

DRAWING NOT TO SCALE ALL DIMENSIONS ARE NOMINAL
PRODUCT PROTECTED BY ONE OR MORE US PATENTS
LEGAL NOTICE

NU-A10
SHEET

UNIRAC
1411 BROADWAY BLVD. NE
ALBUQUERQUE, NM 87102 USA
PHONE: 505.242.6411
WWW.UNIRAC.COM

PRODUCT LINE:	NXT UMount
DRAWING TYPE:	PART DETAIL
DESCRIPTION:	RAIL
REVISION DATE:	11/17/2022

DRAWING NOT TO SCALE ALL DIMENSIONS ARE NOMINAL
PRODUCT PROTECTED BY ONE OR MORE US PATENTS
LEGAL NOTICE

NU-P01
SHEET

NXT HORIZON®

UNIRAC®
BETTER SOLAR STARTS HERE

UNIRAC®
25
YEAR
FULL-SYSTEM
WARRANTY

DISCOVER YOUR NXT HORIZON®

The culmination of over two decades of experience. Thoughtful design, rigorous engineering, world-class support, and a reliable supply chain are the foundation of what makes us confident that NXT HORIZON® is the NXT Level of DESIGN, SIMPLICITY, and VALUE.

STRONGHOLD™ RAIL CLAMP
DARK: SHCLMPD1
MILL: SHCLMPM1

Adaptable rail connection to attachments allows click-in feature compatibility with almost all of Unirac's attachments.

STRONGHOLD™ ATTACHMENT KIT
DARK: SHCPKTD1
MILL: SHCPKTM1

Rail clicks into the clamps attached to the Stronghold™ base. Open slot in L-foot allows drop-in rail clamp.

Alternative attachment options:

SOLARHOOKS
All varieties

FLASHKIT PRO
DARK: 004055D
MILL: 004055M

FLASHLOC™ DUO
DARK: 004275D
MILL: 004275M

NXT HORIZON™ RAIL
DARK: 168RLD1
MILL: 168RLM1

Strong, lightweight open channel rail with invisible, easy, unfailing and integrated wire management system.

NXT HORIZON™ RAIL SPLICE
RLSPLCM1

Structural internal splice that does not interfere with roof connection nor module connection. Pre-assembled thread cutting bolts.

NXT HORIZON™ COMBO CLAMP
DARK: CCLAMPD1
MILL: CCLAMPM1

Clicks into rail anywhere (even where there are cables!)
Self-standing clamp with spring combines as both mid and end clamp. Clamps 30-40 mm modules

1/2 inch module spacing for efficiency.
Unirac-quality bonding that works both as mid and end clamps.

NXT HORIZON™ CAP KIT
ENDCAPD1

Make the install look clean with the end cap kit designed to complement the module end clamp and rail ends.

WIRE MANAGEMENT OPTIONS

NXT HORIZON™ MLPE & LUG CLAMP
LUGMLPE1

Works as either MLPE Mount or Grounding Lug connection to the rail. Why source two parts when one can do the job?

NXT HORIZON™ WIRE MANAGEMENT CLIP
WRMCLPD1

Aesthetic, yet functional accessory that works to help installers keep wires inside the rail. No zip-ties required. Optional zip tie loop for extra wire management capabilities!

NXT HORIZON™ NORTH/SOUTH WIRE MANAGEMENT CLIP
WRMCNSD1

An elegant solution to help installers get to the home run. The same hardware works to provide both easy entry to rail and adjustability for cable thickness.

ALL NXT HORIZON® SYSTEMS INCLUDE A FREE PERMITTING PLANSET DESIGN - FOR QUESTIONS OR CUSTOMER SERVICE VISIT UNIRAC.COM OR EMAIL NXTPERMITS@UNIRAC.COM

powered by
Q.ANTUM DUO Z

Q.PEAK DUO BLK ML-G10+ 385-405

ENDURING HIGH
PERFORMANCE



BREAKING THE 20% EFFICIENCY BARRIER

Q.ANTUM DUO Z Technology with zero gap cell layout boosts module efficiency up to 20.9%.



THE MOST THOROUGH TESTING PROGRAMME IN THE INDUSTRY

Q CELLS is the first solar module manufacturer to pass the most comprehensive quality programme in the industry: The new "Quality Controlled PV" of the independent certification institute TÜV Rheinland.



INNOVATIVE ALL-WEATHER TECHNOLOGY

Optimal yields, whatever the weather with excellent low-light and temperature behavior.



ENDURING HIGH PERFORMANCE

Long-term yield security with Anti LID Technology, Anti PID Technology¹, Hot-Spot Protect and Traceable Quality Tra.Q™.



EXTREME WEATHER RATING

High-tech aluminum alloy frame, certified for high snow (5400 Pa) and wind loads (4000 Pa).



A RELIABLE INVESTMENT

Inclusive 25-year product warranty and 25-year linear performance warranty².

¹ APT test conditions according to IEC/TS 62804-1:2015, method A (-1500 V, 96 h)
² See data sheet on rear for further information.

THE IDEAL SOLUTION FOR:




Rooftop arrays on
residential buildings

Engineered in Germany

Q CELLS

MECHANICAL SPECIFICATION

Format	74.0 in x 41.1 in x 1.26 in (including frame) (1879 mm x 1045 mm x 32 mm)
Weight	48.5 lbs (22.0 kg)
Front Cover	0.13 in (3.2 mm) thermally pre-stressed glass with anti-reflection technology
Back Cover	Composite film
Frame	Black anodized aluminum
Cell	6 x 22 monocrystalline Q.ANTUM solar half cells
Junction Box	2.09-3.98 in x 1.26-2.36 in x 0.59-0.71 in (53-101 mm x 32-60 mm x 15-18 mm), IP67, with bypass diodes
Cable	4 mm ² Solar cable; (+) ≥ 49.2 in (1250 mm), (-) ≥ 49.2 in (1250 mm)
Connector	Stäubli MC4; IP68

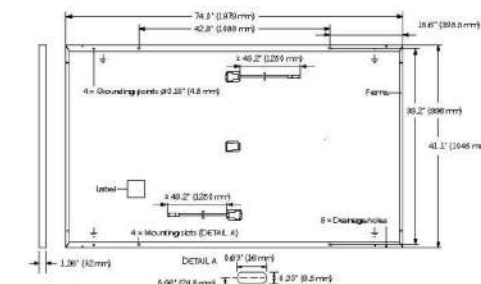


ELECTRICAL CHARACTERISTICS

POWER CLASS		385	390	395	400	405
MINIMUM PERFORMANCE AT STANDARD TEST CONDITIONS, STC* (POWER TOLERANCE +5 W / -0 W)						
Minimum	Power at MPP ¹	P _{MPP} [W]	385	390	395	405
	Short Circuit Current ¹	I _{SC} [A]	11.04	11.07	11.10	11.17
	Open Circuit Voltage ¹	V _{OC} [V]	45.19	45.23	45.27	45.34
	Current at MPP	I _{MPP} [A]	10.59	10.65	10.71	10.83
	Voltage at MPP	V _{MPP} [V]	36.36	36.62	36.88	37.39
	Efficiency ¹	η [%]	≥ 19.6	≥ 19.9	≥ 20.1	≥ 20.6
MINIMUM PERFORMANCE AT NORMAL OPERATING CONDITIONS, NMOT ²						
Minimum	Power at MPP	P _{MPP} [W]	288.8	292.6	296.3	300.1
	Short Circuit Current	I _{SC} [A]	8.90	8.92	8.95	9.00
	Open Circuit Voltage	V _{OC} [V]	42.62	42.65	42.69	42.72
	Current at MPP	I _{MPP} [A]	8.35	8.41	8.46	8.51
	Voltage at MPP	V _{MPP} [V]	34.59	34.81	35.03	35.25

* Measurement tolerances P_{MPP} ± 3%; I_{SC}, V_{OC} ± 5% at STC: 1000 W/m², 25 ± 2 °C, AM 1.5 according to IEC 60904-3 • 800 W/m², NMOT, spectrum AM 1.5


Q CELLS PERFORMANCE WARRANTY

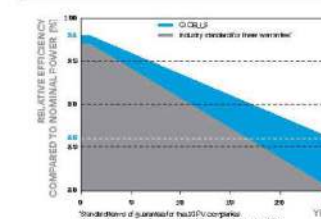

At least 98% of nominal power during first year. Thereafter max. 0.5% degradation per year. At least 93.5% of nominal power up to 10 years. At least 86% of nominal power up to 25 years.

All data within measurement tolerances. Full warranties in accordance with the warranty terms of the Q CELLS sales organization of your respective country.

PERFORMANCE AT LOW IRRADIANCE

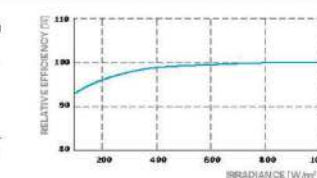

Typical module performance under low irradiance conditions in comparison to STC conditions (25 °C, 1000 W/m²)

TEMPERATURE COEFFICIENTS

Temperature Coefficient of I _{SC}	α [%/K]	+0.04	Temperature Coefficient of V _{OC}	β [%/K]	-0.27
Temperature Coefficient of P _{MPP}	γ [%/K]	-0.34	Nominal Module Operating Temperature	NMOT [°F]	109 ± 5.4 (43 ± 3 °C)

PROPERTIES FOR SYSTEM DESIGN

Maximum System Voltage V _{MV}	[V]	1000 (IEC)/1000 (UL)	PV module classification	Class II
Maximum Series Fuse Rating	[A DC]	20	Fire Rating based on ANSI/UL 61730	TYPE 2
Max. Design Load, Push/Pull ³	[lbs/ft ²]	75 (3600 Pa)/55 (2600 Pa)	Permitted Module Temperature on Continuous Duty	-40 °F up to +185 °F (-40 °C up to +85 °C)
Max. Test Load, Push/Pull ³	[lbs/ft ²]	113 (5400 Pa)/84 (4000 Pa)		

³ See Installation Manual

QUALIFICATIONS AND CERTIFICATES

UL 61730, CE-compliant
Quality Controlled PV - TÜV Rheinland
IEC 61215/2016, IEC 61730:2016
U.S. Patent No. 9,893,215 (solar cells)
QCVP Certification ongoing



Horizontal packaging	76.4 in 1940 mm	43.3 in 1100 mm	48.0 in 1220 mm	1656 lbs 751 kg	24 pallets	24 pallets	32 modules
----------------------	--------------------	--------------------	--------------------	--------------------	---------------	---------------	---------------

Note: Installation instructions must be followed. See the installation and operating manual or contact our technical service department for further information on approved installation and use of this product.

Harwin Q CELLS America Inc.
400 Spectrum Center Drive, Suite 1400, Irvine, CA 92618, USA | TEL +1 949 748 59 96 | EMAIL inquiry@us.q-cells.com | WEB www.q-cells.us

Specifications subject to technical changes © Q CELLS Q.PEAK DUO BLK ML-G10+ 385-405, 2021-05, Rev.01_NA



IQ8 Series Microinverters

Our newest IQ8 Microinverters are the industry’s first microgrid-forming, software-defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application-specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has super-fast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.



Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the Enphase IQ Battery, Enphase IQ Gateway, and the Enphase App monitoring and analysis software.



IQ8 Series Microinverters redefine reliability standards with more than one million cumulative hours of power-on testing, enabling an industry-leading limited warranty of up to 25 years.



Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.



IQ8 Series Microinverters are UL Listed as PV Rapid Shut Down Equipment and conform with various regulations, when installed according to manufacturer’s instructions.

Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

High productivity and reliability

- Produce power even when the grid is down
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

Microgrid-forming

- Complies with the latest advanced grid support
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) requirements

IQ8 Series Microinverters

INPUT DATA (DC)		IQ8-60-2-US	IQ8PLUS-72-2-US	IQ8M-72-2-US	IQ8A-72-2-US	IQ8H-240-72-2-US	IQ8H-208-72-2-US ⁽¹⁾
Commonly used module pairings ²	W	235 – 350	235 – 440	260 – 460	295 – 500	320 – 540+	295 – 500+
Module compatibility		60-cell/120 half-cell					
MPPT voltage range	V	27 – 37	29 – 45	33 – 45	36 – 45	38 – 45	38 – 45
Operating range	V	25 – 48			25 – 58		
Min/max start voltage	V	30 / 48			30 / 58		
Max input DC voltage	V	50			60		
Max DC current ³ [module Isc]	A			15			
Overvoltage class DC port				II			
DC port backfeed current	mA			0			
PV array configuration		1x1 Ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit					
OUTPUT DATA (AC)		IQ8-60-2-US	IQ8PLUS-72-2-US	IQ8M-72-2-US	IQ8A-72-2-US	IQ8H-240-72-2-US	IQ8H-208-72-2-US
Peak output power	VA	245	300	330	366	384	366
Max continuous output power	VA	240	290	325	349	380	360
Nominal (L-L) voltage/range ⁴	V			240 / 211 – 264			208 / 183 – 250
Max continuous output current	A	1.0	1.21	1.35	1.45	1.58	1.73
Nominal frequency	Hz			60			
Extended frequency range	Hz			50 – 68			
Max units per 20 A (L-L) branch circuit ⁵		16	13	11	11	10	9
Total harmonic distortion				<5%			
Overvoltage class AC port				III			
AC port backfeed current	mA			30			
Power factor setting				1.0			
Grid-tied power factor (adjustable)				0.85 leading – 0.85 lagging			
Peak efficiency	%	97.5	97.6	97.6	97.6	97.6	97.4
CEC weighted efficiency	%	97	97	97	97.5	97	97
Night-time power consumption	mW			60			
MECHANICAL DATA							
Ambient temperature range		-40°C to +60°C (-40°F to +140°F)					
Relative humidity range		4% to 100% (condensing)					
DC Connector type		MC4					
Dimensions (HxWxD)		212 mm (8.3") x 175 mm (6.9") x 30.2 mm (1.2")					
Weight		1.08 kg (2.38 lbs)					
Cooling		Natural convection – no fans					
Approved for wet locations		Yes					
Acoustic noise at 1 m		<60 dBA					
Pollution degree		PD3					
Enclosure		Class II double-insulated, corrosion resistant polymeric enclosure					
Environ. category / UV exposure rating		NEMA Type 6 / outdoor					
COMPLIANCE							
Certifications		CA Rule 21 (UL 1741-SA), UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer’s instructions.					

(1) The IQ8H-208 variant will be operating in grid-tied mode only at 208V AC. (2) No enforced DC/AC ratio. See the compatibility calculator at <https://link.enphase.com/module-compatibility> (3) Maximum continuous input DC current is 10.6A (4) Nominal voltage range can be extended beyond nominal if required by the utility. (5) Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

Enphase IQ Combiner 4/4C

X-IQ-AM1-240-4
X-IQ-AM1-240-4C



To learn more about Enphase offerings, visit enphase.com

The **Enphase IQ Combiner 4/4C** with Enphase IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure and streamlines IQ microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

Smart

- Includes IQ Gateway for communication and control
- Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring

Simple

- Centered mounting brackets support single stud mounting
- Supports bottom, back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- UL listed



Enphase IQ Combiner 4/4C

MODEL NUMBER	
IQ Combiner 4 (X-IQ-AM1-240-4)	IQ Combiner 4 with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes a silver solar shield to match the IQ Battery system and IQ System Controller 2 and to deflect heat.
IQ Combiner 4C (X-IQ-AM1-240-4C)	IQ Combiner 4C with Enphase IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and consumption monitoring (+/- 2.5%). Includes Enphase Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.) Includes a silver solar shield to match the IQ Battery and IQ System Controller and to deflect heat.
ACCESSORIES AND REPLACEMENT PARTS (not included, order separately)	
Ensemble Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05	- Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint data plan for Ensemble sites - 4G based LTE-M1 cellular modem with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year AT&T data plan
Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-15A-2P-240V-B BRK-20A-2P-240V-B	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220 Circuit breaker, 2 pole, 15A, Eaton BR215B with hold down kit support Circuit breaker, 2 pole, 20A, Eaton BR220B with hold down kit support
EPLC-01	Power line carrier (communication bridge pair), quantity - one pair
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 4/4C
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Gateway printed circuit board (PCB) for Combiner 4/4C
X-IQ-NA-HD-125A	Hold down kit for Eaton circuit breaker with screws.
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating	65 A
Max. continuous current rating (input from PV/storage)	64 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. total branch circuit breaker rating (input)	80A of distributed generation / 95A with IQ Gateway breaker included
Envoy breaker	10A or 15A rating GE/Siemens/Eaton included
Production metering CT	200 A solid core pre-installed and wired to IQ Gateway
Consumption monitoring CT (CT-200-SPLIT)	A pair of 200 A split core current transformers
MECHANICAL DATA	
Dimensions (WxHxD)	37.5 x 49.5 x 16.8 cm (14.75" x 19.5" x 6.63"). Height is 21.06" (53.5 cm) with mounting brackets.
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Cellular	CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellular modem). Note that an Enphase Mobile Connect cellular modem is required for all Ensemble installations.
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
COMPLIANCE	
Compliance, IQ Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5
Compliance, IQ Gateway	UL 60601-1/CANCSA 22.2 No. 61010-1

To learn more about Enphase offerings, visit enphase.com

© 2022 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 4/4C, and other names are trademarks of Enphase Energy, Inc. Data subject to change. 02-14-2022

