
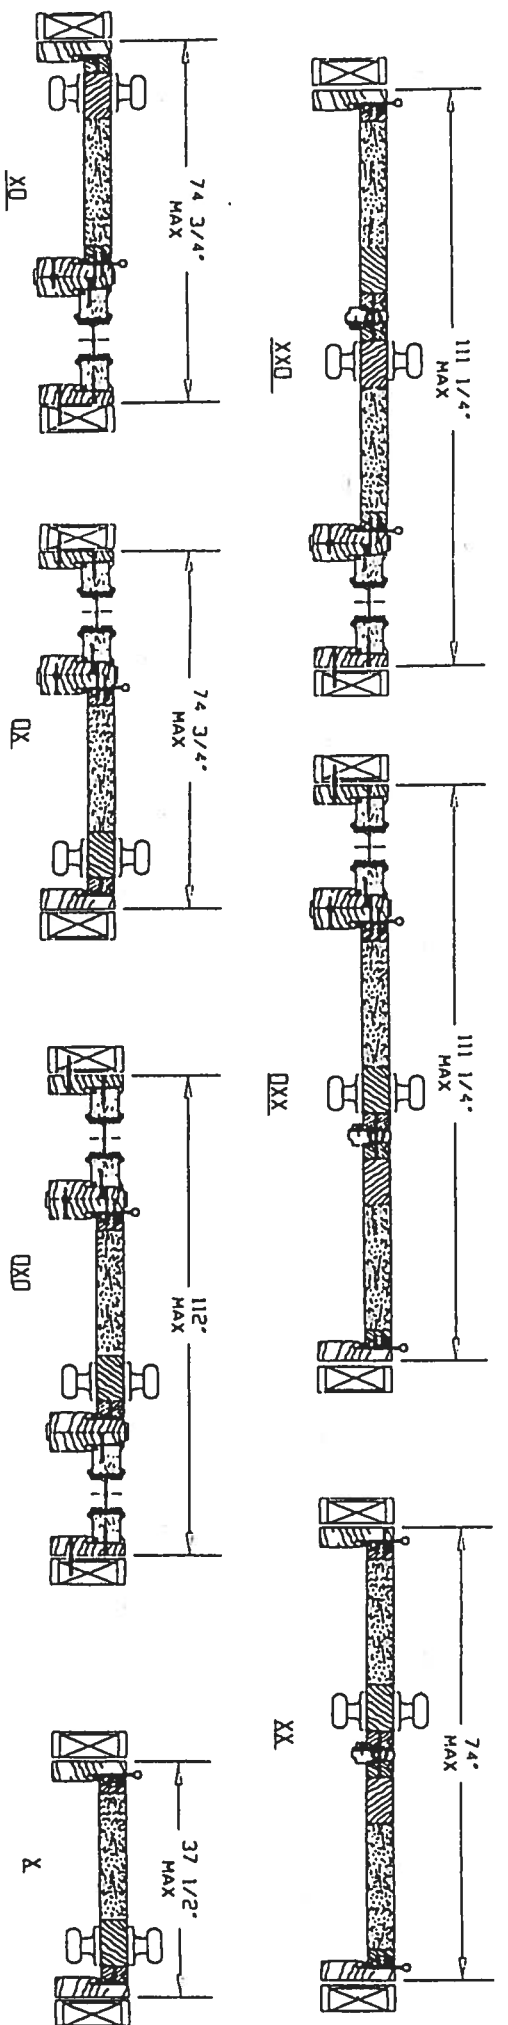
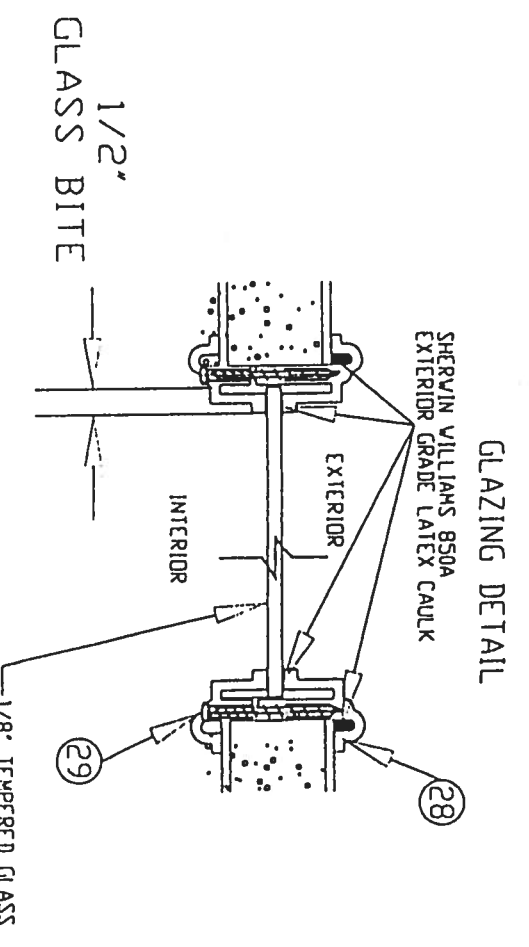


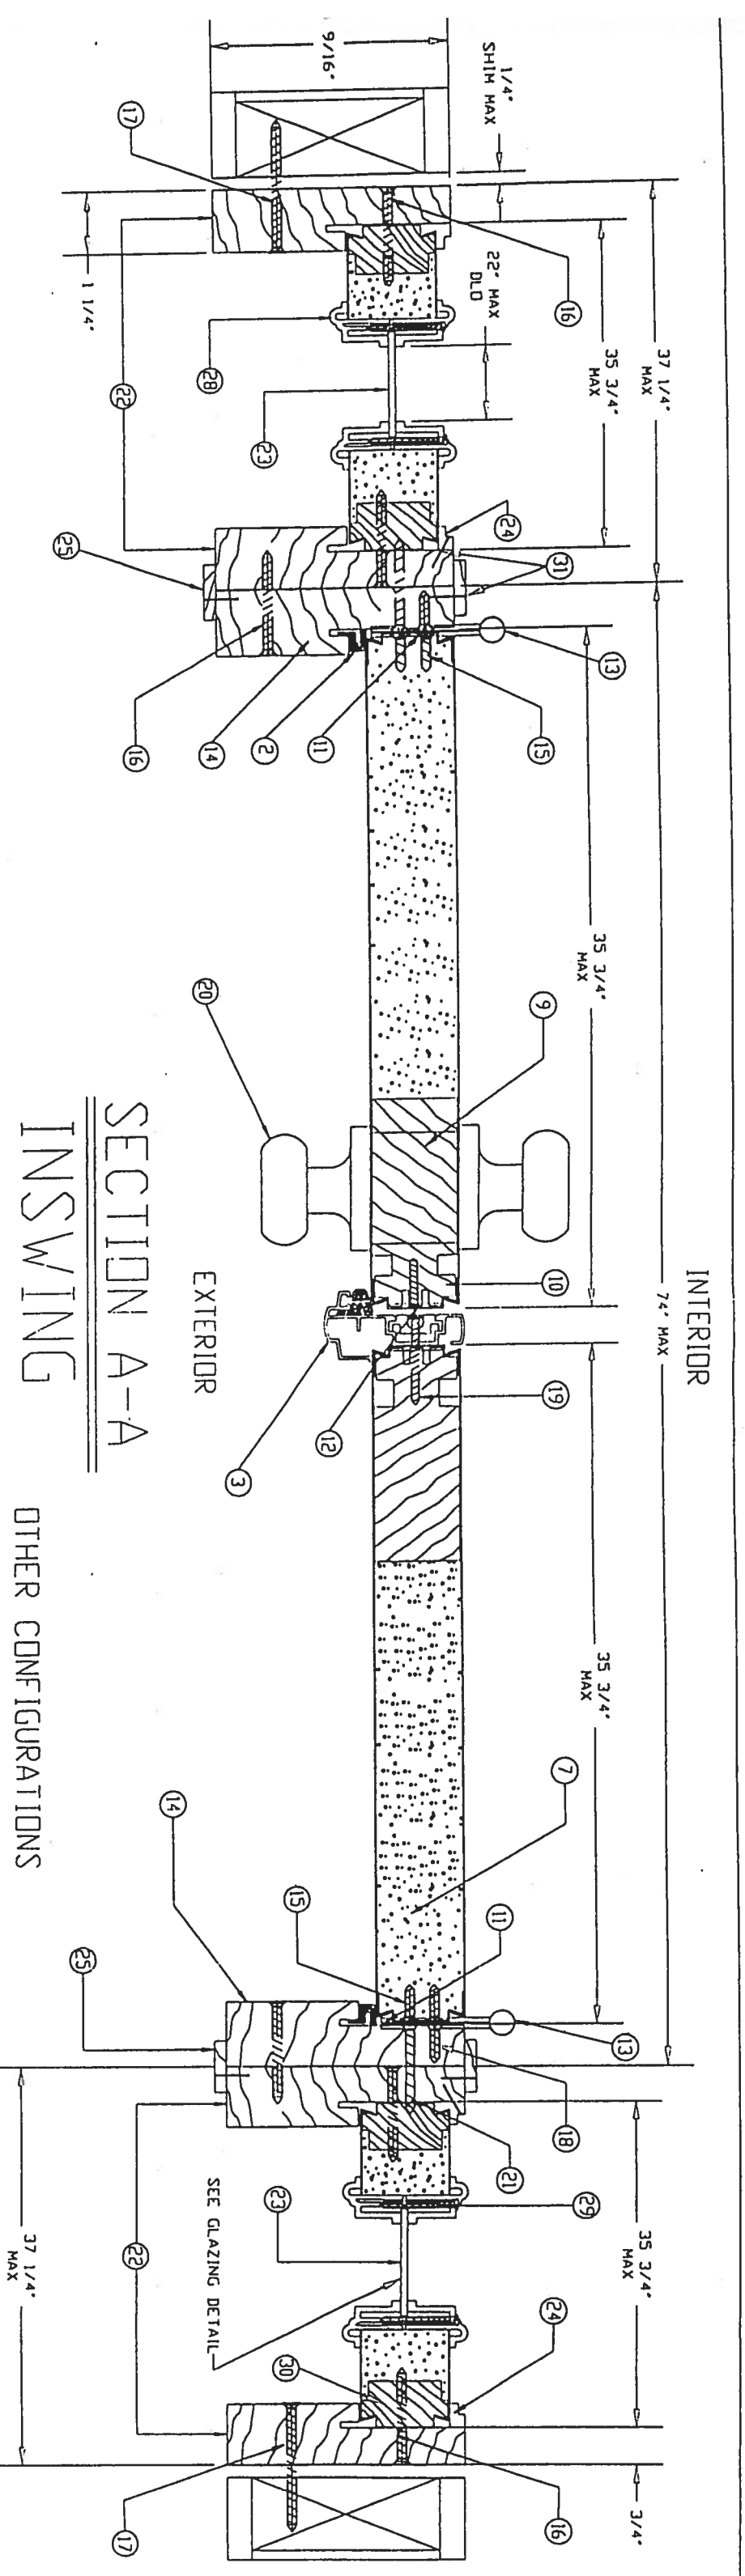


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **JUN 05 2001**
BY *William C. Jones*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

LIMITS UNLESS NOTED OTHERWISE		IC	AG
B ADD SCREWS TO LITE FRAMES & EXTENDING UNLESS NOTED SUB CON. UNITS			
ENGINEER:		A	RS
PART NAME: EXTENDED DOOR SYSTEMS (A-1)		DATE: 7-29-97	
SCALE: NTS			
REVISIONS:			
DATE: 7-29-97			
BY: William C. Jones			
PRODUCT CONTROL DIVISION			
BUILDING CODE COMPLIANCE OFFICE			
PREMIER ENTRY SYSTEMS			
MIL C. JORDON			
31-1029-EM-1			
SHEET 2 OF 6			

MATERIALS LIST

ITEM NO.	DESCRIPTION	PART NUMBER	COMMENTS
①	WOOD HEAD JAMB	EM-14	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
②	COMPRESSION WEATHERSTRIP	EM-25	LOCKSCREEN BRAND LOXSEAL 9650-BRONZED
③	ALUMINUM ASTRAGAL	EM-12	PREMDOR BRAND OR EQUIVALENT - 5/8" ALUMINUM ASTRAGAL
④	ALUMINUM-BUMPER THRESHOLD	EM-15	PREMDOR BRAND OR EQUIVALENT - 1 1/4" X 4 9/16"
⑤	TOP CHANNEL	EM-08	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
⑥	STEEL SKIN	26 ga. (017 +004 -000)	MAX TENSILE STRENGTH 50,000 PSI MIN THICKNESS PER TABLE 153, SECTION 15.207
⑦	POLYURETHANE FOAM CORE	BASF FOAM - DENSITY 2.0 TO 2.5 lbs./ft. ³	
⑧	BOTTOM CHANNEL	EM-07	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
⑨	WOOD LOCK BLOCK	EM-09	4" X 9 1/2" MTL. TO BE PINE OR EQUIVALENT
⑩	STRIKE STILE	EM-06	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
⑪	HINGE STILE	EM-05	PREMDOR BRAND - 1 11/16" - 20 GA STEEL
⑫	LOCK PREP FILLER PLATE	EM-10	PREMDOR BRAND - .050" THICK - MTL. TO BE POLYETHYLENE
⑬	4"x4" HINGE	EM-16	HAGER BRAND HINGE OR EQUIVALENT - .097 THICK (STEEL)
⑭	WOOD HINGE JAMB	EM-13	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
⑮	#10-24 X 1/2" F.H.W.S.		(4) SCREWS PER HINGE INTO DOOR
⑯	#10 X 2" F.H.W.S.		(3) SCREWS THROUGH HINGE JAMB INTO SIDELITE JAMB, 8" DOWN FROM TOP, MAX 18" O.C. THEREAFTER (10) SCREWS THROUGH STRIKE JAMB INTO SIDELITE JAMB, 4" DOWN FROM TOP, MAX 8" O.C. THEREAFTER (6) SCREWS THROUGH EACH SIDELITE JAMB INTO SIDELITE, 4" DOWN FROM TOP, MAX 15" O.C. THEREAFTER
⑰	#10 F.H.W.S. V/MINIMUM 1 1/2" THEREAFTER OR 3/16" PER TABS V/MINIMUM 1 1/2" THEREAFTER		REFER TO ELEVATION VIEW, FOR # OF SCREWS USED AND LOCATIONS
⑱	#10 X 3/4" F.H.W.S.		(2) SCREWS PER HINGE INTO JAMB
⑲	#8 X 2" F.H.W.S.		(2) SCREWS AT EACH STRIKE PLATE
⑳	LOCKSET		KWIKSET BRAND 200 LOCK OR HARLOC BRAND 100 LOCK
㉑	#10 X 1 3/4" F.H.W.S.		(2) SCREWS PER HINGE INTO JAMB
㉒	WOOD SIDELITE JAMB	EM-18	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
㉓	22" X 64" SINGLE PANEL GLASS	EM-19	TEMPERED GLASS IN POLYPROPYLENE FRAME - DC-1643 - (DDL-23)
㉔	SIDELITE TRIM (WOOD)	EM-20	5/16" X 1/2" MTL. TO BE PINE OR EQUIVALENT
㉕	WOOD CASING	EM-21	1/8" x 1" MTL. TO BE PINE OR EQUIVALENT - ITEMS ARE HOLDINGS USED FOR "SIDE BY SIDE JAMBS" AS MULLIONS
㉖	WOOD SIDELITE HEAD JAMB	EM-22	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
㉗	WOOD SIDELITE BASE	EM-23	1 1/4" X 4 9/16" MTL. TO BE PINE OR EQUIVALENT
㉘	POLYPROPYLENE LITE FRAME	DC-1643, DDL-2	HP Polypropylene by DDL
㉙	#6 X 1 1/2" PAN HEAD SCREWS		SCREW SPACING TO BE 3" IN FROM EACH CORNER AND NOT 18" PER FRAME TO EXCEED 14" O.C. THERE AFTER.
㉚	SIDELITE STILES	EM-25	15/16" X 1 11/16" MTL. TO BE PINE OR EQUIVALENT
㉛	PIN NAIL		3/4" LONG NAIL, 4" IN FROM END, MAX 8" O.C. THEREAFTER, USED ON MULLIONS AND TRIM


#995 DOW SILICONE

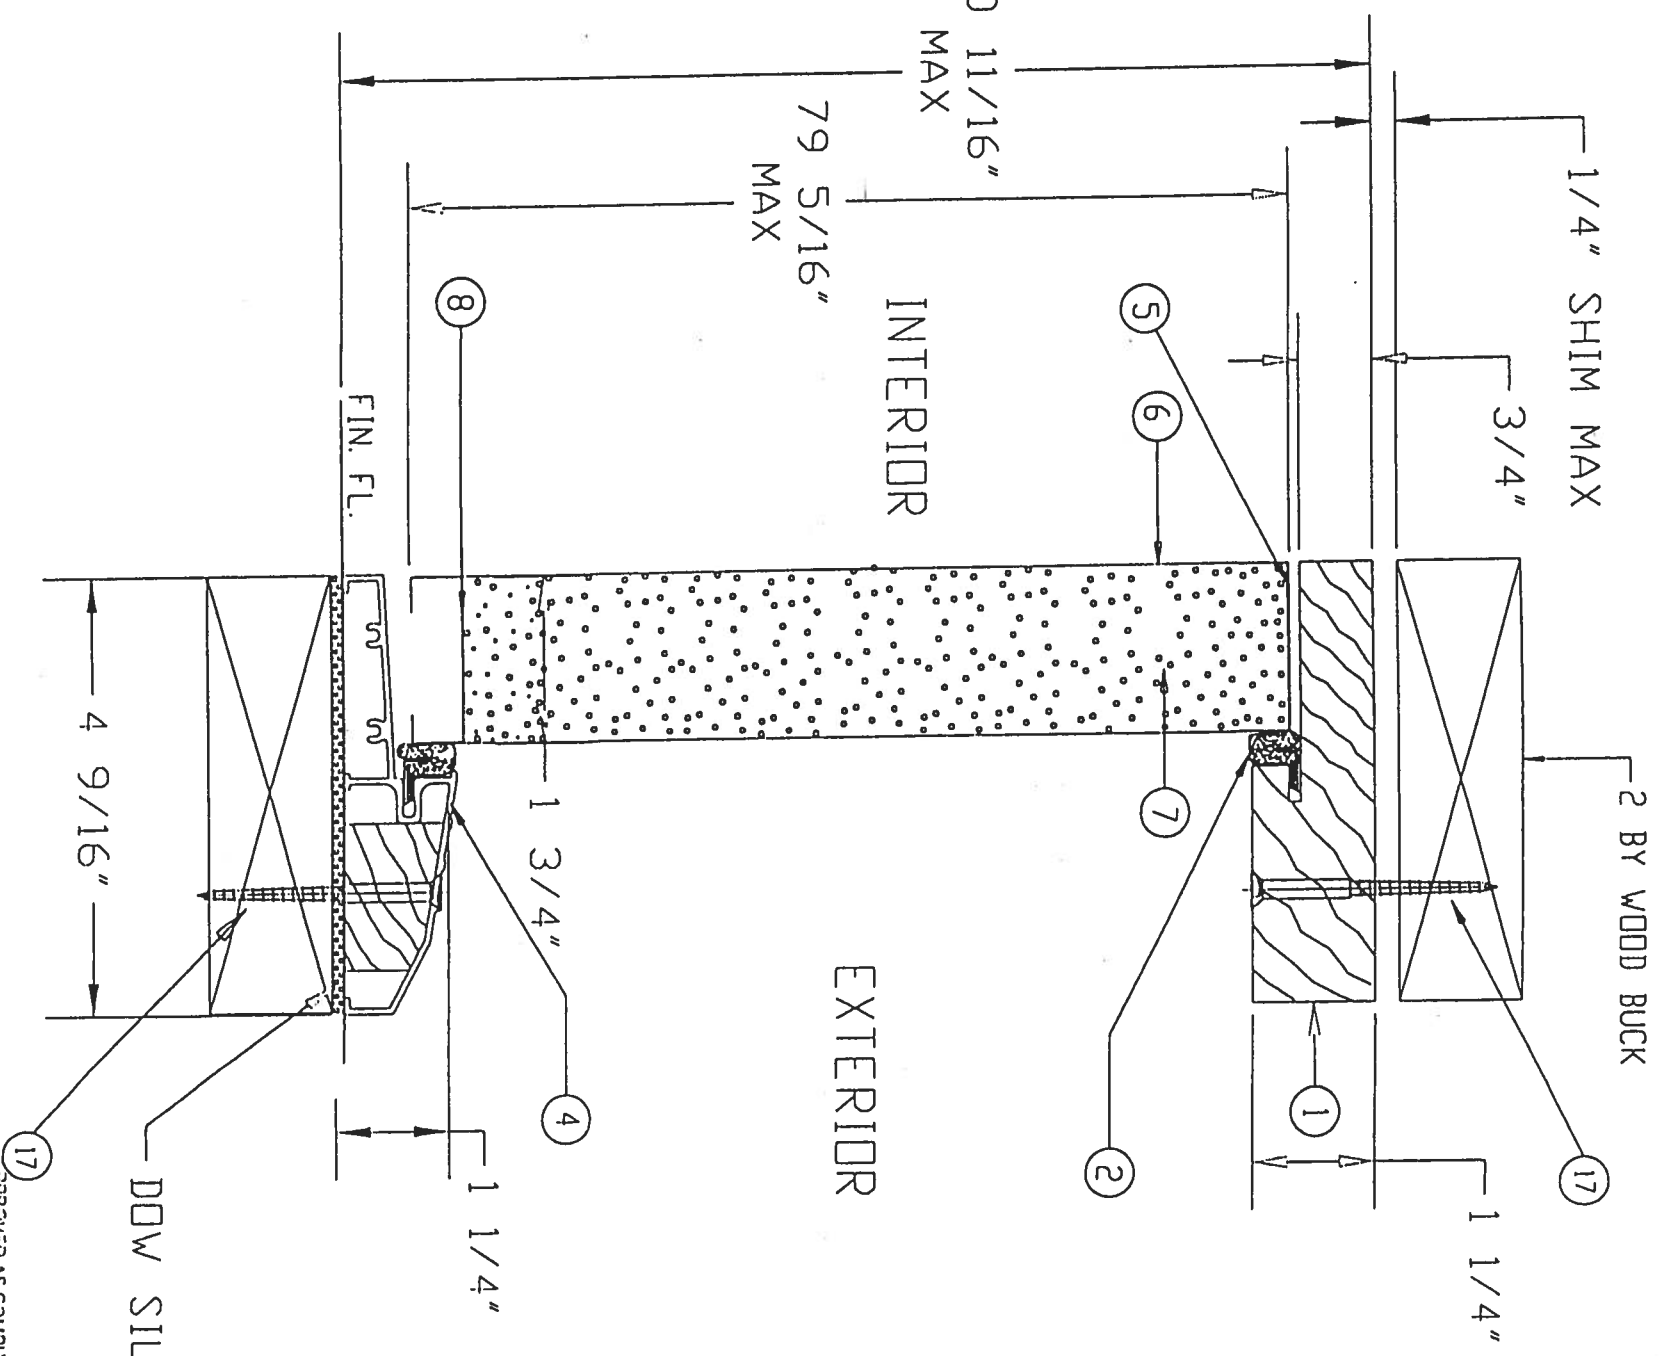

SECTION B-B

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **JUN 05 2001**
BY *W. J. JEFFERSON*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

ENGINEER:	DATE: 7-29-97	DC:	ANG:	B:	DADE COUNTY MODIFICATIONS	11/11/01	JD
LIMITS: UNLESS NOTED, FRAC. :				A:	ADDED PAGE 5 (DOOR OPTIONS)	10-1-98	RS
EXTRUSIONS: UNLESS NOTED, STD. COMPL. TOL'S :				LTR:	REVISIONS	DATE	BY
DR. BY: R.S.	DATE: 7-29-97	PARI NAME: ENTERGY STEEL EDGE DOOR (B-B)	SCALE:				
PREMDOR ENTRY SYSTEMS		31-1029-EM-1					
911 E. JEFFERSON		SHEET 3 OF 6					
PILTSBURG, KS 66762							

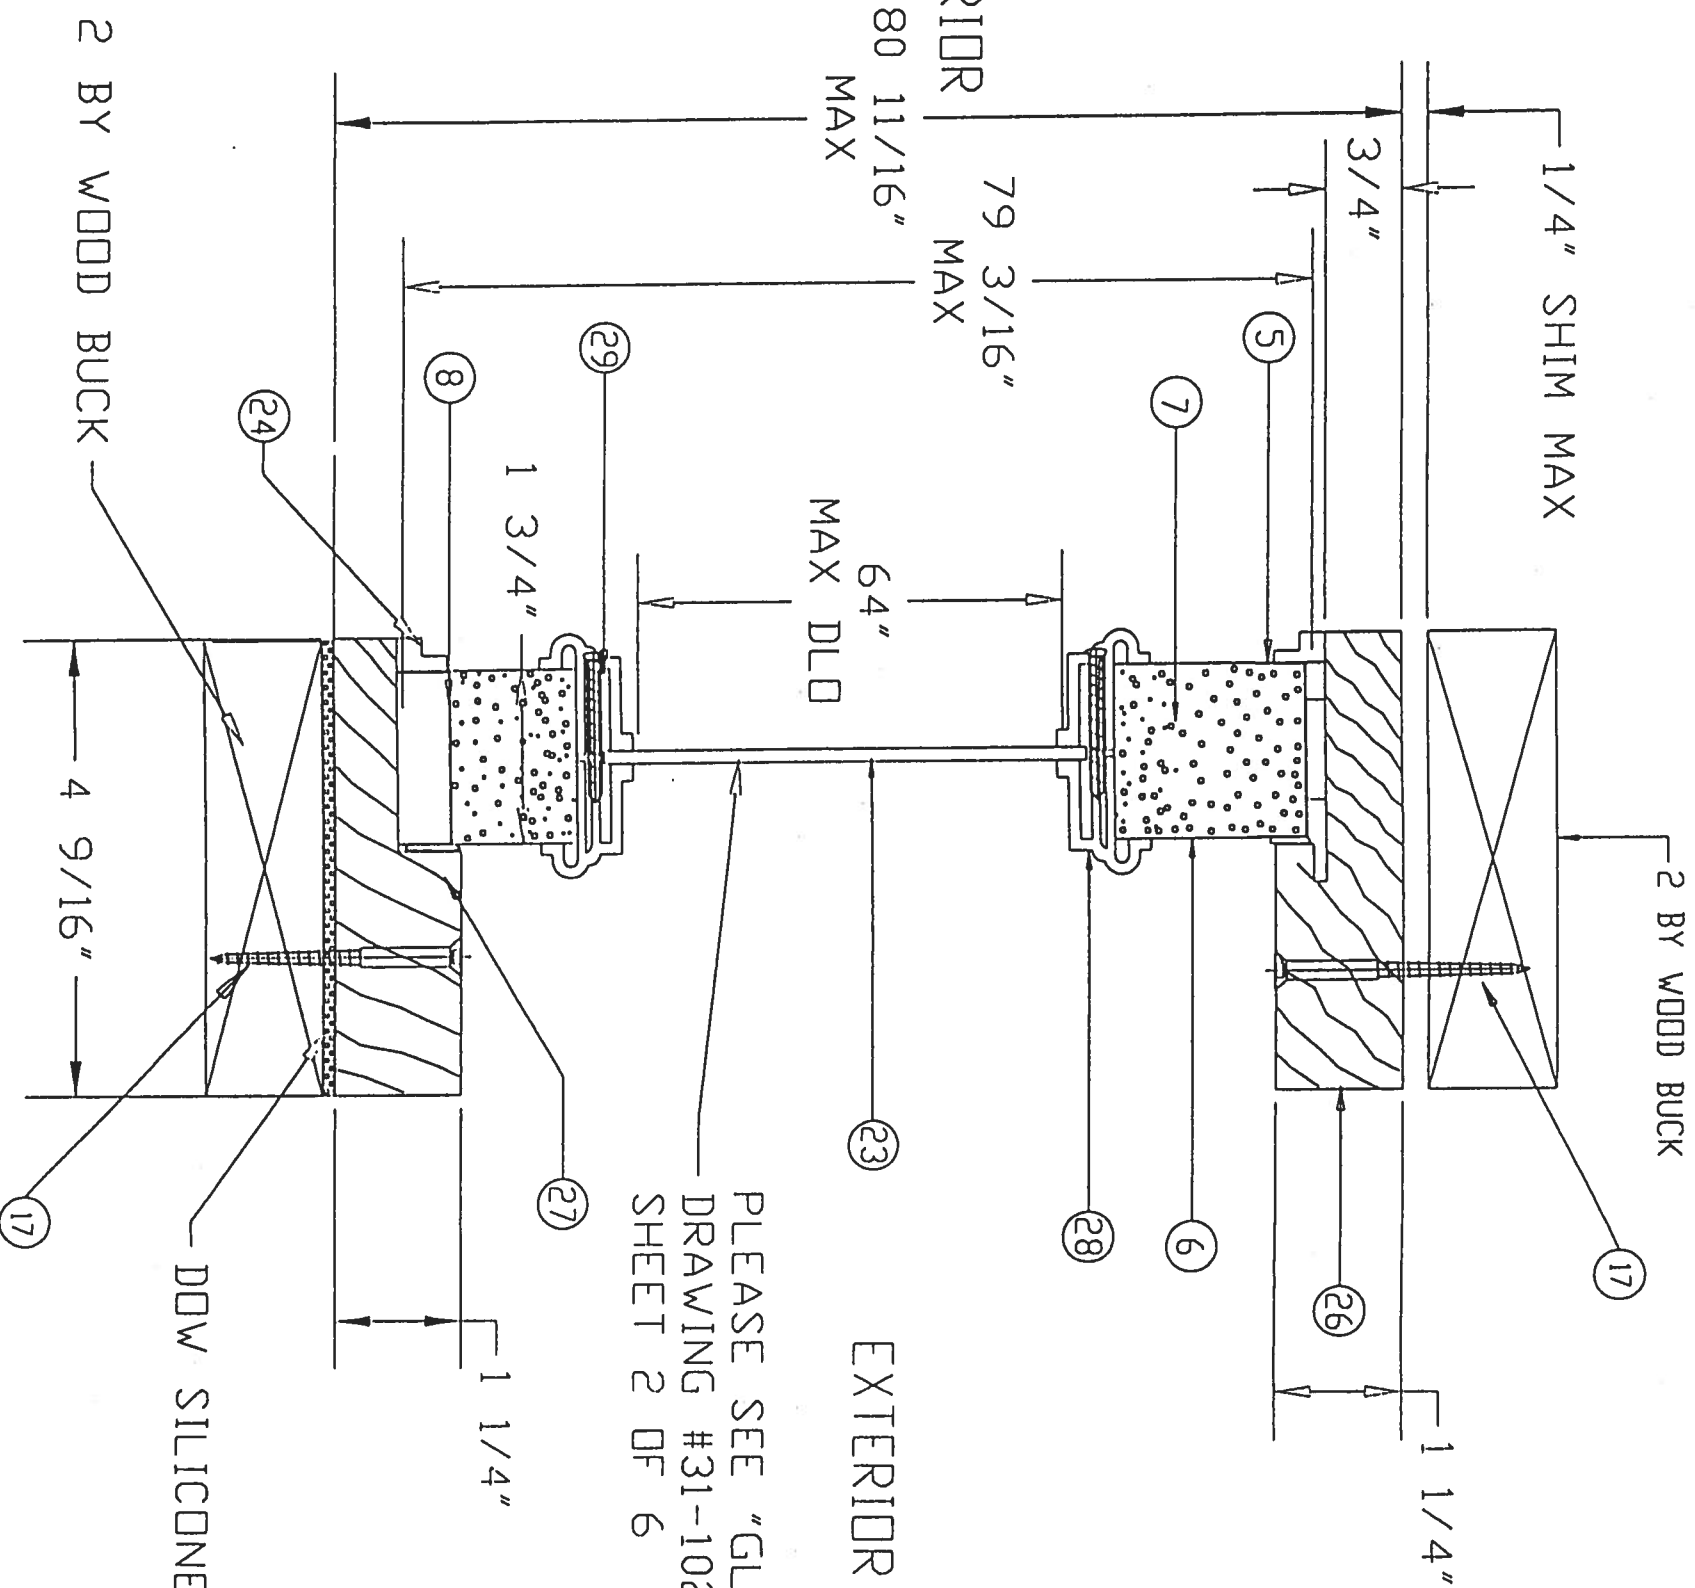

PLEASE SEE "GLAZING DETAIL"
DRAWING #31-1029-EM-I
SHEET 2 OF 6

SECTION C-C


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **JUN 05 2004**
BY *M. J. JEFFERSON*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

LIMITS: UNLESS NOTED, FRAC. :	DEC. :	ANG. :
EXTRUSIONS: UNLESS NOTED, STD. COM'L. IDLS.		
ENGINEER:		
D	DADE COUNTY MODIFICATIONS	1/11/01 JD
C	MATERIAL WAS POLYSTYRENE	6-2-99 RS
B	ADDED PAGE 5 (DOOR OPTIONS)	10-1-98 RS
A	ADD SCREWS TO LITE FRAME & MATERIAL LIST	12-18-97 R.S.
LIR	REVISIONS	DATE BY


DR. BY: R.S.	DATE: 7-29-97	PART NAME: ENERGY METAL EDGE SILL/LITE (C-C)	SCALE:
--------------	---------------	--	--------

PREMDOR ENTRY SYSTEMS
911 E. JEFFERSON
PITTSBURG, KS. 66762


OTHER DOOR CONFIGURATIONS

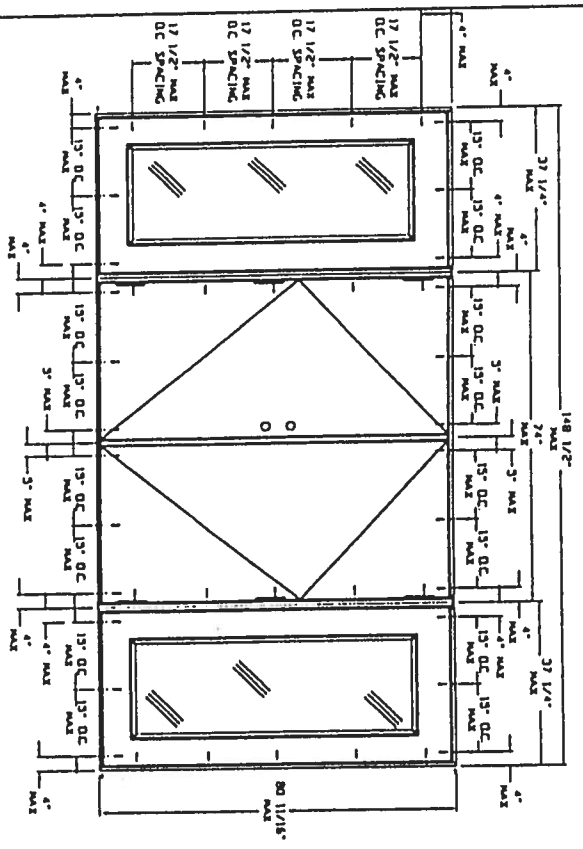


XXXX

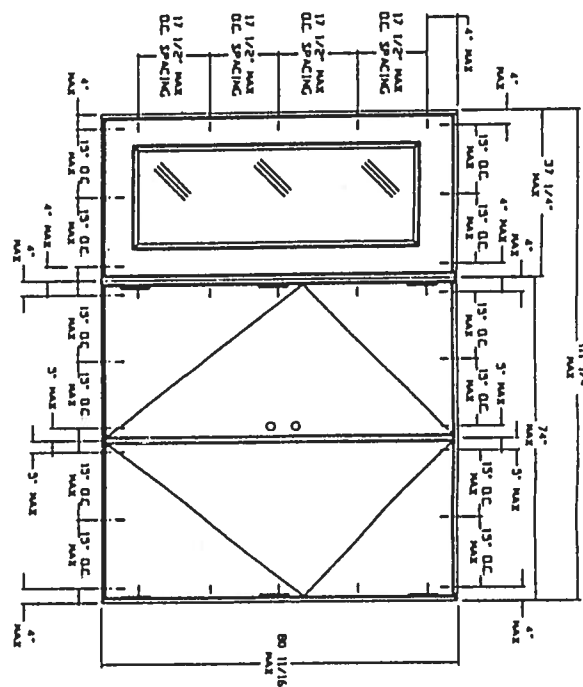


XXX

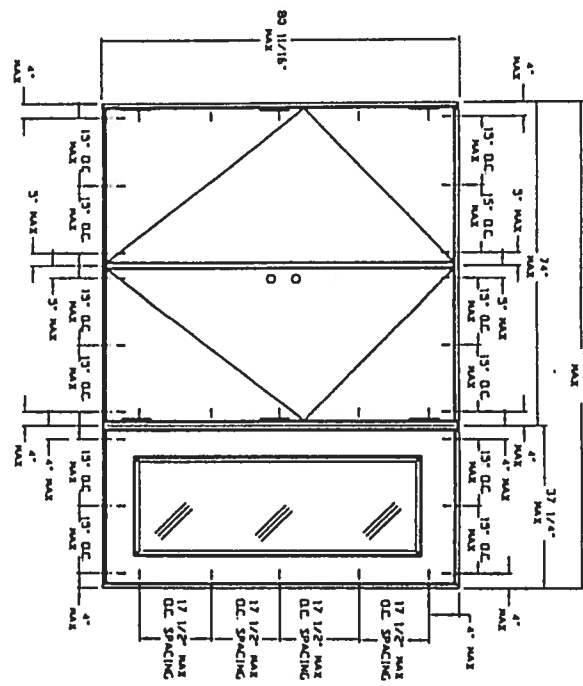


XXD

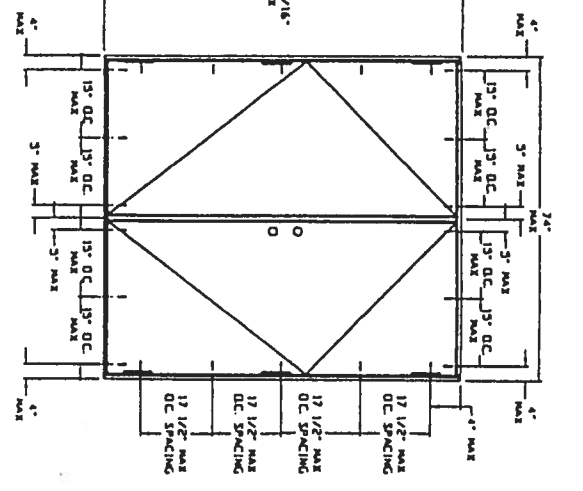


XX

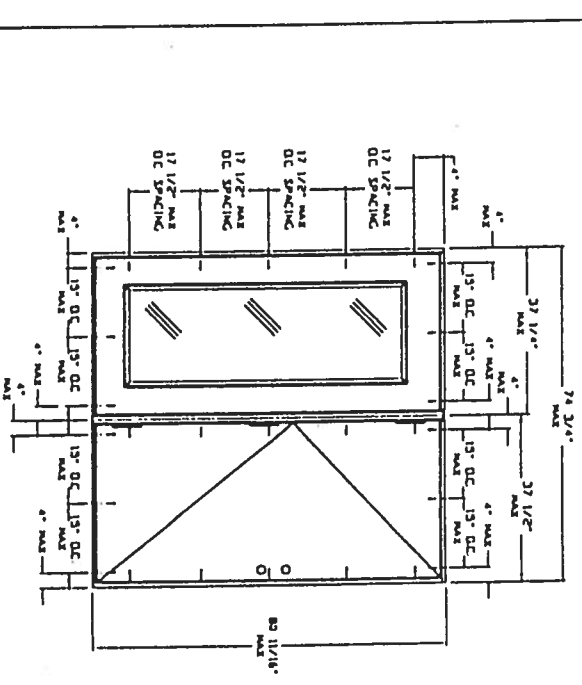


DX

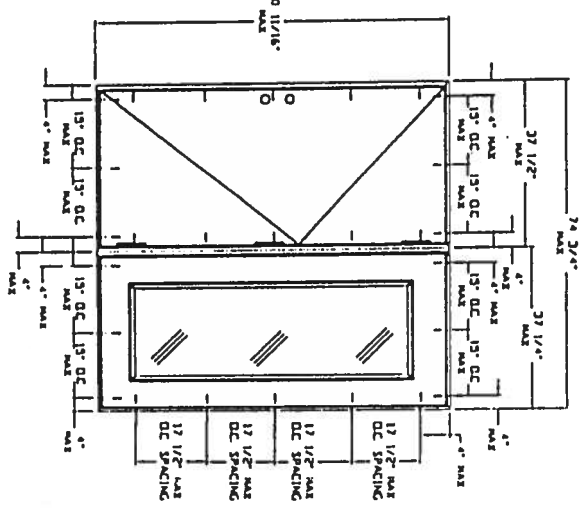

XD

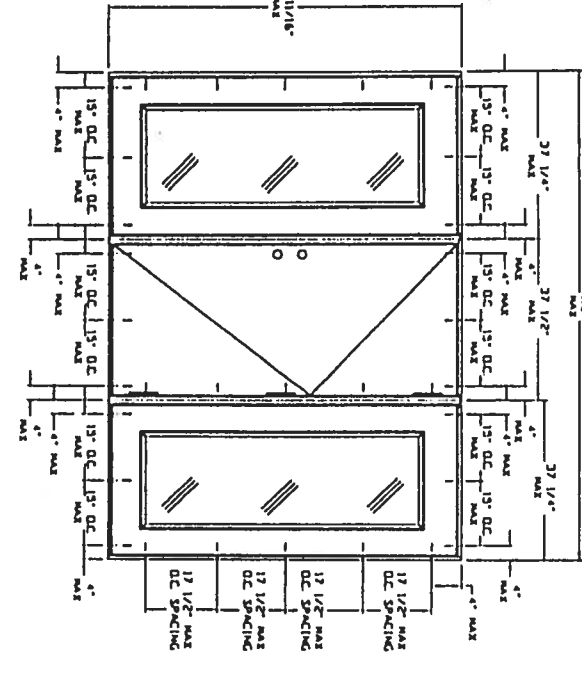

DXD

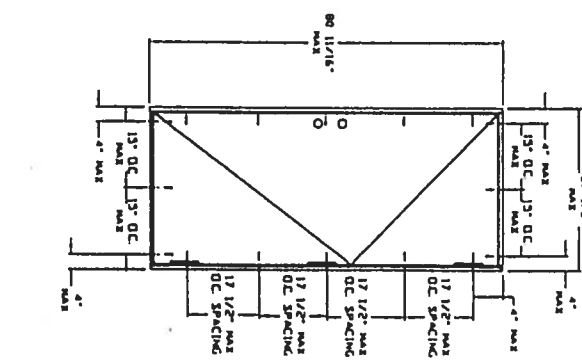


X



APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2007
BY: *Matthew Ellis*
FRODOUF CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :			
EXTENSIONS: UNLESS NOTED, STD. CONCL. TOL'S			
ENGINEER:			
DR. BY J.D.	DATE 1-11-01	PART NAME:	REVISIONS
PREMOR ENTRY SYSTEMS		SCALE:	DATE BY
911 E. JEFFERSON			
PITTSBURG, KS 66162			
31-1029-EM-1			
SHEET 5 OF 6			

OTHER DOOR PANEL STYLES

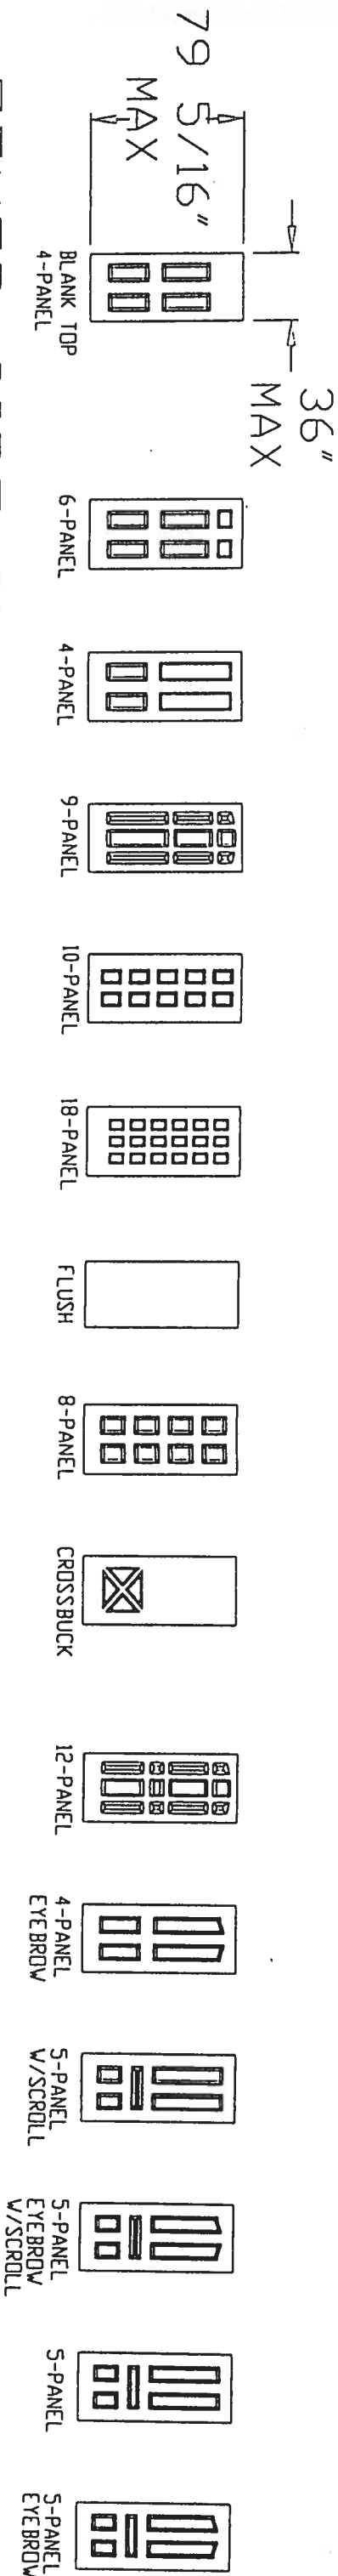



OTHER SIDELITE STYLES

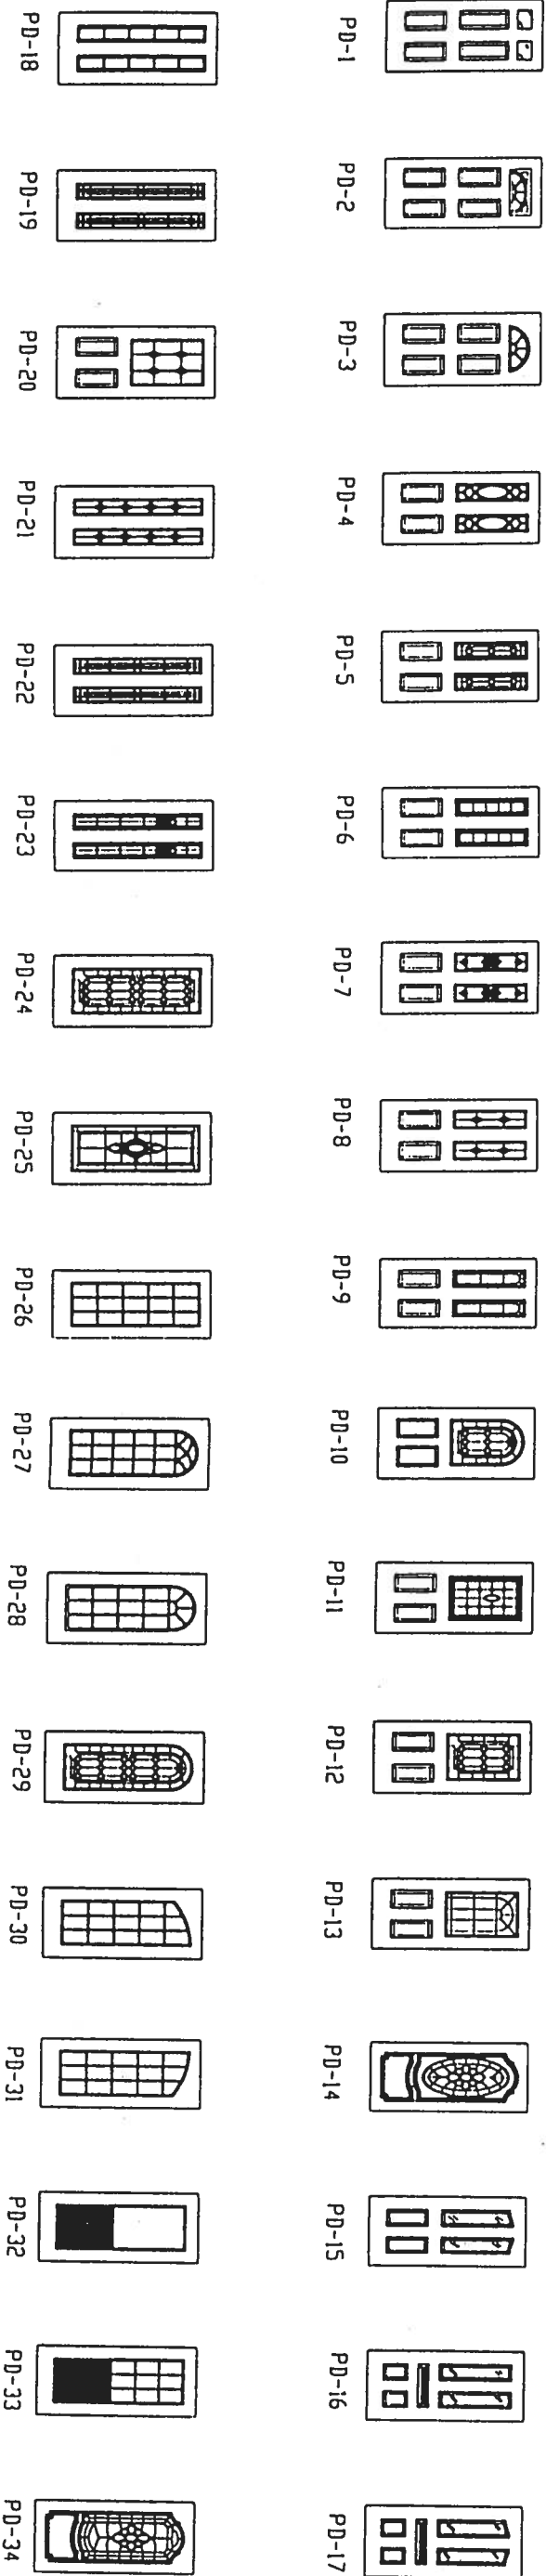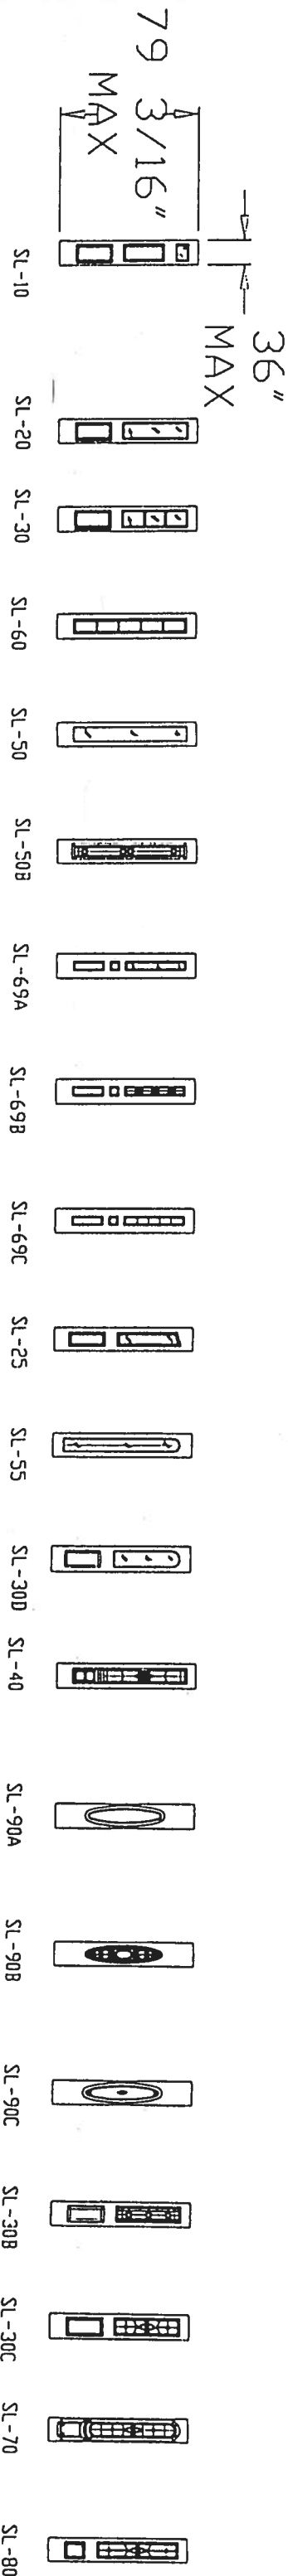

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 05 2001
BY *Manuel J. Jerez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO 01-0314.23

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :	
EXCEPTIONS: UNLESS NOTED, STD. COM. 10.3.	
ENGINEER:	LIR
DR. BY J.D.	DATE 1/15/01
PREMOR ENTRY SYSTEMS	
911 E. JEFFERSON	
PITTSBURGH, KS 66762	
31-1029-EM-1	
SHEET 6 OF 6	

#10 x 1 1/2" MINIMUM EMBEDMENT
(12) PER HEAD & SILL, (5) PER JAMB
ALTERNATE: 3/16" PFH TAPCONS
#1 1/2" MINIMUM EMBEDMENT

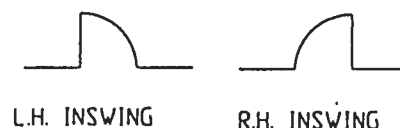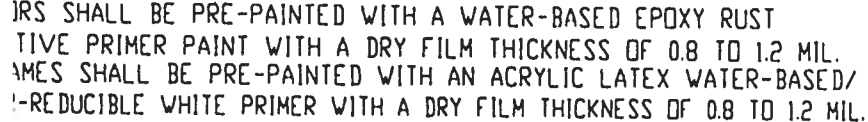

LIMITS: UNLESS NOTED, FRAC. : DEC. : ANG. :		DADE COUNTY MODIFICATIONS		11/11/00	JD
EXTRUSIONS: UNLESS NOTED, STD. COM'L. TOL'S.		B	ADDED PAGE 5 (DOOR OPTIONS)	10-1-98	RS
ENGINEER:		A	ADD OTHER DOOR CONFIGURATIONS	12/18/97	RS
		LTR.	REVISIONS	DATE	BY
DR. BY R.S.		PART NAME: ENERGY METAL EDGE DOUBLE DOOR VENTILATES			
DATE 7-29-97		MATERIAL:		SCALE: N.T.S.	
PREMDOR ENTRY SYSTEMS			31-1029-EM-I		
911 E. JEFFERSON			SHEET 1 OF 6		
PITTSBURG, KS. 66762			REVISION LETTER C		