



ONE STORY WALL SECTION
SCALE: 3/4" = 1'-0"

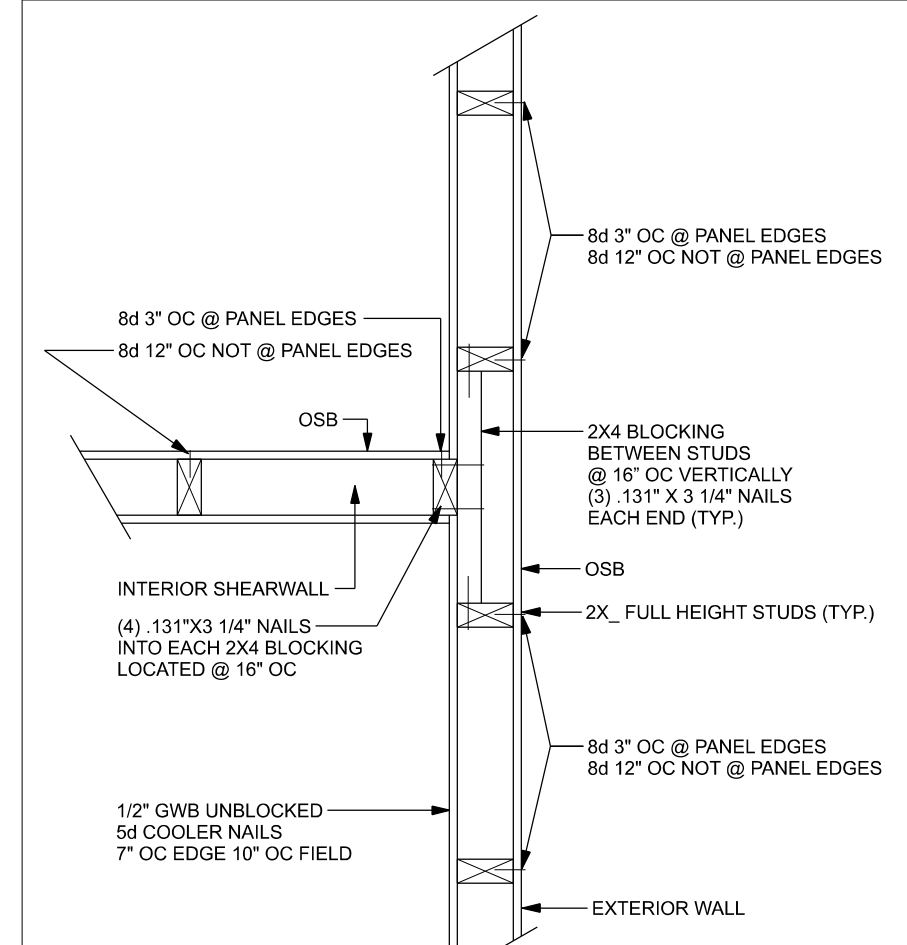


(TYP.) INTERSECTING WALL FRAMING
WOOD FRAME

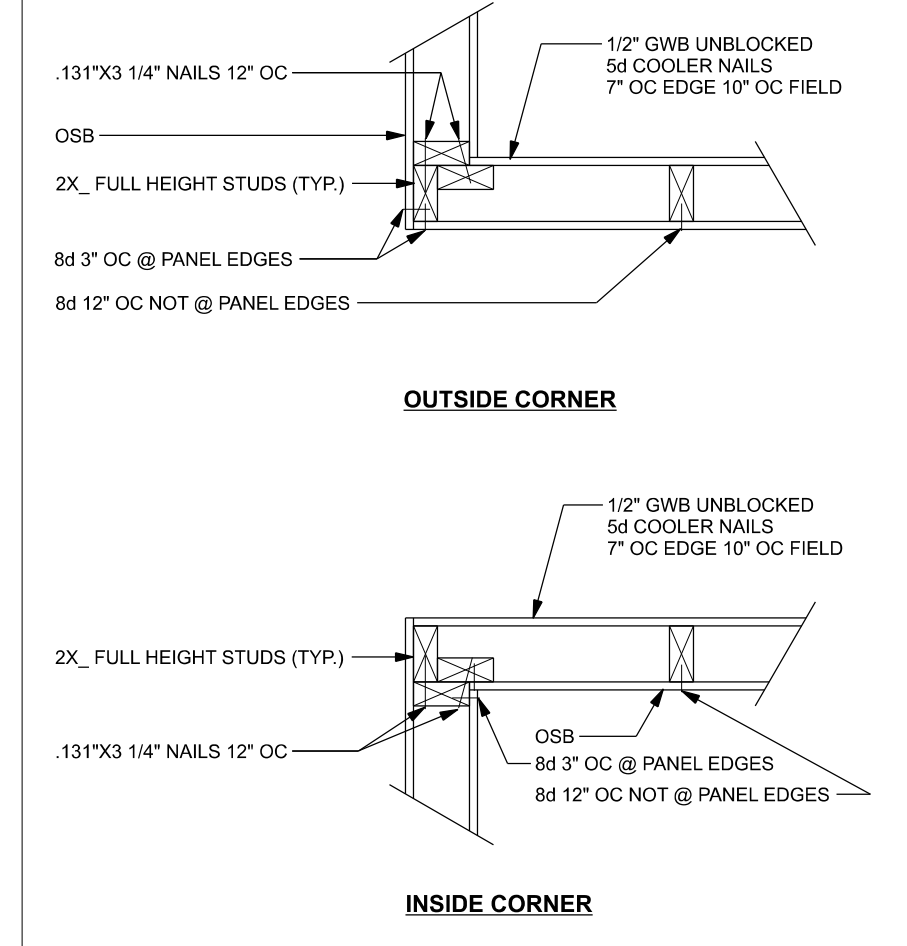

(TYP.) CORNER FRAMING
WOOD FRAME

ROOF SHEATHING FASTENING TABLE (RAFTER / TRUSS SG = 0.49)					
Wind Speed	Sheathing Thickness Plywood Or OSB	Required Nail	Nail spacing along panel edges	Nail spacing along intermediate supports in the panel field	
120 mph Exp. B	7/16"	ASTM F1667 RSR-01 (2 3/8" x 0.113")	6" oc	12" oc	
120 mph Exp. C	7/16"	ASTM F1667 RSR-01 (2 3/8" x 0.113")	6" oc	6" oc	
120 mph Exp. D	19/32"	ASTM F1667 RSR-03 (2 1/2" x 0.131") or ASTM F1667 RSR-04 (3" x 0.120")	6" oc	6" oc	
130 mph Exp. B	7/16"	ASTM F1667 RSR-01 (2 3/8" x 0.113")	6" oc	6" oc	
130 mph Exp. C	19/32"	ASTM F1667 RSR-03 (2 1/2" x 0.131") or ASTM F1667 RSR-04 (3" x 0.120")	6" oc	6" oc	
130 mph Exp. D	19/32"	ASTM F1667 RSR-03 (2 1/2" x 0.131") or ASTM F1667 RSR-04 (3" x 0.120")	6" oc	6" oc	
140 mph Exp. B	7/16"	ASTM F1667 RSR-01 (2 3/8" x 0.113")	6" oc	6" oc	
140 mph Exp. C	19/32"	ASTM F1667 RSR-03 (2 1/2" x 0.131") or ASTM F1667 RSR-04 (3" x 0.120")	6" oc	6" oc	
140 mph Exp. D	19/32"	ASTM F1667 RSR-03 (2 1/2" x 0.131") or ASTM F1667 RSR-04 (3" x 0.120")	6" oc	6" oc	

Note:
For sheathing located a minimum of 4 feet from the perimeter edge of the roof, including a feet on each side of ridges and hips, nail spacing is permitted to be 6 inches on center along panel edges and 6 inches on center along intermediate supports in the panel field.
Note:
This table specifies the code minimum thickness of roof sheathing. The thickness of the sheathing may need to be increased based in the type of roofing material being used. See manufacturer Florida product approval.

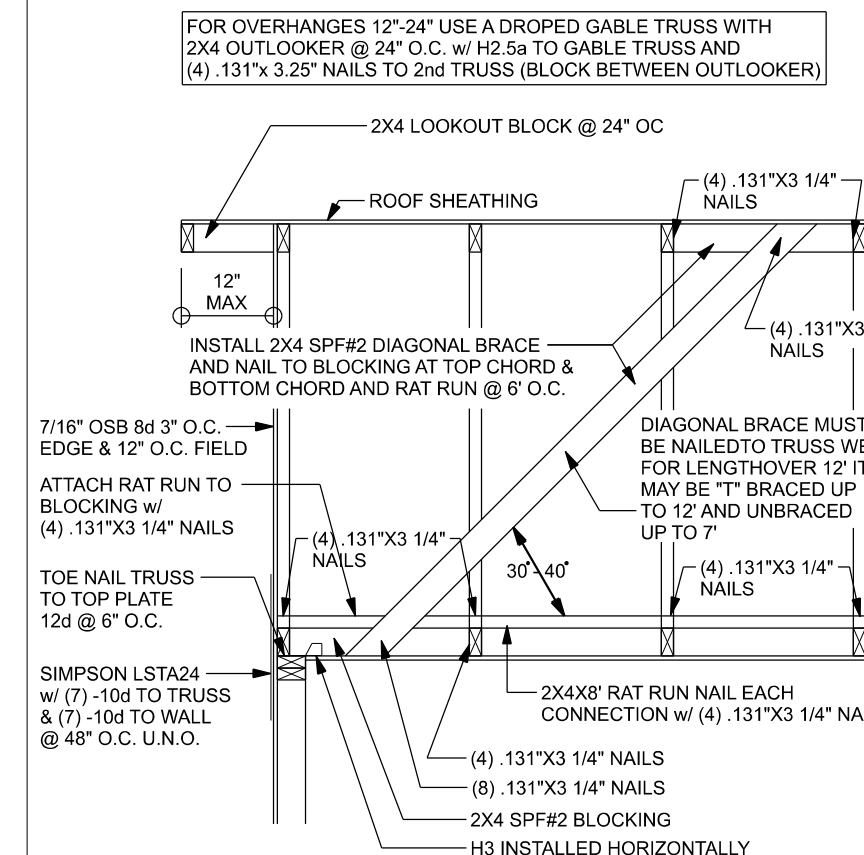

(TYP.) GABLE BRACING DETAIL
WOOD FRAME

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME


OPTION: 1 (BUCKET)

HEADER STRAP TABLE			
Uplift	Top Connection	Bottom Connection	
< 1235	LSTA24, 14-10d wrap over plate	LSTA24, 14-10d wrap under plate	
< 1455	MSTA24, 18-10d header to jacks	DIT22	
< 1800	(2) MSTA24, 18-10d header to jacks	DIT22	
< 2910	(2) MSTA24, 18-10d header to jacks	HTT4	


SILL PLATE SPANS FOR 10'-0" WALL HEIGHT				
DESIGN WIND SPEED	MAX. SPANS FOR SPF #2	MAX. SPANS FOR SPF #2	MAX. SPANS FOR SPF #2	MAX. SPANS FOR SPF #2
130 MPH EXP. C	5'-3"	7'-9"	7'-7"	11'-3"

BASED ON WFCM TABLE A-3.2.8
FOR OTHER WALL HEIGHTS (H) SILL SPAN SHALL BE DIVIDED BY (H/10)

TYPICAL HEADER STRAPING DETAIL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

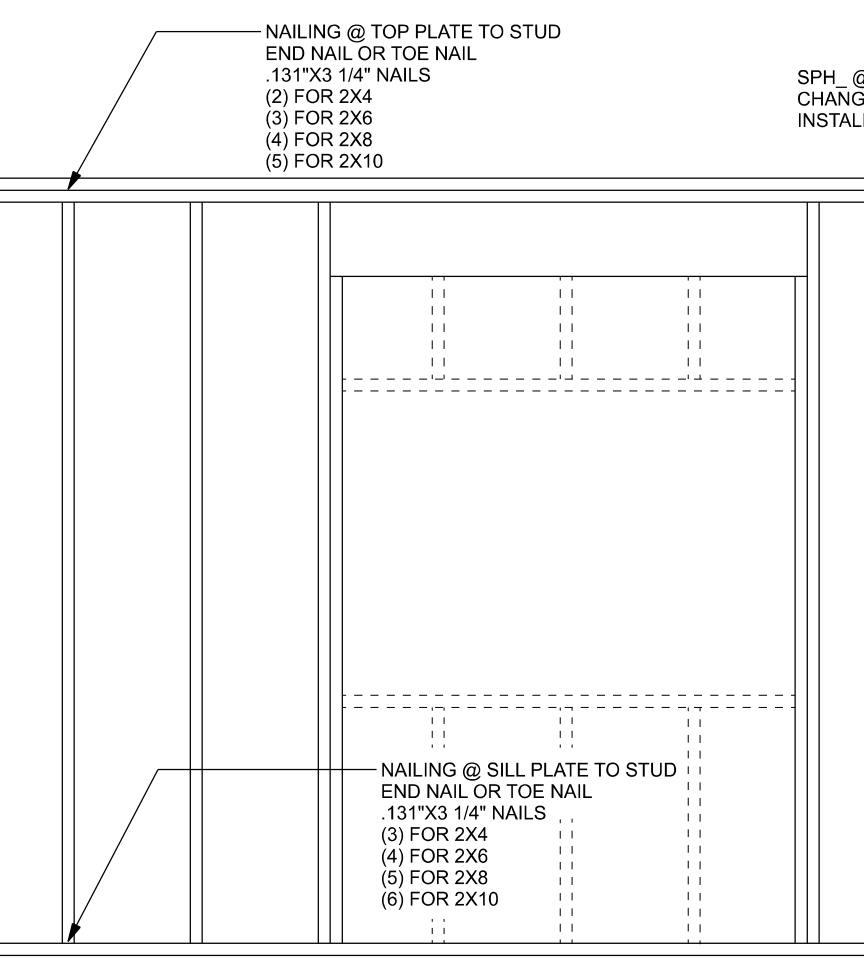


(TYP.) WALL CONNECTIONS
ONE STORY WOOD FRAME

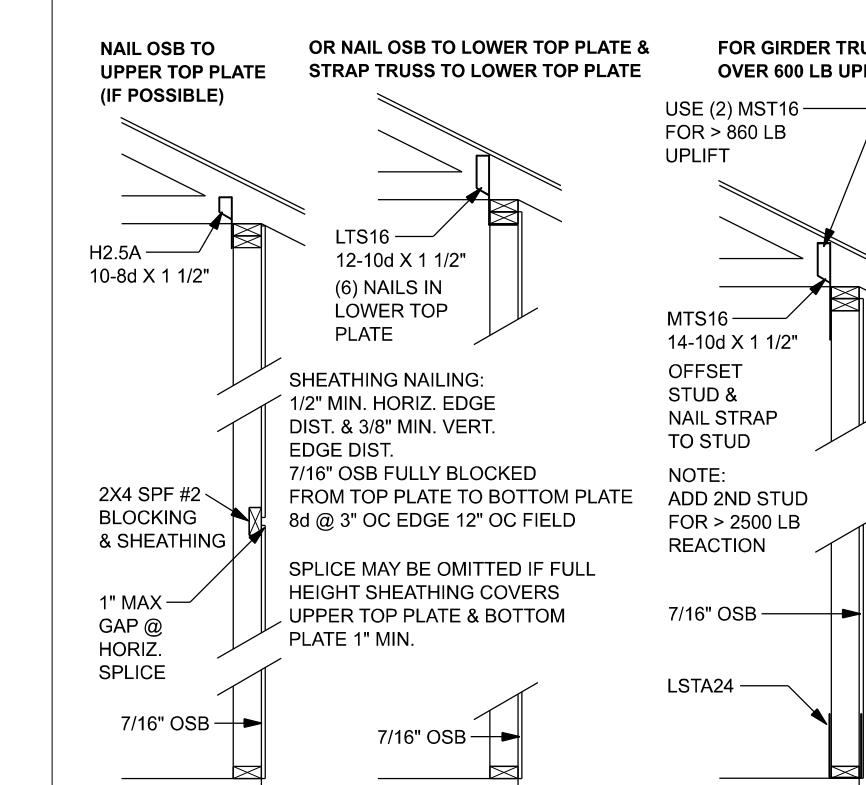

(TYP.) PORCH POST
ONE STORY WOOD



(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

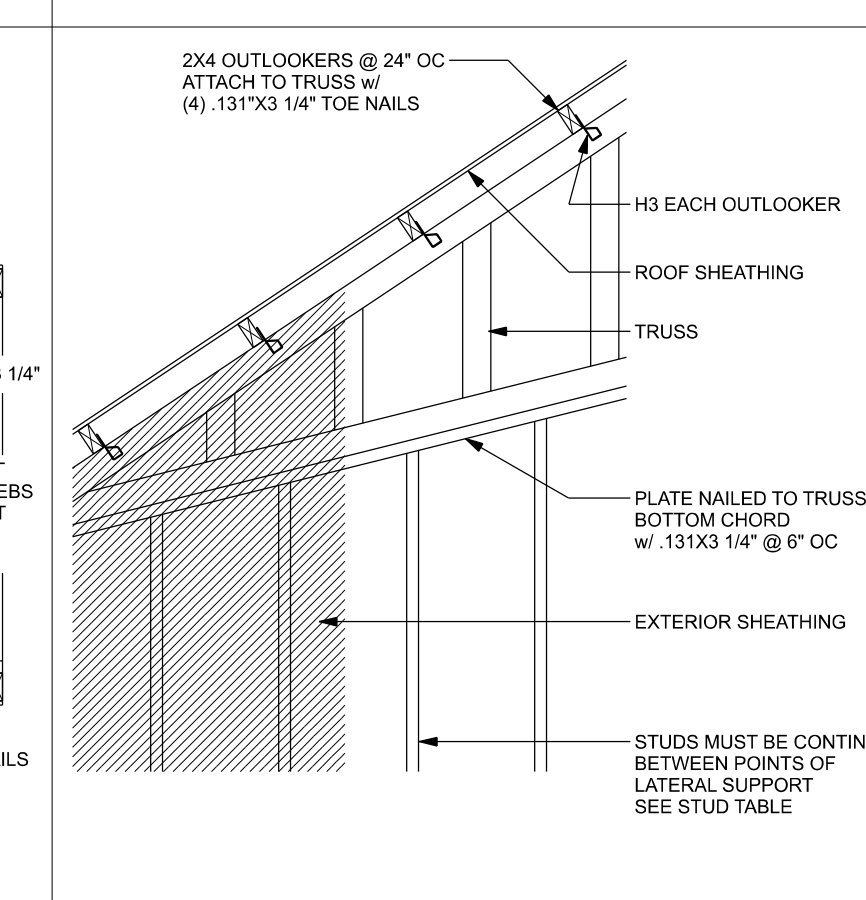

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME


OPTION: 2 (POCKETED)

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

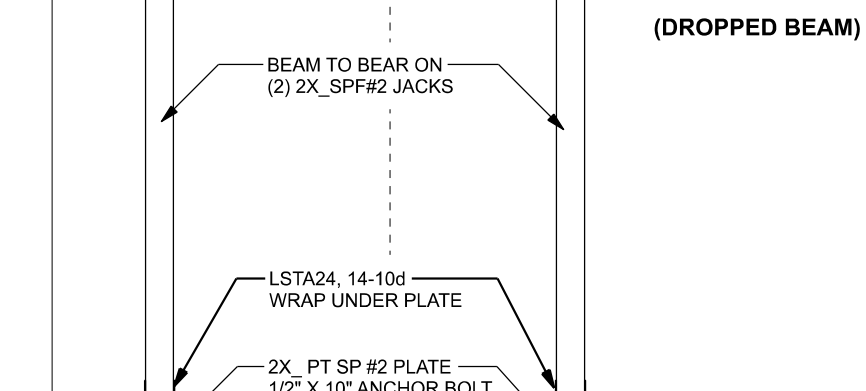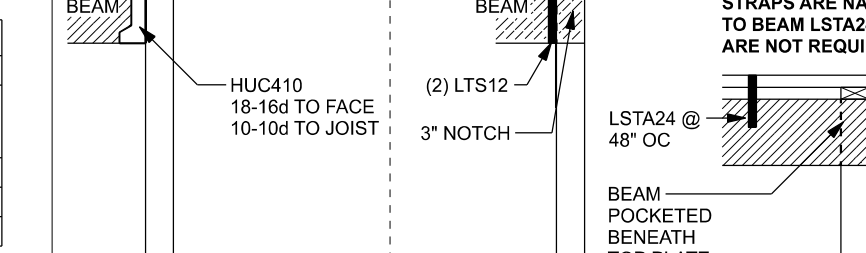


(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

OPTION: 1 (BUCKET)

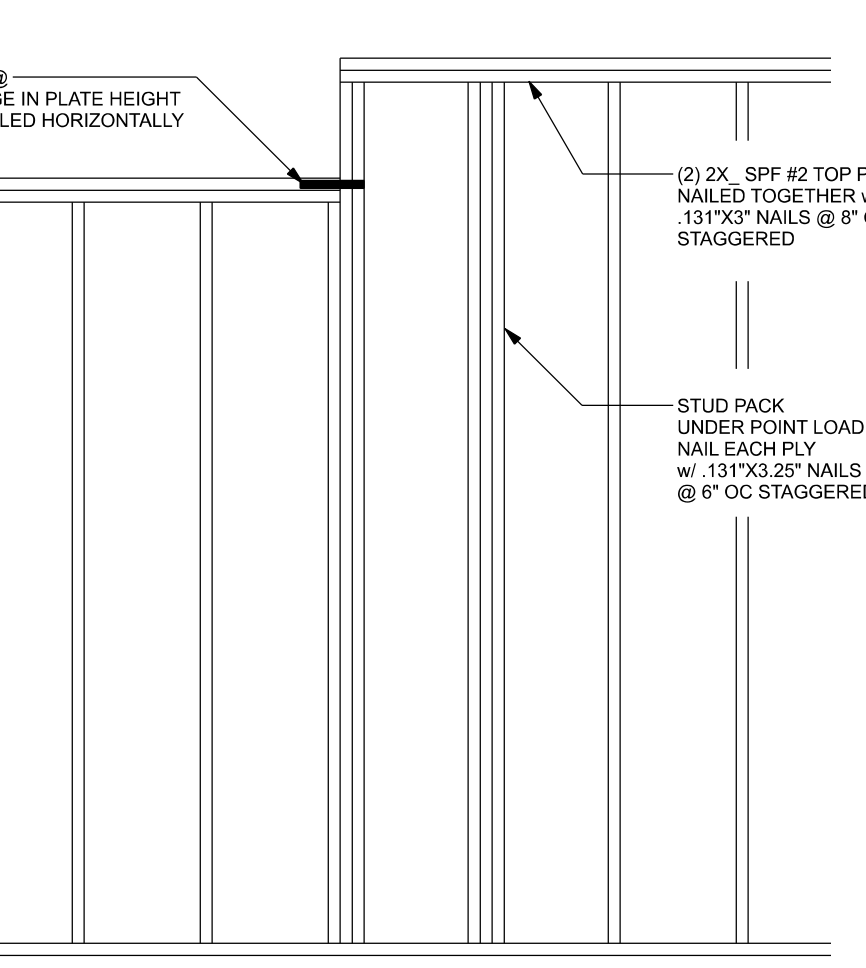


(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

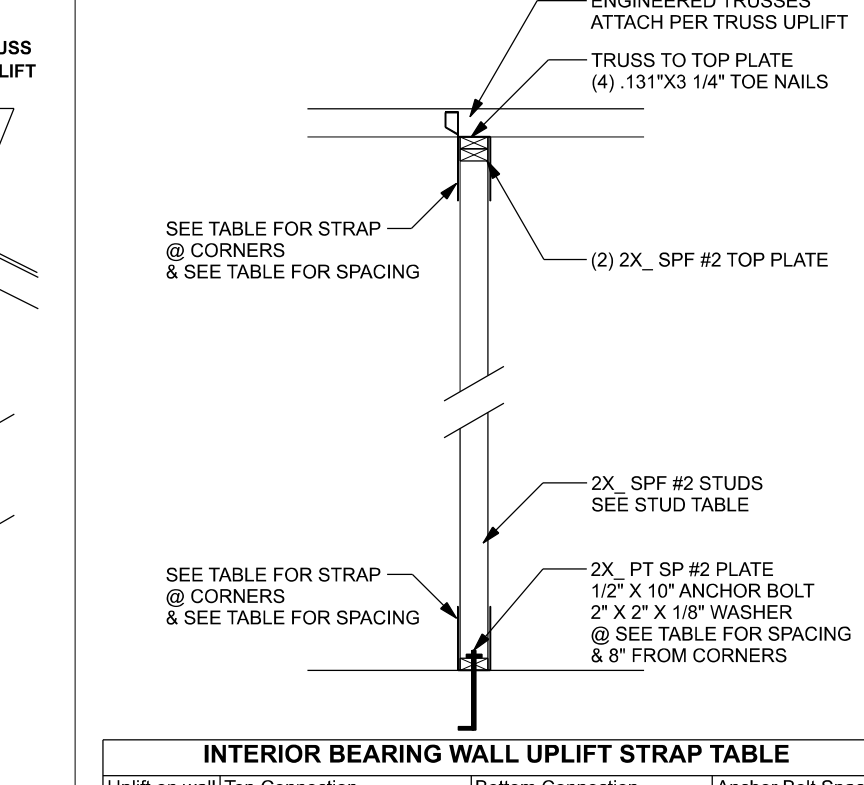

(TYP.) PORCH POST
ONE STORY WOOD



(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

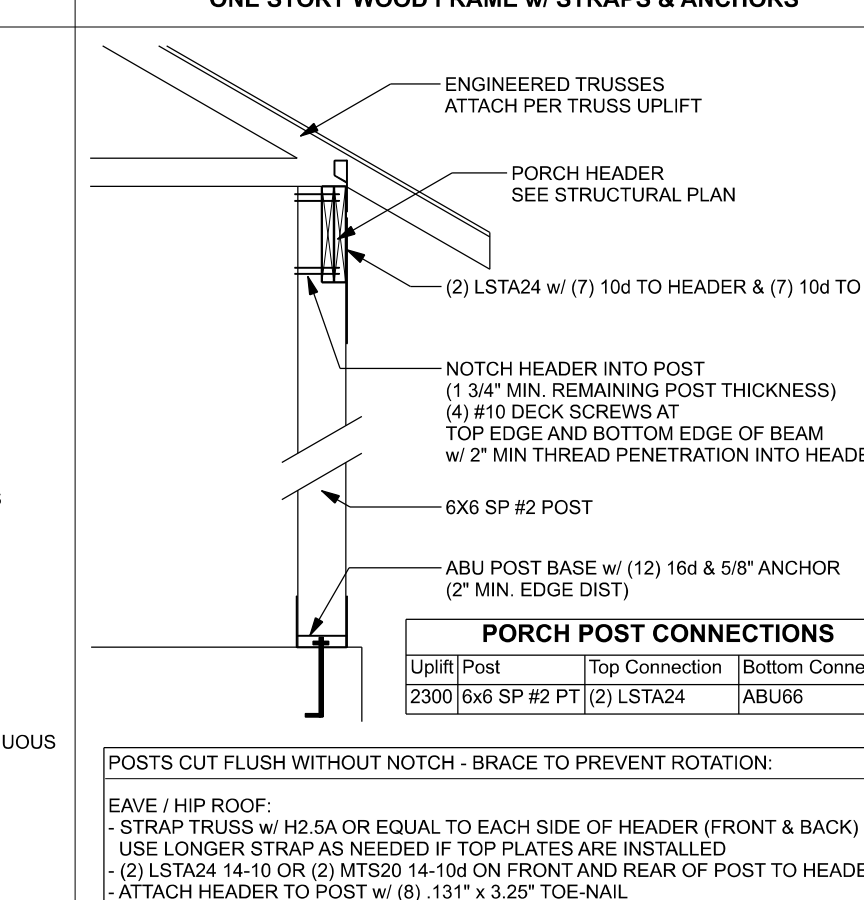

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME


OPTION: 2 (POCKETED)

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

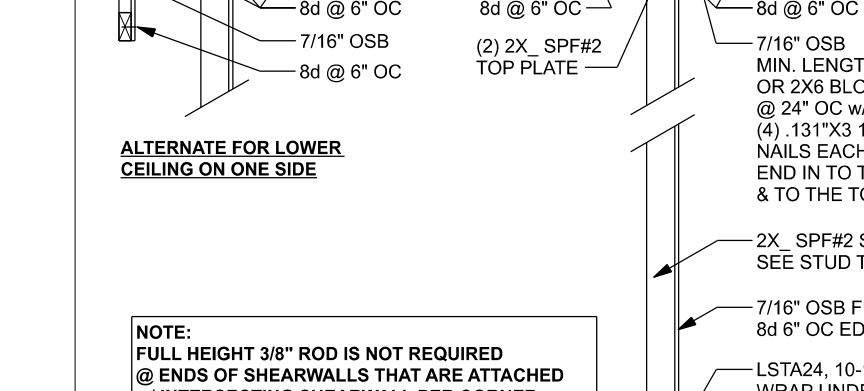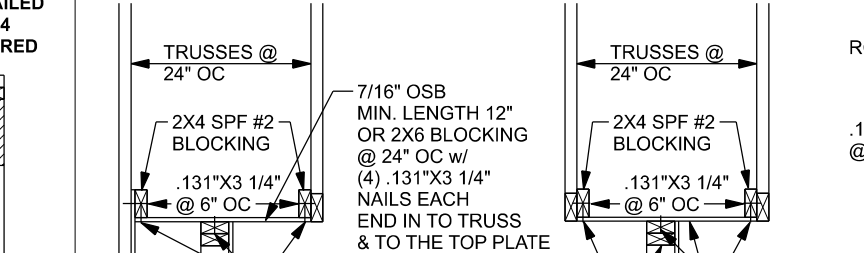

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

OPTION: 1 (BUCKET)




(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

CONNECTOR TABLE					
Uplift SP	Uplift SPF	Truss Connector	To Plate	To Truss/Rafter	
615	485	SDWC15600			
415	290	H3	4-8d x 1 1/2"	4-8d x 1 1/2"	
575	496	H2.5A	5-8d x 1 1/2"	5-8d x 1 1/2"	
1340	1015	H10A	9-10d x 1 1/2"	9-10d x 1 1/2"	
720	620	LTS12-20	6-10d x 1 1/2"	6-10d x 1 1/2"	
1000	860	MTS12-30	7-10d x 1 1/2"	7-10d x 1 1/2"	
1450	1245	HTS20-30	12-10d x 1 1/2"	12-10d x 1 1/2"	
Uplift SP Uplift SPF Strap Ties					
			To One Member	To Other Member	
1235	1235	LSTA21	6-10d	6-10d	
1640	1455	MSTA24	9-10d	9-10d	
1030	1030	CS20	7-10d	7-10d	
Uplift SP Uplift SPF Stud Plate Ties					
			To Stud	To Plate	
585	535	SP1	6-10d	4-10d	
1065	605	SP2	6-10d	6-10d	
771	771	LSTA24	10-10d	wrap under or over plate	
1235	1235	LSTA24	14-10d	wrap under or over plate	
Uplift SP Uplift SPF Holdowns @ Stewall					
			To Stud / Post	Anchor	
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x12" Titen HD	
4235	3640	HTT4	16-16d x 1 1/2"	1/2"x12" Titen HD	
Uplift SP Uplift SPF Holdowns @ Mono					
			To Stud / Post	Anchor	
1825	1800	DTT22	8-SDS 1/4"x1 1/2"	1/2"x8" Titen HD	
4235	3640	HTT4	16-16d x 1 1/2"	1/2"x12" Titen HD	
Uplift SP Uplift SPF Post Bases @ Stewall					
			To Post	Anchor	
2200		ABU44	12-16d	5/8"x12" Drill & Epoxy	
2300		ABU66	12-16d	5/8"x12" Drill & Epoxy	
Uplift SP Uplift SPF Post Bases @ Mono					
			To Post	Anchor	
2200		ABU44	12-16d	5/8"x7" Drill & Epoxy	
2300		ABU66	12-16d	5/8"x7" Drill & Epoxy	

(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS



(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

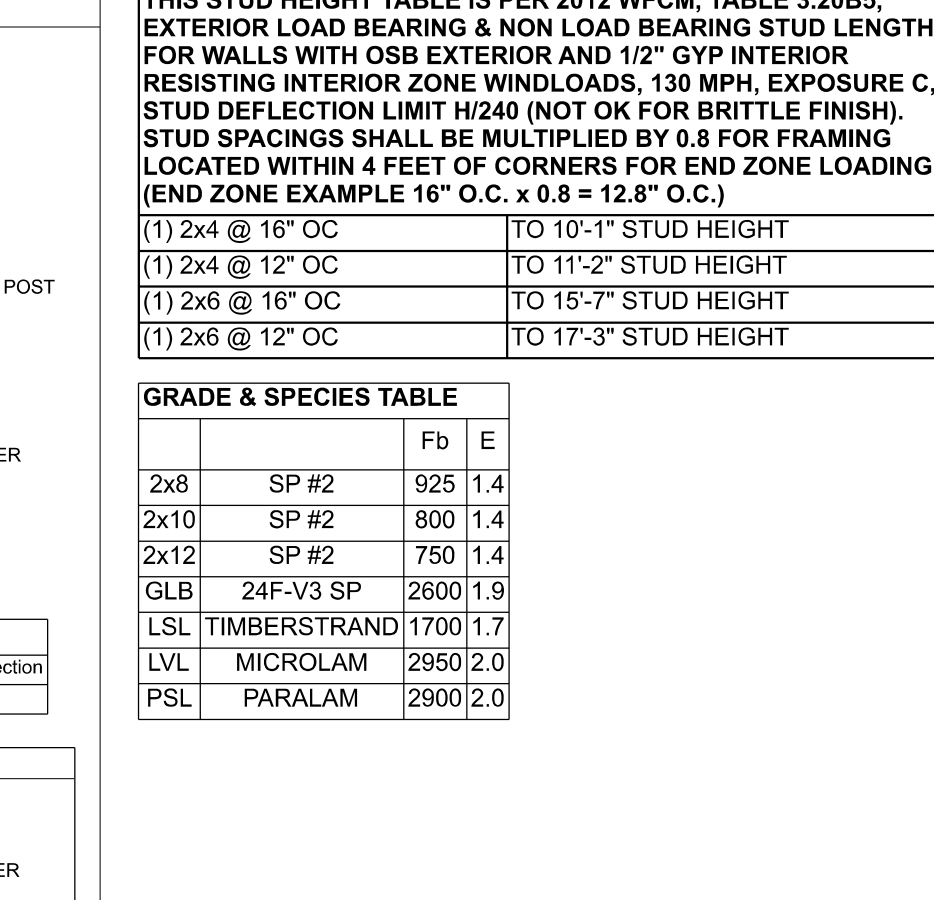

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME

OPTION: 2 (POCKETED)

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

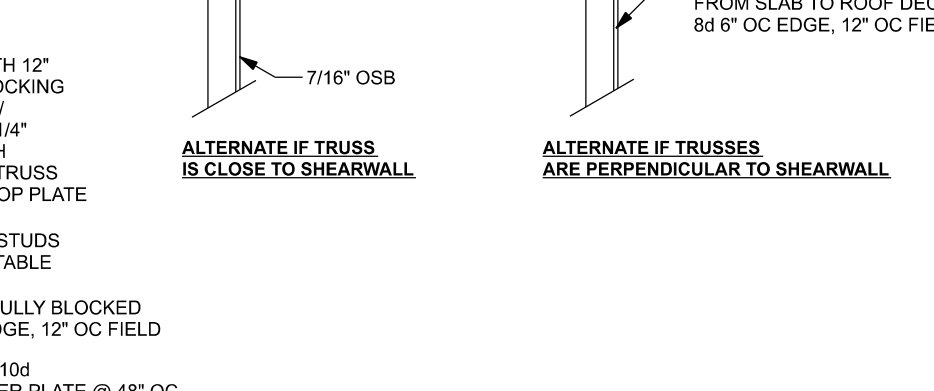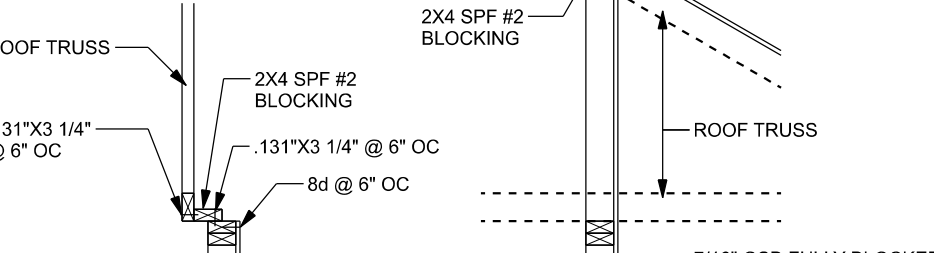

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

OPTION: 1 (BUCKET)




(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

GENERAL NOTES:
TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR. TRUSS ENGINEERING SHALL INCLUDE TRUSS PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY TO VERIFY THE TRUSS DESIGNER HAS SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WOOD LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN. UPLIFT CONNECTION 415LB EACH END, 2X8 RAFTERS 700 LB EACH END.
SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN
FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET GRAVITY LOAD REQUIREMENTS (ASSUME 1500 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVIDES OTHERWISE)
CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F_c = 2500 PSI.
WELDED WIRE REINFORCED SLAB: 6" x 6" W14 x W14, F_y = 80ksi, WELDED WIRE REINFORCEMENT FABRIC (W.W.R.) CONFORMING TO ASTM A186, LOCATED IN MIDDLE OF THE SLAB, SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.
FIBER CONCRETE SLAB: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT FIBER LENGTH 12 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C-1116. SUPPLIER TO PROVIDE ASTM C-1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.
CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH/ WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE 12FT. DO NOT CUT WWM OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.)
REBAR: ASTM A 615, GRADE 40, DEFORMED BARS, F_y = 40 KSI. ALL LAP SPLICES 40" DB (25" FOR #5 BARS); UNO. ALL REINFORCEMENT SHALL BE DETAILD AND PLACED IN ACCORDANCE WITH ACI 315-86, U.N.O.
ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL. DIAPHRAGMS, SHEATHING, UNBLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED.
STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE SAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.
ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 10" IN GROUDED CMU.
BUILDER'S RESPONSIBILITY:
THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK.
CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS WIND, AND FLOOD ZONE.
PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES WHICH COMPLY WITH FBCR REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES.
PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMMITS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY.
VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS.
ROOF SYSTEM DESIGN:
THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR. IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBCR REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER. ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SHEETS.

(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

(TYP.) INTERIOR BEARING WALL
ONE STORY WOOD FRAME w/ STRAPS & ANCHORS

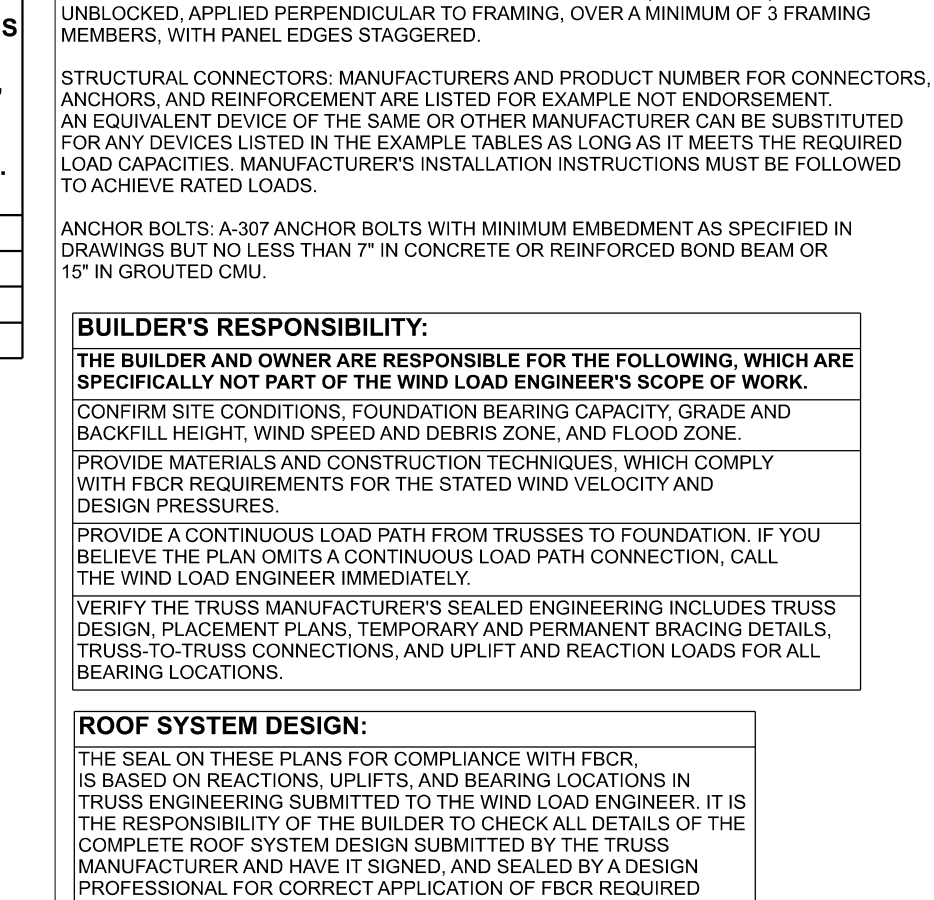

(TYP.) GABLE WALL w/ VAULTED CEILING
WOOD FRAME


OPTION: 2 (POCKETED)

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS



(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

OPTION: 1 (BUCKET)

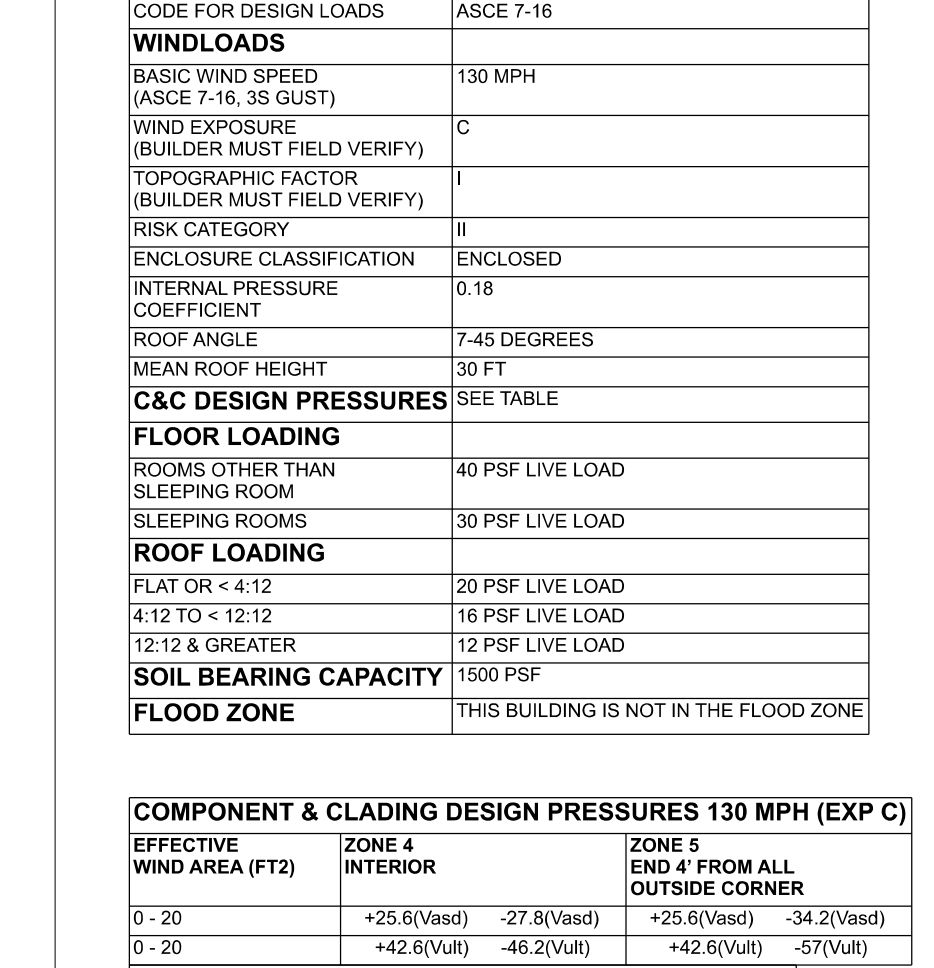

(TYP.) BEAM TO WALL
WOOD FRAME w/ STRAPS & ANCHORS

DESIGN CRITERIA & LOADS:			
BUILDING CODE	7TH EDITION FLORIDA BUILDING CODE RESIDENTIAL (2020)		
CODE FOR DESIGN LOADS	ASCE 7-16		
WINDLOADS			
BASIC WIND SPEED (ASCE 7-16, 3S GUST)	130 MPH		
WIND EXPOSURE (BUILDER MUST FIELD VERIFY)	C		
TOPOGRAPHIC FACTOR (BUILDER MUST FIELD VERIFY)	I		
RISK CATEGORY	II		
ENCLOSURE CLASSIFICATION	ENCLOSED		
INTERNAL PRESSURE COEFFICIENT	0.18		
ROOF ANGLE	7-45 DEGREES		
MEAN ROOF HEIGHT	30 FT		
C&C DESIGN PRESSURES	SEE TABLE		
FLOOR LOADING			
ROOMS OTHER THAN SLEEPING ROOM	40 PSF LIVE LOAD		
SLEEPING ROOMS	30 PSF LIVE LOAD		
ROOF LOADING			
FLAT OR < 4:12	20 PSF LIVE LOAD		
4:12 TO < 12:12	16 PSF LIVE LOAD		
12:12 & GREATER	12 PSF LIVE LOAD		
SOIL BEARING CAPACITY	1500 PSF		
FLOOD ZONE	THIS BUILDING IS NOT IN THE FLOOD ZONE		

COMPONENT & CLADING DESIGN PRESSURES 130 MPH (EXP C)			
EFFECTIVE WIND AREA (FZ2)	ZONE 4 INTERIOR	ZONE 5 END 4 FROM ALL OUTSIDE CORNER	
0 - 20	+25.6(Vasd) -27.8(Vasd)	+25.6(Vasd) -34.2(Vasd)	
0 - 20	+42.6(Vult) -46.2(Vult)	+42.6(Vult) -57(Vult)	
GARAGE DOOR DESIGN PRESSURES 130 MPH (EXP C)			
9x7 GARAGE DOOR	+22.6(Vasd) -25.5(Vasd)		
16x7 GARAGE DOOR	+21.7(Vasd) -24.1(Vasd)		

Amira Builders

Creasey Res.

PROJECT ADDRESS:

100 SW Sugar Bear Glen

FL 33146, FL

DIMENSIONS:

Stated dimensions supersede scaled dimensions. Refer all questions to Mark Disoway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS:

Mark Disoway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disoway.

CERTIFICATION:


I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION:

This design

S-2
OF 3 SHEET

RIDGE BOARD	2X6 SYP #2
RAFTER SPANS 20'-0" OR LESS	2X4 SYP #2
PURLINS / LATERAL BRACING	2X4 SYP #2
SLEEPERS	2X (WIDTH OF RAFTER SEAT CUT) SPF #3 OR 2 PARALLEL 2X4 SPF #3
CRIPPLES & BLOCKING	2X4 SYP #2 OR BETTER
TRUSS BELOW	SEE TRUSS DESIGN - SOUTHERN PINE MATERIAL



ROOF OVER FRAMING & BRACING DETAIL

===== TRUSS
 = = = = TRUSS UNDER VALLEY FRAMING
 | | | | | VALLEY RAFTER OR RIDGE
 ● CRIPPLE

CRIPPLES 4'-0" O.C. FOR 20 psf (TL) AND 10 psf (TD) (TYP. SHINGLE ROOF) MAX.

MAXIMUM RAFTER SPANS
 6'-0" FOR 2X4, 8'-0" FOR 2X6 SFF #2 OR SYP #2,
 MAXIMUM ROOF AREA PER SUPPORT
 1602 IN ZONES 2 & 3, 2402 IN ZONE 1 (EXAMPLE: 4'-0" O.C. 2 X 4" SPAN
 2402 OR 2'-0" X 6'-0" SFF #2 OR SYP #2)
 PURLINS REQUIRED 2'-0" O.C. IF EXISTING SHEATHING IS REMOVED.
 PURLINS SHOULD OVERLAP SHEATHING ONE TRUSS SPACING MINIMUM.
 IN CASES THAT THIS IS IMPRACTICAL, OVERLAP SHEATHING A MINIMUM OF 6", AND NAIL UPWARDS THROUGH SHEATHING INTO PURLIN WITH A MINIMUM OF 1" BY CODE.
 THIS DRAWING APPLIES TO VALLEYS WITH THE FOLLOWING CONDITIONS:
 -SPANS (DISTANCES BETWEEN BEAMS) 4'-0" OR LESS
 -MAXIMUM VALLEY HEIGHT: 14'-0" OR LESS
 -MAXIMUM WIND SPEED: 130 MPH
 -MAXIMUM MEAN RAINFALL: 14.0" OR FEWER
 -MAXIMUM TOTAL LOADING: 40 PSF
 -MEETS FIBC (ASC 4-10) WINDING REQUIREMENTS
 -EXPOSURE CATEGORY: "C", 1-10, Ret = 1.0
 -ENCLOSED SHEATHING

2X4 CONTINUOUS LATERAL BRACE (CLB) MIN. IS REQUIRED FOR CRIPPLES 5'-0" TO 10'-0" LONG NAIL 2'-0" - 10' NAILS OR 2X4 "T" OR SCAB BRACE NAIL TO FLAT EDGE OF CRIPPLE WITH 8" NAILS @ 8" O.C. "T" OR SCAB MUST BE 90% OF CRIPPLE LENGTH. CRIPPLES OVER 10'-0" LONG REQUIRE 2X4 "T" OR SCAB WITH BOTH FACES "W" "T" OR SCAB. USE STRESS GRADED LUMBER & BOX OR COMMON NAILS.

NARROW EDGE OF CRIPPLE CAN FACE RIDGE OR RAFTER AS LONG AS THE PROPER NUMBER OF NAILS ARE INSTALLED INTO RIDGE BOARD.

- INSTALL BLOCKING UNDER RAFTER IF SLEEPERS ARE NOT USED.
- INSTALL BLOCKING UNDER CRIPPLES IF CRIPPLES FALL BETWEEN JOIST TRUSS TOP CHORDS AND LATERAL BRACING IS NOT USED.

APPLY ALL NAILING IN ACCORDANCE TO NDS-1997 SECTION 12. NAILS ARE COMMON WIRE NAILS UNLESS NOTED OTHERWISE.

SN-1	ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X6 SP #2 (U.N.O.)
SN-2	ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
SN-3	ALL HEADERS W/ UPLIFT TO BE STRAPPED DOWN @ EACH SIDE OF (1) LSTA24, 14-10 @ TOP & BOTTOM OF WALL WRAP UNDER BOTTOM PLATE & OVER TOP PLATE 1/2" - 10" ANCHOR BOLT w/ 3" x 3" 14" WASHER MUST BE LOCATED WITHIN 6" OF KING STUD @ ALL DOOR LOCATIONS (U.N.O.)
SN-4	USE ONE JACK STUD GIRDER SUPPORT PER 2500 LB LOAD
SN-5	DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS
SN-6	PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BC511-03, BC511-81, BC511-82, & BC511-83. BC511-81, BC511-82, & BC511-83 ARE FURNISHED BY THE TRUSS SUPPLIER. WITH THE SEALED TRUSS PACKAGE

Diagram illustrating the components and dimensions of a 2x6 header:

- 2x6x0', 1J 1K: Header/Beam Call-out (U.N.O.)
- NUMBER OF KING STUDS (FULL LENGTH)
- NUMBER OF JACK STUDS (UNDER HEADER)
- SPAN OF HEADER
- SIZE OF HEADER MATERIAL
- NUMBER OF PLIES IN HEADER



NOTE:
IF THE ABOVE DETAIL IS USED
ON THE FRONT & REAR WALL
@ FRONT & REAR PORCH
THE PORCH CEILING DOES NOT
NEED TO BE SHEATHED

NOTE:
PORCH CEILING MUST BE SHEATHED
w/ MIN. 3/8" OSB w/
8d @ 3" OC EDGE & 12" OC FIELD

**NO UPLIFT
STRAPPING
REQUIRED
THIS HEADER**

NOTE:
PORCH CEILING MUST BE SHEATHED
w/ MIN. 3/8" OSB w/
8d @ 3" OC EDGE & 12" OC FIELD

SEE PORCH
POST DETAIL (TYPICAL)

**ENGINEERED TRUSSES
ATTACH PER TRUSS UPLIFT**

SCALE: 1/4" = 1'-0"

CONNECTIONS, WALL, & HEADER DESIGN IS BASED
ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING
FURNISHED BY BUILDER. BUILDERS FIRST SOURCE
JOB #2933862

Amira Builders
Creasey Res.
PROJECT ADDRESS:
100 SW Sugar Bear Glen
Ft. White, FL

DIMENSIONS:
Stated dimensions supercede scaled dimensions. Refer all questions to Mark Discosway, P.E. for resolution. Do not proceed without clarification.

COPYRIGHTS AND PROPERTY RIGHTS: Mark Disosway, P.E. hereby expressly reserves its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway.

CERTIFICATION: I hereby certify that I have examined this plan, and that the applicable portions of the plan, relating to wind engineering, comply with the 7th Edition Florida Building Code Residential (2020) to the best of my knowledge.

LIMITATION: This design is valid for one building, at specified location.

MARK DISOSWAY P.E. 53915

THIS PDF HAS DIGITAL SIGNATURE
AND ELECTRONIC SEAL. PRINTED
COPIES ARE NOT CONSIDERED
SIGNED OR SEALED. YOU MUST
VERIFY SIGNATURE ON THIS PDF.
[CLICK HERE TO VERIFY.](#)



Tuesday, November 9, 2021

Mark Disosway P.E.
163 SW Midtown Place
Suite 103
Lake City, Florida 32025
386.754.5419
disoswaydesign@gmail.com

JOB NUMBER:
211511

S-3
OF 3 SHEETS