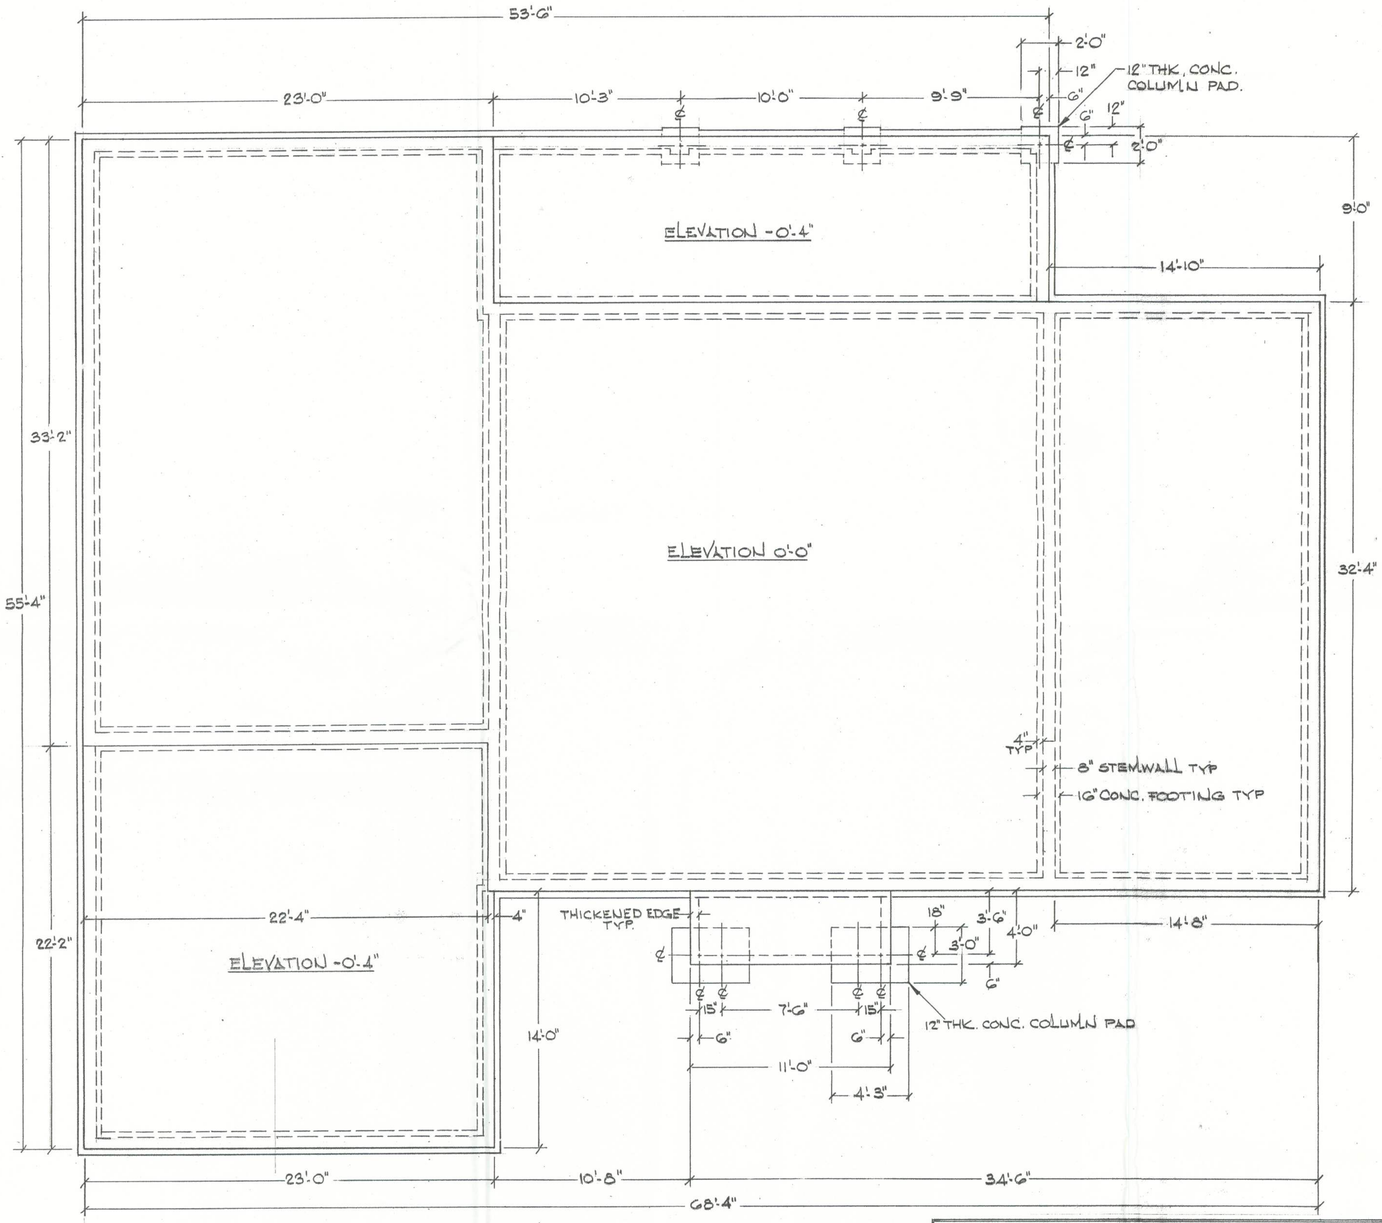

FOUNDATION PLAN

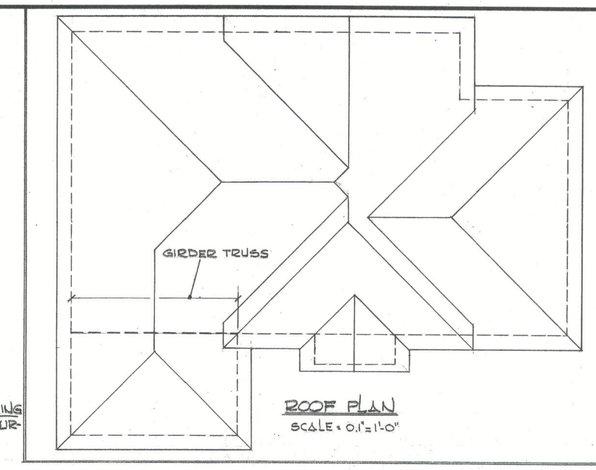

ROOF PLAN

SCALE: 0.1"=1'-0"

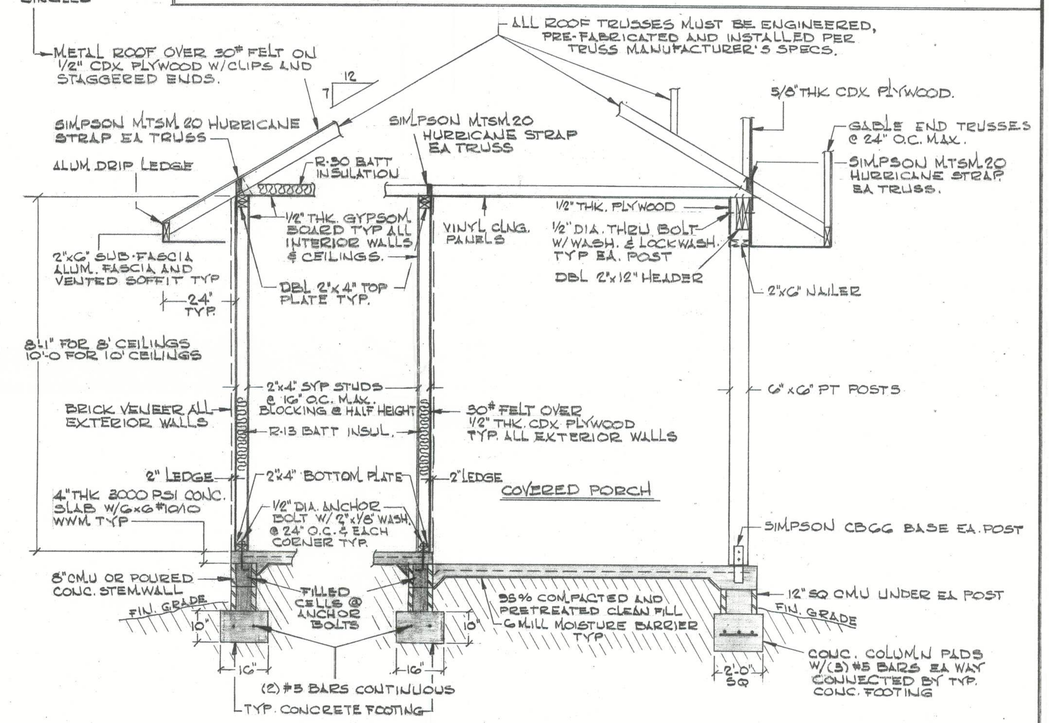

TYPICAL WALL SECTION

SCALE: 1/2"=1'-0"

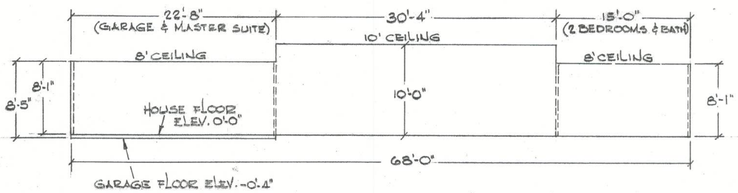

FRONT AND REAR WALL DIAGRAM

SOIL STATEMENT

A geotechnical soil report shall be supplied by a soil testing lab, stating a minimum bearing capacity of 2000 PSF prior to commencement of construction. Should a different condition be encountered the engineer is to be notified prior to assuming the work. At such time an architect or engineer shall supply a letter attesting that the site has been observed and the foundation conditions are similar to those the design is based on. See FBC-2001 EDITION.

SUB-TERRANEAN TERMITE PROTECTION

Building(s) shall receive pre-construction treatment protecting against subterranean termites in accordance with the rules and laws established by the "FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SURVICES". A "CERTIFICATE OF COMPLIANCE" shall be issued to the Building Department by a licensed pest control company containing the following statement:
"This building has received a complete treatment for the prevention of subterranean termites. Treatment is in accordance with the rules and laws established by the FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES".

I hereby certify that the building depicted in this set of drawings numbered VH1 OF 4 through VH4 OF 4 will withstand wind pressures of up to 120 MPH as defined in the Florida Building Code, 2001 Edition, Section 1606, provided that it is built in strict accordance with these drawings.

H.L. Bennett, Florida P.E. No. 32534 — Date 7/20/05

H. L. BENNETT
241 YEOMANS AVENUE – P.O. DRAWER 2137
LABELLE, FLORIDA 33975 PH. (863) 675-8882
FAX (863) 675-1327

MR. AND MRS. VEP HUDSON

SCALE: 1/4"= 1'-0"	APPROVED BY:	DRAWN BY
DATE: 06-21-05		REVISED 07-05-05

CUSTOM SINGLE ONE-STORY HOME

FOUNDATION & WALL SECTION — DRAWING NUMBER VH2 OF 4