

GENERAL NOTES

FABRICATION SHALL BE IN ACCORDANCE WITH ELITE STRUCTURES STANDARD PRACTICES AND IN COMPLIANCE WITH THE APPLICABLE SECTIONS, RELATING TO DESIGN REQUIREMENTS AND ALLOWABLE STRESSES OF THE LATEST EDITION OF THE 'AWS STRUCTURAL WELDING CODE D 1.1 AND D1.3"

MATERIALS	ASTM DESIGNATION	MIN. YIELD STRENGTH
HOT ROLLED STEEL SHAPES	A572	FY = 50 KSI
STEEL PIPES	A500	FY = 42 KSI
STRUCTURAL TUBING	A500	FY = 46 KSI
STRUCTURAL STEEL WEB PLATE	A572/A1011	FY = 50 KSI
STRUCTURAL STEEL FLANGE PLATES/BARS	A36/A572	FY = 50 KSI
COLD FORM LIGHT GAUGE	A653/A1011	FY = 50, 55 KSI
ROOF AND WALL SHEETS	A792/A653	FY = 50, 60 KSI
CABLE BRACE	A475- TYPE1	EXTRA HIGH STRENGTH
ROD BRACE	A36	FY = 36 KSI
MILL SECTIONS	A36	FY = 36 KSI
MACHINE BOLTS & NUTS	A307	MIN. TENSILE STRENGTH
HIGH STRENGTH BOLTS (1/2" DIA. & LESS)	A325 - TYPE 1	FU = 60 KSI
HIGH STRENGTH BOLTS (3/4" TO 1-1/2")	A325 - TYPE 1	FU = 120 KSI
ANCHOR BOLTS (IF SUPPLIED)	F1554 - GR36	FU = 109 KSI

CLOSURE STRIPS ARE FURNISHED ONLY IF NOTED ON SHIPPING DOCUMENTS

INSIDE - UNDER ROOF PANELS AT EAVE
OUTSIDE - BETWEEN END WALL PANELS AND RAKE TRIM
UNDER CONTINUOUS RIDGE VENT SKIRTS

ERECTION NOTE:

ALL BRACING, STRAPPING, & BRIDGING SHOWN AND PROVIDED BY ELITE STRUCTURES FOR THIS BUILDING IS REQUIRED AND SHALL BE INSTALLED BY THE ERECTOR AS A PERMANENT PART OF THE STRUCTURE. IF ADDITIONAL BRACING IS REQUIRED FOR STABILITY DURING ERECTION, IT SHALL BE THE ERECTOR'S RESPONSIBILITY TO DETERMINE THE AMOUNT OF SUCH BRACING AND TO PROVIDE AND INSTALL AS NEEDED.

ERECTION AND UNLOADING NOT BY ELITE STRUCTURES

SHORTAGES

ANY CLAIMS OR SHORTAGES BY BUYERS MUST BE MADE TO ELITE STRUCTURES AT TIME OF DELIVERY, OR SUCH CLAIMS SHALL BE CONSIDERED WAIVED BY THE CUSTOMER AND DISALLOWED IF MATERIAL IS SHOWN DELIVERED

CORRECTIONS OF ERRORS AND REPAIRS (MMA 610)

CLAIMS FOR CORRECTIONS OF ALLEGED MISFITS WILL BE DISALLOWED UNLESS ELITE STRUCTURES SHALL HAVE RECEIVED PRIOR NOTICE THEREOF AND ALLOWED REASONABLE INSPECTION OF SUCH MISFITS. THE CORRECTION OF MINOR MISFITS BY THE USE OF DRIFT PINS TO DRAW THE COMPONENTS INTO LINE, MODERATE AMOUNTS OF REAMING, CHIPPING AND CUTTING, AND THE REPLACEMENT OF MINOR SHORTAGES OF MATERIAL ARE A NORMAL PART OF ERECTION AND ARE NOT SUBJECT TO CLAIM.

A-325 BOLT TIGHTENING REQUIREMENTS

ALL BOLTED JOINTS WITH A325 OR TYPE 1 BOLTS ARE SPECIFIED AS SNUG-TIGHTENED JOINTS IN ACCORDANCE WITH THE SPECIFICATION FOR STRUCTURAL JOINTS USING ASTM A325 OR A490 BOLTS, JUNE 30,2004. PRETENSIONING METHODS, INCLUDING TURN-OF-NUT,CALIBRATED WRENCH,TWIST OFF TYPE TENSION CONTROL BOLTS OR DIRECT TENSION INDICATOR ARE NOT REQUIRED. INSTALLATION INSPECTION REQUIREMENTS FOR SNUG TIGHT (SPECIFICATION FOR STRUCTURAL JOINTS 9.1) IS SUGGESTED.

REFERENCE: STEEL CONSTRUCTION MANUAL
AMERICAN INSTITUTE OF STEEL CONSTRUCTION INC.
THIRTEENTH EDITION (AISC)

FLORIDA PRODUCT APPROVAL NUMBER - ELITE STRUCTURES 26 GAUGE PBR PANEL


WALL PANEL 26 GA PBR PANEL FL27502
ROOF PANEL 26 GA PBR PANEL FL27503

NDA APPROVAL NUMBER

WALL 24 GA PBR PANEL 01-041712
ROOF 24 GA PBR PANEL 96-0529

TELL 3070 WALK DOOR FL APPROVAL #

3070 WIND RATED WALK DOOR 22211.1

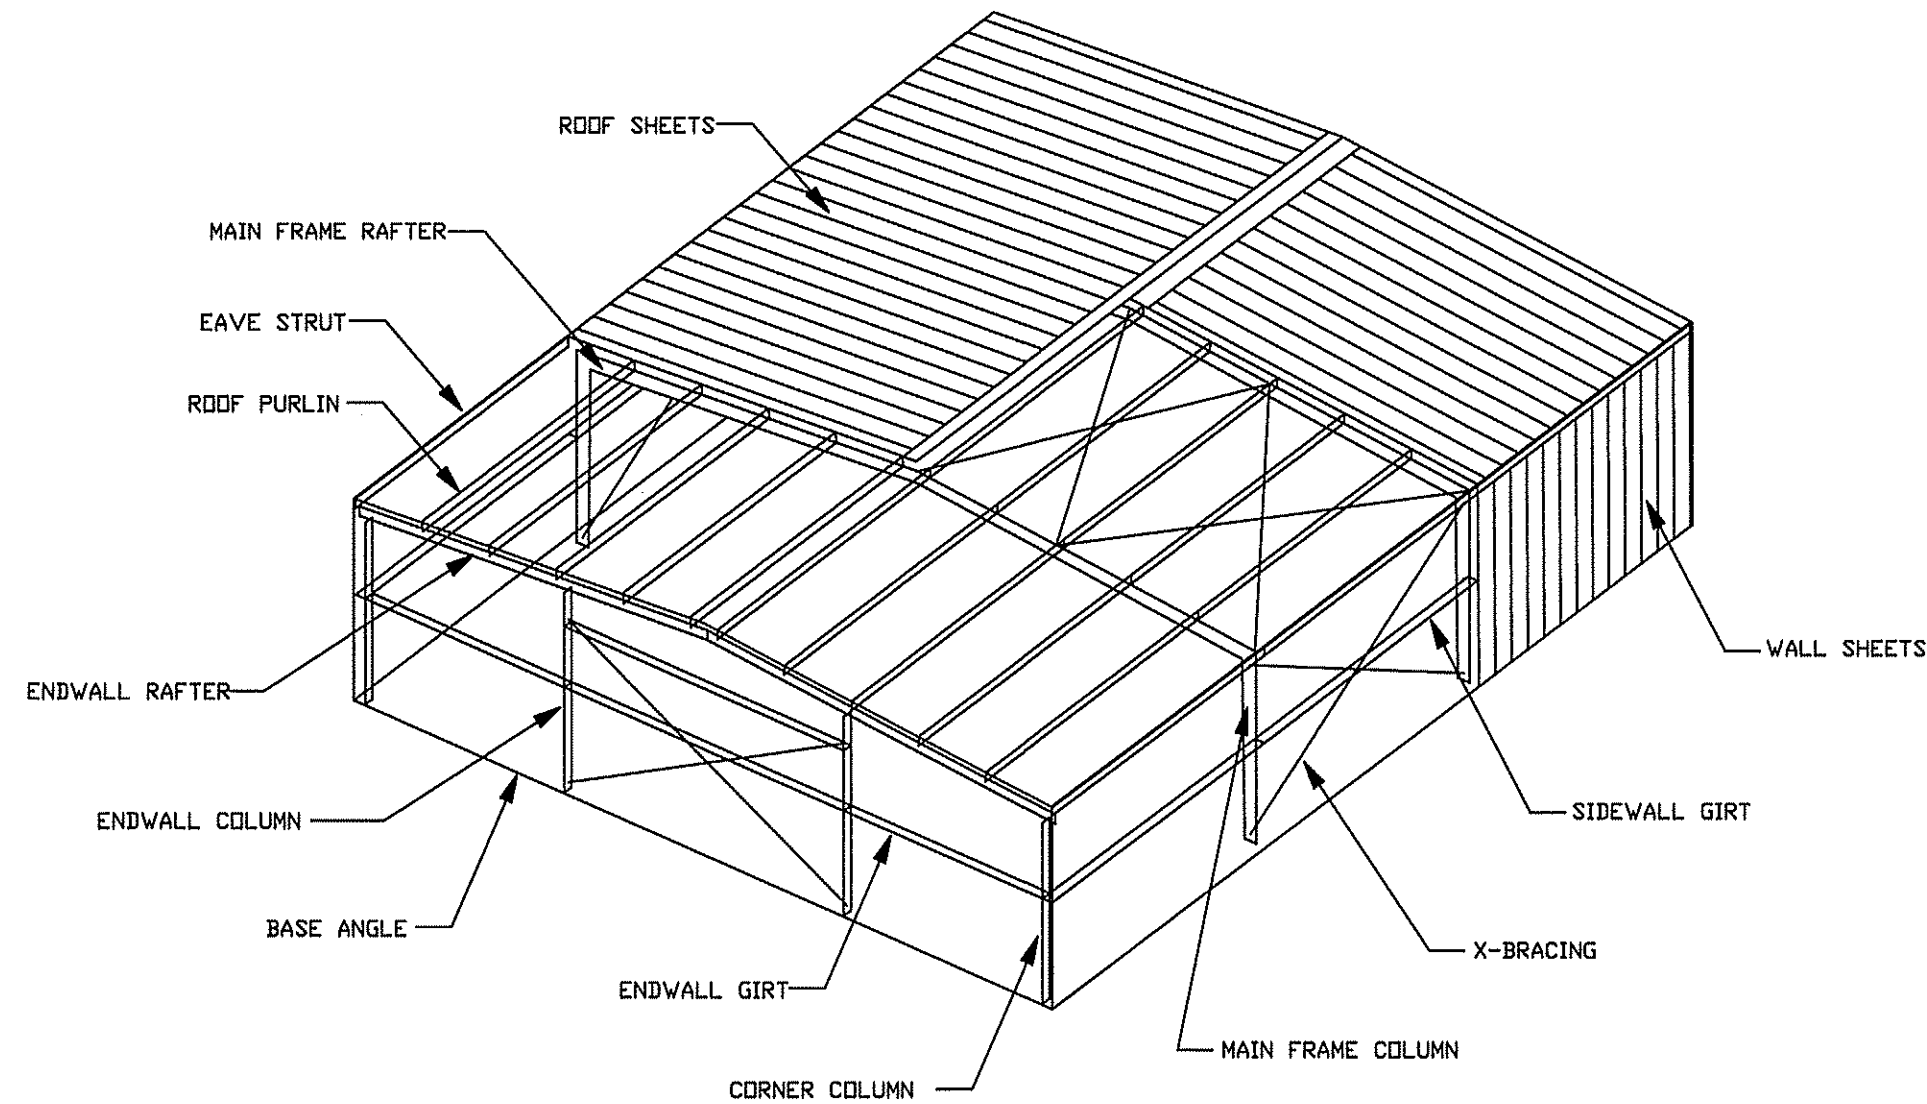

BUILDING DRAWING FOR ILLUSTRATION ONLY

401 OLD QUITMAN RD.
ADEL, GA. 31620
229-896-7569

Psaln 91



ELITE-STRUCTURES.COM

CONSTRUCTION MANUAL AVAILABLE ONLINE
WWW.ELITE-STRUCTURES.COM

PROJECT:
I.C. CONSTRUCTION
ATTN: ISAIAH CULLY

PROJECT MANAGER LOCATION:
L. WHITEHURST LAKE CITY, FL

SERVICEABILITY CRITERIA

Endwall Column	= 180	Roof Panel (Live)	= 60
Endwall Rafter (Live)	= 180	Roof Panel (Wind)	= 60
Endwall Rafter (Wind)	= 180	Rigid Frame (Horz)	= 60
Wall Girt	= 90	Rigid Frame (Vert)	= 180
Roof Purlin (Live)	= 180	Rigid Frame (Seismic)	= 50
Roof Purlin (Wind)	= 150		
Wall Panel	= 60		
MEZZANINE LOADS (IF APPLICABLE)			
Use/Occupancy	Collateral load below		
Dead load	Live load		
Partition dead	Live deflection limit		
Collateral load above	Dead and live deflection limit		

BUILDING DESCRIPTION:

40 × 60 × 14

LOCAL BUILDING CODE:
ENCLOSURE TYPE:
BUILDING RISK CATAGORY
LOAD REDUCTION USED:
LIVE LOAD TO FRAMES:
LIVE LOAD TO PURLINS:
DEAD LOAD:
COLLATERAL LOAD:
SNOW LOAD (GROUND):
SNOW LOAD (ROOF):
WIND SPEED:
WIND EXPOSURE:
SEISMIC ZONE:
SEISMIC IMPORTANCE:
SPECTRAL RESPONSE Ss
SPECTRAL RESPONSE S1
RAIN INTENSITY: 5 yr.
25 yr.

FBC 23
Enclosed
II - Normal
Yes
12.00
20.00
2.50
1.00
4
3.13
118
B
B
1.00
0.14
0.06
10
11.0000

Harry V
Whiddon

Digitally signed by Harry V Whiddon
DN: c=US, o=Georgia,
dnQualifier=A01410D0000018D83F35
BF800091177, cn=Harry V Whiddon
Date: 2025.05.16 10:18:54 -04'00'


HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968


DESIGN SPECIFICATIONS
FOR
JOB ID: 13325

ENGINEERING SEAL


THIS CERTIFICATION COVERS PARTS MANUFACTURED AND
DELIVERED BY ELITE STRUCTURES ONLY

SEALING OF THESE DRAWINGS DOES NOT IMPLY OR CONSTITUTE THAT ELITE
STRUCTURES ENGINEER IS THE ENGINEER OF RECORD OR THE DESIGN PROFESSIONAL
FOR THE THIS PROJECT. ONLY THE DESIGN OF THE METAL BUILDING SYSTEM AS
FURNISHED BY ELITE STRUCTURES IS INCLUDED. FOUNDATIONS ANALYSIS, ELECTRICAL,
AND MECHANICAL SYSTEMS, AND/OR OTHER PARTS SUPPLIED BY ANYONE OTHER THAN
ELITE STRUCTURES ARE SPECIFICALLY EXCLUDED, NO INSPECTION OR SUPERVISION
IS IMPLIED.


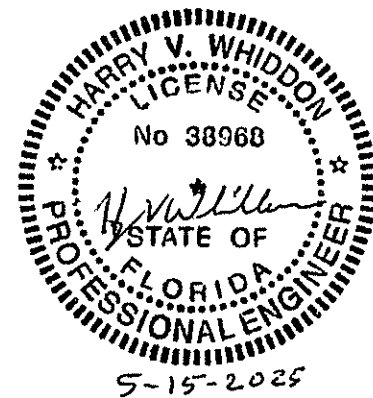


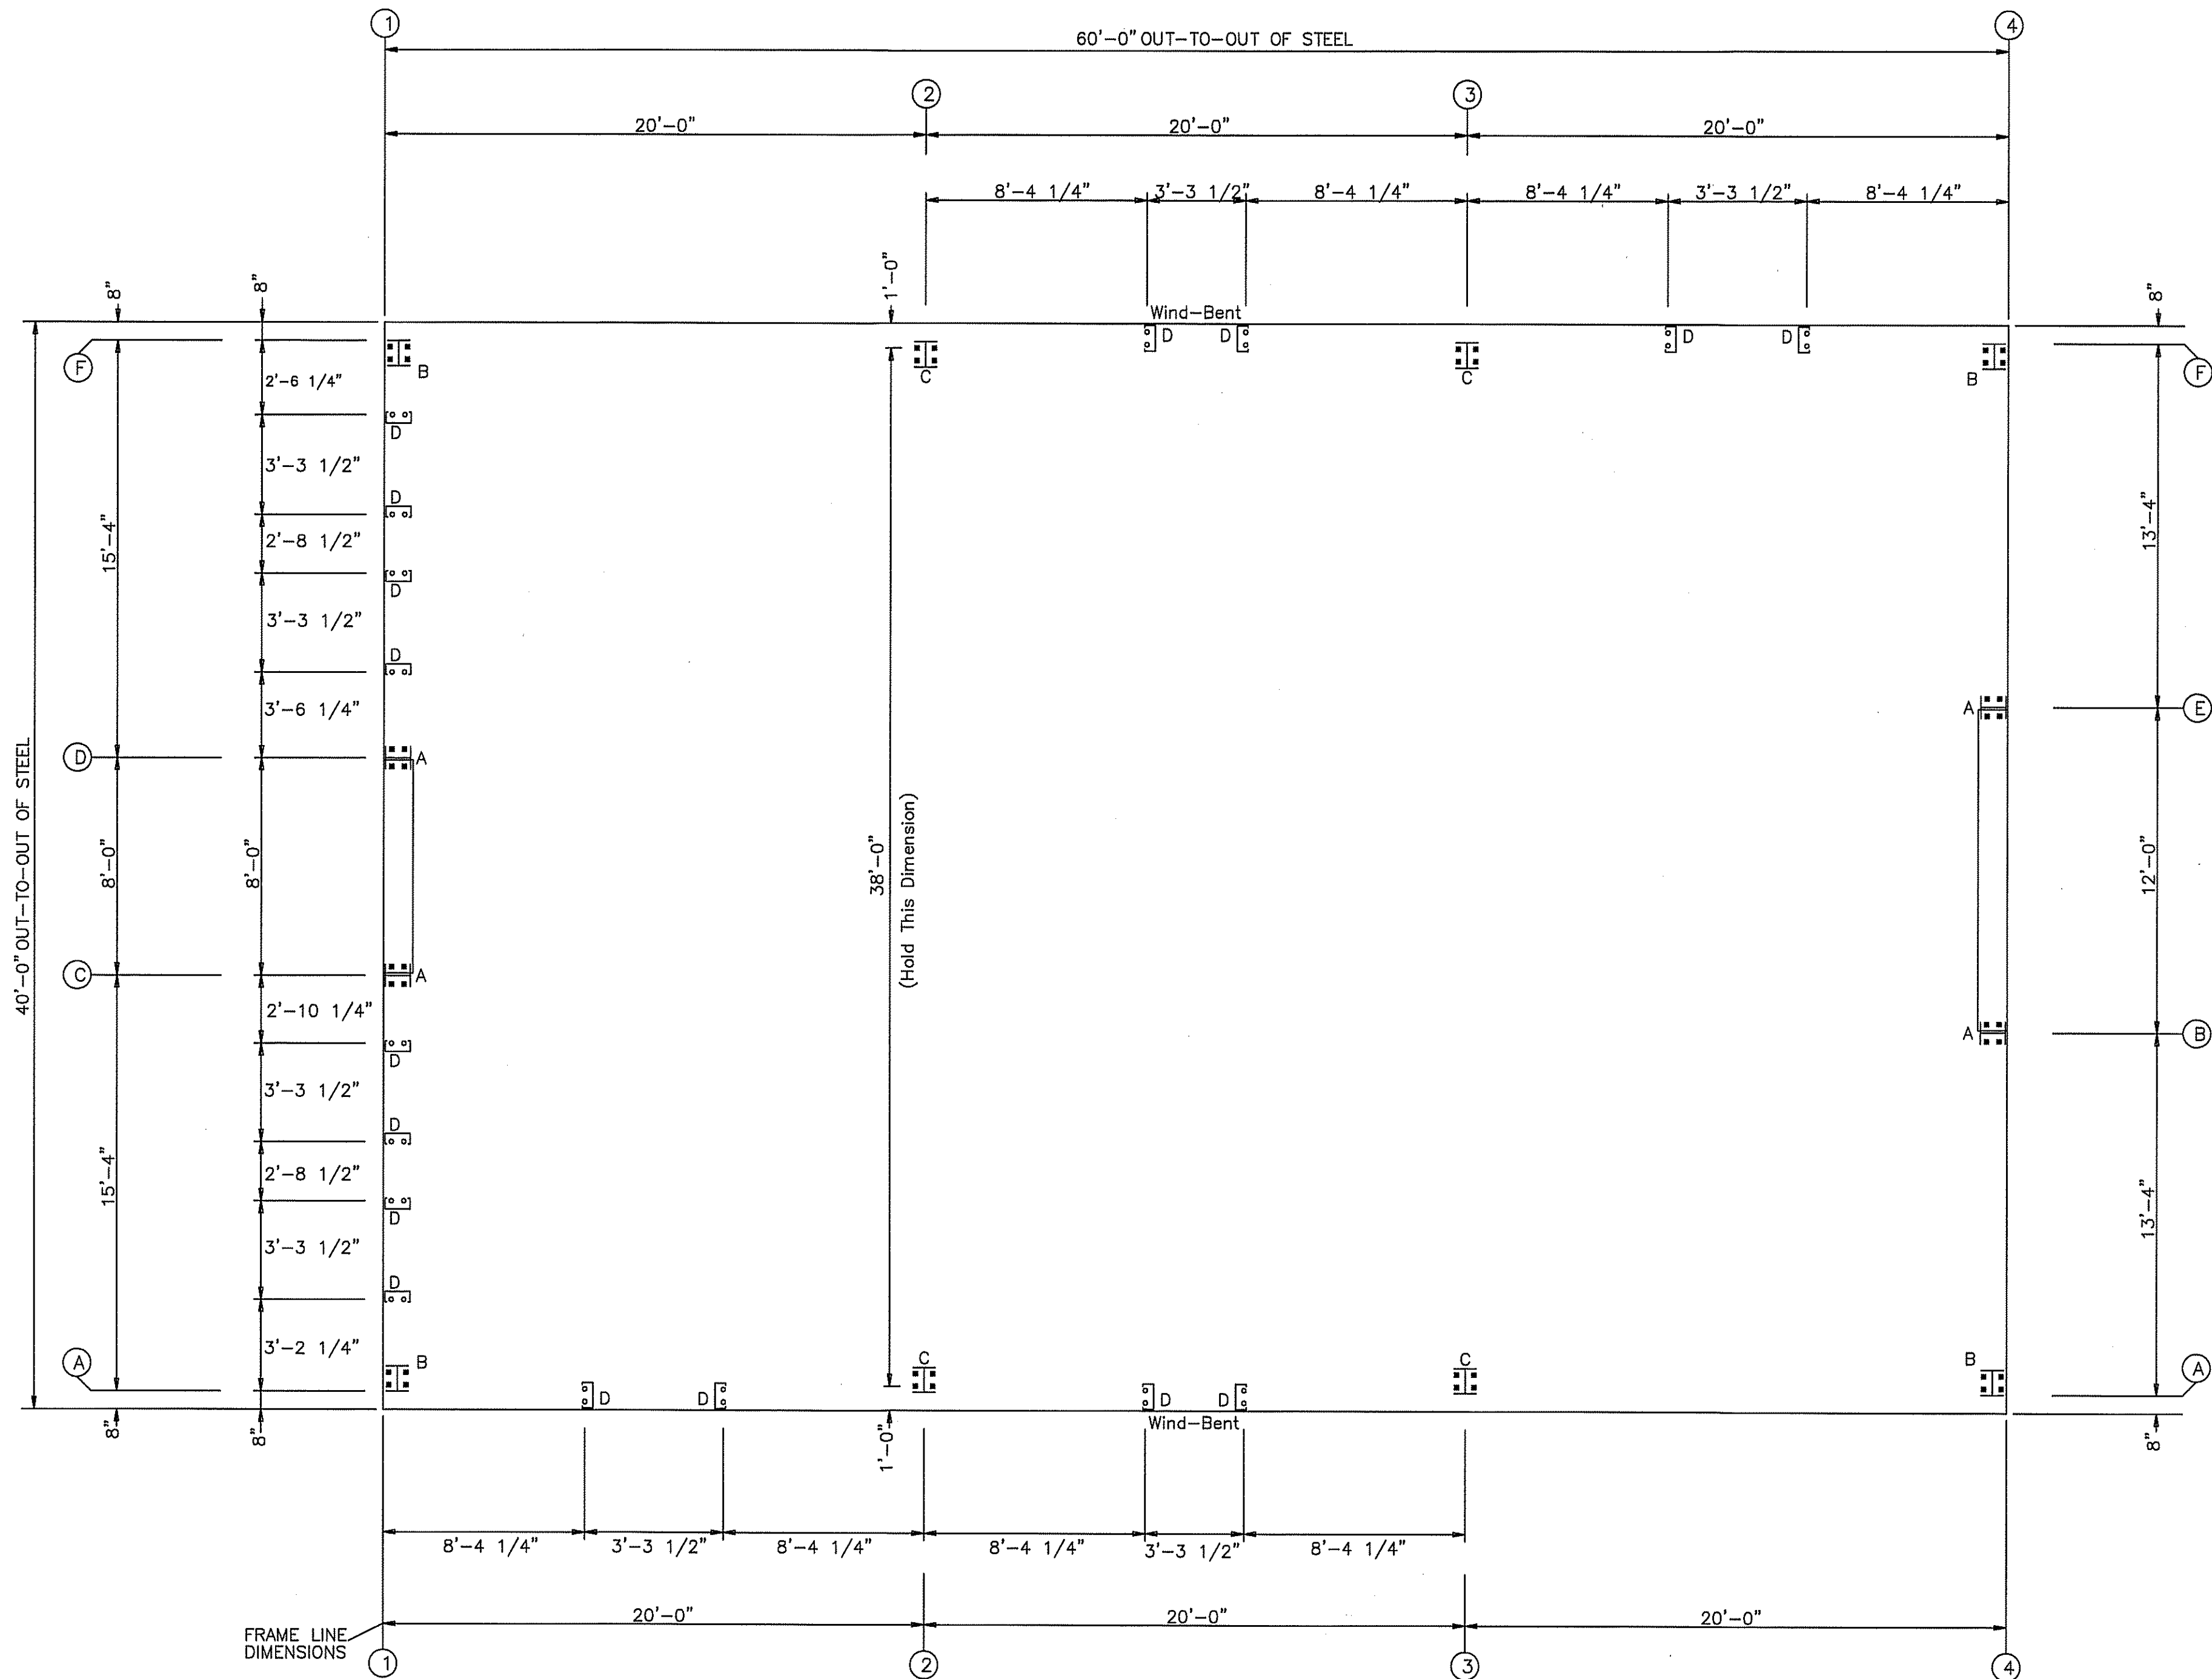

ANCHOR BOLT PLAN
NOTE: All Base Plates @ 100'-0" (U.N.)

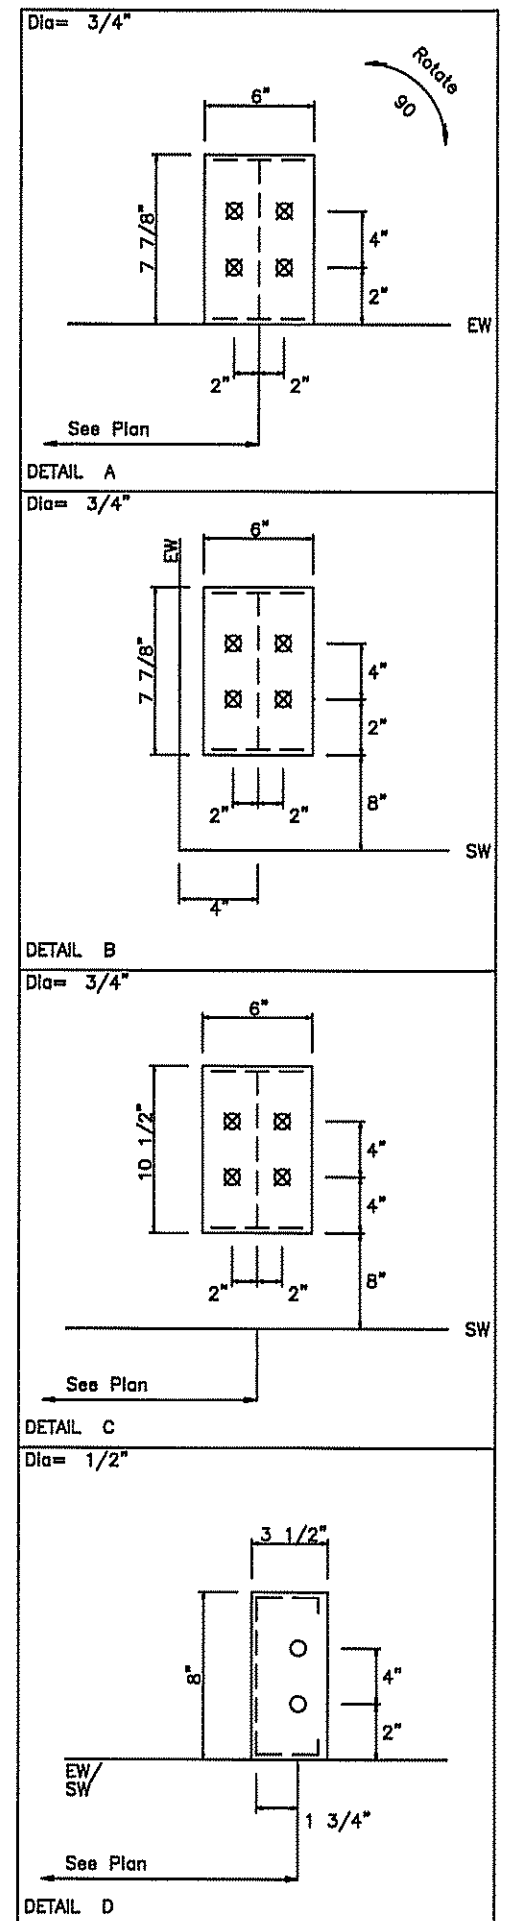

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

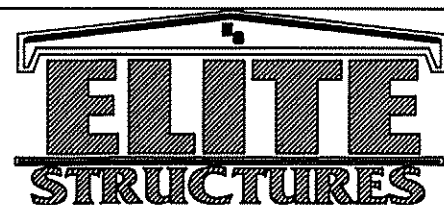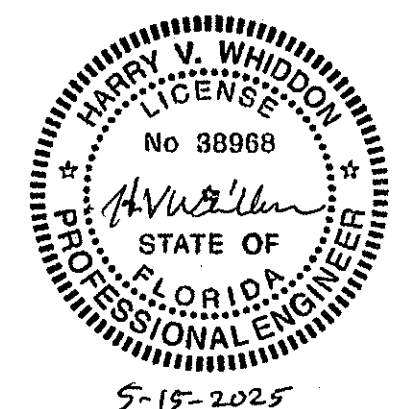

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620

SCALE: N.T.S. DATE: 9/14/24
DRAWN BY: C.REVILL SALESMAN: L.WHITEHURST
BUILDING SIZE: 40X60X14


REVISION
DATE: DESCRIPTION
9/14 TOOK OFF SOME OF WAINSCOTT

TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN
ANCHOR BOLT

JOB #
13325-AB
SHEET 1 OF 13

FRAME LINES: 2 3

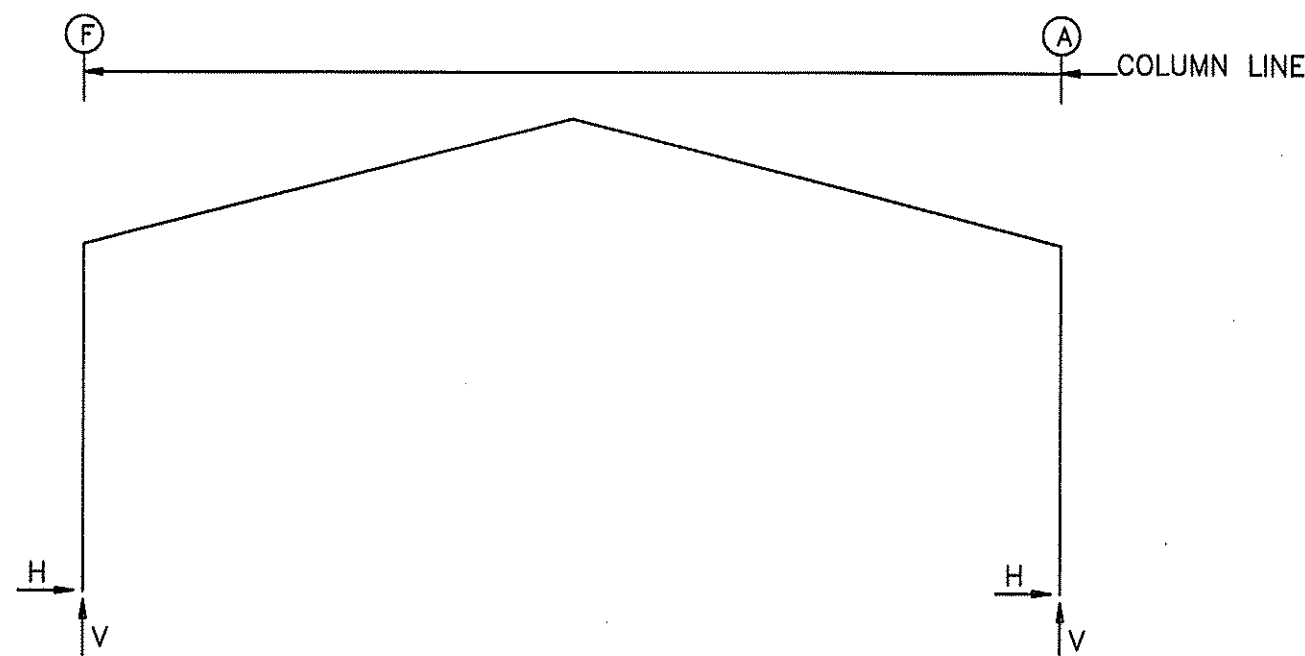

RIGID FRAME: MAXIMUM REACTIONS, ANCHOR BOLTS, & BASE PLATES

Frm Line	Col Line	Column_Reactions(k)						Bolt(in) Qty Dia		Base_Plate(in)			Grout (in)
		Load Id	Hmax H	V Vmax	Load Id	Hmin H	V Vmin			Width	Length	Thick	
2*	F	3	2.7	3.6	6	-2.9	-2.2	4	0.750	6.000	10.50	0.500	0.0
		1	2.3	6.8	4	-2.8	-4.0						
2*	A	7	2.9	-2.2	2	-2.7	3.6	4	0.750	6.000	10.50	0.500	0.0
		1	-2.3	6.8	5	2.8	-4.0						
2*	Frame lines: 2 3												

2* Frame lines: 2 3

RIGID FRAME: BASIC COLUMN REACTIONS (k)

Frame Line	Column Line	Dead		Collateral		Live		Snow		Wind_Left1		Wind_Right1	
		Horz	Vert	Horz	Vert	Horz	Vert	Horz	Vert	Horz	Vert	Horz	Vert
2*	F	0.5	1.6	0.1	0.4	1.7	4.8	0.4	1.3	-5.1	-8.2	1.8	-4.3
2*	A	-0.5	1.6	-0.1	0.4	-1.7	4.8	-0.4	1.3	-1.8	-4.3	5.1	-8.2
Frame Line	Column Line	Wind_Left2		Wind_Right2		Wind_Long1		Wind_Long2		Seismic_Left		Seismic_Right	
		Horz	Vert	Horz	Vert	Horz	Vert	Horz	Vert	Horz	Vert	Horz	Vert
2*	F	-5.3	-5.2	1.5	-1.3	0.3	-8.1	-0.4	-7.2	-0.3	-0.2	0.3	0.2
2*	A	-1.5	-1.3	5.3	-5.2	0.4	-7.2	-0.3	-8.1	-0.3	0.2	0.3	-0.2
Frame Line	Column Line	Seismic_Long		MIN_SNOW		F1UNB_SL_L		F1UNB_SL_R					
		Horz	Vert	Horz	Vert	Horz	Vert	Horz	Vert				
2*	F	0.0	-0.2	0.6	1.6	0.4	1.2	0.4	0.7				
2*	A	0.0	-0.2	-0.6	1.6	-0.4	0.7	-0.4	1.2				

2* Frame lines: 2 3

NOTES FOR REACTIONS

Building reactions are based on the following building data:

Width	(ft)	=	40.0
Length	(ft)	=	60.0
Eave Height	(ft)	=	14.0
Roof Slope	(rise/12)	=	3.00/ 3.00
Roof Dead Load	(psf)	=	2.5
Wall Dead Load	(psf)	=	2.0
Left Endwall	(psf)	=	2.0
Right Endwall	(psf)	=	2.0
Front Sidewall	(psf)	=	2.0
Back Sidewall	(psf)	=	2.0
Roof Live Load	(psf)	=	20.0
Frame Live Load	(psf)	=	12.0
Collateral Load	(psf)	=	1.0
Snow Load	(psf)	=	3.1
Minimum Snow	(psf)	=	4.0
Wind Speed	(mph)	=	118.0
Wind Code		=	FBC 23 (IBC 24)
Exposure		=	B
Closure		=	Enclosed
Internal Wind Coeff		=	-0.18, +0.18
Risk Category		=	II - Normal
Importance - Wind		=	1.00
Importance - Seismic		=	1.00
Seismic Design Category		=	B
Seismic Coeff	(Sms)	=	0.18

ID Description

- 1 Dead+Collateral+Live
- 2 Dead+Collateral+0.75Live+0.45Wind_Left1
- 3 Dead+Collateral+0.75Live+0.45Wind_Right1
- 4 0.6Dead+0.6Wind_Left1
- 5 0.6Dead+0.6Wind_Right1
- 6 0.6Dead+0.6Wind_Left2
- 7 0.6Dead+0.6Wind_Right2
- 8 0.6Dead+0.6Wind_Long1L
- 9 0.6Dead+0.6Wind_Long2L
- 10 1.01Dead+1.01Collateral+0.75Live+0.53Seismic_Right
- 11 0.6Dead+0.6Wind_Left1+0.6Wind_Suction
- 12 0.6Dead+0.6Wind_Pressure+0.6Wind_Long1L
- 13 0.6Dead+0.6Wind_Right1+0.6Wind_Suction
- 14 0.6Dead+0.6Wind_Pressure+0.6Wind_Long2L

BUILDING BRACING REACTIONS

Wall Loc	Col Line	Reactions(k)				Panel Shear (lb/ft)		Note
		Wind Horz	Seismic Vert	Wind Vert	Seismic Horz	Wind	Seis	
L_EW	1							(i)
F_SW	A	2,3	1.3	1.6	0.2	0.2		(b)
R_EW	4							(i)
B_SW	F	2,3	1.3	1.6	0.2	0.2		(b)

(b) Wind bent in bay, base above finish floor
(i) Bracing in roof to rigid frameReactions for seismic represent shear force, Eh
Reaction values shown are unfactored

ENDWALL COLUMN: BASIC COLUMN REACTIONS (k)

Frm Line	Col Line	Dead Vert	Collat Vert	Live Vert	Snow Vert	Wind Left1 Vert	Wind Right1 Vert	Wind Left2 Vert	Wind Right2 Vert	Wind Press Horz	Wind Suct Horz	Wind Long1 Vert	Wind Long2 Vert
1	F	0.3	0.0	0.9	0.1	-1.3	-0.9	-0.7	-0.3	0.0	0.0	-1.5	-1.1
1	D	0.7	0.2	3.2	0.5	-2.8	-1.7	-2.1	-0.9	-1.6	1.8	-2.6	-1.1
1	C	0.7	0.2	3.2	0.5	-1.7	-2.8	-0.9	-2.1	-1.6	1.8	-1.1	-2.6
1	A	0.3	0.0	0.9	0.1	-0.9	-1.3	-0.3	-0.7	0.0	0.0	-1.1	-1.5

Frm Line	Col Line	Seis Left Vert	Seis Right Vert	Seis Long Vert	-MIN_SNOW Horz	-MIN_SNOW Vert	E1UNB_SL_L Horz	E1UNB_SL_L Vert	E1UNB_SL_R Horz	E1UNB_SL_R Vert
1	F	0.0	0.1	0.0	0.0	0.2	0.0	0.2	0.0	0.0
1	D	0.0	-0.1	0.0	0.0	0.6	0.0	0.6	0.0	0.2
1	C	-0.1	0.0	0.0	0.0	0.6	0.0	0.2	0.0	0.6
1	A	0.1	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.2

Frm Line	Col Line	Dead Vert	Collat Vert	Live Vert	Snow Vert	Wind Left1 Vert	Wind Right1 Vert	Wind Left2 Vert	Wind Right2 Vert	Wind Press Horz	Wind Suct Horz	Wind Long1 Vert	Wind Long2 Vert
4	A	0.3	0.1	1.1	0.2	-1.1	-0.7	-0.5	-0.2	0.0	0.0	-1.4	-1.0
4	B	0.7	0.2	2.9	0.5	-2.9	-1.9	-2.1	-1.1	-1.7	1.9	-2.6	-1.4
4	E	0.7	0.2	2.9	0.5	-1.9	-2.9	-1.1	-2.1	-1.7	1.9	-1.4	-2.6
4	F	0.3	0.1	1.1	0.2	-0.7	-1.1	-0.2	-0.5	0.0	0.0	-1.0	-1.4



Frm Line	Col Line	Seis Left Vert	Seis Right Vert	Seis Long Vert	-MIN_SNOW Horz	-MIN_SNOW Vert	E2UNB_SL_L Horz	E2UNB_SL_L Vert	E2UNB_SL_R Horz	E2UNB_SL_R Vert
4	A	0.0	0.1	0.0	0.0	0.2	0.0	0.2	0.0	0.1
4	B	0.0	-0.1	0.0	0.0	0.6	0.0	0.5	0.0	0.2
4	E	-0.1	0.0	0.0	0.0	0.6	0.0	0.2	0.0	0.5
4	F	0.1	0.0	0.0	0.0	0.2	0.0	0.1	0.0	0.2

ENDWALL COLUMN: MAXIMUM REACTIONS, ANCHOR BOLTS, & BASE PLATES

Frm Line	Col Line	Column_Reactions(k)						Bolt(in) Qty	Dia	Base_Plate(in)			Grout (in)
		Load Id	Hmax H	V Vmax	Load Id	Hmin H	V Vmin			Width	Length	Thick	
1	F	8 10	0.0 0.0	-0.7 1.5	8	0.0	-0.7	4	0.750	6.000	7.875	0.375	0.0
1	D	11 1	1.1 0.0	-1.3 4.1	12 11	-1.0 1.1	-1.2 -1.3	4	0.750	6.000	7.875	0.375	0.0
1	C	13 1	1.1 0.0	-1.3 4.1	14 13	-1.0 1.1	-1.2 -1.3	4	0.750	6.000	7.875	0.375	0.0
1	A	9 10	0.0 0.0	-0.7 1.5	9	0.0	-0.7	4	0.750	6.000	7.875	0.375	0.0
4	A	8 1	0.0 0.0	-0.6 1.5	8	0.0	-0.6	4	0.750	6.000	7.875	0.375	0.0
4	B	11 1	1.1 0.0	-1.3 3.8	12 11	-1.0 1.1	-1.2 -1.3	4	0.750	6.000	7.875	0.375	0.0
4	E	13 1	1.1 0.0	-1.3 3.8	14 13	-1.0 1.1	-1.2 -1.3	4	0.750	6.000	7.875	0.375	0.0
4	F	9 1	0.0 0.0	-0.6 1.5	9	0.0	-0.6	4	0.750	6.000	7.875	0.375	0.0

ANCHOR BOLT SUMMARY

Qty	Locate	Dia (in)	Type	Proj (in)
48	Jamb	1/2"	GR36	1.50
32	Endwall	3/4"	GR36	2.50
16	Frame	3/4"	GR36	2.50

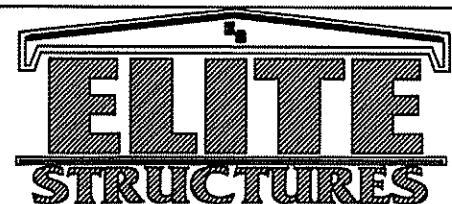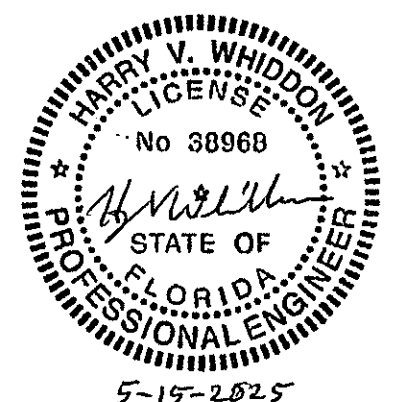HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620

SCALE: N.T.S.

DATE: 9/14/24

REVISION

DRAWN BY: CREVILL

SALESMAN: L.WHITEHURST

DATE: 9/14

DESCRIPTION: TOOK OFF SOME OF THE WAINSCOTT

BUILDING SIZE: 40X60X14

TITLE/LOCATION

I.C. CONSTRUCTION
LAKE CITY, FL


PLAN:

COLUMN REACTIONS


JOB #

13325-CR

SHEET 2 OF 13

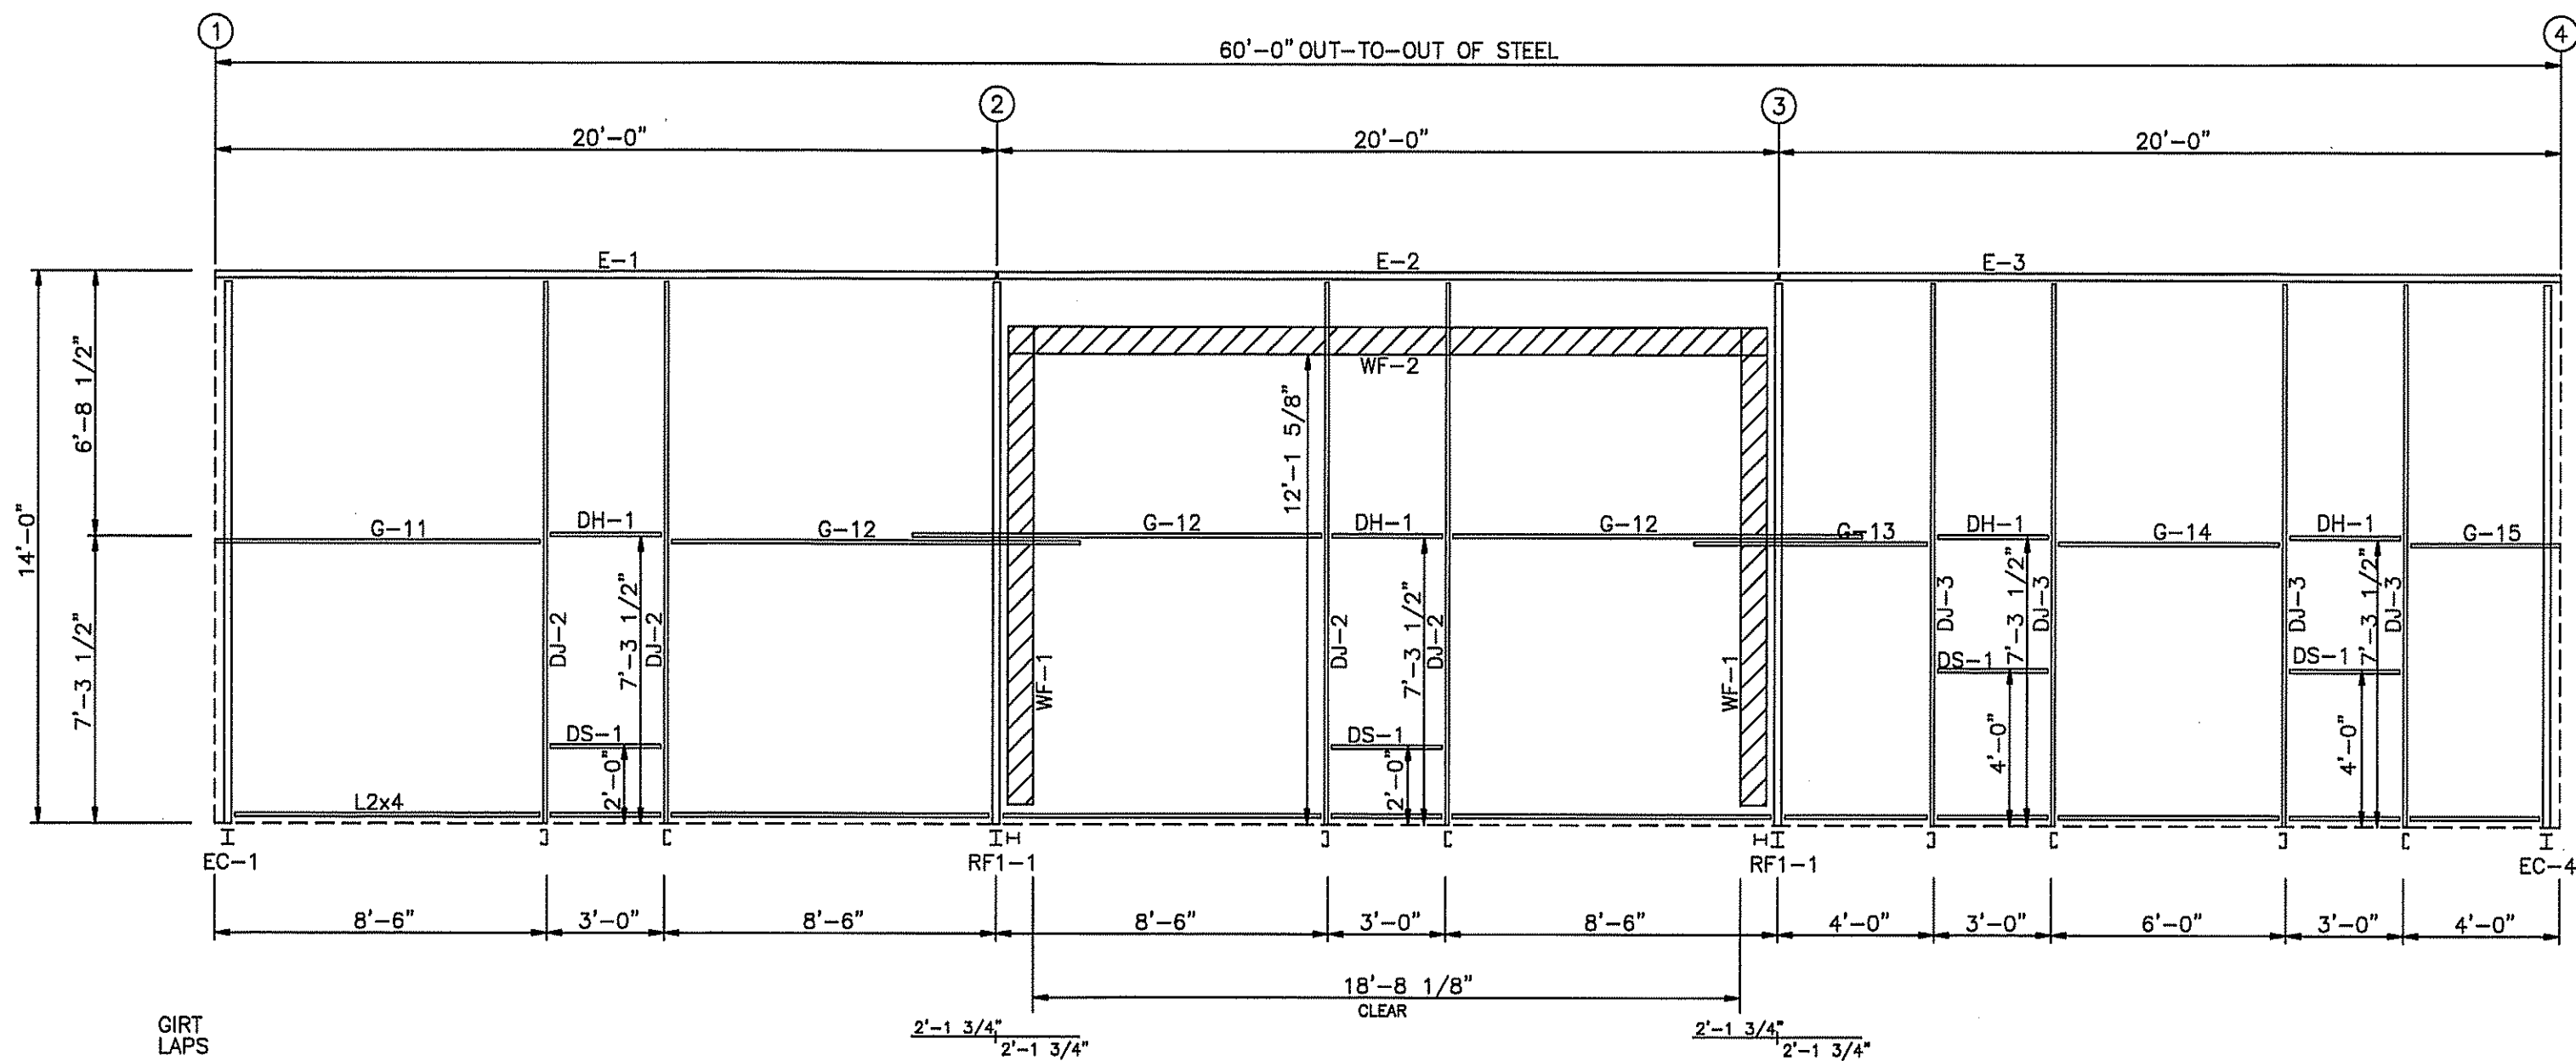


SIDEWALL FRAMING: FRAME LINE A

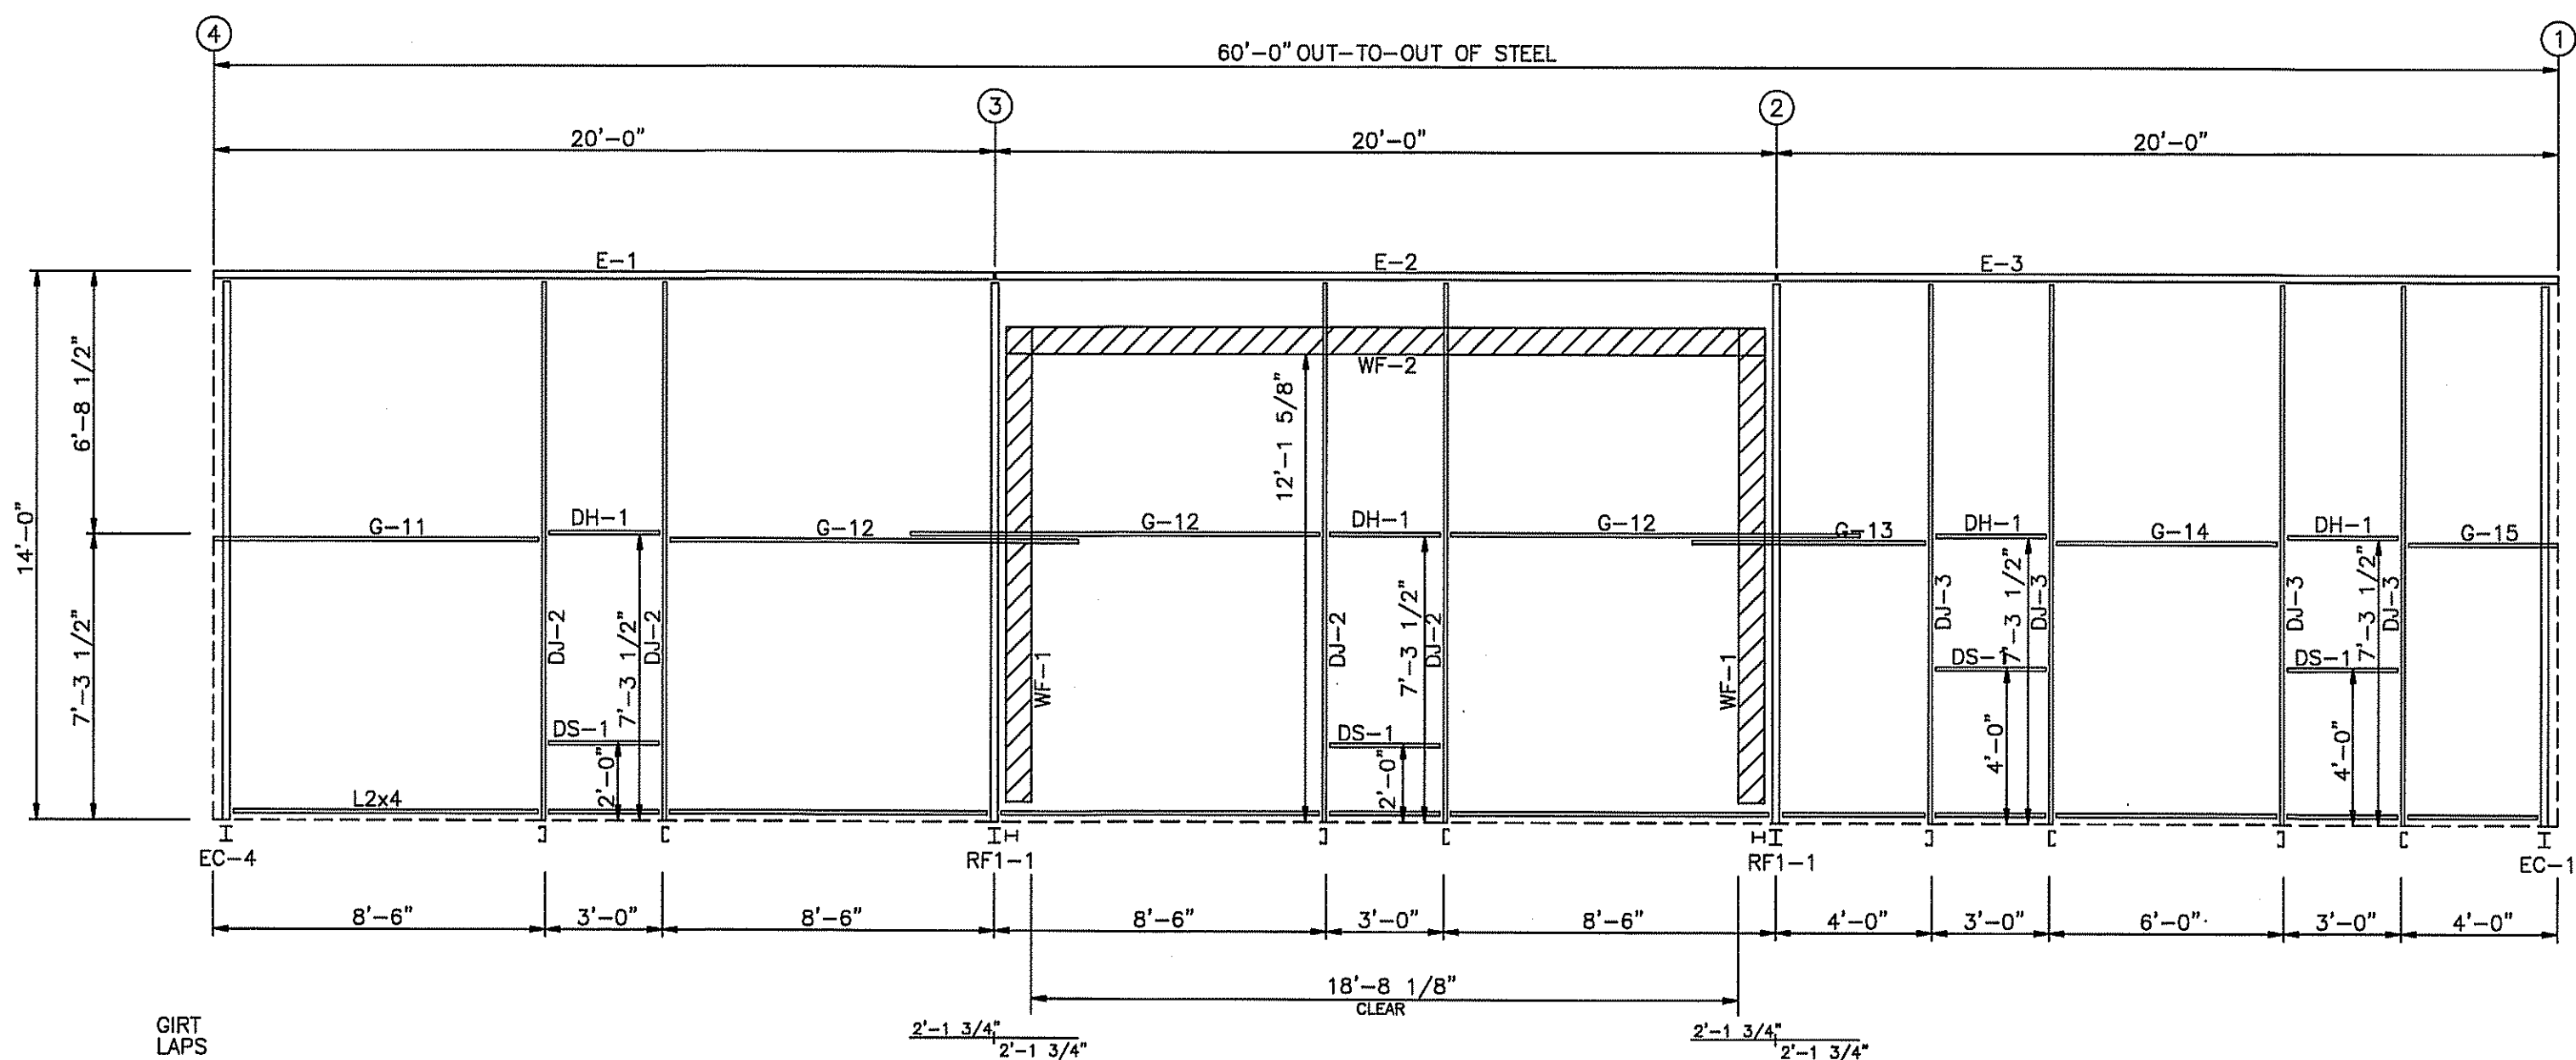

SIDEWALL FRAMING: FRAME LINE F



BOLT TABLE				
FRAME LINE A & F				
LOCATION	QUAN	TYPE	DIA	LENGTH
WF-1 - WF-2	8	A325	3/4"	3"
WF-1 - RF1-1	14	A325	3/4"	3"

MEMBER TABLE		
FRAME LINE A & F		
MARK	PART	LENGTH
WF-1	W8X10	12'-3 3/4"
WF-2	W8X18	18'-7 1/8"
DJ-2	8X25C14	13'-5 3/4"
DJ-3	8X25C14	13'-5 3/4"
DH-1	8X25C14	3'-0"
DS-1	8X25C14	3'-0"
E-1	8E214L3	19'-11 1/2"
E-2	8E214L3	19'-11 1/2"
E-3	8E214L3	19'-11 1/2"
G-11	8X25Z16	8'-3"
G-12	8X25Z16	10'-5"
G-13	8X25Z16	5'-11"
G-14	8X25Z16	5'-6 1/2"
G-15	8X25Z16	3'-9"

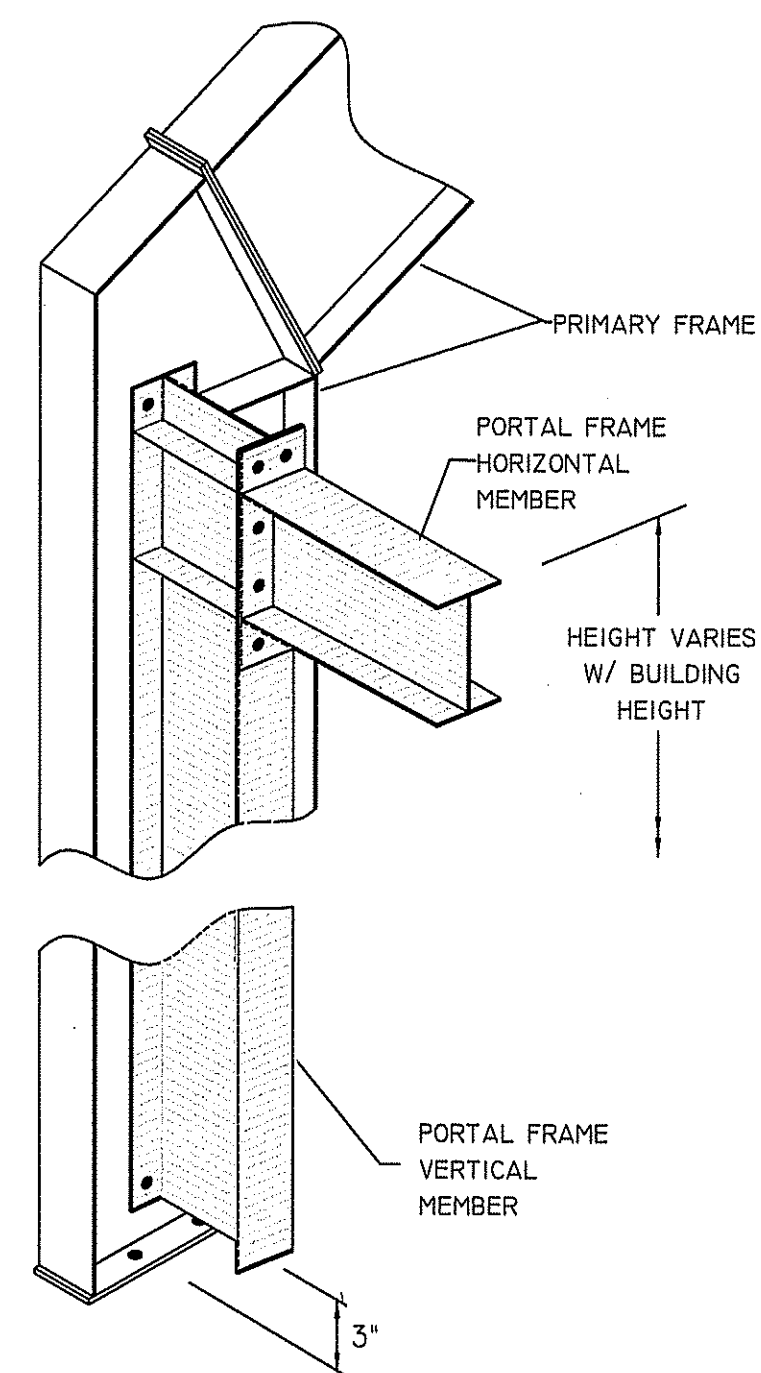

PORTAL FRAME CONNECTION DETAIL

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

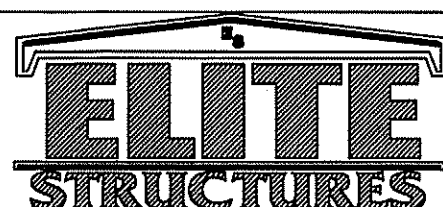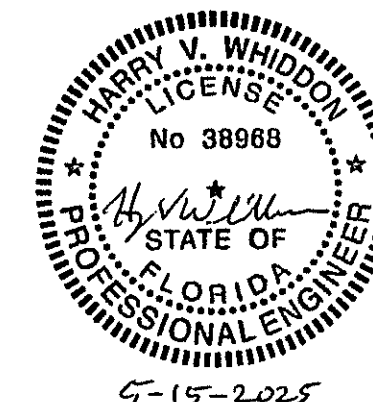

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620

SCALE: N.T.S.
DRAWN BY: C. REVILL
BUILDING SIZE: 40X60X14
DATE: 9/3/24
SALESMAN: L. WHITEHURST
DATE: 5/14

REVISION

NO.	DESCRIPTION
1	TOOK OFF SOME WAINSCOTT


TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN
SIDEWALL FRAMING


JOB #
13325-SF

SHEET 3 OF 13

5-15-2025

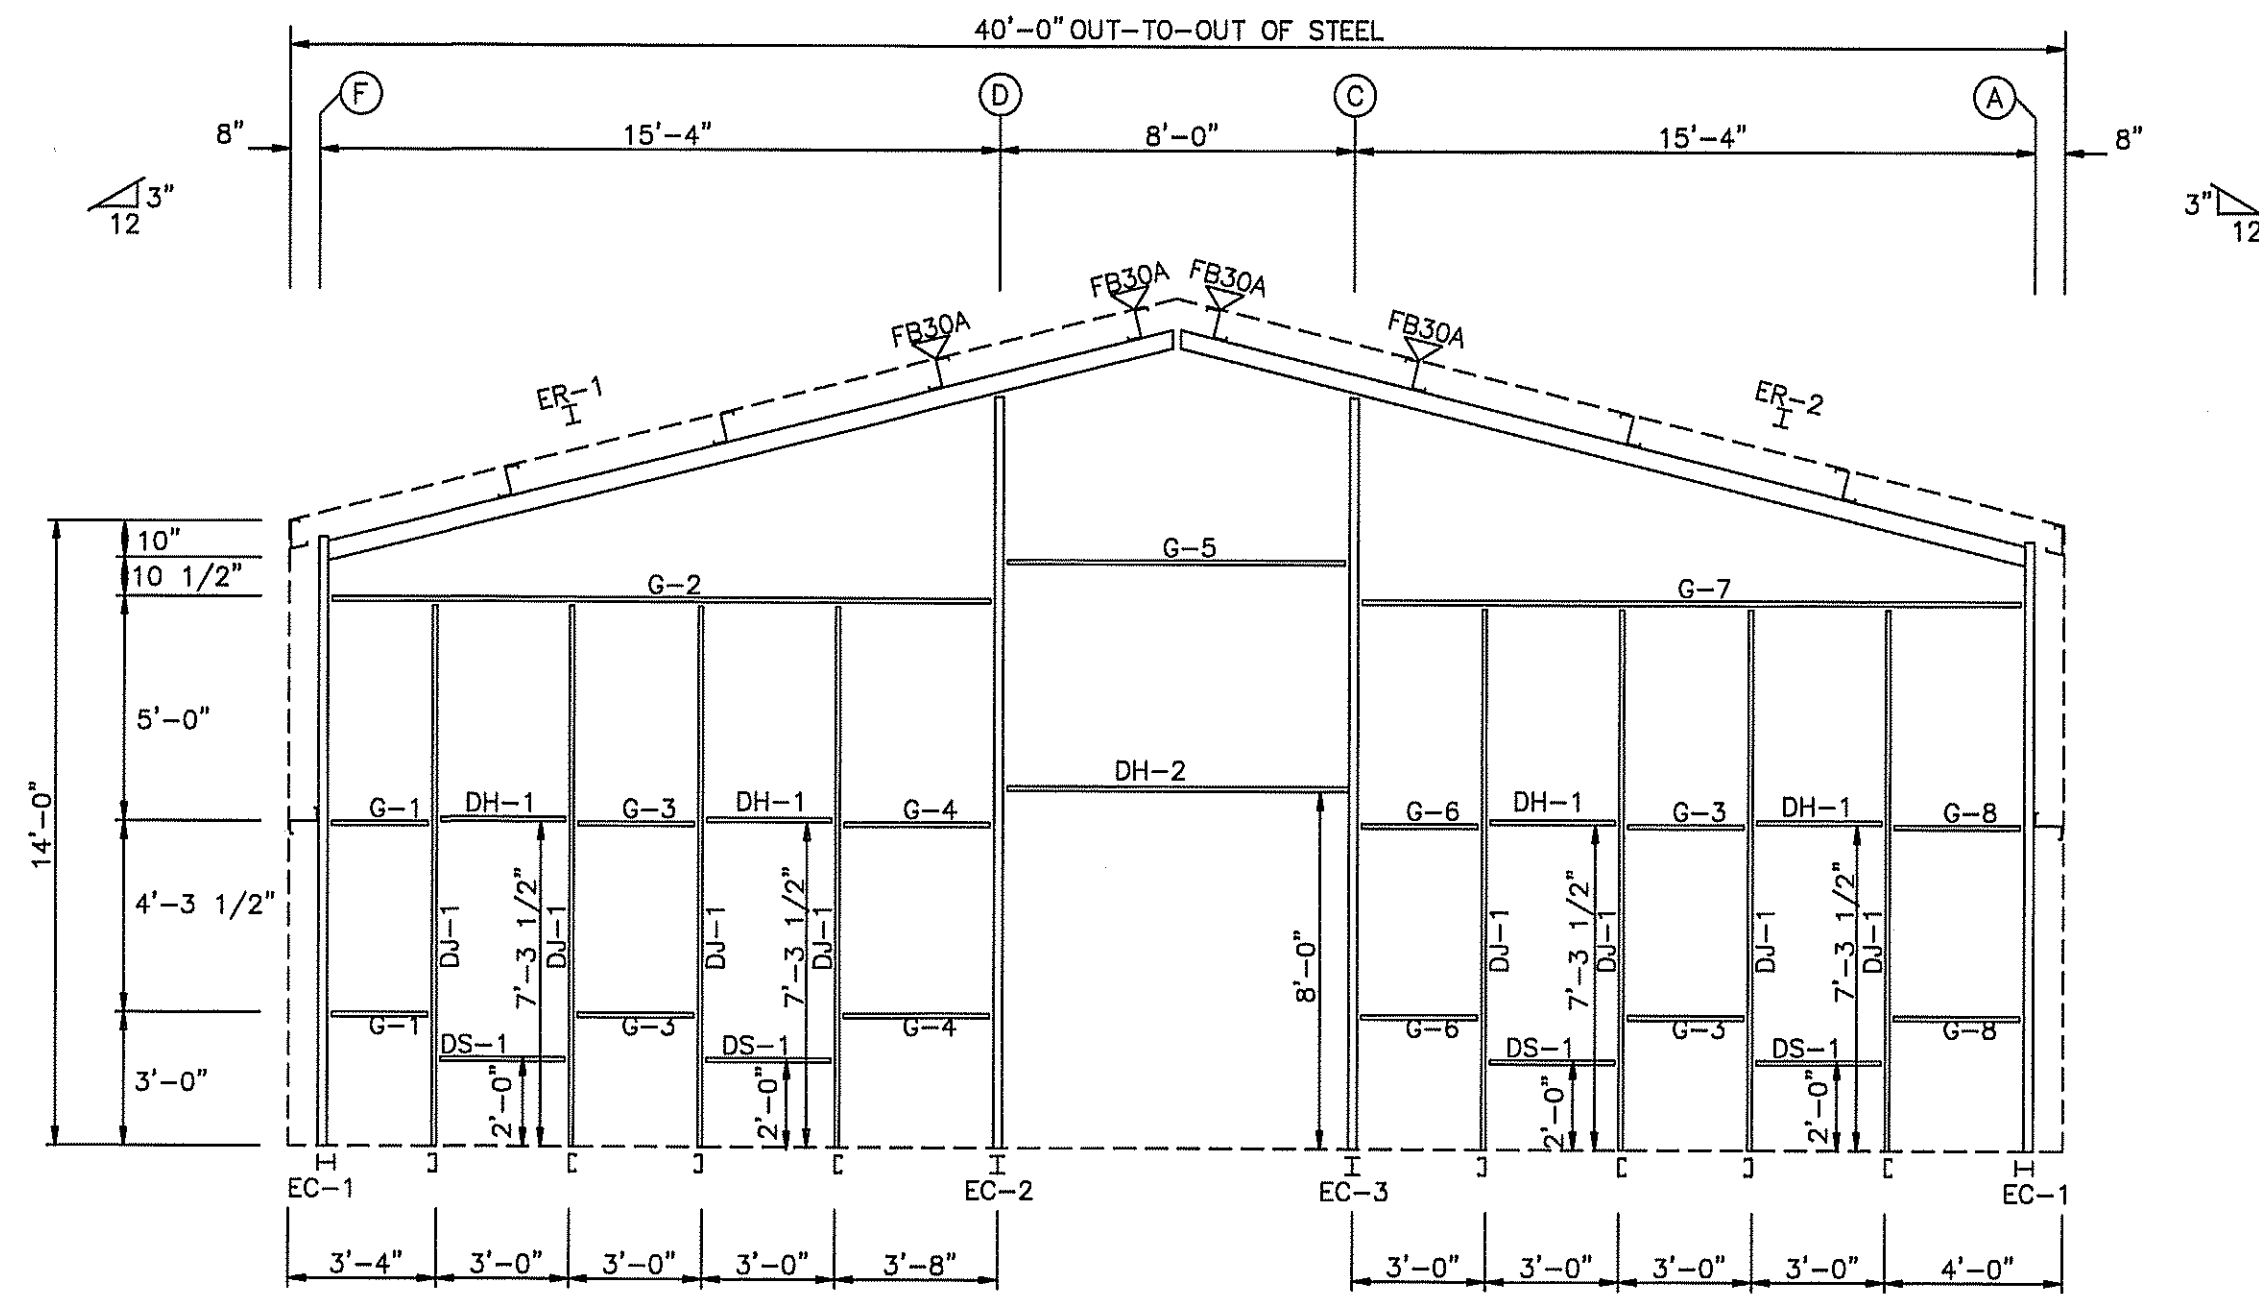

ENDWALL FRAMING: FRAME LINE 1

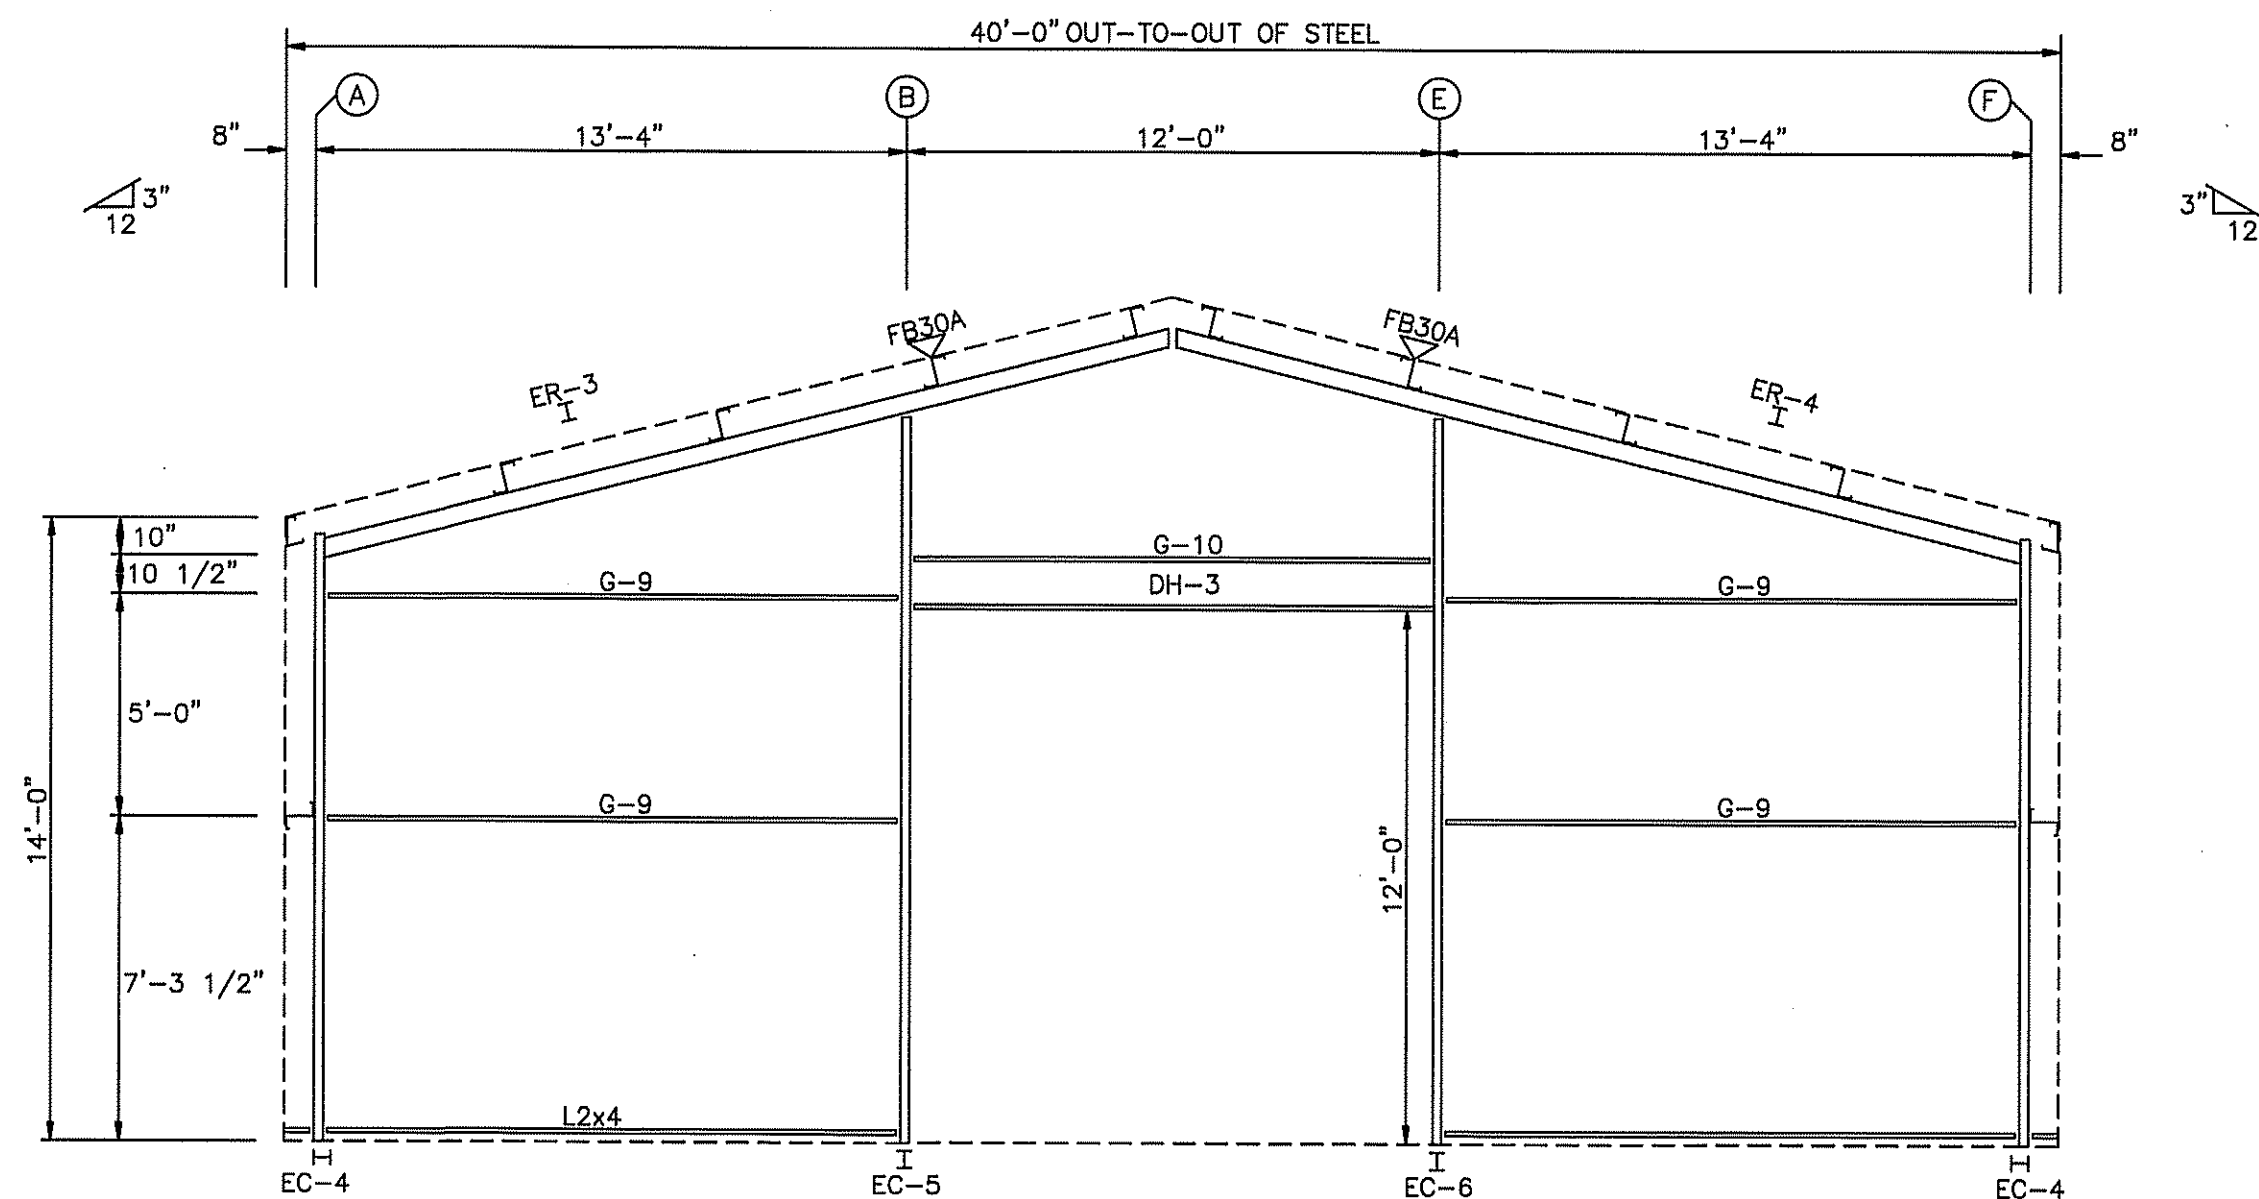


ENDWALL FRAMING: FRAME LINE 4

BOLT TABLE FRAME LINE 1 & 4				
LOCATION	QUAN	TYPE	DIA	LENGTH
Cor_Column/Raf	4	A325	3/4"	3"
ER-1/ER-2	8	A325	3/4"	3"
ER-3/ER-4	8	A325	3/4"	3"
Int_Column/Raf	4	A325	1/2"	1 1/2"

MEMBER TABLE FRAME LINE 1 & 4		
MARK	PART	LENGTH
EC-1	WBX10	13'-7 3/4"
EC-2	WBX10	16'-8 1/8"
EC-3	WBX10	16'-8 1/8"
EC-4	WBX10	13'-7 3/4"
EC-5	WBX10	16'-8 1/8"
EC-6	WBX10	16'-8 1/8"
ER-1	WBX10	19'-9 1/2"
ER-2	WBX10	19'-9 1/2"
ER-3	WBX10	19'-9 1/2"
ER-4	WBX10	19'-9 1/2"
DJ-1	8X25C14	12'-0 1/2"
DJ-2	8X25C14	3'-0"
DH-1	8X35C14	7'-7 1/2"
DH-2	8X35C14	11'-7 1/2"
DS-1	8X25C14	3'-0"
G-1	8X25Z16	3'-0 1/8"
G-2	8X25Z16	14'-5 5/8"
G-3	8X25Z16	2'-6 1/2"
G-4	8X25Z16	3'-7 1/2"
G-5	8X25Z16	2'-7 1/2"
G-6	8X25Z16	14'-5 5/8"
G-7	8X25Z16	2'-5 1/8"
G-8	8X25Z16	12'-5 5/8"
G-9	8X25Z16	11'-7 1/2"
G-10	8X25Z16	11'-7 1/2"

FLANGE BRACE TABLE FRAME LINE 1 & 4		
MARK	TYPE	LENGTH
1	FB30A	2'-6"

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

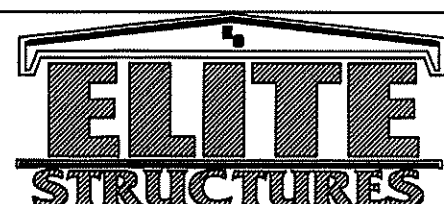

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620

SCALE: N.T.S. DATE: 9/3/24
DRAWN BY: C.REVILL SALESMAN: L.WHITEHURST
BUILDING SIZE: 40X60X14


REVISION
DATE: 5/14 DESCRIPTION: TOOK OFF SOME OF WAINSCOTT

TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN
ENDWALL FRAMING

JOB #
13325-EF
SHEET 4 OF 13


5-15-2025

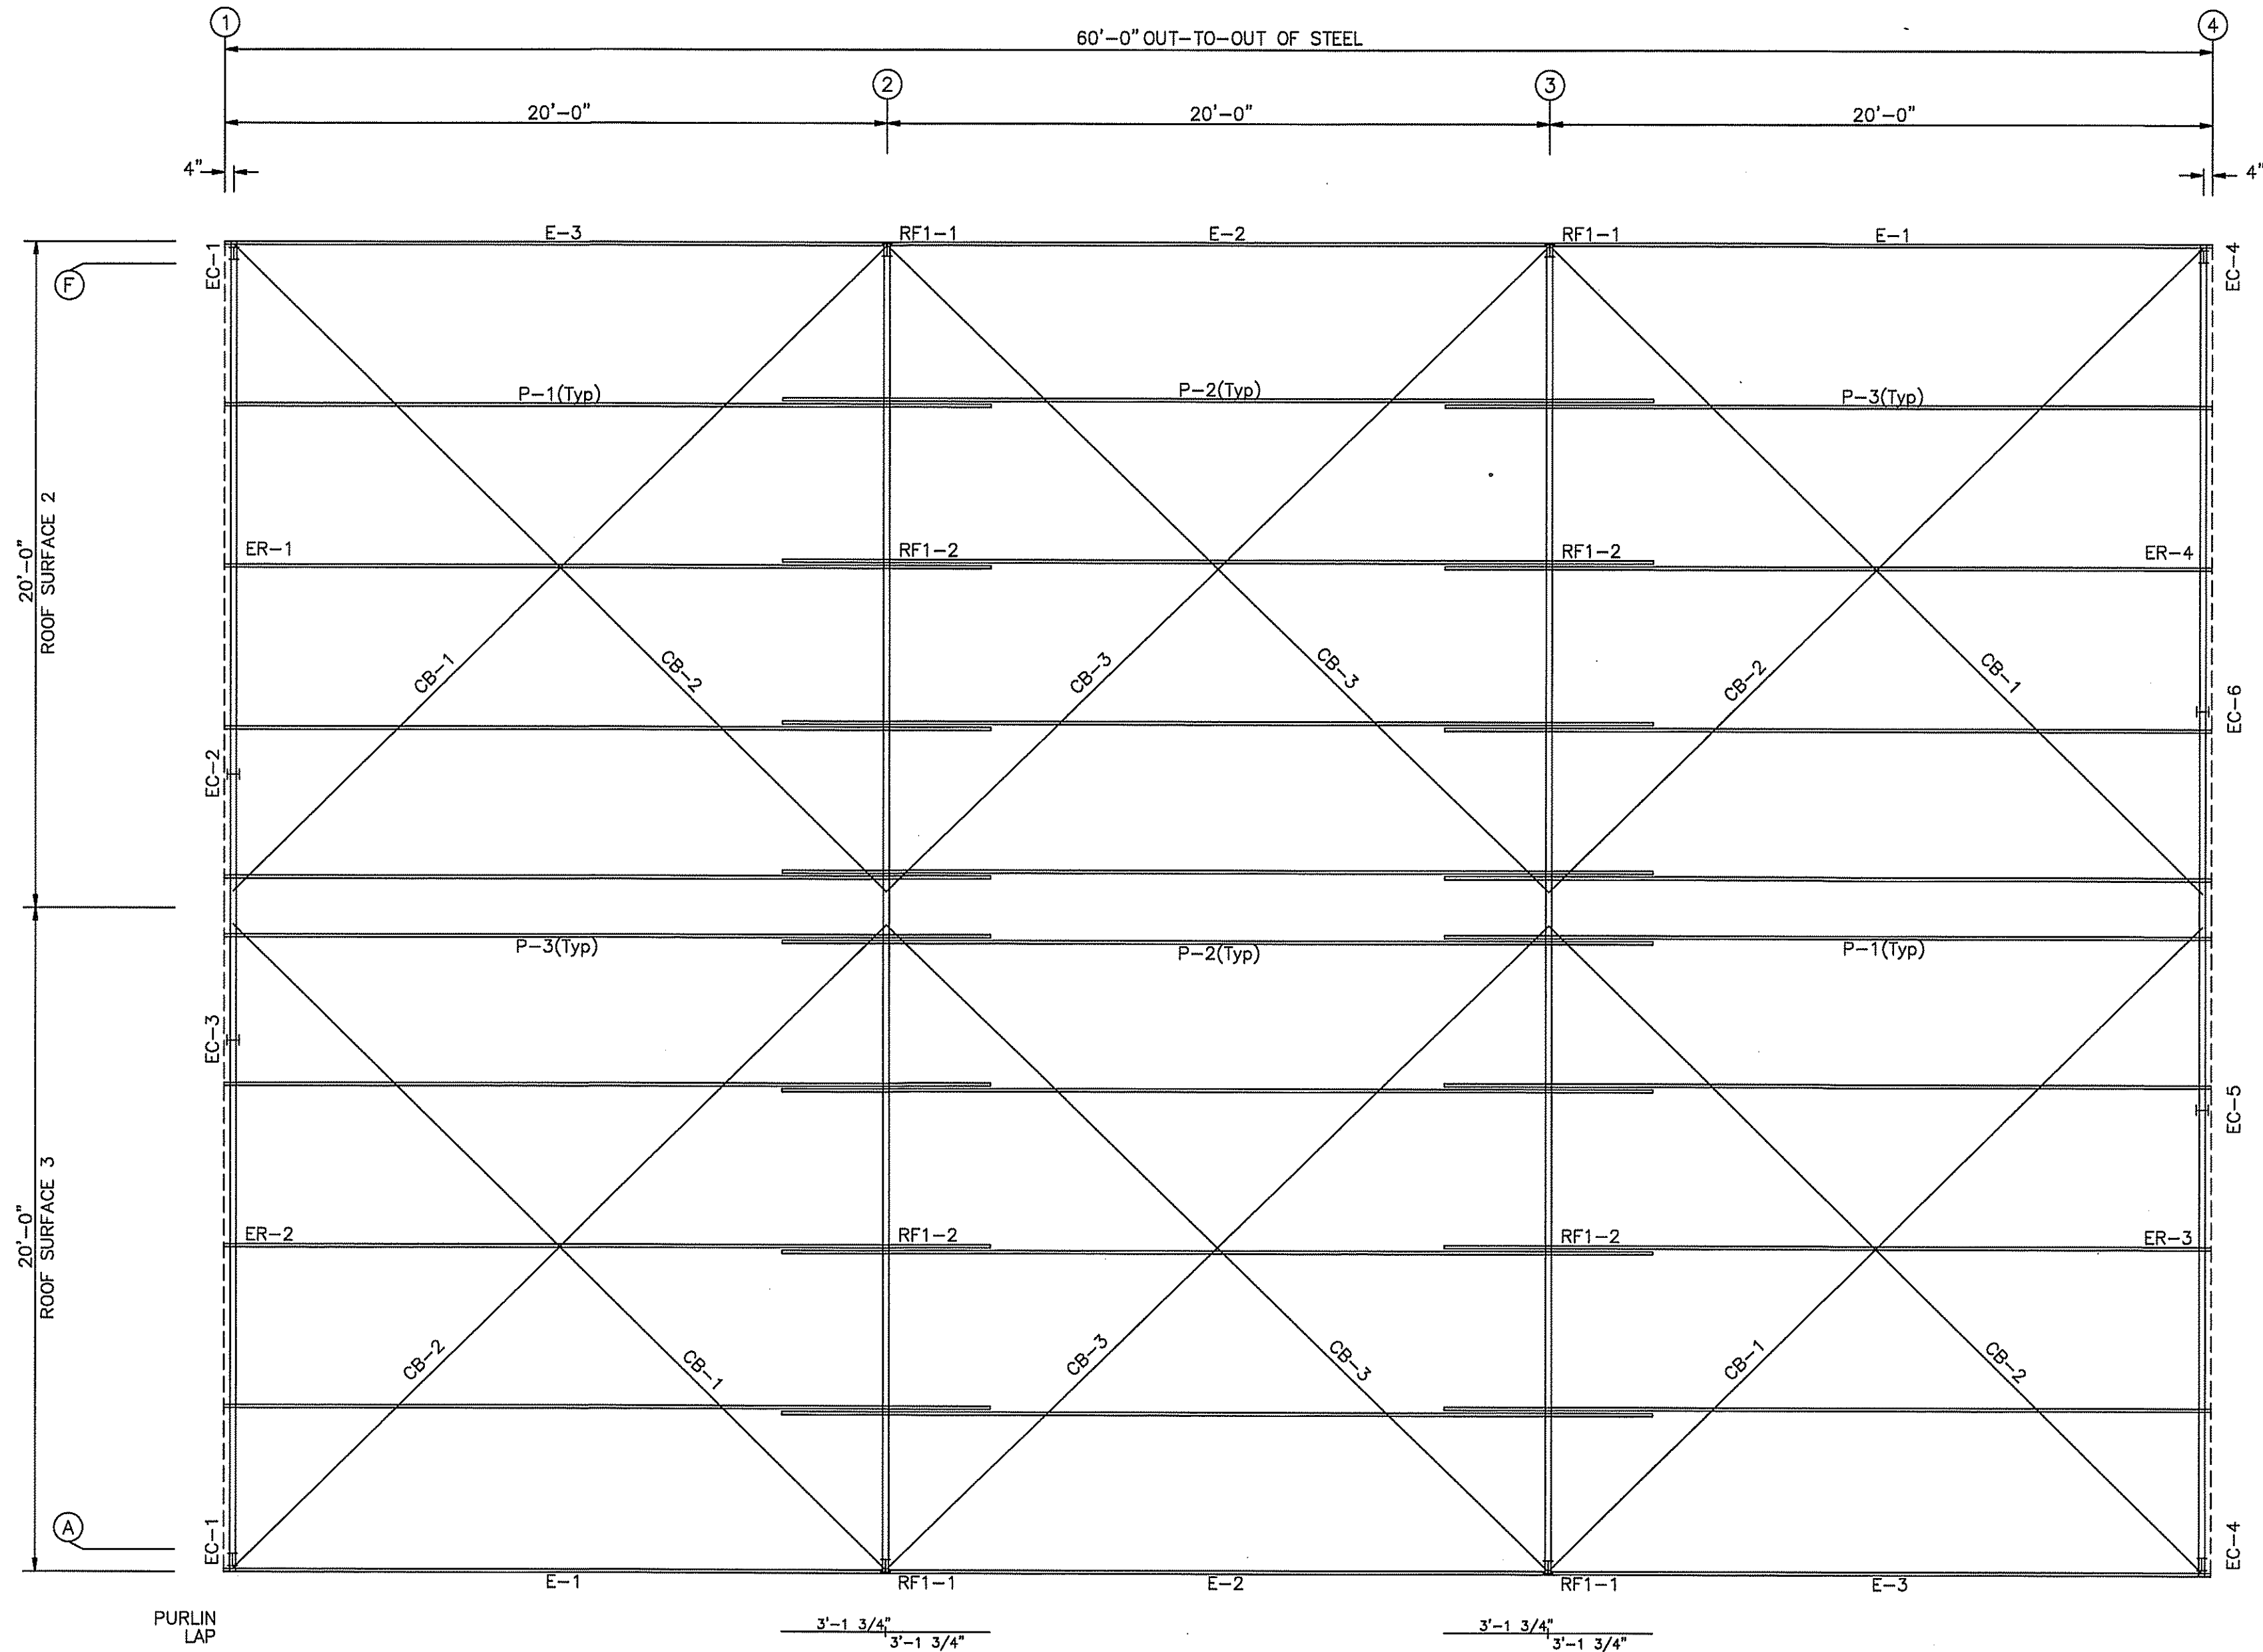

MEMBER TABLE		
ROOF PLAN		
MARK	PART	LENGTH
P-1	8X25Z16	23'-1 1/2"
P-2	8X25Z16	26'-3 1/2"
P-3	8X25Z16	23'-1 1/2"
E-1	8E214L3	19'-11 1/2"
E-2	8E214L3	19'-11 1/2"
E-3	8E214L3	19'-11 1/2"
CB-1	1/4_CBL	27'-9"
CB-2	1/4_CBL	27'-5"
CB-3	1/4_CBL	28'-0"

ROOF FRAMING PLAN

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

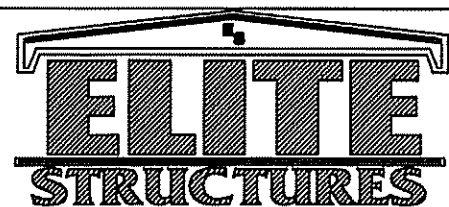

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620

SCALE: N.T.S.
DRAWN BY: C.REVILL

DATE: 9/3/24
SALESMAN: L.WHITEHURST
BUILDING SIZE: 40X60X14

REVISION

DATE	DESCRIPTION
5/14	TOOK OFF SOME OF WAINSCOTT

TITLE/LOCATION

I.C. CONSTRUCTION
LAKE CITY, FL


PLAN:

ROOF FRAMING


JOB #

13325-RF

SHEET 5 OF 13

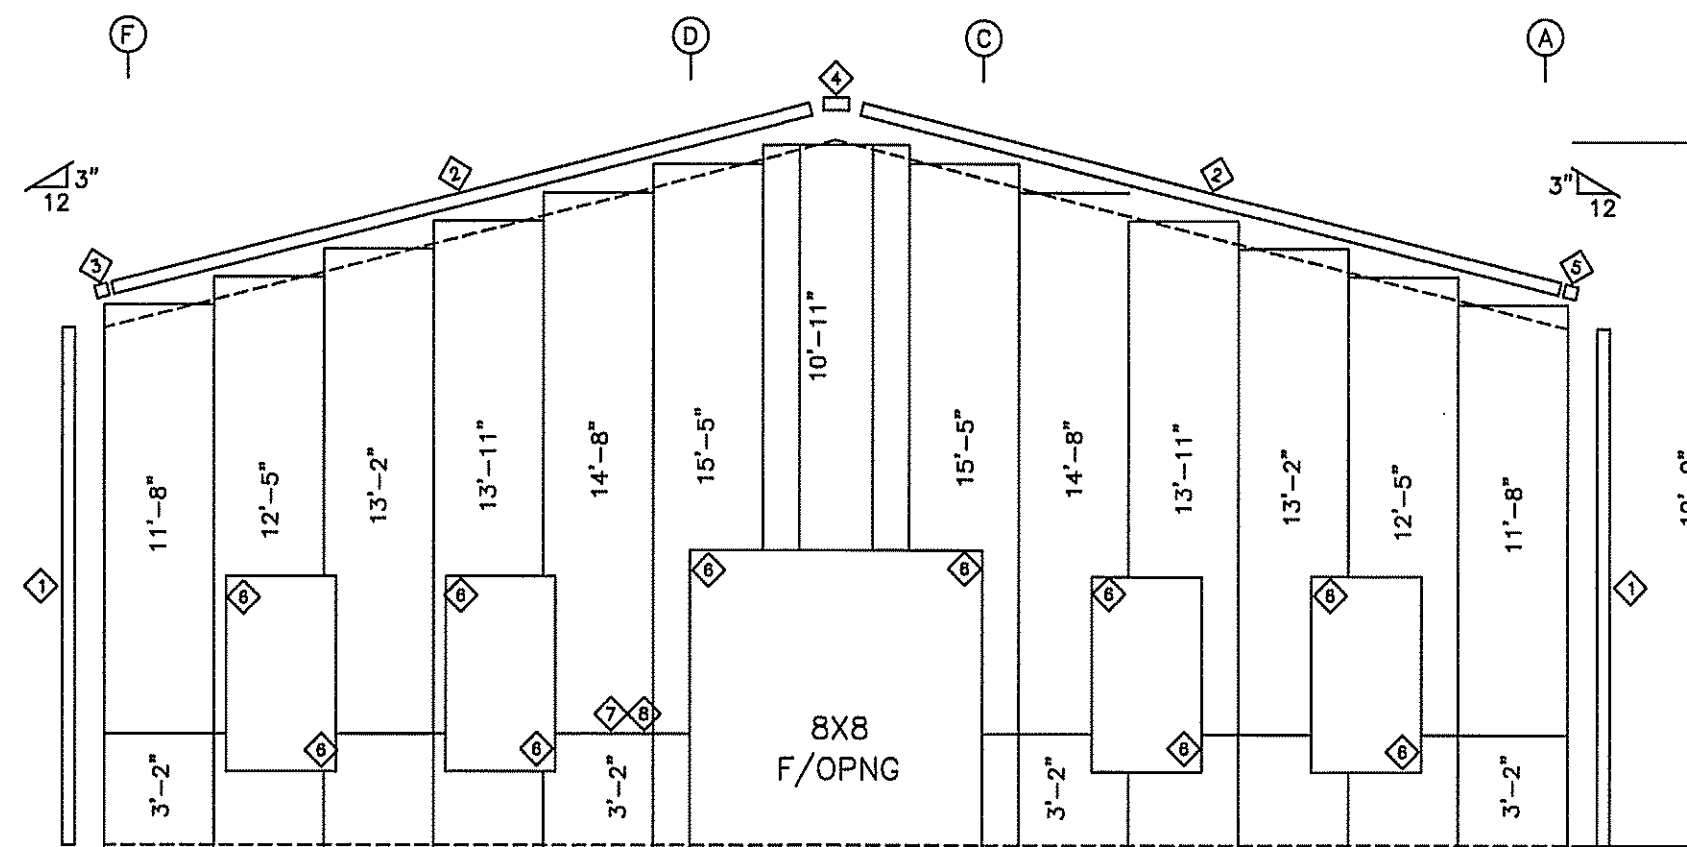


ENDWALL SHEETING & TRIM: FRAME LINE 1

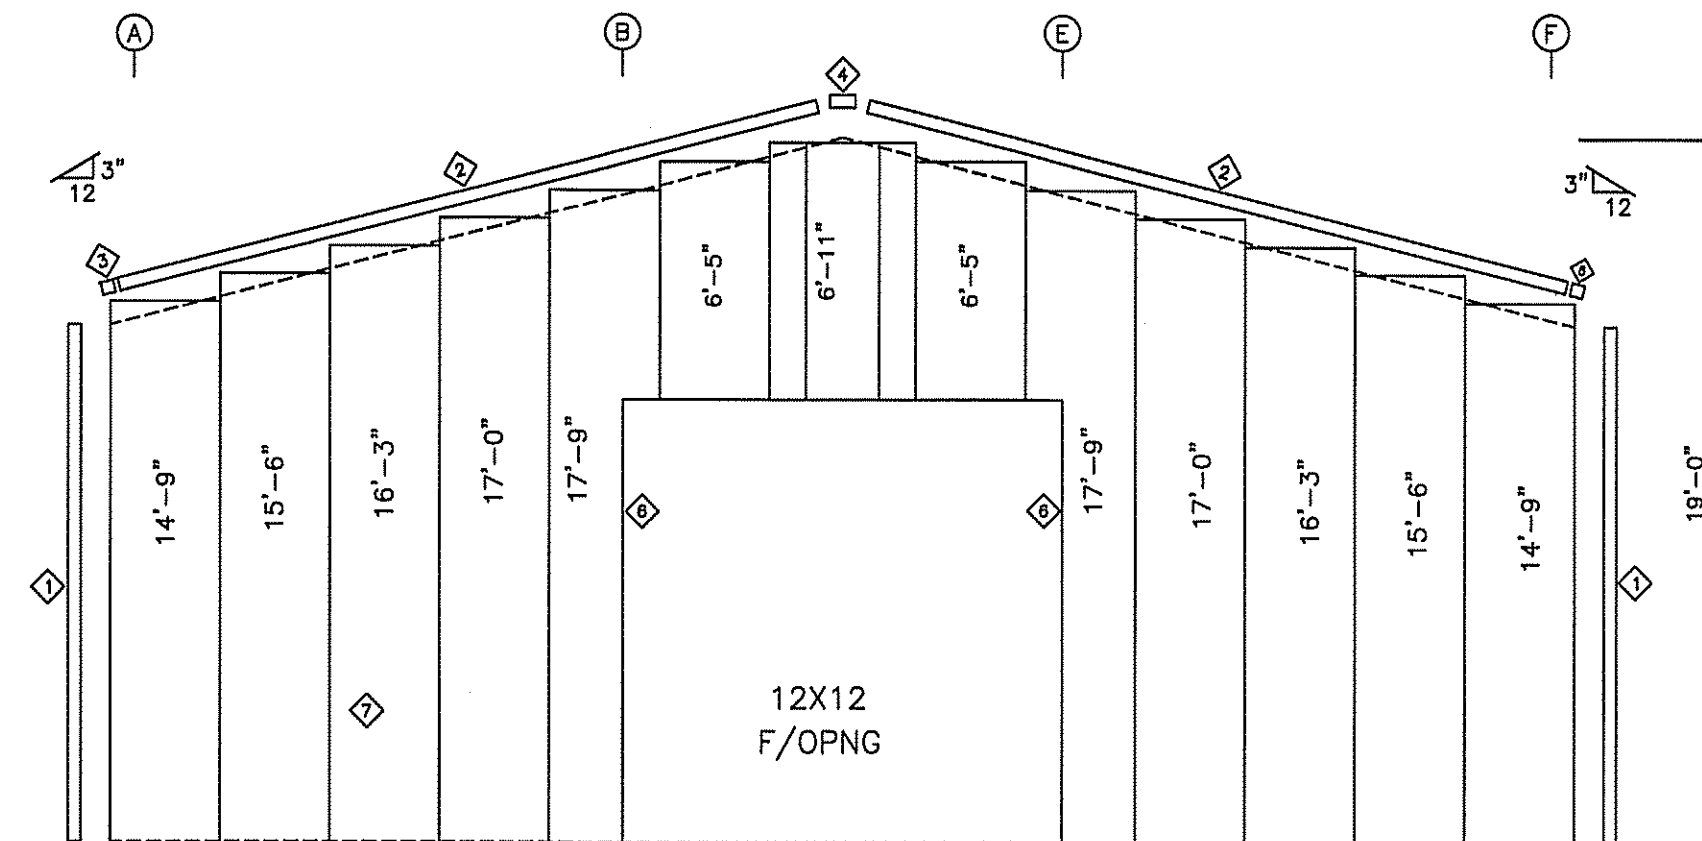

ENDWALL SHEETING & TRIM: FRAME LINE 4


TRIM TABLE FRAME LINE 1 & 4		
ID	PART	DETAIL
1	FL-830	TRIM_47
2	E-101	TRIM_16
3	E-145	TRIM_7
4	E-146	TRIM_23
5	E-105	TRIM_7
6	FL-26	TRIM_49
7	E-156	TRIM_77
8	E-156	TRIM_77
9	E-108	TRIM_43

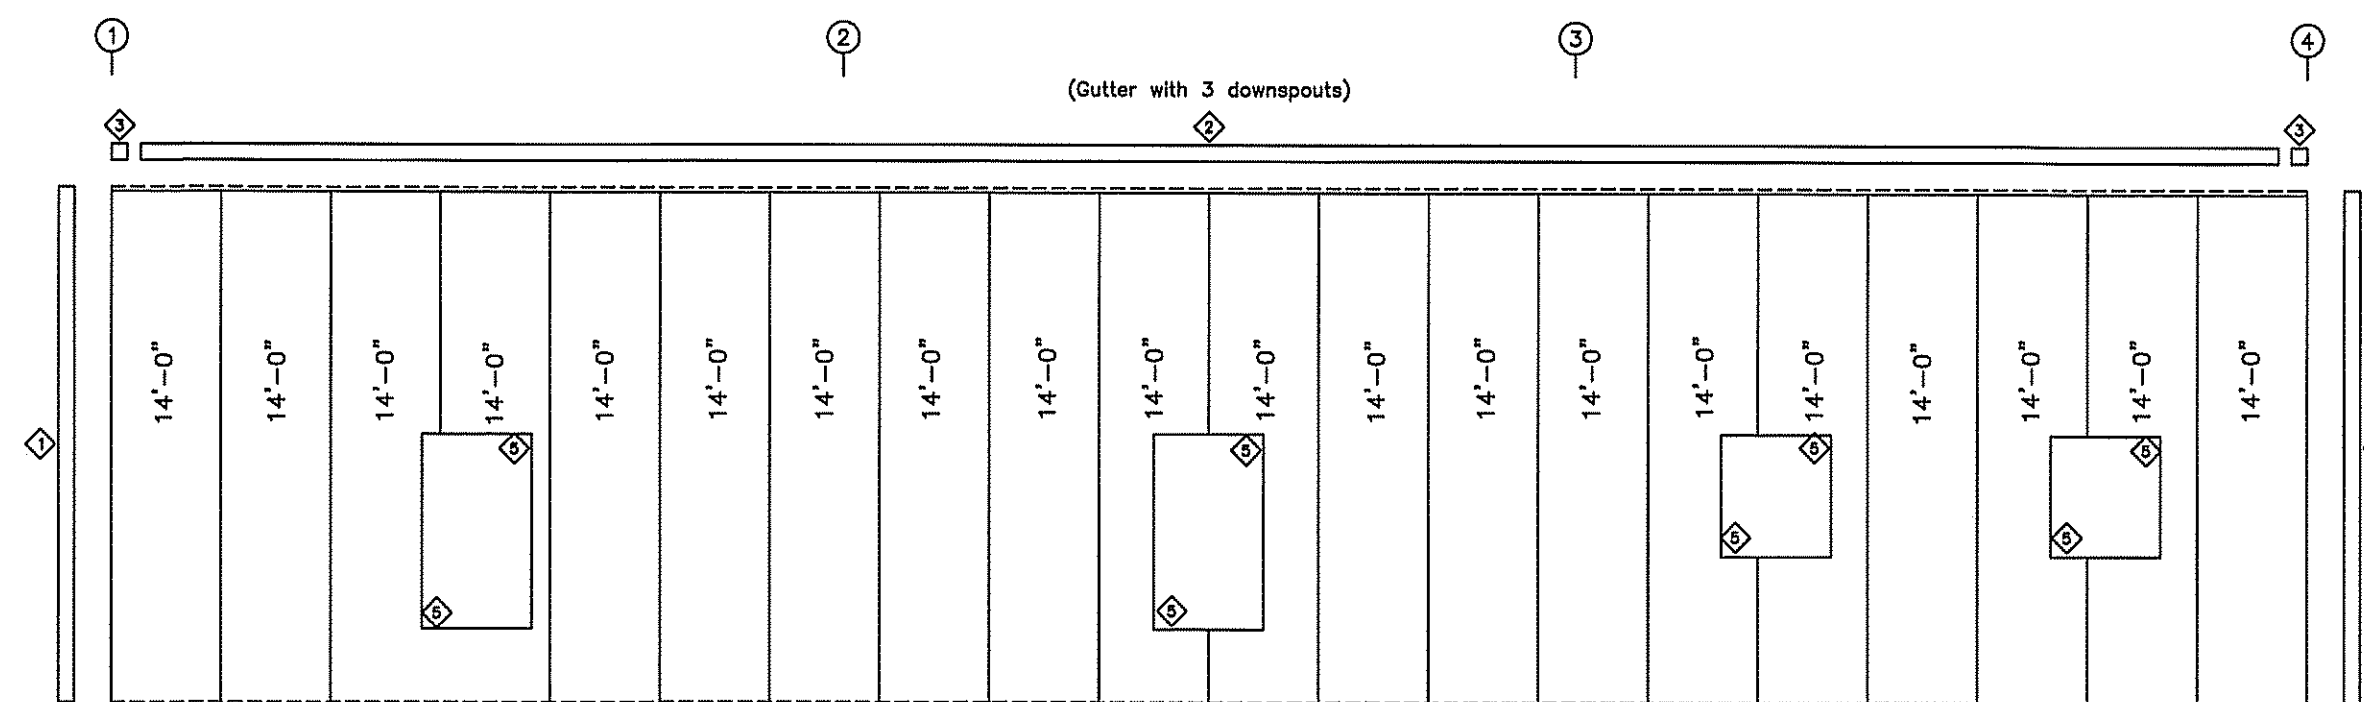

SIDEWALL SHEETING & TRIM: FRAME LINE A

PANELS: 26 Ga. PBR - NEED COLOR
[A] PANELS: 26 Ga. PBR - White



TRIM TABLE FRAME LINE A & F		
ID	PART	DETAIL
1	E-108	TRIM_43
2	FL-830	TRIM_47
3	E-114	TRIM_30
4	E-115	TRIM_33
5	FL-26	TRIM_49

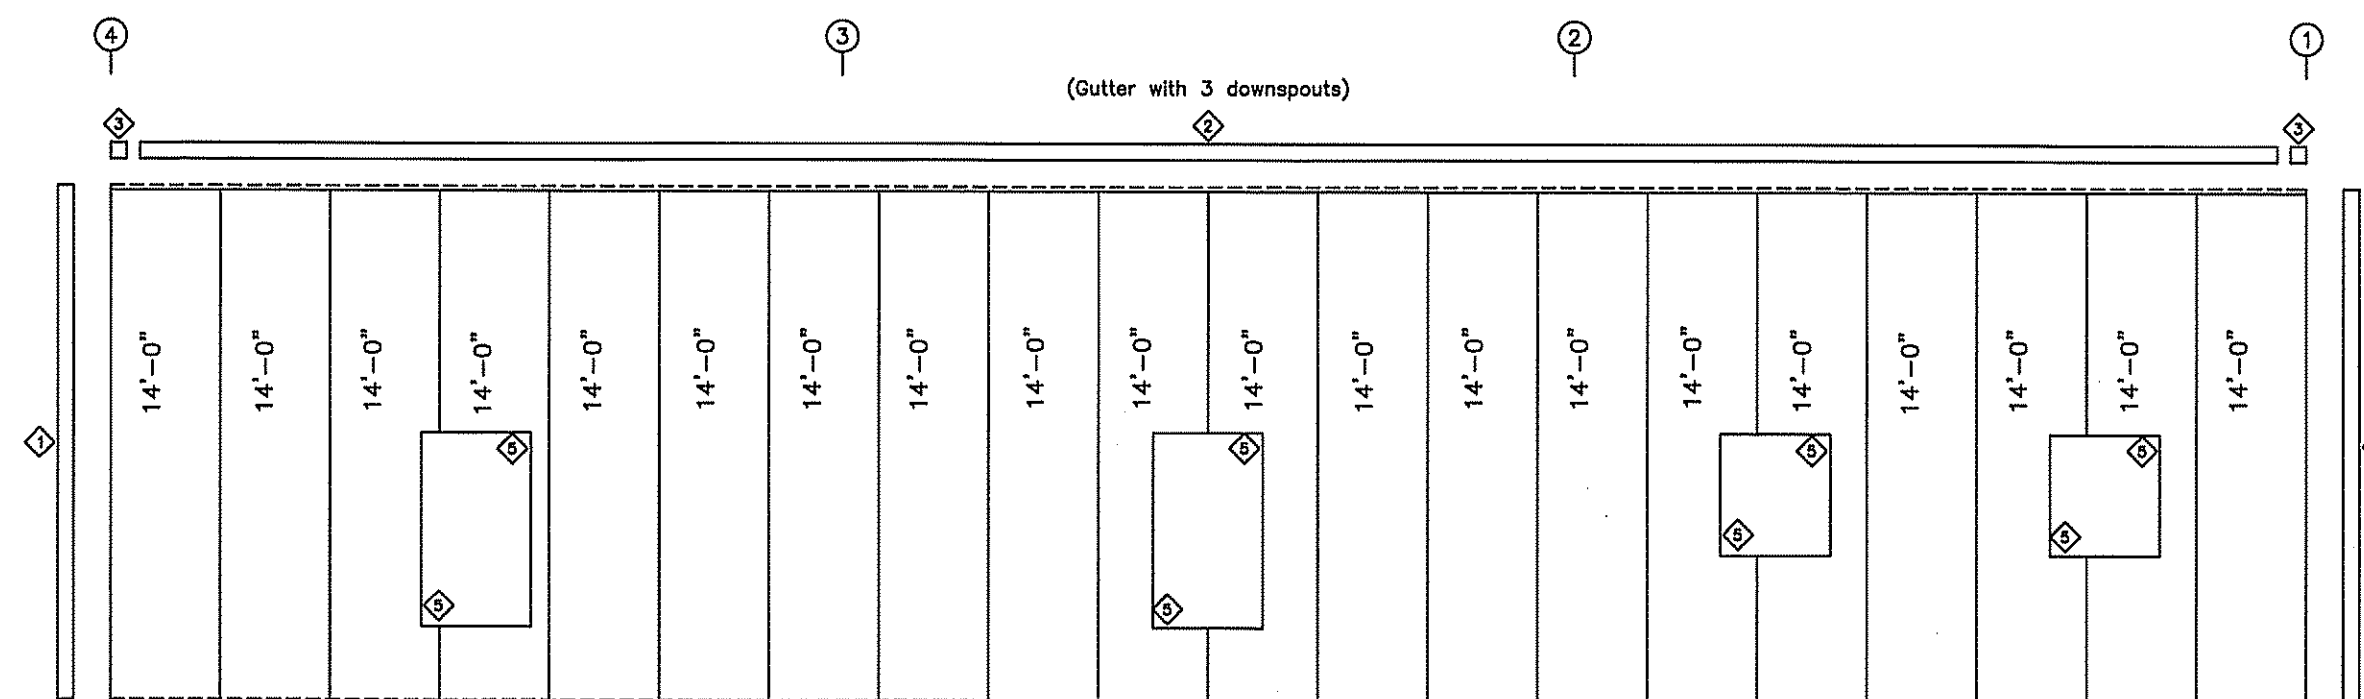

SIDEWALL SHEETING & TRIM: FRAME LINE F

PANELS: 26 Ga. PBR - NEED COLOR
[A] PANELS: 26 Ga. PBR - White

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

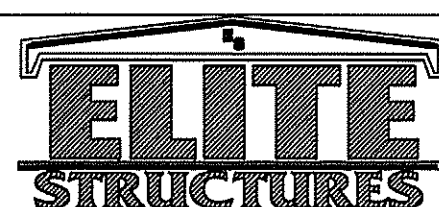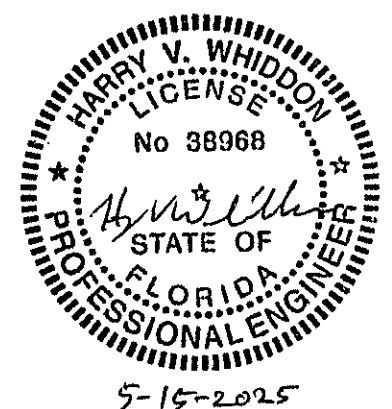

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620

SCALE: N.T.S. DATE: 9/3/24
DRAWN BY: C.REVILL SALESMAN: L.WHITEHURST
BUILDING SIZE: 40X60X14


REVISION
DATE: 5/14 DESCRIPTION: took off some of the walnscott

TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN
WALL SHEETING

JOB #
13325-WS
SHEET 6 OF 13



○ DOWNSPOUT LOCATIONS

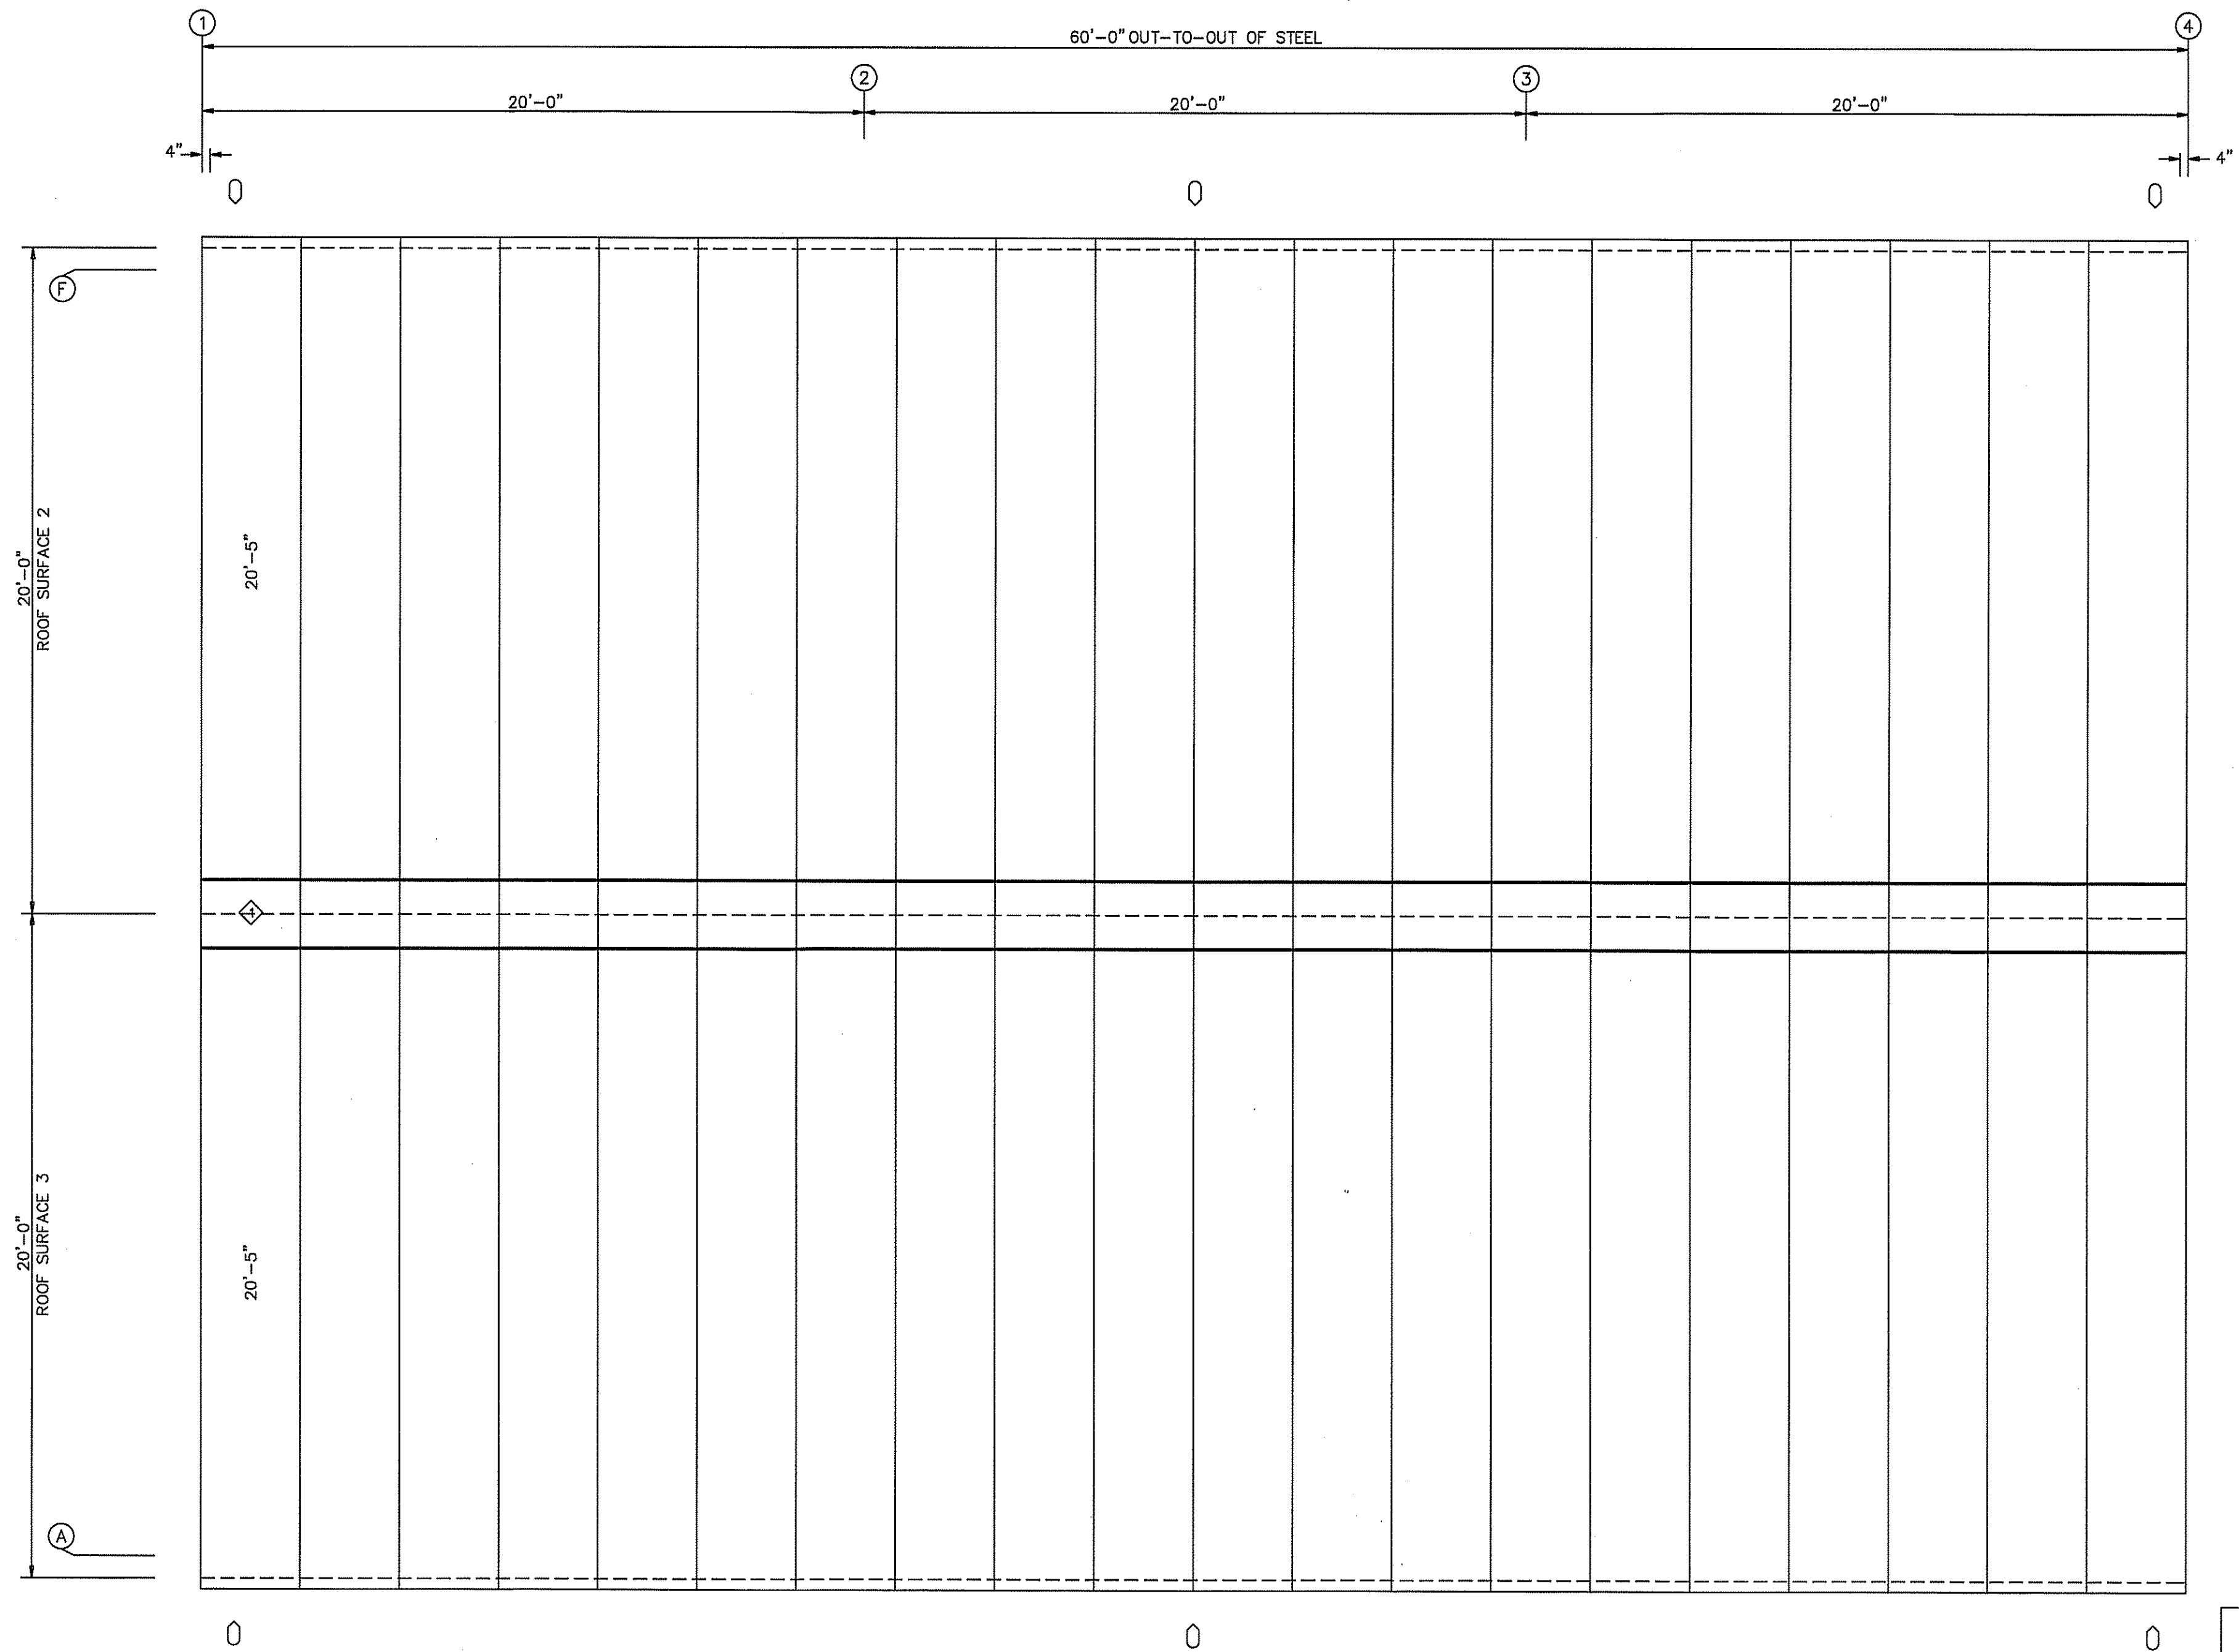

ROOF SHEETING PLAN
PANELS: 26 Ga. PBR - Galvalume

TRIM TABLE
ROOF PLAN
○ ID PART
1 FL-51

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

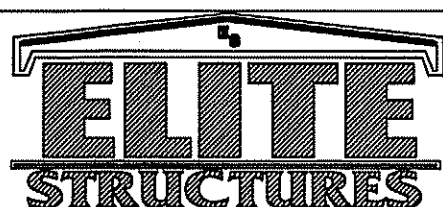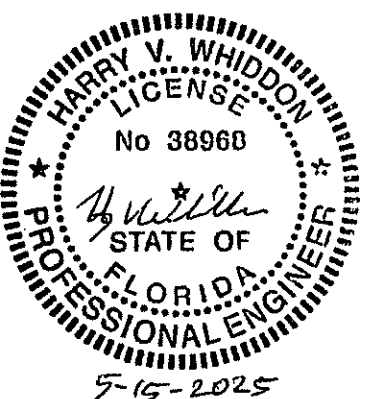

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620





SCALE: N.T.S. DATE: 9/3/24
DRAWN BY: CREVILL SALESMAN: L. WHITEHURST
BUILDING SIZE: 40X60X14

REVISION	
DATE	DESCRIPTION
5/14	TOOK OFF SOME OF THE WAINSCOTT

TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN:
ROOF SHEETING



JOB #
13325-RS
SHEET 7 OF 13

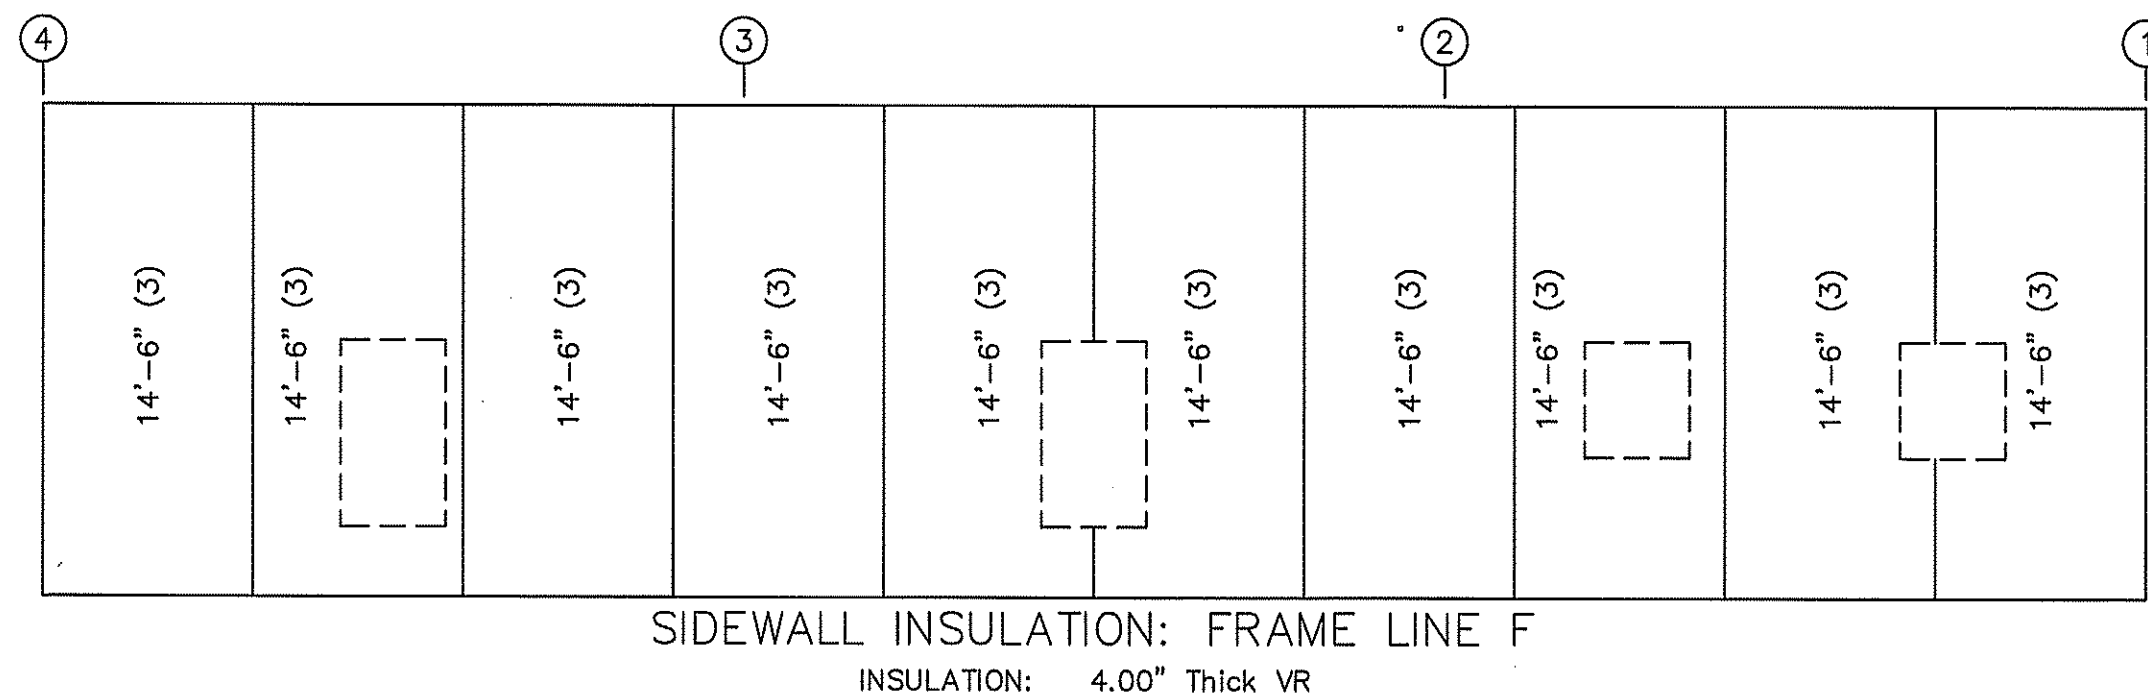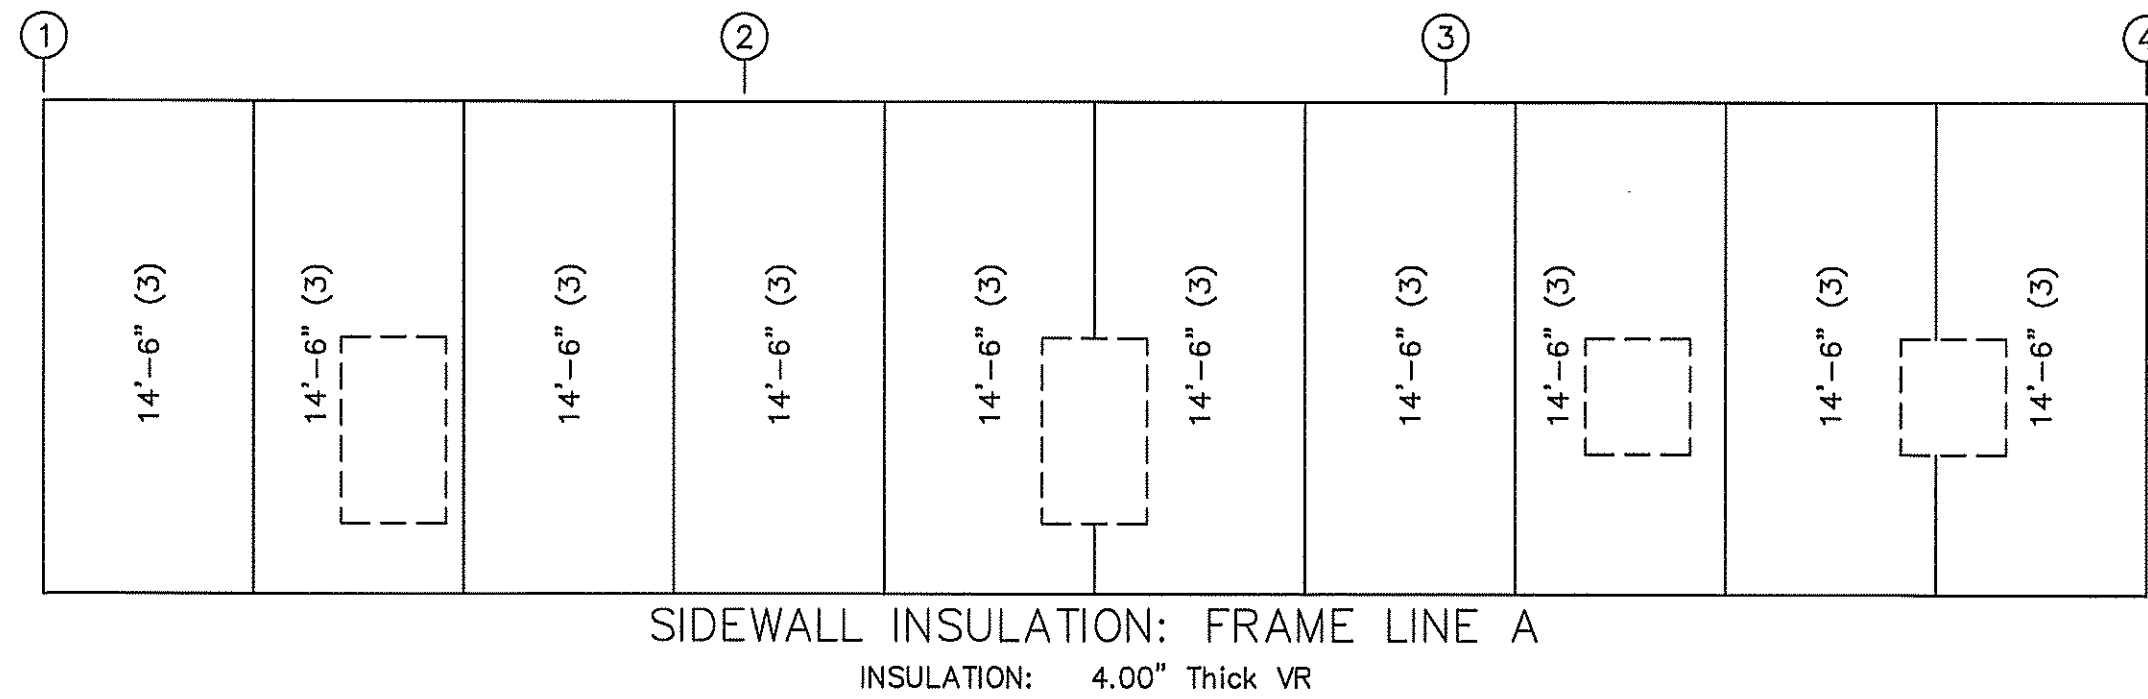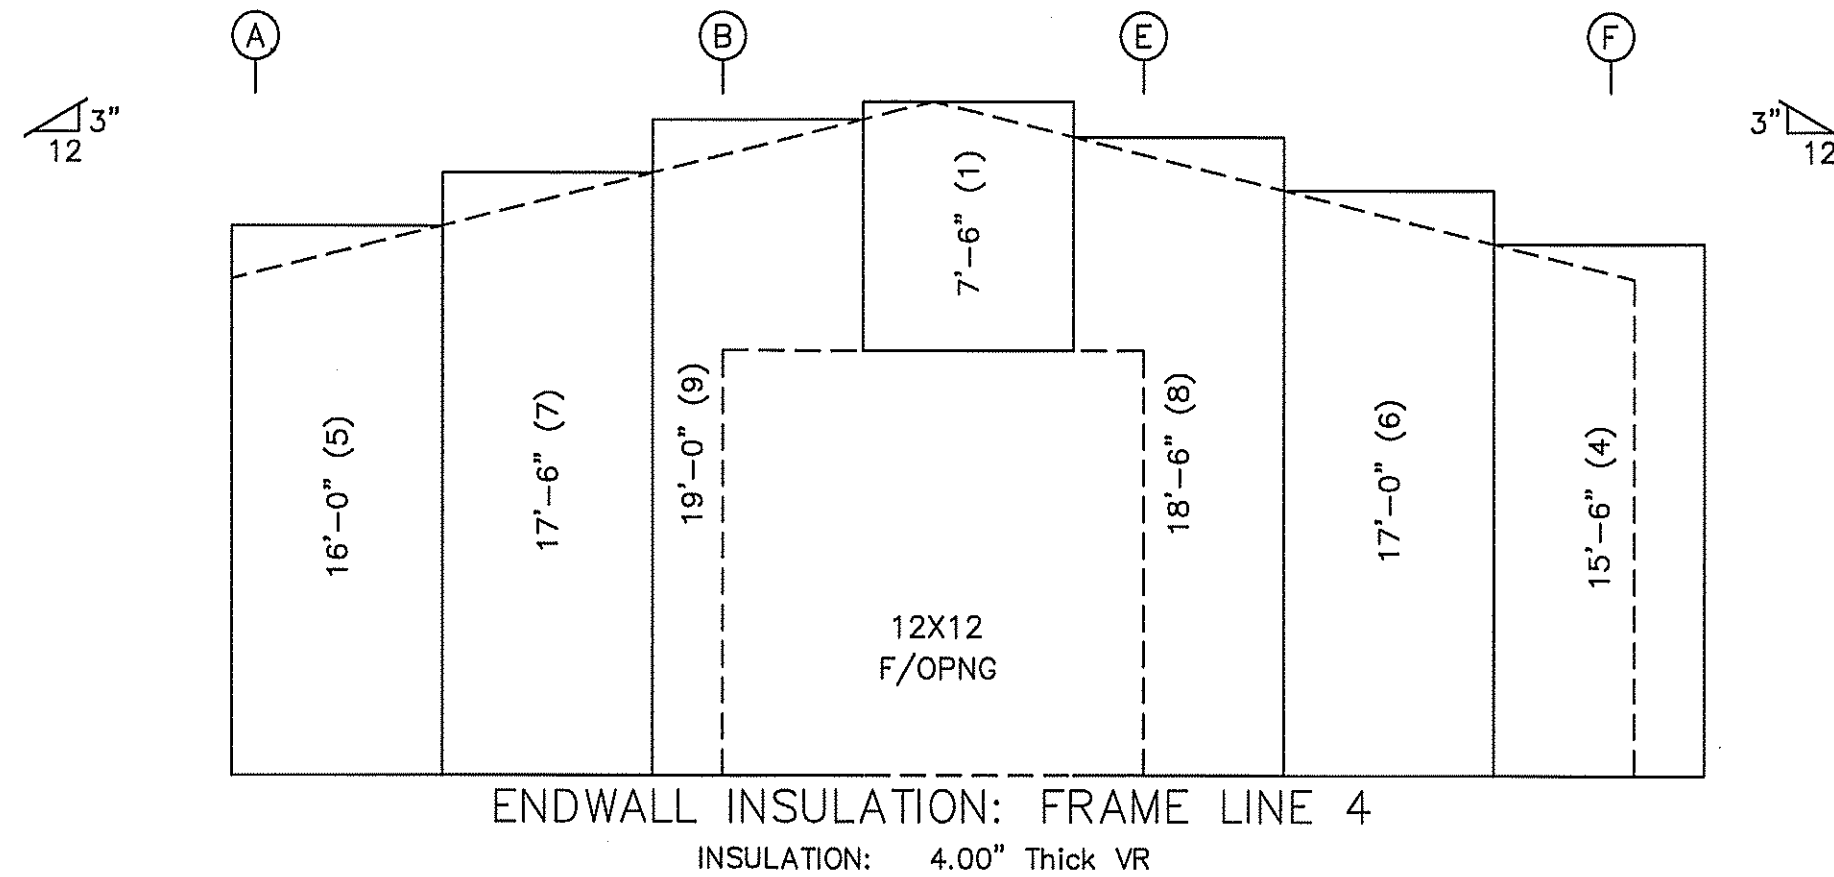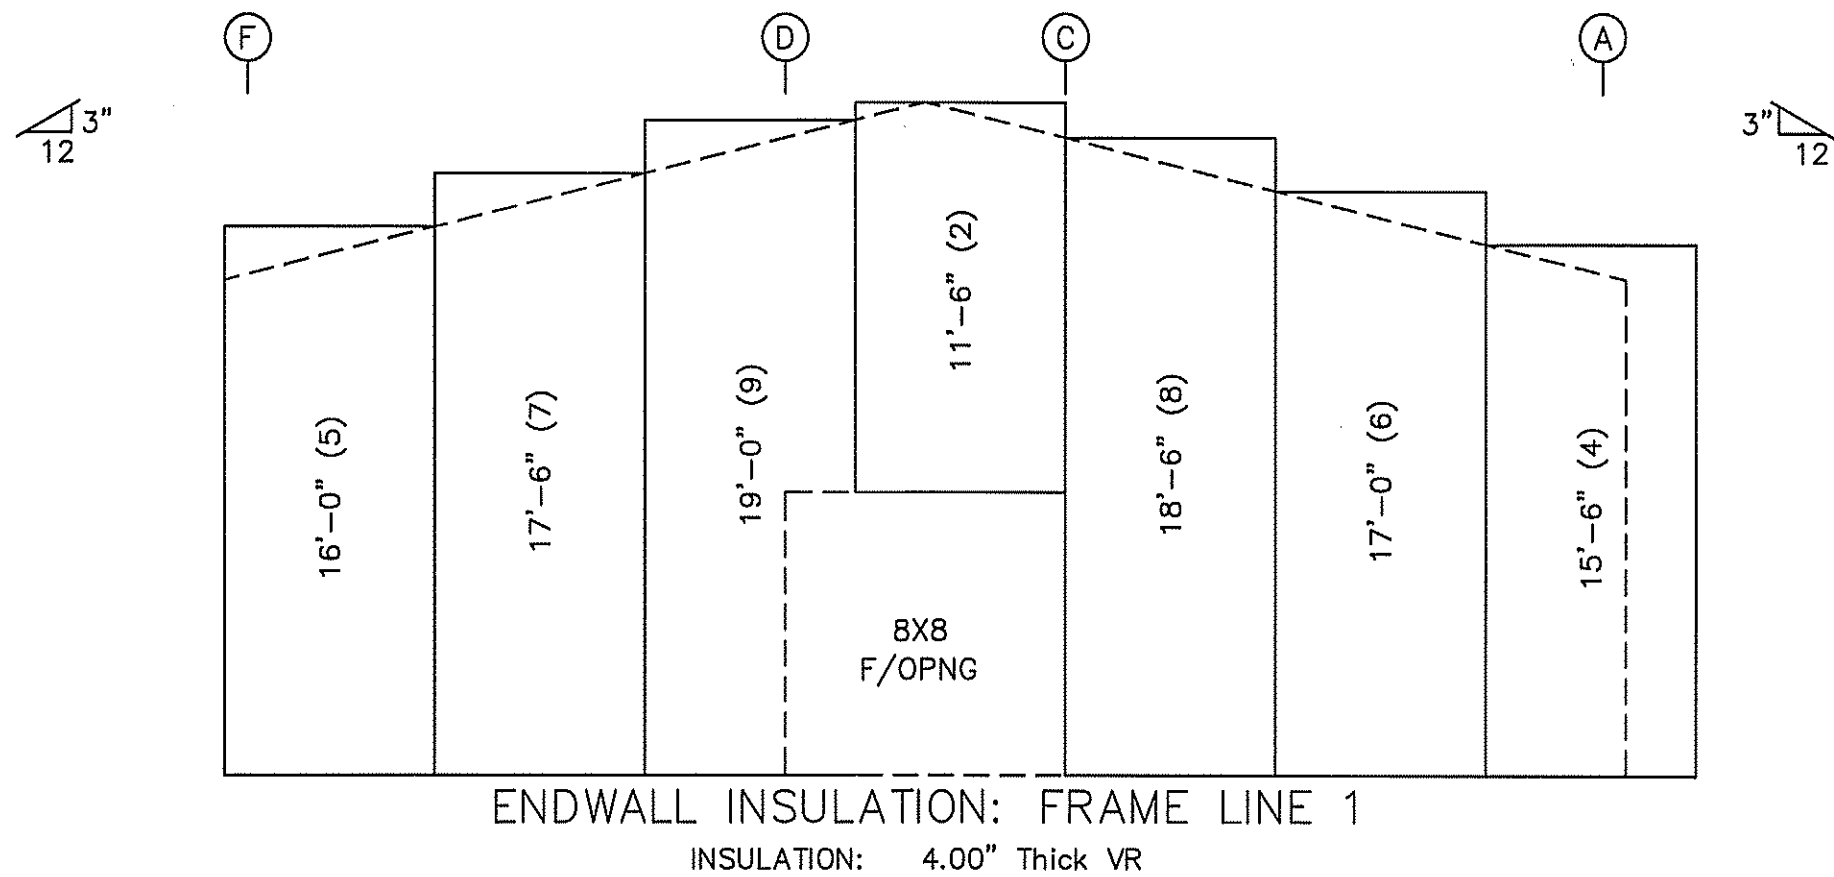

INSULATION TABLE FRAME LINE 1 A 4 F				
ROLL	QUAN	MARK	WIDTH	LENGTH
1	1	WI-1	6'-0"	7'-6"
2	1	WI-2	6'-0"	11'-6"
3	20	WI-3	6'-0"	14'-6"
4	2	WI-4	6'-0"	15'-6"
5	2	WI-5	6'-0"	16'-0"
6	2	WI-6	6'-0"	17'-0"
7	2	WI-7	6'-0"	17'-6"
8	2	WI-8	6'-0"	18'-6"
9	2	WI-9	6'-0"	19'-0"

LEGEND:
7'-6" (1)
Length (Roll #)

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

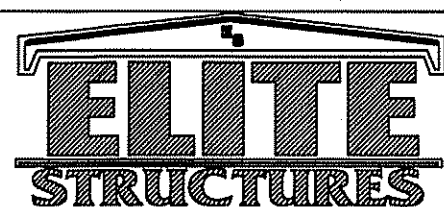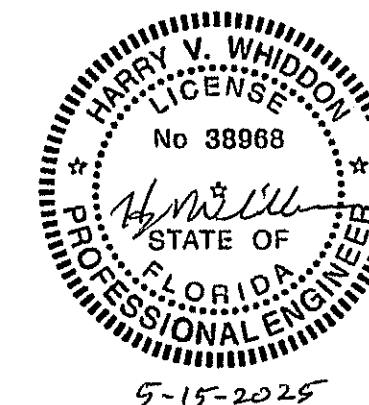

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620


SCALE: N.T.S. DATE: 9/3/24
DRAWN BY: CREVILL SALESMAN: L. WHITEHURST
BUILDING SIZE: 40X60X14

REVISION
DATE: 5/14 DESCRIPTION: TOOK OFF SOME OF THE WAINSCOTT

TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN:
WALL INSULATION



JOB #
13325-WI
SHEET 8 OF 13

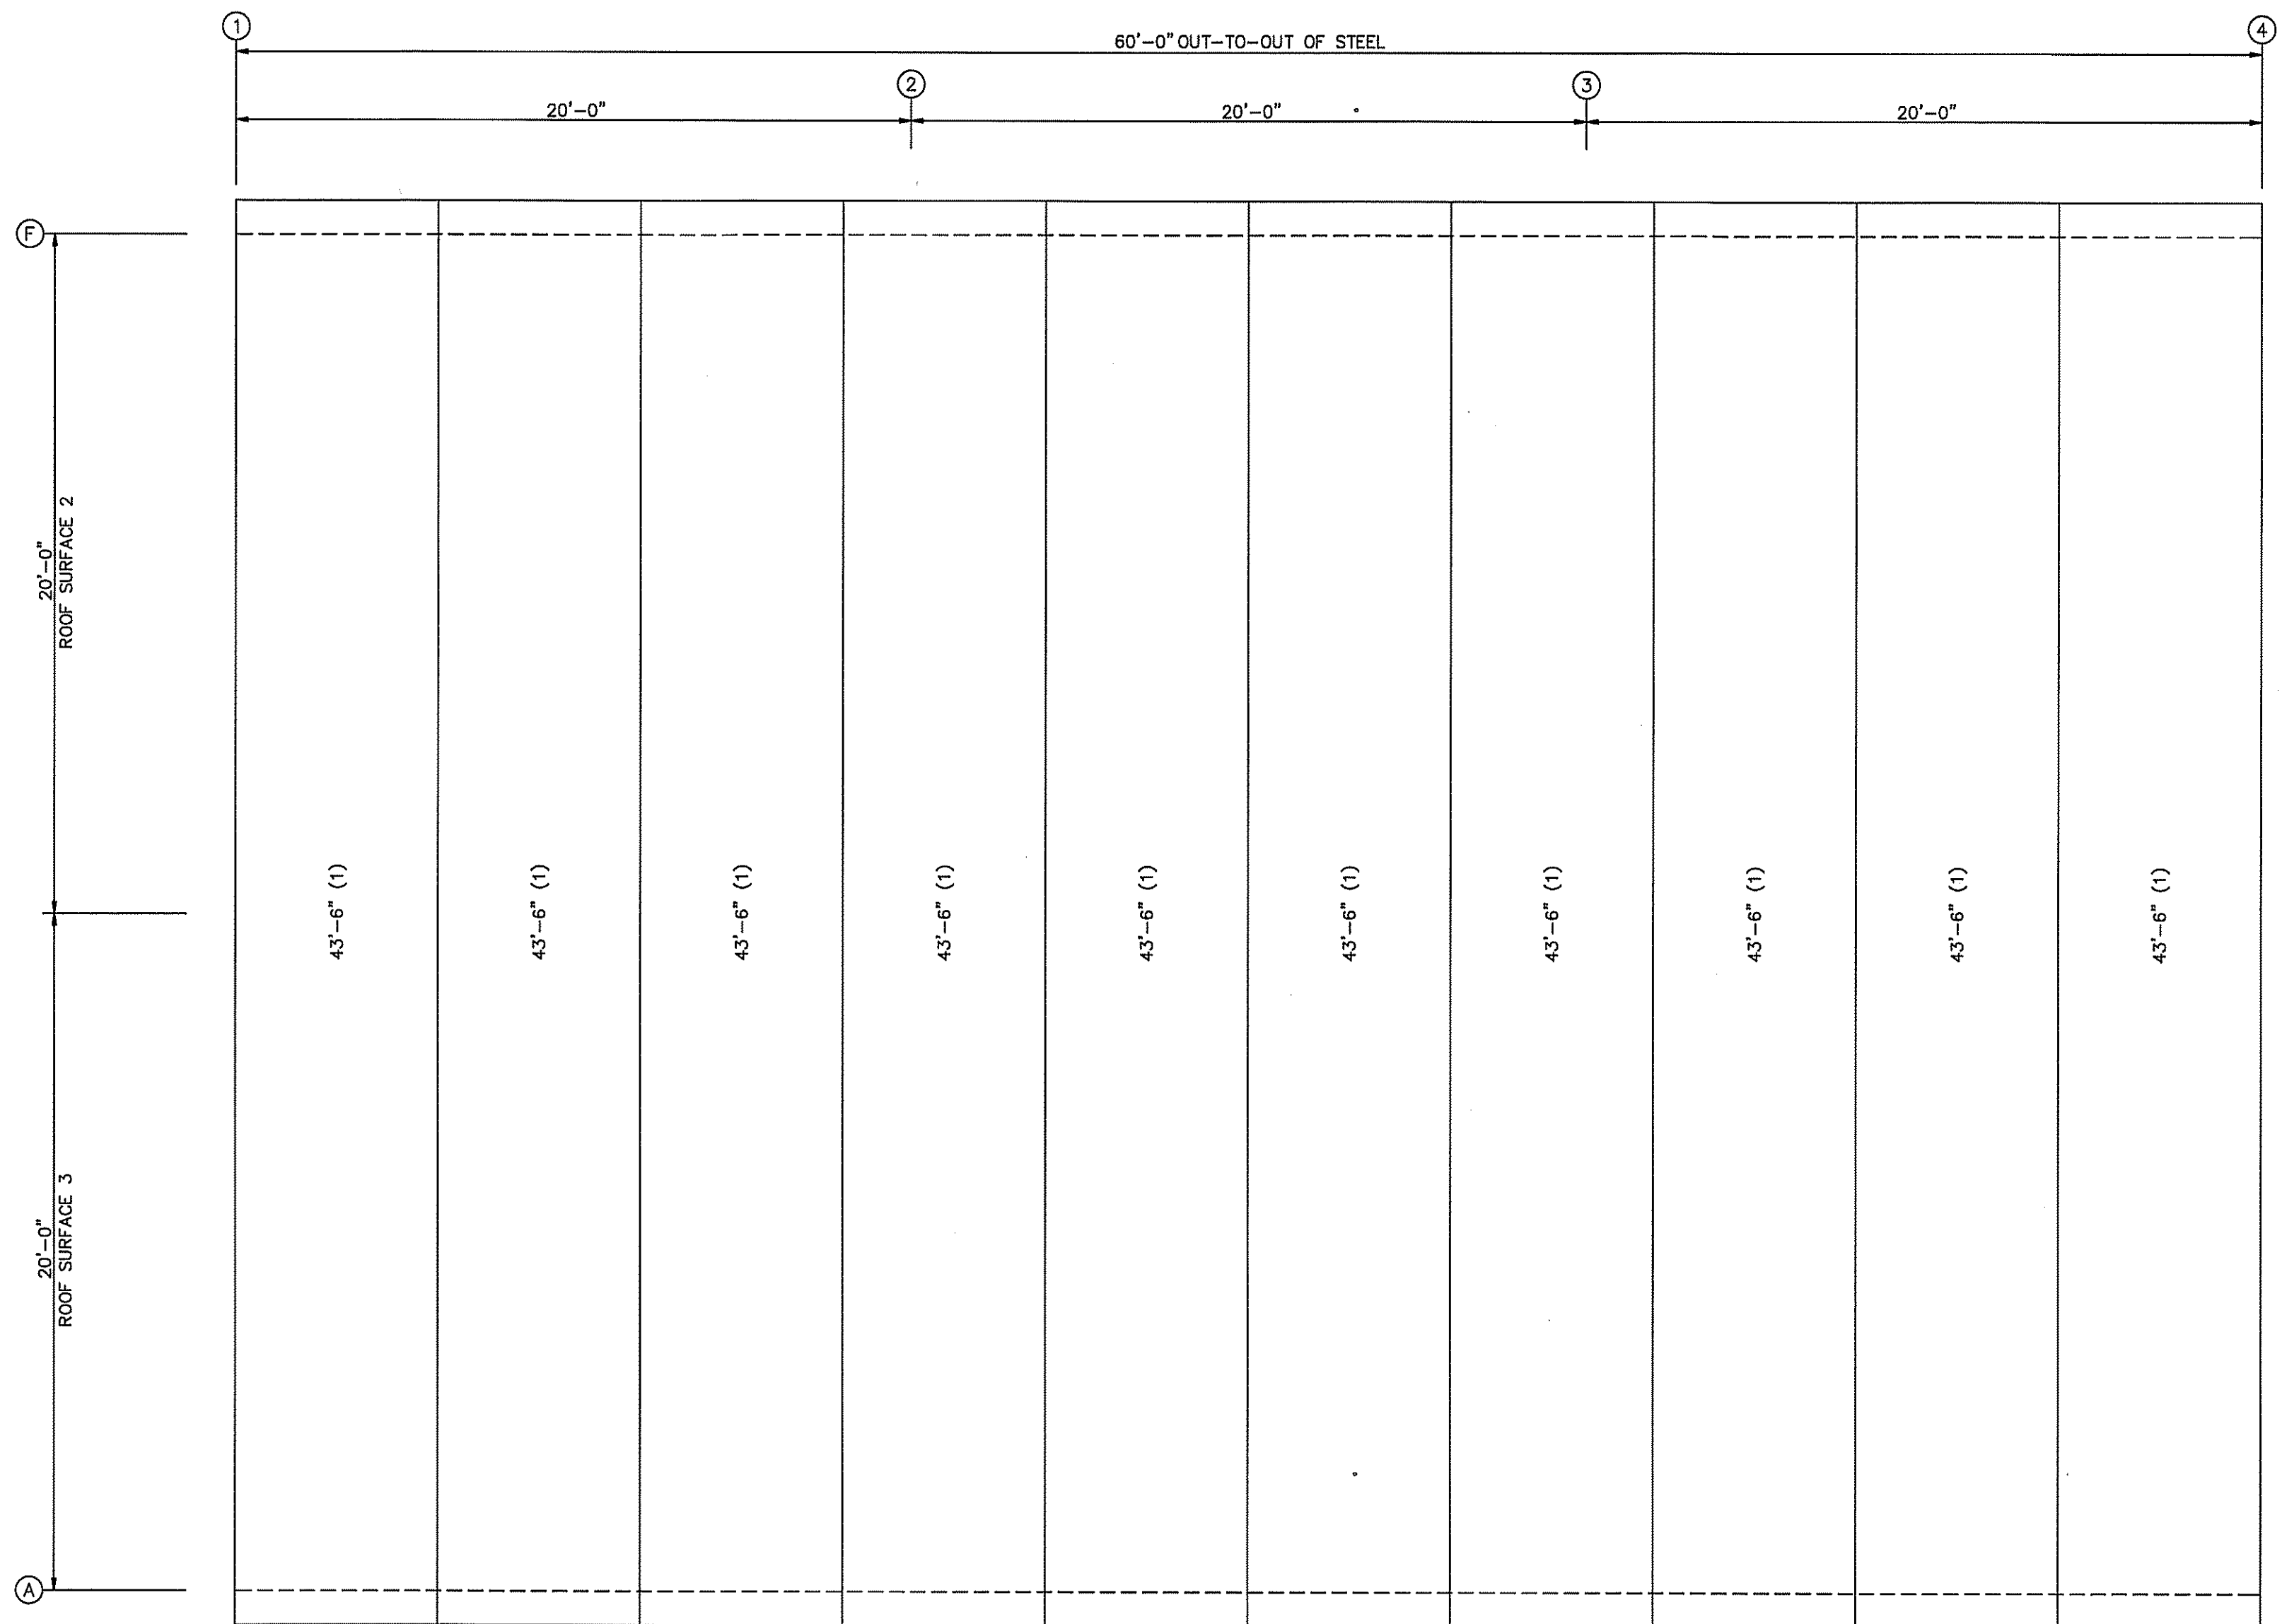

ROOF INSULATION
INSULATION: 4.00" Thick VR

INSULATION TABLE				
ROOF PLAN				
ROLL	QUAN	MARK	WIDTH	LENGTH
1	10	RI-1	6'-0"	43'-6"

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

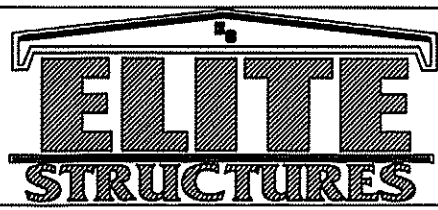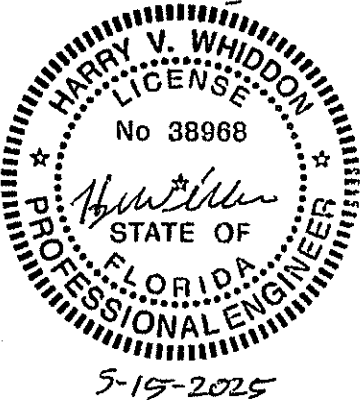

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620


SCALE: N.T.S.	DATE: 9/3/24
DRAWN BY: CREVILL	SALESMAN: L.WHITEHURST
BUILDING SIZE: 40X60X14	

REVISION	
DATE	DESCRIPTION
5/14	REMOVED SOME OF THE WAINSCOTT

TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN:
ROOF INSULATION

JOB #
13325-RI
SHEET 9 OF 13

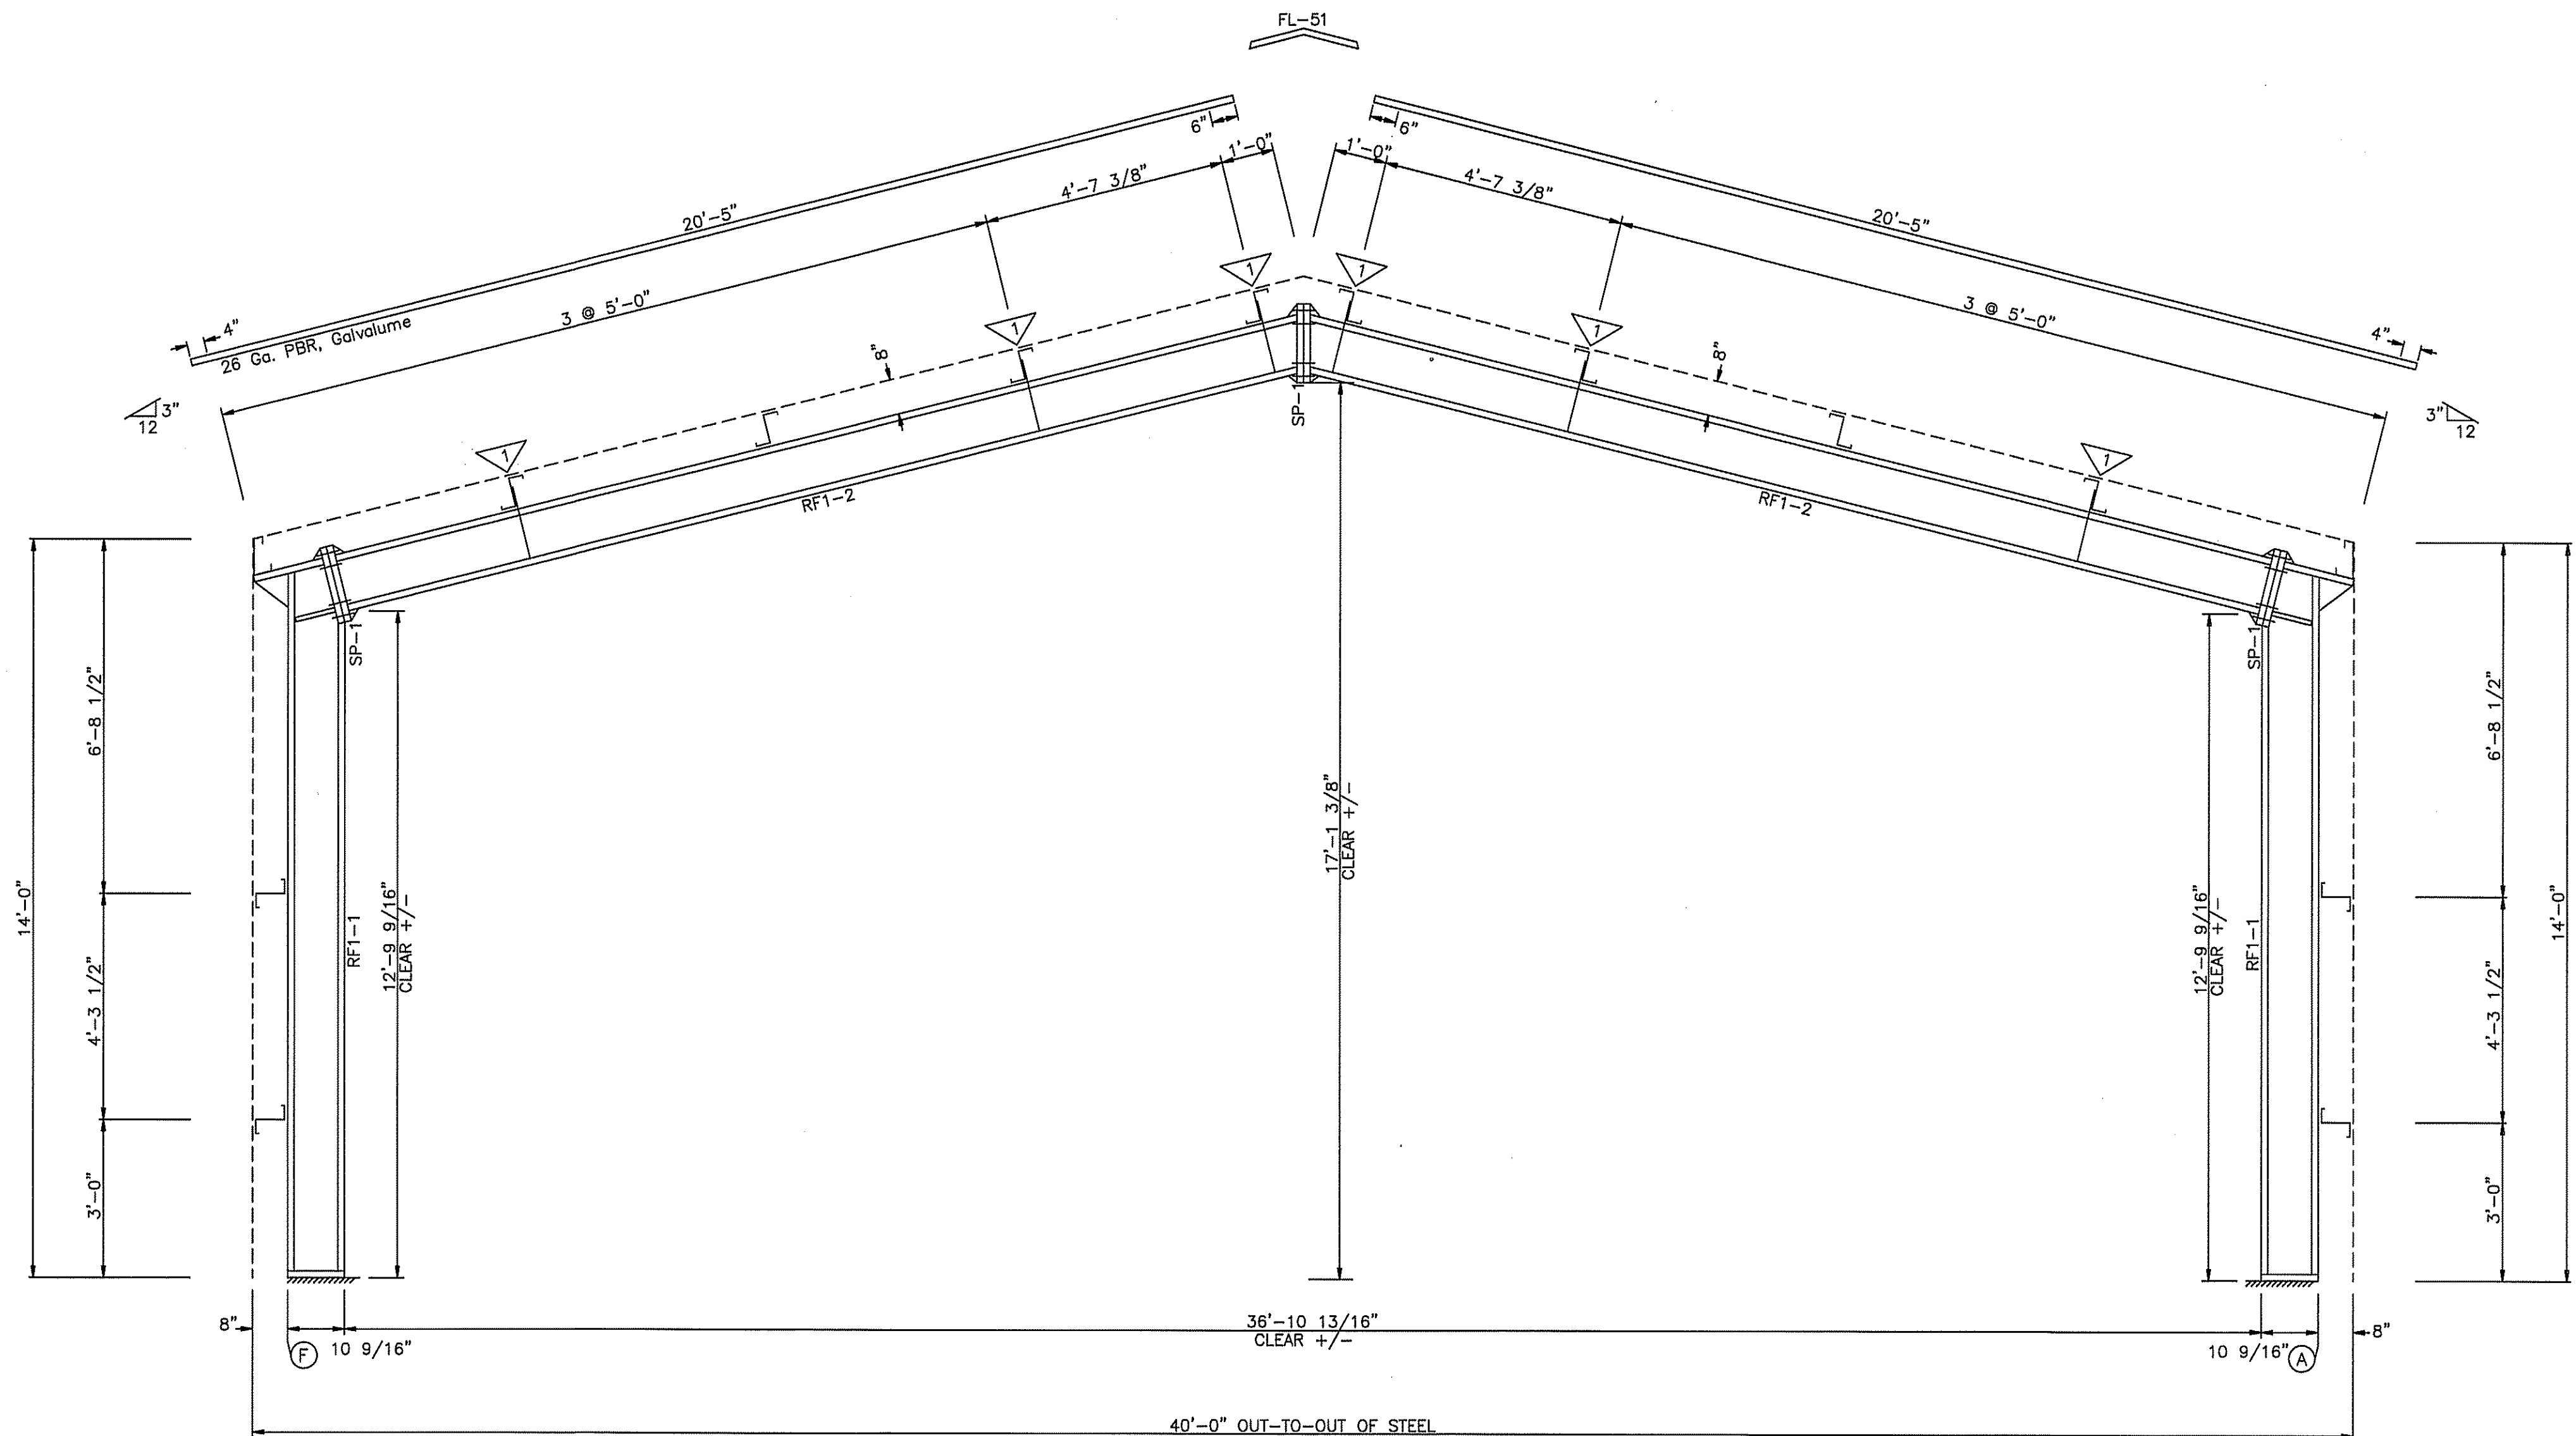



BUILDING CROSS SECTION: FRAME LINE 2 3

FLANGE BRACE TABLE FRAME LINE 2 3							
▽ ID	SIDES	MARK	LENGTH	OFFSET	DETAIL	CLIP	CLIP2
1	1	FB31A	2'-7"	2'-4"			

SPLICE BOLT TABLE						
Mark	Qty	Top	Bot	Int	Type	Dia Length
SP-1	4	4	0	A325	0.750	3.00

MEMBER TABLE							
Mark	Weight	Web Depth Start/End	Web Plate Thick Length	Outside Flange W x Thk x Length	Inside Flange W x Thk x Length		
RF1-1	258	10.0/10.0	0.188 31.4	6 x 1/4" x 161.0	6 x 1/4" x 149.4		
		10.0/10.1	0.188 118.0	6 x 1/4" x 15.4			
RF1-2	365	10.1/6.8	0.250 13.3	6 x 1/4" x 230.4	6 x 1/4" x 227.8		
		10.0/10.0	0.188 118.0				
		10.0/10.0	0.188 112.4				

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

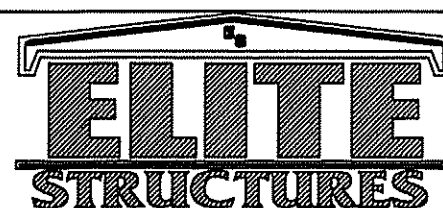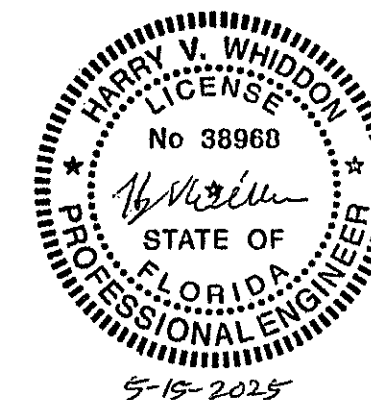

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620


SCALE: N.T.S.
DATE: 9/3/24
DRAWN BY: C.REVILL
SALESMAN: L.WHITEHURST
BUILDING SIZE: 40X60X14

REVISION
DATE: 5/14
DESCRIPTION: REMOVED SOME OF THE WAINSCOTT

TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN:
CROSS SECTION



JOB #
13325-XS
SHEET 10 OF 13

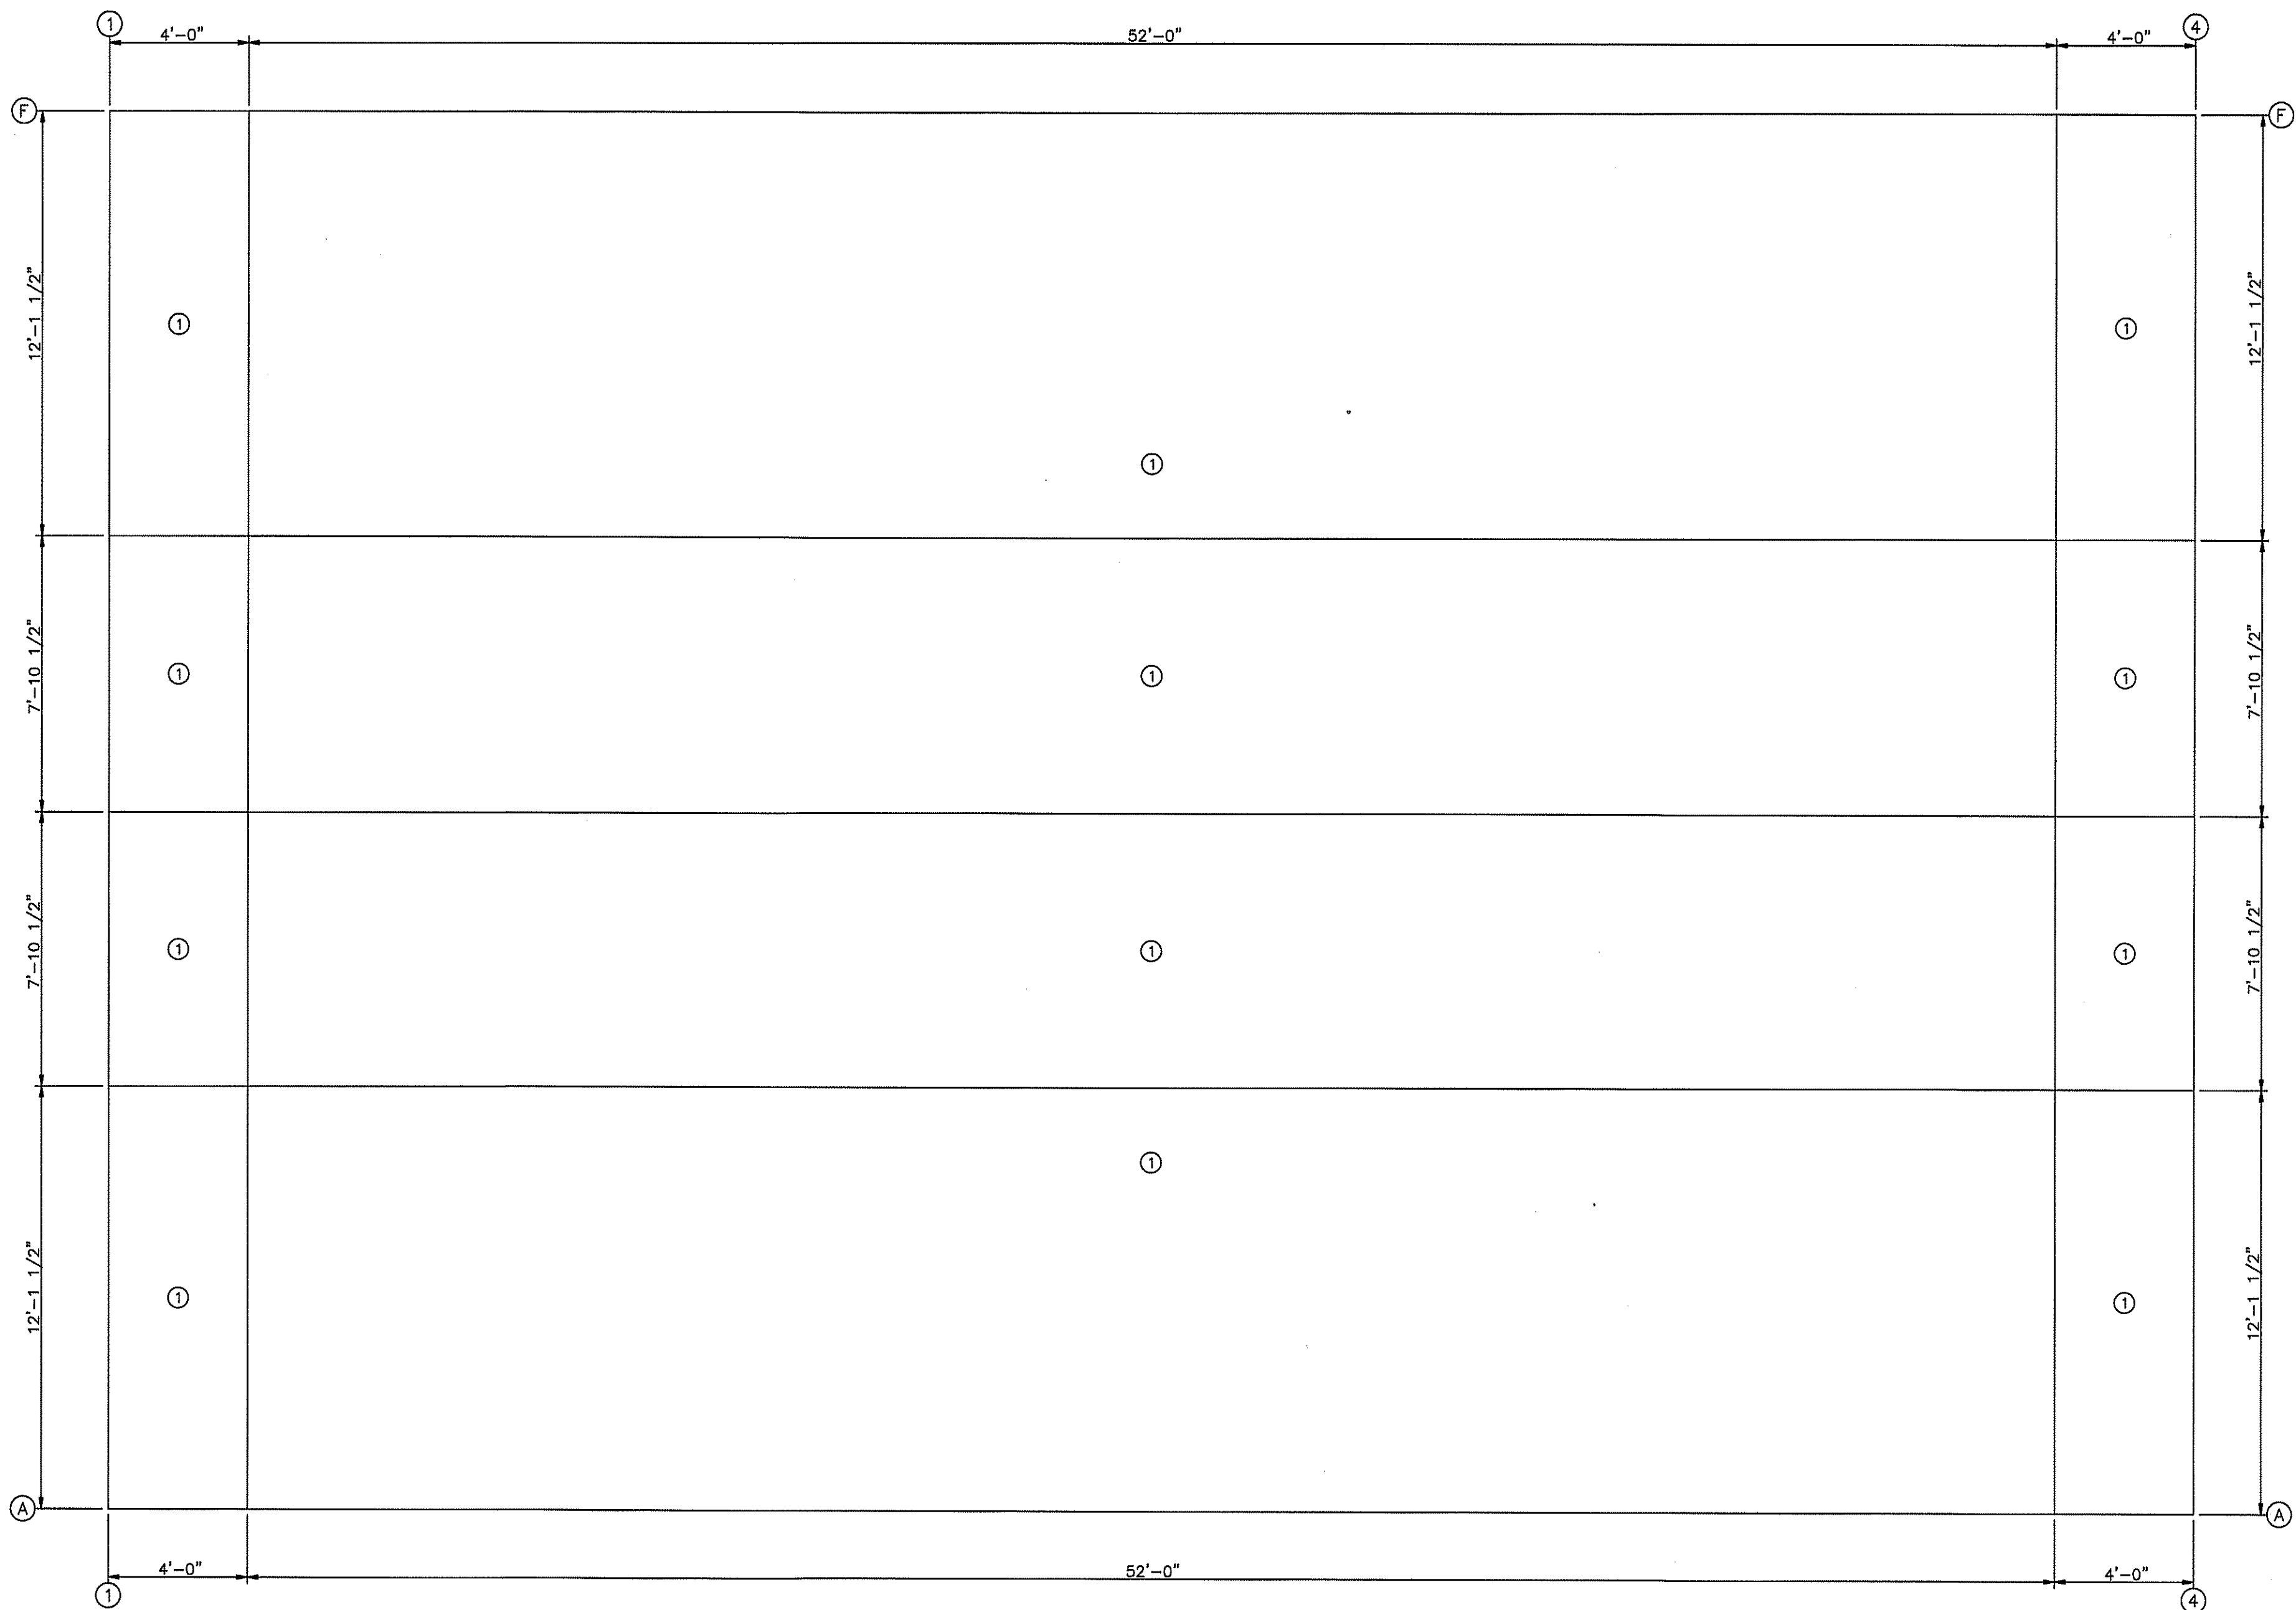

FASTENER LAYOUT
(Minimum Fastener Spacing)

FASTENER TABLE		
O ID	SCREW PART	SPACE (in)
1	12x1.25	12.0

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

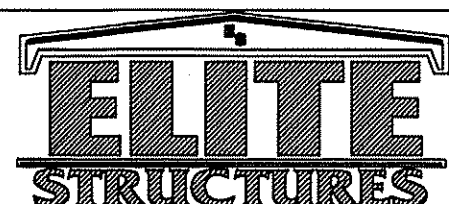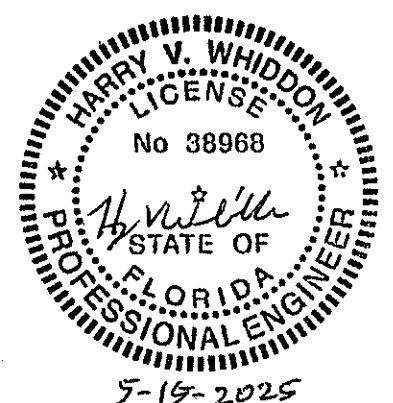

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620


SCALE: N.T.S.	DATE: 9/3/24
DRAWN BY: C.REVILL	SALESMAN: L.WHITEHURST
BUILDING SIZE: 40X60X14	

REVISION	
DATE	DESCRIPTION
5/14	REMOVED SOME OF THE WAINSCOTT



TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN:
FASTENER LAYOUT

JOB #
13325-FL
SHEET 11 OF 13

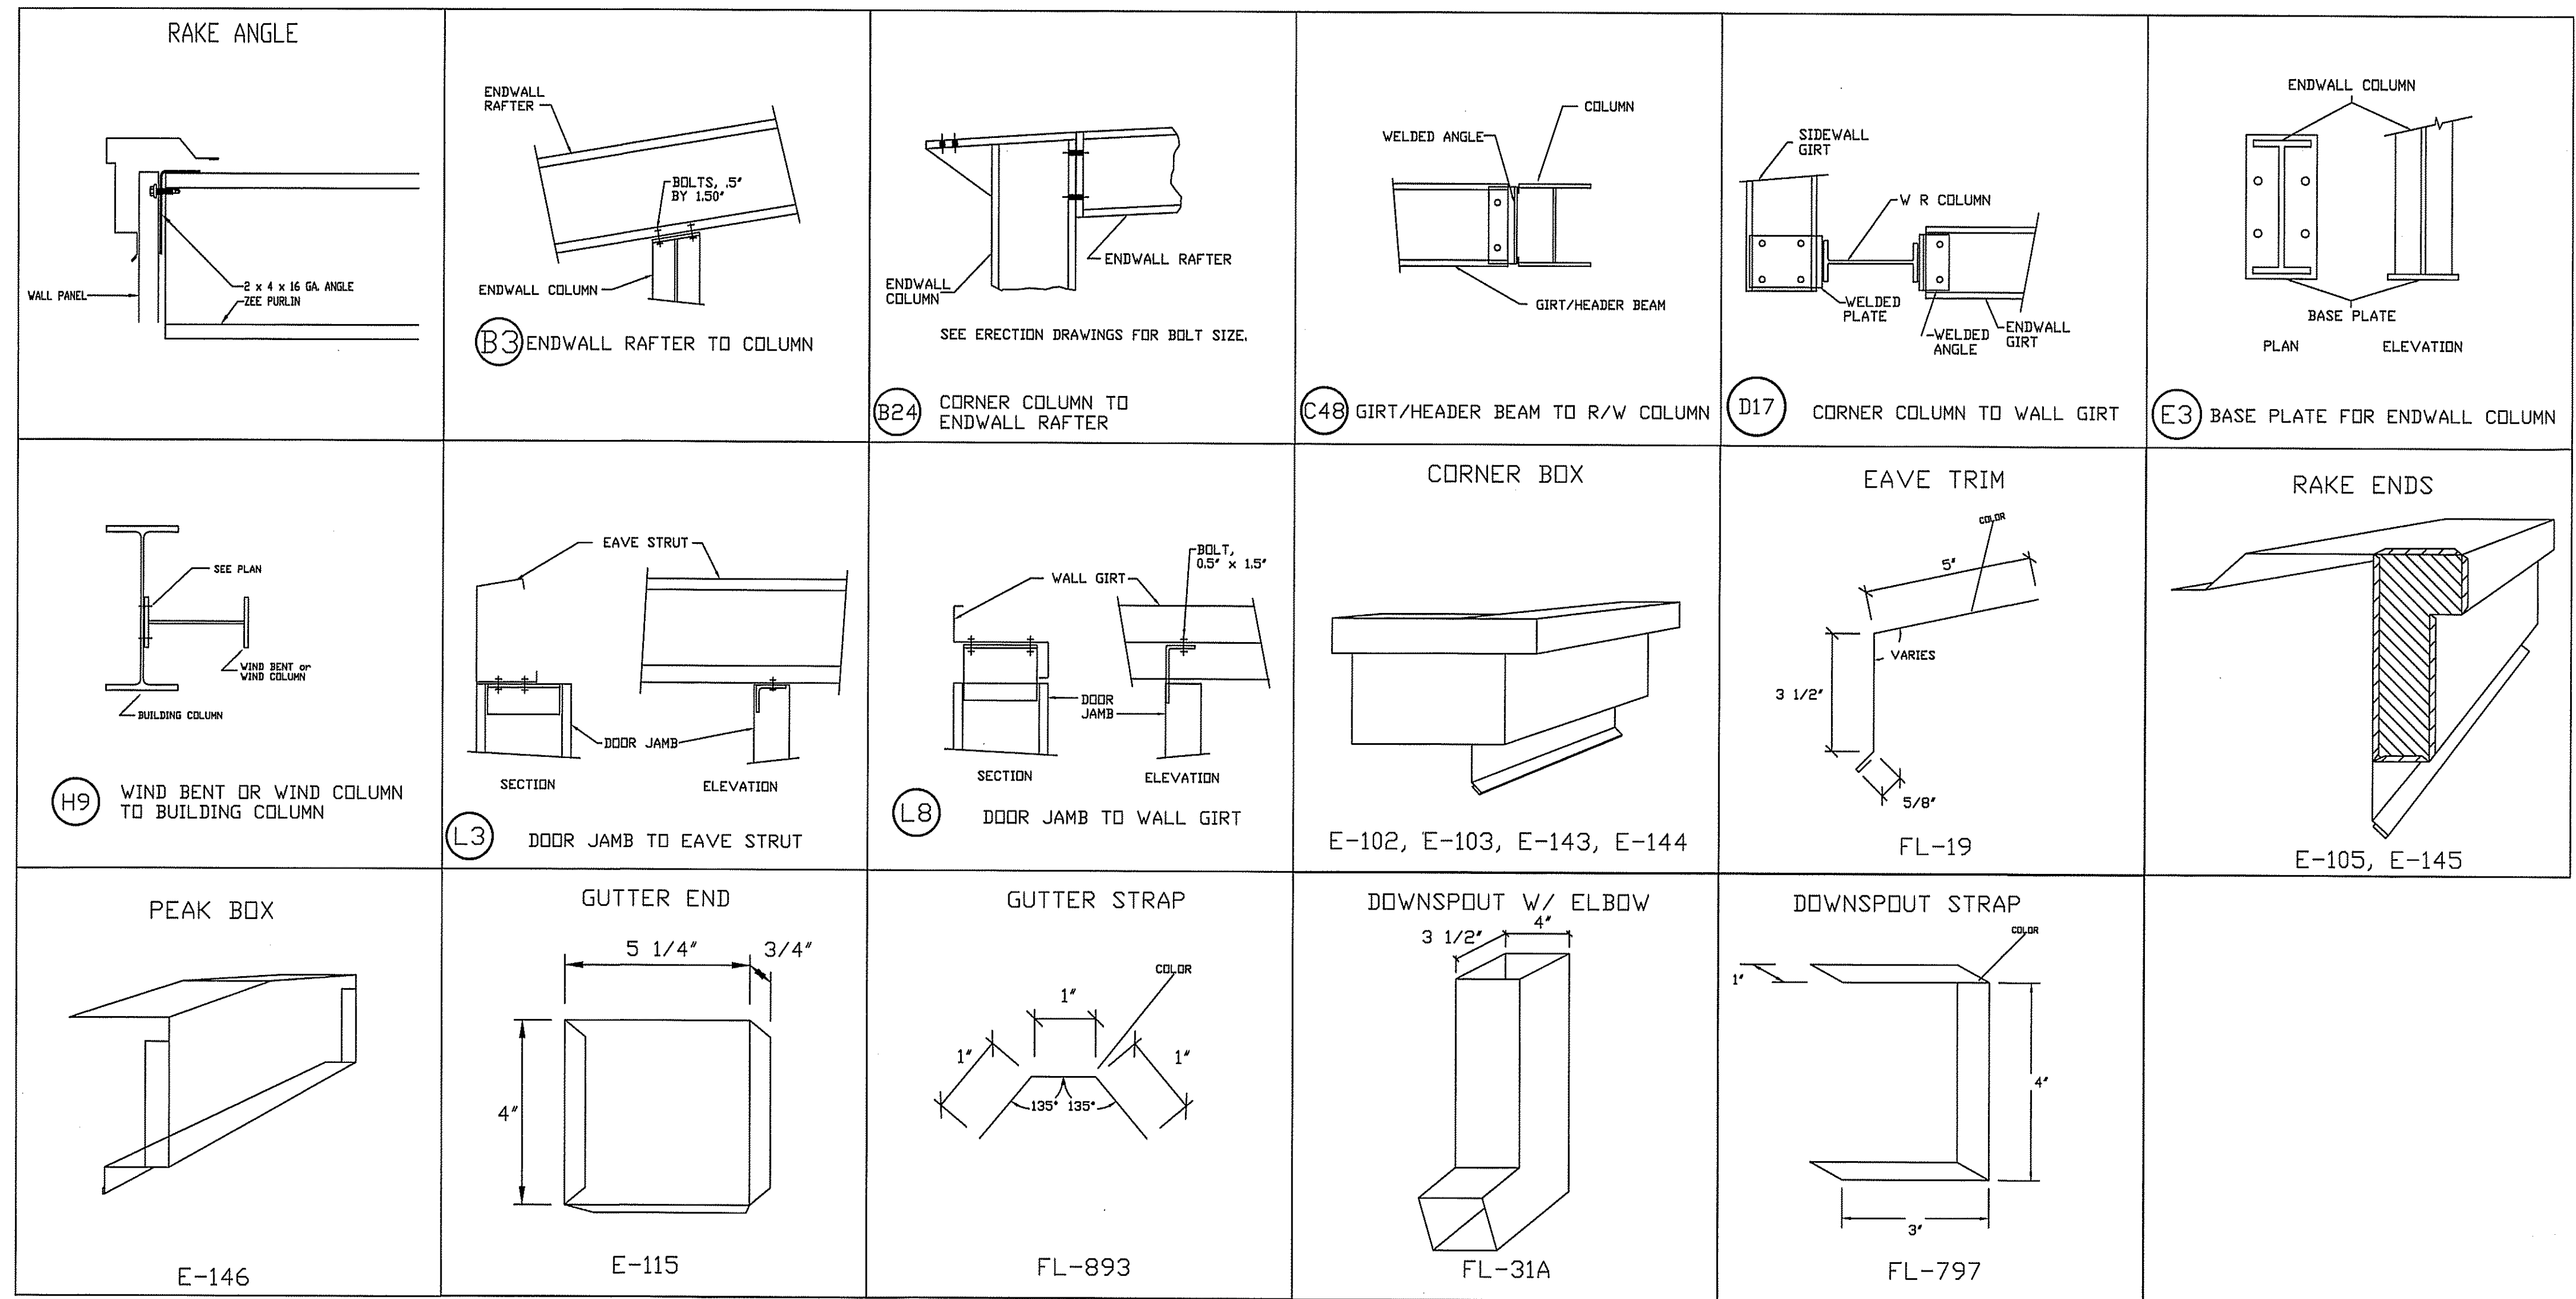

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

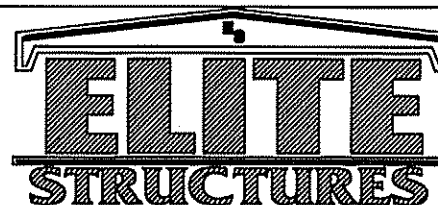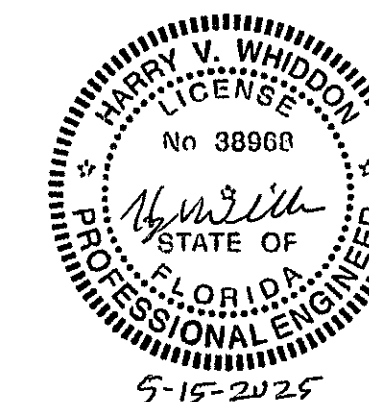

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620


SCALE: N.T.S. DATE: 9/3/24
DRAWN BY: C. REVILL SALESMAN: L. WHITEHURST
BUILDING SIZE: 40X60X14

REVISION	
DATE	DESCRIPTION
5/14	REMOVED SOME OF THE VAINSCOTT


TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN:
DETAIL PAGE-1

JOB #
13325-DP-1
SHEET 12 OF 13

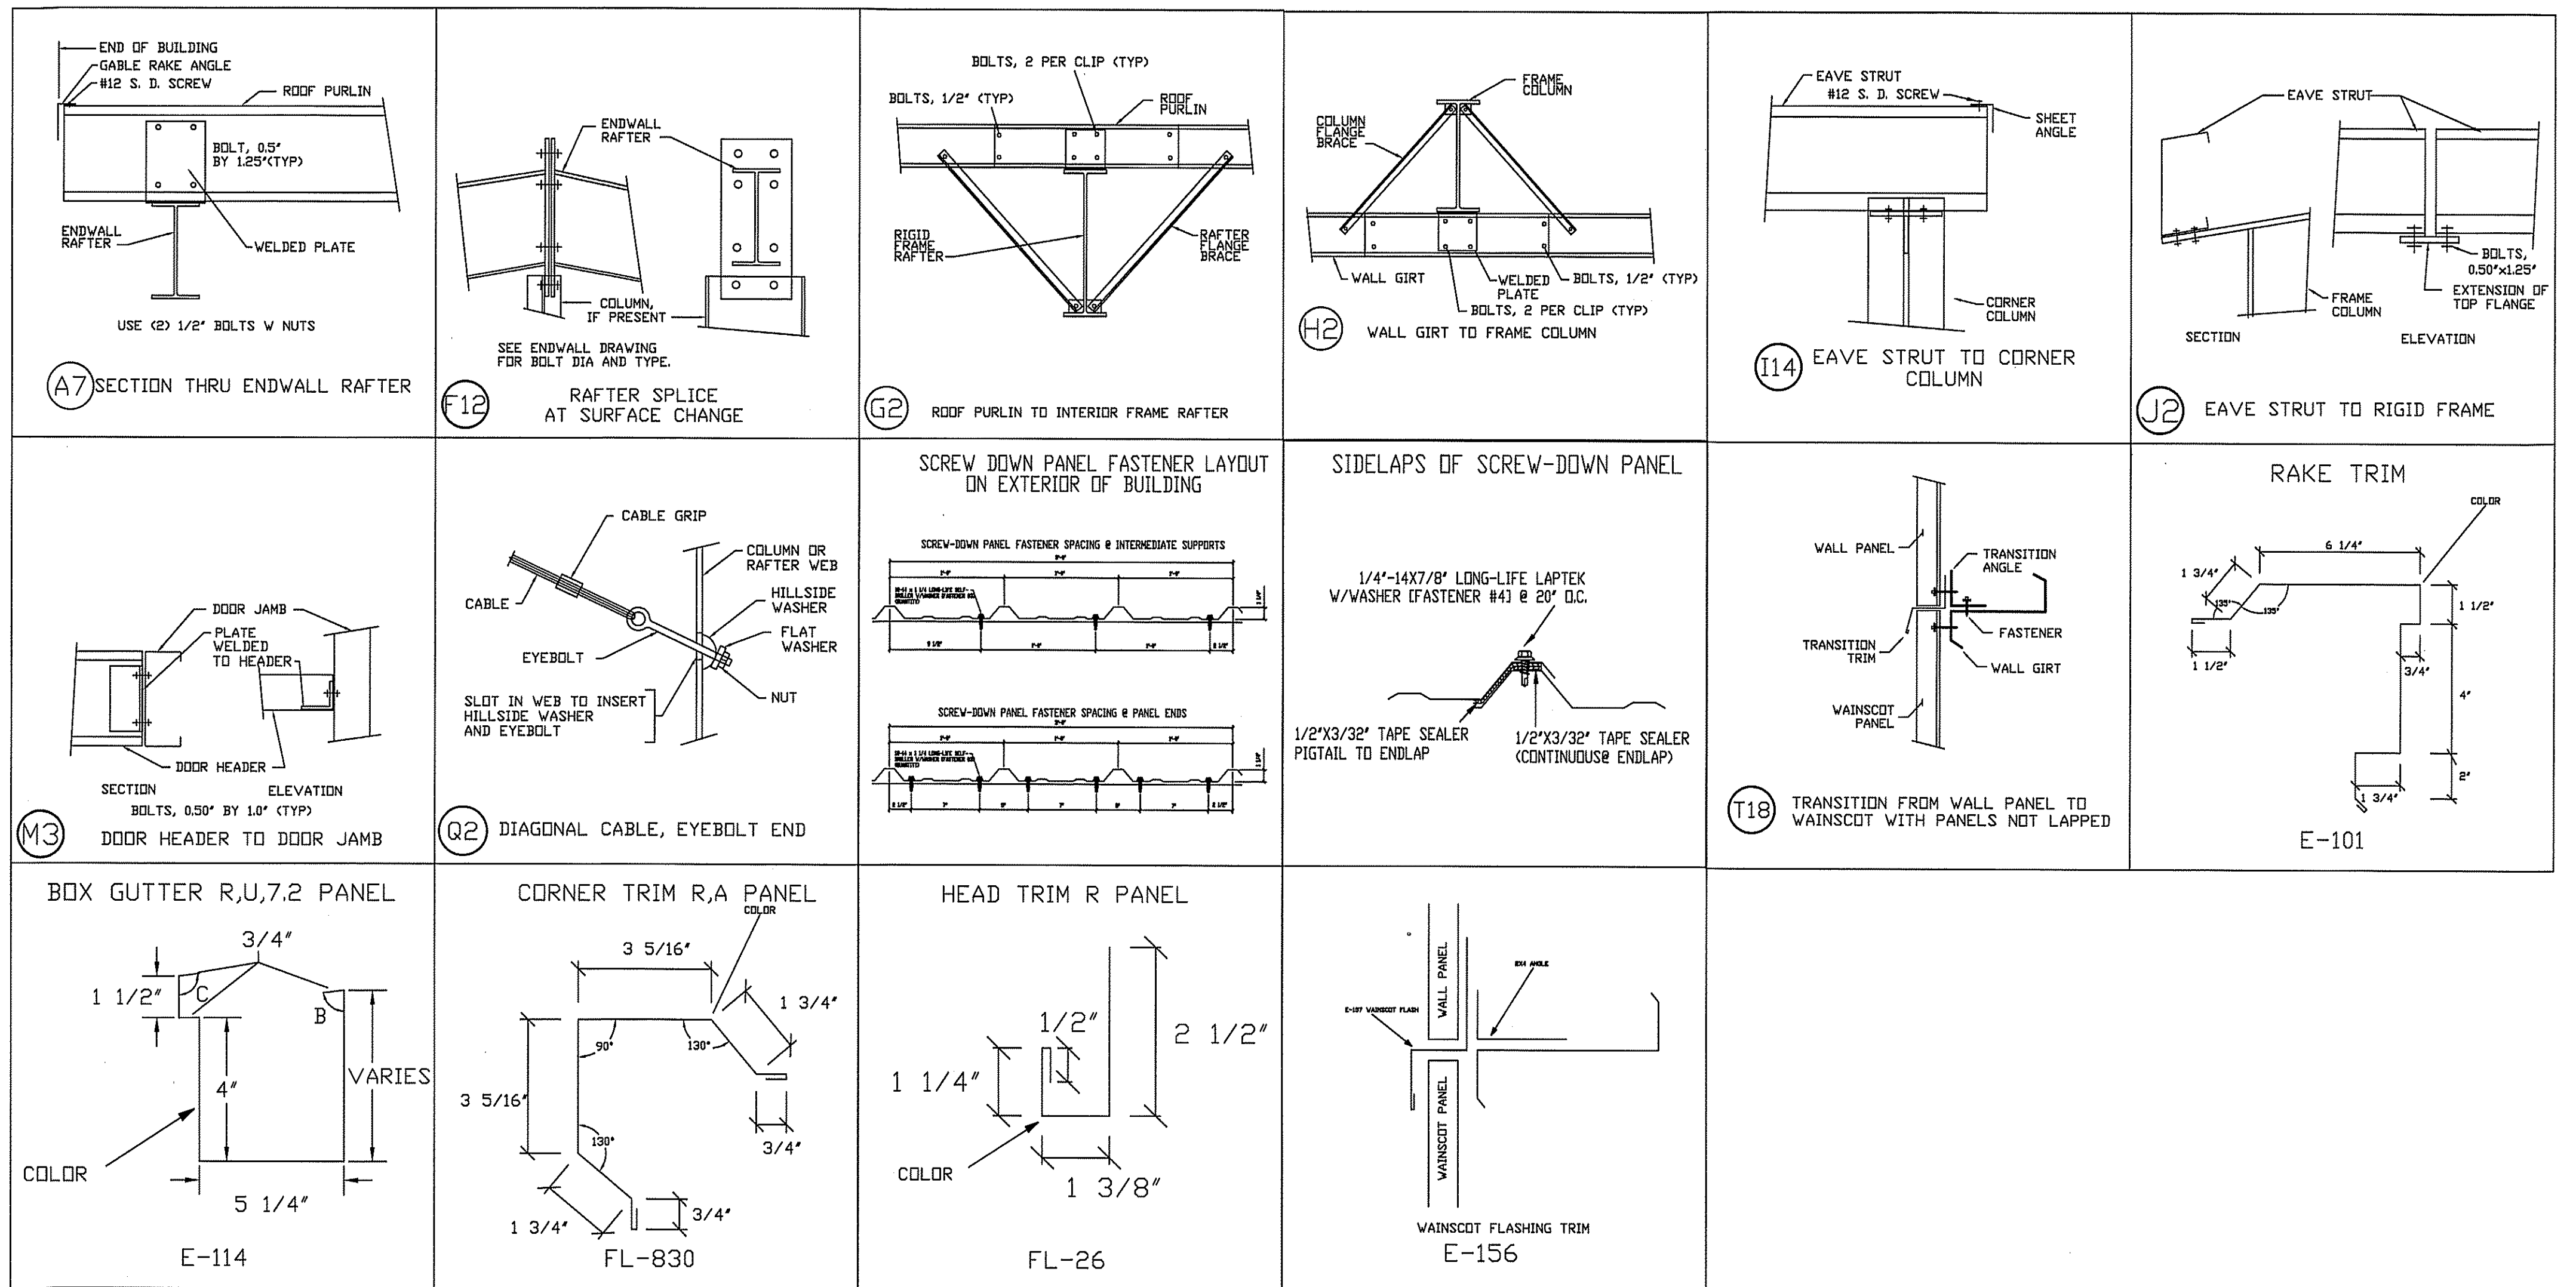

HARRY V. WHIDDON, PE
111 LONNIE GRIMSLEY RD.
ADEL, GA 31620
PE#38968

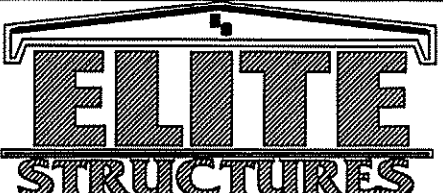

PH 229-896-7569
FAX 229-896-7560
P.O. BOX 207
ADEL, GA 31620

SCALE: N.T.S.
DATE: 9/3/24
DRAWN BY: C.REVILL
SALESMAN: L.WHITEHURST
BUILDING SIZE: 40X60X14

REVISION	
DATE	DESCRIPTION
5/14	REMOVE SOME OF THE WAINSCOTT

TITLE/LOCATION
I.C. CONSTRUCTION
LAKE CITY, FL

PLAN:
DETAIL PAGE-2

JOB #
13325-DP-2
SHEET 13 OF 13