

JENKINS RESIDENCE  
27.200 kW PV SYSTEM  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

Castillo  
Engineering  
SOLAR DONE RIGHT®

CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER™  
PRODUCTION MANAGEMENT, INC.

Signature with  
No. 52550

Digitally  
signed by:  
Ermocrate  
s E Castillo  
Date:  
2022.08.30  
15:22:50

PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME


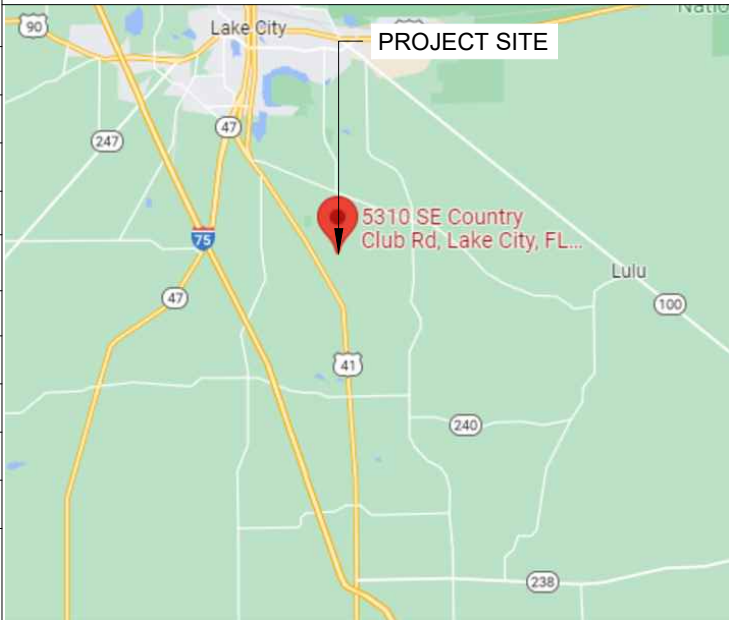
COVER SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

G-01

PROJECT DESCRIPTION:	CODES AND STANDARDS	OWNER	HOUSE PHOTO	
<p>68x400 VSUN: VSUN400-108M-BB (400W) MODULES ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES</p> <p>SYSTEM SIZE: 27.200 kW DC STC ARRAY AREA #1: 399.16 SQ. FT. ARRAY AREA #2: 168.07 SQ. FT. ARRAY AREA #3: 861.35 SQ FT.</p> <p>EQUIPMENT SUMMARY 68 VSUN: VSUN400-108M-BB (400W) MODULES 68 ENPHASE: IQ7A-72-2-US MICROINVERTERS 02 ENPHASE ENPOWER SMART SWITCH 05 ENPHASE ENCHARGE 10 BATTERIES</p> <p>RACKING: SNAPNRACK ULTRA RAIL UR-40 ATTACHMENT: SNAPNRACK SPEEDSEAL FOOT</p> <p>DESIGN CRITERIA : WIND SPEED (ULT): 120 MPH WIND SPEED (ASD): 93 MPH RISK CATEGORY: II EXPOSURE: B</p>	<p>GOVERNING CODES : FLORIDA RESIDENTIAL CODE, 7TH EDITION 2020 (FRC) FLORIDA PLUMBING CODE, 7TH EDITION 2020 (FPC) FLORIDA BUILDING CODE, 7TH EDITION 2020 (FBC) FLORIDA MECHANICAL CODE, 7TH EDITION 2020 (FMC) NATIONAL ELECTRICAL CODE 2017 (NEC) ASCE 7-16 FLORIDA FIRE PREVENTION CODE, 7TH EDITION 2020 (FFPC)</p>	JENKINS, SUSAN		
		INSTALLER		<p>POWER PRODUCTION MANAGEMENT 625 NW 8th Ave, Gainesville, FL 32601 (352) 263-0766</p>
		ENGINEER		
		<p>Castillo Engineering Services LLC 620 N. Wymore Road, Suite 250, Maitland, FL 32751 TEL: (407) 289-2575 Ermocrates E. Castillo License#: FL PE 52590</p>		
		SHEET INDEX		
		SHEET #	SHEET DESCRIPTION	
		G-01	COVER SHEET	
		A-00	NOTES AND DESCRIPTION	
		A-01	ROOF PLAN	
		S-01	MODULE LAYOUT	
		S-01.1	PARTIAL PRESSURE AND MODULES EXPOSURE	
		S-02	ATTACHMENT DETAIL	
		S-02.1	STRUCTURE CALCULATION	
		E-01	ELECTRICAL LINE DIAGRAM	
		E-02	WIRING CALCULATIONS	
		E-03	SYSTEM LABELING	
		DS-01-09	DATA SHEETS	
STRUCTURAL CERTIFICATION:	ELECTRICAL CERTIFICATION:			
<p>I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL 2020 7th ED., CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE WIND LATERAL AND UPLIFT FORCES, AND EQUIPMENT DEAD LOADS.</p>	<p>I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107, THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION.</p>			

Symbols:

Section.....

Sheet where section is located

Elevation .....

Detail ID Letter

Sheet where section is located

Detail .....

Detail ID Letter

Sheet where section is located

Detail .....

Detail ID Letter

Area to be enlarged

Sheet where section is located

Keyed Notes .....

1

Keyed note designation on applicable sheet

Ground Terminal .....

Grounding Point/rod....

Solar Panel .....

or

00

Module with Source Circuit number

Combiner Box .....

CB

AC Disconnect .....

ACD

Main Distribution Panel .....

MDP

Fuse .....

Overcurrent Breaker ..

Inverter .....

Transformer .....

Automatic .....

ATS

Transfer Switch

Vent, Attic fan (Roof obstruction)

PV Roof Attachment

Trusses

Conduit

Fire Access

Abbreviations:

AC	Alternating Current
ACD	AC Disconnect
APPROX	Approximate
AWG	American Wire Gauge
BAT	Battery
CB	Combiner Box
DC	Direct Current
DISC	Disconnect
(E)	Existing
EL	Elevation
EQ	Equal
GP	Generation Panel
JB	Junction Box
MCB	Main Combiner Box
MFR	Manufacturer
MID	Microgrid Interconnect Device
MIN	Minimum
MISC	Miscellaneous
MDP	Main Distribution Panel
(N)	New
NAVD	North American Vertical datum
OCPD	OverCurrent Protection Device
POCC	Point Of Common Coupling
PV	Photovoltaic
SF	Squarefoot/feet
STC	Standard Test Conditions
SD	Soladeck
TBD	To Be Determined
TYP	Typical
UNO	Unless Noted Otherwise
UM	Utility meter
VIF	Verify In Field
WP	Weather Proof

System Description

This system is a grid-tied, PV system, with PV generation consisting of 68x400 VSUN: VSUN400-108M-BB (400W) Modules with a combined STC rated dc output power of 27,200W. The modules are connected into 68 ENPHASE: IQ7A-72-2-US Microinverters. The inverter has electronic maximum power point tracking to maximize energy captured by the PV modules. The inverter also has an internal ground fault detection and interruption device that is set to disconnect the array in the event that a ground fault that exceeds one ampere should occur. The inverter has DC and AC disconnect integrated system and labels are provided as required by the *National Electrical Code*.

When the sun is shining, power from the PV array is fed into the inverter, where it is converted from DC to AC. The inverter output is then used to contribute to the power requirements of the occupancy. If PV power meets the requirements of the loads of the occupancy, any remaining PV power is sold back to the utility. When utility power is available, but PV power is not available, building loads are supplied by the utility.

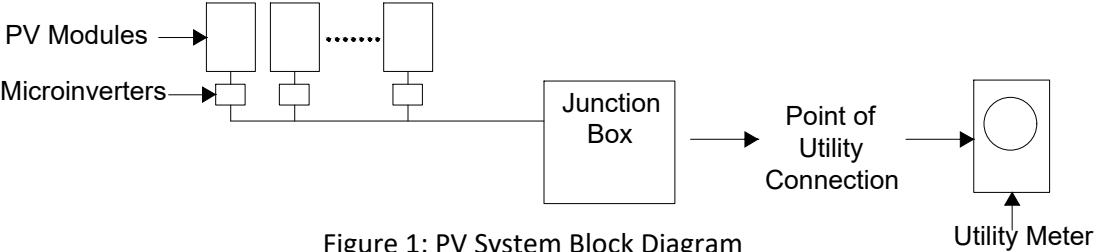


Figure 1: PV System Block Diagram

The inverter meets the requirements of IEEE 1547 and UL 1741.


**FALL PROTECTION:**

ANCHORAGES USED FOR ATTACHMENT OF PERSONAL FALL ARREST EQUIPMENT MUST BE INDEPENDENT OF ANY ANCHORAGE BEING USED TO SUPPORT OR SUSPEND PLATFORMS, AND CAPABLE OF SUPPORTING AT LEAST 5,000 POUNDS PER EMPLOYEE ATTACHED, OR MUST BE DESIGNED AND USED AS FOLLOWS:

- AS PART OF A COMPLETE PERSONAL FALL ARREST SYSTEM WHICH MAINTAINS A SAFETY FACTOR OF AT LEAST TWO.
- UNDER THE SUPERVISION OF A QUALIFIED PERSON

**ADDITIONAL INFORMATION**

- 29 CFR 1926 SUBPART M, FALL PROTECTION. OSHA STANDARD.
- 1926.502, FALL PROTECTION SYSTEMS CRITERIA AND PRACTICES
- ... 1926.502(D)(15)

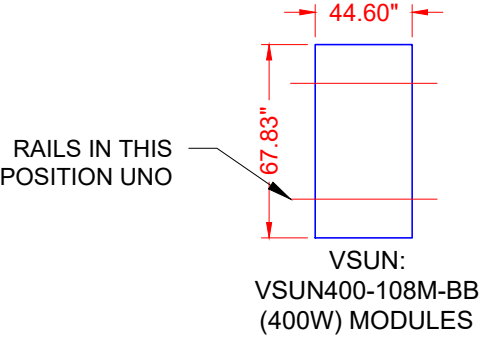

ALLOWABLE/DESIGN PRESSURE	PSF
DOWN PRESSURE	75
UPLIFT PRESSURE, 2 RAILS	33.6

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

Digitally signed by: Ermocrates E. Castillo

Date: 2022.08.30 15:22:50

PROJECT NAME

JENKINS RESIDENCE

5310 SE COUNTRY CLUB RD, LAKE CITY, FL 32025

SHEET NAME


NOTES AND DESCRIPTION

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER

A-00



325'-0"

480'-0"

224'-1"

51'-0"

(E) STRUCTURE

POOL

EXISTING DRIVEWAY

DETAIL A

100'-0"

65'-0"

EXISTING DRIVEWAY

480'-0"

325'-0"

SE COUNTRY CLUB RD,

1

A-01

# ROOF PLAN WITH FIRE SETBACKS AND PROPERTY LINES

SCALE: 1/64" = 1'-0"

2

A-01

DETAIL A

SCALE: 1/32" = 1'-0"

(E) MAIN SERVICE DISCONNECT

(E) AUTOMATIC TRANSFER SWITCH

(N) (02) ENPHASE ENPOWER  
SMART SWITCH

(N) (05) ENPHASE ENCHARGE 10 BATTERIES  
(N) ALTERNATIVE POWER SOURCE AC  
DISCONNECT/ RAPID SHUTDOWN  
(DISCONNECT 1 OF 2)

(N) (02) ENPHASE IQ COMBINER BOX  
(N) BATTERY DISCONNECT  
(DISCONNECT 2 OF 2)

3/4" IMC, RMC, FMC, LFMC,  
EMT OR EQUIVALENT CONDUIT RUN

(E) MAIN DISTRIBUTION PANEL

(N) (68) ENPHASE: IQ7A-72-2-US  
MICROINVERTERS

ROOF #1  
(19) VSUN: VSUN400-108M-BB (400W)  
MODULES

1-STORY  
HOUSE

(N) SOLADECK

ROOF #3  
(41) VSUN: VSUN400-108M-BB  
(400W) MODULES

ROOF #2  
(08) VSUN: VSUN400-108M-BB  
(400W) MODULES

FIRE ACCESS AND PATHWAYS  
AS PER NFPA 1,11.12.2

(E) SERVICE POINT AND  
UTILITY METERING

**Castillo**  
Engineering  
SOLAR DONE RIGHT®

CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

## REVISIONS

DESCRIPTION	DATE	REV

## PROJECT INSTALLER

**POWER**  
PRODUCTION MANAGEMENT, INC.

Digitally  
signed by:  
Ermocrate  
s E Castillo  
Date:  
2022.08.30  
15:22:51

## PROJECT NAME

JENKINS RESIDENCE

5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

## SHEET NAME

ROOF PLAN

## SHEET SIZE

ANSI B  
11" X 17"


## SHEET NUMBER

A-01




MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 68 MODULES  
MODULE TYPE = VSUN: VSUN400-108M-BB (400W) MODULES  
MODULE WEIGHT = 48.06 LBS / 21.8 KG.  
MODULE DIMENSIONS = 67.83" x 44.60" = 21.01 SF  
UNIT WEIGHT OF ARRAY = 2.29 PSF



ARRAY AREA & ROOF AREA CALC'S								
ROOF	ROOF TYPE	ARRAY AREA (sq.Ft.)	ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)	TILT	AZIMUTH	TRUSS SIZE	TRUSS SPACING
#1	ASPHALT SHINGLE	399.16	550.90	72.46	26.6°	270°	2"x4"	24" O.C.
#2	ASPHALT SHINGLE	168.07	1183.93	14.20	26.6°	270°	2"x4"	24" O.C.
#3	ASPHALT SHINGLE	861.35	1112.56	77.42	26.6°	180°	2"x4"	24" O.C.
TOTAL PLAN VIEW		1428.58	9970.08	14.33				

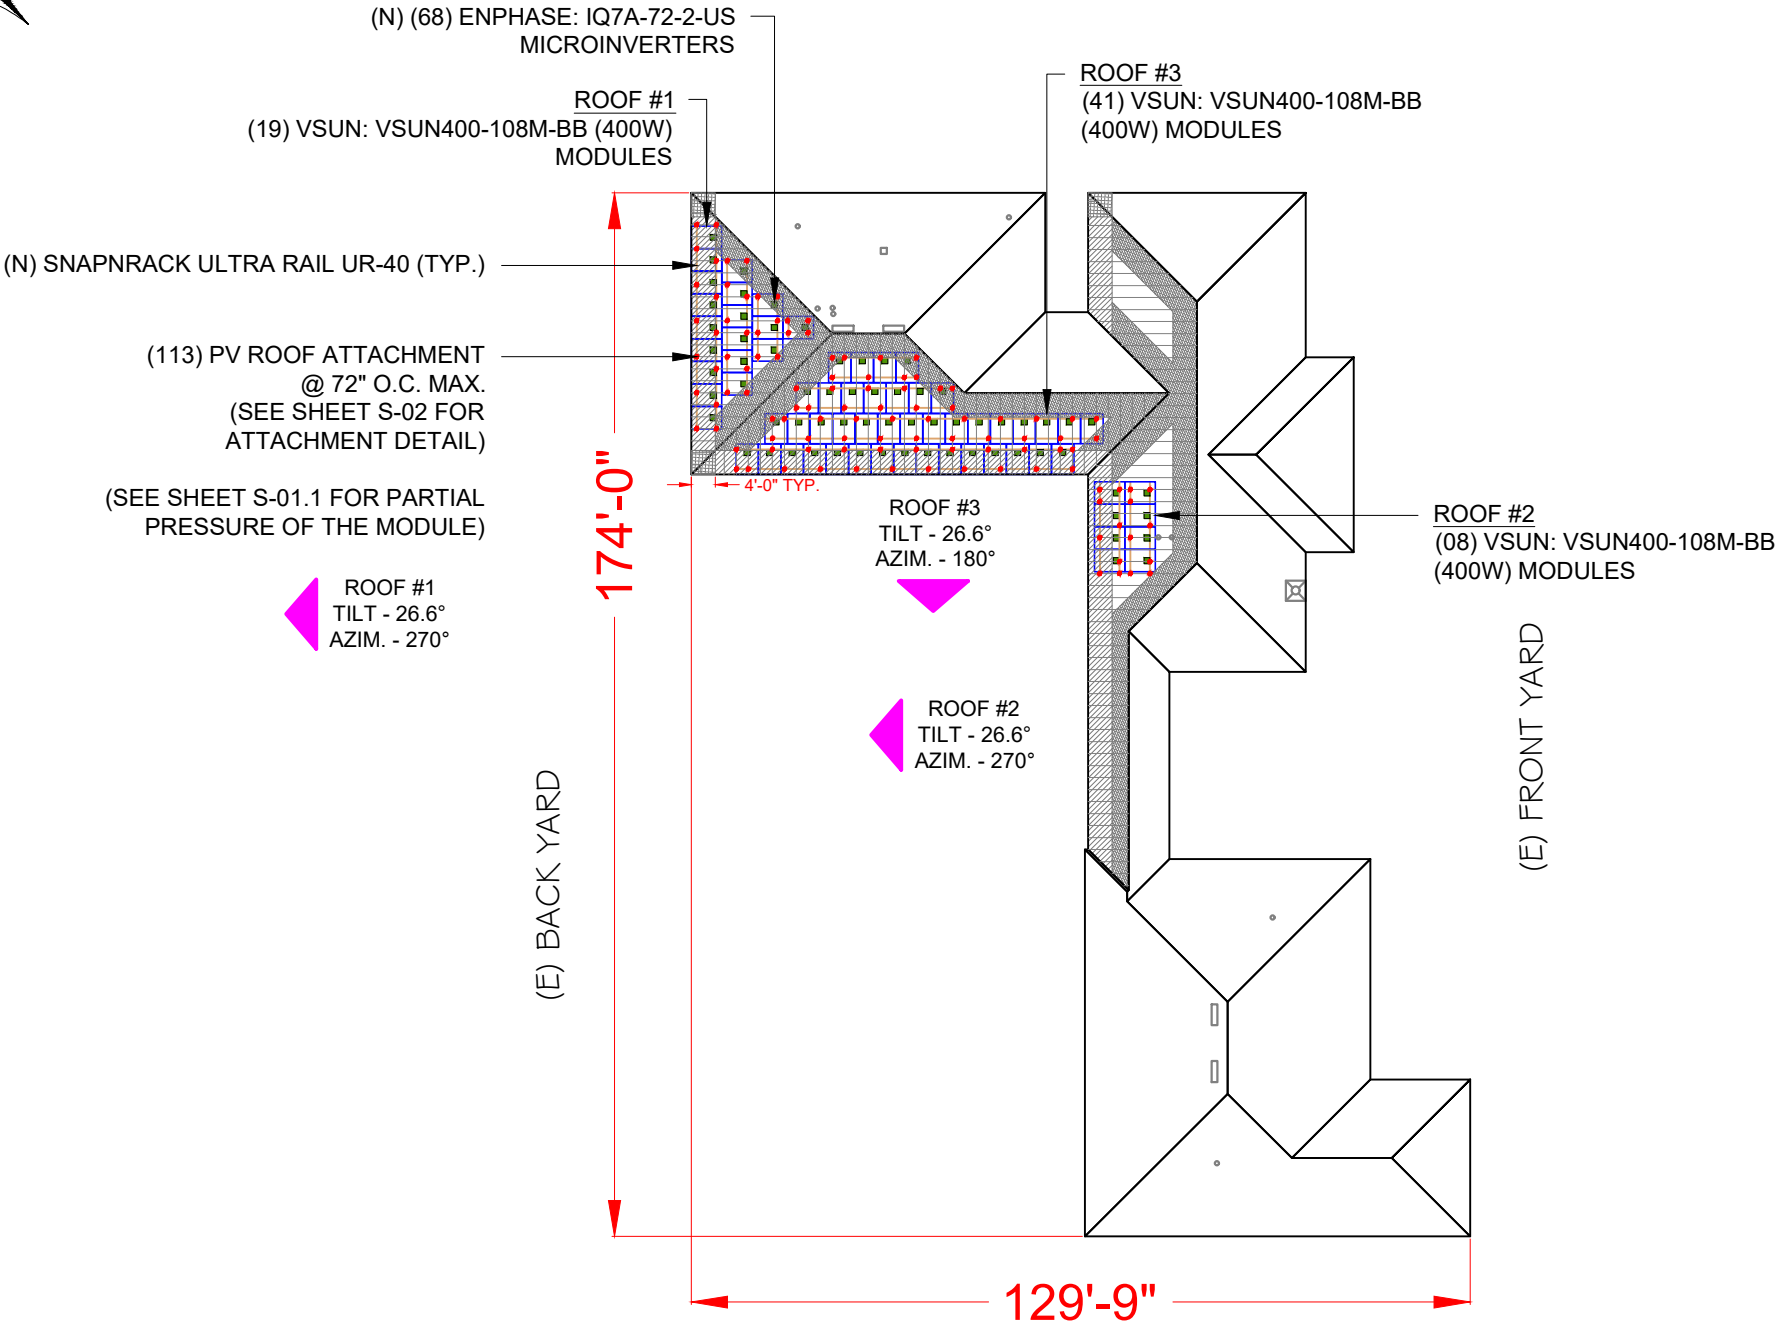

GENERAL INSTALLATION PLAN NOTES:

1) ROOF ATTACHMENTS TO SYP TRUSSES SHALL BE INSTALLED AS SHOWN IN SHEET S-02 AND AS FOLLOWS FOR EACH WIND ZONE:

WIND ZONES	NON-EXPOSED MODULES		EDGE / EXPOSED MODULES	
	SPAN	CANTILEVER	SPAN	CANTILEVER
ZONE 1	6' - 0"	2' - 0"	6' - 0"	2' - 0"
ZONE 1'	X	X	X	X
ZONE 2e	6' - 0"	2' - 0"	6' - 0"	2' - 0"
ZONE 2n	X	X	X	X
ZONE 2r	6' - 0"	2' - 0"	6' - 0"	2' - 0"
ZONE 3e	6' - 0"	2' - 0"	6' - 0"	2' - 0"
ZONE 3r	X	X	X	X

SEE SHEET S-02.1 FOR SUPPORTING CALCULATIONS.

2) EXISTING RESIDENTIAL BUILDING HAS AN ASPHALT SHINGLE ROOF WITH A MEAN ROOF HEIGHT OF 15 FT AND SYP 2"x4" ROOF TRUSSES SPACED 24" O.C. EXISTING ROOF SLOPE FOR SOLAR SYSTEM RETROFIT IS 26.6 DEGREES. CONTRACTOR TO FIELD VERIFY AND SHALL REPORT TO THE ENGINEER IF ANY DISCREPANCIES EXIST BETWEEN PLANS AND IN FIELD CONDITIONS.

3) FIRE SETBACK TO BE 3' FROM RIDGES AND EDGES, AND 18" EACH WAY FROM HIPS AND VALLEYS PER NFPA 1, 11.12.2

4) THE EXISTING ROOF AND STRUCTURE WILL NOT BE ADVERSELY AFFECTED DUE TO THE ADDITIONAL LOADS IMPOSED BY THE SOLAR SYSTEM.

\* I CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL 2020 7TH ED., CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE WIND LATERAL AND UPLIFT FORCES AND EQUIPMENT DEAD LOADS. \*

LEGEND

- WIND ZONE 1 (TYP)
- WIND ZONE 2e (TYP)
- WIND ZONE 2n (TYP)
- WIND ZONE 2r (TYP)
- WIND ZONE 3r (TYP)
- WIND ZONE 3e (TYP)



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally signed by: Ermocrates E Castillo  
Date: 2022.08.30 15:22:51


PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME  
MODULE LAYOUT

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
S-01




FOR EDGE MODULES

1	1'	2e	2n	2r	3e	3r
16	0	19	0	19	19	0

Module Size 21.01 Sq. ft.

Edge Modules								Partial Pressure
	1	1'	2e	2n	2r	3e	3r	
P21	4.37	0	16.54	0	0	0	0	18.33
P22	1.13	0	16.54	0	3.24	0	0	18.84
P23	5.56	0	0	0	15.45	0	0	18.21
P24	9.60	0	0	0	11.41	0	0	17.63
P25	3.37	0	16.54	0	1.01	0	0	18.52
P26	0	0	16.54	0	4.37	0	0	19.00

ALLOWABLE MODULE UPLIFT PRESSURE 2 RAILS: 33.6 PSF

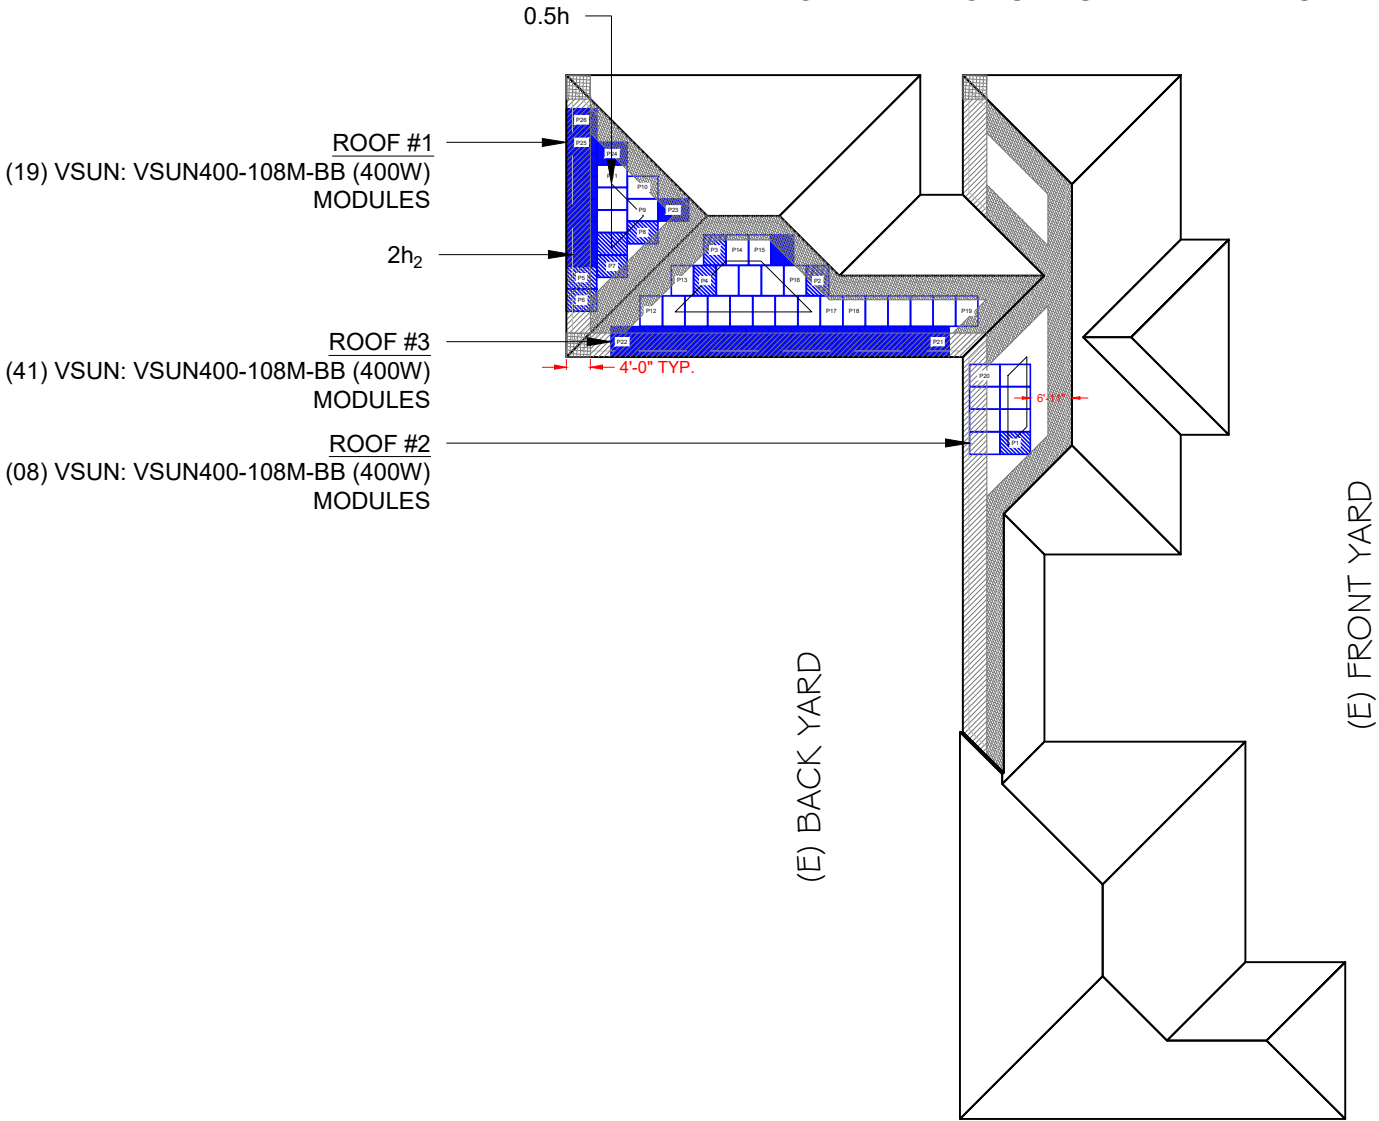

2h<sub>2</sub> DISTANCE : 1' - 0"  
0.5h DISTANCE : 7' - 6"

NOTE: PARTIAL PRESSURES OF THE WIND ZONES ON ALL MODULES HAVE BEEN VERIFIED AND ARE WITHIN THE ALLOWABLE PER THE MANUFACTURER SPECIFICATION, INSTALLER SHOULD FOLLOW THE LAYOUT TO AVOID HIGHER ZONAL PARTIAL PRESSURES. ANY CHANGES IN LAYOUT SHOULD BE REPORTED BACK TO THE ENGINEER OF RECORD.

FOR EXPOSED MODULES

1	1'	2e	2n	2r	3e	3r
16	0	19	0	19	19	0

Module Size 21.01 Sq. ft.

Exposed modules								Partial Pressure
	1	1'	2e	2n	2r	3e	3r	
P1	20.99	0	0	0	0.02	0	0	16.00
P2	5.50	0	0	0	15.51	0	0	18.21
P3	14.52	0	0	0	6.48	0	0	16.93
P4	21.01	0	0	0	0	0	0	16.00
P5	4.37	0	16.54	0	0	0	0	18.33
P6	1.32	0	16.54	0	3.05	0	0	18.81
P7	17.30	0	0.00	0	3.71	0	0	16.53
P8	18.69	0	0	0	2.32	0	0	16.33

FOR NON-EXPOSED MODULES

1	1'	2e	2n	2r	3e	3r
16	0	16	0	16	16	0

Module Size 21.01 Sq. ft.

Non-Exposed modules								Partial Pressure
	1	1'	2e	2n	2r	3e	3r	
P9	21.01	0	0	0	0	0	0	16.00
P10	11.85	0	0	0	9.16	0	0	16.00
P11	20.61	0	0	0	0.40	0	0	16.00
P12	14.02	0	0	0	6.99	0	0	16.00
P13	14.40	0	0	0	6.61	0	0	16.00
P14	17.30	0	0	0	3.62	0	0	16.00
P15	17.36	0	0	0	3.65	0	0	16.00
P16	19.04	0	0	0	1.97	0	0	16.00
P17	18.38	0	0	0	2.63	0	0	16.00
P18	13.11	0	0	0	7.90	0	0	16.00
P19	8.78	0	12.13	0	0.10	0	0	16.00

ALLOWABLE MODULE UPLIFT PRESSURE 2 RAILS: 33.6 PSF

LEGEND

- EXPOSED MODULE
- EDGE MODULE
- NON- EXPOSED MODULE
- MISSING MODULE
- MIN. MODULE EDGE DISTANCE LINE
- MODULE EXPOSURE LINE
- WIND ZONE 1 (TYP)
- WIND ZONE 2 & 2e (TYP)
- WIND ZONE 2n (TYP)
- WIND ZONE 2r (TYP)
- WIND ZONE 3r (TYP)
- WIND ZONE 3 & 3e (TYP)



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2022.08.30 15:22:51

PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME



PARTIAL PRESSURE AND  
MODULES EXPOSURE

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

S-01.1

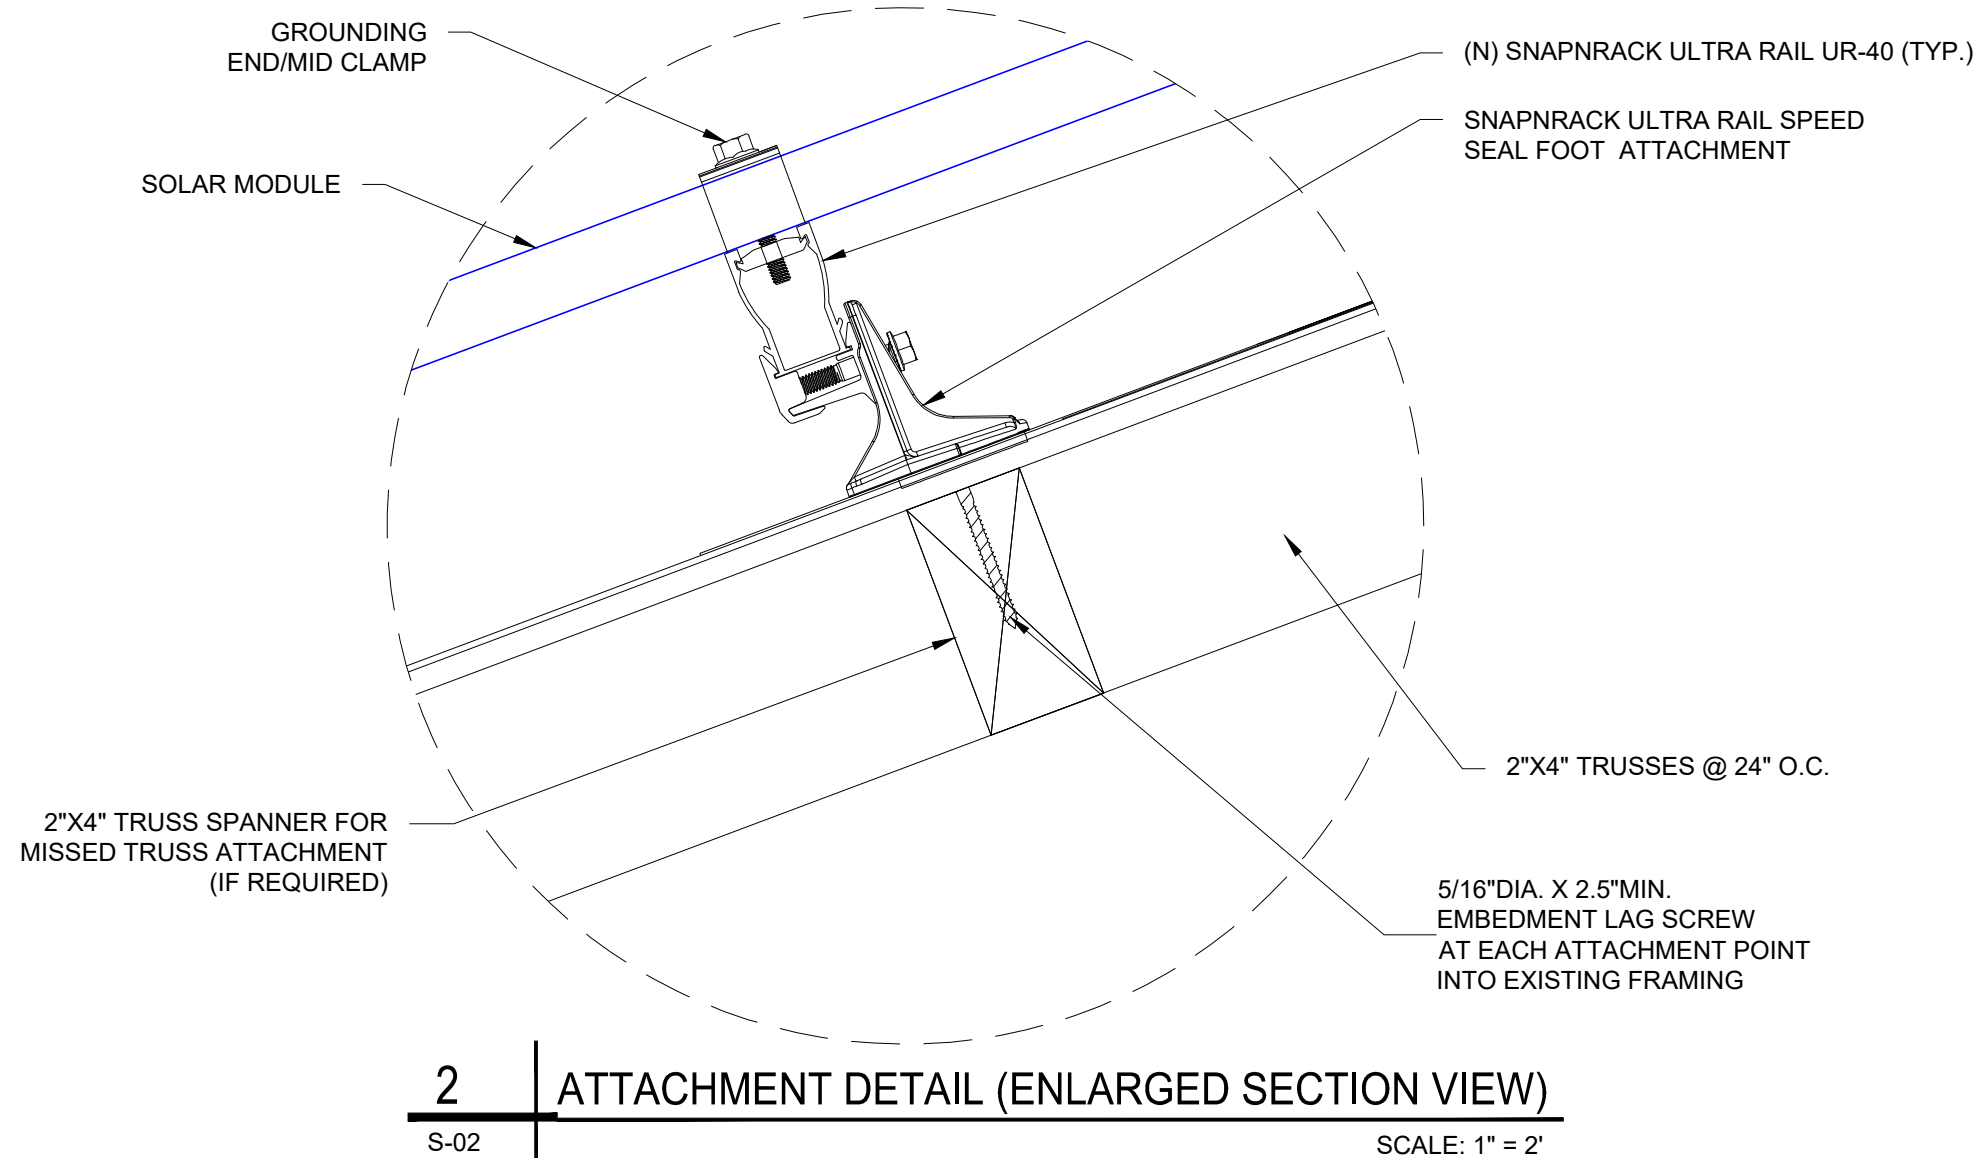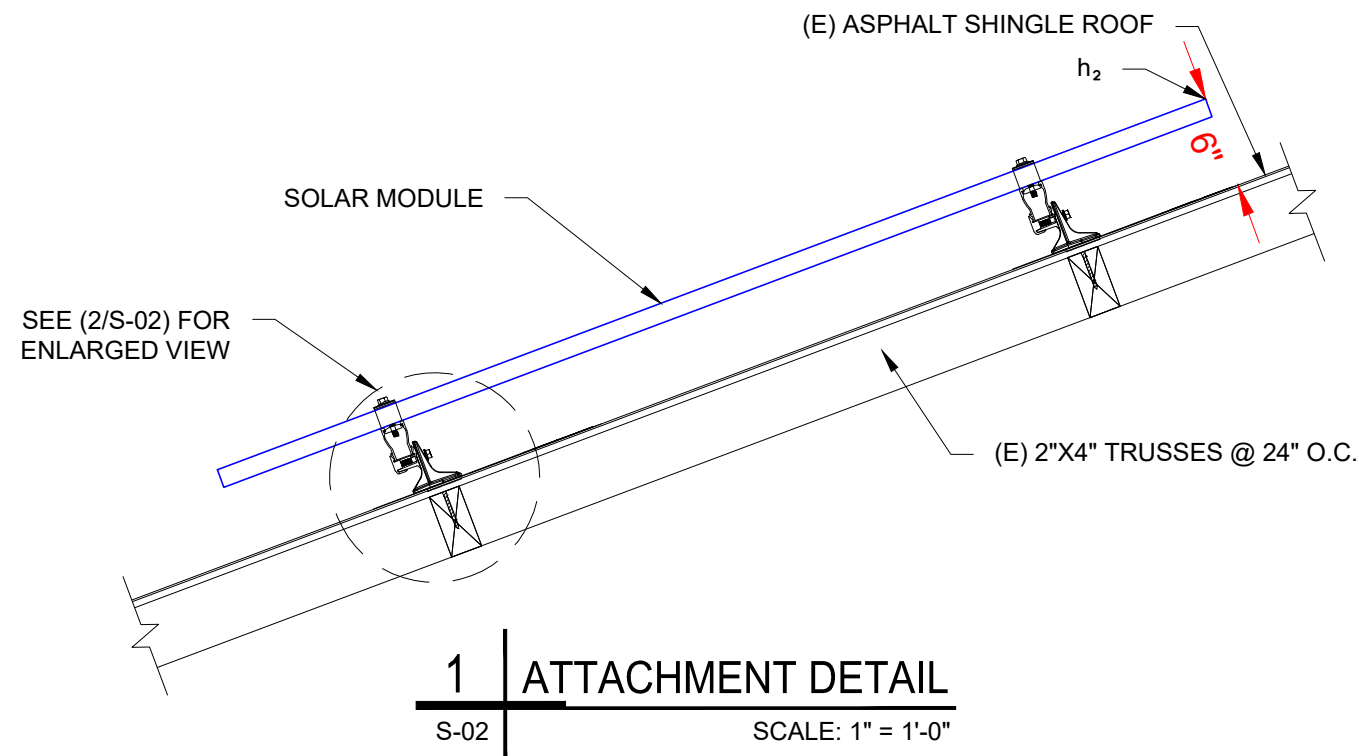

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME

ATTACHMENT DETAIL


SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

S-02



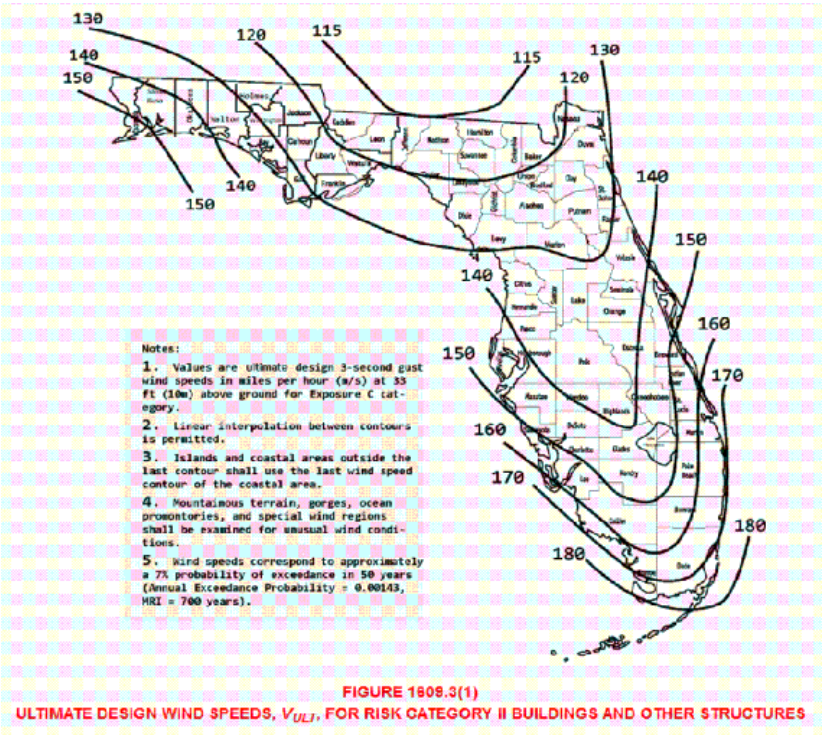

WIND LOAD CALCULATIONS FOR MODULES INSTALLED ON ROOFS WITH A HEIGHT LESS THAN 60'

SITE INFORMATION			
FBC VERSION	2020	RISK CATEGORY	II
MEAN ROOF HEIGHT (ft)	15.0	EXPOSURE CATEGORY	B
ROOF LENGTH (ft)	174.0	ROOF SLOPE	6 /12
ROOF WIDTH (ft)	129.9	ROOF SLOPE (°)	26.6
PARAPET HEIGHT (ft)	0.0	ROOF TYPE	HIP
MODULE LENGTH (in)	67.83	ULTIMATE WIND SPEED	120 mph
MODULE WIDTH (in)	44.6	NOMINAL WIND SPEED	93 mph
MODULE ORIENTATION	PORTRAIT	EXPOSURE FACTOR (C <sub>e</sub> )	1.000
MODULE AREA (sq. ft.)	21.01	TEMPERATURE FACTOR (C <sub>t</sub> )	1.000
GROUND SNOW LOAD (psf)	0.0	IMPORTANCE FACTOR (I <sub>s</sub> )	1.000
DEAD LOAD (psf)	3.0	SLOPE FACTOR (C <sub>s</sub> )	0.910
SLOPED ROOF SNOW LOAD (psf)	0.0	K <sub>D</sub>	0.850
EFFECTIVE WIND AREA (ft²)	21.0	K <sub>ZT</sub>	1.000
GROUND ELEVATION (ft)	95.0	K <sub>e</sub>	0.997
HVHZ	NO	K <sub>z</sub>	0.575

DESIGN CALCULATIONS			
VELOCITY PRESSURE (q) = .00256*K <sub>e</sub> K <sub>z</sub> K <sub>zt</sub> K <sub>d</sub> V²			
VELOCITY PRESSURE (ASD) 10.8 psf			
WIDTH OF PRESSURE COEFFICIENT	129.9' * 10%	=	12.99'
	15' * 40%	=	6'
EXTERNAL PRESSURE COEFFICIENT	ZONE 1	0.571	-1.207
	ZONE 1'	0.571	X
	ZONE 2e	0.571	-1.752
	ZONE 2n	0.571	X
	ZONE 2r	0.571	-1.752
	ZONE 3e	0.571	-1.752
	ZONE 3r	0.571	X
INTERNAL PRESSURE COEFFICIENT (+/-) 0			

DESIGN PRESSURES			
ROOF ZONE	DOWN	UP	
1	16.0	-13.0	psf
1'	16.0	X	psf
2e	16.0	-18.9	psf
2n	16.0	X	psf
2r	16.0	-18.9	psf
3e	16.0	-18.9	psf
3r	16.0	X	psf
Module allowable uplift pressure 33.6 psf			
Module allowable down pressure 75 psf			

ARRAY FACTORS			
ARRAY EDGE FACTOR (EXPOSED)	1.5	SOLAR PANEL PRESSURE	0.67104
ARRAY EDGE FACTOR (NON-EXPOSED)	1	EQUALIZATION FACTOR	

ADJUSTED DESIGN PRESSURES			
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)
1	16.0	-16.0	-16.0
1'	16.0	X	X
2e	16.0	-19.0	-16.0
2n	16.0	X	X
2r	16.0	-19.0	-16.0
3e	16.0	-19.0	-16.0
3r	16.0	X	X

ATTACHMENTS USED	
ATTACHMENT MODEL	Speedsea
ATTACHMENT STRENGTH	476 lbs

MAX DESIGN LOADS ALLOWABLE			
LIMIT MAX SPAN TO		N/A	in
RAFTER/SEAM SPACING		24	in
		NO. OF RAILS	Exposed: 2 Non. Exp: 2
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)
1	271.3	271.3	27'.3
1'	0.0	X	X
2e	271.3	322.0	27'.3
2n	0.0	X	X
2r	271.3	322.0	27'.3
3e	271.3	322.0	27'.3
3r	0.0	X	X
		SPANS (E)	SPANS (N.E)
		72 in	72 in
		X in	X in
		72 in	72 in
		X in	X in
		72 in	72 in
		72 in	72 in
		X in	X in

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

POWER™  
PRODUCTION MANAGEMENT, INC.

Digitally signed by: Ermocrates E Castillo  
Date: 2022.08.30 15:22:52

PROJECT NAME

JENKINS RESIDENCE

5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME

STRUCTURAL CALCULATION

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

S-02.1





ELECTRICAL CALCULATION

Module Manufacturer	VSUN
Module Model	VSUN400-100M-BB
Inverter Manufacturer	ENPHASE
Inverter Model	ENPHASE IQ 7 A
Modules/Branch Circuit 1	8
Modules/Branch Circuit 2	8
Modules/Branch Circuit 3	11
Modules/Branch Circuit 4	11
Modules/Branch Circuit 5	11
Modules/Branch Circuit 6	11
Modules/Branch Circuit 7	8
TOTAL ARRAY POWER (KW)	27.200
SYSTEM AC VOLTAGE	240V 1-PHASE

DESIGN TEMPERATURE	
MIN. AMBIENT TEMP. °F	32
MAX. AMBIENT TEMP. °F	117
CALCULATED MAX. V <sub>OC</sub>	40
CALCULATED MIN V <sub>MP</sub>	25
CONDUIT FILL	
NUMBER OF CONDUITS	2

MODULE PROPERTIES			
V <sub>OC</sub>	37.36	I <sub>SC</sub>	11.19
V <sub>MPP</sub>	31.36	I <sub>MP</sub>	10.39
T <sub>C</sub> V <sub>OC</sub>	-0.32%/K	T <sub>C</sub> V <sub>MP</sub>	-0.32%/K
P <sub>MP</sub>	400.0	N <sub>OUT</sub>	45 °C

INVERTER PROPERTIES	
OUTPUT VOLTAGE	240 L-L 1-PH
MAX INPUT DC VOLTAGE	58 V <sub>DC</sub>
OPERATING RANGE	18 - 58 V <sub>DC</sub>
MPPT VOLTAGE RANGE	30 - 58 V <sub>DC</sub>
START VOLTAGE	30 V <sub>DC</sub>
MAX INPUT POWER	460 W <sub>DC</sub>
CONTINUOUS AC POWER	349 VA

AMPACITY CALCULATIONS										
CIRCUIT	MAX AMPS	1.25 x MAX AMPS	AWG	90 °C AMPACITY	AMBIENT TEMP °F	TEMP DERATE	CONDUIT FILL	FILL DERATE	DERATED AMPACITY	MAXIMUM CIRCUIT BREAKER
CIRCUIT 1	11.6	14.5	#10	40	130	0.76	4	0.8	24.32	20 A
CIRCUIT 2	11.6	14.5	#10	40	130	0.76	4	0.8	24.32	20 A
AC COMBINER 1	23.2	29.0	#10	40	95	0.96	3	1	38.4	30 A
CIRCUIT 3	16.0	20.0	#10	40	130	0.76	8	0.7	21.28	20 A
CIRCUIT 4	16.0	20.0	#10	40	130	0.76	8	0.7	21.28	20 A
CIRCUIT 5	16.0	20.0	#10	40	130	0.76	8	0.7	21.28	20 A
CIRCUIT 6	16.0	20.0	#10	40	130	0.76	8	0.7	21.28	20 A
AC COMBINER 2	64.0	80.0	#4	95	95	0.96	3	1	91.2	80 A
CIRCUIT 7	11.6	14.5	#10	40	130	0.76	2	1	30.4	20 A

MAXIMUM CIRCUIT VOLTAGE DROP	2%
------------------------------	----

VOLTAGE DROP CALCULATIONS					
CIRCUIT	AWG	CIRCULAR MILLS	I	V	MAX LENGTH
CIRCUIT 1	#10	10380	11.6	240	166 FEET
CIRCUIT 2	#10	10380	11.6	240	166 FEET
AC COMBINER 1	#10	10380	23.2	240	83 FEET
CIRCUIT 3	#10	10380	16.0	240	121 FEET
CIRCUIT 4	#10	10380	16.0	240	121 FEET
CIRCUIT 5	#10	10380	16.0	240	121 FEET
CIRCUIT 6	#10	10380	16.0	240	121 FEET
AC COMBINER 2	#4	41740	64.0	240	121 FEET
CIRCUIT 7	#10	10380	11.6	240	166 FEET

NOTES	
TEMP DERATE BASED ON NEC TABLE 310.15(B)(2)(A)	
CONDUIT FILL DERATE BASED ON NEC TABLE 310.15(B)(3)(A)	
MAXIMUM V <sub>OC</sub> CALCULATED USING MODULE MANUFACTURE TEMPERATURE COEFFICIENTS PER NEC 690.7(A)	
UNLESS OTHERWISE SPECIFIED, ALL WIRING MUST BE THHN OR THWN-2 COPPER	
ALL WIRE SIZES LISTED ARE THE MINIMUM ALLOWABLE	
	IN ANY CELL INDICATES THAT THE SYSTEM IS SAFE AND COMPLIES WITH NEC REQUIREMENTS
	IN ANY CELL INDICATES A POTENTIALLY UNSAFE CONDITION
	INFORMATION INPUT BY SYSTEM DESIGNER
	INFORMATION OBTAINED FROM MANUFACTURER DATASHEETS

ELECTRICAL NOTES

1. ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
2. ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT. THE TERMINALS ARE RATED FOR 75 DEGREE C.
3. THE WIRES ARE SIZED ACCORDING TO NEC 110.14.
4. WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
5. WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
6. DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
7. WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
8. ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
9. MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
10. MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
11. THE POLARITY OF THE GROUNDED CONDUCTORS IS NEGATIVE .
12. UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
13. MODULES CONFORM TO AND ARE LISTED UNDER UL 1703.
14. RACKING CONFORMS TO AND IS LISTED UNDER UL 2703.
15. CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D).
16. CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).
17. THIS SYSTEM IS EQUIPPED WITH RAPID SHUTDOWN OF PV CONDUCTORS IN COMPLIANCE WITH NEC 690.12.
18. LABELING IN COMPLIANCE WITH NEC 690.12 AND 690.56(C) IS SHOWN ON SHEET E-03.
19. ALL CONDUITS TO BE INSTALLED A MIN OF 7/8" ABOVE THE ROOF SURFACE.
20. THE ENCHARGE BATTERY AS PART OF THE ENSEMBLE SYSTEM DOES NOT EXPORT POWER TO THE GRID IN ANY STORAGE MODE

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107, THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION.



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

Signature with Digitaly signed by: Ermocrates E Castillo

Date: 2022.08.30 15:22:52

PROJECT NAME

JENKINS RESIDENCE

5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME

WIRING CALCULATIONS

SHEET SIZE


ANSI B  
11" X 17"

SHEET NUMBER

E-02

## CAUTION!


POWER TO THIS BUILDING  
SUPPLIED FROM MULTIPLE SOURCES

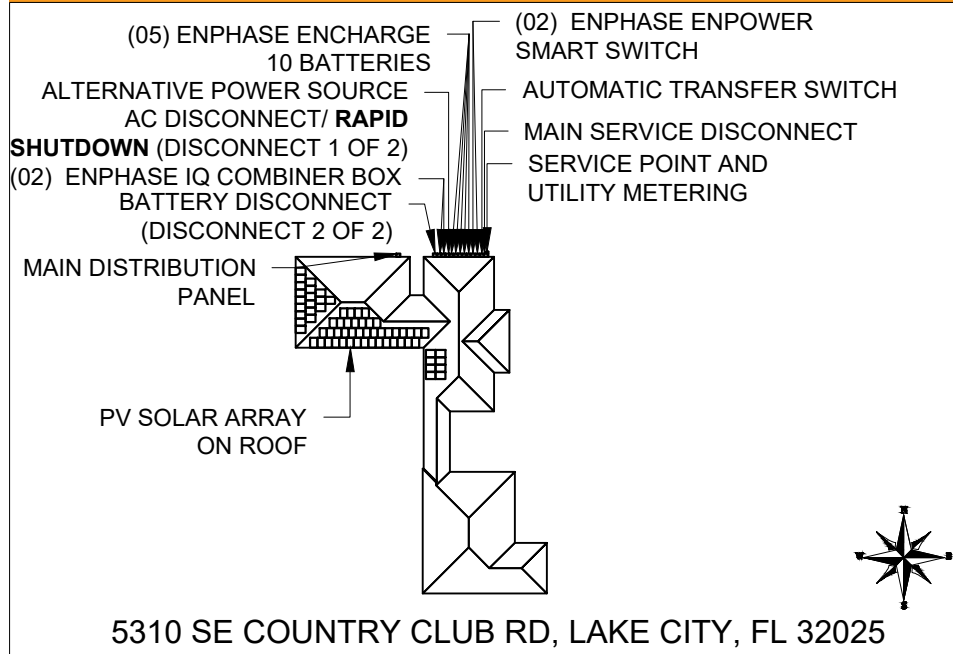

LABEL LOCATION:  
MAIN SERVICE DISCONNECT / MAIN DISTRIBUTION PANEL, PV DISCONNECT  
LOCATED NO MORE THAN 3FT (1M) FROM THE SERVICE DISCONNECT  
(TEXT HEIGHT SHOULD BE A MINIMUM OF 3/8")  
PER CODE NEC 705.10

## SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN  
SWITCH TO THE  
"OFF" POSITION TO  
SHUT DOWN PV SYSTEM  
AND REDUCE  
SHOCK HAZARD  
IN THE ARRAY



LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC 690.56(C)(1)(a), IFC 1204.5.1)

### ⚠ WARNING

**ELECTRIC SHOCK HAZARD**  
TERMINALS ON BOTH LINE AND  
LOAD SIDES MAY BE ENERGIZED  
IN THE OPEN POSITION

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC 690.13(B))

### ⚠ WARNING DUAL POWER SOURCE SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(b))

## PHOTOVOLTAIC SYSTEM AC DISCONNECT RATED AC OPERATING CURRENT 98.6 AMPS AC NOMINAL OPERATING VOLTAGE 240 VOLTS

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC 690.54)

**WARNING:**  
POWER SOURCE OUTPUT CONNECTION DO  
NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(b))

DATA PER PANEL

NOMINAL OPERATING AC VOLTAGE -	240	V
NOMINAL OPERATING AC FREQUENCY-	60	Hz
MAXIMUM AC POWER-	349	VA
MAXIMUM AC CURRENT-	1.45	A
MAXIMUM OVERCURRENT DEVICE RATING FOR AC MODULE PROTECTION PER CIRCUIT-	20	A

LABEL LOCATION:  
COMBINER BOX  
(PER CODE: NEC 690.52)

## RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM



LABEL LOCATION:  
AC DISCONNECT  
(PER CODE: NEC 690.56(C)(3))


**WARNING:**  
THIS EQUIPMENT FED BY MULTIPLE  
SOURCES. TOTAL RATING OF ALL  
OVERCURRENT DEVICES, EXCLUDING  
MAIN SUPPLY OVERCURRENT DEVICE,  
SHALL NOT EXCEED AMPACITY OF BUSBAR

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(c))

## EMERGENCY RESPONDER THIS SOLAR PV SYSTEM IS EQUIPPED WITH RAPID SHUTDOWN.

TURN RAPID  
SHUTDOWN SWITCH  
TO THE "OFF" POSITION  
TO SHUT DOWN ENTIRE  
PV SYSTEM

 - SECTIONS OF THE PV SYSTEM THAT  
ARE SHUT DOWN WHEN THE RAPID  
SHUTDOWN SWITCH IS OPERATED.  
 - SECTIONS OF THE PV SYSTEM THAT  
ARE NOT SHUT DOWN WHEN THE RAPID  
SHUTDOWN SWITCH IS OPERATED.



LABEL LOCATION:  
AC DISCONNECT  
(TEXT HEIGHT SHOULD BE A MINIMUM OF 3/8")  
(PER CODE: NFPA 1, 11.12.2.1.1)

**POWER PRODUCTION MANAGEMENT**  
EMERGENCY CONTACT:   
PH:(352) 263-0766

LABEL LOCATION:  
MAIN DISCONNECT  
(PER CODE: NFPA - 1, 11.12.2.1.5)

ADHESIVE FASTENED SIGNS:  
• THE LABEL SHALL BE VISIBLE, REFLECTIVE AND SUITABLE FOR  
THE ENVIRONMENT WHERE IT IS INSTALLED [NFPA 1, 11.12.2.1]  
• WHERE REQUIRED ELSEWHERE IN THIS CODE, ALL FIELD  
APPLIED LABELS, WARNINGS, AND MARKINGS SHOULD  
COMPLY WITH ANSI Z535.4 [NEC 110.21(B) FIELD MARKING].  
• ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF  
PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER  
RESISTANT [IFC 605.11.1.3]

**Castillo**  
Engineering  
SOLAR DONE RIGHT®

CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER

**POWER**  
PRODUCTION MANAGEMENT, INC.

Signature with  
Date:  
2022.08.30  
15:22:53  
Digitally  
signed by:  
Ermocrate  
s E Castillo

### PROJECT NAME

JENKINS RESIDENCE

5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

### SHEET NAME

SYSTEM LABELING

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

E-03



# VSUN405-108M-BB

**405W**

Highest power output

**20.75%**


Module efficiency

**12years**

Material & Workmanship warranty

**25years**

Linear power output warranty

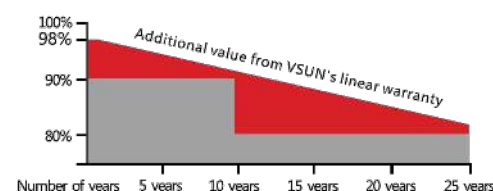

■ VSUN ■ Standard Warranty

**Munich RE**

**PERC** MBB technology with Circular Ribbon


Higher output power

Half-cell Technology

Positive tolerance offer

**VSUN405-108M-BB**  
**VSUN395-108M-BB**

**VSUN400-108M-BB**  
**VSUN390-108M-BB**

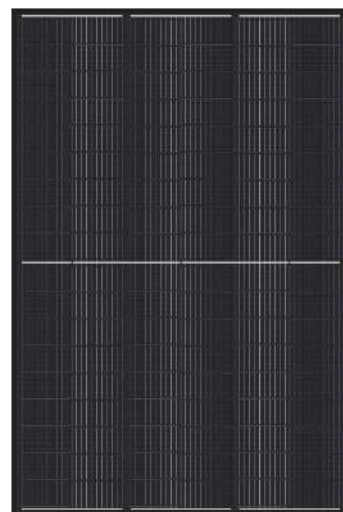

Micro Gap

Better shading tolerance

Certified for salt/ammonia corrosion resistance

Load certificates: wind to 2400Pa and snow to 5400Pa

Lower LCOE

VSUN, a BNEF Tier-1 PV module manufacturer invested by Fuji Solar, has been committed to providing greener, cleaner and more intelligent renewable energy solutions. VSUN is dedicated to bringing reliable, customized and high-efficient products into various markets and customers worldwide.

最も信頼出来る再エネパートナー

## Electrical Characteristics at Standard Test Conditions(STC)

Module Type	VSUN405-108M-BB	VSUN400-108M-BB	VSUN395-108M-BB	VSUN390-108M-BB
Maximum Power - Pmax (W)	405	400	395	390
Open Circuit Voltage - Voc (V)	37.36	37.2	37.03	36.84
Short Circuit Current - Isc (A)	13.78	13.68	13.59	13.5
Maximum Power Voltage - Vmpp (V)	31.36	31.17	31	30.82
Maximum Power Current - Imp (A)	12.92	12.84	12.75	12.66
Module Efficiency	20.75%	20.49%	20.23%	19.98%

Standard Test Conditions (STC): irradiance 1,000 W/m<sup>2</sup>; AM 1.5; module temperature 25°C. Pmax Sorting : 0-5W. Measuring Tolerance: ±3%.

Remark: Electrical data do not refer to a single module and they are not part of the offer. They only serve for comparison among different module types.

## Electrical Characteristics at Normal Operating Cell Temperature(NOCT)

Module Type	VSUN405-108M-BB	VSUN400-108M-BB	VSUN395-108M-BB	VSUN390-108M-BB
Maximum Power - Pmax (W)	302.1	298.4	294.7	287.3
Open Circuit Voltage - Voc (V)	35.1	34.9	34.8	34.5
Short Circuit Current - Isc (A)	11.19	11.13	11.05	10.91
Maximum Power Voltage - Vmpp (V)	29.1	28.9	28.8	28.4
Maximum Power Current - Imp (A)	10.39	10.32	10.25	10.1

Normal Operating Cell Temperature( NOCT) : irradiance 800W/m<sup>2</sup>; wind speed 1 m/s ; ambient temperature 20°C. Measuring Tolerance: ±3%.

## Temperature Characteristics

NOCT	45°C (±2°C)
Voltage Temperature Coefficient	-0.27%/°C
Current Temperature Coefficient	+0.048%/°C
Power Temperature Coefficient	-0.32%/°C

## Maximum Ratings

Maximum System Voltage [V]	1000
Series Fuse Rating [A]	30

## Material Characteristics

Dimensions	1723×1133×35mm (L×W×H)
Weight	21.8kg
Frame	Black anodized aluminum profile
Front Glass	White toughened safety glass, 3.2 mm
Cell Encapsulation	EVA (Ethylene-Vinyl-Acetate)
Back Sheet	Composite film
Cells	12×9 pieces monocrystalline solar cells series strings
Junction Box	IP68, 3 diodes
Cable&Connector	Potrait: 500 mm (cable length can be customized) , 1×4 mm <sup>2</sup> , compatible with MC4


## Packaging

Dimensions(L×W×H)	1760×1125×1253mm
Container20'	186
Container40'	403
Container40'HC	806


## System Design

Temperature Range	-40 °C to + 85 °C
Withstanding Hail	Maximum diameter of 25 mm with impact speed of 23 m/s-1
Maximum Surface Load	5,400 Pa
Application class	class A

## Dimensions

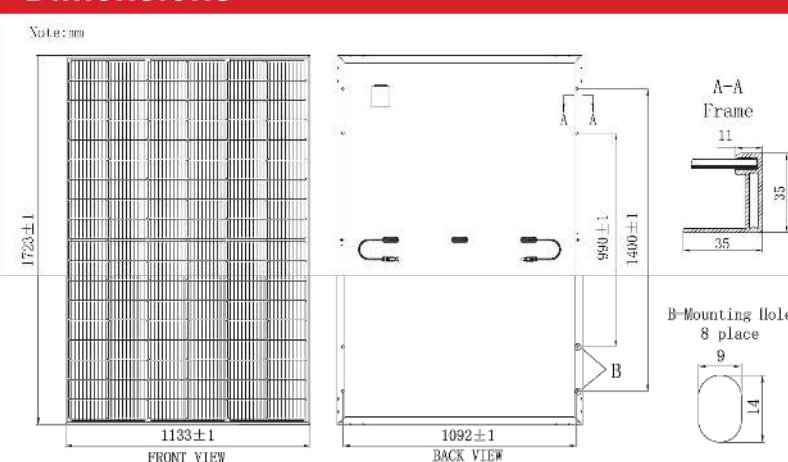

## IV-Curves

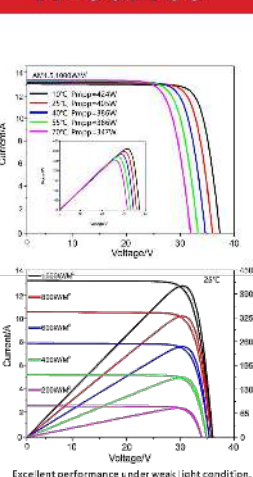

CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

**POWER**  
PRODUCTION MANAGEMENT, INC.

Digitally signed by:  
Ermocrates E Castillo  
Date:  
2022.08.30  
15:22:53

PROJECT NAME

**JENKINS RESIDENCE**  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-01



## Enphase IQ 7A Microinverter

The high-powered smart grid-ready **Enphase IQ 7A Micro™** dramatically simplifies the installation process while achieving the highest system efficiency for systems with 60-cell and 72-cell modules.

Part of the Enphase IQ System, the IQ 7A Micro integrates with the Enphase IQ Envoy™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

The IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.



### High Power

- Peak output power 366 VA @ 240 VAC and 295 VA @ 208 VAC

### Easy to Install

- Lightweight and simple
- Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014, 2017 & 2020)

### Efficient and Reliable

- Optimized for high powered 60-cell and 72-cell modules
- Highest CEC efficiency of 97%
- More than a million hours of testing
- Class II double-insulated enclosure
- UL listed

### Smart Grid Ready

- Complies with advanced grid support, voltage and frequency ride-through requirements
- Envoy and Internet connection required
- Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)

## Enphase IQ 7A Microinverter

INPUT (DC)		IQ7A-72-2-US	
Commonly used module pairings <sup>1</sup>	295 W–460 W +		
Module compatibility	60-cell, 66-cell and 72-cell PV modules		
Maximum input DC voltage	58 V		
Power point tracking voltage range <sup>2</sup>	18 V–58 V		
Min/Max start voltage	33 V / 58 V		
Max DC short circuit current (module Isc) <sup>3</sup>	15 A		
Overvoltage class DC port	II		
DC port backfeed current	0 A		
PV array configuration	1 x 1 ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit		
OUTPUT (AC)		@ 240 VAC	@ 208 VAC
Peak output power	366 VA	295 VA	
Maximum continuous output power	349 VA	290 VA	
Nominal (L-L) voltage/range <sup>4</sup>	240 V / 211–264 V	208 V / 183–229 V	
Maximum continuous output current	1.45 A (240 VAC)	1.39 A (208 VAC)	
Nominal frequency	60 Hz		
Extended frequency range	47–68 Hz		
AC short circuit fault current over 3 cycles	5.8 Arms		
Maximum units per 20 A (L-L) branch circuit <sup>5</sup>	11 (240 VAC)	11 (208 VAC)	
Overvoltage class AC port	III		
AC port backfeed current	18 mA		
Power factor setting	1.0		
Power factor (adjustable)	0.85 leading ...	0.85 lagging	
EFFICIENCY		@240 VAC	@208 VAC
CEC weighted efficiency	97.0 %	96.5%	
MECHANICAL			
Ambient temperature range	-40°C to +60°C		
Relative humidity range	4% to 100% (condensing)		
Connector type: DC (IQ7A-72-2-US)	MC4		
Dimensions (HxWxD)	212 mm x 175 mm x 30.2 mm (without bracket)		
Weight	1.08 kg (2.38 lbs)		
Cooling	Natural convection — No fans		
Approved for wet locations	Yes		
Pollution degree	PD3		
Enclosure	Class II double-insulated, corrosion resistant polymeric enclosure		
Environmental category / UV exposure rating	NEMA Type 6 / outdoor		
FEATURES			
Communication	Power Line Communication (PLC)		
Monitoring	Enlighten Manager and MyEnlighten monitoring options Compatible with Enphase IQ Envoy		
Disconnecting means	The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.		
Compliance	CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020, section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according manufacturer's instructions.		

- No enforced DC/AC ratio. See the compatibility calculator at <https://enphase.com/en-us/support/module-compatibility>.
- CEC peak power tracking voltage range is 38 V to 43 V.
- Maximum continuous input DC current is 10.2A.
- Voltage range can be extended beyond nominal if required by the utility.
- Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2021 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Enphase IQ 7A, Enphase IQ Battery, Enphase Enlighten, Enphase IQ Envoy, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change.  
11-04-2021



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



**CASTILLO ENGINEERING SERVICES, LLC**  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

**COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC**

### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2022.08.30 15:22:53

### PROJECT NAME

**JENKINS RESIDENCE**  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET

### SHEET SIZE


ANSI B  
11" X 17"

### SHEET NUMBER

DS-02

# Enphase IQ Combiner 3 (X-IQ-AM1-240-3)

The **Enphase IQ Combiner 3™** with Enphase IQ Envoy™ consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

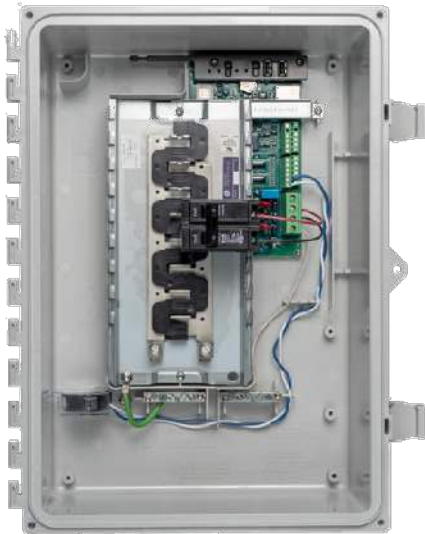

## Smart

- Includes IQ Envoy for communication and control
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and optional consumption monitoring
- Supports Ensemble Communications Kit for communication with Enphase Encharge™ storage and Enphase Enpower™ smart switch

## Simple

- Reduced size from previous combiner
- Centered mounting brackets support single stud mounting
- Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

## Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- UL listed



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase IQ Combiner 3

MODEL NUMBER	
IQ Combiner 3 X-IQ-AM1-240-3	IQ Combiner 3 with Enphase IQ Envoy™ printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).
ACCESSORIES and REPLACEMENT PARTS (not included, order separately)	
Enphase Mobile Connect™ CELLMODEM-03 (4G/12-year data plan) CELLMODEM-01 (3G/5-year data plan) CELLMODEM-M1 (4G based LTE-M/5-year data plan)	Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.)
Consumption Monitoring* CT CT-200-SPLIT	Split core current transformers enable whole home consumption metering (+/- 2.5%).
* Consumption monitoring is required for Enphase Storage Systems	
Ensemble Communications Kit COMMS-KIT-01	Installed at the IQ Envoy. For communications with Enphase Encharge™ storage and Enphase Enpower™ smart switch. Includes USB cable for connection to IQ Envoy or Enphase IQ Combiner™ and allows wireless communication with Encharge and Enpower.
Circuit Breakers BRK-10A-2-240 BRK-15A-2-240 BRK-20A-2P-240	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220
EPLC-01	Power line carrier (communication bridge pair), quantity - one pair
XA-SOLARSHIELD-ES	Replace the default solar shield with this Ensemble Combiner Solar Shield to match the look and feel of the Enphase Enpower™ smart switch and the Enphase Encharge™ storage system
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Envoy printed circuit board (PCB) for Combiner 3
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating (output to grid)	65 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. continuous current rating (input from PV)	64 A
Max. total branch circuit breaker rating (input)	80 A of distributed generation / 95 A with IQ Envoy breaker included
Envoy breaker	10A or 15A rating GE Q-line/Siemens Type QP /Eaton BR series included
Production Metering CT	200 A solid core pre-installed and wired to IQ Envoy
MECHANICAL DATA	
Dimensions (WxHxD)	49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Height is 21.06" (53.5 cm with mounting brackets).
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
Cellular	CELLMODEM-M1 4G based LTE-M cellular modem (not included). Note that an Enphase Mobile Connect cellular modem is required for all Ensemble installations.
COMPLIANCE	
Compliance, Combiner	UL 1741, CAN/CSA C22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2021 Enphase Energy. All rights reserved. Enphase, the Enphase logo, IQ Combiner 3, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2021-05-20



CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER



Digitally signed by:  
Ermocrates E Castillo  
Date: 2022.08.30 15:22:54

### PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

DS-03



Enphase  
Enpower



The **Enphase Enpower™** smart switch connects the home to grid power, the Encharge storage system, and solar PV. It provides microgrid interconnection device (MID) functionality by automatically detecting and seamlessly transitioning the home energy system from grid power to backup power in the event of a grid failure. It consolidates interconnection equipment into a single enclosure and streamlines grid independent capabilities of PV and storage installations by providing a consistent, pre-wired solution for residential applications.

Reliable

- Durable NEMA type 3R enclosure
- Ten-year limited warranty

Smart

- Controls safe connectivity to the grid
- Automatically detects grid outages
- Provides seamless transition to backup

Simple

- Connects to the load or service equipment<sup>1</sup> side of the main load panel
- Centered mounting brackets support single stud mounting
- Supports conduit entry from the bottom, bottom left side, and bottom right side
- Supports whole home and partial home backup and subpanel backup
- Up to 200A main breaker support
- Includes neutral-forming transformer for split phase 120/240V backup operation

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



Enphase Enpower

MODEL NUMBER		
EP200G101-M240US00		Enphase Enpower smart switch with neutral-forming transformer (NFT), Microgrid Interconnect Device (MID), breakers, and screws. Streamlines grid-independent capabilities of PV and storage installations.
ACCESSORIES and REPLACEMENT PARTS		
EP200G-LITKIT		Literature Kit for Enpower, including labels, feed-through headers, screws and filler plates.
EP200G-NA-HD-200A		Eaton type BR circuit breaker hold-down screw kit, BRHDK125
EP200G-HNDL-R1		Enpower installation handle kit (order separately)
Circuit breakers (as needed) <sup>1,2</sup>		Not included, must order separately:
BRK-100A-2P-240V		• Main breaker, 2 pole, 100A, 25kAIC, CSR2100
BRK-125A-2P-240V		• Main breaker, 2 pole, 125A, 25kAIC, CSR2125N
BRK-150A-2P-240V		• Main breaker, 2 pole, 150A, 25kAIC, CSR2150N
BRK-175A-2P-240V		• Main breaker, 2 pole, 175A, 25kAIC, CSR2175N
BRK-200A-2P-240V		• Main breaker, 2 pole, 200A, 25kAIC, CSR2200N
BRK-20A-2P-240V-B		• Circuit breaker, 2 pole, 20A, 10kAIC, BR220B
BRK-30A-2P-240V		• Circuit breaker, 2 pole, 30A, 10kAIC, BR230B
BRK-40A-2P-240V		• Circuit breaker, 2 pole, 40A, 10kAIC, BR240B
BRK-60A-2P-240V		• Circuit breaker, 2 pole, 60A, 10kAIC, BR260
BRK-80A-2P-240V		• Circuit breaker, 2 pole, 80A, 10kAIC, BR280
ELECTRICAL SPECIFICATIONS		
Assembly rating		Continuous operation at 100% of its rating
Nominal voltage / range (L-L)		240 VAC / 100 - 310 VAC
Voltage measurement accuracy		±1% V nominal (±1.2V L-N and ±2.4V L-L)
Auxiliary contact for load control and excess PV control		24V, 1A
Nominal frequency / range		60 Hz / 56 - 63 Hz
Frequency measurement accuracy		±0.1 Hz
Maximum continuous current rating		160A
Maximum input overcurrent protection device		200A
Maximum output overcurrent protection device		200A
Maximum overcurrent protection device rating for storage branch circuit <sup>3</sup>		80A
Maximum overcurrent protection device rating for PV combiner branch circuit <sup>5</sup>		80A
Neutral Forming Transformer (NFT)		• Breaker rating (pre-installed): 40A between L1 and Neutral; 40A between L2 and Neutral • Continuous rated power: 3600VA • Maximum continuous unbalance current: 30A @ 120V • Peak rated power: 8800VA for 30 seconds • Peak unbalanced current: 80A @ 120V for 30 seconds
MECHANICAL DATA		
Dimensions (WxHxD)		50cm x 91.6cm x 24.6cm (19.7 in x 36 in x 9.7 in)
Weight		39.5 kg (85 lbs)
Ambient temperature range		-40° C to +50° C (-40° F to 122° F)
Cooling		Natural convection, plus heat shield
Enclosure environmental rating		Outdoor, NEMA type 3R, polycarbonate construction
Altitude		To 2500 meters (8200 feet)
WIRE SIZES		
Connections (All lugs are rated to 90C)		• Main lugs and backup load lugs • CSR breakers • BR breakers (wire provided) • AC combiner lugs, Encharge lugs, and generator lugs • Neutral (large lugs) Cu/Al: 1 AWG – 300 KCMIL Cu/Al: 2 AWG – 300 KCMIL 6 AWG 14 AWG – 2 AWG Cu/Al: 6 AWG - 300 KCMIL
Neutral and ground bars		Large holes (5/16-24 UNF) Small holes (10-32 UNF) 14 AWG – 1/0 AWG 14 AWG – 6 AWG
COMPLIANCE		
Compliance		UL 1741, UL 1741 SA, UL 1741 PCS, UL1998, UL869A*, UL67*, UL508*, UL50F* CSA 22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003, AC156. Enpower is approved for Use as Service Equipment in the United States*.

1. Compatible with BRHDK125 Hold-Down Kit to comply with 2017 NEC 710.15E for back-fed circuit breakers.  
2. The Enpower is rated 22 kAIC  
3. Not included. Installer must provide properly rated breaker per circuit breaker list above.  
4. Sections from these standards were used during the safety evaluation and included in the UL 1741 listing.  
5. Enpower is not suitable for use as service equipment in Canada.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2021 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Enpower, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 08-05-2021



CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER



Signature with  
Date:  
2022.08.30  
15:22:54

PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-04



# Enphase Encharge 10

The **Enphase Encharge 10™** all-in-one AC-coupled storage system is **reliable, smart, simple, and safe**. It is comprised of three base Encharge 3™ storage units, has a total usable energy capacity of 10.08 kWh and twelve embedded grid-forming microinverters with 3.84 kW power rating. It provides backup capability and installers can quickly design the right system size to meet the needs of both new and retrofit solar customers.



### Reliable

- Proven high reliability IQ Series Microinverters
- Ten-year limited warranty
- Three independent Encharge storage base units
- Twelve embedded IQ 8X-BAT Microinverters
- Passive cooling (no moving parts/fans)

### Smart

- Grid-forming capability for backup operation
- Remote software and firmware upgrade
- Mobile app-based monitoring and control
- Support for self consumption
- Utility time of use (TOU) optimization

### Simple

- Fully integrated AC battery system
- Quick and easy plug-and-play installation
- Interconnects with standard household AC wiring

### Safe

- Cells safety tested
- Lithium iron phosphate (LFP) chemistry for maximum safety and longevity

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase Encharge 10

MODEL NUMBER	
ENCHARGE-10-1P-NA	Encharge 10 battery storage system with integrated Enphase Microinverters and battery management unit (BMU). Includes: - Three Encharge 3.36 kWh base units (B03-A01-US00-1-3) - One Encharge 10 cover kit with cover, wall mounting bracket, watertight conduit hubs, and interconnect kit for wiring between batteries (B10-C-1050-0)
ACCESSORIES	
ENCHARGE-HNDL-R1	One set of Encharge base unit installation handles
OUTPUT (AC)	
@ 240 VAC <sup>1</sup>	
Rated (continuous) output power	3.84 kVA
Peak output power	5.7 kVA (10 seconds)
Nominal voltage / range	240 / 211 – 264 VAC
Nominal frequency / range	60 / 57 – 61 Hz
Rated output current	16 A
Peak output current	24.6A (10 seconds)
Power factor (adjustable)	0.85 leading ... 0.85 lagging
Maximum units per 20 A branch circuit	1 unit (single phase)
Interconnection	Single-phase
Maximum AC short circuit fault current over 3 cycles	69.6 Arms
Round trip efficiency <sup>2</sup>	89%
BATTERY	
Total capacity	10.5 kWh
Usable capacity	10.08 kWh
Round trip efficiency	96%
Nominal DC voltage	67.2 V
Maximum DC voltage	73.5 V
Ambient operating temperature range	-15° C to 55° C (5° F to 131° F) non-condensing
Optimum operating temperature range	0° C to 30° C (32° F to 86° F)
Chemistry	Lithium iron phosphate (LFP)
MECHANICAL DATA	
Dimensions (WxHxD)	1070 mm x 664 mm x 319 mm (42.13 in x 26.14 in x 12.56 in)
Weight	Three individual 44.2 kg (97.4 lbs) base units plus 21.1 kg (48.7 lbs) cover and mounting bracket; total 154.7 kg (341 lbs)
Enclosure	Outdoor – NEMA type 3R
IQ 8X-BAT microinverter enclosure	NEMA type 6
Cooling	Natural convection – No fans
Altitude	Up to 2500 meters (8200 feet)
Mounting	Wall mount
FEATURES AND COMPLIANCE	
Compatibility	Compatible with grid-tied PV systems. Compatible with Enphase M215/M250 and IQ Series Micros, Enphase Enpower, and Enphase IQ Envoy for backup operation.
Communication	Wireless 2.4 GHz
Services	Backup, self-consumption, TOU, Demand Charge, NEM Integrity
Monitoring	Enlighten Manager and MyEnlighten monitoring options; API integration
Compliance	UL 9540, UN 38.3, UL 9540A, UL 1998, UL 991, NEMA Type 3R, AC156 EMI: 47 CFR, Part 15, Class B, ICES 003 Cell Module: UL 1973, UN 38.3 Inverters: UL 62109-1, IEC 62109-2, UL 1741SA, CAN/CSA C22.2 No. 107.1-16, and IEEE 1547
LIMITED WARRANTY	
Limited Warranty <sup>3</sup>	>70% capacity, up to 10 years or 4000 cycles

1. Supported in backup/off grid operations  
2. AC to Battery to AC at 50% power rating.  
3. Whichever occurs first. Restrictions apply.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2021 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Encharge 10, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Date subject to change. 2021-03-01



CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER

**POWER**  
PRODUCTION MANAGEMENT, INC.

Digitally signed by:  
Ermocrates E Castillo  
Date: 2022.08.30 15:22:54

### PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET

### SHEET SIZE


ANSI B  
11" X 17"

### SHEET NUMBER

DS-05

# Ultra Rail

**UR-40**  
**UR-60**

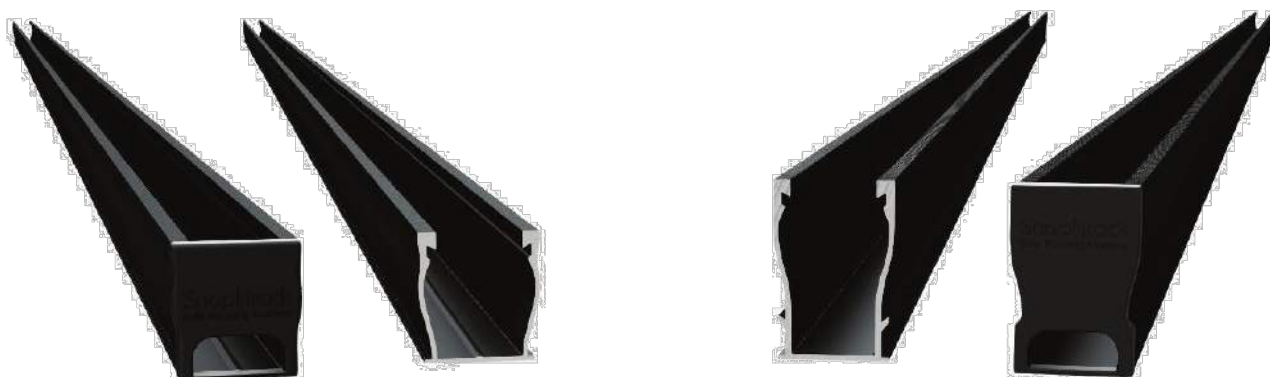

## The Ultimate Value in Rooftop Solar



Industry leading Wire Management Solutions



Single Tool Installation



Mounts available for all roof types



All SnapNrack Module Clamps & Accessories are compatible with both rail profiles

**Start Installing Ultra Rail Today**

**RESOURCES**  
**DESIGN**  
**WHERE TO BUY**


[snapnrack.com/resources](https://snapnrack.com/resources)  
[snapnrack.com/configurator](https://snapnrack.com/configurator)  
[snapnrack.com/where-to-buy](https://snapnrack.com/where-to-buy)

## SnapNrack Ultra Rail System

A sleek, straightforward rail solution for mounting solar modules on all roof types. Ultra Rail features two rail profiles; UR-40 is a lightweight rail profile that is suitable for most geographic regions and maintains all the great features of SnapNrack rail, while UR-60 is a heavier duty rail profile that provides a larger rail channel and increased span capabilities. Both are compatible with all existing mounts, module clamps, and accessories for ease of install.

### The Entire System is a Snap to Install

- New Ultra Rail Mounts include snap-in brackets for attaching rail
- Compatible with all the SnapNrack Mid Clamps and End Clamps customers love
- Universal End Clamps and snap-in End Caps provide a clean look to the array edge

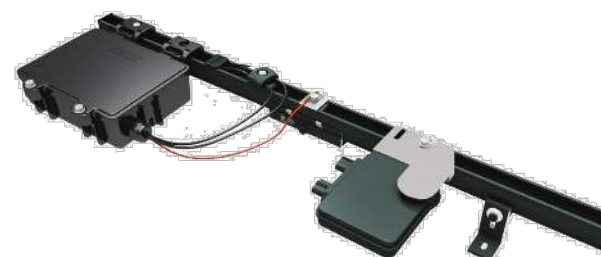

### Unparalleled Wire Management

- Open rail channel provides room for running wires resulting in a long-lasting quality install
- Industry best wire management offering includes Junction Boxes, Universal Wire Clamps, MLPE Attachment Kits, and Conduit Clamps
- System is fully bonded and listed to UL 2703 Standard

### Heavy Duty UR-60 Rail

- UR-60 rail profile provides increased span capabilities for high wind speeds and snow loads
- Taller, stronger rail profile includes profile-specific rail splice and end cap
- All existing mounts, module clamps, and accessories are retained for the same great install experience



## Quality. Innovative. Superior.

SnapNrack Solar Mounting Solutions are engineered to optimize material use and labor resources and improve overall installation quality and safety.

877-732-2860

[www.snapnrack.com](https://www.snapnrack.com)

[contact@snapnrack.com](mailto:contact@snapnrack.com)

© 2019 by SnapNrack Solar Mounting Solutions. All rights reserved

**CASTILLO ENGINEERING SERVICES, LLC**  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER

**POWER**  
PRODUCTION MANAGEMENT, INC.

Digitally signed by:  
Ermocrates E Castillo  
Date: 2022.08.30 15:22:54

### PROJECT NAME

**JENKINS RESIDENCE**

5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

DS-06



# Grounding Specifications


snapnrack.com

## An Intro to SnapNrack Ultra Rail

snapnrack.com

### System Bonding Methods


- 1 SnapNrack Ultra Rail Mid Clamp
- 2 SnapNrack Ultra Rail End Clamp
- 3 SnapNrack Mid Clamp
- 4 SnapNrack Adjustable End Clamp
- 5 SnapNrack UR-40 Rail Splice
- 6 SnapNrack UR-60 Rail Splice

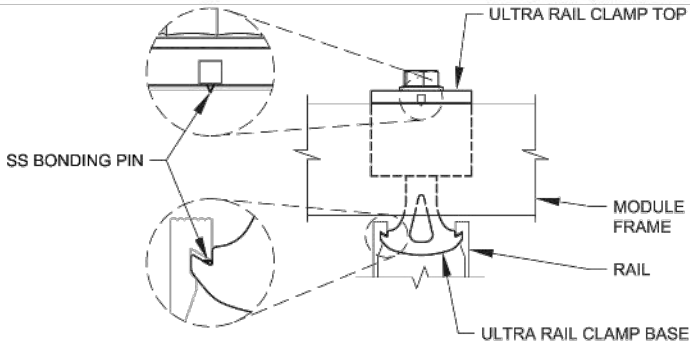

SnapNrack Ultra Rail Solar Mounting System offers a low profile, visually appealing, photovoltaic (PV) module installation system. This innovative system simplifies the process of installing solar PV modules, shortens installation times, and lowers installation costs..

SnapNrack systems, when installed in accordance with this manual, will be structurally adequate for the specific installation site and will meet the local and International Building Code. Systems will also be bonded to ground, under SnapNrack's UL 2703 Listing.


The SnapNrack installation system is a set of engineered components that can be assembled into a wide variety of solar mounting structures. It is designed to be installed by qualified solar installation technicians. With SnapNrack you will be able to solve virtually any PV module mounting challenge.

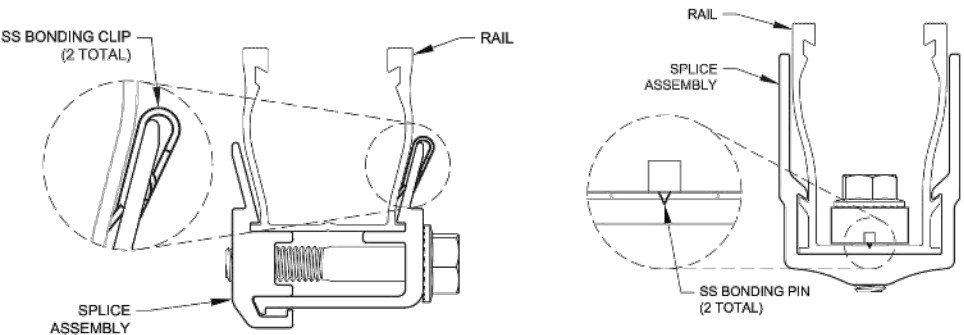

**Note:**  
SnapNrack module clamps contain a SnapNrack Channel Nut with integral bonding clips or pins in assembly to properly bond the system (except Universal End Clamps).

**Note:**  
SnapNrack Ultra Rail Splices contain integral bonding clips in assembly to properly bond the system.

### SnapNrack Ground Lug Assembly

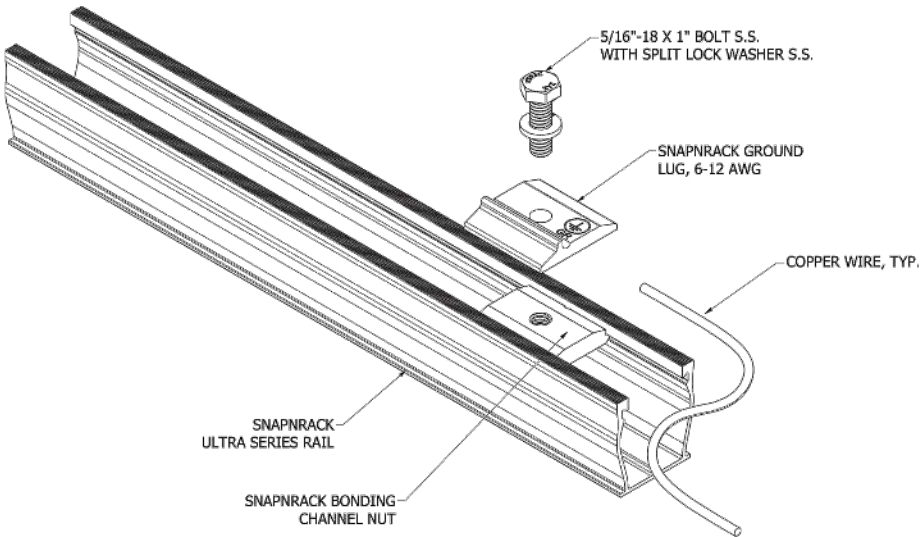

### Benefits of Installing the SnapNrack Ultra Rail System

- Install With Existing Roof Attachments**  
Compatible with existing SnapNrack roof attachments
- Install With Very Few Tools**  
All Ultra Rail hardware is attached using a standard 1/2" socket
- Built in Wire Management and Aesthetics**  
Extensive wire management solutions have been designed specifically for the system that adapts to multiple possible mounting positions.
- The system is designed to be aesthetically pleasing on its own, so it does not require an aesthetic skirt. SnapNrack does offer an optional skirt for those looking for a high end look to the system.

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

**POWER**  
PRODUCTION MANAGEMENT, INC.

Digitally signed by:  
Ermocrates E Castillo  
Date: 2022.08.30 15:22:55

PROJECT NAME

**JENKINS RESIDENCE**

5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-07



## SnapNrack SpeedSeal™ Foot

Patent Pending Lag Driven Sealant Solution for Ultra Rail



### A New Generation of Roof Attachments

- Innovative design incorporates flashing reliability into a single roof attachment
- 100% waterproof solution
- Sealing cavity with compressible barrier secures sealant in place & fills voids

### Maintain the Integrity of the Roof by Eliminating Disruption


- Zero prying of shingles
- Zero removal of nails leaving holes in the roof
- Roof remains installed the way manufacturer meant it to be

### Lag Driven Sealant Waterproofing

- Time Tested Roof Sealant provides lasting seal
- Sealant is compressed into cavity and lag hole as attachment is secured to rafter
- Active sealant solidifies bond if ever touched by liquid
- Technology passes UL 2582 Wind Driven Rain Test and ASTM E2140 Water Column Testing standards. Patent Pending.

### Single Tool Installation

- SnapNrack was the first in the industry to develop a complete system that only requires a single tool. That tradition is continued as a ½" socket is still the only tool necessary to secure the mount as well as all other parts of the system.

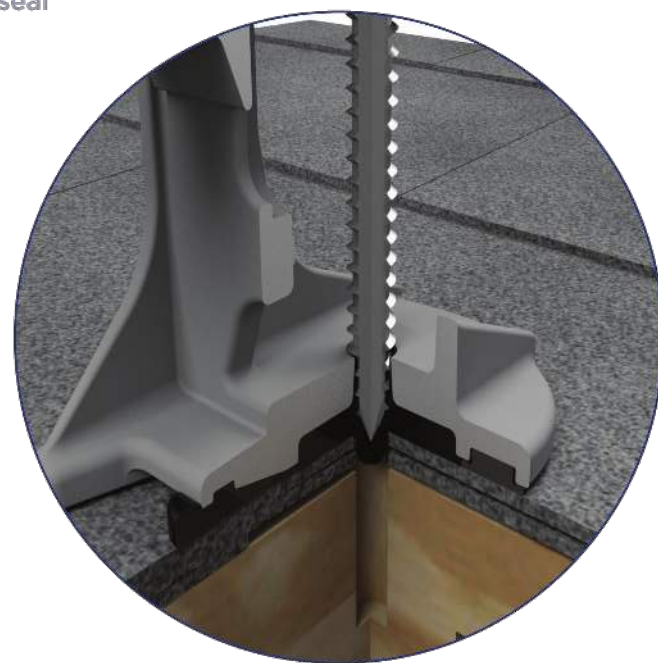

Note: Sealant shown in white for illustration purposes only.

## SnapNrack SpeedSeal™ Foot

Fastest Roof Attachment in Solar

- Lag straight to a structural member, no in-between components such as flashings or bases.
- Simply locate rafter, fill sealant cavity & secure to roof. *It's that simple!*

### Integrated Flashings. No Questions.

- Sealant fills around lag screw keeping roof and structure sealed and intact
- No added holes from ripping up nails, staples and screws holding shingles on roof

### Less Time. Less Parts. Less Tools.

- No more need for a pry bar to rip up shingles
- No more proprietary lag screws
- Single Tool installation with ½" socket

### Total System Solution One Tool. One Warranty.

- SnapNrack Ultra Rail is a straightforward intuitive install experience on the roof without compromising quality, aesthetics & safety, all supported by a 25 year warranty.
- Built-in Wire Management & Aesthetically pleasing features designed for Ultra Rail result in a long-lasting quality install that installers and homeowners love.

### Certifications

SnapNrack Ultra Rail System has been evaluated by Underwriters Laboratories (UL) and Listed to UL/ANSI Standard 2703 for Mechanical Loading and Fire. Additionally it is listed to UL 2582 for wind-driven rain and ASTM 2140.



877-732-2860

www.snapnrack.com

contact@snapnrack.com

© 2020 by SnapNrack Solar Mounting Solutions. All rights reserved

REVISIONS		
DESCRIPTION	DATE	REV

### PROJECT INSTALLER



Digitally  
signed by:  
Ermocrates E Castillo  
Date:  
2022.08.30  
15:22:55

### PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

### SHEET NAME

DATA SHEET


### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

DS-08


DESCRIPTION:	DRAWN BY:	<div>SnapNrack™ Solar Mounting Solutions</div> <div>595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA PHONE (415) 590-6900 • FAX (415) 590-6902</div> <div>THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.</div>
SNAPNRACK, ULTRA RAIL SPEEDSEAL™ FOOT	mwatkins	
PART NUMBER(S):	REVISION:	
242-02163, 242-02167	A	

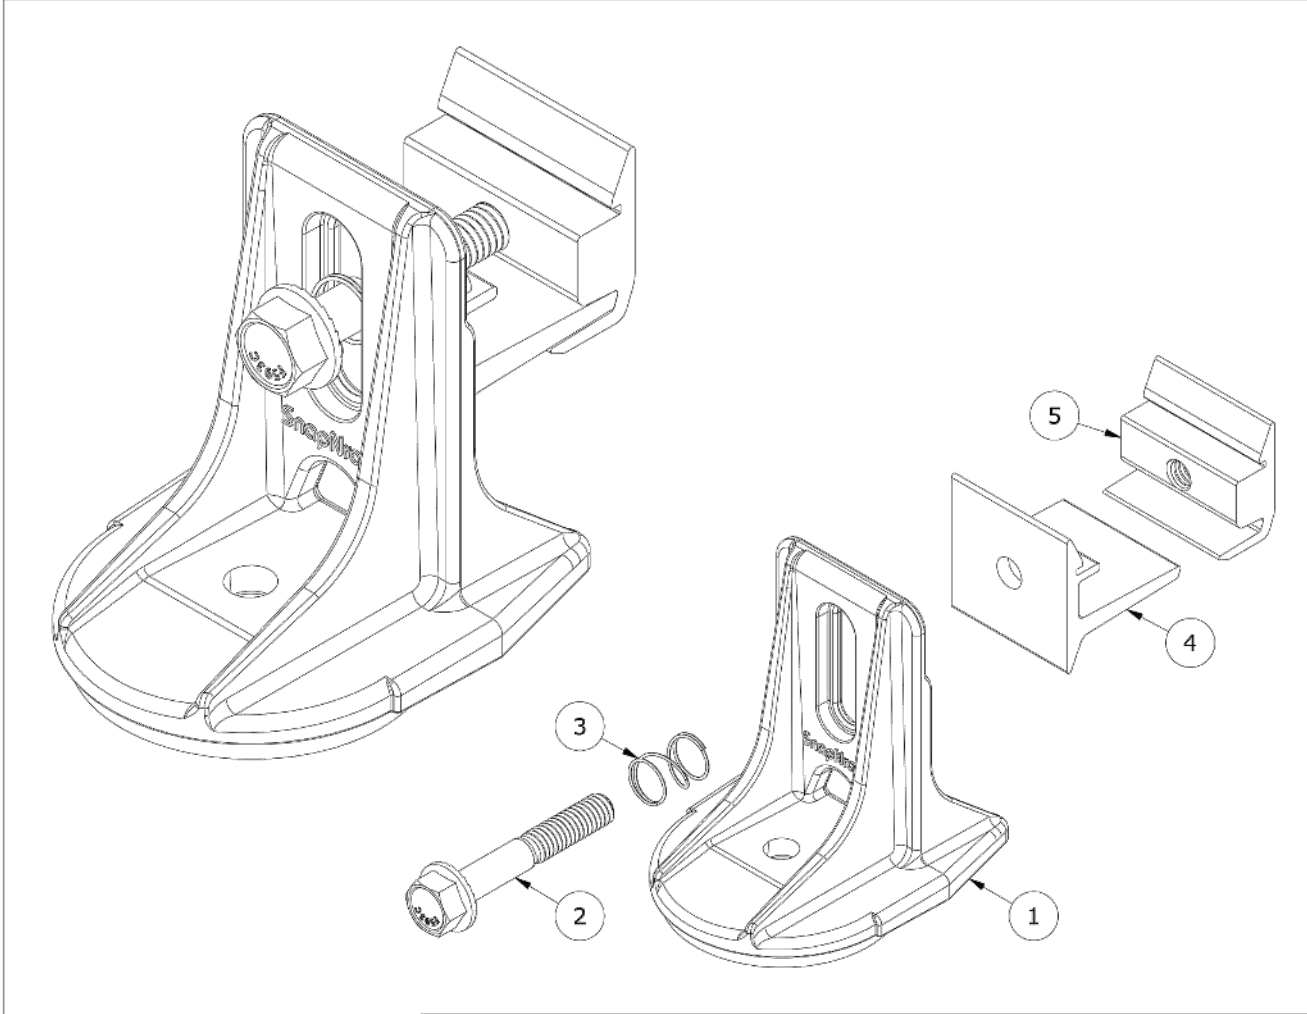

PARTS LIST		
ITEM	QTY	DESCRIPTION
1	1	SNAPNRACK, SPEEDSEAL FOOT, BASE, SEALING, SILVER / BLACK
2	1	BOLT, FLANGE, SERRATED, 5/16IN-18 X 2IN, SS
3	1	SNAPNRACK, RL UNIVERSAL, MOUNT SPRING, SS
4	1	SNAPNRACK, ULTRA RAIL MOUNT THRU PRC, CLEAR / BLACK
5	1	SNAPNRACK, ULTRA RAIL MOUNT TAPPED PRC, CLEAR / BLACK

MATERIALS:	DIE CAST A380 ALUMINUM, 6000 SERIES ALUMINUM, STAINLESS STEEL	
DESIGN LOAD (LBS):	802 UP, 1333 DOWN, 357 SIDE	OPTIONS:
ULTIMATE LOAD (LBS):	2118 UP, 4006 DOWN, 1331 SIDE	CLEAR / BLACK
TORQUE SPECIFICATION:	12 LB-FT	
CERTIFICATION:	UL 2703, FILE E359313; WIND-DRIVEN RAIN TEST FROM SUBJECT UL 2582	
WEIGHT (LBS):	0.45	

DESCRIPTION:	DRAWN BY:	<div>SnapNrack™ Solar Mounting Solutions</div> <div>595 MARKET STREET, 29TH FLOOR • SAN FRANCISCO, CA 94105 USA PHONE (415) 590-6900 • FAX (415) 590-6902</div> <div>THE INFORMATION IN THIS DRAWING IS CONFIDENTIAL AND PROPRIETARY. ANY REPRODUCTION, DISCLOSURE, OR USE THEREOF IS PROHIBITED WITHOUT THE WRITTEN CONSENT OF SUNRUN SOUTH LLC.</div>
SNAPNRACK, ULTRA RAIL SPEEDSEAL™ FOOT	mwatkins	
PART NUMBER(S):	REVISION:	
242-02163, 242-02167	A	

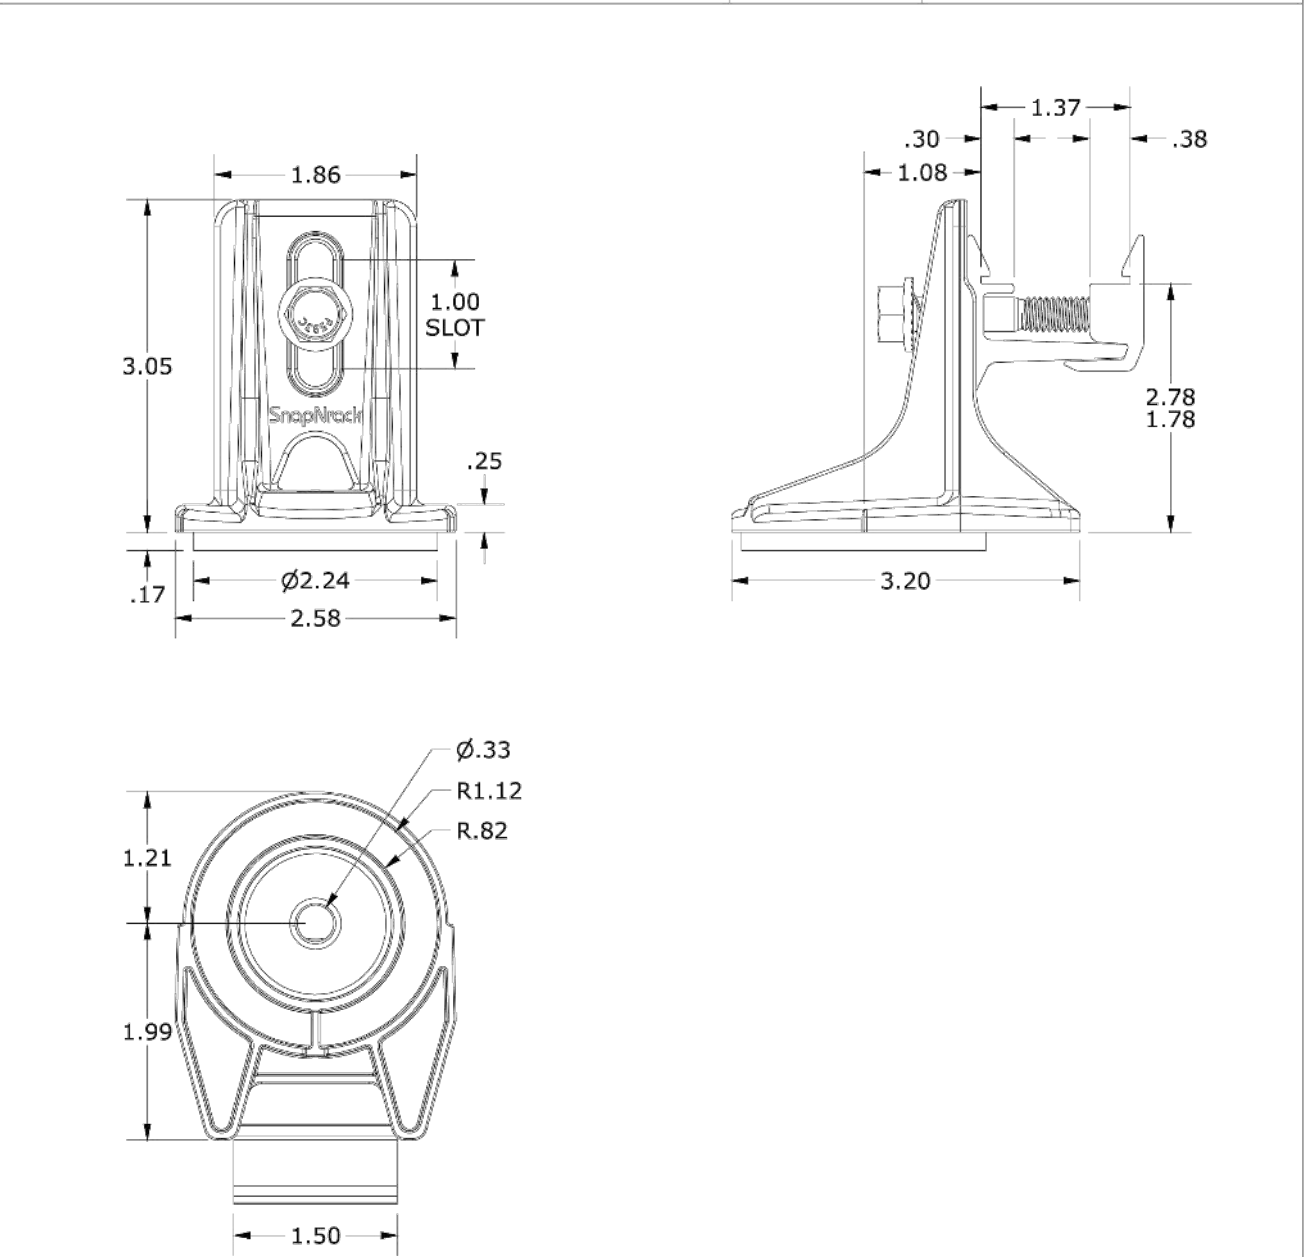

ALL DIMENSIONS IN INCHES

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

PROJECT NAME

JENKINS RESIDENCE  
5310 SE COUNTRY CLUB RD,  
LAKE CITY, FL 32025

SHEET NAME
DATA SHEET

SHEET SIZE
ANSI B 11" X 17"

SHEET NUMBER
DS-09