



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

73

RE: 2797533 - SIMQUE HOMES - LOT 56 PLL

MiTek USA, Inc.
6904 Parke East Blvd.
Tampa, FL 33610-4115

Site Information:

Customer Info: Aaron Simque Homes Project Name: Spec Hse Model: Ivy
Lot/Block: 56 Subdivision: The Preserve at Laurel Lake
Address: TBD, TBD
City: Columbia Cty State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.


Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2020/TPI2014 Design Program: MiTek 20/20 8.4
Wind Code: ASCE 7-16 Wind Speed: 130 mph
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 39 individual, Truss Design Drawings and 0 Additional Drawings.
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T23987452	CJ1	5/18/21	23	T23987474	T04	5/18/21
2	T23987453	CJ3	5/18/21	24	T23987475	T05	5/18/21
3	T23987454	CJ3A	5/18/21	25	T23987476	T06	5/18/21
4	T23987455	CJ3B	5/18/21	26	T23987477	T07	5/18/21
5	T23987456	CJ5	5/18/21	27	T23987478	T08	5/18/21
6	T23987457	CJ5A	5/18/21	28	T23987479	T09	5/18/21
7	T23987458	EJ5	5/18/21	29	T23987480	T10	5/18/21
8	T23987459	EJ5B	5/18/21	30	T23987481	T11	5/18/21
9	T23987460	EJ6	5/18/21	31	T23987482	T12	5/18/21
10	T23987461	EJ7	5/18/21	32	T23987483	T13	5/18/21
11	T23987462	HJ7	5/18/21	33	T23987484	T14	5/18/21
12	T23987463	HJ10	5/18/21	34	T23987485	T15	5/18/21
13	T23987464	PB1	5/18/21	35	T23987486	T16	5/18/21
14	T23987465	PB2	5/18/21	36	T23987487	T17	5/18/21
15	T23987466	PB3	5/18/21	37	T23987488	T18	5/18/21
16	T23987467	PB4	5/18/21	38	T23987489	T19	5/18/21
17	T23987468	PB5	5/18/21	39	T23987490	T20	5/18/21
18	T23987469	T01	5/18/21				
19	T23987470	T01G	5/18/21				
20	T23987471	T02	5/18/21				
21	T23987472	T02G	5/18/21				
22	T23987473	T03	5/18/21				

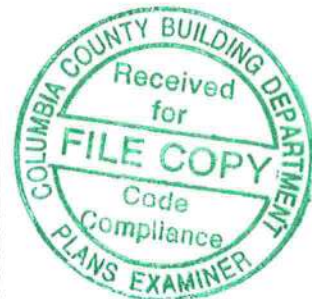

The truss drawing(s) referenced above have been prepared by MiTek USA, Inc.
under my direct supervision based on the parameters
provided by Builders FirstSource-Jacksonville.

Truss Design Engineer's Name: Velez, Joaquin
My license renewal date for the state of Florida is February 28, 2023.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

Velez, Joaquin

1 of 1


Job 2797533	Truss CJ1	Truss Type Jack-Open	Qty 6	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987452
----------------	--------------	-------------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:41 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-Pzl2bnRHLw5tXuq6Z0xGHAdUprF7lvYguDKCKXzGJ30

Job Reference (optional)

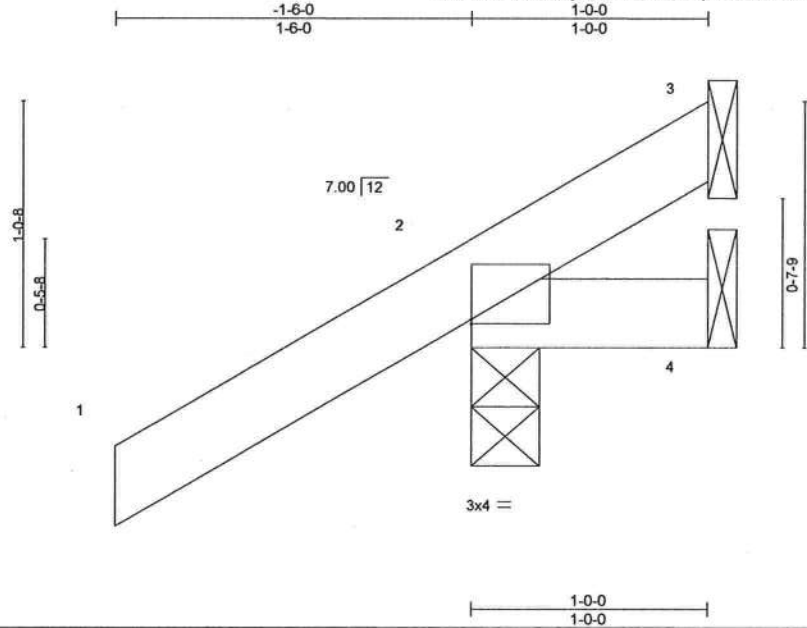

Scale = 1:9.4

Plate Offsets (X,Y)--		[2:0-0-0,0-0-4]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d
TCLL 20.0		Plate Grip DOL	1.25	TC 0.23		Vert(LL)	0.00 7	>999	240
TCDL 7.0		Lumber DOL	1.25	BC 0.06		Vert(CT)	0.00 7	>999	180
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.00		Horz(CT)	0.00 2	n/a	n/a
BCDL 10.0		Code	FBC2020/TPI2014	Matrix-MP					
						PLATES	GRIP		
						MT20	244/190		
						Weight: 6 lb	FT = 20%		

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=64(LC 12)
Max Uplift 3=-5(LC 1), 2=-103(LC 12), 4=-25(LC 19)
Max Grav 3=7(LC 16), 2=179(LC 1), 4=26(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5 lb uplift at joint 3, 103 lb uplift at joint 2 and 25 lb uplift at joint 4.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek

6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss CJ3	Truss Type Jack-Open	Qty 3	Ply 1	SIMQUE HOMES - LOT 56 PLL Job Reference (optional)	T23987453
----------------	--------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:42 2021 Page 1

ID:cExzFHCxHzHNjPCInbH0FZzN74p-tAJQo7Sv3EDk81PI6kSVqOAxfZ91Mq7l4lszzGJ3N



Scale = 1:15.3

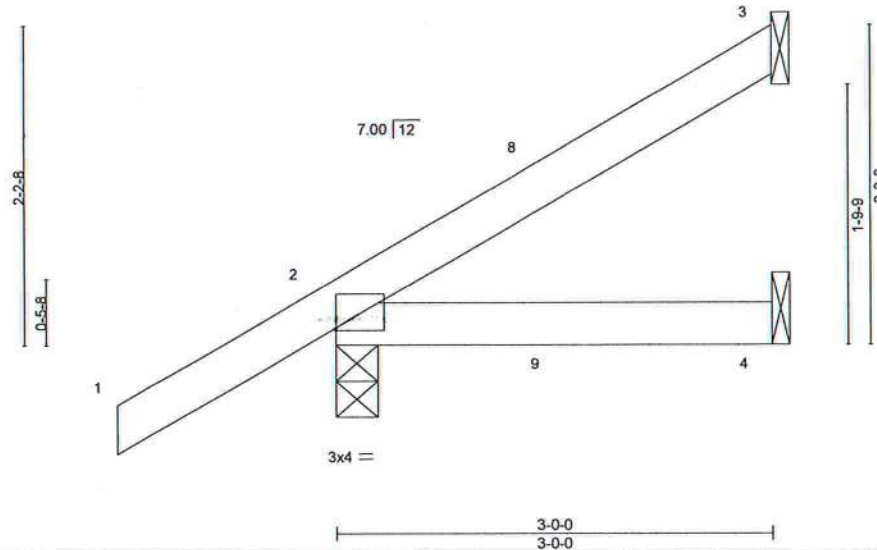


Plate Offsets (X,Y)-- [2:0-0-0,0-0-4]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.20	Vert(LL)	0.01	4-7	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.13	Vert(CT)	-0.01	4-7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						Weight: 12 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=120(LC 12)
Max Uplift 3=63(LC 12), 2=88(LC 12), 4=26(LC 9)
Max Grav 3=67(LC 19), 2=210(LC 1), 4=51(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 2-11-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 63 lb uplift at joint 3, 88 lb uplift at joint 2 and 26 lb uplift at joint 4.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610


Job 2797533	Truss CJ3A	Truss Type Jack-Open	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL Job Reference (optional)	T23987454
----------------	---------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Jacksonville, FL),

Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:42 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-tAJQo7Sv3EDk81PI6kSVqOAggFZW1Moq7t4lszzGJ3N

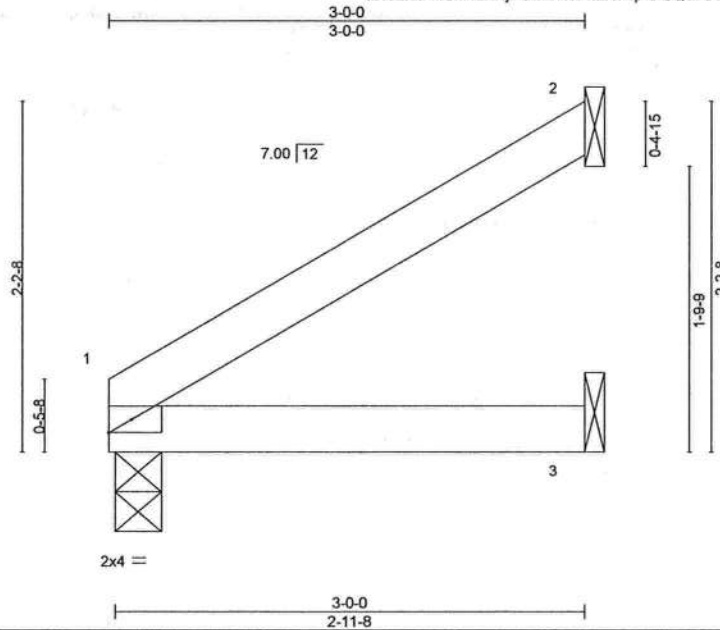

Scale = 1:14.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.16	Vert(LL)	0.02	3-6	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.18	Vert(CT)	-0.01	3-6	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	2	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 10 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD

Structural wood sheathing directly applied or 3-0-0 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 2=Mechanical, 3=Mechanical

Max Horz 1=83(LC 12)

Max Uplift 1=-37(LC 9), 2=-70(LC 12), 3=-30(LC 9)

Max Grav 1=109(LC 1), 2=76(LC 19), 3=54(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCp=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 1, 70 lb uplift at joint 2 and 30 lb uplift at joint 3.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss CJ3B	Truss Type Jack-Open	Qty 2	Ply 1	SIMQUE HOMES - LOT 56 PLL Job Reference (optional)	T23987455
----------------	---------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:43 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-MMtp0TTXqXLbmB_UgRzkNbighfulmp2zLXpJPQzGJ3M

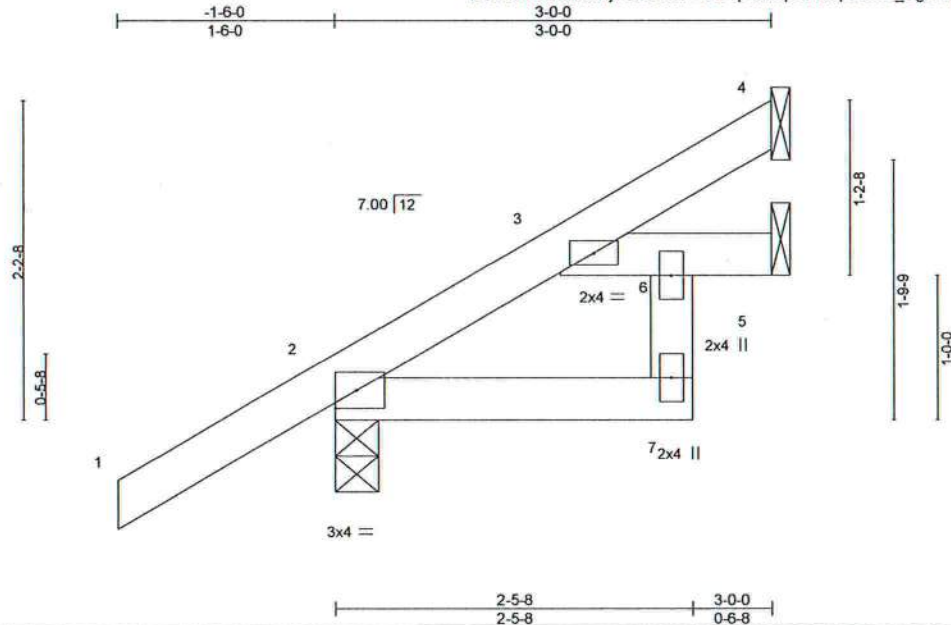

Scale = 1:15.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.20	Vert(LL)	-0.00	11	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.17	Vert(CT)	-0.00	11	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MR						Weight: 15 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
6-7: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical
Max Horz 2=120(LC 12)
Max Uplift 4=31(LC 12), 2=87(LC 12), 5=28(LC 12)
Max Grav 4=43(LC 19), 2=216(LC 1), 5=72(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-8, Interior(1) 1-6-8 to 2-11-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 4, 87 lb uplift at joint 2 and 28 lb uplift at joint 5.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:44 2021 Page 1
ID:cExzFHCxHzHNjPCINbH0FZzN74p-qYRBDpTAbT SOLZgE9UzvpFy629gVG16aBZsxsxGJ3L




BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.


- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDF=4.2psf, BCDF=3.0psf, h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 4-11-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 114 lb uplift at joint 3, 99 lb uplift at joint 2 and 47 lb uplift at joint 4.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TP1 1 as referenced by the building code.



Design valid for use only with MiTeC® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2797533	Truss CJ5A	Truss Type Jack-Open	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987457
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:45 2021 Page 1					
Job Reference (optional) ID:cExzFHCxHzHNjPCINbH0FZzN74p-II_ZR9UoM9bJ0V8tos?CS0o7SSVREjXGprlQTlzGJ3K					

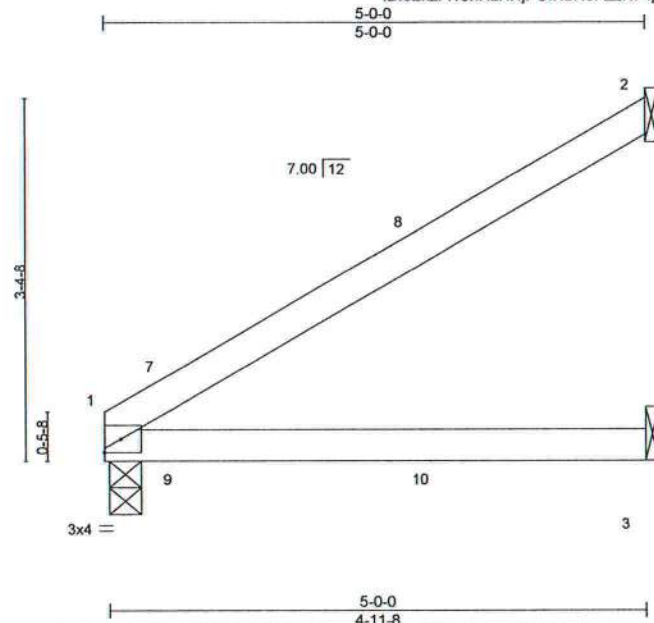

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.44	Vert(LL)	0.11	3-6	>530	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.48	Vert(CT)	0.10	3-6	>598	180	
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	2	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
									Weight: 16 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 2=Mechanical, 3=Mechanical
Max Horz 1=140(LC 12)
Max Uplift 1=64(LC 9), 2=119(LC 12), 3=49(LC 9)
Max Grav 1=183(LC 1), 2=130(LC 19), 3=91(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 4-11-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 1, 119 lb uplift at joint 2 and 49 lb uplift at joint 3.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss EJ5	Truss Type JACK-OPEN	Qty 4	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987458
----------------	--------------	-------------------------	----------	----------	---------------------------	-----------


Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:45 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-II_ZR9UoM9bJ0V8tos?CS0o95SZ1EjAGprlQTIzGJ3K



Scale = 1:20.4

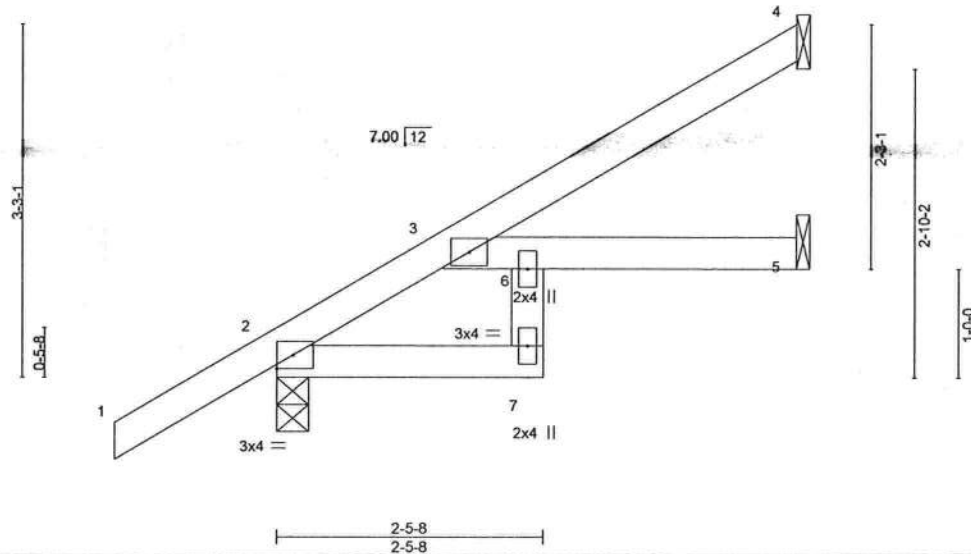

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.27	Vert(LL)	0.04	7	>999	240	MT20
TCDL 7.0	Lumber DOL	1.25	BC 0.25	Vert(CT)	-0.06	7	>999	180	244/190
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.03	5	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP						
								Weight: 21 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-9-8 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 2=0-3-8, 5=Mechanical
Max Horz 2=171(LC 12)
Max Uplift 4=86(LC 12), 2=95(LC 12), 5=26(LC 12)
Max Grav 4=111(LC 19), 2=278(LC 1), 5=86(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-8, Interior(1) 1-6-8 to 4-8-12 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 86 lb uplift at joint 4, 95 lb uplift at joint 2 and 26 lb uplift at joint 5.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek

6904 Parke East Blvd.
Tampa, FL 36610

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244, 8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:46 2021 Page 1
ID:cExzFHCxHzHNjPCINbH0FZzN74p-mxYxeVVQ7SjAdfj3LZWR EKKZsvjzAnP1V2z0kzGJ3J



LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 4-9-8 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=171(LC 12)
Max Uplift 3=109(LC 12), 2=98(LC 12), 4=5(LC 12)
Max Grav 3=124(LC 19), 2=269(LC 1), 4=85(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCdL=4.2psf; BCdL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 4-8-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 109 lb uplift at joint 3, 98 lb uplift at joint 2 and 5 lb uplift at joint 4.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TP1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18, 2021



WARNING: Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MIL-7473 rev. 5/19/2020 BEFORE USE

Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss EJ6	Truss Type Monopitch	Qty 5	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987460
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:47 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-E76JrrW2umr1FplFvH1gXRIW5GEEiajZG9nWYBzGJ3I

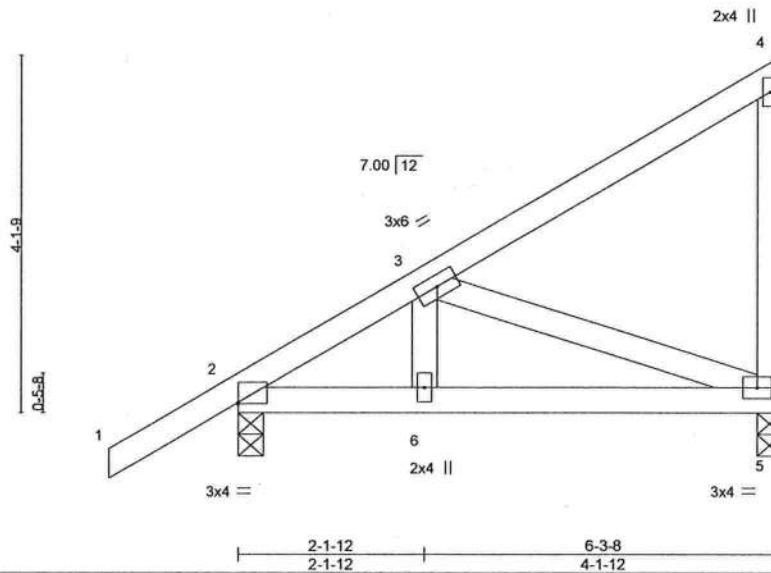

Scale = 1:25.6

Plate Offsets (X,Y)-- [2-0-0-0,0-0-4]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.24	Vert(LL)	0.04	5-6	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.27	Vert(CT)	0.04	5-6	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.21	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MP							
									Weight: 36 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-7-9 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=0-3-8
Max Horz 2=211(LC 12)
Max Uplift 2=108(LC 12), 5=152(LC 12)
Max Grav 2=318(LC 1), 5=218(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=309/527
BOT CHORD 2-6=675/254, 5-6=675/254
WEBS 3-6=310/147, 3-5=269/715

NOTES- (6)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 6-1-12 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 108 lb uplift at joint 2 and 152 lb uplift at joint 5.
- 6) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610


Job	Truss	Truss Type	Qty	Ply	SIMQUE HOMES - LOT 56 PLL	T23987461
2797533	EJ7	Jack-Open	9	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL).

Jacksonville, FL - 32244.

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:48 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-iKgi3BWgf4zttytST_Zv4fQXfgZqR4HiVpX44dzGJ3H

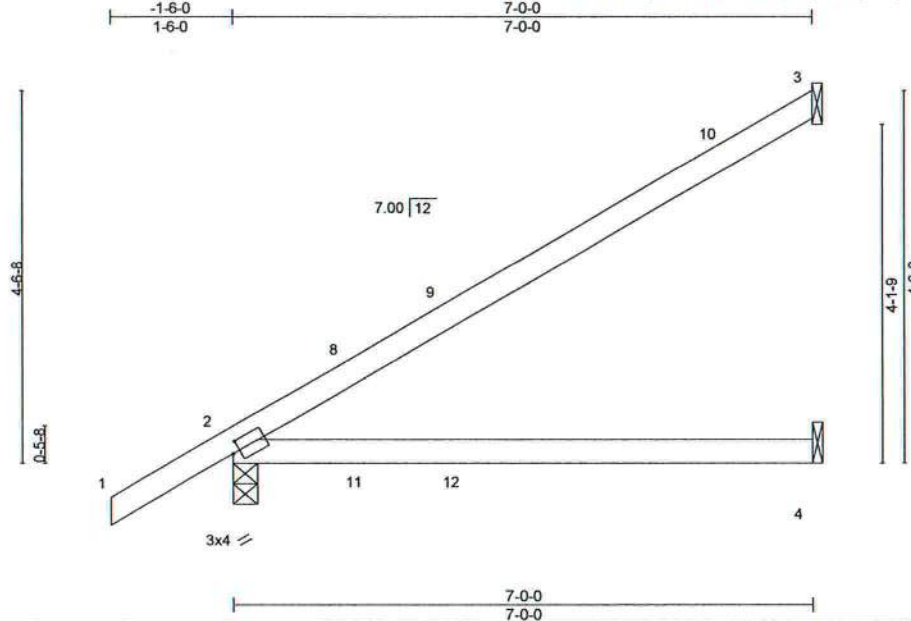

Scale = 1:26.9

Plate Offsets (X,Y)-- [2-0-1-1,0-1-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.83	Vert(LL)	0.31	4-7	>268	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.37	Vert(CT)	0.27	4-7	>305	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.02	3	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 25 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP M 31

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=225(LC 12)
Max Uplift 3=144(LC 12), 2=118(LC 12), 4=70(LC 9)
Max Grav 3=176(LC 19), 2=346(LC 1), 4=131(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (7)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 6-11-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 144 lb uplift at joint 3, 118 lb uplift at joint 2 and 70 lb uplift at joint 4.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek

6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss HJ7	Truss Type DIAGONAL HIP GIRDER	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987462
----------------	--------------	-----------------------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:50 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-eioSUsYwBhEb6G1qaPbN94VxaT7iv_n?y70B9WzGJ3F

Job Reference (optional)

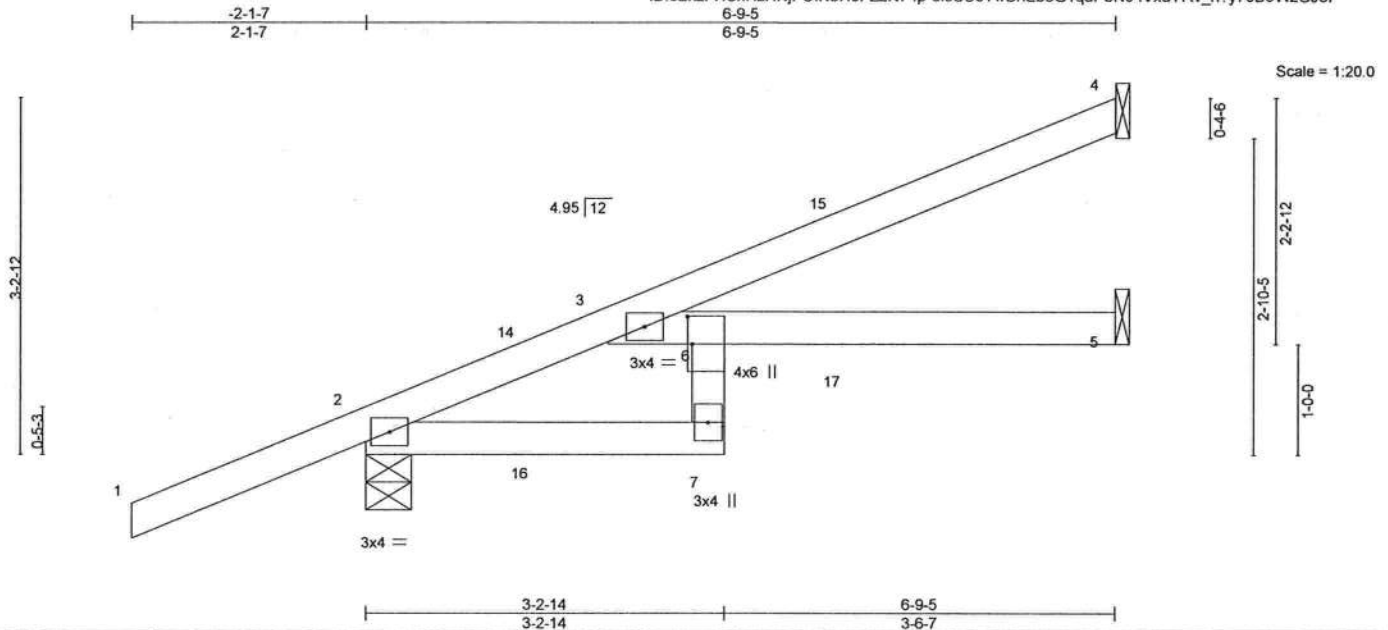


Plate Offsets (X,Y)-- [6:0-3-0,0-0-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.54	Vert(LL)	0.17	5-6	>473	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.78	Vert(CT)	-0.19	5-6	>418	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.00	Horz(CT)	0.06	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MR							
									Weight: 27 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
6-7: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-4-15, 5=Mechanical
Max Horz 2=171(LC 8)
Max Uplift 4=123(LC 8), 2=252(LC 8), 5=72(LC 8)
Max Grav 4=149(LC 1), 2=414(LC 1), 5=139(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-9=427/164
BOT CHORD 2-7=230/287, 3-6=287/230

NOTES- (9)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 4, 252 lb uplift at joint 2 and 72 lb uplift at joint 5.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 86 lb down and 28 lb up at 4-3-11, 86 lb down and 28 lb up at 4-3-11, and 72 lb down and 76 lb up at 1-5-12, and 72 lb down and 76 lb up at 1-5-12 on top chord, and 25 lb down and 54 lb up at 1-5-12, 25 lb down and 54 lb up at 1-5-12, and 59 lb down and 42 lb up at 4-3-11, and 59 lb down and 42 lb up at 4-3-11 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- 9) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 7-8=-20, 6-11=-20, 5-6=-20
Concentrated Loads (lb)
Vert: 17=-62(F=-31, B=-31)



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss HJ10	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987463
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:49 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-AWE4GWXIQN5KU6Se1i48csyk?3qkARbrkTGdc3zGJ3G

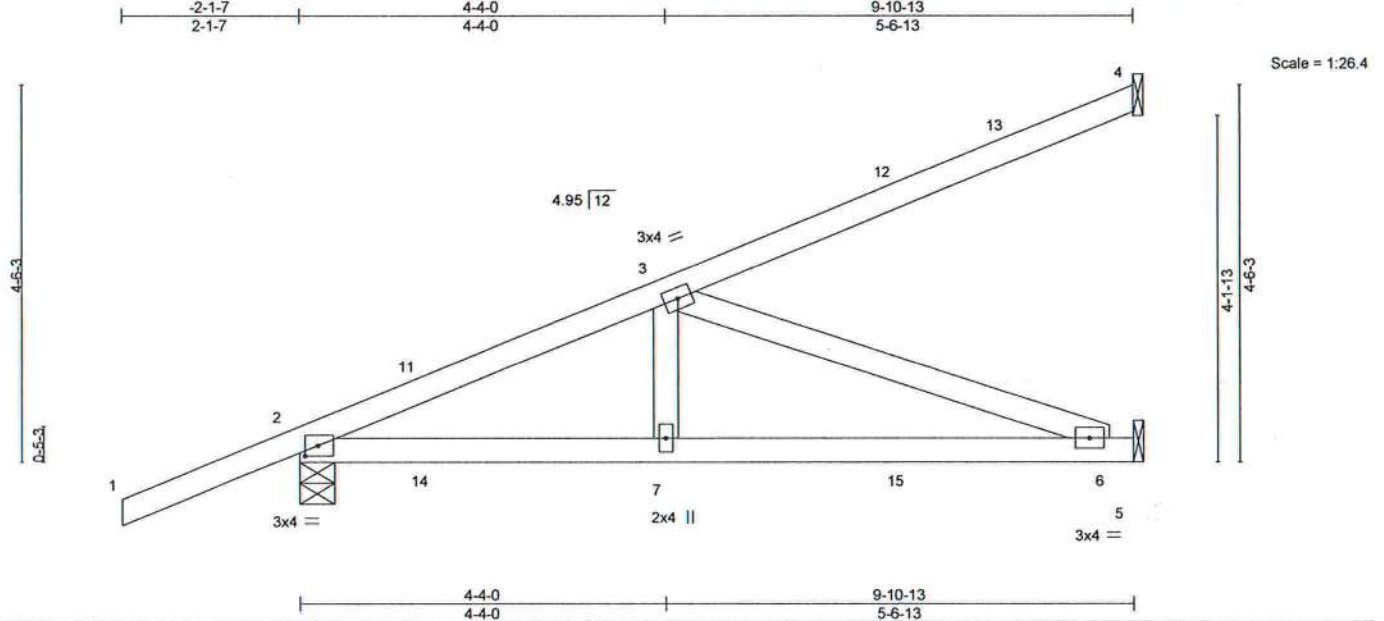


Plate Offsets (X,Y)-- [2:0-1-13,0-1-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.66	Vert(LL) 0.13	6-7	>932	240		MT20	244/190
TCDL 7.0	Lumber DOL 1.25		BC 0.65	Vert(CT) -0.13	6-7	>876	180			
BCLL 0.0 *	Rep Stress Incr NO		WB 0.44	Horz(CT) -0.01	5	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS							
									Weight: 45 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-8-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-4-15, 5=Mechanical
Max Horz 2=226(LC 8)
Max Uplift 4=140(LC 8), 2=425(LC 4), 5=284(LC 5)
Max Grav 4=158(LC 1), 2=538(LC 1), 5=304(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=745/584
BOT CHORD 2-7=656/660, 6-7=656/660
WEBS 3-7=145/286, 3-6=702/698

NOTES- (9)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 140 lb uplift at joint 4, 425 lb uplift at joint 2 and 284 lb uplift at joint 5.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 103 lb down and 71 lb up at 4-3-11, 103 lb down and 62 lb up at 4-3-11, 134 lb down and 128 lb up at 7-1-10, 135 lb down and 122 lb up at 7-1-10, and 72 lb down and 76 lb up at 1-5-12, and 72 lb down and 76 lb up at 1-5-12 on top chord, and 58 lb down and 54 lb up at 1-5-12, 58 lb down and 54 lb up at 1-5-12, 23 lb down and 39 lb up at 4-3-11, 20 lb down and 34 lb up at 4-3-11, and 44 lb down and 65 lb up at 7-1-10, and 42 lb down and 62 lb up at 7-1-10 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- 9) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=54, 5-8=20

Continued on page 2



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek

6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss HJ10	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987463 Job Reference (optional)
----------------	---------------	-----------------------------------	----------	----------	--

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:49 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-AWE4GWXIQN5kU6Se1i48csyk?3qkARbrkTGdc3zGJ3G

LOAD CASE(S) Standard

Concentrated Loads (lb)

Vert: 3=-2(B) 7=-12(F=-2, B=-10) 12=-80(F=-37, B=-43) 15=-64(F=-28, B=-35)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss PB1	Truss Type Piggyback	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987464
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:51 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-7uMqHCZZy?MSkQb1876ch19qtdneRE8BnkhyzGJ3E

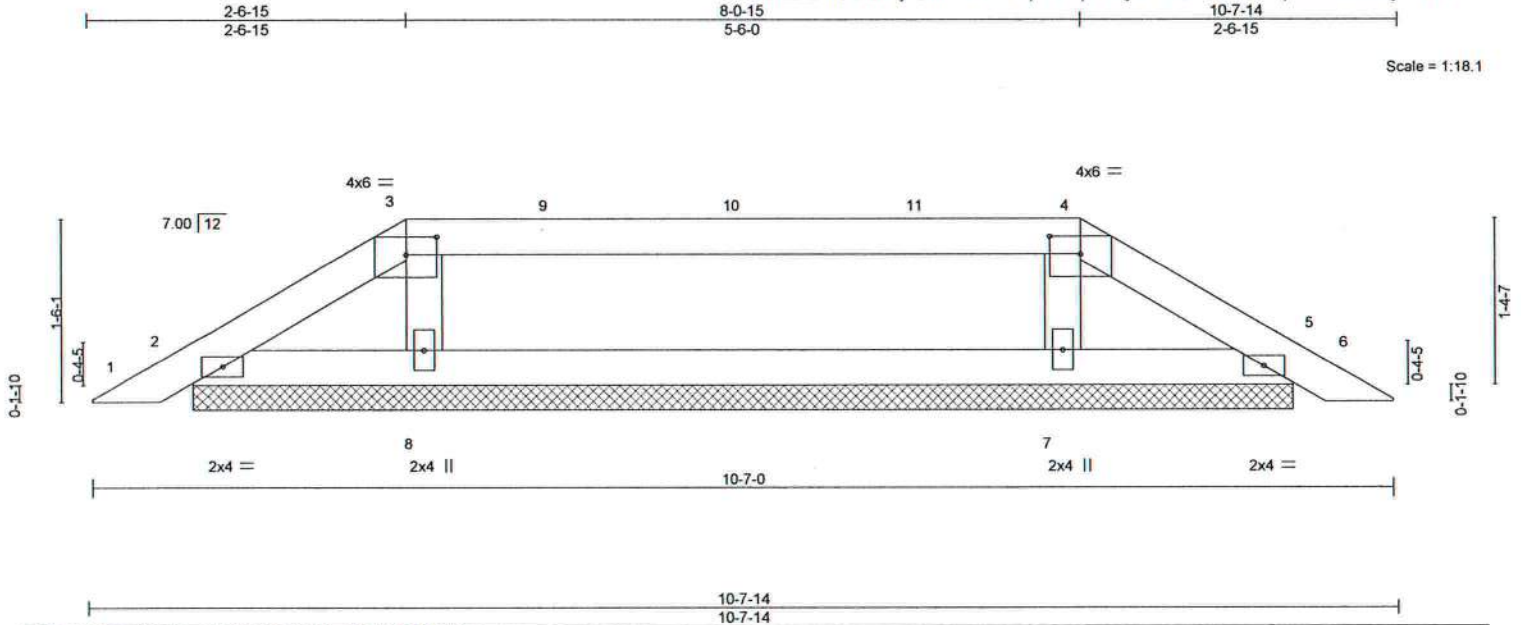


Plate Offsets (X,Y) - [3:0-3-0,0-1-12], [4:0-3-0,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.32	Vert(LL)	-0.00	5	n/r	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.16	Vert(CT)	-0.00	6	n/r		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.05	Horz(CT)	-0.00	5	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 33 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 8-11-9.
(lb) - Max Horz 2=-42(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 5 except 8=-123(LC 9), 7=-114(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 2, 5 except 8=302(LC 23), 7=302(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-** (10)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 2-6-15, Exterior(2R) 2-6-15 to 6-9-13, Interior(1) 6-9-13 to 8-0-15, Exterior(2E) 8-0-15 to 10-4-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5 except (jt=lb) 8=123, 7=114.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:52 2021 Page 1
ID:cExzFHCxHzHNjPCINbH0FZzN74p-b5vCvYaBjUJLAAdiqdrEVaNHh sNunlQVRVHDozGJ3D




Weight: 37 lb FT = 20%

BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (10)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCFL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 4-6-15, Exterior(2E) 4-6-15 to 10-4-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) Gable requires continuous bottom chord bearing.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5, 7 except (jt=lb) 8=108.
- 9) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- 10) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TP1 1 as referenced by the building code.




May 18, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Components**.


Safe Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2797533	Truss PB3	Truss Type Piggyback	Qty 7	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987466
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:53 2021 Page 1
ID: cExzFHCxHzHNjPCINbH0FZzN74p-3HTb6uapTccAzkiPGY84ni7Xsglo6LiRe5ErlqzGJ3C

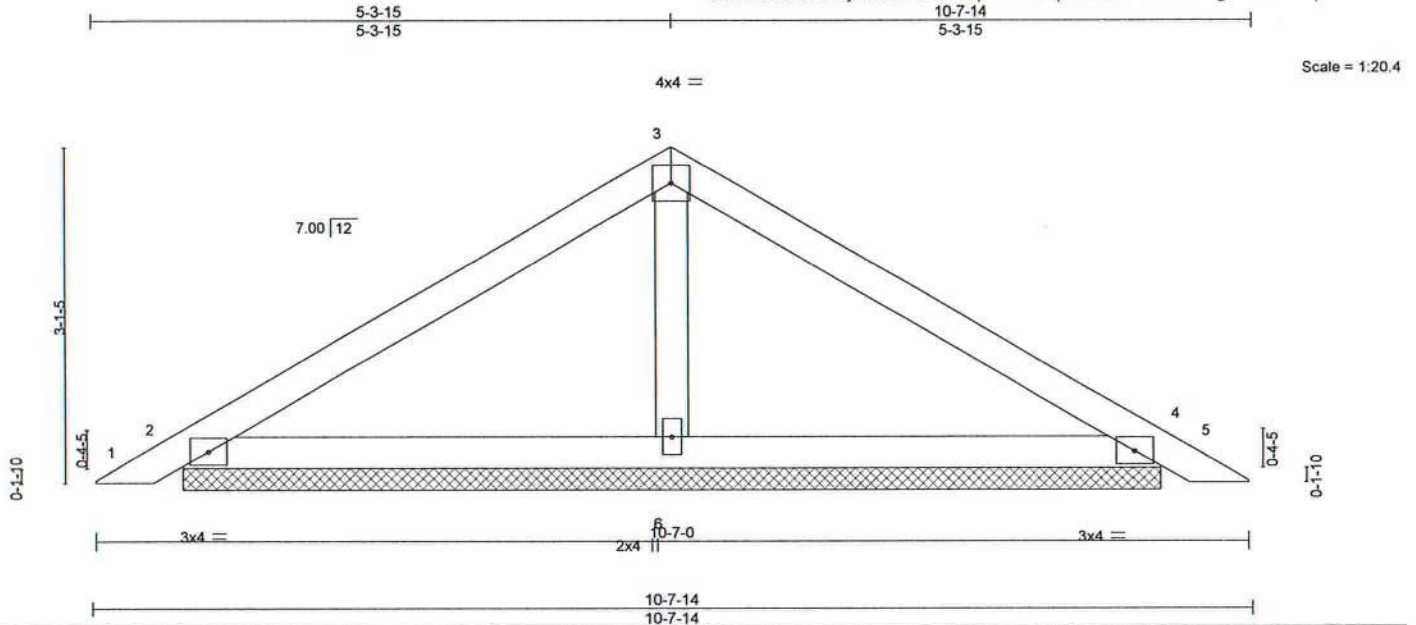

LOADING (psf)	SPACING-		CSI.		DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.22		Vert(LL)	0.01	5	n/r	120	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.19		Vert(CT)	0.01	5	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05		Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S							Weight: 35 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=8-11-9, 4=8-11-9, 6=8-11-9
Max Horz 2=-91(LC 10)
Max Uplift 2=-92(LC 12), 4=-104(LC 13), 6=-96(LC 12)
Max Grav 2=187(LC 1), 4=190(LC 20), 6=348(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 5-3-15, Exterior(2R) 5-3-15 to 8-3-15, Interior(1) 8-3-15 to 10-4-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6 except (jt=lb) 4=104.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MI-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss PB4	Truss Type Piggyback	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL Job Reference (optional)	T23987467
----------------	--------------	-------------------------	----------	----------	---	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:54 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-XT1zKEbREwk1btKbpFfJJwfkX4goroFbtk_OIHZGJ3B

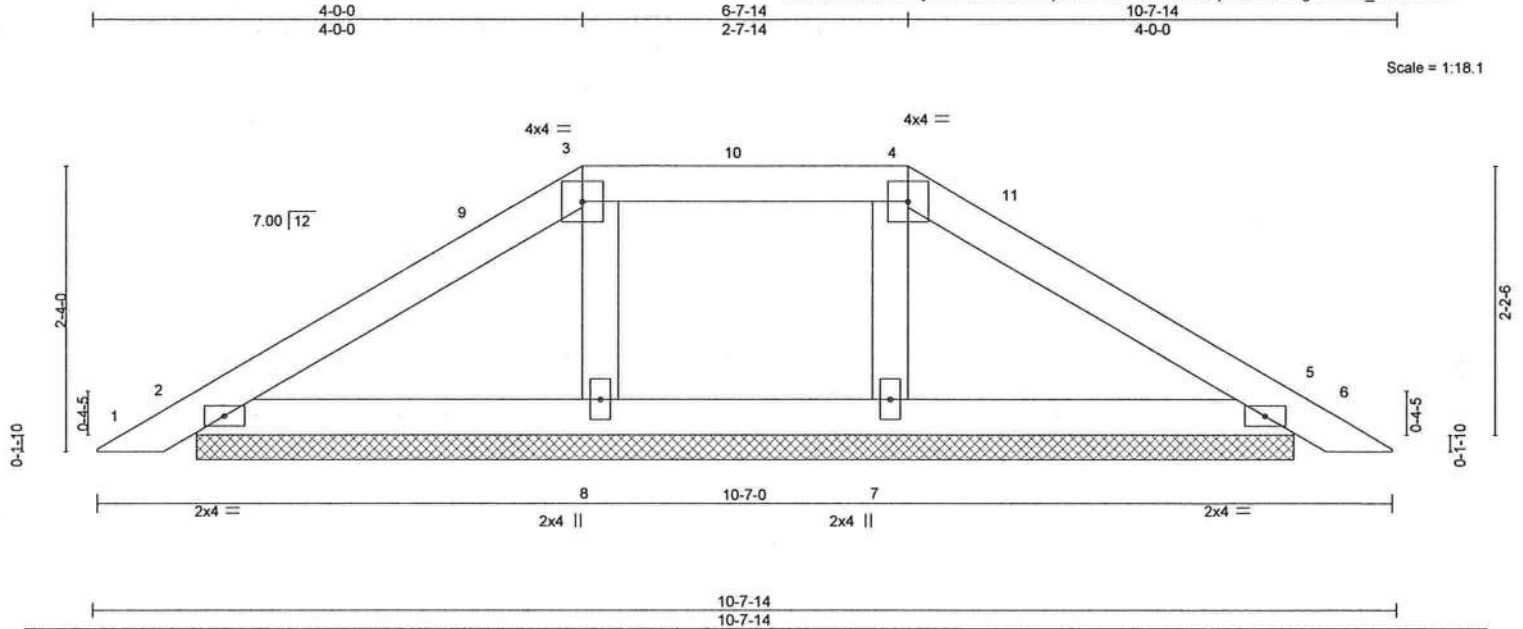

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.10	Vert(LL)	0.00 6	n/r	120	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.08	Vert(CT)	0.00 6	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00 5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-S					Weight: 36 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 8-11-9.
(lb) - Max Horz 2=67(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 2, 5, 7 except 8=100(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 2, 5, 8, 7

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES- (10)**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 3-3-11, Interior(1) 3-3-11 to 4-0-0, Exterior(2E) 4-0-0 to 10-4-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5, 7 except (jt=lb) 8=100.
 - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek

6904 Parke East Blvd.
Tampa, FL 33610


Job 2797533	Truss PB5	Truss Type Piggyback	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987468
----------------	--------------	-------------------------	----------	----------	--

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:55 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-?gbLXac3?DsuC1voNyBYs7CpeU_ZaExk6OjxqzGJ3A

Job Reference (optional)



Scale = 1:18.1

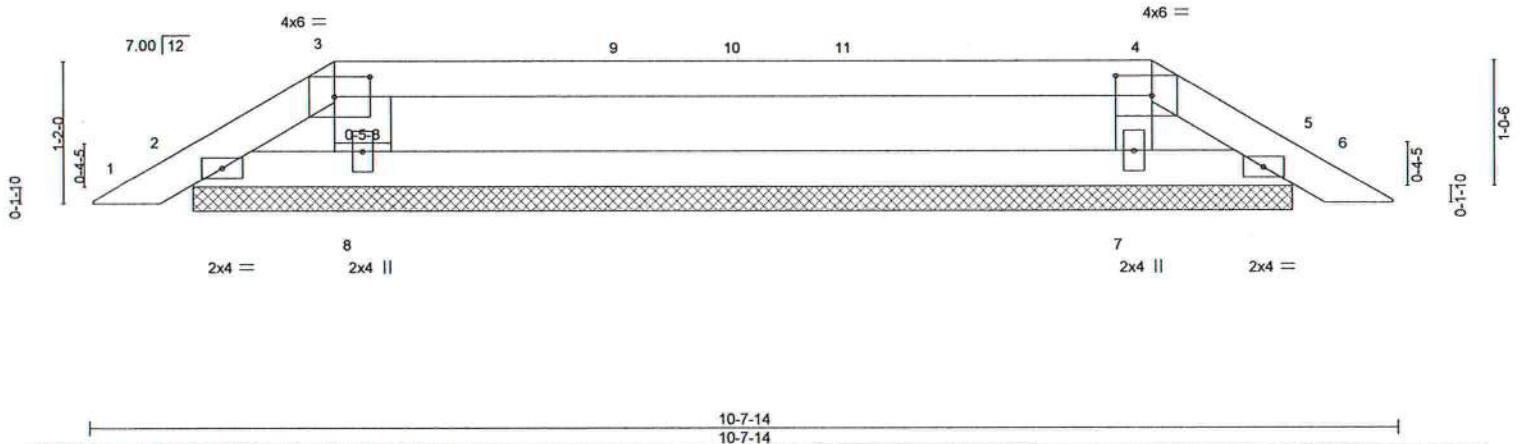


Plate Offsets (X,Y) - [3:0-3-8,0-2-0], [4:0-3-8,0-2-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.46	Vert(LL)	-0.00	6	n/r	120	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.24	Vert(CT)	-0.00	6	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 32 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x6 SP No.2 *Except*
4-7: 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. All bearings 8-11-9.
(lb) - Max Horz 2=31(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 2, 5 except 8=150(LC 9), 7=155(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 2, 5 except 8=372(LC 1), 7=391(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-8=275/226, 4-7=285/232

NOTES- (10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-11 to 2-0-0, Exterior(2R) 2-0-0 to 6-2-15, Interior(1) 6-2-15 to 8-7-14, Exterior(2E) 8-7-14 to 10-4-3 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5 except (jt=lb) 8=150, 7=155.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss T01	Truss Type Common	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987469
----------------	--------------	----------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:55 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-?gblXac3?DsuC1voNyBYs7Cn7UvnaD0k60jxqzGJ3A

Job Reference (optional)



4x6 =

Scale: 3/8"=1'

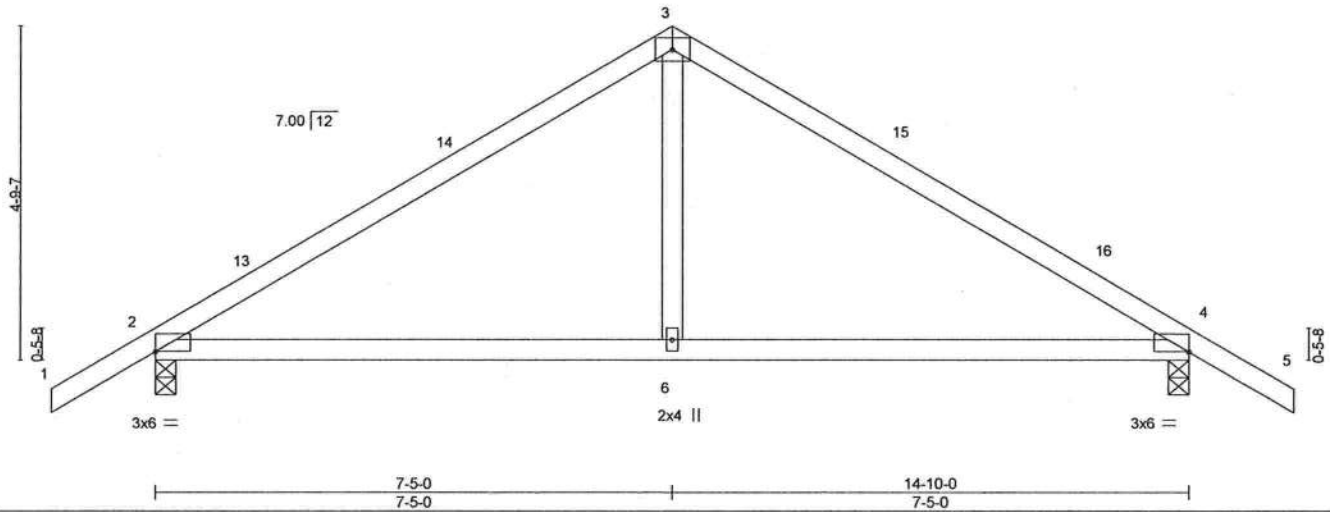


Plate Offsets (X,Y)-- [2-0-0-0,0-0-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.62	Vert(LL)	0.11	6-9	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.54	Vert(CT)	-0.15	6-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.13	Horz(CT)	0.01	2	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS							
									Weight: 59 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-9-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 4=0-3-8
Max Horz 2=-162(LC 10)
Max Uplift 2=-253(LC 12), 4=-253(LC 13)
Max Grav 2=630(LC 1), 4=630(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-693/275, 3-4=-693/275
BOT CHORD 2-6=-119/521, 4-6=-119/521
WEBS 3-6=-6/338

NOTES- (7)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TC DL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 7-5-0, Exterior(2R) 7-5-0 to 10-5-0, Interior(1) 10-5-0 to 16-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=253, 4=253.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek


6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T01G	Truss Type Common Supported Gable	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL Job Reference (optional)	T23987470
----------------	---------------	--------------------------------------	----------	----------	---	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:57 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-x2j5yGdJXr6cSL3AVND0xYHEMhc28e1ZiC2uczGJ38



Scale = 1:29.5

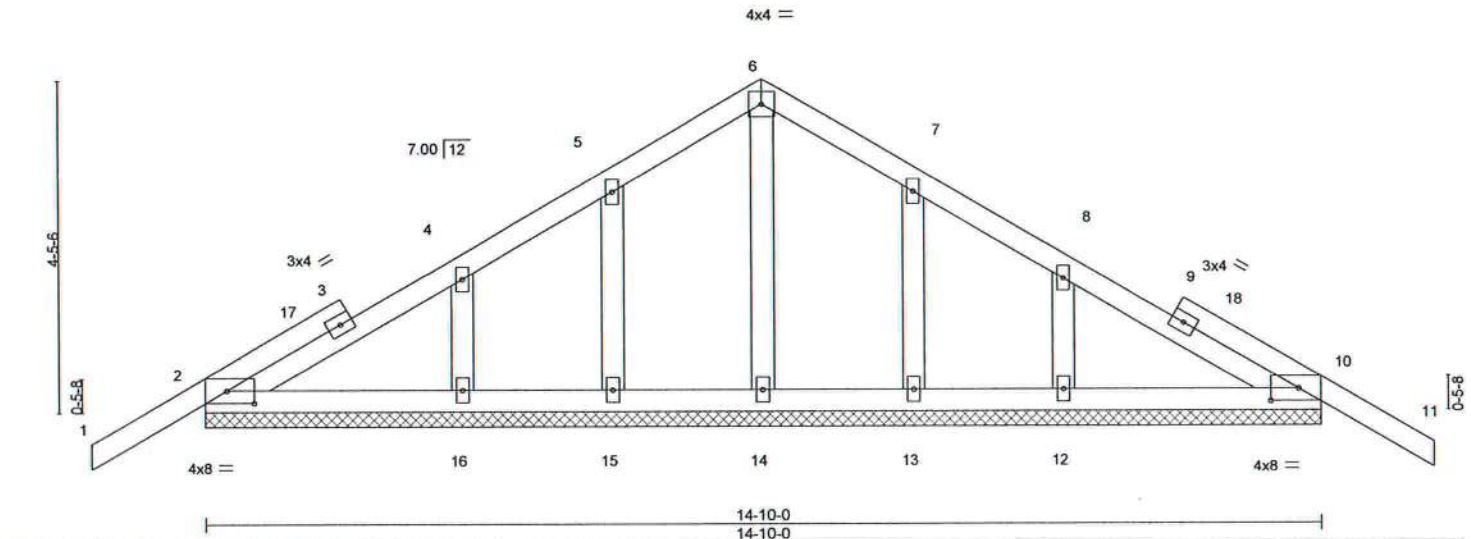


Plate Offsets (X,Y) - [2:0-4-7,0-2-0], [10:0-4-7,0-2-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.19	Vert(LL)	-0.00	11	n/r	120	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.07	Vert(CT)	-0.00	11	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	10	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-S						Weight: 77 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

- All bearings 14-10-0.
(lb) - Max Horz 2=151(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 15, 13 except 16=130(LC 12), 12=134(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 10, 14, 15, 16, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (11)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) -1-6-0 to 1-6-0, Exterior(2N) 1-6-0 to 7-5-0, Corner(3R) 7-5-0 to 10-5-0, Exterior(2N) 10-5-0 to 16-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 15, 13 except (jt=lb) 16=130, 12=134.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek

6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss T02	Truss Type Common	Qty 3	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987471
----------------	--------------	----------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:58 2021 Page 1
ID:cExzFHCxHzHNjPCINbH0FZzN74p-PFHU9beyl8ET3VeN25kFUmqHuhwQnZkAoMycR2zGJ37

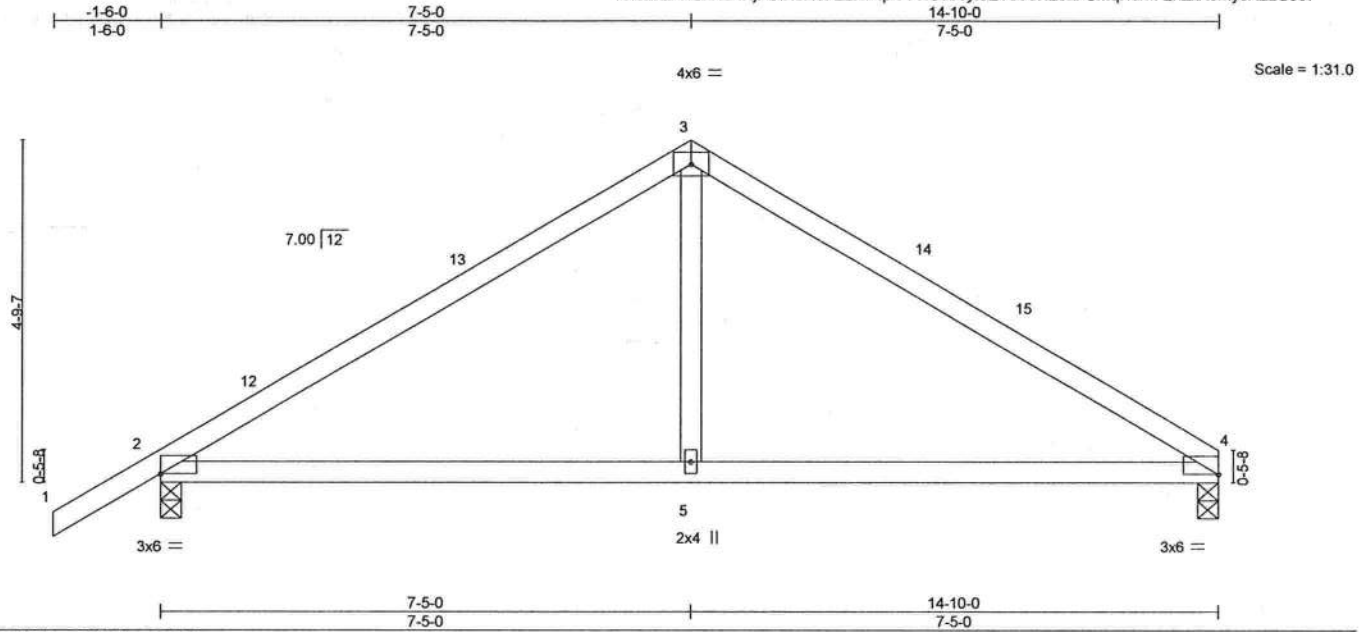


Plate Offsets (X,Y)-- [2:Edge,0-0-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.	DEFL. in (loc)			PLATES GRIP	
TCLL 20.0		Plate Grip DOL 1.25		TC 0.65	Vert(LL) 0.13	5-8	>999	240	MT20 244/190
TCDL 7.0		Lumber DOL 1.25		BC 0.55	Vert(CT) -0.17	5-8	>999	180	
BCLL 0.0 *		Rep Stress Incr YES		WB 0.13	Horz(CT) 0.01	2	n/a	n/a	
BCDL 10.0		Code FBC2020/TPI2014		Matrix-MS					
								Weight: 57 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-4-6 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=0-3-8, 2=0-3-8
Max Horz 2=153(LC 9)
Max Uplift 4=200(LC 13), 2=254(LC 12)
Max Grav 4=545(LC 1), 2=634(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-703/283, 3-4=-702/288
BOT CHORD 2-5=-140/524, 4-5=-140/524
WEBS 3-5=-15/339

NOTES- (7)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 7-5-0, Exterior(2R) 7-5-0 to 10-5-0, Interior(1) 10-5-0 to 14-10-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 4=200, 2=254.
- 7) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek

6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T02G	Truss Type Common Supported Gable	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987472
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,					

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:37:59 2021 Page 1
ID:cExzFHCxHzHNjPCINbH0FZzN74p-uRrsNxfa3SMKhFDZcoFU0zNaE5OeW1iK10h9zUzGJ36

-1-6-0 10-4-0 20-8-0 22-2-0
1-6-0 10-4-0 10-4-0 1-6-0

Scale = 1:41.9

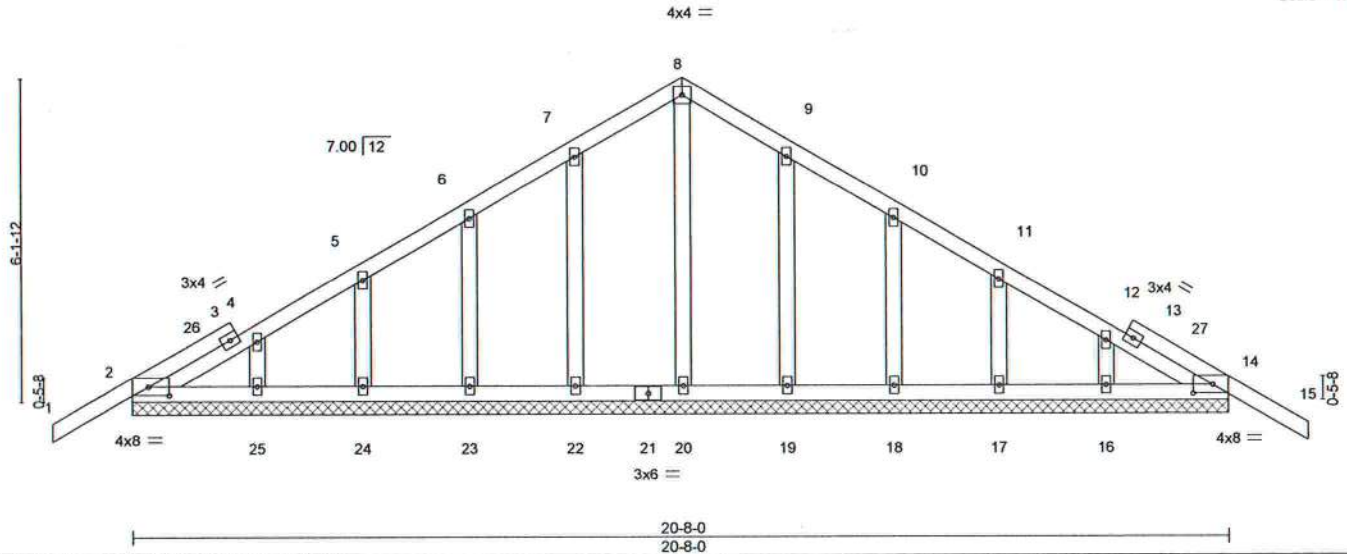


Plate Offsets (X,Y)-- [2:0-4-7,0-2-0], [14:0-4-7,0-2-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.17	Vert(LL)	-0.01	15	n/r	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.04	Vert(CT)	-0.01	15	n/r		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.08	Horz(CT)	0.00	14	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S						
	Code FBC2020/TPI2014							
							Weight: 117 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 20-8-0.
(lb) - Max Horz 2=-204(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 2, 14, 25, 16 except 22=-105(LC 12), 23=-101(LC 12), 24=-106(LC 12), 19=-103(LC 13), 18=-102(LC 13), 17=-106(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 14, 20, 22, 23, 24, 25, 19, 18, 17, 16

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES- (11)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCCL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Corner(3E) -1-6-0 to 1-6-0, Exterior(2N) 1-6-0 to 10-4-0, Corner(3R) 10-4-0 to 13-4-0, Exterior(2N) 13-4-0 to 22-2-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 25, 16 except (jt=lb) 22=105, 23=101, 24=106, 19=103, 18=102, 17=106.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquín Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss T03	Truss Type Common	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987473
----------------	--------------	----------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:00 2021 Page 1

ID:cExzFHCxHzHnJPCINbH0FZzN74p-MdOEaHgCqmUAJonIAWmjZBvfgVdmFQuTFgRvXzGJ35



4x6 //

Scale = 1:41.5

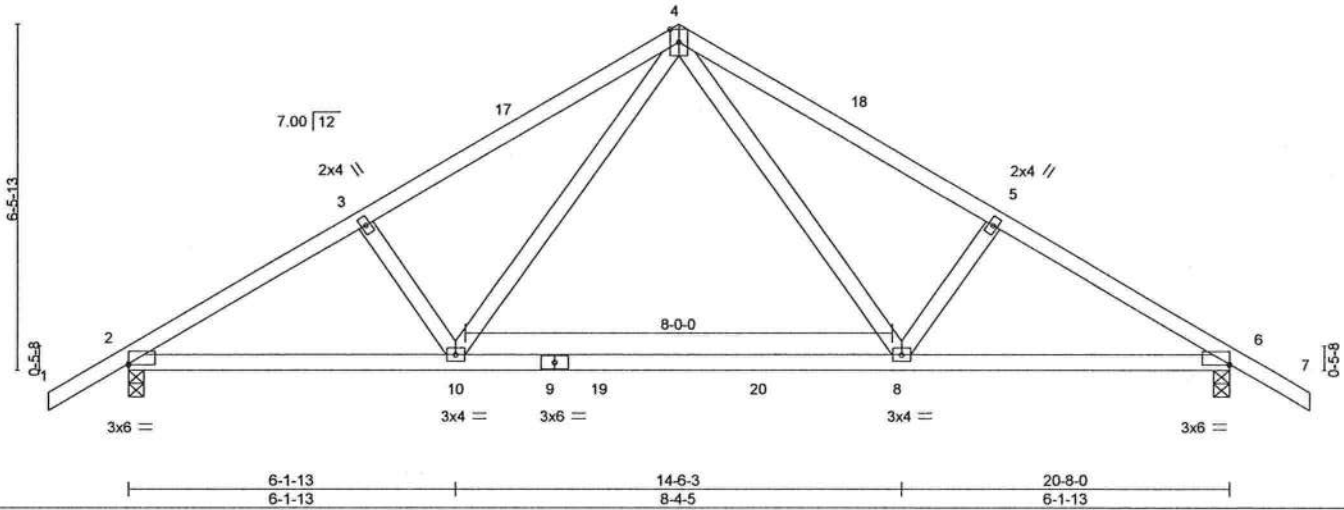


Plate Offsets (X,Y)-- [2:0-0-0,0-0-4], [6:0-0-0,0-0-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.57	Vert(LL)	-0.24	8-10	>999	240	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.49	Vert(CT)	-0.45	8-10	>557	180	
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.34	Horz(CT)	0.03	6	n/a	n/a	
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
								Weight: 102 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP M 31
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-9-14 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 6=0-3-8
Max Horz 2=-215(LC 10)
Max Uplift 2=-409(LC 12), 6=-409(LC 13)
Max Grav 2=1146(LC 19), 6=1146(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1769/606, 3-4=-1663/616, 4-5=-1664/616, 5-6=-1770/606
BOT CHORD 2-10=-565/1624, 8-10=-237/988, 6-8=-420/1463
WEBS 4-8=-319/868, 5-8=-269/269, 4-10=-318/868, 3-10=-269/269

NOTES- (8)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 10-4-0, Exterior(2R) 10-4-0 to 13-4-0, Interior(1) 13-4-0 to 22-2-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=409, 6=409.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- 8) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-7=-54, 10-11=-20, 8-10=-60(F=-40), 8-14=-20



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18, 2021



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T04	Truss Type Common	Qty 3	Ply 1	SIMQUE HOMES - LOT 56 PLL Job Reference (optional)	T23987474
----------------	--------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:01 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-qyycodhqb3c1wyMykDly5OSqOvz0_twdUKAG1NzGJ34



4x6 II

Scale = 1:40.8

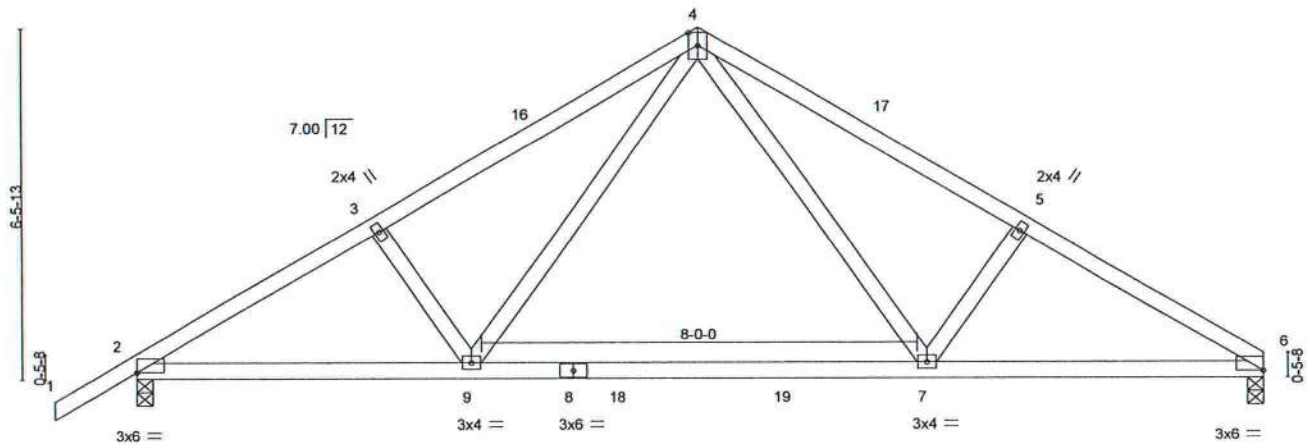


Plate Offsets (X,Y)-- [2:Edge,0-0-0]

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	2-0-0	TC 0.57	Vert(LL)	-0.24	7-9	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.49	Vert(CT)	-0.44	7-9	>561	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.36	Horz(CT)	0.03	6	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						Weight: 100 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP M 31
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-9-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=0-3-8, 2=0-3-8
Max Horz 2=206(LC 11)
Max Uplift 6=357(LC 13), 2=410(LC 12)
Max Grav 6=1066(LC 20), 2=1148(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1772/608, 3-4=-1666/617, 4-5=-1681/629, 5-6=-1787/620
BOT CHORD 2-9=-585/1612, 7-9=-257/977, 6-7=-472/1489
WEBS 4-7=-332/884, 5-7=-277/276, 4-9=-318/867, 3-9=-269/269

NOTES- (8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 10-4-0, Exterior(2R) 10-4-0 to 13-4-0, Interior(1) 13-4-0 to 20-8-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 6=357, 2=410.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-4=-54, 4-6=-54, 9-13=-20, 7-9=-60(F=-40), 7-10=-20



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18, 2021



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	SIMQUE HOMES - LOT 56 PLL	T23987475
2797533	T05	Half Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:02 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-I0W_?zhSMNkuY6x8HwpBec7zkJFBjJomj_wpapzGJ33



Scale = 1:27.3

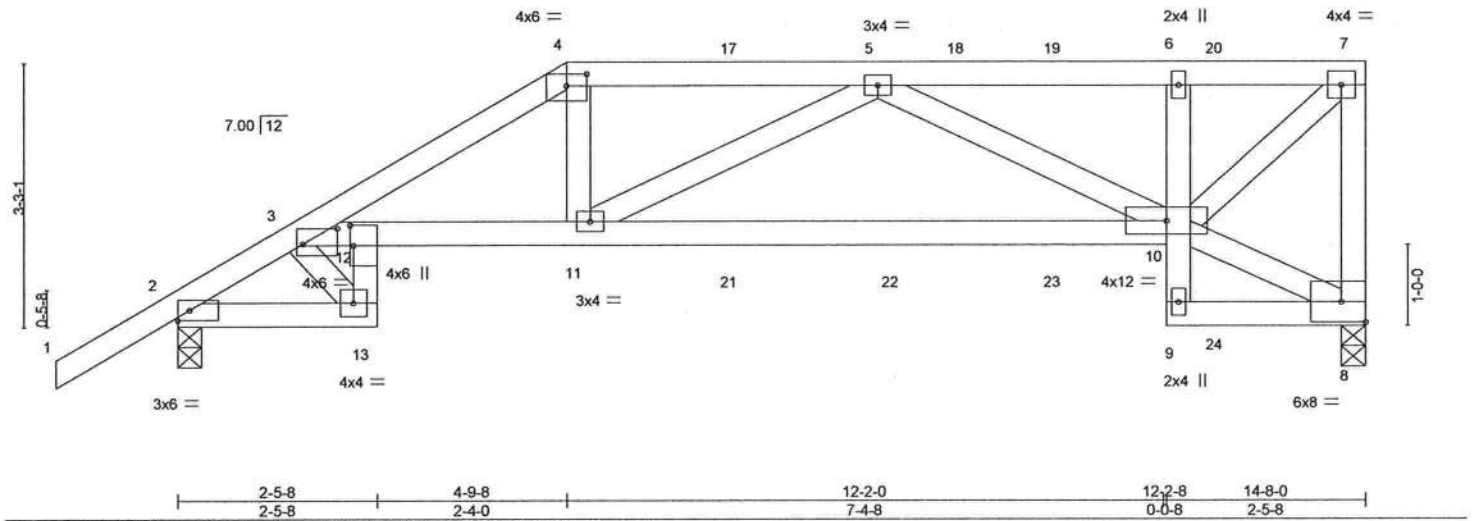


Plate Offsets (X,Y)- [3:0-5-1,0-2-4], [4:0-3-0,0-1-12], [12:0-3-0,0-0-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.66	Vert(LL)	0.19 11-12	>894	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.75	Vert(CT)	-0.23 10-11	>755	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.45	Horz(CT)	0.13 8	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 80 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
3-10: 2x4 SP M 31, 6-9: 2x4 SP No.3
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-3-1 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 8=0-3-8, 2=0-3-8
Max Horz 2=174(LC 8)
Max Uplift 8=535(LC 5), 2=529(LC 8)
Max Grav 8=873(LC 1), 2=921(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-15=-1245/714, 3-4=-2018/1224, 4-5=-1783/1143, 5-6=-930/562, 6-7=-875/538, 7-8=-845/528
BOT CHORD 2-13=-670/975, 12-13=-623/928, 3-12=-979/1528, 11-12=-1121/1737, 10-11=-1061/1632
WEBS 4-11=-299/615, 5-11=-94/286, 5-10=-795/594, 7-10=-721/1169, 3-13=-1185/819

NOTES- (9)

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCp=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=535, 2=529.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 251 lb down and 221 lb up at 4-9-8, 117 lb down and 87 lb up at 6-10-4, 117 lb down and 85 lb up at 8-10-4, and 117 lb down and 87 lb up at 10-10-4, and 122 lb down and 109 lb up at 12-10-4 on top chord, and 176 lb down and 137 lb up at 4-9-8, 61 lb down and 43 lb up at 6-10-4, 61 lb down and 43 lb up at 8-10-4, and 61 lb down and 43 lb up at 10-10-4, and 50 lb down and 20 lb up at 12-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T05	Truss Type Half Hip Girder	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987475 Job Reference (optional)
----------------	--------------	-------------------------------	----------	----------	--

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:02 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-i0W_?zhSMNkuY6x8HwpBec?zkJfBJomj_wpapzGJ33

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 1-4=-54, 4-7=-54, 13-14=-20, 10-12=-20, 8-9=-20

Concentrated Loads (lb)

Vert: 4=-116(F) 11=-151(F) 5=-44(F) 17=-44(F) 19=-44(F) 20=-54(F) 21=-51(F) 22=-51(F) 23=-51(F) 24=-34(F)



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	SIMQUE HOMES - LOT 56 PLL	T23987476
2797533	T06	ROOF SPECIAL	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:04 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-EPeIQfju_cnQ5WPLrfj14lo6unB763AIPweizGJ31

1-6-0	4-7-12	9-0-0	11-9-4	19-6-0	21-10-0	28-2-12	30-7-8	36-2-0	40-4-8	42-10-0	44-4-0
1-6-0	4-7-12	4-4-4	2-9-4	7-8-12	2-4-0	6-4-12	2-4-12	5-6-8	4-2-8	2-5-8	1-6-0

Scale = 1:77.2

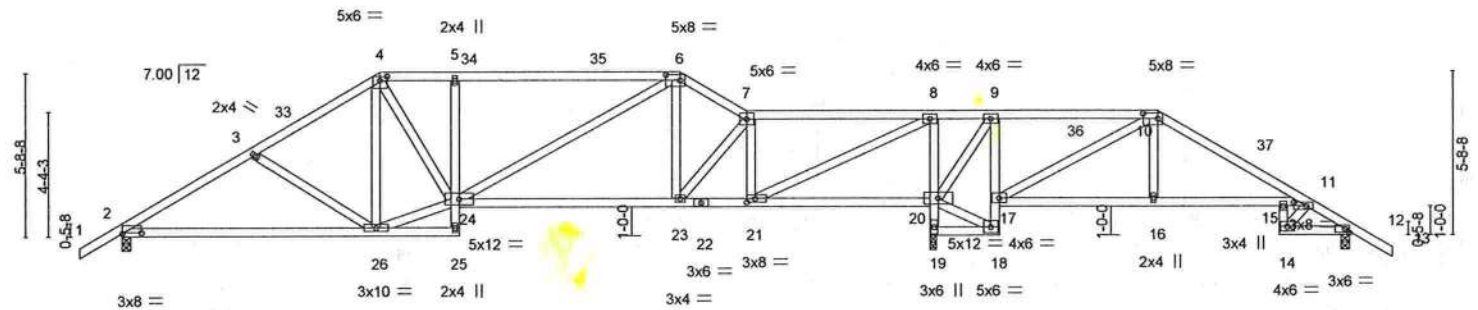


Plate Offsets (X,Y)--	[2:0-8-0,0-0-4], [4:0-3-0,0-1-12], [6:0-6-0,0-2-4], [10:0-6-0,0-2-4], [11:0-5-4,0-1-8], [21:0-3-8,0-1-8]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.69	Vert(LL)	0.16 15-16	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.87	Vert(CT)	-0.29 23-24	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.78	Horz(CT)	0.07 12	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 245 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2 *Except*
 5-25,8-19,9-18: 2x4 SP No.3, 14-15: 2x4 SP M 31
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-3-12 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 4-0-1 oc bracing. Except:
 10-0-0 oc bracing: 15-16

REACTIONS.

(size) 2=0-3-8, 19=0-2-12, 12=0-3-8
 Max Horz 2=191(LC 10)
 Max Uplift 2=376(LC 12), 19=643(LC 13), 12=258(LC 13)
 Max Grav 2=1034(LC 1), 19=1871(LC 1), 12=434(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1514/595, 3-4=-1283/524, 4-5=-1405/618, 5-6=-1437/632, 6-7=-1240/563,
 7-8=-1004/511, 8-9=-135/869, 9-10=-10/404, 10-11=-364/243, 11-12=-454/298
 BOT CHORD 2-26=-512/1262, 5-24=-386/297, 23-24=-432/1059, 21-23=-461/1043, 20-21=-835/330,
 19-20=-1780/616, 8-20=-1140/471, 9-17=-142/524, 16-17=-52/288, 15-16=-51/279,
 14-15=-114/288, 12-14=-182/348
 WEBS 3-26=-302/255, 24-26=-373/1092, 4-24=-349/698, 6-24=-205/469, 7-21=-817/312,
 8-21=-655/2038, 10-17=-766/248, 10-16=-13/295, 9-20=-904/358, 18-20=-370/188,
 11-14=-348/170

NOTES- (9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 1-6-0 to 1-6-0, Interior(1) 1-6-0 to 9-0-0, Exterior(2R) 9-0-0 to 12-0-0, Interior(1) 12-0-0 to 19-6-0, Exterior(2E) 19-6-0 to 21-10-0, Interior(1) 21-10-0 to 36-2-0, Exterior(2R) 36-2-0 to 39-2-0, Interior(1) 39-2-0 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 19.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=376, 19=643, 12=258.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd. Tampa FL 33610
 Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
 Tampa, FL 33610

Job 2797533	Truss T07	Truss Type ROOF SPECIAL	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987477
----------------	--------------	----------------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:07 2021 Page 1

ID: cExzFHCxHzHNjPCINbHOFZzN74p-fzJt2glbAvNBetq54UOMLfp4KvYORLVsGdaF1zGJ3_

-1-6-0 2-5-8 6-10-8 8-9-12 11-0-0 17-6-0 19-10-0 24-2-2 28-2-12 30-7-8 34-2-0 40-4-8 42-10-0 44-4-0
1-6-0 2-5-8 4-5-0 1-11-4 2-2-4 6-6-0 2-4-0 4-4-2 4-0-10 2-4-12 3-6-8 6-2-8 2-5-8 1-6-0

Scale = 1:77.2

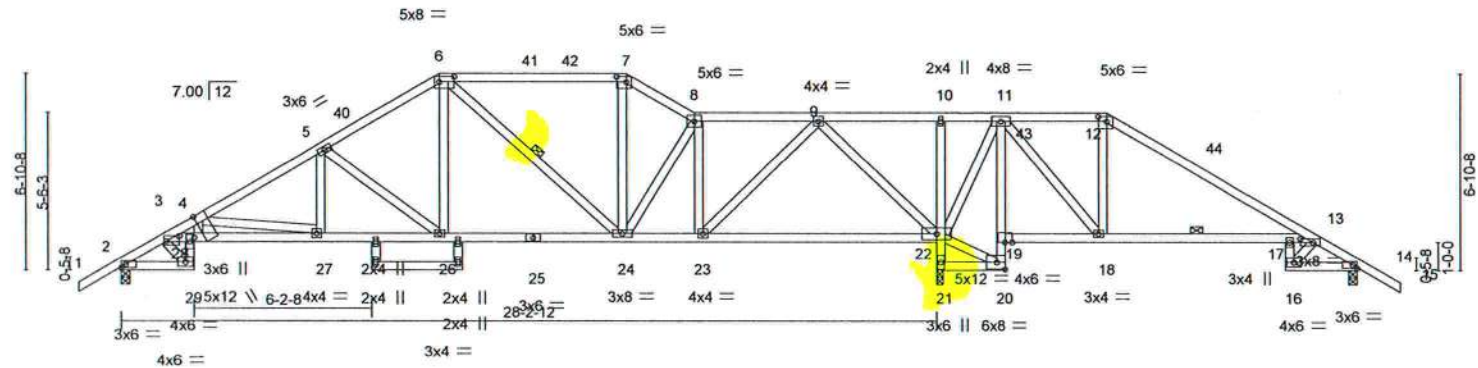


Plate Offsets (X,Y)	[3:0-5-1,0-2-4], [6:0-6-0,0-2-4], [7:0-4-0,0-2-4], [12:0-3-8,0-2-0], [13:0-5-4,0-1-8], [28:0-7-12,Edge]
---------------------	---

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.69	Vert(LL)	0.28 17-18	>618	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.93	Vert(CT)	-0.38 17-18	>451	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 1.00	Horz(CT)	0.13 14	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 266 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD
BOT CHORD 2x4 SP No.2 *Except*	BOT CHORD
28-29,31-32: 2x4 SP No.3, 16-17: 2x4 SP M 31	Structural wood sheathing directly applied or 3-0-5 oc purlins.
WEBS 2x4 SP No.3	Rigid ceiling directly applied or 2-2-0 oc bracing. Except:
	6-0-0 oc bracing: 17-18
	7-9-0 oc bracing: 26-27
	WEBS 1 Row at midpt 6-24

REACTIONS.	(size) 2=0-3-8, 21=0-2-12, 14=0-3-8
Max Horz	2=228(LC 10)
Max Uplift	2=380(LC 12), 21=734(LC 13), 14=212(LC 13)
Max Grav	2=961(LC 1), 21=2081(LC 1), 14=331(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	3-35=1314/493, 3-4=3317/1314, 4-5=1649/632, 5-6=1149/510, 6-7=756/444, 7-8=884/475, 8-9=687/421, 9-10=208/1105, 10-11=207/1108, 12-13=57/316, 13-14=326/261
BOT CHORD	2-29=455/1033, 28-29=411/970, 3-28=1101/2610, 27-28=1142/2660, 26-27=586/1400, 24-26=428/951, 23-24=434/709, 22-23=361/146, 21-22=1929/678, 18-19=708/333, 13-17=324/238, 14-16=170/255
WEBS	8-23=636/262, 9-23=306/1087, 9-22=1454/509, 20-22=653/353, 11-22=1074/439, 11-18=293/792, 12-18=439/217, 6-26=172/474, 5-27=102/345, 6-24=314/136, 5-26=626/359, 4-28=337/943, 4-27=1291/635, 3-29=1210/530

- NOTES- (9)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-5-10, Interior(1) 1-5-10 to 11-0-0, Exterior(2R) 11-0-0 to 14-0-0, Interior(1) 14-0-0 to 17-6-0, Exterior(2E) 17-6-0 to 19-10-0, Interior(1) 19-10-0 to 34-2-0, Exterior(2R) 34-2-0 to 37-2-0, Interior(1) 37-2-0 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 21.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=380, 21=734, 14=212.
 - This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

Job	Truss	Truss Type	Qty	Ply	SIMQUE HOMES - LOT 56 PLL	T23987478
2797533	T08	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:09 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-bMRetMnriXdvUBzUCvRqQ4nC77a_sQboKa6hJvzGJ2y

1-6-0 2-5-8 7-1-10 13-0-0 15-6-0 17-10-0 23-0-6 28-2-12 30-7-8 32-2-0 36-3-4 40-4-8 42-10-0 44-4-0
1-6-0 2-5-8 4-8-2 5-10-6 2-6-0 2-4-0 5-2-6 5-2-6 2-4-12 1-6-8 4-1-4 4-1-4 2-5-8 1-6-0

Scale = 1:78.6

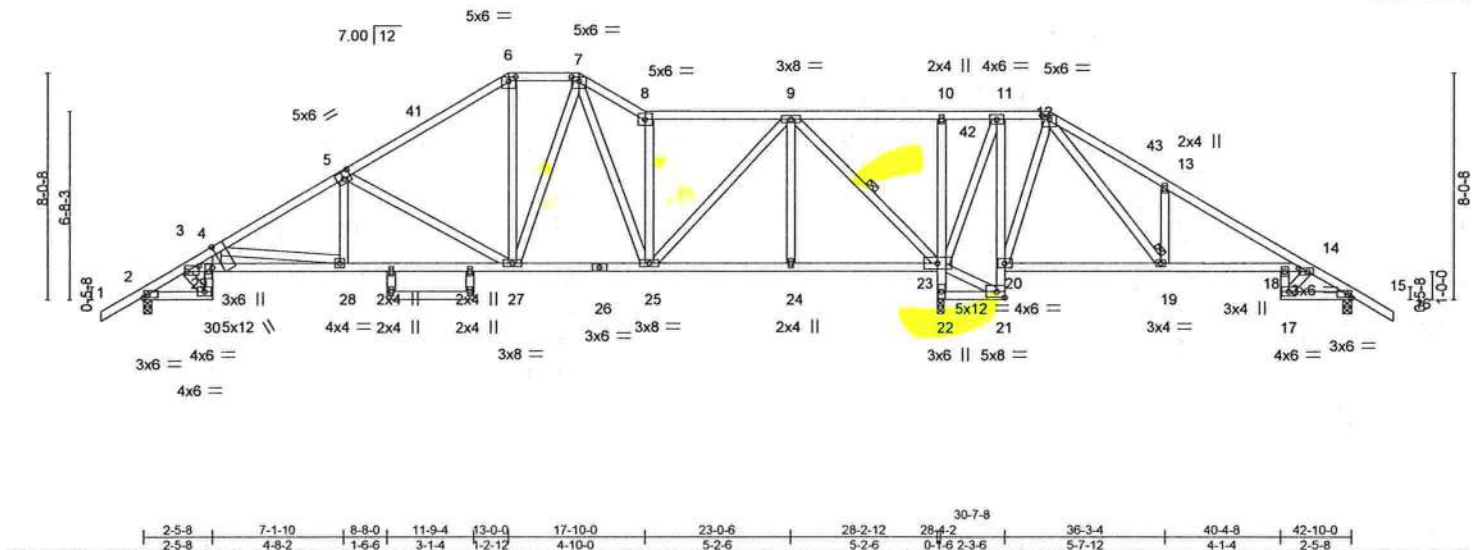


Plate Offsets (X,Y)--	[3-0-5,1,0-2-4], [5-0-3-0,0-3-0], [6-0-3-0,0-1-12], [7-0-3-0,0-1-12], [12-0-3-0,0-1-12], [14-0-3-12,0-1-8], [29-0-7-12,Edge]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.46	Vert(LL)	0.17 28-29	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.93	Vert(CT)	-0.26 28-29	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.13 22	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 292 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-1 oc purlins.
BOT CHORD 2x4 SP No.2 *Except*	Rigid ceiling directly applied or 2-2-0 oc bracing. Except:
29-30,32-33: 2x4 SP No.3, 17-18: 2x4 SP M 31	6-0-0 oc bracing: 19-20, 18-19
WEBS 2x4 SP No.3	7-8-0 oc bracing: 27-28
	1 Row at midpt 9-23
	1 Brace at Jt(s): 19

REACTIONS.	(size) 2=0-3-8, 22=0-2-12, 15=0-3-8
	Max Horz 2=-264(LC 10)
	Max Uplift 2=-400(LC 12), 22=-713(LC 13), 15=-238(LC 13)
	Max Grav 2=967(LC 1), 22=2063(LC 1), 15=371(LC 20)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	3-36=-1326/505, 3-4=-3320/1429, 4-5=-1653/666, 5-6=-999/476, 6-7=-788/472, 7-8=-916/580, 8-9=-742/458, 9-10=-77/833, 10-11=-78/835, 11-12=-42/532, 12-13=-313/383, 14-15=-353/259
BOT CHORD	2-30=-506/1119, 29-30=-461/1053, 3-29=-1202/2725, 28-29=-1240/2779, 27-28=-593/1458, 25-27=-318/713, 24-25=-275/180, 23-24=-275/180, 22-23=-1926/658, 11-20=-264/770, 19-20=-363/204, 15-17=-147/258
WEBS	6-27=-100/276, 8-25=-634/399, 9-25=-257/822, 21-23=-528/291, 11-23=-943/349, 4-29=-397/1026, 13-19=-361/312, 12-20=-601/229, 12-19=-385/673, 7-27=-138/311, 7-25=-269/198, 9-23=-1439/456, 5-28=-85/399, 4-28=-1343/656, 5-27=-789/453, 3-30=-1310/592, 14-17=-252/141

- NOTES-** (9)
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCp=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-5-10, Interior(1) 1-5-10 to 13-0-0, Exterior(2E) 13-0-0 to 17-10-0, Interior(1) 17-10-0 to 32-2-0, Exterior(2R) 32-2-0 to 35-2-0, Interior(1) 35-2-0 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 22.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=400, 22=713, 15=238.
 - 9) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date: May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2797533	Truss T09	Truss Type Hip	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987479
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:11 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-XIZOu2o5E8ld7V7lJJTIVVsTCxG8KGT5nuboNozGJ2w

1-6-0 2-5-8 7-1-10 12-8-0 20-7-2 28-2-12 30-2-0 35-8-6 40-4-8 42-10-0 44-4-0
1-6-0 2-5-8 4-8-2 5-6-6 7-11-2 7-7-10 1-11-4 5-6-6 4-8-2 2-5-8 1-6-0

Scale = 1:77.2

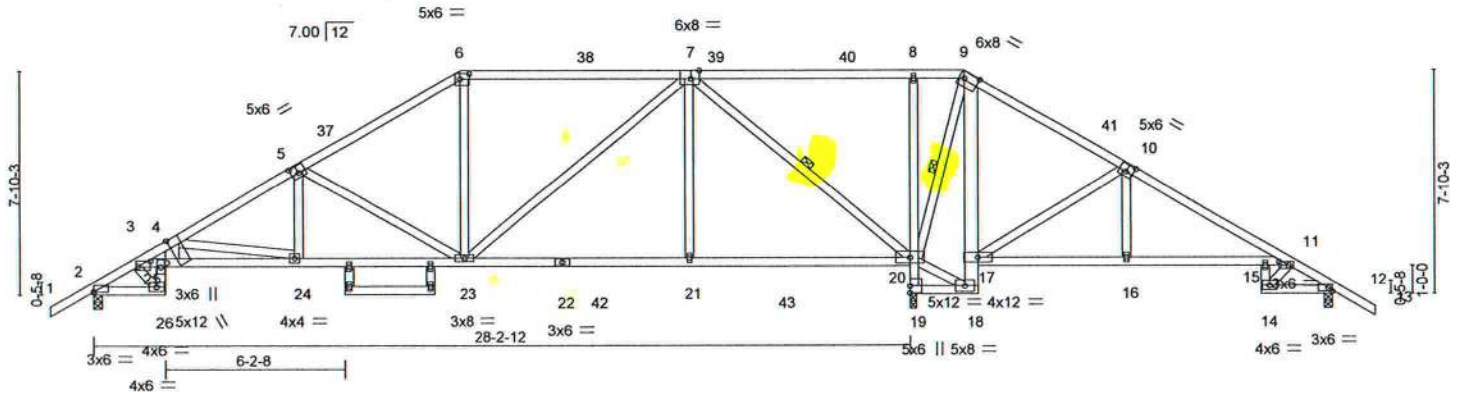


Plate Offsets (X,Y)=-	2-0-0-0,0-0-4	3-0-5-1,0-2-4	5-0-3-0,0-3-0	6-0-4-0,0-2-4	7-0-3-8,Edge	9-0-6-0,0-2-12	10-0-3-0,0-3-0	11-0-4-0,0-1-8	25-0-8-0,Edge
-----------------------	---------------	---------------	---------------	---------------	--------------	----------------	----------------	----------------	---------------

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.81	Vert(LL) -0.17	24-25	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.95	Vert(CT) -0.28	24-25	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.93	Horz(CT) 0.14	19	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014	Matrix-MS					Weight: 276 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
25-26,28-29,8-19: 2x4 SP No.3, 9-18: 2x6 SP No.2
14-15: 2x4 SP M 31
WEBS 2x4 SP No.3 *Except*
4-25: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-10-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing. Except:
7-1-0 oc bracing: 23-24
WEBS 1 Row at midpt 7-20, 9-20

REACTIONS.

(size) 2=0-3-8, 19=0-2-12 (req. 0-2-14), 12=0-3-8
Max Horz 2=-258(LC 10)
Max Uplift 2=-452(LC 12), 19=-662(LC 13), 12=-219(LC 13)
Max Grav 2=1037(LC 25), 19=2443(LC 2), 12=323(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-32=-1463/590, 3-4=-3693/1629, 4-5=-1783/792, 5-6=-1123/544, 6-7=-918/535,
7-8=-113/960, 8-9=-113/961, 9-10=-129/877, 10-11=-198/476
BOT CHORD 2-26=-574/1259, 25-26=-511/1171, 3-25=-1342/3010, 24-25=-1383/3037,
23-24=-694/1574, 21-23=-414/521, 20-21=-415/517, 19-20=-2294/609, 8-20=-334/256,
9-17=-273/643, 16-17=-344/175, 15-16=-348/174, 11-15=-345/173
WEBS 7-21=0/452, 7-20=-1750/601, 18-20=-660/375, 9-20=-1189/353, 6-23=-38/263,
3-26=-1429/649, 5-24=-107/463, 4-25=-444/1217, 4-24=-1491/701, 5-23=-864/439,
7-23=-248/706, 10-16=0/256, 10-17=-671/357

NOTES- (10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-5-10, Interior(1) 1-5-10 to 12-8-0, Exterior(2R) 12-8-0 to 16-10-15, Interior(1) 16-10-15 to 30-2-0, Exterior(2R) 30-2-0 to 34-4-15, Interior(1) 34-4-15 to 44-4-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- WARNING: Required bearing size at joint(s) 19 greater than input bearing size.
- Providing mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=452, 19=662, 12=219.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date: May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss T10	Truss Type HIP	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987480
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:13 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-T7h8JkqMml7KNoHFRkVmwawtYkx_oFYOFc4uSgzGJ2u

1-6-0	6-11-14	11-9-4	14-8-0	21-5-0	28-2-0	31-0-12	35-10-2	42-10-0	44-4-0
1-6-0	6-11-14	4-9-6	2-10-12	6-9-0	6-9-0	2-10-12	4-9-6	6-11-14	1-6-0

Scale = 1:77.1

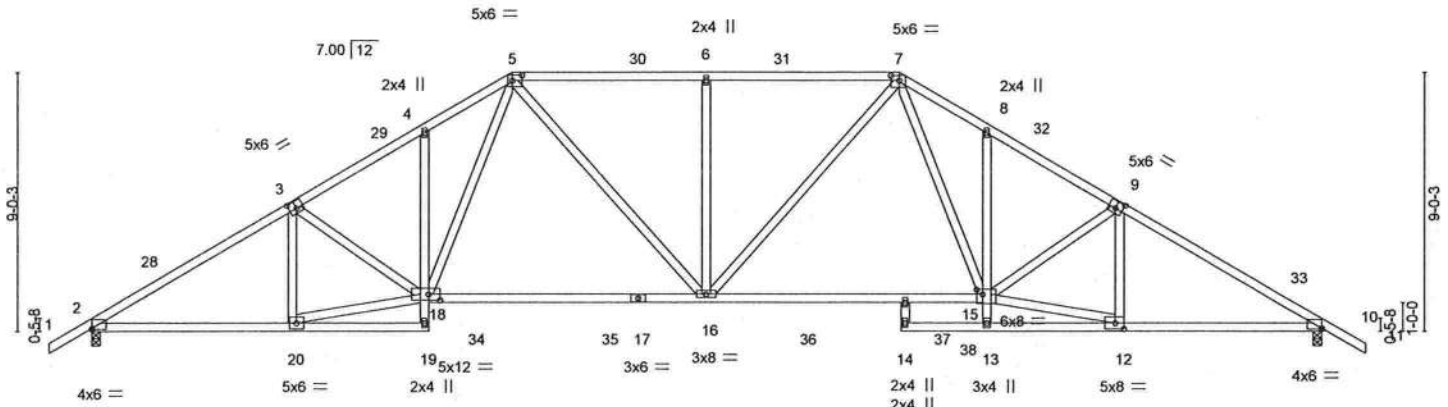


Plate Offsets (X,Y) -	[2:0-0-0,0-0-8], [3:0-3-0,0-3-0], [5:0-4-0,0-2-4], [7:0-3-8,0-2-0], [9:0-3-0,0-3-0], [10:0-0-0,0-0-8], [12:0-3-8,0-2-8], [15:0-2-8,0-2-0], [18:0-4-12,0-2-8]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.56	Vert(LL)	-0.46 16-18	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.99	Vert(CT)	-0.80 16-18	>644	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.64	Horz(CT)	0.19 10	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
Weight: 270 lb									FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
4-19,8-13: 2x4 SP No.3, 15-17: 2x4 SP M 31
WEBS 2x4 SP No.3 *Except*
18-20,12-15: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-11-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing. Except:
10-0-0 oc bracing: 13-15

REACTIONS.

(size) 2=0-3-8, 10=0-3-8
Max Horz 2=-294(LC 10)
Max Uplift 2=-648(LC 12), 10=-641(LC 13)
Max Grav 2=1866(LC 2), 10=1913(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3038/971, 3-4=-3115/1042, 4-5=-3103/1143, 5-6=-2676/851, 6-7=-2676/851,
7-8=-3246/1086, 8-9=-3260/983, 9-10=-3123/959
BOT CHORD 2-20=-885/2583, 16-18=-615/2290, 15-16=-433/2356, 10-12=-676/2629, 13-15=0/253
WEBS 3-20=-374/209, 18-20=-863/2671, 5-18=-433/1131, 5-16=-298/685, 6-16=-418/316,
9-12=-432/157, 9-15=-167/256, 12-15=-635/2816, 7-16=-313/585, 7-15=-391/1269

NOTES- (8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 14-8-0, Exterior(2R) 14-8-0 to 18-10-15, Interior(1) 18-10-15 to 28-2-0, Exterior(2R) 28-2-0 to 32-4-15, Interior(1) 32-4-15 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=648, 10=641.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T11	Truss Type HIP	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987481
----------------	--------------	-------------------	----------	----------	---------------------------	-----------


Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:14 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-xKFXW4r_X3FB_ysR_S0?78U2h8JRXc4XUsqS_7zGJ2t

1-6-0	6-11-14	11-9-4	16-8-0	21-5-0	26-2-0	28-2-12	31-0-12	35-10-2	42-10-0	44-4-0
1-6-0	6-11-14	4-9-6	4-10-12	4-9-0	4-9-0	2-0-12	2-10-0	4-9-6	6-11-14	1-6-0

Scale = 1:77.1

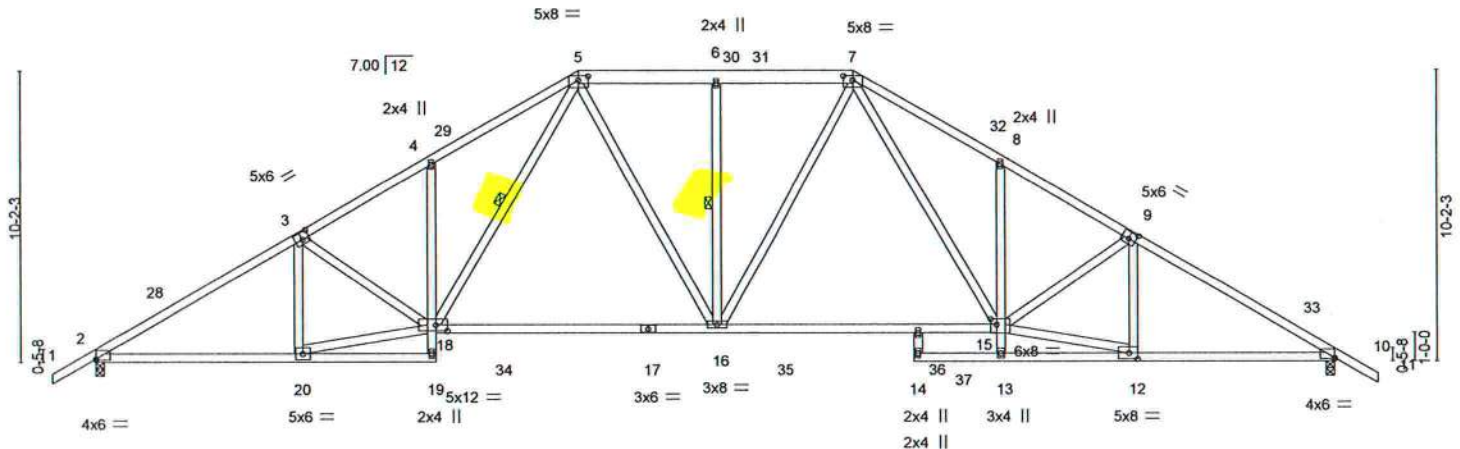

6-11-14	11-9-4	21-5-0	28-2-12	31-0-12	35-10-2	42-10-0
6-11-14	4-9-6	9-7-12	6-9-12	2-10-0	4-9-6	6-11-14

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.53	Vert(LL)	-0.41 15-16	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.85	Vert(CT)	-0.70 15-16	>739	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 1.00	Horz(CT)	0.18 10	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 285 lb	FT = 20%

LUMBER-

TOP CHORD	2x4 SP No.2 *Except* 5-7: 2x6 SP No.2
BOT CHORD	2x4 SP No.2 *Except* 4-19,8-13: 2x4 SP No.3, 17-18,15-17: 2x4 SP M 31
WEBS	2x4 SP No.3 *Except* 18-20,12-15: 2x4 SP No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 2-10-10 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing. Except: 10-0-0 oc bracing: 13-15
WEBS	1 Row at midpt 5-18, 6-16

REACTIONS.

(size)	2=0-3-8, 10=0-3-8
Max Horz	2=-330(LC 10)
Max Uplift	2=-643(LC 12), 10=-636(LC 13)
Max Grav	2=1877(LC 19), 10=1921(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-3046/961, 3-4=-3124/1036, 4-5=-3142/1191, 5-6=-2345/778, 6-7=-2345/777, 7-8=-3277/1130, 8-9=-3260/973, 9-10=-3125/949
BOT CHORD	2-20=-897/2706, 4-18=-288/260, 16-18=-530/2123, 15-16=-402/2161, 10-12=-666/2630, 8-15=-288/261
WEBS	3-20=-377/208, 18-20=-862/2772, 5-18=-549/1280, 5-16=-247/582, 6-16=-314/231, 7-16=-260/502, 7-15=-503/1415, 9-12=-425/152, 9-15=-137/256, 12-15=-614/2796

NOTES- (8)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 16-8-0, Exterior(2R) 16-8-0 to 20-10-15, Interior(1) 20-10-15 to 26-2-0, Exterior(2R) 26-2-0 to 30-4-15, Interior(1) 30-4-15 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=643, 10=636.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss T12	Truss Type Hip	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987482
Job Reference (optional)					

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:16 2021 Page 1

ID: cExzFHCxHzHNjPCINbHOFZzN74p-iiMHxIsE3gVvEG0q6t3TCZaNFyzA?XBqxAJZ2?zGJ2r

1-6-0 4-2-5 8-1-1 14-9-4 22-2-12 28-2-2 32-6-0 34-8-15 36-8-3 42-10-0 44-4-0
1-6-0 4-2-5 3-10-12 6-8-3 7-5-8 5-11-6 4-3-14 2-2-15 1-11-4 6-1-13 1-6-0

Scale = 1:75.9

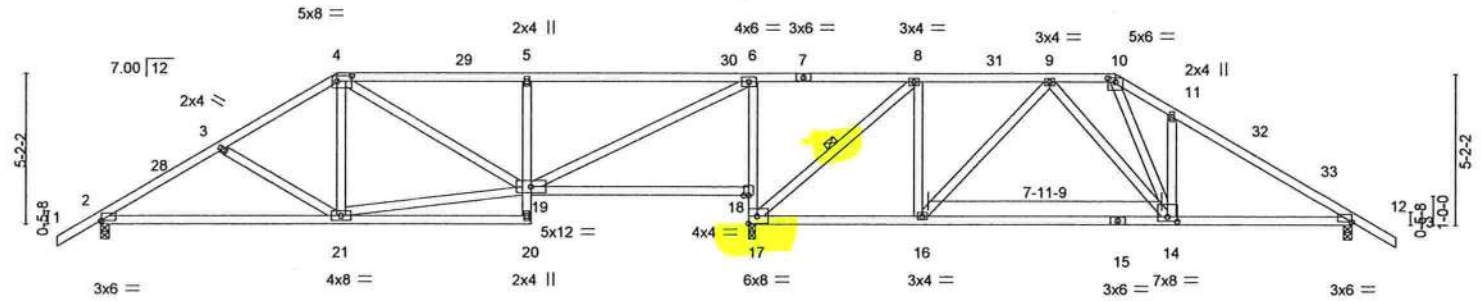


Plate Offsets (X,Y) -		[2:0-0-4,0-0-0], [4:0-6-0,0-2-4], [10:0-3-0,0-1-12], [14:0-4-0,0-2-0]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d
TCLL 20.0		Plate Grip DOL	1.25	TC 0.59		Vert(LL)	0.18 14-16	>999	240
TCDL 7.0		Lumber DOL	1.25	BC 0.90		Vert(CT)	-0.35 14-16	>699	180
BCLL 0.0 *		Rep Stress Incr	NO	WB 0.83		Horz(CT)	0.02 17	n/a	n/a
BCDL 10.0		Code FBC2020/TPI2014		Matrix-MS					
						PLATES		GRIP	
						MT20		244/190	
						Weight: 244 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
5-20,6-17: 2x4 SP No.3, 15-17: 2x4 SP M 31
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 4-5-13 oc bracing.
WEBS 1 Row at midpt 8-17

REACTIONS.

(size) 2=0-3-8, 17=0-2-12, 12=0-3-8
Max Horz 2=-175(LC 10)
Max Uplift 2=-419(LC 12), 17=-758(LC 9), 12=-488(LC 13)
Max Grav 2=854(LC 23), 17=1879(LC 1), 12=944(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1187/596, 3-4=-988/515, 4-5=-918/582, 5-6=-933/588, 6-8=-74/314, 8-9=-728/558,
9-10=-882/567, 10-11=-1334/834, 11-12=-1378/695
BOT CHORD 2-21=-524/982, 5-19=-417/315, 18-19=-251/113, 17-18=-1062/518, 6-18=-975/537,
16-17=-291/728, 14-16=-357/892, 12-14=-459/1114
WEBS 3-21=-266/210, 4-21=-17/273, 19-21=-307/765, 6-19=-590/1317, 8-17=-1262/509,
8-16=-125/575, 11-14=-294/280, 10-14=-430/647

NOTES- (10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 8-1-1, Exterior(2R) 8-1-1 to 12-4-0, Interior(1) 12-4-0 to 34-8-15, Exterior(2R) 34-8-15 to 38-11-14, Interior(1) 38-11-14 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 17.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=419, 17=758, 12=488.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard

Continued on page 2



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021



6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	SIMQUE HOMES - LOT 56 PLL	T23987482
2797533	T12	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:16 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-UiMHxIsE3gVvEG0q6t3TCZaNFyzA?XBqxAJZ2?zGJ2r

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-54, 4-10=-54, 10-13=-54, 20-22=-20, 18-19=-20, 16-17=-20, 14-16=-60(F=-40), 14-25=-20



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T13	Truss Type HIP	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987483
Job Reference (optional)					


Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:17 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-Mvwf85tsq_dmrQb0gaailm6YwMI5k7RzAq36bRzGJ2q

1-6-0 5-5-9 10-1-1 14-9-4 22-2-12 28-2-2 32-8-15 38-6-13 42-10-0 44-4-0
1-6-0 5-5-9 4-7-8 4-8-3 7-5-8 5-11-6 4-6-13 5-9-14 4-3-3 1-6-0

Scale = 1:75.9

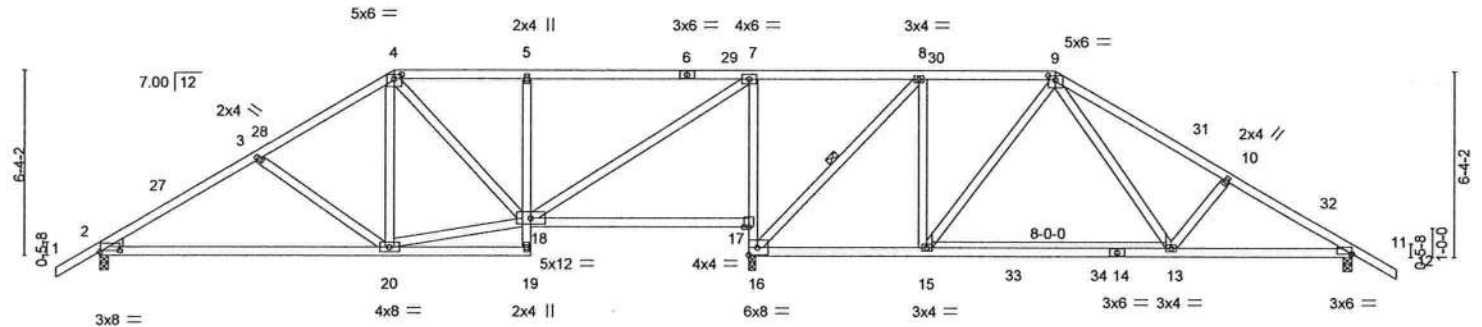

		10-1-1	14-9-4	22-2-12	22-4-2	28-2-2	36-8-3	42-10-0		
		10-1-1	4-8-3	7-5-8	0-1-6	5-10-0	8-6-1	6-1-13		
Plate Offsets (X,Y)--		[2:0-8-4,0-0-8], [4:0-3-0,0-1-12], [9:0-3-0,0-1-12], [11:0-0-0,0-0-4]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.25	TC 0.60	Vert(LL)	-0.23 13-15	>999	240	MT20	244/190	
TCDL 7.0	Lumber DOL	1.25	BC 0.98	Vert(CT)	-0.44 13-15	>560	180			
BCLL 0.0	Rep Stress Incr	NO	WB 0.77	Horz(CT)	0.02 16	n/a	n/a			
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS							
								Weight: 248 lb	FT = 20%	

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
5-19,7-16: 2x4 SP No.3, 14-16: 2x4 SP M 31
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-2-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 4-3-6 oc bracing.
WEBS 1 Row at midpt 8-16

REACTIONS.

(size) 2=0-3-8, 16=0-2-12, 11=0-3-8
Max Horz 2=-211(LC 10)
Max Uplift 2=-418(LC 12), 16=-695(LC 9), 11=-498(LC 13)
Max Grav 2=886(LC 19), 16=2007(LC 2), 11=1057(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1145/580, 3-4=-936/487, 4-5=-727/492, 5-7=-743/501, 7-8=-50/368, 8-9=-624/530,
9-10=-1475/769, 10-11=-1595/776
BOT CHORD 2-20=-519/1037, 5-18=-365/277, 16-17=-1102/507, 7-17=-987/527, 15-16=-206/617,
13-15=-251/738, 11-13=-568/1316
WEBS 3-20=-368/282, 4-20=-65/361, 18-20=-243/803, 7-18=-478/1162, 8-16=-1222/444,
8-15=-120/749, 9-15=-255/87, 9-13=-288/836, 10-13=-274/262

NOTES- (10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 10-1-1, Exterior(2R) 10-1-1 to 14-7-8, Interior(1) 14-7-8 to 32-8-15, Exterior(2R) 32-8-15 to 36-11-14, Interior(1) 36-11-14 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Reaction engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 16.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=418, 16=695, 11=498.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard

Continued on page 2



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek

6904 Parke East Blvd.
Tampa, FL 36610

Job	Truss	Truss Type	Qty	Ply	SIMQUE HOMES - LOT 56 PLL	T23987483
2797533	T13	HIP	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:17 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-Mvwf85tsq_dmrQb0gaailm6YwMI5k?RzAq36bRzGJ2q

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=54, 4-9=54, 9-12=54, 19-21=20, 17-18=20, 15-16=20, 13-15=60(F=-40), 13-24=20



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T14	Truss Type Hip	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987484
----------------	--------------	-------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:18 2021 Page 1

ID:cExzFHCxHzHNPCINbH0FZn74p-q5U1MRuUblldTZADDI5xH_fjUfOTry7OTofuzGJ2p

1-6-0 6-11-14 12-1-1 14-9-4 22-2-12 24-8-0 30-8-15 36-8-3 42-10-0 44-4-0
1-6-0 6-11-14 5-1-3 2-8-3 7-5-8 2-5-4 6-0-14 5-11-4 6-1-13 1-6-0

Scale = 1:75.9

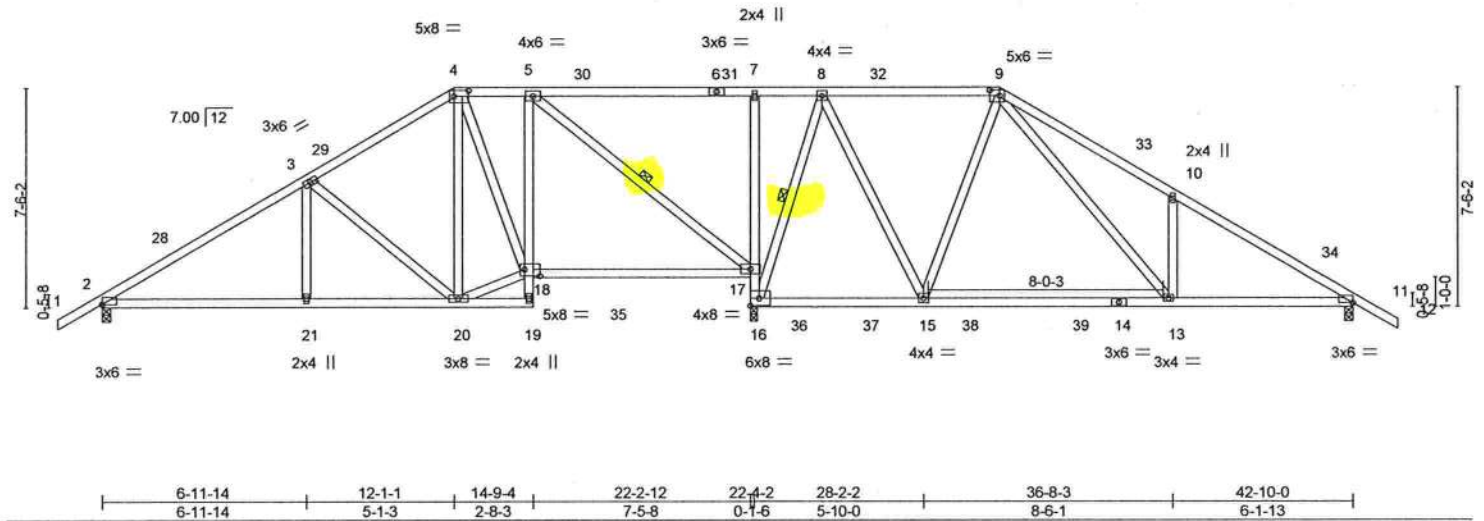


Plate Offsets (X,Y)--		[2:0-0-0,0-0-4], [4:0-6-0,0-2-4], [9:0-4-0,0-2-4], [18:0-6-4,0-2-12]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.61		Vert(LL)	-0.23 13-15	>999	240	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.91		Vert(CT)	-0.43 13-15	>568	180		
BCLL 0.0 *		Rep Stress Incr	NO	WB 0.88		Horz(CT)	0.03 16	n/a	n/a		
BCDL 10.0		Code FBC2020/TPI2014		Matrix-MS						Weight: 264 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 4-2-6 oc purlins.
BOT CHORD	2x4 SP No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 4-2-4 oc bracing.
	5-19,7-16; 2x4 SP No.3, 14-16; 2x4 SP M 31	WEBS	1 Row at midpt 5-17, 8-16
WEBS	2x4 SP No.3		

REACTIONS. (size) 2=0-3-8, 16=0-2-12, 11=0-3-8
Max Horz 2=-248(LC 10)
Max Uplift 2=-417(LC 12), 16=-622(LC 9), 11=-515(LC 13)
Max Grav 2=909(LC 19), 16=2113(LC 2), 11=1084(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1177/537, 3-4=-726/448, 4-5=-598/454, 5-7=-35/409, 7-8=-40/411, 8-9=-552/507, 9-10=-1650/964, 10-11=-1584/756
BOT CHORD 2-21=-483/1075, 20-21=-483/1075, 5-18=-13/555, 17-18=-267/611, 16-17=-1086/453, 7-17=-312/220, 13-15=-182/583, 11-13=-518/1281
WEBS 3-21=0/268, 3-20=-629/337, 18-20=-201/731, 5-17=-1087/421, 8-16=-1035/409, 8-15=-237/978, 9-15=-357/165, 9-13=-529/1138, 10-13=-388/361

- NOTES-** (10)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 12-1-1, Exterior(2R) 12-1-1 to 16-4-0, Interior(1) 16-4-0 to 30-8-15, Exterior(2R) 30-8-15 to 34-11-14, Interior(1) 34-11-14 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 16.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=417, 16=622, 11=515.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
 - This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek
6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	SIMQUE HOMES - LOT 56 PLL	T23987484
2797533	T14	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:18 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-q5U1MRuUblldTZADDI5xH_fjUfOTRy7OTof7uzGJ2p

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-54, 4-9=-54, 9-12=-54, 19-22=-20, 17-18=-20, 15-16=-20, 13-15=-60(F=-40), 13-25=-20

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T15	Truss Type Hip	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987485
Job Reference (optional)						

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:20 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-mUcon7vI7v?LitJbLi7PNPk0xZKZxN1QsnHmBmzGJ2n

1-6-0 6-11-14 14-1-1 14-9-4 22-2-12 28-8-15 32-6-0 36-8-3 42-10-0 44-4-0
1-6-0 6-11-14 7-1-3 0-8-3 7-5-8 6-6-3 3-9-1 4-2-3 6-1-13 1-6-0

Scale = 1:77.1

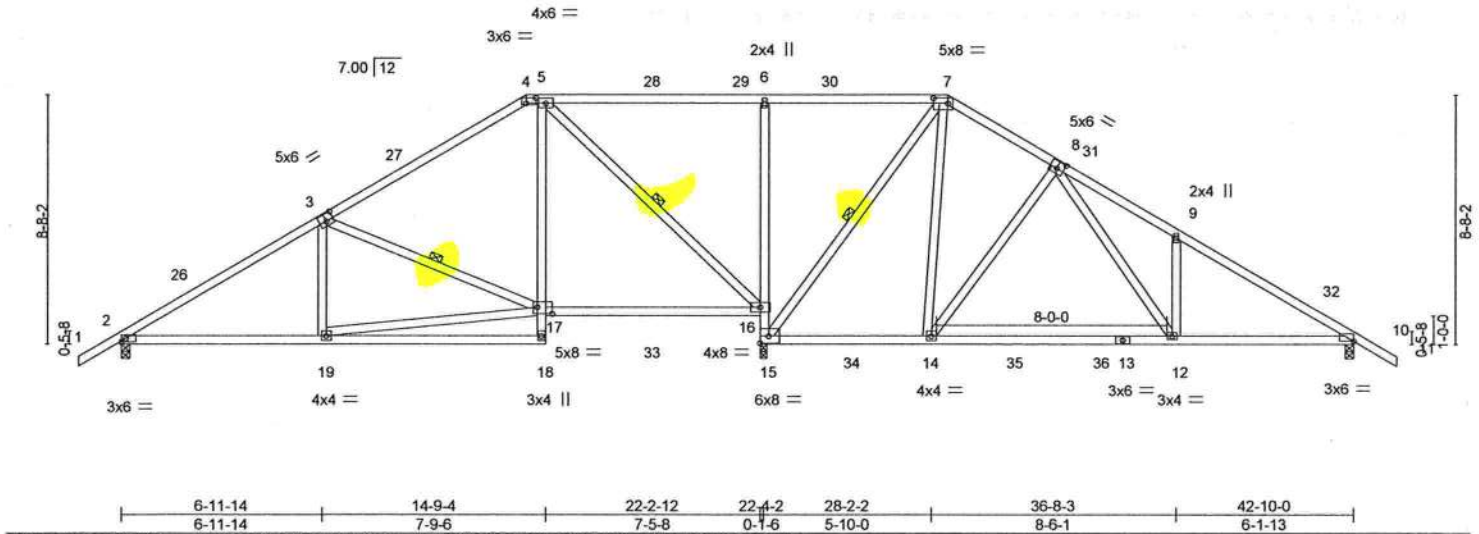


Plate Offsets (X,Y) - [3:0-3:0,0-3:0], [4:0-4:0,0-2:4], [7:0-6:0,0-2:4], [8:0-3:0,0-3:0], [17:0-6:4,0-2:12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.74	Vert(LL)	-0.23 12-14	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 1.00	Vert(CT)	-0.45 12-14	>542	180		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.72	Horz(CT)	0.03 15	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 261 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
5-18,6-15: 2x4 SP No.3, 13-15: 2x4 SP M 31
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-6-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 3-7-11 oc bracing.
WEBS 1 Row at midpt 5-16, 7-15, 3-17

REACTIONS.

(size) 2=0-3-8, 15=0-2-12, 10=0-3-8
Max Horz 2=-284(LC 10)
Max Uplift 2=-407(LC 12), 15=-601(LC 12), 10=-518(LC 13)
Max Grav 2=908(LC 19), 15=2186(LC 2), 10=1089(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1154/519, 3-4=-580/383, 4-5=-428/410, 5-6=-59/468, 6-7=-58/469, 7-8=-570/517,
8-9=-1608/916, 9-10=-1587/752
BOT CHORD 2-19=-495/1122, 5-17=-153/704, 16-17=-186/505, 15-16=-1213/519, 6-16=-441/334,
14-15=-86/444, 12-14=-278/738, 10-12=-508/1277
WEBS 5-16=-1069/389, 7-15=-1239/361, 7-14=-359/1113, 8-14=-649/371, 8-12=-415/972,
9-12=-299/291, 3-17=-676/361, 17-19=-456/1108

NOTES- (10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 14-1-1, Exterior(2R) 14-1-1 to 18-4-0, Interior(1) 18-4-0 to 28-8-15, Exterior(2R) 28-8-15 to 32-11-14, Interior(1) 32-11-14 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 15.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=407, 15=601, 10=518.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss T15	Truss Type Hip	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987485 Job Reference (optional)
----------------	--------------	-------------------	----------	----------	--

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:20 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-mUcon7vi7v?LiUjLi7PNPk0xZKZxN1QsnHmBmzGJ2n

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-54, 4-7=-54, 7-11=-54, 18-20=-20, 16-17=-20, 14-15=-20, 12-14=-60(F=-40), 12-23=-20

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



6904 Parke East Blvd.
Tampa, FL 36610

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:21 2021 Page 1
ID:cExzFHCxHzHNjPCINbH0FZzN74p-EgAA_TwNiD7CK1uovQeevcHDlZgwgoQZ5R1KkdZGJ2m

Structural drawing of a roof truss system. The drawing includes dimensions for various members and overall spans. Key dimensions include 1-6-0, 6-11-14, 14-9-4, 16-1-1, 22-2-12, 26-8-15, 32-6-0, 36-8-3, 42-10-0, and 44-4-0. The scale is 1:80.4. The truss is supported by columns labeled 3x6, 4x4, 3x4, 6x8, 4x4, 3x6, and 3x4. The roof structure is composed of members labeled 1 through 36. The drawing also shows a cross-section of the roof with a pitch of 10-2 and a total width of 10-0-0. The truss is supported by a foundation labeled 1-0-0.

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.61	Vert(LL) -0.23 12-14 >999 240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.99	Vert(CT) -0.45 12-14 >552 180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.83	Horz(CT) 0.04 15 n/a n/a		
BCDL 10.0	Code FBC2020/TP12014	Matrix-MS		Weight: 290 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
 4-19,6-15: 2x4 SP No.3, 13-15: 2x4 SP M 31
WEBS 2x4 SP No.3

BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 4-4-14 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 4-2-0 oc bracing. Except:
	1 Row at midpt 6-16
WEBS	1 Row at midpt 3-18, 5-16, 7-15

REACTIONS. (size) 2=0-3-8, 15=0-2-12, 10=0-3-8
 Max Horz 2=320(LC 10)
 Max Uplift 2=402(LC 12), 15=600(LC 12), 10=531(LC 13)
 Max Grav 2=906(LC 19), 15=2181(LC 2), 10=1110(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1151/512, 3-4=-567/381, 4-5=-407/456, 5-6=-45/455, 6-7=-46/453, 7-8=-619/558,
8-9=-1627/924, 9-10=-1621/774

BOT CHORD 2-20=-515/1146, 4-18=-172/375, 17-18=-175/492, 16-17=-136/369, 15-16=-1157/462,
6-16=-345/261, 12-14=-315/786, 10-12=-526/1304

WEBS 3-20=0/264, 18-20=-499/959, 3-18=-697/363, 4-17=-698/473, 5-17=-445/1034,
5-16=-1061/358, 7-15=-1178/360, 8-14=-711/436, 8-12=-381/933, 9-12=-269/262,
7-14=-415/1171

NOTES- (10)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDF=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) 1-6-0 to 1-6-0, Interior(1) 1-6-0 to 16-1-1, Exterior(2R) 16-1-1 to 20-4-0, Interior(1) 20-4-0 to 26-8-15, Exterior(2R) 26-8-15 to 30-11-14, Interior(1) 30-11-14 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 15.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=402, 15=600, 10=531.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- 10) This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.

LOAD CASE(S) Standard

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiteTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18, 2021



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T16	Truss Type Hip	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987486
----------------	--------------	-------------------	----------	----------	--

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:21 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-EgAA_TwNiD7CK1uovQeevcHDlZgwoQZ5R1KkDzGJ2m

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-5=-54, 5-7=-54, 7-11=-54, 19-21=-20, 16-18=-20, 14-15=-20, 12-14=-60(F=-40), 12-24=-20

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MI
MiTek

6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T17	Truss Type PIGGYBACK BASE	Qty 2	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987487
Job Reference (optional)						


Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:23 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-B2HwP9ydpQOwZL2A0rh6_1MZFMMy8wsYIWQo5zGJ2k

1-6-0	6-11-14	14-9-4	16-1-1	22-2-12	26-8-15	32-6-0	36-8-3	42-10-0	44-4-0
1-6-0	6-11-14	7-9-6	1-3-13	6-1-11	4-6-3	5-9-1	4-2-3	6-1-13	1-6-0

Scale = 1:80.4

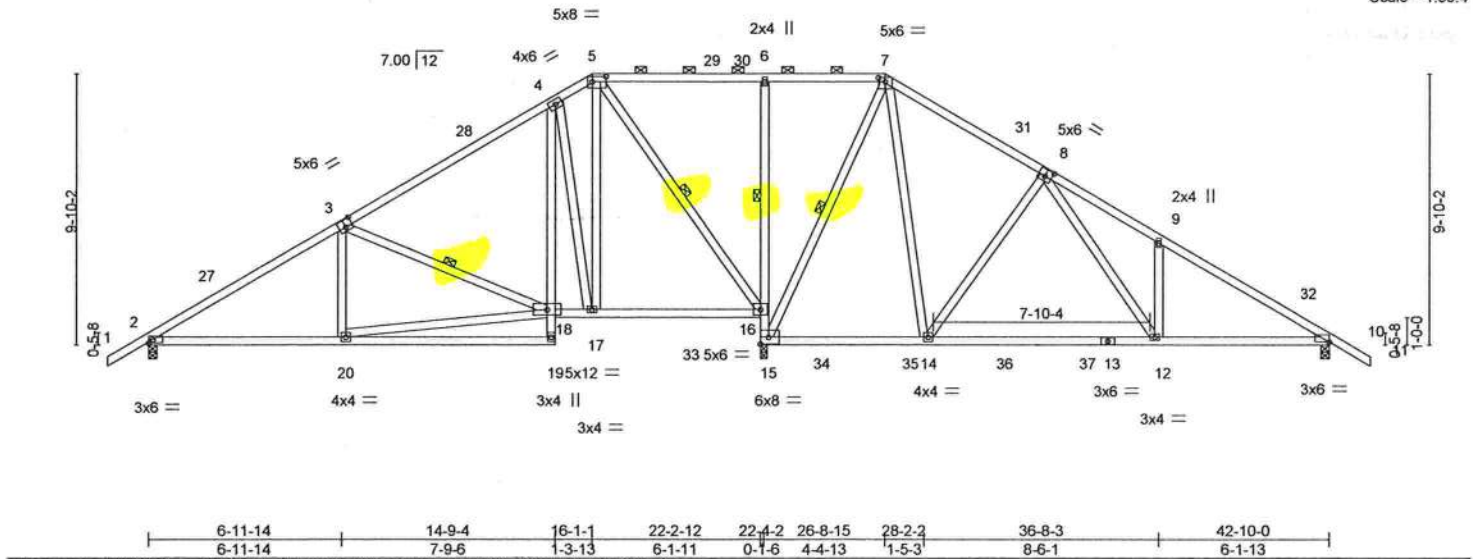

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.61	Vert(LL)	-0.22 12-14	>999	240	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.95	Vert(CT)	-0.42 12-14	>586	180		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.83	Horz(CT)	0.04 15	n/a	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS						
	Code FBC2020/TPI2014						Weight: 290 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-4-15 oc purlins, except
BOT CHORD 2x4 SP No.2 "Except"	2-0-0 oc purlins (10-0-0 max.): 5-7.
4-19,6-15: 2x4 SP No.3, 13-15: 2x4 SP M 31	Rigid ceiling directly applied or 4-1-14 oc bracing. Except:
WEBS 2x4 SP No.3	1 Row at midpt 6-16
	1 Row at midpt 3-18, 5-16, 7-15

REACTIONS.	(size)
2-0-3-8, 15-0-2-12, 10-0-3-8	
Max Horz 2=320(LC 10)	
Max Uplift 2=402(LC 12), 15=597(LC 12), 10=531(LC 13)	
Max Grav 2=908(LC 19), 15=2173(LC 2), 10=1111(LC 20)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-1156/513, 3-4=-573/382, 4-5=-413/457, 5-6=-45/448, 6-7=-46/446, 7-8=-638/565, 8-9=-1627/923, 9-10=-1620/773
BOT CHORD	2-20=-515/1151, 4-18=-172/375, 17-18=-176/497, 16-17=-137/374, 15-16=-1154/462, 6-16=-345/261, 12-14=-314/791, 10-12=-525/1304
WEBS	3-20=0/264, 18-20=-499/963, 3-18=-696/363, 4-17=-698/473, 5-17=-445/1035, 5-16=-1058/358, 7-15=-1161/356, 8-14=-706/435, 8-12=-380/924, 9-12=-270/262, 7-14=-416/1167

- NOTES-** (11)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 16-1-1, Exterior(2R) 16-1-1 to 20-4-0, Interior(1) 20-4-0 to 26-8-15, Exterior(2R) 26-8-15 to 30-11-14, Interior(1) 30-11-14 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate at joint(s) 15.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=402, 15=597, 10=531.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
 - This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 33610

Job	Truss	Truss Type	Qty	Ply	SIMQUE HOMES - LOT 56 PLL	T23987487
2797533	T17	PIGGYBACK BASE	2	1	Job Reference (optional)	

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:23 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-B2HwP9ydPqOwZL2A0rh6_1MZFMMy8iwsYIWQo5zGJ2k

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-5=-54, 5-7=-54, 7-11=-54, 19-21=-20, 16-18=-20, 14-15=-20, 12-14=-60(F=-40), 12-24=-20



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T18	Truss Type PIGGYBACK BASE	Qty 4	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987488
----------------	--------------	------------------------------	----------	----------	---------------------------	-----------

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:25 2021 Page 1

ID:cExzFHCxHzHNjPCINbH0FZzN74p-7RPhqzuxRedpeCZ8Gja4SSI?a3Scb8973?Xl_zGJ2i

Job Reference (optional)

1-6-0	6-11-14	14-9-4	16-1-1	21-5-0	26-8-15	28-0-12	35-10-2	42-10-0	44-4-0
1-6-0	6-11-14	7-9-6	1-3-13	5-3-15	5-3-15	1-3-13	7-9-6	6-11-14	1-6-0

Scale = 1:80.0

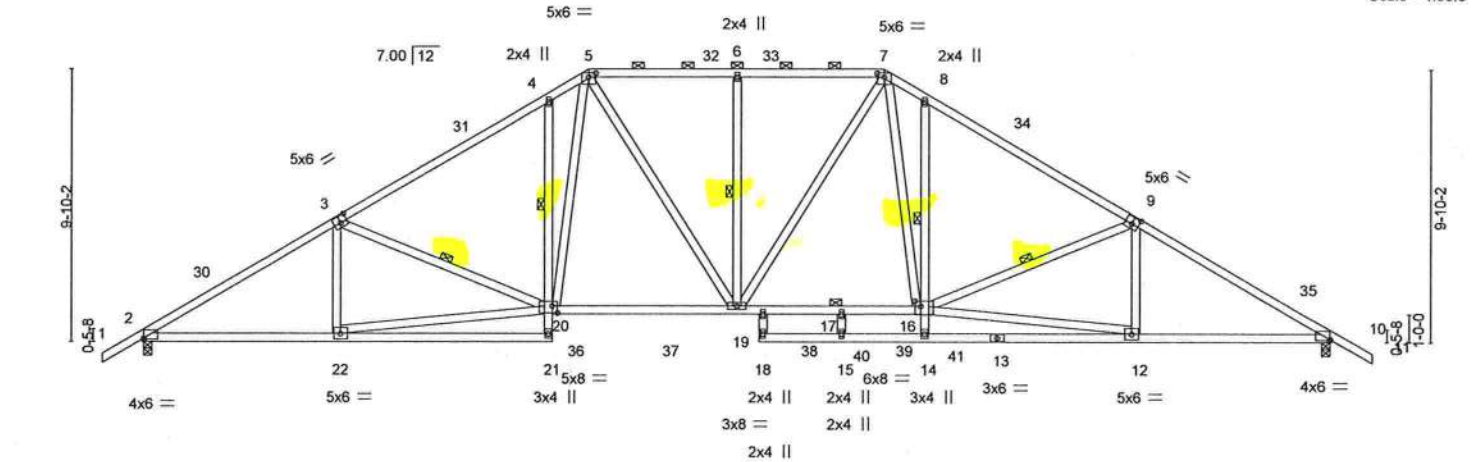


Plate Offsets (X,Y) - [2:0-0-0,0-0-8], [3:0-3-0,0-3-0], [5:0-3-0,0-1-12], [7:0-3-0,0-1-12], [9:0-3-0,0-3-0], [10:0-0-0,0-0-8], [16:0-2-8,0-2-4], [20:0-2-4,0-3-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25		TC 0.72	Vert(LL) -0.54	18	>945	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25		BC 0.89	Vert(CT) -0.96	18	>537	180		
BCLL 0.0 *	Rep Stress Incr YES		WB 0.92	Horz(CT) 0.18	10	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS						
								Weight: 300 lb	FT = 20%

LUMBER-	BRACING-	
TOP CHORD 2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except 2-0-0 oc purlins (3-6-5 max.): 5-7.
BOT CHORD 2x4 SP No.2 *Except* 4-21,8-14: 2x4 SP No.3, 16-20: 2x4 SP M 31	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing. Except: 1 Row at midpt 4-20
WEBS 2x4 SP No.3 *Except* 20-22,12-16: 2x4 SP No.2		6-0-0 oc bracing: 8-14
		10-0-0 oc bracing: 17-19
		1 Row at midpt 3-20, 6-19, 9-16
	WEBS JOINTS	1 Brace at Jt(s): 17

REACTIONS. (size) 2=0-3-8, 10=0-3-8
Max Horz 2=320(LC 10)
Max Uplift 2=641(LC 12), 10=639(LC 13)
Max Grav 2=1893(LC 2), 10=1926(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3117/967, 3-4=-2851/909, 4-5=-2833/1084, 5-6=-2478/791, 6-7=-2478/791, 7-8=-2943/1039, 8-9=-2958/865, 9-10=-3171/965
BOT CHORD 2-22=-905/2743, 4-20=-415/347, 19-20=-542/2228, 17-19=-399/2296, 16-17=-399/2296, 8-16=-416/345, 10-12=-687/2674
WEBS 20-22=-889/2598, 3-20=-402/290, 5-20=-545/1161, 5-19=-255/575, 6-19=-326/247, 7-19=-268/445, 7-16=-508/1309, 12-16=-637/2656, 9-16=-387/329

- NOTES-** (9)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 16-1-1, Exterior(2R) 16-1-1 to 20-4-0, Interior(1) 20-4-0 to 26-8-15, Exterior(2R) 26-8-15 to 30-11-13, Interior(1) 30-11-13 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=641, 10=639.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T19	Truss Type PIGGYBACK BASE	Qty 5	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987489
----------------	--------------	------------------------------	----------	----------	--

Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:26 2021 Page 1

ID: cExzFHCxHzHNjPCInbHOFZzN74p-bdz31A_WlImUQonlhEpcf_5j_NNL2EIEjk4PQzGJ2h

1-6-0	6-11-14	11-9-4	16-1-1	21-5-0	26-8-15	31-0-12	35-10-2	42-10-0	44-4-0
1-6-0	6-11-14	4-9-6	4-3-13	5-3-15	5-3-15	4-3-13	4-9-6	6-11-14	1-6-0

Scale = 1:77.1

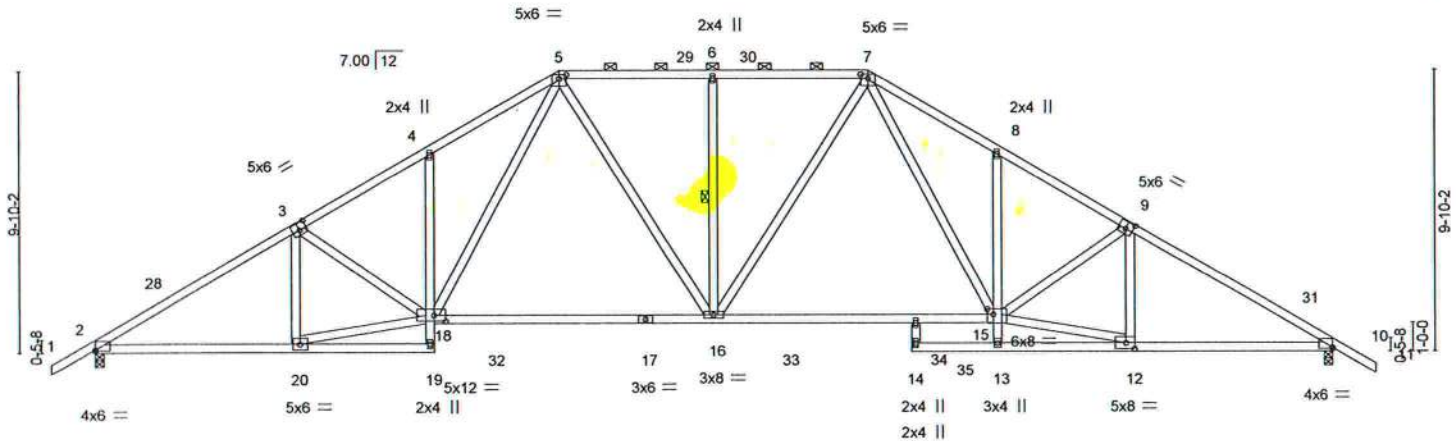


Plate Offsets (X,Y)=-	6-11-14	11-9-4	21-5-0	28-2-12	31-0-12	35-10-2	42-10-0
	6-11-14	4-9-6	9-7-12	6-9-12	2-10-0	4-9-6	6-11-14

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.53	Vert(LL)	-0.47 16-18	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.97	Vert(CT)	-0.80 16-18	>643	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.93	Horz(CT)	0.19 10	n/a	n/a		
BCDL 10.0	Code FBC2020/TPI2014		Matrix-MS					Weight: 275 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2 *Except*
4-19,8-13: 2x4 SP No.3, 15-17: 2x4 SP M 31
WEBS 2x4 SP No.3 *Except*
18-20,12-15: 2x4 SP No.2

REACTIONS.

(size) 2=0-3-8, 10=0-3-8
Max Horz 2=-320(LC 10)
Max Uplift 2=-644(LC 12), 10=-637(LC 13)
Max Grav 2=1872(LC 2), 10=1917(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3049/963, 3-4=-3129/1038, 4-5=-3144/1181, 5-6=-2425/792, 6-7=-2425/792,
7-8=-3278/1118, 8-9=-3264/975, 9-10=-3128/951
BOT CHORD 2-20=-895/2676, 4-18=-283/243, 16-18=-553/2169, 15-16=-409/2213, 8-15=-281/242,
10-12=-668/2633
WEBS 3-20=-373/209, 18-20=-866/2754, 5-18=-523/1250, 5-16=-253/593, 6-16=-325/250,
7-16=-266/510, 7-15=-474/1379, 12-15=-619/2800, 9-15=-145/256, 9-12=-427/153

NOTES- (9)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-6-0 to 1-6-0, Interior(1) 1-6-0 to 16-1-1, Exterior(2R) 16-1-1 to 20-4-0, Interior(1) 20-4-0 to 26-8-15, Exterior(2R) 26-8-15 to 31-3-6, Interior(1) 31-3-6 to 44-4-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load design covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=644, 10=637.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek


6904 Parke East Blvd.
Tampa, FL 33610

Job 2797533	Truss T20	Truss Type Hip Girder	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL	T23987490
Job Reference (optional)						


Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:28 2021 Page 1

ID: cExzFHCxHzHNjPCINbH0FZzN74p-X05pSs?mEM0Cg6w8pOHh44Oqn3cpX7bi1DBUJzGJ2f



Scale = 1:50.2

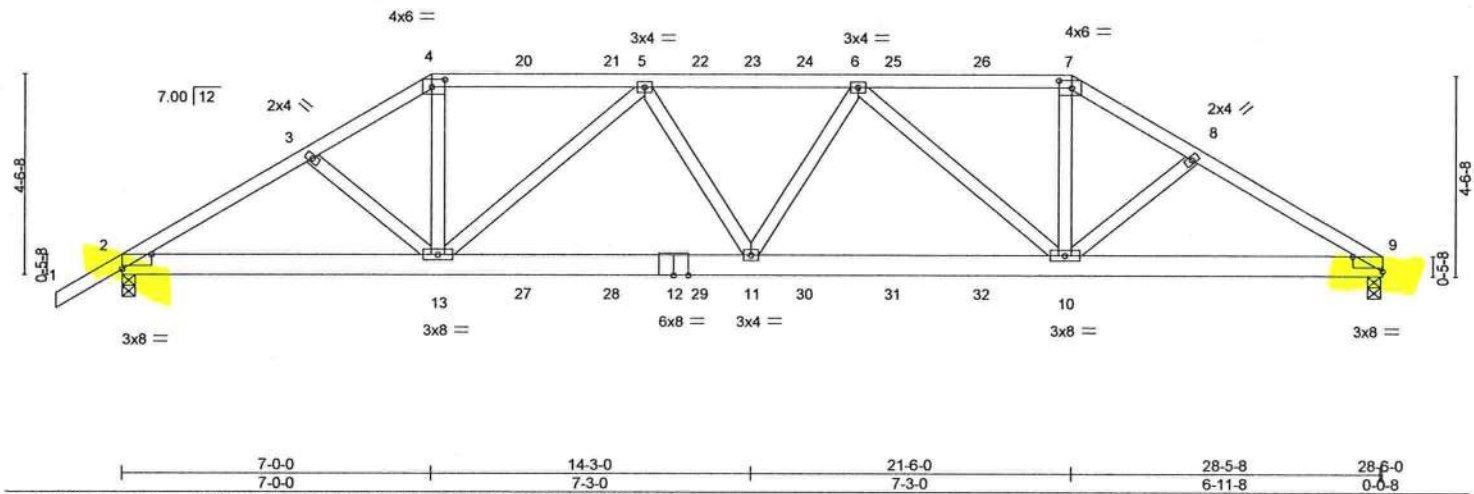

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.75	Vert(LL)	0.35 11-13 >967 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.92	Vert(CT)	-0.35 11-13 >982 180				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.96	Horz(CT)	-0.11 9 n/a n/a				
BCDL	10.0	Code FBC2020/TPI2014		Matrix-MS							
								Weight: 168 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 *Except* 4-7: 2x4 SP M 31	TOP CHORD	Structural wood sheathing directly applied or 2-9-5 oc purlins.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 3-9-13 oc bracing.
WEBS	2x4 SP No.3		

REACTIONS. (size) 9=0-3-8, 2=0-3-8
Max Horz 2=146(LC 5)
Max Uplift 9=1713(LC 4), 2=1733(LC 5)
Max Grav 9=2192(LC 1), 2=2277(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3959/3154, 3-4=-3813/3151, 4-5=-3321/2785, 5-6=-4395/3644, 6-7=-3331/2789,
7-8=-3825/3156, 8-9=-3974/3160
BOT CHORD 2-13=-2796/3362, 11-13=-3562/4255, 10-11=-3531/4258, 9-10=-2675/3377
WEBS 4-13=-1200/1466, 5-13=-1285/1105, 5-11=-254/418, 6-11=-252/416, 6-10=-1281/1103,
7-10=-1204/1474

- NOTES-** (10)
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp C; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=1713, 2=1733.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 235 lb down and 295 lb up at 7-0-0, 148 lb down and 144 lb up at 9-0-12, 148 lb down and 144 lb up at 11-0-12, 148 lb down and 144 lb up at 13-0-12, 148 lb down and 133 lb up at 14-3-0, 148 lb down and 144 lb up at 15-5-4, 148 lb down and 144 lb up at 17-5-4, and 148 lb down and 144 lb up at 19-5-4, and 235 lb down and 295 lb up at 21-6-0 on top chord, and 343 lb down and 404 lb up at 7-0-0, 91 lb down and 90 lb up at 9-0-12, 91 lb down and 90 lb up at 11-0-12, 91 lb down and 90 lb up at 13-0-12, 91 lb down and 90 lb up at 14-3-0, 91 lb down and 90 lb up at 15-5-4, 91 lb down and 90 lb up at 17-5-4, and 91 lb down and 90 lb up at 19-5-4, and 343 lb down and 404 lb up at 21-5-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
 - This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.



Joaquin Velez PE No.68182
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

May 18,2021

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Job 2797533	Truss T20	Truss Type Hip Girder	Qty 1	Ply 1	SIMQUE HOMES - LOT 56 PLL T23987490
Builders FirstSource (Jacksonville, FL), Jacksonville, FL - 32244,			Job Reference (optional)		

8.430 s Apr 20 2021 MiTek Industries, Inc. Sat May 15 08:38:28 2021 Page 2
ID:cExzFHCxHzHNjPCINbH0FZzN74p-X05pSs?mEM0Cg6w8pOHHh440qn3cpX7bi1DBUJzGJ2f

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-4=-54, 4-7=-54, 7-9=-54, 14-17=-20

Concentrated Loads (lb)

Vert: 4=-188(B) 7=-188(B) 13=-343(B) 11=-68(B) 10=-343(B) 20=-106(B) 21=-106(B) 22=-106(B) 23=-106(B) 24=-106(B) 25=-106(B) 26=-106(B) 27=-68(B)
28=-68(B) 29=-68(B) 30=-68(B) 31=-68(B) 32=-68(B)



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



6904 Parke East Blvd.
Tampa, FL 36610

Symbols

PLATE LOCATION AND ORIENTATION

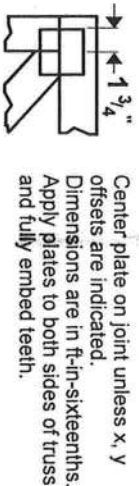

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITek 20/20 software or upon request.

PLATE SIZE


4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



BEARING




Industry Standards:

ANSI/TPI1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

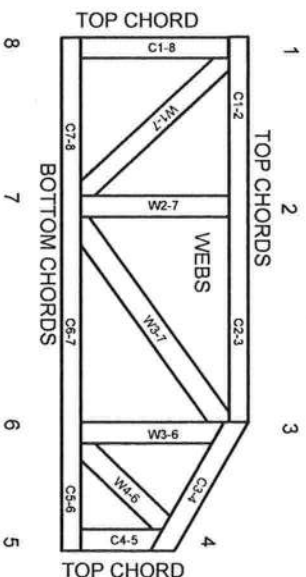

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and ware at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Gamber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

AUGUST 1, 2016

T-BRACE / I-BRACE DETAIL WITH 2X BRACE ONLY

MII-T-BRACE 2

MiTek USA, Inc. Page 1 of 1



Note: T-Bracing / I-Bracing to be used when continuous lateral bracing is impractical. T-Brace / I-Brace must cover 90% of web length.

Note: This detail NOT to be used to convert T-Brace / I-Brace webs to continuous lateral braced webs.

Nailing Pattern

T-Brace size	Nail Size	Nail Spacing
2x4 or 2x6 or 2x8	10d (0.131" X 3")	6" o.c.

Note: Nail along entire length of T-Brace / I-Brace
(On Two-Ply's Nail to Both Plies)

Brace Size
for One-Ply Truss

Specified Continuous
Rows of Lateral Bracing




Web Size	1	2
2x3 or 2x4	2x4 T-Brace	2x4 I-Brace
2x6	2x6 T-Brace	2x6 I-Brace
2x8	2x8 T-Brace	2x8 I-Brace

Brace Size
for Two-Ply Truss

Specified Continuous
Rows of Lateral Bracing

Web Size	1	2
2x3 or 2x4	2x4 T-Brace	2x4 I-Brace
2x6	2x6 T-Brace	2x6 I-Brace
2x8	2x8 T-Brace	2x8 I-Brace

T-Brace / I-Brace must be same species and grade (or better) as web member.

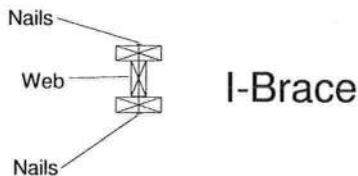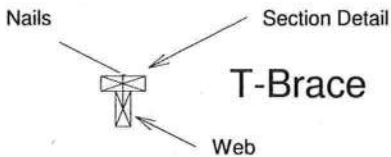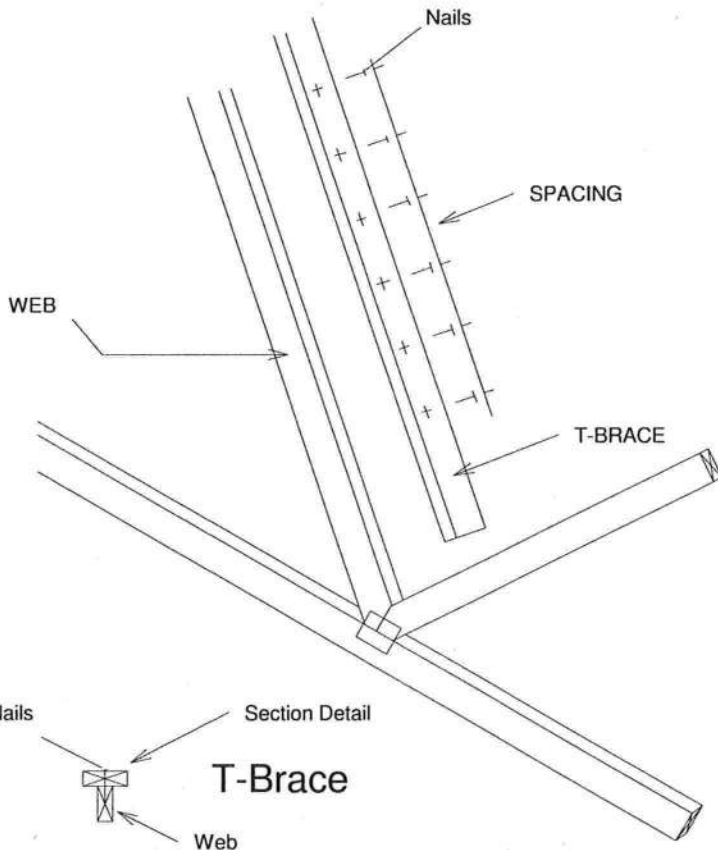


Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 12, 2018

AUGUST 1, 2016

SCAB-BRACE DETAIL

MII-SCAB-BRACE




MiTek USA, Inc.

Page 1 of 1


Note: Scab-Bracing to be used when continuous lateral bracing at midpoint (or T-Brace) is impractical.
Scab must cover full length of web +/- 6".

*** THIS DETAIL IS NOT APPLICABLE WHEN BRACING IS REQUIRED AT 1/3 POINTS OR I-BRACE IS SPECIFIED.

APPLY 2x SCAB TO ONE FACE OF WEB WITH
2 ROWS OF 10d (0.131" X 3") NAILS SPACED 6" O.C.
SCAB MUST BE THE SAME GRADE, SIZE AND
SPECIES (OR BETTER) AS THE WEB.

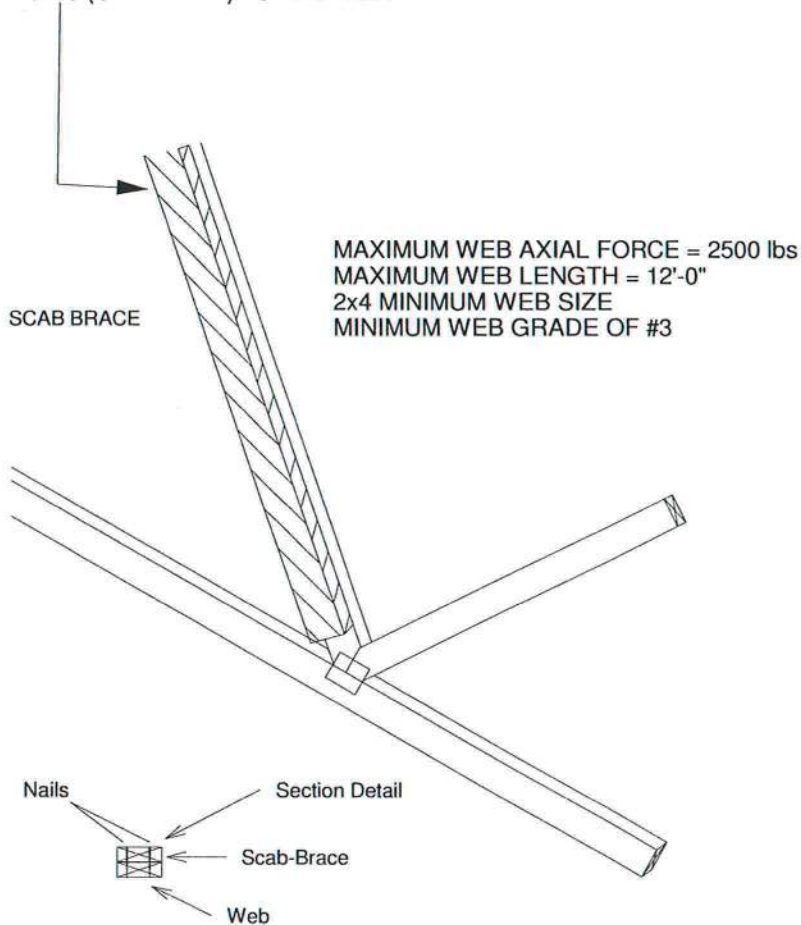


Scab-Brace must be same species grade (or better) as web member.

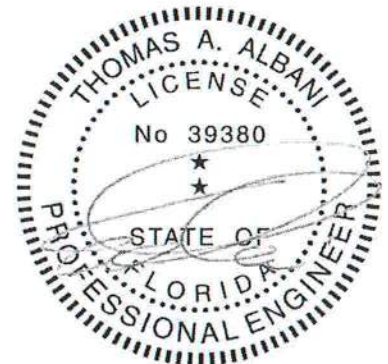


Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


February 12, 2018




1. THIS IS A SPECIFIC REPAIR DETAIL TO BE USED ONLY FOR ITS ORIGINAL INTENTION. THIS REPAIR DOES NOT IMPLY THAT THE REMAINING PORTION OF THE TRUSS IS UNDAMAGED. THE ENTIRE TRUSS SHALL BE INSPECTED TO VERIFY THAT NO FURTHER REPAIRS ARE REQUIRED. WHEN THE REQUIRED REPAIRS ARE PROPERLY APPLIED, THE TRUSS WILL BE CAPABLE OF SUPPORTING THE LOADS INDICATED.
2. ALL MEMBERS MUST BE RETURNED TO THEIR ORIGINAL POSITIONS BEFORE APPLYING REPAIR AND HELD IN PLACE DURING APPLICATION OF REPAIR.
3. THE END DISTANCE, EDGE DISTANCE, AND SPACING OF NAILS SHALL BE SUCH AS TO AVOID SPLITTING OF THE WOOD.
4. LUMBER MUST BE CUT CLEANLY AND ACCURATELY AND THE REMAINING WOOD MUST BE UNDAMAGED.
5. THIS REPAIR IS TO BE USED FOR SINGLE PLY TRUSSES IN THE 4X ORIENTATION ONLY.
6. CONNECTOR PLATES MUST BE FULLY IMBEDDED AND UNDISTURBED.

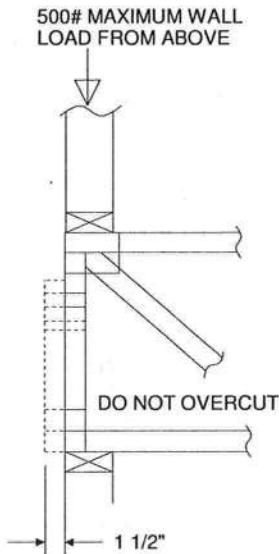

REFER TO INDIVIDUAL
TRUSS DESIGN FOR
PLATE SIZES AND
LUMBER GRADES

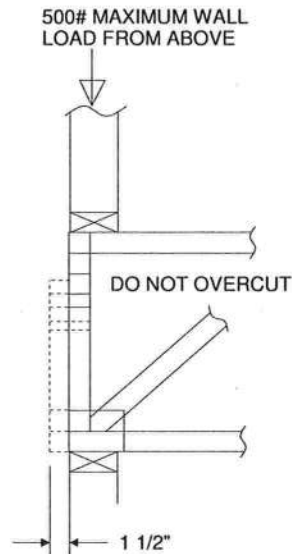

TRUSSES BUILT
WITH 4x2 MEMBERS

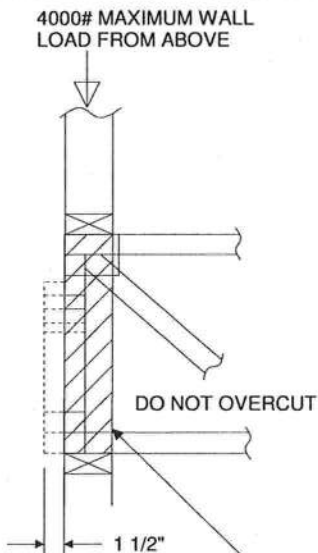


REFER TO INDIVIDUAL
TRUSS DESIGN FOR
PLATE SIZES AND
LUMBER GRADES



TRUSSES BUILT
WITH 4x2 MEMBERS

ATTACH 2x4 SQUASH BLOCK (CUT TO FIT TIGHTLY)
TO BOTH SIDES OF THE TRUSS AS SHOWN WITH
10d (0.131" X 3") NAILS SPACED 3" O.C.

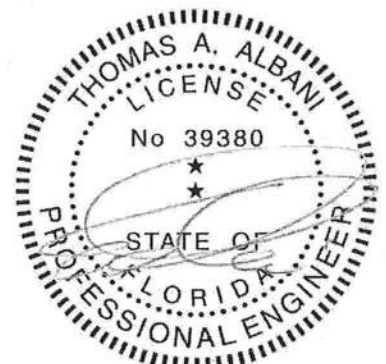

Thomas A. Albani PE No. 39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:





February 12, 2018

AUGUST 1, 2016

Standard Gable End Detail

MII-GE130-D-SP

MiTek USA, Inc. Page 1 of 2

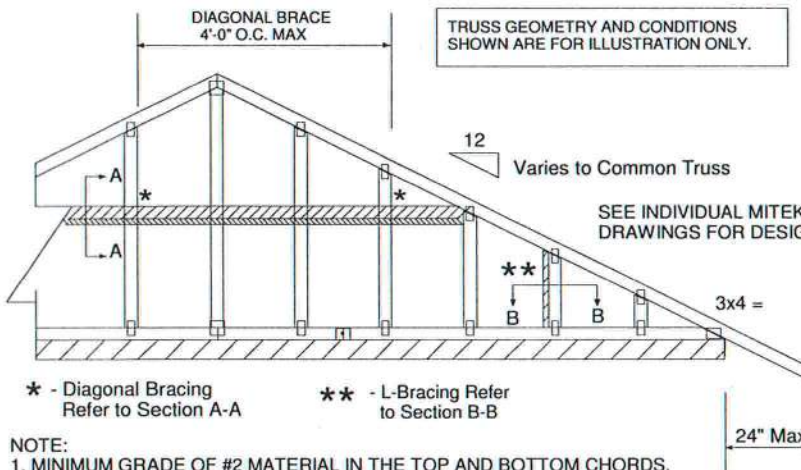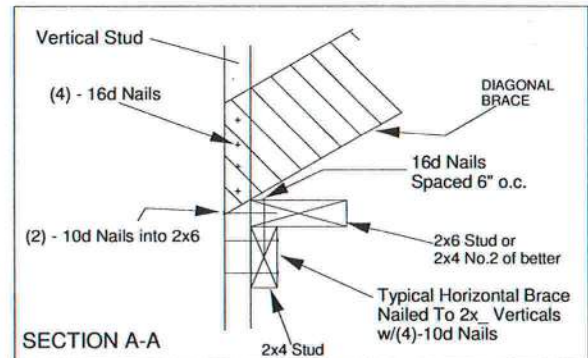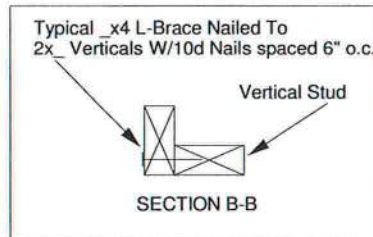

NOTE:



1. MINIMUM GRADE OF #2 MATERIAL IN THE TOP AND BOTTOM CHORDS.
2. CONNECTION BETWEEN BOTTOM CHORD OF GABLE END TRUSS AND WALL TO BE PROVIDED BY PROJECT ENGINEER OR ARCHITECT.
3. BRACING SHOWN IS FOR INDIVIDUAL TRUSS ONLY. CONSULT BLDG. ARCHITECT OR ENGINEER FOR TEMPORARY AND PERMANENT BRACING OF ROOF SYSTEM.
4. "L" BRACES SPECIFIED ARE TO BE FULL LENGTH. GRADES: 1x4 SRB OR 2x4 STUD OR BETTER WITH ONE ROW OF 10d NAILS SPACED 6" O.C.
5. DIAGONAL BRACE TO BE APPROXIMATELY 45 DEGREES TO ROOF DIAPHRAM AT 4'-0" O.C.
6. CONSTRUCT HORIZONTAL BRACE CONNECTING A 2x6 STUD AND A 2x4 STUD AS SHOWN WITH 16d NAILS SPACED 6" O.C. HORIZONTAL BRACE TO BE LOCATED AT THE MIDSPAN OF THE LONGEST STUD. ATTACH TO VERTICAL STUDS WITH (4) 10d NAILS THROUGH 2x4. (REFER TO SECTION A-A)
7. GABLE STUD DEFLECTION MEETS OR EXCEEDS L/240.
8. THIS DETAIL DOES NOT APPLY TO STRUCTURAL GABLES.
9. DO NOT USE FLAT BOTTOM CHORD GABLES NEXT TO SCISSOR TYPE TRUSSES.
10. SOUTHERN PINE LUMBER DESIGN VALUES ARE THOSE EFFECTIVE 06-01-13 BY SPIB/ALSC.
11. NAILS DESIGNATED 10d ARE (0.131" X 3") AND NAILS DESIGNATED 16d ARE (0.131" X 3.5")

Minimum Stud Size Species and Grade	Stud Spacing	Without Brace					2 DIAGONAL BRACES AT 1/3 POINTS
		Without Brace	1x4 L-Brace	2x4 L-Brace	DIAGONAL BRACE		
2x4 SP No. 3 / Stud	12" O.C.	3-9-13	4-1-1	5-9-6	7-1-3		11-5-7
2x4 SP No. 3 / Stud	16" O.C.	3-5-4	3-6-8	5-0-2	6-10-8		10-3-13
2x4 SP No. 3 / Stud	24" O.C.	2-9-11	2-10-11	4-1-1	5-7-6		8-5-1

- * Diagonal braces over 6'-3" require a 2x4 T-Brace attached to one edge. Diagonal braces over 12'-6" require 2x4 l-braces attached to both edges. Fasten T and l braces to narrow edge of diagonal brace with 10d nails 8" o.c., with 3" minimum end distance. Brace must cover 90% of diagonal length.





MAX MEAN ROOF HEIGHT = 30 FEET
CATEGORY II BUILDING
EXPOSURE D
ASCE 7-98, ASCE 7-02, ASCE 7-05 130 MPH
ASCE 7-10 160 MPH
DURATION OF LOAD INCREASE : 1.60

STUD DESIGN IS BASED ON COMPONENTS AND CLADDING.
CONNECTION OF BRACING IS BASED ON MWFRS.

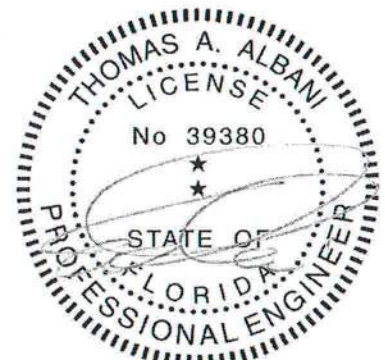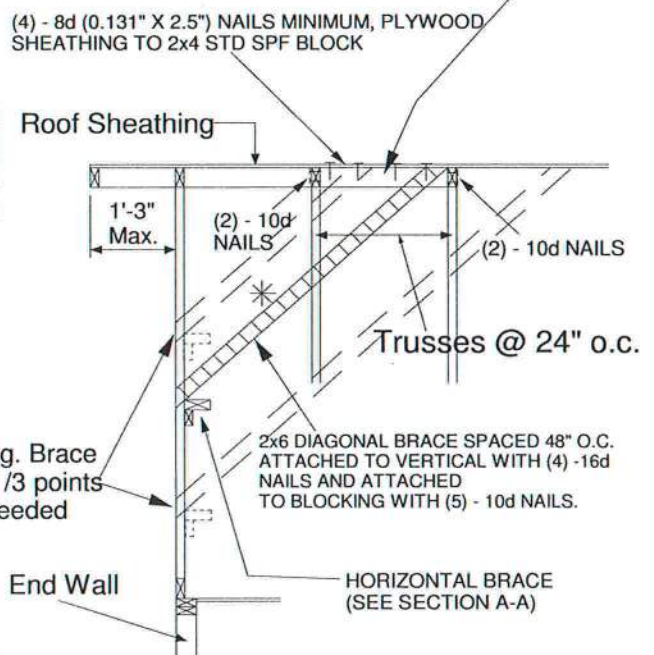

Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 12, 2018

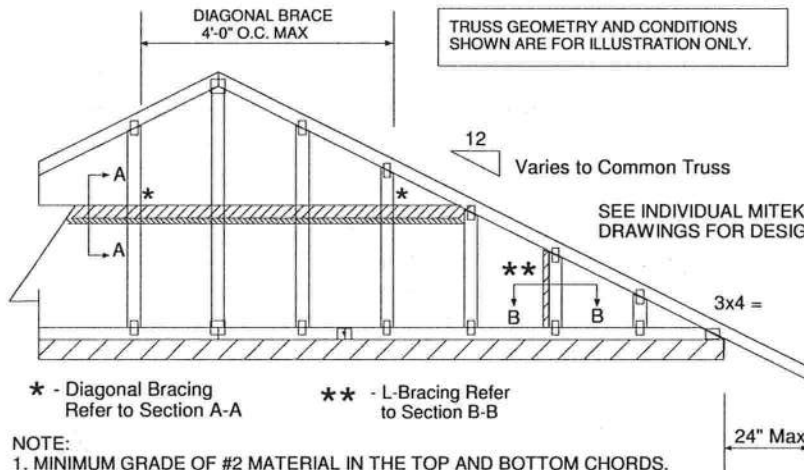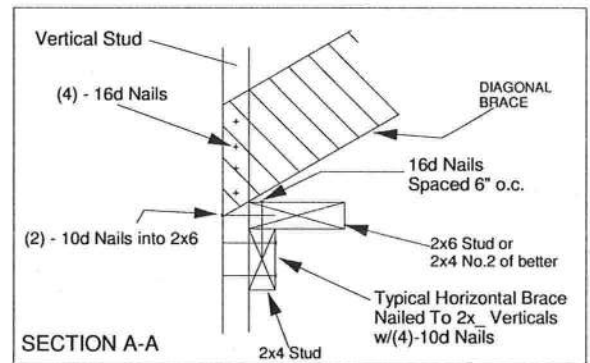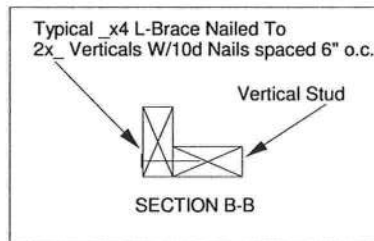


NOTE:

1. MINIMUM GRADE OF #2 MATERIAL IN THE TOP AND BOTTOM CHORDS.
2. CONNECTION BETWEEN BOTTOM CHORD OF GABLE END TRUSS AND WALL TO BE PROVIDED BY PROJECT ENGINEER OR ARCHITECT.
3. BRACING SHOWN IS FOR INDIVIDUAL TRUSS ONLY. CONSULT BLDG. ARCHITECT OR ENGINEER FOR TEMPORARY AND PERMANENT BRACING OF ROOF SYSTEM.
4. "L" BRACES SPECIFIED ARE TO BE FULL LENGTH. GRADES: 1x4 SRB OR 2x4 STUD OR BETTER WITH ONE ROW OF 10d NAILS SPACED 6" O.C.
5. DIAGONAL BRACE TO BE APPROXIMATELY 45 DEGREES TO ROOF DIAPHRAM AT 4'-0" O.C.
6. CONSTRUCT HORIZONTAL BRACE CONNECTING A 2x6 STUD AND A 2x4 STUD AS SHOWN WITH 16d NAILS SPACED 6" O.C. HORIZONTAL BRACE TO BE LOCATED AT THE MIDSPAN OF THE LONGEST STUD. ATTACH TO VERTICAL STUDS WITH (4) 10d NAILS THROUGH 2x4. (REFER TO SECTION A-A)
7. GABLE STUD DEFLECTION MEETS OR EXCEEDS L/240.
8. THIS DETAIL DOES NOT APPLY TO STRUCTURAL GABLES.
9. DO NOT USE FLAT BOTTOM CHORD GABLES NEXT TO SCISSOR TYPE TRUSSES.
10. SOUTHERN PINE LUMBER DESIGN VALUES ARE THOSE EFFECTIVE 06-01-13 BY SPIB/ALSC.
11. NAILS DESIGNATED 10d ARE (0.131" X 3") AND NAILS DESIGNATED 16d ARE (0.131" X 3.5")

PROVIDE 2x4 BLOCKING BETWEEN THE FIRST TWO TRUSSES AS NOTED. TOENAIL BLOCKING TO TRUSSES WITH (2) - 10d NAILS AT EACH END. ATTACH DIAGONAL BRACE TO BLOCKING WITH (5) - 10d NAILS.

(4) - 8d (0.131" X 2.5") NAILS MINIMUM, PLYWOOD SHEATHING TO 2x4 STD SPF BLOCK

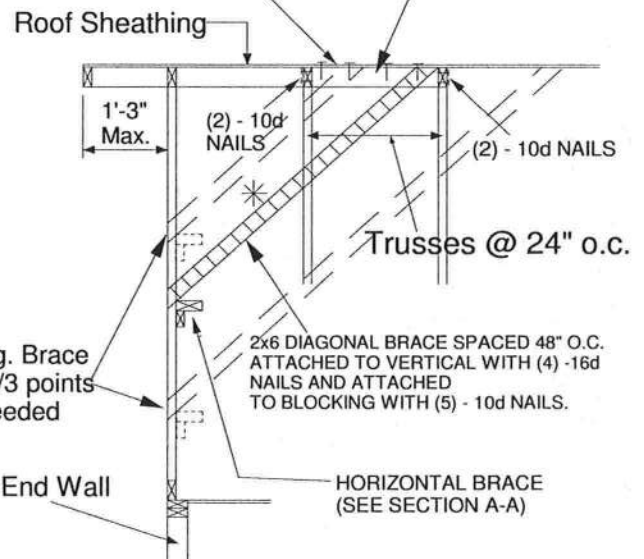

Minimum Stud Size Species and Grade	Stud Spacing	Without Brace	1x4	2x4	DIAGONAL BRACE	2 DIAGONAL BRACES AT 1/3 POINTS
			L-Brace	L-Brace		
Maximum Stud Length						
2x4 SP No. 3 / Stud	12" O.C.	4-0-7	4-5-6	6-3-8	8-0-15	12-1-6
2x4 SP No. 3 / Stud	16" O.C.	3-8-0	3-10-4	5-5-6	7-4-1	11-0-1
2x4 SP No. 3 / Stud	24" O.C.	3-0-10	3-1-12	4-5-6	6-1-5	9-1-15

- * Diagonal braces over 6'-3" require a 2x4 T-Brace attached to one edge. Diagonal braces over 12'-6" require 2x4 I-braces attached to both edges. Fasten T and I braces to narrow edge of diagonal brace with 10d nails 8" o.c., with 3" minimum end distance. Brace must cover 90% of diagonal length.





MAX MEAN ROOF HEIGHT = 30 FEET
CATEGORY II BUILDING
EXPOSURE B or C
ASCE 7-98, ASCE 7-02, ASCE 7-05 130 MPH
ASCE 7-10 160 MPH
DURATION OF LOAD INCREASE : 1.60

STUD DESIGN IS BASED ON COMPONENTS AND CLADDING.
CONNECTION OF BRACING IS BASED ON MWFRS.



Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 12, 2018

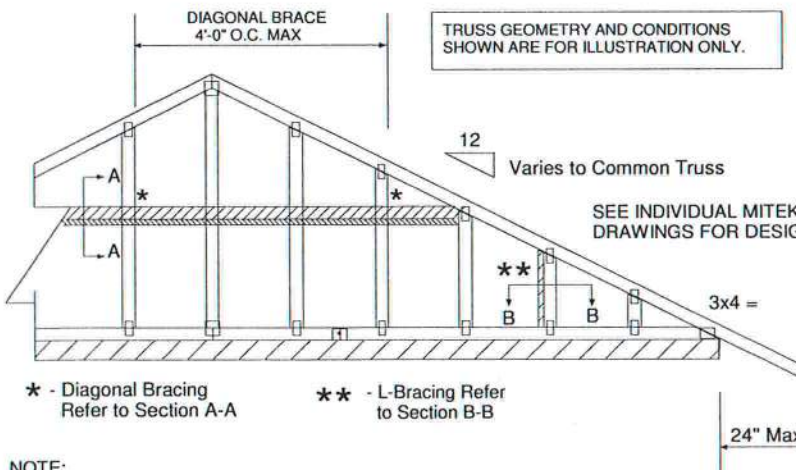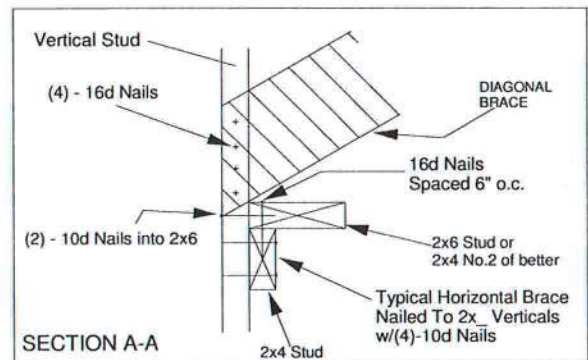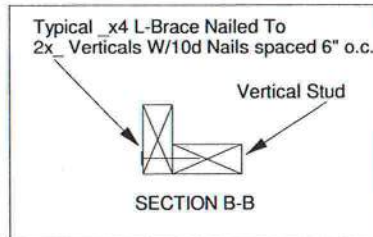


NOTE:

1. MINIMUM GRADE OF #2 MATERIAL IN THE TOP AND BOTTOM CHORDS.
2. CONNECTION BETWEEN BOTTOM CHORD OF GABLE END TRUSS AND WALL TO BE PROVIDED BY PROJECT ENGINEER OR ARCHITECT.
3. BRACING SHOWN IS FOR INDIVIDUAL TRUSS ONLY. CONSULT BLDG. ARCHITECT OR ENGINEER FOR TEMPORARY AND PERMANENT BRACING OF ROOF SYSTEM.
4. "L" BRACES SPECIFIED ARE TO BE FULL LENGTH. GRADES: 1x4 SRB OR 2x4 STUD OR BETTER WITH ONE ROW OF 10d NAILS SPACED 6" O.C.
5. DIAGONAL BRACE TO BE APPROXIMATELY 45 DEGREES TO ROOF DIAPHRAM AT 4'-0" O.C.
6. CONSTRUCT HORIZONTAL BRACE CONNECTING A 2x6 STUD AND A 2x4 STUD AS SHOWN WITH 16d NAILS SPACED 6" O.C. HORIZONTAL BRACE TO BE LOCATED AT THE MIDSPAN OF THE LONGEST STUD. ATTACH TO VERTICAL STUDS WITH (4) 10d NAILS THROUGH 2x4. (REFER TO SECTION A-A)
7. GABLE STUD DEFLECTION MEETS OR EXCEEDS 1/240.
8. THIS DETAIL DOES NOT APPLY TO STRUCTURAL GABLES.
9. DO NOT USE FLAT BOTTOM CHORD GABLES NEXT TO SCISSOR TYPE TRUSSES.
10. NAILS DESIGNATED 10d ARE (0.131" X 3") AND NAILS DESIGNATED 16d ARE (0.131" X 3.5")

PROVIDE 2x4 BLOCKING BETWEEN THE FIRST TWO TRUSSES AS NOTED. TOENAIL BLOCKING TO TRUSSES WITH (2) - 10d NAILS AT EACH END. ATTACH DIAGONAL BRACE TO BLOCKING WITH (5) - 10d NAILS.

(4) - 8d (0.131" X 2.5") NAILS MINIMUM, PLYWOOD SHEATHING TO 2x4 STD DF/SPF BLOCK

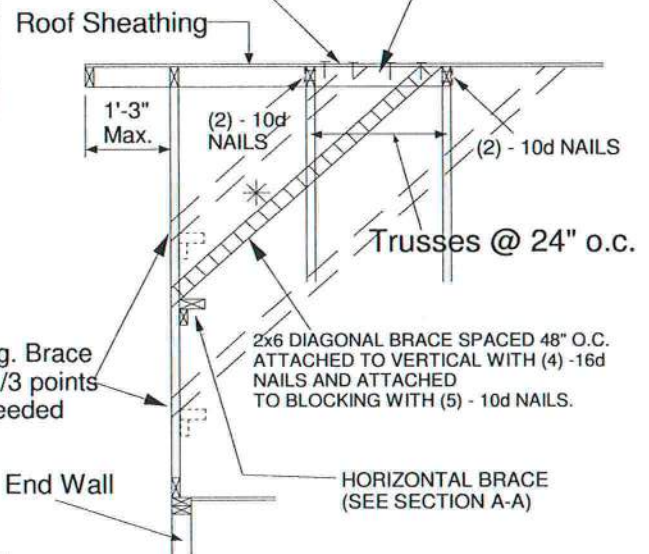

Minimum Stud Size Species and Grade	Stud Spacing	Without Brace	1x4 L-Brace	2x4 L-Brace	DIAGONAL BRACE	2 DIAGONAL BRACES AT 1/3 POINTS
		Maximum Stud Length				
2x4 DF/SPF Std/Stud	12" O.C.	3-10-1	3-11-7	5-7-2	7-8-2	11-6-4
2x4 DF/SPF Std/Stud	16" O.C.	3-3-14	3-5-1	4-10-2	6-7-13	9-11-11
2x4 DF/SPF Std/Stud	24" O.C.	2-8-9	2-9-8	3-11-7	5-5-2	8-1-12

- * Diagonal braces over 6'-3" require a 2x4 T-Brace attached to one edge. Diagonal braces over 12'-6" require 2x4 I-braces attached to both edges. Fasten T and I braces to narrow edge of web with 10d nails 8" o.c., with 3" minimum end distance. Brace must cover 90% of diagonal length.


MAXIMUM WIND SPEED = 140 MPH
MAX MEAN ROOF HEIGHT = 30 FEET
CATEGORY II BUILDING
EXPOSURE B or C
ASCE 7-98, ASCE 7-02, ASCE 7-05
DURATION OF LOAD INCREASE : 1.60

STUD DESIGN IS BASED ON COMPONENTS AND CLADDING.
CONNECTION OF BRACING IS BASED ON MWFRS.



Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

January 19, 2018



MiTek USA, Inc.

ENGINEERED BY
TRENCO
A MiTek AffiliateTypical 2x4 L-Brace Nailed To
2x4 Verticals W/10d Nails spaced 6" o.c.

Vertical Stud

SECTION B-B

TRUSS GEOMETRY AND CONDITIONS
SHOWN ARE FOR ILLUSTRATION ONLY.

Varies to Common Truss

SEE INDIVIDUAL MITEK ENGINEERING
DRAWINGS FOR DESIGN CRITERIA


3x4 =

24" Max

* - Diagonal Bracing
Refer to Section A-A** - L-Bracing Refer
to Section B-B

NOTE:

1. MINIMUM GRADE OF #2 MATERIAL IN THE TOP AND BOTTOM CHORDS.
2. CONNECTION BETWEEN BOTTOM CHORD OF GABLE END TRUSS AND WALL TO BE PROVIDED BY PROJECT ENGINEER OR ARCHITECT.
3. BRACING SHOWN IS FOR INDIVIDUAL TRUSS ONLY. CONSULT BLDG. ARCHITECT OR ENGINEER FOR TEMPORARY AND PERMANENT BRACING OF ROOF SYSTEM.
4. "L" BRACES SPECIFIED ARE TO BE FULL LENGTH, SPF or SP No.3 OR BETTER WITH ONE ROW OF 10d NAILS SPACED 6" O.C.
5. DIAGONAL BRACE TO BE APPROXIMATELY 45 DEGREES TO ROOF DIAPHRAM AT 4'-0" O.C.
6. CONSTRUCT HORIZONTAL BRACE CONNECTING A 2x6 AND A 2x4 AS SHOWN WITH 16d NAILS SPACED 6" O.C. HORIZONTAL BRACE TO BE LOCATED AT THE MIDSPAN OF THE LONGEST GABLE STUD. ATTACH TO VERTICAL GABLE STUDS WITH (4) 10d NAILS THROUGH 2x4. (REFER TO SECTION A-A)
7. GABLE STUD DEFLECTION MEETS OR EXCEEDS L/240.
8. THIS DETAIL DOES NOT APPLY TO STRUCTURAL GABLES.
9. DO NOT USE FLAT BOTTOM CHORD GABLES NEXT TO SCISSOR TYPE TRUSSES.
10. SOUTHERN PINE LUMBER DESIGN VALUES ARE THOSE EFFECTIVE 06-01-13 BY SPIB/ALSC.
11. NAILS DESIGNATED 10d ARE (0.131" X 3") AND NAILS DESIGNATED 16d ARE (0.131" X 3.5")

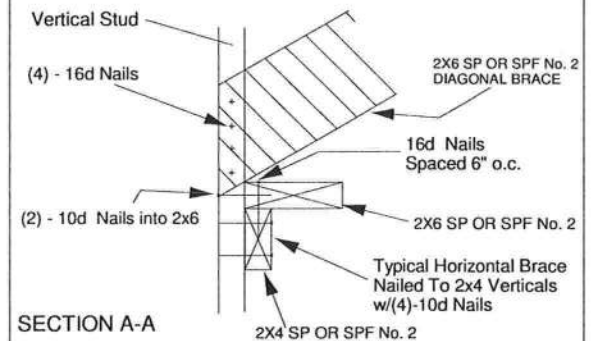

SECTION A-A

PROVIDE 2x4 BLOCKING BETWEEN THE FIRST TWO TRUSSES AS NOTED. TOENAIL BLOCKING TO TRUSSES WITH (2) - 10d NAILS AT EACH END. ATTACH DIAGONAL BRACE TO BLOCKING WITH (5) - 10d NAILS.

(4) - 8d (0.131" X 2.5") NAILS MINIMUM, PLYWOOD SHEATHING TO 2x4 STD SPF BLOCK

Roof Sheathing

Diag. Brace at 1/3 points if needed

End Wall

Trusses @ 24" o.c.

2x6 DIAGONAL BRACE SPACED 48" O.C. ATTACHED TO VERTICAL WITH (4) - 16d NAILS, AND ATTACHED TO BLOCKING WITH (5) - 10d NAILS.

HORIZONTAL BRACE (SEE SECTION A-A)

Minimum Stud Size Species and Grade	Stud Spacing	Without Brace	2x4 L-Brace	DIAGONAL BRACE	2 DIAGONAL BRACES AT 1/3 POINTS
Maximum Stud Length					
2x4 SP No. 3 / Stud	12" O.C.	3-9-7	5-8-8	6-11-1	11-4-4
2x4 SP No. 3 / Stud	16" O.C.	3-4-12	4-11-15	6-9-8	10-2-3
2x4 SP No. 3 / Stud	24" O.C.	2-9-4	4-0-7	5-6-8	8-3-13
2x4 SP No. 2	12" O.C.	3-11-13	5-8-8	6-11-1	11-11-7
2x4 SP No. 2	16" O.C.	3-7-7	4-11-5	6-11-1	10-10-5
2x4 SP No. 2	24" O.C.	3-1-15	4-0-7	6-3-14	9-5-14

* Diagonal braces over 6'-3" require a 2x4 T-Brace attached to one edge. Diagonal braces over 12'-6" require 2x4 I-braces attached to both edges. Fasten T and I braces to narrow edge of diagonal brace with 10d nails 6" o.c., with 3" minimum end distance. Brace must cover 90% of diagonal length. T or I braces must be 2x4 SPF No. 2 or SP No. 2.

MAX MEAN ROOF HEIGHT = 30 FEET
EXPOSURE D
ASCE 7-10 170 MPH
DURATION OF LOAD INCREASE : 1.60

STUD DESIGN IS BASED ON COMPONENTS AND CLADDING.
CONNECTION OF BRACING IS BASED ON MWFRS.



Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


February 12, 2018

AUGUST 1, 2016

Standard Gable End Detail

MII-GE180-D-SP

MiTek USA, Inc. Page 1 of 2



MiTek USA, Inc.

ENGINEERED BY
TRENCO

A MiTek Affiliate

DIAGONAL BRACE
4'-0" O.C. MAXTypical 2x4 L-Brace Nailed To
2x4 Verticals W/10d Nails spaced 6" o.c.

Vertical Stud

SECTION B-B

TRUSS GEOMETRY AND CONDITIONS
SHOWN ARE FOR ILLUSTRATION ONLY.12
Varies to Common TrussSEE INDIVIDUAL MITEK ENGINEERING
DRAWINGS FOR DESIGN CRITERIA

3x4 =

24" Max

* - Diagonal Bracing
Refer to Section A-A** - L-Bracing Refer
to Section B-B

NOTE:


1. MINIMUM GRADE OF #2 MATERIAL IN THE TOP AND BOTTOM CHORDS.
2. CONNECTION BETWEEN BOTTOM CHORD OF GABLE END TRUSS AND WALL TO BE PROVIDED BY PROJECT ENGINEER OR ARCHITECT.
3. BRACING SHOWN IS FOR INDIVIDUAL TRUSS ONLY. CONSULT BLDG. ARCHITECT OR ENGINEER FOR TEMPORARY AND PERMANENT BRACING OF ROOF SYSTEM.
4. "L" BRACES SPECIFIED ARE TO BE FULL LENGTH, SPF or SP No.3 OR BETTER WITH ONE ROW OF 10d NAILS SPACED 6" O.C.
5. DIAGONAL BRACE TO BE APPROXIMATELY 45 DEGREES TO ROOF DIAPHRAM AT 4'-0" O.C.
6. CONSTRUCT HORIZONTAL BRACE CONNECTING A 2x6 AND A 2x4 AS SHOWN WITH 16d NAILS SPACED 6" O.C. HORIZONTAL BRACE TO BE LOCATED AT THE MIDSPAN OF THE LONGEST GABLE STUD. ATTACH TO VERTICAL GABLE STUDS WITH (4) 10d NAILS THROUGH 2x4. (REFER TO SECTION A-A)
7. GABLE STUD DEFLECTION MEETS OR EXCEEDS L/240.
8. THIS DETAIL DOES NOT APPLY TO STRUCTURAL GABLES.
9. DO NOT USE FLAT BOTTOM CHORD GABLES NEXT TO SCISSOR TYPE TRUSSES.
10. SOUTHERN PINE LUMBER DESIGN VALUES ARE THOSE EFFECTIVE 06-01-13 BY SPIB/ALSC.
11. NAILS DESIGNATED 10d ARE (0.131" X 3") AND NAILS DESIGNATED 16d ARE (0.131" X 3.5")

Minimum Stud Size Species and Grade	Stud Spacing	Without Brace	2x4 L-Brace	DIAGONAL BRACE	2 DIAGONAL BRACES AT 1/3 POINTS
		Maximum Stud Length			
2x4 SP No. 3 / Stud	12" O.C.	3-7-12	5-4-11	6-2-1	10-11-3
2x4 SP No. 3 / Stud	16" O.C.	3-2-8	4-8-1	6-2-1	9-7-7
2x4 SP No. 3 / Stud	24" O.C.	2-7-7	3-9-12	5-2-13	7-10-4
2x4 SP No. 2	12" O.C.	3-10-0	5-4-11	6-2-1	11-6-1
2x4 SP No. 2	16" O.C.	3-5-13	4-8-1	6-2-1	10-5-7
2x4 SP No. 2	24" O.C.	3-0-8	3-9-12	6-1-1	9-1-9

- * Diagonal braces over 6'-3" require a 2x4 T-Brace attached to one edge. Diagonal braces over 12'-6" require 2x4 I-braces attached to both edges. Fasten T and I braces to narrow edge of diagonal brace with 10d nails 6in o.c., with 3in minimum end distance. Brace must cover 90% of diagonal length. T or I braces must be 2x4 SPF No. 2 or SP No. 2.

MAX MEAN ROOF HEIGHT = 30 FEET
EXPOSURE D
ASCE 7-10 180 MPH
DURATION OF LOAD INCREASE : 1.60



STUD DESIGN IS BASED ON COMPONENTS AND CLADDING.
CONNECTION OF BRACING IS BASED ON MWFRS.

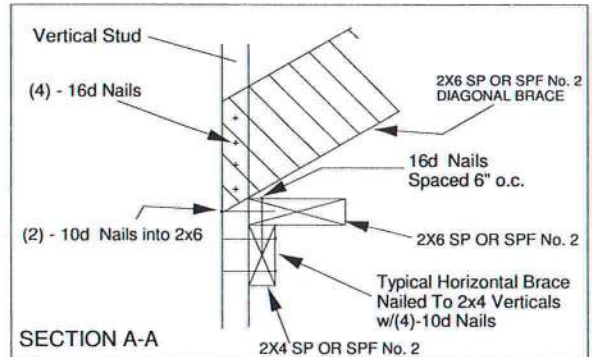

PROVIDE 2x4 BLOCKING BETWEEN THE FIRST TWO TRUSSES AS NOTED. TOENAIL BLOCKING TO TRUSSES WITH (2) - 10d NAILS AT EACH END. ATTACH DIAGONAL BRACE TO BLOCKING WITH (5) - 10d NAILS.

(4) - 8d (0.131" X 2.5") NAILS MINIMUM, PLYWOOD SHEATHING TO 2x4 STD SPF BLOCK

Roof Sheathing

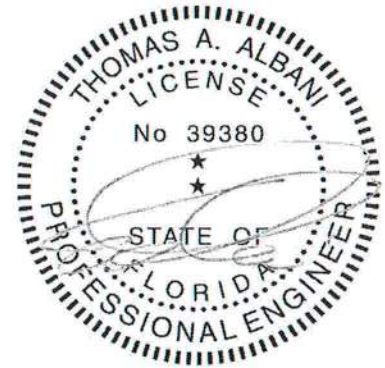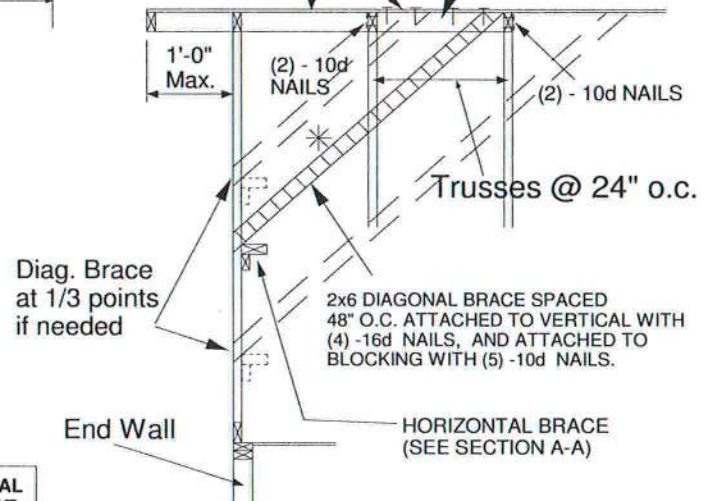

Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 12, 2018

AUGUST 1, 2016

STANDARD PIGGYBACK TRUSS CONNECTION DETAIL

MII-PIGGY-7-10




MiTek USA, Inc. Page 1 of 1

MAXIMUM WIND SPEED = REFER TO NOTES D AND OR E
MAX MEAN ROOF HEIGHT = 30 FEET
MAX TRUSS SPACING = 24" O.C.
CATEGORY II BUILDING
EXPOSURE B or C
ASCE 7-10
DURATION OF LOAD INCREASE : 1.60

DETAIL IS NOT APPLICABLE FOR TRUSSES
TRANSFERING DRAG LOADS (SHEAR TRUSSES).
ADDITIONAL CONSIDERATIONS BY BUILDING
ENGINEER/DESIGNER ARE REQUIRED.


- A - PIGGYBACK TRUSS, REFER TO MITEK TRUSS DESIGN DRAWING. SHALL BE CONNECTED TO EACH PURLIN WITH (2) (0.131" X 3.5") TOE-NAILED.
- B - BASE TRUSS, REFER TO MITEK TRUSS DESIGN DRAWING.
- C - PURLINS AT EACH BASE TRUSS JOINT AND A MAXIMUM 24" O.C. UNLESS SPECIFIED CLOSER ON MITEK TRUSS DESIGN DRAWING. CONNECT TO BASE TRUSS WITH (2) (0.131" X 3.5") NAILS EACH.
- D - 2 X 4'-0" SCAB, SIZE TO MATCH TOP CHORD OF PIGGYBACK TRUSS, MIN GRADE #2, ATTACHED TO ONE FACE, CENTERED ON INTERSECTION, WITH (2) ROWS OF (0.131" X 3") NAILS @ 4" O.C. SCAB MAY BE OMITTED PROVIDED THE TOP CHORD SHEATHING IS CONTINUOUS OVER INTERSECTION AT LEAST 1 FT. IN BOTH DIRECTIONS AND:
1. WIND SPEED OF 115 MPH OR LESS FOR ANY PIGGYBACK SPAN, OR
 2. WIND SPEED OF 116 MPH TO 160 MPH WITH A MAXIMUM PIGGYBACK SPAN OF 12 ft.
- E - FOR WIND SPEEDS BETWEEN 126 AND 160 MPH, ATTACH MITEK 3X8 20 GA Nail-On PLATES TO EACH FACE OF TRUSSES AT 72" O.C. W/ (4) (0.131" X 1.5") NAILS PER MEMBER. STAGGER NAILS FROM OPPOSING FACES. ENSURE 0.5" EDGE DISTANCE. (MIN. 2 PAIRS OF PLATES REQ. REGARDLESS OF SPAN)

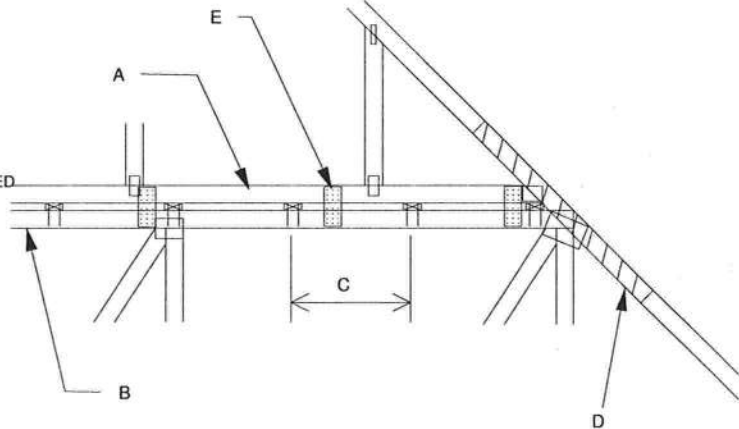


WHEN NO GAP BETWEEN PIGGYBACK AND BASE TRUSS EXISTS:

REPLACE TOE NAILING OF PIGGYBACK TRUSS TO PURLINS WITH Nail-On PLATES AS SHOWN, AND INSTALL PURLINS TO BOTTOM EDGE OF BASE TRUSS TOP CHORD AT SPECIFIED SPACING SHOWN ON BASE TRUSS MITEK DESIGN DRAWING.

SCAB CONNECTION PER
NOTE D ABOVE

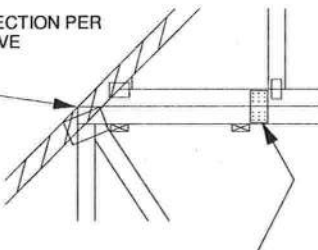


FOR ALL WIND SPEEDS, ATTACH MITEK 3X6 20 GA Nail-On PLATES TO EACH FACE OF TRUSSES AT 48" O.C. W/ (4) (0.131" X 1.5") PER MEMBER. STAGGER NAILS FROM OPPOSING FACES ENSURE 0.5" EDGE DISTANCE.

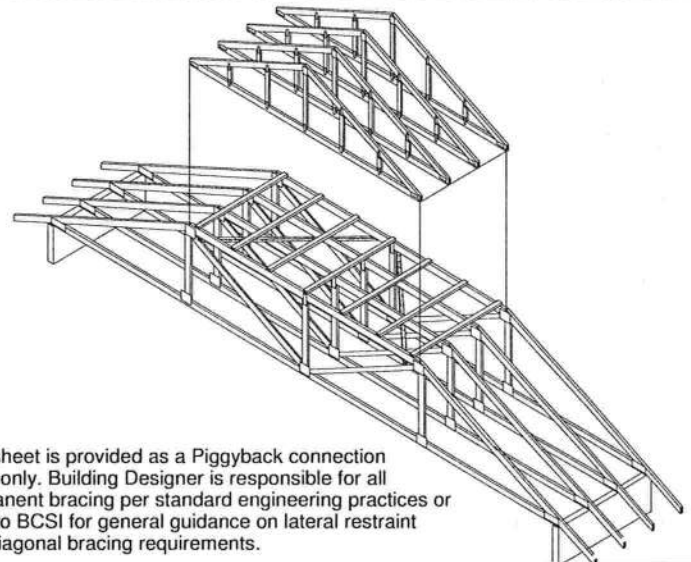

This sheet is provided as a Piggyback connection detail only. Building Designer is responsible for all permanent bracing per standard engineering practices or refer to BCSI for general guidance on lateral restraint and diagonal bracing requirements.

VERTICAL WEB TO
EXTEND THROUGH
BOTTOM CHORD
OF PIGGYBACK



FOR LARGE CONCENTRATED LOADS APPLIED
TO CAP TRUSS REQUIRING A VERTICAL WEB:

- 1) VERTICAL WEBS OF PIGGYBACK AND BASE TRUSS MUST MATCH IN SIZE, GRADE, AND MUST LINE UP AS SHOWN IN DETAIL.
- 2) ATTACH 2 x 4'-0" SCAB TO EACH FACE OF TRUSS ASSEMBLY WITH 2 ROWS OF 10d (0.131" X 3") NAILS SPACED 4" O.C. FROM EACH FACE. (SIZE AND GRADE TO MATCH VERTICAL WEBS OF PIGGYBACK AND BASE TRUSS.) (MINIMUM 2X4)
- 3) THIS CONNECTION IS ONLY VALID FOR A MAXIMUM CONCENTRATED LOAD OF 4000 LBS (@1.15). REVIEW BY A QUALIFIED ENGINEER IS REQUIRED FOR LOADS GREATER THAN 4000 LBS.
- 4) FOR PIGGYBACK TRUSSES CARRYING GIRDER LOADS, NUMBER OF PLYS OF PIGGYBACK TRUSS TO MATCH BASE TRUSS.
- 5) CONCENTRATED LOAD MUST BE APPLIED TO BOTH THE PIGGYBACK AND THE BASE TRUSS DESIGN.



Thomas A. Albani PE No. 39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


February 12, 2018

AUGUST 1, 2016

STANDARD PIGGYBACK TRUSS CONNECTION DETAIL

MII-PIGGY-ALT
7-10

MiTek USA, Inc. Page 1 of 1




MiTek USA, Inc.



MAXIMUM WIND SPEED = REFER TO NOTES D AND OR E
MAX MEAN ROOF HEIGHT = 30 FEET
MAX TRUSS SPACING = 24" O.C.
CATEGORY II BUILDING
EXPOSURE B or C
ASCE 7-10
DURATION OF LOAD INCREASE : 1.60

DETAIL IS NOT APPLICABLE FOR TRUSSES
TRANSFERING DRAG LOADS (SHEAR TRUSSES).
ADDITIONAL CONSIDERATIONS BY BUILDING
ENGINEER/DESIGNER ARE REQUIRED.


- A - PIGGYBACK TRUSS, REFER TO MITEK TRUSS DESIGN DRAWING.
SHALL BE CONNECTED TO EACH PURLIN
WITH (2) 0(0.131" X 3.5") TOE-NAILED.
- B - BASE TRUSS, REFER TO MITEK TRUSS DESIGN DRAWING.
- C - PURLINS AT EACH BASE TRUSS JOINT AND A MAXIMUM 24" O.C.
UNLESS SPECIFIED CLOSER ON MITEK TRUSS DESIGN DRAWING.
CONNECT TO BASE TRUSS WITH (2) (0.131" X 3.5") NAILS EACH.
- D - 2 X ____ X 4'-0" SCAB, SIZE TO MATCH TOP CHORD OF
PIGGYBACK TRUSS, MIN GRADE #2, ATTACHED TO ONE FACE, CENTERED ON
INTERSECTION, WITH (2) ROWS OF (0.131" X 3") NAILS @ 4" O.C.
SCAB MAY BE OMITTED PROVIDED THE TOP CHORD SHEATHING
IS CONTINUOUS OVER INTERSECTION AT LEAST 1 FT. IN BOTH
DIRECTIONS AND:
1. WIND SPEED OF 115 MPH OR LESS FOR ANY PIGGYBACK SPAN, OR
 2. WIND SPEED OF 116 MPH TO 160 MPH WITH A MAXIMUM
PIGGYBACK SPAN OF 12 FT.
- E - FOR WIND SPEED IN THE RANGE 126 MPH - 160 MPH
ADD 9" x 9" x 1/2" PLYWOOD (or 7/16" OSB) GUSSET
EACH SIDE AT 48" O.C. OR LESS. ATTACH WITH
3 - 6d (0.113" X 2") NAILS INTO EACH CHORD FROM
EACH SIDE (TOTAL - 12 NAILS)

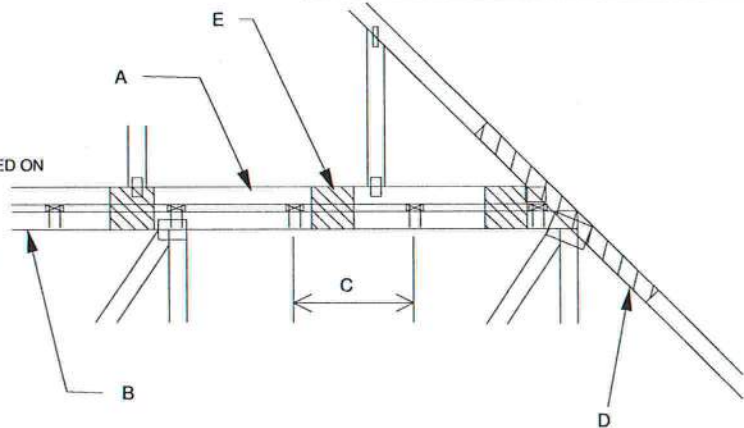


WHEN NO GAP BETWEEN PIGGYBACK AND BASE TRUSS EXISTS:

REPLACE TOE NAILING OF PIGGYBACK TRUSS TO PURLINS WITH PLYWOOD
GUSSETS AS SHOWN, AND INSTALL PURLINS TO BOTTOM EDGE OF BASE
TRUSS TOP CHORD AT SPECIFIED SPACING SHOWN ON BASE
TRUSS MITEK DESIGN DRAWING.

SCAB CONNECTION PER
NOTE D ABOVE

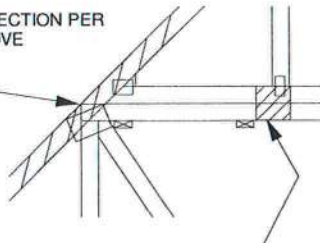


7" x 7" x 1/2" PLYWOOD (or 7/16" OSB) GUSSET EACH SIDE AT 24" O.C.
ATTACH WITH 3 - 6d (0.113" X 2") NAILS INTO EACH CHORD
FROM EACH SIDE (TOTAL - 12 NAILS)

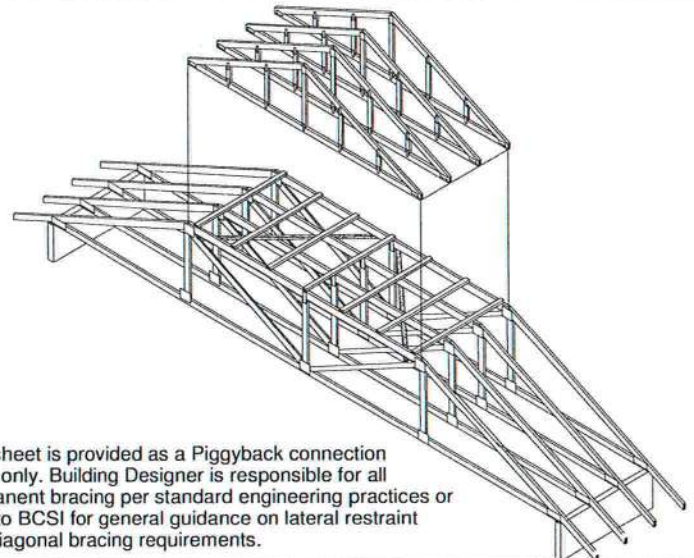


This sheet is provided as a Piggyback connection
detail only. Building Designer is responsible for all
permanent bracing per standard engineering practices or
refer to BCSI for general guidance on lateral restraint
and diagonal bracing requirements.

VERTICAL WEB TO
EXTEND THROUGH
BOTTOM CHORD
OF PIGGYBACK



FOR LARGE CONCENTRATED LOADS APPLIED
TO CAP TRUSS REQUIRING A VERTICAL WEB:

- 1) VERTICAL WEBS OF PIGGYBACK AND BASE TRUSS
MUST MATCH IN SIZE, GRADE, AND MUST LINE UP
AS SHOWN IN DETAIL.
- 2) ATTACH 2 x ____ x 4'-0" SCAB TO EACH FACE OF
TRUSS ASSEMBLY WITH 2 ROWS OF 10d (0.131" X 3") NAILS
SPACED 4" O.C. FROM EACH FACE. (SIZE AND GRADE TO MATCH
VERTICAL WEBS OF PIGGYBACK AND BASE TRUSS.)
(MINIMUM 2X4)
- 3) THIS CONNECTION IS ONLY VALID FOR A MAXIMUM
CONCENTRATED LOAD OF 4000 LBS (@1.15). REVIEW
BY A QUALIFIED ENGINEER IS REQUIRED FOR LOADS
GREATER THAN 4000 LBS.
- 4) FOR PIGGYBACK TRUSSES CARRYING GIRDER LOADS,
NUMBER OF PLYS OF PIGGYBACK TRUSS TO MATCH BASE TRUSS.
- 5) CONCENTRATED LOAD MUST BE APPLIED TO BOTH
THE PIGGYBACK AND THE BASE TRUSS DESIGN.

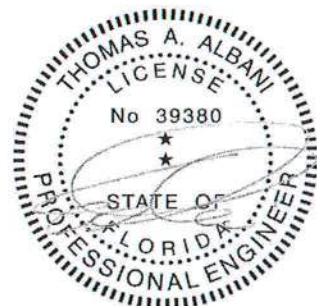

Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd, Tampa FL 33610
Date:


January 19, 2018

AUGUST 1, 2016

STANDARD REPAIR DETAIL FOR BROKEN CHORDS, WEBS
AND DAMAGED OR MISSING CHORD SPLICE PLATES

MII-REP01A1

MiTek USA, Inc. Page 1 of 1




TOTAL NUMBER OF NAILS EACH SIDE OF BREAK *		X INCHES	MAXIMUM FORCE (lbs) 15% LOAD DURATION							
			SP		DF		SPF		HF	
2x4	2x6		2x4	2x6	2x4	2x6	2x4	2x6	2x4	2x6
20	30	24"	1706	2559	1561	2342	1320	1980	1352	2028
26	39	30"	2194	3291	2007	3011	1697	2546	1738	2608
32	48	36"	2681	4022	2454	3681	2074	3111	2125	3187
38	57	42"	3169	4754	2900	4350	2451	3677	2511	3767
44	66	48"	3657	5485	3346	5019	2829	4243	2898	4347

* DIVIDE EQUALLY FRONT AND BACK

ATTACH 2x SCAB OF THE SAME SIZE AND GRADE AS THE BROKEN MEMBER TO EACH FACE OF THE TRUSS (CENTER ON BREAK OR SPLICE) WITH 10d (0.131" X 3") NAILS (TWO ROWS FOR 2x4, THREE ROWS FOR 2x6) SPACED 4" O.C. AS SHOWN. STAGGER NAIL SPACING FROM FRONT FACE AND BACK FACE FOR A NET 0-2-0 O.C. SPACING IN THE MAIN MEMBER. USE A MIN. 0-3-0 MEMBER END DISTANCE.

THE LENGTH OF THE BREAK (C) SHALL NOT EXCEED 12". (C=PLATE LENGTH FOR SPLICE REPAIRS)
THE MINIMUM OVERALL SCAB LENGTH REQUIRED (L) IS CALCULATED AS FOLLOWS:
 $L = (2) X + C$

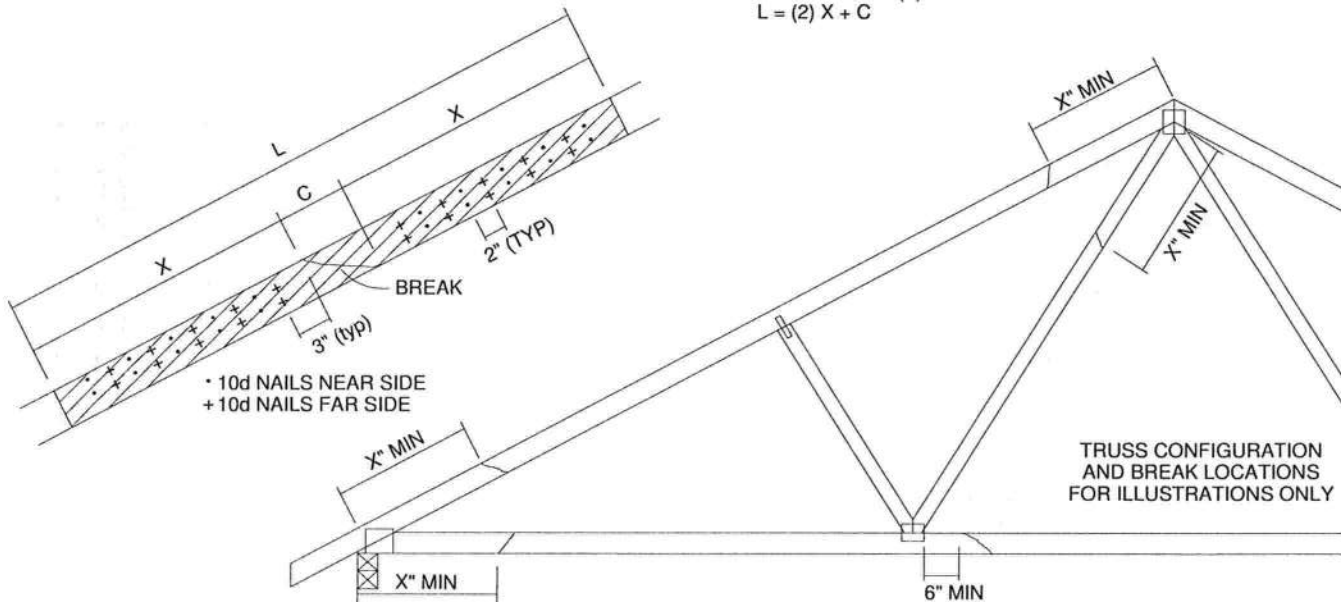

THE LOCATION OF THE BREAK MUST BE GREATER THAN OR EQUAL TO THE REQUIRED X DIMENSION FROM ANY PERIMETER BREAK OR HEEL JOINT AND A MINIMUM OF 6" FROM ANY INTERIOR JOINT (SEE SKETCH ABOVE)

DO NOT USE REPAIR FOR JOINT SPLICES

NOTES:

1. THIS REPAIR DETAIL IS TO BE USED ONLY FOR THE APPLICATION SHOWN. THIS REPAIR DOES NOT IMPLY THAT THE REMAINING PORTION OF THE TRUSS IS UNDAMAGED. THE ENTIRE TRUSS SHALL BE INSPECTED TO VERIFY THAT NO FURTHER REPAIRS ARE REQUIRED. WHEN THE REQUIRED REPAIRS ARE PROPERLY APPLIED, THE TRUSS WILL BE CAPABLE OF SUPPORTING THE LOADS INDICATED.
2. ALL MEMBERS MUST BE RETURNED TO THEIR ORIGINAL POSITIONS BEFORE APPLYING REPAIR AND HELD IN PLACE DURING APPLICATION OF REPAIR.
3. THE END DISTANCE, EDGE DISTANCE AND SPACING OF NAILS SHALL BE SUCH AS TO AVOID UNUSUAL SPLITTING OF THE WOOD.
4. WHEN NAILING THE SCABS, THE USE OF A BACKUP WEIGHT IS RECOMMENDED TO AVOID LOOSENING OF THE CONNECTOR PLATES AT THE JOINTS OR SPLICES.
5. THIS REPAIR IS TO BE USED FOR SINGLE PLY TRUSSES IN THE 2x ORIENTATION ONLY.
6. THIS REPAIR IS LIMITED TO TRUSSES WITH NO MORE THAN THREE BROKEN MEMBERS.



Thomas A. Albani PE No. 39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

January 19, 2018


AUGUST 1, 2016

LATERAL TOE-NAIL DETAIL

MII-TOENAIL_SP

MiTek USA, Inc.

Page 1 of 1



MiTek USA, Inc.
ENGINEERED BY
TRENCO
A MiTek Affiliate

NOTES:

1. TOE-NAILS SHALL BE DRIVEN AT AN ANGLE OF 45 DEGREES WITH THE MEMBER AND MUST HAVE FULL WOOD SUPPORT. (NAIL MUST BE DRIVEN THROUGH AND EXIT AT THE BACK CORNER OF THE MEMBER END AS SHOWN.)
2. THE END DISTANCE, EDGE DISTANCE, AND SPACING OF NAILS SHALL BE SUCH AS TO AVOID UNUSUAL SPLITTING OF THE WOOD.
3. ALLOWABLE VALUE SHALL BE THE LESSER VALUE OF THE TWO SPECIES FOR MEMBERS OF DIFFERENT SPECIES.

THIS DETAIL APPLICABLE TO THE
THREE END DETAILS SHOWN BELOW

VIEWS SHOWN ARE FOR
ILLUSTRATION PURPOSES ONLY

TOE-NAIL SINGLE SHEAR VALUES PER NDS 2001 (lb/nail)

	DIAM.	SP	DF	HF	SPF	SPF-S
3.5" LONG	.131	88.0	80.6	69.9	68.4	59.7
	.135	93.5	85.6	74.2	72.6	63.4
	.162	108.8	99.6	86.4	84.5	73.8
3.25" LONG	.128	74.2	67.9	58.9	57.6	50.3
	.131	75.9	69.5	60.3	59.0	51.1
	.148	81.4	74.5	64.6	63.2	52.5

VALUES SHOWN ARE CAPACITY PER TOE-NAIL.
APPLICABLE DURATION OF LOAD INCREASES MAY BE APPLIED.

EXAMPLE:

(3) - 16d (0.162" X 3.5") NAILS WITH SPF SPECIES BOTTOM CHORD







For load duration increase of 1.15:


3 (nails) X 84.5 (lb/nail) X 1.15 (DOL) = 291.5 lb Maximum Capacity



Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:



January 19, 2018

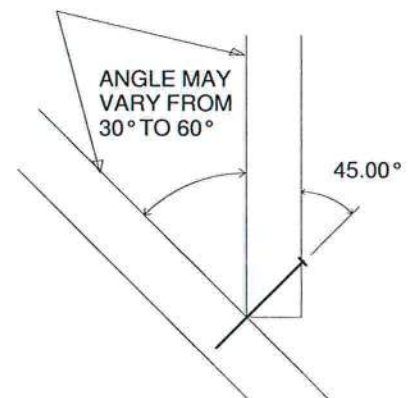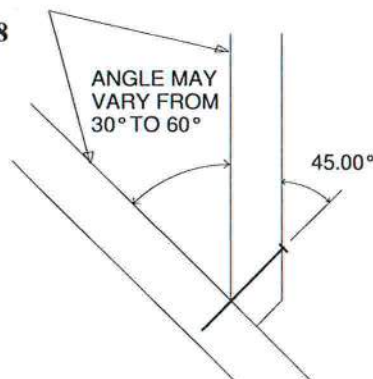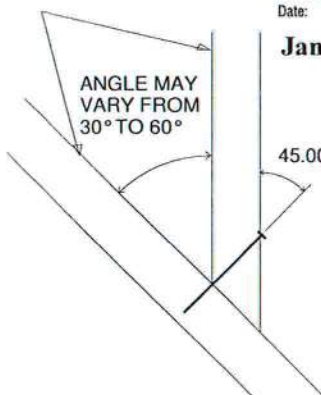SIDE VIEW
(2x3)
2 NAILSSIDE VIEW
(2x4)
3 NAILSSIDE VIEW
(2x6)
4 NAILS




GENERAL SPECIFICATIONS

1. NAIL SIZE 10d (0.131" X 3")
2. WOOD SCREW = 3" WS3 USP OR EQUIVALENT
DO NOT USE DRYWALL OR DECKING TYPE SCREW
3. INSTALL VALLEY TRUSSES (24" O.C. MAXIMUM) AND SECURE PER DETAIL A
4. BRACE VALLEY WEBS IN ACCORDANCE WITH THE INDIVIDUAL DESIGN DRAWINGS.
5. BASE TRUSS SHALL BE DESIGNED WITH A PURLIN SPACING EQUIVANT TO THE RAKE DIMENSION OF THE VALLEY TRUSS SPACING.
6. NAILING DONE PER NDS - 01
7. VALLEY STUD SPACING NOT TO EXCEED 48" O.C.

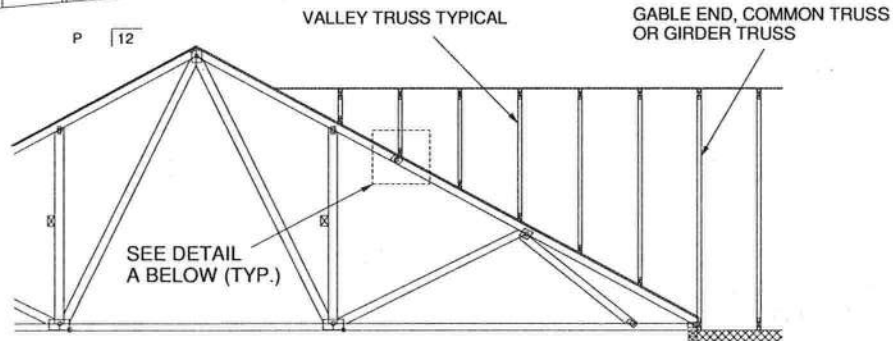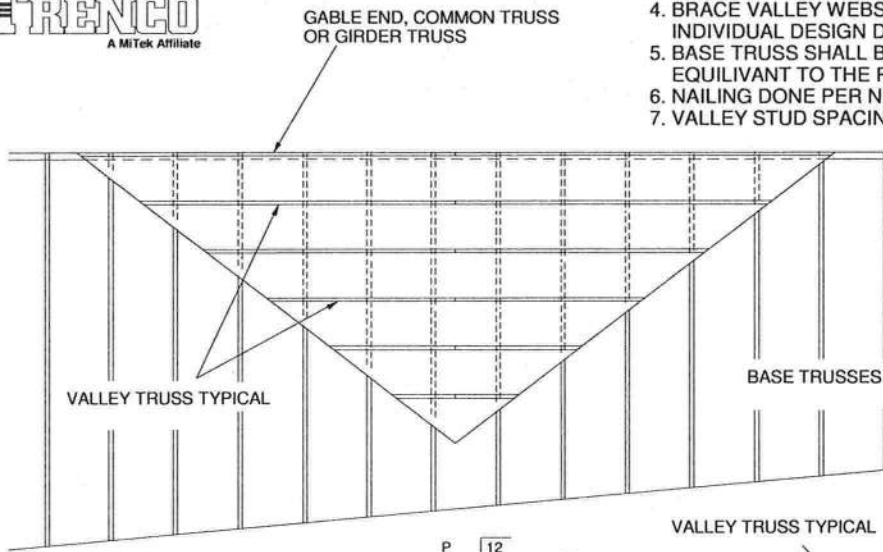

SECURE VALLEY TRUSS
W/ ONE ROW OF 10d
NAILS 6" O.C.

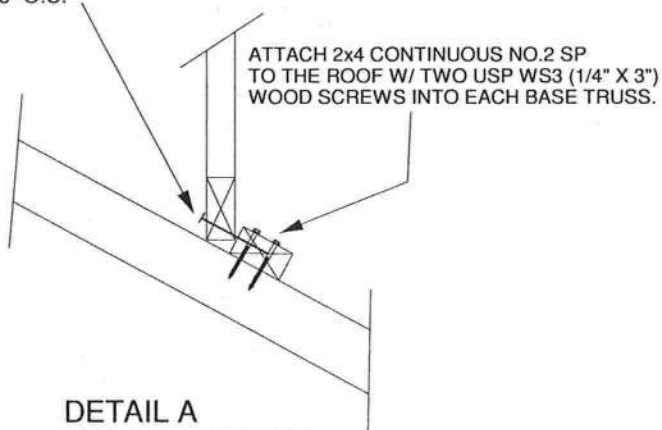

DETAIL A
(NO SHEATHING)
N.T.S.

WIND DESIGN PER ASCE 7-98, ASCE 7-02, ASCE 7-05 146 MPH
WIND DESIGN PER ASCE 7-10 160 MPH
MAX MEAN ROOF HEIGHT = 30 FEET
ROOF PITCH = MINIMUM 3/12 MAXIMUM 6/12
CATEGORY II BUILDING
EXPOSURE C
WIND DURATION OF LOAD INCREASE : 1.60
MAX TOP CHORD TOTAL LOAD = 50 PSF
MAX SPACING = 24" O.C. (BASE AND VALLEY)
MINIMUM REDUCED DEAD LOAD OF 6 PSF
ON THE TRUSSES



Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

January 19, 2018


AUGUST 1, 2016

TRUSSED VALLEY SET DETAIL

MII-VALLEY HIGH WIND2


MiTek USA, Inc.

Page 1 of 1




GENERAL SPECIFICATIONS


1. NAIL SIZE 10d (0.131" X 3")
2. WOOD SCREW = 4.5" WS45 USP OR EQUIVANT
3. INSTALL SHEATHING TO TOP CHORD OF BASE TRUSSES.
4. INSTALL VALLEY TRUSSES (24" O.C. MAXIMUM) AND SECURE TO BASE TRUSSES AS PER DETAIL A
5. BRACE VALLEY WEBS IN ACCORDANCE WITH THE INDIVIDUAL DESIGN DRAWINGS.
6. NAILING DONE PER NDS-01
7. VALLEY STUD SPACING NOT TO EXCEED 48" O.C.

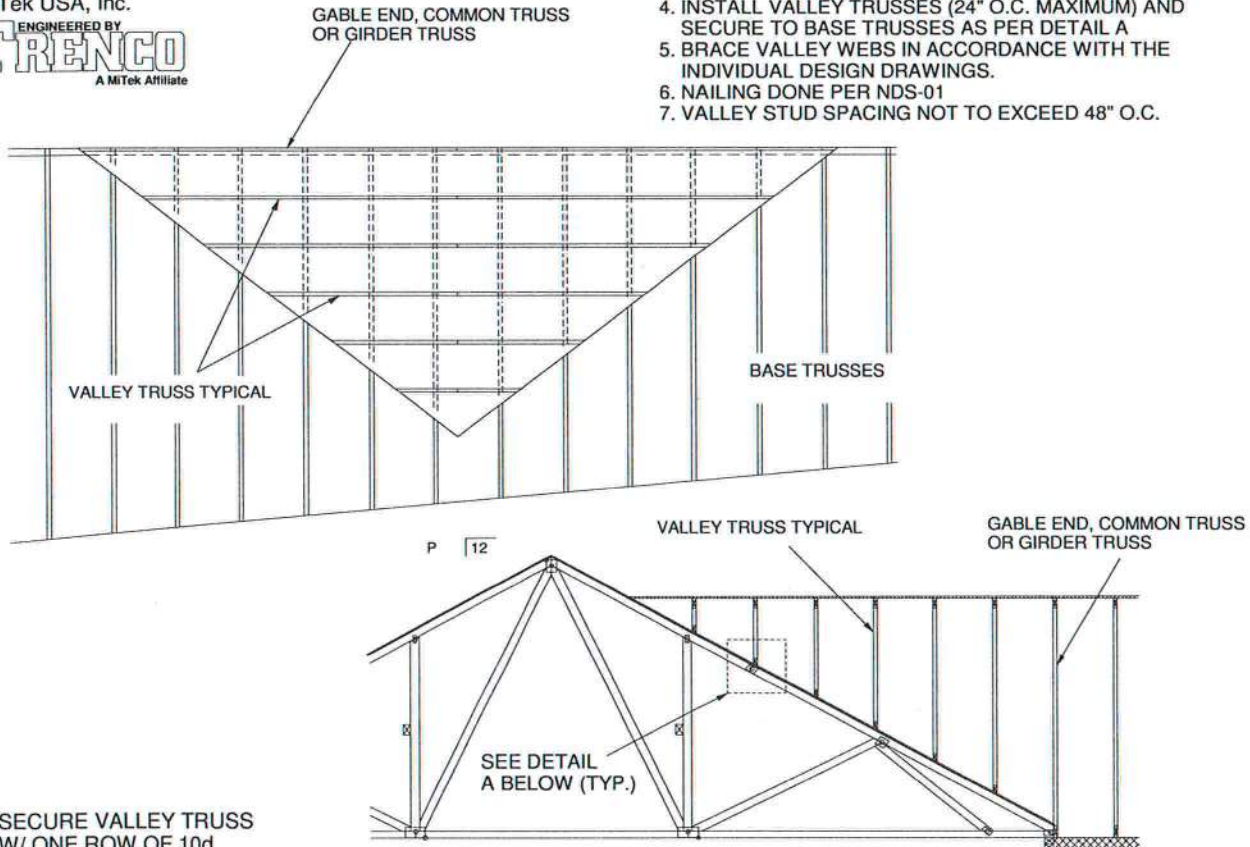

SECURE VALLEY TRUSS
W/ ONE ROW OF 10d
NAILS 6" O.C.

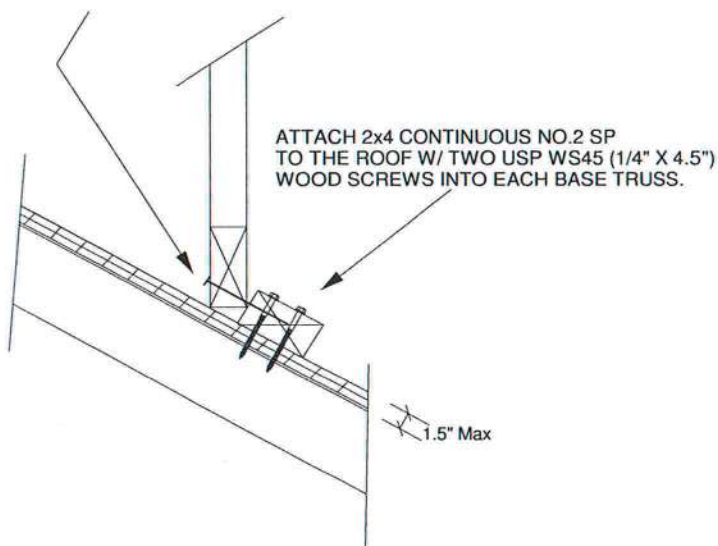


WIND DESIGN PER ASCE 7-98, ASCE 7-02, ASCE 7-05 146 MPH
WIND DESIGN PER ASCE 7-10 160 MPH
MAX MEAN ROOF HEIGHT = 30 FEET
ROOF PITCH = MINIMUM 3/12 MAXIMUM 6/12
CATEGORY II BUILDING
EXPOSURE C
WIND DURATION OF LOAD INCREASE : 1.60
MAX TOP CHORD TOTAL LOAD = 50 PSF
MAX SPACING = 24" O.C. (BASE AND VALLEY)
MINIMUM REDUCED DEAD LOAD OF 6 PSF
ON THE TRUSSES

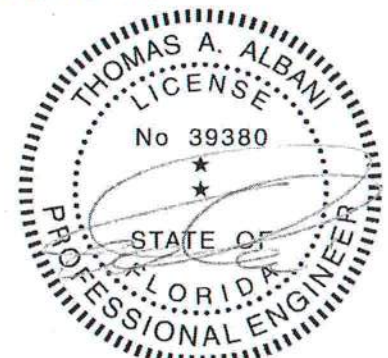

Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 12, 2018




MiTek USA, Inc.


ENGINEERED BY
TRENCO
A MiTek Affiliate

GENERAL SPECIFICATIONS

1. NAIL SIZE 16d (0.131" X 3.5")
2. INSTALL VALLEY TRUSSES (24" O.C. MAXIMUM) AND SECURE PER DETAIL A
3. BRACE VALLEY WEBS IN ACCORDANCE WITH THE INDIVIDUAL DESIGN DRAWINGS.
4. BASE TRUSS SHALL BE DESIGNED WITH A PURLIN SPACING EQUIVARIANT TO THE RAKE DIMENSION OF THE VALLEY TRUSS SPACING.
5. NAILING DONE PER NDS - 01
6. VALLEY STUD SPACING NOT TO EXCEED 48" O.C.
7. ALL LUMBER SPECIES TO BE SP.

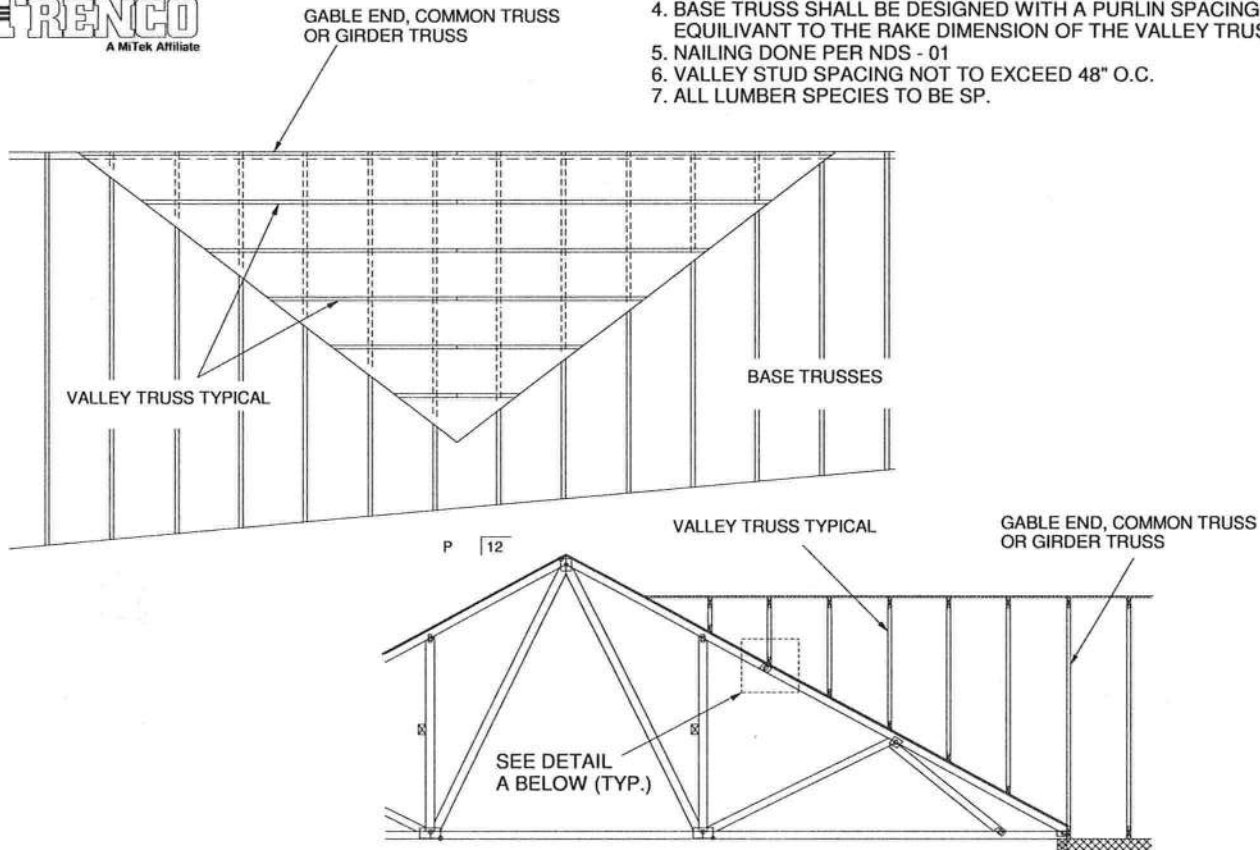

SECURE VALLEY TRUSS
W/ ONE ROW OF 16d
NAILS 6" O.C.

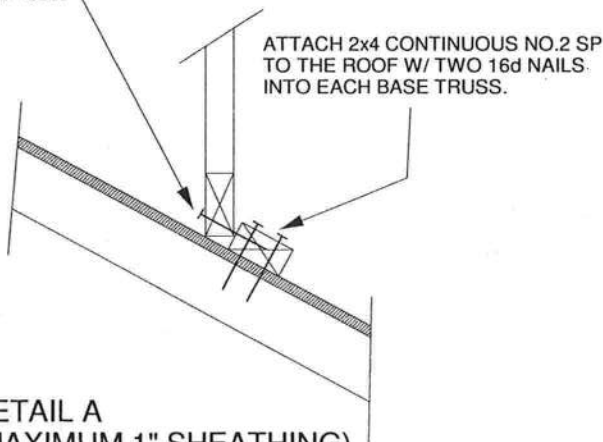

DETAIL A
(MAXIMUM 1" SHEATHING)
N.T.S.

WIND DESIGN PER ASCE 7-98, ASCE 7-02, ASCE 7-05 120 MPH
WIND DESIGN PER ASCE 7-10 150 MPH
MAX MEAN ROOF HEIGHT = 30 FEET
ROOF PITCH = MINIMUM 3/12 MAXIMUM 10/12
CATEGORY II BUILDING
EXPOSURE C OR B
WIND DURATION OF LOAD INCREASE : 1.60
MAX TOP CHORD TOTAL LOAD = 60 PSF
MAX SPACING = 24" O.C. (BASE AND VALLEY)
MINIMUM REDUCED DEAD LOAD OF 4.2 PSF
ON THE TRUSSES



Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:


February 12, 2018

AUGUST 1, 2016

TRUSSED VALLEY SET DETAIL
(HIGH WIND VELOCITY)

MII-VALLEY


MiTek USA, Inc. Page 1 of 1




MiTek USA, Inc.

ENGINEERED BY
TRENCO
A MiTek Affiliate


NOTE: VALLEY STUD SPACING NOT
TO EXCEED 48" O.C. SPACING

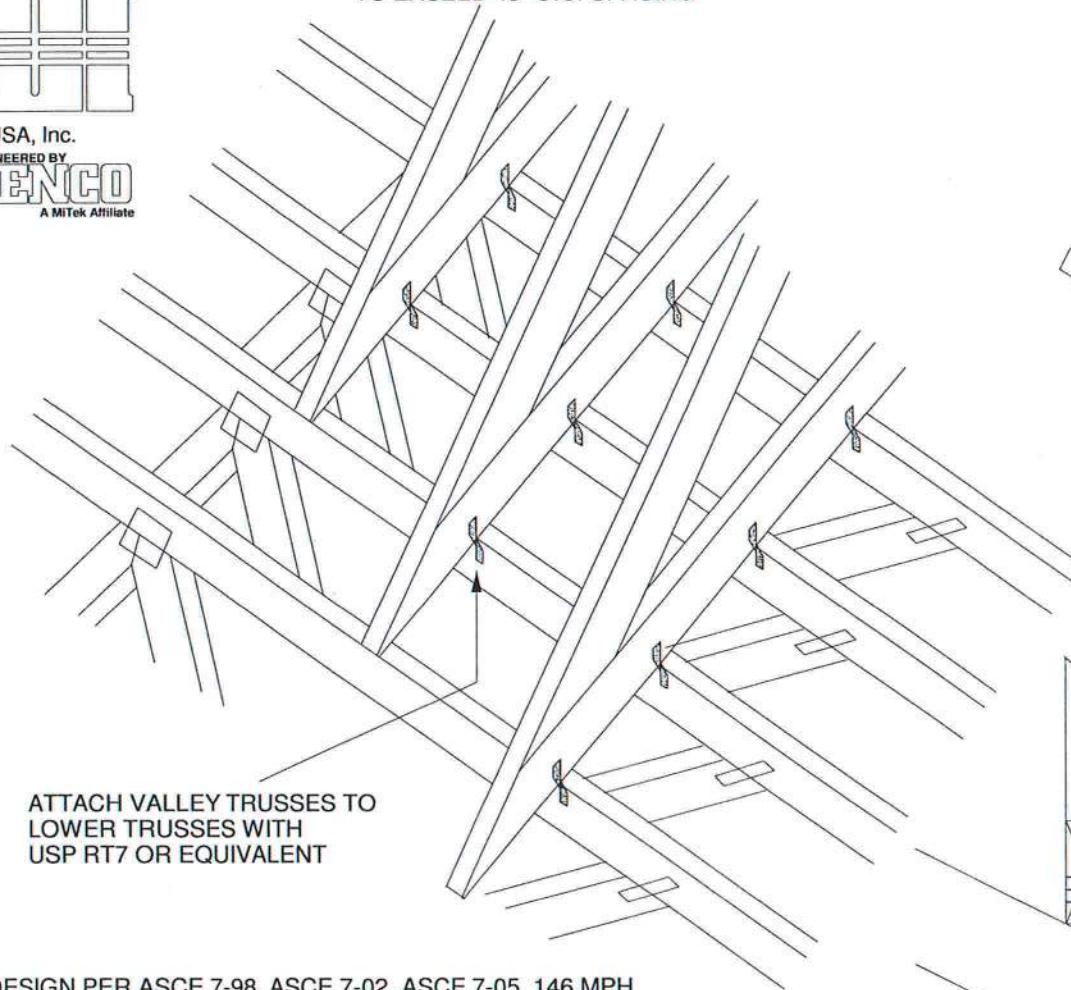

ATTACH VALLEY TRUSSES TO
LOWER TRUSSES WITH
USP RT7 OR EQUIVALENT

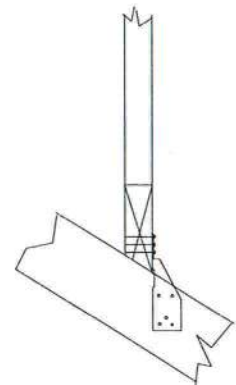

FOR BEVELED BOTTOM
CHORD, CLIP MAY BE
APPLIED TO EITHER FACE

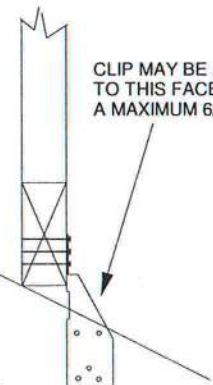


CLIP MAY BE APPLIED
TO THIS FACE UP TO
A MAXIMUM 6/12 PITCH

WIND DESIGN PER ASCE 7-98, ASCE 7-02, ASCE 7-05 146 MPH
WIND DESIGN PER ASCE 7-10 160 MPH
MAX MEAN ROOF HEIGHT = 30 FEET
CATEGORY II BUILDING
EXPOSURE B or C
WIND DURATION OF LOAD INCREASE : 1.6
MAX TOP CHORD TOTAL LOAD = 50 PSF
MAX SPACING = 24" O.C. (BASE AND VALLEY)


SUPPORTING TRUSSES DIRECTLY UNDER
VALLEY TRUSSES MUST BE DESIGNED
WITH A MAXIMUM UNBRACED LENGTH OF
2'-10" ON AFFECTED TOP CHORDS.

NOTES:

- SHEATHING APPLIED AFTER
INSTALLATION OF VALLEY TRUSSES
- THIS DETAIL IS NOT APPLICABLE FOR
SPF-S SPECIES LUMBER.

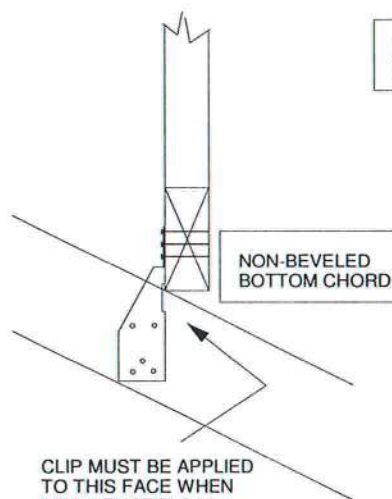

CLIP MUST BE APPLIED
TO THIS FACE WHEN
PITCH EXCEEDS 6/12.
(MAXIMUM 12/12 PITCH)

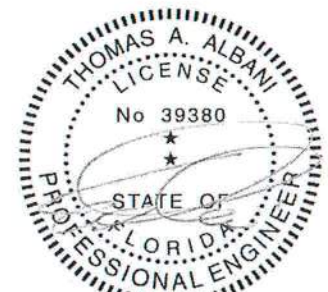

Thomas A. Albani PE No. 39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:




January 19, 2018

AUGUST 1, 2016


Standard Gable End Detail

MII-GE146-001

MiTek USA, Inc. Page 1 of 2

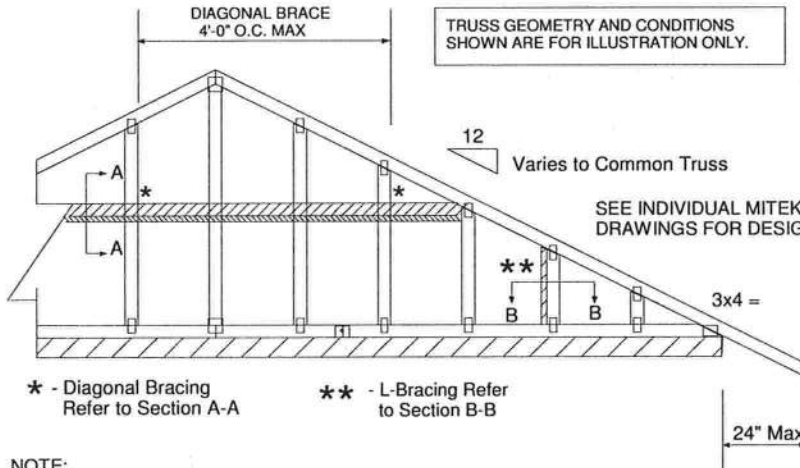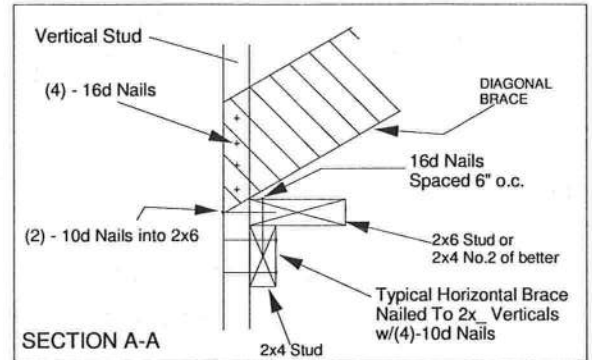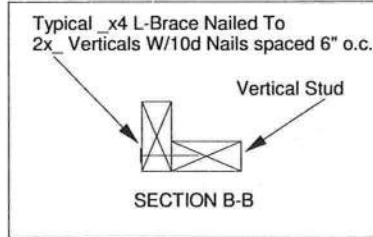

- NOTE:
1. MINIMUM GRADE OF #2 MATERIAL IN THE TOP AND BOTTOM CHORDS.
 2. CONNECTION BETWEEN BOTTOM CHORD OF GABLE END TRUSS AND WALL TO BE PROVIDED BY PROJECT ENGINEER OR ARCHITECT.
 3. BRACING SHOWN IS FOR INDIVIDUAL TRUSS ONLY. CONSULT BLDG. ARCHITECT OR ENGINEER FOR TEMPORARY AND PERMANENT BRACING OF ROOF SYSTEM.
 4. "L" BRACES SPECIFIED ARE TO BE FULL LENGTH. GRADES: 2x4 No 3/STUD SP OR BETTER WITH ONE ROW OF 10d NAILS SPACED 6" O.C.
 5. DIAGONAL BRACE TO BE APPROXIMATELY 45 DEGREES TO ROOF DIAPHRAM AT 4'-0" O.C.
 6. CONSTRUCT HORIZONTAL BRACE CONNECTING A 2x6 STUD AND A 2x4 STUD AS SHOWN WITH 16d NAILS SPACED 6" O.C. HORIZONTAL BRACE TO BE LOCATED AT THE MIDSPAN OF THE LONGEST STUD. ATTACH TO VERTICAL STUDS WITH (4) 10d NAILS THROUGH 2x4. (REFER TO SECTION A-A)
 7. GABLE STUD DEFLECTION MEETS OR EXCEEDS 1/240.
 8. THIS DETAIL DOES NOT APPLY TO STRUCTURAL GABLES.
 9. DO NOT USE FLAT BOTTOM CHORD GABLES NEXT TO SCISSOR TYPE TRUSSES.
 10. NAILS DESIGNATED 10d ARE (0.131" X 3") AND NAILS DESIGNATED 16d ARE (0.131" X 3.5")

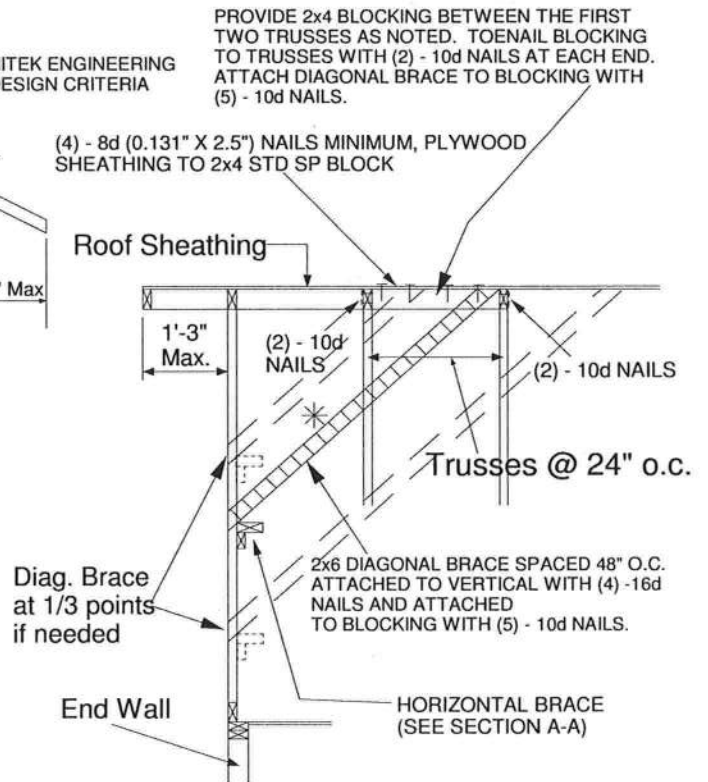

Minimum Stud Size Species and Grade	Stud Spacing	Without Brace	2x4 L-Brace	DIAGONAL BRACE	2 DIAGONAL BRACES AT 1/3 POINTS
		Maximum Stud Length			
2x4 SP No 3/Stud	12" O.C.	3-11-3	6-8-0	7-2-14	11-9-10
2x4 SP No 3/Stud	16" O.C.	3-6-14	5-9-5	7-1-13	10-8-11
2x4 SP No 3/Stud	24" O.C.	3-1-8	4-8-9	6-2-15	9-4-7

- * Diagonal braces over 6'-3" require a 2x4 T-Brace attached to one edge. Diagonal braces over 12'-6" require 2x4 I-braces attached to both edges. Fasten T and I braces to narrow edge of web with 10d nails 8" o.c., with 3" minimum end distance. Brace must cover 90% of diagonal length.


MAXIMUM WIND SPEED = 146 MPH
 MAX MEAN ROOF HEIGHT = 30 FEET
 CATEGORY II BUILDING
 EXPOSURE B or C
 ASCE 7-98, ASCE 7-02, ASCE 7-05
 DURATION OF LOAD INCREASE : 1.60

STUD DESIGN IS BASED ON COMPONENTS AND CLADDING.
 CONNECTION OF BRACING IS BASED ON MWFRS.



Thomas A. Albani PE No. 39380
 MiTek USA, Inc. FL Cert 6634
 6904 Parke East Blvd, Tampa FL 33610
 Date:

January 19, 2018



MiTek USA, Inc.



MiTek USA, Inc.

Page 1 of 1

TRUSS CRITERIA:

LOADING: 40-10-0-10

DURATION FACTOR: 1.15

SPACING: 24" O.C.

TOP CHORD: 2x4 OR 2x6


PITCH: 4/12 - 12/12

HEEL HEIGHT: STANDARD HEEL UP TO 12" ENERGY HEEL

END BEARING CONDITION

NOTES:

1. ATTACH 2x_ SCAB (MINIMUM NO.2 GRADE SPF, HF, SP, DF) TO ONE FACE OF TRUSS WITH TWO ROWS OF 10d (0.131" X 3") SPACED 6" O.C.
2. THE END DISTANCE, EDGE DISTANCE, AND SPACING OF NAILS SHALL BE SUCH AS TO AVOID UNUSUAL SPLITTING OF THE WOOD.
3. WHEN NAILING THE SCABS, THE USE OF A BACKUP WEIGHT IS RECOMMENDED TO AVOID LOOSENING OF THE CONNECTOR PLATES AT THE JOINTS OR SPLICES.

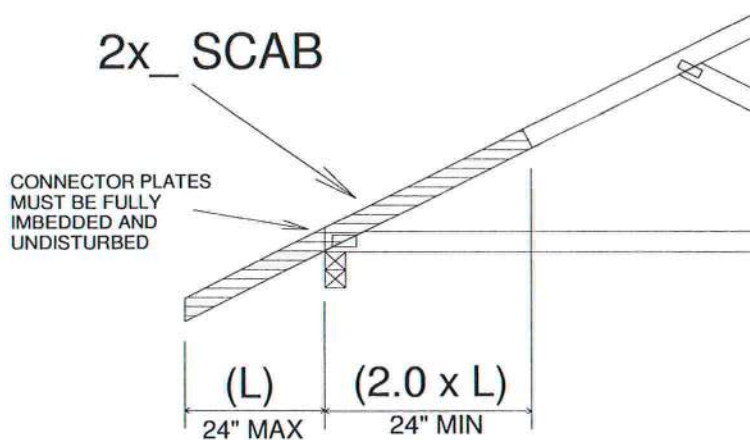


IMPORTANT

This detail to be used only with trusses (spans less than 40') spaced 24" o.c. maximum and having pitches between 4/12 and 12/12 and total top chord loads not exceeding 50 psf.


Trusses not fitting these criteria should be examined individually.

REFER TO INDIVIDUAL TRUSS DESIGN
FOR PLATE SIZES AND LUMBER GRADES

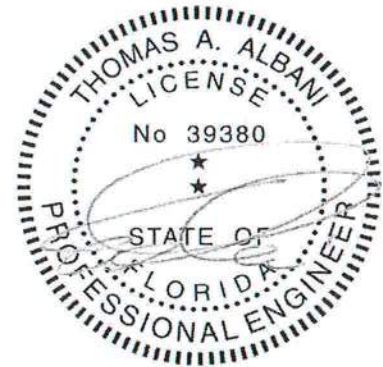

Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:



February 12, 2018



TO MINIMIZE VIBRATION COMMON TO ALL SHALLOW FRAMING SYSTEMS, 2x6 "STRONGBACK" IS RECOMMENDED, LOCATED EVERY 8 TO 10 FEET ALONG A FLOOR TRUSS.

NOTE 1: 2X6 STRONGBACK ORIENTED VERTICALLY MAY BE POSITIONED DIRECTLY UNDER THE TOP CHORD OR DIRECTLY ABOVE THE BOTTOM CHORD. SECURELY FASTENED TO THE TRUSS USING ANY OF THE METHODS ILLUSTRATED BELOW.

NOTE 2: STRONGBACK BRACING ALSO SATISFIES THE LATERAL BRACING REQUIREMENTS FOR THE BOTTOM CHORD OF THE TRUSS WHEN IT IS PLACED ON TOP OF THE BOTTOM CHORD, IS CONTINUOUS FROM END TO END, CONNECTED WITH A METHOD OTHER THAN METAL FRAMING ANCHOR, AND PROPERLY CONNECTED, BY OTHERS, AT THE ENDS.

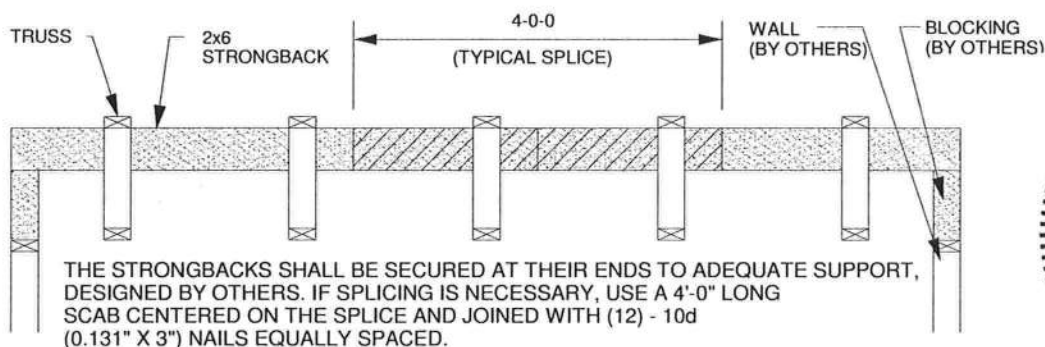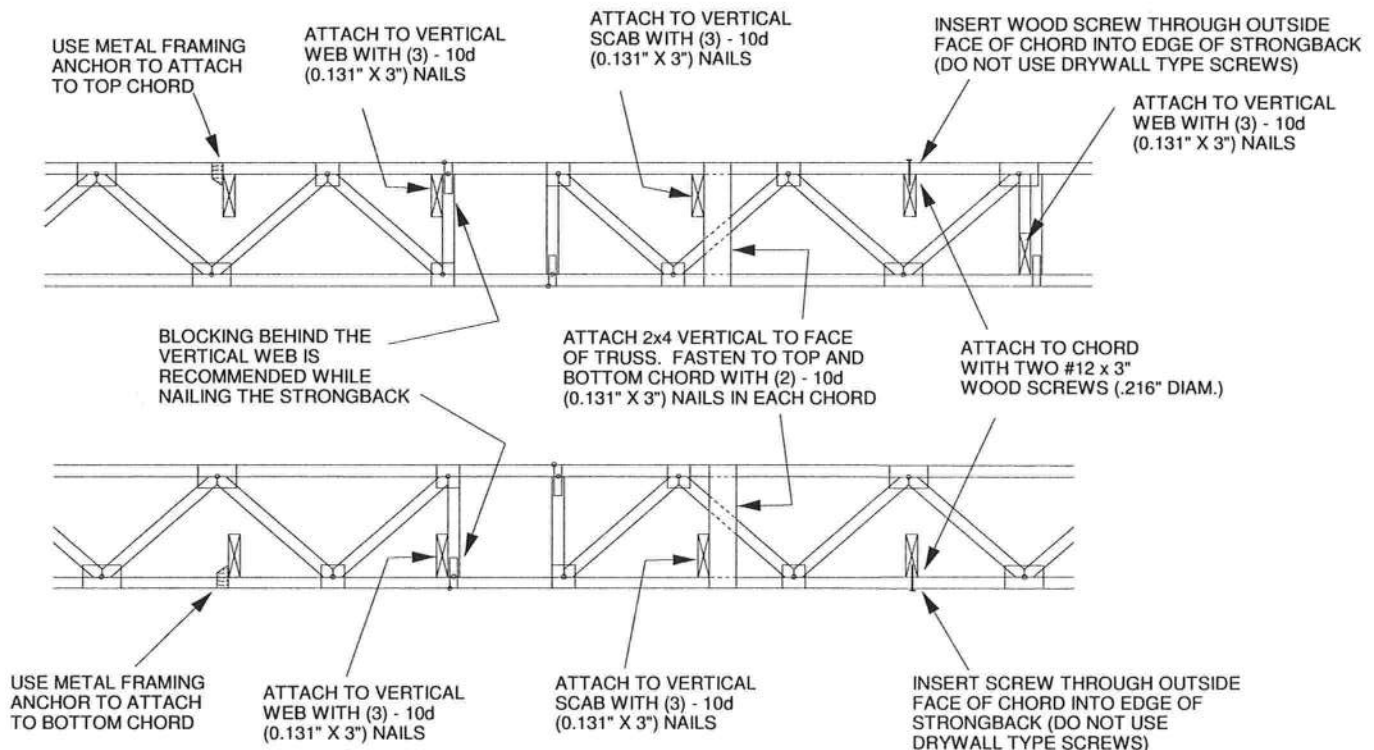


ALTERNATE METHOD OF SPLICING:
OVERLAP STRONGBACK MEMBERS A MINIMUM OF 4'-0" AND FASTEN WITH (12) - 10d (0.131" X 3") NAILS STAGGERED AND EQUALLY SPACED.
(TO BE USED ONLY WHEN STRONGBACK IS NOT ALIGNED WITH A VERTICAL)



Thomas A. Albani PE No.39380
MiTek USA, Inc. FL Cert 6634
6904 Parke East Blvd. Tampa FL 33610
Date:

February 12, 2018

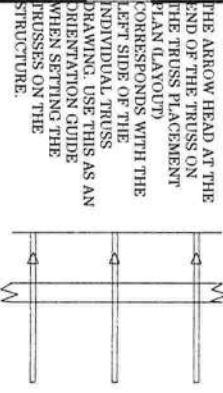

THE ARROW HEAD AT THE END OF THE TRUSS ON THE TRUSS PLACEMENT PLAN LAYOUT CORRESPONDS WITH THE LEFT SIDE OF THE INDIVIDUAL TRUSS DRAWING. USE THIS AS AN ORIENTATION GUIDE WHEN SETTING THE TRUSSES ON THE STRUCTURE.

- General Notes:
- Per ANSI/TPI 1-2002 all "Truss to Wall" connections are the responsibility of the Building Designer, not the Truss Manufacturer.
 - Use Manufacturer's specifications for all hanger connections unless noted otherwise.
 - Trusses are to be 24' o.c. U.N.O.
 - All hangers are to be Simpson or equivalent U.N.O.-Use 10d x 1 1/2" Nails in hanger connections to single ply girders.
 - Trusses are not designed to support brick U.N.O.
 - Dimensions are Feet/Inches' Sixteenths

Notes:

No back charges will be accepted by Builders FirstSource unless approved in writing first.
880-835-4541

ACQ lumber is corrosive to truss plates. Any ACQ lumber that comes in contact with truss plates (i.e. scaled on tails) must have an approved barrier applied first.

Refer to BCSI-B1 Summary Sheet-Guide for handling, installing and bracing of Metal Plate Connected Wood Truss prior to and during truss installation.

It is the responsibility of the Contractor to ensure the proper orientation of the truss placement plans as to the structure orientation. If a reversed or flipped layout is required, it will be supplied at no extra cost by Builders FirstSource.

It is the responsibility of the Contractor to make sure the placement of trusses are adjusted for plumbing drops, fan lights, etc.... so the trusses do not interfere with these type of items.

All common framed roof or floor systems must be designed as to NOT impose any loads on the floor trusses below. The floor trusses have not been designed to carry any additional loads from above.

This truss placement plan was not created by an engineer, but rather by the Builders FirstSource staff and is solely to be used as an installation guide and does not require a seal. Complete truss engineering and analysis can be found on the truss design drawings which may be sealed by the truss design engineer.

Gable end trusses require continuous bottom chord bearing. Refer to local codes for wall framing requirements.

Although all attempts have been made to do so, trusses may not be designed symmetrically. Please refer to the individual truss drawings and truss placement plans for proper orientation and placement.




Lake City
PHONE: 386-755-6894
FAX: 386-755-7973

Jacksonville
PHONE: 904-772-6100
FAX: 904-772-1973

Tallahassee
PHONE: 850-576-5177

Builder:
Aaron Simque Homes
Agent Address:
Lot 56 The Preserve at
Laurel Lake

Model: LVY		
Date: 5-15-21	Drawn By: KLH	Original Ref #: 2797533
3 floor 1 Job#	3 floor 2 Job#	Roof Job #: 2797533

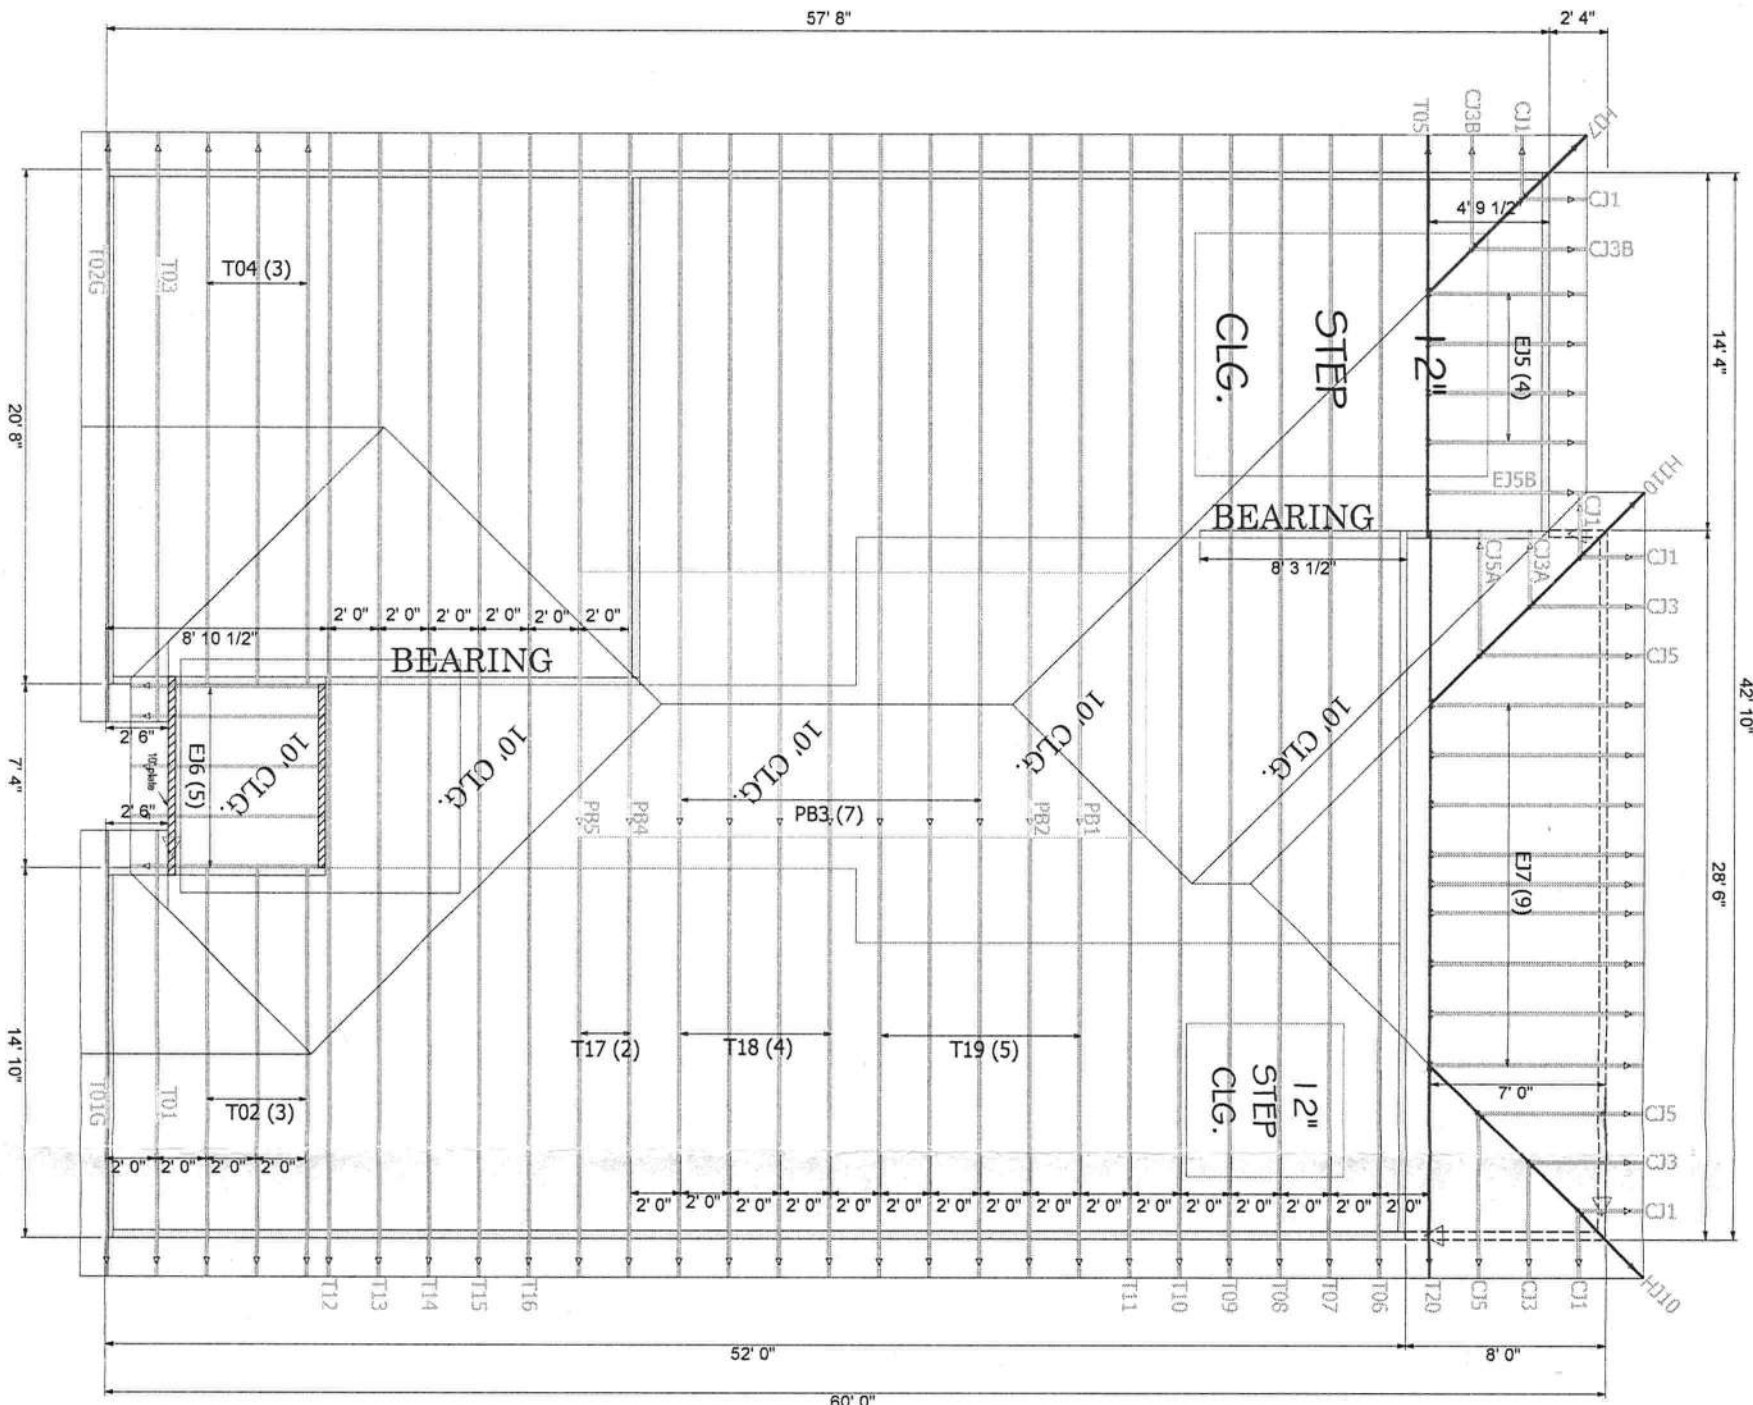

7/12 PITCH
18" O/H

NOTE BEARING ADDED

Hatch Legend

9' 1-1/8"

10' 1-1/8"

