

BUILDING "A" PROFILE

A

Width (ft) = 50 Eave Height (ft) = 21
 Length (ft) = 251.33 Roof Slope (Rise/12) = 3.0:12

BUILDING LOADS

- A) THIS IS TO CERTIFY THAT THIS STRUCTURE IS DESIGNED UTILIZING THE LOADS INDICATED AND APPLIED AS REQUIRED BY FBC 23 / 8TH EDITION
- B) THIS CERTIFICATION IS LIMITED TO THE STRUCTURAL DESIGN OF THE FRAMING AND COVERING PARTS MANUFACTURED BY THE BUILDING MANUFACTURER AND AS SPECIFIED IN THE CONTRACT. ACCESSORY ITEMS SUCH AS DOORS, WINDOWS, LOUVERS, TRANSLUCENT PANELS, VENTILATORS ARE NOT INCLUDED. ALSO EXCLUDED ARE OTHER PARTS OF THE PROJECT NOT PROVIDED BY THE BUILDING MANUFACTURER SUCH AS FOUNDATIONS, MASONRY WALLS, MECHANICAL EQUIPMENT AND THE ERECTION AND INSPECTION OF THE BUILDING. THE BUILDING SHOULD BE ERECTED ON A PROPERLY DESIGNED FOUNDATION IN ACCORDANCE WITH THE BUILDING MANUFACTURER'S DESIGN MANUAL, THE ATTACHED DRAWINGS, AND GOOD ERECTION PRACTICES. THE END USER AND/OR ENGINEER OF RECORD IS TO CONFIRM THAT THESE LOADS COMPLY WITH REQUIREMENTS OF THE LOCAL BUILDING DEPT.

OCCUPANCY/RISK CATEGORY II - Normal Is 1.0000 Ie 1.00
 WIND LOAD ULTIMATE 122 MPH NOMINAL 94.50 MPH WIND EXPOSURE C
 CLOSURE TYPE Enclosed INTERNAL WIND COEF. -0.18 / 0.18
 GROUND SNOW LOAD 0.00 PSF ROOF SNOW LOAD 0.00 PSF Ce 1.0000 Ct 1.2000
 SNOW BANKING LOADS PER CODE
 COLLATERAL DEAD LOAD 3.00 PSF
 ROOF LIVE LOAD 20.00 PSF (REDUCIBLE Yes)
 DEAD LOAD 3.75 PSF (FOR ROOF PANELS AND PURLINS)

SEISMIC
 SPECTRAL RESPONSE Ss 0.1100 S1 0.0550 Sds 0.1000 Sd1 0.0800
 SITE CLASS D DESIGN RISK CATEGORY B Cs 0.0334

RESPONSE MODIFICATION FACTOR, R 3.000* FRAMES 3.000* BRACING
 BASIC SEISMIC FORCE RESISTING SYSTEM (LATERAL DIRECTIONS) = ORDINARY STEEL MOMENT FRAMES
 BASIC SEISMIC FORCE RESISTING SYSTEM (ENDWALLS) = ORDINARY STEEL MOMENT BRACED FRAMES
 BASIC SEISMIC FORCE RESISTING SYSTEM (LONGITUDINAL DIRECTIONS) = ORDINARY STEEL MOMENT FRAMES
 ANALYSIS PROCEDURE = EQUIVALENT LATERAL FORCE PROCEDURE

SERVICEABILITY CRITERIA

* STEEL SYSTEM NOT SPECIFICALLY DETAILED FOR SEISMIC RESISTANCE.

| MINIMUM DESIGN DEFLECTIONS | | | |
|----------------------------|-------|-------------------------|-------|
| Endwall Column | = 180 | Roof Panel (Live) | = 60 |
| Endwall Rafter (Live) | = 180 | Roof Panel (Wind) | = 60 |
| Endwall Rafter (Wind) | = 180 | Rigid Frame (Horz) | = 100 |
| Wall Girt | = 90 | Rigid Frame (Vert) | = 180 |
| Roof Purlin (Live) | = 150 | Rigid Frame (Seismic) | = 50 |
| Roof Purlin (Wind) | = 150 | MEZZANINE (Dead + Live) | = 240 |
| Wall Panel | = 60 | MEZZANINE (Live) | = 360 |

COMPONENTS & CLADDING (unfactored)

Wall Field Values = 35.583 psf / -38.599 psf
 Wall Edge Values = 35.583 psf / -47.645 psf

THIS PROJECT IS DESIGNED AS AN ENCLOSED BUILDING. ACCESSORIES (DOORS, WINDOWS, ETC.) BY OTHERS MUST BE DESIGNED AS "COMPONENTS AND CLADDING" IN ACCORDANCE TO SPECIFIC WIND PROVISIONS OF REFERENCED BUILDING CODE. 3

THE MBM DOES NOT CONSIDER VIBRATION ANALYSIS OF MEZZANINE SYSTEMS. 18

MEZZANINE LOADINGS

DEAD LOAD = 50 psf. (4" CONC., DECK & JOIST)
 LIVE LOAD = 100 psf. (UNREDUCIBLE)
 COLL. LOAD = 1 psf.

BUILDING "B" PROFILE

B

Width (ft) = 25 Eave Height (ft) = 16.13 H/S
 Length (ft) = 76 Roof Slope (Rise/12) = 1.5:12.0

BUILDING LOADS

- A) THIS IS TO CERTIFY THAT THIS STRUCTURE IS DESIGNED UTILIZING THE LOADS INDICATED AND APPLIED AS REQUIRED BY FBC 23 / 8TH EDITION
- B) THIS CERTIFICATION IS LIMITED TO THE STRUCTURAL DESIGN OF THE FRAMING AND COVERING PARTS MANUFACTURED BY THE BUILDING MANUFACTURER AND AS SPECIFIED IN THE CONTRACT. ACCESSORY ITEMS SUCH AS DOORS, WINDOWS, LOUVERS, TRANSLUCENT PANELS, VENTILATORS ARE NOT INCLUDED. ALSO EXCLUDED ARE OTHER PARTS OF THE PROJECT NOT PROVIDED BY THE BUILDING MANUFACTURER SUCH AS FOUNDATIONS, MASONRY WALLS, MECHANICAL EQUIPMENT AND THE ERECTION AND INSPECTION OF THE BUILDING. THE BUILDING SHOULD BE ERECTED ON A PROPERLY DESIGNED FOUNDATION IN ACCORDANCE WITH THE BUILDING MANUFACTURER'S DESIGN MANUAL, THE ATTACHED DRAWINGS, AND GOOD ERECTION PRACTICES. THE END USER AND/OR ENGINEER OF RECORD IS TO CONFIRM THAT THESE LOADS COMPLY WITH REQUIREMENTS OF THE LOCAL BUILDING DEPT.

OCCUPANCY/RISK CATEGORY II - Normal Is 1.0000 Ie 1.00
 WIND LOAD ULTIMATE 122 MPH NOMINAL 94.50 MPH WIND EXPOSURE C
 CLOSURE TYPE Partially Enclosed INTERNAL WIND COEF. -0.55 / 0.55
 GROUND SNOW LOAD 0.00 PSF ROOF SNOW LOAD 0.00 PSF Ce 1.0000 Ct 1.2000
 SNOW BANKING LOADS PER CODE
 COLLATERAL DEAD LOAD 3.00 PSF
 ROOF LIVE LOAD 20.00 PSF (REDUCIBLE Yes)
 DEAD LOAD 4.00 PSF (FOR ROOF PANELS AND PURLINS)

SEISMIC
 SPECTRAL RESPONSE Ss 0.1100 S1 0.0550 Sds 0.1000 Sd1 0.0800
 SITE CLASS D DESIGN RISK CATEGORY B Cs 0.0334

RESPONSE MODIFICATION FACTOR, R 3.000* FRAMES 3.000* BRACING
 BASIC SEISMIC FORCE RESISTING SYSTEM (LATERAL DIRECTIONS) = ORDINARY STEEL MOMENT FRAMES
 BASIC SEISMIC FORCE RESISTING SYSTEM (ENDWALLS) = ORDINARY STEEL MOMENT BRACED FRAMES
 BASIC SEISMIC FORCE RESISTING SYSTEM (LONGITUDINAL DIRECTIONS) = ORDINARY STEEL MOMENT FRAMES
 ANALYSIS PROCEDURE = EQUIVALENT LATERAL FORCE PROCEDURE

SERVICEABILITY CRITERIA

* STEEL SYSTEM NOT SPECIFICALLY DETAILED FOR SEISMIC RESISTANCE.

| MINIMUM DESIGN DEFLECTIONS | | | |
|----------------------------|-------|-----------------------|-------|
| Endwall Column | = 180 | Roof Panel (Live) | = 60 |
| Endwall Rafter (Live) | = 180 | Roof Panel (Wind) | = 60 |
| Endwall Rafter (Wind) | = 180 | Rigid Frame (Horz) | = 100 |
| Wall Girt | = 90 | Rigid Frame (Vert) | = 180 |
| Roof Purlin (Live) | = 150 | Rigid Frame (Seismic) | = 50 |
| Roof Purlin (Wind) | = 150 | | |
| Wall Panel | = 60 | | |

COMPONENTS & CLADDING (unfactored)

Wall Field Values = 39.835 psf / -42.308 psf
 Wall Edge Values = 39.835 psf / -49.726 psf

THIS PROJECT IS DESIGNED AS A PARTIALLY ENCLOSED BUILDING AS DEFINED BY THE REFERENCED BUILDING CODE. 5

THE MBM DOES NOT CONSIDER VIBRATION ANALYSIS OF MEZZANINE SYSTEMS. 18

COLORS:

ROOF: _____ COLOR _____
 WALLS: _____ COLOR _____
 GABLE: _____ COLOR _____
 EAVE: _____ COLOR _____
 CORNER: _____ COLOR _____
 FRAMED OPENINGS: _____ COLOR _____
 GUTTER: _____ COLOR _____
 DOWNSPOUTS: _____ COLOR _____
 BASE: _____ COLOR _____

| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: COVER PAGE | | | |
| DRAWING NO: PAGE 0B | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

BUILDING "C" PROFILE



Width (ft) = 25 Eave Height (ft) = 16.13 H/S
 Length (ft) = 76 Roof Slope (Rise/12) = 1.5:12.0

BUILDING LOADS

- A) THIS IS TO CERTIFY THAT THIS STRUCTURE IS DESIGNED UTILIZING THE LOADS INDICATED AND APPLIED AS REQUIRED BY FBC 23 / 8TH EDITION
- B) THIS CERTIFICATION IS LIMITED TO THE STRUCTURAL DESIGN OF THE FRAMING AND COVERING PARTS MANUFACTURED BY THE BUILDING MANUFACTURER AND AS SPECIFIED IN THE CONTRACT. ACCESSORY ITEMS SUCH AS DOORS, WINDOWS, LOUVERS, TRANSLUCENT PANELS, VENTILATORS ARE NOT INCLUDED. ALSO EXCLUDED ARE OTHER PARTS OF THE PROJECT NOT PROVIDED BY THE BUILDING MANUFACTURER SUCH AS FOUNDATIONS, MASONRY WALLS, MECHANICAL EQUIPMENT AND THE ERECTION AND INSPECTION OF THE BUILDING. THE BUILDING SHOULD BE ERECTED ON A PROPERLY DESIGNED FOUNDATION IN ACCORDANCE WITH THE BUILDING MANUFACTURER'S DESIGN MANUAL, THE ATTACHED DRAWINGS, AND GOOD ERECTION PRACTICES. THE END USER AND/OR ENGINEER OF RECORD IS TO CONFIRM THAT THESE LOADS COMPLY WITH REQUIREMENTS OF THE LOCAL BUILDING DEPT.

OCCUPANCY/RISK CATEGORY II - Normal Is 1.0000 Ie 1.00
 WIND LOAD ULTIMATE 122 MPH NOMINAL 94.50 MPH WIND EXPOSURE C
 CLOSURE TYPE Enclosed INTERNAL WIND COEF. -0.18 / 0.18
 GROUND SNOW LOAD 0.00 PSF ROOF SNOW LOAD 0.00 PSF Ce 1.0000 Ct 1.2000
 SNOW BANKING LOADS PER CODE
 COLLATERAL DEAD LOAD 3.00 PSF
 ROOF LIVE LOAD 20.00 PSF (REDUCIBLE Yes)
 DEAD LOAD 2.75 PSF (FOR ROOF PANELS AND PURLINS)

SEISMIC
 SPECTRAL RESPONSE Ss 0.1100 s1 0.0550 Sds 0.1000 Sd1 0.0800
 SITE CLASS D DESIGN RISK CATEGORY B Cs 0.0334

RESPONSE MODIFICATION FACTOR, R 3.000* FRAMES 3.000* BRACING
 BASIC SEISMIC FORCE RESISTING SYSTEM (LATERAL DIRECTIONS) = ORDINARY STEEL MOMENT FRAMES
 BASIC SEISMIC FORCE RESISTING SYSTEM (ENDWALLS) = ORDINARY STEEL MOMENT BRACED FRAMES
 BASIC SEISMIC FORCE RESISTING SYSTEM (LONGITUDINAL DIRECTIONS) = ORDINARY STEEL MOMENT FRAMES
 ANALYSIS PROCEDURE = EQUIVALENT LATERAL FORCE PROCEDURE

SERVICEABILITY CRITERIA

* STEEL SYSTEM NOT SPECIFICALLY DETAILED FOR SEISMIC RESISTANCE.

| MINIMUM DESIGN DEFLECTIONS | | | |
|----------------------------|-------|-----------------------|-------|
| Endwall Column | = 180 | Roof Panel (Live) | = 60 |
| Endwall Rafter (Live) | = 180 | Roof Panel (Wind) | = 60 |
| Endwall Rafter (Wind) | = 180 | Rigid Frame (Horz) | = 100 |
| Wall Girt | = 90 | Rigid Frame (Vert) | = 180 |
| Roof Purlin (Live) | = 150 | Rigid Frame (Seismic) | = 50 |
| Roof Purlin (Wind) | = 150 | | |
| Wall Panel | = 60 | | |

COMPONENTS & CLADDING (unfactored)

Wall Field Values = 29.670 psf / -32.143 psf
 Wall Edge Values = 29.670 psf / -39.561 psf

THIS PROJECT IS DESIGNED AS AN ENCLOSED BUILDING. ACCESSORIES (DOORS, WINDOWS, ETC.) BY OTHERS MUST BE DESIGNED AS "COMPONENTS AND CLADDING" IN ACCORDANCE TO SPECIFIC WIND PROVISIONS OF REFERENCED BUILDING CODE. 3

THE MBM DOES NOT CONSIDER VIBRATION ANALYSIS OF MEZZANINE SYSTEMS. 18

BUILDING "D" PROFILE



Width (ft) = 28 Eave Height (ft) = 10
 Length (ft) = 12 Roof Slope (Rise/12) = 6.0:12

BUILDING LOADS

- A) THIS IS TO CERTIFY THAT THIS STRUCTURE IS DESIGNED UTILIZING THE LOADS INDICATED AND APPLIED AS REQUIRED BY FBC 23 / 8TH EDITION
- B) THIS CERTIFICATION IS LIMITED TO THE STRUCTURAL DESIGN OF THE FRAMING AND COVERING PARTS MANUFACTURED BY THE BUILDING MANUFACTURER AND AS SPECIFIED IN THE CONTRACT. ACCESSORY ITEMS SUCH AS DOORS, WINDOWS, LOUVERS, TRANSLUCENT PANELS, VENTILATORS ARE NOT INCLUDED. ALSO EXCLUDED ARE OTHER PARTS OF THE PROJECT NOT PROVIDED BY THE BUILDING MANUFACTURER SUCH AS FOUNDATIONS, MASONRY WALLS, MECHANICAL EQUIPMENT AND THE ERECTION AND INSPECTION OF THE BUILDING. THE BUILDING SHOULD BE ERECTED ON A PROPERLY DESIGNED FOUNDATION IN ACCORDANCE WITH THE BUILDING MANUFACTURER'S DESIGN MANUAL, THE ATTACHED DRAWINGS, AND GOOD ERECTION PRACTICES. THE END USER AND/OR ENGINEER OF RECORD IS TO CONFIRM THAT THESE LOADS COMPLY WITH REQUIREMENTS OF THE LOCAL BUILDING DEPT.

OCCUPANCY/RISK CATEGORY II - Normal Is 1.0000 Ie 1.00
 WIND LOAD ULTIMATE 122 MPH NOMINAL 94.50 MPH WIND EXPOSURE C
 CLOSURE TYPE Enclosed INTERNAL WIND COEF. -0.18 / 0.18
 GROUND SNOW LOAD 0.00 PSF ROOF SNOW LOAD 0.00 PSF Ce 1.0000 Ct 1.2000
 SNOW BANKING LOADS PER CODE
 COLLATERAL DEAD LOAD 1.00 PSF
 ROOF LIVE LOAD 20.00 PSF (REDUCIBLE Yes)
 DEAD LOAD 2.50 PSF (FOR ROOF PANELS AND PURLINS)

SEISMIC
 SPECTRAL RESPONSE Ss 0.1100 s1 0.0550 Sds 0.1000 Sd1 0.0800
 SITE CLASS D DESIGN RISK CATEGORY B Cs 0.0334

RESPONSE MODIFICATION FACTOR, R 3.000* FRAMES 3.000* BRACING
 BASIC SEISMIC FORCE RESISTING SYSTEM (LATERAL DIRECTIONS) = ORDINARY STEEL MOMENT FRAMES
 BASIC SEISMIC FORCE RESISTING SYSTEM (ENDWALLS) = ORDINARY STEEL MOMENT BRACED FRAMES
 BASIC SEISMIC FORCE RESISTING SYSTEM (LONGITUDINAL DIRECTIONS) = ORDINARY STEEL MOMENT FRAMES
 ANALYSIS PROCEDURE = EQUIVALENT LATERAL FORCE PROCEDURE

SERVICEABILITY CRITERIA

* STEEL SYSTEM NOT SPECIFICALLY DETAILED FOR SEISMIC RESISTANCE.

| MINIMUM DESIGN DEFLECTIONS | | | |
|----------------------------|-------|-----------------------|-------|
| Endwall Column | = 180 | Roof Panel (Live) | = 60 |
| Endwall Rafter (Live) | = 180 | Roof Panel (Wind) | = 60 |
| Endwall Rafter (Wind) | = 180 | Rigid Frame (Horz) | = 100 |
| Wall Girt | = 90 | Rigid Frame (Vert) | = 180 |
| Roof Purlin (Live) | = 150 | Rigid Frame (Seismic) | = 50 |
| Roof Purlin (Wind) | = 150 | | |
| Wall Panel | = 60 | | |

COMPONENTS & CLADDING (unfactored)

Wall Field Values = 29.670 psf / -29.670 psf
 Wall Edge Values = 29.670 psf / -54.396 psf

1.0 PSF COLL ONLY ALLOW LIGHTING AND HVAC DUCT TO HANG FROM ROOF SYSTEMS SUSPENSION OF ANY LOAD INDUCING SYSTEM IS EXPLICITLY PROHIBITED, UNLESS A CORRESPONDING REDUCTION IN CERTIFIED LIVE/SNOW LOADS CAN BE PERMITTED BY CODE. 8M

THE MBM DOES NOT CONSIDER VIBRATION ANALYSIS OF MEZZANINE SYSTEMS. 18


COLORS:

| | |
|------------------|-------|
| ROOF: | COLOR |
| WALLS: | COLOR |
| GABLE: | COLOR |
| EAVE: | COLOR |
| CORNER: | COLOR |
| FRAMED OPENINGS: | COLOR |
| GUTTER: | COLOR |
| DOWNSPOUTS: | COLOR |
| BASE: | COLOR |

| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: COVER PAGE | | | |
| DRAWING NO: PAGE 0C | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

⊕ Dia= 5/8"

⊕ Dia= 3/4"

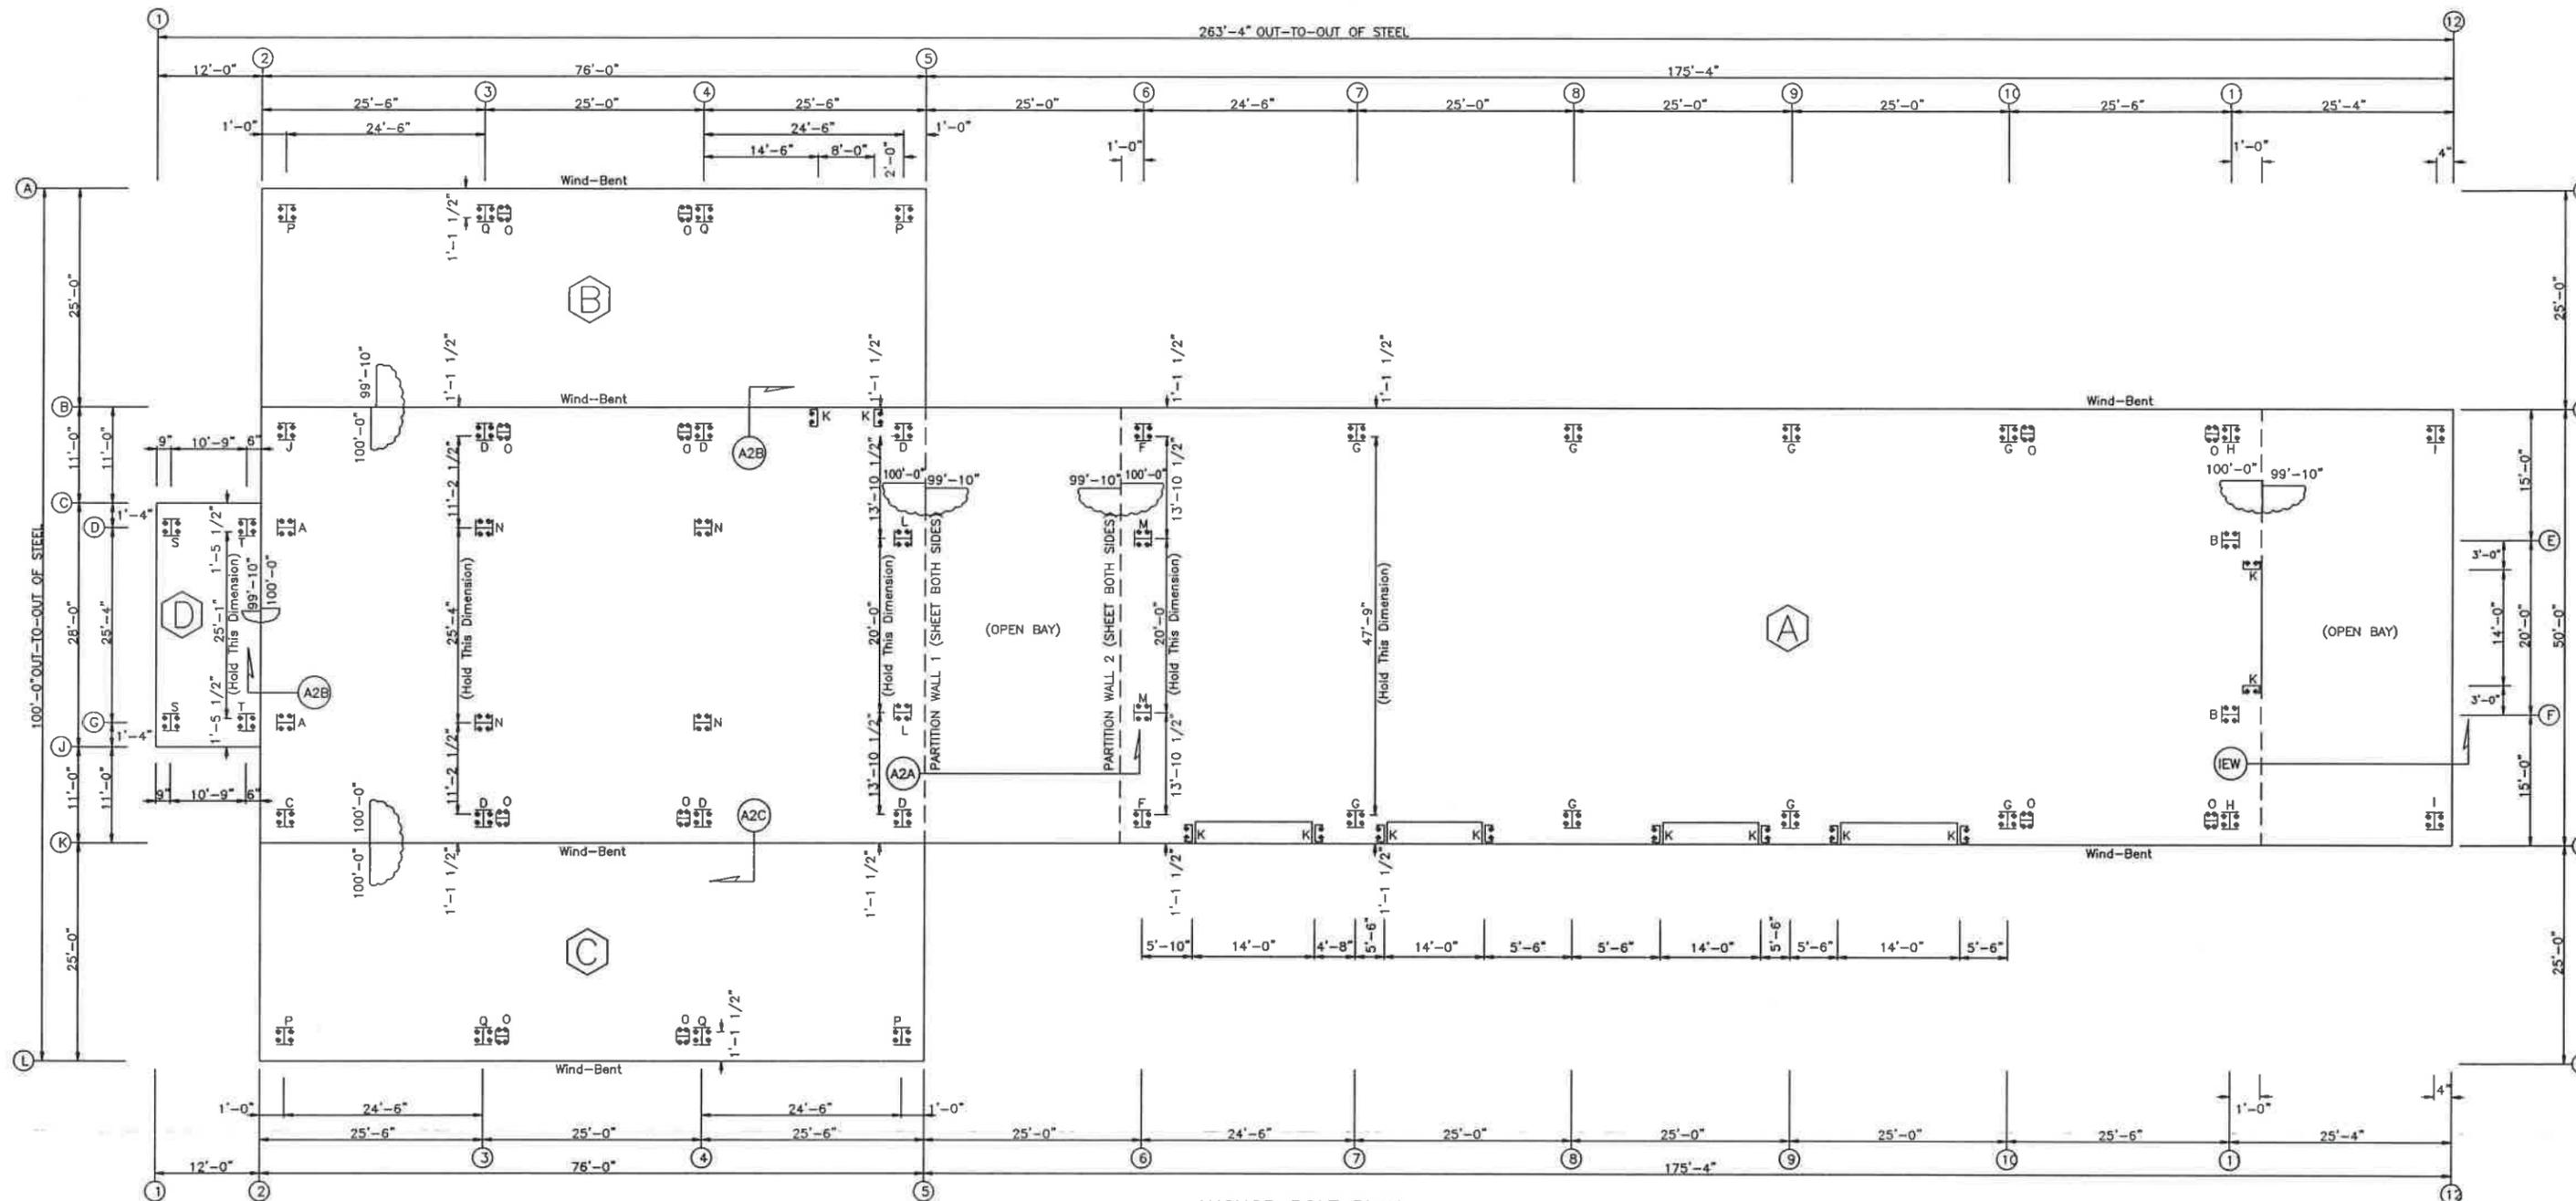


ANCHOR BOLT PLAN
 NOTE: All Base Plates ⊕ 100'-0" (Unless Noted)

NOTE: ALL FIELD LOCATED FRAMED OPENING LOCATIONS SHALL BE AT THE DISCRETION OF THE ERECTOR/CUSTOMER. IT IS RECOMMENDED THAT THESE ANCHORS BE LOCATED AT TIME OF ERECTION.


- FIELD LOCATE:
- (18) 3W x 7L FRAMED OPENINGS
 - (1) 8'-0" x 8'-0" FRAMED OPENING
 - (7) 3'-4" x 7'-2" FRAMED OPENINGS
 - (3) 6'-4" x 7'-2" FRAMED OPENINGS

| ISSUE | DET | CHK | DATE |
|--------------------------------------|-------------------|--------------------|----------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ANCHOR BOLT LAYOUT | | | |
| DRAWING NO: PAGE 1 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |


A2C

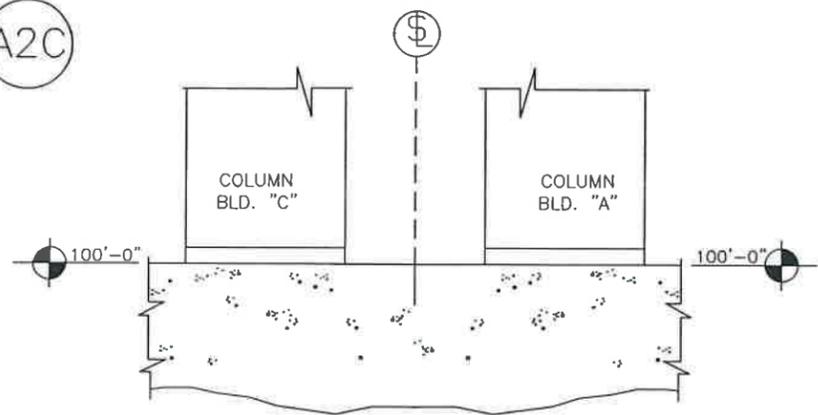


IEW

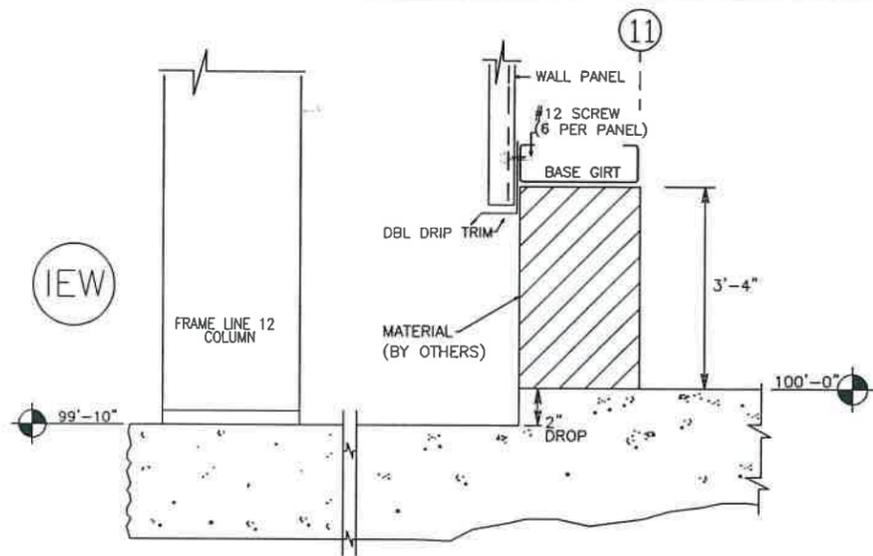

A2B

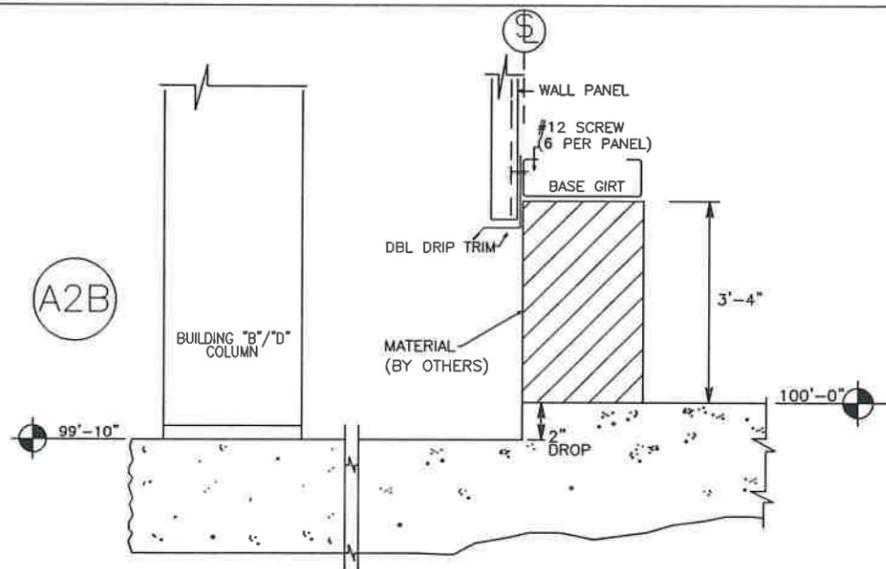


*CUSTOMER TO VERIFY

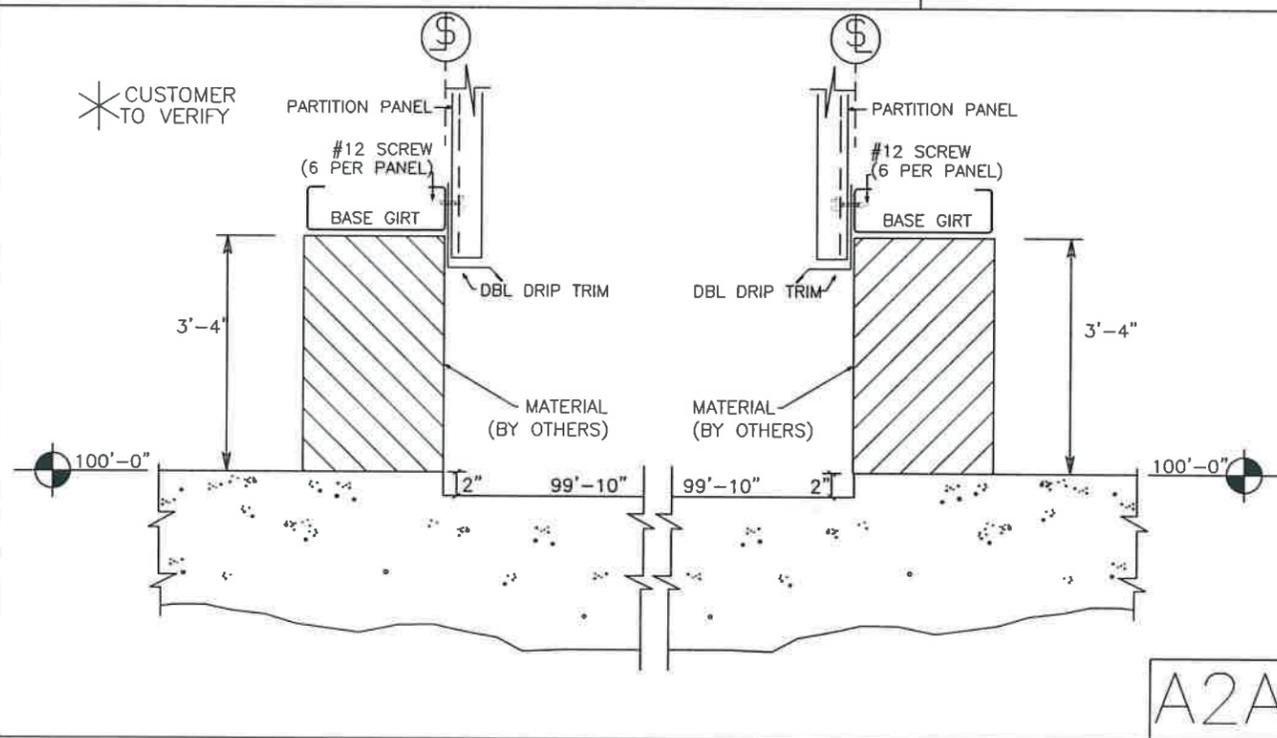


A2A


| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ANCHOR BOLT DETAILS | | | |
| DRAWING NO: PAGE 1.1 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

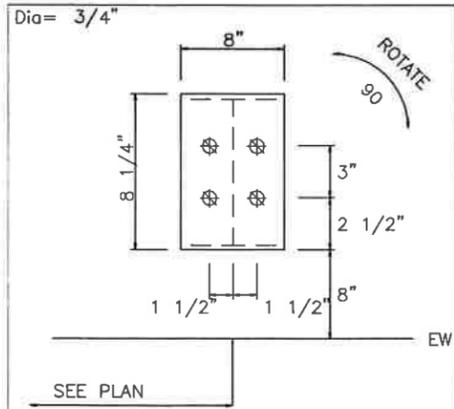


DETAIL A

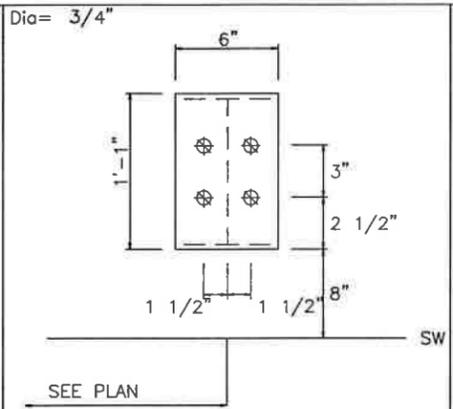


DETAIL D

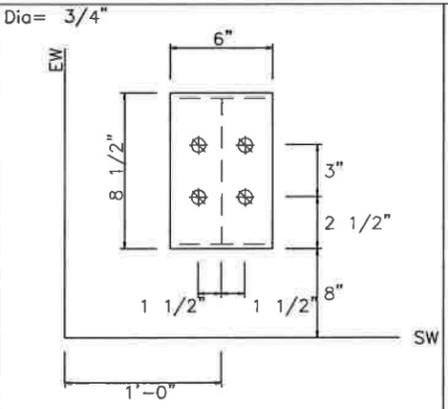


DETAIL H

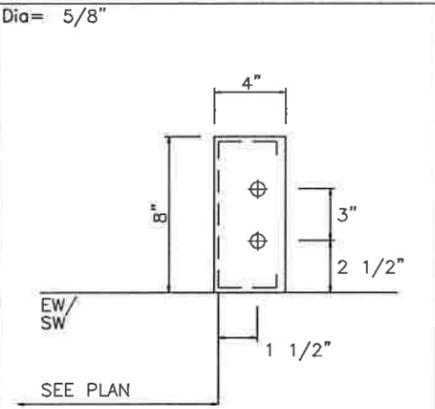


DETAIL K

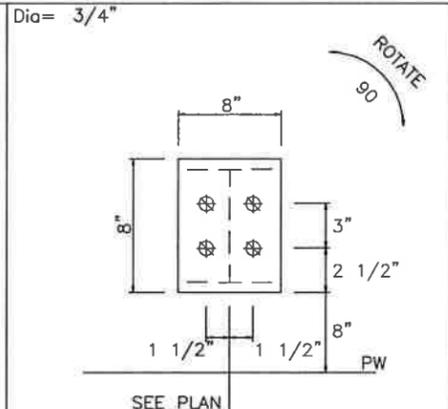


DETAIL M

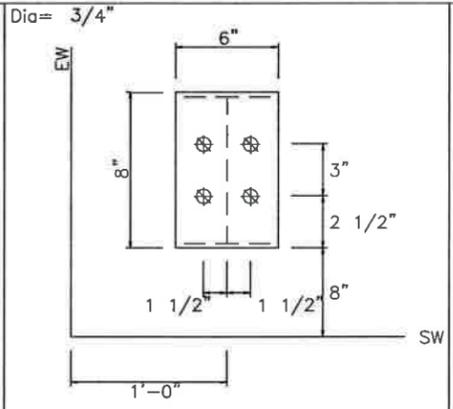


DETAIL P

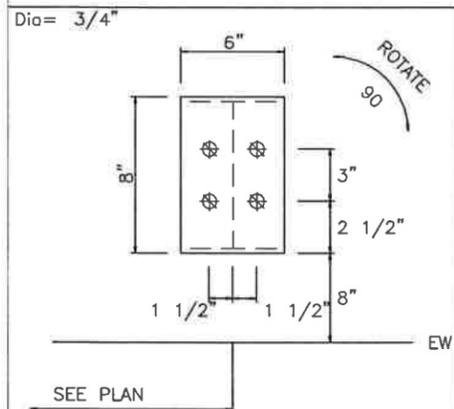


DETAIL B

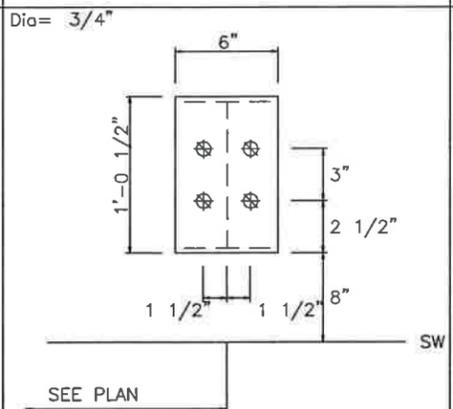


DETAIL F

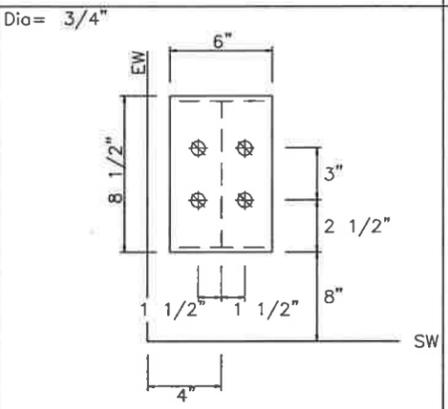


DETAIL I

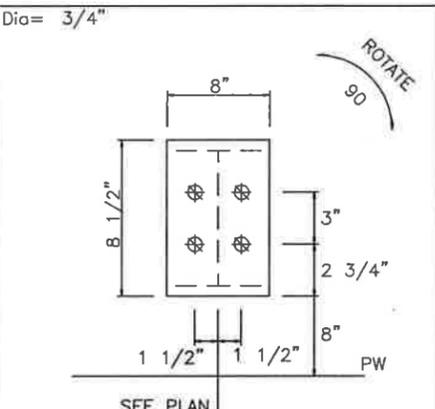


DETAIL L

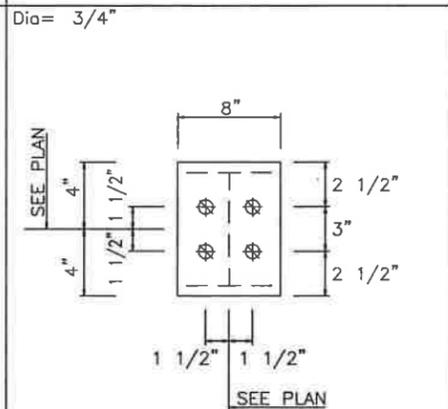


DETAIL N

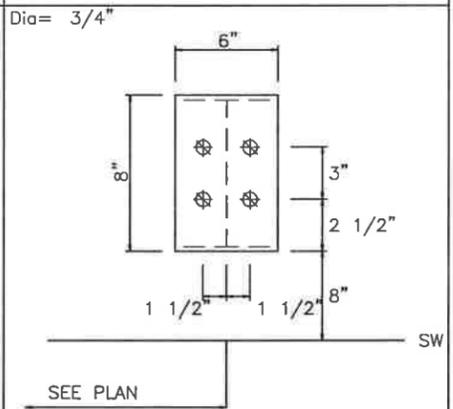


DETAIL Q

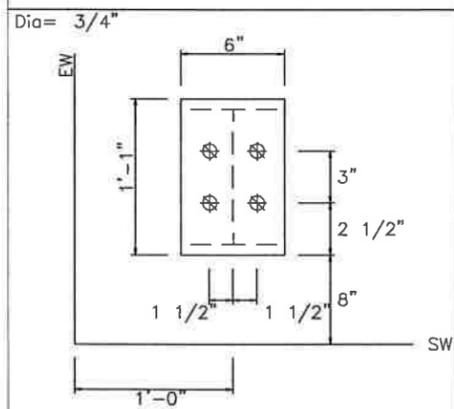


DETAIL C

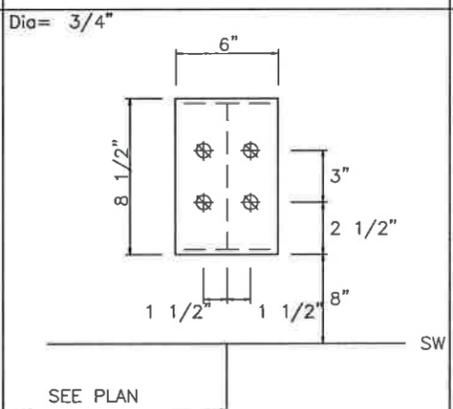


DETAIL G

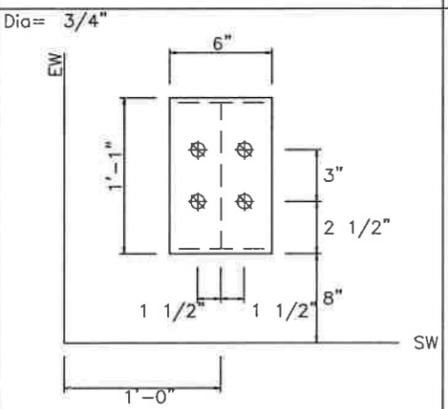


DETAIL J

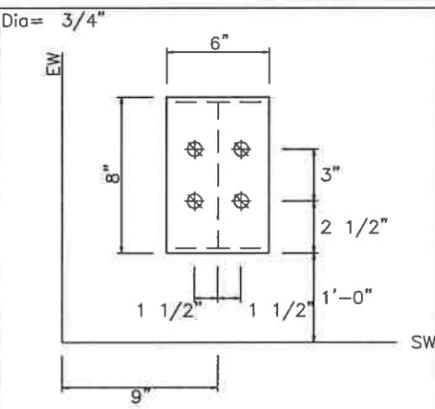



DETAIL S

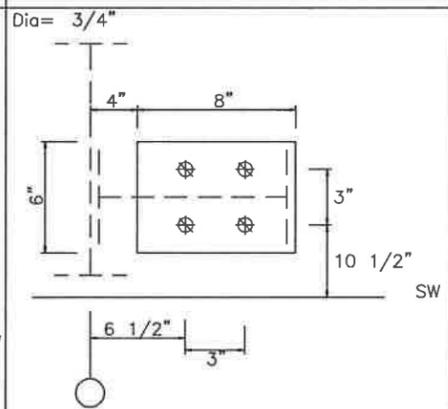

DETAIL O

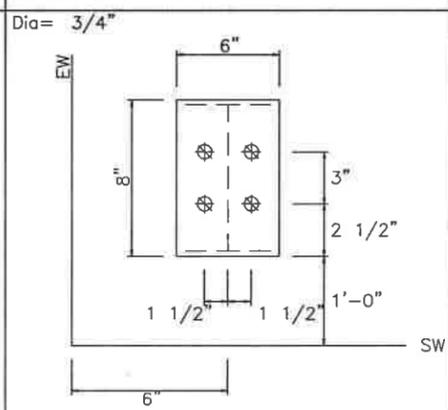


DETAIL T

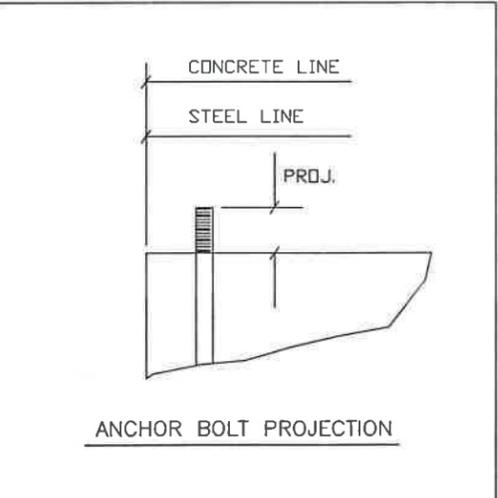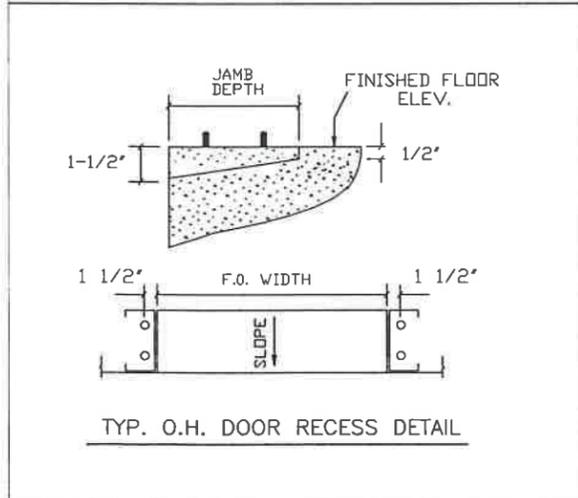


| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ANCHOR BOLT DETAILS | | | |
| DRAWING NO: PAGE 1.2 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |


FRAME LINES: 2

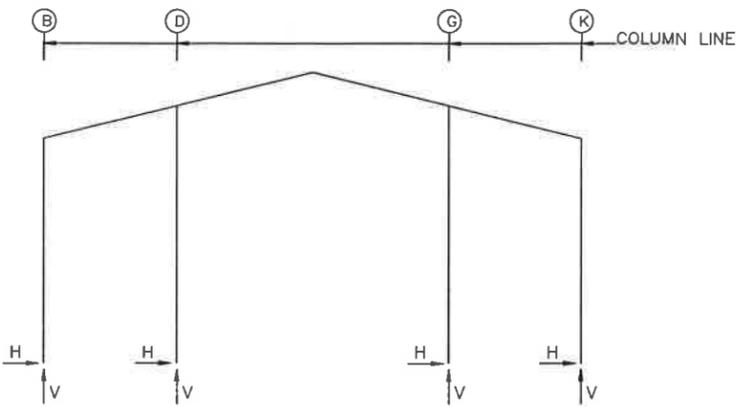

FRAME LINES: 5 6 11

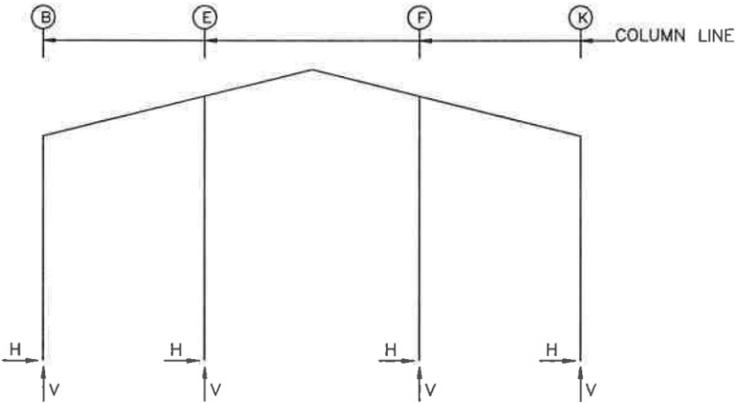

FRAME LINES: 3 4 7 8 9 10 12

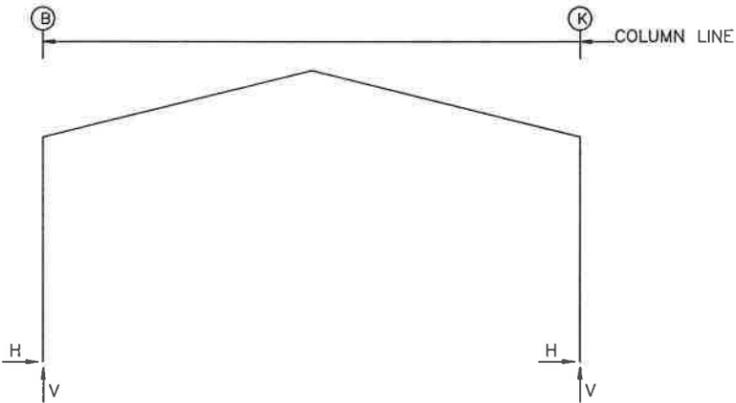

WIND BENT REACTIONS

| Loc | Line | Col Line | ± Reactions (k) | | | | Bolt Qty | Base Plate (in) | | | |
|------|------|----------|-----------------|-----------|--------------|--------------|----------|-----------------|--------|--------|-------|
| | | | Wind Horz | Wind Vert | Seismic Horz | Seismic Vert | | Width | Length | Thick | |
| F_SW | K | 3 | 2.4 | 3.7 | 1.6 | 2.5 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |
| F_SW | K | 4 | 2.4 | 3.7 | 1.6 | 2.5 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |
| F_SW | K | 10 | 2.4 | 3.6 | 1.6 | 2.5 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |
| F_SW | K | 11 | 2.4 | 3.6 | 1.6 | 2.5 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |
| B_SW | B | 11 | 2.4 | 3.6 | 1.6 | 2.5 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |
| B_SW | B | 10 | 2.4 | 3.6 | 1.6 | 2.5 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |
| B_SW | B | 4 | 2.4 | 3.7 | 1.6 | 2.5 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |
| B_SW | B | 3 | 2.4 | 3.7 | 1.6 | 2.5 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |

FLOOR COLUMN REACTIONS

| Frame Line | Col Line | Max_Vert Ld | Dead Vert (k) | Coll Vert (k) | Live Vert (k) | Anc_Bolt Qty | Base Plate Width | Base Plate Length | Base Plate Thick | Grout (in) | | |
|------------|----------|-------------|---------------|---------------|---------------|--------------|------------------|-------------------|------------------|------------|-------|-----|
| 3 | D | 2 | 69.5 | 23.6 | 0.5 | 45.4 | 4 | 0.750 | 8.000 | 8.000 | 0.375 | 0.0 |
| 3 | G | 2 | 69.5 | 23.6 | 0.5 | 45.4 | 4 | 0.750 | 8.000 | 8.000 | 0.375 | 0.0 |
| 4 | D | 2 | 69.5 | 23.6 | 0.5 | 45.4 | 4 | 0.750 | 8.000 | 8.000 | 0.375 | 0.0 |
| 4 | G | 2 | 69.5 | 23.6 | 0.5 | 45.4 | 4 | 0.750 | 8.000 | 8.000 | 0.375 | 0.0 |

NOTES FOR REACTIONS

Building reactions are based on the following building data:

- Width (ft) = 50.0
- Length (ft) = 251.3
- Eave Height (ft) = 21.0 / 21.0
- Roof Slope (rise/12) = 3.00 / 3.00
- Roof Dead Load (psf) = 3.8
- Wall Dead Load (psf) = 13.0
- Left Endwall (psf) = 13.0
- Right Endwall (psf) = 13.0
- Front Sidewall (psf) = 8.0
- Back Sidewall (psf) = 8.0
- Roof Live Load (psf) = 20.0
- Collateral Load (psf) = 3.0
- Wind Speed (mph) = 122.0
- Wind Code = FBC 23 (8th Edition)
- Exposure = C
- Closure = Enclosed
- Internal Wind Coeff = -0.18, +0.18
- Risk Category = II - Normal
- Importance - Wind = 1.00
- Importance - Seismic = 1.00
- Seismic Design Category = B
- Seismic Coeff (Sms) = 0.15

GENERAL NOTES

- FOUNDATION DESIGN AND CONSTRUCTION ARE NOT THE RESPONSIBILITY OF METAL BUILDING MANUFACTURER.
- ALL REACTIONS ARE UNFACTORED.
- ULTIMATE WIND LOADS ARE USED TO DERIVE THE WIND REACTION.
- ANCHOR BOLTS SHALL BE ACCURATELY SET TO A TOLLERANCE OF +/- 1/8" IN BOTH ELEVATION AND LOCATION.
- COLUMN BASE PLATES ARE DESIGNED NOT TO EXCEED A BEARING PRESSURE OF 1050 POUNDS PER SQUARE INCH.

BUILDING BRACING REACTIONS

| Loc | Line | Col Line | ± Reactions (k) | | | | Panel Shear (lb/ft) | Note |
|------|------|----------|-----------------|-----------|--------------|--------------|---------------------|------|
| | | | Wind Horz | Wind Vert | Seismic Horz | Seismic Vert | | |
| L_EW | 2 | | | | | | (h) | |
| F_SW | K | 3,4 | | | | | (a) | |
| | | 10,11 | | | | | (a) | |
| R_EW | 11 | | | | | | (h) | |
| B_SW | B | 10,11 | | | | | (a) | |
| | | 3,4 | | | | | (a) | |

(c) Wind bent in bay
(h) Rigid frame at endwall

FLOOR BRACING REACTIONS

| Orient | Offset | Location | ± Reactions (k) | | | |
|--------|--------|----------|-----------------|-----|--------------|--------------|
| | | | Start | End | Seismic Horz | Seismic Vert |
| Tran | 76.0 | B E | | | 1.1 | 1.1 |

Reactions for seismic represent shear force, Eh
Reaction values shown are unfactored

MEZZANINE LOADINGS

DEAD LOAD = 50 psf. (4" CONC., DECK & JOIST)
LIVE LOAD = 100 psf. (UNREDUCIBLE)
COLL LOAD = 1 psf.

*ADDITIONAL WALL WEIGHT CONSIDERED IN SEISMIC DESIGN.

PARTITION REACTIONS

| Part Id | Orient | --Max(k)-- | |
|---------|--------|------------|-----------|
| | | Dead Vert | Wind Horz |
| 1 | Trans. | 0.4 | 3.9 |
| 2 | Trans. | 0.6 | 3.9 |
| 3 | Trans. | 0.4 | 3.9 |

NOTE: THE FRAMING AT BOTH ENDWALLS IS NOT DESIGNED TO ACCOMMODATE FUTURE ADDITIONS. REACTIONS CORRESPONDING TO THESE FRAME LINES REFLECT LOADINGS FOR ACTUAL TRIBUTARY AREA AND ARE NOT INTENDED TO INCLUDE ANY FUTURE MODIFICATIONS UNLESS NOTED OTHERWISE.

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc_Bolt Qty | Anc_Dia | Base_Plate Width | Base_Plate Length | Base_Plate Thick | Grout (in) |
|----------|----------|--------------|---------|------------------|-------------------|------------------|------------|
| 2 | B | 4 | 0.750 | 6.000 | 13.00 | 0.375 | 0.0 |
| 2 | K | 4 | 0.750 | 6.000 | 13.00 | 0.375 | 0.0 |
| 2 | D | 4 | 0.750 | 8.000 | 8.250 | 0.500 | 0.0 |
| 2 | G | 4 | 0.750 | 8.000 | 8.250 | 0.500 | 0.0 |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc_Bolt Qty | Anc_Dia | Base_Plate Width | Base_Plate Length | Base_Plate Thick | Grout (in) |
|----------|----------|--------------|---------|------------------|-------------------|------------------|------------|
| 3* | B | 4 | 0.750 | 6.000 | 13.00 | 0.375 | 0.0 |
| 3* | K | 4 | 0.750 | 6.000 | 13.00 | 0.375 | 0.0 |

3* Frame lines: 3 4

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc_Bolt Qty | Anc_Dia | Base_Plate Width | Base_Plate Length | Base_Plate Thick | Grout (in) |
|----------|----------|--------------|---------|------------------|-------------------|------------------|------------|
| 5 | B | 4 | 0.750 | 6.000 | 13.00 | 0.375 | 0.0 |
| 5 | K | 4 | 0.750 | 6.000 | 13.00 | 0.375 | 0.0 |
| 5 | E | 4 | 0.750 | 8.000 | 8.500 | 0.375 | 0.0 |
| 5 | F | 4 | 0.750 | 8.000 | 8.500 | 0.375 | 0.0 |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc_Bolt Qty | Anc_Dia | Base_Plate Width | Base_Plate Length | Base_Plate Thick | Grout (in) |
|----------|----------|--------------|---------|------------------|-------------------|------------------|------------|
| 6 | B | 4 | 0.750 | 6.000 | 12.50 | 0.375 | 0.0 |
| 6 | K | 4 | 0.750 | 6.000 | 12.50 | 0.375 | 0.0 |
| 6 | E | 4 | 0.750 | 8.000 | 8.000 | 0.375 | 0.0 |
| 6 | F | 4 | 0.750 | 8.000 | 8.000 | 0.375 | 0.0 |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc_Bolt Qty | Anc_Dia | Base_Plate Width | Base_Plate Length | Base_Plate Thick | Grout (in) |
|----------|----------|--------------|---------|------------------|-------------------|------------------|------------|
| 7* | B | 4 | 0.750 | 6.000 | 8.500 | 0.500 | 0.0 |
| 7* | K | 4 | 0.750 | 6.000 | 8.500 | 0.500 | 0.0 |

7* Frame lines: 7 8 9 10

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc_Bolt Qty | Anc_Dia | Base_Plate Width | Base_Plate Length | Base_Plate Thick | Grout (in) |
|----------|----------|--------------|---------|------------------|-------------------|------------------|------------|
| 11 | B | 4 | 0.750 | 6.000 | 8.500 | 0.375 | 0.0 |
| 11 | K | 4 | 0.750 | 6.000 | 8.500 | 0.375 | 0.0 |
| 11 | E | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |
| 11 | F | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc_Bolt Qty | Anc_Dia | Base_Plate Width | Base_Plate Length | Base_Plate Thick | Grout (in) |
|----------|----------|--------------|---------|------------------|-------------------|------------------|------------|
| 12 | B | 4 | 0.750 | 6.000 | 8.500 | 0.375 | 0.0 |
| 12 | K | 4 | 0.750 | 6.000 | 8.500 | 0.375 | 0.0 |

ANCHOR BOLT SUMMARY

| Qty | Locate | Dia (in) | Type | Projection (in) |
|-----|---------|----------|------|-----------------|
| 24 | Jamb | 5/8" | A307 | 1.50 |
| 16 | Endwall | 3/4" | GR36 | 1.50 |
| 104 | Frame | 3/4" | GR36 | 2.50 |
| 32 | WindCol | 3/4" | GR36 | 2.50 |
| 16 | Floor | 3/4" | GR36 | 2.50 |

RIGID FRAME: BASIC COLUMN REACTIONS (k)


| Frm Line | Column Line | Dead | | Collateral | | Live | | Floor | | Wind_Left1 | | Wind_Right1 | |
|----------|-------------|------|------|------------|------|------|------|-------|------|------------|-------|-------------|-------|
| | | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert |
| 2 | B | -0.1 | 7.1 | -0.1 | 0.9 | -0.3 | 4.6 | 0.0 | 10.2 | -1.9 | -14.6 | 4.9 | -2.3 |
| 2 | K | 0.1 | 6.9 | 0.1 | 0.9 | 0.3 | 4.6 | 0.0 | 10.2 | -1.6 | -3.7 | 2.6 | -15.7 |
| 2 | D | -0.2 | 14.8 | 0.1 | 1.4 | 0.1 | 4.6 | 0.1 | 24.0 | 0.1 | -8.8 | 0.2 | -14.5 |
| 2 | G | 0.0 | 14.8 | 0.0 | 1.4 | 0.0 | 4.6 | 0.0 | 24.0 | -0.1 | -10.9 | 0.2 | -5.5 |

BUILDING "A" REACTIONS

| ISSUE | DET | CHK | DATE |
|-------|-----|-----|------|
| | | | |

CUSTOMER: PINNACLE SITE SOLUTIONS
JOB NO: 9249R1
DATE: 10/13/25
LOCATION: HIGH SPRINGS, FL 32643
DRAWING NAME: ANCHOR BOLT REACTIONS
DRAWING NO: PAGE 1.3
DRAWN BY: DJH
CHECKED BY: SPW
SCALE: NONE

FRAME LINES: 2 3 4 5

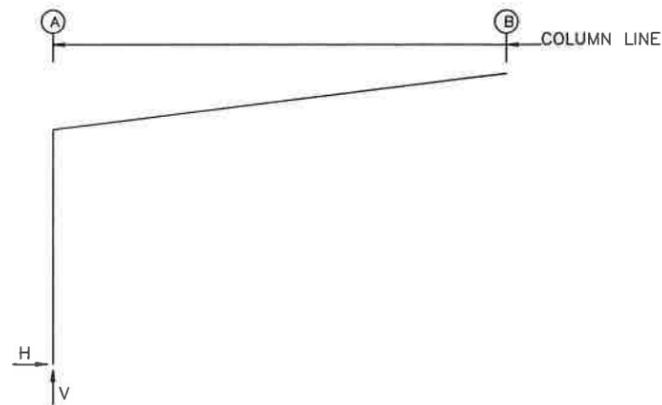

RIGID FRAME: BASIC COLUMN REACTIONS (k)

| Frame Line | Column Line | ---Dead--- | | ---Collateral--- | | ---Live--- | | ---Wind_Left1--- | | ---Wind_Right1--- | | ---Wind_Left2--- | |
|------------|-------------|------------|------|------------------|------|------------|------|------------------|-------|-------------------|------|------------------|------|
| | | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert |
| 2 | A | 0.0 | 1.1 | 0.0 | 0.6 | 0.0 | 3.9 | 0.2 | -9.3 | 2.0 | -6.2 | -2.1 | -2.8 |
| 3* | A | 0.0 | 1.7 | 0.0 | 1.0 | -0.1 | 4.9 | 0.6 | -13.3 | 3.4 | -9.6 | -3.7 | -2.6 |
| 5 | A | 0.0 | 1.1 | 0.0 | 0.6 | 0.0 | 3.9 | 0.2 | -9.3 | 2.0 | -6.2 | -2.1 | -2.8 |

| Frame Line | Column Line | ---Wind_Right2--- | | ---Wind_Long1--- | | ---Wind_Long2--- | |
|------------|-------------|-------------------|------|------------------|-------|------------------|------|
| | | Horz | Vert | Horz | Vert | Horz | Vert |
| 2 | A | -0.3 | 0.2 | 2.1 | -7.2 | 2.1 | -5.4 |
| 3* | A | -0.9 | 1.1 | 3.9 | -11.9 | 3.9 | -9.0 |
| 5 | A | -0.3 | 0.2 | 2.1 | -7.2 | 2.1 | -5.4 |

3* Frame lines: 3 4

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc. Bolt Qty | Bolt Dia | Base_Plate (in) | | | Grout (in) |
|----------|----------|---------------|----------|-----------------|--------|-------|------------|
| | | | | Width | Length | Thick | |
| 2 | A | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc. Bolt Qty | Bolt Dia | Base_Plate (in) | | | Grout (in) |
|----------|--------------|---------------|----------|-----------------|--------|-------|------------|
| | | | | Width | Length | Thick | |
| 3* | A | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |
| 3* | Frame lines: | | | 3 | 4 | | |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc. Bolt Qty | Bolt Dia | Base_Plate (in) | | | Grout (in) |
|----------|----------|---------------|----------|-----------------|--------|-------|------------|
| | | | | Width | Length | Thick | |
| 5 | A | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |

ANCHOR BOLT SUMMARY

| Qty | Locate | Dia (in) | Type | Projection (in) |
|-----|---------|----------|------|-----------------|
| 16 | Frame | 3/4" | GR36 | 2.50 |
| 8 | WindCol | 3/4" | GR36 | 2.50 |

GENERAL NOTES

- FOUNDATION DESIGN AND CONSTRUCTION ARE NOT THE RESPONSIBILITY OF METAL BUILDING MANUFACTURER.
- ALL REACTIONS ARE UNFACTORED.
- ULTIMATE WIND LOADS ARE USED TO DERIVE THE WIND REACTION.
- ANCHOR BOLTS SHALL BE ACCURATELY SET TO A TOLERANCE OF +/- 1/8" IN BOTH ELEVATION AND LOCATION.
- COLUMN BASE PLATES ARE DESIGNED NOT TO EXCEED A BEARING PRESSURE OF 1050 POUNDS PER SQUARE INCH.

BUILDING BRACING REACTIONS


| ---Wall Loc | ---Col Line | ± Reactions(k) | | | | Panel_Shear (lb/ft) | | Note |
|-------------|-------------|----------------|--------------|-----------------|-----------------|---------------------|------|------|
| | | ---Wind Horz | ---Wind Vert | ---Seismic Horz | ---Seismic Vert | Wind | Seis | |
| L_EW | 2 | | | | | | | (h) |
| F_SW | B | | | | | | | (e) |
| R_EW | 5 | | | | | | | (h) |
| B_SW | A 3,4 | | | | | | | (o) |

- (a) Wind bent in bay
- (e) Bracing loads applied to supporting building
- (h) Rigid frame at endwall

Reactions for seismic represent shear force, Eh
Reaction values shown are unfactored

NOTE: THE FRAMING AT BOTH ENDWALLS IS NOT DESIGNED TO ACCOMMODATE FUTURE ADDITIONS. REACTIONS CORRESPONDING TO THESE FRAME LINES REFLECT LOADINGS FOR ACTUAL TRIBUTARY AREA AND ARE NOT INTENDED TO INCLUDE ANY FUTURE MODIFICATIONS UNLESS NOTED OTHERWISE.

WIND BENT REACTIONS




| ---Wall Loc | ---Col Line | Wind(k) Horz | ± Reactions | | Bolt(in) Qty | Bolt Dia | Base_Plate(in) | | |
|-------------|-------------|--------------|--------------|-----------------|--------------|----------|-----------------|--------|--------|
| | | | Wind(k) Vert | Seismic(k) Horz | | | Seismic(k) Vert | Width | Length |
| B_SW | A | 1.0 | 0.9 | 0.2 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |
| B_SW | A | 1.0 | 0.9 | 0.2 | 4 | 0.750 | 6.000 | 12.000 | 0.375 |

BUILDING "B" REACTIONS

| ISSUE | DET | CHK | DATE |
|-------------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ANCHOR BOLT REACTIONS | | | |
| DRAWING NO: PAGE 1.4 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

FRAME LINES: 5 4 3 2

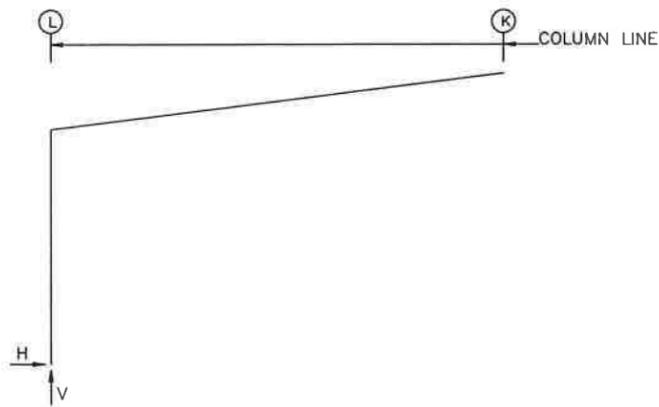

RIGID FRAME: BASIC COLUMN REACTIONS (k)

| Frame Line | Column Line | ---Dead--- | | ---Collateral--- | | ---Live--- | | ---Wind_Left1--- | | ---Wind_Right1--- | | ---Wind_Left2--- | |
|------------|-------------|------------|------|------------------|------|------------|------|------------------|------|-------------------|------|------------------|------|
| | | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert |
| 5 | L | 0.0 | 0.9 | 0.0 | 0.6 | 0.0 | 3.9 | -0.6 | -7.1 | 1.2 | -4.0 | -1.4 | -5.0 |
| 4* | L | 0.0 | 1.3 | 0.0 | 1.0 | -0.1 | 4.9 | -0.8 | -9.7 | 2.0 | -6.0 | -2.2 | -6.2 |
| 2 | L | 0.0 | 0.9 | 0.0 | 0.6 | 0.0 | 3.9 | -0.6 | -7.1 | 1.2 | -4.0 | -1.4 | -5.0 |

| Frame Line | Column Line | ---Wind_Right2--- | | ---Wind_Long1--- | | ---Wind_Long2--- | |
|------------|-------------|-------------------|------|------------------|------|------------------|------|
| | | Horz | Vert | Horz | Vert | Horz | Vert |
| 5 | L | 0.4 | -2.0 | 1.3 | -5.0 | 1.3 | -3.2 |
| 4* | L | 0.6 | -2.5 | 2.4 | -8.3 | 2.5 | -5.4 |
| 2 | L | 0.4 | -2.0 | 1.3 | -5.0 | 1.3 | -3.2 |

4* Frame lines: 4 3

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc. Qty | Bolt Dia | Base_Plate (in) | | | Grout (in) |
|----------|----------|----------|----------|-----------------|--------|-------|------------|
| | | | | Width | Length | Thick | |
| 5 | L | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc. Qty | Bolt Dia | Base_Plate (in) | | | Grout (in) |
|----------|----------|----------|----------|-----------------|--------|-------|------------|
| | | | | Width | Length | Thick | |
| 4* | L | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |

4* Frame lines: 4 3

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc. Qty | Bolt Dia | Base_Plate (in) | | | Grout (in) |
|----------|----------|----------|----------|-----------------|--------|-------|------------|
| | | | | Width | Length | Thick | |
| 2 | L | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |

ANCHOR BOLT SUMMARY

| Qty | Locate | Dia (in) | Type | Projection (in) |
|-----|---------|----------|------|-----------------|
| 16 | Frame | 3/4" | GR36 | 2.50 |
| 8 | WindCol | 3/4" | GR36 | 2.50 |

GENERAL NOTES

- FOUNDATION DESIGN AND CONSTRUCTION ARE NOT THE RESPONSIBILITY OF METAL BUILDING MANUFACTURER.
- ALL REACTIONS ARE UNFACTORED.
- ULTIMATE WIND LOADS ARE USED TO DERIVE THE WIND REACTION.
- ANCHOR BOLTS SHALL BE ACCURATELY SET TO A TOLLERANCE OF +/- 1/8" IN BOTH ELEVATION AND LOCATION.
- COLUMN BASE PLATES ARE DESIGNED NOT TO EXCEED A BEARING PRESSURE OF 1050 POUNDS PER SQUARE INCH.

BUILDING BRACING REACTIONS


| Wall Loc | Col Line | ± Reactions(k) | | | | Panel Shear (lb/ft) | | Note |
|----------|----------|-----------------|-----------|--------------|--------------|---------------------|------|------|
| | | Wind Horz | Wind Vert | Seismic Horz | Seismic Vert | Wind | Seis | |
| L_EW | 5 | | | | | | | (h) |
| F_SW | K | | | | | | | (e) |
| R_EW | 2 | | | | | | | (h) |
| B_SW | L 4,3 | | | | | | | (a) |

- (a) Wind bent in bay
- (e) Bracing loads applied to supporting building
- (h) Rigid frame at endwall

Reactions for seismic represent shear force, Eh
Reaction values shown are unfactored

NOTE: THE FRAMING AT BOTH ENDWALLS IS NOT DESIGNED TO ACCOMMODATE FUTURE ADDITIONS. REACTIONS CORRESPONDING TO THESE FRAME LINES REFLECT LOADINGS FOR ACTUAL TRIBUTARY AREA AND ARE NOT INTENDED TO INCLUDE ANY FUTURE MODIFICATIONS UNLESS NOTED OTHERWISE.

WIND BENT REACTIONS



| Wall Loc | Col Line | Bolt Qty | Bolt Dia | Base_Plate Width (in) | Base_Plate Length (in) | Base_Plate Thick (in) | ± Reactions | | |
|----------|----------|----------|----------|-----------------------|------------------------|-----------------------|-------------|-----------|--------------|
| | | | | | | | Wind Horz | Wind Vert | Seismic Vert |
| B_SW | L 3 | 4 | 0.750 | 6.000 | 12.000 | 0.375 | 1.0 | 0.9 | 0.4 |
| B_SW | L 4 | 4 | 0.750 | 6.000 | 12.000 | 0.375 | 1.0 | 0.9 | 0.4 |

BUILDING "C" REACTIONS

| ISSUE | DET | CHK | DATE |
|-------|-----|-----|------|
| | | | |

BUILDINGS AND MORE

CUSTOMER: PINNACLE SITE SOLUTIONS


JOB NO: 9249R1 DATE: 10/13/25

LOCATION: HIGH SPRINGS, FL 32643

DRAWING NAME: ANCHOR BOLT REACTIONS

DRAWING NO: PAGE 1.5 DRAWN BY: DJH CHECKED BY: SPW SCALE: NONE

FRAME LINES: 1 2

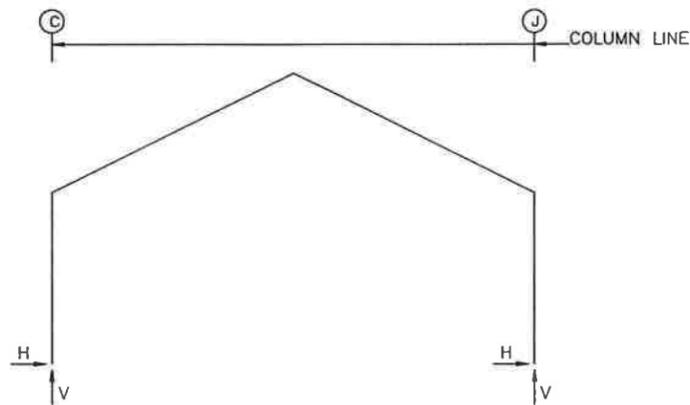

RIGID FRAME: BASIC COLUMN REACTIONS (k)

| Frame Line | Column Line | ---Dead--- | | ---Collateral--- | | ---Live--- | | ---Wind_Left1--- | | ---Wind_Right1--- | | ---Wind_Left2--- | |
|------------|-------------|------------|------|------------------|------|------------|------|------------------|------|-------------------|------|------------------|------|
| | | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert |
| 1 | C | 0.1 | 1.1 | 0.1 | 0.6 | 0.3 | 2.4 | -1.2 | -2.4 | 0.8 | -1.7 | -1.4 | -1.3 |
| 1 | J | -0.1 | 1.1 | -0.1 | 0.6 | -0.3 | 2.4 | -0.8 | -1.7 | 1.2 | -2.4 | -0.6 | -0.5 |
| 2 | C | 0.1 | 0.5 | 0.0 | 0.1 | 0.4 | 1.8 | -1.2 | -1.8 | 0.6 | -1.1 | -1.3 | -1.0 |
| 2 | J | -0.1 | 0.5 | 0.0 | 0.1 | -0.4 | 1.8 | -0.6 | -1.1 | 1.2 | -1.8 | -0.5 | -0.3 |

| Frame Line | Column Line | ---Wind_Right2--- | | ---Wind_Long1--- | | ---Wind_Long2--- | | ---Seismic_Left--- | | Seismic_Right | | ---Wind_Left3--- | |
|------------|-------------|-------------------|------|------------------|------|------------------|------|--------------------|------|---------------|------|------------------|------|
| | | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert | Horz | Vert |
| 1 | C | 0.6 | -0.5 | 0.1 | -3.9 | 0.4 | 0.1 | 0.0 | 0.0 | 0.0 | 0.0 | -1.5 | -1.4 |
| 1 | J | 1.4 | -1.3 | -0.1 | -3.9 | -0.4 | 0.1 | 0.0 | 0.0 | 0.0 | 0.0 | -1.2 | -0.8 |
| 2 | C | 0.5 | -0.3 | 0.1 | -2.8 | 0.4 | 0.1 | 0.0 | 0.0 | 0.0 | 0.0 | -1.4 | -1.1 |
| 2 | J | 1.3 | -1.0 | -0.1 | -2.8 | -0.4 | 0.1 | 0.0 | 0.0 | 0.0 | 0.0 | -0.9 | -0.5 |

| Frame Line | Column Line | ---Wind_Right3--- | | ---Wind_Left4--- | | ---Wind_Right4--- | |
|------------|-------------|-------------------|------|------------------|------|-------------------|------|
| | | Horz | Vert | Horz | Vert | Horz | Vert |
| 1 | C | 1.2 | -0.8 | -1.7 | -0.2 | 1.0 | 0.3 |
| 1 | J | 1.5 | -1.4 | -1.0 | 0.3 | 1.7 | -0.2 |
| 2 | C | 0.9 | -0.5 | -1.5 | -0.2 | 0.8 | 0.3 |
| 2 | J | 1.4 | -1.1 | -0.8 | 0.3 | 1.5 | -0.2 |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc. Bolt Qty | Bolt Dia | Base_Plate (in) | | | Grout (in) |
|----------|----------|---------------|----------|-----------------|--------|-------|------------|
| | | | | Width | Length | Thick | |
| 1 | C | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |
| 1 | J | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

| Frm Line | Col Line | Anc. Bolt Qty | Bolt Dia | Base_Plate (in) | | | Grout (in) |
|----------|----------|---------------|----------|-----------------|--------|-------|------------|
| | | | | Width | Length | Thick | |
| 2 | C | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |
| 2 | J | 4 | 0.750 | 6.000 | 8.000 | 0.375 | 0.0 |

ANCHOR BOLT SUMMARY

| Qty | Locate | Dia (in) | Type | Projection (in) |
|-----|--------|----------|------|-----------------|
| 16 | Frame | 3/4" | GR36 | 2.50 |

GENERAL NOTES

- FOUNDATION DESIGN AND CONSTRUCTION ARE NOT THE RESPONSIBILITY OF METAL BUILDING MANUFACTURER.
- ALL REACTIONS ARE UNFACTORED.
- ULTIMATE WIND LOADS ARE USED TO DERIVE THE WIND REACTION.
- ANCHOR BOLTS SHALL BE ACCURATELY SET TO A TOLLERANCE OF +/- 1/8" IN BOTH ELEVATION AND LOCATION.
- COLUMN BASE PLATES ARE DESIGNED NOT TO EXCEED A BEARING PRESSURE OF 1050 POUNDS PER SQUARE INCH.

BUILDING BRACING REACTIONS

| Wall Loc | Col Line | ± Reactions(k) | | | | Panel_Shear (lb/ft) | | Note |
|----------|----------|----------------|-----------|--------------|--------------|---------------------|------|------|
| | | Wind Horz | Wind Vert | Seismic Horz | Seismic Vert | Wind | Seis | |
| L_EW | 1 | | | | | | | (h) |
| F_SW | J | | | | | | | (1) |
| R_EW | 2 | | | | | | | (h) |
| B_SW | C | | | | | | | (1) |

(h)Rigid frame at endwall
(1)Building "A" Tie-in

Reactions for seismic represent shear force, Eh
Reaction values shown are unfactored

NOTES FOR REACTIONS

Building reactions are based on the following building data:

- Width (ft) = 28.0
- Length (ft) = 12.0
- Eave Height (ft) = 10.0 / 10.0
- Roof Slope (rise/12) = 6.00 / 6.00
- Roof Dead Load (psf) = 2.5
- Wall Dead Load (psf) = 2.0
- Left Endwall (psf) = 0.0
- Right Endwall (psf) = 2.0
- Front Sidewall (psf) = 2.0
- Back Sidewall (psf) = 2.0
- Roof Live Load (psf) = 20.0
- Collateral Load (psf) = 1.0
- Wind Speed (mph) = 122.0
- Wind Code = FBC 23 (8th Edition)
- Exposure = C
- Closure = Enclosed
- Internal Wind Coeff = -0.18, +0.18
- Risk Category = II - Normal
- Importance - Wind = 1.00
- Importance - Seismic = 1.00
- Seismic Design Category = B
- Seismic Coeff (Sms) = 0.15


BUILDING "D" REACTIONS

| ISSUE | DET | CHK | DATE |
|-------|-----|-----|------|
| | | | |

BUILDINGS AND MORE

| | | | |
|--|-------------------|--------------------|----------------|
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ANCHOR BOLT REACTIONS | | | |
| DRAWING NO: PAGE 1.6 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

NOTE: THE FRAMING AT BOTH ENDWALLS IS NOT DESIGNED TO ACCOMMODATE FUTURE ADDITIONS. REACTIONS CORRESPONDING TO THESE FRAME LINES REFLECT LOADINGS FOR ACTUAL TRIBUTARY AREA AND ARE NOT INTENDED TO INCLUDE ANY FUTURE MODIFICATIONS UNLESS NOTED OTHERWISE.

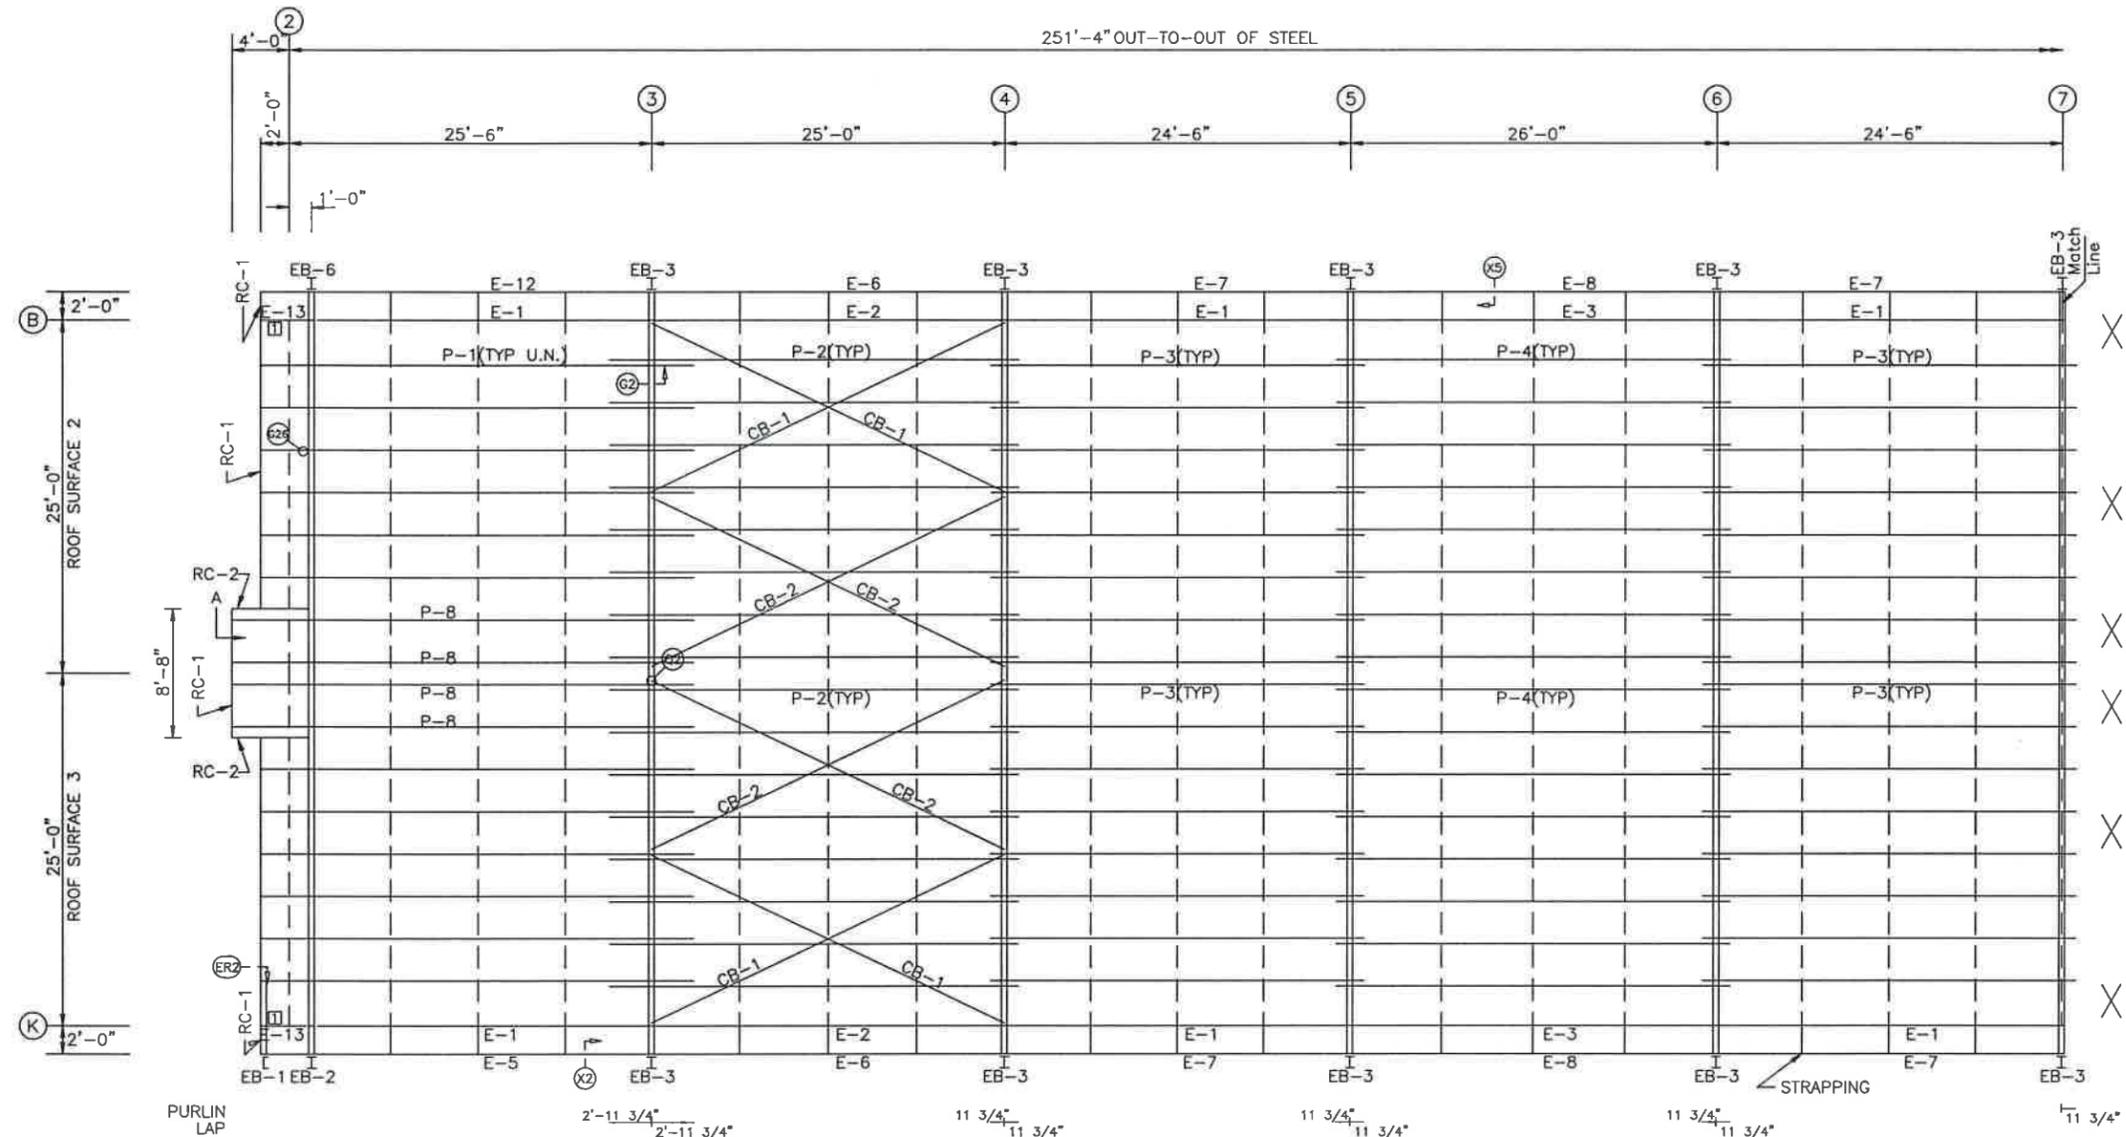


ROOF FRAMING PLAN


| EXTENSION/CANOPY BOLTS | | | | |
|------------------------|------|------|------|--------|
| ROOF PLAN | | | | |
| MARK | QUAN | TYPE | DIA | LENGTH |
| EB-2 | 4 | A325 | 5/8" | 2" |
| EB-3 | 4 | A325 | 5/8" | 2" |
| EB-4 | 4 | A325 | 5/8" | 2" |
| EB-5 | 4 | A325 | 5/8" | 2" |
| EB-6 | 4 | A325 | 5/8" | 2" |

| MEMBER TABLE | | |
|--------------|----------|-------------|
| ROOF PLAN | | |
| MARK | PART | LENGTH |
| EB-1 | 10X2CH16 | 5'-7 7/8" |
| EB-2 | W10X12 | 3'-5 7/8" |
| EB-3 | W10X12 | 3'-6 3/4" |
| EB-6 | W10X12 | 3'-5 7/8" |
| P-1 | 10x25Z16 | 32'-5 1/2" |
| P-2 | 10x25Z16 | 28'-11 1/2" |
| P-3 | 10x25Z16 | 26'-5 1/2" |
| P-4 | 10x25Z16 | 27'-11 1/2" |
| P-8 | 10x25Z16 | 32'-5 1/2" |
| E-1 | 10LE14@3 | 23'-9 1/2" |
| E-2 | 10LE14@3 | 24'-3 1/2" |
| E-3 | 10LE14@3 | 25'-3 1/2" |
| E-5 | 10x35C14 | 27'-5 1/2" |
| E-6 | 10x35C14 | 24'-11 1/2" |
| E-7 | 10x35C14 | 24'-5 1/2" |
| E-8 | 10x35C14 | 25'-11 1/2" |
| E-12 | 10x35C14 | 27'-5 1/2" |
| E-13 | 10LE14@3 | 2'-7 1/2" |
| CB-1 | 1/4 CBL | 27'-9" |
| CB-2 | 1/4 CBL | 28'-5" |


| CONNECTION PLATES | |
|-------------------|-----------|
| ROOF PLAN | |
| ID | MARK/PART |
| 1 | FBX1 |

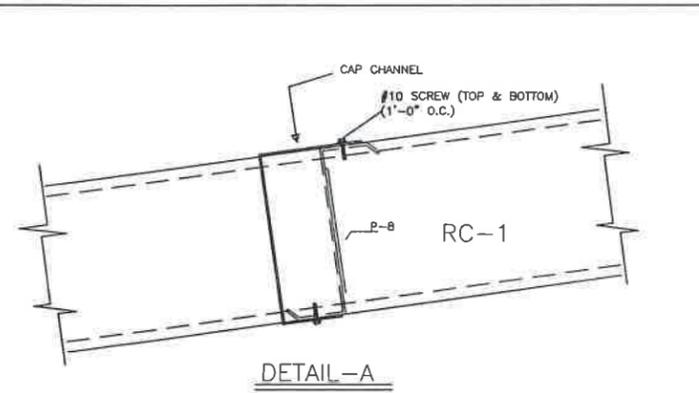

DETAIL-A

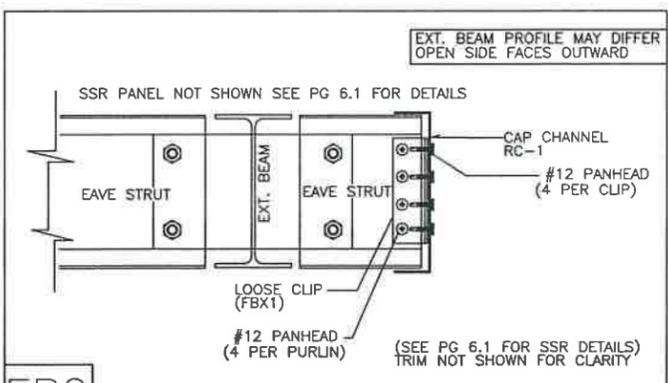

ER2

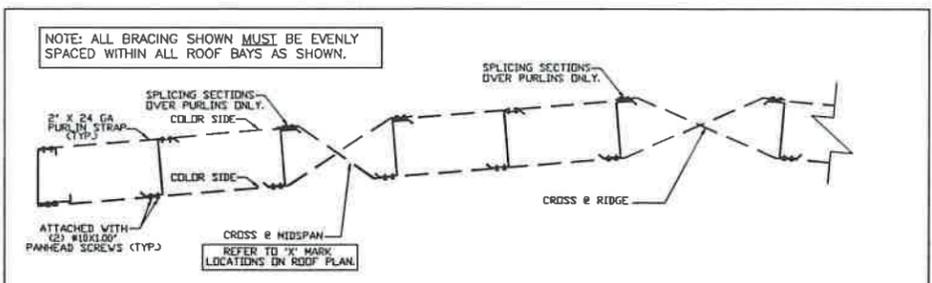


PURLIN BRACING DETAIL

| | | | |
|-----------------------------------|----------------|-----------------|-------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF FRAMING LAYOUT | | | |
| DRAWING NO: PAGE 2A | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |


| EXTENSION/CANOPY BOLTS | | | | |
|------------------------|------|------|------|--------|
| ROOF PLAN | | | | |
| MARK | QUAN | TYPE | DIA | LENGTH |
| EB-2 | 4 | A325 | 5/8" | 2" |
| EB-3 | 4 | A325 | 5/8" | 2" |
| EB-4 | 4 | A325 | 5/8" | 2" |
| EB-5 | 4 | A325 | 5/8" | 2" |
| EB-6 | 4 | A325 | 5/8" | 2" |

| MEMBER TABLE | | |
|--------------|----------|-------------|
| ROOF PLAN | | |
| MARK | PART | LENGTH |
| EB-1 | 10X2CH16 | 5'-7 7/8" |
| EB-3 | W10X12 | 3'-6 3/4" |
| EB-4 | W10X12 | 3'-6 3/4" |
| EB-5 | W10X12 | 3'-6 3/4" |
| P-5 | 10x25Z16 | 26'-11 1/2" |
| P-6 | 10x25Z16 | 29'-5 1/2" |
| P-7 | 10x25Z14 | 30'-3 1/2" |
| P-9 | 10x25Z14 | 30'-3 1/2" |
| E-2 | 10LE14@3 | 24'-3 1/2" |
| E-4 | 10LE14@3 | 24'-9 1/2" |
| E-6 | 10x35C14 | 24'-11 1/2" |
| E-9 | 10x35C14 | 25'-5 1/2" |
| E-10 | 10x35C14 | 27'-3 1/2" |
| E-11 | 10x35C14 | 27'-3 1/2" |
| E-14 | 10LE14@3 | 1'-11 1/2" |
| CB-3 | 1/4 CBL | 27'-11" |
| CB-4 | 1/4 CBL | 28'-3" |
| CB-5 | 1/4 CBL | 28'-10" |

| CONNECTION PLATES | |
|-------------------|-----------|
| ROOF PLAN | |
| ID | MARK/PART |
| 1 | FBX1 |

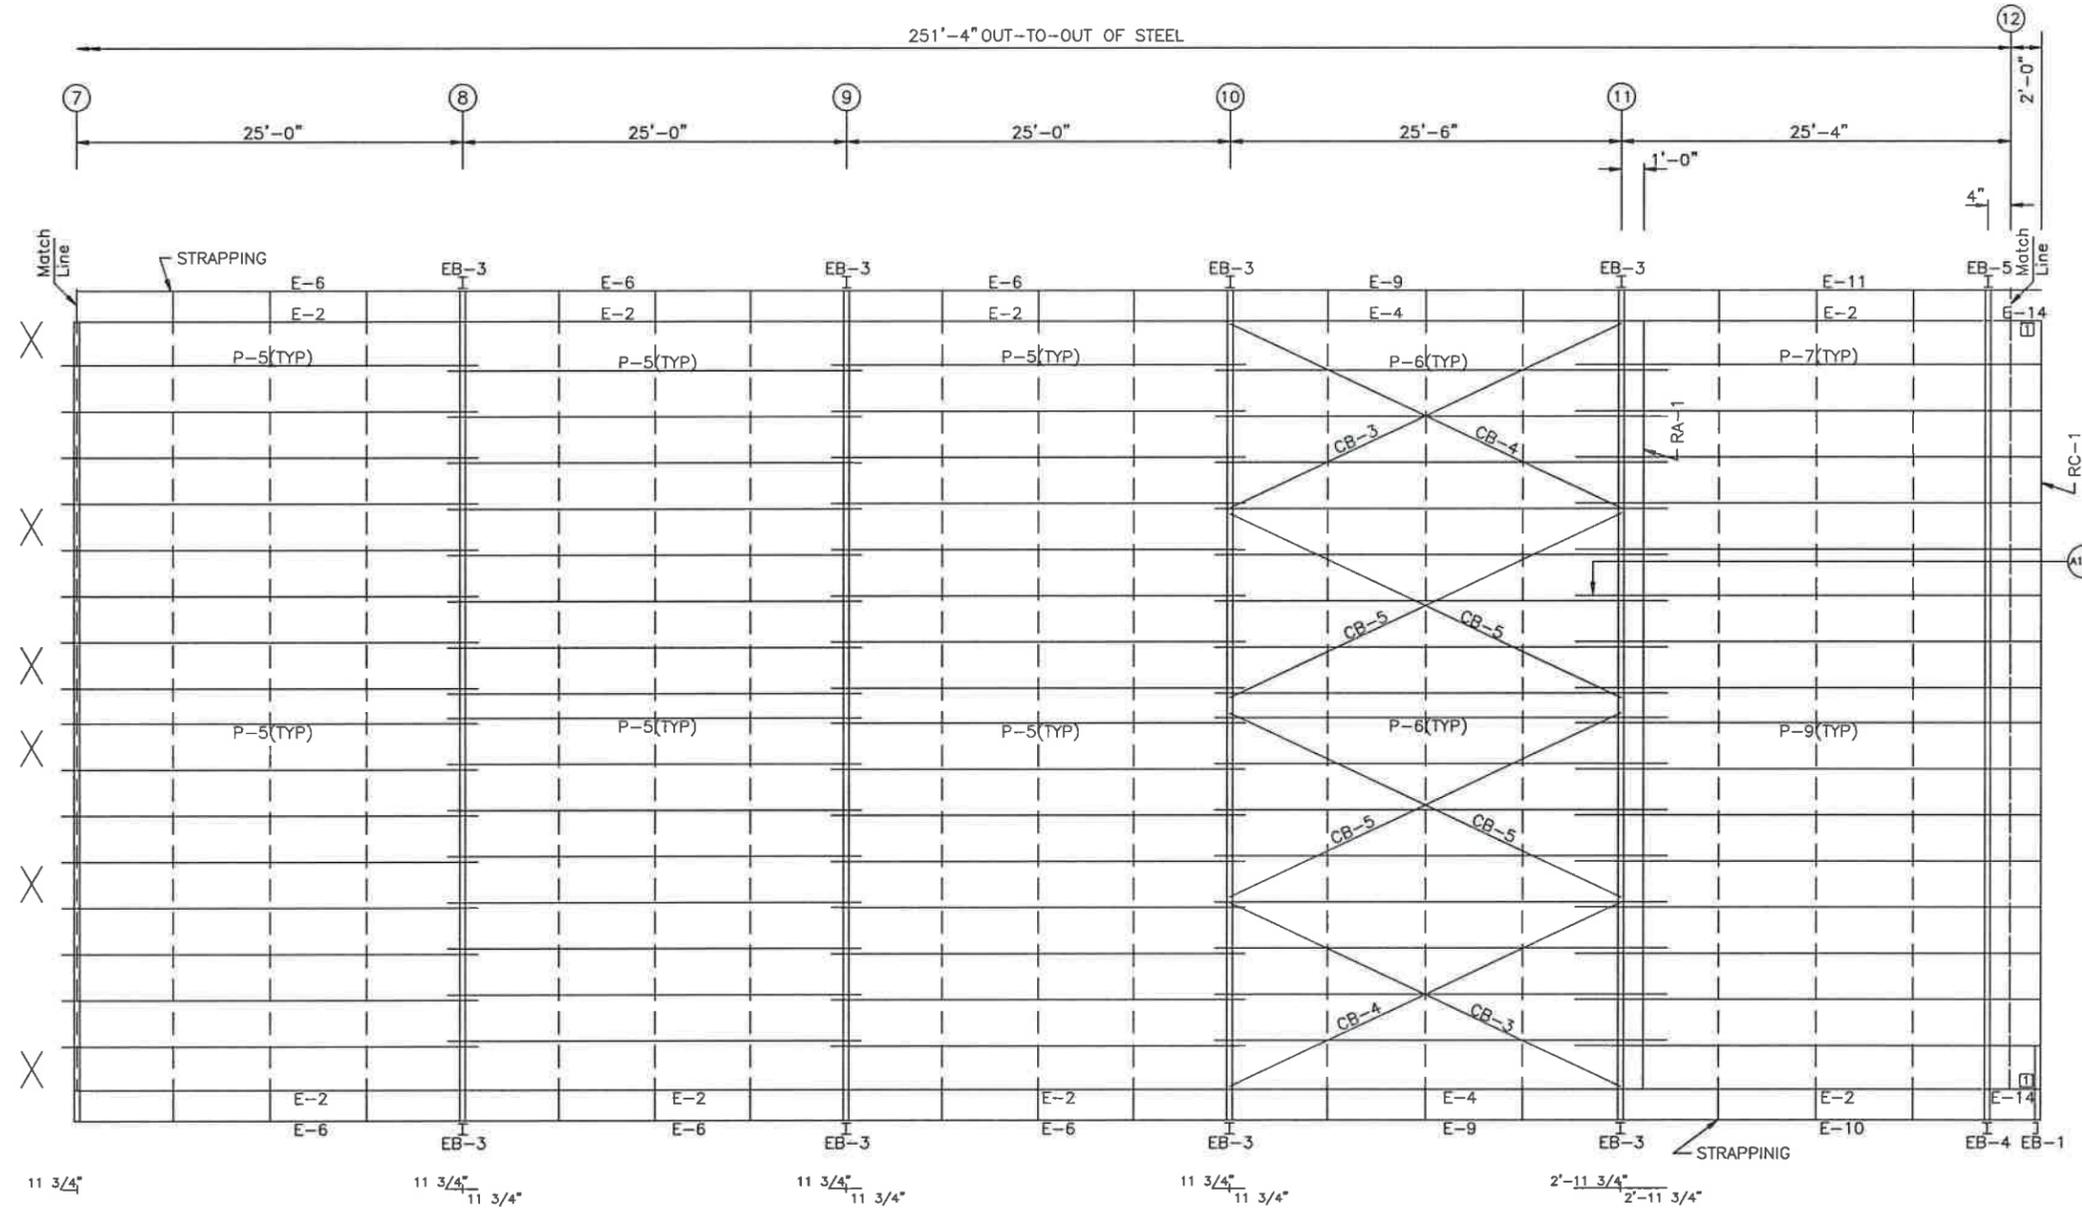

ROOF FRAMING PLAN

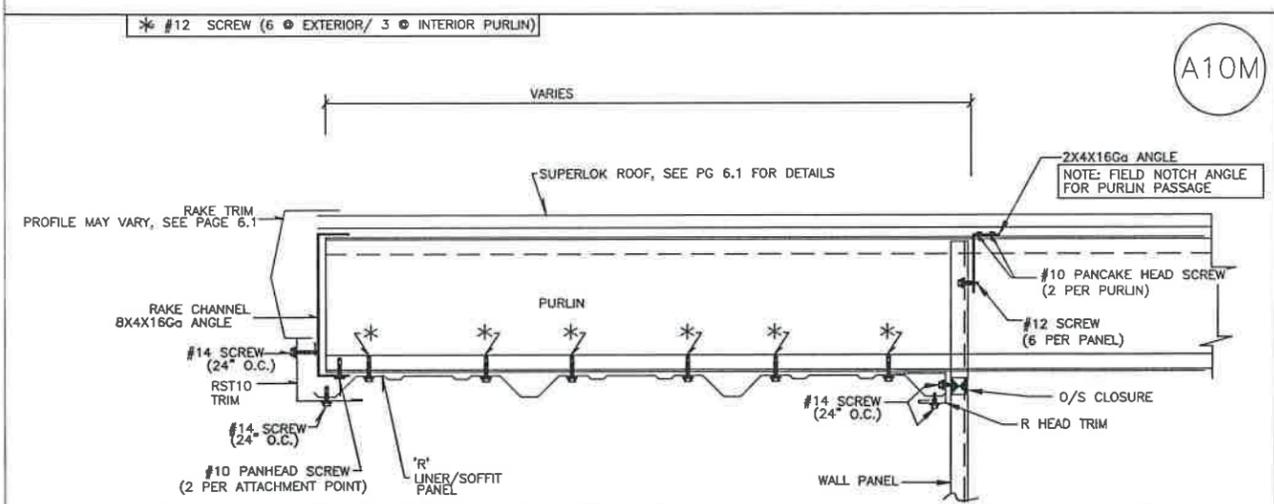


| | | | |
|-----------------------------------|----------------|-----------------|-------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF FRAMING LAYOUT | | | |
| DRAWING NO: PAGE 2A.2 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

| EXTENSION/CANOPY BOLTS | | | | |
|------------------------|------|------|------|--------|
| ROOF PLAN | | | | |
| MARK | QUAN | TYPE | DIA | LENGTH |
| EB-101 | 4 | A325 | 5/8" | 2" |
| EB-102 | 4 | A325 | 5/8" | 2" |
| EB-103 | 4 | A325 | 5/8" | 2" |

| MEMBER TABLE | | |
|--------------|---------|-------------|
| ROOF PLAN | | |
| MARK | PART | LENGTH |
| EB-100 | 8X2CH16 | 5'-6 3/16" |
| EB-101 | W8X10 | 3'-6 3/16" |
| EB-102 | W8X10 | 3'-6 3/16" |
| EB-103 | W8X10 | 3'-6 3/16" |
| P-100 | 8x25Z14 | 30'-5 1/2" |
| P-101 | 8x25Z16 | 30'-11 1/2" |
| P-102 | 8x25Z14 | 30'-5 1/2" |
| E-100 | 8LE12@1 | 23'-9 1/2" |
| E-101 | 8LE12@1 | 24'-3 1/2" |
| E-102 | 8x35C14 | 27'-5 1/2" |
| E-103 | 8x35C14 | 24'-11 1/2" |
| E-104 | 8LE12@1 | 2'-7 1/2" |
| CB-100 | 1/4 CBL | 27'-8" |
| CB-101 | 1/4 CBL | 28'-3" |

| CONNECTION PLATES | |
|-------------------|-----------|
| ROOF PLAN | |
| ID | MARK/PART |
| 1 | FBX1 |

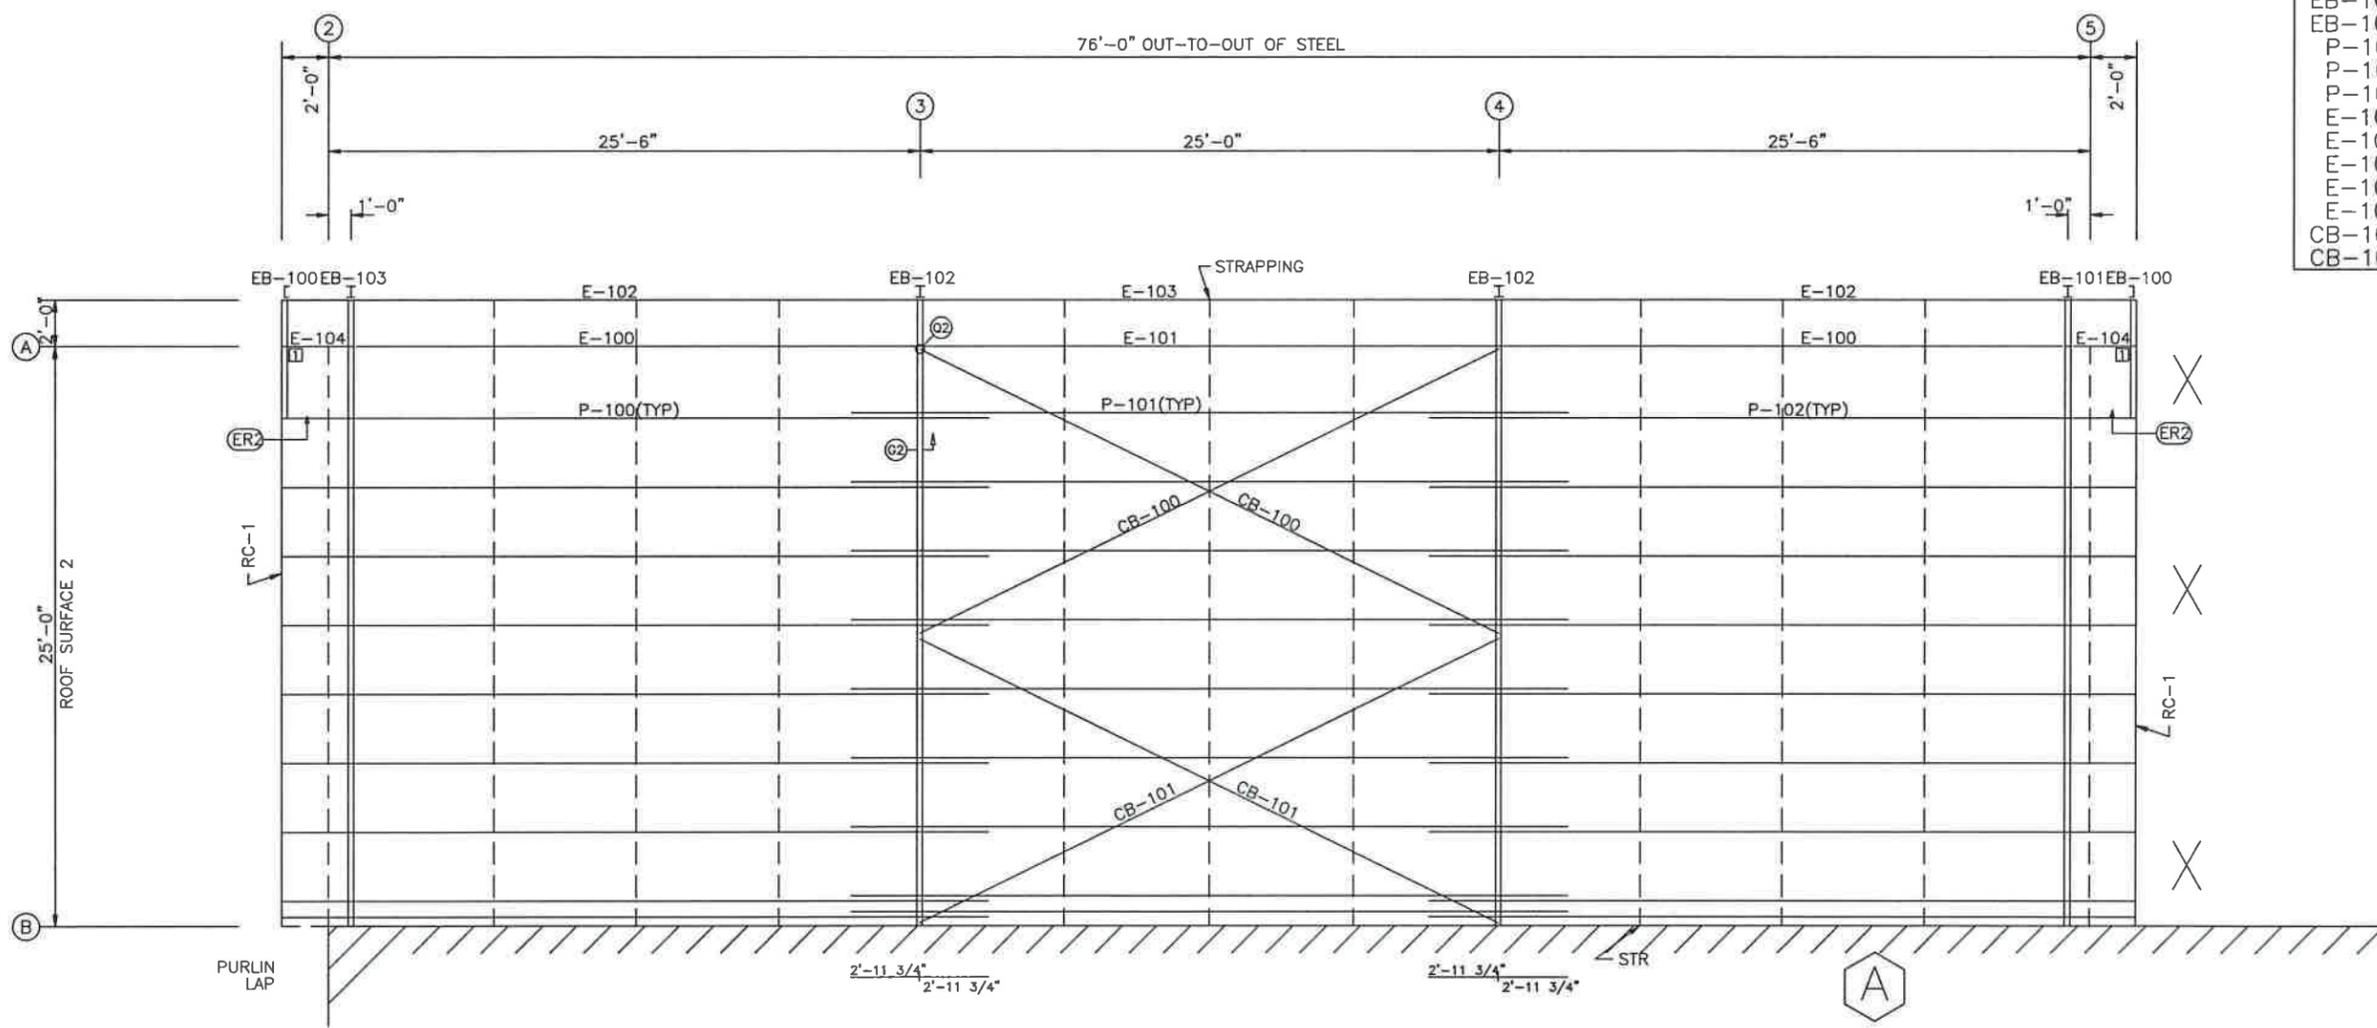


ROOF FRAMING PLAN

| | | | |
|--------------------------------------|-------------------|--------------------|----------------|
| BUILDING "B" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNICAL SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF FRAMING LAYOUT | | | |
| DRAWING NO: PAGE 2B | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

| EXTENSION/CANOPY BOLTS | | | | |
|------------------------|------|------|------|--------|
| ROOF PLAN | | | | |
| MARK | QUAN | TYPE | DIA | LENGTH |
| EB-201 | 4 | A325 | 5/8" | 2" |
| EB-202 | 4 | A325 | 5/8" | 2" |
| EB-203 | 4 | A325 | 5/8" | 2" |


| MEMBER TABLE | | |
|--------------|---------|-------------|
| ROOF PLAN | | |
| MARK | PART | LENGTH |
| EB-200 | 8X2CH16 | 5'-6 3/16" |
| EB-201 | W8X10 | 3'-6 3/16" |
| EB-202 | W8X10 | 3'-6 3/16" |
| EB-203 | W8X10 | 3'-6 3/16" |
| P-200 | 8x25Z16 | 29'-5 1/2" |
| P-201 | 8x25Z16 | 28'-11 1/2" |
| P-202 | 8x25Z16 | 29'-5 1/2" |
| E-200 | 8LE14@1 | 23'-9 1/2" |
| E-201 | 8LE14@1 | 24'-3 1/2" |
| E-202 | 8x35C14 | 27'-5 1/2" |
| E-203 | 8x35C14 | 24'-11 1/2" |
| E-204 | 8LE14@1 | 2'-7 1/2" |
| CB-200 | 1/4 CBL | 27'-8" |
| CB-201 | 1/4 CBL | 28'-3" |

| CONNECTION PLATES | |
|-------------------|-----------|
| ROOF PLAN | |
| ID | MARK/PART |
| 1 | FBX1 |

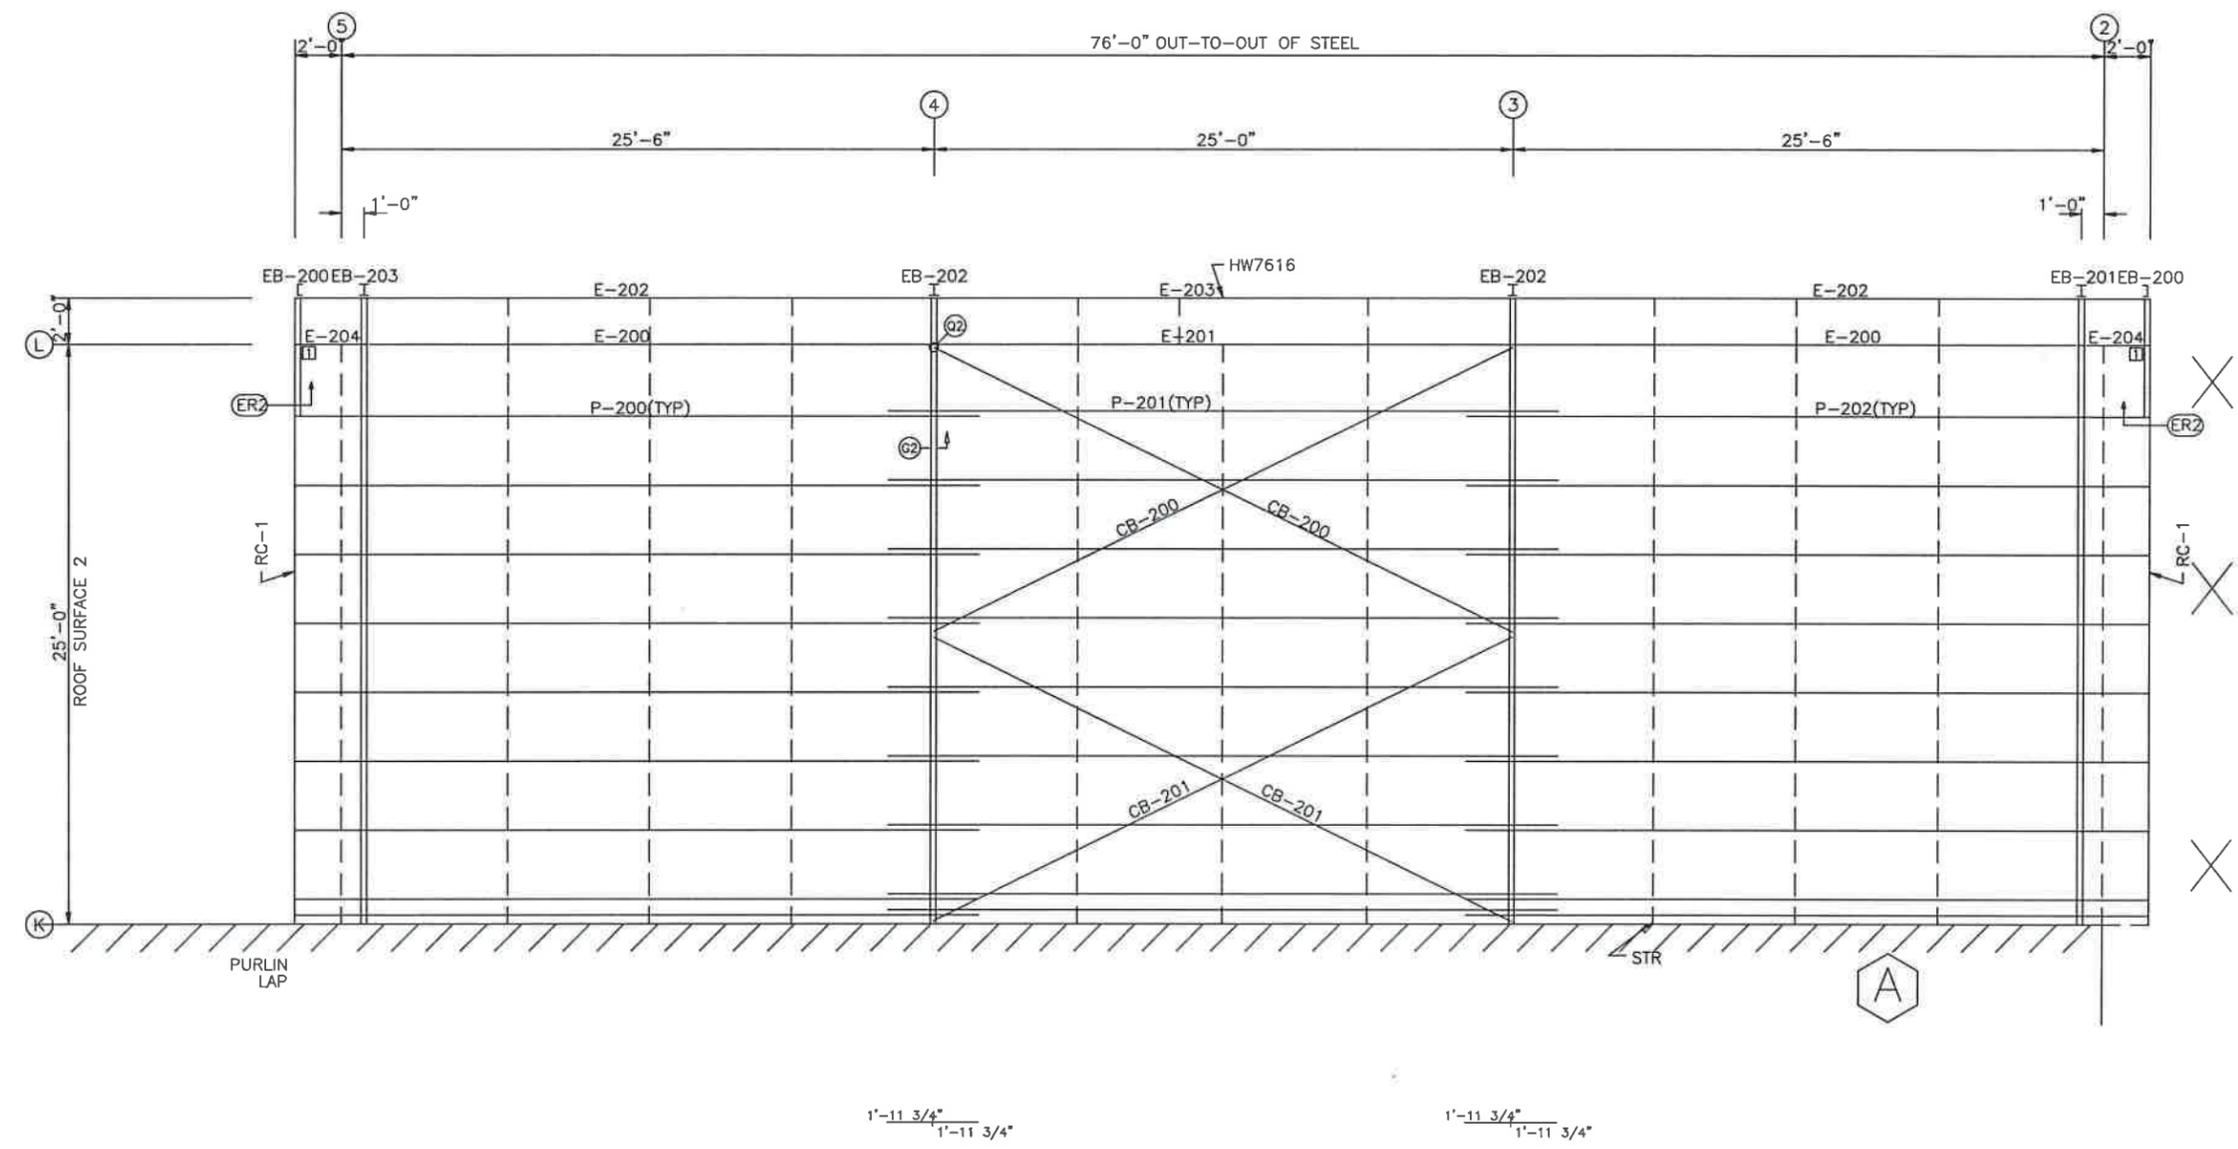

ROOF FRAMING PLAN

| | | | |
|-------------------------|---------|-----------|----------|
| BUILDING "C" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: | | | |
| PINNICAL SITE SOLUTIONS | | | |
| JOB NO: | 9249R1 | DATE: | 10/13/25 |
| LOCATION: | | | |
| HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: | | | |
| ROOF FRAMING LAYOUT | | | |
| DRAWING NO: | PAGE 2C | DRAWN BY: | CHKD BY: |
| | | DJH | GTL |
| SCALE: | | NONE | |

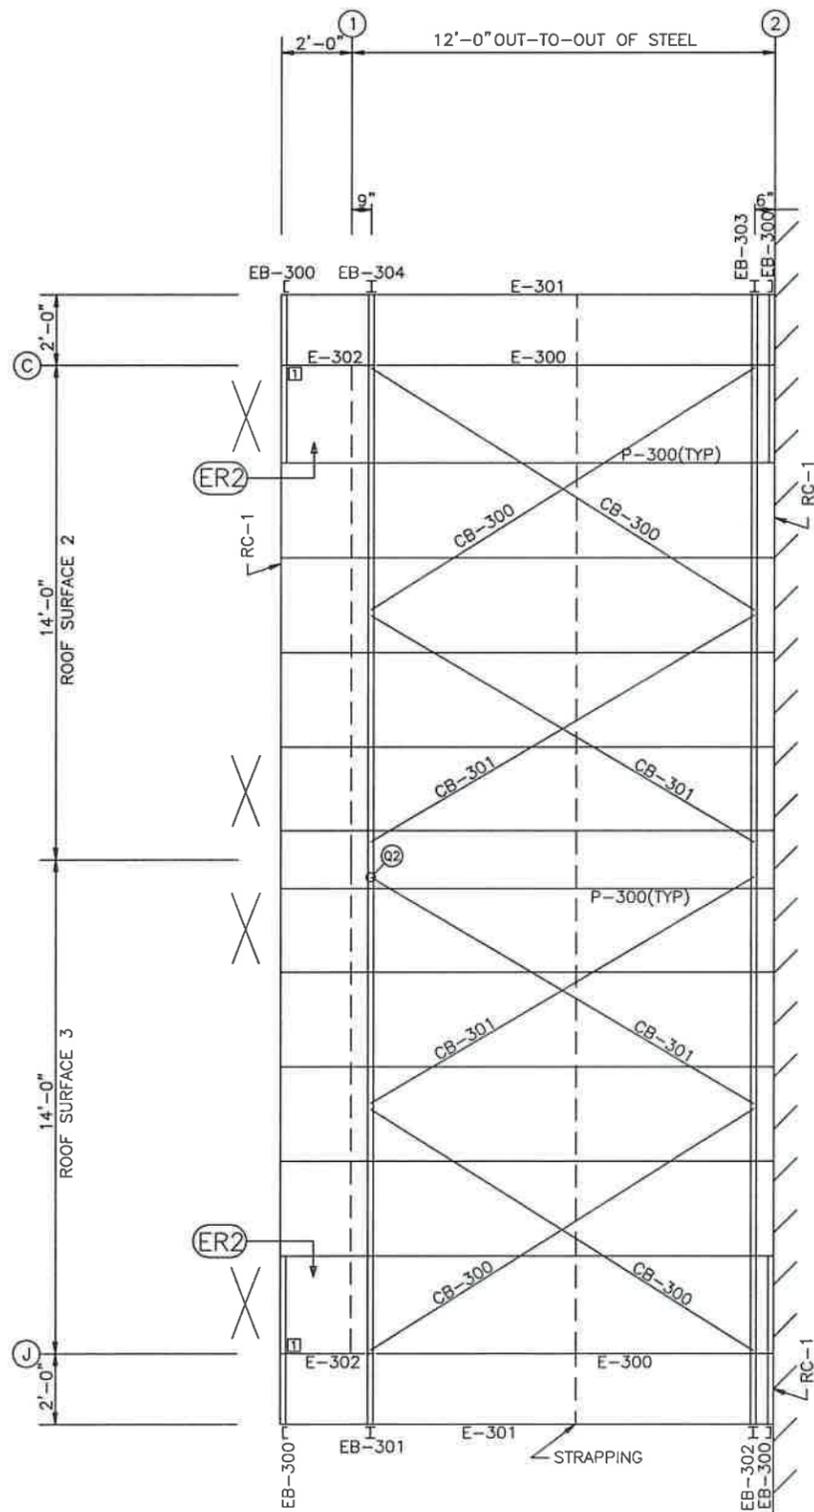

ROOF FRAMING PLAN

| EXTENSION/CANOPY BOLTS ROOF PLAN | | | | |
|-------------------------------------|------|------|------|--------|
| MARK | QUAN | TYPE | DIA | LENGTH |
| EB-301 | 4 | A325 | 5/8" | 2" |
| EB-302 | 4 | A325 | 5/8" | 2" |
| EB-303 | 4 | A325 | 5/8" | 2" |
| EB-304 | 4 | A325 | 5/8" | 2" |

| MEMBER TABLE ROOF PLAN | | |
|---------------------------|---------|-------------|
| MARK | PART | LENGTH |
| EB-300 | 8X2CH16 | 5'-8 13/16" |
| EB-301 | W8X10 | 3'-7 11/16" |
| EB-302 | W8X10 | 3'-7 11/16" |
| EB-303 | W8X10 | 3'-7 11/16" |
| EB-304 | W8X10 | 3'-7 11/16" |
| P-300 | 8x25Z16 | 13'-11 1/2" |
| E-300 | 8LE14@6 | 10'-0 1/2" |
| E-301 | 8x35C14 | 13'-11 1/2" |
| E-302 | 8LE14@6 | 2'-4 1/2" |
| CB-300 | 1/4 CBL | 12'-6" |
| CB-301 | 1/4 CBL | 13'-5" |

| CONNECTION PLATES ROOF PLAN | |
|--------------------------------|-----------|
| ID | MARK/PART |
| 1 | FBX1 |


| | | | |
|--------------------------------------|-------------------|--------------------|----------------|
| BUILDING "D" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNICAL SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF FRAMING LAYOUT | | | |
| DRAWING NO: PAGE 2D | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

| SPLICE BOLT TABLE | | | | | | | |
|-------------------|-----|-----|-----|-----|------|------|--------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | 0 | A325 | 7/8" | 2 1/2" |
| SP2 | 2 | 2 | 0 | 0 | A325 | 7/8" | 2 1/2" |

| BASE PLATE TABLE | | | |
|------------------|------------|-------|--------|
| COL | PLATE SIZE | | |
| MARK | Width | THICK | Length |
| BP1 | 6" | 3/8" | 8" |





▽ FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1): xx=length(in)
 A - L2x2x14

| MEMBER TABLE | | | | | | | |
|--------------|--------|-------------|-----------|----------------|------------------------|------------------------|--|
| MARK | Weight | Web Depth | Web PLATE | Outside Flange | Inside Flange | | |
| | | Start/End | THICK | Length | W x Thk x Length | W x Thk x Length | |
| RF1-300 | 138 | W8X10 | | | | | |
| RF1-301 | 586 | 8.0/ 8.0 | 0.188 | 11'-9 1/2" | 12 x 1/2" x 11'-5 1/4" | 12 x 1/2" x 11'-9 1/2" | |
| RF1-302 | 229 | 8.3/19.2 | 0.188 | 3'-10 15/16" | 12 x 1/2" x 2'-2 1/4" | 12 x 1/2" x 3'-3" | |
| EB-301 | 38 | W8X10 | | | | | |
| EB-304 | 38 | W8X10 | | | | | |
| TB-1 | TBD | TS4X4X.1875 | TBD | | | | |
| TB-2 | TBD | TS4X4X.1875 | TBD | | | | |
| TB-3 | TBD | TS4X4X.1875 | TBD | | | | |

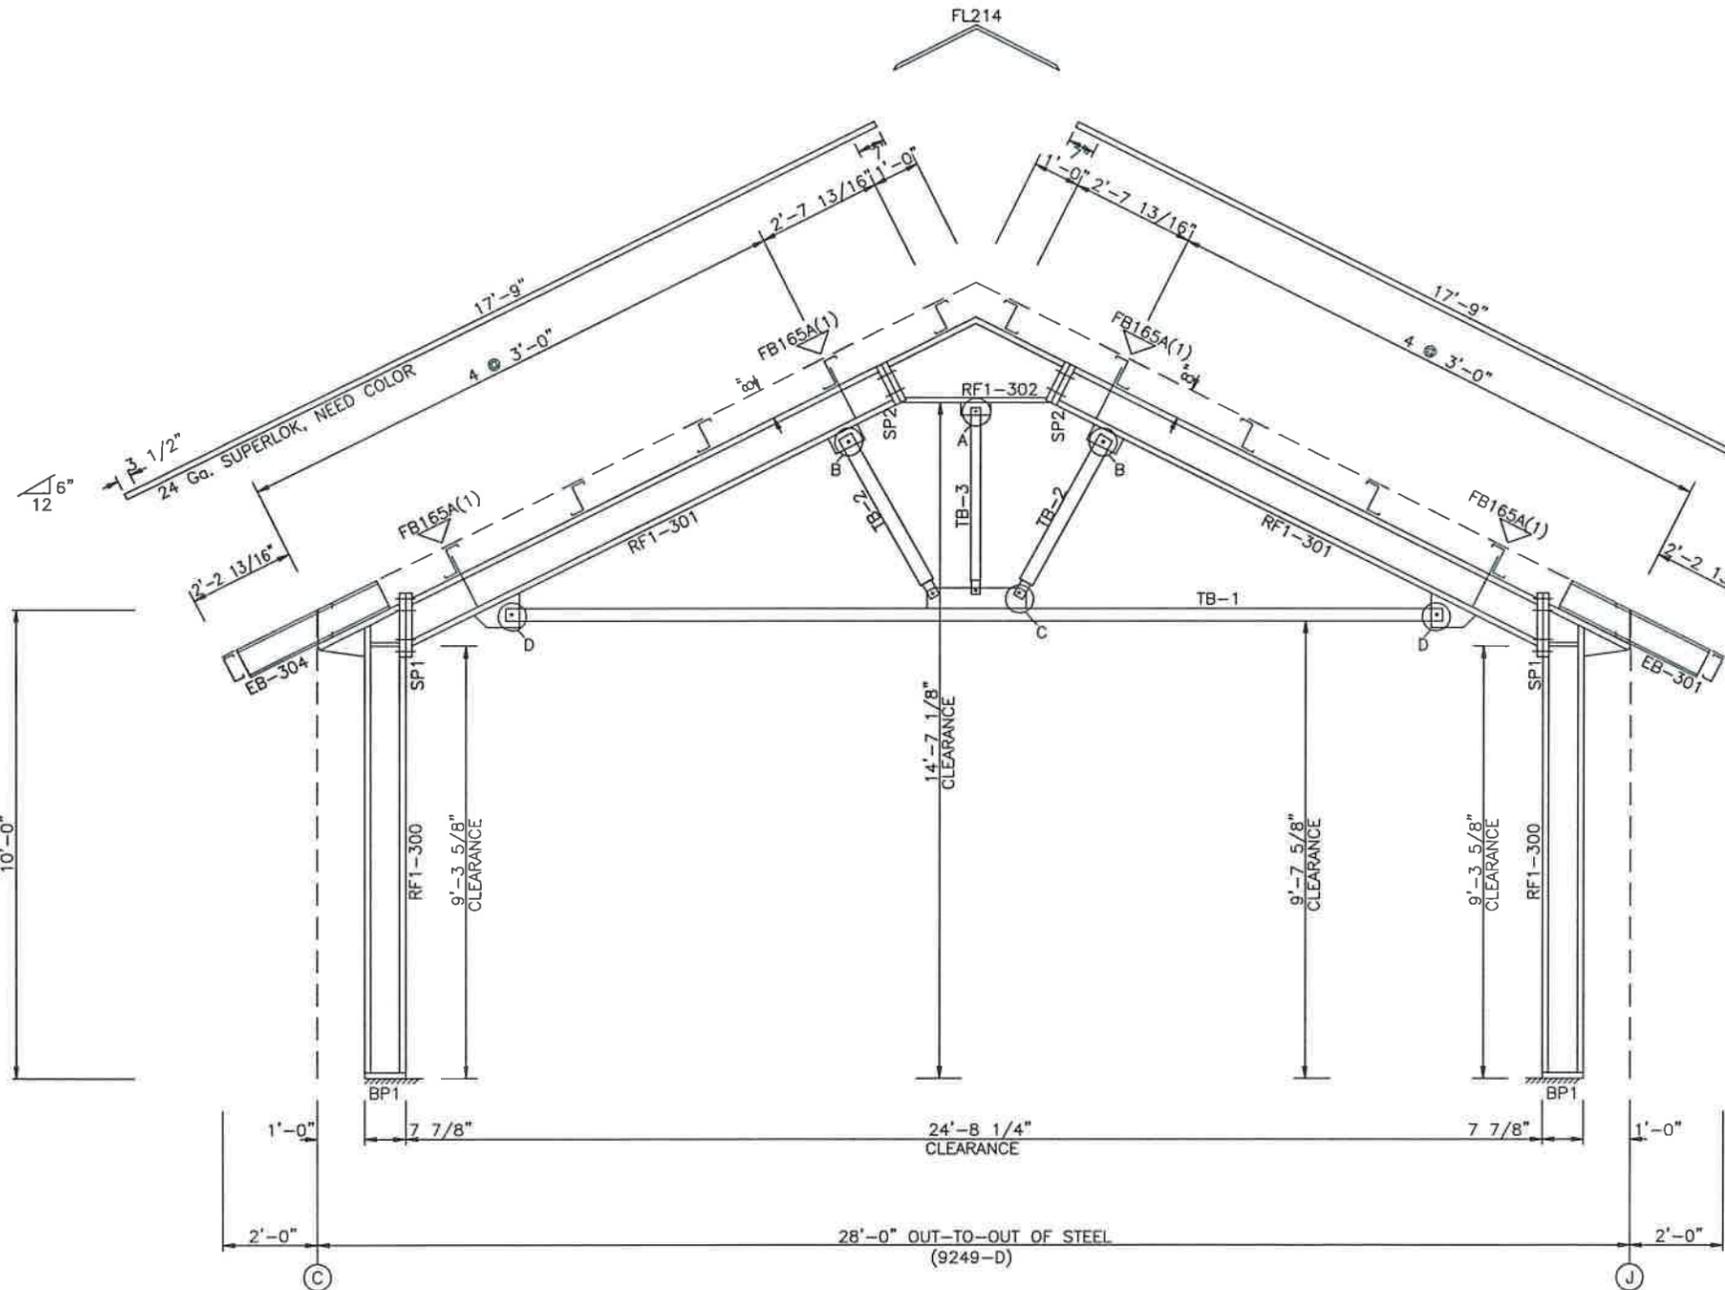

RIGID FRAME ELEVATION: FRAME LINE 1

NOTE: THE FRAMING AS DEPICTED ABOVE IS NOT DESIGNED TO ACCOMMODATE ANY FUTURE EXPANSION.

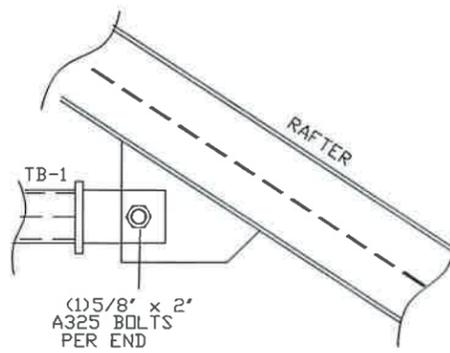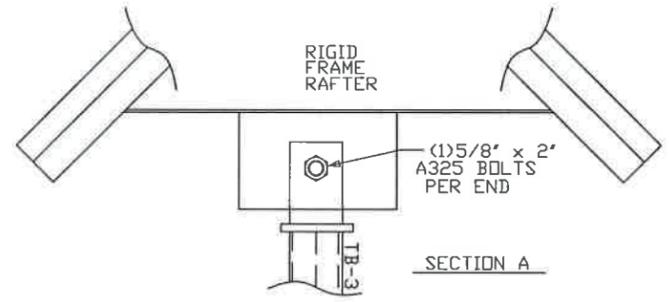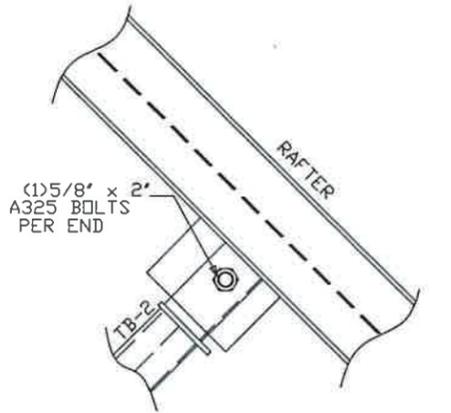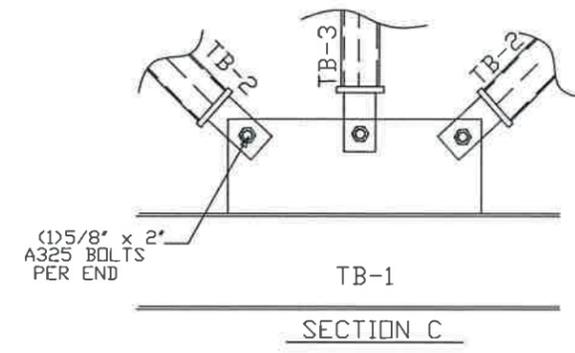



| | | | |
|---|----------------|-----------------|-------------|
| BUILDING "D" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.1 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| SPlice Bolt Table | | | | | | | |
|-------------------|-----|-----|-----|-----|------|------|--------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | | A325 | 5/8" | 2" |

| BASE PLATE TABLE | | | | |
|------------------|------|------------|-------|--------|
| COL | MARK | PLATE SIZE | THICK | Length |
| BP1 | 6" | 3/8" | B" | |

| MEMBER SIZE TABLE | | | | |
|-------------------|--------|-------------|--------|--|
| MARK | MEMBER | LENGTH | WEIGHT | |
| RF2-300 | WBX10 | 9'-9 1/16" | 124 | |
| RF2-301 | WBX10 | 13'-9 3/8" | 172 | |
| EB-302 | WBX10 | 3'-7 11/16" | 37 | |
| EB-303 | WBX10 | 3'-7 11/16" | 37 | |

▽ FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1): xx=length(in)
 A - L2x2x14

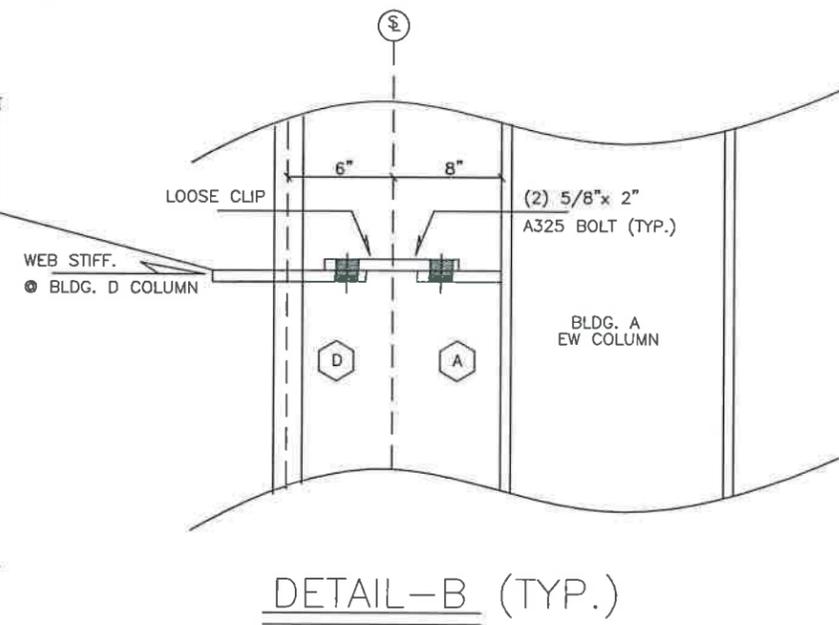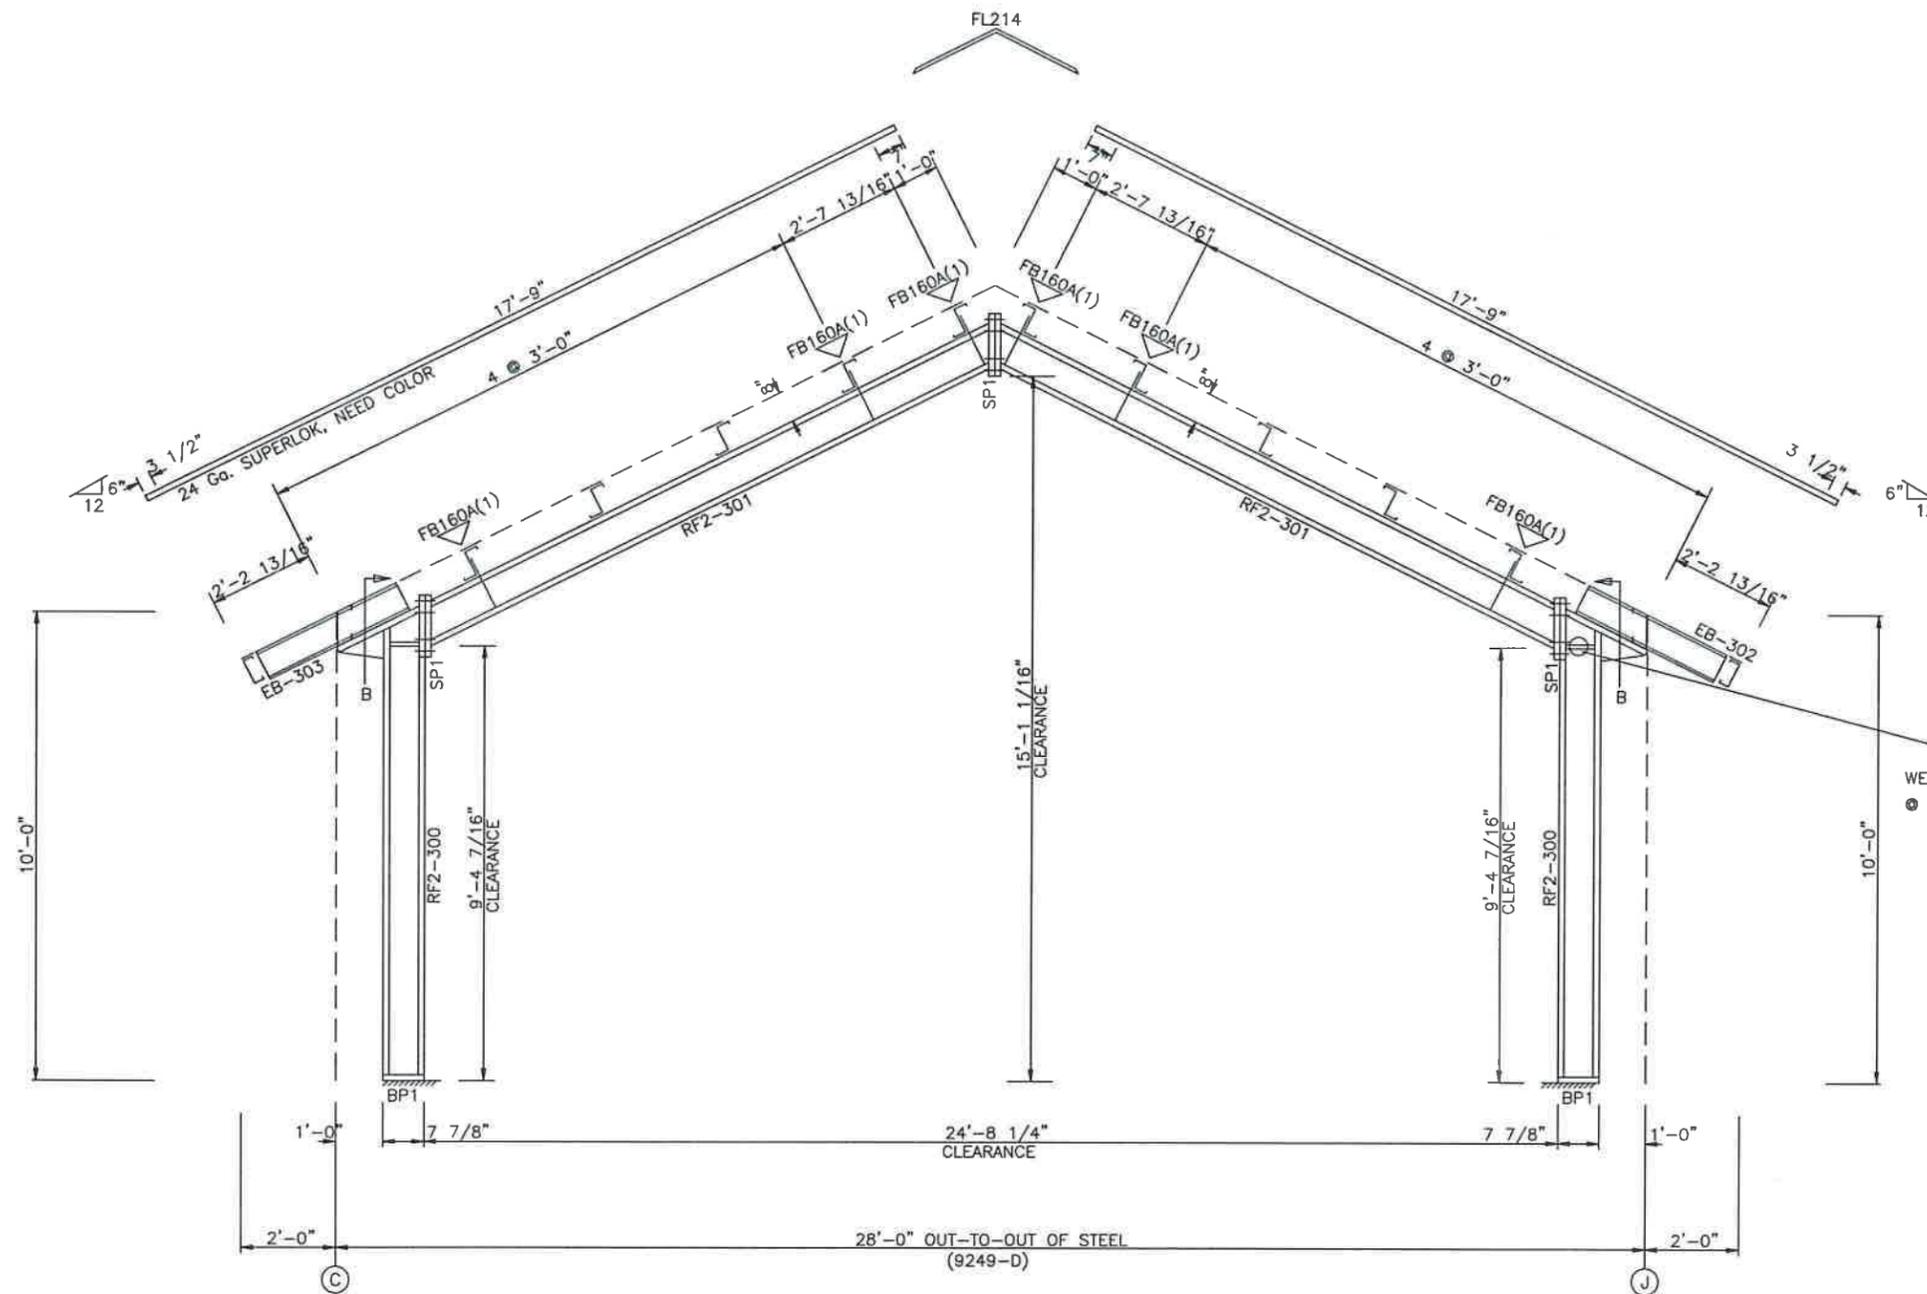

RIGID FRAME ELEVATION: FRAME LINE 2

| ISSUE | DET | CHK | DATE |
|---|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.2 | DRAWN BY: WTH | CHECKED BY: SPW | SCALE: NONE |

| SPLICE BOLT TABLE | | | | | | CAP PLATE BOLTS | | | | | | |
|-------------------|-----|-----|-----|-----|------|-----------------|--------|------|-----|-------|------|--------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length | MARK | Qty | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | 0 | A325 | 5/8" | 2" | EC-1 | 4 | A325T | 5/8" | 2" |
| SP2 | 4 | 0 | 0 | 0 | A325 | 5/8" | 2" | EC-2 | 4 | A325T | 5/8" | 2" |
| SP3 | 4 | 0 | 0 | 0 | A325 | 5/8" | 2" | | | | | |

| BASE PLATE TABLE | | | |
|------------------|------------|-------|--------------|
| COL MARK | PLATE SIZE | Width | THICK Length |
| BP1 | 6" | 3/8" | 1'-1" |
| BP2 | 8" | 1/2" | 8 1/4" |
| BP3 | 6" | 3/8" | 8" |
| BP4 | 6" | 3/8" | 8" |


| SUPPORT BEAM BOLT TABLE | | | | |
|-------------------------|-----|------|------|--------|
| ID | Qty | TYPE | DIA | Length |
| S1 | 4 | A325 | 3/4" | 2" |

▽ FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1): xx=length(in)
 A - L2x2x14

| MEMBER TABLE | | | | | | | | | |
|--------------|--------|-----------|-----------|--------------|------------------------|------------------------|--|--|--|
| MARK | Weight | Web Depth | Web THICK | PLATE Length | Outside Flange | Inside Flange | | | |
| | | Start/End | | | W x Thk x Length | W x Thk x Length | | | |
| RF1-1 | 481 | 12.0/12.0 | 0.188 | 13'-11 5/8" | 5 x 1/4" x 18'-3 1/16" | 5 x 1/2" x 14'-5 5/8" | | | |
| | | | | | 5 x 1/4" x 2'-0" | 5 x 3/8" x 4'-7 7/16" | | | |
| | | | | | 5 x 1/4" x 1'-8 13/16" | | | | |
| RF1-2 | 398 | 12.0/12.0 | 0.135 | 14'-11" | 5 x 1/4" x 20'-0" | 5 x 1/4" x 10'-7 7/16" | | | |
| | | | | | 5 x 1/4" x 3'-10 7/8" | 5 x 1/4" x 11'-11 7/8" | | | |
| RF1-3 | 398 | 12.0/12.0 | 0.135 | 9'-2 13/16" | 5 x 1/4" x 3'-10 3/4" | 5 x 1/4" x 11'-11 7/8" | | | |
| | | | | | 5 x 1/4" x 20'-0" | 5 x 1/4" x 10'-7 5/16" | | | |
| RF1-4 | 465 | 12.0/12.0 | 0.135 | 6'-6 1/2" | 5 x 1/4" x 1'-8 15/16" | 5 x 3/8" x 4'-7 7/16" | | | |
| | | | | | 5 x 1/4" x 4'-9" | 5 x 1/2" x 14'-5 5/8" | | | |
| | | | | | 5 x 1/4" x 14'-8 1/16" | | | | |
| EC-1 | 431 | W8X18 | | | | | | | |
| EC-2 | 431 | W8X18 | | | | | | | |
| EB-2 | 43 | W10X12 | | | | | | | |
| EB-6 | 43 | W10X12 | | | | | | | |
| RF1-100 | 160 | W8X10 | | | | | | | |
| RF1-101 | 317 | W10X12 | | | | | | | |
| RF3-200 | 165 | W8X10 | | | | | | | |
| RF3-201 | 325 | W10X12 | | | | | | | |

CONNECTION PLATES

| ID | Mark/Part |
|----|-----------|
| 2 | FBC8 |

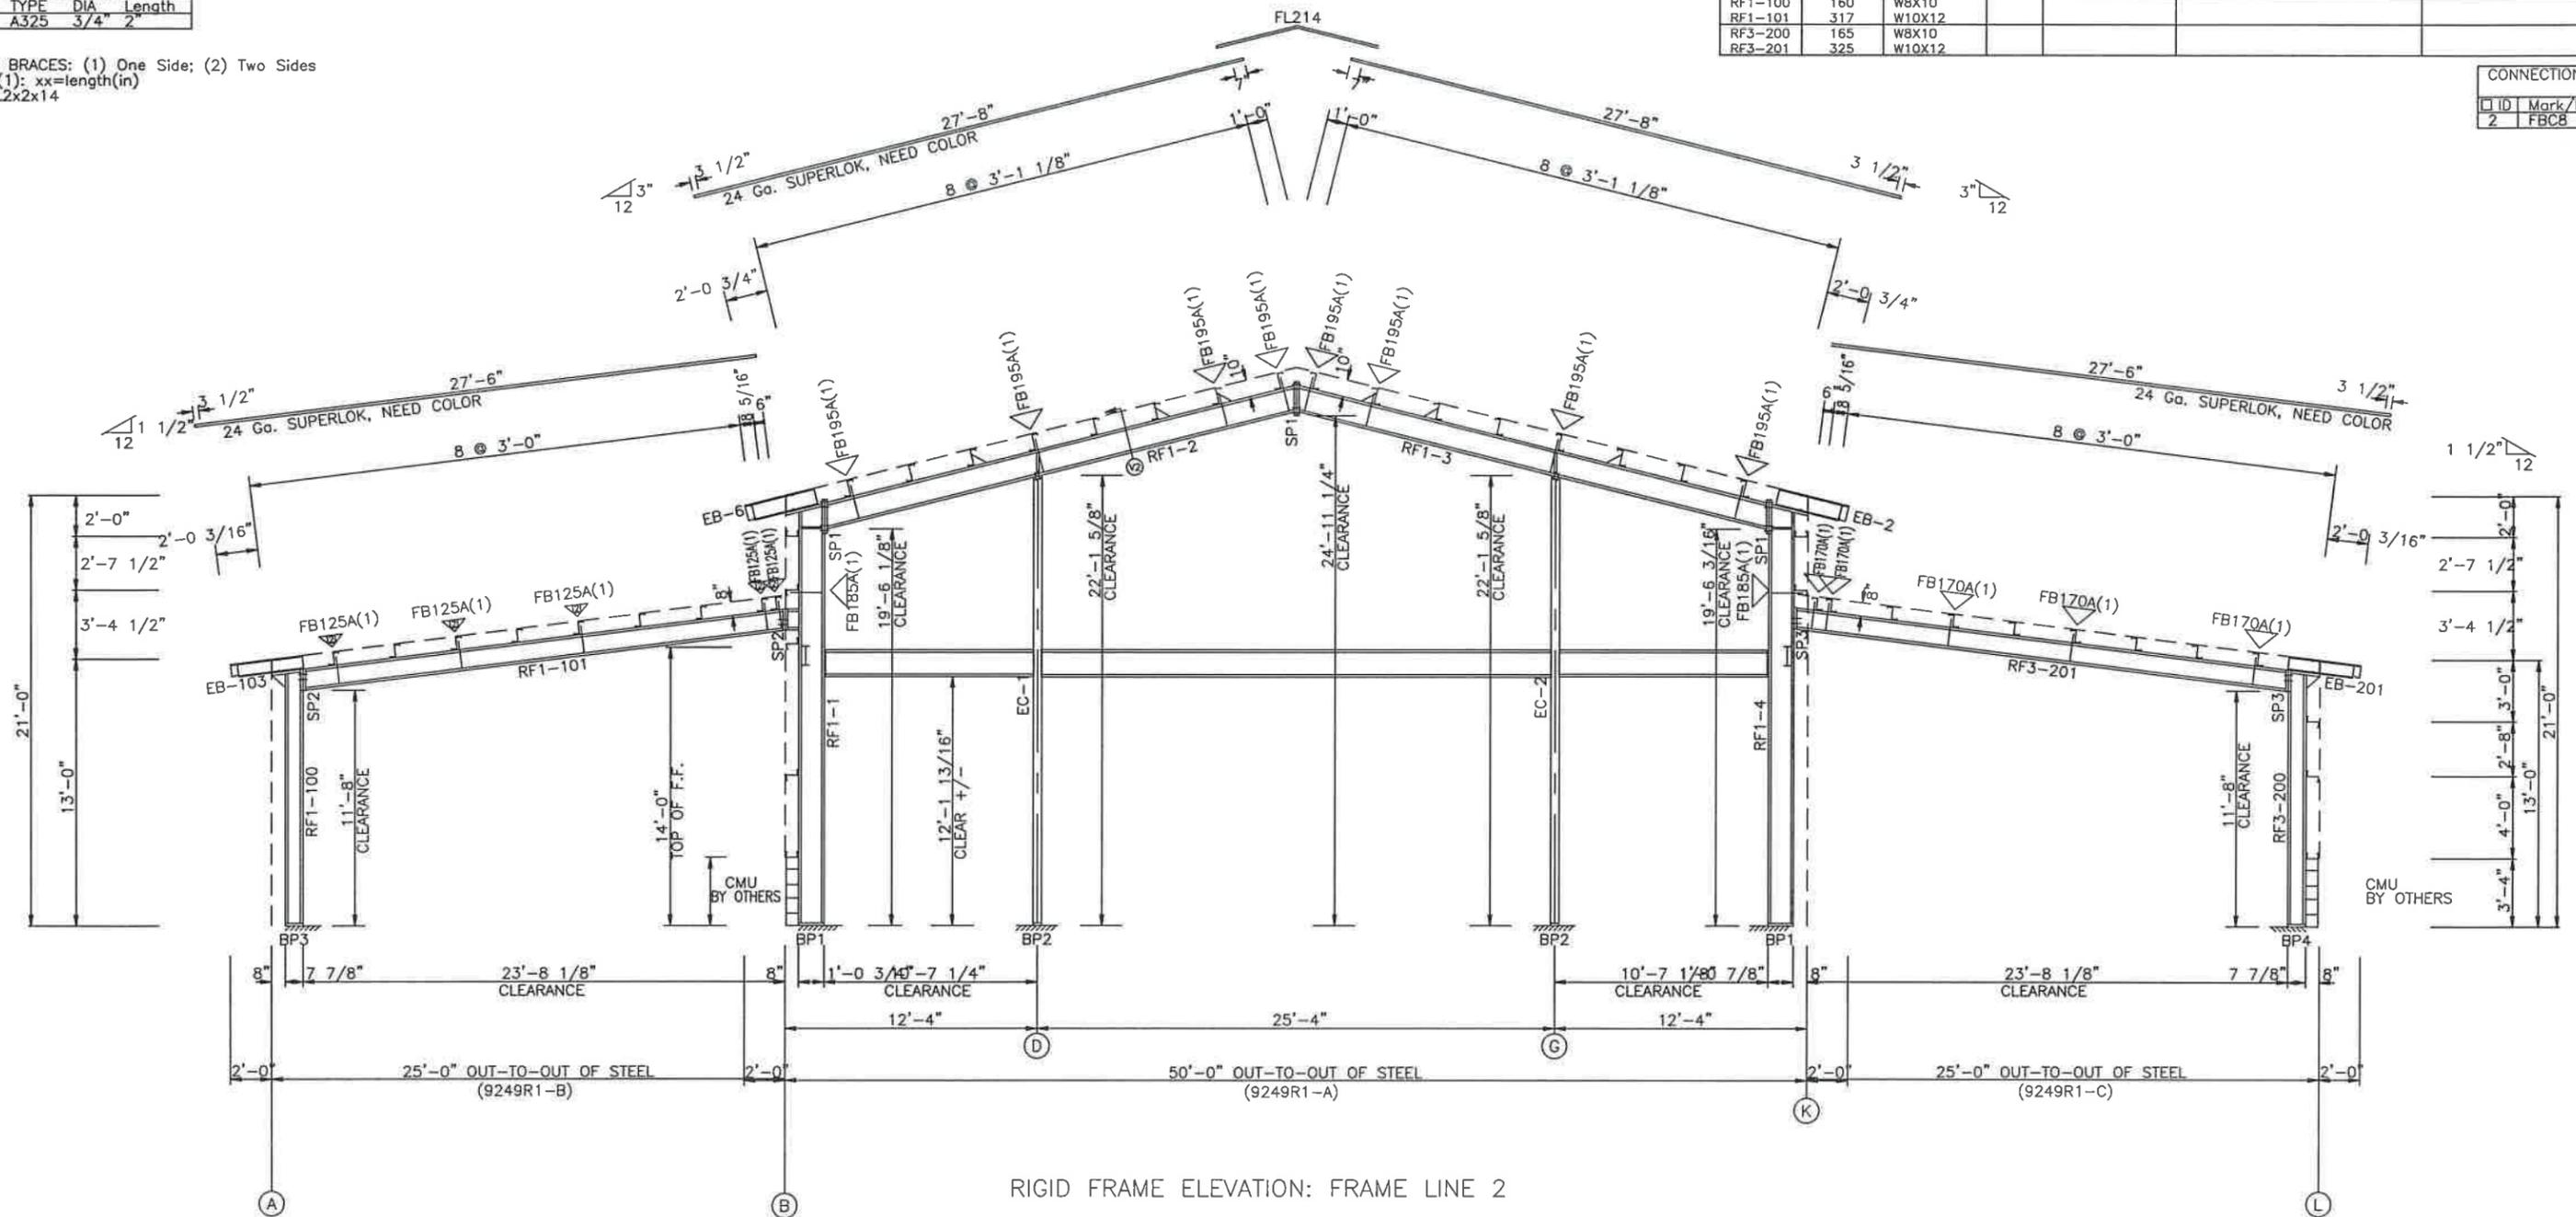

RIGID FRAME ELEVATION: FRAME LINE 2

SEE PAGE 12 FOR MEZZANINE INFORMATION

| ISSUE | | | | DET | CHK | DATE |
|---|--|---------------|--|-----------------|----------------|-------------|
| BUILDINGS AND MORE | | | | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | | | | |
| JOB NO: 9249R1 | | | | | DATE: 10/13/25 | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | | | | |
| DRAWING NO: PAGE 2.3 | | DRAWN BY: DJH | | CHECKED BY: SPW | | SCALE: NONE |

| SPlice BOLT TABLE | | | | | | | |
|-------------------|-----|-----|-----|-----|------|------|--------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | 0 | A325 | 5/8" | 2" |
| SP3 | 4 | 0 | 0 | 0 | A325 | 5/8" | 2" |

| BASE PLATE TABLE | | | |
|------------------|------------|-------|--------------|
| COL MARK | PLATE SIZE | Width | THICK Length |
| BP1 | 6" x 3/8" | 1'-1" | |
| BP2 | 6" x 3/8" | 8" | |


| SUPPORT BEAM BOLT TABLE | | | | |
|-------------------------|-----|------|------|--------|
| ID | Qty | TYPE | DIA | Length |
| S1 | 5 | A325 | 3/4" | 2" |

| SUPPORT COLUMN BOLT TABLE | | | | |
|---------------------------|-----|------|------|--------|
| ID | Qty | TYPE | DIA | Length |
| C1 | 4 | GR56 | 3/4" | 1 1/2" |

FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1): xx=length(in)
 A - L2x2x14

| MEMBER TABLE | | | | | | | | | |
|--------------|--------|-----------|-----------|--------------|------------------------|------------------------|--|--|--|
| MARK | Weight | Web Depth | Web THICK | PLATE Length | Outside Flange | Inside Flange | | | |
| | | Start/End | | | W x Thk x Length | W x Thk x Length | | | |
| RF2-1 | 620 | 12.0/16.0 | 0.188 | 13'-11 5/8" | 6 x 3/8" x 14'-5 5/8" | 6 x 1/2" x 13'-11 5/8" | | | |
| | | 16.0/24.0 | 0.135 | 4'-4 1/4" | 6 x 5/16" x 5'-9 7/16" | 6 x 3/8" x 4'-4 13/16" | | | |
| | | 24.0/24.0 | 0.188 | 2'-5 1/4" | 6 x 1/4" x 2'-9 5/16" | | | | |
| RF2-2 | 414 | 24.0/10.5 | 0.135 | 12'-10 3/16" | 5 x 1/4" x 20'-0" | 5 x 1/4" x 12'-10 3/4" | | | |
| | | 10.5/12.0 | 0.135 | 10'-6 5/16" | 5 x 1/4" x 2'-10 3/8" | 5 x 1/4" x 10'-3 1/4" | | | |
| | | 24.0/24.0 | 0.188 | 2'-5 1/4" | 6 x 1/4" x 2'-9 5/16" | 6 x 3/8" x 4'-4 13/16" | | | |
| RF2-3 | 599 | 24.0/16.0 | 0.135 | 4'-4 1/4" | 6 x 5/16" x 4'-9" | 6 x 1/2" x 13'-11 5/8" | | | |
| | | 16.0/12.0 | 0.188 | 13'-11 5/8" | 6 x 5/16" x 7/16" | | | | |
| EB-3 | 46 | W10X12 | | | | | | | |
| RF2-100 | 141 | WBX10 | | | | | | | |
| RF2-101 | 368 | W12X14 | | | | | | | |
| RF2-200 | 146 | WBX10 | | | | | | | |
| RF2-201 | 377 | W12X14 | | | | | | | |

| CONNECTION PLATES | | |
|-------------------|-----------|--|
| ID | Mark/Part | |
| 3 | FBC8 | |

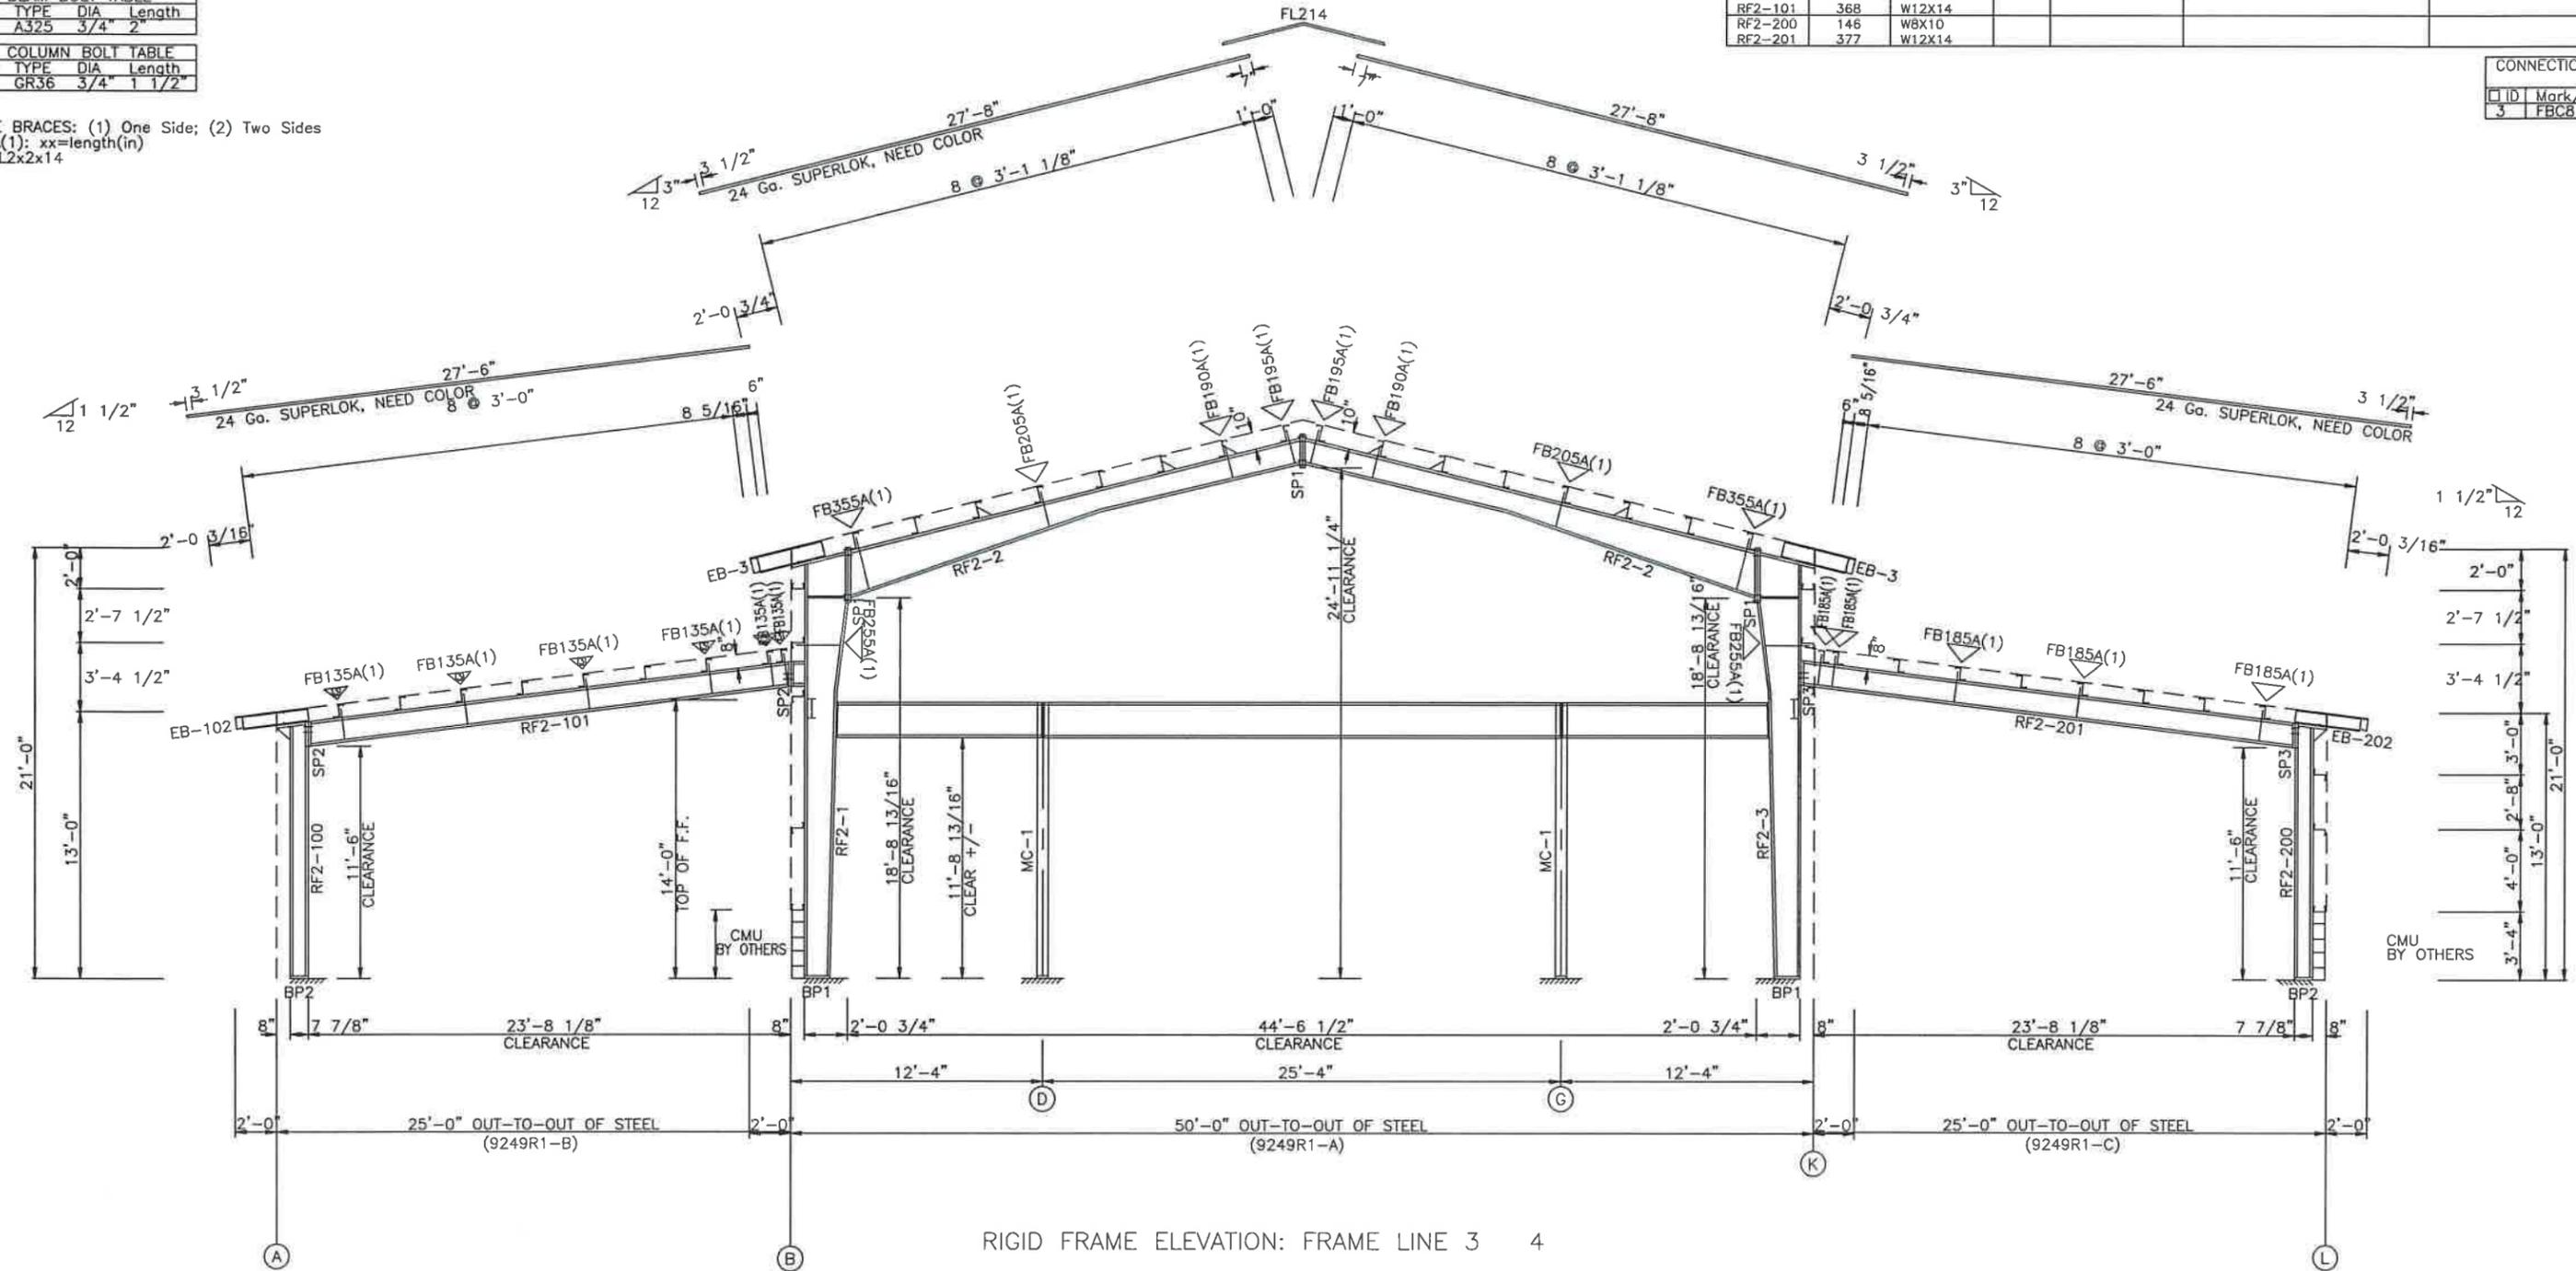

RIGID FRAME ELEVATION: FRAME LINE 3 4

SEE PAGE 12 FOR MEZZANINE INFORMATION

| ISSUE | DET | CHK | DATE |
|---|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.4 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| SPLICE BOLT TABLE | | | | | | CAP PLATE BOLTS | | | | | | |
|-------------------|-----|-----|-----|-----|------|-----------------|--------|-------|-----|-------|------|--------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length | MARK | Qty | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | 0 | A325 | 5/8" | 2" | RF3-5 | 4 | A325T | 5/8" | 2" |
| SP2 | 4 | 0 | 0 | 0 | A325 | 5/8" | 2" | RF3-6 | 4 | A325T | 5/8" | 2" |
| SP3 | 4 | 0 | 0 | 0 | A325 | 5/8" | 2" | | | | | |


| BASE PLATE TABLE | | | |
|------------------|------------|-------|--------------|
| COL MARK | PLATE SIZE | Width | THICK Length |
| BP1 | 6" | 3/8" | 1'-1" |
| BP2 | 8" | 3/8" | 8 1/2" |
| BP3 | 6" | 3/8" | 8" |
| BP4 | 6" | 3/8" | 8" |

| SUPPORT BEAM BOLT TABLE | | | | |
|-------------------------|-----|------|------|--------|
| ID | Qty | TYPE | DIA | Length |
| S1 | 4 | A325 | 3/4" | 2" |

| MEMBER TABLE | | | | | | | | | |
|--------------|--------|-----------|-----------|--------------|------------------------|------------------------|--|--|--|
| MARK | Weight | Web Depth | Web THICK | PLATE Length | Outside Flange | Inside Flange | | | |
| | | Start/End | | | W x Thk x Length | W x Thk x Length | | | |
| RF3-1 | 553 | 12.0/12.0 | 0.188 | 13'-11 5/8" | 6 x 1/4" x 18'-3 1/16" | 6 x 1/2" x 13'-11 5/8" | | | |
| | | 12.0/18.0 | 0.188 | 6'-8" | 6 x 1/4" x 2'-0" | 6 x 3/8" x 4'-9 1/8" | | | |
| RF3-2 | 416 | 18.0/12.0 | 0.135 | 14'-3 5/16" | 5 x 1/4" x 20'-0" | 5 x 1/4" x 12'-11 3/4" | | | |
| RF3-3 | 416 | 12.0/12.0 | 0.135 | 9'-5 15/16" | 5 x 1/4" x 3'-4 11/16" | 5 x 1/4" x 9'-2 7/8" | | | |
| RF3-4 | 537 | 12.0/18.0 | 0.135 | 14'-3 3/16" | 5 x 1/4" x 20'-0" | 5 x 1/4" x 12'-11 5/8" | | | |
| | | 18.0/12.0 | 0.188 | 6'-8" | 6 x 1/4" x 2'-3 1/8" | 6 x 3/8" x 4'-9 3/16" | | | |
| | | 12.0/12.0 | 0.188 | 13'-11 5/8" | 6 x 1/4" x 14'-8 1/16" | 6 x 1/2" x 13'-11 5/8" | | | |
| RF3-5 | 448 | W8X18 | | | | | | | |
| RF3-6 | 448 | W8X18 | | | | | | | |
| EB-3 | 46 | W10X12 | | | | | | | |
| RF3-100 | 140 | W8X10 | | | | | | | |
| RF3-101 | 317 | W10X12 | | | | | | | |
| RF1-200 | 160 | W8X10 | | | | | | | |
| RF1-201 | 325 | W10X12 | | | | | | | |

| CONNECTION PLATES | | |
|-------------------|-----------|--|
| ID | Mark/Part | |
| 2 | FBC10 | |
| 3 | FBC8 | |

▽ FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1): xx=length(in)
 A - L2x14

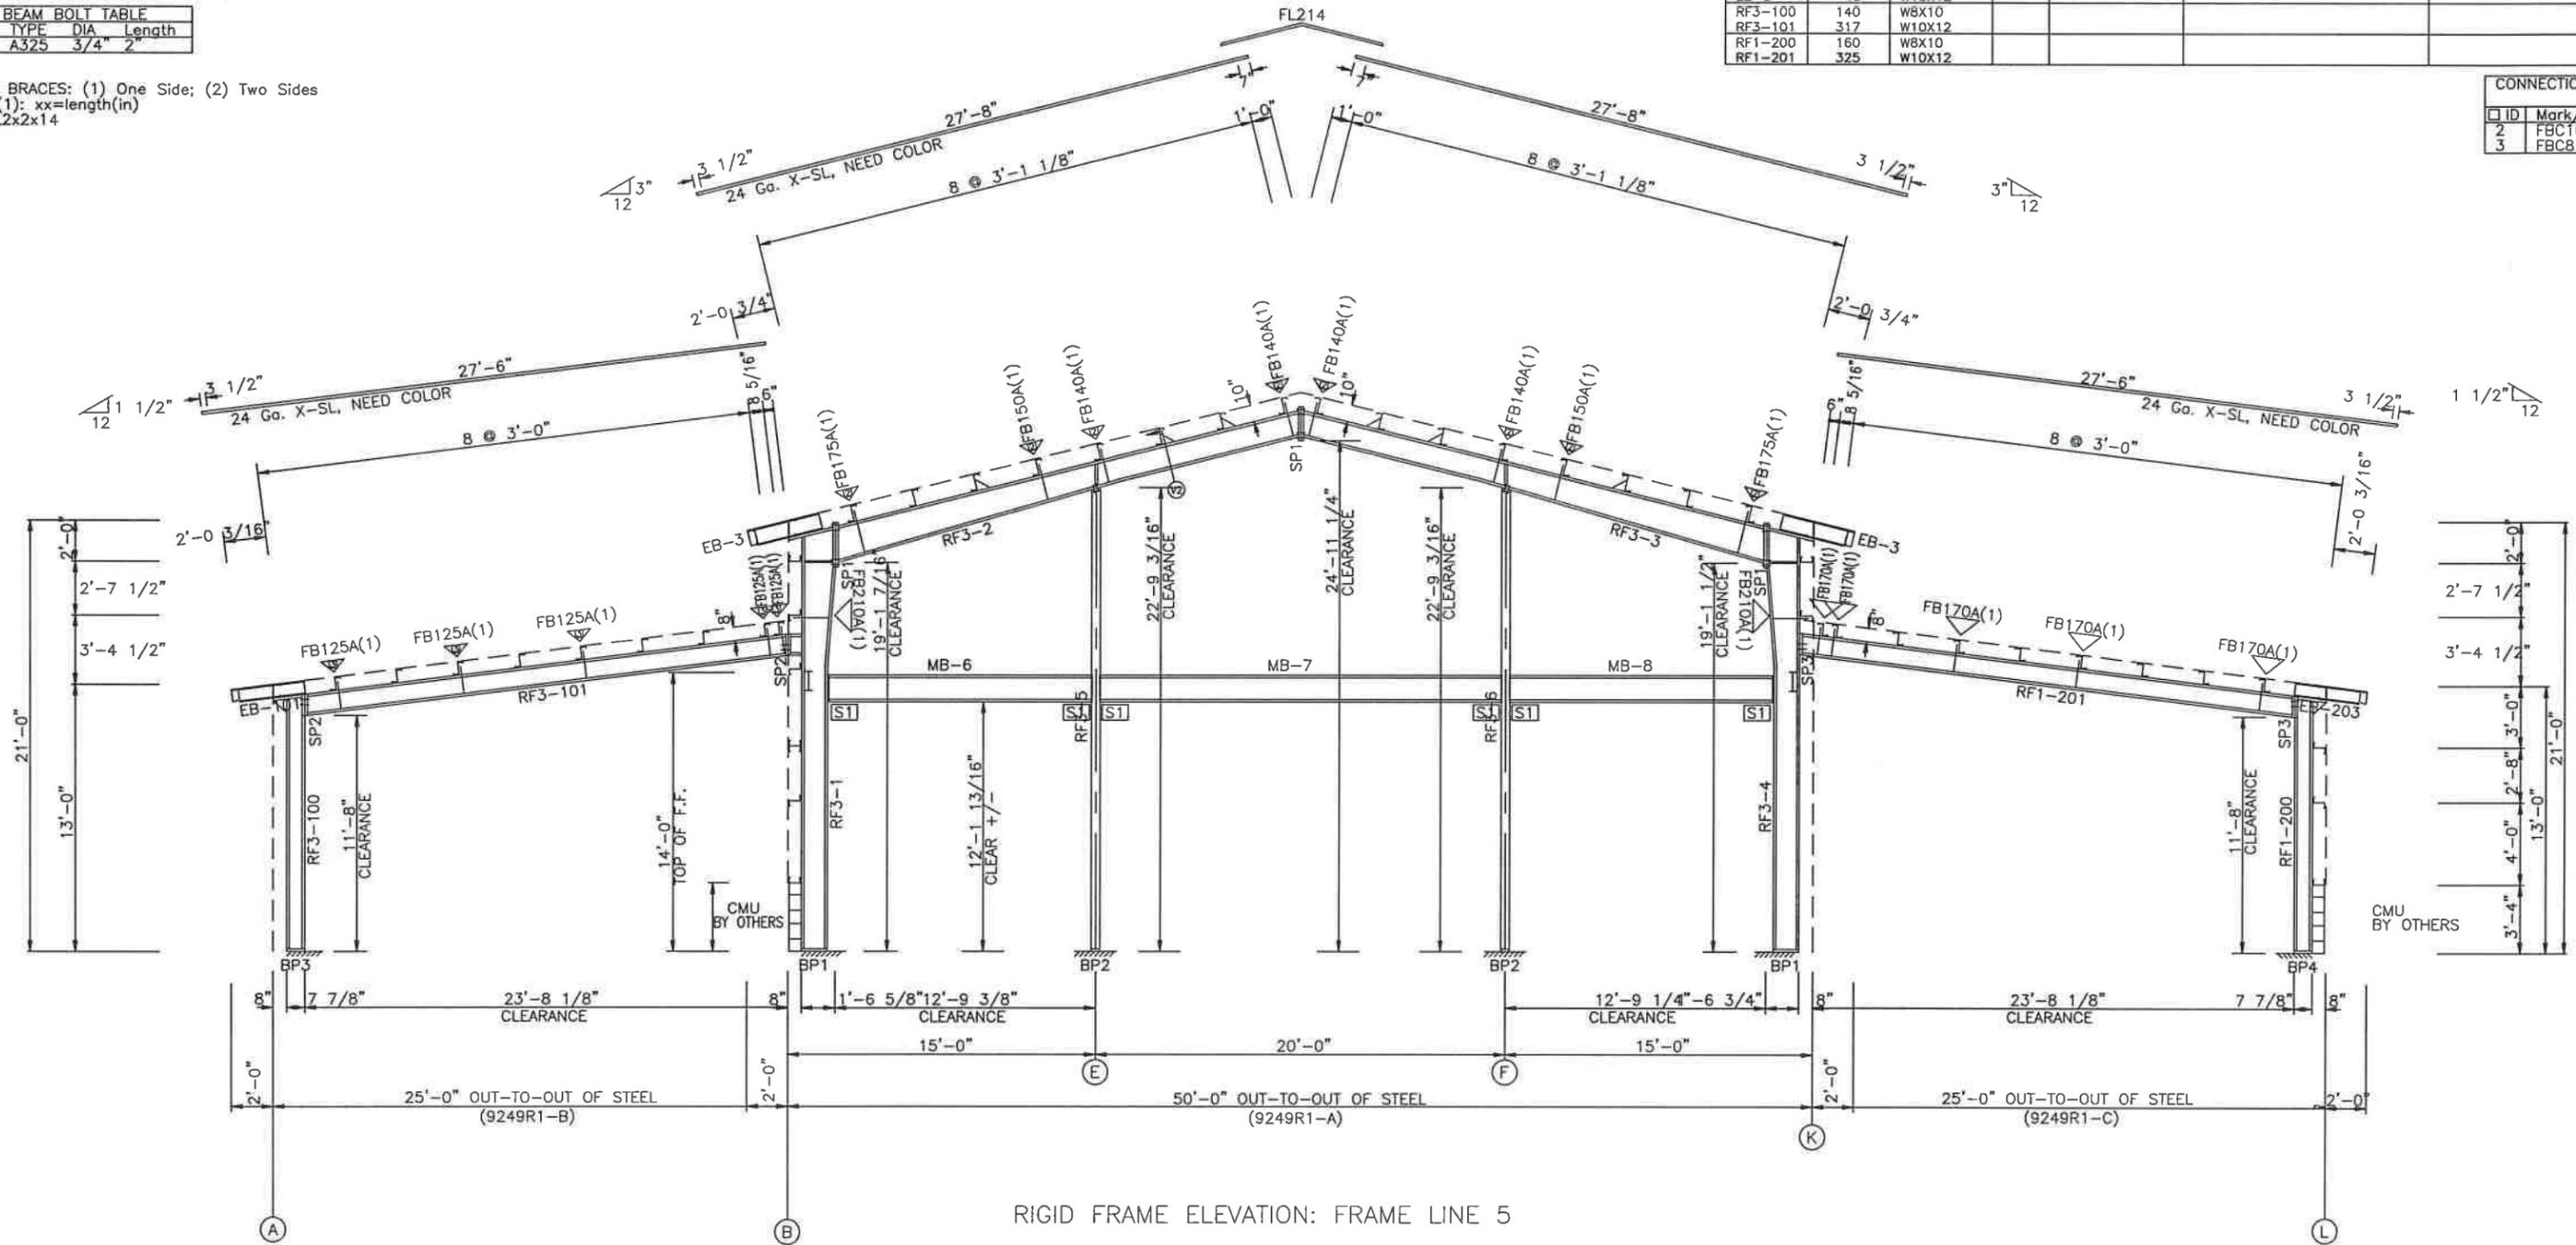

RIGID FRAME ELEVATION: FRAME LINE 5

SEE PAGE 12 FOR MEZZANINE INFORMATION

| ISSUE | DET | CHK | DATE |
|---|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.5 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |


| SPLICE BOLT TABLE | | | | | | CAP PLATE BOLTS | | | | | | |
|-------------------|-----|-----|-----|-----|------|-----------------|--------|-------|-----|-------|------|--------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length | MARK | Qty | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | | A325 | 5/8" | 2" | RF4-4 | 4 | A325T | 5/8" | 2" |
| | | | | | | | | RF4-5 | 4 | A325T | 5/8" | 2" |

| BASE PLATE TABLE | | | |
|------------------|-------|-------|-------------------|
| COL MARK | Width | THICK | PLATE SIZE Length |
| BP1 | 6" | 3/8" | 1'-0 1/2" |
| BP2 | 8" | 3/8" | 8" |

▽ FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1); xx=length(in)
 A - L2x2x14

| MEMBER TABLE | | | | | | |
|--------------|--------|---------------------|-----------|--------------|---------------------------------|--------------------------------|
| MARK | Weight | Web Depth Start/End | Web THICK | PLATE Length | Outside Flange W x Thk x Length | Inside Flange W x Thk x Length |
| RF4-1 | 359 | 12.0/13.8 | 0.135 | 5'-8 5/8" | 5 x 1/4" x 18'-3 1/16" | 5 x 1/4" x 18'-8 1/2" |
| | | 13.8/18.0 | 0.135 | 14'-11" | 5 x 1/4" x 2'-0" | |
| | | | | | 5 x 1/4" x 2'-3" | |
| RF4-2 | 415 | 18.0/12.0 | 0.135 | 14'-3 9/16" | 5 x 1/4" x 20'-0" | 5 x 1/4" x 12'-11" |
| | | 12.0/12.0 | 0.135 | 9'-5 15/16" | 5 x 1/4" x 3'-4 15/16" | 5 x 1/4" x 9'-2 7/8" |
| RF4-3 | 358 | 18.0/13.8 | 0.135 | 14'-11" | 5 x 1/4" x 2'-3" | 5 x 1/4" x 18'-8 1/2" |
| | | 13.8/12.0 | 0.135 | 5'-8 5/8" | 5 x 1/4" x 2'-0" | |
| RF4-4 | 573 | WBX24 | | | 5 x 1/4" x 18'-3 1/16" | |
| RF4-5 | 573 | WBX24 | | | | |
| EB-3 | 46 | W10x12 | | | | |

| CONNECTION PLATES | | |
|-------------------|-----------|--------|
| ID | Mark/Part | DETAIL |
| 1 | FBC10 | G25 |

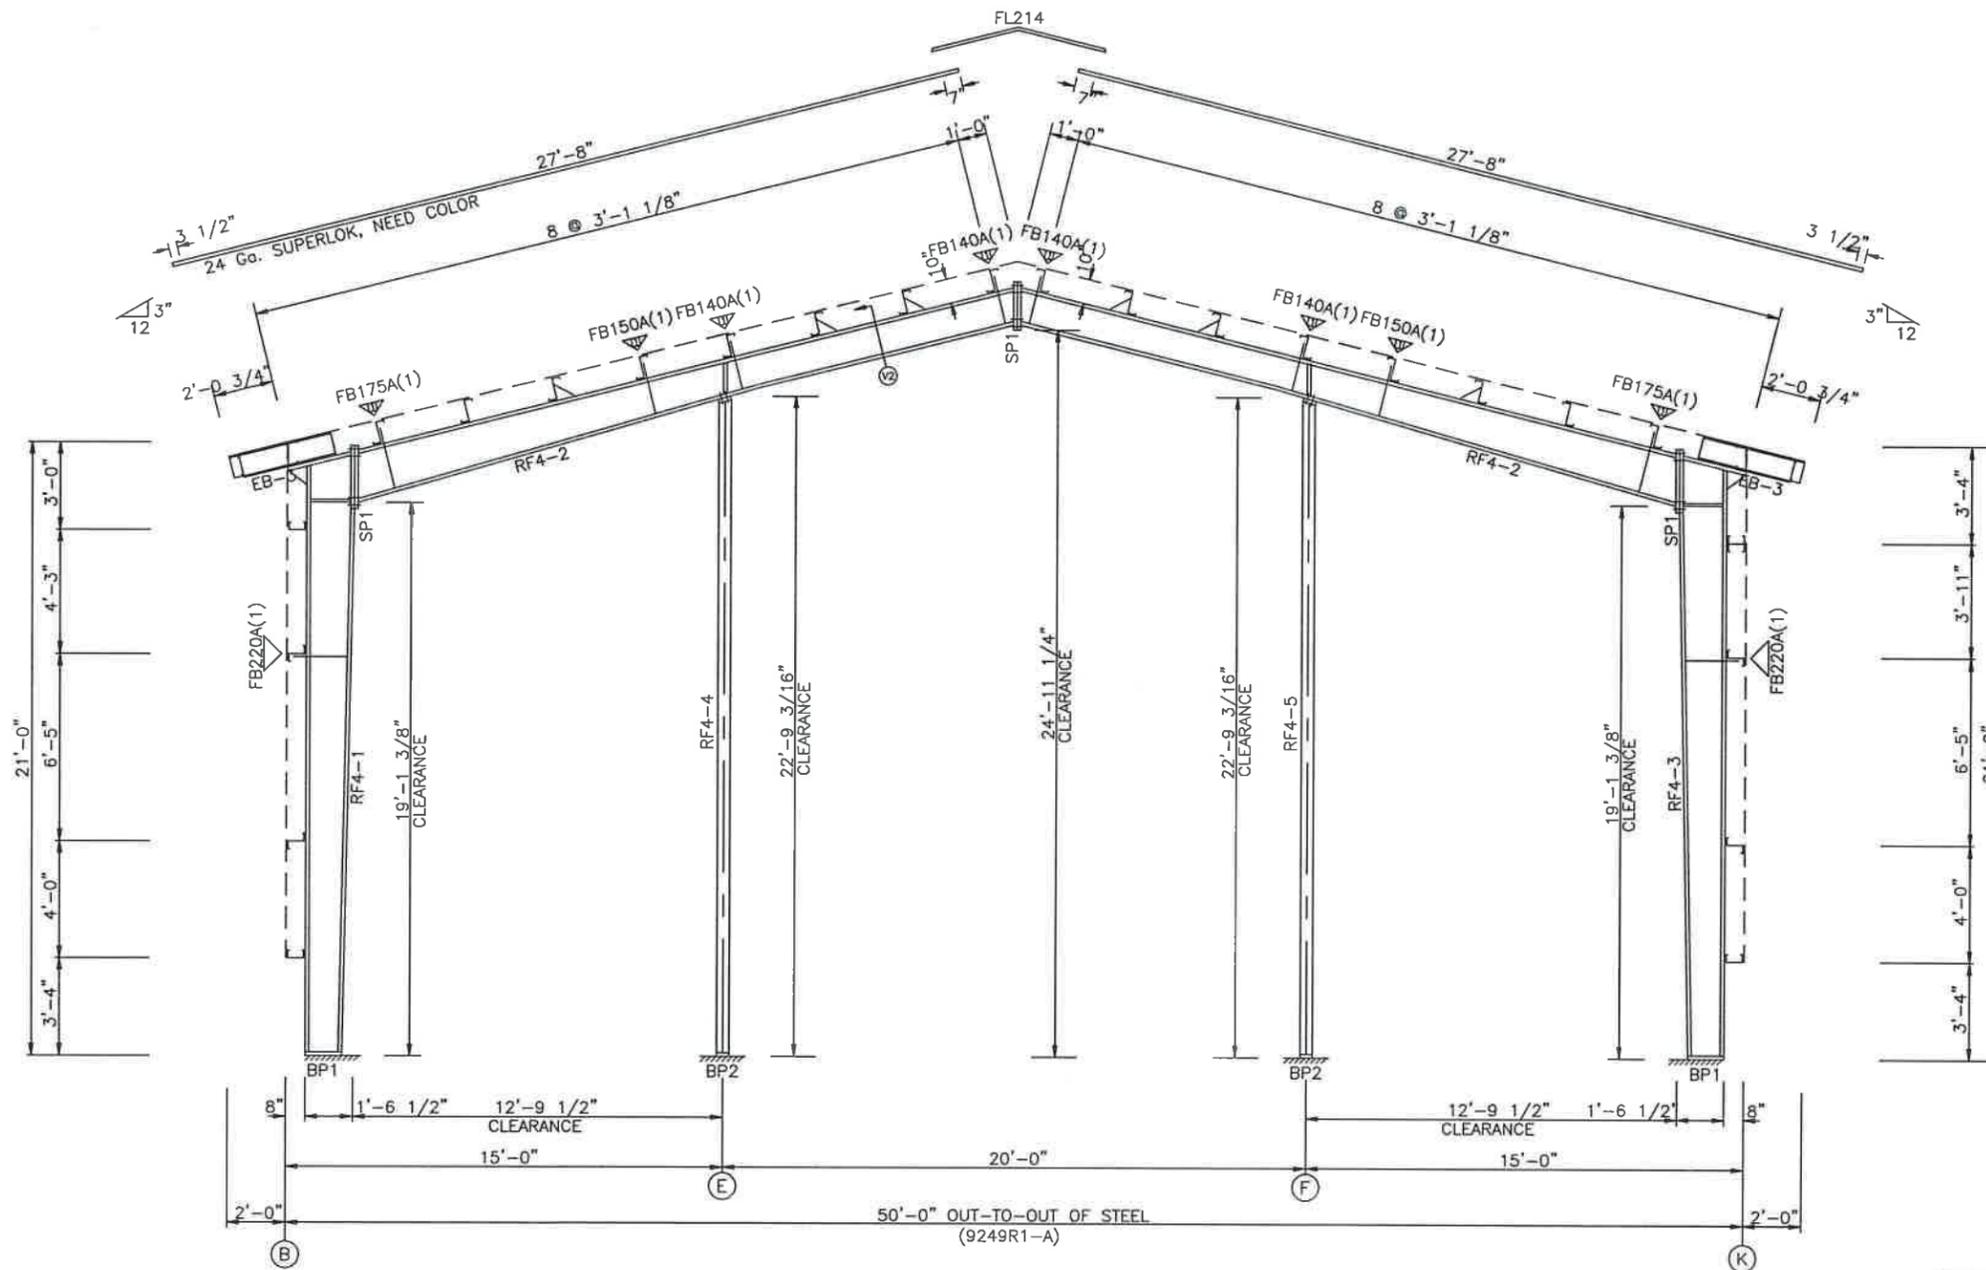

RIGID FRAME ELEVATION: FRAME LINE 6

| BUILDING "A" | | | |
|---|----------------|-----------------|-------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.6 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |


| SPLICE BOLT TABLE | | | | | | | |
|-------------------|-----|-----|-----|-----|------|------|---------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | | A325 | 5/8" | 2'-1/2" |
| SP2 | 4 | 4 | 0 | | A325 | 5/8" | 2" |

| BASE PLATE TABLE | | | |
|------------------|--------------------|-------|--------------|
| COL MARK | PLATE SIZE | Width | THICK Length |
| BP1 | 6" x 1/2" x 8 1/2" | | |

| ALTERNATE MEMBER | | |
|------------------|-----|-------|
| Frame Line | OID | MARK |
| 10 | A | RFS-4 |
| | B | RFS-5 |

▽ FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1): xx=length(in)
 A - L2x2x14

| MEMBER TABLE | | | | | | | | | |
|--------------|--------|-----------|-----------|------------------|---------------------------------|--------------------------------|--|--|--|
| MARK | Weight | Web Depth | Web THICK | Web PLATE Length | Outside Flange W x Thk x Length | Inside Flange W x Thk x Length | | | |
| RFS-1 | 578 | 7.5/10.7 | 0.188 | 5'-8 1/2" | 6 x 1/4" x 18'-2 15/16" | 6 x 5/8" x 18'-8 9/16" | | | |
| | | 10.7/18.0 | 0.188 | 14'-11" | 6 x 1/4" x 2'-0" | | | | |
| | | | | | 6 x 1/4" x 2'-3" | | | | |
| RFS-2 | 389 | 18.0/ 7.5 | 0.135 | 13'-2 11/16" | 5 x 1/4" x 20'-0" | 5 x 5/16" x 13'-3 1/16" | | | |
| | | 7.5/ 7.5 | 0.135 | 10'-6 5/16" | 5 x 1/4" x 3'-4 7/16" | 5 x 1/4" x 10'-4 5/16" | | | |
| RFS-3 | 576 | 18.0/10.7 | 0.188 | 14'-11" | 6 x 1/4" x 2'-3" | 6 x 5/8" x 18'-8 9/16" | | | |
| | | 10.7/ 7.5 | 0.188 | 5'-8 1/2" | 6 x 1/4" x 2'-0" | | | | |
| EB-3 | 46 | W10X12 | | | 6 x 1/4" x 18'-2 15/16" | | | | |

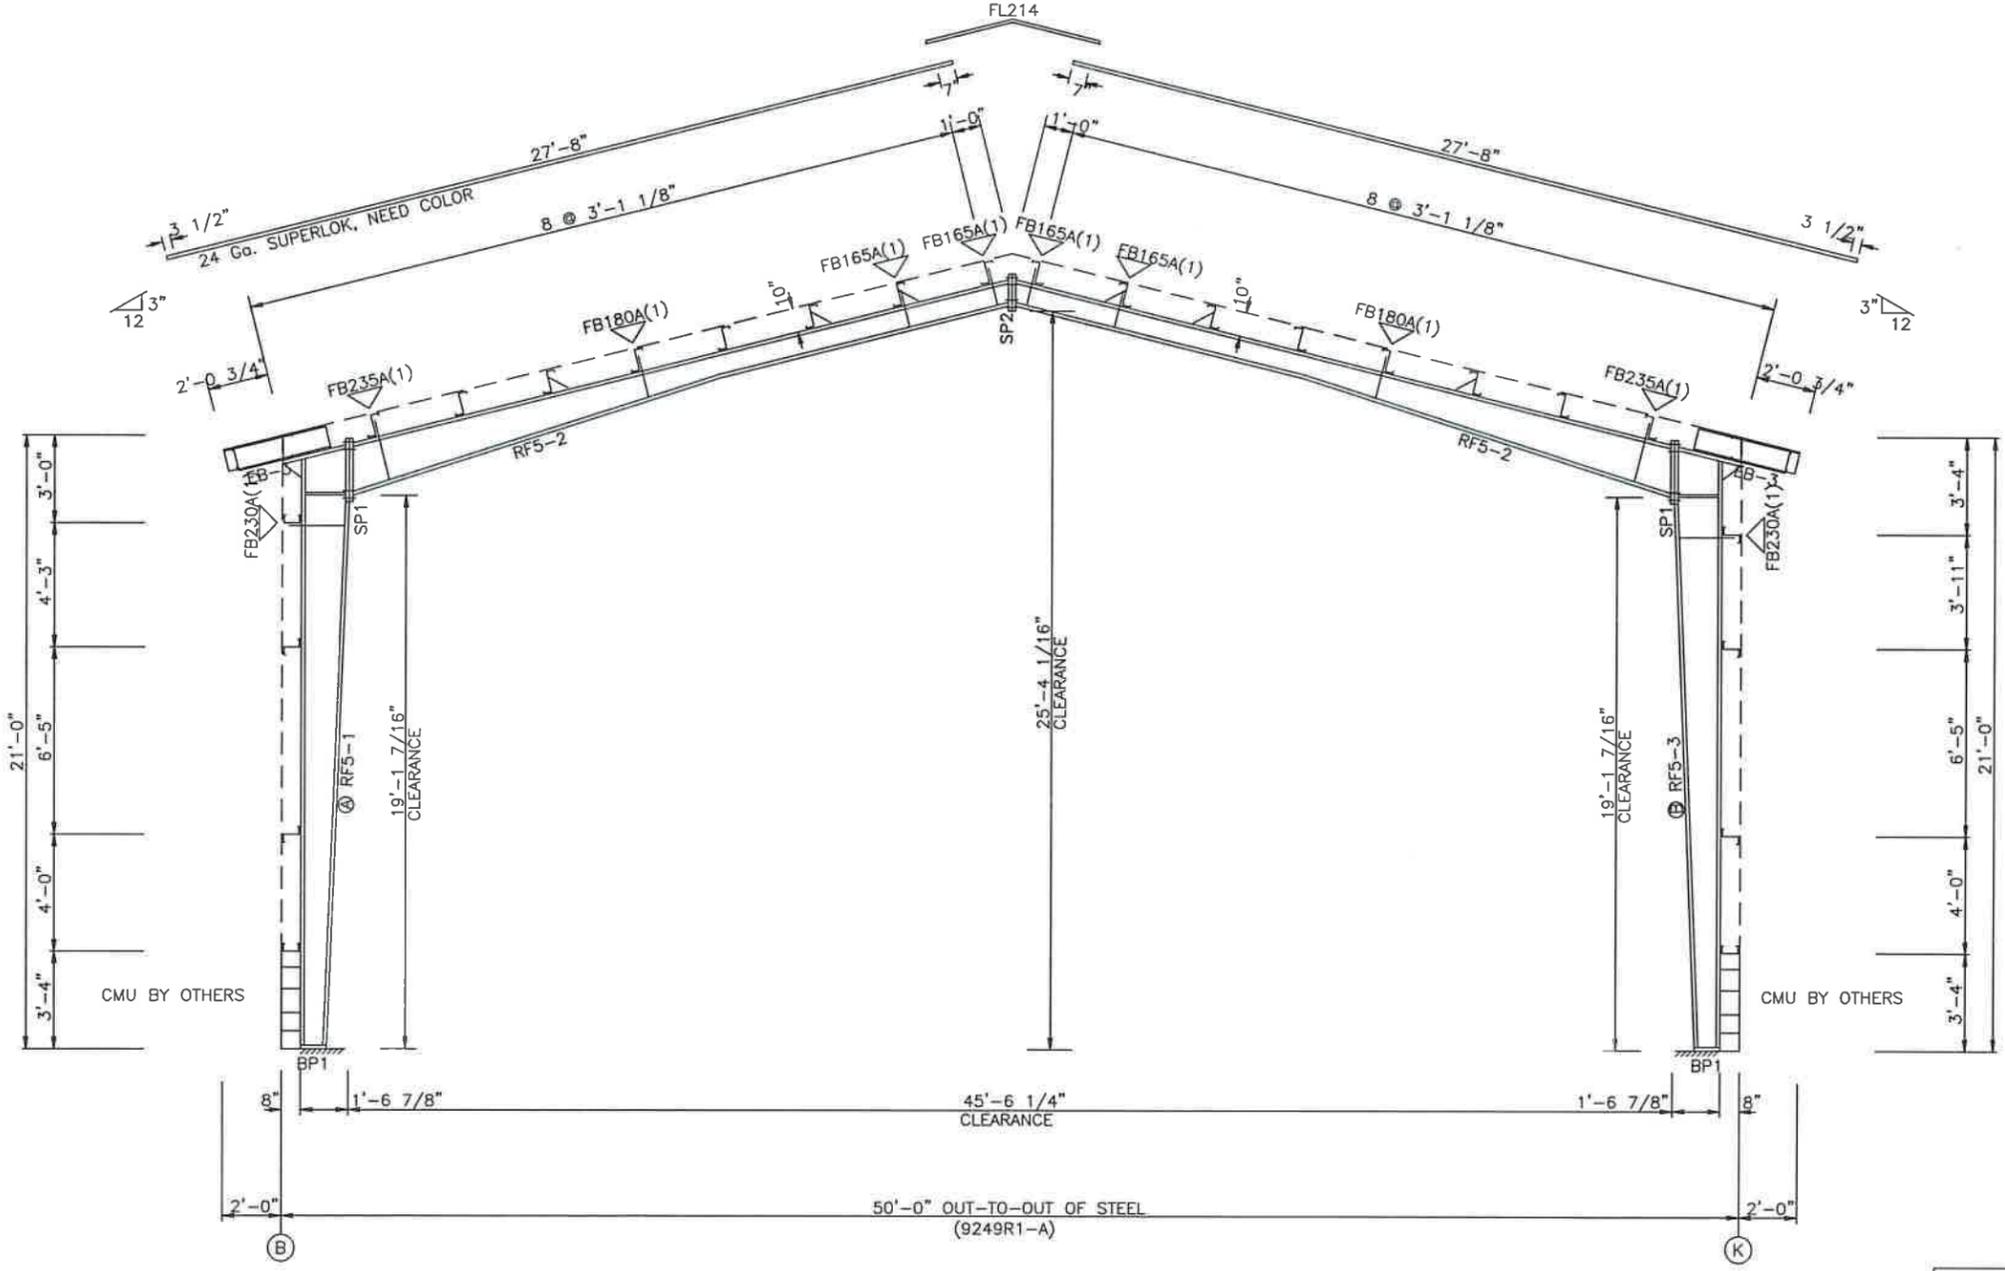

RIGID FRAME ELEVATION: FRAME LINE 7 8 9 10

| BUILDING "A" | | | |
|---|----------------|-----------------|-------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.7 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |


| SPLICE BOLT TABLE | | | | | | CAP PLATE BOLTS | | | | | | |
|-------------------|-----|-----|-----|-----|------|-----------------|--------|------|-----|-------|------|--------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length | MARK | Qty | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | | A325 | 5/8" | 2" | EC-4 | 4 | A325T | 5/8" | 2" |
| | | | | | | | | EC-3 | 4 | A325T | 5/8" | 2" |

| BASE PLATE TABLE | | | |
|------------------|-------|------------------|---------|
| COL MARK | Width | PLATE SIZE THICK | Length |
| BP1 | 6" | 3/8" | 8' 1/2" |
| BP2 | 6" | 3/8" | 8" |

| MEMBER TABLE | | Web Depth | Web PLATE | Outside Flange | Inside Flange |
|--------------|--------|------------------------------------|----------------|----------------------|--|
| MARK | Weight | Start/End | THICK Length | W x Thk x Length | W x Thk x Length |
| RF6-1 | 393 | 7.5/ 9.7 9.7/15.0 | 0.135 0.135 | 5'-7 7/8" 14'-11" | 6 x 1/4" x 18'-3 1/16" 6 x 1/4" x 2'-0" 6 x 1/4" x 1'-11 7/8" |
| RF6-2 | 385 | 15.0/10.0 | 0.135 | 14'-6 7/16" | 5 x 1/4" x 20'-0" 5 x 1/4" x 3'-8 1/16" |
| RF6-3 | 391 | 10.0/10.0 15.0/ 9.7 9.7/ 7.5 | 0.135 0.135 | 14'-11" 5'-7 7/8" | 5 x 1/4" x 1'-11 7/8" 6 x 1/4" x 2'-0" 6 x 5/16" x 18'-10 13/16" |
| EC-4 | 318 | W8X13 | | | |
| EC-3 | 318 | W8X13 | | | |
| EB-3 | 46 | W10X12 | | | |

▽ FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1): xx=length(in)
 A - L2x2x14

| CONNECTION PLATES | | |
|-------------------|-----------|--------|
| ID | Mark/Part | DETAIL |
| 1 | FBC10 | G25 |

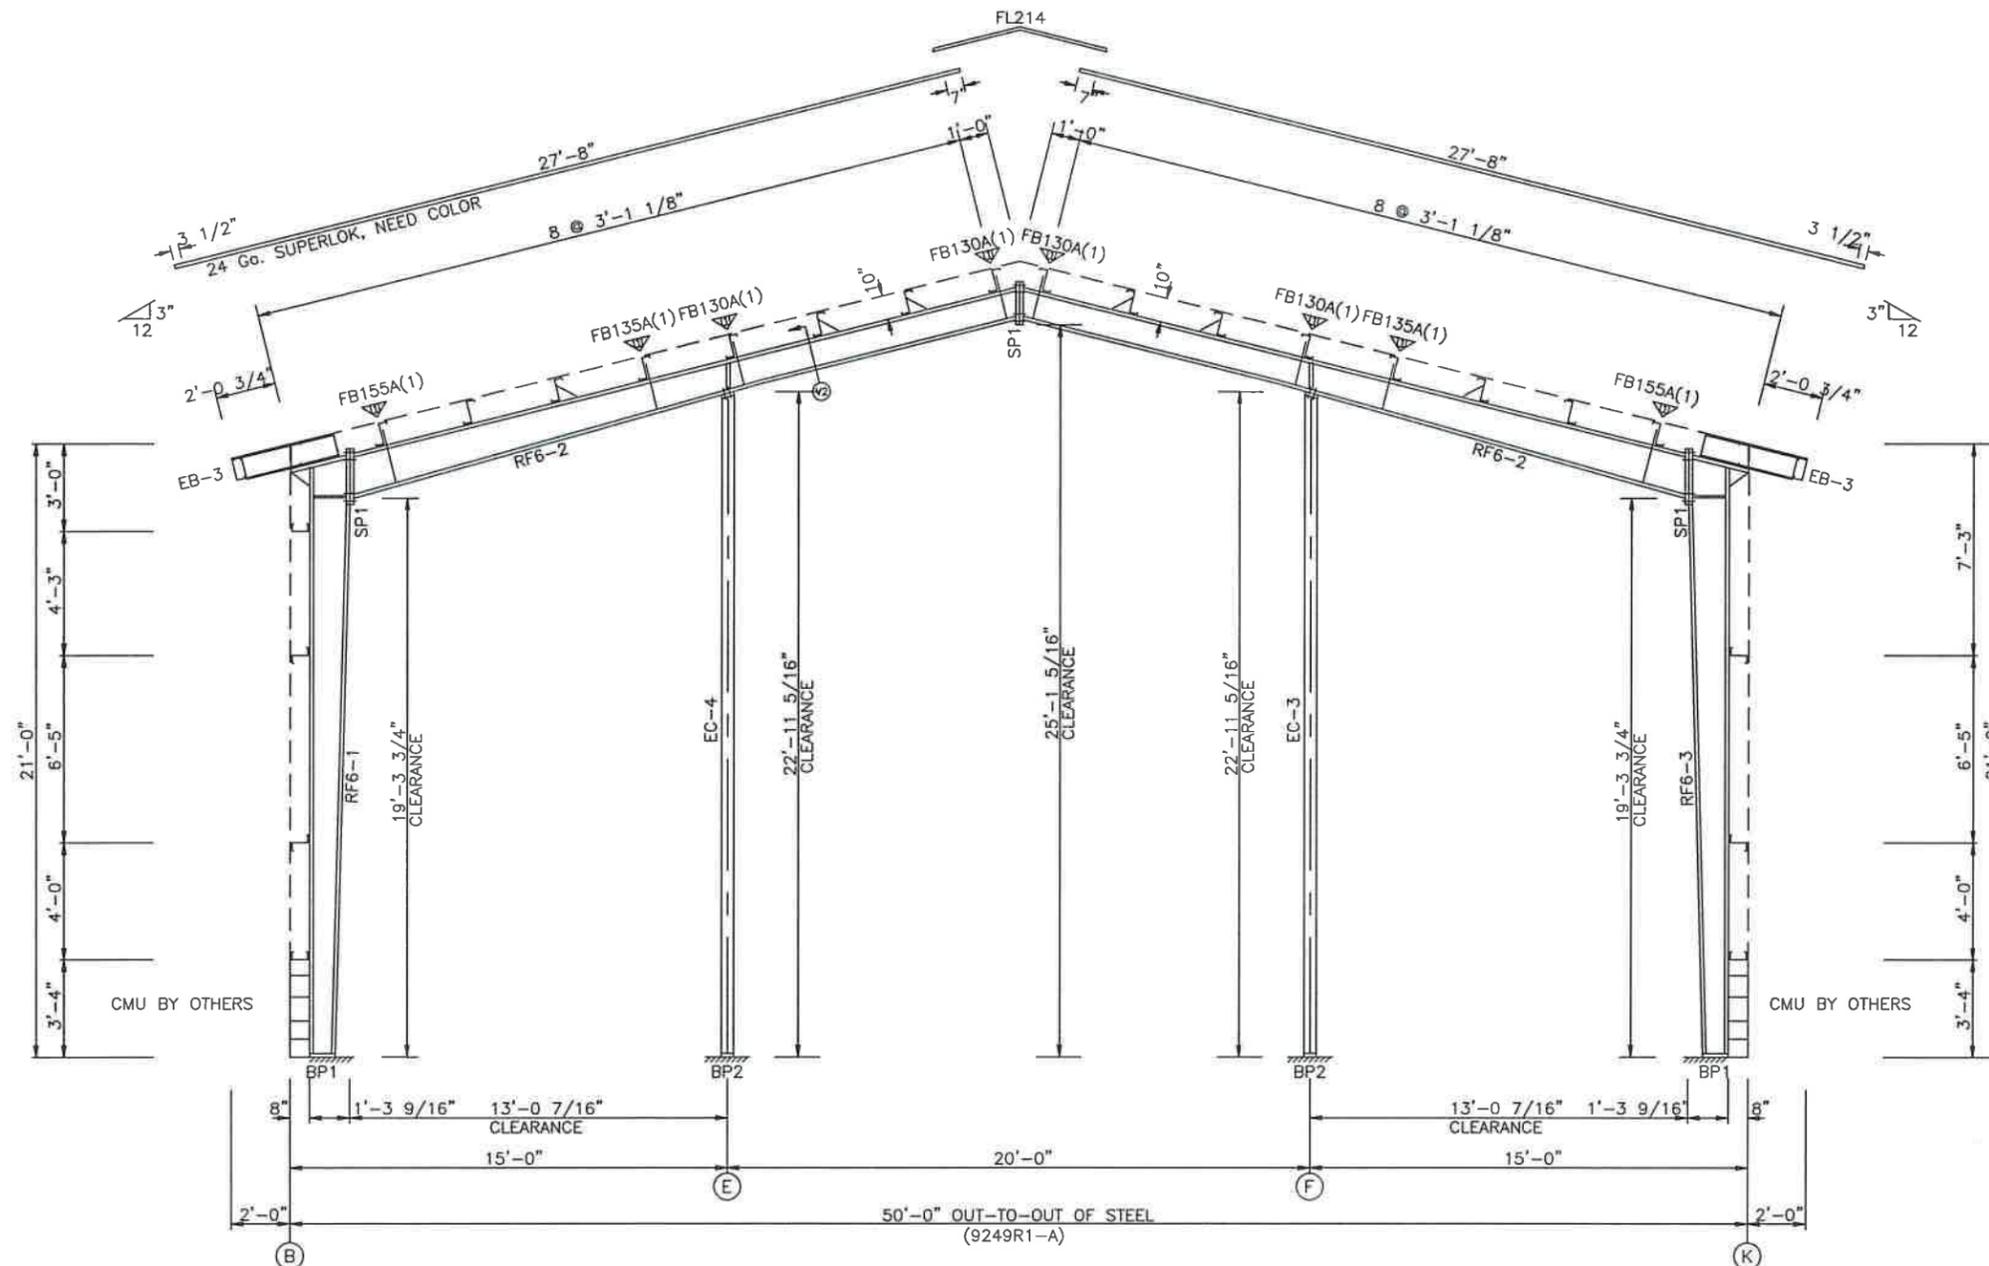

RIGID FRAME ELEVATION: FRAME LINE 11

| BUILDING "A" | | | |
|---|----------------|-----------------|-------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.8 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |


| SPLICE BOLT TABLE | | | | | | | |
|-------------------|-----|-----|-----|-----|------|------|--------|
| MARK | Qty | Top | Bot | Int | TYPE | DIA | Length |
| SP1 | 4 | 4 | 0 | | A325 | 5/8" | 2 1/2" |
| SP2 | 4 | 4 | 0 | | A325 | 5/8" | 2" |

| BASE PLATE TABLE | | | |
|------------------|------------|-------|--------|
| COL | PLATE SIZE | | |
| MARK | Width | THICK | Length |
| BP1 | 6" | 3/8" | 8 1/2" |

▽ FLANGE BRACES: (1) One Side; (2) Two Sides
 FBxxA(1): xx=length(in)
 A - L2x2x14

| MEMBER TABLE | | | | | |
|--------------|--------|-----------------------|-----------|---------------------------|---|
| MARK | Weight | Web Depth | Web PLATE | Outside Flange | Inside Flange |
| | | Start/End | THICK | W x Thk x Length | W x Thk x Length |
| RF7-1 | 513 | 7.5/ 9.4 9.4/14.0 | 0.188 | 5'-7 5/8" 14'-11" | 6 x 5/16" x 18'-3 1/16" 6 x 5/16" x 2'-0" 6 x 1/4" x 1'-10 15/16" |
| RF7-2 | 363 | 14.0/ 7.5 7.5/ 7.5 | 0.135 | 13'-5 3/4" 10'-6 5/16" | 5 x 1/4" x 20'-0" 5 x 1/4" x 3'-8 1/2" |
| EB-4 | 44 | W10X12 | | | 5 x 1/4" x 13'-5 7/8" |
| EB-5 | 44 | W10X12 | | | 5 x 1/4" x 10'-4 5/16" |

| CONNECTION PLATES | | |
|-------------------|-----------|--------|
| ID | Mark/Part | DETAIL |
| 1 | FBC10 | G25 |

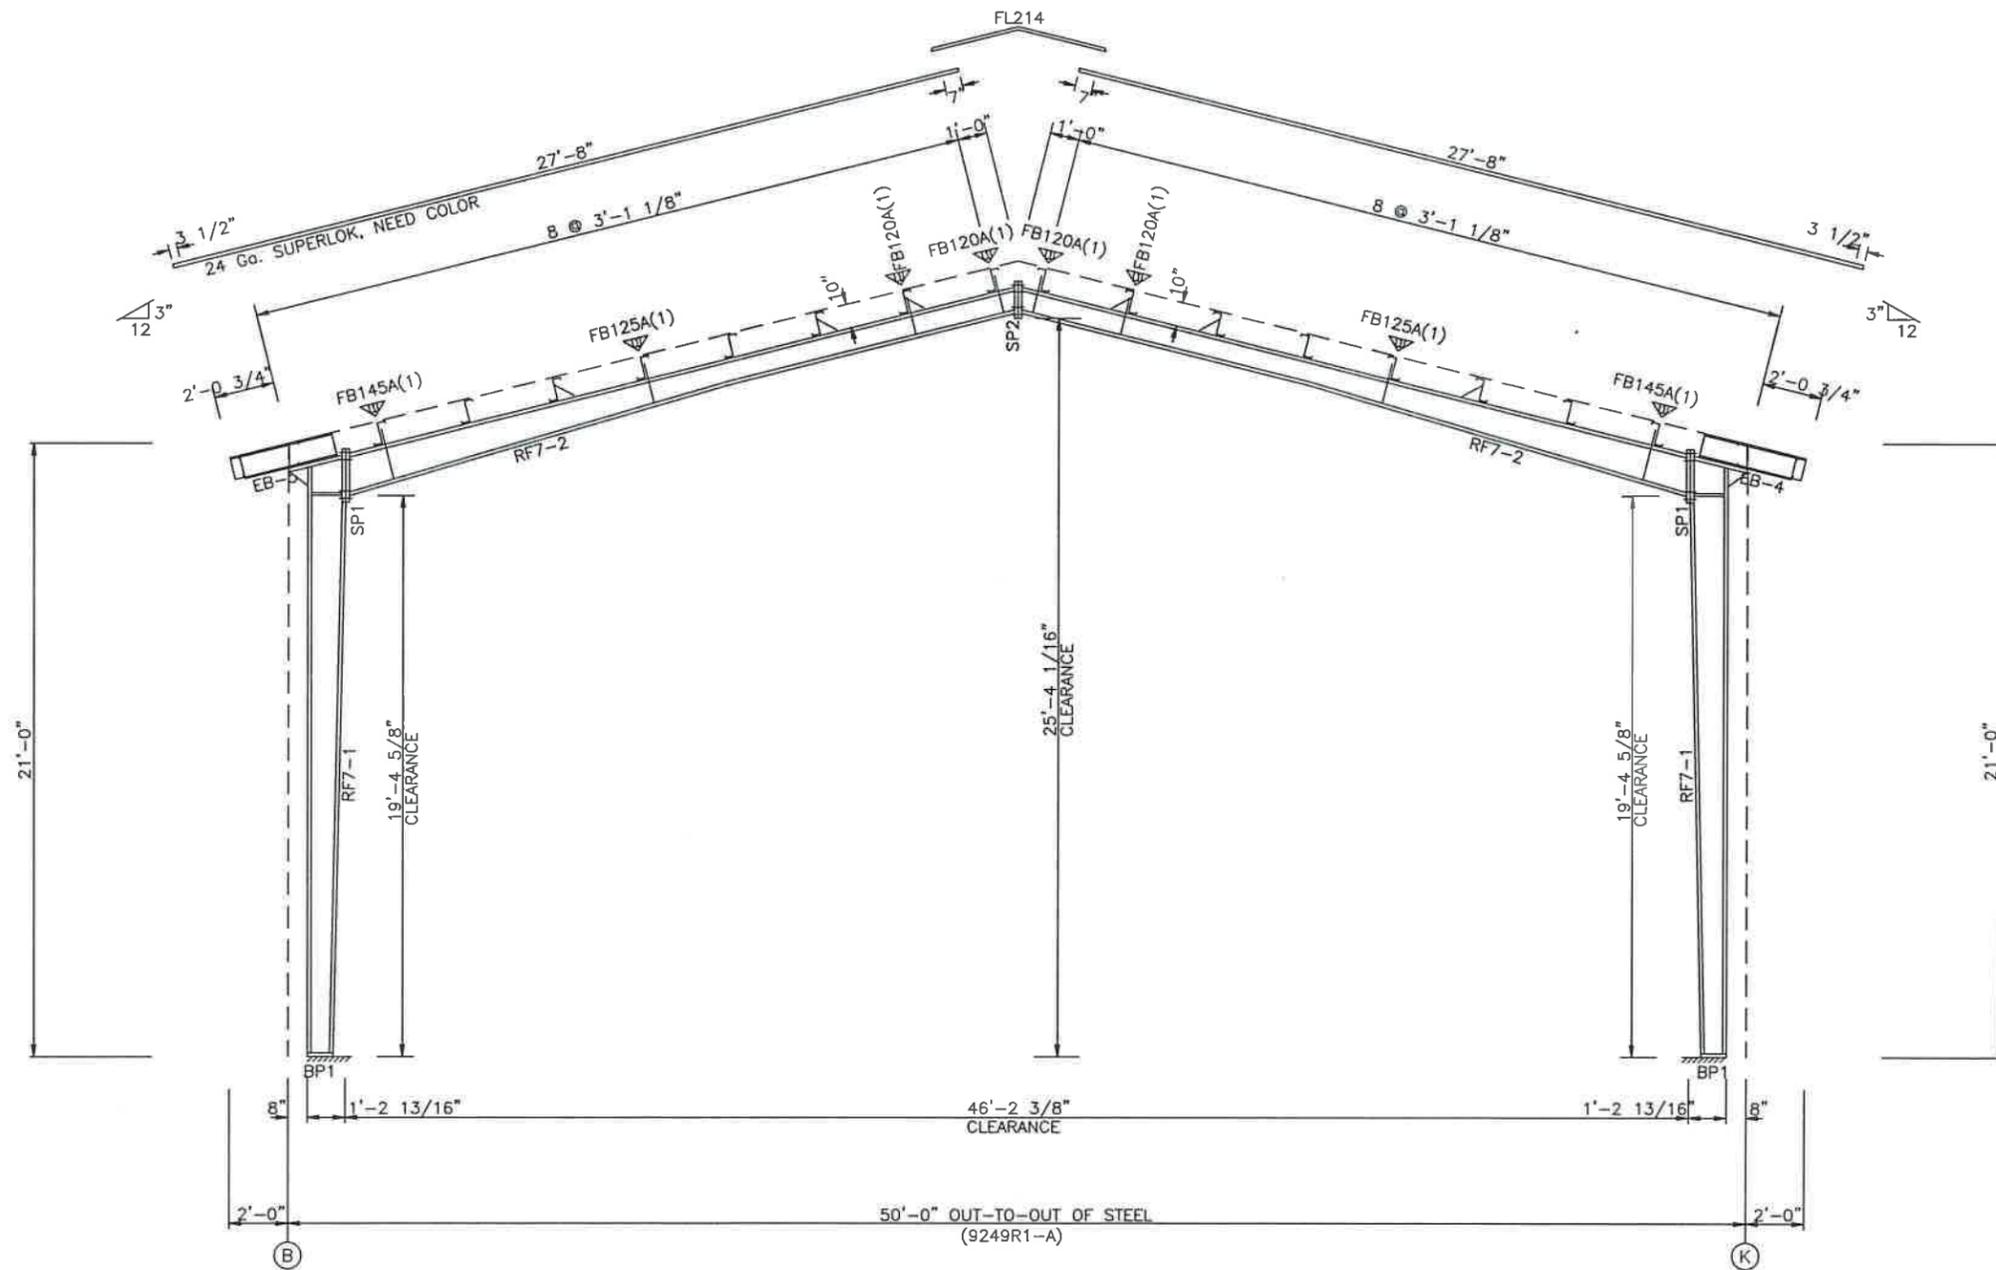


RIGID FRAME ELEVATION: FRAME LINE 12

| | | | |
|--|-------------------|--------------------|----------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.9 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| SPlice BOLTS | | | | |
|--------------|---------------|------|------|--------|
| Splice Mark | Quan Top/ Bot | Type | Di | Length |
| SP1 | 4 4 | A325 | 3/4" | 2 1/2" |

| MEMBER SIZE TABLE | | |
|-------------------|--------|---------|
| MARK | MEMBER | LENGTH |
| WF-2 | B10651 | 22'-11" |
| WF-1 | B12641 | 19'-8" |

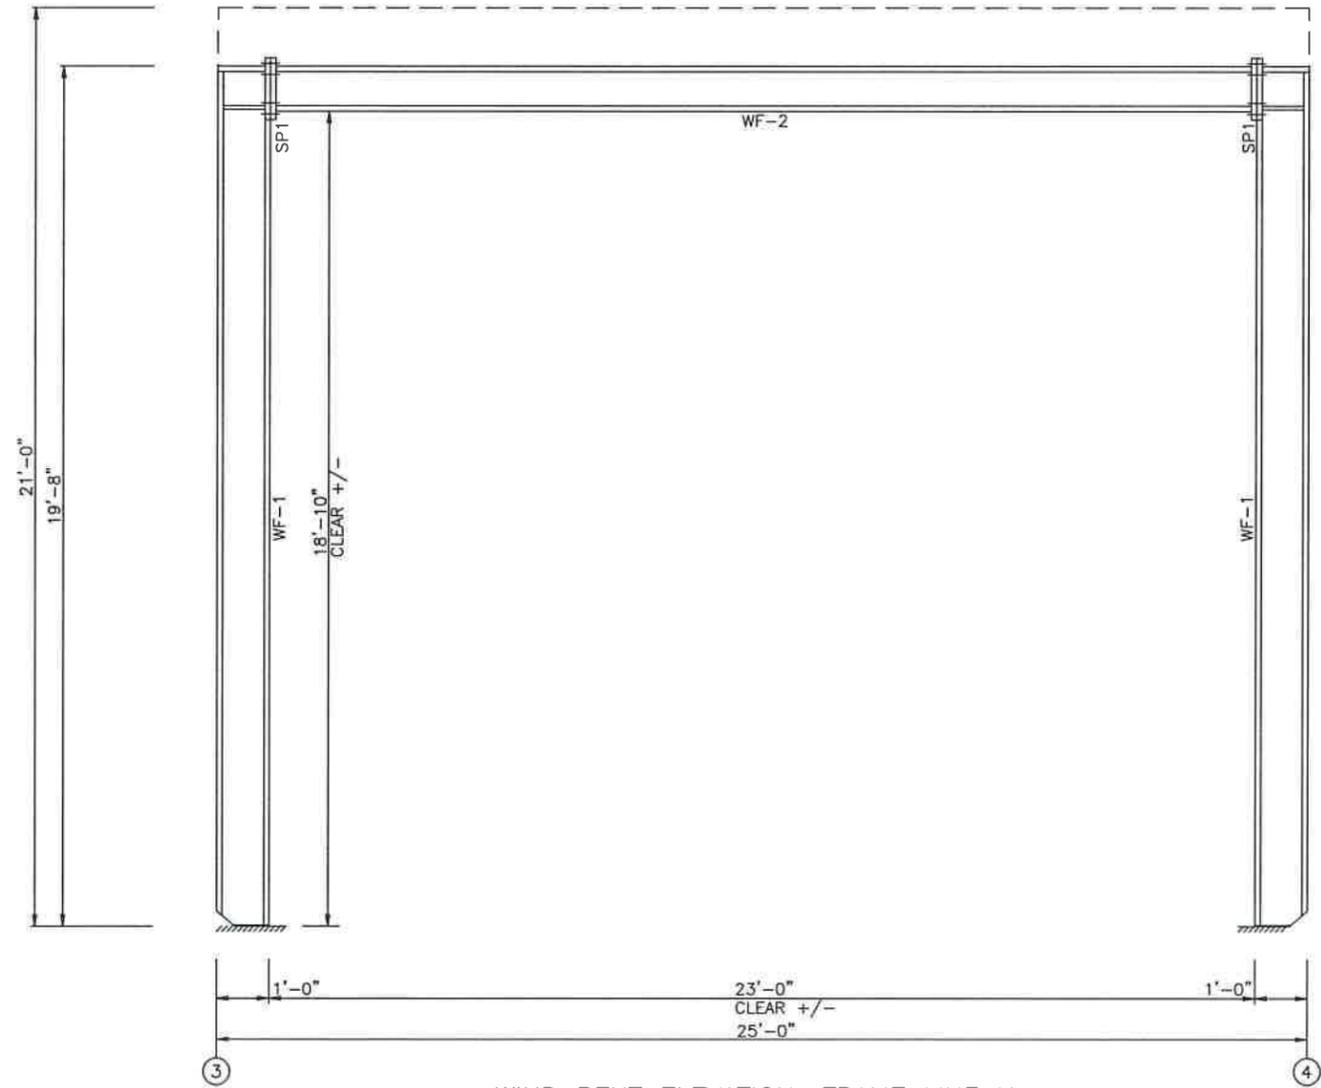


WIND BENT ELEVATION: FRAME LINE K

| | | | |
|--|-------------------|--------------------|----------------|
| BLDG "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.10 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| SPlice BOLTS | | | | |
|--------------|------|---------|------|------------|
| Splice Mark | Quan | Top/Bot | Type | Dia Length |
| SP1 | 4 | 4 | A325 | 5/8" 2" |

| MEMBER SIZE TABLE | | |
|-------------------|--------|-------------|
| MARK | MEMBER | LENGTH |
| WF-101 | B10651 | 22'-11 3/4" |
| WF-100 | B12541 | 11'-8" |

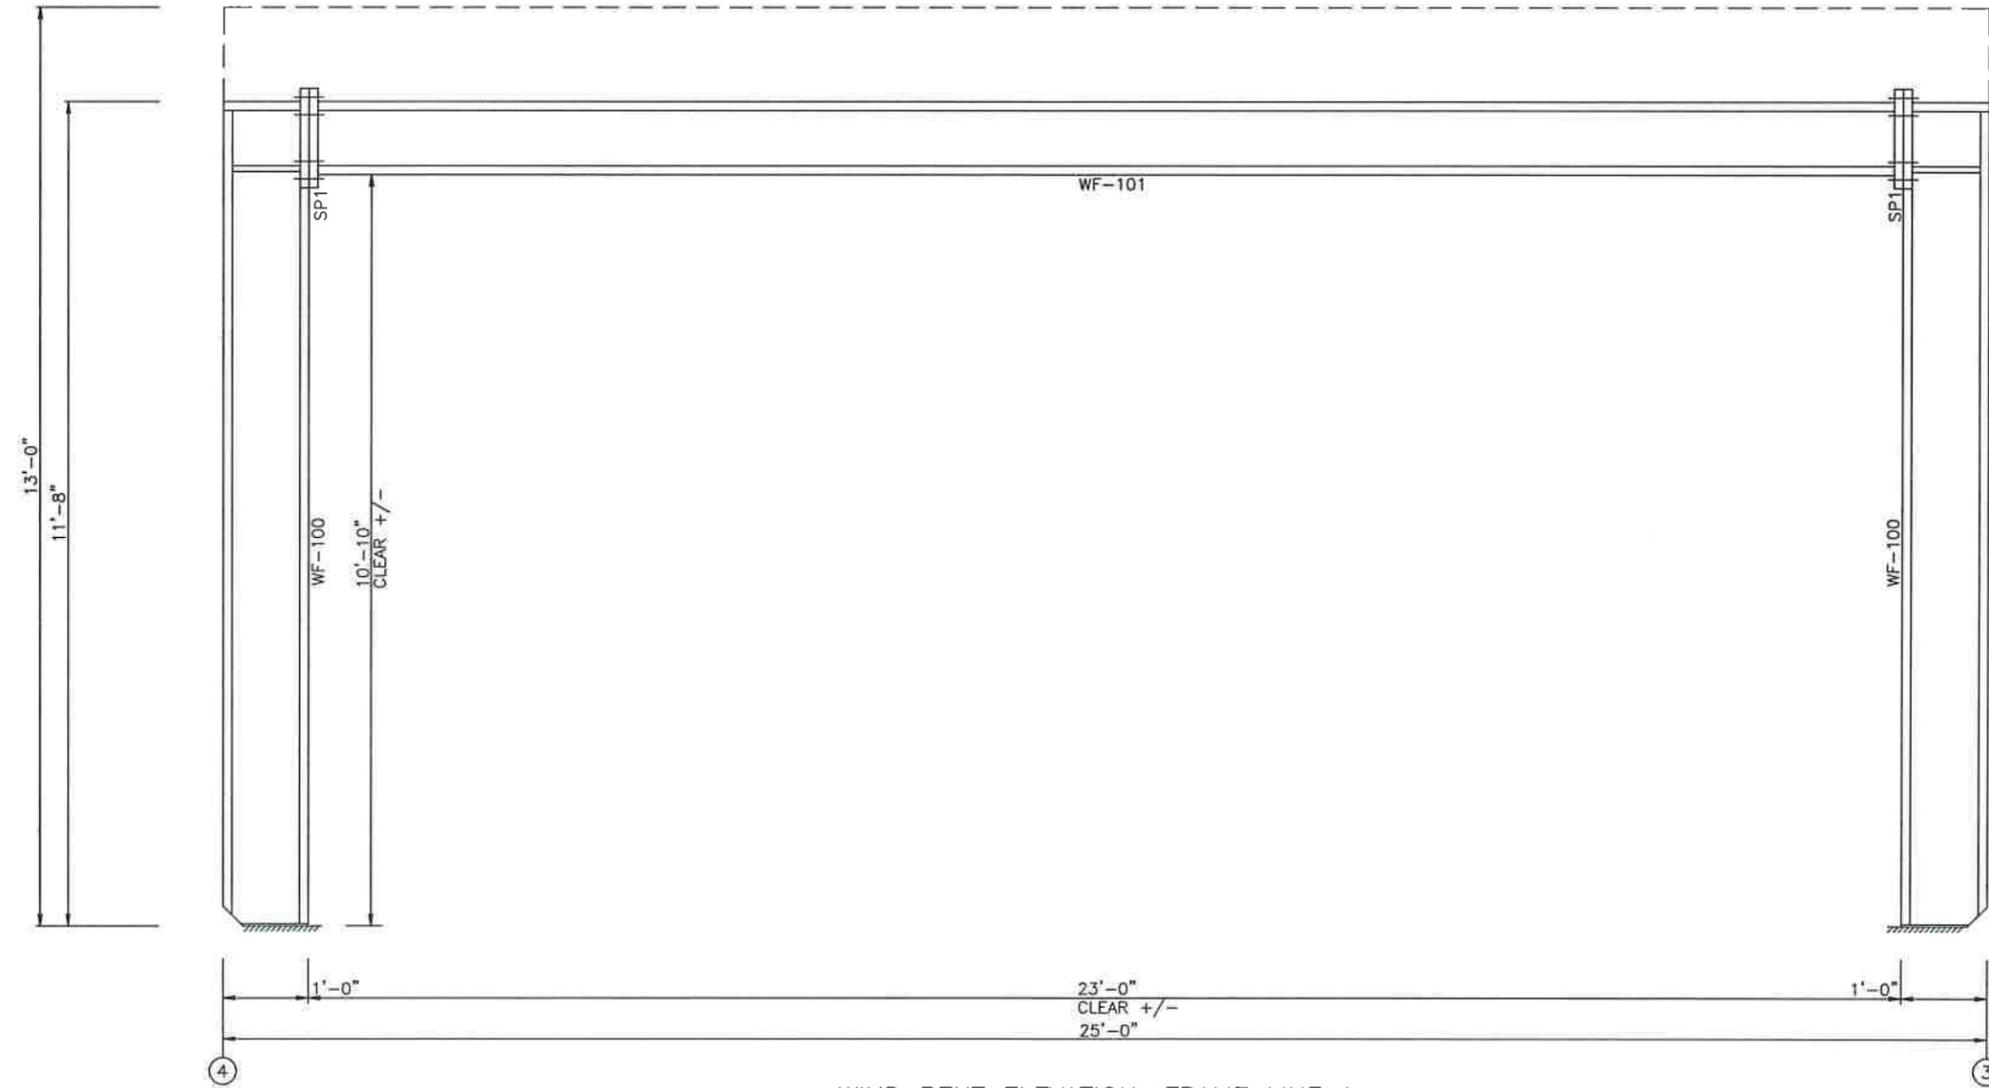


WIND BENT ELEVATION: FRAME LINE A

| | | | |
|--|-------------------|--------------------|----------------|
| BLDG "B" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNICAL SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.11 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| SPlice BOLTS | | | | |
|--------------|------|----------|------|-----------------|
| Splice Mark | Quan | Top/ Bot | Type | Bolt Dia Length |
| SP1 | 4 | 4 | A325 | 5/8" 2" |

| MEMBER SIZE TABLE | | |
|-------------------|--------|-------------|
| MARK | MEMBER | LENGTH |
| WF-201 | B10651 | 22'-11 3/4" |
| WF-200 | B12541 | 11'-8" |

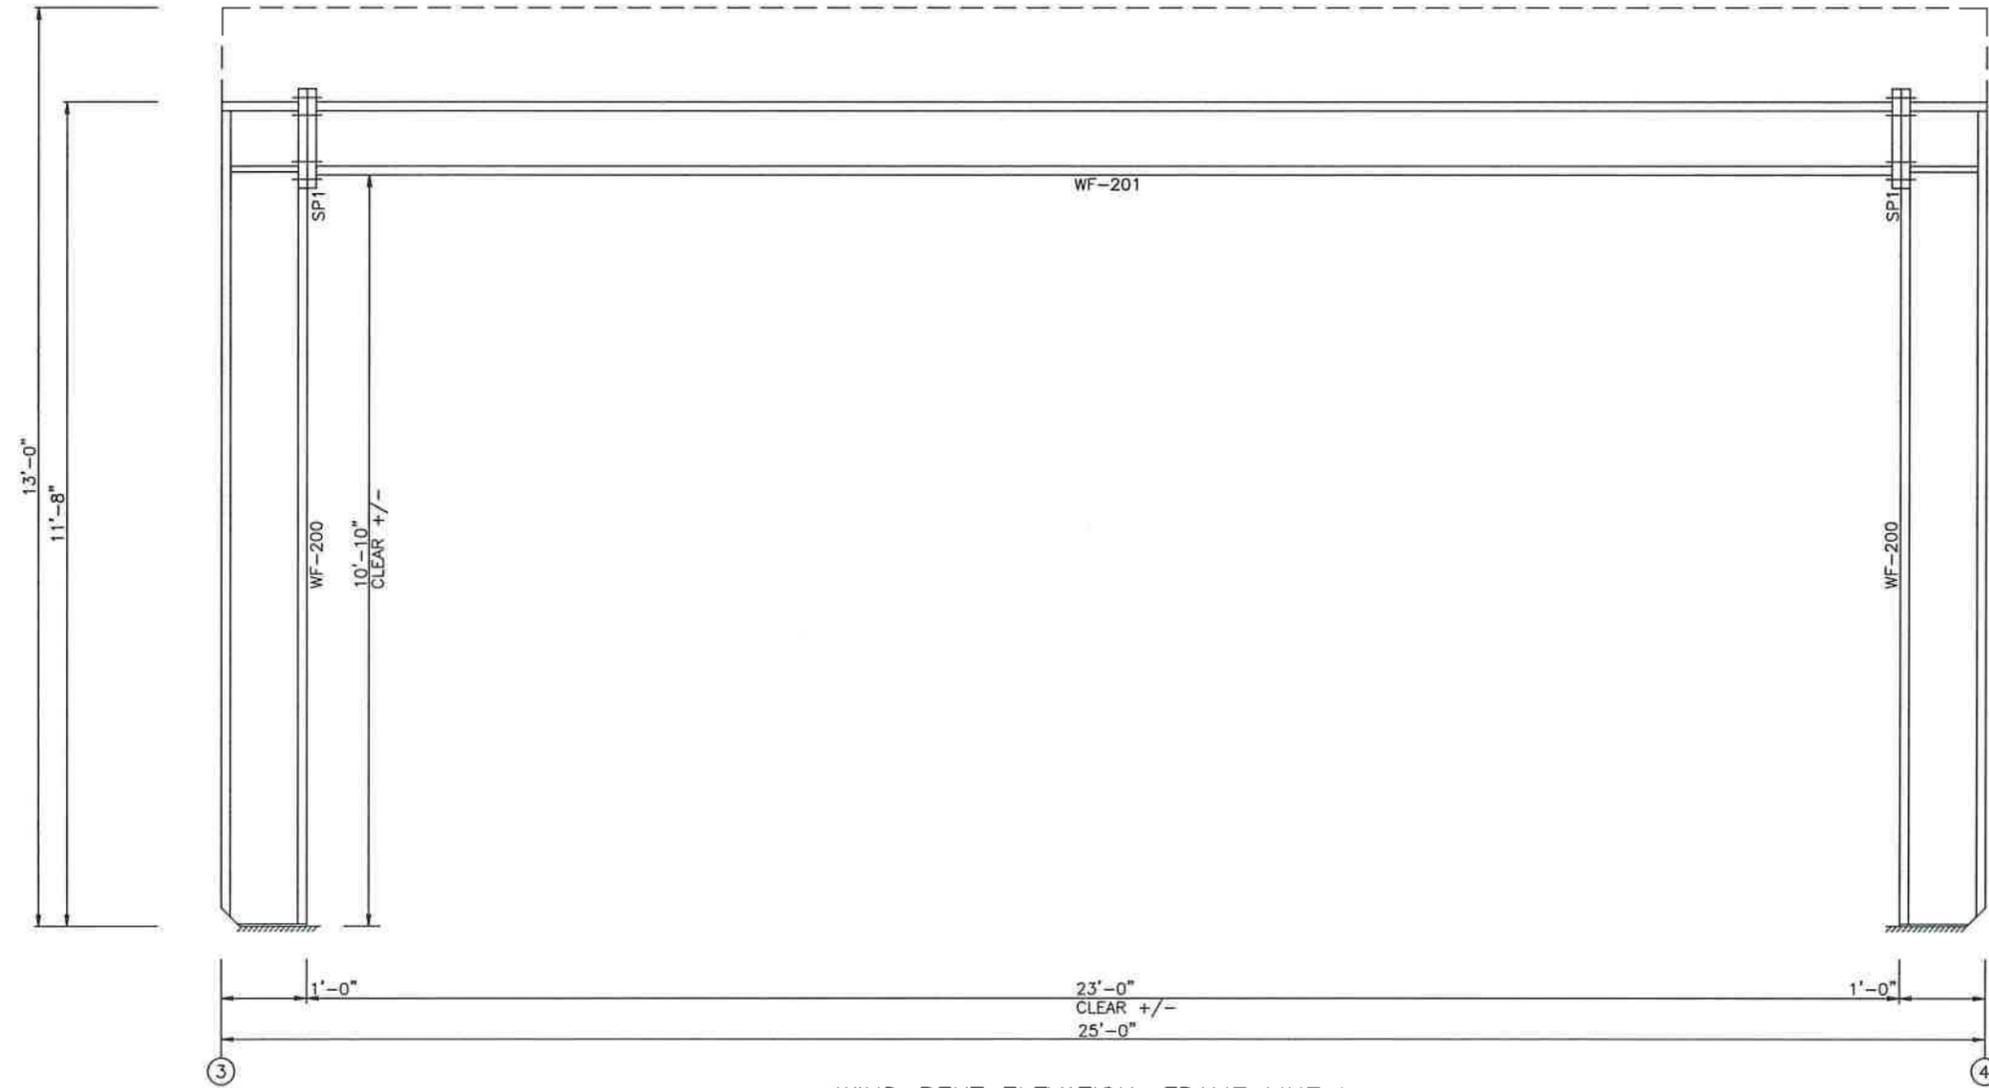


WIND BENT ELEVATION: FRAME LINE L

| | | | |
|--|-------------------|--------------------|----------------|
| BLDG "C" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNICAL SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.12 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| SPICE BOLTS | | | | | |
|-------------|------|---------|------|------|--------|
| Splice Mark | Quan | Top/Bot | Type | Dia | Length |
| SP1 | 4 | 4 | A325 | 3/4" | 2 1/2" |

| MEMBER SIZE TABLE | | |
|-------------------|--------|--------|
| MARK | MEMBER | LENGTH |
| WF-3 | B10651 | 23'-5" |
| WF-1 | B12641 | 19'-8" |

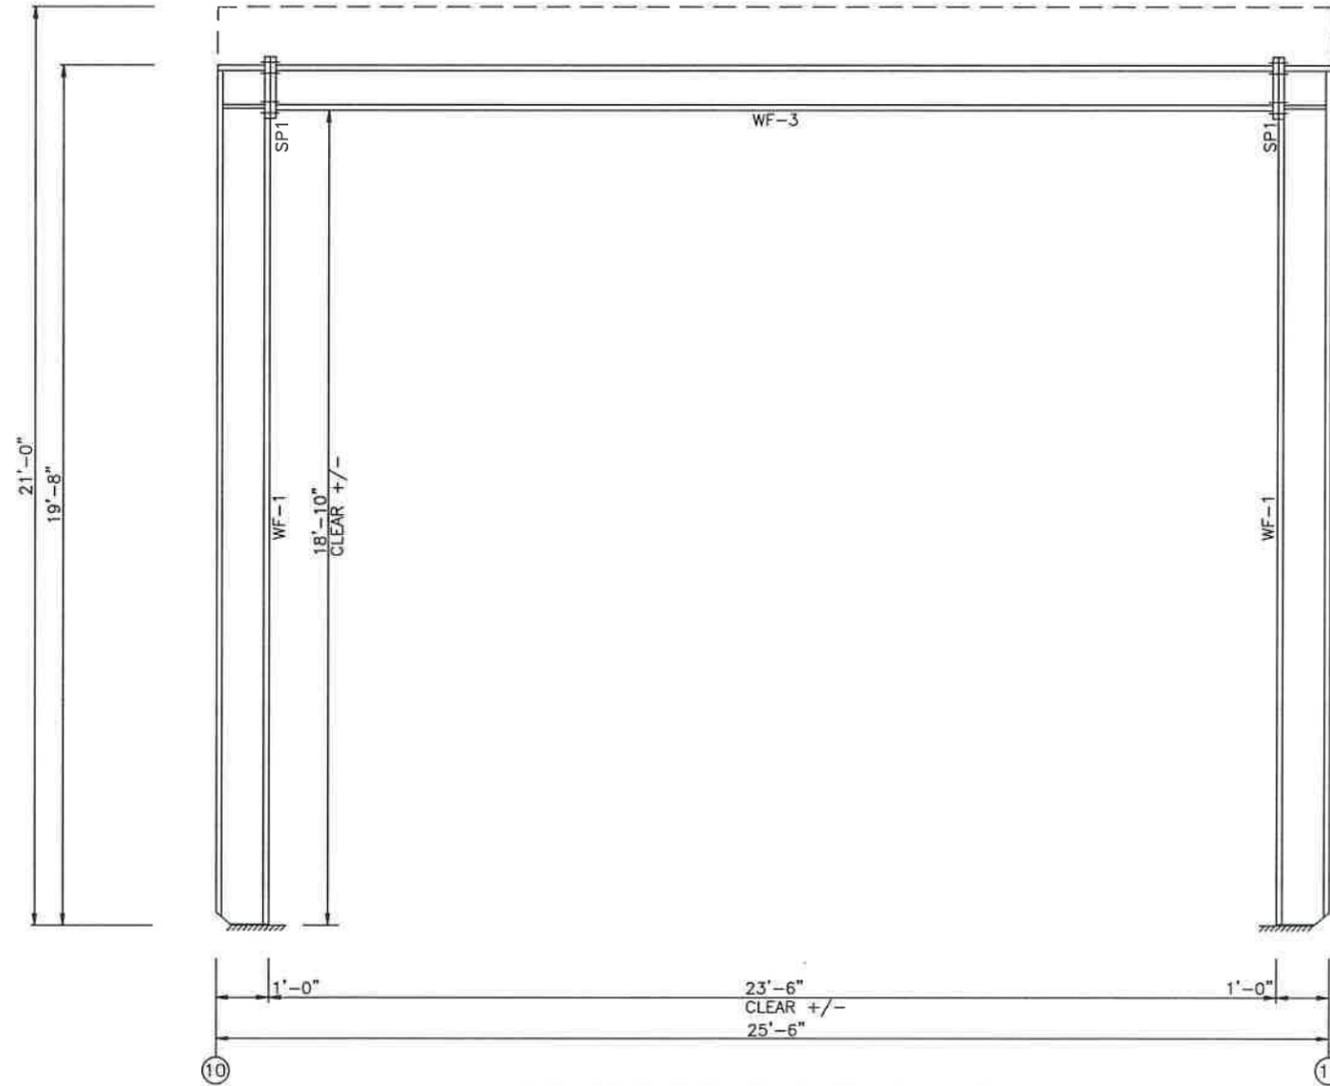


WIND BENT ELEVATION: FRAME LINE K

| | | | |
|---|----------------|-----------------|-------------|
| BLDG "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.13 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| SPLICE BOLTS | | | | |
|--------------|---------|------|------|-------------|
| Splice Mark | Quan | | Bolt | |
| | Top/Bot | Type | Dia | Length |
| SP1 | 4 | 4 | A325 | 3/4" 2 1/2" |

| MEMBER SIZE TABLE | | |
|-------------------|--------|--------|
| MARK | MEMBER | LENGTH |
| WF-3 | B10651 | 23'-5" |
| WF-1 | B12641 | 19'-8" |

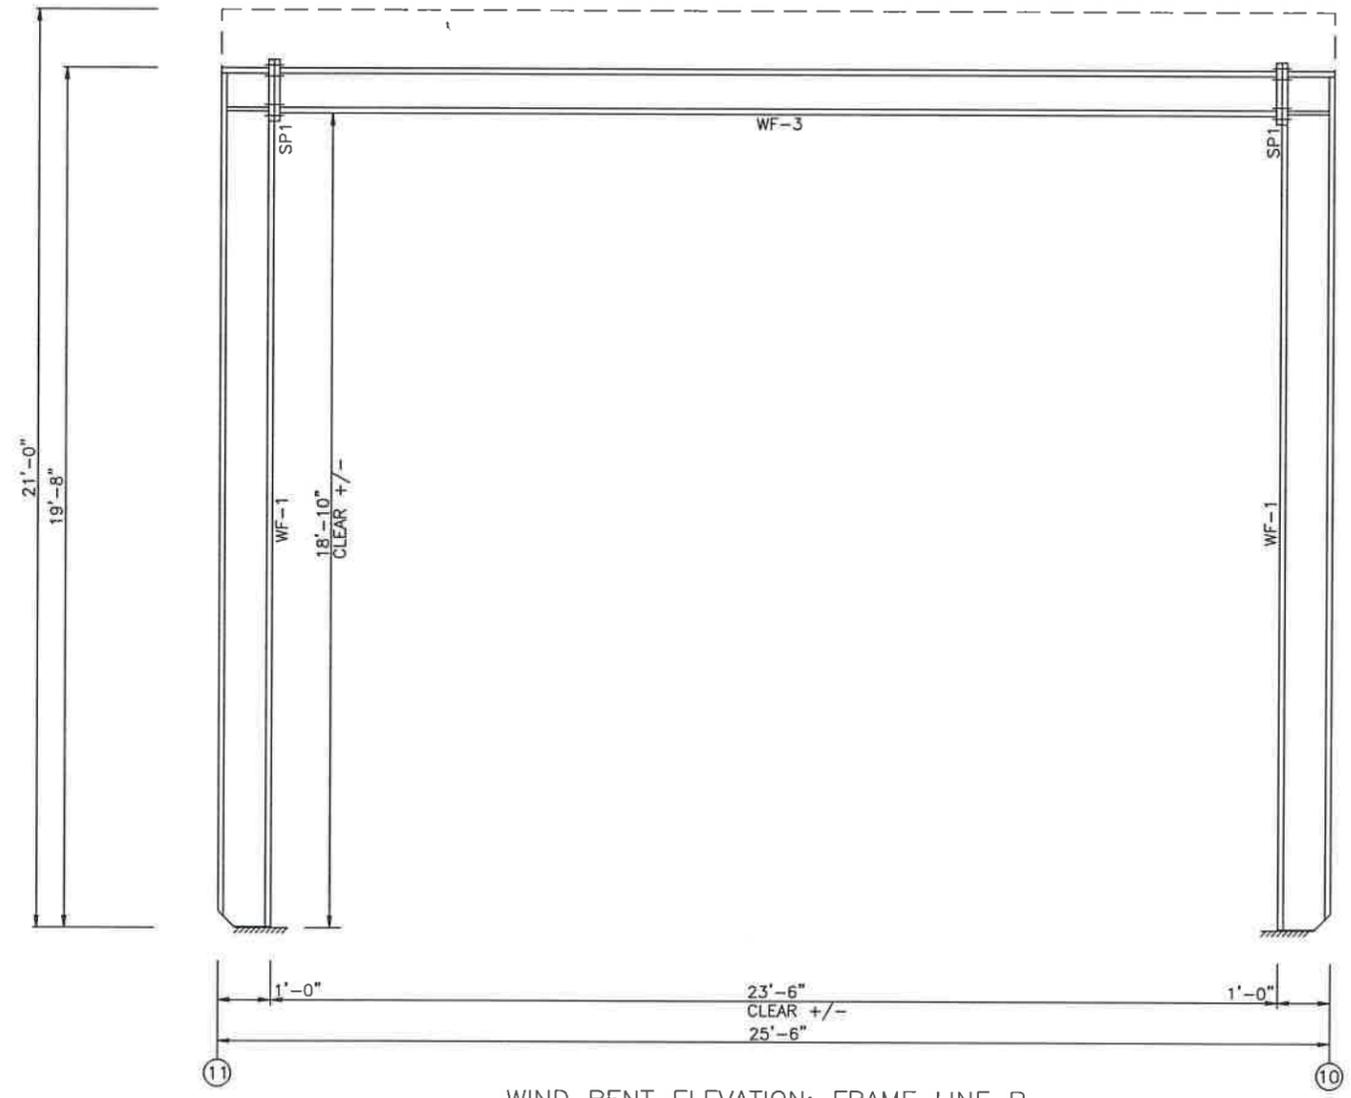


WIND BENT ELEVATION: FRAME LINE B

| | | | |
|---|-----------|---------------|-----------------------------|
| BLDG "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: | 9249R1 | DATE: | 10/13/25 |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: | PAGE 2.14 | DRAWN BY: DJH | CHECKED BY: SPW SCALE: NONE |

| SPLICE BOLTS | | | | |
|--------------|------|-----|-----------|--------|
| Splice Mark | Quan | | Bolt | |
| | Top | Bot | Type | Length |
| SP1 | 4 | 4 | A325 3/4" | 2 1/2" |


| MEMBER SIZE TABLE | | |
|-------------------|--------|---------|
| MARK | MEMBER | LENGTH |
| WF-2 | B10651 | 22'-11" |
| WF-1 | B12641 | 19'-8" |

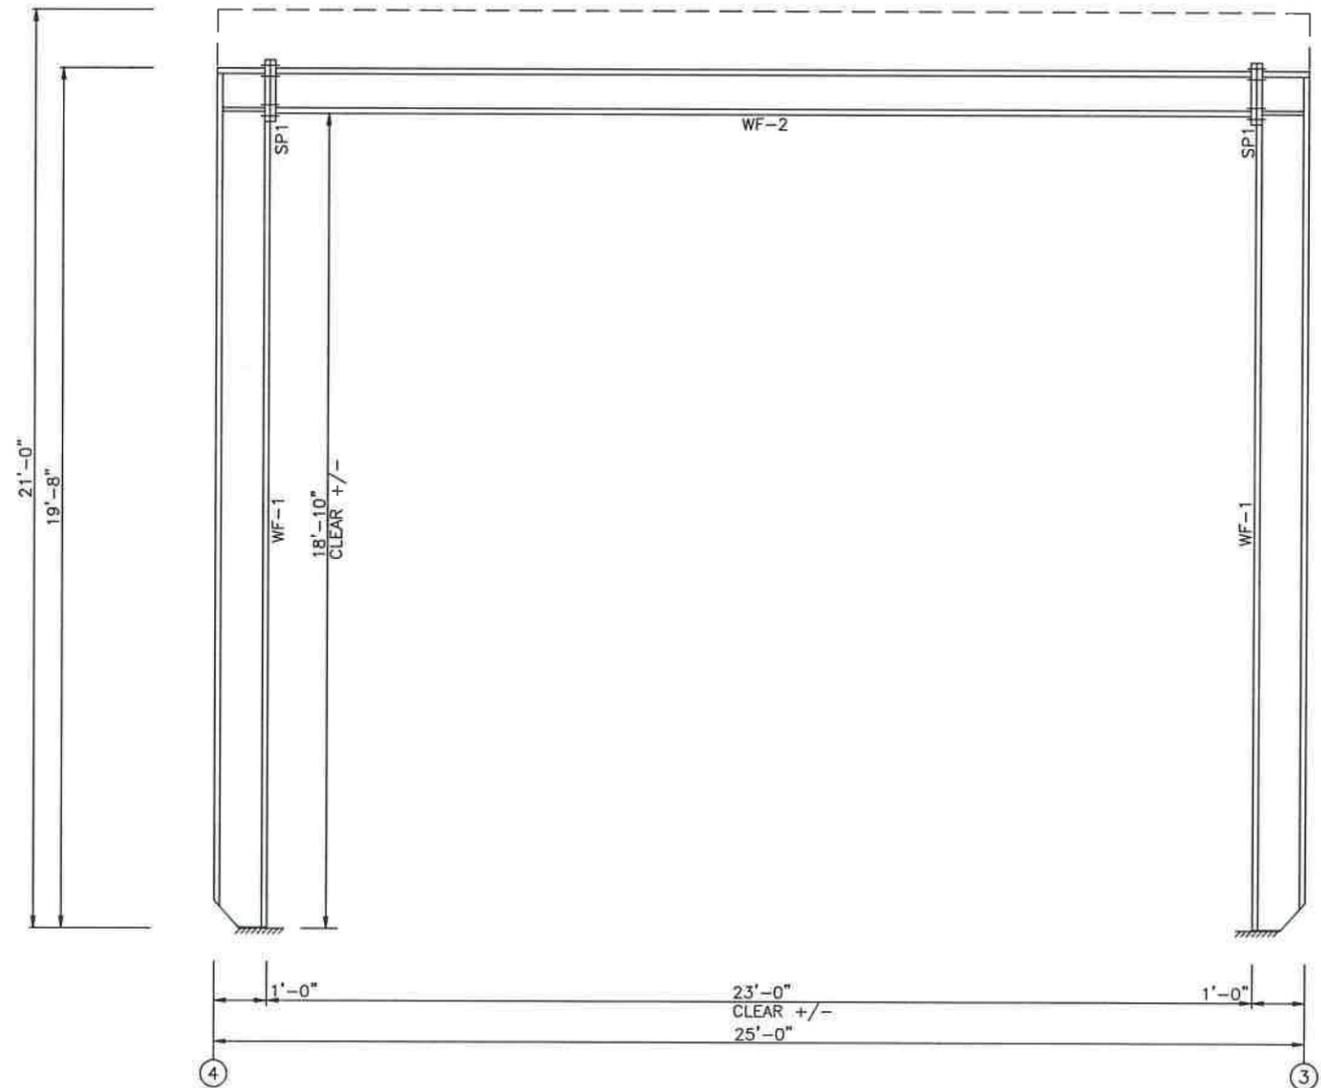


WIND BENT ELEVATION: FRAME LINE B

| | | | |
|--|-------------------|--------------------|----------------|
| BLDG "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: RIGID FRAME CROSS SECTION | | | |
| DRAWING NO: PAGE 2.15 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| TRIM TABLE | | | |
|--------------|-------------|-----------|--------|
| FRAME LINE 1 | | | |
| ID | PART | LENGTH | DETAIL |
| 2 | RAKE TRIM | 15'-8" | RAKE2 |
| 3 | RST8 | 15'-11" | RAKE2 |
| 4 | PEAK BOX | 1'-6" | |
| 5 | RID END CAP | 1'-9 1/2" | |

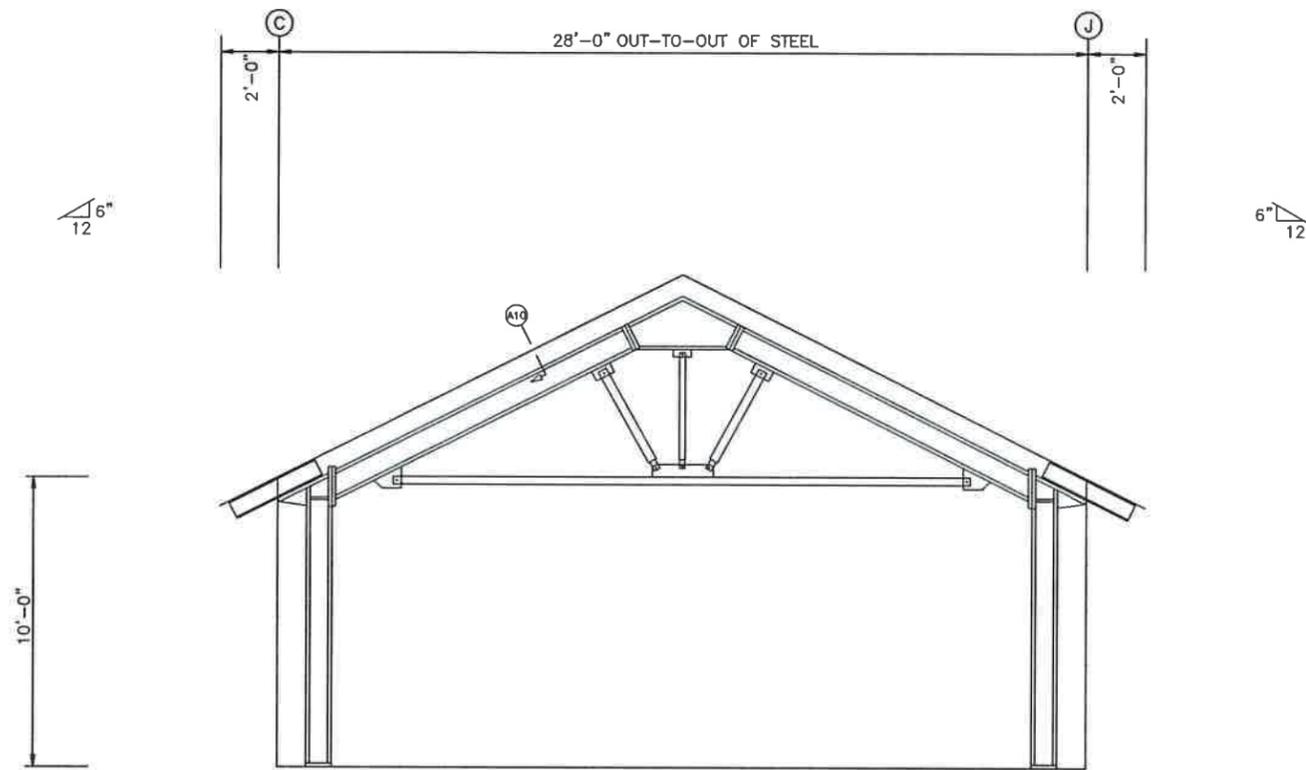



ENDWALL FRAMING: FRAME LINE 1

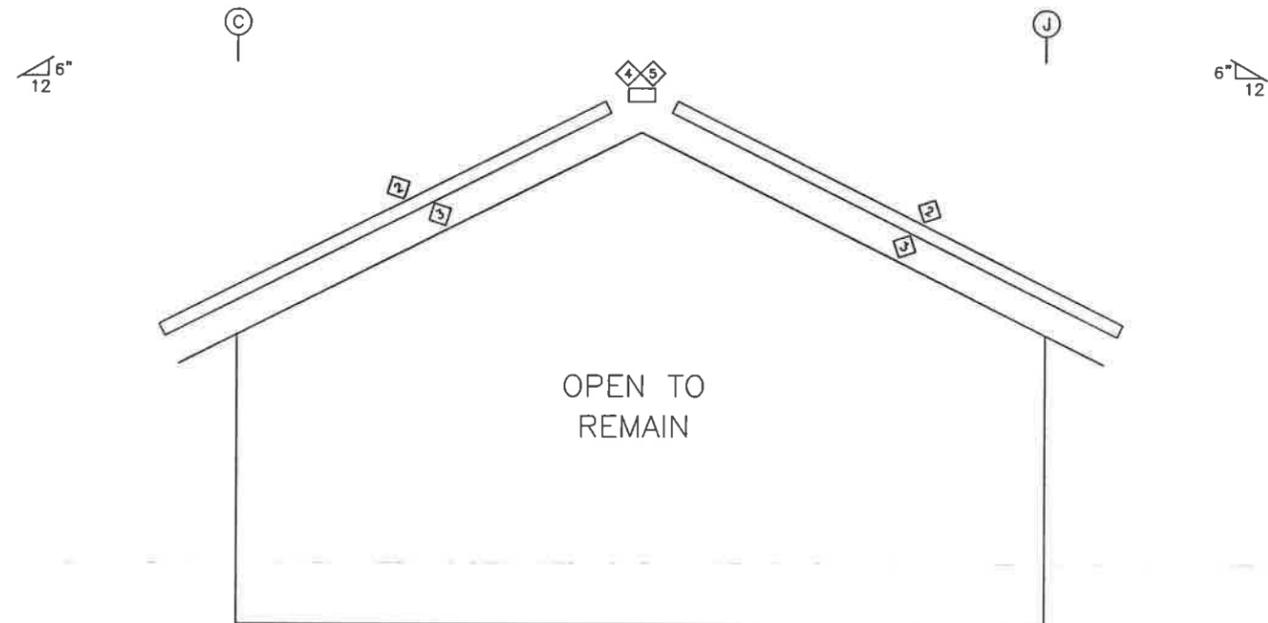

ENDWALL TRIM: FRAME LINE 1



NOTE: THE FRAMING AS DEPICTED ABOVE IS NOT DESIGNED TO ACCOMMODATE ANY FUTURE EXPANSION.

| BUILDING "D" | | | |
|--|-------------------|--------------------|----------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ENDWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 3.0 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

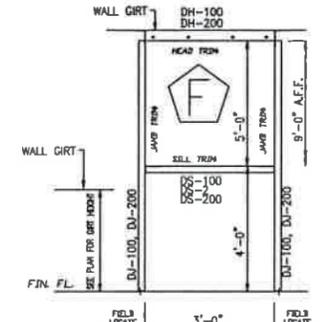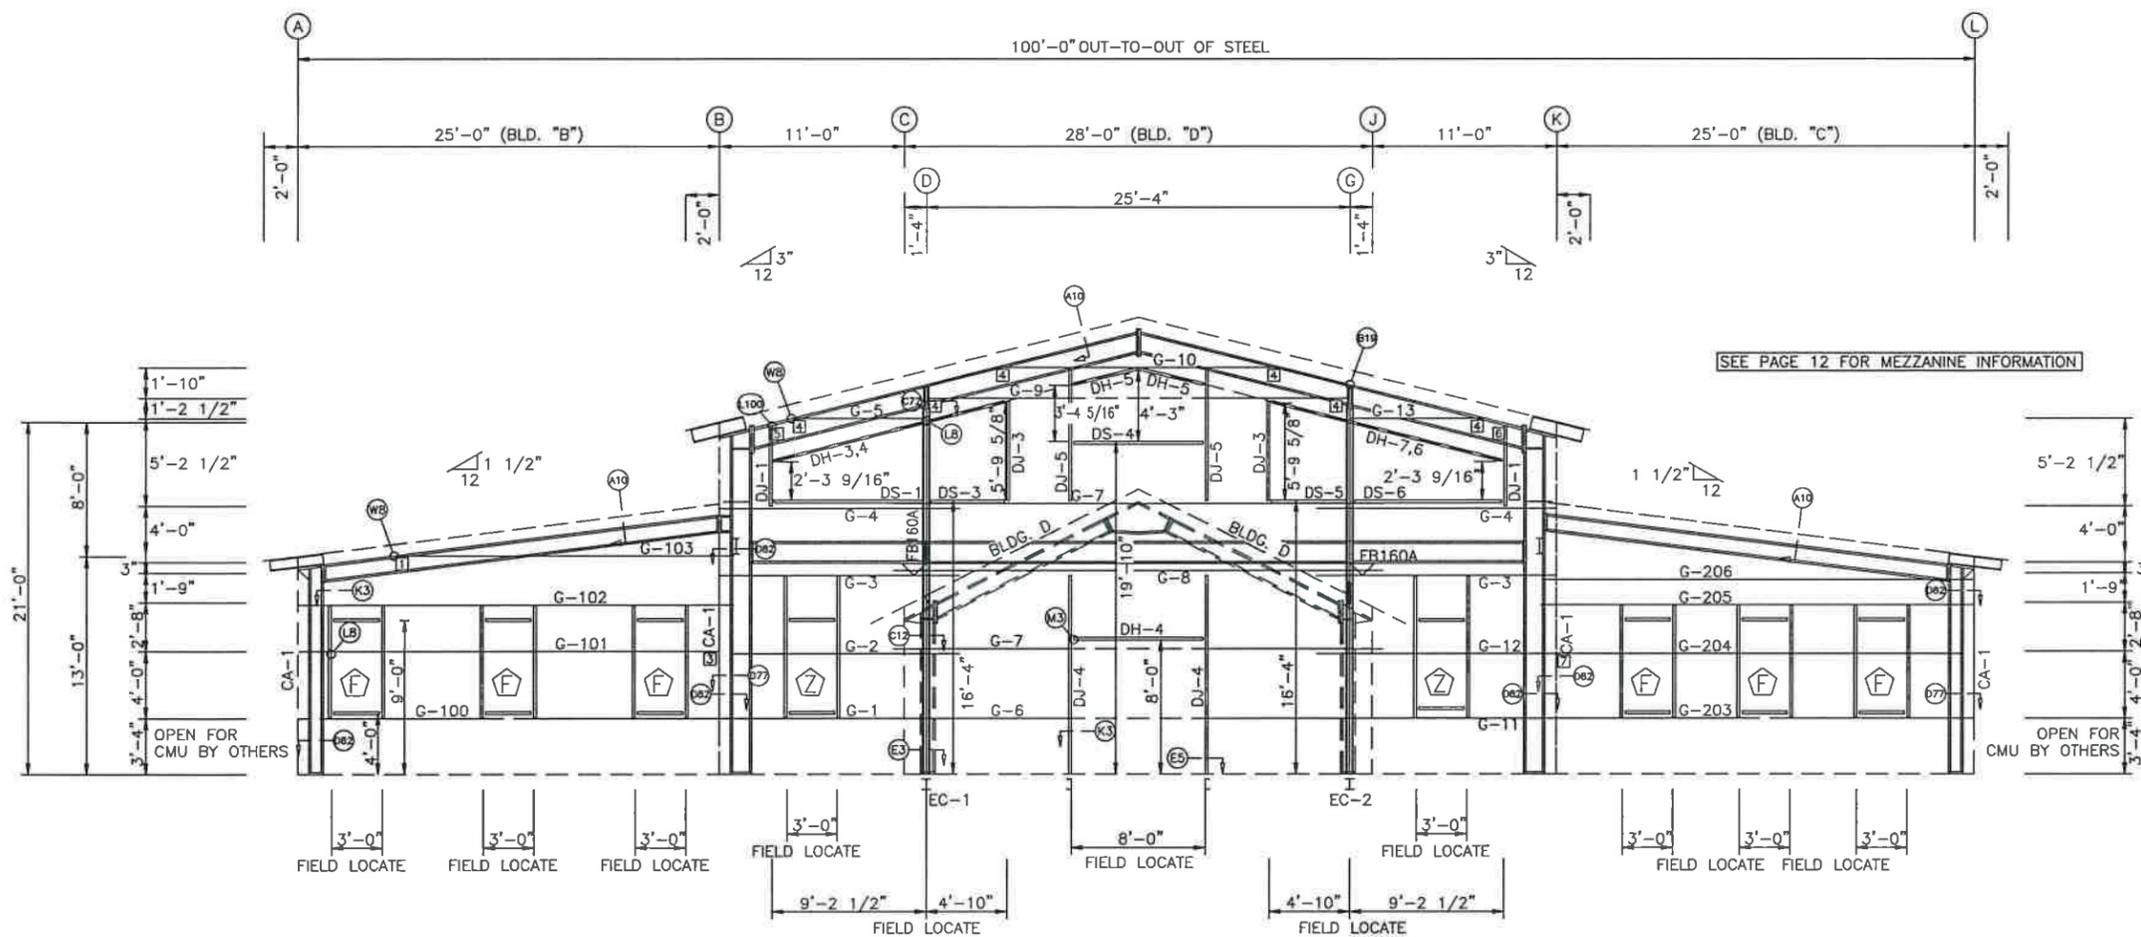


| BOLT TABLE | | | |
|--------------|------|------|---------|
| FRAME LINE 2 | | | |
| LOCATION | QUAN | TYPE | DIA |
| 9249R1-A | | | |
| Columns/Raf | 4 | A325 | 5/8" 2" |

| TRIM TABLE | | | |
|--------------|-----------|---------|---------|
| FRAME LINE 2 | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | DBLBASTR | 12'-9" | TRIM_22 |
| 2 | R HEAD | 12'-11" | A10M |
| 3 | DBLBASTR | 16'-11" | TRIM_22 |
| 4 | R HEAD | 13'-2" | A10M |
| 5 | 7.2 JAMB | 5'-3" | 7.2 WDJ |
| 6 | HEAD DRIP | 3'-3" | 7.2 HDD |
| 7 | 7.2 HEAD | 3'-3" | 7.2 SDD |
| 8 | 7.2 JAMB | 4'-11" | 7.2 WDJ |
| 9 | HEAD DRIP | 8'-3" | 7.2 HDD |
| 10 | 7.2 JAMB | 2'-7" | 7.2 WDJ |
| 11 | 7.2 JAMB | 6'-1" | 7.2 WDJ |
| 12 | 7.2 HEAD | 14'-4" | 7.2 SDD |
| 13 | HEAD DRIP | 14'-9" | 7.2 HDD |
| 14 | 7.2 JAMB | 3'-8" | 7.2 WDJ |
| 15 | 7.2 HEAD | 4'-5" | 7.2 SDD |
| 16 | 7.2 HEAD | 8'-3" | 7.2 SDD |

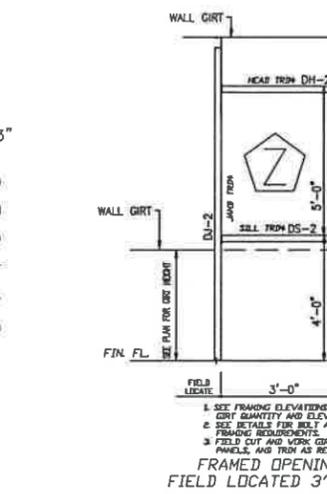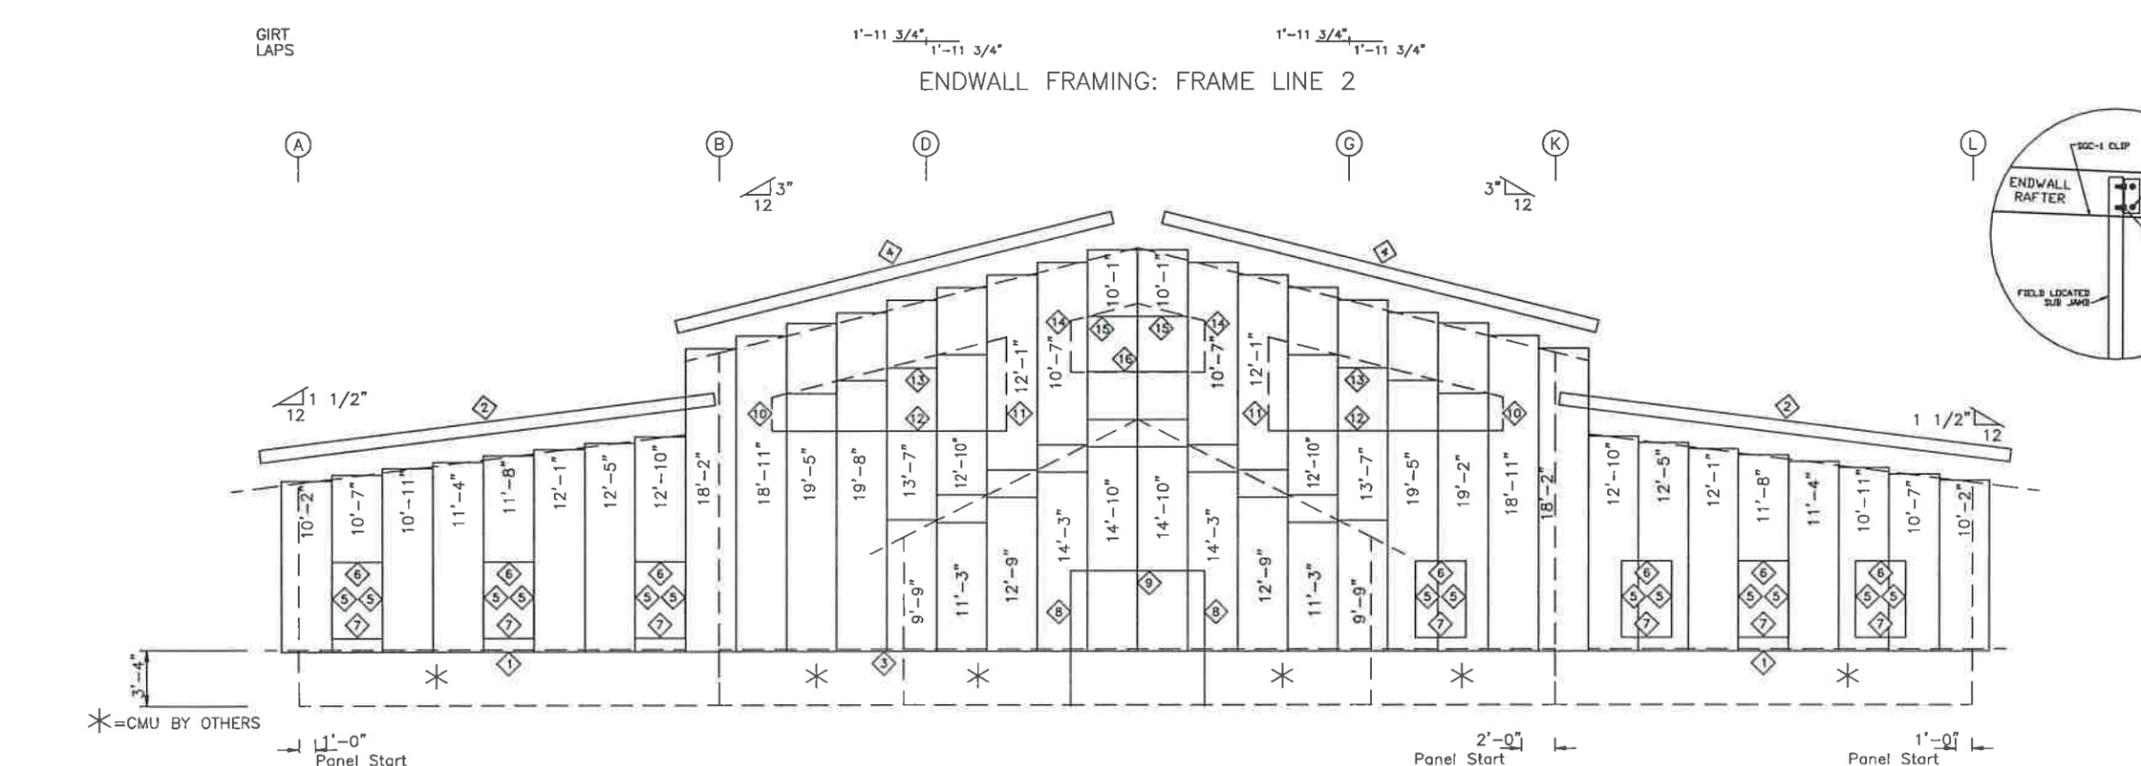

| MEMBER TABLE | | | |
|--------------|----------|-------------|--|
| FRAME LINE 2 | | | |
| MARK | PART | LENGTH | |
| 9249-A | | | |
| EC-1 | W8X18 | 22'-2 5/16" | |
| EC-2 | W8X18 | 22'-2 5/16" | |
| DJ-1 | 8X25C16 | 5'-2 1/2" | |
| DJ-2 | 8X25C16 | 6'-8" | |
| DJ-3 | 8X25C16 | 6'-5" | |
| DJ-4 | 8X25C16 | 12'-0" | |
| DJ-5 | 8X25C16 | 8'-3" | |
| DH-1 | 8.3.5CH6 | 9'-4 3/4" | |
| DH-2 | 8X25C16 | 3'-0" | |
| DH-3 | 8.3.5CH6 | 5'-0 1/4" | |
| DH-4 | 8X25C16 | 8'-0" | |
| DH-5 | 8.3.5CH6 | 8'-0" | |
| DH-6 | 8.3.5CH6 | 5'-0 1/4" | |
| DH-7 | 8.3.5CH6 | 9'-4 3/4" | |
| DS-1 | 8.3.5CH6 | 9'-4 3/4" | |
| DS-2 | 8X25C16 | 3'-0" | |
| DS-3 | 8.3.5CH6 | 5'-0 1/4" | |
| DS-4 | 8.3.5CH6 | 8'-0" | |
| DS-5 | 8.3.5CH6 | 5'-0 1/4" | |
| DS-6 | 8.3.5CH6 | 9'-4 3/4" | |
| G-1 | 8X25C16 | 11'-7 1/2" | |
| G-2 | 8X25Z16 | 13'-7 1/2" | |
| G-3 | 8X25Z12 | 14'-3 1/2" | |
| G-4 | 8X25Z14 | 14'-3 1/2" | |
| G-5 | 8X25Z16 | 8'-0 1/2" | |
| G-6 | 8X25C16 | 25'-3 1/2" | |
| G-7 | 8X25Z16 | 29'-3 1/2" | |
| G-8 | 8X25Z12 | 29'-3 1/2" | |
| G-9 | 8X25Z16 | 25'-4" | |
| G-10 | 8X25Z14 | 17'-1 1/2" | |
| G-11 | 8X25C16 | 12'-3 1/2" | |
| G-12 | 8X25Z16 | 14'-3 1/2" | |
| G-13 | 8X25Z16 | 8'-0 1/2" | |
| 9249-B | | | |
| DJ-100 | 8X25C16 | 6'-8" | |
| DH-100 | 8X25C16 | 3'-0" | |
| DS-100 | 8X25C16 | 3'-0" | |
| G-100 | 8X25C16 | 24'-11 3/4" | |
| G-101 | 8X7DC14 | 24'-11 3/4" | |
| G-102 | 8X25Z12 | 26'-3 1/2" | |
| G-103 | 8X25Z16 | 19'-6 3/16" | |
| 9249-C | | | |
| DJ-200 | 8X25C16 | 6'-8" | |
| DH-200 | 8X25C16 | 3'-0" | |
| DS-200 | 8X25C16 | 3'-0" | |
| G-203 | 8X25C16 | 24'-3 3/4" | |
| G-204 | 8X25C16 | 24'-3 3/4" | |
| G-205 | 8X25Z16 | 26'-3 1/2" | |
| G-206 | 8X25Z12 | 26'-3 1/2" | |

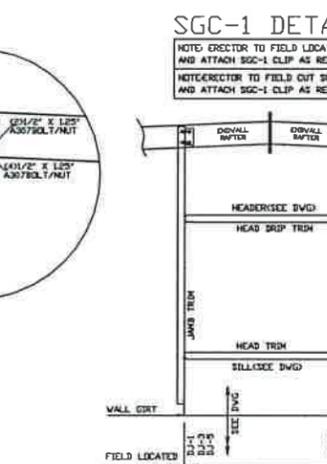

FIELD LOCATED 4'-10" X 5'-9 5/8"
 FIELD LOCATED 9'-2 1/2" X 5'-6 5/8"
 FIELD LOCATED 8'-0" X 4'-3"

ALL VEHICULAR FRAMED OPENINGS SUPPLIED ON THIS PROJECT HAVE BEEN DESIGNED TO SUPPORT WIND LOADS NORMAL TO A DOOR SYSTEM, BASED ON THE STANDARD BUILDING CODE CRITERIA. THE VEHICULAR FRAMED OPENING HAS NOT BEEN DESIGNED FOR ANY ADDITIONAL MOMENT OR CATENARY FORCE FROM THE DOOR SYSTEM. ANY CHANGES TO THE INFORMATION SHOWN HERE WOULD REQUIRE AN ENGINEERING INVESTIGATION AND POSSIBLE BUILDING REINFORCEMENT.

ENDWALL SHEETING & TRIM: FRAME LINE 2
 PANELS: 26 Ga. 7.2 - NEED COLOR


| BUILDING "A" | | | |
|--------------|-----|-----|------|
| ISSUE | DET | CHK | DATE |
| | | | |
| | | | |

| BUILDINGS AND MORE | | | |
|--------------------|-----------------------------------|-----------|----------|
| CUSTOMER: | PINNACLE SITE SOLUTIONS | | |
| JOB NO: | 9249R1 | DATE: | 10/13/25 |
| LOCATION: | HIGH SPRINGS, FL 32643 | | |
| DRAWING NAME: | ENDWALL FRAMING & SHEETING LAYOUT | | |
| DRAWING NO: | PAGE 3.1 | DRAWN BY: | SPW |
| CHECKED BY: | | SCALE: | NONE |


| TRIM TABLE FRAME LINE 5 | | | |
|----------------------------|----------|---------|---------|
| ID | PART | LENGTH | DETAIL |
| 1 | O/S CORN | 9'-10" | TRIM_5 |
| 2 | DBLBASTR | 12'-9" | TRIM_22 |
| 3 | R HEAD | 12'-11" | A10M |
| 5 | RAKE | 12'-9" | RAKE2 |

| MEMBER TABLE FRAME LINE 5 | | |
|------------------------------|---------|-------------|
| MARK | PART | LENGTH |
| 9249R1-C | | |
| G-200 | 8x25C16 | 24'-3 1/2" |
| G-201 | 8x25Z12 | 24'-3 1/2" |
| G-202 | 8x25Z12 | 24'-11 1/2" |

| CONNECTION PLATES FRAME LINE 5 | |
|-----------------------------------|-----------|
| ID | MARK/PART |
| 1 | CGC-3 |

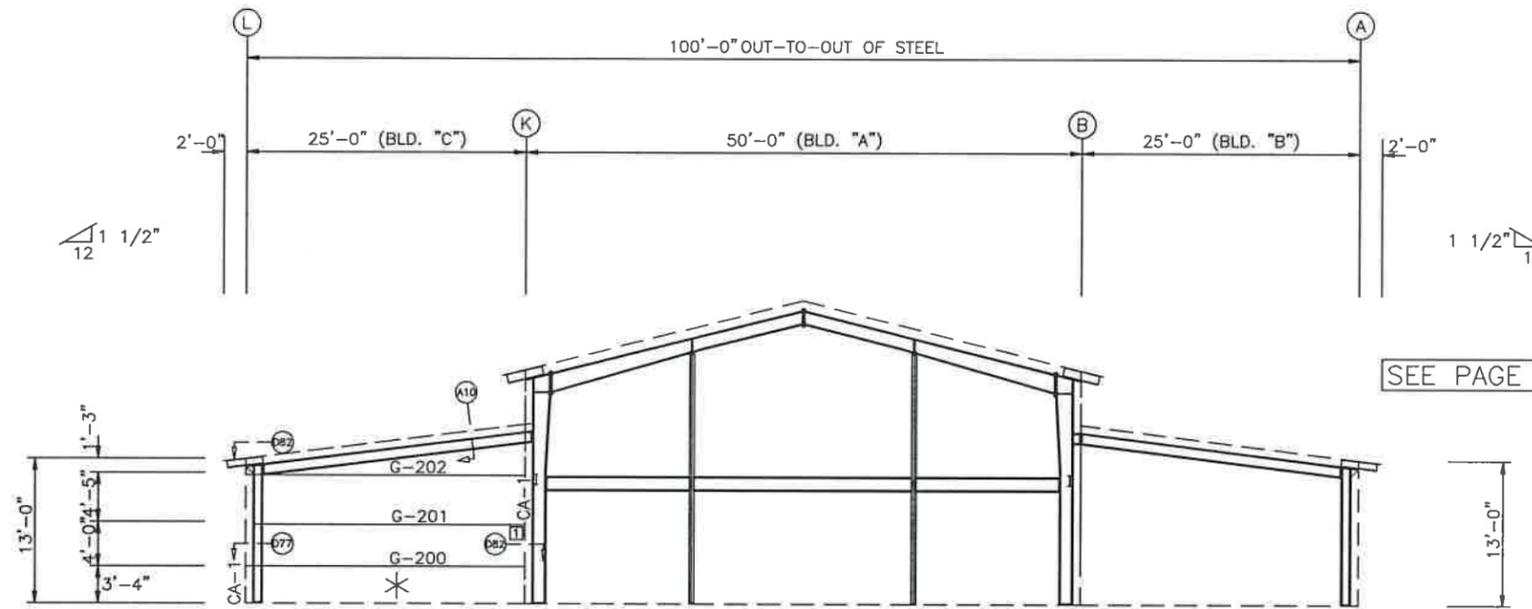


ENDWALL FRAMING: FRAME LINE 5

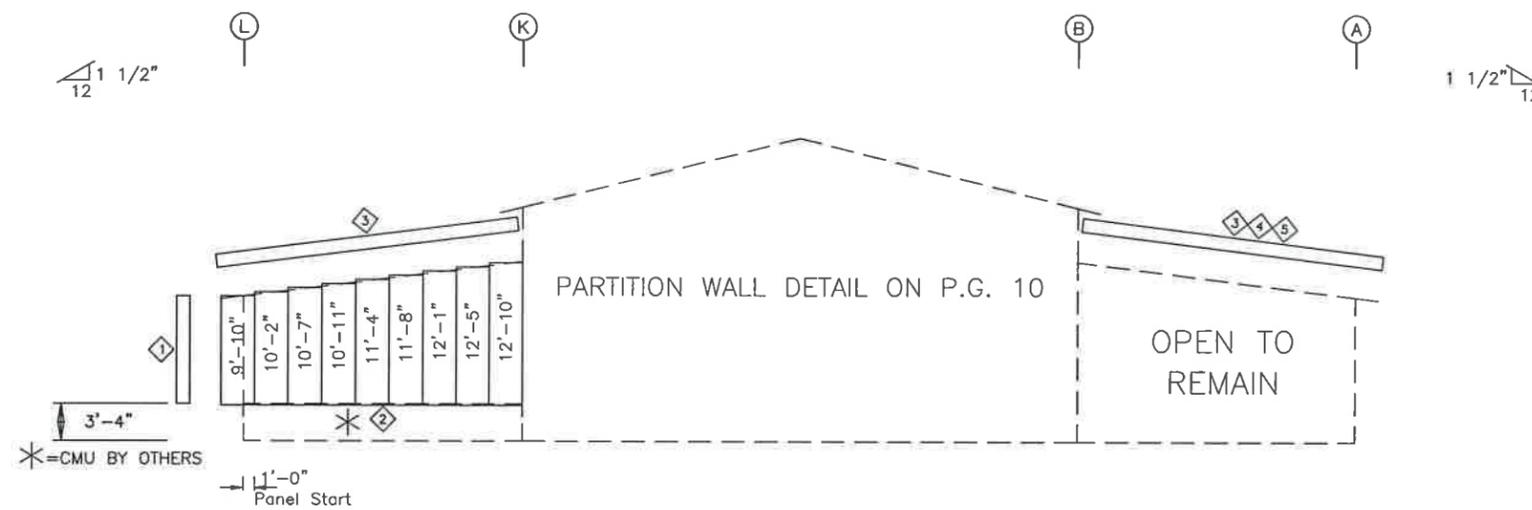


ENDWALL SHEETING & TRIM: FRAME LINE 5
PANELS: 26 Ga. R - NEED COLOR

| BUILDING "A" | | | |
|---|----------------|-----------------|-------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ENDWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 3.2 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| TRIM TABLE | | | |
|--------------|----------|--------|--------|
| FRAME LINE 2 | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | RAKE TRM | 12'-9" | RAKE1 |
| 2 | PEAK BOX | 1'-0" | |

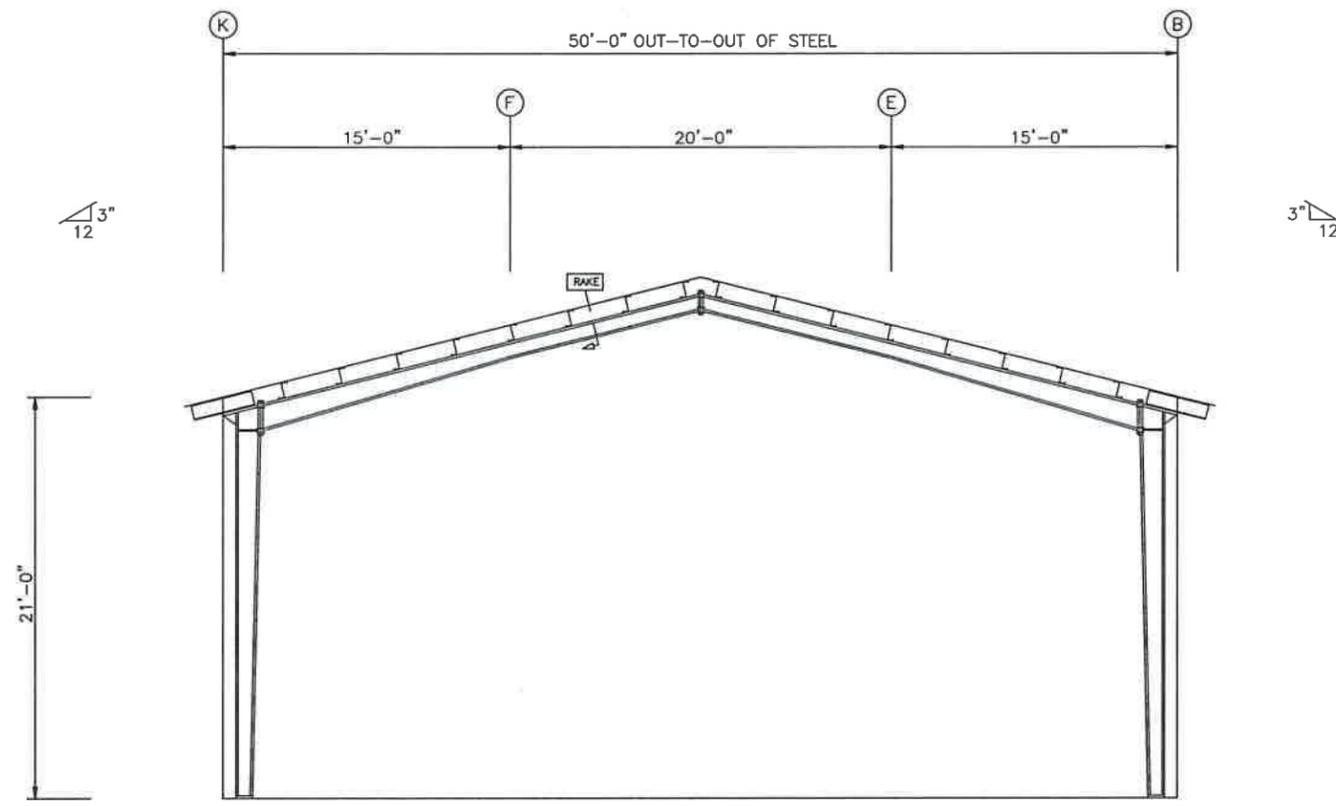

ENDWALL FRAMING: FRAME LINE 12

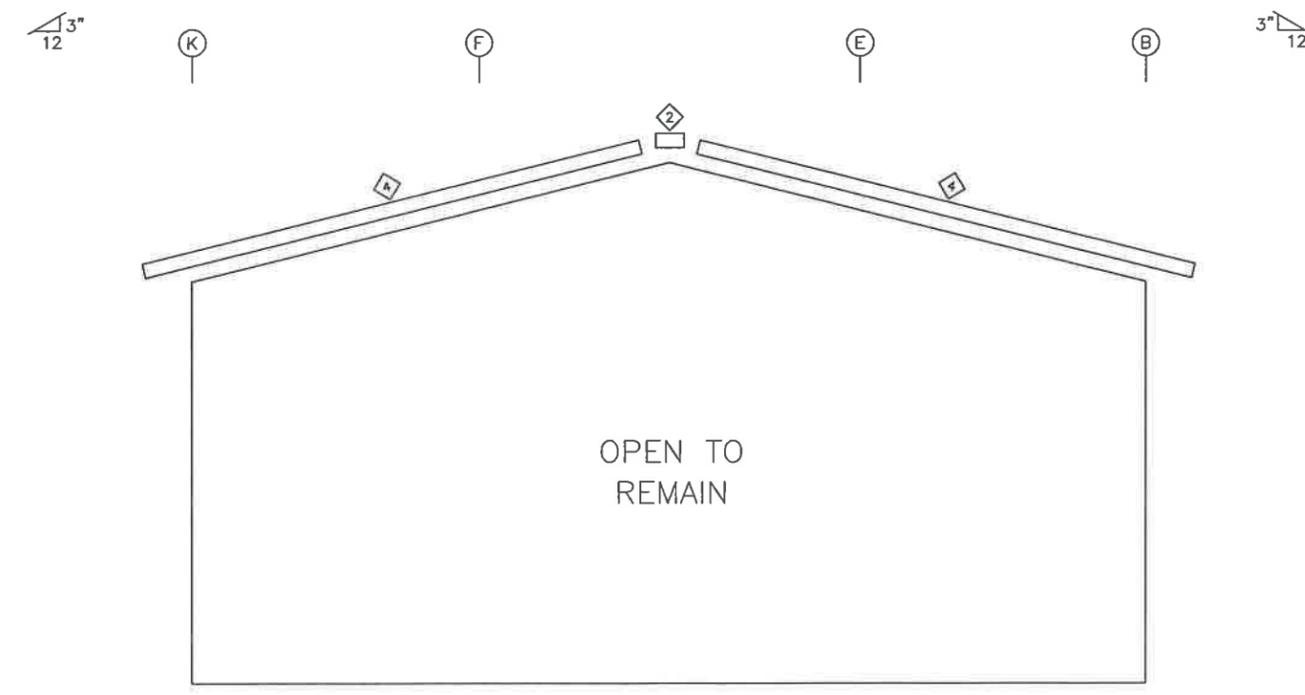


ENDWALL TRIM: FRAME LINE 12


| BUILDING "A" | | | |
|---|----------------|-----------------|-------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ENDWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 3.4 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

| BOLT TABLE | | | | |
|------------------|------|------|------|--------|
| FRAME LINE A | | | | |
| LOCATION | QUAN | TYPE | DIA | LENGTH |
| WF-100 - WF-101 | 8 | A325 | 5/8" | 2" |
| WF-100 - RF2-100 | 6 | A325 | 5/8" | 2" |

| MEMBER TABLE | | |
|--------------|--------|-------------|
| FRAME LINE A | | |
| MARK | PART | LENGTH |
| WF-100 | B12541 | 11'-8" |
| WF-101 | B10651 | 22'-11 3/4" |

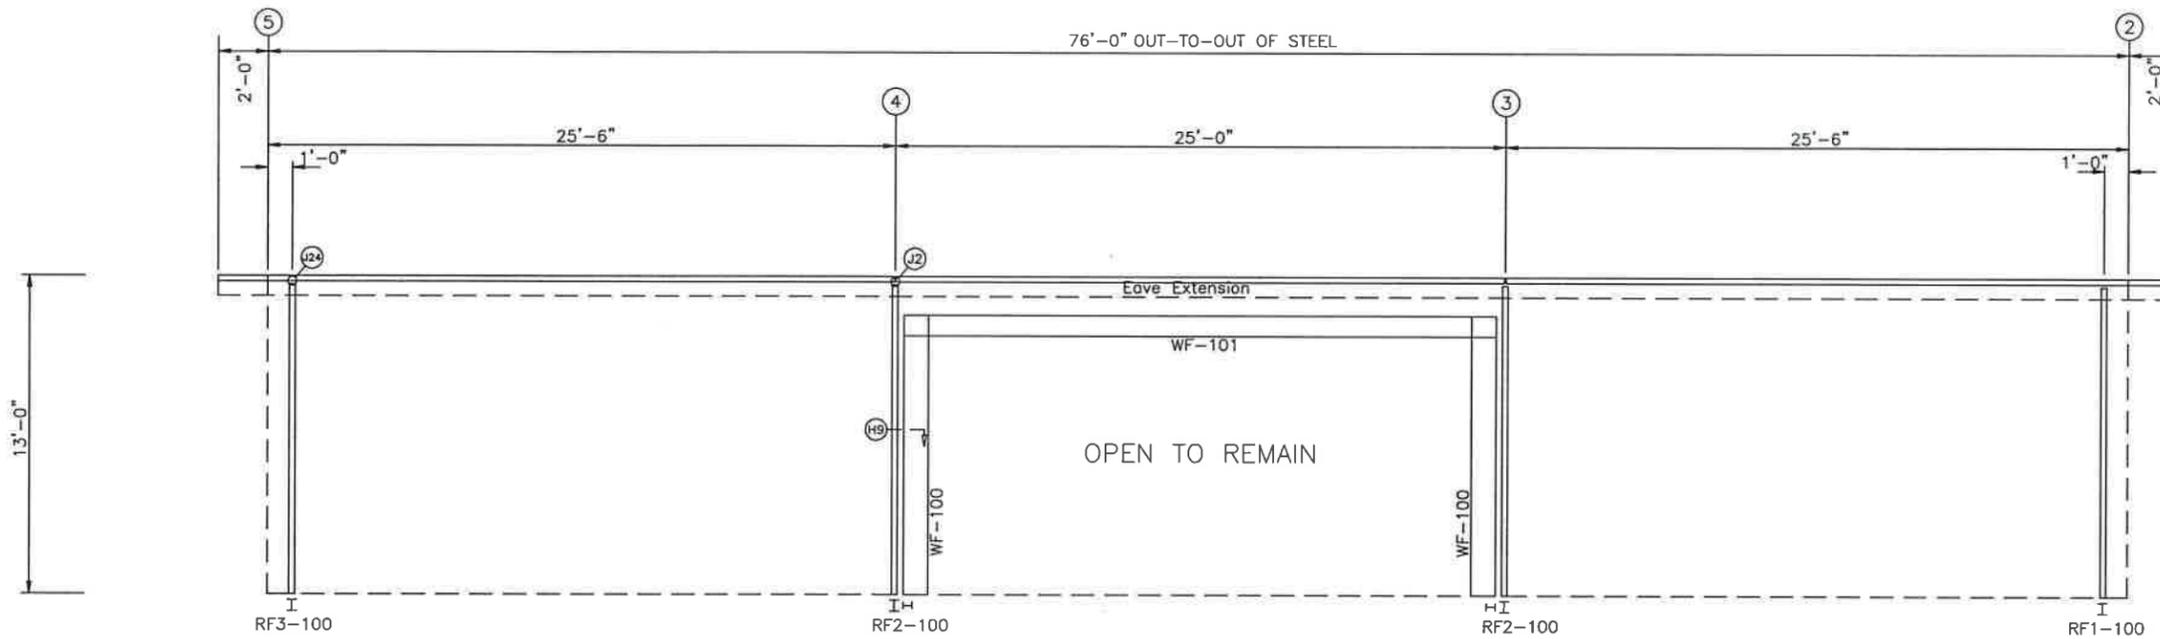

SIDEWALL FRAMING: FRAME LINE A

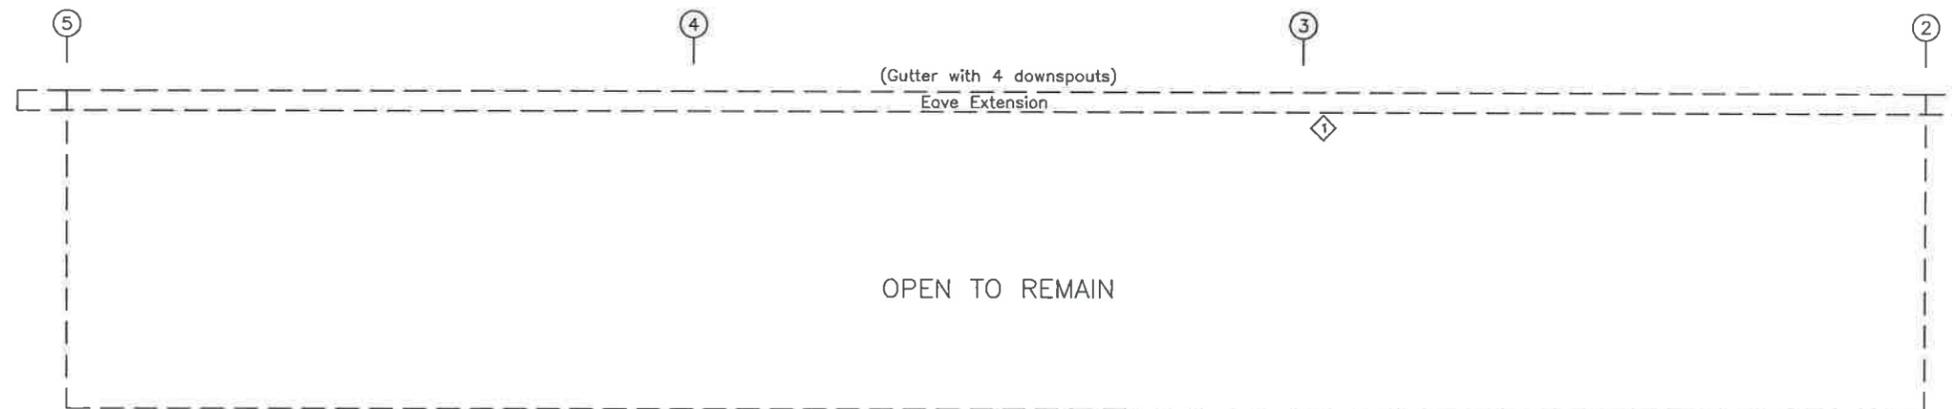


SIDEWALL TRIM: FRAME LINE A

| | | | |
|--|----------------|-----------------|-------------|
| BUILDING "B" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 4 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |


| BOLT TABLE | | | | |
|--------------|------|------|------|--------|
| FRAME LINE B | | | | |
| LOCATION | QUAN | TYPE | DIA | LENGTH |
| WF-1 - WF-3 | 8 | A325 | 3/4" | 2 1/2" |
| WF-1 - RF6-1 | 4 | A325 | 5/8" | 2" |
| WF-1 - RF5-4 | 4 | A325 | 5/8" | 2" |
| WF-1 - WF-2 | 8 | A325 | 3/4" | 2 1/2" |
| WF-1 - RF2-1 | 4 | A325 | 5/8" | 2" |

| TRIM TABLE | | | |
|--------------|----------|--------|---------|
| FRAME LINE B | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | R JAMB | 3'-7" | TRIM_8 |
| 2 | DBLBASTR | 18'-2" | TRIM_22 |
| 3 | DBLBASTR | 2'-3" | TRIM_22 |
| 4 | DBLBASTR | 16'-6" | TRIM_22 |
| 7 | R JAMB | 4'-3" | TRIM_8 |
| 8 | R HEAD | 4'-3" | TRIM_61 |
| 9 | R HEAD | 4'-3" | TRIM_7 |
| 10 | R JAMB | 4'-11" | TRIM_8 |
| 11 | R HEAD | 8'-3" | TRIM_61 |
| 12 | R JAMB | 2'-3" | TRIM_8 |
| 13 | R HEAD | 20'-3" | TRIM_61 |
| 14 | R HEAD | 20'-3" | TRIM_7 |
| 15 | R JAMB | 4'-1" | TRIM_8 |
| 16 | R HEAD | 3'-7" | TRIM_61 |
| 17 | R JAMB | 3'-3" | TRIM_8 |
| 18 | R HEAD | 3'-3" | TRIM_61 |
| 19 | R HEAD | 3'-3" | TRIM_7 |
| 20 | STEP F | 19'-0" | TRIM_65 |

| MEMBER TABLE | | |
|--------------|----------|-------------|
| FRAME LINE B | | |
| MARK | PART | LENGTH |
| WF-1 | B12641 | 19'-8" |
| WF-2 | B10651 | 22'-11" |
| DJ-12 | 8X25C16 | 4'-3" |
| DJ-13 | 8X25C16 | 10'-0" |
| DJ-14 | 8X25C16 | 2'-7 1/2" |
| DJ-15 | 8X25C16 | 10'-0" |
| DJ-16 | 8X25C16 | 10'-5" |
| DH-2 | 8.3.5CH6 | 3'-0" |
| DH-4 | 8X25C16 | 8'-0" |
| DH-9 | 8X25C16 | 3'-4" |
| DS-2 | 8.3.5CH6 | 3'-0" |
| DS-8 | 8.3.5CH6 | 4'-0" |
| DS-9 | 8.3.5CH6 | 20'-0" |
| G-22 | 8x25Z16 | 28'-5 1/2" |
| G-23 | 8x25C16 | 25'-5 1/2" |
| G-24 | 8x25Z16 | 30'-11 1/2" |
| G-25 | 8x25C16 | 24'-11 1/2" |
| G-26 | 8x25Z16 | 27'-9 1/2" |
| G-27 | 8x25C16 | 24'-5 1/2" |
| G-48 | 8x25Z14 | 30'-11 1/2" |
| G-50 | 8x25Z12 | 27'-9 1/2" |
| G-51 | 8x25C12 | 24'-5 1/2" |
| G-52 | 8x25C16 | 1'-7 1/2" |
| G-53 | 8x25Z16 | 1'-11 1/2" |
| G-54 | 8X7DC14 | 24'-5 1/2" |
| G-55 | 8x25C16 | 14'-1 1/2" |
| G-56 | 8x25Z14 | 17'-1 1/2" |
| G-57 | 8x25C14 | 24'-11 1/2" |
| G-58 | 8x25C16 | 25'-5 1/2" |
| G-59 | 8x25Z12 | 28'-5 1/2" |
| G-60 | 8x25Z14 | 28'-5 1/2" |

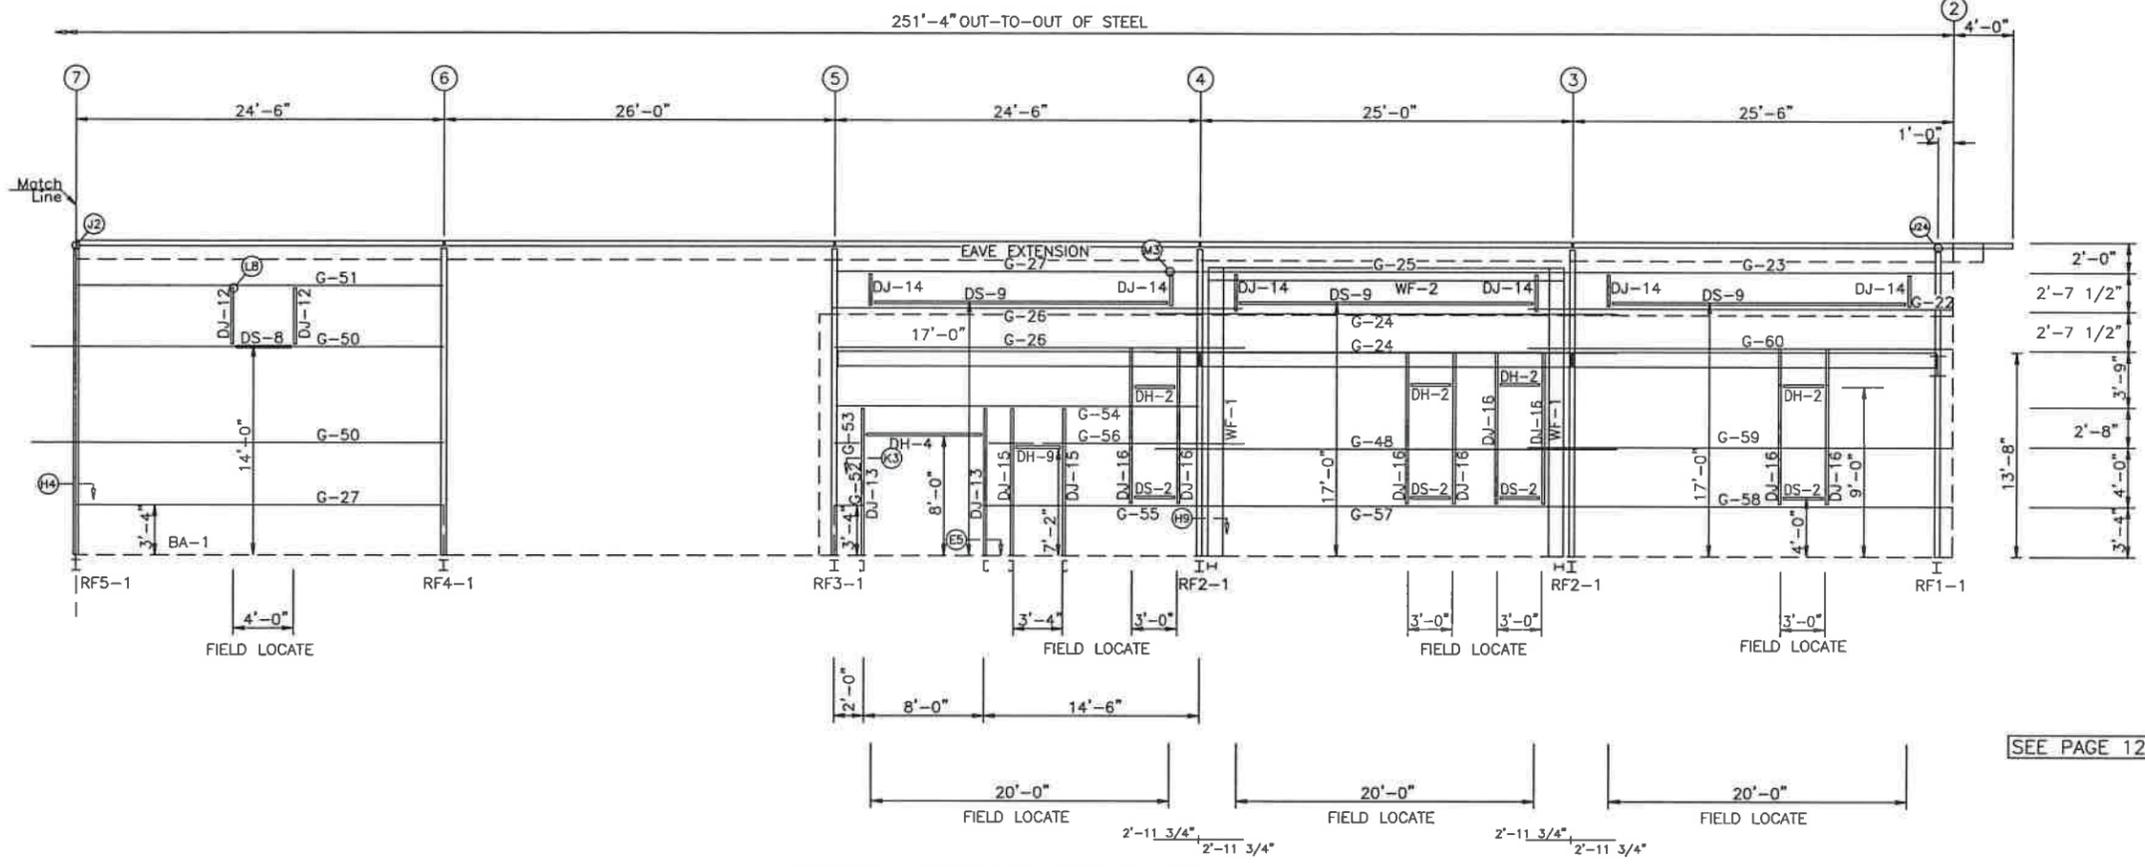

SIDEWALL FRAMING: FRAME LINE B

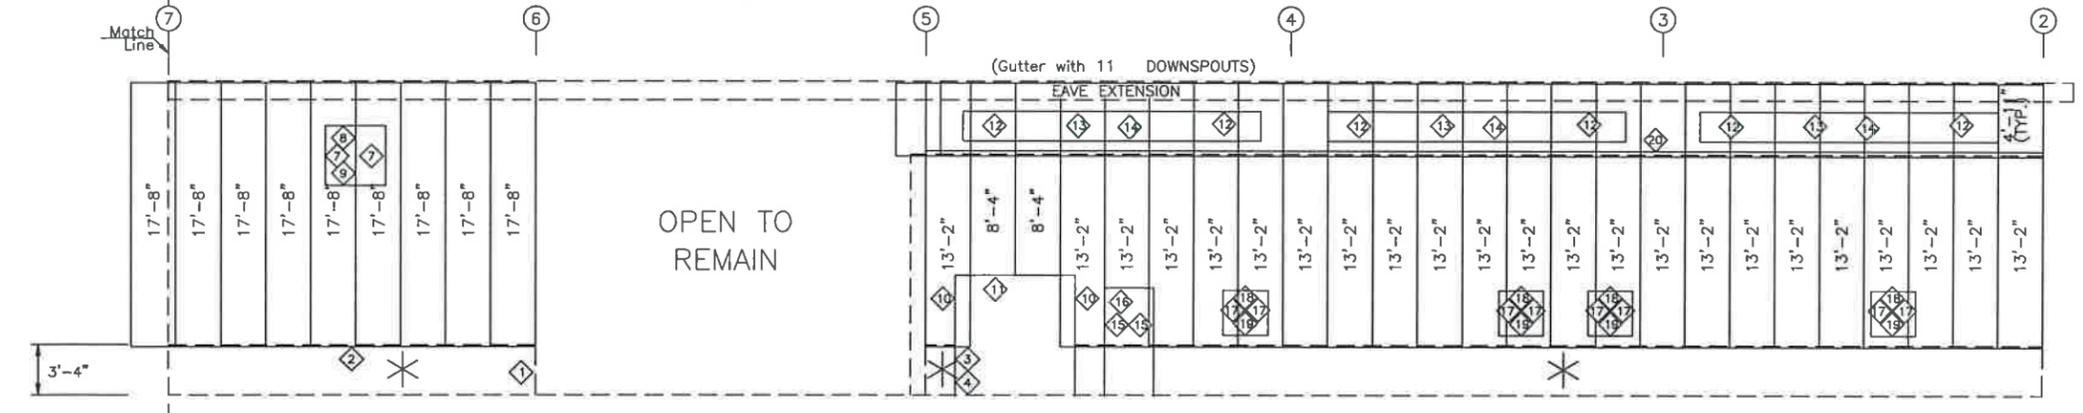

SIDEWALL SHEETING & TRIM: FRAME LINE B

PANELS: 26 GA. PBR - COLOR
 (9249-B) PANELS: 26 GA. PBR - COLOR

*=CMU BY OTHERS


ALL VEHICULAR FRAMED OPENINGS SUPPLIED ON THIS PROJECT HAVE BEEN DESIGNED TO SUPPORT WIND LOADS NORMAL TO A DOOR SYSTEM, BASED ON THE STANDARD BUILDING CODE CRITERIA. THE VEHICULAR FRAMED OPENING HAS NOT BEEN DESIGNED FOR ANY ADDITIONAL MOMENT OR CATENARY FORCE FROM THE DOOR SYSTEM. ANY CHANGES TO THE INFORMATION SHOWN HERE WOULD REQUIRE AN ENGINEERING INVESTIGATION AND POSSIBLE BUILDING REINFORCEMENT.

| | | | |
|---|-------------------|--------------------|----------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 4.1 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |


| BOLT TABLE | | | | |
|--------------|------|------|------|--------|
| FRAME LINE B | | | | |
| LOCATION | QUAN | TYPE | DIA | LENGTH |
| WF-1 - WF-3 | 8 | A325 | 3/4" | 2 1/2" |
| WF-1 - RF6-1 | 4 | A325 | 5/8" | 2" |
| WF-1 - RF5-4 | 4 | A325 | 5/8" | 2" |
| WF-1 - WF-2 | 8 | A325 | 3/4" | 2 1/2" |
| WF-1 - RF2-1 | 4 | A325 | 5/8" | 2" |

| TRIM TABLE | | | |
|--------------|-----------|--------|---------|
| FRAME LINE B | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | DRIP BASE | 1'-3" | TRIM_16 |
| 2 | O/S CORN | 3'-6" | TRIM_5 |
| 3 | DBLBASTR | 18'-2" | TRIM_22 |
| 4 | R JAMB | 4'-3" | TRIM_8 |
| 5 | R HEAD | 4'-3" | TRIM_61 |
| 6 | R HEAD | 4'-3" | TRIM_7 |

| MEMBER TABLE | | |
|--------------|----------|-------------|
| FRAME LINE B | | |
| MARK | PART | LENGTH |
| WF-1 | B12641 | 19'-8" |
| WF-3 | B10651 | 23'-5" |
| DJ-12 | 8X25C16 | 4'-3" |
| DJ-99 | 8X25C16 | 7'-4" |
| DH-99 | 8X25C16 | 3'-4" |
| DS-8 | 8.3.5CH6 | 4'-0" |
| G-24 | 8x25Z16 | 30'-11 1/2" |
| G-25 | 8x25C16 | 24'-11 1/2" |
| G-45 | 8x25C14 | 26'-5 1/2" |
| G-46 | 8x25Z12 | 29'-5 1/2" |
| G-47 | 8x25C12 | 26'-5 1/2" |
| G-48 | 8x25Z14 | 30'-11 1/2" |
| G-49 | 8x25C12 | 24'-11 1/2" |

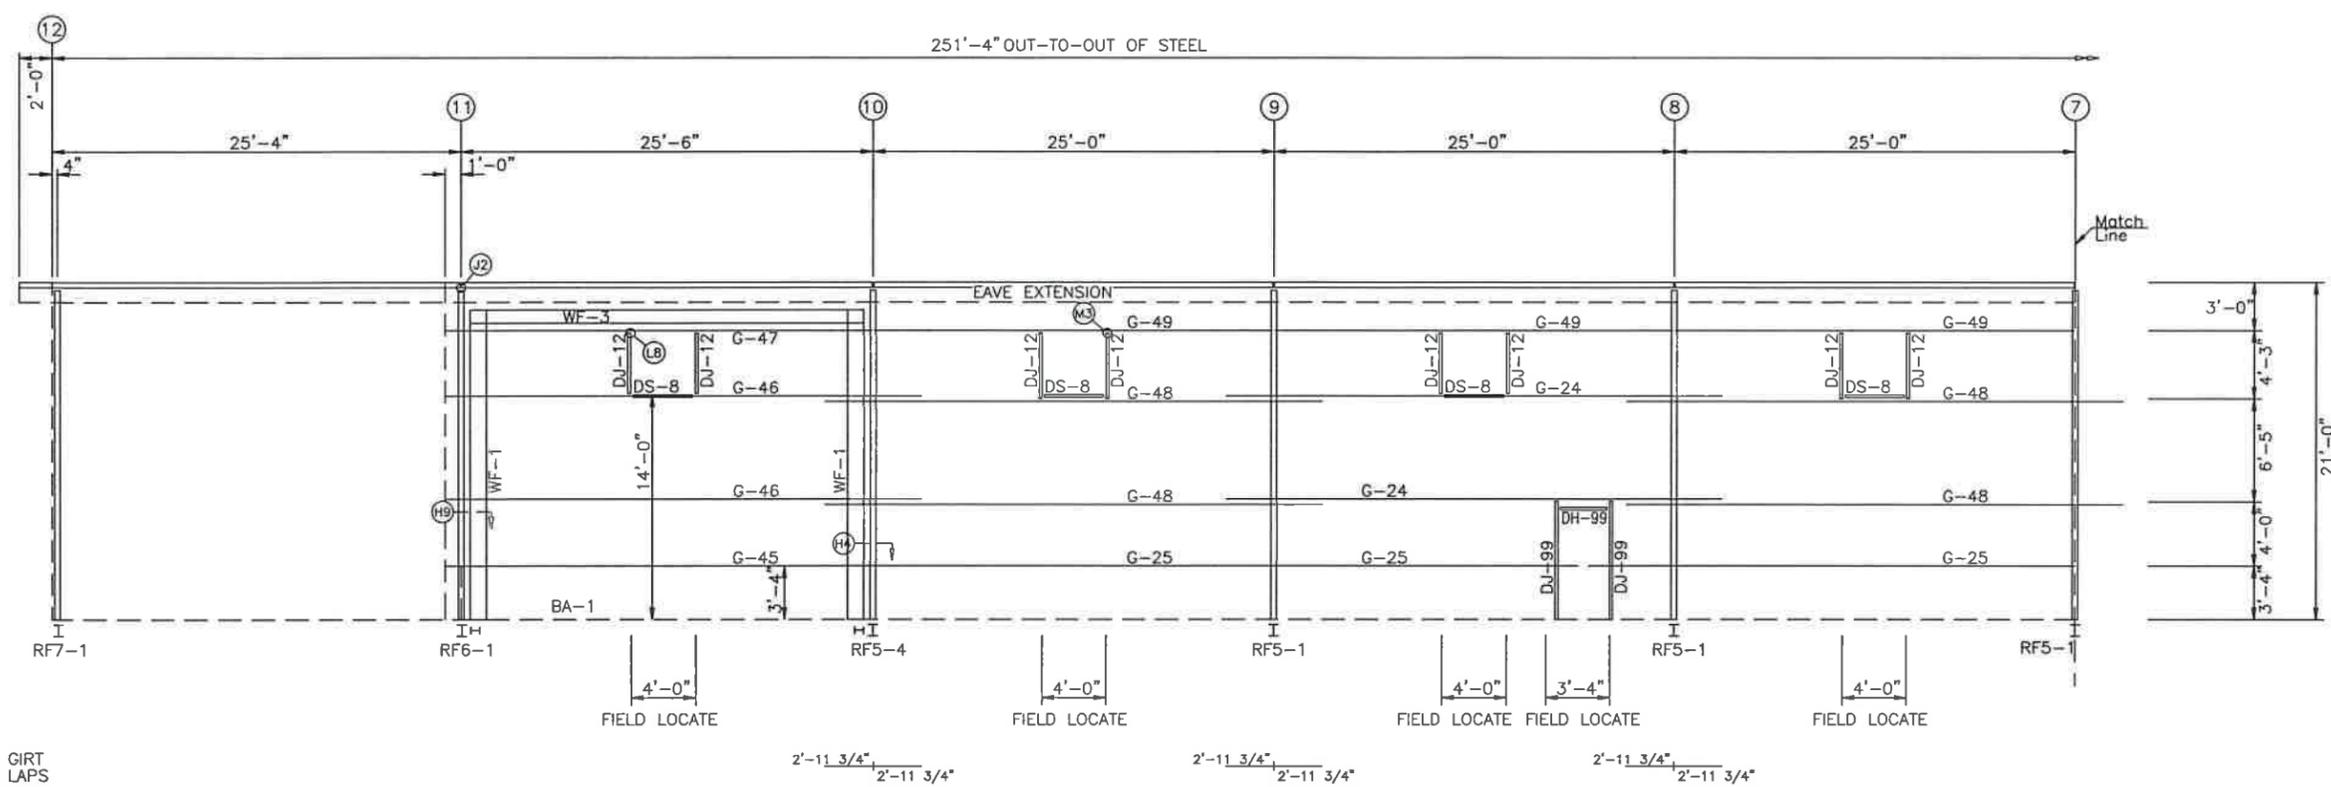


SIDEWALL FRAMING: FRAME LINE B

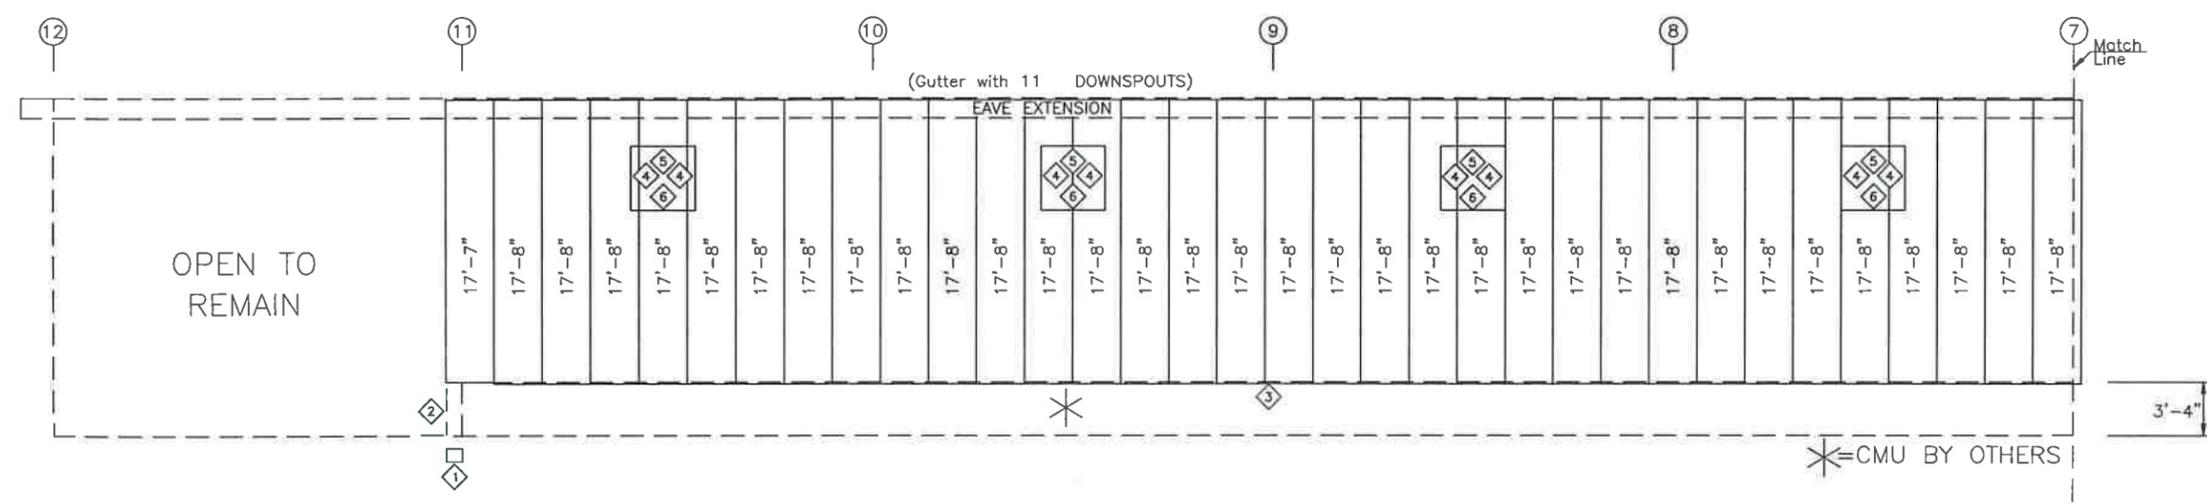


SIDEWALL SHEETING & TRIM: FRAME LINE B

PANELS: 26 GA. PBR - COLOR
(9249-B) PANELS: 26 GA. PBR - COLOR

| BUILDING "A" | | | |
|---|-------------------|--------------------|----------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 4.2 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

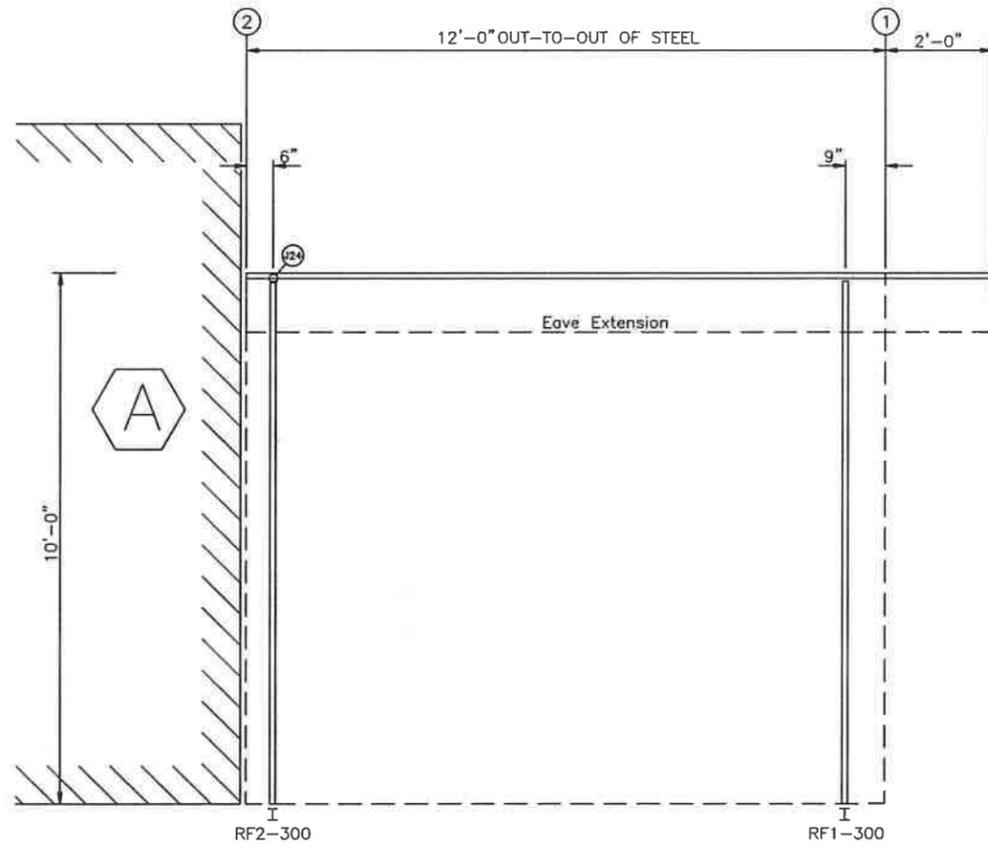


SIDEWALL FRAMING: FRAME LINE C

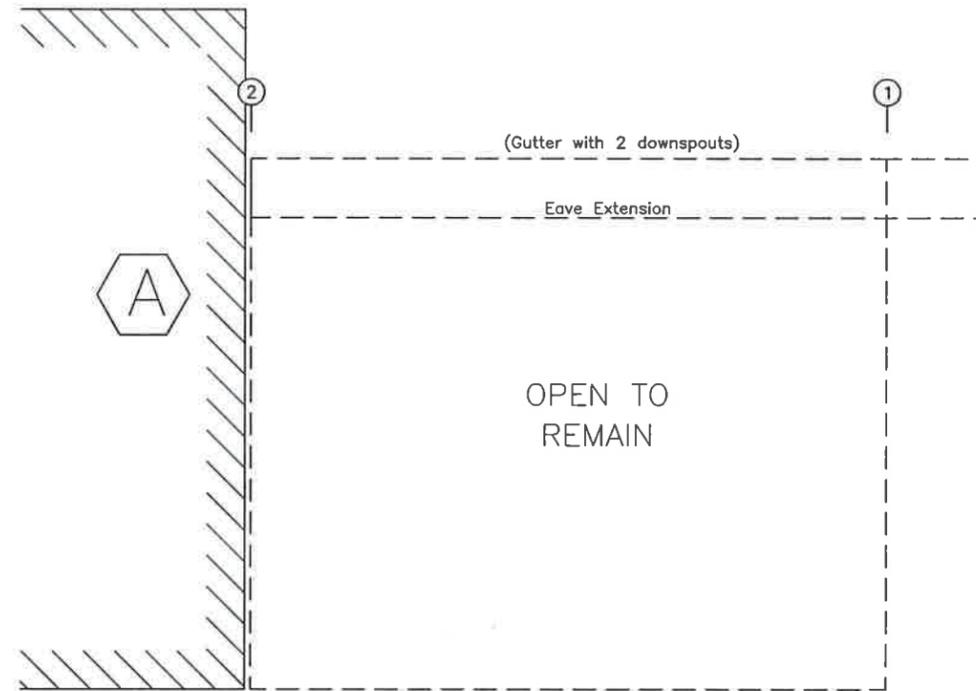


SIDEWALL TRIM: FRAME LINE C

| BUILDING "D" | | | |
|---|-------------------|--------------------|----------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 4.3 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

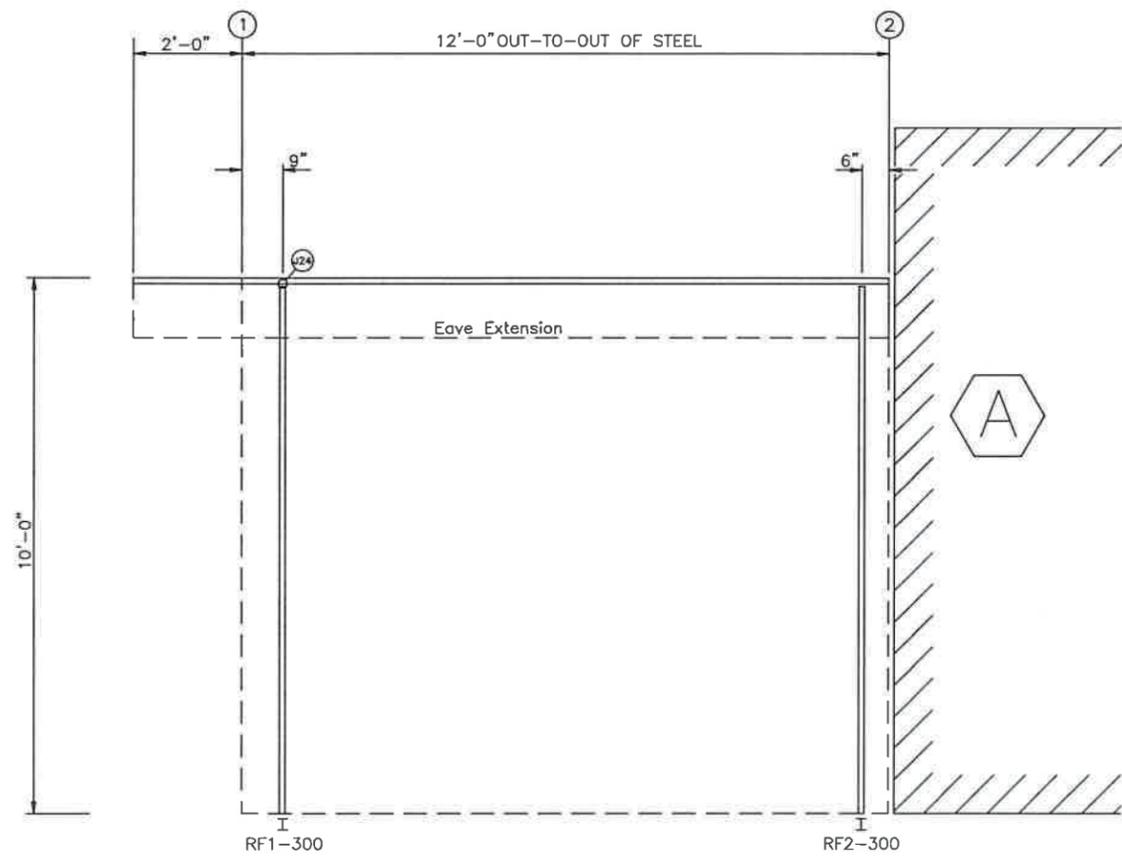


SIDEWALL FRAMING: FRAME LINE J

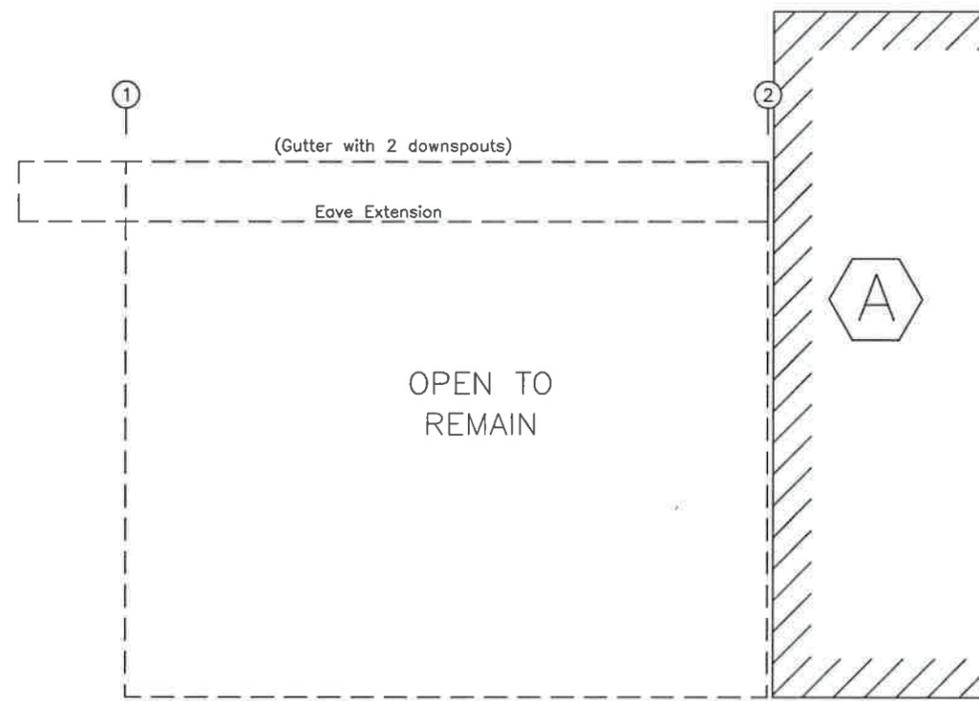


SIDEWALL TRIM: FRAME LINE J

| | | | |
|---|-------------------|--------------------|----------------|
| BUILDING "D" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 4.4 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

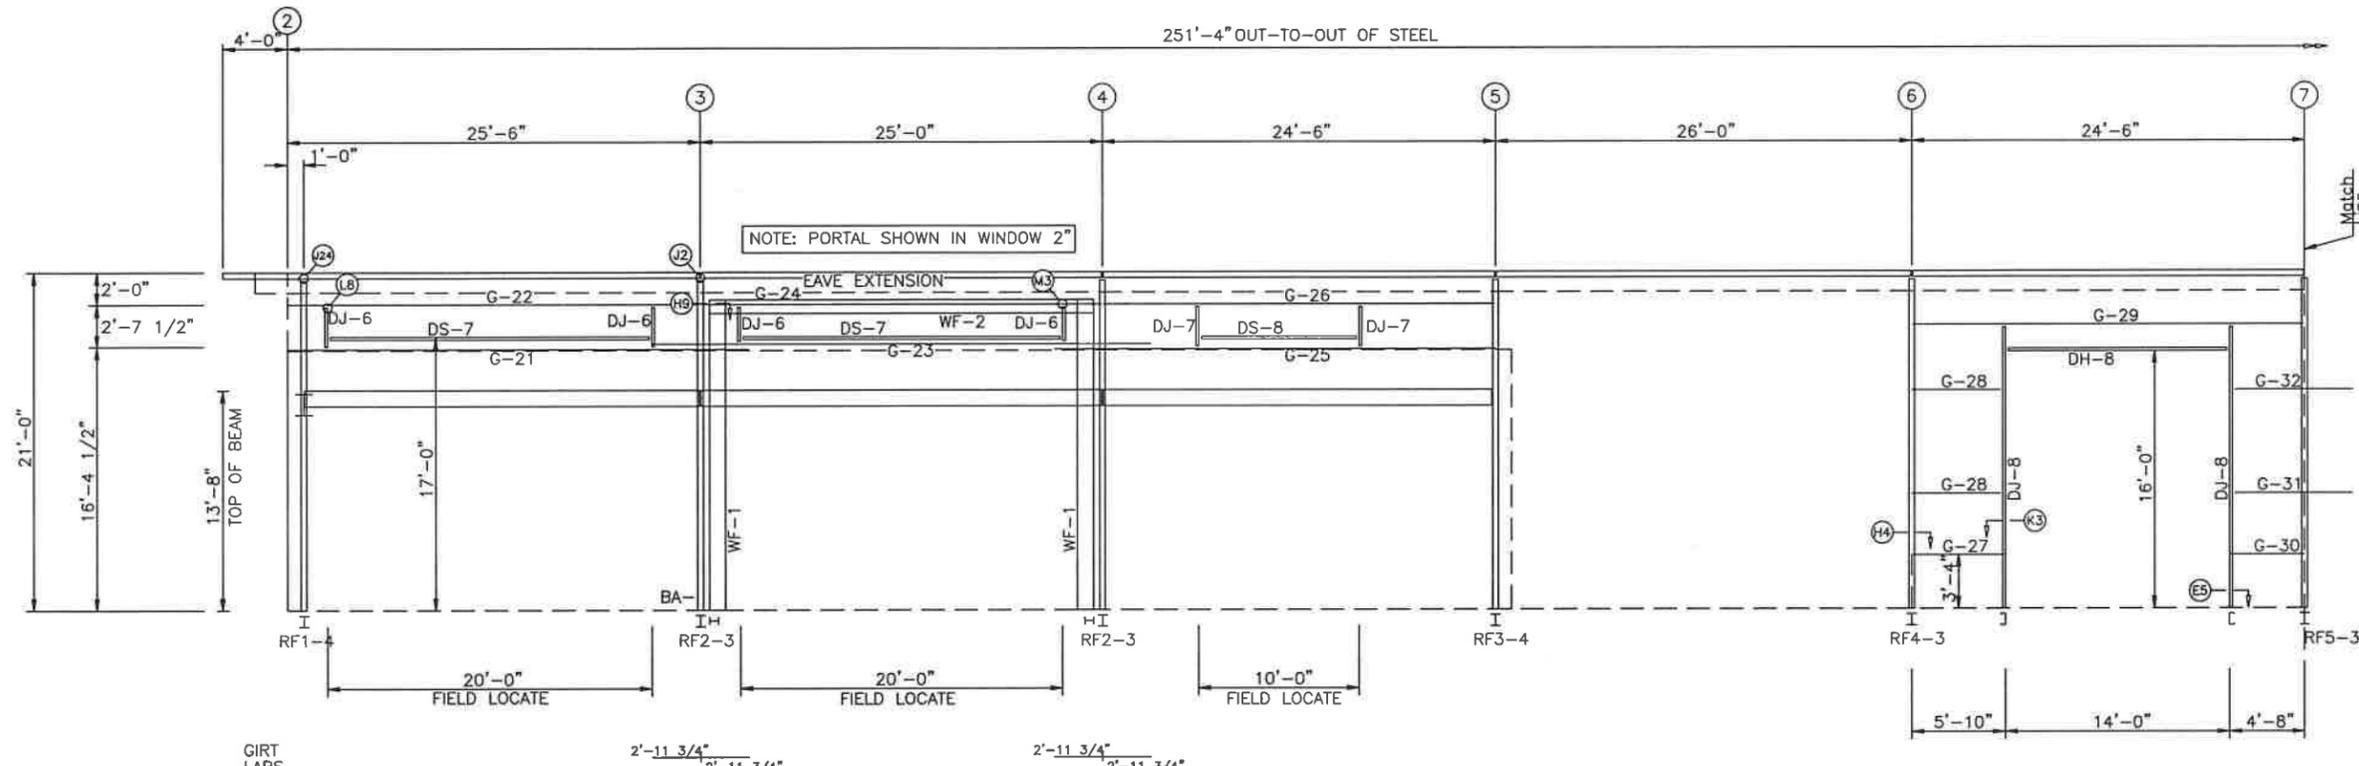

SIDEWALL FRAMING: FRAME LINE K

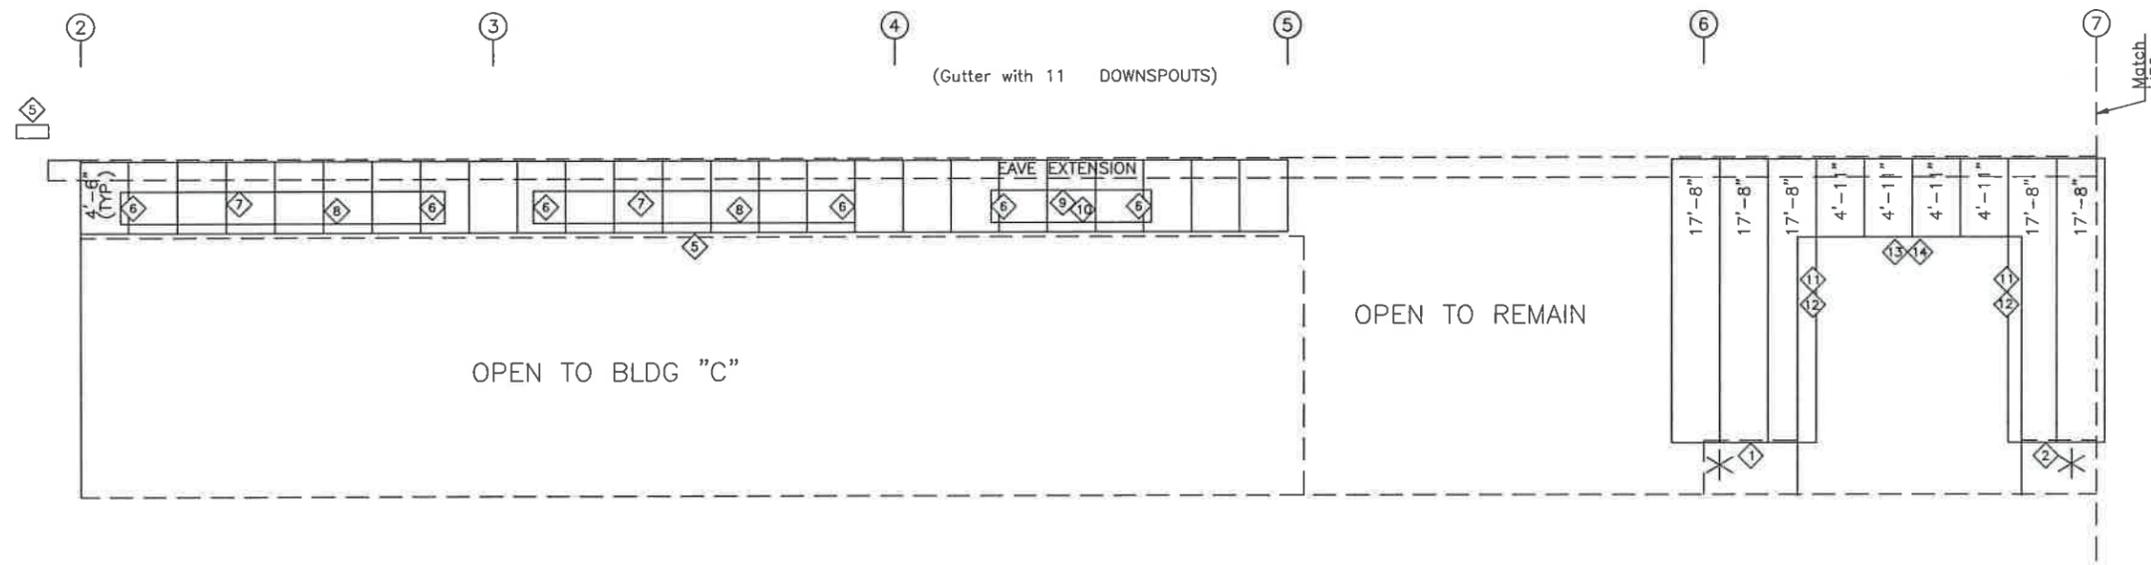

SIDEWALL SHEETING & TRIM: FRAME LINE K
PANELS: 26 GA. PBR - COLOR

SEE PAGE 12 FOR MEZZANINE INFORMATION

| BOLT TABLE FRAME LINE K | | | | |
|----------------------------|------|------|------|--------|
| LOCATION | QUAN | TYPE | DIA | LENGTH |
| WF-1 - WF-2 | 8 | A325 | 3/4" | 2 1/2" |
| WF-1 - RF2-3 | 4 | A325 | 5/8" | 2" |
| WF-1 - WF-3 | 8 | A325 | 3/4" | 2 1/2" |
| WF-1 - RF5-5 | 4 | A325 | 5/8" | 2" |
| WF-1 - RF6-3 | 4 | A325 | 5/8" | 2" |

| TRIM TABLE FRAME LINE K | | | |
|----------------------------|----------|---------|---------|
| ID | PART | LENGTH | DETAIL |
| 1 | DBLBASTR | 6'-1" | TRIM_22 |
| 2 | DBLBASTR | 10'-5" | TRIM_22 |
| 5 | STEP F | 19'-0" | TRIM_65 |
| 6 | R JAMB | 2'-3" | TRIM_8 |
| 7 | R HEAD | 20'-3" | TRIM_61 |
| 8 | R HEAD | 20'-3" | TRIM_7 |
| 9 | R HEAD | 10'-3" | TRIM_61 |
| 10 | R HEAD | 10'-3" | TRIM_7 |
| 11 | CT8 | 16'-1" | TRIM_11 |
| 12 | R JAMB | 12'-11" | TRIM_8 |
| 13 | CT8 | 14'-0" | TRIM_10 |
| 14 | R HEAD | 14'-3" | TRIM_61 |


| MEMBER TABLE FRAME LINE K | | |
|------------------------------|----------|-------------|
| MARK | PART | LENGTH |
| WF-1 | B12641 | 19'-8" |
| WF-2 | B10651 | 22'-11" |
| DJ-6 | 8X25C16 | 2'-7 1/2" |
| DJ-7 | 8X25C16 | 2'-7 1/2" |
| DJ-8 | 8X35C12 | 17'-8" |
| DH-8 | 8X35C16 | 14'-0" |
| DS-7 | 8X35C14 | 20'-0" |
| DS-8 | 8.3.5CH6 | 10'-0" |
| G-21 | 8x25Z16 | 28'-5 1/2" |
| G-22 | 8x25C16 | 25'-5 1/2" |
| G-23 | 8x25Z16 | 30'-11 1/2" |
| G-24 | 8x25C16 | 24'-11 1/2" |
| G-25 | 8x25Z16 | 27'-9 1/2" |
| G-26 | 8x25C16 | 24'-5 1/2" |
| G-27 | 8x25C16 | 5'-5 1/2" |
| G-28 | 8x25Z16 | 5'-9 1/2" |
| G-29 | 8X7DC14 | 24'-5 1/2" |
| G-30 | 8x25C16 | 4'-3 1/2" |
| G-31 | 8x25Z16 | 7'-3 1/2" |
| G-32 | 8x25Z12 | 7'-3 1/2" |
| MB-9 | w12X14 | 24'-4 3/4" |
| MB-10 | w12X14 | 24'-10 3/4" |
| MB-11 | w12X14 | 24'-2 5/8" |

| BUILDING "A" | | | |
|--|----------------|-----------------|-------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 4.5 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| BOLT TABLE | | | | |
|--------------|------|------|------|--------|
| FRAME LINE K | | | | |
| LOCATION | QUAN | TYPE | DIA | LENGTH |
| WF-1 - WF-2 | 8 | A325 | 3/4" | 2 1/2" |
| WF-1 - RF2-3 | 4 | A325 | 5/8" | 2" |
| WF-1 - WF-3 | 8 | A325 | 3/4" | 2 1/2" |
| WF-1 - RF5-5 | 4 | A325 | 5/8" | 2" |
| WF-1 - RF6-3 | 4 | A325 | 5/8" | 2" |


| TRIM TABLE | | | |
|--------------|-----------|---------|---------|
| FRAME LINE K | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | DRIP BASE | 1'-3" | TRIM_16 |
| 2 | O/S CORN | 3'-6" | TRIM_5 |
| 3 | CT8 | 16'-1" | TRIM_11 |
| 4 | R JAMB | 12'-11" | TRIM_8 |
| 5 | CT8 | 14'-0" | TRIM_10 |
| 6 | R HEAD | 14'-3" | TRIM_61 |
| 7 | R JAMB | 4'-1" | TRIM_8 |
| 8 | R HEAD | 3'-7" | TRIM_61 |
| 9 | DBLBASTR | 11'-3" | TRIM_22 |
| 10 | DBLBASTR | 15'-9" | TRIM_22 |

| MEMBER TABLE | | |
|--------------|---------|-------------|
| FRAME LINE K | | |
| MARK | PART | LENGTH |
| WF-1 | B12641 | 19'-8" |
| WF-3 | B10651 | 23'-5" |
| DJ-9 | 8X35C12 | 17'-8" |
| DJ-10 | 8X25C16 | 13'-9" |
| DH-8 | 8X35C16 | 14'-0" |
| DH-9 | 8X25C16 | 3'-4" |
| G-33 | 8x25C16 | 5'-1 1/2" |
| G-34 | 8x25Z16 | 8'-1 1/2" |
| G-35 | 8x25Z12 | 8'-1 1/2" |
| G-36 | 8x25Z16 | 27'-11 1/2" |
| G-37 | 8x25Z16 | 8'-1 1/2" |
| G-38 | 8x25Z12 | 8'-1 1/2" |
| G-39 | 8x25Z16 | 30'-11 1/2" |
| G-40 | 8x25Z14 | 8'-1 1/2" |
| G-41 | 8x25Z14 | 8'-1 1/2" |
| G-42 | 8x25Z16 | 28'-3 1/2" |
| G-43 | 8x25C14 | 26'-5 1/2" |
| G-44 | 8x25Z12 | 29'-5 1/2" |

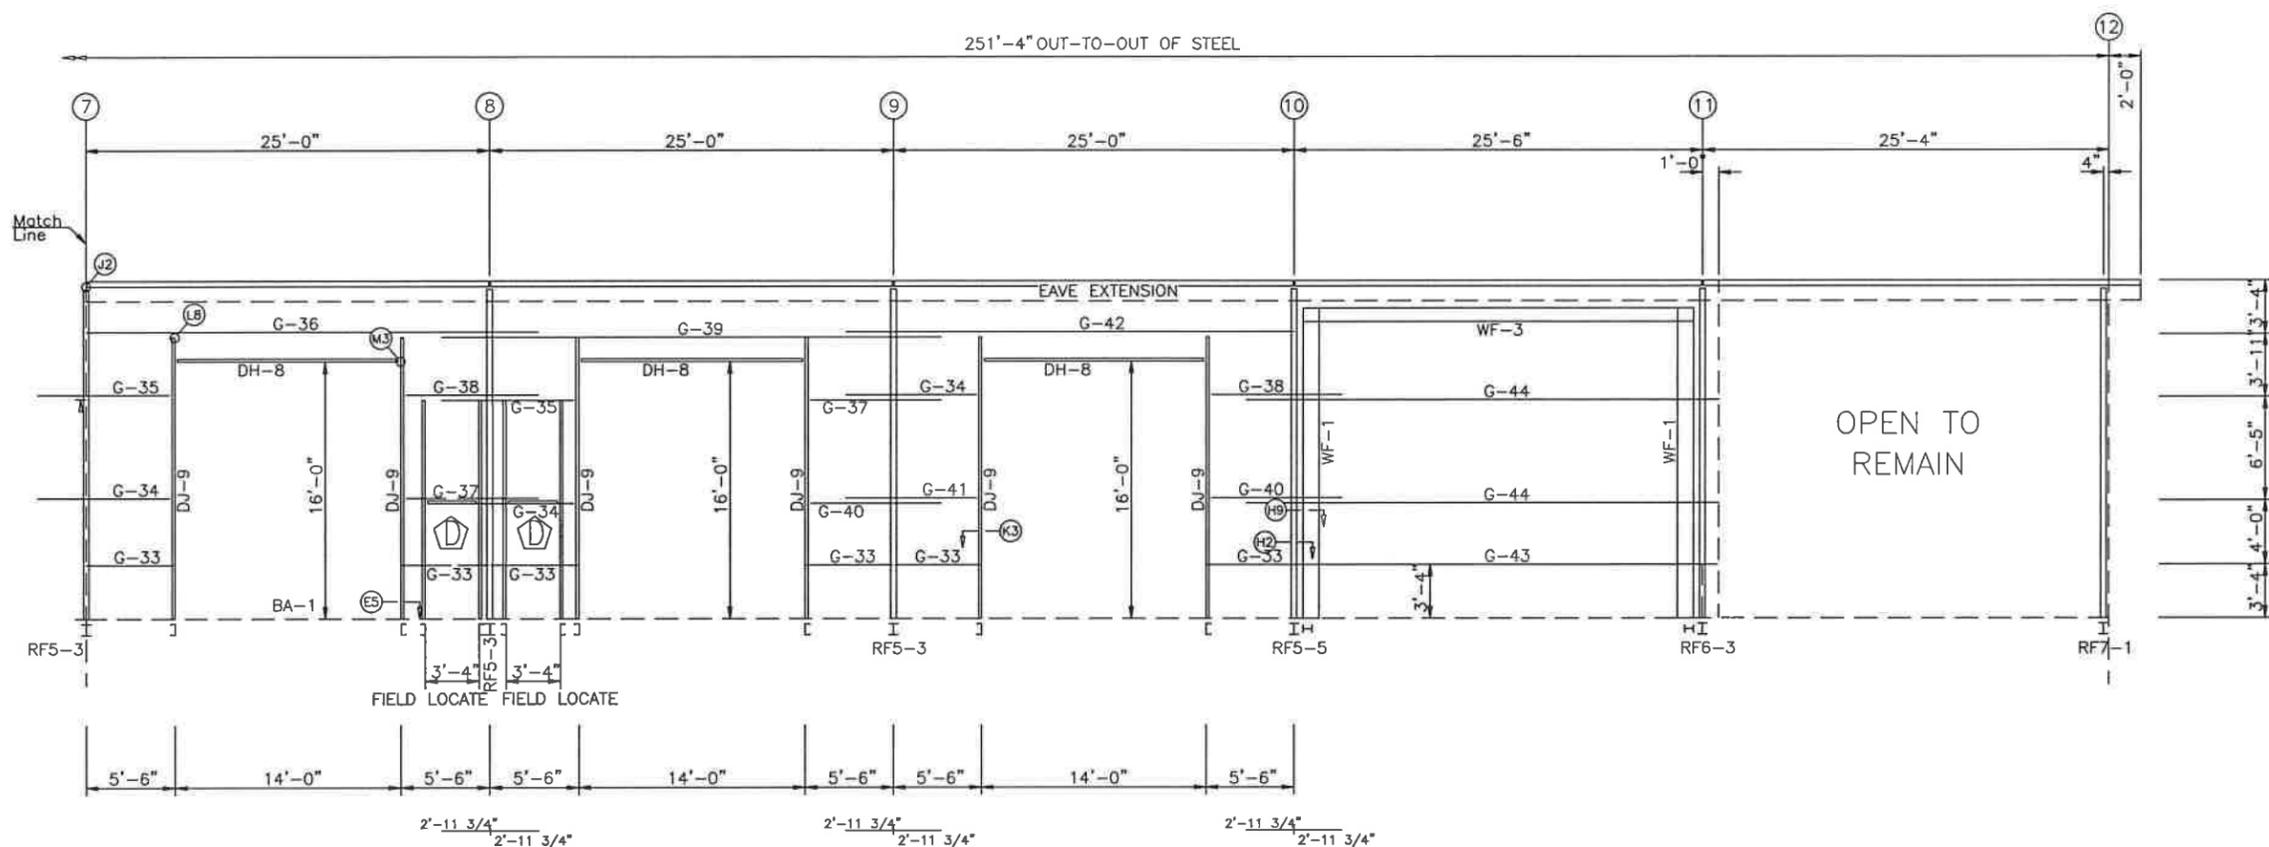


SIDEWALL FRAMING: FRAME LINE K

(Gutter with 11 DOWNSPOUTS)

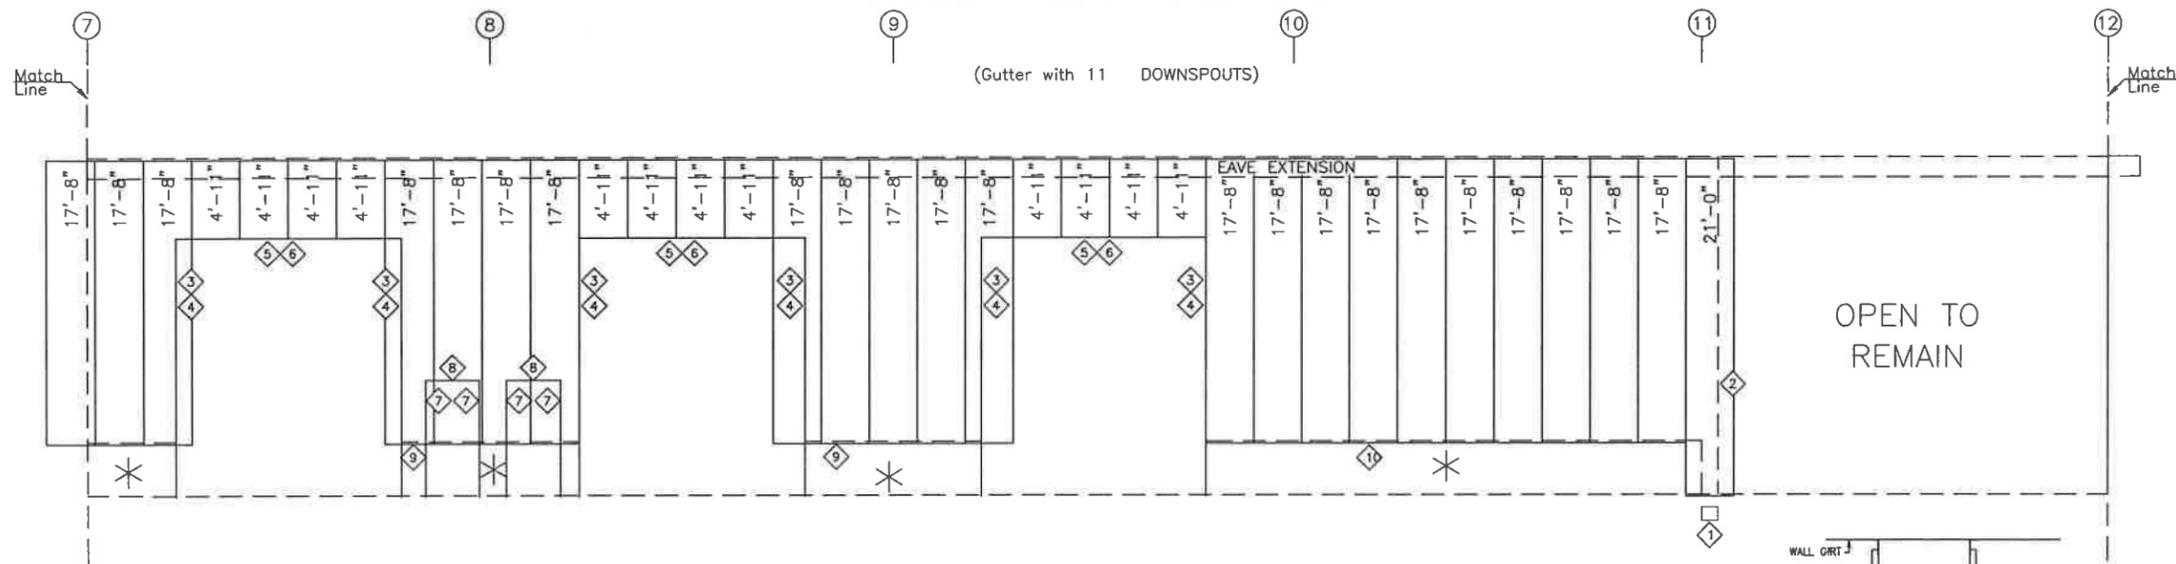

SIDEWALL SHEETING & TRIM: FRAME LINE K
PANELS: 26 GA. PBR - COLOR

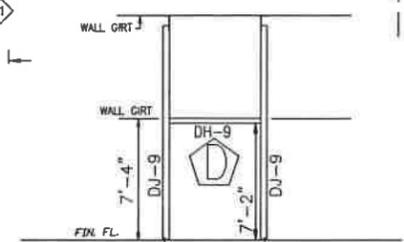

FIELD LOCATED 3'-4" X 7'-2" F.O.

1. FIELD CUT AND WORK GIRTS, PANELS, AND TRIM AS REQUIRED.
2. REFER TO DETAIL PAGES FOR APPLICABLE TRIM DETAILS.


| BUILDING "A" | | | |
|--|----------------|-----------------|-------------|
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 4.6 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

ALL VEHICULAR FRAMED OPENINGS SUPPLIED ON THIS PROJECT HAVE BEEN DESIGNED TO SUPPORT WIND LOADS NORMAL TO A DOOR SYSTEM, BASED ON THE STANDARD BUILDING CODE CRITERIA. THE VEHICULAR FRAMED OPENING HAS NOT BEEN DESIGNED FOR ANY ADDITIONAL MOMENT OR CATENARY FORCE FROM THE DOOR SYSTEM. ANY CHANGES TO THE INFORMATION SHOWN HERE WOULD REQUIRE AN ENGINEERING INVESTIGATION AND POSSIBLE BUILDING REINFORCEMENT.


| BOLT TABLE FRAME LINE L | | | | |
|----------------------------|------|------|------|--------|
| LOCATION | QUAN | TYPE | DIA | LENGTH |
| WF-200 - WF-201 | 8 | A325 | 5/8" | 2" |
| WF-200 - RF2-200 | 6 | A325 | 5/8" | 2" |

| TRIM TABLE FRAME LINE L | | | |
|----------------------------|-----------|--------|---------|
| ID | PART | LENGTH | DETAIL |
| 2 | DBLBASTR | 19'-3" | TRIM_22 |
| 3 | HEAD DRIP | 3'-3" | 7.2 HDD |
| 4 | 7.2 HEAD | 3'-3" | 7.2 SDD |
| 5 | 7.2 JAMB | 3'-3" | 7.2 WDJ |

| MEMBER TABLE FRAME LINE L | | |
|------------------------------|---------|-------------|
| MARK | PART | LENGTH |
| WF-200 | B12541 | 11'-8" |
| WF-201 | B10651 | 22'-11 3/4" |
| DJ-201 | 8X25C16 | 6'-8" |
| DH-200 | 8X25C16 | 3'-0" |
| DS-200 | 8X25C16 | 3'-0" |
| G-207 | 8x25C14 | 25'-9 1/2" |
| G-208 | 8x25Z16 | 27'-5 1/2" |
| G-209 | 8x25C16 | 24'-11 1/2" |
| G-210 | 8x25Z16 | 28'-11 1/2" |

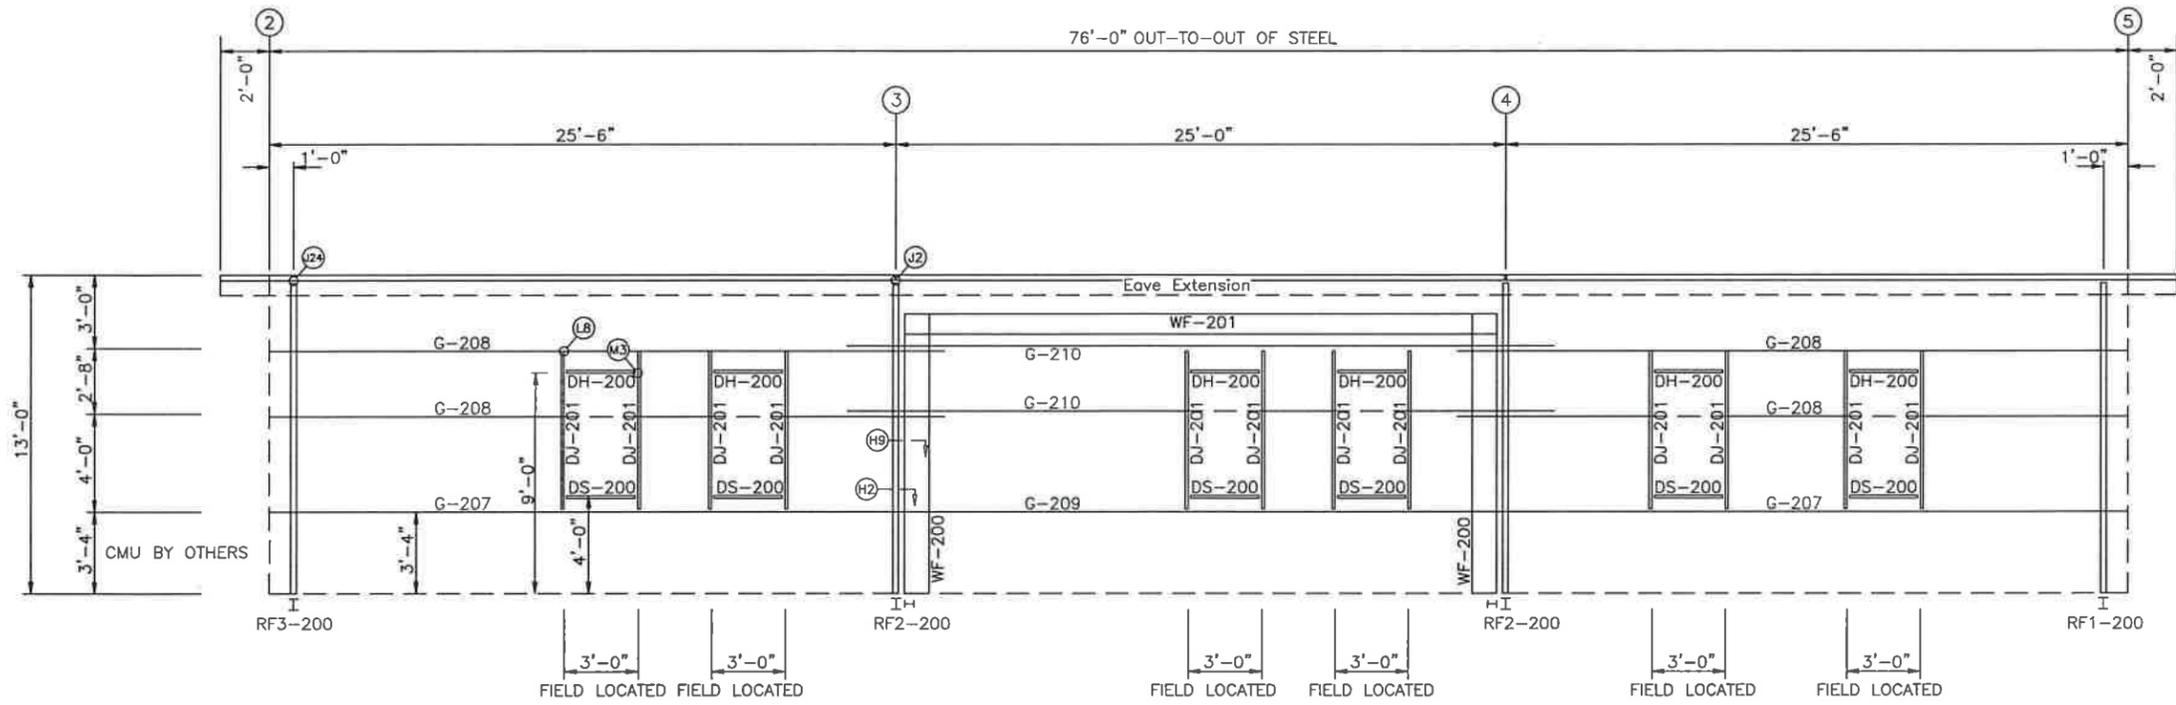







SIDEWALL FRAMING: FRAME LINE L

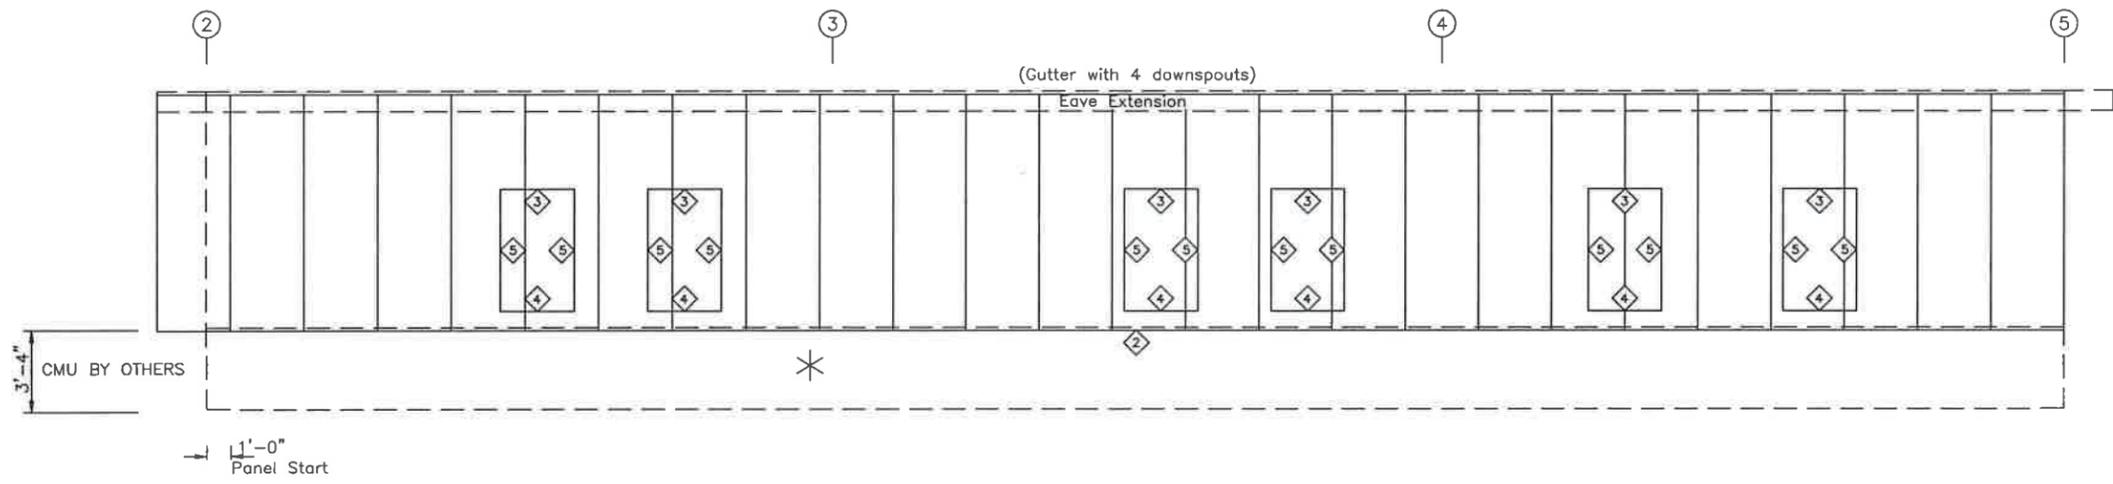

SIDEWALL SHEETING & TRIM: FRAME LINE L
PANELS: 26 Ga. 7.2 - NEED COLOR


*=CMU BY OTHERS

| | | | |
|---|-------------------|--------------------|----------------|
| BUILDING "C" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL FRAMING & SHEETING LAYOUT | | | |
| DRAWING NO: PAGE 4.7 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

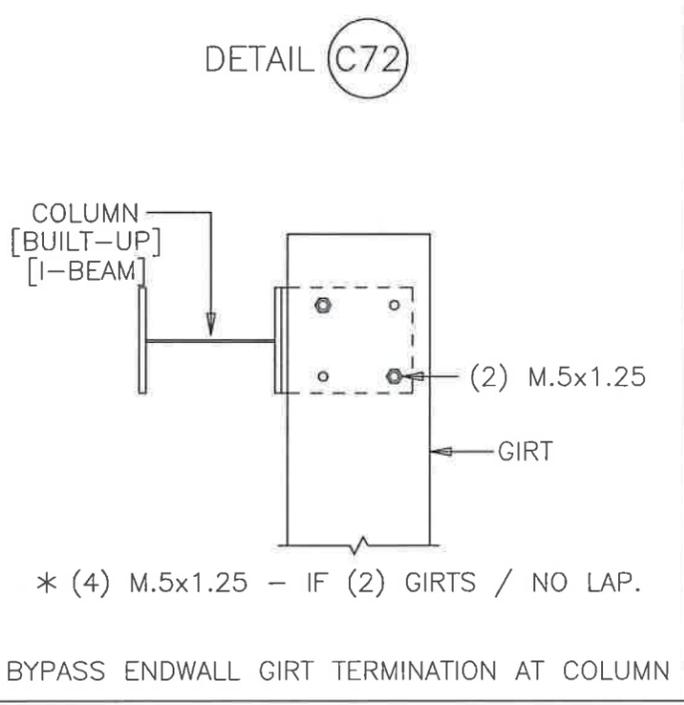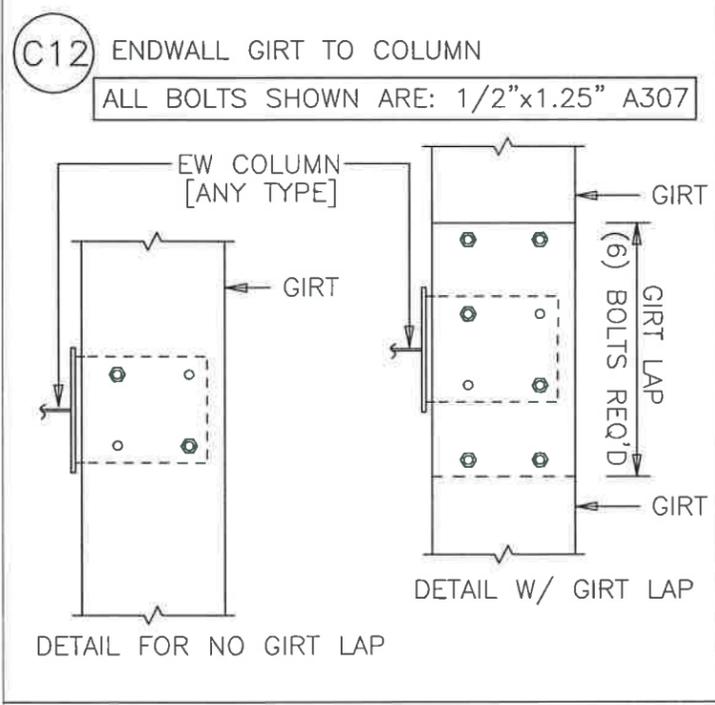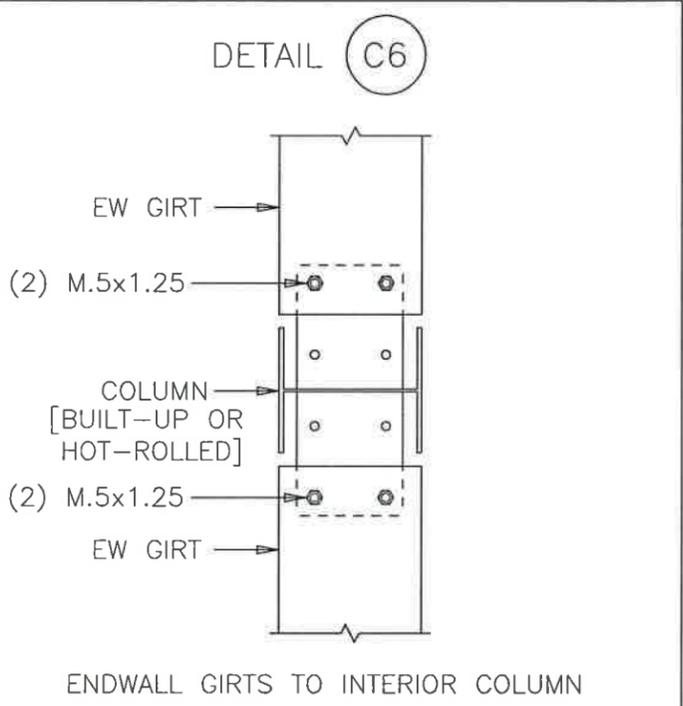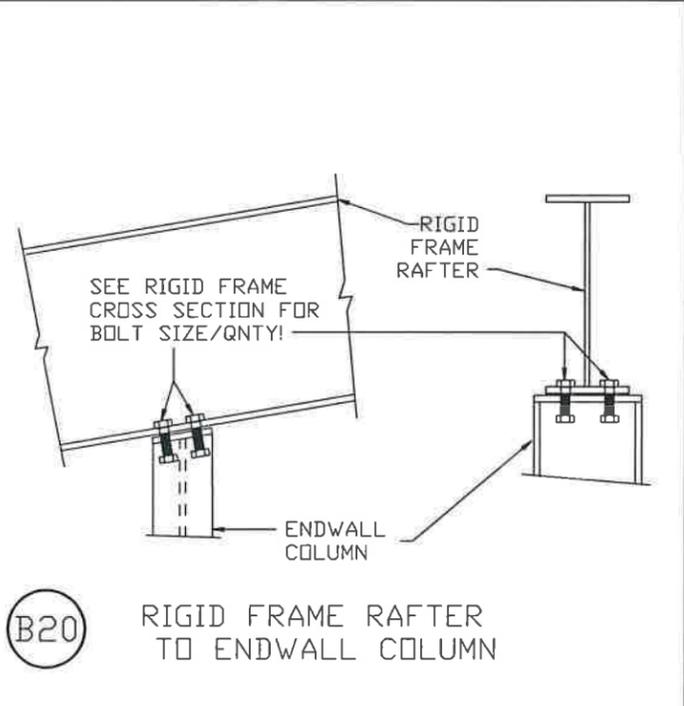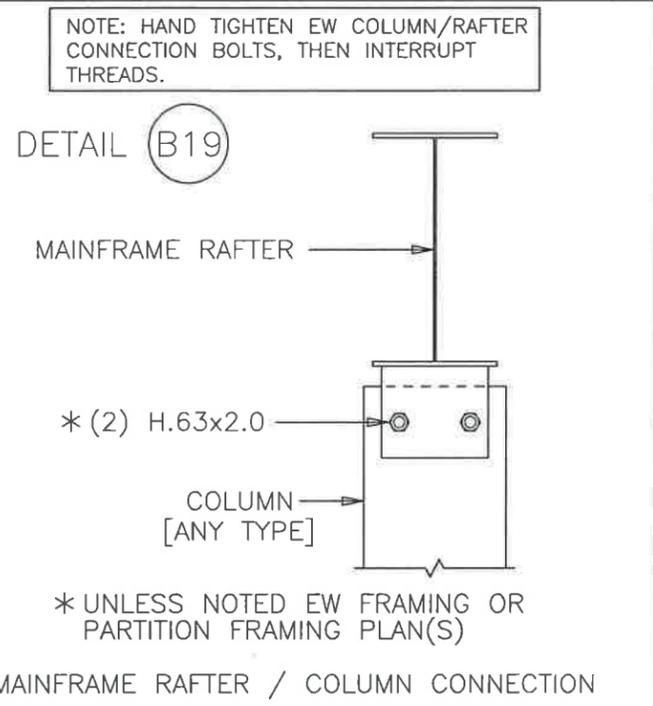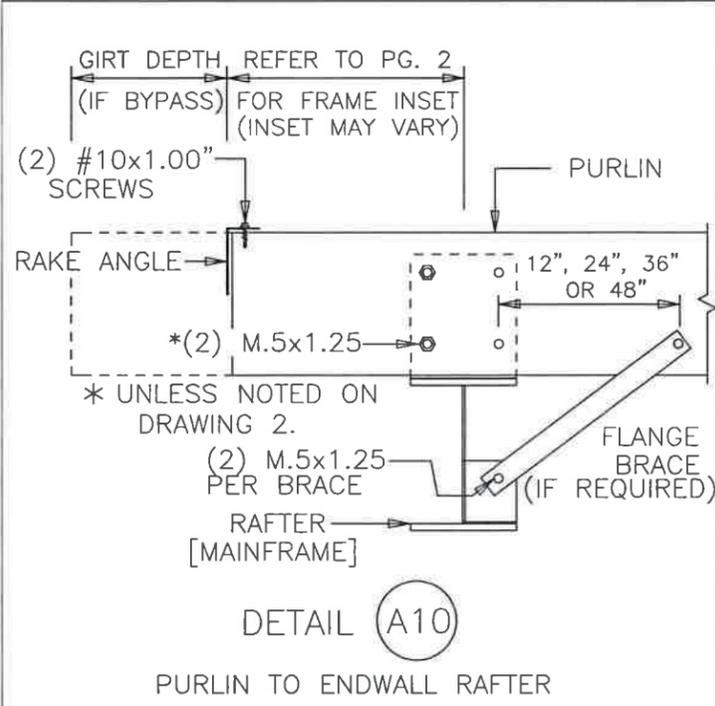


| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: FRAMING DETAILS | | | |
| DRAWING NO: PAGE 5 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

DETAIL (E3)

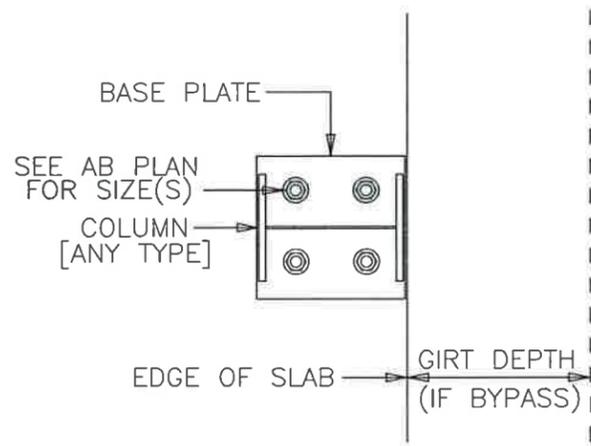


ENDWALL COLUMN BASE DETAIL

DETAIL (E5)

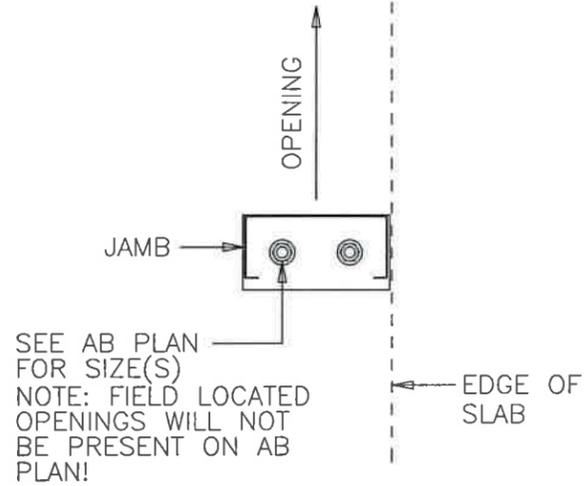


FRAMED OPENING JAMB BASE DETAIL

DETAIL (G2)

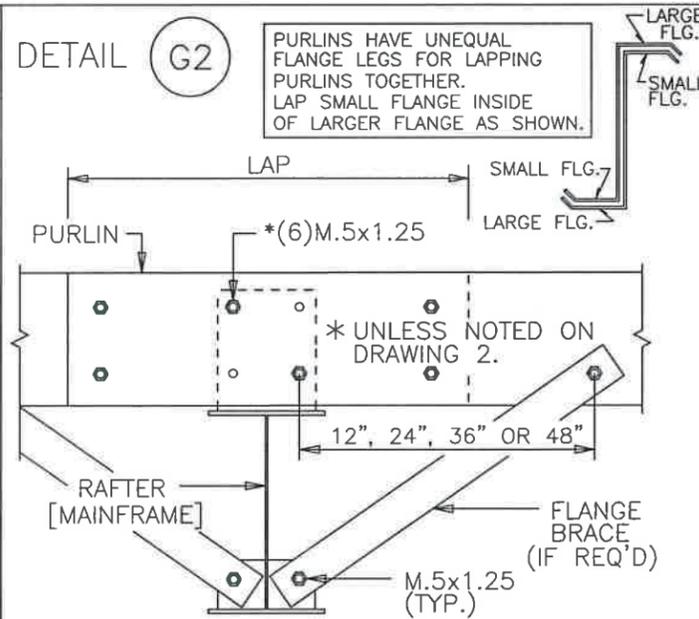


PURLIN TO MAINFRAME RAFTER

NOTE: FBC* CLIP MUST BE INSTALLED PRIOR TO ANY LINER SYSTEM

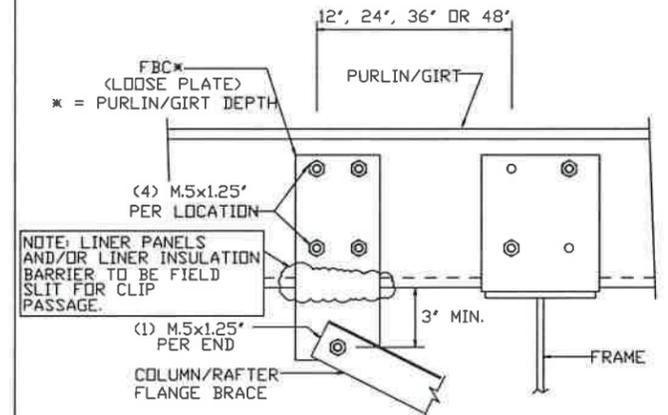


(G25) FLANGE BRACE TO PURLIN/GIRT DURING LINER TYPE INSTANCES

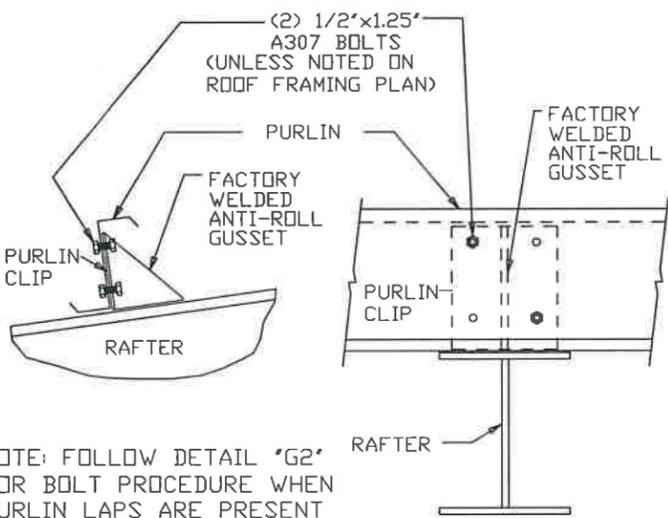

NOTE: FOLLOW DETAIL "G2" FOR BOLT PROCEDURE WHEN PURLIN LAPS ARE PRESENT


(G26) WELDED ANTI-ROLL CLIP

DETAIL (H2)

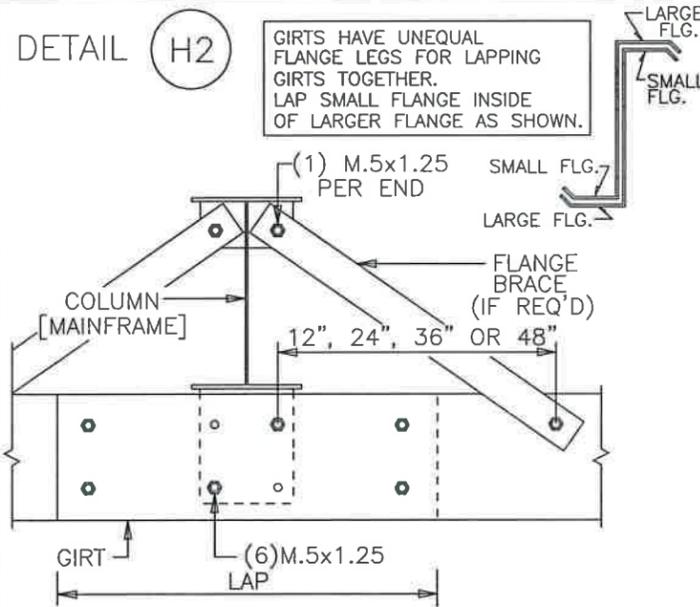


GIRT TO MAINFRAME COLUMN

DETAIL (H4)

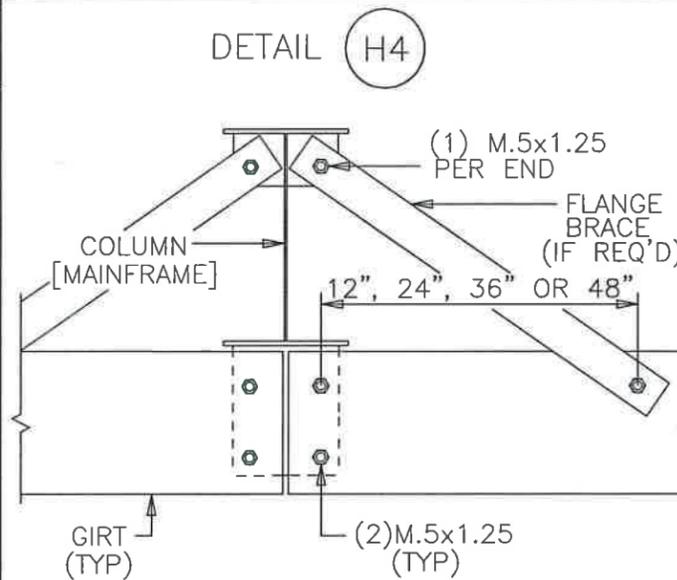


GIRT TO MAINFRAME COLUMN

DETAIL (H9)

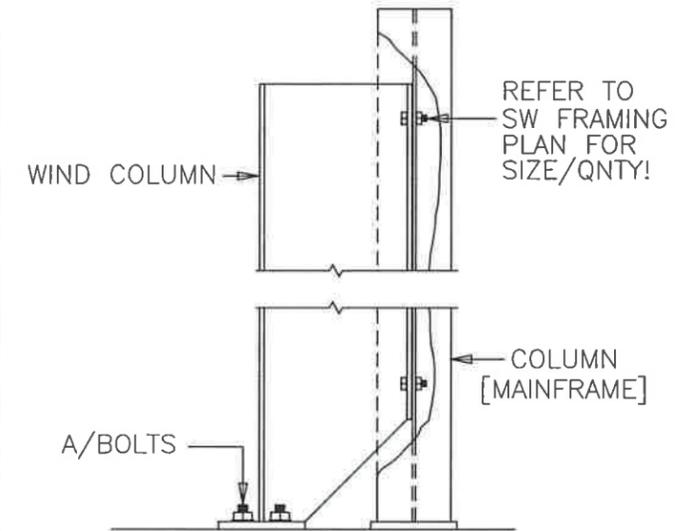


WIND COLUMN DETAIL


| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: FRAMING DETAILS | | | |
| DRAWING NO: PAGE 5.1 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

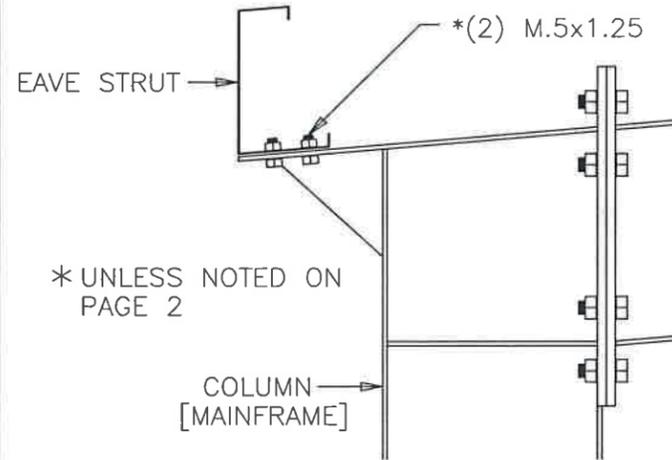



J2 EAVE STRUT CONNECTION AT MAINFRAME

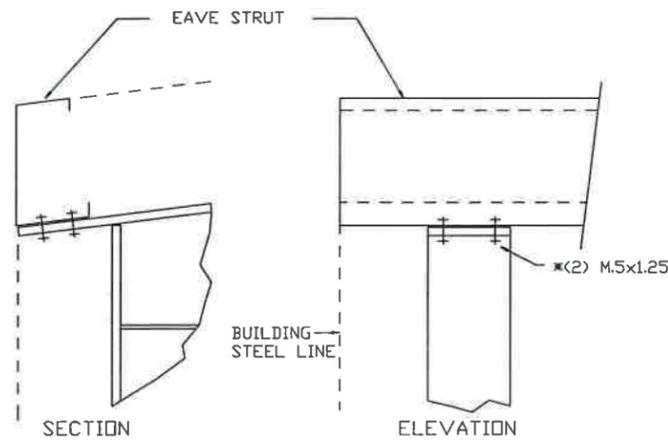


J24 EAVE STRUT TO RIGID FRAME

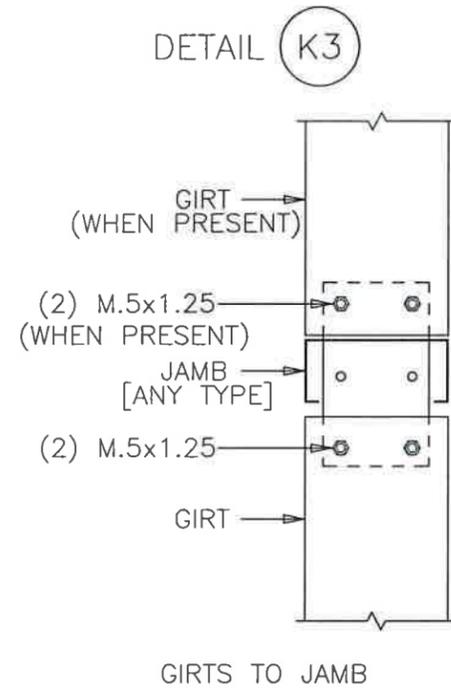


K9 WALL GIRT TO JAMB

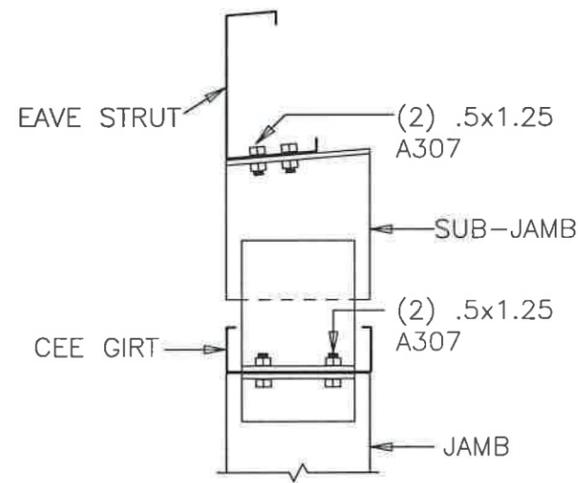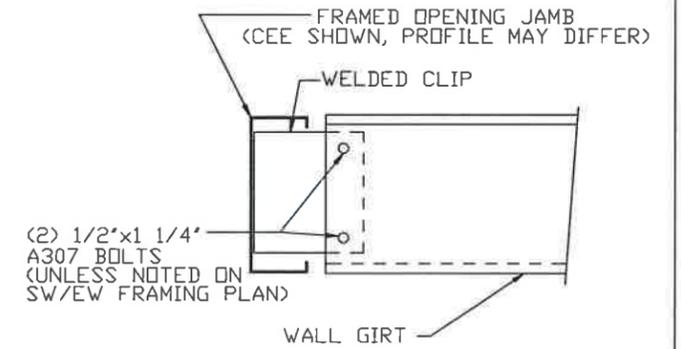

FRAMED OPENING JAMB TO CEE GIRTS
TO SUBJAMB TO EAVE STRUT

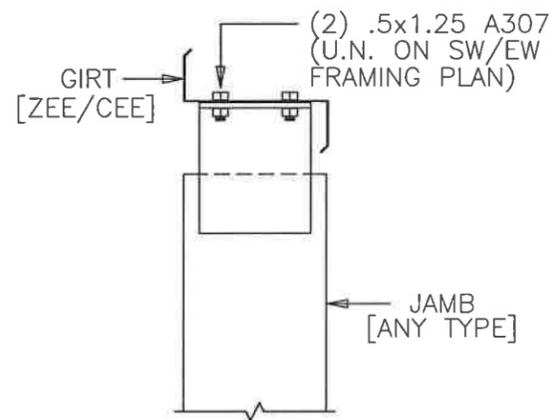


FRAMED OPENING JAMB TO GIRTS

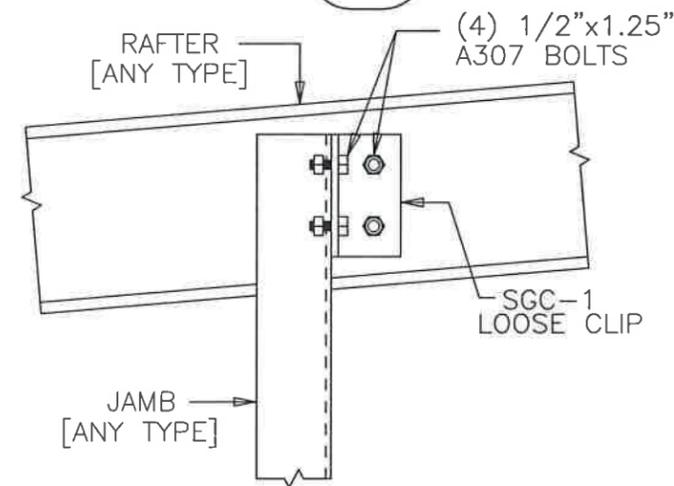

* UNLESS NOTED ON EW FRAMING PLAN
JAMB/COLUMN TO BYPASS EW RAFTER


| ISSUE | DET | CHK | DATE |
|--------------------------------------|-------------------|--------------------|----------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: FRAMING DETAILS | | | |
| DRAWING NO: PAGE 5.2 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

DETAIL M3

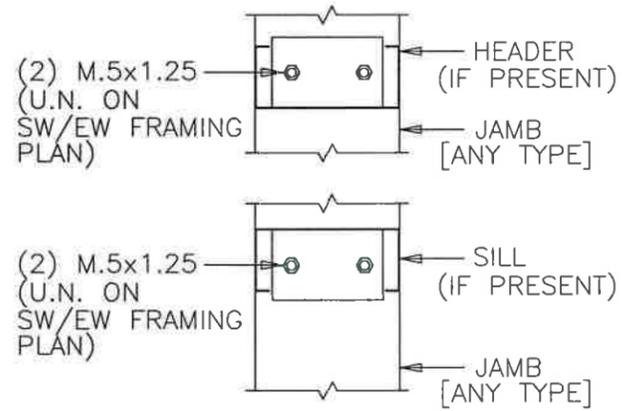


FRAMED OPENING HEADER/SILL TO JAMB

M7 DOOR HEADER TO DOOR JAMB

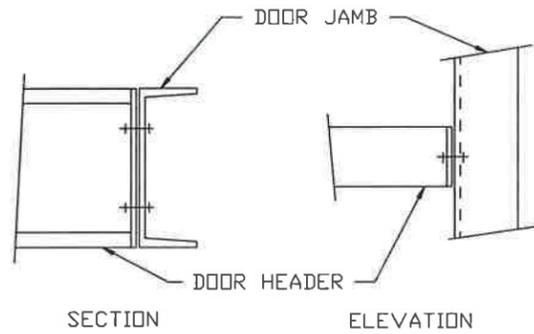


Q2 CABLE INSTALLATION DETAIL

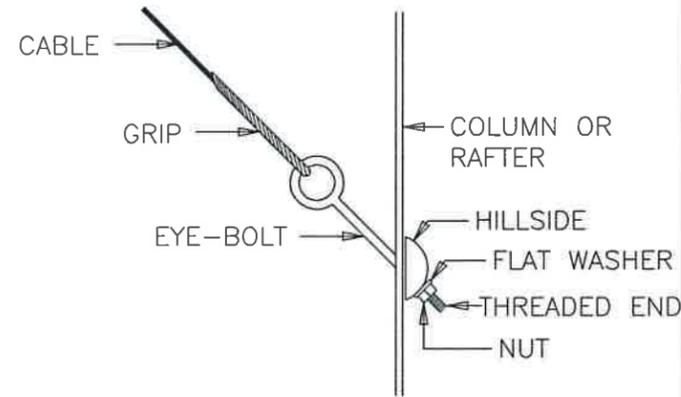


NOTE: WHEN FLUSH GIRTS/PURLINS ARE USED, FIELD SLOT GIRT OR PURLIN AS REQ'D FOR CABLE/ROD PASSAGE THROUGH PURLIN/GIRT.

DETAIL T1


1/4" x 1 1/4" ZINC HAMMER DRIVES ZAMAK ALLOY (ASTM B633, SC1, TYPE III) (24" ON CENTER)

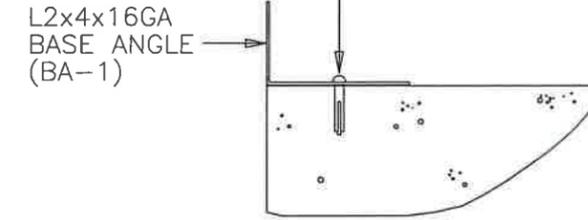

BASE ANGLE DETAIL

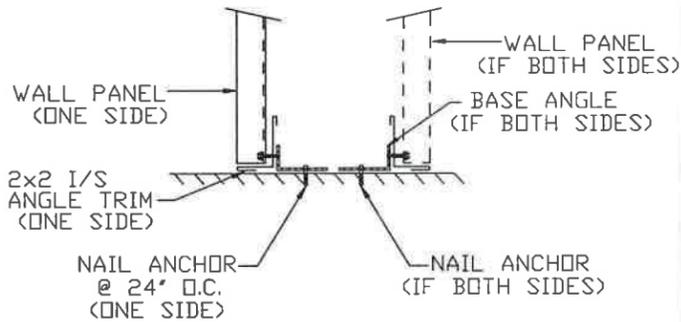


T10 SECTION THRU PARTITION BASE AND CONCRETE FLOOR

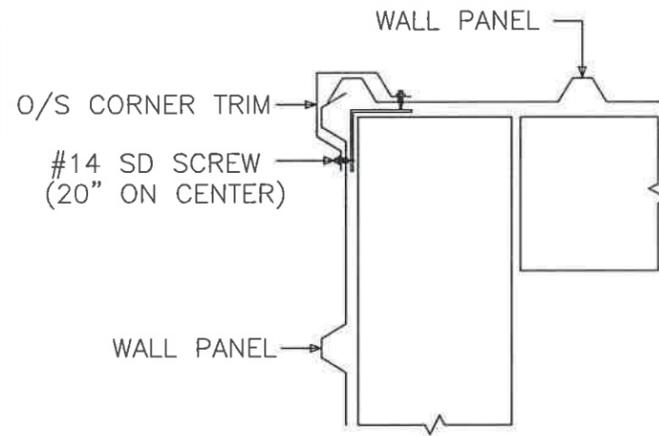


TRIM_5 O/S CORNER DETAIL

| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: FRAMING DETAILS | | | |
| DRAWING NO: PAGE 5.3 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

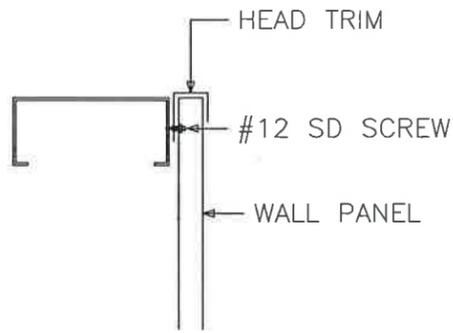


TRIM_7

HEAD TRIM DETAIL AT SILL

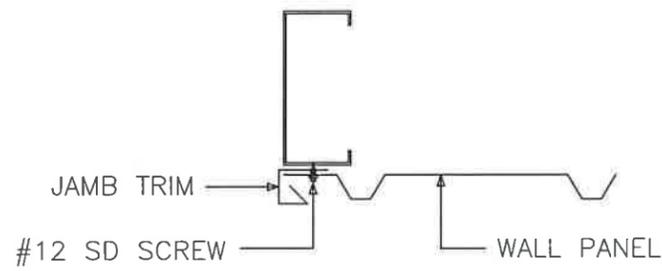


TRIM_8

JAMB TRIM DETAIL AT JAMB

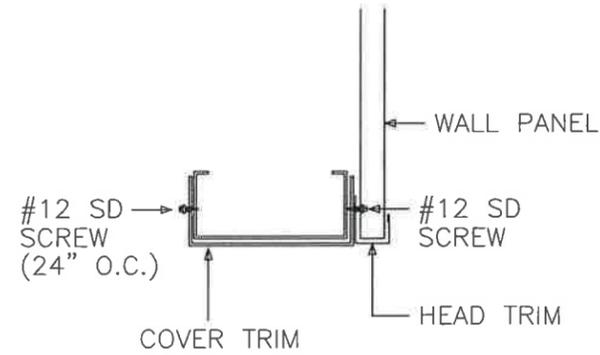


TRIM_10

COVER TRIM DETAIL AT HEADER

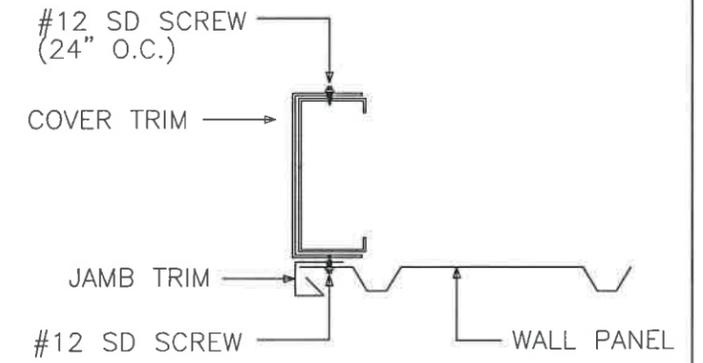


TRIM_11

COVER TRIM DETAIL AT JAMB

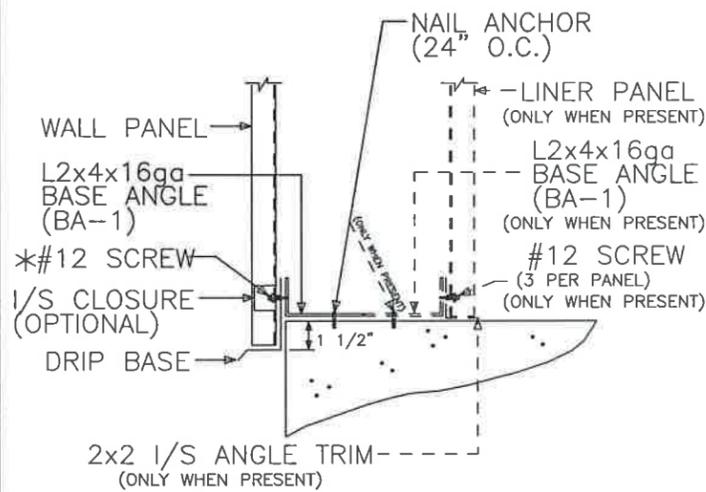


* = 6 PER PANEL FOR STANDARD PBR
3 PER PANEL FOR REV. ROLLED PBR

TRIM_16 BASE TRIM DETAIL

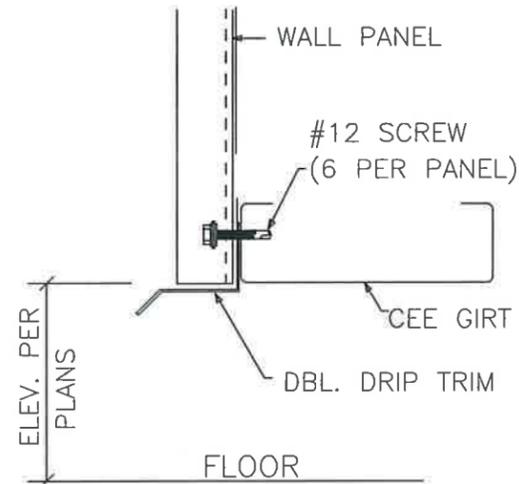


TRIM_22

DOUBLE DRIP TRIM DETAIL
(PARTIAL WALL; CLEAR OPENING)

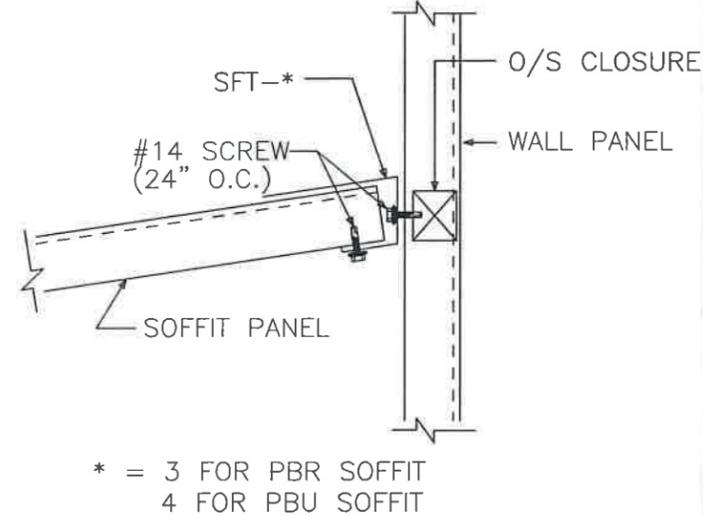

TRIM_23








SOFFIT TRIM DETAIL AT
WALL PANEL

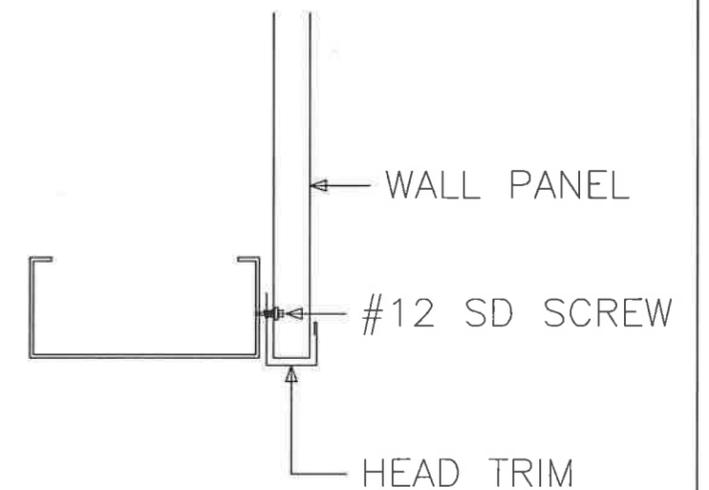

TRIM_61

HEAD TRIM DETAIL AT HEADER

| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: FRAMING DETAILS | | | |
| DRAWING NO: PAGE 5.4 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

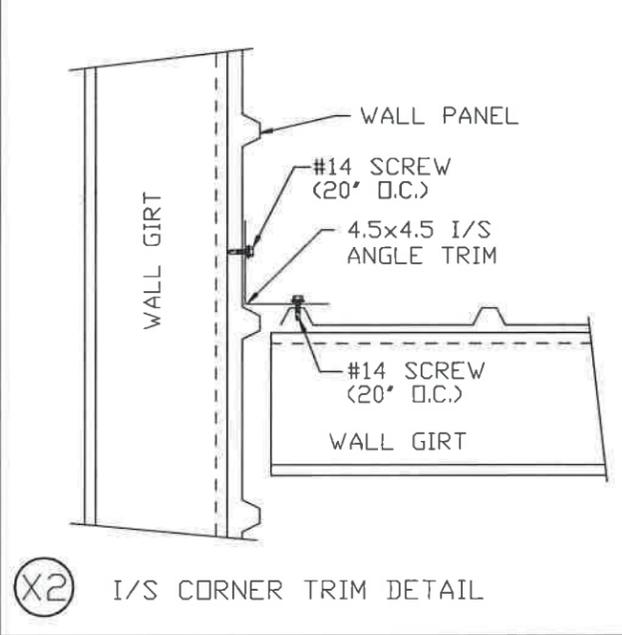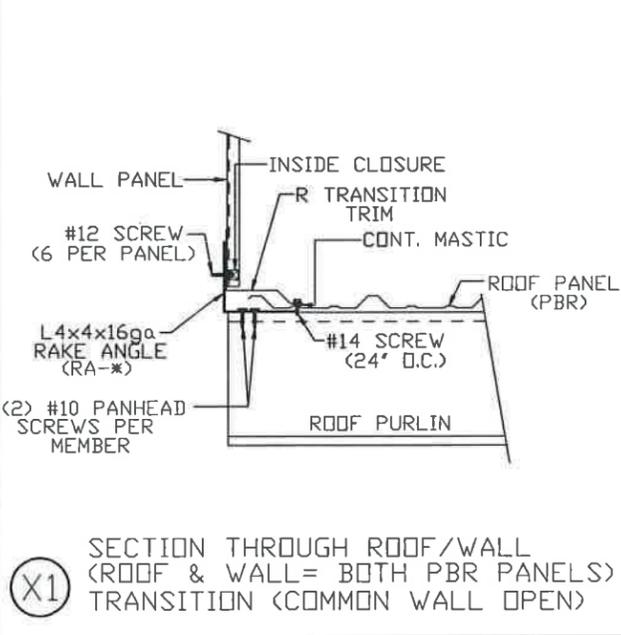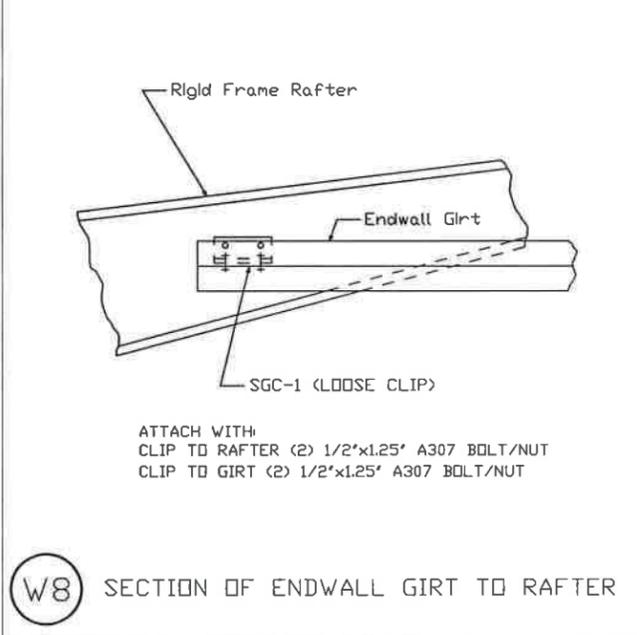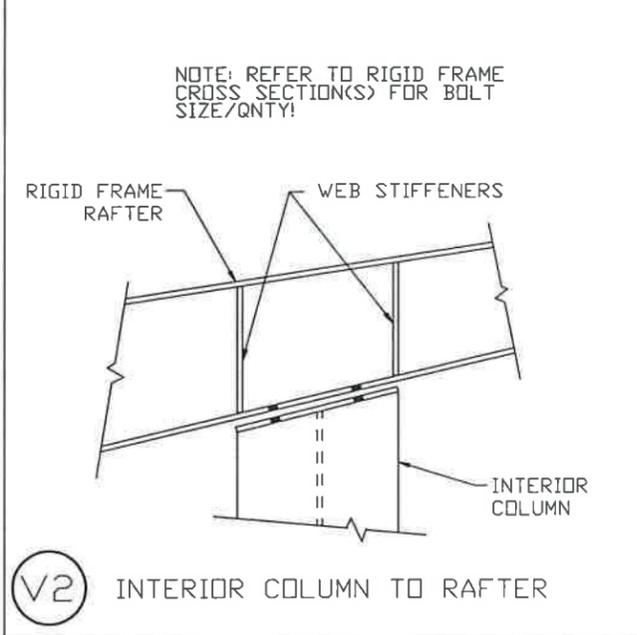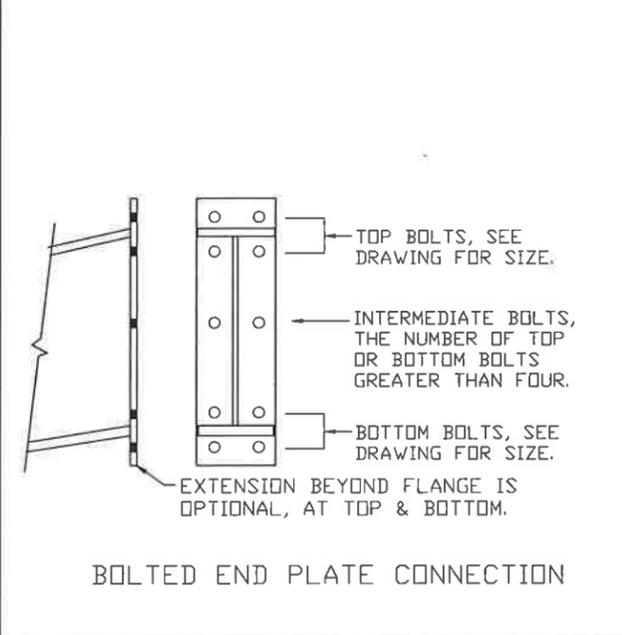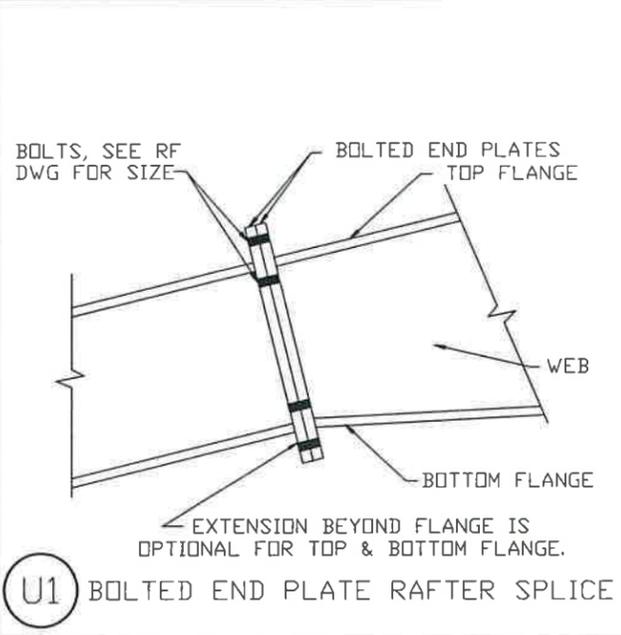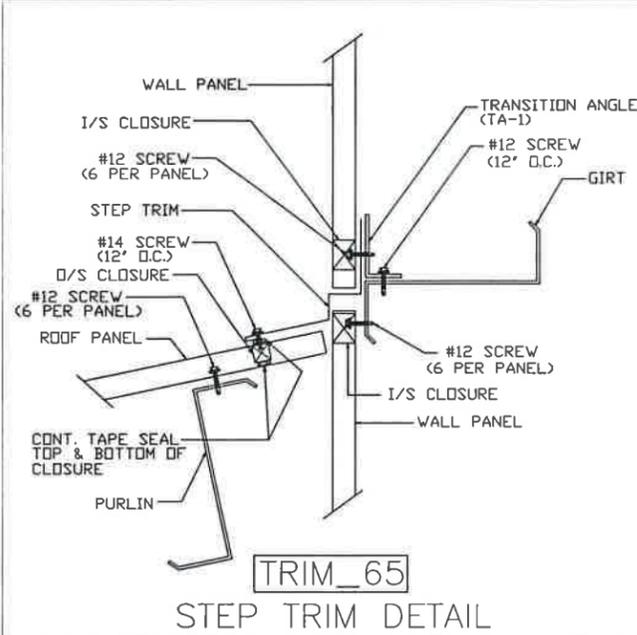

STRUCTURAL BOLTED CONNECTIONS
REFER TO COVER PAGE "GENERAL NOTES" PARAGRAPH "C", SECTION "9" FOR INSTRUCTIONS ON TIGHTENING ALL A325 AND A490 CONNECTION BOLTS.

TRIM NOTES:

- [1] SEAL TRIM SPLICES WITH TUBE CAULK.
- [2] SECURE GUTTER SPLICES AND END PLUGS WITH RIVETS.
- [3] SECURE ALL OTHER ROOF TRIM SPLICES WITH TRIM SCREWS UNLESS NOTED OTHERWISE.
- [4] TRIM SCREWS ARE LOCATED 24" ON CENTER UNLESS NOTED OTHERWISE.
- [5] STD. TRIM SPLICES ARE 3" TOTAL UNLESS NOTED OTHERWISE.

MORTISE PREPPED PERSONNEL DOORS

ALL MORTISE PREPPED PERSONNEL DOORS COME AS RIGHTHAND REVERSED SWING.

(i.e. STANDING ON THE OUTSIDE OF THE BUILDING FACING THE DOOR, THE LOCK WILL BE ON THE LEFTHAND SIDE OF THE DOOR AND THE DOOR WILL SWING OUTWARD FROM THE BUILDING.)








ANY FIELD MODIFICATIONS ARE THE RESPONSIBILITY OF THE ERECTOR AND MBM IS NOT LIABLE FOR LABOR CHARGES NOR DAMAGES DUE TO ERROR.

BUILT-UP MEMBER LEGEND

| BEAM TYPE | BEAM DEPTH | FLANGE WIDTH | FLANGE THK. | WEB THK. |
|-------------|---|-------------------------|--|-----------------------------|
| B08541 | | | | |
| B= BUILT-UP | 08= 8" 10= 10" 12= 12" 14= 14" ETC. | 5,6,8,10 OR 12 (INCHES) | MEASURED IN 16ths. (4= 1/4", 5= 5/16", ETC.) | 1= 10ga 3= 3/16" ETC. |

| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: FRAMING DETAILS | | | |
| DRAWING NO: PAGE 5.5 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |



| TRIM TABLE | | | |
|------------|-----------|---------|---------|
| ID | PART | LENGTH | DETAIL |
| 1 | SFT-3 | 19'-7" | TRIM_23 |
| 2 | SCT10 | 19'-11" | EAVE |
| 3 | RID FLSH | 10'-3" | |
| 4 | GUTEND | 1" | |
| 5 | CORBOX L | 1'-0" | |
| 6 | EAVE TRM | 19'-11" | EAVE |
| 7 | GUTTER | 19'-11" | EAVE |
| 8 | CORBOX R | 1'-0" | |
| 9 | EAVE TRM | 2'-0" | EAVE |
| 10 | RAKE TRM | 4'-7" | EAVE |
| 11 | RST10 | 14'-1" | RAKE |
| 12 | R HEAD | 13'-2" | RAKE |
| 13 | REV RIDGE | 4'-3" | RR |

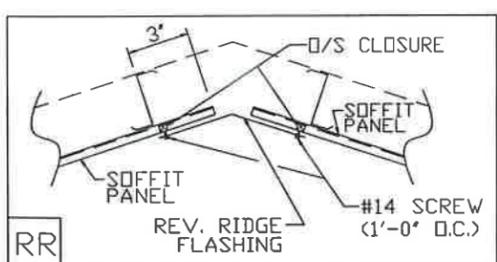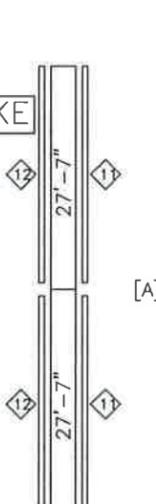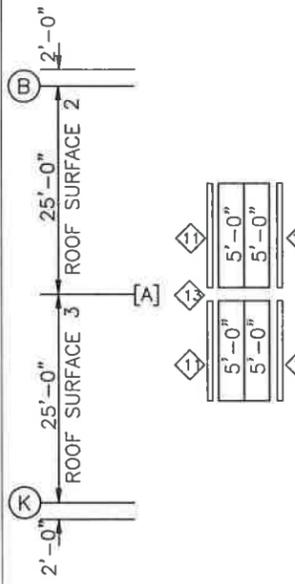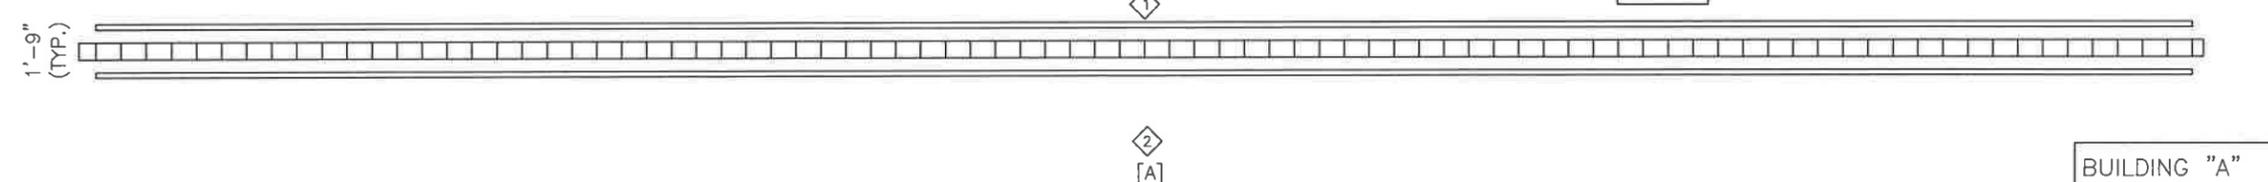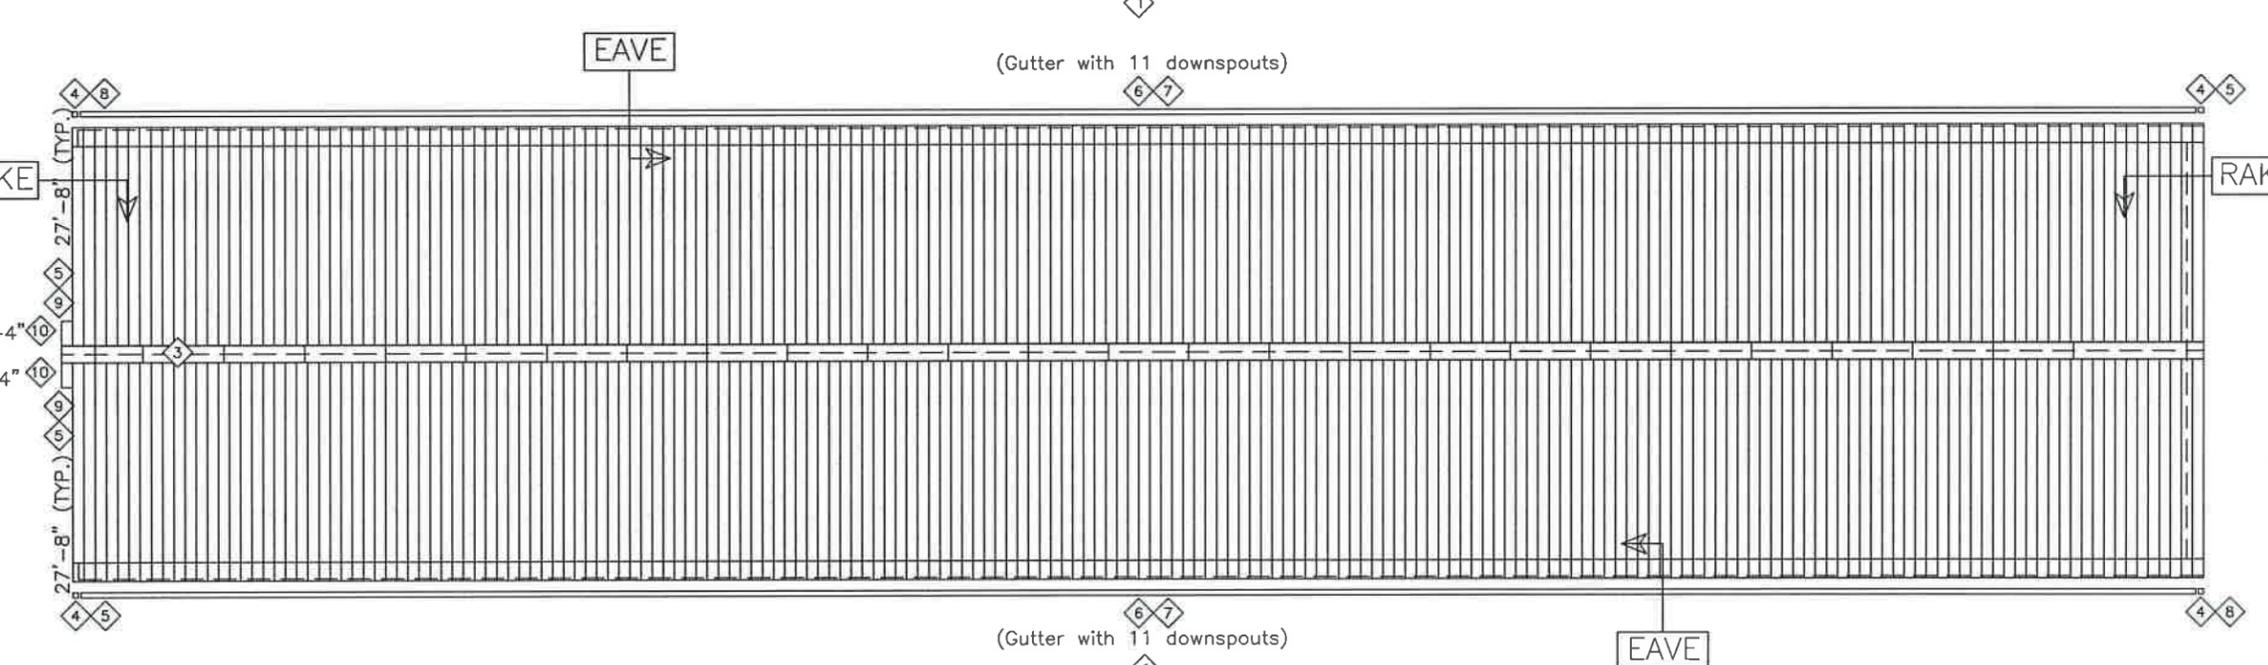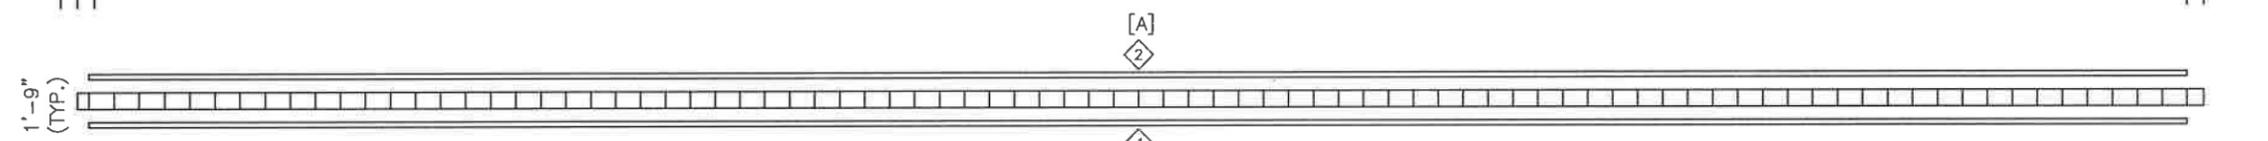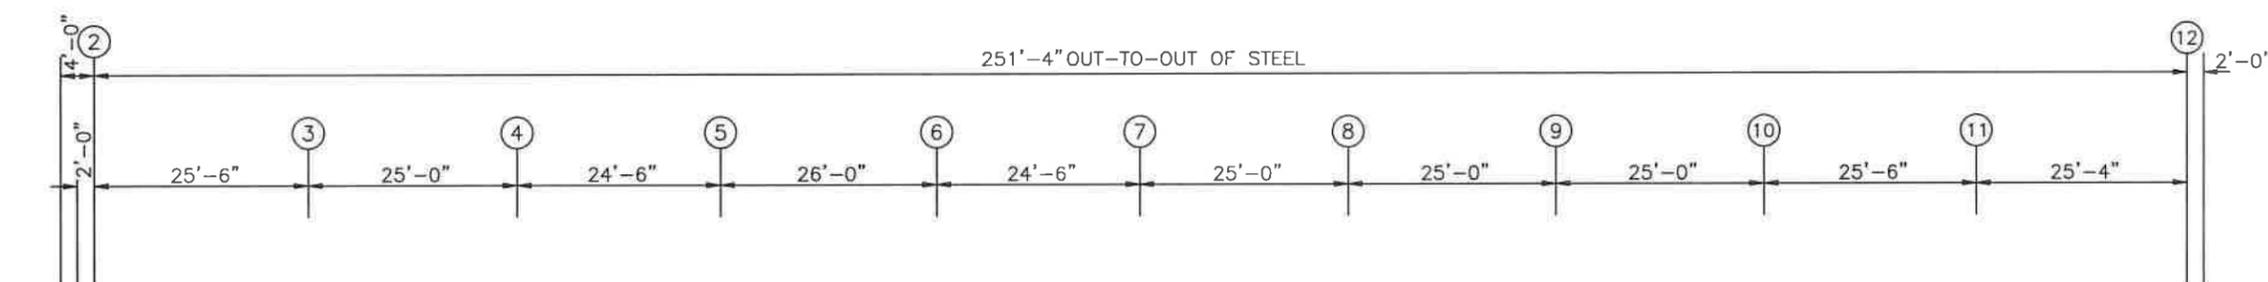

ROOF SHEETING PLAN
 PANELS: 24 Ga. PC216 - NEED COLOR
 [A] SOFFIT PANELS: 26 GA. PBR - NEED COLOR

| | | | |
|-----------------------------------|----------------|-----------------|-------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF PANELS & TRIM | | | |
| DRAWING NO: PAGE 6A | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |



| TRIM TABLE | | | |
|------------|----------|---------|---------|
| ROOF PLAN | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | SCT8 | 20'-3" | EAVE2 |
| 2 | SFT-3 | 19'-3" | TRIM_23 |
| 3 | FL245 | 1" | |
| 4 | CORBOX L | 1'-0" | |
| 5 | GUTTER | 20'-3" | EAVE2 |
| 6 | EAVE TRM | 20'-3" | EAVE2 |
| 7 | CORBOX R | 1'-0" | |
| 8 | RST8 | 13'-9" | RAKE2 |
| 9 | R HEAD | 12'-11" | RAKE2 |
| 10 | H/S FLSH | 20'-3" | H/S |

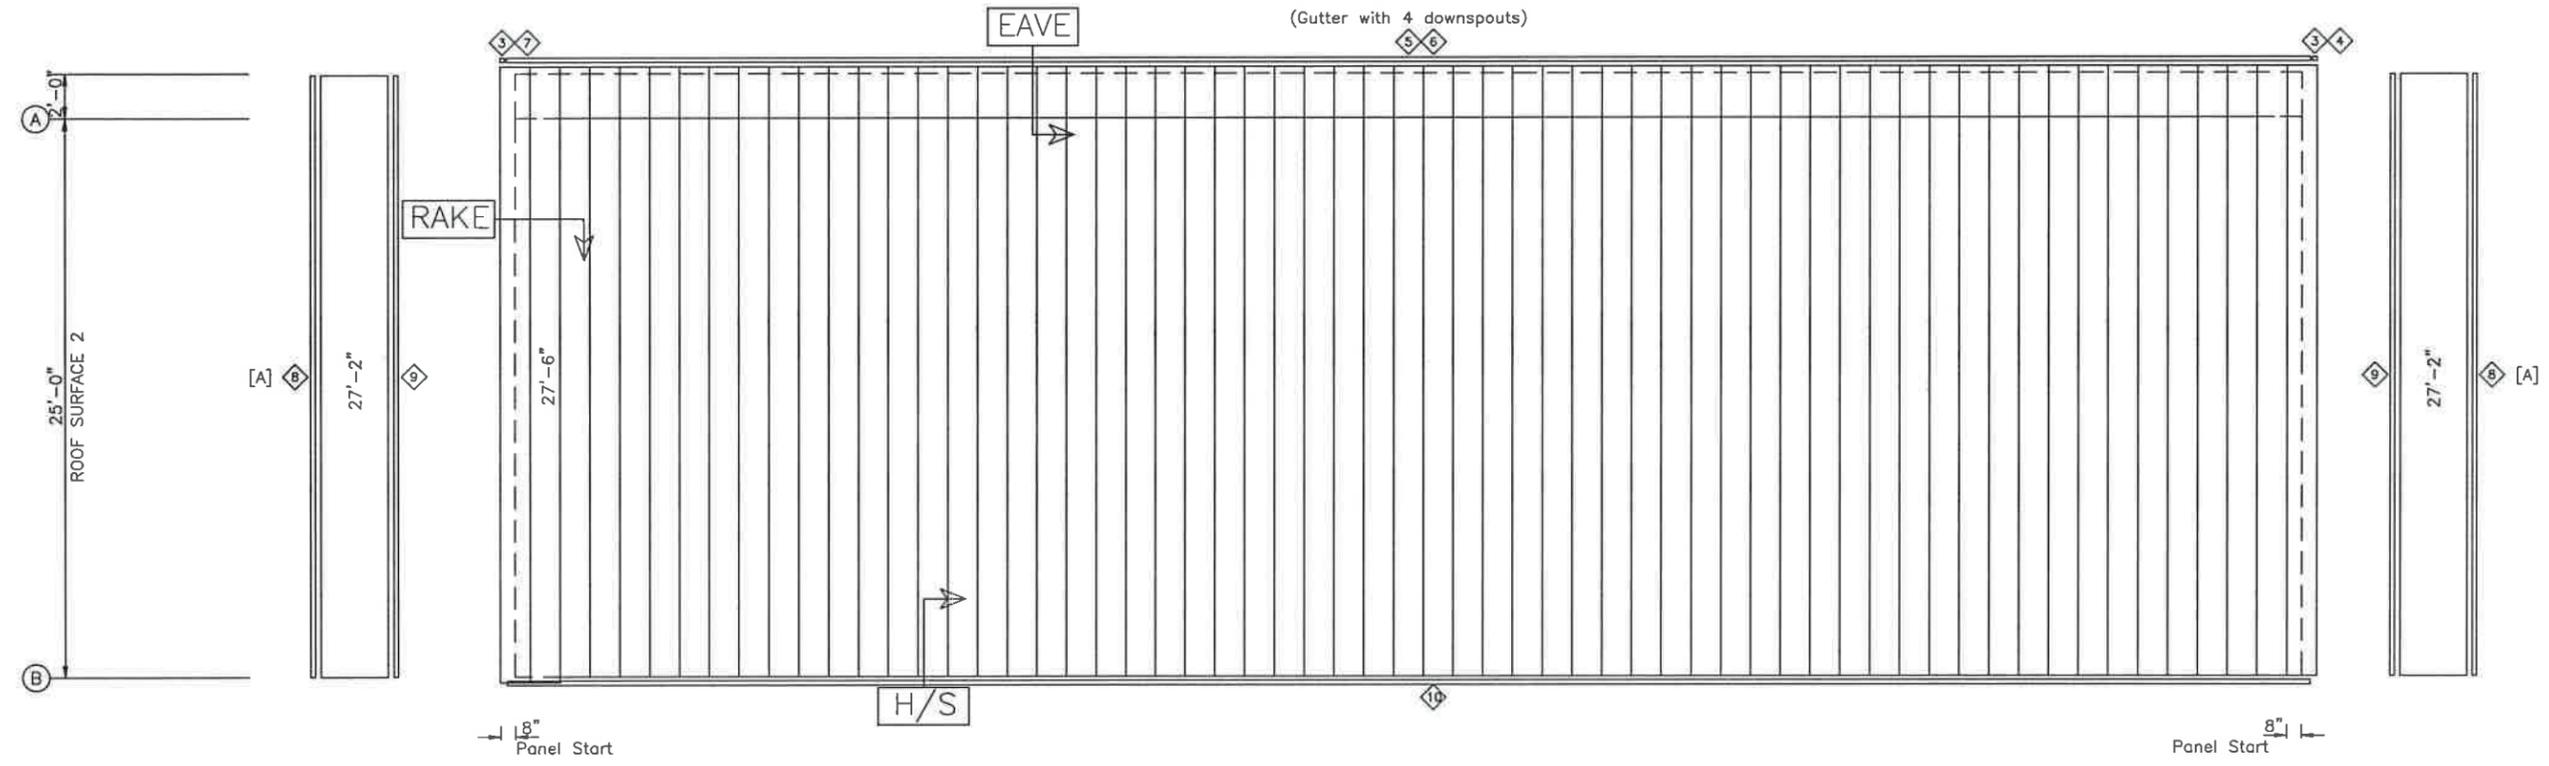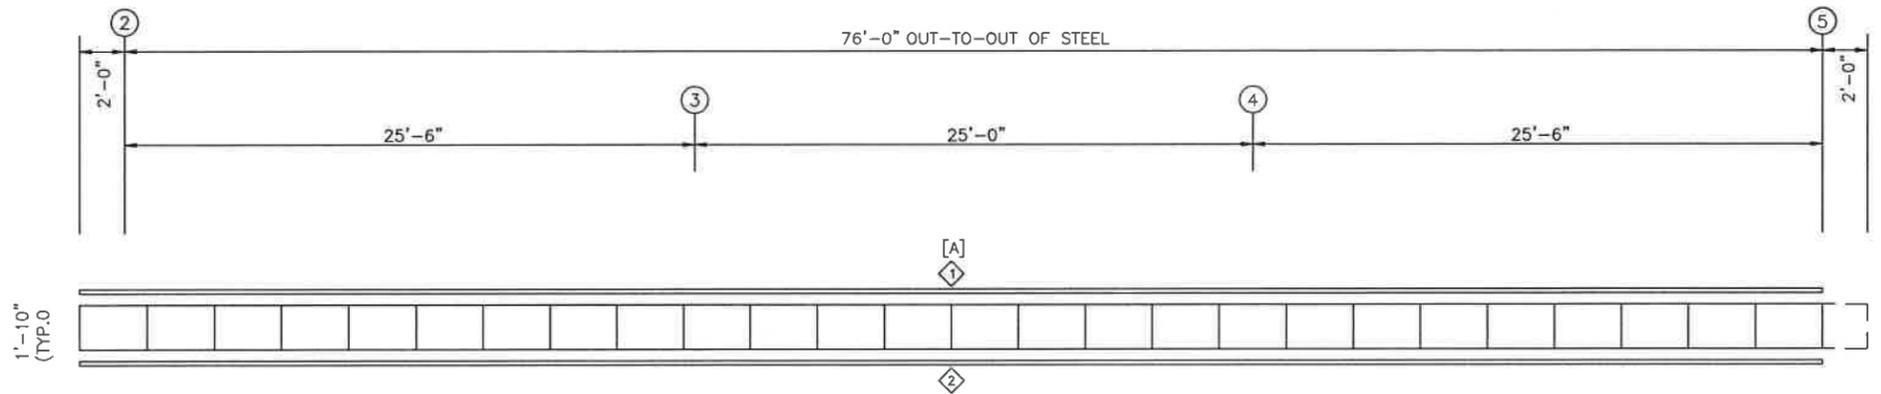

ROOF SHEETING PLAN
 PANELS: 24 Ga. PC216 - NEED COLOR
 [A] SOFFIT PANELS: 26 GA. PBR - NEED COLOR

| | | | |
|--------------------------------------|-------------------|--------------------|----------------|
| BUILDING "B" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNICAL SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF PANELS & TRIM | | | |
| DRAWING NO: PAGE 6B | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |


| TRIM TABLE | | | |
|------------|----------|---------|---------|
| ROOF PLAN | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | SCT8 | 20'-3" | EAVE2 |
| 2 | SFT-3 | 19'-3" | TRIM_23 |
| 3 | FL245 | 1'-0" | |
| 4 | CORBOX L | 1'-0" | |
| 5 | FL248A | 20'-3" | EAVE2 |
| 6 | FL272 | 20'-3" | EAVE2 |
| 7 | CORBOX R | 1'-0" | |
| 8 | RST8 | 13'-9" | RAKE2 |
| 9 | R HEAD | 12'-11" | RAKE2 |
| 10 | H/S FLSH | 19'-3" | H/S |

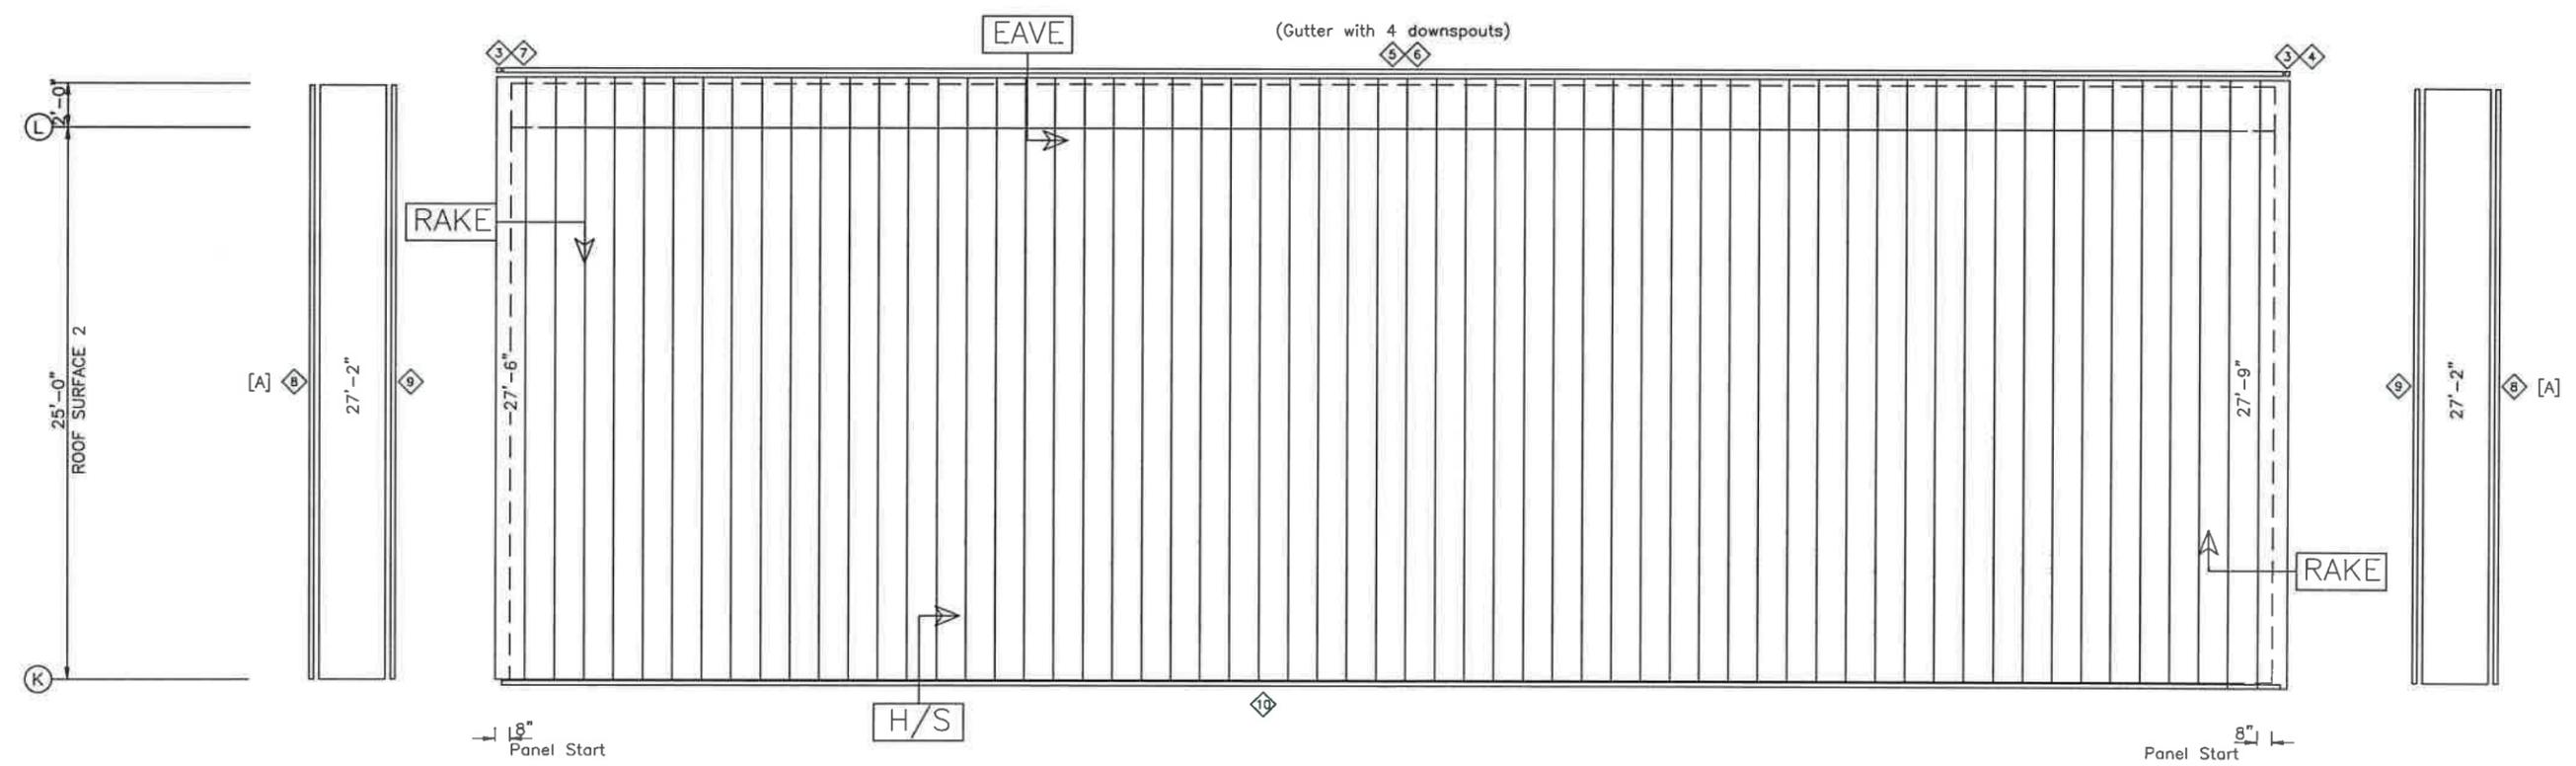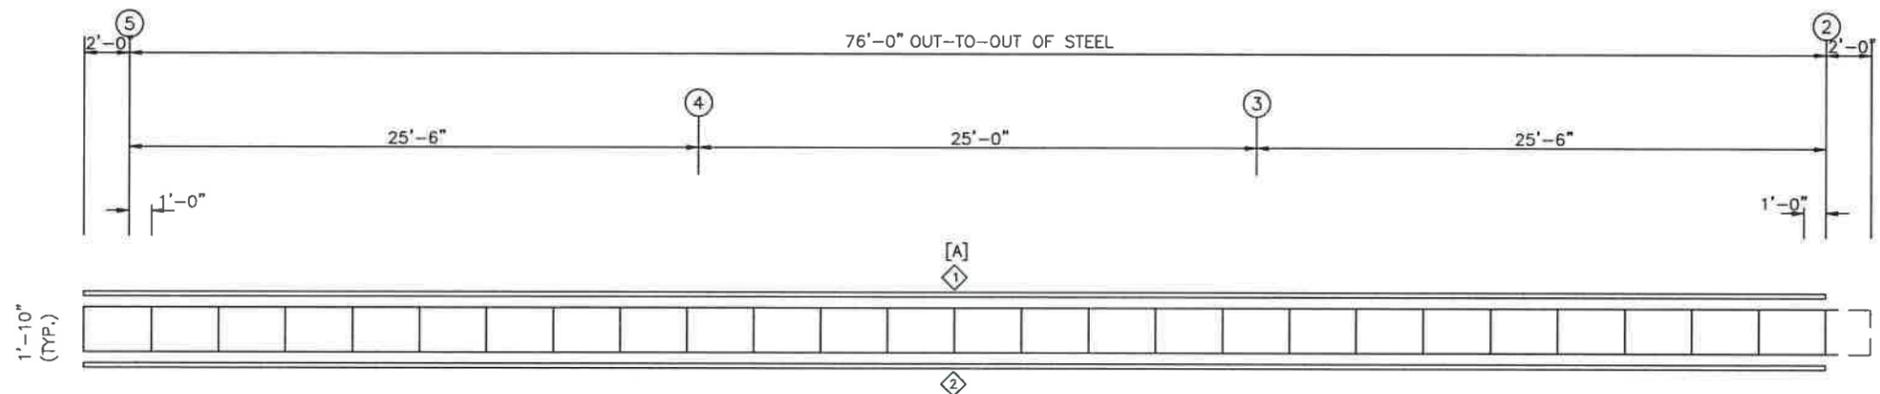

ROOF SHEETING PLAN
 PANELS: 24 Ga. PC216 - NEED COLOR
 [A] SOFFIT PANELS: 26 GA. PBR - NEED COLOR

| | | | |
|--------------------------------------|-------------------|--------------------|----------------|
| BUILDING "C" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNICAL SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF PANELS & TRIM | | | |
| DRAWING NO: PAGE 6C | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |


| TRIM TABLE | | | |
|------------|-----------|---------|---------|
| ROOF PLAN | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | RST8 | 2'-0" | RAKE2 |
| 2 | SFT-3 | 12'-3" | TRIM_23 |
| 3 | SCT8 | 14'-0" | EAVE2 |
| 4 | RIDG FLSH | 7'-2" | |
| 5 | GUT END | 1" | |
| 6 | CORBOX L | 1'-0" | |
| 7 | GUTTER | 14'-0" | EAVE2 |
| 8 | EAVE TRM | 14'-0" | EAVE2 |
| 9 | CORBOX R | 1'-0" | |
| 10 | RST8 | 15'-8" | RAKE2 |
| 11 | RST8 | 17'-8" | RAKE2 |
| 12 | R HEAD | 15'-11" | |
| 13 | REV RIDGE | 2'-3" | RR |

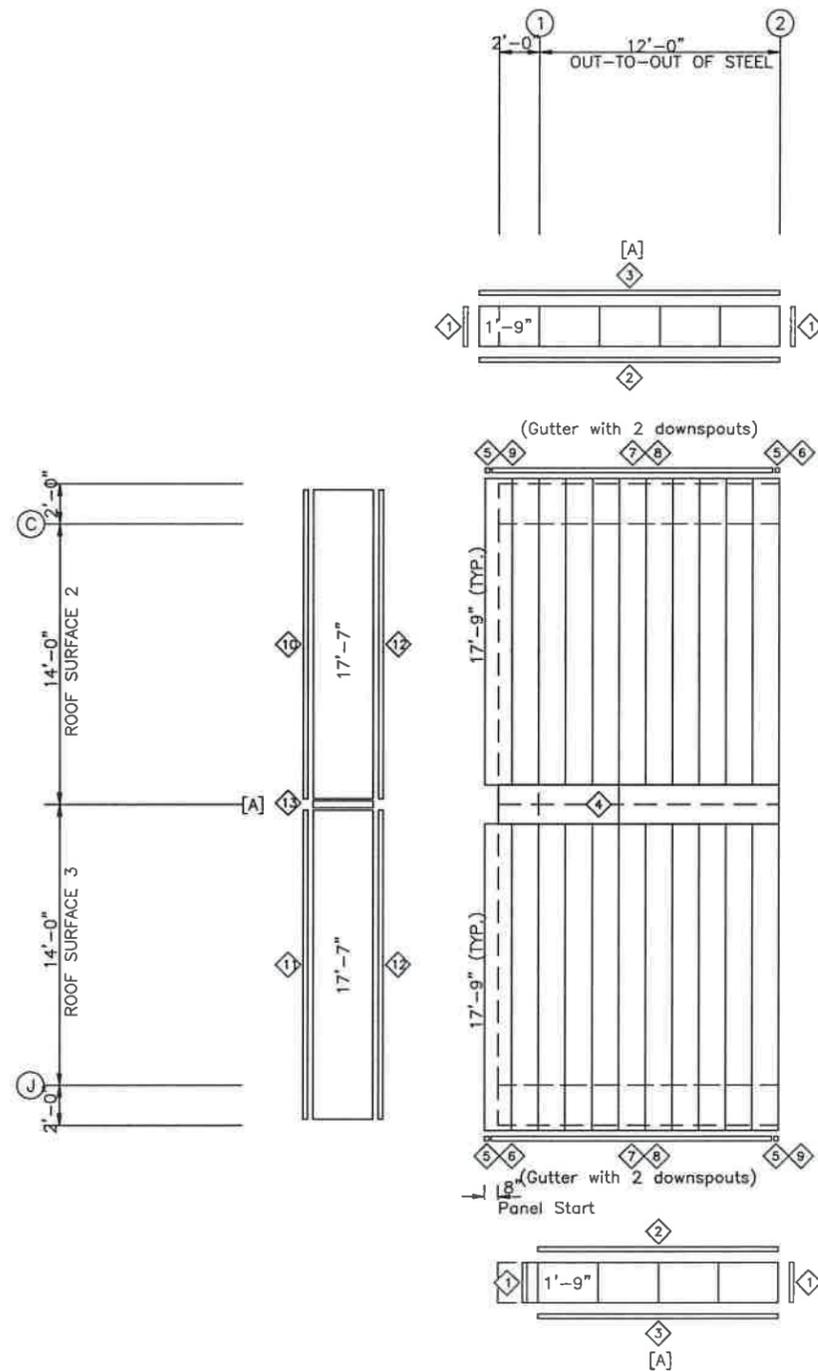


ROOF SHEETING PLAN
 PANELS: 24 Ga. PC216 - NEED COLOR
 [A] SOFFIT PANELS: 26 GA. PBR - NEED COLOR

| | | | |
|--------------------------------------|-------------------|--------------------|----------------|
| BUILDINGS "D" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNICAL SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF PANELS & TRIM | | | |
| DRAWING NO: PAGE 6D | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

RAKE

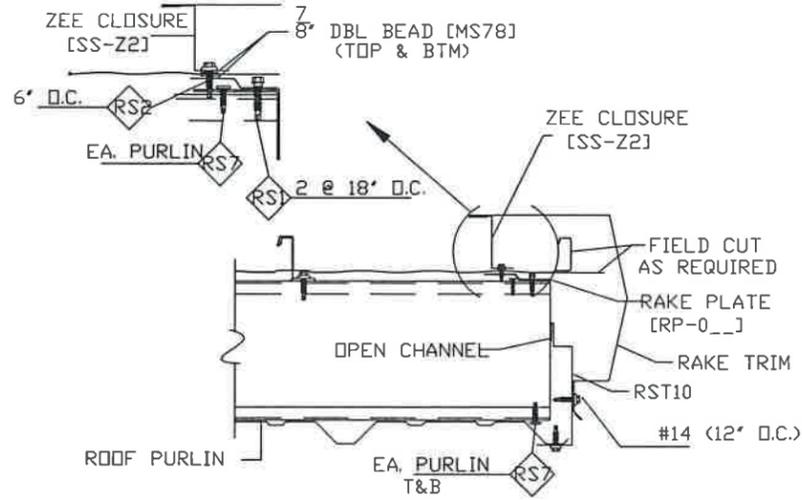


SECTION THRU RAKE
(WITHOUT WALL PANEL)

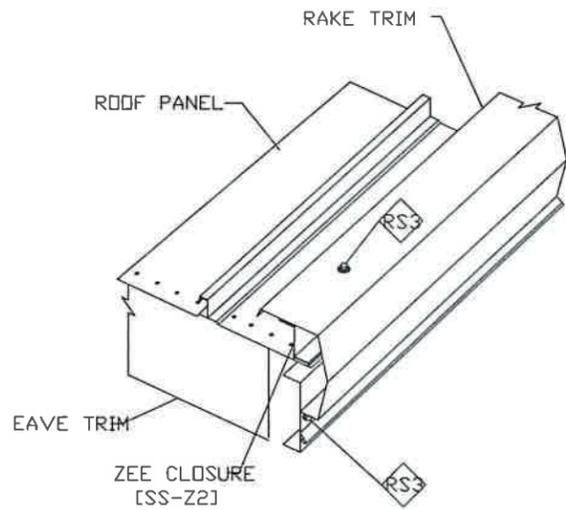


ISOMETRIC VIEW OF RAKE

PEAK

* = 3/8" OR 3/8" STANDOFF

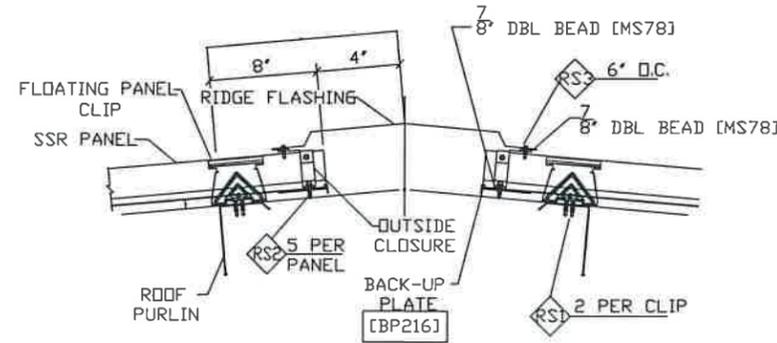


SECTION THRU RIDGE
POSITION RIDGE COVER SO EXPOSED

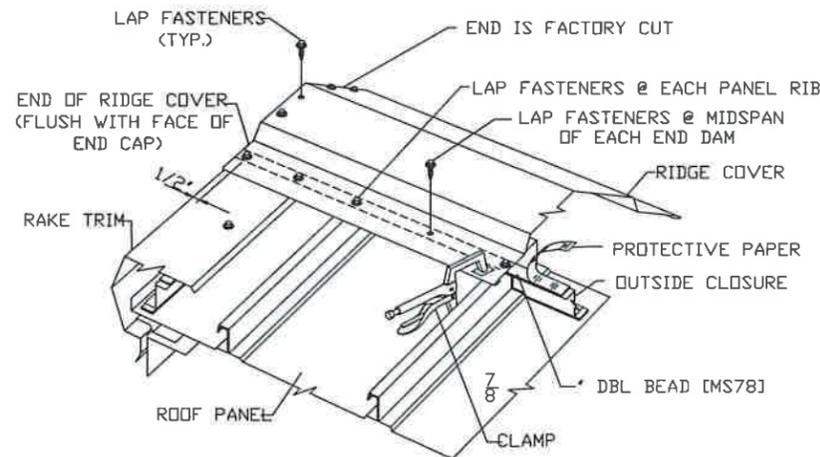


ISOMETRIC VIEW OF RIDGE

EAVE

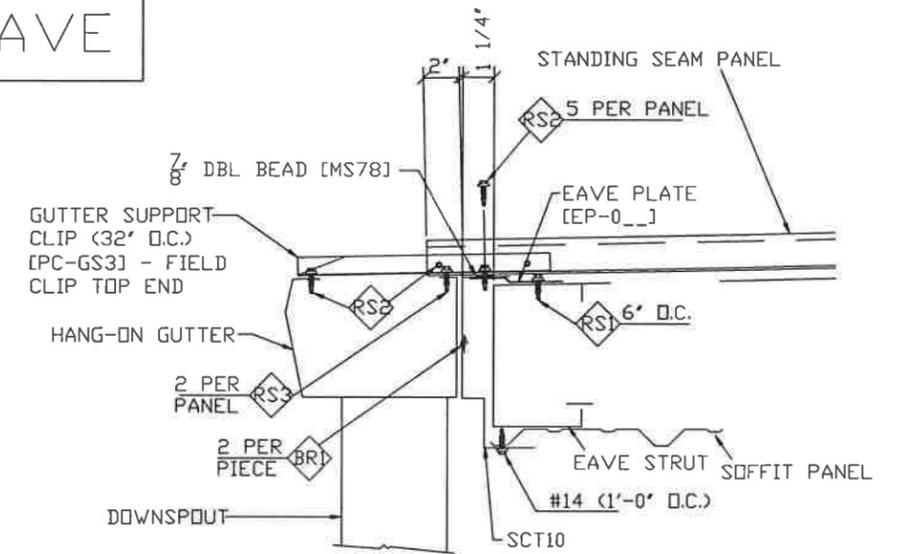

USE POP RIVETS AS REQ'D TO SUPPORT FLASHING UNTIL SCREWS CAN BE INSTALLED

SECTION THRU EAVE WITH NORTHERN GUTTER
(WITHOUT WALL PANEL)

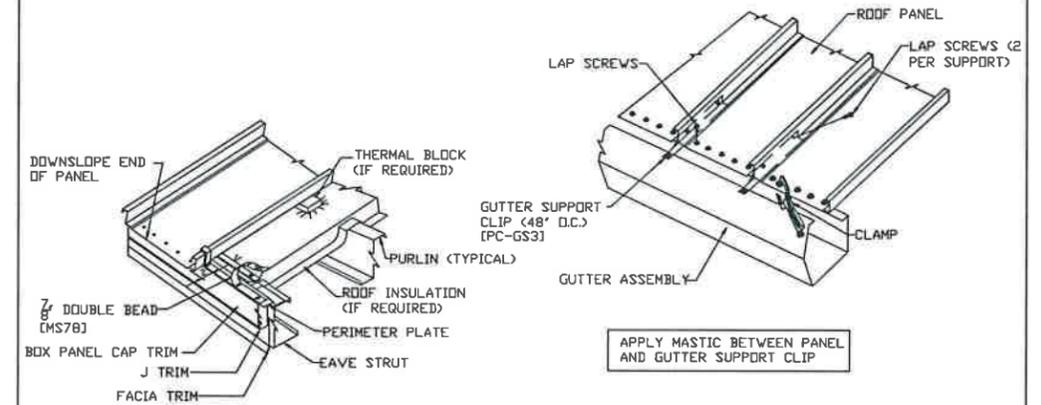


APPLY MASTIC BETWEEN PANEL AND GUTTER SUPPORT CLIP

ISOMETRIC VIEW OF EAVE


ROOF SCREW LEGEND

- | | |
|-----------------------------------|-------------------------------|
| RS1 1/4"-14x1 1/4" DRILLER WDW | RS7 12x1" PANCAKE |
| RS2 1/4"-14x1 1/4" L.L. DRILLER | RS8 #17x1" SELF TAPPER |
| RS3 1/4"-14x7/8" L.L. LAPTEK | BR 1/8"x3/16" RIVET |
| RS4 1/4"-14x1 1/4" SHOULDER TEK2 | WS1 12-14x1 1/4" L.L. DRILLER |
| RS5 12-24x1 1/4" TEK4.5 DRILLER | WS2 1/4"-14x7/8" L.L. LAPTEK |
| RS6 1/4"-20x1 1/4" SHOULDER TEK 4 | |


| | | | |
|--------------------------------------|------------------|--------------------|----------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO. 9249R1 | DATE 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF PANELS & TRIM | | | |
| DRAWING NO. PAGE 6.1 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

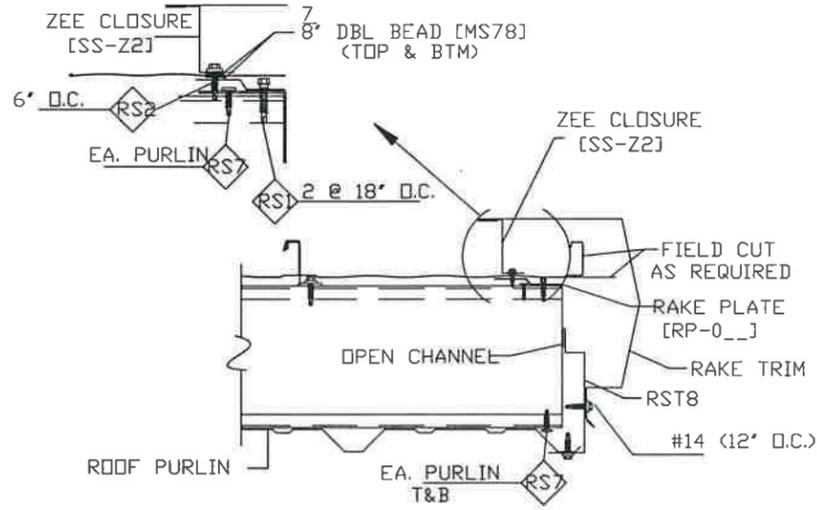

SECTION THRU RAKE (WITHOUT WALL PANEL)

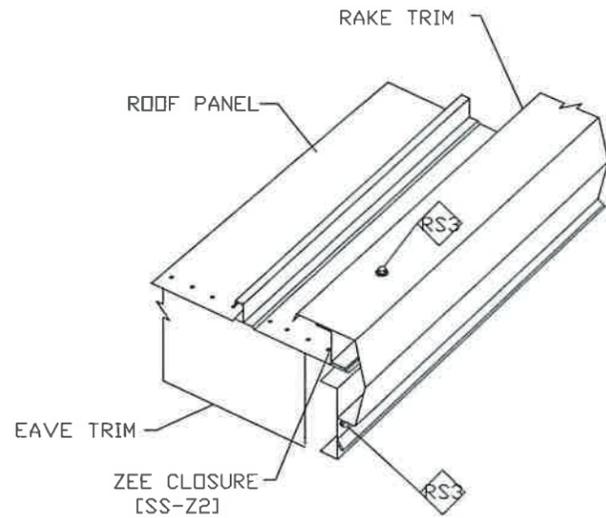


ISOMETRIC VIEW OF RAKE

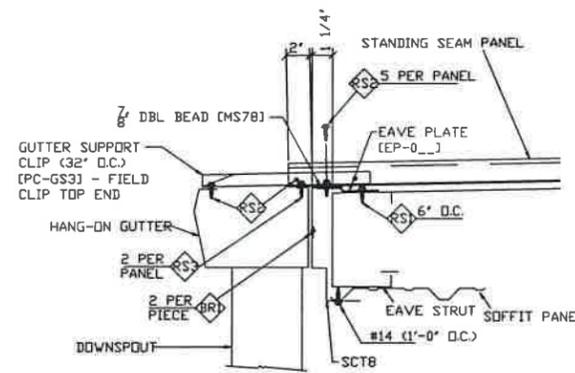

USE POP RIVETS AS REQ'D TO SUPPORT FLASHING UNTIL SCREWS CAN BE INSTALLED

SECTION THRU EAVE WITH NORTHERN GUTTER (WITHOUT WALL PANEL)

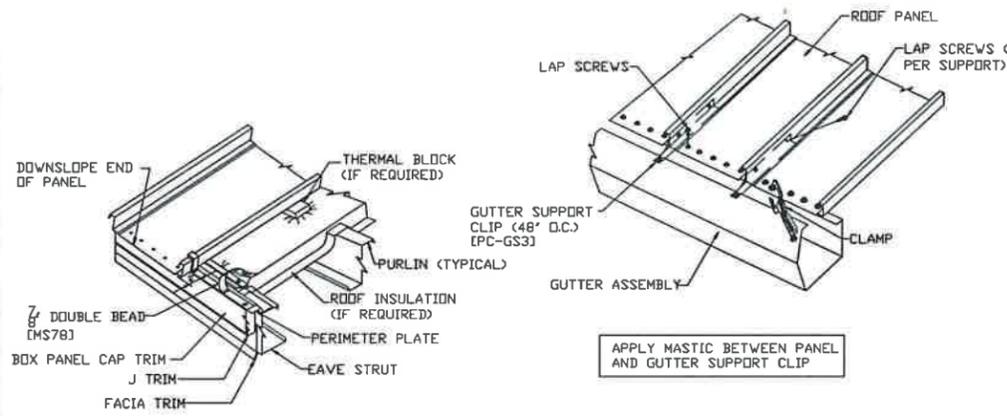


APPLY MASTIC BETWEEN PANEL AND GUTTER SUPPORT CLIP

ISOMETRIC VIEW OF EAVE


ROOF SCREW LEGEND

- RS1 1/4"-14x1 1/4" DRILLER WDW
- RS2 1/4"-14x1 1/4" L.L. DRILLER
- RS3 1/4"-14x7/8" L.L. LAPTEK
- RS4 1/4"-14x1 1/4" SHOULDER TEK2
- RS5 12-24x1 1/4" TEK4.5 DRILLER
- RS6 1/4"-20x1 1/4" SHOULDER TEK 4
- RS7 12x1" PANCAKE
- RS8 #17x1" SELF TAPPER
- BR1 1/8"x3/16" RIVET
- WS1 12-14x1 1/4" L.L. DRILLER
- WS2 1/4"-14x7/8" L.L. LAPTEK

* = 3/8" OR 3/4" STANDOFF

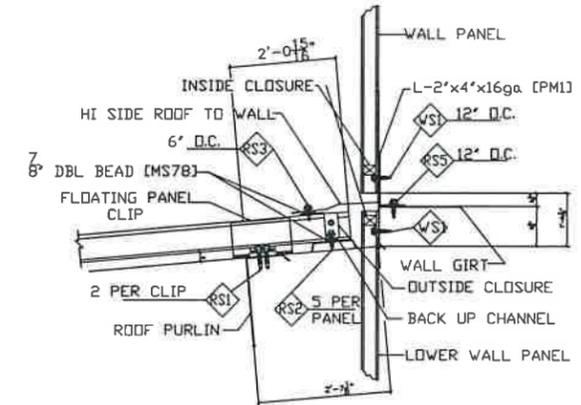


SECTION THRU HIGH EAVE ROOF TO WALL (WITH WALL PANEL CONTINUATION)

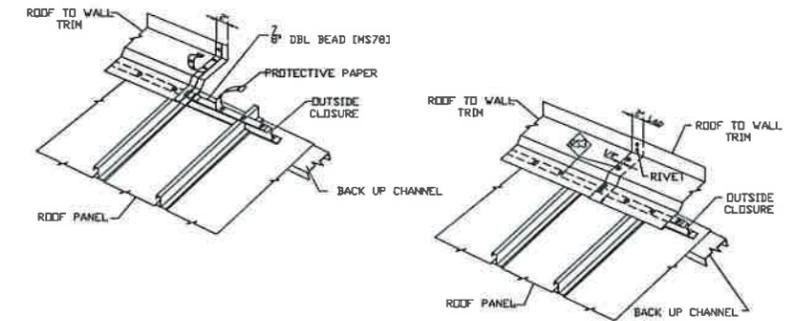


ISOMETRIC VIEW OF HI EAVE ROOF TO WALL

| | | | |
|-----------------------------------|----------------|-----------------|-------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF PANELS & TRIM | | | |
| DRAWING NO: PAGE 6.2 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

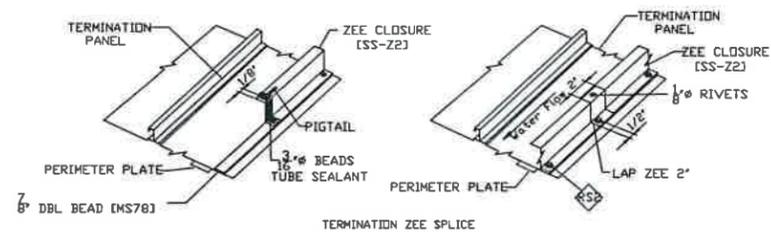


TERMINATION ZEE SPLICE

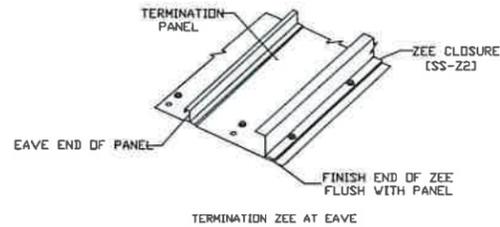


TERMINATION ZEE AT EAVE


ISOMETRIC VIEW OF ZEE CLOSURE SPLICE AT PANEL

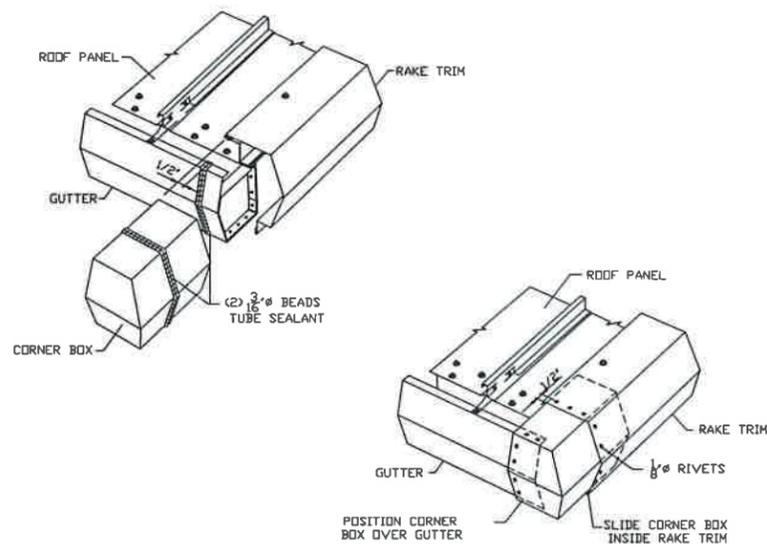

ISOMETRIC VIEW OF CORNER BOX INSTALLATION

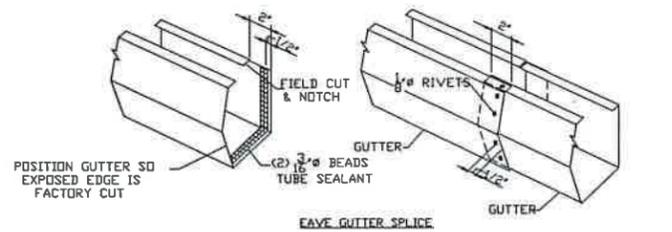


EAVE GUTTER SPLICE

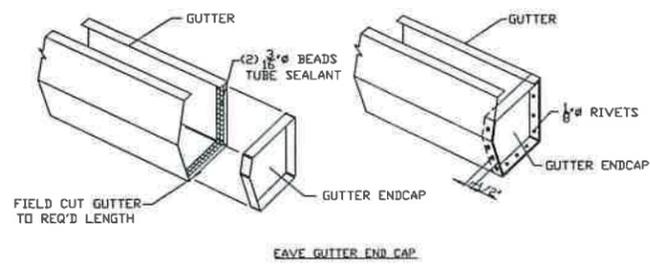



EAVE GUTTER END CAP

ISOMETRIC VIEW OF GUTTER SPLICE

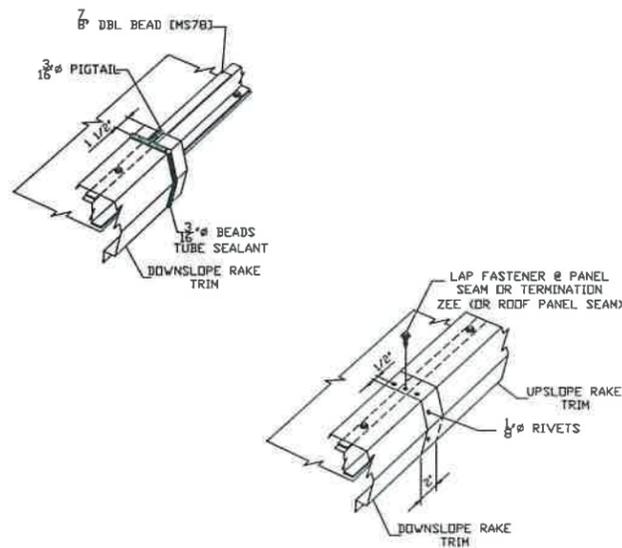


ISOMETRIC VIEW OF RAKE SPLICE


| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ROOF PANELS & TRIM | | | |
| DRAWING NO: PAGE 6.3 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

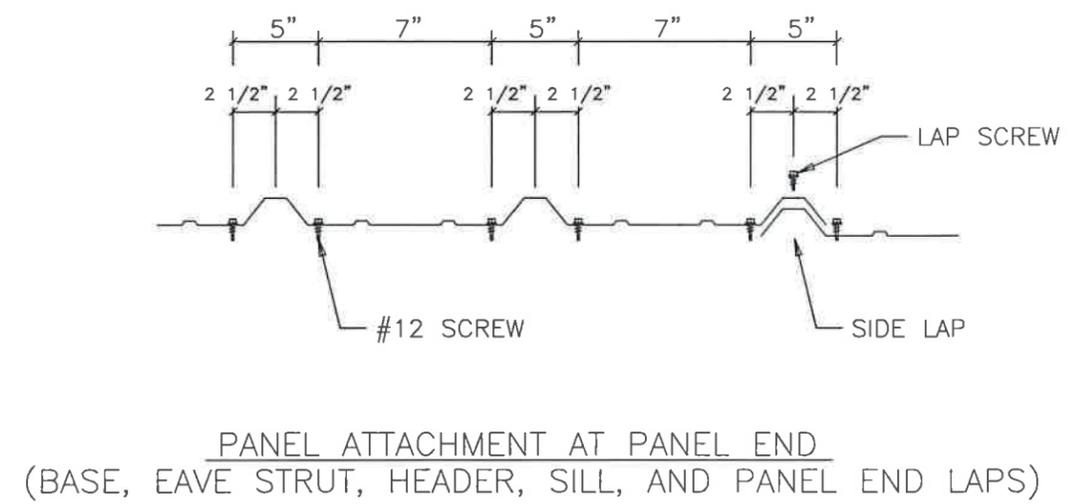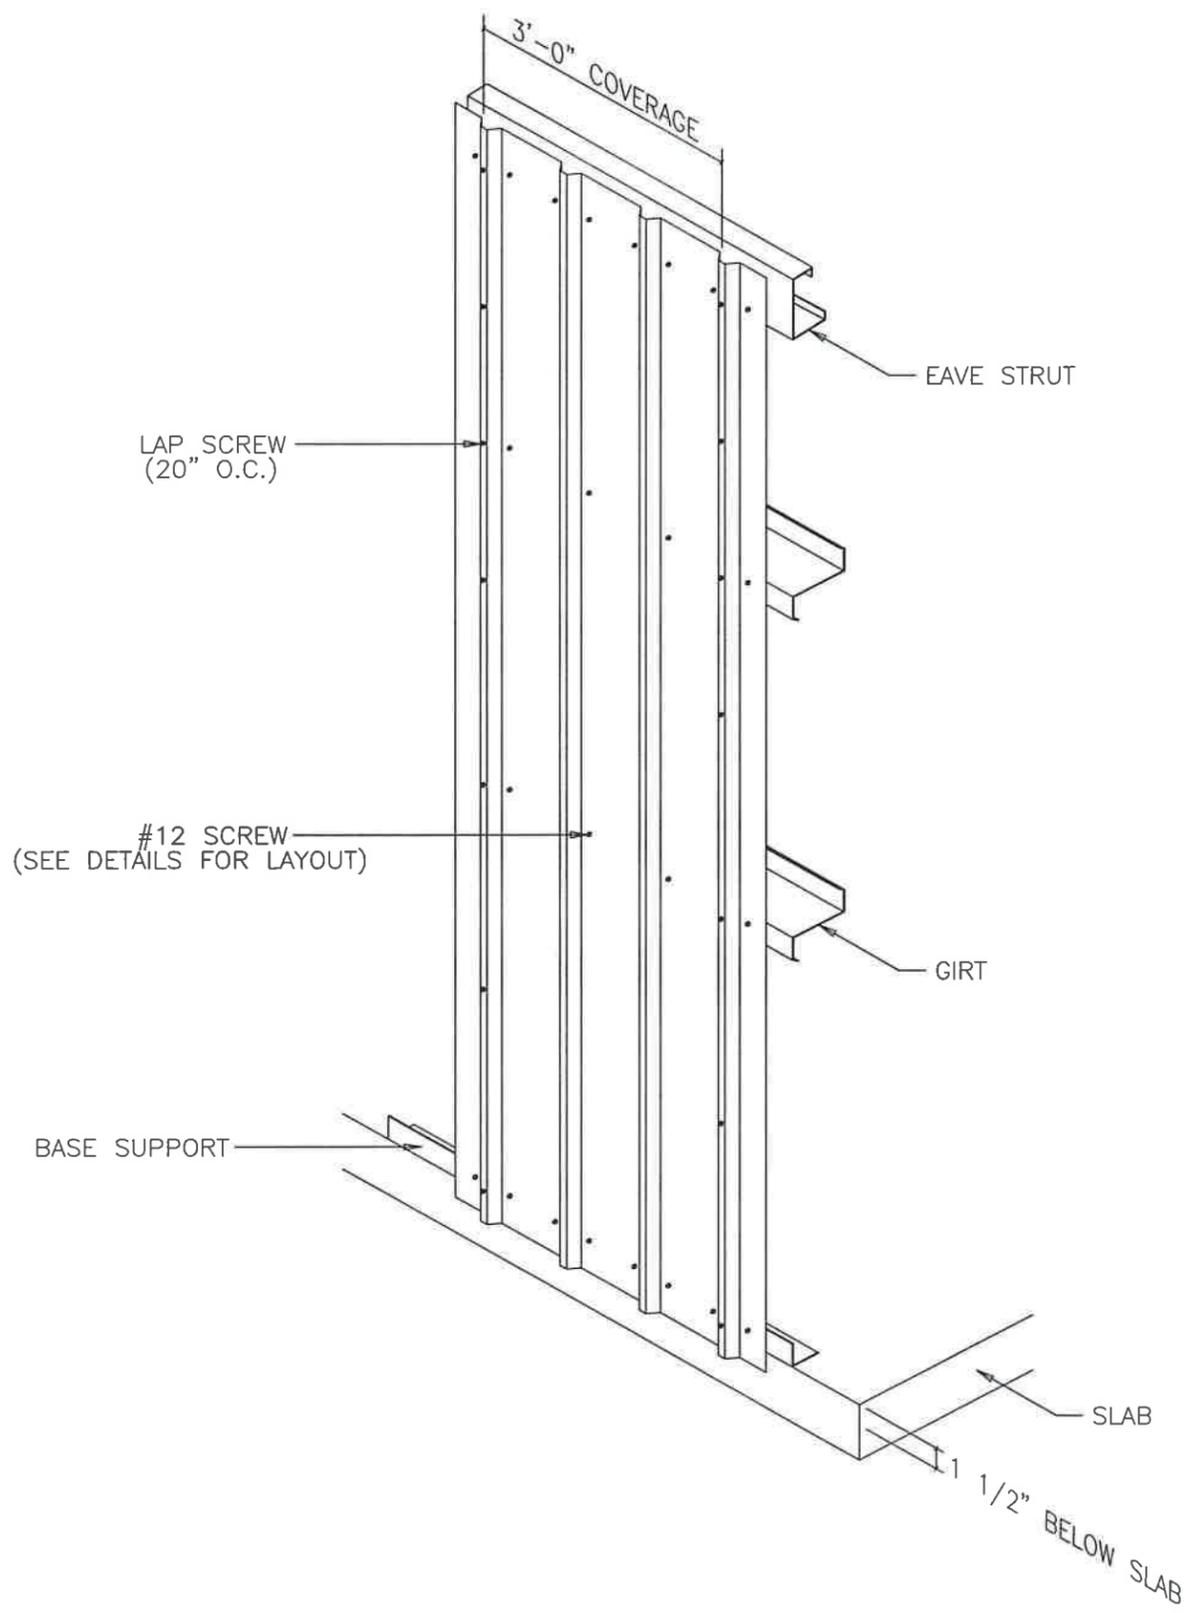

PANEL ATTACHMENT AT PANEL END
(BASE, EAVE STRUT, HEADER, SILL, AND PANEL END LAPS)

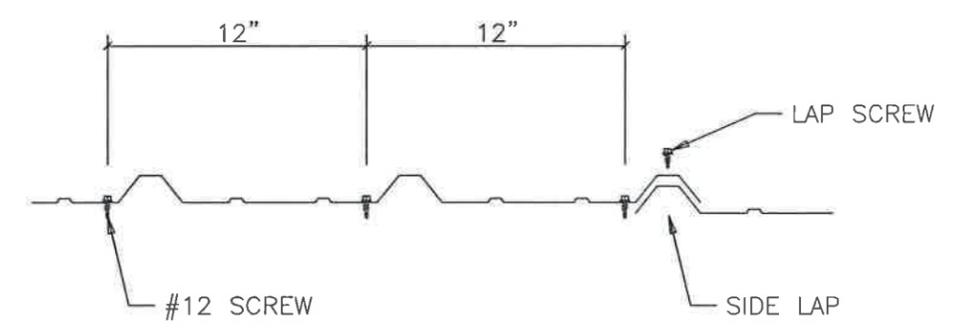



PANEL ATTACHMENT AT INTERMEDIATE MEMBERS

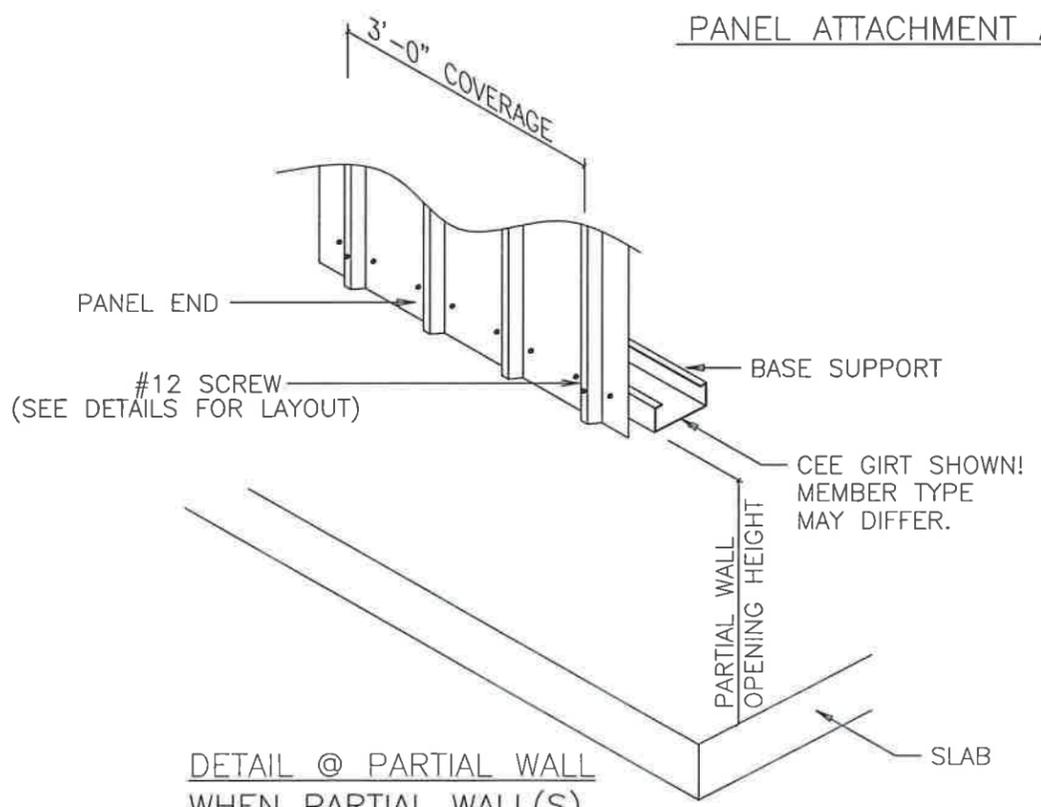


DETAIL @ PARTIAL WALL
WHEN PARTIAL WALL(S)
ARE PRESENT

- NOTES:
- [1] METAL SHAVINGS MUST BE SWEEPED FROM THE WALL EACH DAY DURING ERECTION TO PREVENT SURFACE RUSTING.
 - [2] #12 SCREWS ARE USED TO ATTACH THE PANEL TO THE GIRTS. #14 LAP SCREWS ARE USED AT THE PANEL-TO-PANEL ATTACHMENTS. ALL FASTENERS ARE SELF-DRILLING.


| ISSUE | DET | CHK | DATE |
|--------------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SIDEWALL PANEL DETAILS | | | |
| DRAWING NO: PAGE 7 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

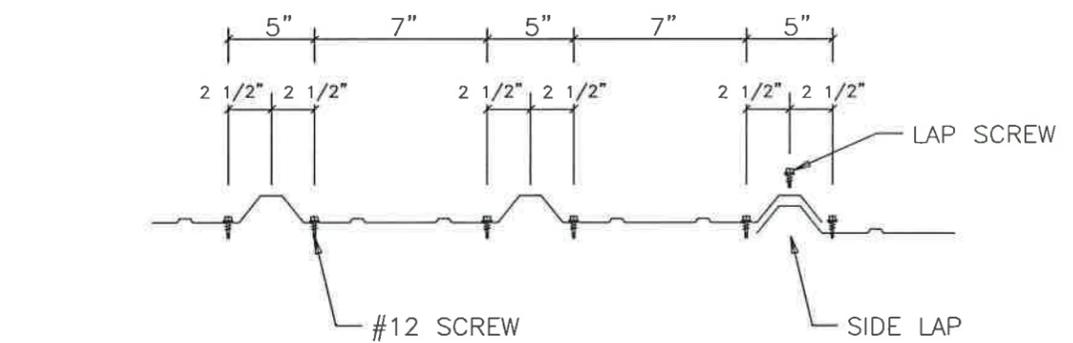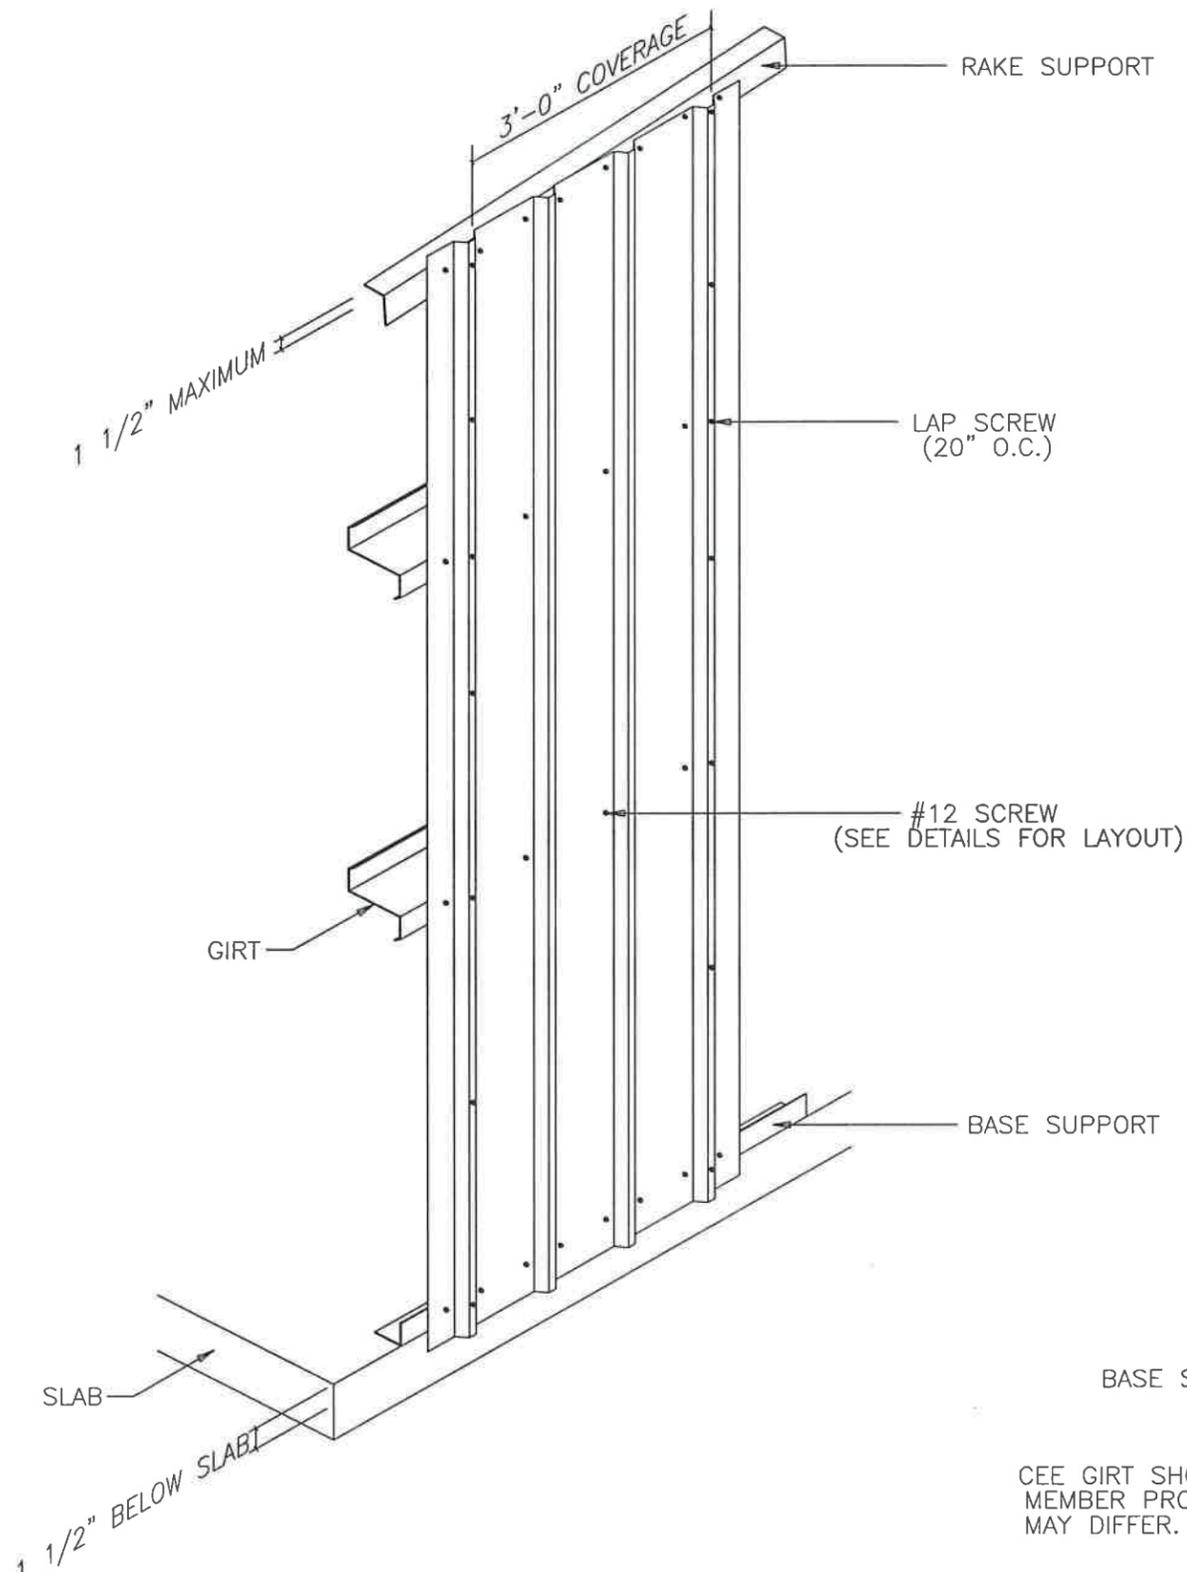

PANEL ATTACHMENT AT PANEL END
 (BASE, EAVE STRUT, HEADER, SILL, AND PANEL END LAPS)

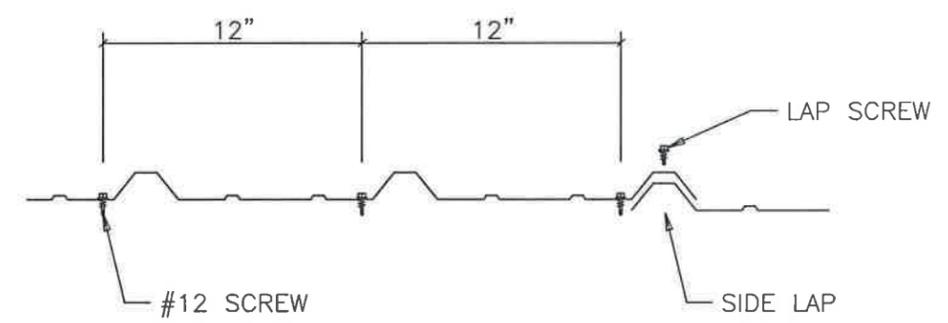


PANEL ATTACHMENT AT INTERMEDIATE MEMBERS

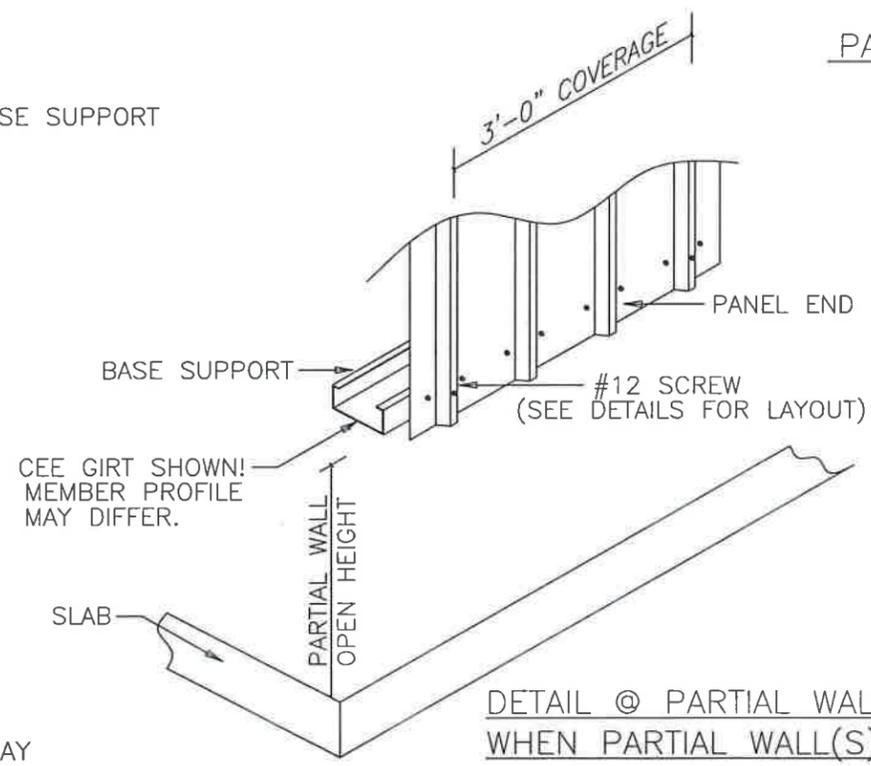


DETAIL @ PARTIAL WALL
WHEN PARTIAL WALL(S)
ARE PRESENT

- NOTES:
- [1] METAL SHAVINGS MUST BE SWEEPED FROM THE WALL EACH DAY DURING ERECTION TO PREVENT SURFACE RUSTING.
 - [2] #12 SCREWS ARE USED TO ATTACH THE PANEL TO THE GIRTS. #14 LAP SCREWS ARE USED AT THE PANEL-TO-PANEL ATTACHMENTS. ALL FASTENERS ARE SELF-DRILLING.


| ISSUE | DET | CHK | DATE |
|-------------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ENDWALL PANEL DETAILS | | | |
| DRAWING NO: PAGE 8 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

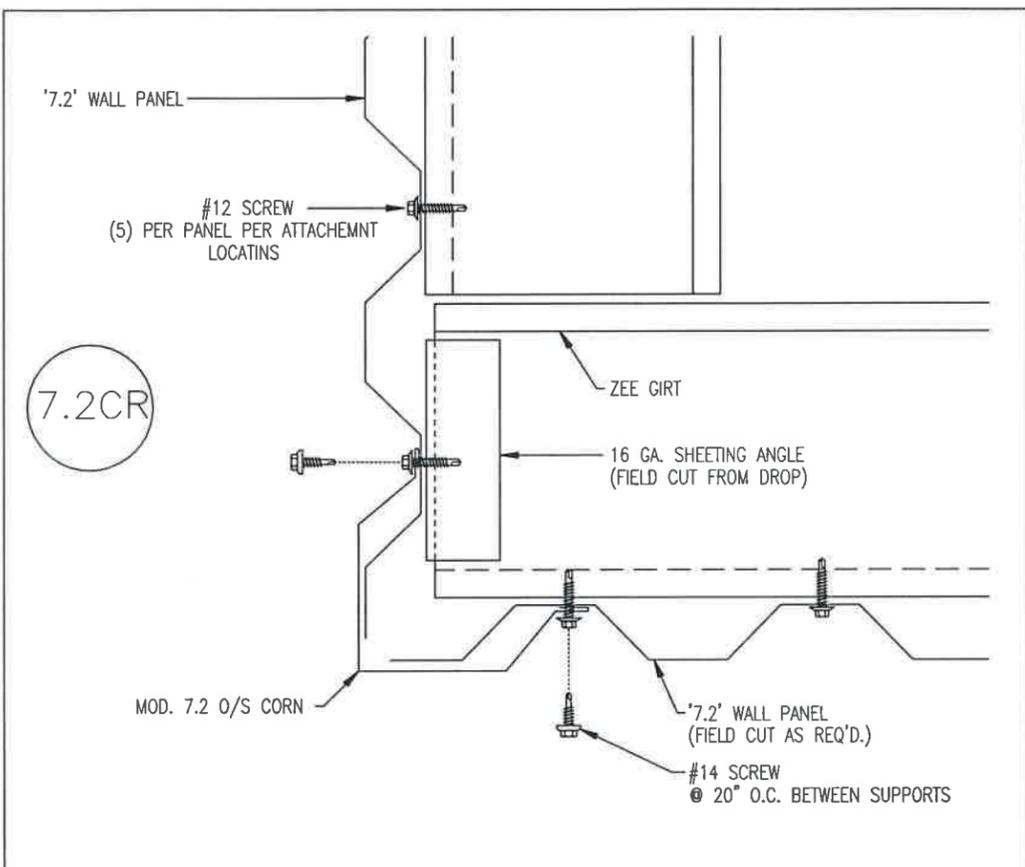


7.2CR

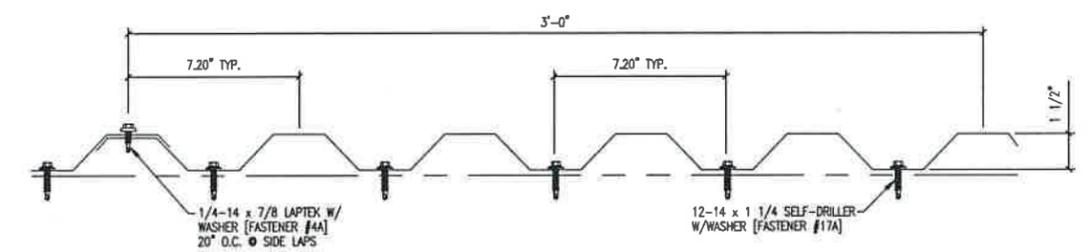


7.2 FASTENER SPACING @ PANEL ENDS & INTERMEDIATE SUPPORTS

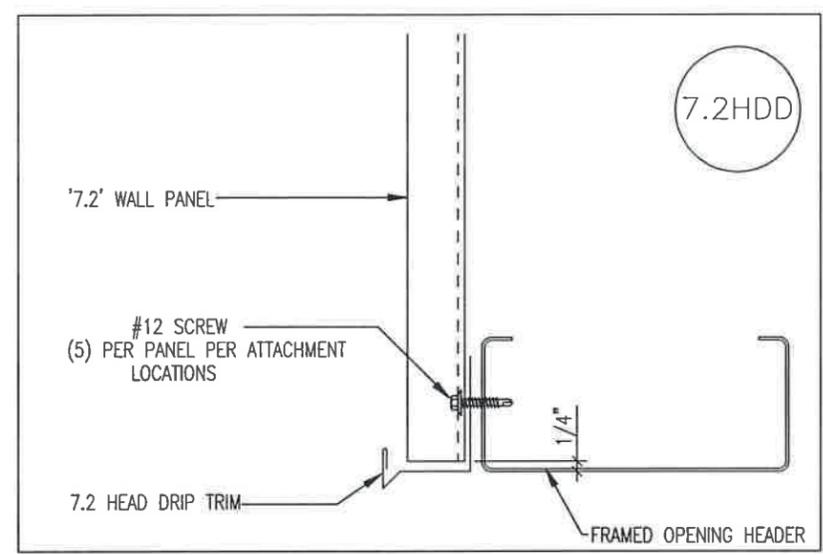


7.2HDD

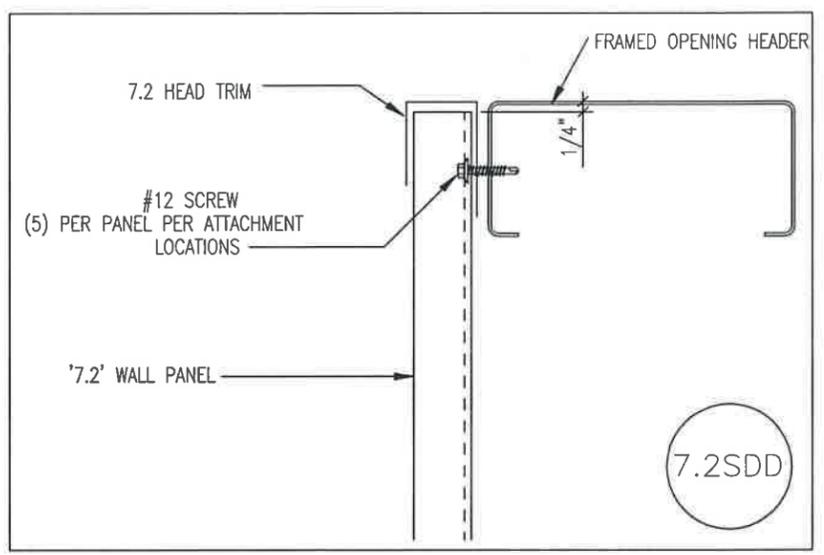

7.2SDD

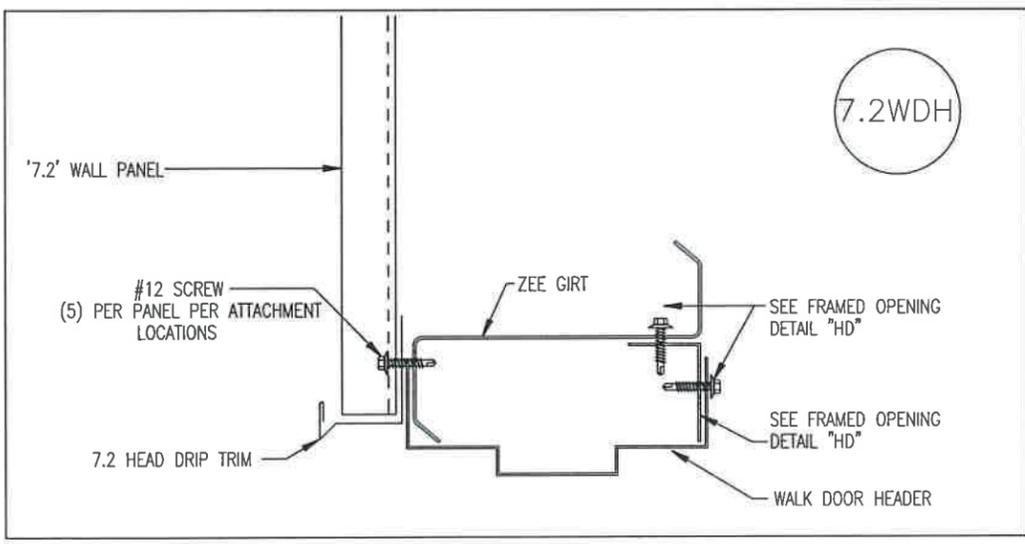


7.2WDH

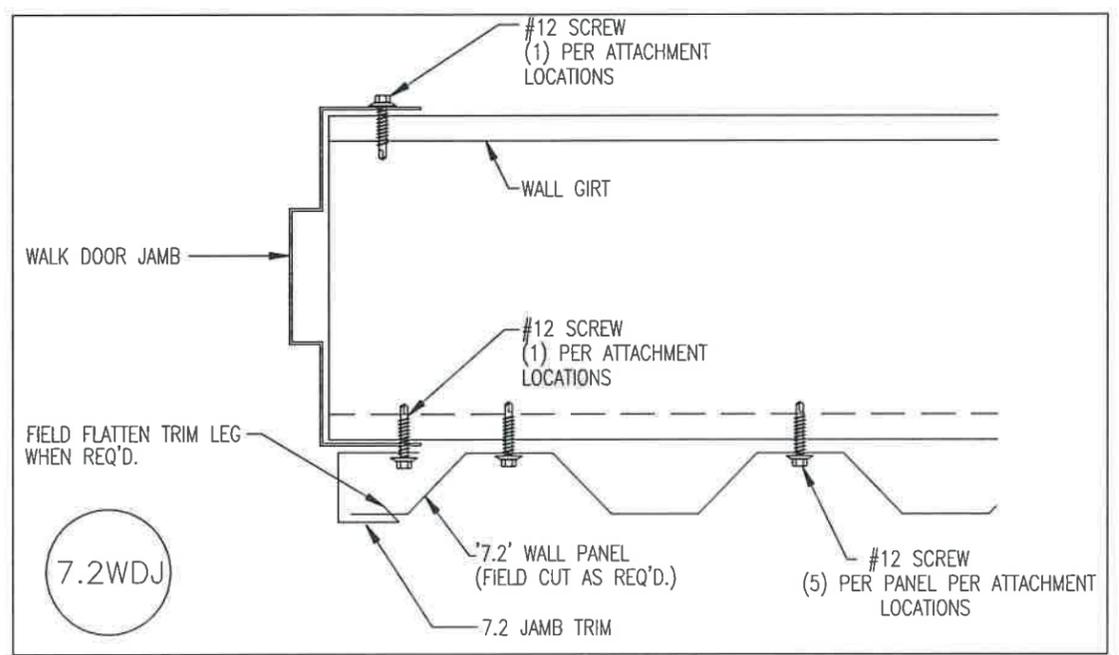

7.2WDJ

| ISSUE | DET | CHK | DATE |
|-------------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: ENDWALL PANEL DETAILS | | | |
| DRAWING NO: PAGE 8.1 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

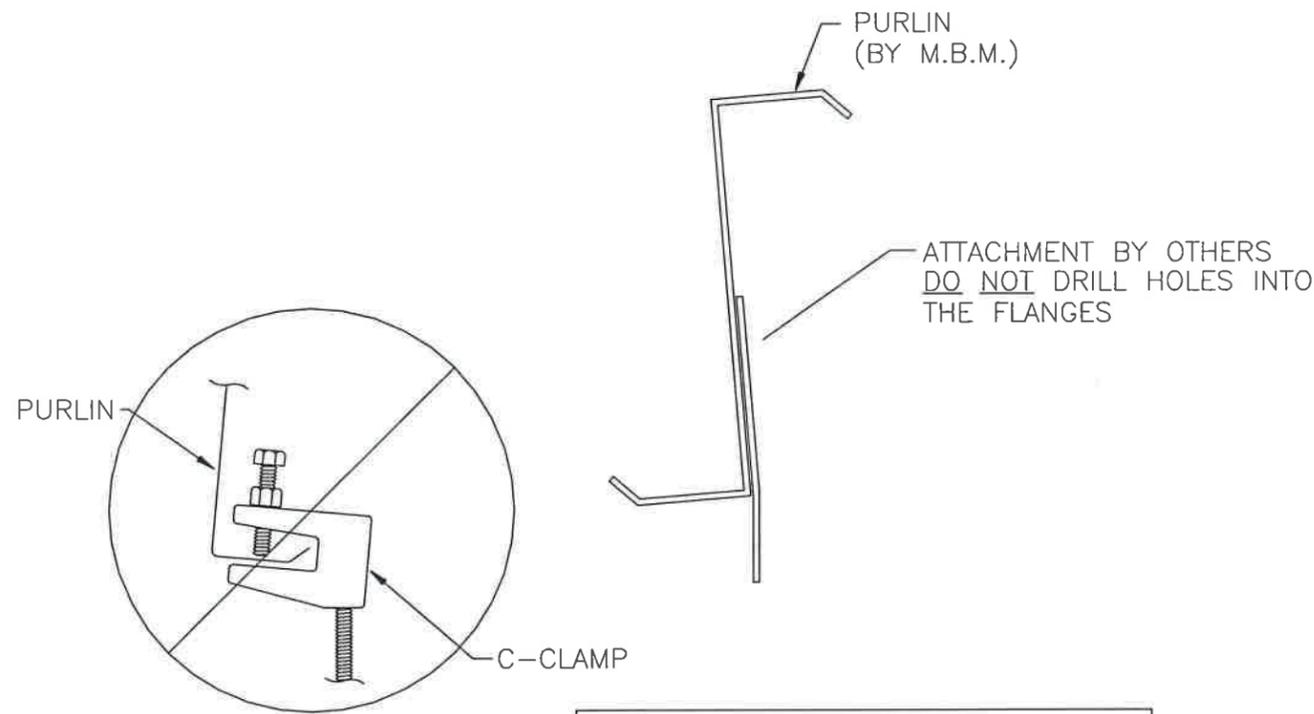

NOTE: M.B.M. only provides the roof purlin. All other material and hardware is by others.

Recommended Connection Detail


NOTE

MANY FACTORS BEYOND THE CONTROL OF THE METAL BUILDING SUPPLIER AFFECT THE ABILITY OF A PURLIN TO SAFELY SUPPORT HANGING LOADS COMBINED WITH OTHER REQUIRED ROOF LOADS. DUE TO THE VARIABLES INVOLVED IN HANGING LOADS AND THEIR ATTACHMENTS TO THE PURLINS, THE METAL BUILDING SUPPLIER CANNOT ASSURE THAT THE PURLINS FOR A PARTICULAR BUILDING PROJECT CAN SAFELY SUPPORT THE MAXIMUM ALLOWABLE HANGING LOADS IN COMBINATION WITH OTHER ROOF LOADS.



IT IS THE RESPONSIBILITY OF THE HANGER SYSTEM INSTALLER TO COORDINATE WITH THE ENGINEER OF RECORD FOR THE OVERALL PROJECT TO ENSURE A SAFE HANGING LOAD INSTALLATION. THE METAL BUILDING ENGINEER IS NOT THE ENGINEER OF RECORD FOR THE OVERALL PROJECT. WITHOUT SPECIFIC CERTIFICATION FOR INDIVIDUAL HANGING LOADS, THE NET EFFECTS OF APPLIED HANGER LOADS INSTALLED ON A PARTICULAR PURLIN SHALL NOT EXCEED THE NET EFFECTS OF THE CERTIFIED UNIFORMLY APPLIED DESIGN COLLATERAL LOAD.

HANGING LOADS SHOULD NOT BE APPLIED TO THE PURLIN LIP. WHERE PERMISSIBLE, THE BEST PRACTICE FOR HANGING LOADS IS TO ATTACH TO THE PURLIN WEB USING A BOLT AND NUT, OR SELF-DRILLING SCREWS.

HANGING UNIFORM LOADS SUCH AS SPRINKLER MAINS OR HVAC EQUIPMENT SHOULD BE DISTRIBUTED OVER SEVERAL PURLINS, AND SHOULD NEVER EXCEED THE COLLATERAL LOAD ALLOWANCE FOR THE ROOF SYSTEM. FOR UNIFORM LOADS THAT RUN PARALLEL TO THE PURLINS, IT MAY BE NECESSARY TO USE TRANSVERSE SUPPORT CHANNELS (A.K.A. TRAPEZE BEAMS) ATTACHED TO THE WEBS OR FLANGES OF ADJACENT PURLINS TO SPREAD THE LOAD BETWEEN TWO OR MORE PURLINS. IN SUCH CASES, CONTACT THE BUILDING MANUFACTURER OR A LOCAL PROFESSIONAL ENGINEER PRIOR TO ATTEMPTING TO HANG LOADS FROM THE PURLINS

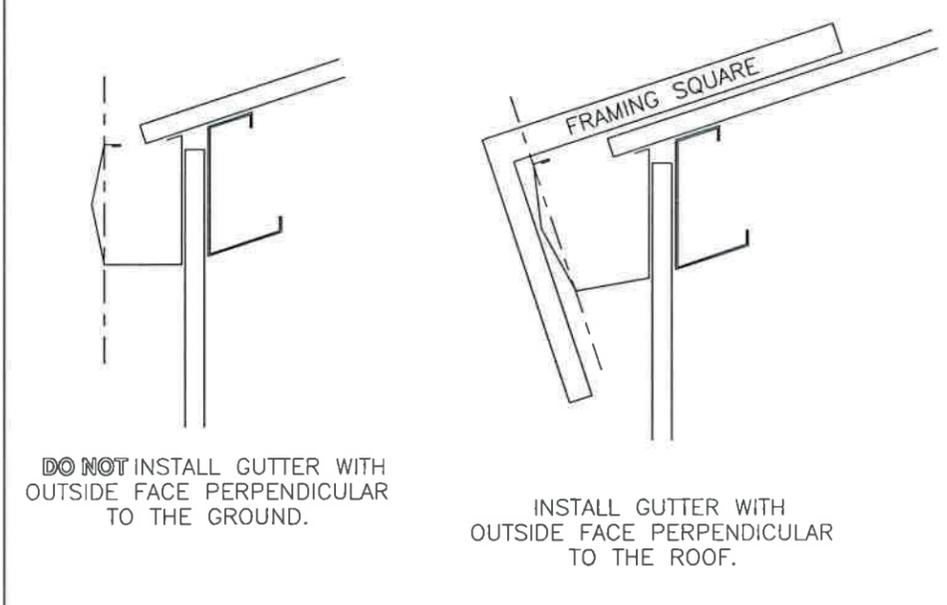

GUTTER INSTALLATION DETAIL
(ONLY IF PROVIDED)

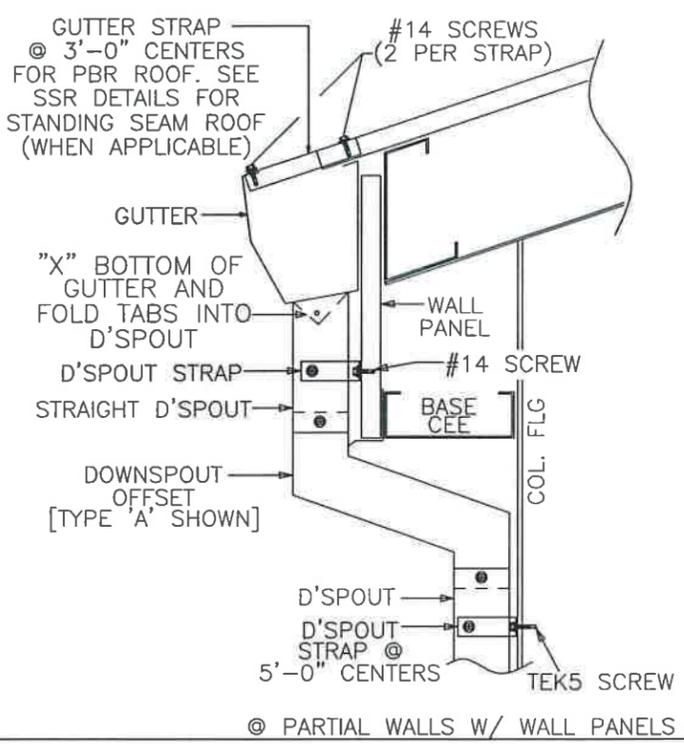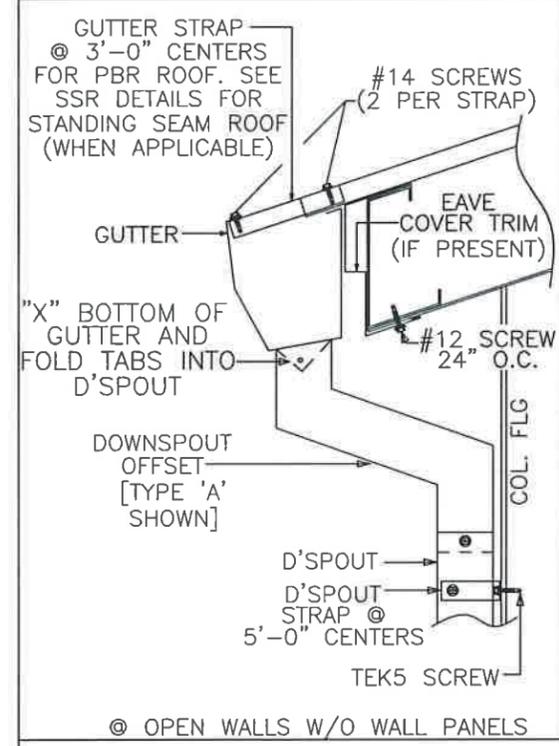


NOTE: REGARDLESS OF DOWNSPOUT OFFSET SCENARIO, TEK5 SCREWS MUST BE USED TO ATTACH DOWNSPOUT STRAPS TO PEMB FRAMING. WHEN WALL PANELS SPAN FROM GROUND TO EAVE (FULL SPAN), #14 SCREWS WILL BE USED TO ATTACH DOWNSPOUT STRAPS TO WALL PANELS.



| ISSUE | DET | CHK | DATE |
|-----------------------------------|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: SPECIAL DETAILS | | | |
| DRAWING NO: PAGE 9 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| TRIM TABLE PARTITION 1 | | | |
|---------------------------|------------|---------|---------|
| ID | PART | LENGTH | DETAIL |
| 1 | R JAMB | 7'-5" | TRIM_8 |
| 2 | R HEAD | 6'-7" | TRIM_61 |
| 3 | R JAMB | 7'-5" | TRIM_8 |
| 4 | R HEAD | 6'-7" | TRIM_7 |
| 5 | DLBASTR | 16'-11" | TRIM_22 |
| 6 | PRT10 | 4'-7" | PRT |
| 7 | PWT | 4'-7" | PWT |
| 8 | O/S CORNER | 10'-8" | PRT |


SEE PAGE 12 FOR MEZZANINE INFORMATION

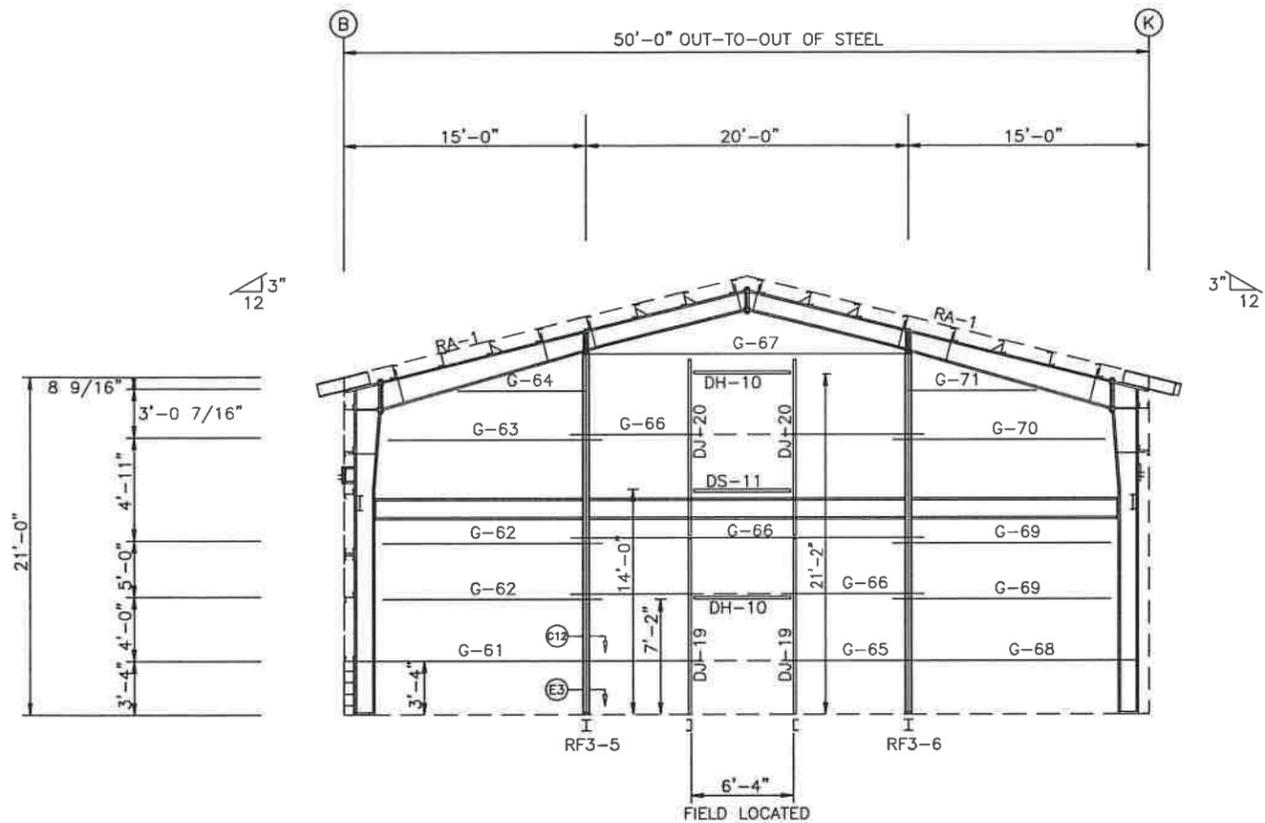


GIRT LAPS 11 3/4" / 11 3/4" / 11 3/4" / 11 3/4"
PARTITION 1 FRAMING

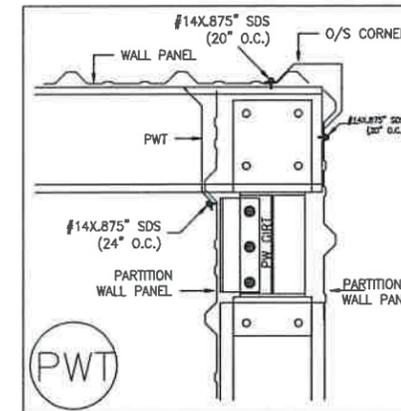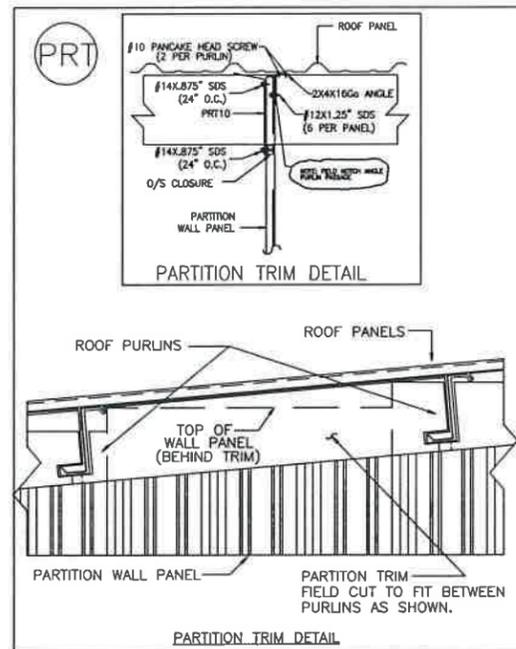

| MEMBER TABLE PARTITION 1 | | |
|-----------------------------|---------|--------------|
| MARK | PART | LENGTH |
| DJ-19 | 8X25C16 | 12'-1 13/16" |
| DJ-20 | 8X25C16 | 9'-11" |
| DH-10 | 8X25C16 | 6'-4" |
| DS-11 | 8X25C16 | 6'-4" |
| G-61 | 8x25C16 | 13'-2 3/4" |
| G-62 | 8x25Z16 | 14'-2 3/4" |
| G-63 | 8x25Z16 | 13'-10 3/4" |
| G-64 | 8x25Z16 | 8'-7 1/2" |
| G-65 | 8x25C16 | 19'-11 1/2" |
| G-66 | 8x25Z16 | 21'-11 1/2" |
| G-67 | 8x25Z14 | 20'-7 1/2" |
| G-68 | 8x25C16 | 13'-2 5/8" |
| G-69 | 8x25Z16 | 14'-2 5/8" |
| G-70 | 8x25Z16 | 13'-10 5/8" |
| G-71 | 8x25Z16 | 8'-7 1/2" |

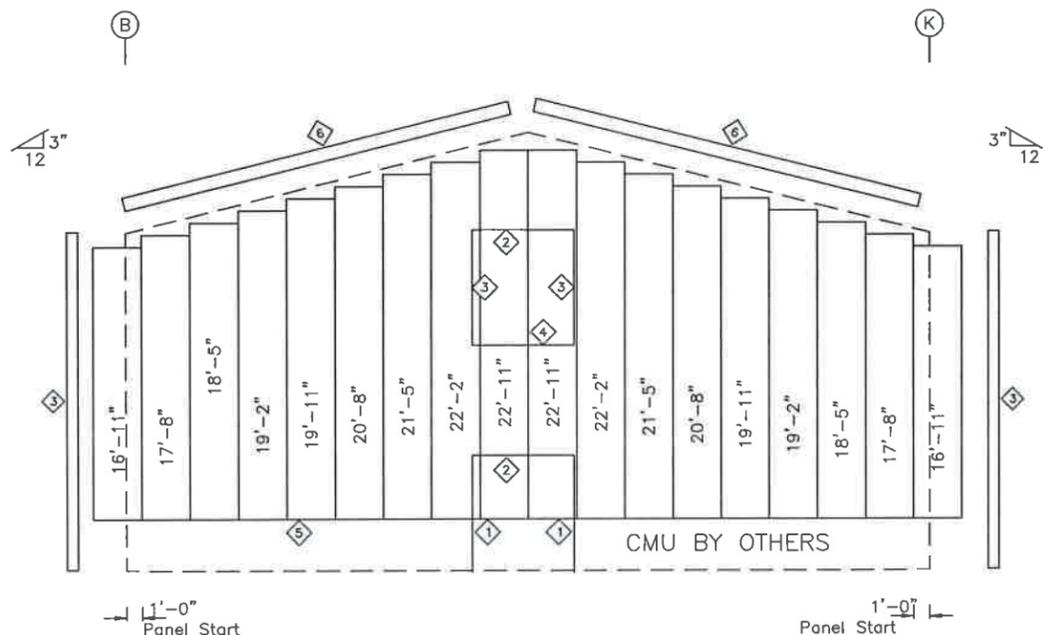

PARTITION 1 LEFT SHEETING & TRIM
PANELS: 26 Ga. R - NEED COLOR

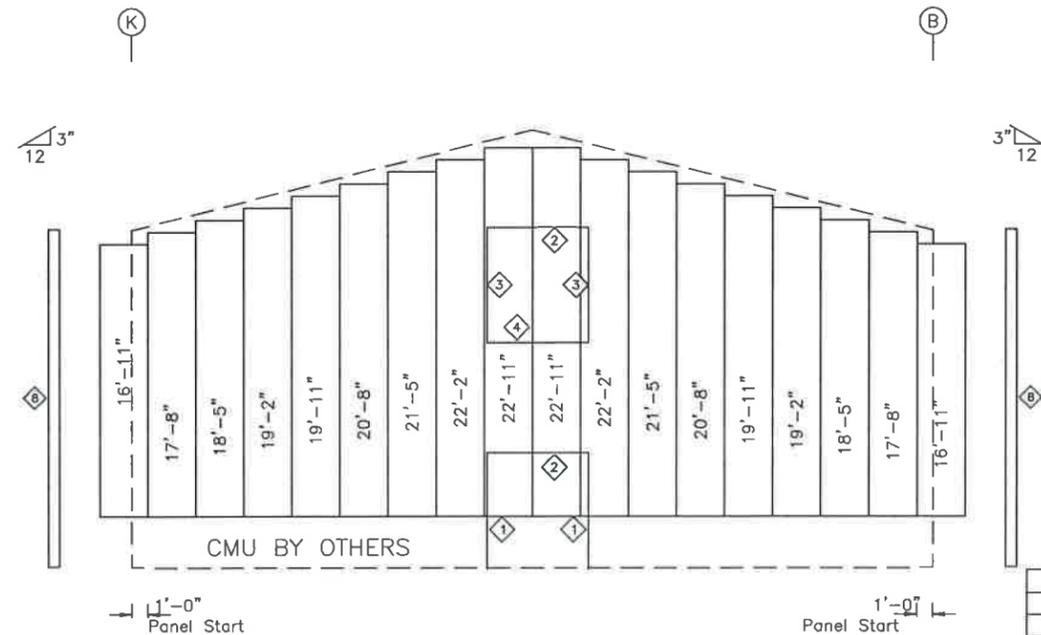


PARTITION 1 RIGHT SHEETING & TRIM
PANELS: 26 Ga. R - NEED COLOR


| ISSUE | DET | CHK | DATE |
|--|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1-A | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: PARTITION FRAMING, SHEETING & TRIM | | | |
| DRAWING NO: PAGE 10 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |

| TRIM TABLE PARTITION 2 | | | |
|---------------------------|------------|---------|---------|
| ID | PART | LENGTH | DETAIL |
| 1 | R JAMB | 7'-5" | TRIM_8 |
| 2 | R HEAD | 6'-7" | TRIM_61 |
| 3 | DBLBASTR | 16'-11" | TRIM_22 |
| 4 | PRT10 | 4'-7" | PRT |
| 5 | PWT | 4'-6" | PWT |
| 6 | O/S CORNER | 10'-8" | PWT |


| MEMBER TABLE PARTITION 2 | | |
|-----------------------------|---------|--------------|
| MARK | PART | LENGTH |
| DJ-11 | 8X25C16 | 14'-0" |
| DH-10 | 8X25C16 | 6'-4" |
| G-65 | 8x25C16 | 19'-11 1/2" |
| G-66 | 8x25Z16 | 21'-11 1/2" |
| G-72 | 8x25C16 | 13'-1 15/16" |
| G-73 | 8x25Z16 | 14'-0 5/8" |
| G-74 | 8x25Z16 | 13'-10 1/2" |
| G-75 | 8x25Z16 | 11'-11 3/8" |
| G-76 | 8x25Z12 | 20'-7 1/2" |

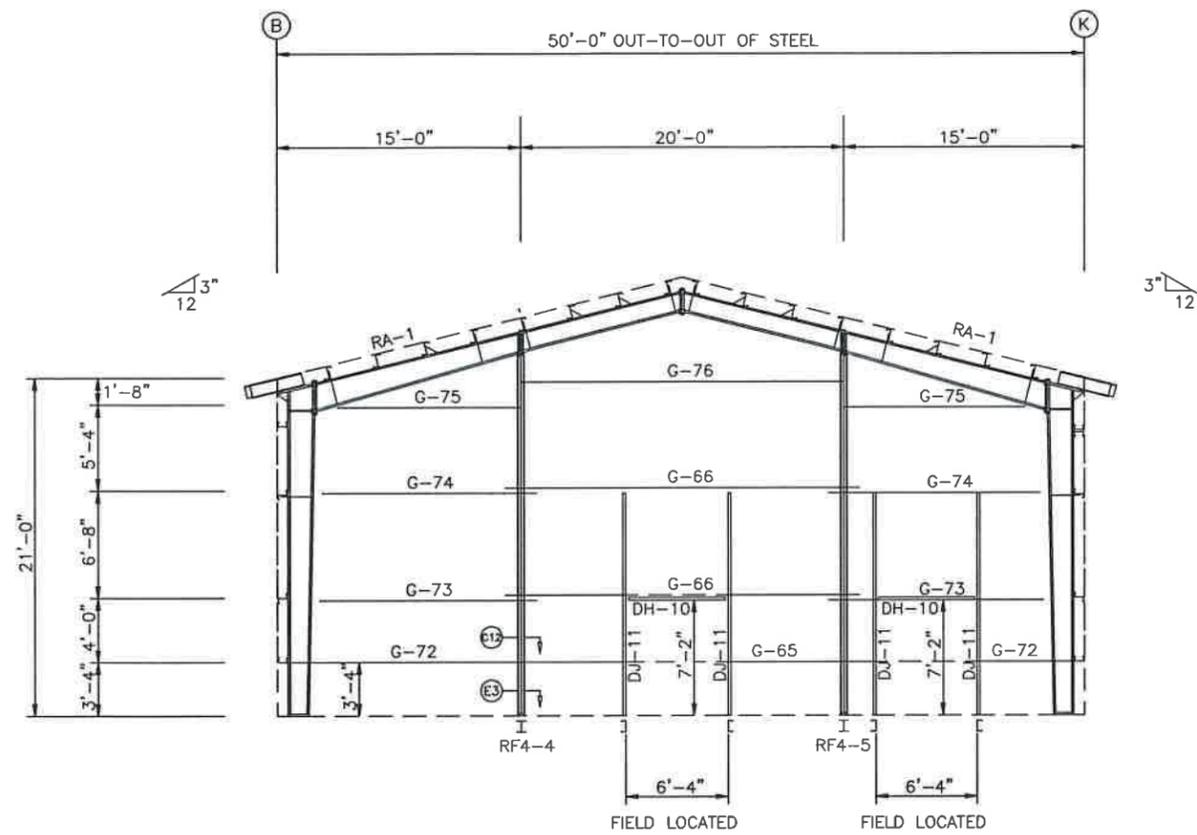

PARTITION 2 FRAMING

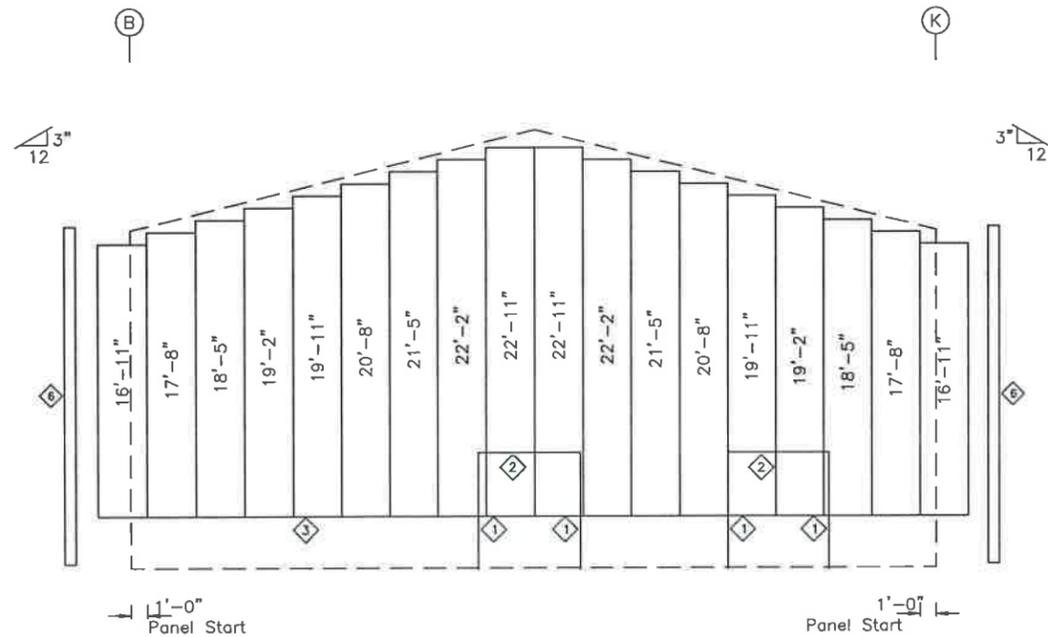


PARTITION 2 LEFT SHEETING & TRIM
PANELS: 26 Ga. R - NEED COLOR

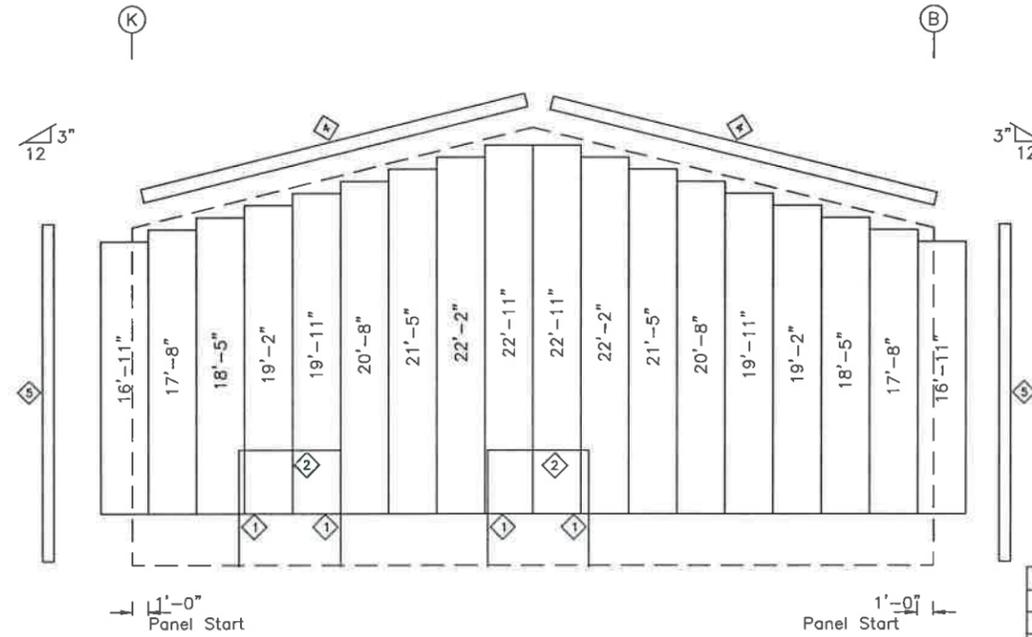


PARTITION 2 RIGHT SHEETING & TRIM
PANELS: 26 Ga. R - NEED COLOR

| ISSUE | DET | CHK | DATE |
|--|----------------|-----------------|-------------|
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249R1-A | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: PARTITION FRAMING, SHEETING & TRIM | | | |
| DRAWING NO: PAGE 10.1 | DRAWN BY: DJH | CHECKED BY: SPW | SCALE: NONE |



| TRIM TABLE | | | |
|--------------|----------|--------|--------|
| FRAME LINE 1 | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | R HEAD | 12'-8" | ELA |
| 2 | RRIDFLSH | 12'-6" | RR |
| 3 | R HEAD | 12'-8" | WALL |
| 4 | R HEAD | 12'-8" | LM |

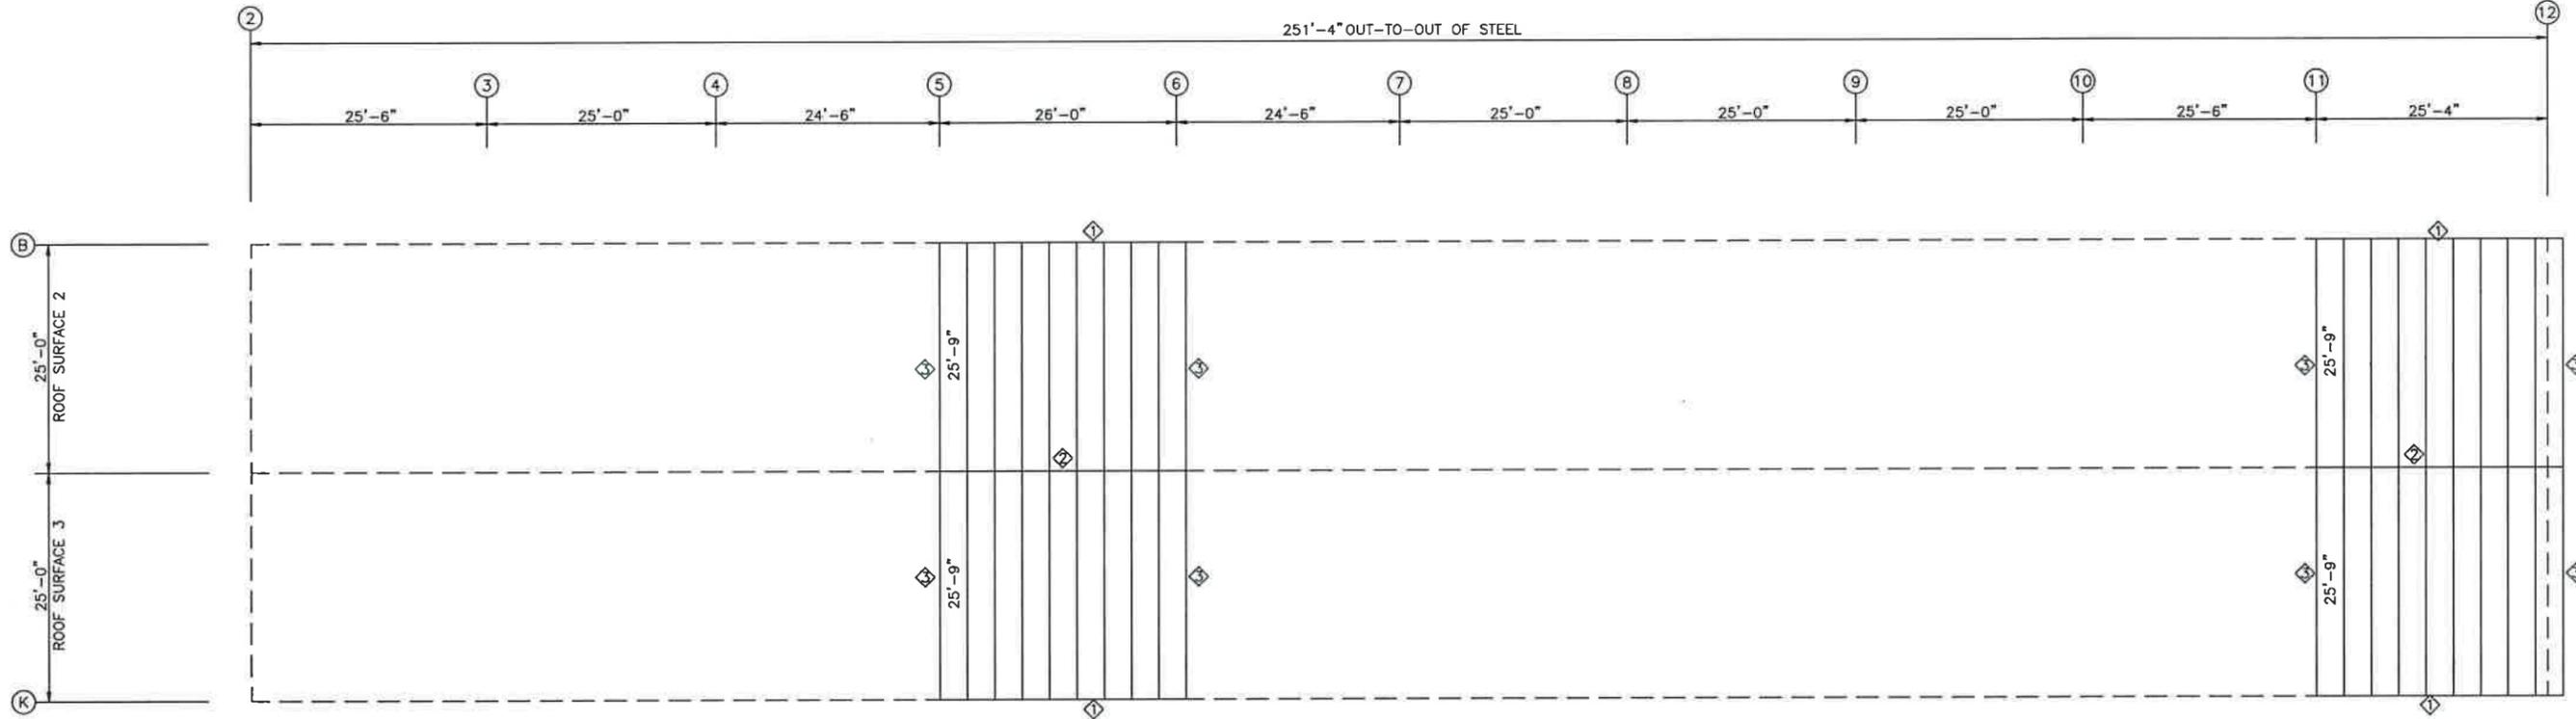

ROOF LINER SHEETING PLAN
PANELS: 26 Ga. R - NEED COLOR

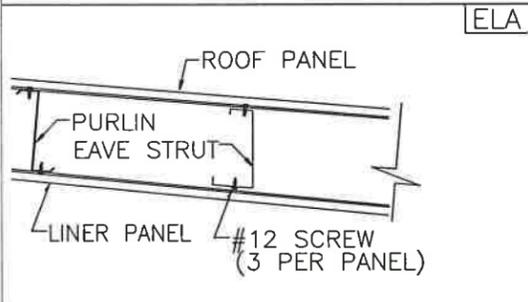


SEE ROOF DETAILS FOR ROOF/TRIM ATTACHMENT

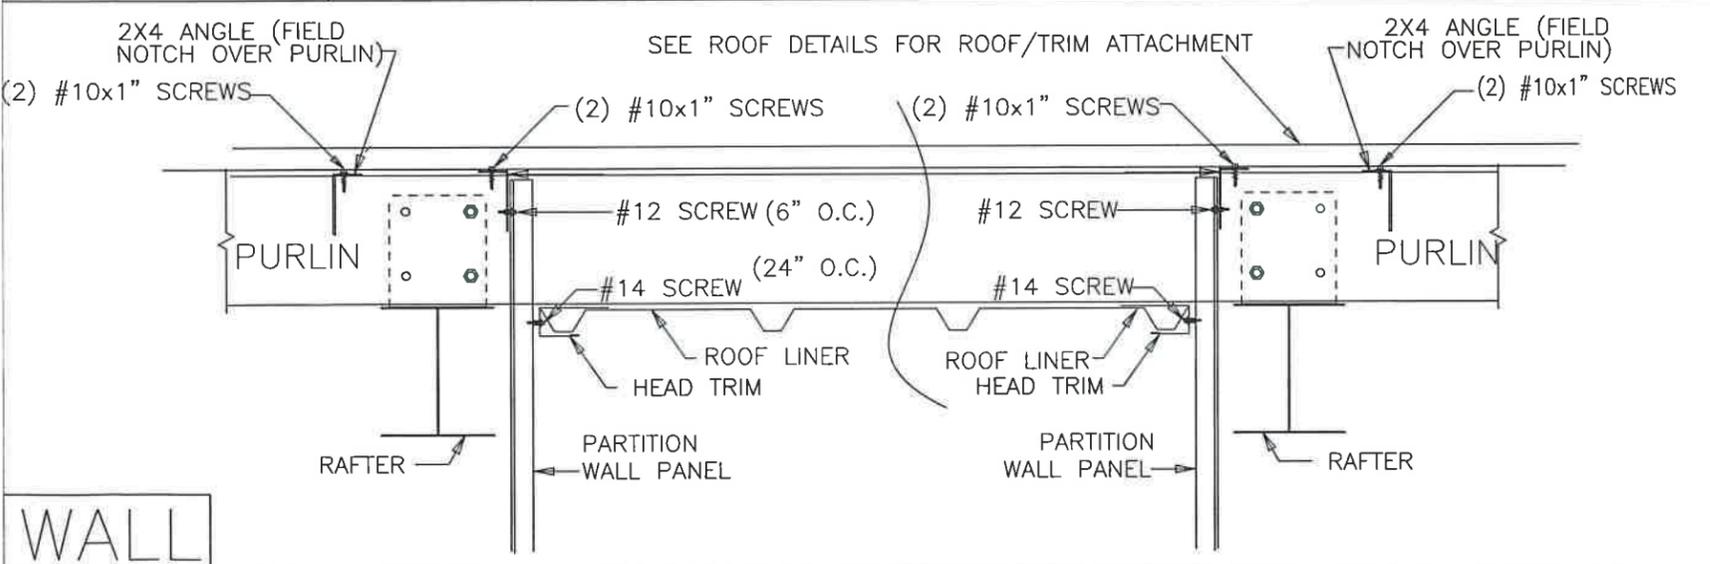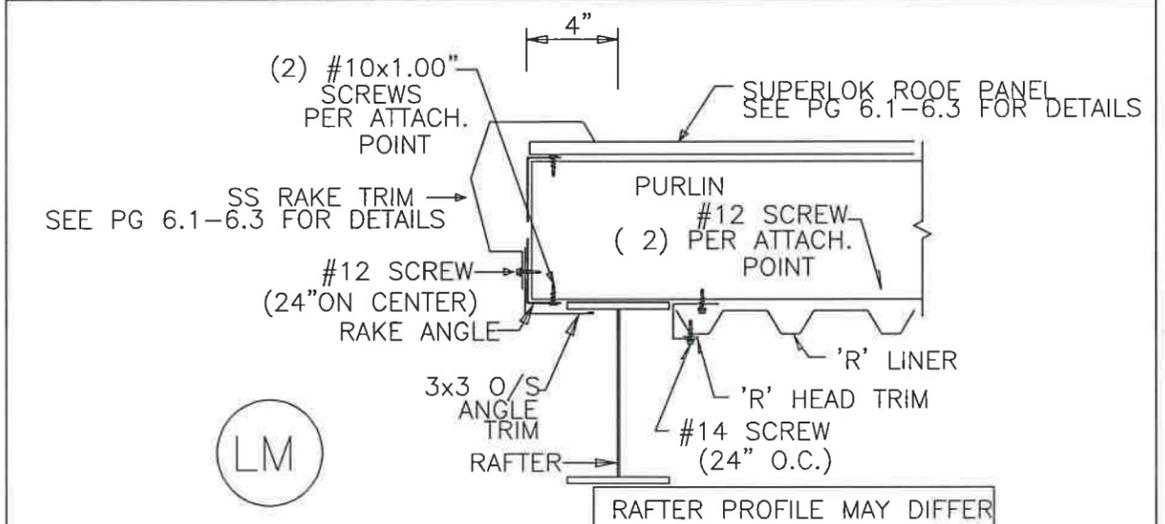




WALL

| | | | |
|-------------------------------------|----------------|-----------------|-------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: LINER SHEETING & TRIM | | | |
| DRAWING NO: PAGE 11 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |


| TRIM TABLE | | | |
|--------------|---------|--------|--------|
| FRAME LINE 1 | | | |
| ID | PART | LENGTH | DETAIL |
| 1 | R HEAD | 19'-3" | ELA |
| 2 | 3X3 1/S | 19'-3" | WALL3 |
| 3 | R HEAD | 12'-8" | LEW |
| 4 | R HEAD | 12'-8" | LM |

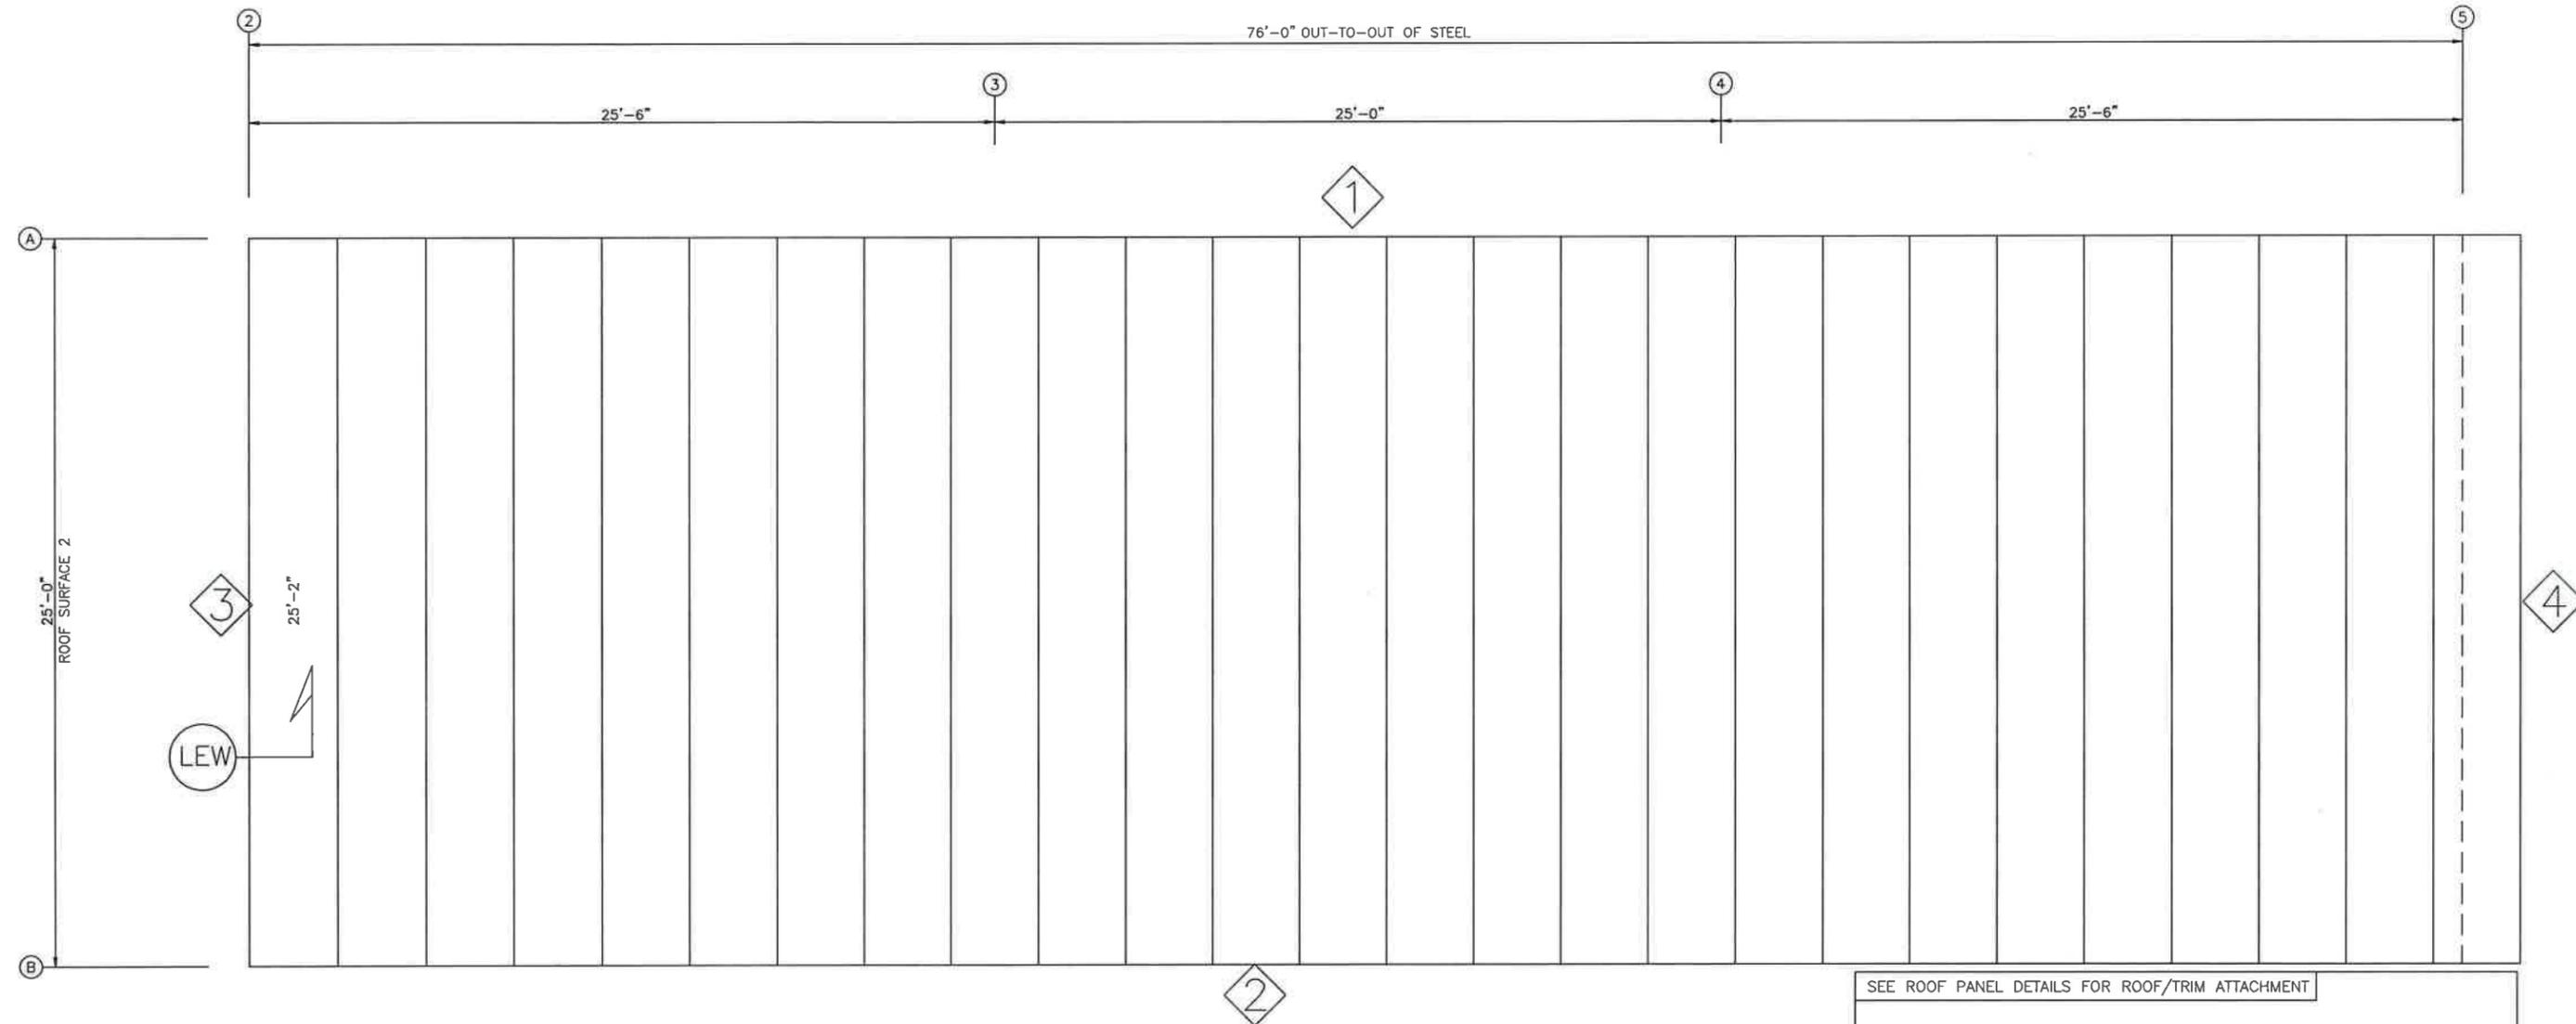

ROOF LINER SHEETING PLAN
PANELS: 26 Ga. R - NEED COLOR

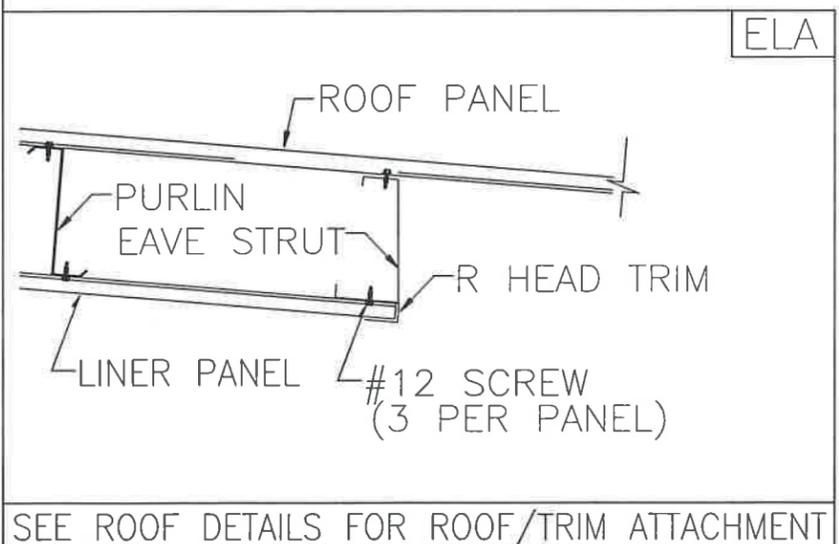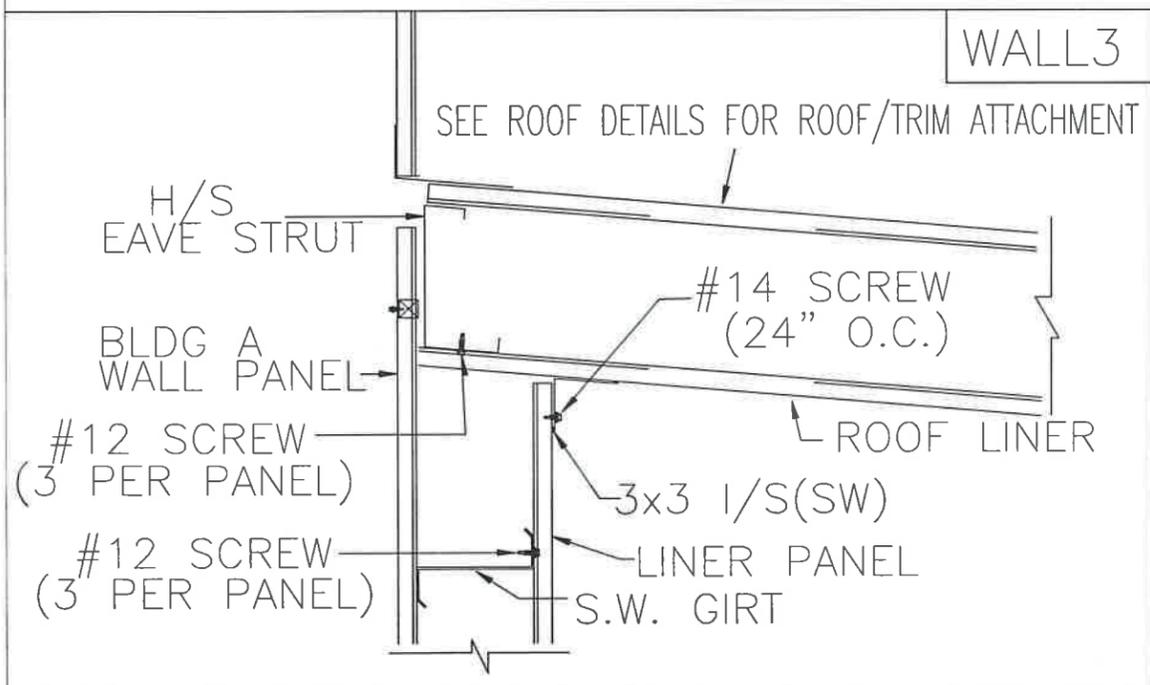
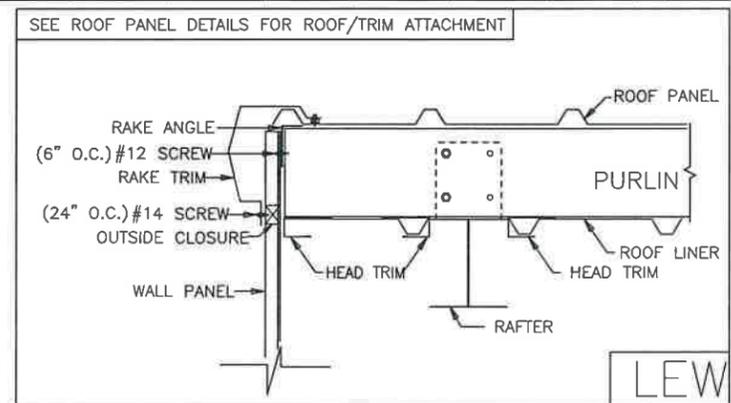


| | | | |
|-------------------------------------|----------------|-----------------|-------------|
| BUILDING "B" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNICAL SITE SOLUTIONS | | | |
| JOB NO: 9249 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: LINER SHEETING & TRIM | | | |
| DRAWING NO: PAGE 11.1 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

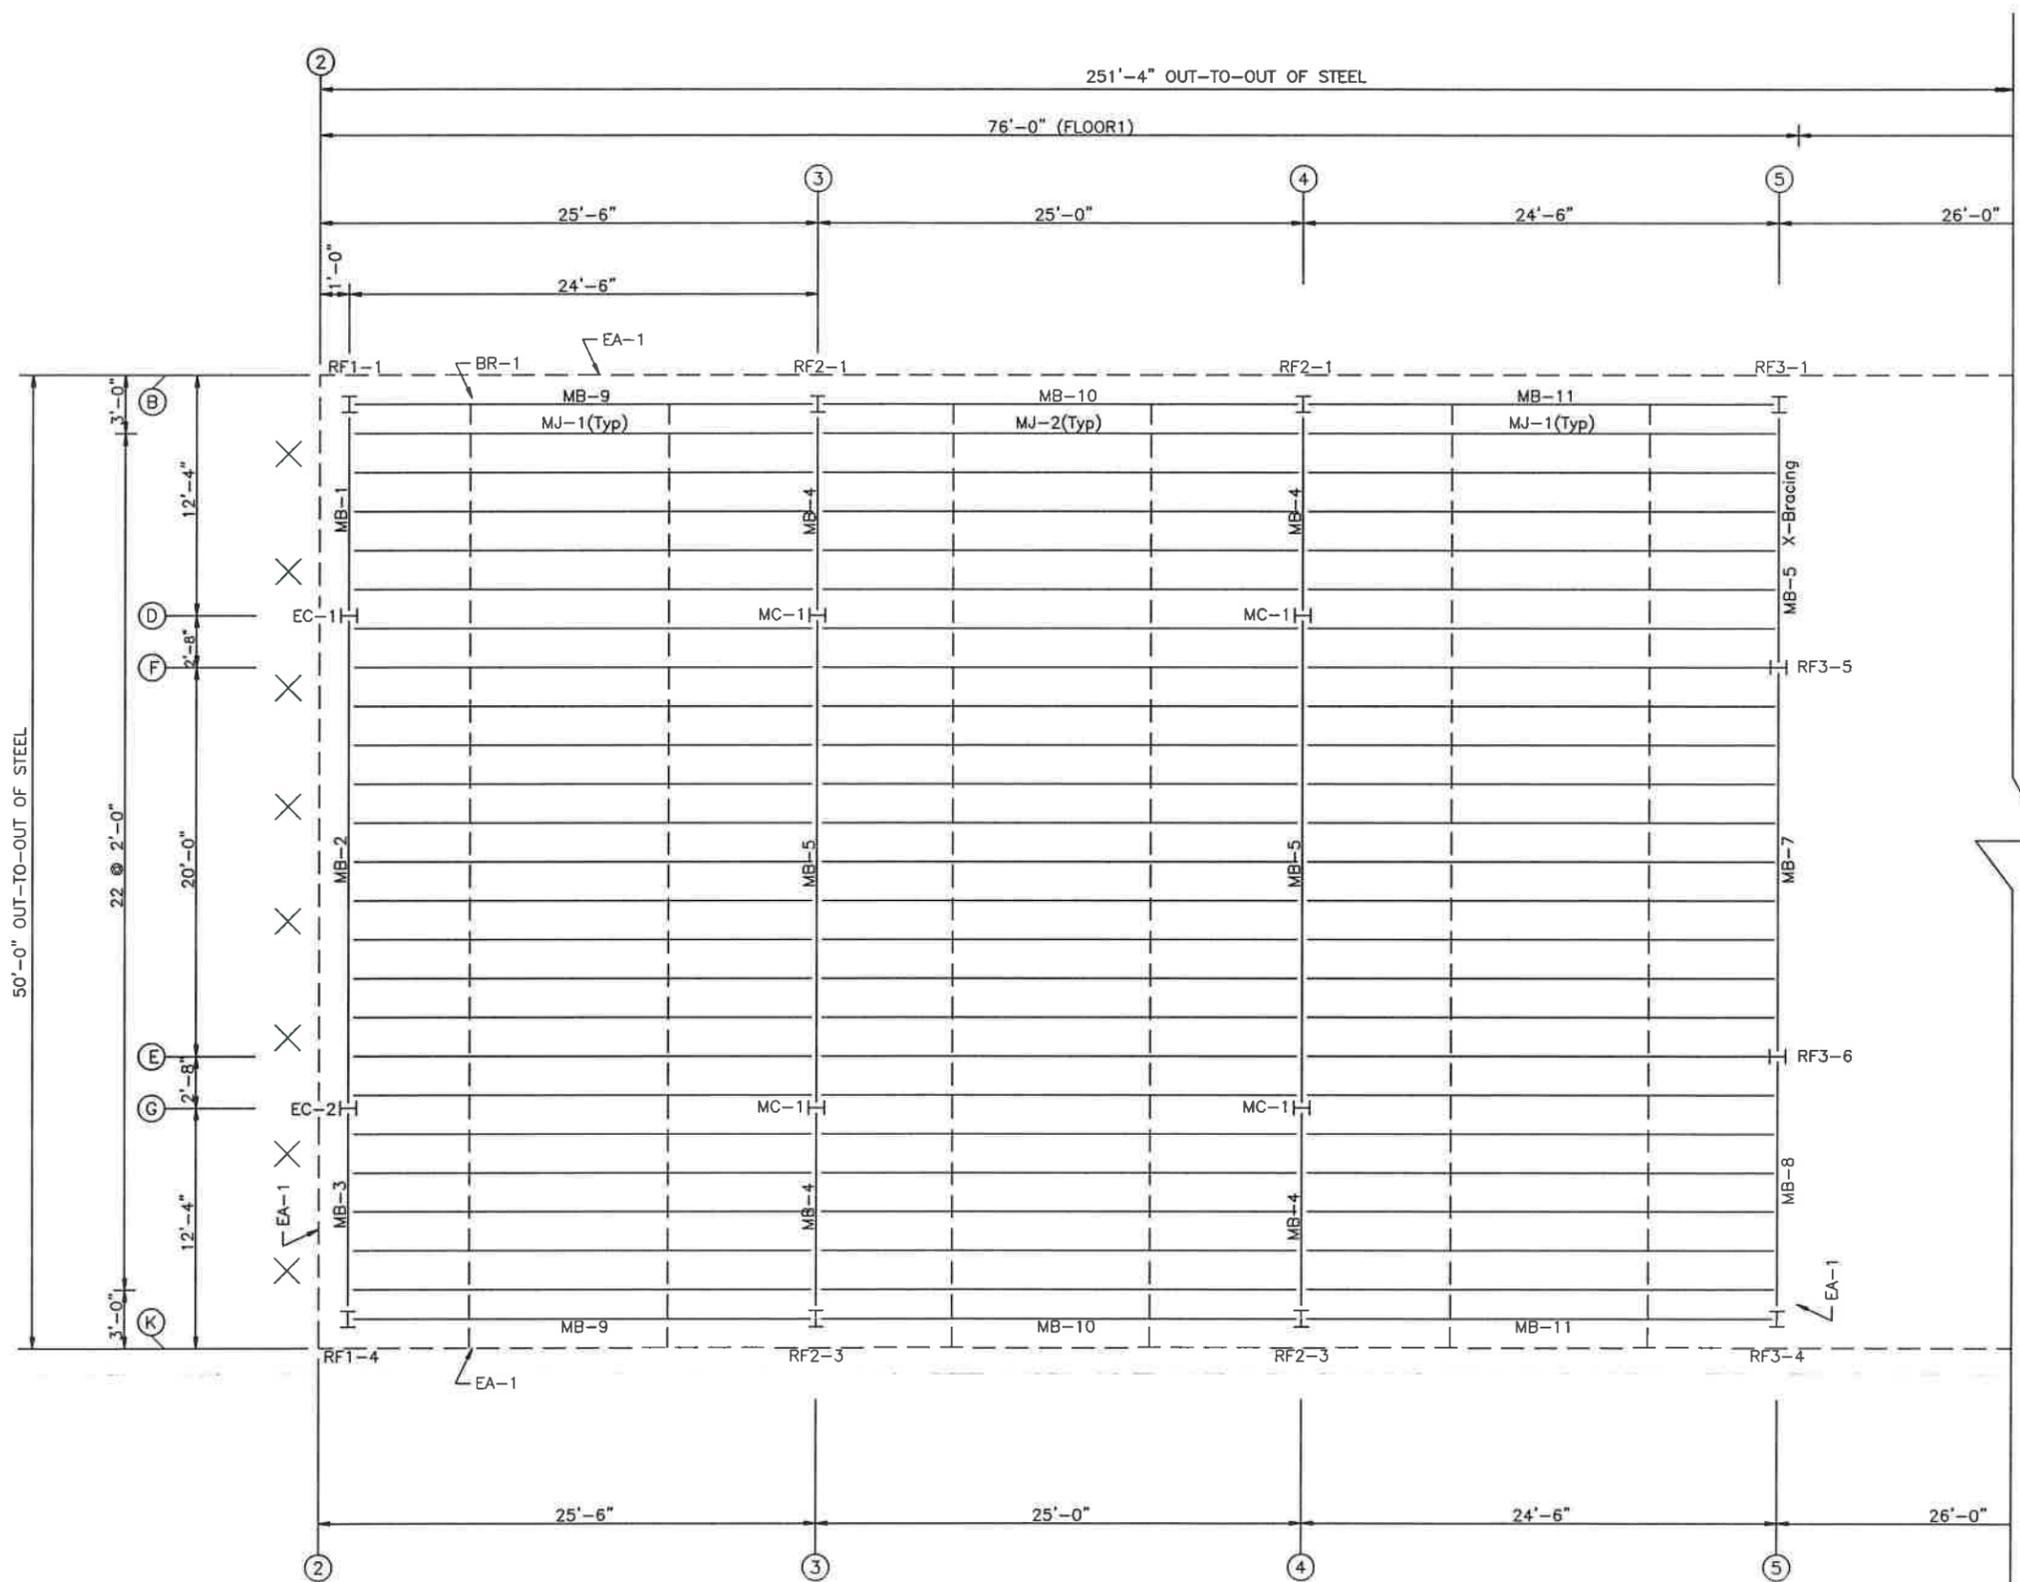



| MEMBER TABLE | | | | |
|--------------|--------|-------------|--------------|----------|
| MARK | PART | LENGTH | BOLT SIZE | QUANTITY |
| MB-1 | w16X26 | 10'-6 1/8" | 3/4"x2" A325 | 4 |
| MB-2 | w16X40 | 25'-2 3/4" | 3/4"x2" A325 | 4 |
| MB-3 | w16X26 | 10'-6" | 3/4"x2" A325 | 4 |
| MB-4 | w21X44 | 10'-2 1/8" | 3/4"x2" A325 | 6 |
| MB-5 | w21X55 | 25'-2 3/4" | 3/4"x2" A325 | 6 |
| MB-6 | w16X26 | 14'-11 3/4" | 3/4"x2" A325 | 4 |
| MB-7 | w16X26 | 19'-11 1/2" | 3/4"x2" A325 | 4 |
| MB-8 | w16X26 | 14'-11 3/4" | 3/4"x2" A325 | 3 |
| MB-9 | w12X14 | 24'-4 3/4" | 3/4"x2" A325 | 3 |
| MB-10 | w12X14 | 24'-10 3/4" | 3/4"x2" A325 | 3 |
| MB-11 | w12X14 | 24'-2 5/8" | 3/4"x2" A325 | 3 |
| MC-1 | w8X24 | 13'-5 1/2" | | |
| MJ-1 | 18K3 | 25'-5 1/2" | | |
| MJ-2 | 20K3 | 24'-11 1/2" | | |

MEZZANINE LOADINGS
 DEAD LOAD = 50 psf. (4" CONC., DECK & JOIST)
 LIVE LOAD = 100 psf. (UNREDUCIBLE)
 COLL. LOAD = 1 psf.

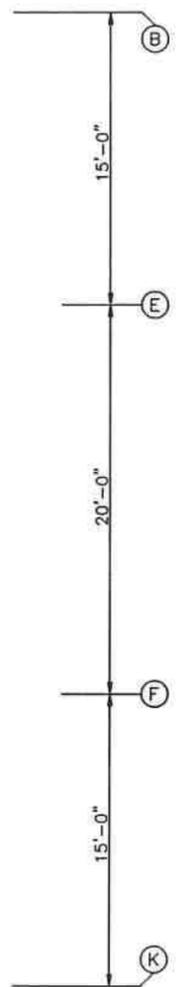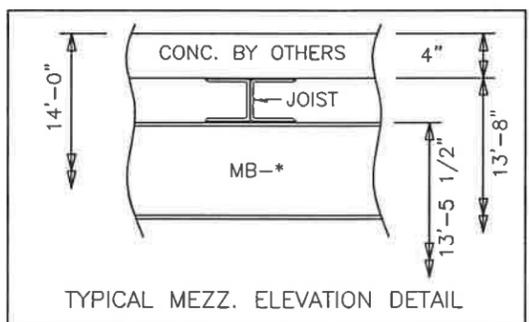


FLOOR FRAMING & JOISTS




| | | | |
|--|----------------|-----------------|-------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: MEZZANINE FRAMING LAYOUT | | | |
| DRAWING NO: PAGE 12 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

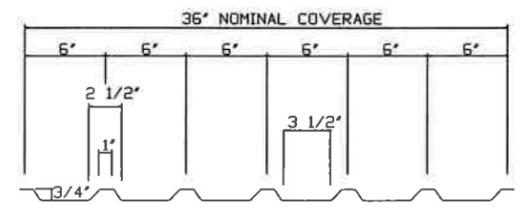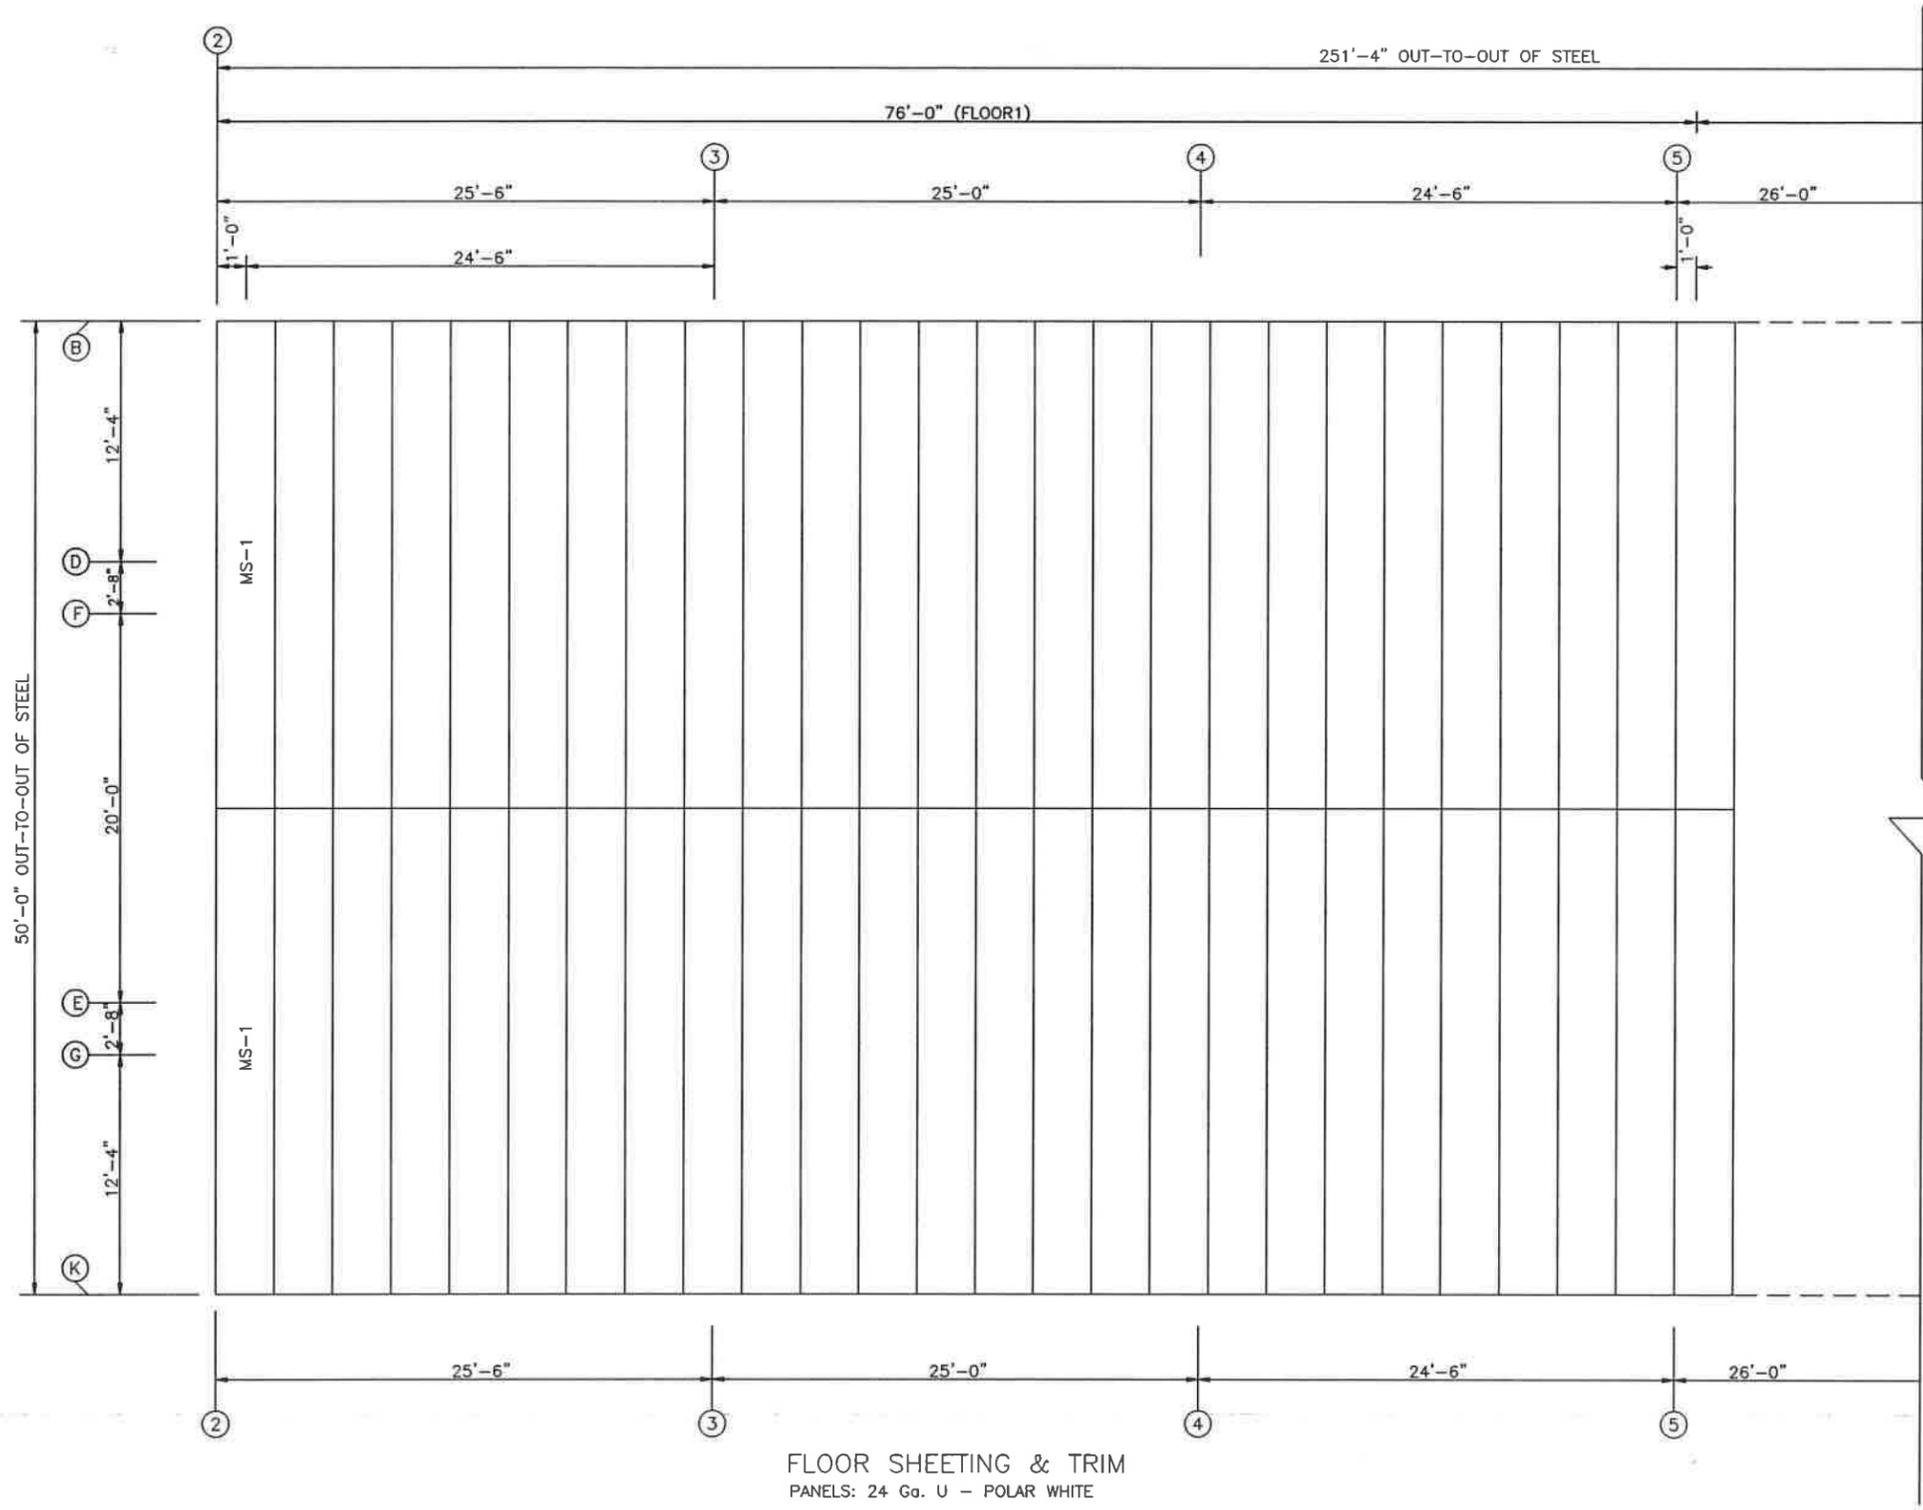

PBU DECK PANEL

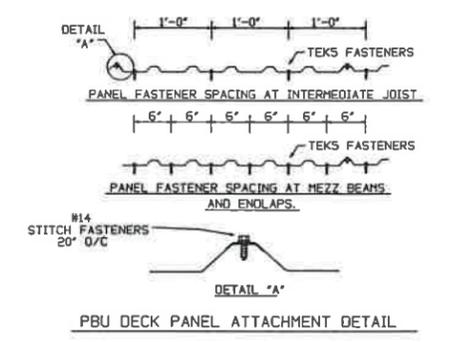

| | | | |
|--|-------------------|--------------------|----------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: MEZZANINE SHEETING LAYOUT | | | |
| DRAWN BY: PAGE 12.1 | DESIGN BY: DJH | CHECKED BY: GTL | SCALE: NONE |

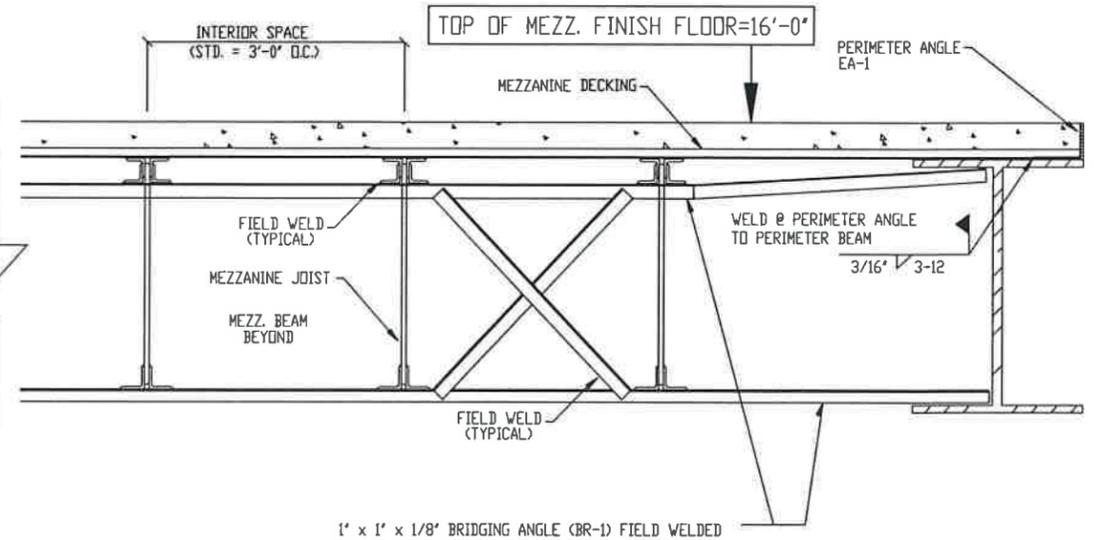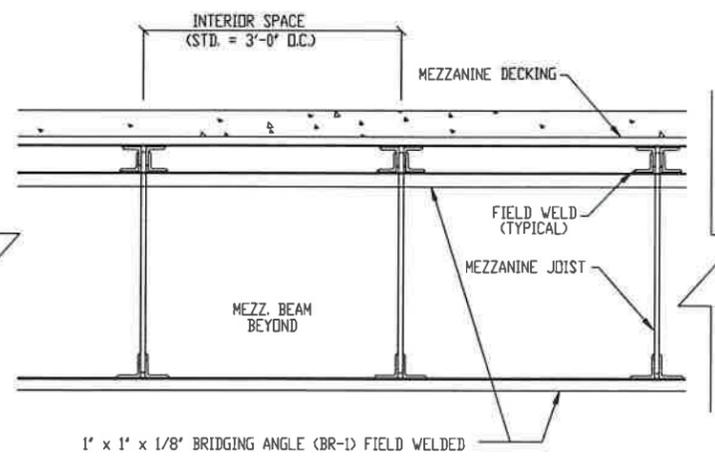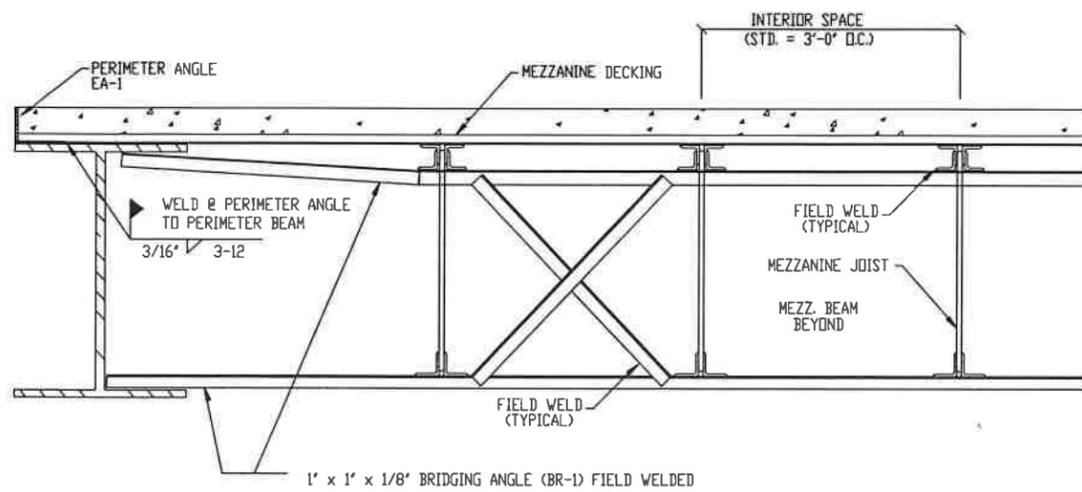


TYPICAL BRIDGING DETAILS

NOTE: BRIDGING ANGLE MAY CROSS IN MULTIPLE LOCATIONS. REFER TO DWG. ABOVE OR JOIST LAYOUT PAGE IF NOTED. LOCATIONS ARE MANDATORY.


NOTE: ALL WELDING PER SJI & AWS SPECIFICATIONS.

HANDLING AND ERECTION OF JOISTS:

1. CARE SHALL BE EXERCISED AT ALL TIMES TO AVOID DAMAGE THROUGH CARELESS HANDLING DURING UNLOADING, STORAGE, AND ERECTION.
2. AS SOON AS JOISTS ARE ERECTED, ALL BRIDGING SHALL BE COMPLETELY INSTALLED AND THE JOISTS PERMANENTLY FASTENED INTO PLACE BEFORE THE APPLICATION OF ANY LOADS EXCEPT THE WEIGHT OF THE ERECTORS.
3. WHERE FIVE ROWS OF BRIDGING ARE REQUIRED IN SPANS OVER 40 FEET, EACH JOIST SHALL BE ADEQUATELY BRACED LATERALLY BEFORE THE NEXT JOIST IS ERECTED AND BEFORE ANY LOADS ARE APPLIED. HOISTING CABLES SHALL NOT BE RELEASED UNTIL SUPPORT HAS BEEN PROVIDED BY THE CENTER ROW OF DIAGONAL BRIDGING AND THE BRIDGING LINE HAS BEEN ANCHORED TO PREVENT LATERAL MOVEMENT.
4. DURING THE CONSTRUCTION PERIOD, THE CONTRACTOR SHALL PROVIDE MEANS FOR ADEQUATE DISTRIBUTION OF CONCENTRATED LOADS SO THAT THE CARRYING CAPACITY OF ANY JOIST IS NOT EXCEEDED.
5. FIELD WELDING SHALL NOT DAMAGE THE JOISTS.

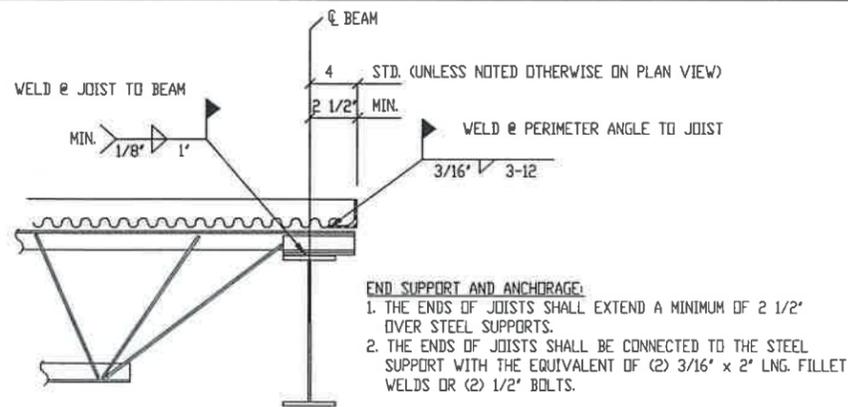

TYPICAL JOIST END DETAIL

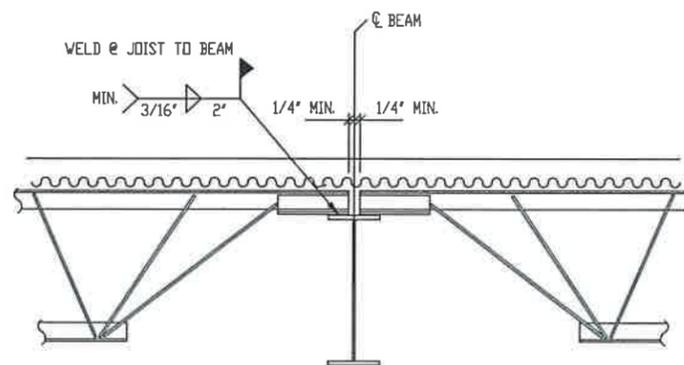

TYPICAL JOIST END DETAIL @ INTERIOR BEAM

| | | | |
|--------------------------------------|-------------------|--------------------|----------------|
| BUILDING "A" | | | |
| ISSUE | DET | CHK | DATE |
| | | | |
| BUILDINGS AND MORE | | | |
| CUSTOMER: PINNACLE SITE SOLUTIONS | | | |
| JOB NO: 9249 | DATE: 10/13/25 | | |
| LOCATION: HIGH SPRINGS, FL 32643 | | | |
| DRAWING NAME: MEZZANINE DETAILS | | | |
| DRAWING NO: PAGE 12.2 | DRAWN BY: DJH | CHECKED BY: GTL | SCALE: NONE |