



Freedom Forever
Planset Revision Letter

12/10/2024
REV #1

Attn. County of Columbia (FL):

The changes outlined in Revision Details have been applied to the plans corresponding to the following customer:

FRANK VOIGT
135 SOUTHEAST SCARLETT WAY

Revision Details:

REV#1

Layout changd with 21 SILFAB SOLAR: SIL-380 HC and INVERTER SOLAREEDGE USE5700H-USMNBL75

All corresponding changes are notated on the plans by revision clouds.

Thank you for your time in reviewing these plans. Please reach out if you have any additional questions or concerns.

Construction Engineering
Freedom Forever
engineering@freedomforever.com

ROOF MOUNT PHOTOVOLTAIC SYSTEM

CODES:

THIS PROPOSED INSTALLATION COMPLIES WITH THE FOLLOWING:
2023 8TH EDITION FLORIDA BUILDING CODE: BUILDING
2023 8TH EDITION FLORIDA BUILDING CODE: RESIDENTIAL
2023 8TH EDITION FLORIDA BUILDING CODE: MECHANICAL
2023 8TH EDITION FLORIDA BUILDING CODE: PLUMBING
2023 8TH EDITION FLORIDA BUILDING CODE: FUEL GAS
2023 8TH EDITION FLORIDA BUILDING CODE: ENERGY CONSERVATION
2023 8TH EDITION FLORIDA BUILDING CODE: EXISTING BUILDING
2023 8TH EDITION FLORIDA BUILDING CODE: ACCESSIBILITY
2023 8TH EDITION FLORIDA FIRE PREVENTION CODE (NFPA)
2020 NATIONAL ELECTRIC CODE (NEC)
AS ADOPTED BY COUNTY OF COLUMBIA

VICINITY MAP:

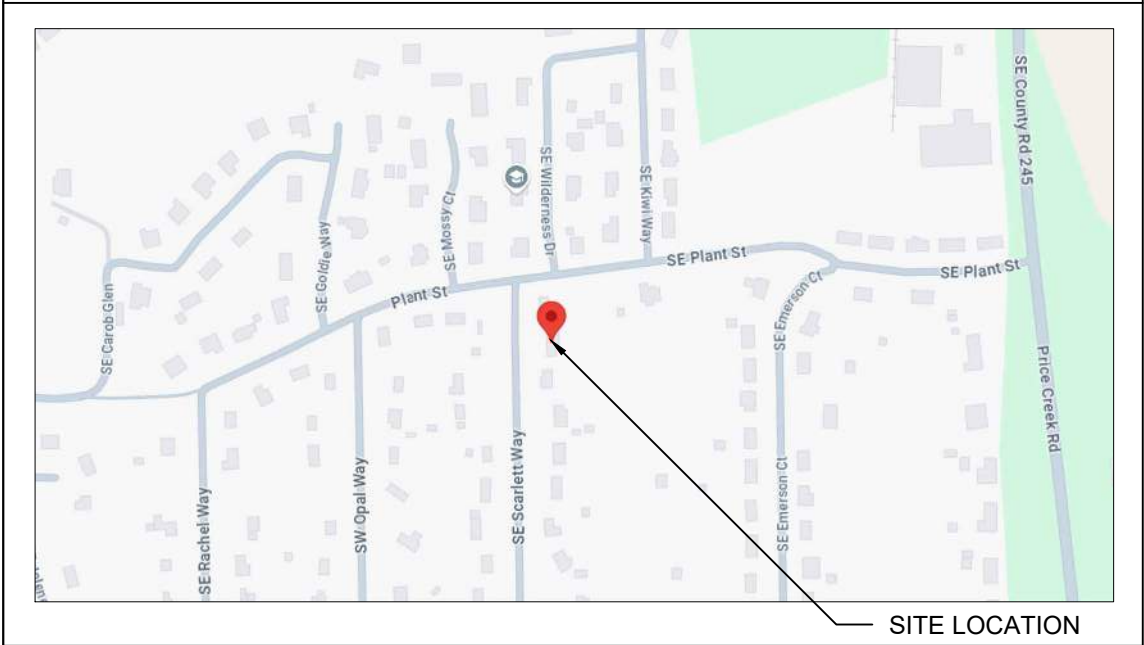


TABLE OF CONTENTS:

PV-1	PROJECT DETAILS
PV-2	SITE PLAN
PV-2A	ROOF PLAN WITH MODULES LAYOUT
PV-2B	ARRAY DETAILS
PV-3	MOUNTING DETAILS
PV-4	THREE LINE DIAGRAM
PV-5	CONDUCTOR CALCULATIONS
PV-6	EQUIPMENT & SERVICE LIST
PV-7	LABELS
PV-7A	SITE PLACARD
PV-8	OPTIMIZER CHART
PV-9	SAFETY PLAN
PV-10	SAFETY PLAN
APPENDIX	MANUFACTURER SPECIFICATION SHEETS

CONSTRUCTION NOTES:

CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS.

ALL SOLAR ENERGY SYSTEM EQUIPMENT SHALL BE SCREENED TO THE MAXIMUM EXTENT POSSIBLE AND SHALL BE PAINTED A COLOR SIMILAR TO THE SURFACE UPON WHICH THEY ARE MOUNTED.

MODULES SHALL BE TESTED , LISTED AND IDENTIFIED WITH FIRE CLASSIFICATION IN ACCORDANCE WITH UL 2703. SMOKE AND CARBON MONOXIDE ALARMS ARE REQUIRED PER SECTION R314 AND 315 TO BE VERIFIED AND INSPECTED BY INSPECTOR IN THE FIELD.

DIG ALERT (811) TO BE CONTACTED AND COMPLIANCE WITH EXCAVATION SAFETY PRIOR TO ANY EXCAVATION TAKING PLACE

PHOTOVOLTAIC SYSTEM GROUND WILL BE TIED INTO EXISTING GROUND AT MAIN SERVICE FROM DC DISCONNECT/INVERTER AS PER 2020 NEC SEC 250.166(A).

SOLAR PHOTOVOLTAIC SYSTEM EQUIPMENT WILL BE INSTALLED IN ACCORDANCE WITH REQUIREMENTS OF ART. 690 OF THE 2020 NEC


THE MAIN SERVICE PANEL WILL BE EQUIPPED WITH A GROUND ROD OR UFER

UTILITY COMPANY WILL BE NOTIFIED PRIOR TO ACTIVATION OF THE SOLAR PV SYSTEM

SOLAREEDGE OPTIMIZERS ARE LISTED TO IEC 62109-1 (CLASS II SAFETY) AND UL 1741 STANDARDS

INSTALL CREW TO VERIFY ROOF STRUCTURE PRIOR TO COMMENCING WORK. EMT CONDUIT ATTACHED TO THE ROOF USING CONDUIT MOUNT.

THIS SYSTEM DESIGNED WITH:
WIND SPEED: 119
WIND EXPOSURE: C
SNOW LOAD: 0

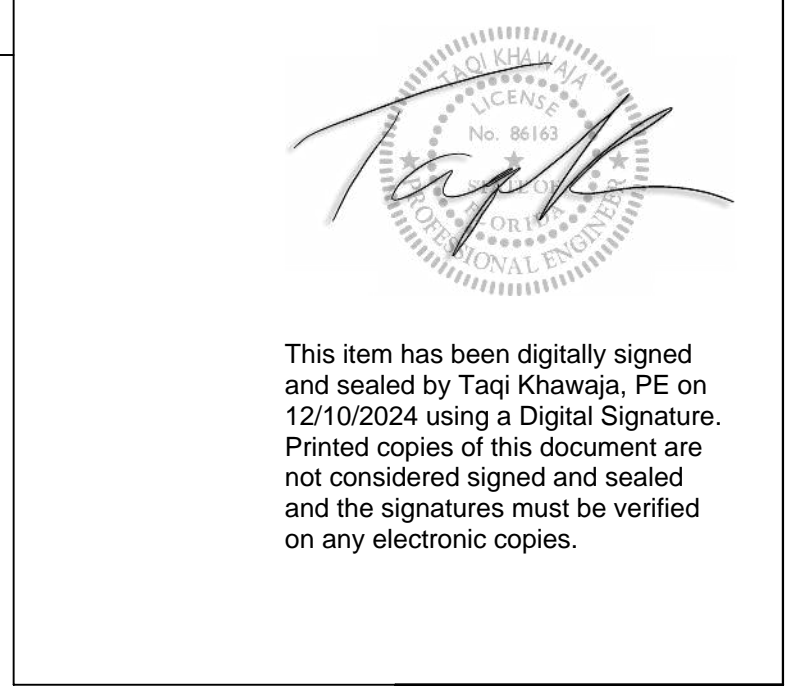

	<p><u>CLIENT:</u> FRANK VOIGT 135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025 AHJ: COUNTY OF COLUMBIA UTILITY: FPL - FLORIDA POWER & LIGHT METER: ACD7965 APN: 03-4S-17-07570-066 PHONE: (402) 290-9386 EMAIL: USN1RET@GMAIL.COM</p>
--	--

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE
USE5700H-USMNB175

1











	REVISIONS	
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-



PROJECT DETAILS			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-1

JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-1
-------------------	---------------------	--------------------	----------------

LEGEND:

-  CHIMNEY
-  PIPE VENT
-  MODULES
-  CONDUIT
-  SETBACK
-  AC DISCONNECT
-  UTILITY METER
-  JUNCTION BOX
-  INVERTER
-  MAIN SERVICE PANEL

PV SYSTEM
7.980 kW-DC
5.760 kW-AC

TOTAL ROOF AREA RIDGE SETBACK CALCS:
TOTAL ROOF AREA: 2354.4 SQ FT
SINGLE MODULE AREA: 19.66791622 SQ FT
TOTAL NUMBER OF MODULES: 21
TOTAL AREA OF MODULES: 413.03 SQ FT
ROOF COVERAGE: 17.54%
FIRE SPRINKLERS : NO


THIS SYSTEM DESIGNED WITH:
WIND SPEED: 119
WIND EXPOSURE: C
SNOW LOAD: 0



SITE PLAN
SCALE: 1/24" = 1'-0"

1

SOUTHEAST SCARLETT WAY

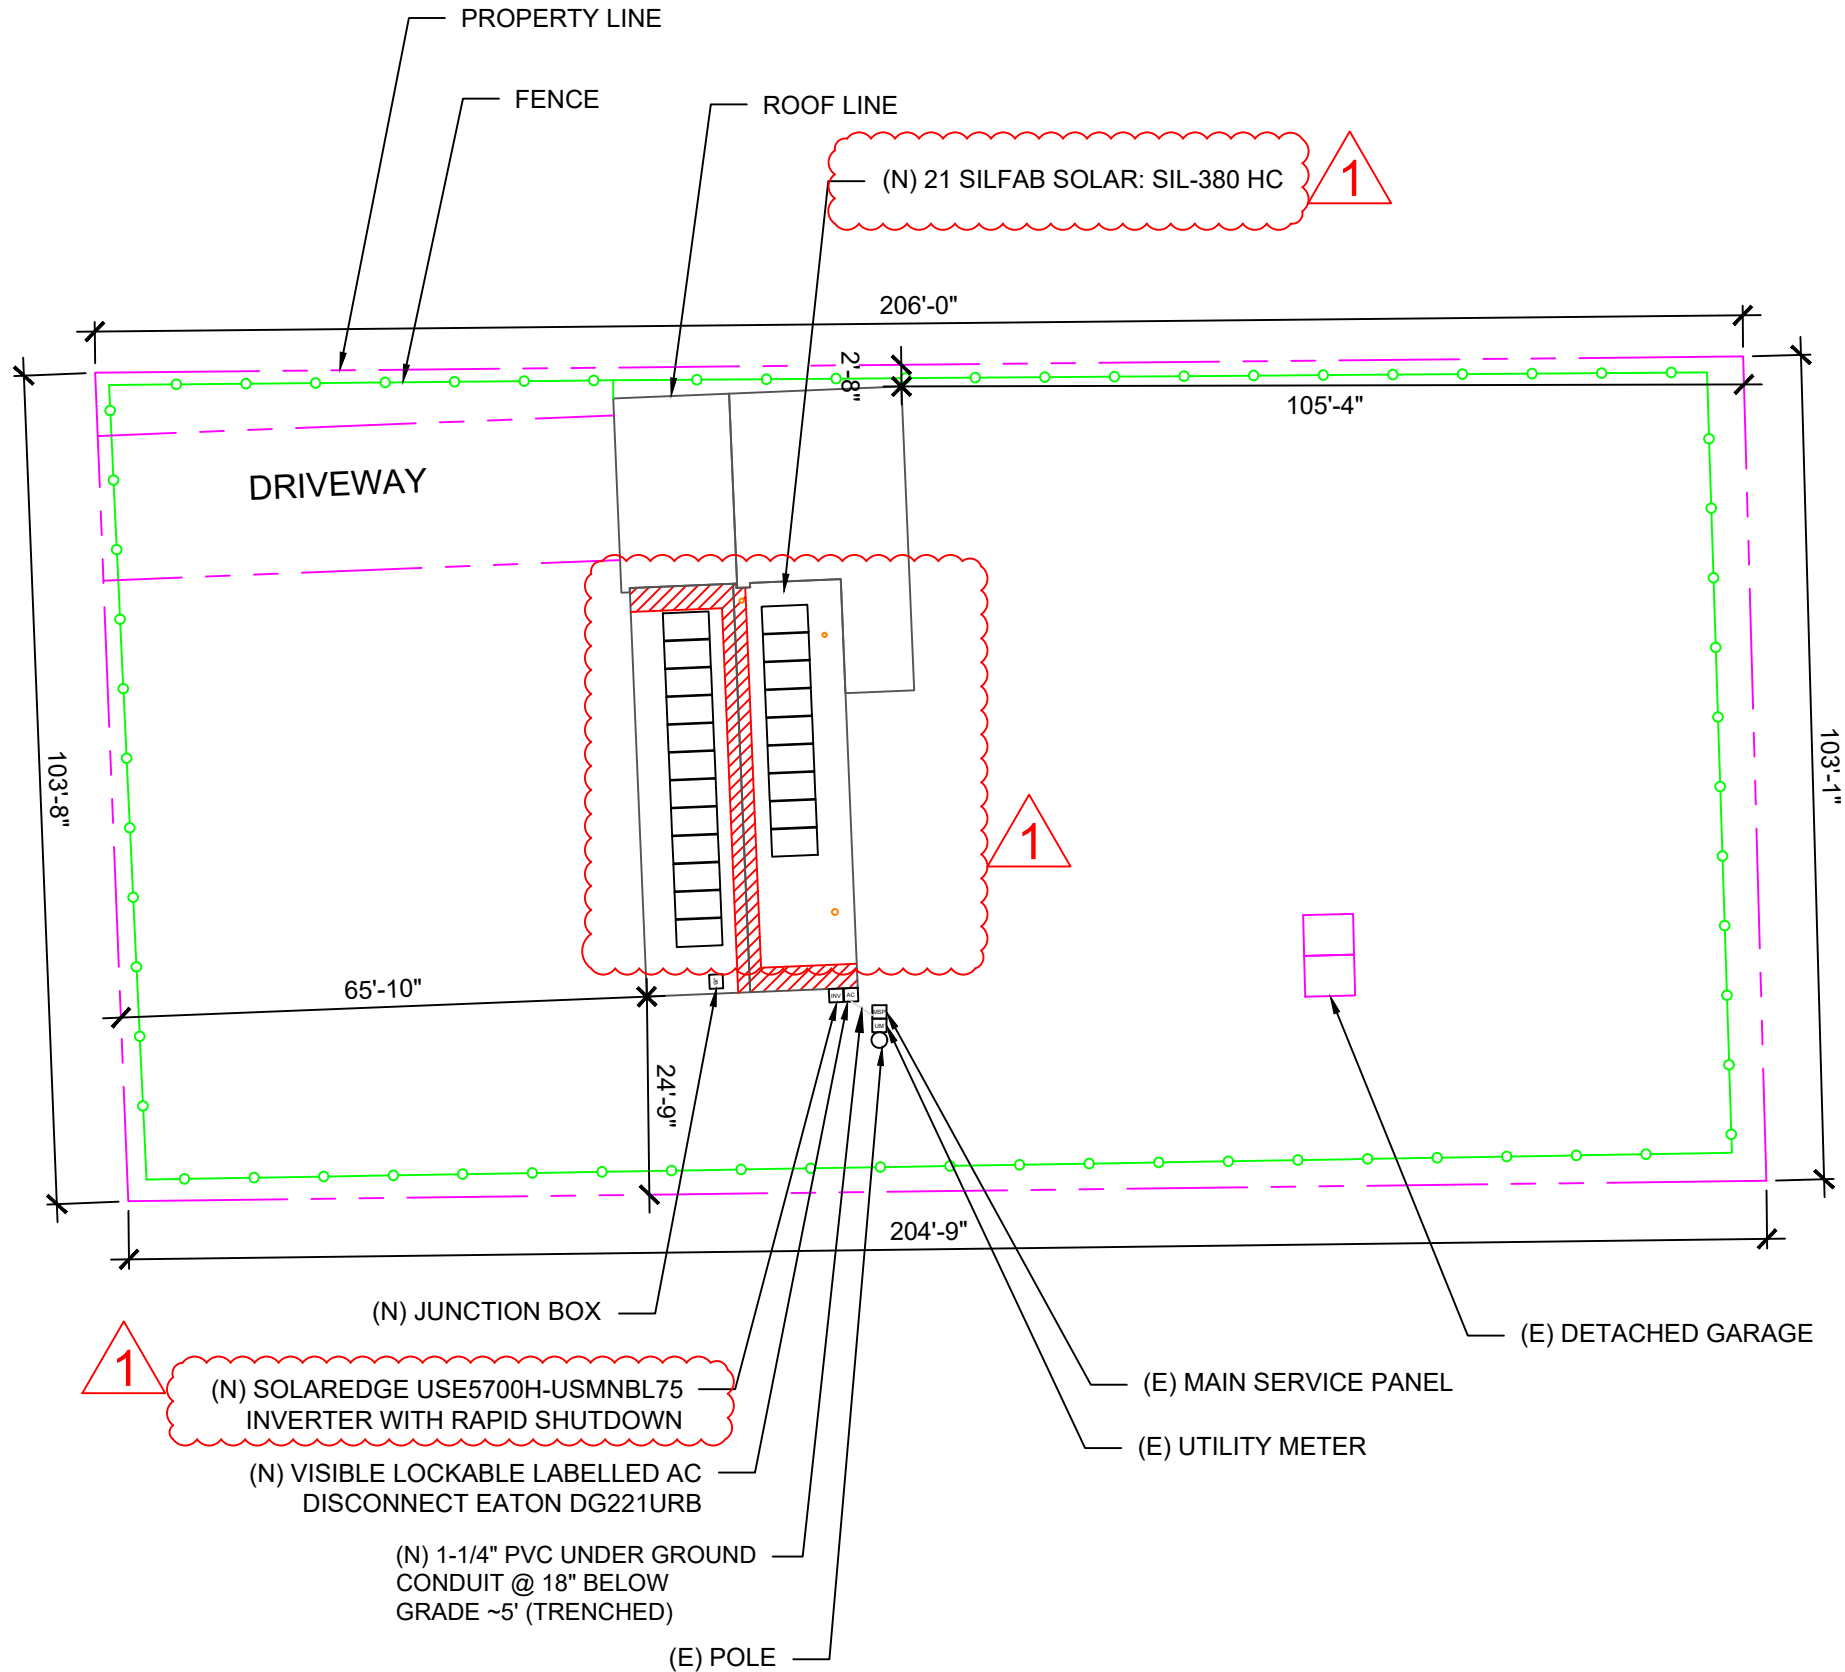

This item has been digitally signed and sealed by Taqi Khawaja, PE on 12/10/2024 using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signatures must be verified on any electronic copies.

ROOF AREA: 2354.4 SQ FT

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREDGE S440
INVERTER: SOLAREDGE USE5700H-USMNB75

REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-













FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

SITE PLAN			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
496748	12/10/2024	V.	PV-2

LEGEND:

-  CHIMNEY
-  PIPE VENT
-  MODULES
-  CONDUIT
-  SETBACK
-  AC DISCONNECT
-  UTILITY METER
-  JUNCTION BOX
-  INVERTER
-  MAIN SERVICE PANEL

PV SYSTEM
7.980 kW-DC
5.760 kW-AC


THIS SYSTEM DESIGNED WITH:
WIND SPEED: 119
WIND EXPOSURE: C
SNOW LOAD: 0

TOTAL ROOF AREA: 2354.4 SQ FT
TOTAL ARRAY AREA: 413.03 SQ FT
ARRAY COVERAGE: 17.54%
SYSTEM DISTRIBUTED WEIGHT: 2.69 LBS
SOLARFOOT POINT-LOAD: 10.38 LBS



ROOF PLAN
SCALE: 3/32" = 1'-0"

1

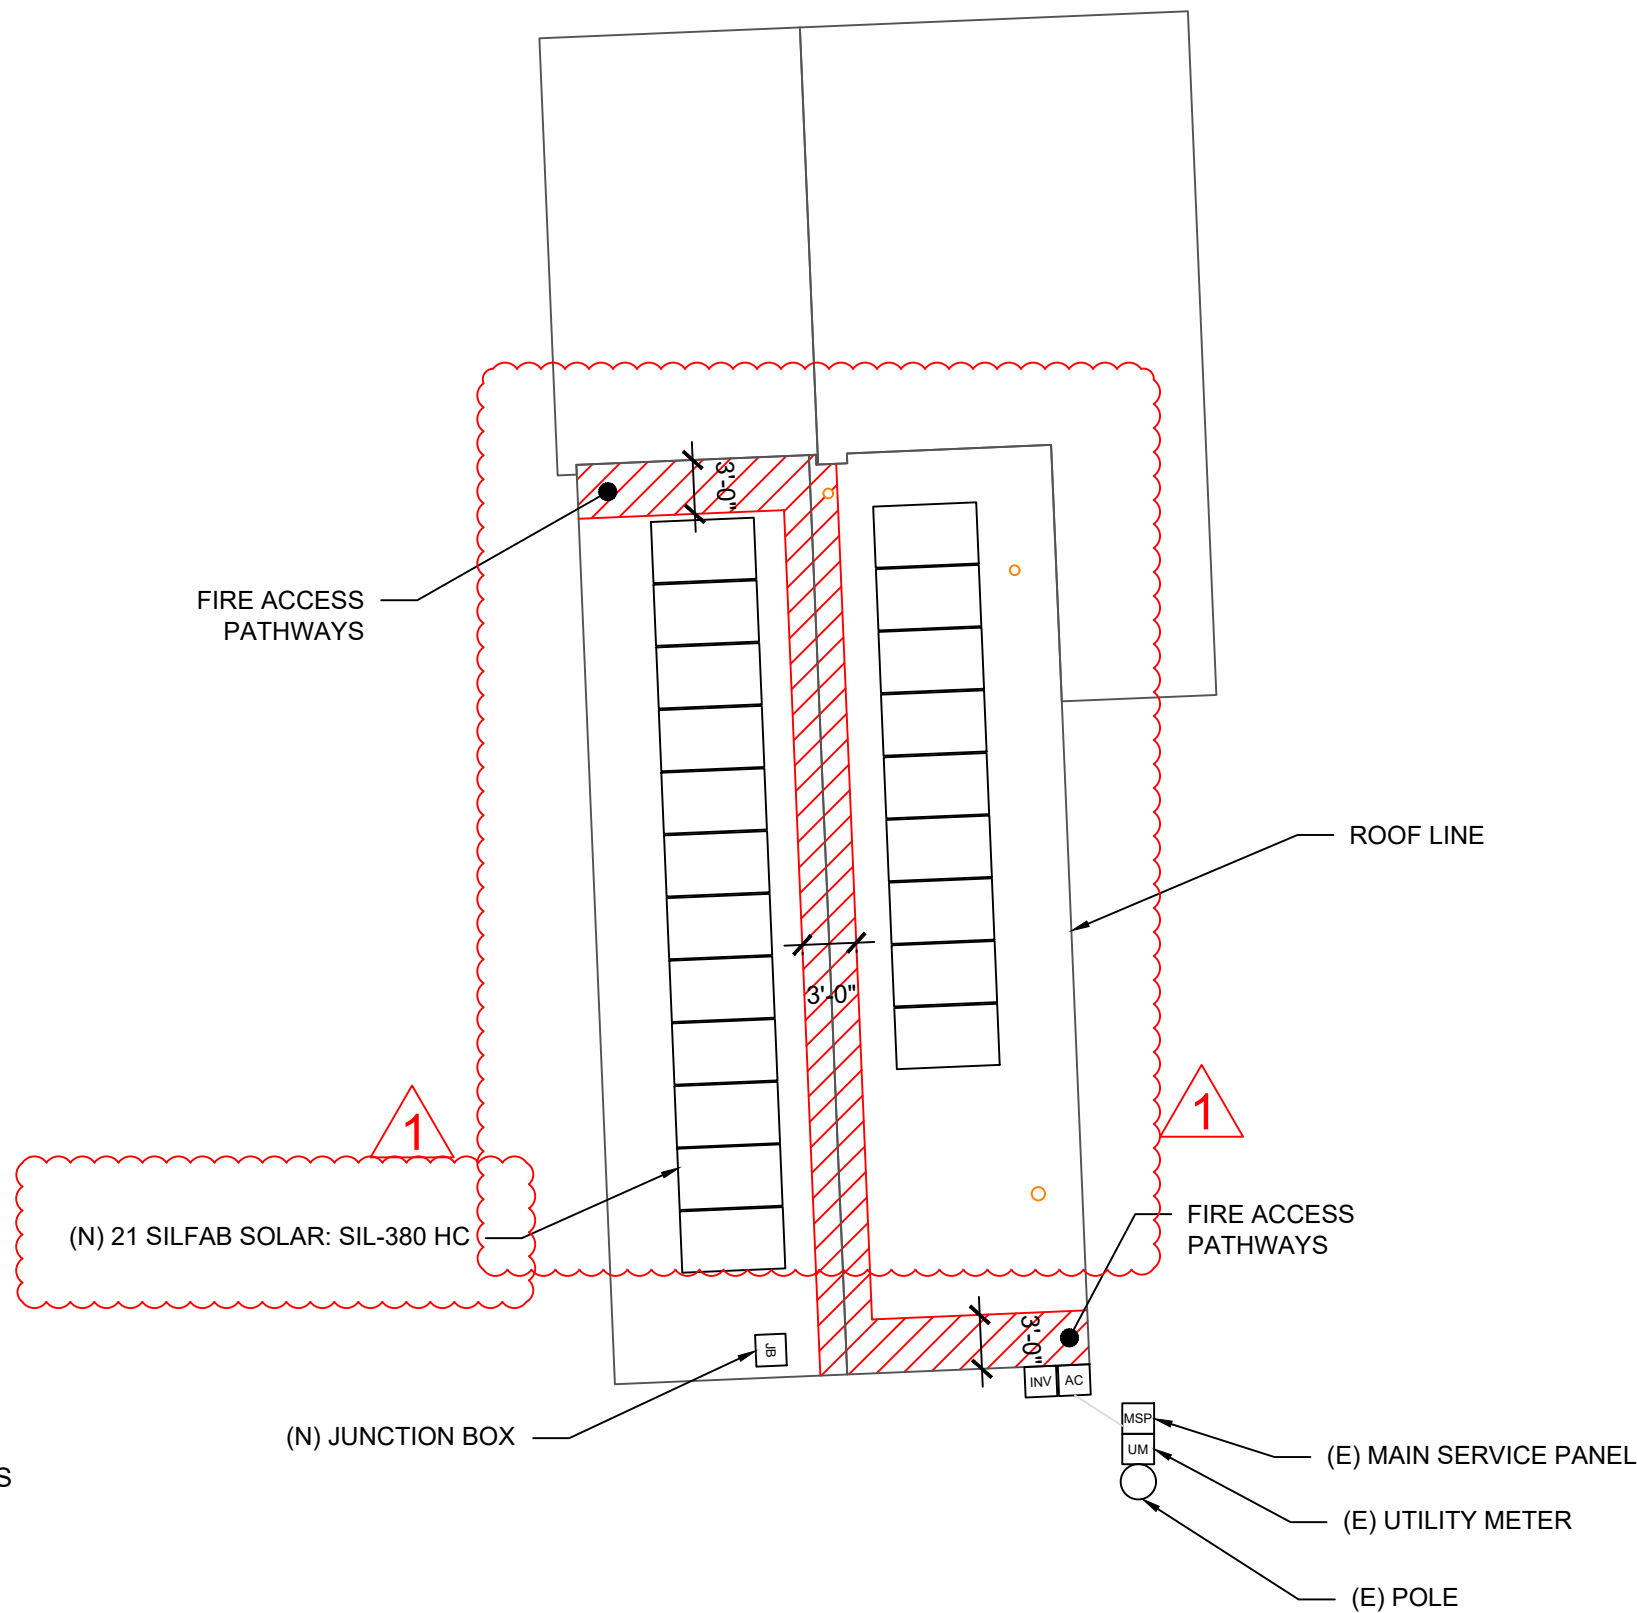

- NOTES:
- EMT CONDUIT ATTACHED TO THE ROOF USING CONDUIT MOUNTS
 - ATTACHED CLAMPS AT 25% FROM THE EDGE AND 50% FROM THE CENTER OF THE MODULES
 - JUNCTION BOX IS MOUNTED TO THE RAIL.



This item has been digitally signed and sealed by Taqi Khawaja, PE on 12/10/2024 using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signatures must be verified on any electronic copies.

ROOF AREA: 2354.4 SQ FT

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE
USE5700H-USMNB75

1

REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-



FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT

GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

ROOF PLAN WITH MODULES LAYOUT

JOB NO:	DATE:	DESIGNED BY:	SHEET:
496748	12/10/2024	V.	PV-2A

ROOF DETAILS:

TOTAL ROOF AREA: 2354.4 SQ FT
TOTAL ARRAY AREA: 413.03 SQFT
ARRAY COVERAGE: 17.54%
SYSTEM DISTRIBUTED WEIGHT: 2.69 LBS
SOLARFOOT POINT-LOAD: 10.38 LBS



This item has been digitally signed and sealed by Taqi Khawaja, PE on 12/10/2024 using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signatures must be verified on any electronic copies.

ROOF AREA STATEMENT						
ROOF	MODULE QUANTITY	ROOF PITCH	ARRAY PITCH	AZIMUTH	ROOF AREA	ARRAY AREA
ROOF 1	9	8	8	88	694.44 SQ FT	177.01 SQ FT
ROOF 2	12	8	8	268	667.13 SQ FT	236.01 SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT
----	----	----	----	----	SQ FT	SQ FT

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE
USE5700H-USMNB75

1

REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-




FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT




CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

ARRAY DETAILS			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
496748	12/10/2024	V.	PV-2B

TABLE 1 – ARRAY INSTALLATION									
	ROOF PITCH	ROOFING TYPE	ATTACHMENT TYPE	FRAMING TYPE	MAX UNBRACED LENGTH(FT.)	STRUCTURAL ANALYSIS RESULT	PENETRATION PATTERN	MAX ATTACHMENT SPACING (IN.)	MAX RAIL OVERHANG(IN. N.)
ROOF 1	8	Trapezoidal Metal	S–5 Solarfoot	2x2 @ 24” O.C.	6.66	PASS	STAGGERED	48	16
ROOF 2	8	Trapezoidal Metal	S–5 Solarfoot	2x2 @ 24” O.C.	6.66	PASS	STAGGERED	48	16
1. CONTRACTOR TO VERIFY FRAMING TYPE AND MAX UNBRACED LENGTH PRIOR TO INSTALLATION. IF THE ABOVE INFORMATION DOES NOT MATCH FIELD CONDITIONS, NOTIFY ENGINEER OF RECORD IMMEDIATELY.									
2. WHERE COLLAR TIES OR RAFTER SUPPORTS EXIST, CONTRACTOR SHALL USE RAFTERS WITH COLLAR TIES AS ATTACHMENT POINTS.									
3. MAX RAIL OVERHANG APPLICABLE FOR RAILED ATTACHMENT INSTALLATIONS.									

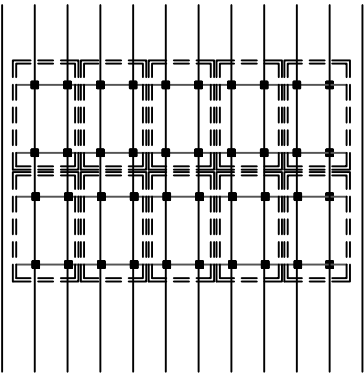


STACKED DETAIL
For Illustration purposes only

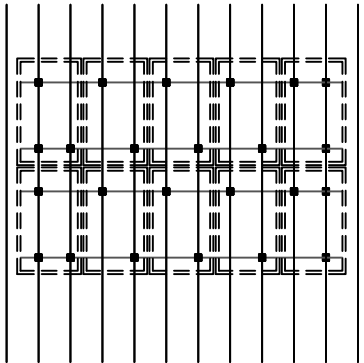


STAGGERED DETAIL
For Illustration purposes only



This item has been digitally signed and sealed by Taqi Khawaja, PE on 12/10/2024 using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signatures must be verified on any electronic copies.

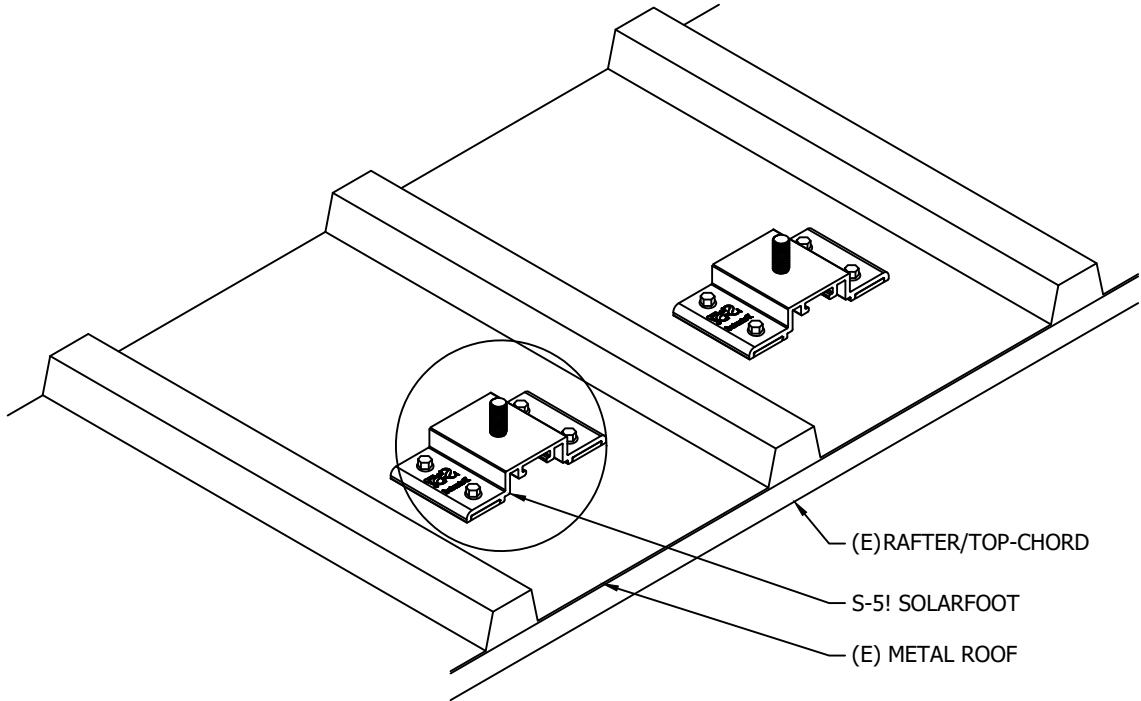

SOLAR PV ARRAY SECTION VIEW
Scale: NTS

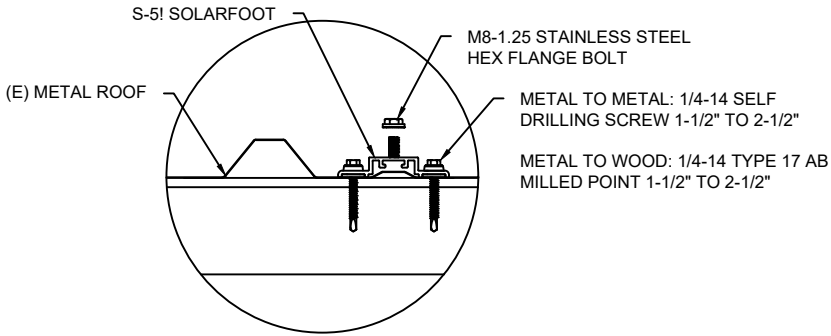

ATTACHMENT DETAIL
Scale: NTS

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREDGE S440
INVERTER: SOLAREDGE
USE5700H-USMNB75



REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-



FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT



CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

MOUNTING DETAILS			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-3

BACKFEED BREAKER SIZING						
MAX. CONTINUOUS OUTPUT 24.00A @ 240V						
24.00	X	1.25	=	30.00AMPS	30A BREAKER - OK	
SEE 705.12 OF 2020 NEC						
200	X	1.20	=	240		
240	-	200	=	40A ALLOWABLE BACKFEED		


PV SYSTEM
7.980 kW-DC
5.760 kW-AC



This item has been digitally signed and sealed by Taqi Khawaja, PE on 12/10/2024 using a Digital Signature. Printed copies of this document are not considered signed and sealed and the signatures must be verified on any electronic copies.

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE USE5700H-USMNB75

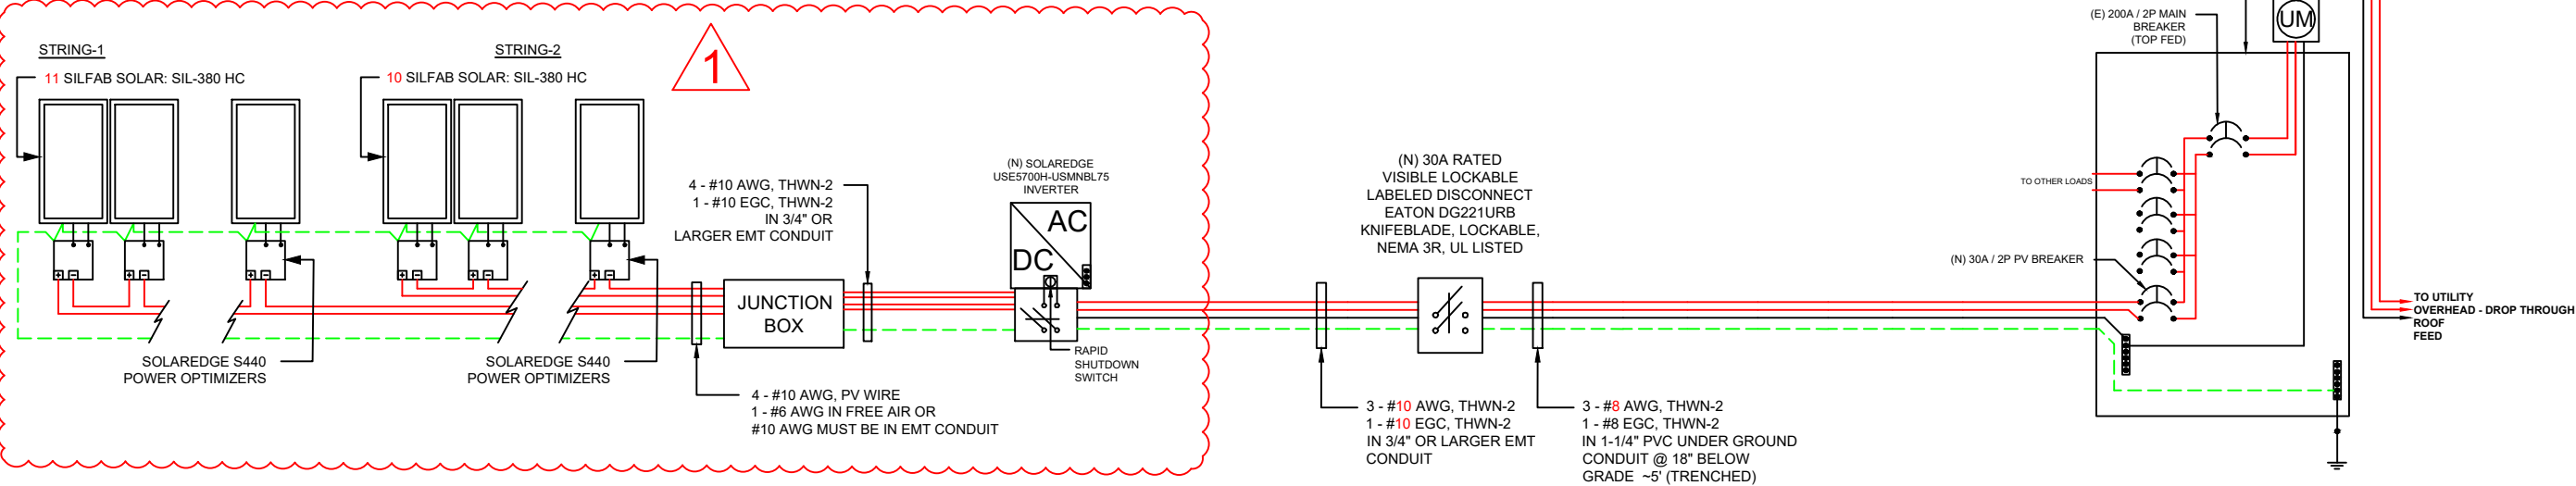


NOTE:
CONDUIT AND CONDUCTORS SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS

REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-

FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT



CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

THREE LINE DIAGRAM			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-4

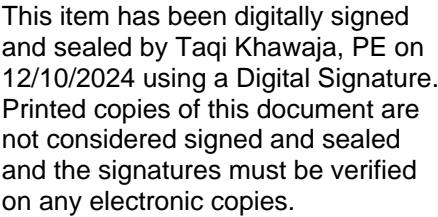


CONDUCTOR AMPACITY CALCULATIONS IN ACCORDANCE WITH NEC 690.8.

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HO
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE
 USE5700H-USMNB175



Gay Albert

CONDUCTOR CALCULATIONS			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-5

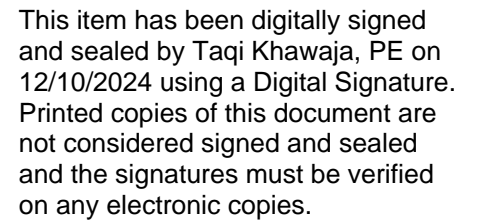[illegible][illegible][illegible]

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE
USE5700H-USMNB175

	REVISIONS	
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-



EQUIPMENT & SERVICE LIST			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-6

MAIN PHOTOVOLTAIC
SYSTEM DISCONNECT

690.13(B)

DO NOT DISCONNECT
UNDER LOAD

NEC 690.15 (B) & NEC 690.33(D)(2)

WARNING

SINGLE 120-VOLT SUPPLY
DO NOT CONNECT
MULTIWIRE BRANCH CIRCUITS

NEC 710.15(C) & 692.9 (C)

WARNING DUAL POWER SOURCE
SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

NEC 705.12(D) & NEC 690.59

WARNING

TURN OFF PHOTOVOLTAIC
AC DISCONNECT PRIOR TO
WORKING INSIDE PANEL

NEC 110.27(C) & OSHA 1910.145(F)(7)

WARNING

ELECTRICAL SHOCK HAZARD
TERMINALS ON THE LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION

706.15(C)(4) & 690.13(B)

WARNING

THIS EQUIPMENT FED BY
MULTIPLE SOURCES:
TOTAL RATING OF ALL OVERCURRENT
DEVICES EXCLUDING MAIN POWER
SUPPLY SHALL NOT EXCEED
AMPACITY OF BUSBAR

NEC 705.12(B)(3)(3)

WARNING

THE DISCONNECTION OF THE
GROUNDED CONDUCTOR(S)
MAY RESULT IN OVERVOLTAGE
ON THE EQUIPMENT

NEC 690.31(E)

RAPID SHUTDOWN SWITCH FOR
SOLAR PV SYSTEM

690.56(C)(3)


If you have any questions about your system, please call
our Customer Support Team at
888.557.6431
or visit freedomforever.com/customer-service

This solar PV system was installed by
freedom
FOREVER

*Freedom Forever is a licensed contractor in all states it operates in. For more information visit freedomforever.com/forever

SOLAR PV SYSTEM EQUIPPED
WITH RAPID SHUTDOWN

TURN RAPID
SHUTDOWN SWITCH TO
THE "OFF" POSITION TO
SHUT DOWN PV SYSTEM
AND REDUCE SHOCK
HAZARD IN THE ARRAY



IFC 605.11.3.1(1) & 690.56(C)

CAUTION
PHOTOVOLTAIC SYSTEM CIRCUIT IS BACKFED

NEC 705.12(D) & NEC 690.59

WARNING
POWER SOURCE OUTPUT
CONNECTION. DO NOT
RELOCATE THIS
OVERCURRENT DEVICE.

NEC 705.12(C) & NEC 690.59

WARNING
ARC FLASH AND SHOCK HAZARD
APPROPRIATE PPE REQUIRED
24 INCH FLASH HAZARD BOUNDARY
2 CALCMF2 FLASH HAZARD AT 18 INCHES
480 VAC SHOCK HAZARD WHEN COVER IS REMOVED
42 INCH LIMITED APPROACH - 500 V CLASS 00 GLOVES
12 INCH RESTRICTED APPROACH - 500 V CLASS 00 GLOVES
1 INCH PROHIBITED APPROACH - 500 V CLASS 00 GLOVES
LOCATION: 135 SOUTHEAST SCARLETT WAY LAKE CITY, FL 32025

NEC 706.15(C) AND NEC 110.16

PHOTOVOLTAIC
AC DISCONNECT

NEC 690.13(B)

PHOTOVOLTAIC AC DISCONNECT
RATED AC OUTPUT CURRENT: **24.00A**
NOMINAL OPERATING AC VOLTAGE: **240V**

NEC 690.54

WARNING DUAL POWER SOURCE
SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

NEC 705.12(D) & NEC 690.59

SOLAR PV DC CIRCUIT

EVERY 10' ON CONDUIT AND ENCLOSURES
NEC 690.31

PHOTOVOLTAIC POWER SOURCE

EVERY 10' ON CONDUIT AND ENCLOSURES
NEC 690.31(D)(2)

MAXIMUM VOLTAGE **480** V
MAXIMUM CIRCUIT CURRENT **30** A
MAX DC-DC CONVERTER
OUTPUT CURRENT **15** A

NOTES:

- NEC ARTICLES 690 AND 705 AND IRC SECTION R324 MARKINGS SHOWN HEREON.
- ALL MARKING SHALL CONSIST OF THE FOLLOWING:
 - UV RESISTANT SIGN MATERIAL WITH ENGRAVED OR MACHINE PRINTED LETTERS OR ELECTRO-PLATING.
 - RED BACKGROUND COLOR WHITE TEXT AND LINE WORK.
 - ARIAL FONT.
- ALL SIGNS SHALL BE SIZED APPROPRIATELY AND PLACED IN THE LOCATIONS SPECIFIED. SIGNAGE CANNOT BE HAND-WRITTEN.
- SIGNS SHALL BE ATTACHED TO THE SERVICE EQUIPMENT WITH POP-RIVETS OR SCREWS



This item has been digitally signed
and sealed by Taqi Khawaja, PE on
12/10/2024 using a Digital Signature.
Printed copies of this document are
not considered signed and sealed
and the signatures must be verified
on any electronic copies.

PHOTOVOLTAIC
DC DISCONNECT

NEC 690.13(B)

MAXIMUM DC VOLTAGE
OF PV SYSTEM

NEC 690.53

WARNING
ELECTRICAL SHOCK HAZARD
TERMINALS ON THE LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION
DC VOLTAGE IS ALWAYS PRESENT
WHEN SOLAR MODULES
ARE EXPOSED TO SUNLIGHT

706.15(C)(4) & 690.13(B)


WARNING
ELECTRICAL SHOCK HAZARD
TERMINALS ON THE LINE AND
LOAD SIDES MAY BE ENERGIZED
IN THE OPEN POSITION

706.15(C)(4) & 690.13(B)

WARNING
TURN OFF PHOTOVOLTAIC
AC DISCONNECT PRIOR TO
WORKING INSIDE PANEL

NEC 110.27(C) & OSHA 1910.145(F)(7)

ARRAY

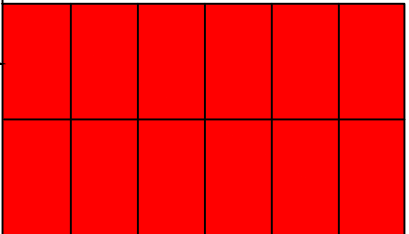

NEC 690.31(G)(3) & (4)

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE
CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREDGE S440
INVERTER: SOLAREDGE
USE5700H-USMNB175



REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-




FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO,
FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

LABELS			
JOB NO:	DATE:	DESIGNED BY:	SHEET:
496748	12/10/2024	V.	PV-7

CAUTION:

POWER TO THIS BUILDING IS
ALSO SUPPLIED FROM THE
FOLLOWING SOURCES WITH
DISCONNECTS AS SHOWN

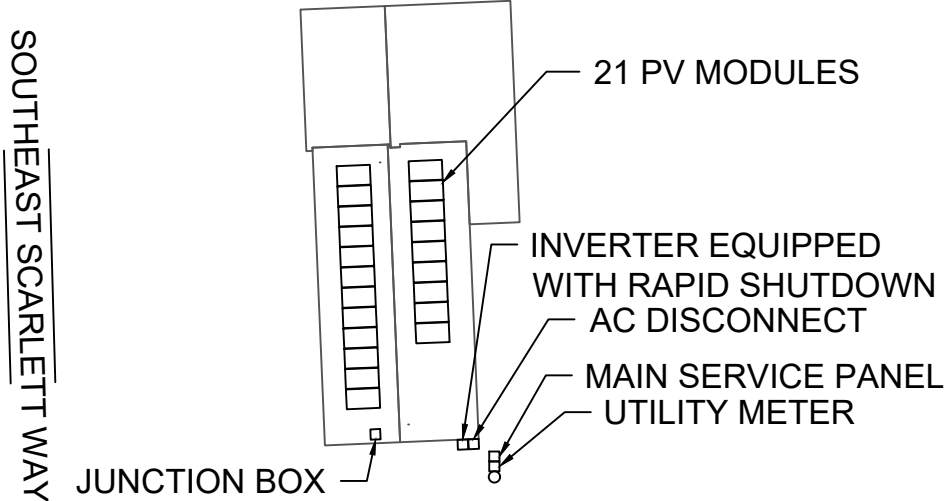

WARNING

TURN OFF PHOTOVOLTAIC AC DISCONNECT
PRIOR TO WORKING INSIDE PANEL



1

NOTES:

1. NEC ARTICLES 690 AND 705 AND IRC SECTION R324 MARKINGS SHOWN HEREON.
2. ALL MARKING SHALL CONSIST OF THE FOLLOWING:
 - A. UV RESISTANT SIGN MATERIAL WITH ENGRAVED OR MACHINE PRINTED LETTERS OR ELECTRO-PLATING.
 - B. RED BACKGROUND COLOR WHITE TEXT AND LINE WORK.
 - C. AERIAL FONT.
3. ALL SIGNS SHALL BE SIZED APPROPRIATELY AND PLACED IN THE LOCATIONS SPECIFIED. SIGNAGE CANNOT BE HAND-WRITTEN.
4. SIGNS SHALL BE ATTACHED TO THE SERVICE EQUIPMENT WITH POP-RIVETS OR SCREWS.



This item has been digitally signed
and sealed by Taqi Khawaja, PE on
12/10/2024 using a Digital Signature.
Printed copies of this document are
not considered signed and sealed
and the signatures must be verified
on any electronic copies.

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE
CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE
USE5700H-USMNB75

1

REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-



FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO,
FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

SITE PLACARD			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-7A

	1-10	11-20	21-30	31-40	41-50	51-60	SOLAREEDGE OPTIMIZER CHART											
1																		
2																		
3																		
4																		
5																		
6																		
7																		
8																		
9																		
10																		

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE USE5700H-USMNB75

1

	REVISIONS		
NO.	REVISED BY	DATE	
1	V.	12/10/2024	
-	-	-	
-	-	-	

FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

OPTIMIZER CHART			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-8

SAFETY PLAN

INSTRUCTIONS:

- 1. USE SYMBOLS IN KEY TO MARK UP THIS SHEET.
- 2. SAFETY PLAN MUST BE MARKED BEFORE JOB STARTS AS PART OF THE PRE-PLAN
- 3. DOCUMENT ALL ADDITIONAL HAZARDS ON THIS PAGE & MAKE NOTES ON THE JHA SHEET

INCIDENT REPORTING:

INJURIES - CALL INJURY HOTLINE

(855) 400-7233

**If injury is life threatening, call 911 first THEN the Injury Hotline*

NON-INJURIES - USE MOBILE INCIDENT REPORTING
(Auto, Property Damage, Near Miss)



NEAREST OCCUPATIONAL/INDUSTRIAL CLINIC:

NAME: _____

ADDRESS: _____

NEAREST HOSPITAL:

NAME: _____

ADDRESS: _____

SAFETY COACH CONTACT INFORMATION:


NAME: _____

PHONE NUMBER: _____

ALL EMPLOYEES ON SITE SHALL BE MADE AWARE OF THE SAFETY PLAN AND SIGN INDICATING THAT THEY ARE AWARE OF THE HAZARDS ON-SITE AND THE PLAN FOR WORKING SAFELY.

NAME	SIGNATURE
_____	_____
_____	_____
_____	_____
_____	_____
_____	_____
_____	_____
_____	_____

DATE: _____ TIME: _____

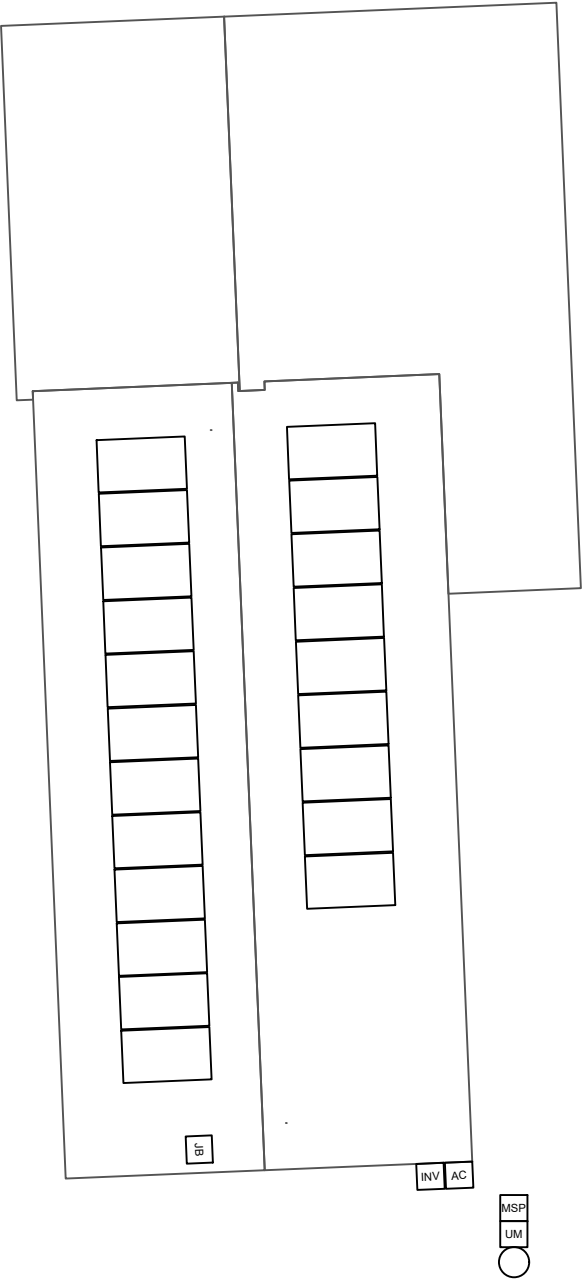

MARK UP KEY

- PERMANENT ANCHOR
- TEMPORARY ANCHOR
- INSTALLER LADDER
- JUNCTION / COMBINER BOX
- STUB-OUT
- SKYLIGHT
- NO LADDER ACCESS (STEEP GRADE OR GROUND LEVEL OBSTRUCTIONS)
- RESTRICTED ACCESS
- CONDUIT
- GAS SHUT OFF
- WATER SHUT OFF
- SERVICE DROP
- POWER LINES

POLICIES

INSTRUCTIONS:

- 1. SCAN QR LINK BELOW TO ACCESS ALL FREEDOM FOREVER SAFETY POLICIES AND PROGRAMS.



CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREEDGE S440
INVERTER: SOLAREEDGE
USE5700H-USMNB75



BREAK AND WATER LOG

THIS LOG IS TO BE FILLED OUT ANY TIME THE TEMP EXCEEDS 90 DEGREES. THE CREW LEAD AND ROOF LEAD ARE RESPONSIBLE FOR ENSURING THIS IS COMPLETED AND UPLOADED AT THE END OF EVERYDAY WHEN TEMPS EXCEED 90 DEGREES

NAME	0800HRS	0900HRS	1000HRS	1100HRS	1200HRS	1300HRS	1400HRS	1500HRS	1600HRS

REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-



FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

SAFETY PLAN			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-9

JOB HAZARD ANALYSIS

Crew leader to fill out all sections below, hold a pre-job safety meeting with all personnel, and upload this completed document and the Safety Plan to Site Capture

Ladder Access

- Ladders must be inspected before each use.
- Extension ladders must be set up on a firm and level surface at a 4-to-1 rise to run angle (or 75 degrees) and the top must be secured to the structure. Extension style ladders placed on uneven, loose or slippery surfaces must additionally have the base firmly anchored or lashed so the base will not slip out.
- Extension ladders must be used with walk-through devices or the ladder must extend 36" above the stepping off point.
- A-frame ladders must only be climbed with the ladder spreader bars locked in the open position; A-frame ladders shall not be climbed while in the closed position (ex, closed and used while leaned against a structure).

- Additional notes:

Mobile Equipment

- Only Qualified operators will operate equipment; operators must maintain a certification on their person for the equipment being operated.
- Type(s) of mobile equipment (Type/Make/Model):

- Qualified operator(s):

Material Handling and Storage

- Materials will be staged/stored in a way that does not present a hazard to client, personnel or public. Materials stored on the roof will be physically protect from failing or sliding off.

Fall Protection

- A site-specific plan for fall prevention and protection is required prior to starting work and must remain onsite at all times until work is complete; a fall rescue plan must be outlined and discussed among the crew prior to work start.
- First-person-Up (FPU) must install their anchor and connect before any other task, including installing other anchors. The Last-Person-Down (LPD) must be the only person on a roof uninstalling fall protection.

- FPCP (name and title):

- FPU and LPD (name and title):

Electrical Safety

- The Electrical Qualified Person (EQP) is required onsite to perform electrical work.
- All electrical work will be performed with equipment in an electrically safe condition (de-energized) unless approval has been granted prior to work.
- Service drops and overhead electrical hazards will be indentified and protected from contact, as neccessary.

- EQP (name and tile):

Public Protection

- The safety of the Client and Public must be maintained at all times.
- The Client and the Public shall be prevented from entering the work zone through the use of barriers and/or signage, as required.
- Company, Client and Public property shall be protected from falling objects.
- Pets (including dogs) shall be secured by their owners prior to work start.
- The Client should not leave pets, family members, or others in charge or care of Employees, Contractors, or Temporary Workers.

- Crew leader responsible for communication with the client:
- Client and public is excluded from work area by barricades (N/A, Yes, No):

Training and Pre-Job Safety Briefing

- All employees onsite shall be made aware of the specific hazards of this project and review this HJA during a pre-job briefing, and their signature indicates awareness of site conditions and the plan to eliminate any hazards identified prior to and during the project.

- Crew leader (name/title):

- Crew member (name/title):

- Crew member (name/title):

- Crew member (name/title):

- Crew member (name/title):

- Crew member (name/title):

Airborne Contaminants:

- Asbestos-containing (Transite) piping (ACP) - Do not disturb (move, drill, cut fracture, etc.)
- Asbestos-containing thermal insulation (ACI) and Asbestos-containing duct wrapping (ACW) - do not disturb, no attic or crawlspace access is allowed if work to be performed could cause exposure to personnel, client or public.

- If yes, list specific tasks and protection in place:

Weather and Environment

- The site supervisor shall forecast the weather conditions at the job site, prior to crew arrival, in order to mitigate any hazards associated with inclement weather (heat, cold, wind, rain, etc.)
- The site supervisor will utilized a portable wind meter (anemometer) to verify actual onsite wind conditions, by checking at the ground and on any elevated work surface (ex, rooftop) prior to work start, at midday and prior to solar panel staging on a roof.
- Elevated work involving the moving or maneuvering of solar panels shall cease at 25mph (sustained wind) until wind subsides.

- Forecasted weather maximum temp (degrees f):

Heat Related Illness Prevention

- Employees shall have access to potable drinking water that is fresh, pure, and suitably cool. The water shall be located as close as practicable to the areas where employees are working. Water shall be supplied in sufficient quantity at the beginning of the work shift to provide at least one quart per employee per hour for drinking for the entire shift. Employees may begin the shift with smaller quantities of water if they identify the location and have effective means for replenishment during the shift to allow employees to drink on quart or more per hour. The frequent drinking of water shall be encouraged.
- Shade shall be present when temperature exceeds 80 degrees Fahrenheit. When the outdoor temperature in the work exceeds 80 degrees Fahrenheit, employees shall have and maintain one or more areas with shade at all times.
- New employees must be acclimatized. New employees will be monitored by their Crew Leader (site supervisor) for the first two (2) weeks of employment or longer when necessary.
- Employees will be allowed and encouraged to implement scheduled breaks during each shift. Employees must take cool-down breaks in the shade any time they feel the need to do so to protect them from overheating. Supervisors are REQUIRED to allow employees any break period they need during high heat conditions.
- Cool Vests are encouraged for all employees at all times during periods of high heat.
- Identify the location of the closet Occupational/Industrial Clinic or Hospital in case a crew member becomes ill.

What is the specific plan to provide and replenish sufficient water for all employees on site?

- If offsite replenish is necessary, where will you go to replenish water (location/address):

- Who will replenish the drinking water (name):

Restroom facilities

- Employees shall have access to restroom facilities with hand-washing stations. Use of onsite restroom is at the client's discretion (location is annotated below). If client does not give permission, location of suitable restroom facilities with hand-washing stations offsite will be provided. The onsite supervisor will identify location and make arrangements to ensure all employees have access at any point.

- Restroom facilities will be (circle one): Onsite - Offsite
- If Offsite, add location name and address:

Incident Reporting Procedure

- Contact your Site Supervisor

Name:

Phone:

- Contact your Manager

Name:

Phone:

- Contact your Site Supervisor

Name:

Phone:

With: Your full name, phone number, office location, brief description of what happen and when.

NOTE ADDITIONAL HAZARDS NOT ADDRESSED ABOVE
(add as many as necessary by using additional sheets)

Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:
Define the Hazard:	Method/steps to prevent incident:

CLIENT:
FRANK VOIGT
135 SOUTHEAST SCARLETT WAY, LAKE CITY, FL 32025
AHJ: COUNTY OF COLUMBIA
UTILITY: FPL - FLORIDA POWER & LIGHT
METER: ACD7965
APN: 03-4S-17-07570-066
PHONE: (402) 290-9386
EMAIL: USN1RET@GMAIL.COM

SYSTEM:
SYSTEM SIZE (DC): 21 X 380 = 7.980 kW
SYSTEM SIZE (AC): 5.760 kW @ 240V
MODULES: 21 X SILFAB SOLAR: SIL-380 HC
OPTIMIZERS: 21 X SOLAREDGE S440
INVERTER: SOLAREDGE
USE5700H-USMNB75



REVISIONS		
NO.	REVISED BY	DATE
1	V.	12/10/2024
-	-	-
-	-	-



FREEDOM FOREVER LLC
2619 CONSULATE DR SUITE 800, ORLANDO, FL 32819
Tel: (800) 385-1075
GREG ALBRIGHT

CONTRACTOR LICENSE:
CERTIFIED ELECTRICAL CONTRACTOR
EC13008056

SAFETY PLAN			
JOB NO: 496748	DATE: 12/10/2024	DESIGNED BY: V.	SHEET: PV-10

FOR INSTALLATION REFERENCE ONLY

SCAN QR CODE TO ACCESS REFERENCE LINK

FREEDOM REFERENCES



INSTALL HOTLINE

PV INSTALLATION REFERENCES



ENPHASE



SOLAREEDGE



TESLA

BATTERY INSTALLATION REFERENCES



Enphase Storage Systems



SOLAREEDGE Storage Systems



TESLA Storage Systems



NON-BACKUP Battery Systems



Misc. Quick Guide

SILFAB PRIME

SIL-380 HC



ELECTRICAL SPECIFICATIONS		380	
Test Conditions		STC	NOCT
Module Power (Pmax)	Wp	380	284
Maximum power voltage (Vpmax)	V	35.32	32.83
Maximum power current (Ipmax)	A	10.77	8.64
Open circuit voltage (Voc)	V	42.17	39.55
Short circuit current (Isc)	A	11.36	9.16
Module efficiency	%	20.8%	19.4%
Maximum system voltage (VDC)	V	1000	
Series fuse rating	A	20	
Power Tolerance	Wp	0 to +10	


Measurement conditions: STC 1000 W/m² • AM 1.5 • Temperature 25 °C • NOCT 800 W/m² • AM 1.5 • Measurement uncertainty ≤ 3%
Sun simulator calibration reference modules from Fraunhofer Institute. Electrical characteristics may vary by ±5% and power by 0 to +10W.

MECHANICAL PROPERTIES / COMPONENTS	METRIC	IMPERIAL
Module weight	19.5kg ±0.2kg	43lbs ±0.4lbs
Dimensions (H x L x D)	1762 mm x 1037 mm x 35 mm	69.4 in x 40.8 in x 1.37 in
Maximum surface load (wind/snow)*	5400 Pa rear load / 5400 Pa front load	112.8 lb/ft² rear load / 112.8 lb/ft² front load
Hail impact resistance	ø 25 mm at 83 km/h	ø 1 in at 51.6 mph
Cells	120 Half cells - Si mono PERC 9 busbar - 83 x 166 mm	120 Half cells- Si mono PERC 9 busbar - 3.26 x 6.53 in
Glass	3.2 mm high transmittance, tempered, DSM antireflective coating	0.126 in high transmittance, tempered, DSM antireflective coating
Cables and connectors (refer to installation manual)	1350 mm, ø 5.7 mm, MC4 from Staubli	53.15 in, ø 0.22 in (12AWG), MC4 from Staubli
Backsheet	High durability, superior hydrolysis and UV resistance, multi-layer dielectric film, fluorine-free PV backsheet	
Frame	Anodized Aluminum (Black)	
Bypass diodes	3 diodes-30SQ045T (45V max DC blocking voltage, 30A max forward rectified current)	
Junction Box	UL 3730 Certified, IEC 62790 Certified, IP68 rated	

TEMPERATURE RATINGS		WARRANTIES	
Temperature Coefficient Isc	+0.064 %/°C	Module product workmanship warranty	25 years**
Temperature Coefficient Voc	-0.28 %/°C	Linear power performance guarantee	30 years
Temperature Coefficient Pmax	-0.36 %/°C		≥ 97.1% end 1st yr ≥ 91.6% end 12th yr ≥ 85.1% end 25th yr ≥ 82.6% end 30th yr
NOCT (± 2°C)	45 °C		
Operating temperature	-40/+85 °C		

CERTIFICATIONS		SHIPPING SPECS	
Product	ULC ORD C1703, UL1703, CEC listed, UL 61215-1/-2, UL 61730-1/-2, IEC 61215-1/-2. IEC 61730-1/-2, CSA C22.2#61730-1/-2, IEC 62716 Ammonia Corrosion; IEC61701:2011 Salt Mist Corrosion Certified, UL Fire Rating: Type 2	Modules Per Pallet:	26 or 26 (California)
Factory	ISO9001:2015	Pallets Per Truck	34 or 32 (California)
		Modules Per Truck	884 or 832 (California)

* ⚠ Warning. Read the Safety and Installation Manual for mounting specifications and before handling, installing and operating modules.
** 12 year extendable to 25 years subject to registration and conditions outlined under “Warranty” at silfabsolar.com
PAN files generated from 3rd party performance data are available for download at: silfabsolar.com/downloads

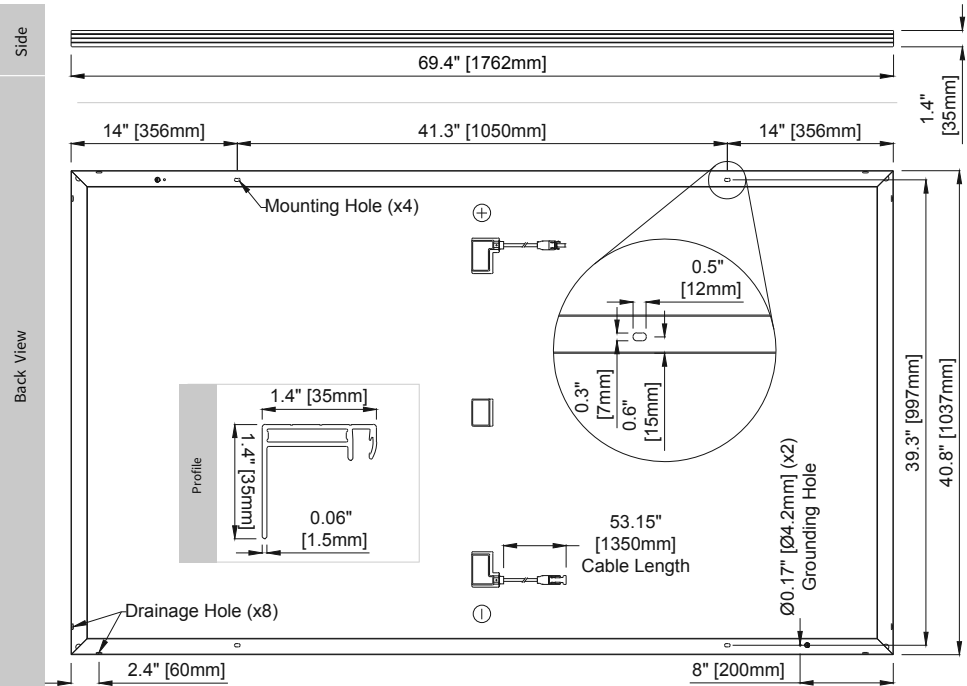

SILFAB SOLAR INC.

800 Cornwall Ave
Bellingham WA 98225 USA
T +1 360.569.4733
info@silfabsolar.com
SILFABSOLAR.COM

1770 Port Drive
Burlington WA 98233 USA
T +1 360.569.4733

240 Courtneypark Drive East
Mississauga ON L5T 2Y3 Canada
T +1 905.255.2501
F +1 905.696.0267

Silfab - SIL-380-HC-20220223
No reproduction of any kind is allowed without permission. Data and information is subject to modifications without notice. © Silfab Solar Inc., 2021. Silfab Solar™ is a trademark of Silfab Solar Inc.

RELIABLE ENERGY.
DIRECT FROM THE SOURCE.
Introducing Silfab Prime.

Designed to outperform.

Dependable, durable, high-performance solar panels
engineered for North American homeowners.

SILFABSOLAR.COM



CHUBB
* Chubb provides error and omission insurance to Silfab Solar Inc.

SolarEdge Home Hub Inverter

USA Domestic Content Eligible*

Single Phase, for North America

SE3800H-US / SE5700H-US / SE7600H-US / SE10000H-US / SE11400H-US



HOME BACKUP

SolarEdge's USA-manufactured residential single phase inverter offering for storage and backup applications

- /

Eligible for domestic content: SolarEdge USA-manufactured inverters*, when paired with certain SolarEdge power optimizers, are intended to be eligible for the enhanced federal income tax credit for domestic content
- /

The ultimate home energy manager in charge of PV production, battery storage, backup operation during a power outage**, EV Charging, and smart energy devices
- /

Record-breaking 99% weighted efficiency with up to 200% DC oversizing
- /

Able to start high LRA HVAC systems during backup operation
- /

Integrates seamlessly with the complete SolarEdge Home Smart Energy Ecosystem, through SolarEdge Home Network
- /

Module-level monitoring and visibility of battery status, PV production, and self-consumption data
- /

Fast and easy installation – small and lightweight, with reduced commissioning time
- /

A scalable solution that supports future homeowner needs through easy connection to a growing ecosystem of products
- /

Advanced safety features with integrated arc fault protection and rapid shutdown for 690.11 and 690.12
- /

Advanced reliability with automotive-grade components
- /

Embedded revenue grade production data, ANSI C12.20 Class 0.5
- /

NEMA 4X-rated, for indoor and outdoor installations
- /

Embedded Power Control System (PCS) – install larger systems while avoiding main panel upgrade

* Manufactured by SolarEdge with the intent to be eligible for inclusion under the elective safe harbor in calculating the Domestic Cost Percentage under the "Rooftop (MLPE)" category (under IRS Notice 2024-41). For inverters with part number USExxxxH-USMNB175, the PCBA, Electrical Parts, and Enclosure are domestically produced and manufactured to meet the requirements of eligibility to be considered for the ITC domestic content bonus adder. For inverters with part number SExxxxH-USMNxB1x5, the PCBA and Enclosure are domestically manufactured to meet the requirements of eligibility to be considered for the ITC domestic content bonus adder. SolarEdge does not provide tax and/or legal advice. You should consult with your own legal and/or tax advisor(s) regarding the eligibility of your project for the ITC or PTC, including the 10% domestic content bonus, to determine how the applicable rules apply to your particular project. The forward-looking statements in this datasheet are accurate as of the date herein and are subject to change. For more information, please contact your local SolarEdge sales representative.

** Requires additional hardware and firmware version upgrade.

solaredge.com



/ SolarEdge Home Hub Inverter

USA Domestic Content Eligible

Single Phase, for North America

SE3800H-US / SE5700H-US / SE7600H-US / SE10000H-US / SE11400H-US

Applicable to inverters with part number	SExxxxxH-USMNxBLx5 / USExxxxxH-USMNB175					
Model Number ⁽¹⁾	SE3800H-US	SE5700H-US	SE7600H-US	SE10000H-US	SE11400H-US	
OUTPUT – AC ON GRID						
Maximum AC Power Output	3800 @ 240V 3300 @ 208V	5760 @ 240V 5000 @ 208V	7600 @ 240V	10,000 @ 240V	11,400 @ 240V 10,000 @ 208V	W
AC Output Voltage (Nominal)	208 / 240					Vac
AC Output Voltage (Range)	183 – 264					Vac
AC Frequency Range (min - nom - max)	59.3 – 60 – 60.5 ⁽²⁾					Hz
Maximum Continuous Output Current	16 @ 240V 16 @ 208V	24 @240V 24 @ 208V	32 @ 240V	42 @ 240V	47.5 @ 240V 48 @208V	A
GFDI Threshold	1					A
Total Harmonic Distortion (THD)	< 3					%
Power Factor	1, adjustable -0.85 to 0.85					
Utility Monitoring, Islanding Protection, Country Configurable Thresholds	Yes					
Charge Battery from AC (if allowed)	Yes					
Typical Nighttime Power Consumption	< 2.5					W
OUTPUT – AC STANDALONE (BACKUP) ⁽³⁾						
Rated AC Power in Standalone Operation ⁽⁴⁾	11,400					W
Maximum Continuous Output Current in Standalone Operation	48					A
Locked Rotor Amperage (LRA) ⁽⁵⁾	Up to 106					A
AC L-L Output Voltage Range in Standalone Operation	211 – 264					Vac
AC L-N Output Voltage Range in Standalone Operation	105 – 132					Vac
AC Frequency Range in Standalone Operation (min - nom - max)	55 – 60 – 65					Hz
GFDI	1					A
THD	< 5					%
INPUT – DC (PV AND BATTERY)						
Transformer-less, Ungrounded	Yes					
Maximum Input Voltage	480					Vdc
Nominal DC Input Voltage	380					Vdc
Reverse-Polarity Protection	Yes					
Ground-Fault Isolation Detection	600kΩ Sensitivity					
Maximum Input Short Circuit Current	45					Adc
Maximum Inverter Efficiency	99.2					%
CEC Weighted Efficiency	98.5	99			99 @ 240V 98.5 @ 208V	%
2-Pole Disconnection	Yes					
DC CONNECTION – PV						
Maximum Input Power	7600 @ 240V 6600 @ 208V	11,520 @ 240V 10,000 @ 208V	15,200 @ 240V	20,000 @ 240V	22,800 @ 240V 20,000 @ 208V	W
Maximum Input Current	20 @ 240V 17 @ 208V	30 @ 240V 26 @ 208V	40 @ 240V	53 @ 240V	60 @ 240V 53 @ 208V	Adc
Number of Ports	3					
Maximum Current per Port	40					Adc

(1) These specifications apply to inverters with part number SExxxxH-USMNxB1x5 and USExxxxH-USMNB175 and connection unit model number DCD-1PH-US-PxH-F-x

(2) For other regional settings please refer to the [SolarEdge Inverters, Power Control Options](#) application note.

(3) Not designed for non-grid connected applications and requires AC for commissioning. Standalone (backup) functionality is only supported for the 240V grid.

(4) For models SE7600H-US and below, the Rated AC Power in Standalone Operation is configurable between 7,600W with a Maximum Continuous Output Current of 32A or 11,400W with a Maximum Continuous Output Current of 48A, from firmware version 4.20.xx.

(5) For more information about LRA (Locked Rotor Amperage) values, see the [SolarEdge Home Hub Inverter LRA](#) application note.



/ SolarEdge Home Hub Inverter

USA Domestic Content Eligible

Single Phase, for North America

SE3800H-US / SE5700H-US / SE7600H-US / SE10000H-US / SE11400H-US

Applicable to inverters with part number	SExxxxxH-USMNXBLx5 / USExxxxxH-USMNB175					
Model Number ⁽¹⁾	SE3800H-US	SE5700H-US	SE7600H-US	SE10000H-US	SE11400H-US	
DC CONNECTION – BATTERY						
Supported Battery Types	SolarEdge Home Battery 400V					
Number of Batteries per Inverter	Up to 3					
Maximum Continuous Power (Charge and Discharge) ⁽⁶⁾	11,400					W
Number of Ports	2					
Maximum Current per Port	40					Adc
2-pole Disconnection	Up to the inverter's rated standalone power					
SMART ENERGY CAPABILITIES						
Consumption Metering	Built-in ⁽⁷⁾					
Standalone & Battery Storage	With Backup Interface (purchased separately) for service up to 200A; up to 3 inverters					
EV Charging	Direct connection to the SolarEdge Home EV Charger ⁽⁸⁾					
ADDITIONAL FEATURES						
Supported Communication Interfaces	RS485, Ethernet, Cellular ⁽⁹⁾ , Wi-Fi ⁽¹⁰⁾ (optional), SolarEdge Home Network ⁽¹⁰⁾ (optional)					
Revenue Grade Metering, ANSI C12.20	Built-in ⁽⁷⁾					
Integrated AC, DC, and Communication Connection Unit	Yes					
Inverter Commissioning	With the SetApp mobile application using built-in Wi-Fi Access Point for local connection					
DC Voltage Rapid Shutdown (PV and Battery)	Yes, NEC 690.12					
STANDARD COMPLIANCE						
Safety	UL 1741, UL 1741SA, UL 1741SB, UL 1699B, CSA 22.2#107.1, C22.2#330, C22.3#9, ANSI/CAN/UL 9540					
Grid Connection Standards	IEEE1547-2018 and IEEE-1547.1 Rule 21, Rule 14H					
Emissions	FCC Part 15 Class B					
Power Control System (PCS)	UL 1741 PCS ⁽¹¹⁾					
INSTALLATION SPECIFICATIONS						
AC Terminals	L1, L2, N terminal blocks, PE busbar for inverter connection L1, L2 terminal blocks, PE busbar for EV Charger AC connection					
DC Terminals	3 x terminal block pairs for PV input, 2 x terminal block pair for battery input					
AC Output and EV AC Output Conduit Size / AWG Range	1" maximum / 14 – 4 AWG					
DC Input (PV and Battery) Conduit Size / AWG Range	1" maximum / 14 – 6 AWG					
Dimensions with Connection Unit (H x W x D)	21.06 x 14.6 x 8.2 / 535 x 370 x 208					in / mm
Weight with Connection Unit	44.9 / 20.3					lb / kg
Noise	< 50					dBA
Cooling	Natural Convection					
Operating Temperature Range	-40 to +140 / -40 to +60 ⁽¹²⁾					°F / °C
Protection Rating	NEMA 4X					

(6) Discharge power is limited up to the inverter’s rated AC power for on-grid and standalone applications, as well as up to the installed batteries’ rating.
(7) For consumption metering current transformers should be ordered separately: SECT-SPL-225A-T-20 or SEACT1250-400NA-20. Revenue grade metering is only for production metering.
(8) For more information about the SolarEdge Home EV Charger, refer to the [SolarEdge Home EV Charger datasheet](#).
(9) Information concerning the data plan terms & conditions is available in [SolarEdge Communication Plan Terms and Conditions](#).
(10) SolarEdge Home Network Plugin ENET-HBNP-01 and Wi-Fi Antenna SE-ANT-ZBWIFI-KIT purchased separately. For more information, refer to the [SolarEdge Home Network Plugin](#) datasheet and the [Antenna for Wi-Fi and ZigBee Wireless Communications](#) datasheet.
(11) Only part numbers SExxxxH-USMNo7x and USExxxxH-USMNo7x support the PCS meter.
(12) Full power up to at least 122°F / 50°C; for power derating information refer to the [Temperature Derating for North America](#) technical note.

SolarEdge is a global leader in smart energy technology. By leveraging world-class engineering capabilities and with a relentless focus on innovation, SolarEdge creates smart energy solutions that power our lives and drive future progress.

SolarEdge developed an intelligent inverter solution that changed the way power is harvested and managed in photovoltaic (PV) systems. The SolarEdge DC optimized inverter maximizes power generation while lowering the cost of energy produced by the PV system.

Continuing to advance smart energy, SolarEdge addresses a broad range of energy market segments through its PV, storage, EV charging, UPS, and grid services solutions.

- f

SolarEdge
- t

@SolarEdgePV
- @

@SolarEdge_US
- y

SolarEdge North America
- in

SolarEdge
- ✉

www.solaredge.com/corporate/contact

solaredge.com

© SolarEdge Technologies, Ltd. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: September 12, 2024 DS-000229-NAM Subject to change without notice.

Cautionary Note Regarding Market Data and Industry Forecasts: This brochure may contain market data and industry forecasts from certain third-party sources. This information is based on industry surveys and the preparer’s expertise in the industry and there can be no assurance that any such market data is accurate or that any such industry forecasts will be achieved. Although we have not independently verified the accuracy of such market data and industry forecasts, we believe that the market data is reliable and that the industry forecasts are reasonable.



Power Optimizer

For North America

S440, S500



POWER OPTIMIZER

PV power optimization at the module level

- Specifically designed to work with SolarEdge residential inverters
- Detected abnormal PV connector behavior, preventing potential safety issues*
- Module-level voltage shutdown for installer and firefighter safety
- Superior efficiency (99.5%)
- Mitigates all types of module mismatch loss, from manufacturing tolerance to partial shading
- Faster installations with simplified cable management and easy assembly using a single bolt
- Flexible system design for maximum space utilization
- Compatible with bifacial PV modules
- Meets NEC requirements for arc fault protection (AFCI) and Photovoltaic Rapid Shutdown System (PVRSS)

* Expected availability in 2022

[solaredge.com](https://www.solaredge.com)



/ Power Optimizer

For North America


S440, S500

	S440	S500	Unit
INPUT			
Rated Input DC Power ⁽¹⁾	440	500	W
Absolute Maximum Input Voltage (Voc)	60		Vdc
MPPT Operating Range	8 - 60		Vdc
Maximum Short Circuit Current (Isc) of Connected PV Module	14.5	15	Adc
Maximum Efficiency	99.5		%
Weighted Efficiency	98.6		%
Overvoltage Category	II		
OUTPUT DURING OPERATION			
Maximum Output Current	15		Adc
Maximum Output Voltage	60		Vdc
OUTPUT DURING STANDBY (POWER OPTIMIZER DISCONNECTED FROM INVERTER OR INVERTER OFF)			
Safety Output Voltage per Power Optimizer	1+/-0.1		Vdc
STANDARD COMPLIANCE			
Photovoltaic Rapid Shutdown System	NEC 2014, 2017 & 2020		
EMC	FCC Part 15 Class B, IEC61000-6-2, IEC61000-6-3		
Safety	IEC62109-1 (class II safety), UL1741		
Material	UL94 V-0, UV Resistant		
RoHS	Yes		
Fire Safety	VDE-AR-E 2100-712:2013-05		
INSTALLATION SPECIFICATIONS			
Maximum Allowed System Voltage	1000		Vdc
Dimensions (W x L x H)	129 x 153 x 30 / 5.07 x 6.02 x 1.18		mm / in
Weight (including cables)	655 / 1.5		gr / lb
Input Connector	MC4 ⁽²⁾		
Input Wire Length	0.1 / 0.32		m / ft
Output Connector	MC4		
Output Wire Length	(+) 2.3, (-) 0.10 / (+) 7.54, (-) 0.32		m / ft
Operating Temperature Range ⁽³⁾	-40 to +85		°C
Protection Rating	IP68 / Type6B		
Relative Humidity	0 - 100		%

(1) Rated power of the module at STC will not exceed the power optimizer Rated Input DC Power. Modules with up to +5% power tolerance are allowed
(2) For other connector types please contact SolarEdge
(3) For ambient temperature above +70°C / +158°F power de-rating is applied. Refer to Power Optimizers Temperature De-Rating Technical Note for more details

PV System Design Using a SolarEdge Inverter		Single Phase HD-Wave	Three Phase for 208V grid	Three Phase for 277/480V grid	
Minimum String Length (Power Optimizers)	S440, S500	8	14	18	
Maximum String Length (Power Optimizers)		25		50 ⁽⁴⁾	
Maximum Nominal Power per String		5700 (6000 with SE7600-US-SE11400-U)	6000	12750	W
Maximum Allowed Connected Power per String ⁽⁵⁾ (Permitted only when the difference in connected power between strings is 1,000W or less)		Refer to Footnote 5	One String 7200W Two strings or more 7800W	15,000W	
Parallel Strings of Different Lengths or Orientations		Y			

(4) A string with more than 30 optimizers does not meet NEC rapid shutdown requirements; safety voltage will be above the 30V requirement
(5) If the inverters rated AC power < maximum nominal power per string, then the maximum power per string will be able to reach up to the inverters maximum input DC power. Refer to: <https://www.solaredge.com/sites/default/files/se-power-optimizer-single-string-design-application-note.pdf>
(6) It is not allowed to mix S-series and P-series Power Optimizers in new installations

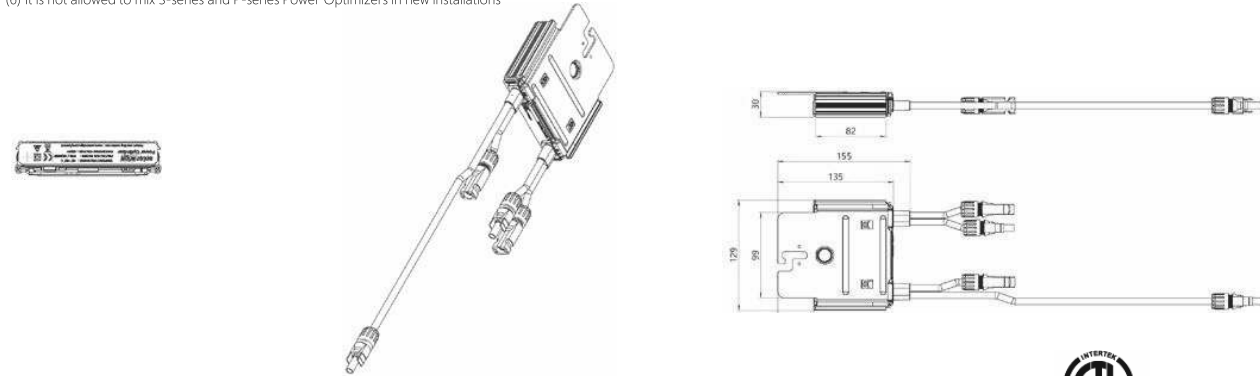

© SolarEdge Technologies, Inc. All rights reserved. SOLAREEDGE, the SolarEdge logo, OPTIMIZED BY SOLAREEDGE are trademarks or registered trademarks of SolarEdge Technologies, Inc. All other trademarks mentioned herein are trademarks of their respective owners. Date: February 8, 2022 DS-000018-NA. Subject to change without notice.



Product specifications

Eaton DG221URB

Catalog Number: DG221URB

Eaton General duty non-fusible safety switch, single-throw, 30 A, 240 V, NEMA 3R, Rainproof, Painted galvanized steel, Two-pole, Two-wire

General specifications

Product Name	Catalog Number
Eaton general duty non-fusible safety switch	DG221URB
	UPC
	782113120232
Product Length/Depth	Product Height
6.88 in	10.81 in
Product Width	Product Weight
6.38 in	6 lb
Warranty	Certifications
Eaton Selling Policy 25-000, one (1) year from the date of installation of the Product or eighteen (18) months from the date of shipment of the Product, whichever occurs first.	UL Listed
	Catalog Notes
	WARNING! Switch is not approved for service entrance unless a neutral kit is installed.



Product specifications

Product Category
General duty safety switch

Enclosure material
Painted galvanized steel

Type
Non-fusible, single-throw

Fuse configuration
Non-fusible

Number of wires
2

Enclosure
NEMA 3R

Voltage rating
240V

Amperage Rating
30A

Number Of Poles
Two-pole

Resources

Catalogs
Eaton's Volume 2—Commercial Distribution

Multimedia
Double Up on Safety
Switching Devices Flex Center

Specifications and datasheets
Eaton Specification Sheet - DG221URB



Eaton Corporation plc
Eaton House
30 Pembroke Road
Dublin 4, Ireland
Eaton.com
© 2023 Eaton. All Rights Reserved.

Eaton is a registered trademark.
All other trademarks are property of their respective owners.



Eaton.com/socialmedia

S-5!®

The Right Way!

NEW PRODUCT SolarFoot™

Introducing the new SolarFoot™ for exposed fastener metal roofing with the strength, testing, quality, and time-proven integrity you expect from S-5!. The SolarFoot provides an ideal mounting platform to attach the L-Foot (not included) of a rail-mounted PV system to the roof. This solution is The Right Way to secure rail-mounted solar systems to exposed fastener metal such as AG-Panel or R-Panel.

SolarFoot Features:

Manufactured in the U.S.A. from certified raw material

Fabricated in our own ISO 9001:2015 certified factory

All aluminum and stainless components

25yr limited warranty

Compatible with all commercial L-Foot products on the market

Factory applied 40-year isobutylene/isoprene crosslink polymer sealant for reliable weathertightness

Sealant reservoir to prevent over-compression of sealant

Load-to-failure tested Normal to Seam by a nationally accredited laboratory on numerous metal roof materials and substrates


Four points of attachment into structure or deck with tested holding strength for engineered applications

Integrated M8-1.25x17mm stud and M8-1.25 stainless steel hex flange nut included




888-825-3432 | www.S-5.com

S-5!®
The Right Way!



SolarFoot™ Mounting for Exposed Fastener Roofing

The SolarFoot is a simple, cost-effective pedestal for L-Foot (not included) attachment of rail-mounted solar PV. The unique design is compatible with all rail producer L-Foot components. The new SolarFoot assembly ensures a durable weathertight solution for the life of the roof. Special factory applied butyl co-polymeric sealant contained in a reservoir is The Right Way, allowing a water-tested seal. Stainless integrated stud and hex flange lock-nut secure the L-Foot into position. A low center of gravity reduces the moment arm commonly associated with L-Foot attachments. Direct attachment of the SolarFoot to the structural member or deck provides unparalleled holding strength.

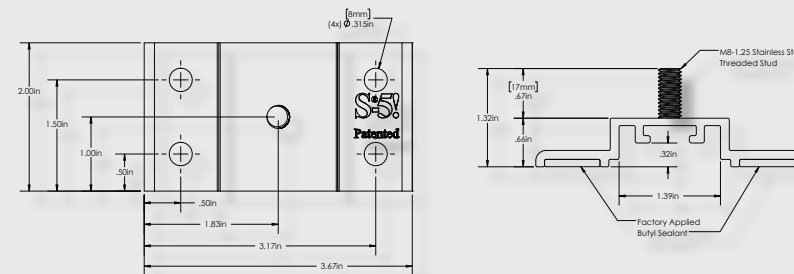

*Fasteners sold separately. Fastener type varies with substrate. Contact S-5! on how to purchase fasteners and obtain our test results. L-Foot also sold separately.

Fastener Selection



Metal to Metal:
1/4-14 Self Drilling Screw
1-1/2" to 2-1/2"



Metal to Wood:
1/4-14 Type 17 AB Milled Point
1-1/2" to 2-1/2"

To source fasteners for your projects, contact S-5!
When other brands claim to be "just as good as S-5!", tell them to PROVE IT.

SolarFoot Advantages:

Exposed fastener mounting platform for solar arrays attached via L-Foot and Rails

Weatherproof attachment to exposed fastener roofing

Butyl sealant reservoir provides long-term waterproof seal

M8-1.25x17mm stud with M8 hex flange nut for attachment of all popular L-Foot/rail combinations

Tool: 13 mm Hex Socket or 1/2" Hex Socket

Tool Required: Electric screw gun with hex drive socket for self-tapping screws.

Low Center of Gravity reduces moment arm commonly associated with L-Foot/Rail solar mounting scenarios

Attaches directly to structure or deck for optimal holding strength

S-5! Recommended substrate-specific (e.g. steel purlin, wood 2x4, OSB, etc.) fasteners provide excellent waterproofing and pull-out strength

Fastener through-hole locations comply with NDS (National Design Specification) for Wood Construction

S-5!® Warning! Please use this product responsibly!


The independent lab test data found at www.S-5.com can be used for load-critical designs and applications.

Products are protected by multiple U.S. and foreign patents. For published data regarding holding strength, fastener torque, patents, and trademarks, visit the S-5! website at www.S-5.com. Copyright 2017, Metal Roof Innovations, Ltd. S-5! products are patent protected.

Copyright 2017, Metal Roof Innovations, Ltd. Version 102017


Distributed by:

The right way to attach almost anything to metal roofs!

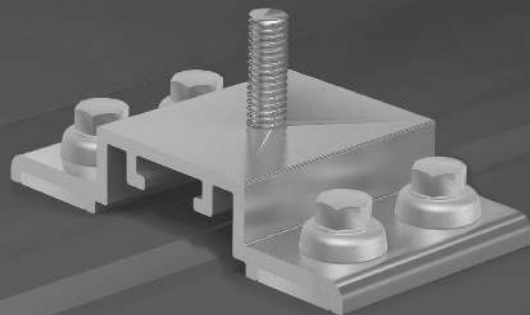

DISCOVER YOUR NXT HORIZON®

The culmination of over two decades of experience. Thoughtful design, rigorous engineering, world-class support, and a reliable supply chain are the foundation of what makes us confident that NXT HORIZON® is the NXT Level of DESIGN, SIMPLICITY, and VALUE.

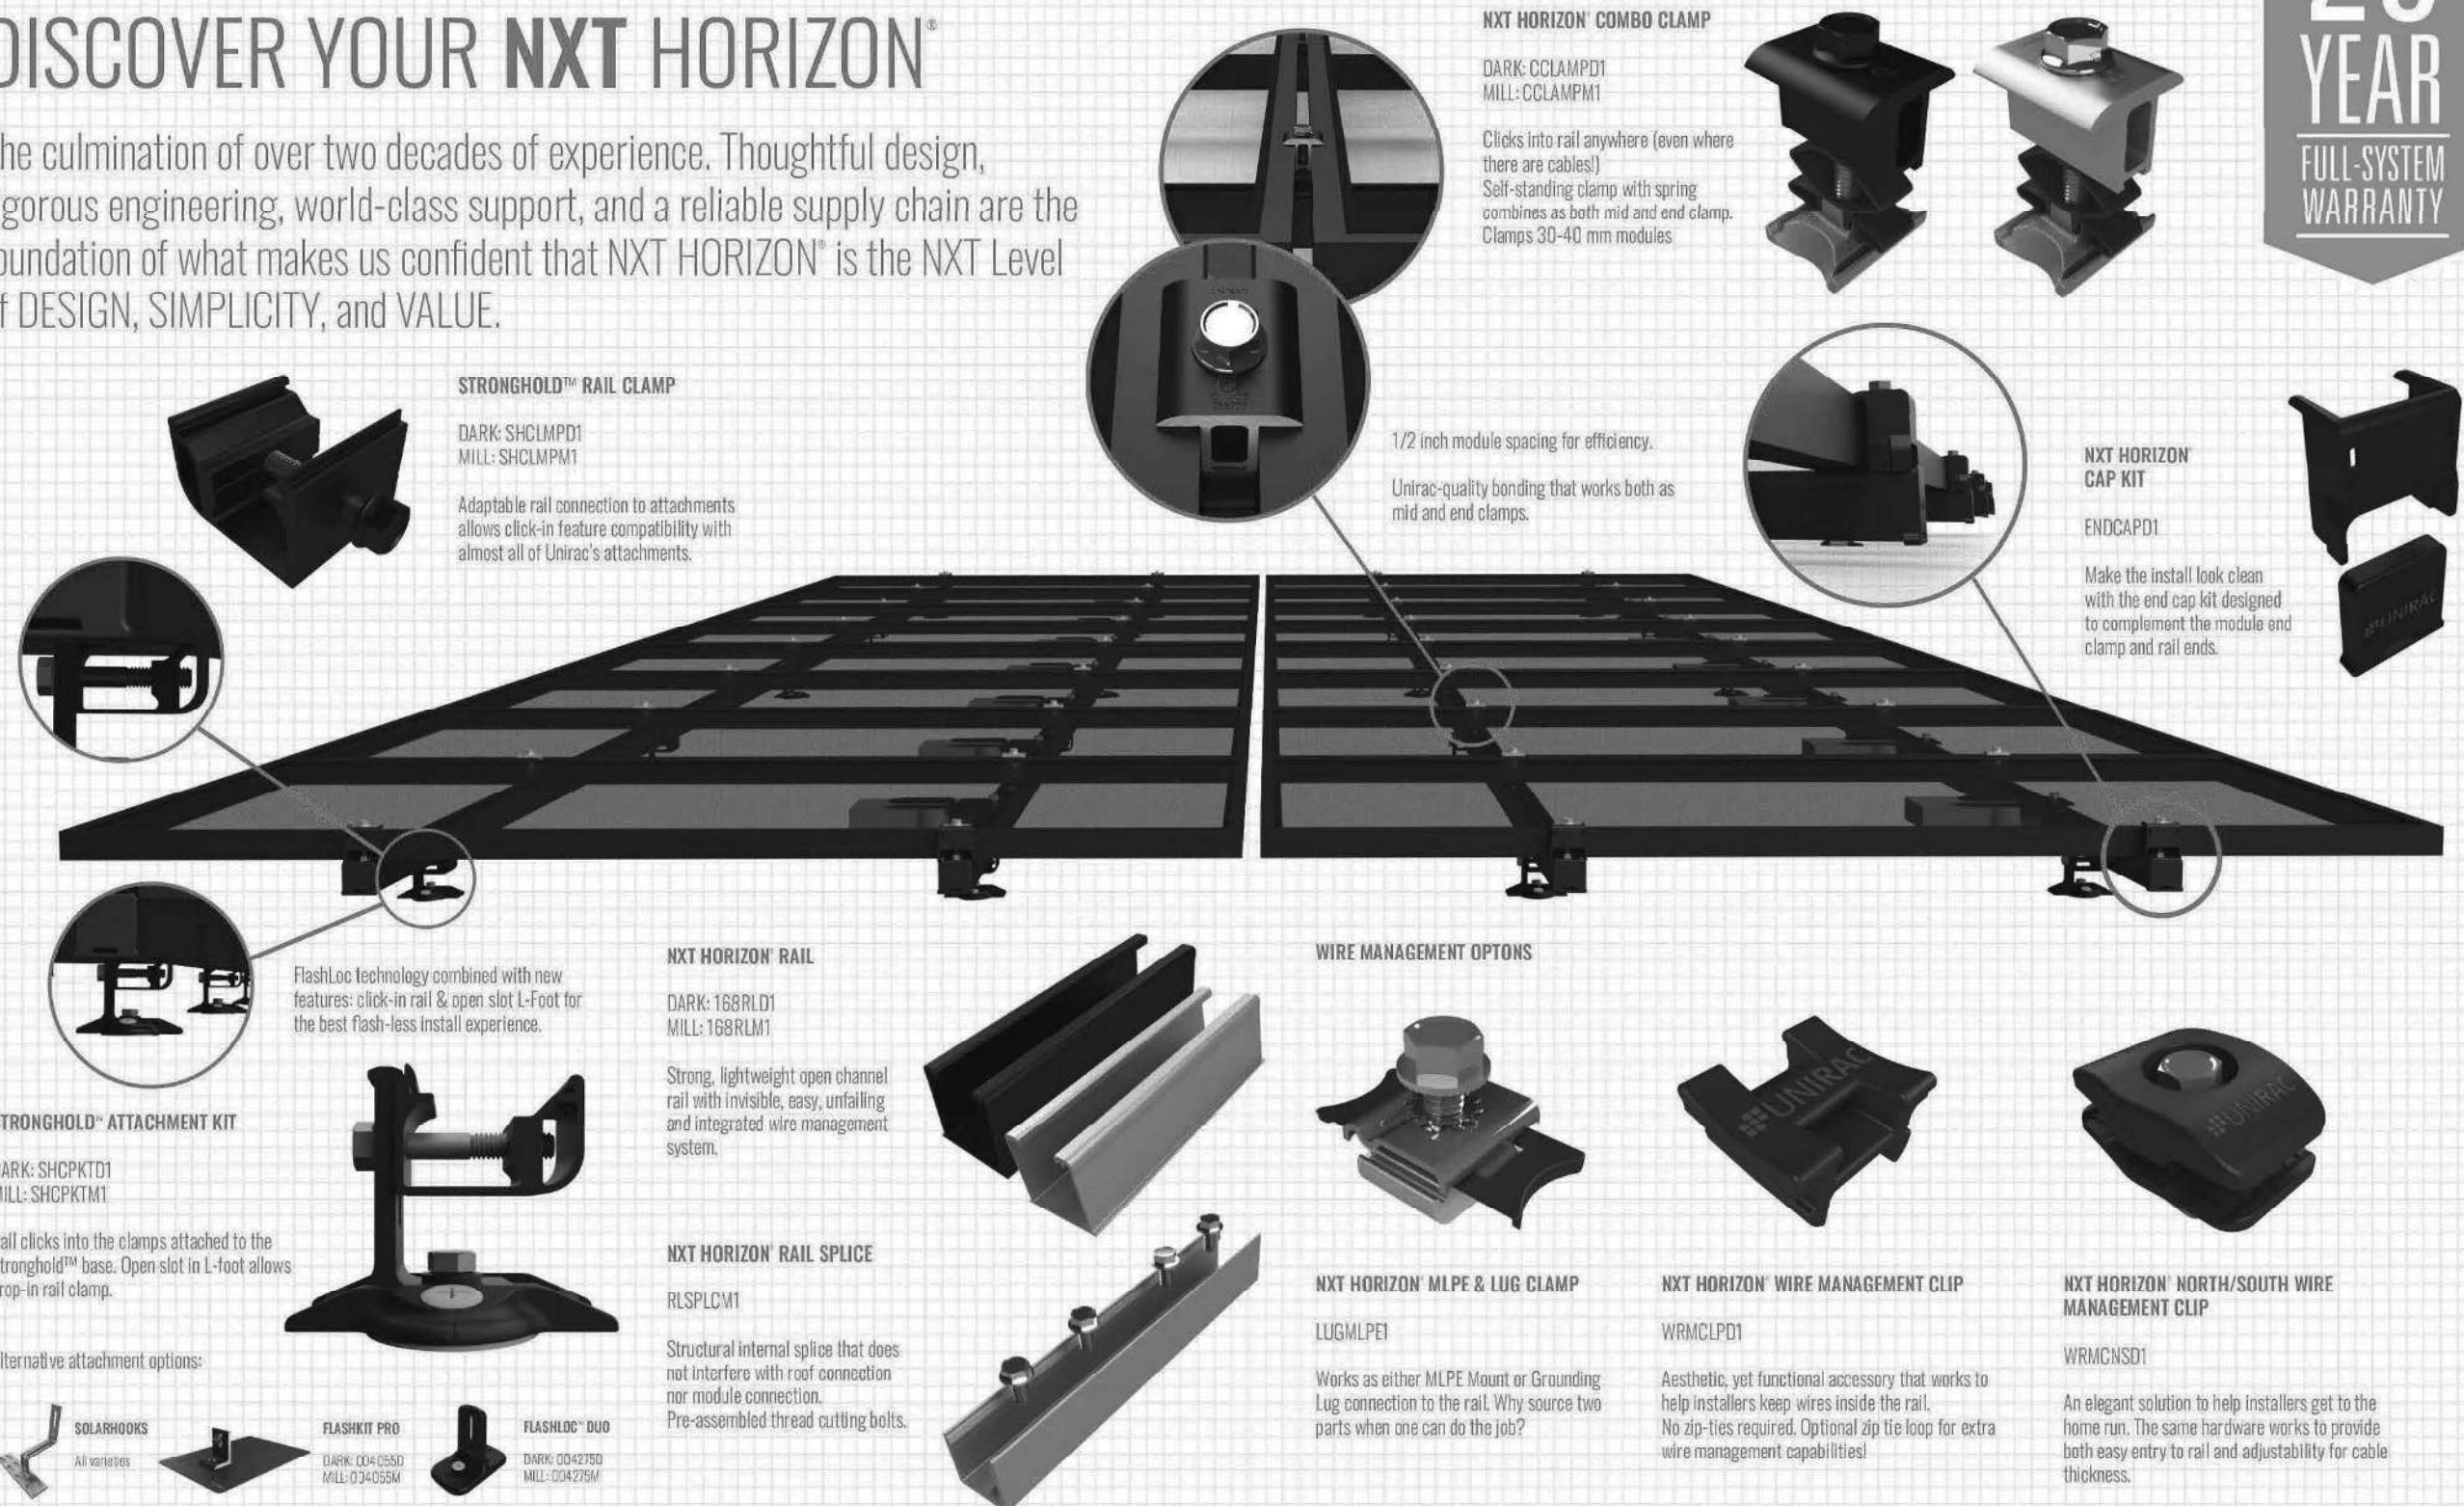

NXT HORIZON® COMBO CLAMP

DARK: CCLAMPD1
MILL: CCLAMPM1


Clicks into rail anywhere (even where there are cables!)
Self-standing clamp with spring combines as both mid and end clamp.
Clamps 30-40 mm modules



STRONGHOLD™ RAIL CLAMP


DARK: SHCLMPD1
MILL: SHCLMPM1

Adaptable rail connection to attachments allows click-in feature compatibility with almost all of Unirac's attachments.

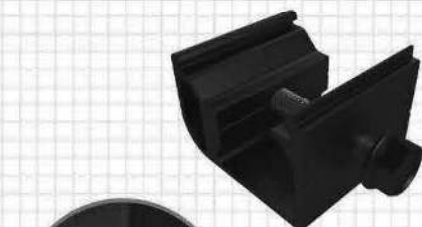

1/2 inch module spacing for efficiency.


Unirac-quality bonding that works both as mid and end clamps.

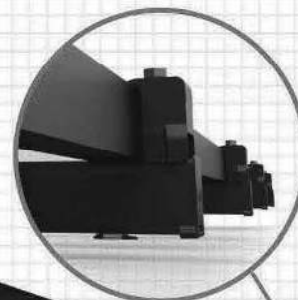

NXT HORIZON CAP KIT

ENDCAPD1

Make the install look clean with the end cap kit designed to complement the module end clamp and rail ends.



STRONGHOLD™ ATTACHMENT KIT

DARK: SHCPKTD1
MILL: SHCPKTM1

Rail clicks into the clamps attached to the Stronghold™ base. Open slot in L-foot allows drop-in rail clamp.

Alternative attachment options:




FLASHKIT PRO
DARK: C04055D
MILL: C04055M

FLASHLOC™ DUO
DARK: C04275D
MILL: C04275M

NXT HORIZON® RAIL

DARK: 168RLD1
MILL: 168RLM1


Strong, lightweight open channel rail with invisible, easy, unfailing and integrated wire management system.

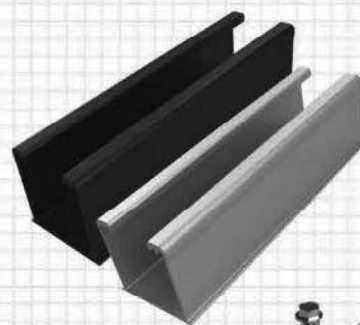


NXT HORIZON® RAIL SPLICE

RLSPLCM1

Structural internal splice that does not interfere with roof connection nor module connection.
Pre-assembled thread cutting bolts.

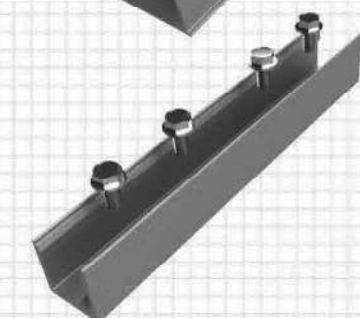

WIRE MANAGEMENT OPTIONS



NXT HORIZON® MLPE & LUG CLAMP

LUGMLPE1

Works as either MLPE Mount or Grounding Lug connection to the rail. Why source two parts when one can do the job?



NXT HORIZON® WIRE MANAGEMENT CLIP

WRMCLPD1

Aesthetic, yet functional accessory that works to help installers keep wires inside the rail. No zip-ties required. Optional zip tie loop for extra wire management capabilities!



NXT HORIZON® NORTH/SOUTH WIRE MANAGEMENT CLIP

WRMCHSD1

An elegant solution to help installers get to the home run. The same hardware works to provide both easy entry to rail and adjustability for cable thickness.



Certificate: 70131735
Project: 80182385

Master Contract: 266909
Date Issued: 2023-11-29

Downward Design Load (lb/ft²)	33.9
Upward Design Load (lb/ft²)	33.9
Down-Slope Load (lb/ft²)	16.5

Model	NXT UMOUNT	-	Flush-to-Roof is an extruded aluminum rail PV racking system that is installed parallel to the roof in landscape or portrait orientations.
-------	---------------	---	--

NXT UMOUNT

The system listed is designed to provide bonding/grounding, and mechanical stability for photovoltaic modules. The system is secured to the roof with the L-Foot components through the roofing material to building structure. Modules are secured to the racking system with aluminum mid clamps and aluminum end clamps. The modules are bonded to the racking system with bonding mid and end clamps with piercing points. Fire ratings of Class A with Type 1, 2, 3 (with metallic frame), 10(with metallic frame), 19, 22, 25, 29, or 30 for steep and low slope. Tested at 5” interstitial gap which allows installation at any stand-off height.

The grounding of the system is intended to comply with the latest edition of the National Electrical Code, to include NEC 250 & 690. Local codes compliance is required, in addition to national codes. All grounding/bonding connections are to be torqued in accordance with the Installation Manual and the settings used during the certification testing for the current edition of the project report.

Latest Install Manual revision: PUB2023NOV10

UL 2703 Mechanical Load ratings for tested module area 21.86 sq ft:

NXT Systems without DTD Butyl Attachment P30817211, Rail Splice P30808218, or Rail Clamp P30817214	
Downward Design Load (lb/ft²)	113.7
Upward Design Load (lb/ft²)	51.1
Down-Slope Load (lb/ft²)	16.8

NXT Systems with DTD Butyl Attachment P30817211, Rail Splice P30808218, or Rail Clamp P30817214	
Downward Design Load (lb/ft²)	51.1
Upward Design Load (lb/ft²)	51.1



Certificate: 70131735
Project: 80182385

Master Contract: 266909
Date Issued: 2023-11-29

Down-Slope Load (lb/ft²)	16.8
--------------------------	------

UL 2703 and TIL Mechanical Load ratings tested module area 27.76 sq ft:

NXT Systems without DTD Butyl Attachment P30817211, Rail Splice P30808218, or Rail Clamp P30817214	
Downward Design Load (lb/ft²)	50.1
Upward Design Load (lb/ft²)	22.2
Down-Slope Load (lb/ft²)	8.0

NXT Systems with DTD Butyl Attachment P30817211, Rail Splice P30808218, or Rail Clamp P30817214	
Downward Design Load (lb/ft²)	39.47
Upward Design Load (lb/ft²)	22.2
Down-Slope Load (lb/ft²)	8.0

UL 2703 and TIL Mechanical Load ratings tested module area 29.49 sq ft:

NXT Systems with all components included in PUB2023NOV10 Install Manual	
Downward Design Load (lb/ft²)	37.06
Upward Design Load (lb/ft²)	20.97
Down-Slope Load (lb/ft²)	7.53

Model	SM Ascender	-	One or two row elevated or non-elevated roof system is an extruded aluminum rail PV racking system that is installed to the roof in portrait orientation.
-------	-------------	---	---

SM Ascender

The system listed is designed to provide bonding/grounding, and mechanical stability for photovoltaic modules. The system is secured to the roof with the L-Foot components through the roofing material to building structure. Modules are secured to the racking system with aluminum mid clamps and aluminum end clamps. Fire rating of Class A when installed over non-combustible roofing materials.



February 5, 2024

Unirac, Inc.
1411 Broadway Boulevard NE
Albuquerque, New Mexico 87102
TEL: (505) 242-6411
FAX: (505)242-6512

Re.: Innova Technologies No.: 124-099-1000
Unirac NXT U-Mount Design Tool – Florida

Attn: Engineering Services

Innova Technologies Inc. has reviewed Unirac's NXT U-Mount design tool and analysis, including the U-Builder online tool. NXT U-mount is a proprietary system to support Photovoltaic (PV) panels on a rooftop structure.

All analysis and information in the NXT design tool's formulas and tables comply with the following:

- 2009-2021 International Building Code by International Code Council Inc. with provisions from SEAO PV-2
- ASCE/SEI 7-05 through 7-22 Minimum Design Loads and Other Structures, by American Society of Civil Engineers.
- Florida Building Code 2020, and 2023 Editions
- 2005 - 2020 Aluminum Design Manual, by the Aluminum Association.

This letter certifies that the structural analysis of the racking members and their direct components comply with the above codes and methodologies. This Design tool does not review the existing roof structure, or the PV panels themselves.

The U-Builder tool should be used under review of a registered design professional where required by the authority having jurisdiction.

For more information, see the construction drawings, and manufacturer installation instructions.

Best Regards,



COA # 29916

Adriana Gonorazky
Sr. Vice President
Innova Technologies, Inc.

