

DATE 09/09/2010

Columbia County Building Permit

PERMIT

This Permit Must Be Prominently Posted on Premises During Construction

000028847

APPLICANT KATIE REED PHONE 386.752.4072
ADDRESS 2230 SE BAYA DRIVE, STE 101 LAKE CITY FL 32025
OWNER CLAUDE & AGATHIA BRADFORD PHONE 386.438.4151
ADDRESS 230 SE CAROB GLN LAKE CITY FL 32025
CONTRACTOR L. DON REED PHONE 386.752.4072
LOCATION OF PROPERTY 90E- TO SR 100,TR TO C-245,TR TO PLANT,TL TO GOLDIE TR
TO CAROB GLN,TL YELLOW SFD ON L. @ THE VERY END.
TYPE DEVELOPMENT ADD/SFD ESTIMATED COST OF CONSTRUCTION 10750.00
HEATED FLOOR AREA 203.00 TOTAL AREA 203.00 HEIGHT 18.00 STORIES 1
FOUNDATION CONC WALLS FRAMED ROOF PITCH 5'12 FLOOR CONC
LAND USE & ZONING RSF-2 MAX. HEIGHT 35
Minimum Set Back Requirments: STREET-FRONT 25.00 REAR 15.00 SIDE 10.00
NO. EX.D.U. 1 FLOOD ZONE X DEVELOPMENT PERMIT NO. _____

PARCEL ID 03-4S-17-07570-023 SUBDIVISION SUZANNE
LOT 23 BLOCK _____ PHASE _____ UNIT 1 TOTAL ACRES 0.50

CGC036224 x Katie Reed
Culvert Permit No. _____ Culvert Waiver _____ Contractor's License Number _____ Applicant/Owner/Contractor _____
EXISTING 10-0373-E BLK TC
Driveway Connection _____ Septic Tank Number _____ LU & Zoning checked by _____ Approved for Issuance _____ New Resident _____
COMMENTS: NOC ON FILE.

Check # or Cash 1337

FOR BUILDING & ZONING DEPARTMENT ONLY

(footer/Slab)

Temporary Power _____ Foundation _____ Monolithic _____
date/app. by _____ date/app. by _____ date/app. by _____
Under slab rough-in plumbing _____ Slab _____ Sheathing/Nailing _____
date/app. by _____ date/app. by _____ date/app. by _____
Framing _____ Insulation _____
date/app. by _____ date/app. by _____
Rough-in plumbing above slab and below wood floor _____ Electrical rough-in _____
date/app. by _____ date/app. by _____
Heat & Air Duct _____ Peri. beam (Lintel) _____ Pool _____
date/app. by _____ date/app. by _____ date/app. by _____
Permanent power _____ C.O. Final _____ Culvert _____
date/app. by _____ date/app. by _____ date/app. by _____
Pump pole _____ Utility Pole _____ M/H tie downs, blocking, electricity and plumbing _____
date/app. by _____ date/app. by _____ date/app. by _____
Reconnection _____ RV _____ Re-roof _____
date/app. by _____ date/app. by _____ date/app. by _____

BUILDING PERMIT FEE \$ 55.00 CERTIFICATION FEE \$ 1.02 SURCHARGE FEE \$ 1.02
MISC. FEES \$ 0.00 ZONING CERT. FEE \$ 50.00 FIRE FEE \$ 0.00 WASTE FEE \$ _____
FLOOD DEVELOPMENT FEE \$ _____ FLOOD ZONE FEE \$ 25.00 CULVERT FEE \$ _____ TOTAL FEE 132.04
INSPECTORS OFFICE [Signature] CLERKS OFFICE [Signature]

NOTICE: IN ADDITION TO THE REQUIREMENTS OF THIS PERMIT, THERE MAY BE ADDITIONAL RESTRICTIONS APPLICABLE TO THIS PROPERTY THAT MAY BE FOUND IN THE PUBLIC RECORDS OF THIS COUNTY. AND THERE MAY BE ADDITIONAL PERMITS REQUIRED FROM OTHER GOVERNMENTAL ENTITIES SUCH AS WATER MANAGEMENT DISTRICTS, STATE AGENCIES, OR FEDERAL AGENCIES.

"WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR AN ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT."

EVERY PERMIT ISSUED SHALL BECOME INVALID UNLESS THE WORK AUTHORIZED BY SUCH PERMIT IS COMMENCED WITHIN 180 DAYS AFTER ITS ISSUANCE, OR IF THE WORK AUTHORIZED BY SUCH PERMIT IS SUSPENDED OR ABANDONED FOR A PERIOD OF 180 DAYS AFTER THE TIME THE WORK IS COMMENCED. A VALID PERMIT RECIEVES AN APPROVED INSPECTION EVERY 180 DAYS. WORK SHALL BE CONSIDERED NOT SUSPENDED, ABANDONED OR INVALID WHEN THE PERMIT HAS RECIEVED AN APPROVED INSPECTION WITHIN 180 DAYS OT THE PREVIOUS INSPECTION.

The Issuance of this Permit Does Not Waive Compliance by Permittee with Deed Restrictions.

Notice of Treatment

Applicator: Florida Pest Control & Chemical Co. (www.flapest.com)

Address: 536 SE Bay St. Phone 386-752-1703

City: Lake City FL

Site Location: Subdivision SUZANNE

Lot # 23 Block# Permit # 28847

Address 730 SE Carol Lake Cir

Product used

☒ Premise

☐ Termidor

☐ Bora-Care

Active Ingredient

Imidacloprid

Fipronil

Disodium Octaborate Tetrahydrate

% Concentration

0.1%

0.12%

23.0%

Type treatment:

☒ Soil

☐ Wood

Area Treated

Bathroom Addition

Square feet

203

Linear feet

40

Gallons Applied

30

As per Florida Building Code 104.2.6 - If soil chemical barrier method for termite prevention is used, final exterior treatment shall be completed prior to final building approval.

If this notice is for the final exterior treatment, initial this line _____.

9/14/10

Date

0805

Time

James P. Baker F254

Print Technician's Name

Remarks:

Applicator - White

Permit File - Canary

Permit Holder - Pink

10/05

©

Notice of Treatment

Applicator: Florida Pest Control & Chemical Co. (www.flapest.com)

Address: 536 SE Bay St. Phone 386-752-1703

City: Lake City FL

Site Location: Subdivision

Lot # Block# Permit # 28847

Address 730 SE Carol Lake Cir

Product used

☒ Premise

☐ Termidor

☐ Bora-Care

Active Ingredient

Imidacloprid

Fipronil

Disodium Octaborate Tetrahydrate

% Concentration

0.1%

0.12%

23.0%

Type treatment:

☐ Soil

☐ Wood

Area Treated

90 days follow

Square feet

33

Linear feet

3.3

Gallons Applied

3.3

As per Florida Building Code 104.2.6 - If soil chemical barrier method for termite prevention is used, final exterior treatment shall be completed prior to final building approval.

If this notice is for the final exterior treatment, initial this line _____.

10-13-10

Date

0820H

Time

B.A.

Print Technician's Name

Remarks:

Applicator - White

Permit File - Canary

Permit Holder - Pink

10/05

©

Don Reed

Columbia County Building Permit Application

For Office Use Only Application # 1009-01 Date Received 9/1/10 By G Permit # 28847
 Zoning Official BLK Date 08.09.10 Flood Zone X Land Use Res. Low Dev. Zoning RSF-2
 FEMA Map # N/A Elevation N/A MFE _____ River N/A Plans Examiner JC Date 9-7-1
 Comments _____
☒ NOC ☒ EH ☐ Deed or PA ☒ Site Plan ☐ State Road Info ☐ Parent Parcel # _____
☐ Dev Permit # _____ ☐ In Floodway ☐ Letter of Auth. from Contractor ☐ F W Comp. letter
 IMPACT FEES: EMS _____ Fire _____ Corr _____ Road/Code _____
 School _____ = TOTAL N/A addition to existing dwelling

Septic Permit No. 10-0373E

Fax 386-755-7272

Name Authorized Person Signing Permit KATIE REED

Phone 386-752-4072

Address 2230 SE BAYA DR. STE. 101 LAKE CITY, FL 32025

Owners Name CLAUDE AND AGATHIA BRADFORD

Phone 386-755-9585

911 Address 230 SE CAROL GLEN LAKE CITY, FL 32025-7685

Contractors Name DON REED CONSTRUCTION, INC.

Phone 386-752-4072

Address 2230 SE BAYA DR. STE. 101 LAKE CITY, FL 32025

Fee Simple Owner Name & Address N/A

Bonding Co. Name & Address N/A

Architect/Engineer Name & Address Pete Woods

Mortgage Lenders Name & Address N/A

Circle the correct power company - FL Power & Light - Clay Elec. - Suwannee Valley Elec. - Progress Energy

Property ID Number 03-45-17-07570-023

Estimated Cost of Construction 27,000

Subdivision Name SUZANNE

Lot 23 Block _____ Unit 1 Phase _____

Driving Directions 100 E, TR on 245, TR on Plant St., TR on Goldie, TL on Carol
last house on left-end of pavement.

Number of Existing Dwellings on Property 1

Construction of Addition SFD

Total Acreage .5ac Lot Size .5ac

Do you need a - Culvert Permit or Culvert Waiver or Have an Existing Drive

Total Building Height 18'

Actual Distance of Structure from Property Lines - Front 33'4" Side 36' Side 51' Rear 158'

Number of Stories 1 Heated Floor Area 35.25 Total Floor Area 203 Roof Pitch 5/12

Application is hereby made to obtain a permit to do work and installations as indicated. I certify that no work or installation has commenced prior to the issuance of a permit and that all work be performed to meet the standards of all laws regulating construction in this jurisdiction.

JW Left message for Katie 9.8.10

CK# 1337

Columbia County Building Permit Application

TIME LIMITATIONS OF APPLICATION : An application for a permit for any proposed work shall be deemed to have been abandoned 180 days after the date of filing, unless such application has been pursued in good faith or a permit has been issued; except that the building official is authorized to grant one or more extensions of time for additional periods not exceeding 90 days each. The extension shall be requested in writing and justifiable cause demonstrated.

TIME LIMITATIONS OF PERMITS: Every permit issued shall become invalid unless the work authorized by such permit is commenced within 180 days after its issuance, or if the work authorized by such permit is suspended or abandoned for a period of 180 days after the time work is commenced. A valid permit receives an approved inspection every 180 days. Work shall be considered not suspended, abandoned or invalid when the permit has received an approved inspection within 180 days of the previous approved inspection.

FLORIDA'S CONSTRUCTION LIEN LAW: Protect Yourself and Your Investment: According to Florida Law, those who work on your property or provide materials, and are not paid-in-full, have a right to enforce their claim for payment against your property. This claim is known as a construction lien. If your contractor fails to pay subcontractors or material suppliers or neglects to make other legally required payments, the people who are owed money may look to your property for payment, even if you have paid your contractor in full. This means if a lien is filed against your property, it could be sold against your will to pay for labor, materials or other services which your contractor may have failed to pay.

NOTICE OF RESPONSIBILITY TO BUILDING PERMITEE: **YOU ARE HEREBY NOTIFIED** as the recipient of a building permit from Columbia County, Florida, you will be held responsible to the County for any damage to sidewalks and/or road curbs and gutters, concrete features and structures, together with damage to drainage facilities, removal of sod, major changes to lot grades that result in ponding of water, or other damage to roadway and other public infrastructure facilities caused by you or your contractor, subcontractors, agents or representatives in the construction and/or improvement of the building and lot for which this permit is issued. No certificate of occupancy will be issued until all corrective work to these public infrastructures and facilities has been corrected.

WARNING TO OWNER: YOUR FAILURE TO RECORD A NOTICE OF COMMENCEMENT MAY RESULT IN YOU PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY. A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT WITH YOUR LENDER OR ATTORNEY BEFORE RECORDING YOUR NOTICE OF COMMENCEMENT.

OWNERS CERTIFICATION: I CERTIFY THAT ALL THE FOREGOING INFORMATION IS ACCURATE AND THAT ALL WORK WILL BE DONE IN COMPLIANCE WITH ALL APPLICABLE LAWS REGULATING CONSTRUCTION AND ZONING.

NOTICE TO OWNER: There are some properties that may have deed restrictions recorded upon them. These restrictions may limit or prohibit the work applied for in your building permit. It may be to your advantage to check and see if your property is encumbered by any restrictions.

(Owners Must Sign All Applications Before Permit Issuance.)

Agatha Bradford
Owners Signature

****OWNER BUILDERS MUST PERSONALLY APPEAR AND SIGN THE BUILDING PERMIT.**

CONTRACTORS AFFIDAVIT: By my signature I understand and agree that I have informed and provided this written statement to the owner of all the above written responsibilities in Columbia County for obtaining this Building Permit including all application and permit time limitations.

Don Reed
Contractor's Signature (Permitee)

Contractor's License Number CGC 036224
Columbia County
Competency Card Number 000626

Affirmed under penalty of perjury to by the Contractor and subscribed before me this ____ day of _____, 20__.

Personally known _____ or Produced Identification _____

LSM
State of Florida Notary Signature (For the Contractor)

SEAL:



SUBCONTRACTOR VERIFICATION FORM

APPLICATION NUMBER 1009-01 CONTRACTOR Don Reed PHONE 752-4072
 THIS FORM MUST BE SUBMITTED PRIOR TO THE ISSUANCE OF A PERMIT

In Columbia County one permit will cover all trades doing work at the permitted site. It is **REQUIRED** that we have records of the subcontractors who actually did the trade specific work under the permit. Per Florida Statute 440 and Ordinance 89-6, a contractor shall require all subcontractors to provide evidence of workers' compensation or exemption, general liability insurance and a valid Certificate of Competency license in Columbia County.

Any changes, the permitted contractor is responsible for the corrected form being submitted to this office prior to the start of that subcontractor beginning any work. Violations will result in stop work orders and/or fines.

| | | |
|---------------------------|--|---|
| ELECTRICAL 380 OK | Print Name <u>Donald Davis</u> License #: <u>EC-000-2306 EC13003780</u> | Signature <u>Donald Davis</u> Phone #: <u>386-464-1407</u> |
| MECHANICAL/ A/C 568 OK | Print Name <u>David Hall</u> License #: <u>CACO-57424</u> | Signature <u>David Hall</u> Phone #: <u>386-755-9792</u> |
| PLUMBING/ GAS 441 OK | Print Name <u>Joseph Davis</u> License #: <u>CECO-57304</u> | Signature <u>Joseph Davis</u> Phone #: <u>386-454-1407</u> |
| ROOFING 626 OK | Print Name <u>Don Reed</u> License #: <u>RC0055399</u> | Signature <u>Don Reed</u> Phone #: <u>386-752-4072</u> |
| SHEET METAL | Print Name _____ License #: _____ | Signature _____ Phone #: _____ |
| FIRE SYSTEM/ SPRINKLER | Print Name _____ License #: _____ | Signature _____ Phone #: _____ |
| SOLAR | Print Name _____ License #: _____ | Signature _____ Phone #: _____ |

| | | | |
|----------------------|-----------|--------------|--------------|
| MASON | | | |
| CONCRETE FINISHER 28 | 28 | Butch Vaughn | Butch Vaughn |
| FRAMING 521 | CGC036224 | Don Reed | Don Reed |
| INSULATION | | | |
| STUCCO | | | |
| DRYWALL | | | |
| PLASTER | | | |
| CABINET INSTALLER | | | |
| PAINTING | | | |
| ACOUSTICAL CEILING | | | |
| GLASS | | | |
| CERAMIC TILE | | | |
| FLOOR COVERING | | | |
| ALUM/VINYL SIDING | ✓ | | |
| GARAGE DOOR | | | |
| METAL BLDG ERECTOR | | | |

F. S. 440.103 Building permits; identification of minimum premium policy.--Every employer shall, as a condition to applying for and receiving a building permit, show proof and certify to the permit issuer that it has secured compensation for its employees under this chapter as provided in ss. 440.10 and 440.38, and shall be presented each time the employer applies for a building permit.

Contractor Form: Subcontractor Form: 6/09

This Warranty Deed Made the 16th day of AUGUST **OFFICIAL RECORDS** by

GREGORY S. WALTRIP AND WIFE, LISA M. WALTRIP

hereinafter called the grantor, to

CLAUDE J. BRADFORD AND WIFE, AGATHIA M. BRADFORD

whose postoffice address is RT 12, BOX 10T, LAKE CITY, FLORIDA 32055
hereinafter called the grantee:

(Wherever used herein the terms "grantor" and "grantee" include all the parties to this instrument and the heirs, legal representatives and assigns of individuals, and the successors and assigns of corporations)

Witnesseth: That the grantor, for and in consideration of the sum of \$-10.00- and other valuable considerations, receipt whereof is hereby acknowledged, hereby grants, bargains, sells, aliens, remises, releases, conveys and confirms unto the grantee, all that certain land situate in COLUMBIA County, Florida, viz:

LOT 23, SUZANNE SUBDIVISION, UNIT 1, a subdivision according to plat thereof recorded in Plat Book 4, Page 91 of the Public Records of Columbia County, Florida. The West 50 feet of said lands being subject to utility easement for Florida Power and Light Company.



91-11589

FILED AND RECORDED IN PUBLIC
RECORDS OF COLUMBIA COUNTY, FLA.

1991 AUG 16 PM 4:07

RECORD VERIFIED

P. DeWitt Cason
CLERK OF COURTS
COLUMBIA COUNTY, FLORIDA
B. R. Deppie

Together with all the tenements, hereditaments and appurtenances thereto belonging or in anywise appertaining.

To Have and to Hold, the same in fee simple forever.

And the grantor hereby covenants with said grantee that the grantor is lawfully seized of said land in fee simple; that the grantor has good right and lawful authority to sell and convey said land; that the grantor hereby fully warrants the title to said land and will defend the same against the lawful claims of all persons whomsoever; and that said land is free of all encumbrances, except taxes accruing subsequent to December 31, 1990

In Witness Whereof, the said grantor has signed and sealed these presents the day and year first above written.

Signed, sealed and delivered in our presence:

Jessie Baker

GREGORY S. WALTRIP

LISA M. WALTRIP

STATE OF FLORIDA
COUNTY OF COLUMBIA

DOCUMENTARY STAMP 389.40
INTANGIBLE TAX
P. DEWITT CASON, CLERK OF
COURTS, COLUMBIA COUNTY
R. Deppie

I HEREBY CERTIFY that on this day, before me, an officer duly authorized in the State aforesaid and in the County aforesaid to take acknowledgements, personally appeared

GREGORY S. WALTRIP AND WIFE, LISA M. WALTRIP

to me known to be the person s described in and who executed the foregoing instrument and they acknowledged before me that they executed the same.

WITNESS my hand and official seal in the County and State last aforesaid this 16th day of August, A.D. 1991

Prepared by: Michael H. Harrell

P. O. Box 7016

Lake City, Florida 32055

Pursuant to issuance of Title Insurance

NOTARY PUBLIC



MICHAEL H. HARRELL
State of Florida
My Comm. Exp. 1-17-93

NOTICE OF COMMENCEMENT

County Clerk's Office Stamp or Seal

Tax Parcel Identification Number 03-45-17-08749-101

THE UNDERSIGNED hereby gives notice that improvements will be made to certain real property, and in accordance with Section 713.13 of the Florida Statutes, the following information is provided in this NOTICE OF COMMENCEMENT.

1. Description of property (legal description):
a) Street (job) Address: 230 SE CAROL GLEN LAKE CITY, FL 32025
2. General description of improvements: ADDITION
3. Owner Information
a) Name and address: CLAUDE & AGATHIA BRADFORD
b) Name and address of fee simple titleholder (if other than owner)
c) Interest in property
4. Contractor Information
a) Name and address: DON REED CONSTRUCTION, INC
b) Telephone No.: 386-752-4072 Fax No. (Opt.) 386-755-7272
5. Surety Information
a) Name and address: N/A
b) Amount of Bond:
c) Telephone No.: Fax No. (Opt.)
6. Lender
a) Name and address: N/A
b) Phone No.:
7. Identity of person within the State of Florida designated by owner upon whom notices or other documents may be served:
a) Name and address: DON REED CONSTRUCTION, INC
b) Telephone No.: 386-752-4072 Fax No. (Opt.) 386-755-7272
8. In addition to himself, owner designates the following person to receive a copy of the Lienor's Notice as provided in Section 713.13(1)(b), Florida Statutes:
a) Name and address: N/A
b) Telephone No.: Fax No. (Opt.)
9. Expiration date of Notice of Commencement (the expiration date is one year from the date of recording unless a different date is specified):

WARNING TO OWNER: ANY PAYMENTS MADE BY THE OWNER AFTER THE EXPIRATION OF THE NOTICE OF COMMENCEMENT ARE CONSIDERED IMPROPER PAYMENTS UNDER CHAPTER 713, PART I, SECTION 713.13, FLORIDA STATUTES, AND CAN RESULT IN YOUR PAYING TWICE FOR IMPROVEMENTS TO YOUR PROPERTY; A NOTICE OF COMMENCEMENT MUST BE RECORDED AND POSTED ON THE JOB SITE BEFORE THE FIRST INSPECTION. IF YOU INTEND TO OBTAIN FINANCING, CONSULT YOUR LENDER OR AN ATTORNEY BEFORE COMMENCING WORK OR RECORDING YOUR NOTICE OF COMMENCEMENT.

STATE OF FLORIDA
COUNTY OF COLUMBIA

10. Agathia Bradford
Signature of Owner or Owner's Authorized Officer/Director/Partner/Manager
Agathia Bradford
Print Name

The foregoing instrument was acknowledged before me, a Florida Notary, this 30 day of August, 20 10, by _____ as Owner (type of authority, e.g. officer, trustee, attorney fact) for _____ (name of party on behalf of whom instrument was executed).

Personally Known ☒ OR Produced Identification _____ Type _____

Notary Signature LSM

Notary Stamp or Seal



---AND---

11. Verification pursuant to Section 92.525, Florida Statutes. Under penalties of perjury, I declare that I have read the foregoing and that the facts stated in it are true to the best of my knowledge and belief.

Signature of Natural Person Signing (in line #10 above.)



COLUMBIA COUNTY BUILDING DEPARTMENT RESIDENTIAL CHECK LIST REQUIREMENTS

MINIMUM PLAN REQUIREMENTS FOR THE FLORIDA BUILDING CODE RESIDENTIAL 2007 ONE (1) AND TWO (2) FAMILY DWELLINGS

ALL REQUIREMENTS ARE SUBJECT TO CHANGE

ALL BUILDING PLANS MUST INDICATE COMPLIANCE with the Current 2007 FLORIDA BUILDING CODES RESIDENTIAL. ALL PLANS OR DRAWINGS SHALL PROVIDE CALCULATIONS AND DETAILS THAT HAVE THE SEAL AND SIGNATURE OF A CERTIFIED ARCHITECT OR ENGINEER REGISTERED IN THE STATE OF FLORIDA, OR ALTERNATE METHODOLOGIES, APPROVED BY THE STATE OF FLORIDA BUILDING COMMISSION FOR ONE-AND-TWO FAMILY DWELLINGS.

FOR DESIGN PURPOSES THE FOLLOWING BASIC WIND SPEEDS ARE PER FIGURE R301.2(4) of the FLORIDA BUILDING CODES RESIDENTIAL (Florida Wind speed map) SHALL BE USED.

WIND SPEED LINE SHALL BE DEFINED AS FOLLOWS: THE CENTERLINE OF INTERSTATE 75.

ALL BUILDINGS CONSTRUCTED EAST OF SAID LINE SHALL BE ----- 100 MPH
ALL BUILDINGS CONSTRUCTED WEST OF SAID LINE SHALL BE ----- 110 MPH
NO AREA IN COLUMBIA COUNTY IS IN A WIND BORNE DEBRIS REGION

| GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL | | Items to Include- Each Box shall be Circled as Applicable | | |
|---|--|--|--|--|
|---|--|--|--|--|

| | | | Yes | No | N/A |
|---|---|----------------------------|----------|----------|------|
| 1 | Two (2) complete sets of plans containing the following: | | | | |
| 2 | All drawings must be clear, concise, drawn to scale, details that are not used shall be marked void | | | | |
| 3 | Condition space (Sq. Ft.) | Total (Sq. Ft.) under roof | IIIIIIII | IIIIIIII | IIII |

Designers name and signature shall be on all documents and a licensed architect or engineer, signature and official embossed seal shall be affixed to the plans and documents as per the FLORIDA BUILDING CODES RESIDENTIAL R101.2.1

Site Plan information including:

| | | | | |
|---|---|---|--|--|
| 4 | Dimensions of lot or parcel of land | ✓ | | |
| 5 | Dimensions of all building set backs | ✓ | | |
| 6 | Location of all other structures (include square footage of structures) on parcel, existing or proposed well and septic tank and all utility easements. | ✓ | | |
| 7 | Provide a full legal description of property. | ✓ | | |

Wind-load Engineering Summary, calculations and any details required

| GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL | | Items to Include- Each Box shall be Circled as Applicable | | |
|---|---|--|-------|--------|
| | | IIIIII | IIIII | IIIIII |
| | | YES | NO | N/A |
| 8 | Plans or specifications must show compliance with FBCR Chapter 3 | | | |
| 9 | Basic wind speed (3-second gust), miles per hour | | | ✓ |
| 10 | (Wind exposure – if more than one wind exposure is used, the wind exposure and applicable wind direction shall be indicated) | | | |
| 11 | Wind importance factor and nature of occupancy | | | |
| 12 | The applicable internal pressure coefficient, Components and Cladding | | | |
| 13 | The design wind pressure in terms of psf (kN/m ²), to be used for the design of exterior component, cladding materials not specifically designed by the registered design professional. | | | |
| | | | | |
| | | | | |
| | | | | |

Elevations Drawing including:

| | | | | |
|-----|--|---|--|--|
| 14 | All side views of the structure | ✓ | | |
| 15 | Roof pitch | ✓ | | |
| 16 | Overhang dimensions and detail with attic ventilation | ✓ | | |
| 17 | Location, size and height above roof of chimneys | | | |
| 18 | Location and size of skylights with Florida Product Approval | | | |
| 18 | Number of stories | ✓ | | |
| 20A | Building height from the established grade to the roofs highest peak | ✓ | | |

Floor Plan including:

| | | | | |
|----|---|---|--|---|
| 20 | Dimensioned area plan showing rooms, attached garage, breeze ways, covered porches, deck, balconies | ✓ | | |
| 21 | Raised floor surfaces located more than 30 inches above the floor or grade | | | ✓ |
| 22 | All exterior and interior shear walls indicated | | | ✓ |
| 23 | Shear wall opening shown (Windows, Doors and Garage doors) | | | ✓ |
| 24 | Emergency escape and rescue opening shown in each bedroom (net clear opening shown) | | | ✓ |
| 25 | Safety glazing of glass where needed | | | ✓ |
| 26 | Fireplaces types (gas appliance) (vented or non-vented) or wood burning with Hearth (see chapter 10 of FBCR) | | | ✓ |
| 27 | Stairs with dimensions (width, tread and riser and total run) details of guardrails, Handrails (see FBCR SECTION 311) | | | |
| 28 | Identify accessibility of bathroom (see FBCR SECTION 322) | ✓ | | |

All materials placed within opening or onto/into exterior walls, soffits or roofs shall have Florida product approval number and mfg. installation information submitted with the plan (see Florida product approval form)

| GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL | | Items to Include- Each Box shall be Circled as Applicable | | |
|---|--|--|--|--|
|---|--|--|--|--|

FBCR 403: Foundation Plans

| | | YES | NO | N/A |
|----|--|-----|----|-----|
| 29 | Location of all load-bearing walls footings indicated as standard, monolithic, dimensions, size and type of reinforcing. | ✓ | | |
| 30 | All posts and/or column footing including size and reinforcing | | | |
| 31 | Any special support required by soil analysis such as piling. | | | ✓ |
| 32 | Assumed load-bearing value of soil _____ Pound Per Square Foot | | | ✓ |
| 33 | Location of horizontal and vertical steel, for foundation or walls (include # size and type) | | | ✓ |

FBCR 506: CONCRETE SLAB ON GRADE

| | | | | |
|----|---|---|--|---|
| 34 | Show Vapor retarder (6mil. Polyethylene with joints lapped 6 inches and sealed) | ✓ | | |
| 35 | Show control joints, synthetic fiber reinforcement or welded fire fabric reinforcement and Supports | | | ✓ |

FBCR 320: PROTECTION AGAINST TERMITES

| | | | | |
|----|--|---|--|--|
| 36 | Indicate on the foundation plan if soil treatment is used for subterranean termite prevention or submit other approved termite protection methods. Protection shall be provided by registered termiticides | ✓ | | |
|----|--|---|--|--|

FBCR 606: Masonry Walls and Stem walls (load bearing & shear Walls)

| | | | | |
|----|--|---|--|--|
| 37 | Show all materials making up walls, wall height, and Block size, mortar type | ✓ | | |
| 38 | Show all Lintel sizes, type, spans and tie-beam sizes and spacing of reinforcement | ✓ | | |

Metal frame shear wall and roof systems shall be designed, signed and sealed by Florida Prof. Engineer or Architect

Floor Framing System: First and/or second story

| | | | | |
|----|---|---|--|---|
| 39 | Floor truss package shall including layout and details, signed and sealed by Florida Registered Professional Engineer | ✓ | | |
| 40 | Show conventional floor joist type, size, span, spacing and attachment to load bearing walls, stem walls and/or piers | | | ✓ |
| 41 | Girder type, size and spacing to load bearing walls, stem wall and/or piers | | | ✓ |
| 42 | Attachment of joist to girder | | | ✓ |
| 43 | Wind load requirements where applicable | | | ✓ |
| 44 | Show required under-floor crawl space | | | ✓ |
| 45 | Show required amount of ventilation opening for under-floor spaces | | | ✓ |
| 46 | Show required covering of ventilation opening | | | ✓ |
| 47 | Show the required access opening to access to under-floor spaces | | | ✓ |
| | Show the sub-floor structural panel sheathing type, thickness and fastener schedule on the edges & | | | ✓ |

| | | | | |
|----|--|--|--|---|
| 48 | intermediate of the areas structural panel sheathing | | | ✓ |
| 49 | Show Draftstopping, Fire caulking and Fire blocking | | | ✓ |
| 50 | Show fireproofing requirements for garages attached to living spaces, per FBCR section 309 | | | ✓ |
| 51 | Provide live and dead load rating of floor framing systems (psf). | | | ✓ |

FBCR CHAPTER 6 WOOD WALL FRAMING CONSTRUCTION

| GENERAL REQUIREMENTS: APPLICANT - PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL | | Items to Include- Each Box shall be Circled as Applicable | | |
|---|--|--|----|-----|
| | | YES | NO | N/A |
| 52 | Stud type, grade, size, wall height and oc spacing for all load bearing or shear walls | ✓ | | |
| 53 | Fastener schedule for structural members per table FBCR 602.3 are to be shown | ✓ | | |
| 54 | Show Wood structural panel's sheathing attachment to studs, joist, trusses, rafters and structural members, showing fastener schedule attachment on the edges & intermediate of the areas structural panel sheathing | | | |
| 55 | Show all required connectors with a max uplift rating and required number of connectors and oc spacing for continuous connection of structural walls to foundation and roof trusses or rafter systems | | | |
| 56 | Show sizes, type, span lengths and required number of support jack studs, king studs for shear wall opening and girder or header per FBCR Table 502.5 (1) | | | |
| 57 | Indicate where pressure treated wood will be placed | ✓ | | |
| 58 | Show all wall structural panel sheathing, grade, thickness and show fastener schedule for structural panel sheathing edges & intermediate areas | | | |
| 59 | A detail showing gable truss bracing, wall balloon framing details or/ and wall hinge bracing detail | | | |

FBCR :ROOF SYSTEMS:

| | | | | |
|----|--|---|--|--|
| 60 | Truss design drawing shall meet section FBCR 802.10 Wood trusses | ✓ | | |
| 61 | Include a layout and truss details, signed and sealed by Florida Professional Engineer | ✓ | | |
| 62 | Show types of connector's assemblies' and resistance uplift rating for all trusses and rafters | ✓ | | |
| 63 | Show gable ends with rake beams showing reinforcement or gable truss and wall bracing details | ✓ | | |
| 64 | Provide dead load rating of trusses | | | |

FBCR 802:Conventional Roof Framing Layout

| | | | | |
|----|--|---|--|--|
| 65 | Rafter and ridge beams sizes, span, species and spacing | ✓ | | |
| 66 | Connectors to wall assemblies' include assemblies' resistance to uplift rating | ✓ | | |
| 67 | Valley framing and support details | ✓ | | |
| 68 | Provide dead load rating of rafter system | ✓ | | |

FBCR Table 602,3(2) & FBCR 803 ROOF SHEATHING

| | | | | |
|----|---|---|--|--|
| 69 | Include all materials which will make up the roof decking, identification of structural panel sheathing, grade, thickness | ✓ | | |
| 70 | Show fastener Size and schedule for structural panel sheathing on the edges & intermediate areas | ✓ | | |

FBCR ROOF ASSEMBLIES FRC Chapter 9

| | | | | |
|----|---|---|--|--|
| 71 | Include all materials which will make up the roof assembles covering | ✓ | | |
| 72 | Submit Florida Product Approval numbers for each component of the roof assembles covering | ✓ | | |

FBCR Chapter 11 Energy Efficiency Code for residential building

Residential construction shall comply with this code by using the following compliance methods in the FBCR chapter 11 Residential buildings compliance methods. *Two of the required forms are to be submitted, showing dimensions condition area equal to the total condition living space area*

| GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL | | Items to Include- Each Box shall be Circled as Applicable | | |
|---|--|--|----|-----|
| | | YES | NO | N/A |
| 73 | Show the insulation R value for the following areas of the structure | ✓ | | |
| 74 | Attic space | ✓ | | |
| 75 | Exterior wall cavity | ✓ | | |
| 76 | Crawl space | | | ✓ |

HVAC information

| | | | | |
|----|--|---|--|---|
| 77 | Submit two copies of a Manual J sizing equipment or equivalent computation study | ✓ | | |
| 78 | Exhaust fans locations in bathrooms | ✓ | | |
| 79 | Show clothes dryer route and total run of exhaust duct | | | ✓ |

Plumbing Fixture layout shown

| | | | | |
|----|--|---|--|--|
| 80 | All fixtures waste water lines shall be shown on the foundation plan | ✓ | | |
| 81 | Show the location of water heater | ✓ | | |

Private Potable Water

| | | | | |
|----|---|---|--|--|
| 82 | Pump motor horse power | ✓ | | |
| 83 | Reservoir pressure tank gallon capacity | ✓ | | |
| 84 | Rating of cycle stop valve if used | | | |

Electrical layout shown including

| | | | | |
|----|---|---|--|--|
| 85 | Switches, outlets/receptacles, lighting and all required GFCI outlets identified | ✓ | | |
| 86 | Ceiling fans | ✓ | | |
| 87 | Smoke detectors & Carbon dioxide detectors | ✓ | | |
| 88 | Service panel, sub-panel, location(s) and total ampere ratings | ✓ | | |
| 89 | On the electrical plans identify the electrical service overcurrent protection device for the main electrical service. This device shall be installed on the exterior of structures to serve as a disconnecting means for the utility company electrical service. Conductors used from the exterior disconnecting means to a panel or sub panel shall have four-wire conductors, of which one conductor shall be used as an equipment ground. Indicate if the utility company service entrance cable will be of the overhead or underground type. | ✓ | | |

| | | | | |
|----|---|---|--|---|
| | | | | |
| 90 | Appliances and HVAC equipment and disconnects | ✓ | | |
| 91 | Arc Fault Circuits (AFCI) in bedrooms | | | ✓ |

Disclosure Statement for Owner Builders *If you as the applicant will be acting as an owner/builder under section 489.103(7) of the Florida Statutes, submit the required owner builder disclosure statement form.*

Notice Of Commencement

A notice of commencement form **recorded** in the Columbia County Clerk Office is required to be filed with the building department Before Any Inspections can be preformed.

| | | |
|---|--|--|
| GENERAL REQUIREMENTS: APPLICANT – PLEASE CHECK ALL APPLICABLE BOXES BEFORE SUBMITTAL | | Items to Include- Each Box shall be Circled as Applicable |
|---|--|--|

THE FOLLOWING ITEMS MUST BE SUBMITTED WITH BUILDING PLANS

| | | YES | NO | N/A |
|-----|---|-----|----|-----|
| 92 | Building Permit Application A current Building Permit Application form is to be completed and submitted for all residential projects | ✓ | | |
| 93 | Parcel Number The parcel number (Tax ID number) from the Property Appraiser (386) 758-1084 is required. A copy of property deed is also requested | ✓ | | |
| 94 | Environmental Health Permit or Sewer Tap Approval A copy of a approved Columbia County Environmental Health (386) 758-1058 | ✓ | | |
| 95 | City of Lake City A permit showing an approved waste water sewer tap | | | |
| 96 | Toilet facilities shall be provided for all construction sites | | | |
| 97 | Town of Fort White (386) 497-2321 If the parcel in the application for building permit is within the Corporate city limits of Fort White an approval land use development letter issued by the Town of Fort is required to be submitted with the application for a building permit. | | | ✓ |
| 98 | Flood Information: All projects within the Floodway of the Suwannee or Santa Fe Rivers shall require permitting through the Suwannee River Water Management District, before submitting a application to this office. Any project located within a flood zone where the base flood elevation (100 year flood) has been established shall meet the requirements of Section 8.5.2 of the Columbia County Land Development Regulations. Any project located within a flood zone where the base flood elevation has not been established (Zone A) shall meet the requirements of Section 8.5.3 of the Columbia County Land Development Regulations | | | ✓ |
| 99 | CERTIFIED FINISHED FLOOR ELEVATIONS will be required on any project where the base flood elevation (100 year flood) has been established | | | ✓ |
| 100 | A development permit will also be required. Development permit cost is \$50.00 | ✓ | | |
| 101 | Driveway Connection: If the property does not have an existing access to a public road, then an application for a culvert permit (\$25.00) must be made. If the applicant feels that a culvert is not needed, they may apply for a culvert waiver (\$50.00). All culvert waivers are sent to the Columbia County Public Works Department for approval or denial. | | | ✓ |
| 102 | 911 Address: If the project is located in an area where a 911 address has not been issued, then application for a 911 address must be applied for and received through the Columbia County Emergency Management Office of 911 Addressing Department (386) 758-1125 | ✓ | | |

Section R101.2.1 of the Florida Building Code Residential:

The provisions of Chapter 1, Florida Building Code, Building shall govern the administration and enforcement of the Florida Building Code, Residential.

Section 105 of the Florida Building Code defines the:

Time limitation of application.

An application for a permit for any proposed work shall be deemed to have been abandoned 180 days after the date of filing, unless such application has been pursued in good faith or a permit has been issued; except that the building official is authorized to grant one or more extensions of time for additional periods not exceeding 90 days each. The extension shall be requested in writing and justifiable cause demonstrated.

Single-family residential dwelling.

Section 105.3.4 A building permit for a single-family residential dwelling must be issued within 30 working days of application therefor unless unusual circumstances require a longer time for processing the application or unless the permit application fails to satisfy the Florida Building Code or the enforcing agency's laws or ordinances.

Permit intent.

Section 105.4.1: A permit issued shall be constructed to be a license to proceed with the work and not as authority to violate, cancel, alter or set aside any of the provisions of the technical codes, nor shall issuance of a permit prevent the building official from thereafter requiring a correction of errors in plans, construction or violations of this code. Every permit issued shall become invalid unless the work authorized by such permit is commenced within six months after its issuance, or if the work authorized by such permit is suspended or abandoned for a period of six months after the time the work is commenced.

If work has commenced.

Section 105.4.1.1: If work has commenced and the permit is revoked, becomes null and void, or expires because of lack of progress or abandonment, a new permit covering the proposed construction shall be obtained before proceeding with the work.

New Permit.

Section 105.4.1.2: If a new permit is not obtained within 180 days from the date the initial permit became null and void, the building official is authorized to require that any work which has been commenced or completed be removed from the building site. Alternately, a new permit may be issued on application, providing the work in place and required to complete the structure meets all applicable regulations in effect at the time the initial permit became null and void and any regulations which may have become effective between the date of expiration and the date of issuance of the new permit.

Work Shall Be:

Section 105.4.1.3: Work shall be considered to be in active progress when the permit has received an approved inspection within 180 days. This provision shall not be applicable in case of civil commotion or strike or when the building work is halted due directly to judicial injunction, order or similar process.

The Fee:

Section 105.4.1.4: The fee for renewal reissuance and extension of a permit shall be set forth by the administrative authority.

When the submitted application is approved for permitting the applicant will be notified by phone as to the date and time a building permit will be prepared and issued by the Columbia County Building & Zoning Department

PRODUCT APPROVAL SPECIFICATION SHEET

Location: _____

Project Name: _____

BRADFORD

As required by Florida Statute 553.842 and Florida Administrative Code 9B-72, please provide the information and the product approval number(s) on the building components listed below if they will be utilized on the construction project for which you are **applying for a building on or after April 1, 2004**. We recommend you contact your local product supplier should you not know the product approval number for any of the applicable listed products. More information about statewide product approval can be obtained at www.floridabuilding.org

| Category/subcategory | Manufacturer | Product Description | Approval Number(s) |
|----------------------------|------------------|---------------------|--------------------|
| A. EXTERIOR DOORS | | | |
| 1. Swinging | Masonite | In or Out Swing | FL 4904 |
| 2. Sliding | | | |
| 3. Sectional | | | |
| 4. Roll Up | | | |
| 5. Automatic | | | |
| 6. Other | | | |
| B. WINDOWS | | | |
| 1. Single Hung | General Aluminum | vinyl twin | 11654.19 |
| 2. Horizontal Slider | | | |
| 3. Casement | | | |
| 4. Double Hung | | | |
| 5. Fixed | | | |
| 6. Awning | | | |
| 7. Pass - Through | | | |
| 8. Projected | | | |
| 9. Mullion | | | |
| 10. Wind Breaker | | | |
| 11. Dual Action | | | |
| 12. Other | | | |
| C. PANEL WALL | | | |
| 1. Siding | Kaycan | Vinyl Siding | FL 12192 |
| 2. Soffits | Kaycan | Vinyl | FL 12199 |
| 3. EIFS | | | |
| 4. Storefronts | | | |
| 5. Curtain Walls | | | |
| 6. Wall Louver | | | |
| 7. Glass Block | | | |
| 8. Membrane | | | |
| 9. Greenhouse | | | |
| 10. Other | | | |
| D. ROOFING PRODUCTS | | | |
| 1. Asphalt Shingles | Gas - Elk | Roof Shingles | FL 728 - R1 |
| 2. Underlayments | Woodland | Felt Underlayment | 1814 - R1 |
| 3. Roofing Fasteners | Union | Metal Roof | FL4586.3 |
| 4. Non-Structural Metal Rf | | | |
| 5. Built -Up Roofing | | | |
| 6. Modified Bitumen | | | |
| 7. Single Ply Roofing Sys | | | |
| 8. Roofing Tiles | | | |
| 9. Roofing Insulation | | | |
| 10. Waterproofing | | | |
| 11. Wood Shingles /Shakes | | | |
| 12. Roofing Slate | | | |

| Category/subcategory (cont.) | Manufacturer | Product Description | Approval Number (s) |
|--|--------------|---------------------|---------------------|
| 13. Liquid Applied Roof Sys | | | |
| 14. Cements-Adhesives - Coatings | | | |
| 15. Roof Tile Adhesive | | | |
| 16. Spray Applied Polyurethane Roof | | | |
| 17. Other | | | |
| E. SHUTTERS | | | |
| 1. Accordion | | | |
| 2. Bahama | | | |
| 3. Storm Panels | | | |
| 4. Colonial | | | |
| 5. Roll-up | | | |
| 6. Equipment | | | |
| 7. Others | | | |
| F. SKYLIGHTS | | | |
| 1. Skylight | | | |
| 2. Other | | | |
| G. STRUCTURAL COMPONENTS | | | |
| 1. Wood connector/anchor | | | |
| 2. Truss plates | | | |
| 3. Engineered lumber | | | |
| 4. Railing | | | |
| 5. Coolers-freezers | | | |
| 6. Concrete Admixtures | | | |
| 7. Material | | | |
| 8. Insulation Forms | | | |
| 9. Plastics | | | |
| 10. Deck-Roof | | | |
| 11. Wall | | WOOD FRAMING | |
| 12. Sheds | | | |
| 13. Other | | | |
| H. NEW EXTERIOR ENVELOPE PRODUCTS | | | |
| 1.. | | | |
| 2.. | | | |

The products listed below did not demonstrate product approval at plan review. I understand that at the time of inspection of these products, the following information must be available to the inspector on the jobsite; 1) copy of the product approval, 2) the performance characteristics which the product was tested and certified to comply with, 3) copy of the applicable manufactures installation requirements.

I understand these products may have to be removed if approval cannot be demonstrated during inspection.

Don Reed

Contractor or contractor's Authorized Agent Signature

DON REED

Print Name

8-04-10

Date

Permit # (FOR STAFF USE ONLY)



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE DISPOSAL SYSTEM
APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 10-0373E
DATE PAID: 8/4/10
FEE PAID: 1125.00
RECEIPT #: 1440911

APPLICATION FOR:

☐ New System ☒ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: Claude 3 Agathia BradfordAGENT: Don Reed Construction, Inc. TELEPHONE: 386-752-4012MAILING ADDRESS: 2230 SE Baya Dr. Ste. 101 LAKE CITY FL 32025

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3)(m) OR 489.552, FLORIDA STATUTES.

PROPERTY INFORMATION

LOT: 23 BLOCK: 03-45-17-07570-23 KR SUBDIVISION: Suzanne PLATTED: 1973PROPERTY ID #: 03-45-17-08749-10 ZONING: RS I/M OR EQUIVALENT: ☒ Y ☐ NPROPERTY SIZE: 0.7 ACRES WATER SUPPLY: ☐ PRIVATE ☒ PUBLIC ☐ <=2000GPD ☒ >2000GPDIS SEWER AVAILABLE AS PER 381.0065, FS? ☒ Y ☐ N DISTANCE TO SEWER: N/A FTPROPERTY ADDRESS: 230 SE CAROL GLN LAKE CITY, FL 32025DIRECTIONS TO PROPERTY: 100 E, TR on 2415, TR on Plant St, TR on Goldie, TL on Carol

BUILDING INFORMATION

☒ RESIDENTIAL☐ COMMERCIAL

| Unit No | Type of Establishment | No. of Bedrooms | Building Area Sqft | Commercial/Institutional System Design Table 1, Chapter 64K-6, FAC |
|---------|-----------------------|-----------------|--------------------|--|
| 1 | SFD | 3 | 1620 | Current existing building |
| 2 | Bathroom/Porch | 0 | 203 | New addition * |
| 3 | | | 1823 | Total |
| 4 | | | | ORIGINAL ATTACHED |

☐ Floor/Equipment Drains Don Reed Other (Specify) _____

SIGNATURE: _____

DATE: 8-03-10

STATE OF FLORIDA
DEPARTMENT OF HEALTH

APPLICATION FOR ONSITE SEWAGE DISPOSAL SYSTEM CONSTRUCTION PERMIT

Permit Application Number

10-0323E

PART II - SITE PLAN

Scale: Each block represents 5 feet and 1 inch = 50 feet.

* SEE ATTACHED *

Notes:

Site Plan submitted by:

Don Reed

Signature

CONTRACTOR

Title

Plan Approved ☒

Not Approved

Date 8/11/10

By

Columbia CHD

County Health Department


ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT

SF


BOUNDARY SURVEY OF

LOT 23, SUZANNE SUBDIVISION, UNIT 1

Lot 23, SUZANNE SUBDIVISION, UNIT 1, a subdivision according to plat thereof recorded in Plat Book 4, Page 91 of the Public Records of Columbia County, Florida. The West 50 feet of said lands being subject to a utility easement for Florida Power and Light Company.



5/12 PITCH ROOF
2/12 PITCH CEILING

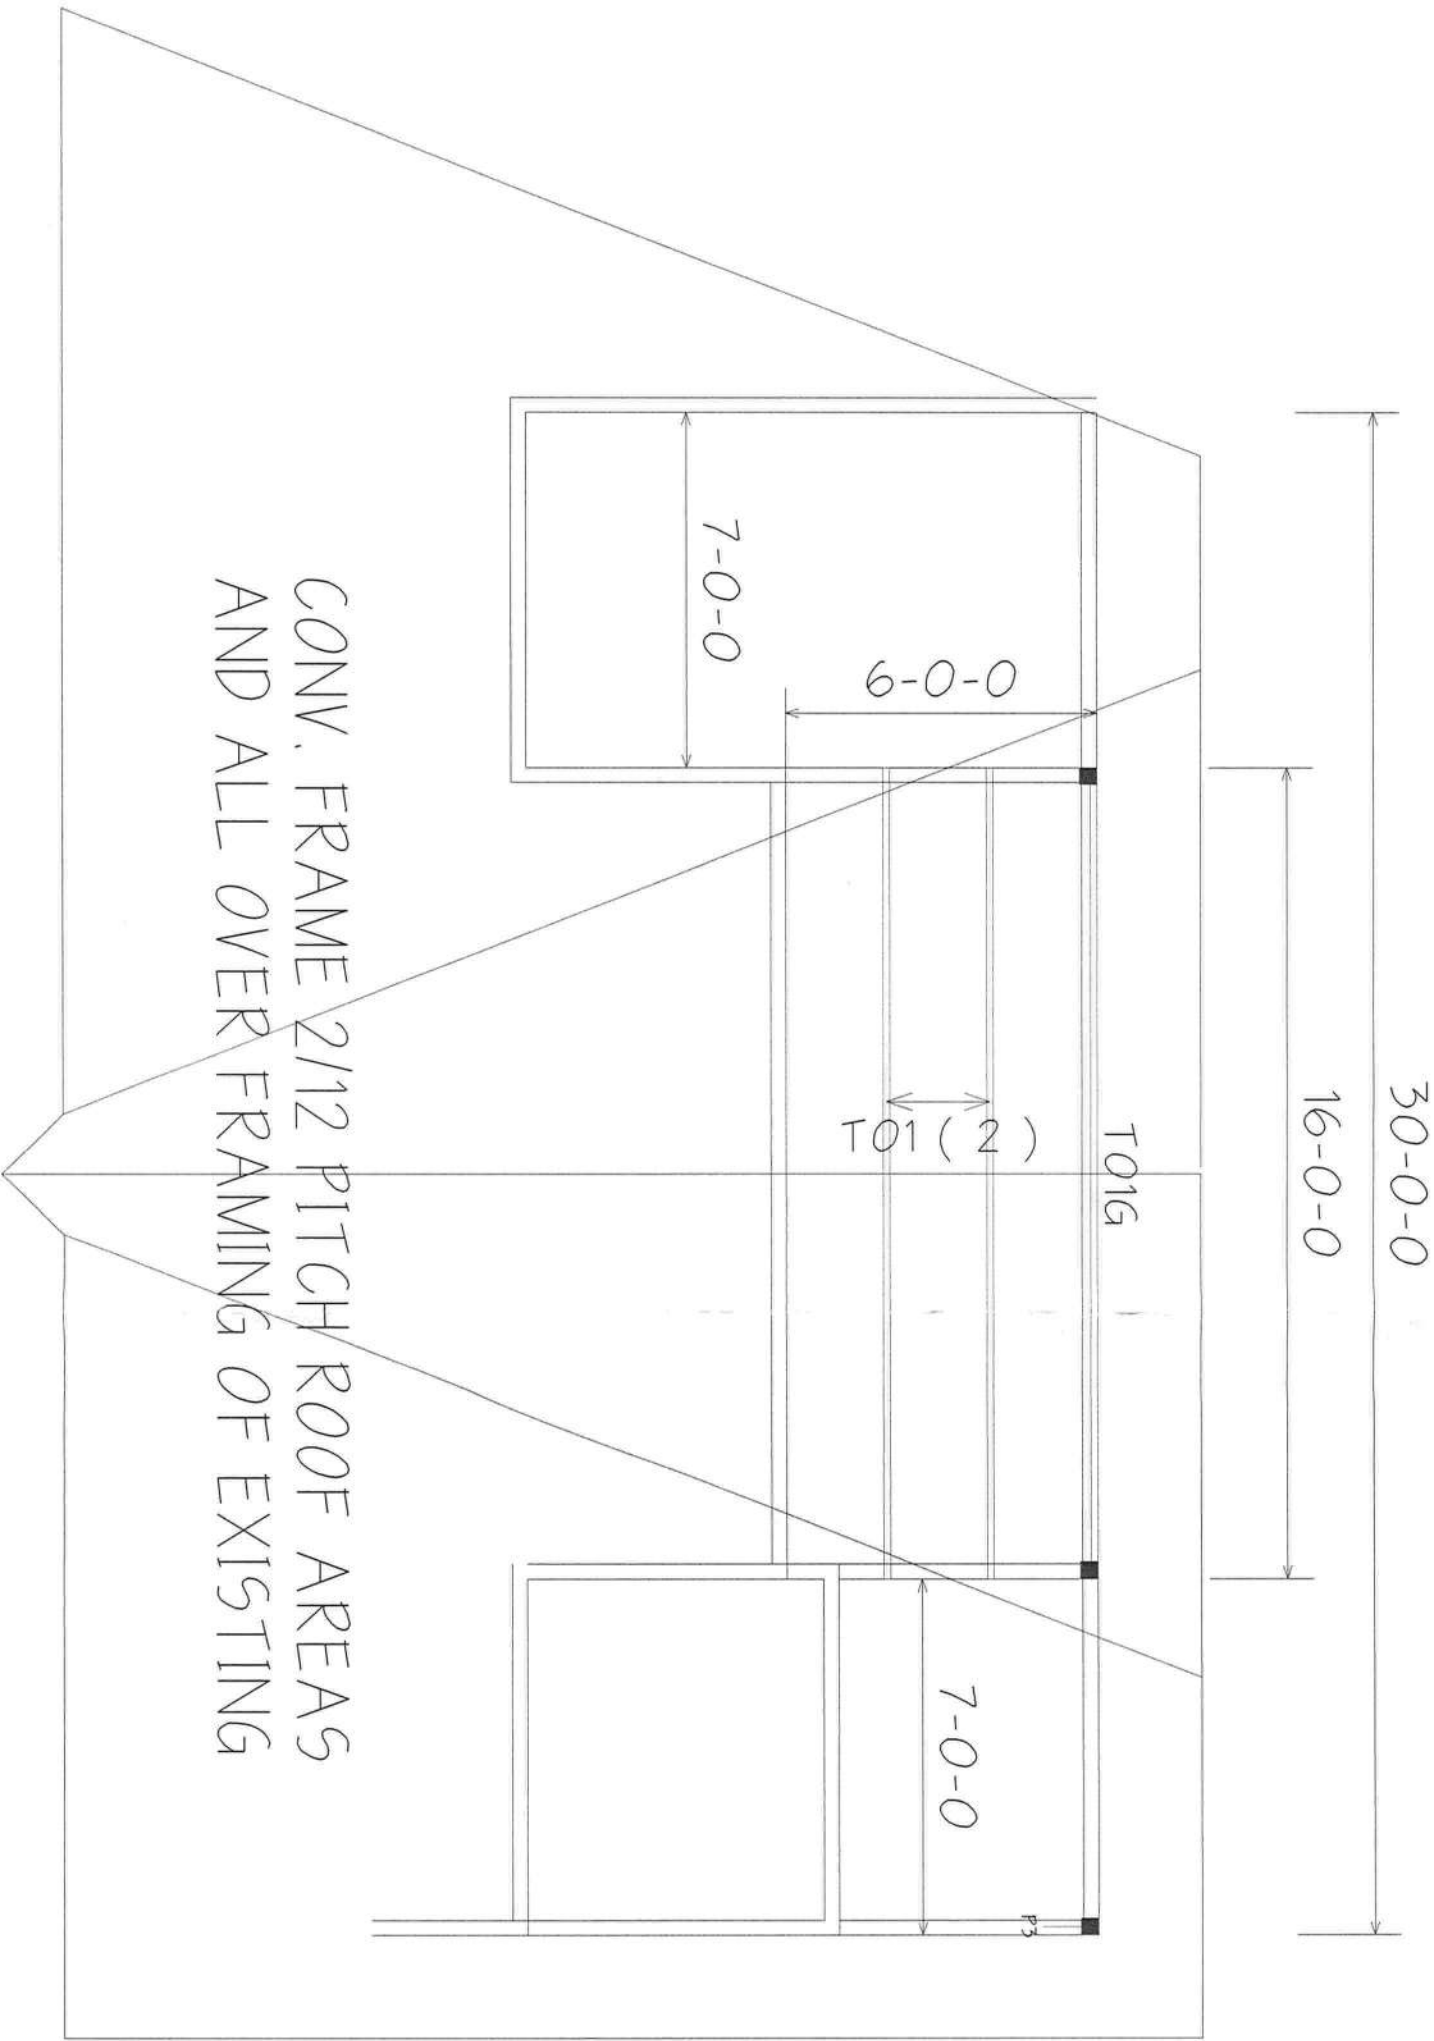

6'-0'-0 5'-0'-0

NOTES:

- 1) REFER TO HD 91 (RECOMMENDATIONS FOR HANDLING INSTALLATION AND TEMPORARY BRACING) REFER TO ENGINEERED DRAWINGS FOR PERMANENT BRACING REQUIRED.
- 2) ALL TRUSSES (INCLUDING TRUSSES UNDER VALLEY FRAMING) MUST BE COMPLETELY DECKED OR REFER TO DETAIL V05 FOR ALTERNATE BRACING REQUIREMENTS.
- 3) ALL VALLEYS ARE TO BE CONVENTIONALLY FRAMED BY BUILDER.
- 4) ALL TRUSSES ARE DESIGNED FOR 2.0G MAXIMUM SPACING, UNLESS OTHERWISE NOTED.
- 5) ALL WALLS SHOWN ON PLACEMENT PLAN ARE CONSIDERED TO BE LOAD BEARING, UNLESS OTHERWISE NOTED.
- 6) S/Y42 TRUSSES MUST BE INSTALLED WITH THE TOP BEING UP.
- 7) ALL ROOF TRUSS HANGERS TO BE SHOWN UNLESS OTHERWISE NOTED. ALL FLOOR TRUSS HANGERS TO BE SHOWN UNLESS OTHERWISE NOTED.
- 8) BEAM/RAFTER/INTEL. (REQ) TO BE FURNISHED BY BUILDER.

SHOP DRAWING APPROVAL

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS. ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS, REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Revised Drawing Size _____

Approved By _____ Date _____



PHONE: 904-437-3349 FAX: 904-437-3494

Bunnell

Jacksonville

PHONE: 904-772-6100 FAX: 904-772-1873

Lake City

Sanford

PHONE: 386-795-6844 FAX: 386-795-7973

PHONE: 407-322-0094 FAX: 407-322-9953

DON REED CONST.

BRADFORD ADDITION

| | | | | |
|-----------|---------|--------|--------|--------|
| DATE: | 8-31-10 | MONTH: | K.L.H. | 344258 |
| REVISION: | DATE: | NTS | | |

Julius Lee

RE: 344258 - DON REED - BRADFORD ADDITION

**1109 Coastal Bay Blvd.
Boynton Beach, FL 33435**

Site Information:

Project Customer: DON REED CONST. Project Name: 344258 Model: BRADFORD ADDITION
Lot/Block: Subdivision:
Address: 230 SE CAROB GLEN
City: COLUMBIA CTY State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: LARRY D. REED License #: CGC036224
Address: 2230 SE BAYA DRIVE STE 101
City: LAKE CITY, State: FL

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2007/TPI2002 Design Program: MiTek 20/20 7.1
Wind Code: ASCE 7-05 Wind Speed: 110 mph Floor Load: N/A psf
Roof Load: 32.0 psf

This package includes 2 individual, dated Truss Design Drawings and 0 Additional Drawings.
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.
This document processed per section 16G15-23.003 of the Florida Board of Professionals Rules

In the event of changes from Builder or E.O.R. additional coversheets and drawings may accompany this coversheet. The latest approval dates supersede and replace the previous drawings.

| No. | Seal# | Truss Name | Date |
|-----|----------|------------|----------|
| 1 | I4459699 | T01 | 8/31/010 |
| 2 | I4459700 | T01G | 8/31/010 |



The truss drawing(s) referenced above have been prepared by MiTek Industries, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Lake City).

Truss Design Engineer's Name: Julius Lee

My license renewal date for the state of Florida is February 28, 2011.

NOTE: The seal on these drawings indicate acceptance of professional engineering responsibility solely for the truss components shown. The suitability and use of this component for any particular building is the responsibility of the building designer, per ANSI/TPI-1 Chapter 2.



| | | | | | | |
|---------------|--------------|-----------------------|----------|----------|--|----------|
| Job 344258 | Truss T01 | Truss Type SCISSOR | Qty 2 | Ply 1 | DON REED - BRADFORD ADDITION Job Reference (optional) | 14459699 |
|---------------|--------------|-----------------------|----------|----------|--|----------|

Builders FirstSource, Lake City, FL 32055

7.140 s Oct 1 2009 MiTek Industries, Inc. Tue Aug 31 11:15:34 2010 Page 1

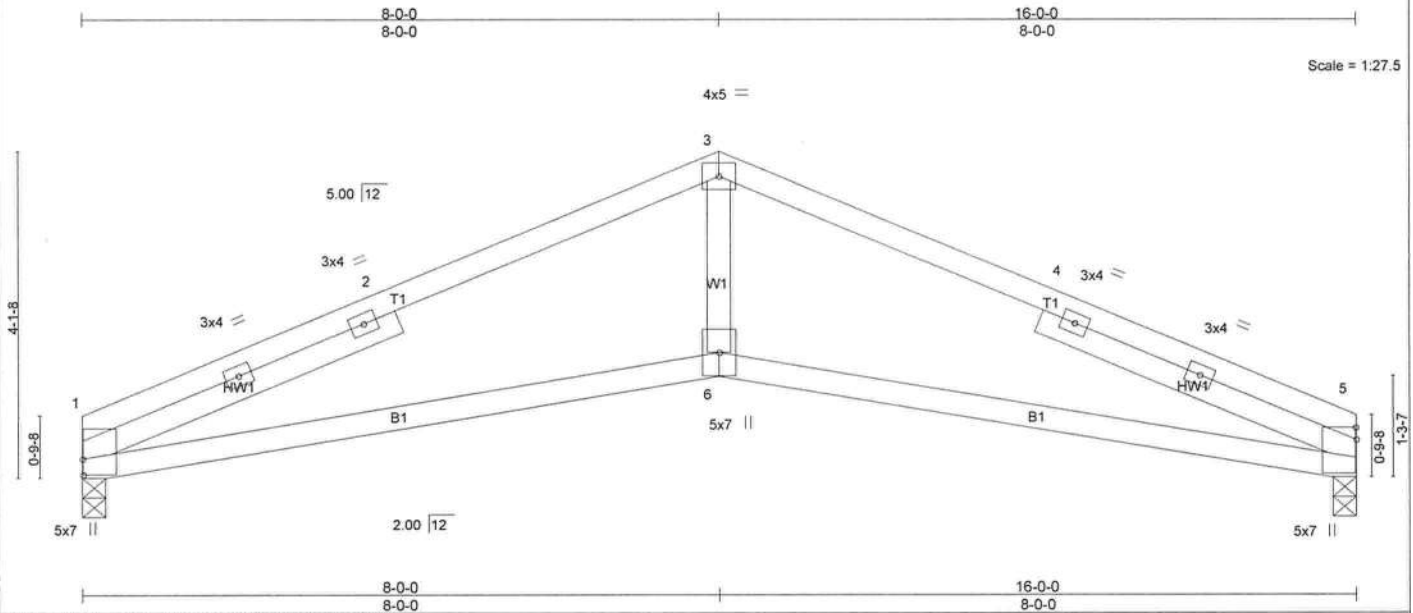


Plate Offsets (X,Y): [1:0-2-6,0-0-2], [5:0-1-14,0-0-2]

| LOADING (psf) | SPACING | 2-0-0 | CSI | DEFL | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|-------|-------|--------|-----|---------------|---------|
| TCLL 20.0 | Plates Increase | 1.25 | TC 0.49 | Vert(LL) | -0.12 | 1-6 | >999 | 360 | MT20 | 244/190 |
| TCDL 7.0 | Lumber Increase | 1.25 | BC 0.56 | Vert(TL) | -0.22 | 1-6 | >880 | 240 | | |
| BCLL 0.0 | Rep Stress Incr | YES | WB 0.17 | Horz(TL) | -0.06 | 5 | n/a | n/a | | |
| BCDL 5.0 | Code FBC2007/TPI2002 | | (Matrix) | Wind(LL) | 0.51 | 1-6 | >377 | 240 | | |
| | | | | | | | | | Weight: 67 lb | |

LUMBER

TOP CHORD 2 X 4 SYP No.2
BOT CHORD 2 X 4 SYP No.2
WEBS 2 X 4 SYP No.3
SLIDER Left 2 X 4 SYP No.2 4-4-2, Right 2 X 4 SYP No.2 4-4-2

BRACING

TOP CHORD
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 4-3-3 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS (lb/size) 1=509/0-3-8, 5=509/0-3-8
Max Horz 1=46(LC 6)
Max Uplift 1=-311(LC 6), 5=-311(LC 7)


FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1035/1704, 2-3=-934/1731, 3-4=-934/1731, 4-5=-1035/1704
BOT CHORD 1-6=-1419/882, 5-6=-1419/882
WEBS 3-6=-1084/441

NOTES (9-10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-05; 110mph (3-second gust); TCDL=4.2psf; BCDL=3.0psf; h=18ft; Cat. II; Exp B; enclosed; MWFRS (low-rise) and C-C Exterior(2) zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SYP No.2 .
- Bearing at joint(s) 1, 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 311 lb uplift at joint 1 and 311 lb uplift at joint 5.
- "Semi-rigid pitchbreaks including heels" Member end fixity model was used in the analysis and design of this truss.
- This manufactured product is designed as an individual building component. The suitability and use of this component for any particular building is the responsibility of the building designer per ANSI TPI 1 as referenced by the building code.
- Truss Design Engineer: Julius Lee, PE: Florida P.E. License No. 34869: Address: 1109 Coastal Bay Blvd. Boynton Beach, FL 33435

LOAD CASE(S) Standard

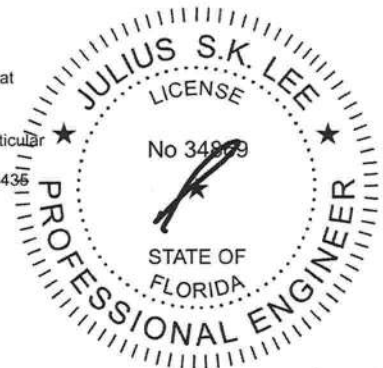


August 31, 2010



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.

Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information available from Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53719.

Julius Lee
1109 Coastal Bay Blvd.
Boynton, FL 33435

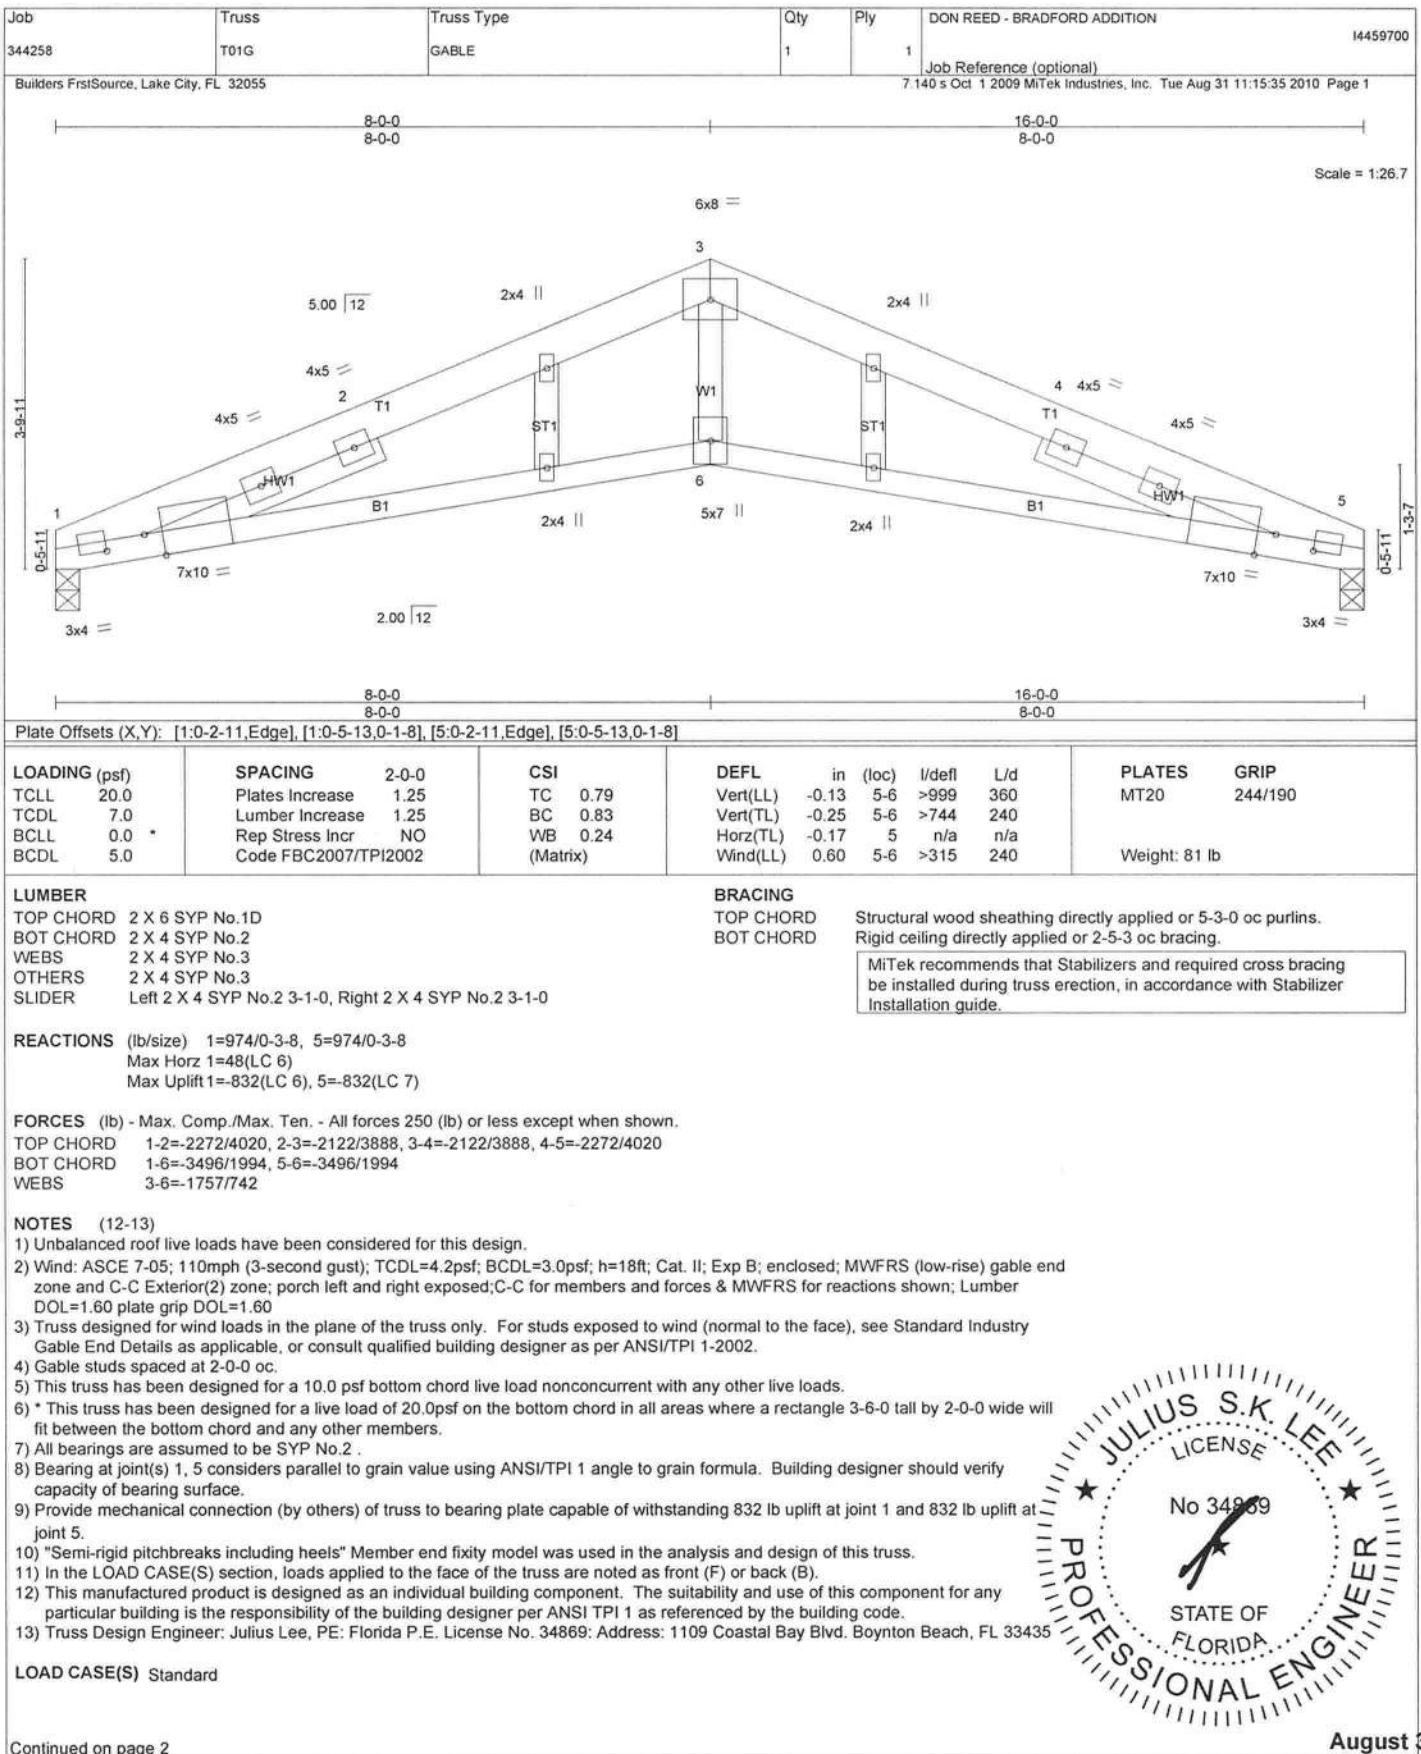

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 BEFORE USE.


Design valid for use only with Mittek connectors. This design is based only upon parameters shown, and is for an individual building component. Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component Safety Information** available from Truss Plate Institute, 583 D'Oroff Drive, Madison, WI 53719.


Julius Lee
1109 Coastal Bay Blvd.
Boynton, FL 33435

| | | | | | | |
|---------------|---------------|---------------------|----------|----------|--|----------|
| Job 344258 | Truss T01G | Truss Type GABLE | Qty 1 | Ply 1 | DON REED - BRADFORD ADDITION Job Reference (optional) | 14459700 |
|---------------|---------------|---------------------|----------|----------|--|----------|

Builders FirstSource, Lake City, FL 32055 7.140 s Oct 1 2009 MiTek Industries, Inc. Tue Aug 31 11:15:35 2010 Page 2

LOAD CASE(S) Standard
 1) Regular: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-3=-114(F=-60), 3-5=-114(F=-60), 1-6=-10, 5-6=-10





August 31, 2010





WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 BEFORE USE.
 Design valid for use only with MiTek connectors. This design is based only upon parameters shown, and is for an individual building component.
 Applicability of design parameters and proper incorporation of component is responsibility of building designer - not truss designer. Bracing shown
 is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the
 erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding
 fabrication, quality control, storage, delivery, erection and bracing, consult **ANSI/TPI1 Quality Criteria, D58-89 and BCS11 Building Component**
Safety Information available from Truss Plate Institute, 583 D'Ondra Drive, Madison, WI 53719.

Julius Lee
 1109 Coastal Bay Blvd.
 Boynton, FL 33435

Symbols

PLATE LOCATION AND ORIENTATION

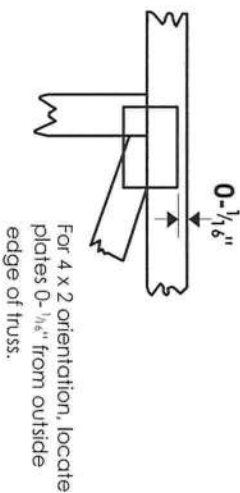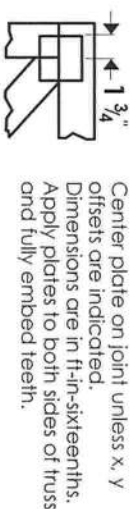

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.


PLATE SIZE

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION




BEARING



Industry Standards:

ANSI/TP11: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCS11: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

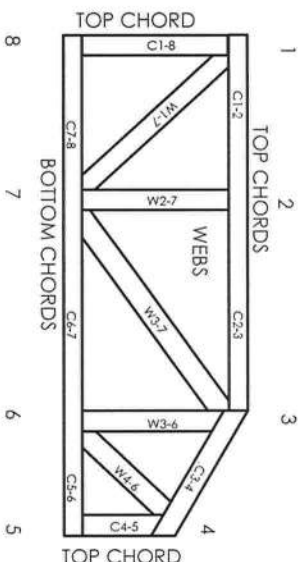

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ER-5243, 9604B, 9730, 95-43, 96-31, 9667A
NER-487, NER-561
95110, 84-32, 96-67, ER-3907, 9432A

© 2006 Mitek® All Rights Reserved

Julius Lee
1109 Coastal Bay Blvd.
Boynton, FL 33435



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCS11.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stock materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and worn at joint locations are regulated by ANSI/TP11.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP11.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP11 Quality Criteria.

STEPDOWN CORNER SET

TOP CHORD 2X4 SO. PINE #2 or Better
BOT CHORD 2X4 SO. PINE #2 or Better
WEBS 2X4 SO. PINE #3 or Better

120 MPH MAX

Setback 7' or Less

PROVIDE UPLIFT CONNECTIONS AT BEARINGS AS INDICATED.



UPLIFT: 400# or Less
BRG LOC: *
UPLIFT BASED ON 7.2 PSF TOTAL DEAD LOAD. WIND SPEED=120 "C" MPH. MEAN HGT=28 FT. ENCLOSED. (ASCE 7-02)

PROVIDE UPLIFT CONNECTIONS AT BEARINGS AS INDICATED. TILE



UPLIFT: 400# or Less
BRG LOC: *
UPLIFT BASED ON 15.0 PSF TOTAL DEAD LOAD. WIND SPEED=120 "C" MPH. MEAN HGT (of jacks)=28 FT. ENCLOSED. (ASCE 7-02)

PROVIDE UPLIFT CONNECTIONS AT BEARINGS AS INDICATED.

UPLIFT: 400# or Less
BRG LOC: *
UPLIFT BASED ON 7.2 PSF TOTAL DEAD LOAD. WIND SPEED=120 "B" MPH. MEAN HGT (of jacks)=28 FT. ENCLOSED. (ASCE 7-02)

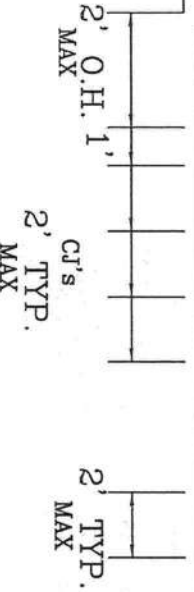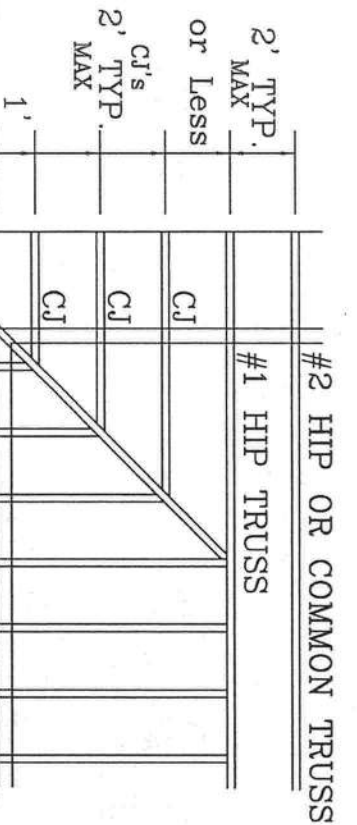

* (3) 16d TOENAILS
** SEE EOR FOR TIE DOWN

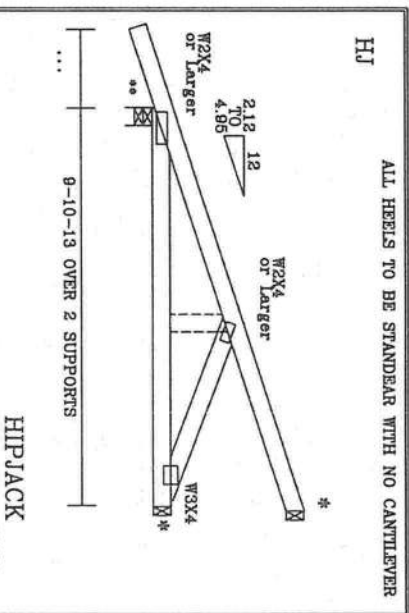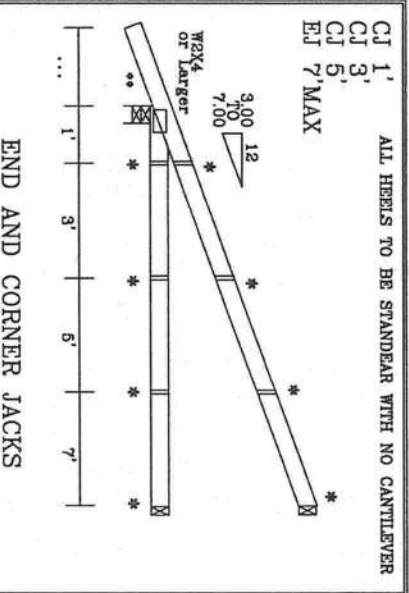


UPLIFT VALUES DO TAKE INTO ACCOUNT PORCHES EXPOSED
BC LIVE LOAD IS NON CONCURRENT 10*

CORNER SET
SETBACK
7'0" MAX

WARNING TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BCS 1-03 (BUILDING COMPONENT SAFETY INFORMATION), PUBLISHED BY THE TRUSS PLATE INSTITUTE, 504 BROAD RD., SUITE 400, WEST HAVEN, CT 06611-4000 FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.


IMPORTANT FURNISH COPY OF THIS DESIGN TO INSTALLATION CONTRACTOR. ALPINE ENGINEERED PRODUCTS, INC., SHALL NOT BE RESPONSIBLE FOR FABRICATING, HANDLING, SHIPPING, INSTALLING, OR BRACING OF TRUSSES. DESIGN CONFORMS WITH APPLICABLE PROVISIONS OF THE NATIONAL DESIGN SPECIFICATION FOR STEEL, AISC 360-10, AND THE ALPINE CONNECTOR PLATES ARE MADE OF 20/18/16GA C/H/S/30 ASTM A653 GRADE 40/60 C/H/S/30 GALV. STEEL. APPLY PLATES TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWING 1600-2. ANY INSPECTION OF PLATES FOLLOWED BY A DESIGNER SHALL BE THE DESIGNER'S RESPONSIBILITY. THE TRUSS DESIGNER'S RESPONSIBILITY IS THE RESPONSIBILITY OF THE BUILDING DESIGNER, PER ANSI/TPI 1 SEC. 2.

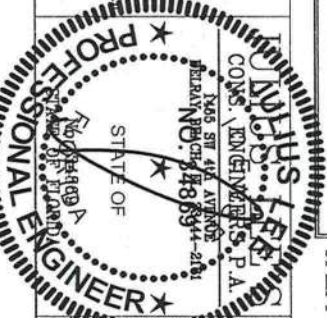

| TRUSS | SPAN | LOAD | REF |
|---|--------------|---------|----------------|
| HC | 20 | MAX PSF | 7' MAX STBK CS |
| BC | 10* | MAX PSF | |
| DL | 5 | MAX PSF | |
| DRWG | | | |
| ENG | | | |
| DATE | Jun./27/2008 | | |
| REVIEWED | | | |
| By Julius Lee at 10:52 am, Jun 27, 2008 | | | |

DUR. FAC. 1.25
SPACING 2' MAX

| MAX GABLE VERTICAL LENGTH | | | | | | | | | | | | | | |
|---------------------------|-------------|----------|-----------|---------------------|---------|---------------------|---------|----------------------|---------|---------------------|---------|---------------------|---------|--------|
| CABLE VERTICAL SPACING | 2x4 SPECIES | BRACE | NO BRACES | (1) 1x4 "L" BRACE • | | (1) 2x4 "L" BRACE • | | (2) 2x4 "L" BRACE •• | | (1) 2x6 "L" BRACE • | | (2) 2x8 "L" BRACE • | | |
| | | | | GROUP A | GROUP B | GROUP A | GROUP B | GROUP A | GROUP B | GROUP A | GROUP B | GROUP A | GROUP B | |
| 24" O.C. | SPF | #1 / #2 | 3' 2" | 5' 6" | 6' 8" | 6' 5" | 6' 9" | 7' 10" | 8' 0" | 10' 3" | 10' 7" | 12' 3" | 12' 7" | |
| | | | #3 | 3' 1" | 4' 5" | 4' 5" | 5' 10" | 5' 10" | 7' 10" | 9' 1" | 9' 1" | 12' 3" | 12' 3" | |
| | | | STUD | 3' 1" | 4' 5" | 4' 5" | 5' 10" | 5' 10" | 7' 10" | 9' 1" | 9' 1" | 12' 3" | 12' 3" | |
| | | HF | STANDARD | 2' 11" | 3' 9" | 3' 9" | 6' 0" | 6' 0" | 6' 9" | 6' 9" | 7' 10" | 7' 10" | 10' 7" | 10' 7" |
| | | | #1 | 3' 6" | 5' 6" | 5' 11" | 6' 8" | 7' 0" | 7' 10" | 8' 5" | 10' 3" | 11' 1" | 12' 3" | 13' 2" |
| | | | #2 | 3' 6" | 5' 6" | 5' 11" | 6' 8" | 7' 0" | 7' 10" | 8' 5" | 10' 3" | 11' 1" | 12' 3" | 13' 2" |
| | SP | #3 | 3' 3" | 4' 6" | 4' 6" | 6' 0" | 6' 0" | 7' 10" | 8' 1" | 9' 4" | 9' 4" | 12' 3" | 12' 6" | |
| | | STUD | 3' 3" | 4' 6" | 4' 6" | 5' 11" | 5' 11" | 7' 10" | 8' 0" | 9' 3" | 9' 3" | 12' 3" | 12' 6" | |
| | | STANDARD | 3' 0" | 3' 10" | 3' 10" | 6' 1" | 6' 1" | 6' 11" | 6' 11" | 8' 0" | 8' 0" | 10' 10" | 10' 10" | |
| | DFL | #1 / #2 | #3 | 3' 8" | 6' 4" | 6' 6" | 7' 6" | 7' 8" | 9' 2" | 11' 8" | 12' 1" | 14' 0" | 14' 0" | |
| | | | #8 | 3' 7" | 5' 5" | 5' 5" | 7' 2" | 7' 2" | 8' 11" | 8' 11" | 11' 2" | 11' 2" | 14' 0" | 14' 0" |
| | | | STUD | 3' 7" | 5' 5" | 5' 5" | 7' 2" | 7' 2" | 8' 11" | 8' 11" | 11' 2" | 11' 2" | 14' 0" | 14' 0" |
| HF | | STANDARD | 3' 7" | 4' 8" | 4' 8" | 6' 2" | 6' 2" | 6' 3" | 6' 3" | 8' 7" | 8' 7" | 12' 11" | 12' 11" | |
| | | #1 | 4' 0" | 6' 4" | 6' 4" | 8' 10" | 8' 10" | 8' 11" | 8' 11" | 11' 9" | 11' 9" | 14' 0" | 14' 0" | |
| | | #2 | 3' 11" | 6' 4" | 6' 4" | 8' 10" | 8' 10" | 8' 11" | 8' 11" | 11' 9" | 11' 9" | 14' 0" | 14' 0" | |
| 16" O.C. | SP | #3 | 3' 8" | 5' 6" | 5' 6" | 7' 4" | 7' 4" | 8' 11" | 8' 6" | 11' 5" | 11' 6" | 14' 0" | 14' 0" | |
| | | STUD | 3' 8" | 5' 6" | 5' 6" | 7' 4" | 7' 4" | 8' 11" | 8' 6" | 11' 5" | 11' 6" | 14' 0" | 14' 0" | |
| | | STANDARD | 3' 8" | 5' 6" | 5' 6" | 7' 4" | 7' 4" | 8' 11" | 8' 6" | 11' 5" | 11' 6" | 14' 0" | 14' 0" | |
| | DFL | STANDARD | 3' 8" | 4' 9" | 4' 9" | 6' 3" | 6' 3" | 6' 5" | 6' 5" | 9' 9" | 9' 9" | 13' 3" | 13' 3" | |
| | | #1 / #2 | 4' 0" | 6' 11" | 6' 11" | 8' 3" | 8' 3" | 8' 6" | 8' 6" | 10' 1" | 10' 1" | 12' 11" | 12' 11" | |
| | | #3 | 3' 11" | 6' 3" | 6' 3" | 8' 3" | 8' 3" | 8' 3" | 8' 3" | 9' 10" | 9' 10" | 12' 11" | 12' 11" | |
| 12" O.C. | SPF | STUD | 3' 11" | 5' 4" | 5' 4" | 7' 1" | 7' 1" | 9' 6" | 9' 6" | 11' 1" | 11' 1" | 14' 0" | 14' 0" | |
| | | STANDARD | 3' 11" | 5' 4" | 5' 4" | 7' 1" | 7' 1" | 9' 6" | 9' 6" | 11' 1" | 11' 1" | 14' 0" | 14' 0" | |
| | | #1 | 4' 5" | 6' 11" | 6' 11" | 8' 3" | 8' 3" | 8' 11" | 8' 11" | 10' 7" | 10' 7" | 14' 0" | 14' 0" | |
| | SP | #2 | 4' 4" | 6' 11" | 6' 11" | 8' 3" | 8' 3" | 8' 11" | 8' 11" | 10' 7" | 10' 7" | 14' 0" | 14' 0" | |
| | | #3 | 4' 2" | 6' 6" | 6' 6" | 8' 3" | 8' 3" | 8' 6" | 8' 6" | 10' 4" | 10' 4" | 14' 0" | 14' 0" | |
| | | STUD | 4' 0" | 6' 4" | 6' 4" | 8' 3" | 8' 3" | 8' 6" | 8' 6" | 10' 4" | 10' 4" | 14' 0" | 14' 0" | |

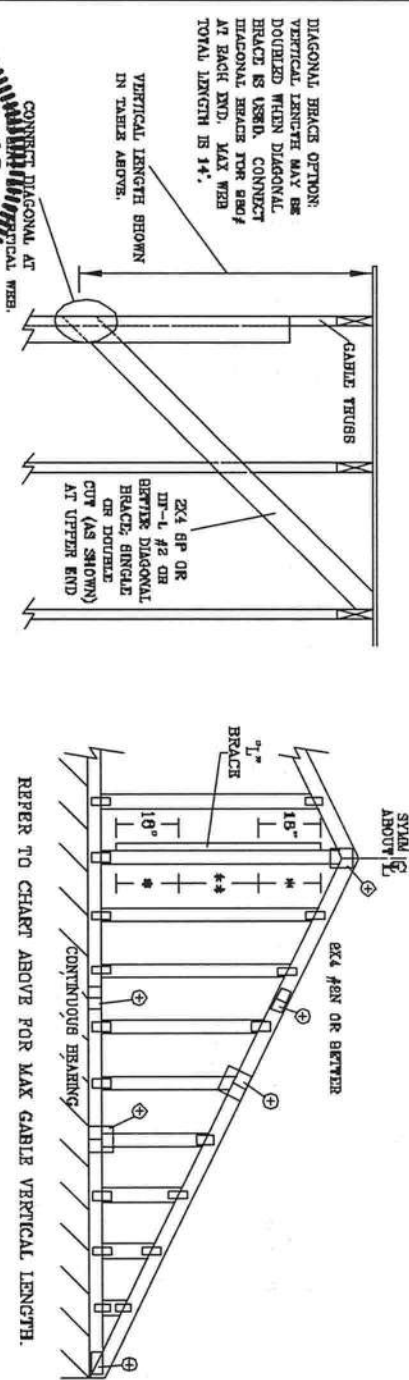

| BRACING GROUP SPECIES AND GRADDES: | | | | | | | | | | | | | | | | | | | | | |
|--|----------|----------|----|------|--|----|------|----|----------|--|--|----------|--|----|--|----|--|------|--|----------|--|
| <p>GROUP A:</p> <p>SPRUCE-PINE-TR</p> <table border="1"> <tr> <td>#1 / #2</td> <td>STANDARD</td> </tr> <tr> <td>#3</td> <td>STUD</td> </tr> </table> <p>DOUGLAS FIR-LARCH</p> <table border="1"> <tr> <td>#3</td> <td></td> </tr> <tr> <td>STUD</td> <td></td> </tr> <tr> <td>STANDARD</td> <td></td> </tr> </table> | #1 / #2 | STANDARD | #3 | STUD | #3 | | STUD | | STANDARD | | <p>GROUP B:</p> <p>RED-FIR</p> <table border="1"> <tr> <td>#1 & BTR</td> <td></td> </tr> <tr> <td>#1</td> <td></td> </tr> </table> <p>SOUTHERN PINE</p> <table border="1"> <tr> <td>#3</td> <td></td> </tr> <tr> <td>STUD</td> <td></td> </tr> <tr> <td>STANDARD</td> <td></td> </tr> </table> | #1 & BTR | | #1 | | #3 | | STUD | | STANDARD | |
| #1 / #2 | STANDARD | | | | | | | | | | | | | | | | | | | | |
| #3 | STUD | | | | | | | | | | | | | | | | | | | | |
| #3 | | | | | | | | | | | | | | | | | | | | | |
| STUD | | | | | | | | | | | | | | | | | | | | | |
| STANDARD | | | | | | | | | | | | | | | | | | | | | |
| #1 & BTR | | | | | | | | | | | | | | | | | | | | | |
| #1 | | | | | | | | | | | | | | | | | | | | | |
| #3 | | | | | | | | | | | | | | | | | | | | | |
| STUD | | | | | | | | | | | | | | | | | | | | | |
| STANDARD | | | | | | | | | | | | | | | | | | | | | |
| <p>SOUTHWEST PINE</p> <table border="1"> <tr> <td>#1</td> <td></td> </tr> <tr> <td>#2</td> <td></td> </tr> </table> | #1 | | #2 | | <p>DOUGLAS FIR-LARCH</p> <table border="1"> <tr> <td>#1</td> <td></td> </tr> <tr> <td>#2</td> <td></td> </tr> </table> | #1 | | #2 | | | | | | | | | | | | | |
| #1 | | | | | | | | | | | | | | | | | | | | | |
| #2 | | | | | | | | | | | | | | | | | | | | | |
| #1 | | | | | | | | | | | | | | | | | | | | | |
| #2 | | | | | | | | | | | | | | | | | | | | | |


CABLE TRUSS DETAIL NOTES:

LIVE LOAD DEFLECTION CRITERIA IS $L/240$.
 PROVIDE UPLIFT CONNECTIONS FOR 190 PLF OVER-
 CONDUCTIONS BEARING (6 PSF TC DEAD LOAD).
 CABLE END SUPPORTS LOAD FROM 4" 0"
 OUTLICKERS WITH 2" 0" OVERHANG, OR 12"
 PLUMB OVERHANG.

| CABLE VERTICAL PLATE SIZES | |
|---|------------|
| VERTICAL LENGTH | NO SPlice |
| LESS THAN 4' 0" | 1X4 OR 2X3 |
| GREATER THAN 4' 0", BUT LESS THAN 11' 0" | 2X4 |
| GREATER THAN 11' 0" | 2, 5X4 |

+ REFER TO COMMON TROUS DESIGN FOR
FRAX, SPLICE, AND HELL PLATES.

T. BRACING MUST BE A MINIMUM OF 80% OF WEB
MEMBER LENGTH.

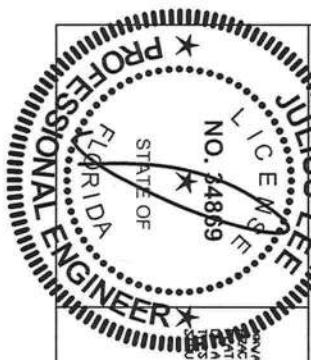

REVIEWED
By *julius lee* at 12:00 pm, Jun 11, 2008

EXHAUST SYSTEMS, INCLUDING EXTENSIVE CARE IN FABRICATING, HANGING, SHOPPING, AND DISTINGUISHING. WORKMAN, REFER TO BEST LEADING QUALITY, CONCRETE SAFETY, INTERNATIONAL, PUBLISHED BY THE STRASSER INSTITUTE, 3833 PINEWOOD, ST. LOUIS 20, MISSOURI, MO. 63119 AND VICA (VOLUME) THROUGH COUNCIL, AMERICA, 6800 ENTERPRISE, LA, MOBILE, LA 53129 FOR SAFETY PRACTICES, PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, TOP CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND BOTTOM CHORD SHALL HAVE A PROPERLY ATTACHED ROOF CEILING.

JULIUS LEE'S
CONS. ENGINEERS P.A.

1456 SW 4th AVENUE
DELRAY BEACH, FL 33444-2161

REF ASCB7-02-CAB13030

DATE 11/26/03

DWG MIVEK STD CABLE 30' E INT

—ENG

MAX. TOT. LD. 60 PSF

MAX. SPACING 24.0"

TOP CHORD 2X4 #2 OR BETTER
BOT CHORD 2X4 #2 OR BETTER
WEBS 2X4 #3 OR BETTER

PIGGYBACK DETAIL

REFER TO SEALED DESIGN FOR DASHED PLATES.

SPACE PIGGYBACK VERTICALS AT 4' OC MAX.
TOP AND BOTTOM CHORD SPLICES MUST BE STAGGERED SO THAT ONE SPLICE IS NOT DIRECTLY OVER ANOTHER.

PIGGYBACK BOTTOM CHORD MAY BE OMITTED. ATTACH VERTICAL WEBS TO TRUSS TOP CHORD WITH 1.5X3 PLATE.




ATTACH PURLINS TO TOP OF FLAT TOP CHORD. IF PIGGYBACK IS SOLID LUMBER OR THE BOTTOM CHORD IS OMITTED, PURLINS MAY BE APPLIED BENEATH THE TOP CHORD OF SUPPORTING TRUSS.

REFER TO ENGINEER'S SEALED DESIGN FOR REQUIRED PURLIN SPACING.

THIS DETAIL IS APPLICABLE FOR THE FOLLOWING WIND CONDITIONS:

110 MPH WIND, 30' MEAN HGT, ASCE 7-02, CLOSED BLDG, LOCATED ANYWHERE IN ROOF, CAT II, EXP. C, WIND TC DL=6 PSF, WIND BC DL=5 PSF
110 MPH WIND, 30' MEAN HGT, PEG ENCLOSED BLDG, LOCATED ANYWHERE IN ROOF, WIND TC DL=6 PSF, WIND BC DL=5 PSF
FRONT FACE (B,*) PLATES MAY BE OFFSET FROM BACK FACE PLATES AS LONG AS BOTH FACES ARE SPACED 4' OC MAX.


130 MPH WIND, 30' MEAN HGT, ASCE 7-02, CLOSED BLDG, LOCATED ANYWHERE IN ROOF, CAT II, EXP. C, WIND TC DL=6 PSF, WIND BC DL=6 PSF

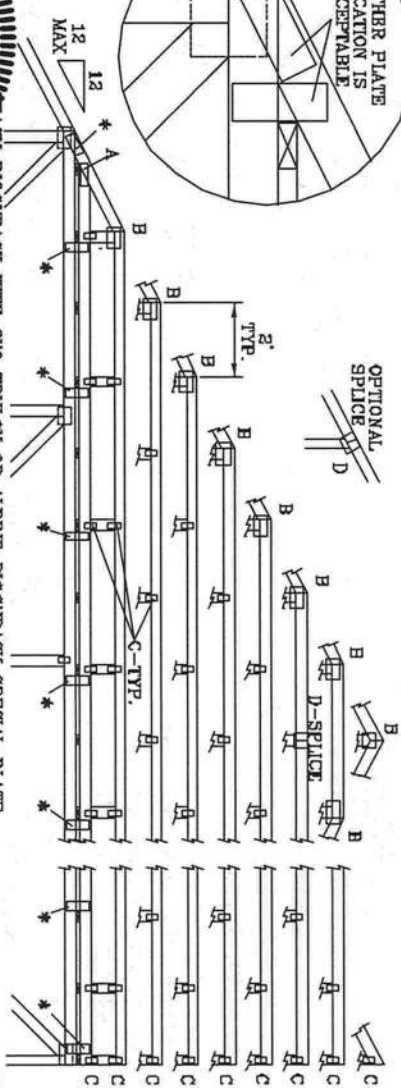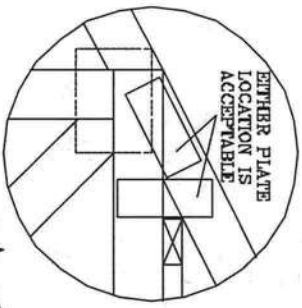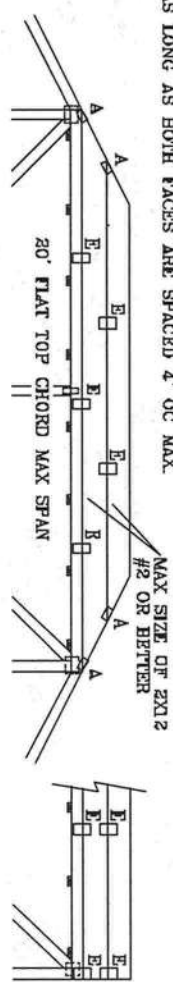


| JOINT TYPE | SPANS UP TO | | | |
|------------|---|-------|-------|-------|
| | 30' | 34' | 38' | 62' |
| A | 2X4 | 2.6X4 | 2.6X4 | 3X6 |
| B | 4X6 | 6X6 | 6X6 | 6X6 |
| C | 1.5X3 | 1.5X4 | 1.5X4 | 1.5X4 |
| D | 6X4 | 6X5 | 6X5 | 6X6 |
| E | 4X6 OR 3X6 TRUSS AT 4' OC, ROTATED VERTICALLY | | | |

ATTACH TRUSS PLATES WITH (6) 0.120" X 1.375" NAILS, OR EQUAL, PER FACE PER PLY. (4) NAILS IN EACH MEMBER TO BE CONNECTED. REFER TO DRAWING 160 TL FOR TRUSS INFORMATION.

| WEB LENGTH | WEB BRACING CHART |
|-------------|--|
| 0' TO 7'9" | NO BRACING |
| 7'9" TO 10' | 1X4 "T" BRACE, SAME GRADE, SPECIES AS WEB MEMBER OR BETTER, AND 80% LENGTH OF WEB MEMBER. ATTACH WITH 8d NAILS AT 4" OC. |
| 10' TO 14' | 2X4 "T" BRACE, SAME GRADE, SPECIES AS WEB MEMBER, OR BETTER, AND 80% LENGTH OF WEB MEMBER. ATTACH WITH 16d NAILS AT 4" OC. |

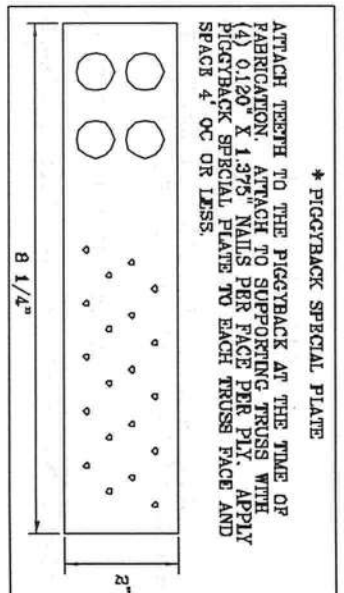

THIS DRAWING REPLACES DRAWINGS 634.016 634.017 & 647.045

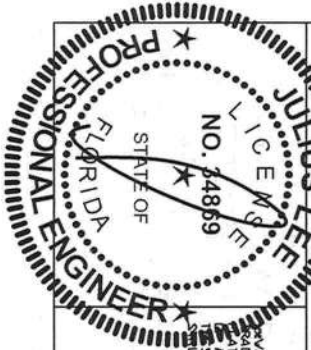

REVIEWED
By Julius Lee at 11:59 am, Jun 11, 2008

JULIUS LEE'S
CONS. ENGINEERS P.A.
1400 SW 4TH AVENUE
DUNNWAY BEACH, FL 33444-2161

No. 34869
STATE OF FLORIDA

| MAX LOADING | | REF | PIGGYBACK |
|---------------|----------------|-----------|-----------|
| 55 PSF AT | 1.33 DUR. FAC. | DATE | 09/12/07 |
| 60 PSF AT | 1.25 DUR. FAC. | DRWG/ITER | STD PIGGY |
| 47 PSF AT | 1.15 DUR. FAC. | ENG | JL |
| SPACING 24.0" | | | |

TOE-NAIL DETAIL

TOE-NAILS TO BE DRIVEN AT AN ANGLE OF APPROXIMATELY THIRTY DEGREES WITH THE PIECE AND STARTED APPROXIMATELY ONE-THIRD THE LENGTH OF THE NAIL FROM THE END OF THE MEMBER.

PER ANSI/AF&PA NDS-2001 SECTION 12.4.1 - EDGE DISTANCE, END DISTANCE, SPACING, END DISTANCES, END DISTANCES AND SPACINGS FOR NAILS AND SPIKES SHALL BE SUFFICIENT TO PREVENT SPLITTING OF THE WOOD.



THE NUMBER OF TOE-NAILS TO BE USED IN A SPECIFIC APPLICATION IS DEPENDENT UPON PROPERTIES FOR THE CHORD SIZE, LUMBER SPECIES, AND NAIL TYPE. PROPER CONSTRUCTION PRACTICES AS WELL AS GOOD JUDGEMENT SHOULD DETERMINE THE NUMBER OF NAILS TO BE USED.

THIS DETAIL DISPLAYS A TOE-NAILED CONNECTION FOR JACK FRAMING INTO A SINGLE OR DOUBLE PLY SUPPORTING GIRDER.


MAXIMUM VERTICAL RESISTANCE OF 16d (0.162"x3.5") COMMON TOE-NAILS

| NUMBER OF TOE-NAILS | SOUTHERN PINE | | DOUGLAS FIR-LARCH | | HEM-FIR | | SPRUCE PINE FIR | |
|---------------------|---------------|---------|-------------------|---------|---------|---------|-----------------|---------|
| | 1 PLY | 2 PILES | 1 PLY | 2 PILES | 1 PLY | 2 PILES | 1 PLY | 2 PILES |
| 2 | 197# | 256# | 181# | 234# | 156# | 203# | 154# | 189# |
| 3 | 286# | 383# | 271# | 351# | 234# | 304# | 230# | 298# |
| 4 | 394# | 511# | 361# | 468# | 312# | 406# | 307# | 397# |
| 5 | 493# | 639# | 452# | 585# | 390# | 507# | 384# | 496# |

ALL VALUES MAY BE MULTIPLIED BY APPROPRIATE DURATION OF LOAD FACTOR.

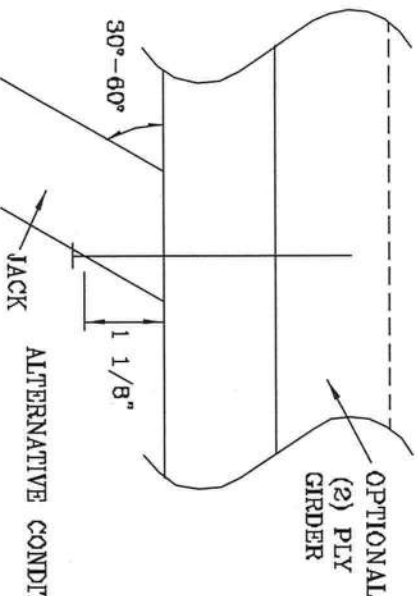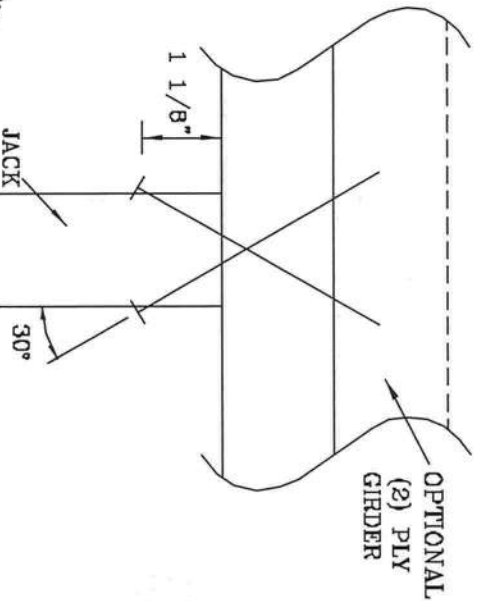

THIS DRAWING REPLACES DRAWING 784040

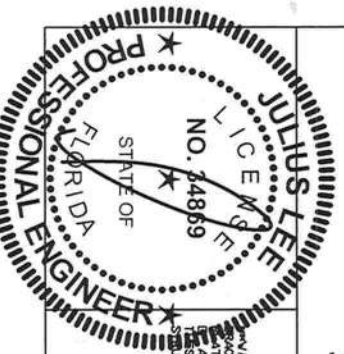

WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BEST PRACTICES FOR TRUSS SAFETY (INTERNATIONAL TRUSS ASSOCIATION, 1999) AND AIAA (2003) TRUSS STANDARDS. TRUSSES SHOULD BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH THE AIAA (2003) TRUSS STANDARDS. TRUSSES SHOULD BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH THE AIAA (2003) TRUSS STANDARDS. TRUSSES SHOULD BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH THE AIAA (2003) TRUSS STANDARDS.

REVIEWED
By Julius Lee at 11:59 am, Jun 11, 2008

JULIUS LEE'S
CONS. ENGINEERS P.A.
1400 1ST AVENUE
DELRAY BEACH, FL 33441-2161

No. 34869
STATE OF FLORIDA

| | | | |
|-----------|------|------|--------------|
| TC LL | PSF | REF | TOE-NAIL |
| TC DL | PSF | DATE | 09/12/07 |
| BC DL | PSF | DRWG | CNTONAIL1103 |
| BC LL | PSF | ENG | JL |
| TOT. LD. | PSF | | |
| DUR. FAC. | 1.00 | | |
| SPACING | | | |

TRULOX CONNECTION DETAIL


11 GAUGE (0.120" X 1.375") NAILS REQUIRED FOR TRULOX PLATE ATTACHMENT. FILL ROWS COMPLETELY WHERE SHOWN (Φ).

* NAILS MAY BE OMITTED FROM THESE ROWS.

THIS DETAIL MAY BE USED WITH SO. PINE, DOUGLAS-FIR OR HEM-FIR CHORDS WITH A MINIMUM 1.00 DURATION OF LOAD OR SPRUCE-PINE-FIR CHORDS WITH A MINIMUM 1.15 DURATION OF LOAD. CHORD SIZE OF BOTH TRUSSES MUST EXCEED THE TRULOX PLATE WIDTH.


TRULOX PLATE IS CENTERED ON THE CHORDS AND BENT BETWEEN NAIL ROWS.

REFER TO ENGINEER'S SEALED DESIGN REFERENCING THIS DETAIL FOR LUMBER, PLATES, AND OTHER INFORMATION NOT SHOWN.

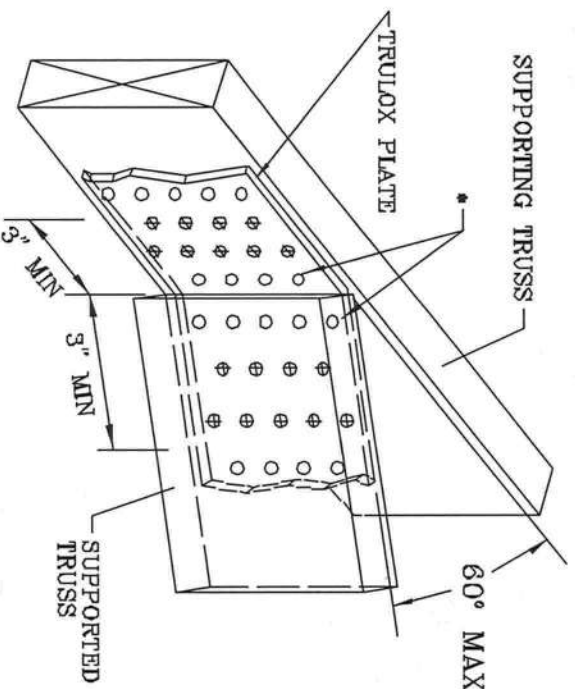


SUPPORTING TRUSS

60° MAX

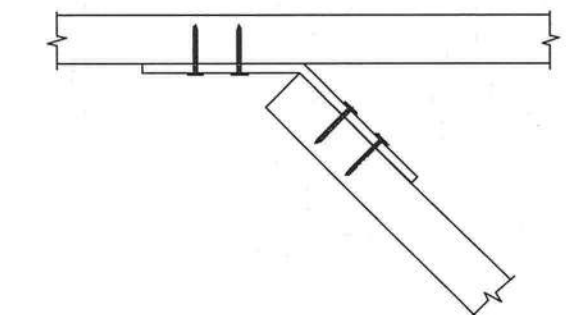

| TRULOX PLATE SIZE | REQUIRED NAILS PER TRUSS | MAXIMUM LOAD UP OR DOWN |
|-------------------|--------------------------|-------------------------|
| 3X6 | 9 | 350 # |
| 6X6 | 15 | 990 # |

MINIMUM 3X6 TRULOX PLATE

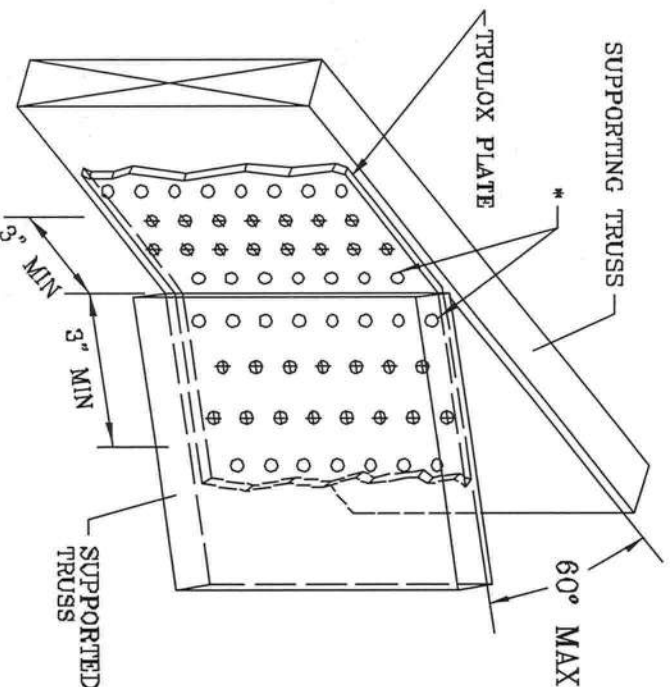


SUPPORTING TRUSS

60° MAX

SUPPORTED TRUSS

MINIMUM 5X6 TRULOX PLATE

REVIEWED
By Julius Lee at 11:58 am, Jun 11, 2008

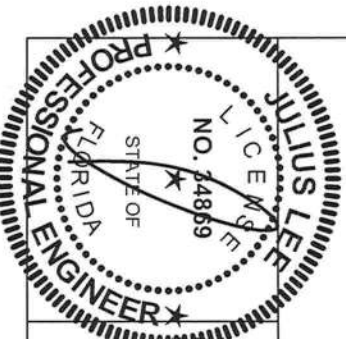

WARNING: TRUSSES REQUIRE EXTREME CARE IN FABRICATING, HANDLING, SHIPPING, INSTALLING AND BRACING. REFER TO BC31-1-00 BUILDING DEPARTMENT SAFETY DEPARTMENT, PUBLISHED BY THE TRUSS MANUFACTURERS ASSOCIATION, 383 DUNSTON DR., SUITE 800, NORTON, VT. 05719 AND VITA (VITA TRUSS COUNCIL, AMERICA, 6300 ENTERPRISE LN, WADSWORTH, VT. 05719) FOR SAFETY PRACTICES PRIOR TO PERFORMING THESE FUNCTIONS. UNLESS OTHERWISE INDICATED, THE CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL PANELS AND DETAIL BOND SHALL HAVE A PROPERLY ATTACHED RIBBON CEILING.

JULIUS LEE'S
CONS. ENGINEERS P.A.

1455 SR 4th AVENUE
DELMAR, DE. 19844-2101

No: 34869
STATE OF FLORIDA

THIS DRAWING REPLACES DRAWINGS 1,158,989 1,158,989/R
1,154,844 1,152,217 1,152,017 1,159,154 & 1,151,524

| REF | TRULOX |
|------|--------------|
| DATE | 11/26/03 |
| DRWG | CNTRULOX1103 |
| —ENG | JL |

MULTIPLE-MEMBER CONNECTIONS FOR SIDE-LOADED BEAMS

Maximum Uniform Load Applied to Either Outside Member (PLF)


| Connector Type | Number of Rows | Connector On-Center Spacing | Connector Pattern | | | | | |
|---|----------------|-----------------------------|-------------------|--------------|--------------|------------|------------|------------|
| | | | Assembly A | Assembly B | Assembly C | Assembly D | Assembly E | Assembly F |
| | | | | | | | | |
| | | | 3 1/2" 2-ply | 5 1/4" 3-ply | 5 1/4" 2-ply | 7" 3-ply | 7" 2-ply | 7" 4-ply |
| 10d (0.128" x 3") Nail ⁽¹⁾ | 2 | 12" | 370 | 280 | 280 | 245 | | |
| | 3 | 12" | 555 | 415 | 415 | 370 | | |
| 1/2" A307 Through Bolts ⁽²⁾⁽⁴⁾ | 2 | 24" | 505 | 380 | 520 | 465 | 860 | 340 |
| | | 19.2" | 635 | 475 | 655 | 580 | 1,075 | 425 |
| | | 16" | 760 | 570 | 785 | 695 | 1,290 | 505 |
| SDS 1/4" x 3 1/2" ⁽⁴⁾ | 2 | 24" | 680 | 510 | 510 | 455 | | |
| | | 19.2" | 850 | 640 | 640 | 565 | | |
| | | 16" | 1,020 | 765 | 765 | 680 | | |
| SDS 1/4" x 6" ⁽³⁾⁽⁴⁾ | 2 | 24" | | | | 455 | 465 | 455 |
| | | 19.2" | | | | 565 | 580 | 565 |
| | | 16" | | | | 680 | 695 | 680 |
| USP WS35 ⁽⁴⁾ | 2 | 24" | 480 | 360 | 360 | 320 | | |
| | | 19.2" | 600 | 450 | 450 | 400 | | |
| | | 16" | 715 | 540 | 540 | 480 | | |
| USP WS6 ⁽³⁾⁽⁴⁾ | 2 | 24" | | | | 350 | 525 | 350 |
| | | 19.2" | | | | 440 | 660 | 440 |
| | | 16" | | | | 525 | 790 | 525 |
| 3 3/8" TrussLok ⁽⁴⁾ | 2 | 24" | 635 | 475 | 475 | 425 | | |
| | | 19.2" | 795 | 595 | 595 | 530 | | |
| | | 16" | 955 | 715 | 715 | 635 | | |
| 5" TrussLok ⁽⁴⁾ | 2 | 24" | | 500 | 500 | 445 | 480 | 445 |
| | | 19.2" | | 625 | 625 | 555 | 600 | 555 |
| | | 16" | | 750 | 750 | 665 | 725 | 665 |
| 6 3/4" TrussLok ⁽⁴⁾ | 2 | 24" | | | | 445 | 620 | 445 |
| | | 19.2" | | | | 555 | 770 | 555 |
| | | 16" | | | | 665 | 925 | 665 |

- (1) Nailed connection values may be doubled for 6" on-center or tripled for 4" on-center nail spacing.
- (2) Washers required. Bolt holes to be 1/16" maximum.
- (3) 6" SDS or WS screws can be used with Parallam® PSL and Microllam® LVL, but are not recommended for TimberStrand® LSL.
- (4) 24" on-center bolted and screwed connection values may be doubled for 12" on-center spacing.

General Notes

- Connections are based on NDS® 2005 or manufacturer's code report.
- Use specific gravity of 0.5 when designing lateral connections.
- Values listed are for 100% stress level. Increase 15% for snow-loaded roof conditions or 25% for non-snow roof conditions, where code allows.
- Bold Italic** cells indicate **Connector Pattern** must be installed on both sides. Stagger fasteners on opposite side of beam by 1/2 the required **Connector Spacing**.
- Verify adequacy of beam in allowable load tables on pages 16–33.
- 7" wide beams should be side-loaded only when loads are applied to both sides of the members (to minimize rotation).
- Minimum end distance for bolts and screws is 6".
- Beams wider than 7" require special consideration by the design professional.

Uniform Load Design Example

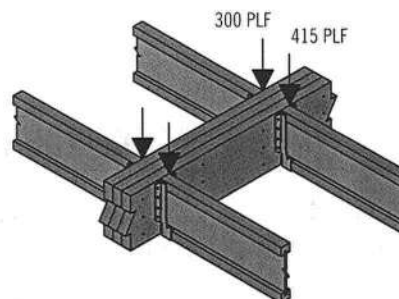


First, check the allowable load tables on pages 16–33 to verify that three pieces can carry the total load of 715 plf with proper live load deflection criteria. Maximum load applied to either outside member is 415 plf. For a 3-ply 1 3/4" assembly, two rows of 10d (0.128" x 3") nails at 12" on-center is good for only 280 plf. Therefore, use three rows of 10d (0.128" x 3") nails at 12" on-center (good for 415 plf).

Alternates:

Two rows of 1/2" bolts or SDS 1/4" x 3 1/2" screws at 19.2" on-center.

#26847

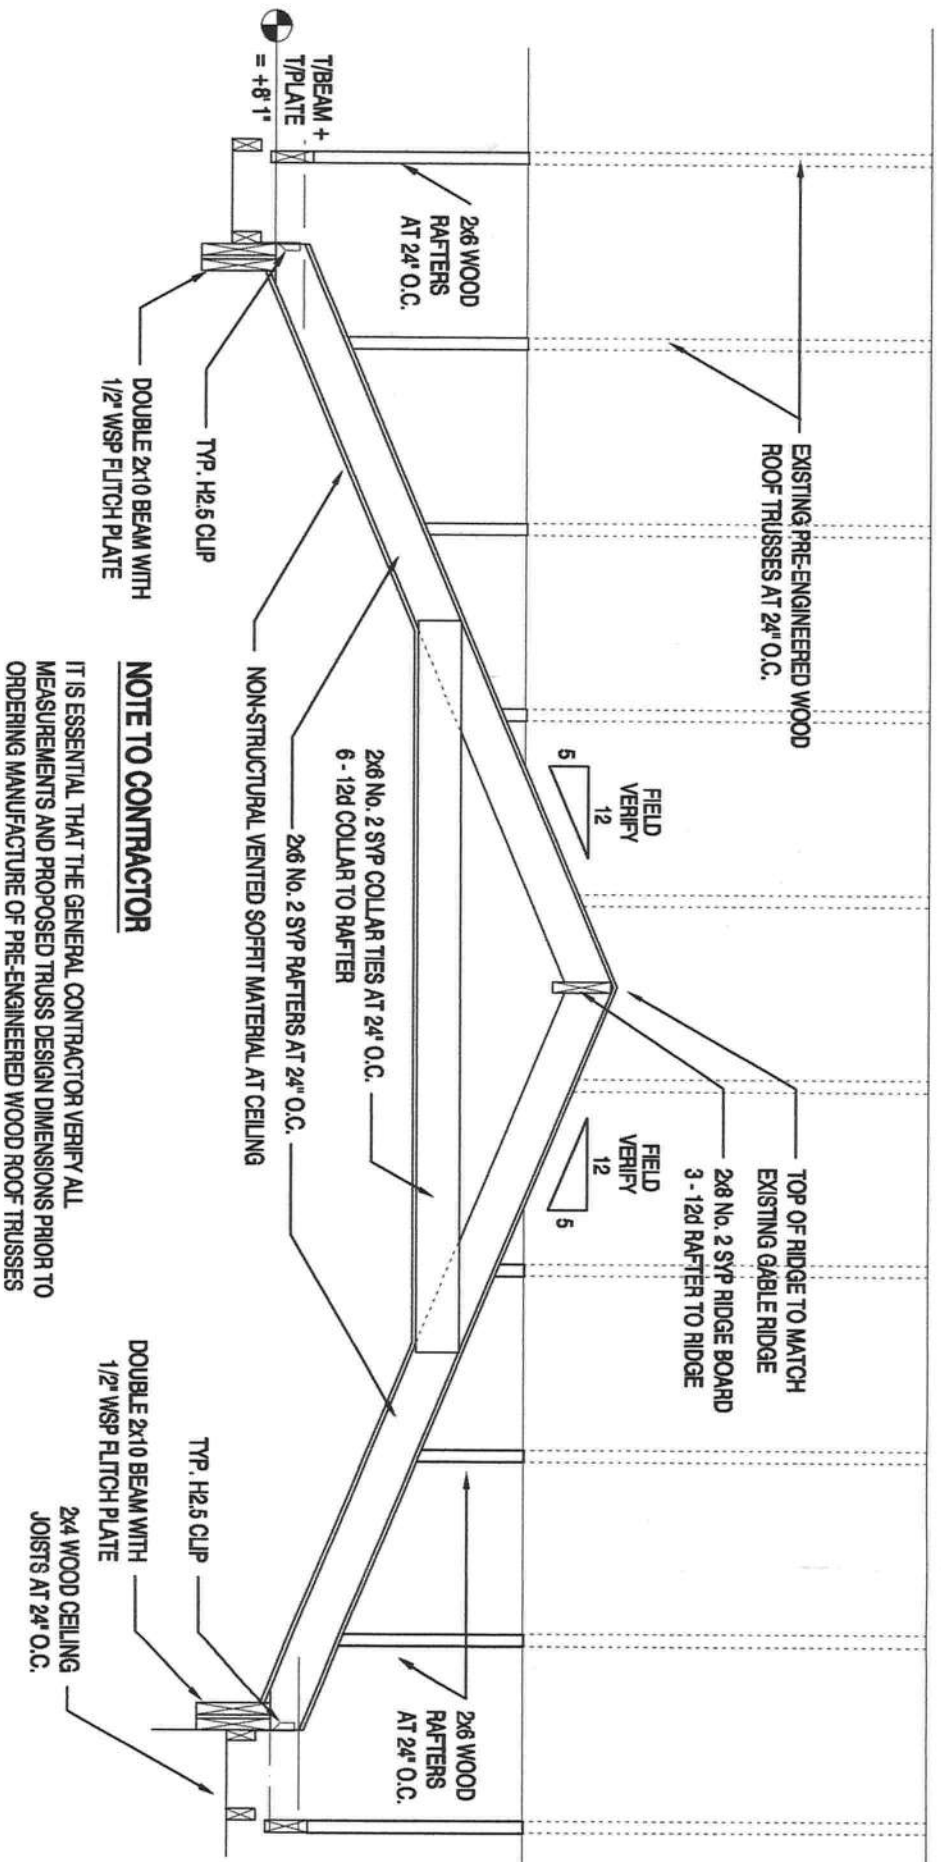


NOTE TO CONTRACTOR

IT IS ESSENTIAL THAT THE GENERAL CONTRACTOR VERIFY ALL MEASUREMENTS AND PROPOSED TRUSS DESIGN DIMENSIONS PRIOR TO ORDERING MANUFACTURE OF PRE-ENGINEERED WOOD ROOF TRUSSES

REVISED GABLE FRAMING

1
5

NOT TO SCALE

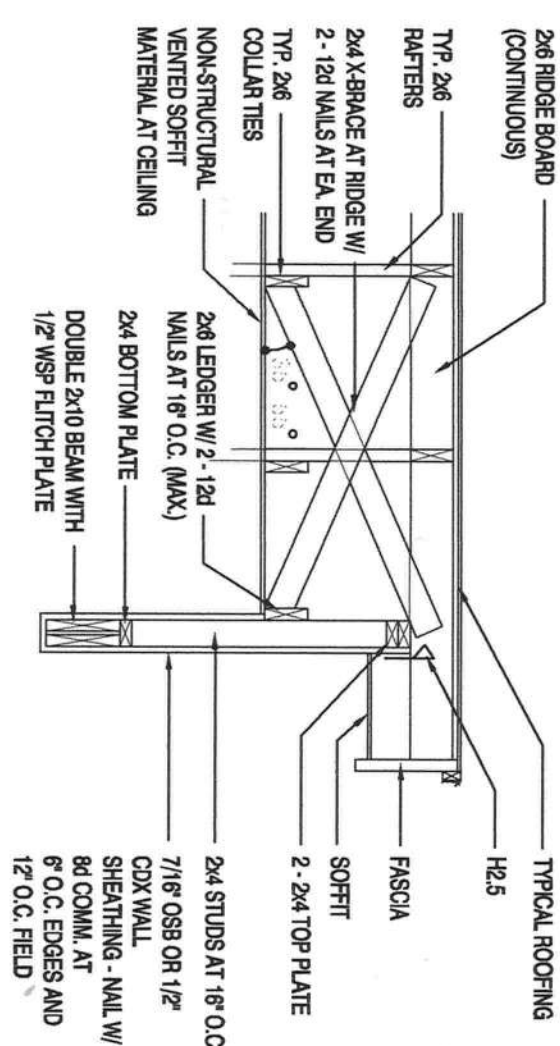

REVISED GABLE END FRAMING AND BRACING DETAIL


5
5

NOT TO SCALE

**PROPOSED ADDITION
BRADFORD RESIDENCE**
230 SE CAROB GLEN, LAKE CITY, FL 32025
PARCEL NO. 03-4S-17-07570-023

Structural Plan Service Inc COA27152
Po Box 940128 Maitland, FL 32794
Ken Ehlers PE 18243

9/22/16

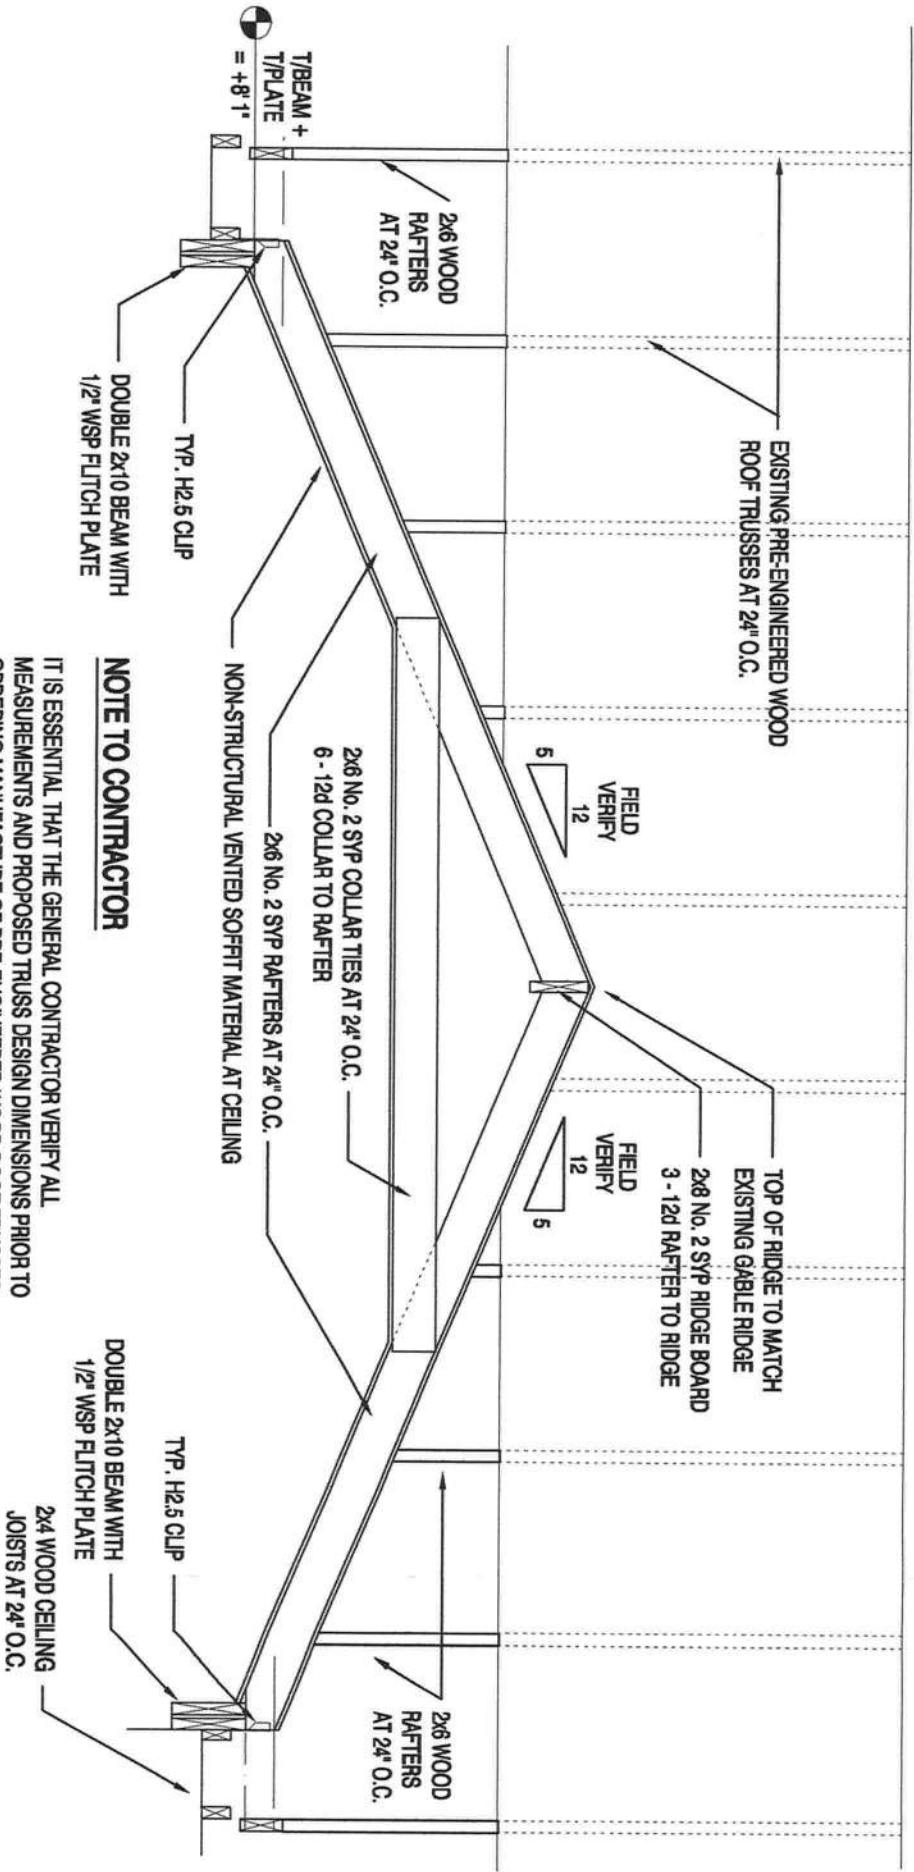


15

REVISED GABLE FRAMING

NOT TO SCALE

PROPOSED ADDITION
BRADFORD RESIDENCE
230 SE CAROB GLEN, LAKE CITY, FL 32025
PARCEL NO. 03-4S-17-07570-023

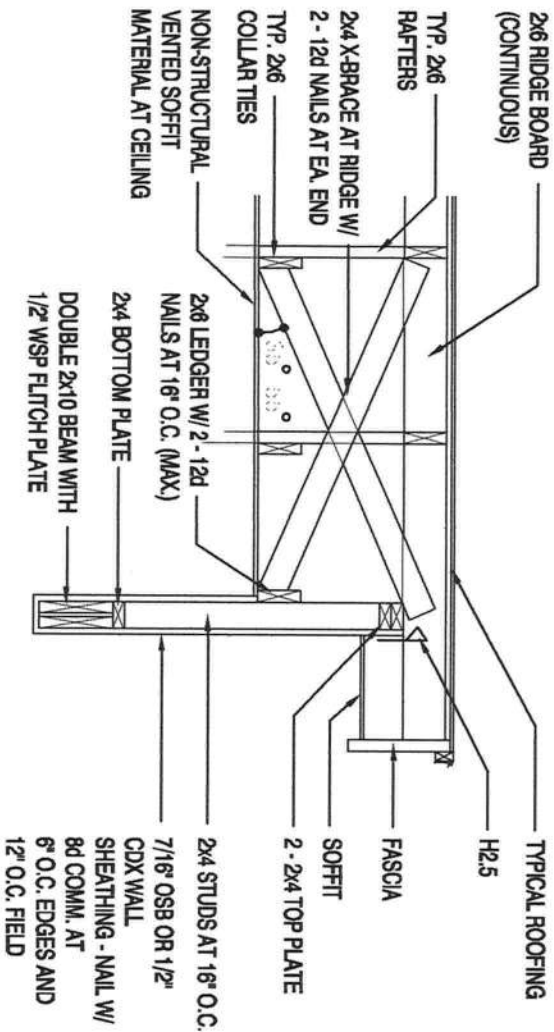

55

REVISED GABLE END FRAMING AND BRACING DETAIL

NOT TO SCALE

Structural Plan Service Inc COA27152
Po Box 940128 Maitland, FL 32794
Ken Ehlers PE18243

✓ Glen 9/22/16