

56



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM
APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 21-0719
DATE PAID: 8/24/21
FEE PAID: 310.00
RECEIPT #: 1712008

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☐ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: Kay Parker (Trent G)

AGENT: ROBERT FORD III, NORTH FLORIDA SEPTIC TANK INC;

TELEPHONE: 386-755-6372

MAILING ADDRESS: 741 SE State Rd 100, Lake City, FL 32025

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3)(m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: 1 BLOCK: 1 SUBDIVISION: 1 PLATTED:

PROPERTY ID #: 33-48-18-10534-002 ZONING: I/M OR EQUIVALENT: ☐ Y ☐ N

PROPERTY SIZE: 5.74 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐ ≤ 2000 GPD ☐ > 2000 GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? ☒ Y ☐ N DISTANCE TO SEWER: FT

PROPERTY ADDRESS: 7938 SE CR 252 LULU FL.

DIRECTIONS TO PROPERTY: 90 East to SR 100 +/R to CR 245 +/R to CR 252 +/L to site on (R) About 3/4 mile before CR 241

BUILDING INFORMATION

☒ RESIDENTIAL ☐ COMMERCIAL

Unit No	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 64E-6, FAC
1	<u>SFR</u>	<u>3</u>	<u>1820</u>	
2				
3				
4				

☐ Floor/Equipment Drains ☐ Other (Specify)

SIGNATURE: Robert Ford

DATE: 8-24-2021



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

PERMIT #: **12-SC-2355099**
APPLICATION #: **AP1717003**
DATE PAID: **9/27/2021**
FEE PAID: **310.00**
RECEIPT #: **12-P10-5187197**
DOCUMENT #: **PR1625410**

CONSTRUCTION PERMIT FOR: OSTDS New

APPLICANT: KAY**21-0719 PARKER

PROPERTY ADDRESS: 7938 CR 252 Lulu, FL 32061

LOT: _____ BLOCK: _____ SUBDIVISION: _____

PROPERTY ID #: 10534-002

[SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [900] GALLONS / GPD New Septic CAPACITY
A [1] GALLONS / GPD N/A CAPACITY
N [] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK: 1250 GALLONS]
K [] GALLONS DOSING TANK CAPACITY [] GALLONS @ [] DOSES PER 24 HRS #Pumps []

D [375] SQUARE FEET New drainfield SYSTEM
R [] SQUARE FEET N/A SYSTEM

A TYPE SYSTEM: [] STANDARD [] FILLED [x] MOUND []
I CONFIGURATION: [x] TRENCH [] BED []

F LOCATION OF BENCHMARK: Nail in 12" pine S of site

I ELEVATION OF PROPOSED SYSTEM SITE [24.00] [INCHES] FT [] ABOVE / [] BELOW BENCHMARK/REFERENCE POINT
E BOTTOM OF DRAINFIELD TO BE [8.00] [INCHES] FT [] ABOVE / [] BELOW BENCHMARK/REFERENCE POINT

D FILL REQUIRED: [34.00] INCHES EXCAVATION REQUIRED: [] INCHES

O The system is sized for 3 bedrooms with a maximum occupancy of 6 persons (2 per bedroom), for a total estimated flow of 300 gpd.
T A lift station may be needed if gravity flow can not be achieved.

SPECIFICATIONS BY: William D Bishop II

TITLE: Master Septic Contractor

APPROVED BY: Kelli Rogers

TITLE: Environmental Specialist II

Columbia CHD

DATE ISSUED: 08/30/2021

EXPIRATION DATE: 02/28/2023

DH 4016, 08/09 (Obsoletes all previous editions which may not be used)
Incorporated: 64E-6.003, FAC


STATE OF FLORIDA
DEPARTMENT OF HEALTH
APPLICATION FOR CONSTRUCTION PERMIT

1"=40'

Permit Application Number

21-0719

Parker (Trent G)

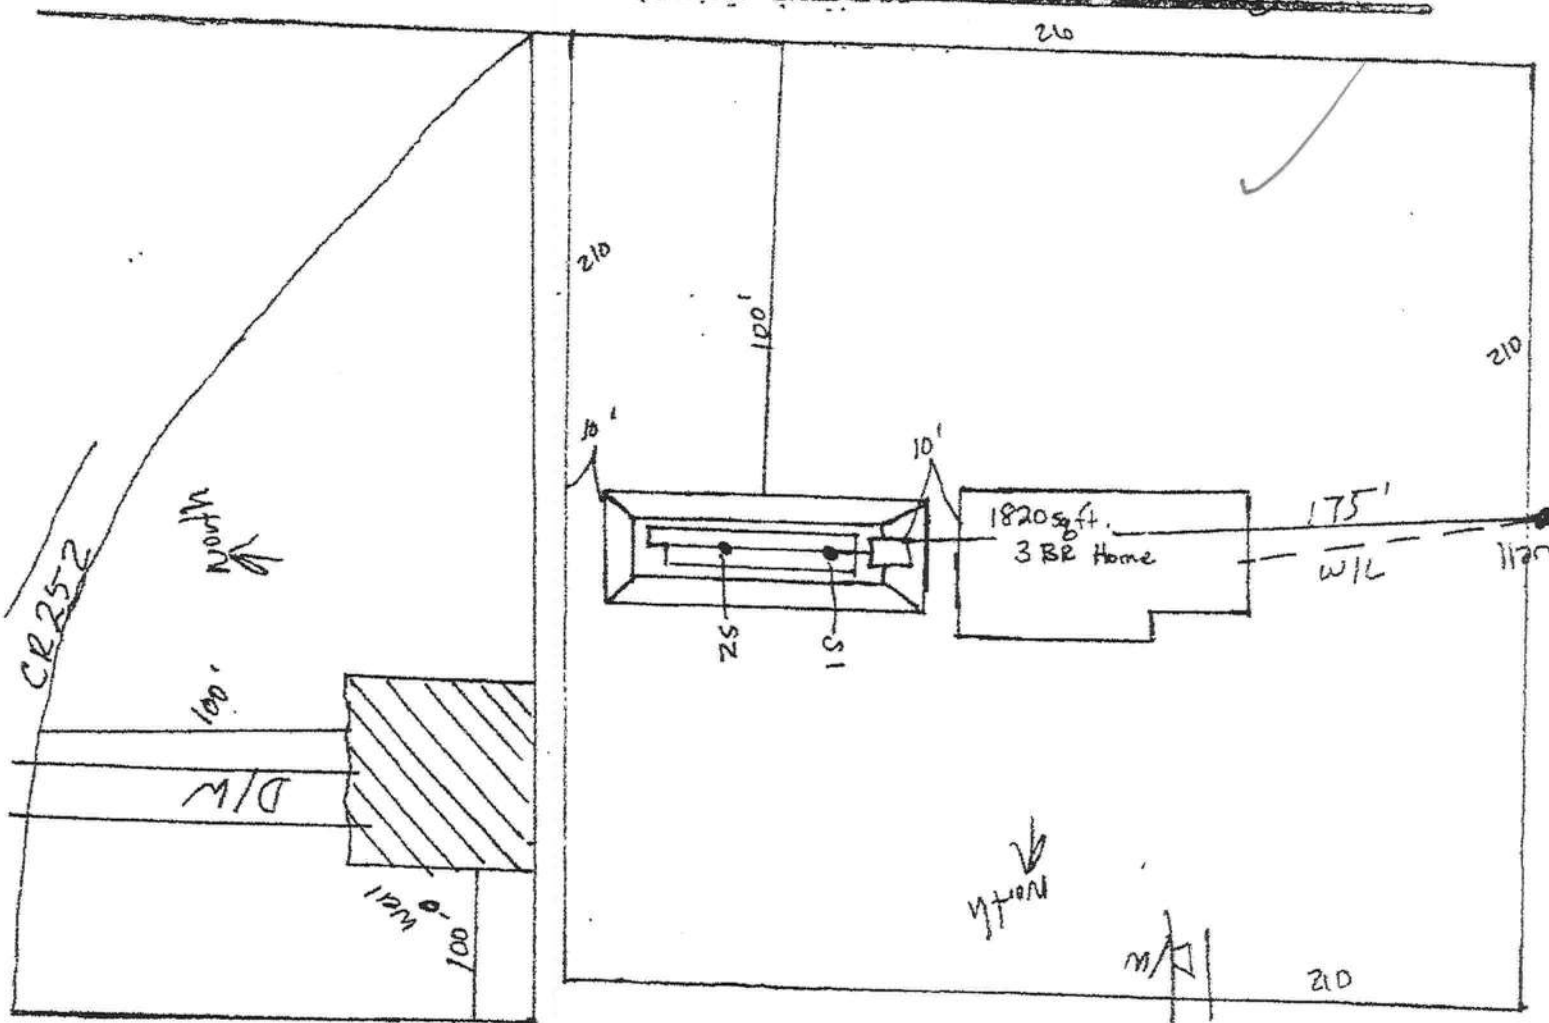

Notes:

The Plan submitted by Robert W. Dand III Date 8-24-2021

Plan Approved

Not Approved

Date 8/30/2021

Kula B

APPROVED

County Health Department

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT