

OTERO RESIDENCE  
12.00 kW PV SYSTEM  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

Castillo  
Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING  
SERVICES, LLC

COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Professional Engineer  
ERMOCRATES E. CASTILLO  
No. 52590  
STATE OF FLORIDA  
Professional Engineering

Digitally  
Signed by:  
Ermocrates E. Castillo  
Date:  
2021.07.28  
17:10:43

This document is the property of Castillo Engineering Services, LLC. It is to be used only for the project and location specified. No part of this document may be reproduced or transmitted in any form or by any means electronic or mechanical, including photocopying and recording, or by any information storage or retrieval system, except as may be permitted in writing by Castillo Engineering Services, LLC.

PROJECT NAME

OTERO RESIDENCE  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME

COVER SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

G-01

PROJECT DESCRIPTION:

32x375 LG375N1C-A6 (375W) MODULES  
ROOF MOUNTED SOLAR PHOTOVOLTAIC MODULES

SYSTEM SIZE: 12.00 kW DC STC  
ARRAY AREA #1: 292.50 SQ FT.  
ARRAY AREA #2: 39.00 SQ FT.  
ARRAY AREA #3: 292.50 SQ FT.

EQUIPMENT SUMMARY

32 LG375N1C-A6 (375W) MODULES  
32 ENPHASE IQ 7 PLUS-72-2-US MICROINVERTERS  
02 ENPHASE ENCHARGE 10 BATTERIES  
01 ENPHASE ENPOWER SMART SWITCH

RACKING: UNIRAC LIGHT RAIL  
ATTACHMENT: S-5 PROTEA BRACKET

DESIGN CRITERIA:

WIND SPEED (ULT): 120  
WIND SPEED (ASD): 93  
RISK CATEGORY: II  
EXPOSURE: C

CODES AND STANDARDS

GOVERNING CODES :  
FLORIDA RESIDENTIAL CODE, 7TH EDITION 2020 (FRC)  
FLORIDA PLUMBING CODE, 7TH EDITION 2020 (FPC)  
FLORIDA BUILDING CODE, 7TH EDITION 2020 EDITION (FBC)  
FLORIDA MECHANICAL CODE, 7TH EDITION 2020 (FMC)  
NATIONAL ELECTRICAL CODE 2017 (NEC)  
ASCE 7-16  
FLORIDA FIRE PREVENTION CODE, 7TH EDITION 2020 (FFPC)

PROJECT INFORMATION

OTERO, LILLIAN

INSTALLER

SUNPRO SOLAR  
4492-4494 EAGLE FALLS PLACE  
TAMPA, FL 33619  
PH: (866) 450-1012

ENGINEER

Castillo Engineering Services LLC  
620 N. Wymore Road, Suite 250,Maitland, FL 32751  
TEL: (407) 289-2575  
Ermocrates E. Castillo  
License#: FL PE 52590


SHEET INDEX

SHEET #	SHEET DESCRIPTION
G-01	COVER SHEET
A-00	NOTES AND DESCRIPTION
A-01	ROOF PLAN
S-01	MODULE LAYOUT
S-01.1	PARTIAL PRESSURE AND MODULES EXPOSURE
S-02	ATTACHMENT DETAIL
S-02.1	STRUCTURE CALCULATION
E-01	ELECTRICAL LINE DIAGRAM
E-02	WIRING CALCULATIONS
E-03	SYSTEM LABELING
DS-01-06	DATA SHEETS

HOUSE PHOTO



VICINITY MAP

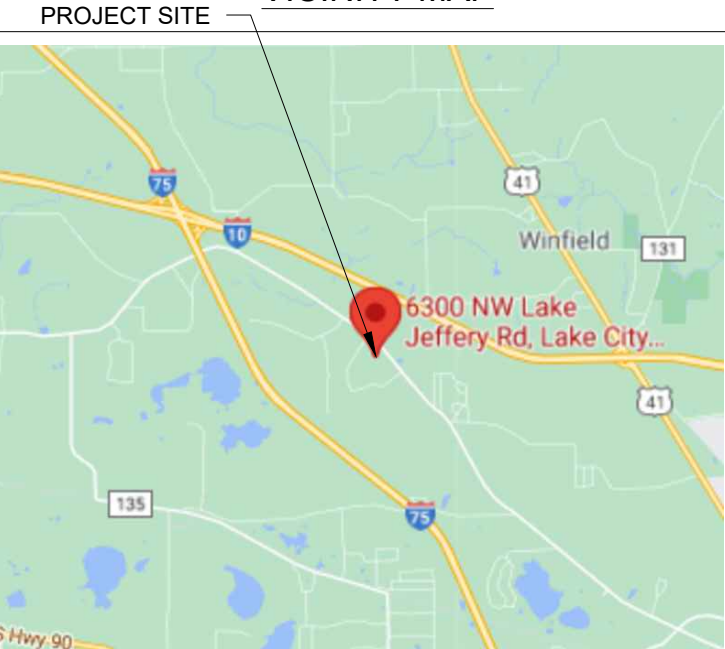

STRUCTURAL CERTIFICATION:

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL 2020 7TH ED., CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE WIND LATERAL AND UPLIFT FORCES, AND EQUIPMENT DEAD LOADS.

ELECTRICAL CERTIFICATION:

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107, THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION

Symbols:

Section.....

Sheet where section is located

Elevation .....

Detail ID Letter

Sheet where section is located

Detail .....

Detail ID Letter

Sheet where section is located

Detail .....

Detail ID Letter

Area to be enlarged

Sheet where section is located

Keyed Notes .....

1

Keyed note designation on applicable sheet

Ground Terminal .....

Grounding Point/rod....

Solar Panel .....

or 00

Module with Source Circuit number

Combiner Box .....

CB

AC Disconnect .....

ACD

Main Distribution Panel .....

MDP

Fuse .....

Overcurrent Breaker ..

Inverter .....

Transformer .....

Automatic .....

ATS

Transfer Switch

Vent, Attic fan (Roof obstruction)

PV Roof Attachment

Trusses

Conduit

Fire Access

Abbreviations:

ACD	AC Disconnect
AC	Alternating Current
APPROX	Approximate
AWG	American Wire Gauge
BAT	Tesla Powerwall
CB	Combiner Box
DC	Direct Current
DISC	Disconnect
(E)	Existing
EL	Elevation
EQ	Equal
GP	Generation Panel
JB	Junction Box
MCB	Main Combiner Box
MFR	Manufacturer
MID	Microgrid Interconnect Device
MIN	Minimum
MISC	Miscellaneous
MDP	Main Distribution Panel
(N)	New
NAVD	North American Vertical datum
OCPD	Over Current Protection Device
POCC	Point Of Common Coupling
PV	Photovoltaic
SF	Squarefoot/feet
STC	Standard Test Conditions
SD	Soladeck
TBD	To Be Determined
TYP	Typical
UNO	Unless Noted Otherwise
UM	Utility meter
VIF	Verify In Field
WP	Weather Proof

System Description

This system is a grid-tied, PV system, with PV generation consisting of 32 LG375N1C-A6 (375W) MODULES with a combined STC rated dc output power of 12,000W. The modules are connected into 32 ENPHASE IQ7PLUS-72-2-US MICROINVERTERS. The inverter has electronic maximum power point tracking to maximize energy captured by the PV modules. The inverter also has an internal ground fault detection and interruption device that is set to disconnect the array in the event that a ground fault that exceeds one ampere should occur. The inverter has DC and AC disconnect integrated system and labels are provided as required by the *National Electrical Code*

When the sun is shining, power from the PV array is fed into the inverter, where it is converted from DC to AC. The inverter output is then used to contribute to the power requirements of the occupancy. If PV power meets the requirements of the loads of the occupancy, any remaining PV power is sold back to the utility. When utility power is available, but PV power is not available, building loads are supplied by the utility.

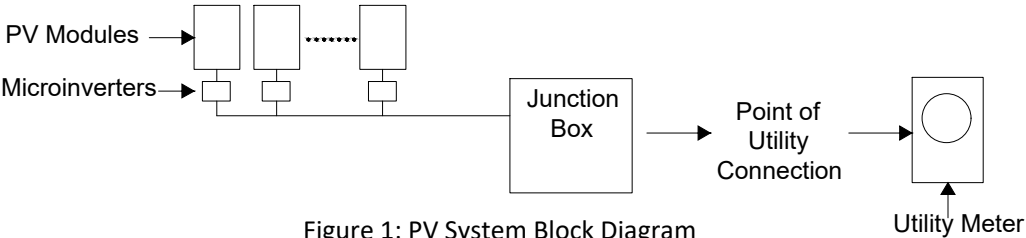


Figure 1: PV System Block Diagram


The inverter meets the requirements of IEEE 1547 and UL 1741.

**FALL PROTECTION:**  
ANCHORAGES USED FOR ATTACHMENT OF PERSONAL FALL ARREST EQUIPMENT MUST BE INDEPENDENT OF ANY ANCHORAGE BEING USED TO SUPPORT OR SUSPEND PLATFORMS, AND CAPABLE OF SUPPORTING AT LEAST 5,000 POUNDS PER EMPLOYEE ATTACHED, OR MUST BE DESIGNED AND USED AS FOLLOWS:

- AS PART OF A COMPLETE PERSONAL FALL ARREST SYSTEM WHICH MAINTAINS A SAFETY FACTOR OF AT LEAST TWO.
- UNDER THE SUPERVISION OF A QUALIFIED PERSON

**ADDITIONAL INFORMATION**

- 29 CFR 1926 SUBPART M, FALL PROTECTION. OSHA STANDARD.
- 1926.502, FALL PROTECTION SYSTEMS CRITERIA AND PRACTICES
- 1926.502(D)(15)

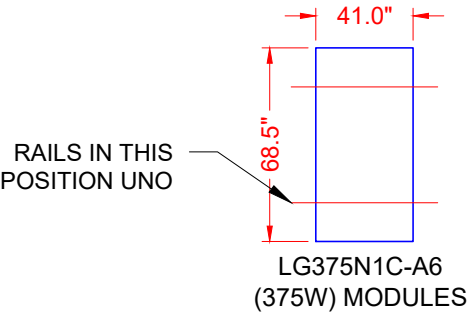

PRESSURE	PSF
DOWN PRESSURE	126
UPLIFT PRESSURE, 2 RAILS	86

**Castillo Engineering**  
SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

**SUNPRO**

Digitally Signed by:  
Ermocrates E. Castillo  
Date: 2021.07.28 17:10:44



PROJECT NAME

**OTERO RESIDENCE**  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME  
NOTES AND  
DESCRIPTION

SHEET SIZE  
**ANSI B**  
11" X 17"

SHEET NUMBER  
**A-00**

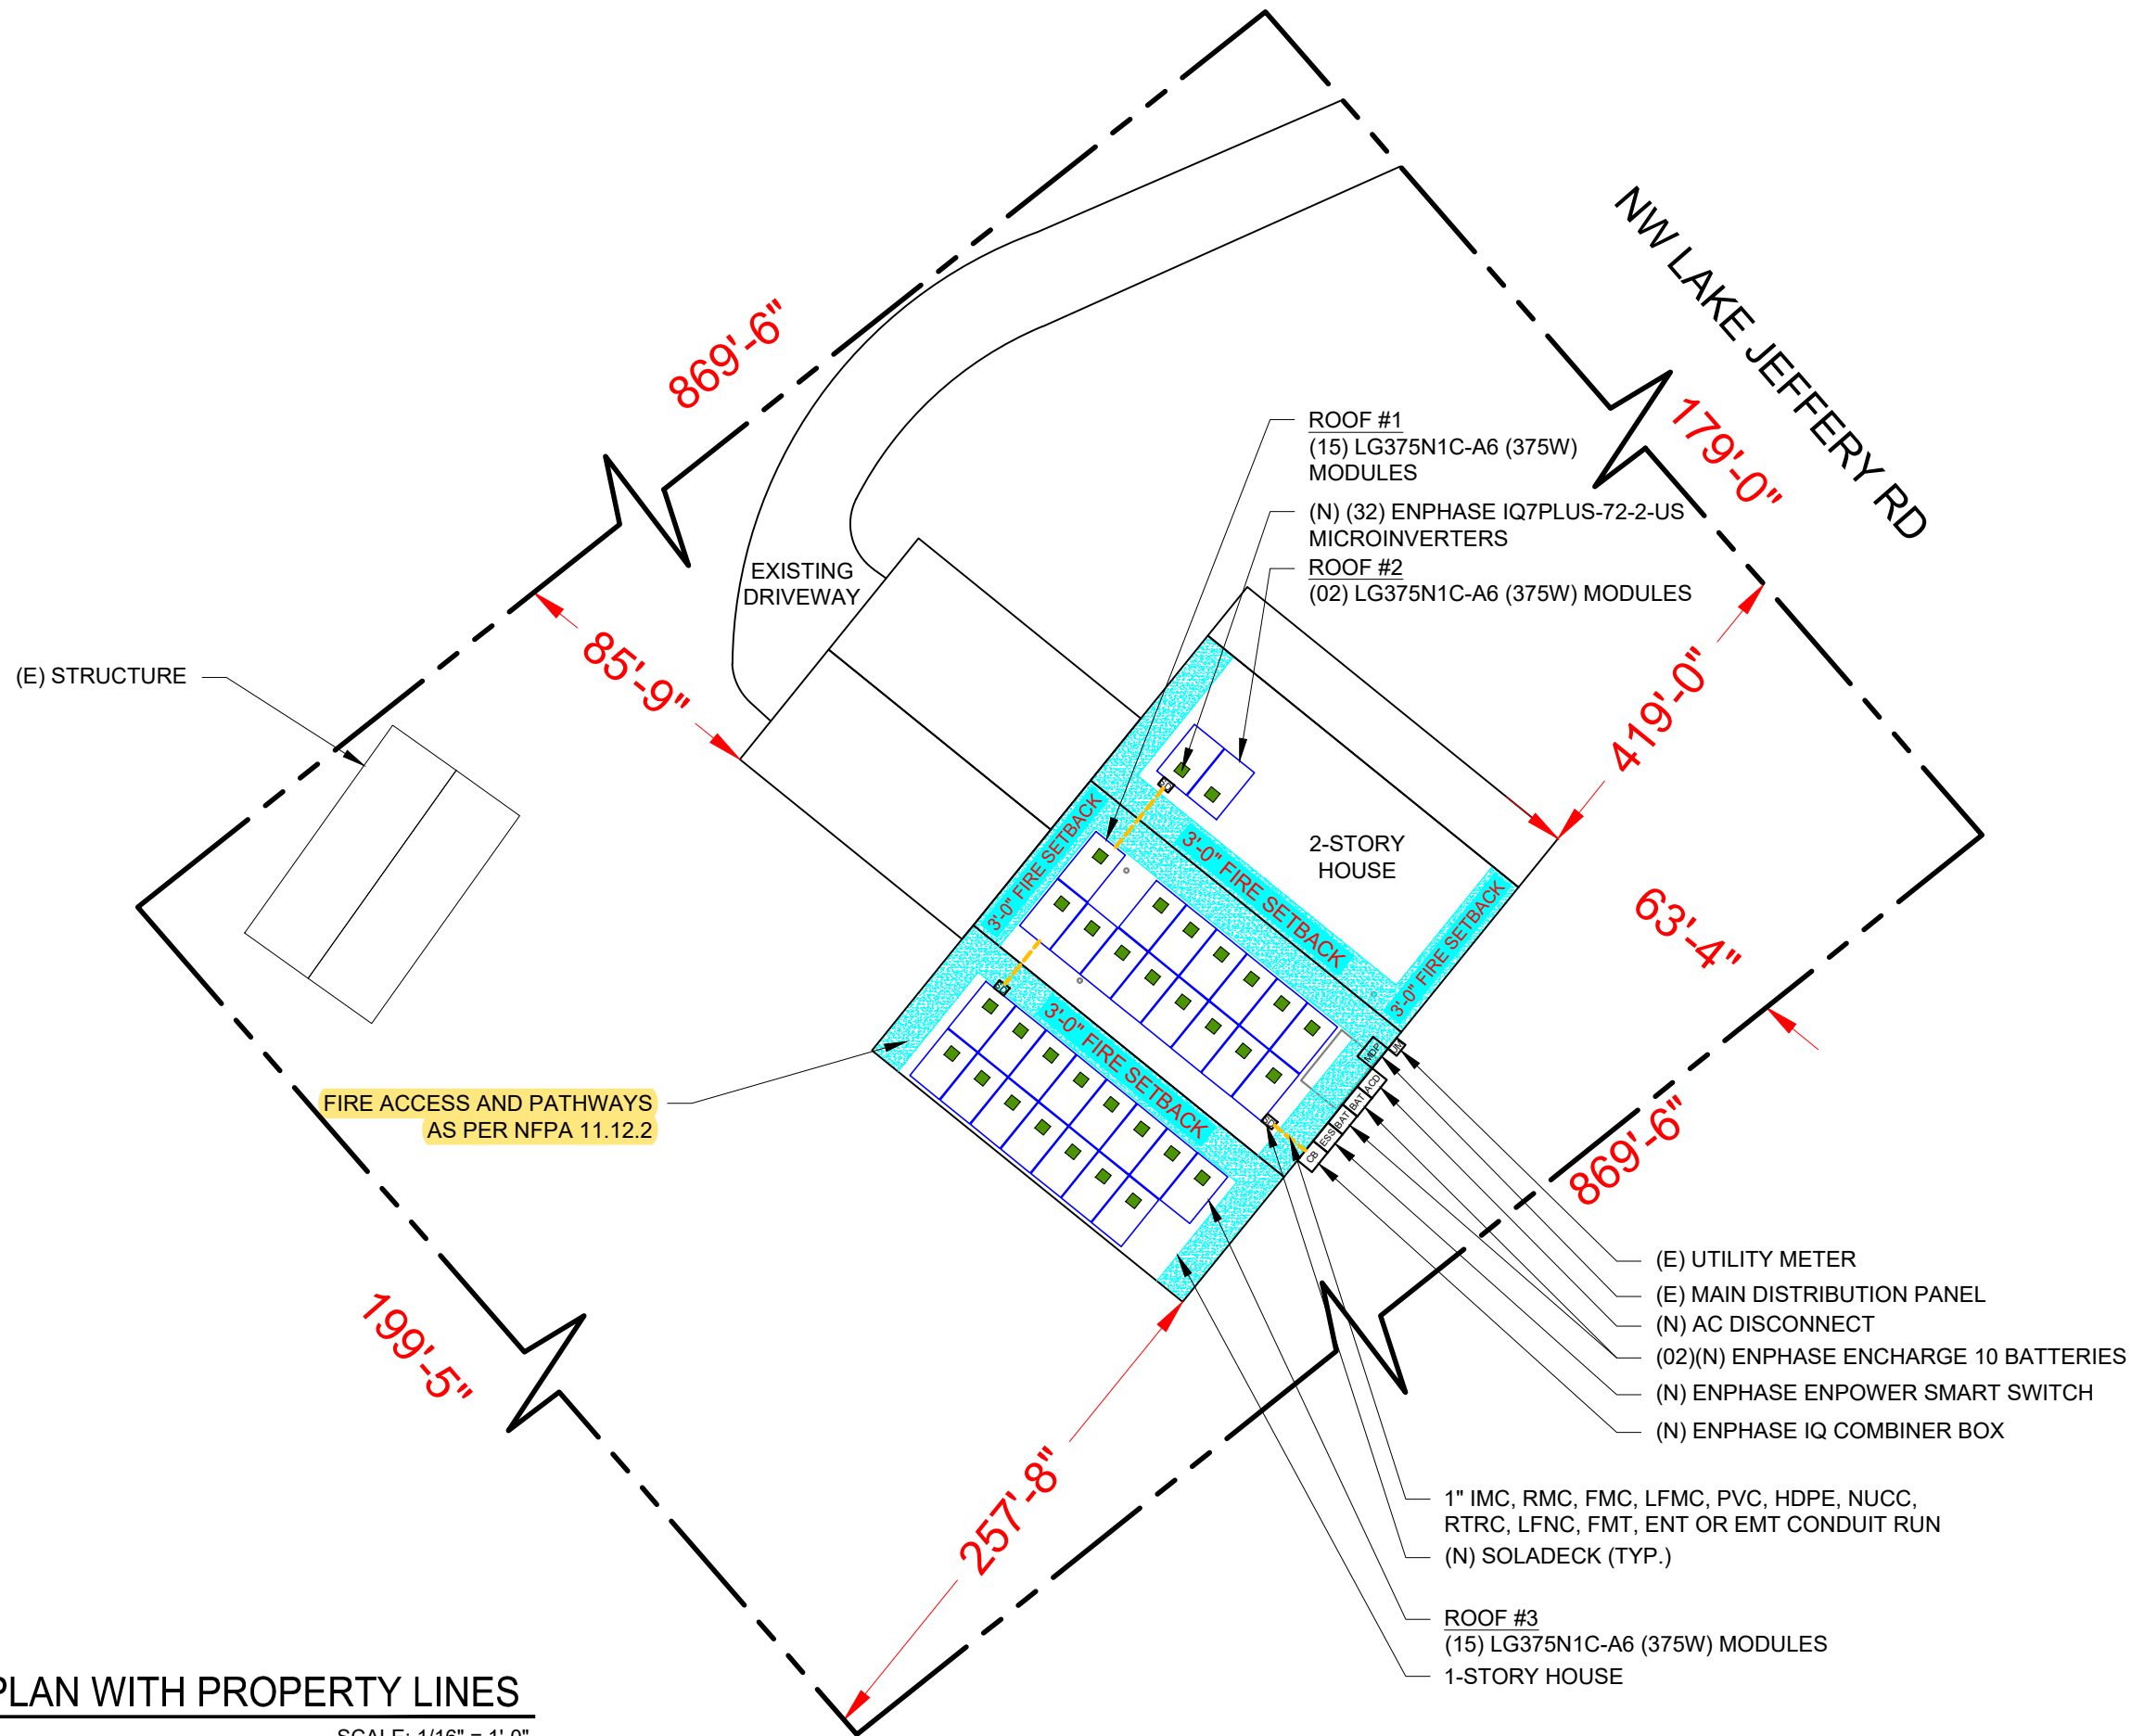

1

# ROOF PLAN WITH PROPERTY LINES

A-01

SCALE: 1/16" = 1'-0"

**Castillo Engineering**  
SOLAR DONE RIGHT®  
CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

## REVISIONS

DESCRIPTION	DATE	REV

## PROJECT INSTALLER

**SUNPRO**

Digitally signed by:  
Ermocrates E. Castillo  
Date: 2021.07.28 17:10:45

## PROJECT NAME

OTERO RESIDENCE

6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

## SHEET NAME

ROOF PLAN

## SHEET SIZE

ANSI B  
11" X 17"


## SHEET NUMBER

A-01



LEGEND


- EXPOSED MODULE
- EDGE MODULE
- NON- EXPOSED MODULE
- MISSING MODULE
- MIN. MODULE EDGE DISTANCE LINE
- MODULE EXPOSURE LINE
- WIND ZONE 1 (TYP)
- WIND ZONE 2e (TYP)
- WIND ZONE 2n (TYP)
- WIND ZONE 2r (TYP)
- WIND ZONE 3r (TYP)
- WIND ZONE 3e (TYP)



ROOF	ROOF TYPE	ARRAY AREA (Sq. Ft.)	ROOF AREA (Sq. Ft.)	ROOF AREA COVERED BY ARRAY (%)	TILT	AZIMUTH	SEAM SPACING
#1	METAL	292.50	601.54	48.63	18.4°	219°	10" O.C.
#2	METAL	39.00	601.54	6.48	18.4°	39°	10" O.C.
#3	METAL	292.50	519.29	56.33	18.4°	219°	10" O.C.

MODULE TYPE, DIMENSIONS & WEIGHT

NUMBER OF MODULES = 32 MODULES  
MODULE TYPE = LG375N1C-A6 (375W) MODULES  
WEIGHT = 41.00 LBS / 18.6 KG.  
MODULE DIMENSIONS = 68.5" x 41" = 19.50 SF  
UNIT WEIGHT OF ARRAY = 2.10 PSF

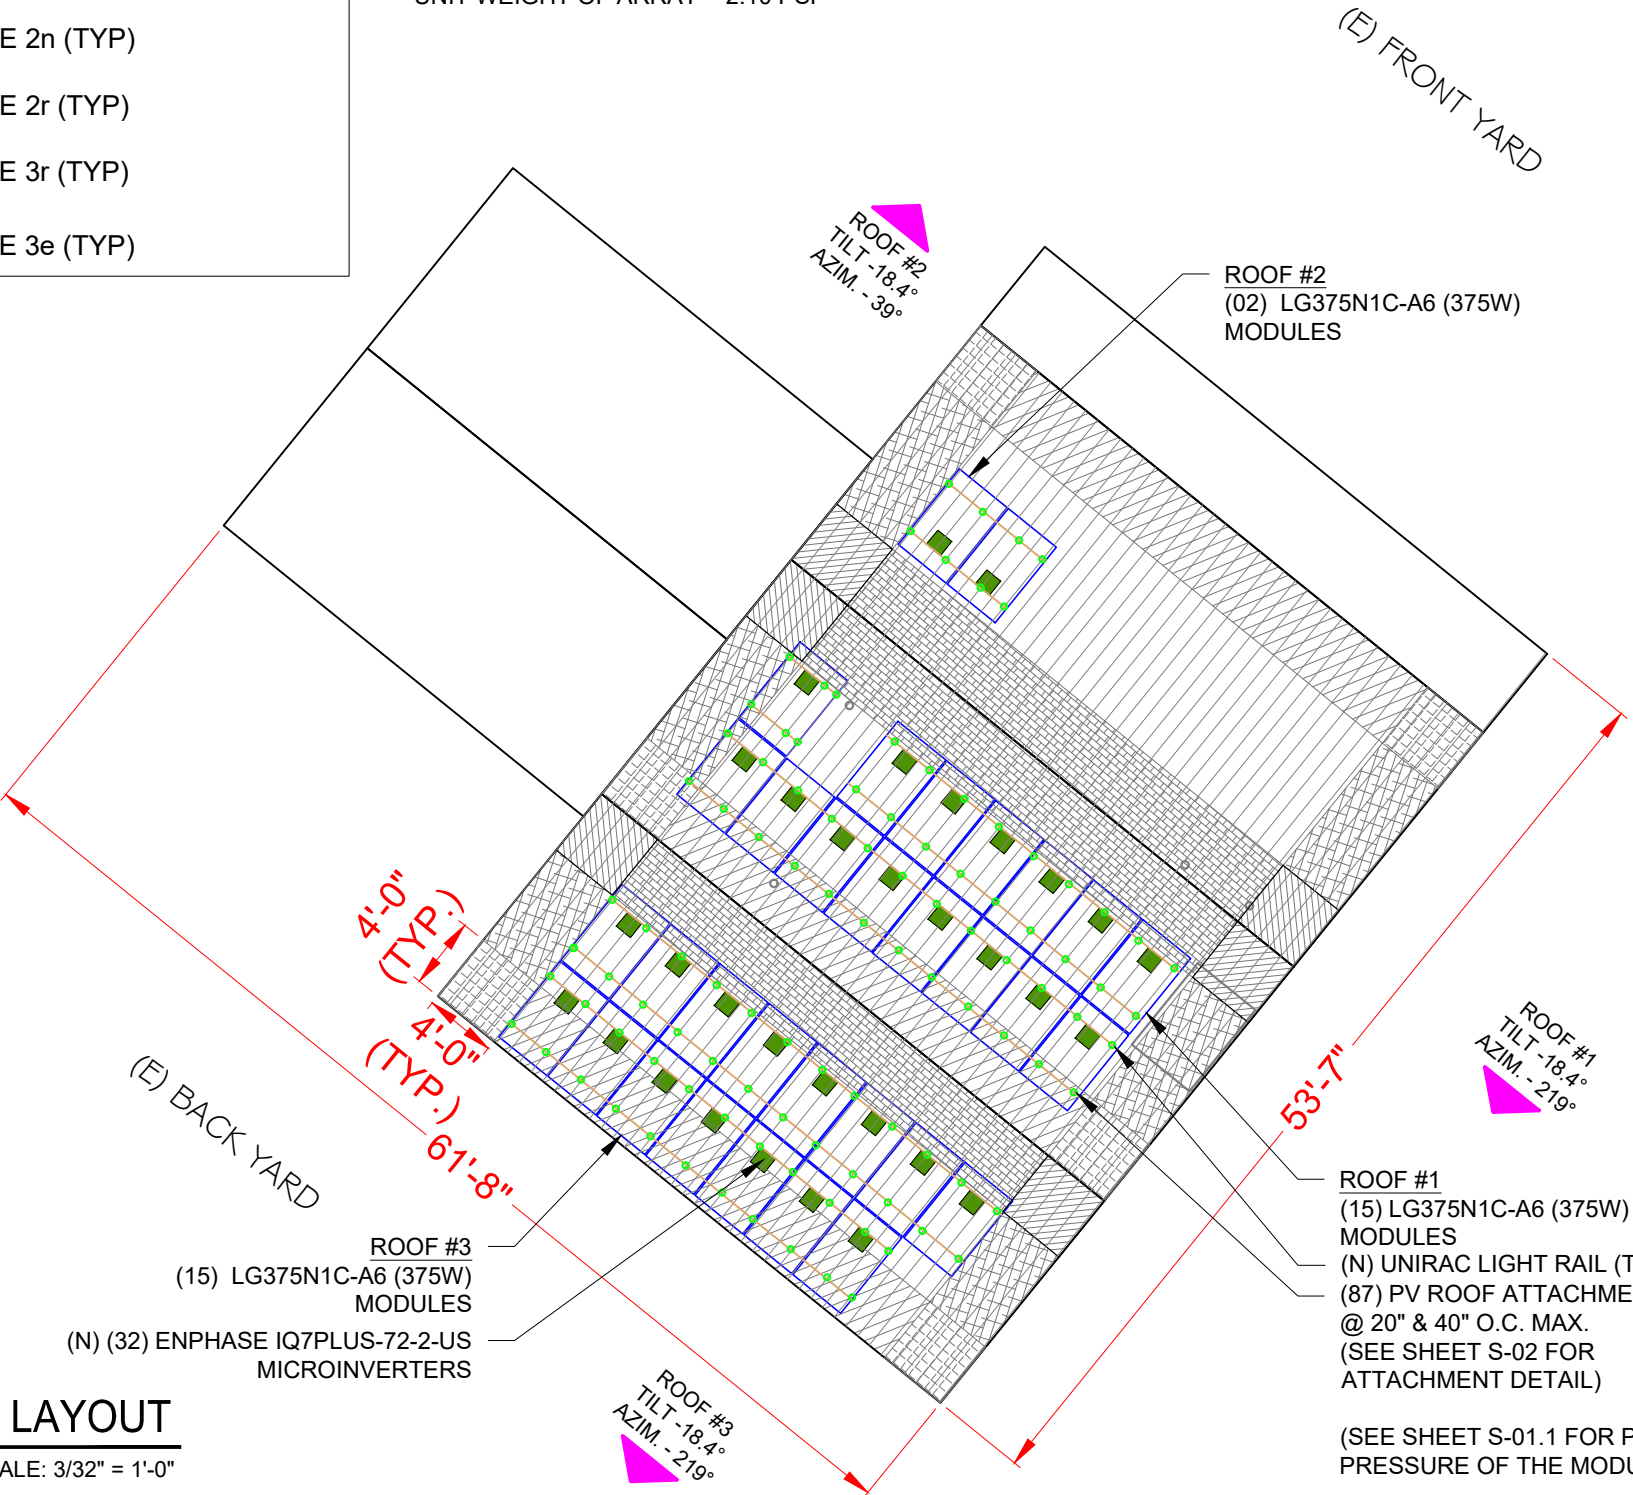

GENERAL INSTALLATION PLAN NOTES:

1) ROOF ATTACHMENTS TO SEAM SHALL BE INSTALLED AS SHOWN IN SHEET S-02 AND AS FOLLOWS FOR EACH WIND ZONE:

FOR ROOF 3 :

WIND ZONES	NON - EXPOSED MODULES		EDGE / EXPOSED MODULES	
	SPAN	CANTILEVER	SPAN	CANTILEVER
ZONE 1	30"	13"	30"	13"
ZONE 1'	X	X	X	X
ZONE 2e	30"	13"	30"	13"
ZONE 2n	30"	13"	30"	7"
ZONE 2r	30"	13"	30"	7"
ZONE 3e	30"	13"	30"	7"
ZONE 3r	30"	7"	30"	7"

FOR ROOF 1 & 2 :

WIND ZONES	NON - EXPOSED MODULES		EDGE / EXPOSED MODULES	
	SPAN	CANTILEVER	SPAN	CANTILEVER
ZONE 1	30"	13"	30"	7"
ZONE 1'	X	X	X	X
ZONE 2e	30"	13"	30"	7"
ZONE 2n	30"	13"	30"	7"
ZONE 2r	30"	13"	30"	7"
ZONE 3e	30"	13"	30"	7"
ZONE 3r	30"	7"	30"	7"

SEE SHEET S-02.1 FOR SUPPORTING CALCULATIONS.

2) EXISTING RESIDENTIAL BUILDING IS A METAL ROOF WITH MEAN ROOF HEIGHT IS 15 FT & 25 FT AND SEAM SPACED 10" O.C. EXISTING ROOF SLOPE FOR SOLAR SYSTEM RETROFIT IS 18.4 DEGREES. CONTRACTOR TO FIELD VERIFY AND SHALL REPORT TO THE ENGINEER IF ANY DISCREPANCIES EXIST BETWEEN PLANS AND IN FIELD CONDITIONS.

3) FIRE SETBACK TO BE 3' FROM RIDGE AND EDGES, AND 18" EACH WAY FROM HIPS AND VALLEYS PER NFPA 11.12.2.

\* I CERTIFY THAT THE INSTALLATION OF THE MODULES IS IN COMPLIANCE WITH FBC: RESIDENTIAL 2020 7TH ED. CHAPTER 3. BUILDING STRUCTURE WILL SAFELY ACCOMMODATE LATERAL AND UPLIFT WIND LOADS AND EQUIPMENT DEAD LOADS. \*



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



Digitally Signed by:  
Ermocrates E. Castillo  
Date: 2021.07.28 17:10:45

PROJECT NAME

OTERO RESIDENCE  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME

MODULE LAYOUT

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

S-01

1 MODULE LAYOUT

S-01 SCALE: 3/32" = 1'-0"

FOR ROOF 1 & 2 :

	1	1'	2e	2n	2r	3e	3r	
	26.60	0.00	26.60	33.40	33.40	33.40	39.40	
			Module Size		19.5	Sqft.		
Non-Exposed modules								Partial Pressure
P4	14.50	0.00	5.00	0.00	0.00	0.00	0.00	26.60
P5	11.33	0.00	3.91	3.16	0.00	1.09	0.00	28.08
P6	13.13	0.00	0.00	3.66	2.12	0.00	0.59	29.00
P7	16.79	0.00	0.00	0.00	2.71	0.00	0.00	27.55

ALLOWABLE MODULE UPLIFT PRESSURE 2 RAILS: 86 PSF

FOR ROOF 3 :

	1	1'	2e	2n	2r	3e	3r	
	23.90	0.00	23.90	30.00	30.00	30.00	35.40	
			Module Size		19.5	Sqft.		
Non-Exposed modules								Partial Pressure
P2	16.57	0.00	0.00	0.00	2.93	0.00	0.00	24.82
P3	16.28	0.00	0.00	0.30	2.87	0.00	0.05	24.92
			Module Size		19.5	Sqft.		
Edge Modules modules								Partial Pressure
P1	6.44	0.00	13.06	0.00	0.00	0.00	0.00	35.90


ALLOWABLE MODULE UPLIFT PRESSURE 2 RAILS: 86 PSF

NOTE : PARTIAL PRESSURES OF THE WIND ZONES ON ALL MODULES HAVE BEEN VERIFIED AND ARE WITHIN THE ALLOWABLE PER THE MANUFACTURER SPECIFICATION, INSTALLER SHOULD FOLLOW THE LAYOUT TO AVOID HIGHER ZONAL PARTIAL PRESSURES. ANY CHANGES IN LAYOUT SHOULD BE REPORTED BACK TO THE ENGINEER OF RECORD.

2h<sub>2</sub> DISTANCE : 0'-12"  
0.5h DISTANCE : 7'-6" & 12'-6"

LEGEND

- EDGE MODULE
- EXPOSED MODULE
- NON- EXPOSED MODULE
- MISSING MODULE
- MIN. MODULE EDGE DISTANCE LINE
- MODULE EXPOSURE LINE
- WIND ZONE 1' (TYP)
- WIND ZONE 1 (TYP)
- WIND ZONE 2e (TYP)
- WIND ZONE 2n (TYP)
- WIND ZONE 2r (TYP)
- WIND ZONE 3r (TYP)
- WIND ZONE 3e (TYP)

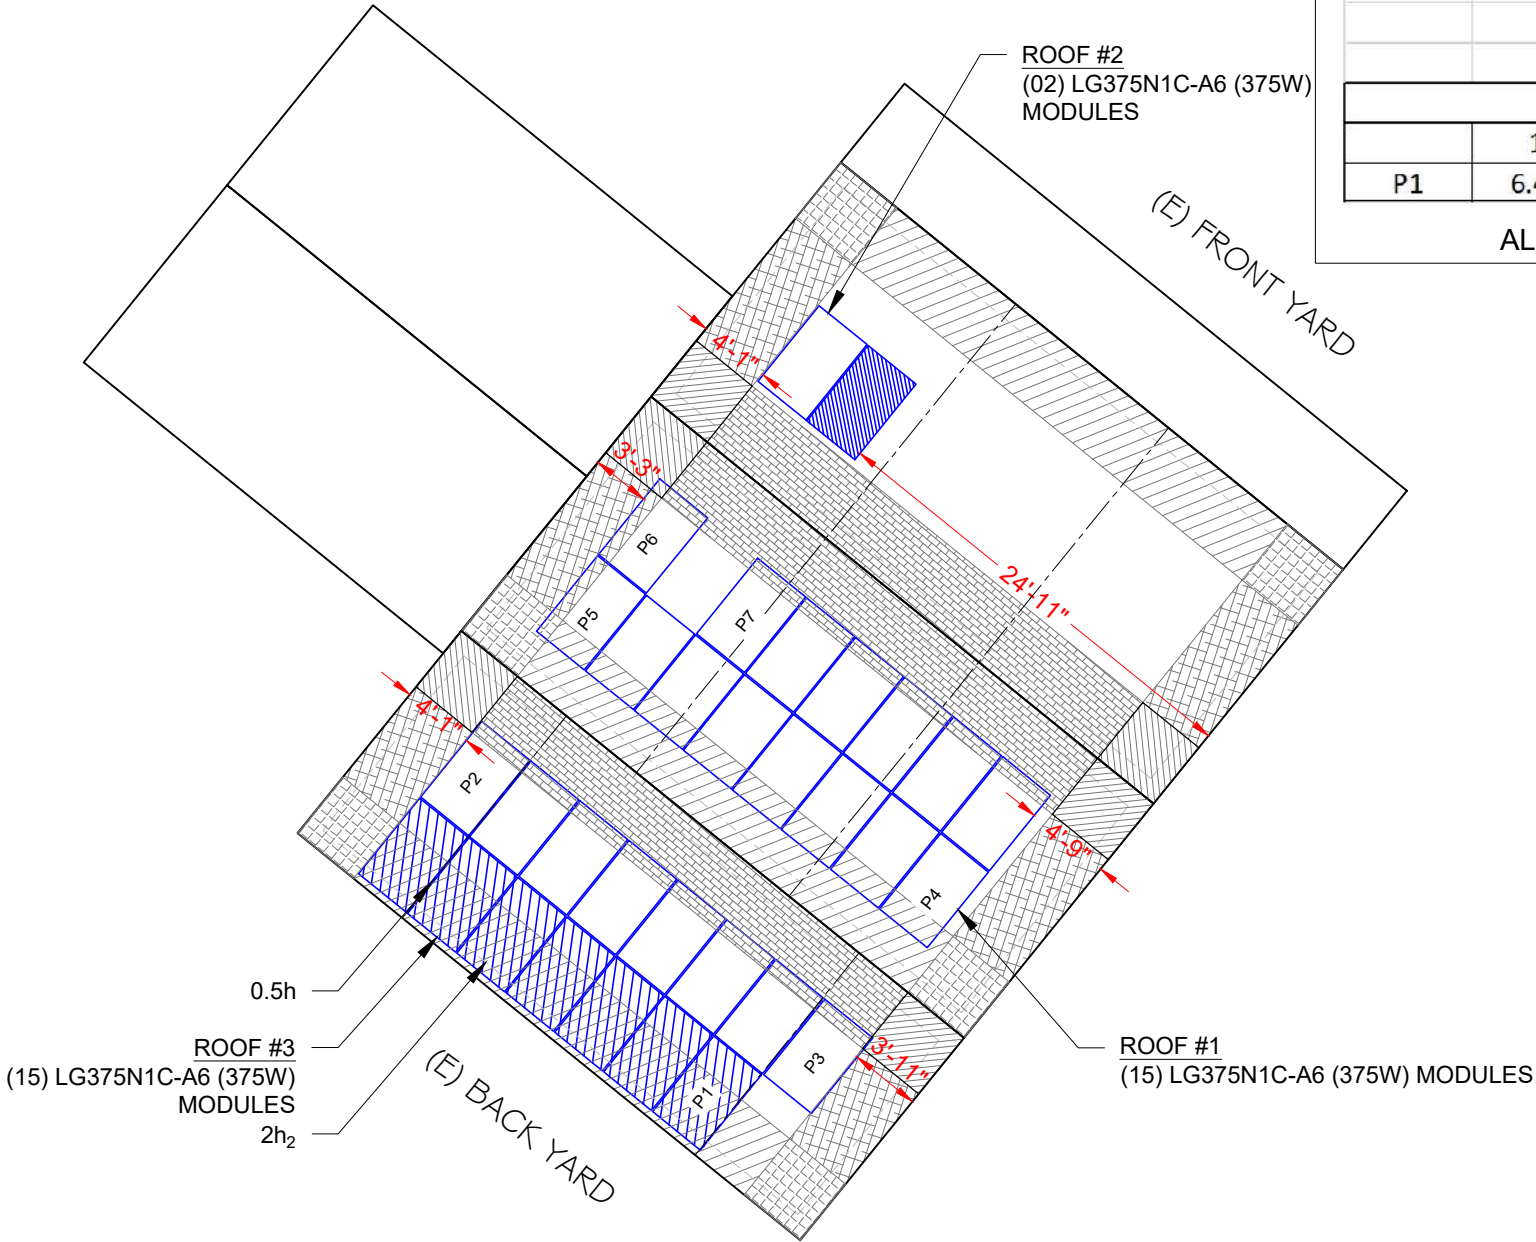

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Digitally signed by:  
Ermocrates E Castillo  
Date: 2021.07.28 17:10:46

PROJECT NAME


OTERO RESIDENCE  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME  
PARTIAL PRESSURE AND  
MODULES EXPOSURE

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
S-01.1



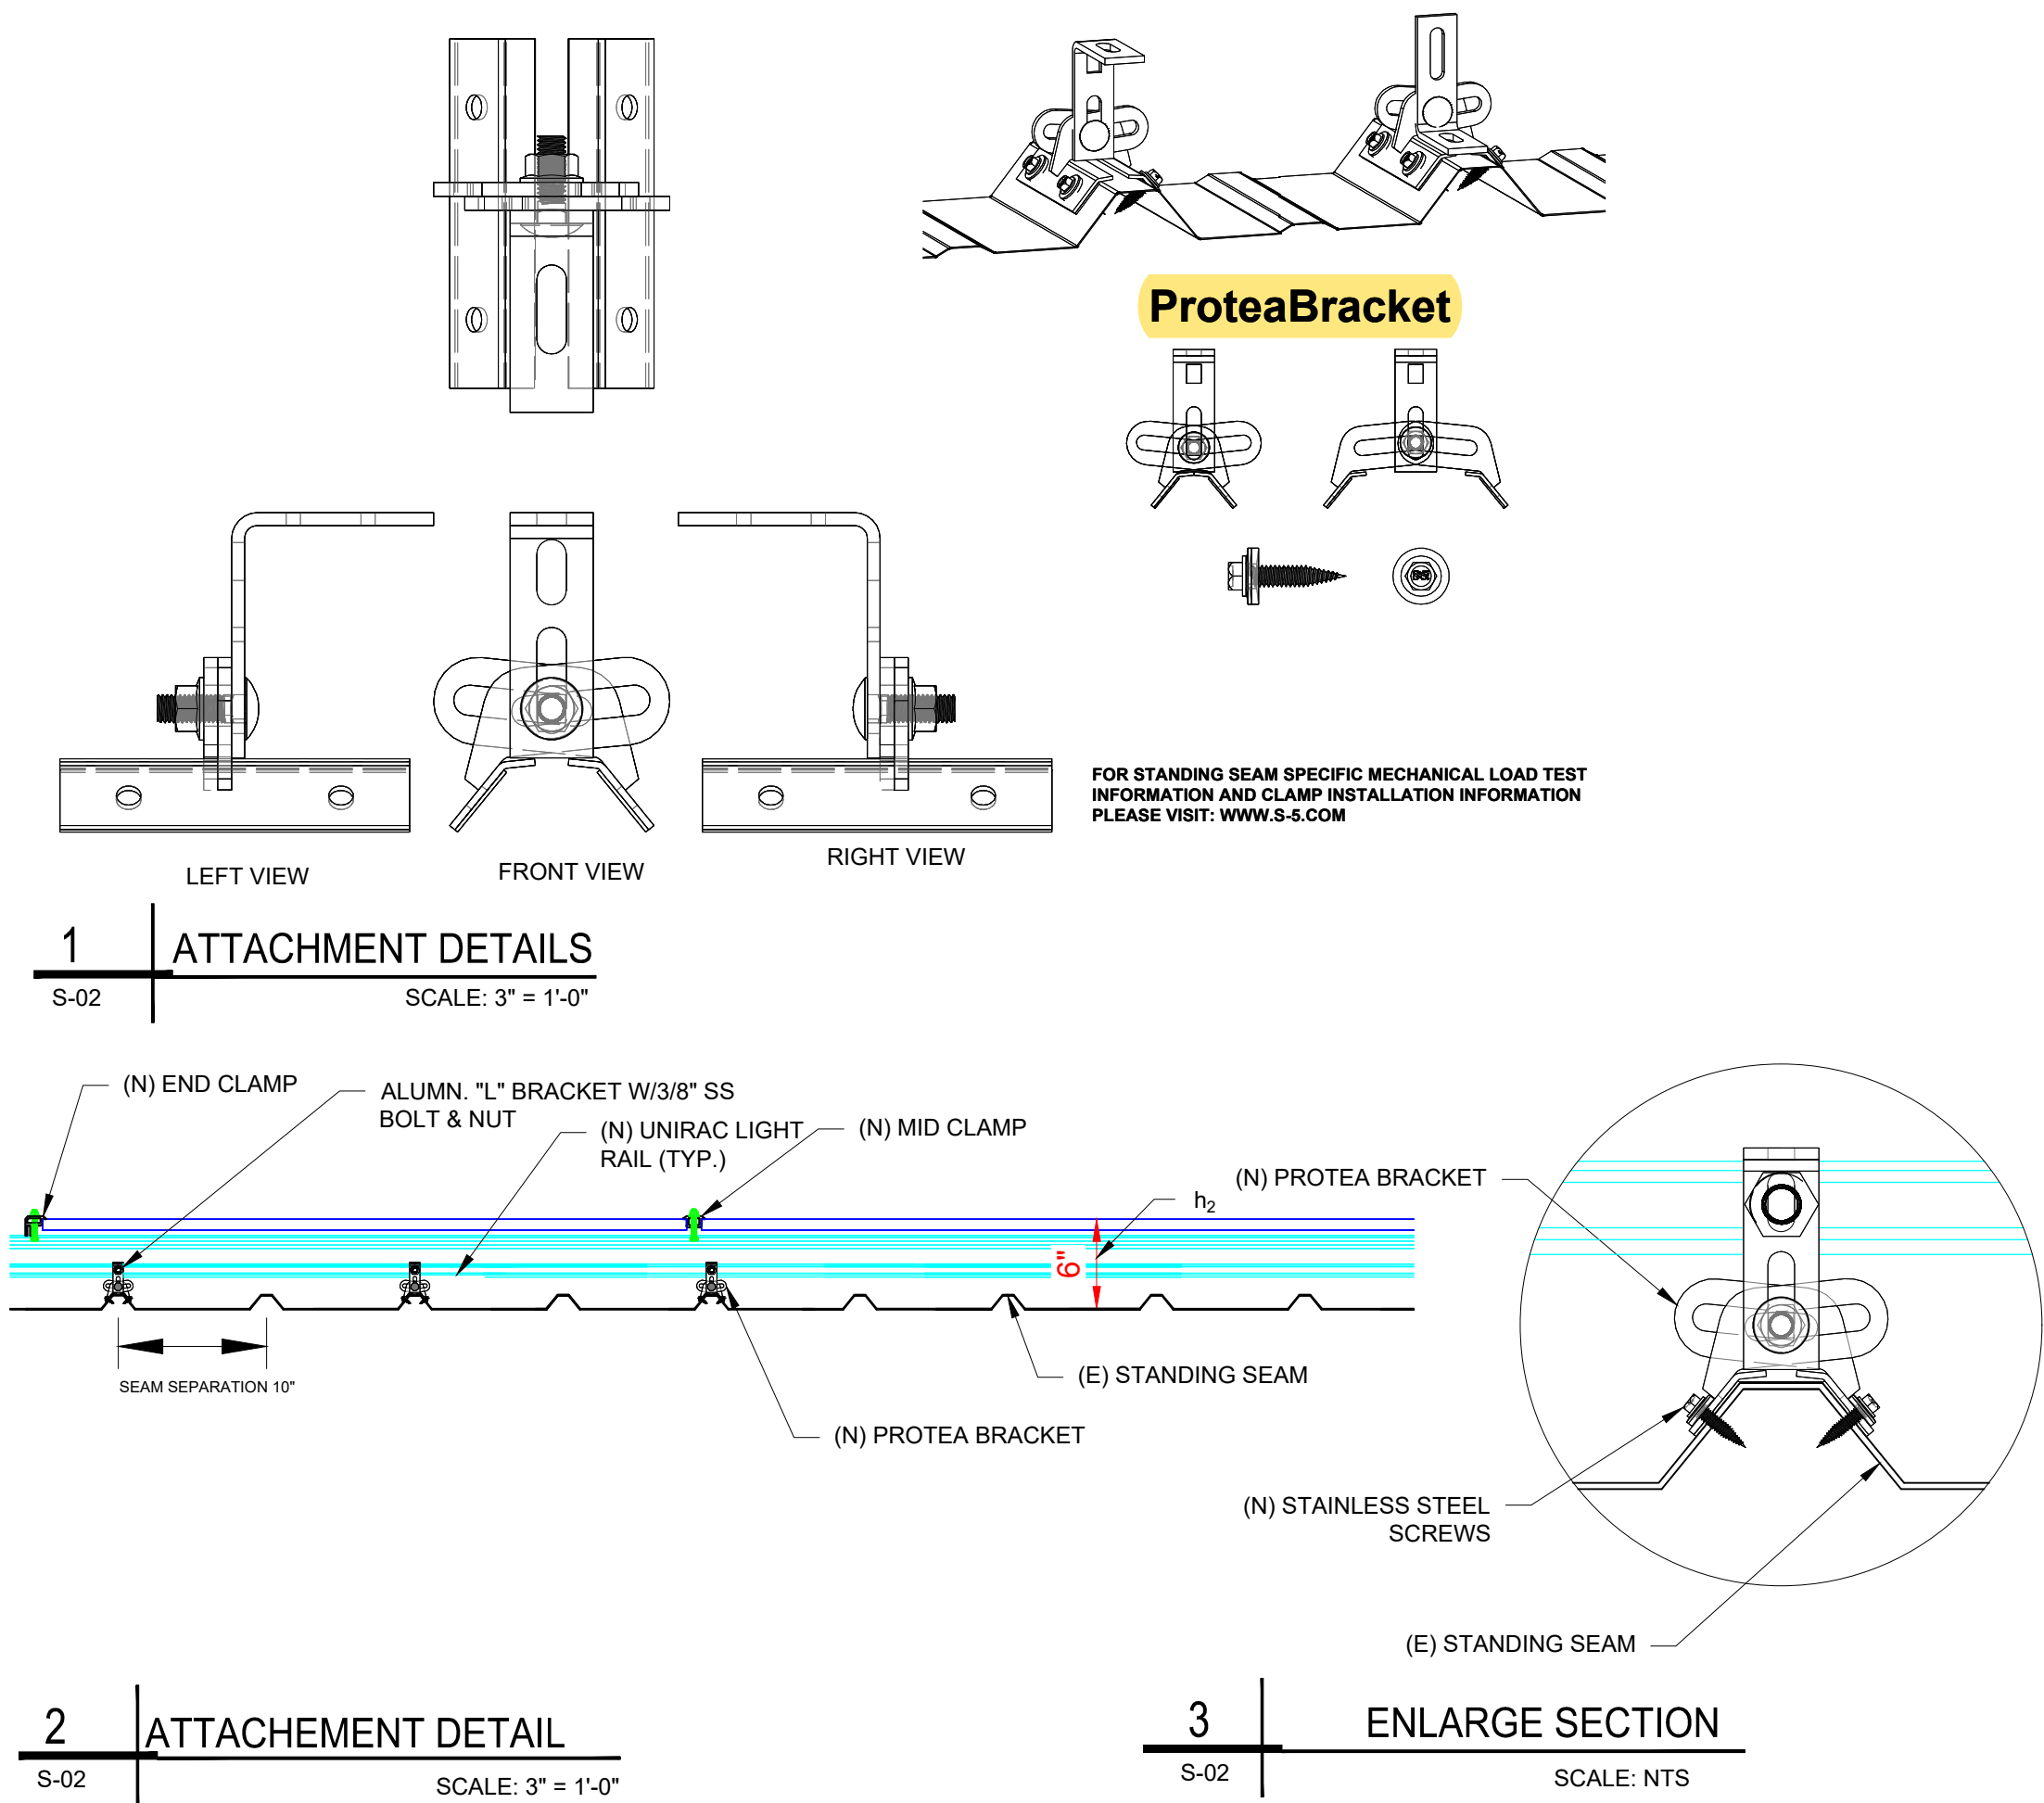

Castillo

Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250,

MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER



State of Florida  
Professional Engineer  
ERMOCRATES E. CASTILLO  
No. 52590

Digitally  
signed by:  
Ermocrates  
E Castillo  
Date:  
2021.07.28  
17:10:47

PROJECT NAME

OTERO RESIDENCE  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME  
ATTACHMENT DETAIL

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
S-02

## WIND LOAD CALCULATIONS FOR MODULES INSTALLED ON ROOFS WITH A HEIGHT LESS THAN 60'

SITE INFORMATION			
FBC VERSION	2020	RISK CATEGORY	II
MEAN ROOF HEIGHT (ft)	25.0	EXPOSURE CATEGORY	C
ROOF LENGTH (ft)	61.0	ROOF SLOPE	4 / 12
ROOF WIDTH (ft)	54.0	ROOF SLOPE (°)	18.4
PARAPET HEIGHT (ft)	0.0	ROOF TYPE	GABLE
MODULE LENGTH (in)	68.5	ULTIMATE WIND SPEED	120 mph
MODULE WIDTH (in)	41.02	NOMINAL WIND SPEED	93 mph
MODULE ORIENTATION	PORTRAIT	EXPOSURE FACTOR (C <sub>e</sub> )	1.000
MODULE AREA (sq. ft.)	19.51	TEMPERATURE FACTOR (C <sub>t</sub> )	1.000
GROUND SNOW LOAD (psf)	0.0	IMPORTANCE FACTOR (I <sub>s</sub> )	1.000
DEAD LOAD (psf)	3.0	SLOPE FACTOR (C <sub>s</sub> )	0.910
SLOPED ROOF SNOW LOAD (psf)	0.0	K <sub>D</sub>	0.850
EFFECTIVE WIND AREA (ft <sup>2</sup> )	19.5	K <sub>ZT</sub>	1.000
GROUND ELEVATION (ft)	152.0	K <sub>e</sub>	0.995
HVHZ	NO	K <sub>c</sub>	0.945

DESIGN CALCULATIONS			
VELOCITY PRESSURE (q) = .00256*K <sub>e</sub> K <sub>ZT</sub> K <sub>c</sub> V <sub>0</sub> <sup>2</sup>			
VELOCITY PRESSURE(ASD) 17.7 psf			
WIDTH OF PRESSURE COEFFICIENT	54'* 10%	=	5.4'
	25'* 40%	=	10'
ZONE WIDTH A 4 FT			
ZONE 2 WIDTH N/A (FOR (°) < 7°)			
ZONE 3 WIDTH N/A (FOR (°) < 7°)			
EXTERNAL PRESSURE COEFFICIENT	ZONE 1	0.467	-2.023
	ZONE 1'	X	X
	ZONE 2e	0.467	-2.023
	ZONE 2n	0.467	-2.585
	ZONE 2r	0.467	-2.585
	ZONE 3e	0.467	-2.585
	ZONE 3r	0.467	-3.077
INTERNAL PRESSURE COEFFICIENT (+/-) 0.18			

DESIGN PRESSURES					
ROOF ZONE	DOWN	UP			
1	16.0	-38.9	psf		
1'	X	X	psf		
2e	16.0	-38.9	psf	Module allowable uplift pressure	86 psf
2n	16.0	-48.9	psf	Module allowable down pressure	126 psf
2r	16.0	-48.9	psf		
3e	16.0	-48.9	psf		
3r	16.0	-57.6	psf		

ARRAY FACTORS			
ARRAY EDGE FACTOR (EXPOSED)	1.5	SOLAR PANEL PRESSURE	
ARRAY EDGE FACTOR (NON EXPOSED)	1	EQUALIZATION FACTOR	0.6839

ADJUSTED DESIGN PRESSURES				
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)	
1	16.0	-39.9	-26.6	psf
1'	X	X	X	psf
2e	16.0	-39.9	-26.6	psf
2n	16.0	-50.1	-33.4	psf
2r	16.0	-50.1	-33.4	psf
3e	16.0	-50.1	-33.4	psf
3r	16.0	-59.1	-39.4	psf

ATTACHMENTS USED		
ATTACHMENT MODEL	S-5 protea	
ATTACHMENT STRENGTH	422	lbs

MAX DESIGN LOADS ALLOWABLE						
LIMIT MAX SPAN TO		N/A	in			
RAFTER/SEAM SPACING		10	in	NO. OF RAILS	Exposed: 2	Non. Exp: 2
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)	SPANS (E)		SPANS (N.E)
1	114.2	285.0	190.0	lbs	30 in	30 in
1'	X	X	X	lbs	X in	X in
2e	114.2	285.0	190.0	lbs	30 in	30 in
2n	114.2	357.7	238.4	lbs	30 in	30 in
2r	114.2	357.7	238.4	lbs	30 in	30 in
3e	114.2	357.7	238.4	lbs	30 in	30 in
3r	114.2	421.4	280.9	lbs	30 in	30 in

## WIND LOAD CALCULATIONS FOR MODULES INSTALLED ON ROOFS WITH A HEIGHT LESS THAN 60'

SITE INFORMATION			
FBC VERSION	2020	RISK CATEGORY	II
MEAN ROOF HEIGHT (ft)	25.0	EXPOSURE CATEGORY	C
ROOF LENGTH (ft)	61.0	ROOF SLOPE	4 / 12
ROOF WIDTH (ft)	54.0	ROOF SLOPE (°)	18.4
PARAPET HEIGHT (ft)	0.0	ROOF TYPE	GABLE
MODULE LENGTH (in)	68.5	ULTIMATE WIND SPEED	120 mph
MODULE WIDTH (in)	41.02	NOMINAL WIND SPEED	93 mph
MODULE ORIENTATION	PORTRAIT	EXPOSURE FACTOR (C <sub>e</sub> )	1.000
MODULE AREA (sq. ft.)	19.51	TEMPERATURE FACTOR (C <sub>t</sub> )	1.000
GROUND SNOW LOAD (psf)	0.0	IMPORTANCE FACTOR (I <sub>s</sub> )	1.000
DEAD LOAD (psf)	3.0	SLOPE FACTOR (C <sub>s</sub> )	0.910
SLOPED ROOF SNOW LOAD (psf)	0.0	K <sub>D</sub>	0.850
EFFECTIVE WIND AREA (ft <sup>2</sup> )	19.5	K <sub>ZT</sub>	1.000
GROUND ELEVATION (ft)	152.0	K <sub>e</sub>	0.995
HVHZ	NO	K <sub>c</sub>	0.945

DESIGN CALCULATIONS			
VELOCITY PRESSURE (q) = .00256*K <sub>e</sub> K <sub>ZT</sub> K <sub>c</sub> V <sub>0</sub> <sup>2</sup>			
VELOCITY PRESSURE(ASD) 17.7 psf			
WIDTH OF PRESSURE COEFFICIENT	54'* 10%	=	5.4'
	25'* 40%	=	10'
ZONE WIDTH A 4 FT			
ZONE 2 WIDTH N/A (FOR (°) < 7°)			
ZONE 3 WIDTH N/A (FOR (°) < 7°)			
EXTERNAL PRESSURE COEFFICIENT	ZONE 1	0.467	-2.023
	ZONE 1'	X	X
	ZONE 2e	0.467	-2.023
	ZONE 2n	0.467	-2.585
	ZONE 2r	0.467	-2.585
	ZONE 3e	0.467	-2.585
	ZONE 3r	0.467	-3.077
INTERNAL PRESSURE COEFFICIENT (+/-) 0.18			

DESIGN PRESSURES					
ROOF ZONE	DOWN	UP			
1	16.0	-38.9	psf		
1'	X	X	psf		
2e	16.0	-38.9	psf	Module allowable uplift pressure	86 psf
2n	16.0	-48.9	psf	Module allowable down pressure	126 psf
2r	16.0	-48.9	psf		
3e	16.0	-48.9	psf		
3r	16.0	-57.6	psf		

ARRAY FACTORS			
ARRAY EDGE FACTOR (EXPOSED)	1.5	SOLAR PANEL PRESSURE	
ARRAY EDGE FACTOR (NON-EXPOSED)	1	EQUALIZATION FACTOR	0.6839

ADJUSTED DESIGN PRESSURES				
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)	
1	16.0	-39.9	-26.6	psf
1'	X	X	X	psf
2e	16.0	-39.9	-26.6	psf
2n	16.0	-50.1	-33.4	psf
2r	16.0	-50.1	-33.4	psf
3e	16.0	-50.1	-33.4	psf
3r	16.0	-59.1	-39.4	psf

ATTACHMENTS USED		
ATTACHMENT MODEL	S-5 protea	
ATTACHMENT STRENGTH	422	lbs

MAX DESIGN LOADS ALLOWABLE						
LIMIT MAX SPAN TO		N/A	in			
RAFTER/SEAM SPACING		10	in	NO. OF RAILS	Exposed: 2	Non. Exp: 2
ROOF ZONE	DOWN	UP (Exposed)	UP (N. Exposed)	SPANS (E)		SPANS (N.E)
1	114.2	285.0	190.0	lbs	30 in	30 in
1'	X	X	X	lbs	X in	X in
2e	114.2	285.0	190.0	lbs	30 in	30 in
2n	114.2	357.7	238.4	lbs	30 in	30 in
2r	114.2	357.7	238.4	lbs	30 in	30 in
3e	114.2	357.7	238.4	lbs	30 in	30 in
3r	114.2	421.4	280.9	lbs	30 in	30 in

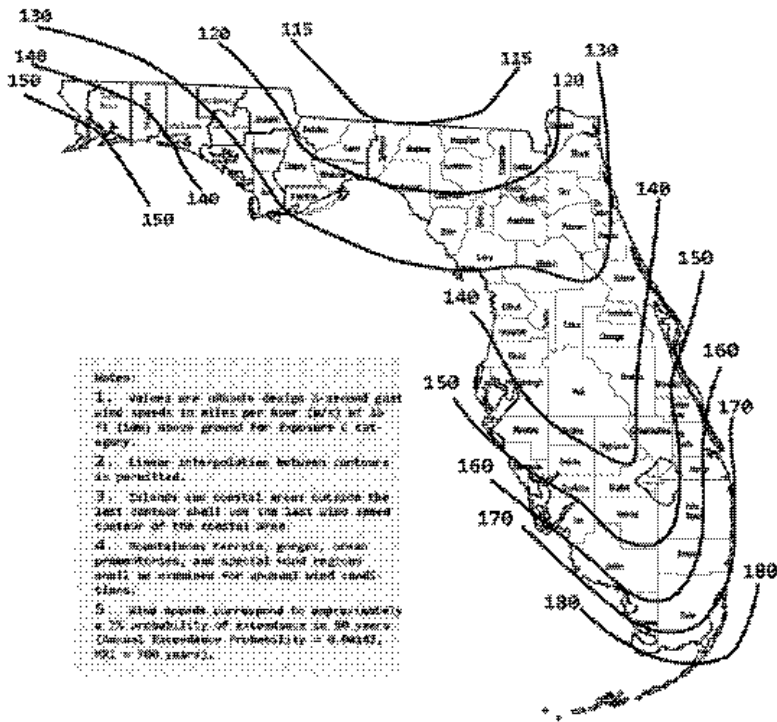


FIGURE 1609.3(1)

ULTIMATE DESIGN WIND SPEEDS, V<sub>ULT</sub>, FOR RISK CATEGORY II BUILDINGS AND OTHER STRUCTURES

## REVISIONS

DESCRIPTION	DATE	REV

## PROJECT INSTALLER

## PROJECT NAME

## SHEET NAME

STRUCTURE  
CALCULATION

## SHEET SIZE

ANSI B  
11" X 17"

## SHEET NUMBER

## S-02.1







AC CONDUCTOR AMPACITY CALCULATIONS:  
FROM ROOF TOP SOLADECK TO COMBINER BOX

MODULE MANUFACTURER	LG
MODULE MODEL	LG375N1C-A6
INVERTER MANUFACTURER	ENPHASE
INVERTER MODEL	ENPHASE IQ 7 PLUS
MODULES/BRANCH CIRCUIT 1	11
MODULES/BRANCH CIRCUIT 2	11
MODULES/BRANCH CIRCUIT 3	10
TOTAL ARRAY POWER (KW)	12.00
SYSTEM AC VOLTAGE	240V 1-PHASE

DESIGN TEMPERATURE	
MIN. AMBIENT TEMP. °F	32
MAX. AMBIENT TEMP. °F	117
CALCULATED MAX. VDD	45
CALCULATED MIN VMP	28
CONDUIT FILL	
NUMBER OF CONDUITS	1

AMPACITY CALCULATIONS										
CIRCUIT	MAX AMPS	1.25 X MAX AMPS	AWG	90 °C AMPACITY	AMBIENT TEMP °F	TEMP DERATE	CONDUIT FILL	FILL DERATE	DERATED AMPACITY	MAXIMUM CIRCUIT BREAKER
CIRCUIT 1	13.3	16.6	#12	30	95	0.96	6	0.8	23.04	20 A
CIRCUIT 2	13.3	16.6	#12	30	95	0.96	6	0.8	23.04	20 A
AC COMBINER PANEL OUTPUT	38.7	48.3	#6	75	95	0.96	3	1	72	50 A

MAXIMUM CIRCUIT VOLTAGE DROP	2%
------------------------------	----

VOLTAGE DROP CALCULATIONS					
CIRCUIT	AWG	CIRCULAR MILLS	I	V	MAX LENGTH
CIRCUIT 1	#12	6530	13.3	240	91 FEET
CIRCUIT 2	#12	6530	13.3	240	91 FEET
CIRCUIT 3	#12	6530	12.1	240	101 FEET
COMBINER PANEL OUTPUT	#6	26240	38.7	240	126 FEET

NOTES	
TEMP DERATE BASED ON NEC TABLE 310.15(B)(2)(A)	
CONDUIT FILL DERATE BASED ON NEC TABLE 310.15(B)(3)(A)	
MAXIMUM VDD CALCULATED USING MODULE MANUFACTURE TEMPERATURE COEFFICIENTS PER NEC 690.7(A)	
UNLESS OTHERWISE SPECIFIED, ALL WIRING MUST BE THHN OR THWN-2 COPPER	
ALL WIRE SIZES LISTED ARE THE MINIMUM ALLOWABLE	
	IN ANY CELL INDICATES THAT THE SYSTEM IS SAFE AND COMPLIES WITH NEC REQUIREMENTS
	IN ANY CELL INDICATES A POTENTIALLY UNSAFE CONDITION
	INFORMATION INPUT BY SYSTEM DESIGNER
	INFORMATON OBTAINED FROM MANUFACTURER DATASHEETS

I ERMOCRATES CASTILLO PE# 52590 AN ENGINEER LICENSED PURSUANT TO CHAPTER 471, CERTIFY THAT THE PV ELECTRICAL SYSTEM AND ELECTRICAL COMPONENTS ARE DESIGNED AND APPROVED USING THE STANDARDS CONTAINED IN THE MOST RECENT VERSION OF THE FLORIDA BUILDING CODE. FBC 107, THE NEC 2017, AND THOSE SET FORTH BY THE FLORIDA SOLAR ENERGY CENTER CERTIFICATION

AC CONDUCTOR AMPACITY CALCULATIONS:  
FROM AC COMBINER BOX TO MSP


MODULE PROPERTIES			
VOC	41.8	ISC	11.35
VMPP	35.3	IMP	10.63
TC VOC	-0.26%/ °C	TC VMP	-0.34%/ °C
PMP	375.0	NOCT	45 °C

INVERTER PROPERTIES	
OUTPUT VOLTAGE	240 L-L 1-PH
MAX INPUT DC VOLTAGE	60 VDD
OPERATING RANGE	16 - 60 VDD
MPPT VOLTAGE RANGE	27 - 45 VDD
START VOLTAGE	22 VDD
MAX INPUT POWER	440 WDC
CONTINUOUS AC POWER	290 VA

ELECTRICAL NOTES

- ALL EQUIPMENT TO BE LISTED BY UL OR OTHER NRTL, AND LABELED FOR ITS APPLICATION.
- ALL CONDUCTORS SHALL BE COPPER, RATED FOR 600 V AND 90 DEGREE C WET ENVIRONMENT. THE TERMINALS ARE RATED FOR 75 DEGREE C.
- THE WIRES ARE SIZED ACCORDING TO NEC 110.14.
- WIRING, CONDUIT, AND RACEWAYS MOUNTED ON ROOFTOPS SHALL BE ROUTED DIRECTLY TO, AND LOCATED AS CLOSE AS POSSIBLE TO THE NEAREST RIDGE, HIP, OR VALLEY.
- WORKING CLEARANCES AROUND ALL NEW AND EXISTING ELECTRICAL EQUIPMENT SHALL COMPLY WITH NEC 110.26.
- DRAWINGS INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS. CONTRACTOR SHALL FURNISH ALL NECESSARY OUTLETS, SUPPORTS, FITTINGS AND ACCESSORIES TO FULFILL APPLICABLE CODES AND STANDARDS.
- WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, THE CONTRACTOR SHALL SIZE THEM ACCORDINGLY.
- ALL WIRE TERMINATIONS SHALL BE APPROPRIATELY LABELED AND READILY VISIBLE.
- MODULE GROUNDING CLIPS TO BE INSTALLED BETWEEN MODULE FRAME AND MODULE SUPPORT RAIL, PER THE GROUNDING CLIP MANUFACTURER'S INSTRUCTION.
- MODULE SUPPORT RAIL TO BE BONDED TO CONTINUOUS COPPER G.E.C. VIA WEEB LUG OR ILSCO GBL-4DBT LAY-IN LUG.
- THE POLARITY OF THE GROUNDED CONDUCTORS IS NEGATIVE .
- UTILITY HAS 24-HR UNRESTRICTED ACCESS TO ALL PHOTOVOLTAIC SYSTEM COMPONENTS LOCATED AT THE SERVICE ENTRANCE.
- MODULES CONFORM TO AND ARE LISTED UNDER UL 1703.
- RACKING CONFORMS TO AND IS LISTED UNDER UL 2703.
- CONDUCTORS EXPOSED TO SUNLIGHT SHALL BE LISTED AS SUNLIGHT RESISTANT PER NEC ARTICLE 300.6 (C) (1) AND ARTICLE 310.10 (D).
- CONDUCTORS EXPOSED TO WET LOCATIONS SHALL BE SUITABLE FOR USE IN WET LOCATIONS PER NEC ARTICLE 310.10 (C).

ENPHASE IQ7PLUS-72-2-US MICROINVERTER		
Input Data (DC)		
	Recommended Input Power (STC)	235-400W +
	Maximum Input DC Voltage	60V
	Peak Power Tracking Voltage	27V-45V
	Operating Range	16V-60V
	Min. / Max. Start Voltage	22V / 60V
	Max DC Short Circuit Current	15A
Output Data (AC)		
	Maximum Output Power	290W
	Nominal Output Current	1.21A
	Nominal Voltage / Range	240V/211-264V
	Nominal Frequency / Range	60 Hz
	Extended Frequency / Range	47-68 Hz
	Power Factor at rated power	1.0
	Maximum unit per 20A Branch Circuit	13 (240 VAC)




CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD, SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590


COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER





Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.07.28  
17:10:49

PROJECT NAME

OTERO RESIDENCE

6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME

WIRING CALCULATIONS

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

E-02

⚠

WARNING

ELECTRIC SHOCK HAZARD

TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC 690.13(B))

⚠

WARNING

DUAL POWER SOURCE

SECOND SOURCE IS PHOTOVOLTAIC SYSTEM

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(b))

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

LABEL LOCATION:  
AC DISCONNECT  
(PER CODE: NEC690.56(C)(3))

- ADHESIVE FASTENED SIGNS:
- THE LABEL SHALL BE SUITABLE FOR THE ENVIRONMENT WHERE IT IS INSTALLED.
  - WHERE REQUIRED ELSEWHERE IN THIS CODE, ALL FIELD APPLIED LABELS, WARNINGS, AND MARKINGS SHOULD COMPLY WITH ANSI Z535.4 [NEC 110.21(B) FIELD MARKING].
    - ADHESIVE FASTENED SIGNS MAY BE ACCEPTABLE IF PROPERLY ADHERED. VINYL SIGNS SHALL BE WEATHER RESISTANT [IFC 605.11.1.3]

SOLAR CONNECTION LINE SIDE TAP

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(A))

AC COMBINER BOX

LABEL LOCATION:  
COMBINER BOX  
(PER CODE: NEC690.52)

SOLAR BREAKER

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(b))

PHOTOVOLTAIC SYSTEM AC DISCONNECT

RATED AC OPERATING CURRENT 38.7 AMPS

AC NOMINAL OPERATING VOLTAGE 240 VOLTS

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC690.54)

WARNING

INVERTER OUTPUT CONNECTION DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL LOCATION:  
POINT OF INTERCONNECTION  
(PER CODE: NEC 705.12(B)(2)(3)(b))

DATA PER PANEL	
NOMINAL OPERATING AC VOLTAGE -	240 V
NOMINAL OPERATING AC FREQUENCY-	60 Hz
MAXIMUM AC POWER-	290 VA
MAXIMUM AC CURRENT-	1.21 A
MAXIMUM OVERCURRENT DEVICE RATING FOR AC MODULE PROTECTION PER CIRCUIT-	20 A

LABEL LOCATION:  
COMBINER BOX  
(PER CODE: NEC690.52)

AC DISCONNECT

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC690.54)

PHOTOVOLTAIC SYSTEM MICROINVERTERS LOCATED UNDER EACH PV MODULE IN ROOF TOP ARRAY

LABEL LOCATION:  
INVERTER  
(PER CODE: NEC690.52)

12.00 KW SOLAR DISCONNECT LOCATED

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC690.54)

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN THE ARRAY

SOLAR ELECTRIC PV PANELS

LABEL LOCATION:  
AC DISCONNECT, POINT OF INTERCONNECTION  
(PER CODE: NEC 690.56(C)(1)(a), IFC 605.11.3.1(1))

WARNING

⚠ IN CASE OF EMERGENCY CONTACT: ⚠


PES SOLAR

PH. NO. - (321) 365-0249

LABEL LOCATION:  
MAIN DISCONNECT  
(PER CODE: NFPA - 11.12.2.1.5)

EMERGENCY RESPONDER: THIS SOLAR PV SYSTEM IS EQUIPPED WITH RAPID SHUTDOWN.

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUT DOWN ENTIRE PV SYSTEM

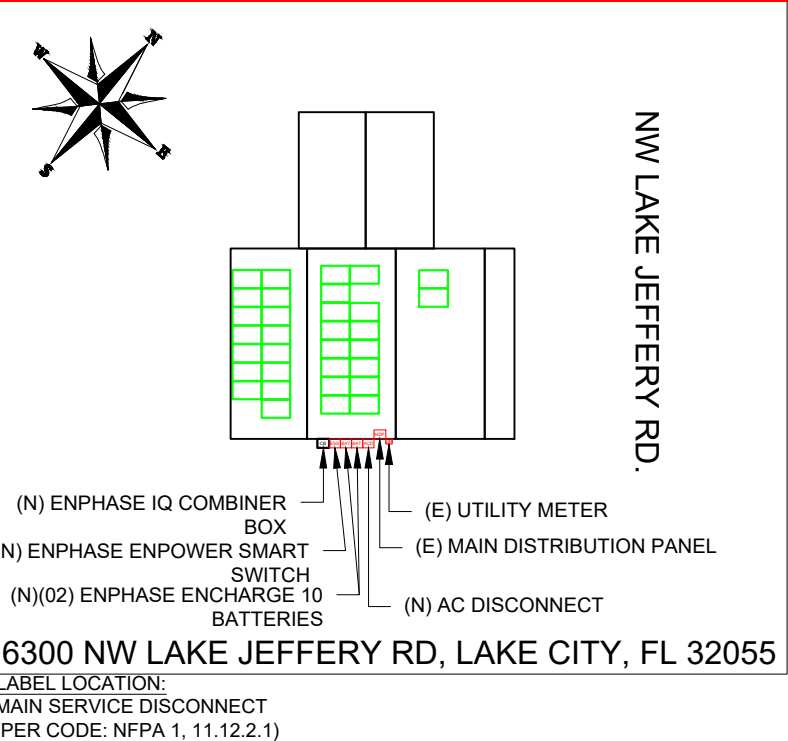

Castillo Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING SERVICES, LLC

COA # 28345

620 N. WYMORE ROAD, SUITE 250, MAITLAND, FL 32751

TEL: (407) 289-2575

ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY CASTILLO ENGINEERING SERVICES, LLC

REVISIONS

DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Digitally signed by: Ermocrates E Castillo

Date: 2021.07.28 17:10:49

PROJECT NAME

OTERO RESIDENCE

6300 NW LAKE JEFFERY RD, LAKE CITY, FL 32055

SHEET NAME

SYSTEM LABELING

SHEET SIZE

ANSI B 11" X 17"

SHEET NUMBER

E-03



# LG NeON<sup>®</sup>2

LG375N1C-A6

375W

The LG NeON<sup>®</sup> 2 is LG's best selling solar module and one of the most powerful and versatile modules on the market today. The cells are designed to appear all-black at a distance, and the performance warranty guarantees 90.6% of labeled power output at 25 years.



## Features



### Enhanced Performance Warranty

LG NeON<sup>®</sup> 2 has an enhanced performance warranty. After 25 years, LG NeON<sup>®</sup> 2 is guaranteed at least 90.6% of initial performance.



### 25-Year Limited Product Warranty

The NeON<sup>®</sup> 2 is covered by a 25-year limited product warranty. In addition, up to \$450 of labor costs will be covered in the rare case that a module needs to be repaired or replaced.



### Solid Performance on Hot Days

LG NeON<sup>®</sup> 2 performs well on hot days due to its low temperature coefficient.



### Roof Aesthetics

LG NeON<sup>®</sup> 2 has been designed with aesthetics in mind using thinner wires that appear all black at a distance.

When you go solar, ask for the brand you can trust: LG Solar

## About LG Electronics USA, Inc.

LG Electronics is a global leader in electronic products in the clean energy markets by offering solar PV panels and energy storage systems. The company first embarked on a solar energy source research program in 1985, supported by LG Group's vast experience in the semi-conductor, LCD, chemistry and materials industries. In 2010, LG Solar successfully released its first MonoX<sup>®</sup> series to the market, which is now available in 32 countries. The NeON<sup>®</sup> (previous MonoX<sup>®</sup> NeON), NeON<sup>®</sup>2, NeON<sup>®</sup>2 BiFacial won the "Intersolar AWARD" in 2013, 2015 and 2016, which demonstrates LG's leadership and innovation in the solar industry.



# LG NeON<sup>®</sup>2

LG375N1C-A6

## General Data

Cell Properties (Material/Type)	Monocrystalline/Al-type
Cell Maker	LG
Cell Configuration	60 Cells (5 x 10)
Module Dimensions (L x W x H)	1,740mm x 1,042mm x 40mm
Weight	18.6 kg
Glass (Material)	Tempered Glass with AR Coating
Backsheet (Color)	White
Frame (Material)	Anodized Aluminium
Junction Box (Protection Degree)	IP 68 with 3 Bypass Diodes
Cables (Length)	1,100mm x 2EA
Connector (Type/Maker)	MC 4/MC

## Certifications and Warranty

Certifications*	IEC 61215-1/-1:2016, IEC 61730-1/2:2016, UL 61730-1:2017, UL 61730-2:2017, ISO 9001, ISO 14001, ISO 50001
	OHSAS 18001
Salt Mist Corrosion Test	IEC 61701:2012 Severity 6
Ammonia Corrosion Test	IEC 62716:2013
Module Fire Performance	Type 1 (UL 61730)
Fire Rating	Class C (UL 790, ULC/ORD C 1703)
Solar Module Product Warranty	25 Year Limited
Solar Module Output Warranty	Linear Warranty*

\*Improved: 1<sup>st</sup> year 98.5%, from 2-24th year: 0.33%/year down, 90.6% at year 25

## Temperature Characteristics


NMOT*	[°C]	42 ± 3
P <sub>max</sub>	[%/°C]	-0.34
V <sub>oc</sub>	[%/°C]	-0.26
I <sub>sc</sub>	[%/°C]	0.03

\*NMOT (Nominal Module Operating Temperature): Irradiance 800 W/m<sup>2</sup>, Ambient temperature 20°C, Wind speed 1 m/s, Spectrum AM 1.5

## Electrical Properties (NMOT)

Model	LG375N1C-A6	
Maximum Power (P <sub>max</sub> )	[W]	281
MPP Voltage (V <sub>mpp</sub> )	[V]	33.2
MPP Current (I <sub>mpp</sub> )	[A]	8.48
Open Circuit Voltage (V <sub>oc</sub> )	[V]	39.4
Short Circuit Current (I <sub>sc</sub> )	[A]	9.13

## I-V Curves

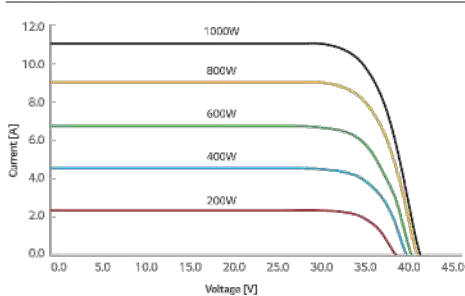

## Electrical Properties (STC\*)

Model		LG375N1C-A6
Maximum Power (Pmax)	[W]	375
MPP Voltage (Vmpp)	[V]	35.3
MPP Current (Impp)	[A]	10.63
Open Circuit Voltage (Voc, ± 5%)	[V]	41.8
Short Circuit Current (Isc, ± 5%)	[A]	11.35
Module Efficiency	[%]	20.7
Bifaciality Coefficient of Power	[%]	10
Power Tolerance	[%]	0 ~ +3

\*STC (Standard Test Condition): Irradiance 1000 W/m<sup>2</sup>, cell temperature 25°C, AM 1.5

## Operating Conditions


Operating Temperature	[°C]	-40 ~ +85
Maximum System Voltage	[V]	1,000
Maximum Series Fuse Rating	[A]	20
Mechanical Test Load* (Front)	[Pa/psf]	5,400
Mechanical Test Load* (Rear)	[Pa/psf]	4,000

\*Based on IEC 61215-2:2016 (Test Load = Design Load x Safety Factor (1.5))  
Mechanical test Loads 6,000Pa / 5,400Pa based on IEC 61215:2005

## Packaging Configuration

Number of Modules per Pallet	[EA]	25
Number of Modules per 40' Container	[EA]	650
Number of Modules per 53' Container	[EA]	850
Packaging Box Dimensions (L x W x H)	[mm]	1,790 x 1,120 x 1,213
Packaging Box Dimensions (L x W x H)	[in]	70.5 x 44.1 x 47.8
Packaging Box Gross Weight	[kg]	500
Packaging Box Gross Weight	[lb]	1,102

## Dimensions (mm/inch)

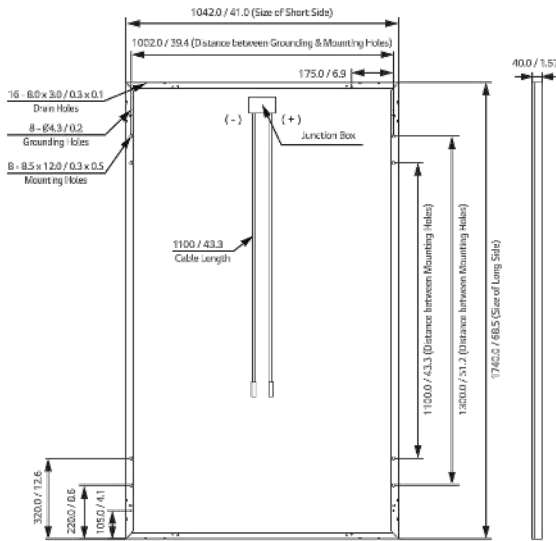

LG Electronics USA, Inc.  
Solar Business Division  
2000 Millbrook Drive  
Lincolnshire, IL 60069  
www.lg-solar.com

Product specifications are subject to change without notice.  
LG375N1C-A6\_AUS.pdf  
012221

© 2021 LG Electronics USA, Inc. All rights reserved.



CASTILLO ENGINEERING SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING SERVICES, LLC

## REVISIONS

DESCRIPTION	DATE	REV

## PROJECT INSTALLER



Digitally signed by:  
Ermocrates E. Castillo  
Date: 2021.07.28 17:10:50

## PROJECT NAME

OTERO RESIDENCE

6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-01



LG Electronics U.S.A., Inc.  
111 Sylvan Avenue  
Englewood Cliffs, NJ 07632  
201.816.2000

Friday, February 5, 2021

RE: Mechanical Load Testing to Determine Structural Performance under Uniform Static Pressure

To: Castillo Engineering,


Upon your request we have conducted in house tests to determine the structural performance of the LG Module frames listed below. Our test results meet the requirements you presented in our conference call on January 29<sup>th</sup>. We will present the test criteria, results, and product limitations that may result from these test conditions in this letter.

The specifications and conditions presented in this letter apply retroactively to the following LG module(s);

	2 Rails	3 Rails
Front	9,000Pa	9,000Pa
Rear	6,350Pa	9,000Pa
Model	LGxxxN1C(K)-N5(L5), LGxxxN1C(K)-A6(B6) LGxxxQ1C(K)-V5, LGxxxQ1C(K)-A6	

\*The result is based on test load.

Our R&D department has tested these modules to determine the structural performance of under uniform static loading to represent the effects of a wind load on the module. This test was designed only to determine structural performance; the revised specifications apply only to the mechanical performance of the module. A safety factor of 1.5 should be applied to these test loads for obtaining design loads. It is not recommend designing any system to the full test load.

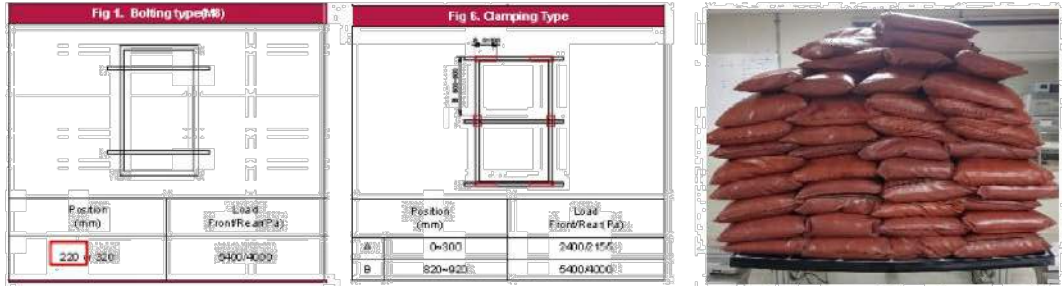

The scope of this test does not include electrical functionality or performance testing. Subjecting the module to these pressures may result in power degradation or total power loss. The electrical function and power generation warranties and specifications of these products are not altered by this document.

If you have any additional questions or concerns about this letter or the test protocol, contact your LG Solar Sales Representative.

Castillo  
Engineering  
SOLAR DONE RIGHT®

CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.07.28  
17:10:51

PROJECT NAME

OTERO RESIDENCE

6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-02



# Enphase IQ 7 and IQ 7+ Microinverters

The high-powered smart grid-ready **Enphase IQ 7 Micro™** and **Enphase IQ 7+ Micro™** dramatically simplify the installation process while achieving the highest system efficiency.

Part of the Enphase IQ System, the IQ 7 and IQ 7+ Microinverters integrate seamlessly with the Enphase IQ Envoy™, Enphase Q Aggregator™, Enphase IQ Battery™, and the Enphase Enlighten™ monitoring and analysis software.

IQ Series Microinverters extend the reliability standards set forth by previous generations and undergo over a million hours of power-on testing, enabling Enphase to provide an industry-leading warranty of up to 25 years.



### Easy to Install

- Lightweight and simple
- Faster installation with improved, lighter two-wire cabling
- Built-in rapid shutdown compliant (NEC 2014 & 2017)

### Productive and Reliable

- Optimized for high powered 60-cell and 72-cell\* modules
- More than a million hours of testing
- Class II double-insulated enclosure
- UL listed

### Smart Grid Ready

- Complies with advanced grid support, voltage and frequency ride-through requirements
- Remotely updates to respond to changing grid requirements
- Configurable for varying grid profiles
- Meets CA Rule 21 (UL 1741-SA)

\* The IQ 7+ Micro is required to support 72-cell modules.



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase IQ 7 and IQ 7+ Microinverters

INPUT DATA (DC)	IQ7-60-2-US		IQ7PLUS-72-2-US	
Commonly used module pairings <sup>1</sup>	235 W - 350 W +		235 W - 440 W +	
Module compatibility	60-cell PV modules only		60-cell and 72-cell PV modules	
Maximum input DC voltage	48 V		60 V	
Peak power tracking voltage	27 V - 37 V		27 V - 45 V	
Operating range	16 V - 48 V		16 V - 60 V	
Min/Max start voltage	22 V / 48 V		22 V / 60 V	
Max DC short circuit current (module Isc)	15 A		15 A	
Overvoltage class DC port	II		II	
DC port backfeed current	0 A		0 A	
PV array configuration	1 x 1 ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit			
OUTPUT DATA (AC)	IQ 7 Microinverter		IQ 7+ Microinverter	
Peak output power	250 VA		295 VA	
Maximum continuous output power	240 VA		290 VA	
Nominal (L-L) voltage/range <sup>2</sup>	240 V / 211-264 V	208 V / 183-229 V	240 V / 211-264 V	208 V / 183-229 V
Maximum continuous output current	1.0 A	1.15 A	1.21 A	1.39 A
Nominal frequency	60 Hz		60 Hz	
Extended frequency range	47 - 68 Hz		47 - 68 Hz	
AC short circuit fault current over 3 cycles	5.8 Arms		5.8 Arms	
Maximum units per 20 A (L-L) branch circuit <sup>3</sup>	16 (240 VAC) 13 (208 VAC)		13 (240 VAC) 11 (208 VAC)	
Overvoltage class AC port	III		III	
AC port backfeed current	0 A		0 A	
Power factor setting	1.0		1.0	
Power factor (adjustable)	0.7 leading ... 0.7 lagging		0.7 leading ... 0.7 lagging	
EFFICIENCY	@240 V	@208 V	@240 V	@208 V
Peak CEC efficiency	97.6 %	97.6 %	97.5 %	97.3 %
CEC weighted efficiency	97.0 %	97.0 %	97.0 %	97.0 %
MECHANICAL DATA	IQ 7 Microinverter			
Ambient temperature range	-40°C to +65°C			
Relative humidity range	4% to 100% (condensing)			
Connector type	MC4 (or Amphenol H4 UTX with additional Q-DCC-5 adapter)			
Dimensions (WxHxD)	212 mm x 175 mm x 30.2 mm (without bracket)			
Weight	1.08 kg (2.38 lbs)			
Cooling	Natural convection - No fans			
Approved for wet locations	Yes			
Pollution degree	PD3			
Enclosure	Class II double-insulated, corrosion resistant polymeric enclosure			
Environmental category / UV exposure rating	NEMA Type 6 / outdoor			
FEATURES				
Communication	Power Line Communication (PLC)			
Monitoring	Enlighten Manager and MyEnlighten monitoring options. Both options require installation of an Enphase IQ Envoy.			
Disconnecting means	The AC and DC connectors have been evaluated and approved by UL for use as the load-break disconnect required by NEC 690.			
Compliance	CA Rule 21 (UL 1741-SA) UL 62109-1, UL1741/IEEE1547, FCC Part 15 Class B, ICES-0003 Class B, CAN/CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shut Down Equipment and conforms with NEC-2014 and NEC-2017 section 690.12 and C22.1-2015 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according manufacturer's instructions.			

1. No enforced DC/AC ratio. See the compatibility calculator at <https://enphase.com/en-us/support/module-compatibility>.  
2. Nominal voltage range can be extended beyond nominal if required by the utility.  
3. Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)


© 2018 Enphase Energy. All rights reserved. All trademarks or brands used are the property of Enphase Energy, Inc.  
2018-02-08



### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.07.28  
17:10:52

### PROJECT NAME

OTERO RESIDENCE  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

### SHEET NAME

DATA SHEET

### SHEET SIZE


ANSI B  
11" X 17"

### SHEET NUMBER

DS-03

# Enphase IQ Combiner 3 (X-IQ-AM1-240-3)

The **Enphase IQ Combiner 3™** with Enphase IQ Envoy™ consolidates interconnection equipment into a single enclosure and streamlines PV and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

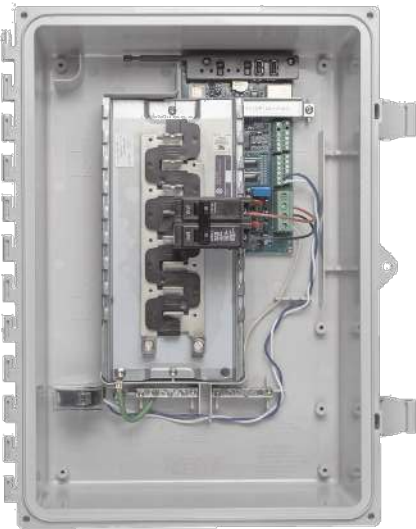

## Smart

- Includes IQ Envoy for communication and control
- Flexible networking supports Wi-Fi, Ethernet, or cellular
- Optional AC receptacle available for PLC bridge
- Provides production metering and optional consumption monitoring

## Simple

- Reduced size from previous combiner
- Centered mounting brackets support single stud mounting
- Supports back and side conduit entry
- Up to four 2-pole branch circuits for 240 VAC plug-in breakers (not included)
- 80 A total PV or storage branch circuits

## Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year warranty
- UL listed



To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase IQ Combiner 3

MODEL NUMBER	
IQ Combiner 3 X-IQ-AM1-240-3	IQ Combiner 3 with Enphase IQ Envoy™ printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 +/- 0.5%) and optional* consumption monitoring (+/- 2.5%).
ACCESSORIES and REPLACEMENT PARTS (not included, order separately)	
Enphase Mobile Connect™ CELLMODEM-03 (4G / 12-year data plan) CELLMODEM-01 (3G / 5-year data plan) CELLMODEM-M1 (4G based LTE-M / 5-year data plan)	Plug and play industrial grade cellular modem with data plan for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.)
Consumption Monitoring* CT CT-200-SPLIT	Split core current transformers enable whole home consumption metering (+/- 2.5%).
Circuit Breakers BRK-10A-2-240 BRK-15A-2-240 BRK-20A-2P-240	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220
EPLC-01	Power line carrier (communication bridge pair), quantity 2
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 3 (required for EPLC-01)
XA-ENV-PCBA-3	Replacement IQ Envoy printed circuit board (PCB) for Combiner 3
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240 VAC, 60 Hz
Eaton BR series busbar rating	125 A
Max. continuous current rating (output to grid)	65 A
Max. fuse/circuit rating (output)	90 A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. continuous current rating (input from PV)	64 A
Max. total branch circuit breaker rating (input)	80A of distributed generation / 90A with IQ Envoy breaker included
Production Metering CT	200 A solid core pre-installed and wired to IQ Envoy
MECHANICAL DATA	
Dimensions (WxHxD)	49.5 x 37.5 x 16.8 cm (19.5" x 14.75" x 6.63"). Height is 21.06" (53.5 cm with mounting brackets).
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40° C to +46° C (-40° to 115° F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20 A to 50 A breaker inputs: 14 to 4 AWG copper conductors • 60 A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors Always follow local code requirements for conductor sizing.
Altitude	To 2000 meters (6,560 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	802.11b/g/n
Ethernet	Optional, 802.3, Cat5E (or Cat 6) UTP Ethernet cable (not included)
Cellular	Optional, CELLMODEM-01 (3G) or CELLMODEM-03 (4G) or CELLMODEM-M1 (4G based LTE-M) (not included)
COMPLIANCE	
Compliance, Combiner	UL 1741 CAN/CSA C22.2 No. 107.1 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production)
Compliance, IQ Envoy	UL 60601-1/CANCSA 22.2 No. 61010-1
* Consumption monitoring is required for Enphase Storage Systems.	

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)


© 2018 Enphase Energy. All rights reserved. All trademarks or brands in this document are registered by their respective owner.  
2018-09-13



### REVISIONS

DESCRIPTION	DATE	REV

### PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.07.28  
17:10:53

### PROJECT NAME

**OTERO RESIDENCE**  
  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"


### SHEET NUMBER

DS-04



# Enphase Encharge 10

The **Enphase Encharge 10™** all-in-one AC-coupled storage system is **reliable, smart, simple, and safe**. It is comprised of three base Encharge 3™ storage units, has a total usable energy capacity of 10.08 kWh and twelve embedded grid-forming microinverters with 3.84 kW power rating. It provides backup capability and installers can quickly design the right system size to meet the needs of both new and retrofit solar customers.

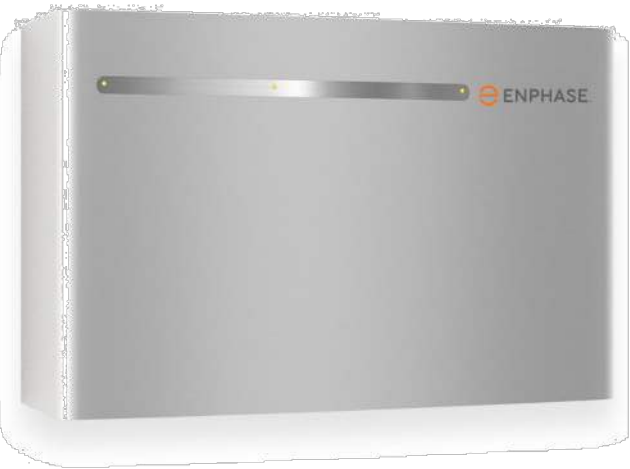

### Reliable

- Proven high reliability IQ Series Microinverters
- Ten-year limited warranty
- Three independent Encharge storage base units
- Twelve embedded IQ 8X-BAT Microinverters
- Passive cooling (no moving parts/fans)

### Smart

- Grid-forming capability for backup operation
- Remote software and firmware upgrade
- Mobile app-based monitoring and control
- Support for self consumption
- Utility time of use (TOU) optimization

### Simple

- Fully integrated AC battery system
- Quick and easy plug-and-play installation
- Interconnects with standard household AC wiring

### Safe

- Cells safety tested
- Lithium iron phosphate (LFP) chemistry for maximum safety and longevity

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase Encharge 10

MODEL NUMBER	
ENCHARGE-10-1P-NA	Encharge 10 battery storage system with integrated Enphase Microinverters and battery management unit (BMU). Includes: - Three Encharge 3.36 kWh base units (B3-A01-US001-1-3) - One Encharge 10 cover kit with cover, wall mounting bracket, watertight conduit hubs, and interconnect kit for wiring between batteries (B10-C-1050-0)
ACCESSORIES	
ENCHARG-HNDLR1	One set of Encharge base unit installation handles
OUTPUT (AC)	
@ 240 VAC¹	
Rated (continuous) output power²	3.84 kVA
Peak output power	5.7 kVA (10 seconds)
Nominal voltage / range	240 / 211 – 264 VAC
Nominal frequency / range	60 / 57 – 61 Hz
Rated output current	16 A
Power factor (adjustable)	0.85 leading ... 0.85 lagging
Maximum units per 20 A branch circuit	1 unit (single phase)
Interconnection	Single-phase
Maximum AC short circuit fault current over 3 cycles	69.6 Arms
Round trip efficiency²	89%
BATTERY	
Total capacity	10.5 kWh
Usable capacity	10.08 kWh
Round trip efficiency	96%
Nominal DC voltage	67.2 V
Maximum DC voltage	73.5 V
Ambient operating temperature range	-15° C to 55° C (5° F to 131° F) non-condensing
Optimum operating temperature range	0° C to 30° C (32° F to 86° F)
Chemistry	Lithium iron phosphate (LFP)
MECHANICAL DATA	
Dimensions (WxHxD)	1070 mm x 664 mm x 319 mm (42.13 in x 26.14 in x 12.56 in)
Weight	Three individual 44.2 kg (97.4 lbs) base units plus 21.1 kg (48.7 lbs) cover and mounting bracket; total 154.7 kg (341 lbs)
Enclosure	Outdoor – NEMA type 3R
IQ 8X-BAT microinverter enclosure	NEMA type 6
Cooling	Natural convection – No fans
Altitude	Up to 2500 meters (8200 feet)
Mounting	Wall mount
FEATURES AND COMPLIANCE	
Compatibility	Compatible with grid-tied PV systems. Compatible with Enphase IQ Series Micros, Enphase Enpower, and Enphase IQ Envoy for backup operation.
Communication	Wireless 2.4 GHz and 915 MHz
Services	Backup, self-consumption, TOU, Demand Charge, NEM Integrity
Monitoring	Enlighten Manager and MyEnlighten monitoring options; API integration
Compliance (pending)	UL 9540, UN 38.3, UL 9540A, UL 1998, UL 991, NEMA Type 3R, AC156 EMI: 47 CFR, Part 15, Class B, ICES 003 Cell Module: UL 1973, UN 38.3 Inverters: UL 62109-1, IEC 62109-2, UL 1741SA, CAN/CSA C22.2 No. 107.1-16
LIMITED WARRANTY	
Limited Warranty³	>70% capacity, up to 10 years or 4000 cycles
1. Supported in backup/off grid operations 2. AC to Battery to AC at 50% power rating. 3. Whichever occurs first. Restrictions apply.	

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2020 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Encharge 10, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2020-03-29



Castillo  
Engineering

SOLAR DONE RIGHT®

CASTILLO ENGINEERING  
SERVICES, LLC

COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

PROFESSIONAL ENGINEER  
No. 52590  
STATE OF FLORIDA

ERMOCRATES E. CASTILLO

Digitally  
signed by:  
Ermocrates  
Castillo  
Date:  
2021.07.28  
17:10:53

PROJECT NAME

OTERO RESIDENCE

6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME  
DATA SHEET

SHEET SIZE  
ANSI B  
11" X 17"

SHEET NUMBER  
DS-05

# Enphase Enpower

The **Enphase Enpower™** smart switch connects the home to grid power, the Encharge storage system, and solar PV. It provides microgrid interconnection device (MID) functionality by automatically detecting and seamlessly transitioning the home energy system from grid power to backup power in the event of a grid failure. It consolidates interconnection equipment into a single enclosure and streamlines grid independent capabilities of PV and storage installations by providing a consistent, pre-wired solution for residential applications.



## Reliable

- Durable NEMA type 3R enclosure
- Ten-year limited warranty

## Smart

- Controls safe connectivity to the grid
- Automatically detects grid outages
- Provides seamless transition to backup

## Simple

- Connects to the load or service equipment¹ side of the main load panel
- Centered mounting brackets support single stud mounting
- Supports conduit entry from the bottom, bottom left side, and bottom right side
- Supports whole home and partial home backup and subpanel backup
- Up to 200A main breaker support
- Includes neutral-forming transformer for split phase 120/240V backup operation

1. Enpower is not suitable for use as service equipment in Canada.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)



## Enphase Enpower

MODEL NUMBER		
EP200G101-M240US00	Enphase Enpower smart switch with neutral-forming transformer (NFT), Microgrid Interconnect Device (MID), breakers, and screws. Streamlines grid-independent capabilities of PV and storage installations.	
ACCESSORIES and REPLACEMENT PARTS		
XA-E3-PCBA-ENS	Replacement Enpower controller printed circuit board	
Circuit breakers (as needed) <sup>2,3</sup>	Not included, must order separately:	
BRK-100A-2P-240V	• Main breaker, 2 pole, 100A, 25kAIC, CSR2100N or CSR2100	
BRK-125A-2P-240V	• Main breaker, 2 pole, 125A, 25kAIC, CSR2125N	
BRK-150A-2P-240V	• Main breaker, 2 pole, 150A, 25kAIC, CSR2150N	
BRK-175A-2P-240V	• Main breaker, 2 pole, 175A, 25kAIC, CSR2175N	
BRK-200A-2P-240V	• Main breaker, 2 pole, 200A, 25kAIC, CSR2200N	
BRK-20A-2P-240V-B	• Circuit breaker, 2 pole, 20A, 10kAIC, BR220B	
BRK-30A-2P-240V	• Circuit breaker, 2 pole, 30A, 10kAIC, BR230B	
BRK-40A-2P-240V	• Circuit breaker, 2 pole, 40A, 10kAIC, BR240B	
BRK-60A-2P-240V	• Circuit breaker, 2 pole, 60A, 10kAIC, BR260	
BRK-80A-2P-240V	• Circuit breaker, 2 pole, 80A, 10kAIC, BR280	
EP200G-HNDL-R1	Enpower installation handle kit (order separately)	
ELECTRICAL SPECIFICATIONS		
Assembly rating	Continuous operation at 100% of its rating	
Nominal voltage / range (L-L)	240 VAC / 100 - 310 VAC	
Voltage measurement accuracy	±1% V nominal (±1.2V L-N and ±2.4V L-L)	
Nominal frequency / range	60 Hz / 56 - 63 Hz	
Frequency measurement accuracy	±0.1 Hz	
Maximum continuous current rating	160A	
Maximum output overcurrent protection device	200A	
Maximum input overcurrent protection device	200A	
Maximum overcurrent protection device rating for storage branch circuit <sup>4</sup>	80A	
Maximum overcurrent protection device rating for PV combiner branch circuit <sup>4</sup>	80A	
Neutral Forming Transformer (NFT)	• Breaker rating (pre-installed): 40A between L1 and Neutral; 40A between L2 and Neutral • Continuous rated power: 3600VA • Maximum continuous unbalance current: 30A @ 120V • Peak rated power: 8800VA for 30 seconds • Peak unbalanced current: 80A @ 120V for 30 seconds	
MECHANICAL DATA		
Dimensions (WxHxD)	50cm x 91.6cm x 24.6cm (19.7 in x 36 in x 9.7 in)	
Weight	38.5 kg (85 lbs)	
Ambient temperature range	-40° C to +50° C (-40° F to 122° F)	
Cooling	Natural convection, plus heat shield	
Enclosure environmental rating	Outdoor, NEMA type 3R, polycarbonate construction	
Altitude	To 2500 meters (8200 feet)	
WIRE SIZES		
Connections	• Main lugs, backup load lugs, and CSR breakers • BR breakers (wire provided) • AC combiner lugs, Encharge lugs, and generator (reserved for future use) lugs • Neutral (large lugs)	Cu/AL: 2 AWG - 300 KCMIL 6 AWG 14 AWG – 2 AWG  Cu/AL: 6 AWG - 300 KCMIL
Neutral and ground bars	Large holes (5/16-24 UNF) Small holes (10-32 UNF)	14 AWG – 1/0 AWG 14 AWG – 6 AWG
COMPLIANCE		
Compliance	UL 1741, UL 1741 SA, UL1998, UL869A <sup>5</sup> , UL67 <sup>5</sup> , UL508 <sup>5</sup> , UL50E <sup>5</sup> CSA 22.2 No. 107.1, 47 CFR, Part 15, Class B, ICES 003, AC156.	

2. Compatible with BRHDK125 Hold-Down Kit to comply with 2017 NEC 710.15E for back-fed circuit breakers.  
3. The kAIC of Enpower is the same as the kAIC of the main breaker being installed as listed.  
4. Not included. Installer must provide properly rated breaker per circuit breaker list above.  
5. Sections from these standards were used during the safety evaluation and included in the UL 1741 listing.

To learn more about Enphase offerings, visit [enphase.com](https://enphase.com)

© 2020 Enphase Energy. All rights reserved. Enphase, the Enphase logo, Enpower, and other trademarks or service names are the trademarks of Enphase Energy, Inc. Data subject to change. 2020-06-16




CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

## REVISIONS

DESCRIPTION	DATE	REV

## PROJECT INSTALLER



Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.07.28  
17:10:54

This document is the property of Castillo Engineering Services, LLC. It is to be used only for the project and location specified. It is not to be reproduced, copied, or distributed without the written consent of Castillo Engineering Services, LLC.

## PROJECT NAME

OTERO RESIDENCE  
6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

## SHEET NAME

DATA SHEET

## SHEET SIZE

ANSI B  
11" X 17"

## SHEET NUMBER


DS-06



# SOLARMOUNT



**SOLARMOUNT** defined the standard in solar racking. Features are designed to get installers off the roof faster. Our grounding & bonding process eliminates copper wire and grounding straps to reduce costs. Systems can be configured with standard or light rail to meet your design requirements at the lowest cost possible. The superior aesthetics package provides a streamlined clean edge for enhanced curb appeal, with no special brackets required for installation.

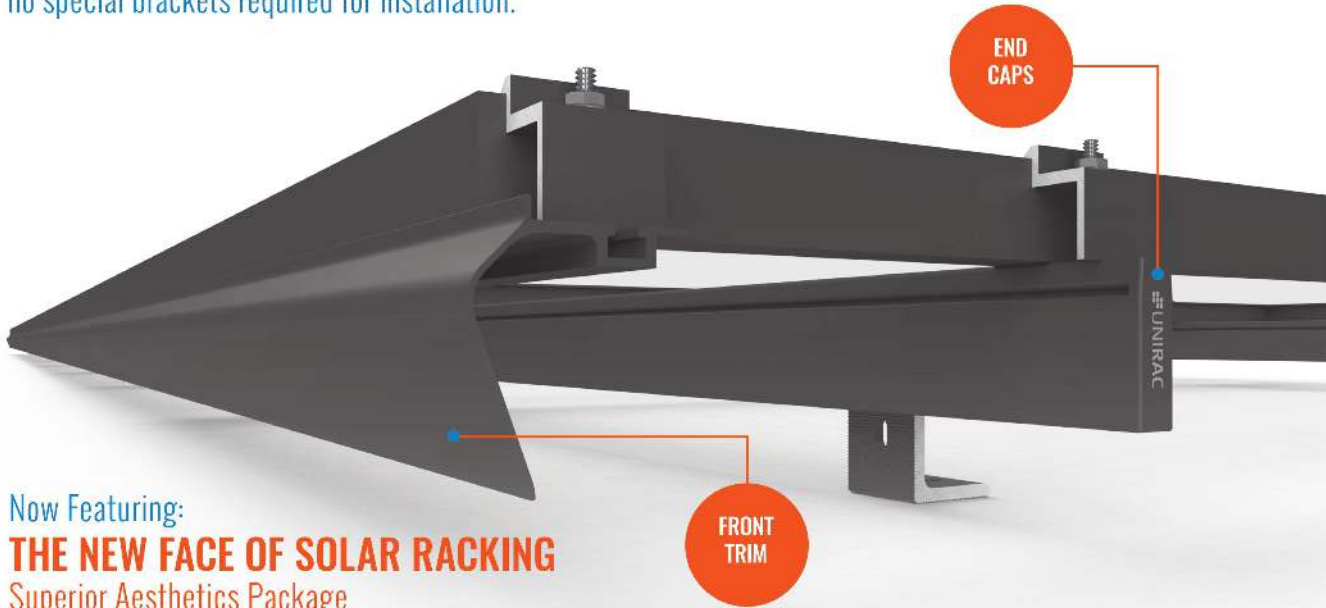

Now Featuring:  
**THE NEW FACE OF SOLAR RACKING**  
Superior Aesthetics Package



**LOSE ALL OF THE COPPER & LUGS**  
System grounding through Enphase microinverters and trunk cables



**SMALL IS THE NEXT NEW BIG THING**  
Light Rail is Fully Compatible with all SM Components



**ENHANCED DESIGN & LAYOUT TOOLS**  
Featuring Google Map Capabilities within U-Builder

## FAST INSTALLATION. SUPERIOR AESTHETICS

OPTIMIZED COMPONENTS • VERSATILITY • DESIGN TOOLS • QUALITY PROVIDER

# SOLARMOUNT



## OPTIMIZED COMPONENTS

### INTEGRATED BONDING & PRE-ASSEMBLED PARTS

Components are pre-assembled and optimized to reduce installation steps and save labor time. Our new grounding & bonding process eliminates copper wire and grounding straps or bonding jumpers to reduce costs. Utilize the microinverter mount with a wire management clip for an easier installation.

## VERSATILITY

### ONE PRODUCT - MANY APPLICATIONS

Quickly set modules flush to the roof or at a desired tilt angle. Change module orientation to portrait or landscape while securing a large variety of framed modules on flat, low slope or steep pitched roofs. Available in mill, clear and dark anodized finishes to outperform your projects financial and aesthetic aspirations.

## AUTOMATED DESIGN TOOL

### DESIGN PLATFORM AT YOUR SERVICE

Creating a bill of materials is just a few clicks away with U-Builder, a powerful online tool that streamlines the process of designing a code compliant solar mounting system. Save time by creating a user profile, and recall preferences and projects automatically when you log in. You will enjoy the ability to share projects with customers: there's no need to print results and send to a distributor, just click and share.



**LISTED UL2703**

BONDING & GROUNDING  
MECHANICAL LOADING  
SYSTEM FIRE CLASSIFICATION

## UNIRAC CUSTOMER SERVICE MEANS THE HIGHEST LEVEL OF PRODUCT SUPPORT



### TECHNICAL SUPPORT

Unirac's technical support team is dedicated to answering questions & addressing issues in real time. An online library of documents including engineering reports, stamped letters and technical data sheets greatly simplifies your permitting and project planning process.



### CERTIFIED QUALITY PROVIDER

Unirac is the only PV mounting vendor with ISO certifications for 9001:2015, 14001:2015 and OHSAS 18001:2007, which means we deliver the highest standards for fit, form, and function. These certifications demonstrate our excellence and commitment to first class business practices.




### BANKABLE WARRANTY

Don't leave your project to chance, Unirac has the financial strength to back our products and reduce your risk. Have peace of mind knowing you are receiving products of exceptional quality. SOLARMOUNT is covered by a twenty five (25) year limited product warranty and a five (5) year limited finish warranty.




### PERMIT DOCUMENTATION


Protect your reputation with quality racking solutions backed by engineering excellence and a superior supply chain.

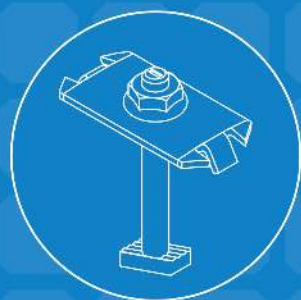

INTEGRATED BONDING  
MIDCLAMP

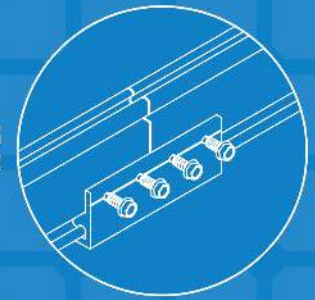

INTEGRATED BONDING  
SPLICE BAR

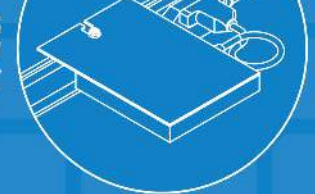

INTEGRATED BONDING  
L-FOOT w/ T-BOLT



**CASTILLO ENGINEERING SERVICES, LLC**  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

### PROJECT INSTALLER



Digitally signed by:  
Ermocrates E. Castillo  
Date: 2021.07.28 17:10:55

### PROJECT NAME

OTERO RESIDENCE

6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

### SHEET NAME

DATA SHEET

### SHEET SIZE

ANSI B  
11" X 17"

### SHEET NUMBER

DS-07



The right way to attach almost anything to metal roofs!

# S-5!®

## The Right Way!

### ProteaBracket™

ProteaBracket™ is the most versatile standing seam metal roof attachment solution on the market, fitting most trapezoidal sheet profiles with and without intermediate insulation. It features an adjustable attachment base and multiple solar module attachment options (illustrated on back) to accommodate varying widths and heights. There are no messy sealants to apply and no chance for leaks; the ProteaBracket comes with factory-applied, adhesive rubber sealant to ensure quick installation and a weather-proof fit.

Installation is simple! The ProteaBracket is mounted directly onto the crown of the panel, straddling the profile. No surface preparation is necessary; simply wipe away excess oil and debris, align, and apply. Secure ProteaBracket through its pre-punched holes, using the hardened drill point S-5!® screws.

ProteaBracket is the perfect match for our S-5-PV Kit and spares you the hassle of cold-bridging! For a solar attachment solution that is both economical and easy to use, choose ProteaBracket.\*

\*When ProteaBracket is used in conjunction with the S-5-PV Kit, an additional nut is required during installation.

S-5!® ProteaBracket™ is a versatile bracket that adjusts easily to most trapezoidal roof profiles.

888-825-3432 | [www.S-5.com](http://www.S-5.com)



ProteaBracket™

# S-5!®

The Right Way!

ProteaBracket™ is the perfect solar attachment solution for most trapezoidal exposed-fastened metal roof profiles! No messy sealants to apply. The factory-applied adhesive rubber sealant weather-proofs and makes installation easy!

Each ProteaBracket™ comes with a factory-applied, adhesive rubber sealant on the base. A structural A2 stainless steel bimetal attachment bracket, ProteaBracket is compatible with most common metal roofing materials. All four pre-punched holes must be used to achieve tested strength. Mounting hardware is furnished with the ProteaBracket. For design assistance, ask your distributor, or visit [www.S-5.com](http://www.S-5.com) for the independent lab test data that can be used for load-critical designs and applications. Also, please visit our website for more information including metallurgical compatibilities and specifications. S-5!® holding strength is unmatched in the industry.

### Multiple Attachment Options:


Side Rail Option

Top Rail Option

S-5-PV Kit Option




### ProteaBracket™

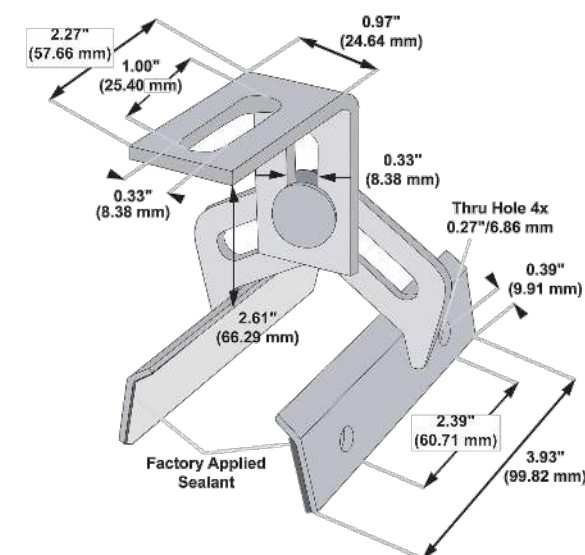

Please note: All measurements are rounded to the second decimal place.

### Example Applications

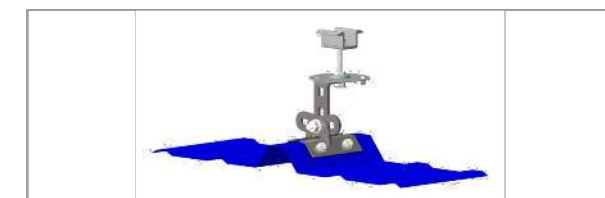

S-5-PV Kit demonstrated with a ProteaBracket on a trapezoidal profile.

### Example Profile



### S-5!® Warning! Please use this product responsibly!

Products are protected by multiple U.S. and foreign patents. For published data regarding holding strength, bolt torque, patents, and trademarks, visit the S-5! website at [www.S-5.com](http://www.S-5.com).

Copyright 2013, Metal Roof Innovations, Ltd. S-5! products are patent protected. S-5! aggressively protects its patents, trademarks, and copyrights. Version 112513.

Distributed by

Castillo  
Engineering

SOLAR DONE RIGHT®  
CASTILLO ENGINEERING  
SERVICES, LLC  
COA # 28345  
620 N. WYMORE ROAD,  
SUITE 250,  
MAITLAND, FL 32751  
TEL: (407) 289-2575  
ERMOCRATES E. CASTILLO - FL PE 52590

COPYRIGHTED BY  
CASTILLO ENGINEERING  
SERVICES, LLC

REVISIONS		
DESCRIPTION	DATE	REV

PROJECT INSTALLER

SUNPRO

Digitally  
Signed by:  
Ermocrates  
E Castillo  
Date:  
2021.07.28  
17:10:55

PROJECT NAME

OTERO RESIDENCE

6300 NW LAKE JEFFERY RD,  
LAKE CITY, FL 32055

SHEET NAME

DATA SHEET

SHEET SIZE

ANSI B  
11" X 17"

SHEET NUMBER

DS-08