


ITW Building Components Group, Inc.

1950 Marley Drive Haines City, FL 33844
Florida Engineering Certificate of Authorization Number: 567
Florida Certificate of Product Approval # FL1999
Page 1 of 1 Document ID: ITA18228Z0505135453

Truss Fabricator: Anderson Truss Company
Job Identification: 7-259--Seth Heitzman Horton Addition -- Cannon Creek Airpark , **
Truss Count: 2
Model Code: Florida Building Code 2004 and 2006 Supplement
Truss Criteria: ANSI/TPI-2002(STD)/FBC
Engineering Software: Alpine Software, Version 7.36.
Structural Engineer of Record: The identity of the structural EOR did not exist as of
Address: the seal date per section 61G15-31.003(5a) of the FAC
Minimum Design Loads: Roof - 40.0 PSF @ 1.25 Duration
Floor - N/A
Wind - 110 MPH ASCE 7-02 -Closed



Notes:

1. Determination as to the suitability of these truss components for the structure is the responsibility of the building designer/engineer of record, as defined in ANSI/TPI 1
2. The drawing date shown on this index sheet must match the date shown on the individual truss component drawing.
3. As shown on attached drawings; the drawing number is preceded by: HCUSR8228

Seal Date: 09/05/2007

-Truss Design Engineer-
James F. Collins Jr.
Florida License Number: 52212
1950 Marley Drive
Haines City, FL 33844


Details: A11030EE-GBLLETIN-

#	Ref	Description	Drawing#	Date
1	20111--A1		07248010	09/05/07
2	20112--A-GE		07248011	09/05/07



110 mph wind, 23.62 ft mean hgt, ASCE 7-02, CLOSED bldg, located anywhere in roof, CAT II, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ $G_{CPI}(+/-)=0.18$

Wind reactions based on MWRFS pressures.


$$Cq/RT=1.00(1.25)/0(0)$$

QTY:1

Scale = .25"/Ft.

A PROPERLY ATTACHED RIGID CEILING

ALPINE

ITW Building Components Group, Inc.

FL Certificate of Authorization # 667



TC LL	20.0 PSF	REF	R8228- 20111
TC DL	10.0 PSF	DATE	09/05/07
BC DL	10.0 PSF	DRW	HCUS8228 07248010
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEQN-	47334
DUR.FAC.	1.25		
SPACING	24.0"	JREF-	1TA18228Z05

110 mph wind, 24.00 ft mean hgt, ASCE 7-02, CLOSED bldg, located anywhere in roof, CAT 11, EXP B, wind TC DL=5.0 psf, wind BC DL=5.0 psf. $I_w=1.00$ GCPI (+/-)=0.18

See DWGS A11030FE0207 & GBLLETIN0207 for more requirements.

Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.

-
-
-
-

Deflection meets L/240 live and L/180 total load. Creep increase factor for dead load is 1.50.



Design Crit: TPI-2002(STD)/FBC

$$Cq/RT=1.00(1.25)/0(0)$$

QTY:1

Scale = .25"/Ft.

JAMES F. COLLINS
JAN 19 1964
JAN 19 1964
JAN 19 1964

ALPINE

ITW Building Components Group, Inc.
Haines City, FL 33844
FPI Certificate of Authorization # 657

ITW Building Components Group, Inc.
Haines City, FL 33844
FL Certificate of Authorization # 567




STATE OF
FLORIDA
PROFESSIONAL ENGINEER

TC LL	20.0 PSF	REF	R8228- 20112
TC DL	10.0 PSF	DATE	09/05/07
BC DL	10.0 PSF	DRW	HCU8R8228 07248011
BC LL	0.0 PSF	HC-ENG	SSB/AP
TOT.LD.	40.0 PSF	SEON -	47339
DUR.FAC.	1.25	FROM	AH
SPACING	SEE ABOVE	JREF -	1TA18228Z05

MAX GABLE VERTICAL LENGTH														
2x4 GABLE VERTICAL SPECIES	BRACE GRADE	NO BRACES	(1) 1x4 "L" BRACE *		(1) 2x4 "L" BRACE *		(2) 2x4 "L" BRACE **		(1) 2x6 "L" BRACE *		(2) 2x6 "L" BRACE *		(2) 2x6 "L" BRACE **	
			GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B	GROUP A	GROUP B
24" O.C.	SPF	#1 / #2	3' 8"	6' 4"	6' 6"	7' 6"	7' 8"	8' 11"	9' 2"	11' 9"	12' 1"	14' 0"	14' 0"	14' 0"
		#3	3' 7"	5' 5"	5' 5"	7' 2"	7' 2"	8' 11"	8' 11"	11' 2"	11' 2"	14' 0"	14' 0"	
		STUD	3' 7"	5' 5"	5' 5"	7' 1"	7' 1"	8' 11"	8' 11"	11' 1"	11' 1"	14' 0"	14' 0"	
	HF	STANDARD	3' 7"	4' 8"	4' 8"	6' 1"	6' 1"	8' 3"	8' 3"	9' 6"	9' 6"	12' 11"	12' 11"	
		#1	4' 0"	6' 4"	6' 10"	7' 6"	8' 1"	8' 11"	9' 7"	11' 9"	12' 8"	14' 0"	14' 0"	
		#2	3' 11"	6' 4"	6' 10"	7' 6"	8' 1"	8' 11"	9' 7"	11' 9"	12' 8"	14' 0"	14' 0"	
	SP	#3	3' 9"	5' 7"	5' 7"	7' 4"	7' 4"	8' 11"	9' 5"	11' 5"	11' 5"	14' 0"	14' 0"	
		STUD	3' 9"	5' 6"	5' 6"	7' 3"	7' 3"	8' 11"	9' 5"	11' 4"	11' 4"	14' 0"	14' 0"	
		STANDARD	3' 8"	4' 9"	4' 9"	6' 3"	6' 3"	8' 5"	8' 5"	9' 9"	9' 9"	13' 3"	14' 0"	
	DFL	#1 / #2	4' 2"	7' 3"	7' 5"	8' 7"	8' 10"	10' 3"	10' 6"	13' 5"	13' 10"	14' 0"	14' 0"	
		#3	4' 1"	6' 8"	6' 8"	8' 7"	8' 7"	10' 3"	10' 3"	13' 5"	13' 5"	14' 0"	14' 0"	
		STUD	4' 1"	6' 0"	8' 0"	8' 7"	8' 7"	10' 3"	10' 3"	13' 5"	13' 5"	14' 0"	14' 0"	
16" O.C.	SPF	STANDARD	4' 1"	5' 8"	5' 8"	7' 6"	7' 6"	10' 1"	10' 1"	11' 8"	11' 8"	14' 0"	14' 0"	
		#1	4' 7"	7' 3"	7' 9"	8' 7"	9' 3"	10' 3"	11' 0"	13' 5"	14' 0"	14' 0"		
		#3	4' 4"	6' 10"	6' 10"	8' 7"	9' 0"	10' 3"	10' 9"	13' 5"	14' 0"	14' 0"		
	HF	STUD	4' 4"	6' 9"	6' 9"	8' 7"	8' 11"	10' 3"	10' 9"	13' 5"	14' 0"	14' 0"		
		STANDARD	4' 2"	5' 10"	5' 10"	7' 8"	7' 8"	10' 3"	10' 9"	13' 5"	14' 0"	14' 0"		
		#1 / #2	4' 7"	8' 0"	8' 2"	9' 5"	9' 6"	11' 3"	10' 4"	11' 11"	11' 11"	14' 0"	14' 0"	
	SP	#3	4' 6"	7' 8"	7' 8"	9' 5"	9' 5"	11' 3"	11' 3"	14' 0"	14' 0"	14' 0"		
		STUD	4' 6"	7' 8"	7' 8"	9' 5"	9' 5"	11' 3"	11' 3"	14' 0"	14' 0"	14' 0"		
		STANDARD	4' 6"	8' 0"	8' 7"	9' 5"	8' 8"	11' 3"	11' 3"	13' 6"	13' 6"	14' 0"	14' 0"	
	DFL	#1	5' 1"	8' 0"	8' 7"	9' 5"	10' 2"	11' 3"	12' 1"	14' 0"	14' 0"	14' 0"		
		#2	4' 11"	8' 0"	8' 7"	9' 5"	10' 2"	11' 3"	12' 1"	14' 0"	14' 0"	14' 0"		
		#3	4' 9"	7' 11"	7' 11"	9' 5"	9' 11"	11' 3"	11' 10"	14' 0"	14' 0"	14' 0"		
12" O.C.	SPF	STUD	4' 9"	7' 9"	7' 9"	9' 5"	9' 11"	11' 3"	11' 10"	14' 0"	14' 0"	14' 0"		
		STANDARD	4' 7"	6' 9"	6' 9"	8' 10"	8' 10"	11' 3"	11' 7"	13' 10"	13' 10"	14' 0"		
		#1	4' 7"	7' 3"	7' 9"	8' 7"	9' 3"	10' 3"	11' 0"	13' 5"	14' 0"	14' 0"		
	HF	#3	4' 4"	6' 10"	6' 10"	8' 7"	9' 0"	10' 3"	10' 9"	13' 5"	14' 0"	14' 0"		
		STUD	4' 4"	6' 9"	6' 9"	8' 7"	8' 11"	10' 3"	10' 9"	13' 5"	14' 0"	14' 0"		
		STANDARD	4' 2"	5' 10"	5' 10"	7' 8"	7' 8"	10' 3"	10' 9"	13' 5"	14' 0"	14' 0"		
	SP	#1	4' 7"	8' 0"	8' 2"	9' 5"	9' 6"	11' 3"	10' 4"	11' 11"	11' 11"	14' 0"	14' 0"	
		#2	4' 6"	7' 8"	7' 8"	9' 5"	9' 5"	11' 3"	11' 3"	14' 0"	14' 0"	14' 0"		
		#3	4' 6"	7' 8"	7' 8"	9' 5"	9' 5"	11' 3"	11' 3"	14' 0"	14' 0"	14' 0"		
	DFL	STUD	4' 6"	7' 8"	7' 8"	9' 5"	9' 5"	11' 3"	11' 3"	14' 0"	14' 0"	14' 0"		
		STANDARD	4' 6"	8' 0"	8' 7"	9' 5"	8' 8"	11' 3"	11' 3"	13' 6"	13' 6"	14' 0"	14' 0"	
		#1	5' 1"	8' 0"	8' 7"	9' 5"	10' 2"	11' 3"	12' 1"	14' 0"	14' 0"	14' 0"		

CABLE VERTICAL PLATE SIZES	
VERTICAL LENGTH	NO SPICE
LESS THAN 4' 0"	1x4 OR 2x3
GREATER THAN 4' 0", BUT LESS THAN 11' 6"	2x4
GREATER THAN 11' 6"	2.5x4

+ REFER TO COMMON TRUSS DESIGN FOR
PEAK, SPLICE, AND HEEL PLATES.

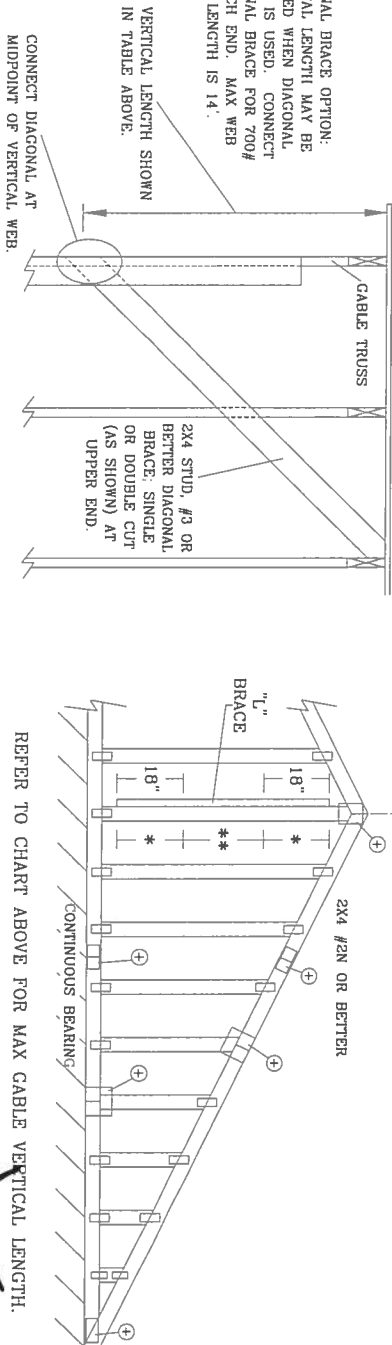

REFER TO CHART ABOVE FOR MAX CABLE VERTICAL LENGTH.

DIAGONAL BRACE OPTION:
VERTICAL LENGTH MAY BE
DOUBLED WHEN DIAGONAL
BRACE IS USED. CONNECT
DIAGONAL BRACE FOR 700#
AT EACH END. MAX WEB
TOTAL LENGTH IS 14'.

VERTICAL LENGTH SHOWN
IN TABLE ABOVE.

CONNECT DIAGONAL AT
MIDPOINT OF VERTICAL WEB



ITW BUILDING COMPONENTS GROUP, INC.
POMPANO BEACH, FLORIDA

BRACING. TRUSSES REQUIRE EXTREME CARE FABRICATING, HANDLING, SHIPPING, INSTALLING AND
 BRACING. REFER TO BGCI BUILDING COMPONENT SAFETY INFORMATION, PUBLISHED BY THE TRUSS PLANT
 INSTITUTE, 218 NORTH LEE ST., SUITE 312, ALEXANDRIA, VA 22314 AND WEA COVID 19 TRUSS CARE
 AMERICA, 6300 ENTERPRISE LN, MADISON, WI 53719. FOR SAFETY PRACTICES PRIOR TO PROCESSING THESE
 FOLDERS. UNLESS OTHERWISE INDICATED, THE CHORD SHALL HAVE PROPERLY ATTACHED STRUCTURAL
 PANELS AND OUTRIG CHORD SHALL HAVE A PROPERLY ATTACHED RIGID CEILING.

NOT BE RESPONSIBLE FOR ANY DEVIATION FROM THIS DESIGN, ANY FAILURE OR BUILD THE TRUSS IN CONFORMANCE WITH TPIU OR FABRICATING, HANDLING, SHIPPING, INSTALLING & BRACING OF TRUSSES.

DESIGN COMPLIANCE WITH APPLICABLE PROVISIONS OF NCS (NATIONAL DESIGN SPEC.) BY A783-04 AND TPI 1-2002 SEC. 3.1.1.1. ALL TRUSS AND PLATE CONNECTIONS SHALL BE MADE OF 2018/1604 (A578/SS40) ASTM A653 GRADE 40/60 (A36/SS490) GALV. STEEL. APPLY PLATES TO EACH FACE OF TRUSS AND, UNLESS OTHERWISE LOCATED ON THIS DESIGN, POSITION PER DRAWINGS 1604-2. ANY INSPECTION OF PLATES FOLLOWED BY (1) SHALL BE PER ANNEX A3 OF TPI 1-2002 SEC. 3. A SEAL ON THIS DRAWING INDICATES ACCEPTANCE OF PROFESSIONAL ENGINEERING RESPONSIBILITY SOLELY FOR THE TRUSS COMPONENT DESIGN SHOWN. THE SUITABILITY AND USE OF THIS COMPONENT FOR ANY BUILDING IS THE RESPONSIBILITY OF THE BUILDING DESIGNER, PER A581/TPI 1 SEC. 2.

STATE OF

MAX. TOT. LD. 60 PSF
MAX. SPACING 24.0"

REF	ASCE7-02-GABI1030
DATE	2/23/07
DRWG	A11030EEO207
-ENG	

