

STATE OF FLORIDA
DEPARTMENT OF HEALTH
APPLICATION FOR ONSITE SEWAGE DISPOSAL SYSTEM CONSTRUCTION PERMIT


Permit Application Number

05-0536

Holmes

PART II - SITEPLAN

Scale: 1 inch = 40 feet.

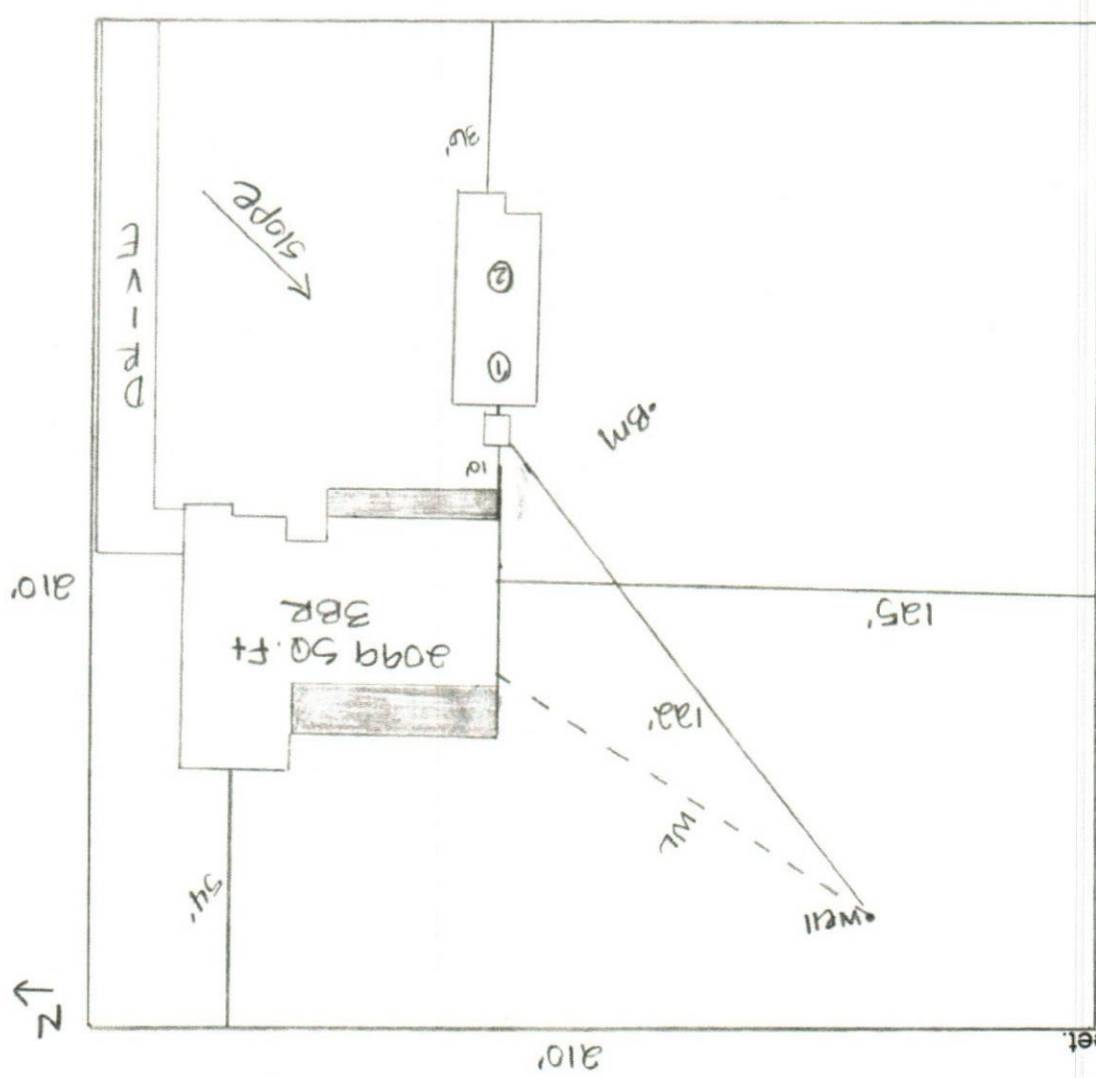

Notes:

Site Plan submitted by: William A. Bishop II
 Plan Approved X Not Approved _____
 By Columbia CHD
 Date 7/18/20
 County Health Department
 MASTER CONTRACTOR

ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 20-0536
DATE PAID: 3/19/20
FEE PAID: 318.00
RECEIPT #: 1524725

APPLICATION FOR:
☒ New System
☐ Repair

☒ Existing System
☐ Holding Tank
☐ Temporary
☐ Innovative

APPLICANT: Thomas Holmes

AGENT: ROCKY FORD, A & B CONSTRUCTION

TELEPHONE: 386-497-2311

MAILING ADDRESS: 546 SW Dortch Street, FT. WHITE, FL, 32038

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3)(m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: NA BLOCK: NA SUB: NA PLATTED:

PROPERTY ID #: 14-55-16-03617-003 ZONING: I/M OR EQUIVALENT: ☒ Y / ☒ N

PROPERTY SIZE: 9.3 ACRES WATER SUPPLY: ☒ PRIVATE PUBLIC ☐ ☐ <=2000GPD ☐ >2000GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? ☒ Y / ☒ N DISTANCE TO SEWER: NA FT

PROPERTY ADDRESS:

Old Wire Rd Lake City FL

DIRECTIONS TO PROPERTY: 47 South Left on Walter Ave cross 240 onto Old Wire Rd to

lot on Right just before Nautilus Rd

gate code 5794

BUILDING INFORMATION

☒ RESIDENTIAL ☐ COMMERCIAL

Unit Type of Establishment No. of Bedrooms Building Area Sqft Commercial/Institutional System Design

1

SF Residential

3

2099

2

3

☐ Floor/Equipment Drains ☐ Other (Specify)

SIGNATURE:

William D. Bishop II

DATE: 7/8/2020



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

PERMIT #: 12-SC-2108034
APPLICATION #: AP1524725
DATE PAID: 7/5/20
FEE PAID: 30.00
RECEIPT #:
DOCUMENT #: PR1377459

CONSTRUCTION PERMIT FOR: OSTDS New

APPLICANT: THOMAS**0536 HOLMES

PROPERTY ADDRESS: OLD WIRE Rd Fort White, FL 32038

LOT: BLOCK: SUBDIVISION:

PROPERTY ID #: 03617-003 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T 900 GALLONS / GPD Septic Tank N/A CAPACITY
A 1 GALLONS / GPD N/A CAPACITY
N 1 GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]
K 1 GALLONS DOSING TANK CAPACITY [GALLONS @] [DOSES PER 24 HRS #pumps]
D 462 SQUARE FEET Drainfield N/A SYSTEM
R 1 SQUARE FEET N/A SYSTEM
A TYPE SYSTEM: [X] STANDARD [] FILLED [] MOUND []
I CONFIGURATION: [X] TRENCH [] BED []
N LOCATION OF BENCHMARK: Nail in oak S. of site.

I ELEVATION OF PROPOSED SYSTEM SITE [12.00] [INCHES] [FT] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT
E BOTTOM OF DRAINFIELD TO BE [31.00] [INCHES] [FT] [ABOVE / BELOW] BENCHMARK/REFERENCE POINT
D FILL REQUIRED: [0.00] INCHES EXCAVATION REQUIRED: [0.00] INCHES

The system is sized for 3 bedrooms with a maximum occupancy of 6 persons (2 per bedroom), for a total estimated flow of 300 gpd.

SPECIFICATIONS BY: WILLIAM D BISHOP TITLE: SA0890009, SM0081587

APPROVED BY: DUSTIN W JONES
DATE ISSUED: 07/13/2020
TITLE: Environmental Specialist II
Columbia CHD
EXPIRATION DATE: 01/13/2022

DH 4016, 08/09 (Obsoletes all previous editions which may not be used)
Incorporated: 64E-6.003, FAC