

SQUARE FOOTAGES		
AREA	SQ. FT.	
CABANA / LANAI	516 SF	
ENTRY	142 SF	
GARAGE	544 SF	
LIVING	2242 SF	
NON AC STORAGE	41 SF	
TOTAL	3485 SF	

- GENERAL NOTES:**
- ALL WDKS TO HAVE FLUSH SILLS, PITCH TOP OF SILL FIN AWAY FROM WDM FRAME.
 - VERIFY ALL WDM & DR ROUGH OPNGS W/ MFR SPECS. SEE PLAN FOR WDM HDR HTS.
 - VERIFY DEPTH AND WIDTH OF SLAB RECESS AT ALL DOORS TO ACCOMMODATE PROPER ALIGNMENT WITH THRESHOLDS AND DOOR TRACKS WITH MFR. REQUIREMENTS IN RELATION TO FINISH FLOOR MATERIALS.
 - REC CLG SURFACES, BOTH HORIZONTAL AND VERTICAL, SHALL HAVE SMOOTH FIN.
 - PROVIDE SOLID FILLED CONC. BLOCK AT ALL SHOWER SEALS.
 - INTERIOR WALL FINISH TO BE ORANGE PEE.
 - INTERIOR WALL CORNER BEAD TO BE SQUARE
 - INTERIOR CEILING FINISH TO BE SINGLE KNOCKDOWN






ARTHUR RUTENBERG HOMES, INC. 07/10/17-R0N-A-1 07/10/17-R0N-A-2

THE ANTIGUA 1441F - L-GREEN RESIDENCE
BUILDER: BRYAN ZECHER HOMES, INC.
LAKE CITY, FLORIDA
AN INDEPENDENTLY OWNED AND OPERATED FRANCHISE

FLOOR PLAN
CLG 1441F-25-01-15
JOB 88-TIO-A-2



5

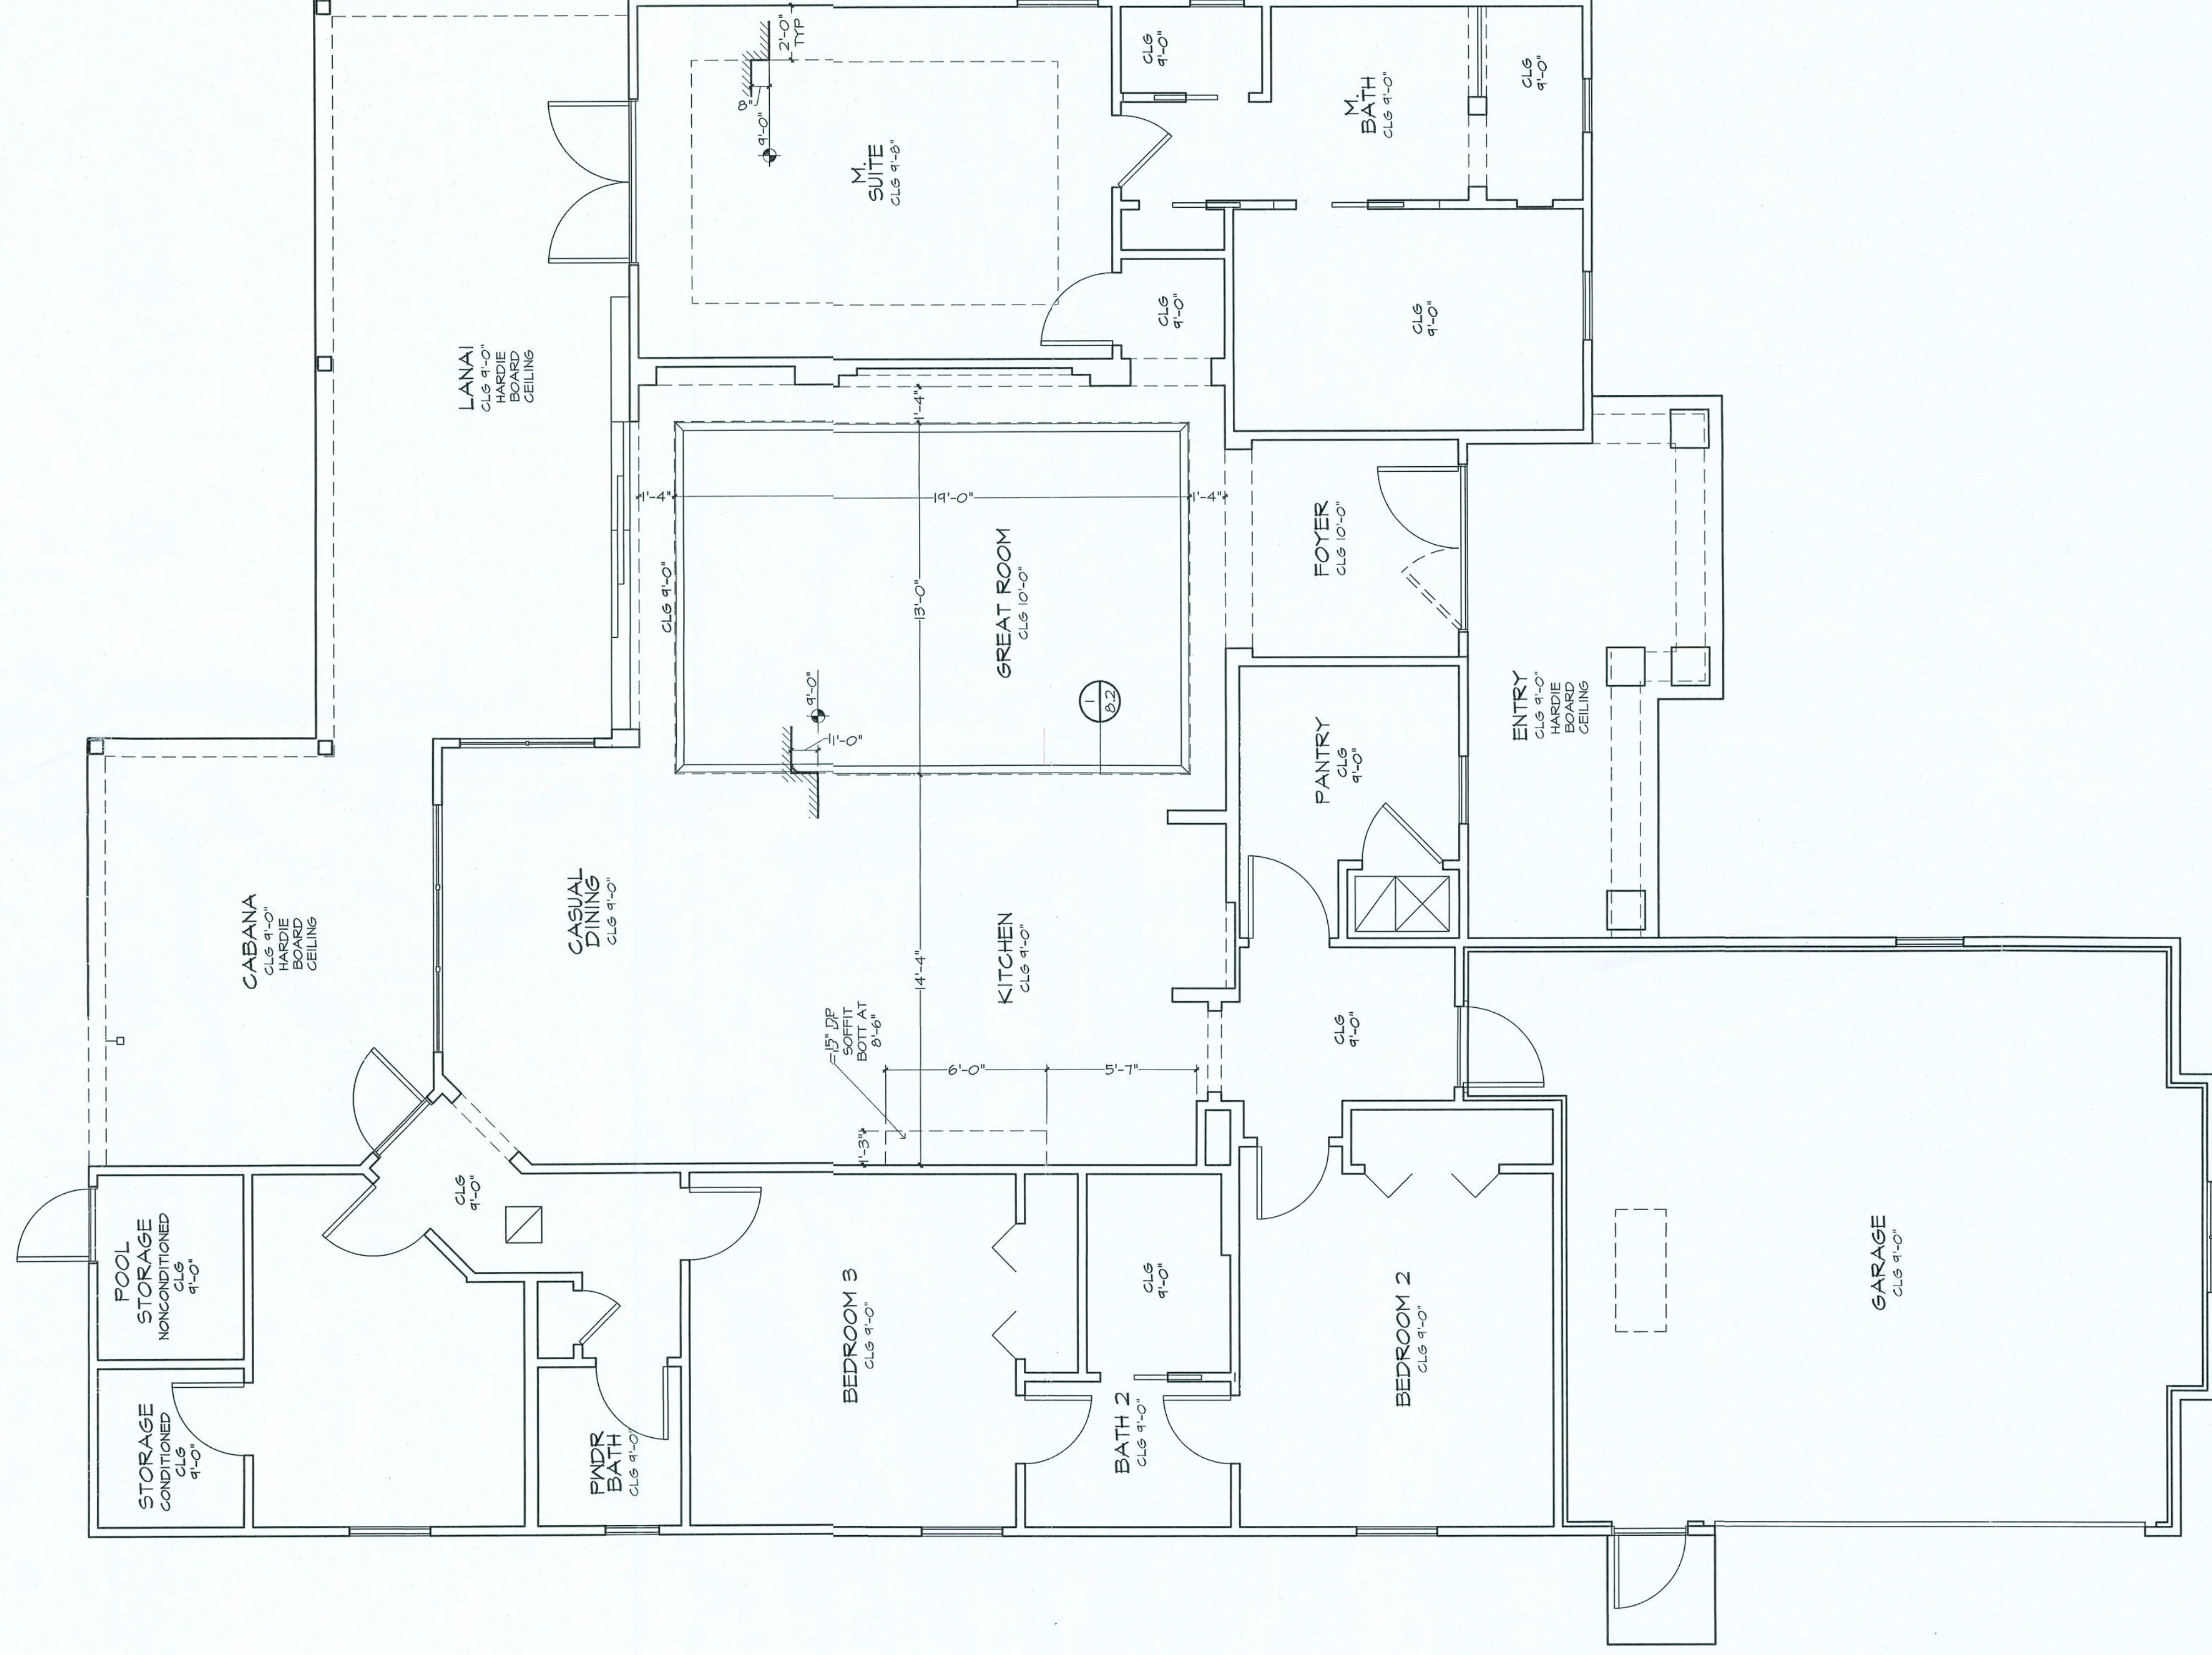

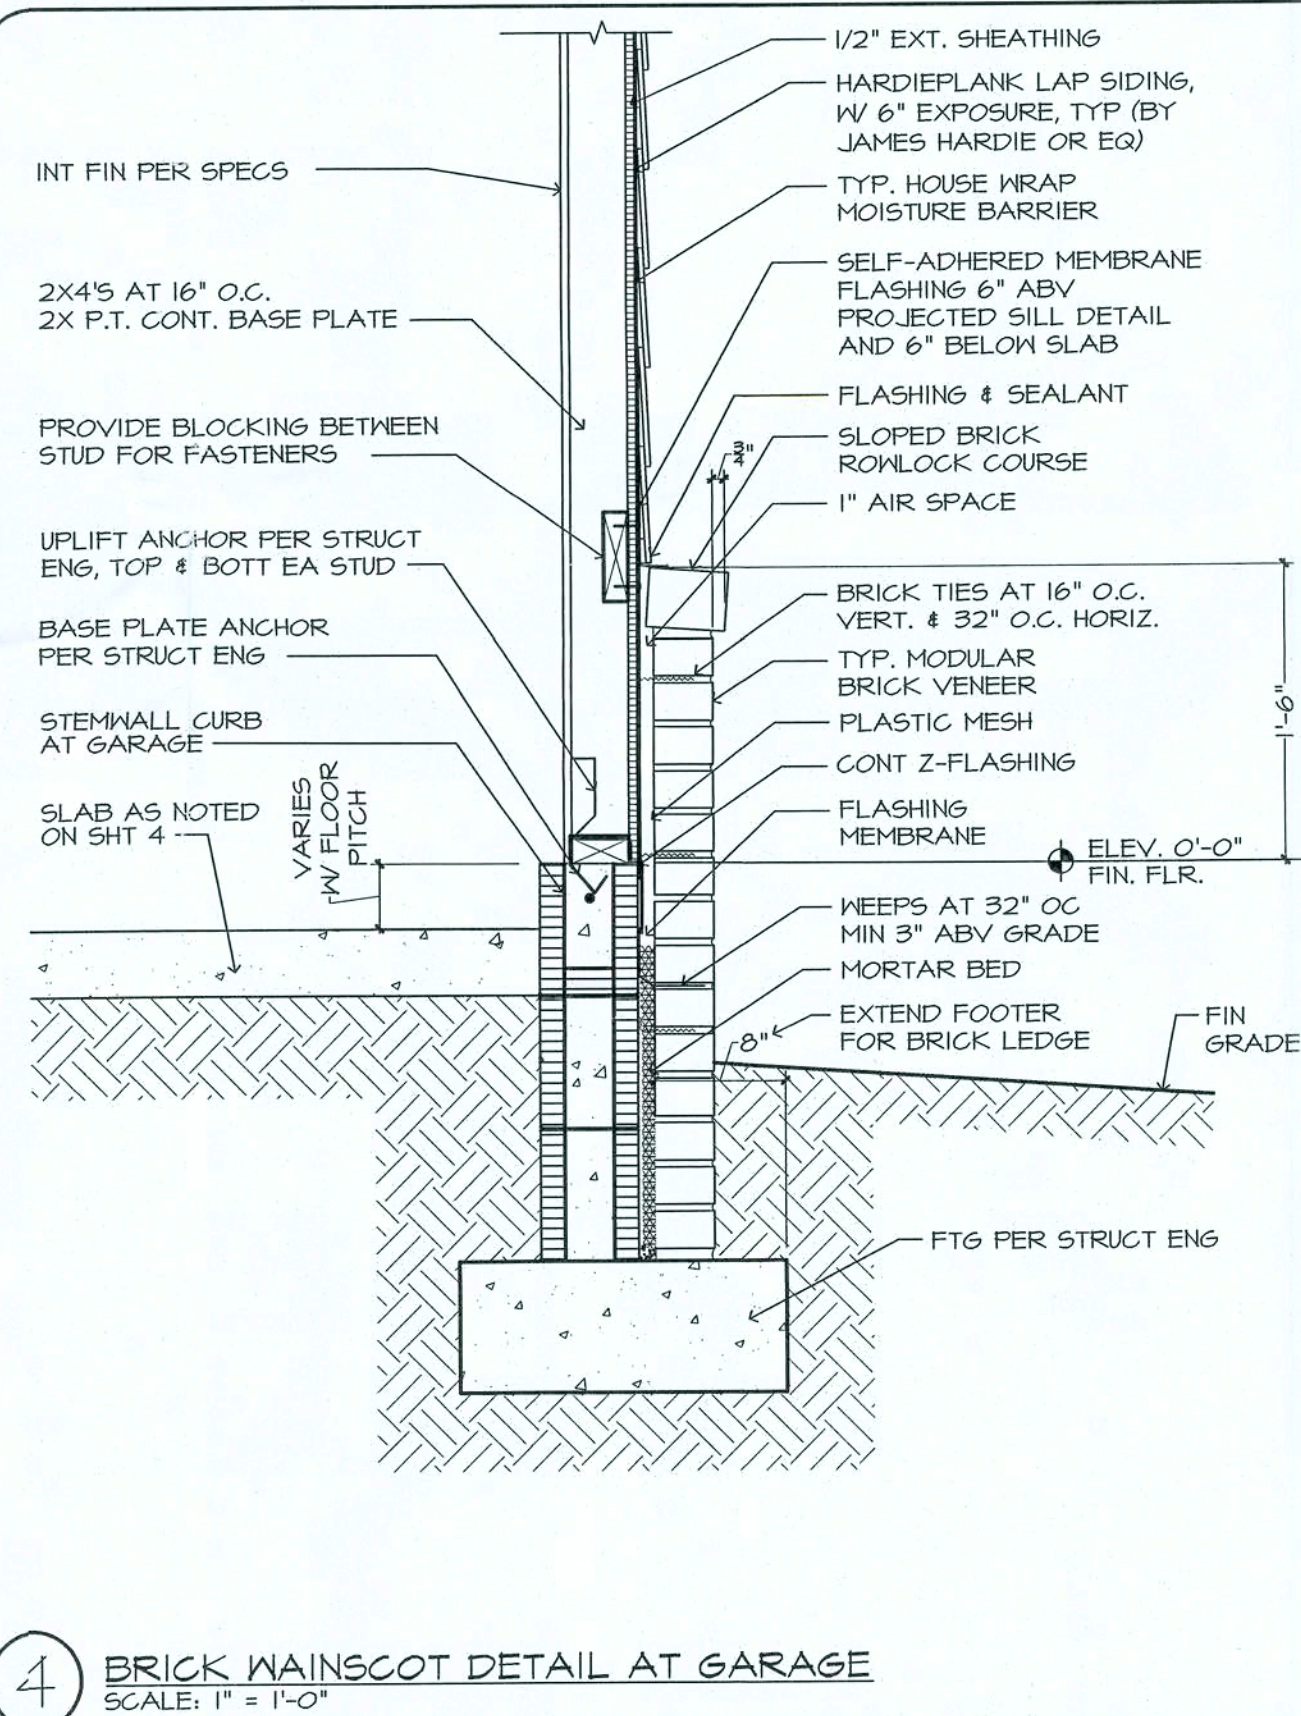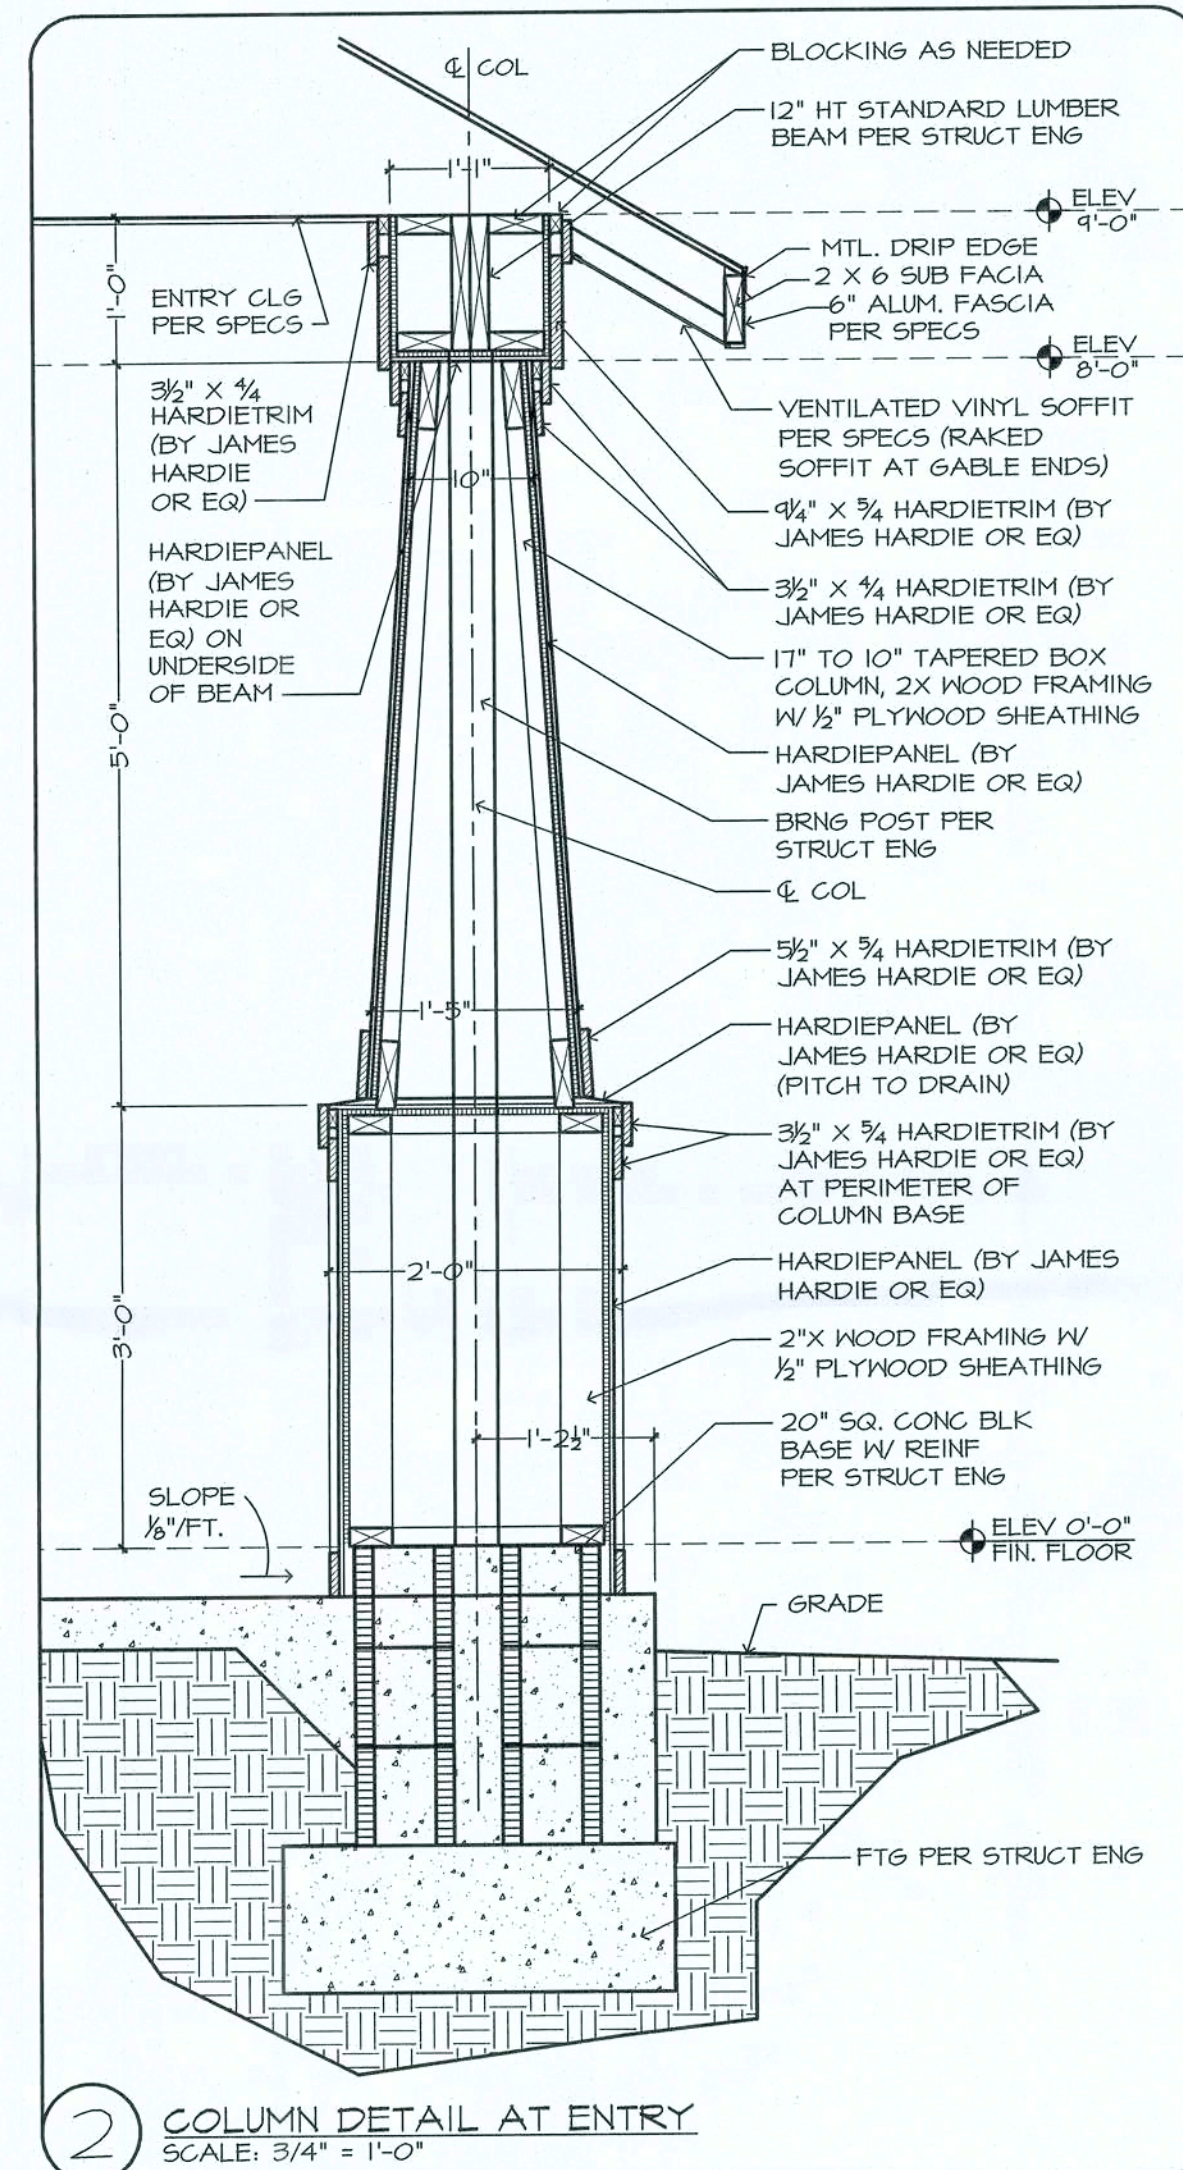

- FLAT SOFFIT AT PERIMETER OF HOUSE UNLESS NOTED OTHERWISE.
- VERIFY ALL INDW & DR ROUGH OPENGS W/ MFR SPECS.
- LOCATE ALL PLUMBING STACKS BEYOND THE FRONT ELEV ROOF RIDGES, IF ALLOWABLE PER CODE.
- ROOF VENTS SHOWN FOR LOCATION PURPOSE ONLY
- NUMBER OF ROOF VENTS TO BE DETERMINED BY BUILDER

THE FRAMING PLANS REPRESENTED IN THESE DRAWINGS ARE INTENDED TO ESTABLISH THE PROPOSED FRAMING MEMBER LOCATIONS, FRAMING MEMBER DEPTH, POTENTIAL BEARING LOCATIONS AND ELEVATIONS. THIS IS IN NO WAY INTENDED TO BE INTERPRETED AS A STRUCTURAL ENGINEERED DRAWING. THE CONTRACTOR (BUILDER) SHALL ENSURE THAT THE STRUCTURE CONFORMS TO THOSE STANDARDS IN ALL RESPECTS INCLUDING STRENGTH, STRESSES, STRAINS, LOADS, CONNECTIONS, AND STABILITY. REFER TO PLAN DISCLAIMER LOCATED ON THIS SHEET FOR ADDITIONAL STIPULATIONS AND REQUIREMENTS.

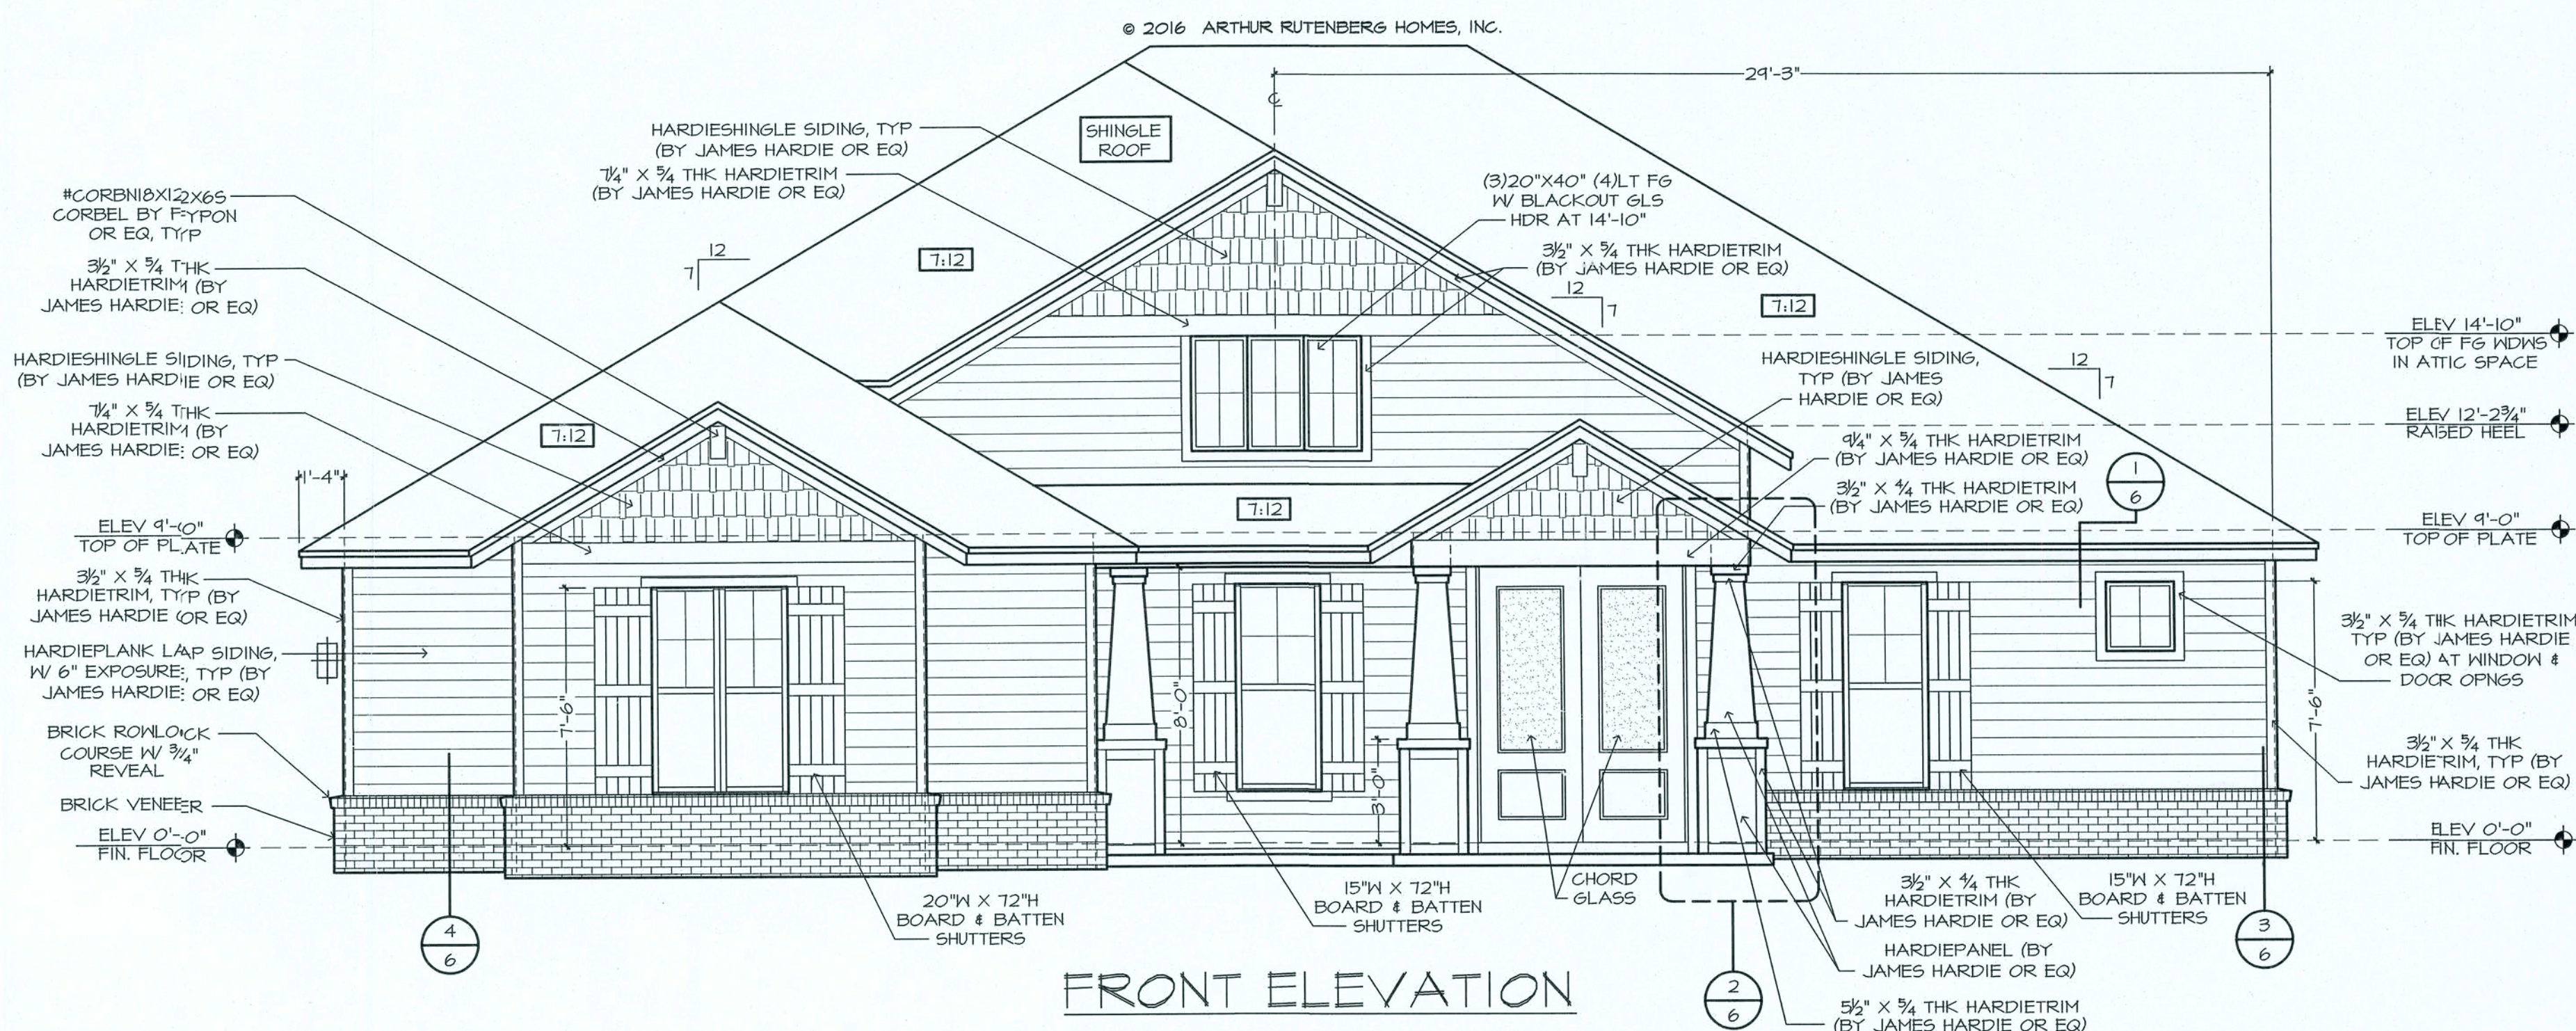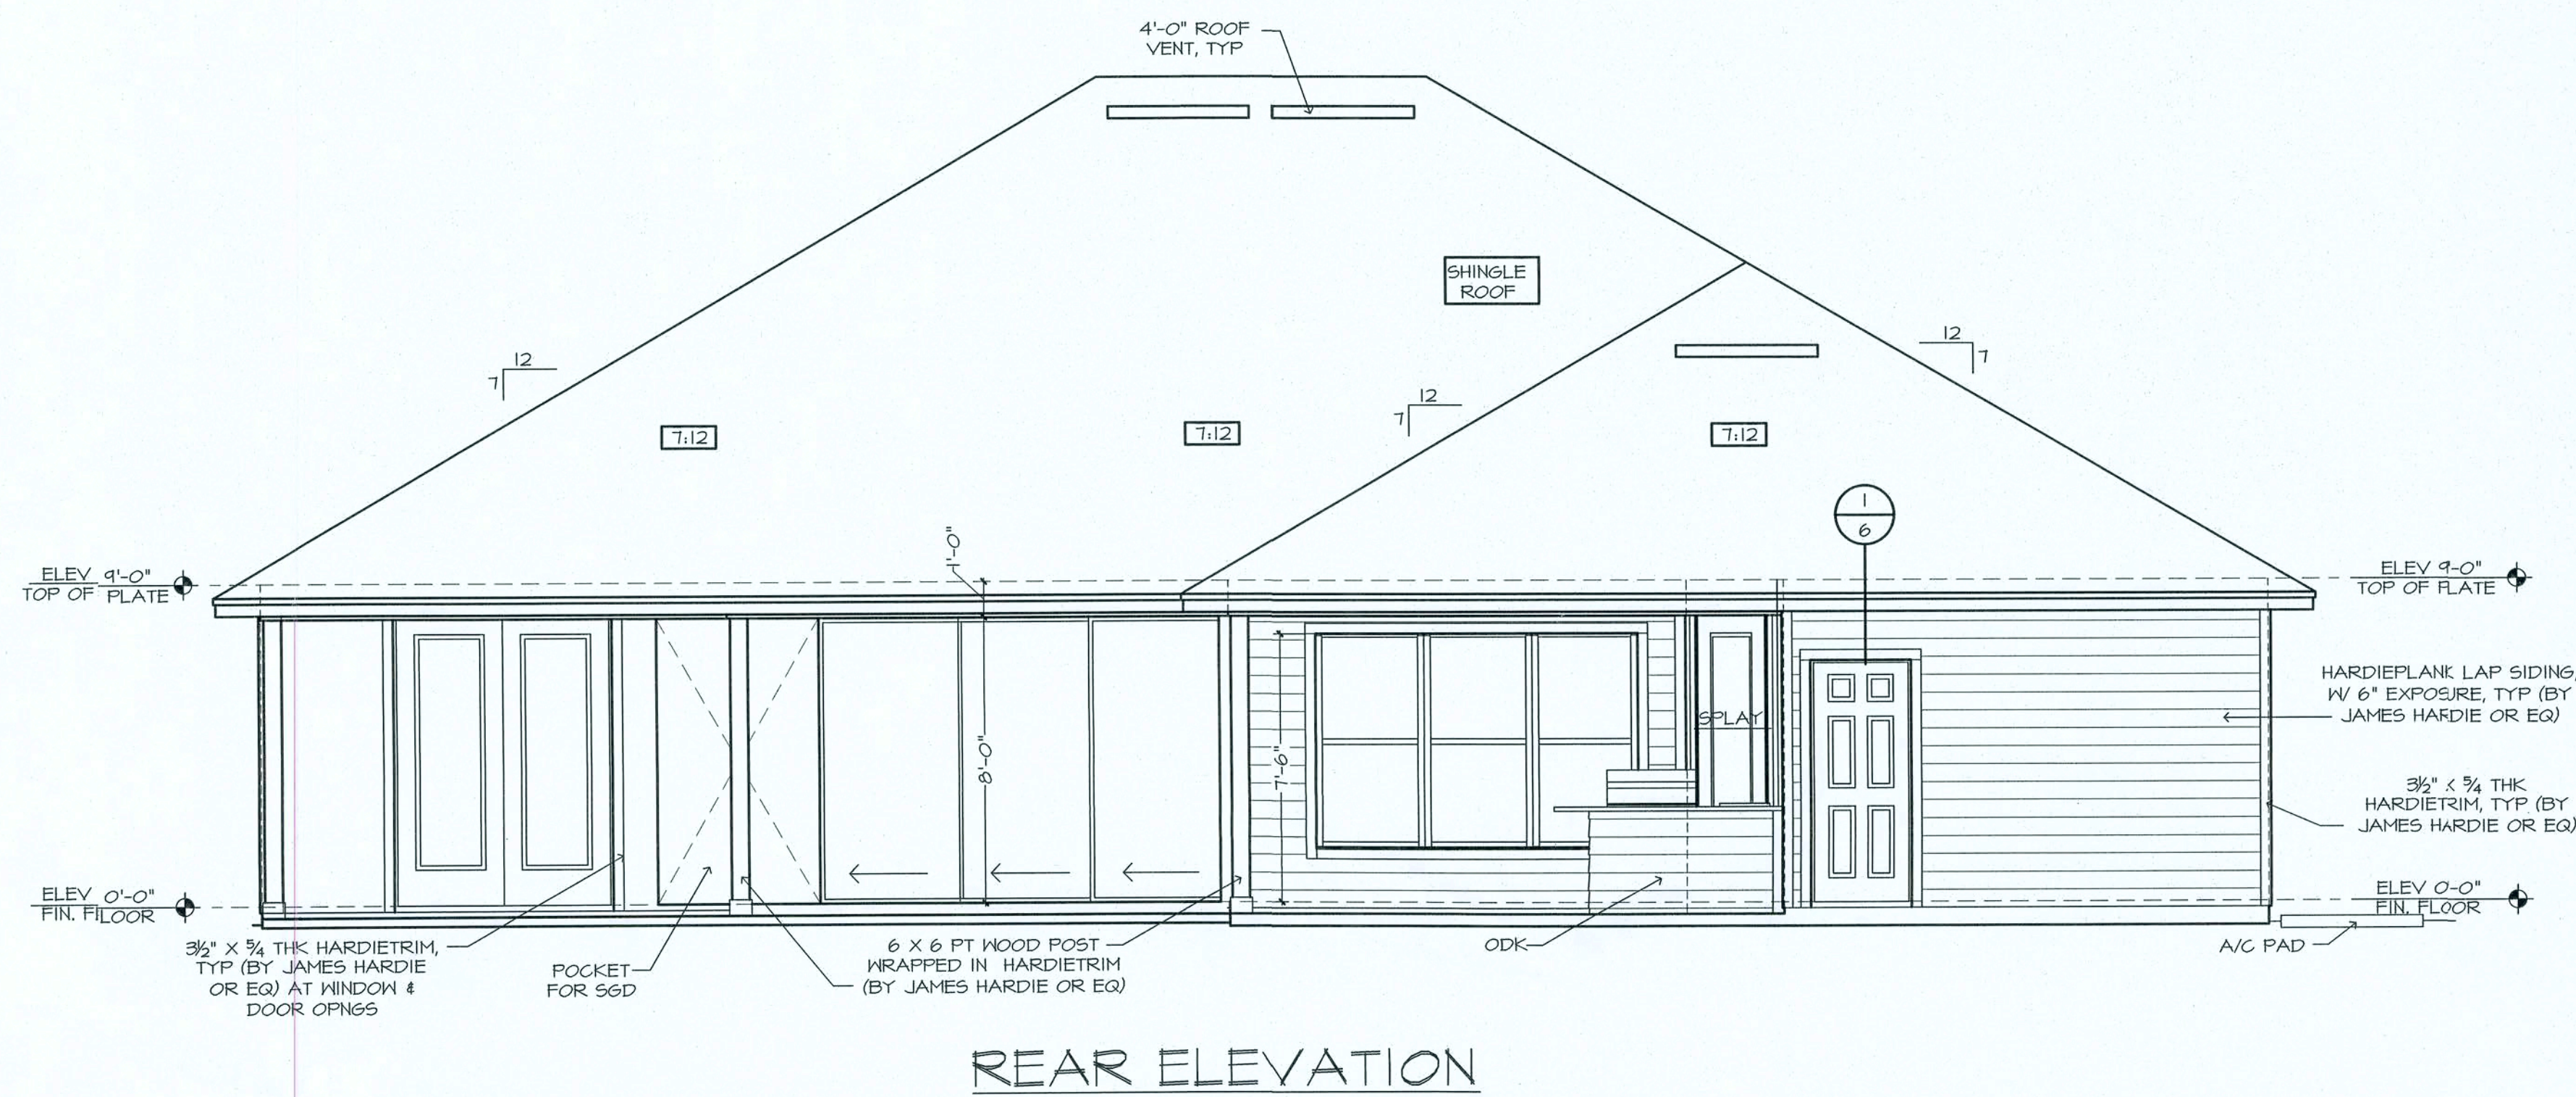

 Arthur Rutenbergsm
Homes

COPYRIGHT
ARTHUR RUTENBERG HOMES, INC.

07/05/17-RDW-A
07/07/17-RDW-A-1
07/10/17-RDW-A-2

[illegible]



THE ANTIGUA 1441F - L-GREEN RESIDENCE
BUILDER: **BRYAN ZECHER HOMES, INC.**
LAKE CITY, FLORIDA

SIDE ELEVATIONS

PLAN 144F-25-01-B*
C1139 I-70
C1139 I-70

24X36; 1/4" = 1'-0"
12X18; 1/8" = 1'-0"

6 a

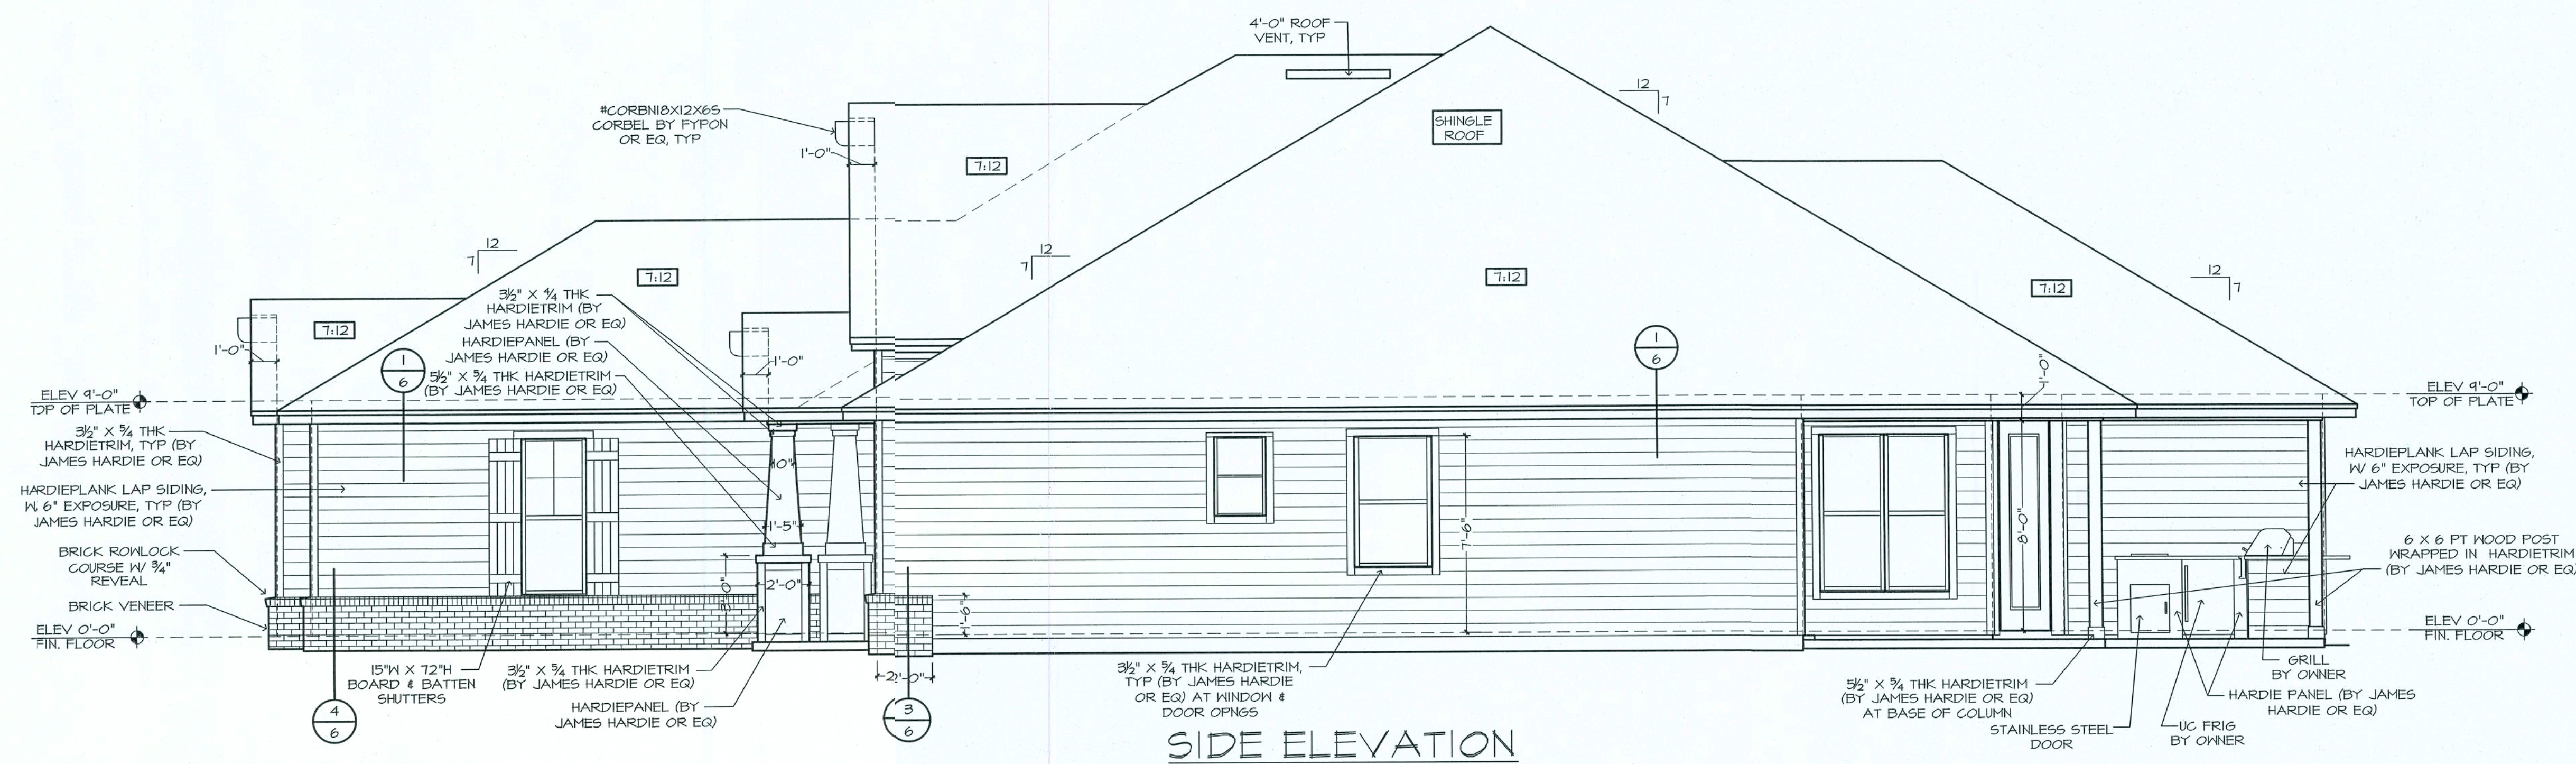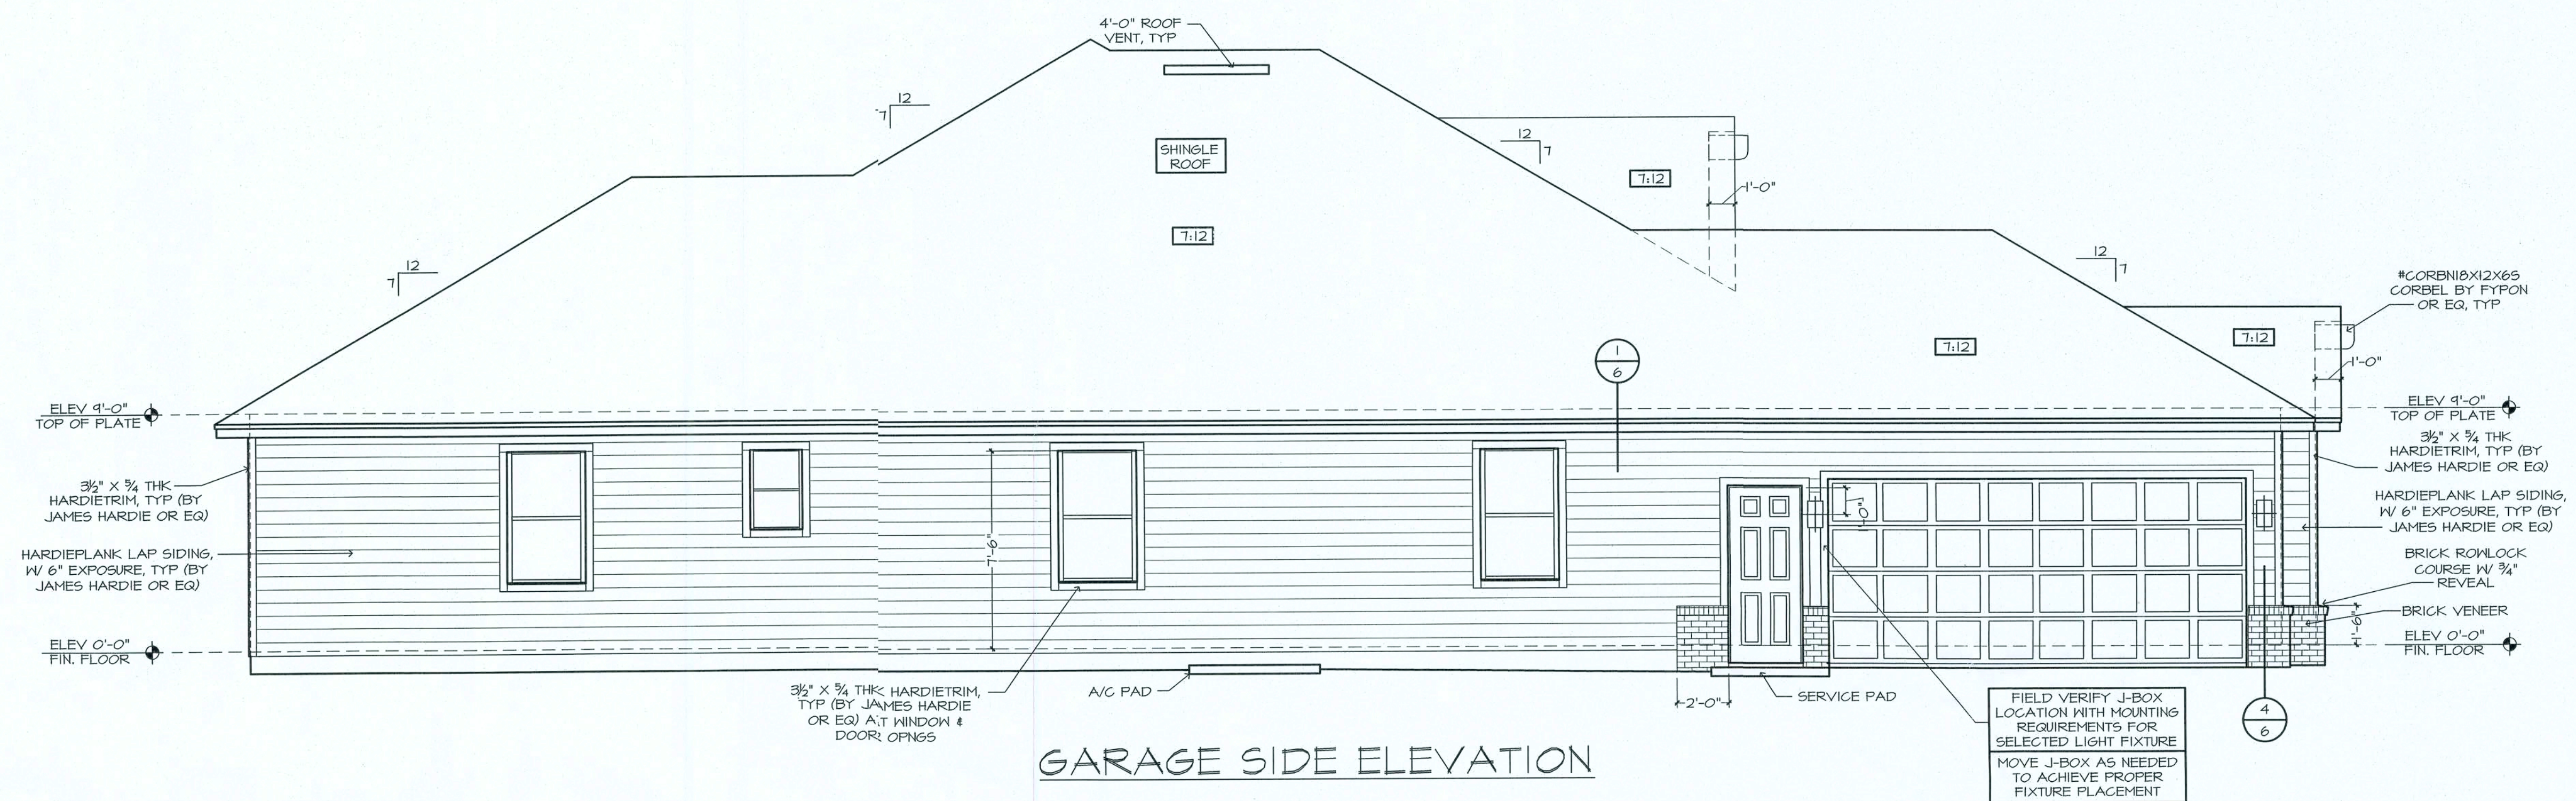


FRAMING PLAN DISCLAIMER


THE FRAMING PLANS REPRESENTED IN THESE DRAWINGS ARE INTENDED TO ESTABLISH PROPOSED FRAMING MEMBER LOCATIONS, FRAMING MEMBER DEPTH, POTENTIAL BEARING LOCATIONS AND ELEVATIONS, AND IS IN NO WAY INTENDED TO BE INTERPRETED AS STRUCTURAL ENGINEERED DRAWINGS. THE CONTRACTOR (BUILDER) SHALL ENSURE THAT THE STRUCTURE CONFORMS TO THOSE STANDARDS IN ALL RESPECTS INCLUDING STRENGTH, STRESSES, STRAINS, LOADS, CONNECTIONS, AND STABILITY. REFER TO PLAN DISCLAIMER LOCATED ON THIS SHEET FOR ADDITIONAL STIPULATIONS AND REQUIREMENTS.

MECHANICAL DISCLAIMER

ANY DUCT ROUTING AND HVAC EQUIPMENT SHOWN ON THESE DRAWINGS ARE DIAGRAMATIC ONLY. THE BUILDER IS SOLELY RESPONSIBLE FOR COORDINATING ALL ASPECTS OF MECHANICAL INSTALLATION WITH ALL TRADES. THE BUILDER SHALL COORDINATE BETWEEN THE PRE-ENGINEERED TRUSS MFR. AND/OR FRAMING REQUIREMENTS WITH THE MECHANICAL CONTRACTOR TO ENSURE ADEQUATE SPACE FOR DUCT ROUTING AND EQUIPMENT PLACEMENT AND SUPPORT. HVAC INSTALLATION SHALL BE INSTALLED ACCORDING TO ALL CURRENT STATE AND LOCAL MECHANICAL CODES.

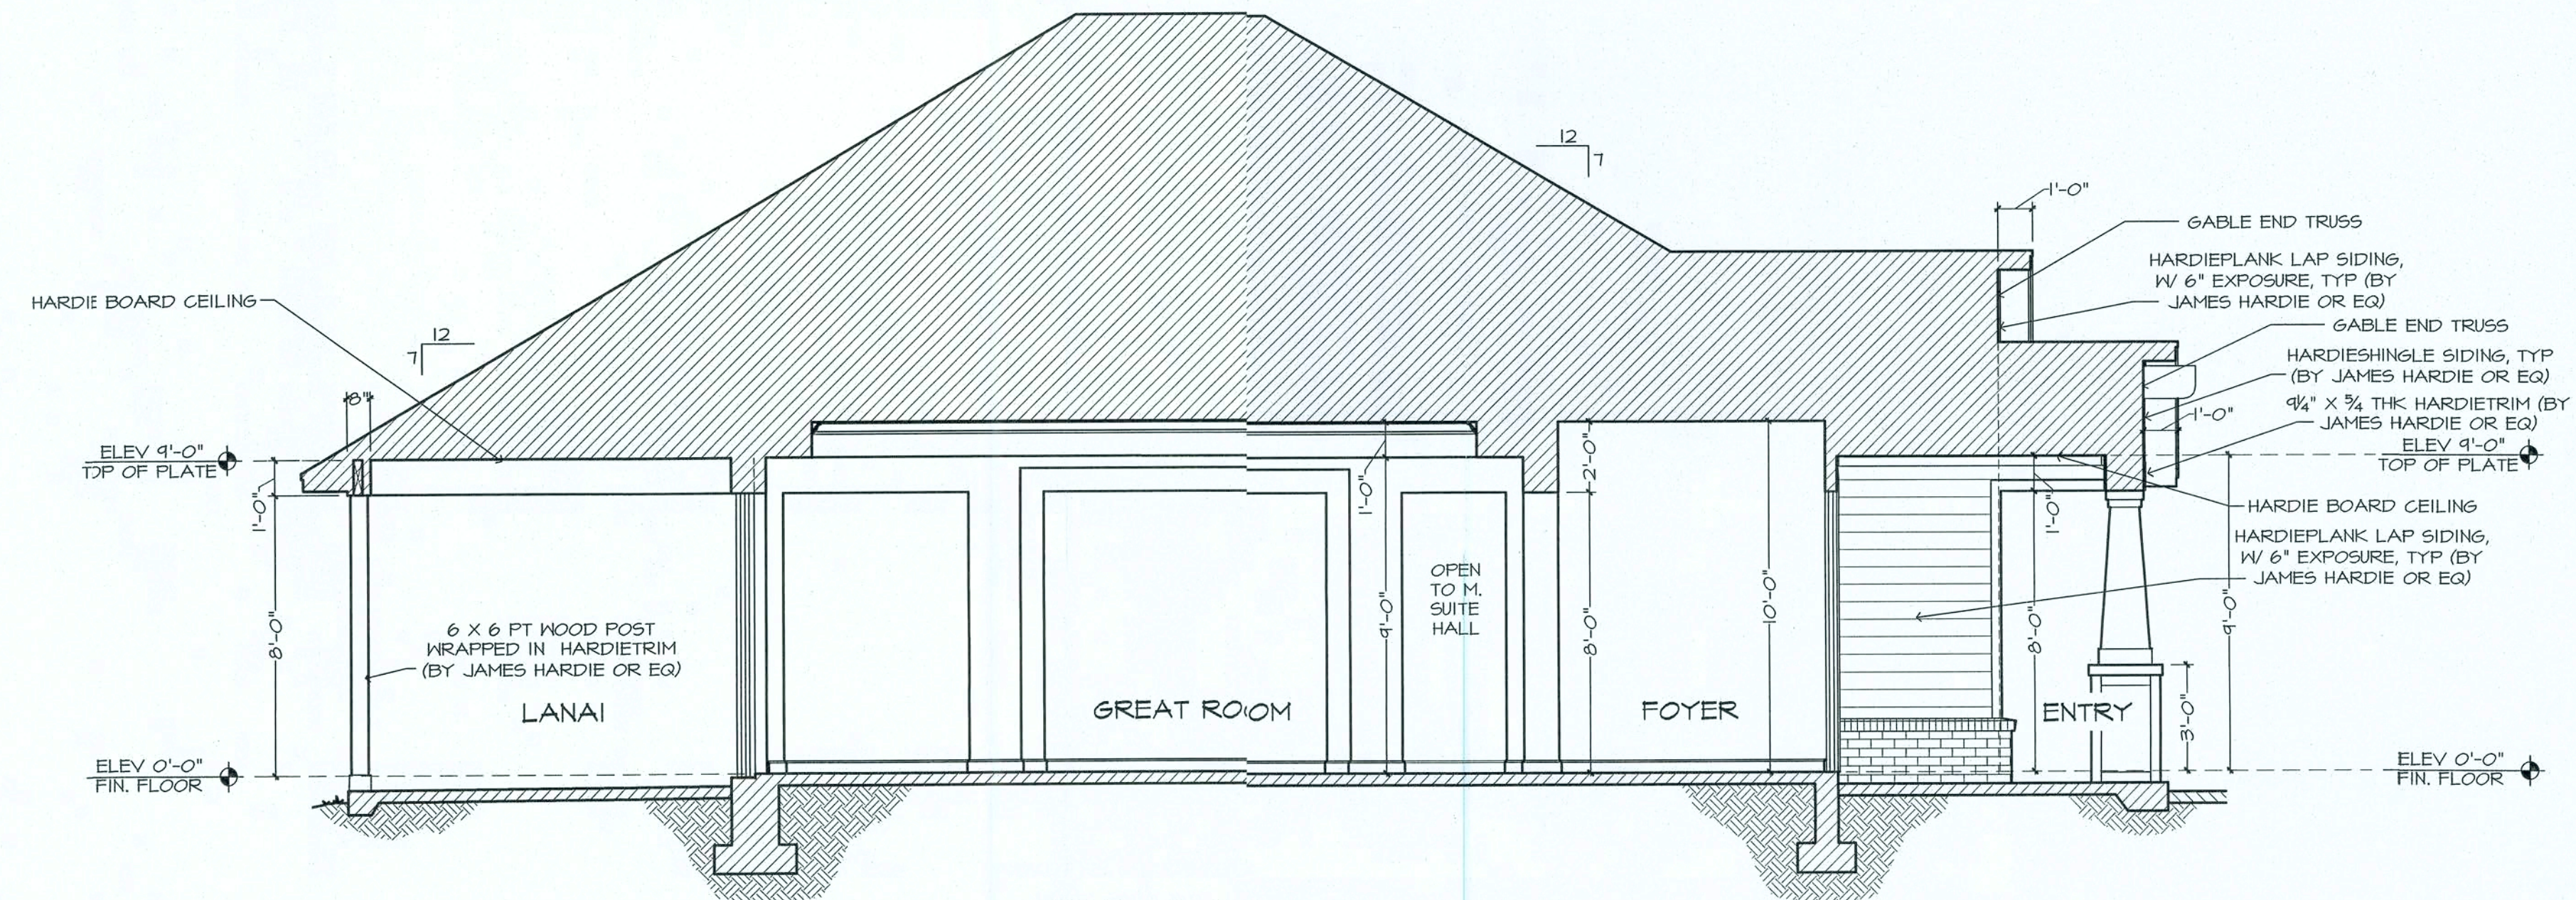

A BUILDING SECTION

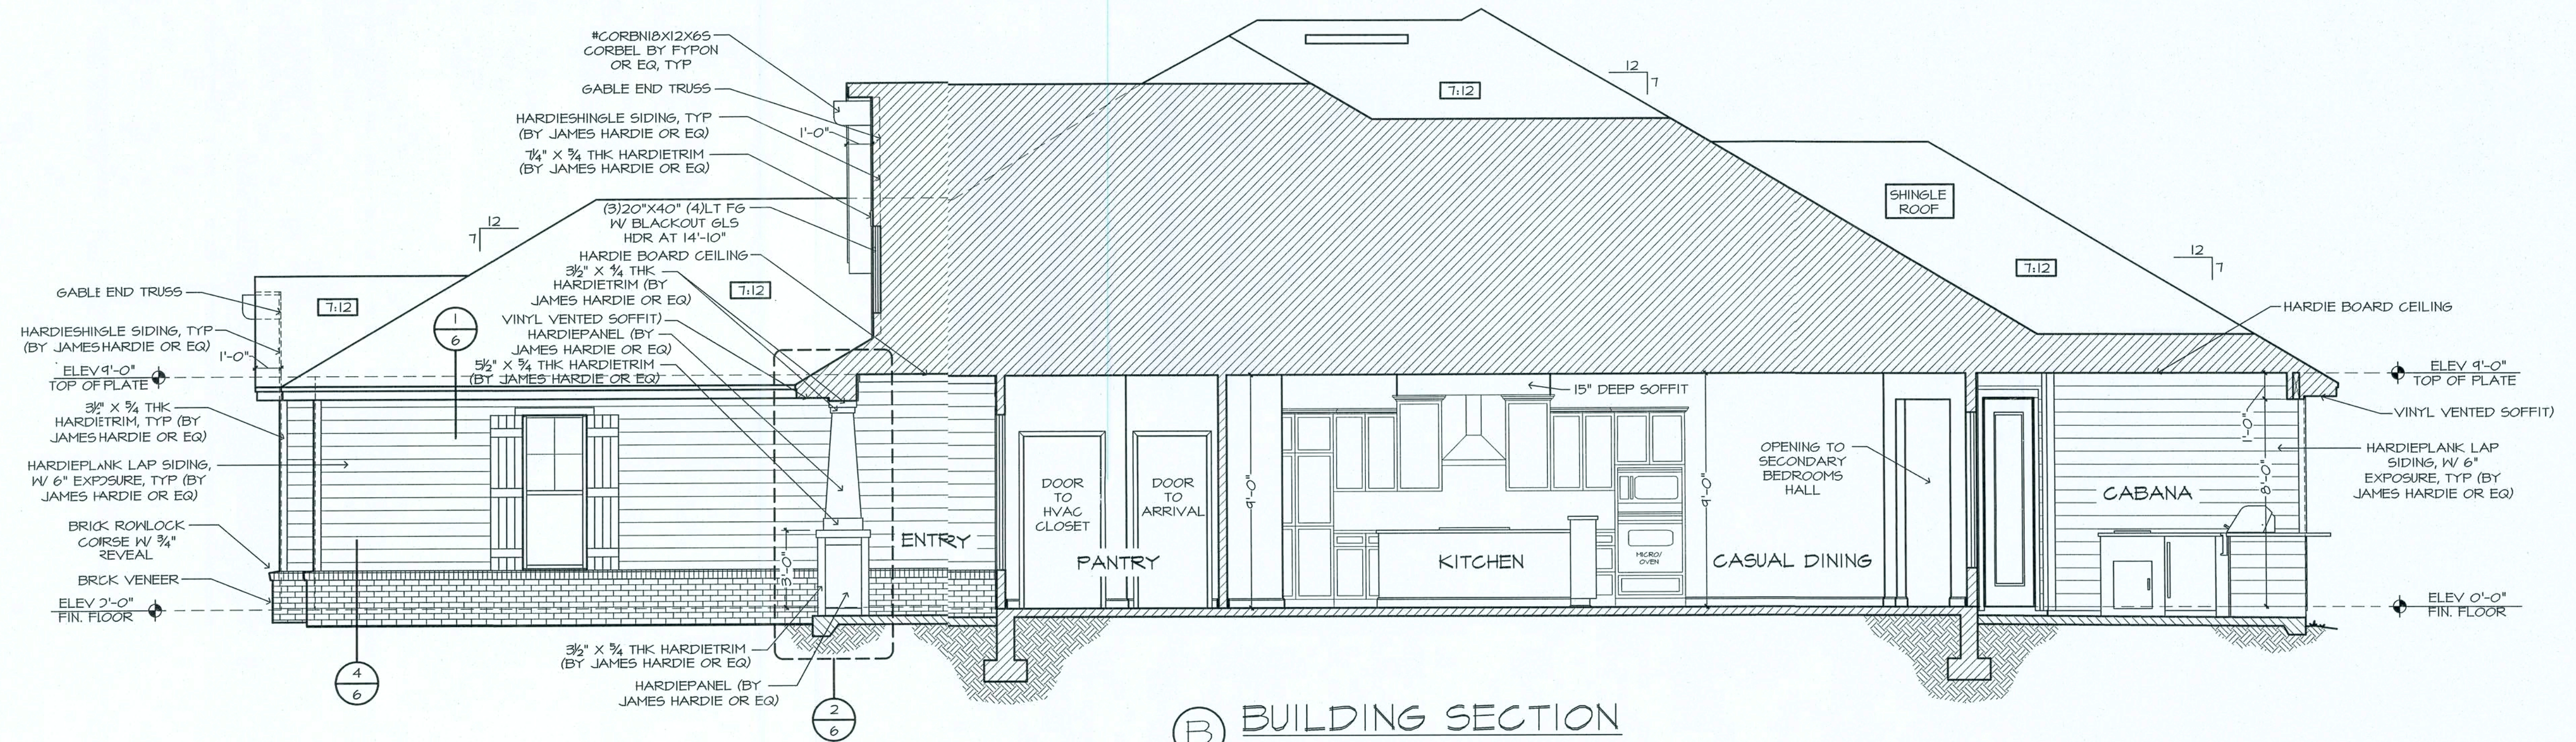


B BUILDING SECTION

THE CONTRACTOR (BUILDER) IS RESPONSIBLE FOR COORDINATING ALL ASPECTS OF MECHANICAL INSTALLATION WITH ALL TRADES. THE BUILDER SHALL COORDINATE BETWEEN THE PRE-ENGINEERED TRUSS MFR. AND/OR FRAMING REQUIREMENTS WITH THE MECHANICAL CONTRACTOR TO ENSURE ADEQUATE SPACE FOR DUCT ROUTING AND EQUIPMENT PLACEMENT AND SUPPORT. HVAC INSTALLATION SHALL BE INSTALLED ACCORDING TO ALL CURRENT STATE AND LOCAL MECHANICAL CODES.

THE ANTIGUA 1441F - L-GREEN RESIDENCE
BUILDER: BRYAN ZECHER HOMES, INC.
LAKE CITY, FLORIDA
AN INDEPENDENTLY OWNED AND OPERATED FRANCHISE

BUILDING SECTIONS
PLAN 1441F-25-01-B
UD# 88-710-A-2

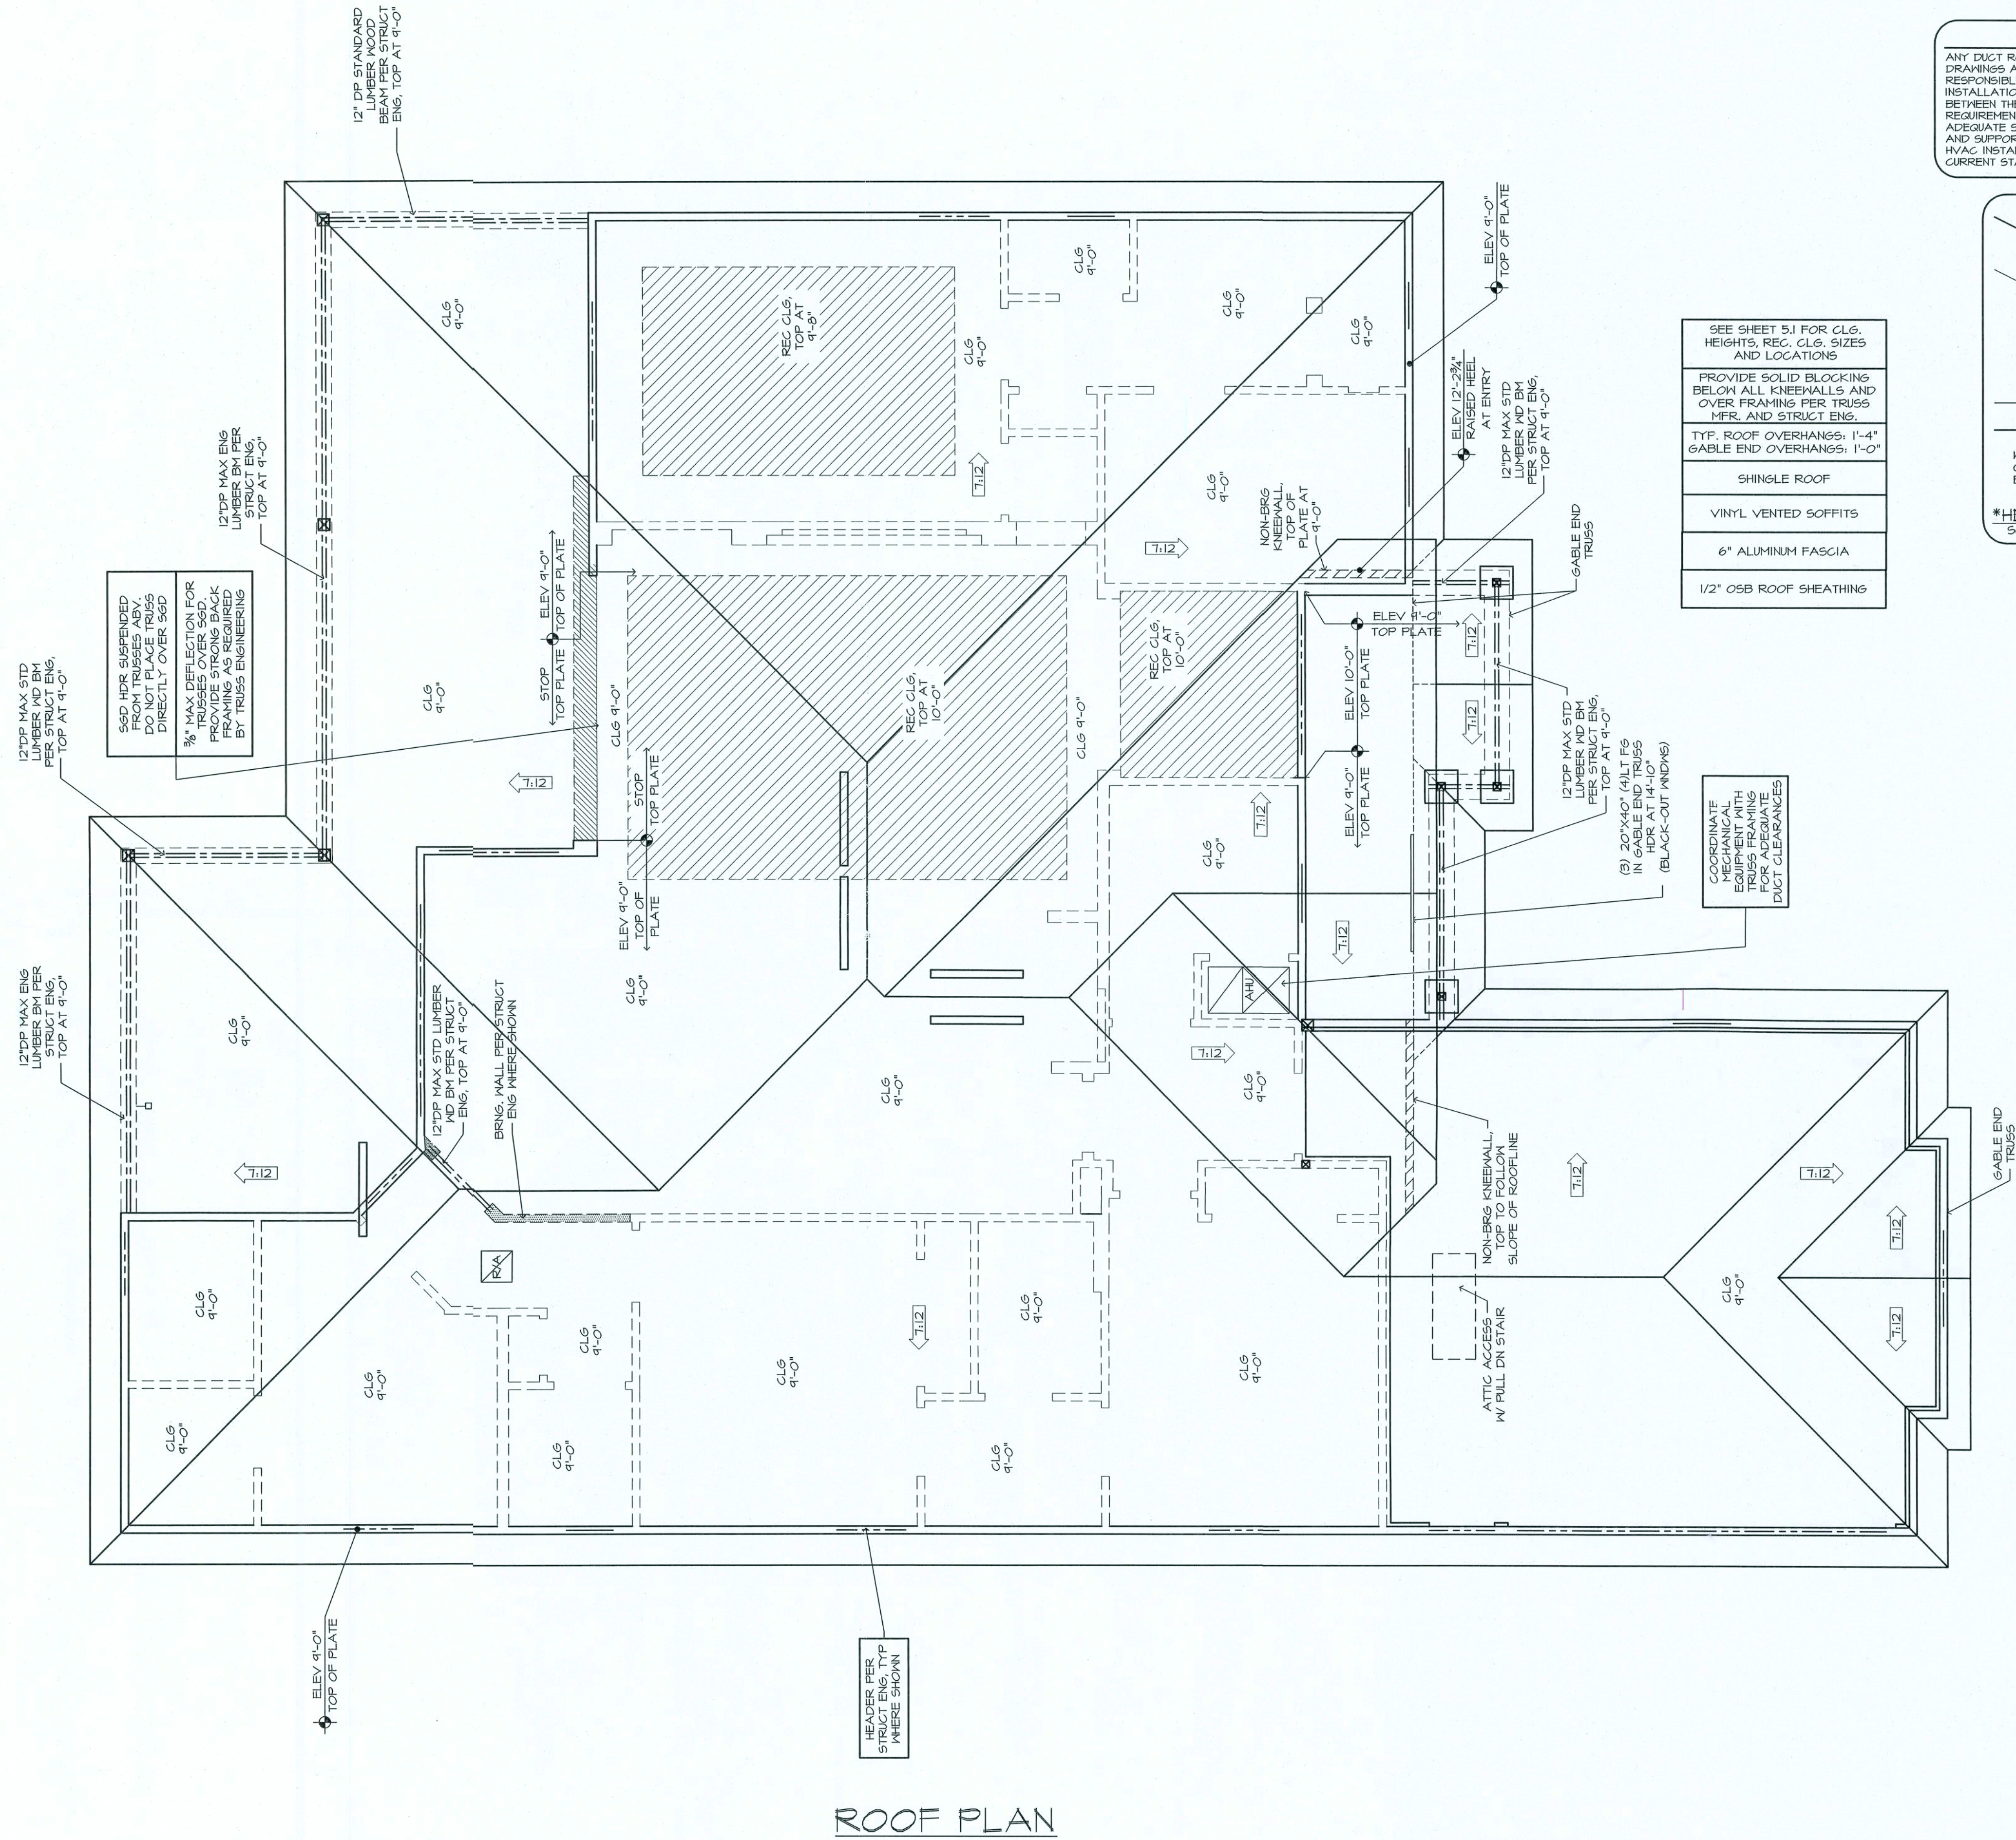


FRAMING PLAN DISCLAIMER

THE FRAMING PLANS REPRESENTED IN THESE DRAWINGS ARE INTENDED TO ESTABLISH PROPOSED FRAMING MEMBER LOCATIONS, FRAMING MEMBER DEPTH, POTENTIAL BEARING LOCATIONS AND ELEVATIONS, AND IS IN NO WAY INTENDED TO BE INTERPRETED AS STRUCTURAL ENGINEERED DRAWINGS. THE CONTRACTOR (BUILDER) SHALL ENSURE THAT THE STRUCTURE CONFORMS TO THOSE STANDARDS IN ALL RESPECTS INCLUDING STRENGTH, STRESSES, STRAIN, LOADS, CONNECTIONS, AND STABILITY. REFER TO PLAN DISCLAIMER LOCATED ON THIS SHEET FOR ADDITIONAL STIPULATIONS AND REQUIREMENTS.

MECHANICAL DISCLAIMER

ANY DUCT ROUTING AND HVAC EQUIPMENT SHOWN ON THESE DRAWINGS ARE DIAGNOSTIC ONLY. THE BUILDER IS SOLELY RESPONSIBLE FOR COORDINATING ALL ASPECTS OF MECHANICAL INSTALLATION WITH ALL TRADES. THE BUILDER SHALL COORDINATE BETWEEN THE PRE-ENGINEERED TRUSS MFR. AND/OR FRAMING REQUIREMENTS WITH THE MECHANICAL CONTRACTOR TO ENSURE ADEQUATE SPACE FOR DUCT ROUTING AND EQUIPMENT PLACEMENT AND SUPPORT. HVAC INSTALLATION SHALL BE INSTALLED ACCORDING TO ALL CURRENT STATE AND LOCAL MECHANICAL CODES.

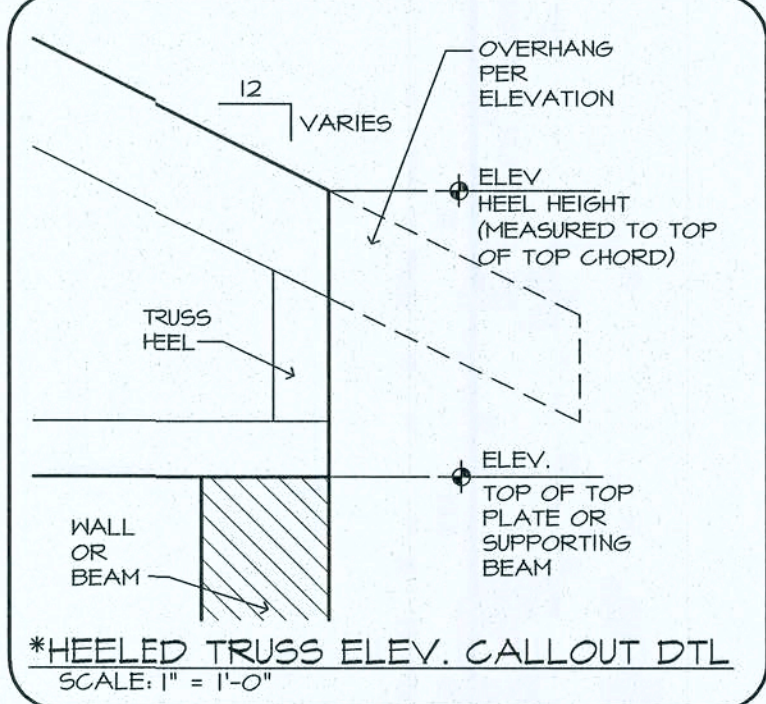


!! ATTENTION !!


NOTE: IT IS THE RESPONSIBILITY OF THE BUILDER TO COORDINATE THE INSTALLATION OF ALL WATERPROOFING METHODS NECESSARY TO PROVIDE A WATER TIGHT BUILDING ENVELOPE. REFER TO MFR. INSTALLATION RECOMMENDATION FOR ALL SELECTED WATERPROOFING MATERIALS, FLASHING, SEALERS AND AD-MIX COMPONENTS.

SEE SHEET 5/J FOR CLG, HEIGHTS, REC. CLG, SIZES AND LOCATIONS
PROVIDE SOLID BLOCKING BELOW ALL KNEEWALLS AND OVER FRAMING PER TRUSS MFR. AND STRUCT ENG.
TYP. ROOF OVERHANGS: 1'-4" GABLE END OVERHANGS: 1'-0"
SHINGLE ROOF
VINYL VENTED SOFFITS
6" ALUMINUM FASCIA
1/2" OSB ROOF SHEATHING

COORDINATE MECHANICAL EQUIPMENT WITH TRUSS FRAMING FOR ADEQUATE DUCT CLEARANCES

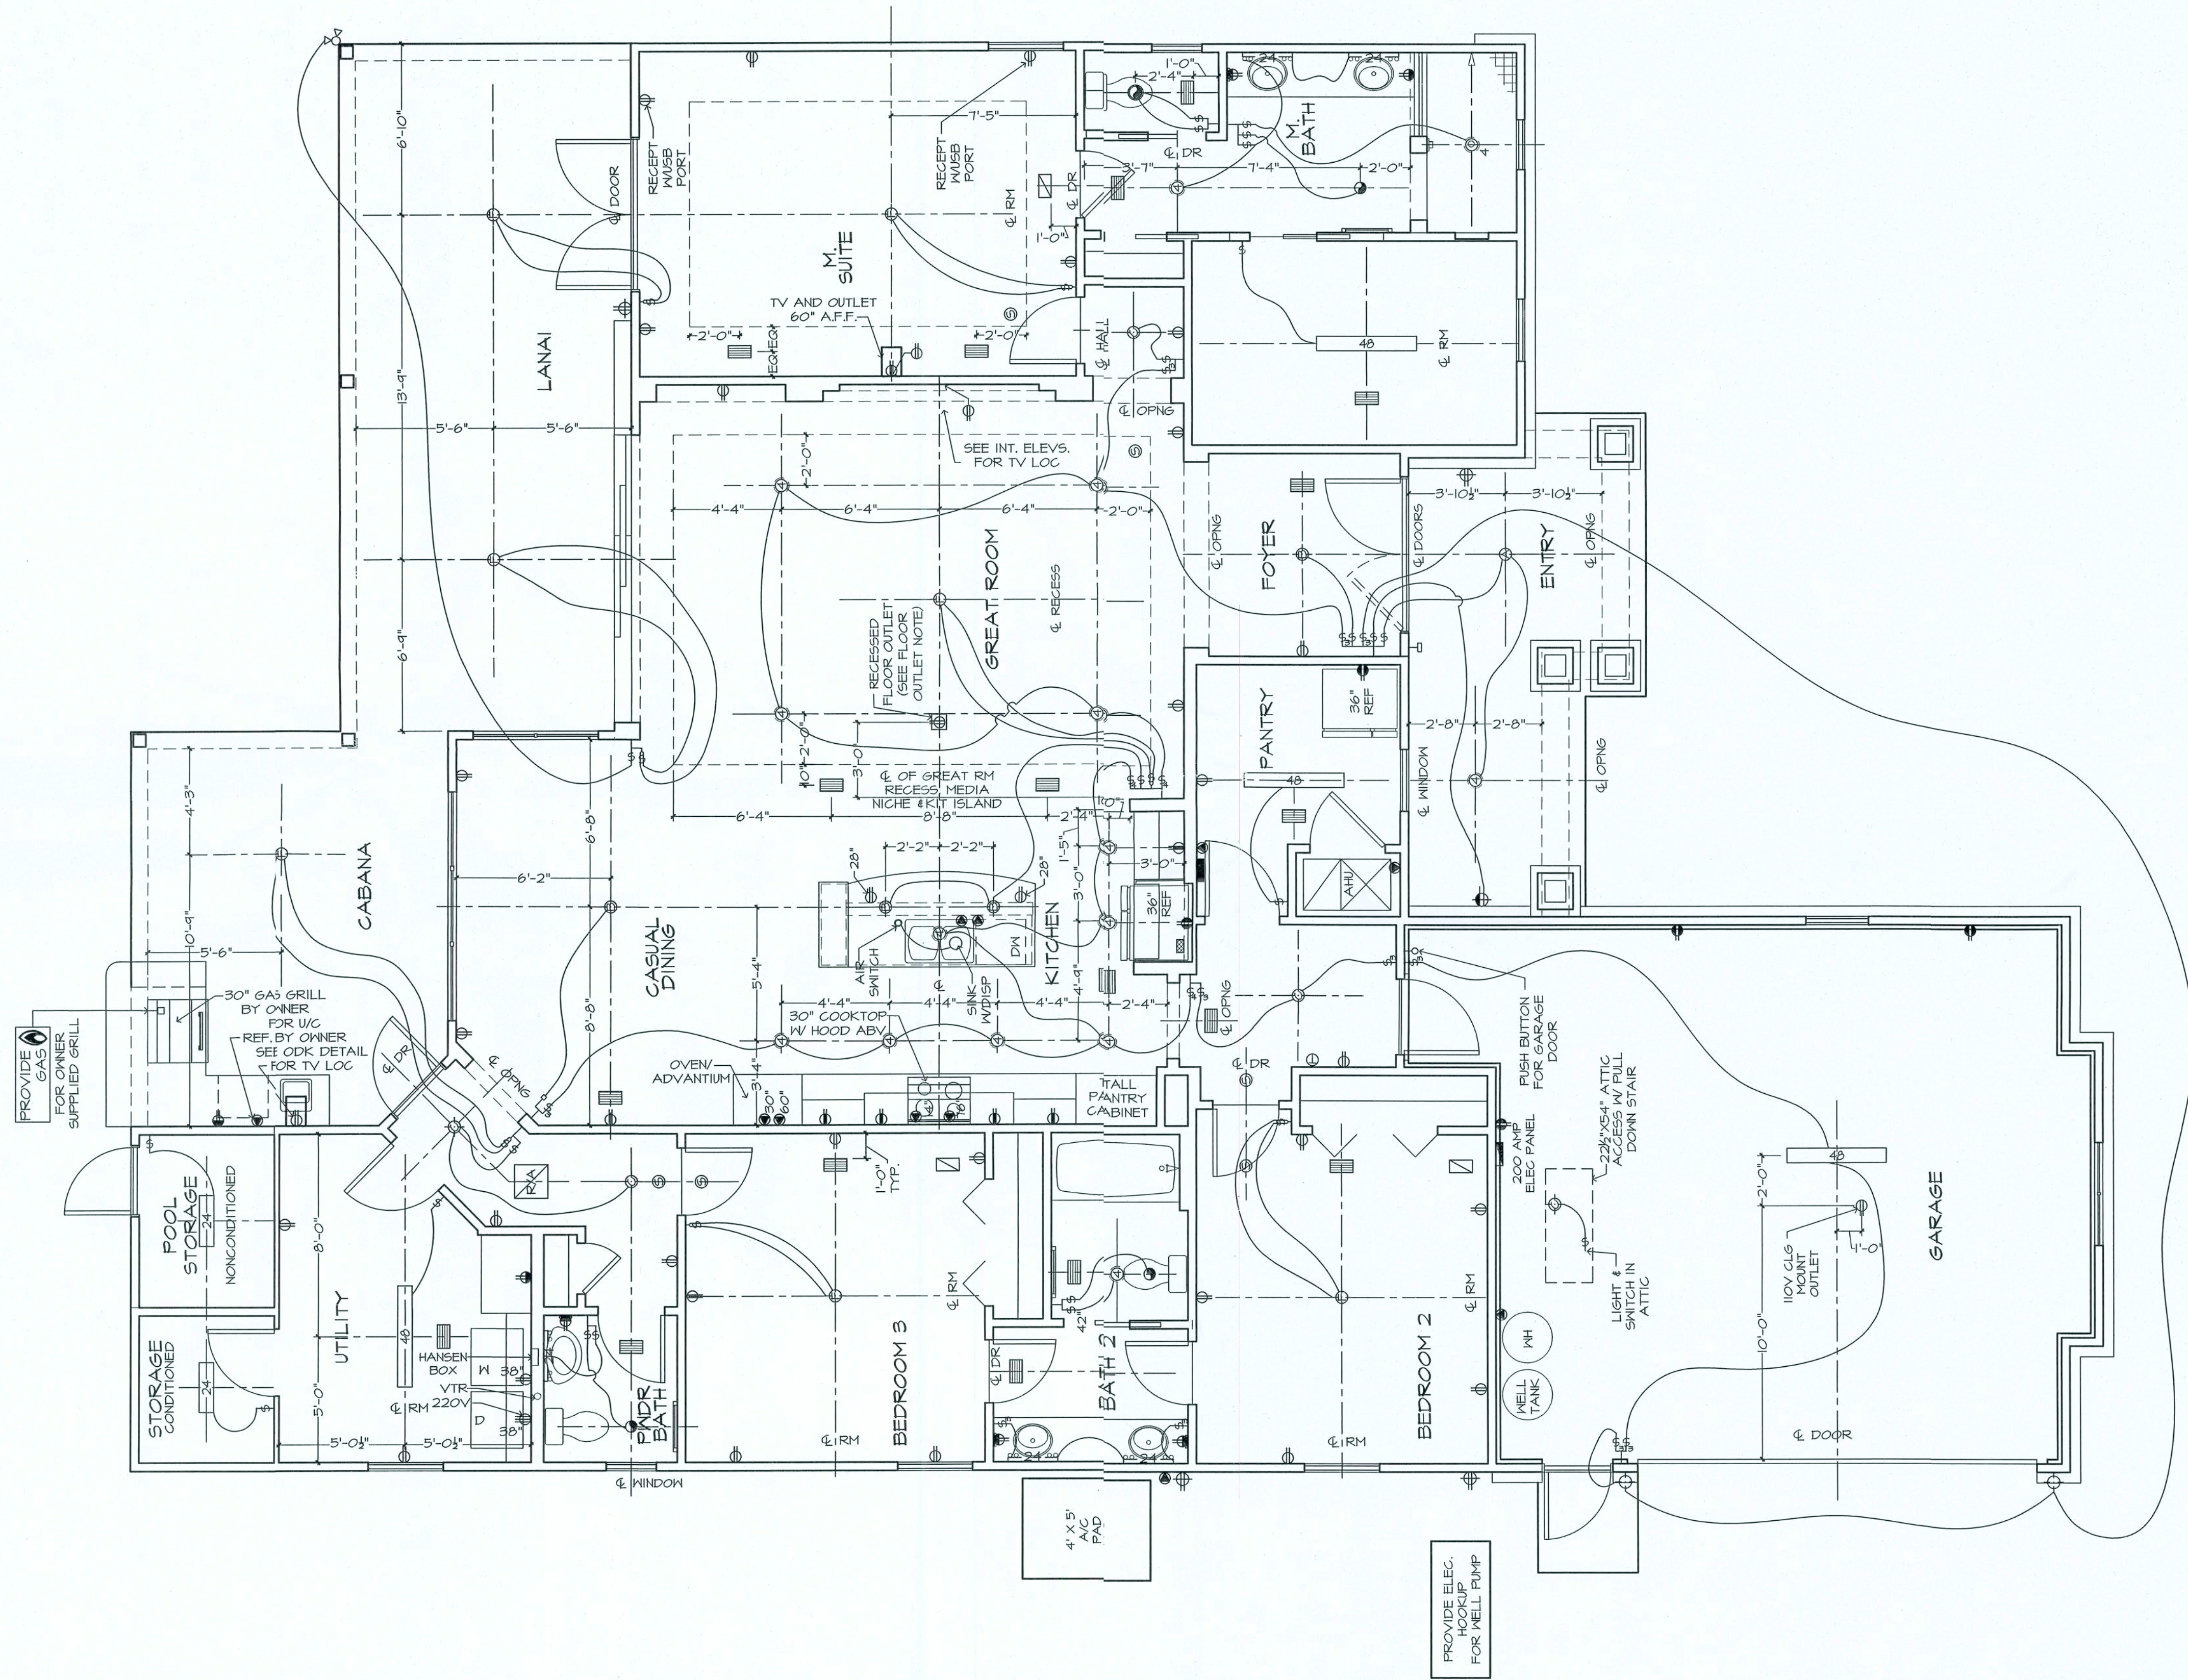

MECHANICAL DISCLAIMER
ANY DUCT ROUTING AND HVAC EQUIPMENT SHOWN ON THESE DRAWINGS ARE DIAGRAMMATIC ONLY. THE BUILDER IS SOLELY RESPONSIBLE FOR COORDINATING ALL ASPECTS OF MECHANICAL INSTALLATION WITH ALL TRADES. THE BUILDER SHALL COORDINATE BETWEEN THE PRE-ENGINEERED TRUSS MFR. AND/OR FRAMING REQUIREMENTS WITH THE MECHANICAL CONTRACTOR TO ENSURE ADEQUATE SPACE FOR DUCT ROUTING AND EQUIPMENT PLACEMENT AND SUPPORT.
HVAC INSTALLATION SHALL BE INSTALLED ACCORDING TO ALL CURRENT STATE AND LOCAL MECHANICAL CODES.

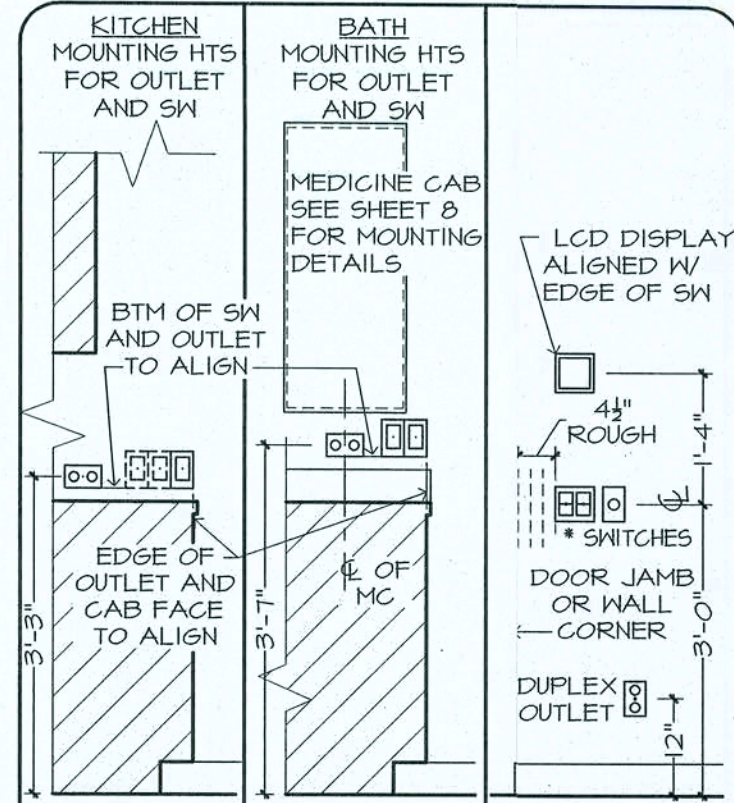

THE ITEMS BELOW ARE SHOWN FOR LOCATION PURPOSES ONLY. PLEASE REFER TO LOCAL SPECS TO DETERMINE WHETHER OR NOT THE FOLLOWING ITEMS ARE INCLUDED:
□ LIGHTING OR ELECTRONICS (LCD DISPLAY OR LIGHTING ATTACHMENT PUSH BUTTON CONTROLLER)
□ VOLUME CONTROL KNOB
* USE MAX OF 6 GANG BOXES. FOR GANG BOXES OF 3 OR MORE THAT ARE LOCATED ON BLOCK WALL, CHIP OUT THE BLOCK TO ACCOMMODATE DEEPER BOX.
NOTE: ALL DIMENSIONS ARE FOR ROUGH FRAMING.
ELECTRICAL DETAILS
SCALE: 1/2"=1'-0"

FLOOR OUTLET NOTE:
RECESSED FLOOR OUTLET (FULLY CONCEAL BELOW FLOOR LEVEL) #603-P W/ COVER PLATE BY: THOMAS & BETTS, INC. OR EQUAL

WATER HEATER NOTE:
INSTALL WATER HEATER PER MANUFACTURERS INSTALLATION INSTRUCTIONS AND CURRENT APPLICABLE CODES

ELECTRICAL LEGEND

- ⊕ DUPLEX OUTLET (110V AT 12" OR AS NTD)
 - ⊕ DUPLEX OUTLET (110V AT 34")
 - ⊕ DUPLEX OUTLET (110V AT 43")
 - ⊕ DUPLEX OUTLET (110V AT 45")
 - ⊕ SPLIT DPLX OUTLET (110V AT 12") TOP IS 'HOT'
 - ⊕ WEATHERPROOF DPLX OUTLET (110V AT 12")
 - ⊕ WEATHERPROOF DPLX OUTLET (110V AT 12") TOP PLUG IS 'HOT'
 - ⊕ 220V OUTLET AT 30"
 - ⊕ RECESS FLOOR OUTLET
 - ⊕ SPECIAL PURPOSE CONN
 - ⊕ USB PORT FOR OUTLETS (110V AT 12" OR AS NTD)
 - ⊕ SW SEE ELEC DTL
 - ⊕ 3-WAY SW SEE ELEC DTL
 - ⊕ 4-WAY SW SEE ELEC DTL
 - ⊕ 1-GANG COMBINATION FAN / LIGHTSWITCH
 - ⊕ OCCUPANCY/MOTION DETECTOR SWITCH
 - ⊕ PUSH-BUTTON FOR GARAGE DOOR AT 60"
 - ⊕ DIMMER SW AT 36"
 - ⊕ PUSH-BUTTON DOORBELL
 - ⊕ CL6 MNT LT FIXTURE
 - ⊕ CL6 MNT PREMIRE - FIXTURE BY OWNER
 - ⊕ SURFACE MNT FIXTURE
 - ⊕ WALL MNT FIXTURE
 - ⊕ 6" ROUND RECESS 2700K LED RETROFIT TRIM W/OFFEN BAFFLE
 - ⊕ 4" MINI ROUND RECESS 2700K LED RETROFIT TRIM W/OFFEN BAFFLE
 - ⊕ 4" MINI ROUND RECESS 2700K LED EYE BALL TRIM
 - ⊕ 8" ROUND SLOPE CL6 RECESS WITH 2700K LED BULB (INTERIOR SLOPED CL6)
 - ⊕ 2 1/2" MINI ROUND LED 3000K
 - ⊕ CL6 FANLIGHT PREMIRE AND SWITCHES
 - ⊕ COMBO SMOKE & CARBON MONOXIDE DETECTOR
 - ⊕ UNDER CABT LED 9"
 - ⊕ UNDER CABT LED 14"
 - ⊕ UNDER CABT LED 22"
 - ⊕ UNDER CABT LED 30"
 - ⊕ SINGLE 24" FLUOR STRIP
 - ⊕ 24" CL6 MNT FLUOR. LT, WRAPPED
 - ⊕ 48" CL6 MNT FLUOR. LT, WRAPPED
 - ⊕ 24" VANITY LIGHTING (SEE SPEC)
 - ⊕ 36" VANITY LIGHTING (SEE SPEC)
 - ⊕ EXHAUST FAN / LIGHT FIXTURE COMBO
 - ⊕ EXHAUST FAN
 - ⊕ SOFFIT MNT FLOOD LIGHT
 - ⊕ CL6 MNT SPEAKER
 - ⊕ CHIMES
 - ⊕ ELEC PANEL
 - ⊕ STRUCTURED WIRING PANEL
 - ⊕ CL6 RETURN AIR
 - ⊕ A/C REGISTER
 - ⊕ THERMOSTAT
 - ⊕ SECURITY PAD
- * NOTE: ALL OUTLETS ABOVE COUNTERS SHALL BE MOUNTED HORIZONTALLY
* NOTE: ALL 125V, 15 AND 20 AMP OUTLETS TO BE TAMPER-RESISTANT IN AREAS SPECIFIED BY NEC 2011 406.12
* NOTE: ALL EXTERIOR OUTLETS, OUTLETS IN GARAGE, WALL OUTLETS IN KITCHENS AND BATHROOMS AND ALL OUTLETS WITHIN 6'-0" OF A WATER SOURCE SHALL BE G.F.
ALL NON-GFI OR 220V OUTLETS ARE PROTECTED BY AN ARC-FAULT CIRCUIT INTERRUPTER. ALL HEIGHTS TO CENTERLINE AFF.
* NOTE: LIGHTS, FANS, SMOKE DETECTORS, A/C SUPPLIES AND RETURN AIRS TO BE PLACED ON CENTERLINES OF DOORS, HALLWAYS AND HALLWAYS, TYP UNO
* NOTE: COMBINATION SMOKE & CARBON MONOXIDE DETECTORS SHALL BE INSTALLED PER NFPA72 CHAPTER 24 AND FSC-R 5TH EDITION (2014) SECTION R314 & 315.
* NOTE: COORDINATE LOCATION OF ALL REQ. ELECTRICAL, CABLE, AUDIO/VIDEO & DATA RECEPTACLES W/ MOUNTING HARDWARE & MFR. INSTALLATION REQ. FOR ALL FLAT PANEL DISPLAYS.

Arthur Rutenberg Homes
ARTHUR RUTENBERG HOMES, INC.
ALL RIGHTS RESERVED




07/07/17-EDNA-A
07/07/17-EDNA-A-1
07/07/17-EDNA-A-2

THE ANTIGUA 1441F - L-GREEN RESIDENCE, INC.
BUILDER: BRYAN ZECHER HOMES, INC.
LACE CITY, FLORIDA
AN INDEPENDENTLY OWNED AND OPERATED FRANCHISE

ELECTRICAL PLAN
PLAN 1441F-25-01-B*
CL 1/3" 1'-0"
JOB# 65710-A-2

24X36: 1/4"=1'-0"
12X18: 1/8"=1'-0"

7

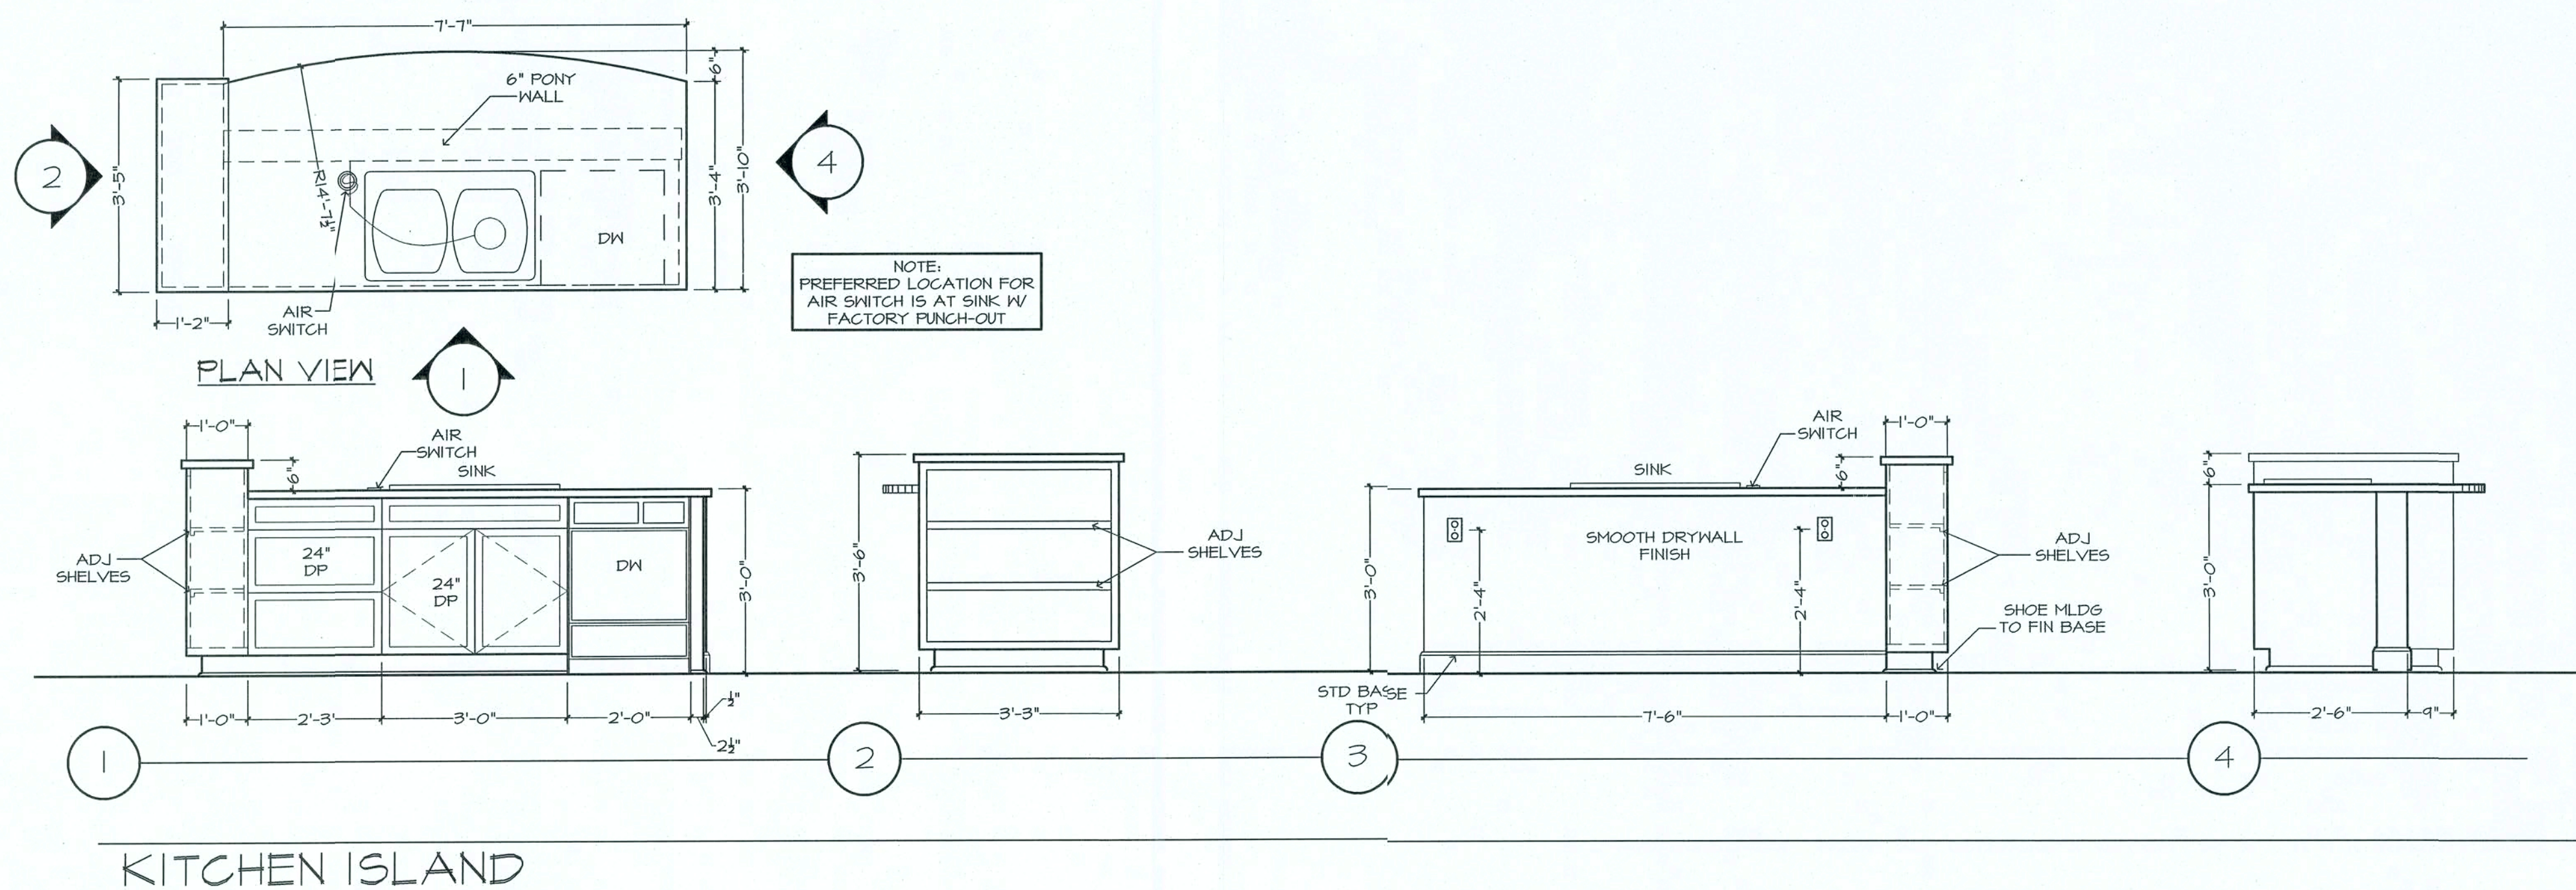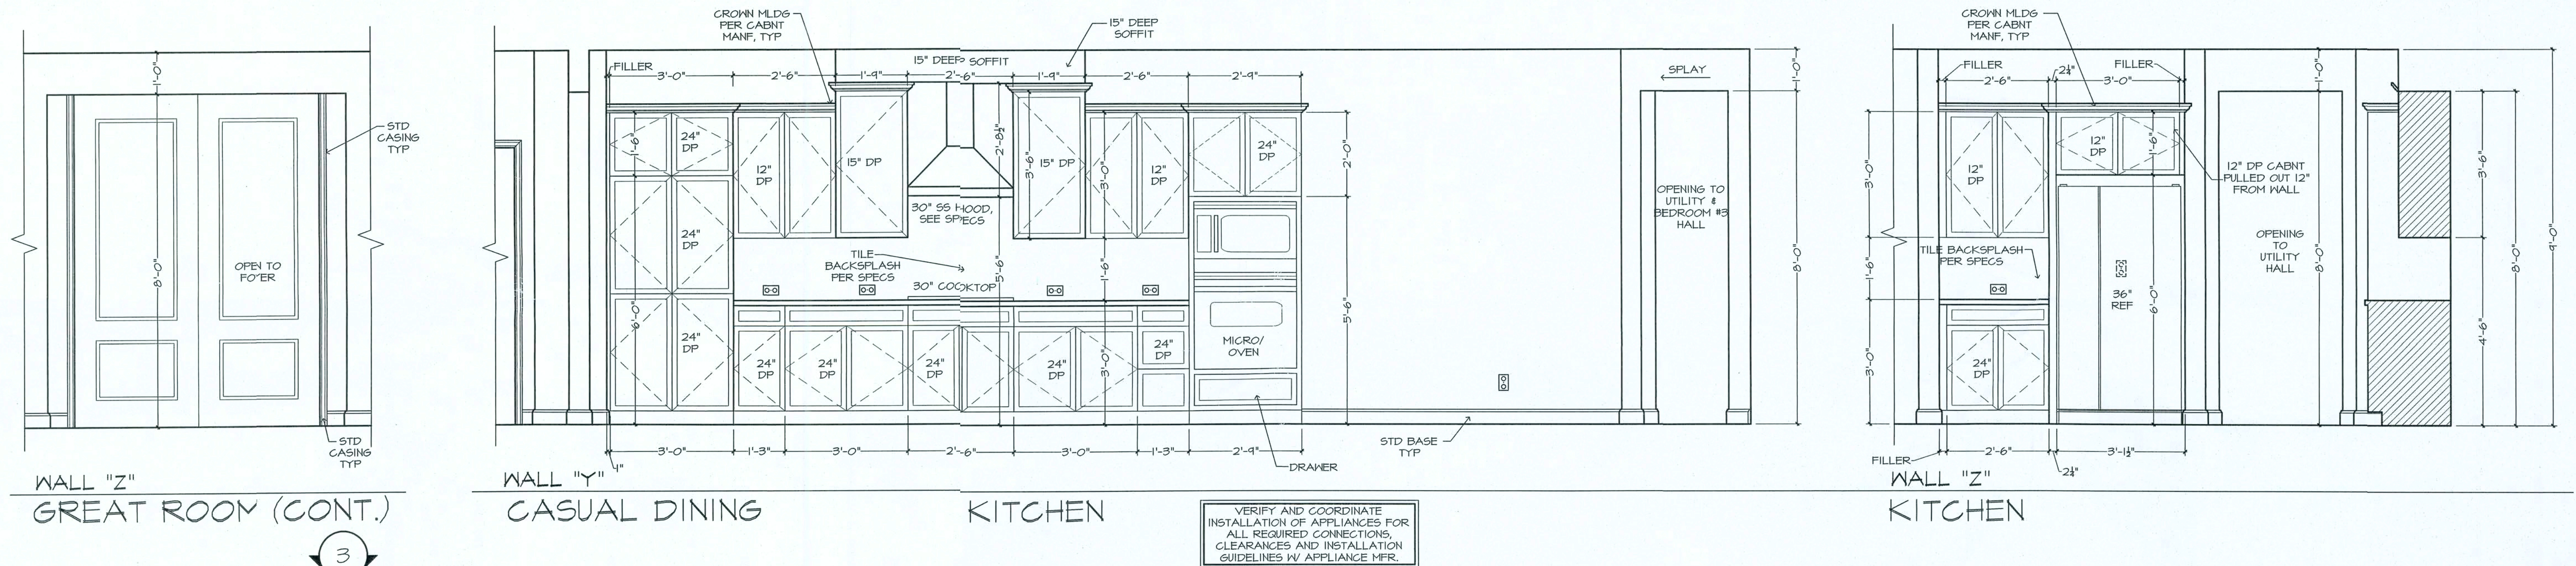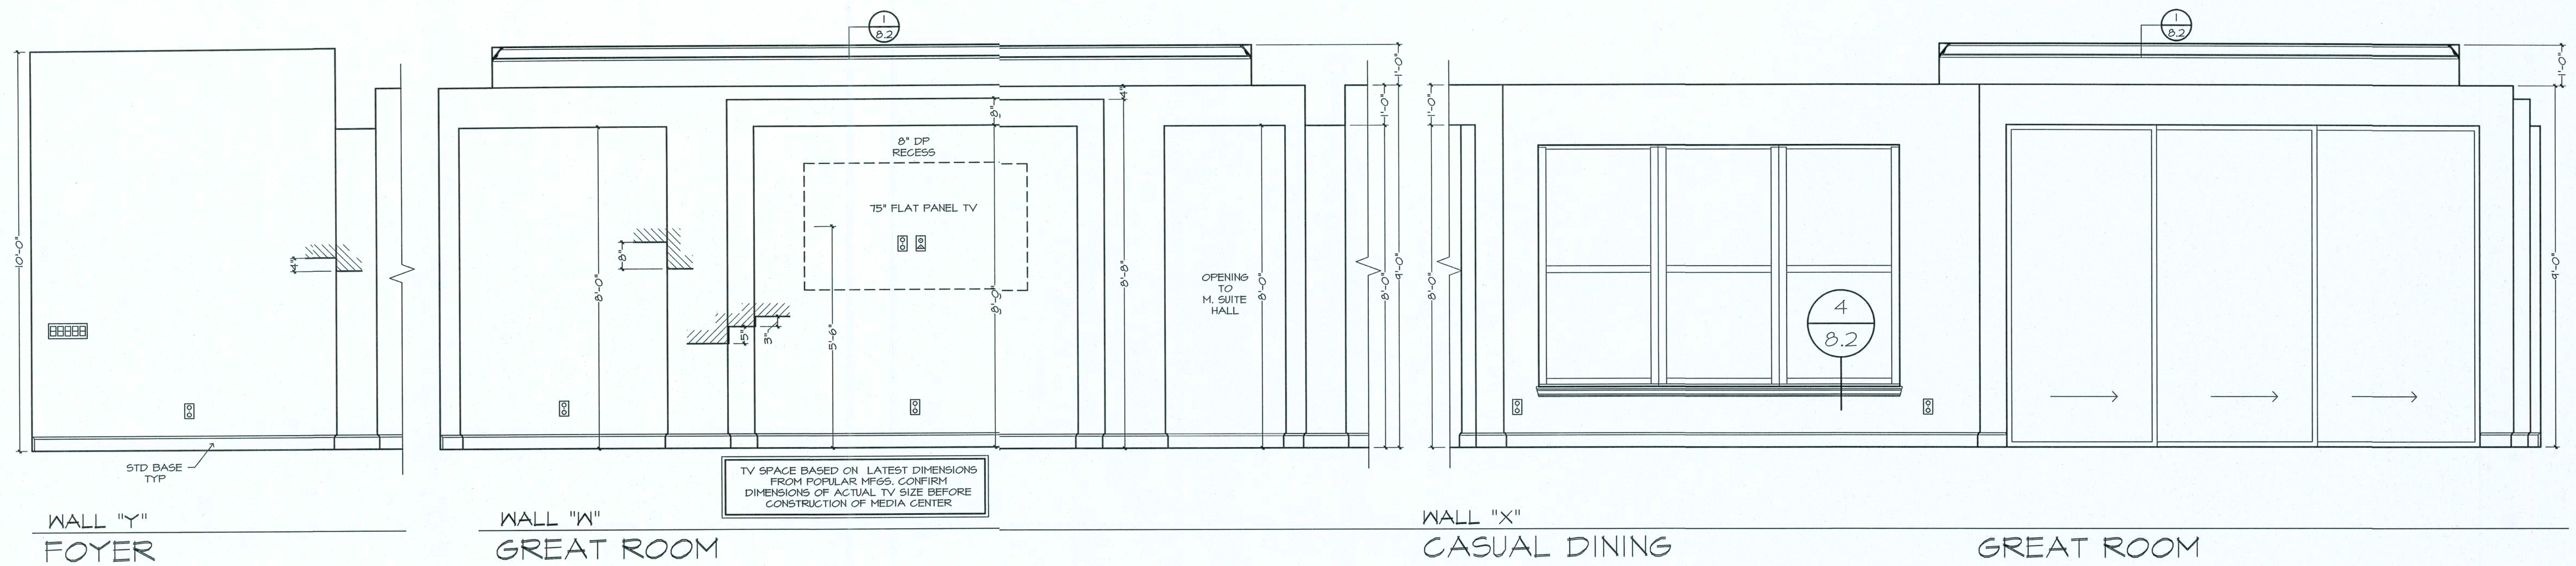

GENERAL NOTES:


CABINET ELEVATIONS AND LIGHTING ARE GRAPHIC REPRESENTATIONS ONLY. REFERENCE SHOULD BE MADE TO THE ELECTRICAL SHEET, CABINET MFR DRAWINGS AND SPECS FOR FURTHER INFORMATION.

REFER TO CABINET SHOP DRAWINGS FOR CABINET & VANITY TOP DIMENSIONS


FOR STEPPED UPPER CABINETS, IF MODULAR CABINETS ARE SELECTED AND NOT AVAILABLE IN SPECIFIED DEPTHS THE WALLS BEHIND CABINETS WILL NEED TO BE BUILT OUT TO OBTAIN SPECIFIED DEPTH.

THE TOE KICK IS 4".


PLUMBING, TILE, BASE MLDG, DOOR CASING, & DECORATIVE LIGHTING & DECORATIVE MIRRORS ARE ILLUSTRATED FOR LOCATION PURPOSES ONLY. PLEASE REFER TO COMMUNITY STANDARDS FOR SIZES & SPECS.

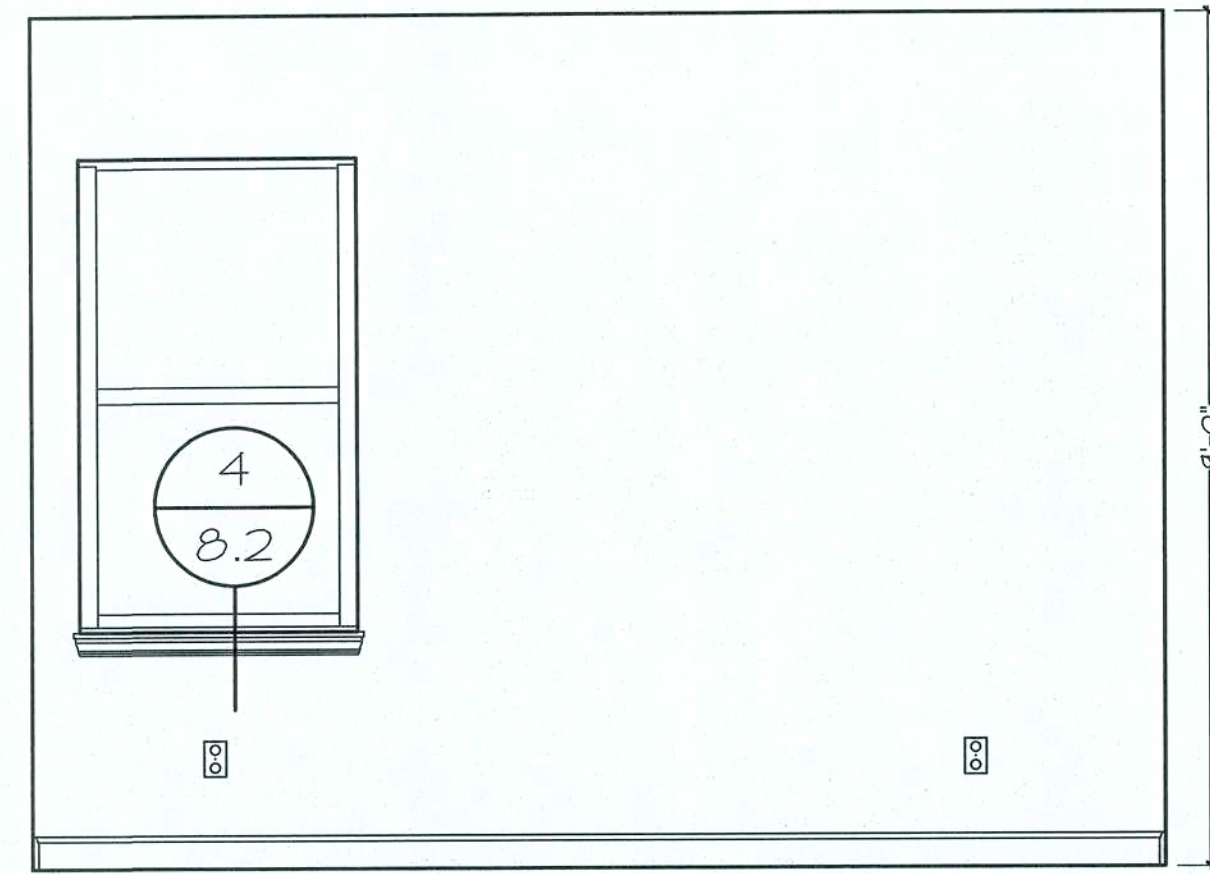


WALL "Y"
BEDROOM 3

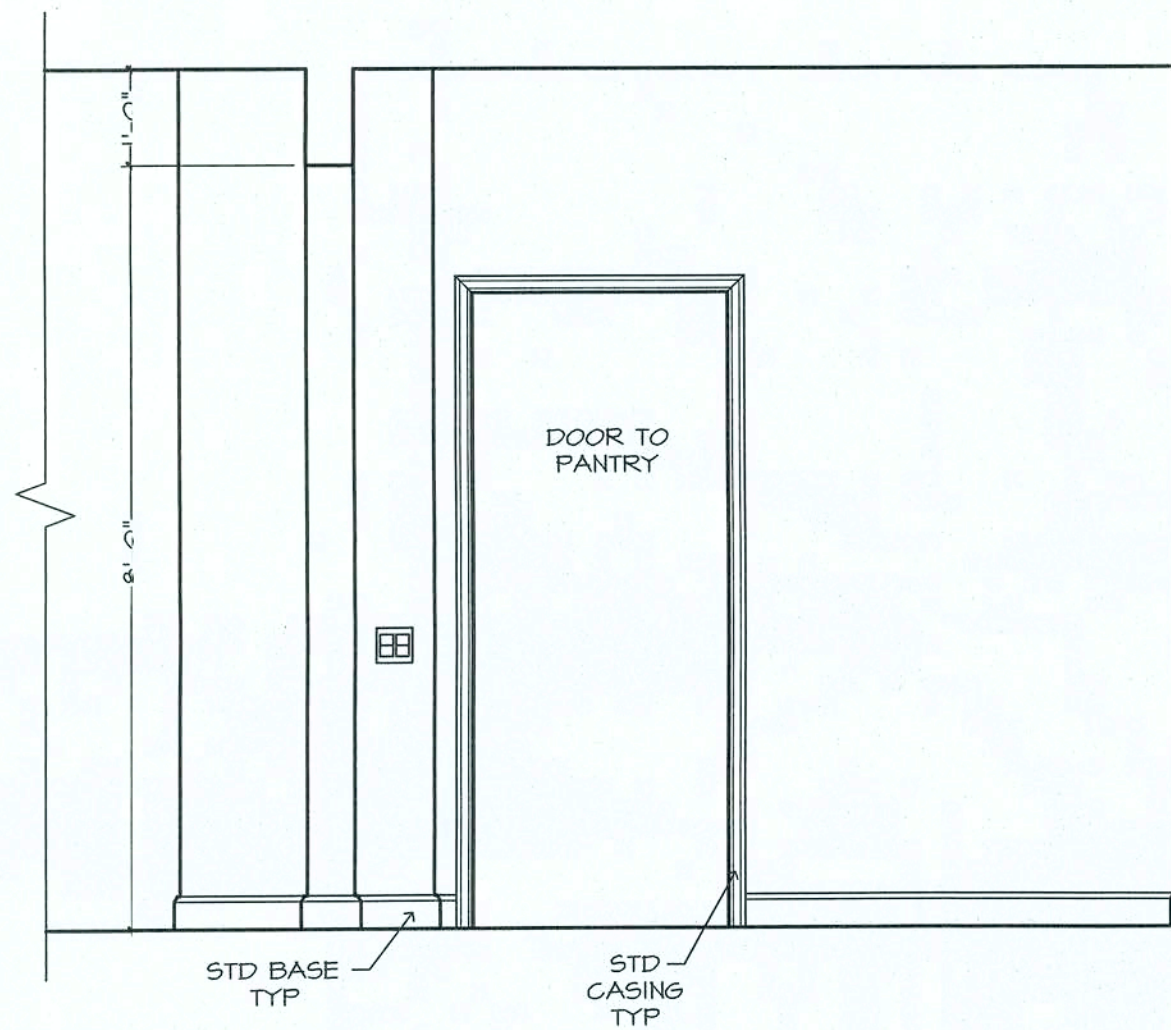


WALL "N"
ARRIVAL

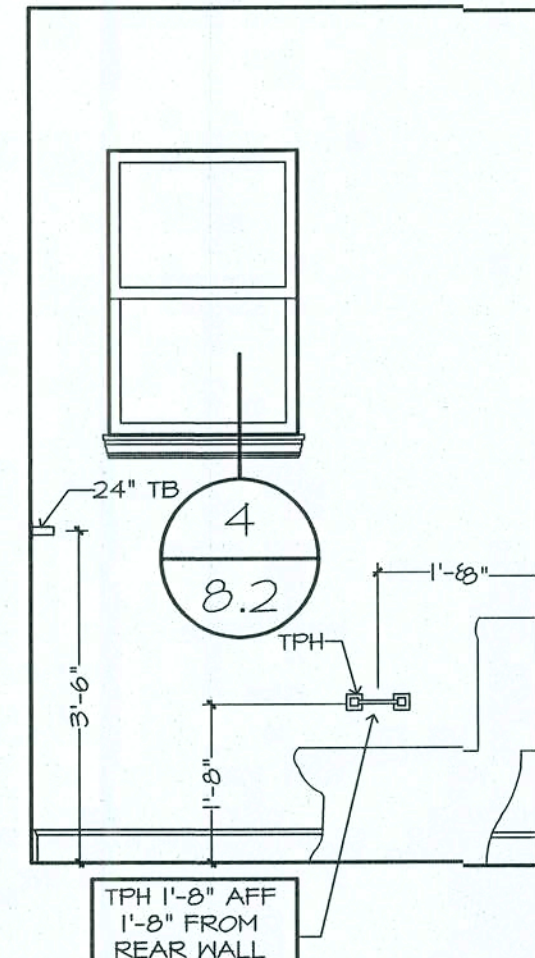


WALL "Y"
POWDER BATH

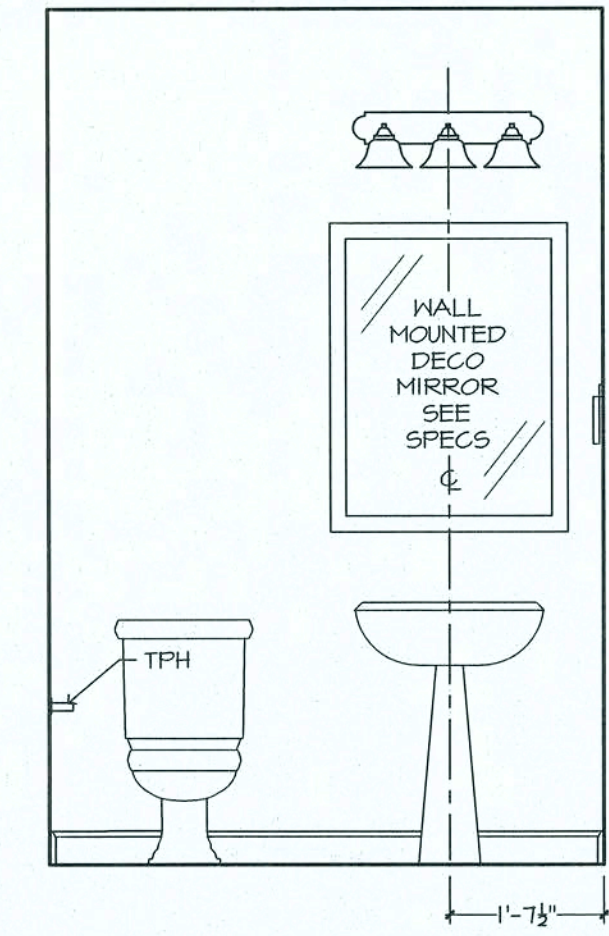


WALL "X"

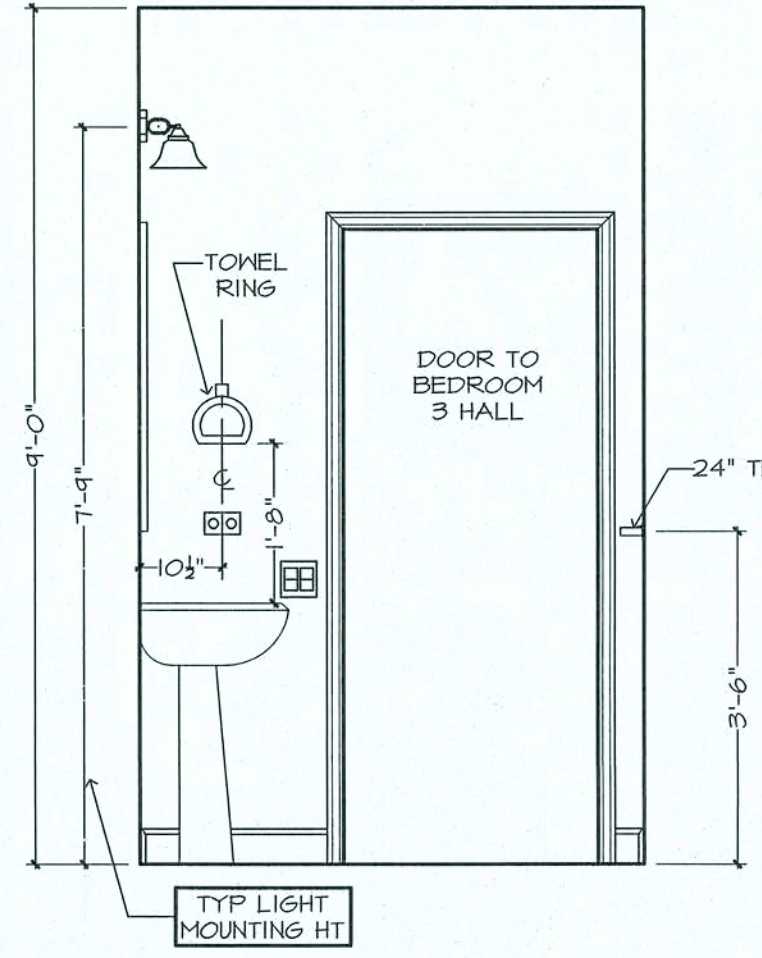


WALL "W"

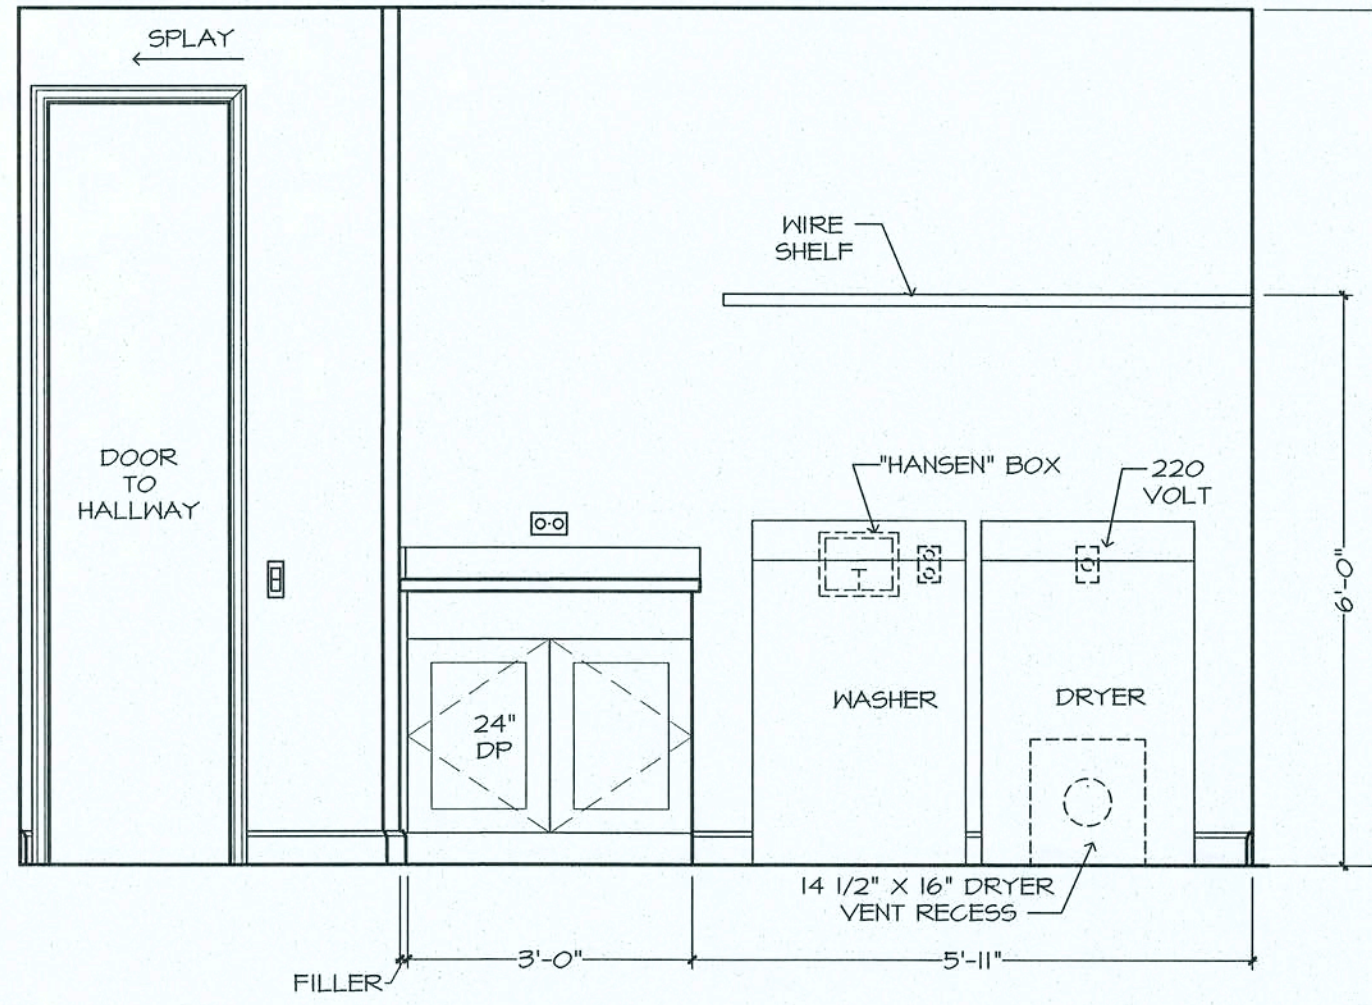


WALL "Z"
UTILITY

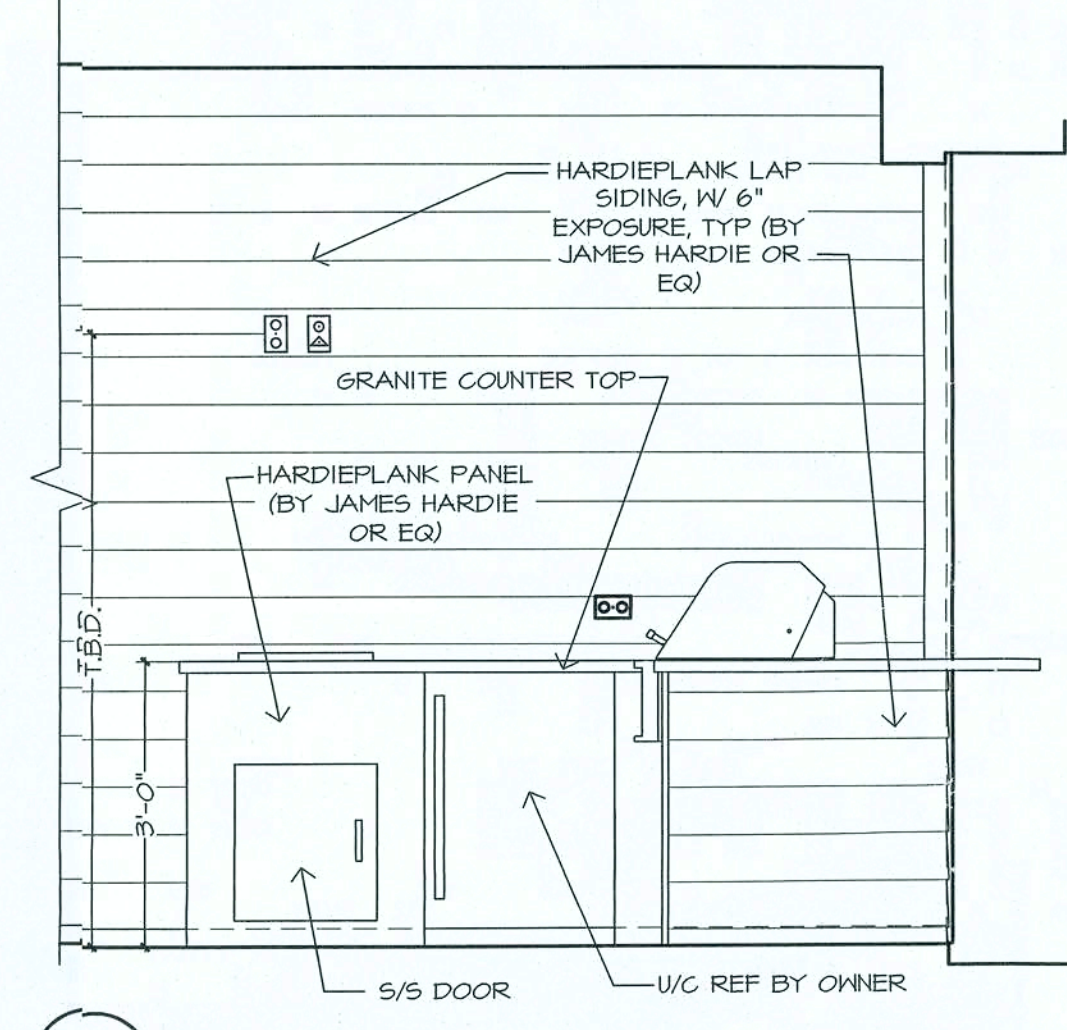

1
OUTDOOR KITCHEN

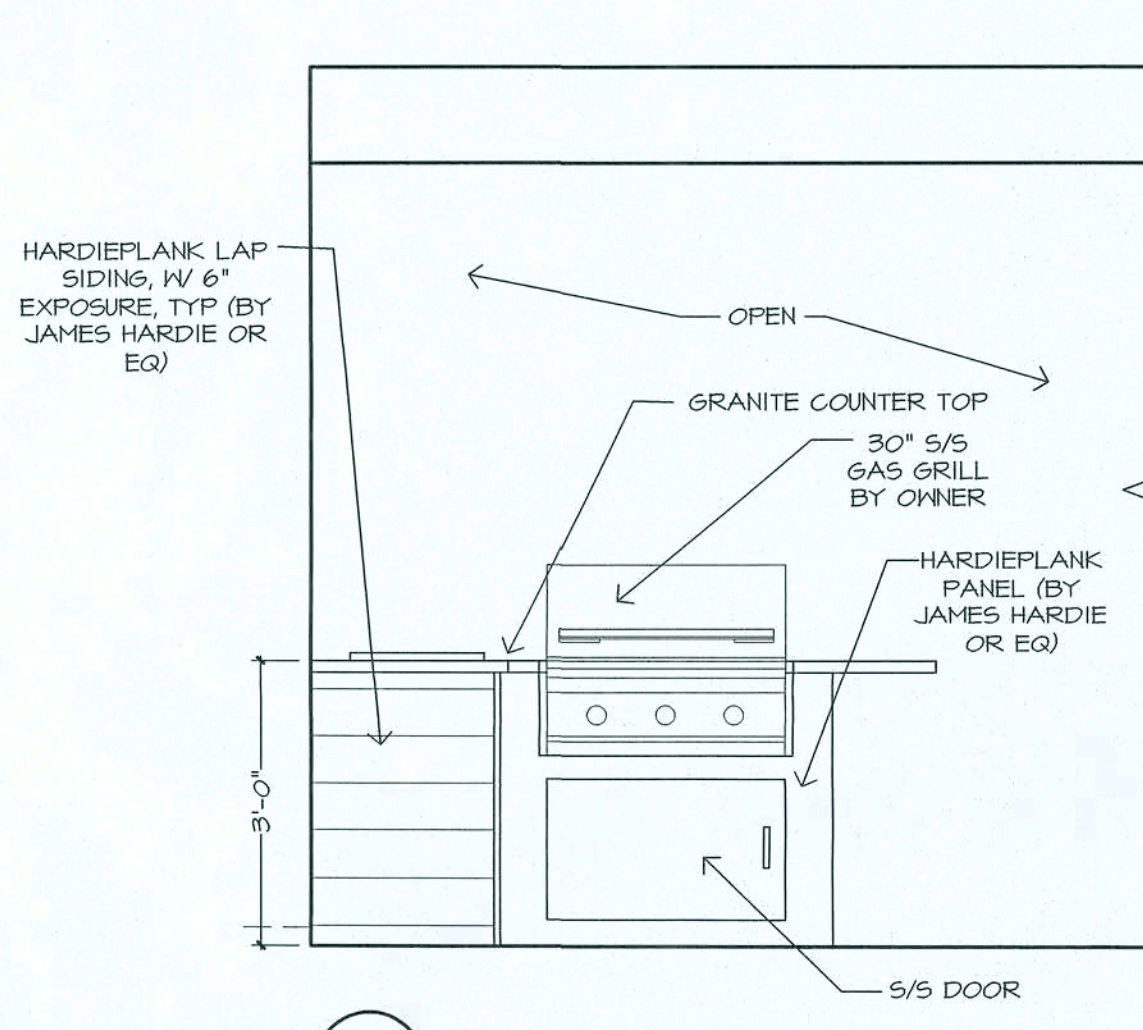



2

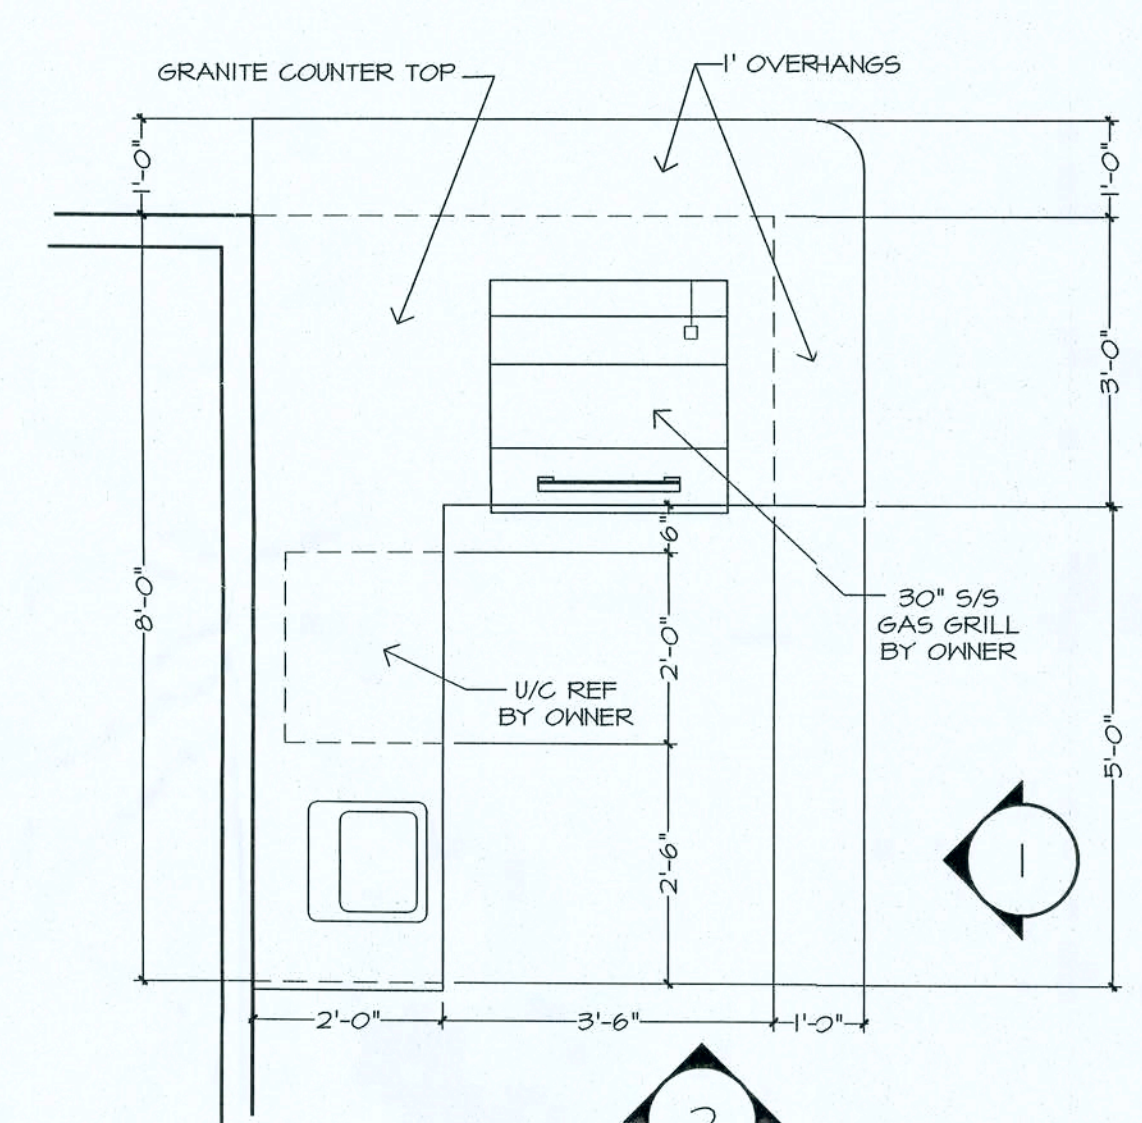

PLAN VIEW

USE
POLYFLEX "FLEXIBLE MLDG"
(904) 880-7253
TO MATCH S&S PROFILES
FOR CURVED APPLICATIONS

*ALL MLDG
PROFILES ARE TO
BE PAINTED UNLESS
OTHERWISE NOTED

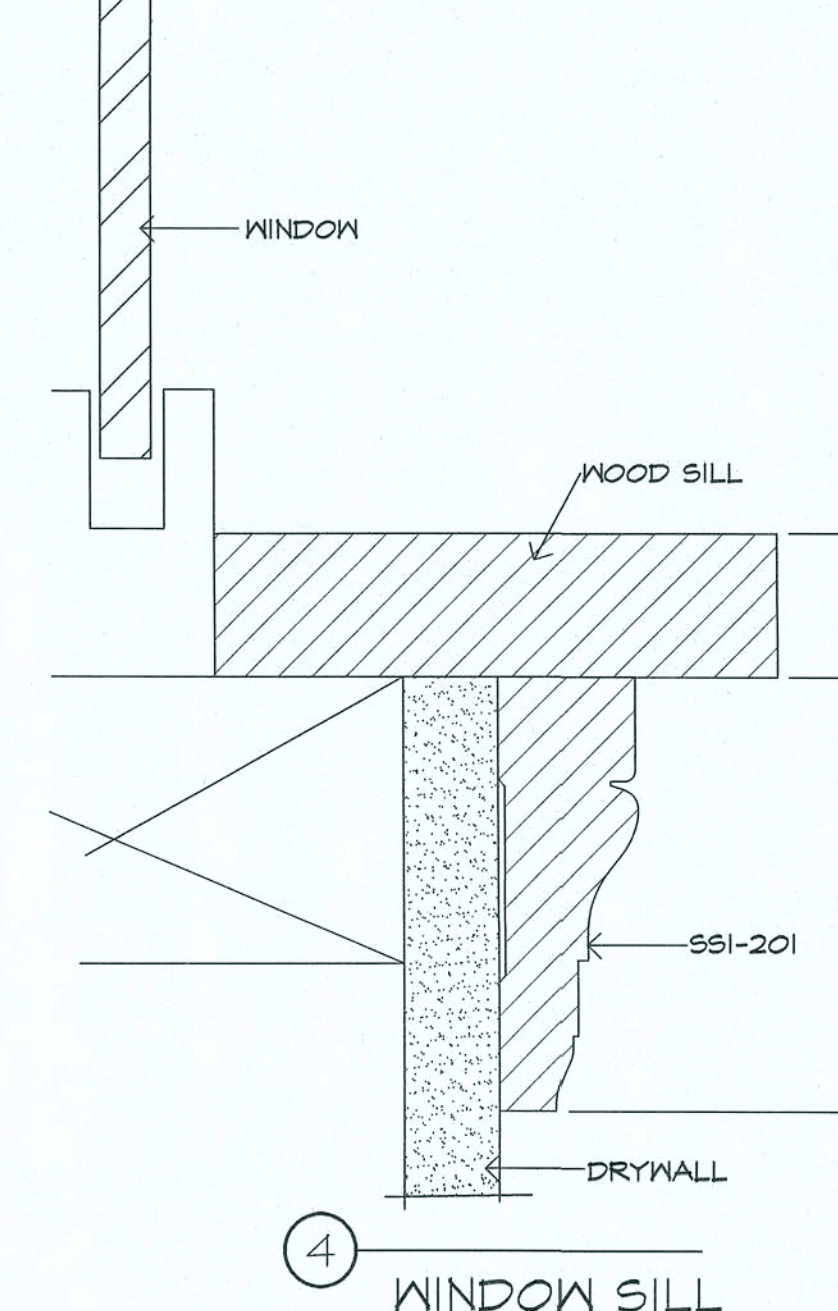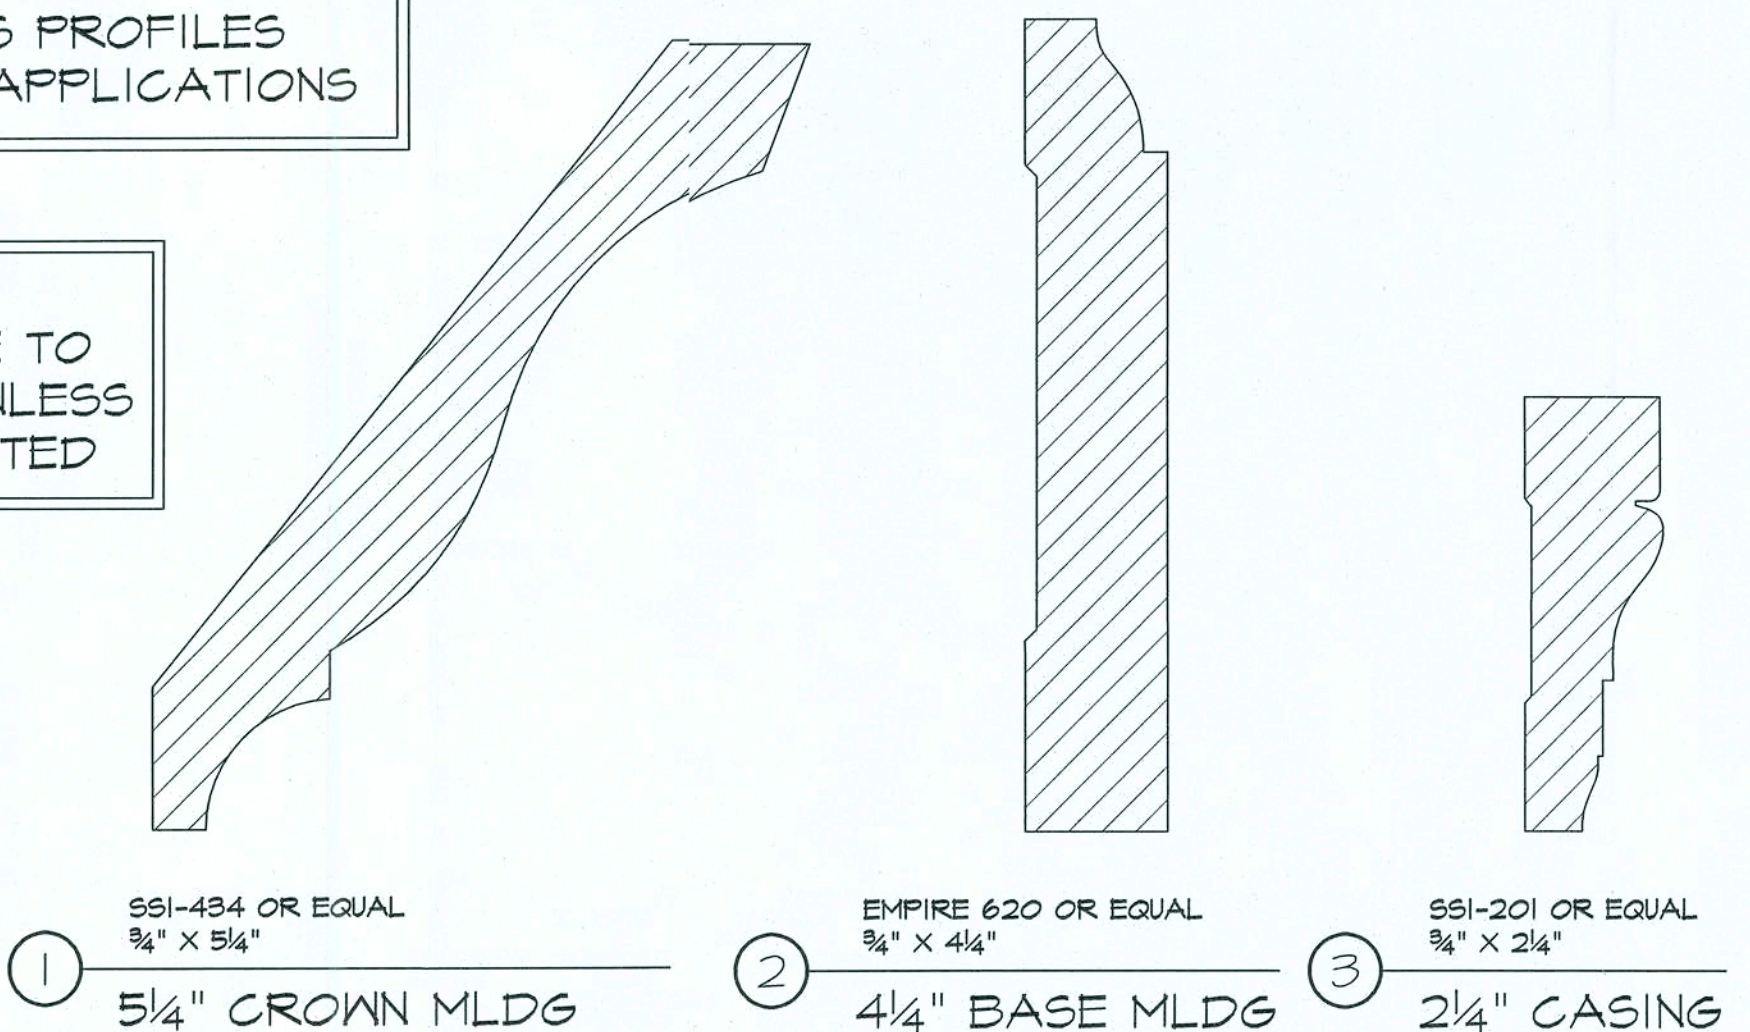

4
WINDOW SILL

GENERAL NOTES:
CABINET ELEVATIONS AND LIGHTING ARE GRAPHIC REPRESENTATIONS ONLY. REFERENCE SHOULD BE MADE TO THE ELECTRICAL SHEET, CABINET MFR DRAWINGS AND SPECS FOR FURTHER INFORMATION.
REFER TO CABINET SHOP DRAWINGS FOR CABINET & VANITY TOP DIMENSIONS.
FOR STEPPED UPPER CABINETS:
IF MODULAR CABINETS ARE SELECTED AND NOT AVAILABLE IN SPECIFIED DEPTHS THE WALLS BEHIND CABINETS WILL NEED TO BE BUILT OUT TO OBTAIN SPECIFIED DEPTH.
THE TOE KICK IS 4".
PLUMBING, TILE, BASE MLDG, DOOR CASING, & DECORATIVE LIGHTING & DECORATIVE MIRRORS ARE ILLUSTRATED FOR LOCATION PURPOSES ONLY. PLEASE REFER TO COMMUNITY STANDARDS FOR SIZES & SPECS.

DESIGN CRITERIA AND LOADS

Building Code Florida Building and Residential Codes, 6th Edition (2014)	
Code for Design Loads ANSI/ASCE 7-10	
ROOF LOADING ¹	C _s = 1.25
TOP CHORD LIVE LOAD.....	20 PSF
TOP CHORD DEAD LOAD.....	7 PSF
BOTTOM CHORD LIVE LOAD.....	
ATTICS WITH LIMITED STORAGE.....	20 PSF (PER FRC)
ATTICS WITHOUT STORAGE.....	10 PSF
BOTTOM CHORD DEAD LOAD.....	(NON-CONCURRENT) 5 PSF
WIND LOADING	
ASCE 7-10, 35 GUST.....	C _e = 1.60
BASIC WIND SPEED.....	120 MPH
EXPOSURE CATEGORY.....	C
BUILDING CATEGORY.....	II
ENCLOSURE CLASSIFICATION.....	ENCLOSED
INTERNAL PRESSURE COEFF.....	0.18
C&D DESIGN PRESSURES.....	(SEE TABLE 1)
FLOOR LOADINGS	
ASCE 7-10, 35 GUST.....	C _s = 1.00
TOP CHORD LIVE LOAD.....	40 PSF
TOP CHORD DEAD LOAD.....	10 PSF
BOTTOM CHORD LIVE LOAD.....	0 PSF
BOTTOM CHORD DEAD LOAD.....	5 PSF
MAXIMUM FLOOR TRUSS SPACING.....	16' O.C.
SPECIAL FLOOR (GAME ROOM) LOADING	
TOP CHORD LIVE LOAD.....	60 PSF
TOP CHORD DEAD LOAD.....	10 PSF
BOTTOM CHORD LIVE LOAD.....	0 PSF
BOTTOM CHORD DEAD LOAD.....	5 PSF
MAXIMUM FLOOR TRUSS SPACING.....	16' O.C.
DEFLECTION CRITERIA	
ROOF TRUSSES.....	LL / 240
TL MAX 1" UP TO 40' SPAN	TL / 180
OPEN WEB FLOOR TRUSSES/BEAMS.....	LL / 360
TL MAX 1" UP TO 40' SPAN	TL / 240
WOOD JOISTS.....	LL / 480
TL MAX 1" UP TO 40' SPAN	TL / 240

NOTES:
1. CONCURRENTLY LOADED LIVE LOAD MAY BE REDUCED PER FBC 1605.3.1.1.

TABLE 1: COMPONENT AND CLADDING DESIGN PRESSURES

WINDOWS AND DOORS		
EFFECTIVE WIND AREA	ZONE DESIGNATION	
	IZ - Interior Zone (psf)	EZ - End Zone (psf)
0 - 20 ft ²	+19.15	-20.78
21 - 50 ft ²	+18.23	-19.85
51 - 100 ft ²	+17.13	-18.75
101 - 200 ft ²	+16.28	-17.90
VINYL SOFFIT MAX PRESSURE (psf)	+16.15	-17.7
GARAGE DOOR PRESSURE	SEE FRAMING PLAN	

END ZONE KEY MAP

END ZONE, END ZONES SHALL BE TAKEN AS THE 1ST 4.0' PER IRC FIGURE R301.2 (7)

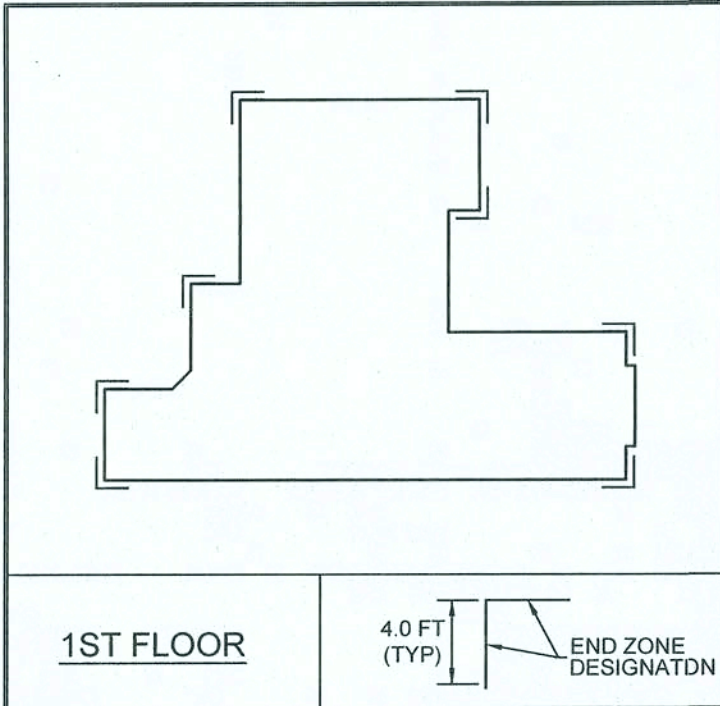


TABLE 2: WOOD STRUCTURAL PANEL SHEATHING REQUIREMENTS

TYPICAL EXTERIOR WALL SHEATHING (NOTES 1, 2)	ALL WALLS	OSB OR PLYWOOD PANEL EDGES REQUIRED TO LAP BOTTOM PLATE 1 1/2" AND TOP MEMBER OF TOP PLATE. EDGE NAILING SHALL HAVE 1" EDGE DISTANCE FROM EDGE OF PANEL.
ROOF DECK SHEATHING (NOTES 1, 2)	FLEXIBLE VENEER & BRICK VENEER (NOTE 5)	MIN 3/4" 24/16 SPAN RATED OSB OR PLYWOOD INSTALLED W/ 8d COMMON, 3" O.C. AT PANEL EDGES, 6" O.C. IN THE FIELD.
	BRITTLE VENEER (EXCLUDING BRICK VENEER) (NOTE 6)	MIN 1/2" 32/16 SPAN RATED OSB OR PLYWOOD INSTALLED VERTICALLY OR 5/8" 24/16 INSTALLED HORIZONTALLY W/ 8d COMMON, 3" O.C. AT PANEL EDGES, 12" O.C. IN THE FIELD. 2x4 BLOCKING IS REQUIRED AT UNSUPPORTED PANEL EDGES.
	TILE ROOF (NOTE 7)	MIN 3/4" 32/16 SPAN RATED PLYWOOD INSTALLED WITH LONG DIMENSION PERPENDICULAR TO SUPPORTS W/ 8d RING SHANK NAILS. 4" O.C. AT PANEL EDGES AND 8" O.C. IN THE FIELD.
	SHINGLE ROOF	MIN 1/4" 24/16 SPAN RATED OSB OR PLYWOOD INSTALLED WITH LONG DIMENSION PERPENDICULAR TO SUPPORTS W/ 8d RING SHANK NAILS. 6" O.C. AT PANEL EDGES, 12" O.C. IN THE FIELD.
FLOOR DECK SHEATHING: (NOTE 5)		3/4" T&G OSB OR PLYWOOD W/ 10d COMMON, 6" O.C. AT PANEL EDGES, 12" O.C. IN THE FIELD.
	PORCH CEILING BOARD SHEATHING:	MIN 3/4" OSB OR PLYWOOD OR CDX INSTALLED PERPENDICULAR TO SUPPORTS W/ 8d COMMON, 3" O.C. AT PANEL EDGES, 12" O.C. IN THE FIELD.
SHEARWALL (SW) SHEATHING: (NOTE 8)		MIN 3/4" OSB OR PLYWOOD W/ 8d COMMON, 3" O.C. AT PANEL EDGES, 6" O.C. IN THE FIELD.

NOTES:
1. FOR SHEATHING THICKNESS GREATER THAN 3/4" CATEGORY (32/16 SPAN RATING), USE 10d RING SHANK NAILS IN LIEU OF 8d RING SHANK NAILS. (0.148" x 3" LONG).
2. COMMON NAILS IN WALL SHEATHING MAY BE SUBSTITUTED W/ 8d GALVANIZED BOX NAILS.
3. ZIP WALL SHEATHING IS AN ACCEPTABLE ALTERNATE FOR APA RATED WOOD STRUCTURAL PANEL.
4. ALL WOOD STRUCTURAL PANEL SHALL CONFORM TO THE MOST CURRENT APPLICABLE SPECIFICATION AND SUPPLEMENTS OF THE APA.
5. FASTENERS ARE MINIMUM REQUIRED FOR DIAPHRAGM DESIGN. FOR INCREASED FLOOR PERFORMANCE AND TO AVOID SQUEEING, 8d RING SHANK NAILS OR 8d SCREW NAILS ARE RECOMMENDED.
6. 1/2" 32/16 SPAN RATED OSB OR PLYWOOD WITH BLOCKED PANEL EDGES IS AN APA RECOMMENDATION PER TECHNICAL BULLETIN Q370 (STUCCO). SHOULD BUILDER SPECIFICATIONS ALLOW, MIN STRUCTURAL REQUIREMENTS ARE 3/4" 24/16 SPAN RATING INSTALLED HORIZONTALLY OR 5/8" 24/16 SPAN RATED PLYWOOD INSTALLED VERTICALLY PER FLEXIBLE VENEER WALL SPECIFICATIONS.
7. 3/4" PLYWOOD IS A WARRANTY LIMITATION COMMON TO TILE MANUFACTURER'S MINIMUM RECOMMENDATIONS. SHOULD WARRANTY AND INSTALLATION REQUIREMENTS ALLOW, 1/2" APA RATED OSB OR EQUAL MAY BE USED TO SUPPORT TILE ROOF.
8. WOOD STRUCTURAL PANEL MAY BE INSTALLED VERTICALLY OR HORIZONTALLY W/ UNBLOCKED HORIZONTAL PANEL EDGES PROVIDED THE REQUIREMENTS OF THE WALL PANEL CONNECTION DETAIL ON SHEET ST-5 ARE MET. UNO, BLOCKED WALL, FIELD NAILING IS PERMITTED TO BE 12" O.C.

TABLE 3: MAXIMUM EXTERIOR WALL STUD SPACING (IN O.C.)

BEARING CONDITION & STUD TYPE	BRITTLE FINISH-1/240 WALL HEIGHT					FLEXIBLE FINISH-1/120 WALL HEIGHT				
	8 FT	9 FT	10 FT	11 FT	12 FT	8 FT	9 FT	10 FT	11 FT	12 FT
ROOF ONLY										
2x4 SPF STUD	16	12	--	--	--	24	16	12	12	--
2x4 NO 2 SPF	16	16	12	--	--	24	16	16	16	12
(2)x24 NO 2 SPF, 2x6 NO 2 SPF	24	24	16	16	12	24	24	24	24	24
2x6 SPF STUD, 2x6 NO 2 SPF	24	24	16	16	12	24	24	24	24	24
ROOF AND FLOOR										
2x4 SPF STUD	24	24	16	16	12	24	24	24	24	16
2x4 NO 2 SPF	24	24	24	24	16	24	24	24	24	16
(2)x24 NO 2 SPF, 2x6 NO 2 SPF	24	24	24	24	16	24	24	24	24	24
2x6 SPF STUD, 2x6 NO 2 SPF	24	24	24	24	16	24	24	24	24	24

NOTES:
1. STUD SPACINGS ABOVE ARE THE MAXIMUM REQUIRED ACCORDING TO STUD HEIGHT AND TYPE, UNLESS NOTED OTHERWISE ON PLAN.
2. IF STUD SPACING IS NOT LISTED, STUD SIZE AND GRADE IS NOT APPLICABLE AT THAT WALL HEIGHT.
3. WALL DESIGNED AS UN-BLOCKED. NO BLOCKING IS REQUIRED AT HORIZONTAL WOOD STRUCTURAL PANEL EDGES. BLOCKING AT HORIZONTAL PANEL EDGES IS RECOMMENDED FOR STUCCO VENEER. SEE TABLE 2.

TABLE 4: NAIL SIZE LEGEND

	DIAMETER	LENGTH
8d COMMON	0.131"	2 1/2"
8d RINGSHANK	0.113"	2 1/2"
10d 1 1/2"	0.148"	1 1/2"
10d	0.131"	3"
10d COMMON	0.148"	3"
12d COMMON	0.148"	3 1/2"
16d COMMON	0.148"	3 1/2"
16d SINKER	0.148"	3 1/2"
16d COMMON	0.182"	3 1/2"

NOTES:
1. INSTALL 10d NAILS UNLESS OTHERWISE SPECIFIED.
2. COMMON WIRE NAILS AND THREADED HARDENED STEEL NAILS SHALL CONFORM TO THE NOMINAL SIZES SPECIFIED IN ASTM F1667. NOMINAL DIAMETER SIZES APPLY TO FASTENERS BEFORE APPLICATION OF PROTECTIVE COATING.
3. WHEN A BORED HOLE IS REQUIRED TO PREVENT SPLITTING OF A WOOD DUE TO FASTENER PENETRATION, THE BORED HOLE SHALL NOT EXCEED 75% OF THE NAIL OR SPIKE DIAMETER.
4. THE NOMINAL DIAMETER AND LENGTH OF TYPICAL FASTENERS SPECIFIED FOR THIS PROJECT ARE AS LISTED IN TABLE 4.

TABLE 6: UPLIFT ANCHORS

SYMBOL	DESCRIPTION	CONCRETE / MASONRY EMBEDMENT	TENSION CAPACITY	MINIMUM EDGE DISTANCE	EPOXY OR ADHESIVE
●	3/8" ATC (ALL THREAD CONNECTION) 3/8" DIA ALL THREAD ROD W/ 2" SQUARE x 1/2" THICK WASHER AT TOP PLATE	4" / 8"	2,050 LB.	1 1/4"	SIMPSON ACRYLIC-TIE ADHESIVE
●	1/2" ATC (ALL THREAD CONNECTION) 1/2" DIA ALL THREAD ROD W/ 3" SQUARE x 1/2" THICK WASHER AT TOP PLATE	6" / 12"	3,200 LB.	1 1/4"	SIMPSON ACRYLIC-TIE ADHESIVE
Ⓑ	ONE STORY QTB (QUICK TIE BLUE) (NOTE 7) 3/8" WIRE ROPE - 3/8" STEEL STUD 2x4 x 2 1/2" x 1/2" WASHER @ TOP PLT	4" / 4"	1,527 LB.	1 1/4"	EPCON G5 HIGH-STRENGTH EPOXY
Ⓑ	TWO STORY QTB (QUICK TIE BLUE) (NOTE 7) 3/8" WIRE ROPE - 3/8" STEEL STUD 2x4 x 2 1/2" x 1/2" WASHER @ TOP PLT	4" / 4"	2,839 LB.	2 1/2"	EPCON G5 HIGH-STRENGTH EPOXY
Ⓒ	ONE STORY QTO (QUICK TIE ORANGE) 3/8" WIRE ROPE - 3/8" STEEL STUD 3" x 3" x 1/2" WASHER @ TOP PLT	6" / 6"	4,455 LB.	3"	EPCON G5 HIGH-STRENGTH EPOXY
Ⓒ	TWO STORY QTO (QUICK TIE ORANGE) 3/8" WIRE ROPE - 3/8" STEEL STUD 3" x 3" x 1/2" WASHER @ TOP PLT	6" / 6"	4,455 LB.	3"	EPCON G5 HIGH-STRENGTH EPOXY


NOTES:
1. ONE ALL THREAD CONNECTION (ATC) IS COMPOSED OF 36ksi ALL-TREAD THAT RUNS THE FULL VERTICAL HEIGHT OF THE WALL, PENETRATING BOTH THE TOP AND BOTTOM PLATES, AND GROUTED WITH SIMPSON ACRYLIC-TIE ADHESIVE IN MASONRY OR CONCRETE. THE ALL-THREAD MAY BE SPLICED WITH A COUPLER THREADED ONTO THE ALL-THREAD AT A MINIMUM DISTANCE OF 1/2" AT EACH END OF THE COUPLER. THE COUPLER SHALL BE RATED FOR ALLOWABLE TENSION OF 2,050 LB FOR 3/8" RODS (3,200 LB FOR 1/2" RODS). THE ALL-THREAD SHALL BE INSTALLED PLUMB WITH THE MAXIMUM DEVIATION FROM VERTICAL OF 3/64" HORIZONTAL PER FOOT VERTICAL.
2. WASHER AND NUT REQUIRED AT THE BOTTOM PLATE FOR ATCS LOCATED IN EXTERIOR WALLS ADJACENT TO OPENINGS AND AT WALL ENDS WHICH TERMINATE AT CORNERS.
3. THE HEX NUT ABOVE THE TOP PLATE SHALL BE TIGHTENED TO APPROXIMATELY 30 ft-lbs OF TORQUE. CHANGES IN MOISTURE CONTENT AND THE RELATED SHRINKAGE OF THE BUILDING MATERIALS WILL EFFECTIVELY ELIMINATE THE PRE-LOADING CAUSED BY THE INITIAL TIGHTENING OF THE NUT. AFTER ALL ROUGH-INS OF THE MECHANICAL AND ELECTRICAL TRADES ARE COMPLETE, AND PRIOR TO INSTALLATION OF INSULATION, RE-TIGHTEN THE UPPER HEX NUTS TO 30 ft-lbs OF TORQUE.
4. IT IS THE RESPONSIBILITY OF THE BUILDING DEPARTMENT OR BUILDER TO VERIFY THE TIGHTNESS OF THE HEX NUT PRIOR TO INSULATION INSTALLATION.
5. REFER TO FRAMING NOTES THIS SHEET FOR EPOXY INSTALLATION SPECIFICATIONS.
6. ATC OR QUICK TIES SHOWN ON FRAMING PLAN AT FIXED LOCATIONS ARE DESIGNATED BY SYMBOLS SHOWN ABOVE. REFER TO TYPICAL WALL SECTION FOR ADDITIONAL REQUIRED ATC LOCATIONS.
7. ALL QTB IN EXTERIOR WALLS MUST HAVE AN ADDITIONAL WALL STUD WITHIN 3" (THIS IS IN ADDITION TO STANDARD WALL FRAMING STUDS). EXCEPTIONS: QTB WITHIN 6" OF DBL STUD, SUCH AS NEXT TO OPENINGS OR SHEATHING SPLICES WITH DBL STUD, DOES NOT REQUIRE ADDITIONAL STUD.

TABLE 7: METAL CONNECTOR SCHEDULE

DTT2Z (NOTES 2,3)	(8) 1/2" x 1 1/2" SDS SCREWS IN STUD 3/8" Ø x 4 1/2" EMBED EPOXY OR SCREW ANCHOR	CS18	(9) 10d COMMON EACH END OF STRAP
HTT4 (NOTES 2,3)	(18) 0.162" x 2 1/2" IN STUD/BEAM/TRUSS, 3/8" Ø x 6" EMBED ANCHOR IN CONCRETE (NOTE 1)	MTS12	(7) 10d x 1 1/2" EACH END
HTT5 (NOTES 2,3)	(26) 0.162" x 2 1/2" IN STUD/BEAM/TRUSS, 3/8" Ø x 6" EMBED ANCHOR IN CONCRETE (NOTE 1)	MSTA24/MS24	(9) 10d COMMON EACH END
HDQ8-SDS3	(20) SDS 3/8" x 3" SCREWS IN STUD GROUP 1/4" DIA x 12" EMBED ANCHOR IN CONCRETE	MSTA36/MS36	(13) 10d COMMON EACH END
STDH14	(38) 16d SINKERS INTO STUDS (WET EMBED)	HTS20	(11) 10d x 1 1/2" IN TRUSS/RAFTER (11) 10d x 1 1/2" IN STUD
LTT20B (NOTE 2)	(10) 10d x 1 1/2" IN STUDS 1/2" x 6" EMBED EPOXY OR SCREW ANCHOR	H2.5THA8	(5) 8d x 1 1/2" IN TRUSS (5) 8d x 1 1/2" IN TOP PLATE
ABU44	(12) 16d COMMON & 3/4" x 7" DRILL & EPOXY	H8	(5) 10d x 1 1/2" IN TRUSS (5) 10d x 1 1/2" IN PLATE
ABU66	(12) 16d COMMON & 3/4" x 7" DRILL & EPOXY (12" EMBED AT GARAGE DOOR RETURNS)	TSP	(9) 10d x 1 1/2" IN STUD (9) 10d x 1 1/2" IN PLATE
HU48, HUC48, HU28-2, HUC28-2	(14) 16d COMMON IN HEADER (6) 10d COMMON IN BEAM	SPH4 / SPH6	(12) 10d x 1 1/2" IN STUD
HU410, HUC410, HU210-2, HUC210-2	(18) 16d COMMON IN HEADER (10) 10d COMMON IN BEAM	DSP	(6) 10d COMMON IN TOP PLATE (8) 10d COMMON IN STUD/HEADER
HGA10KT	(4) SDS 3/8" x 1 1/2" SCREWS IN TRUSS/RAFTER (4) SDS 3/8" x 3" SCREWS IN TOP PLATE	QGT (NOTE 2)	(18) 10d x 1 1/2" IN TRUSS W/ QUICK TIE UPLIFT ANCHOR TO SLAB AS SPECIFIED ON PLAN
LGT3	(26) 16d SINKER IN WALL FRAMING (12) SDS 3/8" x 2 1/2" IN TRUSS	QQT2 (NOTE 2)	(30) 10d x 1 1/2" IN TRUSS W/ QUICK TIE UPLIFT ANCHOR TO SLAB AS SPECIFIED ON PLAN

NOTES:
1. EPOXY ANCHOR EMBED IN CMU TO BE 12-INCHES. OPTIONAL SIMPSON 1/2"x12" TITEN HD IS AN ACCEPTABLE ALTERNATIVE ANCHOR IN ALL CASES EXCEPT GARAGE RETURN HOLDDOWNS.
2. REFER TO FRAMING NOTES THIS SHEET FOR ACRYLIC-TIE INSTALLATION SPECIFICATIONS.
3. QUICK-TIE SUBSTITUTION (INSTALLED W/ EPCON G5 HIGH STRENGTH EPOXY):
• QTB = DTT2Z
• QTO = HTT4 OR HTT5 (PROVIDED) (2) STUDS INSTALLED EACH SIDE OF QTO)
4. PRODUCTS SELECTED USING SIMPSON 2011-2012 CATALOG AND QUICK TIE SPRING 2010 CATALOG. PRODUCTS MAY BE SUBSTITUTED WITH EQUAL OR BETTER APPROVED ALTERNATES REFER TO SIMPSON CATALOG FOR ADDITIONAL INSTALLATION INSTRUCTIONS.
5. IF CONNECTOR IS NOT LISTED ABOVE, CONTACT EOR FOR SPECIFIC FASTENING REQUIREMENTS.
6. POSITIVE PLACEMENT GUN NAILS, 2 1/2" LONG, WITH EQUIVALENT DIAMETER TO COMMON NAILS SPECIFIED ABOVE MAY BE USED FOR ABU POST BASE ANCHORS, CS16, AND MSTA-FLAT STRAPS.

TABLE 8: SPECIFIED SHEARWALLS

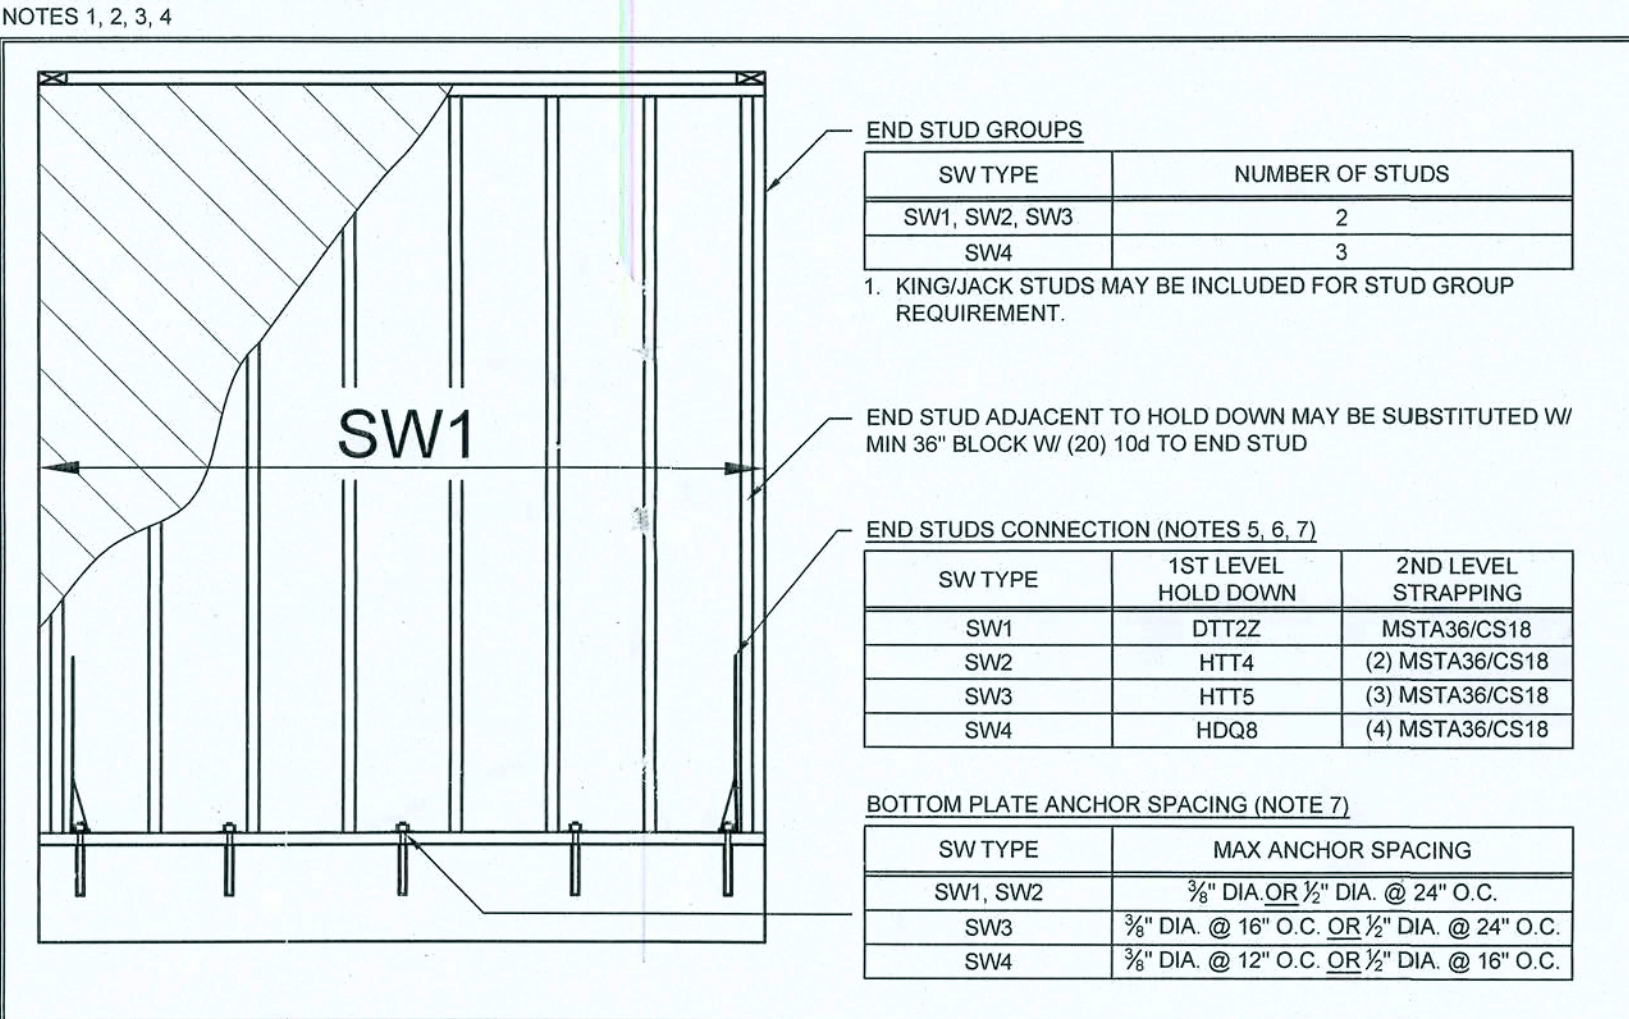

NOTES:
1. THE EXTERIOR WALLS ARE FULLY SHEATHED WITH OSB OR PLYWOOD. ALL TYPICAL EXTERIOR WALLS ARE SHEAR WALLS AND ARE PART OF THE BUILDING'S MAIN WIND FORCE RESISTING SYSTEM. ADDITIONAL FRAMING AND HOLD-DOWNS ARE REQUIRED ONLY AS NOTED ON THE PLAN OR IF WALL SEGMENT IS IDENTIFIED AS SW1, SW2, SW3, SW4, OR SWB ON THE PLAN.
2. ALL SW SHEATHING TO BE FASTENED TO FRAMING PER TABLE 2, WOOD STRUCTURAL PANEL SHEATHING REQUIREMENTS.
3. SHEARWALLS INDICATED ON PLAN WITH OPENINGS AND DOOR OPENINGS WITHIN THE SHEARWALL REQUIRE STUD GROUP AND HOLD DOWNS ONLY AT EXTREME END OF DESIGNATED WALL OR PORTION THEREOF AS NOTED ON STRUCTURAL PLAN.
4. SWB - SEE "SWB-SPECIAL SHEAR WALL DETAIL", LOCATED ON THE DETAIL SHEET.
5. 2ND-LEVEL SWB - END STUDS OF SHEAR WALL TO BE ANCHORED PER ONE OF THE FOLLOWING:
• HOLD DOWN WITH FULL-HEIGHT 1/2" Ø ROD TO SLAB. END STUDS TO BE CONTINUOUSLY SUPPORTED THROUGH FLOOR SYSTEM TO SLAB.
• 2ND LEVEL END STUDS TO MATCHING 1ST LEVEL STUD GROUP BELOW W/ STRAPPING AS NOTED. 1ST LEVEL STUD GROUP TO SLAB WITH HOLD DOWN.
6. DESIGNATED SWB'S WITH A COMMON CORNER REQUIRE (1) HOLDDOWN, WHICH IS TO BE LARGEST OF THE TWO HOLDDOWNS SPECIFIED, UNO.
7. ACCEPTABLE BOTTOM PLATE ANCHORS INCLUDE ATC, TITEN HD, HURRI-BOLT, ALL THREAD ROD SCREW IN ANCHORS ALLOWED IN MONOLITHIC FOOTINGS ONLY. EPOXY ANCHORS MUST BE USED IN STEMWALL FOUNDATIONS.

CONCRETE AND FOUNDATION NOTES

1. CONCRETE COMPRESSIVE STRENGTH FOR FOOTINGS= 2,500 PSI AT 28 DAYS (UNO).
2. CONCRETE COMPRESSIVE STRENGTH FOR SLAB = 2,500 PSI AT 28 DAYS (UNO).
3. ALL REINFORCING STEEL #3 AND BIGGER SHALL BE ASTM A615 GRADE 40 DEFORMED BARS (UNO).
4. ALL REINFORCING STEEL SHALL HAVE 90 DEGREE BEND AT CORNERS WITH A 24" LAP. 24" LONG #4 BAR IS RECOMMENDED TO BE INSTALLED AT ALL REINTRANS CORNERS.
5. FIBERMESH IS AN ACCEPTABLE ALTERNATIVE AND SHALL NOT REQUIRE WFF. FIBER LENGTHS SHALL BE 1/2 INCH TO 2 INCHES IN LENGTH. BASKAGE AMOUNTS SHALL RANGE FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. SYNTHETIC FIBERS SHALL COMPLY WITH ASTM C1116. THE MANUFACTURER OR SUPPLIER SHALL PROVIDE CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY THE BUILDING OFFICIAL.
6. MASONRY STEMWALL AND MONOLITHIC FOOTING ARE TO BE REINFORCED AS SHOWN.
7. EARTH AND EARTH FILL SUPPORTING SLABS ON GRADE IS ASSUMED TO HAVE A MINIMUM BEARING CAPACITY OF 2,000 psf IN ACCORDANCE WITH FRC 5TH EDITION (2014) TABLE R401.4.1, AND SHALL BE FREE OF ORGANIC MATERIAL AND COHESIVE SOILS. COMPACT THE FILL IN 12" LIFTS TO AT LEAST 95% OF MODIFIED PROCTOR MAXIMUM DRY DENSITY. IT IS THE OWNER'S OR CONTRACTOR'S RESPONSIBILITY TO CONFIRM THESE ASSUMPTIONS.
8. CONCRETE FLOOR SLABS ON GRADE SHALL BE INSTALLED OVER A MINIMUM 6 MIL POLYETHYLENE VAPOR RETARDER WITH JOINTS LAPPED 6" AND SEALED OVER CLEAN, COMPACTED EARTH OR FILL WITH APPROVED CHEMICAL SOIL TREATMENT FOR PREVENTION OF SUBTERRANEAN TERMITES.
9. STEMWALLS OVER 4' COURSES TALL REQUIRE SPECIAL ATTENTION TO BRACING DURING CONSTRUCTION. CONTACT ENGINEER OF RECORD IF THIS CONDITION EXISTS.
10. TO CONTROL CRACKING, CUT 1" SAWCUTS IN THE SLAB IN A 19x19' GRID WITHIN 12 HOURS OF CONCRETE PLACEMENT. CONTACT EOR FOR ALTERNATIVE METHODS. CONTROL JOINTS ARE NOT REQUIRED WHEN WFF OR FIBERMESH ARE INCLUDED WITH CONCRETE WORK.
11. DO NOT SCALE FOOTING DIMENSIONS AND LOCATIONS FROM THE FOUNDATION PLAN. DO NOT DETERMINE FOOTING LOCATION FROM ARCHITECTURAL PLANS OR FRAMING PLAN. IF FOOTING SIZE OR LOCATION IS NOT DETERMINATE FROM USE OF FOUNDATION PLAN ALONE, CONTACT THE ENGINEER OF RECORD.

PRE-ENGINEERED TRUSSES & I-JOISTS

1. ROOF OR FLOOR TRUSSES FABRICATED TO ACHIEVE THE ROOF PLANES DEPICTED ON THE ARCHITECTURAL PLANS SHALL BE DESIGNED UNDER THE SUPERVISION OF A REGISTERED FLORIDA PROFESSIONAL ENGINEER. ENGINEERING SHOP DRAWINGS SHALL BE PREPARED IN ACCORDANCE WITH ANSI/PTI-2002 AND SUBMITTED TO THE ENGINEER OF RECORD FOR APPROVAL PRIOR TO FABRICATION. DESIGN CRITERIA IS LOCATED ON SHEET ST-1 OF THE PLAN SET. TEMPORARY BRACING SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND SHALL BE LEFT IN PLACE AFTER CONSTRUCTION IS COMPLETE.
2. TRUSSES OR I-JOISTS SHALL BE DESIGNED TO MATCH THE ORIENTATION, SPAN DIRECTION, SPACING, BEARING LOCATION AND NAMING CONVENTION OF THE LAYOUT SHOWN HERE.
3. THE TRUSS ENGINEER SHALL PROVIDE ALL TRUSS TO TRUSS CONNECTION DESIGN AND SPECIFICATIONS AND SUBMIT THEM UNDER SIGN AND SEAL WITH THE TRUSS SHOP DRAWINGS.
4. TRUSS UPLIFTS HAVE BEEN CALCULATED BY THE ENGINEER OF RECORD AND TAKEN INTO CONSIDERATION DURING THE DESIGN OF THE UPLIFT RESTRAINT SYSTEM FOR THIS STRUCTURE. AS SUCH, THE REPORTED UPLIFTS ON THE TRUSS SHOP DRAWINGS MAY BE DISREGARDED.
5. CONNECT ALL TRUSSES TO TOP PLATE AS SPECIFIED ON THE TYPICAL WALL SECTION SHEET.
6. I-JOISTS FABRICATED TO ACHIEVE THE FLOOR PLANS DEPICTED ON THE ARCHITECTURAL PLANS SHALL BE DESIGNED AND SUBMITTED TO THE ENGINEER OF RECORD FOR APPROVAL PRIOR TO FABRICATION AND INSTALLATION. SEE DESIGN CRITERIA, THIS SHEET.

SHEET INDEX

ST-1.....	STRUCTURAL SPECIFICATIONS
ST-2.....	FOUNDATION PLAN
ST-3.....	1ST LEVEL STRUCTURAL FRAMING PLAN
ST-3A.....	1ST LEVEL ROOF FRAMING PLAN
ST-4.....	2ND LEVEL STRUCTURAL FRAMING PLAN (IF APPLICABLE)
ST-4A.....	2ND LEVEL ROOF FRAMING PLAN (IF APPLICABLE)
ST-5.....	TYPICAL WALL SECTION SHEET
ST-6.....	SECTIONS AND DETAILS (IF APPLICABLE)
ST-7.....	SECTIONS AND DETAILS (IF APPLICABLE)

LEGEND

UNO	UNLESS NOTED OTHERWISE ON PLAN OR DETAIL
EOR	ENGINEER OF RECORD
EW	EACH WAY
OSB	ORIENTED STRAND BOARD
WSP	WOOD STRUCTURAL PANEL
SWP	SOUTHERN YELLOW PINE
SPF	SPRUCE-PINE-FUR
CONT	CONTINUOUS
O.C.	ON CENTER
LSL	1.5SE TIMBERSTRAND LSL ENGINEERED LUMBER, 1 3/4" WIDE, UNO. (3 1/2" WIDE LSL BEAMS ARE EQUIVALENT TO 2-PLY 1 3/4" BEAM)
LVL	1.9E MICROLAM LVL ENGINEERED LUMBER, 1 3/4" WIDE 2.0E PARRALLAM LVL ENGINEERED LUMBER, 3 1/2" WIDE, UNO.
QTB	QUICKTIE BLUE, SEE TABLE 6: UPLIFT ANCHORS
QTG	QUICKTIE GREEN, SEE TABLE 6: UPLIFT ANCHORS
QTO	QUICKTIE ORANGE, SEE TABLE 6: UPLIFT ANCHORS

INTERIOR ROOF LOAD BEARING WALL, SPECIFICATIONS OUTLINED ON TYPICAL WALL SECTIONS, DETAIL SHEETS

INTERIOR BEARING WALL WITH NO UPLIFT. NO UPLIFT ANCHORS REQUIRED. MINIMUM BOTTOM PLATE ANCHORAGE IS 3/4" ANCHOR @ 48" O.C. (UNO ON FRAMING PLAN OR SW SPECIFICATIONS).

STRUCTURAL WOOD BEAM

FOUNDATION KEYNOTE CALLOUT

STUD COLUMN KEYNOTE CALLOUT
NUMBER OF STUDS BELOW BEAM/GIRDER TRUSS. STUDS TO MATCH WALL FRAMING SIZE AND GRADE, UNO.

ADDITIONAL CLARITY FOR THE LOCATION OF THE STUD COLUMN
BOTTOM OF STUD COLUMN CONNECTION
• 1ST LEVEL STUD COLUMN: HOLDDOWN REQUIRED AT BASE OF COLUMN
• 2ND LEVEL STUD COLUMN: STRAPPING REQUIRED FROM 2ND LEVEL COLUMN TO 1ST LEVEL STUDS/HEADER/BREAM
• "ATC" REQUIRES 3/4" ATC WITHIN 3" OF SUPPORTED MEMBER.

HEADER STRAPPING KEYNOTE CALLOUT
NUMBER OF STRAPS CONNECTING HEADER TO JACK STUD

TYPE OF STRAP CONNECTING HEADER TO JACK STUD
KING/JACK GROUP BOTTOM CONNECTION
• 1ST LEVEL STUD GROUP: HOLDDOWN REQUIRED AT BASE OF STUD GROUP
• 2ND LEVEL STUD COLUMN: STRAPPING REQUIRED FROM 2ND LEVEL STUD GROUP UP TO 1ST LEVEL STUDS/HEADER/BREAM
NUMBER OF HOLDDOWNS/STRAPS AT BASE OF KING/JACK GROUP


HEADER FRAMING KEYNOTE CALLOUT
NUMBER OF KING STUDS EACH SIDE OF OPENING
NUMBER OF JACK STUDS EACH SIDE OF OPENING
SIZE OF HEADER (ALL HEADERS TO BE NO 2 SYP UNLESS DESIGNATED AS LSL, LVL, PSL, OR WSP)
NUMBER OF PLYS IN HEADER

FRAMING NOTES

1. SIMPSON ACRYLIC-TIE ADHESIVE SHALL BE USED IN ALL DRILLED AND EPOXIED CONNECTIONS TO CONCRETE. EPCON G5 HIGH STRENGTH EPOXY OR EQUIVALENT SHALL BE USED FOR ALL QUICKTIE TO SLAB CONNECTIONS. ANCHOR BOLT, THREADED ROD, OR DOWELED REINFORCING STEEL MAY BE EMBEDDED TO THE SPECIFIED DEPTH, IN A HOLE 1/4" GREATER THAN THE DIAMETER OF THE ANCHOR. ADHESIVE MUST FLL THE HOLE IN THE CONCRETE AND WOOD BOTTOM PLATE. MANUFACTURER'S SPECIFICATIONS MUST BE FOLLOWED FOR PROPER INSTALLATION.
2. ALL LUMBER SPECIFIED ON DRAWINGS IS INTENDED FOR DRY USE ONLY, UNO. ALL WATERPROOFING AND FIRE SAFETY SYSTEMS ARE THE RESPONSIBILITY OF THE CONTRACTOR AND ARE TO BE DESIGNED AND DETAILED BY OTHER.
3. ALL METAL CONNECTORS SPECIFIED ON PLAN ARE IN ADDITION TO FRAMING FASTENER REQUIREMENTS LISTED IN FLORIDA BUILDING CODE TABLE 2304.91.
4. BEAMS IDENTIFIED BY NUMBER ON PLAN ARE TO BE PROVIDED BY TRUSS MANUFACTURER.
5. FASTEN ALL MULTI-PLY STUD COLUMNS AND CORNERS TOGETHER WITH (2) ROWS 10d COMMON @ 8" O.C. STAGGERED. UPPER LEVEL MULTI-PLY STUD GROUPS TO BE CONTINUOUS THROUGH FLOOR SYSTEM TO FOUNDATION.
6. FASTEN ALL STUDS TO BOTTOM AND TOP PLATES WITH (4)8d TOE NAILS OR (2)16d COMMON END NAILS.
7. FASTEN ALL TRUSSES AND RAFTERS TO TOP PLATES WITH (3)8d TOE NAILS.
8. ALL MULTI-PLY TRUSS GIRDERS AND BEAMS TO HAVE SOLID STUD GROUP BELOW MATCHING GIRDER OR BEAM THICKNESS AND MATCHING WALL STUD SPECIFICATIONS AS NOTED ON STRUCTURAL PLAN, UNO.

HEADER FRAMING

1. ALL HEADER JACK AND KING STUDS SHALL BE FASTENED TO EACH OTHER WITH (2) ROWS 10d @ 8" O.C. STAGGERED.
2. WSP HEADERS ARE WOOD STRUCTURAL PANEL HEADERS AND HAVE THE FOLLOWING REQUIRE

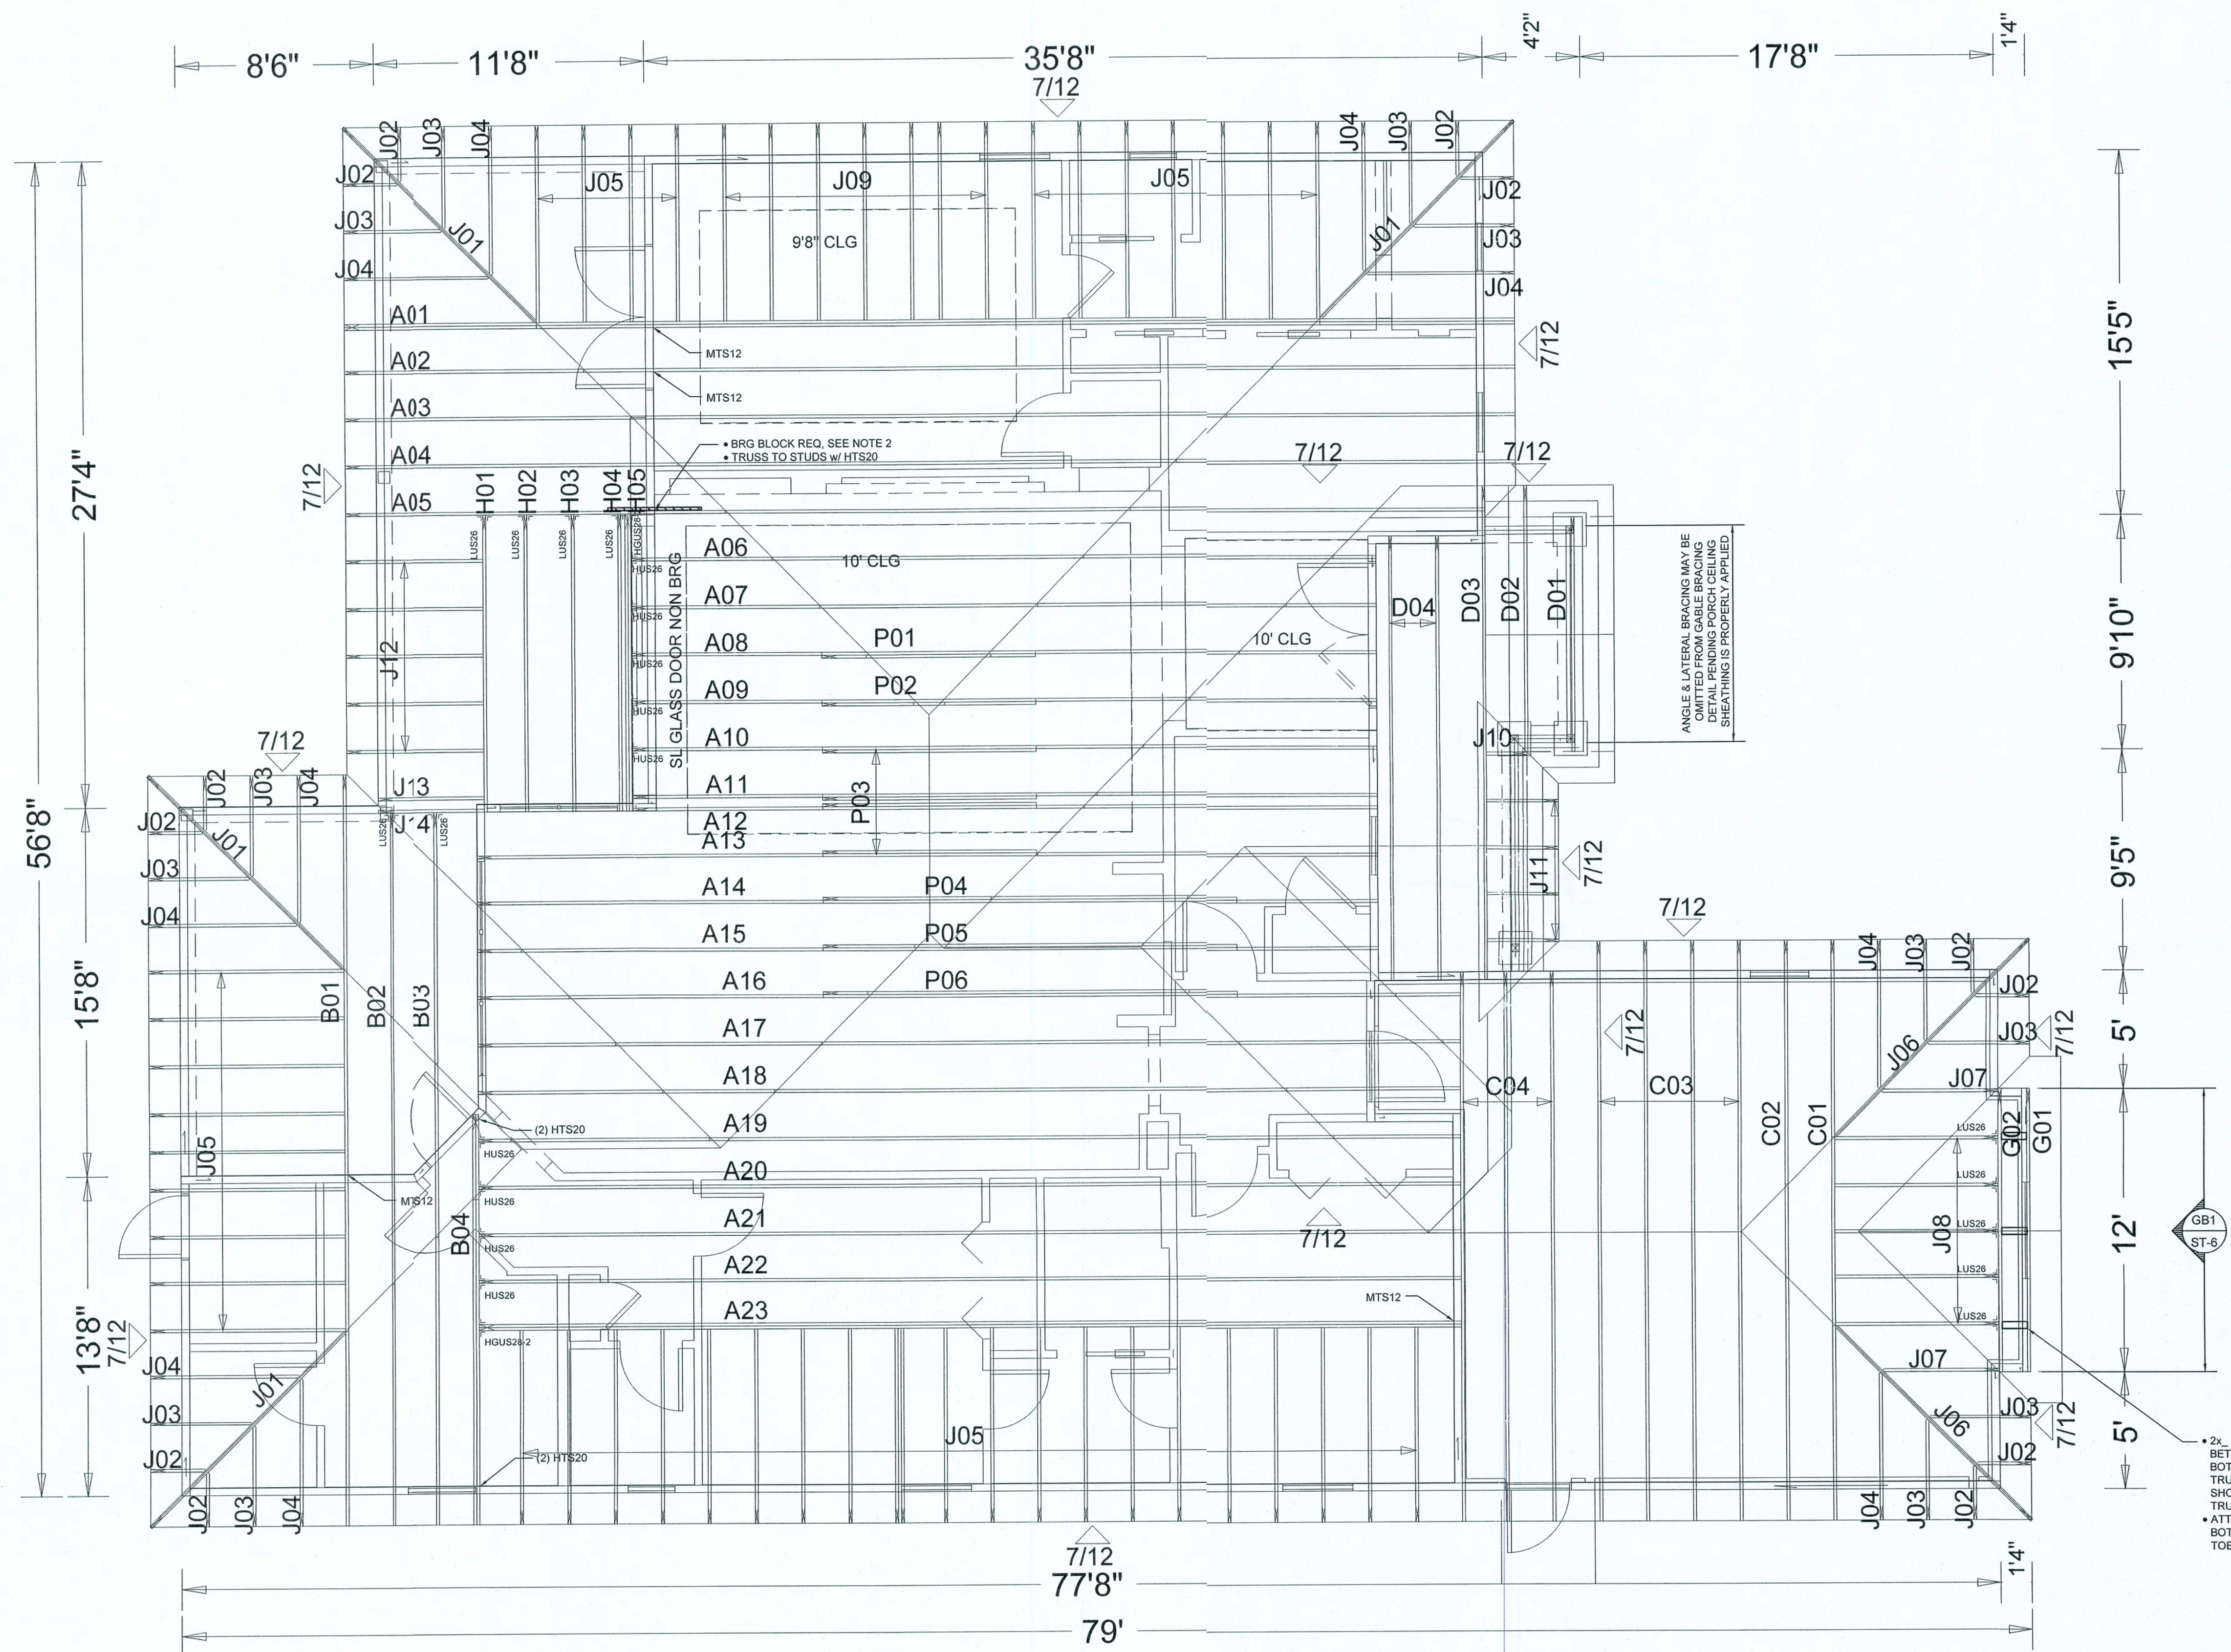

ROOF FRAMING KEYNOTES

NOTES APPLICABLE ONLY WHERE SPECIFIED ON PLAN

- 1. **PRE-MANUFACTURED SHEAR PANEL**
 - INSTALL AS SHOWN ON LAYOUT ABOVE SW SPECIFIED ON FRAMING PLAN
 - SHEAR PANEL TO SW DBL TOP PLT W 104 @ 3" O.C.
 - FLOOR DECK TO SHEAR PANEL W 104 @ 3" O.C.
- 2. **TYPICAL BEARING BLOCK**
 - BEARING BLOCK TO BE NO 2 STYP. MIN 48" LONG AND TO MATCH DIMENSION OF TRUSS MEMBER.
 - ATTACH BEARING BLOCK TO TRUSS VERTICAL OR TRUSS BOTTOM CHORD W/D (3) ROWS 10d @ 4" O.C. STAGGERED.
- 3. **LEDGER FRAMING NOTES:**
 - FASTEN LEDGER TO FRAMING/TRUSS VERTICALS AT EVERY SUPPORT WITH FASTENING SHOWN BELOW (MAX 24" O.C. SPACING)
 - ADDITIONAL FASTENERS MAY BE REQUIRED AT SPECIFIED LOCATIONS ON PLAN
 - SEE TABLE 3 ON SHEET ST-15/161 FOR FASTENER PROTECTION AGAINST CORROSION
 - IN ACCORDANCE W/ FRC 502.2.1, EXTERIOR DECK LEDGERS SHALL BE SECURE TO WALL FRAMING WITH 10D SCREWS AS INDICATED ABOVE. COMMON WALLS AT FLOOR FRAMING LEDGERS ARE FOR INTERIOR USE ONLY.

ROOF FRAMING LEDGER:

2x6.....(4) 12d COMMON
2x8.....(6) 12d COMMON
2x10.....(8) 12d COMMON
2x12.....(10) 12d COMMON

FLOOR FRAMING LEDGER (W/ NAILS):

PT 2x6.....(3) 16d COMMON
PT 2x8.....(5) 16d COMMON
PT 2x10.....(7) 16d COMMON
PT 2x12.....(9) 16d COMMON

FLOOR FRAMING LEDGER (W/ SCREWS):

PT 2x6.....(5) 3" x 4-1/2" LONG #14 WOOD SCREWS
PT 2x8.....(7) 3" x 4-1/2" LONG #14 WOOD SCREWS
PT 2x10.....(9) 3" x 4-1/2" LONG #14 WOOD SCREWS
PT 2x12.....(11) 3" x 4-1/2" LONG #14 WOOD SCREWS

4. **OVERFRAMING NOTES**
- ALL RAFTERS TO BE MIN. 2x6 NO.2 SYP @ 24" O.C. MAX.
 - ALL "SLEEPERS" TO BE PLANK-ORIENTED 2x8 NO.2 SYPMIN.
 - FASTEN "SLEEPERS" TO EACH TRUSS/RAFTER W/ (3) 16d COMMONS MIN.
 - EACH RAFTER TO "SLEEPER" W/ SIMPSON H3 UPLIFT CONNECTOR.
 - ALL RIDGE BOARDS TO BE 2x8 NO.2 SYP MIN.
 - FASTEN 2x6 NO.2 SYP COLLAR TIES FROM RAFTER TO RAFTER WHERE APPLICABLE W/ (5) 10d COMMONS MIN

RAFTER SPAN SCHEDULE				
O.C. SPACING	LUMBER SIZE			
	2x6	2x8	2x10	2x12
12"	15'-5"	19'-11"	23'-9"	26'-0"
16"	13'-4"	17'-3"	20'-7"	22'-0"
24"	10'-11"	14'-1"	16'-10"	19'-9"
20 L.L./15 D.L. #2 SYP				

CEILING JOIST SPAN SCHEDULE				
O.C. SPACING	LUMBER SIZE			
	2x4	2x6	2x8	2x10
12"	12'-5"	19'-6"	25'-8"	26'-0"
16"	11'-3"	17'-8"	23'-4"	26'-0"
24"	9'-10"	15'-6"	20'-1"	23'-11"
10 LL/5 D.L. #2 SYP				

5. DRAFT STOPPING AT FLOOR TRUSSES TO BE PROVIDED BY BUILDER IN ACCORDANCE WITH FRC R302.12.

TRUSS ENGINEERING NOTES:

- UNLESS SPECIFICALLY NOTED ON TRUSS FRAMING PLAN, ALL TRUSS TO TOP PLATE CONNECTIONS SHALL BE ACCORDING TO THE TYPICAL WALL SECTION SHEET.
- ALL EXTERIOR WALLS ARE HELD BACK 1/2" FOR SHEATHING.

- 2x_ FLATWISE BLOCKING BETWEEN GABLE TRUSS BOTTOM CHORD AND GIRDER TRUSS BOTTOM CHORD AS SHOWN, ALIGN WITH OPPOSING TRUSSES @ MAX 48" O.C.
- ATTACH EACH BLOCK TO TRUSS BOTTOM CHORD W/ (3) 10d TOE-NAILS



8/21/2013

COMBINED USE PANEL (CUP) ENGINEERING

APEX JOB NO: BZH5280
ADDRESS: LAKE CITY FLORIDA

 Arthur Rutenbergsm
Homes

copyright
arthur rutenberg homes, inc.
all rights reserved

plan DISCUMPER

ARTHUR RUTENBERG HOMES, INC., THE DESIGNER, IS RESPONSIBLE FOR THE AESTHETIC DESIGN ONLY AS REPRESENTED IN THESE DRAWINGS PLANS, BUT NOT FOR ANY STRUCTURAL INFORMATION INCLUDED OR OMITTED. THE CONTRACTOR (BUILDER) IS RESPONSIBLE BOTH FOR CONFORMING THESE PLANS AND CONSTRUCTING THE RESIDENCE TO ALL APPLICABLE FEDERAL, STATE, AND LOCAL BUILDING CODES, ORDINANCES, AND LAWS, INCLUDING BUT NOT LIMITED TO THE FOLLOWING: EGRESS, FIRE SAFETY, TECHNICAL CODES, FLOOD ZONE CRITERIA, HURRICANE CODES, PRE-ENGINEERED TRUSS, FRAMING MEMBERS, INSULATION, FINISHING, AND MOISTURE PROTECTION. BY USE OF THESE DRAWINGS THE OWNER, CONTRACTOR (BUILDER), AND SUBCONTRACTORS ACKNOWLEDGE AND AGREE TO THIS DISCLAIMER.

The Antiqua 1441F - I-GREEN RESIDENCE

Builder: bryan zecher homes, inc.
lake city, FLORIDA
An independently owned and Operated Franchise

Roof Framing Plan 1/4"=1'-0"

ST-3A

WALL SECTION AT ROOF (COMMON HEEL CONDITION)

(THIS SECTION IS TYPICAL. FOR ONE AND TWO STORY APPLICATIONS)

WALL SECTION AT FOUNDATION

(THIS SECTION IS TYPICAL FOR ONE AND TWO STORY APPLICATIONS)

TYPICAL WALL SECTIONS

PLANK HEADER FRAMING ELEVATION

WALL SECTION AT ROOF (RAISED HEEL CONDITION)

(THIS SECTION IS TYPICAL FOR ONE AND TWO STORY APPLICATIONS)

WALL SECTION AT ROOF (CANTILEVER CONDITION)

(THIS SECTION IS TYPICAL FOR ONE AND TWO STORY APPLICATIONS)

ALTERNATE WALL SECTIONS

GENERAL NOTES APPLICABLE TO ALL:

1. ALL TOP PLATES ARE TO BE BUILT WITH (2)2x_ NO 2 SYP FASTENED W/(2) ROWS 10d @ 8" O.C. STAGGERED (UNO). MINIMUM 48" LAP W/ MINIMUM (20)10d IN LAP. ADJUST TYPICAL NAIL SPACING AS NEEDED.
2. ALL BOTTOM PLATES ARE TO BE 2x_ NO 2 SYP PT.
3. ALL INTERIOR LOAD BEARING WALL STUDS ARE TO BE MINIMUM 2X4 NO 2 SPF AT 16" O.C. UNLESS NOTED OTHERWISE ON FRAMING PLAN.
4. FOR EXTERIOR WALL STUD SIZE AND SPACING, REFER TO TABLE 3: MINIMUM EXTERIOR WALL STUD SIZES ON SHEET ST-1.
5. FOR SHEATHING SIZE AND FASTENING REFER TO TABLE 2: WOOD STRUCTURAL PANEL SHEATHING REQUIREMENTS ON SHEET ST-1.
6. FOUNDATION INFORMATION ON THIS PAGE IS FOR GRAPHICAL DEPICTION ONLY. REFER TO FOUNDATION PLAN AND SECTIONS FOR FOUNDATION INFORMATION.
7. WALL SECTION AT FOUNDATION AND WALL SECTION AT ROOF ARE TYPICAL FOR ONE AND TWO STORY APPLICATIONS.
8. STUD TO BOTTOM PLATE CONNECTION MAY BE OMITTED IF ½" ANCHOR W/ 3" SQUARE BY ¼" WASHER INSTALLED @ 24" O.C. (WASHER NOT REQUIRED W/ MASA)

DOUBLE CMU STEMWALL SECTION

9 GARAGE ENTRY CMU STEMWALL SECTION

1. SPECIAL CARE SHOULD BE EXERCISED BY CONTRACTOR WHEN BACK FILLING BEHIND A STEM WALL, PARTICULARLY WHEN IT IS OVER 4 COURSES HIGH. SHOULD THIS CONDITION EXIST, RECOMMENDATIONS MAY BE OBTAINED FROM THE ENGINEER OF RECORD.
2. SCREW IN ANCHORS ALLOWED IN MONOLITHIC FOOTINGS ONLY. SCREW ANCHORS MUST BE USED IN STEMWALL FOUNDATIONS.

1. The engineering data and details contained herein are the property of Apex Technology and are not to be reproduced in any manner, except as approved in writing by Apex Technology.
2. The information represented in this package is intended for the residence or structure indicated in the title block alone. Application of these details to any other structure or application is expressly forbidden.
3. Dimensions should not be scaled from the drawings. If a dimension is unclear or indeterminate from adjacent dimensions, contact the engineer of record for clarification.

The Antigua 1441F - I-GREEN RESIDENCE

Builder: bryan zecher homes, inc.


lake city, FLORIDA
Independently owned and Operated Franchise

Typical Wall Sections $1/4"=1'-0"$

Typical
Plan 1441f-2S-01-B
C.I. S# 1-70
JOB# 88-1710-A-2

ST-5

APEX TECHNOLOGY IS A FICTITIOUS NAME
OWNED BY JAX APEX TECHNOLOGY INC.,
A FLORIDA CORPORATION FLORIDA
ENGINEER BUSINESS NO. 7547-4745
SUCTION PARK COURT, SUITE 402,
JACKSONVILLE, FL. 32224 - 904.821.5200

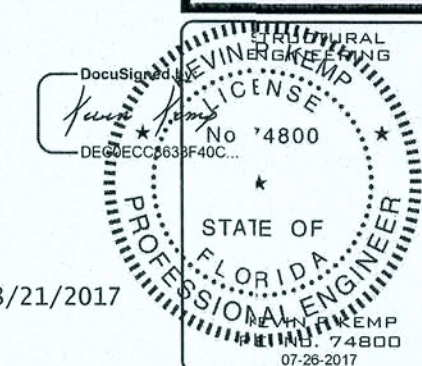

8/21/2017

COMBINED USE PANEL (CUP) ENGINEERING

APEX JOB NO: BZH5280
ADDRESS: LAKE CITY FLORIDA

