


William H. Freeman  
3/15/10  
P.E. # 10007

WEST SIDE COMMUNITY CENTER

128 SW NASSAU STREET  
LAKE CITY, FL 32025  
(386) 758-4209



Freeman  
Design Group Inc.

CERTIFICATE OF AUTHORIZATION # 00008701

DATE	DRAWN BY
11/5/10	W.H.F.
	APPROVED
	W.H.F.

REVISIONS

SHEET	LS-1
OF	1

PROJECT NO.  
09 C037

BUILDING USE, CLASSIFICATION & OCCUPANCY AS PER TABLES 903 & 1004.1.1, FLORIDA BUILDING CODE, 2007 ED.	
BUILDING GROUP OCCUPANCY	GROUP A-3/5-2
TABLE 903 TYPE OF CONSTRUCTION	TYPE V-B unspunked
TABLE 903 AREA/HEIGHT LIMITATIONS	10.5 KSF/1 STORY
OCCUPANCY	
LOAD CAPACITY	294 OCCUPANTS
assembly 15 hat = 288 people	
storage 300 gross = 3 people	
office = 100 gross = 3 people	


ELECTRICAL	COUNT	SYMBOL
emergency lighting with battery backup	4	
exit directional	8	

LIFE SAFETY NOTES

ALL EXIT AND EMERGENCY LIGHTING SHALL BE  
INSTALLED PER NEC 700-12, 2008 EDITION.

ACCESS TO EXITS SHALL BE MARKED BY APPROVED  
READILY VISIBLE SIGNS IN ALL CASES WHERE THE EXIT OR WAY TO  
REACH THE EXIT IS NOT READILY APPARENT TO THE OCCUPANTS.  
SIGN PLACEMENT SHALL BE SUCH THAT NO POINT IN THE EXIT  
ACCESS CORRIDOR IS MORE THAN 100 FT FROM THE NEAREST  
EXTERNALLY ILLUMINATED SIGN AND IS NOT IN EXCESS OF THE  
MARKED RATING FOR INTERNALLY ILLUMINATED SIGNS.

ALL FIRE EXTINGUISHERS SHALL BE TYPE 2A-20BC AND SHALL  
BE LOCATED SO THAT NO POINT IN THE DIRECTION OF TRAVEL  
FROM ANY POINT IS MORE THAN 75 FT TO THE FIRE EXTINGUISHER.  
SEE SHEET E-3 FOR ALARM NOTES AND REQUIREMENTS.

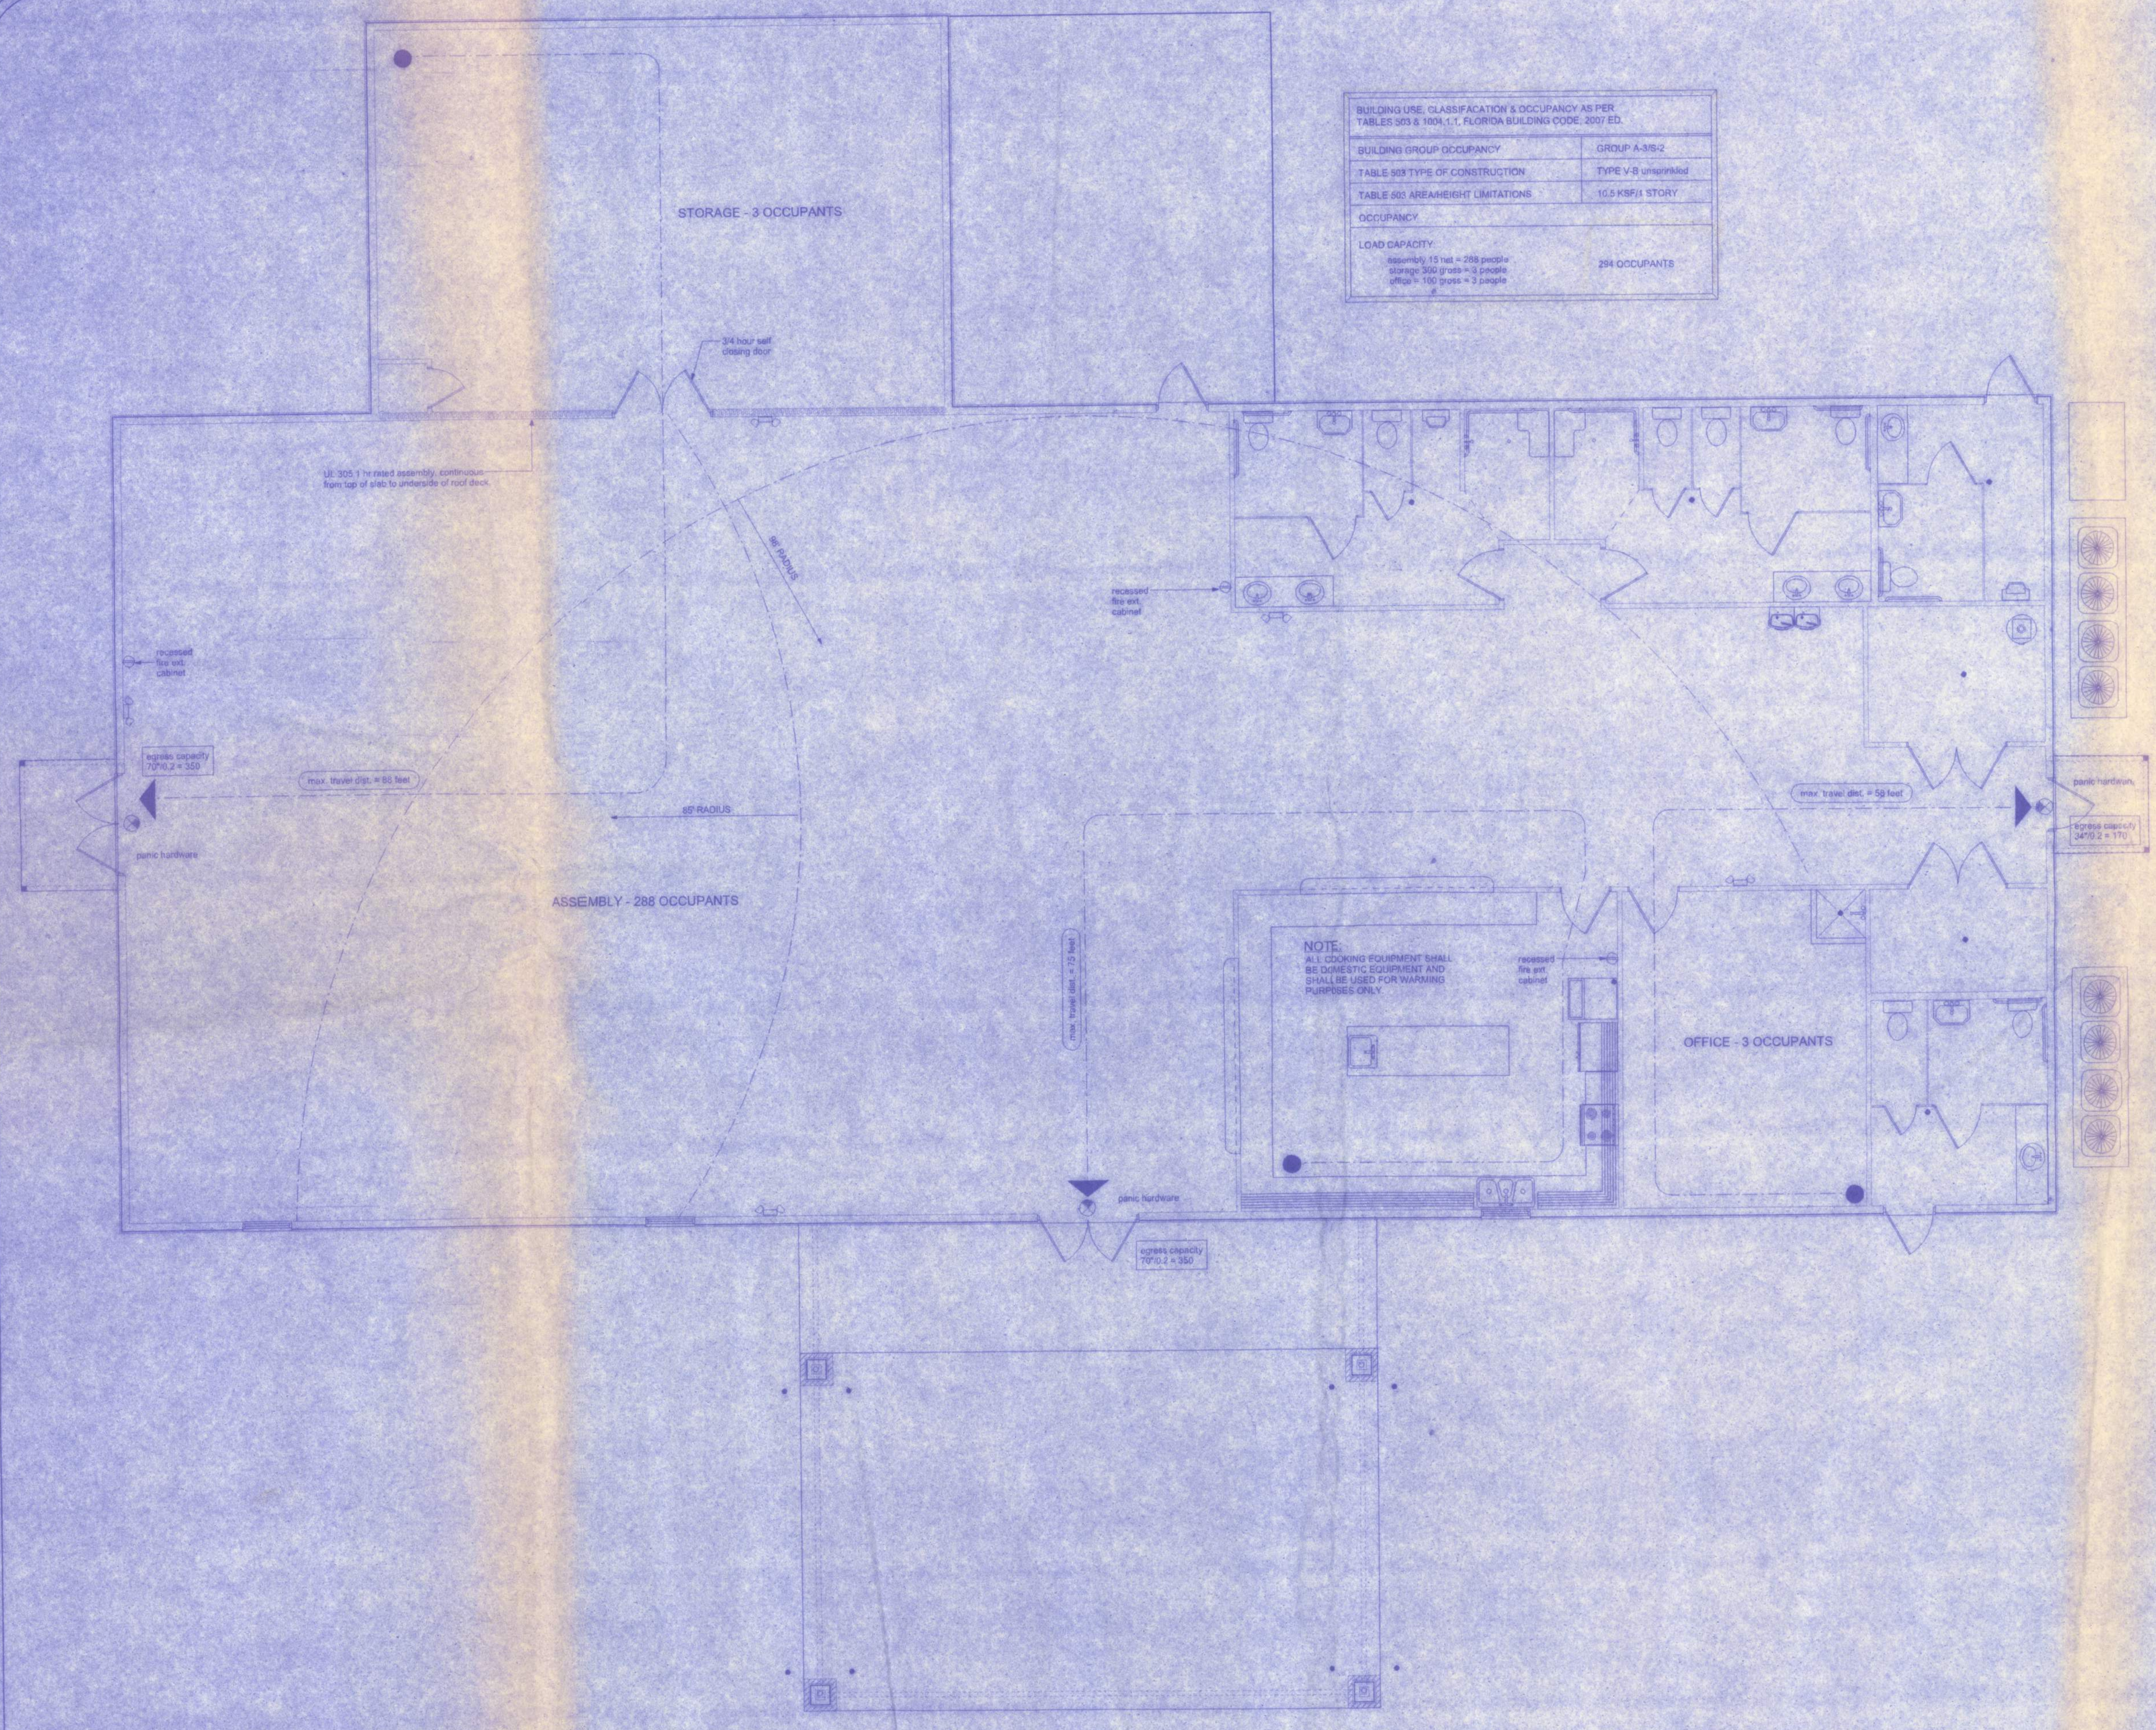

LIFE SAFETY PLAN  
SCALE: 3/16" = 1'-0"