



Lumber design values are in accordance with ANSI/TPI 1 section 6.3  
These truss designs rely on lumber values established by others.

RE: 3842104 - NORRIS - VOIDANOFF RES.

MiTek, Inc.  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200

**Site Information:**

Customer Info: NORRIS CONST. Project Name: Voidanoff Res Model: Custom  
Lot/Block: N/A Subdivision: N/A  
Address: TBD, TBD  
City: Columbia Cty State: FL

**Name Address and License # of Structural Engineer of Record, If there is one, for the building.**

Name: License #:  
Address:  
City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.7  
Wind Code: ASCE 7-22 Wind Speed: 130 mph  
Roof Load: 37.0 psf Floor Load: N/A psf

This package includes 21 individual, Truss Design Drawings and 0 Additional Drawings.

With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	T32764591	CJ01	1/29/24	15	T32764605	T08	1/29/24
2	T32764592	CJ03	1/29/24	16	T32764606	T09	1/29/24
3	T32764593	CJ05	1/29/24	17	T32764607	T09G	1/29/24
4	T32764594	EJ01	1/29/24	18	T32764608	T10	1/29/24
5	T32764595	HJ10	1/29/24	19	T32764609	T10G	1/29/24
6	T32764596	T01	1/29/24	20	T32764610	T11	1/29/24
7	T32764597	T01G	1/29/24	21	T32764611	T11G	1/29/24
8	T32764598	T02	1/29/24				
9	T32764599	T03	1/29/24				
10	T32764600	T04	1/29/24				
11	T32764601	T04G	1/29/24				
12	T32764602	T05	1/29/24				
13	T32764603	T06	1/29/24				
14	T32764604	T07	1/29/24				



This item has been digitally signed and sealed by O'Regan, Philip, PE on the date adjacent to the seal.


Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies

The truss drawing(s) referenced above have been prepared by  
MiTek USA, Inc. under my direct supervision based on the parameters  
provided by Builders FirstSource-Lake City, FL.

Truss Design Engineer's Name: O'Regan, Philip

My license renewal date for the state of Florida is February 28, 2025.

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

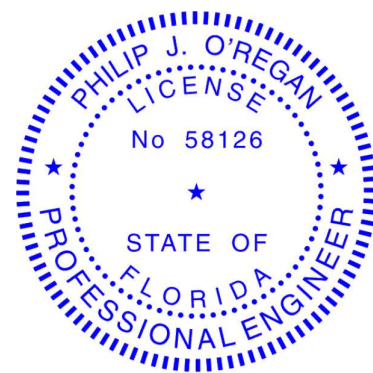

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:


January 29, 2024

O'Regan, Philip

1 of 1

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764591
3842104	CJ01	Jack-Open	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:04 2024 Page 1  
ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-8uUKNtmmDaeGWjZRxDc?EtV0dIVmwJqEVj2865zrUNH

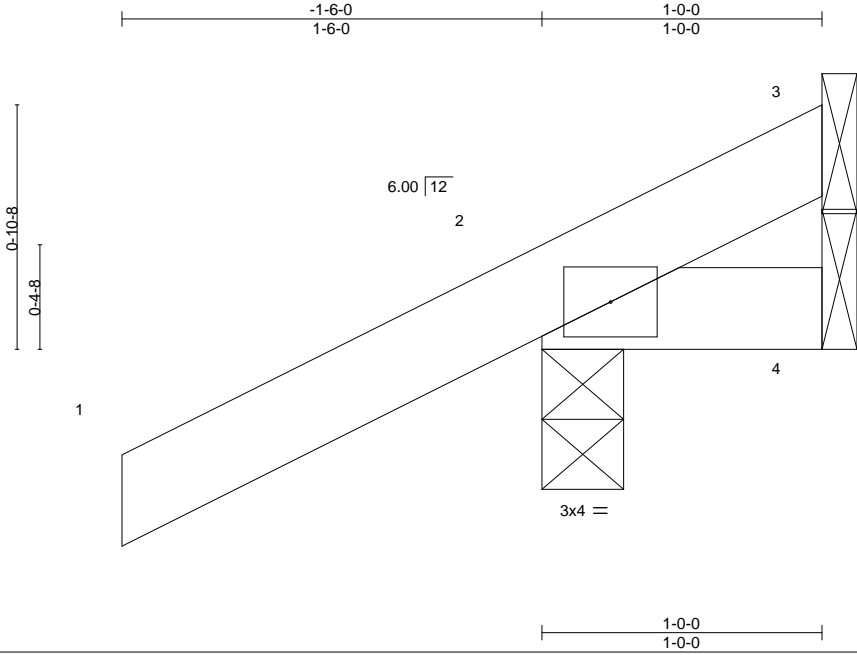

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.25	TC 0.16	Vert(LL)	0.00	7	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL	1.25	BC 0.03	Vert(CT)	0.00	7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014		Matrix-MP						Weight: 6 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=44(LC 12)  
Max Uplift 3=-6(LC 1), 2=-79(LC 12), 4=-19(LC 1)  
Max Grav 3=8(LC 16), 2=179(LC 1), 4=20(LC 16)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 4.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764592
3842104	CJ03	Jack-Open	4	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:05 2024 Page 1  
ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-c41iaDnO\_um78t8eUw7Em42BNiqTfm4NkNohfYzrUNG

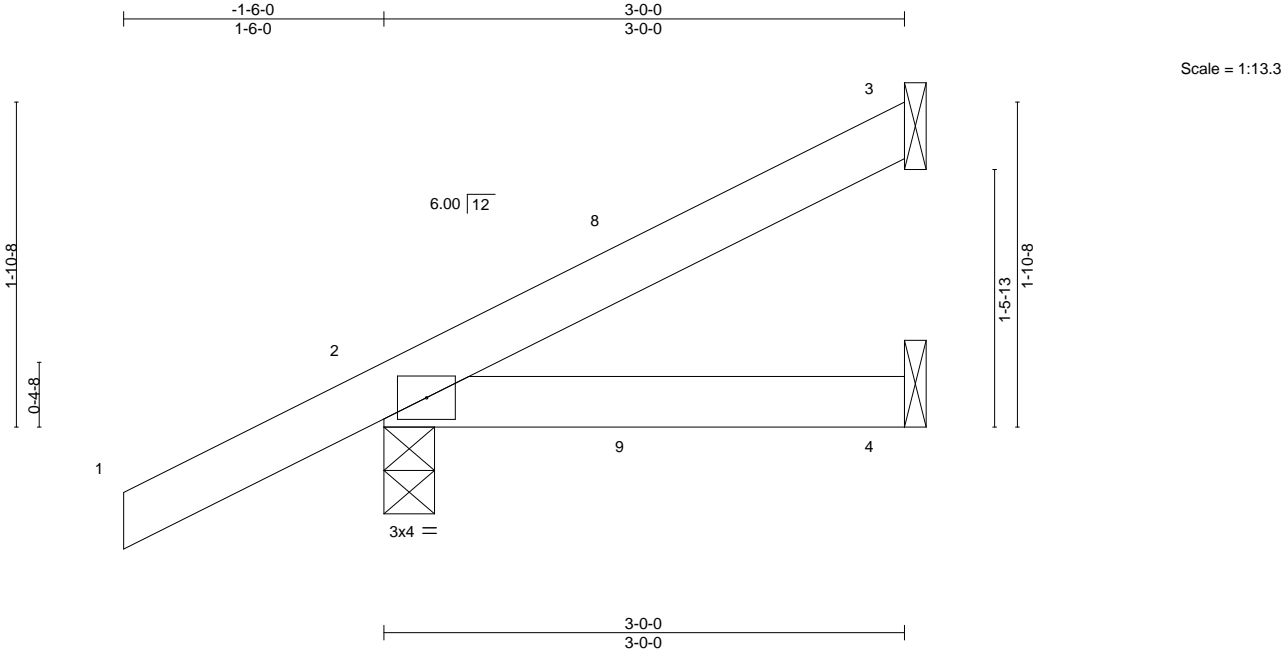

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.16	Vert(LL)	-0.00	4-7	>999	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.07	Vert(CT)	-0.01	4-7	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP					Weight: 12 lb	FT = 20%
	Code FBC2023/TPI2014							

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.	(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
	Max Horz 2=82(LC 12)
	Max Uplift 3=-41(LC 12), 2=-69(LC 12), 4=-19(LC 9)
	Max Grav 3=60(LC 1), 2=210(LC 1), 4=50(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 2-11-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 4.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.
3842104	CJ05	Jack-Open	4	1	T32764593

Builders FirstSource (Lake City,FL),

Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:06 2024 Page 1

ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-4Gb4oYo0lCu\_m1iq2eeTJlbKK684ODKXz1XEB\_zrUNF

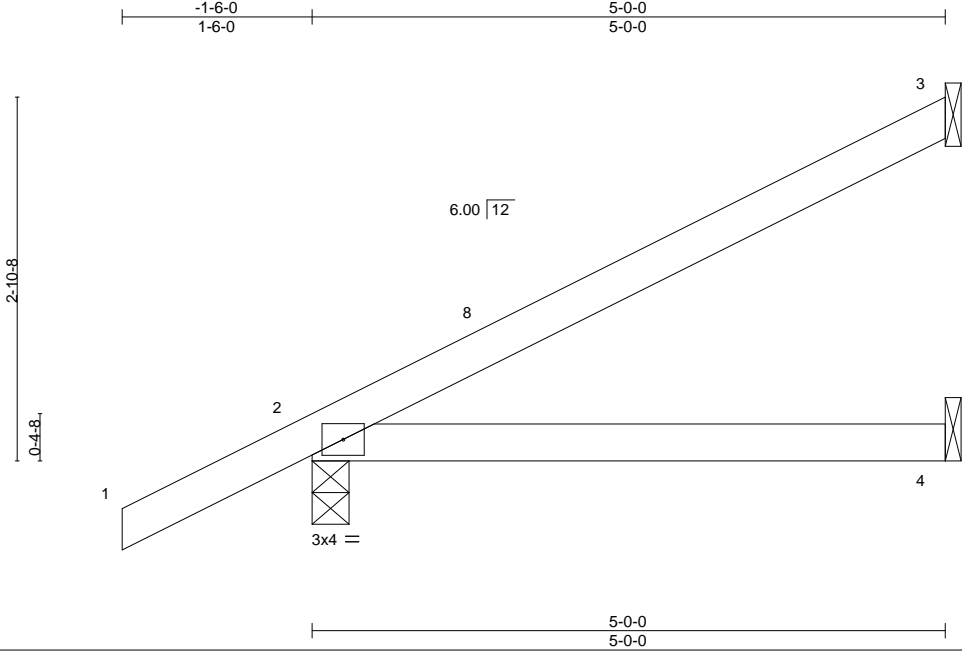

Scale = 1:18.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.28	Vert(LL)	0.03	4-7	>999	MT20	244/190
TCDL 7.0	Plate Grip DOL 1.25	BC 0.24	Vert(CT)	-0.05	4-7	>999		
BCLL 0.0 *	Lumber DOL 1.25	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP					Weight: 18 lb	FT = 20%
	Code FBC2023/TPI2014							

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 2=0-3-8, 4=Mechanical  
Max Horz 2=120(LC 12)  
Max Uplift 3=-77(LC 12), 2=-79(LC 12), 4=-1(LC 12)  
Max Grav 3=113(LC 1), 2=276(LC 1), 4=88(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 4-11-4 zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 4.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764594
3842104	EJ01	Jack-Partial	6	1	Job Reference (optional)	

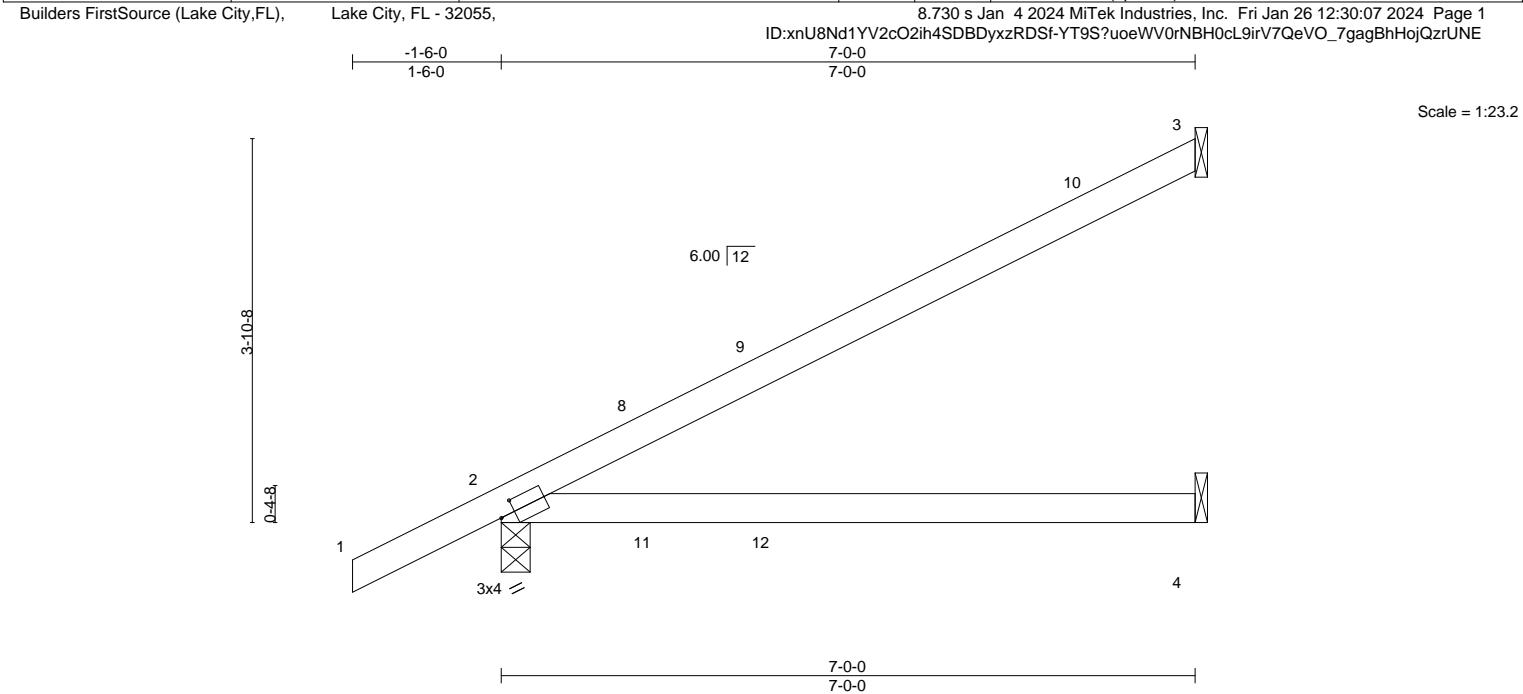


Plate Offsets (X,Y)--		[2:0-1-13,0-1-8]			
<b>LOADING</b> (psf) TCLL 20.0 TCDL 7.0 BCLL 0.0 * BCDL 10.0	<b>SPACING-</b> 2-0-0 Plate Grip DOL 1.25 Lumber DOL 1.25 Rep Stress Incr YES Code FBC2023/TPI2014	<b>CSI.</b> TC 0.63 BC 0.51 WB 0.00 Matrix-MS	<b>DEFL.</b> in (loc) l/defl L/d Vert(LL) 0.19 4-7 >449 240 Vert(CT) -0.22 4-7 >385 180 Horz(CT) 0.01 2 n/a n/a	<b>PLATES</b> MT20    Weight: 25 lb	<b>GRIP</b> 244/190    FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.		(size)	3=Mechanical, 2=0-3-8, 4=Mechanical
		Max Horz	2=153(LC 12)
		Max Uplift	3=-99(LC 12), 2=-93(LC 12), 4=-48(LC 9)
		Max Grav	3=164(LC 1), 2=346(LC 1), 4=126(LC 3)

FORCES.		(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
---------	--	--

- NOTES-**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 6-11-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 4.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764595
3842104	HJ10	Diagonal Hip Girder	2	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:08 2024 Page 1  
ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-0fjqDEpHHp8i?KsDA3gxOjgbuviTs1XqQL0LFszrUND

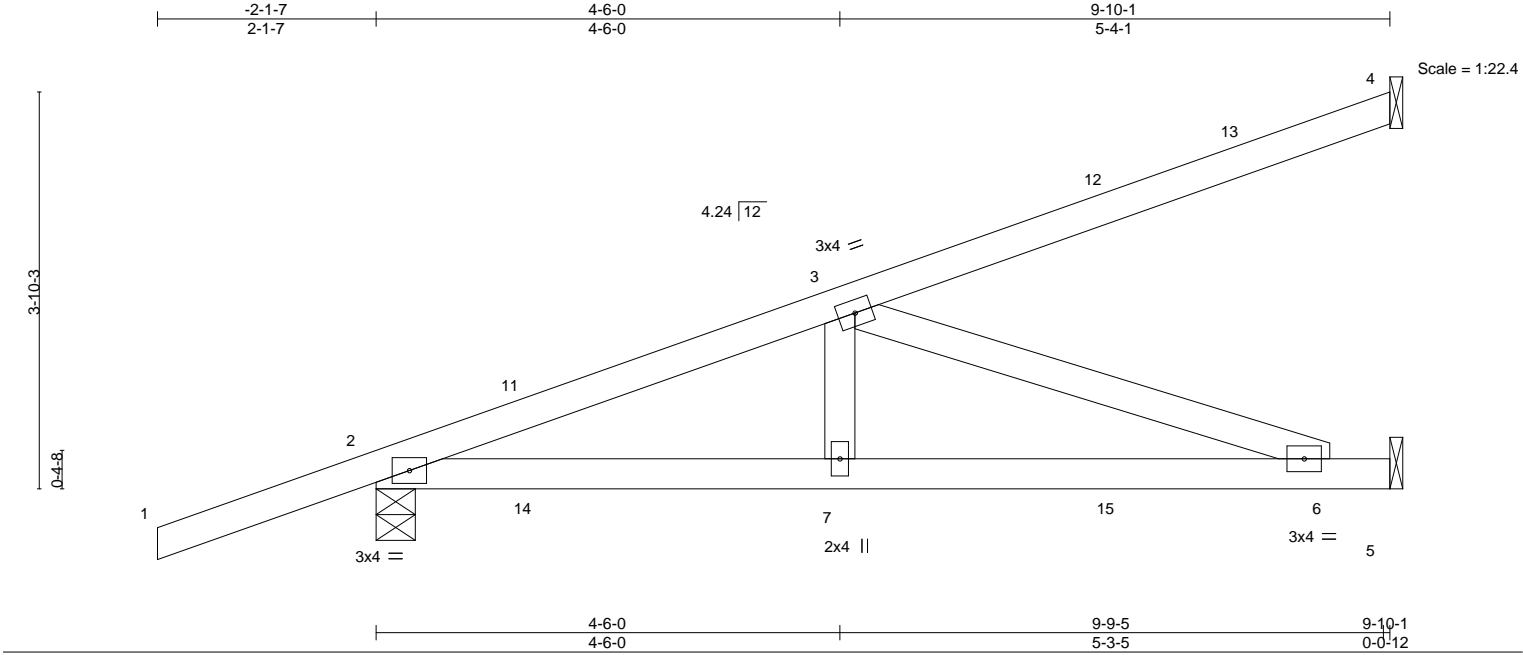

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 2-0-0	TC 0.59	Vert(LL) 0.09	6-7	>999	240		MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.69	Vert(CT) -0.15	6-7	>805	180			
BCLL 0.0 *	Rep Stress Incr NO	WB 0.40	Horz(CT) 0.01	5	n/a	n/a			
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS						Weight: 43 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 8-2-13 oc bracing.
WEBS 2x4 SP No.3	

**REACTIONS.** (size) 4=Mechanical, 2=0-4-9, 5=Mechanical  
Max Horz 2=167(LC 4)  
Max Uplift 4=-91(LC 4), 2=-343(LC 4), 5=-170(LC 4)  
Max Grav 4=151(LC 1), 2=527(LC 1), 5=297(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-804/406  
BOT CHORD 2-7=-467/733, 6-7=-467/733  
WEBS 3-7=-91/298, 3-6=-776/494

- NOTES-**
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; porch left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 2=343, 5=170.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 67 lb down and 74 lb up at 1-6-1, 67 lb down and 74 lb up at 1-6-1, 23 lb down and 46 lb up at 4-4-0, 23 lb down and 46 lb up at 4-4-0, and 45 lb down and 87 lb up at 7-1-15, and 45 lb down and 87 lb up at 7-1-15 on top chord, and 46 lb down and 43 lb up at 1-6-1, 46 lb down and 43 lb up at 1-6-1, 19 lb down and 27 lb up at 4-4-0, 19 lb down and 27 lb up at 4-4-0, and 67 lb down and 16 lb up at 7-1-15, and 67 lb down and 16 lb up at 7-1-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-54, 5-8=-20  
Concentrated Loads (lb)  
Vert: 7=-6(F=-3, B=-3) 12=-73(F=-36, B=-36) 15=-59(F=-29, B=-29)

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com




Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764596
3842104	T01	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:09 2024 Page 1

ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-UrhHDQaqv17GZdURPjmBAwwDmoJz6bQ6zf?mvoJzrUNC

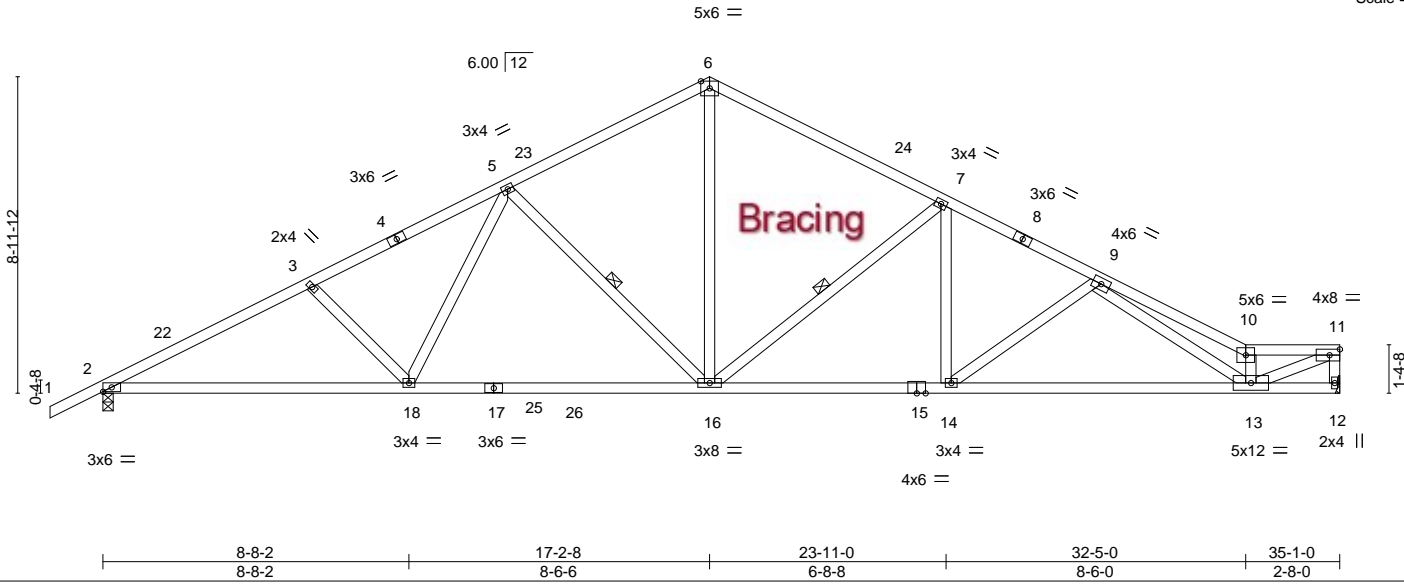

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.58	Vert(LL) -0.29	16-18	>999	240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.98	Vert(CT) -0.54	13-14	>779	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.70	Horz(CT) 0.11	12	n/a	n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS						
							Weight: 193 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-9-1 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 5-16, 7-16
11-13: 2x4 SP No.2	

**REACTIONS.** (size) 12=Mechanical, 2=0-3-8  
Max Horz 2=191(LC 12)  
Max Uplift 12=-335(LC 13), 2=-368(LC 12)  
Max Grav 12=1392(LC 2), 2=1474(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-2607/608, 3-5=-2439/569, 5-6=-1675/438, 6-7=-1686/429, 7-9=-2324/552,  
9-10=-3499/814, 10-11=-2898/625, 11-12=-1383/312  
BOT CHORD 2-18=-642/2303, 16-18=-452/1878, 14-16=-374/2047, 13-14=-534/2362  
WEBS 3-18=-292/205, 5-18=-109/586, 5-16=-625/299, 6-16=-244/1184, 7-16=-766/322,  
7-14=-73/508, 9-14=-394/197, 9-13=-189/935, 10-13=-1639/453, 11-13=-656/3106

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 2-0-2, Zone1 2-0-2 to 17-2-8, Zone2 17-2-8 to 22-2-1, Zone1 22-2-1 to 34-11-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=335, 2=368.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764597
3842104	T01G	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:11 2024 Page 1

ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-QEPzrGr9ZkWHsborBEe0LIDM7tv3ThG6JF?sBzrUNA



Scale = 1:62.6

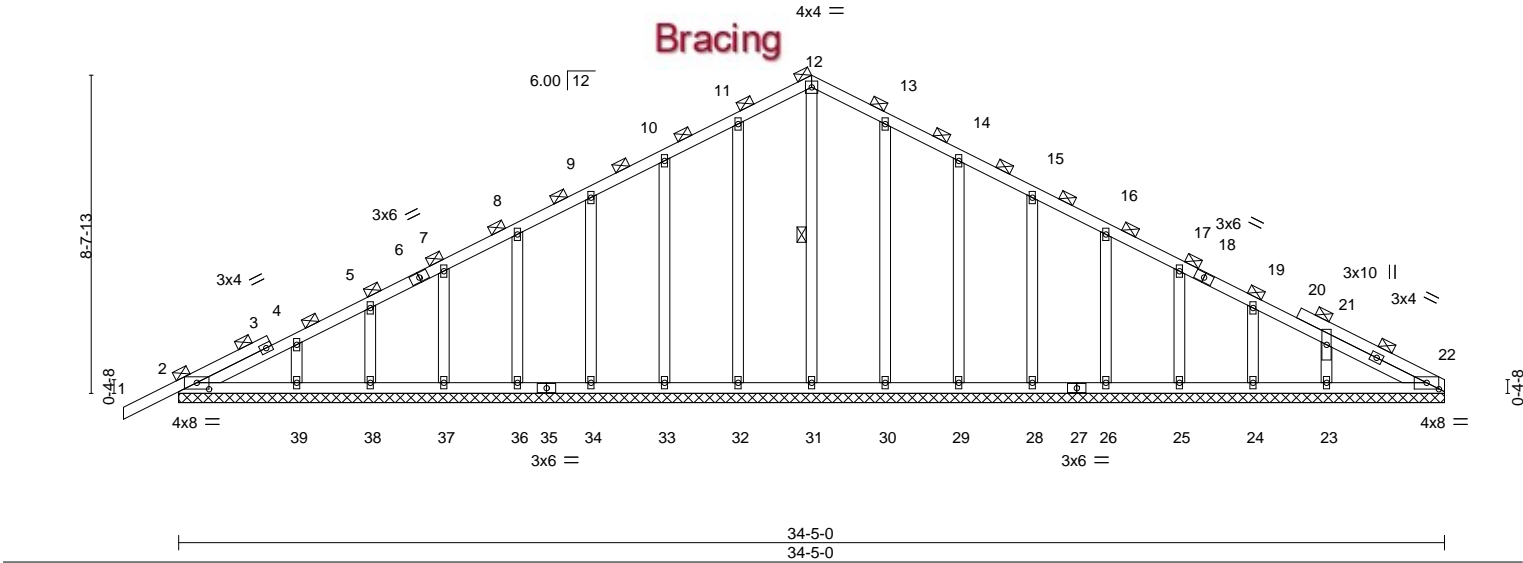


Plate Offsets (X,Y)--		[2:0-4-0,0-2-1], [22:0-4-0,0-2-1]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.13
TCDL 7.0	Lumber DOL	1.25	BC 0.07
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-S
DEFL.	in (loc)	I/defl	L/d
Vert(LL)	0.00 1	n/r	120
Vert(CT)	-0.00 1	n/r	120
Horz(CT)	0.01 22	n/a	n/a
PLATES	GRIP		
MT20	244/190		
Weight: 218 lb		FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	WEBS 1 Row at midpt 12-31

REACTIONS.	All bearings 34-5-0.
(lb) - Max Horz	2=162(LC 12)
Max Uplift	All uplift 100 lb or less at joint(s) 2, 32, 33, 34, 36, 37, 38, 39, 30, 29, 28, 26, 25, 24 except 23=-104(LC 13)
Max Grav	All reactions 250 lb or less at joint(s) 2, 31, 32, 33, 34, 36, 37, 38, 39, 30, 29, 28, 26, 25, 24, 23, 22

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 32, 33, 34, 36, 37, 38, 39, 30, 29, 28, 26, 25, 24 except (jt=lb) 23=104.
  - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com



Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764598
3842104	T02	Roof Special	5	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:13 2024 Page 1

ID:xnU8Nd1YV2cO2ih4SDBDxyzRDSf-NcWjGytP5Lm\_56IAycG75mNQewKMXA\_Zadk6x4zrUN8

-1-6-0	5-11-3	11-5-12	17-2-8	23-7-8	27-4-0	30-7-7	35-1-0
1-6-0	5-11-3	5-6-9	5-8-12	6-5-0	3-8-8	3-3-7	4-5-9

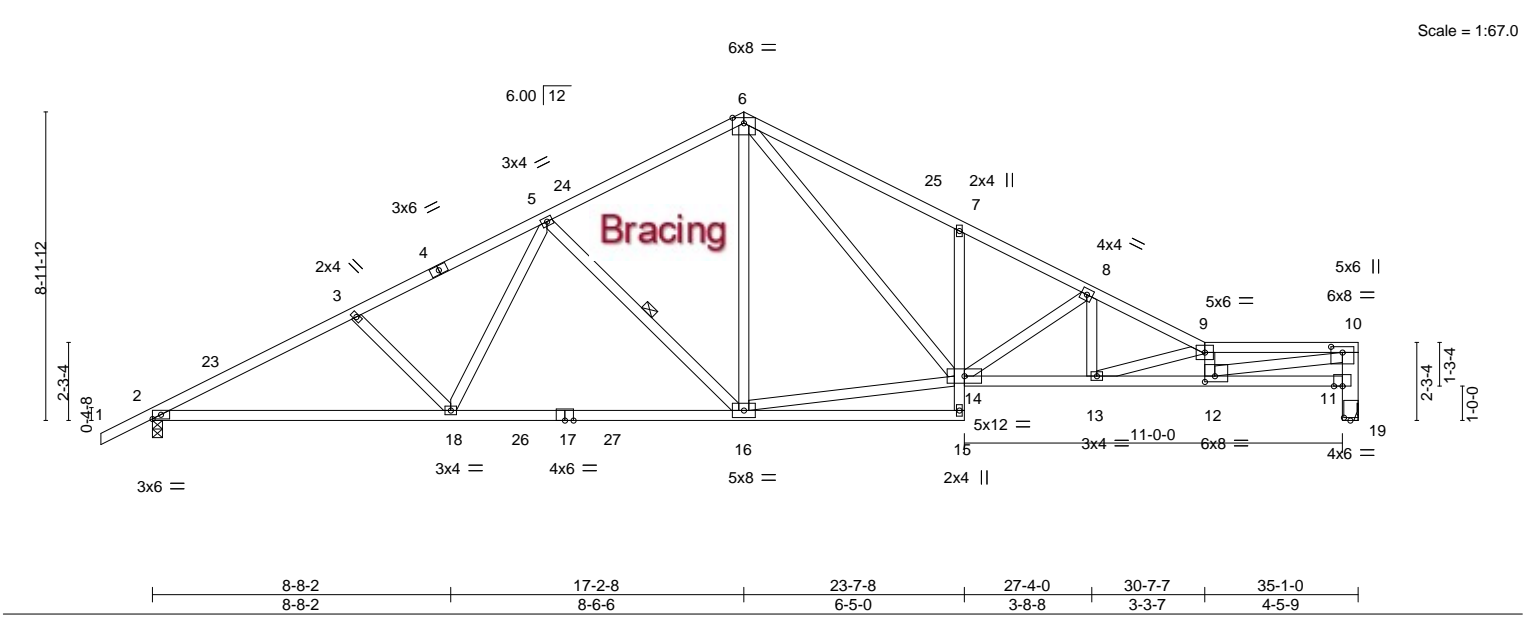


Plate Offsets (X,Y)--		[10:0-4-0,0-2-0], [12:0-3-8,0-2-0], [19:0-1-0,0-2-4]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL 1.25		TC 0.72		Vert(LL)	-0.34 16-18	>999	240	MT20	244/190
TCDL 7.0		Lumber DOL 1.25		BC 0.96		Vert(CT)	-0.58 16-18	>716	180		
BCLL 0.0 *		Rep Stress Incr YES		WB 0.90		Horz(CT)	0.22 19	n/a	n/a		
BCDL 10.0		Code FBC2023/TPI2014		Matrix-MS						Weight: 208 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 5-16
10-19: 2x6 SP No.2, 10-12: 2x4 SP No.1	

REACTIONS.	(size) 2=0-3-8, 19=Mechanical
	Max Horz 2=210(LC 12)
	Max Uplift 2=-366(LC 12), 19=-335(LC 13)
	Max Grav 2=1470(LC 2), 19=1389(LC 2)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2597/605, 3-5=-2429/566, 5-6=-1679/433, 6-7=-2702/756, 7-8=-2682/625, 8-9=-3578/815, 9-10=-4817/1113, 11-19=-1389/335, 10-11=-1221/323
BOT CHORD	2-18=-659/2295, 16-18=-469/1873, 7-14=-312/235, 13-14=-697/3197, 12-13=-1160/4987, 11-12=-77/294
WEBS	3-18=-292/205, 5-18=-110/578, 5-16=-619/300, 6-16=-129/573, 14-16=-243/1300, 6-14=-494/1447, 8-14=-995/284, 9-13=-1867/484, 9-12=-1150/320, 10-12=-1066/4651, 8-13=-143/783

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 2-0-2, Zone1 2-0-2 to 17-2-8, Zone2 17-2-8 to 22-2-1, Zone1 22-2-1 to 34-10-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=366, 19=335.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:


January 29,2024

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (www.tpinst.org) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (www.sbcsccomponents.com)</p>	<p><b>MiTek®</b></p> <p>16023 Swingley Ridge Rd. Chesterfield, MO 63017 314.434.1200 / MiTek-US.com</p>
--	---



Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764600
3842104	T04	Common	6	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),		Lake City, FL - 32055,		8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:16 2024 Page 1				
ID:xnU8Nd1YVZcQ2ih4SDBDyxzRDSf-nBCsuzvIOG8ZyZTlekqjP?048Nlkdf?GbymYPzrJUN5								
-1-6-0	5-11-3	11-5-12	17-2-8	22-11-4	28-5-13	34-5-0	35-11-0	
1-6-0	5-11-3	5-6-9	5-8-12	5-8-12	5-6-9	5-11-3	1-6-0	

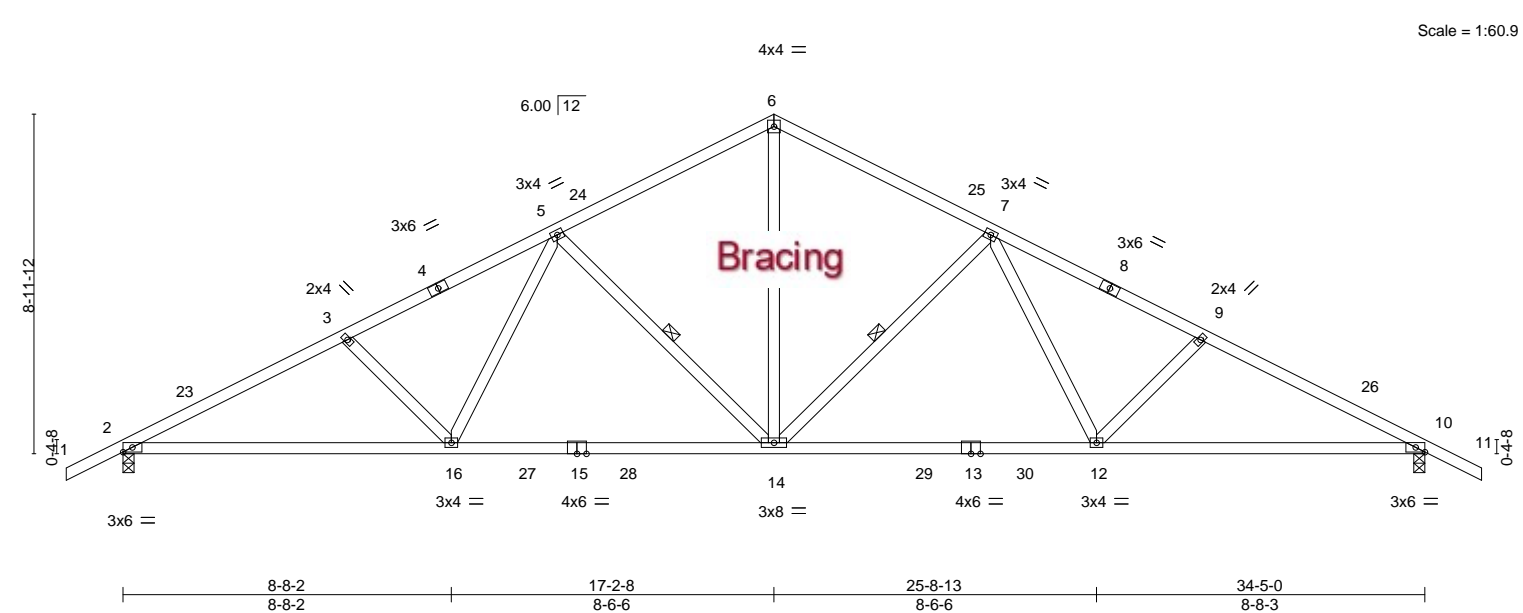

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.39	in (loc) l/defl L/d	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.95	Vert(LL) -0.24 12-14 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.46	Vert(CT) -0.41 12-14 >999 180		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS	Horz(CT) 0.11 10 n/a n/a		
				Weight: 180 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-3-7 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 7-14, 5-14

<b>REACTIONS.</b>	(size) 2=0-3-8, 10=0-3-8
	Max Horz 2=156(LC 16)
	Max Uplift 2=-364(LC 12), 10=-364(LC 13)
	Max Grav 2=1466(LC 2), 10=1466(LC 2)

<b>FORCES.</b> (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2585/601, 3-5=-2416/562, 5-6=-1666/424, 6-7=-1666/424, 7-9=-2416/562, 9-10=-2585/602
BOT CHORD 2-16=-601/2284, 14-16=-411/1865, 12-14=-282/1865, 10-12=-445/2284
WEBS 6-14=-247/1201, 7-14=-617/302, 7-12=-110/572, 9-12=-293/205, 5-14=-617/302, 5-16=-110/572, 3-16=-293/205

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-11-5, Zone1 1-11-5 to 17-2-8, Zone2 17-2-8 to 22-0-15, Zone1 22-0-15 to 35-11-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=364, 10=364.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764601
3842104	T04G	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:18 2024 Page 1

ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-jaKcJfxYwuOHCtd8l9sloq4PbxGaCdQljvRtcHzrUN3

35-11-0, 34-5-0, 17-2-8, 1-6-0, 1-6-0, 1-6-0

Scale = 1:63.0

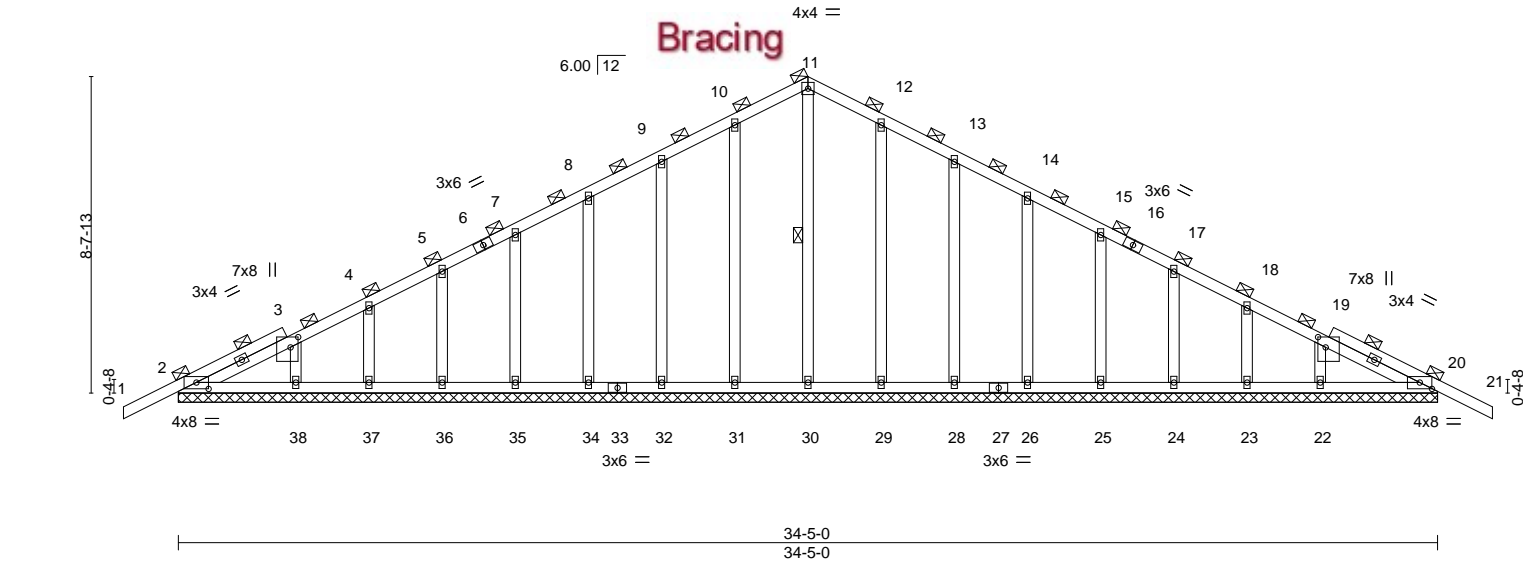


Plate Offsets (X,Y)-- [2:0-4-0,0-2-1], [3:0-3-6,0-2-8], [19:0-3-6,0-2-8], [20:0-4-0,0-2-1]						
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>
TCLL	20.0	Plate Grip DOL	1.25	TC 0.13	in (loc)	MT20
TCDL	7.0	Lumber DOL	1.25	BC 0.06	l/defl	GRIP
BCLL	0.0 *	Rep Stress Incr	YES	WB 0.12	L/d	244/190
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-S		
					Weight: 219 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>
TOP CHORD	2x4 SP No.2	TOP CHORD
BOT CHORD	2x4 SP No.2	2-0-0 oc purlins (6-0-0 max.).
OTHERS	2x4 SP No.3	BOT CHORD
		Rigid ceiling directly applied or 10-0-0 oc bracing.
		WEBS
		1 Row at midpt
		11-30

**REACTIONS.** All bearings 34-5-0.  
(lb) - Max Horz 2=151(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 31, 32, 34, 35, 36, 37, 38, 29, 28, 26, 25, 24, 23, 22, 20  
Max Grav All reactions 250 lb or less at joint(s) 2, 30, 31, 32, 34, 35, 36, 37, 38, 29, 28, 26, 25, 24, 23, 22, 20

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 10-11=-102/260, 11-12=-102/260

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 31, 32, 34, 35, 36, 37, 38, 29, 28, 26, 25, 24, 23, 22, 20.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764602
3842104	T05	Scissor	8	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:20 2024 Page 1  
ID: xnU8Nd1YV2cO2ih4SDBDyxzRDSf-gzRNkLyoSVf?RANWtaumtFAeAllUgLNbBDw\_hAzrUN1  
6-6-0 11-8-0 17-2-8 22-9-0 27-11-0 34-5-0  
6-6-0 5-2-0 5-6-8 5-6-8 5-2-0 6-6-0

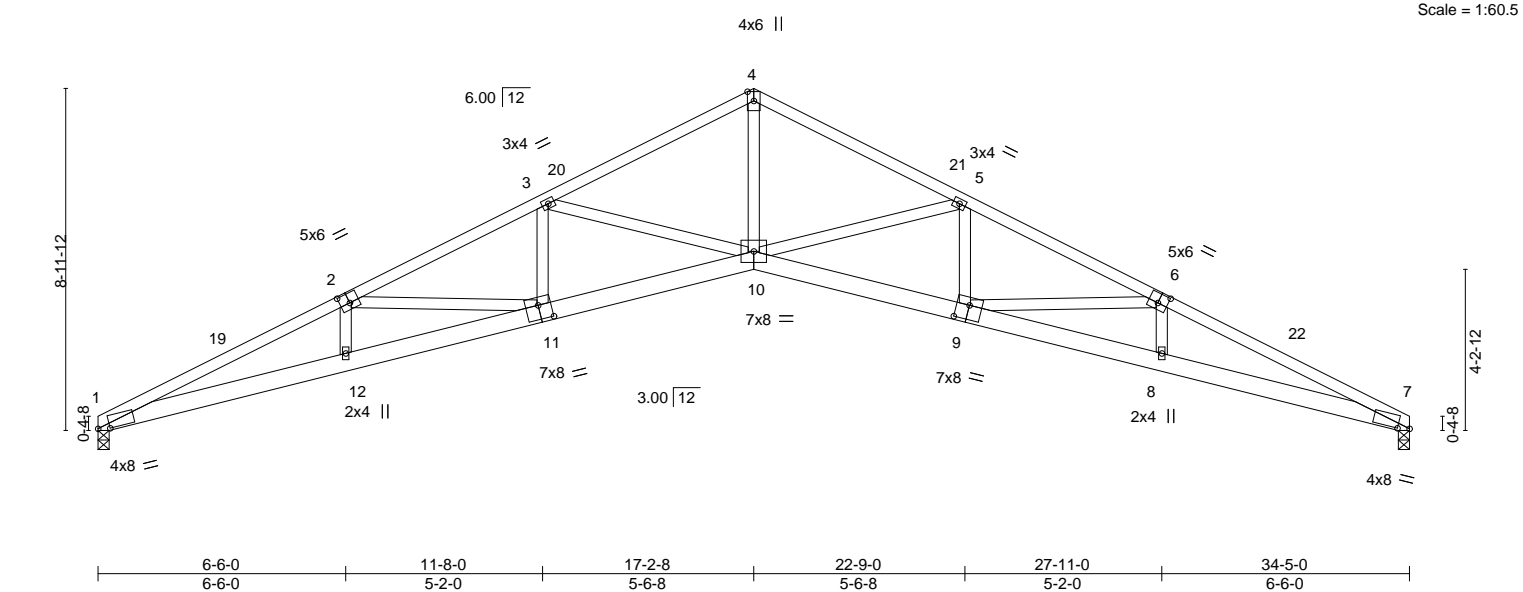


Plate Offsets (X,Y)--		[1:0-3-12,0-0-12], [2:0-3-0,0-0-3-0], [6:0-3-0,0-0-3-0], [7:0-3-12,0-0-12], [9:0-4-0,0-4-8], [11:0-4-0,0-4-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.64
TCDL 7.0	Lumber DOL	1.25	BC 0.87
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.86
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.42 10 >982 240
			Vert(CT) -0.78 10 >529 180
			Horz(CT) 0.52 7 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 189 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-6 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-7-13 oc bracing.
WEBS 2x4 SP No.3	

**REACTIONS.** (size) 1=0-3-8, 7=0-3-8  
Max Horz 1=-144(LC 13)  
Max Uplift 1=-327(LC 12), 7=-327(LC 13)  
Max Grav 1=1273(LC 1), 7=1273(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-4505/1210, 2-3=-3818/960, 3-4=-2909/650, 4-5=-2909/671, 5-6=-3818/803, 6-7=-4505/1064  
BOT CHORD 1-12=-1185/4110, 11-12=-1182/4112, 10-11=-849/3471, 9-10=-594/3471, 8-9=-899/4112, 7-8=-904/4110  
WEBS 4-10=-470/2257, 5-10=-866/402, 5-9=-74/391, 6-9=-643/334, 3-10=-866/401, 3-11=-73/391, 2-11=-643/323

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-5-5, Zone1 3-5-5 to 17-2-8, Zone2 17-2-8 to 22-0-15, Zone1 22-0-15 to 34-5-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Bearing at joint(s) 1, 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=327, 7=327.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764603
3842104	T06	Scissor	3	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),		Lake City, FL - 32055,		8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:22 2024 Page 1			
				ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-cLZ791_3_6vjhUxv_?wEygF_hYR_8FuueXP5l2zrUN?			
6-6-0	11-8-0	17-2-8	22-9-0	27-11-0	34-5-0	35-11-0	
6-6-0	5-2-0	5-6-8	5-6-8	5-2-0	6-6-0	1-6-0	

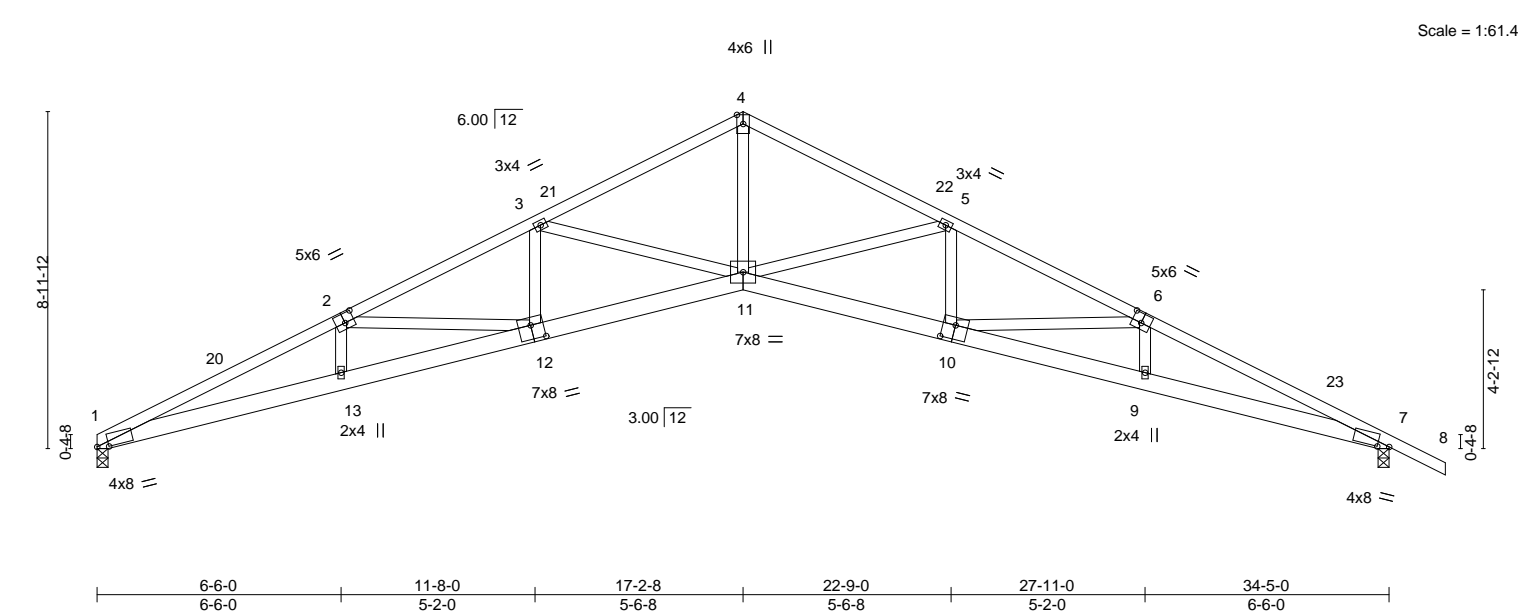


Plate Offsets (X,Y)--		[1:0-3-12,0-0-12], [2:0-3-0,0-3-0], [6:0-3-0,0-3-0], [7:0-3-12,0-0-12], [10:0-4-0,0-4-8], [12:0-4-0,0-4-8]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0		Plate Grip DOL	1.25	TC 0.64		Vert(LL)	-0.42 11	>987	240	MT20	244/190
TCDL 7.0		Lumber DOL	1.25	BC 0.87		Vert(CT)	-0.78 11	>531	180		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.86		Horz(CT)	0.52 7	n/a	n/a		
BCDL 10.0		Code	FBC2023/TPI2014	Matrix-MS						Weight: 192 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-8 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-8-11 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS.	(size) 1=0-3-8, 7=0-3-8
	Max Horz 1=-168(LC 13)
	Max Uplift 1=-326(LC 12), 7=-365(LC 13)
	Max Grav 1=1272(LC 1), 7=1356(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-4498/1196, 2-3=-3810/945, 3-4=-2902/635, 4-5=-2902/656, 5-6=-3804/767, 6-7=-4465/1015
BOT CHORD	1-13=-1160/4104, 12-13=-1156/4105, 11-12=-822/3464, 10-11=-566/3458, 9-10=-828/4075, 7-9=-831/4070
WEBS	4-11=-456/2251, 5-11=-860/399, 5-10=-72/390, 6-10=-619/321, 3-11=-866/401, 3-12=-73/391, 2-12=-643/324

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 0-0-0 to 3-5-5, Zone1 3-5-5 to 17-2-8, Zone2 17-2-8 to 22-0-15, Zone1 22-0-15 to 35-11-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Bearing at joint(s) 1, 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=326, 7=365.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024




Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764604
3842104	T07	Hip Girder	1	1	Job Reference (optional)	


Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:23 2024 Page 1

ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-4Y7VMM?hkQ1aleW5YiSTVtoAAyqDtp1t1B9eHVzrUN\_



Scale = 1:41.9

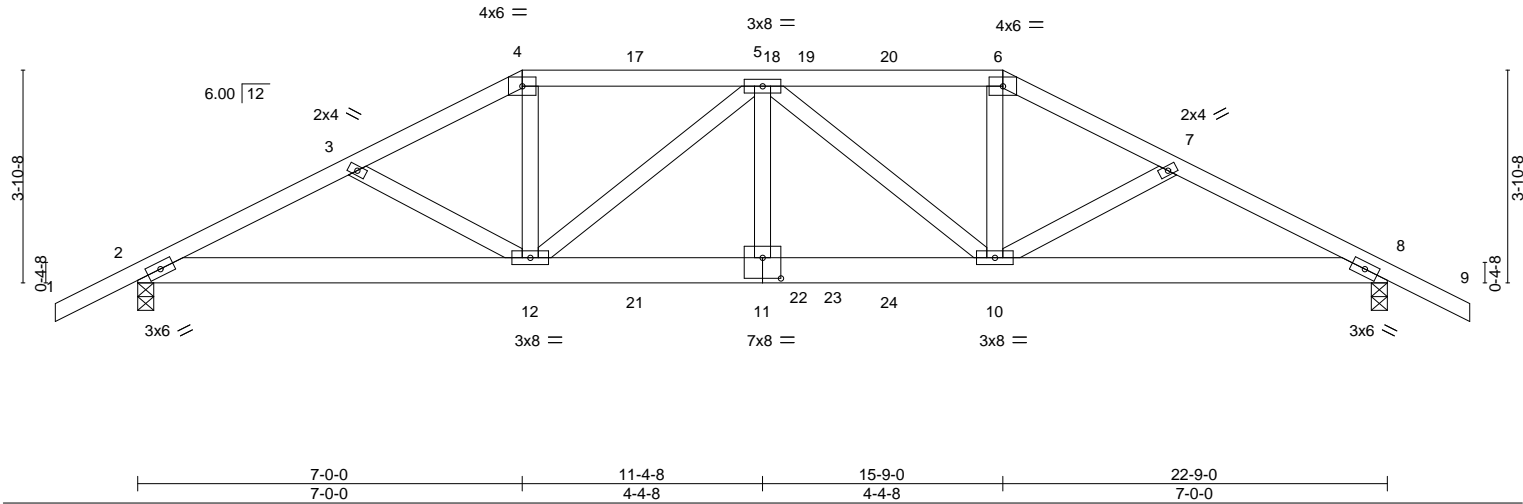

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.53	Vert(LL)	0.18 11 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.67	Vert(CT)	-0.25 11 >999 180				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.43	Horz(CT)	0.08 8 n/a n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
								Weight: 134 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-0-3 oc purlins.
BOT CHORD	2x6 SP No.2	BOT CHORD	Rigid ceiling directly applied or 5-6-15 oc bracing.
WEBS	2x4 SP No.3		

**REACTIONS.** (size) 2=0-3-8, 8=0-3-8  
Max Horz 2=71(LC 12)  
Max Uplift 2=-855(LC 8), 8=-867(LC 9)  
Max Grav 2=1737(LC 1), 8=1765(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-3329/1727, 3-4=-3159/1674, 4-5=-2843/1546, 5-6=-2897/1566, 6-7=-3222/1698, 7-8=-3392/1751  
BOT CHORD 2-12=-1538/2951, 11-12=-1751/3385, 10-11=-1751/3385, 8-10=-1489/3007  
WEBS 4-12=-540/1050, 5-12=-763/458, 5-11=-160/365, 5-10=-679/398, 6-10=-503/1004

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=855, 8=867.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 128 lb down and 102 lb up at 7-0-0, 110 lb down and 102 lb up at 9-0-12, 110 lb down and 97 lb up at 11-0-12, 110 lb down and 97 lb up at 11-8-4, and 110 lb down and 102 lb up at 13-8-4, and 231 lb down and 198 lb up at 15-9-0 on top chord, and 333 lb down and 271 lb up at 7-0-0, 86 lb down and 68 lb up at 9-0-12, 86 lb down and 68 lb up at 11-0-12, 86 lb down and 68 lb up at 11-8-4, and 86 lb down and 68 lb up at 13-8-4, and 333 lb down and 271 lb up at 15-8-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-54, 4-6=-54, 6-9=-54, 2-8=-20

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764604
3842104	T07	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:24 2024 Page 2  
ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-Ykhtai0JVk9Rwo4H6Qzi15KLwMAScG7A6ruBpxzrUMz

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 4=-110(B) 6=-184(B) 12=-333(B) 10=-333(B) 17=-110(B) 18=-110(B) 19=-110(B) 20=-110(B) 21=-64(B) 22=-64(B) 23=-64(B) 24=-64(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764605
3842104	T08	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:25 2024 Page 1

ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-0wFGn20xG1HHYyfUf7UxaltXkmV5LnXKKVeILNzrUMy



Scale = 1:39.8

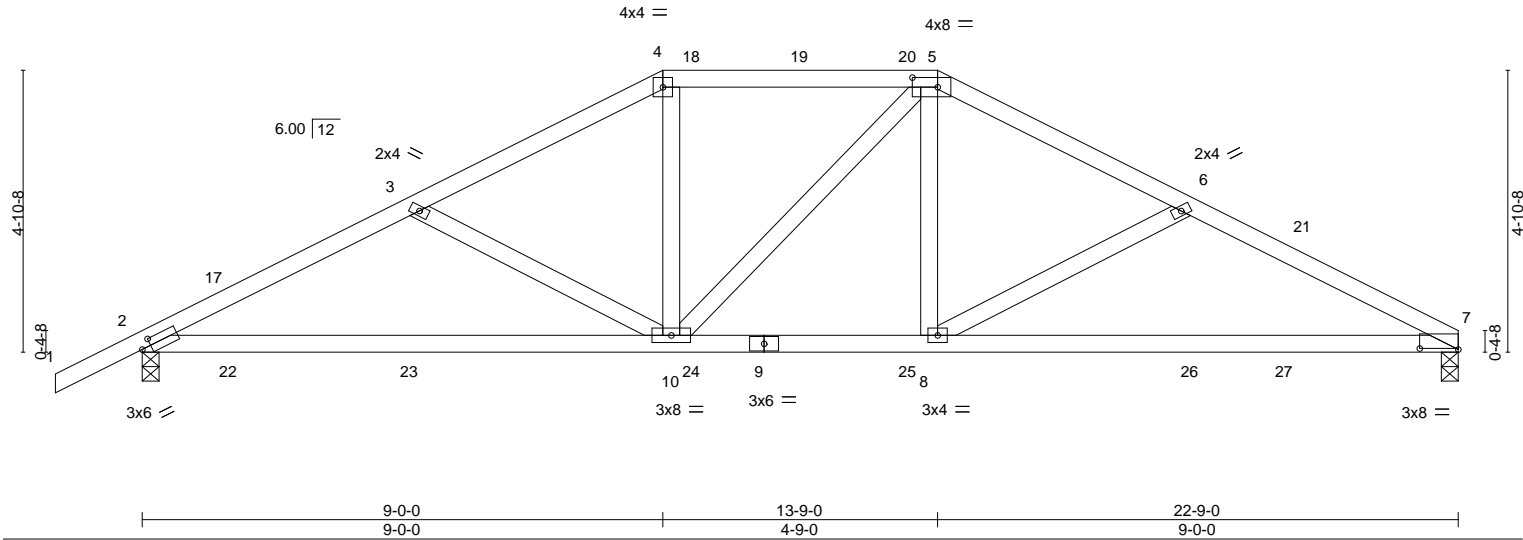


Plate Offsets (X,Y)--		[2:0-1-15,0-1-8], [5:0-5-4,0-2-0], [7:0-8-0,0-0-3]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.46
TCDL 7.0	Lumber DOL	1.25	BC 0.71
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.16
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.18 8-13 >999 240
			Vert(CT) -0.33 8-13 >822 180
			Horz(CT) 0.04 7 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 110 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-5-10 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 7-2-6 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 7=0-3-8, 2=0-3-8  
Max Horz 2=100(LC 16)  
Max Uplift 7=321(LC 8), 2=338(LC 9)  
Max Grav 7=839(LC 1), 2=925(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=1462/711, 3-4=1195/624, 4-5=1025/588, 5-6=1201/625, 6-7=1476/710  
BOT CHORD 2-10=610/1285, 8-10=453/1028, 7-8=607/1302  
WEBS 3-10=306/194, 4-10=182/334, 5-8=189/337, 6-8=321/203

- NOTES-
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1 13-2-15 to 13-9-0, Zone2 13-9-0 to 18-1-7, Zone1 18-1-7 to 22-9-0 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=321, 2=338.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764606
3842104	T09	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),	Lake City, FL - 32055,	8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:26 2024 Page 1
-1-6-0	3-7-4	ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-U6pe_O1Z1LP895EgDr?A7WQmXAzO4GOTZ9NltqzrUMx
1-6-0	3-7-4	7-2-8
		8-8-8
		1-6-0

Scale = 1:19.0

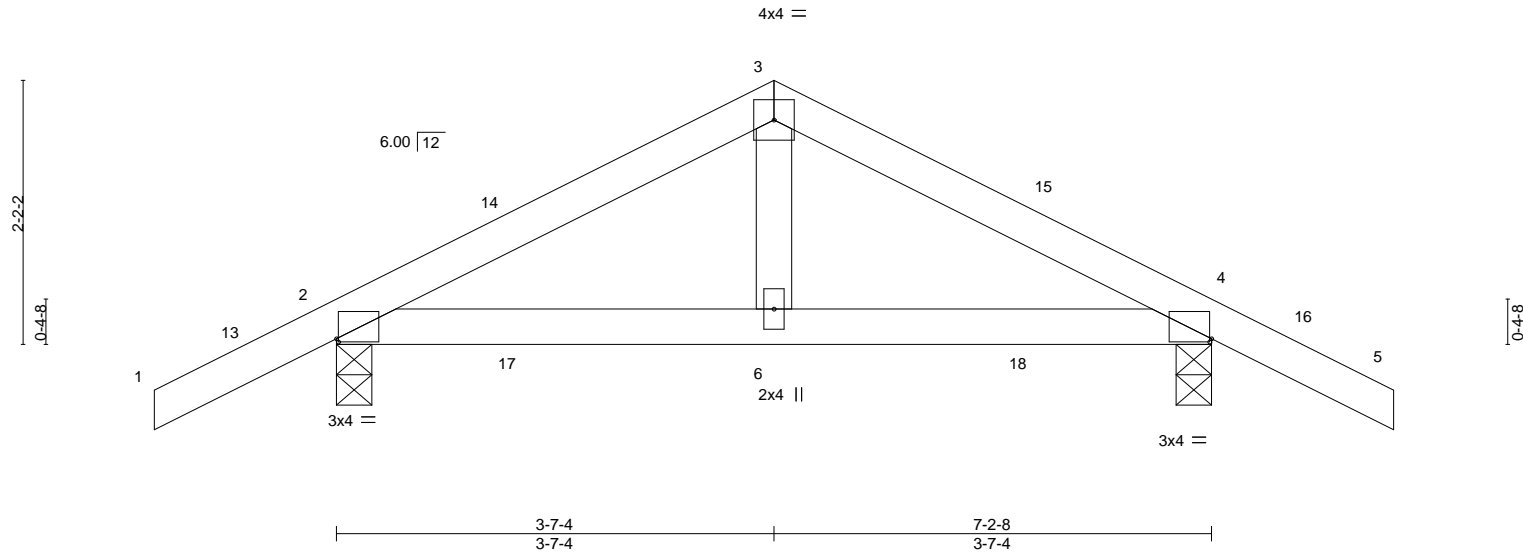


Plate Offsets (X,Y)--		[2:0-0-3,0-0-5], [4:0-0-3,0-0-5]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.20
TCDL 7.0	Lumber DOL	1.25	BC 0.13
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.01 6-12 >999 240
			Vert(CT) -0.01 6-12 >999 180
			Horz(CT) 0.00 4 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 30 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.
WEBS 2x4 SP No.3	

REACTIONS.	(size) 2=0'-3-8, 4=0'-3-8
	Max Horz 2=43(LC 16)
	Max Uplift 2=-108(LC 12), 4=-108(LC 13)
	Max Grav 2=348(LC 1), 4=348(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-322/280, 3-4=-322/280
BOT CHORD	2-6=-127/254, 4-6=-127/254

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 3-7-4, Zone2 3-7-4 to 7-10-3, Zone1 7-10-3 to 8-8-8 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=108, 4=108.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764607
3842104	T09G	KINGPOST	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:27 2024 Page 1

ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-yJN0Ck2BofX?nFpsnYWPfjywNZKvpjkdp7rPGzrUMw



Scale = 1:19.6

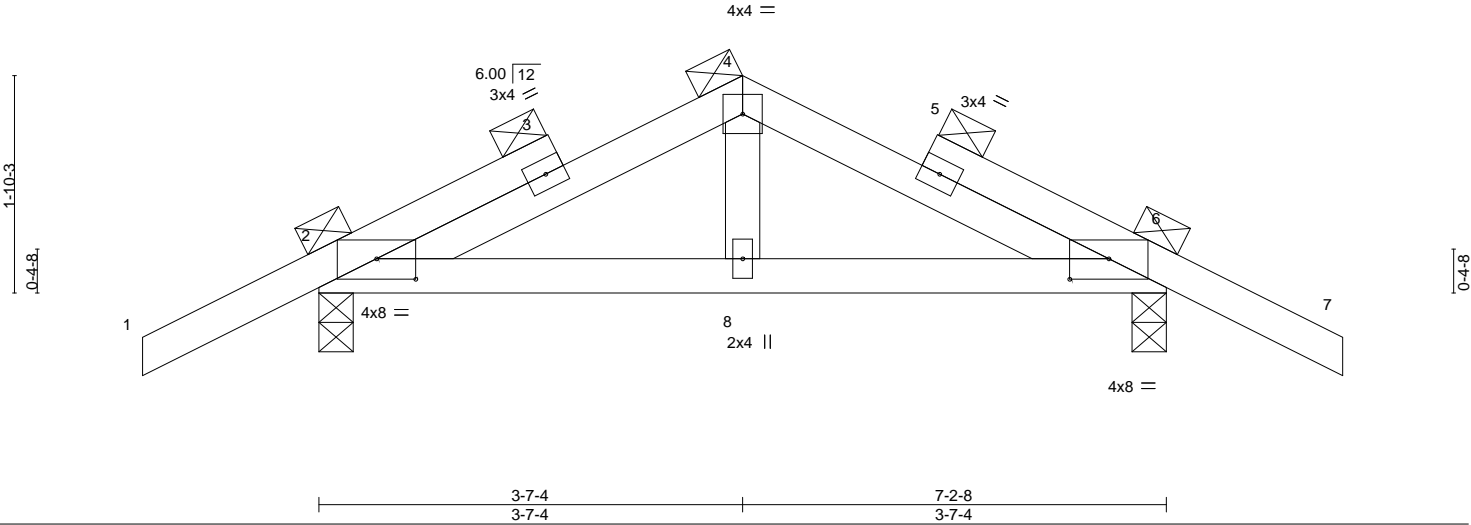


Plate Offsets (X,Y)--		[2:0-4-0,0-2-1], [6:0-4-0,0-2-1]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.26
TCDL 7.0	Lumber DOL	1.25	BC 0.11
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) 0.01 8-14 >999 240
			Vert(CT) -0.01 8 >999 180
			Horz(CT) 0.00 6 n/a n/a
			PLATES GRIP
			MT20 244/190
			Weight: 35 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS.	(size) 2=0-3-8, 6=0-3-8
	Max Horz 2=37(LC 16)
	Max Uplift 2=111(LC 12), 6=111(LC 13)
	Max Grav 2=345(LC 1), 6=345(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-4=-307/344, 4-6=-306/344
BOT CHORD	2-8=-195/270, 6-8=-195/270

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=111, 6=111.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**  
16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764608
3842104	T10	Common	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055, 8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:28 2024 Page 1  
ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-RVwOP43pZyfsPPO3LG1eCxV53zYmY80m0SsPyizrUMv  
-1-6-0 4-8-5 8-0-8 11-4-10 16-1-0 17-7-0  
1-6-0 4-8-5 3-4-2 3-4-3 4-8-6 1-6-0

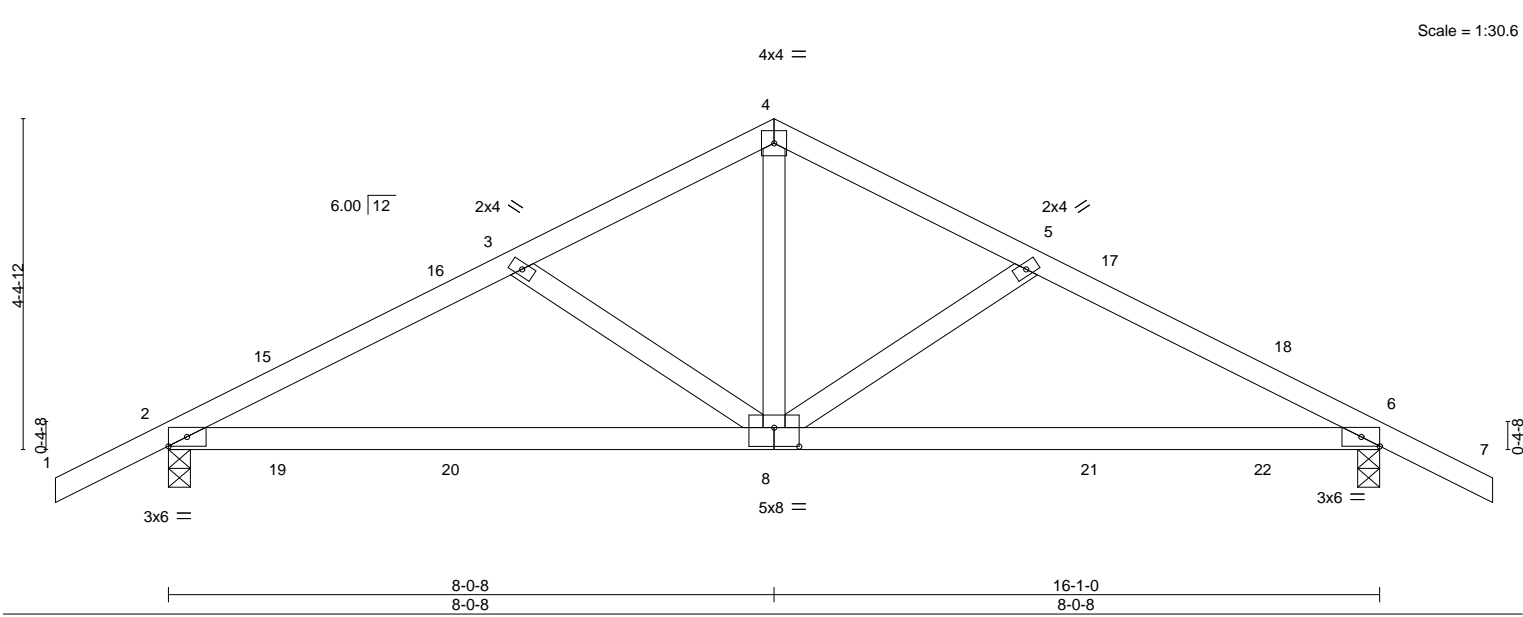

LOADING (psf)		SPACING-		CSL		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	1.25	TC	0.26	Vert(LL)	0.08 8-11 >999 240	MT20		244/190	
TCDL	7.0	Lumber DOL	1.25	BC	0.59	Vert(CT)	-0.15 8-14 >999 180				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.18	Horz(CT)	0.02 6 n/a n/a				
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							
								Weight: 73 lb		FT = 20%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 5-10-8 oc purlins.
BOT CHORD	2x4 SP No.2	BOT CHORD	Rigid ceiling directly applied or 8-10-8 oc bracing.
WEBS	2x4 SP No.3		

**REACTIONS.** (size) 2=0-3-8, 6=0-3-8  
Max Horz 2=80(LC 16)  
Max Uplift 2=-205(LC 9), 6=-205(LC 8)  
Max Grav 2=676(LC 1), 6=676(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-939/538, 3-4=-727/465, 4-5=-727/465, 5-6=-939/538  
BOT CHORD 2-8=-401/814, 6-8=-422/814  
WEBS 4-8=-331/464, 5-8=-259/186, 3-8=-259/186

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 8-0-8, Zone2 8-0-8 to 12-3-7, Zone1 12-3-7 to 17-7-0 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=205, 6=205.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024



Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764609
3842104	T10G	Common Structural Gable	1	1	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:29 2024 Page 1  
ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-vhUmdQ3SKGnj0ZzFuzYtk82GINzxHcawF6cyU9zrUMu  
1-6-0 4-8-5 8-0-8 11-4-11 16-1-0 17-7-0  
1-6-0 4-8-5 3-4-3 3-4-3 4-8-5 1-6-0  
Scale = 1:31.6

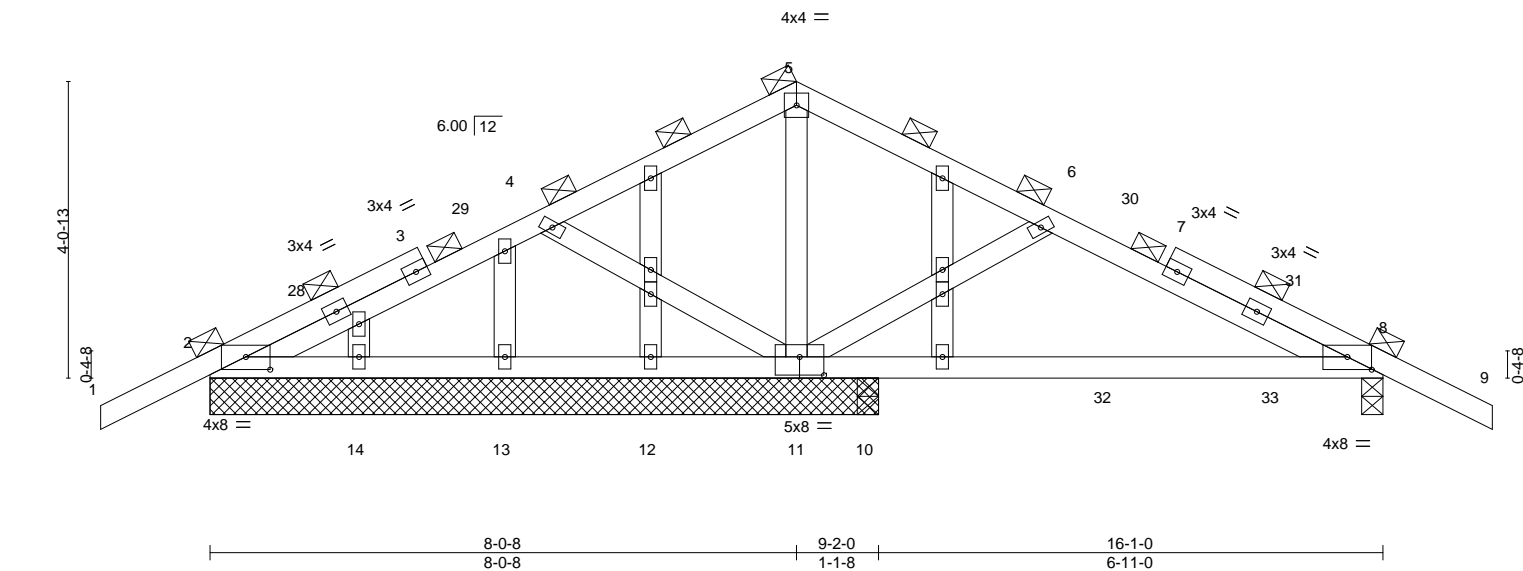


Plate Offsets (X,Y)--		[2:0-4-0,0-2-1], [8:0-4-0,0-2-1], [11:0-4-0,0-3-0]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 20.0	Plate Grip DOL	1.25	TC 0.29
TCDL 7.0	Lumber DOL	1.25	BC 0.27
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09
BCDL 10.0	Code	FBC2023/TPI2014	Matrix-MS
DEFL.	in (loc)	I/defl	L/d
Vert(LL)	-0.03 10-27	>999	240
Vert(CT)	-0.06 10-27	>999	180
Horz(CT)	-0.00 8	n/a	n/a
PLATES	GRIP		
MT20	244/190		
Weight: 90 lb		FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 9-2-0 except (jt=length) 8=0-3-8, 10=0-3-8.  
(lb) - Max Horz 2=75(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 14, 10 except 8=122(LC 13), 11=224(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 13, 14, 2 except 8=325(LC 26), 11=486(LC 1), 10=300(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 5-11=-301/108, 6-11=-278/204

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 8-0-8, Zone2 8-0-8 to 12-3-7, Zone1 12-3-7 to 17-7-0 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 10, 2 except (jt=lb) 8=122, 11=224.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.


This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764610
3842104	T11	Common Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City, FL), Lake City, FL - 32055, 8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:32 2024 Page 1  
ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-JGAvFR6KdB9lt0iqa56aMngmAaz7UikMx4qc5TzrUMr

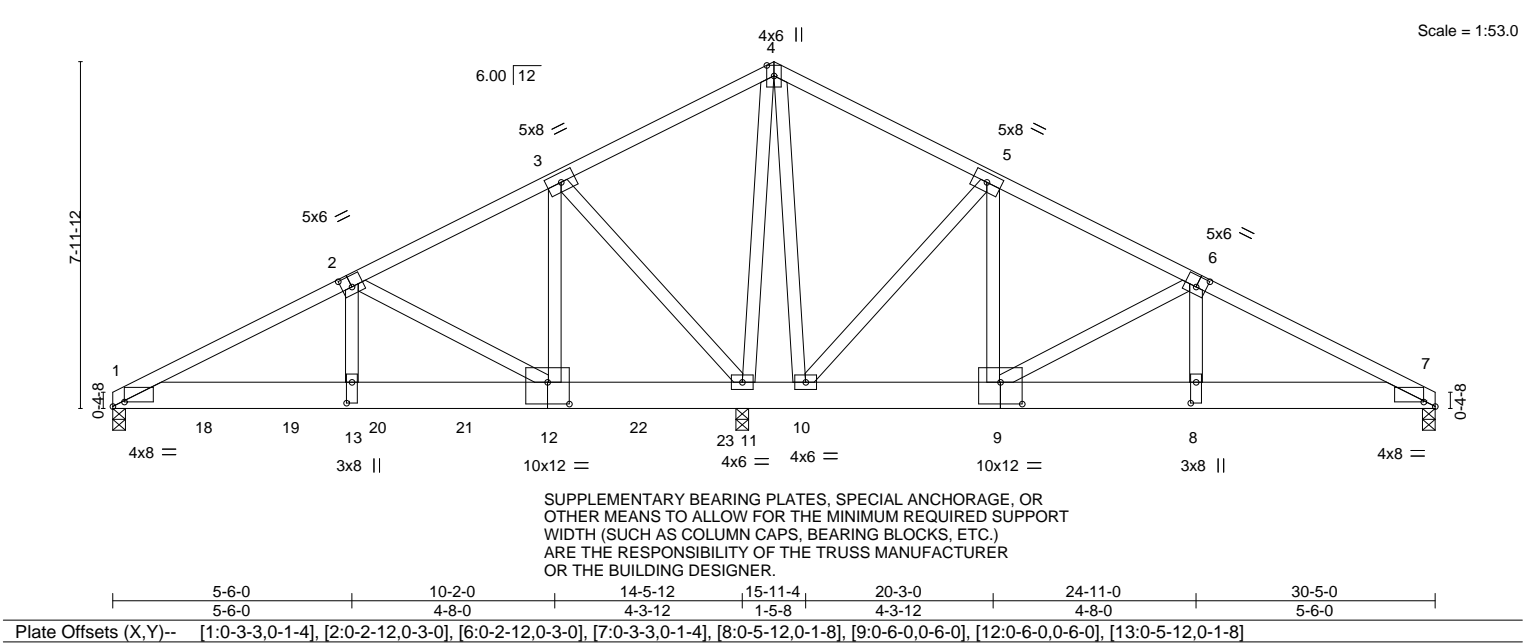

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.38	Vert(LL) -0.07 13-15 >999 240	MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.37	Vert(CT) -0.12 13-15 >999 180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.96	Horz(CT) 0.02 11 n/a n/a		
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS		Weight: 438 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-0-9 oc purlins.
BOT CHORD 2x8 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	

**REACTIONS.** (size) 11=0-3-8 (req. 0-5-0), 1=0-3-8, 7=0-3-8  
Max Horz 1=126(LC 8)  
Max Uplift 11=-2139(LC 8), 1=-935(LC 8), 7=-764(LC 23)  
Max Grav 11=8427(LC 2), 1=3692(LC 23), 7=496(LC 16)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-5623/1413, 2-3=-1594/434, 3-4=-542/2332, 4-5=-529/2341, 5-6=-617/2084, 6-7=-803/1842  
BOT CHORD 1-13=-1326/5011, 12-13=-1349/5104, 11-12=-378/1220, 10-11=-1959/670, 9-10=-1858/560, 8-9=-1629/687, 7-8=-1633/684  
WEBS 4-10=-1225/378, 5-10=-549/274, 5-9=-85/350, 6-9=-470/208, 4-11=-1125/292, 3-11=-4825/1336, 3-12=-1249/5053, 2-12=-4295/1173, 2-13=-899/3740

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-7-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - WARNING: Required bearing size at joint(s) 11 greater than input bearing size.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=2139, 1=935, 7=764.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1372 lb down and 355 lb up at 2-0-12, 1369 lb down and 355 lb up at 4-0-12, 1369 lb down and 355 lb up at 6-0-12, 1369 lb down and 355 lb up at 8-0-12, 1369 lb down and 355 lb up at 10-0-12, and 1369 lb down and 355 lb up at 12-0-12, and 1374 lb down and 357 lb up at 14-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

This item has been digitally signed and sealed by O'Regan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

<b>LOAD CASE(S)</b> Standard <b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.</b> Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria and DSB-22</b> available from Truss Plate Institute (www.tpinst.org) and <b>BCSI Building Component Safety Information</b> available from the Structural Building Component Association (www.sbcsccomponents.com)	<b>MiTek®</b> 16023 Swingley Ridge Rd. Chesterfield, MO 63017 314.434.1200 / MiTek-US.com
--	--

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764610
3842104	T11	Common Girder	1	2	Job Reference (optional)	

Builders FirstSource (Lake City,FL), Lake City, FL - 32055,

8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:32 2024 Page 2  
ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-JGAvFR6KdB9lt0iqa56aMngmAaz7UIkMx4qc5TzrUMr

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
- Uniform Loads (plf)  
Vert: 1-4=-54, 4-7=-54, 1-7=-20
- Concentrated Loads (lb)  
Vert: 12=-1268(B) 18=-1271(B) 19=-1268(B) 20=-1268(B) 21=-1268(B) 22=-1268(B) 23=-1273(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcsccomponents.com](http://www.sbcsccomponents.com))

**MiTek®**

16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / [MiTek-US.com](http://MiTek-US.com)

Job	Truss	Truss Type	Qty	Ply	NORRIS - VOIDANOFF RES.	T32764611
3842104	T11G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Lake City,FL),		Lake City, FL - 32055,		8.730 s Jan 4 2024 MiTek Industries, Inc. Fri Jan 26 12:30:33 2024 Page 1	
				ID:xnU8Nd1YV2cO2ih4SDBDyxzRDSf-nTkHSn7yOVH9VAH07pdpv_CrU_G9DMQVAKaAdwzrUMq	
-1-6-0	7-9-0	15-2-8	22-8-0	30-5-0	31-11-0
1-6-0	7-9-0	7-5-8	7-5-8	7-9-0	1-6-0

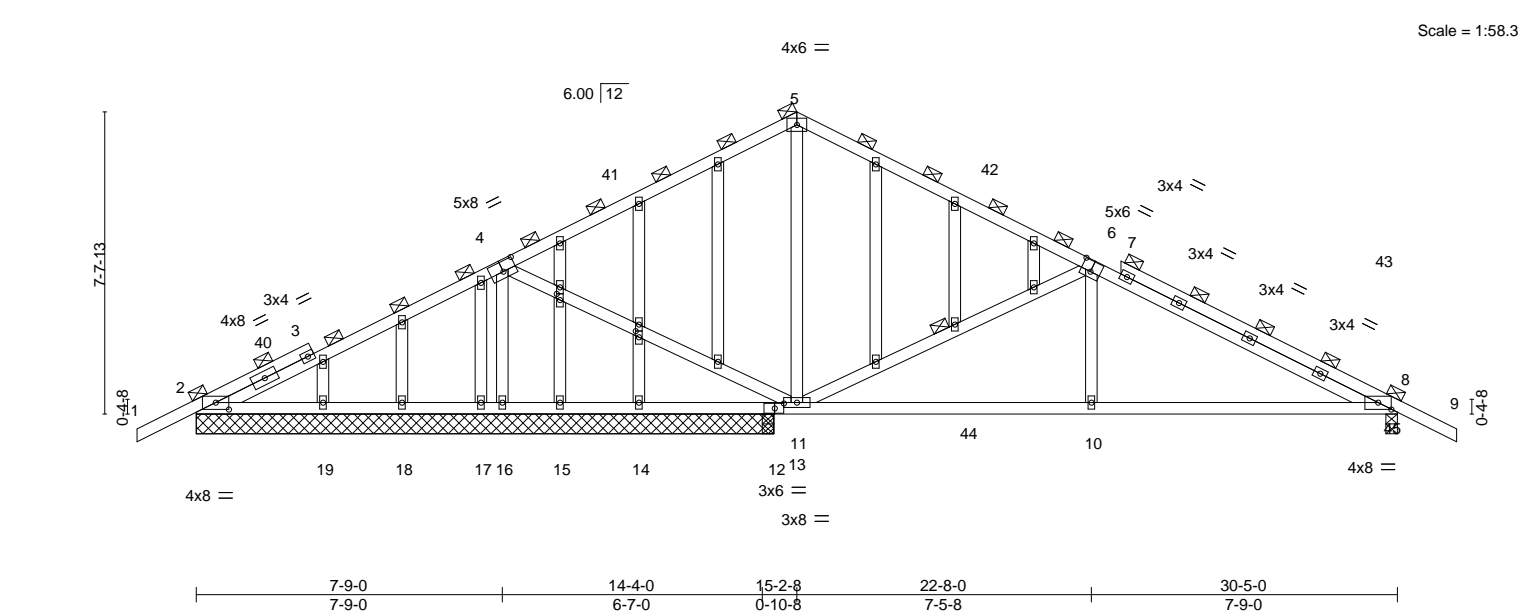


Plate Offsets (X,Y)--	[2:0-4-0,0-2-1], [4:0-4-0,0-3-0], [6:0-3-0,0-3-4], [8:0-4-0,0-2-1], [12:0-2-12,0-1-8], [22:0-1-14,0-1-0], [24:0-1-14,0-1-0]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.25	TC 0.67	Vert(LL) 0.10 10-11	>999	240		MT20	244/190
TCDL 7.0	Lumber DOL 1.25	BC 0.57	Vert(CT) -0.17 10-11	>999	180			
BCLL 0.0 *	Rep Stress Incr YES	WB 0.29	Horz(CT) 0.01 8	n/a	n/a			
BCDL 10.0	Code FBC2023/TPI2014	Matrix-MS					Weight: 204 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD 2-0-0 oc purlins (6-0-0 max.).
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except:
WEBS 2x4 SP No.3	8-8-11 oc bracing: 10-11
OTHERS 2x4 SP No.3	8-9-10 oc bracing: 8-10.
	WEBS 1 Row at midpt 6-11

REACTIONS.	All bearings 14-7-8 except (jt=length) 8=0-3-8, 13=0-3-8.
(lb) - Max Horz 2=134(LC 17)	
Max Uplift	All uplift 100 lb or less at joint(s) 2, 14, 15, 17, 18, 19 except 16=318(LC 12), 8=260(LC 8), 13=136(LC 13)
Max Grav	All reactions 250 lb or less at joint(s) 2, 14, 15, 17, 18, 19, 2 except 16=837(LC 1), 8=761(LC 1), 13=404(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-4=132/326, 4-5=371/254, 5-6=372/261, 6-8=1059/549
BOT CHORD	10-11=434/921, 8-10=433/919
WEBS	6-11=760/451, 6-10=143/322, 4-11=226/515, 4-16=872/393

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCCL=4.2psf; BCDL=3.0psf; h=20ft; Cat. II; Exp B; Encl., GCpi=0.18; MWFRS (envelope) gable end zone and C-C Zone3 -1-6-0 to 1-6-8, Zone1 1-6-8 to 15-2-8, Zone2 15-2-8 to 19-6-2, Zone1 19-6-2 to 31-11-0 zone; porch right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 14, 15, 17, 18, 19, 2 except (jt=lb) 16=318, 8=260, 13=136.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

This item has been digitally signed and sealed by ORegan, Philip, PE on the date indicated here. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Philip J. O'Regan PE No.58126  
MiTek Inc. DBA MiTek USA FL Cert 6634  
16023 Swingley Ridge Rd. Chesterfield, MO 63017  
Date:

January 29,2024

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

**MiTek®**


16023 Swingley Ridge Rd.  
Chesterfield, MO 63017  
314.434.1200 / MiTek-US.com

## Symbols

### PLATE LOCATION AND ORIENTATION

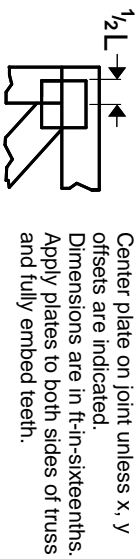

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

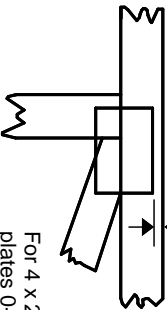

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

—  
This symbol indicates the required direction of slots in connector plates.


\* Plate location details available in MITek software or upon request.

### PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

### LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

### BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

### Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

## Numbering System

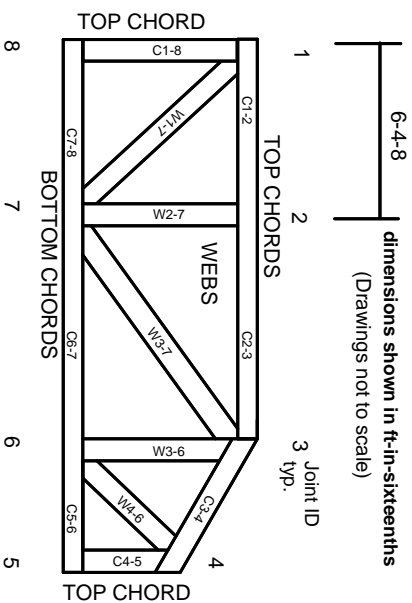

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

## Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

## Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

# MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

## General Safety Notes

**Failure to Follow Could Cause Property Damage or Personal Injury**

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.