

## AREA SUMMARY

LIVING AREA	1954	S.F.
GARAGE AREA	455	S.F.
ENTRY PORCH AREA	83	S.F.
COVERED PORCH AREA	235	S.F.
TOTAL AREA	2727	S.F.

## Garage fire separations shall comply with the following:

1. The private garagge shall be separated from the dwelling unit and its attic area by means of a minimum ½-inch 1 (12.7 mm) gypsum board applied to the garage side. Garages beneath habitable rooms shall 1 be separated from all habitable rooms above by not less than 5/8-inch Type X gypsum board or equuivalent. Door openings between a private garage and the dwelling unit shall be equipped with either solid wood doors, or solid or honeycomb core steel doors not less than 13/8 inches (34.9 mm) thick, or doors irin compliance with Section 715.3.3. Openings from a private garage directly into a room used for sleepiring purposes shall not be permitted.

Ducts in a private garage and ducts penetrating the walls or ceilings separating the dwelling unit from the garage shall be constructed of a minimum 0.019-inch (0.48 mm) sheet steel and shall have no openings into the garage.

A separation is not required between a Group R-3 and U carport provided the carport is entirely open on two or more sides and there are not enclosed areas above.


 When installing an attic access and/or pull-down stair unit in the garage, devise shall have a minimum 20 min. fire rating.



LOOR PLAN

LOT 14, ROLLING MEADOWS
ADAM'S FRAMING & CONSTRUCTION


©WLLIAM MYERS
DESIGN
P.O. BOX 1513
LAKE CITY, FL 32056
(386) 758-8406
will@willmyers.net



JOB NUMBER 070207

SHEET NUMBER

A.2
OF 3 SHEETS

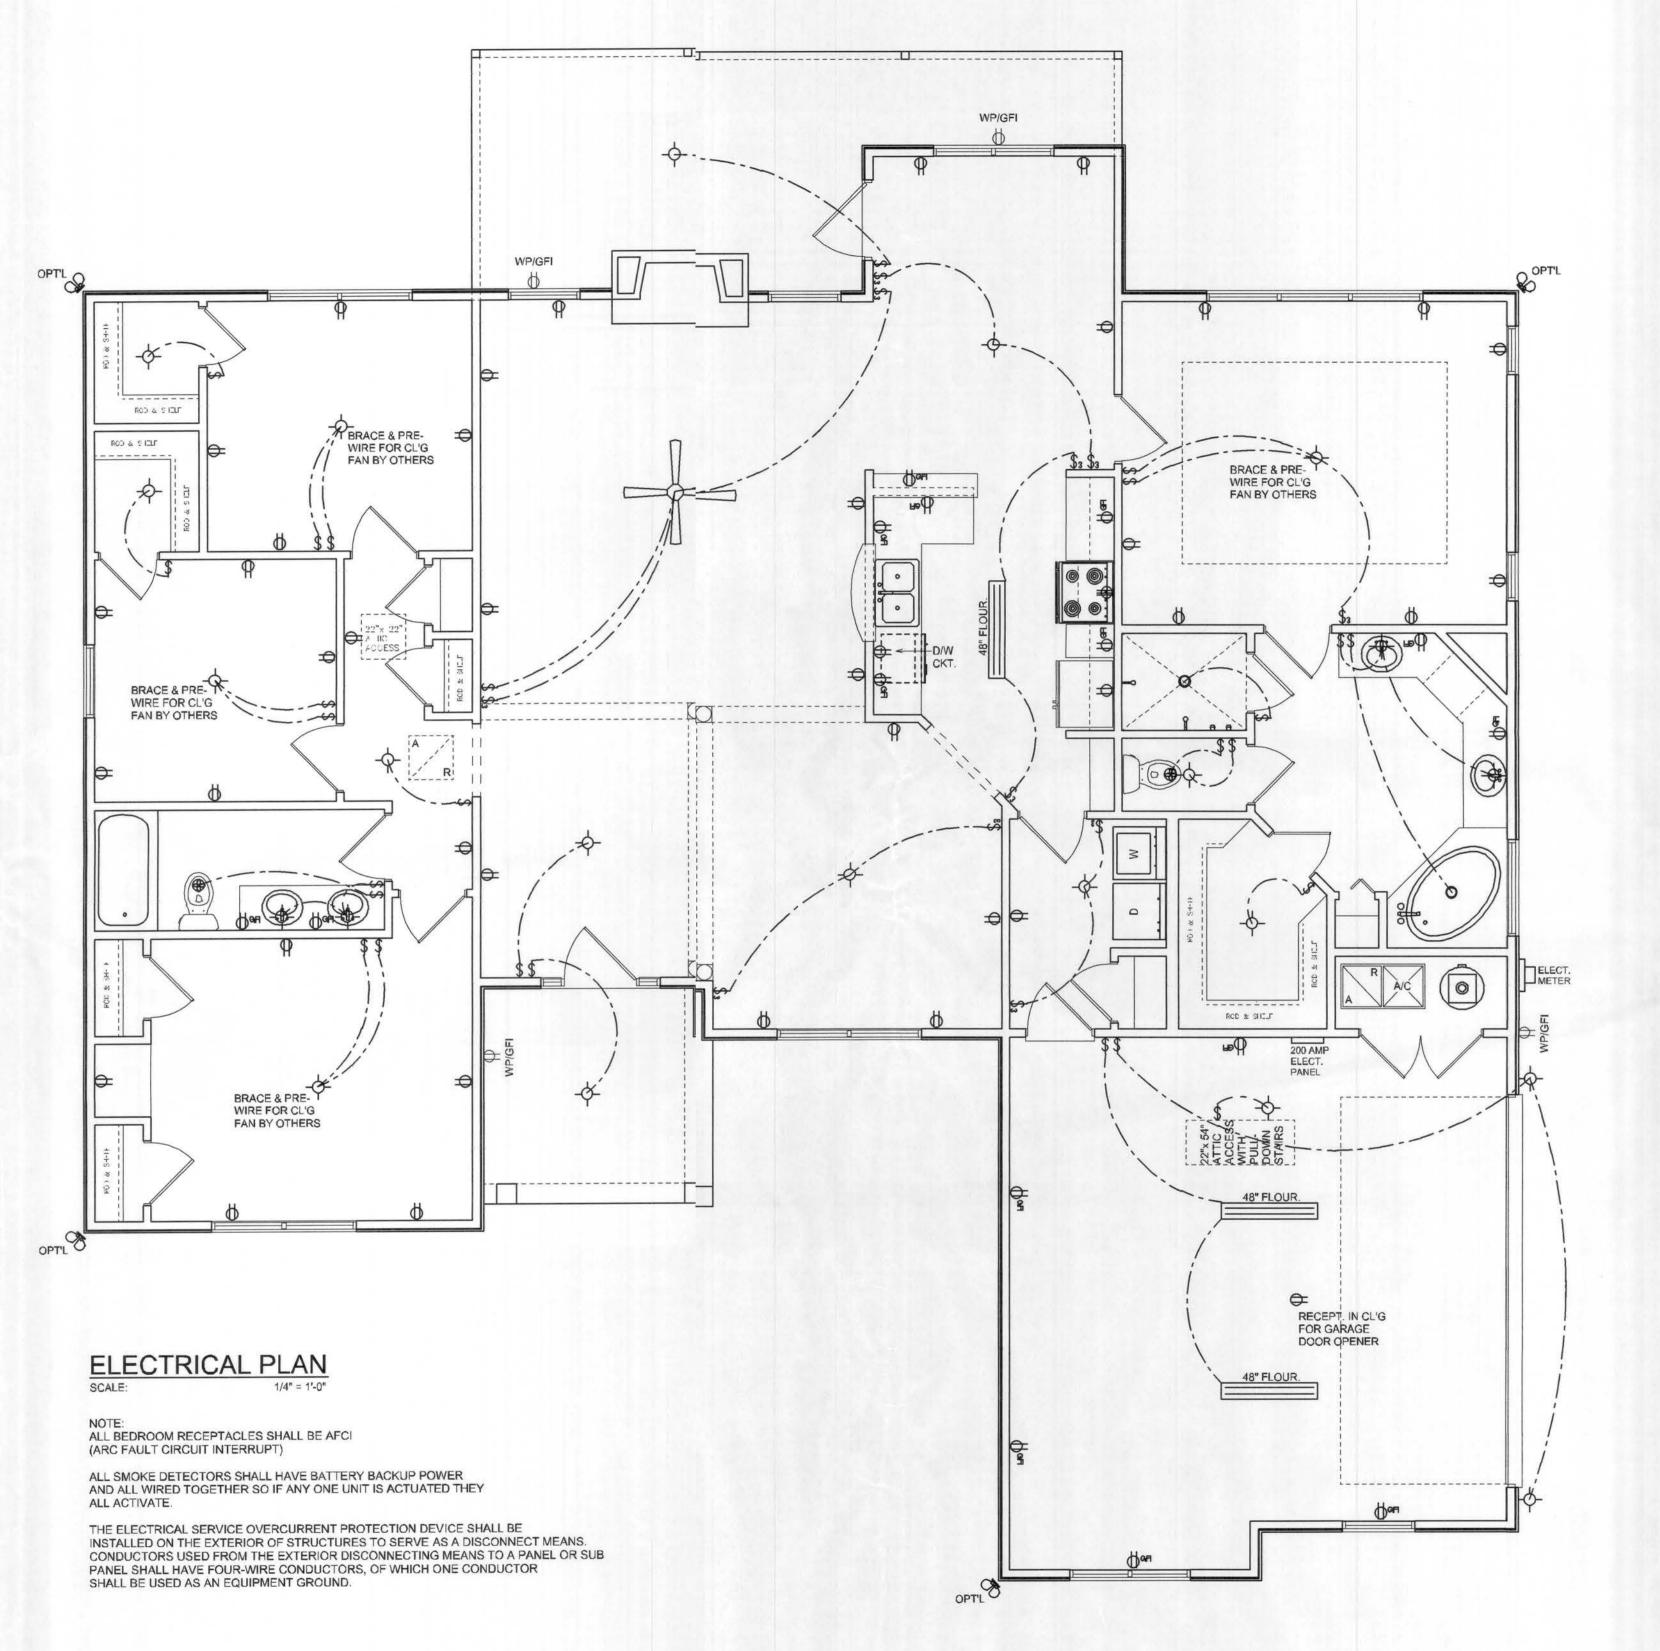

THEFT	ELECTRICAL LEGEND
	CEILING FAN (PRE-WIRE FOR LIGHT KIT)
Ø	DOUBLE SECURITY LIGHT
0	RECESSED CAN LIGHT
₩	BATH EXHAUST FAN
	LIGHT FIXTURE
Ф	DUPLEX OUTLET
Ф	220v OUTLET
<b></b> GFI	GFI DUPLEX OUTLET
TV †	TELEVISION JACK
PH ▽	TELEPHONE JACK
•	SMOKE DETECTOR (see note below)
\$	WALL SWITCH
\$3	3 WAY WALL SWITCH
₩P/GFI	WATER PROOF GFI OUTLET
48" FLOUR.	2 OR 4 TUB FLUORESCENT FIXTURE

REVISIONS
February 21, 2007
February 21, 2007

ARCHITECTLRAL DESIGN SOFTWAI

FLOOR PLAN SCALE: 1/4" = 1'-0"

T 14, ROLLING MEADOWS

W'S FRAMING & CONSTRUCTION

©WLLIAM MYER.5


DE.54(N

P.O. BOX 1513

LAKE CITY, FL 32056


(386) 758-8406

will@willmyers.net



JOB NUMBER 070207

A.2
OF 3 SHEETS

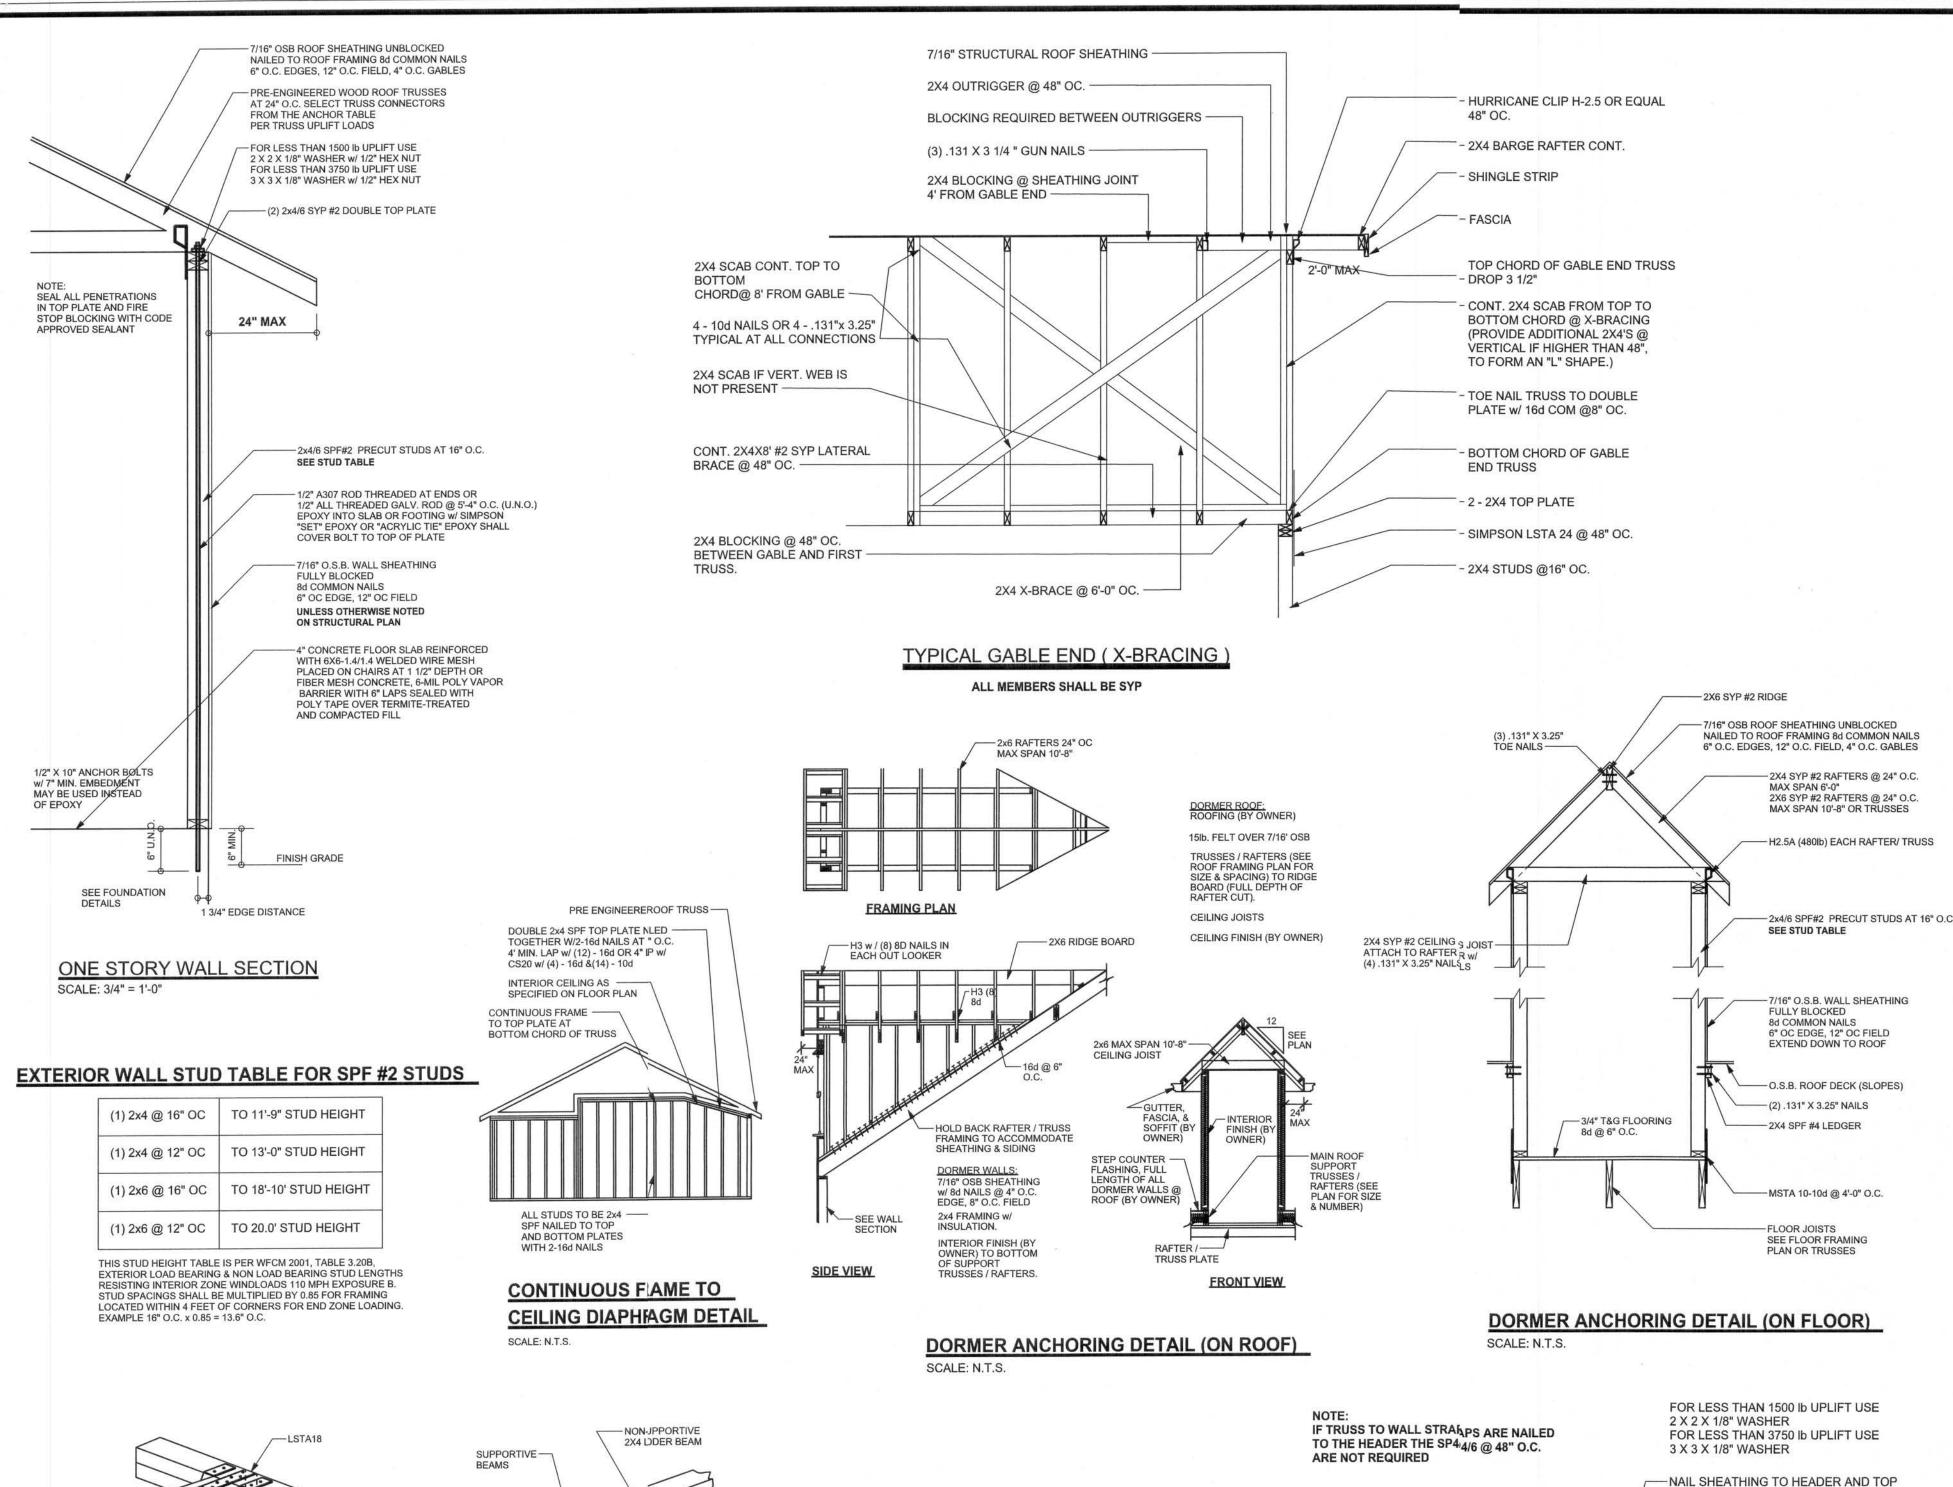

SIMPSON H2.5A U.N.O.-

SEE STRUCTURAL PLAN

(2) SIMPSON LSTA21-

AND (8) -16d TO POST

w/ (8) -16d TO HEADER

-(2) 2X12 SYP #2 U.N.O.

w/ (12) - 16d & 5/8" x 10"

—SEE FOOTING DETAILS

ANCHOR BOLT

—6X6 SYP #2 POST

3 SIMPSON LSTA18'S

(1-ONE SIDE, 2-ON -

OPPOSITE SIDE) EA.

NAILED WITH 14-10d

SCALE: N.T.S.

(2-ONE SIDE,2-ON

OTHER SIDE)

POST CONNECTION.

INSTALL ONE SIMPSON

SUPPORTIVE POST'O BEAM

DETAIL FOR SINGLIBEAM

SUPPORTIVE BEAM-

SUPPORTIVE CENTER POS TO BEAM DETAIL

2X12 SYP #2 MIN. -

SÉE STRUCTURAL PLAN

SIMPSON HUS412 MIN. -SEE STRUCTURAL PLAN

SCALE: N.T.S.

- (4)-2x4 SPF #2 NAILED

**BEAM MID-WALL CONNECTION DETAIL** 

LSTA18 -

BEAM MAY BE ATTACHED IN EITHER METHOD SHOWN ABOVE

**BEAM CORNER CONNECTION. DETAIL** 

BEAM W/4-16d

SEE STRUCTURAL PLAN

SCALE: N.T.S.

TOGETHER W/2-16d NAILS AT 16" O.C. MIN. (SEE STRUCTURAL PLAN)

SEE STRUCTURAL PLAN

UPLIFT LBS. SYP UPLIFT LBS. SPF TRUSS CONNECTOR\* TO PLATES TO RAFTER/TRUSS TO STUDS < 455 < 265 4-8d < 360 < 235 4-8d 4-8d < 455 4-8d 4-8d < 415 < 365 H2.5 5-8d < 600 < 535 H2.5A 5-8d 5-8d < 950 < 820 8-8d 8-8d < 565 5-10d, 1 1/2" 5-10d, 1 1/2 < 1465 < 1050 H14-1 13-8d 12-8d, 1 1/2" < 1465 < 1050 H14-2 15-8d 12-8d, 1 1/2" < 990 < 850 H10-1 8-8d, 1 1/2" 8-8d, 1 1/2 < 760 < 655 6-10d 6-10d < 1470 < 1265 H16-1 10-10d, 1 1/2" 2-10d, 1 1/2" < 1470 10-10d, 1 1/2" 2-10d, 1 1/2" < 1265 H16-2 < 1000 < 860 MTS24C 7-10d 1 1/2" 7-10d 1 1/2" < 1450 < 1245 HTS24 12-10d 1 1/2" 12-10d 1 1/2 < 2900 2 - HTS24 < 2490 < 2050 < 1785 14 -16d 14 -16d AVY GIRDER TIEDOWN TO FOUNDATION 1-5/8" THREADED ROD < 3965 < 3330 22 -10d 12" EMBEDMENT < 10980 < 6485 16 -10d 12" EMBEDMENT 2-5/8" THREADED ROD < 10530 < 9035 HGT-3 16 -10d 12" EMBEDMENT 2-5/8" THREADED ROD < 9250 < 9250 HGT-4 16 -10d 12" EMBEDMENT STUD STRAP CONNECTOR TO STUDS SSP DOUBLE TOP PLATE < 435 < 435 < 455 < 420 SSP SINGLE SILL PLATE 4 -10d DSP DOUBLE TOP PLATE 8 -10d < 825 < 600 DSP SINGLE SILL PLATE 8 -10d < 885 < 760 6-10d, 1 1/2" < 1240 < 1065 10-10d, 1 1/2" < 885 < 760 6-10d, 1 1/2"

SPH6

LSTA18

CS16

LTTI31

HD2A

HTT16

PAHD42

HPAHD22

ABU88

**GRADE & SPECIES TABLE** 

SYP #2

SYP #2

24F-V3 SP

MICROLAM

PARALAM

2x6 SYP #2 GARAGE DOOR BUCK ATTACHMENT

DOOR WIDTH | 3/8" x 4" LAG | 16d | (2) ROWS OF | 131 x 3 1/4" GN

24" O.C. 5" O.C.

18" O.C. 4" O.C.

ATTACH GARAGE DOOR BUCK TO STUD PACK AT

SCREWS w/ 1" WASHER LAG SCREWS MAY BE

COUNTERSUNK. HORIZONTAL JAMBS DO NOT

TRANSFER LOAD. CENTER LAG SCREWS OR STAGGER 16d NAILS OR (2) ROWS OF .131 x 3 1/4"

16" O.C.

GN PER TABLE BELOW:

8' - 10'

11' - 15'

16' - 18'

2x6SYP #2 DOOR BUCK ----

SCALE: N.T.S.

EACH SIDE OF DOOR OPENING WITH 3/8"x4" LAG

Fb (psi) E (10<sup>6</sup> psi

1.6

1.6

1.6

5" O.C.

4" O.C.

1200

1050

975

2400

2900

2900

14-10d

16-10d

18-8d

28-8d

TO STUDS

8-16d

18-10d, 1 1/2

2-5/8" BOLTS

16-16d

16-16d

12-16d

12-16d

TO FOUNDATION

1/2" AB

5/8" AB

5/8" AB

1/2" AB

1/2" AB

2-5/8" AB

ANCHOR TABLE

MANUFACTURER'S ENGINEERING

< 1240

< 1235

< 1235

< 1030

< 1705

< 1350

< 2310

< 2775

< 4175

< 1400

< 3335

< 2200

< 2300

< 2320

< 1065

< 1165

< 1235

< 1030

< 1705

< 1305

< 2310

< 2570

< 3695

< 1400

< 3335

< 2200

< 2300

< 2320

OBTAIN UPLIFT REQUIREMENTS FROM TRUSS

#### **GENERAL NOTES**

TRUSSES: TRUSSES SHALL BE DESIGNED BY A FLORIDA LICENSED ENGINEER IN ACCORDANCE WITH THE FBCR 2004. TRUSS ENGINEERING SHALL INCLUDE TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS, TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL BEARING LOCATIONS. TRUSS ENGINEERING IS THE RESPONSIBILITY OF THE TRUSS MANUFACTURER AND SHALL BE SIGNED & SEALED BY THE MANUFACTURER'S DESIGN ENGINEER. IT IS THE BUILDER'S RESPONSIBILITY VERIFY THE TRUSS DESIGNER FULLY SATISFIED ALL THE ABOVE REQUIREMENTS AND TO SELECT UPLIFT CONNECTIONS BASED ON TRUSS ENGINEERING UPLIFT AND PROVIDE FOOTINGS FOR INTERIOR PEA PROVIDE REAL PROPERTY OF THE PROP INTERIOR BEARING WALLS. BUILDER IS TO FURNISH TRUSS ENGINEERING TO WIND LOAD ENGINEER FOR REVIEW OF TRUSS REACTIONS ON THE BUILDING STRUCTURE. STRAP 2X6 RAFTERS WITH MIN UPLIFT CONNECTION 415LB EACH END; 2X8 RAFTERS 700 LB EACH END.

SITE PREPARATION: SITE ANALYSIS AND PREPARATION IS NOT PART OF THIS PLAN FOUNDATION: CONFIRM THAT THE FOUNDATION DESIGN & SITE CONDITIONS MEET

GRAVITY LOAD REQUIREMENTS (ASSUME 1000 PSF BEARING CAPACITY UNLESS VISUAL OBSERVATION OR SOILS TEST PROVES OTHERWISE CONCRETE: MINIMUM COMPRESSIVE STRENGTH OF CONCRETE AT 28 DAYS, F'c = 3000 PSI.

**WELDED WIRE REINFORCED SLAB:** 6" × 6" W1.4 × W1.4, FB = 85KSI, WELDED WIRE REINFORCEMENT FABRIC (W.W.M.) CONFORMING TO ASTM A185; LOCATED IN MIDDLE OF THE SLAB; SUPPORTED WITH APPROVED MATERIALS OR SUPPORTS AT SPACINGS NOT TO EXCEED 3'.

FIBER CONCRETE SLABS: CONCRETE SLABS ON GROUND CONTAINING SYNTHETIC FIBER REINFORCEMENT FIBER LENGTH 1/2 INCH TO 2 INCHES. DOSAGE AMOUNTS FROM 0.75 TO 1.5 POUNDS PER CUBIC YARD PER THE MANUFACTURER'S RECOMMENDATIONS. FIBERS TO COMPLY WITH ASTM C 1116. SUPPLIER TO PROVIDE ASTM C 1116 CERTIFICATION OF COMPLIANCE WHEN REQUESTED BY BUILDING OFFICIAL.

CONTROL JOINTS: WHERE SPECIFIED, SAWN CONTROL JOINTS IN SLAB-ON-GRADE SHALL BE CUT IN ACCORDANCE WITH ACI 302. JOINTS SHALL BE CUT WITHIN 12 HOURS OF SLAB PLACEMENT. THE LENGTH / WIDTH RATIOS OF SLAB AREAS SHALL NOT EXCEED 1.5 AND TYPICAL SPACING OF CUTS TO BE 12FT. DO NOT CUT WWM OR REINFORCING STEEL. (RECOMMENDED LOCATION OF CONTROL JOINTS IS SUBJECT TO OWNER AND CONTRACTOR'S APPROVAL. THE CONTROL JOINTS ARE NOT INTENDED TO PREVENT CRACKS BUT RATHER TO ENCOURAGE THE SLAB TO CRACK ON A GIVEN LINE.)

REBAR: ASTM A 615, GRADE 60, DEFORMED BARS, FY = 60 KSI. ALL LAP SPLICES 40 \* DB (25" FOR #5 BARS); UNO. ALL REINFORCEMENT SHALL BE DETAILED AND PLACED IN ACCORDANCE WITH ACI 315-96, U.N.O.

GLULAM BEAMS: GLULAM BEAM, GLB, 24F-V3SP, Fb = 2.4ksi, E = 1800ksi; UNO. SUPPLIER MAY SUPPLY AN ALTERNATE BEAM WITH EQUAL PROPERTIES OR MAY SUBMIT THEIR OWN SIZING CALCS. ROOF SHEATHING: ALL ROOFS ARE HORIZONTAL DIAPHRAGMS; 7/16" OSB SHEATHING, UNBLOCKED, APPLIED PERPENDICULAR TO FRAMING, OVER A MINIMUM OF 3 FRAMING MEMBERS, WITH PANEL EDGES STAGGERED, FASTENED WITH 8d COMMON NAILS (.131), 6"OC PANEL EDGES, 12"OC INTERMEDIATE MEMBERS, GABLE ENDS AND DIAPHRAGM BOUNDARY; 4"OC, UNO.

STRUCTURAL CONNECTORS: MANUFACTURERS AND PRODUCT NUMBER FOR CONNECTORS, ANCHORS, AND REINFORCEMENT ARE LISTED FOR EXAMPLE NOT ENDORSEMENT. AN EQUIVALENT DEVICE OF THE SAME OR OTHER MANUFACTURER CAN BE SUBSTITUTED FOR ANY DEVICES LISTED IN THE EXAMPLE TABLES AS LONG AS IT MEETS THE REQUIRED LOAD CAPACITIES. MANUFACTURER'S INSTALLATION INSTRUCTIONS MUST BE FOLLOWED TO ACHIEVE RATED LOADS.

ANCHOR BOLTS: A-307 ANCHOR BOLTS WITH MINIMUM EMBEDMENT AS SPECIFIED IN DRAWINGS BUT NO LESS THAN 7" IN CONCRETE OR REINFORCED BOND BEAM OR 15" IN GROUTED CMU.

WASHERS USED WITH 1/2" BOLTS TO BE 2" x 2" x 9/64"; WITH 5/8" BOLTS TO BE 3" x 3" x 9/64"; VITH 3/4" BOLTS TO BE 3" x 3" x 9/64"; WITH 7/8" BOLTS TO BE 3" x 3" x 5/16"; UNO.

NAILS: ALL NAILS ARE COMMON NAILS UNLESS OTHERWISE SPECIFIED OR ACCEPTED BY FBC TEST REPORTS AS HAVING EQUAL STRUCTURAL VALUES.

#### **BUILDER'S RESPONSIBILITY**

THE BUILDER AND OWNER ARE RESPONSIBLE FOR THE FOLLOWING, WHICH ARE SPECIFICALLY NOT PART OF THE WIND LOAD ENGINEER'S SCOPE OF WORK. CONFIRM SITE CONDITIONS, FOUNDATION BEARING CAPACITY, GRADE AND BACKFILL HEIGHT, WIND SPEED AND DEBRIS ZONE, AND FLOOD ZONE. PROVIDE MATERIALS AND CONSTRUCTION TECHNIQUES, WHICH COMPLY WITH FBCR 2004 REQUIREMENTS FOR THE STATED WIND VELOCITY AND DESIGN PRESSURES. PROVIDE A CONTINUOUS LOAD PATH FROM TRUSSES TO FOUNDATION. IF YOU BELIEVE THE PLAN OMITS A CONTINUOUS LOAD PATH CONNECTION, CALL THE WIND LOAD ENGINEER IMMEDIATELY. VERIFY THE TRUSS MANUFACTURER'S SEALED ENGINEERING INCLUDES TRUSS DESIGN, PLACEMENT PLANS, TEMPORARY AND PERMANENT BRACING DETAILS,

**ROOF SYSTEM DESIGN** 

BEARING LOCATIONS.

THE SEAL ON THESE PLANS FOR COMPLIANCE WITH FBCR 2004, SECTION R301.2.1 IS BASED ON REACTIONS, UPLIFTS, AND BEARING LOCATIONS IN TRUSS ENGINEERING SUBMITTED TO THE WIND LOAD ENGINEER. IT IS THE RESPONSIBILITY OF THE BUILDER TO CHECK ALL DETAILS OF THE COMPLETE ROOF SYSTEM DESIGN SUBMITTED BY THE TRUSS MANUFACTURER AND HAVE IT SIGNED, AND SEALED BY A DESIGN PROFESSIONAL FOR CORRECT APPLICATION OF FBC 2001 REQUIRED LOADS AND ANY SPECIAL LOADS. THE BUILDER IS RESPONSIBLE TO REVIEW EACH INDIVIDUAL TRUSS MEMBER AND THE TRUSS ROOF SYSTEM AS A WHOLE AND TO PROVIDE RESTRAINT FOR ANY LATERAL BRACING. THE BUILDER SHOULD USE CARE CHECKING THE ROOF DESIGN BECAUSE THE WIND LOAD ENGINEER IS SPECIFICALLY NOT RESPONSIBLE FOR THE TRUSS LAYOUT WHICH WAS CREATED BY THE TRUSS MANUFACTURER AND THE TRUSS DESIGNER ALSO DENIES RESPONSIBILITY FOR THE LAYOUT PER NOTES ON THEIR SEALED TRUSS SHEETS.

TRUSS-TO-TRUSS CONNECTIONS, AND UPLIFT AND REACTION LOADS FOR ALL

## **DESIGN DATA**

WIN	ID LOADS PER FLORIDA BUILDING CODE 2004 RESIDENTIAL, SECTION R301.2.1
ME, ON	CLOSED SIMPLE DIAPHRAGM BUILDINGS WITH FLAT, HIPPED, OR GABLE ROOFS; AN ROOF HEIGHT NOT EXCEEDING LEAST HORIZONTAL DIMENSION OR 60 FT; NOT UPPER HALF OF HILL OR ESCARPMENT 60FT IN EXP. B, 30FT IN EXP. C AND >10% OPE AND UNOBSTRUCTED UPWIND FOR 50x HEIGHT OR 1 MILE WHICHEVER IS LES
BUI	LDING IS NOT IN THE HIGH VELOCITY HURRICANE ZONE
BUI	LDING IS NOT IN THE WIND-BORNE DEBRIS REGION
1.)	BASIC WIND SPEED = 110 MPH
2.)	WIND EXPOSURE = B
3.)	WIND IMPORTANCE FACTOR = 1.0
4.)	BUILDING CATEGORY = II
5.)	ROOF ANGLE = 10-45 DEGREES
6.)	MEAN ROOF HEIGHT = <30 FT
7.)	INTERNAL PRESSURE COEFFICIENT = N/A (ENCLOSED BUILDING)
8.)	COMPONENTS AND CLADDING DESIGN WIND PRESSURES (TABLE R301.2(2))

Zone Effective Wind Area (ft2)

19.9 -21.8 | 18.1 | -18.1


19.9 -25.5 18.1 -21.8

-40.6

3 O'hg -68.3 -42.4 4 21.8 -23.6 18.5 -20.4

5 21.8 -29.1 18.5 -22.6

19.9 -25.5 18.1 -21.



£ 32	2	Doors & Windows Worst Case (Zone 5, 10 ft2)	21.8	-29.1
5	13 13	8x7 Garage Door	19.5	-22.9
1	4 3 4 5	16x7 Garage Door	18.5	-21.0
DESIGN	LOADS			
FLOOR	40 PSF (ALL OTHER DWELLING ROOMS)			
	30 PSF (SLEEPING ROOMS)			
	30 PSF (ATTICS WITH STORAGE)			
	10 PSF (ATTICS WITHOUT STORAGE, <3:12)			
ROOF	20 PSF (FLAT OR <4:12)			
	16 PSF (4:12 TO <12:12)			
	12 PSF (12:12 AND GREATER)			
STAIRS	40 PSF (ONE & TWO FAMILY DWELLINGS)			
SOIL BE	ARING CAPACITY 1000PSF			
NOT IN	FLOOD ZONE (BUILDER TO VERIFY)			
	2000 ZONE (DOIEDENTIO VENTI)			

/INDLOAD ENGINEER: Mark Disosway, PE No.53915, POB 868, Lake City, FL

IMENSIONS: Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution Do not proceed without clarification

056, 386-754-5419

REVISIONS

SOFTPIAN

OPYRIGHTS AND PROPERTY RIGHTS: Mark Disosway, P.E. hereby expressly reserve s common law copyrights and property right ese instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express writte rmission and consent of Mark Disosway.

ERTIFICATION: I hereby certify that I ha mined this plan, and that the applicable tions of the plan, relating to wind engine emply with section R301.2.1, florida building ode residential 2004, to the best of my

IMITATION: This design is valid for one uilding, at specified location.

P.E. 53915

Adam's Framing & Construction

Spec House Rolling Meadows S/D

ADDRESS: Lot 13 Rolling Meadows S/D Columbia County, Florida

Mark Disosway P.E. P.O. Box 868 Lake City, Florida 32056 Phone: (386) 754 - 5419 Fax: (386) 269 - 4871


> PRINTED DATE: March 06, 2007

STRUCTURAL BY David Disosway

FINALS DATE: 06 / Mar / 07 JOB NUMBER 703011

DRAWING NUMBER

OF 3 SHEETS

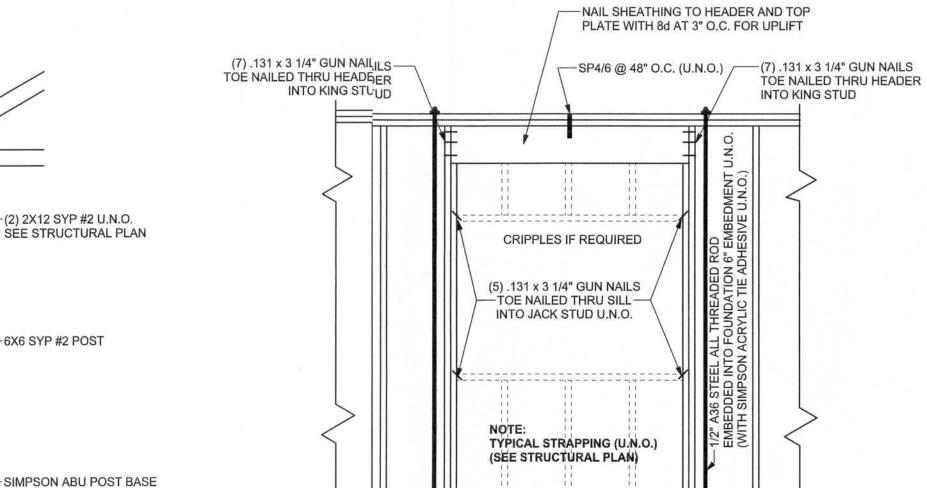

<u>Trypical 1 Story Header Straping Detail</u>


(1) 2X6 SPF #2 SILL UP TO 7'-6" U.N.O.


(2) 2X4 SPF #2 SILL UP TO 7'-8" U.N.O.

(1) 2X4 SPF #2 SILL UP TO 5'-1" U.N.O.

(FOR: 120 MPH, 10'-0" WALL HEIGHT U.N.O.)


GARAGE DOOR BUCK INSTALLATION DETAIL

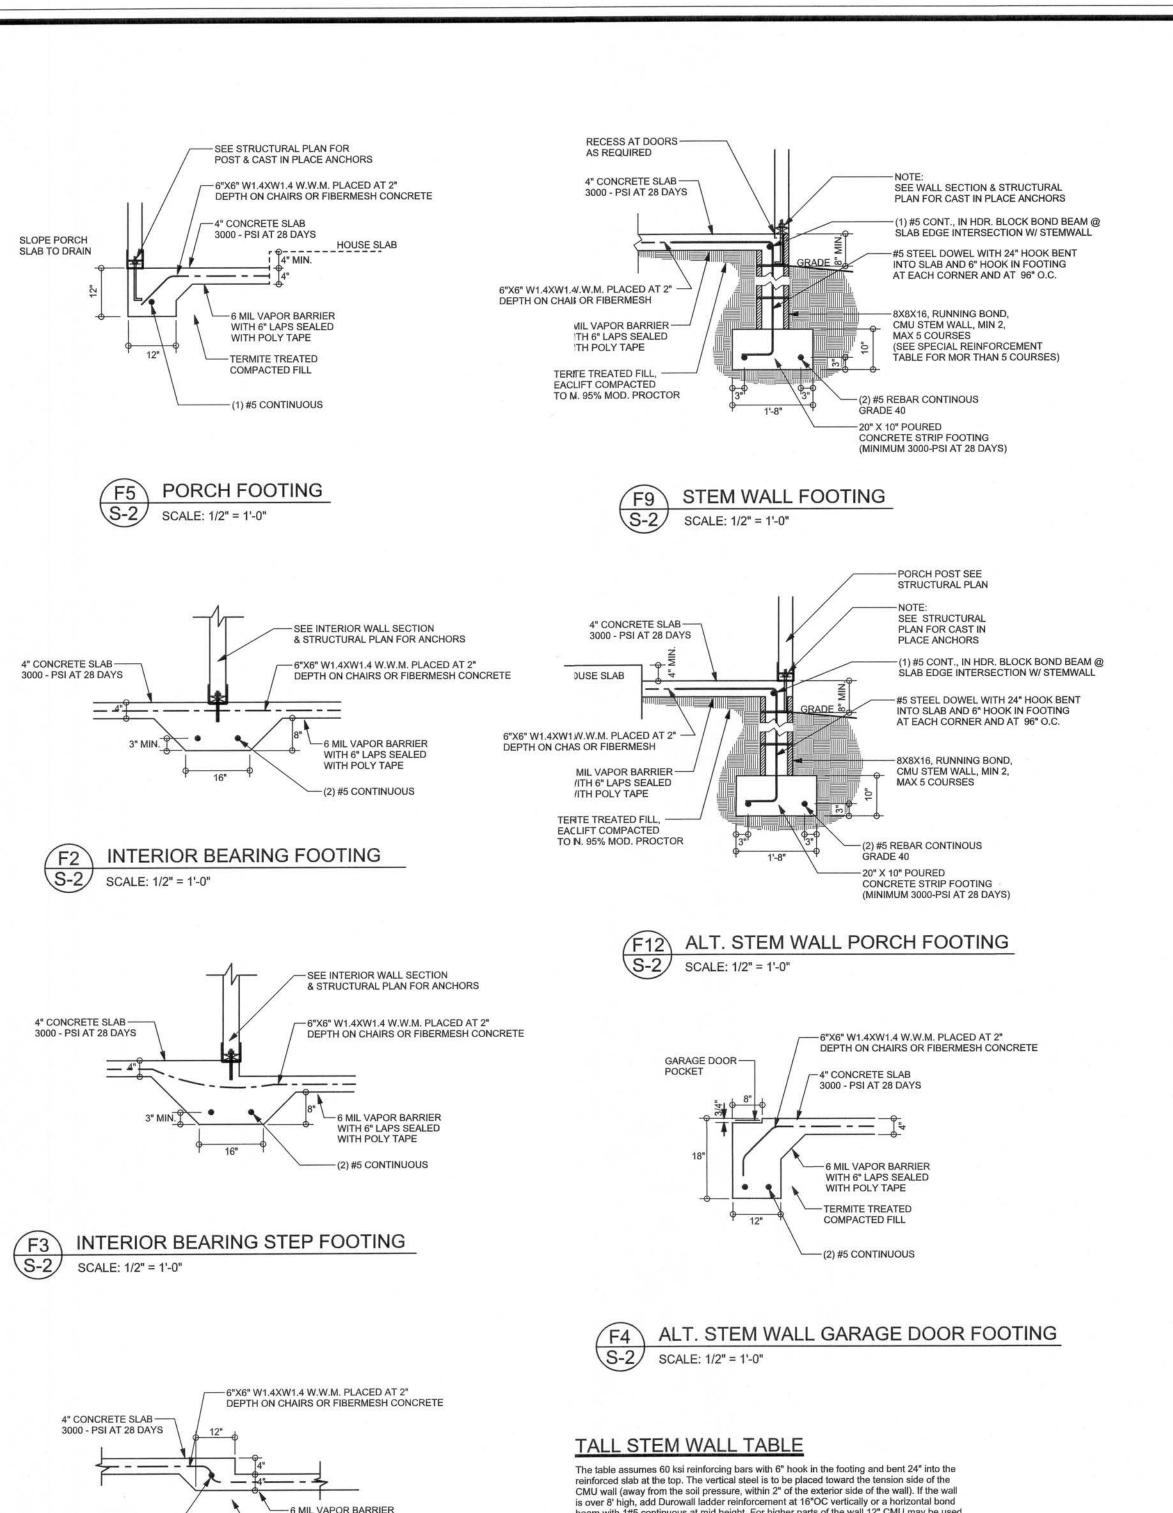

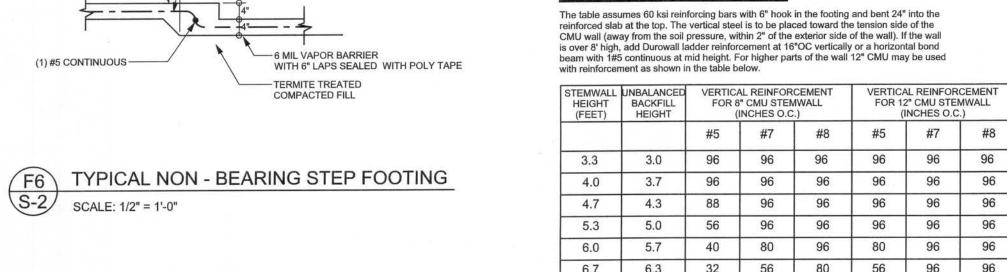

 8.3
 8
 24
 32
 24
 48


 9.0
 8
 16
 24
 16
 40

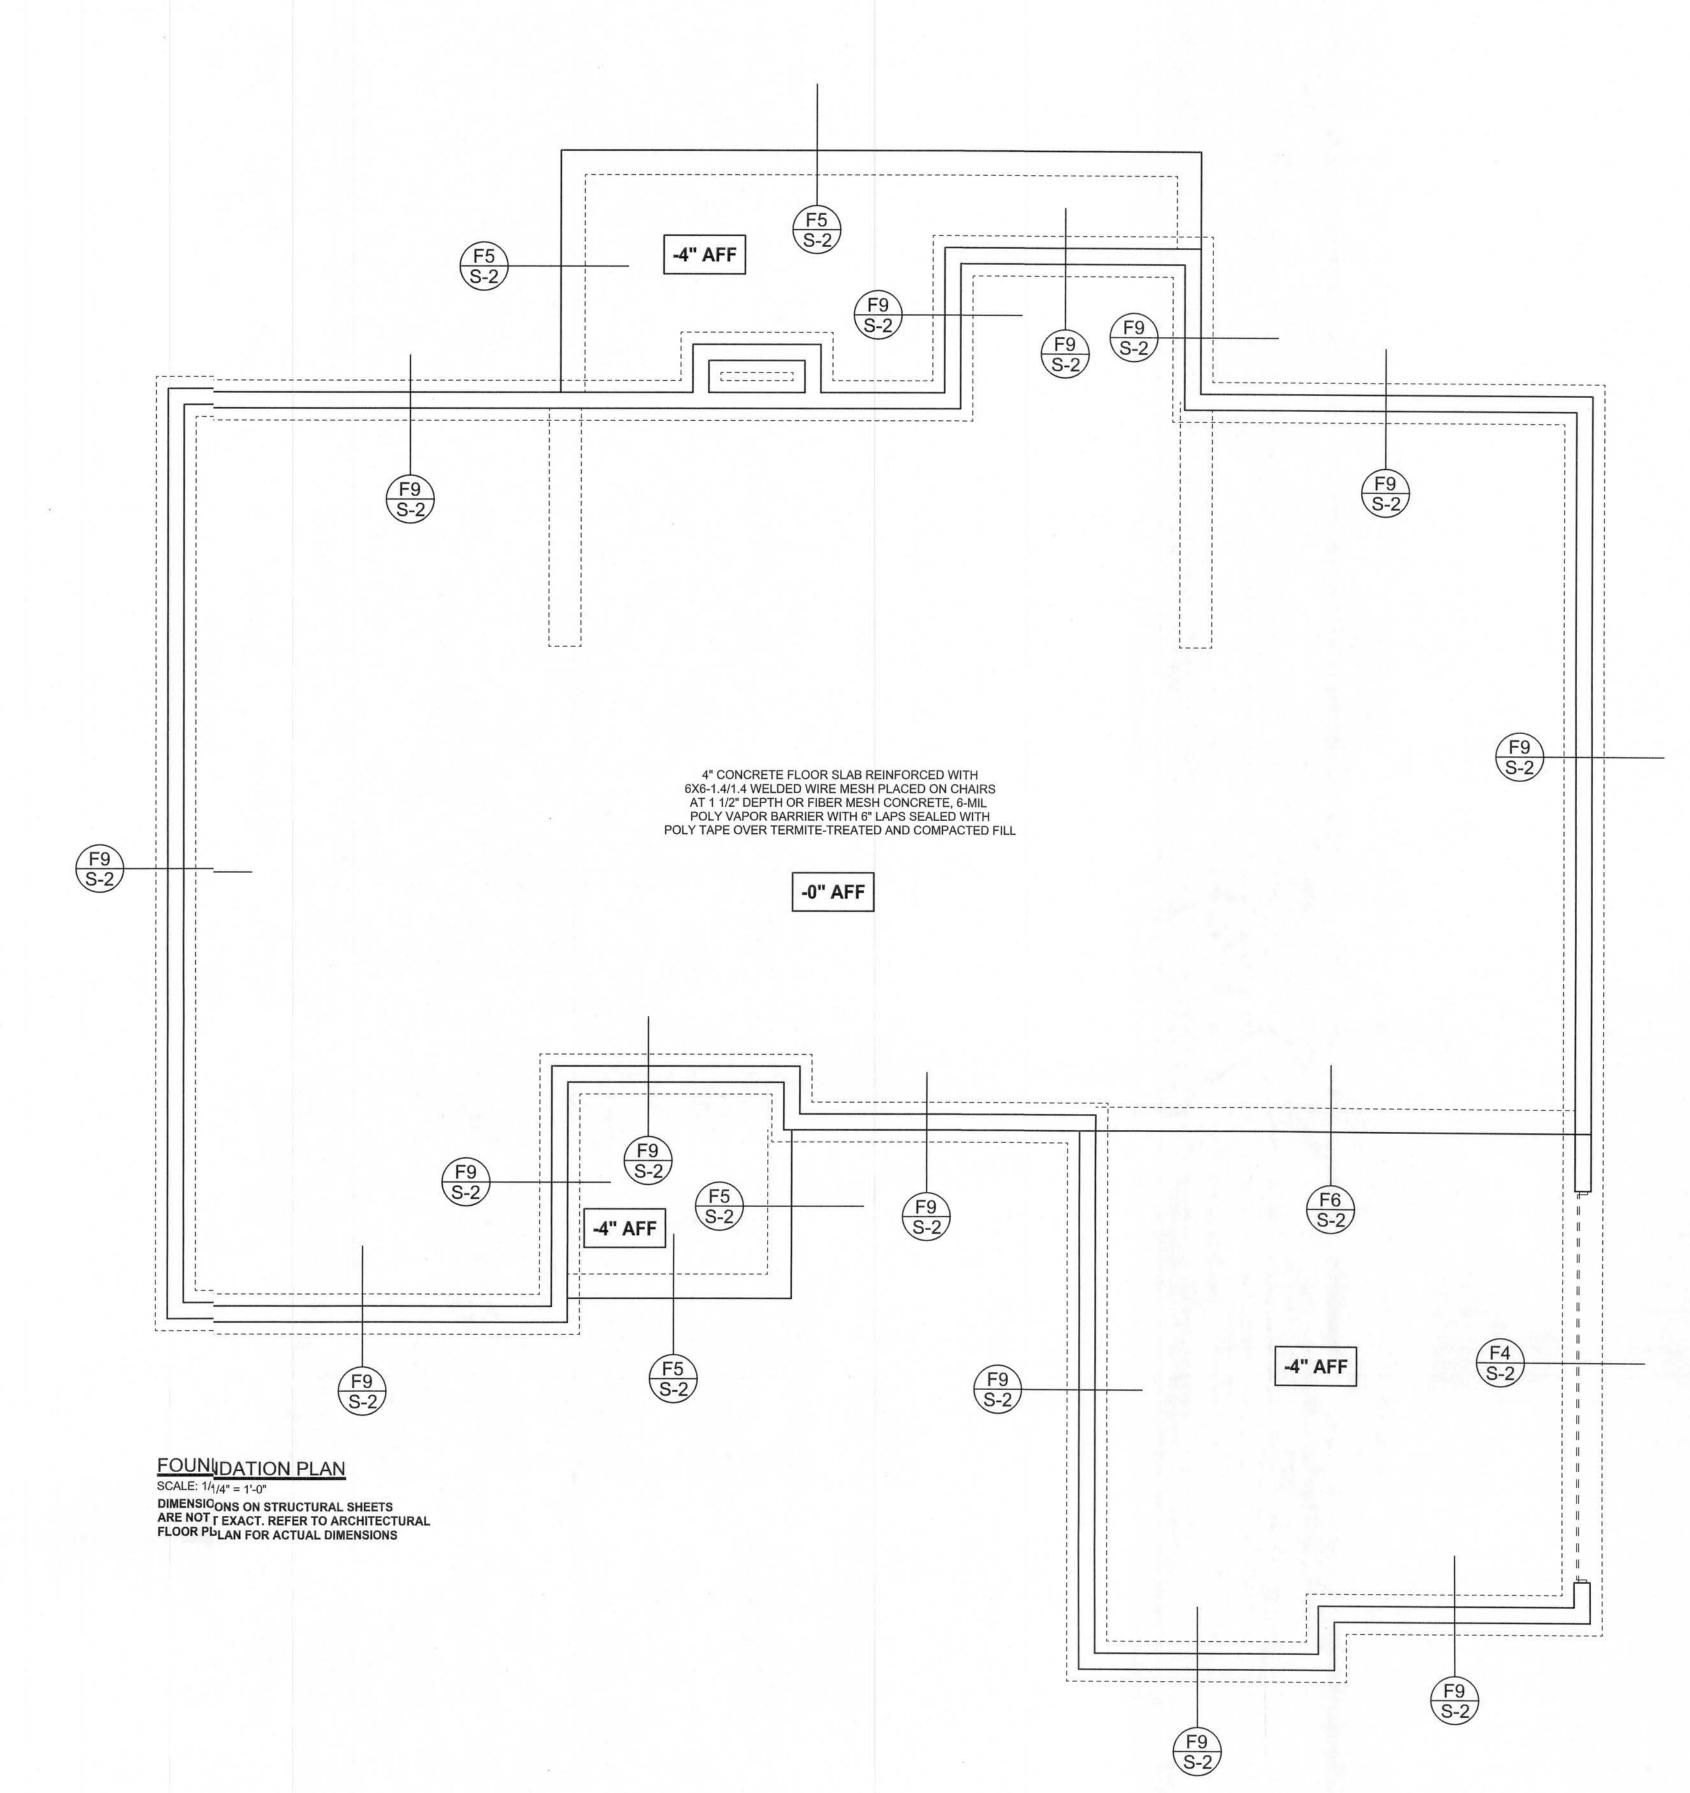

WINDLOAD ENGINEER: Mark Disosway, PE No.53915, POB 868, Lake City, FL Stated dimensions supercede scaled dimensions. Refer all questions to Mark Disosway, P.E. for resolution. Do not proceed without clarification. COPYRIGHTS AND PROPERTY RIGHTS: Mark Disosway, P.E. hereby expressly reserve its common law copyrights and property right in these instruments of service. This document is not to be reproduced, altered or copied in any form or manner without first the express written permission and consent of Mark Disosway. examined this plan, and that the applicable portions of the plan, relating to wind engineerin comply with section R301.2.1, florida building code residential 2004, to the best of my LIMITATION: This design is valid for one building, at specified location. MARK DISOSWAY P.E. 53915 Adam's Framing & Construction Spec House Lot 14 Rolling Meadows S/D ADDRESS: Lot 13 Rolling Meadows S/D Columbia County, Florida Mark Disosway P.E. P.O. Box 868 Lake City, Florida 32056 Phone: (386) 754 - 5419 Fax: (386) 269 - 4871 PRINTED DATE: March 06, 2007 DRAWN BY: STRUCTURAL BY David Disosway FINALS DATE: 06 / Mar / 07 JOB NUMBER: 703011 DRAWING NUMBER **S-2** OF 3 SHEETS

**REVISIONS** 

SOFTPIAN

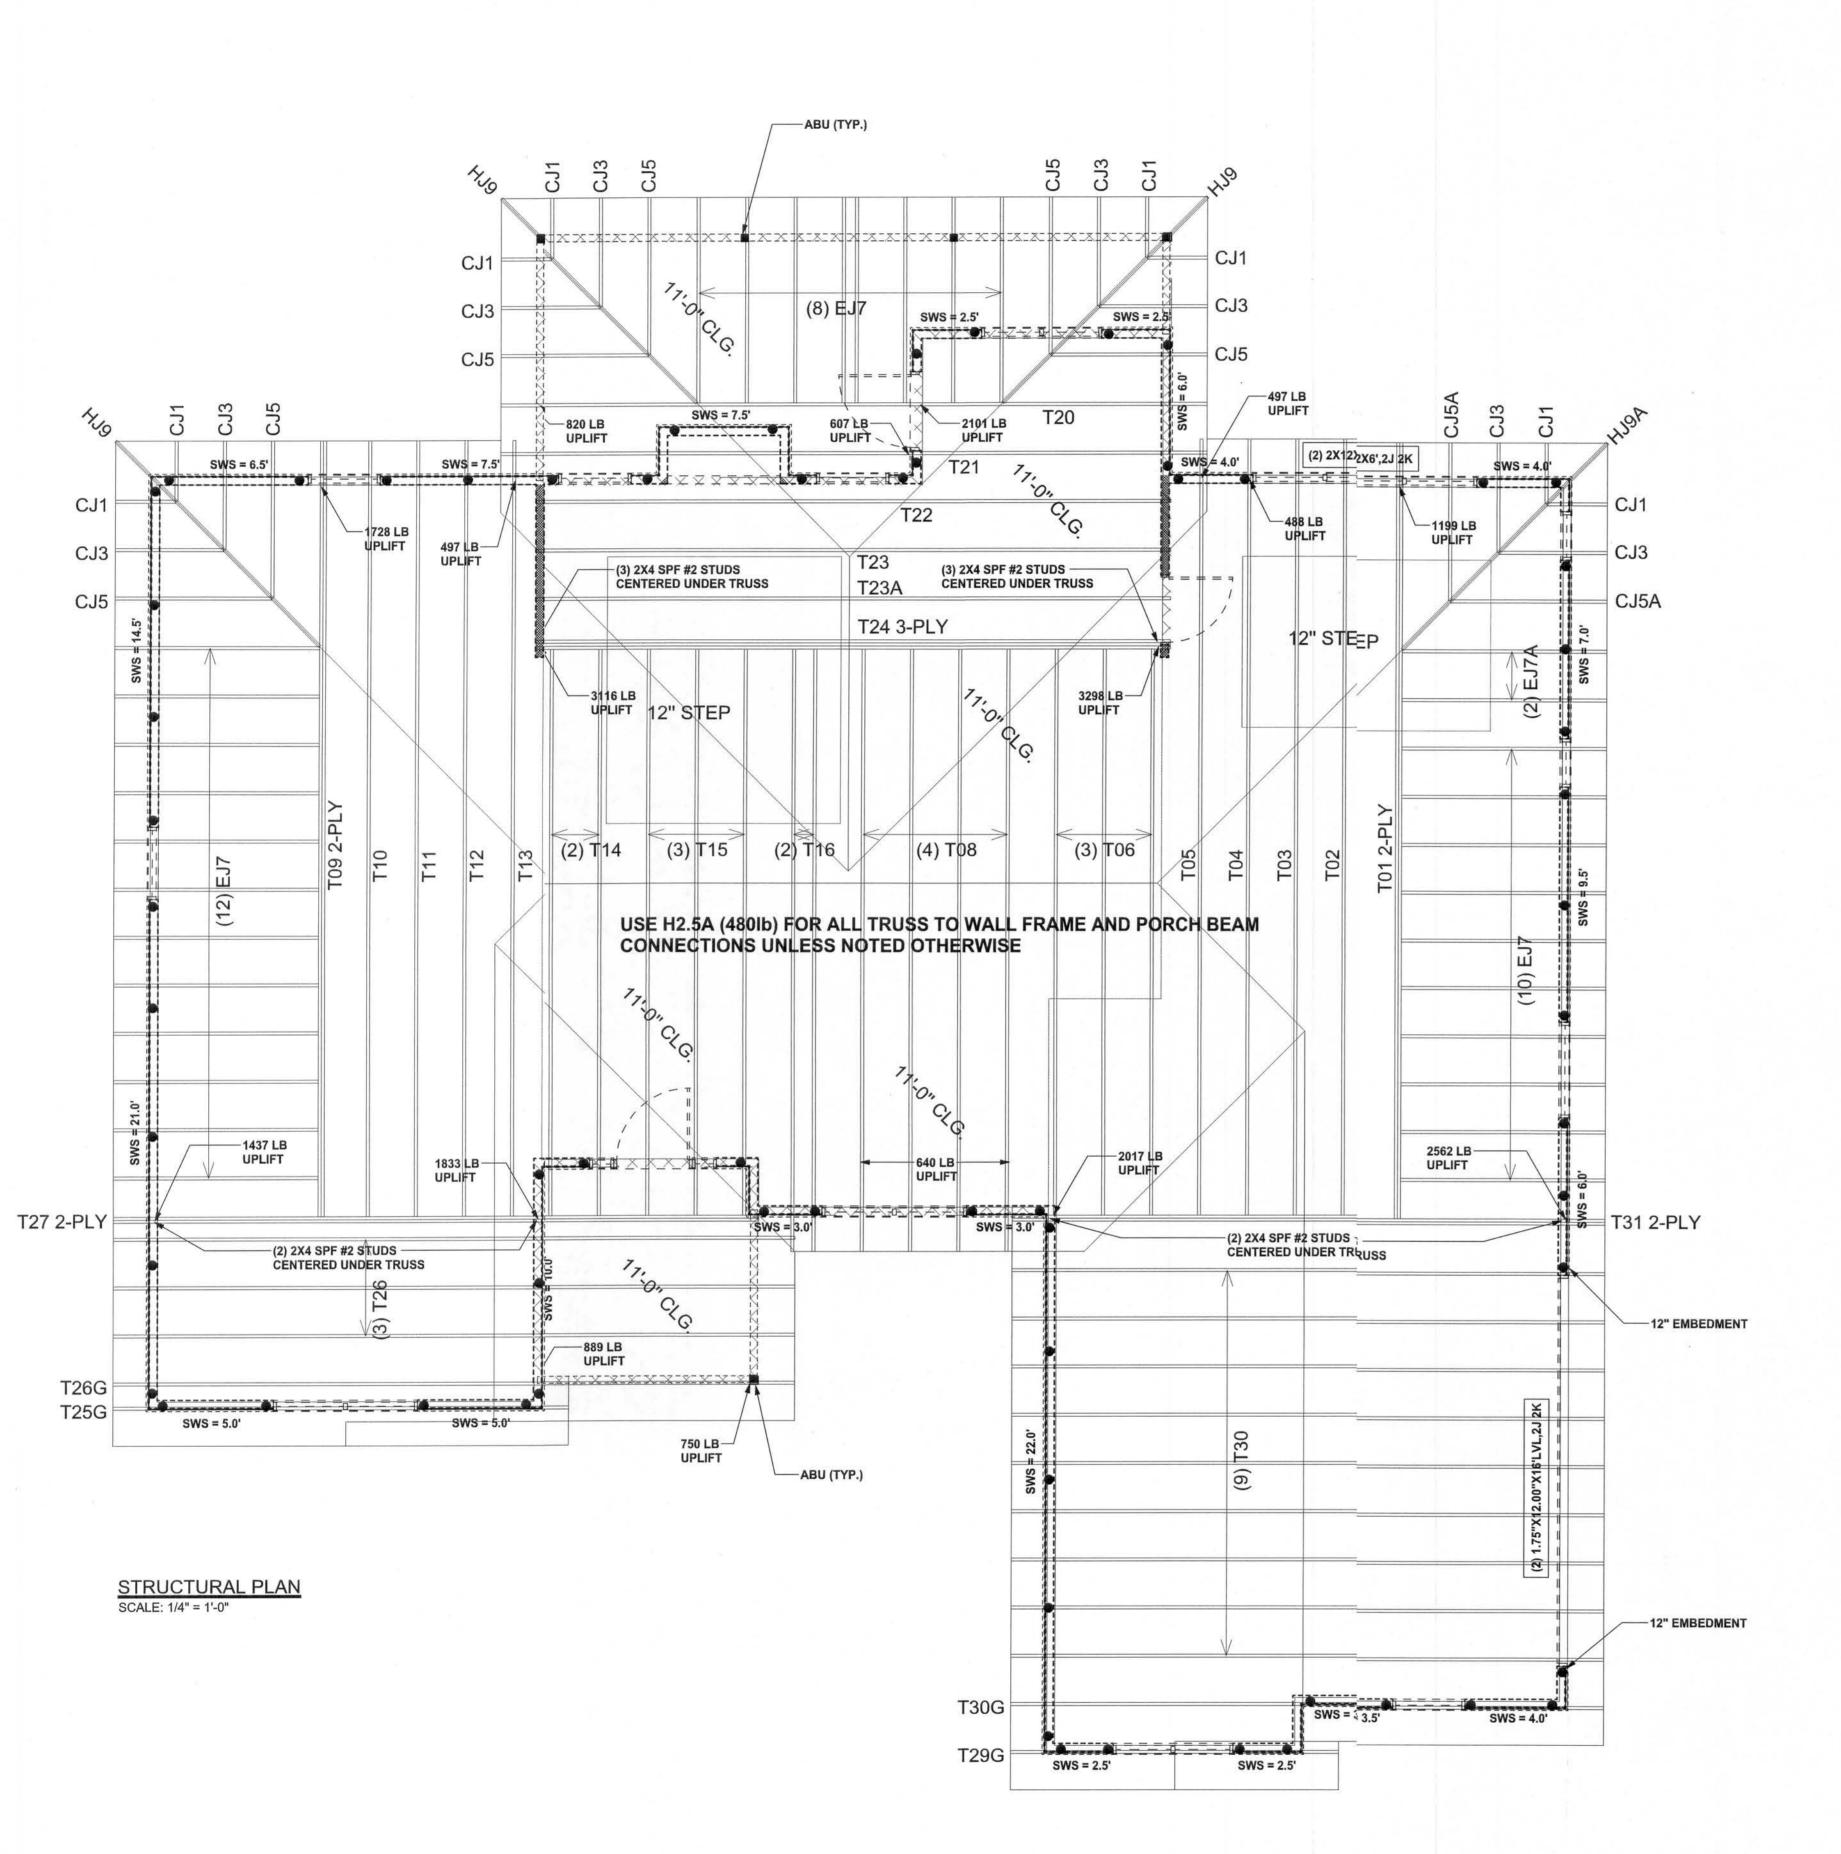

**REVISIONS** 

SOFTPIXN ARCHITECTURAL DESIGN SOFTWARE

### STRUCTURAL PLAN NOTES

- ALL LOAD BEARING FRAME WALL & PORCH HEADERS SHALL BE A MINIMUM OF (2) 2X12 SYP#2 (U.N.O.)
- SN-2 ALL LOAD BEARING FRAME WALL HEADERS SHALL HAVE (1) JACK STUD & (1) KING STUD EACH SIDE (U.N.O.)
- SN-3 DIMENSIONS ON STRUCTURAL SHEETS ARE NOT EXACT. REFER TO ARCHITECTURAL FLOOR PLAN FOR ACTUAL DIMENSIONS

PERMANENT TRUSS BRACING IS TO BE INSTALLED AT LOCATIONS AS SHOWN ON THE SEALED TRUSS DRAWINGS. LATERAL BRACING IS TO BE RESTRAINED PER BCSI1-03, BCSI-B1, BCSI-B2, & BCSI-B3. BCSI-B1, BCSI-B2, & BCSI-B3 ARE FURNISHED BY THE TRUSS SUPPLIER, WITH THE SEALED TRUSS PACKAGE

2ND FLOOR 1/2" A307 ALL THREADED ROD

### THREADED ROD LEGEND

- INDICATES LOCATION OF: 1ST FLOOR 1/2" A307 ALL THREADED ROD - INDICATES LOCATION OF:

#### **HEADER LEGEND**

(2) 2X12X0',1J 1K HEADER/BEAM CALL-OUT (U.N.O.) NUMBER OF KING STUDS (FULL LENGTH) NUMBER OF JACK STUDS (UNDER HEADER) -----SPAN OF HEADER SIZE OF HEADER MATERIAL ---NUMBER OF PLIES IN HEADER


### TOTAL SHEAR WALL SEGMENTS

SWS = 0.0' INDICATES SHEAR WALL SEGMENTS

	REQUIRED	ACTUAL
TRANSVERSE	36.5'	82.5'
LONGITUDINAL	31.2'	58.0

# WALL LEGEND

SM2 = 0.0,	1ST FLOOR EXTERIOR WALL
SWS = 0.0'	2ND FLOOR EXTERIOR
IBW	1ST FLOOR INTERIOR BEARING WALLS SEE DETAILS ON SHEET S-1
IBW	2ND FLOOR INTERIOR BEARING WALLS SEE DETAILS ON SHEET S-1

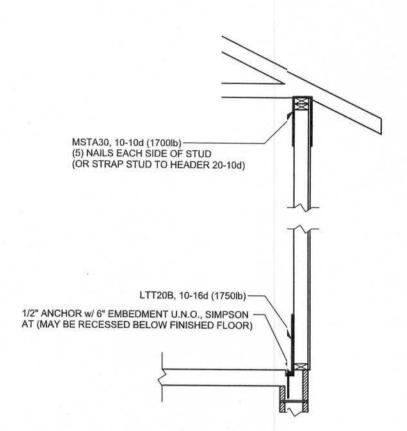

ALTERNATE WALL TIE CONNECTION WHERE THREADED ROD CANNOT BE PLACED IN WALL SCALE: 1/2" = 1'-0"

VINDLOAD ENGINEER: Mark Disosway, E No.53915, POB 868, Lake City, FL 2056, 386-754-5419

itated dimensions supercede scaled imensions. Refer all questions to lark Disosway, P.E. for resolution. to not proceed without clarification.

OPYRIGHTS AND PROPERTY RIGHTS: flark Disosway, P.E. hereby expressly reserves is common law copyrights and property right in hese instruments of service. This document is ot to be reproduced, altered or copied in any brm or manner without first the express written ermission and consent of Mark Disosway.

ERTIFICATION: I hereby certify that I have examined this plan, and that the applicable prtions of the plan, relating to wind engineering omply with section R301.2.1, florida building ode residential 2004, to the best of my

IMITATION: This design is valid for one luilding, at specified location.

MARK DISOSWAY P.E. 53915

Adam's Framing &

Construction

Spec House Lot 14 Rolling Meadows S/D

ADDRESS: Lot 13 Rolling Meadows S/D Columbia County, Florida

Mark Disosway P.E. P.O. Box 868 Lake City, Florida 32056 Phone: (386) 754 - 5419 Fax: (386) 269 - 4871

> PRINTED DATE: March 06, 2007

STRUCTURAL BY DRAWN BY: David Disosway

JOB NUMBER: 703011

DRAWING NUMBER

**S-3** 

OF 3 SHEETS

FINALS DATE: 06 / Mar / 07

CONNECTIONS, WALL, & HEADER DESIGN IS BASED ON REACTIONS & UPLIFTS FROM TRUSS ENGINEERING FURNISHED BY BUILDER. BUILDERS FIRST SOURCE JOB #L228645