



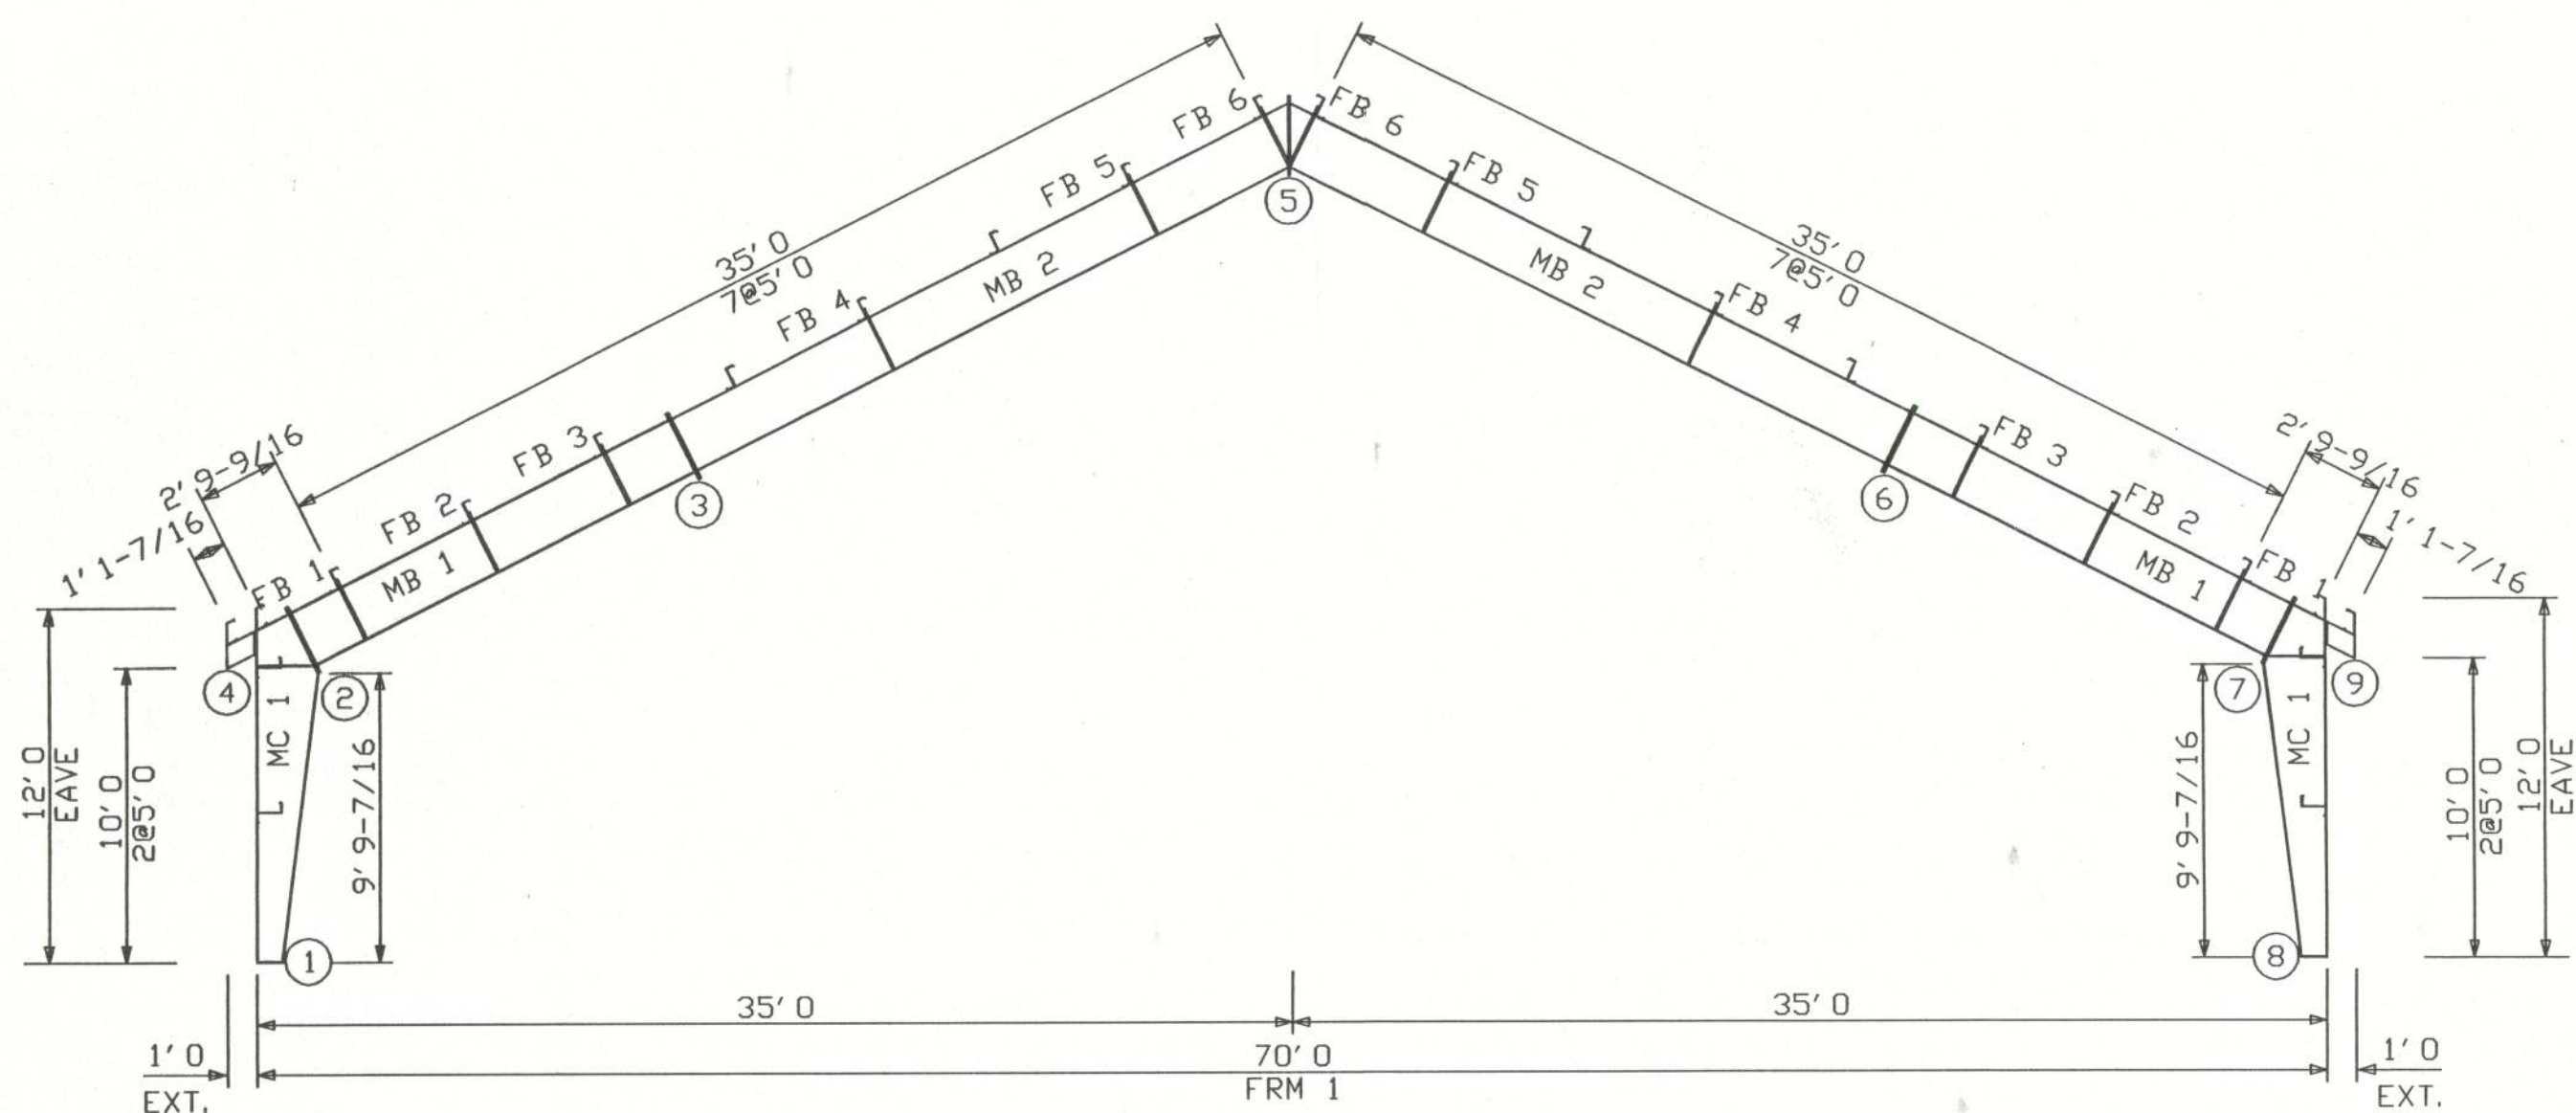

JOINT INFORMATION					
JOINT	PARTMARK	DEPTH	THICKNESS	BOLT QTY	DESCRIPTION
1	MC 1	10	0.1345	4	AB. 75X24
2	MC 1	1' 11	0.1875	8	H. 75X225
2	OH 1	8	0.1250	4	H. 75X200
4	OH 1	8	0.1250		
2	MB 1	1' 11	0.1875		
3	MB 1	1' 11	0.1250	8	H. 75X225
3	MB 2	1' 11	0.1250		
5	MB 2	1' 11	0.1345	8	H. 75X200

FLANGE BRACE TABLE				
PARTMARK	LENGTH	PLACEMENT	QTY/FRAME	QTY/BLDG
FB 1	3' 0-13/16	NS	2	8
FB 2	3' 0-13/16	NS	2	8
FB 3	3' 0-13/16	NS	2	8
FB 4	3' 0-13/16	NS	2	8
FB 5	3' 0-13/16	NS	2	8
FB 6	3' 0-13/16	NS	2	8

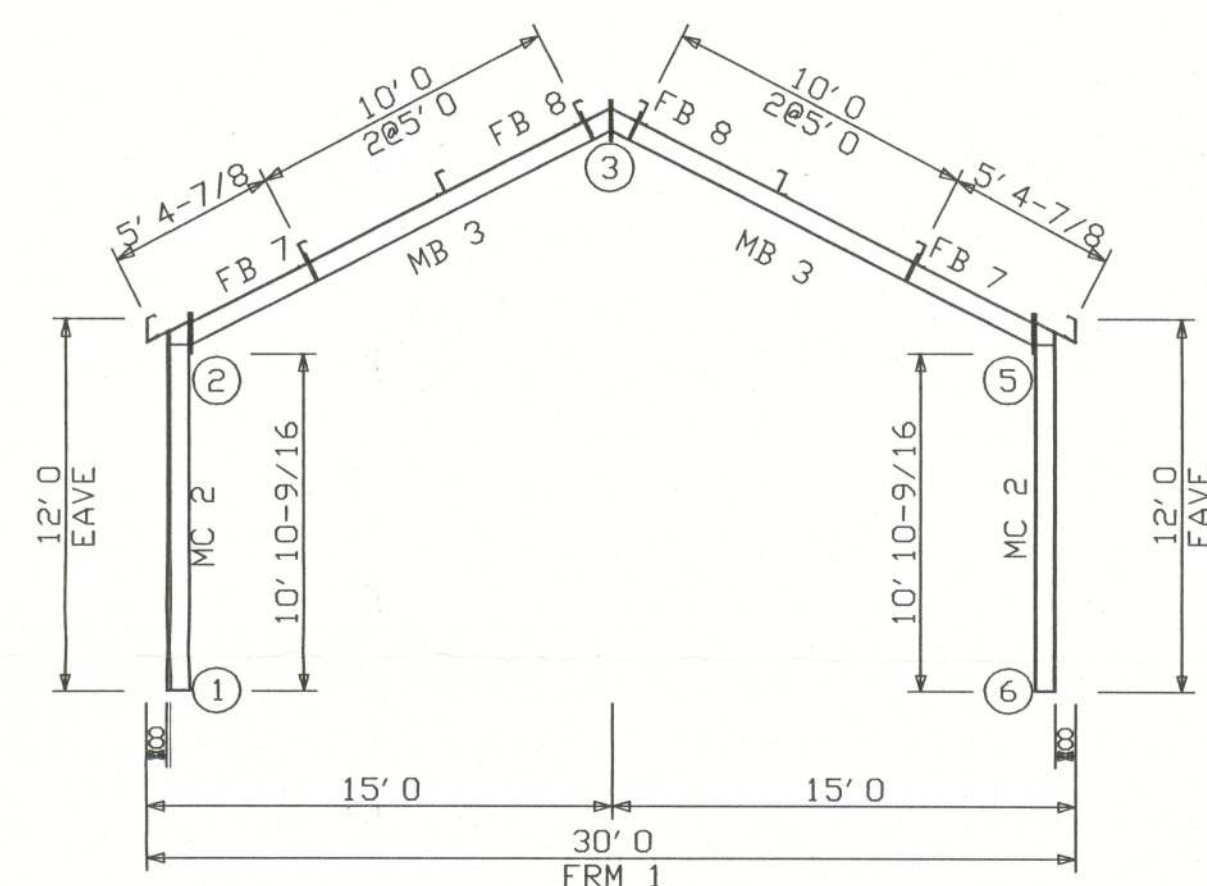

JOINT INFORMATION					
JOINT	PARTMARK	DEPTH	THICKNESS	BOLT QTY	DESCRIPTION
1	MC 2	7-1/8	0.2450	4	AB. 75X24
2	MC 2	7-1/8	0.2450	8	H. 75X250
2	MB 3	7-1/2	0.2300		
3	MB 3	7-1/2	0.2300	8	H. 75X200

FLANGE BRACE TABLE				
PARTMARK	LENGTH	PLACEMENT	QTY/FRAME	QTY/BLDG
FB 7	2' 4-13/16	NS	2	4
FB 8	2' 4-13/16	NS	2	4

DESIGN CRITERIA			
BUILDING CODE:	FBC		
LIVE LOAD TO FRAMES:	12	PSF	
LIVE LOAD TO PURLINS:	20	PSF	
COLLATERAL LOAD:	3	PSF	
SNOW LOAD:	0	PSF	
WIND LOAD: (3 SECOND GUST)	110	MPH	
WIND IMPORTANCE FACTOR:	1.15		
WIND EXPOSURE:	B		
CATEGORY: (SEISMIC USE GROUP)	I		
PLAN:		JOB #	5004-XS
CROSS SECTION		SHEET	8 OF 8