



Lumber design values are in accordance with ANSI/TPI 1 section 6.3
These truss designs rely on lumber values established by others.

RE: 1225-032 - JOSEPH MISTRETТА

MiTek, Inc.
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Site Information:

Customer Info: JOSEPH MISTRETТА Project Name: . Model: .
Lot/Block: . Subdivision: .
Address: ., .
City: COLUMBIA COUNTY State: FL

Name Address and License # of Structural Engineer of Record, If there is one, for the building.

Name: License #:
Address:
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: FBC2023/TPI2014 Design Program: MiTek 20/20 8.8
Wind Code: ASCE 7-22 Wind Speed: 130 mph
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 17 individual, Truss Design Drawings and 0 Additional Drawings.
With my seal affixed to this sheet, I hereby certify that I am the Truss Design Engineer and this index sheet conforms to 61G15-31.003, section 5 of the Florida Board of Professional Engineers Rules.


No.	Seal#	Truss Name	Date
1	T39619749	A01	12/23/25
2	T39619750	A01A	12/23/25
3	T39619751	A02	12/23/25
4	T39619752	A02A	12/23/25
5	T39619753	A03	12/23/25
6	T39619754	A03A	12/23/25
7	T39619755	A04	12/23/25
8	T39619756	A04A	12/23/25
9	T39619757	B01	12/23/25
10	T39619758	B02	12/23/25
11	T39619759	CJ01	12/23/25
12	T39619760	CJ01A	12/23/25
13	T39619761	J01	12/23/25
14	T39619762	J02	12/23/25
15	T39619763	J02A	12/23/25
16	T39619764	J03	12/23/25
17	T39619765	J04	12/23/25



The truss drawing(s) referenced above have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Mayo Truss Company, Inc..

Truss Design Engineer's Name: Lee, Julius
My license renewal date for the state of Florida is February 28, 2027.

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

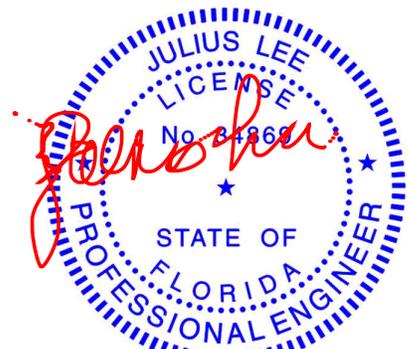

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:


December 23, 2025

Job 1225-032	Truss A01	Truss Type Common	Qty 9	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619749
-----------------	--------------	----------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:19
ID:NY79P71OobmaekbYME8rny6TbR-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

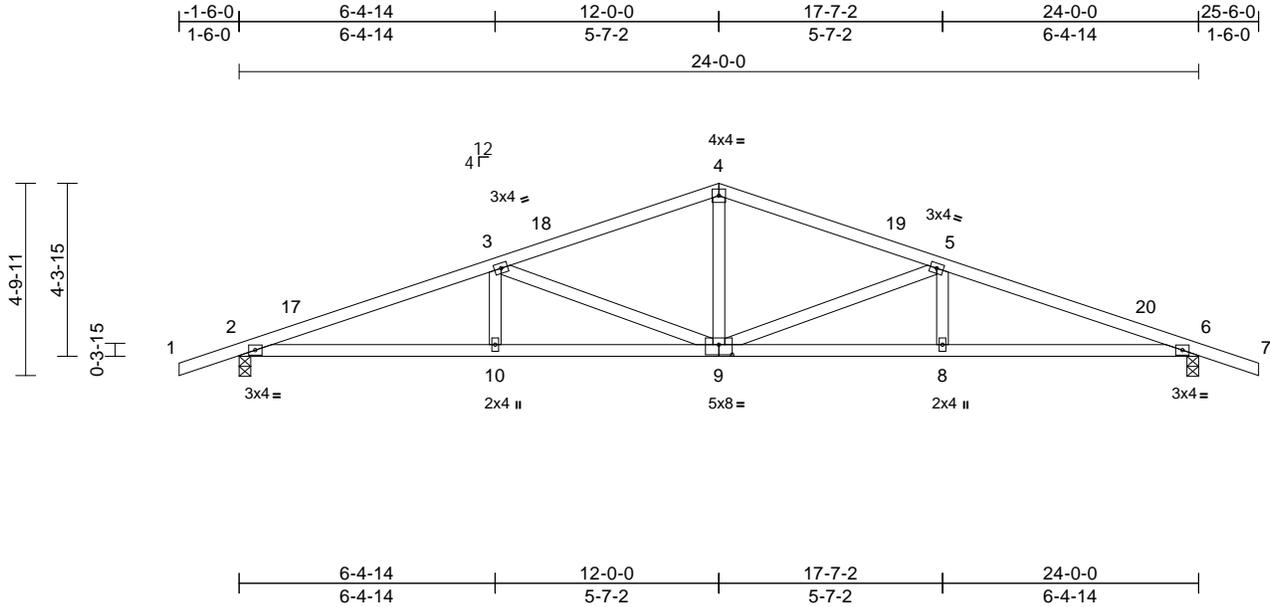

Scale = 1:57.3

Plate Offsets (X, Y): [9:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.37	Vert(LL)	-0.12	9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.63	Vert(CT)	-0.25	9-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.48	Horz(CT)	0.08	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 106 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-3-8, 6=0-3-8
Max Horiz 2=47 (LC 11)
Max Uplift 2=-35 (LC 12), 6=-35 (LC 12)
Max Grav 2=1050 (LC 1), 6=1050 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/28, 2-3=-2303/139, 3-4=-1586/135,
4-5=-1586/135, 5-6=-2303/139, 6-7=0/28
BOT CHORD 2-10=-67/2153, 8-10=-83/2153, 6-8=-83/2153
WEBS 3-10=0/243, 3-9=-774/75, 4-9=0/654,
5-9=-774/75, 5-8=0/243

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -1-6-0 to 1-6-0,
Zone1 1-6-0 to 12-0-0, Zone2 12-0-0 to 16-2-15, Zone1
16-2-15 to 25-6-0 zone; cantilever left and right
exposed; end vertical left and right exposed; C-C for
members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.

- 5) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 35 lb uplift at joint
2 and 35 lb uplift at joint 6.
- 7) This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss A01A	Truss Type Common	Qty 3	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619750
-----------------	---------------	----------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:20
ID: V2P37ZBYkbPkik41dTuoQy6TbE-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

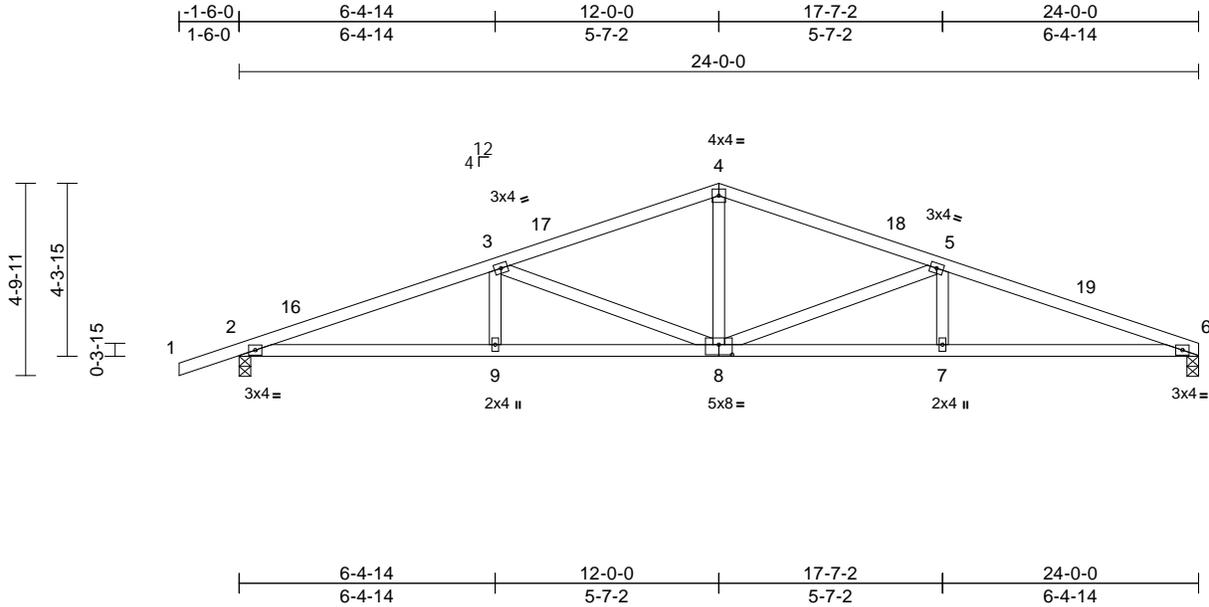

Scale = 1:57.3

Plate Offsets (X, Y): [8:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.41	Vert(LL)	-0.12	8-9	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.67	Vert(CT)	-0.25	8-9	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.49	Horz(CT)	0.08	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 104 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-3-8, 6=0-3-8
Max Horiz 2=48 (LC 11)
Max Uplift 2=-37 (LC 12)
Max Grav 2=1053 (LC 1), 6=957 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/28, 2-3=-2312/161, 3-4=-1594/144,
4-5=-1595/156, 5-6=-2333/179
BOT CHORD 2-9=-107/2161, 7-9=-110/2184,
6-7=-110/2184
WEBS 3-9=0/243, 3-8=-774/77, 4-8=0/661,
5-8=-799/81, 5-7=0/246

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFERS (directional) and C-C Zone3 -1-6-0 to 1-6-0,
Zone1 1-6-0 to 12-0-0, Zone2 12-0-0 to 16-2-15, Zone1
16-2-15 to 24-0-0 zone; cantilever left and right
exposed ; end vertical left and right exposed;C-C for
members and forces & MWFERS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- 3) Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- 4) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.

- 5) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 37 lb uplift at joint
2.
- 7) This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss A02	Truss Type Hip	Qty 1	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619751
-----------------	--------------	-------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:20
ID:s?DyBHFhZ721oVz?Q0S3VUy6Tb9-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

Page: 1

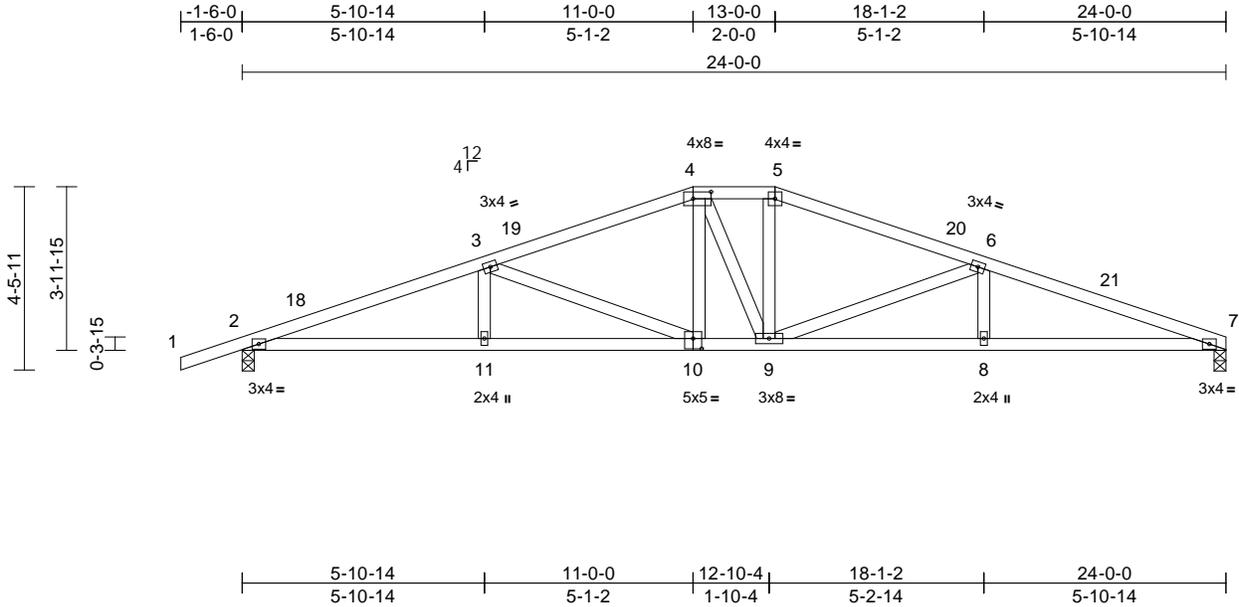

Scale = 1:55.9

Plate Offsets (X, Y): [4:0-5-4,0-2-0], [10:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.36	Vert(LL)	-0.12	10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.64	Vert(CT)	-0.25	10-11	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.39	Horz(CT)	0.08	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 112 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-3-8, 7=0-3-8
Max Horiz 2=45 (LC 11)
Max Uplift 2=-37 (LC 12)
Max Grav 2=1053 (LC 1), 7=957 (LC 1)

FORCES


(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/28, 2-3=-2351/197, 3-4=-1696/185,
4-5=-1561/190, 5-6=-1687/179,
6-7=-2375/196
BOT CHORD 2-11=-154/2200, 9-11=-154/2200,
8-9=-151/2226, 7-8=-151/2226
WEBS 3-11=0/228, 3-10=-697/69, 4-10=0/318,
4-9=-126/140, 5-9=-13/323, 6-9=-732/75,
6-8=0/232

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -1-6-0 to 1-6-0,
Zone1 1-6-0 to 11-0-0, Zone3 11-0-0 to 13-0-0, Zone2
13-0-0 to 17-2-15, Zone1 17-2-15 to 24-0-0 zone;
cantilever left and right exposed ; end vertical left and
right exposed;C-C for members and forces & MWFRS
for reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 37 lb uplift at joint
2.
- This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard

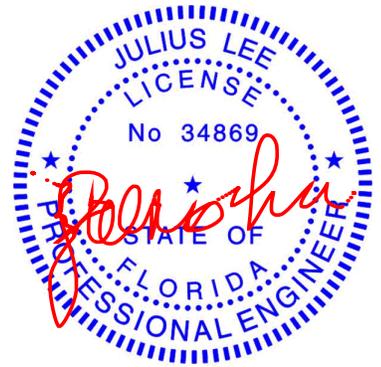

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss A02A	Truss Type Hip	Qty 1	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619752
-----------------	---------------	-------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:21
ID:Cz0rE_jqNggKuGryDZ2ECXy6Tb4-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

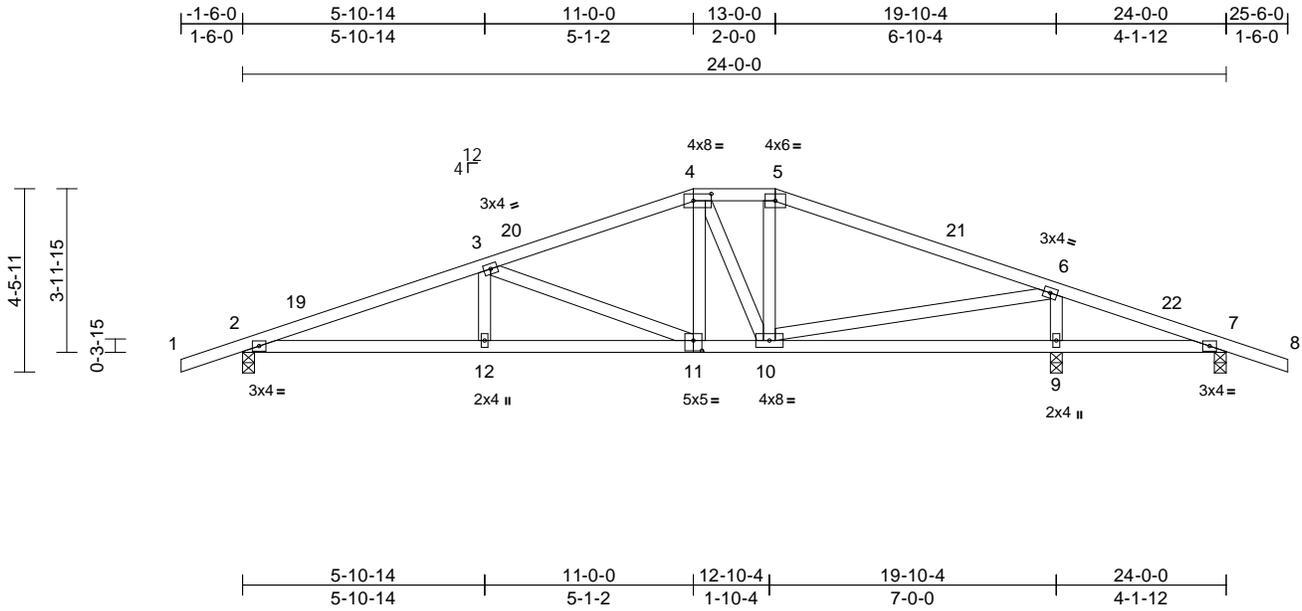

Scale = 1:55.9
Plate Offsets (X, Y): [4:0-5-4,0-2-0], [11:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.46	Vert(LL)	-0.06	12-15	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.49	Vert(CT)	-0.13	11-12	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.38	Horz(CT)	0.03	9	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 116 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 7=0-3-8, 9=0-3-8
Max Horiz 2=-44 (LC 10)
Max Uplift 2=-38 (LC 12), 7=-82 (LC 12), 9=-23 (LC 12)
Max Grav 2=859 (LC 1), 7=167 (LC 24), 9=1107 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/28, 2-3=-1758/156, 3-4=-1086/143, 4-5=-913/137, 5-6=-1031/124, 6-7=-19/240, 7-8=0/28
BOT CHORD 2-12=-95/1640, 10-12=-95/1640, 9-10=-185/40, 7-9=-185/44
WEBS 3-12=0/235, 3-11=-711/70, 4-11=-9/303, 4-10=-246/61, 5-10=-70/144, 6-10=-46/1109, 6-9=-973/164

- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 38 lb uplift at joint 2, 23 lb uplift at joint 9 and 82 lb uplift at joint 7.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 11-0-0, Zone3 11-0-0 to 13-0-0, Zone2 13-0-0 to 17-2-15, Zone1 17-2-15 to 25-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss A03	Truss Type Hip	Qty 1	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619753
-----------------	--------------	-------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:21
ID:JWVK9GjWcpqeMLtle?8z2Uy6TaZ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

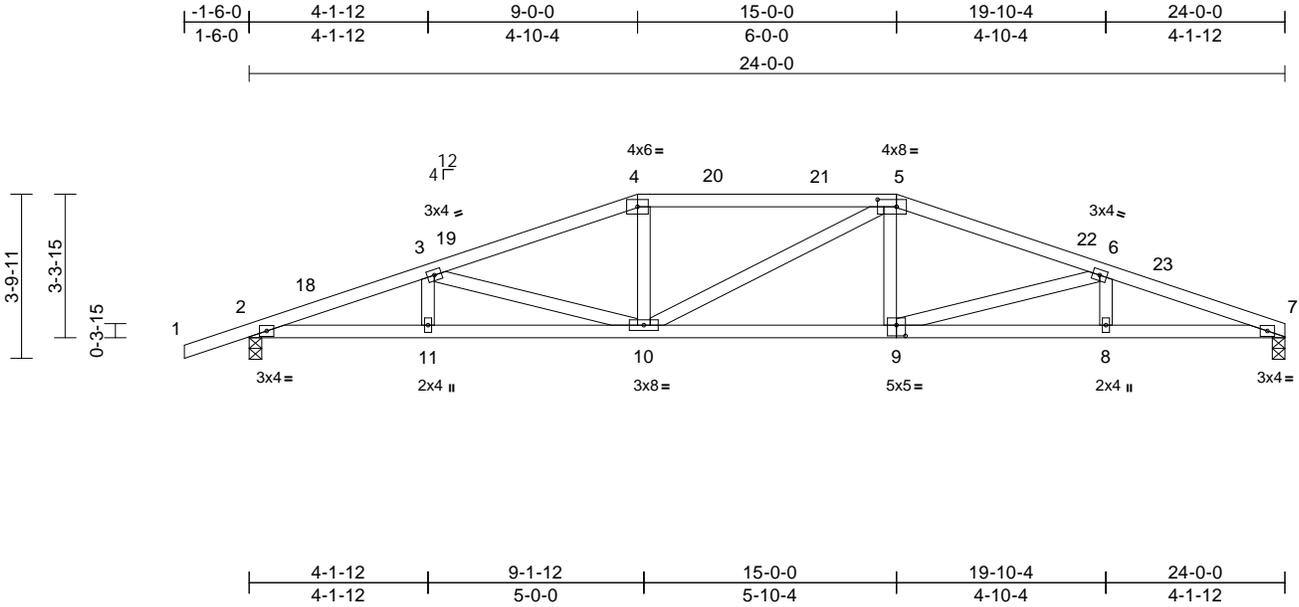

Scale = 1:53.1

Plate Offsets (X, Y): [5:0-5-4,0-2-0], [9:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.43	Vert(LL)	-0.12	9-10	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.55	Vert(CT)	-0.26	9-10	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.25	Horz(CT)	0.08	7	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 111 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 7=0-3-8
Max Horiz 2=38 (LC 11)
Max Uplift 2=-37 (LC 12)
Max Grav 2=1053 (LC 1), 7=957 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/28, 2-3=-2457/242, 3-4=-1953/225,
4-5=-1826/234, 5-6=-1968/215,
6-7=-2496/238
BOT CHORD 2-11=-208/2310, 10-11=-208/2310,
8-10=-201/2350, 7-8=-201/2350
WEBS 3-10=-521/65, 4-10=0/340, 5-10=-156/158,
5-9=0/341, 6-9=-550/73, 3-11=0/158,
6-8=0/158

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -1-6-0 to 1-6-0,
Zone1 1-6-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1
13-2-15 to 15-0-0, Zone2 15-0-0 to 19-2-15, Zone1
19-2-15 to 24-0-0 zone; cantilever left and right
exposed ; end vertical left and right exposed;C-C for
members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
 - Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
 - Provide adequate drainage to prevent water ponding.



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss A03A	Truss Type Hip	Qty 1	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619754
-----------------	---------------	-------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:21
ID:S2hOy7SnFYW_Aj11jlkH0My6TZc-RfC?PsB70Hq3NSgPqnL8w3uITXbGkWrCDoi7J4zJC?f

Page: 1

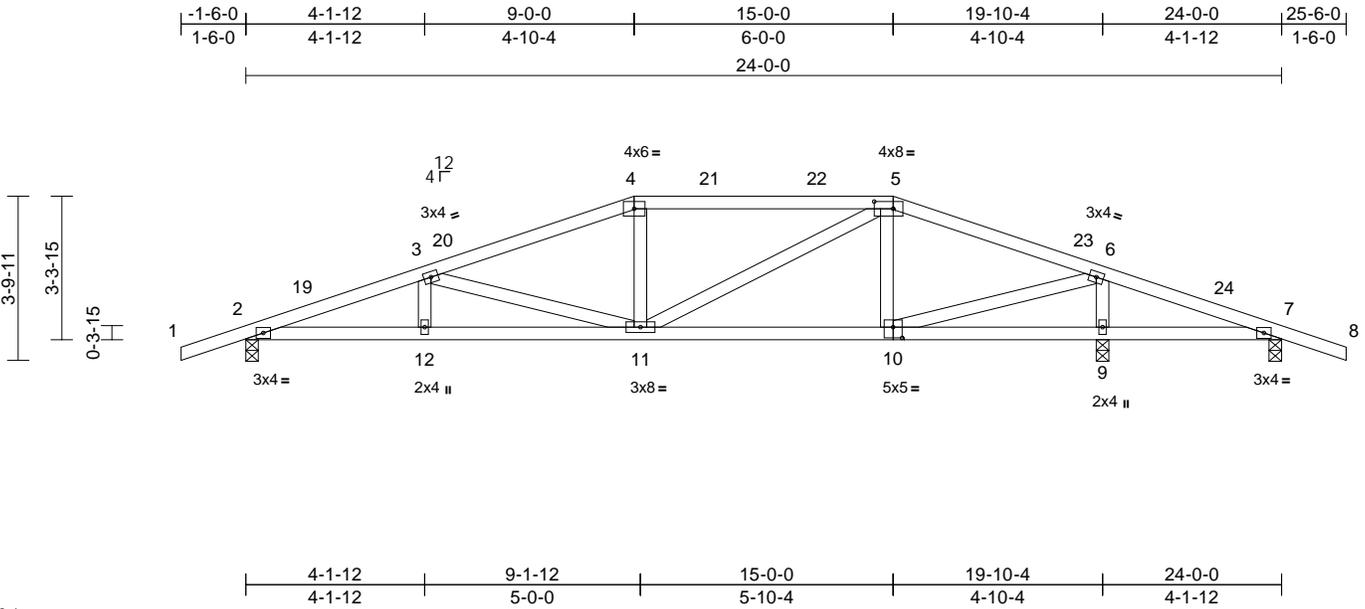

Scale = 1:53.1

Plate Offsets (X, Y): [5:0-5-4,0-2-0], [10:0-2-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.40	Vert(LL)	-0.07	11-12	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.46	Vert(CT)	-0.14	11-12	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.29	Horz(CT)	0.03	9	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 113 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 7=0-3-8, 9=0-3-8
Max Horiz 2=37 (LC 11)
Max Uplift 2=-38 (LC 12), 7=-85 (LC 12), 9=-19 (LC 12)
Max Grav 2=848 (LC 1), 7=127 (LC 24), 9=1167 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/28, 2-3=-1842/192, 3-4=-1317/172, 4-5=-1212/183, 5-6=-900/126, 6-7=-26/478, 7-8=0/28
BOT CHORD 2-12=-140/1728, 11-12=-140/1728, 9-11=-411/808, 7-9=-411/59
WEBS 3-11=-540/67, 4-11=0/187, 5-11=-58/505, 5-10=-258/96, 6-10=-83/1270, 6-9=-1051/153, 3-12=0/163

- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 85 lb uplift at joint 7, 19 lb uplift at joint 9 and 38 lb uplift at joint 2.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional) and C-C Zone3 1-6-0 to 1-6-0, Zone1 1-6-0 to 9-0-0, Zone2 9-0-0 to 13-2-15, Zone1 13-2-15 to 15-0-0, Zone2 15-0-0 to 19-2-15, Zone1 19-2-15 to 25-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DDL=1.60 plate grip DOL=1.60



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss A04	Truss Type Hip Girder	Qty 1	Ply 2	JOSEPH MISTRETTA Job Reference (optional)	T39619755
-----------------	--------------	--------------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:22
ID:iKoe_zql6mxuqKqklq?MGQy6TYx-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

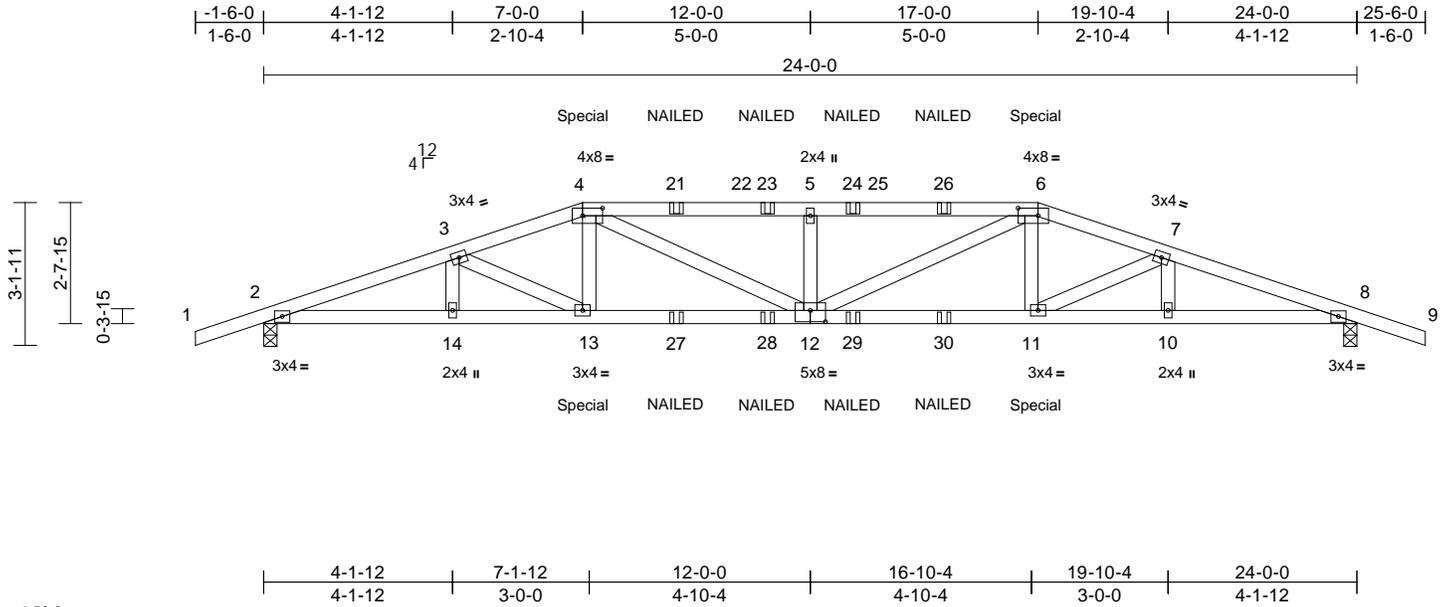

Scale = 1:50.3
Plate Offsets (X, Y): [4:0-5-4,0-2-0], [6:0-5-4,0-2-0], [12:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.49	Vert(LL)	-0.18	12	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.69	Vert(CT)	-0.35	11-12	>812	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.13	Horz(CT)	0.09	8	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 228 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-8-7 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 8=0-3-8
Max Horiz 2=-30 (LC 6)
Max Grav 2=1978 (LC 1), 8=1978 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/28, 2-3=-5200/0, 3-4=-5043/0, 4-5=-5793/0, 5-6=-5793/0, 6-7=-5043/0, 7-8=-5200/0, 8-9=0/28
BOT CHORD 2-14=0/4895, 13-14=0/4895, 11-13=0/4814, 10-11=0/4895, 8-10=0/4895
WEBS 4-13=0/656, 4-12=0/1146, 5-12=-682/131, 6-12=0/1146, 6-11=0/656, 3-13=-136/119, 7-11=-136/119, 3-14=-26/50, 7-10=-26/50

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional); cantilever left and right exposed ;
end vertical left and right exposed; Lumber DOL=1.60
plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 219 lb down and 65 lb up at 7-0-0, and 219 lb down and 65 lb up at 17-0-0 on top chord, and 381 lb down at 7-0-0, and 381 lb down at 16-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-4=-60, 4-6=-60, 6-9=-60, 15-18=-20
Concentrated Loads (lb)
Vert: 4=-172 (B), 6=-172 (B), 13=-381 (B), 11=-381 (B), 21=-124 (B), 23=-124 (B), 24=-124 (B), 26=-124 (B), 27=-64 (B), 28=-64 (B), 29=-64 (B), 30=-64 (B)



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)</p>	 <p>16023 Swingley Ridge Rd. Chesterfield, MO 63017 314.434.1200 / MiTek-US.com</p>
--	--

Job 1225-032	Truss A04A	Truss Type Hip Girder	Qty 1	Ply 2	JOSEPH MISTRETTA Job Reference (optional)	T39619756
-----------------	---------------	--------------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:22
ID:?Dm8brTTTT53FdSAexE_Q3y6TYI-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCdoi7J4zJC7f

Page: 1

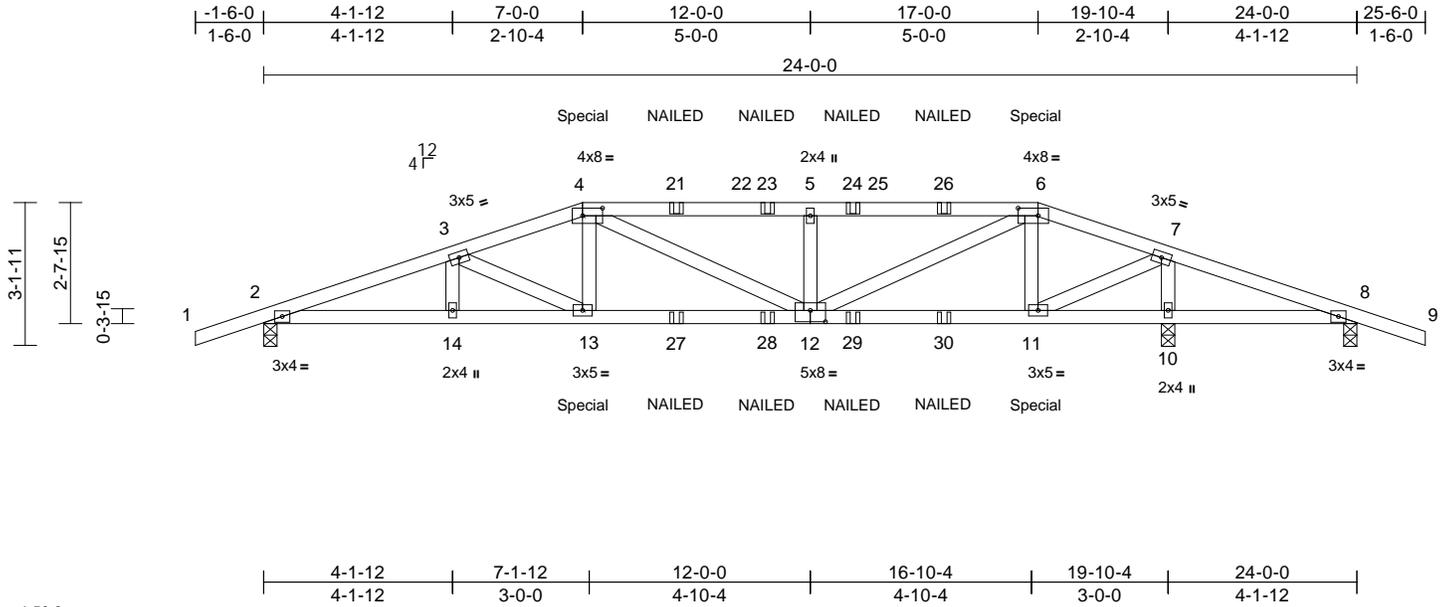

Scale = 1:50.3

Plate Offsets (X, Y): [4:0-5-4,0-2-0], [6:0-5-4,0-2-0], [12:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.36	Vert(LL)	-0.08	12-13	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.48	Vert(CT)	-0.16	12-13	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.34	Horz(CT)	0.03	10	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 228 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 8=0-3-8, 10=0-3-8
Max Horiz 2=-30 (LC 6)
Max Uplift 8=-497 (LC 19)
Max Grav 2=1440 (LC 1), 8=-20 (LC 18), 10=2531 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/28, 2-3=-3588/0, 3-4=-3362/0, 4-5=-3090/0, 5-6=-3090/0, 6-7=-1097/13, 7-8=0/1815, 8-9=0/28
BOT CHORD 2-14=0/3370, 13-14=0/3370, 11-13=0/3216, 10-11=-1686/0, 8-10=-1686/0
WEBS 4-13=0/663, 4-12=-148/0, 5-12=-696/130, 6-12=0/2386, 6-11=-1075/24, 7-11=0/2968, 7-10=-2402/0, 3-13=-213/87, 3-14=0/76

NOTES
1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; porch right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 497 lb uplift at joint 8.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 219 lb down and 65 lb up at 7-0-0, and 150 lb down and 51 lb up at 17-0-0 on top chord, and 381 lb down at 7-0-0, and 88 lb down at 16-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-4=-60, 4-6=-60, 6-9=-60, 15-18=-20
Concentrated Loads (lb)
Vert: 4=-172 (F), 6=-124 (F), 13=-381 (F), 11=-88 (F), 21=-124 (F), 23=-124 (F), 24=-124 (F), 26=-124 (F), 27=-64 (F), 28=-64 (F), 29=-64 (F), 30=-64 (F)



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss B01	Truss Type Common	Qty 2	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619757
-----------------	--------------	----------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:22
ID:Bu112b5rY95GuSN5EDS9yFy6Ts8-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

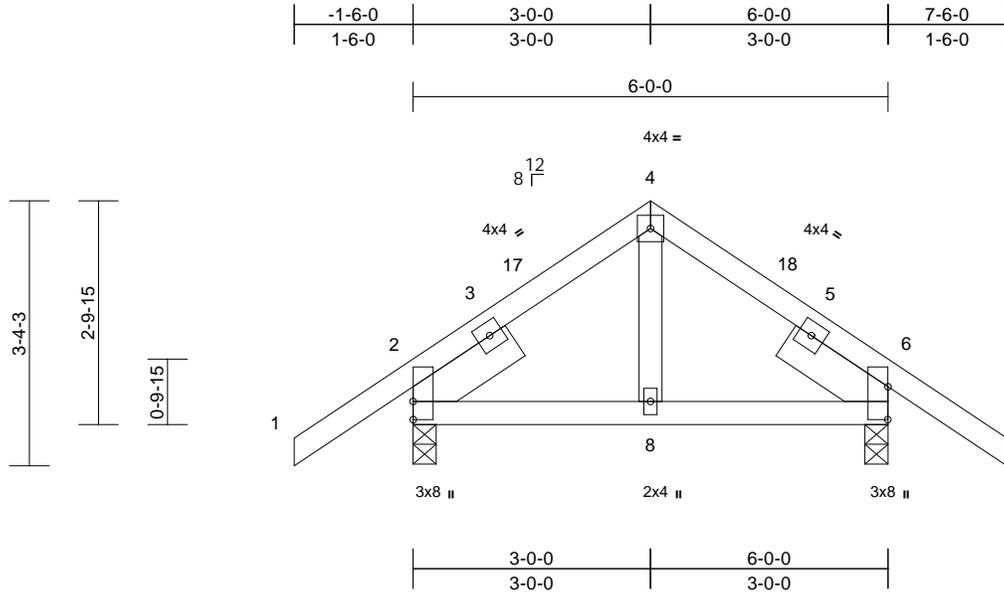

Scale = 1:29

Plate Offsets (X, Y): [2:Edge,0-0-1], [6:Edge,0-0-1]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.19	Vert(LL)	0.00	8-15	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.10	Vert(CT)	0.00	8-11	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 36 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.2
SLIDER	Left 2x6 SP No.2 -- 1-6-0, Right 2x6 SP No.2 -- 1-6-0

BRACING

TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	Rigid ceiling directly applied.

REACTIONS

(size)	2=0-3-8, 6=0-3-8
Max Horiz	2=-55 (LC 10)
Max Uplift	2=-65 (LC 12), 6=-65 (LC 12)
Max Grav	2=330 (LC 1), 6=330 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/50, 2-4=-193/132, 4-6=-193/114, 6-7=0/50
BOT CHORD	2-8=-8/142, 6-8=-1/142
WEBS	4-8=-21/106

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional) and C-C Zone3 -1-6-0 to 1-6-0, Zone1 1-6-0 to 3-0-0, Zone3 3-0-0 to 7-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 65 lb uplift at joint 2 and 65 lb uplift at joint 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss B02	Truss Type Common Supported Gable	Qty 1	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619758
-----------------	--------------	--------------------------------------	----------	----------	--	-----------


Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:23

Page: 1

LATERALLY BRACE TOP CHORD WITH PURLINS AT 2-0-0 o/c
IF STRUCTURAL SHEATHING IS NOT DIRECTLY APPLIED.

ID:1Cj8r8pw6n_6wGDNZ2?SiCy6Tpw-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

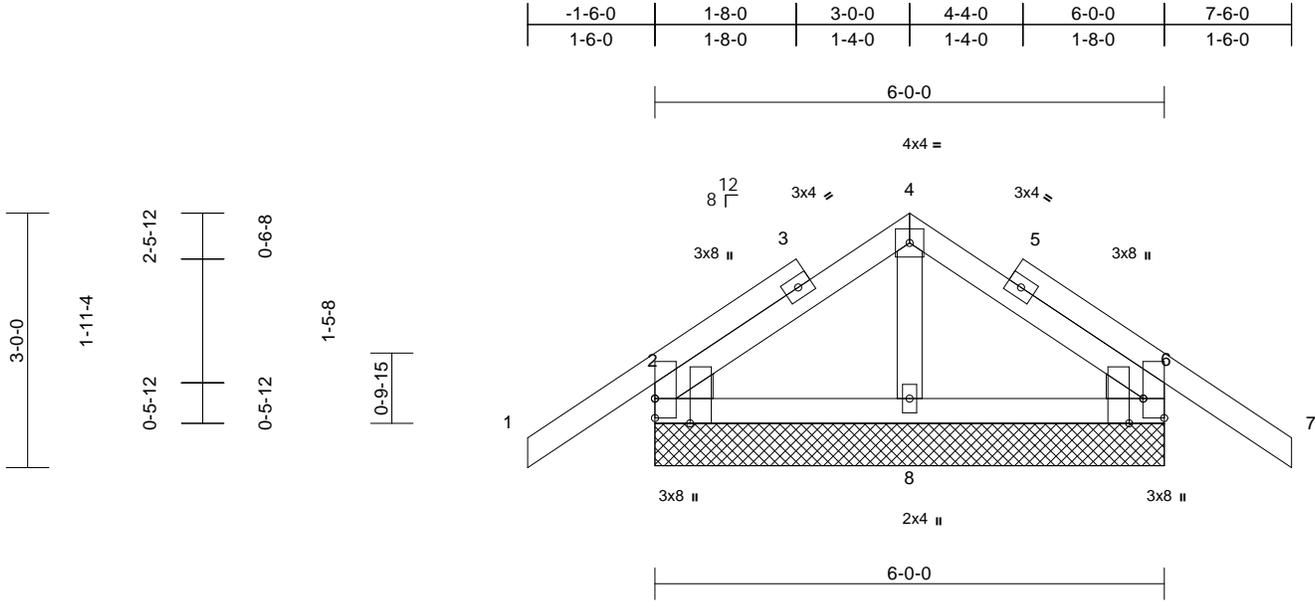

Scale = 1:27
Plate Offsets (X, Y): [2:0-3-8,Edge], [6:Edge,0-2-15], [6:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.17	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.09	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	6	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 36 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.2
WEDGE Left: 2x4 SP No.2
Right: 2x4 SP No.2

BRACING
TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.


REACTIONS (size) 2=6-0-0, 6=6-0-0, 8=6-0-0
Max Horiz 2=-49 (LC 10)
Max Uplift 2=-69 (LC 12), 6=-69 (LC 12)
Max Grav 2=221 (LC 23), 6=221 (LC 24),
8=233 (LC 17)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/43, 2-4=-52/47, 4-6=-52/51, 6-7=0/43
BOT CHORD 2-8=-56/116, 6-8=-56/116
WEBS 4-8=-158/110

- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 69 lb uplift at joint 2 and 69 lb uplift at joint 6.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 6.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp B; Partially Enclosed; MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - Gable requires continuous bottom chord bearing.

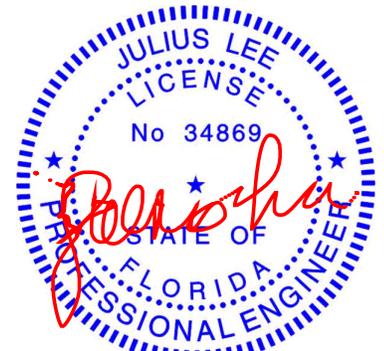

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss CJ01	Truss Type Diagonal Hip Girder	Qty 3	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619759
-----------------	---------------	-----------------------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:23
ID:E7EGmUz7MSp1DAF5A7U7jCy6TYy-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f

Page: 1

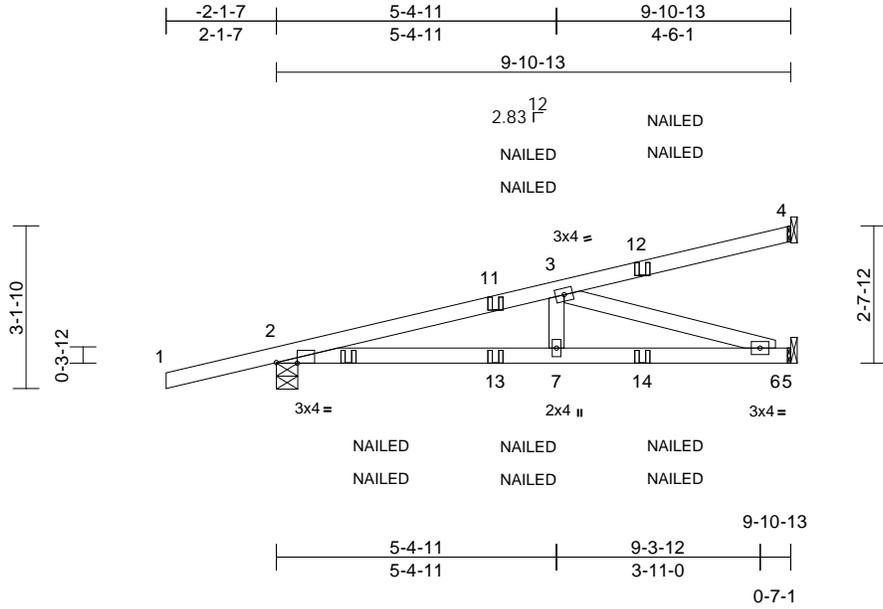

Scale = 1:44.1

Plate Offsets (X, Y): [2:0-4-13,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.39	Vert(LL)	-0.03	6-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.51	Vert(CT)	-0.08	6-7	>999	180		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.37	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS							Weight: 41 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2


BRACING
TOP CHORD Structural wood sheathing directly applied or 5-7-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-4-15, 4= Mechanical, 5= Mechanical
Max Horiz 2=74 (LC 8)
Max Uplift 2=-76 (LC 8), 4=-25 (LC 8)
Max Grav 2=527 (LC 1), 4=132 (LC 1), 5=346 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/29, 2-3=-1060/0, 3-4=-49/24
BOT CHORD 2-7=-3/1009, 6-7=0/1009, 5-6=0/0
WEBS 3-7=0/273, 3-6=-1055/0

- NOTES**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFERS (directional); cantilever left and right exposed ;
end vertical left and right exposed; Lumber DOL=1.60
plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 4 and 76 lb uplift at joint 2.
 - 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-4=-60, 5-8=-20
Concentrated Loads (lb)
Vert: 10=62 (F=31, B=31), 12=-79 (F=-40, B=-40), 13=-11 (F=-5, B=-5), 14=-62 (F=-31, B=-31)

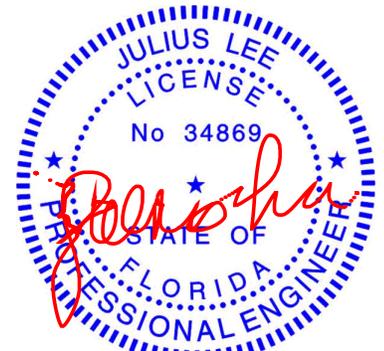

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss CJ01A	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619760
-----------------	----------------	-----------------------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:23
ID:3qfOAAASDxlrL0JInWXCWLeY6TYK-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRcDoi7J4zJC?f

Page: 1

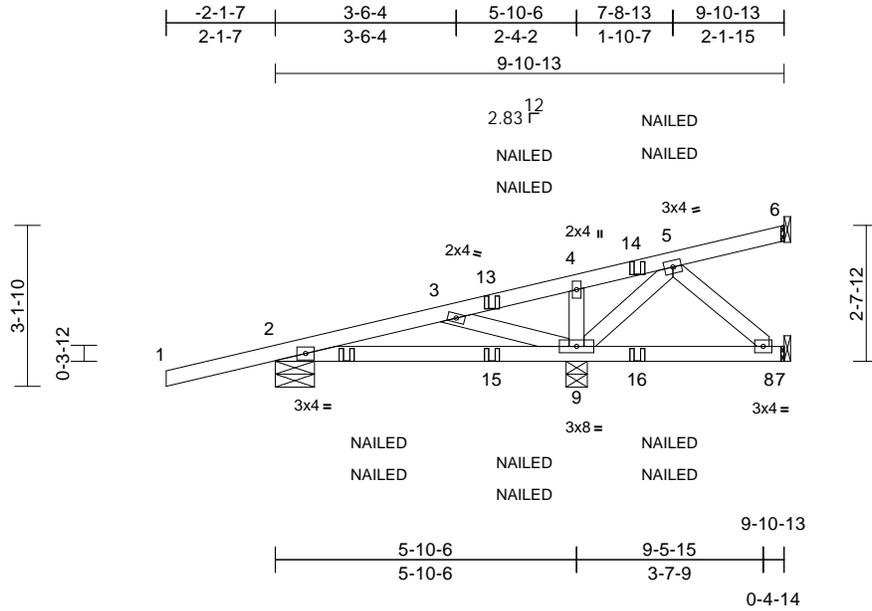

Scale = 1:44.6

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.33	Vert(LL)	0.01	9-12	>999	240	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.17	Vert(CT)	-0.02	9-12	>999	180	
BCLL	0.0*	Rep Stress Incr	NO	WB	0.04	Horz(CT)	0.00	7	n/a	n/a	
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MS						Weight: 46 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size) 2=0-9-2, 6= Mechanical, 7= Mechanical, 9=0-4-15
Max Horiz 2=74 (LC 8)
Max Uplift 2=-90 (LC 8), 6=-16 (LC 25), 7=-4 (LC 9), 9=-74 (LC 8)
Max Grav 2=296 (LC 1), 6=52 (LC 19), 7=52 (LC 1), 9=494 (LC 13)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/29, 2-3=-162/80, 3-4=-28/161, 4-5=-15/163, 5-6=-17/9
BOT CHORD 2-9=-80/146, 8-9=-22/39, 7-8=0/0
WEBS 3-9=-288/45, 4-9=-177/40, 5-9=-228/25, 5-8=-54/31

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust) Vasd=101mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 6, 90 lb uplift at joint 2, 4 lb uplift at joint 7 and 74 lb uplift at joint 9.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (lb/ft)
Vert: 1-6=-60, 7-10=-20
Concentrated Loads (lb)
Vert: 12=62 (F=31, B=31), 14=-67 (F=-28, B=-40), 15=-11 (F=-5, B=-5), 16=46 (F=77, B=-31)



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss J01	Truss Type Jack-Open	Qty 12	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619761
-----------------	--------------	-------------------------	-----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:23
ID:ixguZ8yVb8gAb0gvdQzuA?y6TYz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

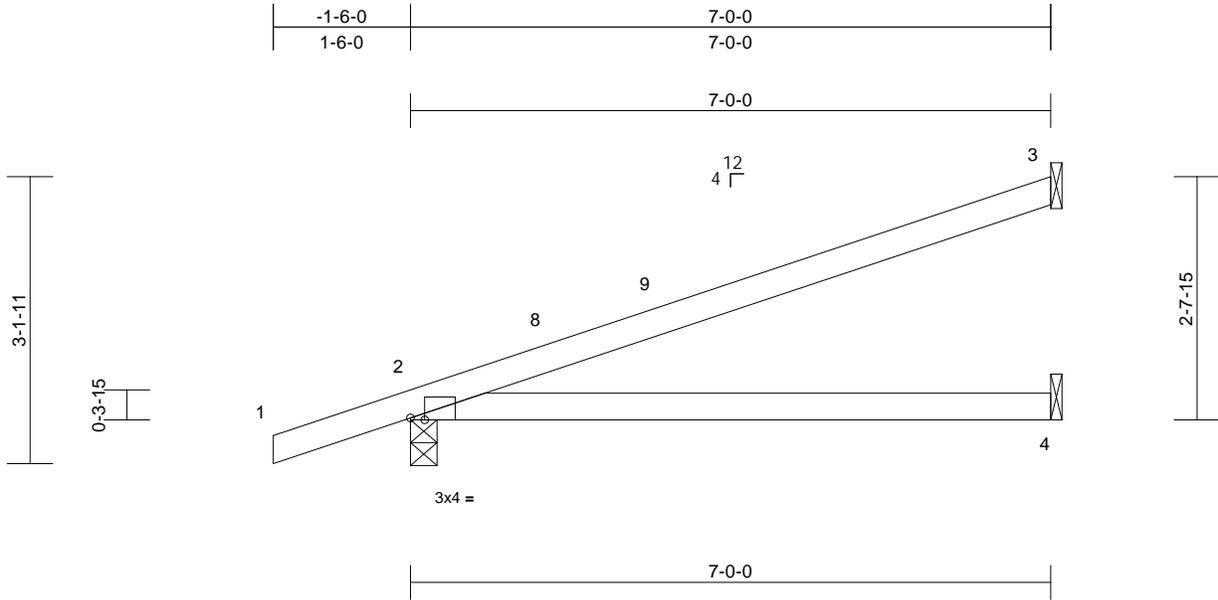

Scale = 1:25.1

Plate Offsets (X, Y): [2:0-1-14,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.59	Vert(LL)	0.09	4-7	>883	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.48	Vert(CT)	-0.20	4-7	>408	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 24 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 3= Mechanical, 4= Mechanical

Max Horiz 2=74 (LC 12)

Max Uplift 2=-32 (LC 12), 3=-33 (LC 12)

Max Grav 2=377 (LC 1), 3=184 (LC 1), 4=123 (LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/28, 2-3=-116/47

BOT CHORD 2-4=-39/113

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -1-6-0 to 1-6-0,
Zone1 1-6-0 to 6-11-4 zone; cantilever left and right
exposed; end vertical left and right exposed; C-C for
members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 33 lb uplift at joint
3 and 32 lb uplift at joint 2.

- 7) This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss J02	Truss Type Jack-Open	Qty 7	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619762
-----------------	--------------	-------------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:24
ID:lxguZ8yVb8gAb0gvdQzuA?y6TYz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

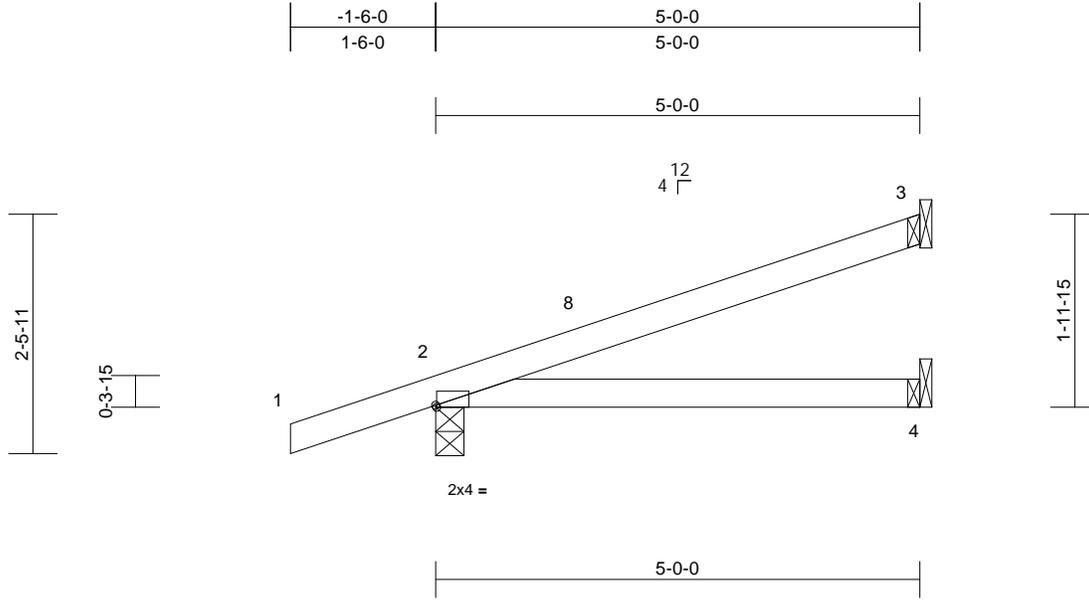

Scale = 1:23.7

Plate Offsets (X, Y): [2:0-0-2,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.27	Vert(LL)	0.03	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.23	Vert(CT)	-0.05	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 18 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS

(size) 2=0-3-8, 3= Mechanical, 4= Mechanical
Max Horiz 2=58 (LC 12)
Max Uplift 2=-36 (LC 12), 3=-21 (LC 12)
Max Grav 2=301 (LC 1), 3=124 (LC 1), 4=87 (LC 3)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/28, 2-3=-94/32
BOT CHORD 2-4=-24/76

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -1-6-0 to 1-6-0,
Zone1 1-6-0 to 4-11-4 zone; cantilever left and right
exposed ; end vertical left and right exposed;C-C
for members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 21 lb uplift at joint
3 and 36 lb uplift at joint 2.

7) This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss J02A	Truss Type Jack-Open	Qty 1	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619763
-----------------	---------------	-------------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:24
ID:3qfOAAASDxrlL0JlnWXCWLeY6TYK-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

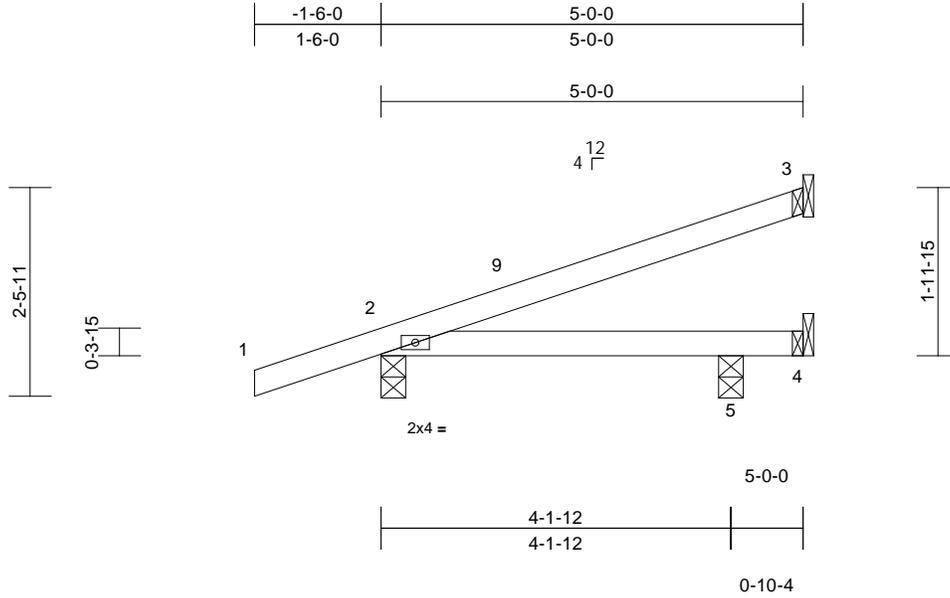

Scale = 1:27.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.22	Vert(LL)	0.02	5-8	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.23	Vert(CT)	-0.02	5-8	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-AS							Weight: 18 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS (size) 2=0-3-8, 3= Mechanical, 4= Mechanical, 5=0-3-8

Max Horiz 2=58 (LC 12)
Max Uplift 2=-72 (LC 12), 3=-26 (LC 12),
4=-90 (LC 1), 5=-33 (LC 12)
Max Grav 2=270 (LC 1), 3=113 (LC 1), 4=24
(LC 12), 5=210 (LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/28, 2-3=-69/28
BOT CHORD 2-5=-40/43, 4-5=0/0

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TCDL=6.0psf; BCCL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -1-6-0 to 1-6-0,
Zone1 1-6-0 to 4-11-4 zone; cantilever left and right
exposed; end vertical left and right exposed; porch left
exposed; C-C for members and forces & MWFRS for
reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- 2) Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 26 lb uplift at joint
3, 72 lb uplift at joint 2, 90 lb uplift at joint 4 and 33 lb
uplift at joint 5.
- 7) This truss design requires that a minimum of 7/16"
structural wood sheathing be applied directly to the top
chord and 1/2" gypsum sheetrock be applied directly to
the bottom chord.

LOAD CASE(S) Standard



Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss J03	Truss Type Jack-Open	Qty 8	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619764
-----------------	--------------	-------------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:24
ID:lxguZ8yVb8gAb0gvdQzuA?y6TYz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

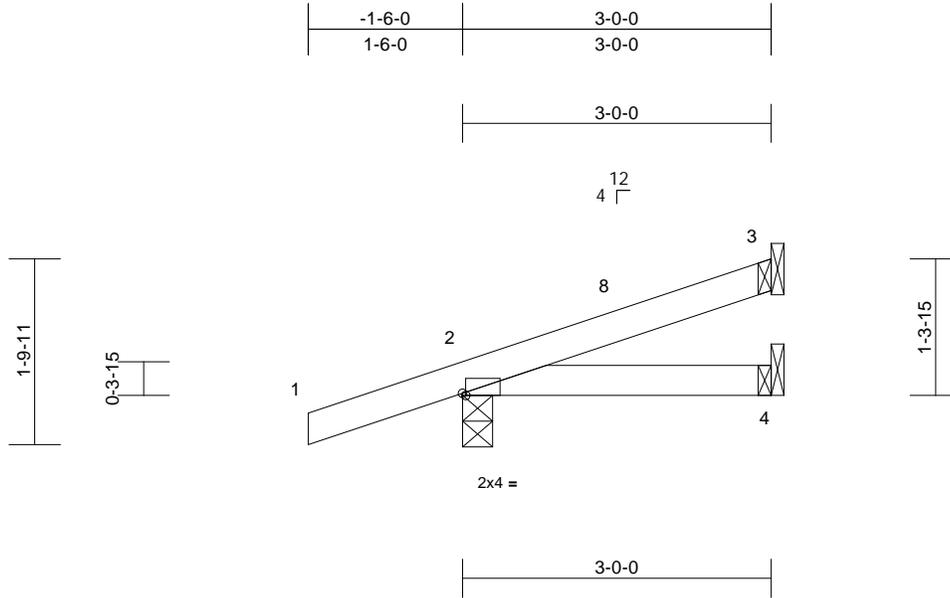

Scale = 1:22.3

Plate Offsets (X, Y): [2:0-0-6,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.15	Vert(LL)	0.00	4-7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.06	Vert(CT)	-0.01	4-7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 12 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-3-8, 3= Mechanical, 4= Mechanical
Max Horiz 2=42 (LC 12)
Max Uplift 2=-43 (LC 12), 3=-8 (LC 12)
Max Grav 2=230 (LC 1), 3=63 (LC 1), 4=49 (LC 3)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/28, 2-3=-90/16
BOT CHORD 2-4=-17/69

NOTES

- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
Vasd=101mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
MWFRS (directional) and C-C Zone3 -1-6-0 to 1-6-0,
Zone1 1-6-0 to 2-11-4 zone; cantilever left and right
exposed ; end vertical left and right exposed;C-C for
members and forces & MWFRS for reactions shown;
Lumber DOL=1.60 plate grip DOL=1.60
- 2) Building Designer / Project engineer responsible for
verifying applied roof live load shown covers rain loading
requirements specific to the use of this truss component.
- 3) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.

- 6) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 8 lb uplift at joint 3
and 43 lb uplift at joint 2.

LOAD CASE(S) Standard

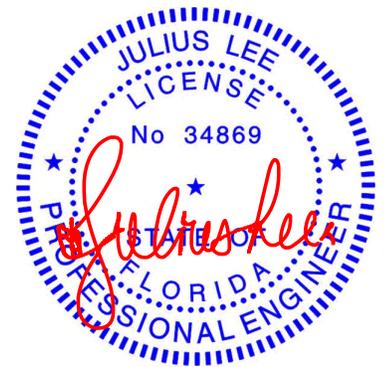

Julius Lee PE No. 34869
MiTek Inc. DBA MiTek USA FL Cert 6634
16023 Swingley Ridge Rd. Chesterfield, MO 63017
Date:

December 23, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job 1225-032	Truss J04	Truss Type Jack-Open	Qty 8	Ply 1	JOSEPH MISTRETTA Job Reference (optional)	T39619765
-----------------	--------------	-------------------------	----------	----------	--	-----------

Mayo Truss Company, Inc., Mayo, FL - 32066,

Run: 8.83 S Sep 3 2025 Print: 8.830 S Sep 3 2025 MiTek Industries, Inc. Mon Dec 22 09:35:24
ID:lxguZ8yVb8gAb0gvdQzuA7y6TYz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

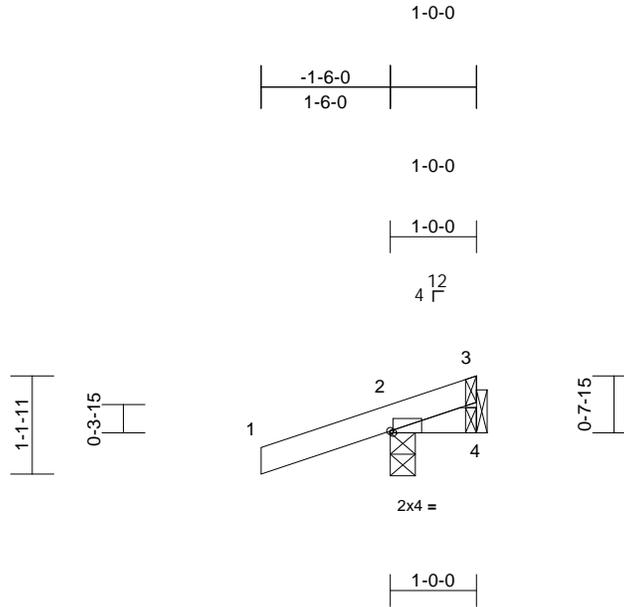

Scale = 1:26.6

Plate Offsets (X, Y): [2:0-0-6,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.25	TC	0.15	Vert(LL)	0.00	7	>999	240	MT20	244/190
TCDL	10.0	Lumber DOL	1.25	BC	0.02	Vert(CT)	0.00	7	>999	180		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	FBC2023/TPI2014	Matrix-MP							Weight: 6 lb	FT = 20%

LUMBER
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 1-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 4= Mechanical
 Max Horiz 2=26 (LC 12)
 Max Uplift 2=-67 (LC 12), 4=-35 (LC 1)
 Max Grav 2=197 (LC 1), 4=31 (LC 12)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/28, 2-3=-57/38
 BOT CHORD 2-4=-39/63

LOAD CASE(S) Standard

- NOTES**
- 1) Wind: ASCE 7-22; Vult=130mph (3-second gust)
 Vasd=101mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft;
 B=45ft; L=24ft; eave=4ft; Cat. II; Exp B; Enclosed;
 MWFRS (directional) and C-C Zone3 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Building Designer / Project engineer responsible for verifying applied roof live load shown covers rain loading requirements specific to the use of this truss component.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 67 lb uplift at joint 2 and 35 lb uplift at joint 4.



Julius Lee PE No. 34869
 MiTek Inc. DBA MiTek USA FL Cert 6634
 16023 Swingley Ridge Rd. Chesterfield, MO 63017
 Date:

December 23,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)


MiTek®
 16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

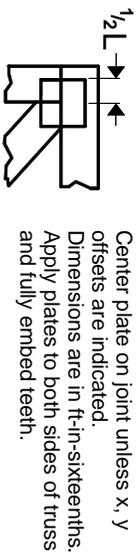

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

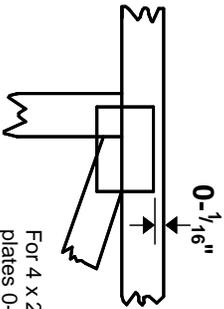

For 4 x 2 orientation, locate plates 0- 1/16\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in MITtek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

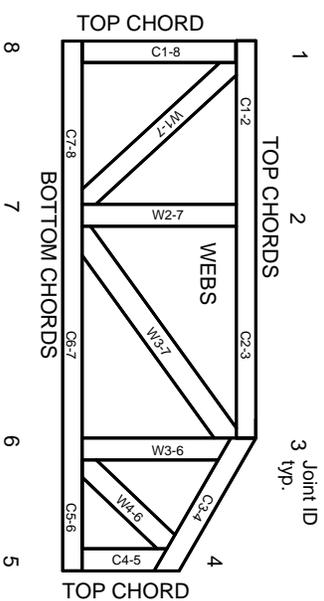

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1-1988, ESR-2-362, ESR-2-685, ESR-3-282
ESR-4-722, ESL-1-388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITtek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek®

MITtek Engineering Reference Sheet: Mill-7473 rev. 1/2/2023