



STATE OF FLORIDA  
DEPARTMENT OF HEALTH  
ONSITE SEWAGE TREATMENT AND DISPOSAL  
SYSTEM

PERMIT #: 12-SC-4068883  
APPLICATION #: AP2283753  
DATE PAID: \_\_\_\_\_  
FEE PAID: \_\_\_\_\_  
RECEIPT #: \_\_\_\_\_  
DOCUMENT #: PR2366491

CONSTRUCTION PERMIT FOR: OSTDS New  
APPLICANT: Paul\*\*26-0001 Davis  
PROPERTY ADDRESS: SW JOE MARKHAM Lake City, FL 32024  
LOT: 16 BLOCK: \_\_\_\_\_ SUBDIVISION: FORD LAND HIGHLANDS  
PROPERTY ID #: 00472016 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]  
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [ 1,050 ] GALLONS / GPD New Multi-Chambered Septic CAPACITY  
A [ ] GALLONS / GPD N/A CAPACITY  
N [ ] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]  
K [ ] GALLONS DOSING TANK CAPACITY [ ] GALLONS @ [ ] DOSES PER 24 HRS #Pumps [ ]

D [ 500 ] SQUARE FEET Drainfield SYSTEM  
R [ ] SQUARE FEET N/A SYSTEM  
A TYPE SYSTEM: [x] STANDARD [ ] FILLED [ ] MOUND [ ]  
I CONFIGURATION: [x] TRENCH [ ] BED [ ]

F LOCATION OF BENCHMARK: Oak tree east of site  
I ELEVATION OF PROPOSED SYSTEM SITE [ 24.00 ] [ INCHES / FT ] [ ABOVE / BELOW ] BENCHMARK/REFERENCE POINT  
E BOTTOM OF DRAINFIELD TO BE [ 52.00 ] [ INCHES / FT ] [ ABOVE / BELOW ] BENCHMARK/REFERENCE POINT

D FILL REQUIRED: [ 0.00 ] INCHES EXCAVATION REQUIRED: [ ] INCHES

O  
T  
H  
E  
R  
The system is sized for 4 bedrooms with a maximum occupancy of 8 persons (2 per bedroom), for a total estimated flow of 400 gpd.

SPECIFICATIONS BY: Robert Ford TITLE: Master Contractor

APPROVED BY:  TITLE: Environmental Specialist II Columbia CHD

DATE ISSUED: 01/09/2026 EXPIRATION DATE: 07/09/2027

DEP 4015, 06-21-2022 (Obsoletes previous editions which may not be used)  
Incorporated 62-6.004, FAC

STATE OF FLORIDA  
 DEPARTMENT OF ENVIRONMENTAL PROTECTION  
 APPLICATION FOR CONSTRUCTION PERMIT


1" = 40'

Permit Application Number

26-01

PART II - SITEPLAN

DAVIS

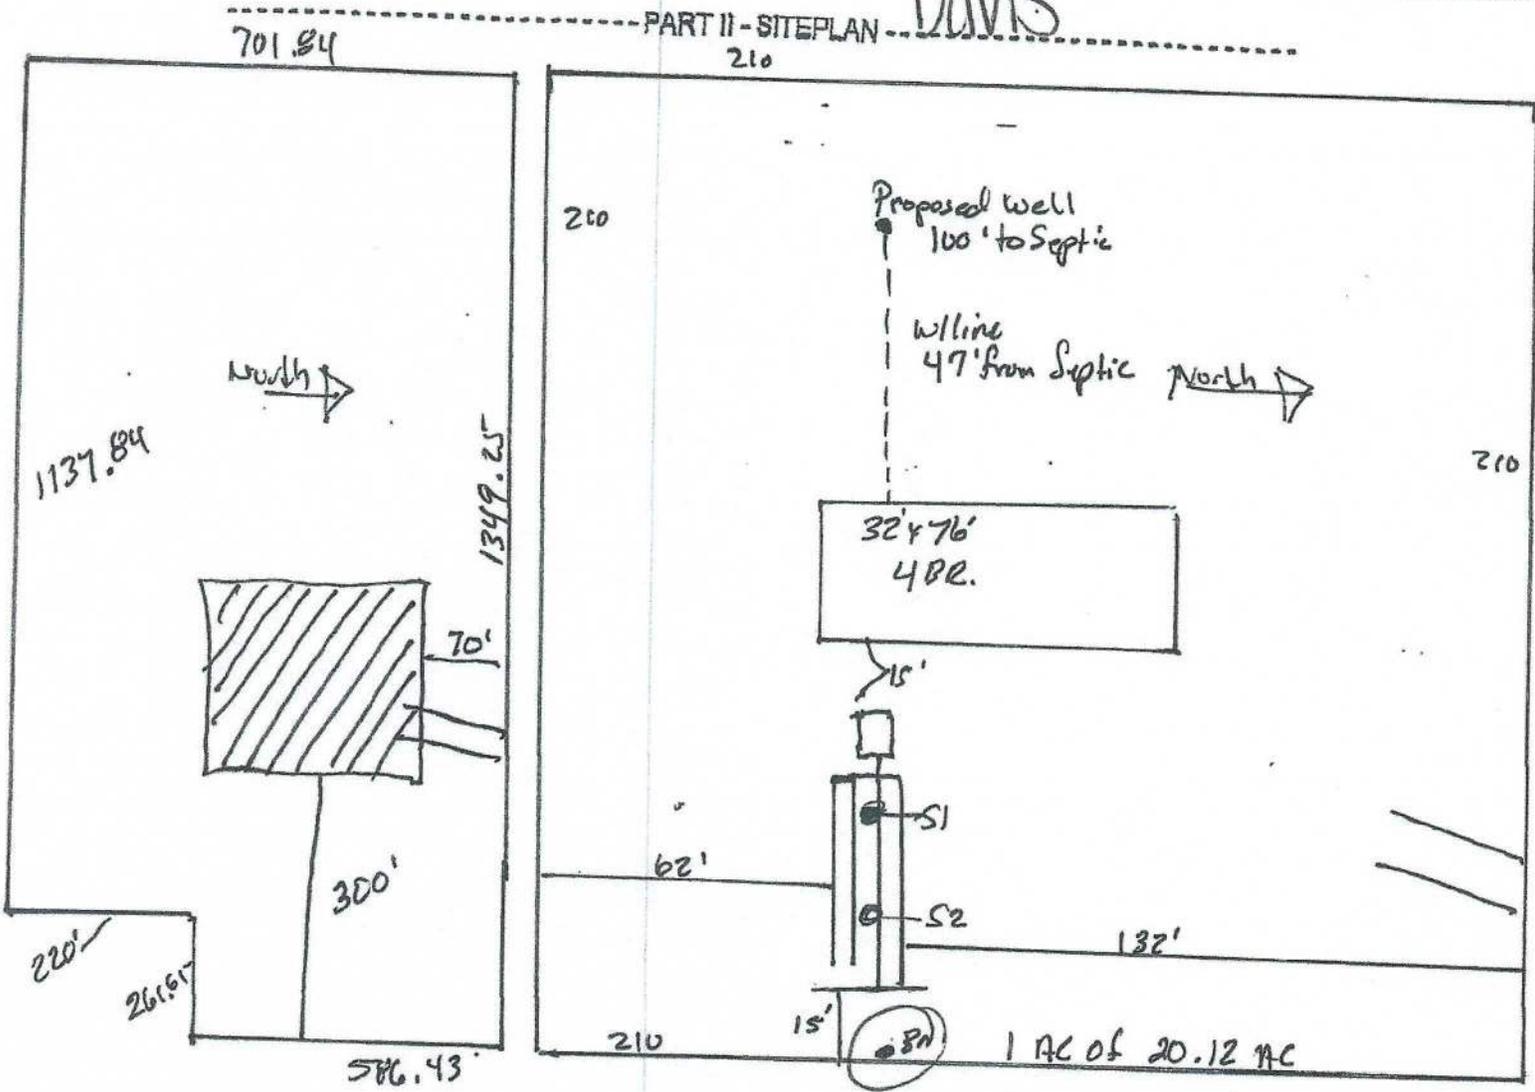

Notes:

Site Plan submitted by: Robert Ford 9999 1-2-2026

Plan Approved

Not Approved

Date 1/7/25

By [Signature]

Columbia

County Health Department

**ALL CHANGES MUST BE APPROVED BY THE COUNTY HEALTH DEPARTMENT**

DEP 4015, 06-21-2022 (Obsoletes previous editions which may not be used)  
 Incorporated: 62-6.004, F.A.C.



STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION  
ON-SITE SEWAGE TREATMENT AND DISPOSAL  
SYSTEM (OSTDS)

PERMIT NO. 26-01  
DATE PAID: 1-5-26  
FEE PAID: \$310.00  
RECEIPT #: \_\_\_\_\_

2283753

APPLICATION FOR CONSTRUCTION PERMIT

APPLICATION FOR:

New System     Existing System     Holding Tank     Innovative  
 Repair     Abandonment     Temporary     \_\_\_\_\_

APPLICANT: Paul & Jennifer Davis    EMAIL: NFLSEPTICTANK@COMCAST.NET

AGENT: ROBERT FORD III-NORTH FLORIDA SEPTIC TANK INC    TELEPHONE: 386-755-6372

MAILING ADDRESS: 741 SE STATE ROAD 100, LAKE CITY FL 32025

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3)(m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION    OSTDS REMEDIATION PLAN?  / N ]

LOT: 16    BLOCK: —    SUBDIVISION: Ford Land Highlands    PLATTED: \_\_\_\_\_

PROPERTY ID #: 24-55-15-00472-06    ZONING: SF    I/M OR EQUIVALENT: [ Y / N ]

PROPERTY SIZE: 20.2 ACRES    WATER SUPPLY:  PRIVATE    PUBLIC [ ] <=2000GPD [ ] >2000GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? [ Y / N ]    DISTANCE TO SEWER: \_\_\_\_\_ FT

PROPERTY ADDRESS: TBD SW JOE MARKHAM DR Lake City

DIRECTIONS TO PROPERTY: SR 47 South to CR 240 + 1/2 follow to SW Ichetucknee Ave + 1/2 follow to SW Joe Markham + 1/2 go to lot just before 612 SW Joe Markham Dr.

BUILDING INFORMATION     RESIDENTIAL    [ ] COMMERCIAL

Unit No.	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table I, Chapter 62-6, FAC
1	<u>MH</u>	<u>4</u>	<u>2034</u>	
2				
3				
4				

[ ] Floor/Equipment Drains    [ ] Other (Specify) \_\_\_\_\_

SIGNATURE: [Signature]

DATE: 1-2-2026

