

### General Roofing NOTES:

DECK REQUIREMENTS:  
ASPHALT SHINGLES SHALL BE FASTENED TO SOLIDLY SHEATHED DECKS.

SLOPE:  
ASPHALT SHINGLES SHALL BE USED ONLY ON ROOF SLOPES OF 2:12 OR GREATER. FOR ROOF SLOPES FROM 2:12 TO 4:12, DBL. UNDERLAYMENT IS REQUIRED.

UNDERLAYMENT:  
UNLESS OTHERWISE NOTED, UNDERLAYMENT SHALL CONFORM W/ ASTM D 226, TYPE I, OR ASTM D 4669, TYPE I.

SELF-ADHERING POLYMER MODIFIED BITUMEN SHEET:  
SELF ADHERING POLYMER MODIFIED BITUMEN SHALL COMPLY W/ ASTM D 1910.

ASPHALT SHINGLES:  
ASPHALT SHINGLES SHALL HAVE SELF SEAL STRIPS OR BE INTERLOCKING, AND COMPLY WITH ASTM D 226 OR ASTM D 3462.

FASTENERS:  
FASTENERS FOR ASPHALT SHINGLES SHALL BE GALVANIZED, STAINLESS STEEL, ALUMINUM OR COPPER ROOFING NAILS, MINIMUM 12 GAUGE SHANK WITH A MINIMUM 3/8 INCH DIAMETER HEAD, OF A LENGTH TO PENETRATE THROUGH THE ROOFING MATERIAL AND A MINIMUM 3/4" INTO THE ROOF SHEATHING, WHERE THE SHEATHING IS LESS THAN 3/4" THICK, THE NAILS SHALL PENETRATE THROUGH THE SHEATHING.

ATTACHMENT:  
ASPHALT SHINGLES SHALL BE SECURED TO THE ROOF WITH NOT LESS THAN FOUR FASTENERS PER SHINGLE OR TWO FASTENERS PER INDIVIDUAL SHINGLE WHERE ROOFS LOCATED IN BASIC WIND SPEED OF 110 MPH OR GREATER, SPECIAL METHODS OF FASTENING ARE REQUIRED. UNLESS OTHERWISE NOTED, ATTACHMENT OF ASPHALT SHINGLES SHALL CONFORM WITH ASTM D 3161 OR M-DC PA 101-95.

UNDERLAYMENT APPLICATION:  
FOR ROOF SLOPES FROM 2:12 TO 4:12, UNDERLAYMENT SHALL BE A MINIMUM OF TWO LAYERS APPLIED AS FOLLOWS:

1. STARTING AT THE EAVE, A 18 INCH STRIP OF UNDERLAYMENT SHALL BE APPLIED PARALLEL TO THE EAVE AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

2. STARTING AT THE EAVE, 36 INCH WIDE STRIPS OF UNDERLAYMENT FELT SHALL BE APPLIED OVERLAPPING SUCCESSIVE SHEETS 18 INCHES AND FASTENED SUFFICIENTLY TO STAY IN PLACE.

FOR ROOF SLOPES 4:12 AND GREATER, UNDERLAYMENT SHALL BE A MINIMUM OF ONE LAYER OF UNDERLAYMENT FELT APPLIED AS FOLLOWS:

STARTING AT THE EAVE, UNDERLAYMENT SHALL BE APPLIED SHINGLE FASHION PARALLEL TO THE EAVE, LAPPED 2 INCHES, AND FASTENED SUFFICIENTLY TO STAY IN PLACE.


BASE AND CAP FLASHING:  
BASE AND CAP FLASHING SHALL BE INSTALLED IN ACCORDANCE W/ MFG's INSTALLATION INSTRUCTIONS. BASE FLASHING SHALL BE OF EITHER CORROSION RESISTANT METAL OF MINIMUM NOMINAL THICKNESS 0.019 INCH OR MINERAL SURFACE ROLL ROOFING WEIGHING A MINIMUM OF 11 LBS PER 100 SQUARE FEET. CAP FLASHING SHALL BE CORROSION RESISTANT METAL OF MINIMUM NOMINAL THICKNESS OF 0.019 INCH.

VALLEYS:  
VALLEY LININGS SHALL BE INSTALLED IN ACCORDANCE W/ MANUFACTURER'S INSTALLATION INSTRUCTIONS BEFORE APPLYING ASPHALT SHINGLES. VALLEY LININGS OF THE FOLLOWING TYPES SHALL BE PERMITTED:

1. FOR OPEN VALLEYS LINED WITH METAL, THE VALLEY LINING SHALL BE AT LEAST 16" WIDE AND OF ANY OF THE CORROSION RESISTANT METALS IN FBC TABLE 1B013.9.2.


2. FOR OPEN VALLEYS, VALLEY LINING OF TWO PLYS OF MINERAL SURFACE ROLL ROOFING SHALL BE PERMITTED, THE BOTTOM LAYER SHALL BE 10 INCHES AND THE TOP LAYER A MINIMUM OF 36 INCHES WIDE.

3. FOR CLOSED VALLEYS, VALLEY LINING SHALL BE ONE OF THE FOLLOWING:  
1. BOTH TYPES 1 AND 2 ABOVE, COMBINED.  
2. ONE PLY OF SMOOTH ROLL ROOFING AT LEAST 36 INCHES WIDE AND COMPLYING WITH ASTM D 224.  
3. SPECIALTY UNDERLAYMENT AT LEAST 36 INCHES WIDE AND COMPLYING WITH ASTM D 1910.

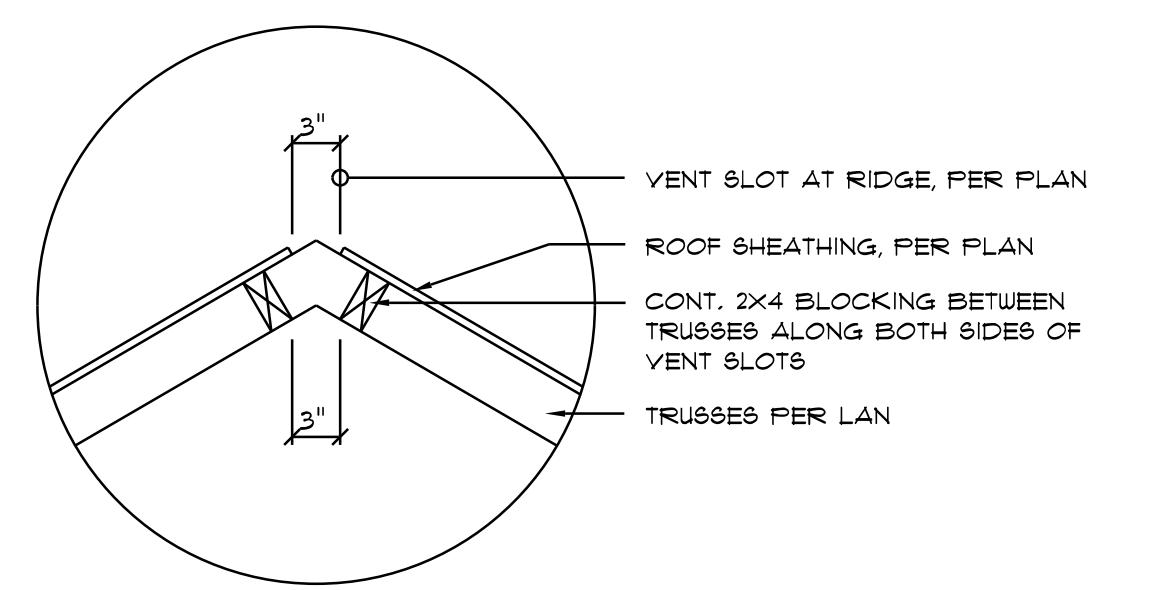


Vent DETAIL

A1

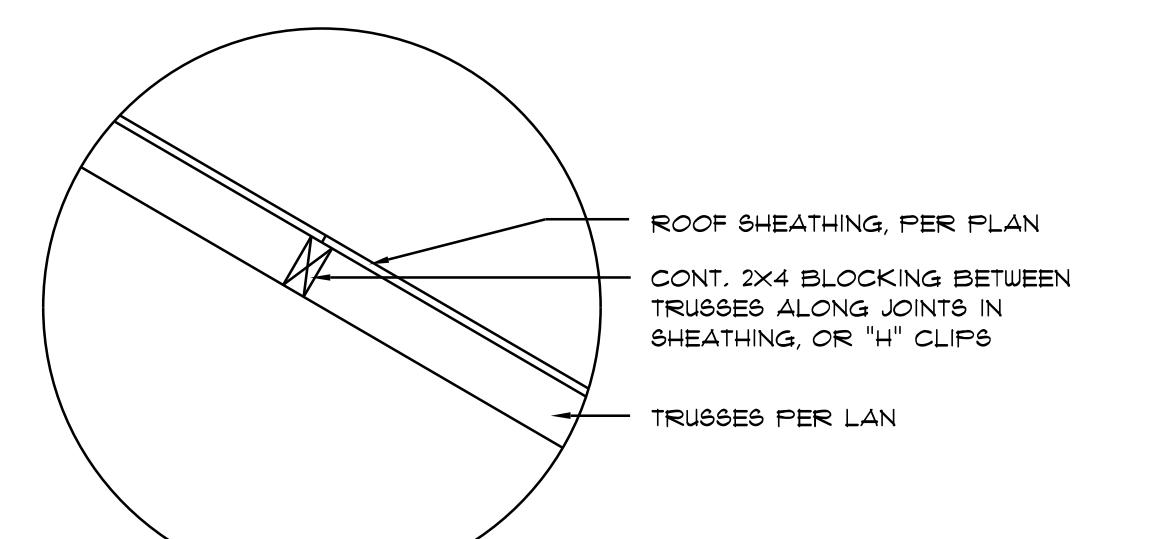


Joint DETAIL

A2

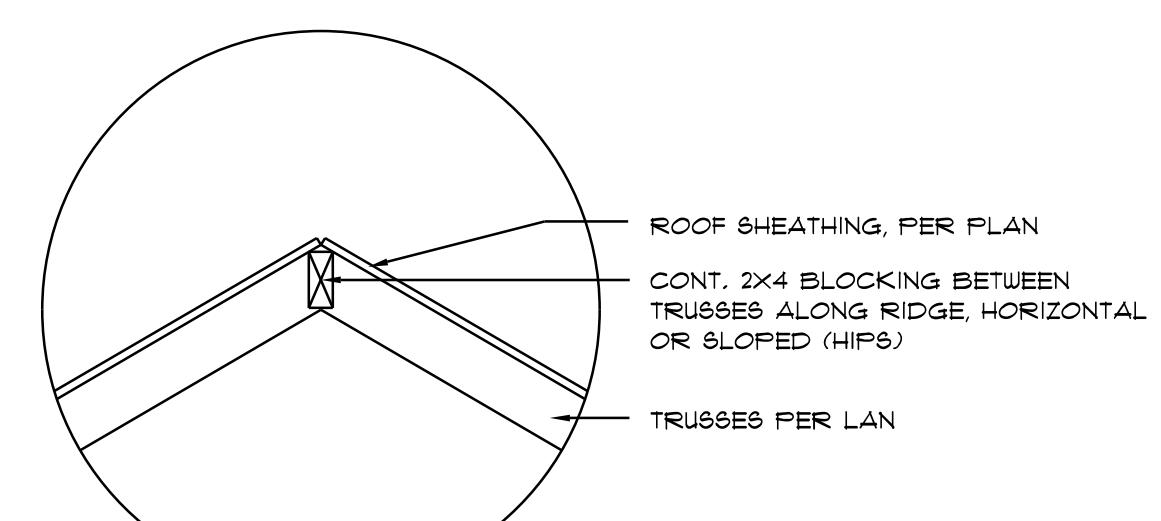


Ridge DETAIL

A3

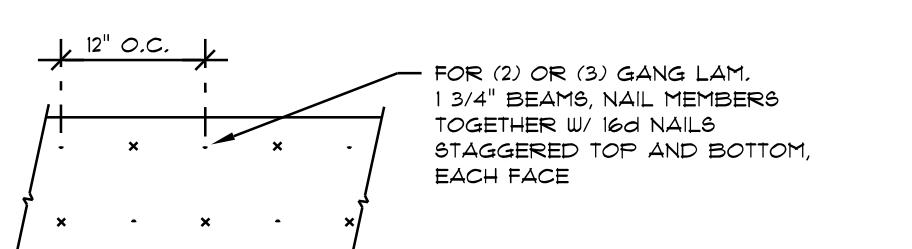

MULTIPLE GANG LAM. DETAIL

NOT TO SCALE

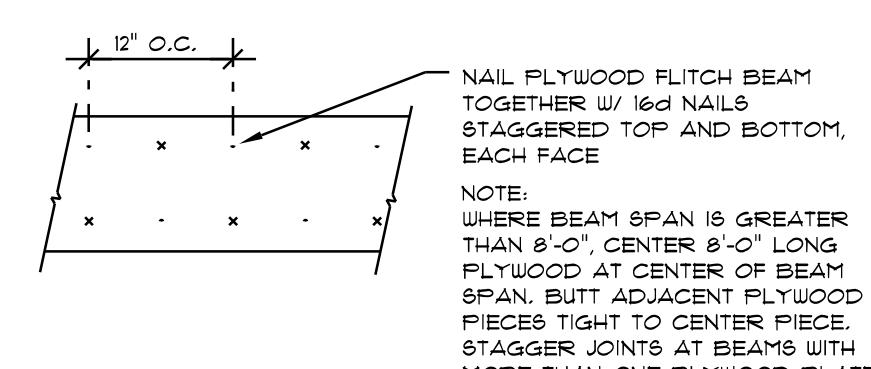


PLYWOOD FLITCH BEAM DETAIL

NOT TO SCALE

B/U Beam DETAILS

SCALE: NONE

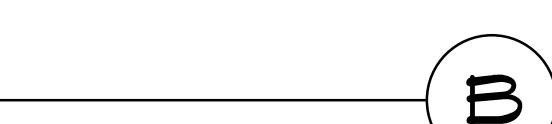

### FRAMING ANCHOR SCHEDULE

APPLICATION	MANUF./MODEL	CAP.
TRUSS TO WALL: GIRDER TRUSS TO POST/HEADER: HEADER TO KING STUD(S):	SIMPSON H2.5a or SDWC15600 SIMPSON LGT. W/ 28 - 16d NAILS SIMPSON ST22	600# 1725# 1370#
PLATE TO STUD: STUD TO SILL: PORCH BEAM TO POST: PORCH POST TO FND.:	NO CONNECTION REQ. WHEN USING WINDSTORM BOARD NO CONNECTION REQ. WHEN USING WINDSTORM BOARD SIMPSON FC44 or (2) 5/8" LAG BOLTS EA. POST SIMPSON ABU44	1100# 2200# 315/240#
MISC. JOINTS	SIMPSON A34	315/240#

NOTE:  
ALL ANCHORS SHALL BE SECURED W/ NAILS AS PRESCRIBED BY THE MANUFACTURER FOR MAXIMUM JOINT STRENGTH, UNLESS NOTED OTHERWISE.

NOTE:  
REFER TO THE INCLUDED STRUCTURAL DETAILS FOR ADDITIONAL ANCHORS/JOINT REINFORCEMENT AND FASTENERS.

NOTE:  
ALL UNLISTED JOINTS IN THE LOAD PATH SHALL BE REINFORCED WITH SIMPSON A34 FRAMING ANCHORS, TYPICAL T.O.

NOTE:  
"SEMCO" PRODUCT APPROVAL:  
MIAMI/DADE COUNTY REPORT #95-0218.15

NOTE:  
"SIMPSON" PRODUCT APPROVALS:  
MIAMI/DADE COUNTY REPORT #97-0101.05, #98-1126.11, #98-0623.04  
SBCCI NER-443, NER-393

### FLORIDA BUILDING CODE Compliance Summary

#### TYPE OF CONSTRUCTION

Roof: Gable Construction, Wood Trusses @ 24" O.C.  
Walls: 2x4 Wood Studs @ 16" O.C.  
Floor: 4" Trk. Concrete Slab w/ Fibermesh Concrete Additive  
Foundation: Continuous Footer/Slab Wall

#### ROOF DECKING

Material: 1/2" CDX Plywood or 7/16" O.S.B.  
Sheet Size: 48" x 96" Sheets Perpendicular to Roof Framing  
Fasteners: 1/8" RING SHANKED Nails per schedule on sheet 6.4

#### SHEWALLS

Material: 7/16" O.S.B. WINDSTORM BOARD  
Sheet Size: 48" x 96" Sheets Placed Vertical  
Fasteners: 1/8" COMMON Nails @ 2" O.C. Edges + 8" O.C. Interior  
Drillbit: Double Top Plate (S.T.P.) W/ 16d Nails @ 12" O.C.  
Wall Studs: 2x4 Studs @ 16" O.C.

#### HURRICANE UPLIFT CONNECTORS

True Anchors: SIMPSON H2.5a @ Ea. Truss End (Typ. U.O.N.)  
Wall Tension: Wall Sheathing Nailing is Adequate - 8d @ 4" O.C. Top + Bot.  
Anchor Bolts: 1/2" A307 Bolts @ 48" O.C. - 1st Bolt 6" from corner  
Corner Hold-down Device: (1) HD8a @ each corner  
Porch Column Base Connector: Simpson ABU66 @ each column  
Porch Column Beam Connector: Simpson MTA20 (2 ea. side) or Simpson EPC66 or 2 - 5/8" thru bolts

#### FOOTINGS AND FOUNDATIONS

Footing: 20" x 10" Cont. W/ 2 - 5" Bars Cont. on wire/plastic chairs @ 48" O.C.  
Stemwall: 8" C.M.U. W/ 5" Vertical Dowel @ 48" O.C.  
Int. Footings: 12" x 12" x Cont. W/ 2 - 5" Bars Cont. on wire/plastic chairs @ 48" O.C.

#### STRUCTURAL DESIGN CRITERIA:

1. THE DESIGN COMPLIES WITH THE REQUIREMENTS OF THE 2023 FLORIDA, 8th EDITION BUILDING CODE - SECTION 1609 AND OTHER REFERENCED CODES AND SPECIFICATIONS. ALL CODES AND SPECIFICATIONS SHALL BE LATEST EDITION AT TIME OF PERMIT.

2. WIND LOAD CRITERIA: RISK CATEGORY: 2, EXPOSURE: "B"

BASED ON ANSI/ASCE T-22, 2023 FBC 1609-A WIND VELOCITY:  $V_{ULT} = 130 \text{ MPH}$   
 $V_{ASD} = 101 \text{ MPH}$

3. ROOF DESIGN LOADS:  
SUPERIMPOSED DEAD LOADS: ..... 20 PSF  
SUPERIMPOSED LIVE LOADS: ..... 20 PSF

4. FLOOR DESIGN LOADS:  
SUPERIMPOSED DEAD LOADS: ..... 25 PSF  
SUPERIMPOSED LIVE LOADS:  
RESIDENTIAL ..... 40 PSF  
BALCONIES ..... 60 PSF


5. WIND NET UPLIFT: ARE AS INDICATED ON PLANS

BUILDING COMPONENTS & CLADDING LOADS  
MEAN BUILDING HEIGHT = 30.0', EXPOSURE "B"  
ROOF ANGLE T = 27°

ZONE	AREA	Vult 110 MPH		Vult 120 MPH		Vult 130 MPH		Vult 140 MPH	
		10	20	10	20	10	20	10	20
1	10	12.0 / -19.3	14.9 / -23.7	17.5 / -27.8	20.3 / -32.3	18.5 / -31.4	21.1 / -30.2		
1	20	11.4 / -19.4	13.6 / -23.0	16.0 / -27.0	19.8 / -31.4	18.1 / -30.2			
1	80	10.0 / -18.6	11.9 / -22.2	13.9 / -26.0					
2	10	12.5 / -34.7	14.9 / -41.3	17.5 / -48.4	20.3 / -56.2	18.5 / -51.1	21.1 / -45.1		
2	20	11.4 / -31.9	13.6 / -38.0	16.0 / -44.6	19.8 / -51.1	18.5 / -45.1			
2	80	10.0 / -28.2	11.9 / -33.6	13.8 / -39.3					
3	10	12.5 / -51.3	14.9 / -61.0	17.5 / -71.6	20.3 / -83.1	18.5 / -71.1	21.1 / -70.5		
3	20	11.4 / -41.9	13.6 / -51.1	16.0 / -61.0	19.8 / -71.1	18.5 / -60.8			
3	80	10.0 / -43.5	11.9 / -51.0	13.8 / -60.8					
4	10	21.8 / -23.6	25.9 / -34.7	30.4 / -43.0	35.3 / -48.2	31.7 / -36.7	34.1 / -41.2		
4	20	20.8 / -22.6	24.7 / -32.4	29.0 / -38.0	33.7 / -44.0	31.6 / -39.0			
4	80	19.5 / -21.3	23.2 / -29.4	27.2 / -32.8	31.2 / -34.3				

HEIGHT & EXPOSURE ADJUSTMENT COEFFICIENTS  
FOR BUILDING COMPONENTS & CLADDING

BLDG HEIGHT	EXPOSURE "B"	EXPOSURE "C"	EXPOSURE "D"
15	.82	1.21	1.41
20	.85	1.29	1.55
25	.94	1.35	1.61
30	1.00	1.40	1.66

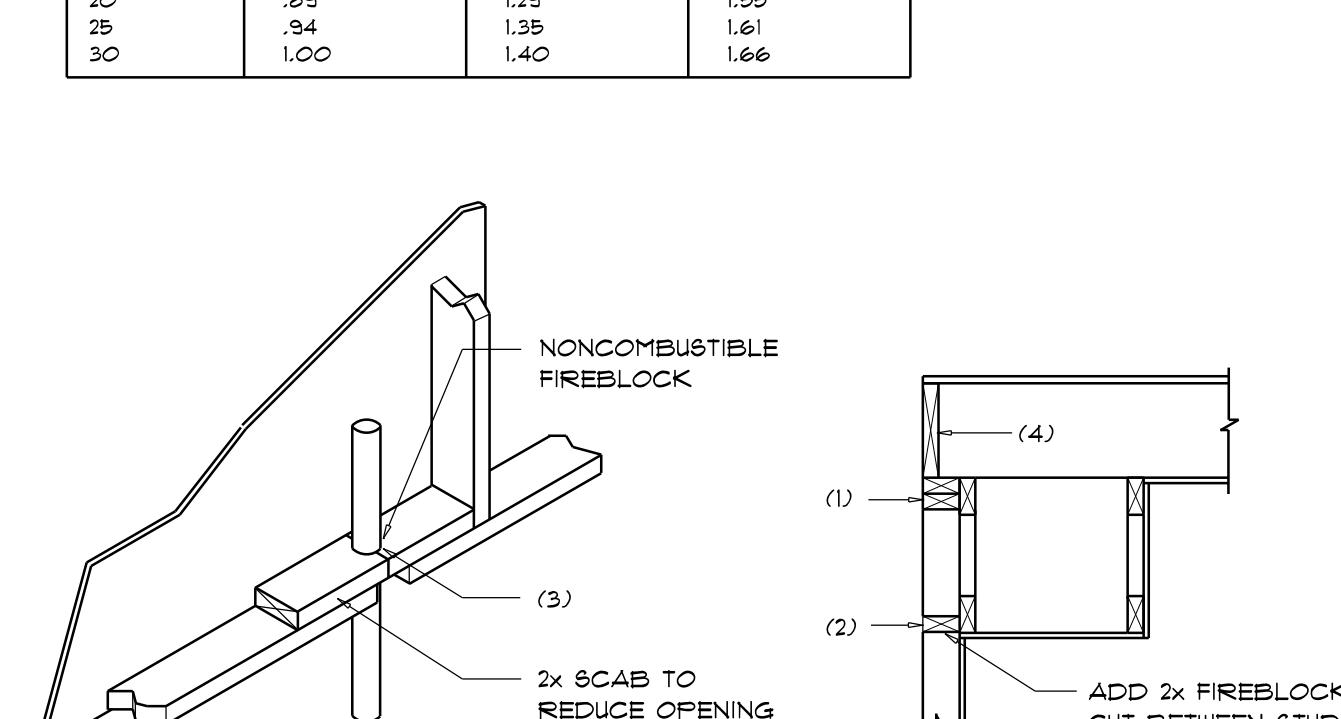

#### FIREBLOCKING NOTES:

FIREBLOCKING SHALL BE INSTALLED IN WOOD FRAME CONSTRUCTION IN THE FOLLOWING LOCATIONS: